



Florida Municipal Power Agency

Michele A. Jackson, P.E.
System Planning Manager

Florida Public Service Commission
Office of Commission Clerk
2540 Shumard Oak Blvd.
Tallahassee, FL 32399-0850

RECEIVED-FPSC
13 APR - 1 AM 9:04
COMMISSION
CLERK

130000-07

Re: FMPA's 2013 Ten Year Site Plan

April 1, 2013

Dear Sir/Madam:

Pursuant to Rule 25-22.071(1) Florida Administrative Code, FMPA is hereby submitting 25 copies of its 2013 Ten Year Site Plan in hardcopy format. An electronic version has also been sent to PELLIS@PSC.STATE.FL.US. If you have any questions, please do not hesitate to contact me at (321) 239-1013.

Sincerely,

Michele A. Jackson, P.E.
System Planning Manager

Enc.

cc. File

COM _____
AFD _____
APA _____
ECO _____
ENG 24 _____
GCL 1 _____
IDM _____
TEL _____
CLK _____

DOCUMENT NUMBER-DATE

01559 APR-1 2013

FPSC-COMMISSION CLERK

8553 Commodity Circle | Orlando, FL 32819-9002
T. (407) 355-7767 | Toll Free (888) 774-7606
F. (407) 355-5794 | www.fmpa.com
michele.jackson@fmpa.com



Florida Municipal Power Agency

Ten-Year Site Plan

April 2013

Community Power + Statewide Strength®

DOCUMENT NUMBER-DATE

01559 APR-13

FPSC-COMMISSION CLERK



Florida Municipal Power Agency

Ten-Year Site Plan 2013-2022

Submitted to

Florida Public Service Commission

April 1, 2013

Community Power + Statewide Strength®

DOCUMENT NUMBER-DATE

01559 APR-1 2013

FPSC-COMMISSION CLERK

FMPA

Table of Contents

Executive Summary	ES-1
Section 1 Description of FMPA	1-1
1.1 FMPA	1-1
1.2 All-Requirements Power Supply Project.....	1-2
1.3 Other FMPA Power Supply Projects.....	1-7
1.4 Summary of Projects	1-9
Section 2 Description of Existing Facilities	2-1
2.1 ARP Supply-Side Resources	2-1
2.2 ARP Transmission System	2-3
2.2.1 ARP Participant Transmission Systems.....	2-3
2.2.2 ARP Transmission Agreements.....	2-6
Section 3 Forecast of Demand and Energy for the All-Requirements Power Supply Project.....	3-1
3.1 Introduction	3-1
3.2 Load Forecast Process	3-1
3.3 2012 Load Forecast Overview.....	3-2
3.4 Methodology.....	3-2
3.4.1 Model Specifications	3-3
3.4.2 Projection of NEL and Peak Demand.....	3-4
3.5 Data Sources.....	3-5
3.5.1 Historical ARP Participant Retail Sales Data	3-5
3.5.2 Weather Data	3-5
3.5.3 Economic Data.....	3-5
3.5.4 Real Electricity Price Data.....	3-6
3.6 Overview of Results	3-6
3.6.1 Base Case Forecast	3-6
3.6.2 Weather-Related Uncertainty of the Forecast.....	3-6
3.7 Load Forecast Schedules	3-7
Section 4 Renewable Resources and Conservation Programs.....	4-1
4.1 Introduction	4-1
4.2 Renewable Resources.....	4-1
4.2.1 Solar Photovoltaic.....	4-1
4.2.2 Biomass.....	4-1
4.3 Conservation & Energy Efficiency Program.....	4-2
4.4 Net Metering Program	4-3
4.5 Load Management Program	4-3
Section 5 Forecast of Facilities Requirements	5-1
5.1 ARP Planning Process.....	5-1
5.2 Planned ARP Generating Facility Requirements	5-1

5.3 Capacity and Power Purchase Requirements 5-1
 5.4 Summary of Current and Future ARP Resource Capacity 5-2
 Section 6 Site and Facility Descriptions..... 6-1

List of Figures, Tables and Required Schedules

Table ES-1 FMPA ARP Summer 2013 Capacity Resources ES-2
 Figure ES-1 ARP Participants and FMPA Power Supply Resource Locations..... ES-3
 Figure 1-1 ARP Participant Cities..... 1-3
 Table 1-1 St. Lucie Project Participants..... 1-7
 Table 1-2 Stanton Project Participants..... 1-8
 Table 1-3 Tri-City Project Participants..... 1-8
 Table 1-4 Stanton II Project Participants 1-8
 Table 1-5 Summary of FMPA Power Supply Project Participants..... 1-9
 Table 2-1 ARP Supply-Side Resources Summer 2013..... 2-1
 Schedule 1 Existing Generating Facilities as of December 31, 2012..... 2-7
 Figure 3-1 Load Forecast Process 3-1
 Schedule 2.1 History and Forecast of Energy Consumption and Number of Customers by
 Customer Class 3-8
 Schedule 2.2 History and Forecast of Energy Consumption and Number of Customers by
 Customer Class 3-9
 Schedule 2.3 History and Forecast of Energy Consumption and Number of Customers by
 Customer Class 3-10
 Schedule 3.1 History and Forecast of Summer Peak Demand (MW) – Base Case 3-11
 Schedule 3.2 History and Forecast of Winter Peak Demand (MW) – Base Case 3-12
 Schedule 3.3 History and Forecast of Annual Net Energy for Load (GWh) – Base Case 3-13
 Schedule 3.1a Forecast of Summer Peak Demand (MW) – High Case 3-14
 Schedule 3.2a Forecast of Winter Peak Demand (MW) – High Case 3-15
 Schedule 3.3a Forecast of Annual Net Energy for Load (GWh) – High Case 3-16
 Schedule 3.1b Forecast of Summer Peak Demand (MW) – Low Case..... 3-17
 Schedule 3.2b Forecast of Winter Peak Demand (MW) – Low Case..... 3-18
 Schedule 3.3b Forecast of Annual Net Energy for Load (GWh) – Low Case 3-19
 Schedule 4 Previous Year and 2-Year Forecast of Peak Demand and Net Energy for
 Load by Month 3-20
 Table 5-1 Summary of All-Requirements Power Supply Project Resource Summer
 Capacity..... 5-3
 Table 5-2 Summary of All-Requirements Power Supply Project Resource Winter
 Capacity..... 5-4
 Schedule 5 Fuel Requirements – All-Requirements Power Supply Project 5-5
 Schedule 6.1 Energy Sources (GWh) – All-Requirements Power Supply Project 5-6
 Schedule 6.2 Energy Sources (%) – All-Requirements Power Supply Project..... 5-7

Schedule 7.1 Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Summer Peak..... 5-8

Schedule 7.2 Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Winter Peak 5-9

Schedule 8 Planned and Prospective Generating Facility Additions and Changes..... 5-10

Schedule 9 Status Report and Specifications of Proposed Generating Facilities..... 6-3

Schedule 10 Status Report and Specifications of Proposed Directly Associated Transmission Lines..... 6-4

Appendices

Appendix I List of Abbreviations.....I-1

Appendix II ARP Participant Transmission Information.....II-1

Appendix III Additional Reserve Margin Information III-1

FMPA

Executive Summary

The following information is provided in accordance with Florida Public Service Commission (PSC) Rules 25-22.070, 25-22.071, and 25-22.072, which require certain electric utilities in the State of Florida to submit a Ten-Year Site Plan (TYSP). The TYSP provides, among other things, a description of existing electric utility resources, a 10-year forecast of electric power generating needs and an identification of the general location and type of any proposed generation capacity and transmission additions for the next 10-year period.

The Florida Municipal Power Agency (FMPA or the Agency) is a project-oriented, joint-action agency. There are currently 31 Members of FMPA – each a municipal electric utility – located throughout the State of Florida. As a joint-action agency, FMPA facilitates opportunities for FMPA Members to participate in power supply projects developed by third-party Florida utilities and other power producers. For example, FMPA facilitated the participation of 15 FMPA Members in an 8.8 percent undivided ownership interest in the St. Lucie Nuclear Power Plant Unit No. 2, developed by Florida Power & Light Company (FPL). FMPA's direct responsibility for power supply is with the All-Requirements Power Supply Project (the ARP), where the Agency has committed to planning for and supplying all of the power requirements of 14 ARP Participants. FMPA's TYSP is focused on the resources of, and planning for, the ARP.

The total summer capacity of ARP resources for the year 2013 is 1,779 MW. This capacity is comprised of ARP Participant-owned resources, ARP Participant entitlements and ownership shares in nuclear, coal and gas-fired power plants located in the State of Florida, ARP owned resources and ownership shares in coal and gas-fired power plants located in the State of Florida, and power purchase agreements, and are summarized below in Table ES-1.

**Table ES-1
FMPA ARP Summer 2013 Capacity Resources**

Resource Category	Summer Capacity (MW)
Nuclear	57
ARP Ownership	1,126
ARP Participant Ownership	353
Power Purchases	243
Net Total 2013 ARP Resources	1,779

Based on the ARP’s 2013 Load Forecast, the ARP is expected to be able to meet its generation capacity requirements with existing resources through 2022. The projected peak native ARP summer load for 2013 is 1,264 MW and is forecast to increase to 1,381 MW in 2022. At this time, FMPA is planning to meet the ARP’s need for additional generation capacity in 2023 through a power purchase, or unit participation agreement from a supplier to be determined. FMPA will continue to evaluate and develop sufficient and cost-effective resource alternatives for the ARP through its integrated resource planning process.


In 2010, FMPA, on behalf of the ARP, responded to a Request for Proposals from the City of Quincy for providing full-requirements capacity and energy beyond Quincy’s entitlement in a Southeastern Power Administration (SEPA) Project. The ARP was awarded the Quincy contract for the term of January 1, 2011 through December 31, 2015. The ARP is expecting to provide a peak requirement of 26 MW to Quincy above its SEPA entitlement during the summer of 2013. The sale to Quincy increases the projected ARP load to 1,290 MW for the summer of 2013.

FMPA is actively involved in planning and developing new renewable energy resources and demand side resource opportunities consistent with, and in consideration of the planning requirements of the State of Florida and the Public Utility Regulatory Policies Act (PURPA). Currently, the ARP purchases renewable energy from a cogeneration

plant fueled by sugar bagasse, and utilizes landfill gas as a secondary fuel to supplement its coal fuel requirements. In December 2009, the ARP commissioned its first solar photovoltaic system, a jointly-owned 30 kW DC system located in Key West, FL. In addition, ARP-Participants are engaged in an ARP-sponsored energy conservation program, and several ARP-Participants are independently piloting Demand Side Management programs aimed at reducing their loads during peak energy usage periods.

A location map of the ARP Participants and FMPA's power resources as of December 31, 2012 is shown in Figure ES-1.

**Figure ES-1
ARP Participants and FMPA Power Supply Resource Locations**

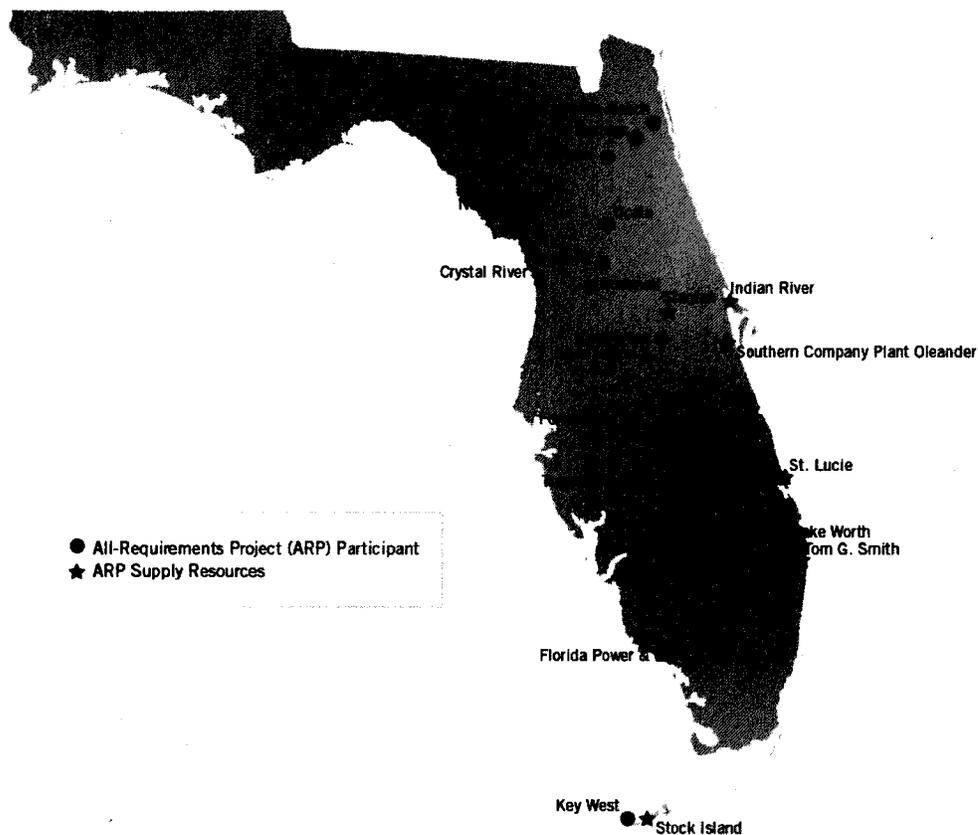

FMPA

Section 1 Description of FMPA

1.1 FMPA

Florida Municipal Power Agency (FMPA or the Agency) is a governmental wholesale power company owned by municipal electric utilities. FMPA provides economies of scale in power generation and related services to support community-owned electric utilities.

FMPA was created on February 24, 1978, by the signing of the Interlocal Agreement among its original members to provide a means by which its members could cooperatively gain mutual advantage and meet present and projected electric energy requirements. This agreement specifies the purposes and authority of FMPA. FMPA was formed under the provisions of the Florida Interlocal Cooperation Act of 1969, Section 163.01, Florida Statutes and the supplemental authority granted by the Joint Power Act, Part II, Chapter 361, Florida Statutes, implementing Article VII, Section 10 of the Florida Constitution.

The Interlocal Cooperation Act of 1969 authorizes municipal electric utilities to cooperate with each other on the basis of mutual advantage to provide services and facilities in a manner and in a form of governmental organization that will accord best with geographic, economic, population, and other factors influencing the needs and development of local communities. The Florida Constitution and the Joint Power Act provide the supplemental authority for municipal electric utilities to join together with public utilities, electric cooperatives, foreign public utilities and other persons, as defined, for the joint financing, constructing, acquiring, managing, operating, utilizing, and owning of electric power plants.

Each city commission and council, utility commission, board, or authority that is a signatory to the Interlocal Agreement has the right to appoint one member to FMPA's Board of Directors, the governing body of FMPA. The Board has the responsibility of approving FMPA's project budgets (except for the All-Requirements Power Supply Project budget which is approved by the FMPA Executive Committee), approving new projects and project financing (except for All-Requirements Power Supply Project financing which is approved by the FMPA Executive Committee), hiring a General Manager and General Counsel, establishing by-laws that govern how FMPA operates, and creating policies that implement such by-laws. At its annual meeting, the Board elects a Chairperson, Vice Chairperson, Secretary, and Treasurer.

The Executive Committee consists of 14 members, representing the 15 participants in the All-Requirements Power Supply Project (ARP)¹. The Executive Committee has the responsibility of approving the ARP budget and agency general budget, approving and financing ARP projects, approving ARP expenditures and contracts, and governs and manages the business and affairs of the ARP. At its annual meeting, the Executive Committee elects a Chairperson and Vice Chairperson.

1.2 All-Requirements Power Supply Project

FMPA developed the ARP to secure an adequate, economical, and reliable supply of electric capacity and energy as directed by FMPA Members. Currently, 15 FMPA Members (the ARP Participants) participate in the ARP. The geographical locations of the ARP Participants are shown in Figure 1-1.


Bushnell, Green Cove Springs, Jacksonville Beach, Leesburg, and Ocala were the original ARP Participants. The ARP began delivering capacity and energy to these original five participants in 1986. The remaining 10 ARP Participants joined as follows:

- 1991 – The City of Clewiston;
- 1997 – The Cities of Vero Beach and Starke;
- 1998 – Fort Pierce Utilities Authority (FPUA) and the Utility Board of City of Key West, Florida (KEYS)
- 2000 – The City of Fort Meade, the Town of Havana, and the City of Newberry; and
- 2002 – Kissimmee Utility Authority (KUA) and the City of Lake Worth.

ARP Participants are required to purchase all of their capacity and energy requirements from the ARP pursuant to the All-Requirements Power Supply Project Contract at a rate that is established by the Executive Committee to recover all ARP costs. Those ARP Participants that own generating resources, or entitlements and/or ownership shares in FMPA power supply projects or third-party developed power plants sell the electric capacity and energy of their resource entitlements and ownership shares to the ARP pursuant to a Capacity & Energy Sales Agreement between FMPA and the ARP Participant.

¹ As further discussed in this section, the City of Vero Beach has exercised the right to modify its ARP participation by implementation of a contract rate of delivery, which pursuant to contract terms has been calculated as 0 MW. While it remains a participant in the ARP, effective January 1, 2010, Vero Beach no longer is purchasing capacity and energy from the ARP and no longer has a representative on the Executive Committee.

**Figure 1-1
ARP Participant Cities**

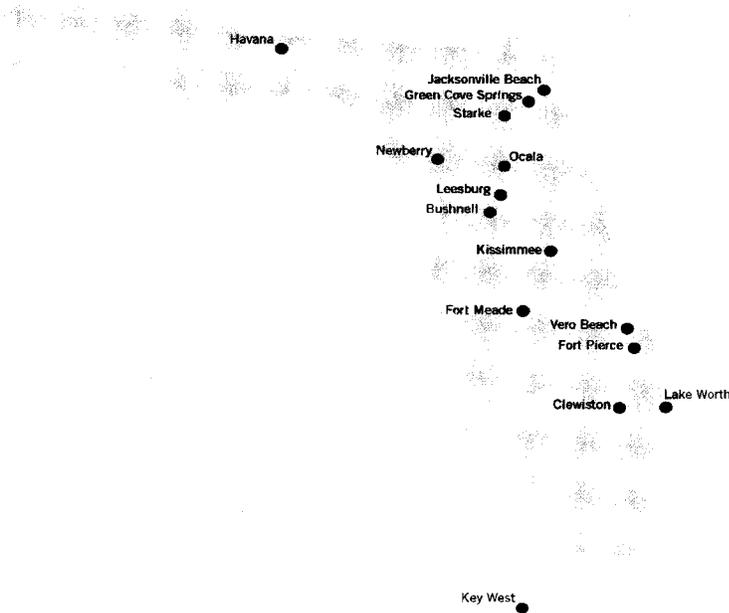

On December 9, 2004, the City of Vero Beach provided notice to FMPA, pursuant to the All-Requirements Power Supply Project Contract, that it was going exercise the right to modify its ARP full requirements membership and request and establish a Contract Rate of Delivery (CROD) which began January 1, 2010. On December 17, 2008, the City of Lake Worth provided notice to FMPA that it will exercise the right to modify its ARP full requirements membership and establish a CROD beginning January 1, 2014. In addition, on July 14, 2009, the City of Fort Meade provided notice to FMPA that it will also exercise its right to modify its full requirements membership and establish a CROD beginning January 1, 2015. The effect of these notices is that the ARP will no longer utilize these ARP Participants' generating resources (if any), and the ARP will commence serving up to a calculated maximum amount of capacity and energy for these ARP Participants (with these ARP participants being responsible for meeting all of their electric demand in excess of FMPA's obligation). The amount of the partial requirements for Vero Beach served by the ARP has been established as zero MW, and the amount of the partial requirements for the ARP to serve the Cities of Lake Worth and Fort Meade will be established in December of 2013 and 2014, respectively.

A brief description of each of the ARP Participants begins on the following page.

City of Bushnell

The City of Bushnell is located in central Florida in Sumter County. The City joined the ARP in May 1986. Vince Ruano is the City Manager and Bruce Hickie is the Director of Utilities. The City's service area is approximately 1.4 square miles. For more information about the City of Bushnell, please visit www.cityofbushnellfl.com.

City of Clewiston

The City of Clewiston is located in southern Florida in Hendry County. The City joined the ARP in May 1991. The City's FMPA representative, James L. Pittman, is a City Commissioner. The City's service area is approximately 5 square miles. For more information about the City of Clewiston, please visit www.cityofclewiston.org.

City of Fort Meade

The City of Fort Meade is located in central Florida in Polk County. The City joined the ARP in February 2000. Fred Hilliard is the City Manager. The City's service area is approximately 5 square miles. For more information about the City of Fort Meade, please visit www.cityoffortmeade.com.

Fort Pierce Utilities Authority

The City of Fort Pierce is located on Florida's east coast in St. Lucie County. FPUA joined the ARP in January 1998. William Thiess is the Director of Utilities. FPUA's service area is approximately 35 square miles. For more information about Fort Pierce Utilities Authority, please visit www.fpua.com.

City of Green Cove Springs

The City of Green Cove Springs is located in northeast Florida in Clay County. The City joined the ARP in May 1986. The City's FMPA representative, Robert Page, is a City Councilman. The City's service area is approximately 25 square miles. For more information about the City of Green Cove Springs, please visit www.greencovesprings.com.

Town of Havana

The Town of Havana is located in the panhandle of Florida in Gadsden County. The Town joined the ARP in July 2000. Howard McKinnon is the Town Manager. The Town's service area is approximately 5 square miles. For more information about the Town of Havana, please visit www.townofhavana.com.

City of Jacksonville Beach

The City of Jacksonville Beach is located in northeast Florida in Duval County. Jacksonville Beach's electric department, operating under the name Beaches Energy Services (Beaches), serves customers in Duval and St. Johns Counties. Beaches joined the ARP in May 1986. George D. Forbes is the City Manager and Roy Trotter is the Director of Electric Utilities. Beaches' service area is approximately 45 square miles. For more information about Beaches, please visit www.beachesenergy.com.

Utility Board of the City of Key West

The Utility Board of the City of Key West, Florida, doing business as Keys Energy Services (KEYS), provides electric service to the lower Keys in Monroe County. KEYS joined the ARP in April 1998. Lynne Tejada is the General Manager and CEO. KEYS' service area is approximately 45 square miles. For more information about Keys Energy Services, please visit www.keysenergy.com.

Kissimmee Utility Authority

The City of Kissimmee is located in central Florida in Osceola County. KUA joined the ARP in October 2002. James C. Welsh is the President & General Manager, CEO, and Larry Mattern is the Vice President of Power Supply. KUA's service area is approximately 85 square miles. For more information about KUA, please visit www.kua.com.

City of Lake Worth

The City of Lake Worth is located on Florida's east coast in Palm Beach County. Lake Worth joined the ARP in October 2002. Clay Lindstrom is the Acting Utility Director. Lake Worth's service area is approximately 12.5 square miles. For more information about the City of Lake Worth, please visit www.lakeworth.org.

City of Leesburg

The City of Leesburg is located in central Florida in Lake County. The City joined the ARP in May 1986. Paul Kalv is the Director of Electric Department. The City's service area is approximately 50 square miles. For more information about the City of Leesburg, please visit www.leesburgflorida.gov.

City of Newberry

The City of Newberry is located in north central Florida in Alachua County. The City joined the ARP in December 2000. Bill Conrad is the Mayor, and Blaine Suggs is the Utilities Director. The City's service area is approximately 3 square miles. For more information about the City of Newberry, please visit www.ci.newberry.fl.us.

City of Ocala

The City of Ocala, doing business as Ocala Utility Services, is located in central Florida in Marion County. The City joined the ARP in May 1986. Matthew J. Brower is the City Manager, and Larry M. Novak is the Assistant City Manager/Utility Services. The City's service area is approximately 161 square miles. For more information about Ocala Utility Services, please visit www.ocalaelectric.com.

City of Starke

The City of Starke is located in north Florida in Bradford County. The City joined the ARP in October 1997. Marc Oody is the Operations Manager. The City's service area is approximately 6.5 square miles. For more information about the City of Starke, please visit www.cityofstarke.org.

City of Vero Beach

The City of Vero Beach is located on Florida's east coast in Indian River County. Vero Beach joined the ARP in June 1997. Craig Fletcher is the Mayor. The City's service area is approximately 41 square miles. For more information about the City of Vero Beach, please visit www.covb.org.

1.3 Other FMPA Power Supply Projects

In addition to the ARP, FMPA facilitates the participation of FMPA Members in four other power supply projects as discussed below.

St. Lucie Project

On May 12, 1983, FMPA purchased from Florida Power & Light Company (FPL) an 8.806 percent undivided ownership interest in St. Lucie Unit No. 2 (the St. Lucie Project), a nuclear generating unit located in St. Lucie County. St. Lucie Unit No. 2 was declared in commercial operation on August 8, 1983, and in Firm Operation, as defined in the participation agreement, on August 14, 1983. Fifteen FMPA Members are participants in the St. Lucie Project, with the following entitlements to FMPA’s undivided ownership interest as shown in Table 1-1.

**Table 1-1
St. Lucie Project Participants**

City	% Entitlement	City	% Entitlement
Alachua	0.431	Clewiston	2.202
Fort Meade	0.336	Fort Pierce	15.206
Green Cove Springs	1.757	Homestead	8.269
Jacksonville Beach	7.329	Kissimmee	9.405
Lake Worth	24.870	Leesburg	2.326
Moore Haven	0.384	Newberry	0.184
New Smyrna Beach	9.884	Starke	2.215
Vero Beach	15.202		

Stanton Project

On August 13, 1984, FMPA purchased from the Orlando Utilities Commission (OUC) a 14.8193 percent undivided ownership interest in Stanton Unit No. 1. Stanton Unit No. 1 went into commercial operation July 1, 1987. Six FMPA Members are participants in the Stanton Project with entitlements to FMPA’s undivided interest as shown in Table 1-2.

**Table 1-2
Stanton Project Participants**

City	% Entitlement	City	% Entitlement
Fort Pierce	24.390	Homestead	12.195
Kissimmee	12.195	Lake Worth	16.260
Starke	2.439	Vero Beach	32.521

Tri-City Project

On March 22, 1985, the FMPA Board approved the agreements associated with the Tri-City Project, and FMPA purchased from OUC an additional 5.3012 percent undivided ownership interest in Stanton Unit No. 1. Three FMPA Members are participants in the Tri-City Project with the following entitlements as shown in Table 1-3.

**Table 1-3
Tri-City Project Participants**

City	% Entitlement
Fort Pierce	22.727
Homestead	22.727
Key West	54.546

Stanton II Project

On June 6, 1991, under the Stanton II Project structure, FMPA purchased from OUC a 23.2367 percent undivided ownership interest in OUC's Stanton Unit No. 2, a coal fired unit virtually identical to Stanton Unit No. 1. The unit commenced commercial operation in June 1996. Seven FMPA Members are participants in the Stanton II Project with the following entitlements as shown in Table 1-4.

**Table 1-4
Stanton II Project Participants**

City	% Entitlement	City	% Entitlement
Fort Pierce	16.4880	Homestead	8.2443
Key West	9.8932	Kissimmee	32.9774
St. Cloud	14.6711	Starke	1.2366
Vero Beach	16.4887		

1.4 Summary of Projects

Table 1-5 provides a summary of FMPA Member project participation as of December 31, 2012.

**Table 1-5
Summary of FMPA Power Supply Project Participants**

Agency Member	St. Lucie Project	Stanton Project	Tri-City Project	All-Requirements Power Supply Project	Stanton II Project
City of Alachua	X				
City of Bushnell				X	
City of Clewiston	X			X	
City of Ft. Meade	X			X	
Ft. Pierce Utilities Authority	X	X	X	X	X
City of Green Cove Springs	X			X	
Town of Havana				X	
City of Homestead	X	X	X		X
City of Jacksonville Beach	X			X	
Utility Board of the City of Key West			X	X	X
Kissimmee Utility Authority	X	X		X	X
City of Lake Worth	X	X		X	
City of Leesburg	X			X	
City of Moore Haven	X				
City of Newberry	X			X	
City of New Smyrna Beach	X				
City of Ocala				X	
City of St. Cloud					X
City of Starke	X	X		X	X
City of Vero Beach	X	X		X [1]	X

[1] Effective January 1, 2010, the City of Vero Beach exercised the right to modify its ARP full requirements membership (CROD).

FMPA

Section 2 Description of Existing Facilities

2.1 ARP Supply-Side Resources

The ARP supply-side resources consist of ARP Participant-owned resources, ARP Participant entitlements and ownership shares in nuclear, coal and gas-fired power plants located in the State of Florida, ARP owned resources and ownership shares in coal and gas-fired power plants located in the State of Florida, and power purchase agreements. The supply side resources for the ARP for the 2013 summer season are shown by ownership capacity in Table 2-1.

**Table 2-1
ARP Supply-Side Resources Summer 2013**

Resource Category	Summer Capacity (MW)
1) Nuclear	57
2) ARP Ownership	
Existing	1,126
New	-
Sub Total ARP Ownership	1,126
3) Participant Ownership	
KEYS	33
KUA	242
Lake Worth	78
Sub Total Participant Ownership	353
4) Power Purchases	243
Total 2013 ARP Resources	1,779

The resource categories shown in Table 2-1 are described in more detail below.

- 1) **Nuclear Generation:** A number of the ARP Participants have ownership interests in Progress Energy Florida’s Crystal River Unit 3 (CR3). Likewise, a number of ARP Participants participate in FMPA’s St. Lucie Project, and are entitled to capacity and

energy shares from St. Lucie Unit No. 2. Capacity from these two nuclear units is classified as "Excluded Power Supply Resources" in the All-Requirements Power Supply Project Contract between FMPA and the ARP Participants. As such, the ARP Participants pay their own costs associated with their ownership and/or entitlement in the nuclear units and individually receive the benefits of the capacity and energy from these units. The ARP provides the balance of capacity and energy requirements for these ARP Participants. As Excluded Power Supply Resources, ARP Participants' ownership shares or entitlements in the nuclear units are considered in the capacity planning for the ARP. On February 20th, 2013 Duke Energy (owner of Progress Energy Florida) certified to the NRC that it had permanently ceased operation and removed all fuel from the reactor vessel CR3, so no nuclear capacity is being attributed to CR3 as of January 1, 2013. However owners in CR3 will continue to receive a certain amount of replacement energy in 2013, per an agreement on an energy only basis.

- 2) **ARP Owned Generation:** This category includes generation that is wholly owned and operated by FMPA as agent for the ARP, specifically, Treasure Coast Energy Center, Stock Island Generating Facility, and Cane Island Unit 4. This category also includes ownership shares that the ARP acquired in OUC's Stanton Units 1 and 2 (separate from the Stanton and Stanton II Projects), OUC's Indian River Power Plant Units A through D, KUA's Cane Island Units 1-3 and Southern Company's Stanton Unit A. Lastly, this category includes generation entitlements assigned to the ARP by ARP Participants via their participation in other FMPA Power Supply Projects.
- 3) **Participant Owned Generation:** Capacity included in this category is generation wholly owned by the ARP Participants. The ARP purchases this capacity through Capacity and Energy Sales Agreements between FMPA and the ARP Participants, and then commits and economically dispatches this generation to meet the total requirements of the ARP.
- 4) **Power Purchases:** This category includes power purchases between FMPA, as agent for the ARP, and third-parties. Purchased power generation used to serve the ARP as of December 31, 2012 includes capacity and energy purchased from Southern Company and FPL. The FPL contract expires on June 1, 2013.

Information regarding existing ARP generation resources as of December 31, 2012, can be found in Schedule 1 at the end of this section.

2.2 ARP Transmission System

The Florida electric transmission grid is interconnected by high voltage transmission lines ranging from 69 KV to 500 KV. Peninsular Florida's electric grid is tied to the rest of the continental United States at the Florida/Georgia/Alabama interface. FPL, PEF, JEA and the City of Tallahassee own the transmission tie lines at the Florida/Georgia/Alabama interface. ARP Participants are interconnected to the transmission systems of FPL, PEF, OUC, JEA, Seminole Electric Cooperative, Florida Keys Electric Cooperative Association (FKEC), and Tampa Electric Company (TECO). Some ARP Participants own transmission facilities within their service territories, and the ARP has an ownership share of the transmission facilities associated with the Cane Island Power Plant.

The ARP transmits capacity and energy to the ARP Participants utilizing the transmission systems of FPL, PEF, and OUC. Capacity and energy for the Cities of Jacksonville Beach, Green Cove Springs, Clewiston, Fort Pierce, Key West, Lake Worth, and Starke are transmitted across FPL's transmission system. Capacity and energy for the Cities of Ocala, Leesburg, Bushnell, Newberry, Havana, and Ft. Meade are transmitted across the PEF transmission system. Capacity and energy for KUA is transmitted across the transmission systems of FPL, PEF and OUC. Sales to the City of Quincy are made across PEF's transmission system.

2.2.1 ARP Participant Transmission Systems

FPUA

FPUA is a municipally owned utility operating electric, water, wastewater, and natural gas utilities. The electric utility owns an internal, looped, 69kV transmission system for system load. There are two interconnections with other utilities, both at 138 kV. The FPUA's Hartman Substation interconnects to FPL's Hartman-Midway #1, Hartman-Midway #2, and Emerson via Fort Pierce Substations. The second interconnection is from the FPUA's Garden City (#2) Substation to County Line Substation No. 20 by a 7.5 mile, single circuit 138 kV line. FPUA and the City of Vero Beach jointly own County Line Substation, the 138 kV line connecting to Emerson Substation, and some parts of the tie between the two cities.

KEYS

KEYS owns and maintains an electric generation, transmission, and distribution system, which supplies electric power and energy south of FKEC's Marathon Substation to the City of Key West. KEYS and FKEC jointly own a 64 mile long 138 kV transmission tie line from FKEC's Marathon Substation that interconnects to FPL's Florida City Substation at the Dade/Monroe

County Line. In addition, a second interconnection with FPL was completed in 1995, which consists of a jointly owned 21 mile 138 kV tie line between the FKEC's Tavernier and Florida City Substations at the Dade/Monroe County line and is independently operated by FKEC. KEYS owns a 49.2 mile long 138 kV radial transmission line from Marathon Substation to KEYS' Stock Island Substation. Two autotransformers at the Stock Island Substation provide transformation between 138 kV and 69 kV. KEYS has six 69 kV and four 138 kV substations which supply power at 13.8 kV to its distribution system. KEYS owns approximately 227 miles of 13.8 kV distribution line. KEYS/FMPA has completed installing STATCOMS and shunt capacitors at Big Pine and Stock Island Substations in the summer of 2012. In addition, a series capacitor at Islamorada Substation is being planned with Florida Keys Electric Coop (FKEC) to be in operation by the summer of 2014. These projects will enable the Florida Keys (KEYS/FMPA and FKEC) to increase the import limit of the 138 kV transmission line to be equal to its thermal limit.

City of Lake Worth Utilities

The City of Lake Worth Utilities (LWU) owns and maintains an electric generation, transmission, and distribution system, which supplies electric power and energy in and around the City of Lake Worth. The total generating capability, located at the Tom G. Smith power plant is rated at approximately 78 MW (summer rating). LWU has one 138 kV interconnection with FPL at the LWU owned Hypoluxo Switching Station. A 3-mile radial 138 kV transmission line connects the Hypoluxo Switching Station to LWU's Main Plant Substation. In addition, a 2.4-mile radial 138 kV transmission line connects the Main Plant Substation to LWU's Canal Substation. Two 138/26 kV autotransformers are located at the Main Plant, and one 138/26 kV autotransformer is located at Canal Substation. The utility owns an internal 26 kV sub-transmission system to serve system load.

KUA

KUA serves a total area of approximately 85 square miles, and owns 24.6 circuit miles of 230 kV and 48.8 circuit miles of 69 kV transmission lines that deliver capacity and energy to 10 distribution substations. KUA and FMPA jointly own 21.6 circuit miles of 230 kV lines out of Cane Island Power Park. KUA has direct transmission interconnections with: (1) PEF at PEF's 230 kV Intercession City Substation, 69 kV Lake Bryan Substation, and 69 kV Meadow Wood East Substation; (2) OUC at OUC's 230 kV Taft Substation and TECO / OUC's 230 kV Osceola Substation from Cane Island Substation; and (3) the City of St. Cloud at KUA's 69 kV Carl A. Wall Substation.

Ocala Utility Services

Ocala Utility Services (OUS) owns its bulk power supply system which consists of three 230 kV to 69 kV substations, 13 miles of radial 230 kV transmission, 71.19 miles of a 69 kV transmission loop, and 18 distribution substations delivering power at 12.47 kV. The distribution system consists of 773 miles of overhead lines and 302 miles of underground lines.

OUS' 230 kV transmission system interconnects with PEF's Silver Springs Switching Station and Seminole Electric Cooperative, Inc.'s (SECI) Silver Springs North Switching Station. OUS' Dearmin Substation ties at PEF's Silver Springs Switching Station and OUS' Ergle and Shaw substations are tied at SECI's Silver Springs North Switching Station. OUS also has a 69 kV tie from the Airport Substation with Sumter Electric Cooperative's Martel Substation. In addition, OUS owns a 13 mile, radial 230 kV transmission line from Shaw Substation to Silver Springs North Switching Station. OUS completed this second 230 kV tie by rerouting the existing Shaw to Ergle 230 kV line from Shaw Substation to a direct radial connecting to SECI's Silver Springs North Switching Station.

City of Vero Beach

The City of Vero Beach owns a looped, 69 kV transmission system for system load and a 144 MW local power plant. Vero Beach has two 138 kV interconnections with FPL and one with FPUA. Vero Beach's interconnection with FPL is at Vero Beach's West Substation No. 7. Vero Beach also has a second FPL interconnection from County Line Substation No. 20. County Line Substation No. 20 is connected by two separate, single circuit, 138 kV transmission lines to FPL's Emerson 230/138 kV substation and FPUA's Garden City (No. 2) Substation. Vero Beach and FPUA jointly own County Line Substation No. 20, the connecting lines to FPL's Emerson Station, and some part of the tie between the two municipal utilities.

Beaches

Beaches owns the 230 kV Sampson transmission switching station that interconnects to FPL at FPL's Orangedale Substation and JEA at JEA's Switzerland Substation. Beaches has a second interconnection that ties to JEA's Neptune Beach Substation from its Penman Substation at 138 kV.

Three auto-transformers at Sampson substation provide transformation from 230 kV to 138 kV. Beaches has five 138 kV substations and five distribution substations, which deliver energy at 12.47 kV and 26.4 kV to its distribution system. Beaches owns 47.9 miles of 138 kV transmission lines.

City of Clewiston

The City of Clewiston owns the 138 kV McCarthy transmission switching station that interconnects to FPL at FPL's Okeelanta and Clewiston substations. Clewiston owns two 3.5 mile 138 kV transmission lines from its McCarthy substation to the City of Clewiston substation. Two transformers at the City of Clewiston substation provide transformation from 138 kV to 12.47 kV to its distribution system.

2.2.2 ARP Transmission Agreements

OUC provides transmission service for delivery of power associated with ARP Participants' or the ARP's entitlements in, ownership shares of or purchases from power plants interconnected to OUC's transmission system, including Stanton Unit 1, Stanton Unit 2, Stanton A combined cycle (CC), and the Indian River combustion turbine (CT) units, to the FPL and PEF interfaces for subsequent delivery to ARP Participants. Rates for such transmission wheeling service for the Stanton and Indian River units are pursuant to the terms and conditions of Firm Transmission Service Agreements between the ARP Participants, or the ARP, and OUC, and rates for transmission service for wheeling service for Stanton A are pursuant to OUC's OATT.

FMPA also has contracts with PEF and FPL for Network Integration Transmission Service that allow FMPA to integrate its resources to serve its load (those loads interconnected with either FPL or PEF) in a manner comparable to how FPL and PEF integrate resources to serve FPL and PEF native loads. The Network Service and Network Operating Agreements with FPL were executed in March 1996 and were subsequently amended to both conform to FERC's Pro forma Tariff and to add additional ARP Participants as points of delivery. The Network Service and Network Operating Agreements with PEF were executed and filed with FERC in January 2011.

**Schedule 1
Existing Generating Facilities as of December 31, 2012**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)		(13)
Plant Name	Unit No.	Location	Unit Type	Fuel Type		Fuel Transportation		Commercial In-Service MM/YY	Expected Retirement MM/YY	Gen. Max Nameplate MW	Net Capability		
				Primary	Alternate	Primary	Alternate				Summer (MW)	Winter (MW)	
Nuclear Capacity													
Crystal River	3	Cirus	NP	UR	-	TK	-	03/77	01/13	891	0	0	
St. Lucie	2	St Lucie	NP	UR	-	TK	-	08/83	NA	891	57	58	
Total Nuclear Capacity											57	58	
ARP Owned Generation													
Stanton Energy Center	1	Orange	ST	BIT	-	RR	-	07/87	NA	465	83	81	
Stanton Energy Center	2	Orange	ST	BIT	-	RR	-	06/96	NA	465	86	86	
Stanton Energy Center	A	Orange	CC	NG	DFO	PL	TK	10/03	NA	671	22	23	
Indian River	CT A	Brevard	GT	NG	DFO	PL	TK	06/89	NA	41	12	16	
Indian River	CT B	Brevard	GT	NG	DFO	PL	TK	07/89	NA	41	12	16	
Indian River	CT C	Brevard	GT	NG	DFO	PL	TK	08/92	NA	112	22	27	
Indian River	CT D	Brevard	GT	NG	DFO	PL	TK	10/92	NA	112	22	27	
Cane Island	1	Osceola	GT	NG	DFO	PL	TK	01/95	NA	40	17	19	
Cane Island	2	Osceola	CC	NG	DFO	PL	TK	06/95	NA	122	54	56	
Cane Island	3	Osceola	CC	NG	DFO	PL	TK	01/02	NA	280	120	125	
Cane Island	4	Osceola	CC	NG	DFO	PL	TK	08/11	NA	315	300	310	
Stock Island	CT2	Monroe	GT	DFO	-	WA	-	06/99	NA	21	15	15	
Stock Island	CT3	Monroe	GT	DFO	-	WA	-	06/99	NA	21	15	15	
Stock Island	GT4	Monroe	GT	DFO	-	WA	-	06/06	NA	61	45	45	
Treasure Coast	1	St Lucie	CC	NG	DFO	PL	TK	05/08	NA	315	300	310	
Total ARP Owned Generation											1,126	1,171	
Participant Owned Generation													
Kissimmee Utility Authority (TARP)													
Cane Island	1	Osceola	GT	NG	DFO	PL	TK	01/95	NA	40	17	19	
Cane Island	2	Osceola	CC	NG	DFO	PL	TK	06/95	NA	122	54	56	
Cane Island	3	Osceola	CC	NG	DFO	PL	TK	01/02	NA	280	120	125	
Stanton Energy Center	1	Orange	ST	BIT	-	RR	-	07/87	NA	465	21	21	
Stanton Energy Center	A	Orange	CC	NG	DFO	PL	TK	10/03	NA	671	22	23	
Indian River	CT A	Brevard	GT	NG	DFO	PL	TK	06/89	NA	41	4	5	
Indian River	CT B	Brevard	GT	NG	DFO	PL	TK	06/89	NA	41	4	5	
Sub Total KUA											242	254	

[1] Capabilities shown are as of December 31, 2012. The City of Vero Beach has exercised the right to modify its ARP full requirements membership. Effective January 1, 2010, the ARP will no longer utilize Vero Beach's generating resources, including its entitlement shares in the Stanton, Stanton II, and St. Lucie Projects. See Schedule 8 for information on the change in net capabilities for the ARP for these resources effective January 1, 2013.

Schedule 1 (Continued)
Existing Generating Facilities as of December 31, 2012

(1)	(2)	(3)	(4)	(5)		(7)		(9)	(10)	(11)	(12)		(13)
Plant Name	Unit No.	Location	Unit Type	Fuel Type		Fuel Transportation		Commercial In-Service MM/YY	Expected Retirement MM/YY	Gen. Max Nameplate MW	Net Capability		
				Primary	Alternate	Primary	Alternate				Summer (MW)	Winter (MW)	
Lake Worth													
Tom G. Smith	GT-1	Palm Beach	GT	DFO	-	TK	-	12/76	NA	31	26	27	
Tom G. Smith	GT-2	Palm Beach	CT	NG	DFO	PL	TK	03/78	NA	20	20	21	
Tom G. Smith	S-3	Palm Beach	ST	NG	RFO	PL	TK	11/67	NA	27	24	25	
Tom G. Smith	S-5	Palm Beach	CA	WH	-	-	-	03/78	NA	10	8	9	
Sub Total Lake Worth											78	82	
Keys Energy Services (TARP)													
Stock Island	CT1	Monroe	GT	DFO	-	WA	-	11/78	NA	20	18	18	
Stock Island MSD	MSD1	Monroe	IC	DFO	-	WA	-	06/91	NA	9	6	6	
Stock Island MSD	MSD2	Monroe	IC	DFO	-	WA	-	06/91	NA	9	7	7	
Stock Island	EP2	Monroe	IC	DFO	-	WA	-	??/12	NA	2	2	2	
Sub Total Keys											33	33	
Total Participant Owned Generation											353	369	
Total Generation Resources											1,537	1,598	

FMPA

Section 3 Forecast of Demand and Energy for the All-Requirements Power Supply Project


3.1 Introduction

To secure sufficient capacity and energy, FMPA forecasts each ARP Participant’s electrical power demand and energy requirements on an individual basis and aggregates the results into a forecast for the entire ARP. The following discussion summarizes the load forecasting process and the results of the load forecast contained in this Ten-Year Site Plan.

3.2 Load Forecast Process

FMPA prepares its load and energy forecast by month and summarizes the forecast annually, with updates during the year if warranted. The load and energy forecast includes projections of customers, demand, and energy sales by rate classification for each of the ARP Participants. Forecasts are prepared on an individual Participant basis and are then aggregated into projections of the total ARP demand and energy requirements. Figure 3-1 below identifies FMPA’s load forecast process.

**Figure 3-1
Load Forecast Process**

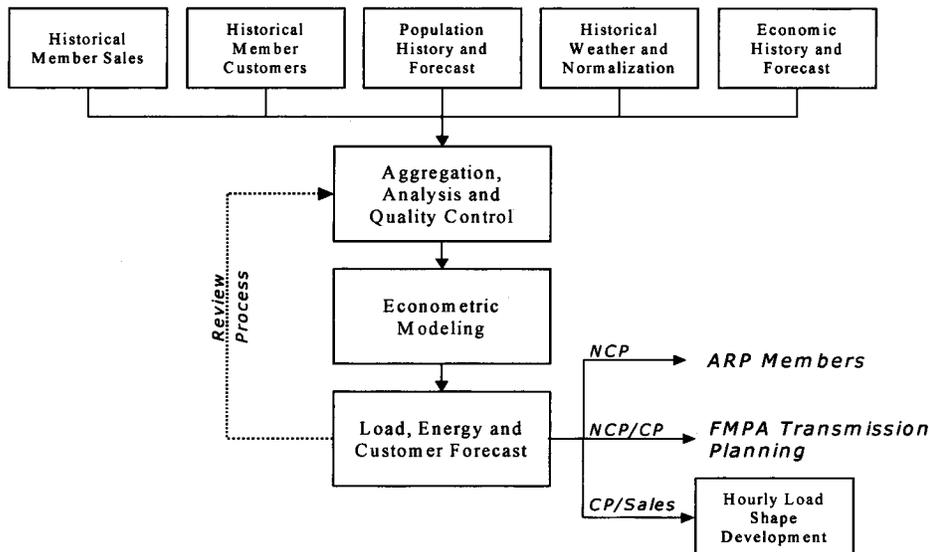

Note:

NCP is the Non-Coincident Peak demand, which represents the maximum hourly demand for a participant in a given month. CP is the Coincident Peak demand which represents the maximum hourly demand of the ARP system in aggregate, or the hourly demand of the ARP Participant at the time of the ARP CP.

In addition to the Base Case load and energy forecast, FMPA has prepared high and low case forecasts, which are intended to capture the majority of the uncertainty in certain driving variables, for each of the ARP Participants. The high and low load forecast scenarios are considered in FMPA's resource planning process. In this way, power supply plans are tested for their robustness under varying future load conditions.

3.3 2013 Load Forecast Overview

The load and energy forecast (Forecast) was prepared for a 20 year period, beginning fiscal year 2013 through 2032. The Forecast was prepared on a monthly basis using municipal utility data provided to FMPA by the ARP Participants and load data maintained by FMPA. Historical and projected economic and demographic data were provided by IHS Global Insight and Woods & Poole Economics, nationally recognized providers of such data. The Forecast also relied on information regarding local economic and demographic issues specific to each ARP Participant. Weather data was provided by the National Oceanic and Atmospheric Administration (NOAA) for a variety of weather stations in close proximity to the ARP Participants.

The Forecast reflects the City of Lake Worth's and the City of Fort Meade's establishment of Contract Rate of Delivery (CROD). The Forecast assumed that Lake Worth's CROD becomes effective on January 1, 2014; however, the results of the Forecast do not currently include any potential partial requirements load of Lake Worth that may be served by the ARP. The Forecast assumed that Fort Meade's CROD becomes effective on January 1, 2015; the results of the Forecast do currently include an estimate of the partial requirements load of Fort Meade that may be served by FMPA. The results of the Base Case forecast are discussed in Section 3.6.1.

In addition to the Base Case forecast, FMPA has prepared high and low forecasts to capture the uncertainty of weather. The methodology and results of the high (Severe) and low (Mild) weather cases are discussed in Section 3.6.2.

3.4 Methodology

The forecast of peak demand and net energy for load to be supplied from the ARP relies on an econometric forecast of each ARP Participant's retail sales, combined with various assumptions regarding loss, load, and coincidence factors, generally based on the recent historical values for such factors, which are then summed across the ARP Participants. Econometric forecasting makes use of regression to establish historical relationships between energy consumption and various explanatory variables based on fundamental economic theory and experience.

In this approach, the significance of historical relationships is evaluated using commonly accepted statistical measures. Models that, in the view of the analyst, best explain the historical variation of energy consumption are selected. These historical relationships are generally assumed to continue into the future, barring any specific information or assumptions to the contrary. The selected models are then populated with projections of explanatory variables, resulting in projections of energy requirements.

Econometric forecasting can be a more reliable technique for long-term forecasting than trend-based approaches and other techniques, because the approach results in an explanation of variations in load rather than simply an extrapolation of history. As a result of this approach, utilities are more likely to anticipate departures from historical trends in energy consumption, given accurate projections of the driving variables. In addition, understanding the underlying relationships which affect energy consumption allows utilities to perform scenario and risk analyses, thereby improving decisions. The Severe and Mild Cases are examples of this capability.

Forecasts of monthly sales were prepared by rate classification for each ARP Participants. In some cases, rate classifications were combined to eliminate the effects of class migration or redefinition. In this way, greater stability is provided in the historical period upon which statistical relationships are based.

3.4.1 Model Specifications

The following discussion summarizes the development of econometric models used to forecast load, energy sales, and customer accounts on a monthly basis. This overview will present a common basis upon which each classification of models was prepared.

For the residential class, the analysis of electric sales was separated into residential usage per customer and the number of customers, the product of which is total residential sales. This process is common for homogenous customer groups. The residential class models typically reflect that energy sales are dependent on, or driven by: (i) the number of residential customers, (ii) real personal income per household, (iii) real electricity prices, and (iv) weather variables. The number of residential customers was projected on the basis of the estimated historical relationship between the number of residential customers of the ARP Participants and the number of households in each ARP Participant's county.

The non-residential electricity sales models reflect that energy sales are best explained by: (i) real retail sales, total personal income, or gross domestic product (GDP) as a measure of

economic activity and population in and around the ARP Participant's service territory, (ii) the real price of electricity, and (iii) weather variables. For certain large non-residential customers, the forecast was based on assumptions developed in consultation with the Participants (e.g., Clewiston and Key West).

Weather variables include heating and cooling degree days for the current month and for the prior month. Lagged degree day variables are included to account for the typical billing cycle offset from calendar data. In other words, sales that are billed in any particular month are typically made up of electricity that was used during some portion of the current month and of the prior month.

3.4.2 Projection of NEL and Peak Demand

The forecast of sales for each rate classification described above were summed to equal the total retail sales of each ARP Participant. An assumed loss factor, typically based on a 5-year average of historical loss factors, was then applied to the total sales to derive monthly NEL. To the extent historical loss factors were deemed anomalous, they were excluded from these averages.

Projections of summer and winter non-coincident peak (NCP) demand were developed by applying projected annual load factors to the forecasted net energy for load on a total ARP Participant system basis. The projected load factors were based on the average relationship between annual NEL and the seasonal peak demand generally over the period 1999-2012.

Monthly peak demand was based on the average relationship between each monthly peak and the appropriate seasonal peak. This average relationship was computed after ranking the historical demand data within the summer and winter seasons and reassigning peak demands to each month based on the typical ranking of that month compared to the seasonal peak. This process avoids distortion of the averages due to randomness as to the months in which peak weather conditions occur within each season. For example, a summer peak period typically occurs during July or August of each year. It is important that the shape of the peak demands reflects that only one of those two months is the peak month and that the other is typically some percentage less.

Projected coincident peak demands related to the total ARP, the ARP Participant groups, and the transmission providers were derived from monthly coincidence factors averaged generally over a 5-year period (2008-2012). The historical coincidence factors are based on historical coincident peak demand data that is maintained by FMPA. Similarly, the timing of the total ARP and ARP Participant group peaks was determined from an appropriate summation of the hourly load data.

3.5 Data Sources

3.5.1 Historical ARP Participant Retail Sales Data

Data was generally available and analyzed over January 1992 through September 2012 (Study Period). Data included historical customer counts, sales, and revenues by rate classification for each of the ARP Participants.

3.5.2 Weather Data

Historical weather data was provided by the National Climatic Data Center (a subsidiary of the National Oceanic and Atmospheric Administration) (NCDC), which was generally used to supplement an existing weather database maintained by FMPA. Weather stations, from which historical weather was obtained, were selected by their quality and proximity to the ARP Participants. In most cases, the closest “first-order” weather station was the best source of weather data. First-order weather stations (usually airports) generally provide the highest quality and most reliable weather data. In two cases (Beaches and FPUA), however, weather data from a “cooperative” weather station, which was closer than the closest first-order station, appeared to more accurately reflect the weather conditions that affect the ARP Participants’ loads, based on statistical measures, than the closest first-order weather station.

The influence of weather on electricity sales has been represented through the use of two data series: heating and cooling degree days (HDD and CDD, respectively). Degree days are derived by comparing the average daily temperature and a base temperature, 65 degrees Fahrenheit. To the extent the average daily temperature exceeds 65 degrees Fahrenheit, the difference between that average temperature and the base is the number of CDD for the day in question. Conversely, HDD result from average daily temperatures which are below 65 degrees Fahrenheit. Heating and cooling degree days are then summed over the period of interest, in this case, months.

Normal weather conditions have been assumed in the projected period. Thirty-year normal monthly HDD and CDD are based on average weather conditions from 1981 through 2010, as reported by NOAA.

3.5.3 Economic Data

IHS Global Insight and Woods & Poole Economics, both nationally recognized providers of economic data, provided both historical and projected economic and demographic data for each of the 15 counties in which the ARP Participants’ service territories reside (the service territory of Beaches includes portions of both Duval and St. Johns Counties). This data includes county

population, households, employment, personal income, retail sales, and gross domestic product. Although all of the data was not necessarily used in each of the forecast equations, each was examined for its potential to explain changes in the ARP Participants' historical electric sales.

3.5.4 Real Electricity Price Data

The real price of electricity was derived from a twelve month or multi-year moving average of real average revenue. Projected electricity prices were assumed to increase at the rate of inflation. Consequently, the real price was projected to be essentially constant.

3.6 Overview of Results

3.6.1 Base Case Forecast

The results of the Forecast show that the net energy for load (NEL) to be supplied to ARP Participants is expected to grow at an annual average growth rate of 0.9% from 2013-2022, and at 1.5% from Fiscal Year 2023-2032. The Base Case 2013 ARP forecast summer peak demand is 1,264 MW and forecast annual NEL for Calendar Year 2013 is 6,129 GWh. (These values do not include the Quincy Sale and are measured at each ARP Participant's delivery point, or "city gate".)

FMPA's ARP has entered into a five year contract with the City of Quincy (Quincy) to provide all of its bulk power requirements which are above and beyond purchases from Southeastern Power Administration (SEPA). Quincy's load forecast was developed by FMPA staff and was based on Quincy monthly historical peaks and energy for 2008 through 2009. Monthly distribution ratios were developed and then projected forward taking into account Quincy's SEPA contract and escalated at 1.2% annually. Quincy's 2013 forecast summer peak demand requirement from the ARP is 26 MW, and forecast annual NEL for Calendar Year 2013 is 116 GWh.

The combination of Quincy's energy requirements from the ARP and the requirements of ARP Participants results in a 2013 forecast summer peak demand of 1,290 MW and a Calendar Year NEL forecast of 6,246 GWh.

3.6.2 Weather-Related Uncertainty of the Forecast

In addition to the Base Case forecast, which relies on normal weather conditions, FMPA has developed high and low forecasts, referred to herein as the Severe and Mild weather cases, intended to capture the volatility resulting from weather variations in the summer and winter seasons equivalent to 90 percent of potential occurrences. Accordingly, load variations due to

weather should be outside the resulting “band” between the Mild and Severe weather cases less than 1 out of 10 years. For this purpose, the summer and winter seasons were assumed to encompass June through September and December through February, respectively.

The potential weather variability was developed using weather data specific to each weather station generally over the period 1971-2012. These weather scenarios simultaneously reflect more and less severe weather conditions in both seasons, although this is less likely to happen than severe conditions in one season or the other. Accordingly, it should be recognized that annual NEL may be somewhat less volatile than the annual NEL variation shown herein. Conversely, NEL in any particular month may be *more* volatile than shown herein. Finally, because the forecast methodology derives peak demand from NEL via constant load factor assumptions, annual summer and winter peak demand are effectively assumed to have the same weather-related volatility as annual NEL.

The weather scenarios result in bands of uncertainty around the Base Case that are essentially constant through time, so that the projected growth rate is the same as the Base Case. The differential between the Severe Case and Base Case is somewhat larger than between the Mild Case and Base Case as a result of a somewhat non-linear response of load to weather.

3.7 Load Forecast Schedules

Schedules 2.1 through 2.3 and 3.1 through 3.3 present the Base Case load forecast. Schedules 3.1a through 3.3a present the high, or Severe weather case, and Schedules 3.1b through 3.3b present the low, or Mild weather case. Schedule 4 presents the Base Case monthly load forecast.

As a general note, the ARP provides wholesale power to the ARP Participants who, in turn, serve retail load. In addition, the ARP has entered into a wholesale power contract to provide full requirements capacity and energy to the City of Quincy, as a wholesale customer of the ARP. The reported demands and energy shown in Schedules 2.1 through 4 are at the “city gate” of each ARP Participant and the City of Quincy. For example, Schedules 2.1 – 2.3 reflect the energy consumption of the retail customers of the ARP Participants and a sale-for-resale to the City of Quincy (as discussed in section 3.6.1) which, when combined with utility use and losses within each ARP Participant, represents the NEL that the ARP delivers on an aggregated basis to each city gate.

Schedule 2.1
History and Forecast of Energy Consumption and Number of Customers by Customer Class
All-Requirements Power Supply Project

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year [1]	Rural and Residential [2]				Commercial [2]			
	Population	Members per Household	GWh	Average No. of Customers	Average kWh Consumption per Customer	GWh	Average No. of Customers	Average kWh Consumption per Customer
2003	NA	NA	3,178	227,990	13,941	2,603	41,827	62,232
2004	NA	NA	3,172	234,589	13,523	2,625	41,746	62,879
2005	NA	NA	3,269	238,106	13,730	2,675	42,928	62,303
2006	NA	NA	3,293	244,419	13,474	2,692	43,968	61,224
2007	NA	NA	3,273	248,679	13,161	2,740	44,492	61,578
2008	NA	NA	3,127	248,529	12,582	2,767	45,528	60,786
2009	NA	NA	3,169	248,899	12,731	2,669	45,037	59,258
2010	NA	NA	2,951	220,525	13,382	2,271	39,185	57,968
2011	NA	NA	2,850	222,304	12,818	2,252	39,127	57,561
2012	NA	NA	2,764	225,183	12,273	2,249	39,126	57,478
2013	NA	NA	2,887	228,318	12,645	2,270	39,668	57,213
2014	NA	NA	2,727	208,920	13,052	2,137	37,103	57,596
2015	NA	NA	2,791	212,284	13,150	2,169	37,518	57,811
2016	NA	NA	2,850	215,601	13,221	2,202	37,934	58,040
2017	NA	NA	2,902	218,652	13,274	2,235	38,349	58,278
2018	NA	NA	2,953	221,513	13,331	2,268	38,760	58,518
2019	NA	NA	3,004	224,217	13,397	2,302	39,177	58,771
2020	NA	NA	3,056	226,895	13,468	2,337	39,597	59,030
2021	NA	NA	3,108	229,546	13,540	2,372	40,018	59,279
2022	NA	NA	3,160	232,141	13,614	2,407	40,446	59,520

[1] Amounts shown for 2003 through 2012 represent historical values. Amounts shown for 2013 through 2022 represent forecast values.

[2] Loads and customer counts only reflects the ARP. Quincy's loads are shown as Sale for Resale on Schedule 2.3.

Schedule 2.2
History and Forecast of Energy Consumption and Number of Customers by Customer Class
All-Requirements Power Supply Project

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)
Year [1]	Industrial [2]			Railroads and Railways GWh	Street and Highway Lighting GWh	Other Sales to Public Authorities GWh	Total Sales to Ultimate Customers GWh
	GWh	Average No. of Customers	Average kWh Consumption per Customer				
2003	615	1,126	546,214	0	71	120	6,587
2004	629	1,134	554,126	0	71	117	6,614
2005	638	1,163	548,974	0	73	115	6,770
2006	660	1,207	546,916	0	76	107	6,829
2007	673	1,221	551,483	0	75	111	6,872
2008	589	991	594,455	0	74	112	6,669
2009	554	960	577,681	0	75	111	6,578
2010	554	988	560,541	0	69	106	5,951
2011	542	1,010	536,439	0	68	102	5,814
2012	536	1,010	531,361	0	66	102	5,717
2013	532	1,014	524,755	0	68	102	5,859
2014	538	1,025	524,806	0	66	103	5,570
2015	546	1,037	526,783	0	67	103	5,677
2016	555	1,050	529,214	0	68	104	5,779
2017	565	1,063	531,979	0	69	105	5,876
2018	576	1,076	535,030	0	70	105	5,972
2019	586	1,089	538,124	0	71	106	6,069
2020	597	1,103	541,285	0	72	107	6,169
2021	608	1,116	544,581	0	73	107	6,268
2022	619	1,129	547,881	0	74	108	6,369

[1] Amounts shown for 2003 through 2012 represent historical values. Amounts shown for 2013 through 2022 represent forecast values.

[2] Loads and customer counts only reflects the ARP. Quincy's loads are shown as Sale for Resale on Schedule 2.3.

Schedule 2.3
History and Forecast of Energy Consumption and Number of Customers by Customer Class
All-Requirements Power Supply Project

(1)	(2)	(3)	(4)	(5)	(6)
Year [1]	Sales for Resale GWh [2]	Utility Use & Losses GWh	Net Energy for Load GWh	Other Customers (Average No.)	Total No. of Customers
2003	0	421	7,008	0	270,943
2004	0	387	7,000	0	277,469
2005	0	374	7,145	0	282,197
2006	0	382	7,211	0	289,594
2007	0	373	7,246	0	294,392
2008	0	296	6,966	0	295,048
2009	0	316	6,894	0	294,896
2010	0	348	6,299	0	260,697
2011	105	208	6,127	0	262,440
2012	96	246	6,059	0	265,318
2013	117	270	6,246	0	268,999
2014	119	245	5,934	0	247,048
2015	121	248	6,045	0	250,839
2016	0	254	6,034	0	254,584
2017	0	256	6,132	0	258,064
2018	0	260	6,232	0	261,350
2019	0	264	6,333	0	264,484
2020	0	271	6,439	0	267,595
2021	0	272	6,540	0	270,679
2022	0	276	6,644	0	273,716

[1] Amounts shown for 2003 through 2012 represent historical values. Amounts shown for 2013 through 2022 represent forecast values.

[2] Years 2013 through 2015 include expected sales to the City of Quincy.

Schedule 3.1
History and Forecast of Summer Peak Demand (MW) – Base Case
All-Requirements Power Supply Project

(1)	(2)	(3)		(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year [1]	Total	Wholesale		Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	ARP Net Firm Demand
		ARP	Quincy							
2003	1,343	1,343	0	0	0	0	0	0	0	1,343
2004	1,416	1,416	0	0	0	0	0	0	0	1,416
2005	1,524	1,524	0	0	0	0	0	0	0	1,524
2006	1,478	1,478	0	0	0	0	0	0	0	1,478
2007	1,521	1,521	0	0	0	0	0	0	0	1,521
2008	1,450	1,450	0	0	0	0	0	0	0	1,450
2009	1,482	1,482	0	0	0	0	0	0	0	1,482
2010	1,272	1,272	0	0	0	0	0	0	0	1,272
2011	1,280	1,258	22	0	0	0	0	0	0	1,280
2012	1,224	1,203	21	0	0	0	0	0	0	1,224
2013	1,290	1,264	26	0	0	0	0	0	0	1,290
2014	1,231	1,205	26	0	0	0	0	0	0	1,231
2015	1,254	1,228	26	0	0	0	0	0	0	1,254
2016	1,252	1,252	0	0	0	0	0	0	0	1,252
2017	1,272	1,272	0	0	0	0	0	0	0	1,272
2018	1,294	1,294	0	0	0	0	0	0	0	1,294
2019	1,315	1,315	0	0	0	0	0	0	0	1,315
2020	1,338	1,338	0	0	0	0	0	0	0	1,338
2021	1,359	1,359	0	0	0	0	0	0	0	1,359
2022	1,381	1,381	0	0	0	0	0	0	0	1,381

[1] Amounts shown for 2003 through 2012 represent historical values. Amounts shown for 2013 through 2022 represent forecast values.

Schedule 3.2
History and Forecast of Winter Peak Demand (MW) – Base Case
All-Requirements Power Supply Project

(1)	(2)	(3)		(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year [1]	Total	Wholesale		Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/	Commercial/	ARP Net Firm Demand
		ARP	Quincy					Industrial Load Management	Industrial Load Conservation	
2003/04	1,194	1,194	0	0	0	0	0	0	0	1,194
2004/05	1,340	1,340	0	0	0	0	0	0	0	1,340
2005/06	1,401	1,401	0	0	0	0	0	0	0	1,401
2006/07	1,202	1,202	0	0	0	0	0	0	0	1,202
2007/08	1,330	1,330	0	0	0	0	0	0	0	1,330
2008/09	1,419	1,419	0	0	0	0	0	0	0	1,419
2009/10	1,412	1,412	0	0	0	0	0	0	0	1,412
2010/11	1,258	1,258	0	0	0	0	0	0	0	1,258
2011/12	1,115	1,097	18	0	0	0	0	0	0	1,115
2012/13	1,226	1,201	25	0	0	0	0	0	0	1,226
2013/14	1,178	1,153	25	0	0	0	0	0	0	1,178
2014/15	1,200	1,175	25	0	0	0	0	0	0	1,200
2015/16	1,197	1,197	0	0	0	0	0	0	0	1,197
2016/17	1,217	1,217	0	0	0	0	0	0	0	1,217
2017/18	1,237	1,237	0	0	0	0	0	0	0	1,237
2018/19	1,257	1,257	0	0	0	0	0	0	0	1,257
2019/20	1,278	1,278	0	0	0	0	0	0	0	1,278
2020/21	1,298	1,298	0	0	0	0	0	0	0	1,298
2021/22	1,319	1,319	0	0	0	0	0	0	0	1,319
2022/23	1,340	1,340	0	0	0	0	0	0	0	1,340

[1] Amounts shown for 2003/04 through 2011/12 represent historical values. Amounts shown for 2012/13 through 2022/23 represent forecast values.

Schedule 3.3
History and Forecast of Annual Net Energy for Load (GWh) – Base Case
All-Requirements Power Supply Project

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year [1]	Total	Residential Conservation	Commercial/ Industrial Conservation	Retail [2]	Wholesale [3]	Utility Use & Losses	ARP Net Energy for Load [4]	Load Factor %
2003	6,587	0	0	6,587	0	421	7,008	43%
2004	6,614	0	0	6,614	0	387	7,000	60%
2005	6,770	0	0	6,770	0	374	7,145	56%
2006	6,829	0	0	6,829	0	382	7,211	54%
2007	6,872	0	0	6,872	0	373	7,246	56%
2008	6,669	0	0	6,669	0	296	6,966	54%
2009	6,578	0	0	6,578	0	316	6,894	55%
2010	5,951	0	0	5,951	0	348	6,299	53%
2011	5,814	0	0	5,709	105	208	6,022	56%
2012	5,717	0	0	5,621	96	246	5,963	55%
2013	5,859	0	0	5,742	117	270	6,129	55%
2014	5,570	0	0	5,451	119	245	5,815	55%
2015	5,677	0	0	5,556	121	248	5,924	55%
2016	5,779	0	0	5,779	0	254	6,034	55%
2017	5,876	0	0	5,876	0	256	6,132	55%
2018	5,972	0	0	5,972	0	260	6,232	55%
2019	6,069	0	0	6,069	0	264	6,333	55%
2020	6,169	0	0	6,169	0	271	6,439	55%
2021	6,268	0	0	6,268	0	272	6,540	55%
2022	6,369	0	0	6,369	0	276	6,644	55%

[1] Amounts shown for 2003 through 2012 represent historical values. Amounts shown for 2013 through 2022 represent forecast values.

[2] Represents the Retail Load of the ARP Participants.

[3] Represents the sales in 2011 through 2015 to the City of Quincy from the ARP.

[4] Includes both ARP and Quincy loads and distribution losses.

Schedule 3.1a
Forecast of Summer Peak Demand (MW) – High (Severe Weather) Case
All-Requirements Power Supply Project [1]

(1)	(2)	(3)		(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale		Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
		ARP	Quincy							
2013	1,339	1,313	26	0	0	0	0	0	0	1,339
2014	1,279	1,253	26	0	0	0	0	0	0	1,279
2015	1,303	1,277	26	0	0	0	0	0	0	1,303
2016	1,301	1,301	0	0	0	0	0	0	0	1,301
2017	1,322	1,322	0	0	0	0	0	0	0	1,322
2018	1,344	1,344	0	0	0	0	0	0	0	1,344
2019	1,366	1,366	0	0	0	0	0	0	0	1,366
2020	1,390	1,390	0	0	0	0	0	0	0	1,390
2021	1,412	1,412	0	0	0	0	0	0	0	1,412
2022	1,435	1,435	0	0	0	0	0	0	0	1,435

[1] Values represent predicted summer peak demand under severe weather conditions.

Schedule 3.2a
Forecast of Winter Peak Demand (MW) – High (Severe Weather) Case
All-Requirements Power Supply Project ^[1]

(1)	(2)	(3)		(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale		Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
		ARP	Quincy							
2012/13	1,274	1,249	25	0	0	0	0	0	0	1,274
2013/14	1,225	1,200	25	0	0	0	0	0	0	1,225
2014/15	1,247	1,222	25	0	0	0	0	0	0	1,247
2015/16	1,245	1,245	0	0	0	0	0	0	0	1,245
2016/17	1,266	1,266	0	0	0	0	0	0	0	1,266
2017/18	1,286	1,286	0	0	0	0	0	0	0	1,286
2018/19	1,307	1,307	0	0	0	0	0	0	0	1,307
2019/20	1,329	1,329	0	0	0	0	0	0	0	1,329
2020/21	1,350	1,350	0	0	0	0	0	0	0	1,350
2021/22	1,371	1,371	0	0	0	0	0	0	0	1,371

[1] Values represent predicted winter peak demand under severe weather conditions.

Schedule 3.3a
Forecast of Annual Net Energy for Load (GWh) – High (Severe Weather) Case
All-Requirements Power Supply Project ^[1]

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Total	Residential Conservation	Commercial/ Industrial Conservation	ARP Retail [2]	Wholesale [3]	Utility Use & Losses	Net Energy for Load [4]	Load Factor %
2013	6,092	0	0	6,092	117	276	6,485	56%
2014	5,796	0	0	5,796	119	249	6,164	56%
2015	5,907	0	0	5,907	121	250	6,278	56%
2016	6,013	0	0	6,013	0	257	6,270	55%
2017	6,114	0	0	6,114	0	258	6,372	55%
2018	6,213	0	0	6,213	0	262	6,475	55%
2019	6,314	0	0	6,314	0	266	6,580	55%
2020	6,417	0	0	6,417	0	273	6,691	55%
2021	6,521	0	0	6,521	0	274	6,795	55%
2022	6,625	0	0	6,625	0	278	6,903	55%

[1] Values represent predicted net energy for load under severe weather conditions.

[2] Represents the Retail Load of the ARP Participants.

[3] Years 2013 through 2015 include the expected NEL of the City of Quincy, after other Quincy resources have been utilized.

[4] Includes both ARP and Quincy loads and distribution losses.

**Schedule 3.1b
Forecast of Summer Peak Demand (MW) – Low (Mild Weather) Case
All-Requirements Power Supply Project ^[1]**

(1)	(2)	(3)		(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale		Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/ Industrial Load Management	Commercial/ Industrial Load Conservation	Net Firm Demand
		ARP	Quincy							
2013	1,245	1,219	26	0	0	0	0	0	0	1,245
2014	1,188	1,162	26	0	0	0	0	0	0	1,188
2015	1,210	1,184	26	0	0	0	0	0	0	1,210
2016	1,207	1,207	0	0	0	0	0	0	0	1,207
2017	1,227	1,227	0	0	0	0	0	0	0	1,227
2018	1,247	1,247	0	0	0	0	0	0	0	1,247
2019	1,268	1,268	0	0	0	0	0	0	0	1,268
2020	1,289	1,289	0	0	0	0	0	0	0	1,289
2021	1,310	1,310	0	0	0	0	0	0	0	1,310
2022	1,331	1,331	0	0	0	0	0	0	0	1,331

[1] Values represent predicted summer peak demand under mild weather conditions.

Schedule 3.2b
Forecast of Winter Peak Demand (MW) – Low (Mild Weather) Case
All-Requirements Power Supply Project ^[1]

(1)	(2)	(3)		(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale		Retail	Interruptible	Residential Load Management	Residential Conservation	Commercial/Industrial Load Management	Commercial/Industrial Load Conservation	Net Firm Demand
		ARP	Quincy							
2012/13	1,182	1,157	25	0	0	0	0	0	0	1,182
2013/14	1,136	1,111	25	0	0	0	0	0	0	1,136
2014/15	1,157	1,132	25	0	0	0	0	0	0	1,157
2015/16	1,153	1,153	0	0	0	0	0	0	0	1,153
2016/17	1,172	1,172	0	0	0	0	0	0	0	1,172
2017/18	1,191	1,191	0	0	0	0	0	0	0	1,191
2018/19	1,210	1,210	0	0	0	0	0	0	0	1,210
2019/20	1,231	1,231	0	0	0	0	0	0	0	1,231
2020/21	1,250	1,250	0	0	0	0	0	0	0	1,250
2021/22	1,270	1,270	0	0	0	0	0	0	0	1,270

[1] Values represent predicted winter peak demand under mild weather conditions.

Schedule 3.3b
Forecast of Annual Net Energy for Load (GWh) – Low (Mild Weather) Case
All-Requirements Power Supply Project ^[1]

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Total	Residential Conservation	Commercial/ Industrial Conservation	ARP Retail [2]	Wholesale [3]	Utility Use & Losses	Net Energy for Load [4]	Load Factor %
2013	5,649	0	0	5,649	117	265	6,031	55%
2014	5,369	0	0	5,369	119	240	5,728	55%
2015	5,470	0	0	5,470	121	245	5,836	55%
2016	5,568	0	0	5,568	0	252	5,820	55%
2017	5,661	0	0	5,661	0	253	5,914	55%
2018	5,753	0	0	5,753	0	257	6,010	55%
2019	5,846	0	0	5,846	0	261	6,108	55%
2020	5,942	0	0	5,942	0	268	6,210	55%
2021	6,038	0	0	6,038	0	269	6,307	55%
2022	6,134	0	0	6,134	0	273	6,407	55%

[1] Values represent predicted net energy for load under mild weather conditions.

[2] Represents the Retail Load of the ARP Participants.

[3] Years 2013 through 2015 show the expected NEL of the City of Quincy to be served by the ARP.

[4] Includes both ARP and Quincy loads and distribution losses

Schedule 4
Previous Year and 2-Year Forecast of Peak Demand and Net Energy for Load by Month
All-Requirements Power Supply Project

(1)	(2)	(3)	(4)	(5)	(6)	(7)
Month	Actual - 2012 [1]		Forecast - 2013 [2]		Forecast - 2014 [2] [3]	
	Peak Demand (MW)	NEL (GWh)	Peak Demand (MW)	NEL (GWh)	Peak Demand (MW)	NEL (GWh)
January	1,115	447	1,226	482	1,178	462
February	1,058	412	1,080	422	1,048	401
March	884	459	928	445	889	422
April	1,005	465	952	462	905	437
May	1,111	552	1,128	544	1,078	517
June	1,166	555	1,237	597	1,181	567
July	1,224	633	1,254	634	1,197	603
August	1,204	613	1,290	648	1,231	615
September	1,156	563	1,180	587	1,125	555
October	1,099	512	1,087	513	1,032	486
November	757	405	887	439	848	417
December	843	443	912	473	879	452

[1] Year 2012 included both the coincidental peak of the ARP and peak supplied to Quincy. 2012 also shows the actual combined NEL for calendar year 2012.

[2] Years 2013 and 2014 show expected ARP requirements including the sale to the City of Quincy.

[3] Starting on January 1, 2014 the City of Lake Worth will have their CROD in effect.

FMPA

Section 4 Renewable Resources and Conservation Programs

4.1 Introduction

FMPA continually evaluates renewable and conservation resource opportunities as part of its integrated resource planning process for the ARP. The ARP currently utilizes renewable energy resources as part of the generation portfolio, including solar photovoltaic (PV) and biomass. In addition, the ARP operates a Conservation & Energy Efficiency Program and a Net Metering Program.

4.2 Renewable Resources

The following provides an overview of the ARP's current renewable resources, as well as new resources that are being considered as part of FMPA's integrated resource planning process:

4.2.1 Solar Photovoltaic

In December 2009, the ARP completed construction on a 30 kW (DC) solar photovoltaic (PV) project located in Key West, FL. This project was developed and constructed as a joint partnership between the National Oceanic and Atmospheric Administration (NOAA) and FMPA. FMPA receives 62% of the energy generated from the solar PV system.

FMPA continues to evaluate additional opportunities for Solar PV projects for the ARP.

4.2.2 Biomass

FMPA currently receives biomass renewable energy from two sources.

- FMPA purchases as-available power from a cogeneration plant owned and operated by U.S. Sugar Corporation. The U.S. Sugar cogeneration plant is fueled by sugar bagasse, a byproduct of sugar production. U.S. Sugar Corporation uses the bagasse to fuel their generation plants to provide power for their processes. FMPA purchases the excess power produced from these generators. During 2012, FMPA purchased 28,391 MWh of energy from this renewable resource.
- In 2012, the Stanton Units 1 and 2 consumed 615,614 MMBtu of landfill gas as a supplemental fuel source. The ARP receives energy from both the ARP's and ARP Participants' shares in the Stanton Energy Center Units 1 and 2, which amount to 23.6%

of the energy output of Stanton Unit 1 and 19.3% of the energy output of Unit 2 as of December 31, 2012. Thus, the ARP utilized 122,545 MMBtu of landfill gas as a supplemental fuel source.

These renewable resources help the ARP meet current and future energy needs. However, the existing renewable resources are not considered firm capacity, so they do not assist the ARP in meeting current or future capacity needs.

In addition, FMPA continues to hold discussions with other biomass developers and evaluate proposals in an effort to find additional cost-effective biomass resources for the ARP.

FMPA's forecast of renewable energy is provided in Schedule 6.1 of Section 5 (Forecast of Facility Requirements).

4.3 Conservation & Energy Efficiency Program

The ARP Participants have developed the ARP Conservation Program to provide conservation and energy efficiency incentives and assistance to their retail customers. The project is funded through the ARP rates and members are allocated funds based on their energy load ratio share. Each ARP Participant can elect to implement programs that are most suitable for their community.

Conservation programs offered by ARP Participants include:

- Rebates on ENERGY STAR® qualified appliances
- Rebates on insulation upgrades and duct leak repair
- Residential and Commercial energy audits
- Customer education materials, including brochures and DVDs
- Equipment and training for utility energy auditors

Since the inception of the program in 2008, the ARP Participants have allocated more than \$3.7 million to the ARP Conservation Program.

In addition to the ARP Conservation Program, FMPA has a partnership agreement with ENERGY STAR®, a government-backed program helping businesses and individuals protect the environment and save energy through end-use products with superior energy efficiency characteristics. Partnering with ENERGY STAR® and working together through FMPA makes

it convenient and cost-effective for FMPA's Members to bring the benefits of energy efficiency to their hometown utility. Members are provided with promotional materials including newsletters, posters, bill stuffers, and web banners to participate in the campaigns and promote the conservation message to their customers.

FMPA is currently not including the effects of its energy efficiency programs in its forecast of demand and net energy for load as the program results are still under FMPA's designated threshold for level of significance developed pursuant to NERC Reliability Standards for load and demand modeling. FMPA has developed reporting tools and techniques in order to be able to estimate program effects on demand and NEL and understand the level of significance of the program. Once the threshold is crossed, FMPA will separately account for the effects of the energy efficiency program in its demand and load forecast. To the extent that recent energy efficiency efforts have been captured in actual consumption data for the last few years, the effects of the program are included in the current load forecast.

4.4 Net Metering Program

In June 2008, the ARP Participants adopted a Net Metering Policy to permit interconnection of customer-owned renewable generation to its Members' distribution system. This policy facilitates the purchase of excess customer-owned renewable generation and outlines the metering, billing and crediting procedures to be followed by ARP Participants. Thus, through the Net Metering Program the ARP has been able to switch the fuel used to provide the energy from certain residential and commercial customer loads from traditional ARP fuel sources to PV. As of December 2012, the ARP had approximately 1,022 kW of solar photovoltaic renewable generation connected to the grid through the Net Metering Program.

As with the conservation programs, FMPA is currently not including the effects of its net metering program in its forecast of demand and net energy for load as the program results are still under FMPA's designated threshold for level of significance. However, to the extent that recent net metering program results via reduced customer consumption of utility generated electricity have been captured in actual consumption data for the last one or two years, the effects of the program are included in the current load forecast.

4.5 Load Management Program

Currently, there are no ARP-wide load management programs in place. However, beginning in 2009, some ARP Participants established load management programs for certain customers, such

as those with standby generation for the discreet use by the ARP Participant, not FMPA or the Balancing Authority. However, FMPA tracks the effects of these load management programs and accounts for them appropriately in the load forecast and planning process, again, pursuant to NERC Reliability Standards for load and demand modeling.

FMPA

Section 5 Forecast of Facilities Requirements

5.1 ARP Planning Process

FMPA's integrated resource planning (IRP) mandate is to assure, on a long-term basis, a low-cost and reliable electricity supply to ARP Participants that reflects the goals and objectives established by the ARP Participants. FMPA's planning process is consistent with Florida Public Service Commission (PSC) statutory and regulatory requirements which do not specifically subject utilities in Florida to integrated resource planning, but when taken together equate to an integrated resource planning requirement. In addition, FMPA's process is considerate of the Public Utility Regulatory Act (PURPA) which requires certain standards of practice to comply with retail rate regulations.

The IRP planning process requires that FMPA and the ARP Executive Committee evaluate alternative resource portfolios and make certain decisions regarding implementing a particular preferred plan. Certain requirements, such as maintaining 18 percent Summer Peak Reserves and 15 percent Winter Peak Reserves on a planned basis, and 'best efforts' goals, such as achieving the lowest net present value cost over the next 20 years, and integrating demand-side and renewable resources into the ARP power supply portfolio, have been developed as guidelines to assist FMPA and the Executive Committee in communicating and evaluating the key issues associated with making resource portfolio planning decisions.

5.2 Planned ARP Generating Facility Requirements

Based upon FMPA's current Base Load forecast, the ARP currently does not require any additional resources through the term of this study (2022). Schedule 8 at the end of this section shows planned and prospective ARP generating resources changes during the next 10-year period.

5.3 Capacity and Power Purchase Requirements

The current system firm power supply purchase resources of the ARP include purchases from FPL and Southern Company. Power purchase contracts included in the ARP plans are briefly summarized below:

- **FPL:** FMPA has a long-term purchase contract with FPL for 45 MW until June 1, 2013. The FPL long-term purchase is a Partial Requirements type purchase and includes reserves.
- **Southern Company:** The ARP and KUA each have a contract for the purchase of 6.5 percent of the net operating capability of the Stanton A combined cycle facility from Southern Company – Florida LLC. The initial term of the purchase ends in September 2023 and includes subsequent extension options. For 2013, the ARP's and KUA's combined purchases from Stanton A amount to 80.6 MW based on the 620 MW summer rating of the facility. FMPA also has a contract to purchase the entire capacity of, and energy generated by, Southern Power Company's Oleander Unit 5, an approximately 162 MW (summer rating) or 180 MW (winter rating), simple cycle gas turbine unit primarily fueled with natural gas and located in Brevard County. The initial term of the purchase ends in December 2027 and includes a subsequent extension option.

5.4 Summary of Current and Future ARP Resource Capacity

Tables 5-1 and 5-2 provide a summary, ten-year projection of the ARP resource capacity for the summer and winter seasons, respectively. A projection of the ARP fuel requirements by fuel type is shown in Schedule 5. Schedules 6.1 (quantity) and 6.2 (percent of total) present the forecast of ARP energy sources by resource type. Schedules 7.1 and 7.2 summarize the capacity, demand, and resulting reserve margin forecasts for the summer and winter seasons, respectively. Information on planned and prospective ARP generating facility additions and changes is located in Schedule 8.

**Table 5-1
Summary of All-Requirements Power Supply Project Resource Summer Capacity**

Line No.	Resource Description (a)	Summer Rating (MW)									
		2013 (b)	2014 (c)	2015 (d)	2016 (e)	2017 (f)	2018 (g)	2019 (h)	2020 (i)	2021 (j)	2022 (k)
	Installed Capacity										
	Existing Resources										
1	Excluded Resources (Nuclear) [1]	57	35	35	35	35	35	35	35	35	35
2	Stanton Coal Plant	190	177	179	179	179	179	179	179	179	179
3	Stanton CC Unit A	43	43	43	43	43	43	43	43	43	43
4	Cane Island 1-4	683	683	683	683	683	683	683	683	683	683
5	Indian River CTs	77	77	77	77	77	77	77	77	77	77
6	Key West Units 2&3	31	31	31	31	31	31	31	31	31	31
7	Key West Unit 4	45	45	45	45	45	45	45	45	45	45
8	Treasure Coast Energy Center	300	300	300	300	300	300	300	300	300	300
9	Key West Native Generation	33	33	33	33	33	33	33	33	33	33
10	Kissimmee Native Generation	-	-	-	-	-	-	-	-	-	-
11	Lake Worth Native Generation	78	-	-	-	-	-	-	-	-	-
12	Sub Total Existing Resources	1,537	1,424	1,426	1,426	1,426	1,426	1,426	1,426	1,426	1,426
	Planned Additions										
13	None Required	-	-	-	-	-	-	-	-	-	-
15	Sub Total Planned Additions	-	-	-	-	-	-	-	-	-	-
16	Total Installed Capacity	1,537	1,424	1,426							
	Firm Capacity Import										
	Firm Capacity Import Without Reserves										
17	Stanton A Purchase	81	81	81	81	81	81	81	81	81	81
18	Oleander Purchase	162	162	162	162	162	162	162	162	162	162
19	Peaking Purchase(s)	-	-	-	-	-	-	-	-	-	-
20	Sub Total Without Reserves	243	243	243	243	243	243	243	243	243	243
	Firm Capacity Import With Reserves										
21	FPL Long-Term Partial Requirements	-	-	-	-	-	-	-	-	-	-
22	Sub Total With Reserves	-	-	-	-	-	-	-	-	-	-
23	Total Firm Capacity Import	243	243	243	243	243	243	243	243	243	243
24	Total Available Capacity	1,779	1,667	1,669							

[1] Crystal River Unit 3 is considered retired as of January 2013, so no capacity is shown for it.

**Table 5-2
Summary of All-Requirements Power Supply Project Resource Winter Capacity**

Line No.	Resource Description	Winter Rating (MW) [1]									
		2012/13	2013/14	2014/15	2015/16	2016/17	2017/18	2018/19	2019/20	2020/21	2021/22
	(a)	(b)	(c)	(d)	(e)	(f)	(g)	(h)	(i)	(j)	(k)
	Installed Capacity										
	Existing Resources										
1	Excluded Resources (Nuclear)	58	36	36	36	36	36	36	36	36	36
2	Stanton Coal Plant	188	178	177	180	180	180	180	180	180	180
3	Stanton CC Unit A	45	45	45	45	45	45	45	45	45	45
4	Cane Island 1-4	711	711	711	711	711	711	711	711	711	711
5	Indian River CTs	95	95	95	95	95	95	95	95	95	95
6	Key West Units 2&3	31	31	31	31	31	31	31	31	31	31
7	Key West Unit 4	45	45	45	45	45	45	45	45	45	45
8	Treasure Coast Energy Center	310	310	310	310	310	310	310	310	310	310
9	Key West Native Generation	33	33	33	33	33	33	33	33	33	33
10	Kissimmee Native Generation	-	-	-	-	-	-	-	-	-	-
11	Lake Worth Native Generation	82	-	-	-	-	-	-	-	-	-
12	Sub Total Existing Resources	1,598	1,484	1,484	1,486	1,486	1,486	1,486	1,486	1,486	1,486
	Planned Additions										
13	None Required	-	-	-	-	-	-	-	-	-	-
15	Sub Total Planned Additions	-	-	-	-	-	-	-	-	-	-
16	Total Installed Capacity	1,598	1,484	1,484	1,486						
	Firm Capacity Import										
	Firm Capacity Import Without Reserves										
17	Stanton A Purchase	81	81	81	81	81	81	81	81	81	81
18	Oleander Purchase	180	180	180	180	180	180	180	180	180	180
19	Peaking Purchase(s)	-	-	-	-	-	-	-	-	-	-
20	Sub Total Without Reserves	261	261	261	261	261	261	261	261	261	261
	Firm Capacity Import With Reserves										
21	FPL Long-Term Partial Requirements	45	-	-	-	-	-	-	-	-	-
22	Sub Total With Reserves	45	-	-	-	-	-	-	-	-	-
23	Total Firm Capacity Import	306	261								
25	Total Available Capacity	1,903	1,744	1,744	1,746						

[1] The 2013 Winter Season in this table is considered December 2012 through February 2013

Schedule 5
Fuel Requirements – All-Requirements Power Supply Project

Line No.	(1) Fuel Type	(2) Unit Type	(3) Fuel Units	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
				Actual 2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022
1	Nuclear [1]		Trillion BTU	5	5	3	3	3	3	3	3	3	3	3
2	Coal		000 Ton	255	231	215	346	375	428	437	454	423	412	414
	Residual													
3		Steam	000 BBL	-	3	3	2	2	1	1	1	2	2	2
4		CC	000 BBL	-	-	-	-	-	-	-	-	-	-	-
5		CT	000 BBL	-	-	-	-	-	-	-	-	-	-	-
6		Total	000 BBL	-	3	3	2	2	1	1	1	2	2	2
	Distillate													
7		Steam	000 BBL	-	-	-	-	-	-	-	-	-	-	-
8		CC	000 BBL	-	-	-	-	-	-	-	-	-	-	-
9		CT	000 BBL	1	3	10	1	1	3	4	3	3	7	3
10		Total	000 BBL	1	3	10	1	1	3	4	3	3	7	3
	Natural Gas													
11		Steam	000 MCF	474	15	-	-	-	-	-	-	-	-	-
12		CC	000 MCF	31,454	42,853	42,337	32,202	31,394	28,151	27,714	27,404	29,957	31,563	32,427
13		CT	000 MCF	443	816	925	413	377	259	316	307	308	397	401
14		Total	000 MCF	32,371	43,684	43,262	32,615	31,771	28,409	28,030	27,711	30,266	31,961	32,829
	Renewables [2]													
15		Biofuels	Billion BTU	284	130	130	130	130	130	130	130	130	130	130
16		Biomass	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
17		Geothermal	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
18		Hydro	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
19		Landfill Gas	Billion BTU	132	203	178	164	155	146	137	128	119	110	110
20		MSW	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
21		Solar	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
22		Wind	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
23		Other	Billion BTU	-	-	-	-	-	-	-	-	-	-	-
24		Total	Billion BTU	416	333	308	294	285	276	267	258	249	240	240
25	Other		Trillion BTU	-	-	-	-	-	-	-	-	-	-	-

2013 Base TYSP Stanton Coal no CR3

[1] Nuclear generation is not part of the All-Requirements Project power supply. It is owned directly by some Project participants.

[2] Includes landfill gas consumed by FMPA's ownership share of the Stanton Energy Center as a supplemental fuel source, as well as bagasse consumed by U.S. Sugar cogeneration facility in the production of power purchased by FMPA.

Schedule 6.1
Energy Sources (GWh) – All-Requirements Power Supply Project

Line No.	(1) Energy Source	(2) Prime Mover	(3) Units	(4)		(5)	(6)	(7)	(8)	(9) Forecasted					(12)	(13)	(14)
				Actual	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022		
1	Annual Firm Inter-Region Interchange		GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
2	Nuclear [1]		GWh	505	425	283	282	267	282	282	266	283	282	266			
3	Coal		GWh	638	534	498	855	935	1,089	1,115	1,165	1,078	1,047	1,053			
4	Residual	Steam	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
5		CC	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
6		CT	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
7		Total	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
8	Distillate	Steam	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
9		CC	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
10		CT	GWh	1	1	4	1	0	1	2	1	1	3	1			
11		Total	GWh	1	1	4	1	0	1	2	1	1	3	1			
12	Natural Gas	Steam	GWh	-	1	-	-	-	-	-	-	-	-	-	-	-	
13		CC	GWh	5,111	5,147	4,971	4,427	4,316	3,890	3,833	3,799	4,145	4,364	4,494			
14		CT	GWh	25	63	71	30	28	19	23	23	22	29	29			
15		Total	GWh	5,136	5,210	5,042	4,457	4,344	3,909	3,857	3,822	4,167	4,393	4,523			
16	NUG		GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
17	Renewables [2]	Biofuels	GWh	28	13	13	13	13	13	13	13	13	13	13			
18		Biomass	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
19		Geothermal	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
20		Hydro	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
21		Landfill Gas	GWh	12	20	17	17	16	15	14	13	12	11	11			
22		MSW	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
23		Solar	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
24		Wind	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
25		Other	GWh	-	-	-	-	-	-	-	-	-	-	-	-	-	
26		Total	GWh	41	33	30	30	29	28	27	26	25	24	24			
27	Interchange		GWh	(177)	158	186	526	565	931	1,059	1,164	996	902	890			
28	Net Energy for Load [3]		GWh	6,144	6,362	6,043	6,150	6,140	6,241	6,341	6,445	6,551	6,652	6,757			

[1] Nuclear generation is not part of the All-Requirements Project power supply. It is owned directly by some Project participants.

[2] Includes power purchased from U.S. Sugar cogeneration facility and power generated from FMPA's ownership share of the Stanbn Energy Center using landfill gas.

[3] Includes transmission losses.

Schedule 6.2
Energy Sources (%) – All-Requirements Power Supply Project

Line No.	(1) Energy Source	(2) Prime Mover	(3) Units	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
				Actual 2012	2013	2014	2015	2016	Forecasted					
				2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022
1	Annual Firm Inter-Region Interchange		%	-	-	-	-	-	-	-	-	-	-	-
2	Nuclear [1]		%	8.2	6.7	4.7	4.6	4.3	4.5	4.4	4.1	4.3	4.2	3.9
3	Coal		%	10.4	8.4	8.2	13.9	15.2	17.5	17.6	18.1	16.5	15.7	15.6
Residual														
4		Steam	%	-	-	-	-	-	-	-	-	-	-	-
5		CC	%	-	-	-	-	-	-	-	-	-	-	-
6		CT	%	-	-	-	-	-	-	-	-	-	-	-
7		Total	%	-	-	-	-	-	-	-	-	-	-	-
Distillate														
8		Steam	%	-	-	-	-	-	-	-	-	-	-	-
9		CC	%	-	-	-	-	-	-	-	-	-	-	-
10		CT	%	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
11		Total	%	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0
Natural Gas														
12		Steam	%	-	0.0	-	-	-	-	-	-	-	-	-
13		CC	%	83.2	80.9	82.3	72.0	70.3	62.3	60.4	58.9	63.3	65.6	66.5
14		CT	%	0.4	1.0	1.2	0.5	0.5	0.3	0.4	0.4	0.3	0.4	0.4
15		Total	%	83.6	81.9	83.4	72.5	70.7	62.6	60.8	59.3	63.6	66.0	66.9
16	NUG		%	-	-	-	-	-	-	-	-	-	-	-
Renewables [2]														
17		Biofuels	%	0.5	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
18		Biomass	%	-	-	-	-	-	-	-	-	-	-	-
19		Geothermal	%	-	-	-	-	-	-	-	-	-	-	-
20		Hydro	%	-	-	-	-	-	-	-	-	-	-	-
21		Landfill Gas	%	0.2	0.3	0.3	0.3	0.3	0.2	0.2	0.2	0.2	0.2	0.2
22		MSW	%	-	-	-	-	-	-	-	-	-	-	-
23		Solar	%	-	-	-	-	-	-	-	-	-	-	-
24		Wind	%	-	-	-	-	-	-	-	-	-	-	-
25		Other	%	-	-	-	-	-	-	-	-	-	-	-
26		Total	%	0.7	0.5	0.5	0.5	0.5	0.5	0.4	0.4	0.4	0.4	0.4
27	Interchange		%	(2.9)	2.5	3.1	8.5	9.2	14.9	16.7	18.1	15.2	13.6	13.2
28	Net Energy for Load		%	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0	100.0

[1] Nuclear generation is not part of the All-Requirements Project power supply. It is owned directly by some Project participants.

[2] Includes power purchased from U.S. Sugar cogeneration facility and power generated from FMPA's ownership share of the Stanton Energy Center using landfill gas.

Schedule 7.1
Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Summer Peak
All-Requirements Power Supply Project plus Quincy Sale

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
Year	Total Installed Capacity (MW) [1]	Firm Capacity Import (MW)	Firm Capacity Export (MW) [2]	QF (MW)	Total Available Capacity (MW)	Total System Firm Summer Peak Demand (MW) [2][3]			Reserve Margin before Maintenance [4]		Scheduled Maintenance (MW)	Reserve Margin after Maintenance [4]	
						Peak	Losses	Total	(MW)	(% of Peak)		(MW)	(% of Peak)
2013	1,537	243	0	0	1,779	1,290	23	1,313	466	36%	0	466	36%
2014	1,424	243	0	0	1,667	1,231	21	1,252	415	33%	0	415	33%
2015	1,426	243	0	0	1,669	1,254	22	1,276	393	31%	0	393	31%
2016	1,426	243	0	0	1,669	1,252	22	1,273	396	31%	0	396	31%
2017	1,426	243	0	0	1,669	1,272	22	1,294	375	29%	0	375	29%
2018	1,426	243	0	0	1,669	1,294	22	1,316	353	27%	0	353	27%
2019	1,426	243	0	0	1,669	1,315	23	1,338	331	25%	0	331	25%
2020	1,426	243	0	0	1,669	1,338	23	1,360	309	23%	0	309	23%
2021	1,426	243	0	0	1,669	1,359	23	1,382	287	21%	0	287	21%
2022	1,426	243	0	0	1,669	1,381	23	1,405	264	19%	0	264	19%

[1] See Table 5-1 for a listing of the resources identified as Installed Capacity and Firm Capacity Import.

[2] The Quincy Sale is represented as part of the System Firm Peak Demand.

[3] System Firm Summer Peak Demand includes transmission losses for the ARP Participants served through FPL, PEF, and KUA.

[4] Reserve Margin calculated as $[(\text{Total Available Capacity} - \text{Partial Requirements Purchases}) - (\text{System Firm Peak Demand} - \text{Partial Requirements Purchases})] / (\text{System Firm Peak Demand} - \text{Partial Requirements Purchases})$. See Appendix III to this Ten-Year Site Plan for the calculation of reserve margins.

Schedule 7.2
Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Winter Peak
All-Requirements Power Supply Project plus Quincy Sale

(1)	(2)	(3)	(4)	(5)	(6)	(6)			(7)	(8)		(9)	(10)	(11)		(12)
Year	Total Installed Capacity (MW) [1]	Firm Capacity Import (MW) [1]	Firm Capacity Export (MW) [2]	QF (MW)	Total Available Capacity (MW)	System Firm Winter Peak Demand (MW) [2][3]			Reserve Margin before Maintenance [4]		Scheduled Maintenance (MW)	Reserve Margin after Maintenance [4]				
						Peak	Losses	Total	(MW)	(% of Peak)		(MW)	(% of Peak)			
2012/13	1,598	306	0	0	1,903	1,226	21	1,247	656	55%	0	656	55%			
2013/14	1,484	261	0	0	1,744	1,178	20	1,198	546	46%	0	546	46%			
2014/15	1,484	261	0	0	1,744	1,200	20	1,221	524	43%	0	524	43%			
2015/16	1,486	261	0	0	1,746	1,197	21	1,218	528	43%	0	528	43%			
2016/17	1,486	261	0	0	1,746	1,217	21	1,238	508	41%	0	508	41%			
2017/18	1,486	261	0	0	1,746	1,237	21	1,258	488	39%	0	488	39%			
2018/19	1,486	261	0	0	1,746	1,257	22	1,278	468	37%	0	468	37%			
2019/20	1,486	261	0	0	1,746	1,278	22	1,300	446	34%	0	446	34%			
2020/21	1,486	261	0	0	1,746	1,298	22	1,320	426	32%	0	426	32%			
2021/22	1,486	261	0	0	1,746	1,319	22	1,341	405	30%	0	405	30%			

[1] See Table 5-1 for a listing of the resources identified as Installed Capacity and Firm Capacity Import.

[2] The Quincy Sale is represented as part of the System Firm Peak Demand.

[3] System Firm Summer Peak Demand includes transmission losses for the ARP Participants served through FPL, PEF, and KUA.

[4] Reserve Margin calculated as $\frac{[(\text{Total Available Capacity} - \text{Partial Requirements Purchases}) - (\text{System Firm Peak Demand} - \text{Partial Requirements Purchases})]}{(\text{System Firm Peak Demand} - \text{Partial Requirements Purchases})}$. See Appendix III to this Ten-Year Site Plan for the calculation of reserve margins.

**Schedule 8
Planned and Prospective Generating Facility Additions and Changes**

Plant Name	Unit No.	Location (County)	Unit Type	Fuel		Fuel Transport		Alt. Fuel Days Use	Commercial In-Service MM/YY	Expected Retirement MM/YY	Gen. Max. Nameplate kW	Net Capability		Status
				Primary	Alt.	Primary	Alt.					Summer MW	Winter MW	
Resource Additions														
Changes to Existing Resources														
Crystal River	3	Citrus	NP	UR	-	TK	-	NA		01/13	NA	(25)	(26)	RT [1]
Tom G. Smith	MU1	Palm Beach	IC	DFO	-	TK	-	NA	12/65	NA	2	(2)	(2)	IR [2]
Tom G. Smith	MU2	Palm Beach	IC	DFO	-	TK	-	NA	12/65	NA	2	(2)	(2)	IR [2]
Tom G. Smith	MU3	Palm Beach	IC	DFO	-	TK	-	NA	12/65	NA	2	(2)	(2)	IR [2]
Tom G. Smith	MU4	Palm Beach	IC	DFO	-	TK	-	NA	12/65	NA	2	(2)	(2)	IR [2]
Tom G. Smith	MU5	Palm Beach	IC	DFO	-	TK	-	NA	12/65	NA	2	(2)	(2)	IR [2]
Stanton Energy Center	1	Orange	ST	BIT	-	RR	-	NA	01/14	NA	NA	(11)	(11)	OT [3]
St. Lucie	2	St. Lucie	NP	UR	-	TK	-	NA	01/14	NA	NA	(21)	(22)	OT [3]
Tom G. Smith	GT-1	Palm Beach	GT	DFO	-	TK	-	NA	01/14	NA	NA	(26)	(27)	OT [3]
Tom G. Smith	GT-2	Palm Beach	CT	NG	DFO	PL	TK	NA	01/14	NA	NA	(20)	(21)	OT [3]
Tom G. Smith	S-3	Palm Beach	ST	NG	RFO	PL	TK	NA	01/14	NA	NA	(24)	(25)	OT [3]
Tom G. Smith	S-5	Palm Beach	CA	WH	-	-	-	NA	01/14	NA	NA	(8)	(9)	OT [3]
Stanton Energy Center	2	Orange	ST	BIT	-	RR	-	NA	11/13	NA	NA	2	2	A [4]

[1] Progress Energy Florida showed in their 2013 LRDB that Crystal River #3 was considered retired on January 1, 2013. Replacement energy will continue in 2013.

[2] Lake Worth changed the status of their Tom G Smith Diesels MU1 – MU5 to Emergency Only in 2012

[3] The City of Lake Worth has provided notice to FMPA that it will exercise the right to modify its ARP full requirements membership. Effective January 1, 2014, the ARP will no longer utilize Lake Worth's generating resources, including its entitlement shares in the Stanton and St. Lucie Projects.

[4] Capacity increases to Stanton 2 from unit efficiency improvement.

FMPA

Section 6 Site and Facility Descriptions

Florida Public Service Commission Rule 25-22.072 F.A.C. requires that the State of Florida Public Service Commission Electric Utility Ten-Year Site Plan Information and Data Requirements Form PSC/EAG 43 dated 11/97 govern the submittal of information regarding Potential and Identified Preferred sites. Ownership or control is required for sites to be Potential or Identified Preferred. The following are Potential sites for FMPA as specified by PSC/EAG 43.

- Cane Island Power Park – Potential Site for additional future generation.
- Treasure Coast Energy Center – Potential Site.
- Stock Island – Potential Site.

FMPA anticipates that simple cycle combustion turbines could be installed at existing generation sites located within or adjacent to the service territories of ARP Participants, such as the Stock Island site at KEYS, the Cane Island Power Park site at KUA, or the Treasure Coast Energy Center in Fort Pierce. FMPA also anticipates that combined cycle generation could be installed at the Treasure Coast Energy Center site. FMPA continuously explores the feasibility of other sites located within Florida with the expectation that ARP Participants' service territories would provide the best option for future development.

Cane Island Power Park

Cane Island Power Park is located south and west of KUA's service area and contains 683 MW (summer ratings) of gas turbine and combined cycle capacity: Units 1-3 include a simple cycle gas turbine and two combined cycle generating units, each of which is 50 percent owned by FMPA and 50 percent owned by KUA. Cane Island Unit 4 (CI4), a nominal 300 MW (summer rating), natural gas-fired 1x1 GE 7FA combined cycle unit, is wholly owned by the ARP.

Treasure Coast Energy Center

FMPA commissioned Treasure Coast Energy Center (TCEC) Unit 1, a dual fuel low sulfur diesel and natural gas-fired 300 MW (summer rating) 1x1 GE 7FA combined cycle unit in May 2008. The Treasure Coast Energy Center is located in St. Lucie County in the City of Fort Pierce. The site was certified in June 2006 and can accommodate construction of future units beyond TCEC Unit 1, up to a total of 1,200 MW.

Stock Island

The Stock Island site currently consists of four combustion turbines, three diesel generating units, one of which is a high speed diesel that had been previously retired but refurbished and brought back into service in July of 2012. The site receives water from the Florida Keys Aqueduct Authority via a pipeline from the mainland, and also uses on-site groundwater. The site receives delivery of fuel oil to its unloading system through waterborne delivery, and also has the capability of receiving fuel oil deliveries via truck.

General

Schedule 9 presents the status report and specifications for any proposed ARP generating facility, if applicable. Schedule 10 contains the status report and specifications for proposed ARP transmission line projects.

**Schedule 9
Status Report and Specifications of Proposed Generating Facilities
All-Requirements Power Supply Project
(Preliminary Information)**

(No Proposed Generating Facilities)

(1)	Plant Name and Unit Number	
(2)	Capacity a. Summer b. Winter	
(3)	Technology Type	
(4)	Anticipated Construction Timing a. Field Construction Start Date b. Commercial In-Service Date	
(5)	Fuel a. Primary Fuel b. Alternate Fuel	
(6)	Air Pollution Control Strategy	
(7)	Cooling Method	
(8)	Total Site Area	
(9)	Construction Status	
(10)	Certification Status	
(11)	Status with Federal Agencies	
(12)	Projected Unit Performance Data Planned Outage Factor (POF) Forced Outage Factor (FOF) Equivalent Availability Factor Resulting Capacity Factor Average Net Operating Heat Rate (ANOHR)	
(13)	Projected Unit Financial Data Book Life (Years) Total Installed Cost (In-Service Year \$/kW) Direct Construction Cost (2010 \$/kW) AFUDC Amount (\$/kW) [1] Escalation (\$/kW) Fixed O&M (\$/kW) Variable O&M (\$/MWh)	

[1] Includes AFUDC and bond issuance expenses

**Schedule 10
 Status Report and Specifications of Proposed Directly Associated Transmission Lines
 All-Requirements Power Supply Project**

(1) Point of Origin and Termination (2) Number of Lines (3) Right-of-Way (4) Line Length (5) Voltage (6) Anticipated Construction Timing (7) Anticipated Capital Investment (8) Substations (9) Participation with Other Utilities	(See note below)
--	------------------

Note: FMPA currently has no new proposed transmission lines.

FMPA

Appendix I List of Abbreviations

Generator Type

CA	Steam Portion of Combined Cycle
CC	Combined Cycle (Total Unit)
CT	Combustion Turbine Portion of Combined Cycle
GT	Combustion Turbine
IC	Internal Combustion Engine
NP	Nuclear Power
ST	Steam Turbine

Fuel Type

BIT	Bituminous Coal
DFO	Distillate Fuel Oil
NG	Natural Gas
RFO	Residual Fuel Oil
UR	Uranium
WH	Waste Heat

Fuel Transportation Method

PL	Pipeline
RR	Railroad
TK	Truck
WA	Water Transportation

Status of Generating Facilities

P	Planned Unit (Not Under Construction)
L	Regulatory Approval Pending. Not Under Construction
RT	Existing Generator Scheduled for Retirement
U	Under Construction, Less Than or Equal to 50% Complete
V	Under Construction, More Than 50% Complete
A	Generation Unit Capability Increased
OT	Other
IR	Inactive Reserve (Emergency Only)

Other

NA	Not Available or Not Applicable
----	---------------------------------

FMPA

Appendix II
ARP Participant Transmission Information

Table II-1 presented on the following page contains a list of planned and proposed transmission facility additions for ARP Participant cities.

**Table II-1
Planned and Proposed Transmission Additions for ARP Participants
2012 through 2020 (69 kV and Above)**

City	From	To	MVA	Voltage	Circuit	Estimated In-Service Date
Kissimmee	Osceola Parkway Substation	Osceola Parkway Osceola Parkway		69 kV	1	6/2017
	Lake Bryan			69 kV		6/2017
	Lake Cecile			69 kV		6/2017
	Domingo Toro Substation			69 kV		6/2019
Ocala	Shaw Second 30 MVA Transformer		30	69/12.47 kV	1	6/2017
	Ergle Second 168 MVA Transformer		168	230/69 kV	1	12/2020

FMPA

Appendix III Additional Reserve Margin Information

FMPA excludes Partial Requirements (PR) purchases that are being supplied by the PR utility in the calculation of reserves being supplied in Schedules 7.1 and 7.2. The PR utility is required to serve the ARP load equivalent to that of the PR utility's own native load. Thus, the PR purchase by FMPA is equal to the purchase capacity plus equivalent reserves of the selling utility and therefore does not require additional reserves to be carried by FMPA. Tables III-1 and III-2 below are provided as supplements to Ten-Year Site Plan Schedules 7.1 and 7.2 to demonstrate how the reserve margin percentages were calculated for the summer and winter peaks, respectively.

**Table III-1
Calculation of Reserve Margin at Time of Summer Peak
All-Requirements Power Supply Project**

Year	Total Available Capacity (MW)	System Firm Peak Demand (MW)	Partial Requirements Purchases (MW)	Reserve Margin (MW) [1]	Reserve Margin (%) [2]
(a)	(b)	(c)	(d)	(e)	(f)
2013	1,779	1,313	0	466	36%
2014	1,667	1,252	0	415	33%
2015	1,669	1,276	0	393	31%
2016	1,669	1,273	0	396	31%
2017	1,669	1,294	0	375	29%
2018	1,669	1,316	0	353	27%
2019	1,669	1,338	0	331	25%
2020	1,669	1,360	0	309	23%
2021	1,669	1,382	0	287	21%
2022	1,669	1,405	0	264	19%

[1] Reserve Margin MW calculated as follows: (Total Available Capacity - Partial Requirements Purchases) - (System Firm Peak Demand - Partial Requirements Purchases)

[2] Reserve Margin % calculated as follows: [(Total Available Capacity - Partial Requirements Purchases) - (System Firm Peak Demand - Partial Requirements Purchases)] / (System Firm Peak Demand - Partial Requirements Purchases)

**Table III-2
Calculation of Reserve Margin at Time of Winter Peak
All-Requirements Power Supply Project**

Year	Total Available Capacity (MW)	System Firm Peak Demand (MW)	Partial Requirements Purchases (MW)	Reserve Margin (MW) [1]	Reserve Margin (%) [2]
(a)	(b)	(c)	(d)	(e)	(f)
2012/13	1,903	1,247	45	656	55%
2013/14	1,744	1,198	0	546	46%
2014/15	1,744	1,221	0	524	43%
2015/16	1,746	1,218	0	528	43%
2016/17	1,746	1,238	0	508	41%
2017/18	1,746	1,258	0	488	39%
2018/19	1,746	1,278	0	468	37%
2019/20	1,746	1,300	0	446	34%
2020/21	1,746	1,320	0	426	32%
2021/22	1,746	1,341	0	405	30%

[1] Reserve Margin MW calculated as follows: (Total Available Capacity - Partial Requirements Purchases) - (System Firm Peak Demand - Partial Requirements Purchases)

[2] Reserve Margin % calculated as follows: [(Total Available Capacity - Partial Requirements Purchases) - (System Firm Peak Demand - Partial Requirements Purchases)] / (System Firm Peak Demand - Partial Requirements Purchases)

FMPA

Florida Municipal Power Agency
8553 Commodity Circle
Orlando, FL 32819-0002
www.fmpa.com