

080695-WU

**CLASS A**  
**WATER AND/OR WASTEWATER UTILITIES**  
**ADDITIONAL ENGINEERING**  
**INFORMATION**  
**MINIMUM FILING**  
**REQUIREMENTS**

**OF**

**Peoples Water Service Company of Florida, Inc.**

Exact Legal Name of Utility

**VOLUME IIIA**



**FOR THE**

**TEST YEAR ENDED December 31, 2008**

DOCUMENT NUMBER DATE

05020 MAY 20 8

FPSC-COMMISSIONER CLERK

**THE PEOPLES WATER SERVICE COMPANY OF FLORIDA, INC.**

**2008 CHEMICAL TESTING RESULTS**

**VOLUME III-A**

**TABLE OF CONTENTS**

- A. 2008 Chemical Usage Calculation Date
- B. 2008 Monthly Operating Reports
- C. 2007 Monthly Operating Reports
- D. D.E.P Surveys
- E. D.E.P. Construction Permits
- F. Employee Listing
- G. Vehicle Listing
- H. 2008 Customer Concern Records

DOCUMENT NUMBER - DATE

05020 MAY 20 8

FPSC-COMMISSION CLERK



# 2008 Chemical Usage Calculation Data

DOCUMENT NUMBER-DATE

05020 MAY 20 8

FPSC-COMMISSION CLERK



CHENEY LIME & CEMENT CO.  
478 Graystone Rd.  
P.O. Box 160  
Allgood, AL 35013  
1-800-752-8282  
FAX # 205-625-3032

# INVOICE

INVOICE NUMBER: 0026136-IN

INVOICE DATE: 02/06/2008

PAGE: 1

PEOPLES WATER SERVICES

P. O. BOX 4815

Pensacola, FL 32507-0815

SHIP  
TO:

PEOPLES WATER SERVICE

905 LOWNDE AVENUE

PENSACOLA, FL

Customer No.	Customer P.O. No/Release	Ship Via	Terms	Due Date	Sales Rep
PEOWAT		BB	NET 30	03/07/08	AA

Date Shipped	BOL#	Description	Quantity	Units	Material Price	Freight Rate	Total
02/06/08	022199	BAGGED HYDRATE	22.50	TONS	138.500		3,116.25
		FREIGHT				28.220	634.95
02/06/08	022199	FUEL SURCHARGE	22.50	FRT	11.850		266.63

PEOPLES WATER SERVICE CO.  
OF FLORIDA, INC.  
PENSACOLA, FLA.

REC'D IN GOOD

ORDER, DATE 2/6/08

VENDOR # 2070

USED FOR Lime For All Wells

CHARGE ACCT NO. 5410-140

\$4,017.83

PERIOD OF USE 3 Months

APPROVED [Signature]

MANAGER

Total	45.00	TON	Net Invoice:	4,017.83
-------	-------	-----	--------------	----------

CONFIRM TO:

Total Due



LIME MANUFACTURERS  
ESTABLISHED 1903

CHENEY LIME & CEMENT CO.  
478 Graystone Rd.  
P.O. Box 180  
Allgood, AL 35013  
1-800-752-8282  
FAX # 205-625-3032

# INVOICE

INVOICE NUMBER: 0027004-IN

INVOICE DATE: 04/22/2008

PAGE: 1

PEOPLES WATER SERVICES  
P. O. BOX 4815  
Pensacola, FL 32507-0815

SHIP TO: PEOPLES WATER SERVICE  
905 LOWNDE AVENUE  
PENSACOLA, FL

Customer No.	Customer P.O. No/Release	Ship Via	Terms	Due Date	Sales Rep
PEOWAT		MDS	NET 30	05/22/08	AA

Date Shipped	BOL#	Description	Quantity	Units	Material Price	Freight Rate	Total
04/22/08	011919	BAGGED HYDRATE	22.50	TONS	138.500		3,116.25
		FREIGHT				35.360	795.60
04/22/08	011919	FUEL SURCHARGE	22.50	FRT	7.960		179.10

PEOPLES WATER SERVICE CO.  
OF FLORIDA, INC.  
PENSACOLA, FLA

REC'D IN GOOD  
ORDER, DATE 4-22-08  
VENDOR # 2070  
USED FOR LIME FOR ALL WELL SITES  
CHARGE ACCT NO. 5410-140  
\$ 4090.95  
PERIOD OF USE 3 Months  
APPROVED [Signature]  
MANAGER

Tot	45.00	TON	Net Invoice:	4,090.95
CONFIRM TO:			Total Due	



LIME MANUFACTURERS  
ESTABLISHED 1903

CHENEY LIME & CEMENT CO.  
478 Graystone Rd.  
P.O. Box 160  
Allgood, AL 35013  
1-800-752-8282  
FAX # 205-625-3032

# INVOICE

INVOICE NUMBER: 0027594-IN

INVOICE DATE: 06/06/2008

PAGE: 1

OLD  
O: PEOPLES WATER SERVICES  
P. O. BOX 4815  
Pensacola, FL 32507-0815

SHIP  
TO: PEOPLES WATER SERVICE  
905 LOWNDE AVENUE  
PENSACOLA, FL

Customer No.	Customer P.O. No/Release	Ship Via	Terms	Due Date	Sales Rep
PEOWAT		STT	NET 30	07/06/08	AA

Date Shipped	BOL#	Description	Quantity	Units	Material Price	Freight Rate	Total
06/06/08	014753	BAGGED HYDRATE	22.50	TONS	138.500		3,116.25
		FREIGHT				34.370	773.33
06/06/08	014753	FUEL SURCHARGE	22.50	FRT	12.370		278.33

PEOPLES WATER SERVICE CO.  
OF FLORIDA, INC.  
PENSACOLA, FLA.

REC'D IN GOOD  
ORDER, DATE 6/6/08  
VENDOR # 2070  
USED FOR Lime for All Well Sites  
CHARGE ACCT NO. 5410-140  
\$4,167.91  
PERIOD OF USE 2 Months  
APPROVED [Signature]  
MANAGER

T :	45.00	TON	Net Invoice:	4,167.91
CONFIRM TO:			Total Due	



LIME MANUFACTURERS  
ESTABLISHED 1903

CHENEY LIME & CEMENT CO.  
478 Graystone Rd.  
P.O. Box 160  
Allgood, AL 35013  
1-800-752-8282  
FAX # 205-625-3032

# INVOICE

INVOICE NUMBER: 0028257-IN

INVOICE DATE: 07/23/2008

PAGE: 1

OLD  
O: PEOPLES WATER SERVICES  
P. O. BOX 4815  
Pensacola, FL 32507-0815

SHIP  
TO: PEOPLES WATER SERVICE  
905 LOWNDE AVENUE  
PENSACOLA, FL

Customer No.	Customer P.O. No/Release	Ship Via	Terms	Due Date	Sales Rep
PEOWAT		STT	NET 30	08/22/08	AA

Date Shipped	BOL#	Description	Quantity	Units	Material Price	Freight Rate	Total
07/23/08	013028	BAGGED HYDRATE	22.50	TONS	138.500		3,116.25
		FREIGHT				34.370	773.33
07/23/08	013028	FUEL SURCHARGE	22.50	FRT	12.370		278.33

PEOPLES WATER SERVICE CO.  
OF FLORIDA, INC.  
PENSACOLA, FLA.

REC'D IN GOOD

ORDER, DATE 7/23/08

VENDOR # 2070

USED FOR Lime for All Wells

CHARGE ACCT NO. 5410-140

\$4,167.91

PERIOD OF USE 3 Months

APPROVED W. W. W.

MANAGER

T	45.00	TON	Net Invoice:	4,167.91
CONFIRM TO:			Total Due	





LIME MANUFACTURERS  
ESTABLISHED 1903

CHENEY LIME & CEMENT CO.  
478 Crayslor Rd.  
P.O. Box 160  
Allgood, AL 35013  
1-800-752-8282  
FAX # 205-625-3032

# INVOICE

INVOICE NUMBER: 0029241-IN

INVOICE DATE: 10/07/2008

PAGE: 1

OLD  
O: PEOPLES WATER SERVICES  
P. O. BOX 4815  
PENSACOLA, FL 32507-0815

SHIP  
TO: PEOPLES WATER SERVICE  
905 LOWNDE AVENUE  
PENSACOLA, FL

Customer No.	Customer P.O. No/Release	Ship Via	Terms	Due Date	Sales Rep
PEOWAT		STT	NET 30	11/06/08	AA

Date Shipped	BOL#	Description	Quantity	Units	Material Price	Freight Rate	Total
10/07/08	015846	BAGGED HYDRATE	18.00	TONS	138.500		2,493.00
10/07/08	015846	ENERGY SURCHARGE	18.00	TONS	5.650		101.70
		FREIGHT				34.370	773.33
10/07/08	015846	FUEL SURCHARGE	22.50	FRT	9.970		224.33

PEOPLES WATER SERVICE CO.  
OF FLORIDA, INC.  
PENSACOLA, FLA.

REC'D IN GOOD

ORDER, DATE 10/7/08

VENDOR # 2070

USED FOR Lime for All Wells

CHARGE ACCT NO. 5410-140

\$ 3,592.36

PERIOD OF USE 3 months

APPROVED [Signature]

MANAGER

T	58.50	TON	Net Invoice:	3,592.36
CONFIRM TO:			Total Due	



LIME MANUFACTURERS  
ESTABLISHED 1993

CHENEY LIME & CEMENT CO.  
478 Graystone Rd.  
P.O. Box 160  
Allgood, AL 35013  
1-800-752-8282  
FAX # 205-625-3032

# INVOICE

INVOICE NUMBER: 0029944-IN

INVOICE DATE: 12/15/2008

PAGE: 1

OLD  
O: PEOPLES WATER SERVICES  
P. O. BOX 4815  
PENSACOLA, FL 32507-0815

SHIP  
TO: PEOPLES WATER SERVICE  
905 LOWNDE AVENUE  
PENSACOLA, FL

Customer No.	Customer P.O. No/Release	Ship Via	Terms	Due Date	Sales Rep
PEOWAT		STT	NET 30	01/14/09	AA

Date Shipped	BOL#	Description	Quantity	Units	Material Price	Freight Rate	Total
12/15/08	017324	BAGGED HYDRATE	22.50	TONS	138.500		3,116.25
12/15/08	017324	ENERGY SURCHARGE	22.50	TONS	5.650		127.13
		FREIGHT				34.370	773.33
12/15/08	017324	FUEL SURCHARGE	22.50	PKT	5.500		123.75

PEOPLES WATER SERVICE CO.  
OF FLORIDA, INC.  
PENSACOLA, FLA.

REC'D IN GOOD

ORDER, DATE 12/15/08

VENDOR # 2070

USED FOR All Wells

CHARGE ACCT NO. 5410-140

\$4,140.46

PERIOD OF USE 3 mos

APPROVED

MANAGER

67.50

TON

Net Invoice:

4,140.46

CONFIRM TO:

Total Due

# Peoples Water Service Company of Florida, Inc.

## Chlorine Calculation Report

Chemical Supplier : Water Specialties  
 Type of supply: Chlorine Gas, 150 lbs Cylinders

December-08

Month of Test Year/Data	Well 3 Usage (lbs)	Well 4 Usage (lbs)	Well 5 Usage (lbs)	Well 8 Usage (lbs)	Well 9 Usage (lbs)	Individual Monthly Usage Totals (lbs)	Monthly Well Pumpage Totals (MG)	Average Monthly Dosage Rates (ppm,mg/l)
January-08	136	160	103	62	76	537	86,545,000	0.74
February-08	116	141	78	41	233	609	87,874,000	0.83
March-08	120	155	78	41	92	486	77,974,000	0.75
April-08	124	178	110	48	46	506	74,172,000	0.82
May-08	2	293	142	61	161	659	74,025,000	1.07
June-08	0	330	136	72	148	686	74,748,000	1.10
July-08	0	281	119	75	160	615	69,558,000	1.06
August-08	0	308	98	60	160	626	62,219,000	1.21
September-08	0	404	99	63	125	691	74,025,000	1.12
October-08	65	263	83	62	122	595	74,748,000	0.95
November-08	92	126	92	66	94	470	69,558,000	0.81
December-08	85	107	86	60	96	434	62,219,000	0.84
<i>Individual Well Usage Totals (lbs)</i>	740	2,726	1,224	711	1,513	6,914	****	****

Supplier Invoice Date	Purchase Amount (lbs)	Purchase Cost
8-Feb-08	1,200	\$725.00
3-Apr-08	1,500	\$905.00
2-Jun-08	1,050	\$646.00
18-Jul-08	900	\$563.00
5-Sep-08	1,050	\$651.00
3-Oct-08	900	\$563.00
NA	NA	\$0.00
<i>Invoice Totals</i>	6,600	\$4,053.00

**Average Chlorine dosage rate for Test Year (ppm,mg/l)**

**0.94**

Useful Formulas for dosage rates:

Average Monthly Dosage Rate = Total Monthly Usage/8.34/(pumpage total/1000000)  
 Average Test Year Dosage Rate = Average Monthly Dosage Rates/12 months



# Invoice

Invoice Number:  
2458

Invoice Date:  
Feb 8, 2008

Page:  
1

Water and Waste Specialties LLC  
P. O. Box 746  
Theodore, AL 36590

Voice: 251-653-4300  
Fax: 251-653-5300

Sold To:  
PEOPLES WATER SERVICE CORP.  
ACCOUNTS PAYABLE  
P. O. BOX 4815  
PENSACOLA, FL 32507

Ship to:

Customer ID	Customer PO	Payment Terms	
PEOPLES	VERBAL/RUSS	Net 30 Days	
Sales Rep ID	Shipping Method	Ship Date	Due Date
	Company Truck	2/8/08	3/9/08

Quantity	Item	Description	Unit Price	Extension
4.00	CL-2WA	150# CYL CHLORINE SER #: 1627 1680 1745 1425	88.00	352.00
4.00	CL-2D	150# CYL CHLORINE SER #: 28256 69952 82742 13014	88.00	352.00
1.00	FUEL SURCHARGE	FUEL SURCHARGE	21.00	21.00
<div style="border: 1px solid black; padding: 5px; margin: 10px auto; width: 60%; text-align: center;"><p>PEOPLES WATER SERVICE CO. OF FLORIDA, INC. PENSACOLA, FLA.</p><p>REC'D IN GOOD ORDER, DATE <u>2/8/08</u> VENDOR # <u>6105</u> USED FOR <u>All Wells</u> CHARGE ACCT NO. <u>5410-140</u> <u>\$725.00</u> PERIOD OF USE <u>3 months</u> APPROVED <u>[Signature]</u> MANAGER</p></div>				

Check/Credit Memo No:

Subtotal	725.00
Sales Tax	87.00
Freight	
Total Invoice Amount	725.00
Payment/Credit Applied	
<b>TOTAL</b>	<b>725.00</b>

A late charge of 1.5% will apply on past due invoices over 30 days

# Invoice

Invoice Number:

2782

Invoice Date:

Apr 3, 2008

Page:

1

**Water and Waste Specialties LLC****P. O. Box 746****Theodore, AL 36590**

Voice: 251-653-4300

Fax: 251-653-5300

**Sold To:**PEOPLES WATER SERVICE CORP.  
ACCOUNTS PAYABLE  
P. O. BOX 4815  
PENSACOLA, FL 32507**Ship to:**

Customer ID	Customer PO	Payment Terms	
PEOPLES	VERBAL/RUSS	Net 30 Days	
Sales Rep ID	Shipping Method	Ship Date	Due Date
	Company Truck	4/10/08	5/3/08

Quantity	Item	Description	Unit Price	Extension
10.00	CL-2W	150# CHLORINE CYL SER #: 413759 1210 CX83616 1758 1149 CX82489 CX69073 1444265 165138 158	88.00	880.00
1.00	FUEL SURCHARGE	FUEL SURCHARGE	25.00	25.00
<div style="border: 1px solid black; padding: 5px; margin: 10px auto; width: 60%; text-align: center;"><p>PEOPLES WATER SERVICE CO. OF FLORIDA, INC. PENSACOLA, FLA.</p><p>REC'D IN GOOD ORDER, DATE <u>4/3/08</u> VENDOR # <u>6105</u> USED FOR <u>Chlorine for all sites</u> CHARGE ACCT NO. <u>5410-140</u> <u>\$905.00</u> PERIOD OF USE <u>3 months</u> APPROVED <u>[Signature]</u> MANAGER</p></div>				

Subtotal	905.00
Sales Tax	
Freight	
Total Invoice Amount	905.00
Payment/Credit Applied	
<b>TOTAL</b>	<b>905.00</b>

Check/Credit Memo No:

A late charge of 1.5% will apply on past due invoices over 30 days

# Invoice

Invoice Number:

3036

Invoice Date:

Jun 2, 2008

Page:

1

**Water and Waste Specialties LLC****P. O. Box 746****Theodore, AL 36590**

Vol. 251-653-4300

Fax: 251-653-5300

Sold To:

PEOPLES WATER SERVICE CORP.  
ACCOUNTS PAYABLE  
P. O. BOX 4815  
PENSACOLA, FL 32507

Ship to:

Customer ID	Customer PO	Payment Terms	
PEOPLES	VERBAL/RUSS	Net 30 Days	
Sales Rep ID	Shipping Method	Ship Date	Due Date
	Company Truck	6/2/08	7/2/08

Quantity	Item	Description	Unit Price	Extension
7.00	CL-2W	150# CHLORINE CYL SER #: CX12367	88.00	616.00
		CX181713 1146 1670 95056 1779		
1.00	FUEL SURCHARGE	FUEL SURCHARGE	30.00	30.00
<div>PEOPLES WATER SERVICE CO. OF FLORIDA, INC. PENSACOLA, FLA.  REC'D IN GOOD ORDER, DATE <u>6/2/08</u> VENDOR # <u>6105</u> USED FOR <u>Chlorine - All sites</u> CHARGE ACCT NO. <u>5410-140</u> <u>\$646.00</u> PERIOD OF USE <u>2 Months</u> APPROVED <u>[Signature]</u> MANAGER</div>				

Subtotal	646.00
Sales Tax	
Freight	
Total Invoice Amount	646.00
Payment/Credit Applied	
<b>TOTAL</b>	<b>646.00</b>

Check/Credit Memo No:

A late charge of 1.5% will apply on past due invoices over 30 days

**Water and Waste Specialties LLC**  
**P. O. Box 746**  
**Theodore, AL 36590**

**Invoice**  
 Invoice Number:  
 3344

Invoice Date:  
 Jul 18, 2008

Voice: 251-653-4300  
 Fax: 251-653-5300

Page:  
 1

Sold To:  
 PEOPLES WATER SERVICE CORP.  
 ACCOUNTS PAYABLE  
 P. O. BOX 4815  
 PENSACOLA, FL 32507

Ship to:

Customer ID	Customer PO	Payment Terms	
PEOPLES	VERBAL/RUSS	Net 30 Days	
Sales Rep ID	Shipping Method	Ship Date	Due Date
	Company Truck	7/18/08	8/17/08

Quantity	Item	Description	Unit Price	Extension
4.00	CL-2W	150# CHLORINE CYL SER #: 1168 CX88260 1253 CX36118	88.00	352.00
2.00	CL-2D	150# CYL CHLORINE SER #: 56226 13185	88.00	176.00
1.00	FUEL SURCHARGE	FUEL SURCHARGE	35.00	35.00

PEOPLES WATER SERVICE CO.  
 OF FLORIDA, INC.  
 PENSACOLA, FLA.

REC'D IN GOOD  
 ORDER, DATE 7/18/08  
 VENDOR # 6105  
 USED FOR All Wells  
 CHARGE ACCT NO. 5410-140  
\$563.00

PERIOD OF USE 3 Months  
 APPROVED [Signature]  
 MANAGER

Check/Credit Memo No:

Subtotal	563.00
Sales Tax	
Freight	
Total Invoice Amount	563.00
Payment/Credit Applied	
<b>TOTAL</b>	<b>563.00</b>

A late charge of 1.5% will apply on past due invoices over 30 days

**Water and Waste Specialties LLC**P. O. Box 746  
Theodore, AL 36590**INVOICE**Invoice Number: 3613  
Invoice Date: Sep 5, 2008  
Page: 1Voice: 251-653-4300  
Fax: 251-653-5300

Bill To
PEOPLES WATER SERVICE CORP. ACCOUNTS PAYABLE P. O. BOX 4815 PENSACOLA, FL 32507

Ship To

Company ID	Customer Ref	Payment Days
PEOPLES	VERBAL/RUSS	Net 30 Days
Supplier Ref	Supplier Name	
	Company Truck	9/5/08 10/5/08

Quantity	Item	Description	Unit Price	Total Price
7.00	CL-2H	150# CHLORINE CYL SER #: 11587 4261	88.00	616.00
		6406 1797 1583 4303 3958		
1.00	FUEL SURCHARGE	FUEL SURCHARGE	35.00	35.00

PEOPLES WATER SERVICE CO. OF FLORIDA, INC. PENSACOLA, FLA.
REC'D IN GOOD
ORDER, DATE <u>9/5/08</u>
VENDOR # <u>6105</u>
USED FOR <u>All Wells</u>
CHARGE ACCT NO. <u>5410-140</u>
<u>\$651.00</u>
PERIOD OF USE <u>2 Months</u>
APPROVED <u>[Signature]</u>
MANAGER

Subtotal	651.00
Sales Tax	
Total Invoice Amount	651.00
Payment/Credit Applied	

Check/Credit Memo No:

A late charge of 1.5% will apply on past due invoices over 30 days

# Water and Waste Specialties LLC

P. O. Box 746  
Theodore, AL 36590

# INVOICE

Invoice Number: 3760  
Invoice Date: Oct 3, 2008  
Page: 1

tel: 251-653-4300  
Fax: 251-653-5300

PEOPLES WATER SERVICE CORP.  
ACCOUNTS PAYABLE  
P. O. BOX 4815  
PENSACOLA, FL 32507

Customer	Customer PO	Payment Terms
PEOPLES	VERBAL/RUSS	Net 30 Days
Sales Rep ID	Shipping Method	Ship Date
	Company Truck	10/3/08
		11/2/08

Quantity	Item	Description	Unit Price	Amount
6.00	CL-2WH	150# CHLORINE CYL SER #:CX181294	88.00	528.00
		1519 6163259 1527 CX68971 CX181522		
1.00	FUEL SURCHARGE	FUEL SURCHARGE	35.00	35.00

PEOPLES WATER SERVICE CO.  
OF FLORIDA, INC.  
PENSACOLA, FLA.

REC'D IN GOOD

ORDER, DATE 10-3-08

VENDOR # 6105

USED FOR ALL SITES

CHARGE ACCT. NO. 5410-140

\$ 563.00

PERIOD OF USE 3 MONTHS

APPROVED [Signature]

MANAGER

Subtotal	563.00
Sales Tax	
Freight	
Total Invoice Amount	563.00
Payment/Credit Applied	

Check/Credit Memo No:

A late charge of 1.5% will apply on past due invoices over 30 days



**Water Treatment  
& Controls Co.**

REMIT TO:  
9900A N. PALAFOX STREET  
PENSACOLA, FLORIDA 32534  
(850) 474-1805  
FAX (850) 474-1776

# INVOICE

INVOICE DATE: 4/30/2008  
INVOICE NO: 0080558-IN  
Ship Date: 4/24/2008  
CUSTOMER NO: 0000673  
SALES PERSON: 0007  
PAGE: 1

**SOLD TO:**

The Peoples Water FL-1.5  
Accounts Payable  
PO Box 4815  
Pensacola, FL 32507

**SHIPPED TO:**

905 Lowndes Avenue  
Pensacola, FL 32507

FO.B POINT Origin	CUSTOMER ORDER NO. Verbal-Russ	SHIP VIA FREIGHT TRUCK	TERMS X Net 30	OUR ORDER NO. 0042725
----------------------	-----------------------------------	---------------------------	-------------------	--------------------------

ITEM NO./SERIAL NO.	UNIT	QUANTITY			UNIT PRICE	EXTENDED PRICE
		ORDERED	BACK ORDERED	SHIPPED		
CP1236-B	Gal	468.00	0.00	468.00	11.652	5359.92

Site: 010 WT&C Pensacola  
Sweetwater CP1236 Bulk (Two to

NOTE: FREIGHT NOT INCLUDED IN PRICING. MUST DELIVER BY TRUCK WITH LIFTGATE.  
PEOPLES WATER SERVICE SHOULD RETURN THEIR TOTES FOR REFILL.

FREIGHT CHARGES SHOULD INCLUDE DELIVERY AND RETURNED TOTE FREIGHT.

BO#050446

C. CALS NON TAXABLE SALE

**PEOPLES WATER SERVICE CO.  
OF FLORIDA, INC.  
PENSACOLA, FLA.**

REC'D IN GOOD  
ORDER, DATE 4-24-08  
VENDOR # 6000  
USED FOR SAL WELL SITES  
CHARGE ACCT NO 5410-100  
A 6118.54  
PERIOD OF USE 12 MONTHS  
APPROVED [Signature]  
MANAGER

Sales Total: 5359.92  
Trade Discount: 0.00  
Freight: 758.62  
Tax Total: 0.00

A FINANCE CHARGE OF 1-1-2% PER MONTH WHICH IS AN ANNUAL RATE OF 18% WILL BE CHARGED ON ALL PAST DUE ACCOUNTS, AND IF SUCH PAYMENT IS NOT SO MADE AND THIS ACCOUNT IS PLACED IN THE HANDS OF AN ATTORNEY OR COLLECTION AGENCY, CUSTOMER AGREES TO PAY, IN ADDITION TO THE AMOUNT DUE, A REASONABLE AMOUNT OF COSTS.

6118.54



# Water Treatment & Controls Co.

## REMIT TO:

9900A N. PALAFOX STREET  
PENSACOLA, FLORIDA 32534  
(850) 474-1805  
FAX (850) 474-1776

## INVOICE

INVOICE DATE: 9/30/2008  
INVOICE NO: 0082047-IN  
Ship Date: 9/23/2008  
CUSTOMER NO: 0000673  
SALES PERSON: 0007  
PAGE: 1

### SOLD TO:

The Peoples Water FL-1.5  
Accounts Payable  
PO Box 4815  
Pensacola, FL 32507

### SHIPPED TO:

The Peoples Water FL  
905 Lowndes Avenue  
Pensacola, FL 32507

FOB POINT	CUSTOMER ORDER NO.	SHIP VIA	TERMS	OUR ORDER NO.
Origin	Verbal-RUBB	FREIGHT TRUCK	Net 30	0082047

ITEM NO./SERIAL NO.	UNIT	ORDERED	QUANTITY BACK ORDERED	SHIPPED	UNIT PRICE	EXTENDED PRICE
CP1236-B	GAL	460.00	0.00	460.00	14.411	6631.82

Site: 010 WT&C Pensacola  
Sweetwater CP1236 Bulk

Freight is prepay and add from Athens to Pensacola. WTC will pay for return tote freight to Athens.  
BO#051123

### PEOPLES WATER SERVICE CO. OF FLORIDA, INC. PENSACOLA, FLA.

REC'D IN GOOD

ORDER, DATE 9/30/08

VENDOR # 6000

USED FOR All Well Sites

CHARGE ACCT NO. 5410-140

\$7,299.97

PERIOD OF USE 4 1/2 Months

APPROVED [Signature]

MANAGER

Sales Total: 6631.82  
Trade Discount: 0.00  
Freight: 668.15  
Tax Total: 0.00

A FINANCE CHARGE OF 1-1-2% PER MONTH WHICH IS AN ANNUAL RATE OF 18% WILL BE CHARGED ON ALL PAST DUE ACCOUNTS, AND IF SUCH PAYMENT IS NOT SO MADE AND THIS ACCOUNT IS PLACED IN THE HANDS OF AN ATTORNEY OR COLLECTION AGENCY, CUSTOMER AGREES TO PAY, IN ADDITION TO THE AMOUNT DUE, A REASONABLE AMOUNT AS ATTORNEY FEES AND OR COLLECTION

**TOTAL**

7299.97



# Peoples Water Service Company of Florida, Inc.

## Zinc Orthophosphate Calculation Report

Chemical Supplier : Sweetwater Inc.  
 Type of supply: Zinc Orthophosphate, per gallon

December-08

Month of Test Year/Data	Well 3 Usage (gals)	Well 4 Usage (gals)	Well 5 Usage (gals)	Well 8 Usage (gals)	Well 9 Usage (gals)	Individual Monthly Usage Totals (gals)	Monthly Well Pumpage Totals (MG)	Average Monthly Dosage Rates (ppm,mg/l)
January-08	19	17	17	8	18	79	86,545,000	1.39
February-08	18	19	15	7	24	83	87,874,000	1.44
March-08	21	22	29	22	12	106	77,974,000	2.08
April-08	18	15	22	10	13	78	74,172,000	1.61
May-08	1	23	22	11	44	101	74,025,000	2.08
June-08	0	24	22	9	42	97	74,748,000	1.98
July-08	0	20	18	15	42	95	69,558,000	2.09
August-08	0	13	19	22	19	73	62,219,000	1.79
September-08	0	28	16	14	30	88	74,025,000	1.82
October-08	7	17	12	17	30	83	74,748,000	1.70
November-08	8	8	11	10	27	64	69,558,000	1.41
December-08	8	7	14	9	23	61	62,219,000	1.50
<i>Individual Well Usage Totals (lbs)</i>	100	213	217	154	324	1,008	****	****

Supplier Invoice Date	Purchase Amount (gals)	Purchase Cost
30-Apr-08	460	\$6,118.54
30-Sep-08	460	\$7,299.97
NA	NA	\$0.00
NA	NA	\$0.00
NA	NA	\$0.00
NA	NA	\$0.00
<i>Invoice Totals</i>	920	\$13,418.51

<b>Average Zinc Orthophosphate dosage rate for Test Year (ppm,mg/l)</b>	<b>1.74</b>
---	-------------

Useful Formulas for dosage rates:

Average Monthly Dosage Rate	=	Total Monthly Usage/8.34/(pumpage total/1000000)
Average Test Year Dosage Rate	=	Average Monthly Dosage Rates/12 months

## **2008 Monthly Operating Reports**



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

**I. General Information for the Month/Year of:** **December 2008**

## A. Public Water System (PWS) Information


PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,407			Total Population Served at End of Month:	32,925
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross			Person's Title:	Manager
Contact Person's Mailing Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Contact Person's Telephone Number:	(850) 455-8552	Contact Person's Fax Number:	(850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com				

## B. Water Treatment Plant Information

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9			Plant Telephone	(850) 455-8552
Plant Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water	<input type="checkbox"/> Purchased Finished Water			
Permitted Maximum Day Operating Capacity of Plant:	4,860,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8:00am - 5:00 pm/weekend visit	
Other Operators:	Mark Cross	7169	A	Mon - Fri 8:00am - 5:00 pm	
	Dan Middlebrook	8445	C	Mon - Fri 8:00am - 5:00 pm	
	Russ Barrett	12704	B	Mon - Fri 8:00am - 5:00 pm/weekend visit	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

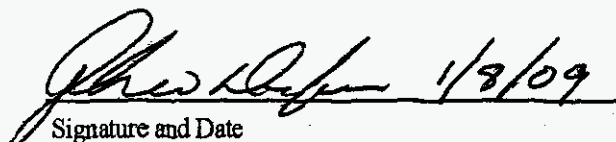  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

Plant Name: **Well # 3**

**December 2008**☒ Free Chlorine    ☐ Chlorine Dioxide    ☐ Ozone    ☐ Combined Chlorine (Chloramines)    ☐ Ultraviolet Radiation    ☐ Other:

[x]Free Chlorine

[ ] Combined Chlorine (Chloramines)

[ ]Chlorine Dioxide

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 31

days checked by operator 31

# MONTGOMERY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Id. Location Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data for the Month Year of:

**December 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	FE	Temp. of Water at FE, °F	Temp. of Water at Distribution System, °F	Temp. of Water at Remote Point in Distribution System, °F	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	19.7	1,022,430								0.5	0
2	X	13.8	716,220								0.5	0
3	X	0.0	0								0.5	0
4	X	18.6	965,340								0.6	0
5	X	0.0	0								0.5	0
6	X	12.2	633,180								0.5	0
7	X	0.0	0								0.5	0
8	X	7.2	373,680								0.5	0
9	X	0.0	0								0.5	0
10	X	0.0	0								0.5	0
11	X	0.0	0								0.6	0
12	X	0.0	0								0.4	0
13	X	0.0	0								0.6	0
14	X	0.0	0								0.6	0
15	X	0.0	0								0.6	0
16	X	0.0	0								0.5	0
17	X	0.0	0								0.6	0
18	X	23.4	1,214,460								0.5	0
19	X	0.0	0								0.4	0
20	X	0.0	0								0.5	0
21	X	0.0	0								0.4	0
22	X	0.0	0								0.6	0
23	X	0.0	0								0.5	0
24	X	0.0	0								0.5	0
25	X	24.2	1,255,980								0.5	0
26	X	0.0	0								0.5	0
27	X	15.9	825,210								0.4	0
28	X	14.6	757,740								0.4	0
29	X	0.0	0								0.4	0
30	X	0.0	0								0.6	0
31	X	0.0	0								0.6	0
			7,764,240									
			250,459									
			1,255,980									

LOWEST RESIDUAL 0.4

days checked by operator: 31

DAYS IN MONTH 31



Plant Name: **Well # 5**

days checked by operator 31



**WATER OR PURCHASED FINISHED WATER**

**December 2008**☒ Free Chlorine    ☐ Chlorine Dioxide    ☐ Ozone    ☐ Combined Chlorine (Chloramines)    ☐ Ultraviolet Radiation    ☐ Other:☒ Free Chlorine      ☐ Combined Chlorine (Chloramines)      ☐ Chlorine Dioxide

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 31



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Location Number: **FL 1170527**

Plant Name: **Well # 9**

III. Daily Data for the Month Year of: **December 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg/L	Level of all of Water Distribution System, ft	Level of all of Water Distribution System, ft	Level of all of Water Distribution System, ft	Level of all of Water Distribution System, ft	Level of all of Water Distribution System, ft	Level of all of Water Distribution System, ft	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	3.6	177,120											0.5	0
2	X	25.1	1,234,920											0.5	0
3	X	0.0	0											0.5	0
4	X	7.1	349,320											0.6	0
5	X	20.5	1,008,600											0.5	0
6	X	0.0	0											0.5	0
7	X	25.0	1,230,000											0.5	0
8	X	0.0	0											0.5	0
9	X	15.6	767,520											0.5	0
10	X	6.8	334,560											0.5	0
11	X	12.6	618,920											0.6	0
12	X	21.7	1,067,640											0.4	0
13	X	0.0	0											0.6	0
14	X	23.9	1,175,880											0.6	0
15	X	5.4	265,680											0.6	0
16	X	18.8	924,960											0.5	0
17	X	0.0	0											0.6	0
18	X	5.5	270,600											0.5	0
19	X	21.6	1,062,720											0.4	0
20	X	0.0	0											0.5	0
21	X	23.1	1,136,520											0.4	0
22	X	0.0	0											0.6	0
23	X	12.4	610,080											0.5	0
24	X	0.0	0											0.5	0
25	X	0.0	0											0.5	0
26	X	24.9	1,225,080											0.5	0
27	X	0.0	0											0.4	0
28	X	23.5	1,156,200											0.4	0
29	X	0.0	0											0.4	0
30	X	13.0	639,600											0.6	0
31	X	0.0	0											0.6	0
Total			15,256,920												
Average			492,159												
Maximum			1,234,920												

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31



**MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY PLANTS THAT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished Water Production for the Month Year of:

**December 2008**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well #3	Well #4	Well #5	Well #8	Well #9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	1,440,000	1,440,000	1,032,000	1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
1	0	1,022,430	0	1,026,948	177,120						2,226,498
2	0	716,220	0	212,628	1,234,920						2,163,768
3	0	0	1,032,336	986,232	0						2,018,568
4	0	965,340	0	1,035,996	349,320						2,350,656
5	0	0	626,592	0	1,008,600						1,635,192
6	0	633,180	575,232	918,372	0						2,126,784
7	0	0	739,584	0	1,230,000						1,969,584
8	1,032,000	373,680	0	959,088	0						2,364,768
9	1,380,000	0	0	0	767,520						2,147,520
10	0	0	1,135,056	0	334,560						1,469,616
11	312,000	0	0	1,085,760	619,920						2,017,680
12	0	0	564,960	0	1,067,840						1,632,800
13	780,000	0	380,064	959,088	0						2,119,152
14	0	0	790,944	0	1,175,880						1,966,824
15	354,000	0	642,000	741,936	265,680						2,003,616
16	996,000	0	241,392	0	924,960						2,162,352
17	684,000	0	1,109,376	0	0						1,793,376
18	0	1,214,460	0	900,276	270,600						2,385,336
19	0	0	585,504	0	1,082,720						1,668,224
20	1,392,000	0	0	669,552	0						2,061,552
21	0	0	770,400	0	1,136,520						1,906,920
22	1,122,000	0	0	1,049,568	0						2,171,568
23	1,374,000	0	0	0	610,080						1,984,080
24	726,000	0	1,150,464	0	0						1,876,464
25	0	1,255,980	0	814,320	0						2,070,300
26	0	0	616,320	0	1,225,080						1,841,400
27	1,398,000	825,210	0	0	0						2,223,210
28	0	767,740	0	208,104	1,156,200						2,122,044
29	930,000	0	0	972,660	0						1,902,660
30	1,362,000	0	0	0	639,600						2,001,600
31	648,000	0	1,206,960	0	0						1,854,960
Total	14,490,000	7,764,240	12,167,184	12,540,528	18,265,920						62,218,872
Avg.	467,419	247,263	392,489	404,533	589,226						2,007,060
Max.	1,392,000	1,255,980	1,109,376	1,085,760	1,234,920						2,385,336

0.4

0.4

0.4

0.4

0.4

<---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **November 2008**

## A. Public Water System (PWS) Information

PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,928			Total Population Served at End of Month:	32,648
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross			Person's Title:	Manager
Contact Person's Mailing Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Contact Person's Telephone Number:	(850) 455-8552	Contact Person's Fax Number:	(850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com				

## B. Water Treatment Plant Information

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9			Plant Telephone	(850) 455-8552
Plant Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water	<input type="checkbox"/> Purchased Finished Water			
Permitted Maximum Day Operating Capacity of Plant:	4,860,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	
Other Operators:	Mark Cross	7189	A	Mon - Fri 8 :00am - 5:00 pm	
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm	
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

*Theo Deleon* 12/3/08  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier Number: **FL 1170527**

Plant Name: **Walters**

III. Daily Data for the Month/Year of: **November 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Concentration (C) Before or at First Customer During Peak Flow, mg/L	Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	22.9	1,395,000										0.6	0
2	X	0.0	0										0.6	0
3	X	21.3	1,302,000										0.6	0
4	X	21.7	1,296,000										0.5	0
5	X	17.0	1,032,000										0.6	0
6	X	0.0	0										0.5	0
7	X	7.0	383,000										0.5	0
8	X	21.8	1,323,000										0.5	0
9	X	0.0	0										0.5	0
10	X	19.1	1,155,000										0.5	0
11	X	23.5	1,392,000										0.6	0
12	X	4.8	280,000										0.5	0
13	X	0.0	0										0.6	0
14	X	0.0	0										0.5	0
15	X	24.1											0.6	0
16	X	0.0	0										0.5	0
17	X	17.5	1,057,000										0.6	0
18	X	23.4	1,398,000										0.4	0
19	X	17.8	1,078,000										0.7	0
20	X	0.0	0										0.7	0
21	X	0.0	0										0.5	0
22	X	11.7	702,000										0.5	0
23	X	0.0	0										0.4	0
24	X	0.0	0										0.6	0
25	X	0.0	0										0.5	0
26	X	0.0	0										0.5	0
27	X	0.0	0										0.5	0
28	X	0.0	0										0.6	0
29	X	0.0	0										0.5	0
30	X	0.0	0										0.5	0
31	X	0.0	0											0

15,255,000

492,097

1,462,000

LOWEST RESIDUAL 0.0

DAYS IN MONTH 30

days checked by operator 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Plant # 4**

III. Daily Data for the Month/Year of: **November 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Operating UV Dose, mW-sec/cm <sup>2</sup>	UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	19.4	898,000										0.6	0
3	X	0.0	0										0.6	0
4	X	3.9	288,000										0.5	0
5	X	0.0	0										0.6	0
6	X	22.7	1,127,000										0.5	0
7	X	0.0	0										0.5	0
8	X	0.0	0										0.5	0
9	X	0.0	0										0.5	0
10	X	5.3	278,000										0.5	0
11	X	0.0	0										0.6	0
12	X	0.0	0										0.5	0
13	X	23.4	1,139,000										0.6	0
14	X	0.0	0										0.5	0
15	X	0.0	0										0.6	0
16	X	0.0	0										0.5	0
17	X	5.1	264,000										0.6	0
18	X	0.0	0										0.4	0
19	X	0.0	0										0.7	0
20	X	22.9	1,122,000										0.7	0
21	X	0.0	0										0.5	0
22	X	12.6	627,000										0.5	0
23	X	21.6	0										0.4	0
24	X	0.0	1,296,000										0.6	0
25	X	0.0	0										0.5	0
26	X	0.0	0										0.5	0
27	X	22.0											0.5	0
28	X	0.0	0										0.6	0
29	X	18.0	1,080,000										0.5	0
30	X	0.0	0										0.5	0
31	X	0.0	0											0
			<b>9,415,000</b>											
			<b>303,710</b>											
			<b>1,320,000</b>											
				LOWEST RESIDUAL 0.0					days checked by operator: 30					
				DAYS IN MONTH 30										



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier Number: **FL 1170527**

Plant Name: **FL 1170527**

III. Daily Data for the Month/Year of: **November 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Concentration of Disinfectant Before or at First Customer During Peak Flow, mg/L	Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum Required CT, mg-min/L	UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	16.9	893,000										0.6	0
3	X	0.0	0										0.6	0
4	X	0.0	0										0.5	0
5	X	21.9	1,137,000										0.6	0
6	X	0.0	0										0.5	0
7	X	11.7	807,000										0.5	0
8	X	0.0	0										0.5	0
9	X	18.8	965,000										0.5	0
10	X	0.0	0										0.5	0
11	X	6.3	325,000										0.6	0
12	X	16.2	822,000										0.5	0
13	X	0.0	0										0.6	0
14	X	17.8	900,000										0.5	0
15	X	0.0	0										0.6	0
16	X	19.1	972,000										0.5	0
17	X	0.0	0										0.6	0
18	X	0.0	0										0.4	0
19	X	24.6	1,242,000										0.7	0
20	X	0.0	0										0.7	0
21	X	13.8	828,000										0.5	0
22	X	0.0	0										0.5	0
23	X	19.2	1,115,000										0.4	0
24	X	0.0	0										0.6	0
25	X	15.5	930,000										0.5	0
26	X	21.7											0.5	0
27	X	0.0	0										0.5	0
28	X	16.0	960,000										0.6	0
29	X	8.1	486,000										0.5	0
30	X	13.6	816,000										0.5	0
31	X	0.0	0											0

**14,300,000**

**461,290**

**1,302,000**

LOWEST RESIDUAL 0.0

DAYS IN MONTH 30

days checked by operator 30

Plant Name: W. B. 100

November 2008

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Chlorine Residuals									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				Peak Flow Rate, gpd	Residual Before or at First Customer During Peak Flow, mg/L	Time Elapsed Between Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	UV Dose, mW-sec/cm <sup>2</sup>	Dose Required, mW-sec/cm <sup>2</sup>			
1	X	18.9	865,000										0.6	0	
2	X	0.0	0										0.6	0	
3	X	20.5	864,000										0.6	0	
4	X	0.0	0										0.5	0	
5	X	0.0	0										0.6	0	
6	X	24.0	1,096,000										0.5	0	
7	X	0.0	0										0.5	0	
8	X	17.9	816,000										0.5	0	
9	X	0.0	0										0.5	0	
10	X	22.1	997,000										0.5	0	
11	X	0.0	0										0.6	0	
12	X	18.7	853,000										0.5	0	
13	X	0.0	0										0.6	0	
14	X	0.0	0										0.5	0	
15	X	17.3	786,000										0.6	0	
16	X	0.0	0										0.5	0	
17	X	23.3	1,059,000										0.6	0	
18	X	0.1	0										0.4	0	
19	X	0.0	0										0.7	0	
20	X	20.4	941,000										0.7	0	
21	X	0.0	0										0.5	0	
22	X	20.9	1,065,000										0.5	0	
23	X	0.0	0										0.4	0	
24	X	23.6	1,000,000										0.6	0	
25	X	0.0	0										0.5	0	
26	X	18.6	948,600										0.5	0	
27	X	18.4	938,400										0.5	0	
28	X	0.0	0										0.6	0	
29	X	23.1	1,178,000										0.5	0	
30	X	0.0	0										0.5	0	
31	X	0.0	0											0	
			13,610,000												
			439,032												
			1,203,000												
				LOWEST RESIDUAL 0.0				days checked by operator 30							
				DAYS IN MONTH 30											

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier Number: **FL 1170527**

Plant Name: **FL 1170527**

III. Daily Data for the Month/Year of: **November 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Concentration (mg/L) Before or at First Customer During Peak Flow, mg/L	Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Required, mg-min/L	UV Dose, mW-sec/cm <sup>2</sup>	UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	22.1	1,106,000										0.6	0
3	X	0.0	0										0.6	0
4	X	17.1	861,000										0.5	0
5	X	0.0	0										0.6	0
6	X	7.9	374,000										0.5	0
7	X	20.3	985,000										0.5	0
8	X	0.0	0										0.5	0
9	X	23.4	1,160,000										0.5	0
10	X	0.0	0										0.5	0
11	X	18.6	903,000										0.6	0
12	X	0.0	0										0.5	0
13	X	19.6	908,000										0.6	0
14	X	21.4	972,000										0.5	0
15	X	0.0	0										0.6	0
16	X	23.6	1,155,000										0.5	0
17	X	0.0	0										0.6	0
18	X	15.1	734,000										0.4	0
19	X	0.0	0										0.7	0
20	X	6.9	329,000										0.7	0
21	X	22.4	1,135,000										0.5	0
22	X	0.0	0										0.5	0
23	X	24.4	1,256,000										0.4	0
24	X	0.0	0										0.6	0
25	X	28.8	1,728,000										0.5	0
26	X	0.0	0										0.5	0
27	X	0.0	0										0.5	0
28	X	31.0											0.6	0
29	X	0.0	0										0.5	0
30	X	25.2	1,512,000										0.5	0
31	X	0.0	0											0

Total: **16,978,000**  
**547,677**  
**1,860,000**

LOWEST RESIDUAL 0.0  
 DAYS IN MONTH 30

days checked by operator 30

# MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS

AT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month/Year of:

November 2008

Community Water System (CWS) Name: Peoples Water Service Company of Florida, Inc.

Public Water System (PWS) Identification FL 1170527

Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	Total
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Net Quantity of Finished Water Produced by Each Plant, gallons										6,792,000
	1,395,000	0	0	865,000	0						Total
	0	898,000	893,000	0	1,106,000						2,260,000
	1,302,000	0	0	864,000	0						
	1,298,000	266,000	0	0	861,000						2,168,000
	1,032,000	0	1,137,000	0	0						2,423,000
	0	1,127,000	0	1,096,000	374,000						2,169,000
	383,000	0	607,000	0	985,000						2,597,000
	1,323,000	0	0	816,000	0						1,975,000
	0	0	965,000	0	1,160,000						2,139,000
	1,155,000	276,000	0	997,000	0						2,125,000
	1,392,000	0	325,000	0	903,000						2,428,000
	280,000	0	822,000	853,000	0						2,620,000
	0	1,139,000	0	0	908,000						1,955,000
	0	0	900,000	0	972,000						2,047,000
	1,462,000	0	0	786,000	0						1,872,000
	0	0	972,000	0	1,155,000						2,248,000
	1,057,000	264,000	0	1,059,000	0						2,127,000
	1,398,000	0	0	0	734,000						2,380,000
	1,078,000	0	1,242,000	0	0						2,132,000
	0	1,122,000	0	941,000	329,000						2,320,000
	0	0	828,000	0	1,135,000						2,382,000
	702,000	627,000	0	1,065,000	0						1,963,000
	0	0	1,115,000	0	1,256,000						2,394,000
	0	1,296,000	0	1,203,000	0						2,371,000
	0	0	930,000	0	1,728,000						2,499,000
	0	0	1,302,000	948,600	0						2,658,000
	0	1,320,000	0	938,400	0						2,250,800
	0	0	960,000	0	1,860,000						2,258,400
	0	1,080,000	486,000	1,178,000	0						2,820,000
	0	0	816,000	0	1,512,000						2,744,000
Total	15,255,000	9,415,000	14,300,000	13,610,000	16,978,000						2,328,000
Avg.	508,500	313,833	476,667	453,667	565,933						69,558,000
Max.	1,462,000	1,320,000	1,302,000	1,203,000	1,860,000						2,318,600
	0.0	0.0	0.0	0.0	0.0						2,897,000

<-LOWEST CI





# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **October 2008**

## A. Public Water System (PWS) Information

PWS Name:	Peoples Water Service Company of Florida, Inc.		PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive
Number of Service Connections at End of Month:	9,363		Total Population Served at End of Month:	32,771
PWS Owner:	Peoples Water Service Company of Florida, Inc.			
Contact Person:	Mark Cross		Person's Title: Manager	
Contact Person's Mailing Address:	905 Lowndes Avenue	City: Pensacola	State: Florida	Zip Code: 32507-0815
Contact Person's Telephone Number:	(850) 455-8552	Contact Person's Fax Number: (850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com			

## B. Water Treatment Plant Information

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9		Plant Telephone (850) 455-8552	
Plant Address:	905 Lowndes Avenue	City: Pensacola	State: Florida	Zip Code: 32507-0815
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant:	4,860,000			
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
Other Operators:	Mark Cross	7169	A	Mon - Fri 8 :00am - 5:00 pm
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
	Mitch Torrance	15407	Level 2	Mon - Fri 8 :00am - 5:00 pm

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

 11/5/08  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month Year of: **October 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Concentration (3) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (CT) at Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Free Chlorine Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.5	0
2	X	0.0	0										0.5	0
3	X	0.0	0										0.5	0
4	X	0.0	0										0.6	0
5	X	0.0	0										0.7	0
6	X	0.0	0										0.4	0
7	X	0.0	0										0.4	0
8	X	0.0	0										0.7	PBWN
9	X	0.0	0										0.4	0
10	X	0.0	0										0.5	PBWN
11	X	0.0	0										0.5	0
12	X	0.0	0										0.5	0
13	X	20.4	1,069,000										0.6	0
14	X	0.0	0										0.5	0
15	X	0.0	0										0.4	0
16	X	0.0	0										0.4	0
17	X	0.0	0										0.5	0
18	X	0.0	0										0.6	0
19	X	0.0	0										0.6	0
20	X	15.6	1,233,000										0.4	0
21	X	20.8	1,293,000										0.5	PBWN
22	X	13.8	837,000										0.5	0
23	X	0.0	0										0.4	0
24	X	24.4	1,475,000										0.4	0
25	X	22.7	1,383,000										0.5	0
26	X	0.0	0										0.5	0
27	X	19.3	1,179,000										0.6	0
28	X	20.9	1,232,000										0.4	0
29	X	15.1	947,000										0.6	0
30	X	7.7	475,000										0.5	0
31	X	0.0	0										0.5	0
			<b>11,123,000</b>											
			<b>358,806</b>											
			<b>1,475,000</b>											
				LOWEST RESIDUAL 0.4										
				DAYS IN MONTH 31										
								days checked by operator 31						

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier Number: **FL 1170527**

Plant Name: **Well # 4**

III. Data for the Month Year of: **October 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (mg/L) Before or at First Customer During Peak Flow	Disinfectant Residual (mg/L) at Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	UV Dose, mW-sec/cm <sup>2</sup>	UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	18.6	938,000										0.5	0
2	X	23.5	1,176,000										0.5	0
3	X	20.5	1,016,000										0.5	0
4	X	5.8	294,000										0.6	0
5	X	22.6	1,111,000										0.7	0
6	X	23.1	1,211,000										0.4	0
7	X	21.0	1,092,000										0.4	0
8	X	0.0	0										0.7	PBWN
9	X	25.7	1,340,000										0.4	0
10	X	18.9	961,000										0.5	PBWN
11	X	0.0	0										0.5	0
12	X	23.8	1,197,000										0.5	0
13	X	0.0	0										0.6	0
14	X	0.0	0										0.5	0
15	X	0.0	0										0.4	0
16	X	18.4	944,000										0.4	0
17	X	19.5	964,000										0.5	0
18	X	0.0	0										0.6	0
19	X	22.7	1,136,000										0.6	0
20	X	4.9	253,000										0.4	0
21	X	0.0	0										0.5	PBWN
22	X	0.0	0										0.5	0
23	X	22.4	1,113,000										0.4	0
24	X	0.0	0										0.4	0
25	X	0.0	0										0.5	0
26	X	23.6	1,201,000										0.5	0
27	X	0.0	0										0.6	0
28	X	0.0	0										0.4	0
29	X	0.0	0										0.6	0
30	X	22.3	1,121,000										0.5	0
31	X	0.0	0										0.5	0

**17,033,000**

**549,452**

**1,305,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator: 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year of: **October 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Chlorine Concentration (mg/L) Before or at First Customer During Peak Flow	Time (min) at C Measurement Point During Peak Flow	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Required CT, mg-min/L	UV Dose, mW-sec/cm²	Required UV Dose, mW-sec/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	22.5	1,263,000										0.5	0
2	X	11.2	620,000										0.5	0
3	X	0.0	0										0.5	0
4	X	23.2	1,263,000										0.6	0
5	X	0.0	0										0.7	0
6	X	0.0	0										0.4	0
7	X	4.1	236,000										0.4	0
8	X	19.0	1,051,000										0.7	PBWN
9	X	7.9	442,000										0.4	0
10	X	0.0	0										0.5	PBWN
11	X	21.2	1,148,000										0.5	0
12	X	0.0	0										0.5	0
13	X	0.0	0										0.6	0
14	X	0.0	0										0.5	0
15	X	4.0	239,000										0.4	0
16	X	6.5	340,000										0.4	0
17	X	0.0	0										0.5	0
18	X	19.9	1,135,000										0.6	0
19	X	0.0	0										0.6	0
20	X	0.0	0										0.4	0
21	X	4.8	268,000										0.5	PBWN
22	X	20.3	1,114,000										0.5	0
23	X	0.0	0										0.4	0
24	X	14.7	810,000										0.4	0
25	X	0.0	0										0.5	0
26	X	23.2	1,268,000										0.5	0
27	X	0.0	0										0.6	0
28	X	0.0	0										0.4	0
29	X	23.0	1,236,000										0.6	0
30	X	0.0	0										0.5	0
31	X	18.6	992,000										0.5	0
			13,432,000											
			433,290											
			1,270,000											
				LOWEST RESIDUAL 0.4					days checked by operator 31					
				DAYS IN MONTH 31										



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 8**

III. Daily Data for the Month/Year of: **October 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (mg/L) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (min) During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	11.4	531,000										0.5	0
2	X	21.7	990,000										0.5	0
3	X	6.6	304,000										0.5	0
4	X	0.0	0										0.6	0
5	X	12.2	562,000										0.7	0
6	X	21.4	1,053,000										0.4	0
7	X	10.8	497,000										0.4	0
8	X	3.5	162,000										0.7	PBWN
9	X	22.7	1,042,000										0.4	0
10	X	5.7	274,000										0.5	PBWN
11	X	0.0	0										0.5	0
12	X	6.6	301,000										0.5	0
13	X	16.6	801,000										0.6	0
14	X	24.2	1,184,000										0.5	0
15	X	19.2	885,000										0.4	0
16	X	22.2	1,024,000										0.4	0
17	X	0.0	0										0.5	0
18	X	0.0	0										0.6	0
19	X	10.1	470,000										0.6	0
20	X	21.1	971,000										0.4	0
21	X	0.0	0										0.5	PBWN
22	X	0.0	0										0.5	0
23	X	21.8	1,002,000										0.4	0
24	X	0.0	0										0.4	0
25	X	18.9	881,000										0.5	0
26	X	0.0	0										0.5	0
27	X	27.3	1,253,000										0.6	0
28	X	0.0	0										0.4	0
29	X	0.0	0										0.6	0
30	X	21.3	976,000										0.5	0
31	X	0.0	0										0.5	0
			15,163,000											days checked by operator 31
			489,129											
			1,253,000											
				LOWEST RESIDUAL 0.4										
				DAYS IN MONTH 31										

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

WS Identif

Number: **FL 1170527**

Plant Name: **Well # 9**

Daily Data for the Month Year of:

**October 2008**

Means of Achieving Four-Log Virus

☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in

☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				CT Calculations						UV Dose					
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²			
1	X	0.0	0										0.5	0	
2	X	0.0	0										0.5	0	
3	X		988,000										0.5	0	
4	X		1,021,000										0.6	0	
5	X		1,094,000										0.7	0	
6	X	0.0	0										0.4	0	
7	X		1,053,000										0.4	0	
8	X	17.0	743,000										0.7	PBWN	
9	X	0.0	0										0.4	0	
10	X		1,047,000										0.5	PBWN	
11	X		1,058,000										0.5	0	
12	X		1,117,000										0.5	0	
13	X	17.9	862,000										0.6	0	
14	X		1,139,000										0.5	0	
15	X		1,162,000										0.4	0	
16	X	7.2	334,000										0.4	0	
17	X		1,133,000										0.5	0	
18	X		1,091,000										0.6	0	
19	X		844,000										0.6	0	
20	X	0.0	0										0.4	0	
21	X		972,000										0.5	PBWN	
22	X	6.0	277,000										0.5	0	
23	X	0.0	0										0.4	0	
24	X	0.0	0										0.4	0	
25	X	0.0	0										0.5	0	
26	X	0.0	0										0.5	0	
27	X	0.0	0										0.6	0	
28	X	16.4	780,000										0.4	0	
29	X	0.0	0										0.6	0	
30	X	4.6	226,000										0.5	0	
31	X		1,078,000										0.5	0	
Total			17,997,000												
Average			580,548	LOWEST RESIDUAL 0.4 days checked by operator 31											
Maximum			1,162,000	DAYS IN MONTH 31											

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator 31

# MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWSs THAT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month Year of:

October 2008

Community Water System (CWS) Name: Peoples Water Service Company of Florida, Inc.

Public Water System (PWS) Identification FL 1170527

Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	Total
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM x 1440)										Total
	1,440,000	1,440,000	1,440,000	1,032,000	1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
1	0	938,000	1,263,000	631,000	0						2,732,000
2	0	1,178,000	620,000	990,000	0						2,786,000
3	0	1,016,000	0	304,000	966,000						2,286,000
4	0	294,000	1,270,000	0	1,021,000						2,585,000
5	0	1,111,000	0	562,000	1,094,000						2,767,000
6	0	1,211,000	0	1,053,000	0						2,264,000
7	0	1,092,000	236,000	497,000	1,053,000						2,878,000
8	0	0	1,061,000	162,000	743,000						1,966,000
9	0	1,306,000	442,000	1,042,000	0						2,789,000
10	0	961,000	0	274,000	1,047,000						2,282,000
11	0	0	1,148,000	0	1,068,000						2,206,000
12	0	1,197,000	0	301,000	1,117,000						2,615,000
13	1,069,000	0	0	801,000	862,000						2,732,000
14	0	0	0	1,184,000	1,139,000						2,323,000
15	0	0	239,000	885,000	1,162,000						2,286,000
16	0	944,000	340,000	1,024,000	334,000						2,642,000
17	0	964,000	0	0	1,133,000						2,097,000
18	0	0	1,136,000	0	1,091,000						2,226,000
19	0	1,136,000	0	470,000	844,000						2,450,000
20	1,233,000	253,000	0	971,000	0						2,457,000
21	1,293,000	0	268,000	0	972,000						2,533,000
22	837,000	0	1,114,000	0	277,000						2,228,000
23	0	1,113,000	0	1,002,000	0						2,115,000
24	1,476,000	0	810,000	0	0						2,286,000
25	1,383,000	0	0	881,000	0						2,264,000
26	0	1,201,000	1,268,000	0	0						2,469,000
27	1,179,000	0	0	1,253,000	0						2,432,000
28	1,232,000	0	0	0	780,000						2,012,000
29	947,000	0	1,236,000	0	0						2,183,000
30	475,000	1,121,000	0	976,000	226,000						2,798,000
31	0	0	992,000	0	1,078,000						2,070,000
Total	11,123,000	17,033,000	13,432,000	16,163,000	17,997,000						74,748,000
Avg.	358,806	549,452	433,290	489,129	580,548						2,411,226
Max.	1,475,000	1,306,000	1,270,000	1,253,000	1,162,000						2,878,000

0.4

0.4

0.4

0.4

0.4

<—lowest CI




# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

<b>I. General Information for the Month/Year of:</b> <b>September 2008</b>				
<b>A. Public Water System (PWS) Information</b>				
PWS Name: <b>Peoples Water Service Company of Florida, Inc.</b>		PWS Identification Number: <b>FL 1170527</b>		
PWS Type: <input checked="" type="checkbox"/> Community <input type="checkbox"/> Non-Transient <input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive				
Number of Service Connections at End of Month: <b>9,276</b>		Total Population Served at End of Month: <b>32,466</b>		
PWS Owner: <b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person: <b>Mark Cross</b>		Person's Title: <b>Manager</b>		
Contact Person's Mailing Address: <b>905 Lowndes Avenue</b>		City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Contact Person's Telephone Number: <b>(850) 455-8552</b>		Contact Person's Fax Number: <b>(850) 456-1010</b>		
Contact Person's E-Mail Address: <b>MarkCross@PeoplesWaterService.com</b>				
<b>B. Water Treatment Plant Information</b>				
Plant Name: <b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>		Plant Telephone (850) 455-8552		
Plant Address: <b>905 Lowndes Avenue</b>		City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Type of Water Treated by Plant: <input checked="" type="checkbox"/> Raw Ground Water <input type="checkbox"/> Purchased Finished Water				
Permitted Maximum Day Operating Capacity of Plant: <b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.): <b>V</b>		Plant Class (per subsection 62-699.310(4), F.A.C.): <b>C</b>		
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
Other Operators:	Mark Cross	7189	A	Mon - Fri 8 :00am - 5:00 pm
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

 Oct 6, 2008  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month/Year of:

**September 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before Leaf Filter Customers During Peak Flow, mg/L	Sanitary Sampling Time (H:M:S) Measurement Point During Peak Flow, minutes	mg/L	Temp of Influent Water, °C	pH of Water	Residuals, mg/L	UV Dose, mJ/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0										0.7	0
2	X	0.0										0.4	0
3	X	0.0										0.5	0
4	X	0.0										0.4	0
5	X	0.0										0.6	0
6	X	0.0										0.6	0
7	X	0.0										0.6	0
8	X	0.0										0.6	0
9	X	0.0										0.5	0
10	X	0.0										0.5	0
11	X	0.0										0.6	0
12	X	0.0										0.5	0
13	X	0.0										0.5	PBWN
14	X	0.0										0.5	0
15	X	0.0										0.5	0
16	X	0.0										0.5	0
17	X	0.0										0.6	0
18	X	0.0										0.5	0
19	X	0.0										0.4	0
20	X	0.0										0.5	0
21	X	0.0										0.5	0
22	X	0.0										0.6	0
23	X	0.0										0.4	0
24	X	0.0										0.5	0
25	X	0.0										0.5	0
26	X	0.0										0.4	0
27	X	0.0										0.5	0
28	X	0.0										0.5	0
29	X	0.0										0.5	0
30	X	0.0										0.5	0
			0										
			0										
			0										

LOWEST RESIDUAL 0.4

days checked by operator 30

DAYS IN MONTH 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: FL 1170527

Plant Name: Well # 4

III. Daily Data for the Month/Year of:

September 2008

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpm	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Customer Complaints During Peak Flow	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	20.2	1,048,000												0.7	0
2	X	24.0	1,200,000												0.4	0
3	X	17.4	890,000												0.5	0
4	X	21.9	1,131,000												0.4	0
5	X	19.6	1,002,000												0.6	0
6	X	0.0	0												0.6	0
7	X	26.5													0.6	0
8	X	17.5	915,000												0.6	0
9	X	22.5	1,141,000												0.5	0
10	X	21.3	1,108,000												0.5	0
11	X	19.6	1,016,000												0.6	0
12	X	16.3	844,000												0.5	0
13	X	8.0	417,000												0.5	0
14	X	24.0	1,235,000												0.5	FBWN
15	X	20.3	1,041,000												0.5	0
16	X	21.7	1,102,000												0.5	0
17	X	21.5	1,098,000												0.5	0
18	X	23.1	1,164,000												0.6	0
19	X	19.1	955,000												0.5	0
20	X	0.0	0												0.4	0
21	X	9.0	470,000												0.5	0
22	X	21.2	1,078,000												0.5	0
23	X	23.3	1,169,000												0.6	0
24	X	21.0	1,069,000												0.4	0
25	X	22.2	1,113,000												0.5	0
26	X	20.8	1,039,000												0.5	0
27	X	0.0	0												0.4	0
28	X	13.0	703,000												0.5	0
29	X	24.4	1,195,000												0.5	0
30	X	22.7	1,120,000												0.5	0
			27,631,000													
			921,033													
			1,370,000													

LOWEST RESIDUAL 0.4

days checked by operator: 30

DAYS IN MONTH 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year of:

**September 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpm	Chlorine Concentration at Entry Point, mg/L	Chlorine Concentration at End of Line, mg/L	Chlorine Concentration at Point of Use, mg/L	Temp. of Water, °F	pH	Alkalinity, mg/L	Hardness, mg/L	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	7.5	395,000									0.7	0
2	X	0.0	0									0.4	0
3	X	15.4	808,000									0.5	0
4	X	0.0	0									0.4	0
5	X	0.0	0									0.6	0
6	X	20.3	1,050,000									0.6	0
7	X	9.3	478,000									0.6	0
8	X	12.6	839,000									0.6	0
9	X	0.0	0									0.5	0
10	X	23.7	1,191,000									0.5	0
11	X	0.0	0									0.6	0
12	X	8.1	399,000									0.5	0
13	X	22.6	1,115,000									0.5	PBWN
14	X	20.3	1,002,000									0.5	0
15	X	0.0	0									0.5	0
16	X	0.0	0									0.5	0
17	X	27.4	1,333,000									0.6	0
18	X	0.0	0									0.5	0
19	X	0.0	0									0.4	0
20	X	20.1	1,172,000									0.5	0
21	X	23.6	1,200,000									0.5	0
22	X	7.1	418,000									0.6	0
23	X	0.0	0									0.4	0
24	X	22.7	1,289,000									0.5	0
25	X	0.0	0									0.5	0
26	X	0.0	0									0.4	0
27	X	20.1	1,139,000									0.5	0
28	X	23.4	1,311,000									0.5	0
29	X	6.9	372,000									0.5	0
30	X	0.0	0									0.5	0
			15,458,000										
			515,267										
			1,351,000										
				LOWEST RESIDUAL 0.4		days checked by operator 30							
				DAYS IN MONTH 30									

days checked by operator 30

**PWS Identifier**

Number: FL 1170527

Plant Name: **Webb # 8**

U.S. District Court for the District of Columbia

September 2008

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

[illegible]



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 9**

HL Daily Data for the Month Year of: **September 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Free Chlorine (mg/L)	Chlorine Dioxide (mg/L)	Ozone (mg/L)	Combined Chlorine (mg/L)	Ultraviolet Radiation (mJ/cm²)	Other (mg/L)	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0							0.7	0
2	X	15.4	632,000							0.4	0
3	X	0.0	0							0.5	0
4	X	11.9	509,000							0.4	0
5	X	21.3	883,000							0.6	0
6	X	22.8	966,000							0.6	0
7	X	22.1	984,000							0.6	0
8	X	0.0	0							0.6	0
9	X	20.3	984,000							0.5	0
10	X	0.0	0							0.5	0
11	X	8.2	333,000							0.6	0
12	X	20.9	945,000							0.5	0
13	X	23.6								0.5	PBWN
14	X	6.4	316,000							0.5	0
15	X	0.0	0							0.5	0
16	X	22.2	831,000							0.5	0
17	X	0.0	0							0.6	0
18	X	9.5	448,000							0.5	0
19	X	21.0	982,000							0.4	0
20	X	22.4	807,000							0.5	0
21	X	23.3	1,002,000							0.5	0
22	X	0.0	0							0.6	0
23	X	22.1	987,000							0.4	0
24	X	0.0	0							0.5	0
25	X	10.5	445,000							0.5	0
26	X	20.9	967,000							0.4	0
27	X	20.3	950,000							0.5	0
28	X	25.2	987,000							0.5	0
29	X	0.0	0							0.5	0
30	X	22.5	1,034,000							0.5	0
			17,078,000								
			569,267								
			1,086,000								

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 30

days checked by operator 30

### WHAT HAVE MULTIPLE TREATMENT PLANTS

Provision for the Month Year of:

**September 2008**

Public Water System (PWS) Identification FL 1170527

Daily Finished: _____ Production for the Month Year of: _____ Community Water System (CWS) Name: <b>Peoples Water Service Company of Florida, Inc.</b>	_____ _____ _____
--	-------------------------

Community Water System (CWS) Name: Peoples Water Service Company of Florida, Inc.										Public Water System (PWS) Identification: 12-116021
Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Total
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	
	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)									
	1,440,000	1,440,000	1,440,000	1,032,000	1,440,000	NA	NA	NA	NA	
	Net Community Permitted Water Production Exceeding Plant Capacity									2,485,000
0	1,048,000	395,000	1,042,000	0						2,158,000
0	1,200,000	0	324,000	632,000						1,972,000
0	890,000	806,000	276,000	0						2,527,000
0	1,131,000	0	887,000	509,000						1,885,000
0	1,002,000	0	0	883,000						2,016,000
0	0	1,050,000	0	968,000						2,832,000
0	1,370,000	478,000	0	984,000						2,730,000
0	915,000	839,000	1,178,000	0						2,125,000
0	1,144,000	0	0	984,000						2,995,000
0	1,108,000	1,191,000	696,000	0						2,218,000
0	1,016,000	0	869,000	333,000						2,188,000
0	844,000	399,000	0	945,000						2,818,000
0	417,000	1,116,000	0	1,086,000						2,619,000
0	1,235,000	1,902,000	488,000	316,000						2,098,000
0	1,041,000	0	1,057,000	0						2,405,000
0	1,102,000	0	472,000	831,000						2,890,000
0	1,098,000	1,333,000	459,000	0						2,832,000
0	1,184,000	0	1,020,000	448,000						1,937,000
0	955,000	0	0	982,000						1,979,000
0	0	1,172,000	0	807,000						2,823,000
0	470,000	1,351,000	0	1,002,000						2,482,000
0	1,078,000	418,000	990,000	0						2,809,000
0	1,168,000	0	653,000	987,000						2,783,000
0	1,068,000	1,289,000	405,000	0						2,516,000
0	1,113,000	0	958,000	445,000						2,008,000
0	1,038,000	0	0	967,000						2,453,000
0	0	1,139,000	364,000	950,000						3,001,000
0	703,000	1,311,000	0	987,000						2,682,000
0	1,195,000	372,000	1,115,000	0						2,781,000
0	1,120,000	0	627,000	1,034,000						74,025,000
Total		27,631,000	15,458,000	13,858,000	17,078,000					2,467,500
Avg.		921,033	515,267	461,933	569,267					3,021,000
Max		1,370,000	1,902,000	1,178,000	1,086,000					<-lowest CI

←lowest Cl

0.4

0.4

0.4

## 0.4

### 0.4



**MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER**  
See last page for instructions.

I. General Information for the Month Year of: **August 2008**

**A. Public Water System (PWS) Information**

PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL T170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,800			Total Population Served at End of Month:	32,921
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross			Person's Title:	Manager
Contact Person's Mailing Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Contact Person's Telephone Number:	(850) 455-8552	Contact Person's Fax Number:	(850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com				

**B. Water Treatment Plant Information**

Plant Name:	Well #3, Well #4, Well #5, Well #8, and Well #9			Plant Telephone	(850) 455-8552
Plant Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water			<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant:	4,860,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8:00am - 5:00 pm/weekend visit	
Other Operators:	Mark Cross	7189	A	Mon - Fri 8:00am - 5:00 pm	
	Jim Ogle	4927	C	Mon - Fri 8:00am - 5:00 pm	
	Dan Middlebrook	8445	C	Mon - Fri 8:00am - 5:00 pm	
	Russ Barrett	12704	B	Mon - Fri 8:00am - 5:00 pm/weekend visit	
	Mitch Torrance	15407	Level 2	Mon - Fri 8:00am - 5:00 pm	

**II. Certification by Lead/Chief Operator**

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month Year of:

**August 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Residual Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfection Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	0.0	0										0.6	0
3	X	0.0	0										0.6	0
4	X	0.0	0										0.6	0
5	X	0.0	0										0.4	0
6	X	0.0	0										0.5	0
7	X	0.0	0										0.5	0
8	X	0.0	0										0.5	0
9	X	0.0	0										0.6	0
10	X	0.0	0										0.5	0
11	X	0.0	0										0.5	0
12	X	0.0	0										0.5	0
13	X	0.0	0										0.5	0
14	X	0.0	0										0.4	0
15	X	0.0	0										0.5	PBWN
16	X	0.0	0										0.5	0
17	X	0.0	0										0.5	0
18	X	0.0	0										0.4	0
19	X	0.0	0										0.6	0
20	X	0.0	0										0.5	0
21	X	0.0	0										0.4	0
22	X	0.0	0										0.4	0
23	X	0.0	0										0.5	0
24	X	0.0	0										0.4	0
25	X	0.0	0										0.4	0
26	X	0.0	0										0.4	0
27	X	0.0	0										0.4	PBWN
28	X	0.0	0										0.5	0
29	X	0.0	0										0.6	0
30	X	0.0	0										0.4	0
31	X	0.0	0										0.5	0
			0											
			0											
			0											

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31



Plant Name: **Well #4**

**August 2008**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Chlorine Residual Concentration (C) Before or at First Customer During Peak Flow, mg/L	Distribution System Chlorine Residual Concentration (D) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	5.3	278,000										0.6	0
3	X	7.0	369,000										0.6	0
4	X	19.8	1,022,000										0.6	0
5	X	15.4	793,000										0.4	0
6	X	20.9	1,069,000										0.5	0
7	X	11.3	577,000										0.5	0
8	X	0.0	0										0.5	0
9	X	6.7	347,000										0.6	0
10	X	6.2	326,000										0.5	0
11	X	22.9	1,160,000										0.5	0
12	X	19.7	998,000										0.5	0
13	X	22.1	1,123,000										0.5	0
14	X	17.3	890,000										0.4	0
15	X	0.0	0										0.5	PBWN
16	X	0.0	0										0.5	0
17	X	23.4	1,209,000										0.5	0
18	X	22.2	1,143,000										0.4	0
19	X	20.8	1,059,000										0.6	0
20	X	21.3	1,101,000										0.5	0
21	X	22.3	1,198,000										0.4	0
22	X	19.1	1,000,000										0.4	0
23	X	0.0	0										0.5	0
24	X	22.9	1,187,000										0.4	0
25	X	18.2	953,000										0.4	0
26	X	20.2	1,041,000										0.4	0
27	X	15.9	832,000										0.4	PBWN
28	X	22.9	1,176,000										0.5	0
29	X	19.7	1,012,000										0.6	0
30	X	0.0	0										0.4	0
31	X	24.2											0.5	0
			23,124,000											
			745,935											
			1,261,000											

## PWS Identifier: Number: FL 1170527

Plant Name: Well # 5

**August 2008**

Means of Achieving Four-Log Virus	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Chlorine Dioxide	<input type="checkbox"/> Ozone	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Ultraviolet Radiation	<input type="checkbox"/> Other:
-----------------------------------	---	---	--------------------------------	--	--	---------------------------------

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

[illegible]

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: FL 1170527

Plant Name: Well # 8

III. Daily Data for the Month Year of:

August 2008

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (D) in G Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Maximum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	0.0	0										0.6	0
3	X	0.0	0										0.6	0
4	X	24.0	1,042,000										0.6	0
5	X	6.4	291,000										0.4	0
6	X	22.8	1,041,000										0.5	0
7	X	5.4	248,000										0.5	0
8	X	6.3	303,000										0.5	0
9	X	0.0	0										0.6	0
10	X	0.0	0										0.5	0
11	X	23.1	1,054,000										0.5	0
12	X	0.0	0										0.5	0
13	X	24.7	1,139,000										0.5	0
14	X	22.0	1,012,000										0.4	0
15	X	0.0	0										0.5	PBWN
16	X	0.0	0										0.5	0
17	X	0.0	0										0.5	0
18	X	22.9	1,056,000										0.4	0
19	X	0.0	0										0.6	0
20	X	27.6											0.5	0
21	X	13.4	624,000										0.4	0
22	X	0.0	0										0.4	0
23	X	0.0	0										0.5	0
24	X	0.0	0										0.4	0
25	X	19.9	912,000										0.4	0
26	X	7.9	365,000										0.4	0
27	X	22.6	1,033,000										0.4	PBWN
28	X	21.6	987,000										0.5	0
29	X	0.0	0										0.6	0
30	X	9.8	463,000										0.4	0
31	X	0.0	0										0.5	0

12,831,000

413,903

1,263,000

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: **FL 1170527**

Plant Name: **Wentz**

III. Daily Data for the Month Year of:

**August 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	20.5	971,000										0.6	0
2	X	20.0	979,000										0.6	0
3	X	26.4											0.6	0
4	X	4.9	235,000										0.6	0
5	X	22.2	1,089,000										0.4	0
6	X	0.0	0										0.5	0
7	X	24.1	1,156,000										0.5	0
8	X	22.7	1,089,000										0.5	0
9	X	23.3	1,094,000										0.6	0
10	X	23.5	1,124,000										0.5	0
11	X	0.0	0										0.5	0
12	X	22.0	853,000										0.5	0
13	X	0.0	0										0.5	0
14	X	8.9	403,000										0.4	0
15	X	22.8	1,015,000										0.5	PBWN
16	X	21.3	941,000										0.5	0
17	X	22.3	1,006,000										0.5	0
18	X	0.0	0										0.4	0
19	X	21.8	972,000										0.6	0
20	X	0.0	0										0.5	0
21	X	19.9	1,066,000										0.4	0
22	X	20.7	973,000										0.4	0
23	X	23.0	1,110,000										0.5	0
24	X	22.4	1,026,000										0.4	0
25	X	0.0	0										0.4	0
26	X	24.0	1,080,000										0.4	0
27	X	0.0	0										0.4	PBWN
28	X	8.8	407,000										0.5	0
29	X	21.6	1,110,000										0.6	0
30	X	23.2	1,214,000										0.4	0
31	X	22.4	1,171,000										0.5	0
			<b>23,358,000</b>											
			<b>753,484</b>											
			<b>1,274,000</b>											

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31



**MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished Water Production for the Month Year of:

**August 2008**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

Public Water System (PWS) Identification FL 1170527											
Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Minimum Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										
	1,440,000	1,440,000	1,440,000	1,032,000	1,440,000	NA	NA	NA	NA	NA	Total
											6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
1	0	0	1,135,000	0	971,000						2,106,000
	0	278,000	1,123,000	0	979,000						2,380,000
	0	369,000	1,177,000	0	1,274,000						2,820,000
	0	1,022,000	297,000	1,042,000	235,000						2,596,000
	0	793,000	391,000	291,000	1,089,000						2,564,000
	0	1,069,000	568,000	1,041,000	0						2,678,000
	0	577,000	0	246,000	1,156,000						1,979,000
	0	0	637,000	303,000	1,089,000						2,029,000
	0	347,000	1,030,000	0	1,094,000						2,531,000
	0	326,000	1,151,000	0	1,124,000						2,604,000
	0	1,160,000	0	1,054,000	0						2,214,000
	0	998,000	0	0	853,000						1,851,000
	0	1,123,000	416,000	1,139,000	0						2,678,000
	0	890,000	0	1,012,000	403,000						2,305,000
	0	0	1,164,000	0	1,015,000						2,179,000
	0	0	1,035,000	0	941,000						1,976,000
	0	1,209,000	331,000	0	1,006,000						2,546,000
	0	1,143,000	512,000	1,056,000	0						2,511,000
	0	1,059,000	0	0	972,000						2,031,000
	0	1,101,000	241,000	1,263,000	0						2,605,000
	0	1,198,000	0	624,000	1,066,000						
	0	1,000,000	494,000	0	973,000						2,467,000
	0	0	893,000	0	1,110,000						2,003,000
	0	1,187,000	306,000	0	1,026,000						2,519,000
	0	953,000	0	912,000	0						1,865,000
	0	1,041,000	0	365,000	1,080,000						2,486,000
	0	832,000	790,000	1,033,000	0						2,655,000
	0	1,176,000	0	987,000	407,000						2,570,000
	0	1,012,000	0	0	1,110,000						2,122,000
	0	0	927,000	463,000	1,214,000						2,604,000
	0	1,261,000	378,000	0	1,171,000						2,810,000
Total		23,124,000	14,859,000	12,831,000	23,258,000						74,172,000
Avg.		745,935	479,323	413,903	753,484						2,392,645
Max.		1,261,000	1,177,000	1,263,000	1,274,000						2,888,000

0.4

0.4

0.4

0.4

0.4

<—lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month Year of: **July 2008**

## A. Public Water System (PWS) Information

PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,326			Total Population Served at End of Month:	32,641
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross			Person's Title:	Manager
Contact Person's Mailing Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Contact Person's Telephone Number:	(850) 455-8552	Contact Person's Fax Number:	(850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com				

## B. Water Treatment Plant Information

Plant Name:	Wells 3, Well #4, Well #5, Well #6, and Well #9			Plant Telephone	(850) 455-8552
Plant Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water	<input type="checkbox"/> Purchased Finished Water			
Permitted Maximum Day Operating Capacity of Plant:	4,860,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	
Other Operators:	Mark Cross	7169	A	Mon - Fri 8 :00am - 5:00 pm	
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm	
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	
	Chester Horton	NA	NA	Mon - Fri 8 :00am - 5:00 pm	
	Gary Leatherberry	NA	NA	Mon - Fri 8 :00am - 5:00 pm	

## II. Certification by Lead Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Theo Deleon Aug 6, 2008  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier Number: **FL 1170527**

Plant Name: **Well # 3**

HL Daily Date of the Month Year of:

**July 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	0.0	0										0.5	0
3	X	0.0	0										0.5	0
4	X	0.0	0										0.5	0
5	X	0.0	0										0.6	0
6	X	0.0	0										0.6	0
7	X	0.0	0										0.6	0
8	X	0.0	0										0.5	0
9	X	0.0	0										0.5	0
10	X	0.0	0										0.6	0
11	X	0.0	0										0.4	0
12	X	0.0	0										0.5	0
13	X	0.0	0										0.6	0
14	X	0.0	0										0.6	0
15	X	0.0	0										0.4	0
16	X	0.0	0										0.5	0
17	X	0.0	0										0.6	0
18	X	0.0	0										0.5	0
19	X	0.0	0										0.6	0
20	X	0.0	0										0.5	0
21	X	0.0	0										0.6	0
22	X	0.0	0										0.6	0
23	X	0.0	0										0.7	0
24	X	0.0	0										0.6	0
25	X	0.0	0										0.6	0
26	X	0.0	0										0.5	0
27	X	0.0	0										0.5	0
28	X	0.0	0										0.5	0
29	X	0.0	0										0.4	0
30	X	0.0	0										0.6	0
31	X	0.0	0										0.5	PBWN

0

0

0

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31

Plant Name: Well # 4

**July 2008**☒ Free Chlorine    ☐ Chlorine Dioxide    ☐ Ozone    ☐ Combined Chlorine (Chloramines)    ☐ Ultraviolet Radiation    ☐ Other: \_\_\_\_\_

**[x]Free Chlorine**

☐ Combined Chlorine (Chloramines)    ☐ Chlorine Dioxide

DAYS IN MONTH 31



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identific

Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year of:

**July 2008**

Means of Achieving Four-Log Virus

☒ Free Chlorine

☐ Chlorine Dioxide

☐ Ozone

☐ Combined Chlorine (Chloramines)

☐ Ultraviolet Radiation

☐ Other:

Type of Disinfectant Residual Maintained in

☒ Free Chlorine

☐ Combined Chlorine (Chloramines)

☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (mg/L) Before or at First Customer During Peak Flow	Disinfectant Contact Time (CT) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	17.1	976,000										0.6	0
2	X	13.3	749,000										0.5	0
3	X	0.0	0										0.5	0
4	X	14.2	811,000										0.5	0
5	X	18.8	1,055,000										0.6	0
6	X	7.3	423,000										0.6	0
7	X	0.0	0										0.6	0
8	X	18.2	1,018,000										0.5	0
9	X	19.7	1,110,000										0.5	0
10	X	0.0	0										0.6	0
11	X	6.9	391,000										0.4	0
12	X	8.4	474,000										0.5	0
13	X	14.5	820,000										0.6	0
14	X	0.0	0										0.6	0
15	X	13.2	741,000										0.4	0
16	X	10.3	586,000										0.5	0
17	X	0.0	0										0.6	0
18	X	12.9	786,000										0.5	0
19	X	9.2	516,000										0.6	0
20	X	12.3	695,000										0.5	0
21	X	0.0	0										0.6	0
22	X	19.0	1,050,000										0.6	0
23	X	20.9	1,184,000										0.7	0
24	X	0.0	0										0.6	0
25	X	21.6	1,123,000										0.6	0
26	X	17.8	971,000										0.5	0
27	X	18.2	995,000										0.5	0
28	X	0.0	0										0.5	0
29	X	17.7	964,000										0.4	0
30	X	9.6	526,000										0.6	0
31	X	0.0	0										0.5	PBWN

Total	18,009,000
	580,935
	1,188,000

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: **FL 1170527**

Plant Name: **W01178**

III. Daily Data for the Month Year of:

**July 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Maximum UV Dose Required, mW-sec/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	23.8	1,013,000										0.5	0
3	X	0.0	0										0.5	0
4	X	0.0	0										0.5	0
5	X	0.0	0										0.6	0
6	X	0.0	0										0.6	0
7	X	19.8	900,000										0.6	0
8	X	8.0	370,000										0.5	0
9	X	19.5	872,000										0.5	0
10	X	19.3	885,000										0.6	0
11	X	21.8	999,000										0.4	0
12	X	15.9	731,000										0.5	0
13	X	0.0	0										0.6	0
14	X	22.4	1,023,000										0.6	0
15	X	13.5	618,000										0.4	0
16	X	21.8	997,000										0.5	0
17	X	0.0	0										0.6	0
18	X	21.4	978,000										0.5	0
19	X	0.0	0										0.6	0
20	X	0.0	0										0.5	0
21	X	18.4	830,000										0.6	0
22	X	15.2	696,000										0.6	0
23	X	18.8	844,000										0.7	0
24	X	23.6	1,086,000										0.6	0
25	X	7.1	324,000										0.6	0
26	X	0.0	0										0.5	0
27	X	0.0	0										0.5	0
28	X	23.5	1,073,000										0.5	0
29	X	0.0	0										0.4	0
30	X	27.2											0.6	0
31	X	0.0	0										0.5	PBWN

Total	15,477,000
	499,258
	1,238,000

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: FL 1170527

Plant Name: WELL 79

III. Daily Data for the Month Year of:

July 2008

Means of Achieving Four-Log Virus

☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in

☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	19.9	1,032,000										0.6	0
2	X	0.0	0										0.5	0
3	X	23.7	1,221,000										0.5	0
4	X	19.5	984,000										0.5	0
5	X	18.5	959,000										0.6	0
6	X	17.7	841,000										0.6	0
7	X	24.1											0.6	0
8	X	20.5	1,057,000										0.5	0
9	X	0.0	0										0.5	0
10	X	19.5	986,000										0.6	0
11	X	18.6	939,000										0.4	0
12	X	20.0	1,012,000										0.5	0
13	X	22.2	1,158,000										0.6	0
14	X	4.6	239,000										0.6	0
15	X	16.6	983,000										0.4	0
16	X	0.0	0										0.5	0
17	X	26.4	1,230,000										0.6	0
18	X	19.9	989,000										0.5	0
19	X	20.2	886,000										0.6	0
20	X	21.2	1,085,000										0.5	0
21	X	23.5	1,142,000										0.6	0
22	X	20.2	962,000										0.6	0
23	X	0.0	0										0.7	0
24	X	20.0	916,000										0.6	0
25	X	22.5	1,060,000										0.6	0
26	X	20.8	992,000										0.5	0
27	X	20.8	927,000										0.5	0
28	X	6.9	317,000										0.5	0
29	X	21.3	1,054,000										0.4	0
30	X	0.0	0										0.6	0
31	X	23.2	1,122,000										0.5	PBWN
Total:			25,363,000											
			818,161											
			1,270,000											

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31



# MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CY

THAT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month Year of: **July 2008**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Minimum Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
1,440,000	1,440,000	1,440,000	1,032,000	1,440,000	NA	NA	NA	NA	NA	6,792,000
Net Quantity of Finished Water Produced by Each Plant, gallons										Total
0	0	976,000	0	1,032,000						2,008,000
0	1,322,000	749,000	1,013,000	0						2,382,000
0	1,161,000	0	0	1,221,000						2,557,000
0	762,000	811,000	0	984,000						2,482,000
0	468,000	1,055,000	0	959,000						2,478,000
0	1,214,000	423,000	0	841,000						2,594,000
0	424,000	0	900,000	1,270,000						2,445,000
0	0	1,018,000	370,000	1,057,000						2,693,000
0	711,000	1,110,000	872,000	0						2,496,000
0	625,000	0	885,000	986,000						2,329,000
0	0	391,000	999,000	939,000						2,217,000
0	0	474,000	731,000	1,012,000						2,493,000
0	515,000	820,000	0	1,158,000						2,209,000
0	947,000	0	1,023,000	239,000						2,342,000
0	0	741,000	618,000	983,000						2,749,000
0	1,166,000	586,000	997,000	0						2,334,000
0	1,104,000	0	0	1,230,000						2,753,000
0	0	786,000	978,000	989,000						2,560,000
0	1,158,000	516,000	0	886,000						3,007,000
0	1,227,000	695,000	0	1,085,000						2,632,000
0	660,000	0	830,000	1,142,000						2,708,000
0	0	1,050,000	696,000	962,000						2,568,000
0	560,000	1,164,000	844,000	0						2,558,000
0	556,000	0	1,086,000	916,000						2,572,000
0	0	1,188,000	324,000	1,060,000						2,428,000
0	465,000	971,000	0	992,000						2,359,000
0	437,000	995,000	0	927,000						2,478,000
0	1,088,000	0	1,073,000	317,000						2,435,000
0	417,000	964,000	0	1,054,000						2,920,000
0	1,156,000	526,000	1,238,000	0						2,104,000
0	982,000	0	0	1,122,000						77,974,000
	13,125,000	18,009,000	15,417,000	25,363,000						2,515,290
Avg.	616,935	580,935	499,258	818,161						3,084,000
Max.	1,322,000	1,188,000	1,238,000	1,270,000						

0.4

0.4

0.4

0.4

0.4

<—lowest CI





# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month Year of: **June 2008**

## A. Public Water System (PWS) Information

PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,333			Total Population Served at End of Month:	32,666
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross			Person's Title:	Manager
Contact Person's Mailing Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Contact Person's Telephone Number:	(850) 455-8552	Contact Person's Fax Number:	(850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com				

## B. Water Treatment Plant Information

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 6, and Well # 9			Plant Telephone	(850) 455-8552
Plant Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water	<input type="checkbox"/> Purchased Finished Water			
Permitted Maximum Day Operating Capacity of Plant,	4,360,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	
Other Operators:	Mark Cross	7169	A	Mon - Fri 8 :00am - 5:00 pm	
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm	
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Theo Deleon 7/8/08  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier:

Number: **FL 1170527**

Plant Name: **Well #4**

III. Daily Data for the Month/Year of:

**June 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	14.3	1,054,000										0.5	0
2	X	21.6	813,000										0.6	0
3	X	11.6	625,000										0.5	0
4	X	23.3	1,232,000										0.5	0
5	X	22.2	1,149,000										0.6	0
6	X	0.0	0										0.5	0
7	X	22.8	1,183,000										0.4	0
8	X	18.7	988,000										0.5	0
9	X	24.1	1,237,000										0.5	PBWN
10	X	23.6	1,205,000										0.4	0
11	X	24.0	1,230,000										0.4	0
12	X	20.8	1,068,000										0.5	0
13	X	0.0	0										0.5	0
14	X	24.8	1,211,000										0.5	0
15	X	23.9	1,211,000										0.5	0
16	X	22.4	1,157,000										0.4	0
17	X	0.0	0										0.5	0
18	X	21.3	1,134,000										0.5	0
19	X	18.2	953,000										0.4	0
20	X	0.0	0										0.4	0
21	X	15.7	804,000										0.6	0
22	X	16.6	848,000										0.7	0
23	X	17.1	882,000										0.4	0
24	X	10.9	568,000										0.4	0
25	X	10.2	539,000										0.5	0
26	X	9.3	512,000										0.5	0
27	X	0.0	0										0.5	PBWN
28	X	16.8	854,000										0.4	0
29	X	13.8	738,000										0.5	0
30	X	20.7	1,068,000										0.5	0

**24,317,000**

**810,567**

**1,265,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 30

days checked by operator: 30

Plant Name: **Well # 5**

# June 2008

Means of Achieving Four-Log Virus	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Chlorine Dioxide	<input type="checkbox"/> Ozone	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Ultraviolet Radiation	<input type="checkbox"/> Other:
-----------------------------------	---	---	--------------------------------	--	--	---------------------------------

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

DAYS IN MONTH 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identific

Number: **FL 1170527**

Plant Name: **Well #8**

III. Daily Data for the Month Year of:

**June 2008**

Means of Achieving Four-Log Virus ☒Free Chlorine ☐Chlorine Dioxide ☐Ozone ☐Combined Chlorine (Chloramines) ☐Ultraviolet Radiation ☐Other:

Type of Disinfectant Residual Maintained in ☒Free Chlorine ☐Combined Chlorine (Chloramines) ☐Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water, Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0									0.5	0
2	X	25.4	1,146,000									0.6	0
3	X	0.0	0									0.5	0
4	X	24.2	1,103,000									0.5	0
5	X	22.0	1,007,000									0.6	0
6	X	11.7	537,000									0.5	0
7	X	0.0	0									0.4	0
8	X	7.8	344,000									0.5	0
9	X	21.7	991,000									0.5	PBWN
10	X	0.0	0									0.4	0
11	X	23.3	1,061,000									0.4	0
12	X	14.4	649,000									0.5	0
13	X	23.1	1,067,000									0.5	0
14	X	0.0	0									0.5	0
15	X	0.0	0									0.5	0
16	X	23.2	1,067,000									0.4	0
17	X	0.0	0									0.5	0
18	X	16.0	732,000									0.5	0
19	X	12.2	548,000									0.4	0
20	X	0.0	0									0.4	0
21	X	0.1	0									0.6	0
22	X	0.0	0									0.7	0
23	X	26.8	1,230,000									0.4	0
24	X	0.0	0									0.4	0
25	X	23.2	1,071,000									0.5	0
26	X	22.4	1,069,000									0.5	0
27	X	0.0	0									0.5	PBWN
28	X	0.0	0									0.4	0
29	X	0.0	0									0.5	0
30	X	24.8	1,142,000									0.5	0
			<b>14,764,000</b>										
			<b>492,133</b>										
			<b>1,230,000</b>										
				LOWEST RESIDUAL		0.4		days checked by operator 30					
				DAYS IN MONTH		30							



**PWS Identific**

Number: FL 1170527

Plant Name: Well # 9

June 2008

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	24.6	1,484,000										0.5	0
2	X	19.3	1,164,000										0.6	0
3	X	21.3	1,303,000										0.5	0
4	X	0.0	0										0.5	0
5	X	19.6	1,212,000										0.6	0
6	X	21.4	1,299,000										0.5	0
7	X	22.9	1,403,000										0.4	0
8	X	24.4	1,480,000										0.5	0
9	X	14.6	877,000										0.5	PBWN
10	X	19.1	1,074,000										0.4	0
11	X	0.0	0										0.4	0
12	X	24.4	1,479,000										0.5	0
13	X	18.6	1,072,000										0.5	0
14	X	17.7	997,000										0.5	0
15	X	16.1	907,000										0.5	0
16	X	6.6	386,000										0.4	0
17	X	20.8	1,244,000										0.5	0
18	X	0.0	0										0.5	0
19	X	24.7	1,511,000										0.4	0
20	X	20.0	1,210,000										0.4	0
21	X	20.2	1,183,000										0.6	0
22	X	20.0	1,201,000										0.7	0
23	X	10.7	642,000										0.4	0
24	X	19.4	1,164,000										0.4	0
25	X	0.0	0										0.5	0
26	X	0.0	0										0.5	0
27	X	18.4	945,000										0.5	PBWN
28	X	20.5	1,042,000										0.4	0
29	X	21.2	1,091,000										0.5	0
30	X	4.8	232,000										0.5	0
			27,612,000											
			920,400											
			1,521,000											
				LOWEST RESIDUAL		0.4								
				DAYS IN MONTH		30					days checked by operator 30			

**MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished-Water Production for the Month Year of: **June 2008**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Gross Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	1,440,000	1,440,000	1,032,000	1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
1	0	1,054,000	1,323,000	0	1,484,000						3,861,000
	0	813,000	0	1,146,000	1,164,000						3,123,000
	0	625,000	1,456,000	0	1,303,000						3,384,000
	0	1,232,000	925,000	1,103,000	0						3,260,000
	0	1,149,000	0	1,007,000	1,212,000						3,368,000
	0	0	1,239,000	537,000	1,299,000						3,075,000
	0	1,183,000	969,000	0	1,403,000						3,555,000
	0	988,000	1,299,000	344,000	1,480,000						
	0	1,237,000	0	991,000	877,000						3,105,000
	0	1,205,000	737,000	0	1,074,000						3,016,000
	0	1,230,000	644,000	1,061,000	0						2,935,000
	0	1,068,000	0	648,000	1,479,000						3,196,000
	0	0	0	1,067,000	1,072,000						2,139,000
	0	1,265,000	907,000	0	997,000						3,169,000
	0	1,211,000	537,000	0	907,000						2,655,000
	0	1,157,000	0	1,067,000	386,000						2,610,000
	0	0	1,241,000	0	1,244,000						2,485,000
	0	1,134,000	1,285,000	732,000	0						3,151,000
	0	953,000	0	548,000	1,521,000						3,022,000
	0	0	1,353,000	0	1,210,000						2,563,000
	0	804,000	551,000	0	1,183,000						2,538,000
	0	848,000	644,000	0	1,201,000						2,693,000
	0	882,000	0	1,230,000	642,000						2,754,000
	0	568,000	1,116,000	0	1,164,000						2,848,000
	0	539,000	1,080,000	1,071,000	0						2,690,000
	0	512,000	992,000	1,069,000	0						2,573,000
	0	0	1,213,000	0	945,000						2,158,000
	0	854,000	966,000	0	1,042,000						2,862,000
	0	738,000	704,000	0	1,091,000						2,533,000
	0	1,068,000	0	1,142,000	232,000						2,442,000
Total		24,347,000	21,181,000	14,764,000	27,612,000						87,874,000
Avg.		810,567	706,033	492,133	920,400						2,929,133
Max.		1,265,000	1,456,000	1,230,000	1,521,000						4,111,000

0.4

0.4

0.4

0.4

0.4

<—lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **May 2008**

## A. Public Water System (PWS) Information

PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>			PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	<b>9,317</b>			Total Population Served at End of Month:	<b>32,610</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person:	<b>Mark Cross</b>			Person's Title: <b>Manager</b>	
Contact Person's Mailing Address:	<b>905 Lownd Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>	
Contact Person's Telephone Number:	<b>(850) 455-8552</b>		Contact Person's Fax Number: <b>(850) 456-1010</b>		
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.Com</b>				

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>			Plant Telephone <b>(850) 455-8552</b>	
Plant Address:	<b>905 Lownd Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>	
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water		
Permitted Maximum Day Operating Capacity of Plant:	<b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>		Plant Class (per subsection 62-699.310(4), F.A.C.): <b>C</b>		
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8:00am - 5:00 pm/weekend visit</b>	
Other Operators:	<b>Mark Cross</b>	<b>7169</b>	<b>A</b>	<b>Mon - Fri 8:00am - 5:00 pm</b>	
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8:00am - 5:00 pm</b>	
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8:00am - 5:00 pm</b>	
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8:00am - 5:00 pm/weekend visit</b>	

## II. Certification by Lead Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

 **June 9, 2008**  
Signature and Date

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number

**MONTHLY (**

# REPORT FOR PWSs TREATING RAW GROUND WAT

**OR PURCHASED FINISHED WATER**Plant Name: **Well # 3****May 2008**

**[x]Free Chlorine**

[ ]Chlorine Dioxide

**jOzone**

11C

### Combined Chlorine (Chloramines)

### [ ] Ultraviolet Radiation

[ ] Other:

**[x]Free Chlorine**

[ ] Combined Chlorine (Chloramines)

[ ]Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²		
1	X	0.0	0										0.6	0
2	X	0.0	0										0.4	0
3	X	0.0	0										0.5	0
4	X	0.0	0										0.5	0
5	X	0.0	0										0.4	0
6	X	6.5	368,000										0.5	0
7	X	0.0	0										0.5	0
8	X	0.0	0										0.6	0
9	X	0.0	0										0.4	0
10	X	0.0	0										0.7	0
11	X	0.0	0										0.6	0
12	X	0.0	0										0.5	0
13	X	0.0	0										0.5	0
14	X	0.0	0										0.6	0
15	X	0.0	0										0.5	0
16	X	0.0	0										0.5	PBWN
17	X	0.0	0										0.5	0
18	X	0.0	0										0.5	0
19	X	0.0	0										0.6	0
20	X	0.0	0										0.4	0
21	X	0.0	0										0.6	0
22	X	0.0	0										0.5	0
23	X	0.0	0										0.6	0
24	X	0.0	0										0.6	0
25	X	0.0	0										0.6	0
26	X	0.0	0										0.6	0
27	X	0.0	0										0.5	0
28	X	0.0	0										0.5	0
29	X	0.0	0										0.5	0
30	X	0.0	0										0.5	0
31	X	0.0	0										0.6	PBWN
			368,000										0.5	0
			11,871	LOWEST RESIDUAL 0.4									days checked by operator 31	
			368,000	DAYS IN MONTH 31										



Plant Name: **Well # 4**

**May 2008**

Type of Disinfectant Residual Maintained in

**[x]Free Chlorine**

**[ ] Combined Chlorine (Chloramines)**

### **Chlorine Dioxide**

DAYS IN MONTH 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year of: **May 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C (if Applicable)	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	20.6	1,070,000										0.4	0
3	X	0.0	0										0.5	0
4	X	22.2	1,154,000										0.5	0
5	X	0.0	0										0.4	0
6	X	19.2	981,000										0.5	0
7	X	22.0	1,113,000										0.5	0
8	X	0.0	0										0.6	0
9	X	21.5	1,062,000										0.4	0
10	X	12.0	591,000										0.7	0
11	X	21.5	1,034,000										0.6	0
12	X	0.0	0										0.5	0
13	X	22.4	1,055,000										0.5	0
14	X	23.2	1,071,000										0.6	0
15	X	0.0	0										0.5	0
16	X	17.3	798,000										0.5	PBWN
17	X	0.0	0										0.5	0
18	X	25.6	1,160,000										0.5	0
19	X	0.0	0										0.6	0
20	X	23.9	1,048,000										0.4	0
21	X	13.7	603,000										0.6	0
22	X	0.0	0										0.5	0
23	X	17.8	1,080,000										0.6	0
24	X	0.0	0										0.6	0
25	X	26.6	1,318,000										0.6	0
26	X	0.0	0										0.5	0
27	X	21.0	1,269,000										0.5	0
28	X	10.2	599,000										0.5	0
29	X	0.0	0										0.5	0
30	X	22.2	1,332,000										0.5	0
31	X	13.1	775,000										0.6	PBWN
			<b>19,413,000</b>											0.5
			<b>626,226</b>											0
			<b>1,617,000</b>											0

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31

Plant Name: **Well # 8**

**May 2008**

**[ ]Chlorine Dioxide**

days checked by operator 31



# MONTHLY CHLORINATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 9**

III. Daily Data for the Month Year of: **May 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, cpm	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C (if Applicable)	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW	Minimum UV Dose Required, mW	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	14.0	841,000										0.6	0
2	X	21.1	1,279,000										0.4	0
3	X	19.1	1,132,000										0.5	0
4	X	24.0											0.5	0
5	X	10.3	610,000										0.4	0
6	X	20.8	1,259,000										0.5	0
7	X	0.0	0										0.5	0
8	X	13.9	844,000										0.6	0
9	X	21.2	1,288,000										0.4	0
10	X	22.5	1,357,000										0.7	0
11	X	23.6	1,422,000										0.6	0
12	X	11.9	707,000										0.5	0
13	X	22.0	1,341,000										0.5	0
14	X	0.0	0										0.6	0
15	X	5.7	323,000										0.5	0
16	X	21.0	1,270,000										0.5	PBWN
17	X	21.7	1,315,000										0.5	0
18	X	23.4	1,422,000										0.5	0
19	X	11.0	658,000										0.6	0
20	X	21.8	1,337,000										0.4	0
21	X	0.0	0										0.6	0
22	X	11.0	656,000										0.5	0
23	X	20.7	1,251,000										0.6	0
24	X	23.0	1,384,000										0.6	0
25	X	21.4	1,295,000										0.6	0
26	X	12.4	757,000										0.5	0
27	X	21.3	1,278,000										0.5	0
28	X	0.0	0										0.5	0
29	X	13.8	829,000										0.5	0
30	X	22.1	1,352,000										0.6	PBWN
31	X	23.6	1,428,000										0.5	0
			<b>30,105,000</b>											
			<b>971,129</b>											
			<b>1,470,000</b>											

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31



MONTHLY OPERATIONAL REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month Year of: **May 2008**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	1,440,000	1,440,000	1,032,000	1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	0	1,201,000	0	830,000	841,000						2,872,000
	0	0	1,070,000	0	1,279,000						2,349,000
	0	1,136,000	0	0	1,132,000						2,268,000
	0	464,000	1,154,000	0	1,470,000						3,088,000
	0	1,001,000	0	1,035,000	610,000						2,646,000
	368,000	0	981,000	0	1,259,000						2,608,000
	0	898,000	1,113,000	1,085,000	0						3,096,000
	0	1,132,000	0	779,000	844,000						2,755,000
	0	0	1,062,000	0	1,288,000						2,350,000
	0	1,177,000	591,000	0	1,357,000						3,125,000
	0	569,000	1,034,000	333,000	1,422,000						3,358,000
	0	1,138,000	0	974,000	707,000						2,819,000
	0	278,000	1,065,000	0	1,341,000						2,674,000
	0	788,000	1,071,000	1,222,000	0						3,081,000
	0	1,132,000	0	983,000	323,000						2,438,000
	0	0	799,000	0	1,270,000						2,069,000
	0	1,145,000	0	0	1,315,000						2,460,000
	0	539,000	1,160,000	0	1,422,000						3,121,000
	0	1,182,000	0	1,087,000	658,000						2,927,000
	0	578,000	1,048,000	0	1,337,000						2,963,000
	0	1,037,000	603,000	1,124,000	0						2,764,000
	0	1,177,000	0	962,000	656,000						2,795,000
	0	0	1,080,000	0	1,251,000						2,331,000
	0	1,202,000	0	0	1,384,000						2,586,000
	0	0	1,617,000	0	1,295,000						2,912,000
	0	1,302,000	0	1,104,000	757,000						3,163,000
	0	407,000	1,269,000	0	1,278,000						2,954,000
	0	1,182,000	599,000	1,129,000	0						2,910,000
	0	1,169,000	0	987,000	829,000						2,985,000
	0	0	1,332,000	0	1,352,000						2,684,000
	0	1,191,000	775,000	0	1,428,000						3,394,000
Total	368,000	23,025,000	19,413,000	13,634,000	30,105,000						86,545,000
Avg.	11,871	742,742	626,226	439,806	971,129						2,791,774
Max.	368,000	1,302,000	1,617,000	1,222,000	1,470,000						3,394,000

0.4

0.4

0.4

0.4

0.4

<—lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **April 2008**

## A. Public Water System (PWS) Information

PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,364			Total Population Served at End of Month:	32,774
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross			Person's Title:	Manager
Contact Person's Mailing Address:	905 Lowndes Avenue	City: Pensacola	State: Florida	Zip Code:	32507-0815
Contact Person's Telephone Number:	(850) 455-8552		Contact Person's Fax Number:	(850) 456-1010	
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.com				

## B. Water Treatment Plant Information

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 6, and Well # 9			Plant Telephone	(850) 455-8552
Plant Address:	905 Lowndes Avenue	City: Pensacola	State: Florida	Zip Code:	32507-0815
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water			<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant:	4,800,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	
Other Operators:	Mark Cross	7189	A	Mon - Fri 8 :00am - 5:00 pm	
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm	
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

 **MAY 7, 2008**  
Signature and Date

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month/Year of: **April 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpm	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	20.6	1,206,000										0.6	0
2	X	17.9	1,046,000										0.5	0
3	X	0.0	0										0.5	PBWN
4	X	0.0	0										0.5	0
5	X	22.6	1,317,000										0.5	0
6	X	0.0	0										0.5	0
7	X	23.5	1,379,000										0.5	0
8	X	22.4	1,301,000										0.5	0
9	X	17.0	977,000										0.5	0
10	X	0.0	0										0.6	0
11	X	0.0	0										0.6	0
12	X	22.8	1,330,000										0.5	0
13	X	0.0	0										0.5	0
14	X	21.2	1,236,000										0.5	0
15	X	22.5	1,275,000										0.5	0
16	X	19.3	1,087,000										0.4	PBWN
17	X	0.0	0										0.6	0
18	X	0.0	0										0.4	0
19	X	23.6	1,340,000										0.6	0
20	X	0.0	0										0.5	0
21	X	24.0	1,359,000										0.5	0
22	X	22.8	1,240,000										0.5	PBWN
23	X	20.0	1,086,000										0.6	0
24	X	0.0	0										0.7	0
25	X	0.0	0										0.5	0
26	X	25.5	1,405,000										0.5	0
27	X	0.0	0										0.6	0
28	X	22.9	1,243,000										0.5	0
29	X	21.5	1,098,000										0.5	0
30	X	21.2	1,062,000										0.5	0

Total:	21,987,000
	732,900
	1,405,000

LOWEST RESIDUAL 0.4

days checked by operator 30

DAYS IN MONTH 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Wall #4**

III. Daily Data for the Month/Year of: **April 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating DW Dose, mW-sec/cm <sup>2</sup>	Minimum DV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	0.0	0										0.5	0
3	X	23.1	1,232,000										0.5	PBWN
4	X	0.0	0										0.5	0
5	X	18.2	968,000										0.5	0
6	X	20.5	1,094,000										0.5	0
7	X	6.7	371,000										0.5	0
8	X	0.0	0										0.5	0
9	X	0.0	0										0.5	0
10	X	24.8	1,321,000										0.6	0
11	X	20.9	1,124,000										0.6	0
12	X	18.0	937,000										0.5	0
13	X	21.8	1,171,000										0.5	0
14	X	5.1	290,000										0.5	0
15	X	7.0	353,000										0.5	0
16	X	0.0	0										0.4	PBWN
17	X	23.7	1,271,000										0.6	0
18	X	20.3	1,083,000										0.4	0
19	X	21.4	1,132,000										0.6	0
20	X	22.3	1,199,000										0.5	0
21	X	9.1	489,000										0.5	0
22	X	0.0	0										0.5	PBWN
23	X	0.0	0										0.6	0
24	X	23.7	1,272,000										0.7	0
25	X	0.0	0										0.5	0
26	X	0.0	0										0.5	0
27	X	0.0	0										0.6	0
28	X	0.0	0										0.5	0
29	X	0.0	0										0.5	0
30	X	7.0	400,000										0.5	0

Total  
**15,707,000**  
**523,567**  
**1,321,000**

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 30

days checked by operator: 30



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well 75**

III. Daily Data for the Month Year of:

**April 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpm	Disinfectant Concentration (C) Before or After Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C (if Applicable)	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	4.6	267,000									0.6	0
2	X	22.2	1,273,000									0.5	0
3	X	13.2	765,000									0.5	PBWN
4	X	17.3	986,000									0.5	0
5	X	0.0	0									0.5	0
6	X	23.0	1,312,000									0.5	0
7	X	0.0	0									0.5	0
8	X	18.0	1,024,000									0.5	0
9	X	20.5	1,156,000									0.5	0
10	X	12.5	704,000									0.6	0
11	X	18.3	1,043,000									0.6	0
12	X	0.0	0									0.5	0
13	X	22.8	1,282,000									0.5	0
14	X	0.0	0									0.5	0
15	X	14.9	831,000									0.5	0
16	X	22.7	1,258,000									0.4	PBWN
17	X	10.4	581,000									0.6	0
18	X	19.9	1,097,000									0.4	0
19	X	0.0	0									0.6	0
20	X	22.7	1,250,000									0.5	0
21	X	0.0	0									0.5	0
22	X	0.0	0									0.5	PBWN
23	X	27.0	<del>1,463,000</del>									0.6	0
24	X	0.0	0									0.7	0
25	X	21.1	1,130,000									0.5	0
26	X	11.9	638,000									0.5	0
27	X	21.3	1,130,000									0.6	0
28	X	0.0	0									0.5	0
29	X	0.0	0									0.5	0
30	X	24.5	1,295,000									0.5	0

Total: **20,485,000**  
**662,833**  
**1,463,000**

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 30

days checked by operator 30

Plant Name: **Well # 9**

**April 2008**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Chlorine									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²		
1	X	13.9	824,000									0.6	0	
2	X	0.0	0									0.5	0	
3	X	0.0	0									0.5	PBWN	
4	X	21.4	1,299,000									0.5	0	
5	X	0.0	0									0.5	0	
6	X	0.0	0									0.5	0	
7	X	0.0	0									0.5	0	
8	X	0.0	0									0.5	0	
9	X	0.0	0									0.5	0	
10	X	0.0	0									0.6	0	
11	X	0.0	0									0.6	0	
12	X	0.0	0									0.5	0	
13	X	0.0	0									0.5	0	
14	X	0.0	0									0.5	0	
15	X	0.0	0									0.5	0	
16	X	0.0	0									0.4	PBWN	
17	X	0.0	0									0.6	0	
18	X	0.0	0									0.4	0	
19	X	0.0	0									0.6	0	
20	X	0.0	0									0.5	0	
21	X	0.0	0									0.5	0	
22	X	24.1	1,328,000									0.5	PBWN	
23	X	0.0	0									0.6	0	
24	X	10.9	777,000									0.7	0	
25	X	20.6	1,239,000									0.5	0	
26	X	0.0	0									0.5	0	
27	X	23.5	1,222,000									0.6	0	
28	X	8.9	408,000									0.5	0	
29	X	17.8	1,088,000									0.5	0	
30	X	0.0	0									0.5	0	
Total			8,361,000											
			278,700	LOWEST RESIDUAL 0.4									days checked by operator 30	
			1,422,000	DAYS IN MONTH 30										

# Peoples Water Service Company of Florida, Inc.

Pensacola, Florida

PWS# 1170527 Well # 8

795

23583

694245

2487

455.6

Month: April-08

Date	Gas		Electric		Flow		Electric Hours		Gas	Hours	Hours	GPM	pH/Cl2	
	Reading	CF	Reading	KWH Use	Reading	Gallons	Reading	Hours In Op.	reading	Hours In Op.	Total	Flow	Readings	
1	795	0	23583	0	694245	0	2487	0	455.6	0	0	0	NA	NA
2	823	28	23592	360	694552	307,000	2492.5	5.5	460.8	5.2	10.7	478	7.0	0.7
3	823	0	23618	1,040	695140	588,000	2511.7	19.2	460.8	0	19.2	510	7.3	0.7
4	823	0	23618	0	695140	0	2511.7	0	460.8	0	0	0	NA	NA
5	823	0	23618	0	695140	0	2511.7	0	460.8	0	0	0	NA	NA
6	823	0	23618	0	695140	0	2511.7	0	460.8	0	0	0	NA	NA
7	823	0	23660	1,680	696041	901,000	2541.4	29.7	460.8	0	29.7	506	7.2	0.6
8	823	0	23660	0	696041	0	2541.4	0	460.8	0	0	0	NA	NA
9	823	0	23660	0	696041	0	2541.4	0	460.8	0	0	0	NA	NA
10	823	0	23696	1,440	696811	770,000	2566.9	25.5	460.8	0	25.5	503	7.0	0.7
11	823	0	23696	0	696811	0	2566.9	0	460.8	0	0	0	NA	NA
12	823	0	23696	0	696811	0	2566.9	0	460.8	0	0	0	NA	NA
13	823	0	23714	720	697229	418,000	2577.5	10.6	460.8	0	10.6	657	7.2	0.6
14	823	0	23745	1,240	698052	823,000	2598.2	20.7	460.8	0	20.7	663	6.6	0.6
15	823	0	23745	0	698052	0	2598.2	0	460.8	0	0	0	NA	NA
16	823	0	23758	520	698367	315,000	2606.2	8.0	460.8	0	8.0	656	7.4	0.8
17	823	0	23789	1,240	699200	833,000	2627.3	21.1	460.8	0	21.1	658	6.5	0.7
18	823	0	23789	0	699200	0	2627.3	0	460.8	0	0	0	NA	NA
19	823	0	23805	640	699588	388,000	2637	9.7	460.8	0	9.7	667	8.1	0.9
20	823	0	23825	800	700118	530,000	2650.5	13.5	460.8	0	13.5	654	7.0	0.6
21	823	0	23857	1,280	700987	869,000	2672.3	21.8	460.8	0	21.8	664	6.7	0.7
22	823	0	23857	0	700987	0	2672.3	0	460.8	0	0	0	NA	NA
23	823	0	23857	0	700987	0	2672.3	0	460.8	0	0	0	NA	NA
24	823	0	23901	1,760	702117	1,130,000	2700.8	28.5	460.8	0	28.5	661	6.6	0.7
25	823	0	23901	0	702117	0	2700.8	0	460.8	0	0	0	NA	NA
26	823	0	23935	1,360	703019	902,000	2723.7	22.9	460.8	0	22.9	656	6.9	0.6
27	823	0	23935	0	703019	0	2723.7	0	460.8	0	0	0	NA	NA
28	823	0	23975	1,600	704082	1,063,000	2750.7	27.0	460.8	0	27.0	656	7.0	0.7
29	823	0	23984	360	704297	215,000	2756.1	5.4	460.8	0	5.4	664	6.8	0.6
30	823	0	23994	400	704551	254,000	2761.9	5.8	460.8	0	5.8	730	7.0	0.6
Total		28		16,440		10,308,000		274.9		5.2	280.1			
Avg		28		1,028		644,125		17.2		5.2	17.5			
Max		28		1,760		1,130,000		29.7		5.2	29.7			
Min		28		360		215,000		5.4		5.2	5.4		6.5	0.6

# Peoples Water Service Company of Florida Inc.

Well # 8 PWS# 1170527

Pensacola, Florida

Month/Year

April-08

Day	Lime Inventory						Chlorine Inventory						Zinc Ortho Phosphate					
	Start	Used p.m.	Used a.m.	PPM	Added	Total	Start	Daily Reading	Used lbs	PPM	Added	Total	Daily Reading	Used Gal	Pounds	PPM	Added Day/Tank	Total
1	1,200	0	0	0	0	1,200	445	145.0	0.0	0	0	445	21.5	0.0	0.0	0	0.0	21.5
2	1,200	50	50	39.1	0	1,100	445	145.0	2.0	0.8	0	443	21.5	0.0	0.0	0	0.0	21.5
3	1,100	0	100	20.4	0	1,000	443	143.0	2.0	0.4	0	441	21.5	1.0	12.7	2.6	0.0	20.5
4	1,000	0	0	0	0	1,000	441	141.0	0.0	0	0	441	20.5	0.0	0.0	0	0.0	20.5
5	1,000	0	0	0	0	1,000	441	141.0	0.0	0	0	441	20.5	0.0	0.0	0	0.0	20.5
6	1,000	0	0	0	0	1,000	441	141.0	0.0	0	0	441	20.5	0.0	0.0	0	0.0	20.5
7	1,000	100	100	26.6	0	800	441	141.0	5.0	0.7	0	436	20.5	1.0	12.7	1.7	0.0	19.5
8	800	0	0	0	0	800	436	136.0	0.0	0	0	436	19.5	0.0	0.0	0	0.0	19.5
9	800	0	0	0	500	1,300	436	136.0	0.0	0	0	436	19.5	0.0	0.0	0	10.5	30.0
10	1,300	50	100	23.4	0	1,150	436	136.0	3.0	0.5	0	433	30.0	1.0	12.7	2.0	0.0	29.0
11	1,150	0	0	0	0	1,150	433	133.0	0.0	0	0	433	29.0	0.0	0.0	0	0.0	29.0
12	1,150	0	0	0	0	1,150	433	133.0	0.0	0	0	433	29.0	0.0	0.0	0	0.0	29.0
13	1,150	0	100	28.7	0	1,050	433	133.0	3.0	0.9	0	430	29.0	0.0	0.0	0	0.0	29.0
14	1,050	50	100	21.9	0	900	430	130.0	3.0	0.4	0	427	29.0	1.0	12.7	1.9	0.0	28.0
15	900	0	0	0	0	900	427	127.0	0.0	0	0	427	28.0	0.0	0.0	0	0.0	28.0
16	900	0	50	19.0	0	850	427	127.0	2.0	0.8	0	425	28.0	0.0	0.0	0	0.0	28.0
17	850	50	150	28.8	650	1,300	425	125.0	3.0	0.4	0	422	28.0	2.0	25.5	3.7	9.5	35.5
18	1,300	0	0	0	0	1,300	422	122.0	0.0	0	0	422	35.5	0.0	0.0	0	0.0	35.5
19	1,300	50	0	15.5	0	1,250	422	122.0	2.0	0.6	0	420	35.5	0.0	0.0	0	0.0	35.5
20	1,250	0	100	22.6	0	1,150	420	120.0	3.0	0.7	0	417	35.5	0.5	6.4	1.4	0.0	35.0
21	1,150	100	100	27.6	0	950	417	117.0	4.0	0.6	0	413	35.0	1.0	12.7	1.8	0.0	34.0
22	950	0	0	0	0	950	413	113.0	0.0	0	0	413	34.0	0.0	0.0	0	0.0	34.0
23	950	0	0	0	0	950	413	113.0	0.0	0	0	413	34.0	0.0	0.0	0	0.0	34.0
24	950	100	150	26.5	450	1,150	413	113.0	5.0	0.5	0	408	34.0	1.0	12.7	1.4	0.5	33.5
25	1,150	0	0	0	0	1,150	408	108.0	0.0	0	0	408	33.5	0.0	0.0	0	0.0	33.5
26	1,150	100	100	26.6	0	950	408	108.0	4.0	0.5	0	404	33.5	0.5	6.4	0.8	0.0	33.0
27	950	0	0	0	0	950	404	104.0	0.0	0	0	404	33.0	0.0	0.0	0	0.0	33.0
28	950	50	150	22.6	0	750	404	104.0	5.0	0.6	0	399	33.0	0.5	6.4	0.7	0.0	32.5
29	750	0	50	27.9	0	700	399	99.0	1.0	0.6	0	398	32.5	0.0	0.0	0	0.0	32.5
30	700	0	50	23.6	0	650	398	98.0	1.0	0.5	0	397	32.5	0.5	6.4	3.0	0.0	32.0
Total			2,150						48.0						10.0			
Avg			134						1.6						0.3			
Max			250						5.0						2.0			
Min			50						1.0						0.5			



# MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Production for the Month Year of **April 2008**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	Total
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	1,440,000	1,440,000		1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
1	1,208,000	0	267,000	0	824,000						2,297,000
	1,048,000	0	1,273,000	307,000	0						2,628,000
	0	1,232,000	765,000	588,000	0						2,585,000
	0	0	988,000	0	1,299,000						2,285,000
	1,317,000	968,000	0	0	0						2,285,000
	0	1,094,000	1,312,000	0	0						2,406,000
	1,379,000	371,000	0	901,000	0						2,651,000
	1,301,000	0	1,024,000	0	0						2,325,000
	977,000	0	1,156,000	0	0						2,133,000
	0	1,321,000	704,000	770,000	0						2,795,000
	0	1,124,000	1,043,000	0	0						2,167,000
	1,330,000	937,000	0	0	0						2,267,000
	0	1,171,000	1,282,000	418,000	0						2,871,000
	1,236,000	290,000	0	823,000	0						2,349,000
	1,275,000	353,000	831,000	0	0						2,459,000
	1,087,000	0	1,258,000	315,000	0						2,660,000
	0	1,271,000	581,000	833,000	0						2,685,000
	0	1,083,000	1,097,000	0	0						2,180,000
	1,340,000	1,132,000	0	388,000	0						2,860,000
	0	1,199,000	1,250,000	530,000	0						2,979,000
	1,359,000	489,000	0	869,000	0						2,717,000
	1,240,000	0	0	0	1,328,000						2,568,000
	1,086,000	0	1,483,000	0	0						2,549,000
	0	1,272,000	0	1,130,000	777,000						
	0	0	1,130,000	0	1,239,000						2,369,000
	1,405,000	0	638,000	902,000	0						2,945,000
	0	0	1,130,000	0	1,422,000						2,552,000
	1,243,000	0	0	1,083,000	406,000						2,712,000
	1,098,000	0	0	215,000	1,066,000						2,379,000
	1,062,000	400,000	1,295,000	254,000	0						3,011,000
Total	21,937,000	13,707,000	20,485,000	10,305,000	8,361,000						76,848,000
Avg.	732,900	523,567	682,833	343,533	278,700						2,561,533
Max.	1,405,000	1,321,000	1,463,000	1,130,000	1,422,000						3,179,000

0.4

0.4

0.4

0.4

0.4

<---lowest CI



**MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER**  
See last page for instructions.

I. General Information for the Month/Year of: **March 2008**

**A. Public Water System (PWS) Information**

PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,356		Total Population Served at End of Month:	32,746	
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross		Person's Title: Manager		
Contact Person's Mailing Address:	905 Lownd Avenue	City: Pensacola	State: Florida	Zip Code: 32507-0815	
Contact Person's Telephone Number:	(850) 455-8552		Contact Person's Fax Number: (850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com				

**B. Water Treatment Plant Information**

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9			Plant Telephone (850) 455-8552
Plant Address:	905 Lownd Avenue	City: Pensacola	State: Florida	Zip Code: 32507-0815
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant:	4,860,000			
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
Other Operators:	Mark Cross	7169	A	Mon - Fri 8 :00am - 5:00 pm
	Jim Ogle	4927	C	Mon - Fri 8 :00am - 5:00 pm
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit

**II. Certification by Lead/Chief Operator**

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identific

Number: FL 1170527

Plant Name: Well # 3

III. Daily Data for the Month Year of:

March 2008

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	23.3	1,164,000										0.5	0
2	X	0.0	0										0.6	0
3	X	23.0	1,148,000										0.4	0
4	X	20.0	1,061,000										0.5	0
5	X	13.7	795,000										0.6	0
6	X	0.0	0										0.5	0
7	X	0.0	0										0.4	0
8	X	24.2	1,224,000										0.6	0
9	X	0.0	0										0.5	0
10	X	21.3	1,289,000										0.5	PBWN
11	X	22.0	1,291,000										0.5	0
12	X	15.7	928,000										0.6	0
13	X	11.1	667,000										0.4	PBWN
14	X	22.0	1,306,000										0.5	PBWN
15	X	21.3	1,262,000										0.6	0
16	X	0.0	0										0.4	0
17	X	24.1	1,423,000										0.6	0
18	X	23.0	1,337,000										0.5	0
19	X	14.8	869,000										0.5	0
20	X	0.0	0										0.4	0
21	X	0.0	0										0.6	0
22	X	22.5	1,327,000										0.6	0
23	X	0.0	0										0.6	0
24	X	13.9	833,000										0.5	0
25	X	18.1	1,051,000										0.4	PBWN
26	X	19.1	1,128,000										0.5	0
27	X	0.0	0										0.6	0
28	X	0.0	0										0.4	0
29	X	22.7	1,336,000										0.6	0
30	X	0.0	0										0.5	0
31	X	23.5	1,399,000										0.5	0

23,078,000

744,452

1,464,000

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator 31

**PWS Identific**

Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data for the Month/Year of:

**March 2008**

### Means of Achieving Four-Log Virus

**[x]Free Chlorine**

**[ ]Chlorine Dioxide**

**[ ] Ozone**

[ ] Combined Chlorine (Chloramines)

☐ Ultraviolet Radiation

☐ Other:

Type of Disinfectant Residual Maintained in

**[x]Free Chlorine**

**[ ] Combined Chlorine (Chloramines)**

**[ ]Chlorine Dioxide**

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Chlorine Residuals (mg/L)								Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				Free Chlorine	Combined Chlorine (Chloramines)	Chlorine Dioxide	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C			pH of Water, if Applicable
1	X	18.7	1,001,000										0.5	0
2	X	12.1	645,000										0.6	0
3	X	12.5	897,000										0.4	0
4	X	0.0	0										0.5	0
5	X	0.0	0										0.6	0
6	X	21.0	1,130,000										0.5	0
7	X	0.0	0										0.4	0
8	X	6.0	323,000										0.6	0
9	X	22.3	1,202,000										0.5	0
10	X	5.5	299,000										0.5	PBWN
11	X	0.0	0										0.5	0
12	X	0.0	0										0.6	0
13	X	21.1	1,133,000										0.4	PBWN
14	X	0.0	0										0.5	PBWN
15	X	7.1	400,000										0.6	0
16	X	0.0	0										0.4	0
17	X	9.8	513,000										0.6	0
18	X	0.0	0										0.5	0
19	X	0.0	0										0.5	0
20	X	22.9	1,218,000										0.4	0
21	X	0.0	0										0.6	0
22	X	19.9	1,053,000										0.6	0
23	X	0.0	0										0.6	0
24	X	17.3	1,040,000										0.5	0
25	X	0.0	0										0.4	PBWN
26	X	0.0	0										0.5	0
27	X	26.6	1,237,000										0.6	0
28	X	0.0	0										0.4	0
29	X	20.0	1,057,000										0.6	0
30	X	0.0	0										0.5	0
31	X	11.5	636,000										0.5	0
			13,832,000											
			446,194											
			1,287,000											
				LOWEST RESIDUAL		0.4	days checked by operator: 31							
				DAYS IN MONTH		31								



Plant Name: **Well # 5**

**March 2008**

☐ Other:

☐ Combined Chlorine (Chloramines)    ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data (Chloramines) - Chlorine Dioxide								Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²		
1	X	0.0	0									0.5	0
2	X	14.6	603,000									0.6	0
3	X	0.0	0									0.4	0
4	X	0.0	0									0.5	0
5	X	24.3	438,000									0.6	0
6	X	8.8	522,000									0.5	0
7	X	12.3	735,000									0.4	0
8	X	0.0	0									0.6	0
9	X	20.6	1,222,000									0.5	0
10	X	0.0	0									0.5	PBWN
11	X	0.0	0									0.5	0
12	X	22.1	1,303,000									0.6	0
13	X	0.0	0									0.4	PBWN
14	X	4.6	271,000									0.5	PBWN
15	X	0.0	0									0.6	0
16	X	21.5	1,268,000									0.4	0
17	X	0.0	0									0.6	0
18	X	0.0	0									0.5	0
19	X	22.3	1,317,000									0.5	0
20	X	0.0	0									0.4	0
21	X	19.1	1,123,000									0.6	0
22	X	0.0	0									0.6	0
23	X	21.0	1,236,000									0.6	0
24	X	0.0	0									0.5	0
25	X	5.7	338,000									0.4	PBWN
26	X	21.5	1,249,000									0.5	0
27	X	0.0	0									0.6	0
28	X	19.2	1,127,000									0.4	0
29	X	4.3	253,000									0.6	0
30	X	19.6	1,152,000									0.5	0
31	X	0.0	0									0.5	0
			15,155,000										
			488,871	LOWEST RESIDUAL 0.4								days checked by operator 31	
			1,436,000	DAYS IN MONTH 31									

**PWS Identifier**

Number: **FL 1170527**

Plant Name: Well # 8

### III. Daily Data for the Month/Year of:

**March 2008**

Means of Achieving Four-Log Virus	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Chlorine Dioxide	<input type="checkbox"/> Ozone	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Ultraviolet Radiation	<input type="checkbox"/> Other:
-----------------------------------	---	---	--------------------------------	--	--	---------------------------------

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Chlorine Dioxide								Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²		
1	X	0.0	0									0.5	0
2	X	0.0	0									0.6	0
3	X	22.9	683,000									0.4	0
4	X	0.0	0									0.5	0
5	X	0.0	0									0.6	0
6	X	14.2	435,000									0.5	0
7	X	0.0	0									0.4	0
8	X	17.0	528,000									0.6	0
9	X	0.0	0									0.5	0
10	X	26.4	808,000									0.5	PBWN
11	X	0.0	0									0.5	0
12	X	0.0	0									0.6	0
13	X	19.5	596,000									0.4	PBWN
14	X	0.0	0									0.5	PBWN
15	X	18.5	563,000									0.6	0
16	X	0.0	0									0.4	0
17	X	23.6	725,000									0.6	0
18	X	0.0	0									0.5	0
19	X	0.0	0									0.5	0
20	X	22.3	680,000									0.4	0
21	X	0.0	0									0.6	0
22	X	0.0	0									0.6	0
23	X	0.0	0									0.6	0
24	X	25.7	784,000									0.5	0
25	X	0.0	0									0.4	PBWN
26	X	0.0	0									0.5	0
27	X	25.3	773,000									0.6	0
28	X	0.0	0									0.4	0
29	X	0.0	0									0.6	0
30	X	0.0	0									0.5	0
31	X	22.7	692,000									0.5	0
			7,267,000										
			234,419										
			808,000										
				LOWEST RESIDUAL		0.4	days checked by operator 31						
				DAYS IN MONTH		31							

**PWS Identifi**

Number: **FL 1170527**

Plant Name: **Well # 9**

**March 2008**

### Means of Achieving Four-Log Virus

☒ Free Chlorine

**[ ]Chlorine Dioxide**

**[ ] Ozone**

**[ ] Combined Chlorine (Chloramines)**

**[ ] Ultraviolet Radiation**

[ ] Other:

Type of Disinfectant Residual Maintained in

**[x]Free Chlorine**

**[ ] Combined Chlorine (Chloramines)**

**[ ]Chlorine Dioxide**

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Free Chlorine									Combined Chlorine (Chloramines)			Chlorine Dioxide			Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²								
1	X	0.0	0														0.5	0		
2	X	23.4	1,422,000														0.6	0		
3	X	0.1	0														0.4	0		
4	X	17.6	1,129,000														0.5	0		
5	X	0.0	0														0.6	0		
6	X	5.1	301,000														0.5	0		
7	X	20.6	1,233,000														0.4	0		
8	X	0.0	0														0.6	0		
9	X	0.0	0														0.5	0		
10	X	0.0	0														0.5	PBWN		
11	X	15.5	918,000														0.5	0		
12	X	0.0	0														0.6	0		
13	X	15.6	939,000														0.4	PBWN		
14	X	18.2	1,082,000														0.5	PBWN		
15	X	0.0	0														0.6	0		
16	X	23.5	1,420,000														0.4	0		
17	X	0.0	0														0.6	0		
18	X	16.9	1,018,000														0.5	0		
19	X	0.0	0														0.5	0		
20	X	0.0	0														0.4	0		
21	X	28.1	1,582,000														0.6	0		
22	X	0.0	0														0.6	0		
23	X	22.4	1,377,000														0.6	0		
24	X	0.0	0														0.5	0		
25	X	19.3	1,166,000														0.4	PBWN		
26	X	0.0	0														0.5	0		
27	X	11.9	714,000														0.6	0		
28	X	21.5	1,309,000														0.4	0		
29	X	0.0	0														0.6	0		
30	X	22.0	1,331,000														0.5	0		
31	X	0.0	0														0.5	0		
			17,029,000																	
			549,323													LOWEST RESIDUAL	0.4	days checked by operator	31	
			1,692,000													DAYS IN MONTH	31			

**MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS**

Date Finished: Production for the Month/Year of:

**March 2008**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Planned Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,140,000	1,140,000	1,140,000	1,072,000	1,140,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
1	1,164,000	1,001,000	0	0	0						2,165,000
2	0	645,000	603,000	0	1,422,000						2,670,000
3	1,148,000	897,000	0	683,000	0						2,728,000
4	1,081,000	0	0	0	1,129,000						2,190,000
5	795,000	0	1,436,000	0	0						2,231,000
6	0	1,130,000	522,000	435,000	301,000						2,388,000
7	0	0	738,000	0	1,233,000						1,988,000
8	1,484,000	323,000	0	528,000	0						2,315,000
9	0	1,202,000	1,222,000	0	0						2,424,000
10	1,289,000	299,000	0	808,000	0						2,398,000
11	1,291,000	0	0	0	918,000						2,207,000
12	928,000	0	1,303,000	0	0						2,231,000
13	667,000	1,133,000	0	596,000	939,000						
14	1,306,000	0	271,000	0	1,062,000						2,639,000
15	1,262,000	400,000	0	563,000	0						2,225,000
16	0	0	1,268,000	0	1,420,000						2,688,000
17	1,423,000	513,000	0	725,000	0						2,661,000
18	1,337,000	0	0	0	1,018,000						2,355,000
19	869,000	0	1,317,000	0	0						2,186,000
20	0	1,216,000	0	680,000	0						1,896,000
21	0	0	1,123,000	0	1,692,000						2,815,000
22	1,327,000	1,053,000	0	0	0						2,380,000
23	0	0	1,236,000	0	1,377,000						2,613,000
24	833,000	1,040,000	0	784,000	0						2,657,000
25	1,051,000	0	338,000	0	1,166,000						2,555,000
26	1,128,000	0	1,249,000	0	0						2,377,000
27	0	1,267,000	0	773,000	714,000						2,774,000
28	0	0	1,127,000	0	1,308,000						2,436,000
29	1,336,000	1,067,000	283,000	0	0						2,646,000
30	0	0	1,152,000	0	1,331,000						2,483,000
31	1,399,000	636,000	0	692,000	0						2,727,000
Total	23,076,000	13,852,000	15,155,000	7,267,000	17,029,000						76,361,000
Avg.	744,452	446,194	488,871	234,419	549,323						2,463,258
Max.	1,464,000	1,287,000	1,436,000	808,000	1,692,000						3,335,000

0.4

0.4

0.4

0.4

0.4

<—lowest CI





**MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER**  
See last page for instructions.

I. General Information for the Month/Year of: **February 2008**

**A. Public Water System (PWS) Information**


PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,318			Total Population Served at End of Month:	32,613
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross			Person's Title:	Manager
Contact Person's Mailing Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Contact Person's Telephone Number:	(850) 455-8552	Contact Person's Fax Number:	(850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.com				

**B. Water Treatment Plant Information**

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9			Plant Telephone (850) 455-8552	
Plant Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water	<input type="checkbox"/> Purchased Finished Water			
Permitted Maximum Day Operating Capacity of Plant,	4,880,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	
Other Operators:	Mark Cross	7169	A	Mon - Fri 8 :00am - 5:00 pm	
	Jim Ogle	4927	C	Mon - Fri 8 :00am - 5:00 pm	
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm	
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit	

**II. Certification by Lead/Chief Operator**

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

 MAR 6, 2008  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: FL 1170527

Plant Name: Well # 3

III. Daily Data for the Month Year of:

February 2008

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.4	0
2	X	22.4	1,143,000										0.5	0
3	X	0.0	0										0.7	0
4	X	17.6	902,000										0.5	0
5	X	17.5	1,152,000										0.6	0
6	X	23.5	936,000										0.5	0
7	X	0.0	0										0.6	0
8	X	0.0	0										0.5	0
9	X	23.6	1,113,000										0.5	0
10	X	0.0	0										0.5	0
11	X	21.4	1,082,000										0.6	0
12	X	22.4	1,117,000										0.5	0
13	X	4.7	233,000										0.4	0
14	X	0.0	0										0.5	0
15	X	0.0	0										0.6	0
16	X	22.3	1,122,000										0.5	0
17	X	0.0	0										0.6	0
18	X	22.0	1,114,000										0.6	0
19	X	22.8	1,136,000										0.5	0
20	X	19.2	966,000										0.5	0
21	X	0.0	0										0.5	0
22	X	0.0	0										0.6	0
23	X	22.8	1,140,000										0.7	0
24	X	0.0	0										0.5	0
25	X	21.6	1,085,000										0.6	0
26	X	22.8	1,124,000										0.4	0
27	X	16.0	796,000										0.6	0
28	X	0.0	0										0.7	0
29	X	23.3	1,164,000										0.6	0

Total	17,409,000
	600,310
	1,195,000

LOWEST RESIDUAL 0.4

DAYS IN MONTH 29

days checked by operator 29

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data for the Month/Year of:

**February 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.4	0
2	X	8.0	427,000										0.5	0
3	X	0.0	0										0.7	0
4	X	13.3	709,000										0.5	0
5	X	12.9	691,000										0.8	0
6	X	0.0	0										0.5	0
7	X	22.3	1,190,000										0.6	0
8	X	0.0	0										0.5	0
9	X	9.6	511,000										0.5	0
10	X	0.0	0										0.5	0
11	X	13.9	762,000										0.6	0
12	X	0.0	0										0.5	0
13	X	0.0	0										0.4	0
14	X	14.7	762,000										0.5	0
15	X	0.0	0										0.6	0
16	X	18.8	1,010,000										0.5	0
17	X	0.0	0										0.6	0
18	X	12.4	664,000										0.6	0
19	X	0.0	0										0.5	0
20	X	0.0	0										0.5	0
21	X	23.4	1,232,000										0.5	0
22	X	0.0	0										0.6	0
23	X	9.2	496,000										0.7	0
24	X	7.3	393,000										0.5	0
25	X	6.6	403,000										0.6	0
26	X	0.0	0										0.4	0
27	X	5.5	247,000										0.6	0
28	X	21.4	1,129,000										0.7	0
29	X	18.0	1,001,000										0.6	0

**11,627,000**

**400,931**

**1,232,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 29

days checked by operator: 29

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month/Year of:

**February 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Livees Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	14.6	688,000										0.4	0
2	X	0.0	0										0.5	0
3	X	18.6	884,000										0.7	0
4	X	0.0	0										0.5	0
5	X	0.0	0										0.6	0
6	X	29.6	1,089,000										0.5	0
7	X	8.8	406,000										0.6	0
8	X	14.1	643,000										0.5	0
9	X	0.0	0										0.5	0
10	X	18.4	830,000										0.5	0
11	X	0.0	0										0.6	0
12	X	0.0	0										0.5	0
13	X	14.6	661,000										0.4	0
14	X	0.0	0										0.5	0
15	X	15.5	688,000										0.6	0
16	X	0.0	0										0.5	0
17	X	17.2	759,000										0.6	0
18	X	0.0	0										0.6	0
19	X	0.0	0										0.5	0
20	X	24.8	1,089,000										0.5	0
21	X	0.0	0										0.5	0
22	X	14.9	638,000										0.6	0
23	X	0.0	0										0.7	0
24	X	17.4	745,000										0.5	0
25	X	0.0	0										0.6	0
26	X	0.0	0										0.4	0
27	X	22.8	967,000										0.6	0
28	X	0.0	0										0.7	0
29	X	15.1	626,000										0.6	0

**10,989,000**

**378,931**

**1,365,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 29

days checked by operator 29



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: **FL 1170527**

Plant Name: **Well # 8**

III. Daily Data for the Month Year of

**February 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C If Applicable	pH of Water, If Applicable	Minimum CT, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.4	0
2	X	19.0	584,000										0.5	0
3	X	0.0	0										0.7	0
4	X	21.5	644,000										0.5	0
5	X	0.0	0										0.6	0
6	X	0.0	0										0.5	0
7	X	28.8	891,000										0.6	0
8	X	0.0	0										0.5	0
9	X	20.6	636,000										0.5	0
10	X	0.0	0										0.5	0
11	X	22.3	682,000										0.6	0
12	X	0.0	0										0.5	0
13	X	0.0	0										0.4	0
14	X	0.0	0										0.5	0
15	X	0.0	0										0.6	0
16	X	0.0	0										0.5	0
17	X	0.0	0										0.6	0
18	X	30.3	926,000										0.6	0
19	X	0.0	0										0.5	0
20	X	7.9	244,000										0.5	0
21	X	17.8	546,000										0.5	0
22	X	0.0	0										0.6	0
23	X	18.0	559,000										0.7	0
24	X	0.0	0										0.5	0
25	X	23.3	710,000										0.6	0
26	X	0.0	0										0.4	0
27	X	0.0	0										0.6	0
28	X	25.2	778,000										0.7	0
29	X	0.0	0										0.6	0

**7,200,000**

**248,276**

**926,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 29

days checked by operator 29

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identific

Number: **FL 1170527**

Plant Name: **Well #9**

III. Daily Data for the Month Year of:

**February 2008**

Means of Achieving Four-Log Virus ☒Free Chlorine ☐Chlorine Dioxide ☐Ozone ☐Combined Chlorine (Chloramines) ☐Ultraviolet Radiation ☐Other:

Type of Disinfectant Residual Maintained in ☒Free Chlorine ☐Combined Chlorine (Chloramines) ☐Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	21.1	1,282,000										0.4	0
2	X	0.0	0										0.5	0
3	X	23.6	1,459,000										0.7	0
4	X	0.0	0										0.5	0
5	X	0.0	0										0.6	0
6	X	0.0	0										0.5	0
7	X	0.0	0										0.6	0
8	X	22.4	1,410,000										0.5	0
9	X	0.0	0										0.5	0
10	X	22.8	1,408,000										0.5	0
11	X	0.0	0										0.6	0
12	X	17.3	1,032,000										0.5	0
13	X	21.7	1,344,000										0.4	0
14	X	23.6	1,351,000										0.5	0
15	X	21.9	1,346,000										0.6	0
16	X	0.0	0										0.5	0
17	X	23.0	1,410,000										0.6	0
18	X	0.0	0										0.6	0
19	X	18.0	1,087,000										0.5	0
20	X	0.0	0										0.5	0
21	X	6.8	393,000										0.5	0
22	X	20.8	1,267,000										0.6	0
23	X	0.0	0										0.7	0
24	X	23.5	1,441,000										0.5	0
25	X	0.0	0										0.6	0
26	X	17.5	1,048,000										0.4	0
27	X	0.0	0										0.6	0
28	X	8.2	487,000										0.7	0
29	X	22.4	1,381,000										0.6	0

Total	19,259,000
	664,103
	1,464,000

LOWEST RESIDUAL 0.4

days checked by operator 29

DAYS IN MONTH 29

# MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month Year of

February 2008

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

Day of Month	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	Total
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Permanent Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	1,440,000	1,440,000		1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
1	0	0	688,000	0	1,282,000						1,970,000
	1,143,000	427,000	0	584,000	0						2,154,000
	0	0	884,000	0	1,459,000						2,343,000
	902,000	709,000	0	644,000	0						2,255,000
	1,152,000	691,000	0	0	0						1,843,000
	936,000	0	1,365,000	0	0						2,301,000
	0	1,190,000	406,000	891,000	0						2,487,000
	0	0	643,000	0	1,410,000						2,053,000
	1,195,000	511,000	0	636,000	0						2,342,000
	0	0	830,000	0	1,408,000						2,238,000
	1,082,000	762,000	0	682,000	0						2,526,000
	1,117,000	0	0	0	1,032,000						2,149,000
	233,000	0	661,000	0	1,344,000						2,238,000
	0	762,000	0	0	1,464,000						2,226,000
	0	0	668,000	0	1,346,000						2,034,000
	1,122,000	1,010,000	0	0	0						2,132,000
	0	0	759,000	0	1,410,000						2,169,000
	1,114,000	664,000	0	926,000	0						2,704,000
	1,136,000	0	0	0	1,087,000						2,223,000
	968,000	0	1,089,000	244,000	0						2,301,000
	0	1,232,000	0	546,000	393,000						2,171,000
	0	0	638,000	0	1,267,000						1,905,000
	1,140,000	496,000	0	559,000	0						2,195,000
	0	393,000	745,000	0	1,441,000						2,579,000
	1,085,000	403,000	0	710,000	0						2,198,000
	1,124,000	0	0	0	1,048,000						2,172,000
	796,000	247,000	967,000	0	0						2,010,000
	0	1,129,000	0	778,000	487,000						2,394,000
	1,164,000	1,001,000	626,000	0	1,381,000						
<b>Total</b>	<b>17,409,000</b>	<b>11,627,000</b>	<b>10,969,000</b>	<b>7,200,000</b>	<b>19,259,000</b>						<b>66,484,000</b>
<b>Avg.</b>	<b>600,310</b>	<b>400,931</b>	<b>378,931</b>	<b>248,276</b>	<b>664,103</b>						<b>2,292,552</b>
<b>Max.</b>	<b>1,195,000</b>	<b>1,232,000</b>	<b>1,365,000</b>	<b>926,000</b>	<b>1,464,000</b>						<b>4,172,000</b>

0.4

0.4

0.4

0.4

0.4

<---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **January 2008**

## A. Public Water System (PWS) Information

PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>			PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	<b>9,396</b>			Total Population Served at End of Month:	<b>32,886</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person:	<b>Mark Cross</b>		Person's Title: <b>Manager</b>		
Contact Person's Mailing Address:	<b>905 Lowndes Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>	
Contact Person's Telephone Number:	<b>(850) 455-8552</b>		Contact Person's Fax Number: <b>(850) 456-1010</b>		
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.Com</b>				

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>			Plant Telephone <b>(850) 455-8552</b>	
Plant Address:	<b>905 Lowndes Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>	
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water		
Permitted Maximum Day Operating Capacity of Plant:	<b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>		Plant Class (per subsection 62-699.310(4), F.A.C.): <b>C</b>		
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
Other Operators:	<b>Mark Cross</b>	<b>7189</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

*Theo Deleon Feb 4, 2008*  
Signature and Date

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number



Plant Name: **Well # 3**

Means of Achieving Four-Log Virus	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Chlorine Dioxide	<input type="checkbox"/> Ozone	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Ultraviolet Radiation	<input type="checkbox"/> Other:
-----------------------------------	---	---	--------------------------------	--	--	---------------------------------

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	UV Dose									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	23.6	1,080,000									0.5	0	
2	X	20.5	1,080,000									0.6	0	
3	X	0.0	0									0.7	0	
4	X	18.8	1,005,000									0.6	0	
5	X	23.0	1,198,000									0.5	0	
6	X	0.0	0									0.5	0	
7	X	19.7	1,015,000									0.5	0	
8	X	23.3	1,188,000									0.4	PBWN	
9	X	16.7	858,000									0.7	0	
10	X	0.0	0									0.8	0	
11	X	0.0	0									0.5	0	
12	X	22.7	1,183,000									0.5	0	
13	X	0.0	0									0.6	0	
14	X	22.4	1,177,000									0.4	0	
15	X	22.6	1,170,000									0.7	0	
16	X	19.6	1,024,000									0.5	0	
17	X	0.0	0									0.6	0	
18	X	0.0	0									0.7	0	
19	X	23.5	1,224,000									0.6	0	
20	X	0.0	0									0.7	0	
21	X	21.9	1,134,000									0.6	0	
22	X	22.5	1,140,000									0.5	0	
23	X	19.6	1,013,000									0.6	0	
24	X	0.0	0									0.6	0	
25	X	0.0	0									0.5	0	
26	X	22.7	1,173,000									0.5	0	
27	X	0.0	0									0.6	0	
28	X	22.1	1,127,000									0.5	0	
29	X	22.2	1,125,000									0.4	PBWN	
30	X	12.0	612,000									0.4	0	
31	X	0.0	0									0.5	0	
			20,682,000											
			667,161											
			1,236,000											
				LOWEST RESIDUAL		0.4	days checked by operator						31	
				DAYS IN MONTH		31								

Plant Name: **Well # 4**

**January 2008**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

DAYS IN MONTH 31

# MONTHLY CATION REPORT FOR PWSs TREATING RAW GROUND WATER PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year on: **January 2008**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C If Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	21.7	1,094,000										0.5	0
2	X	23.4	1,162,000										0.6	0
3	X	15.3	754,000										0.7	0
4	X	18.8	938,000										0.6	0
5	X	0.0	0										0.5	0
6	X	22.8	1,119,000										0.5	0
7	X	0.0	0										0.5	0
8	X	0.0	0										0.4	PBWN
9	X	21.9	1,073,000										0.7	0
10	X	0.0	0										0.6	0
11	X	19.2	958,000										0.5	0
12	X	0.0	0										0.5	0
13	X	20.4	1,010,000										0.6	0
14	X	0.0	0										0.4	0
15	X	0.0	0										0.7	0
16	X	19.7	1,000,000										0.5	0
17	X	0.0	0										0.6	0
18	X	21.3	1,035,000										0.7	0
19	X	0.0	0										0.6	0
20	X	21.2	1,017,000										0.7	0
21	X	0.0	0										0.6	0
22	X	0.0	0										0.5	0
23	X	29.5	1,110,000										0.6	0
24	X	0.0	0										0.6	0
25	X	21.2	1,013,000										0.5	0
26	X	0.0	0										0.5	0
27	X	18.1	906,000										0.6	0
28	X	0.0	0										0.5	0
29	X	0.0	0										0.4	PBWN
30	X	22.1	1,053,000										0.4	0
31	X	0.0	0										0.5	0
			15,512,000											
			500,387											
			1,270,000											

LOWEST RESIDUAL 0.4

days checked by operator 31

DAYS IN MONTH 31

Plant Name: **Well # 8****January 2008**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

DAYS IN MONTH 31



Plant Name: **Well # 9****January 2008**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

DAYS IN MONTH 31

MONTHLY OPERATIONAL REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month Year of

January 2008

Community Water System (CWS) Name: Peoples Water Service Company of Florida, Inc.

Public Water System (PWS) Identification FL 1170527

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	1,440,000	1,440,000		1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	1,236,000	0	1,094,000	0	0						2,330,000
	1,080,000	0	1,162,000	340,000	0						2,582,000
	0	1,369,000	754,000	691,000	0						2,814,000
	1,005,000	0	938,000	0	0						1,943,000
	1,198,000	1,243,000	0	244,000	0						2,685,000
	0	1,268,000	1,119,000	506,000	0						
	1,015,000	389,000	0	634,000	371,000						2,409,000
	1,188,000	0	0	0	1,078,000						2,266,000
	858,000	0	1,073,000	0	0						1,931,000
	0	1,295,000	0	827,000	536,000						2,658,000
	0	0	958,000	0	1,054,000						2,012,000
	1,183,000	533,000	0	630,000	0						2,346,000
	0	0	1,010,000	0	1,395,000						2,405,000
	1,177,000	738,000	0	597,000	0						2,512,000
	1,170,000	0	0	0	1,141,000						2,311,000
	1,024,000	0	1,270,000	208,000	0						2,502,000
	0	1,205,000	0	601,000	489,000						2,275,000
	0	0	1,035,000	0	1,066,000						2,101,000
	1,224,000	562,000	0	700,000	0						2,486,000
	0	0	1,017,000	0	1,362,000						2,379,000
	1,134,000	734,000	0	701,000	0						2,569,000
	1,140,000	0	0	0	962,000						2,102,000
	1,013,000	0	1,110,000	311,000	0						2,434,000
	0	1,219,000	0	614,000	441,000						2,274,000
	0	0	1,013,000	0	1,061,000						2,074,000
	1,173,000	488,000	0	631,000	0						2,292,000
	0	0	908,000	0	1,417,000						2,323,000
	1,127,000	631,000	0	697,000	0						2,455,000
	1,125,000	0	0	0	1,038,000						2,163,000
	612,000	474,000	1,053,000	0	0						2,139,000
	0	1,164,000	0	647,000	443,000						2,254,000
Total	20,682,000	13,312,000	15,512,000	9,579,000	13,834,000						72,919,000
Avg.	667,161	429,419	500,387	309,000	446,258						2,352,226
Max.	1,236,000	1,369,000	1,270,000	827,000	1,417,000						2,893,000
	0.4	0.4	0.4	0.4	0.4						

<--lowest CI

## 2007 Monthly Operating Reports



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **December 2007**

## A. Public Water System (PWS) Information

PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>			PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	<b>9,268</b>			Total Population Served at End of Month:	<b>32,438</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person:	<b>Mark Cross</b>			Person's Title: <b>Manager</b>	
Contact Person's Mailing Address:	<b>905 Lownde Avenue</b>	City:	<b>Pensacola</b>	State:	<b>Florida</b>
Contact Person's Telephone Number:	<b>(850) 455-8552</b>	Contact Person's Fax Number:	<b>(850) 456-1010</b>		
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.Com</b>				

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>			Plant Telephone (850) 455-8552	
Plant Address:	<b>905 Lownde Avenue</b>	City:	<b>Pensacola</b>	State:	<b>Florida</b>
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water			<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant,	<b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>	Plant Class (per subsection 62-699.310(4), F.A.C.): <b>C</b>			
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
Other Operators:	<b>Mark Cross</b>	<b>7169</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
	<b>Chester Horton</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Gary Leatherberry</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

*Theo Deleon* 1/5/08  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number



**PWS Identification**

Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month Year of:

**December 2007**

### Means of Achieving Four-Log Virus

**[x]Free Chlorine**

[ ]Chlorine Dioxide

☐ Ozone

☐ **Combi**

### Med Chlorine (Chloramines)

**[ ]Ultraviolet Radiation**

[ ] Other:

Type of Disinfectant Residual Maintained in

[x]Free Chlorine

[ ] Combined Chlorine (Chloramines)

[ ]Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	22.0	1,177,000										0.5	0
2	X	0.0	0										0.5	0
3	X	23.6											0.4	PBWN
4	X	20.9	1,111,000										0.6	0
5	X	19.3	1,036,000										0.6	PBWN
6	X	0.0	0										0.6	0
7	X	20.3	1,088,000										0.5	0
8	X	22.1	1,174,000										0.5	0
9	X	0.0	0										0.5	0
10	X	22.3	1,187,000										0.6	0
11	X	23.7	1,256,000										0.5	0
12	X	16.5	866,000										0.7	0
13	X	0.0	0										0.7	0
14	X	9.8	506,000										0.4	0
15	X	20.0	1,050,000										0.5	0
16	X	0.0	0										0.6	0
17	X	22.3	1,188,000										0.4	0
18	X	23.2	1,236,000										0.5	0
19	X	19.2	1,014,000										0.6	0
20	X	0.0	0										0.7	0
21	X	18.2	966,000										0.6	0
22	X	22.4	1,177,000										0.5	0
23	X	0.0	0										0.4	0
24	X	22.2	1,175,000										0.6	0
25	X	22.8	1,197,000										0.6	0
26	X	18.8	967,000										0.6	0
27	X	0.0	0										0.6	0
28	X	19.8	1,064,000										0.6	0
29	X	21.6	1,123,000										0.6	0
30	X	0.0	0										0.4	0
31	X	22.2	1,166,000										0.7	0
			24,010,000											
			774,516	LOWEST RESIDUAL 0.4				days checked by operator 31						
			1,286,000	DAYS IN MONTH 31										

Plant Name: **Well # 4**

**December 2007**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year of: **December 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	4.0	219,000										0.5	0
2	X	21.2	1,149,000										0.5	0
3	X	0.0	0										0.4	PBWN
4	X	0.0	0										0.6	0
5	X	26.0											0.6	PBWN
6	X	10.4	557,000										0.6	0
7	X	21.3	1,138,000										0.5	0
8	X	0.0	0										0.5	0
9	X	22.4	1,197,000										0.5	0
10	X	0.0	0										0.6	0
11	X	21.5	1,129,000										0.5	0
12	X	20.3	1,059,000										0.7	0
13	X	11.3	589,000										0.7	0
14	X	18.2	941,000										0.4	0
15	X	0.0	0										0.5	0
16	X	22.5	1,187,000										0.6	0
17	X	0.0	0										0.4	0
18	X	19.3	1,004,000										0.5	0
19	X	22.8	1,185,000										0.6	0
20	X	7.8	408,000										0.7	0
21	X	20.8	1,080,000										0.6	0
22	X	0.0	0										0.5	0
23	X	22.3	1,156,000										0.4	0
24	X	0.0	0										0.6	0
25	X	19.0	984,000										0.6	0
26	X	21.5	1,106,000										0.6	0
27	X	8.0	413,000										0.6	0
28	X	21.0	1,081,000										0.6	0
29	X	0.0	0										0.6	0
30	X	21.9	1,115,000										0.4	0
31	X	0.0	0										0.7	0
			<b>20,105,000</b>											
			<b>648,548</b>											
			<b>1,408,000</b>											
				LOWEST RESIDUAL 0.4					days checked by operator 31					
				DAYS IN MONTH 31										

Plant Name: **Well # 8****December 2007**☐ Free Chlorine    ☐ Chlorine Dioxide    ☐ Ozone    ☐ Combined Chlorine (Chloramines)    ☐ Ultraviolet Radiation    ☐ Other:

☐ Chlorine Dioxide

DAYS IN MONTH 31



Plant Name: **Well # 9**

December 2007

☐ Other:

[ ]Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²		
1	X	0.0	0										0.5	0
2	X	23.5											0.5	0
3	X	0.0	0										0.4	PBWN
4	X	17.9	1,109,000										0.6	0
5	X	0.0	0										0.6	PBWN
6	X	0.0	0										0.6	0
7	X	0.0	0										0.5	0
8	X	0.0	0										0.5	0
9	X	0.0	0										0.5	0
10	X	0.0	0										0.6	0
11	X	0.0	0										0.5	0
12	X	0.0	0										0.7	0
13	X	0.0	0										0.7	0
14	X	0.0	0										0.4	0
15	X	0.0	0										0.5	0
16	X	0.0	0										0.6	0
17	X	0.0	0										0.4	0
18	X	0.0	0										0.5	0
19	X	0.0	0										0.6	0
20	X	0.0	0										0.7	0
21	X	0.0	0										0.6	0
22	X	0.0	0										0.5	0
23	X	0.0	0										0.4	0
24	X	0.0	0										0.6	0
25	X	0.0	0										0.6	0
26	X	0.0	0										0.6	0
27	X	0.0	0										0.6	0
28	X	0.0	0										0.6	0
29	X	0.0	0										0.6	0
30	X	0.0	0										0.4	0
31	X	0.0	0										0.7	0
			2,546,000											
			82,129	LOWEST RESIDUAL 0.4				days checked by operator 31						
			1,437,000	DAYS IN MONTH 31										

**MONTHLY OPERATING REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS**
**AT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished Water Production for the Month Year of:

**December 2007**

 Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

 Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	1,440,000	1,440,000		1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	1,177,000	1,121,000	219,000	0	0						2,517,000
	0	0	1,149,000	0	1,437,000						2,586,000
	1,286,000	862,000	0	643,000	0						2,591,000
	1,111,000	0	0	0	1,109,000						2,220,000
	1,036,000	0	1,408,000	0	0						2,444,000
	0	1,207,000	557,000	762,000	0						2,526,000
	1,088,000	0	1,138,000	0	0						2,226,000
	1,174,000	1,149,000	0	283,000	0						2,586,000
	0	1,247,000	1,197,000	289,000	0						2,703,000
	1,187,000	477,000	0	650,000	0						2,314,000
	1,256,000	0	1,129,000	0	0						2,385,000
	886,000	0	1,059,000	0	0						1,925,000
	0	1,325,000	589,000	812,000	0						2,726,000
	506,000	0	941,000	693,000	0						2,140,000
	1,050,000	737,000	0	497,000	0						2,284,000
	0	1,226,000	1,187,000	0	0						2,413,000
	1,188,000	450,000	0	816,000	0						2,454,000
	1,236,000	0	1,004,000	0	0						2,240,000
	1,014,000	0	1,185,000	0	0						2,199,000
	0	1,299,000	408,000	714,000	0						2,421,000
	966,000	0	1,080,000	0	0						2,046,000
	1,177,000	1,053,000	0	0	0						2,230,000
	0	1,094,000	1,156,000	173,000	0						2,423,000
	1,175,000	516,000	0	673,000	0						2,364,000
	1,197,000	0	984,000	0	0						2,181,000
	967,000	0	1,106,000	0	0						2,073,000
	0	1,272,000	413,000	759,000	0						2,444,000
	1,064,000	0	1,081,000	0	0						2,145,000
	1,123,000	1,042,000	0	0	0						2,165,000
	0	1,063,000	1,115,000	282,000	0						2,460,000
	1,166,000	436,000	0	668,000	0						2,270,000
Total	24,010,000	17,376,000	20,105,000	8,664,000	2,546,000						72,701,000
Avg.	774,516	560,516	648,548	279,484	82,129						2,345,194
Max.	1,286,000	1,325,000	1,408,000	816,000	1,437,000						2,726,000

0.4

0.4

0.4

0.4

0.4

&lt;---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

<b>I. General Information for the Month/Year of:</b> <b>November 2007</b>				
<b>A. Public Water System (PWS) Information</b>				
PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>		PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive
Number of Service Connections at End of Month:	<b>9,341</b>		Total Population Served at End of Month:	<b>32,694</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>			
Contact Person:	<b>Mark Cross</b>		Person's Title: <b>Manager</b>	
Contact Person's Mailing Address:	<b>905 Lowndes Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Contact Person's Telephone Number:	<b>(850) 455-8552</b>		Contact Person's Fax Number: <b>(850) 456-1010</b>	
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.com</b>			
<b>B. Water Treatment Plant Information</b>				
Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>		Plant Telephone <b>(850) 455-8552</b>	
Plant Address:	<b>905 Lowndes Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant:	<b>4,860,000</b>			
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>		Plant Class (per subsection 62-699.310(4), F.A.C.):	<b>C</b>
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>
Other Operators:	<b>Mark Cross</b>	<b>7169</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>
	<b>Chester Horton</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Gary Leatherberry</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
<b>II. Certification by Lead/Chief Operator</b>				

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

 12/7/07  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527** Plant Name: **Well # 3**

III. Daily Data for the Month Year of: **November 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Quality Control									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	0.0	0										0.5	0
2	X	0.0	0										0.4	0
3	X	23.6											0.4	0
4	X	0.0	0										0.4	0
5	X	22.4	1,247,000										0.5	0
6	X	22.6	1,225,000										0.6	PBWN
7	X	18.4	1,012,000										0.5	0
8	X	0.0	0										0.6	0
9	X	0.0	0										0.5	0
10	X	23.0	1,263,000										0.5	0
11	X	0.0	0										0.5	0
12	X	23.3	1,282,000										0.6	0
13	X	22.8	1,234,000										0.6	PBWN
14	X	21.6	1,181,000										0.6	0
15	X	0.0	0										0.6	0
16	X	0.0	0										0.5	0
17	X	23.3	1,270,000										0.5	PBWN
18	X	0.0	0										0.5	0
19	X	23.2	1,267,000										0.5	0
20	X	23.8	1,284,000										0.5	0
21	X	18.1	974,000										0.5	0
22	X	0.0	0										0.6	0
23	X	0.0	0										0.5	0
24	X	23.0	1,248,000										0.6	0
25	X	0.0	0										0.5	0
26	X	23.9	1,291,000										0.6	0
27	X	21.5	1,148,000										0.5	0
28	X	17.5	950,000										0.6	0
29	X	0.0	0										0.6	0
30	X	0.0	0										0.6	0

**19,185,000**

**639,500**

**1,309,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 30

days checked by operator 30



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification

Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data for the Month Year of:

**November 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C If Applicable	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	23.0	1,243,000										0.5	0
2	X	0.0	0										0.4	0
3	X	9.1	492,000										0.4	0
4	X	0.0	0										0.4	0
5	X	12.1	663,000										0.5	0
6	X	0.0	0										0.6	PBWN
7	X	0.0	0										0.5	0
8	X	23.4	1,243,000										0.6	0
9	X	0.0	0										0.5	0
10	X	11.6	627,000										0.5	0
11	X	0.0	0										0.5	0
12	X	12.8	701,000										0.6	0
13	X	0.0	0										0.6	PBWN
14	X	0.0	0										0.6	0
15	X	23.2	1,253,000										0.6	0
16	X	0.0	0										0.5	0
17	X	10.3	563,000										0.5	PBWN
18	X	0.0	0										0.5	0
19	X	12.0	657,000										0.5	0
20	X	0.0	0										0.5	0
21	X	0.0	0										0.5	0
22	X	22.6	1,227,000										0.6	0
23	X	0.0	0										0.5	0
24	X	21.1	1,134,000										0.6	0
25	X	0.0	0										0.5	0
26	X	20.5	1,100,000										0.6	0
27	X	0.0	0										0.5	0
28	X	0.0	0										0.6	0
29	X	22.9	1,227,000										0.6	0
30	X	0.0	0										0.6	0
			<b>12,156,000</b>											
			<b>405,200</b>											
			<b>1,269,000</b>											
				LOWEST RESIDUAL 0.4				days checked by operator: 30						
				DAYS IN MONTH 30										

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year of: **November 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²		
1	X	0.0	0										0.5	0
2	X	19.9	1,094,000										0.4	0
3	X	0.0	0										0.4	0
4	X	22.4	1,234,000										0.4	0
5	X	0.0	0										0.5	0
6	X	0.0	0										0.6	PBWN
7	X	24.8											0.5	0
8	X	0.0	0										0.6	0
9	X	19.9	1,082,000										0.5	0
10	X	0.0	0										0.5	0
11	X	21.6	1,183,000										0.5	0
12	X	0.0	0										0.6	0
13	X	0.0	0										0.6	PBWN
14	X	23.0	1,256,000										0.6	0
15	X	0.0	0										0.6	0
16	X	19.1	1,037,000										0.5	0
17	X	0.0	0										0.5	PBWN
18	X	22.1	1,209,000										0.5	0
19	X	0.0	0										0.5	0
20	X	0.0	0										0.5	0
21	X	22.3	1,218,000										0.5	0
22	X	0.0	0										0.6	0
23	X	20.4	1,110,000										0.5	0
24	X	0.0	0										0.6	0
25	X	23.8	1,291,000										0.5	0
26	X	0.0	0										0.6	0
27	X	0.0	0										0.5	0
28	X	23.7	1,286,000										0.6	0
29	X	0.0	0										0.6	0
30	X	19.5	1,055,000										0.6	0
			15,417,000	LOWEST RESIDUAL 0.4 DAYS IN MONTH 30					days checked by operator 30					
			513,900											
			1,362,000											

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier:

Number: **FL 1170527**

Plant Name: **Well # 8**

III. Daily Data for the Month Year of:

**November 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm	Minimum UV Dose Required, mW-sec/cm	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	23.8	915,000										0.5	0
2	X	0.0	0										0.4	0
3	X	26.9	854,000										0.4	0
4	X	0.0	0										0.4	0
5	X	22.7	873,000										0.5	0
6	X	0.0	0										0.6	PBWN
7	X	0.0	0										0.5	0
8	X	25.3											0.6	0
9	X	0.0	0										0.5	0
10	X	22.0	848,000										0.5	0
11	X	0.0	0										0.5	0
12	X	23.3	898,000										0.6	0
13	X	0.0	0										0.6	PBWN
14	X	0.0	0										0.6	0
15	X	23.6	909,000										0.6	0
16	X	0.0	0										0.5	0
17	X	22.5	870,000										0.5	PBWN
18	X	0.0	0										0.5	0
19	X	23.2	900,000										0.5	0
20	X	0.0	0										0.5	0
21	X	0.0	0										0.5	0
22	X	0.0	0										0.6	0
23	X	0.0	0										0.5	0
24	X	0.0	0										0.6	0
25	X	0.0	0										0.5	0
26	X	0.0	0										0.6	0
27	X	0.0	0										0.5	0
28	X	0.0	0										0.6	0
29	X	0.0	0										0.6	0
30	X	0.0	0										0.6	0

8,040,000

268,000

973,000

LOWEST RESIDUAL 0.4

DAYS IN MONTH 30

days checked by operator 30

PWS Identifica	umber: FL 1170527	Plant Name: Well # 9
----------------	-------------------	----------------------

**November 2007**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Chlorination									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²			
1	X	10.0	600,000										0.5	0	
2	X	21.0	1,274,000										0.4	0	
3	X	0.0	0										0.4	0	
4	X	24.2	1,500,000										0.4	0	
5	X	0.0	0										0.5	0	
6	X	20.5	1,221,000										0.6	PBWN	
7	X	0.0	0										0.5	0	
8	X	9.5	560,000										0.6	0	
9	X	20.4	1,237,000										0.5	0	
10	X	0.0	0										0.5	0	
11	X	23.1	1,404,000										0.5	0	
12	X	0.0	0										0.6	0	
13	X	22.0	1,323,000										0.6	PBWN	
14	X	0.0	0										0.6	0	
15	X	8.1	478,000										0.6	0	
16	X	20.0	1,195,000										0.5	0	
17	X	0.0	0										0.5	PBWN	
18	X	23.7	1,436,000										0.5	0	
19	X	0.0	0										0.5	0	
20	X	21.7	1,302,000										0.5	0	
21	X	0.0	0										0.5	0	
22	X	22.1	1,315,000										0.6	0	
23	X	20.9	1,249,000										0.5	0	
24	X	0.0	0										0.6	0	
25	X	23.2	1,416,000										0.5	0	
26	X	0.0	0										0.6	0	
27	X	21.2	1,262,000										0.5	0	
28	X	0.0	0										0.6	0	
29	X	21.5	1,290,000										0.6	0	
30	X	20.5	1,239,000										0.6	0	
			21,310,000												
			710,333	LOWEST RESIDUAL 0.4					days checked by operator 30						
			1,509,000	DAYS IN MONTH 30											



**MONTHLY OPEX REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS**
**DO NOT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished-Water Production for the Month Year of:

**November 2007**

 Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

 Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	1,440,000	1,440,000		1,440,000	NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	0	1,243,000	0	915,000	600,000						2,758,000
	0	0	1,094,000	0	1,274,000						2,368,000
	1,309,000	492,000	0	854,000	0						2,655,000
	0	0	1,234,000	0	1,509,000						2,743,000
	1,247,000	663,000	0	873,000	0						2,783,000
	1,225,000	0	0	0	1,221,000						2,446,000
	1,012,000	0	1,362,000	0	0						2,374,000
	0	1,269,000	0	973,000	560,000						2,802,000
	0	0	1,082,000	0	1,237,000						2,319,000
	1,263,000	627,000	0	848,000	0						2,738,000
	0	0	1,183,000	0	1,404,000						2,587,000
	1,282,000	701,000	0	898,000	0						
	1,234,000	0	0	0	1,323,000						2,557,000
	1,181,000	0	1,256,000	0	0						2,437,000
	0	1,253,000	0	909,000	478,000						2,640,000
	0	0	1,037,000	0	1,195,000						2,232,000
	1,270,000	563,000	0	870,000	0						2,703,000
	0	0	1,209,000	0	1,436,000						2,645,000
	1,267,000	657,000	0	900,000	0						2,824,000
	1,284,000	0	0	0	1,302,000						2,586,000
	974,000	0	1,218,000	0	0						2,192,000
	0	1,227,000	0	0	1,315,000						2,542,000
	0	0	1,110,000	0	1,249,000						2,359,000
	1,248,000	1,134,000	0	0	0						2,382,000
	0	0	1,291,000	0	1,416,000						2,707,000
	1,291,000	1,100,000	0	0	0						2,391,000
	1,148,000	0	0	0	1,262,000						2,410,000
	950,000	0	1,286,000	0	0						2,236,000
	0	1,227,000	0	0	1,290,000						2,517,000
	0	0	1,055,000	0	1,239,000						2,294,000
Total	19,185,000	12,156,000	15,417,000	8,040,000	21,310,000						76,108,000
Avg.	639,500	405,200	513,900	268,000	710,333						2,536,933
Max.	1,309,000	1,269,000	1,362,000	973,000	1,509,000						2,881,000

0.4

0.4

0.4

0.4

0.4

&lt;---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month Year of: **October 2007**

## A. Public Water System (PWS) Information

PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>		PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive
Number of Service Connections at End of Month:	<b>9,466</b>		Total Population Served at End of Month:	<b>33,131</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>			
Contact Person:	<b>Mark Cross</b>		Person's Title: <b>Manager</b>	
Contact Person's Mailing Address:	<b>905 Lowndes Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Contact Person's Telephone Number:	<b>(850) 455-8552</b>		Contact Person's Fax Number: <b>(850) 456-1010</b>	
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.Com</b>			

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>		Plant Telephone (850) 455-8552	
Plant Address:	<b>905 Lowndes Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant,	<b>4,860,000</b>			
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>		Plant Class (per subsection 62-699.310(4), F.A.C.):	<b>C</b>
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>
Other Operators:	<b>Mark Cross</b>	<b>7169</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>
	<b>Chester Horton</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Gary Leatherberry</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

 **Nov 8, 2007**  
Signature and Date

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number

PWS Identifier:	Number: <b>FL 1170527</b>	Plant Name: <b>Well # 3</b>	
-----------------	---------------------------	-----------------------------	--

October 2007

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>		
1	X	3.0	182,000									0.5	0
2	X	0.0	0									0.5	0
3	X	0.0	0									0.4	0
4	X	0.0	0									0.5	0
5	X	14.0	827,000									0.4	0
6	X	11.5	663,000									0.5	0
7	X	0.0	0									0.5	0
8	X	23.7	1,348,000									0.5	0
9	X	25.6	1,454,000									0.5	PBWN
10	X	23.7	1,349,000									0.5	0
11	X	23.9	1,377,000									0.5	0
12	X	21.5	1,230,000									0.6	0
13	X	25.1	1,436,000									0.6	0
14	X	0.0	0									0.4	0
15	X	15.4	842,000									0.6	0
16	X	23.2	1,285,000									0.5	0
17	X	24.9	1,392,000									0.5	0
18	X	0.0	0									0.6	0
19	X	0.0	0									0.5	0
20	X	0.0	0									0.5	0
21	X	28.1										0.5	0
22	X	24.4	1,366,000									0.4	0
23	X	23.8	1,327,000									0.6	0
24	X	23.9	1,347,000									0.5	0
25	X	24.2	1,371,000									0.6	0
26	X	24.0	1,334,000									0.4	0
27	X	24.1	1,344,000									0.6	PBWN
28	X	24.7	1,385,000									0.5	0
29	X	6.3	359,000									0.5	0
30	X	22.6	1,252,000									0.4	0
31	X	20.6	1,146,000									0.4	0
			27,204,000										
			877,548	LOWEST RESIDUAL 0.4							days checked by operator 31		
			1,588,000	DAYS IN MONTH 31									

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification

Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data for the Month Year of:

**October 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/l	Temp. of Water, °C if Applicable	pH of Water	Minimum CT, mg-min/l	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	28.1											0.5	0
2	X	21.9	1,163,000										0.5	0
3	X	0.0	0										0.4	0
4	X	23.6	1,242,000										0.5	0
5	X	0.0	0										0.4	0
6	X	21.2	1,130,000										0.5	0
7	X	4.1	218,000										0.5	0
8	X	4.6	252,000										0.5	0
9	X	19.8	1,036,000										0.5	PBWN
10	X	24.0	1,251,000										0.5	0
11	X	21.0	1,117,000										0.5	0
12	X	0.0	0										0.6	0
13	X	20.8	1,121,000										0.6	0
14	X	23.5	1,242,000										0.4	0
15	X	23.7	1,238,000										0.6	0
16	X	0.0	0										0.5	0
17	X	0.0	0										0.5	0
18	X	19.9	1,066,000										0.6	0
19	X	0.0	0										0.5	0
20	X	23.3	1,297,000										0.5	0
21	X	8.2	474,000										0.5	0
22	X	0.0	0										0.4	0
23	X	0.0	0										0.6	0
24	X	0.0	0										0.5	0
25	X	22.3	1,225,000										0.6	0
26	X	0.0	0										0.4	0
27	X	17.7	965,000										0.6	PBWN
28	X	5.8	310,000										0.5	0
29	X	18.9	1,028,000										0.5	0
30	X	0.0	0										0.4	0
31	X	0.0	0										0.4	0

**18,880,000**

**609,032**

**1,505,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator: 31

Plant Name: **Well # 5**

October 2007

☒ Free Chlorine    ☐ Chlorine Dioxide    ☐ Ozone    ☐ Combined Chlorine (Chloramines)    ☐ Ultraviolet Radiation    ☐ Other: \_\_\_\_\_

☒ Free Chlorine      ☐ Combined Chlorine (Chloramines)      ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>		
1	X	9.4	517,000									0.5	0
2	X	9.8	549,000									0.5	0
3	X	19.2	1,054,000									0.4	0
4	X	0.0	0									0.5	0
5	X	10.2	582,000									0.4	0
6	X	0.0	0									0.5	0
7	X	21.8	1,191,000									0.5	0
8	X	0.0	0									0.5	0
9	X	5.4	303,000									0.5	PBWN
10	X	9.7	533,000									0.5	0
11	X	0.0	0									0.5	0
12	X	0.0	0									0.6	0
13	X	0.0	0									0.6	0
14	X	15.8	877,000									0.4	0
15	X	0.0	0									0.6	0
16	X	0.0	0									0.5	0
17	X	11.0	604,000									0.5	0
18	X	0.0	0									0.6	0
19	X	11.8	861,000									0.5	0
20	X	0.0	0									0.5	0
21	X	0.0	0									0.5	0
22	X	0.0	0									0.4	0
23	X	0.0	0									0.6	0
24	X	0.0	0									0.5	0
25	X	0.0	0									0.6	0
26	X	4.5	247,000									0.4	0
27	X	0.0	0									0.6	PBWN
28	X	19.3	1,171,000									0.5	0
29	X	0.0	0									0.5	0
30	X	6.0	246,000									0.4	0
31	X	21.6										0.4	0
			9,709,000										
			313,194	LOWEST RESIDUAL 0.4						days checked by operator 31			
			1,194,000	DAYS IN MONTH 31									



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification

Number: **FL 1170527**

Plant Name: **Well # 8**

III. Daily Data for the Month Year of:

**October 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	20.2	727,000										0.5	0
2	X	0.0	0										0.5	0
3	X	0.0	0										0.4	0
4	X	22.2											0.5	0
5	X	0.0	0										0.4	0
6	X	0.0	0										0.5	0
7	X	0.0	0										0.5	0
8	X	21.0	802,000										0.5	0
9	X	0.0	0										0.5	PBWN
10	X	0.0	0										0.5	0
11	X	12.5	475,000										0.5	0
12	X	0.0	0										0.6	0
13	X	0.0	0										0.6	0
14	X	0.0	0										0.4	0
15	X	21.4	815,000										0.6	0
16	X	0.0	0										0.5	0
17	X	19.3	717,000										0.5	0
18	X	21.2	809,000										0.6	0
19	X	0.0	0										0.5	0
20	X	0.0	0										0.5	0
21	X	0.0	0										0.5	0
22	X	0.0	0										0.4	0
23	X	13.1	498,000										0.6	0
24	X	0.0	0										0.5	0
25	X	6.8	262,000										0.6	0
26	X	0.0	0										0.4	0
27	X	0.0	0										0.6	PBWN
28	X	0.0	0										0.5	0
29	X	22.1	851,000										0.5	0
30	X	0.3	0										0.4	0
31	X	0.0	0										0.4	0

TOTAL	6,808,000
LOWEST RESIDUAL	219,613
DAYS IN MONTH	852,000

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 31

days checked by operator 31

Plant Name: **Well # 9**

October 2007

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Type of Disinfectant Residual Maintained in				[X] Free Chlorine [ ] Combined Chlorine (Chloramines) [ ] Other									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm	Minimum UV Dose Required, mW-sec/cm		
1	X	0.0	0										0.5	0
2	X	22.3	1,377,000										0.5	0
3	X	24.0	1,443,000										0.4	0
4	X	14.2	860,000										0.5	0
5	X	19.8	1,154,000										0.4	0
6	X	15.5	897,000										0.5	0
7	X	22.5	1,354,000										0.5	0
8	X	0.0	0										0.5	0
9	X	15.9	1,034,000										0.5	PBWN
10	X	0.0	0										0.5	0
11	X	0.0	0										0.5	0
12	X	19.8	1,037,000										0.6	0
13	X	10.3	586,000										0.6	0
14	X	20.3	1,172,000										0.4	0
15	X	0.0	0										0.6	0
16	X	17.3	984,000										0.5	0
17	X	0.0	0										0.5	0
18	X	6.5	382,000										0.6	0
19	X	23.2	1,397,000										0.5	0
20	X	17.3	1,101,000										0.5	0
21	X	18.6	1,130,000										0.5	0
22	X	14.1	858,000										0.4	0
23	X	16.8	1,022,000										0.6	0
24	X	15.8	964,000										0.5	0
25	X	0.0	0										0.6	0
26	X	19.1	1,107,000										0.4	0
27	X	0.0	0										0.6	PBWN
28	X	5.4	289,000										0.5	0
29	X	0.0	0										0.5	0
30	X	19.2	1,145,000										0.4	0
31	X	0.0	0										0.4	0
			21,360,000											
			689,032	LOWEST RESIDUAL 0.4				days checked by operator 31						
			1,464,000	DAYS IN MONTH 31										

**MONTHLY OPERATIONAL REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS**
**PLANTS THAT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished-Water Production for the Month Year of:

**October 2007**

 Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

 Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
						NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	182,000	1,505,000	517,000	727,000	0						2,931,000
	0	1,163,000	549,000	0	1,377,000						3,089,000
	0	0	1,054,000	0	1,443,000						2,497,000
	0	1,242,000	0	852,000	880,000						2,954,000
	827,000	0	562,000	0	1,154,000						2,543,000
	663,000	1,130,000	0	0	897,000						2,690,000
	0	218,000	1,191,000	0	1,354,000						2,763,000
	1,348,000	252,000	0	802,000	0						2,402,000
	1,454,000	1,036,000	303,000	0	1,034,000						
	1,348,000	1,261,000	533,000	0	0						3,133,000
	1,377,000	1,117,000	0	475,000	0						2,969,000
	1,230,000	0	0	0	1,037,000						2,267,000
	1,436,000	1,121,000	0	0	586,000						3,143,000
	0	1,242,000	877,000	0	1,172,000						3,291,000
	842,000	1,238,000	0	815,000	0						2,895,000
	1,285,000	0	0	0	984,000						2,268,000
	1,382,000	0	604,000	717,000	0						2,713,000
	0	1,066,000	0	809,000	382,000						2,257,000
	0	0	661,000	0	1,464,000						2,125,000
	0	1,297,000	0	0	1,101,000						2,398,000
	1,588,000	474,000	0	0	1,130,000						3,192,000
	1,366,000	0	0	0	858,000						2,224,000
	1,327,000	0	0	498,000	1,022,000						2,847,000
	1,347,000	0	0	0	964,000						2,311,000
	1,371,000	1,225,000	0	262,000	0						2,858,000
	1,334,000	0	247,000	0	1,107,000						2,688,000
	1,344,000	965,000	0	0	0						2,309,000
	1,385,000	310,000	1,171,000	0	289,000						3,155,000
	359,000	1,028,000	0	851,000	0						2,238,000
	1,252,000	0	246,000	0	1,145,000						2,643,000
	1,146,000	0	1,194,000	0	0						2,340,000
Total	27,204,000	18,880,000	9,709,000	6,808,000	21,360,000						83,961,000
Avg.	877,548	609,032	313,194	219,613	689,032						2,708,419
Max.	1,588,000	1,505,000	1,194,000	852,000	1,464,000						3,827,000

0.4

0.4

0.4

0.4

0.4

&lt;---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **September 2007**

## A. Public Water System (PWS) Information

PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>			PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	<b>9,406</b>			Total Population Served at End of Month:	<b>32,921</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person:	<b>Mark Cross</b>			Person's Title: <b>Manager</b>	
Contact Person's Mailing Address:	<b>905 Lowndes Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>	
Contact Person's Telephone Number:	<b>(850) 455-8552</b>			Contact Person's Fax Number: <b>(850) 456-1010</b>	
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.com</b>				

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>			Plant Telephone (850) 455-8552	
Plant Address:	<b>905 Lowndes Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>	
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water			<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant:	<b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>			Plant Class (per subsection 62-699.310(4), F.A.C.): <b>C</b>	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
Other Operators:	<b>Mark Cross</b>	<b>7169</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
	<b>Chester Horton</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Gary Leatherberry</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

*Theo Deleon* 10/8/07  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identificat

Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month Year of:

**September 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, min-mg/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	22.4	1,316,000									0.6	0	
2	X	0.0	0									0.5	0	
3	X	23.2	1,385,000									0.4	0	
4	X	23.3	1,407,000									0.5	0	
5	X	22.7	996,000									0.5	0	
6	X	11.1	1,075,000									0.5	0	
7	X	0.0	0									0.6	0	
8	X	23.5	1,454,000									0.5	0	
9	X	0.0	0									0.5	0	
10	X	0.0	0									0.5	0	
11	X	23.2	1,388,000									0.5	0	
12	X	17.3	1,126,000									0.5	0	
13	X	0.0	0									0.6	0	
14	X	0.0	0									0.4	0	
15	X	27.9	1,500,000									0.6	0	
16	X	0.0	0									0.5	0	
17	X	24.3	1,539,000									0.4	0	
18	X	21.1	1,300,000									0.6	0	
19	X	21.9	1,381,000									0.6	0	
20	X	24.0	1,492,000									0.5	0	
21	X	0.0	0									0.5	0	
22	X	23.5	1,471,000									0.6	0	
23	X	0.0	0									0.4	0	
24	X	19.0	1,171,000									0.5	0	
25	X	23.3	1,419,000									0.5	PBWN	
26	X	20.0	1,226,000									0.5	0	
27	X	0.0	0									0.6	0	
28	X	22.7	1,406,000									0.5	0	
29	X	21.8	1,367,000									0.4	0	
30	X	24.0	1,491,000									0.4	PBWN	
			27,165,000											
			905,500											
			1,755,000											
				LOWEST RESIDUAL		0.4	days checked by operator 30							
				DAYS IN MONTH		30								

LOWEST RESIDUAL 0.4

days checked by operator 30

DAYS IN MONTH 30



Plant Name: **Well # 4**

September 2007

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 30

days checked by operator: 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year of: **September 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0											0.6	0
2	X	21.6	1,313,000										0.5	0
3	X	0.0											0.4	0
4	X	0.7											0.5	0
5	X	22.4	1,308,000										0.5	0
6	X	0.0											0.5	0
7	X	18.4	1,037,000										0.6	0
8	X	18.8	1,061,000										0.5	0
9	X	13.9	781,000										0.5	0
10	X	0.0											0.5	0
11	X	3.7	204,000										0.5	0
12	X	20.0	1,132,000										0.5	0
13	X	0.0											0.6	0
14	X	20.1	1,119,000										0.4	0
15	X	0.0											0.6	0
16	X	20.9	1,165,000										0.5	0
17	X	0.0											0.4	0
18	X	0.0											0.6	0
19	X	20.7	1,154,000										0.6	0
20	X	0.0											0.5	0
21	X	23.3	1,289,000										0.5	0
22	X	0.0											0.6	0
23	X	17.6	977,000										0.4	0
24	X	5.9	326,000										0.5	0
25	X	0.0											0.5	PBWN
26	X	22.9	1,261,000										0.5	0
27	X	0.0											0.6	0
28	X	0.0											0.5	0
29	X	0.0											0.4	0
30	X	6.3	357,000										0.4	PBWN

Total	14,484,000
Average	482,800
Minimum	

LOWEST RESIDUAL 0.4

days checked by operator 30

DAYS IN MONTH 30

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 8**

September 2007

Means of Achieving Four-Log Virus	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Chlorine Dioxide	<input type="checkbox"/> Ozone	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Ultraviolet Radiation	<input type="checkbox"/> Other:
-----------------------------------	---	---	--------------------------------	--	--	---------------------------------

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Daily									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²		
1	X	24.1	920,000									0.6	0	
2	X	0.0	0									0.5	0	
3	X	23.3	891,000									0.4	0	
4	X	0.0	0									0.5	0	
5	X	0.0	0									0.5	0	
6	X	26.7	930,000									0.5	0	
7	X	0.0	0									0.6	0	
8	X	0.0	0									0.5	0	
9	X	0.0	0									0.5	0	
10	X	22.3	810,000									0.5	0	
11	X	0.0	0									0.5	0	
12	X	0.0	0									0.5	0	
13	X	24.0	914,000									0.6	0	
14	X	0.0	0									0.4	0	
15	X	0.0	0									0.6	0	
16	X	0.0	0									0.5	0	
17	X	24.9	945,000									0.4	0	
18	X	0.0	0									0.6	0	
19	X	7.5	281,000									0.6	0	
20	X	0.0	0									0.5	0	
21	X	0.0	0									0.5	0	
22	X	0.0	0									0.6	0	
23	X	0.0	0									0.4	0	
24	X	16.6	624,000									0.5	0	
25	X	0.0	0									0.5	PBWN	
26	X	0.0	0									0.5	0	
27	X	10.2	386,000									0.6	0	
28	X	0.0	0									0.5	0	
29	X	8.0	324,000									0.4	0	
30	X	0.0	0									0.4	PBWN	
			7,102,000											
			236,733											
			1,007,000											
				LOWEST RESIDUAL 0.4		days checked by operator 30								
				DAYS IN MONTH 30										

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 9**

III. Daily Data for the Month Year of:

**September 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection								Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	
1	X	0.0	0									0.6	0
2	X	19.7	1,192,000									0.5	0
3	X	0.0	0									0.4	0
4	X	21.5	1,261,000									0.5	0
5	X	0.0	0									0.5	0
6	X	0.0	0									0.5	0
7	X	21.5	1,309,000									0.6	0
8	X	0.0	0									0.5	0
9	X	23.7	1,390,000									0.5	0
10	X	20.1	1,211,000									0.5	0
11	X	19.1	1,155,000									0.5	0
12	X	0.0	0									0.5	0
13	X	8.6	488,000									0.6	0
14	X	17.5	1,035,000									0.4	0
15	X	0.0	0									0.6	0
16	X	23.7	1,332,000									0.5	0
17	X	0.0	0									0.4	0
18	X	22.7	1,343,000									0.6	0
19	X	0.0	0									0.6	0
20	X	0.0	0									0.5	0
21	X	20.8	1,194,000									0.5	0
22	X	0.0	0									0.6	0
23	X	23.2	1,360,000									0.4	0
24	X	0.0	0									0.5	0
25	X	19.9	1,172,000									0.5	PBWN
26	X	0.0	0									0.5	0
27	X	22.6	1,374,000									0.6	0
28	X	18.1	1,110,000									0.5	0
29	X	0.0	0									0.4	0
30	X	21.2	1,305,000									0.4	PBWN
			<b>19,311,000</b>										
			<b>643,700</b>										
			<b>1,412,000</b>										

LOWEST RESIDUAL 0.4

days checked by operator 30

DAYS IN MONTH 30

**MONTHLY OPER** **REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS:** **I HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished-Water Production for the Month Year of: **September 2007**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	NA										6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	1,318,000	747,000	0	920,000	0						2,983,000
	0	0	1,313,000	0	1,192,000						2,505,000
	1,385,000	858,000	0	891,000	0						3,134,000
	1,407,000	0	0	0	1,281,000						2,668,000
	998,000	0	1,308,000	0	0						2,304,000
	1,075,000	1,140,000	0	1,007,000	0						3,222,000
	0	0	1,037,000	0	1,309,000						2,346,000
	1,454,000	324,000	1,061,000	0	0						2,839,000
	0	1,274,000	781,000	0	1,390,000						2,651,000
	0	630,000	0	810,000	1,211,000						2,747,000
	1,388,000	0	204,000	0	1,155,000						2,258,000
	1,126,000	0	1,132,000	0	0						2,258,000
	0	1,266,000	0	914,000	488,000						2,668,000
	0	0	1,119,000	0	1,035,000						2,154,000
	1,755,000	1,109,000	0	0	0						2,864,000
	0	528,000	1,165,000	0	1,412,000						3,103,000
	1,539,000	671,000	0	945,000	0						3,155,000
	1,300,000	0	0	0	1,343,000						2,643,000
	1,381,000	0	1,154,000	281,000	0						2,816,000
	1,492,000	1,162,000	0	0	0						2,654,000
	0	0	1,289,000	0	1,194,000						2,483,000
	1,471,000	866,000	0	0	0						2,337,000
	0	519,000	977,000	0	1,360,000						2,856,000
	1,171,000	596,000	326,000	624,000	0						2,717,000
	1,419,000	0	0	0	1,172,000						2,591,000
	1,226,000	0	1,261,000	0	0						2,487,000
	0	1,258,000	0	386,000	1,374,000						3,018,000
	1,406,000	0	0	0	1,110,000						2,516,000
	1,367,000	891,000	0	324,000	0						2,582,000
	1,491,000	0	357,000	0	1,305,000						3,153,000
Total	27,165,000	13,837,000	14,484,000	7,102,000	19,311,000						81,899,000
Avg.	905,500	461,233	482,800	236,733	643,700						2,729,967
Max.	1,755,000	1,274,000	1,313,000	1,007,000	1,412,000						3,445,000

0.4

0.4

0.4

0.4

0.4

<---lowest CI






# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

<b>I. General Information for the Month/Year of:</b> <b>August 2007</b>				
<b>A. Public Water System (PWS) Information</b>				
PWS Name: <b>Peoples Water Service Company of Florida, Inc.</b>		PWS Identification Number: <b>FL 1170527</b>		
PWS Type: <input checked="" type="checkbox"/> Community <input type="checkbox"/> Non-Transient		<input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive		
Number of Service Connections at End of Month: <b>9,191</b>		Total Population Served at End of Month: <b>32,169</b>		
PWS Owner: <b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person: <b>Mark Cross</b>		Person's Title: <b>Manager</b>		
Contact Person's Mailing Address: <b>905 Lownd Avenue</b>		City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Contact Person's Telephone Number: <b>(850) 455-8552</b>		Contact Person's Fax Number: <b>(850) 456-1010</b>		
Contact Person's E-Mail Address: <b>MarkCross@PeoplesWaterService.Com</b>				
<b>B. Water Treatment Plant Information</b>				
Plant Name: <b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>		Plant Telephone: <b>(850) 455-8552</b>		
Plant Address: <b>905 Lownd Avenue</b>		City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Type of Water Treated by Plant: <input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water		
Permitted Maximum Day Operating Capacity of Plant: <b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.): <b>V</b>		Plant Class (per subsection 62-699.310(4), F.A.C.): <b>C</b>		
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
Other Operators:	Mark Cross	7169	A	Mon - Fri 8 :00am - 5:00 pm
	Jim Ogle	4927	C	Mon - Fri 8 :00am - 5:00 pm
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
	Chester Horton	NA	NA	Mon - Fri 8 :00am - 5:00 pm
	Gary Leatherberry	NA	NA	Mon - Fri 8 :00am - 5:00 pm

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

  
Signature and Date **9/7/07**

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number

# MONTHLY OPERATION REPORT FOR PWSSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identical Number: **FL 1170527** Plant Name: **Well # 3**

III. Daily Data for the Month/year of: **August 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal											Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpm	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²			
1	X	21.0	1,309,000										0.6	0	
2	X	0.0	0										0.6	0	
3	X	0.0	0										0.4	0	
4	X	23.8	1,484,000										0.5	0	
5	X	0.0	0										0.5	0	
6	X	22.8	1,427,000										0.5	0	
7	X	23.7	1,471,000										0.5	0	
8	X	21.9	1,357,000										0.4	0	
9	X	0.0	0										0.5	PBWN	
10	X	0.0	0										0.5	0	
11	X	13.3	817,000										0.5	0	
12	X	0.0	0										0.4	0	
13	X	23.5	1,448,000										0.5	0	
14	X	23.4	1,429,000										0.6	PBWN	
15	X	22.5	1,378,000										0.5	2 - PBWN	
16	X	21.4	1,317,000										0.5	0	
17	X	22.8	1,403,000										0.5	0	
18	X	25.0	1,415,000										0.5	0	
19	X	25.1	1,520,000										0.6	0	
20	X	22.9	1,390,000										0.5	0	
21	X	22.0	1,312,000										0.4	0	
22	X	23.8	1,423,000										0.5	0	
23	X	20.5	1,222,000										0.4	PBWN	
24	X	24.6	1,462,000										0.7	0	
25	X	24.3	1,444,000										0.4	0	
26	X	24.4	1,441,000										0.4	0	
27	X	23.2	1,355,000										0.5	0	
28	X	24.9	1,468,000										0.5	0	
29	X	23.1	1,356,000										0.6	0	
30	X	23.5	1,369,000										0.6	0	
31	X	0.0	0										0.6	0	
			33,138,000											days checked by operator 31	
			1,068,968												
			1,536,000												
				LOWEST RESIDUAL 0.4											
				DAYS IN MONTH 31											

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data for the Month/Year of: **August 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, mgd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water	Minimum CT Required	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	23.8	1,283,000										0.6	0
3	X	0.0	0										0.4	0
4	X	13.2	711,000										0.5	0
5	X	0.0	0										0.5	0
6	X	6.0	324,000										0.5	0
7	X	0.0	0										0.5	0
8	X	0.0	0										0.4	0
9	X	25.7											0.5	PBWN
10	X	0.0	0										0.5	0
11	X	18.3	997,000										0.5	0
12	X	7.3	407,000										0.4	0
13	X	11.9	647,000										0.5	0
14	X	0.0	0										0.6	PBWN
15	X	0.0	0										0.5	2 - PBWN
16	X	24.0	1,310,000										0.5	0
17	X	9.4	508,000										0.5	0
18	X	17.2	958,000										0.5	0
19	X	17.9	962,000										0.6	0
20	X	15.7	850,000										0.5	0
21	X	0.0	0										0.4	0
22	X	10.2	536,000										0.5	0
23	X	18.9	1,024,000										0.4	PBWN
24	X	20.9	1,086,000										0.7	0
25	X	18.7	986,000										0.4	0
26	X	14.8	795,000										0.4	0
27	X	5.4	296,000										0.5	0
28	X	0.0	0										0.5	0
29	X	0.0	0										0.6	0
30	X	21.9	1,176,000										0.6	0
31	X	0.0	0										0.6	0
			16,252,000											
			524,258											
			1,396,000											
				LOWEST RESIDUAL 0.4					days checked by operator: 31					
				DAYS IN MONTH 31										

PWS Identificat	Number: <b>FL 1170527</b>	Plant Name: <b>Well # 5</b>
-----------------	---------------------------	-----------------------------

Plant Name: **Well # 5**

**August 2007**

Means of Achieving Four-Log Virus	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Chlorine Dioxide	<input type="checkbox"/> Ozone	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Ultraviolet Radiation	<input type="checkbox"/> Other:
-----------------------------------	---	---	--------------------------------	--	--	---------------------------------

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate and	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg- min/L	Temp. of Water, °C	pH of Water, mg/L	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-seconds	Minimum UV Dose Required, mW-seconds		
1	X	21.5	1,255,000										0.6	0
2	X	0.0	0										0.6	0
3	X	21.2	1,228,000										0.4	0
4	X	0.0	0										0.5	0
5	X	22.4	1,300,000										0.5	0
6	X	10.0	581,000										0.5	0
7	X	12.1	696,000										0.5	0
8	X	21.3	1,221,000										0.4	0
9	X	0.0	0										0.5	PBWN
10	X	24.1											0.5	0
11	X	7.6	440,000										0.5	0
12	X	22.6	1,295,000										0.4	0
13	X	0.0	0										0.5	0
14	X	9.4	541,000										0.6	PBWN
15	X	22.2	1,268,000										0.5	2 - PBWN
16	X	0.0	0										0.5	0
17	X	22.0	1,262,000										0.5	0
18	X	9.6	548,000										0.5	0
19	X	10.4	604,000										0.6	0
20	X	0.0	0										0.5	0
21	X	13.4	771,000										0.4	0
22	X	7.1	428,000										0.5	0
23	X	0.0	0										0.4	PBWN
24	X	16.0	994,000										0.7	0
25	X	13.6	830,000										0.4	0
26	X	16.4	1,006,000										0.4	0
27	X	0.0	0										0.5	0
28	X	19.7	1,200,000										0.5	0
29	X	19.2	1,177,000										0.6	0
30	X	0.0	0										0.6	0
31	X	19.1	1,162,000										0.6	0
			21,189,000											
			683,516	LOWEST RESIDUAL 0.4					days checked by operator 31					
			1,382,000	DAYS IN MONTH 31										

## PWS Identification Number: FL 1170527

Plant Name: **Well # 8****August 2007**☐ Free Chlorine    ☐ Chlorine Dioxide    ☐ Ozone    ☐ Combined Chlorine (Chloramines)    ☐ Ultraviolet Radiation    ☐ Other: \_\_\_\_\_

<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>		
1	X	0.0	0									0.6	0
2	X	24.6	933,000									0.6	0
3	X	0.0	0									0.4	0
4	X	22.0	838,000									0.5	0
5	X	0.0	0									0.5	0
6	X	21.7	783,000									0.5	0
7	X	0.0	0									0.5	0
8	X	9.0	340,000									0.4	0
9	X	21.6	822,000									0.5	PBWN
10	X	0.0	0									0.5	0
11	X	23.1	878,000									0.5	0
12	X	0.0	0									0.4	0
13	X	25.0	960,000									0.5	0
14	X	0.0	0									0.6	PBWN
15	X	10.8	413,000									0.5	2 - PBWN
16	X	16.9	646,000									0.5	0
17	X	0.0	0									0.5	0
18	X	11.5	438,000									0.5	0
19	X	0.0	0									0.6	0
20	X	26.1	992,000									0.5	0
21	X	0.0	0									0.4	0
22	X	0.0	0									0.5	0
23	X	9.2	349,000									0.4	PBWN
24	X	0.0	0									0.7	0
25	X	0.0	0									0.4	0
26	X	0.0	0									0.4	0
27	X	15.6	587,000									0.5	0
28	X	0.0	0									0.5	0
29	X	0.0	0									0.6	0
30	X	16.9	637,000									0.6	0
31	X	0.0	0									0.6	0
			9,616,000										
			310,194	LOWEST RESIDUAL 0.4				days checked by operator 31					
			992,000	DAYS IN MONTH 31									



Plant Name: **Well # 9****August 2007**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

days checked by operator 31

**MONTHLY OPEX REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS**
**DO NOT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished Water Production for the Month Year of:

**August 2007**

 Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

 Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
											6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	1,309,000	0	1,255,000	0	0						2,564,000
	0	1,283,000	0	933,000	695,000						2,911,000
	0	0	1,228,000	0	1,316,000						2,544,000
	1,484,000	711,000	0	838,000	0						3,033,000
	0	0	1,300,000	0	1,365,000						2,665,000
	1,427,000	324,000	581,000	783,000	0						3,115,000
	1,471,000	0	696,000	0	686,000						2,853,000
	1,357,000	0	1,221,000	340,000	0						2,918,000
	0	1,396,000	0	822,000	655,000						2,873,000
	0	0	1,382,000	0	1,333,000						2,715,000
	817,000	997,000	440,000	878,000	0						3,132,000
	0	467,000	1,295,000	0	1,251,000						2,953,000
	1,448,000	647,000	0	960,000	0						3,055,000
	1,429,000	0	541,000	0	1,357,000						3,327,000
	1,378,000	0	1,268,000	413,000	0						3,059,000
	1,317,000	1,310,000	0	646,000	0						3,273,000
	1,403,000	508,000	1,262,000	0	0						3,173,000
	1,536,000	958,000	548,000	438,000	0						3,480,000
	1,520,000	962,000	604,000	0	480,000						3,566,000
	1,390,000	850,000	0	992,000	470,000						3,702,000
	1,312,000	0	771,000	0	1,263,000						3,346,000
	1,423,000	536,000	428,000	0	1,051,000						3,438,000
	1,222,000	1,024,000	0	349,000	902,000						3,497,000
	1,462,000	1,086,000	994,000	0	0						3,542,000
	1,444,000	986,000	830,000	0	318,000						3,578,000
	1,441,000	795,000	1,006,000	0	246,000						3,488,000
	1,355,000	296,000	0	587,000	1,038,000						3,276,000
	1,468,000	0	1,200,000	0	0						2,668,000
	1,356,000	0	1,177,000	0	0						2,533,000
	1,369,000	1,176,000	0	637,000	0						3,182,000
	0	0	1,162,000	0	1,481,000						2,643,000
Total	33,138,000	16,252,000	21,189,000	9,616,000	15,907,000						96,102,000
Avg.	1,068,968	524,258	683,516	310,194	513,129						3,100,065
Max.	1,536,000	1,396,000	1,382,000	992,000	1,481,000						3,702,000

0.4 0.4 0.4 0.4 0.4

&lt;---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **July 2007**

## A. Public Water System (PWS) Information

PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,607			Total Population Served at End of Month:	33,275
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross			Person's Title:	Manager
Contact Person's Mailing Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Contact Person's Telephone Number:	(850) 455-8552	Contact Person's Fax Number:	(850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com				

## B. Water Treatment Plant Information

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9			Plant Telephone	(850) 455-8552
Plant Address:	905 Lowndes Avenue	City:	Pensacola	State:	Florida
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water	<input type="checkbox"/> Purchased Finished Water			
Permitted Maximum Day Operating Capacity of Plant:	4,880,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8:00am - 5:00 pm/weekend visit	
Other Operators:	Mark Cross	7169	A	Mon - Fri 8:00am - 5:00 pm	
	Jim Ogle	4927	C	Mon - Fri 8:00am - 5:00 pm	
	Dan Middlebrook	8445	C	Mon - Fri 8:00am - 5:00 pm	
	Russ Barrett	12704	B	Mon - Fri 8:00am - 5:00 pm/weekend visit	
	Chester Horton	NA	NA	Mon - Fri 8:00am - 5:00 pm	
	Gary Leatherberry	NA	NA	Mon - Fri 8:00am - 5:00 pm	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 52-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

**PWS Identifier**

Plant Name: **Well # 3**

**July 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

[illegible]



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: **FL 1170527**

Plant Name: **Well #4**

III. Daily Data for the Month Year of:

**July 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	24.8	1,307,000										0.6	0
2	X	10.8	598,000										0.6	0
3	X	9.9	542,000										0.5	0
4	X	0.0	0										0.5	0
5	X	22.0	1,209,000										0.5	0
6	X	0.0	0										0.5	PBWN
7	X	8.7	465,000										0.5	0
8	X	15.9	874,000										0.5	PBWN
9	X	11.2	608,000										0.5	0
10	X	0.0	0										0.5	0
11	X	0.0	0										0.4	0
12	X	22.3	1,219,000										0.5	0
13	X	0.0	0										0.5	0
14	X	7.5	418,000										0.5	0
15	X	0.0	0										0.5	0
16	X	6.7	373,000										0.5	0
17	X	0.0	0										0.6	PBWN
18	X	0.0	0										0.5	0
19	X	23.9	1,303,000										0.6	0
20	X	0.0	0										0.5	0
21	X	12.3	659,000										0.5	0
22	X	20.5	1,142,000										0.6	0
23	X	0.0	0										0.6	0
24	X	0.0	0										0.4	0
25	X	7.0	364,000										0.5	0
26	X	22.8	1,249,000										0.5	0
27	X	0.0	0										0.4	0
28	X	14.6	794,000										0.5	0
29	X	13.9	759,000										0.4	0
30	X	8.2	441,000										0.5	0
31	X	0.0	0										0.5	PBWN

**14,324,000**

**462,066**

**1,307,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator: 31



**PWS Identifier**

Number: **FL 1170527**

Plant Name: Well # 5

**July 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

[illegible]

**PWS Identific**

Number: **FL 1170527**

Plant Name: **Well # 8**

**July 2007**

Means of Achieving Four-Log Virus	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Chlorine Dioxide	<input type="checkbox"/> Ozone	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Ultraviolet Radiation	<input type="checkbox"/> Other:
-----------------------------------	---	---	--------------------------------	--	--	---------------------------------

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (mg/L) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	25.3	978,000										0.6	0
3	X	0.0	0										0.5	0
4	X	14.4	548,000										0.5	0
5	X	0.0	0										0.5	0
6	X	9.2	315,000										0.5	PBWN
7	X	22.2	861,000										0.5	0
8	X	0.0	0										0.5	PBWN
9	X	26.3	1,014,000										0.5	0
10	X	0.0	0										0.5	0
11	X	0.0	0										0.4	0
12	X	18.0	677,000										0.5	0
13	X	0.0	0										0.5	0
14	X	0.0	0										0.5	0
15	X	0.0	0										0.5	0
16	X	23.2	897,000										0.5	0
17	X	0.0	0										0.6	PBWN
18	X	0.0	0										0.5	0
19	X	27.4	1,050,000										0.6	0
20	X	0.0	0										0.5	0
21	X	22.4	850,000										0.6	0
22	X	0.0	0										0.6	0
23	X	23.3	882,000										0.6	0
24	X	0.0	0										0.4	0
25	X	6.0	213,000										0.5	0
26	X	20.4	799,000										0.5	0
27	X	0.0	0										0.4	0
28	X	22.1	856,000										0.5	0
29	X	0.0	0										0.4	0
30	X	23.4	889,000										0.5	0
31	X	0.0	0										0.5	PBWN
			10,819,000											
			349,000											
			1,040,000											
Total				LOWEST RESIDUAL	0.4	days checked by operator 31								
				DAYS IN MONTH	31									

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier:

Number: **FL 1170527**

Plant Name: **Well # 9**

III. Daily Data for the Month Year of:

**July 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	18.0	1,038,000										0.6	0
2	X	0.0	0										0.6	0
3	X	8.3	536,000										0.5	0
4	X	18.0	1,064,000										0.5	0
5	X	16.5	981,000										0.5	0
6	X	20.4	1,215,000										0.5	PBWN
7	X	0.0	0										0.5	0
8	X	17.6	1,030,000										0.5	PBWN
9	X	0.0	0										0.5	0
10	X	9.2	514,000										0.5	0
11	X	0.0	0										0.4	0
12	X	24.2	1,464,000										0.5	0
13	X	24.7											0.5	0
14	X	23.5	1,420,000										0.5	0
15	X	22.5	1,341,000										0.5	0
16	X	0.0	0										0.5	0
17	X	21.0	1,260,000										0.6	PBWN
18	X	0.0	0										0.5	0
19	X	15.0	903,000										0.6	0
20	X	22.1	1,315,000										0.5	0
21	X	0.0	0										0.5	0
22	X	14.4	847,000										0.6	0
23	X	0.0	0										0.6	0
24	X	18.8	1,115,000										0.4	0
25	X	0.0	0										0.5	0
26	X	9.1	540,000										0.5	0
27	X	18.8	1,128,000										0.4	0
28	X	0.0	0										0.5	0
29	X	22.7	1,351,000										0.4	0
30	X	0.0	0										0.5	0
31	X	20.9	1,241,000										0.5	PBWN

Total	21,820,000
Peak Flow	703,871
Net Quantity	1,517,000

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator 31

# MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month Year of **July 2007**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	NA										6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
1	1,501,000	1,307,000	0	0	1,038,000						3,846,000
	1,497,000	598,000	573,000	978,000	0						3,646,000
	1,311,000	542,000	0	0	536,000						2,389,000
	523,000	0	1,156,000	548,000	1,064,000						3,291,000
	398,000	1,209,000	0	0	981,000						2,588,000
	0	0	1,170,000	315,000	1,215,000						2,700,000
	1,530,000	465,000	480,000	881,000	0						3,336,000
	0	874,000	1,093,000	0	1,030,000						2,997,000
	1,718,000	608,000	0	1,014,000	0						3,340,000
	1,534,000	0	1,396,000	0	514,000						3,444,000
	1,496,000	0	1,125,000	0	0						2,621,000
	0	1,219,000	0	677,000	1,464,000						3,380,000
	0	0	1,299,000	0	1,517,000						2,816,000
	1,409,000	418,000	0	0	1,420,000						3,247,000
	588,000	0	732,000	0	1,341,000						2,681,000
	1,382,000	373,000	0	897,000	0						2,652,000
	0	0	1,399,000	0	1,260,000						2,659,000
	1,403,000	0	1,274,000	0	0						2,677,000
	0	1,303,000	0	1,040,000	903,000						3,246,000
	284,000	0	1,209,000	0	1,315,000						2,808,000
	1,440,000	659,000	0	850,000	0						2,949,000
	0	1,142,000	1,205,000	0	847,000						3,194,000
	1,334,000	0	588,000	882,000	0						2,804,000
	0	0	1,255,000	0	1,115,000						2,370,000
	995,000	364,000	1,238,000	213,000	0						2,810,000
	251,000	1,249,000	0	799,000	540,000						2,839,000
	0	0	1,238,000	0	1,128,000						2,366,000
	1,523,000	794,000	0	856,000	0						3,173,000
	0	759,000	1,257,000	0	1,351,000						3,367,000
	1,329,000	441,000	353,000	889,000	0						3,012,000
	1,425,000	0	310,000	0	1,241,000						2,976,000
Total	24,371,000	14,524,000	20,399,000	10,619,000	21,820,000						92,184,000
Avg.	802,290	462,065	656,452	349,000	703,871						2,973,677
Max.	1,718,000	1,307,000	1,399,000	1,040,000	1,517,000						3,846,000

0.4

0.4

0.4

0.4

0.4

<—lowest CI





# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **June 2007**

## A. Public Water System (PWS) Information

PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>			PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	<b>9,217</b>			Total Population Served at End of Month:	<b>32,260</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person:	<b>Mark Cross</b>			Person's Title:	<b>Manager</b>
Contact Person's Mailing Address:	<b>905 Lowndes Avenue</b>	City:	<b>Pensacola</b>	State:	<b>Florida</b>
Contact Person's Telephone Number:	<b>(850) 455-8552</b>	Contact Person's Fax Number:	<b>(850) 456-1010</b>		
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.Com</b>				

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>			Plant Telephone	<b>(850) 455-8552</b>
Plant Address:	<b>905 Lowndes Avenue</b>	City:	<b>Pensacola</b>	State:	<b>Florida</b>
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water	<input type="checkbox"/> Purchased Finished Water			
Permitted Maximum Day Operating Capacity of Plant:	<b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>	Plant Class (per subsection 62-699.310(4), F.A.C.):	<b>C</b>		
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
Other Operators:	<b>Mark Cross</b>	<b>7169</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Russ Barnett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
	<b>Chester Horton</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm/Shift Work</b>	
	<b>Gary Leatherberry</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm/Shift Work</b>	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

*Theo Deleon* July 9, 2007  
Signature and Date

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number



PWS Identical	Number: <b>FL 1170527</b>	Plant Name: <b>Well # 3</b>
---------------	---------------------------	-----------------------------

III. Daily Data for the Month/Year of: <b>June 2007</b>														
Means of Achieving Four-Log Virus				<input checked="" type="checkbox"/> Free Chlorine <input type="checkbox"/> Chlorine Dioxide <input type="checkbox"/> Ozone <input type="checkbox"/> Combined Chlorine (Chloramines) <input type="checkbox"/> Ultraviolet Radiation <input type="checkbox"/> Other:										
Type of Disinfectant Residual Maintained in				<input checked="" type="checkbox"/> Free Chlorine <input type="checkbox"/> Combined Chlorine (Chloramines) <input type="checkbox"/> Chlorine Dioxide										
Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Parameters								Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/l	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, min	Lowest Operating UV Dose, mW-sec/cm²			Minimum UV Dose Required, mW-sec/cm²
1	X	24.4	1,463,000										0.5	0
2	X	23.3	1,378,000										0.5	0
3	X	24.8	1,456,000										0.5	0
4	X	11.3	700,000										0.6	0
5	X	21.2	1,358,000										0.5	0
6	X	5.7	364,000										0.7	0
7	X	24.0	1,521,000										0.5	0
8	X	24.3	1,555,000										0.4	0
9	X	23.8	1,513,000										0.6	0
10	X	24.4	1,548,000										0.5	0
11	X	23.5	1,482,000										0.4	0
12	X	23.8	1,509,000										0.6	0
13	X	25.3	1,593,000										0.6	0
14	X	23.6	1,483,000										0.4	0
15	X	10.0	624,000										0.5	0
16	X	23.6	1,474,000										0.5	0
17	X	24.3	1,508,000										0.5	0
18	X	24.1	1,486,000										0.5	0
19	X	4.4	273,000										0.6	0
20	X	14.2	875,000										0.6	0
21	X	0.0	0										0.4	0
22	X	0.0	0										0.6	0
23	X	24.1	1,543,000										0.6	0
24	X	20.8	1,340,000										0.5	0
25	X	23.3	1,426,000										0.5	0
26	X	22.7	1,413,000										0.5	0
27	X	25.4	1,500,000										0.4	0
28	X	22.2	1,381,000										0.5	0
29	X	24.2	1,498,000										0.4	0
30	X	23.8	1,474,000										0.4	0
Total			36,836,000											
Average			1,227,867	LOWEST RESIDUAL 0.4						days checked by operator 30				
Total			1,598,000	DAYS IN MONTH 30										

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527** Plant Name: **Well # 4**

III. Daily Data for the Month Year of: **June 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/l	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	15.3	811,000										0.5	0
2	X	14.8	788,000										0.5	0
3	X	14.0	748,000										0.5	0
4	X	13.6	751,000										0.6	0
5	X	0.0	0										0.5	0
6	X	25.5											0.7	0
7	X	19.0	1,048,000										0.5	0
8	X	0.0	0										0.4	0
9	X	13.4	728,000										0.6	0
10	X	0.0	0										0.5	0
11	X	24.7	1,340,000										0.4	0
12	X	15.6	829,000										0.6	0
13	X	0.0	0										0.6	0
14	X	24.2	1,313,000										0.4	0
15	X	0.0	0										0.5	0
16	X	17.7	977,000										0.5	0
17	X	20.3	1,116,000										0.5	0
18	X	13.8	727,000										0.5	0
19	X	0.0	0										0.6	0
20	X	6.5	358,000										0.6	0
21	X	23.2	1,261,000										0.4	0
22	X	13.9	750,000										0.6	0
23	X	21.1	1,126,000										0.6	0
24	X	14.9	805,000										0.5	0
25	X	11.2	581,000										0.5	0
26	X	0.0	0										0.5	0
27	X	0.0	0										0.4	0
28	X	21.5	1,173,000										0.5	0
29	X	0.0	0										0.4	0
30	X	22.1	1,187,000										0.4	0

Net Quantity of Finished Water Produced, gal	19,790,000
Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	659,667
Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	1,373,000

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 30

days checked by operator: 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 5**

(II. Daily Data for the Month Year of: **June 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	0.0	0										0.5	0
2	X	0.0	0										0.5	0
3	X	7.8	481,000										0.5	0
4	X	0.0	0										0.8	0
5	X	14.1	842,000										0.5	0
6	X	16.7	992,000										0.7	0
7	X	0.0	0										0.5	0
8	X	9.4	559,000										0.4	0
9	X	0.0	0										0.8	0
10	X	12.7	751,000										0.5	0
11	X	0.0	0										0.4	0
12	X	16.8	995,000										0.8	0
13	X	18.1	1,087,000										0.6	0
14	X	0.0	0										0.4	0
15	X	18.4	1,081,000										0.5	0
16	X	0.0	0										0.5	0
17	X	19.1	1,123,000										0.5	0
18	X	0.0	0										0.5	0
19	X	23.1	1,200,000										0.8	0
20	X	20.4	1,200,000										0.6	0
21	X	0.0	0										0.4	0
22	X	16.9	993,000										0.6	0
23	X	0.0	0										0.8	0
24	X	8.7	508,000										0.5	0
25	X	0.0	0										0.5	0
26	X	3.9	230,000										0.5	0
27	X	19.8	1,166,000										0.4	0
28	X	0.0	0										0.5	0
29	X	8.0	473,000										0.4	0
30	X	3.8	222,000										0.4	0
			<b>14,016,000</b>											
			<b>467,200</b>											
			<b>1,355,000</b>											
				LOWEST RESIDUAL 0.4					days checked by operator 30					
				DAYS IN MONTH 30										

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527** Plant Name: **Well # 8**

III. Daily Data for the Month Year of: **June 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C (if Applicable)	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	0.0	0										0.5	0
2	X	0.0	0										0.5	0
3	X	0.0	0										0.5	0
4	X	21.8	789,000										0.6	0
5	X	0.0	0										0.5	0
6	X	12.8	491,000										0.7	0
7	X	15.4	588,000										0.5	0
8	X	0.0	0										0.4	0
9	X	23.5	902,000										0.6	0
10	X	0.0	0										0.5	0
11	X	18.9	706,000										0.4	0
12	X	0.0	0										0.6	0
13	X	0.0	0										0.6	0
14	X	17.9	703,000										0.4	0
15	X	0.0	0										0.5	0
16	X	23.7	912,000										0.5	0
17	X	0.0	0										0.5	0
18	X	12.8	485,000										0.5	0
19	X	17.9	697,000										0.6	0
20	X	0.0	0										0.6	0
21	X	25.4	922,000										0.4	0
22	X	0.0	0										0.6	0
23	X	0.0	0										0.6	0
24	X	0.0	0										0.5	0
25	X	22.8	880,000										0.5	0
26	X	0.0	0										0.5	0
27	X	7.7	295,000										0.4	0
28	X	15.0	578,000										0.5	0
29	X	0.0	0										0.4	0
30	X	20.1	773,000										0.4	0
			9,770,000											days checked by operator 30
			325,667											
			971,000											
				LOWEST RESIDUAL 0.4										
				DAYS IN MONTH 30										

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527** Plant Name: **Well # 9**

HL Daily Data for the Month Year of: **June 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C If Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mJ/cm²	Minimum UV Dose Required, mJ/cm²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	10.8	595,000										0.5	0
2	X	18.8	1,047,000										0.5	0
3	X	21.0	1,216,000										0.5	0
4	X	13.3	810,000										0.6	0
5	X	10.7	685,000										0.5	0
6	X	0.0	0										0.7	0
7	X	5.3	297,000										0.5	0
8	X	17.0	992,000										0.4	0
9	X	0.0	0										0.6	0
10	X	20.8	1,159,000										0.5	0
11	X	0.0	0										0.4	0
12	X	0.0	0										0.6	0
13	X	0.0	0										0.6	0
14	X	7.7	422,000										0.4	0
15	X	21.2	1,285,000										0.5	0
16	X	0.0	0										0.5	0
17	X	0.0	0										0.5	0
18	X	0.0	0										0.5	0
19	X	0.0	0										0.6	0
20	X	5.1	298,000										0.6	0
21	X	15.0	906,000										0.4	0
22	X	19.5	1,130,000										0.6	0
23	X	10.8	617,000										0.6	0
24	X	18.1	1,027,000										0.5	0
25	X	0.0	0										0.5	0
26	X	21.9	1,244,000										0.5	0
27	X	0.0	0										0.4	0
28	X	0.0	0										0.5	0
29	X	22.0	1,267,000										0.4	0
30	X	0.0	0										0.4	0
			<b>15,044,000</b>											
			<b>501,467</b>											
			<b>1,311,000</b>											
				LOWEST RESIDUAL 0.4					days checked by operator 30					
				DAYS IN MONTH 30										



**MONTHLY OPERATIONAL REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS**
**DO NOT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished Water Production for the Month Year of:

**June 2007**

 Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

 Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	NA										6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	1,483,000	811,000	0	0	595,000						2,889,000
	1,378,000	788,000	0	0	1,047,000						3,213,000
	1,458,000	748,000	481,000	0	1,218,000						3,881,000
	700,000	751,000	0	769,000	810,000						3,050,000
	1,358,000	0	842,000	0	685,000						2,885,000
	384,000	1,373,000	992,000	491,000	0						3,220,000
	1,521,000	1,048,000	0	588,000	297,000						3,454,000
	1,555,000	0	559,000	0	992,000						3,106,000
	1,513,000	728,000	0	902,000	0						3,143,000
	1,548,000	0	781,000	0	1,159,000						3,458,000
	1,482,000	1,340,000	0	706,000	0						3,528,000
	1,509,000	829,000	995,000	0	0						3,333,000
	1,593,000	0	1,067,000	0	0						2,680,000
	1,483,000	1,313,000	0	703,000	422,000						
	624,000	0	1,081,000	0	1,285,000						2,970,000
	1,474,000	977,000	0	912,000	0						3,363,000
	1,508,000	1,116,000	1,123,000	0	0						3,747,000
	1,486,000	727,000	0	485,000	0						2,698,000
	273,000	0	1,355,000	697,000	0						2,325,000
	875,000	358,000	1,200,000	0	298,000						2,731,000
	0	1,261,000	0	971,000	906,000						3,138,000
	0	750,000	993,000	0	1,130,000						2,873,000
	1,543,000	1,126,000	0	0	617,000						3,286,000
	1,340,000	805,000	506,000	0	1,027,000						3,678,000
	1,426,000	581,000	0	880,000	0						2,887,000
	1,413,000	0	230,000	0	1,311,000						2,954,000
	1,598,000	0	1,166,000	295,000	0						3,059,000
	1,381,000	1,173,000	0	578,000	0						3,132,000
	1,498,000	0	473,000	0	1,267,000						3,238,000
	1,474,000	1,187,000	222,000	773,000	0						3,656,000
Total	36,836,000	19,790,000	14,016,000	9,770,000	15,044,000						95,456,000
Avg.	1,227,867	659,667	467,200	325,667	501,467						3,181,867
Max.	1,598,000	1,373,000	1,355,000	971,000	1,311,000						3,921,000

0.4

0.4

0.4

0.4

0.4

&lt;---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **May 2007**

## A. Public Water System (PWS) Information


PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>		PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive
Number of Service Connections at End of Month:	<b>9,520</b>		Total Population Served at End of Month:	<b>33,320</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>			
Contact Person:	<b>Mark Cross</b>		Person's Title: <b>Manager</b>	
Contact Person's Mailing Address:	<b>905 Lownde Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Contact Person's Telephone Number:	<b>(850) 455-8552</b>		Contact Person's Fax Number: <b>(850) 456-1010</b>	
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.Com</b>			

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>		Plant Telephone <b>(850) 455-8552</b>	
Plant Address:	<b>905 Lownde Avenue</b>	City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant,	<b>4,860,000</b>			
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>	Plant Class (per subsection 62-699.310(4), F.A.C.):	<b>C</b>	
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>
Other Operators:	<b>Mark Cross</b>	<b>7189</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>
	<b>Chester Horton</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Gary Leatherberry</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

  
Signature and Date **6/5/07**

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month Year of: **May 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data								Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>			Minimum UV Dose Required, mW-sec/cm <sup>2</sup>
1	X	22.9	1,329,000										0.8	0
2	X	23.8	1,383,000										0.6	0
3	X	0.0	0										0.6	0
4	X	7.1	399,000										0.6	0
5	X	23.4	1,371,000										0.6	0
6	X	15.7	907,000										0.5	0
7	X	13.8	792,000										0.6	0
8	X	21.0	1,194,000										0.5	0
9	X	10.6	605,000										0.6	0
10	X	23.4	1,357,000										0.5	0
11	X	25.1	1,437,000										0.4	0
12	X	22.0	1,243,000										0.5	0
13	X	20.4	1,141,000										0.6	0
14	X	24.3	1,408,000										0.6	0
15	X	23.8	1,357,000										0.6	0
16	X	23.6	1,351,000										0.5	0
17	X	0.0	0										0.5	0
18	X	25.8											0.5	0
19	X	24.2	1,401,000										0.8	0
20	X	24.3	1,329,000										0.5	0
21	X	20.3	1,218,000										0.5	0
22	X	23.9	1,448,000										0.7	0
23	X	23.2	1,403,000										0.5	0
24	X	0.0	0										0.6	0
25	X	23.5	1,427,000										0.5	0
26	X	22.7	1,363,000										0.6	0
27	X	23.0	1,387,000										0.5	0
28	X	24.2	1,463,000										0.5	0
29	X	24.0	1,443,000										0.5	0
30	X	22.1	1,338,000										0.6	0
31	X	24.0	1,433,000										0.6	PBWN
			35,394,000											
			1,141,742											
			1,467,000											
				LOWEST RESIDUAL 0.4				days checked by operator 31						
				DAYS IN MONTH 31										

Plant Name: **Well # 4**

May 2007

Type of Disinfectant Residual Maintained in

<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	--	---

days checked by operator: 31

Plant Name: **Well # 5**

May 2007

Other:

## [ ]Chlorine Dioxide

DAYS IN MONTH 31



Plant Name: **Well # 8**

**May 2007**

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

days checked by operator 31

Plant Name: **Well # 9**

Means of Achieving Four-Log Virus	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Chlorine Dioxide	<input type="checkbox"/> Ozone	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Ultraviolet Radiation	<input type="checkbox"/> Other:
-----------------------------------	---	---	--------------------------------	--	--	---------------------------------

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data								Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>		
1	X	20.4	1,273,000									0.6	0
2	X	3.3	197,000									0.6	0
3	X	13.4	815,000									0.6	0
4	X	20.3	1,205,000									0.6	0
5	X	0.0	0									0.6	0
6	X	26.2										0.5	0
7	X	23.0	1,400,000									0.6	0
8	X	22.8	1,367,000									0.5	0
9	X	22.3	1,364,000									0.6	0
10	X	6.6	371,000									0.5	0
11	X	21.3	1,227,000									0.4	0
12	X	24.0	1,489,000									0.5	0
13	X	22.4	1,361,000									0.6	0
14	X	0.0	0									0.6	0
15	X	18.5	1,082,000									0.6	0
16	X	0.0	0									0.5	0
17	X	22.9	1,387,000									0.5	0
18	X	7.9	439,000									0.5	0
19	X	0.0	0									0.8	0
20	X	14.4	800,000									0.5	0
21	X	7.9	441,000									0.5	0
22	X	10.0	575,000									0.7	0
23	X	17.7	1,056,000									0.5	0
24	X	24.1	1,466,000									0.6	0
25	X	16.7	950,000									0.5	0
26	X	9.0	510,000									0.6	0
27	X	17.9	1,007,000									0.5	0
28	X	10.6	626,000									0.5	0
29	X	11.1	619,000									0.5	0
30	X	0.0	0									0.6	0
31	X	22.7	1,359,000									0.6	PBWN
			25,963,000										
			837,516	LOWEST RESIDUAL 0.4				days checked by operator 31					
			1,597,000	DAYS IN MONTH 31									

**MONTHLY OPERATIONAL REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS**

**DO NOT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished Water Production for the Month Year of:

**May 2007**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
Day of						NA	NA	NA	NA	NA	6,792,000
	Actual Maximum Day Operating Capacity of Each Plant, gallons										Total
	1,329,000	0	586,000	0	1,273,000						3,188,000
	1,383,000	0	935,000	453,000	197,000						2,968,000
	0	1,299,000	0	817,000	815,000						2,931,000
	399,000	0	1,205,000	0	1,205,000						2,809,000
	1,371,000	831,000	0	760,000	0						2,962,000
	907,000	535,000	774,000	0	1,597,000						3,813,000
	792,000	0	0	785,000	1,400,000						2,977,000
	1,194,000	806,000	0	0	1,387,000						3,369,000
	605,000	0	1,272,000	0	1,384,000						3,241,000
	1,357,000	1,226,000	0	761,000	371,000						3,715,000
	1,437,000	0	601,000	0	1,227,000						3,265,000
	1,243,000	805,000	0	0	1,469,000						3,517,000
	1,141,000	0	766,000	0	1,361,000						3,268,000
	1,408,000	966,000	0	915,000	0						3,289,000
	1,357,000	0	1,009,000	0	1,082,000						3,448,000
	1,351,000	0	853,000	583,000	0						2,787,000
	0	1,012,000	0	879,000	1,387,000						3,278,000
	1,467,000	0	1,387,000	0	439,000						3,293,000
	1,401,000	1,379,000	739,000	328,000	0						3,847,000
	1,329,000	1,292,000	370,000	0	800,000						3,791,000
	1,218,000	1,228,000	0	603,000	441,000						3,490,000
	1,448,000	986,000	732,000	0	576,000						3,741,000
	1,403,000	0	614,000	377,000	1,056,000						3,450,000
	0	1,086,000	0	907,000	1,466,000						3,459,000
	1,427,000	0	1,034,000	0	950,000						3,411,000
	1,363,000	1,322,000	0	711,000	510,000						3,906,000
	1,387,000	1,272,000	0	0	1,007,000						3,666,000
	1,463,000	1,333,000	0	593,000	626,000						
	1,443,000	0	1,023,000	0	619,000						3,085,000
	1,338,000	466,000	658,000	702,000	0						3,164,000
31	1,433,000	437,000	0	0	1,359,000						3,229,000
Total	35,394,000	18,283,000	14,558,000	10,174,000	25,963,000						104,372,000
Avg.	1,141,742	589,774	469,613	328,194	837,516						3,366,839
Max.	1,467,000	1,379,000	1,387,000	915,000	1,597,000						4,015,000

0.4 0.4 0.4 0.4 0.4

<--lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **April 2007**

## A. Public Water System (PWS) Information

PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>			PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	<b>9,448</b>			Total Population Served at End of Month:	<b>33,068</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person:	<b>Mark Cross</b>			Person's Title:	<b>Manager</b>
Contact Person's Mailing Address:	<b>905 Lowndes Avenue</b>	City:	<b>Pensacola</b>	State:	<b>Florida</b>
Contact Person's Telephone Number:	<b>(850) 455-8552</b>		Contact Person's Fax Number:	<b>(850) 456-1010</b>	
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.Com</b>				

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>			Plant Telephone	<b>(850) 455-8552</b>
Plant Address:	<b>905 Lowndes Avenue</b>	City:	<b>Pensacola</b>	State:	<b>Florida</b>
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water			<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant:	<b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>			Plant Class (per subsection 62-699.310(4), F.A.C.):	<b>C</b>
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
Other Operators:	<b>Mark Cross</b>	<b>7169</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>	
	<b>Chester Horton</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	
	<b>Gary Leatherberry</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>	

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

*Theo Deleon* May 4, 2007  
Signature and Date

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identificat

Number: FL 1170527

Plant Name: Well # 3

III. Daily Data for the Month Year of:

April 2007

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²		
1	X	0.0	0										0.5	0
2	X	20.6	1,224,000										0.5	0
3	X	22.1	1,291,000										0.5	0
4	X	14.9	877,000										0.6	0
5	X	0.0	0										0.2	0
6	X	0.0	0										0.6	0
7	X	23.7	1,402,000										0.4	0
8	X	0.0	0										0.6	0
9	X	21.8	1,305,000										0.5	0
10	X	18.4	1,013,000										0.6	0
11	X	15.4	907,000										0.7	Issuance of PBWN
12	X	0.0	0										0.6	0
13	X	5.5	325,000										0.4	0
14	X	22.2	1,325,000										0.5	Issuance of PBWN
15	X	0.0	0										0.6	0
16	X	19.7	1,162,000										0.6	0
17	X	23.0	1,357,000										0.6	0
18	X	14.1	838,000										0.6	0
19	X	0.0	0										0.6	0
20	X	9.5	580,000										0.5	0
21	X	17.1	972,000										0.5	0
22	X	22.6	1,338,000										0.5	0
23	X	23.9	1,394,000										0.5	0
24	X	23.3	1,347,000										0.6	0
25	X	22.7	1,326,000										0.6	0
26	X	0.0	0										0.7	0
27	X	4.0	236,000										0.6	0
28	X	23.3	1,383,000										0.5	0
29	X	25.4											0.6	0
30	X	24.3	1,439,000										0.5	Issuance of PBWN
			24,510,000											
			817,000											
			1,469,000											

LOWEST RESIDUAL 0.2

days checked by operator 30

DAYS IN MONTH 30



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification

Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data For the Month Year of:

**April 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water, Required, min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0									0.5	0
2	X	9.4	520,000									0.5	0
3	X	0.0	0									0.5	0
4	X	0.0	0									0.6	0
5	X	22.4	1,225,000									0.2	0
6	X	0.0	0									0.6	0
7	X	9.2	511,000									0.4	0
8	X	0.0	0									0.6	0
9	X	6.6	370,000									0.5	0
10	X	0.0	0									0.6	0
11	X	0.0	0									0.7	Issuance of PBWN
12	X	24.1	1,000,000									0.6	0
13	X	0.0	0									0.4	0
14	X	8.9	490,000									0.5	Issuance of PBWN
15	X	0.0	0									0.6	0
16	X	6.2	348,000									0.6	0
17	X	0.0	0									0.6	0
18	X	0.0	0									0.6	0
19	X	24.0	1,315,000									0.6	0
20	X	0.0	0									0.5	0
21	X	0.0	0									0.5	0
22	X	0.0	0									0.5	0
23	X	23.3	1,264,000									0.5	0
24	X	0.0	0									0.6	0
25	X	0.0	0									0.6	0
26	X	22.2	1,188,000									0.7	0
27	X	0.0	0									0.6	0
28	X	11.2	624,000									0.5	0
29	X	0.0	0									0.6	0
30	X	13.3	727,000									0.5	Issuance of PBWN
			<b>9,910,000</b>										
			<b>330,333</b>										
			<b>1,328,000</b>										

LOWEST RESIDUAL 0.2

days checked by operator: 30

DAYS IN MONTH 30

Plant Name: **Well # 5**

**April 2007**

☐ Chlorine Dioxide

DAYS IN MONTH 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification

Number: FL 1170527

Plant Name: Well # 8

III. Daily Data for the Month Year of:

April 2007

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.5	0
2	X	22.8	840,000										0.5	0
3	X	0.0	0										0.5	0
4	X	9.9	383,000										0.6	0
5	X	17.7	890,000										0.2	0
6	X	0.0	0										0.6	0
7	X	18.9	740,000										0.4	0
8	X	0.0	0										0.6	0
9	X	23.5	912,000										0.5	0
10	X	0.0	0										0.6	0
11	X	0.0	0										0.7	Issuance of PBWN
12	X	23.5	918,000										0.6	0
13	X	0.0	0										0.4	0
14	X	19.0	741,000										0.5	Issuance of PBWN
15	X	0.0	0										0.6	0
16	X	23.1	894,000										0.6	0
17	X	0.0	0										0.6	0
18	X	0.0	0										0.6	0
19	X	70.3	793,000										0.6	0
20	X	0.0	0										0.5	0
21	X	0.0	0										0.5	0
22	X	0.0	0										0.5	0
23	X	17.3	676,000										0.5	0
24	X	0.0	0										0.6	0
25	X	0.0	0										0.6	0
26	X	26.3	850,000										0.7	0
27	X	0.0	0										0.6	0
28	X	20.8	813,000										0.5	0
29	X	0.0	0										0.6	0
30	X	13.8	832,000										0.5	Issuance of PBWN
			10,247,000											
			341,567											
			1,015,000											

LOWEST RESIDUAL 0.2

days checked by operator 30

DAYS IN MONTH 30

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification

Number: **FL 1170527**

Plant Name: **Well # 9**

III. Daily Data for the Month/Year of:

**April 2007**

Means of Achieving Four-Log Virus

☒ Free Chlorine

☐ Chlorine Dioxide

☐ Ozone

☐ Combined Chlorine (Chloramines)

☐ Ultraviolet Radiation

☐ Other:

Type of Disinfectant Residual Maintained in

☒ Free Chlorine

☐ Combined Chlorine (Chloramines)

☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Daily Data									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	23.7	1,133,000										0.5	0
2	X	0.0	0										0.5	0
3	X	19.0	1,078,000										0.5	0
4	X	0.0	0										0.6	0
5	X	7.3	418,000										0.2	0
6	X	22.5	1,339,000										0.6	0
7	X	0.0	0										0.4	0
8	X	23.7	1,439,000										0.6	0
9	X	0.0	0										0.5	0
10	X	17.5	1,039,000										0.6	0
11	X	0.0	0										0.7	Issuance of PBWN
12	X	10.7	478,000										0.6	0
13	X	21.7	992,000										0.4	0
14	X	0.0	0										0.5	Issuance of PBWN
15	X	23.8	1,103,000										0.6	0
16	X	0.0	0										0.6	0
17	X	16.6	754,000										0.6	0
18	X	0.0	0										0.6	0
19	X	11.0	536,000										0.6	0
20	X	22.0	1,210,000										0.5	0
21	X	26.8	1,050,000										0.5	0
22	X	18.0	919,000										0.5	0
23	X	0.0	0										0.5	0
24	X	21.2	1,084,000										0.6	0
25	X	0.0	0										0.6	0
26	X	6.8	301,000										0.7	0
27	X	19.5	1,162,000										0.6	0
28	X	0.0	0										0.5	0
29	X	19.2	1,101,000										0.6	0
30	X	0.0	0										0.5	Issuance of PBWN
			17,549,000											
			584,967											
			1,463,000											
				LOWEST RESIDUAL 0.2		days checked by operator 30								
				DAYS IN MONTH 30										

LOWEST RESIDUAL 0.2

DAYS IN MONTH 30

days checked by operator 30

## MONTHLY OPERATIONAL REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS

DO NOT HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month Year of:

April 2007

Community Water System (CWS) Name: Peoples Water Service Company of Florida, Inc.

Public Water System (PWS) Identification FL 1170527

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	NA										6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	0	0	1,267,000	0	1,133,000						2,400,000
	1,224,000	520,000	0	840,000	0						2,584,000
	1,291,000	0	0	0	1,078,000						2,369,000
	877,000	0	1,535,000	383,000	0						2,795,000
	0	1,225,000	0	690,000	418,000						2,333,000
	0	0	1,144,000	0	1,339,000						2,483,000
	1,402,000	511,000	0	740,000	0						2,653,000
	0	0	1,127,000	0	1,439,000						2,566,000
	1,305,000	370,000	0	912,000	0						2,587,000
	1,013,000	0	334,000	0	1,039,000						2,386,000
	907,000	0	1,347,000	0	0						2,254,000
	0	1,328,000	0	918,000	478,000						2,724,000
	325,000	0	1,034,000	0	992,000						2,351,000
	1,325,000	490,000	0	741,000	0						2,556,000
	0	0	1,163,000	0	1,103,000						2,266,000
	1,162,000	348,000	0	894,000	0						2,404,000
	1,357,000	0	250,000	0	754,000						2,361,000
	838,000	0	1,331,000	0	0						2,169,000
	0	1,315,000	0	793,000	536,000						2,644,000
	580,000	0	716,000	0	1,210,000						2,506,000
	972,000	0	606,000	0	1,463,000						3,041,000
	1,338,000	0	412,000	0	919,000						2,669,000
	1,394,000	1,264,000	0	676,000	0						
	1,347,000	0	648,000	0	1,084,000						3,079,000
	1,326,000	0	976,000	0	0						2,302,000
	0	1,188,000	0	1,015,000	301,000						2,504,000
	236,000	0	857,000	0	1,162,000						2,255,000
	1,383,000	624,000	0	813,000	0						2,820,000
	1,469,000	0	672,000	0	1,101,000						3,242,000
	1,439,000	727,000	0	832,000	0						2,998,000
Total	24,510,000	9,910,000	15,419,000	10,247,000	17,549,000						77,635,000
Avg.	817,000	330,333	513,967	341,567	584,967						2,587,833
Max.	1,469,000	1,328,000	1,535,000	1,015,000	1,463,000						3,334,000

0.2

0.2

0.2

0.2

0.2

&lt;—lowest CI






# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

<b>I. General Information for the Month/Year of:</b> <b>March 2007</b>				
<b>A. Public Water System (PWS) Information</b>				
PWS Name: <b>Peoples Water Service Company of Florida, Inc.</b>		PWS Identification Number: <b>FL 1170527</b>		
PWS Type: <input checked="" type="checkbox"/> Community <input type="checkbox"/> Non-Transient <input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive				
Number of Service Connections at End of Month: <b>9,454</b>		Total Population Served at End of Month: <b>33,089</b>		
PWS Owner: <b>Peoples Water Service Company of Florida, Inc.</b>				
Contact Person: <b>Mark Cross</b>		Person's Title: <b>Manager</b>		
Contact Person's Mailing Address: <b>905 Lowndes Avenue</b>		City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Contact Person's Telephone Number: <b>(850) 455-8552</b>		Contact Person's Fax Number: <b>(850) 456-1010</b>		
Contact Person's E-Mail Address: <b>MarkCross@PeoplesWaterService.Com</b>				
<b>B. Water Treatment Plant Information</b>				
Plant Name: <b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>		Plant Telephone: <b>(850) 455-8552</b>		
Plant Address: <b>905 Lowndes Avenue</b>		City: <b>Pensacola</b>	State: <b>Florida</b>	Zip Code: <b>32507-0815</b>
Type of Water Treated by Plant: <input checked="" type="checkbox"/> Raw Ground Water <input type="checkbox"/> Purchased Finished Water				
Permitted Maximum Day Operating Capacity of Plant: <b>4,860,000</b>				
Plant Category (per subsection 62-699.310(4), F.A.C.): <b>V</b>		Plant Class (per subsection 62-699.310(4), F.A.C.): <b>C</b>		
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
Other Operators:	Mark Cross	7169	A	Mon - Fri 8 :00am - 5:00 pm
	Jim Ogle	4927	C	Mon - Fri 8 :00am - 5:00 pm
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
	Chester Horton	NA	NA	Mon - Fri 8 :00am - 5:00 pm
	Gary Leatherberry	NA	NA	Mon - Fri 8 :00am - 5:00 pm
<b>II. Certification by Lead/Chief Operator</b>				

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification

Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month Year of

**March 2007**

Means of Achieving Four-Log Virus

☒ Free Chlorine

☐ Chlorine Dioxide

☐ Ozone

☐ Combined Chlorine (Chloramines)

☐ Ultraviolet Radiation

☐ Other:

Type of Disinfectant Residual Maintained in

☒ Free Chlorine

☐ Combined Chlorine (Chloramines)

☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	PWSs Treating Raw Ground Water or Purchased Finished Water - Disinfection Data (If Applicable)									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²		
1	X	0.0	0									0.6	0	
2	X	0.0	0									0.4	0	
3	X	23.6	1,441,000									0.5	0	
4	X	0.0	0									0.5	0	
5	X	19.8	1,225,000									0.6	0	
6	X	0.0	0									0.6	0	
7	X	17.4	1,073,000									0.6	0	
8	X	16.2	990,000									0.4	0	
9	X	0.0	0									0.5	0	
10	X	25.1	1,557,000									0.6	0	
11	X	0.0	0									0.5	0	
12	X	19.7	1,204,000									0.5	0	
13	X	23.0	1,408,000									0.6	PBWN	
14	X	14.7	905,000									0.6	0	
15	X	0.0	0									0.7	0	
16	X	4.6	285,000									0.5	0	
17	X	23.2	1,428,000									0.6	0	
18	X	0.0	0									0.5	0	
19	X	24.4	1,195,000									0.6	0	
20	X	23.6	1,430,000									0.4	0	
21	X	14.3	877,000									0.7	0	
22	X	0.0	0									0.5	0	
23	X	0.0	0									0.5	0	
24	X	23.9	1,465,000									0.5	0	
25	X	0.0	0									0.5	0	
26	X	23.8	1,467,000									0.3	0	
27	X	18.4	1,075,000									0.5	PBWN	
28	X	17.7	1,054,000									0.6	0	
29	X	0.0	0									0.6	0	
30	X	0.0	0									0.6	0	
31	X	24.7	1,472,000									0.6	0	
Total			21,551,000											
Average			695,194	LOWEST RESIDUAL 0.3 days checked by operator 31										
Minimum			1,557,000	DAYS IN MONTH 31										

LOWEST RESIDUAL 0.3

days checked by operator 31

DAYS IN MONTH 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification

Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data for the Month Year of:

**March 2007**

Means of Achieving Four-Log Virus

☒ Free Chlorine

☐ Chlorine Dioxide

☐ Ozone

☐ Combined Chlorine (Chloramines)

☐ Ultraviolet Radiation

☐ Other:

Type of Disinfectant Residual Maintained in

☒ Free Chlorine

☐ Combined Chlorine (Chloramines)

☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Operator's Name, Title, and Signature (If Applicable)									Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>		
1	X	23.4	1,272,000										0.6	0
2	X	0.0	0										0.4	0
3	X	0.0	0										0.5	0
4	X	3.9	221,000										0.5	0
5	X	0.0	0										0.6	0
6	X	6.4	352,000										0.6	0
7	X	0.0	0										0.6	0
8	X	23.0	1,266,000										0.4	0
9	X	0.0	0										0.5	0
10	X	8.2	456,000										0.6	0
11	X	5.9	329,000										0.5	0
12	X	8.1	498,000										0.5	0
13	X	0.0	0										0.6	PBWN
14	X	0.0	0										0.6	0
15	X	23.6	1,247,000										0.7	0
16	X	0.0	0										0.5	0
17	X	5.8	327,000										0.6	0
18	X	0.0	0										0.5	0
19	X	12.3	672,000										0.6	0
20	X	0.0	0										0.4	0
21	X	0.0	0										0.7	0
22	X	24.0	1,331,000										0.5	0
23	X	0.0	0										0.5	0
24	X	12.7	712,000										0.5	0
25	X	5.4	303,000										0.5	0
26	X	14.1	779,000										0.3	0
27	X	0.0	0										0.5	PBWN
28	X	0.0	0										0.6	0
29	X	24.4	1,337,000										0.6	0
30	X	0.0	0										0.6	0
31	X	9.0	502,000										0.6	0

**11,604,000**

**374,323**

**1,337,000**

LOWEST RESIDUAL 0.3

DAYS IN MONTH 31

days checked by operator: 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier:

Number: **FL 1170527**

Plant Name: **Well # 5**

III. Daily Data for the Month Year of:

**March 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C If Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	12.0	752,000										0.4	0
3	X	0.0	0										0.5	0
4	X	17.9	1,119,000										0.5	0
5	X	0.0	0										0.6	0
6	X	17.3	1,076,000										0.6	0
7	X	21.2	1,310,000										0.6	0
8	X	0.0	0										0.4	0
9	X	17.3	1,069,000										0.5	0
10	X	0.0	0										0.6	0
11	X	18.4	1,144,000										0.5	0
12	X	0.0	0										0.5	0
13	X	0.0	0										0.6	PBWN
14	X	24.4											0.6	0
15	X	0.0	0										0.7	0
16	X	12.1	753,000										0.5	0
17	X	0.0	0										0.6	0
18	X	18.3	1,137,000										0.5	0
19	X	0.0	0										0.6	0
20	X	3.4	215,000										0.4	0
21	X	21.0	1,304,000										0.7	0
22	X	0.0	0										0.5	0
23	X	18.3	1,131,000										0.5	0
24	X	0.0	0										0.5	0
25	X	17.6	1,098,000										0.5	0
26	X	0.0	0										0.3	0
27	X	11.9	731,000										0.5	PBWN
28	X	21.1	1,295,000										0.6	0
29	X	0.0	0										0.6	0
30	X	23.9	1,461,000										0.6	0
31	X	0.0	0										0.6	0
			<b>17,112,000</b>											
			<b>552,000</b>											
			<b>1,517,000</b>											

LOWEST RESIDUAL 0.3

days checked by operator 31

DAYS IN MONTH 31



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER & PURCHASED FINISHED WATER

PWS Identification

Number: FL 1170527

Plant Name: Well # 8

III. Daily Data for the Month Year of:

March 2007

Means of Achieving Four-Log Virus

☒ Free Chlorine

☐ Chlorine Dioxide

☐ Ozone

☐ Combined Chlorine (Chloramines)

☐ Ultraviolet Radiation

☐ Other:

Type of Disinfectant Residual Maintained in

☒ Free Chlorine

☐ Combined Chlorine (Chloramines)

☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection Data (Applicable)										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Chlorination			UV Disinfection			Other Disinfection Methods					
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>			
1	X	0.0	0										0.6	0	
2	X	0.0	0										0.4	0	
3	X	21.0	840,000										0.5	0	
4	X	0.0	0										0.5	0	
5	X	22.6	846,000										0.6	0	
6	X	0.0	0										0.6	0	
7	X	0.0	0										0.6	0	
8	X	0.0	0										0.4	0	
9	X	0.0	0										0.5	0	
10	X	23.4	853,000										0.6	0	
11	X	0.0	0										0.5	0	
12	X	23.2	895,000										0.5	0	
13	X	0.0	0										0.6	PBWN	
14	X	0.0	0										0.6	0	
15	X	18.6	730,000										0.7	0	
16	X	0.0	0										0.5	0	
17	X	17.3	675,000										0.6	0	
18	X	0.0	0										0.5	0	
19	X	22.2	862,000										0.6	0	
20	X	0.0	0										0.4	0	
21	X	8.3	326,000										0.7	0	
22	X	19.4	759,000										0.5	0	
23	X	0.0	0										0.5	0	
24	X	20.9	814,000										0.5	0	
25	X	0.0	0										0.5	0	
26	X	24.1	945,000										0.3	0	
27	X	0.0	0										0.5	PBWN	
28	X	5.8	223,000										0.6	0	
29	X	20.7	807,000										0.6	0	
30	X	0.0	0										0.6	0	
31	X	17.1	682,000										0.6	0	

Minimum 10,397,000

Volume 335,387

Maximum 1,013,000

LOWEST RESIDUAL 0.3

days checked by operator 31

DAYS IN MONTH 31



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 9**

III. Daily Data for the Month Year of: **March 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Disinfection by Product of Free Chlorine, Chlorine Dioxide, or Ozone (If Applicable)								Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>			Minimum UV Dose Required, mW-sec/cm <sup>2</sup>
1	X	17.0	1,042,000									0.6	0	
2	X	19.7	1,202,000									0.4	0	
3	X	0.0	0									0.5	0	
4	X	22.5	885,000									0.5	0	
5	X	0.0	0									0.6	0	
6	X	22.3	885,000									0.6	0	
7	X	0.0	0									0.6	0	
8	X	13.2	704,000									0.4	0	
9	X	21.2	1,244,000									0.5	0	
10	X	0.0	0									0.6	0	
11	X	23.3	1,344,000									0.5	0	
12	X	0.0	0									0.5	0	
13	X	17.1	915,000									0.6	PBWN	
14	X	0.0	0									0.6	0	
15	X	6.0	320,000									0.7	0	
16	X	17.0	984,000									0.5	0	
17	X	0.0	0									0.6	0	
18	X	23.6	1,392,000									0.5	0	
19	X	0.0	0									0.6	0	
20	X	15.5	977,000									0.4	0	
21	X	0.0	0									0.7	0	
22	X	13.5	641,000									0.5	0	
23	X	22.2	1,240,000									0.5	0	
24	X	0.0	0									0.5	0	
25	X	22.9	1,270,000									0.5	0	
26	X	0.0	0									0.3	0	
27	X	19.3	1,049,000									0.5	PBWN	
28	X	0.0	0									0.6	0	
29	X	16.3	863,000									0.6	0	
29	X	17.8	915,000									0.6	0	
29	X	0.0	0									0.6	0	
			18,998,000											
			612,839	LOWEST RESIDUAL 0.3										
			1,458,000	DAYS IN MONTH 31										days checked by operator 31

LOWEST RESIDUAL 0.3

days checked by operator 31

DAYS IN MONTH 31

## MONTHLY OPERATIONAL REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWSs

HAVE MULTIPLE TREATMENT PLANTS

Daily Finished Water Production for the Month Year of:

March 2007

Community Water System (CWS) Name: Peoples Water Service Company of Florida, Inc.

Public Water System (PWS) Identification FL 1170527

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
						NA	NA	NA	NA	NA	6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	0	1,272,000	0	0	1,042,000						2,314,000
	0	0	752,000	0	1,202,000						1,954,000
	1,441,000	0	0	840,000	0						2,281,000
	0	221,000	1,119,000	0	1,458,000						2,798,000
	1,225,000	0	0	846,000	0						2,071,000
	0	352,000	1,076,000	0	1,458,000						2,886,000
	1,073,000	0	1,310,000	0	0						2,383,000
	990,000	1,266,000	0	0	704,000						2,960,000
	0	0	1,069,000	0	1,244,000						2,313,000
	1,557,000	456,000	0	1,013,000	0						3,026,000
	0	329,000	1,144,000	0	1,344,000						2,817,000
	1,204,000	498,000	0	895,000	0						2,597,000
	1,408,000	0	0	0	915,000						2,323,000
	905,000	0	1,517,000	0	0						2,422,000
	0	1,247,000	0	730,000	320,000						2,297,000
	285,000	0	753,000	0	964,000						2,002,000
	1,428,000	327,000	0	675,000	0						2,430,000
	0	0	1,137,000	0	1,392,000						2,529,000
	1,195,000	872,000	0	862,000	0						2,729,000
	1,430,000	0	215,000	0	977,000						2,622,000
	877,000	0	1,304,000	326,000	0						2,507,000
	0	1,331,000	0	769,000	641,000						2,731,000
	0	0	1,131,000	0	1,240,000						2,371,000
	1,465,000	712,000	0	814,000	0						2,991,000
	0	303,000	1,098,000	0	1,270,000						2,671,000
	1,467,000	779,000	0	945,000	0						
	1,075,000	0	731,000	0	1,049,000						2,855,000
	1,054,000	0	1,295,000	223,000	0						2,572,000
	0	1,337,000	0	807,000	863,000						3,007,000
	0	0	1,461,000	0	915,000						2,376,000
	1,472,000	502,000	0	662,000	0						2,636,000
Total	21,551,000	11,604,000	17,112,000	10,397,000	18,998,000						79,662,000
Avg.	695,194	374,323	552,000	335,387	612,839						2,569,742
Max.	1,557,000	1,337,000	1,517,000	1,013,000	1,458,000						3,191,000

0.3

0.3

0.3

0.3

0.3

&lt;---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **February 2007**

## A. Public Water System (PWS) Information

PWS Name:	<b>Peoples Water Service Company of Florida, Inc.</b>		PWS Identification Number	<b>FL 1170527</b>
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive
Number of Service Connections at End of Month:	<b>9,394</b>		Total Population Served at End of Month:	<b>32,879</b>
PWS Owner:	<b>Peoples Water Service Company of Florida, Inc.</b>			
Contact Person:	<b>Mark Cross</b>		Person's Title:	<b>Manager</b>
Contact Person's Mailing Address:	<b>905 Lowndes Avenue</b>	City:	<b>Pensacola</b>	State: <b>Florida</b> Zip Code: <b>32507-0815</b>
Contact Person's Telephone Number:	<b>(850) 455-8552</b>		Contact Person's Fax Number:	<b>(850) 456-1010</b>
Contact Person's E-Mail Address:	<b>MarkCross@PeoplesWaterService.Com</b>			

## B. Water Treatment Plant Information

Plant Name:	<b>Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9</b>		Plant Telephone	<b>(850) 455-8552</b>
Plant Address:	<b>905 Lowndes Avenue</b>	City:	<b>Pensacola</b>	State: <b>Florida</b> Zip Code: <b>32507-0815</b>
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant:	<b>4,860,000</b>			
Plant Category (per subsection 62-699.310(4), F.A.C.):	<b>V</b>		Plant Class (per subsection 62-699.310(4), F.A.C.):	<b>C</b>
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	<b>Theo Deleon</b>	<b>10012</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>
Other Operators:	<b>Mark Cross</b>	<b>7169</b>	<b>A</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Jim Ogle</b>	<b>4927</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Dan Middlebrook</b>	<b>8445</b>	<b>C</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>
	<b>Russ Barrett</b>	<b>12704</b>	<b>B</b>	<b>Mon - Fri 8 :00am - 5:00 pm/weekend visit</b>
	<b>Chester Horton</b>	<b>NA</b>	<b>NA</b>	<b>Mon - Fri 8 :00am - 5:00 pm</b>

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

  
Signature and Date

**Theo Deleon**  
Printed or Typed Name

**# 10012**  
License Number

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 3**

III. Daily Data for the Month Year of: **February 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations									UV Dose		Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm²	Minimum UV Dose Required, mW-sec/cm²				
1	X	0.0	0											0.4	0	
2	X	0.0	0											0.4	0	
3	X	23.9	1,475,000											0.6	0	
4	X	0.0	0											0.5	0	
5	X	17.9	1,119,000											0.5	0	
6	X	0.0	0											0.5	0	
7	X	16.1	1,000,000											0.4	0	
8	X	0.0	0											0.5	0	
9	X	9.5	572,000											0.5	0	
10	X	24.5	1,475,000											0.5	0	
11	X	0.0	0											0.6	0	
12	X	20.4	1,273,000											0.6	0	
13	X	0.0	0											0.6	0	
14	X	13.2	819,000											0.5	0	
15	X	0.0	0											0.5	0	
16	X	0.0	0											0.4	0	
17	X	24.0	1,495,000											0.6	0	
18	X	0.0	0											0.5	0	
19	X	20.2	1,273,000											0.5	0	
20	X	0.0	0											0.6	0	
21	X	4.9	299,000											0.6	0	
22	X	0.0	0											0.6	0	
23	X	0.0	0											0.5	0	
24	X	23.7	1,482,000											0.5	0	
25	X	0.0	0											0.5	0	
26	X	19.1	1,184,000											0.5	0	
27	X	0.0	0											0.6	0	
28	X	14.8	923,000											0.5	0	
			14,445,000													
			515,893	LOWEST RESIDUAL 0.4					days checked by operator 28							
			1,531,000	DAYS IN MONTH 28												

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 28

days checked by operator 28

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 4**

III. Daily Data for the Month Year of: **February 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	22.0	1,195,000										0.4	0
2	X	0.0	0										0.4	0
3	X	3.4	197,000										0.6	0
4	X	11.8	652,000										0.5	0
5	X	0.0	0										0.5	0
6	X	17.8	968,000										0.5	0
7	X	0.0	0										0.4	0
8	X	22.3	1,216,000										0.5	0
9	X	0.0	0										0.5	0
10	X	0.0	0										0.5	0
11	X	25.2	1,220,000										0.6	0
12	X	0.0	0										0.6	0
13	X	17.2	943,000										0.6	0
14	X	0.0	0										0.5	0
15	X	22.2	1,220,000										0.5	0
16	X	0.0	0										0.4	0
17	X	7.8	440,000										0.6	0
18	X	0.0	0										0.5	0
19	X	7.7	430,000										0.5	0
20	X	0.0	0										0.6	0
21	X	18.8	997,000										0.6	0
22	X	16.0	874,000										0.6	0
23	X	0.0	0										0.5	0
24	X	0.0	0										0.5	0
25	X	4.9	281,000										0.5	0
26	X	0.0	0										0.5	0
27	X	0.0	0										0.6	0
28	X	0.0	0										0.5	0

Grand Total	10,785,000
Minimum	385,179
Maximum	1,372,000

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 28

days checked by operator: 28



Plant Name: **Well # 5**

February 2007

Type of Disinfectant Residual Maintained in	<input checked="" type="checkbox"/> Free Chlorine	<input type="checkbox"/> Combined Chlorine (Chloramines)	<input type="checkbox"/> Chlorine Dioxide
---	---	--	---

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 28

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527** Plant Name: **Well # 8**

III. Daily Data for the Month Year of: **February 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	7.0	273,000										0.4	0
2	X	0.0	0										0.4	0
3	X	16.6	657,000										0.6	0
4	X	0.4	0										0.5	0
5	X	24.2											0.5	0
6	X	0.0	0										0.5	0
7	X	7.9	273,000										0.4	0
8	X	0.0	0										0.5	0
9	X	0.0	0										0.5	0
10	X	19.6	776,000										0.5	0
11	X	4.9	190,000										0.6	0
12	X	21.9	859,000										0.6	0
13	X	0.0	0										0.6	0
14	X	4.3	193,000										0.5	0
15	X	0.0	0										0.5	0
16	X	0.0	0										0.4	0
17	X	20.5	685,000										0.6	0
18	X	0.3	0										0.5	0
19	X	22.7	787,000										0.5	0
20	X	0.0	0										0.6	0
21	X	0.0	0										0.6	0
22	X	7.8	305,000										0.6	0
23	X	0.0	0										0.5	0
24	X	17.2	682,000										0.5	0
25	X	0.0	0										0.5	0
26	X	23.1	895,000										0.5	0
27	X	0.0	0										0.6	0
28	X	0.0	0										0.5	0

Total	7,540,000
Average	269,286
Maximum	965,000

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 28

days checked by operator 28

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: **FL 1170527**

Plant Name: **Well # 9**

III. Daily Data for the Month Year of: **February 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations								UV Dose		Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow Rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>			
1	X	18.9	1,171,000										0.4	0	
2	X	20.7	1,291,000										0.4	0	
3	X	0.0	0										0.6	0	
4	X	23.6	1,484,000										0.5	0	
5	X	0.0	0										0.5	0	
6	X	23.6	1,487,000										0.5	0	
7	X	0.0	0										0.4	0	
8	X	18.8	1,157,000										0.5	0	
9	X	20.7	1,268,000										0.5	0	
10	X	0.0	0										0.5	0	
11	X	24.6	1,500,000										0.6	0	
12	X	0.0	0										0.6	0	
13	X	21.8	1,453,000										0.6	0	
14	X	0.0	0										0.5	0	
15	X	18.8	1,168,000										0.5	0	
16	X	20.1	1,250,000										0.4	0	
17	X	0.0	0										0.6	0	
18	X	23.1	1,441,000										0.5	0	
19	X	0.0	0										0.5	0	
20	X	23.3	1,292,000										0.6	0	
21	X	0.0	0										0.6	0	
22	X	19.7	1,237,000										0.6	0	
23	X	21.3	1,333,000										0.5	0	
24	X	0.0	0										0.5	0	
25	X	23.5	1,475,000										0.5	0	
26	X	0.0	0										0.5	0	
27	X	24.7	1,550,000										0.6	0	
28	X	0.0	0										0.5	0	

**21,624,000**

**772,286**

**1,567,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 28

days checked by operator 28

**MONTHLY OPEI N REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS**
**AT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished-Water Production for the Month Year of:

**February 2007**

 Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

 Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Permitted Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	NA										6,792,000
	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	0	1,195,000	0	273,000	1,171,000						2,639,000
	0	0	832,000	0	1,291,000						2,123,000
	1,475,000	197,000	0	657,000	0						2,329,000
	0	652,000	375,000	0	1,484,000						2,511,000
	1,119,000	0	155,000	965,000	0						2,239,000
	0	968,000	0	0	1,487,000						2,455,000
	1,000,000	0	1,977,000	273,000	0						2,250,000
	0	1,216,000	0	0	1,157,000						2,373,000
	572,000	0	0	0	1,268,000						1,840,000
	1,531,000	0	0	776,000	0						2,307,000
	0	1,372,000	0	190,000	1,567,000						3,129,000
	1,273,000	0	0	859,000	0						2,132,000
	0	943,000	0	0	1,453,000						2,396,000
	819,000	0	1,107,000	193,000	0						2,119,000
	0	1,220,000	0	0	1,168,000						2,388,000
	0	0	992,000	0	1,250,000						2,242,000
	1,495,000	440,000	0	685,000	0						2,620,000
	0	0	1,138,000	0	1,441,000						2,579,000
	1,273,000	430,000	0	787,000	0						2,490,000
	0	0	847,000	0	1,292,000						2,139,000
	299,000	997,000	1,275,000	0	0						2,571,000
	0	874,000	0	305,000	1,237,000						2,416,000
	0	0	871,000	0	1,333,000						2,204,000
	1,482,000	0	0	682,000	0						2,164,000
	0	281,000	1,224,000	0	1,475,000						2,980,000
	1,184,000	0	0	895,000	0						2,079,000
	0	0	1,280,000	0	1,550,000						2,830,000
	923,000	0	1,338,000	0	0						2,259,000
Total	14,445,000	10,785,000	13,409,000	7,540,000	21,624,000						67,803,000
Avg.	515,893	385,179	478,893	269,286	772,286						2,421,536
Max.	1,531,000	1,372,000	1,977,000	965,000	1,567,000						3,250,000

0.4

0.4

0.4

0.4

0.4

&lt;---lowest CI



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See last page for instructions.

I. General Information for the Month/Year of: **January 2007**

## A. Public Water System (PWS) Information

PWS Name:	Peoples Water Service Company of Florida, Inc.			PWS Identification Number	FL 1170527
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient	<input type="checkbox"/> Transient Non-Community	<input type="checkbox"/> Consecutive	
Number of Service Connections at End of Month:	9,442			Total Population Served at End of Month:	33,047
PWS Owner:	Peoples Water Service Company of Florida, Inc.				
Contact Person:	Mark Cross		Person's Title: Manager		
Contact Person's Mailing Address:	905 Lowndes Avenue	City: Pensacola	State: Florida	Zip Code: 32507-0815	
Contact Person's Telephone Number:	(850) 455-8552		Contact Person's Fax Number: (850) 456-1010		
Contact Person's E-Mail Address:	MarkCross@PeoplesWaterService.Com				

## B. Water Treatment Plant Information

Plant Name:	Well # 3, Well # 4, Well # 5, Well # 8, and Well # 9			Plant Telephone (850) 455-8552
Plant Address:	905 Lowndes Avenue	City: Pensacola	State: Florida	Zip Code: 32507-0815
Type of Water Treated by Plant:	<input checked="" type="checkbox"/> Raw Ground Water		<input type="checkbox"/> Purchased Finished Water	
Permitted Maximum Day Operating Capacity of Plant,	4,860,000			
Plant Category (per subsection 62-699.310(4), F.A.C.):	V		Plant Class (per subsection 62-699.310(4), F.A.C.):	C
Licensed Operators	Name	License Number	License Class	Day(s)/Shift(s) Worked
Lead/Chief Operator:	Theo Deleon	10012	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
Other Operators:	Mark Cross	7169	A	Mon - Fri 8 :00am - 5:00 pm
	Jim Ogle	4927	C	Mon - Fri 8 :00am - 5:00 pm
	Dan Middlebrook	8445	C	Mon - Fri 8 :00am - 5:00 pm
	Russ Barrett	12704	B	Mon - Fri 8 :00am - 5:00 pm/weekend visit
	Chester Horton	NA	NA	Mon - Fri 8 :00am - 5:00 pm

## II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operations records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore, I agree to provide these additional operations records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Theo Deleon 2/7/07  
Signature and Date

Theo Deleon  
Printed or Typed Name

# 10012  
License Number



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: FL 1170527

Plant Name: Well # 3

III. Daily Data for the Month/Year of: January 2007

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	20.1	1,385,000										0.6	0
2	X	0.0	0										0.6	0
3	X	25.3	1,487,000										0.5	0
4	X	0.0	0										0.6	0
5	X	4.5	276,000										0.6	0
6	X	23.0	1,454,000										0.6	0
7	X	0.0	0										0.5	0
8	X	20.3	1,282,000										0.5	0
9	X	15.0	871,000										0.4	0
10	X	22.9	1,506,000										0.4	0
11	X	0.0	0										0.6	0
12	X	5.4	347,000										0.6	0
13	X	22.9	1,438,000										0.6	0
14	X	17.3	1,074,000										0.5	0
15	X	19.2	1,204,000										0.6	0
16	X	14.5	905,000										0.6	0
17	X	22.7	1,416,000										0.4	0
18	X	4.6	283,000										0.8	PBWN
19	X	0.0	0										0.5	0
20	X	24.4											0.7	0
21	X	19.8	1,218,000										0.6	0
22	X	17.2	1,070,000										0.7	0
23	X	0.0	0										0.6	0
24	X	17.6	1,101,000										0.5	0
25	X	0.0	0										0.5	0
26	X	0.0	0										0.5	0
27	X	23.6	1,483,000										0.6	0
28	X	0.0	0										0.6	0
29	X	21.1	1,324,000										0.7	0
30	X	21.2	1,313,000										0.5	0
31	X	24.2	1,508,000										0.6	0

25,484,000

822,065

1,541,000

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator 31

Plant Name: Well # 4

**January 2007**☒ Free Chlorine    ☐ Chlorine Dioxide    ☐ Ozone    ☐ Combined Chlorine (Chloramines)    ☐ Ultraviolet Radiation    ☐ Other:

[1]Chlorine Dioxide

[illegible]

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier

Number: FL 1170527

Plant Name: Well # 5

III. Daily Data for the Month Year of:

January 2007

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C if Applicable	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	0.0	0										0.6	0
3	X	0.0	0										0.5	0
4	X	0.0	0										0.6	0
5	X	0.0	0										0.6	0
6	X	0.0	0										0.6	0
7	X	0.0	0										0.5	0
8	X	0.0	0										0.5	0
9	X	4.8	173,000										0.4	0
10	X	0.0	0										0.4	0
11	X	0.0	0										0.6	0
12	X	0.0	0										0.6	0
13	X	0.0	0										0.6	0
14	X	0.0	0										0.5	0
15	X	0.0	0										0.6	0
16	X	0.0	0										0.6	0
17	X	0.0	0										0.4	0
18	X	0.0	0										0.8	PBWN
19	X	0.0	0										0.5	0
20	X	0.0	0										0.7	0
21	X	0.0	0										0.6	0
22	X	0.0	0										0.7	0
23	X	0.0	0										0.6	0
24	X	0.0	0										0.5	0
25	X	19.5	975,000										0.5	0
26	X	0.0	0										0.5	0
27	X	20.5	959,000										0.6	0
28	X	0.0	0										0.6	0
29	X	17.8	1,029,000										0.7	0
30	X	0.0	0										0.5	0
31	X	21.8											0.6	0

4,266,000

137,613

1,130,000

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator 31

# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier Number: **FL 1170527**

Plant Name: **Well # 8**

III. Daily Data for the Month Year of: **January 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, If Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	23.1	899,000										0.6	0
2	X	0.0	0										0.6	0
3	X	21.7	831,000										0.5	0
4	X	0.0	0										0.6	0
5	X	19.1	754,000										0.6	0
6	X	13.8	550,000										0.6	0
7	X	0.0	0										0.5	0
8	X	25.0	985,000										0.5	0
9	X	0.0	0										0.4	0
10	X	17.6	693,000										0.4	0
11	X	17.1	674,000										0.6	0
12	X	15.7	624,000										0.6	0
13	X	16.2	647,000										0.6	0
14	X	0.0	0										0.5	0
15	X	24.6	965,000										0.6	0
16	X	0.0	0										0.6	0
17	X	18.2	712,000										0.4	0
18	X	16.7	662,000										0.8	PBWN
19	X	18.4	726,000										0.5	0
20	X	14.5	576,000										0.7	0
21	X	0.0	0										0.6	0
22	X	25.4	999,000										0.7	0
23	X	0.0	0										0.6	0
24	X	7.2	289,000										0.5	0
25	X	0.0	0										0.5	0
26	X	0.0	0										0.5	0
27	X	16.9	660,000										0.6	0
28	X	0.0	0										0.6	0
29	X	23.3	913,000										0.7	0
30	X	0.0	0										0.5	0
31	X	0.0	0										0.6	0

**13,154,000**

**424,323**

**994,000**

LOWEST RESIDUAL 0.4

DAYS IN MONTH 31

days checked by operator 31



# MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identifier: **Number: FL 1170527** Plant Name: **Well #9**

III. Daily Data for the Month Year of: **January 2007**

Means of Achieving Four-Log Virus ☒ Free Chlorine ☐ Chlorine Dioxide ☐ Ozone ☐ Combined Chlorine (Chloramines) ☐ Ultraviolet Radiation ☐ Other:

Type of Disinfectant Residual Maintained in ☒ Free Chlorine ☐ Combined Chlorine (Chloramines) ☐ Chlorine Dioxide

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow Rate, gpd	Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/L	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	mg-min/L	Temp. of Water, °C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm <sup>2</sup>	Minimum UV Dose Required, mW-sec/cm <sup>2</sup>	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
1	X	0.0	0										0.6	0
2	X	19.7	1,241,000										0.6	0
3	X	5.2	319,000										0.5	0
4	X	14.6	902,000										0.6	0
5	X	22.6	1,429,000										0.6	0
6	X	0.0	0										0.6	0
7	X	23.8	1,471,000										0.5	0
8	X	0.0	0										0.5	0
9	X	24.6	1,546,000										0.4	0
10	X	4.6	278,000										0.4	0
11	X	22.7	1,441,000										0.6	0
12	X	22.7	1,431,000										0.6	0
13	X	5.0	311,000										0.6	0
14	X	22.5	1,398,000										0.5	0
15	X	6.8	409,000										0.6	0
16	X	23.0	1,445,000										0.6	0
17	X	0.0	0										0.4	0
18	X	24.4	1,523,000										0.8	PBWN
19	X	23.0	1,458,000										0.5	0
20	X	5.0	305,000										0.7	0
21	X	21.9	1,348,000										0.6	0
22	X	0.0	0										0.7	0
23	X	25.8	1,500,000										0.6	0
24	X	0.0	0										0.5	0
25	X	21.0	1,301,000										0.5	0
26	X	21.8	1,379,000										0.5	0
27	X	0.0	0										0.6	0
28	X	23.0	1,466,000										0.6	0
29	X	0.0	0										0.7	0
30	X	18.7	1,081,000										0.5	0
31	X	0.0	0										0.6	0
			<b>25,105,000</b>											
			<b>809,839</b>											
			<b>1,623,000</b>											

LOWEST RESIDUAL 0.4  
DAYS IN MONTH 31

days checked by operator 31



**MONTHLY OPERATION REPORT FOR SUMMATION OF FINISHED-WATER PRODUCTION BY CWS THAT HAVE MULTIPLE TREATMENT PLANTS**

Daily Finished-Water Production for the Month Year of: **January 2007**

Community Water System (CWS) Name: **Peoples Water Service Company of Florida, Inc.**

Public Water System (PWS) Identification **FL 1170527**

	Plant 1 Name:	Plant 2 Name:	Plant 3 Name:	Plant 4 Name:	Plant 5 Name:	Plant 6 Name:	Plant 7 Name:	Plant 8 Name:	Plant 9 Name:	Plant 10 Name:	
	Well # 3	Well # 4	Well # 5	Well # 8	Well # 9	NA	NA	NA	NA	NA	
Day of Month	Estimated Maximum Day Operating Capacity of Each Plant, gallons per day (or GPM X 1440)										Total
	1,440,000	2,160,000	1,440,000	1,440,000	1,440,000	NA	NA	NA	NA	NA	6,792,000
1	Net Quantity of Finished Water Produced by Each Plant, gallons										Total
	1,385,000	0	0	899,000	0						2,284,000
	0	1,014,000	0	0	1,241,000						2,255,000
	1,487,000	0	0	831,000	319,000						2,637,000
	0	1,220,000	0	0	902,000						2,122,000
	276,000	0	0	754,000	1,429,000						2,459,000
	1,454,000	0	0	550,000	0						2,004,000
	0	1,095,000	0	0	1,471,000						2,566,000
	1,282,000	0	0	985,000	0						2,267,000
	871,000	0	173,000	0	1,546,000						2,590,000
	1,506,000	0	0	693,000	278,000						2,477,000
	0	0	0	674,000	1,441,000						2,115,000
	347,000	0	0	624,000	1,431,000						2,402,000
	1,436,000	0	0	647,000	311,000						2,394,000
	1,074,000	0	0	0	1,398,000						2,472,000
	1,204,000	0	0	965,000	409,000						2,578,000
	905,000	0	0	0	1,445,000						2,350,000
	1,416,000	0	0	712,000	0						2,128,000
	283,000	0	0	662,000	1,523,000						2,468,000
	0	0	0	726,000	1,458,000						2,184,000
	1,541,000	0	0	576,000	305,000						2,422,000
	1,218,000	0	0	0	1,348,000						2,566,000
	1,070,000	0	0	994,000	0						2,064,000
	0	921,000	0	0	1,623,000						2,544,000
	1,101,000	0	0	289,000	0						1,390,000
	0	1,266,000	975,000	0	1,301,000						3,542,000
	0	0	0	0	1,379,000						1,379,000
	1,483,000	0	959,000	660,000	0						3,102,000
	0	439,000	0	0	1,466,000						1,905,000
	1,324,000	0	1,029,000	913,000	0						3,266,000
	1,313,000	858,000	0	0	1,081,000						3,252,000
	1,508,000	0	1,130,000	0	0						2,638,000
Total	25,484,000	6,813,000	4,266,000	13,154,000	25,105,000						74,822,000
Avg.	822,065	219,774	137,613	424,323	809,839						2,413,613
Max.	1,541,000	1,266,000	1,130,000	994,000	1,623,000						3,542,000

0.4

0.4

0.4

0.4

0.4

<--lowest CI

## D.E.P Surveys



# Florida Department of Environmental Protection

Northwest District  
160 Governmental Center  
Pensacola, Florida 32502-5794

Charlie Crist  
Governor

Jeff Kottkamp  
Lt. Governor

Michael W. Sole  
Secretary

September 19, 2007

SENT VIA EMAIL  
(markcross@peopleswaterservice.com)

Mr. Mark Cross  
Peoples Water Service  
905 Lowndes Avenue  
Pensacola, Florida 32507

Dear Mr. Cross:

A compliance inspection of Peoples Water Service (PWS ID No. 1170527) was completed on September 13, 2007. The assistance provided by Mr. Theo DeLeon, Mr. Richard Emmons, and Mr. Dennis Roscom during the inspection was greatly appreciated.

The purpose of this inspection is to evaluate the capability of the water system to continually produce safe drinking water. Public water systems in this state are regulated by the Department under the Florida Safe Drinking Water Act as promulgated by Florida Administrative Code Chapters 62-550, 555 and 560. The Department determines compliance with these regulations.

At the time of this inspection no significant deficiencies were noted. The system is well maintained and in good operating condition.

If you have any questions, please call me at (850) 595-8300, extension 1142 (or email at [karianne.pezdirtz@dep.state.fl.us](mailto:karianne.pezdirtz@dep.state.fl.us)).

Sincerely,

Karianne Pezdirtz  
Environmental Specialist  
Potable Water Section

cc: Theo DeLeon, Water Production Supervisor ([theodeleon@peopleswaterservice.com](mailto:theodeleon@peopleswaterservice.com))

## Compliance Inspection Form

Page 1

<b>Water system:</b> PEOPLES WATER SERVICE	<b>System PWS #:</b> 1170527	<b>Date of inspection:</b> 9/13/2007
<b>System address:</b> 907 LOWME AVE	<b>City:</b> PENSACOLA	<b>State:</b> FL <b>Zip:</b> 32507
<b>System phone:</b> 850.455.8552	<b>Cell:</b> 850.221.9452 (Theo)	
<b>Fax number:</b> 850.456.1010	<b>Email:</b> theodeleon@peopleswaterservice.com	
<b>Owner name:</b> MR. MARK CROSS	<b>Owner title:</b> GENERAL MANAGER	
<b>Owner address:</b> POST OFFICE BOX 4815	<b>City:</b> PENSACOLA	<b>State:</b> FL <b>Zip:</b> 32507
<b>Owner phone:</b> 850.455.8552	<b>Cell:</b> 850.221.5124	
<b>Fax number:</b> 850.456.1010	<b>Email:</b> markcross@peopleswaterservice.com	
<b>Operator required?</b> <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No (If "No", Operator sections not applicable)		
<b>Operator name:</b> THEO DELEON		
<b>Operator Email:</b> THEODELEON@PEOPLESWATERSERVICE.COM	<b>Phone:</b> 850.455.8552 x211	<b>Fax:</b> 850.456.1010
S=Satisfactory U=Unsatisfactory ~ =Not Applicable * =See comment below		

SOURCE WELL INFORMATION	Well Number	3	4	5	8	9		
	Well head sealed? (Pad/conduit/openings)	S	S	S	S	S		
	Well casing 12" above grade?	S	S	S	S	S		
	Casing vent compliant? (2003)	S	S	S	S	S		
	Check valve compliant?	S	S	S	S	S		
	Tap Compliant? (Smooth/12" high/pre-check)	S	S	S	S	S		
	Flow measurable?	S	S	S	S	S		
	Security measures compliant?	S	S	S	S	S		
	O & M manual compliant?	S	S	S	S	S		
	CI storage compliant (no organics/acid/sun)	S	S	S	S	S		
TREATMENT	Spare chlorinator compliant?	S	S	S	S	S		
	Loss of chlorine alarm compliant?	S	S	S	S	S		
	Treated sample tap provided?	S	S	S	S	S		
	Security measures compliant?	S	S	S	S	S		
	HYPO	CI solution NSF approved?	S	S	S	S	S	
		Solution vat compliant? (covered/etc)	S	S	S	S	S	
		Safety: (Gloves/Apron/Eyewash/etc)	S	S	S	S	S	
	GAS	CI room compliant? (separate/ventilation)	S	S	S	S	S	
		Scales compliant?	S	S	S	S	S	
		Auto switchover provided?	S	S	S	S	S	
OTHER	Safety: (SCBA/Gloves/Ammunition/Peric HW)	S	S	S	S	S		
	Aeration	~	~	~	~	~		
	pH adjustment	S	S	S	S	S		
	Orthophosphate	S	S	S	S	S		
STORAGE	Other: GAC	S	~	S	~	~		
	Tank Number	GBE	Wyn	Wel	OC	GBG		
	Inspections compliant? (annual/yr)	~	S	S	S	S		
	Overflow/Vents compliant? (elevated)	~	S	S	S	S		
	Pressure relief valve provided? (hydro)	~	~	~	~	~		
Security measures compliant?	~	S	S	S	S			

DISTRIBUTION	Water system map compliant?	Yes
	Flushing of dead ends compliant?	Yes
	Valve maintenance compliant?	Yes
	Chlorine residual > 0.2 mg/L	Yes
	Number of high service pumps?	6
	High service pumps functional?	Yes
	CCC devices tested annually?	Yes
	Flow meter accuracy checked?	Yes
	ERP, PbCu, DBP, and CCC Plans?	Yes
	In use permits have clearance?	Yes
OPERATOR MANAGEMENT	Operator visits compliant?	Yes
	Plant checked 5 times per week?	Yes
	MORs submittal compliant?	Yes

FOLLOW-UP TO LAST INSPECTION OR SURVEY	
Last inspection fully compliant? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No (see below)	
Number of deficiencies last cited?	1
Were any of the deficiencies "repeat"?	No
Response from system submitted?	Yes
Have deficiencies been addressed?	Yes

MONITORING SCHEDULE		
CHEMICAL	ANALYSIS DATE	NEXT DUE
Nitrate/Nitrite	3-06	2007
Inorganics	2-05	2008
Secondaries (5)	2-05	2008
VOCs	4-05	2008*
Rads	3-02	2008
SOC	3-05/waiver	2008
UOCs	6-96	susp
THM/HAA5s ann	7-07	2008
Asbestos	6-02	2011
Pb/Cu	2007	2010
*Qtrly for VOCs for GAC wells		

FIELD SAMPLING RESULTS	Plant Cl (mg/L)	S	S	S	S	S		Distribution Cl (mg/L) / pH	0.62/6.9	North Loop Road
	Plant pH	S	S	S	S	S			0.39/7.1	Bayshore Dr.

COMMENTS	THE GULF BEACH ELEVATED TANK IS NO LONGER CONNECTED TO THE SYSTEM.
----------	--

**REMARKS AND RECOMMENDATIONS****System Notes**

1. The flow meter at Well #9 needs to be repaired or replaced. The system is investigating options since this flow meter is relatively new.
2. The Weller ground storage tank was inspected and washed out December 2006; however, the exterior was not painted at that time. The system is working on having the exterior painted.
3. The air relief at Well #8 is not closing tight and will be replaced soon.
4. The system will be obtaining a GPS unit soon to locate valves, hydrants, service meters, and mains and converting to a GIS-based mapping system.

**Emergency Replacement of Critical Components**

The Department would like to take this opportunity to inform that any replacement of a water system component which results in a change in the treatment or capacity may require a permit prior to installation.

Consequently, if the failure of a critical water system component (such as a high service pump) occurs, ensure that replacement is like-for-like (same capacity, horsepower, etc). Otherwise, if the replacement will result in an increase or decrease in capacity, a permit must first be obtained from this office.

**Stage 2 Disinfectants & Disinfection Byproducts Rule**

On January 4, 2006 the final Stage 2 D&DBP Rule was published in the Federal Register. The USEPA will retain primacy of this rule during its initial stages. All community, nontransient noncommunity, and consecutive water systems, regardless of whether they retreat, will be required to meet the requirements of this rule. You may obtain information concerning the new rule from EPA's website at <http://www.epa.gov/ogwdw/disinfection/stage2/>. The site also includes a guidance manual for conducting the initial distribution system evaluation, requirements for 40/30 certification, requirements for very small system (VSS) waivers (for systems <500 population), and appropriate schedules for completing key items. It is highly recommended that you visit this site frequently as new items are being added on a regular basis.

➤ Please contact EPA via email at: [Region4\\_Stage2@epa.gov](mailto:Region4_Stage2@epa.gov).

**Storm Tracker Website**

In July 2005, the new StormTracker website became operational for online reporting of post-storm water (and wastewater) system status. Originally, only select systems (population served > 3300) were captured in this application. However, all communities are being entered into StormTracker for this year, and all facilities should be included at this time. It is important to visit/update this site whenever the status of your facility has changed, or if you have other information that needs to be updated (before, during, or after a storm). Our state staff and emergency operators will be using this data to better assist you during storms and recovery.

To enter the status and other important information regarding your system, please go to the following site:  
<http://tlhdwf2.dep.state.fl.us/stormtracker/facility.asp>

Username: florida

Password: storm

If your facility ever requires immediate assistance to ensure public health & safety, please contact your County Emergency Operation Center (EOC) (info at [http://www.floridadisaster.org/County\\_EM/county\\_list.htm](http://www.floridadisaster.org/County_EM/county_list.htm)) or the State Warning Point (SWP) at (800) 320-0519. StormTracker entry does not replace required SWP reporting; any normally reportable emergencies, storm-related or not, must still be reported to the SWP.



**Emergency Response Plan (ERP) – Fine Tuning and Maintaining**

Now that your water system's ERP has been completed, the Department would like this opportunity to discuss refinements and what should be included in the system's plan now, and in the future. This guidance is obtained directly from American Water Works Association's *Emergency Planning for Water Utilities – Manual 19*. The plan should be a working document that is used before, during, and after a disaster. The plan is the logical outgrowth of, and developed from, the hazard summary, vulnerability analysis, and implemented mitigation actions. The following sections describe basic information that should be contained in a plan. For each of the elements required by FAC 62-555.350 (15), we recommend that your plan, at a minimum, address the following:

1. **Communication Chart:** A communication chart should list all utility staff (and alternates) who will direct emergency response actions. Others to include on the chart include additional system personnel, other utilities, regulation agencies, priority customers, and media contacts for general public notification.
2. **Agreements with Other Agencies or Organization:** This particular element of an ERP may be the least understood and implemented. The ERP should include any written agreements with other agencies, utilities, or response organizations. Include interconnection agreements with other systems if they are in force. Particularly important are contracts with private suppliers and contractors. Usually, these contracts detail the nature, conditions, and cost of contracted services. Most contracts typically have an expiration date, so they must be updated periodically. One important administrative tip -- try to get all service contracts on the same renewal schedule and designate a person to confirm they are updated before expiration. Some utilities require 24-hour access and emergency phone numbers from their suppliers as part of their annual bidding package and contract.
3. **Disaster-Specific Plans:** Specific emergency preparedness plans should be developed for most likely disasters. The plan should include the following disasters: vandalism or sabotage; a drought; a hurricane; a structure fire; and if applicable, a flood, a forest or brush fire, and a hazardous material release. Each disaster-specific preparedness/response plan shall incorporate the results of a vulnerability assessment; shall include actions and procedures, and identify equipment, that can obviate or lessen the impact of such a disaster; and shall include plans and procedures that can be implemented, and identify equipment that can be utilized, in the event of such a disaster. The items included in a specific disaster plan are based on the hazard summary, the vulnerability analysis, and mitigation actions.
  - a. **Hazard Summary:** The plan must include the results of the hazard summary for each disaster.
  - b. **Vulnerability analysis:** Provide specific estimates of damage to system components as determined in the vulnerability analysis.
  - c. **Mitigation actions:** List the mitigation and preparedness actions that should be implemented to minimize hazard impacts.
  - d. **Storm Tracker Reporting:** Storm Tracker is the statewide tracking program to track water system's status after a hurricane or similar disaster. As such, instructions for updating Storm Tracker should be included in a system's ERP. Visit <http://tlhdwf2.dep.state.fl.us/stormtracker/default.asp> for more information; and visit <http://tlhdwf2.dep.state.fl.us/stormtracker/facility.asp> to report your system's status after a hurricane or disaster (username: Florida | password: storm).
4. **Standby Power Requirements:** Florida Administrative Code requires that the plan include details about how the water system meets the standby power requirements under subsection 62-555.320(14), F.A.C., and, if applicable, recommendations regarding the amount of fuel to maintain on site, and the amount of fuel to hold in reserve under contracts with fuel suppliers, for operation of auxiliary power sources. To summarize, FAC 62-555.320 (14) requires that each community water system (CWS) serving 350 or more persons (or 150 or more service connections) shall provide standby power for operation of that portion of the system's water source, treatment, and pumping facilities necessary to deliver drinking water meeting all applicable primary or secondary standards at a rate at least equal to the average daily water demand for the system. It also requires, in some circumstances, that automatic power transfer and loss of power alarms be installed. To review the specific requirements visit <http://www.dep.state.fl.us/legal/rules/drinkingwater/62-555.pdf>.
5. **Recommendations regarding the amount of drinking water treatment chemicals to maintain in inventory at treatment plants:** This would include what's normally kept on hand, and how long this inventory would be available if resupply is hindered. Alternative sources of chemicals should also be included.
6. **Boil Water Notice Requirements:** The same boil water notice requirements employed for routine main breaks should be included with the ERP as loss of pressure occurrences following a disaster are probable.

Finally, ensure that the water system has at least one copy of the American Water Works Association's *Emergency Planning for Water Utilities – Manual 19*. To order, visit <http://www.awwa.org/bookstore/> and navigate to *Emergency Planning for Water Utilities – Manual 19*.

INSPECTOR'S SIGNATURE



DATE: September 19, 2007

REVIEWED BY



DATE: September 19, 2007



Jeb Bush  
Governor

# Department of Environmental Protection

Northwest District  
160 Governmental Center  
Pensacola, Florida 32502-5794

Colleen M. Castille  
Secretary

## SENT VIA EMAIL

(mark.cross@telcove.net)

Mr. Mark Cross, District Manager  
Peoples Water Service  
Post Office Box 4815  
Warrington, Florida 32507-0815

Dear Mr. Cross:

A sanitary survey of the Peoples Water Service potable water supply system (PWS ID No. 1170527) was conducted on September 26, 2006. The assistance provided by Mr. Theo Deleon and others during the inspection was greatly appreciated.

The purpose of this survey is to evaluate the capability of the water system to continually produce safe drinking water. Public water systems in this state are regulated by the Department under the Florida Safe Drinking Water Act as promulgated by Florida Administrative Code Chapters 62-550, 555 and 560. The Department determines compliance with these regulations.

One deficiency was identified during the survey as described in the enclosed *Schedule of Deficiencies*. We would appreciate a written response to this report by November 1, 2006, advising us of the actions and time frame you will take to correct the deficiency noted in the Schedule of Deficiencies. Please address the response to me. Recommendations enclosed within the report do not require a written response unless otherwise stated.

If you have any questions regarding the report and/or deficiencies, please contact me at (850) 595-8300 extension 1146 (or e-mail at [toni.touart-rohlke@dep.state.fl.us](mailto:toni.touart-rohlke@dep.state.fl.us)).

Sincerely,

Toni Touart  
Environmental Specialist  
Potable Water Section

TT

Enclosures

Sanitary Survey Report with Photos  
Schedule of Deficiencies  
Map of Water System  
Noted Enclosures

cc: Robert Merritt, Escambia County Health Department ([Robert\\_Merritt@doh.state.fl.us](mailto:Robert_Merritt@doh.state.fl.us))  
Angela Chelette, NFWMD ([Angela.Chelette@nfwmd.state.fl.us](mailto:Angela.Chelette@nfwmd.state.fl.us))

"More Protection. Less Process"



STATE OF FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION  
**SANITARY SURVEY REPORT**  
COMMUNITY SYSTEMS

**SYSTEM AND OWNER INFORMATION**

System Peoples Water Service County Escambia PWS ID # 1170527  
Address 905 Lownde Avenue Zip 32507  
Phone (850) 455-8552 Fax (850) 456-1010 E-mail mark.cross@telcove.net  
Owner Mr. Mark Cross, District Manager Phone (850) 455-8552  
Address Post Office Box 4815, Pensacola, Florida 32507-0815

**INSPECTION AND CONTACT INFORMATION**

Date of this survey September 26, 2006 Date of last survey September 19, 2003  
DEP Representative(s) Toni Touart  
Person(s) Contacted Theo Deleon, John Tindell and Dennis Roscom  
Emergency No. (850) 221-5124 Cell (850) 221-9452 Pager (850) 406-0104 Email theo.deleon@telcove.net

**CERTIFIED OPERATORS AND CERTIFICATION NUMBER**

Theo Deleon B10012, Mark Cross A7169, Jim Ogle C4927, Dan Middlebrook C8445,  
Russell Barrett B12704

**DIRECTIONS TO PLANT OR OFFICE** (Provide general directions to the plant and office.)

Travel west on Gulf Beach Highway to Lownde Avenue. Go right on Lownde, office is on the left.

**SERVICE AREA**

Service Area Characteristics	Rural residential	
	commercial	
Population Served	<u>32,207</u>	Basis <u>SC X 3.5</u>
Service Connections	<u>9,202</u>	% Metered <u>100</u>
Design Capacity (gallons)	<u>7,416,000</u>	
Design Capacity without best well	<u>5,760,000</u>	
Storage Capacity	<u>2,880,000</u>	Avg. Day <u>2,840,432</u>
Max. Day (GPD)	<u>4,278,000</u>	% Design Capacity <u>58</u>
25% Max. Day	<u>1,069,500</u>	% Storage Capacity <u>37</u>

**PERMANENT SOURCES OF RAW WATER:**

☒ Ground How Many Wells 5  
☐ Purchased PWS #'s \_\_\_\_\_  
Purchase Limit (GPD) \_\_\_\_\_  
Avg Purchased (GPD) \_\_\_\_\_

**EMERGENCY MEDIA CONTACT NUMBERS**

Media	Name	Phone Number
Television	WEAR TV	(850) 455-4599
Radio AM	WXBM	(850) 994-5357
Radio FM	WUWF	(850) 474-2327
Newspaper	P'cola News Journal	(850) 435-8500

**EMERGENCY PREPAREDNESS PLAN ON FILE**

Emergency Preparedness Plan On file: ☒ Yes ☐ No ☐ Not Required

The plan includes the following:

☒ Communication Chart ☐ Written Agreements ☒ Disaster Plan  
☒ Standby Power Info ☐ Inventories ☐ Other

Avg. Day Percentage of Auxiliary Supply 49.3

Standby Equipment Operated at Least Monthly? ☒ Yes ☐ No

Any Interconnects ☐ Yes ☒ No

If yes, which systems: \_\_\_\_\_

Comments: \_\_\_\_\_

**TREATMENT IN USE AT THIS PLANT: (CHECK ALL THAT APPLY)**

☒ Filtration - GAC ☐ Iron Removal ☒ pH Adjustment ☒ Chlorination  
☐ UV Disinfection ☐ Softening ☐ Fluoridation ☐ Other \_\_\_\_\_  
☒ Orthophosphate

Any additional treatment is needed? May need GAC at Well 8

For control of what deficiencies? PCE detected.

SOURCE

Well Name or Source	3 (GAC) W	4	5 (GAC)	8	9	Comment
Year Drilled	1982	1983	1951	1971	1988	
Depth Drilled (feet)	258	304	231	240	295	
Drilling Method	Rotary	Rotary	Rotary	Rotary	Rotary	
Length, Outside Casing (feet)	196	180	150	190	218	
Diameter, Outside Casing (inches)	24	24	26	18	24	
Material, Outside Casing	Steel	Steel	Steel	Steel	Steel	
Type of Strainer	SS	SS	SS	SS	SS	
Depth to Top of Strainer	226	184	153	190	218	
Type of Grout	Cement	Cement	Cement	Cement	Cement	
Depth to Static Water Level (feet)	99	90	42	87	110	
Normal Suction Lift (working level-ft)	65	74	65	60	66	
Pump Type	V.T.	V.T.	V.T.	V.T.	V.T.	
Horse Power	100	100	100	75	100	
Normal Yield (GPM)	1300	1300	1080	720	1190	
Capacity(GPM)	1000	1150	1000	1000	1000	
Protection From Surface Water	Yes	Yes	Yes	Yes	Yes	
Is Inundation of Well Possible?	No	No	No	No	No	
Well Ever Been Contaminated?	PCE (GAC)	No	Benzene (GAC)	PCE	No	
Check Valve Present in Line?	Yes	Yes	Yes	Yes	Yes	
Proper Venting?	Yes	Yes	Yes	Yes	Yes	
Motor Accuracy and Year of Test	98%/2006	96%/2006	98% - 2006	100%/2006	97%/2006	
Date of Last Servicing?	1992	1997	1993	1985	1988	
Auxiliary Capability (if yes, list type)	90°		90°	90°	90°	
Manual or Automatic?	manual		manual	manual	manual	
Capacity (GPM)	1000		1000	1000	1000	
Florida Unique ID# (GPS well tag)	AAA6417	AAA6413	AAA6415	AAA6416	AAA6414	
GPS latitude N (accuracy~1m)	30 23 35.945	30 23 34.057	30 24 13.474	30 24 34.606	30 23 40.642	
GPS longitude W (accuracy~1m)	87 16 44.879	87 15 41.196	87 16 26.305	87 16 17.424	87 16 26.244	

Comments: •Well 3 and 5 supply the majority of the water for the system.  
•Well 3 off-line for plant upgrades and replacement of GAC filter media.  
•The GAC Filter from Well 5 may be moved to Well 8 sometime in the future.  
•Plans in works for construction of a new well (Well 10).

**TREATMENT**  
**CHLORINATOR**

PLANT NUMBER (OR NAME)→	Well 3 (GAC)	Well 4	Well 5 (GAC)	Well 8	Well 9
Type of Chlorination	Gas	Gas	Gas	Gas	Gas
Condition of Chlorinator	Good	Good	Good	Good	Good
Capacity (PPD)	20	20	20	20	20
Chlorine Feed Rate (PPD)	8	10	8	8.25	8
Adequate Housing and Security?	Yes				
Associated Well(s) (if any)	Well 3	Well 4	Well 5	Well 8	Well 9
Auxiliary Power Capability?	portable	no	portable	portable	portable
O & M Log/Manual Onsite?		Yes/Yes	Yes/Yes	Yes/Yes	Yes/Yes
Chlorine Residual/pH		0.57/6.8	0.56/7.1	0.81/7.5	0.75/7.8
Chlorine Alarms Functional?	Yes	Yes	tested-passed	tested-passed	Yes
Auto Switchover	Yes	Yes	Yes	Yes	Yes
Dual System	No	No	No	No	No
Evidence of Leaks	No	No	No	No	No
Air-Pack Respirator Adequate?	Kept on truck and at office				
Ammonia Present?	Yes	Yes	Yes	Yes	Yes
Chained Cylinders	Yes	Yes	Yes	Yes	Yes
Proper Ventilation	Yes	Yes	Yes	Yes	Yes
Fitted Wrench	Yes	Yes	Yes	Yes	Yes
Scale Condition	Good	Good	Good	Good	Good
Spare Parts/Backups Operative? <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No    Spare Parts Not Retained <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No More capacity needed? <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No					
Comments on Chlorination:    •System utilizes full SCADA. •Plant 3 is off-line for upgrades.					



STABILIZATION

Is pH control Practiced? Yes

Is a index computed? ☐ Yes ☒ No (if so, check below below)

☐ Langelier ☐ Ryznar ☐ Puckorius ☐ Larson  
☐ Stiff ☐ Odde ☐ Other

Results of index

Chemical(s) used Hydrated lime

FILTERS & FILTRATION

Filter type

Filter media

Filter backwash

Filter backwash water

Filter backwash rate

Filter backwash duration

Filter backwash frequency

Filter backwash volume

Filter backwash pressure

Filter backwash air

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

Filter backwash air volume

Filter backwash air pressure

**PUMPS AND PUMP CONTROLS**

Pump Category						
Pump Number→	Wayne - #1	Wayne #2 (aux.)	Weller #3	Weller #4 (aux.)	Gulf Beach #5	Gulf Beach #6
PUMP TYPE	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal	Centrifugal
MOTOR HP	100	100	100	100	60	60
DATE INSTALLED	1951	1951	1975	1975	2004	2004
CAPACITY (GPM)	1300	1300	1000	1000	1000	1000
AUXILIARY CAPACITY?	No	Auxiliary	No	Auxiliary	Aux. Generator	
PROPER SECURITY?	Yes	Yes	Yes	Yes	Yes	Yes
CONDITION OF PUMP	Good	Good	Good	Good	New	New
MAINT. SCHEDULE	daily	daily	daily	daily	Daily	Daily
DATE LAST SERVICED	2000	2000	2000	2000	New - 2004	New - 2004

**STORAGE FACILITIES:**

TANK NUMBER→	Gulf Beach	Wayne	Weller	Old Corry	Gulf Beach
TYPE (GROUND, ELEVATED, HYDRO)	Elevated	Ground	Ground	Elevated	Ground
YEAR OF CONSTRUCTION	1951	1951	1975	1981*	2004
CAPACITY (GALLONS)	150,000	800,000	1,000,000	330,000	750,000
MATERIAL	Steel	Steel	Concrete	Steel	Fused Metal
GRAVITY DRAIN CAPACITY/DIAMETER	4 hr	8 hr	12 hr	12 hr	8 hr
OVERFLOW STRUCTURES PROPER?	Yes	Yes	Yes	Yes	Yes
BYPASS CAPACITY	~	Yes	Yes	Yes	Yes
COVERED/SCREENED OPENINGS	Yes	No screen	Yes	Yes	No screen
PRESSURE GAUGE	Yes -- also, all tanks are monitored by SCADA				
ON/OFF PRESSURE (PSI)	variable on/off pressures depending on demand				
ALTITUDE VALVE UTILIZED?		N/A	N/A	No	N/A
HGT. TO BOTTOM OF EL. TANK	130'	N/A	N/A	100'	N/A
HGT. TO MAX. WTR. LEVEL (FT)	148'	28'	35'	130'	29'
DATE OF LAST ANNUAL INSPECTION		2006	2006	2006	2006
YEAR OF LAST 5-YEAR INSPECTION		2005	2000	2006	New - 2004
YEAR OF LAST WASHOUT		2005	2000	2006	New - 2004

Does system provide fire protection? ☒ Yes ☐ No Security Adequate? ☒ Yes ☐ No Low Level Alarm? ☒ Yes ☐ No  
Does current storage capacity comply with requirements in FAC 62-555? ☒ Yes ☐ No

Comments: \*Weller Tank to be inspected cleaned and painted in 2006.  
\*\*Old Corry Tank re-assembled in 1981. Purchased as used tank.  
\*Gulf Beach elevated tank removed from system in 2004.

## DISTRIBUTION SYSTEM

Material of mains? PVC, AC, Galv. System looped? Yes How many hydrants? ≈550  
Any fire hydrants < 6" lines? ☐ Yes ☒ No ☐ N/A Max. pipe diameter 16" Min. pipe diameter 2"  
General operation pressure ≈52 PSI Lowest pressures ≈36 PSI Location of low pressure west  
Number of dead ends 12 How many without flush hydrants? zero Flushing program? yes  
Number of line valves ≈2000 How often exercised Annually\* Properly Mapped? yes Properly Marked? yes  
System Maps Adequate? yes Any uncleaned permits? yes Any uncleaned and in use? no  
Percent water loss 9.9 Does the system have reuse? no Comments \*Key valves, others every 3 yrs

## CROSS CONNECTION CONTROL

Cross Connection Control Plan Meet Requirements? ☒ Yes ☐ No Comment: \_\_\_\_\_  
Testing Frequency? annual Tracking: ☒ Hard Copy ☒ CPU # of BFDs: ≈350 Hydrant Meters ☒ Lift Stations ☐ WWTP ☐  
Date of Last Audit (commercial or residential): ongoing Name of Certified BFD Tester: Richard Emmons

Chlorine & pH	Remote 1	Remote 2	Remote 3	Remote 4
Chlorine Residual	0.51	0.66	0.46	
pH	7.2	7.2	7.2	
Location	Sherman St.	Raymond St.	Bayshore Dr.	

## Compliance Schedule: The following parameters are due during the year shown.

NO3/NO2	2007	Inorganics	2008	TTHMs/HAA5	2007	SOCs	2008
VOCs	2008	Radiologicals	2008	Secondaries	2008	Pb & Cu	2007

System out of compliance with any of the above parameters? Quarterly sampling for VOCs at Well 3, 5 and 8


Testing Equipment & Reagents ☒ Adequate ☐ Inadequate Comment: \_\_\_\_\_  
Bacteriological Sampling Plan: ☒ Adequate ☐ Inadequate Comment: \_\_\_\_\_  
Disinfection Byproducts Plan: ☒ Adequate ☐ Inadequate Comment: \_\_\_\_\_

## MANAGERIAL/FINANCIAL

How is the system structured? ☐ Investor ☐ Municipal ☒ Private ☐ Cooperative ☒ Other Does the system follow a budget? ☒ Yes ☐ No  
Preventative Maintenance Program in place? ☐ Yes ☒ No Is adequate training provided to water system personnel? ☒ Yes ☐ No  
Comment: \_\_\_\_\_

In the space below, give a rough sketch of the flow diagram of the plant, showing all important parts of the plant (not to scale):

**System Operation Overview:** All five wells operate in staged progression based on levels in the elevated storage tank on Old Corry Road (Well 5). Lead wells are rotated daily with Wells 3 and 5 maintaining the predominant lead status to assist in containing existing contaminants in the aquifer. To maintain adequate system pressure in the western 1/3 of the distribution system, during high demand conditions, a remote pressure sensor is located at the extreme western end of the distribution system. This sensor relays main pressure data to the SCADA system. The pumping equipment at the ground storage reservoirs on Weller Avenue and Gulf Beach are activated by the SCADA system when pressures fall below the predetermined limit at the remote sensor.

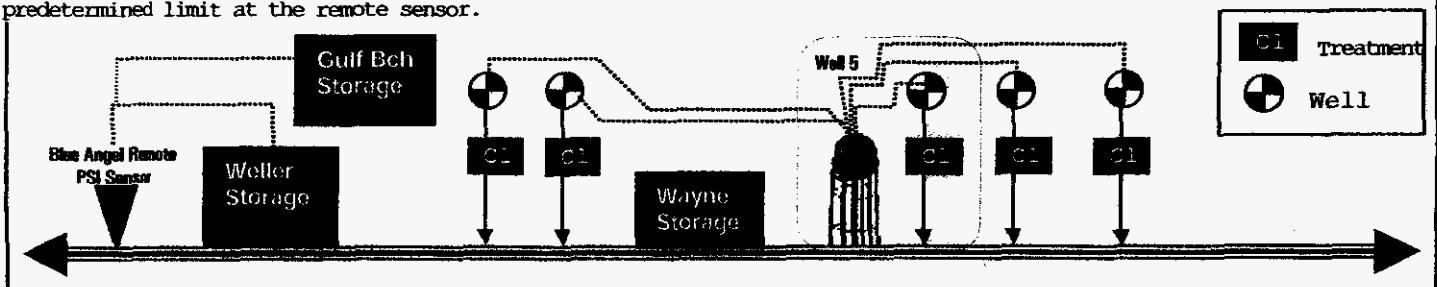

INSPECTOR'S SIGNATURE Lori Jones TITLE ESIII DATE: October 12, 2006

APPROVED BY Scott Smith TITLE ESIII DATE: October 12, 2006

## **SCHEDULE OF DEFICIENCIES**

**PEOPLES WATER SERVICE, INC.**

September 26, 2006 Sanitary Survey

### **DEFICIENCY 1: WELLER TANK LAST CLEANED AND INSPECTED FOR STRUCTURAL AND COATING INTEGRITY IN 2000**

Finished drinking water storage tanks must be checked at least annually to ensure that hatches are closed and screens are in place, must be cleaned at least once every five years to remove biogrowths, calcium or iron/manganese deposits, and sludge for the inside of the tanks and must be inspected for structural and coating integrity at least once every five years by personnel under the responsible charge of a professional engineer licensed in Florida.

REGULATION REFERENCE: FAC Rule 62-555.350(2)

**RECOMMENDED ACTION:** The tank is scheduled to be inspected, cleaned, and painted before the end of 2006. The system has recently entered into a contract to have the tanks inspected every 2 years by a professional tank company. Please ensure that the tank is properly inspected and cleaned before the end of this year. Please advise the Department of a completion date of this 5-year inspection of the tank.

**PEOPLES WATER SERVICE**

September 26, 2006 Sanitary Survey

---

**System Improvements**

The system has computerized the tracking of the backflow prevention assemblies testing and is currently working on computerize mapping of hydrants, valves, and other system components. Additionally, plans are in the works for the construction of a new well (Well 10). It will be determined as to what efforts will be taken to address the tetrachloroethylene (PCE) contamination at Well 8. Discussions have included the move of the GAC filters at Well 5 to the Well 8 site.

System personnel are currently doing annual visual inspections of the storage tanks to ensure hatches are in place and screens are intact. It was recommended that photographs be taken of these events. It is also suggested that separate log sheets be maintained noting date, inspector name, and results of the visual inspection along with the photographs. As noted under the deficiencies, the system has also contracted with a professional tank service to inspect the tanks every two years.

---

**Outstanding Permits**

Our records indicate that the enclosed list of permits (Attachment A) have not been cleared by this office. Please submit a status report for the permits listed with your response to this report.

The 'status' would fall into one of the following categories, A, B, C, D, or E:

- A) not started
- B) started, but not completed
- C) completed, but not in use
- D) completed, and in use
- E) project abandoned (will not be built)

---

**Stage 2 Disinfectants & Disinfection Byproducts Rule**

On January 4, 2006 the final Stage 2 D&DBP Rule was published in the Federal Register. The USEPA will retain primacy of this rule during its initial stages. All community, nontransient noncommunity and consecutive systems, regardless of whether they retreat, will be required to meet the requirements of this rule. You may obtain information concerning the new rule from EPA's website at <http://www.epa.gov/ogwdw/disinfection/stage2/>. The site also includes a guidance manual for conducting the initial distribution system evaluation, requirements for 40/30 certification, requirements for very small system (VSS) waivers (for systems <500 population), and appropriate schedules for completing key items. It is highly recommended that you visit this site frequently as new items are being added on a regular basis. The EPA contact person for this rule is Robert Burns at [Burns.Robert@epamail.epa.gov](mailto:Burns.Robert@epamail.epa.gov) or 404-562-9456.

---



Remarks and Recommendations  
**PEOPLES WATER SERVICE**  
September 26, 2006 Sanitary Survey

### **Precautionary Boil Water Notices**

Precautionary Boil Water Notices (PBWN) are required after loss of system pressure, regardless of the number of customers affected. Subsequent bacteriological sampling is also required to rescind the boil water notice.

#### **Applicable Situations:**

##### **• Zero or Negative Pressure**

• **Low Water Pressure:** Pressures <20 psi (but greater than zero) may not always constitute a PBWN. Use professional judgment (what types of facilities were affected, for how long, and what's the possibility of infiltration?)

• **Water Main Breaks:** PBWN should be issued unless system can demonstrate that an outflow of water was maintained at all times (i.e. water mains repaired with clamping devices while remaining full of pressurized water). Valving off the break to make repairs results in areas of zero pressure, so a PBWN should be issued for customers in the affected area. After Main Break Repairs: Main shall be disinfected in accordance with AWWA standards (C651) and adequate disinfectant residual (0.2mg/L - 4.0mg/L) must be restored as soon as possible. All main breaks require 2 satisfactory days of bacteriological results (if a PBWN is in effect, the notice may be lifted after the 1<sup>st</sup> good set- contingent upon the 2<sup>nd</sup>). If samples in the second set are unsatisfactory, the system shall provide two consecutive days of samples before lifting the notice (on rare occasions, notice may have to be re-issued if it had been lifted on the 1<sup>st</sup> day). Main clearance samples should be clearly marked and submitted with your monthly operation reports (MORs).

• **Planned Interruptions in Service:** Notify customers of water outages/repairs no later than the business day before the work is scheduled. Contact the DEP before taking public water system (PWS) components out of operation for planned repairs or maintenance if finished-water quality may be affected, or if water service will be interrupted to  $\geq 150$  service connections, or  $\geq 350$  people, or any one service connection for > 8 hours, or when issuing a PBWN.

#### **Issuing and Rescinding the Notices:**

- Contact emergency media (TV, radio, newspaper) and/or issue door hangers or flyers if a small residential area is affected.
- Methods of distributing notice should be whatever means necessary and sufficient to reach those affected by the incident.
- Whoever issues the PBWN shall also be responsible for the rescission. Notices can be lifted when satisfactory bacteriological samples are obtained, and DEP has been notified.

For additional information, please consult either of the following:

- Florida Administrative Code (FAC) 62-550, 555 (<http://www.dep.state.fl.us/water/drinkingwater/rules.htm>)
- Florida Department of Health (DOH) "Guidelines for the Issuance of Precautionary Boil Water Notices" (Guidelines) as adopted in Rule 62-555.335 FAC (<http://www.doh.state.fl.us/environment/water/manual/boil.htm>).

You may also contact David Hines at 850-595-8300 extension 1285 or email ([david.hines@dep.state.fl.us](mailto:david.hines@dep.state.fl.us)).

PEOPLES WATER SERVICE

September 26, 2006 Sanitary Survey

### **Submittal of Monthly Operation Reports**

Please note FAC 62-550.730(1)(d) requires the supplier of water to submit monthly operation reports within 10 days after the month of operation. For your convenience, below is a listing of the three ways DEP will accept receipt of Monthly Operation Reports (MORs).

1. **Mail:** Must be post marked on or before the 10<sup>th</sup>
2. **Fax:** Must be faxed on or before the 10<sup>th</sup>
3. **Email:**
  - Must be emailed on or before the 10<sup>th</sup>
  - forms available online at <http://www.dep.state.fl.us/water/drinkingwater/forms.htm>, accepted in Excel, Microsoft Word, or PDF
  - send as an attachment
  - subject line: PWS# and the month
  - send to [epostnwdwfpws@dep.state.fl.us](mailto:epostnwdwfpws@dep.state.fl.us)

Please contact Kevin Holler at (850) 595-8300 extension 1200 if you have any questions.

### **StormTracker Website**

In July 2005, the new StormTracker website became operational for online reporting of post-storm drinking water (and wastewater) system status. Originally, only select systems (population served > 3300) were captured in this application. However, all communities are being entered into StormTracker for this year, and all facilities should be there at this time. It is important to visit/update this site whenever the status of your facility has changed, or if you have other information that needs to be updated (before, during, or after a storm). Our state staff and emergency operators will be using this data to better assist you during storms and recovery.

To enter the status and other important information regarding your system, or for more information now, please go to the following site:

<http://tlhdwf2.dep.state.fl.us/stormtracker/facility.asp>

Username: **florida**

Password: **storm**



Should your facility ever require immediate assistance to ensure public health & safety, please contact your County Emergency Operation Center (EOC) (info at [http://www.floridadisaster.org/County\\_EM/county\\_list.htm](http://www.floridadisaster.org/County_EM/county_list.htm)) or the State Warning Point (SWP) at (800) 320-0519. StormTracker entry does not replace required SWP reporting; any normally-reportable emergencies, storm-related or not, still need to go through the SWP.

**PEOPLES WATER SERVICE**  
September 26, 2006 Sanitary Survey**Gas Chlorine Rooms**

The system is an older system with the newest plant being built in 1988. As such, they do not meet current requirements as outlined in Recommended Standards For Water Works (RSWW), Part 5. With this in mind, the following should be considered in any future modification of the chlorine rooms so as to provide the best level of safety and to comply with the requirements of RSWW, which requires, in part:


- The provision of a shatter resistant inspection window installed in an interior wall.
- Construction in such a manner that all openings between the chlorine room and the remainder of the plant are sealed.
- The provision of doors equipped with panic hardware, assuring ready means of exit and opening outward only to the building exterior.
- The chlorine tanks should be stored in an area not in direct sunlight or exposed to excessive heat.
- The room should have a ventilating fan with a capacity that provides one complete air change per minute when the room is occupied.
- The ventilating fan shall take suction near the floor as far as practical from the door and air inlet, with the point of discharge so located as not to contaminate air inlets to any rooms or structures.
- Air inlets should be through louvers near the ceiling.
- Louvers for chlorine room air intake and exhaust shall facilitate airtight closure.
- Separate switches for the fan and lights shall be located outside the chlorine room and at the inspection window. Outside switches shall be protected from vandalism.
- Vents from feeders and storage shall discharge to the outside atmosphere, above grade.
- Floor drains are discouraged. Where provided, the floor drains shall discharge to the outside of the building and not be connected to other internal or external drainage systems.
- The rooms should be heated to 60°F, and be protected from excessive heat.
- Pressurized chlorine feed lines should not carry chlorine gas beyond the chlorine room.

The RSWW also states, in part, that chlorine vents shall discharge to the outside, above grade. However, it is recommended by this department that these vents be lowered so that chlorine gas is not vented at or above normal standing height.


## PEOPLES WATER SERVICE

September 26, 2006 Sanitary Survey

GRAPH

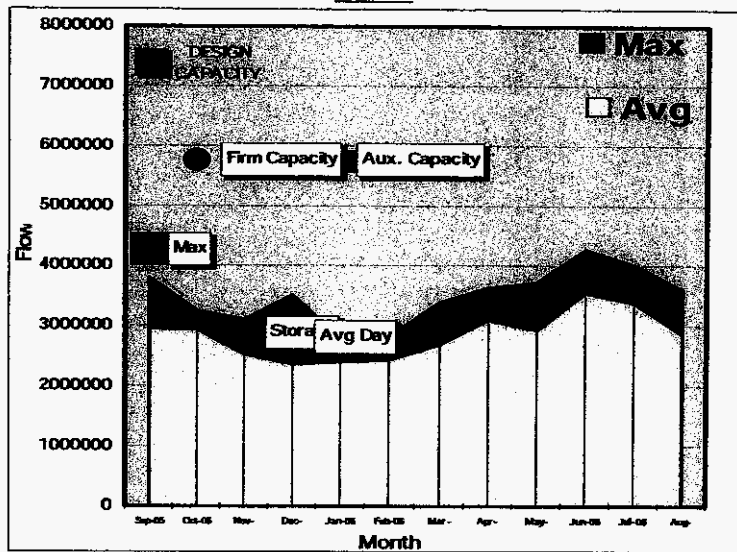

PWS Population Trends

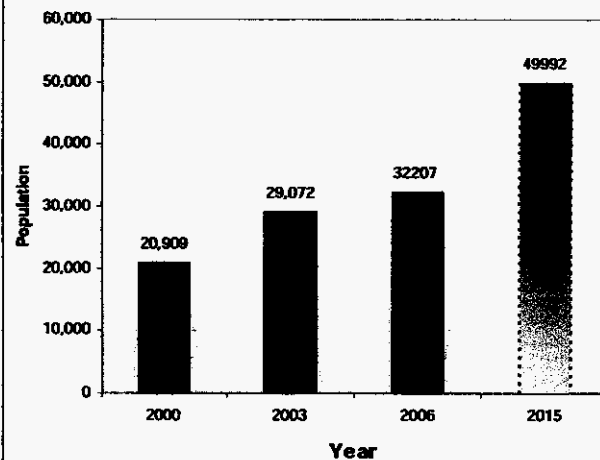
**COMMENTS:**

The system has adequate capacity on all aspects reviewed. The firm capacity (capacity with best well out of service) is well above the average and maximum day. Flows are typical throughout the year with moderate increases in the spring and summer months. The storage capacity is equal to the average daily demand, and is above 25% of maximum day.

The bottom graph indicates that the population growth showed marked increases between 2000 and 2003. Comparisons between 2003 and 2006 are not exact as 2000 and 2003 were based on ERC (equivalent residence count) and a 2.41 population per connection (based on census). 2006 is based on an actual connection count and 3.5 population per connection. Although the numbers are similar they are not exact. There does appear to be a leveling of the population due to a "build-out" in the system and from losses during the 2004 hurricane season.

# PEOPLES WATER SERVICE

September 26, 2006 Sanitary Survey

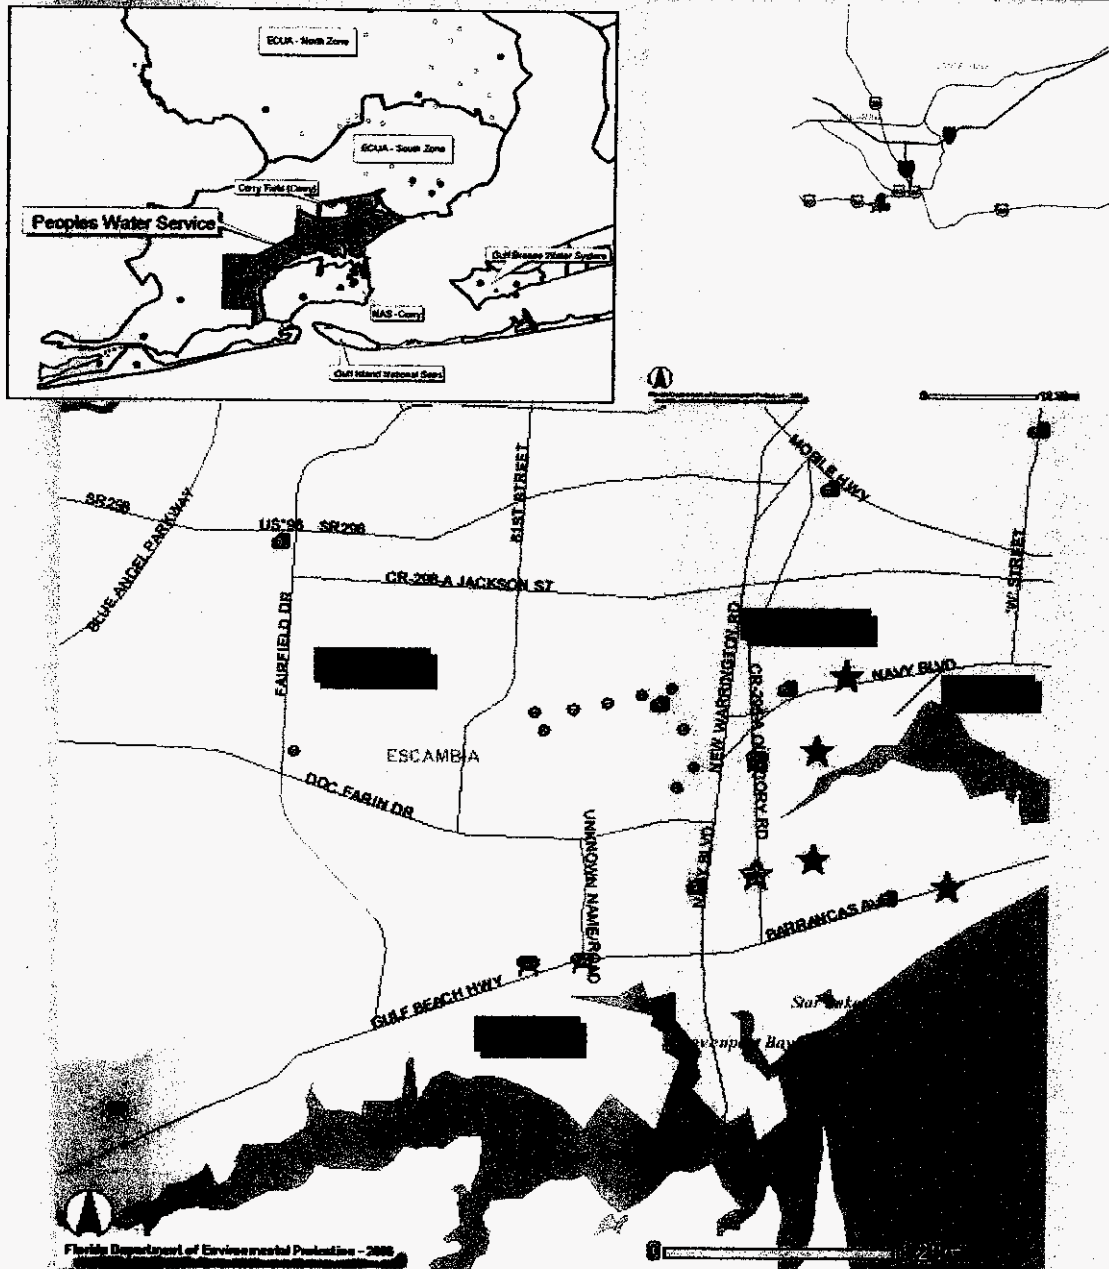

**COMMENTS:** Peoples Water System is located in the southern portion of Escambia County. Nearby water systems include the ECWA to the north and west, and WAS Pensacola to the south. The wells are located mainly in the eastern portion of the franchise area with storage located primarily in the west. Nearby contamination is a potential for all of these wells, since they are located in the older, more commercialized portion of Pensacola.



PEOPLES WATER SERVICE - STORAGE TANKS


September 26, 2006 Sanitary Survey



Wayne ground storage tank with ladder guard.




Overflow and drain for Wayne tank.

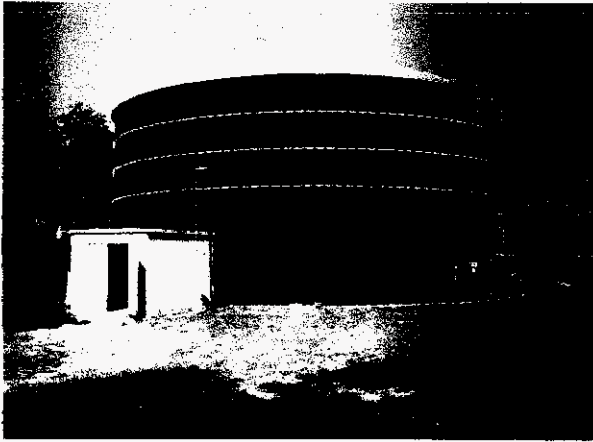

Gulf Beach ground storage tank with Ladder guard.



Overflow from Gulf Beach ground storage tank.

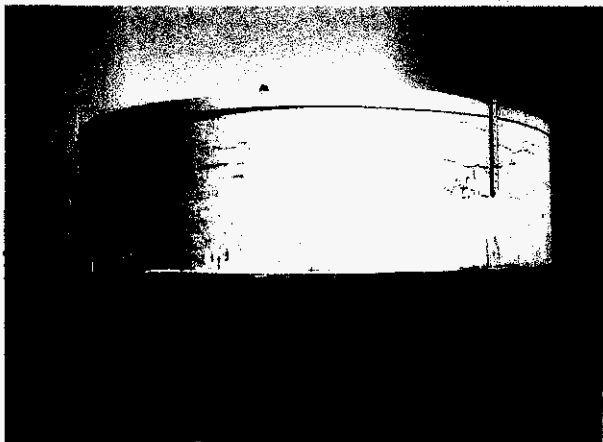


Weller tank is in need of 5-year inspection and maintenance.




Drain line from Weller tank with indeterminate discharge point. Ladder guard in great need of sanding and re-painting.

PEOPLES WATER SERVICE - STORAGE TANKS AND HIGH SERVICE PUMPS  
September 26, 2006 Sanitary Survey

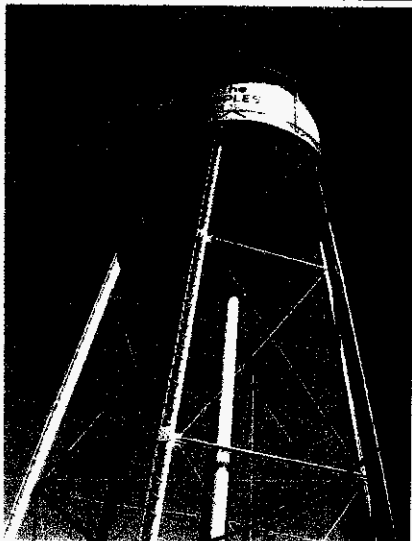


Old Corry elevated tank was recently cleaned and painted.

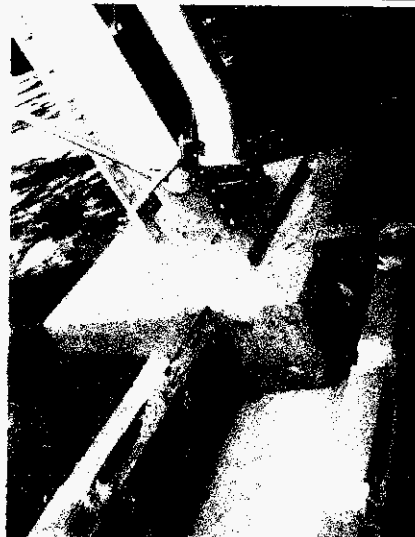


Overflow at Old Corry tank.



High service pumps at Wayne tank - note one is auxiliary pump.

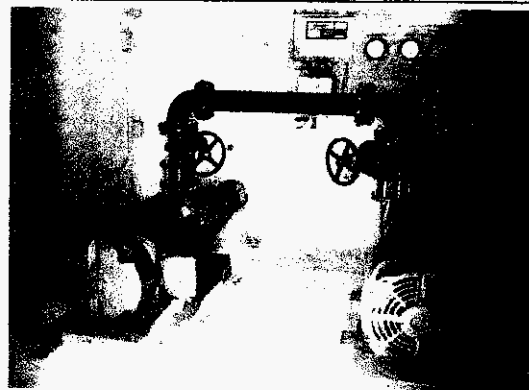

High service pumps at Gulf Beach tank.

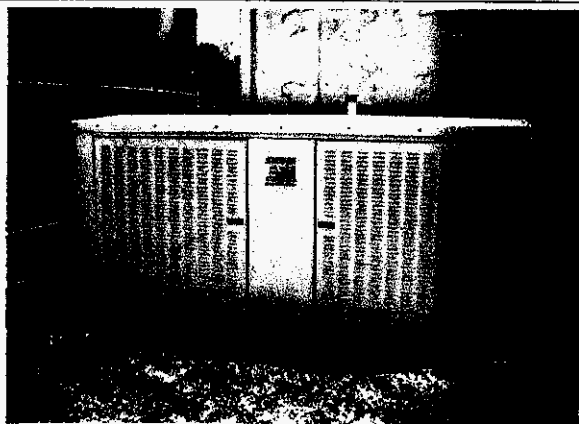

Auxiliary generator at Gulf Beach Tank site.  
Runs high service pumps at this site.



High service pumps at Weller tank site -  
note one is auxiliary pump.

PEOPLES WATER SERVICE - PLANTS

September 26, 2006 Sanitary Survey




Each plant has automatic pH and Chlorine readers.



Plants 3 and 9 have small natural gas generators to run the entire plant during power outages.




Cracks noted in the seal around the well head at Well 4 have been nicely corrected since the last sanitary survey.

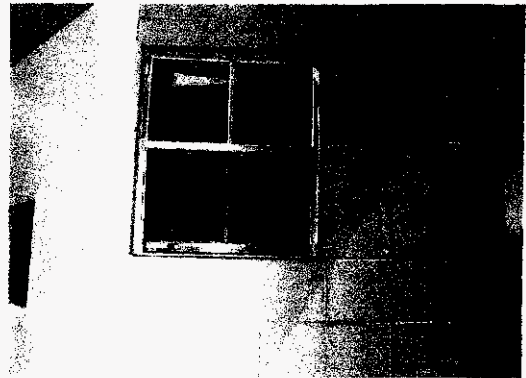

Windows in chlorine rooms that open and close are not appropriate.



GAC filters are located at Wells 3 and 8. These at Well 8 were recently painted.

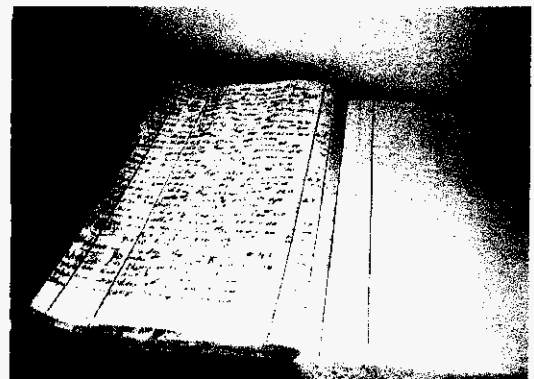

Logbooks are kept up to date at all the plants.

END OF REPORT

**ATTACHMENT A**  
**OUTSTANDING PERMITS**

<b>Issue Date</b>	<b>Permit Number</b>	<b>Project Name</b>
October 15, 2003	0220484-003	Camshire Meadows S/D
July 29, 2005	0251470-001-DSGP/01	Walmart Store #3785
May 19, 2006	0263882-001-DSGP/01	Pines at Warrington
August 28, 2006	0268052-001-DSGP/01	Autumn Meadows

---

## DEP Construction Permits



**NORTHWEST FLORIDA WATER MANAGEMENT DISTRICT**  
**INDIVIDUAL WATER USE PERMIT**  
(NWFWMMD Form No. A2-E)

Permit granted to:

Peoples Water Service  
Company of Florida, Inc.  
905 Lownde Avenue

Pensacola, Florida 32507  
(Legal Name and Address)

County: Escambia Area: B

Application No.: I06699

Permit No.: 19830018 Renewal/Modification

Date Permit Granted: July 27, 2006

Permit Expires On: August 1, 2011

Source Classification: Sand-and-Gravel Aquifer

Use Classification: Public Supply

Location: Section \_\_\_\_\_ 1/4 Section \_\_\_\_\_

Township 2 South Range 30 West

**Terms and standard conditions of this Permit are as follows:**

1. That all statements in the application and in supporting data are true and accurate and based upon the best information available, and that all conditions set forth herein will be complied with. If any of the statements in the application and in the supporting data are found to be untrue and inaccurate, or if the Permittee fails to comply with all of the conditions set forth herein, then this Permit shall be revoked as provided by Chapter 373.243, Florida Statutes.
2. This Permit is predicated upon the assertion by the Permittee that the use of water applied for and granted is and continues to be a reasonable and beneficial use as defined in Section 373.019(4), Florida Statutes, is and continues to be consistent with the public interest, and will not interfere with any legal use of water existing on the date this Permit is granted.
3. This Permit is conditioned on the Permittee having obtained or obtaining all other necessary permit(s) to construct, operate and certify withdrawal facilities and the operation of water system.
4. This Permit is issued to the Permittee contingent upon continued ownership, lease or other present control of property rights in underlying, overlying, or adjacent lands. This Permit may be assigned to a subsequent owner as provided by Chapter 40A-2.351, Florida Administrative Code, and the acceptance by the transferee of all terms and conditions of the Permit.

5. This Permit authorizes the Permittee to make a combined average annual withdrawal of 2,890,000 gallons of water per day, a maximum combined withdrawal of 4,820,000 gallons during a single day, and a combined monthly withdrawal of 100,000,000 gallons. Withdrawals for the individual facilities are authorized as shown in the table below in paragraph six. However, the total combined amount of water withdrawn by all facilities listed in paragraph six shall not exceed the amounts identified above.

6. Individual Withdrawal Facility Authorization

WITHDRAWAL POINT ID NO.	LOCATION SEC,TWN,RNG	GALLONS/DAY AVERAGE	GALLONS/DAY MAXIMUM
AAA6417 (PWS #3A)	Sec. 50, T2S, R30W		1,440,000
AAA6413 (PWS #4A)	Sec. 51, T2S, R30W		1,440,000
AAA6415 (PWS #5)	Sec. 37, T2S, R30W		1,440,000
AAA6416 (PWS #8)	Sec. 37, T2S, R30W		1,036,800
AAA6414 (PWS #9)	Sec. 50, T2S, R30W		1,440,000

7. The use of the permitted water withdrawal is restricted to the use classification set forth by the Permit. Any change in the use of said water shall require a modification of this Permit.
8. The District's staff, upon proper identification, will have permission to enter, inspect and observe permitted and related facilities in order to determine compliance with the approved plans, specifications and conditions of this Permit.
9. The District's staff, upon providing prior notice and proper identification, may request permission to collect water samples for analysis, measure static and/or pumping water levels and collect any other information deemed necessary to protect the water resources of the area.
10. The District reserves the right, at a future date, to require the Permittee to submit pumpage records for any or all withdrawal point(s) covered by this Permit.
11. Permittee shall mitigate any significant adverse impact caused by withdrawals permitted herein on the resource and legal water withdrawals and uses, and on adjacent land use, which existed at the time of permit application. The District reserves the right to curtail permitted withdrawal rates if the withdrawal causes significant adverse impact on the resource and legal uses of water, or adjacent land use, which existed at the time of permit application.
12. Permittee shall not cause significant saline water intrusion or increased chloride levels. The District reserves the right to curtail permitted withdrawal rates if withdrawals cause significant saline water intrusion or increased chloride levels.

13. The District, pursuant to Section 373.042, Florida Statutes, at a future date, may establish minimum and/or management water levels in the aquifer, aquifers, or surface water hydrologically associated with the permitted withdrawals; these water levels may require the Permittee to limit withdrawal from these water sources at times when water levels are below established levels.
14. Nothing in this Permit should be construed to limit the authority of the Northwest Florida Water Management District to declare water shortages and issue orders pursuant to Section 373.175, Florida Statutes, or to formulate and implement a plan during periods of water shortage pursuant to Section 373.246, Florida Statutes, or to declare Water Resource Caution Areas pursuant to Chapters 40A-2.801, and 62-40.41, Florida Administrative Code.
  - (a) In the event of a declared water shortage, water withdrawal reductions shall be made as ordered by the District.
  - (b) In the event of a declared water shortage or an area as a Water Resource Caution Area, the District may alter, modify or inactivate all or parts of this permit.
15. The Permittee shall properly plug and abandon any well determined unsuitable for its intended use, not properly operated and maintained, or removed from service. The well(s) shall be plugged and abandoned to District Standards in accordance with Section 40A-3.531, Florida Administrative Code.
16. Any Specific Permit Condition(s) enumerated in Attachment A are herein made a part of this Permit.



Authorized Signature

Northwest Florida Water Management District

**ATTACHMENT A**  
**Peoples Water Service Company of Florida, Inc.**

Individual Water Use Permit No. 19830018  
Individual Water Use Application No. I06699

1. The Permittee shall include the IWUP number and shall reference each well by its Florida Unique Identification Number (e.g., AAA####) on all submittals when corresponding with the District.
2. The Permittee shall report to the District the following information:
  - a. The data required on Water Use Summary Reporting Form NFWFMD A2-I for the preceding year. Information representing a given year shall be submitted by January 31 of the following year.
  - b. An accounting of the amount of water withdrawn from the wells and the actual amount of water accounted for through the billing system. An estimate of the unaccounted for water by suspected cause shall also be provided (e.g., leaks, line breaks, inaccurate meters, unmetered users, line flushing, etc.). Information representing a given year shall be submitted by January 31 of the following year.
  - c. Static water level data collected during the first two weeks of each month from all production wells. The Permittee shall use a District-approved method and shall not withdraw water from the wells for as long as possible (preferably 24 hours or more) prior to measuring the water level. All measurements shall be taken from the same measuring point. If the measuring point elevation is different from land surface, the Permittee shall provide the difference between these two elevations. All measurements shall reflect the depth to water from land surface elevation. Data representing the months of January through June of a given year shall be submitted by July 31 of the same year, and data representing the months of July through December of a given year shall be submitted by January 31 of the following year.
  - d. Analysis results of water quality samples collected during the first two weeks of January and July of each year from each production well. The water quality analyses shall test for the following chemical concentrations: chloride, sodium, and total dissolved solids. Prior to sampling, the Permittee shall purge at least three well volumes from each well and shall report, with each set of test results, the duration of purging, purge volume, and purge rates used. Data from the January sampling shall be submitted by February 28 and data from the July sampling shall be submitted by August 31 of each year.
  - e. The Permittee, by January 31 of each year, shall submit to the District a copy of its most current rate structure.

The Permittee, if preferred, may submit these reports electronically by e-mailing it to [compliance@nwfwmd.state.fl.us](mailto:compliance@nwfwmd.state.fl.us).

3. The Permittee shall pursue the implementation of a rate structure that promotes water use efficiency and conservation while providing for a life-line initial rate and taking into consideration the water use characteristics of the service area. The Permittee, by January 31, 2010, shall submit to the District the conservation oriented rate structure being considered, a copy of the most current rate proposal and a schedule for rate proceedings with the Public Service Commission. The Permittee shall further provide analysis and projection of the amount of water projected to be conserved by the adoption of such a rate structure.
4. The Permittee, by January 31, 2011, shall fully implement a water conservation oriented rate structure and report the revised rate structure to the District.
5. The Permittee shall maintain water losses and unaccounted for supplies to less than ten percent of the water withdrawn (amount withdrawn verses amount delivered). This can be accomplished by identifying and implementing efficiency and water conservation measures, identifying leaks, identifying inaccurate flow meters, determining accurate per capita demand, quantifying water used for flushing and fire department training, and verifying treatment losses.
6. The Permittee, by December 31, 2010, shall submit a Water Resource Master Plan for meeting the needs of its service area through the year 2020. The plan shall provide for the projected needs of the service area, the protection of the resource, and the implementation of comprehensive water conservation and efficiency measures. The Plan shall specifically identify the anticipated impacts to the water resources and nearby legal users from any expanded use of the Sand-and-Gravel Aquifer and the steps to be undertaken to minimize the anticipated impacts.
7. The Permittee shall continue to consider the interconnection of its water system with that of the Escambia County Utility Authority (ECUA). The Permittee, at the time of permit renewal or modification, shall report its progress to effect such an interconnection.
8. The Permittee, by January 31, 2011, shall provide the District an inventory of facilities using more than 100,000 gallons per day of ground water for non-potable uses within their service area. The Permittee shall include a description of the type(s) of non-potable use and an estimate of the amount of water used at each facility.
9. The Permittee shall mitigate any unexpected impacts attributable to the Utility's withdrawals which interfere with any presently existing legal users of water. In the event of such an occurrence, the Utility shall provide a service connection to the impacted user or otherwise mitigate the impact.





## NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

**INSTRUCTIONS:** This notice shall be completed and submitted by persons proposing to construct projects permitted under the General Permit for Construction of Water Main Extensions for Public Water Systems" in Rule 62-555.405, F.A.C. AT LEAST 30 DAYS BEFORE BEGINNING CONSTRUCTION OF A WATER MAIN EXTENSION PROJECT, complete and submit one copy of this notice to the appropriate Department of Environmental Protection District Office or Approved County Health Department (ACHD) along with payment of the proper permit processing fee. (When completed, Part II of this notice serves as the preliminary design report for a water main extension project, and thus, it is unnecessary to submit a separate preliminary design report or drawings, specifications, and design data with this notice.) All information provided in this notice shall be typed or printed in ink. The permit processing fee for projects requiring the services of a professional engineer during design is \$250, and the permit processing fee for projects not requiring the services of a professional engineer during design is \$100.\* Checks for permit processing fees shall be made payable to the Department of Environmental Protection or the appropriate ACHD. NOTE THAT A SEPARATE NOTIFICATION AND A SEPARATE PERMIT PROCESSING FEE ARE REQUIRED FOR EACH NON-CONTIGUOUS PROJECT.†

\* Except as noted in paragraphs 62-555.520(3)(a) and (b), F.A.C., projects shall be designed under the responsible charge of one or more professional engineers licensed in Florida.

† Non-contiguous projects are projects that are neither interconnected nor located nearby one another (i.e., on the same site, on adjacent streets, or in the same neighborhood).

### I. General Project Information

A. Name of Project: Bayou Place

B. Description of Project and Its Purpose: 73 Unit Multi-Family complex

C. Location of Project

1. County Where Project Located: Escambia

2. Description of Project Location: 222 Weis Lane

D. Estimate of Cost to Construct Project: \$50,000.00

E. Estimate of Dates for Starting and Completing Construction of Project: 12/06 thru 6/07

F. Permittee

PWS/Company Name: <u>Millwood Terrace Developers, LLC</u>		PWS Identification No.:*	
PWS Type:*	<input type="checkbox"/> Community	<input type="checkbox"/> Non-Transient Non-Community	<input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive
Contact Person: <u>Mike McGovern</u>		Contact Person's Title: <u>Manager</u>	
Contact Person's Mailing Address: <u>528 West Garden Street</u>			
City: <u>Pensacola</u>		State: <u>Florida</u>	Zip Code: <u>32501</u>
Contact Person's Telephone Number: <u>248-273-9010</u>		Contact Person's Fax Number: <u>248-273-9020</u>	
Contact Person's E-Mail Address: <u>mmcgovern@emmcapital.net</u>			

\* This information is required only if the permittee is a public water system (PWS).

G. Public Water System (PWS) Supplying Water to Project

PWS Name: <u>Peoples Water Service</u>		PWS Identification No.:	
PWS Type:	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient Non-Community	<input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive
PWS Owner: <u>Peoples Water Service Company Of Florida, Inc.</u>			
Contact Person: <u>Mark Cross</u>		Contact Person's Title: <u>Assistant Manager</u>	
Contact Person's Mailing Address: <u>905 Lowndes Ave.</u>			
City: <u>Pensacola</u>		State: <u>FL</u>	Zip Code: <u>32507</u>
Contact Person's Telephone Number: <u>850-455-8552</u>		Contact Person's Fax Number:	
Contact Person's E-Mail Address:			

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Bayou Place	Permittee: Millwood Terrace Developers, LLC
---------------------------	---

## H. Public Water System (PWS) that Will Own Project After It Is Placed into Permanent Operation

PWS Name: Bayou Place Condominiums		PWS Identification No.:*	
PWS Type:* <input type="checkbox"/> Community <input type="checkbox"/> Non-Transient Non-Community <input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive			
PWS Owner: Millwood Terrace Developers, LLC			
Contact Person: Mike McGovern		Contact Person's Title: Manager	
Contact Person's Mailing Address: 528 West Garden Street			
City: Pensacola		State: FL	Zip Code: 32501
Contact Person's Telephone Number: 248-273-9010		Contact Person's Fax Number: 248-273-9020	
Contact Person's E-Mail Address: mmcgovern@emmcapital.net			

\* This information is required only if the owner/operator is an existing PWS.

## I. Professional Engineer(s) or Other Person(s) in Responsible Charge of Designing Project\*

Company Name: Rebol-Battle & Associates, LLC		
Designer(s): Paul Battle		Title(s) of Designer(s): Owner
Qualifications of Designer(s):		
<input checked="" type="checkbox"/> Professional Engineer(s) Licensed in Florida – License Number(s): 53126		
<input type="checkbox"/> Public Officer(s) Employed by State, County, Municipal, or Other Governmental Unit of State†		
<input type="checkbox"/> Plumbing Contractor(s) Licensed in Florida – License Number(s):^		
Mailing Address of Designer(s): 214 E. Church Street		
City: Pensacola		State: Florida Zip Code: 32502
Telephone Number of Designer(s): 850-438-0400		Fax Number of Designer(s): 850-438-0448
E-Mail Address(es) of Designer(s): pbrba@bellsouth.net		

\* Except as noted in paragraphs 62-555.520(3)(a) and (b), F.A.C., projects shall be designed under the responsible charge of one or more professional engineers licensed in Florida.

† Attach a detailed construction cost estimate showing that the cost to construct this project is \$10,000 or less.

^ Attach documentation showing that this project will be installed by the plumbing contractor(s) designing this project, documentation showing that this project involves a public water system serving a single property and fewer than 250 fixture units, and a detailed construction cost estimate showing that the cost to construct this project is \$50,000 or less.

## II. Preliminary Design Report for Project\*

### A. Service Area, Water Use, and Service Pressure Information

#### 1. Design Type and Number of Service Connections, and Average Daily Water Demands and Maximum-Day Water Demands, in the Entire Area to Be Served by the Water Mains Being Constructed Under this Project:

Design Type	Number of Service Connections	Average Daily Water Demand (gpd)	Maximum-Day Water Demand (gpd)
Single-Family Home	73	350	25,550
Mobile Home			0
Apartment			0
Commercial, Institutional, or Industrial Facility <sup>a</sup>			
<b>Total</b>	<b>73</b>		<b>25,550</b>

a. Description of Commercial, Institutional, or Industrial Facilities and Explanation of Method(s) Used to Estimate Average Daily Water Demand for These Facilities: Ten state standards recommendations

b. Explanation of Peaking Factor(s) or Method(s) Used to Estimate Maximum-Day Water Demand: 2 times ADF per metcalf and eddy text.

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Bayou Place

Permittee: Millwood Terrace Developers, LLC

2. Explanation of Peaking Factor(s) or Method(s) Used to Estimate Design Peak-Hour Water Demand and, for Small Water Systems that Use Hydropneumatic Tanks or that Are Not Designed to Provide Fire Protection, Peak Instantaneous Water Demand: 3 times ADF - Metcalf and Eddy Text

3. Design Fire-Flow Rate and Duration: 750 gpm for 2 hour duration

4. Design Service Pressure Range: 45-65 psi

## B. Project Site Information

1. ATTACH A SITE PLAN OR SKETCH SHOWING THE SIZE AND APPROXIMATE LOCATION OF NEW OR ALTERED WATER MAINS, SHOWING THE APPROXIMATE LOCATION OF HYDRANTS, VALVES, METERS, AND BLOW-OFFS IN SAID MAINS, AND SHOWING HOW SAID MAINS CONNECT TO THE PUBLIC WATER SYSTEM SUPPLYING WATER FOR THE PROJECT.
2. Description of Any Areas Where New or Altered Water Mains Will Cross Above or Under Surface Water or Be Located in Soil that Is Known to Be Aggressive: no aggressive soils or surface water.

## C. Information About Compliance with Design and Construction Requirements

1. If this project is being designed to comply with the following requirements, initial before the requirements. If any of the following requirements do not apply to this project or if this project includes exceptions to any of the following requirements as allowed by rule, mark "NA" before the requirements and complete Part II.C.2 below. *RSWW = Recommended Standards for Water Works* as incorporated into Rule 62-555.330, F.A.C.

- PB a. This project is being designed to keep existing water mains and service lines in operation during construction or to minimize interruption of water service during construction. [RSWW 1.3.a; exceptions allowed under FAC 62-555.330]
- PB b. All pipe, pipe fittings, pipe joint packing and jointing materials, valves, fire hydrants, and meters installed under this project will conform to applicable American Water Works Association (AWWA) standards. [FAC 62-555.320(21)(b), RSWW 8.0, and AWWA standards as incorporated into FAC 62-555.330; exceptions allowed under FAC 62-555.320(21)(c)]
- PB c. All public water system components, excluding fire hydrants, that will be installed under this project and that will come into contact with drinking water will conform to NSF International Standard 61 as adopted in Rule 62-555.335, F.A.C., or other applicable standards, regulations, or requirements referenced in paragraph 62-555.320(3)(b), F.A.C. [FAC 62-555.320(3)(b); exceptions allowed under FAC 62-555.320(3)(d)]
- PB d. All pipe and pipe fittings installed under this project will contain no more than 8.0% lead, and any solder or flux used in this project will contain no more than 0.2% lead. [FAC 62-555.322]
- PB e. All pipe and pipe fittings installed under this project will be color coded or marked in accordance with subparagraph 62-555.320(21)(b)3, F.A.C., using blue as a predominant color. (Underground plastic pipe will be solid-wall blue pipe, will have a co-extruded blue external skin, or will be white or black pipe with blue stripes incorporated into, or applied to, the pipe wall; and underground metal or concrete pipe will have blue stripes applied to the pipe wall. Pipe striped during manufacturing of the pipe will have continuous stripes that run parallel to the axis of the pipe, that are located at no greater than 90-degree intervals around the pipe, and that will remain intact during and after installation of the pipe. If tape or paint is used to stripe pipe during installation of the pipe, the tape or paint will be applied in a continuous line that runs parallel to the axis of the pipe and that is located along the top of the pipe; for pipe with an internal diameter of 24 inches or greater, tape or paint will be applied in continuous lines along each side of the pipe as well as along the top of the pipe. Aboveground pipe will be painted blue or will be color coded or marked like underground pipe.) [FAC 62-555.320(21)(b)3]
- PB f. All new or altered water mains included in this project are sized after a hydraulic analysis based on flow demands and pressure requirements. ATTACH A HYDRAULIC ANALYSIS JUSTIFYING THE SIZE OF ANY NEW OR ALTERED WATER MAINS WITH AN INSIDE DIAMETER OF LESS THAN THREE INCHES. [FAC 62-555.320(21)(b) and RSWW 8.1]

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Bayou Place

Permittee: Millwood Terrace Developers, LLC

- g. The inside diameter of new or altered water mains that are included in this project and that are being designed to provide fire protection and serve fire hydrants will be at least six inches. [FAC 62-555.320(21)(b) and RSWW 8.1.2]
- h. New or altered water mains that are included in this project and that are not being designed to carry fire flows do not have fire hydrants connected to them. [FAC 62-555.320(21)(b) and RSWW 8.1.5]
- i. This project is being designed to minimize dead-end water mains by making appropriate tie-ins where practical. [FAC 62-555.320(21)(b) and RSWW 8.1.6.a]
- j. New or altered dead-end water mains included in this project will be provided with a fire or flushing hydrant or blow-off for flushing purposes. [FAC 62-555.320(21)(b) and RSWW 8.1.6.b]
- k. Sufficient valves will be provided on new or altered water mains included in this project so that inconvenience and sanitary hazards will be minimized during repairs. [FAC 62-555.320(21)(b) and RSWW 8.2]
- l. New or altered fire hydrant leads included in this project will have an inside diameter of at least six inches and will include an auxiliary valve. [FAC 62-555.320(21)(b) and RSWW 8.3.3]
- m. All fire hydrants that will be installed under this project and that will have unplugged, underground drains will be located at least three feet from any existing or proposed storm sewer, stormwater force main, pipeline conveying reclaimed water regulated under Part III of Chapter 62-610, F.A.C., or vacuum-type sanitary sewer; at least six feet from any existing or proposed gravity- or pressure-type sanitary sewer, wastewater force main, or pipeline conveying reclaimed water not regulated under Part III of Chapter 62-10, F.A.C.; and at least ten feet from any existing or proposed "on-site sewage treatment and disposal system." [FAC 62-555.314(4)]
- n. At high points where air can accumulate in new or altered water mains included in this project, provisions will be made to remove the air by means of air relief valves, and automatic air relief valves will not be used in situations where flooding of the valve manhole or chamber may occur. [FAC 62-555.320(21)(b) and RSWW 8.4.1]
- o. The open end of the air relief pipe from all automatic air relief valves installed under this project will be extended to at least one foot above grade and will be provided with a screened, downward-facing elbow. [FAC 62-555.320(21)(b) and RSWW 8.4.2]
- p. New or altered chambers, pits, or manholes that contain valves, blow-offs, meters, or other such water distribution system appurtenances and that are included in this project will not be connected directly to any sanitary or storm sewer, and blow-offs or air relief valves installed under this project will not be connected directly to any sanitary or storm sewer. [FAC 62-555.320(21)(b) and RSWW 8.4.3]
- q. New or altered water mains included in this project will be installed in accordance with applicable AWWA standards or in accordance with manufacturers' recommended procedures. [FAC 62-555.320(21)(b), RSWW 8.5.1, and AWWA standards as incorporated into FAC 62-555.330]
- r. A continuous and uniform bedding will be provided in trenches for underground pipe installed under this project; backfill material will be tamped in layers around underground pipe installed under this project and to a sufficient height above the pipe to adequately support and protect the pipe; and unsuitably sized stones (as described in applicable AWWA standards or manufacturers' recommended installation procedures) found in trenches will be removed for a depth of at least six inches below the bottom of underground pipe installed under this project. [FAC 62-555.320(21)(b), RSWW 8.5.2]
- s. All water main tees, bends, plugs, and hydrants installed under this project will be provided with thrust blocks or restrained joints to prevent movement. [FAC 62-555.320(21)(b) and RSWW 8.5.4]
- t. New or altered water mains that are included in this project and that will be constructed of asbestos-cement or polyvinyl chloride pipe will be pressure and leakage tested in accordance with AWWA Standard C603 or C605, respectively, as incorporated into Rule 62-555.330, F.A.C., and all other new or altered water mains included in this project will be pressure and leakage tested in accordance with AWWA Standard C600 as incorporated into Rule 62-555.330. [FAC 62-555.320(21)(b)1 and AWWA standards as incorporated into FAC 62-555.330]
- u. New or altered water mains, including fire hydrant leads and including service lines that will be under the control of a public water system and that have an inside diameter of three inches or greater, will be disinfected and bacteriologically evaluated in accordance with Rule 62-555.340, F.A.C. [FAC 62-555.320(21)(b)2 and FAC 62-555.340]
- v. New or altered water mains that are included in this project and that will be installed in areas where there are known aggressive soil conditions will be protected through use of corrosion-resistant water main materials, through encasement of the water mains in polyethylene, or through provision of cathodic protection. [FAC 62-555.320(21)(b) and RSWW 8.5.7.d]

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Bayou Place

Permittee: Millwood Terrace Developers, LLC

- PD
- w. New or relocated, underground water mains included in this project will be laid to provide a horizontal distance of at least three feet between the outside of the water main and the outside of any existing or proposed vacuum-type sanitary sewer, storm sewer, stormwater force main, or pipeline conveying reclaimed water regulated under Part III of Chapter 62-610, F.A.C.; a horizontal distance of at least six feet between the outside of the water main and the outside of any existing or proposed gravity-type sanitary sewer (or a horizontal distance of at least three feet between the outside of the water main and the outside of any existing or proposed gravity-type sanitary sewer if the bottom of the water main will be laid at least six inches above the top of the sewer); a horizontal distance of at least six feet between the outside of the water main and the outside of any existing or proposed pressure-type sanitary sewer, wastewater force main, or pipeline conveying reclaimed water not regulated under Part III of Chapter 62-610, F.A.C.; and a horizontal distance of at least ten feet between the outside of the water main and all parts of any existing or proposed "on-site sewage treatment and disposal system." [FAC 62-555.314(1); exceptions allowed under FAC 62-555.314(5)]
- PM
- x. New or relocated, underground water mains that are included in this project and that will cross any existing or proposed gravity- or vacuum-type sanitary sewer or storm sewer will be laid so the outside of the water main is at least six inches above the other pipeline or at least 12 inches below the other pipeline; and new or relocated, underground water mains that are included in this project and that will cross any existing or proposed pressure-type sanitary sewer, wastewater or stormwater force main, or pipeline conveying reclaimed water will be laid so the outside of the water main is at least 12 inches above or below the other pipeline. [FAC 62-555.314(2); exceptions allowed under FAC 62-555.314(5)]
- PD
- y. At the utility crossings described in Part II.C.1.w above, one full length of water main pipe will be centered above or below the other pipeline so the water main joints will be as far as possible from the other pipeline or the pipes will be arranged so that all water main joints are at least three feet from all joints in vacuum-type sanitary sewers, storm sewers, stormwater force mains, or pipelines conveying reclaimed water regulated under Part III of Chapter 62-610, F.A.C., and at least six feet from all joints in gravity- or pressure-type sanitary sewers, wastewater force mains, or pipelines conveying reclaimed water not regulated under Part III of Chapter 62-610, F.A.C. [FAC 62-555.314(2); exceptions allowed under FAC 62-555.314(5)]
- NA
- z. New or altered water mains that are included in this project and that will cross above surface water will be adequately supported and anchored, protected from damage and freezing, and accessible for repair or replacement. [FAC 62-555.320(21)(b) and RSWW 8.7.1]
- NA
- aa. New or altered water mains that are included in this project and that will cross under surface water will have a minimum cover of two feet. [FAC 62-555.320(21)(b) and RSWW 8.7.2]
- NA
- bb. New or altered water mains that are included in this project and that will cross under surface water courses greater than 15 feet in width will have flexible or restrained, watertight pipe joints and will include valves at both ends of the water crossing so the underwater main can be isolated for testing and repair; the aforementioned isolation valves will be easily accessible and will not be subject to flooding; the isolation valve closest to the water supply source will be in a manhole; and permanent taps will be provided on each side of the isolation valve within the manhole to allow for insertion of a small meter to determine leakage from the underwater main and to allow for sampling of water from the underwater main. [FAC 62-555.320(21)(b) and RSWW 8.7.2]
- PD
- cc. This project is being designed to include proper backflow protection at those new or altered service connections where backflow protection is required or recommended under Rule 62-555.360, F.A.C., or in *Recommended Practice for Backflow Prevention and Cross-Connection Control*, AWWA Manual M14, as incorporated into Rule 62-555.330, F.A.C.; or the public water system that will own this project after it is placed into operation has a cross-connection control program requiring water customers to install proper backflow protection at those service connections where backflow protection is required or recommended under Rule 62-555.360, F.A.C., or in AWWA Manual M14. [FAC 62-555.360 and AWWA Manual M14 as incorporated into FAC 62-555.330]
- PD
- dd. Neither steam condensate, cooling water from engine jackets, nor water used in conjunction with heat exchangers will be returned to the new or altered water mains included in this project. [FAC 62-555.320(21)(b) and RSWW 8.8.2]




# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSS

Project Name: Bayou Place	Permittee: Millwood Terrace Developers, LLC
---------------------------	---

2. Explanation for Requirements Marked "NA" in Part II.C.1 Above, Including Justification, Documentation, Assurances, and/or Alternatives as Required by Rule for Exceptions to Requirements in Part II.C.1: \_\_\_\_\_

V. - No aggressive soils  
 2.   
 na - bb > No surface water crossing

I have completed Part II of this notice, and the information provided in Part II and on the attachment(s) to Part II is true and accurate to the best of my knowledge and belief.

Signature, Seal, and Date of Professional Engineer (PE) or Signature and Date of Other Person in Responsible Charge of Designing Project: * <div style="text-align: center; margin-top: 100px;">             11/13/06         </div>	Signature, Seal, and Date of Professional Engineer (PE) or Signature and Date of Other Person in Responsible Charge of Designing Project: * <div style="height: 150px;"></div>
Printed/Typed Name: Paul Battle, Pe	Printed/Typed Name:
License Number of PE or License Number or Title of Other Person in Responsible Charge of Designing Project: * 53126	License Number of PE or License Number or Title of Other Person in Responsible Charge of Designing Project: *
Portion of Preliminary Design Report for Which Responsible: 100%	Portion of Preliminary Design Report for Which Responsible:

\* Except as noted in paragraphs 62-555.520(3)(a) and (b), F.A.C., projects shall be designed under the responsible charge of one or more PEs licensed in Florida. If this project is being designed under the responsible charge of one or more PEs licensed in Florida, Part II of this notice shall be completed, signed, sealed, and dated by the PE(s) in responsible charge. If this project is not being designed under the responsible charge of one or more PEs licensed in Florida, Part II shall be completed, signed, and dated by the person(s) in responsible charge of designing this project.

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Bayou Place

Permittee: Millwood Terrace Developers, LLC

## III. Certifications


### Certification by Permittee

I am duly authorized to sign this notice on behalf of the permittee identified in Part I.F of this notice. I certify that, to the best of my knowledge and belief, this project complies with Chapter 62-555, F.A.C. I also certify that construction of this project has not begun yet and that, to the best of my knowledge and belief, this project does not include any of the following construction work:

- construction of water mains conveying raw or partially treated drinking water;
- construction of drinking water treatment, pumping, or storage facilities or conflict manholes;
- construction of water mains in areas contaminated by low-molecular-weight petroleum products or organic solvents;
- construction of an interconnection between previously separate public water systems or construction of water mains that create a "new system" as described under subsection 62-555.525(1), F.A.C.; or
- construction of water mains that will remain dry following completion of construction.

(A specific construction permit is required for each project involving any of the above listed construction work.)

I understand that, if this project is designed under the responsible charge of one or more professional engineers (PEs) licensed in Florida, the permittee must retain a Florida-licensed PE to take responsible charge of inspecting construction of this project for the purpose of determining in general if the construction proceeds in compliance with the Department of Environmental Protection construction permit, including the approved preliminary design report, for this project. I understand that the permittee must have complete record drawings prepared for this project. I also understand that the permittee must submit a certification of construction completion to the Department and obtain written approval, or clearance, from the Department before the permittee places this project into operation for any purpose other than disinfection or testing for leaks.

  
Signature and Date

11/14/06  
Mike McGovern  
Printed or Typed Name

Manager  
Title


### B. Certification by PWS Supplying Water to Project

I am duly authorized to sign this notice on behalf of the PWS identified in Part I.G of this notice. I certify that said PWS will supply the water necessary to meet the design water demands for this project. As indicated below, the water treatment plant(s) to which this project will be connected has(have) the capacity necessary to meet the design water demands for this project, and I certify that all other PWS components affected by this project also have the capacity necessary to meet the design water demands for this project. I certify that said PWS is in compliance with applicable planning requirements in Rule 62-555.348, F.A.C.; applicable cross-connection control requirements in Rule 62-555.360, F.A.C.; and to the best of my knowledge and belief, all other applicable rules in Chapters 62-550, 62-555, and 62-699, F.A.C.; furthermore, I certify that, to the best of my knowledge and belief, said PWS's connection to this project will not cause said PWS to be in noncompliance with Chapter 62-550 or 62-555, F.A.C. I also certify that said PWS has reviewed the preliminary design report for this project and that said PWS considers the connection(s) between this project and said PWS acceptable as designed.

- Name(s) of Water Treatment Plant(s) to Which this Project Will Be Connected: Peoples Water Service

- Total Permitted Maximum Day Operating Capacity of Plant(s), gpd: \_\_\_\_\_

- Total Maximum Day Flow at Plant(s) as Recorded on Monthly Operating Reports During Past 12 Months, gpd: \_\_\_\_\_


  
Signature and Date

SHERLOCK S. GILLET  
Printed or Typed Name

PRESIDENT  
Title

### C. Certification by PWS that Will Own Project After It Is Placed into Permanent Operation

I am duly authorized to sign this notice on behalf of the PWS identified in Part I.H of this notice. I certify that said PWS will own this project after it is placed into permanent operation. I also certify that said PWS has reviewed the preliminary design report for this project and that said PWS considers this project acceptable as designed.

  
Signature and Date

11/14/06  
Mike McGovern.  
Printed or Typed Name

Manager  
Title

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Bayou Place

Permittee: Millwood Terrace Developers, LLC

## D. Certification by Professional Engineer(s) in Responsible Charge of Designing Project\*

I, the undersigned professional engineer licensed in Florida, am in responsible charge of designing this project. I certify that, to the best of my knowledge and belief, the design of this project complies with Chapter 62-555, F.A.C. I also certify that, to the best of my knowledge and belief, this project is not being designed to include any of the following construction work:

- construction of water mains conveying raw or partially treated drinking water;
- construction of drinking water treatment, pumping, or storage facilities or conflict manholes;
- construction of water mains in areas contaminated by low-molecular-weight petroleum products or organic solvents;
- construction of an interconnection between previously separate public water systems or construction of water mains that create a "new system" as described under subsection 62-555.525(1), F.A.C.; or
- construction of water mains that will remain dry following completion of construction.

(A specific construction permit is required for each project involving any of the above listed construction work.)

Signature, Seal, and Date:



Printed/Typed Name: Paul A. Battle

License Number: 53126

Portion of Preliminary Design Report for Which Responsible:  
100%

Signature, Seal, and Date:

Printed/Typed Name:

License Number:

Portion of Preliminary Design Report for Which Responsible:

\* Except as noted in paragraphs 62-555.520(3)(a) and (b), F.A.C., projects shall be designed under the responsible charge of one or more professional engineers (PEs) licensed in Florida. If this project is being designed under the responsible charge of one or more PEs licensed in Florida, Part III.D of this notice shall be completed by the PE(s) in responsible charge. If this project is not being designed under the responsible charge of one or more PEs licensed in Florida, Part III.D does not have to be completed.



# Florida Department of Environmental Protection

Northwest District  
160 Governmental Center  
Pensacola, Florida 32502-5794

Charlie Crist  
Governor  
Jeff Kottkamp  
Lt. Governor  
Michael W. Sole  
Secretary

March 21, 2007

SENT VIA EMAIL  
(archerhillproperties@hotmail.com)

Mr. Paul Stagner, President  
1288 Country Club Road  
Gulf Breeze, Florida 32563

Dear Mr. Stagner:

This is in response to your Notification of Use of General Permit for Berkshire Estates, notice number 0273794-002-DSGP/01.

The Department has reviewed your notice of intent to use a general permit as provided in Florida Administrative Code 62.555.540 to construct an extension to the People's Water (PWS ID No. 1170527) potable water distribution system to serve the project in Escambia County, and does not object to your use of such general permit.

Please be advised that you are required to abide by all conditions in Florida Administrative Code Rules 62-4.510 through 62-4.540, the general requirements for general permits. The permit will expire five years from the date of this letter.

If you have any questions, please contact John Pope at (850) 595-8300 extension 1145, facsimile number (850) 595-8393 (or e-mail to [john.pope@dep.state.fl.us](mailto:john.pope@dep.state.fl.us)).

Sincerely,

David P. Morres, P.E.  
Program Administrator  
Water Facilities

DPM:mp  
Enclosure: Instructions for Clearance of a Permit

cc: Micah James Jones ([michaj@mcguire-assoc.com](mailto:michaj@mcguire-assoc.com))  
Mark Cross, General Manager ([mark.cross@telcove.net](mailto:mark.cross@telcove.net))  
Theo DeLeon ([theo.deleon@telcove.net](mailto:theo.deleon@telcove.net))

"More Protection, Less Process"  
[www.dep.state.fl.us](http://www.dep.state.fl.us)

# **A Civil Penalty May Be Incurred**

**if this project is placed into use before obtaining a clearance from this office.**

To obtain a clearance from this office, the following items must be submitted to the Department:

**1) Clearance Form**

Submission of a fully completed Department of Environmental Protection (DEP) Form 62-555.900(9) *"Certification of Construction Completion and Request for a Letter of Clearance to Place a Public Drinking Water Facility into Service."*

**2) Record Drawings**

If significant deviations were made after issuance of the permit, one set of "record drawings" signed, sealed, and dated by the engineer of record or the system's professional engineer must accompany the request. In case of water distribution systems or water mains extensions, sample points must be identified on the drawings for bacteriological clearance testing and should correspond to bacteriological analysis reports.

**3) Bacteriological Results**

Copies of satisfactory bacteriological analysis (a.k.a. Main Clearance), taken from locations within the distribution system or water main extension to be cleared, in accordance with Rules 62-555.315 (6), 62-555.340 and 62-555.330, F.A.C. and American Water Works Association (AWWA) Standard C 651-92 as follows:

- *The endpoint of the proposed addition;*
- *Any water lines branching off a main extension;*
- *Every 1,200 feet of water main;*
- *Each location shall be sampled on two separate days (at least 6 hours apart) with sample point locations and chlorine residual readings **clearly indicated** on the report and/or drawings.*
- *Bacteriological sample results will be considered unacceptable if the tests were completed more than 60 days before the Department receives the results.*

**For further clarification contact:**

Simmi Taylor at (850) 595-8300 extension 1140  
FAX (850) 595-8392,  
or email at *simmi.h.taylor@dep.state.fl.us*





# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

INSTRUCTIONS: This notice shall be completed and submitted by persons proposing to construct projects permitted under the General Permit for Construction of Water Main Extensions for Public Water Systems" in Rule 62-555.405, F.A.C. AT LEAST 30 DAYS BEFORE BEGINNING CONSTRUCTION OF A WATER MAIN EXTENSION PROJECT, complete and submit one copy of this notice to the appropriate Department of Environmental Protection District Office or Approved County Health Department (ACHD) along with payment of the proper permit processing fee. (When completed, Part II of this notice serves as the preliminary design report for a water main extension project, and thus, it is unnecessary to submit a separate preliminary design report or drawings, specifications, and design data with this notice.) All information provided in this notice shall be typed or printed in ink. The permit processing fee for projects requiring the services of a professional engineer during design is \$250, and the permit processing fee for projects not requiring the services of a professional engineer during design is \$100.\* Checks for permit processing fees shall be made payable to the Department of Environmental Protection or the appropriate ACHD. NOTE THAT A SEPARATE NOTIFICATION AND A SEPARATE PERMIT PROCESSING FEE ARE REQUIRED FOR EACH NON-CONTIGUOUS PROJECT.†

\* Except as noted in paragraphs 62-555.520(3)(a) and (b), F.A.C., projects shall be designed under the responsible charge of one or more professional engineers licensed in Florida.

† Non-contiguous projects are projects that are neither interconnected nor located nearby one another (i.e., on the same site, on adjacent streets, or in the same neighborhood).

## I. General Project Information

A. Name of Project: Berkshire Estates

B. Description of Project and Its Purpose: 78 Lot Single Family Home Subdivision

### Location of Project

1. County Where Project Located: Escambia

2. Description of Project Location: Pensacola, Florida

D. Estimate of Cost to Construct Project: \_\_\_\_\_

E. Estimate of Dates for Starting and Completing Construction of Project: \_\_\_\_\_

## F. Permittee

PWS/Company Name: <u>Berkshire Land Development, Llc.</u>		PWS Identification No.:*	
PWS Type:* <input type="checkbox"/> Community <input type="checkbox"/> Non-Transient Non-Community <input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive			
Contact Person: <u>Paul Stagner</u>		Contact Person's Title: <u>President</u>	
Contact Person's Mailing Address: <u>1288 Country Club Rd.</u>			
City: <u>Gulf Breeze</u>		State: <u>Fl</u>	Zip Code: <u>32563</u>
Contact Person's Telephone Number: <u>850-982-4411</u>		Contact Person's Fax Number: _____	
Contact Person's E-Mail Address: _____			

\* This information is required only if the permittee is a public water system (PWS).

## G. Public Water System (PWS) Supplying Water to Project

PWS Name: <u>People's Water</u>		PWS Identification No.:	
PWS Type: <input checked="" type="checkbox"/> Community <input type="checkbox"/> Non-Transient Non-Community <input type="checkbox"/> Transient Non-Community <input type="checkbox"/> Consecutive			
PWS Owner: _____			
Contact Person: _____		Contact Person's Title: _____	
Contact Person's Mailing Address: <u>905 Lownde Ave.</u>			
City: <u>Pensacola</u>		State: <u>Fl</u>	Zip Code: <u>32507</u>
Contact Person's Telephone Number: <u>850-455-8552</u>		Contact Person's Fax Number: _____	
Contact Person's E-Mail Address: _____			

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Berkshire Estates Permittee: Berkshire Land Development, Llc.

## H. Public Water System (PWS) that Will Own Project After It Is Placed into Permanent Operation

PWS Name: <u>People's Water</u>		PWS Identification No.:*	
PWS Type:*	<input checked="" type="checkbox"/> Community	<input type="checkbox"/> Non-Transient Non-Community	<input type="checkbox"/> Transient Non-Community
<input type="checkbox"/> Consecutive			
PWS Owner:			
Contact Person:		Contact Person's Title:	
Contact Person's Mailing Address: <u>905 Lownde Ave.</u>			
City: <u>Pensacola</u>		State: <u>FL</u>	Zip Code: <u>32507</u>
Contact Person's Telephone Number: <u>850-455-8552</u>		Contact Person's Fax Number:	
Contact Person's E-Mail Address:			

\* This information is required only if the owner/operator is an existing PWS.

## I. Professional Engineer(s) or Other Person(s) in Responsible Charge of Designing Project\*

Company Name: <u>Jerry W. McGuire &amp; Associates, P.A.</u>	
Designer(s): <u>Gerald W. McGuire</u>	Title(s) of Designer(s): <u>President</u>
Qualifications of Designer(s):	
<input checked="" type="checkbox"/> Professional Engineer(s) Licensed in Florida – License Number(s): <u>39572</u>	
<input type="checkbox"/> Public Officer(s) Employed by State, County, Municipal, or Other Governmental Unit of State†	
<input type="checkbox"/> Plumbing Contractor(s) Licensed in Florida – License Number(s):	
Mailing Address of Designer(s): <u>4400 Bayou Blvd, Suite 26-B</u>	
City: <u>Pensacola</u>	State: <u>FL</u> Zip Code: <u>32503</u>
Telephone Number of Designer(s): <u>850-479-4155</u>	Fax Number of Designer(s): <u>850-479-9141</u>
E-Mail Address(es) of Designer(s): <u>jma@mcguire-assoc.com</u>	

\* Except as noted in paragraphs 62-555.520(3)(a) and (b), F.A.C., projects shall be designed under the responsible charge of one or more professional engineers licensed in Florida.

† Attach a detailed construction cost estimate showing that the cost to construct this project is \$10,000 or less.

^ Attach documentation showing that this project will be installed by the plumbing contractor(s) designing this project, documentation showing that this project involves a public water system serving a single property and fewer than 250 fixture units, and a detailed construction cost estimate showing that the cost to construct this project is \$50,000 or less.

## II. Preliminary Design Report for Project\*

### A. Service Area, Water Use, and Service Pressure Information

#### 1. Design Type and Number of Service Connections, and Average Daily Water Demands and Maximum-Day Water Demands, in the Entire Area to Be Served by the Water Mains Being Constructed Under this Project:

A = Type of Service Connection	B = Number of Service Connections	C = Average Daily Water Demand Per Service Connection, gpd	D = Total Average Daily Water Demand, gpd (Column C x Column B)	E = Maximum Day Water Demand, gpd (Column C x 2)
Single-Family Home	78	350	27,300	44,800
Mobile Home			0	
Apartment			0	
Commercial, Institutional, or Industrial Facility*				
<b>Total</b>	<b>78</b>		<b>27,300</b>	<b>44,800</b>

a. Description of Commercial, Institutional, or Industrial Facilities and Explanation of Method(s) Used to Estimate Average Daily Water Demand for These Facilities: \_\_\_\_\_

b. Explanation of Peaking Factor(s) or Method(s) Used to Estimate Maximum-Day Water Demand: \_\_\_\_\_

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Berkshire Estates

Permittee: Berkshire Land Development, LLC.

2. Explanation of Peaking Factor(s) or Method(s) Used to Estimate Design Peak-Hour Water Demand and, for Small Water Systems that Use Hydropneumatic Tanks or that Are Not Designed to Provide Fire Protection, Peak Instantaneous Water Demand:

3. Design Fire-Flow Rate and Duration:

4. Design Service Pressure Range:

## B. Project Site Information

1. ATTACH A SITE PLAN OR SKETCH SHOWING THE SIZE AND APPROXIMATE LOCATION OF NEW OR ALTERED WATER MAINS, SHOWING THE APPROXIMATE LOCATION OF HYDRANTS, VALVES, METERS, AND BLOW-OFFS IN SAID MAINS, AND SHOWING HOW SAID MAINS CONNECT TO THE PUBLIC WATER SYSTEM SUPPLYING WATER FOR THE PROJECT.
2. Description of Any Areas Where New or Altered Water Mains Will Cross Above or Under Surface Water or Be Located in Soils Known to Be Aggressive:

## C. Information About Compliance with Design and Construction Requirements

1. If this project is being designed to comply with the following requirements, initial before the requirements. If any of the following requirements do not apply to this project or if this project includes exceptions to any of the following requirements as allowed by rule, mark "NA" before the requirements and complete Part II.C.2 below. *RSWW = Recommended Standards for Water Works* as incorporated into Rule 62-555.330, F.A.C.
  - a. This project is being designed to keep existing water mains and service lines in operation during construction or to minimize interruption of water service during construction. [RSWW 1.3.a; exceptions allowed under FAC 62-555.330]
  - b. All pipe, pipe fittings, pipe joint packing and jointing materials, valves, fire hydrants, and meters installed under this project will conform to applicable American Water Works Association (AWWA) standards. [FAC 62-555.320(21)(b), RSWW 8.0, and AWWA standards as incorporated into FAC 62-555.330; exceptions allowed under FAC 62-555.320(21)(c)]
  - c. All public water system components, excluding fire hydrants, that will be installed under this project and that will come into contact with drinking water will conform to NSF International Standard 61 as adopted in Rule 62-555.335, F.A.C., or other applicable standards, regulations, or requirements referenced in paragraph 62-555.320(3)(b), F.A.C. [FAC 62-555.320(3)(b); exceptions allowed under FAC 62-555.320(3)(d)]
  - d. All pipe and pipe fittings installed under this project will contain no more than 8.0% lead, and any solder or flux used in this project will contain no more than 0.2% lead. [FAC 62-555.322]
  - e. All pipe and pipe fittings installed under this project will be color coded or marked in accordance with subparagraph 62-555.320(21)(b)3, F.A.C., using blue as a predominant color. (Underground plastic pipe will be solid-wall blue pipe, will have a co-extruded blue external skin, or will be white or black pipe with blue stripes incorporated into, or applied to, the pipe wall; and underground metal or concrete pipe will have blue stripes applied to the pipe wall. Pipe striped during manufacturing of the pipe will have continuous stripes that run parallel to the axis of the pipe, that are located at no greater than 90-degree intervals around the pipe, and that will remain intact during and after installation of the pipe. If tape or paint is used to stripe pipe during installation of the pipe, the tape or paint will be applied in a continuous line that runs parallel to the axis of the pipe and that is located along the top of the pipe; for pipe with an internal diameter of 24 inches or greater, tape or paint will be applied in continuous lines along each side of the pipe as well as along the top of the pipe. Aboveground pipe will be painted blue or will be color coded or marked like underground pipe.) [FAC 62-555.320(21)(b)3]
  - f. All new or altered water mains included in this project are sized after a hydraulic analysis based on flow demands and pressure requirements. ATTACH A HYDRAULIC ANALYSIS JUSTIFYING THE SIZE OF ANY NEW OR ALTERED WATER MAINS WITH AN INSIDE DIAMETER OF LESS THAN THREE INCHES. [FAC 62-555.320(21)(b) and RSWW 8.1]

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Berkshire Estates

Permittee: Berkshire Land Development, Llc.

- g. The inside diameter of new or altered water mains that are included in this project and that are being designed to provide fire protection and serve fire hydrants will be at least six inches. [FAC 62-555.320(21)(b) and RSWW 8.1.2]
- h. New or altered water mains that are included in this project and that are not being designed to carry fire flows do not have fire hydrants connected to them. [FAC 62-555.320(21)(b) and RSWW 8.1.5]
- i. This project is being designed to minimize dead-end water mains by making appropriate tie-ins where practical. [FAC 62-555.320(21)(b) and RSWW 8.1.6.a]
- j. New or altered dead-end water mains included in this project will be provided with a fire or flushing hydrant or blow-off for flushing purposes. [FAC 62-555.320(21)(b) and RSWW 8.1.6.b]
- k. Sufficient valves will be provided on new or altered water mains included in this project so that inconvenience and sanitary hazards will be minimized during repairs. [FAC 62-555.320(21)(b) and RSWW 8.2]
- l. New or altered fire hydrant leads included in this project will have an inside diameter of at least six inches and will include an auxiliary valve. [FAC 62-555.320(21)(b) and RSWW 8.3.3]
- m. All fire hydrants that will be installed under this project and that will have unplugged, underground drains will be located at least three feet from any existing or proposed storm sewer, stormwater force main, pipeline conveying reclaimed water regulated under Part III of Chapter 62-610, F.A.C., or vacuum-type sanitary sewer; at least six feet from any existing or proposed gravity- or pressure-type sanitary sewer, wastewater force main, or pipeline conveying reclaimed water not regulated under Part III of Chapter 62-10, F.A.C.; and at least ten feet from any existing or proposed "on-site sewage treatment and disposal system." [FAC 62-555.314(4)]
- n. At high points where air can accumulate in new or altered water mains included in this project, provisions will be made to remove the air by means of air relief valves, and automatic air relief valves will not be used in situations where flooding of the valve manhole or chamber may occur. [FAC 62-555.320(21)(b) and RSWW 8.4.1]
- o. The open end of the air relief pipe from all automatic air relief valves installed under this project will be extended to at least one foot above grade and will be provided with a screened, downward-facing elbow. [FAC 62-555.320(21)(b) and RSWW 8.4.2]
- p. New or altered chambers, pits, or manholes that contain valves, blow-offs, meters, or other such water distribution system appurtenances and that are included in this project will not be connected directly to any sanitary or storm sewer, and blow-offs or air relief valves installed under this project will not be connected directly to any sanitary or storm sewer. [FAC 62-555.320(21)(b) and RSWW 8.4.3]
- q. New or altered water mains included in this project will be installed in accordance with applicable AWWA standards or in accordance with manufacturers' recommended procedures. [FAC 62-555.320(21)(b), RSWW 8.5.1, and AWWA standards as incorporated into FAC 62-555.330]
- r. A continuous and uniform bedding will be provided in trenches for underground pipe installed under this project; backfill material will be tamped in layers around underground pipe installed under this project and to a sufficient height above the pipe to adequately support and protect the pipe; and unsuitably sized stones (as described in applicable AWWA standards or manufacturers' recommended installation procedures) found in trenches will be removed for a depth of at least six inches below the bottom of underground pipe installed under this project. [FAC 62-555.320(21)(b), RSWW 8.5.2]
- s. All water main tees, bends, plugs, and hydrants installed under this project will be provided with thrust blocks or restrained joints to prevent movement. [FAC 62-555.320(21)(b) and RSWW 8.5.4]
- t. New or altered water mains that are included in this project and that will be constructed of asbestos-cement or polyvinyl chloride pipe will be pressure and leakage tested in accordance with AWWA Standard C603 or C605, respectively, as incorporated into Rule 62-555.330, F.A.C., and all other new or altered water mains included in this project will be pressure and leakage tested in accordance with AWWA Standard C600 as incorporated into Rule 62-555.330. [FAC 62-555.320(21)(b)1 and AWWA standards as incorporated into FAC 62-555.330]
- u. New or altered water mains, including fire hydrant leads and including service lines that will be under the control of a public water system and that have an inside diameter of three inches or greater, will be disinfected and bacteriologically evaluated in accordance with Rule 62-555.340, F.A.C. [FAC 62-555.320(21)(b)2 and FAC 62-555.340]
- v. New or altered water mains that are included in this project and that will be installed in areas where there are known aggressive soil conditions will be protected through use of corrosion-resistant water main materials, through encasement of the water mains in polyethylene, or through provision of cathodic protection. [FAC 62-555.320(21)(b) and RSWW 8.5.7.d]



# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Berkshire Estates

Permittee: Berkshire Land Development, LLC.

- w. New or relocated, underground water mains included in this project will be laid to provide a horizontal distance of at least three feet between the outside of the water main and the outside of any existing or proposed vacuum-type sanitary sewer, storm sewer, stormwater force main, or pipeline conveying reclaimed water regulated under Part III of Chapter 62-610, F.A.C.; a horizontal distance of at least six feet between the outside of the water main and the outside of any existing or proposed gravity-type sanitary sewer (or a horizontal distance of at least three feet between the outside of the water main and the outside of any existing or proposed gravity-type sanitary sewer if the bottom of the water main will be laid at least six inches above the top of the sewer); a horizontal distance of at least six feet between the outside of the water main and the outside of any existing or proposed pressure-type sanitary sewer, wastewater force main, or pipeline conveying reclaimed water not regulated under Part III of Chapter 62-610, F.A.C.; and a horizontal distance of at least ten feet between the outside of the water main and all parts of any existing or proposed "on-site sewage treatment and disposal system." [FAC 62-555.314(1); exceptions allowed under FAC 62-555.314(5)]
- x. New or relocated, underground water mains that are included in this project and that will cross any existing or proposed gravity- or vacuum-type sanitary sewer or storm sewer will be laid so the outside of the water main is at least six inches above the other pipeline or at least 12 inches below the other pipeline; and new or relocated, underground water mains that are included in this project and that will cross any existing or proposed pressure-type sanitary sewer, wastewater or stormwater force main, or pipeline conveying reclaimed water will be laid so the outside of the water main is at least 12 inches above or below the other pipeline. [FAC 62-555.314(2); exceptions allowed under FAC 62-555.314(5)]
- y. At the utility crossings described in Part II.C.1.w above, one full length of water main pipe will be centered above or below the other pipeline so the water main joints will be as far as possible from the other pipeline or the pipes will be arranged so that all water main joints are at least three feet from all joints in vacuum-type sanitary sewers, storm sewers, stormwater force mains, or pipelines conveying reclaimed water regulated under Part III of Chapter 62-610, F.A.C., and at least six feet from all joints in gravity- or pressure-type sanitary sewers, wastewater force mains, or pipelines conveying reclaimed water not regulated under Part III of Chapter 62-610, F.A.C. [FAC 62-555.314(2); exceptions allowed under FAC 62-555.314(5)]
- z. New or altered water mains that are included in this project and that will cross above surface water will be adequately supported and anchored, protected from damage and freezing, and accessible for repair or replacement. [FAC 62-555.320(21)(b) and *RSWW* 8.7.1]
- aa. New or altered water mains that are included in this project and that will cross under surface water will have a minimum cover of two feet. [FAC 62-555.320(21)(b) and *RSWW* 8.7.2]
- bb. New or altered water mains that are included in this project and that will cross under surface water courses greater than 15 feet in width will have flexible or restrained, watertight pipe joints and will include valves at both ends of the water crossing so the underwater main can be isolated for testing and repair; the aforementioned isolation valves will be easily accessible and will not be subject to flooding; the isolation valve closest to the water supply source will be in a manhole; and permanent taps will be provided on each side of the isolation valve within the manhole to allow for insertion of a small meter to determine leakage from the underwater main and to allow for sampling of water from the underwater main. [FAC 62-555.320(21)(b) and *RSWW* 8.7.2]
- cc. This project is being designed to include proper backflow protection at those new or altered service connections where backflow protection is required or recommended under Rule 62-555.360, F.A.C., or in *Recommended Practice for Backflow Prevention and Cross-Connection Control*, AWWA Manual M14, as incorporated into Rule 62-555.330, F.A.C.; or the public water system that will own this project after it is placed into operation has a cross-connection control program requiring water customers to install proper backflow protection at those service connections where backflow protection is required or recommended under Rule 62-555.360, F.A.C., or in AWWA Manual M14. [FAC 62-555.360 and AWWA Manual M14 as incorporated into FAC 62-555.330]
- dd. Neither steam condensate, cooling water from engine jackets, nor water used in conjunction with heat exchangers will be returned to the new or altered water mains included in this project. [FAC 62-555.320(21)(b) and *RSWW* 8.8.2]



**NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN  
EXTENSIONS FOR PWSs**

Permittee: Berkshire Land Development, Llc.

2. Explanation for Requirements Marked "NA" in Part II.C.1 Above, Including Justification, Documentation, Assurances, and/or Alternatives as Required by Rule for Exceptions to Requirements in Part II.C.1:

I have read and understand the contents of the foregoing notice, and the information provided in Part II and on the attachment(s) to Part II is true and accurate to the best of my knowledge and belief.

Signature, Seal, and Date of Professional Engineer (PE) or  
Signature and Date of Other Person in Responsible Charge of  
Designing Project.\*

Signature, Seal, and Date of Professional Engineer (PE) or  
Signature and Date of Other Person in Responsible Charge of  
Designing Project:\*

Printed/Typed Name: Micah Jones

License Number of PE or License Number or Title of Other  
Person in Responsible Charge of Designing Project: 646299

Portion of Preliminary Design Report for Which Responsible:  
100%

Printed/Typed Name:

License Number of PE or License Number or Title of Other Person in Responsible Charge of Designing Project:\*

Portion of Preliminary Design Report for Which Responsible:

\* Except as noted in paragraphs 62-555.520(3)(a) and (b), F.A.C., projects shall be designed under the responsible charge of one or more PEs licensed in Florida. If this project is being designed under the responsible charge of one or more PEs licensed in Florida, Part II of this notice shall be completed, signed, sealed, and dated by the PE(s) in responsible charge. If this project is not being designed under the responsible charge of one or more PEs licensed in Florida, Part II shall be completed, signed, and dated by the person(s) in responsible charge of designing this project.

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Berkshire Estates

Permittee: Berkshire Land Development, LLC

## III. Certifications

### A. Certification by Permittee

I am duly authorized to sign this notice on behalf of the permittee identified in Part I.F of this notice. I certify that, to the best of my knowledge and belief, this project complies with Chapter 62-555, F.A.C. I also certify that construction of this project has not begun yet and that, to the best of my knowledge and belief, this project does not include any of the following construction work:

- construction of water mains conveying raw or partially treated drinking water;
- construction of drinking water treatment, pumping, or storage facilities or conflict manholes;
- construction of water mains in areas contaminated by low-molecular-weight petroleum products or organic solvents;
- construction of an interconnection between previously separate public water systems or construction of water mains that create a "new system" as described under subsection 62-555.525(1), F.A.C.; or
- construction of water mains that will remain dry following completion of construction.

(A specific construction permit is required for each project involving any of the above listed construction work.)

I understand that, if this project is designed under the responsible charge of one or more professional engineers (PEs) licensed in Florida, the permittee must retain a Florida-licensed PE to take responsible charge of inspecting construction of this project for the purpose of determining in general if the construction proceeds in compliance with the Department of Environmental Protection construction permit, including the approved preliminary design report, for this project. I understand that the permittee must have complete record drawings prepared for this project. I also understand that the permittee must submit a notification of construction completion to the Department and obtain written approval, or clearance, from the Department before the permittee places this project into operation for any purpose other than disinfection or testing for leaks.



Signature and Date

Paul Stagner

Printed or Typed Name

President

Title


### B. Certification by PWS Supplying Water to Project

I am duly authorized to sign this notice on behalf of the PWS identified in Part I.G of this notice. I certify that said PWS will supply the water necessary to meet the design water demands for this project. As indicated below, the water treatment plant(s) to which this project will be connected has(have) the capacity necessary to meet the design water demands for this project, and I certify that all other PWS components affected by this project also have the capacity necessary to meet the design water demands for this project. I certify that said PWS is in compliance with applicable planning requirements in Rule 62-555.348, F.A.C.; applicable cross-connection control requirements in Rule 62-555.360, F.A.C.; and to the best of my knowledge and belief, all other applicable rules in Chapters 62-550, 62-555, and 62-699, F.A.C.; furthermore, I certify that, to the best of my knowledge and belief, said PWS's connection to this project will not cause said PWS to be in noncompliance with Chapter 62-550 or 62-555, F.A.C. I also certify that said PWS has reviewed the preliminary design report for this project and that said PWS considers the connection(s) between this project and said PWS acceptable as designed.

• Name(s) of Water Treatment Plant(s) to Which this Project Will Be Connected: People's Water SERVICE Co.

• Total Permitted Maximum Day Operating Capacity of Plant(s), gpd: \_\_\_\_\_

• Total Maximum Day Flow at Plant(s) as Recorded on Monthly Operating Reports During Past 12 Months, gpd: \_\_\_\_\_

x  12/28/06 SHERLOCK S. GILLET President


Signature and Date

Printed or Typed Name

Title

### C. Certification by PWS that Will Own Project After It Is Placed into Permanent Operation

I am duly authorized to sign this notice on behalf of the PWS identified in Part I.H of this notice. I certify that said PWS will own this project after it is placed into permanent operation. I also certify that said PWS has reviewed the preliminary design report for this project and that said PWS considers this project acceptable as designed.

x  12/28/06 SHERLOCK S. GILLET President

Signature and Date

Printed or Typed Name

Title

# NOTICE OF INTENT TO USE THE GENERAL PERMIT FOR CONSTRUCTION OF WATER MAIN EXTENSIONS FOR PWSs

Project Name: Berkshire Estates

Permittee: Berkshire Land Development, LLC

## D. Certification by Professional Engineer(s) in Responsible Charge of Designing Project\*

I, the undersigned professional engineer licensed in Florida, am in responsible charge of designing this project. I certify that, to the best of my knowledge and belief, the design of this project complies with Chapter 62-555, F.A.C. I also certify that, to the best of my knowledge and belief, this project is not being designed to include any of the following construction work:

- construction of water mains conveying raw or partially treated drinking water;
- construction of drinking water treatment, pumping, or storage facilities or conflict manholes;
- construction of water mains in areas contaminated by low-molecular-weight petroleum products or organic solvents;
- construction of an interconnection between previously separate public water systems or construction of water mains that create a "new system" as described under subsection 62-555.525(1), F.A.C.; or
- construction of water mains that will remain dry following completion of construction.

(A specific construction permit is required for each project involving any of the above listed construction work.)

Signature, Seal, and Date:

Signature, Seal, and Date:

Printed/Typed Name: Micah Jones, PE

License Number: 64629

Portion of Preliminary Design Report for Which Responsible:  
100%

Printed/Typed Name:

License Number:

Portion of Preliminary Design Report for Which Responsible:

\* Except as noted in paragraphs 62-555.520(3)(a) and (b), F.A.C., projects shall be designed under the responsible charge of one or more professional engineers (PEs) licensed in Florida. If this project is being designed under the responsible charge of one or more PEs licensed in Florida, Part III.D of this notice shall be completed by the PE(s) in responsible charge. If this project is not being designed under the responsible charge of one or more PEs licensed in Florida, Part III.D does not have to be completed.

## Employee Listing

**Peoples Water Service Company of Florida, Inc.**

**Employee Listing**

<b>Employee Name</b>	<b>Job Title</b>	<b>Certificates</b>	<b>Salary Allocation Method</b>
Russel Barrett	Operator	Class "B" Operators License	Hours worked charged to applicable general ledger account number
Rhonda Bassett	Utility Service Rep	none	Hours worked charged to applicable general ledger account number
Daniel Boyd	Meter Reader Foreman	none	Hours worked charged to applicable general ledger account number
Constance Brookhart	Utility Service Rep / Billing	none	Hours worked charged to applicable general ledger account number
Velma Coffee	Utility Service Rep	none	Hours worked charged to applicable general ledger account number
Mark Cross	Manager	Class "A" Operators License	Hours worked charged to applicable general ledger account number
Dale Davison	Meter Reader	none	Hours worked charged to applicable general ledger account number
Theo DeLeon	Water Production Supervisor	Class "B" Operators License	Hours worked charged to applicable general ledger account number
Richard Emmons	Facility & Project Coordinator	Backflow Tester	Hours worked charged to applicable general ledger account number
Stephen Haupt	Meter Reader	none	Hours worked charged to applicable general ledger account number
Chester Horton	Utility Worker	none	Hours worked charged to applicable general ledger account number
Robert Jones	Line Locator	none	Hours worked charged to applicable general ledger account number
Gary Leatherberry	Utility Worker	none	Hours worked charged to applicable general ledger account number
Edgar Manzi	Utility Office Supervisor	none	Hours worked charged to applicable general ledger account number
Dan Micklebrook	Utility Service Supervisor	Class "C" Operators License	Hours worked charged to applicable general ledger account number
Linda Porter	Utility Service Rep / Billing	none	Hours worked charged to applicable general ledger account number
Rachael Radlawane	Utility Service Rep	none	Hours worked charged to applicable general ledger account number
Ron Riley	Meter Reader	none	Hours worked charged to applicable general ledger account number
Dennis Roscom	Draftsman	none	Hours worked charged to applicable general ledger account number
John Tindell	Administrative Assistant PT	none	Hours worked charged to applicable general ledger account number
Mitch Torrance	Utility Service Foreman	Grade III Distribution Operator	Hours worked charged to applicable general ledger account number



## Vehicle Listing

**Peoples Water Service Company of Florida, Inc.**

**Vehicle Listing**

<b>UNIT #</b>	<b>DESCRIPTION</b>	<b>VIN #</b>	<b>Original Cost</b>	<b>Assigned</b>	<b>Allocation to Utility</b>
Unit 1	2006 Ford Escape	1FMYU02Z96KA61522	\$17,971.77	Drafting/Maps	100%
Unit 2	2006 Ford P/U	1FTRF12286NB82407	\$17,932.38	Service Workers	100%
Unit 3	2005 Ford P/U	1FTRF122X5NA47234	\$16,720.28	Meter Reading / Service	100%
Unit 4	2006 Ford F150 P/U	1FTRF12286NAO5596	\$15,690.42	Distibution Workers	100%
Unit 5	2008 Chevy Colorado	1GCCS149288199166	\$16,823.44	Operations	100%
Unit 6	2002 Ford P/U	1FTRF17262NCO1572	\$14,068.00	Operations	100%
Unit 7	2005 Ford P/U	1FTRF12285NA47233	\$18,327.00	Meter Reading / Service	100%
Unit 8	2007 Chev P/U	1GCEC14X572649319	\$15,026.97	Operations Supervisor	100%
Unit 9	2007 Chev P/U	1GCEC14X272613642	\$14,623.11	Superintendant	100%
Unit 11	2006 Ford F350 C/C	1FTWW305XGE01872	\$29,340.00	Utility Workers	100%
Unit 12	2006 Ford Ranger	1FTYR10DXGPAO4901	\$15,713.59	Line Locator	100%
Unit 15	2001 Chev P/U	1GCEC14W11Z104463	\$15,242.80	Backflow Tester/ Projects	100%
Unit 16	2003 Ford Ranger	1FTYR10U83PB06208	\$13,321.19	Meter Reading / Service	100%
Unit 17	2009 Chevy Impala	2GIWT57K391147056	\$25,555.49	Manager	100%

## **2008 Customer Concern Records**

**CUSTOMER COMPLAINT RECORD**

ENTERED BY: VC  
DATE: 12-23-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 1020250009  
NAME Smiley Carlette  
ADDRESS 1275 Mahogany Mill 1C  
PHONE ~~346-7779~~ 485-2170

COMPLAINT TYPE: Brown Rusty water

MAIN SIZE: 6" SERVICE SIZE: 3/4"  
MAIN MATERIAL: PVC SERVICE MATERIAL: P.E.

CHLORINE RESIDUAL 0.6 <sup>F</sup> | <sup>T</sup> PH 6.9

WATER TEMPERATURE HOT COLD X BOTH

GALVANIC CONNECTIONS YES uk NO        #       

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Rusty water from  
Several Faucets

ACTION TAKEN: No Rusty water outside, but Run  
Right Hand and Recommended Flushing  
Hot water heater To call back if  
more problems

OPERATOR: Bill DATE: 12-23-08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: VC

DATE: 12.22.08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 0410240006

NAME Blenda F Dees

ADDRESS 1006 Colburn Ave

PHONE 458-5323 Please call before you

COMPLAINT TYPE: Black ring in toilet  
and in Bottom of cats water bowl

MAIN SIZE: 3"

SERVICE SIZE: 3/4"

MAIN MATERIAL: PVC

SERVICE MATERIAL: PE

CHLORINE RESIDUAL 0.51 N/A PH 7.0

WATER TEMPERATURE HOT N/A COLD N/A BOTH N/A

GALVANIC CONNECTIONS YES W/K NO W/K # W/K

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: WATER looked clear  
upon arrival, customer said it was clear  
no visible black rings were noticed  
in toilet or cats Bowl.

ACTION TAKEN: explained about mold and fungus  
growth, flushed water to ensure nothing  
builds in water, so give buildup throughout  
using water.

OPERATOR: Barrett  
B Horton

DATE: 12/22/08



# GENERAL SERVICE ORDER

## PEOPLES WATER SERVICE COMPANY

PO BOX 4815  
905 LOWNDE AVENUE

WORK ORDER # 0000000431	STATUS A	JOB PRIORITY NORMAL	RECEIVED THROUGH Telephone	RECEIVED ON 12/15/08 02:03:08 PM
SCHEDULE FOR		SCHEDULE DATE 12/15/08	SCHEDULE TIME	OPERATOR ID 14
CALLING PARTY MOTLEY MORRIS I		CONTAC PHONE	TEL. NO 1	TEL. NO 2
CUSTOMER NAME MOTLEY, MORRIS I		ACCOUNT NUMBER 2927805200	ACCOUNT STATUS A	ACCOUNT DATE 06/16/88
STREET ADDRESS 7625 OLD HICKORY DR		BLD/ APT #	CITY PENSACOLA	STATE/ ZIP FL 32507

WORK TO BE DONE	WORK DONE
<p>cust. called complained of dirty water all faucets.</p>	<p><i>Contacted Customer Explained Flushing was being performed In his area which was the Reason for Dirty water</i></p>

NOTES/ COMMENTS: *Told Customer To call Back if it didn't Clean up. After flushing was complete*

IS WORK ORDER COMPLETED? YES ☒ NO ☐

NOT DONE REASON

*2:30 pm*

DATE AND TIME COMPLETED

*Bual.*

COMPLETED BY

PAYMENT INFORMATION

CUSTOMER COMMENTS

CUSTOMER SIGNATURE

DATE

T THE PEOPLES WATER SERVICE COMPANY

DATE: 8-29-08

ACCOUNT NUMBER: 0700810001  
 NAME: John Franklin Jr.  
 ADDRESS: 1403 Wisteria Ave  
 PHONE: 850-698-0967

COMPLAINT TYPE: dirty brown water

MAIN SIZE: \_\_\_\_\_ SERVICE SIZE: \_\_\_\_\_  
 MAIN MATERIAL: \_\_\_\_\_ SERVICE MATERIAL: \_\_\_\_\_

CHLORINE RESIDUAL F 0.5 | T \_\_\_\_\_ PH 7.2

WATER TEMPERATURE HOT \_\_\_\_\_ COLD ☒ BOTH \_\_\_\_\_

GALVANIC CONNECTIONS YES ☒ NO \_\_\_\_\_ # \_\_\_\_\_

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT NA  
 PRIVATE LAB (LOCATION) NA  
 IN HOUSE NA

INFORMATION FROM COMPLAINT LOCATION: water is discolored!

ACTION TAKEN: Register head removed from meter, flushed front spigot. Water cleared up w/in a few minutes, requested customer to flush ~~pressure~~ all faucets & flush toilets. No additional action taken at this time.

OPERATOR: TP PB

DATE: 8/29/08

THE PEOPLES WATER SERVICE COMPANY

DATE: 8-29-08

ACCOUNT NUMBER: 0700810001  
 NAME: John Franklin Jr.  
 ADDRESS: 1403 Wisteria Ave  
 PHONE: 850-698-0967

COMPLAINT TYPE: Dirty, Cloudy Water in all faucets. Landlord calling for tenant. Tenant working nights so later this afternoon will be better for him.

MAIN SIZE: \_\_\_\_\_ SERVICE SIZE: \_\_\_\_\_  
 MAIN MATERIAL: \_\_\_\_\_ SERVICE MATERIAL: \_\_\_\_\_

CHLORINE RESIDUAL F \_\_\_\_\_ | T \_\_\_\_\_ PH \_\_\_\_\_

WATER TEMPERATURE HOT \_\_\_\_\_ COLD \_\_\_\_\_ BOTH \_\_\_\_\_

GALVANIC CONNECTIONS YES \_\_\_\_\_ NO \_\_\_\_\_ # \_\_\_\_\_

# OF SAMPLES TAKEN \_\_\_\_\_

SAMPLES SENT TO: HEALTH DEPARTMENT \_\_\_\_\_  
 PRIVATE LAB (LOCATION) \_\_\_\_\_  
 IN HOUSE \_\_\_\_\_

INFORMATION FROM COMPLAINT LOCATION: \_\_\_\_\_

ACTION TAKEN: Talked w/ Property manager (Bill) and explained our findings; water was clear upon first drawl as well as we talked w/ tenant on 8/29/08.

OPERATOR: TP10002

DATE: 8/2/08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: RB

DATE: 8-27-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 2800970003  
NAME Harry Hatten  
ADDRESS 214 Donald Dr  
PHONE \_\_\_\_\_

COMPLAINT TYPE: water is brown  
and has a funny  
taste

MAIN SIZE: 2"  
MAIN MATERIAL: GALV

SERVICE SIZE: 5/8  
SERVICE MATERIAL: 3

CHLORINE RESIDUAL 0.5 1 T PH 7.3

WATER TEMPERATURE HOT COLD BOTH  
X

GALVANIC CONNECTIONS YES X NO #

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Discoloration in water &  
test problems within the past few days

ACTION TAKEN: Flushed hydrant at the corner of Rye M  
& Donald for about 30-40 minutes, removed reg. head at residence & advised customer to flush  
all plumbing lines in the home. Provided a general  
explanation & what we would do to remedy the  
problem.

OPERATOR: TEC 10002  
RB12704

DATE: 8/27/08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: RB

DATE: 8-27-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 0802120001  
 NAME Blue Angel Ice Company  
 ADDRESS 4034 Barrancas Ave  
 PHONE 850-438-1636

COMPLAINT TYPE: water is brown

MAIN SIZE: ? SERVICE SIZE: 2 1/2"  
 MAIN MATERIAL: ? SERVICE MATERIAL: DE

CHLORINE RESIDUAL 0.4 | ? PH 7.2

WATER TEMPERATURE HOT COLD BOTH

GALVANIC CONNECTIONS YES ? NO X # ?

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT NA  
 PRIVATE LAB (LOCATION) NA  
 IN HOUSE NA

INFORMATION FROM COMPLAINT LOCATION: Customers  
noticed slight discoloration  
within the ice being produced.

ACTION TAKEN: Removed register head from meter,  
flushed service & fixtures for about  
45 minutes until water cleared.  
Residuals were good. Problem originated  
from previous week. Mainline area flushing.  
Also, this an end service/main.

OPERATOR: TD DATE: 9/27/08

**CUSTOMER COMPLAINT RECORD**

ENTERED BY: BB  
DATE: 8-12-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 2916200505  
NAME John R. McDonald  
ADDRESS 1235 Middlebrook Dr  
PHONE 850-456-9053

COMPLAINT TYPE: Cust says when he goes to his kitchen sink, water comes out pure brown.

MAIN SIZE: 8"  
MAIN MATERIAL: PVC

SERVICE SIZE: 3/4"  
SERVICE MATERIAL: PVC

CHLORINE RESIDUAL 0.5 1 T PH 7.2

WATER TEMPERATURE HOT NA COLD X BOTH

GALVANIC CONNECTIONS YES uk NO        #       

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Water was sicky this morning when He was making coffee.

ACTION TAKEN: Water was clear when we arrived. Didn't see any need to flush. Told Cust to call back if any more problems.

OPERATOR: R. Smith DATE: 8-12-08



## CUSTOMER COMPLAINT RECORD

ENTERED BY: ✓  
DATE: 7-22-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 0301910008  
NAME Debra Hamby  
ADDRESS 319 E Winthrop  
PHONE 850-455-0058COMPLAINT TYPE: Cust says her water is brown on a constant basis. she does not understand why this happens so often and would like someone to check itMAIN SIZE: 4" SERVICE SIZE: 3/4"  
MAIN MATERIAL: A/C SERVICE MATERIAL: ALLCHLORINE RESIDUAL 0.6 1 N/A PH 7.4WATER TEMPERATURE HOT N/A COLD N/A BOTH N/AGALVANIC CONNECTIONS YES N/A NO N/A # N/A# OF SAMPLES TAKEN 0SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0INFORMATION FROM COMPLAINT LOCATION: left customer to flush system.Water had debris in sinks & tubs.ACTION TAKEN: Remove meter to allow flushing of service. cust. stated all was clear after 30 min. runtime.OPERATOR: R Barnett  
B Horton DATE: 7-22-08

## CUSTOMER COMPLAINT RECORD

ENTERED BY: 9110  
DATE: 08-01-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 2001080002  
NAME Tom Birdwell  
ADDRESS 22 Lakeside Dr  
PHONE 850-456-6073COMPLAINT TYPE: Customer called and stated she and her husband keep having gastrointestinal issues and they think it's their water.MAIN SIZE: 3" SERVICE SIZE: 3/4"  
MAIN MATERIAL: PVC SERVICE MATERIAL: ALLCHLORINE RESIDUAL 0.5 1 N/A PH 7.2WATER TEMPERATURE HOT N/A COLD N/A BOTH N/AGALVANIC CONNECTIONS YES X NO N/A # N/A# OF SAMPLES TAKEN 1SAMPLES SENT TO: HEALTH DEPARTMENT 1  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0INFORMATION FROM COMPLAINT LOCATION: Water is clear and no odor.ACTION TAKEN: Sample sent to health dept. for customer's SALS action. Mr. Birdwell was concerned about soap in cleaning filter causing problems. Mrs. Birdwell was concerned about the filter as well. No problems were noticed of the water by me nor Bud.OPERATOR: R Barnett  
B Horton DATE: 8-1-08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: CB  
DATE: 7-17-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 1501640011  
NAME Karen Bartels  
ADDRESS 417 Seamarge Ln  
PHONE 332-7313

WATER IS  
COMPLAINT TYPE: yellow in color, dingy now  
in color, hot water seems clear.  
no smell, cust. flushed from  
back faucet for 5 minutes, did not  
clear.

MAIN SIZE: 3" SERVICE SIZE: 3/4  
MAIN MATERIAL: PVC SERVICE MATERIAL: ALL

CHLORINE RESIDUAL 0.7 <sup>F</sup> NA <sup>T</sup> PH 7.0

WATER TEMPERATURE NA HOT NA COLD NA BOTH NA

GALVANIC CONNECTIONS YES NA NO NA # NA

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: water had discoloration  
of line, getting cleared up as I spoke

ACTION TAKEN: None

OPERATOR: R Barrett DATE: 7/17/08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: RJR

DATE: 07-03-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER

1811375004

NAME

Jesse McWilliams

ADDRESS

2112 Augusta Ave

PHONE

449-010430

COMPLAINT TYPE:

Water smells & tastes like rubber.

MAIN SIZE:

3"

SERVICE SIZE:

3/4"

MAIN MATERIAL:

PVC

SERVICE MATERIAL:

PC

CHLORINE RESIDUAL

0.9

T

PH 7.3

WATER TEMPERATURE

HOT

COLD

BOTH

X

GALVANIC CONNECTIONS

YES

uk

NO

uk

#

# OF SAMPLES TAKEN

0

SAMPLES SENT TO:

HEALTH DEPARTMENT

0

PRIVATE LAB (LOCATION)

0

IN HOUSE

0

INFORMATION FROM COMPLAINT LOCATION:

gail water smells & tastes like rubber & had a pink color more around toilet bowl.

ACTION TAKEN:

explained about the water here. they left a jar of water, but the customer's were used. they didn't bother with anything. they were with the water. explained to the agent the air from inside was bad in the

OPERATOR:

R. Barrett

G. Lethbrum

DATE:

7-7-08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: RPK

DATE: 06-26-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 2501950000  
NAME Harold Meadows  
ADDRESS 519 Pelham Rd  
PHONE \_\_\_\_\_

COMPLAINT TYPE: Cust. says there is  
too much chlorine in  
water. She can't even make  
good tea.

MAIN SIZE: 3"

MAIN MATERIAL: AC

SERVICE SIZE: 3/4

SERVICE MATERIAL: PK

CHLORINE RESIDUAL 0.6 <sup>F</sup> 1 <sup>T</sup>

PH 7.1

WATER TEMPERATURE

HOT

N/A

COLD

X

BOTH

GALVANIC CONNECTIONS

YES uk

NO uk

# \_\_\_\_\_

# OF SAMPLES TAKEN 0

SAMPLES SENT TO:

HEALTH DEPARTMENT 0

PRIVATE LAB (LOCATION) 0

IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Water smells & Taste  
like Chlorine

ACTION TAKEN: Recommended leaving water run  
for a while before use. Told customer the  
smell was from lack of use, and water was  
fresh coming in there was no smell or taste

OPERATOR: Mark Cross  
B. Horton

DATE: 6-26-08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: CB  
DATE: 6-20-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 230 039 0005  
NAME Angela Miller  
ADDRESS 400 Rue MAX ST  
PHONE 607-2327

COMPLAINT TYPE: white scaly substance  
"Rock like chalk" out of all  
Faucets house. So much deposits  
she can not keep Aerator screens  
clear, all over her bathtub etc...

MAIN SIZE: 8"  
MAIN MATERIAL: A/C

SERVICE SIZE: 3/4  
SERVICE MATERIAL: PK

CHLORINE RESIDUAL 0 <sup>F</sup> 5 | <sup>T</sup> PH 24

WATER TEMPERATURE HOT NA COLD 2 BOTH

GALVANIC CONNECTIONS YES UK NO UK #    

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Scaly Flakes IN water  
only ~~found~~ inside the home / not outside  
Flakes Flaked when IN a glass

ACTION TAKEN: Recommended Flushing hot water  
to test possible dip tube deterioration

OPERATOR: D. Middlebrook  
B. H. H.

DATE: 6-20-08



**CUSTOMER COMPLAINT RECORD**

ENTERED BY: RPR  
DATE: 06-11-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 1000 22000 3  
NAME Thomas Parker Stephanie Parker  
ADDRESS 1060 Harborview Cir  
PHONE 433-0177

COMPLAINT TYPE: Dirty Water & Sand  
particles coming out of faucets  
mostly Bath tub & washer

MAIN SIZE: 3"  
MAIN MATERIAL: pvc

SERVICE SIZE: 3/4"  
SERVICE MATERIAL: all

CHLORINE RESIDUAL 0.5 1 N/A PH 7.4

WATER TEMPERATURE HOT N/A COLD N/A BOTH N/A

GALVANIC CONNECTIONS YES NO # 4/K

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT ✓  
PRIVATE LAB (LOCATION) ✓  
IN HOUSE ✓

INFORMATION FROM COMPLAINT LOCATION: Water in tub and  
wash machine had grit in it.

NO problems in Cold water

Had customer to  
ACTION TAKEN: Flush house and water heater  
House was empty for a time.

OPERATOR: RB Arret G. Cuthbert DATE: 6/11/08

**CUSTOMER COMPLAINT RECORD**

ENTERED BY: VC  
DATE: 6-3-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 2001555005  
NAME Catherine Fisk  
ADDRESS 37 STARLAKE DR  
PHONE 401-323 7742

David Trombly

COMPLAINT TYPE: Brown Water ran water for about 30 mins No change

MAIN SIZE: 6"  
MAIN MATERIAL: AC

SERVICE SIZE: 3/4"  
SERVICE MATERIAL: PC

CHLORINE RESIDUAL 0.4 | T PH 7.3

WATER TEMPERATURE HOT UK COLD UK BOTH

GALVANIC CONNECTIONS YES UK NO UK #

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Brown water in all faucets

ACTION TAKEN: Recommended flushing all lines because house had set traps for a while water at entry point of home was clear and had good residuals

OPERATOR: BA

DATE: 6-3-08

**CUSTOMER COMPLAINT RECORD**

ENTERED BY: CB  
DATE: 5-29-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 100 08900 00  
NAME William Deloach  
ADDRESS 918 Fairway DR  
PHONE 456-1386

COMPLAINT TYPE: Brown in color (1. Re test)  
no smell that she notices  
water is brown in all faucets, she  
did let them run for awhile but  
no change

MAIN SIZE: 2" SERVICE SIZE: 3/4"  
MAIN MATERIAL: Gal SERVICE MATERIAL: P/E

CHLORINE RESIDUAL 0.5 | 1 T PH 7.2

WATER TEMPERATURE HOT NA COLD X BOTH   

GALVANIC CONNECTIONS YES UK NO UK #   

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Dirty water in all  
cold faucets no smell just brown  
& cloudy

ACTION TAKEN: Remove Reg. Head ~~Reg~~ Told  
customer to flush her plumbing as  
as she could. Customer will call  
on 5/30 to let me know how its  
doing

OPERATOR: TD BW DATE: 5/29/08  
BH.

# CUSTOMER COMPLAINT RECORD

ENTERED BY: lc

DATE: 5-9-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 0401270001  
NAME Betty Jo Stewart  
ADDRESS 911 Paulding  
PHONE 453 0635

COMPLAINT TYPE: Chlorine smell & taste  
and when the water drains it  
leaves a grease feeling in sink.

MAIN SIZE: 6"  
MAIN MATERIAL: PVC

SERVICE SIZE: 3/4  
SERVICE MATERIAL: PE

CHLORINE RESIDUAL 0.5 1 T PH 7.2

WATER TEMPERATURE HOT NA COLD X BOTH

GALVANIC CONNECTIONS YES 45 NO        #       

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Capitol Customer Care  
About scummy water and water left sink  
greasy

ACTION TAKEN: Flushed Hydrant 3 House down from  
Customers for 30 mins at 800 gal a min  
Residuals at Hydrant 0.5 clz pH 7.3

OPERATOR: T. DeLeon

DATE: 5/9/08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: RB

DATE: 04-25-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER: 2730143001

NAME: Barton Hultien

ADDRESS: 2501 Gulf Breeze Ave

PHONE: 350-453-0484

COMPLAINT TYPE: water is very brown

MAIN SIZE: 6" 3"  
MAIN MATERIAL: PVC

SERVICE SIZE: 5"  
SERVICE MATERIAL: PE

CHLORINE RESIDUAL 0.5 | T PH 7.4

WATER TEMPERATURE HOT COLD BOTH

GALVANIC CONNECTIONS YES NO X #

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT NA  
PRIVATE LAB (LOCATION) NA  
IN HOUSE NA

INFORMATION FROM COMPLAINT LOCATION: Discolored water in the bath tub.

ACTION TAKEN: Flushed Hydrant before residence & flushout after residence. Flushed about 45 minutes. Also, problem originates from County the truck using fire hydrants water clean in main & at customer's home

OPERATOR: TO 10012  
GL

DATE: 4/25/08



# CUSTOMER COMPLAINT RECORD

ENTERED BY: KB  
DATE: 04-21-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER \_\_\_\_\_  
NAME Marc  
ADDRESS 2207 Apt 4101 W. Navy Blvd  
PHONE NO PHONE (Navy Pines Apts)

COMPLAINT TYPE: water has a funny smell

MAIN SIZE: \_\_\_\_\_  
MAIN MATERIAL: \_\_\_\_\_

SERVICE SIZE: \_\_\_\_\_  
SERVICE MATERIAL: \_\_\_\_\_

CHLORINE RESIDUAL 0.5 <sup>F</sup> 1 <sup>T</sup> PH 7.1

WATER TEMPERATURE Hot Hot Cold Both

GALVANIC CONNECTIONS YES u/k NO u/k # u/k

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Nothing wrong with the water, no odors detected by Russ, but, nor the maintenance man FRANK.

ACTION TAKEN: FRANK, said not to worry about anything, all is ok.

OPERATOR: R Barrett  
B Homan

DATE: 4-21-08

**CUSTOMER COMPLAINT RECORD**

ENTERED BY: RJR  
DATE: 04-16-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 01112000 2  
NAME Shirley Green  
ADDRESS 435 S. Mary + 437  
PHONE 456-3500

COMPLAINT TYPE: Brown water in all faucets.

MAIN SIZE: 2"  
MAIN MATERIAL: Gal.

SERVICE SIZE: 3/4"  
SERVICE MATERIAL: P.E.

CHLORINE RESIDUAL 0.4 | T PH 7.3

WATER TEMPERATURE HOT COLD BOTH  
X

GALVANIC CONNECTIONS YES NO # UK

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Brown Cloudy water in All Faucets.

ACTION TAKEN: Removed Register heads at both addresses, water discoloration was due to flushing in the area ask customers to flush their lines in the house.

OPERATOR: B. Horton  
R. Barnett

DATE: 4-17-08

**CUSTOMER COMPLAINT RECORD**

ENTERED BY: RB  
DATE: 04/02/08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER: 0510250005  
NAME: Rodolfo Agabin  
ADDRESS: 1520 S Fairfield  
PHONE: \_\_\_\_\_

COMPLAINT TYPE: taste like septic tank  
some discoloration  
taste different

MAIN SIZE: 6 SERVICE SIZE: 5/8  
MAIN MATERIAL: PVC SERVICE MATERIAL: PE

CHLORINE RESIDUAL 0.4 <sup>F</sup> | <sup>T</sup> PH 7.3

WATER TEMPERATURE \_\_\_\_\_ HOT \_\_\_\_\_ COLD X BOTH

GALVANIC CONNECTIONS YES X NO \_\_\_\_\_ # \_\_\_\_\_

# OF SAMPLES TAKEN 2 4/3/08

SAMPLES SENT TO: HEALTH DEPARTMENT 2  
PRIVATE LAB (LOCATION) NA  
IN HOUSE NA

INFORMATION FROM COMPLAINT LOCATION: odor & taste  
problems. Also, his doctor requested  
him to drink more water, he explained  
he usually drinks soda.

Note: 4/2/08 Samples collected tested absent  
Also, customer septic tank not working, drains clogged,  
water dumping on floor, hot water heater not used.

ACTION TAKEN: Flushed upstream & downstream hydrants  
nearest to residence. Residuals okay at  
front & 1st grt. Customer does not use hot water  
heater & is noticed odor from hot side.  
even though water was cold. Explained we will  
collect bacteriological samples.

OPERATOR: TP  
BA

DATE: 4/2/08  
4/3/08

Parkhurst & Son Printing / Publishing

4/9/08 TD talked w/customer

CUSTOMER COMPLAINT RECORD

ENTERED BY: RB  
DATE: 4-11-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 1000530004  
NAME Roger Beuc  
ADDRESS 3343 Chantarene  
PHONE 800-458-3047

COMPLAINT TYPE: Dirty Water  
very brown

MAIN SIZE: 4"  
MAIN MATERIAL: PVC

SERVICE SIZE: 3/4"  
SERVICE MATERIAL: PE

CHLORINE RESIDUAL 0 <sup>F</sup>4 <sup>T</sup>1 PH 7.6

WATER TEMPERATURE HOT COLD BOTH  
X

GALVANIC CONNECTIONS YES NO # N/A

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT  
PRIVATE LAB (LOCATION)  
IN HOUSE

INFORMATION FROM COMPLAINT LOCATION: Brown In the Tub  
and Toilet.

ACTION TAKEN: Flushed at meter Connection  
for approx. 50 mins

OPERATOR: R. Bankett

DATE: 4/14/08

## CUSTOMER COMPLAINT RECORD

ENTERED BY: rcDATE: 4-10-09

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 1010205003  
NAME Mildred Green  
ADDRESS 109 Seamaize Cir  
PHONE 453-9958

COMPLAINT TYPE: Brown Water

MAIN SIZE: 3'  
MAIN MATERIAL: pvc

SERVICE SIZE: 3/4'  
SERVICE MATERIAL: ATI

CHLORINE RESIDUAL 0.51 N/A PH 7.2

WATER TEMPERATURE N/A N/A N/A

GALVANIC CONNECTIONS YES chk NO chk # chk

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Water clear at  
house on outside.

2 Bathrooms discolored.

ACTION TAKEN: No where to flush main - Flushed  
Service All is ok on our side let cust.  
Flush house lines.

OPERATOR: R Barrett  
G HetherburyDATE: 4/10/09



# CUSTOMER COMPLAINT RECORD

ENTERED BY: SZ

DATE: 2-11

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 0419250000

NAME Colbert Kronk

ADDRESS 1008 Colbert Ave

PHONE \_\_\_\_\_

COMPLAINT TYPE: ling water (brown)

MAIN SIZE: 3"

MAIN MATERIAL: PVC

SERVICE SIZE: 3/4"

SERVICE MATERIAL: PE

CHLORINE RESIDUAL

0.7

PH 7.2

WATER TEMPERATURE

HOT

NA

COLD

X

BOTH

GALVANIC CONNECTIONS

YES

X

NO

# UK

# OF SAMPLES TAKEN

NONE

SAMPLES SENT TO:

HEALTH DEPARTMENT

NA

PRIVATE LAB (LOCATION)

NA

IN HOUSE

NA

INFORMATION FROM COMPLAINT LOCATION:

Water has slight discoloration, main line clear

ACTION TAKEN:

Remove Register head to flush register

OPERATOR:

R. Bennett

DATE:

2-11-05

**CUSTOMER COMPLAINT RECORD**

ENTERED BY: VC  
DATE: 3-14-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 1700040002  
NAME Dwayne Hill  
ADDRESS 204 B Holmes Dr  
PHONE 455-4428

COMPLAINT TYPE: Dirty Water

MAIN SIZE: 6"  
MAIN MATERIAL: PVC

SERVICE SIZE: 3/4"  
SERVICE MATERIAL: u/k

CHLORINE RESIDUAL 0.4 | N/A PH 7.4

WATER TEMPERATURE HOT N/A COLD N/A BOTH N/A

GALVANIC CONNECTIONS YES / NO / # u/k

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT  
PRIVATE LAB (LOCATION)  
IN HOUSE

INFORMATION FROM COMPLAINT LOCATION: Water was clear on arrival

ACTION TAKEN: Explained main break my home caused some discoloration, he will call back if discoloration returns.

OPERATOR: Robbatt Cleathu Benz DATE: 3/14/08

**CUSTOMER COMPLAINT RECORD**

ENTERED BY: RJK

DATE: 03-12-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 0110370003

NAME Lal Ent. L.L.C

ADDRESS 6003 N.W. Hwy

PHONE 850-393-7281

COMPLAINT TYPE: Water has funny smell to it

Customer left note on bill

MAIN SIZE: \_\_\_\_\_

SERVICE SIZE: \_\_\_\_\_

MAIN MATERIAL: \_\_\_\_\_

SERVICE MATERIAL: \_\_\_\_\_

CHLORINE RESIDUAL F | T PH \_\_\_\_\_

WATER TEMPERATURE HOT COLD BOTH

GALVANIC CONNECTIONS YES \_\_\_\_\_ NO \_\_\_\_\_ # \_\_\_\_\_

# OF SAMPLES TAKEN \_\_\_\_\_

SAMPLES SENT TO: HEALTH DEPARTMENT \_\_\_\_\_

PRIVATE LAB (LOCATION) \_\_\_\_\_

IN HOUSE \_\_\_\_\_

INFORMATION FROM COMPLAINT LOCATION: \_\_\_\_\_

\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

ACTION TAKEN: Called, water heater smells,  
As before, explained cust needs to  
Flush water heater.

OPERATOR: R Barnett

DATE: 3/12/08

# CUSTOMER COMPLAINT RECORD

ENTERED BY: CB  
DATE: 2-28-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 1902266005  
NAME Phillips, Terry (Catherine)  
ADDRESS 3357 Marion Oaks  
PHONE 332-7598

COMPLAINT TYPE: tastes funny, has been that way for about 4 mo.  
Does not have any other problems  
looks fine, smells fine.

MAIN SIZE: \_\_\_\_\_ SERVICE SIZE: \_\_\_\_\_  
MAIN MATERIAL: \_\_\_\_\_ SERVICE MATERIAL: \_\_\_\_\_

CHLORINE RESIDUAL 0.7 <sup>F</sup> 1 <sup>T</sup> N/A PH 7.7

WATER TEMPERATURE HOT N/A COLD N/A BOTH N/A

GALVANIC CONNECTIONS YES cell NO cell # cell

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Water is clear  
Seems OK

Customer mentions chlorine taste  
Beyond what he likes.

ACTION TAKEN: Flushed EOMAIN to make  
make better. No other action taken.

OPERATOR: R. BARNETT DATE: 2/28/08  
G. Lenthnerberg

# CUSTOMER COMPLAINT RECORD

ENTERED BY: KJR

DATE: 01-02-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 27,01060003

NAME Richard Golewin

ADDRESS 3260 Kinard Ave

PHONE Cell-384-0059 Hm-497-0813

COMPLAINT TYPE: White pebbles clogging up faucet.

MAIN SIZE: 6" PVC

SERVICE SIZE: 3/4

MAIN MATERIAL: PVC

SERVICE MATERIAL: all

CHLORINE RESIDUAL 0.6 <sup>F</sup> 1 <sup>T</sup> PH 7.5

WATER TEMPERATURE NA <sup>HOT</sup> NA <sup>COLD</sup> NA <sup>BOTH</sup>

GALVANIC CONNECTIONS YES UK NO UK # UK

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT NA

PRIVATE LAB (LOCATION) NA

IN HOUSE NA

INFORMATION FROM COMPLAINT LOCATION: White line park  
poss. by in water.

ACTION TAKEN: Remove motor head AND FL  
MAN AND SERVICE.

OPERATOR: R. B. Amort DATE: 1/2/08  
G. Leatherberry



**CUSTOMER COMPLAINT RECORD**

ENTERED BY: VC  
DATE: 1-10-08

THE PEOPLES WATER SERVICE COMPANY

ACCOUNT NUMBER 3101000001  
NAME Rosemary Perry  
ADDRESS 2000 CORAL ST  
PHONE 458-0115

COMPLAINT TYPE: Yellow water  
washed clothes they are yellow  
and sediment in the water.

MAIN SIZE: 4" SERVICE SIZE: 3/4"  
MAIN MATERIAL: PVC SERVICE MATERIAL: PE

CHLORINE RESIDUAL 0.6 <sup>F</sup> 1 <sup>T</sup> PH 7.1

WATER TEMPERATURE HOT COLD BOTH

GALVANIC CONNECTIONS YES NO X #

# OF SAMPLES TAKEN 0

SAMPLES SENT TO: HEALTH DEPARTMENT 0  
PRIVATE LAB (LOCATION) 0  
IN HOUSE 0

INFORMATION FROM COMPLAINT LOCATION: Nobody home @ 1:25pm  
1/10/08 for 10 min.

ACTION TAKEN: Flushed Main for 30 minutes about 2 houses  
away from residence. Returned to home 1/10/08  
explained to customer about flushing & no additional  
action necessary. Customer's water was clear/pale.

OPERATOR: RLB, BHT DATE: 1/10/08