

# AUSLEY McMULLEN

ATTORNEYS AND COUNSELORS AT LAW

123 SOUTH CALHOUN STREET  
P.O. BOX 391 (ZIP 32302)  
TALLAHASSEE, FLORIDA 32301  
(850) 224-9115 FAX (850) 222-7560

April 9, 2021

## ELECTRONIC FILING

Mr. Adam J. Teitzman, Commission Clerk  
Office of Commission Clerk  
Florida Public Service Commission  
2540 Shumard Oak Boulevard  
Tallahassee, Florida 32399-0850

Re: Docket 20210034-EI, Petition for Rate Increase by Tampa Electric Company


Dear Mr. Teitzman:

Attached for filing on behalf of Tampa Electric Company in the above-referenced docket is the Direct Testimony and Exhibit of J. Brent Caldwell.

Thank you for your assistance in connection with this matter.

(Document 5 of 34)

Sincerely,



J. Jeffry Wahlen

JJW/ne  
Attachment

cc: Richard Gentry, Public Counsel  
Jon Moyle, FIPUG



**BEFORE THE  
FLORIDA PUBLIC SERVICE COMMISSION**

**DOCKET NO. 20210034-EI  
IN RE: PETITION FOR RATE INCREASE  
BY TAMPA ELECTRIC COMPANY**

**DIRECT TESTIMONY AND EXHIBIT  
OF  
J. BRENT CALDWELL**

1                                   **BEFORE THE FLORIDA PUBLIC SERVICE COMMISSION**

2                                   **PREPARED DIRECT TESTIMONY**

3                                   **OF**

4                                   **J. BRENT CALDWELL**

5  
6   **Q.**   Please state your name, address, occupation, and employer.

7  
8   **A.**   My name is J. Brent Caldwell. My business address is 702  
9           N. Franklin Street, Tampa, Florida 33602. I am employed by  
10          Tampa Electric Company ("Tampa Electric" or "company") as  
11          Director, Planning and Fuels.

12  
13   **Q.**   Please describe your duties and responsibilities in that  
14          position.

15  
16   **A.**   My responsibilities include the long-term planning of Tampa  
17          Electric's energy resources to meet customer demand in an  
18          economic and reliable manner. I also oversee the  
19          optimization and trading associated with the planning and  
20          commitment of the system assets on a day-ahead basis.

21  
22   **Q.**   Please provide a brief outline of your educational  
23          background and business experience.

24  
25   **A.**   I received a bachelor's degree in electrical engineering

1 from Georgia Institute of Technology in 1985 and a Master  
2 of Science degree in Electrical Engineering in 1988 from  
3 the University of South Florida. I have over 25 years of  
4 utility experience with an emphasis in state and federal  
5 regulatory matters, fuel procurement and transportation,  
6 fuel logistics and cost reporting, and business systems  
7 analysis. In 2017, I assumed responsibility for Portfolio  
8 Optimization, which includes unit commitment, near-term  
9 maintenance planning, and natural gas and wholesale power  
10 trading. In December 2018, I assumed the role of Director,  
11 Planning and Fuels, which added responsibility for long-  
12 term planning to my existing responsibilities.

13  
14 **Q.** Have you previously testified before the Florida Public  
15 Service Commission ("Commission")?

16  
17 **A.** Yes. I submitted written testimony in the annual fuel  
18 docket from 2011 through 2019. In 2015, I testified in  
19 Docket No. 20150001-EI regarding natural gas hedging. I  
20 have also testified before the Commission in Docket No.  
21 20120234-EI regarding the company's fuel procurement for  
22 the Polk 2-5 Combined Cycle Conversion project and filed  
23 testimony in Docket No. 20130040-EI regarding fuel  
24 inventory levels in Tampa Electric's last rate case.

25

1 Q. What are the purposes of your direct testimony?

2

3 A. The purposes of my direct testimony are to describe and  
4 explain the prudence of constructing the company's Big Bend  
5 Modernization Project ("Big Bend Modernization"). This  
6 project is part of the company's ongoing process to promote  
7 safety, improve the customer experience, and become a  
8 cleaner and greener utility. I will describe the company's  
9 Big Bend Generating Station, the analysis we undertook  
10 before beginning Big Bend Modernization, why the project  
11 is prudent, and how the project will improve our customer  
12 experience and benefit our customers and the communities  
13 we serve. I will also explain why it is prudent to retire  
14 Big Bend Unit 3 in April 2023.

15

16 Q. How does your direct testimony relate to the direct  
17 testimony of other Tampa Electric witnesses?

18

19 A. My direct testimony addresses the prudence of Big Bend  
20 Modernization and the early retirement of Big Bend Unit 3.  
21 Tampa Electric's witness David A. Pickles describes how  
22 the Big Bend Modernization Project and early retirement of  
23 Big Bend Unit 3 fit into the company's overall Resource  
24 Plans and the costs and project status of Big Bend  
25 Modernization. He also describes the units of property

1 associated with Big Bend Units 1, 2, and 3 that will be  
2 retired and the items of inventory that will become  
3 obsolete when our plans for Units 1, 2, and 3 have been  
4 executed.

5  
6 Mr. Pickles will describe the changes underway at Big Bend  
7 Power Station. Tampa Electric witness Davicel Avellan will  
8 explain how those changes affect our depreciation and  
9 dismantlement rates and create a need to recover the  
10 undepreciated net book value of the portions of Big Bend  
11 Units 1, 2, and 3 to be retired and related obsolete  
12 inventory via capital recovery schedules.

13  
14 **Q.** Have you prepared an exhibit to support your direct  
15 testimony?

16  
17 **A.** Yes. Exhibit No. JBC-1, entitled "Exhibit of J. Brent  
18 Caldwell" was prepared under my direction and supervision.  
19 The contents of my exhibit were derived from the business  
20 records of the company and are true and correct to the best  
21 of my information and belief. It consists of four  
22 documents, as follows:

23  
24 Document No. 1: Big Bend Modernization Photos and  
25 Artist Renderings

- 1 Document No. 2: Big Bend Modernization Options
- 2 Considered and Relative CPVRR Savings
- 3 without Emissions Cost Savings
- 4 Document No. 3: CPVRR by Component for Big Bend
- 5 Modernization
- 6 Document No. 4: CPVRR by Component from Big Bend Unit
- 7 3 Early Retirement

8  
9

**OVERVIEW OF BIG BEND GENERATING STATION**

10 **Q.** Please describe Tampa Electric's generation assets.

11

12 **A.** Tampa Electric has three centralized thermal generation  
13 stations: Big Bend Station, Polk Power Station ("Polk"),  
14 and the H.L. Culbreath Bayside Power Station ("Bayside").  
15 Big Bend Station, Polk and Bayside use fossil steam units,  
16 combined cycle units ("CC"), combustion turbine peaking  
17 units ("CT"), and an integrated gasification combined cycle  
18 unit ("IGCC") to generate electricity. Tampa Electric also  
19 has a fleet of solar photo voltaic ("PV") generation sites  
20 distributed across the service territory and a small  
21 battery energy storage device near Big Bend Station.

22

23 **Q.** Please describe Tampa Electric's Big Bend Power Station  
24 ("Big Bend").

25

1     **A.**    Big Bend consists of four steam turbines and an aero-  
2            derivative combustion turbine. The steam turbine units were  
3            originally designed to operate on high-sulfur, pulverized  
4            coal from the Illinois Basin. The units became operational  
5            in 1970, 1973, 1976, and 1985 for Units 1, 2, 3, and 4,  
6            respectively. The company's last depreciation study in 2011  
7            contemplated that each of the steam turbine units would be  
8            retired after useful lives of 65 years.

9  
10    **Q.**    What types of equipment are needed to support these  
11            pulverized coal generating units?

12  
13    **A.**    Big Bend has equipment to receive, unload, store, blend,  
14            and pulverize coal that is received by barge or by rail.  
15            Each unit also has emission control equipment, such as  
16            precipitators to capture particulate matter, flue gas  
17            desulfurization ("FGD") scrubbers to capture sulfur  
18            oxides, and selective catalytic reduction units ("SCR") to  
19            capture nitrous oxides. Big Bend Unit 4 was originally  
20            designed and built with most of this emission control  
21            equipment in 1985. The company later retrofitted Big Bend  
22            Units 1, 2, and 3 to add this equipment.

23  
24    **Q.**    Have the Big Bend units evolved in other ways?

25



1 **A.** Yes. The four Big Bend pulverized coal units were  
2 originally designed and built to consume high-sulfur, low-  
3 cost Illinois Basin coal. This fuel choice provided  
4 significant fuel cost savings to Tampa Electric customers  
5 because, historically, Illinois Basin coal was the lowest  
6 cost delivered fuel. However, since international demand  
7 for U.S. coal increased and non-conventional shale gas  
8 production caused the price of natural gas to decrease,  
9 natural gas became a more competitively priced option for  
10 electric generation.

11  
12 In 2015, Tampa Electric first took advantage of the greater  
13 availability and lower price of natural gas and replaced  
14 oil with natural gas as the fuel used to start up Big Bend  
15 Units 1 through 4. This change significantly reduced the  
16 cost of fuel associated with unit startup.

17  
18 In 2017, Tampa Electric went a step further by adding  
19 natural gas burners so that each unit could be partially  
20 operated on natural gas. Tampa Electric added additional  
21 natural gas burners to Big Bend Units 1, 2, and 3 so that  
22 those units can operate close to maximum dependable  
23 capacity ("MDC") on natural gas. This dual-fuel capability  
24 enabled the company to run the Big Bend units on natural  
25 gas when available and the pricing is advantageous. The

1 ability to co-fire on natural gas also improved unit and  
2 system reliability since the Big Bend units do not need to  
3 be taken offline in the event of a coal handling issue.

4  
5 Mr. Pickles provides additional details about the  
6 transformation of Big Bend Station in his direct testimony.

7  
8 **Overview of the Big Bend Modernization Project**

9 **Q.** Please generally describe the Big Bend Modernization  
10 Project.

11  
12 **A.** The Big Bend Modernization Project consists of three  
13 fundamental building blocks: (1) the retirement of Big Bend  
14 Unit 2 and all of its associated equipment, (2) the  
15 refurbishment of Big Bend Unit 1's steam turbine and  
16 generator, and (3) replacement of Big Bend Unit 1's boiler  
17 and coal processing equipment with two new GE 7HA.02 CTs  
18 and associated heat recovery steam generators ("HRSG").  
19 Document No. 1 of my exhibit contains photographs and  
20 artist renderings of the project.

21  
22 The Big Bend Modernization Project has two phases and will  
23 take approximately 42 months to complete. Mr. Pickles  
24 describes the activities and costs associated with the two  
25 phases and details of the project timeline in his direct

1 testimony. He also explains that the project is on time  
2 and within budget.

3  
4 **Q.** In general, what components of Big Bend Unit 1 will be  
5 retained and what components of Big Bend Units 1 and 2 will  
6 be retired?

7  
8 **A.** Essentially all coal-related equipment and steam  
9 production equipment associated with Big Bend Unit 1 will  
10 be retired and all the equipment associated with the  
11 production of electricity from Big Bend Unit 1 will be  
12 retained. The equipment being retired from Big Bend Unit 1  
13 includes coal mills, coal pulverizing equipment, coal  
14 injectors, the boiler, slag tanks, ash hoppers,  
15 precipitators, and the flue gas desulfurization scrubber.

16  
17 The primary components being retained and modernized for  
18 Big Bend Unit 1 include the steam turbine, the generator,  
19 ductwork, fans, the cooling system, circulating pumps, and  
20 selective catalytic reduction equipment. With respect to  
21 Big Bend Unit 2, essentially all unit specific equipment  
22 will be retired.

23  
24 **Q.** How will the capacity and heat rates for the modernized  
25 Big Bend Unit 1 compare to those of the original Big Bend

1 Units 1 and 2?

2

3 **A.** The Big Bend Modernization Project will increase the  
4 combined generating capacity for Big Bend Units 1 and 2  
5 from approximately 800 MW to a winter capacity of 1,120 MW  
6 when the repowering is complete.

7

8 The Big Bend Modernization Project will also improve the  
9 generating efficiency at Big Bend. Prior to the Big Bend  
10 Modernization, Units 1 and 2 had operational heat rates of  
11 over 10,500 Btu/kWh. The modernized Big Bend Unit 1 will  
12 be the most efficient generating unit in the company's  
13 fleet, with an expected operational heat rate of  
14 approximately 6,350 Btu/kWh, an efficiency gain of 40  
15 percent. This means lower natural gas fuel volumes, lower  
16 energy costs, and lower emissions, which will result in  
17 savings for customers.

18

19 **Q.** What other operational benefits will the Big Bend  
20 Modernization Project bring to Tampa Electric's system?

21

22 **A.** The modernizing of Big Bend Unit 1 will yield two other  
23 important improvements. First, Big Bend Unit 1 will have  
24 the ability to run in simple-cycle operation, combined-  
25 cycle operation, or a mix of the two, which will provide

1 significant operating flexibility to meet rapidly changing  
2 system needs. In addition to flexible operational modes,  
3 the modernized Big Bend Unit 1 will be able to change its  
4 output much more quickly and vary its output over a much  
5 wider MW range than the existing Big Bend Units 1 and 2  
6 can. With the evolving industry and changing load dynamics,  
7 having a unit with this amount of operational flexibility,  
8 especially as compared to 1970s-vintage pulverized coal  
9 steam turbines, will be critical for meeting current and  
10 future customer needs.

11  
12 Second, the repowered unit will be more reliable. CTs are  
13 inherently more reliable than the pulverized coal units,  
14 and the ability to run in simple-cycle and combined-cycle  
15 modes enhances the reliability of the unit and facilitates  
16 scheduling of maintenance.

17  
18 Mr. Pickles provides additional details about the  
19 operational benefits of Big Bend Modernization, including  
20 how the project will complement the company's solar  
21 generation facilities, in his direct testimony.

22  
23 **Q.** Has Tampa Electric executed a project like Big Bend  
24 Modernization before?  
25

1     **A.**     Yes, the Big Bend Modernization is just the latest example  
2             of Tampa Electric refurbishing and integrating existing  
3             generation assets with new technology to cost effectively  
4             meet customer growth needs and improve overall system  
5             efficiency. Tampa Electric repowered Gannon coal units 5  
6             and 6 into Bayside Units 1 and 2 in 2003 and 2004. Just  
7             like the modernization of Big Bend Unit 1, new natural gas  
8             combustion turbines and heat recovery steam generators were  
9             integrated with a refurbished existing steam turbine and  
10            electrical generator to create a more efficient, more  
11            reliable, and more flexible natural gas combined cycle  
12            ("NGCC") unit. When Bayside 1 and Bayside 2 came online,  
13            they became the most efficient and most reliable units on  
14            the Tampa Electric system.

15  
16            Tampa Electric used this process again in 2017 at Polk  
17            Station. The four existing combustion turbines at Polk  
18            Station were integrated with new heat recovery steam  
19            generators, a new steam turbine, and a new electric  
20            generator. As was the case when the Bayside project went  
21            in-service, when the Polk Unit 2 NGCC became the most  
22            efficient and most reliable unit on the system when it came  
23            online. Tampa Electric has proven the concept of using  
24            existing assets to create a new NGCC at a lower cost than  
25            building a whole new unit. The Big Bend Modernization is

1 exactly the same concept and, when it comes online as a  
2 NGCC unit, will be the most efficient unit on the system.  
3

#### 4 **Analysis Leading to Big Bend Modernization**

5 **Q.** Please describe the industry trends that initiated the  
6 analysis the company performed before beginning Big Bend  
7 Modernization.  
8

9 **A.** Tampa Electric regularly reviews the retirement horizon of  
10 its generation units. In the early to mid-2010s, this  
11 review took on an added sense of urgency for several  
12 reasons.  
13

14 First, numerous environmental initiatives such as the  
15 Mercury and Air Toxics Standards, the Clean Power Plan,  
16 and the Coal Combustion Residuals rule cast significant  
17 uncertainty on the long-term cost and viability of  
18 pulverized coal units.  
19

20 Second, by then Units 1 and 2 were over forty years old,  
21 and while the units can operate for the remainder of their  
22 65-year depreciation lives, annual budgeting activities  
23 revealed rising capital investment and operating cost to  
24 maintain sufficient performance, reliability, and safety  
25 for these units.

1 Finally, technology advancements yielding greater  
2 efficiency and lower costs for NGCC generation, coupled  
3 with relatively lower cost natural gas produced from non-  
4 conventional production technologies, caused efficient  
5 NGCC generation to supplant pulverized coal generation,  
6 even for existing units, as a more cost-effective and  
7 emission-friendly generation choice.

8  
9 **Q.** Please describe the process the company used to identify,  
10 select, and evaluate Big Bend Modernization.

11  
12 **A.** The company started with a screening of options available  
13 at the Big Bend Station site to identify and select the  
14 best alternative for assets at Big Bend. The screening  
15 process, conducted in 2016, looked at multiple options for  
16 Big Bend Station including various retirement scenarios,  
17 various repowering configurations, and new build options.  
18 The screening process determined that the retirement of  
19 Big Bend Unit 2 coupled with the modernization of Big Bend  
20 Unit 1 into a NGCC was the best option for Tampa Electric  
21 customers.

22  
23 **Q.** What were the primary factors that supported identification  
24 of the Big Bend Modernization as the right choice for  
25 customers?



1 **A.** Three main factors supported Big Bend Modernization as the  
2 right choice.

3  
4 The first factor was the cost of continuing to operate Big  
5 Bend Units 1 and 2 on pulverized coal. While Units 1 and 2  
6 have provided Tampa Electric low-cost energy for decades,  
7 their relative inefficiency, recent increases in fuel  
8 costs, emissions intensity, and increasing levels of  
9 investment required to operate the units safely and  
10 reliably opened the door for a life-cycle review.

11  
12 The second factor was the cost savings associated with  
13 retaining and reusing existing assets through repowering  
14 of a Big Bend unit. Using Big Bend Unit 1's steam turbine,  
15 generator, cooling system, transmission infrastructure,  
16 land, and water rights made repowering both cost effective  
17 and executable.

18  
19 The third factor was that the staged approach for bringing  
20 the two new CTs online in 2021 will (1) ease the operational  
21 challenges associated with removing 800 MW of generating  
22 capacity from service and (2) provide operational and  
23 reliability benefits to our system before the project will  
24 be finished.

25

1 **Q.** Once the modernization of Big Bend Unit 1 was selected for  
2 the Big Bend site, what other alternatives were considered?

3  
4 **A.** Once the Big Bend Modernization Project was selected as  
5 the option at Big Bend, the Project was further tested  
6 against other resource alternatives available to the  
7 system. As it does each year, the company updated its load  
8 forecasts, fuel price forecasts, maintenance schedules,  
9 and other projections in the early summer of 2017 to  
10 prepare the company's 2018 projected fuel cost filing. The  
11 2017 Ten-Year Site Plan with updated inputs became the base  
12 case for the analysis. Using these fully updated  
13 assumptions, the company compared Big Bend Modernization  
14 to the base case and several other expansion alternatives  
15 including options to build new generation and options to  
16 purchase power in the market.

17  
18 **Q.** What did this comparison to other options show?

19  
20 **A.** The comparison showed that the Big Bend Modernization  
21 Project is expected to provide \$747 million of cumulative  
22 present value revenue requirement ("CPVRR") savings for  
23 customers compared to the base case. The evaluation also  
24 showed that the Big Bend Modernization Project was the  
25 lowest cost alternative by at least \$50 million CPVRR.

1 **Q.** Please further describe the other alternatives considered.

2

3 **A.** The other alternatives analyzed by the company, and their  
4 savings relative to Big Bend Modernization, are shown in  
5 Document No. 2 of my exhibit.

6

7 The options included building combustion turbines without  
8 retiring any Big Bend units (the base case), retiring both  
9 Big Bend Units 1 and 2 and building combustion turbines  
10 and converting them to combined cycle, and the Big Bend  
11 Modernization Project. Of these build options, the Big Bend  
12 Modernization process was the most cost-effective option  
13 driven largely by the reuse of existing steam turbine and  
14 generation assets, leveraging existing water rights,  
15 circulating water cooling assets and transmission assets,  
16 and immediate fuel savings from improved efficiency of the  
17 system.

18

19 The options also included buying power or existing  
20 generation facilities from the wholesale power market. The  
21 wholesale market options ranged from peaking power to full-  
22 requirements system power and also included solar  
23 photovoltaic purchase power options. The Big Bend  
24 Modernization Project was more cost-effective than all of  
25 the wholesale market purchased power options. Like the

1 alternate build options, the wholesale power purchase  
2 options cannot overcome Big Bend Modernization's  
3 advantages of using existing rights and assets.  
4 Additionally, wholesale power projects have the additional  
5 hurdles of paying for transmission capacity on neighboring  
6 systems, paying for ancillary and balancing services, and  
7 have uncertainty regarding timing and impact of changing  
8 transmission and network dynamics.

9  
10 **Q.** What are some of the key insights from the analysis?  
11

12 **A.** First, avoiding the ongoing capital, operating, and  
13 maintenance expense associated with Big Bend Units 1 and 2  
14 provides the foundation of benefits to customers. Second,  
15 combined cycle energy with its high efficiency and low-  
16 cost generation was the type of resource needed by the  
17 system and provides significant fuel cost savings to  
18 customers. And third, because of the reuse of existing  
19 generation equipment, existing transmission rights and  
20 equipment, and existing water rights and equipment, the  
21 Big Bend Modernization Project was the most cost-effective  
22 option for customers.  
23

24 **Q.** Are there other aspects of the Big Bend Modernization  
25 Project that make it beneficial beyond the cost

1 effectiveness analysis?

2

3 **A.** Yes, there are several benefits from the Big Bend  
4 Modernization Project. First, the Tampa Electric  
5 transmission and distribution system has been built and  
6 operated with a large portion of the capacity and energy  
7 being sourced from the Big Bend Station location. Building  
8 a new resource at a different location or buying power that  
9 is imported into the system creates new flows and dynamics  
10 that will likely increase operational costs and  
11 complexities. Second, the Big Bend Modernization Project  
12 provided certainty of execution. Permitting water use  
13 rights and securing or building new transmission capability  
14 is challenging, both from a cost certainty standpoint and  
15 a time to complete standpoint. Whether building new  
16 generation or buying from the wholesale power market, all  
17 options besides modernizing Big Bend Unit 1 have a much  
18 higher level of cost and timing risk associated with  
19 permits and transmission. And, third, modernizing Big Bend  
20 Unit 1 so that the company keeps a large, spinning  
21 generator on its system provides "inertia" that helps  
22 maintain voltage regulation, frequency regulation, and  
23 other ancillary services that maintain system stability  
24 and integrity that is difficult and expensive to provide  
25 from outside the system.

1     **Q.**     Did the company conduct a formal request for proposals from  
2             the Florida wholesale power market?

3  
4     **A.**     Tampa Electric included numerous wholesale power  
5             alternatives in the options it considered, but it did not  
6             conduct a formal request for proposals. Since the analysis  
7             showed that no build or purchase options were likely to be  
8             more cost effective than the modernization project, and  
9             the other options lacked the previously mentioned benefits  
10            of reusing the existing generation and transmission  
11            infrastructure, the company moved forward with the project  
12            to capture its benefits for customers more quickly rather  
13            than risking delay and cost from a request for proposals.

14  
15    **Q.**     Did the company consider the value of reduced emissions in  
16             the assessment of the project?

17  
18    **A.**     Yes. The company calculated CPVRR savings with and without  
19             avoided emission costs. Using an industry-recognized  
20             forecast of the cost associated with emissions of CO<sub>2</sub>, SO<sub>2</sub>,  
21             and NO<sub>x</sub>, the company estimates that the Big Bend  
22             Modernization Project will avoid approximately \$108  
23             million of emission costs. As shown on Document No. 3 of  
24             my exhibit, the company estimates that the total CPVRR  
25             savings from Big Bend Modernization are \$855 million when

1           avoided emissions costs are included.

2

3       **Q.**    Could energy conservation, load management, or other  
4           demand-side management programs have deferred or avoided  
5           the need for the Big Bend Modernization Project?

6

7       **A.**    No. Demand-side management programs simply could not be  
8           implemented with the magnitude or the certainty needed to  
9           replace 800 MW of baseload generation. Even if cost-  
10          effective at that magnitude, demand-side management  
11          programs could not provide the operational flexibility  
12          provided by the quick start, rapid ramp rates, and  
13          transmission network support associated with Big Bend  
14          Modernization.

15

16       **Q.**    What approvals were requested and received for Big Bend  
17          Modernization?

18

19       **A.**    First, Tampa Electric had to get approval from Emera,  
20          Inc.'s Board of Directors and the Emera Finance Committee  
21          to assure funding of the project by Emera. The Board  
22          approved the project on February 18, 2018, and the Finance  
23          Committee approved the project on May 24, 2018.

24

25          Second, Tampa Electric filed a Site Certification

1 Application with the Florida Department of Environmental  
2 Protection on April 18, 2018. After extensive discovery  
3 and five days of hearings on March 11 through 15 of 2019,  
4 the administrative law judge issued an order on May 30,  
5 2019 recommending approval of the project. The Governor  
6 and cabinet sitting as the Power Plant Siting Board  
7 approved the project on July 25, 2019.

8  
9 **Q.** What is the status of the project?

10  
11 **A.** Big Bend Modernization is on schedule and within budget.  
12 The total project cost for which Tampa Electric is seeking  
13 recovery is projected to be \$893 million, including AFUDC,  
14 three million less than the \$896 million, including AFUDC,  
15 used in the cost-effectiveness analysis. At \$893 million,  
16 the cost of the project is approximately \$800 per kW which  
17 is lower than all recent, similarly sized projects in  
18 Florida, further supporting that the project is the right  
19 choice for customers. More details about the status of the  
20 project are included in the testimony of Mr. Pickles.

21  
22 **Building Big Bend Modernization is Prudent**

23 **Q.** Is Big Bend Modernization prudent, and what benefits does  
24 it provide to Tampa Electric and its customers?

25



1 **A.** Yes. The Big Bend Modernization Project is prudent and  
2 provides numerous benefits to Tampa Electric and its  
3 customers. The benefits generally include avoided  
4 investments of capital and operating costs for two aging  
5 pulverized coal units, greater reliability and flexibility  
6 of the company's generating system, fuel savings from  
7 improved generating efficiency, lower emissions, reduced  
8 water consumption and wastewater, and, finally, continued  
9 support of the winter population of manatees. More  
10 specifically:

11  
12 1. Construction and operation of Big Bend Modernization  
13 and the related replacement of the portions of Units 1 and  
14 2 to be retired is prudent because the project and  
15 associated retirements was the best available option and  
16 will yield a \$747 million CPVRR savings to customers  
17 compared to the base case, without avoided carbon emission  
18 costs and \$855 million with.

19  
20 2. The repowered Big Bend Unit 1 will be the most  
21 efficient generating unit in the company's fleet, with an  
22 expected operational heat rate of approximately 6,350  
23 Btu/kWh. This means lower natural gas fuel volumes, lower  
24 energy costs, and lower emissions, which will result in  
25 savings for customers.

1           3.    The retirement of portions of Big Bend Unit 1 and all  
2           of Big Bend Unit 2 will allow the company to avoid spending  
3           an estimated total of \$293 million CPVRR of capital to keep  
4           Big Bend Units 1 and 2 operating for the remainder of their  
5           Commission-approved lives.

6  
7           4.    Having removed Big Bend Unit 1 from commercial service  
8           in June 2020, the company will avoid making the  
9           approximately \$151 million CPVRR of capital expenditures  
10          needed to keep Big Bend Unit 1 in service in its current  
11          form until its planned retirement date of 2035.

12  
13          5.    Removing Big Bend Unit 2 from commercial service in  
14          December 2021 will allow the company to avoid making the  
15          approximately \$142 million CPVRR of capital expenditures  
16          needed to keep Big Bend Unit 2 in service until its planned  
17          retirement date of 2038.

18  
19          6.    The project will re-use much of the existing Big Bend  
20          Unit 1 infrastructure such that it moderates the dollar  
21          value of retired assets subject to a special capital  
22          recovery schedule and related customer rate impacts.

23  
24          7.    The project will improve the company's overall  
25          generating system reliability. It will also make the Big

1 Bend Station generating units more reliable on a stand-  
2 alone basis. The annual Net Equivalent Availability Factor  
3 ("EAF") for Units 1 and 2 in 2019 were less than 70 percent.  
4 The company expects the EAF for the repowered Big Bend Unit  
5 1 to be approximately to be 93 percent in combined cycle  
6 mode and 98 percent in simple cycle mode.

7  
8 8. The company will burn less coal, use less water, and  
9 generate less wastewater than under the status quo, making  
10 Tampa Electric cleaner and greener.

11  
12 9. The project will lower the company's emission of CO<sub>2</sub>,  
13 SO<sub>2</sub>, and NO<sub>x</sub> relative to current levels and levels projected  
14 for the future.

15  
16 10. The project will enable the company to moderate the  
17 amount of money it must spend on solid fuel before Big Bend  
18 Modernization is complete while maintaining an acceptable  
19 level of warm water discharge to the existing manatee  
20 sanctuary.

21  
22 11. The project will complement the company's approved  
23 solar projects by providing winter reserve margin, 24-7  
24 energy, and regulation support for the solar generation,  
25 which is an intermittent resource. The flexibility and

1 "following" ability inherent in the repowered Big Bend Unit  
2 1 will effectively complement the company's utility scale  
3 solar generation. The repowered Big bend Unit 1 will be  
4 able to quickly offset the variability of solar plants as  
5 weather conditions change by ramping up or reducing output.  
6

7 12. The project will allow the company to reduce O&M  
8 expenses at Big Bend through staffing reductions and other  
9 means as explained further in the direct testimony of Mr.  
10 Pickles.  
11

12 13. The project will enhance safety by making Big Bend an  
13 inherently safer work environment by eliminating the  
14 complex and aging equipment related to coal handling and  
15 coal generation associated with Big Bend Units 1 and 2.  
16

17 **Q.** Did the company identify the costs of not moving forward  
18 with Big Bend Modernization, and, if so, what were they?  
19

20 **A.** Yes. If the company chose not to modernize Big Bend, the  
21 alternative would be to serve customers using a traditional  
22 expansion plan that adds simple-cycle combustion turbines.  
23 Under this approach, Tampa Electric and its customers would  
24 incur additional costs of \$747 million CPVRR. This approach  
25 would also impose other costs and burdens on Tampa Electric

1 and its customers, such as greater water usage, higher  
2 emissions, and lower reliability. Perhaps most  
3 importantly, Tampa Electric and its customers may have  
4 missed out on the opportunity afforded by Big Bend  
5 Modernization, to advance the system with new, more  
6 efficient technology.

7  
8 **Q.** How will Big Bend Modernization benefit Florida and the  
9 communities Tampa Electric serves?

10  
11 **A.** Big Bend Modernization will benefit Florida and the  
12 communities Tampa Electric serves by materially improving  
13 the electrical grid with higher efficiency, lower  
14 emissions, greater reliability, and greater operational  
15 flexibility. The project achieves these benefits while  
16 reusing most of the existing Big Bend Unit 1 generation  
17 assets, water rights, and transmission infrastructure.

18  
19 **Q.** How does the project complement the company's investment  
20 in utility scale solar?

21  
22 **A.** Tampa Electric is committed to cost-effectively reducing  
23 its impact on the environment and solar PV generation is  
24 an important component of this commitment. Customers want  
25 Tampa Electric to incorporate as much cost-effective solar

1 energy as can be managed reliably. By its very nature,  
2 solar energy is non-dispatchable, meaning it produces  
3 energy when the solar radiance is available, not  
4 necessarily when the utility needs it. Similarly, solar  
5 energy output is erratic, with wide, frequent swings as  
6 clouds pass overhead.

7  
8 The Big Bend Modernization Project will replace two aging  
9 pulverized coal units that have limited output range and  
10 are slow to vary output with two state-of-the-art  
11 combustion turbines that can start quickly, ramp rapidly,  
12 and generate across a wide MW range. While the Big Bend  
13 Modernization Project is not solely intended to support  
14 solar, its presence on Tampa Electric's system will improve  
15 our ability to use existing solar resources and add  
16 additional utility scale solar generation as discussed in  
17 the testimony of Mr. Sweat and Mr. Aponte.

18  
19 **Q.** Will the project provide a capacity benefit for the  
20 company?

21  
22 **A.** Yes. With a winter capacity of 1,120 MW, compared to about  
23 800 MW for existing Big Bend Units 1 and 2, Big Bend  
24 Modernization will provide approximately 300 MW of  
25 incremental, reliable, and flexible generating capacity.

1 The cost of the modernization is more than offset by cost  
2 savings from using existing assets from Big Bend Unit 1,  
3 fuel savings from improved efficiency, and redeployment of  
4 capital and O&M to new technology instead of maintaining  
5 aging coal units.

6

7 **Q.** Will the Big Bend Modernization Project advance the  
8 company's three areas of strategic focus - safety, customer  
9 experience, and being cleaner and greener?

10

11 **A.** Yes. The project will support all three areas of strategic  
12 focus.

13

14 The project will enhance safety by making Tampa Electric's  
15 Big Bend Station an inherently safer work environment by  
16 removing complex aging equipment used for coal handling  
17 and coal-fired generation associated with Units 1 and 2.

18

19 The project will enhance the customer experience because  
20 customers will receive increased reliability and lower  
21 costs for their electrical service.

22

23 The project will allow the company to make significant  
24 progress on its goal of running a cleaner and greener  
25 generating fleet by replacing two pulverized coal units

1 with a much more efficient, reliable, and flexible NGCC  
2 unit with lower emission levels, water consumption levels,  
3 and solid waste like coal combustion residuals. As I  
4 previously mentioned, the increased reliability and  
5 flexibility of repowered Big Bend Unit 1 will enhance the  
6 company's ability to accommodate increasing levels of zero-  
7 emission, zero fuel cost solar generation.

8  
9 **Q.** Will Big Bend Modernization increase the company's need  
10 for natural gas?

11  
12 **A.** Yes, but not as much as one might expect. First, Tampa  
13 Electric would need more gas pipeline capacity if the  
14 energy to be generated by the modernized Big Bend Unit 1  
15 would be generated from existing, less efficient units.  
16 When Big Bend Units 1 and 2 are fueled with natural gas,  
17 it requires nearly twice as much natural gas commodity and  
18 pipeline capacity for the same amount of electrical energy  
19 from the modernized Big Bend Unit 1. Even if Big Bend Units  
20 1 and 2 are operating on coal, their much lower  
21 availability factor means that frequently the energy they  
22 produce must be replaced with natural gas burned in the  
23 inefficient Big Bend units or in other gas units on the  
24 Tampa Electric system. While the very efficient and very  
25 reliable modernized Big Bend Unit 1 may increase the



1 average daily need for natural gas supply and pipeline  
2 capacity, it eliminates the unpredictable spikes in gas  
3 supply and pipeline capacity demands associated with the  
4 units it replaces. Overall, Tampa Electric's reliance on  
5 natural gas increases with the project, but the ultimate  
6 management of that natural gas demand improves  
7 significantly.

8  
9 **Q.** Is it prudent to retire portions of Big Bend Units 1 and 2  
10 as part of Big Bend Modernization before the retirement  
11 date used when preparing the company's last-approved  
12 depreciation rates?

13  
14 **A.** Yes. Early retirement of parts of Big Bend Unit 1 and all  
15 of Unit 2 are necessary parts of Big Bend Modernization,  
16 so the early retirement of portions of Big Bend Unit 1 and  
17 all of Unit 2 is prudent for the same reasons Big Bend  
18 Modernization is prudent. The early retirements associated  
19 with Big Bend Modernization will lower fuel costs, reduce  
20 future capital costs, and moderate operating costs at Big  
21 Bend. The cost effectiveness analysis benefits are over  
22 and above recovery of the remaining undepreciated value of  
23 the retired assets. It is clearly in Tampa Electric's  
24 customers' best interest to retire these assets before  
25 their planned retirement dates as part of the project.

1 The Big Bend Units 1 and 2 assets to be retired in  
2 conjunction with Big Bend Modernization, their  
3 undepreciated net book values, and the company's proposed  
4 accounting treatment for those assets are discussed in the  
5 direct testimony of Mr. Pickles and Mr. Avellan.  
6

7 **Q.** How does the Project fit into the company's ten-year site  
8 plan?  
9

10 **A.** The Big Bend Modernization Project strengthens the  
11 foundation upon which Tampa Electric provides energy for  
12 our customers as compared to the coal units that are being  
13 retired and modernized. In addition to improving the  
14 system's ability to accommodate solar, this improved  
15 foundation enables Tampa Electric's generation expansion  
16 plan to incorporate distributed energy resources such as  
17 solar photovoltaic, energy storage, and reciprocating  
18 engines more easily. These emerging technologies provide  
19 opportunities to improve reliability, improve resiliency,  
20 reduce emissions, reduce energy losses, adapt quickly to  
21 changing needs, and avoid transmission and distribution  
22 investments. The Big Bend Modernization Project improves  
23 the Tampa Electric generation portfolio now and into the  
24 future.  
25

1 **Early Retirement of Big Bend Unit 3 is Prudent**

2 **Q.** Please describe Big Bend Unit 3.

3  
4 **A.** Big Bend Unit 3 is a pulverized coal-fired steam unit. It  
5 was placed in service in May 1976. It has a name-plate  
6 capacity of 445.5 MW and has summer and winter capability  
7 of 395 MW and 400 MW, respectively. The expected retirement  
8 date reflected in the company's 2011 Depreciation Study is  
9 2041.

10  
11 Big Bend Unit 3 has been maintained, operated, and upgraded  
12 across those five decades to comply with ever evolving and  
13 increasingly demanding environmental constraints. Some of  
14 its primary emissions control equipment includes  
15 particulate matter collectors, flue gas desulfurization  
16 scrubbers, nitrogen oxide selective catalytic reduction  
17 equipment, pre- and post-water treatment plants, and coal  
18 combustion residual handling equipment. The company has  
19 replaced the heavy oil igniters on Big Bend Unit 3 with  
20 natural gas igniters and added additional natural gas  
21 burners to allow operation with natural gas as either a  
22 supplement or as an alternative to coal.

23  
24 Despite this fuel flexibility and exceptional emission  
25 control, it is prudent to retire Big Bend Unit 3 in April

1 2023, which is before the retirement date used in the  
2 company's 2011 depreciation study.

3  
4 **Q.** How did the company conclude that it would be prudent to  
5 retire Big Bend Unit 3 earlier than planned?

6  
7 **A.** As previously noted, the company began evaluating what  
8 actions would be in the best interest of its customers with  
9 respect to the future of the steam turbine units at Big  
10 Bend Station in 2016. The Big Bend Modernization Project  
11 was the culmination of this process. During that process,  
12 the retirement of Big Bend Unit 3 before its current  
13 expected retirement date was identified as another  
14 opportunity to benefit our customers.

15  
16 The Integrated Resource Plan prepared by the company in  
17 late-2019 and early-2020 once again confirmed the early  
18 retirement of Big Bend Unit 3 and recommended the action.  
19 The decision and timing of the retirement of Big Bend Unit  
20 3 was ultimately finalized in late 2020. In October 2020,  
21 the company concluded that it would be in the best interest  
22 of its customers to retire Big Bend Unit 3 in April 2023.

23  
24 **Q.** Why is the early retirement of Big Bend Unit 3 prudent and  
25 in the best interest of customers?

1 **A.** Early retirement of Big Bend Unit 3 is prudent from an  
2 economic perspective, an environmental risk perspective,  
3 and an operational perspective.  
4

5 Economically, Tampa Electric projects that customers will  
6 save nearly \$299 million on a CPVRR basis from the  
7 retirement of Big Bend Unit 3, as shown in Document No. 4  
8 of my exhibit. These savings come primarily from reduced  
9 investment needed to maintain and operate a 1970's vintage  
10 coal-fired unit. Fuel savings and variable O&M expense  
11 reductions round out the overall economic benefit.  
12

13 Environmentally, the energy that would be provided by Big  
14 Bend Unit 3 with a heat rate of about 11,000 Btu/kWh will  
15 instead be produced by a NGCC generator with a heat rate of  
16 about 7,000 Btu/kWh which is an efficiency improvement of  
17 over 35 percent. Since less fuel will be consumed, fewer  
18 emissions will be created. Due to the relative prices for  
19 natural gas and coal, Big Bend Unit 3 currently operates on  
20 natural gas. Emission reductions from the early retirement  
21 of Big Bend Unit 3 would be even greater compared to a  
22 scenario where Big Bend Unit 3 burns coal or if the  
23 replacement generation comes from solar or some other  
24 emission-free resource.  
25

1           Operationally, Big Bend Unit 3, like all coal-fired steam  
2           turbine units, was built to be a baseload unit, meaning it  
3           is designed to be turned on and left on around-the-clock  
4           for multiple days or even months in a row. Changing energy  
5           use patterns by our customers and the addition of  
6           intermittent resources on our electric system require that  
7           the company's generation portfolio be more flexible, able  
8           to follow the variation in load, and react to changing  
9           output from solar resources. For these reasons and because  
10          aged, coal-fired assets are inherently less reliable  
11          compared to modern gas-fired generation technology, Big  
12          Bend Unit 3 no longer fits the operational needs of Tampa  
13          Electric and its customers' demands.

14  
15       **Q.**    What are the costs and proposed accounting treatments  
16          associated with the early retirement of Big Bend Unit 3?

17  
18       **A.**    The Big Bend Unit 3 assets to be retired in 2023, their  
19          undepreciated net book values, and the company's proposed  
20          accounting treatment for those assets are discussed in the  
21          direct testimony of Mr. Pickles and Mr. Avellan.

22  
23       **SUMMARY**

24       **Q.**    Please summarize your direct testimony.  
25

1     **A.**    The Big Bend Modernization Project is important to Tampa  
2            Electric and its customers. The project will provide \$747  
3            million of CPVRR savings compared to an optimized expansion  
4            plan that does not retire and calls for the continued  
5            refurbishment of existing coal-fired units. The project  
6            was identified and selected through an extensive screening  
7            and analytic process and is the most prudent option as  
8            compared to numerous other new construction and market  
9            options.

10  
11            In addition to its compelling economics, Big Bend  
12            Modernization will improve system efficiency as it will be  
13            the most efficient dispatchable unit on the system. It will  
14            improve system environmental performance by significantly  
15            lowering air emissions, water consumption, and wastewater  
16            production. The project will improve overall system  
17            reliability and operational flexibility by replacing two  
18            1970's vintage pulverized coal units with state-of-the-  
19            art, responsive, and reliable combustion turbines and heat  
20            recovery steam generator integrated with the Big Bend Unit  
21            1 generation equipment. The Big Bend Modernization Project  
22            is a foundational element of Tampa Electric's plan to  
23            provide service to its customers in an affordable,  
24            reliable, and environmentally responsible manner.

25

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25

Likewise, the early retirement of Big Bend Unit 3 is prudent from an economic perspective, an environmental risk perspective, and an operational perspective and will provide demonstrable benefits to Tampa Electric and its customers.

**Q.** Does this conclude your prepared direct testimony?

**A.** Yes, it does.



TAMPA ELECTRIC COMPANY  
DOCKET NO. 20210034-EI  
WITNESS: CALDWELL

EXHIBIT

OF

J. BRENT CALDWELL

**Table of Contents**

<b>DOCUMENT NO.</b>	<b>TITLE</b>	<b>PAGE</b>
1	Big Bend Modernization Photos and Artist Renderings	41
2	Big Bend Modernization Options Considered and Relative CPVRR Savings without Emissions Cost Savings	43
3	CPVRR by Component for Big Bend Modernization	44
4	CPVRR By Component from Big Bend Unit 3 Early Retirement	45


BIG BEND MODERNIZATION PHOTO AND ARTIST RENDERING



TAMPA ELECTRIC COMPANY  
DOCKET NO. 20210034-EI  
EXHIBIT NO. JBC-1  
WITNESS: CALDWELL  
DOCUMENT NO. 1  
PAGE 2 OF 2  
FILED: 04/09/2021



**BIG BEND MODERNIZATION OPTIONS CONSIDERED AND RELATIVE CPVRR  
SAVINGS WITHOUT EMISSIONS COST SAVINGS**

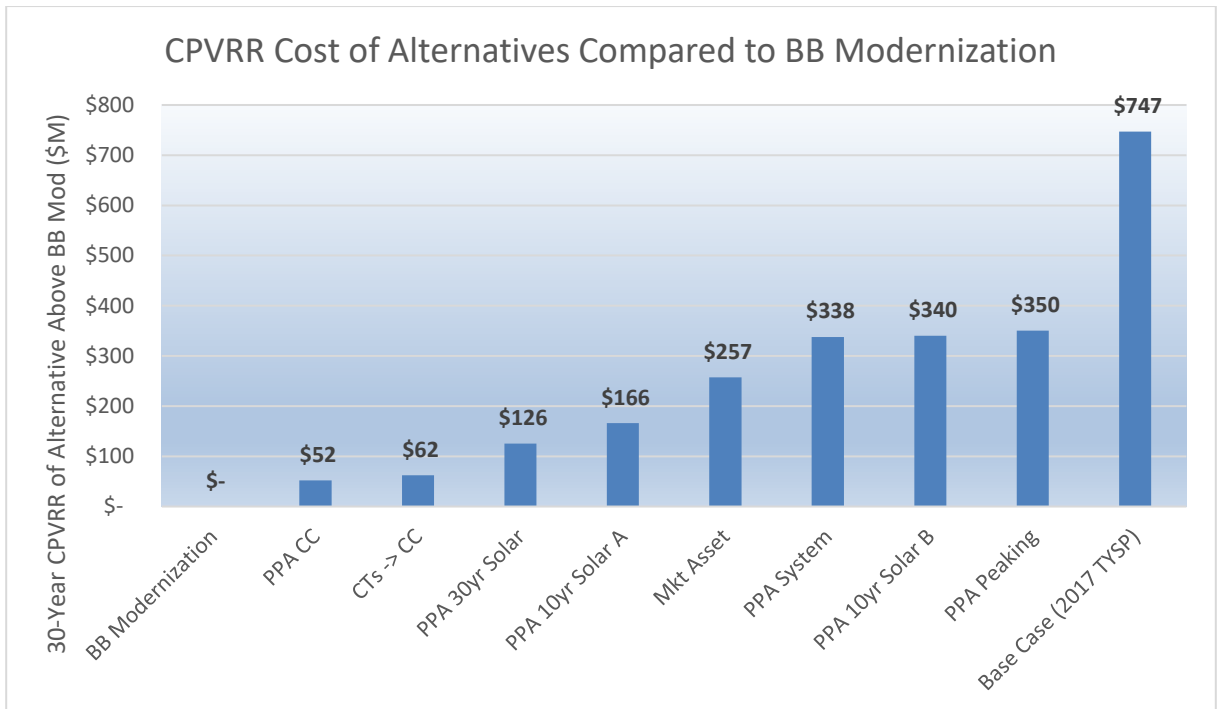

CPVRR BY COMPONENT FOR BIG BEND MODERNIZATION

Staged Modernization with 600 MW of Solar - July 2017 Fuel & Load			
Revenue Requirements (2017 \$000)	Reference BB 1 - 4 on Coal with 600 MW of Solar	Staged Modernization with 600 MW of Solar	Delta
Capital RR - Other New Units	2,528,860	2,750,787	221,927
VOC - Existing Units	447,343	349,202	(98,141)
VOC - Future Units	112,190	274,192	162,003
FOM - Future Units	136,385	186,800	50,415
System Fuel	12,900,671	12,669,994	(230,678)
System Capacity	19,273	20,276	1,003
RR of BB1 to 4 Capital Additions - OEOL	1,320,614	903,088	(417,526)
Big Bend FOM	1,693,215	1,257,056	(436,160)
Big Bend Return on Rate Base - OEOL	1,201,896	1,201,896	-
Big Bend Depreciation - OEOL	717,504	717,504	-
RR of Land for Solar	118,896	118,896	-
Sub Total w/o NO <sub>x</sub> or CO <sub>2</sub> Cost	21,196,849	20,449,692	(747,157)
Plus NO <sub>x</sub> Cost	77,704	56,457	(21,246)
Plus CO <sub>2</sub> Cost	980,611	893,787	(86,824)
Total w/ NO <sub>x</sub> & CO <sub>2</sub> Cost	22,255,164	21,399,936	(855,228)

CPVRR BY COMPONENT FROM BIG BEND UNIT 3 EARLY RETIREMENT

<b>Big Bend 3 Early Retirement Analysis Summary</b>			
<b>Revenue Requirements (2019 \$000)</b>	<b>Reference Case BB3 on Coal Starting in 2024 until OEOL</b>	<b>BB3 Early Retirement in 2023</b>	<b>Delta</b>
Capital RR - Other New Units	3,845,187	3,845,187	-
System VOM	596,965	586,959	(10,007)
FOM - Future Units	662,078	662,078	-
System Fuel	9,998,743	9,984,971	(13,772)
System Capacity	-	-	-
RR of BB3 Capital Additions	170,503	9,960	(160,543)
Big Bend FOM	808,679	694,298	(114,381)
Big Bend Return on Rate Base	1,105,197	1,105,197	-
Big Bend Depreciation	756,868	756,868	-
RR of Land for Solar	94,380	94,380	-
<b>Sub Total w/o NO<sub>x</sub> or CO<sub>2</sub> Cost</b>	<b>18,038,600</b>	<b>17,739,898</b>	<b>(298,703)</b>
Plus NO <sub>x</sub> Cost	5,095	5,095	-
Plus CO <sub>2</sub> Cost	939,287	915,720	(23,567)
<b>Total w/ NO<sub>x</sub> &amp; CO<sub>2</sub> Cost</b>	<b>18,982,982</b>	<b>18,660,712</b>	<b>(322,269)</b>

Notes:  
- 2020 TYSP Expansion  
- Summer 2020 Fuel and Load Forecast (2021 GFI)  
- Reference case is BB3 on gas until end of 2023, coal starting in 2024 until original end of life in 2041