

State of Florida



Public Service Commission

CAPITAL CIRCLE OFFICE CENTER • 2540 SHUMARD OAK BOULEVARD
TALLAHASSEE, FLORIDA 32399-0850

-M-E-M-O-R-A-N-D-U-M-

DATE: December 19, 2022

TO: Adam J. Teitzman, Commission Clerk, Office of Commission Clerk

FROM: Greg Davis, Engineering Specialist I, Division of Engineering *GD*

RE: Docket No. 20220157-WU - Application for staff-assisted rate case in Polk County by Keen Sales, Rentals and Utilities, Inc.

Please file the utility's response to staff's first data request in the above mentioned docket.

Thank you.

RECEIVED-PPSC
2022 DEC 19 AM 9:40

COMMISSIONERS:
ANDREW GILES FAY, CHAIRMAN
ART GRAHAM
GARY F. CLARK
MIKE LA ROSA
GABRIELLA PASSIDOMO

STATE OF FLORIDA



DIVISION OF ENGINEERING
TOM BALLINGER
DIRECTOR
(850) 413-6910

Public Service Commission

November 4, 2022

Ms. Melinda Keen
Keen Sales, Rentals and Utilities, Inc.
685 Dyson Road
Haines City, FL 33844
adunnahoe@aol.com

STAFF'S FIRST DATA REQUEST VIA EMAIL

Re: Docket No. 20220157-WU – Application for staff assisted rate case in Polk County by Keen Sales, Rentals and Utilities, Inc.

Dear Ms. Keen:

For the engineering portion of this rate case, staff requires several items to ensure fast and expedient treatment of your rate cases. Please submit the following information for each of the applications (Keen Mobile Home Subdivision and Paradise Island Subdivision) for the period of January 1, 2021 to December 31, 2021, (test year), unless another time period is specified, to the Commission Clerk, Office of Commission Clerk, 2540 Shumard Oak Blvd., Tallahassee, FL 32399-0850, by **December 5, 2022**. Please make sure the subdivision for each response is clearly labeled.

- N/A
1. Purchased Water: All utility related bills from the beginning of the test year to present which include meter number and location, gallons used, dollars paid, and the utility's account numbers.
 2. Purchased Power: All utility related electricity bills from the beginning of the test year to present, which include meter number and location, kilowatts used, dollars paid, and the electric company's account numbers.
 3. Chemicals: A list of all chemicals used in the treatment of water, amounts purchased, quantity purchased, unit prices paid and dosage rates utilized.
 4. Contractual Services – Testing: A list of tests along with costs paid to outside laboratories for testing the water during the test year.
 5. Contractual Services – Other: The costs of operation and maintenance work not performed by utility employees with an explanation of the type of work performed. These costs include the operator's fee, mowing and grounds keeping and contracted repair for the water system.

- ✓ 6. Transportation Expenses: A schedule of all vehicles by serial number and description owned or leased by the utility, original cost or lease documents, whom the vehicles are assigned to, and an explanation of how they are allocated to the utility, or a copy of the log book showing miles on personal vehicles associated with utility business. All vehicles are to be available for inspection.
- ✓ 7. Copies of your most recent Primary and Secondary Water Quality test results.
- ✓ 8. Copies of monthly operation reports for water from January 1, 2021 to December 31, 2021 (test year) in Microsoft Excel format, if available, which includes:

FOR WATER – Total water purchased or pumped, total wash water, total of each chemical in points, chemical dosages rates (average).

- ✓ 9. Copy of monthly totals of metered water sold for each month of the test year.
- ✓ 10. A written summary, by permit number, of all Department of Environmental Protection (DEP), Water Management District, and/or County Health Department permits.
11. If any plant addition has been made or will be required due to a written order from a governmental agency, please provide a copy of that order.
12. A list of all service complaints received during the test year and four years prior to the test year. Please include the date of the complaint, an explanation of how each complaint was resolved, and the date of resolution.
13. A listing of all water assets owned by the utility, including distribution piping, pumping stations, fire hydrants, etc.

Example: 250' – 6" PVC Pipe (Water)
50' – 6" PVC Fire Hydrants (Water)

14. Number of customers classified as to meter size and class (commercial or residential) for the following points in time:
 - a) A minimum of 4 years prior to the beginning of the test (or calendar last) year.
 - b) The beginning of the last calendar year.
 - c) The end of the last calendar year.
 - d) Present.
- ✓ 15. Please provide a copy of the utility's engineering maps for water showing location and size of water mains throughout the service area and customer location and classification. On each map, please identify vacant customer lots, customer meter sizes, flush points, fire hydrants, and pumping stations.
16. Please fill out the spreadsheet attached concerning any pro forma items the utility is requesting. Please include any bid proposals or estimates for the pro forma items. If less than three bid proposals were requested for each pro forma item, please explain why.

Ms. Melinda Keen
Page 3
November 4, 2022

In addition to the above, please provide responses to the following questions concerning Keen Mobile Home Subdivision:

17. Please refer to the DEP's Sanitary Survey dated January 22, 2021, which lists a malfunctioning POE water sampling tap as a minor out-of-compliance. Was this deficiency corrected within 30 days as required? If so, please detail how this deficiency was corrected. If not, please explain why.
18. Please refer to the DEP correspondence letter dated July 1, 2022, which lists the following deficiency as a result of the Sanitary Survey conducted on June 22, 2022: No Screen on Well Vent. Was this deficiency corrected? If so, please detail how this deficiency was corrected. If not, please explain why.

Please contact me by phone at (850) 413-6582 or by email at Gdavis@psc.state.fl.us, if you have any questions.

Sincerely,

/s/ Phillip G. Davis

Phillip G. Davis
Engineering Specialist

PGD:jp

Enclosure

cc: Office of Commission Clerk (Docket No. 20220157-WU)
Rhonda Hicks, Office of Auditing and Performance Analysis

FPSC
2540 Shumard Oak Blvd
Tall. FL 32399
Div. of Engineering
Phillip Davis



duke-energy.com
1.877.372.8477

Subs #2

Pd 1-11-21 # 7130 (w)

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date Jan 5, 2021
For service Dec 3 - Jan 5
33 days

Account number [REDACTED]

Billing summary


Previous amount due	\$178.33
Payment received Dec 14	-178.33
Electric Charges	144.37
Taxes	27.69
Total amount due Jan 27	\$172.06



Thank you for your payment.

Your usage snapshot

Average daily usage history

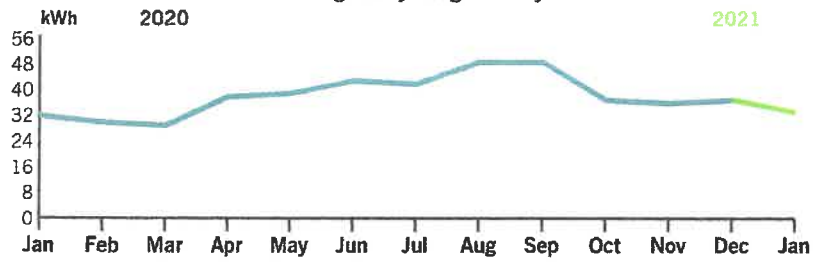

	Current Month	Jan 2020
Electric	33	32

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	11.77
Total Taxes	\$27.69



R. Def. 4/1/20, kille 2/20/21, 05/20/21, 06/21/21, 07/21/21, 08/21/21, 09/21/21, 10/21/21, 11/21/21, 12/21/21, 01/22/22



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading			16518
Previous reading			- 15436
Energy used			1,082 kWh
PRESENT ONPEAK	5,439	PREVIOUS ONPEAK	5,048
DIFFERENCE ONPEAK	391	ON PEAK KWH	391
PRESENT KW (ACTUAL)	4.43	PRESENT PEAK KW	4.43
BASE KW	4	ON-PEAK KW	4
LOAD FACTOR	34.2%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..12-03-20 TO 01-05-21 33 DAYS	
CUSTOMER CHARGE	\$15.09
ENERGY CHARGE	
1,082 KWH @ 8.602c	93.07
FUEL CHARGE	
1,082 KWH @ 3.094c	33.48
ASSET SECURITIZATION CHARGE	
1,082 KWH @ 0.252c	2.73
Total Electric Charges	\$144.37

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$3.70
COUNTY UTILITY TAX	12.22
STATE AND OTHER TAXES ON ELECTRIC	11.77
Total Taxes	\$27.69





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date Feb 4, 2021
For service Jan 5 - Feb 4
30 days

Account number [REDACTED]


Billing summary *Pd 2-12-2015 (7147) W*

Previous amount due	\$172.06
Payment received Jan 19	-172.06
Electric Charges	139.71
Taxes	26.81
Total amount due Feb 26	\$166.52



Thank you for your payment.

Your usage snapshot

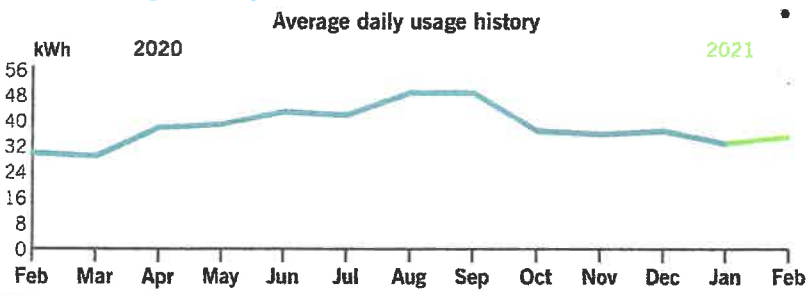

	Current Month	Feb 2020
Electric	35	30

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	11.40
Total Taxes	\$26.81



Your usage snapshot - continued

Current electric usage for meter number 000176055

Actual reading	17561		
Previous reading	- 16518		
Energy used	1,043 kWh		
PRESENT ONPEAK	5,827	PREVIOUS ONPEAK	5,439
DIFFERENCE ONPEAK	388	ON PEAK KWH	388
PRESENT KW (ACTUAL)	4.86	PRESENT PEAK KW	4.86
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	29.0%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..01-05-21 TO 02-04-21 30 DAYS	
CUSTOMER CHARGE	\$15.09
ENERGY CHARGE	
1,043 KWH @ 8.602c	89.72
FUEL CHARGE	
1,043 KWH @ 3.094c	32.27
ASSET SECURITIZATION CHARGE	
1,043 KWH @ 0.252c	2.63
Total Electric Charges	\$139.71

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Duke Energy Florida utilized fuel in the following proportions to generate your power: Coal 7%, Purchased Power 10%, Gas 81%, Oil 0%, Nuclear 0%, Solar 2% (For prior 12 months ending December 31, 2020).

Billing details - Taxes

GROSS RECEIPTS TAX	\$3.58
COUNTY UTILITY TAX	11.83
STATE AND OTHER TAXES ON ELECTRIC	11.40
Total Taxes	\$26.81





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date Mar 8, 2021
For service Feb 4 - Mar 8
32 days

Account number 80029 38156

Billing summary *PD 3-16-2021 # 7173(W)*

Previous amount due	\$166.52
Payment received Feb 19	-166.52
Electric Charges	172.80
Taxes	33.08
Total amount due Mar 30	\$205.88




Thank you for your payment.

Important power line safety reminder: Stay away from power lines. Do not work near overhead lines. Always assume that downed lines are energized and dangerous. Report downed power lines to Duke Energy immediately by calling 1-800-543-5599.

Learn how to lower your bill with an online or free on-site Business Energy Check. This no-cost analysis provides you with specific tips on how to save energy and qualify for valuable rebates for energy-savings measures. You may also qualify for a FREE Commercial Energy Savings Kit. Go to duke-energy.com/FreeBizCheck or call 877.426.0009.

Your usage snapshot

Average daily usage history

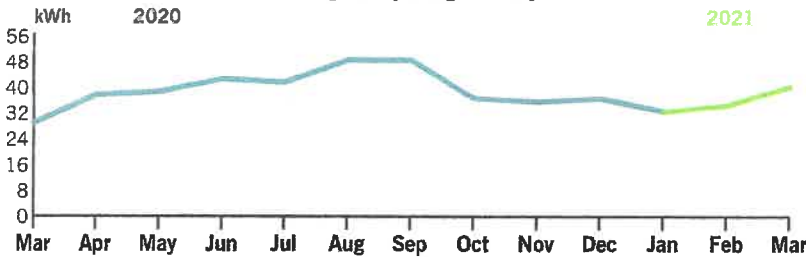

	Current Month	Mar 2020
Electric	41	29

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	14.09
Total Taxes	\$33.08



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading		18883	
Previous reading		- 17561	
Energy used		1,322 kWh	
PRESENT ONPEAK	6,296	PREVIOUS ONPEAK	5,827
DIFFERENCE ONPEAK	469	ON PEAK KWH	469
PRESENT KW (ACTUAL)	4.54	PRESENT PEAK KW	4.54
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	34.4%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..02-04-21 TO 03-08-21 32 DAYS	
CUSTOMER CHARGE	\$15.09
ENERGY CHARGE	
1,322 KWH @ 8.602c	113.72
FUEL CHARGE	
1,322 KWH @ 3.094c	40.90
ASSET SECURITIZATION CHARGE	
1,322 KWH @ 0.234c	3.09
Total Electric Charges	\$172.80

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$4.43
COUNTY UTILITY TAX	14.56
STATE AND OTHER TAXES ON ELECTRIC	14.09
Total Taxes	\$33.08





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date Apr 7, 2021
For service Mar 8 - Apr 7
30 days

Account number **60029 38156**

Billing summary Pd 4-14-2021 #7196 (Water)


Previous amount due	\$205.88
Payment received Mar 23	-205.88
Electric Charges	200.21
Taxes	38.30
Total amount due Apr 29	\$238.51



Thank you for your payment.

On April 29 the Florida Public Counsel will be conducting an online presentation about the rate changes pending in Duke Energy Florida's rate case settlement. Visit duke-energy.com/settlement to learn more.

Your usage snapshot

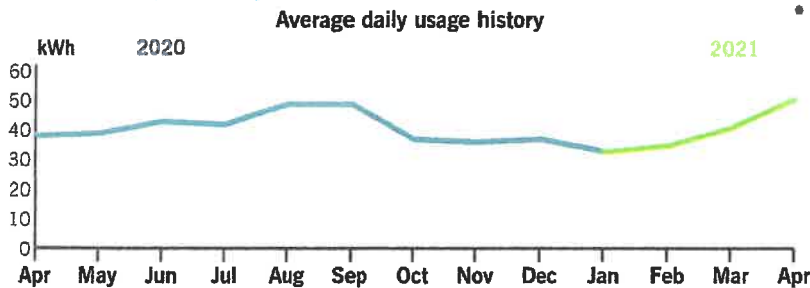

	Current Month	Apr 2020
Electric	51	38

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	16.33
Total Taxes	\$38.30



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading	20424		
Previous reading	- 18883		
Energy used	1,541 kWh		
PRESENT ONPEAK	6,881	PREVIOUS ONPEAK	6,296
DIFFERENCE ONPEAK	585	ON PEAK KWH	585
PRESENT KW (ACTUAL)	4.61	PRESENT PEAK KW	4.61
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	42.8%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..03-08-21 TO 04-07-21 30 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
1,541 KWH @ 8.674c	133.67
FUEL CHARGE	
1,541 KWH @ 3.094c	47.68
ASSET SECURITIZATION CHARGE	
1,541 KWH @ 0.234c	3.61
Total Electric Charges	\$200.21

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$5.13
COUNTY UTILITY TAX	16.84
STATE AND OTHER TAXES ON ELECTRIC	16.33
Total Taxes	\$38.30





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date May 6, 2021
For service Apr 7 - May 6
29 days

Account number 00029 38156

Billing summary *PA 5-11-21 #2215 (W)*

Previous amount due	\$238.51
Payment received Apr 19	-238.51
Electric Charges	172.96
Taxes	33.12
Total amount due May 28	\$206.08




Thank you for your payment.

Important power line safety reminder. Stay away from power lines. Do not work near overhead lines. Always assume that downed lines are energized and dangerous. Report downed power lines to Duke Energy immediately by calling 1-800-769-3766.

Your usage snapshot

Average daily usage history

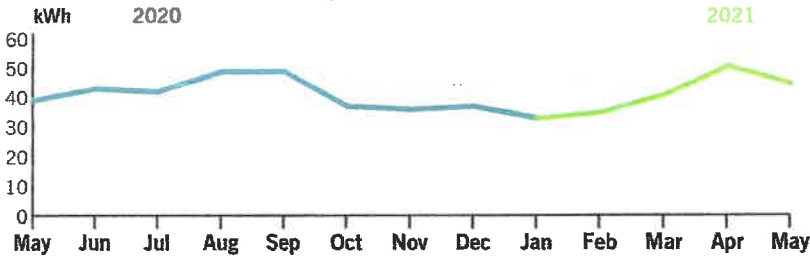

	Current Month	May 2020
Electric	45	39

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	14.10
Total Taxes	\$33.12



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading		21738	
Previous reading		- 20424	
Energy used		1,314 kWh	
PRESENT ONPEAK	7,361	PREVIOUS ONPEAK	6,881
DIFFERENCE ONPEAK	480	ON PEAK KWH	480
PRESENT KW (ACTUAL)	4.54	PRESENT PEAK KW	4.54
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	37.8%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..04-07-21 TO 05-06-21 29 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
1,314 KWH @ 8.674c	113.98
FUEL CHARGE	
1,314 KWH @ 3.094c	40.66
ASSET SECURITIZATION CHARGE	
1,314 KWH @ 0.234c	3.07
Total Electric Charges	\$172.96

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Duke Energy Florida utilized fuel in the following proportions to generate your power: Coal 10%, Purchased Power 9%, Gas 79%, Oil 0%, Nuclear 0%, Solar 2% (For prior 12 months ending March 31, 2021).

Billing details - Taxes

GROSS RECEIPTS TAX	\$4.43
COUNTY UTILITY TAX	14.59
STATE AND OTHER TAXES ON ELECTRIC	14.10
Total Taxes	\$33.12





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date Jun 7, 2021
For service May 6 - Jun 7
32 days

Account number 60029 38156

Billing summary Pd 6-14-2021 #7894 (w)


Previous amount due	\$206.08
Payment received May 17	-206.08
Electric Charges	209.56
Taxes	40.08
Total amount due Jun 29	\$249.64



Thank you for your payment.

Your usage snapshot

Average daily usage history

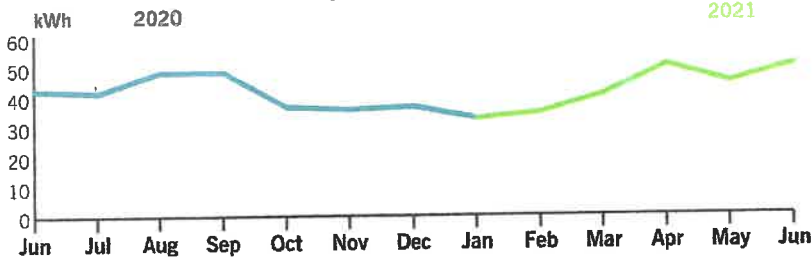

	Current Month	Jun 2020
Electric	51	43

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	17.09
Total Taxes	\$40.08



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading		23357	
Previous reading		- 21738	
Energy used		1,619 kWh	
PRESENT ONPEAK	7,870	PREVIOUS ONPEAK	7,361
DIFFERENCE ONPEAK	509	ON PEAK KWH	509
PRESENT KW (ACTUAL)	4.61	PRESENT PEAK KW	4.61
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	42.2%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..05-06-21 TO 06-07-21 32 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
1,619 KWH @ 8.674c	140.43
FUEL CHARGE	
1,619 KWH @ 3.094c	50.09
ASSET SECURITIZATION CHARGE	
1,619 KWH @ 0.234c	3.79
Total Electric Charges	\$209.56

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$5.37
COUNTY UTILITY TAX	17.62
STATE AND OTHER TAXES ON ELECTRIC	17.09
Total Taxes	\$40.08



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading			24612
Previous reading			- 23357
Energy used			1,255 kWh
PRESENT ONPEAK	8,314	PREVIOUS ONPEAK	7,870
DIFFERENCE ONPEAK	444	ON PEAK KWH	444
PRESENT KW (ACTUAL)	4.54	PRESENT PEAK KW	4.54
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	34.9%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..06-07-21 TO 07-07-21 30 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
1,255 KWH @ 8.674c	108.86
FUEL CHARGE	
1,255 KWH @ 3.094c	38.83
ASSET SECURITIZATION CHARGE	
1,255 KWH @ 0.234c	2.94
Total Electric Charges	\$165.88

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$4.25
COUNTY UTILITY TAX	14.01
STATE AND OTHER TAXES ON ELECTRIC	13.53
Total Taxes	\$31.79





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date Aug 5, 2021
For service Jul 7 - Aug 5
29 days

Account number 60029 38156

Billing summary

2937(W)
Pd 8/12/2021


Previous amount due	\$197.67
Payment received Jul 16	-197.67
Electric Charges	151.50
Taxes	29.06
Adjustments	-17.40
Total amount due Aug 27	\$163.16



Thank you for your payment.

Your usage snapshot

Average daily usage history

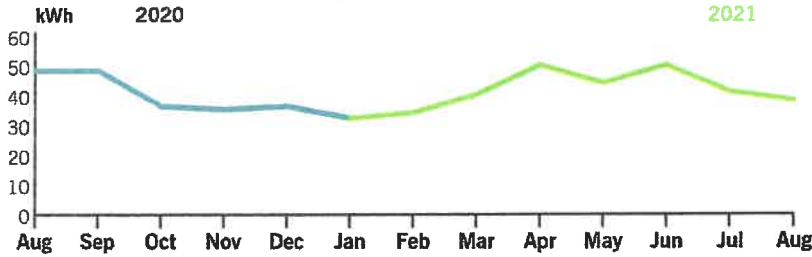

	Current Month	Aug 2020
Electric	39	49

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

Total Adjustments	\$17.40
-------------------	---------

Billing details - Taxes

GROSS RECEIPTS TAX	\$3.88
COUNTY UTILITY TAX	12.83
STATE AND OTHER TAXES ON ELECTRIC	12.35
Total Taxes	\$29.06



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading		25743	
Previous reading		- 24612	
Energy used		1,131 kWh	
PRESENT ONPEAK	8,737	PREVIOUS ONPEAK	8,314
DIFFERENCE ONPEAK	423	ON PEAK KWH	423
PRESENT KW (ACTUAL)	4.52	PRESENT PEAK KW	4.52
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	32.5%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..07-07-21 TO 08-05-21 29 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
1,131 KWH @ 8.719c	98.61
FUEL CHARGE	
1,131 KWH @ 3.094c	34.99
ASSET SECURITIZATION CHARGE	
1,131 KWH @ 0.234c	2.65
Total Electric Charges	\$151.50

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Duke Energy Florida utilized fuel in the following proportions to generate your power: Coal 12%, Purchased Power 9%, Gas 77%, Oil 0%, Nuclear 0%, Solar 2% (For prior 12 months ending June 30, 2021).

Billing details - Adjustments

CREDIT AMOUNT TRANSFERRED FROM ACCOUNT 78649-46400	\$-17.40
Total Adjustments	\$-17.40

Billing details - Taxes

GROSS RECEIPTS TAX	\$3.88
COUNTY UTILITY TAX	12.83
STATE AND OTHER TAXES ON ELECTRIC	12.35
Total Taxes	\$29.06



DUKE ENERGY FLORIDA, INC. 08/2021



duke-energy.com
1.877.372.8477

Your Energy Bill

Pd 9-14-2021 ac# 7955 (W)

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date Sep 7, 2021
For service Aug 5 - Sep 7
33 days

Account number 80029 39156

Billing summary


Previous amount due	\$163.16
Payment received Aug 23	-163.16
Electric Charges	181.56
Taxes	34.34
Total amount due Sep 29	\$215.90



Thank you for your payment.

To help us repair malfunctioning streetlights, quickly: 1. Call us at 1-800-228-8485 or visit duke-energy.com/lightrepair 2. Provide us with the light's location and your contact information 3. Specific addresses, landmarks and directions work best

Your usage snapshot

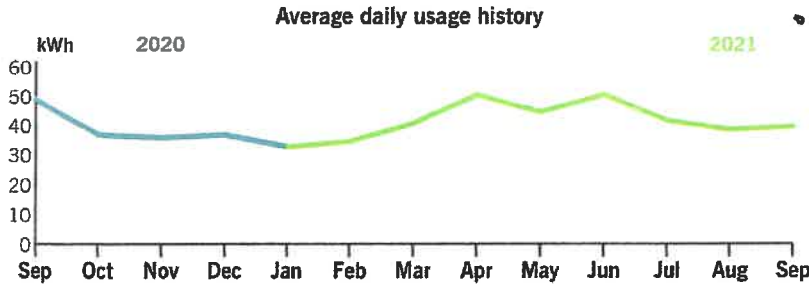

	Current Month	Sep 2020
Electric	40	49

STATE AND OTHER TAXES ON ELECTRIC	14.81
Total Taxes	\$34.34

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading		27076	
Previous reading		- 25743	
Energy used		1,333 kWh	
PRESENT ONPEAK	9,206	PREVIOUS ONPEAK	8,737
DIFFERENCE ONPEAK	469	ON PEAK KWH	469
PRESENT KW (ACTUAL)	4.53	PRESENT PEAK KW	4.53
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	33.7%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..08-05-21 TO 09-07-21 33 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
1,333 KWH @ 8.719c	116.22
FUEL CHARGE	
1,333 KWH @ 3.514c	46.84
ASSET SECURITIZATION CHARGE	
1,333 KWH @ 0.244c	3.25
Total Electric Charges	\$181.56

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$4.66
COUNTY UTILITY TAX	14.87
STATE AND OTHER TAXES ON ELECTRIC	14.81
Total Taxes	\$34.34





duke-energy.com
1.877.372.8477



Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD PUMP
HAINES CITY FL 33844

Bill date Oct 7, 2021
For service Sep 7 - Oct 7
30 days

Account number 0029 30156

Billing summary

Previous amount due	\$215.90
Payment received Sep 20	-215.90
Electric Charges	180.45
Taxes	34.12
Total amount due Oct 29	\$214.57




Thank you for your payment.


Learn how to lower your bill with an online or free on-site Business Energy Check. This no-cost analysis provides you with specific tips on how to save energy and qualify for valuable rebates for energy-savings measures. You may also qualify for a FREE Commercial Energy Savings Kit. Go to duke-energy.com/FreeBizCheck or call 877.426.0009.

Your usage snapshot

Average daily usage history

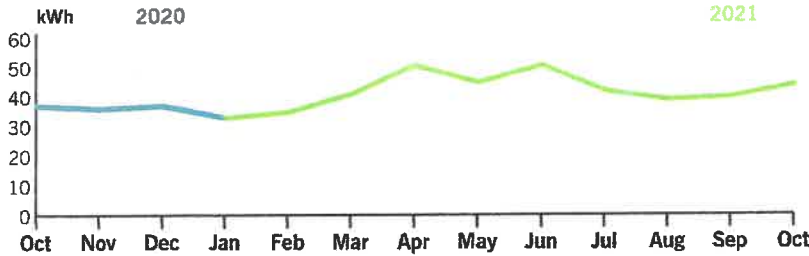

	Current Month	Oct 2020
Electric	44	37

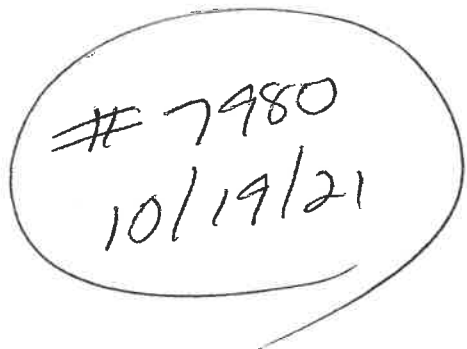

STATE AND OTHER TAXES ON ELECTRIC	14.71
Total Taxes	\$34.12

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.



Your usage snapshot - continued

Current electric usage for meter number 000176055			
Actual reading		28400	
Previous reading		- 27076	
Energy used		1,324 kWh	
PRESENT ONPEAK	9,719	PREVIOUS ONPEAK	9,206
DIFFERENCE ONPEAK	513	ON PEAK KWH	513
PRESENT KW (ACTUAL)	4.58	PRESENT PEAK KW	4.56
BASE KW	5	ON-PEAK KW	5
LOAD FACTOR	36.8%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..09-07-21 TO 10-07-21 30 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
1,324 KWH @ 8.719c	115.44
FUEL CHARGE	
1,324 KWH @ 3.514c	46.53
ASSET SECURITIZATION CHARGE	
1,324 KWH @ 0.244c	3.23
Total Electric Charges	\$180.45

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$4.63
COUNTY UTILITY TAX	14.78
STATE AND OTHER TAXES ON ELECTRIC	14.71
Total Taxes	\$34.12





duke-energy.com
877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD
PUMP

Bill date Nov 11, 2021
For service Oct 7 - Nov 8
33 days

Account number [REDACTED]

Billing summary

Pd 11/15/21 #8006(w)

Previous Amount Due	\$214.57
Payment Received Oct 25	-214.57
Current Electric Charges	189.43
Taxes	35.80
Total Amount Due Dec 02	\$225.23




Thank you for your payment.

We've made updates to your bill! Your usage snapshot now includes the average outdoor temperature, and a new account number also displays at the top of your statement. If paying electronically, we encourage you to use this new 12-digit number, although payments can be processed under the old account number, too. You can also add a contribution on your payment to help others. Visit duke-energy.com/BizBillUpdates to learn more.

Your usage snapshot

Electric usage history

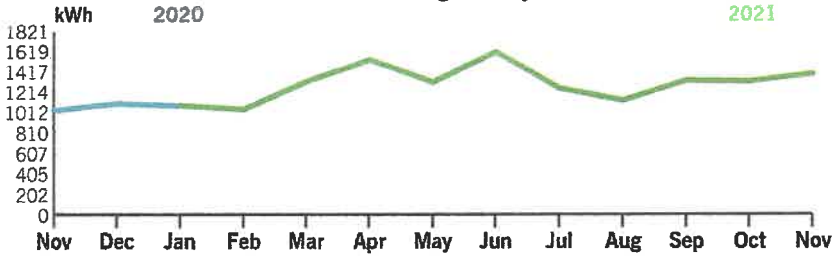

Average temperature in degrees

73° 60° 61° 67° 70° 73° 78° 81° 81° 82° 80° 77° 68°

	Current Month	Nov 2020	12-Month Usage	Avg Monthly Usage
Electric (kWh)	1,396	1,039	15,464	1,289
Avg. Daily (kWh)	42	36	42	

12-month usage based on most recent history

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 0.0%, late charge, whichever is greater.





Your usage snapshot - Continued

Current electric usage for meter number 176055	
Actual reading on Nov 8	29796
Previous reading on Oct 7	- 28400
<hr/>	
Energy used	1,396 kWh
Billed kWh	1,396.000 kWh



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric

Billing Period - Oct 07 to Nov 08	
Meter - 176055	
Customer Charge	\$15.25
Energy Charge	
1,396.000 kWh @ 8.718c	121.71
Fuel Charge	
1,396.000 kWh @ 3.514c	49.06
Asset Securitization Charge	
1,396.000 kWh @ 0.244c	3.41
<hr/>	
Total Current Charges	\$189.43

Your current rate is General Service Non-Demand Secondary (GS-1).

Duke Energy Florida utilized fuel in the following proportions to generate your power: Coal 12%, Purchased Power 10%, Gas 76%, Oil 0%, Nuclear 0%, Solar 2% (For prior 12 months ending September 30, 2021).

Billing details - Taxes

State And Other Taxes	\$13.51
Gross Receipts Tax	4.86
County Utility Tax	15.49
County Optional Tax	1.94
<hr/>	
Total Taxes	\$35.80





duke-energy.com
877.372.8477

Your Energy Bill

Pd 12/31/2021 (w)

Service address
KEEN SALES RENTALS & UTIL
406 RAY KEEN RD
PUMP

Bill date Dec 10, 2021
For service Nov 9 - Dec 8
30 days

Account number 0100 0281 7508

Billing summary


Previous Amount Due	\$225.23
Payment Received Nov 19	-225.23
Current Electric Charges	166.98
Taxes	31.60
Total Amount Due Dec 31	\$198.58



Thank you for your payment.

We've made updates to your bill! Your usage snapshot now includes the average outdoor temperature, and a new account number also displays at the top of your statement. If paying electronically, we encourage you to use this new 12-digit number, although payments can be processed under the old account number, too. You can also add a contribution on your payment to help others. Visit duke-energy.com/BizBillUpdates to learn more.

Your usage snapshot

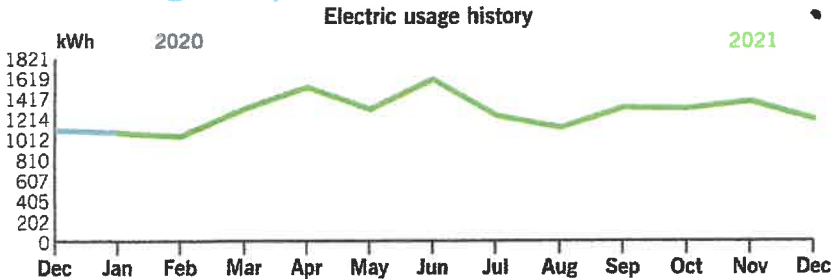

Average temperature in degrees

60° 61° 67 70 73 78 81 81 82 80 77 66 64

	Current Month	Dec 2020	12-Month Usage	Avg Monthly Usage
Electric (kWh)	1,216	1,104	15,576	1,298
Avg. Daily (kWh)	41	37	42	

12-month usage based on most recent history

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 0.0%, late charge, whichever is greater.





Your usage snapshot - Continued

Current electric usage for meter number 176055	
Actual reading on Dec 8	31012
Previous reading on Nov 9	- 29796
<hr/>	
Energy used	1,216 kWh
Billed kWh	1,216.000 kWh



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric

Billing Period - Nov 09 to Dec 08	
Meter - 176055	
Customer Charge	\$15.25
Energy Charge	
1,216.000 kWh @ 8.720c	106.03
Fuel Charge	
1,216.000 kWh @ 3.514c	42.73
Asset Securitization Charge	
1,216.000 kWh @ 0.244c	2.97
Total Current Charges	\$166.98

Your current rate is General Service Non-Demand Secondary (GS-1).

Billing details - Taxes

State And Other Taxes	\$11.91
Gross Receipts Tax	4.28
County Utility Tax	13.70
County Optional Tax	1.71
Total Taxes	\$31.60





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Jan 13, 2021
For service Dec 11 - Jan 13
33 days

Account number [REDACTED]

Billing summary Pd 1-21-2021 CK#7139 (WATER)


Previous amount due	\$102.22
Payment received Dec 28	-102.22
Electric Charges	96.93
Taxes	18.69
Total amount due Feb 04	\$115.62



Thank you for your payment.

Your usage snapshot

Average daily usage history

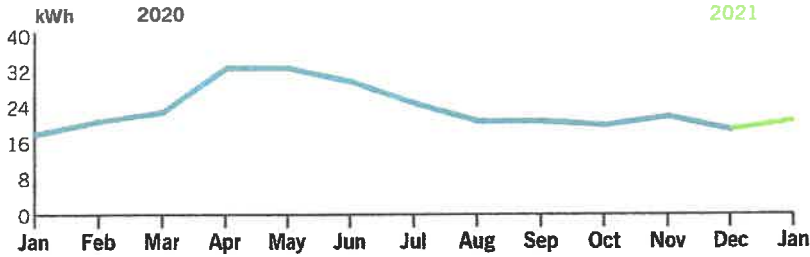

	Current Month	Jan 2020
Electric	21	18

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	7.90
Total Taxes	\$18.69





duke-energy.com
1.877.372.8477

Account number XXXXXXXXXX

Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		10966	
Previous reading		- 10281	
Energy used		685 kWh	
PRESENT ONPEAK	3,154	PREVIOUS ONPEAK	2,957
DIFFERENCE ONPEAK	197	ON PEAK KWH	197
PRESENT KW (ACTUAL)	2.96	PRESENT PEAK KW	2.89
BASE KW	3	ON-PEAK KW	3
LOAD FACTOR	28.8%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..12-11-20 TO 01-13-21 33 DAYS	
CUSTOMER CHARGE	\$15.09
ENERGY CHARGE	
685 KWH @ 8.602c	58.92
FUEL CHARGE	
685 KWH @ 3.094c	21.19
ASSET SECURITIZATION CHARGE	
685 KWH @ 0.252c	1.73
Total Electric Charges	\$96.93

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.49
COUNTY UTILITY TAX	8.30
STATE AND OTHER TAXES ON ELECTRIC	7.90
Total Taxes	\$18.69





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Feb 12, 2021
For service Jan 13 - Feb 12
30 days

Account number [REDACTED]

Billing summary

Pd 2-22-2021 #7154(w)


Previous amount due	\$115.62
Payment received Jan 26	-115.62
Electric Charges	83.32
Taxes	16.12
Total amount due Mar 08	\$99.44



Thank you for your payment.

Your usage snapshot

Average daily usage history

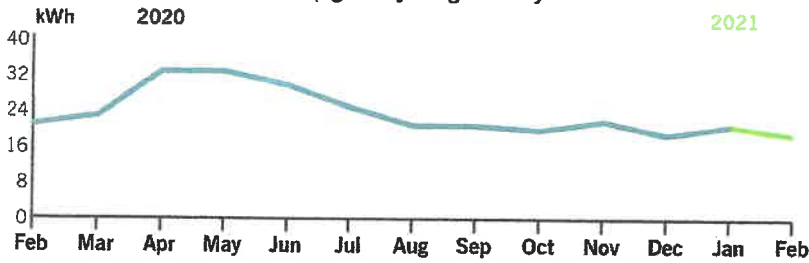

	Current Month	Feb 2020
Electric	19	21

STATE AND OTHER TAXES ON ELECTRIC	6.80
Total Taxes	\$16.12

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.





Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		11537	
Previous reading		- 10966	
Energy used		571 kWh	
PRESENT ONPEAK	3,340	PREVIOUS ONPEAK	3,154
DIFFERENCE ONPEAK	186	ON PEAK KWH	186
PRESENT KW (ACTUAL)	2.92	PRESENT PEAK KW	2.83
BASE KW	3	ON-PEAK KW	3
LOAD FACTOR	26.4%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..01-13-21 TO 02-12-21 30 DAYS	
CUSTOMER CHARGE	\$15.09
ENERGY CHARGE	
571 KWH @ 8.602c	49.12
FUEL CHARGE	
571 KWH @ 3.094c	17.67
ASSET SECURITIZATION CHARGE	
571 KWH @ 0.252c	1.44
Total Electric Charges	\$83.32

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Duke Energy Florida utilized fuel in the following proportions to generate your power: Coal 7%, Purchased Power 10%, Gas 81%, Oil 0%, Nuclear 0%, Solar 2% (For prior 12 months ending December 31, 2020).

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.14
COUNTY UTILITY TAX	7.18
STATE AND OTHER TAXES ON ELECTRIC	6.80
Total Taxes	\$16.12





duke-energy.com
1.877.372.8477

W

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Mar 16, 2021
For service Feb 12 - Mar 16
32 days

Account number [REDACTED]

Billing summary

Pd 3-29-2021 #2179 (W)

Previous amount due	\$99.44
Payment received Feb 26	-99.44
Electric Charges	90.37
Taxes	17.45
Total amount due Apr 07	\$107.82




Thank you for your payment.

Important power line safety reminder: Stay away from power lines. Do not work near overhead lines. Always assume that downed lines are energized and dangerous. Report downed power lines to Duke Energy immediately by calling 1-800-543-5599.

Learn how to lower your bill with an online or free on-site Business Energy Check. This no-cost analysis provides you with specific tips on how to save energy and qualify for valuable rebates for energy-savings measures. You may also qualify for a FREE Commercial Energy Savings Kit. Go to duke-energy.com/FreeBizCheck or call 877.426.0009.

Your usage snapshot

Average daily usage history

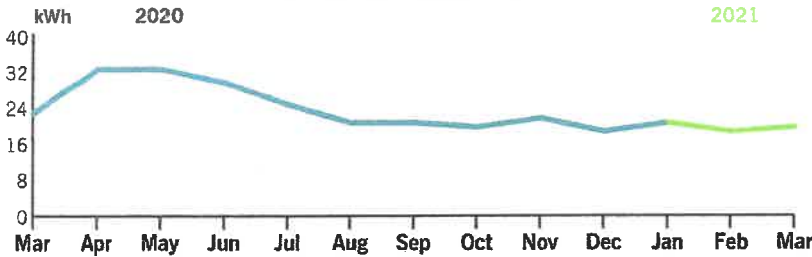

	Current Month	Mar 2020
Electric	20	23

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	7.37
Total Taxes	\$17.45



Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		12168	
Previous reading		- 11537	
Energy used		631 kWh	
PRESENT ONPEAK	3,526	PREVIOUS ONPEAK	3,340
DIFFERENCE ONPEAK	186	ON PEAK KWH	186
PRESENT KW (ACTUAL)	4.24	PRESENT PEAK KW	4.24
BASE KW	4	ON-PEAK KW	4
LOAD FACTOR	20.5%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..02-12-21 TO 03-16-21 32 DAYS	
CUSTOMER CHARGE	\$15.09
ENERGY CHARGE	
631 KWH @ 8.602c	54.28
FUEL CHARGE	
631 KWH @ 3.094c	19.52
ASSET SECURITIZATION CHARGE	
631 KWH @ 0.234c	1.48
Total Electric Charges	\$90.37

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.32
COUNTY UTILITY TAX	7.76
STATE AND OTHER TAXES ON ELECTRIC	7.37
Total Taxes	\$17.45





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Apr 15, 2021
For service Mar 16 - Apr 15
30 days

Account number [REDACTED]

Billing summary *Pd 4-23-21 # 9205 (w)*

Previous amount due	\$107.82
Payment received Apr 06	-107.82
Electric Charges	112.95
Taxes	21.75
Total amount due May 07	\$134.70




Thank you for your payment.

On April 29 the Florida Public Counsel will be conducting an online presentation about the rate changes pending in Duke Energy Florida's rate case settlement. Visit duke-energy.com/settlement to learn more.

Your usage snapshot

Average daily usage history

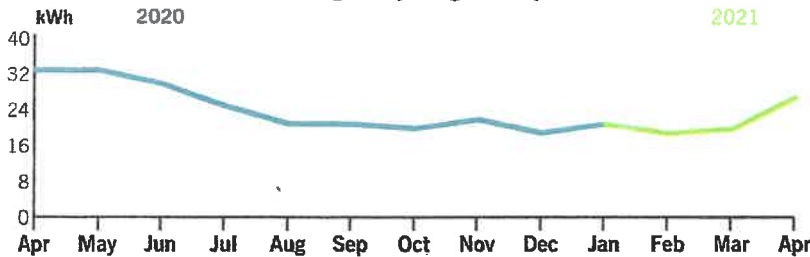

	Current Month	Apr 2020
Electric	27	33

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	9.21
Total Taxes	\$21.75





Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		12982	
Previous reading		- 12168	
Energy used		814 kWh	
PRESENT ONPEAK	3,787	PREVIOUS ONPEAK	3,526
DIFFERENCE ONPEAK	261	ON PEAK KWH	261
PRESENT KW (ACTUAL)	4.77	PRESENT PEAK KW	4.39
BASE KW	5	ON-PEAK KW	4
LOAD FACTOR	22.6%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..03-16-21 TO 04-15-21 30 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
814 KWH @ 8.674c	70.61
FUEL CHARGE	
814 KWH @ 3.094c	25.19
ASSET SECURITIZATION CHARGE	
814 KWH @ 0.234c	1.90
Total Electric Charges	\$112.95

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.90
COUNTY UTILITY TAX	9.64
STATE AND OTHER TAXES ON ELECTRIC	9.21
Total Taxes	\$21.75





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date May 14, 2021
For service Apr 15 - May 14
29 days

Account number [REDACTED]

Billing summary Pd 5-24-2021 #7984(W)

Previous amount due	\$134.70
Payment received Apr 27	-134.70
Electric Charges	108.74
Taxes	20.95
Total amount due Jun 07	\$129.69




Thank you for your payment.

Important power line safety reminder. Stay away from power lines. Do not work near overhead lines. Always assume that downed lines are energized and dangerous. Report downed power lines to Duke Energy immediately by calling 1-800-769-3766.

Your usage snapshot

Average daily usage history

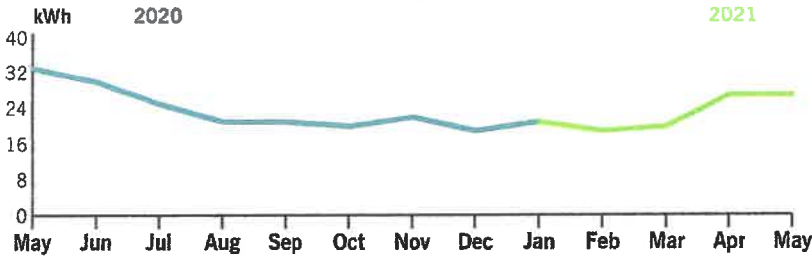

	Current Month	May 2020
Electric	27	33

COUNTY UTILITY TAX	
STATE AND OTHER TAXES ON ELECTRIC	8.87
Total Taxes	\$20.95

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.



Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		13761	
Previous reading		- 12982	
Energy used		779 kWh	
PRESENT ONPEAK	4,011	PREVIOUS ONPEAK	3,787
DIFFERENCE ONPEAK	224	ON PEAK KWH	224
PRESENT KW (ACTUAL)	4.48	PRESENT PEAK KW	2.80
BASE KW	4	ON-PEAK KW	3
LOAD FACTOR	28.0%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..04-15-21 TO 05-14-21 29 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
779 KWH @ 8.674c	67.57
FUEL CHARGE	
779 KWH @ 3.094c	24.10
ASSET SECURITIZATION CHARGE	
779 KWH @ 0.234c	1.82
Total Electric Charges	\$108.74

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Duke Energy Florida utilized fuel in the following proportions to generate your power: Coal 10%, Purchased Power 9%, Gas 79%, Oil 0%, Nuclear 0%, Solar 2% (For prior 12 months ending March 31, 2021).

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.79
COUNTY UTILITY TAX	9.29
STATE AND OTHER TAXES ON ELECTRIC	8.87
Total Taxes	\$20.95





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Jun 15, 2021
For service May 14 - Jun 15
32 days

Account number 73276 15317

Billing summary

7900 (W)
Pd 6-21-2021


Previous amount due	\$129.69
Payment received May 26	-129.69
Electric Charges	125.54
Taxes	24.15
Total amount due Jul 07	\$149.69



Thank you for your payment.

Your usage snapshot

Average daily usage history

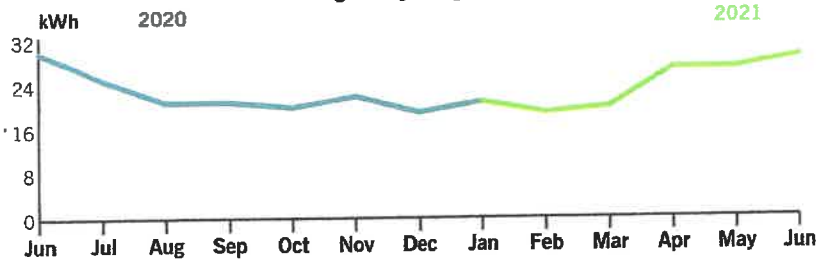

	Current Month	Jun 2020
Electric	29	30

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	10.25
Total Taxes	\$24.15



Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading			14680
Previous reading			- 13761
Energy used			919 kWh
PRESENT ONPEAK	4,248	PREVIOUS ONPEAK	4,011
DIFFERENCE ONPEAK	237	ON PEAK KWH	237
PRESENT KW (ACTUAL)	5.90	PRESENT PEAK KW	4.27
BASE KW	6	ON-PEAK KW	4
LOAD FACTOR	19.9%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..05-14-21 TO 06-15-21 32 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
919 KWH @ 8.674c	79.71
FUEL CHARGE	
919 KWH @ 3.094c	28.43
ASSET SECURITIZATION CHARGE	
919 KWH @ 0.234c	2.15
Total Electric Charges	\$125.54

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$3.22
COUNTY UTILITY TAX	10.68
STATE AND OTHER TAXES ON ELECTRIC	10.25
Total Taxes	\$24.15





duke-energy.com
1.877.372.8477

Your Energy Bill

page 1 of 3

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Jul 15, 2021
For service Jun 15 - Jul 15
30 days

Account number XXXXXXXXXX

Pd 7/22/2021 # 2925 (w)

Billing summary


Previous amount due	\$149.69
Payment received Jun 24	-149.69
Electric Charges	81.27
Taxes	15.73
Total amount due Aug 06	\$97.00



Thank you for your payment.

Your usage snapshot

Average daily usage history

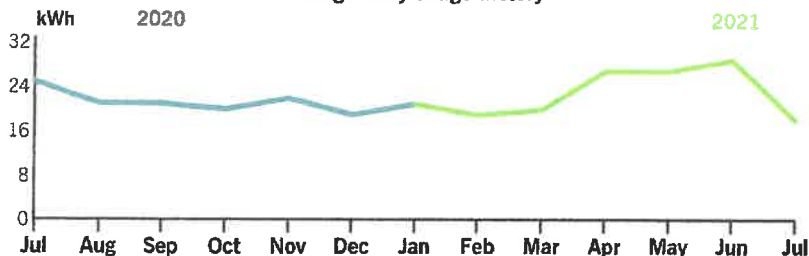

	Current Month	Jul 2020
Electric	18	25

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	0.03
Total Taxes	\$15.73

fb.der.duke.bills.2021.0715215940.70.afp-78409-000000453



Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		15230	
Previous reading		- 14680	
Energy used		550 kWh	
PRESENT ONPEAK	4,417	PREVIOUS ONPEAK	4,248
DIFFERENCE ONPEAK	169	ON PEAK KWH	169
PRESENT KW (ACTUAL)	2.74	PRESENT PEAK KW	2.73
BASE KW	3	ON-PEAK KW	3
LOAD FACTOR	25.5%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..06-15-21 TO 07-15-21 30 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
550 KWH @ 8.674c	47.71
FUEL CHARGE	
550 KWH @ 3.094c	17.02
ASSET SECURITIZATION CHARGE	
550 KWH @ 0.234c	1.29
Total Electric Charges	\$81.27

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.08
COUNTY UTILITY TAX	7.02
STATE AND OTHER TAXES ON ELECTRIC	6.63
Total Taxes	\$15.73





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Aug 13, 2021
For service Jul 15 - Aug 13
29 days

Account number [REDACTED]

Billing summary

*# 1944 (W)
Pd 8-23-2021*


Previous amount due	\$97.00
Payment received Jul 27	-97.00
Electric Charges	90.79
Taxes	17.54
Total amount due Sep 07	\$108.33



Thank you for your payment.

Your usage snapshot

Average daily usage history

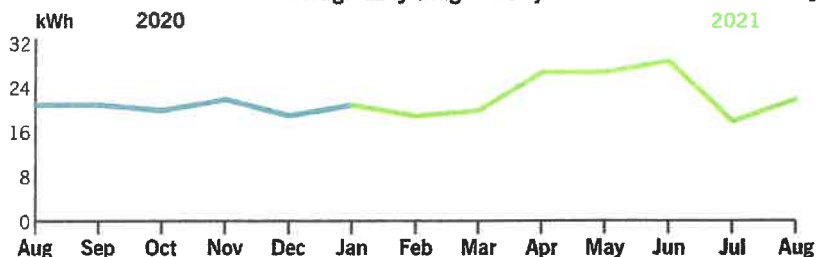

	Current Month	Aug 2020
Electric	22	21

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	7.40
Total Taxes	\$17.54

fb.def.duke.bills.20210813220010.4.a.fp-75793-000001347



Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		15857	
Previous reading		- 15230	
Energy used		627 kWh	
PRESENT ONPEAK	4,631	PREVIOUS ONPEAK	4,417
DIFFERENCE ONPEAK	214	ON PEAK KWH	214
PRESENT KW (ACTUAL)	4.23	PRESENT PEAK KW	4.23
BASE KW	4	ON-PEAK KW	4
LOAD FACTOR	22.5%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD: 07-15-21 TO 08-13-21 29 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
627 KWH @ 8.719c	54.67
FUEL CHARGE	
627 KWH @ 3.094c	19.40
ASSET SECURITIZATION CHARGE	
627 KWH @ 0.234c	1.47
Total Electric Charges	\$90.79

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Duke Energy Florida utilized fuel in the following proportions to generate your power: Coal 12%, Purchased Power 9%, Gas 77%, Oil 0%, Nuclear 0%, Solar 2% (For prior 12 months ending June 30, 2021).

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.33
COUNTY UTILITY TAX	7.81
STATE AND OTHER TAXES ON ELECTRIC	7.40
Total Taxes	\$17.54





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address

KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Sep 15, 2021
For service Aug 13 - Sep 15
33 days

Account number XXXXXXXXXX

7959 (W)

Billing summary

PD 9-22-2021

Previous amount due	\$108.33
Payment received Aug 30	-108.33
Electric Charges	102.71
Taxes	19.57
Total amount due Oct 07	\$122.28




Thank you for your payment.

To help us repair malfunctioning streetlights, quickly: 1. Call us at 1-800-228-8485 or visit duke-energy.com/lightrepair 2. Provide us with the light's location and your contact information 3. Specific addresses, landmarks and directions work best

Your usage snapshot

Average daily usage history

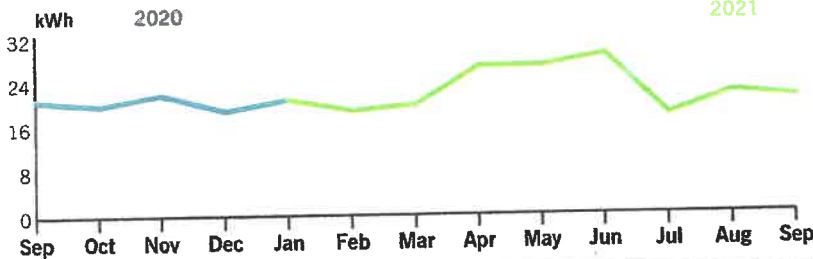

	Current Month	Sep 2020
Electric	21	21

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.

STATE AND OTHER TAXES ON ELECTRIC	8.38
Total Taxes	\$19.57





Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		16558	
Previous reading		- 15857	
Energy used		701 kWh	
PRESENT ONPEAK	4,841	PREVIOUS ONPEAK	4,631
DIFFERENCE ONPEAK	210	ON PEAK KWH	210
PRESENT KW (ACTUAL)	4.21	PRESENT PEAK KW	2.73
BASE KW	4	ON-PEAK KW	3
LOAD FACTOR	22.1%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..08-13-21 TO 09-15-21 33 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
701 KWH @ 8.719c	61.12
FUEL CHARGE	
701 KWH @ 3.514c	24.63
ASSET SECURITIZATION CHARGE	
701 KWH @ 0.244c	1.71
Total Electric Charges	\$102.71

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.63
COUNTY UTILITY TAX	8.56
STATE AND OTHER TAXES ON ELECTRIC	8.38
Total Taxes	\$19.57

fb.def.duke.bills.20210915215701.60.aip-68833-000003007





duke-energy.com
1.877.372.8477

Your Energy Bill

Service address
KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND DR,
LAKE REGION

Bill date Oct 15, 2021
For service Sep 15 - Oct 15
30 days

Account number [REDACTED]

PC 10/25/2021 # 7985 (W)

Billing summary


Previous amount due	\$122.28
Payment received Sep 28	-122.28
Electric Charges	106.33
Taxes	20.25
Total amount due Nov 08	\$126.58



Thank you for your payment.

Learn how to lower your bill with an online or free on-site Business Energy Check. This no-cost analysis provides you with specific tips on how to save energy and qualify for valuable rebates for energy-savings measures. You may also qualify for a FREE Commercial Energy Savings Kit. Go to duke-energy.com/FreeBizCheck or call 877.426.0009.

Your usage snapshot

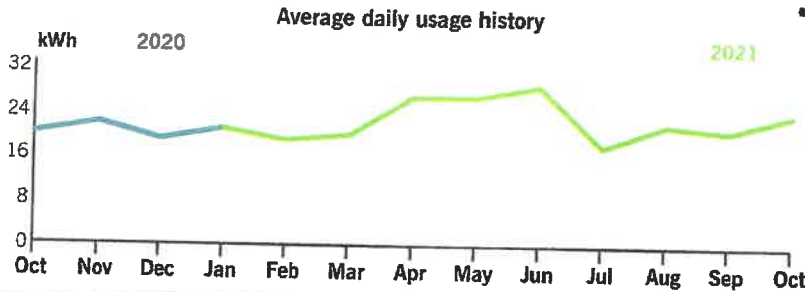

	Current Month	Oct 2020
Electric	24	20

STATE AND OTHER TAXES ON ELECTRIC	8.67
Total Taxes	\$20.25

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 1.5%, late charge, whichever is greater.



Your usage snapshot - continued

Current electric usage for meter number 000177099			
Actual reading		17288	
Previous reading		- 16558	
Energy used		730 kWh	
PRESENT ONPEAK	5,091	PREVIOUS ONPEAK	4,841
DIFFERENCE ONPEAK	250	ON PEAK KWH	250
PRESENT KW (ACTUAL)	4.24	PRESENT PEAK KW	4.08
BASE KW	4	ON-PEAK KW	4
LOAD FACTOR	25.3%		



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric Charges

General Service Non-Demand Secondary (GS-1)	
BILLING PERIOD..09-15-21 TO 10-15-21 30 DAYS	
CUSTOMER CHARGE	\$15.25
ENERGY CHARGE	
730 KWH @ 8.719c	63.65
FUEL CHARGE	
730 KWH @ 3.514c	25.65
ASSET SECURITIZATION CHARGE	
730 KWH @ 0.244c	1.78
Total Electric Charges	\$106.33

Your current rate is General Service Non-Demand Secondary (GS-1).

For a complete listing of all Florida rates and riders, visit duke-energy.com/rates

Billing details - Taxes

GROSS RECEIPTS TAX	\$2.73
COUNTY UTILITY TAX	8.85
STATE AND OTHER TAXES ON ELECTRIC	8.67
Total Taxes	\$20.25



Pd 11-23-2021 #8013 (w)

Service address Bill date Nov 18, 2021
 KEEN SALES RENTALS & UTIL For service Oct 15 - Nov 16
 547 PARADISE ISLAND PL 33 days
 LAKE REGION

Account number XXXXXXXXXX

Billing summary


Previous Amount Due	\$126.58
Payment Received Nov 05	-126.58
Current Electric Charges	119.44
Taxes	22.70
Total Amount Due Dec 09	\$142.14



Thank you for your payment.

We've made updates to your bill! Your usage snapshot now includes the average outdoor temperature, and a new account number also displays at the top of your statement. If paying electronically, we encourage you to use this new 12-digit number, although payments can be processed under the old account number, too. You can also add a contribution on your payment to help others. Visit duke-energy.com/BizBillUpdates to learn more.

Your usage snapshot

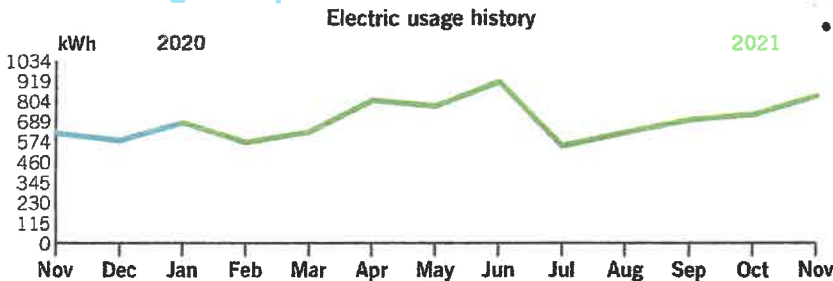

Average temperature in degrees

73° 60° 61° 67 70° 73 78° 81 82° 87 77° 67

	Current Month	Nov 2020	12-Month Usage	Avg Monthly Usage
Electric (kWh)	835	625	8,425	702
Avg. Daily (kWh)	25	22	23	

12-month usage based on most recent history

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 0.0%, late charge, whichever is greater.



Your usage snapshot - Continued

Current electric usage for meter number 177099	
Actual reading on Nov 16	18123
Previous reading on Oct 15	-17288
Energy used	835 kWh
Billed kWh	835.000 kWh



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric

Billing Period - Oct 15 to Nov 16	
Meter - 177099	
Customer Charge	\$15.25
Energy Charge	
835.000 kWh @ 8.720c	72.81
Fuel Charge	
835.000 kWh @ 3.514c	29.34
Asset Securitization Charge	
835.000 kWh @ 0.244c	2.04
Total Current Charges	\$119.44

Your current rate is General Service Non-Demand Secondary (GS-1).

Duke Energy Florida utilized fuel in the following proportions to generate your power: Coal 12%, Purchased Power 10%, Gas 76%, Oil 0%, Nuclear 0%, Solar 2% (For prior 12 months ending September 30, 2021).

Billing details - Taxes

State And Other Taxes	\$8.51
Gross Receipts Tax	3.06
County Utility Tax	9.90
County Optional Tax	1.23
Total Taxes	\$22.70



*Pd 1-3-2022
CK# 8042 (Jan 2022)*

Service address KEEN SALES RENTALS & UTIL
547 PARADISE ISLAND PL
LAKE REGION


Bill date Dec 20, 2021
For service Nov 17 - Dec 16
30 days

Account number [REDACTED]

Billing summary

Previous Amount Due	\$142.14
Payment Received Nov 29	-142.14
Current Electric Charges	96.98
Taxes	18.50
Total Amount Due Jan 10	\$115.48

Your usage snapshot

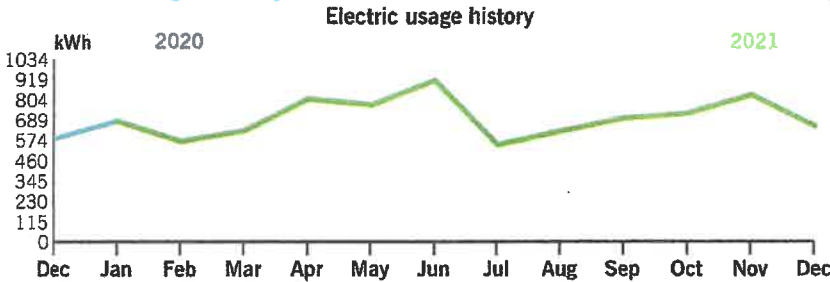

Average temperature in degrees

60° 61° 67° 70° 73° 78° 81° 81° 82° 80° 77° 66° 68°

	Current Month	Dec 2020	12-Month Usage	Avg Monthly Usage
Electric (kWh)	655	583	8,497	708
Avg. Daily (kWh)	22	19	23	

12-month usage based on most recent history



Thank you for your payment.

We've made updates to your bill! Your usage snapshot now includes the average outdoor temperature, and a new account number also displays at the top of your statement. If paying electronically, we encourage you to use this new 12-digit number, although payments can be processed under the old account number, too. You can also add a contribution on your payment to help others. Visit duke-energy.com/BizBillUpdates to learn more.

Mail your payment at least 7 days before the due date or pay instantly at duke-energy.com/billing. Late payments are subject to a \$5.00 or 0.0%, late charge, whichever is greater.



Your usage snapshot - Continued

Current electric usage for meter number 177099	
Actual reading on Dec 16	18778
Previous reading on Nov 17	- 18123
<hr/>	
Energy used	655 kWh
Billed kWh	655.000 kWh



A kilowatt-hour (kWh) is a measure of the energy used by a 1,000-watt appliance in one hour. A 10-watt LED lightbulb would take 100 hours to use 1 kWh.

Billing details - Electric

Billing Period - Nov 17 to Dec 16	
Meter - 177099	
Customer Charge	\$15.25
Energy Charge	
655.000 kWh @ 8.719c	57.11
Fuel Charge	
655.000 kWh @ 3.514c	23.02
Asset Securitization Charge	
655.000 kWh @ 0.244c	1.60
<hr/>	
Total Current Charges	\$96.98

Your current rate is General Service Non-Demand Secondary (GS-1).

Billing details - Taxes

State And Other Taxes	\$6.91
Gross Receipts Tax	2.49
County Utility Tax	8.10
County Optional Tax	1.00
<hr/>	
Total Taxes	\$18.50



#3

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
226 East Lake Avenue
Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
1/1/2021	212561

Bill To:

Paradise Island
685 Dyson Road
Haines City, Fl 33844

#3

We accept Visa, M/C, Discover & AMEX

Pd CK# 7120 (w)

PH: 863-965-1439		Workorder No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
2	Bacteriological Sample	30.25	60.50	
37.5	Gallons of Chlorine	2.20	82.50	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.			Total	\$353.00
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.				
We offer a complete line of water treatment equipment & pool supplies, service and repair.				

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
2/1/2021	214457

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, FL 33844

• We accept Visa, M/C, Discover & AMEX

Pd 2-2-2021 #7143 (w)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms	
PH: 863-967-2863			Due on receipt	
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
2	Bacteriological Sample	30.25	60.50	
42.5	Gallons of Chlorine	2.20	93.50	
	7% Sales Tax	7.00%	0.00	

Thank you for your business.	Total	\$364.00
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.		

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.

Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue

Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
3/1/2021	216275

Bill To:

Paradise Island
685 Dyson Road
Haines City, FL 33844

We accept Visa, M/C, Discover & AMEX

Pd 3-1-2021 CK# 7160(W)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms
PH: 863-967-2863			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
2	Bacteriological Sample	30.25	60.50
37.5	Gallons of Chlorine	2.20	82.50
	7% Sales Tax	7.00%	0.00

Thank you for your business.	Total	\$353.00
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.		

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
4/1/2021	218208

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, Fl 33844

We accept Visa, M/C, Discover & AMEX

Pd 4-7-2021 ck# 401.90

PH: 863-965-1439	Workorder No.	P.O. No.	Terms	
PH: 863-967-2863			Due on receipt	
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
2	Bacteriological Sample	30.25	60.50	
47	Gallons of Chlorine	2.20	103.40	
1	Stenner Tube #7	28.00	28.00	
	7% Sales Tax	7.00%	0.00	

Thank you for your business.

Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.

Total \$401.90

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
5/1/2021	220221

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, FL 33844

We accept Visa, M/C, Discover & AMEX

Pl 5-3-2021 #7214 (w)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms
PH: 863-967-2863			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
2	Bacteriological Sample	30.25	60.50
67	Gallons of Chlorine	2.20	147.40
	7% Sales Tax	7.00%	0.00

Thank you for your business.	Total	\$417.90
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.		

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
6/1/2021	222177

(Handwritten initials in a circle)

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, FL 33844

We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439 PH: 863-967-2863	Workorder No.	P.O. No.	Terms
			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
2	Bacteriological Sample	30.25	60.50
45	Gallons of Chlorine	2.20	99.00
	7% Sales Tax	7.00%	0.00

(Handwritten note in a circle)
 #10669
 6/7/21

Thank you for your business.	Total	\$369.50
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.		

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com




Invoice

Date	Invoice #
7/1/2021	224153

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, Fl 33844

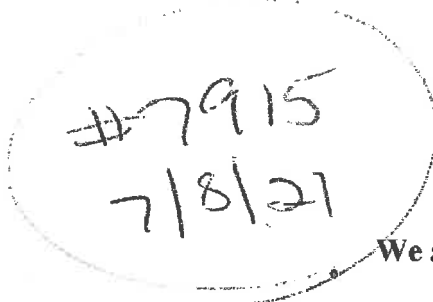

We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439		Workorder No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
2	Bacteriological Sample	30.25	60.50	
65	Gallons of Chlorine	2.20	143.00	
1	Stenner Tube#7	28.00	28.00	
1	Stenner Duckbill	5.00	5.00	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.			Total	\$446.50
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.				
We offer a complete line of water treatment equipment & pool supplies, service and repair.				

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
8/1/2021	226233

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, Fl 33844

We accept Visa, M/C, Discover & AMEX

Pd 8-2-2021 # 7934 (W)

PH: 863-965-1439		Workorder No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
2	Bacteriological Sample	30.25	60.50	
37.5	Gallons of Chlorine	2.20	82.50	
	7% Sales Tax	7.00%	0.00	

Thank you for your business.	Total \$353.00
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.	

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
9/1/2021	228211

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, Fl 33844

We accept Visa, M/C, Discover & AMEX

12 9-2-2021 CK# 7952 (W)

PH: -863-965-1439		Workorder No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
2	Bacteriological Sample	30.25	60.50	
42.5	Gallons of Chlorine	2.20	93.50	
1	OP Log	36.93	36.93	
	7% Sales Tax	7.00%	0.00	

Thank you for your business.

Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.

Total

\$400.93

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.

Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
10/1/2021	230147

Bill To:

Paradise Island
685 Dyson Road
Haines City, Fl 33844

We accept Visa, M/C, Discover & AMEX

pd 10-4-2021 #7971 (w)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms
PH: 863-967-2863			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
2	Bacteriological Sample	30.25	60.50
50	Gallons of Chlorine	2.20	110.00
	7% Sales Tax	7.00%	0.00

Thank you for your business.	Total \$380.50
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.	

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date: 11/1/2021
 Invoice #: 232147

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, FL 33844

Pd 11-1-202 # 7993 (w)

• We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439
 PH: 863-967-2863

Workorder No:

P.O. No:

Terms

Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
2	Bacteriological Sample	30.25	60.50
53.5	Gallons of Chlorine	2.20	117.70
	7% Sales Tax	7.00%	0.00

Thank you for your business.

Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.

Total

\$388.20

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
12/1/2021	234125

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, FL 33844

Pd 12/2/2021
ck# 8021 (w)

• We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439 PH: 863-967-2863		Workorder No.	P.O. No.	Terms
				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
2	Bacteriological Sample	30.25	60.50	
35	Gallons of Chlorine	2.20	77.00	
1	Stenner Duckbill	5.00	5.00	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.		Total		\$352.50
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.				
We offer a complete line of water treatment equipment & pool supplies, service and repair.				

TRI-FLORIDA WATER TREATMENT, INC.

Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue

Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
1/1/2021	212541

Bill To:

Keen's Sales & Rentals

685 Dyson Road

Haines City, Fl. 33844

#153
Subs

We accept Visa, M/C, Discover & AMEX

Pd 1-4-2021 #7122

PH: 863-965-1439		Workorder No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
3	Bacteriological Sample	30.25	90.75	
35	Gallons of Chlorine	2.20	77.00	
1	Stenner Duckbill	5.00	5.00	
1	Stenner Roller Assy	59.45	59.45	
1	Stenner Cover Screw	1.99	1.99	
1	Stenner Tube #2	28.00	28.00	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.			Total \$472.19	
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.				
We offer a complete line of water treatment equipment & pool supplies, service and repair.				

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
2/1/2021	214437

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, Fl. 33844

• We accept Visa, M/C, Discover & AMEX

Pd 2-2-2021 # 7144 (w)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms	
PH: 863-967-2863			Due on receipt	
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
3	Bacteriological Sample	30.25	90.75	
44	Gallons of Chlorine	2.20	96.80	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.		Total	\$397.55	
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.				
We offer a complete line of water treatment equipment & pool supplies, service and repair.				

TRI-FLORIDA WATER TREATMENT, INC.

Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue

Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
3/1/2021	216255

Bill To:

Keen's Sales & Rentals

685 Dyson Road

Haines City, Fl. 33844

We accept Visa, M/C, Discover & AMEX

pd 3-1-2021 #7159 (w)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms
PH: 863-967-2863			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
3	Bacteriological Sample	30.25	90.75
52.5	Gallons of Chlorine	2.20	115.50
	7% Sales Tax	7.00%	0.00

Thank you for your business.	Total	\$416.25
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.		

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
4/1/2021	218188

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, Fl. 33844

We accept Visa, M/C, Discover & AMEX

Pd 4-7-2021 #7189

PH: 863-965-1439		Workorder No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
3	Bacteriological Sample	30.25	90.75	
67.5	Gallons of Chlorine	2.20	148.50	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.			Total	\$449.25
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.				
We offer a complete line of water treatment equipment & pool supplies, service and repair.				

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
5/1/2021	220200

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, Fl. 33844

We accept Visa, M/C, Discover & AMEX

Pd 5-3-2021 # 7213 (w)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms
PH: 863-967-2863			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
3	Bacteriological Sample	30.25	90.75
85	Gallons of Chlorine	2.20	187.00
1	Stenner Tube #2	28.00	28.00
	7% Sales Tax	7.00%	0.00

Thank you for your business.	Total	\$515.75
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.		

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.

Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue

Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
6/1/2021	222156

Bill To:



Keen's Sales & Rentals
685 Dyson Road
Haines City, Fl. 33844

We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439		Workorder No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
3	Bacteriological Sample	30.25	90.75	
49.5	Gallons of Chlorine	2.20	108.90	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.			Total	\$409.65
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.				
We offer a complete line of water treatment equipment & pool supplies, service and repair.				

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
7/1/2021	224133

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, Fl. 33844

#7916
 7/8/21

W

We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439	Workorder No.	P.O. No.	Terms
PH: 863-967-2863			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
3	Bacteriological Sample	30.25	90.75
80	Gallons of Chlorine	2.20	176.00
	7% Sales Tax	7.00%	0.00

Thank you for your business.	Total	\$476.75
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.		

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
8/1/2021	226214

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, Fl. 33844

We accept Visa, M/C, Discover & AMEX

Pd 8-2-2021 # 7933 (w)

PH: 863-965-1439		Workorder No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
3	Bacteriological Sample	30.25	90.75	
39.5	Gallons of Chlorine	2.20	86.90	
1	Stenner Duckbill	5.00	5.00	
1	Stenner Tube #2	28.00	28.00	
	7% Sales Tax	7.00%	0.00	

Thank you for your business.	Total \$420.65
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.	

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
9/1/2021	228192

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, Fl. 33844

We accept Visa, M/C, Discover & AMEX

Pd 9-2-2021 # 1953 (W)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms
PH: 863-967-2863			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
3	Bacteriological Sample	30.25	90.75
42.5	Gallons of Chlorine	2.20	93.50
1	OP Log	36.93	36.93
1	Stenner Duckbill	5.00	5.00
	7% Sales Tax	7.00%	0.00

Thank you for your business.	Total \$436.18
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.	

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)

226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
10/1/2021	230128

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, Fl. 33844

We accept Visa, M/C, Discover & AMEX

Pd 10-4-2021 # 7976 (W)

PH: 863-965-1439	Workorder No.	P.O. No.	Terms
PH: 863-967-2863			Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
3	Bacteriological Sample	30.25	90.75
40	Gallons of Chlorine	2.20	88.00
1	Stenner Duckbill	5.00	5.00
	7% Sales Tax	7.00%	0.00

Thank you for your business.	Total \$393.75
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.	

We offer a complete line of water treatment equipment & pool supplies, service and repair.

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL. 33823

Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
11/1/2021	232129

PA 11-1-2021 # 2994 (W)

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, FL. 33844

• We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439
 PH: 863-967-2863

Workorder No.:

P.O. No.:

Terms:

Due on receipt

Quantity	Description	Rate	Amount
1	State Required Water Plant Staffing Service	210.00	210.00
3	Bacteriological Sample	30.25	90.75
59.5	Gallons of Chlorine	2.20	130.90
1	Stenner Duckbill	5.00	5.00
1	Stenner Tube #2	28.00	28.00
1	Stenner Tube Housing Cover w/Bushing	30.00	30.00
	7% Sales Tax	7.00%	0.00

Thank you for your business.

Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.

Total

\$494.65

We offer a complete line of water treatment equipment & pool supplies, service and repair.

Invoice

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823

Email us at: trifloridawater@msn.com

Date	Invoice #
12/1/2021	234107

Bill To:

Pd 12/2/21 ck# 8022(w)

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, Fl. 33844

• We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439		Workorder No:	P.O. No:	Terms:
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	State Required Water Plant Staffing Service	210.00	210.00	
3	Bacteriological Sample	30.25	90.75	
47.5	Gallons of Chlorine	2.20	104.50	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.			Total	\$405.25
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.				
We offer a complete line of water treatment equipment & pool supplies, service and repair.				

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823 Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
1/8/2021	214070

#4

Bill To:

Keen's Sales & Rentals
 685 Dyson Road
 Haines City, FL 33844

We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439		W.O. No.	P.O. No.	Terms
PH: 863-967-2863				Due on receipt
Quantity	Description	Rate	Amount	
1	CCR - Consumer Confidence Report	198.50	198.50	
1	Disinfection Bi-Products -(TTHM & HAA5 Samples)	355.00	355.00	
5	Lead and Copper	63.00	315.00	
1	Primary Inorganic	394.00	394.00	
1	Secondary Inorganic	317.00	317.00	
1	VOC Sample	215.00	215.00	
1	SOC Sample	1,130.00	1,130.00	
1	Combined Uranium Sample	130.00	130.00	
1	Radium 226 Sample	144.00	144.00	
1	Radium 228 Sample	164.75	164.75	
	7% Sales Tax	7.00%	0.00	
Thank you for your business.		Total	\$3,363.25	
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.		Payments/Credits	-\$926.00	
We offer a complete line of water treatment equipment & pool supplies, service and repair.		Balance Due	\$2,437.25	

TRI-FLORIDA WATER TREATMENT, INC.
Pool Works - Pools & Spas (Lic# RP252555032)
 226 East Lake Avenue
 Auburndale, FL 33823 Email us at: trifloridawater@msn.com

Invoice

Date	Invoice #
1/8/2021	214071

4

Bill To:

Paradise Island
 685 Dyson Road
 Haines City, Fl 33844

We accept Visa, M/C, Discover & AMEX

PH: 863-965-1439 PH: 863-967-2863		W.O. No.	P.O. No.	Terms	
				Due on receipt	
Quantity	Description	Rate	Amount		
1	CCR - Consumer Confidence Report	198.50	198.50		
1	Disinfection Bi-Products -(TTHM & HAA5 Samples)	355.00	355.00		
5	Lead and Copper	63.00	315.00		
1	Primary Inorganic	394.00	394.00		
1	Secondary Inorganics	317.00	317.00		
1	VOC Sample	215.00	215.00		
1	SOC Sample	1,130.00	1,130.00		
1	Combined Uranium Sample	130.00	130.00		
1	Radium 226 Sample	144.00	144.00		
1	Radium 228 Sample	164.75	164.75		
1	Gross Alpha Sample	75.00	75.00		
	7% Sales Tax	7.00%	0.00		
Thank you for your business.			Total	\$3,438.25	
Late charge of 1 1/2% per month will be assessed on past due balances over 30 days.			Payments/Credits	-\$926.00	
We offer a complete line of water treatment equipment & pool supplies, service and repair.			Balance Due	\$2,512.25	



P.O. Box 31111
Tampa, FL 33631-3111
1-800-727-7000

#6

Handwritten signature/initials

Account Number [REDACTED]
Vehicle: 2002 FORD E250 1FTNE24L12HA51258

06/25/2007
063-S004

POB8IM00G03477
KEEN SALES RENTALS & UTIL
685 DYSON RD
HAINES CITY FL 33844

Pd off

~~Dear KEEN SALES RENTALS & UTIL:~~

Congratulations! Your account has been paid-in-full. Please note the following in reference to your contract and title:

Contract Handling

- If a copy of your contract is enclosed, please accept this letter as authentication that the copy is an unaltered optically imaged reproduction of the contract and security agreement.
- If your original contract is not enclosed, please accept this letter as notice the contract is paid.

Credit Life and/or Disability Insurance

- If you purchased credit life and/or disability insurance, you may be entitled to a refund of the unused Credit Life and/or Disability insurance premiums if your contract was paid-in-full prior to its original maturity date. If a refund is due, your dealer will apply for the refund at your request. You may also contact the insurance company directly to apply for your refund.
- State specific disclosures for AL, CO, IA, MD, MA, NH, NY, OK, and WY are provided on the back side of this document.

Title/Lien Handling

While processing the payoff on your account, we have also taken steps to release our lien and forward your title or lien statement to either you or the party who paid off the vehicle or to an alternate lien holder as you have directed. This process varies based on state specific regulations as follows:

- If your state issues a physical or "paper" title and permits us to send the title directly to you, we have released our lien and have included your title or lien statement with this letter. If you have received a paper title with our lien released upon it, you must submit the title to the state for them to release our lien in their records.
- If your title is not enclosed, it is due to one of the following:
 - Your state may require we forward the physical or "paper" title or lien statement to them in order to have our lien released.
 - Several states use an electronic titling system in which a physical or "paper" title is not issued. If your state uses an electronic titling system, we have released our lien electronically and requested your title be forwarded to you. Please be aware the average time to receive your title is between three to six weeks.
 - You have transferred ownership to another party.
- State specific disclosures for AZ, CA, FL, IA, ID, MA, MT, NE, NY, OH, PA, SD, VA, and WA are provided on the back side of this document.

Questions

Please retain this information for your records. If you have any questions regarding your account, please contact us at the number listed above.

We appreciate your business. Thank you for allowing us to service your account!

Sincerely,
Ford Credit

Buyer (and Co-Buyer) Name and Address (including County and Zip Code)
KEEN SALES RENTALS & UTILITIES INC
 685 DYSON RD
 HAINES CITY POLK FL 33844

CREDITOR (Seller Name and Address)
BARTOW FORD COMPANY, INC.
 425 E. VAN FLEET DR.
 BARTOW FL 33830

You, the Buyer (and Co-Buyer, if any), may buy the vehicle described below for cash or on credit. The cash price is shown below as "Cash Price." The credit price is shown below as "Total Sale Price." By signing this contract, you choose to buy the vehicle on credit under the agreements on the front and back of this contract.

New/Used	Year and Make	Model	GVW if Truck (lbs.)	Vehicle Identification Number	Use For Which Purchased
NEW	2002 FORD TRUCK	E250	5176	1FTNE24L12HA51258	<input checked="" type="checkbox"/> Personal <input type="checkbox"/> Agricultural <input type="checkbox"/> Commercial

Trade-in Year and Make \$ N/A Gross Allowance \$ N/A Amount Owing

ITEMIZATION OF AMOUNT FINANCED

1. Cash Price	\$ 20392.58 ⁽¹⁾
2. Down Payment	
(a) Third Party Rebate Assigned to Creditor	\$ N/A
(b) Cash Paid	\$ N/A
(c) Deferred Down Payment Due	\$ N/A
(d) Cash Down Payment (a, b, plus c)	\$ N/A
(e) Trade-in (Description Above)	\$ N/A
Total Down Payment (d plus e)	\$ <u>N/A</u> ⁽²⁾
3. Unpaid Balance of Cash Price (1 minus 2)	\$ 20392.58 ⁽³⁾
4. Amounts paid on your behalf (Seller may be retaining a portion of these amounts) To Public Officials	
(i) for license, title & registration fees	\$ <u>N/A</u>
(ii) for official fees	\$ <u>71.75</u>
(iii) for documentary stamps	\$ <u>N/A</u>
(iv) for taxes (not in Cash Price)	\$ <u>71.75</u>
To Insurance Companies for:	
Credit Life Insurance	\$ <u>N/A</u>
Credit Disability Insurance	\$ <u>N/A</u>
.....	\$ <u>N/A</u>
.....	\$ <u>N/A</u>
To _____ for	\$ <u>N/A</u>
To _____ for	\$ <u>N/A</u>
To _____ for	\$ <u>N/A</u>
To _____ for	\$ <u>N/A</u>
Total	\$ <u>71.75</u> ⁽⁴⁾
5. Amount Financed (3 plus 4)	\$ 20464.33 ⁽⁵⁾

INSURANCE

CREDIT LIFE, CREDIT DISABILITY AND OTHER OPTIONAL INSURANCE ARE NOT REQUIRED TO OBTAIN CREDIT AND WILL NOT BE PROVIDED UNLESS YOU SIGN AN AGREEMENT TO PAY THE PREMIUM.

1. Buyer understands that he has the option of assigning any other policy or policies buyer owns or may procure for the purpose of covering the retail instalment sale and the policy need not be purchased from the creditor in order to obtain credit.

Buyer Signs _____
 Co-Buyer Signs _____

2. Buyer understands that the credit life coverage may be deferred if, at the time of application, the buyer is unable to engage in employment of like age and sex, if the proposed credit life insurance policy contains this restriction.

Buyer Signs _____
 Co-Buyer Signs _____

3. Buyer understands that the benefits under the policy will terminate when buyer reaches a certain age and that buyer's age is accurately represented on the application or policy.

Buyer Signs _____
 Co-Buyer Signs _____

Credit Life Insurer _____
 Premium \$ N/A
 Insured(s) _____
 Signature(s) _____

Disability Insurer _____
 Premium \$ N/A
 Insured(s) _____
 Signature _____

FEDERAL TRUTH-IN-LENDING DISCLOSURES

ANNUAL PERCENTAGE RATE	FINANCE CHARGE	Amount Financed	Total of Payments	Total Sale Price
The cost of your credit as a yearly rate 7.99 %	The dollar amount the credit will cost you \$ 4426.00	The amount of credit provided to you or on your behalf \$ 20464.33	The amount you will have paid when you have made all scheduled payments \$ 24890.40	The total cost of your purchase on credit, including your downpayment \$ 24890.40

Payment Schedule	Number of payments	Amount of Each payment	When Payments are due
Your payment schedule will be:	59	\$ 414.84	monthly starting 09/06/2002
	1 final	\$ 414.84	

Prepayment: If you pay off your account early, you will not have to pay a penalty.
 Late Payment: You must pay a late charge on the portion of each payment received more than 10 days late. The charge is 5 percent of the late amount or \$50.00, whichever is less.
 Security Interest: You are giving a security interest in the vehicle being purchased.
 Contract: Please see this contract for additional information on security interest, non payment.

WARRANTY
 Other Optional Insurance Term _____
 Insurer _____ Premium \$ N/A
 Signature _____

Credit Life and Credit Disability insurance are for the term of the contract. The amount and coverages are shown in a notice or agreement given to you today. You are required to insure the vehicle if a state

7

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

PUBLIC WATER SYSTEM INFORMATION

System Name: Keen Mobile Home Subdivision PWS I.D. #: 653-5235

System Type (check one): Community Nontransient Noncommunity Transient Noncommunity

Address: 685 Dyson Rd

City: Haines City, Fl ZIP Code: 33844

Phone # 863-421-6827 Fax #: _____ E-Mail Address: adunnahoe@aol.com

SAMPLE INFORMATION (to be completed by sampler)

Sample Number: 21120660-001 Sample Date: 12-9-21 Sample Time: 1030 AM PM (Circle One)

Sample Location (be specific): POE Location Code: _____

Disinfectant Residual (Required when reporting results for trihalomethanes and haloacetic acids): 1.5 mg/L Field pH: 7.2

Sample Type (Check Only One) Reason(s) for Sample (Check all that apply)

- | | | |
|---|--|---|
| <input type="checkbox"/> Distribution | <input checked="" type="checkbox"/> Routine Compliance with 62-550 | <input type="checkbox"/> Replacement (of Invalidated Sample) |
| <input checked="" type="checkbox"/> Entry Point (to Distribution) | <input type="checkbox"/> Confirmation of MCL Exceedance | <input type="checkbox"/> Special (not for compliance with 62-550) |
| <input type="checkbox"/> Plant Tap (not for compliance with 62-550) | <input type="checkbox"/> Composite of Multiple Sites | <input type="checkbox"/> Clearance (permitting) |
| <input type="checkbox"/> Raw (at well or intake) | <input type="checkbox"/> Other: _____ | |
| <input type="checkbox"/> Max Residence Time | Sampling Procedure Used or Other Comments: _____ | |
| <input type="checkbox"/> Ave Residence Time | | |
| <input type="checkbox"/> Near First Customer | | |

SAMPLER CERTIFICATION

I, Larry Scott, Operator, do HEREBY CERTIFY

(Print Name)

(Print Title)

that the above public water system and sample collection information is complete and correct.

Signature: Larry Scott

Date: 1-28-22

Certified Operator #: _____ Phone #: _____

Sampler's Fax #: _____

Sampler's E-mail: _____

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

LABORATORY CERTIFICATION INFORMATION (to be completed by lab – please type or print legibly)

Lab Name: Benchmark EnviroAnalytical, Inc Florida DOH Certification #: E84167 Certification Expiration Date: 06/30/2022

ATTACH CURRENT DOH ANALYTE SHEET*

Address: 1711 12th Street East, Palmetto, FL 34221

Phone #: 941-723-9986

Were any analyses subcontracted? Yes No If yes, please provide DOH certification number(s): E83079, E83033, E84567, E87610

ATTACH DOH ANALYTE SHEET FOR EACH SUBCONTRACTED LAB*

ANALYSIS INFORMATION (to be completed by lab)

Date Sample(s) Received: 12/09/2021

PWS ID (From Page 1): 653-5235 Sample Number (From Page 1): _____ Lab Assigned Report # or Job ID: 21120660-001

Group(s) Analyzed & Results attached for compliance with Chapter 62-550, F.A.C. (Check all that apply):

- | | | | | | | |
|---|---|--|--|---|--|--|
| <p><u>Inorganics</u></p> <input checked="" type="checkbox"/> All Except Asbestos
<input type="checkbox"/> Partial
<input type="checkbox"/> Nitrate
<input type="checkbox"/> Nitrite
<input type="checkbox"/> Asbestos | <p><u>Synthetic Organics</u></p> <input type="checkbox"/> All 30
<input checked="" type="checkbox"/> All Except Dioxin
<input type="checkbox"/> Partial
<input type="checkbox"/> Dioxin Only | <p><u>Volatile Organics</u></p> <input checked="" type="checkbox"/> All 21
<input type="checkbox"/> Partial | <p><u>Disinfection Byproducts</u></p> <input type="checkbox"/> Trihalomethanes
<input type="checkbox"/> Haloacetic Acids
<input type="checkbox"/> Chlorite
<input type="checkbox"/> Bromate | <p><u>Radionuclides</u></p> <input checked="" type="checkbox"/> Single Sample
<input type="checkbox"/> Qtrly Composite** | <p><u>Secondaries</u></p> <input checked="" type="checkbox"/> All 14
<input type="checkbox"/> Partial | <p><u>Others</u></p> <input checked="" type="checkbox"/> NOX |
|---|---|--|--|---|--|--|

LAB CERTIFICATION

I, Dale D. Dixon / Tulay Tanrisever / Kara Peterson, Lab Director / Technical Director & QC Officer / QA Officer, do HEREBY CERTIFY
(Print Name) (Print Title)

that all attached analytical data are correct and unless noted meet all requirements of the National Environmental Laboratory Accreditation Conference (NELAC).

Signature: 

Date: 1/26/2022

- * Failure to provide a valid and current Florida DOH lab certification number and a current Analyte Sheet for the attached analysis results will result in rejection of the report, possible enforcement against the public water system for failure to sample, and may result in notification of the DOH Bureau of Laboratory Services.
- ** Please provide radiological sample dates & locations for each quarter.

CONFIRMATION & NOTIFICATION IS REQUIRED WITHIN 24 HRS FOR NITRATE OR NITRITE MCL EXCEEDANCES
 NON-DETECTS ARE TO BE REPORTED AS THE MDL WITH A "U" QUALIFIER. (Non-detects reported as "BDL" or with a "<" are not acceptable.)

COMPLIANCE DETERMINATION (to be completed by DEP or DOH -- attach notes as necessary)

Sample Collection & Analysis Satisfactory: Yes No _____ Replacement Sample or Report Requested (circle or highlight group(s) above)

Person Notified: _____ Date Notified: _____ DEP/DOH Reviewing Official: _____

**Florida Department of Environmental Protection
Safe Drinking Water Program Laboratory Reporting Format**

INORGANIC CONTAMINANTS
62-550.310(1)

Report Number / Job ID: 21120660-001

PWS ID (From Page 1): 653-5235

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	Analysis Date	Analysis Time	DOH Lab Certification #
1040	Nitrate (as N)	10	mg/L	0.020	U	300.0	0.020	12/9/2021	21:10	E84167
1041	Nitrite (as N)	1	mg/L	0.020	U	300.0	0.020	12/9/2021	21:10	E84167
1005	Arsenic	0.010	mg/L	0.00069	U	SM3113B	0.00069	12/13/2021	17:46	E84167
1010	Barium	2	mg/L	0.018		200.7	0.002	12/13/2021	16:32	E84167
1015	Cadmium	0.005	mg/L	0.0009	U	200.7	0.0009	12/13/2021	16:32	E84167
1020	Chromium	0.1	mg/L	0.002	U	200.7	0.002	12/13/2021	16:32	E84167
1024	Cyanide	0.2	mg/L	0.005	U	335.4	0.005	12/14/2021	12:00	E84167
1025	Fluoride	4.0	mg/L	0.071	I	300.0	0.030	12/18/2021	13:18	E84167
1030	Lead	0.015	mg/L	0.002	I	SM3113B	0.00067	12/13/2021	14:11	E84167
1035	Mercury	0.002	mg/L	0.000198	U	245.1	0.000198	12/22/2021	15:01	E84167
1036	Nickel	0.1	mg/L	0.00118	U	200.7	0.00118	12/13/2021	16:32	E84167
1045	Selenium	0.05	mg/L	0.00091	U	200.8	0.00091	1/19/2022	15:39	E87610
1052	Sodium	160	mg/L	8.21		200.7	0.034	12/13/2021	16:32	E84167
1074	Antimony	0.006	mg/L	0.00226	U	SM3113B	0.00226	1/10/2022	18:23	E84167
1075	Beryllium	0.004	mg/L	0.000078	U	200.7	0.000078	12/13/2021	16:32	E84167
1085	Thallium	0.002	mg/L	0.000981	U	200.9	0.000981	12/21/2021	15:42	E84167
1094	Asbestos	7 MFL	MFL							E

*Results must be reported with appropriate qualifiers in accordance with Florida Administrative Code Rule 62-160, Table 1. Results qualified with A, F, H, N, O, T, Z, ?, *, are unacceptable for compliance with 62-550. Results qualified with a J, Q, R, or Y must be accompanied by written justification and will be evaluated on a case by case basis. To avoid a monitoring violation, unacceptable results must be replaced with acceptable results from samples collected during the same monitoring period.

**Florida Department of Environmental Protection
Safe Drinking Water Program Laboratory Reporting Format**

SECONDARY CONTAMINANTS
62-550.320

Report Number / Job ID: 21120660-001

PWS ID (From Page 1): 653-5235

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	Analysis Date	Analysis Time	DOH Lab Certification #
1002	Aluminum	0.2	mg/L	0.029	I	200.7	0.023	12/13/2021	16:32	E84167
1017	Chloride	250	mg/L	12.1		300.0	0.353	12/14/2021	00:13	E84167
1022	Copper	1	mg/L	0.116		200.7	0.004	12/13/2021	16:32	E84167
1025	Fluoride	2.0	mg/L	0.071	I	300.0	0.030	12/18/2022	13:18	E84167
1028	Iron	0.3	mg/L	0.085	I	200.7	0.029	12/13/2021	16:32	E84167
1032	Manganese	0.05	mg/L	0.005		200.7	0.00098	12/13/2021	16:32	E84167
1050	Silver	0.1	mg/L	0.0005	U	200.7	0.0005	12/13/2021	16:32	E84167
1055	Sulfate	250	mg/L	0.856	I	300.0	0.339	12/14/2021	00:13	E84167
1095	Zinc	5	mg/L	0.129		200.7	0.0014	12/13/2021	16:32	E84167
1905	Color	15	CU	5		SM2120B	2.5	12/9/2021	17:18	E84167
1920	Odor	3	TON	1	U	140.1	1	12/9/2021	13:14	E84567
1925	pH (field pH from page 1)	6.5 - 8.5		7.68	Q	SM4500H+B		12/9/2021	16:45	E84167
1930	Total Dissolved Solids	500	mg/L	152		SM2540C	7.26	12/16/2021	13:40	E84167
2905	Foaming Agents	0.5	mg/L	0.03	U	SM5540C	0.03	12/10/2021	09:47	E84167

**Florida Department of Environmental Protection
Safe Drinking Water Program Laboratory Reporting Format**

RADIONUCLIDES
62-550.310(6)

Report Number / Job ID: 21120660-001

PWS ID (From Page 1): 653-5235

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	RDL	Analysis Error	Analysis Date	Analysis Time	DOH Lab Certification #
4000	Gross Alpha (Excl Uranium)	15	pCi/L	**				3				
4002	Gross Alpha (Incl Uranium)	***	pCi/L					3				
4006	Combined Uranium**** (U-234, U-235, & U-238)	20	pCi/L	0.6	U	908.0	0.6	.67	0.5	1/5/2022	06:22	E83033
		30	µg/L					1				
4020	Radium-226	5	pCi/L	0.7		903.1	0.1	1	0.3	12/23/2021	10:02	E83033
4030	Radium-228			0.7	U	904.0	0.7	1	0.5	12/22/2021	09:35	E83033

** If the result exceeds 5 pCi/L, a measurement for radium-226 is required. Uranium is reported separately under Contam ID 4006.

*** If the results exceed 5 pCi/L, a measurement for radium-226 is required. If the results exceed 15 pCi/L, a measurement for Combined Uranium must be reported separately. The DEP/DOH will subtract the U value from the Gross Alpha (ID 4002) to determine compliance with MCL for Gross Alpha (Excl. U) of 15pCi/L. If the result for ID 4002 Gross Alpha (Including Uranium) does not exceed 15pCi/L, Combined Uranium need not be measured nor reported.

**** If using Uranium testing methods ASTM D5174 or EPA 200.8 only, then Analysis Error need not be reported.

**Florida Department of Environmental Protection
Safe Drinking Water Program Laboratory Reporting Format**

VOLATILE ORGANICS
62-550.310(4)(a)

Report Number / Job ID: 21120660-001

PWS ID (From Page 1): 653-5235

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	RDL	Analysis Date	Analysis Time	DOH Lab Certification #
2378	1,2,4-Trichlorobenzene	70	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2380	cis-1,2-Dichloroethylene	70	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2955	Xylenes (total)	10,000	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2964	Dichloromethane	5	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2968	o-Dichlorobenzene	600	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2969	para-Dichlorobenzene	75	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2976	Vinyl Chloride	1	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2977	1,1-Dichloroethylene	7	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2979	trans-1,2-Dichloroethylene	100	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2980	1,2-Dichloroethane	3	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2981	1,1,1-Trichloroethane	200	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2982	Carbon tetrachloride	3	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2983	1,2-Dichloropropane	5	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2984	Trichloroethylene	3	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2985	1,1,2-Trichloroethane	5	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2987	Tetrachloroethylene	3	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2989	Monochlorobenzene	100	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2990	Benzene	1	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2991	Toluene	1,000	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2992	Ethylbenzene	700	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167
2996	Styrene	100	µg/L	0.5	U	524.2	0.5	0.5	12/16/2021	00:25	E84167

NOTE: Results indicating non-detection with a reported lab MDL > .5 µg/L will not be accepted for compliance.

*Results must be reported with appropriate qualifiers in accordance with Florida Administrative Code Rule 62-160, Table 1. Results qualified with A, F, H, N, O, T, Z, ?, *, are unacceptable for compliance with 62-550. Results qualified with a J, Q, R, or Y must be accompanied by written justification and will be evaluated on a case by case basis. To avoid a monitoring violation, unacceptable results must be replaced with acceptable results from samples collected during the same monitoring period.

**Florida Department of Environmental Protection
Safe Drinking Water Program Laboratory Reporting Format**

SYNTHETIC ORGANICS

62-550.310(4)(b)

Report Number / Job ID: 21120660-001 PWS ID (from Page 1): 653-5235

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier *	Analytical Method	Lab MDL	RDL	Extraction Date	Analysis Date	Analysis Time	DOH Lab Certification #
2005	Endrin	2	µg/L	0.0023	U	525.3	0.0023	0.01	12/23/2021	12/26/2021	23:40	E83079
2010	Lindane	0.2	µg/L	0.0027	U	525.3	0.0027	0.02	12/23/2021	12/26/2021	23:40	E83079
2015	Methoxychlor	40	µg/L	0.0230	U	525.3	0.0230	0.1	12/23/2021	12/26/2021	23:40	E83079
2020	Toxaphene	3	µg/L	0.7000	U	505	0.7000	1	12/20/2021	12/21/2021	12:06	E83079
2031	Dalapon	200	µg/L	0.4900	U	515.3	0.4900	1	12/16/2021	12/18/2021	01:36	E83079
2032	Diquat	20	µg/L	0.1600	U	549.2	0.1600	0.4	12/15/2021	12/16/2021	18:28	E83079
2033	Endothall	100	µg/L	3.3000	U	548.1	3.3000	9	12/16/2021	12/20/2021	14:00	E83079
2034	Glyphosate	700	µg/L	4.2000	U	547	4.2000	6	12/16/2021	12/16/2021	02:41	E83079
2035	Di(2-ethylhexyl)adipate	400	µg/L	0.3600	U	525.3	0.3600	0.6	12/23/2021	12/26/2021	23:40	E83079
2036	Oxamyl (Vydate)	200	µg/L	0.4600	U	531.2	0.4600	2	12/17/2021	12/17/2021	00:35	E83079
2037	Simazine	4	µg/L	0.0400	U	525.3	0.0400	0.07	12/23/2021	12/26/2021	23:40	E83079
2039	Di(2-ethylhexyl)phthalate	6	µg/L	0.4700	U	525.3	0.4700	2.2	12/23/2021	12/26/2021	23:40	E83079
2040	Picloram	500	µg/L	0.0400	U	515.3	0.0400	0.1	12/16/2021	12/18/2021	01:36	E83079
2041	Dinoseb	7	µg/L	0.1600	U	515.3	0.1600	0.2	12/16/2021	12/18/2021	01:36	E83079
2042	Hexachlorocyclopentadinene	50	µg/L	0.0240	U	525.3	0.0240	0.1	12/23/2021	12/26/2021	23:40	E83079
2046	Carbofuran	40	µg/L	0.5900	U	531.2	0.5900	0.9	12/17/2021	12/17/2021	00:35	E83079
2050	Atrazine	3	µg/L	0.0150	U	525.3	0.0150	0.1	12/23/2021	12/26/2021	23:40	E83079
2051	Alachlor	2	µg/L	0.0290	U	525.3	0.0290	0.2	12/23/2021	12/26/2021	23:40	E83079
2063	2,3,7,8-TCDD (Dioxin)	0.03	ng/L					0.005				
2065	Heptachlor	0.4	µg/L	0.0140	U	525.3	0.0140	0.04	12/23/2021	12/26/2021	23:40	E83079
2067	Heptachlor Epoxide	0.2	µg/L	0.0030	U	525.3	0.0030	0.02	12/23/2021	12/26/2021	23:40	E83079
2105	2,4-D	70	µg/L	0.0960	U	515.3	0.0960	0.1	12/16/2021	12/18/2021	01:36	E83079
2110	2,4,5-TP (Silvex)	50	µg/L	0.0530	U	515.3	0.0530	0.2	12/16/2021	12/18/2021	01:36	E83079
2274	Hexachlorobenzene	1	µg/L	0.0150	U	525.3	0.0150	0.1	12/23/2021	12/26/2021	23:40	E83079
2306	Benzo(a)pyrene	0.2	µg/L	0.0190	U	525.3	0.0190	0.02	12/23/2021	12/26/2021	23:40	E83079
2326	Pentachlorophenol	1	µg/L	0.0140	U	515.3	0.0140	0.04	12/16/2021	12/18/2021	01:36	E83079
2383	Polychlorinated biphenyls (PCBs)	0.5	µg/L	0.0450	U	505	0.0450	0.1	12/20/2021	12/21/2021	12:06	E83079
2931	Dibromochloropropane	0.2	µg/L	0.014	U	504.1	0.014	0.02	12/13/2021	12/13/2021	13:40	E84167
2946	Ethylene Dibromide (EDB)	0.02	µg/L	0.01	U	504.1	0.01	0.01	12/13/2021	12/13/2021	13:40	E84167
2959	Chlordane	2	µg/L	0.0360	U	505	0.0360	0.2	12/20/2021	12/21/2021	12:06	E83079

NOTE: Results indicating non-detection with a reported lab MDL >50% of the MCL will not be accepted for compliance.

*Results must be reported with appropriate qualifiers in accordance with Florida Administrative Code Rule 62-160, Table 1. Results qualified with A, F, H, N, O, T, Z, ?, *, are unacceptable for compliance with 62-550. Results qualified with a J, Q, R, or Y must be accompanied by written justification and will be evaluated on a case by case basis. To avoid a monitoring violation, unacceptable results must be replaced with acceptable results from samples collected during the same monitoring period.

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

OTHER CONTAMINANTS

Report Number / Job ID: 21120660-001

PWS ID (From Page 1): 653-5235

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	Analysis Date	Analysis Time	DOH Lab Certification #
1038	NITRATE+NITRITE AS N	10	MG/L	0.020	U	300.0	0.020	12/9/2021	21:10	E84167
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E

*Results must be reported with appropriate qualifiers in accordance with Florida Administrative Code Rule 62-160, Table 1. Results qualified with A, F, H, N, O, T, Z, ?, *, are unacceptable for compliance with 62-550. Results qualified with a J, Q, R, or Y must be accompanied by written justification and will be evaluated on a case by case basis. To avoid a monitoring violation, unacceptable results must be replaced with acceptable results from samples collected during the same monitoring period.

DATA QUALIFIERS THAT MAY APPLY:

B = Results based upon colony counts outside the ideal range.

G1 = Accuracy standard does not meet method control limits but does meet lab control limits that are in agreement with USEPA generated data. USEPA letter available upon request.

G2 = Accuracy standard exceeds acceptable control limits. Duplicate and spike values are within control limits. Reported data are usable.

G3 = Precision measurement exceeded acceptable control limits. Standard and spike values are within control limits. Reported data are usable.

G4 = Spike recovery exceeds acceptable control limits. Standard and duplicate values are within control limits. Reported data are usable.

I = Reported value is between the laboratory MDL and the PQL.

J3 = Estimated value. Quality control criteria for precision and accuracy not met.

J4 = Estimated value. Sample matrix interference suspected.

J6 = Estimated value. SM5210B test replicates show more than 30% difference between high and low values, indicating potential presence of toxicity within the sample.

K = Off-scale low. Value is known to be < the value reported.

L = Off scale high; reported concentration exceeds the highest standard.

ND = Not Detected at or above adjusted reporting limit.

Q = Sample held beyond accepted hold time.

U = Analyte analyzed but not detected at the value indicated.

X = Value exceed MCL.

Y = Analysis performed on an improperly preserved sample. Data may be inaccurate

Z = Too many colonies were present (TNTC). The numeric value represents the filtration volume.



Laboratory Scope of Accreditation

Attachment to Certificate #: E84167-52, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E84167

EPA Lab Code: FL00289

(941) 723-9986

E84167

Benchmark EnviroAnalytical, Inc.
1711 12th Street East
Palmetto, FL 34221

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
1,1,1-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,1,2-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,1-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,2,4-Trichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,2-Dibromo-3-chloropropane (DBCP)	EPA 504.1	Synthetic Organic Contaminants	NELAP	4/20/2009
1,2-Dibromoethane (EDB, Ethylene dibromide)	EPA 504.1	Synthetic Organic Contaminants	NELAP	4/20/2009
1,2-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
1,2-Dichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,2-Dichloropropane	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,4-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Alkalinity as CaCO3	SM 2320 B	Primary Inorganic Contaminants	NELAP	5/25/2004
Aluminum	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004
Ammonia as N	EPA 350.1	Primary Inorganic Contaminants	NELAP	3/7/2011
Antimony	SM 3113 B	Primary Inorganic Contaminants	NELAP	1/3/2002
Arsenic	SM 3113 B	Primary Inorganic Contaminants	NELAP	1/3/2002
Barium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Benzene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Beryllium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Boron	EPA 200.7	Secondary Inorganic Contaminants	NELAP	3/7/2011
Bromate	EPA 300.1	Primary Inorganic Contaminants	NELAP	11/21/2008
Bromide	EPA 300.0	Primary Inorganic Contaminants	NELAP	5/25/2004
Bromoacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	4/20/2009
Bromodichloromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	9/28/2005
Bromoform	EPA 524.2	Group II Unregulated Contaminants	NELAP	9/28/2005
Cadmium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Calcium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Carbon tetrachloride	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Chlorate	EPA 300.1	Secondary Inorganic Contaminants	NELAP	11/21/2008
Chloride	EPA 300.0	Secondary Inorganic Contaminants	NELAP	5/25/2004
Chlorine	SM 4500-Cl G	Primary Inorganic Contaminants	NELAP	3/7/2011
Chlorite	EPA 300.1	Primary Inorganic Contaminants	NELAP	11/21/2008
Chloroacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	4/20/2009
Chlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Chloroform	EPA 524.2	Group II Unregulated Contaminants	NELAP	9/28/2005
Chromium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
cis-1,2-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E84167-52, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E84167

EPA Lab Code: FL00289

(941) 723-9986

E84167

Benchmark EnviroAnalytical, Inc.
1711 12th Street East
Palmetto, FL 34221

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Color	SM 2120 B	Secondary Inorganic Contaminants	NELAP	7/31/2007
Conductivity	SM-2510 B	Primary Inorganic Contaminants	NELAP	5/25/2004
Copper	EPA 200.7	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	5/25/2004
Corrosivity (langlier index)	SM 2330 B	Secondary Inorganic Contaminants	NELAP	3/7/2011
Cyanide	EPA 335.4	Primary Inorganic Contaminants	NELAP	1/7/2021
Dibromoacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	4/20/2009
Dibromochloromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	9/28/2005
Dichloroacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	4/20/2009
Dissolved organic carbon (DOC)	SM 5310 B	Primary Inorganic Contaminants	NELAP	11/21/2008
Escherichia coli	SM 9223 B	Microbiology	NELAP	1/3/2002
Escherichia coli	SM 9223 B /QUANTIT-TRAY	Microbiology	NELAP	3/7/2011
Ethylbenzene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Fluoride	EPA 300.0	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	5/25/2004
Hardness	SM 2340 B	Secondary Inorganic Contaminants	NELAP	3/7/2011
Heterotrophic plate count	SIMPLATE	Microbiology	NELAP	7/1/2016
Heterotrophic plate count	SM 9215 B	Microbiology	NELAP	5/25/2004
Hydrogen sulfide	SM 4500S= H (21st ed.)	Primary Inorganic Contaminants	NELAP	3/7/2011
Iron	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004
Lead	SM 3113 B	Primary Inorganic Contaminants	NELAP	1/3/2002
Magnesium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Manganese	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004
Mercury	EPA 245.1	Primary Inorganic Contaminants	NELAP	1/3/2002
Methylene chloride	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Molybdenum	EPA 200.7	Secondary Inorganic Contaminants	NELAP	3/7/2011
Nickel	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Nitrate	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/3/2002
Nitrate as N	EPA 300.0	Primary Inorganic Contaminants	NELAP	5/25/2004
Nitrite as N	EPA 300.0	Primary Inorganic Contaminants	NELAP	5/25/2004
Nitrite as N	EPA 353.2	Primary Inorganic Contaminants	NELAP	5/25/2004
Odor	EPA 140.1	Secondary Inorganic Contaminants	NELAP	1/3/2002
Orthophosphate as P	EPA 300.0	Primary Inorganic Contaminants	NELAP	3/7/2011
pH	SM 4500-H+-B	Secondary Inorganic Contaminants	NELAP	7/31/2007
Potassium	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E84167-52, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E84167

EPA Lab Code: FL00289

(941) 723-9986

E84167

Benchmark EnviroAnalytical, Inc.
1711 12th Street East
Palmetto, FL 34221

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Residue-filterable (TDS)	SM 2540 C	Secondary Inorganic Contaminants	NELAP	7/31/2007
Selenium	SM 3113 B	Primary Inorganic Contaminants	NELAP	1/3/2002
Silica as SiO2	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Silver	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004
Sodium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Styrene	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Sulfate	EPA 300.0	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	5/25/2004
Sulfide	SM 4500-S D/UV-VIS	Primary Inorganic Contaminants	NELAP	3/7/2011
Surfactants - MBAS	SM 5540 C	Secondary Inorganic Contaminants	NELAP	1/3/2002
Tetrachloroethylene (Perchloroethylene)	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Thallium	EPA 200.9	Primary Inorganic Contaminants	NELAP	1/3/2002
Toluene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Total coliforms	SM 9223 B	Microbiology	NELAP	1/3/2002
Total coliforms	SM 9223 B /QUANTI-TRAY	Microbiology	NELAP	3/7/2011
Total cyanide	EPA 335.4	Primary Inorganic Contaminants	NELAP	1/7/2021
Total haloacetic acids (HAA5)	EPA 552.2	Synthetic Organic Contaminants	NELAP	4/20/2009
Total nitrate-nitrite	EPA 300.0	Primary Inorganic Contaminants	NELAP	5/25/2004
Total nitrate-nitrite	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/3/2002
Total organic carbon	SM 5310 B	Primary Inorganic Contaminants	NELAP	5/25/2004
Total trihalomethanes	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
trans-1,2-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Trichloroacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	10/14/2010
Trichloroethene (Trichloroethylene)	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Turbidity	EPA 180.1	Secondary Inorganic Contaminants	NELAP	3/7/2011
UV 254	SM 5910 B	Primary Inorganic Contaminants	NELAP	11/16/2016
Vanadium	EPA 200.7	Secondary Inorganic Contaminants	NELAP	3/7/2011
Vinyl chloride	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Xylene (total)	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Zinc	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E84567-33, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E84567

EPA Lab Code: FL01095

(863) 656-2020

E84567

Benchmark Mid Florida Laboratory
1153 First Street South
Winter Haven, FL 33880

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Escherichia coli	SM 9222 G	Microbiology	NELAP	10/25/2017
Escherichia coli	SM 9223 B	Microbiology	NELAP	3/18/2011
Escherichia coli	SM 9223 B /QUANTI-TRAY	Microbiology	NELAP	8/26/2020
Heterotrophic plate count	SM 9215 B	Microbiology	NELAP	8/26/2020
Odor	EPA 140.1	Secondary Inorganic Contaminants	NELAP	8/31/2020
pH	SM 4500-H ⁺ -B	Primary Inorganic Contaminants	NELAP	8/31/2020
Total coliforms	SM 9222 B	Microbiology	NELAP	11/21/2001
Total coliforms	SM 9223 B	Microbiology	NELAP	11/21/2001
Total coliforms	SM 9223 B /QUANTI-TRAY	Microbiology	NELAP	8/26/2020

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E87610-42, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E87610 EPA Lab Code: NC01152 (919) 467-3090

E87610
Environmental Conservation Laboratories, Inc. - Cary
102A Woodwinds Industrial Court
Cary, NC 27511

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
1,1,1,2-Tetrachloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,1,1-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,1,2,2-Tetrachloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,1,2-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,1-Dichloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,1-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,1-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,2,3-Trichlorobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,2,3-Trichloropropane	EPA 504.1	Group II Unregulated Contaminants	NELAP	2/9/2011
1,2,3-Trichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,2,4-Trichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	9/30/2020
1,2,4-Trimethylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,2-Dibromo-3-chloropropane (DBCP)	EPA 504.1	Synthetic Organic Contaminants	NELAP	7/1/2008
1,2-Dibromoethane (EDB, Ethylene dibromide)	EPA 504.1	Synthetic Organic Contaminants	NELAP	7/1/2008
1,2-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,2-Dichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,2-Dichloropropane	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,3,5-Trimethylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,3-Dichlorobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,3-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,4-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
2,2-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
2,4-D	EPA 515.4	Synthetic Organic Contaminants	NELAP	7/1/2008
2-Chlorotoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
3-Hydroxycarbofuran	EPA 531.1	Group I Unregulated Contaminants	NELAP	10/1/2013
4-Chlorotoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
Acidity, as CaCO3	SM 2310 B	Secondary Inorganic Contaminants	NELAP	10/1/2013
Alachlor	EPA 505	Synthetic Organic Contaminants	NELAP	7/1/2008
Aldicarb (Temik)	EPA 531.1	Group I Unregulated Contaminants	NELAP	10/1/2013
Aldicarb sulfone	EPA 531.1	Group I Unregulated Contaminants	NELAP	10/1/2013
Aldicarb sulfoxide	EPA 531.1	Group I Unregulated Contaminants	NELAP	10/1/2013
Aldrin	EPA 505	Group I Unregulated Contaminants	NELAP	7/1/2008
Alkalinity as CaCO3	SM 2320 B	Primary Inorganic Contaminants	NELAP	7/1/2008
Aluminum	EPA 200.7	Secondary Inorganic Contaminants	NELAP	7/1/2008
Aluminum	EPA 200.8	Secondary Inorganic Contaminants	NELAP	7/1/2008
Antimony	EPA 200.8	Primary Inorganic Contaminants	NELAP	7/1/2008

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022

Ron DeSantis
Governor



Laboratory Scope of Accreditation

Attachment to Certificate #: E83033-17, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83033

EPA Lab Code: FL01113

(407) 382-7733

E83033
Florida Radiochemistry Services, Inc.
5456 Hoffner Rd. Suite 201
Orlando, FL 32812

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Gross Alpha	EPA 900.0	Radiochemistry	NELAP	6/28/2001
Gross Beta	EPA 900.0	Radiochemistry	NELAP	6/28/2001
Radium-226	EPA 903.0	Radiochemistry	NELAP	12/15/2003
Radium-226	EPA 903.1	Radiochemistry	NELAP	6/28/2001
Radium-228	EPA Ra-05	Radiochemistry	NELAP	6/28/2001
Uranium (activity)	EPA 904.0	Radiochemistry	NELAP	6/28/2001

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079

Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174


Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
1,1,1,2-Tetrachloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,1,1-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,1,2,2-Tetrachloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,1,2-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,1-Dichloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,1-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,1-Dichloropropene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,2,3-Trichlorobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,2,3-Trichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,2,4-Trichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,2,4-Trimethylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,2-Dibromo-3-chloropropane (DBCP)	EPA 504.1	Synthetic Organic Contaminants	NELAP	1/8/2002
1,2-Dibromoethane (EDB, Ethylene dibromide)	EPA 504.1	Synthetic Organic Contaminants	NELAP	1/8/2002
1,2-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,2-Dichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,2-Dichloropropane	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,3,5-Trimethylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,3-Dichlorobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,3-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,4-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,4-Dioxane (1,4-Diethyleneoxide)	EPA 522	Group III Unregulated Contaminants	NELAP	1/17/2014
11-Chloroicosano-3-oxadecanoic-1-sulfonic Acid (11-CIPF30UdS)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
2-(N-Ethyl-perfluorooctane sulfonamido) acetic acid	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
2-(N-Methyl-perfluorooctane sulfonamido) acetic acid	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
2,2-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	12/10/2020
2,4,5-T	EPA 515.3	Synthetic Organic Contaminants	NELAP	10/14/2004
2,4-D	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
2,4-DB	EPA 515.3	Synthetic Organic Contaminants	NELAP	10/14/2004
2-Chlorotoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
3-Hydroxycarbofuran	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
3-Hydroxycarbofuran	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
4,8-Dioxo-3H-perfluorononanoic Acid (ADONA)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
4-Chlorotoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
9-Chlorohexadecafluoro-3-oxanonane-1-sulfonic Acid (9-CIPF30NS)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079 EPA Lab Code: FL01264 (386) 672-5668

E83079
Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Acetone	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/3/2012
Acifluorfen	EPA 515.3	Group I Unregulated Contaminants	NELAP	5/11/2004
Alachlor	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Aldicarb (Temik)	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Aldicarb (Temik)	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Aldicarb sulfone	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Aldicarb sulfone	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Aldicarb sulfoxide	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Aldicarb sulfoxide	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Aldrin	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Alkalinity as CaCO3	SM 2320 B	Primary Inorganic Contaminants	NELAP	1/8/2002
alpha-Chlordane	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Aluminum	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Aluminum	EPA 200.8	Secondary Inorganic Contaminants	NELAP	5/11/2004
Antimony	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Aroclor-1016 (PCB-1016)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1221 (PCB-1221)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1232 (PCB-1232)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1242 (PCB-1242)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1248 (PCB-1248)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1254 (PCB-1254)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1260 (PCB-1260)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Arsenic	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Atrazine	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Barium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Barium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Benazoxon	EPA 515.3	Synthetic Organic Contaminants	NELAP	10/14/2004
Benzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Benzo(a)pyrene	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Beryllium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Beryllium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Bromate	EPA 300.1	Primary Inorganic Contaminants	NELAP	5/11/2004
Bromide	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Bromide	EPA 300.1	Primary Inorganic Contaminants	NELAP	5/11/2004
Bromoacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Bromobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079
Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Bromochloroacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Bromochloromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Bromodichloromethane	EPA 524.2	Group II Unregulated Contaminants, Other Regulated Contaminants	NELAP	1/8/2002
Bromoform	EPA 524.2	Group II Unregulated Contaminants, Other Regulated Contaminants	NELAP	1/8/2002
Cadmium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Cadmium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Calcium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Carbaryl (Sevin)	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Carbaryl (Sevin)	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Carbofuran (Furadan)	EPA 531.1	Synthetic Organic Contaminants	NELAP	1/8/2002
Carbofuran (Furadan)	EPA 531.2	Synthetic Organic Contaminants	NELAP	4/26/2018
Carbon tetrachloride	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Chlorate	EPA 300.1	Primary Inorganic Contaminants	NELAP	5/11/2004
Chlordane (tech.)	EPA 505	Synthetic Organic Contaminants	NELAP	4/14/2020
Chloride	EPA 300.0	Secondary Inorganic Contaminants	NELAP	1/8/2002
Chlorine	SM 4500-Cl D	Primary Inorganic Contaminants	NELAP	1/8/2002
Chlorine dioxide, res. disinfectant	SM 4500-ClO2 D	Primary Inorganic Contaminants	NELAP	10/14/2004
Chlorite	EPA 300.1	Primary Inorganic Contaminants	NELAP	5/11/2004
Chloroacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Chlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Chloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Chloroform	EPA 524.2	Other Regulated Contaminants, Group II Unregulated Contaminants	NELAP	1/8/2002
Chromium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Chromium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Chromium VI	EPA 218.6	Primary Inorganic Contaminants	NELAP	12/12/2012
Chromium VI	EPA 218.7	Primary Inorganic Contaminants	NELAP	12/12/2012
cis-1,2-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
cis-1,3-Dichloropropene	EPA 524.2	Group II Unregulated Contaminants	NELAP	4/26/2018
Cobalt	EPA 200.8	Primary Inorganic Contaminants	NELAP	12/12/2012
Color	SM 2120 B	Secondary Inorganic Contaminants	NELAP	1/8/2002
Conductivity	SM 2510 B	Primary Inorganic Contaminants	NELAP	1/8/2002
Copper	EPA 200.7	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	1/8/2002

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079
Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Copper	EPA 200.8	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	5/11/2004
Corrosivity (langlier index)	SM 2330 B	Secondary Inorganic Contaminants	NELAP	1/8/2002
Cyanide	EPA 335.4	Primary Inorganic Contaminants	NELAP	1/8/2002
Dalapon	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
Di(2-ethylhexyl) phthalate (DEHP)	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Di(2-ethylhexyl)adipate	EPA 525.3	Synthetic Organic Contaminants	NELAP	5/21/2020
Dibromoacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Dibromochloromethane	EPA 524.2	Other Regulated Contaminants, Group II Unregulated Contaminants	NELAP	1/8/2002
Dibromomethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Dicamba	EPA 515.3	Group I Unregulated Contaminants	NELAP	5/11/2004
Dichloroacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Dichlorodifluoromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Dichloroprop (Dichlorprop)	EPA 515.3	Synthetic Organic Contaminants	NELAP	10/14/2004
Dieldrin	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Dinoseb (2-sec-butyl-4,6-dinitrophenol, DNBP)	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
Diquat	EPA 549.2	Synthetic Organic Contaminants	NELAP	1/8/2002
Dissolved organic carbon (DOC)	SM 5310 B	Primary Inorganic Contaminants	NELAP	1/3/2012
Endothall	EPA 548.1	Synthetic Organic Contaminants	NELAP	1/8/2002
Endrin	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Escherichia coli	COLISURE	Microbiology	NELAP	1/1/2011
Escherichia coli	SM 9223 B	Microbiology	NELAP	1/1/2011
Ethylbenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Fluoride	EPA 300.0	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	1/8/2002
gamma-BHC (Lindane, gamma-Hexachlorocyclohexane)	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
gamma-Chlordane	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Glyphosate	EPA 547	Synthetic Organic Contaminants	NELAP	1/8/2002
Hardness	SM 2340 B	Secondary Inorganic Contaminants	NELAP	8/14/2006
Hardness (calc.)	EPA 200.7	Secondary Inorganic Contaminants	NELAP	8/14/2006
Heptachlor	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Heptachlor epoxide	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Heterotrophic plate count	SIMPLATE	Microbiology	NELAP	3/15/2013
Hexachlorobenzene	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079
Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Hexachlorobutadiene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Hexachlorocyclopentadiene	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Hexafluoropropylene Oxide Dimer Acid (HFPO-DA, GenX)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Iron	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Isopropylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Lead	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
m+p-Xylenes	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/3/2012
Magnesium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Manganese	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Manganese	EPA 200.8	Secondary Inorganic Contaminants	NELAP	5/11/2004
Mercury	EPA 245.1	Primary Inorganic Contaminants	NELAP	1/8/2002
Methiocarb (Mesuro)	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Methiocarb (Mesuro)	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Methomyl (Lannate)	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Methomyl (Lannate)	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Methoxychlor	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Methyl bromide (Bromomethane)	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Methyl chloride (Chloromethane)	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Methyl tert-butyl ether (MTBE)	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Methylene chloride	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Metolachlor	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Metribuzin	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Molinate	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Naphthalene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
n-Butylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Nickel	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Nickel	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Nitrate	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Nitrate	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/8/2002
Nitrite	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Nitrite	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/8/2002
n-Propylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Odor	SM 2150 B	Secondary Inorganic Contaminants	NELAP	1/8/2002
Orthophosphate as P	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Orthophosphate as P	EPA 365.1	Primary Inorganic Contaminants	NELAP	1/8/2002
Oxamyl	EPA 531.1	Synthetic Organic Contaminants	NELAP	1/8/2002

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079

Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Oxamyl	EPA 531.2	Synthetic Organic Contaminants	NELAP	4/26/2018
o-Xylene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/3/2012
Paraquat	EPA 549.2	Synthetic Organic Contaminants	NELAP	3/10/2010
PCBs	EPA 505	Synthetic Organic Contaminants	NELAP	4/14/2020
Pentachlorophenol	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
Perfluorobutane Sulfonate (PFBS, Perfluorobutane Sulfonic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluorobutane Sulfonate (PFBS, Perfluorobutane Sulfonic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorodecanoate (PFDA, Perfluorodecanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorododecanoate (PFDoA, Perfluorododecanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluoroheptanoate (PFHpA, Perfluoroheptanoic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluoroheptanoate (PFHpA, Perfluoroheptanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorohexane Sulfonic Acid (PFHxS, Perfluorohexane Sulfonate)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluorohexane Sulfonic Acid (PFHxS, Perfluorohexane Sulfonate)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorohexanoate (PFHxA, Perfluorohexanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorononanoate (PFNA, Perfluorononanoic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluorononanoate (PFNA, Perfluorononanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorooctane sulfonate (PFOS, Perfluoro-octane Sulfonic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluorooctane Sulfonic Acid (PFOS, Perfluoro-octane-Sulfonate)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluoro-octanoate (PFOA, Perfluoro-octanoic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluoro-octanoate (PFOA, Perfluoro-octanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorotetradecanoate (PFTeDA, perfluorotetradecanoic acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorotridecanoate (PFTriA, perfluorotridecanoic acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluoroundecanoate (PFUnA, Perfluoroundecanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
pH	SM 4500-H ⁺ -B	Secondary Inorganic Contaminants	NELAP	2/19/2008
Picloram	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
p-Isopropyltoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Potassium	EPA 200.7	Secondary Inorganic Contaminants	NELAP	10/18/2004
Propachlor (Ramrod)	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079

Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Residue-filterable (TDS)	SM 2540 C	Secondary Inorganic Contaminants	NELAP	1/8/2002
sec-Butylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Selenium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Silica as SiO2	EPA 200.7	Primary Inorganic Contaminants	NELAP	12/12/2012
Silver	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Silver	EPA 200.8	Secondary Inorganic Contaminants	NELAP	5/11/2004
Silvex (2,4,5-TP)	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
Simazine	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Sodium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Strontium	PACE SOP S-FL-M-004 / ICP-MS	Secondary Inorganic Contaminants	NELAP	12/12/2012
Styrene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Sulfate	EPA 300.0	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	1/8/2002
Surfactants - MBAS	SM 5540 C	Secondary Inorganic Contaminants	NELAP	1/8/2002
tert-Butylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Tetrachloroethylene (Perchloroethylene)	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Thallium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Toluene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Total coliforms	COLISURE	Microbiology	NELAP	11/1/2011
Total coliforms	SM 9223 B	Microbiology	NELAP	11/1/2011
Total haloacetic acids (HAA5)	EPA 552.3	Synthetic Organic Contaminants	NELAP	7/1/2016
Total nitrate-nitrite	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Total nitrate-nitrite	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/8/2002
Total organic carbon	SM 5310 B	Primary Inorganic Contaminants	NELAP	1/8/2002
Total trihalomethanes	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Toxaphene (Chlorinated camphene)	EPA 505	Synthetic Organic Contaminants	NELAP	4/14/2020
trans-1,2-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
trans-1,3-Dichloropropene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Trichloroacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Trichloroethene (Trichloroethylene)	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Trichlorofluoromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Trifluralin (Treflan)	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Turbidity	EPA 180.1	Secondary Inorganic Contaminants	NELAP	1/8/2002
Uranium (mass)	EPA 200.8	Radiochemistry	NELAP	12/12/2012
Vinyl chloride	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Xylene (total)	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079 EPA Lab Code: FL01264 (386) 672-5668

E83079
Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Zinc	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Zinc	EPA 200.8	Secondary Inorganic Contaminants	NELAP	5/11/2004

Benchmark EnviroAnalytical, Inc.
 1711 Twelfth Street East
 Palmetto, FL 34221
 (941) 723-9986
 (941) 723-6061 fax
 WWW.Benchmarkea.com

Sample Receipt Temp. 3.4 °C
 Thermometer ID: 258
 pH < 2 Int. Ⓟ

Client: **Tri-Florida Water Treatment**
 226 E. Lake Ave.
 Aubundale FL 33823
 863-965-1439 / Fax: 863-965-2407
 Larry Scott: Cell 863-255-8165
 LARRYSCOTT_TRIFLORIDAWATER@hotmail.com

Project Name: Keen MH Subdivision Primary & Secondary Analysis
 PWS ID: 653-5235 Sample Type¹: G Sample Matrix²: DW

Laboratory Submission #: 21120660

Sample ID	Sb, As, Ba, Be, Cd, Cr, Pb, Hg, Ni, Se, Na, Tl Al, Cu, Fe, Mn, Ag, Zn	Radium 226 & 228 Combined Uranium	CN	VOCs	SOC's (Pesticides and PCB's)								MBAS (Foaming Agents)	Odor	Cl SO ₄ TDS Color/pH pH*** NO ₃ (100.0) NO ₃ -NO ₂ (Calc.) NO ₂ (100.0) Fluoride	Lab ID #
					Carbamates 531.2	Pesticides 505	EDB/DBCP 504.1	Herbicides 515.3	Semivolatiles 525.3	Glyphosate 547	Endothall 548.1	Diquat 549.2				
	1:4 HNO ₃ pH < 2	1:4 HNO ₃ pH < 2	NaOH pH > 9	NaThio 1:1 HCl	NaThio C ₄ H ₄ K ₂ O ₄	Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈	EDTA/Ascorbic Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈ H ₂ SO ₄ pH < 2	Plain	Plain	Plain	
	1 x 1 Quart Plastic	1 x 2 Quart Plastic	1 x 250mL Plastic	3 x 40mL Glass Vials**	2 x 40mL Glass Vials	3 x 1 Liter Glass	2 x 40mL Glass Vials	1 x 250mL Glass	3 x 1 Liter Glass	2 x 40mL Glass Vials	2 x 250mL Amber Glass	1 x 1 Liter Plastic	1 x 1 Quart Plastic	1 x 250mL Amber Glass	1 x 1 Quart Plastic	
POE	Date & Time: <u>12-9-21 / 1030</u>															

Field Chlorine: 1.5 Field pH: 7.2

* Add entire vial of HCl to each bottle. Add entire vial of H₂SO₄ to sample.

** Fill all 3 vials COMPLETELY, there can be NO AIR BUBBLES. Add 3 drops of HCl to each vial. *** pH Received after 15 minute hold time, ok to run.

1. "Sample Type" is used to indicate whether the sample was a grab (G) or whether it was a composite (C).
2. "Sample Matrix" is used to indicate whether the sample is being discharged to drinking water (DW), groundwater (GW), surface water (SW), soil, sediment (SDMNT), or sludge (SLDG).
3. "Container Type" is used to indicate whether the container is plastic (P) or glass (G).
4. Sample must be refrigerated or stored in wet ice after collection. The temperature during storage should be less than or equal to 6°C (42.8°F). Under "Preservative," list any preservatives that were added to the sample container.

Instructions:

1. Each bottle has a label identifying sample ID, premeasured preservative contained in the bottle, sample type, client ID, and parameters for analysis.
2. The following information should be added to each bottle label after collection with permanent black ink: date and time of collection, sampler's name or initials, and any field number or ID.
3. All bottles not containing preservative may be rinsed with appropriate sample prior to collection.
4. The client is responsible for documentation of the sampling event. Please note special sampling events on the sample custody form.

Laboratory Sample Acceptability
 pH < 2 Temperature: 3.4 °C
 BMF: 4.92

1	Collector: <u>Jessy Scott</u>	Date: <u>12-9-21</u>	Time: <u>1208</u>	Received By: <u>Lathane O</u>	Received By: <u>Lathane O</u>	Date: <u>12-9-21</u>	Time: <u>1208</u>
2	Relinquished By: <u>Lathane O</u>	Date: <u>12/9/21</u>	Time: <u>1210</u>	Received By: <u>[Signature]</u>	Received By: <u>[Signature]</u>	Date: <u>12/9/21</u>	Time: <u>1210</u>
3	Relinquished By: <u>[Signature]</u>	Date: <u>12/9/21</u>	Time: <u>1500</u>	Received By: <u>Annah Jensen</u>	Received By: <u>Annah Jensen</u>	Date: <u>12/09/21</u>	Time: <u>1505</u>
4	Relinquished By:	Date:	Time:	Received By:	Received By:	Date:	Time:
5	Relinquished By:	Date:	Time:	Received By:	Received By:	Date:	Time:

Benchmark Environmental, Inc.
 1711 17th Street East
 Palmetto, FL 34221
 (941) 723-9986
 (941) 723-6081 fax

Office QC Checks: _____
 Bottle Checks: _____



INTERLABORATORY SAMPLE TRANSMITTAL FORM

Date:	12/10/21		
# of Samples:	1	Total # of Bottles:	1
Method of Shipment:	Courier		
Subcontract Laboratory:	Florida Radiochemistry 5456 Holmes Ave. #201 Orlando, FL 32812 Phone: 407-382-7733 Fax: 407-382-7744		
Page	1	of	1

10 BUSINESS DAY T.A.T. PLEASE

Laboratory Submission #	Collection		Sample Matrix*	Collection Method**	Preservative	Container			Parameters	Field Conductivity $\mu\text{S/cm}$
	Date	Time				Qty	Capacity	Type***		
21120680-001	12/09/21	1030	DW	Grab	1% HNO ₃	1	2 Qt	P	Radium 226 & 228, Combined Uranium	

* Sample Matrix abbreviations: Groundwater (GW), Surface Water (SW), Saline Surface Water (SSW), Fresh Surface Water (FSW), Drinking Water (DW), Sludge (Sludge), Solid (Sol), Soil (Soil), Domestic Effluent (Dom Eff), Industrial Effluent (Ind Eff).
 ** Sample Method abbreviations: Grab (G), Composite (C), 24 Hour Composite (24HR Comp).
 *** Container Type abbreviations: Plastic (P), Glass (G).

Relinquished By: (Benchmark)	Sign Name:		Date:		Received By:		Date:	12/14/21
	Print Name:	Kara McGowan (Benchmark BA)	Time:				Time:	10:40
Relinquished By:	Sign Name:		Date:		Received By:		Date:	
	Print Name:		Time:				Time:	

INTERLABORATORY SAMPLE TRANSMITTAL FORM

Benchmark EnviroAnalytical, Inc.
 1711 12th Street East
 Palmetto, FL 34221
 (941) 723-9986
 (941) 723-6061 fax
 www.Benchmarkea.com



Date:		12/14/21	
# of Samples:	1	Total # of Bottles:	13
Method of Shipment:		Hand Delivery	
Subcontract Laboratory:		E83079 - Pace Analytical Service Inc; 8 East Tower Circle; Ormond Beach, FL 32175 Daniel Barrett; 1-800-966-5668	
Page		1	of 1

Laboratory Submission #	Collection		Sample Matrix*	Collection Method**	Preservative	Container			Parameters	Comments Sample verified to have no Chlorine at BEA
	Date	Time				Qty	Capacity	Type***		
21120660-001	12/09/21	1030	DW	Grab	NaThio C ₄ H ₅ K ₃ O ₇	2	40mL	G	Carbamates (531.2)	pH @ BEA = <u>4.0</u>
					Na ₂ SO ₄	3	40mL	G	Pesticides & PCBs (505)	
					Na ₂ S ₂ O ₃	1	250mL	G	Herbicides (515.3)	
					EDTA ASCORBIC KH ₂ CITRATE	3	1 L	G	Semivolatiles (525.3)	
					Na ₂ S ₂ O ₃	2	40inL	G	Glyphosate (547)	
					Na ₂ S ₂ O ₃	1	250mL	G	Endothall (548.1)	
					NaThio 1:4 H ₂ SO ₄ pH<	1	1 L	P	Diquat (549.2)	pH verified @ BEA
*Do NOT Dilute sample, Call Dale Dixon for OK first!										

Checked against COC & Method Requirements: Dale Dixon Lab. Director

* Sample Matrix abbreviations: Groundwater (GW), Surface Water (SW), Saline Surface Water (SSW), Fresh Surface Water (FSW), Drinking Water (DW), Sludge (Slgd), Solid (Sol), Soil (Soil), Domestic Effluent (Dom Eff), Industrial Effluent (Ind Eff).
 ** Sample Method abbreviations: Grab (G), Composite (C), 24 Hour Composite (24HR Comp).
 *** Container Type abbreviations: Plastic (P), Glass (G).

Relinquished By: (Benchmark)	Sign Name:	<i>N. Hadsell</i>	Date:	12-14-21	Received By:	<i>MSPACE</i>	Date:	12-14-21
	Print Name:	Nathan Hadsell (Benchmark EA)	Time:	12:50		Time:	1446	
Relinquished By:	Sign Name:	<i>MSPACE</i>	Date:	12-14-21	Received By:	<i>D.H. Pace</i>	Date:	15:00 12/14/21
	Print Name:		Time:			Time:	15130	

Hans Run 12/14/21 2138

#7

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

PUBLIC WATER SYSTEM INFORMATION

System Name: Paradise Island Subd PWS I.D. #: 653-1340

System Type (check one): Community Nontransient Noncommunity Transient Noncommunity

Address: 685 Dyson Rd

City: Haines City ZIP Code: _____

Phone # 863-422-8077 Fax #: _____ E-Mail Address: adunnahoe@aol.com

SAMPLE INFORMATION (to be completed by sampler)

Sample Number: 21120658-001 Sample Date: 12-8-21 Sample Time: 1030 AM PM (Circle One)

Sample Location (be specific): POE Location Code: _____

Disinfectant Residual (Required when reporting results for trihalomethanes and haloacetic acids): 1.5 mg/L Field pH: 7.2

Sample Type (Check Only One)

- Distribution
- Entry Point (to Distribution)
- Plant Tap (not for compliance with 62-550)
- Raw (at well or intake)
- Max Residence Time
- Ave Residence Time
- Near First Customer

Reason(s) for Sample (Check all that apply)

- Routine Compliance with 62-550
- Confirmation of MCL Exceedance
- Composite of Multiple Sites
- Other: _____
- Replacement (of Invalidated Sample)
- Special (not for compliance with 62-550)
- Clearance (permitting)

Sampling Procedure Used or Other Comments: _____

SAMPLER CERTIFICATION

I, Larry Scott, Operator, do HEREBY CERTIFY

(Print Name)

(Print Title)

that the above public water system and sample collection information is complete and correct.

Signature: Larry Scott

Date: 1-28-22

Certified Operator #: _____ Phone #: _____

Sampler's Fax #: _____

Sampler's E-mail: _____

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

LABORATORY CERTIFICATION INFORMATION (to be completed by lab – please type or print legibly)

Lab Name: Benchmark EnviroAnalytical, Inc Florida DOH Certification #: E84167 Certification Expiration Date: 06/30/2022

Address: 1711 12th Street East, Palmetto, FL 34221

ATTACH CURRENT DOH ANALYTE SHEET*

Phone #: 941-723-9986

Were any analyses subcontracted? Yes No If yes, please provide DOH certification number(s): E83079, E83033, E84567, E87610

ATTACH DOH ANALYTE SHEET FOR EACH SUBCONTRACTED LAB*

ANALYSIS INFORMATION (to be completed by lab)

Date Sample(s) Received: 12/09/2021

PWS ID (From Page 1): 653-1340 Sample Number (From Page 1): _____ Lab Assigned Report # or Job ID: 21120658-001

Group(s) Analyzed & Results attached for compliance with Chapter 62-550, F.A.C. (Check all that apply):

Inorganics

- All Except Asbestos
- Partial
- Nitrate
- Nitrite
- Asbestos

Synthetic Organics

- All 30
- All Except Dioxin
- Partial
- Dioxin Only

Volatile Organics

- All 21
- Partial

Disinfection Byproducts

- Trihalomethanes
- Haloacetic Acids
- Chlorite
- Bromate

Radionuclides

- Single Sample
- Qtrly Composite**

Secondaries

- All 14
- Partial

Others

- NOX

LAB CERTIFICATION

I, Dale D. Dixon / Tulay Tanrisever / Kara Peterson, Lab Director / Technical Director & QC Officer / QA Officer, do HEREBY CERTIFY
(Print Name) (Print Title)

that all attached analytical data are correct and unless noted meet all requirements of the National Environmental Laboratory Accreditation Conference (NELAC).

Signature:  Date: 1/26/2022

* Failure to provide a valid and current Florida DOH lab certification number and a current Analyte Sheet for the attached analysis results will result in rejection of the report, possible enforcement against the public water system for failure to sample, and may result in notification of the DOH Bureau of Laboratory Services.
** Please provide radiological sample dates & locations for each quarter.

CONFIRMATION & NOTIFICATION IS REQUIRED WITHIN 24 HRS FOR NITRATE OR NITRITE MCL EXCEEDANCES
NON-DETECTS ARE TO BE REPORTED AS THE MDL WITH A "U" QUALIFIER. (Non-detects reported as "BDL" or with a "<" are not acceptable.)

COMPLIANCE DETERMINATION (to be completed by DEP or DOH -- attach notes as necessary)

Sample Collection & Analysis Satisfactory: Yes No _____ Replacement Sample or Report Requested (circle or highlight group(s) above)

Person Notified: _____ Date Notified: _____ DEP/DOH Reviewing Official: _____

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

INORGANIC CONTAMINANTS
62-550.310(1)

Report Number / Job ID: 21120658-001

PWS ID (From Page 1): 653-1340

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	Analysis Date	Analysis Time	DOH Lab Certification #
1040	Nitrate (as N)	10	mg/L	0.020	U	300.0	0.020	12/9/2021	21:44	E84167
1041	Nitrite (as N)	1	mg/L	0.020	U	300.0	0.020	12/9/2021	21:44	E84167
1005	Arsenic	0.010	mg/L	0.00069	U	SM3113B	0.00069	12/13/2021	17:34	E84167
1010	Barium	2	mg/L	0.015		200.7	0.002	12/13/2021	16:23	E84167
1015	Cadmium	0.005	mg/L	0.0009	U	200.7	0.0009	12/13/2021	16:23	E84167
1020	Chromium	0.1	mg/L	0.002	U	200.7	0.002	12/13/2021	16:23	E84167
1024	Cyanide	0.2	mg/L	0.005	U	335.4	0.005	12/14/2021	11:56	E84167
1025	Fluoride	4.0	mg/L	0.209		300.0	0.030	12/18/2021	11:38	E84167
1030	Lead	0.015	mg/L	0.001	I	SM3113B	0.00067	12/13/2021	14:00	E84167
1035	Mercury	0.002	mg/L	0.000198	U	245.1	0.000198	12/22/2021	15:01	E84167
1036	Nickel	0.1	mg/L	0.00118	U	200.7	0.00118	12/13/2021	16:23	E84167
1045	Selenium	0.05	mg/L	0.00091	U	200.8	0.00091	1/19/2022	15:36	E87610
1052	Sodium	160	mg/L	13.0		200.7	0.034	12/13/2021	16:23	E84167
1074	Antimony	0.006	mg/L	0.00226	U	SM3113B	0.00226	1/10/2022	18:01	E84167
1075	Beryllium	0.004	mg/L	0.000078	U	200.7	0.000078	12/13/2021	16:23	E84167
1085	Thallium	0.002	mg/L	0.000981	U	200.9	0.000981	12/21/2021	15:26	E84167
1094	Asbestos	7 MFL	MFL							E

*Results must be reported with appropriate qualifiers in accordance with Florida Administrative Code Rule 62-160, Table 1. Results qualified with A, F, H, N, O, T, Z, ?, *, are unacceptable for compliance with 62-550. Results qualified with a J, Q, R, or Y must be accompanied by written justification and will be evaluated on a case by case basis. To avoid a monitoring violation, unacceptable results must be replaced with acceptable results from samples collected during the same monitoring period.

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

SECONDARY CONTAMINANTS
62-550.320

Report Number / Job ID: 21120658-001

PWS ID (From Page 1): 653-1340

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	Analysis Date	Analysis Time	DOH Lab Certification #
1002	Aluminum	0.2	mg/L	0.023	I	200.7	0.023	12/13/2021	16:23	E84167
1017	Chloride	250	mg/L	16.1		300.0	0.353	12/14/2021	01:26	E84167
1022	Copper	1	mg/L	0.024		200.7	0.004	12/13/2021	16:23	E84167
1025	Fluoride	2.0	mg/L	0.209		300.0	0.030	12/18/2022	11:38	E84167
1028	Iron	0.3	mg/L	0.049	I	200.7	0.029	12/13/2021	16:23	E84167
1032	Manganese	0.05	mg/L	0.003	I	200.7	0.00098	12/13/2021	16:23	E84167
1050	Silver	0.1	mg/L	0.0005	U	200.7	0.0005	12/13/2021	16:23	E84167
1055	Sulfate	250	mg/L	1.56		300.0	0.339	12/14/2021	01:26	E84167
1095	Zinc	5	mg/L	0.026		200.7	0.0014	12/13/2021	16:23	E84167
1905	Color	15	CU	2.5	U	SM2120B	2.5	12/9/2021	17:18	E84167
1920	Odor	3	TON	1	U	140.1	1	12/9/2021	09:46	E84567
1925	pH (field pH from page 1)	6.5 - 8.5		6.96	Q	SM4500H+B		12/9/2021	16:45	E84167
1930	Total Dissolved Solids	500	mg/L	204	Q	SM2540C	7.26	12/16/2021	13:40	E84167
2905	Foaming Agents	0.5	mg/L	0.03	U	SM5540C	0.03	12/10/2021	09:47	E84167

*Results must be reported with appropriate qualifiers in accordance with Florida Administrative Code Rule 62-160, Table 1. Results qualified with A, F, H, N, O, T, Z, ?, *, are unacceptable for compliance with 62-550. Results qualified with a J, Q, R, or Y must be accompanied by written justification and will be evaluated on a case by case basis. To avoid a monitoring violation, unacceptable results must be replaced with acceptable results from samples collected during the same monitoring period.

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

RADIONUCLIDES
62-550.310(6)

Report Number / Job ID: 21120658-001

PWS ID (From Page 1): 653-1340

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	RDL	Analysis Error	Analysis Date	Analysis Time	DOH Lab Certification #
4000	Gross Alpha (Excl Uranium)	15	pCi/L	**				3				
4002	Gross Alpha (Incl Uranium)	***	pCi/L	1.5	U	900.0	1.5	3	1.5	12/17/2022	06:43	E83033
4006	Combined Uranium**** (U-234, U-235, & U-238)	20	pCi/L	0.3	U	908.0	0.3	.67	0.3	12/29/2022	07:32	E83033
		30	µg/L					1				
4020	Radium-226	5	pCi/L	0.4		903.1	0.2	1	0.2	12/23/2022	10:02	E83033
4030	Radium-228			0.5	U	Ra-05	0.5	1	0.5	12/22/2022	08:33	E83033

- ** If the result exceeds 5 pCi/L, a measurement for radium-226 is required. Uranium is reported separately under Contam ID 4006.
- *** If the results exceed 5 pCi/L, a measurement for radium-226 is required. If the results exceed 15 pCi/L, a measurement for Combined Uranium must be reported separately. The DEP/DOH will subtract the U value from the Gross Alpha (ID 4002) to determine compliance with MCL for Gross Alpha (Excl. U) of 15pCi/L. If the result for ID 4002 Gross Alpha (Including Uranium) does not exceed 15pCi/L, Combined Uranium need not be measured nor reported.
- **** If using Uranium testing methods ASTM D5174 or EPA 200.8 only, then Analysis Error need not be reported.

**Florida Department of Environmental Protection
Safe Drinking Water Program Laboratory Reporting Format**

VOLATILE ORGANICS
62-550.310(4)(a)

Report Number / Job ID: 21120658-001

PWS ID (From Page 1): 653-1340

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	RDL	Analysis Date	Analysis Time	DOH Lab Certification #
2378	1,2,4-Trichlorobenzene	70	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2380	cis-1,2-Dichloroethylene	70	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2955	Xylenes (total)	10,000	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2964	Dichloromethane	5	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2968	o-Dichlorobenzene	600	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2969	para-Dichlorobenzene	75	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2976	Vinyl Chloride	1	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2977	1,1-Dichloroethylene	7	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2979	trans-1,2-Dichloroethylene	100	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2980	1,2-Dichloroethane	3	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2981	1,1,1-Trichloroethane	200	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2982	Carbon tetrachloride	3	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2983	1,2-Dichloropropane	5	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2984	Trichloroethylene	3	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2985	1,1,2-Trichloroethane	5	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2987	Tetrachloroethylene	3	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2989	Monochlorobenzene	100	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2990	Benzene	1	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2991	Toluene	1,000	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2992	Ethylbenzene	700	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167
2996	Styrene	100	µg/L	0.5	U	524.2	0.5	0.5	12/15/2021	23:26	E84167

NOTE: Results indicating non-detection with a reported lab MDL > .5 µg/L will not be accepted for compliance.

**Florida Department of Environmental Protection
Safe Drinking Water Program Laboratory Reporting Format**

SYNTHETIC ORGANICS
62-550.310(4)(b)

Report Number / Job ID: 21120658-001 PWS ID (from Page 1): 653-1340

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier *	Analytical Method	Lab MDL	RDL	Extraction Date	Analysis Date	Analysis Time	DOH Lab Certification #
2005	Endrin	2	µg/L	0.0023	U	525.3	0.0023	0.01	12/22/2021	12/27/2021	09:58	E83079
2010	Lindane	0.2	µg/L	0.0027	U	525.3	0.0027	0.02	12/22/2021	12/27/2021	09:58	E83079
2015	Methoxychlor	40	µg/L	0.0230	U	525.3	0.0230	0.1	12/22/2021	12/27/2021	09:58	E83079
2020	Toxaphene	3	µg/L	0.7100	U	505	0.7100	1	12/20/2021	12/21/2021	11:25	E83079
2031	Dalapon	200	µg/L	0.4900	U	515.3	0.4900	1	12/16/2021	12/17/2021	23:38	E83079
2032	Diquat	20	µg/L	0.1600	U	549.2	0.1600	0.4	12/15/2021	12/16/2021	17:49	E83079
2033	Endothall	100	µg/L					9				
2034	Glyphosate	700	µg/L	4.2000	U	547	4.2000	6	12/15/2021	12/15/2021	23:30	E83079
2035	Di(2-ethylhexyl)adipate	400	µg/L	0.3600	U	525.3	0.3600	0.6	12/22/2021	12/27/2021	09:58	E83079
2036	Oxamyl (Vydate)	200	µg/L	0.4600	U	531.2	0.4600	2	12/16/2021	12/16/2021	23:28	E83079
2037	Simazine	4	µg/L	0.0400	U	525.3	0.0400	0.07	12/22/2021	12/27/2021	09:58	E83079
2039	Di(2-ethylhexyl)phthalate	6	µg/L	0.4600	U	525.3	0.4600	2.2	12/22/2021	12/27/2021	09:58	E83079
2040	Picloram	500	µg/L	0.0400	U	515.3	0.0400	0.1	12/16/2021	12/17/2021	23:38	E83079
2041	Dinoseb	7	µg/L	0.1600	U	515.3	0.1600	0.2	12/16/2021	12/17/2021	23:38	E83079
2042	Hexachlorocyclopentadinene	50	µg/L	0.0240	U	525.3	0.0240	0.1	12/22/2021	12/27/2021	09:58	E83079
2046	Carbofuran	40	µg/L	0.5900	U	531.2	0.5900	0.9	12/16/2021	12/16/2021	23:28	E83079
2050	Atrazine	3	µg/L	0.0140	U	525.3	0.0140	0.1	12/22/2021	12/27/2021	09:58	E83079
2051	Alachlor	2	µg/L	0.0290	U	525.3	0.0290	0.2	12/22/2021	12/27/2021	09:58	E83079
2063	2,3,7,8-TCDD (Dioxin)	0.03	ng/L					0.005				
2065	Heptachlor	0.4	µg/L	0.0140	U	525.3	0.0140	0.04	12/22/2021	12/27/2021	09:58	E83079
2067	Heptachlor Epoxide	0.2	µg/L	0.0030	U	525.3	0.0030	0.02	12/22/2021	12/27/2021	09:58	E83079
2105	2,4-D	70	µg/L	0.0960	U	515.3	0.0960	0.1	12/16/2021	12/17/2021	23:38	E83079
2110	2,4,5-TP (Silvex)	50	µg/L	0.0530	U	515.3	0.0530	0.2	12/16/2021	12/17/2021	23:38	E83079
2274	Hexachlorobenzene	1	µg/L	0.0140	U	525.3	0.0140	0.1	12/22/2021	12/27/2021	09:58	E83079
2306	Benzo(a)pyrene	0.2	µg/L	0.0190	U	525.3	0.0190	0.02	12/22/2021	12/27/2021	09:58	E83079
2326	Pentachlorophenol	1	µg/L	0.0140	U	515.3	0.0140	0.04	12/16/2021	12/17/2021	23:38	E83079
2383	Polychlorinated biphenyls (PCBs)	0.5	µg/L	0.0460	U	505	0.0460	0.1	12/20/2021	12/21/2021	11:25	E83079
2931	Dibromochloropropane	0.2	µg/L	0.014	U	504.1	0.014	0.02	12/13/2021	12/13/2021	13:40	E84167
2946	Ethylene Dibromide (EDB)	0.02	µg/L	0.01	U	504.1	0.01	0.01	12/13/2021	12/13/2021	13:40	E84167
2959	Chlordane	2	µg/L	0.0370	U	505	0.0370	0.2	12/20/2021	12/21/2021	11:25	E83079

NOTE: Results indicating non-detection with a reported lab MDL >50% of the MCL will not be accepted for compliance.

Reporting Format 62-550.730
Effective January 1995, Revised December 2012

*Results must be reported with appropriate qualifiers in accordance with Florida Administrative Code Rule 62-160, Table 1. Results qualified with A, F, H, N, O, T, Z, ?, *, are unacceptable for compliance with 62-550. Results qualified with a J, Q, R, or Y must be accompanied by written justification and will be evaluated on a case by case basis. To avoid a monitoring violation, unacceptable results must be replaced with acceptable results from samples collected during the same monitoring period.

Florida Department of Environmental Protection Safe Drinking Water Program Laboratory Reporting Format

OTHER CONTAMINANTS

Report Number / Job ID: 21120658-001

PWS ID (From Page 1): 653-1340

Contam ID	Contam Name	MCL	Units	Analysis Result	Qualifier*	Analytical Method	Lab MDL	Analysis Date	Analysis Time	DOH Lab Certification #
1038	NITRATE+NITRITE AS N	10	MG/L	0.020	U	300.0	0.020	12/9/2021	21:44	E84167
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E
										E

*Results must be reported with appropriate qualifiers in accordance with Florida Administrative Code Rule 62-160, Table 1. Results qualified with A, F, H, N, O, T, Z, ?, *, are unacceptable for compliance with 62-550. Results qualified with a J, Q, R, or Y must be accompanied by written justification and will be evaluated on a case by case basis. To avoid a monitoring violation, unacceptable results must be replaced with acceptable results from samples collected during the same monitoring period.

DATA QUALIFIERS THAT MAY APPLY:

- B = Results based upon colony counts outside the ideal range.
- G1 = Accuracy standard does not meet method control limits but does meet lab control limits that are in agreement with USEPA generated data. USEPA letter available upon request.
- G2 = Accuracy standard exceeds acceptable control limits. Duplicate and spike values are within control limits. Reported data are usable.
- G3 = Precision measurement exceeded acceptable control limits. Standard and spike values are within control limits. Reported data are usable.
- G4 = Spike recovery exceeds acceptable control limits. Standard and duplicate values are within control limits. Reported data are usable.
- I = Reported value is between the laboratory MDL and the PQL.
- J3 = Estimated value. Quality control criteria for precision and accuracy not met.
- J4 = Estimated value. Sample matrix interference suspected.
- J6 = Estimated value. SM5210B test replicates show more than 30% difference between high and low values, indicating potential presence of toxicity within the sample.
- K = Off-scale low. Value is known to be < the value reported.
- L = Off scale high; reported concentration exceeds the highest standard.
- ND = Not Detected at or above adjusted reporting limit.
- Q = Sample held beyond accepted hold time.
- U = Analyte analyzed but not detected at the value indicated.
- V = Analyte detected in sample and method blank. Results for this analyte in associated samples may be biased high. Standard, Duplicate and Spike values are within control limits. Reported data are usable.
- X = Value exceed MCL.
- Y = Analysis performed on an improperly preserved sample. Data may be inaccurate
- Z = Too many colonies were present (TNTC). The numeric value represents the filtration volume



Laboratory Scope of Accreditation

Attachment to Certificate #: E84167-52, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E84167

EPA Lab Code: FL00289

(941) 723-9986

E84167
Benchmark EnviroAnalytical, Inc.
1711 12th Street East
Palmetto, FL 34221

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
1,1,1-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,1,2-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,1-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,2,4-Trichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,2-Dibromo-3-chloropropane (DBCP)	EPA 504.1	Synthetic Organic Contaminants	NELAP	4/20/2009
1,2-Dibromoethane (EDB, Ethylene dibromide)	EPA 504.1	Synthetic Organic Contaminants	NELAP	4/20/2009
1,2-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
1,2-Dichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,2-Dichloropropane	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
1,4-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Alkalinity as CaCO ₃	SM 2320 B	Primary Inorganic Contaminants	NELAP	5/25/2004
Aluminum	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004
Ammonia as N	EPA 350.1	Primary Inorganic Contaminants	NELAP	3/7/2011
Antimony	SM 3113 B	Primary Inorganic Contaminants	NELAP	1/3/2002
Arsenic	SM 3113 B	Primary Inorganic Contaminants	NELAP	1/3/2002
Barium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Benzene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Beryllium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Boron	EPA 200.7	Secondary Inorganic Contaminants	NELAP	3/7/2011
Bromate	EPA 300.1	Primary Inorganic Contaminants	NELAP	11/21/2008
Bromide	EPA 300.0	Primary Inorganic Contaminants	NELAP	5/25/2004
Bromoacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	4/20/2009
Bromodichloromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	9/28/2005
Bromoform	EPA 524.2	Group II Unregulated Contaminants	NELAP	9/28/2005
Cadmium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Calcium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Carbon tetrachloride	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Chlorate	EPA 300.1	Secondary Inorganic Contaminants	NELAP	11/21/2008
Chloride	EPA 300.0	Secondary Inorganic Contaminants	NELAP	5/25/2004
Chlorine	SM 4500-Cl G	Primary Inorganic Contaminants	NELAP	3/7/2011
Chlorite	EPA 300.1	Primary Inorganic Contaminants	NELAP	11/21/2008
Chloroacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	4/20/2009
Chlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Chloroform	EPA 524.2	Group II Unregulated Contaminants	NELAP	9/28/2005
Chromium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
cis-1,2-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E84167-52, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E84167

EPA Lab Code:

FL00289

(941) 723-9986

E84167

Benchmark EnviroAnalytical, Inc.
1711 12th Street East
Palmetto, FL 34221

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Color	SM 2120 B	Secondary Inorganic Contaminants	NELAP	7/31/2007
Conductivity	SM-2510 B	Primary Inorganic Contaminants	NELAP	5/25/2004
Copper	EPA 200.7	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	5/25/2004
Corrosivity (Langier index)	SM 2330 B	Secondary Inorganic Contaminants	NELAP	3/7/2011
Cyanide	EPA 335.4	Primary Inorganic Contaminants	NELAP	1/7/2021
Dibromoacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	4/20/2009
Dibromochloromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	9/28/2005
Dichloroacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	4/20/2009
Dissolved organic carbon (DOC)	SM 5310 B	Primary Inorganic Contaminants	NELAP	11/21/2008
Escherichia coli	SM 9223 B	Microbiology	NELAP	1/3/2002
Escherichia coli	SM 9223 B /QUANTI-TRAY	Microbiology	NELAP	3/7/2011
Ethylbenzene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Fluoride	EPA 300.0	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	5/25/2004
Hardness	SM 2340 B	Secondary Inorganic Contaminants	NELAP	3/7/2011
Heterotrophic plate count	SIMPLATE	Microbiology	NELAP	7/1/2016
Heterotrophic plate count	SM 9215 B	Microbiology	NELAP	5/25/2004
Hydrogen sulfide	SM 4500S-H (21st ed.)	Primary Inorganic Contaminants	NELAP	3/7/2011
Iron	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004
Lead	SM 3113 B	Primary Inorganic Contaminants	NELAP	1/3/2002
Magnesium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Manganese	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004
Mercury	EPA 245.1	Primary Inorganic Contaminants	NELAP	1/3/2002
Methylene chloride	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Molybdenum	EPA 200.7	Secondary Inorganic Contaminants	NELAP	3/7/2011
Nickel	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Nitrate	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/3/2002
Nitrate as N	EPA 300.0	Primary Inorganic Contaminants	NELAP	5/25/2004
Nitrite as N	EPA 300.0	Primary Inorganic Contaminants	NELAP	5/25/2004
Nitrite as N	EPA 353.2	Primary Inorganic Contaminants	NELAP	5/25/2004
Odor	EPA 140.1	Secondary Inorganic Contaminants	NELAP	1/3/2002
Orthophosphate as P	EPA 300.0	Primary Inorganic Contaminants	NELAP	3/7/2011
pH	SM 4500-H+B	Secondary Inorganic Contaminants	NELAP	7/31/2007
Potassium	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E84167-52, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E84167

EPA Lab Code: FL00289

(941) 723-9986

E84167

Benchmark EnviroAnalytical, Inc.

1711 12th Street East

Palmetto, FL 34221

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Residue-filterable (TDS)	SM 2540 C	Secondary Inorganic Contaminants	NELAP	7/31/2007
Selenium	SM 3113 B	Primary Inorganic Contaminants	NELAP	1/3/2002
Silica as SiO2	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Silver	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004
Sodium	EPA 200.7	Primary Inorganic Contaminants	NELAP	5/25/2004
Styrene	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Sulfate	EPA 300.0	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	5/25/2004
Sulfide	SM 4500-S D/UV-VIS	Primary Inorganic Contaminants	NELAP	3/7/2011
Surfactants - MBAS	SM 5540 C	Secondary Inorganic Contaminants	NELAP	1/3/2002
Tetrachloroethylene (Perchloroethylene)	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Thallium	EPA 200.9	Primary Inorganic Contaminants	NELAP	1/3/2002
Toluene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Total coliforms	SM 9223 B	Microbiology	NELAP	1/3/2002
Total coliforms	SM 9223 B /QUANTI-TRAY	Microbiology	NELAP	3/7/2011
Total cyanide	EPA 335.4	Primary Inorganic Contaminants	NELAP	1/7/2021
Total haloacetic acids (HAA5)	EPA 552.2	Synthetic Organic Contaminants	NELAP	4/20/2009
Total nitrate-nitrite	EPA 300.0	Primary Inorganic Contaminants	NELAP	5/25/2004
Total nitrate-nitrite	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/3/2002
Total organic carbon	SM 5310 B	Primary Inorganic Contaminants	NELAP	5/25/2004
Total trihalomethanes	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
trans-1,2-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Trichloroacetic acid	EPA 552.2	Group I Unregulated Contaminants	NELAP	10/14/2010
Trichloroethene (Trichloroethylene)	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Turbidity	EPA 180.1	Secondary Inorganic Contaminants	NELAP	3/7/2011
UV 254	SM 5910 B	Primary Inorganic Contaminants	NELAP	11/16/2016
Vanadium	EPA 200.7	Secondary Inorganic Contaminants	NELAP	3/7/2011
Vinyl chloride	EPA 524.2	Other Regulated Contaminants	NELAP	9/28/2005
Xylene (total)	EPA 524.2	Other Regulated Contaminants	NELAP	12/29/2015
Zinc	EPA 200.7	Secondary Inorganic Contaminants	NELAP	5/25/2004

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E84567-33, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E84567

EPA Lab Code: FL01095

(863) 656-2020

E84567

Benchmark Mid Florida Laboratory

1153 First Street South

Winter Haven, FL 33880

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Escherichia coli	SM 9222 G	Microbiology	NELAP	10/25/2017
Escherichia coli	SM 9223 B	Microbiology	NELAP	3/18/2011
Escherichia coli	SM 9223 B /QUANTI-TRAY	Microbiology	NELAP	8/26/2020
Heterotrophic plate count	SM 9215 B	Microbiology	NELAP	8/26/2020
Odor	EPA 140.1	Secondary Inorganic Contaminants	NELAP	8/31/2020
pH	SM 4500-H ⁺ -B	Primary Inorganic Contaminants	NELAP	8/31/2020
Total coliforms	SM 9222 B	Microbiology	NELAP	11/21/2001
Total coliforms	SM 9223 B	Microbiology	NELAP	11/21/2001
Total coliforms	SM 9223 B /QUANTI-TRAY	Microbiology	NELAP	8/26/2020

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E87610-42, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E87610 EPA Lab Code: NC01152 (919) 467-3090

E87610
Environmental Conservation Laboratories, Inc. - Cary
102A Woodwinds Industrial Court
Cary, NC 27511

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
1,1,1,2-Tetrachloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,1,1-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,1,2,2-Tetrachloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,1,2-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,1-Dichloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,1-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,1-Dichloropropene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,2,3-Trichlorobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,2,3-Trichloropropane	EPA 504.1	Group II Unregulated Contaminants	NELAP	2/9/2011
1,2,3-Trichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,2,4-Trichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	9/30/2020
1,2,4-Trimethylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,2-Dibromo-3-chloropropane (DBCP)	EPA 504.1	Synthetic Organic Contaminants	NELAP	7/1/2008
1,2-Dibromoethane (EDB, Ethylene dibromide)	EPA 504.1	Synthetic Organic Contaminants	NELAP	7/1/2008
1,2-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,2-Dichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,2-Dichloropropane	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
1,3,5-Trimethylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,3-Dichlorobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,3-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
1,4-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	7/1/2008
2,2-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
2,4-D	EPA 515.4	Synthetic Organic Contaminants	NELAP	7/1/2008
2-Chlorotoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
3-Hydroxycarbofuran	EPA 531.1	Group I Unregulated Contaminants	NELAP	10/1/2013
4-Chlorotoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	7/1/2008
Acidity, as CaCO3	SM 2310 B	Secondary Inorganic Contaminants	NELAP	10/1/2013
Alachlor	EPA 505	Synthetic Organic Contaminants	NELAP	7/1/2008
Aldicarb (Temik)	EPA 531.1	Group I Unregulated Contaminants	NELAP	10/1/2013
Aldicarb sulfone	EPA 531.1	Group I Unregulated Contaminants	NELAP	10/1/2013
Aldicarb sulfoxide	EPA 531.1	Group I Unregulated Contaminants	NELAP	10/1/2013
Aldrin	EPA 505	Group I Unregulated Contaminants	NELAP	7/1/2008
Alkalinity as CaCO3	SM 2320 B	Primary Inorganic Contaminants	NELAP	7/1/2008
Aluminum	EPA 200.7	Secondary Inorganic Contaminants	NELAP	7/1/2008
Aluminum	EPA 200.8	Secondary Inorganic Contaminants	NELAP	7/1/2008
Antimony	EPA 200.8	Primary Inorganic Contaminants	NELAP	7/1/2008

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022

Ron DeSantis
Governor



Laboratory Scope of Accreditation

Page 1 of 2

Attachment to Certificate #: E83033-17, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83033

EPA Lab Code: FL01113

(407) 382-7733

E83033

Florida Radiochemistry Services, Inc.
5456 Hoffner Rd. Suite 201
Orlando, FL 32812

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Gross Alpha	EPA 900.0	Radiochemistry	NELAP	6/28/2001
Gross Beta	EPA 900.0	Radiochemistry	NELAP	6/28/2001
Radium-226	EPA 903.0	Radiochemistry	NELAP	12/15/2003
Radium-226	EPA 903.1	Radiochemistry	NELAP	6/28/2001
Radium-228	EPA Ra-05	Radiochemistry	NELAP	6/28/2001
Uranium (activity)	EPA 908.0	Radiochemistry	NELAP	6/28/2001

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079

Pace Analytical Services, LLC - Ormond Beach FL

8 East Tower Circle

Ormond Beach, FL 32174


Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
1,1,1,2-Tetrachloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,1,1-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,1,2,2-Tetrachloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,1,2-Trichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,1-Dichloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,1-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,1-Dichloropropene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,2,3-Trichlorobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,2,3-Trichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,2,4-Trichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,2,4-Trimethylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,2-Dibromo-3-chloropropane (DBCP)	EPA 504.1	Synthetic Organic Contaminants	NELAP	1/8/2002
1,2-Dibromoethane (EDB, Ethylene dibromide)	EPA 504.1	Synthetic Organic Contaminants	NELAP	1/8/2002
1,2-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,2-Dichloroethane	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,2-Dichloropropane	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,3,5-Trimethylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,3-Dichlorobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,3-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
1,4-Dichlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
1,4-Dioxane (1,4-Diethyleneoxide)	EPA 522	Group III Unregulated Contaminants	NELAP	1/17/2014
11-Chloroicosano-3-oxaundecanoic-1-sulfonic Acid (11-CIPF30UdS)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
2-(N-Ethyl-perfluorooctane sulfonamido) acetic acid	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
2-(N-Methyl-perfluorooctane sulfonamido) acetic acid	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
2,2-Dichloropropane	EPA 524.2	Group II Unregulated Contaminants	NELAP	12/10/2020
2,4,5-T	EPA 515.3	Synthetic Organic Contaminants	NELAP	10/14/2004
2,4-D	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
2,4-DB	EPA 515.3	Synthetic Organic Contaminants	NELAP	10/14/2004
2-Chlorotoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
3-Hydroxycarbofuran	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
3-Hydroxycarbofuran	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
4,8-Dioxo-3H-perfluorononanoic Acid (ADONA)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
4-Chlorotoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
9-Chlorohexadecafluoro-3-oxanonanoic-1-sulfonic Acid (9-CIPF30NS)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079

Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Acetone	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/3/2012
Acifluorfen	EPA 515.3	Group I Unregulated Contaminants	NELAP	5/11/2004
Alachlor	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Aldicarb (Temik)	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Aldicarb (Temik)	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Aldicarb sulfone	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Aldicarb sulfone	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Aldicarb sulfoxide	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Aldicarb sulfoxide	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Aldrin	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Alkalinity as CaCO3	SM 2320 B	Primary Inorganic Contaminants	NELAP	1/8/2002
alpha-Chlordane	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Aluminum	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Aluminum	EPA 200.8	Secondary Inorganic Contaminants	NELAP	5/11/2004
Antimony	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Aroclor-1016 (PCB-1016)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1221 (PCB-1221)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1232 (PCB-1232)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1242 (PCB-1242)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1248 (PCB-1248)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1254 (PCB-1254)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Aroclor-1260 (PCB-1260)	EPA 505	Group I Unregulated Contaminants	NELAP	4/14/2020
Arsenic	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Atrazine	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Barium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Barium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Bentazone	EPA 515.3	Synthetic Organic Contaminants	NELAP	10/14/2004
Benzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Benzo(a)pyrene	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Beryllium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Beryllium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Bromate	EPA 300.1	Primary Inorganic Contaminants	NELAP	5/11/2004
Bromide	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Bromide	EPA 300.1	Primary Inorganic Contaminants	NELAP	5/11/2004
Bromoacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Bromobenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079
Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Bromochloroacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Bromochloromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Bromodichloromethane	EPA 524.2	Group II Unregulated Contaminants, Other Regulated Contaminants	NELAP	1/8/2002
Bromoform	EPA 524.2	Group II Unregulated Contaminants, Other Regulated Contaminants	NELAP	1/8/2002
Cadmium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Cadmium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Calcium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Carbaryl (Sevin)	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Carbaryl (Sevin)	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Carbofuran (Furadan)	EPA 531.1	Synthetic Organic Contaminants	NELAP	1/8/2002
Carbofuran (Furadan)	EPA 531.2	Synthetic Organic Contaminants	NELAP	4/26/2018
Carbon tetrachloride	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Chlorate	EPA 300.1	Primary Inorganic Contaminants	NELAP	5/11/2004
Chlordane (tech.)	EPA 505	Synthetic Organic Contaminants	NELAP	4/14/2020
Chloride	EPA 300.0	Secondary Inorganic Contaminants	NELAP	1/8/2002
Chlorine	SM 4500-Cl D	Primary Inorganic Contaminants	NELAP	1/8/2002
Chlorine dioxide, res. disinfectant	SM 4500-ClO2 D	Primary Inorganic Contaminants	NELAP	10/14/2004
Chlorite	EPA 300.1	Primary Inorganic Contaminants	NELAP	5/11/2004
Chloroacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Chlorobenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Chloroethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Chloroform	EPA 524.2	Other Regulated Contaminants, Group II Unregulated Contaminants	NELAP	1/8/2002
Chromium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Chromium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Chromium VI	EPA 218.6	Primary Inorganic Contaminants	NELAP	12/12/2012
Chromium VI	EPA 218.7	Primary Inorganic Contaminants	NELAP	12/12/2012
cis-1,2-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
cis-1,3-Dichloropropene	EPA 524.2	Group II Unregulated Contaminants	NELAP	4/26/2018
Cobalt	EPA 200.8	Primary Inorganic Contaminants	NELAP	12/12/2012
Color	SM 2120 B	Secondary Inorganic Contaminants	NELAP	1/8/2002
Conductivity	SM 2510 B	Primary Inorganic Contaminants	NELAP	1/8/2002
Copper	EPA 200.7	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	1/8/2002

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079 EPA Lab Code: FL01264 (386) 672-5668

E83079
Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Copper	EPA 200.8	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	5/11/2004
Corrosivity (langlier index)	SM 2330 B	Secondary Inorganic Contaminants	NELAP	1/8/2002
Cyanide	EPA 335.4	Primary Inorganic Contaminants	NELAP	1/8/2002
Dalapon	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
Di(2-ethylhexyl) phthalate (DEHP)	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Di(2-ethylhexyl)adipate	EPA 525.3	Synthetic Organic Contaminants	NELAP	5/21/2020
Dibromoacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Dibromochloromethane	EPA 524.2	Other Regulated Contaminants, Group II Unregulated Contaminants	NELAP	1/8/2002
Dibromomethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Dicamba	EPA 515.3	Group I Unregulated Contaminants	NELAP	5/11/2004
Dichloroacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Dichlorodifluoromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Dichloroprop (Dichlorprop)	EPA 515.3	Synthetic Organic Contaminants	NELAP	10/14/2004
Dieldrin	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Dinoseb (2-sec-butyl-4,6-dinitrophenol, DNBP)	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
Diquat	EPA 549.2	Synthetic Organic Contaminants	NELAP	1/8/2002
Dissolved organic carbon (DOC)	SM 5310 B	Primary Inorganic Contaminants	NELAP	1/3/2012
Endothall	EPA 548.1	Synthetic Organic Contaminants	NELAP	1/8/2002
Endrin	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Escherichia coli	COLISURE	Microbiology	NELAP	11/1/2011
Escherichia coli	SM 9223 B	Microbiology	NELAP	11/1/2011
Ethylbenzene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Fluoride	EPA 300.0	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	1/8/2002
gamma-BHC (Lindane, gamma-Hexachlorocyclohexane)	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
gamma-Chlordane	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Glyphosate	EPA 547	Synthetic Organic Contaminants	NELAP	1/8/2002
Hardness	SM 2340 B	Secondary Inorganic Contaminants	NELAP	8/14/2006
Hardness (calc.)	EPA 200.7	Secondary Inorganic Contaminants	NELAP	8/14/2006
Heptachlor	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Heptachlor epoxide	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Heterotrophic plate count	SIMPLATE	Microbiology	NELAP	3/15/2013
Hexachlorobenzene	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code:

FL01264

(386) 672-5668

E83079

Pace Analytical Services, LLC - Ormond Beach FL

8 East Tower Circle

Ormond Beach, FL 32174


Matrix: **Drinking Water**

Analyte	Method/Tech	Category	Certification Type	Effective Date
Hexachlorobutadiene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Hexachlorocyclopentadiene	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Hexafluoropropylene Oxide Dimer Acid (HFPO-DA, GenX)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Iron	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Isopropylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Lead	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
m+p-Xylenes	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/3/2012
Magnesium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Manganese	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Manganese	EPA 200.8	Secondary Inorganic Contaminants	NELAP	5/11/2004
Mercury	EPA 245.1	Primary Inorganic Contaminants	NELAP	1/8/2002
Methiocarb (MesuroI)	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Methiocarb (MesuroI)	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Methomyl (Lannate)	EPA 531.1	Group I Unregulated Contaminants	NELAP	1/8/2002
Methomyl (Lannate)	EPA 531.2	Group I Unregulated Contaminants	NELAP	4/26/2018
Methoxychlor	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Methyl bromide (Bromomethane)	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Methyl chloride (Chloromethane)	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Methyl tert-butyl ether (MTBE)	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Methylene chloride	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Metolachlor	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Metribuzin	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Molinate	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Naphthalene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
n-Butylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Nickel	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Nickel	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Nitrate	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Nitrate	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/8/2002
Nitrite	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Nitrite	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/8/2002
n-Propylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Odor	SM 2150 B	Secondary Inorganic Contaminants	NELAP	1/8/2002
Orthophosphate as P	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Orthophosphate as P	EPA 365.1	Primary Inorganic Contaminants	NELAP	1/8/2002
Oxamyl	EPA 531.1	Synthetic Organic Contaminants	NELAP	1/8/2002

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079

Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Oxamyl	EPA 531.2	Synthetic Organic Contaminants	NELAP	4/26/2018
o-Xylene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/3/2012
Paraquat	EPA 549.2	Synthetic Organic Contaminants	NELAP	3/10/2010
PCBs	EPA 505	Synthetic Organic Contaminants	NELAP	4/14/2020
Pentachlorophenol	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
Perfluorobutane Sulfonate (PFBS, Perfluorobutane Sulfonic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluorobutane Sulfonate (PFBS, Perfluorobutane Sulfonic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorodecanoate (PFDA, Perfluorodecanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorododecanoate (PFDoA, Perfluorododecanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluoroheptanoate (PFHpA, Perfluoroheptanoic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluoroheptanoate (PFHpA, Perfluoroheptanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorohexane Sulfonic Acid (PFHxS, Perfluorohexane Sulfonate)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluorohexane Sulfonic Acid (PFHxS, Perfluorohexane Sulfonate)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorohexanoate (PFHxA, Perfluorohexanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorononanoate (PFNA, Perfluorononanoic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluorononanoate (PFNA, Perfluorononanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorooctane sulfonate (PFOS, Perfluoro-octane Sulfonic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluorooctane Sulfonic Acid (PFOS, Perfluoro-octane Sulfonate)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluoro-octanoate (PFOA, Perfluoro-octanoic Acid)	EPA 537	Group III Unregulated Contaminants	NELAP	7/1/2016
Perfluoro-octanoate (PFOA, Perfluoro-octanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorotetradecanoate (PFTeDA, perfluorotetradecanoic acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluorotridecanoate (PFTriA, perfluorotridecanoic acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
Perfluoroundecanoate (PFUnA, Perfluoroundecanoic Acid)	EPA 537.1	Group III Unregulated Contaminants	NELAP	12/5/2019
pH	SM 4500-H ⁺ -B	Secondary Inorganic Contaminants	NELAP	2/19/2008
Picloram	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
p-Isopropyltoluene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Potassium	EPA 200.7	Secondary Inorganic Contaminants	NELAP	10/18/2004
Propachlor (Ramrod)	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020

* Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079
Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Residue-filterable (TDS)	SM 2540 C	Secondary Inorganic Contaminants	NELAP	1/8/2002
sec-Butylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Selenium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Silica as SiO2	EPA 200.7	Primary Inorganic Contaminants	NELAP	12/12/2012
Silver	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Silver	EPA 200.8	Secondary Inorganic Contaminants	NELAP	5/11/2004
Silvex (2,4,5-TP)	EPA 515.3	Synthetic Organic Contaminants	NELAP	5/11/2004
Simazine	EPA 525.3	Synthetic Organic Contaminants	NELAP	4/14/2020
Sodium	EPA 200.7	Primary Inorganic Contaminants	NELAP	1/8/2002
Strontium	PACE SOP S-FL-M-004 / ICP-MS	Secondary Inorganic Contaminants	NELAP	12/12/2012
Styrene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Sulfate	EPA 300.0	Primary Inorganic Contaminants, Secondary Inorganic Contaminants	NELAP	1/8/2002
Surfactants - MBAS	SM 5540 C	Secondary Inorganic Contaminants	NELAP	1/8/2002
tert-Butylbenzene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Tetrachloroethylene (Perchloroethylene)	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Thallium	EPA 200.8	Primary Inorganic Contaminants	NELAP	5/11/2004
Toluene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Total coliforms	COLISURE	Microbiology	NELAP	11/1/2011
Total coliforms	SM 9223 B	Microbiology	NELAP	11/1/2011
Total haloacetic acids (HAA5)	EPA 552.3	Synthetic Organic Contaminants	NELAP	7/1/2016
Total nitrate-nitrite	EPA 300.0	Primary Inorganic Contaminants	NELAP	1/8/2002
Total nitrate-nitrite	EPA 353.2	Primary Inorganic Contaminants	NELAP	1/8/2002
Total organic carbon	SM 5310 B	Primary Inorganic Contaminants	NELAP	1/8/2002
Total trihalomethanes	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Toxaphene (Chlorinated camphene)	EPA 505	Synthetic Organic Contaminants	NELAP	4/14/2020
trans-1,2-Dichloroethylene	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
trans-1,3-Dichloropropene	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Trichloroacetic acid	EPA 552.3	Group I Unregulated Contaminants	NELAP	7/1/2016
Trichloroethene (Trichloroethylene)	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Trichlorofluoromethane	EPA 524.2	Group II Unregulated Contaminants	NELAP	1/8/2002
Trifluralin (Treflan)	EPA 525.3	Group I Unregulated Contaminants	NELAP	4/14/2020
Turbidity	EPA 180.1	Secondary Inorganic Contaminants	NELAP	1/8/2002
Uranium (mass)	EPA 200.8	Radiochemistry	NELAP	12/12/2012
Vinyl chloride	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002
Xylene (total)	EPA 524.2	Other Regulated Contaminants	NELAP	1/8/2002

Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022



Laboratory Scope of Accreditation

Attachment to Certificate #: E83079-85, expiration date June 30, 2022. This listing of accredited analytes should be used only when associated with a valid certificate.

State Laboratory ID: E83079

EPA Lab Code: FL01264

(386) 672-5668

E83079

Pace Analytical Services, LLC - Ormond Beach FL
8 East Tower Circle
Ormond Beach, FL 32174

Matrix: Drinking Water

Analyte	Method/Tech	Category	Certification Type	Effective Date
Zinc	EPA 200.7	Secondary Inorganic Contaminants	NELAP	1/8/2002
Zinc	EPA 200.8	Secondary Inorganic Contaminants	NELAP	5/11/2004

* Clients and Customers are urged to verify the laboratory's current certification status with the Environmental Laboratory Certification Program.

Issue Date: 7/1/2021

Expiration Date: 6/30/2022

Benchmark EnviroAnalytical, Inc.
 1711 Twelfth Street East
 Palmetto, FL 34221
 (941) 723-9986
 (941) 723-6061 fax
 WWW.Benchmarkea.com

Sample Receipt Temp. 3.4 °C
 Thermometer ID: 258
 pH < 2 Init. (2)

Client: **Tri-Florida Water Treatment**
 226 E. Lake Ave.
 Aubundale Fl 33823
 863-965-1439 / Fax: 863-965-2407
 Larry Scott: Cell 863-255-8165
 LARRYSCOTT.TRIFLORIDAWATER@hotmail.com

Project Name: Paradise Island Subdivision Primary & Secondary Analysis
 PWS ID: 653-1340 Sample Type¹: G Sample Matrix²: DW

Laboratory Submission #: 21120658

Sample ID	Sb, As, Ba, Be, Cd, Cr, Pb, Hg, Ni, Se, Na, Tl, Al, Cu, Fe, Mn, Ag, Zn	Gross Alpha Radium 226 & 228 Combined Uranium	CN	VOCs	SOC's (Pesticides and PCB's)								MBAS (Foaming Agents)	* Odor	Cl SO ₄ TDS Color/pH pH*** NO ₃ (ppm) NO ₂ -NO ₃ (Calc.) NO ₂ (ppm) Fluoride	Lab ID #
					Carbamates 531.2	Pesticides 505	EDB/DBCP 504.1	Herbicides 515.3	Semivolatiles 525.3	Glyphosate 547	Endothal 548.1	Diquat 549.2				
POE	1: 4 HNO ₃ pH < 2	1: 4 HNO ₃ pH < 2	NaOH pH > 9	NaThio 1:1 HCl	NaThio C.H.K.O.	Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈	EDTA Ascorbic Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈	Na ₂ S ₂ O ₈ H ₂ SO ₄ pH < 2	Plain	Plain	Plain	1
	1 x 1 Quart Plastic	2 x 2 Quart Plastic	1 x 250mL Plastic	3 x 40mL Glass Vials**	2 x 40mL Glass Vials	3 x 1 Liter Glass	2 x 40mL Glass Vials	1 x 250mL Glass	3 x 1 Liter Glass	2 x 40mL Glass Vials	2 x 250mL Amber Glass	1 x 1 Liter Plastic	1 x 1 Quart Plastic	1 x 250mL Amber Glass	1 x 1 Quart Plastic	
	Date & Time: <u>12-8-21 / 1030</u>															

Field Chlorine: _____ Field pH: _____

* ~~600~~ rec'd SA of Lab 01/24/22 BB-10A/21 KD

* Add entire vial of HCl to each bottle. Add entire vial of H₂SO₄ to sample.
 ** Fill all 3 vials COMPLETELY, there can be NO AIR BUBBLES. *** pH Received after 15 minute hold time, ok to run.

- "Sample Type" is used to indicate whether the sample was a grab (G) or whether it was a composite (C).
- "Sample Matrix" is used to indicate whether the sample is being discharged to drinking water (DW), groundwater (GW), surface water (SW), soil, sediment (SDMNT), or sludge (SLDG).
- "Container Type" is used to indicate whether the container is plastic (P) or glass (G).
- Sample must be refrigerated or stored in wet ice after collection. The temperature during storage should be less than or equal to 6°C (42.8°F). Under "Preservative," list any preservatives that were added to the sample container.

- Instructions:**
- Each bottle has a label identifying sample ID, preservative contained in the bottle, sample type, client ID, and parameters for analysis.
 - The following information should be added to each bottle label after collection with permanent black ink: date and time of collection, sampler's name or initials, and any field number or ID.
 - All bottles not containing preservative may be rinsed with appropriate sample prior to collection.
 - The client is responsible for documentation of the sampling event. Please note special sampling events on the sample custody form.

Laboratory Sample Acceptability
 pH < 2 BMF: 0.79C
 Temperature: 3.40C

Collector	Date	Time	Received By	Date	Time
Larry Scott	12-9-21	0920	Rathna O BMF	12-9-21	0921
Relinquished By: Rathna O BMF	12/9/21	1200	Relinquished By:	12/9/21	1200
Relinquished By:	12/9/21	1500	Relinquished By: Annah Jensen BSA	12/09/21	1505
Relinquished By:			Relinquished By:		
Relinquished By:			Relinquished By:		

* Not reported due to sublab error. Client will recollect 12/01/21 KW

INTERLABORATORY SAMPLE TRANSMITTAL FORM

Benchmark Environmental, Inc.
 1711 12th Street East
 Palm Bay, FL 32921
 (941) 723-9986
 (941) 723-6061 fax




Office QC Check: _____
 Bottle Check: _____

10 BUSINESS DAY T.A.T. PLEASE

Date:	12/10/21		
# of Samples:	1	Total # of Bottles:	2
Method of Shipment:	Courier		
Subcontract Laboratory:	Florida Radiochemistry 5456 Hoffner Ave. #201 Orlando, FL 32812 Phone: 407-382-7723 Fax: 407-382-7744		
Page:	1	of	1

Laboratory Submission #	Collection		Sample Matrix*	Collection Method**	Preservative	Container			Parameters	Field Conductivity $\mu\text{s/cm}$
	Date	Time				Qty	Capacity	Type***		
21120658-001	12/08/21	1030	DW	Grab	1:4 HNO ₃	2	2 Qt	P	Gross Alpha, Radium-226 & 228, Combined Uranium	

* Sample Matrix abbreviations: Groundwater (GW), Surface Water (SW), Saline Surface Water (SSW), Fresh Surface Water (FSW), Drinking Water (DW), Sludge (Slg), Solid (Sol), Soil (Soil), Domestic Effluent (Dom Eff), Industrial Effluent (Ind Eff).
 ** Sample Method abbreviations: Grab (G), Composite (C), 24 Hour Composite (24HR Comp).
 *** Container Type abbreviations: Plastic (P), Glass (G).

Relinquished By: (Benchmark)	Sign Name:		Date:		Received By:		Date:	12/14/21
	Print Name:	Kara McGowan (Benchmark BA)	Time:				Time:	12:40
Relinquished By:	Sign Name:		Date:		Received By:		Date:	
	Print Name:		Time:				Time:	

INTERLABORATORY SAMPLE TRANSMITTAL FORM

Benchmark EnviroAnalytical, Inc.
 1711 12th Street East
 Palmetto, FL 34221
 (941) 723-9986
 (941) 723-6061 fax
 www.Benchmarkea.com

WO# 35684000



35684000

Date:	12/14/21		
# of Samples:	1	Total # of Bottles:	13
Method of Shipment:	Hand Delivery		
Subcontract Laboratory:	E83079 - Pace Analytical Service Inc; 8 East Tower Circle; Ormond Beach, FL 32175 Daniel Barrett; 1-800-966-5668		
Page	1	of	1

Laboratory Submission #	Collection		Sample Matrix*	Collection Method**	Preservative	Container			Parameters	Comments Sample verified to have no Chlorine at BEA
	Date	Time				Qty	Capacity	Type***		
21120658-001	12/08/21	1030	DW	Grab	NaThio C ₆ H ₅ K ₃ O ₇	2	40mL	G	Carbamates (531.2)	pH @ BEA = <u>4.1</u>
					Na ₂ SO ₃	3	40mL	G	Pesticides & PCBs (505)	
					Na ₂ S ₂ O ₃	1	250mL	G	Herbicides (515.3)	
					EDTA ASCORBIC KH ₂ CITRATE	3	1 L	G	Semivolatiles (525.3)	
					Na ₂ S ₂ O ₃	2	40mL	G	Glyphosate (547)	
					Na ₂ S ₂ O ₃	1	250mL	G	Endothall (548.1)	
					NaThio 1:4 H ₂ SO ₄ pH<2	1	1 L	P	Diquat (549.2)	pH verified @ BEA
*Do NOT Dilute sample, Call Dale Dixon for OK first!										

Checked against COC & Method Requirements: Dale Dixon Lab. Director

* Sample Matrix abbreviations: Groundwater (GW), Surface Water (SW), Saline-Surface Water (SSW), Fresh Surface Water (FSW), Drinking Water (DW), Sludge (Slgd), Solid (Sol), Soil (Soil), Domestic Effluent (Dom Eff), Industrial Effluent (Ind Eff).


** Sample Method abbreviations: Grab (G), Composite (C), 24 Hour Composite (24HR Comp).

*** Container/Type abbreviations: Plastic (P), Glass (G).

Relinquished By: (Benchmark)	Sign Name:	<i>NH</i>	Date:	12-14-21	Received By:	<i>MC PACE</i>	Date:	12-14-21
	Print Name:	Nathan Hadsell (Benchmark EA)	Time:	15:50			Time:	14:46
Relinquished By:	Sign Name:	<i>MC PACE</i>	Date:	12/14/21	Received By:	<i>D.H. Pace</i>	Date:	12.14.21
	Print Name:		Time:				Time:	15:30

Dale Dixon 12/14/21 2138

#8



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: January-21

A. Public Water System (PWS) Information

Table with PWS Name: Paradise Island Subdivision, PWS Identification Number: 653-1340, PWS Type: Community, Number of Service Connections at End of Month: 84, Total Population Served at End of Month: 268, PWS Owner: Earline Keen, Contact Person: Earline Keen, Contact Person's Title: Owner, Contact Person's Mailing Address: 685 Dyson Rd, City: Haines City, State: FL, Zip Code: 33844, Contact Person's Telephone Number: 863-421-6827, Contact Person's Fax Number: None, Contact Person's E-Mail Address: None

B. Water Treatment Plant Information

Table with Plant Name: Paradise Island Sub/Div, Plant Telephone Number: , Plant Address: 115 Scenic Hwy, City: Haines City, State: FL, Zip Code: 33844, Type of Water Treated by Plant: Raw ground water, Permitted Maximum Day Operating Capacity of Plant, gallons per day: 100,000, Plant Category (per subsection 62-699.310(4), F.A.C.): 5, Plant Class (per subsection 62-699.310(4), F.A.C.): D, Licensed Operators table with columns: Name, License Class, License Number, Day(s)/Shift(s) Worked. Includes Larry Scott, Keith Johnson, and Tony Johnson.

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date: Larry Scott 2-2-21

Larry Scott Printed or Typed Name

8567 License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: January-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation.		
		Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations						UV Dose						
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L			
1		24	19600													
2		24	19600													
3		24	19600													
4	X	24	19600											1.6		
5		24	18000													
6	X	24	18000											1.6		
7		24	16300													
8	X	24	16300											1.6		
9		24	17300													
10		24	17300													
11	X	24	17300											1.5		
12		24	16150													
13	X	24	16150											1.8		
14		24	16650													
15	X	24	16650											1.8		
16		24	17367													
17		24	17367													
18	X	24	17367											1.8		
19		24	19600													
20	X	24	19600											1.7		
21		24	18000													
22	X	24	18000											1.5		
23		24	25367													
24		24	25367													
25	X	24	25367											1.5		
26		24	8000													
27	X	24	8000											1.6		
28		24	15800													
29	X	24	15800											1.5		
30		24	15800													
31		24	15800													
Total			547102													
Average			17648													
Maximum			25367													

* Refer to the instructions for this report to determine which plants must provide this information



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: February-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision	PWS Identification Number:	653-1340
PWS Type:	Community		
Number of Service Connections at End of Month:	84	Total Population Served at End of Month:	268
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Paradise Island Sub/Div	Plant Telephone Number:	
Plant Address:	115 Scenic Hwy	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	100,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

Information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date *Larry Scott 3-4-21*

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: February-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: 3/1/2019 Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Paradise Island Subdivision	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
					CT Calculations					UV Dose							
					Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2				
1	x	24		20167												1.5	
2		24		16150													
3	x	24		16150													1.6
4		24		15500													
5	x	24		15500													1.5
6		24		16033													
7		24		16033													
8	x	24		16033													1.5
9		24		16300													
10	x	24		16300													1.6
11		24		16550													
12	x	24		16550													1.6
13		24		14700													
14		24		14700													
15	x	24		14700													1.5
16		24		13650													
17	x	24		13650													1.8
18		24		14900													
19	x	24		14900													1.8
20		24		15267													
21		24		15267													
22	x	24		15267													1.8
23		24		14650													
24	x	24		14650													1.6
25		24		20050													
26	x	24		20050													1.5
27		24		20050													
28		24		20050													
Total				453767													
Average				16206													
Maximum				20167													

* Refer to the instructions for this report to determine which plants must provide this information



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: March-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision	PWS Identification Number:	653-1340
PWS Type:	Community		
Number of Service Connections at End of Month:	84	Total Population Served at End of Month:	268
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Paradise Island Sub/Div	Plant Telephone Number:	
Plant Address:	115 Scenic Hwy	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	100,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			14/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates, and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.



 Signature and Date

Larry Scott

 Printed or Typed Name

8567

 License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: March-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation		
		Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations						UV Dose							
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2					
1	x	24	21233													1.8	
2		24	20550														
3	x	24	20550													1.8	
4		24	19500														
5	x	24	19500													1.6	
6		24	18067														
7		24	18067														
8	x	24	18067													1.5	
9		24	20450														
10	x	24	20450													1.4	
11		24	18400														
12	x	24	18400													1.5	
13		24	21333														
14		24	21333														
15	x	24	21333													1.5	
16		24	24300														
17	x	24	24300													0.8	
18		24	20900														
19	x	24	20900													1.8	
20		24	20233														
21		24	20233														
22	x	24	20233													1.8	
23		24	25050														
24	x	24	25050													1.8	
25		24	27800														
26	x	24	27800													1.8	
27		24	27600														
28		24	27600														
29	x	24	27600													1.5	
30		24	31950														
31	x	24	31950													1.6	
Total			700732														
Average			22604														
Maximum			31950														

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: April-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision	PWS Identification Number:	653-1340
PWS Type:	Community		
Number of Service Connections at End of Month:	84	Total Population Served at End of Month:	268
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Paradise Island Sub/Div	Plant Telephone Number:	
Plant Address:	115 Scenic Hwy	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:			100,000
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date Larry Scott 5-5-21

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: April-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System 3/1/2019 Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				CT Calculations						UV Dose					
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L		
1		24	21500												
2	x	24	21500											1.8	
3		24	23533												
4		24	23533												
5	x	24	23533											1.8	
6		24	29300												
7	x	24	29300											1.6	
8		24	36800												
9	x	24	36800											1.5	
10		24	21033												
11		24	21033												
12	x	24	21033											1.6	
13		24	19150												
14	x	24	19150											1.5	
15		24	21350												
16	x	24	21350											1.5	
17		24	21133												
18		24	21133												
19	x	24	21133											1.5	
20		24	13300												
21	x	24	13300											1.6	
22		24	21150												
23	x	24	21150											1.4	
24		24	23667												
25		24	23667												
26	x	24	23667											1.8	
27		24	22220												
28	x	24	22220											1.8	
29		24	27600												
30	x	24	27600											1.4	
Total			692838												
Average			23095												
Maximum			36800												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: May-21

A. Public Water System (PWS) Information	
PWS Name: Paradise Island Subdivision	PWS Identification Number: 653-1340
PWS Type: Community	
Number of Service Connections at End of Month: 84	Total Population Served at End of Month: 268
PWS Owner: Earline Keen	
Contact Person: Earline Keen	Contact Person's Title: Owner
Contact Person's Mailing Address: 685 Dyson Rd	City: Haines City State: FL Zip Code: 33844
Contact Person's Telephone Number: 863-421-6827	Contact Person's Fax Number: None
Contact Person's E-Mail Address: None	

B. Water Treatment Plant Information	
Plant Name: Paradise Island Sub/Div	Plant Telephone Number:
Plant Address: 115 Scenic Hwy	City: Haines City State: FL Zip Code: 33844
Type of Water Treated by Plant: Raw ground water	
Permitted Maximum Day Operating Capacity of Plant, gallons per day: 100,000	
Plant Category (per subsection 62-699.310(4), F.A.C.): 5	Plant Class (per subsection 62-699.310(4), F.A.C.): D
Licensed Operators	Name License Class License Number Day(s)/Shift(s) Worked
Lead/Chief Operator:	Larry Scott C 8567
Other Operators:	Keith Johnson C 7451
	Tony Johnson D 18154 12/Month

II. Certification by Lead/Chief Operator
I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

Information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 6-2-21
 Signature and Date

Larry Scott
 Printed or Typed Name

8567
 License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: May-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Paradise Island Subdivision	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
					CT Calculations					UV Dose						
					Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg·min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg·min/L	Lowest Operating UV Dose, mW·sec/cm ²	Minimum UV Dose Required, mW·sec/cm ²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L		
1		24		30367												
2		24		30367												
3	x	24		30367											1.4	
4		24		26680												
5	x	24		26680											1.4	
6		24		25950												
7	x	24		25950											1.5	
8		24		29667												
9		24		29667												
10	x	24		29667											1.4	
11		24		31200												
12	x	24		31200											1.5	
13		24		24850												
14	x	24		24850											1.5	
15		24		25733												
16		24		25733												
17	x	24		25733											1.4	
18		24		31200												
19	x	24		31200											1.6	
20		24		29250												
21	x	24		29250											1.5	
22		24		28467												
23		24		28467												
24	x	24		28467											1.6	
25		24		30250												
26	x	24		30250											1.5	
27		24		26300												
28	x	24		26300											1.5	
29		24		26300												
30		24		26300												
31		24		26300												
Total				872962												
Average				28160												
Maximum				31200												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

June-21

I. General Information for the Month/Year of:

A. Public Water System (PWS) Information

PWS Name: Paradise Island Subdivision		PWS Identification Number: 653-1340	
PWS Type: Community			
Number of Service Connections at End of Month: 84	Total Population Served at End of Month: 268		
PWS Owner: Earline Keen		Contact Person's Title: Owner	
Contact Person: Earline Keen	Contact Person's Mailing Address: 685 Dyson Rd	City: Haines City	State: FL Zip Code: 33844
Contact Person's Telephone Number: 863-421-6827	Contact Person's Fax Number: None		
Contact Person's E-Mail Address: None			

B. Water Treatment Plant Information

Plant Name: Paradise Island Sub/Div		Plant Telephone Number:	
Plant Address: 115 Scenic Hwy		City: Haines City	State: FL Zip Code: 33844
Type of Water Treated by Plant: Raw ground water			
Permitted Maximum Day Operating Capacity of Plant, gallons per day: 100,000			
Plant Category (per subsection 62-699.310(4), F.A.C.): 5		Plant Class (per subsection 62-699.310(4), F.A.C.): D	
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years

Signature and Date: Larry Scott 7-2-21

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: June-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: 3/1/2019 Free Chlorine

CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculations										UV Dose		Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
		Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²						
1		24	27900														1.5	
2	x	24	27900															
3		24	22600														1.6	
4	x	24	22600															
5		24	20567															
6		24	20567														1.5	
7	x	24	20567															
8		24	22350														1.6	
9	x	24	22350															
10		24	26150														1.5	
11	x	24	26150															
12		24	23567															
13		24	23567														0.8	Clean inj. pt., Duckbill
14	x	24	23567															
15		24	15400														1.5	
16	x	24	15400															
17		24	18350														1.4	
18	x	24	18350															
19		24	20300															
20		24	20300														0.2	
21	x	24	20300															
22		24	23100														1.5	
23	x	24	23100															
24		24	15200														1.5	
25	x	24	15200															
26		24	16100															
27		24	16100														1.4	
28	x	24	16100															
29		24	15750															
30	x	24	15750														1.4	
Total			615202															
Average			20507															
Maximum			27900															

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: July-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision	PWS Identification Number:	653-1340
PWS Type:	Community		
Number of Service Connections at End of Month:	84	Total Population Served at End of Month:	268
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Paradise Island Sub/Div	Plant Telephone Number:	
Plant Address:	115 Scenic Hwy	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	100,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			13/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 8-6-21
Signature and Date

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: July-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/l	Emergency or Abnormal Operating Conditions Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
		Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations							UV Dose					
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/l	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/l	Minimum Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²				
1		24	14750													
2	x	24	14750												1.5	
3		24	14820													
4		24	14820													
5	x	24	14820												1.5	
6		24	16050													
7	x	24	16050												1.4	
8		24	15850													
9	x	24	15850												1.6	
10		24	15333													
11		24	15333													
12	x	24	15333												1.5	
13		24	16950													
14	x	24	16950												1.5	
15		24	18600													
16	x	24	18600												1.6	
17		24	19533													
18		24	19533													
19	x	24	19533												1.5	
20		24	20250													
21	x	24	20250												1.5	
22		24	21900													
23	x	24	21900												1.5	
24		24	18167													
25		24	18167													
26	x	24	18167												1.4	
27		24	17100													
28	x	24	17100												1.5	
29		24	16300													
30	x	24	16300												1.5	
31		24	16300													
Total			535359													
Average			17270													
Maximum			21900													

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: August-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision	PWS Identification Number:	653-1340
PWS Type:	Community		
Number of Service Connections at End of Month:	84	Total Population Served at End of Month:	268
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
Contact Person's Telephone Number:	863-421-6827	Zip Code:	33844
Contact Person's E-Mail Address:	None	Contact Person's Fax Number:	None

B. Water Treatment Plant Information

Plant Name:	Paradise Island Sub/Div	Plant Telephone Number:	
Plant Address:	115 Scenic Hwy	City:	Haines City
		State:	FL
Type of Water Treated by Plant:	Raw ground water	Zip Code:	33844
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	100,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			13/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 9-7-21
Signature and Date

Keith Johnson Larry Scott
Printed or Typed Name

7451 8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: August-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions: Repair or Maintenance Work that Involves Taking Water System Components Out of Operation		
		Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations						UV Dose							
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2					
1		24	19900													1.5	
2	x	24	19900														
3		24	20520													1.4	
4	x	24	20520														
5		24	19150													1.5	
6	x	24	19150														
7		24	20933														
8		24	20933													1.5	
9	x	24	20933														
10		24	20800													1.4	
11	x	24	20800														
12		24	27550													1.4	
13	x	24	27550														
14		24	19733														
15		24	19733													1.5	
16	x	24	19733														
17		24	21200													1.5	
18	x	24	21200														
19		24	19500													1.4	
20	x	24	19500														
21		24	22633														
22		24	22633													1.5	
23	x	24	22633														
24		24	23200													1.5	
25	x	24	23200														
26		24	23250													1.4	
27	x	24	23250														
28		24	22733														
29		24	22733														
30	x	24	22733													1.4	
31		24	22733														
Total			670969														
Average			21644														
Maximum			27550														

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: September-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision		PWS Identification Number:	653-1340	
PWS Type:	Community				
Number of Service Connections at End of Month:	84	Total Population Served at End of Month:	268		
PWS Owner:	Earline Keen				
Contact Person:	Earline Keen		Contact Person's Title:	Owner	
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City	State:	FL Zip Code: 33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None		
Contact Person's E-Mail Address:	None				

B. Water Treatment Plant Information

Plant Name:	Paradise Island Sub/Div		Plant Telephone Number:		
Plant Address:	115 Scenic Hwy	City:	Haines City	State:	FL Zip Code: 33844
Type of Water Treated by Plant:	Raw ground water				
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	100,000				
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D		
Licensed Operators	Name	License Class	License Number	Day(s)/Shift(s) Worked	
Lead/Chief Operator:	Larry Scott	C	8567	1/Month	
Other Operators:	Tony Johnson	D	18154	9/Month	
	Keith Johnson	C	7451		

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

Information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date: Larry Scott 10-6-21

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: September-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System 3/1/2019 Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation		
		Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations						UV Dose					Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²				
1	X	24	21350												1.5	
2		24	16657													
3		24	16657													
4		24	16657													
5		24	16657													
6		24	16657													
7		24	16657													
8	X	24	16657												1.4	
9		24	16350													
10	X	24	16350												1.6	
11		24	15467													
12		24	15467													
13	X	24	15467												1.5	
14		24	18600													
15	X	24	18600												1.5	
16		24	16300													
17	X	24	16300												1.4	
18		24	22033													
19		24	22033													
20	X	24	22033												1.5	
21		24	18300													
22	X	24	18300												1.5	
23		24	17750													
24	X	24	17750												1.5	
25		24	23280													
26		24	23280													
27		24	23280													
28		24	23280													
29	X	24	23280												1.5	
30		24	23280													
Total			564729													
Average			18824													
Maximum			23280													

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: October-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision	PWS Identification Number:	653-1340
PWS Type:	Community		
Number of Service Connections at End of Month:	84	Total Population Served at End of Month:	268
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Paradise Island Sub/Div	Plant Telephone Number:	
Plant Address:	115 Scenic Hwy	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	100,090		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			13/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 11-4-21
Signature and Date

Keith Johnson, Larry Scott
Printed or Typed Name

7451 8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: October-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: 10/21/2021 Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation		
				CT Calculations						UV Dose					Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²				
1	X	24	31600												1.5	
2		24	25700													
3		24	25700													
4	X	24	25700												1.5	
5		24	25900													
6	X	24	25900												1.4	
7		24	22500													
8	X	24	22500												1.5	
9		24	19700													
10		24	19700													
11	X	24	19700												1.5	
12		24	27200													
13	X	24	27200												1.6	
14		24	38000													
15	X	24	38000												1.4	
16		24	38833													
17		24	38833													
18	X	24	38833												1.5	
19		24	27250													
20	X	24	27250												1.4	
21		24	25450													
22	X	24	25450												1.5	
23		24	22000													
24		24	22000													
25	X	24	22000												1.5	
26		24	21200													
27	X	24	21200												1.4	
28		24	20950													
29	X	24	20950												1.5	
30		24	20950													
31		24	20950													
Total			809099													
Average			26100													
Maximum			38833													

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: November-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision	PWS Identification Number:	653-1340
PWS Type:	Community		
Number of Service Connections at End of Month:	84	Total Population Served at End of Month:	268
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Paradise Island Sub/Div	Plant Telephone Number:	
Plant Address:	115 Scenic Hwy	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	100,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date: *Larry Scott* 12-10-21

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: November-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System				Free Chlorine											
Paradise Island Subdivision				CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*											
Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations						UV Dose		Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation		
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2			Minimum UV Dose Required, mW-sec/cm2	
1	x	24	28400											1.4	
2		24	20500											1.5	
3	x	24	20500											0.6	
4		24	18800												
5	x	24	18800												
6		24	18100												
7		24	18100											0.5	Clean Inj Pt
8	x	24	18100											1.4	
9		24	16700											1.5	
10	x	24	16700											1.5	
11		24	23300											1.5	
12	x	24	23300											1.5	
13		24	26733											1.5	
14		24	26733											1.5	
15	x	24	26733											1.5	
16		24	19200											1.5	
17	x	24	19200											1.4	
18		24	15900											1.0	
19	x	24	15900											0.2	Mainshaft
20		24	15367											0.2	Stenner #7 Tube
21		24	15367											0.2	Roller Assy
22	x	24	15367											0.2	Tube Housing Cover and Bushing
23		24	14050												8ft 1/4" Tubing
24	x	24	14050											1.5	
25		24	15850												
26	x	24	15850												
27		24	15850												
28		24	15850												
29	x	24	18833												
30		24	18833												
Total			566966												
Average			18899												
Maximum			28400												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: December-21

A. Public Water System (PWS) Information

PWS Name:	Paradise Island Subdivision	PWS Identification Number:	653-1340
PWS Type:	Community		
Number of <input type="checkbox"/> x	84	Total Population Served at End of Month:	268
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Per: <input type="checkbox"/> x		City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:		Contact Person's Fax Number:	None
Contact Per: <input type="checkbox"/> x			

B. Water Treatment Plant Information

Plant Name: <input type="checkbox"/> x	Paradise Island Sub/Div	Plant Telephone Number:	
Plant Address:	115 Scenic Hwy	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:			
Permitted <input type="checkbox"/> x		100,000	
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Op: <input type="checkbox"/> x	Name	License Class	License Number
			Day(s)/Shift(s) Worked
Lead/Chief Operator:	Larry Scott	C	8567
Other Oper: <input type="checkbox"/> x	Keith Johnson	C	7451
	Tony Johnson	D	18154
			14/Month
<input type="checkbox"/> x			

II. Certification by Lead/Chief Operator

I, the undersig: x

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International x
 plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain x

Larry Scott 1-5-22
 Signature and Date x

Larry Scott
 Printed or Typed Name

8567
 License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-1340 Plant Name: Paradise Island Sub/Div

III. Daily Data for the Month/Year of: December-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Paradise Island Subdivision		CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation		
		Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations					UV Dose								
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2					
1	X	24	19700													1.5	
2		24	19900														
3	X	24	19900													1.5	
4		24	20533														
5		24	20533														
6	X	24	20533													1.6	
7		24	25800													1.4	
8	X	24	25800													1.4	
9		24	26000														
10	X	24	26000													1.4	
11		24	23267														
12		24	23267														
13	X	24	23267													1.5	
14		24	24600														
15	X	24	24600													1.5	
16		24	23150														
17	X	24	23150													1.4	
18		24	23133														
19		24	23133														
20	X	24	23133													1.5	
21		24	22150														
22	X	24	22150													1.5	
23		24	19550														
24	X	24	19550													1.6	
25		24	20367														
26		24	20367														
27	X	24	20367													1.5	
28		24	21750														
29	X	24	21750													1.6	
30		24	23000														
31	X	24	23000													1.5	
Total			693400														
Average			22368														
Maximum			26000														

* Refer to the instructions for this report to determine which plants must provide this information.

#8



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: January-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
Contact Person's Telephone Number:	863-421-6827	State:	FL
Contact Person's E-Mail Address:	None	Zip Code:	33844
		Contact Person's Fax Number:	None

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			12/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 2-2-21
Signature and Date

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: January-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation:
				CT Calculations					UV Dose						
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²			
1		24	24280												
2		24	24280												
3		24	24280												
4	X	24	24280										1.6		
5		24	22050												
6	X	24	22050										1.6		
7		24	22150												
8	X	24	22150										1.5		
9		24	21933												
10		24	21933												
11	X	24	21933										1.6		
12		24	22800												
13	X	24	22800										1.8		
14		24	21900												
15	X	24	21900										1.5		
16		24	21933												
17		24	21933												
18	X	24	21933										1.8		
19		24	23500												
20	X	24	23500										1.8		
21		24	24300												
22	X	24	24300										1.8		
23		24	24633												
24		24	24633												
25	X	24	24633										1.6		
26		24	27700												
27	X	24	27700										1.8		
28		24	23650												
29	X	24	23650										1.8		
30		24	23650												
31		24	23650												
Total			726017												
Average			23420												
Maximum			27700												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: February-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date: Larry Scott 3-4-21

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: February-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				CT Calculations						UV Dose					
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L		
1	X	24	25533											2.5	
2		24	20250												
3	X	24	20250											2.4	
4		24	22950												
5	X	24	22950											2.4	
6		24	24633												
7		24	24633												
8	X	24	24633											2.0	
9		24	21900												
10	X	24	21900											2.1	
11		24	24000												
12	X	24	24000											1.9	
13		24	22200												
14		24	22200												
15	X	24	22200											2.0	
16		24	21850												
17	X	24	21850											1.8	
18		24	24000												
19	X	24	24000											1.9	
20		24	23200												
21		24	23200												
22	X	24	23200											2.0	
23		24	23600												
24	X	24	23600											2.1	
25		24	31000												
26	X	24	31000											2.2	
27		24	31000												
28		24	31000												
Total			676732												
Average			21830												
Maximum			31000												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: March-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			14/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 4-7-21
Signature and Date

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: March-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions: Repair or Maintenance Work that Involves Taking Water System Components Out of Operation		
				CT Calculations						UV Dose						
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/l	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/l	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L			
1	X	24	26600												2.0	
2		24	24450													
3	X	24	24450												2.1	
4		24	23700													
5	X	24	23700												2.0	
6		24	25667													
7		24	25667													
8	X	24	25667												2.1	
9		24	26350													
10	X	24	26350												2.0	
11		24	24600													
12	X	24	24600												2.0	
13		24	31400													
14		24	31400													
15	X	24	31400												1.9	
16		24	30750													
17	X	24	30750												1.8	
18		24	27650													
19	X	24	27650												2.0	
20		24	25867													
21		24	25867													
22	X	24	25867												2.0	
23		24	27500													
24	X	24	27500												2.1	
25		24	30650													
26	X	24	30650												2.0	
27		24	33967													
28		24	33967													
29	X	24	33967												0.8	
30		24	18900													
31	X	24	18900												1.4	
Total			846403													
Average			27303													
Maximum			33967													

* Refer to the instructions for this report to determine which plants must provide this information



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: April-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

Information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date Larry Scott 5-5-21 Printed or Typed Name Larry Scott License Number 8567

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: April-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				CT Calculations					UV Dose						
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²			
1		24	30250												
2	X	24	30250											1.8	
3		24	42250												
4		24	42250												
5	X	24	42250											1.8	
6		24	12140												
7	X	24	12140											1.8	
8		24	29100												
9	X	24	29100											1.8	
10		24	27067												
11		24	27067												
12	X	24	27067											1.5	
13		24	24200												
14	X	24	24200											2.0	
15		24	49100												
16	X	24	49100											2.0	
17		24	25400												
18		24	25400												
19	X	24	25400											2.0	
20		24	23700												
21	X	24	23700											1.8	
22		24	22850												
23	X	24	22850											1.8	
24		24	21933												
25		24	21933												
26	X	24	21933											1.9	
27		24	26600												
28	X	24	26600											1.8	
29		24	25750												
30	X	24	25750											1.8	
Total			837330												
Average			27011												
Maximum			49100												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: May-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			12/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 6-2-21
Signature and Date

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: May-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculations								UV Dose		Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²			
1		24	28300												
2		24	28300												
3	X	24	28300										1.8		
4		24	29450												
5	X	24	29450										1.8		
6		24	28950												
7	X	24	28950										1.8		
8		24	27667												
9		24	27667												
10	X	24	27667										1.5		
11		24	28500												
12	X	24	28500										1.8		
13		24	25050												
14	X	24	25050										1.5		
15		24	33200												
16		24	33200												
17	X	24	33200										1.5		
18		24	26100												
19	X	24	26100										1.8		
20		24	28600												
21	X	24	28600										1.5		
22		24	28267												
23		24	28267												
24	X	24	28267										1.4		
25		24	32750												
26	X	24	32750										1.5		
27		24	31150												
28	X	24	31150										1.5		
29		24	31150												
30		24	31150												
31		24	31150												
Total			906852												
Average			29253												
Maximum			33200												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

General Information for the Month/Year of:

June-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Signature and Date: Larry Scott 7-2-21

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: June-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				CT Calculations						UV Dose					
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/l	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/l		
1		24	31160												
2	X	24	31160											1.5	
3		24	26850												
4	X	24	26850											1.4	
5		24	27833												
6		24	27833												
7	X	24	27833											1.8	
8		24	28550												
9	X	24	28550											1.8	
10		24	30650												
11	X	24	30650											1.8	
12		24	30100												
13		24	30100												
14	X	24	30100											1.6	
15		24	43900												
16	X	24	43900											1.6	
17		24	19900												
18	X	24	19900											1.4	
19		24	24700												
20		24	24700												
21	X	24	24700											1.6	
22		24	22000												
23	X	24	22000											1.5	
24		24	21750												
25	X	24	21750											1.5	
26		24	35500												
27		24	35500												
28	X	24	35500											1.6	
29		24	23350												
30	X	24	23350											0.8	Duckbill
Total			850619												
Average			27439												
Maximum			43900												

* Refer to the instructions for this report to determine which plants must provide this information



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: July-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
Contact Person's Telephone Number:	863-421-6827	State:	FL
Contact Person's E-Mail Address:	None	Zip Code:	33844
		Contact Person's Fax Number:	None

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
Type of Water Treated by Plant:	Raw ground water	State:	FL
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000	Zip Code:	33844
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			13/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 8-6-21
 Signature and Date

Larry Scott
 Printed or Typed Name

8567
 License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: July-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				CT Calculations							UV Dose				
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/l	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/l	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/l		
1		24	21900												
2	X	24	21900												
3		24	20833											0.2	Stenner #2 Tubing
4		24	20833												
5	X	24	20833												
6		24	22150											1.8	
7	X	24	22150											1.8	
8		24	21250												
9	X	24	21250											1.4	
10		24	21733												
11		24	21733												
12	X	24	21733											1.5	
13		24	20450												
14	X	24	20450											1.4	
15		24	23950												
16	X	24	23950											1.6	
17		24	22267												
18		24	22267												
19	X	24	22267											1.5	
20		24	28800												
21	X	24	28800											1.5	
22		24	26650												
23	X	24	26650											1.5	
24		24	24176												
25		24	24176												
26	X	24	24176											1.6	
27		24	21950												
28	X	24	21950											1.5	
29		24	23900												
30	X	24	23900											1.5	
31		24	23900												
Total			712927												
Average			22998												
Maximum			28800												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: August-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			13/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 9-7-21
Signature and Date

Keith Johnson Larry Scott
Printed or Typed Name

7451 8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: August-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				CT Calculations						UV Dose					
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L		
1		24	23600												
2	x	24	23600											1.5	
3		24	22650												
4	x	24	22650											0.5	Duckbill, Cleaned Injection Point
5		24	26350												
6	x	24	23650											1.5	
7		24	23650												
8		24	22400												
9	x	24	22400											1.4	
10		24	24400												
11	x	24	24400											1.5	
12		24	22750												
13	x	24	22750											1.5	
14		24	22133												
15		24	22133												
16	x	24	22133											1.5	
17		24	23550												
18	x	24	23550											1.5	
19		24	24850												
20	x	24	24850											1.6	
21		24	22133												
22		24	22133												
23	x	24	22133											1.5	
24		24	24200												
25	x	24	24200											1.5	
26		24	24250												
27	x	24	24250											1.5	
28		24	25433												
29		24	25433												
30	x	24	25433											1.4	
31		24	25433												
Total			733480												
Average			23661												
Maximum			26350												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: September-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott
 Signature and Date 10-6-21

Larry Scott
 Printed or Typed Name

8567
 License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP


III. Daily Data for the Month/Year of: September-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Emergency or Abnormal Operating Conditions, Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				CT Calculations						UV Dose					
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm ²	Minimum UV Dose Required, mW-sec/cm ²	Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L		
1	X	24	27200											1.5	
2		24	25525												
3		24	25525												
4		24	25525												
5	X	24	25525											0.8	
6		24	20867												
7		24	20867												
8	X	24	20867											1.5	
9		24	21400												
10	X	24	21400											1.6	
11		24	22567												
12		24	22567												
13	X	24	22567											1.5	
14		24	23750												
15	X	24	23750											1.6	
16		24	21050												
17	X	24	21050											1.4	
18		24	25600												
19		24	25600												
20	X	24	25600											1.5	
21		24	25000												
22	X	24	25000											1.5	
23		24	33200												
24	X	24	33200											1.5	
25		24	27680												
26		24	27680												
27		24	27680												
28		24	27680												
29	X	24	27680											2.0	
30		24	27680												
Total			751282												
Average			24235												
Maximum			33200												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: October-21

A. Public Water System (PWS) Information		PWS Identification Number: 653-5235	
PWS Name:	Keen MH Sub/Div		
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information		Plant Telephone Number: 863-421-6827	
Plant Name:	Keen MH Sub/Div	City:	Haines City
Plant Address:	Ray Keen Rd	State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
			Day(s)/Shift(s) Worked
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			13/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 11-4-21
Signature and Date

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: October-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				CT Calculations						UV Dose					
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2			
1	x	24	2180											1.5	
2		24	2770												
3		24	2770												
4	x	24	2770											1.5	
5		24	2950												
6	x	24	2950											1.6	
7		24	2620												
8	x	24	2620											1.4	
9		24	2500												
10		24	2500												
11	x	24	2500											0.2	Duckbill
12		24	2495												
13	x	24	2495											0.2	Stenner #2 Tubing
14		24	2495												Tube Housing
15	x	24	2495											1.8	Cover on Bushing
16		24	2500												
17		24	2500												
18	x	24	2500											1.7	
19		24	2725												
20	x	24	2725											1.6	
21		24	2710												
22	x	24	2710											1.5	
23		24	2460												
24		24	2460												
25	x	24	2460											1.5	
26		24	2450												
27	x	24	2450											1.8	
28		24	2315												
29	x	24	2315											1.4	
30		24	2315												
31		24	2315												
Total			79020												
Average			2549												
Maximum			2950												

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: October-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
Contact Person's Telephone Number:	863-421-6827	State:	FL
Contact Person's E-Mail Address:	None	Zip Code:	33844
		Contact Person's Fax Number:	None

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
Type of Water Treated by Plant:	Raw ground water	State:	FL
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000	Zip Code:	33844
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

Information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott
Signature and Date 12-6-21

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: October-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				CT Calculations						UV Dose						
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2				
1	x	24	33600												1.5	
2		24	24700													
3	x	24	24700												1.5	
4		24	23050													
5	x	24	23050												1.5	
6		24	22367													
7		24	22367													
8	x	24	22367												1.6	
9		24	22900													
10	x	24	22900												1.5	
11		24	20500													
12	x	24	20500												1.6	
13		24	22667													
14		24	22667													
15	x	24	22667												1.5	
16		24	23900													
17	x	24	23900												1.8	
18		24	24450													
19	x	24	24450												1.6	
20		24	21833													
21		24	21833													
22	x	24	21833												1.5	
23		24	24000													
24	x	24	24000												1.8	
25		24	24600													
26	x	24	24600												1.8	
27		24	23933													
28		24	23933													
29	x	24	23933												1.7	
30		24	23933													
Total			706133													
Average			22778													
Maximum			33600													

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: November-21

A. Public Water System (PWS) Information

PWS Name:	Keen MH Sub/Div	PWS Identification Number:	653-5235
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
Contact Person's Telephone Number:	863-421-6827	Zip Code:	33844
Contact Person's E-Mail Address:	None	Contact Person's Fax Number:	None

B. Water Treatment Plant Information

Plant Name:	Keen MH Sub/Div	Plant Telephone Number:	863-421-6827
Plant Address:	Ray Keen Rd	City:	Haines City
		State:	FL
Type of Water Treated by Plant:	Raw ground water	Zip Code:	33844
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Tony Johnson	D	18154
	Keith Johnson	C	7451
			Day(s)/Shift(s) Worked
			13/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report.

Information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott
Signature and Date 12-10-21

Larry Scott
Printed or Typed Name

8567
License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: November-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation	
				CT Calculations						UV Dose						
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2				
1	X	24	33600												1.5	
2		24	24700													
3	X	24	24700												1.5	
4		24	23050													
5	X	24	23050												1.5	
6		24	22367													
7		24	22367													
8	X	24	22367												1.6	
9		24	22900													
10	X	24	22900												1.5	
11		24	20500													
12	X	24	20500												1.6	
13		24	22667													
14		24	22667													
15	X	24	22667												1.5	
16		24	23900													
17	X	24	23900												1.8	
18		24	24450													
19	X	24	24450												1.6	
20		24	21833													
21		24	21833													
22	X	24	21833												1.5	
23		24	24000													
24	X	24	24000												1.8	
25		24	24600													
26	X	24	24600												1.8	
27		24	23933													
28		24	23933													
29	X	24	23933												1.7	
30		24	23933													
Total			706133													
Average			22778													
Maximum			33600													

* Refer to the instructions for this report to determine which plants must provide this information.



MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

See page 4 for Instructions.

POLK

I. General Information for the Month/Year of: December-21

A. Public Water System (PWS) Information		PWS Identification Number: 653-5235	
PWS Name:	Keen MH Sub/Div		
PWS Type:	Community		
Number of Service Connections at End of Month:	126	Total Population Served at End of Month:	265
PWS Owner:	Earline Keen		
Contact Person:	Earline Keen	Contact Person's Title:	Owner
Contact Person's Mailing Address:	685 Dyson Rd	City:	Haines City
		State:	FL
		Zip Code:	33844
Contact Person's Telephone Number:	863-421-6827	Contact Person's Fax Number:	None
Contact Person's E-Mail Address:	None		

B. Water Treatment Plant Information		Plant Telephone Number: 863-421-6827	
Plant Name:	Keen MH Sub/Div	City:	Haines City
Plant Address:	Ray Keen Rd	State:	FL
		Zip Code:	33844
Type of Water Treated by Plant:	Raw ground water		
Permitted Maximum Day Operating Capacity of Plant, gallons per day:	250,000		
Plant Category (per subsection 62-699.310(4), F.A.C.):	5	Plant Class (per subsection 62-699.310(4), F.A.C.):	D
Licensed Operators	Name	License Class	License Number
			Day(s)/Shift(s) Worked
Lead/Chief Operator:	Larry Scott	C	8567
Other Operators:	Keith Johnson	C	7451
	Tony Johnson	D	18154
			14/Month

II. Certification by Lead/Chief Operator

I, the undersigned water treatment plant operator licensed in Florida, am the lead/chief operator of the water treatment plant identified in Part I of this report. I certify that the information provided in this report is true and accurate to the best of my knowledge and belief. I certify that all drinking water treatment chemicals used at this plant conform to NSF International Standard 60 or other applicable standards referenced in subsection 62-555.320(3), F.A.C. I also certify that the following additional operational records for this plant were prepared each day that a licensed operator staffed or visited this plant during the month indicated above: (1) records of amounts of chemicals used and chemical feed rates; and (2) if applicable, appropriate treatment process performance records. Furthermore I agree to provide these additional operational records to the PWS owner so the PWS owner can retain them, together with copies of this report, at a convenient location for at least ten years.

Larry Scott 1-5-22
 Signature and Date

Larry Scott
 Printed or Typed Name

8567
 License Number

MONTHLY OPERATION REPORT FOR PWSs TREATING RAW GROUND WATER OR PURCHASED FINISHED WATER

PWS Identification Number: 653-5235 Plant Name: Keen MHP

III. Daily Data for the Month/Year of: December-21

Means of Achieving Four-Log Virus Inactivation/Removal:*

Type of Disinfectant Residual Maintained in Distribution System: Free Chlorine

Day of the Month	Days Plant Staffed or Visited by Operator (Place "X")	Hours Plant in Operation	Net Quantity of Finished Water Produced, gal	CT Calculation, or UV Dose, to Demonstrate Four-Log Virus Inactivation, if Applicable*										Lowest Residual Disinfectant Concentration at Remote Point in Distribution System, mg/L	Emergency or Abnormal Operating Conditions; Repair or Maintenance Work that Involves Taking Water System Components Out of Operation
				CT Calculations						UV Dose					
				Peak Flow rate, gpd	Lowest Residual Disinfectant Concentration (C) Before or at First Customer During Peak Flow, mg/l	Disinfectant Contact Time (T) at C Measurement Point During Peak Flow, minutes	Lowest CT Provided Before or at First Customer During Peak Flow, mg-min/L	Temp. of Water, C	pH of Water, if Applicable	Minimum CT Required, mg-min/L	Lowest Operating UV Dose, mW-sec/cm2	Minimum UV Dose Required, mW-sec/cm2			
													0.2	Replaced Duckbill, cleaned inj. point	
1	x	24	24250												
2		24	23200										1.5		
3	x	24	23200												
4		24	24100												
5		24	24100										1.5		
6	x	24	24100												
7		24	25000										1.8		
8	x	24	25000												
9		24	25050										1.6		
10	x	24	25050												
11		24	23800												
12		24	23800										1.4		
13	x	24	23800												
14		24	23950										1.6		
15	x	24	23950												
16		24	22100										1.5		
17	x	24	22100												
18		24	22700												
19		24	22700										1.6		
20	x	24	22700												
21		24	21850										1.8		
22	x	24	21850												
23		24	20850										1.8		
24	x	24	20850												
25		24	22333												
26		24	22333										1.6		
27	x	24	22333												
28		24	23900										1.5		
29	x	24	23900												
30		24	24750										1.6		
31	x	24	24750												
Total			724349												
Average			23366												
Maximum			25050												

* Refer to the instructions for this report to determine which plants must provide this information.

#9

Keen Subdivision monthly totals of water sold 2021

Month	Usage
January	711492
February	554660
March	579616
April	799679
May	616733
June	691759
July	773160
August	553303
September	552900
October	757410
November	635882
December	646278

#9

Paraside Island monthly totals of water sold 2021

Month	Usage
January	583790
February	462300
March	440720
April	667180
May	579905
June	719991
July	604514
August	512190
September	520833
October	666432
November	626675
December	608290

#10



RECEIPT – PWS ANNUAL FEE

THIS DOCUMENT DOES NOT CERTIFY THAT THIS PWS IS IN COMPLIANCE WITH REGULATORY REQUIREMENTS

PWS Number: 6535235
Permit Year: 2022 - 2023

Location: **KEEN MOBILE HOME SUBDIVISION**
RAY KEEN RD OFF SR 580
HAINES CITY, FL 33844

Fee Amount: \$700.00
Receipt #: 248384
Date Paid: 5/31/2022
Issue Date: 07/01/2022
Expires: 06/30/2023

Issued To: **EARLENE KEEN**
685 DYSON ROAD
HAINES CITY, FL 33844

Ronald L. Stadelbacher
Florida Department of Health in Polk County
2090 East Clower Street, Bartow, Florida 33830

ORIGINAL - FACILITY



RECEIPT – PWS ANNUAL FEE

THIS DOCUMENT DOES NOT CERTIFY THAT THIS PWS IS IN COMPLIANCE WITH REGULATORY REQUIREMENTS

PWS Number: 6535235
Permit Year: 2022 - 2023

Location: **KEEN MOBILE HOME SUBDIVISION**
RAY KEEN RD OFF SR 580
HAINES CITY, FL 33844

Fee Amount: \$700.00
Receipt #: 248384
Date Paid: 5/31/2022
Issue Date: 07/01/2022
Expires: 06/30/2023

Issued To: **EARLENE KEEN**
685 DYSON ROAD
HAINES CITY, FL 33844

Ronald L. Stadelbacher
Florida Department of Health in Polk County
2090 East Clower Street, Bartow, Florida 33830

COPY - OWNER

#10



RECEIPT – PWS ANNUAL FEE

THIS DOCUMENT DOES NOT CERTIFY THAT THIS PWS IS IN COMPLIANCE WITH REGULATORY REQUIREMENTS

PWS Number: 6531340
Permit Year: 2022 - 2023

Location: PARADISE ISLAND S/D
US. HWY 27 SOUTH LOT 102
HAINES CITY, FL 33844

Issued To: KEEN SALES & RENTALS UTILITIES (EARLENE KEEN)
685 DYSON ROAD
HAINES CITY, FL 33844

Fee Amount: \$600.00
Receipt #: 248385
Date Paid: 5/31/2022
Issue Date: 07/01/2022
Expires: 06/30/2023

Ronald L. Stadelbacher
Florida Department of Health in Polk County
2090 East Clower Street, Bartow, Florida 33830

ORIGINAL - FACILITY



RECEIPT – PWS ANNUAL FEE

THIS DOCUMENT DOES NOT CERTIFY THAT THIS PWS IS IN COMPLIANCE WITH REGULATORY REQUIREMENTS

PWS Number: 6531340
Permit Year: 2022 - 2023

Location: PARADISE ISLAND S/D
US. HWY 27 SOUTH LOT 102
HAINES CITY, FL 33844

Issued To: KEEN SALES & RENTALS UTILITIES (EARLENE KEEN)
685 DYSON ROAD
HAINES CITY, FL 33844

Fee Amount: \$600.00
Receipt #: 248385
Date Paid: 5/31/2022
Issue Date: 07/01/2022
Expires: 06/30/2023

Ronald L. Stadelbacher
Florida Department of Health in Polk County
2090 East Clower Street, Bartow, Florida 33830

COPY - OWNER

Sorry for the dark
copies. Please let me
know if you can't
read it.

Mindy Keen




#15

KEEN Subs

KEEN SUBDIVISION
MAY 19 1958

PROJECT & ASSOCIATES INC.


SECTION PART 2 TRUCK DETAILS

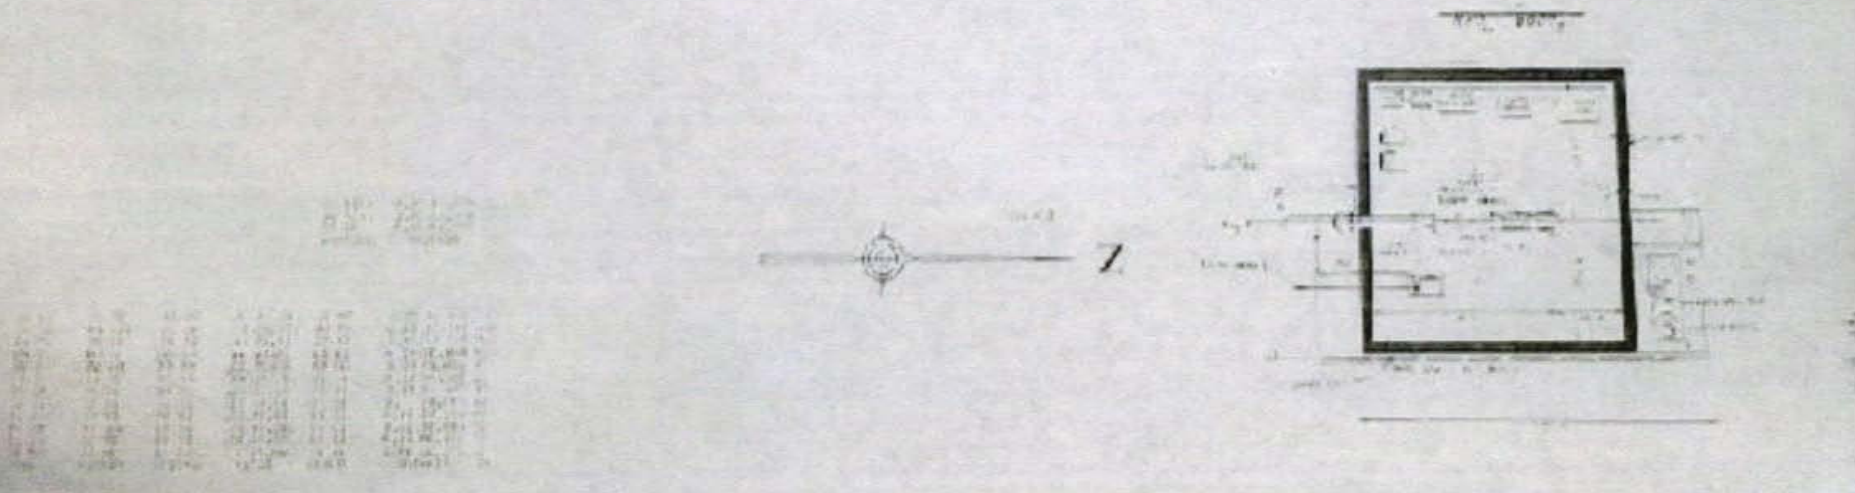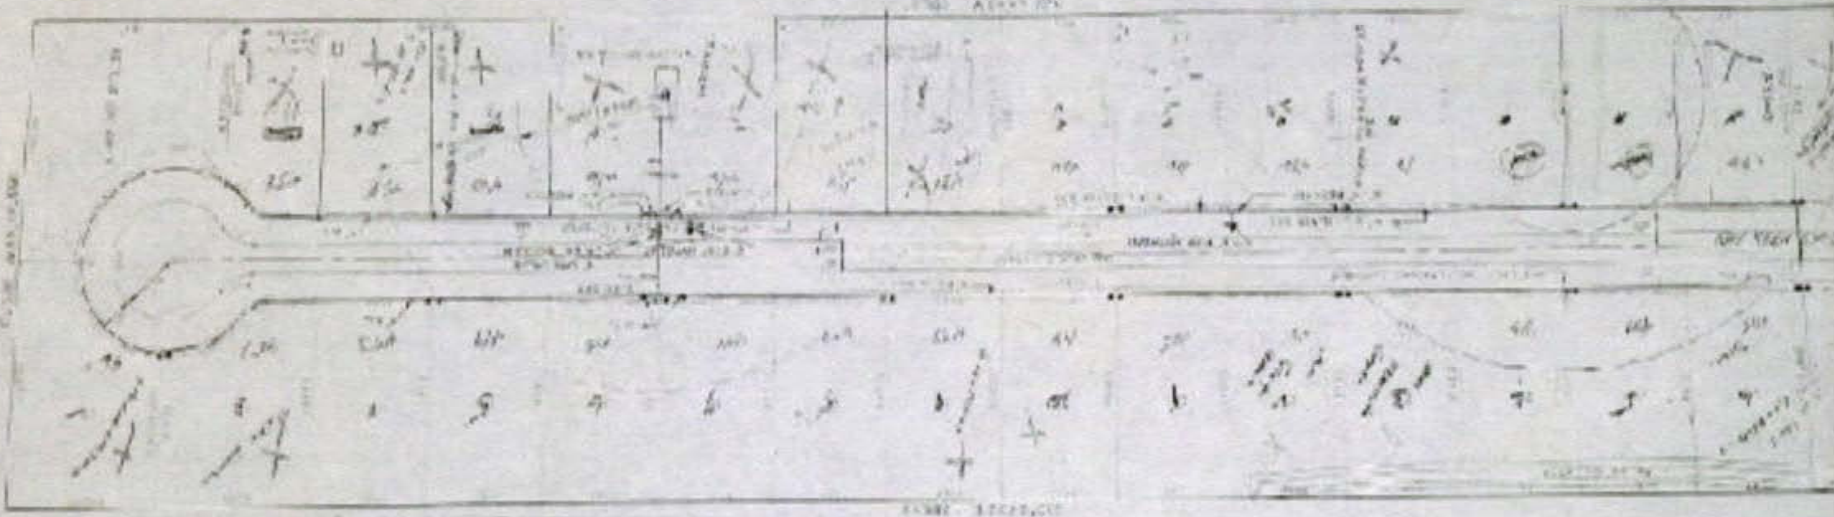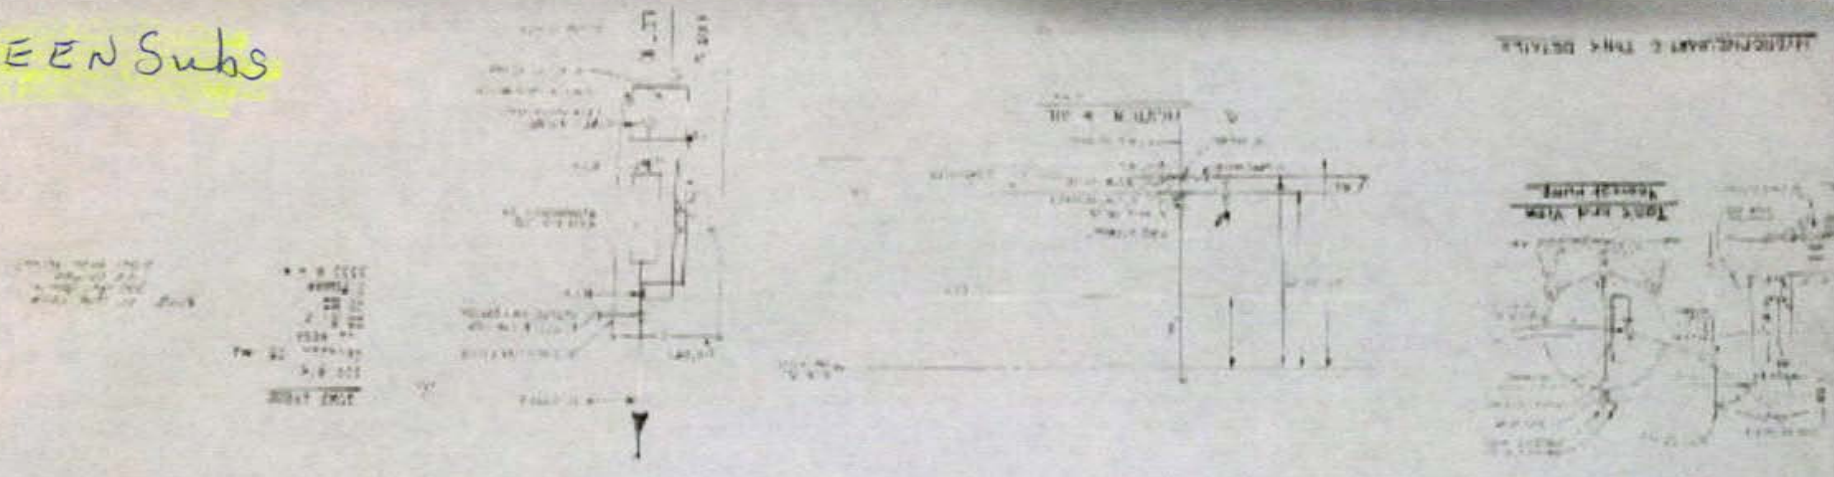

**PLAT SHOWING
WATER DISTRIBUTION SYSTEM FOR LAKE REGION PARADISE
ISLAND SUBD. UNIT NO. 1, LYING IN SEC. 8, TWP 28 S, R. 27 E,**

**DOLK COUNTY, FLORIDA
NOV. 30, 1959 SCALE: 1"=100' LENOX E. TRICKLE
REG. ENGR.**

KEY
 ———— 6" MAIN
 - - - - - 4" MAIN
 - · - · - 2" LINE - 18" from center of Ad down PT. DE.
 X = VALVE
 ● = FIRE HYDRANT
 NOTE: MAINS WILL BE 6 FT. INTO STREETS & MINIMUM OF 2 FT. BELOW SURFACE

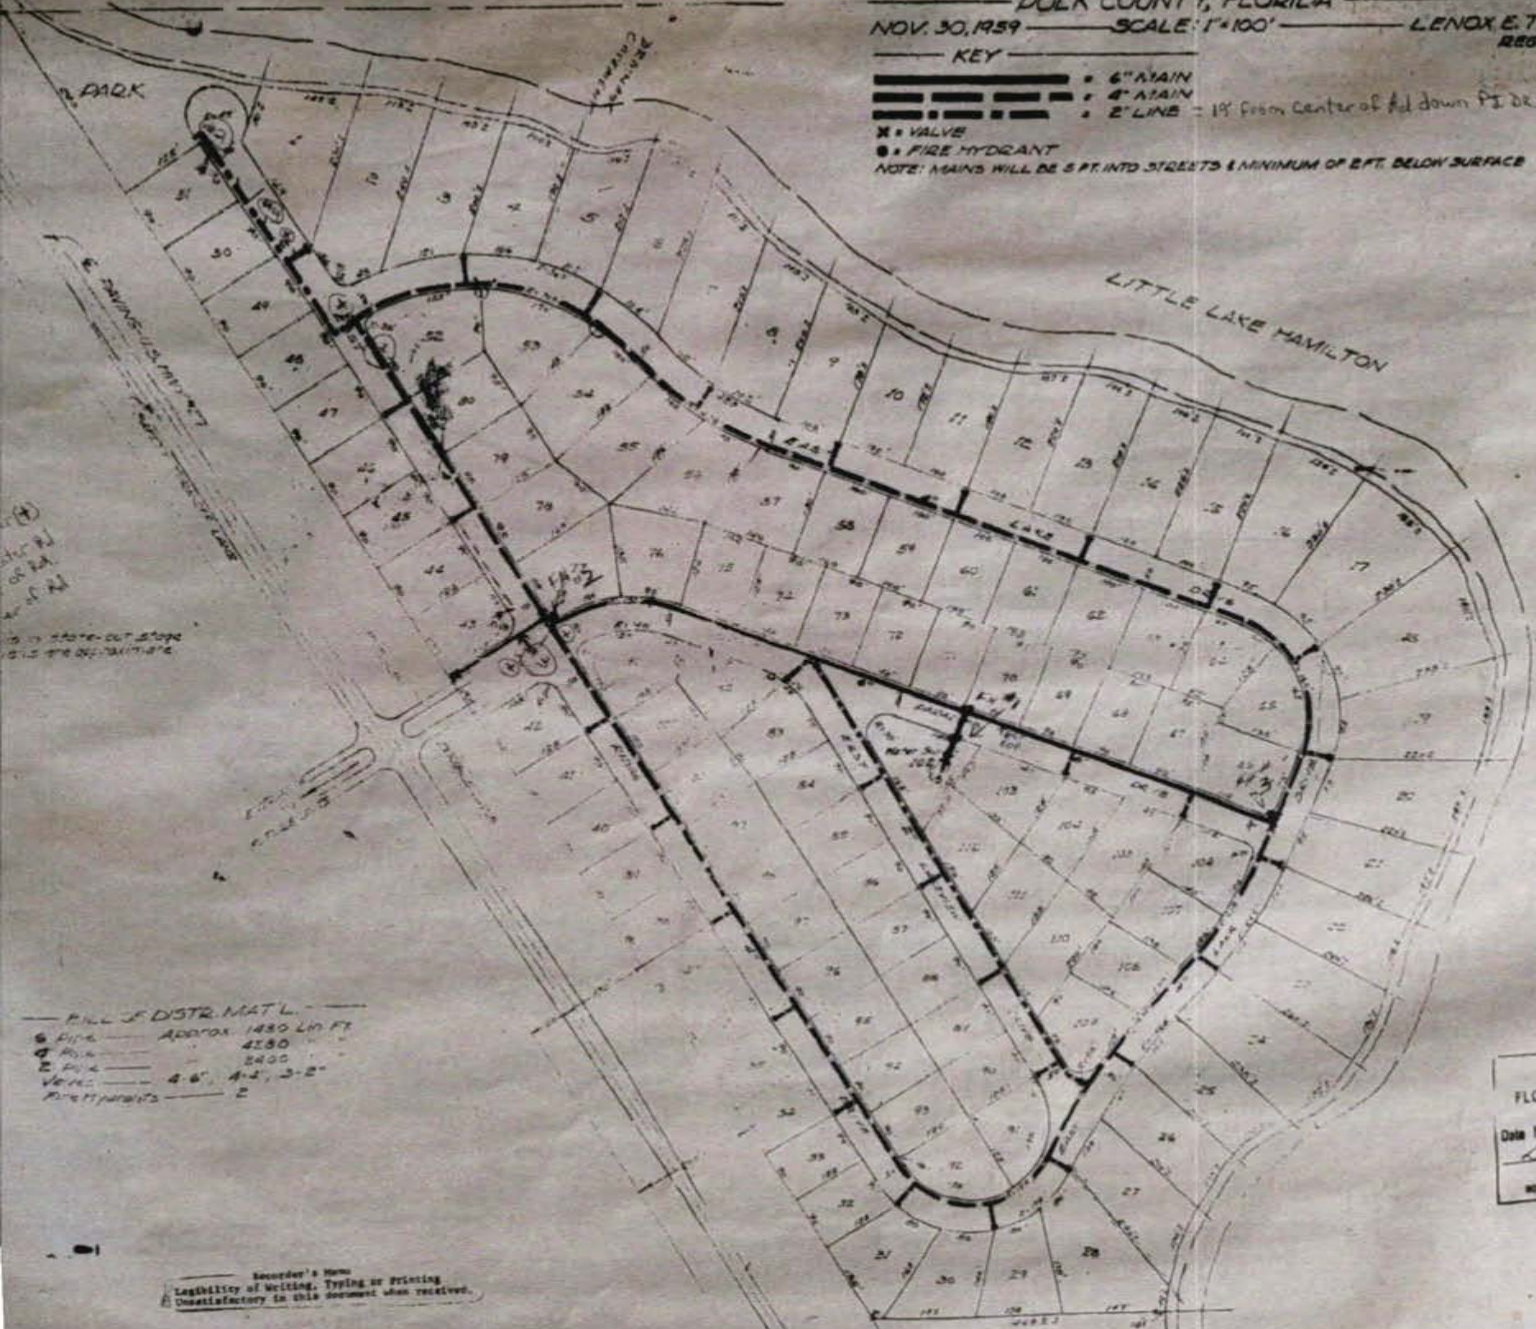


BILL OF DISTR. MAT'L.
 6" PIPE ——— APPROX 1450 LIN. FT.
 4" PIPE ——— 4150
 2" PIPE ——— 2400
 VALVE ——— 4-6", 1-2", 3-2"
 FIRE HYDRANTS ——— 2

APPROVED BY
 FLORIDA STATE BOARD OF PUBLIC SAFETY
 Date MAH 23 1960 Serial No. 1059
 L. E. Trickle
 REGISTERED ENGINEER
 NOTE: THE ORIGINAL OF THIS PLAT IS TO BE KEPT BY THE BOARD.

Recorder's Note
 Legibility of Writing, Typing or Printing
 Unsatisfactory in this document when received.

Keen Subdivision

5/8" x 3/4" meters

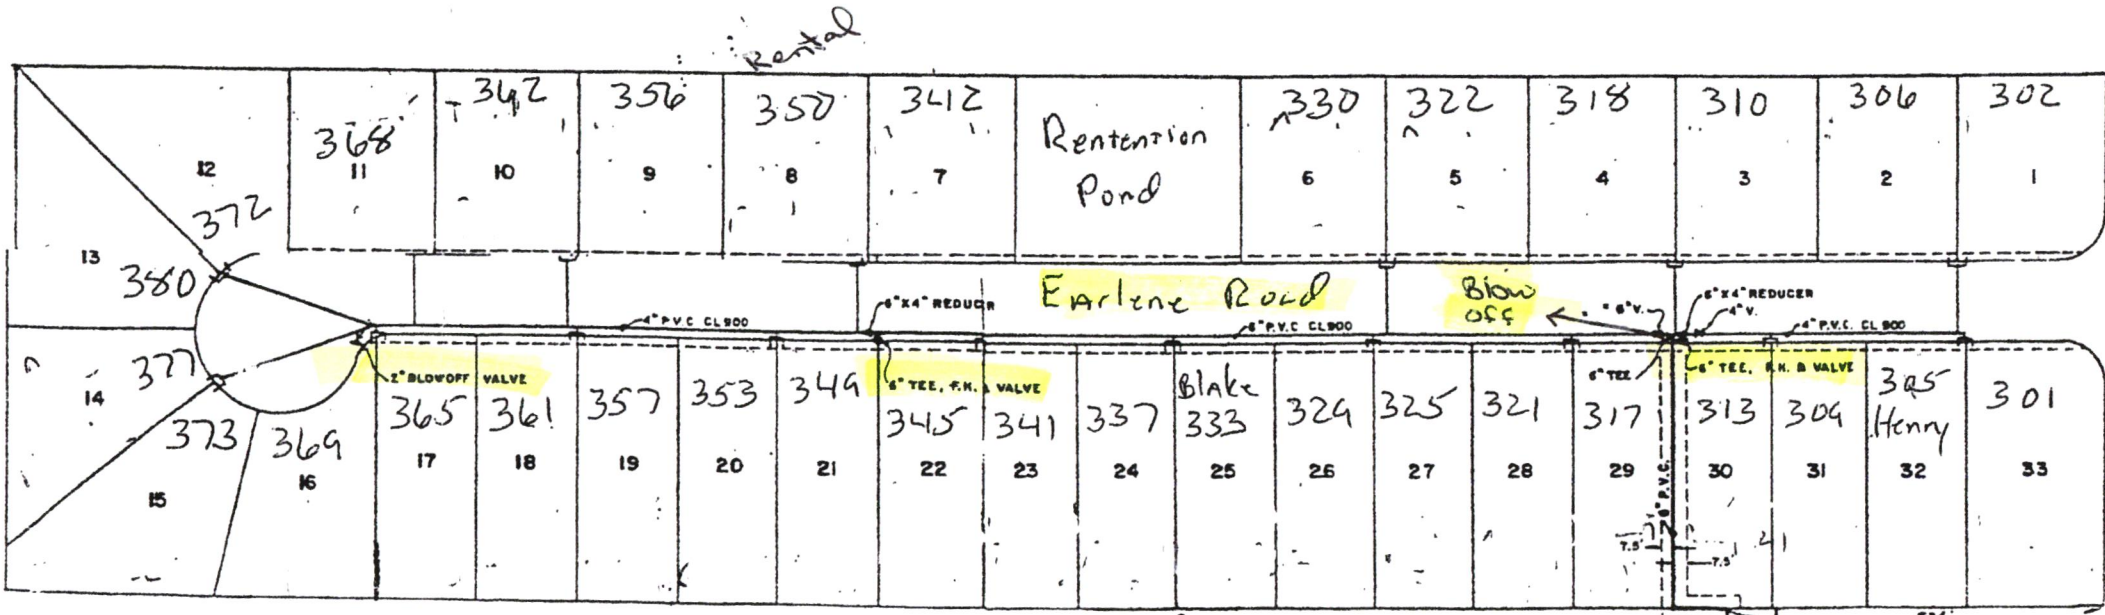


Johnson Avenue

REVISIONS	BY

NOTE: WATER MAIN 5' FROM EASEMENT.

EXISTING WELL
SEE CONNECTION DETAIL THIS SHEET
PROPOSED 4" WELL

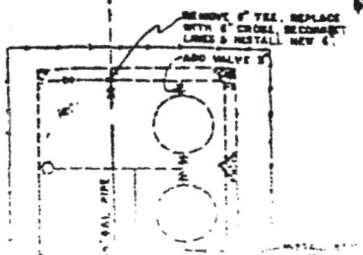

Keen Subs - Ellison Pkwy

5/8" x 3/4" meters

