


ORIGINAL

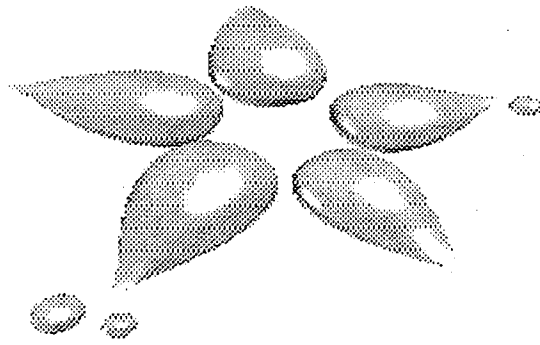

United Water

Before the

Florida Public Service Commission

Docket No. 980214-WS

Application for a General Rate Increase

H - 5 Schedule

Containing

25-30.440

Additional Engineering Information

Required of Class A & B

Water and Sewer Utilities

DOCUMENT NUMBER-DATE

05504 MAY 18 98

FPSC-RECORDS/REPORTING

Book 1 of 7

**WATER
OPERATING REPORTS
1996**

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYS.: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1996

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: David E. Kimbrell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16698	1404	314.4	37.4	99.7	7.1	
AVERAGE	538.6	45.3	10.1	7.5	3.2	1.4	
MAXIMUM	798	68	12.2	7.5	3.5	1.8	
MINIMUM	59	6	8.6	7.4	2.1	1.0	
01	646	50	9.3		3.5		
02	88	8	10.9	7.4	3.5	1.6	
03	103	8	9.3		3.5		
04	672	60	10.7		3.0		
05	636	58	10.9		3.0		
06	59	6	12.2		2.6		
07	714	60	10.1	7.5	2.1		On-site well artesian pressure 3
08	457	38	10.0		3.5		Off-site well artesian pressure 2
09	685	60	10.5		3.5	1.8	
10	684	68	11.9		3.5		
11	326	26	9.6		3.5		
12	515	44	10.2		3.5		
13	98	8	9.8		3.5		
14	753	55	8.8		2.8		
15	656	55	10.1		3.2		
16	656	58	10.6		3.5		
17	740	60	9.7		3.0		
18	477	41	10.3	7.5	3.0	1.5	
19	523	44	10.1		3.5		
20	707	60	10.2		3.0		
21	770	66	10.3		3.2		
22	512	42	9.8		3.0		
23	776	65	10.0	7.5	3.5	1.0	
24	574	41	8.6		3.0		
25	526	45	10.3		3.5		
26	412	40	11.6		2.8		
27	575	43	9.0		3.5		
28	525	43	9.8		2.5		
29	538	44	9.8		3.5		
30	497	42	10.1	7.5	3.5	1.2	
31	798	66	9.9		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6

6

SAMPLE DATE: 12-30-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

*File
copy*

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : November, 1996

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : *David E. Humbell*, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	13772	1201	306.5	30.0	91.9	5.2	
AVERAGE	459.1	40.0	10.6	7.5	3.1	1.3	
MAXIMUM	743	65	13.2	7.5	3.5	1.8	
MINIMUM	0	0	8.0	7.5	1.0	0.6	
01	166	15	10.8		2.8		
02	428	40	11.2		3.0		
03	418	42	12.0		3.5		
04	313	27	10.3	7.5	3.5	1.8	
05	551	45	9.8		3.5		
06	349	30	10.3		3.5		
07	318	35	13.2		3.5		On-site well artesian pressure 3
08	10	1	12.0		3.0		Off-site well artesian pressure 2
09	0	0			3.0		
10	246	24	11.7		3.2		
11	497	42	10.1	7.5	3.5	0.6	
12	730	63	10.3		3.5		
13	477	40	10.1		3.0		
14	639	57	10.7		1.0		
15	620	55	10.6		2.4		
16	743	65	10.5		3.0		
17	669	58	10.4		2.8		
18	402	36	10.7		3.5		
19	30	2	8.0	7.5	3.5	1.6	
20	474	41	10.4		2.8		
21	535	47	10.5		3.5		
22	655	53	9.7		3.0		
23	448	41	11.0		2.5		
24	604	43	8.5		1.5		
25	729	61	10.0		3.5		
26	62	6	11.6	7.5	2.4	1.2	
27	587	51	10.4		3.5		
28	672	59	10.5		3.5		
29	675	59	10.5		3.5		
30	725	63	10.4		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-162

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : October, 1996

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : *Randy Adams*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14853	1290	324.5	37.3	95.1	6.6	
AVERAGE	479.1	41.6	10.5	7.5	3.1	1.3	
MAXIMUM	689	60	12.8	7.5	3.5	2.0	
MINIMUM	198	18	9.3	7.4	2.0	0.8	
01	529	46	10.4		3.5		
02	303	32	12.7		3.0		
03	380	34	10.7	7.5	3.5	1.6	
04	372	33	10.6		3.5		
05	526	48	10.9		3.2		
06	479	44	11.0	7.5	2.8		
07	281	25	10.7		3.5	2.0	On-site well artesian pressure 0
08	510	47	11.0		3.0		Off-site well artesian pressure 0
09	375	32	10.2		3.5		
10	551	51	11.1		3.5		
11	375	40	12.8		3.5		
12	676	60	10.6		2.5		
13	533	42	9.4	7.5	2.5		
14	567	53	11.2		3.0	0.8	
15	580	52	10.8		3.5		
16	451	38	10.1		3.0		
17	593	50	10.1		3.0		
18	542	46	10.2		3.5		
19	502	40	9.6		2.0		
20	689	60	10.4		2.7		
21	490	38	9.3		2.6		
22	481	39	9.7	7.4	2.8	1.0	
23	566	45	9.5		3.0		
24	494	41	10.0		3.0		
25	578	46	9.5		3.0		
26	502	44	10.5		3.0		
27	555	46	9.9		3.5		
28	518	45	10.4	7.4	3.0	1.2	
29	351	30	10.2		3.5		
30	306	25	9.8		2.5		
31	198	18	10.9		3.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : September, 1996

PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : David E. Kimball, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16293	1404	309.6	29.8	93.4	6.3	
AVERAGE	543.1	46.8	10.3	7.4	3.1	1.6	
MAXIMUM	780	68	11.6	7.5	3.5	1.8	
MINIMUM	355	29	9.4	7.4	1.9	1.4	
01	582	51	10.5		2.8		
02	573	49	10.3		3.0		
03	598	58	11.6		2.4	1.4	
04	535	49	11.0	7.4	3.5		
05	547	50	11.0		3.5		
06	596	54	10.9		3.5		
07	723	65	10.8		3.5		On-site well artesian pressure 1.5
08	780	68	10.5		3.5		Off-site well artesian pressure 0
09	459	39	10.2	7.5	3.5	1.6	
10	590	52	10.6		3.0		
11	608	52	10.3		3.0		
12	488	42	10.3		3.5		
13	770	63	9.8		3.5		
14	355	32	10.8		2.2		
15	625	54	10.4		2.5		
16	488	41	10.1		2.6		
17	407	34	10.0	7.5	3.0	1.5	
18	769	65	10.1		3.5		
19	510	42	9.9		3.5		
20	556	46	9.9		3.5		
21	500	40	9.6		3.5		
22	558	45	9.7		3.5		
23	472	38	9.7		3.5		
24	435	34	9.4		3.5		
25	356	29	9.8		3.5		
26	432	38	10.5		3.5		
27	500	47	11.3		1.9		
28	563	49	10.4		1.9		
29	558	46	9.9		2.1		
30	360	32	10.7	7.4	3.5	1.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6

SAMPLE DATE: 09-23-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&L

NAME OF DRINKING WATER SY. : ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : August, 1996

PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : David E. Kimbrell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14704	1297	328.8	29.8	100.6	5.5	
AVERAGE	474.3	41.8	10.6	7.4	3.2	1.4	
MAXIMUM	697	63	13.0	7.5	3.5	2.2	
MINIMUM	243	15	6.1	7.4	1.2	0.7	
01	471	48	12.2		2.5		
02	326	30	11.0		3.5		
03	382	37	11.6		3.5		
04	345	34	11.8		3.5		
05	252	24	11.4	7.4	3.5	1.2	
06	538	51	11.4		3.5		
07	346	35	12.1		3.5		On-site well artesian pressure 1
08	374	37	11.9		3.5		Off-site well artesian pressure 2
09	448	38	10.2		3.5		
10	439	40	10.9		3.5		
11	395	20	6.1		3.5		
12	243	15	7.4	7.5	1.2		
13	453	42	11.1		3.5	2.2	
14	244	23	11.3		3.5		
15	287	25	10.4		3.5		
16	468	42	10.8		3.5		
17	534	51	11.5		3.5		
18	688	61	10.6		3.5		
19	517	45	10.4	7.5	3.5	1.4	
20	697	63	10.8		3.5		
21	438	40	11.0		3.5		
22	454	39	10.3		3.5		
23	435	47	13.0		3.0		
24	672	54	9.6		2.7		
25	577	41	8.5		3.0		
26	637	58	10.9	7.4	2.4	0.7	
27	564	49	10.4		2.8		
28	655	55	10.1		3.0		
29	596	51	10.3		3.5		
30	652	60	11.0		3.5		
31	577	42	8.7		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

6

SAMPLE DATE: 08-01-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: ALDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : July, 1996

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : David E. Kimbrell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	13643	1314	363.1	30.0	96.8	4.7	
AVERAGE	440.1	42.4	11.7	7.5	3.1	1.2	
MAXIMUM	796	62	13.2	7.5	3.5	1.4	
MINIMUM	152	16	9.0	7.5	2.2	0.9	
01	418	40	11.5	7.5	3.0	1.2	
02	405	39	11.5		3.0		
03	292	29	11.9		2.4		
04	383	37	11.6		3.5		
05	298	29	11.7		3.5		
06	307	32	12.5		3.0		
07	438	43	11.8		3.2		
08	152	16	12.6		3.1		On-site well artesian pressure 0
09	265	25	11.3	7.5	3.5	1.4	Off-site well artesian pressure 0
10	200	19	11.4		3.5		
11	338	31	11.0		3.5		
12	436	48	13.2		3.5		
13	442	43	11.7		3.2		
14	493	47	11.4		2.2		
15	401	39	11.7	7.5	3.0	0.9	
16	537	54	12.1		3.5		
17	253	27	12.8		3.0		
18	455	48	12.6		3.5		
19	513	51	11.9		3.0		
20	609	57	11.2		2.9		
21	626	59	11.3		2.6		
22	525	51	11.6	7.5	3.0	1.2	
23	481	46	11.5		3.5		
24	410	45	13.2		3.5		
25	523	49	11.2		3.0		
26	743	56	9.0		3.5		
27	457	48	12.6		3.0		
28	438	43	11.8		2.8		
29	796	62	9.3		3.0		
30	407	43	12.7		2.9		
31	602	58	11.6		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 6

SAMPLE DATE: 07-25-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: MAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1996

PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: David E. Kimbrell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3548	345	175.0	7.5	35.6	1.4	
AVERAGE	322.5	31.4	15.9	7.5	3.2	1.4	
MAXIMUM	689	59	47.0	7.5	3.5	1.4	
MINIMUM	45	4	4.5	7.5	2.1	1.4	
01							06/01/96 - 06/19/96 OFF LINE FOR PAINTING
02							
03							
04							
05							
06							
07							On-site well artesian pressure 1.75
08							Off-site well artesian pressure 0.5
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20	51	20	47.0		3.5	1.4	
21	46	13	33.9		3.0		
22	255	25	11.8		3.5		
23	512	48	11.2		2.1		
24	689	59	10.3	7.5	3.5		
25	561	53	11.3		3.5		
26	360	36	12.0		3.5		
27	161	6	4.5		3.5		
28	45	4	10.7		3.5		
29	387	36	11.2		2.5		
30	481	45	11.2		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

6

SAMPLE DATE: 06-20-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: RMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : May, 1996

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Lon Rice, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL							
AVERAGE							
MAXIMUM							
MINIMUM							
01							PLANT OFF LINE FOR REPAIRS.
02							
03							
04							
05							
06							
07							On-site well artesian pressure 0
08							Off-site well artesian pressure 0
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							
31							

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

6

SAMPLE DATE: 05-07-96

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-16

NAME OF DRINKING WATER SYSTEM: ANDERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1996

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: David E. Kirkell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	

MONTHLY TOTAL

AVERAGE

MAXIMUM

MINIMUM

- 01
- 02
- 03
- 04
- 05
- 06
- 07
- 08
- 09
- 10
- 11
- 12
- 13
- 14
- 15
- 16
- 17
- 18
- 19
- 20
- 21
- 22
- 23
- 24
- 25
- 26
- 27
- 28
- 29
- 30

Plant off-line for painting
 On site well artesian pressure N/
 Off site well artesian pressure 7 p

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&2

NAME OF DRINKING WATER SYSTEM: AMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: David E. Kimball, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	

MONTHLY TOTAL
AVERAGE
MAXIMUM
MINIMUM

01
02
03
04
05
06
07
08
09
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31

Plant off-line for painting

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028-N-1&

NAME OF DRINKING WATER SYSTEM: BERMAN PARK WTP

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : February, 1996

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Ron D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	

MONTHLY TOTAL

AVERAGE

MAXIMUM

MINIMUM

- 01
- 02
- 03
- 04
- 05
- 06
- 07
- 08
- 09
- 10
- 11
- 12
- 13
- 14
- 15
- 16
- 17
- 18
- 19
- 20
- 21
- 22
- 23
- 24
- 25
- 26
- 27
- 28
- 29

PLANT OFF LINE FOR PAINTING

LOCATION: 8043 CARLOTTA ROAD NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1996

PLANT EFFLUENT pH: 7.6 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: David E. Humbell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10877	1015	297.3	30.2	74.9	5.3	
AVERAGE	350.9	42.3	12.4	7.6	3.1	1.1	
MAXIMUM	778	70	40.0	7.6	3.5	1.4	
MINIMUM	0	1	10.7	7.5	2.0	0.7	
01	482	49	12.2		3.0		Plant taken off-line for painting and system improvements. 1-24-96 Well #1, Artesian level=15 PSI Well #2, Artesian level=16.5 PS
02	491	50	12.2	7.5	3.0	1.0	
03	555	57	12.3		2.8		
04	525	55	12.6		3.5		
05	402	38	11.3		3.5		
06	469	42	10.7		3.5		
07	659	59	10.7		3.5		
08	778	70	10.8	7.6	2.8	1.0	
09	643	58	10.8		3.5		
10	348	32	11.0		3.5		
11	330	30	10.9		3.5		
12	463	43	11.1		3.5		
13	442	40	10.9		3.5		
14	442	40	10.9		3.0		
15	460	41	10.7		2.6		
16	390	35	10.8	7.6	2.5	0.7	
17	437	40	11.0		2.0		
18	486	45	11.1		3.0	1.4	
19	626	57	10.9		3.0		
20	440	40	10.9		3.0		
21	338	31	11.0		3.0		
22	473	43	10.9	7.5	3.0	1.2	
23	195	19	11.7		3.2		
24	3	1	40.0		3.5		
25	0						
26	0						
27	0						
28	0						
29	0						
30	0						
31	0						

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0022 NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT
 LOCATION: 6710 COLUMBINE DRIVE JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: December, 1996
 PLANT EFFLUENT pH: 7.5 (AVG.) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimbrell, C.O., CERT NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	23205	2492	401.2	37.4	92.6	7.6	
AVERAGE	748.5	80.4	12.9	7.5	3.0	1.5	
MAXIMUM	948	103	18.4	7.5	3.5	1.8	
MINIMUM	440	48	11.4	7.4	1.9	1.0	
01	447	50	13.4		3.0		
02	768	84	13.1	7.4	3.5	1.8	
03	857	89	12.5		2.8		
04	543	54	11.9		3.0		
05	579	55	11.4		3.5		
06	918	97	12.7		2.8		
07	590	64	13.0		1.9		Well artesian pressure 0 psi
08	840	89	12.7		2.4		
09	816	89	13.1	7.5	2.5	1.0	
10	690	76	13.2		3.5		
11	886	93	12.6		3.5		
12	944	96	12.2		2.6		
13	912	95	12.5		3.5		
14	696	74	12.7		2.6		
15	802	84	12.6		2.8		
16	569	62	13.1		3.0		
17	440	48	13.1	7.5	3.5	1.8	
18	741	82	13.3		3.0		
19	914	95	12.5		3.0		
20	948	103	13.0		3.0		
21	734	78	12.7		2.5		
22	853	94	13.2		3.0		
23	831	87	12.6	7.5	3.0	1.4	
24	509	78	18.4		3.5		
25	778	82	12.6		3.5		
26	724	80	13.2		2.5		
27	656	70	12.8		2.7		
28	870	94	13.0		2.5		
29	867	92	12.7		3.0		
30	683	72	12.6	7.5	3.5	1.6	
31	800	86	12.9		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00288

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1996

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimbrell, C.O., CERT NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	21801	2335	387.7	30.0	93.7	6.3	
AVERAGE	726.7	77.8	12.9	7.5	3.1	1.6	
MAXIMUM	958	98	14.7	7.5	3.5	1.8	
MINIMUM	377	41	11.8	7.5	2.0	1.4	
01	857	92	12.9		3.5		
02	918	98	12.8		2.0		
03	876	94	12.9		3.5		
04	800	87	13.0	7.5	3.5	1.6	
05	400	49	14.7		3.5		
06	822	85	12.4		3.5		
07	943	98	12.5		2.2		Well artesian pressure 0 psi
08	953	95	12.0		2.8		
09	958	95	11.9		2.6		
10	808	91	13.5		2.8		
11	661	73	13.2	7.5	3.5	1.4	
12	628	68	13.0		3.5		
13	900	96	12.8		3.5		
14	620	70	13.5		2.4		
15	600	68	13.6		3.5		
16	665	72	13.0		3.5		
17	598	63	12.6		3.5		
18	816	89	13.1	7.5	3.5	1.5	
19	879	92	12.5		2.6		
20	650	71	13.1		2.5		
21	560	60	12.8		3.0		
22	552	61	13.3		3.5		
23	745	80	12.9		3.5		
24	872	86	11.8		3.0		
25	377	41	13.0		2.5		
26	808	85	12.6	7.5	3.5	1.8	
27	785	85	13.0		2.8		
28	590	64	13.0		3.0		
29	548	60	13.1		3.5		
30	612	67	13.1		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0020x NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT
 LOCATION: 6710 COLUMBINE DRIVE JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: October, 1996
 PLANT EFFLUENT pH: 7.5 (AVG.) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Divercamp, C.O., CERT NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	15643	1789	431.8	37.5	93.1	8.4	
AVERAGE	504.6	57.7	13.9	7.5	3.0	1.7	
MAXIMUM	831	92	19.5	7.5	3.5	2.0	
MINIMUM	347	48	12.1	7.5	2.0	1.4	
01	520	61	14.1		3.5		
02	416	48	13.8		3.5		
03	432	53	14.7	7.5	3.5	1.8	
04	485	55	13.6		2.2		
05	467	54	13.9		2.8		
06	428	50	14.0		3.0		
07	494	56	13.6	7.5	3.5	2.0	Well artesian pressure 0 psi
08	470	54	13.8		2.2		
09	412	57	16.6		3.5		
10	460	53	13.8		2.4		
11	430	51	14.2		3.5		
12	609	65	12.8		3.2		
13	474	49	12.4		2.0		
14	350	57	19.5	7.5	3.0	1.4	
15	510	56	13.2		3.5		
16	542	57	12.6		3.5		
17	502	56	13.4		3.0		
18	524	59	13.5		3.0		
19	477	53	13.3		2.3		
20	551	56	12.2		2.5		
21	471	55	14.0		2.8		
22	513	55	12.9	7.5	3.5	1.4	
23	518	59	13.7		3.0		
24	387	50	15.5		3.5		
25	555	61	13.2		3.0		
26	490	55	13.5		2.6		
27	347	50	17.3		3.5		
28	390	49	15.1	7.5	3.5	1.8	
29	831	92	13.3		2.6		
30	792	83	12.6		2.0		
31	796	80	12.1		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1996

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimball, C.O., CERT NO. C-4317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16506	--	1775	390.0	37.5	93.2	8.6
AVERAGE	550.2		59.2	13.0	7.5	3.1	1.7
MAXIMUM	952		100	13.9	7.5	3.5	2.0
MINIMUM	389		41	9.5	7.5	2.0	1.5
01	517		56	13.0		2.8	
02	488		52	12.8		3.0	
03	476		54	13.6	7.5	3.5	1.8
04	534		61	13.7		3.5	
05	414		47	13.6		3.5	
06	540		59	13.1		3.5	
07	549		59	12.9		3.5	Well artesian pressure
08	577		58	12.1		3.0	0 psi
09	490		54	13.2	7.5	3.5	2.0
10	525		60	13.7		3.5	
11	480		53	13.2		3.0	
12	511		56	13.1		3.5	
13	663		72	13.0		3.5	
14	389		41	12.6		2.5	
15	611		68	13.3		2.0	
16	505		54	12.8		2.2	
17	907		72	9.5	7.5	3.0	1.5
18	583		56	11.5		2.4	
19	502		57	13.6		3.2	
20	553		62	13.4		3.5	
21	509		57	13.4		3.5	
22	448		49	13.1		3.5	
23	480		55	13.7	7.5	3.5	1.8
24	744		82	13.2		3.5	
25	952		100	12.6		2.2	
26	587		63	12.9		3.0	
27	477		55	13.8		3.0	
28	547		58	12.7		2.8	
29	482		51	12.7		2.6	
30	466		54	13.9	7.5	3.5	1.5

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 09-23-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-08

NAME OF DRINKING WATER BY COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimball, C.O., CERT NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	25743	2726	393.5	29.9	98.7	5.5	
AVERAGE	830.4	87.9	12.7	7.5	3.2	1.4	
MAXIMUM	1268	138	19.4	7.5	3.5	1.5	
MINIMUM	472	37	8.4	7.4	1.8	1.2	
01	587	95	19.4		3.5		
02	1268	138	13.0		3.5		
03	802	86	12.9		3.0		
04	660	73	13.3		3.5		
05	882	102	13.9	7.4	3.5	1.4	
06	1015	112	13.2		3.5		
07	711	81	13.7		3.5		Well artesian pressure 0 psi
08	929	102	13.2		1.8		
09	975	68	8.4		3.0		
10	890	94	12.7		1.9		
11	860	92	12.8		3.0		
12	862	91	12.7		2.8		
13	828	90	13.0	7.5	2.5	1.2	
14	923	100	13.0		3.5		
15	854	92	12.9		3.5		
16	1072	118	13.2		3.5		
17	853	92	12.9		3.5		
18	929	93	12.0		3.5		
19	1227	122	11.9	7.5	3.5	1.4	
20	830	85	12.3		3.5		
21	822	88	12.8		3.5		
22	963	112	13.9		3.5		
23	886	92	12.5		3.5		
24	989	105	12.7		2.4		
25	930	91	11.7		3.5		
26	631	71	13.5	7.5	3.5	1.5	
27	472	37	9.4		3.5		
28	542	58	12.8		2.4		
29	490	53	13.0		3.5		
30	567	55	11.6		3.0		
31	494	38	9.2		2.9		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 08-01-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0020 NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT
 LOCATION: 6710 COLUMBINE DRIVE JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: July, 1996
 PLANT EFFLUENT pH: 7.5 (AVG.) NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimbrell, C.O., CERT NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	28571	3055	399.8	30.0	95.5	4.8	
AVERAGE	921.6	98.5	12.9	7.5	3.1	1.2	
MAXIMUM	1154	117	17.9	7.5	3.5	1.4	
MINIMUM	596	79	11.7	7.5	1.5	1.0	
01	960	102	12.7	7.5	3.5	1.2	
02	1018	107	12.6		3.5		
03	871	95	13.1		3.5		
04	950	103	13.0		3.0		
05	1011	99	11.7		3.0		
06	782	88	13.5		3.0		
07	841	94	13.4		3.5		Well artesian pressure 0 psi
08	950	101	12.7		3.0		
09	822	91	13.3	7.5	3.0	1.0	
10	900	97	12.9		3.5		
11	924	101	13.1		3.5		
12	1074	117	13.1		2.8		
13	866	94	13.0		3.0		
14	800	79	11.8		2.2		
15	910	99	13.0	7.5	3.5	1.4	
16	920	99	12.9		3.5		
17	596	89	17.9		1.6		
18	868	91	12.6		3.5		
19	942	101	12.9		3.0		
20	1064	111	12.5		2.7		
21	888	93	12.6		1.5		
22	1102	115	12.5	7.5	3.5	1.2	
23	872	91	12.5		3.5		
24	971	97	12.0		3.5		
25	897	97	13.0		3.0		
26	1154	115	11.9		3.5		
27	927	98	12.7		2.9		
28	971	100	12.3		3.1		
29	900	97	12.9		3.0		
30	858	91	12.7		3.0		
31	962	103	12.8		3.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-002

NAME OF DRINKING WATER SYSTEM: ABINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1996

PLANT EFFLUENT pH: 7.6 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy H. Adams Sr., C.O., CERT NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	21533	1969	339.2	30.2	94.9	5.0	
AVERAGE	694.6	63.5	10.9	7.6	3.1	1.3	
MAXIMUM	994	101	12.3	7.6	3.5	1.4	
MINIMUM	487	46	10.4	7.5	2.0	1.0	
01	580	56	11.6		3.5		
02	641	59	11.0		3.2		
03	762	69	10.9		3.2		
04	487	46	11.3		2.5		
05	620	56	10.8		3.5		
06	672	60	10.7	7.6	3.5	1.4	
07	668	58	10.4		3.5		Well artesian pressure
08	650	58	10.7		3.5		0 psi
09	681	59	10.4		3.0		
10	641	59	11.0		3.1		
11	648	59	10.9		2.6		
12	665	60	10.8		2.7		
13	584	53	10.9	7.5	3.5	1.2	
14	623	57	11.0		3.5		
15	675	61	10.8		3.0		
16	736	66	10.8		3.5		
17	646	60	11.1		3.0		
18	666	61	11.0		2.8		
19	607	53	10.5		3.0		
20	713	63	10.6	7.6	3.5	1.4	
21	600	55	11.0		3.5		
22	663	61	11.0		3.2		
23	695	63	10.9		3.5		
24	672	62	11.1		2.8		
25	684	62	10.9		2.5		
26	653	57	10.5		2.0		
27	710	64	10.8		2.2		
28	960	91	11.4	7.5	2.4	1.0	
29	954	90	11.3		3.5		
30	994	90	10.9		3.5		
31	983	101	12.3		2.2		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 05-02-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028H

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1996

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimbrell, C.O., CERT NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18443	1712	334.3	30.1	94.9	4.9	
AVERAGE	614.8	57.1	11.1	7.5	3.2	1.2	
MAXIMUM	687	64	12.2	7.6	3.5	1.5	
MINIMUM	532	50	10.5	7.5	2.4	1.0	
01	608	59	11.6	7.6	3.5	1.5	
02	645	60	11.2		3.5		
03	532	54	12.2		2.6		
04	628	58	11.1		3.0		
05	640	64	12.0		3.0		
06	623	57	11.0		2.4		
07	574	53	11.1		2.7		
08	638	56	10.5		2.6		
09	630	56	10.7	7.5	3.5	1.0	
10	628	58	11.1		3.5		
11	550	54	11.8		3.5		
12	653	60	11.0		3.5		
13	606	55	10.9		2.8		
14	582	53	10.9		3.0		
15	621	57	11.0	7.5	3.0	1.0	
16	573	56	11.7		3.5		
17	653	59	10.8		3.5		
18	606	56	11.1		3.5		
19	677	63	11.2		3.5		
20	537	50	11.2		2.7		
21	682	62	10.9		2.9		
22	628	57	10.9	7.5	3.5	1.4	
23	602	55	11.0		3.5		
24	597	54	10.8		3.5		
25	680	64	11.3		3.5		
26	613	56	11.0		3.0		
27	687	61	10.6		2.7		
28	610	55	10.8		2.5		
29	585	56	11.5		3.5		
30	555	54	11.7		3.5		

Well artesian pressure 0 psi

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: 7.6 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

David E. Kimball, C.O., CERT NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18667	1731	345.1	30.2	98.4	4.8	
AVERAGE	602.2	55.8	11.1	7.6	3.2	1.2	
MAXIMUM	682	64	11.7	7.6	3.5	1.4	
MINIMUM	455	43	9.5	7.5	2.4	1.0	
01	618	57	11.1		3.5		
02	587	54	11.0		3.5		
03	628	56	10.7		2.7		
04	635	59	11.1	7.6	3.5	1.2	
05	590	55	11.2		3.5		
06	600	55	11.0		3.2		
07	593	58	11.7		3.5		
08	645	51	9.5		3.5		
09	654	56	10.3		3.1		
10	570	54	11.4		3.2		
11	615	56	10.9	7.6	3.0		
12	626	58	11.1		3.5	1.0	
13	606	57	11.3		3.5		
14	608	56	11.0		2.6		
15	560	53	11.3		3.0		
16	661	61	11.1		3.1		
17	616	56	10.9		3.4		
18	627	58	11.1	7.5	3.5	1.2	
19	555	53	11.5		2.6		
20	573	55	11.5		3.0		
21	632	61	11.6		2.8		
22	482	46	11.4		3.0		
23	671	62	11.1		3.0		
24	610	56	11.0		3.5		
25	568	54	11.4		3.0		
26	552	53	11.5	7.5	3.5	1.4	
27	612	56	11.0		3.0		
28	616	59	11.5		3.5		
29	682	64	11.3		3.5		
30	620	59	11.4		2.8		
31	455	43	11.3		2.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 03-14-96

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM: COLUMBINE WATER TREATMENT PLANT

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1996

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ron D. Price, C.O., CERT NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17713	1638	321.7	30.0	93.7	4.6	
AVERAGE	610.8	56.5	11.1	7.5	3.2	1.2	
MAXIMUM	742	67	12.0	7.5	3.5	1.4	
MINIMUM	471	43	10.5	7.5	2.0	0.8	
01	603	58	11.5		3.5		ARTESIAN LEVEL 0.4 P S I
02	567	50	10.6		3.0		
03	649	58	10.7		3.2		
04	601	53	10.6		2.9		
05	671	59	10.5	7.5	2.4	1.2	
06	607	56	11.1		3.2		
07	623	58	11.2		3.2		
08	630	59	11.2		3.2		
09	615	58	11.3		3.5		
10	591	55	11.2		3.0		
11	630	57	10.8		3.4		
12	563	54	11.5	7.5	3.5	1.4	
13	580	55	11.4		3.5		
14	592	58	11.7		3.5		
15	582	55	11.3		3.5		
16	717	65	10.9		3.5		
17	587	54	11.0		3.5		
18	629	60	11.4		3.5		
19	471	43	10.9		2.0		
20	604	56	11.1	7.5	3.5	1.2	
21	622	57	11.0		2.8		
22	652	58	10.7		3.5		
23	742	67	10.8		2.8		
24	600	56	11.2		3.5		
25	562	51	10.9		3.2		
26	607	55	10.9	7.5	3.5	0.8	
27	637	58	10.9		3.5		
28	630	63	12.0		3.2		
29	549	52	11.4		3.2		

LOCATION: 6710 COLUMBINE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1996

PLANT EFFLUENT pH: 7.5 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

David E. Kimball

, C.O., CERT NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16494	1635	370.1	45.0	95.3	7.8	
AVERAGE	532.1	52.7	11.9	7.5	3.1	1.6	
MAXIMUM	696	65	15.0	7.5	3.5	3.0	
MINIMUM	420	42	11.0	7.5	2.1	0.5	
01	507	51	12.1		2.8		
02	513	51	11.9	7.5	3.0	0.8	
03	430	45	12.5		3.5		
04	428	45	12.6		3.5		
05	508	54	12.7		3.5		
06	557	54	11.6		3.2		
07	522	51	11.7		3.5		
08	584	56	11.5	7.5	3.0	1.0	
09	573	55	11.5		2.1		
10	515	51	11.9		3.5		
11	618	62	12.0		3.5		
12	441	55	15.0		3.5		
13	567	56	11.8		3.0		
14	446	45	12.1		2.5		
15	552	55	11.9		2.2		
16	515	48	11.2	7.5	3.5	3.0	
17	506	49	11.6		3.5		
18	420	42	12.0		3.5		
19	663	63	11.4	7.5	2.2	0.5	
20	507	52	12.3		2.5		
21	452	46	12.2		3.0		
22	462	49	12.7	7.5	3.5	2.5	
23	510	50	11.8		3.5		
24	579	56	11.6		3.0		
25	620	62	12.0		3.0		
26	567	55	11.6		2.8		
27	597	55	11.0		3.3		
28	696	65	11.2		3.1		
29	493	47	11.4	7.5	2.4		
30	634	60	11.3		3.2		
31	512	50	11.7		3.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0026a

NAME OF DRINKING WATER SYS.: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1996

PLANT EFFLUENT pH: 6.9 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17793	1348	281.6	20.8	79.8	2.1	
AVERAGE	574.0	43.5	9.1	6.9	2.6	0.7	
MAXIMUM	774	65	11.2	7.0	5.0	1.0	
MINIMUM	195	18	6.9	6.9	2.0	0.5	
01	482	36	9.0		2.4		
02	492	41	10.0		2.2		
03	741	58	9.4	6.9	2.5	0.5	
04	465	30	7.7		2.8		
05	469	31	7.9		2.7		
06	706	57	9.7		3.5		
07	567	42	8.9		2.3		Well artesian pressure 0 psi
08	678	53	9.4		2.5		
09	462	31	8.0		2.0		
10	464	31	8.0		2.3		
11	436	25	6.9		2.8		
12	195	18	11.1		2.4		
13	688	45	7.8	7.0	5.0	1.0	
14	558	46	9.9		2.5		
15	492	40	9.7		2.4		
16	574	45	9.4		2.5		
17	552	40	8.7		2.5		
18	498	38	9.1		2.4		
19	743	57	9.2		2.1		
20	774	65	10.1		2.5		
21	568	45	9.5		2.8		
22	681	57	10.0		2.5		
23	613	50	9.8		2.7		
24	544	45	9.9		2.4		
25	570	38	8.0		2.3		
26	642	38	7.1	6.9	2.7	0.6	
27	555	52	11.2		2.2		
28	569	48	10.1		2.5		
29	695	53	9.1		2.3		
30	633	44	8.3		2.4		
31	687	49	8.6		2.7		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 12-10-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028a

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton J. Derrant, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16541	1253	265.4	20.9	78.2	1.4	
AVERAGE	551.4	41.8	8.8	7.0	2.6	0.5	
MAXIMUM	753	110	19.6	7.0	5.0	0.5	
MINIMUM	300	15	5.2	6.9	1.8	0.4	
01	646	54	10.0	7.0	2.4	0.5	
02	674	110	19.6		2.4		
03	555	37	8.0		2.2		
04	667	46	8.3		2.7		
05	718	40	6.7		2.5		
06	573	40	8.4		2.3		
07	491	40	9.8		1.8		Well artesian pressure 0 psi
08	659	67	12.2	6.9	2.3	0.4	
09	753	60	9.6		2.4		
10	549	40	8.7		2.3		
11	597	46	9.2		2.4		
12	491	26	6.3		2.3		
13	300	15	6.0		2.9		
14	517	45	10.4		3.6		
15	348	15	5.2		2.2		
16	609	56	11.0		4.4		
17	530	45	10.2		2.3		
18	548	34	7.4		2.4		
19	664	54	9.8	7.0	2.6	0.5	
20	522	36	8.3		2.6		
21	522	38	8.7		2.4		
22	471	24	6.1		2.6		
23	491	26	6.3		2.7		
24	411	33	9.6		2.4		
25	464	23	5.9		5.0		
26	665	49	8.8		2.6		
27	538	41	9.1		2.5		
28	447	30	8.0		2.0		
29	498	34	8.2		2.6		
30	623	49	9.4		2.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 11-05-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0026

NAME OF DRINKING WATER SYS. ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton J. Overeay

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	23188	1787	287.1	34.8	79.6	2.7	
AVERAGE	748.0	57.6	9.3	7.0	2.6	0.5	
MAXIMUM	1187	92	11.0	7.0	4.3	0.6	
MINIMUM	475	35	8.3	6.9	2.2	0.5	
01	689	51	8.9	7.0	2.8	0.5	
02	700	52	8.9		4.3		
03	714	50	8.4		2.7		
04	710	51	8.6		2.5		
05	777	57	8.8		2.6		
06	706	53	9.0		2.3		
07	780	54	8.3		2.6		Well artesian pressure 0 psi
08	802	61	9.1		2.3		
09	832	62	8.9	6.9	2.4	0.6	
10	683	50	8.8		2.7		
11	640	56	10.5		2.5		
12	1187	92	9.3		2.6		
13	475	35	8.8		2.4		
14	823	64	9.3		2.5		
15	730	53	8.7		2.5		
16	845	67	9.5	7.0	2.5	0.5	
17	762	56	8.8		2.6		
18	878	61	8.3		2.6		
19	752	56	8.9		2.6		
20	779	59	9.1		2.4		
21	727	65	10.7		2.8		
22	632	54	10.2	6.9	2.2	0.6	
23	644	56	10.4		2.5		
24	690	52	9.0		2.7		
25	902	69	9.2		2.4		
26	812	67	9.9		2.6		
27	884	63	8.5		2.2		
28	807	67	10.0		2.6		
29	475	38	9.6	7.0	2.5	0.5	
30	709	65	11.0		2.4		
31	642	51	9.5		2.3		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 10-10-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18580	--	1484	293.1	14.0	74.8	1.2
AVERAGE	619.3		49.5	9.8	7.0	2.5	0.6
MAXIMUM	876		85	21.0	7.0	3.7	0.6
MINIMUM	120		21	8.1	7.0	1.2	0.6
01	576		46	9.6		2.4	
02	516		37	8.6		2.4	
03	546		39	8.6		2.5	
04	573		39	8.2		2.4	
05	490		38	9.3	7.0	2.5	0.6
06	539		41	9.1		2.2	
07	589		42	8.6		2.5	Well artesian pressure
08	631		45	8.6		2.3	0 psi
09	533		38	8.5		2.5	
10	547		37	8.1		2.4	
11	532		36	8.1		2.5	
12	403		31	9.2		2.5	
13	718		78	13.0		2.3	
14	448		35	9.4		2.5	
15	581		41	8.5		2.3	
16	507		39	9.2		2.5	
17	504		35	8.3		3.2	
18	120		21	21.0		2.6	
19	727		78	12.9		1.2	
20	848		85	12.0		2.4	
21	818		74	10.8		2.7	
22	757		52	8.2		2.5	
23	757		59	9.3		2.6	
24	697		60	10.3		2.5	
25	666		48	8.6		2.5	
26	756		65	10.3		3.7	
27	768		59	9.2	7.0	2.8	0.6
28	876		68	9.3		2.3	
29	820		63	9.2		2.1	
30	737		55	8.9		3.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 6.9 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton J. Jureaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16354	1244	286.5	20.8	67.9	1.6	
AVERAGE	527.5	40.1	9.5	6.9	2.2	0.5	
MAXIMUM	768	72	20.5	7.0	5.0	0.6	
MINIMUM	0	0	5.5	6.9	0.0	0.5	
01	554	61	13.2		2.2		
02	768	72	11.2		1.4		
03	538	40	8.9		2.0		
04	563	39	8.3		2.9		
05	656	52	9.5		1.3		
06	630	47	8.9		1.7		
07	558	41	8.8		0.8		
08	702	53	9.1	6.9	2.6	0.5	Well artesian pressure 0 psi
09	715	33	5.5		2.5		
10	738	55	8.9		2.3		
11	673	54	9.6		2.4		
12	668	50	9.0		2.4		
13	490	34	8.3		2.4		
14	557	38	8.2		2.4		
15	706	43	7.3		2.5		
16	503	36	8.6	6.9	2.4	0.6	
17	388	26	8.0		2.6		
18	123	14	13.6		2.7		
19	0	0			0.0		
20	41	7	20.5		0.6		
21	445	33	8.9		5.0		
22	625	62	11.9		2.6		
23	268	18	8.1		2.4		
24	371	25	8.1		1.0		
25	652	55	10.1		2.5		
26	538	41	9.1		2.0		
27	571	43	9.0	7.0	2.4	0.5	
28	601	43	8.6		2.5		
29	535	41	9.2		2.5		
30	692	52	9.0		2.5		
31	485	36	8.9		2.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 08-05-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028H

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Dovereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	21475	1749	324.4	27.8	77.2	2.2	
AVERAGE	692.7	56.4	10.5	7.0	2.5	0.6	
MAXIMUM	1106	109	36.0	7.0	4.4	0.6	
MINIMUM	140	34	6.7	6.9	1.5	0.5	
01	802	51	7.6		3.5		
02	766	56	8.8		2.5		
03	753	54	8.6		2.8		
04	758	54	8.5		2.1		
05	683	50	8.8		2.5		
06	456	34	8.9		2.1		
07	607	44	8.7		2.7		
08	719	51	8.5	6.9	2.4	0.5	Well artesian pressure 0 psi
09	710	51	8.6		2.2		
10	831	54	7.8		2.3		
11	721	40	6.7		1.5		
12	704	49	8.3		2.1		
13	703	51	8.7		2.1		
14	675	47	8.3		2.4		
15	509	55	13.0		2.9		
16	527	53	12.1	7.0	4.4	0.6	
17	1106	109	11.8		2.4		
18	739	53	8.6		2.2		
19	713	52	8.7		2.5		
20	814	60	8.8		2.6		
21	682	50	8.8		2.4		
22	645	55	10.2		1.8		
23	867	81	11.2		2.3		
24	522	46	10.6	6.9	2.6	0.5	
25	635	70	13.2		3.1		
26	140	42	36.0		2.1		
27	855	83	11.6		3.2		
28	824	75	10.9		2.3		
29	554	49	10.6		2.2		
30	798	74	11.1		2.5		
31	657	56	10.2	7.0	2.5	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 07-08-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0026

NAME OF DRINKING WATER SYSTEM ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

David E. Kimbrell, C.O., CERT. NO. C-4317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	23779	1805	273.7	21.1	73.3	2.6	
AVERAGE	792.6	60.2	9.1	7.0	2.4	0.9	
MAXIMUM	1243	97	14.8	7.1	3.3	1.1	
MINIMUM	541	40	7.7	7.0	2.0	0.5	
01	1015	79	9.3		2.1		
02	1048	78	8.9		2.3		
03	987	76	9.2	7.0	2.4	1.0	
04	1243	80	7.7		2.5		
05	992	75	9.1		2.6		
06	982	75	9.2		2.5		
07	829	59	8.5		2.0		Well artesian pressure 0 psi
08	833	64	9.2		2.4		
09	852	64	9.0		2.4		
10	782	57	8.7		2.3		
11	585	46	9.4	7.1	2.5	1.1	
12	767	57	8.9		2.5		
13	815	59	8.7		2.3		
14	800	60	9.0		3.3		
15	720	55	9.2		2.6		
16	743	56	9.0		2.4		
17	717	60	10.0		2.2		
18	753	56	8.9	7.0	2.4	0.5	
19	777	58	9.0		2.4		
20	722	55	9.1		2.7		
21	724	53	8.8		3.0		
22	630	50	9.5		2.2		
23	768	51	8.0		2.3		
24	641	47	8.8		2.3		
25	787	97	14.8		2.4		
26	541	40	8.9		2.0		
27	642	45	8.4		2.8		
28	760	55	8.7		2.3		
29	669	48	8.6		2.7		
30	655	50	9.2		2.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028a

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton Demeroux

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	33718	2647	275.5	20.9	70.3	1.8	
AVERAGE	1087.7	85.4	9.2	7.0	2.3	0.6	
MAXIMUM	1466	112	10.1	7.0	3.0	0.8	
MINIMUM	0	48	8.1	6.9	1.5	0.5	
01	917	62	8.1		2.0		
02	787	53	8.1		1.9		
03	1232	100	9.7		2.2		
04	1052	82	9.3		2.2		
05	1100	82	8.9		1.9		
06	1240	92	8.9		1.9		
07	1149	87	9.1		1.5		Well artesian pressure
08	1175	90	9.2	7.0	2.0	0.5	0 psi
09	1008	85	10.1		1.9		
10	1195	94	9.4		2.5		
11	1118	88	9.4		2.6		
12	1214	95	9.4		2.1		
13	1143	88	9.2		2.2		
14	1137	82	8.6		2.2		
15	1240	96	9.3		2.4		
16	1108	87	9.4		2.5		
17	1233	96	9.3		2.4		
18	1327	103	9.3	7.0	1.9	0.5	
19	1178	92	9.4		2.8		
20	1367	107	9.4		1.8		
21	893	67	9.0		2.5		
22	1175	99	10.1		3.0		
23	1180	94	9.6		2.7		
24	1199	93	9.3		2.2		
25	1308	104	9.5		2.4		
26	1292	95	8.8		1.8		
27	1466	112	9.2		2.3		
28	800	59	8.8	6.9	2.5	0.8	
29	681	48	8.5		2.9		
30	804	61	9.1		2.4		
31	0	54			2.7		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 05-07-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00208

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimbrell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	31121	2267	261.7	21.1	58.8	1.5	
AVERAGE	1037.4	75.6	8.7	7.0	2.0	0.5	
MAXIMUM	1288	98	9.7	7.1	2.8	0.5	
MINIMUM	661	43	7.5	7.0	1.6	0.5	
01	991	62	7.5		2.2		<i>Well artesion pressure 0 psi</i>
02	825	67	9.7	7.1	2.0	0.5	
03	966	68	8.4		1.7		
04	960	70	8.7		2.8		
05	1072	76	8.5		1.8		
06	1103	82	8.9		2.0		
07	1031	79	9.2		2.2		
08	1228	86	8.4		1.9		
09	734	59	9.6	7.0	2.0	0.5	
10	1070	80	9.0		1.7		
11	910	64	8.4		1.9		
12	1135	82	8.7		2.2		
13	1138	85	9.0		1.9		
14	1190	90	9.1		1.8		
15	898	60	8.0		2.0		
16	1031	72	8.4		2.0		
17	661	43	7.8		1.9		
18	973	69	8.5		2.1		
19	1104	78	8.5		1.9		
20	1017	77	9.1		1.7		
21	1286	98	9.1		1.7		
22	1053	77	8.8		2.0		
23	1204	97	9.7		1.9	0.5	
24	1076	78	8.7	7.0	2.0		
25	1114	80	8.6		1.8		
26	1026	72	8.4		2.0		
27	1255	90	8.6		1.6		
28	1288	98	9.1		2.0		
29	1035	73	8.5		2.0		
30	747	55	8.8		2.1		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028

NAME OF DRINKING WATER SYS.: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

David E. Kimball

, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	28536	2224	290.4	21.1	71.7	1.6	
AVERAGE	920.5	71.7	9.4	7.0	2.3	0.5	
MAXIMUM	1214	102	10.9	7.1	3.9	0.6	
MINIMUM	726	53	6.2	7.0	1.3	0.5	
01	847	68	9.6		2.7		
02	834	76	10.9		3.9		
03	1015	88	10.4		2.4		
04	882	74	10.1		1.6		
05	781	59	9.1		1.9		
06	865	68	9.4	7.0	3.4	0.6	
07	964	76	9.5		2.3		
08	846	65	9.2		2.4		
09	938	79	10.1		1.7		
10	951	74	9.3		2.8		
11	936	74	9.5		2.9		
12	784	60	9.2		3.0		
13	871	68	9.4		2.1		
14	912	79	10.4	7.1	1.9	0.5	
15	824	67	9.7		1.7		
16	1210	102	10.1		3.3		
17	1162	98	10.1		3.1		
18	726	64	10.6		2.4		
19	826	66	9.6		2.3		
20	848	62	8.8		1.3		
21	989	77	9.3		3.0		
22	798	53	8.0		1.9		
23	1214	63	6.2		1.9		
24	979	74	9.1		1.9		
25	1010	70	8.3	7.0	2.2	0.5	
26	956	72	9.0		2.1		
27	838	60	8.6		1.8		
28	925	73	9.5		2.2		
29	1050	82	9.4		1.8		
30	903	70	9.3		1.8		
31	852	63	8.9		2.0		

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0

NAME OF DRINKING WATER SYSTEM: ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy H. Adams Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	26967	2088	267.7	28.0	68.6	2.9	
AVERAGE	929.9	72.0	9.2	7.0	2.4	0.7	
MAXIMUM	1269	142	13.4	7.1	3.9	1.0	
MINIMUM	747	46	6.1	6.9	1.2	0.5	
01	920	57	7.4	7.0	2.9	0.6	ARTESIAN LEVEL 0# P S I
02	903	53	7.0		2.2		
03	981	74	9.0		2.4		
04	1000	79	9.5		2.5		
05	1269	142	13.4		2.1		
06	1180	89	9.0		3.9		
07	856	63	8.8		3.0		
08	906	46	6.1		1.2		
09	936	70	9.0		1.9		
10	861	71	9.9		1.8		
11	914	79	10.4		2.2		
12	865	70	9.7		2.3		
13	862	58	8.1	6.9	2.2	0.5	
14	904	65	8.6		3.3		
15	813	66	9.7		1.9		
16	1124	91	9.7		3.7		
17	871	69	9.5		3.0		
18	967	73	9.1		1.9		
19	747	57	9.1		1.7	0.8	
20	880	69	9.4	7.0	2.8		
21	921	72	9.4		1.9		
22	930	72	9.3		2.6		
23	1003	80	9.6		2.3		
24	842	68	9.7		1.2		
25	838	73	10.4		1.8		
26	990	78	9.4		2.4		
27	934	70	9.0	7.1	2.7	1.0	
28	935	70	9.0		1.5		
29	815	64	9.4		3.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-002

NAME OF DRINKING WATER SYS ELVIA WATER TREATMENT PLANT

LOCATION: 7755 ELVIA DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	MG/L REMOTE TAP	
MONTHLY TOTAL	22214	1500	251.6	27.9	68.5	2.0	
AVERAGE	716.6	48.4	8.1	7.0	2.2	0.5	
MAXIMUM	986	65	9.5	7.0	2.8	0.5	
MINIMUM	541	35	5.4	6.9	1.8	0.5	
01	619	49	9.5		1.9		0 psi artesian at well head
02	712	51	8.6		2.2		
03	607	41	8.1		2.5		
04	611	42	8.2		2.8		
05	578	38	7.9	7.0	1.9	0.5	
06	712	49	8.3		1.9		
07	736	49	8.0		2.4		
08	892	62	8.3		1.8		
09	673	44	7.8		2.4		
10	658	44	8.0		2.4		
11	808	56	8.3		2.1		
12	604	42	8.3		2.1		
13	780	54	8.3		2.3		
14	541	43	9.5		1.8		
15	771	52	8.1	6.9	2.4	0.5	
16	815	58	8.5		2.4		
17	700	49	8.4		2.5		
18	578	39	8.1		2.6		
19	776	51	7.9		2.2		
20	662	44	8.0		2.2		
21	755	52	8.3		1.8		
22	545	37	8.1		2.4		
23	728	51	8.4	7.0	2.4	0.5	
24	774	35	5.4		2.2		
25	734	53	8.7		2.3		
26	864	63	8.7		2.0		
27	755	59	9.4		2.2		
28	986	65	7.9		1.9		
29	726	42	6.9		2.4		
30	764	44	6.9		1.8		
31	750	42	6.7	7.0	2.3	0.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 01-04-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028X

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1996

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Lon Pica C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19095	2015	392.6	21.5	98.2	2.8	
AVERAGE	616.0	65	12.7	7.2	3.2	0.9	
MAXIMUM	744	78	14.3	7.2	3.5	1.0	
MINIMUM	450	46	11.3	7.1	2.1	0.8	
01	518	52	12.0		3.5		
02	588	60	12.2		2.8		
03	450	46	12.3		3.5		
04	627	63	12.0	7.2	3.5	1.0	
05	590	60	12.2		3.5		
06	665	65	11.7		2.5		
07	609	67	13.2		2.1		Well artesian pressure 0 psi
08	593	61	12.3		3.0		
09	659	69	12.6		3.5		
10	561	63	13.5		3.5		
11	631	69	13.1		3.5		
12	614	66	12.9		3.2	1.0	
13	664	70	12.6		3.5		
14	611	66	13.0		2.6		
15	624	69	13.3		2.8		
16	650	68	12.5	7.2	3.5		
17	572	61	12.8		3.0		
18	659	69	12.6		2.8		
19	598	65	13.0		3.0		
20	688	65	11.3		3.5		
21	595	62	12.5		3.0		
22	552	59	12.8		3.1		
23	730	77	12.6		3.5		
24	531	63	14.2		3.5		
25	636	76	14.3		3.5		
26	637	68	12.8	7.1	3.0	0.8	
27	582	61	12.6		2.5		
28	636	65	12.3		3.5		
29	633	66	12.5		3.5		
30	648	66	12.2		3.5		
31	744	78	12.6		2.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 12-10-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT:

Milton Doreault

C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18548	2047	397.6	21.3	93.5	2.3	
AVERAGE	618.3	68	13.3	7.1	3.1	0.8	
MAXIMUM	690	76	14.6	7.2	3.5	1.0	
MINIMUM	541	59	12.0	7.0	2.0	0.6	
01	618	69	13.4		3.5		
02	670	76	13.6		3.0		
03	621	72	13.9		3.5		
04	622	71	13.7	7.0	3.5	0.7	
05	627	68	13.0		3.0		
06	625	69	13.2		3.3		
07	590	67	13.6		2.5		Well artesian pressure 0 psi
08	681	76	13.4		3.5		
09	541	66	14.6		2.8		
10	602	70	13.9		3.0		
11	629	72	13.7	7.1	3.5		
12	577	68	14.1		3.0		
13	649	73	13.5		3.5		
14	584	70	14.4		3.5		
15	593	71	14.4		3.0	0.6	
16	671	70	12.5		3.5		
17	543	65	14.4		3.5		
18	619	70	13.6		2.8		
19	655	68	12.4		2.5		
20	616	71	13.8		2.6		
21	602	64	12.7		2.0		
22	606	61	12.1		3.5	1.0	
23	605	63	12.5		2.5		
24	659	66	12.0		2.5		
25	554	59	12.8	7.2	3.0		
26	602	63	12.5		3.5		
27	690	72	12.5		3.5		
28	618	65	12.6		3.0		
29	605	62	12.3		3.5		
30	674	70	12.5		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

8

SAMPLE DATE: 11-14-96

PWS ID NO. 2161326 CUP NO. 2-031-0028X

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1996

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Ron D. Price C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	MG/L REMOTE TAP	
MONTHLY TOTAL	19306	2209	426.2	28.8	98.2	3.5	
AVERAGE	622.8	71	13.7	7.2	3.2	0.9	
MAXIMUM	798	94	15.9	7.2	3.5	1.0	
MINIMUM	553	58	10.9	7.2	2.0	0.8	
01	649	72	13.3		3.0		
02	627	69	13.2		2.0		
03	667	69	12.4		3.5	1.0	
04	590	66	13.4		3.0		
05	640	70	13.1		2.8		
06	595	74	14.9		3.0		
07	571	63	13.2		3.0		Well artesian pressure 0 psi
08	617	71	13.8		2.5		
09	599	69	13.8	7.2	3.5		
10	636	58	10.9		3.5	0.8	
11	610	79	15.5		3.0		
12	663	77	13.9		3.5		
13	656	75	13.7		3.5		
14	588	78	15.9		3.2		
15	712	73	12.3	7.2	3.0		
16	582	72	14.8		3.5		
17	553	73	15.8		3.5	0.8	
18	673	76	13.5		3.5		
19	604	70	13.9		3.5		
20	630	69	13.1		3.5		
21	601	68	13.6		3.0		
22	640	72	13.5	7.2	3.5	0.9	
23	648	73	13.5		3.5		
24	593	68	13.7		3.5		
25	798	94	14.1		2.9		
26	573	66	13.8		3.5		
27	565	71	15.1		3.5		
28	624	71	13.6		2.8		
29	635	72	13.6	7.2	2.5		
30	565	64	13.6		3.5		
31	602	67	13.3		2.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 10-15-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1996

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT:

Lon Price C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18799	2127	406.9	28.1	95.0	3.6	
AVERAGE	626.6	71	13.6	7.0	3.2	0.9	
MAXIMUM	796	86	14.3	7.1	3.5	1.0	
MINIMUM	445	48	11.2	7.0	2.0	0.8	
01	644	60	11.2		3.0		
02	568	66	13.9		3.0		
03	647	74	13.7	7.0	3.0		
04	695	80	13.8		3.5		
05	586	67	13.7		2.0	0.8	
06	626	74	14.2		3.5		
07	677	79	14.0		3.5		Well artesian pressure
08	626	72	13.8		3.0		0 psi
09	627	69	13.2		3.5		
10	695	82	14.1		3.5		
11	580	67	13.9		3.5		
12	658	74	13.5		3.5	1.0	
13	796	86	13.0	7.1	3.5		
14	445	48	12.9		3.0		
15	668	78	14.0		3.5		
16	597	66	13.3		2.8		
17	682	78	13.7		2.8		
18	546	65	14.3		3.2		
19	628	74	14.1	7.0	2.8	0.8	
20	665	79	14.2		3.1		
21	629	75	14.3		3.5		
22	602	71	14.1		3.5		
23	621	68	13.1		2.8		
24	601	68	13.6		3.1		
25	609	66	13.0		3.0		
26	623	71	13.7		3.5		
27	645	71	13.2		3.0	1.0	
28	630	69	13.1		2.9		
29	582	64	13.2		3.5		
30	601	66	13.2	7.0	3.0		

Well artesian pressure 0 psi

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 09-23-96

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESHRY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT:

Ron Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE NG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19703	2288	430.7	29.0	99.5	3.3	
AVERAGE	635.6	74	13.9	7.3	3.2	0.8	
MAXIMUM	865	106	18.2	7.3	3.5	1.0	
MINIMUM	492	55	12.2	7.2	1.5	0.7	
01	662	77	13.9		3.5		
02	697	106	18.2		3.5		
03	658	82	14.9		3.5		
04	492	55	13.4		3.5		
05	601	68	13.6	7.2	3.5		
06	596	68	13.7		3.5		
07	652	72	13.2		3.5	1.0	Well artesian pressure 0 psi
08	602	68	13.5		2.8		
09	678	75	13.3		3.0		
10	632	67	12.7		3.1		
11	567	68	14.4		3.3		
12	592	65	13.2	7.2	3.0	0.8	
13	651	81	14.9		3.5		
14	638	67	12.6		2.8		
15	574	61	12.7		3.1		
16	798	101	15.2		3.5		
17	558	63	13.5		3.5		
18	619	73	14.1		3.5		
19	865	103	14.3	7.3	1.5	0.8	
20	556	67	14.4		2.5		
21	603	73	14.5		3.2		
22	641	76	14.2		3.5		
23	602	72	14.3		3.5		
24	676	69	12.2		3.0		
25	588	68	13.9		3.2		
26	639	75	14.1	7.3	3.5	0.7	
27	712	83	14.0		3.0		
28	670	74	13.2		3.5		
29	682	75	13.2		3.5		
30	648	74	13.7		3.0		
31	554	62	13.4		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 08-05-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1996

PLANT EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Ron Rice

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	20070	1893	350.8	21.8	84.6	3.3	
AVERAGE	647.4	61	11.3	7.3	2.7	0.8	
MAXIMUM	816	81	14.7	7.3	3.5	1.0	
MINIMUM	542	40	8.7	7.2	2.0	0.7	
01	678	68	12.0		2.0	0.8	
02	625	67	12.9		2.5		
03	596	52	10.5		3.5		
04	604	54	10.7		3.0		
05	733	56	9.2		3.5		
06	575	47	9.8		3.5		
07	619	66	12.8		3.0		Well artesian pressure 0 psi
08	592	65	13.2	7.3	2.5		
09	583	57	11.7		3.5		
10	619	58	11.2		3.5		
11	736	81	13.2		2.8	0.8	
12	625	66	12.7		3.0		
13	596	65	13.1		3.2		
14	542	40	8.8		3.5		
15	660	48	8.7	7.3	2.5		
16	609	53	10.4		2.3		
17	609	53	10.4		2.0		
18	657	57	10.4		2.5	1.0	
19	598	57	11.4		2.5		
20	734	66	10.8		2.8		
21	694	61	10.5		2.2		
22	683	68	11.9		2.5		
23	687	66	11.5		2.0		
24	632	62	11.8		2.2		
25	679	64	11.3		3.0		
26	816	72	10.6		2.5		
27	649	58	10.7		2.2		
28	604	53	10.5		2.6		
29	758	66	10.4		2.8		
30	649	70	12.9		3.0		
31	629	77	14.7	7.2	2.0	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

8

SAMPLE DATE: 07-08-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SY. : LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : June, 1996

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Don D. Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE NG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19546	2153	397.3	28.7	98.4	3.5	
AVERAGE	651.5	72	13.2	7.2	3.3	0.9	
MAXIMUM	781	92	17.7	7.2	3.5	1.0	
MINIMUM	573	57	10.7	7.1	2.0	0.7	
01	752	75	12.0		3.5		
02	781	90	13.8		3.5		
03	693	68	11.8	7.1	3.5		
04	649	71	13.1		3.5		
05	743	88	14.2		3.0	0.8	
06	773	75	11.6		3.5		
07	612	68	13.3		3.5		Well artesian pressure 0 psi
08	617	66	12.8		3.5		
09	658	65	11.8		3.5		
10	639	68	12.8		3.5		
11	660	74	13.4	7.2	3.5		
12	596	64	12.9		3.5		
13	644	72	13.4		3.0	1.0	
14	698	78	13.4		3.5		
15	603	70	13.9		3.0		
16	588	72	14.7		2.8		
17	700	72	12.3		3.5		
18	573	70	14.6	7.2	3.5		
19	622	92	17.7		3.5		
20	653	70	12.9		3.0	0.7	
21	648	77	14.2		3.0		
22	584	72	14.8		3.2		
23	615	75	14.6		2.8		
24	622	57	11.0		3.1		
25	767	86	13.4	7.2	3.5	1.0	
26	594	58	11.7		3.0		
27	582	76	15.7		3.5		
28	646	63	11.7		3.5		
29	639	57	10.7		3.5		
30	595	64	12.9		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 06-04-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : May, 1996

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Lon Price C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	25437	2747	403.1	21.6	98.9	3.7	
AVERAGE	820.5	89	13.0	7.2	3.2	0.9	
MAXIMUM	1009	111	15.9	7.4	3.5	1.0	
MINIMUM	591	64	11.0	7.0	2.0	0.8	
01	676	74	13.1		3.5		
02	781	92	14.1		3.5	1.0	
03	947	103	13.0		3.5		
04	616	69	13.4		2.8		
05	988	111	13.5		3.5		
06	990	91	11.0	7.4	3.2		
07	747	75	12.0		3.0		Well artesian pressure 0 psi
08	825	93	13.5		2.0		
09	834	91	13.1		3.5	0.8	
10	790	89	13.5		3.0		
11	1009	101	12.0		3.2		
12	985	111	13.5		3.2		
13	706	72	12.2		3.5		
14	766	81	12.7	7.0	3.5		
15	869	98	13.5		2.0		
16	832	98	14.1		3.5	1.0	
17	940	91	11.6		3.5		
18	934	103	13.2		3.0		
19	908	99	13.1		3.0		
20	814	85	12.5		3.5		
21	834	84	12.1		3.0		
22	647	86	15.9		3.0		
23	811	78	11.5		3.5		
24	925	92	11.9		2.0	0.9	
25	954	100	12.6		3.5		
26	818	85	12.5		3.5		
27	953	108	13.6		3.5		
28	682	80	14.1	7.2	3.5		
29	616	71	13.8		3.5		
30	649	72	13.3		3.5		
31	591	64	13.0		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 05-02-96

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER 'EM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH : April, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Ron D. Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	22607	2349	374.2	28.3	81.6	3.8	
AVERAGE	753.6	78	12.5	7.1	2.7	1.0	
MAXIMUM	1034	111	14.2	7.2	3.5	1.0	
MINIMUM	606	63	10.5	7.0	1.0	0.8	
01	659	64	11.6		3.5		
02	606	63	12.5	7.2	2.7		
03	700	63	10.8		2.5		
04	644	65	12.1		2.7	1.0	
05	722	81	13.5		2.9		
06	693	67	11.6		2.6		
07	689	73	12.7		3.0		
08	725	77	12.7		3.5		
09	747	81	13.0	7.1	2.5		
10	797	80	12.0		2.6		
11	806	86	12.8		2.2		
12	743	76	12.3		3.5	1.0	
13	912	80	10.5		3.0		
14	821	80	11.7		2.8		
15	634	69	13.0	7.0	2.3		
16	654	72	13.2		3.0		
17	772	82	12.7		2.8		
18	747	79	12.7		2.0	0.8	
19	878	86	11.7		3.0		
20	692	82	14.2		2.8		
21	842	82	11.7		3.0		
22	751	76	12.1		2.6		
23	779	78	12.0	7.0	2.5		
24	789	84	12.8		1.5		
25	746	82	13.2		2.5	1.0	
26	730	81	13.3		2.6		
27	1034	111	12.9		3.5		
28	898	102	13.6		3.0		
29	770	81	12.6		1.0		
30	627	66	12.6		3.5		

Well artesian pressure 0 psi

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

8

SAMPLE DATE: 04-04-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028H

NAME OF DRINKING WATER SYSTEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Ron D. Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	21265	2120	372.4	28.7	93.5	3.7	
AVERAGE	686.0	68	12.0	7.2	3.0	0.9	
MAXIMUM	891	81	14.7	7.2	3.5	1.1	
MINIMUM	548	50	9.6	7.1	1.5	0.8	
01	695	63	10.9		3.5		
02	600	52	10.4		3.5		
03	745	66	10.6		3.5		
04	780	79	12.1	7.2	2.5		
05	722	67	11.1		3.2		
06	891	72	9.7		3.0		
07	656	74	13.5		2.6	0.8	
08	680	75	13.2		3.0		
09	723	71	11.8		3.1		
10	628	77	14.7		3.2		
11	731	70	11.5	7.2	3.5		
12	690	78	13.6		2.8		
13	725	75	12.4		2.7		
14	608	72	14.2		2.5	0.8	
15	587	58	11.8		3.0		
16	761	81	12.8		3.0		
17	655	75	13.7		3.2		
18	680	63	11.1		3.0		
19	640	61	11.4	7.2	3.5		
20	629	73	13.9		2.7		
21	684	70	12.3		3.2	1.0	
22	568	50	10.6		3.5		
23	870	70	9.6		3.5		
24	705	60	10.2		1.5		
25	716	70	11.7	7.1	2.3		
26	684	63	11.0		2.5		
27	626	71	13.6		2.4		
28	661	68	12.3		3.5	1.1	
29	712	74	12.5		3.1		
30	665	69	12.4		3.5		
31	548	53	11.6		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 03-07-96

PWS ID NO. 2161326 CUP NO. 2-031-0028X

NAME OF DRINKING WATER IEM: LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1996

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Ron D. Price C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	21218	2026	330.6	21.5	83.9	2.6	
AVERAGE	731.7	70	11.4	7.2	2.9	0.9	
MAXIMUM	988	103	15.7	7.2	3.7	1.0	
MINIMUM	555	44	8.5	7.1	1.5	0.8	
01	591	44	8.9		3.5		ARTESIAN LEVEL 0 # P S I
02	676	48	8.5		2.5		
03	555	46	9.9		2.2		
04	739	62	10.1		2.6		
05	811	60	8.9		1.5		
06	789	103	15.7		1.8		
07	663	49	8.9	7.2	2.5	0.8	
08	654	74	13.6		2.6		
09	642	56	10.5		3.5		
10	857	77	10.8		3.5		
11	704	62	10.6		3.0		
12	712	76	12.8		3.2		
13	642	59	11.0		2.5		
14	627	65	12.4	7.1	3.5		
15	673	62	11.0		3.7	1.0	
16	871	84	11.6		2.5		
17	730	70	11.5		3.0		
18	885	94	12.7		3.5		
19	658	66	12.0		2.5		
20	656	63	11.5		2.8		
21	769	78	12.2	7.2	3.5		
22	760	80	12.6		2.5	0.8	
23	988	100	12.1		3.0		
24	863	92	12.8		3.5		
25	762	67	10.5		3.5		
26	851	78	11.0		3.0		
27	701	67	11.5		2.0		
28	730	63	10.3		3.0		
29	659	81	14.7		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2161326 CUP NO. 2-031-0028N

NAME OF DRINKING WATER SYS. LAKE LUCINA WTP

LOCATION: 2530 CESERY BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1996

PLANT EFFLUENT pH: 7.2 (AVG)

NO. OF SERVICES AT END OF MONTH

DESIGN FLOW:

PHONE NO. (MAIN OFFICE) (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT :

Ren D. Price

C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE NG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19815	1821	340.5	28.7	92.7	2.7	
AVERAGE	639.2	59	11.0	7.2	3.0	0.9	
MAXIMUM	792	85	13.6	7.2	3.5	1.0	
MINIMUM	502	40	8.7	7.1	2.0	0.8	
01	567	57	12.1		2.8		WELL ARTESIAN LEVEL 04 PSI
02	635	50	9.4		3.5		
03	648	60	11.1	7.2	3.0	1.0	
04	637	48	9.0		3.2		
05	663	58	10.5		2.5		
06	632	52	9.9		3.5		
07	581	50	10.3		2.8		
08	634	57	10.8		3.1		
09	751	85	13.6		2.5		
10	502	40	9.6		3.5		
11	676	74	13.1	7.1	3.5	0.9	
12	591	55	11.2		3.0		
13	681	61	10.7		3.0		
14	616	59	11.5		3.0		
15	650	62	11.4	7.2	3.5		
16	681	63	11.1		3.5		
17	649	47	8.7		2.5		
18	555	52	11.2		2.5		
19	792	75	11.4		2.3		
20	600	68	13.6		3.5		
21	541	46	10.2		3.5		
22	633	62	11.7		2.9		
23	652	58	10.7		3.1		
24	574	54	11.3		2.8		
25	715	69	11.6		3.0		
26	675	63	11.2		3.2		
27	627	50	9.6		2.6		
28	627	46	8.8		2.6		
29	683	73	12.8		2.0		
30	719	69	11.5	7.2	2.8	0.8	
31	628	58	11.1		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 8

SAMPLE DATE: 01-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-002b.

NAME OF DRINKING WATER SYS.: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1996

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Lon Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	716	85	87.8	7.3	14.6	0.8	
AVERAGE	143.2	17.0	17.6	7.3	2.9	0.8	
MAXIMUM	215	27	30.0	7.3	3.5	0.8	
MINIMUM	16	4	7.3	7.3	2.0	0.8	
01	138	16	13.9		3.0		12/06/96-PLANT OFF LINE FOR PAINTING
02	195	25	15.4		2.6		
03	215	13	7.3		3.5		
04	152	27	21.3	7.3	2.0	0.8	
05	16	4	30.0		3.5		
06							
07							Well artesian pressure 0 psi
08							
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							
21							
22							
23							
24							
25							
26							
27							
28							
29							
30							
31							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimbrell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	6685	--	612	364.6	21.5	87.5	10.0
AVERAGE	222.8		20.4	12.2	7.2	2.9	2.5
MAXIMUM	330		32	57.2	7.2	3.5	7.2
MINIMUM	65		5	6.5	7.1	1.5	0.9
01	267		25	11.2		3.5	
02	311		26	10.0		3.5	
03	325		26	9.6		3.0	
04	258		20	9.3	7.1	2.5	
05	315		30	11.4		2.3	
06	209		14	8.0		1.8	
07	289		28	11.6		2.5	0.9 Well artesian pressure
08	230		19	9.9		2.8	
09	266		22	9.9		2.6	
10	315		32	12.2		2.0	
11	263		26	11.9	7.2	3.5	
12	146		12	9.9		3.5	
13	223		18	9.7		3.5	
14	170		15	10.6		2.0	0.9
15	73		5	8.2		3.5	
16	237		18	9.1		3.5	
17	220		17	9.3		3.5	
18	260		23	10.6		2.8	
19	244		16	7.9		2.0	
20	222		18	9.7		2.2	
21	181		16	10.6		3.5	1.0
22	65		31	57.2		2.5	
23	200		19	11.4		1.5	
24	330		18	6.5		3.5	
25	189		24	15.2	7.2	2.5	7.2
26	201		18	10.7		3.5	
27	180		24	16.0		3.5	
28	148		14	11.3		3.5	
29	120		12	12.0		3.5	
30	228		26	13.7		3.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326

C.U.P. NO. 2-031-0026

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNIFIED WATER FLORIDA, INC.

REPORTING MONTH: October, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron D. Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10235	1016	364.6	28.7	95.8	3.9	
AVERAGE	330.2	32.8	11.8	7.2	3.1	1.0	
MAXIMUM	476	57	15.1	7.2	3.5	1.0	
MINIMUM	212	18	9.5	7.1	2.4	0.9	
01	301	30	12.0		3.0		
02	269	28	12.5		3.5		
03	212	18	10.2		3.5	1.0	
04	236	20	10.2		3.0		
05	255	25	11.8		3.1		
06	311	33	12.7		2.8		
07	292	24	9.9		3.5		Well artesian pressure 0 psi
08	297	26	10.5		2.8		
09	304	26	10.3	7.1	2.5		
10	301	25	10.0		2.5	0.9	
11	223	18	9.7		2.5		
12	403	32	9.5		3.5		
13	387	40	12.4		3.0		
14	416	45	13.0		2.6		
15	364	40	13.2	7.2	3.0		
16	364	38	12.5		3.5		
17	370	39	12.6		3.5	1.0	
18	308	34	13.2		3.5		
19	305	33	13.0		3.5		
20	453	57	15.1		3.5		
21	359	35	11.7		3.5		
22	363	41	13.5		2.5		
23	340	31	10.9		3.5		
24	338	30	10.6	7.2	3.0	1.0	
25	476	57	14.4		2.8		
26	345	41	14.2		2.4		
27	293	30	12.3		3.0		
28	403	35	10.4		2.8		
29	308	28	10.9	7.2	3.0		
30	369	31	10.1		3.5		
31	270	26	11.5		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 10-15-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028N

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ron Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	11080	--	1130	379.8	28.6	91.3	2.5
AVERAGE	369.3		37.7	12.7	7.2	3.0	0.8
MAXIMUM	567		70	24.6	7.2	3.5	1.0
MINIMUM	263		23	6.1	7.1	2.4	0.5
01	319		39	14.7		2.5	
02	435		40	11.0		2.5	
03	302		30	11.9	7.2	3.5	
04	399		36	13.1		3.5	
05	330		31	11.5		2.5	1.0
06	322		34	8.3		3.0	
07	493		46	9.9		2.8	Well artesian pressure
08	558		48	16.4		2.7	0 psi
09	350		39	14.3		2.4	
10	326		34	14.4		3.5	
11	284		32	10.0		3.0	
12	383		45	11.7	7.2	3.5	1.0
13	463		54	24.6		3.5	
14	263		29	6.1		3.0	
15	567		53	18.1		3.5	
16	350		35	10.5		3.0	
17	400		45	11.9		2.8	
18	454		70	22.1		3.0	
19	379		39	12.6		3.2	
20	372		39	14.3		2.6	
21	326		35	13.1		3.0	
22	321		33	8.8		3.5	
23	448		35	16.0	7.1	2.8	0.5
24	263		23	8.4		3.0	
25	327		27	10.1		3.5	
26	321		32	12.7		3.0	
27	301		30	9.0		3.5	
28	401		38	11.4		3.2	
29	354		32	10.8		3.0	
30	269		27	12.0	7.1	2.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326

C.U.P. NO. 2-031-002

NAME OF DRINKING WATER SYS

UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH:

August, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron Rice

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	11546	1441	474.7	28.8	87.4	3.4	
AVERAGE	372.5	46.5	15.3	7.2	2.8	0.9	
MAXIMUM	650	78	26.1	7.4	3.5	1.0	
MINIMUM	248	25	8.7	7.0	1.5	0.6	
01	353	45	15.3		2.5		
02	372	35	11.3		3.5		
03	320	39	14.6		2.0		
04	260	38	17.5		3.0		
05	341	46	16.2	7.2	3.5		
06	341	46	16.2		3.5		
07	299	37	14.8		3.5	1.0	Well artesian pressure
08	344	25	8.7		3.5		0 psi
09	370	78	25.3		3.0		
10	380	62	19.6		2.7		
11	272	40	17.6		2.8		
12	303	39	15.4	7.2	3.0	1.0	
13	290	33	13.6		3.5		
14	297	30	12.1		2.8		
15	260	31	14.3		2.9		
16	355	43	14.5		3.5		
17	375	47	15.0		3.2		
18	553	53	11.5		3.0		
19	650	66	12.2	7.0	2.2	0.6	
20	392	49	15.0		3.5		
21	336	50	17.8		2.7		
22	248	54	26.1		2.5		
23	338	54	19.2		3.0		
24	551	54	11.8		2.7		
25	495	54	13.1		2.0		
26	395	54	16.4	7.4	2.7	0.8	
27	504	54	12.8		2.0		
28	441	55	15.0		3.5		
29	429	54	15.1		1.5		
30	359	41	13.7		1.5		
31	323	35	13.0		2.2		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 08-05-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0020K

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	11834	1152	365.0	28.8	87.4	3.8	
AVERAGE	381.7	37.2	11.8	7.2	2.8	1.0	
MAXIMUM	604	55	14.8	7.2	3.5	1.0	
MINIMUM	192	20	9.3	7.2	1.5	0.8	
01	374	30	9.6		1.8	1.0	
02	388	48	14.8		2.0		
03	287	31	13.0		3.5		
04	314	35	13.4		3.5		
05	320	33	12.4		3.5		
06	192	20	12.5		3.0		
07	281	26	11.1		3.5		Well artesian pressure
08	265	25	11.3	7.2	3.5		0 psi
09	244	25	12.3		1.5		
10	270	21	9.3		3.5		
11	380	47	14.8		3.2	1.0	
12	270	32	14.2		2.8		
13	293	33	13.5		3.0		
14	308	28	10.9		3.2		
15	395	36	10.9	7.2	3.5		
16	353	33	11.2		3.0		
17	353	33	11.2		3.0		
18	441	39	10.6		3.5	0.8	
19	387	33	10.2		2.5		
20	582	52	10.7		2.5		
21	500	50	12.0		2.6		
22	480	39	9.7		2.5		
23	508	44	10.4	7.2	2.5		
24	314	31	11.8		2.2		
25	397	37	11.2		2.5		
26	604	48	9.5		2.0		
27	480	55	13.7		2.5		
28	413	40	11.6		3.0		
29	522	50	11.5		2.5		
30	449	47	12.6		2.8		
31	470	51	13.0	7.2	2.8	1.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 07-02-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0028 NAME OF DRINKING WATER SYST UNIVERSITY PARK W.T.P.
 LOCATION: 3703 CAVANAUGH DRIVE JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: June, 1996
 PLANT EFFLUENT pH: 7.1 (AVG.) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Ron D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10431	1046	365.3	28.5	80.7	3.4	
AVERAGE	347.7	34.9	12.2	7.1	2.7	0.9	
MAXIMUM	579	57	23.7	7.2	3.5	1.0	
MINIMUM	238	23	10.0	7.0	1.7	0.6	
01	516	44	10.2		2.5		
02	579	57	11.8		2.0		
03	409	42	12.3	7.0	2.8		
04	462	45	11.7		2.7		
05	490	44	10.8		2.3		
06	512	43	10.1		2.5	0.6	
07	346	39	13.5		1.7		Well artesian pressure 0 psi
08	340	35	12.3		3.5		
09	364	35	11.5		3.5		
10	354	34	11.5		2.0		
11	365	38	12.5	7.2	2.3		
12	281	29	12.4		2.0		
13	340	35	12.3		2.3	1.0	
14	259	30	13.9		2.7		
15	315	30	11.4		3.0		
16	317	32	12.1		2.8		
17	356	36	12.1		3.0		
18	333	32	11.5	7.1	3.5		
19	288	29	12.1		3.0		
20	340	35	12.3		3.0	0.8	
21	268	53	23.7		2.5		
22	238	23	11.6		2.9		
23	278	24	10.4		2.0		
24	369	35	11.4		3.5		
25	313	40	15.3	7.2	2.2		
26	258	25	11.6		3.5		
27	260	25	11.5		3.0	1.0	
28	277	24	10.4		2.5		
29	276	23	10.0		3.5		
30	328	30	11.0		2.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326

C.U.P. NO. 2-031-0028

NAME OF DRINKING WATER SYS.

UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH:

May, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	16222	1676	383.3	28.8	87.4	3.7	
AVERAGE	523.3	54.1	12.4	7.2	2.8	0.9	
MAXIMUM	733	84	16.4	7.4	3.5	1.0	
MINIMUM	250	26	10.3	7.0	2.0	0.8	
01	374	38	12.2		3.5		
02	460	54	14.1		3.5	1.0	
03	630	74	14.1		3.0		
04	403	55	16.4		2.5		
05	673	84	15.0		3.5		
06	618	59	11.4	7.4	2.8		
07	524	48	11.0		2.9		Well artesian pressure 0 psi
08	557	52	11.2		2.0		
09	544	50	11.0		3.5	0.8	
10	449	46	12.3		3.1		
11	595	56	11.3		2.8		
12	550	55	12.0		3.0		
13	553	56	12.1	7.2	2.8		
14	530	52	11.8		3.0		
15	567	60	12.7		2.5		
16	523	54	12.4		2.0	0.9	
17	565	56	11.9		2.8		
18	580	65	13.4		2.3		
19	573	50	10.5		2.8		
20	608	59	11.6	7.0	3.5		
21	561	61	13.0		2.0		
22	453	45	11.9		2.2		
23	571	55	11.5		2.7		
24	579	64	13.3		2.0		
25	623	77	14.8		3.0		
26	616	58	11.3		2.5		
27	733	77	12.6		2.7		
28	250	28	13.4		3.5		
29	301	30	12.0		3.5		
30	286	26	10.9	7.2	3.0	1.0	
31	373	32	10.3		2.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 05-02-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1996

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Lon D. Rice, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	12992	1278	353.0	28.5	87.3	3.6	
AVERAGE	433.1	42.6	11.8	7.1	2.9	0.9	
MAXIMUM	577	70	15.2	7.2	3.5	1.0	
MINIMUM	291	24	6.4	7.0	1.0	0.7	
01	363	39	12.9		3.5		<i>Well artesian pressure Ops</i>
02	351	35	12.0	7.2	3.0		
03	389	41	12.6		3.5		
04	418	37	10.6		2.5	1.0	
05	416	51	14.7		2.4		
06	429	45	12.6		2.5		
07	393	40	12.2		2.7		
08	449	46	12.3		3.0		
09	466	47	12.1	7.2	2.2		
10	469	48	12.3		3.2		
11	291	26	10.7		3.0		
12	449	24	6.4		3.5	1.0	
13	444	35	9.5		1.0		
14	553	41	8.9		3.0		
15	327	33	12.1	7.0	3.0		
16	372	27	8.7		3.5		
17	470	46	11.7		2.9		
18	416	47	13.5		2.0	0.9	
19	478	41	10.3		3.5		
20	385	33	10.3		1.5		
21	533	55	12.4		3.5		
22	439	54	14.7		2.6		
23	456	43	11.3		2.8		
24	504	50	11.9		2.0	0.7	
25	462	49	12.7	7.1	3.5		
26	431	45	12.5		3.5		
27	577	62	12.9		3.5		
28	553	70	15.2		3.5		
29	399	38	11.4		3.5		
30	310	30	11.6		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0026

NAME OF DRINKING WATER SYS.: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron D. Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	11472	1236	411.5	28.5	96.1	4.0	
AVERAGE	370.1	39.9	13.3	7.1	3.1	1.0	
MAXIMUM	548	57	20.0	7.2	3.5	1.2	
MINIMUM	216	28	8.7	7.0	2.0	0.8	
01	347	33	11.4		3.5		
02	350	28	9.6		3.3		
03	411	46	13.4		2.7		
04	395	44	13.4	7.2	2.5		
05	355	41	13.8		3.2		
06	373	37	11.9		3.5		
07	315	37	14.1		3.5	0.8	
08	402	45	13.4		3.5		
09	448	48	12.8		3.2		
10	470	43	11.0		2.9		
11	375	45	14.4	7.0	3.5		
12	372	46	14.8		2.3		
13	363	37	12.2		3.5		
14	453	33	8.7		2.5	1.0	
15	321	39	14.6		2.0		
16	425	51	14.4		2.8		
17	406	38	11.2		2.6		
18	407	39	11.5	7.2	2.8		
19	216	36	20.0		2.9		
20	325	46	17.0		3.5		
21	227	36	19.0		3.5	1.2	
22	318	31	11.7		3.5		
23	548	44	9.6		3.5		
24	466	40	10.3		3.5		
25	322	35	13.0	7.1	3.5		
26	317	29	11.0		3.5		
27	388	30	9.3		3.0		
28	330	39	14.2		2.5	1.0	
29	436	57	15.7		3.5		
30	319	38	14.3		3.1		
31	272	45	19.8		2.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 03-12-96

PNS ID NO. 216-1326 C.U.P. NO. 2-031-

NAME OF DRINKING WATER SYSTEM: UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron D. Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	11587	1195	359.8	21.6	84.9	2.5	
AVERAGE	399.6	41.2	12.4	7.2	2.9	0.8	
MAXIMUM	586	58	15.4	7.2	3.5	1.0	
MINIMUM	281	30	9.1	7.2	1.0	0.7	
01	340	36	12.7		3.5		ARTESIAN LEVEL 04 P S I
02	281	36	15.4		3.5		
03	396	40	12.1		3.2		
04	555	58	12.5		2.9		
05	586	54	11.0		2.5		
06	384	38	11.9	7.2	3.5	0.7	
07	395	30	9.1		3.3		
08	374	35	11.2		3.0		
09	385	40	12.5		2.2		
10	394	45	13.7		1.7		
11	394	31	9.4		2.7		
12	413	35	10.2		2.6		
13	376	38	12.1		1.0		
14	347	38	13.1	7.2	3.5		
15	390	43	13.2		3.0	0.8	
16	488	56	13.8		3.5		
17	412	45	13.1		3.0		
18	402	43	12.8		1.5		
19	351	38	13.0		3.0		
20	351	34	11.6	7.2	2.8		
21	355	39	13.2		3.5		
22	370	41	13.3		3.5	1.0	
23	477	54	13.6		3.5		
24	386	43	13.4		3.5		
25	391	50	15.3		3.0		
26	411	32	9.3		3.5		
27	412	50	14.6		3.0		
28	418	39	11.2		3.0		
29	353	34	11.5		2.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-002a

NAME OF DRINKING WATER SYS. UNIVERSITY PARK W.T.P.

LOCATION: 3703 CAVANAUGH DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1996

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ron D. Price

, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	MG/L REMOTE TAP	
MONTHLY TOTAL	10105	1021	300.7	28.3	93.2	2.8	
AVERAGE	326.0	32.9	12.3	7.1	3.0	0.9	
MAXIMUM	515	51	16.7	7.2	3.5	1.0	
MINIMUM	173	20	8.1	7.0	1.8	0.8	
01	320	29	10.9		2.8		WELL ARTESIAN LEVEL 04 PSI
02	298	31	12.5		3.5		
03	286	30	12.6	7.1	3.0	1.0	
04	303	27	10.7		3.5		
05	293	35	14.3		3.0		
06	346	42	14.6		3.0		
07	371	28	9.0		2.8		
08	515	38	8.8		2.0		
09	342	34	11.9		2.5		
10	287	31	13.0		3.5		
11	358	33	11.1	7.2	3.5	0.8	
12	233	27	13.9		1.8		
13	306	30	11.8		3.0		
14	370	37	12.0		3.5		
15	342	36	12.6	7.0	3.0		
16	308	31	12.1		3.5		
17	287	26	10.9		3.5		
18	173	20	13.9		3.5		
19	338	34	12.1		3.5		
20	282	36	15.3		3.2		
21	270	33	14.7		2.6		
22	250	25	12.0		2.5		
23	472	40	10.2		2.2		
24	288	40	16.7		2.9		
25	336	37	13.2		3.0		
26	317	36	13.6		3.1		
27	408	45	13.2		2.6		
28	425	51	14.4		3.5		
29	339	23	8.1		3.2		
30	339	29	10.3	7.0	2.5	1.0	
31	303	27	10.7		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 01-11-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

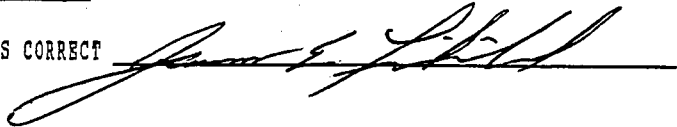

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1341.0	90.0	256.2	145.9	60.7	18.8	
AVERAGE	43.3	2.9	8.3	7.3	2.0	0.9	
MAXIMUM	81.0	5.0	15.5	7.4	3.5	2.0	
MINIMUM	29.0	1.0	3.9	7.2	0.6	0.4	
01	42.0	2.0	5.7		2.2		
02	39.0	2.0	6.2	7.3	2.2	0.5	
03	31.0	4.0	15.5	7.3	0.6	0.4	
04	36.0	3.0	10.0	7.2	3.5	1.8	
05	40.0	3.0	9.0	7.2	3.5	2.0	
06	31.0	1.0	3.9	7.2	1.8	1.4	
07	40.0	2.0	6.0		1.5		
08	42.0	4.0	11.4		1.6		
09	47.0	2.0	5.1	7.3	1.8	0.9	
10	40.0	2.0	6.0	7.3	1.6	0.7	
11	40.0	3.0	9.0	7.3	1.7	0.5	
12	39.0	3.0	9.2	7.3	2.4	1.1	
13	35.0	2.0	6.9	7.4	1.8	0.7	
14	39.0	2.0	6.2		1.8		
15	30.0	3.0	12.0		2.0		
16	45.0	2.0	5.3	7.4	1.8	0.8	
17	45.0	3.0	8.0	7.3	1.6	0.9	
18	36.0	2.0	6.7	7.3	1.8	1.0	
19	81.0	5.0	7.4	7.3	1.6	0.7	
20	75.0	4.0	6.4	7.3	1.6	0.8	
21	52.0	5.0	11.5		1.8		
22	45.0	4.0	10.7		2.0		
23	32.0	4.0	15.0	7.3	1.9	0.7	
24	54.0	5.0	11.1		2.1		
25	44.0	3.0	8.2		2.1		
26	49.0	2.0	4.9	7.3	2.0	0.9	
27	39.0	4.0	12.3	7.3	2.2	1.0	
28	47.0	3.0	7.7		2.2		
29	35.0	2.0	6.9		2.0		
30	62.0	2.0	3.9	7.3	2.0	1.0	
31	29.0	2.0	8.3	7.3	2.0	1.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 12-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *James E. [Signature]*, C.O., CERT. NO. C-7537

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1215.0	52.0	159.8	153.1	44.3	18.1	
AVERAGE	40.5	1.7	5.3	7.3	1.5	0.9	
MAXIMUM	63.0	3.0	11.6	7.3	2.2	6.0	
MINIMUM	28.0	1.0	2.2	7.2	0.1	0.4	
01	46.0	1.0	2.6	7.3	1.4	0.6	
02	44.0	2.0	5.5		1.3		
03	63.0	2.0	3.8		1.3		
04	41.0	1.0	2.9	7.3	1.2	6.0	
05	32.0	2.0	7.5	7.3	1.2	0.5	
06	55.0	1.0	2.2	7.3	1.4	0.6	
07	44.0	2.0	5.5	7.3	1.4	0.8	
08	28.0	1.0	4.3	7.3	1.2	0.6	
09	43.0	1.0	2.8		0.1		
10	37.0	1.0	3.2		1.3		
11	48.0	1.0	2.5	7.3	1.4	0.7	
12	40.0	1.0	3.0	7.3	1.2	0.4	
13	42.0	3.0	8.6	7.3	1.2	0.4	
14	43.0	2.0	5.6	7.3	1.3	0.4	
15	28.0	1.0	4.3	7.3	1.3	0.5	
16	48.0	2.0	5.0		1.3		
17	38.0	1.0	3.2		1.2		
18	41.0	2.0	5.9	7.3	1.0	0.5	
19	36.0	1.0	3.3	7.3	1.4	0.5	
20	39.0	2.0	6.2	7.3	1.2	0.4	
21	31.0	3.0	11.6	7.2	1.8	0.6	
22	31.0	2.0	7.7	7.2	2.0	0.8	
23	40.0	2.0	6.0		2.2		
24	46.0	2.0	5.2		2.2		
25	45.0	2.0	5.3	7.3	2.2	0.7	
26	38.0	2.0	6.3	7.3	2.0	0.9	
27	32.0	2.0	7.5	7.3	1.8	0.8	
28	45.0	2.0	5.3	7.3	2.1	0.8	
29	37.0	2.0	6.5	7.3	1.7	0.6	
30	34.0	3.0	10.6		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 11-13-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

AS TO NO. 2168381 C.F.P. NO. 2-031-0040X NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLAND DRIVE JACKSONVILLE, FLA., DUVAL COUNTY

WWD BY: UNITED WATER FLORIDA INC. REPORTING MONTH: October 1996

WANT TREATMENT PH: 7.3(AVG) NO. OF SERVICES AT END OF MONTH: _____

ESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

SYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	mg/l	EFFLUENT PH	RESIDUAL CHLORINE		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
					PLANT EFFLUENT	SKOOTE TAP	

01	61.0	1.0	2.0	7.3	1.4	0.6	
02	37.0	1.0	3.2	7.3	1.2	0.6	
03	41.0	1.0	2.9	7.3	1.4	0.8	
04	25.0	1.0	4.8	7.3	1.6	0.7	
05	45.0	2.0	5.3		1.5		
06	47.0	2.0	5.1		1.7		
07	38.0	2.0	6.3	7.3	1.2	0.6	
08	39.0	1.0	3.1	7.3	1.2	0.5	
09	37.0	1.0	3.2	7.3	1.5	0.6	
10	38.0	1.0	3.2	7.3	1.5	0.8	
11	40.0	1.0	3.0	7.3	1.4	0.6	
12	40.0	1.0	3.0		1.2		
13	47.0	2.0	5.1		1.4		
14	42.0	1.0	2.9	7.3	1.2	0.5	
15	34.0	1.0	3.5	7.3	1.2	0.6	
16	42.0	1.0	2.9	7.3	1.4	0.8	
17	51.0	2.0	4.7	7.3	1.4	0.6	
18	46.0	2.0	5.2	7.3	1.2	0.5	
19	41.0	1.0	2.9		1.3		
20	49.0	2.0	4.9		1.3		
21	32.0	2.0	7.5	7.3	1.5	0.6	
22	44.0	2.0	5.5	7.3	1.4	0.7	
23	40.0	1.0	3.0	7.3	1.4	0.5	
24	39.0	1.0	3.1	7.3	1.2	0.6	
25	42.0	1.0	2.9	7.3	1.3	0.4	
26	49.0	1.0	2.4		1.2		
27	75.0	2.0	3.2		1.4		
28	42.0	2.0	5.7	7.3	1.2	0.5	
29	50.0	2.0	4.8	7.3	1.2	0.7	
30	31.0	1.0	3.9	7.3	1.2	0.5	
31	41.0	1.0	2.9	7.3	1.4	0.6	

AVG PH 7.3
AVG CHL 3.9
AVG RES 1.3
AVG SKOOTE 0.6
TOTAL 1325.0
TOTAL CHL 43.0
TOTAL RES 41.7
TOTAL SKOOTE 13.9

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160381 C.U.P. NO. 2-031-0040X

NAME OF DRINKING WATER SYSTEM: ST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLAKE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996


AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

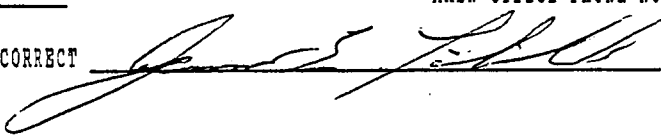 , C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1400.0	40.0	104.6	153.6	41.6	12.3	
BERGAGE	46.7	1.3	3.5	7.3	1.4	0.6	
MINIMUM	65.0	2.0	8.6	7.4	1.6	0.8	
MINIMUM	28.0	1.0	2.1	7.3	1.2	0.5	
01	35.0	1.0	3.4		1.6		
02	48.0	1.0	2.5		1.4		
03	48.0	1.0	2.5	7.3	1.2	0.5	
04	42.0	1.0	2.9	7.3	1.4	0.7	
05	39.0	1.0	3.1	7.3	1.2	0.6	
06	48.0	2.0	5.0	7.3	1.4	0.7	
07	52.0	2.0	4.6	7.3	1.5		
08	47.0	2.0	5.1		1.6		
09	47.0	2.0	5.1		1.4	0.6	
10	48.0	1.0	2.5	7.3	1.4	0.5	
11	44.0	1.0	2.7	7.3	1.4	0.7	
12	40.0	1.0	3.0	7.3	1.6	0.7	
13	37.0	1.0	3.2	7.3	1.4	0.6	
14	55.0	1.0	2.2	7.3	1.4		
15	57.0	1.0	2.1		1.4		
16	40.0	1.0	3.0		1.2	0.5	
17	51.0	1.0	2.4	7.3	1.4	0.7	
18	45.0	1.0	2.7	7.4	1.2	0.5	
19	51.0	2.0	4.7	7.4	1.2	0.6	
20	28.0	2.0	8.6	7.4	1.2	0.5	
21	51.0	2.0	4.7	7.3	1.4		
22	65.0	2.0	3.7		1.3		
23	44.0	1.0	2.7		1.4	0.7	
24	49.0	1.0	2.4	7.3	1.2	0.7	
25	48.0	1.0	2.5	7.3	1.4	0.5	
26	51.0	2.0	4.7	7.3	1.4	0.7	
27	57.0	2.0	4.2	7.3	1.6	0.8	
28	51.0	1.0	2.4	7.3	1.5		
29	47.0	1.0	2.6		1.5		
30	35.0	1.0	3.4	7.3	1.4	0.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 09-11-96

REMARKS:

SEAWATER WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

3 ID NO. 2150331 C.U.P. NO. 2-031-0349

NAME OF DRINKING WATER SYSTEM: SST BROOK WATER TREATMENT PLANT

CARTON: 5855 OAKLAKE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

ORDER BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996

Avg EFFLUENT PH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

SIGN BELOW: _____

MAIN OFFICE PHONS NO. (904) 725-2866

CERTIFY THIS REPORT IS CORRECT

_____, C.O., CERT. NO. C-7537

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
TOTAL	1676.0	69.0	145.0	38.9	11.9
AVERAGE	54.1	2.2	7.3	1.3	0.6
MINIMUM	69.0	5.0	7.3	1.5	0.8
MAXIMUM	35.0	1.0	7.3	1.0	0.5
01	48.0	2.0	7.3	1.1	0.5
02	44.0	2.0	7.3	1.1	0.5
03	51.0	2.0	4.7	1.2	
04	66.0	2.0	3.6	1.1	
05	54.0	2.0	4.4	1.2	0.6
06	58.0	3.0	6.2	1.0	0.5
07	62.0	3.0	5.8	1.2	0.7
08	47.0	4.0	10.2	1.2	0.5
09	61.0	5.0	9.8	1.3	0.5
10	52.0	3.0	6.9	1.5	
11	65.0	4.0	7.4	1.5	
12	43.0	2.0	5.6	1.5	
13	56.0	1.0	2.1	1.3	0.7
14	50.0	2.0	4.8	1.2	0.6
15	50.0	2.0	4.8	1.2	0.7
16	35.0	2.0	6.9	1.1	0.6
17	52.0	2.0	4.6	1.2	
18	61.0	2.0	3.9	1.4	
19	63.0	2.0	3.8	1.4	
20	59.0	2.0	4.1	1.2	0.7
21	56.0	2.0	4.3	1.2	0.6
22	64.0	2.0	3.8	1.1	0.5
23	45.0	2.0	5.3	1.1	0.5
24	65.0	2.0	3.7	1.2	
25	69.0	2.0	3.5	1.3	
26	45.0	1.0	2.7	1.4	0.6
27	50.0	1.0	2.4	1.2	0.7
28	60.0	2.0	4.0	1.2	0.5
29	57.0	2.0	4.2	1.4	0.6
30	46.0	2.0	5.2	1.4	0.8
31	42.0	2.0	5.7	1.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 08-15-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY-

S ID NO. 2160381 C.U.P. NO. 2-031-0040X

NAME OF DRINKING WATER SYSTEM REST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996


AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DIRECTION OF FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1722.0	53.0	113.1	168.1	35.0	11.4	
AVERAGE	55.5	1.7	3.6	7.3	1.1	0.5	
MINIMUM	94.0	4.0	9.0	7.4	1.8	0.7	
MINIMUM	8.0	0.0	0.0	7.3	1.0	0.4	
01	61.0	1.0	2.0	7.3	1.0	0.4	
02	45.0	1.0	2.6	7.3	1.1	0.6	
03	49.0	1.0	2.4	7.3	1.0	0.4	
04	58.0	2.0	4.1		1.1		
05	31.0	1.0	3.9	7.3	1.3	0.4	
06	53.0	2.0	4.5		1.8		
07	49.0	1.0	2.4		1.0		
08	47.0	1.0	2.6	7.3	1.1	0.4	
09	29.0	1.0	4.1	7.3	1.0	0.6	
10	8.0	0.0	0.0	7.3	1.2	0.5	
11	58.0	1.0	2.1	7.3	1.0	0.4	
12	40.0	3.0	9.0	7.3	1.2	0.7	
13	39.0	2.0	6.2		1.5		
14	66.0	2.0	3.6		1.5		
15	59.0	1.0	2.0	7.4	1.0	0.5	
16	55.0	1.0	2.2	7.4	1.0	0.6	
17	46.0	1.0	2.6	7.3	1.2	0.4	
18	67.0	2.0	3.6	7.3	1.0	0.6	
19	68.0	2.0	3.5	7.3	1.0	0.4	
20	94.0	3.0	3.8	7.3	1.2	0.6	
21	79.0	2.0	3.0		1.2		
22	68.0	2.0	3.5	7.3	1.0	0.4	
23	58.0	1.0	2.1	7.3	1.1	0.6	
24	53.0	2.0	4.5	7.3	1.0	0.5	
25	53.0	2.0	4.5	7.3	1.0	0.4	
26	49.0	3.0	7.3	7.3	1.0	0.4	
27	60.0	3.0	6.0		1.0		
28	92.0	4.0	5.2		1.3		
29	56.0	1.0	2.1	7.3	1.2	0.7	
30	67.0	2.0	3.6	7.3	1.0	0.5	
31	64.0	2.0	3.8	7.3	1.0	0.4	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 07-22-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160381 C.U.P. NO. 2-031-0040X

NAME OF DRINKING WATER SYSTEM: WEST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996


AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

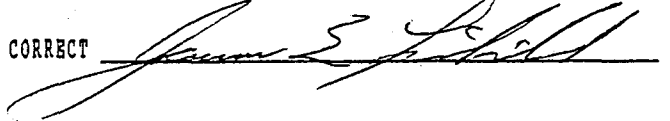

, C.O., CERT. NO. C-7537

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1619.0	55.0	115.1	159.2	35.4	12.3	
AVERAGE	54.0	1.8	3.8	7.2	1.2	0.6	
MINIMUM	84.0	7.0	10.4	7.3	1.6	0.8	
MINIMUM	34.0	1.0	1.8	7.2	0.8	0.4	
01	65.0	1.0	1.8	7.2	1.4	0.7	
02	81.0	7.0	10.4	7.2	1.5	0.7	
03	68.0	3.0	5.3	7.3	1.6	0.6	
04	72.0	4.0	6.7	7.3	1.2	0.5	
05	83.0	5.0	7.2	7.2	1.4	0.7	
06	84.0	3.0	4.3	7.2	1.2	0.6	
07	48.0	1.0	2.5	7.2	0.8	0.4	
08	58.0	1.0	2.1		1.4		
09	49.0	2.0	4.9		1.2		
10	51.0	3.0	7.1	7.3	1.0	0.5	
11	44.0	2.0	5.5	7.3	1.2	0.6	
12	46.0	1.0	2.6	7.2	1.4	0.4	
13	41.0	1.0	2.9	7.2	1.2	0.4	
14	56.0	2.0	4.3	7.2	1.2	0.6	
15	42.0	2.0	5.7		1.2		
16	60.0	2.0	4.0		1.3		
17	45.0	1.0	2.7	7.3	1.0	0.4	
18	46.0	1.0	2.6	7.2	1.1	0.6	
19	40.0	1.0	3.0	7.2	1.2	0.8	
20	46.0	1.0	2.6	7.2	1.0	0.5	
21	49.0	1.0	2.4	7.2	1.0	0.6	
22	59.0	1.0	2.0		1.2		
23	47.0	1.0	2.6		1.0		
24	56.0	1.0	2.1	7.3	1.0	0.5	
25	57.0	2.0	4.2	7.3	1.2	0.7	
26	48.0	1.0	2.5	7.3	1.2	0.6	
27	43.0	1.0	2.8	7.2	1.0	0.5	
28	49.0	1.0	2.4	7.2	1.0	0.4	
29	52.0	1.0	2.3		1.1		
30	34.0	1.0	3.5		1.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WWS ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1376.0	54.0	93.4	130.5	24.9	11.6	
AVERAGE	72.4	2.8	4.9	7.3	1.3	0.6	
MAXIMUM	100.0	5.0	12.3	7.3	1.8	0.8	
MINIMUM	39.0	1.0	1.6	7.1	1.0	0.4	
01				7.1		0.8	
02				7.3		0.6	
03				7.2		0.6	
04				7.2		0.5	
05				7.2		0.5	
06							
07							
08							
09							
10							
11						0.5	
12						0.5	
13	69.0	3.0	5.2		1.0		
14	72.0	1.0	1.7	7.3	1.0	0.4	
15	76.0	1.0	1.6	7.3	1.2	0.6	
16	77.0	3.0	4.7	7.2	1.4	0.5	
17	74.0	3.0	4.9	7.2	1.6	0.6	
18	75.0	3.0	4.8		1.6		
19	100.0	3.0	3.6		1.5		
20	88.0	3.0	4.1	7.3	1.4	0.4	
21	51.0	2.0	4.7	7.3	1.4	0.7	
22	54.0	2.0	4.4	7.3	1.1	0.6	
23	96.0	3.0	3.8	7.3	1.0	0.6	
24	70.0	4.0	6.9	7.3	1.0	0.5	
25	97.0	4.0	4.9		1.0		
26	72.0	3.0	5.0		1.2		
27	83.0	5.0	7.2		1.4		
28	39.0	4.0	12.3	7.2	1.8	0.8	
29	59.0	2.0	4.1	7.2	1.5	0.7	
30	66.0	3.0	5.5	7.3	1.4	0.6	
31	58.0	2.0	4.1	7.3	1.4	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 05-13-96

PWS ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996


PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						12.4	
AVERAGE						0.7	
MAXIMUM						1.2	
MINIMUM						0.4	
01							
02						1.0	
03							
04							
05							
06							
07							
08						0.4	
09							
10							
11							
12						0.6	
13							
14							
15						0.5	
16						0.5	
17						0.6	
18						0.4	
19						0.5	
20						0.8	
21						0.6	
22						1.1	
23						1.2	
24						0.6	
25						0.8	
26						0.6	
27						0.4	
28						0.4	
29						0.8	
30						0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-08-96

COMMENTS: Plant off-line for GST painting, system on city intertie.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160381 C.U.P. NO. 2-031-0040N

NAME OF DRINKING WATER SYSTEM: F T BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

, C.O., CERT. NO. C-7537

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	1464.0	35.0	91.7	43.2	40.6	3.2	
AVERAGE	47.2	1.1	3.0	7.2	1.3	0.5	
MINIMUM	73.0	2.0	5.9	7.2	1.5	0.6	
MINIMUM	35.0	1.0	1.6	7.2	1.2	0.4	
01	47.0	1.0	2.6	7.2	1.4	0.4	
02	48.0	1.0	2.5		1.2		
03	41.0	1.0	2.9		1.5		
04	41.0	1.0	2.9	7.2	1.3	0.6	
05	51.0	1.0	2.4		1.3		
06	50.0	1.0	2.4		1.5		
07	42.0	1.0	2.9	7.2	1.3	0.6	
08	73.0	1.0	1.6		1.3		
09	55.0	1.0	2.2		1.3		
10	49.0	1.0	2.4	7.2	1.4	0.5	
11	39.0	1.0	3.1		1.4		
12	63.0	1.0	1.9		1.3		
13	37.0	1.0	3.2		1.3		
14	47.0	1.0	2.6		1.2		
15	41.0	2.0	5.9		1.2		
16	52.0	2.0	4.6		1.2		
17	62.0	2.0	3.9		1.2		
18	35.0	1.0	3.4	7.2	1.3	0.6	
19	46.0	1.0	2.6		1.5		
20	35.0	1.0	3.4		1.4		
21	59.0	1.0	2.0		1.4		
22	46.0	1.0	2.6		1.2		
23	37.0	1.0	3.2		1.2		
24	71.0	1.0	1.7		1.2		
25	45.0	1.0	2.7	7.2	1.4	0.5	
26	41.0	1.0	2.9		1.2		
27	43.0	1.0	2.8		1.2		
28	35.0	1.0	3.4		1.3		
29	49.0	1.0	2.4		1.2		
30	44.0	2.0	5.5		1.4		
31	40.0	1.0	3.0		1.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-07-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160381 C.U.P. NO. 2-031-0040X

NAME OF DRINKING WATER SYSTEM OREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1426.0	34.0	85.0	43.6	39.5	3.6	
AVERAGE	49.2	1.2	2.9	7.3	1.4	0.6	
MAXIMUM	74.0	2.0	5.6	7.4	1.6	0.8	
MINIMUM	26.0	1.0	2.0	7.2	1.2	0.4	
01	46.0	1.0	2.6	7.2	1.3	0.5	
02	42.0	1.0	2.9		1.4		
03	49.0	1.0	2.4		1.4		
04	49.0	1.0	2.4		1.3		
05	74.0	2.0	3.2		1.5		
06	54.0	2.0	4.4	7.2	1.4	0.4	
07	50.0	2.0	4.8	7.2	1.6	0.7	
08	55.0	1.0	2.2		1.4		
09	51.0	1.0	2.4		1.4		
10	37.0	1.0	3.2		1.5		
11	49.0	2.0	4.9		1.5		
12	55.0	1.0	2.2		1.4		
13	49.0	1.0	2.4	7.4	1.2	0.6	
14	31.0	1.0	3.9		1.5		
15	48.0	1.0	2.5		1.5		
16	44.0	1.0	2.7		1.2		
17	57.0	1.0	2.1		1.2		
18	57.0	1.0	2.1		1.2		
19	48.0	1.0	2.5		1.4		
20	44.0	1.0	2.7	7.3	1.6	0.8	
21	54.0	1.0	2.2		1.4		
22	43.0	2.0	5.6		1.4		
23	45.0	1.0	2.7		1.2		
24	52.0	1.0	2.3		1.2		
25	61.0	1.0	2.0		1.2		
26	56.0	1.0	2.1		1.2		
27	52.0	1.0	2.3		1.4		
28	26.0	1.0	4.6	7.3	1.2	0.6	
29	48.0	1.0	2.5		1.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160381 C.U.P. NO. 2-031-0040K

NAME OF DRINKING WATER SYSTEM: FOREST BROOK WATER TREATMENT PLANT

LOCATION: 5855 OAKLANE DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Paul Vombisli, C.O., CERT. NO. C-5836

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1464.0	40.0	104.8	65.9	37.8	5.1	
AVERAGE	47.2	1.3	3.4	7.3	1.2	0.6	
MAXIMUM	81.0	2.0	6.0	7.4	1.5	0.7	
MINIMUM	34.0	1.0	1.5	7.2	1.1	0.4	
01	81.0	1.0	1.5		1.2		
02	36.0	1.0	3.3	7.3	1.1	0.5	
03	43.0	2.0	5.6		1.3		
04	44.0	2.0	5.5	7.4	1.1	0.4	
05	43.0	1.0	2.8		1.2		
06	40.0	2.0	6.0		1.1		
07	63.0	2.0	3.8		1.2		
08	71.0	1.0	1.7	7.2	1.1	0.6	
09	54.0	1.0	2.2		1.1		
10	50.0	1.0	2.4	7.3	1.3	0.5	
11	51.0	1.0	2.4		1.2		
12	52.0	1.0	2.3		1.3		
13	43.0	1.0	2.8		1.2		
14	45.0	1.0	2.7		1.5		
15	41.0	1.0	2.9		1.3		
16	47.0	1.0	2.6	7.4	1.2	0.7	
17	43.0	2.0	5.6		1.1		
18	57.0	2.0	4.2	7.4	1.3	0.6	
19	39.0	1.0	3.1		1.1		
20	45.0	1.0	2.7		1.2		
21	49.0	1.0	2.4		1.4		
22	49.0	2.0	4.9		1.3		
23	41.0	1.0	2.9	7.2	1.4	0.7	
24	43.0	1.0	2.8		1.2		
25	44.0	1.0	2.7	7.3	1.3	0.5	
26	36.0	1.0	3.3		1.3		
27	48.0	1.0	2.5		1.2		
28	45.0	1.0	2.7		1.2		
29	46.0	2.0	5.2		1.1		
30	41.0	2.0	5.9	7.4	1.2	0.6	
31	34.0	1.0	3.5		1.1		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 01-10-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1996

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL					16.4		
AVERAGE					1.0		
MAXIMUM					2.0		
MINIMUM					0.6		
01					2.0		PLANT OFF-LINE
02					1.4		
03					0.9		
04					0.8		
05					0.6		
06							
07							Well artesian pressure
08							6 psi
09							
10					0.8		
11					1.0		
12					0.8		
13							
14							
15							
16					1.0		
17					0.8		
18					1.0		
19							
20							
21					0.8		
22					0.7		
23					0.8		
24							
25							
26					1.1		
27							
28							
29							
30					1.0		
1					0.9		

BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 12-16-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYST. HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1996

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton Deveraux

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						16.7	
AVERAGE						1.0	
MAXIMUM						2.8	
MINIMUM						0.5	
01						0.5	Plant off line
02							
03							
04							
05						0.6	
06							
07						0.5	Well artesian pressure
08						0.7	6 psi
09							
10							
11						0.6	
12						0.5	
13						0.5	
14						0.5	
15							
16							
17							
18						0.5	
19							
20						0.6	
21						0.5	
22							
23							
24							
25						0.6	
26						0.5	
27						2.4	
28						2.8	
29						2.4	
30						2.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1996

PLANT EFFLUENT pH: (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Devereaux, C.O., CERT. NO. C-7850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL						16.2	
AVERAGE						0.6	
MAXIMUM						1.6	
MINIMUM						0.0	
01						0.4	Plant off line, system supplied from holly oaks grid.
02						0.5	
03						0.4	
04						0.4	
05						0.0	
06						0.5	
07						0.4	Well artesian pressure 5 psi
08						0.5	
09						0.5	
10						0.5	
11						0.6	
12						0.5	
13						0.3	
14						0.3	
15						0.4	
16						0.5	
17						0.4	
18						0.5	
19						0.4	
20						0.8	
21						0.5	
22						0.4	
23						1.5	
24						1.6	
25						1.5	
26						1.5	
27						0.6	
28						0.6	
29						0.5	
30							
31							

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYSTEM HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: 2850

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Jeveraux, C.O., CERT. NO. C-_____

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4.0	0.41	38.8	14.3	27.8	0.9	
AVERAGE	0.1	0.01	19.4	7.2	0.9	0.5	
MAXIMUM	3.0	0.28	33.6	7.3	3.5	0.5	
MINIMUM	0.0	0.00	5.2	7.0	0.2	0.4	
01	0.0	0.00			0.6		
02	0.0	0.00			0.5		
03	0.0	0.00		7.0	0.5	0.4	
04	0.0	0.00			3.5		
05	0.0	0.00			0.5		
06	0.0	0.00			1.5		
07	0.0	0.00			0.8		Well artesian pressure 4 psi
08	0.0	0.00			0.3		
09	0.0	0.00			0.3		
10	0.0	0.00			0.7		
11	0.0	0.00			1.5		
12	0.0	0.00			2.0		
13	0.0	0.00			0.5		
14	0.0	0.00			0.5		
15	0.0	0.00			0.5		
16	0.0	0.00			0.8		
17	0.0	0.00			1.8		
18	0.0	0.00			2.3		
19	0.0	0.00		7.3	1.6	0.5	
20	0.0	0.00			1.3		
21	0.0	0.00			1.4		
22	0.0	0.00			1.2		
23	0.0	0.00			0.8		
24	0.0	0.00			0.7		
25	1.0	0.28	33.6		0.5		
26	3.0	0.13	5.2		0.2		
27	0.0	0.00			0.2		
28	0.0	0.00			0.2		
29	0.0	0.00			0.3		
30	0.0	0.00			0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

Corrected Copy
9/25

PWS ID NO. 216-0924 C.U.P. NO. 2-031-00.

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 6.9 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton L. Devereaux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	385.0	24.30	99.5	27.8	48.2	1.8	
AVERAGE	12.4	0.78	7.1	6.9	1.6	0.5	
MAXIMUM	61.0	4.00	17.1	7.0	3.5	0.5	
MINIMUM	0.0	0.00	0.0	6.9	0.0	0.4	
01	21.0	3.00	17.1	7.0	2.5		
02	26.0	2.00	9.2		3.5	0.5	
03	20.0	0.50	3.0		2.0		
04	15.0	0.70	5.6		2.2		
05	26.0	1.00	4.6		2.5		
06	28.0	1.80	7.7		2.2		
07	26.0	1.00	4.6		3.5		
08	29.0	1.50	6.2	7.0	3.1	0.5	Well artesian pressure 6 psi
09	29.0	1.30	5.4		3.0		
10	36.0	2.60	8.7		3.5		
11	19.0	1.90	12.0		3.0		
12	48.0	3.00	7.5		3.5		
13	1.0	0.00	0.0		2.7		
14	0.0	0.00			1.5		
15	61.0	4.00	7.9		1.0		
16	0.0	0.00			1.2		
17	0.0	0.00			1.7		
18	0.0	0.00			0.8		
19	0.0	0.00			0.3		
20	0.0	0.00		6.9	0.4	0.4	
21	0.0	0.00			0.3		
22	0.0	0.00			0.3		
23	0.0	0.00			0.3		
24	0.0	0.00			0.6		
25	0.0	0.00			0.4		
26	0.0	0.00			0.0		
27	0.0	0.00			0.5		
28	0.0	0.00			0.5		
29	0.0	0.00		6.9	0.4	0.4	
30	0.0	0.00			0.3		
31	0.0	0.00			0.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 08-14-96

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 6.9 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton J. Jereaux

, C.O., CERT. NO. 2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	385.0	24.30	99.5	27.8	48.2	1.8	
AVERAGE	12.4	0.78	7.1	6.9	1.6	0.5	
MAXIMUM	61.0	4.00	17.1	7.0	3.5	0.5	
MINIMUM	0.0	0.00	0.0	6.9	0.0	0.4	
01	21.0	3.00	17.1	7.0	2.5		
02	26.0	2.00	9.2		3.5	0.5	
03	20.0	0.50	3.0		2.0		
04	15.0	0.70	5.6		2.2		
05	26.0	1.00	4.6		2.5		
06	28.0	1.80	7.7		2.2		
07	26.0	1.00	4.6		3.5		
08	29.0	1.50	6.2	7.0	3.1	0.5	Well artesian pressure 6 psi
09	29.0	1.30	5.4		3.0		
10	36.0	2.60	8.7		3.5		
11	19.0	1.90	12.0		3.0		
12	48.0	3.00	7.5		3.5		
13	1.0	0.00	0.0		2.7		
14	0.0	0.00			1.5		
15	61.0	4.00	7.9		1.0		
16	0.0	0.00			1.2		
17	0.0	0.00			1.7		
18	0.0	0.00			0.8		
19	0.0	0.00			0.3		
20	0.0	0.00		6.9	0.4	0.4	
21	0.0	0.00			0.3		
22	0.0	0.00			0.3		
23	0.0	0.00			0.3		
24	0.0	0.00			0.6		
25	0.0	0.00			0.4		
26	0.0	0.00			0.0		
27	0.0	0.00			0.5		
28	0.0	0.00			0.5		
29	0.0	0.00		6.9	0.4	0.4	
30	0.0	0.00			0.3		
31	0.0	0.00			0.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 08-14-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00000

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1996

PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton J. Jereau

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	765.0	56.13	245.5	27.9	89.6	2.1	
AVERAGE	24.7	1.81	7.9	7.0	2.9	0.5	
MAXIMUM	117.0	16.00	19.2	7.0	3.5	0.6	
MINIMUM	14.0	0.00	0.0	6.9	1.6	0.5	
01	24.0	2.00	10.0	7.0	3.0	0.5	
02	14.0	1.00	8.6		3.1		
03	20.0	1.00	6.0		3.0		
04	19.0	0.75	4.7		2.5		
05	19.0	0.88	5.6		3.5		
06	17.0	0.81	5.7		3.5		
07	20.0	0.81	4.9		3.0		Well artesian pressure 5 psi
08	19.0	0.90	5.7		2.4		
09	22.0	1.30	7.1	7.0	2.5	0.5	
10	16.0	1.20	9.0		3.0		
11	19.0	1.00	6.3		3.2		
12	23.0	1.00	5.2		3.0		
13	19.0	1.00	6.3		3.5		
14	19.0	0.81	5.1		3.5		
15	82.0	4.00	5.8		2.8		
16	19.0	1.00	6.3		3.0		
17	19.0	1.00	6.3	6.9	3.1	0.5	
18	19.0	0.75	4.7		3.0		
19	20.0	0.81	4.9		2.7		
20	19.0	0.81	5.1		1.6		
21	20.0	0.00	0.0		2.1		
22	19.0	1.00	6.3		2.0		
23	117.0	16.00	16.4		2.2		
24	20.0	1.80	10.8		2.8		
25	20.0	0.80	4.8		3.5		
26	25.0	1.00	4.8		3.0		
27	15.0	2.00	16.0		2.6		
28	20.0	2.20	13.2		2.5		
29	25.0	4.00	19.2		3.5		
30	16.0	2.50	18.7	7.0	3.0	0.6	
31	20.0	2.00	12.0		3.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 07-23-96

PWS ID NO. 216-1326 C.U.P. NO. 2-031-001

NAME OF DRINKING WATER SYSTEM HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1996

PLANT EFFLUENT pH: 6.9 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton Javeroux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	547.0	31.19	200.9	27.7	82.4	2.1	
AVERAGE	18.2	1.04	6.7	6.9	2.7	0.5	
MAXIMUM	24.0	4.00	22.8	7.0	3.5	0.6	
MINIMUM	10.0	0.40	4.5	6.9	1.5	0.5	
01	16.0	0.60	4.5		2.4		
02	16.0	0.60	4.5		2.5		
03	16.0	0.60	4.5		1.7		
04	15.0	0.90	7.2	7.0	2.8	0.6	
05	15.0	2.00	16.0		2.5		psi tested 5 June 1996
06	10.0	0.40	4.8		2.2		
07	21.0	4.00	22.8		2.5		Well artesian pressure 4 psi
08	22.0	4.00	21.8		3.5		
09	18.0	0.76	5.1		3.5		
10	20.0	1.00	6.0		2.0		
11	20.0	1.00	6.0	6.9	1.5	0.5	
12	15.0	0.75	6.0		3.0		
13	23.0	1.00	5.2		2.8		
14	19.0	0.80	5.0		2.6		
15	18.0	0.80	5.3		2.8		
16	18.0	0.75	5.0	6.9	2.5	0.5	
17	20.0	0.88	5.3		3.0		
18	20.0	0.81	4.9		3.0		
19	24.0	1.06	5.3		3.5		
20	15.0	0.63	5.0		2.6		
21	19.0	0.80	5.0		3.0		
22	18.0	0.75	5.0		2.7		
23	19.0	0.81	5.1		2.0		
24	16.0	0.70	5.2		3.0		
25	23.0	0.94	4.9	6.9	2.8	0.5	
26	19.0	0.80	5.0		3.5		
27	18.0	0.75	5.0		3.0		
28	19.0	0.80	5.0		3.5		
29	19.0	0.80	5.0		3.0		
30	16.0	0.70	5.2		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 06-20-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1996

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Milton Deveraux

, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1238.0	153.29	391.0	28.4	79.1	4.3	
AVERAGE	39.9	5.11	13.0	7.1	2.6	1.1	
MAXIMUM	65.0	15.00	32.7	7.2	3.5	1.5	
MINIMUM	11.0	0.14	1.4	7.0	0.5	0.8	
01	47.0	3.00	7.7		1.0		
02	65.0	4.00	7.4		0.8		
03	56.0	5.00	10.7		1.5		
04	56.0	4.00	8.6		2.2		
05	56.0	6.00	12.8		3.5		
06	49.0	11.00	26.9		2.0		
07	50.0	5.00	12.0	7.2	3.5	1.0	Well artesian pressure 4 psi
08	64.0	10.00	18.7		3.5		
09	56.0	5.00	10.7		1.5		
10	54.0	11.00	24.4		2.7		
11	55.0	11.00	24.0		3.5		
12	55.0	5.00	10.9		0.5		
13	55.0	15.00	32.7		3.5		
14	55.0	10.00	21.8	7.1	3.0	1.0	
15	46.0				3.0		
16	55.0	7.00	15.3		3.0		
17	44.0	9.00	24.5		3.5		
18	42.0	6.00	17.1		3.0		
19	41.0	6.00	17.5		3.5		
20	42.0	7.00	20.0		3.5		
21	43.0	5.00	13.9		3.5		
22	42.0	4.00	11.4	7.1	3.5	1.5	
23	11.0	0.18	2.0		3.5		
24	12.0	0.14	1.4		1.5		
25	11.0	0.47	5.1		1.2		
26	11.0	0.23	2.5		2.0		
27	11.0	0.50	5.5		2.0		
28	11.0	0.87	9.5		1.5		
29	11.0	0.50	5.5		3.0		
30	16.0	0.70	5.2	7.0	2.9		
31	16.0	0.70	5.2		2.3	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 5

SAMPLE DATE: 05-13-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-06...

NAME OF DRINKING WATER SYSTEM: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1996

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Carol H. Johnson Sr., C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1533.0	91.04	210.7	21.2	82.4	1.5	
AVERAGE	51.1	3.03	7.3	7.1	2.7	0.5	
MAXIMUM	97.0	8.00	15.5	7.1	3.5	0.5	
MINIMUM	0.0	0.00	3.5	7.0	0.5	0.5	
01	18.0	1.00	6.7		3.2		
02	54.0	4.00	8.9	7.1	3.1	0.5	<i>Well Artesian pressure 8 psi</i>
03	27.0	2.00	8.9		3.2		
04	39.0	3.00	9.2		3.0		
05	21.0	2.00	11.4		3.5		
06	0.0	0.00			3.5		
07	1.0	0.04	4.8		3.5		
08	97.0	5.00	6.2		3.0		
09	68.0	3.00	5.3	7.0	3.1	0.5	
10	52.0	2.00	4.6		2.0		
11	57.0	2.00	4.2		3.5		
12	56.0	2.00	4.3		3.0		
13	58.0	2.00	4.1		2.8		
14	58.0	2.00	4.1		3.5		
15	56.0	2.00	4.3		3.0		
16	68.0	2.00	3.5		1.7		
17	52.0	5.00	11.5		2.7		
18	75.0	4.00	6.4	7.1	0.5	0.5	
19	62.0	8.00	15.5		3.5		
20	46.0	3.00	7.8		3.1		
21	64.0	4.00	7.5		3.5		
22	49.0	5.00	12.2		3.5		
23	63.0	3.00	5.7		3.5		
24	57.0	3.00	6.3		3.5		
25	56.0	3.00	6.4		3.5		
26	55.0	4.00	8.7		3.0		
27	57.0	4.00	8.4		1.0		
28	57.0	4.00	8.4		0.5		
29	55.0	4.00	8.7		0.5		
30	55.0	3.00	6.5		1.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0015a

NAME OF DRINKING WATER SYS.: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ken D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	216.0	16.66	272.8	21.4	91.7	1.4	
AVERAGE	7.0	0.54	9.4	7.1	3.0	0.5	
MAXIMUM	86.0	5.00	60.0	7.2	3.5	0.5	
MINIMUM	0.0	0.00	1.6	7.1	0.5	0.4	
01	2.0	0.08	4.8		3.0		
02	1.0	0.04	4.8		3.5		
03	1.0	0.04	4.8		3.2		
04	1.0	0.04	4.8		2.6		
05	2.0	0.04	2.4		2.5		
06	2.0	0.06	3.6		2.2		
07	1.0	0.12	14.4	7.1	2.5	0.5	
08	1.0	0.06	7.2		2.7		
09	1.0	0.06	7.2		3.0		
10	1.0	0.06	7.2		2.8		
11	1.0	0.04	4.8		3.1		
12	3.0	0.04	1.6		3.5		
13	1.0	0.04	4.8		3.0		
14	74.0	5.00	8.1		3.1		
15	7.0	0.46	7.9		3.5		
16	1.0	0.04	4.8	7.2	3.5	0.4	
17	3.0	0.04	1.6		3.5		
18	2.0	0.08	4.8		3.5		
19	2.0	0.04	2.4		3.0		
20	1.0	0.04	4.8		2.5		
21	86.0	5.00	7.0		3.5		
22	1.0	0.04	4.8		3.5		
23	0.0	0.00			3.0		
24	1.0	0.04	4.8		3.0		
25	6.0	1.00	20.0		3.0		
26	2.0	0.08	4.8	7.1	2.5	0.5	
27	0.0	0.00			3.0		
28	2.0	0.04	2.4		0.5		
29	6.0	3.00	60.0		3.5		
30	2.0	1.00	60.0		3.0		
31	2.0	0.04	2.4		3.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-

NAME OF DRINKING WATER (M: HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1996

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy D. Adams Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	70.0	4.47	136.8	21.2	79.5	1.3	
AVERAGE	2.4	0.15	6.8	7.1	2.7	0.4	
MAXIMUM	28.0	2.00	24.6	7.2	3.5	0.5	
MINIMUM	0.0	0.00	0.0	7.0	1.5	0.3	
01	3.0	0.33	13.2	7.0	3.0	0.5	ARTESIAN LEVEL 8 1/2 P S I
02	0.0	0.00			1.5		
03	2.0	0.00	0.0		1.9		
04	0.0	0.00			1.9		
05	0.0	0.00			2.5		
06	0.0	0.00			2.2		
07	0.0	0.00			2.8		
08	3.0	0.08	3.2		3.5		
09	2.0	0.00	0.0		3.5		
10	1.0	0.04	4.8		3.5		
11	2.0	0.37	22.2		3.5		
12	1.0	0.03	3.6		3.5		
13	1.0	0.03	3.6	7.0	2.6	0.5	
14	1.0	0.03	3.6		2.8		
15	4.0	0.48	14.4		2.6		
16	0.0	0.00			2.5		
17	0.0	0.00			3.0		
18	0.0	0.00			3.5		
19	0.0	0.00			2.0		
20	3.0	0.08	3.2	7.2	3.5	0.3	
21	5.0	0.13	3.1		2.2		
22	2.0	0.41	24.6		3.5		
23	28.0	2.00	8.6		2.2		
24	1.0	0.03	3.6		3.0		
25	2.0	0.03	1.8		3.5		
26	3.0	0.03	1.2		1.5		
27	2.0	0.04	2.4		2.9		
28	2.0	0.29	17.4		3.0		
29	2.0	0.04	2.4		1.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0015H

NAME OF DRINKING WATER SYSTEM HOLLY OAKS W.T.P.

LOCATION: 1943 HOLLY OAKS LAKE ROAD WEST

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1996

PLANT EFFLUENT pH: 7.1 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Milton D. ..., C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	187.0	7.01	84.9	28.3	83.5	2.1	
AVERAGE	6.0	0.23	2.7	7.1	2.7	0.5	
MAXIMUM	108.0	5.00	7.1	7.2	3.5	0.8	
MINIMUM	1.0	0.03	0.7	7.0	1.0	0.4	
01	1.0	0.03	3.6		2.8		Artesian level at well head 8 psi
02	17.0	1.00	7.1		3.5		
03	2.0	0.03	1.8		3.5		
04	1.0	0.03	3.6		3.5		
05	2.0	0.03	1.8	7.0	2.5	0.4	
06	2.0	0.03	1.8		3.0		
07	2.0	0.04	2.4		3.3		
08	1.0	0.03	3.6		3.3		
09	1.0	0.03	3.6		2.5		
10	1.0	0.03	3.6		3.0		
11	1.0	0.03	3.6		3.5		
12	2.0	0.03	1.8		3.5		
13	2.0	0.03	1.8		3.5		
14	2.0	0.03	1.8		2.0		
15	2.0	0.03	1.8	7.0	2.5	0.4	
16	2.0	0.03	1.8		2.6		
17	1.0	0.03	3.6		2.2		
18	1.0	0.03	3.6		2.5		
19	1.0	0.03	3.6		1.5		
20	5.0	0.03	0.7		3.0		
21	5.0	0.05	1.2		2.5		
22	2.0	0.03	1.8		1.2		
23	3.0	0.06	2.4		1.0		
24	2.0	0.03	1.8	7.2	3.5	0.8	
25	7.0	0.06	1.0		2.2		
26	6.0	0.08	1.6		2.8		
27	1.0	0.03	3.6		3.5		
28	1.0	0.03	3.6		3.2		
29	2.0	0.03	1.8		1.2		
30	108.0	5.00	5.6	7.1	2.2	0.5	
31	1.0	0.03	3.6		2.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015 NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.
 LOCATION: 1258 MONUMENT ROAD JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: December, 1996
 PLANT EFFLUENT pH: 7.2 (AVG.) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT *Charles J. Adams Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	30644.0	3102	377.1	35.9	85.1	2.9	479	58.2	
AVERAGE	988.5	100	12.2	7.2	2.7	0.6	15	1.9	
MAXIMUM	1640.0	160	13.5	7.2	3.5	0.8	26	2.4	
MINIMUM	788.0	80	11.3	7.1	1.0	0.5	12	1.7	
01	788.0	80	12.2		3.5		12	1.9	
02	866.0	85	11.8		1.0		13	1.8	
03	934.0	90	11.6	7.2	3.5	0.5	14	1.8	
04	952.0	95	12.0		3.5		14	1.8	
05	983.0	95	11.6		3.5		15	1.8	
06	1004.0	100	11.9		2.5		16	1.9	
07	1275.0	120	11.3		2.5		20	1.9	Well artesian pressure
08	1640.0	160	11.7		2.7		26	1.9	
09	934.0	95	12.2		2.3		14	1.7	
10	802.0	90	13.5	7.1	3.0	0.8	15	2.2	
11	959.0	100	12.5		2.9		15	1.9	
12	947.0	100	12.7		2.1		14	1.8	
13	979.0	110	13.5		2.7		14	1.8	
14	1092.0	120	13.2		2.8		17	1.9	
15	793.0	85	12.9		3.1		12	1.9	
16	980.0	100	12.2		3.1		15	1.8	
17	889.0	90	12.1	7.2	3.0	0.6	13	1.8	
18	1016.0	100	11.8		2.6		16	1.9	
19	979.0	100	12.2		3.3		15	1.8	
20	1035.0	100	11.6		1.9		16	1.8	
21	1070.0	110	12.3		2.1		17	1.9	
22	998.0	100	12.0		1.2		15	1.8	
23	1126.0	110	11.7	7.2	2.5	0.5	17	1.9	
24	881.0	85	11.6		1.9		17	2.4	
25	910.0	90	11.9		2.9		14	1.9	
26	958.0	100	12.5		3.2		15	1.9	
27	1000.0	100	12.0		3.5		16	1.9	
28	959.0	95	11.9		3.1		15	1.9	
29	852.0	90	12.7		3.4		14	1.9	
30	991.0	100	12.1		2.9		16	1.9	
31	1052.0	107	12.2	7.2	2.9	0.5	16	1.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ronald A. Anderson, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	31150.0	3160	368.4	28.7	94.1	3.2	539	60.0	
AVERAGE	1038.3	105	12.7	7.2	3.1	0.8	18	2.6	
MAXIMUM	1863.0	175	21.5	7.2	5.0	1.2	166	18.8	
MINIMUM	750.0	80	8.5	7.1	2.2	0.5	0	1.3	
01	1303.0	130	12.0		2.2		20	1.9	
02	1094.0	105	11.5		2.4		15	1.6	
03	1058.0	105	11.9		3.1		166	18.8	
04	1018.0	100		7.2	3.5	0.7	16		
05	1089.0	110	13.0		2.3		17	2.0	
06	846.0	100	11.0		2.3		14	1.6	
07	1141.0	110	15.6		2.5		20	2.8	Well artesian pressure
08	1092.0	110	11.6		3.7		15	1.6	
09	970.0	80	8.8		3.7		16	1.8	
10	884.0	80	9.9		3.4		14	1.8	
11	1205.0	130	17.6		3.9		19	2.5	
12	886.0	85	8.5		5.0		13	1.3	
13	1065.0	105	14.5	7.2	3.5	1.2	17	2.3	
14	1049.0	105	11.8		3.5		16	1.8	
15	867.0	85	9.7		3.5		14	1.6	
16	1090.0	110	15.2		3.5		17	2.3	
17	1023.0	100	11.0		3.5		16	1.7	
18	1027.0	100	11.7	7.2	2.5	0.8	0		
19	952.0	95	11.1		2.7		0		
20	1027.0	100	12.6		2.7		0		
21	926.0	90	10.5		2.6		0		
22	975.0	155	20.1		3.5		0		
23	1863.0	175	21.5		2.4		13		
24	945.0	110	14.0		2.7		13	1.7	
25	750.0	85	13.6		3.0		11	1.8	
26	986.0	105	12.8	7.1	2.8	0.5	15	1.8	
27	1090.0	110	12.1		3.5		17	1.9	
28	924.0	90	11.7		3.2		14	1.8	
29	938.0	90	11.5		3.5		14	1.8	
30	1067.0	105	11.8		3.5		16	1.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1996


PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865


I CERTIFY THIS REPORT IS CORRECT _____



, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	31938.0	3165	368.2	36.0	97.9	4.4	496	57.8	
AVERAGE	1030.3	102	11.9	7.2	3.2	0.9	16	1.9	
MAXIMUM	1299.0	130	14.0	7.2	5.0	1.5	20	2.1	
MINIMUM	848.0	60	7.4	7.2	0.4	0.5	13	1.8	
01	999.0	100	12.0		3.5		15	1.8	
02	960.0	95	11.9	7.2	3.2	0.5	15	1.9	
03	943.0	95	12.1		3.5		14	1.8	
04	970.0	60	7.4		3.5		14	1.8	
05	983.0	110	13.4		0.4		15	1.9	
06	904.0	100	13.3		4.9		14	1.9	
07	999.0	100	12.0		5.0		15	1.8	Well artesian pressure
08	889.0	90	12.1	7.2	3.5	1.0	14	1.8	
09	1000.0	100	12.0		3.5		15	1.8	
10	862.0	85	11.8		3.5		13	1.8	
11	889.0	85	11.5		3.5		14	1.8	
12	1299.0	130	12.0		2.4		20	1.8	
13	848.0	85	12.0		2.2		15	2.1	
14	1018.0	100	11.8	7.2	1.8	0.5	16	1.9	
15	1062.0	105	11.9		1.1		16	1.8	
16	1081.0	105	11.6		3.3		17	1.8	
17	1116.0	130	14.0		3.5		17	1.8	
18	938.0	90	11.5		1.9		15	2.0	
19	994.0	100	12.1		3.5		15	1.8	
20	1155.0	115	11.9		3.5		18	1.9	
21	1010.0	100	11.9	7.2	3.3	0.9	16	1.9	
22	1150.0	115	12.0		2.3		18	1.9	
23	1081.0	110	12.2		3.1		17	1.9	
24	1020.0	100	11.8		3.5		16	1.9	
25	1214.0	125	12.3		3.5		19	1.9	
26	1188.0	105	10.6		3.5		18	1.8	
27	1116.0	110	11.8		3.5		17	1.9	
28	1112.0	110	11.9	7.2	3.5	1.5	17	1.9	
29	1059.0	105	11.9		3.5		17	1.9	
30	1112.0	110	11.9		3.5		17	1.8	
31	967.0	95	11.8		3.5		15	1.8	

Apr. 26 '98 10:43

UNITED WATER Moterey  FAX 745-3523

P. 1

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1250 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Randy J. Allen

, C.O., CERT. NO. *C-2537*

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE		SINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		lbs. used	mg/l		PLANT EFFLUENT	RESIDUE	lbs used	mg/l	
MONTHLY TOTAL	32472.0	3243	360.1	36.0	89.8	4.6	509	56.4	
AVERAGE	1092.4	108	12.0	7.2	3.0	0.9	17	1.9	
MAXIMUM	1250.0	140	14.1	7.2	3.5	1.8	20	1.9	
MINIMUM	837.0	90	11.0	7.2	1.0	0.3	14	1.0	
01	1090.0	100	11.0		3.3		17	1.3	
02	1001.0	100	12.0		2.9		16	1.9	
03	933.0	90	11.5	7.2	3.5	1.0	14	1.0	
04	1113.0	110	11.9		3.5		17	1.9	
05	1061.0	100	12.0		3.5		15	1.6	
06	907.0	90	11.9		2.5		14	1.9	
07	1220.0	120	11.7		2.3		19	1.9	Well artesian pressure
08	1210.0	120	11.9		1.0		19	1.9	
09	1042.0	105	12.1	7.2	1.4	0.3	16	1.0	
10	1042.0	100	12.0		3.5		16	1.9	
11	921.0	100	12.2		3.5		13	1.3	
12	1017.0	120	14.1		3.5		16	1.9	
13	1220.0	140	13.1		3.5		20	1.8	
14	827.0	100	13.5		3.5		14	1.5	
15	1117.0	110	11.8		3.3		10	1.9	
16	1074.0	105	11.7	7.2	3.5	1.2	17	1.9	
17	1051.0	105	12.0		3.5		16	1.8	
18	1130.0	110	11.7		3.3		10	1.9	
19	1160.0	115	11.6		2.5		18	1.9	
20	1193.0	118	11.9		3.5		19	1.9	
21	1030.0	105	11.9		3.0		17	1.9	
22	1050.0	105	11.9		3.0		17	1.9	
23	1027.0	100	11.7	7.2	3.5	0.8	16	1.9	
24	1162.0	115	11.9		2.8		10	1.9	
25	1175.0	115	11.7		2.2		10	1.9	
26	1143.0	110	11.5		2.7		10	1.9	
27	1135.0	110	11.6		2.0		10	1.9	
28	1210.0	120	11.9		1.8		20	1.9	
29	1122.0	115	12.3		2.5	0.5	10	1.9	
30	947.0	95	12.0	7.2	3.1		14	1.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

County copy
9/25

PWS ID NO. 216-0924 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy G. Adams, Sr., C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	36022.0	3625	375.3	28.8	84.7	2.1	372	38.1	
AVERAGE	1162.0	117	12.1	7.2	2.7	0.5	12	1.2	
MAXIMUM	1557.0	190	18.3	7.2	3.5	0.6	23	2.1	
MINIMUM	836.0	75	6.9	7.2	0.7	0.4	0	0.0	
01	1220.0	120	11.8		2.9		0	0.0	
02	1253.0	190	18.2		3.5		0	0.0	
03	948.0	145	18.3		2.9		0	0.0	
04	856.0	90	12.6		2.8		0	0.0	
05	1238.0	120	11.6		2.5		0	0.0	
06	1276.0	125	11.7	7.2	3.0	0.6	0	0.0	
07	1089.0	110	12.1		1.8		0	0.0	Well artesian pressure
08	1131.0	115	12.2		3.1		0	0.0	
09	1164.0	115	11.8		2.4		0	0.0	
10	1557.0	155	11.9		1.4		0	0.0	
11	893.0	85	11.4		3.4		0	0.0	
12	954.0	95	11.9	7.2	3.5	0.6	14	1.8	
13	1041.0	105	12.1		3.1		16	1.9	
14	1003.0	100	12.0		3.3		16	1.9	
15	836.0	80	11.5		3.2		14	2.0	
16	1223.0	120	11.8		2.9		19	1.9	
17	1155.0	115	11.9		2.6		18	1.9	
18	1267.0	125	11.8		1.8		20	1.9	
19	1252.0	125	12.0	7.2	2.3	0.4	20	1.9	
20	1168.0	115	11.8		2.1		18	1.9	
21	1053.0	110	12.5		3.1		19	2.1	
22	1246.0	125	12.0		2.8		19	1.8	
23	1257.0	120	11.4		2.7		18	1.8	
24	1240.0	125	12.1		2.1		22	2.1	
25	1411.0	140	11.9		3.5		23	2.0	
26	1299.0	130	12.0	7.2	2.5	0.5	20	1.9	
27	1242.0	120	11.6		3.5		20	1.9	
28	1237.0	120	11.6		2.7		20	1.9	
29	1232.0	120	11.7		3.4		20	1.9	
30	1295.0	75	6.9		3.2		20	1.9	
31	986.0	90	10.9		0.7		14	1.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 08-01-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-001

NAME OF DRINKING WATER SYS MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Charles S. Johnson S., C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	36022.0	3625	375.3	28.8	84.7	2.1	372	38.1	
AVERAGE	1162.0	117	12.1	7.2	2.7	0.5	12	1.2	
MAXIMUM	1557.0	190	18.3	7.2	3.5	0.6	23	2.1	
MINIMUM	836.0	75	6.9	7.2	0.7	0.4	0	0.0	
01	1220.0	120	11.8		2.9		0	0.0	
02	1253.0	190	18.2		3.5		0	0.0	
03	948.0	145	18.3		2.9		0	0.0	
04	856.0	90	12.6		2.8		0	0.0	
05	1238.0	120	11.6		2.5		0	0.0	
06	1276.0	125	11.7	7.2	3.0	0.6	0	0.0	
07	1089.0	110	12.1		1.8		0	0.0	Well artesian pressure
08	1131.0	115	12.2		3.1		0	0.0	
09	1164.0	115	11.8		2.4		0	0.0	
10	1557.0	155	11.9		1.4		0	0.0	
11	893.0	85	11.4		3.4		0	0.0	
12	954.0	95	11.9	7.2	3.5	0.6	14	1.8	
13	1041.0	105	12.1		3.1		16	1.9	
14	1003.0	100	12.0		3.3		16	1.9	
15	836.0	80	11.5		3.2		14	2.0	
16	1223.0	120	11.8		2.9		19	1.9	
17	1155.0	115	11.9		2.6		18	1.9	
18	1267.0	125	11.8		1.8		20	1.9	
19	1252.0	125	12.0	7.2	2.3	0.4	20	1.9	
20	1168.0	115	11.8		2.1		18	1.9	
21	1053.0	110	12.5		3.1		19	2.1	
22	1246.0	125	12.0		2.8		19	1.8	
23	1257.0	120	11.4		2.7		18	1.8	
24	1240.0	125	12.1		2.1		22	2.1	
25	1411.0	140	11.9		3.5		23	2.0	
26	1299.0	130	12.0	7.2	2.5	0.5	20	1.9	
27	1242.0	120	11.6		3.5		20	1.9	
28	1237.0	120	11.6		2.7		20	1.9	
29	1232.0	120	11.7		3.4		20	1.9	
30	1295.0	75	6.9		3.2		20	1.9	
31	986.0	90	10.9		0.7		14	1.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 08-01-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00304

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Charles H. Johnson Sr., C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	38647.0	3790	364.8	21.7	74.7	1.7	597	57.4	
AVERAGE	1246.7	122	11.8	7.2	2.4	0.6	19	1.9	
MAXIMUM	1734.0	170	12.3	7.3	4.0	0.7	27	2.2	
MINIMUM	898.0	90	10.5	7.2	1.0	0.4	11	1.0	
01	1251.0	110	10.5		3.8		20	1.9	
02	1205.0	120	11.9		3.9		19	1.9	
03	1163.0	115	11.9		3.9		18	1.8	
04	1031.0	100	11.6		4.0		16	1.8	
05	898.0	90	12.0	7.2	3.2	0.6	14	1.8	
06	964.0	95	11.8		3.5		15	1.9	
07	1086.0	110	12.1		2.9		17	1.8	Well artesian pressure
08	943.0	95	12.1		2.6		15	1.8	
09	1065.0	105	11.8		2.7		16	1.8	
10	1099.0	110	12.0		2.7		17	1.9	
11	989.0	90	10.9		3.2		15	1.8	
12	1178.0	115	11.7		1.4		18	1.8	
13	1129.0	110	11.7		3.5		17	1.8	
14	1086.0	110	12.1		3.5		17	1.8	
15	920.0	90	11.7	7.2	1.5	0.7	14	1.8	
16	1233.0	120	11.7		1.5		20	1.9	
17	1331.0	130	11.7		1.0		24	2.2	
18	1399.0	140	12.0		1.0		23	1.9	
19	1335.0	130	11.7		1.0		21	1.9	
20	1694.0	170	12.0		1.5		22	1.6	
21	1466.0	145	11.9		1.9		23	1.9	
22	1734.0	160	11.1		3.5		27	1.9	
23	1266.0	125	11.8		2.4		20	1.9	
24	1124.0	110	11.7		2.7		18	1.9	
25	1264.0	125	11.9		1.9		20	1.9	
26	1688.0	160	11.4	7.3	2.5	0.4	27	1.9	
27	1483.0	150	12.1		1.3		24	1.9	
28	1222.0	125	12.3		1.0		20	2.0	
29	1538.0	150	11.7		1.0		25	1.9	
30	1481.0	145	11.7		2.5		27	2.2	
31	1382.0	140	12.1		1.7		11	1.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-01

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: June, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ron D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE LBS USED MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	34364.0	3430	359.3	7.2	84.6	1.9	164	17.9	
AVERAGE	1145.5	114	12.0	7.2	2.8	0.6	5	0.6	
MAXIMUM	1633.0	160	12.6	7.2	3.8	0.8	21	1.9	
MINIMUM	774.0	80	11.0	7.2	0.5	0.4	0	0.0	
01	1315.0	135	12.3		2.5		0	0.0	
02	1504.0	150	12.0		3.5		0	0.0	
03	1092.0	110	12.1	7.2	3.5	0.8	0	0.0	
04	1399.0	140	12.0		3.0		0	0.0	
05	1633.0	160	11.7		2.4		0	0.0	
06	1452.0	145	12.0		2.3		0	0.0	
07	1195.0	120	12.0		1.9		0	0.0	Well artesian pressure
08	1020.0	100	11.8		2.5		0	0.0	
09	1032.0	105	12.2		3.2		0	0.0	
10	1151.0	115	12.0		3.5		0	0.0	
11	1013.0	100	11.8		3.5		0	0.0	
12	1201.0	120	12.0		2.3		0	0.0	
13	1098.0	110	12.0		2.5		0	0.0	
14	1162.0	115	11.9		3.5		0	0.0	
15	1091.0	100	11.0		2.6		0	0.0	
16	774.0	80	12.4		3.1		0	0.0	
17	1092.0	110	12.1		0.5		0	0.0	
18	1131.0	105	11.1		2.5		0	0.0	
19	1003.0	100	12.0	7.2	2.5	0.4	0	0.0	
20	1051.0	105	12.0		0.5		0	0.0	
21	967.0	95	11.8		3.4		15	1.8	
22	1040.0	105	12.1		3.0		16	1.9	
23	1354.0	135	12.0		3.5		21	1.8	
24	1218.0	120	11.8		3.5		19	1.8	
25	1294.0	130	12.0		2.8		20	1.9	
26	1088.0	110	12.1	7.2	2.9	0.7	17	1.9	
27	977.0	100	12.3		3.4		14	1.8	
28	1032.0	105	12.2		3.6		11	1.3	
29	1032.0	105	12.2		2.9		16	1.9	
30	953.0	100	12.6		3.8		14	1.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0015 NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.
 LOCATION: 1258 MONUMENT ROAD JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: May, 1996
 PLANT EFFLUENT pH: 7.2 (AVG.) NO. OF SERVICES AT END OF MONTH: _____
 DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Stanley H. Williams Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	42877.0	4240	368.2	14.4	72.6	1.3	0	0.0	
AVERAGE	1383.1	137	11.9	7.2	2.3	0.7	0	0.0	
MAXIMUM	1826.0	180	13.7	7.2	3.5	0.8	0	0.0	
MINIMUM	1046.0	105	11.0	7.2	1.2	0.5	0	0.0	
01	1110.0	110	11.9		2.2		0	0.0	
02	1238.0	120	11.6		1.5		0	0.0	
03	1398.0	135	11.6		2.4		0	0.0	
04	1308.0	130	11.9		1.6		0	0.0	
05	1631.0	160	11.8		1.5		0	0.0	
06	1350.0	135	12.0		2.0		0	0.0	
07	1440.0	140	11.7		3.5		0	0.0	Well artesian pressure
08	1571.0	155	11.8		2.2		0	0.0	
09	1341.0	130	11.6		3.5		0	0.0	
10	1221.0	120	11.8		1.7		0	0.0	
11	1224.0	120	11.8		2.0		0	0.0	
12	1532.0	150	11.7		1.8		0	0.0	
13	1362.0	130	11.4		2.3		0	0.0	
14	1188.0	120	12.1		1.7		0	0.0	
15	1471.0	145	11.8		1.2		0	0.0	
16	1454.0	145	12.0		2.0		0	0.0	
17	1415.0	130	11.0		2.5		0	0.0	
18	1400.0	150	12.8		2.1		0	0.0	
19	1726.0	160	11.1		2.0		0	0.0	
20	1468.0	145	11.8		2.3		0	0.0	
21	1165.0	115	11.8	7.2	2.7	0.5	0	0.0	
22	1512.0	150	11.9		3.2		0	0.0	
23	1517.0	150	11.9		2.1		0	0.0	
24	1377.0	135	11.8		2.0		0	0.0	
25	1658.0	165	11.9		1.8		0	0.0	
26	1597.0	160	12.0		2.6		0	0.0	
27	1826.0	180	11.8		3.5		0	0.0	
28	1142.0	110	11.5	7.2	3.5	0.8	0	0.0	
29	1046.0	105	12.0		3.0		0	0.0	
30	1053.0	110	12.5		3.2		0	0.0	
31	1136.0	130	13.7		3.0		0	0.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-001111

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Charles H. Johnson Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	31833.0	3100	303.8	35.9	59.6	3.0	0	0.0	
AVERAGE	1061.1	103	11.7	7.2	2.0	0.6	0	0.0	
MAXIMUM	1585.0	155	12.3	7.2	3.5	0.9	0	0.0	
MINIMUM	0.0	0	9.7	7.1	0.0	0.4	0	0.0	
01	1118.0	110	11.8		1.5		0	0.0	04-15-96 THRU 04-18-96 PLANT OFFLINE FOR GST CLEANING <i>Well artesian pressure Ops</i>
02	968.0	95	11.8	7.2	3.3	0.8	0	0.0	
03	1157.0	110	11.4		2.7		0	0.0	
04	1057.0	105	11.9		1.7		0	0.0	
05	1215.0	120	11.8		1.6		0	0.0	
06	1126.0	110	11.7		2.9		0	0.0	
07	1125.0	110	11.7		2.6		0	0.0	
08	1128.0	110	11.7	7.1	3.5	0.9	0	0.0	
09	1220.0	120	11.8		2.1		0	0.0	
10	1146.0	115	12.0		3.5		0	0.0	
11	1214.0	120	11.9		2.1		0	0.0	
12	1385.0	130	11.3		1.5		0	0.0	
13	1333.0	135	12.1		2.0		0	0.0	
14	1435.0	140	11.7		1.8		0	0.0	
15	0.0	0			2.1		0		
16	0.0	0			2.0		0		
17	0.0	0			0.0		0		
18	0.0	0			0.0		0		
19	1225.0	120	11.7	7.2	2.0	0.4	0	0.0	
20	1129.0	110	11.7		1.2		0	0.0	
21	1565.0	150	11.5		1.7		0	0.0	
22	1308.0	130	11.9		2.0		0	0.0	
23	1246.0	120	11.5		1.9		0	0.0	
24	1294.0	125	11.6		2.1		0	0.0	
25	1240.0	100	9.7	7.2	2.4	0.4	0	0.0	
26	1173.0	120	12.3		1.6		0	0.0	
27	1585.0	155	11.7		1.3		0	0.0	
28	1260.0	125	11.9		1.8		0	0.0	
29	1220.0	120	11.8		1.7		0	0.0	
30	961.0	95	11.9	7.2	3.0	0.5	0	0.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-001

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Charles H. Collins Sr., C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	31547.0	3150	371.3	28.8	65.8	2.3	0	0.0	
AVERAGE	1017.6	102	12.0	7.2	2.1	0.6	0	0.0	
MAXIMUM	1220.0	120	13.3	7.2	3.6	0.9	0	0.0	
MINIMUM	859.0	85	10.8	7.2	0.8	0.4	0	0.0	
01	906.0	90	11.9		2.4		0	0.0	Zinc polyphosphate off line due to mechanical problems
02	904.0	90	11.9		1.6		0	0.0	
03	1089.0	110	12.1		3.1		0	0.0	
04	1082.0	110	12.2	7.2	2.3	0.5	0	0.0	
05	1058.0	105	11.9		3.2		0	0.0	
06	1005.0	100	11.9		2.1		0	0.0	
07	893.0	90	12.1		3.0		0	0.0	
08	1063.0	110	12.4		3.0		0	0.0	
09	1126.0	120	12.8		1.6		0	0.0	
10	903.0	100	13.3		1.2		0	0.0	
11	926.0	90	11.7		3.6		0	0.0	
12	937.0	95	12.2	7.2	3.5	0.9	0	0.0	
13	980.0	95	11.6		1.9		0	0.0	
14	957.0	95	11.9		2.3		0	0.0	
15	859.0	85	11.9		2.2		0	0.0	
16	1181.0	120	12.2		2.7		0	0.0	
17	1176.0	120	12.2		1.5		0	0.0	
18	905.0	90	11.9		1.2		0	0.0	
19	943.0	95	12.1		0.8		0	0.0	
20	977.0	95	11.7	7.2	3.2	0.5	0	0.0	
21	901.0	90	12.0		3.4		0	0.0	
22	1144.0	115	12.1		2.2		0	0.0	
23	1132.0	115	12.2		1.1		0	0.0	
24	1098.0	110	12.0		0.8		0	0.0	
25	1121.0	110	11.8	7.2	1.4	0.4	0	0.0	
26	1220.0	110	10.8		1.3		0	0.0	
27	972.0	95	11.7		2.3		0	0.0	
28	1029.0	100	11.7		1.6		0	0.0	
29	1125.0	110	11.7		2.3		0	0.0	
30	1018.0	100	11.8		1.6		0	0.0	
31	917.0	90	11.8		1.4		0	0.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-2

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Reedley H. Polk Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	29145.0	2919	348.5	36.0	72.6	2.4	321	37.9	
AVERAGE	1005.0	101	12.0	7.2	2.5	0.6	11	1.3	
MAXIMUM	1248.0	120	13.2	7.2	3.5	0.7	31	3.1	
MINIMUM	789.0	80	11.2	7.2	1.5	0.5	0	0.0	
01	998.0	100	12.0		2.0		25	3.0	ARTESIAN LEVEL 0# P S I
02	980.0	100	12.2	7.2	3.3	0.6	25	3.1	
03	1000.0	110	13.2		1.7		25	3.0	
04	939.0	100	12.8		2.5		23	2.9	
05	1248.0	120	11.5		2.8		31	3.0	
06	996.0	100	12.0		1.5		15	1.8	
07	1059.0	105	11.9	7.2	3.2	0.6	15	1.7	
08	845.0	85	12.1		3.4		13	1.8	
09	1042.0	105	12.1		2.7		15	1.8	
10	905.0	90	11.9		1.8		0	0.0	
11	1040.0	105	12.1		2.4		0	0.0	
12	959.0	95	11.9	7.2	2.8	0.5	0	0.0	
13	927.0	90	11.6		2.7		0	0.0	
14	996.0	100	12.0		3.0		0	0.0	
15	1000.0	110	13.2		3.5		15	1.8	
16	1066.0	100	11.2		2.7		16	1.8	
17	1073.0	100	11.2		1.7		16	1.8	
18	1126.0	115	12.2		1.8		17	1.8	
19	789.0	80	12.2		2.0		10	1.6	
20	969.0	95	11.8	7.2	3.3	0.7	14	1.8	
21	1006.0	100	11.9		2.3		15	1.8	
22	999.0	100	12.0		3.2		15	1.8	
23	1074.0	107	11.9		2.5		16	1.8	
24	1015.0	100	11.8		1.8		0	0.0	
25	1109.0	110	11.9		2.5		0	0.0	
26	1020.0	100	11.8	7.2	2.0		0	0.0	
27	1084.0	110	12.2		1.8		0	0.0	
28	1074.0	107	11.9		2.2		0	0.0	
29	807.0	80	11.9		3.5		0	0.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYS1. MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1996


PLANT EFFLUENT pH: 7.0 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	27139.0	2641	337.3	35.0	76.0	2.9	611	74.3	
AVERAGE	875.5	85	11.6	7.0	2.5	0.6	20	2.6	
MAXIMUM	1312.0	130	15.6	7.0	3.5	1.0	33	3.0	
MINIMUM	0.0	0	7.4	7.0	1.0	0.4	0	0.0	
01	1050.0	100	11.4		1.0		0	0.0	WELL ARTESIAN LEVEL 0# PSI
02	952.0	95	12.0		1.0		0	0.0	
03	0.0	0			3.1		0		
04	488.0	50	12.3		1.2		0	0.0	
05	15.0	1	8.0	7.0	3.5	1.0	0	0.0	
06	0.0	0			1.2		0		
07	1121.0	110	11.8		1.0		28	2.9	
08	1266.0	120	11.4		3.5		31	3.0	
09	960.0	95	11.9		3.5		24	3.0	
10	1312.0	130	11.9	7.0	2.2	0.5	33	3.0	
11	808.0	80	11.9		2.9		20	3.0	
12	1298.0	80	7.4		2.7		33	3.0	
13	925.0	120	15.6		2.5		23	2.9	
14	958.0	90	11.3		1.5		24	3.0	
15	1095.0	95	10.4		2.9		27	3.0	
16	888.0	110	14.9		3.3		22	3.0	
17	960.0	85	10.6	7.0	2.2	0.4	24	3.0	
18	946.0	95	12.0		2.9		24	3.0	
19	914.0	95	12.5		2.7		23	3.0	
20	978.0	85	10.4		3.5		24	2.9	
21	926.0	95	12.3		3.2		23	3.0	
22	962.0	90	11.2	7.0	2.7	0.6	24	3.0	
23	901.0	90	12.0		2.6		23	3.0	
24	905.0	90	11.9		3.4		23	3.0	
25	822.0	80	11.7		3.2		21	3.0	
26	980.0	100	12.2		2.3		24	2.9	
27	991.0	100	12.1		2.2		24	2.9	
28	1041.0	100	11.5		1.9		26	3.0	
29	943.0	90	11.4	7.0	1.0	0.4	24	3.0	
30	866.0	85	11.8		3.2		21	3.0	
31	868.0	85	11.7		2.0		21	3.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

WS ID NO. 216-0924 C.U.P. NO. 2-031-0015a

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: December, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Paul H. Johnson Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2547.0	177.0	259.9	35.9	84.6	3.7	
AVERAGE	82.2	5.7	8.4	7.2	2.7	0.7	
MAXIMUM	155.0	10.0	10.0	7.2	3.5	1.0	
MINIMUM	12.0	1.0	5.8	7.1	1.5	0.5	
01	70.0	5.0	8.6		3.2		
02	71.0	5.0	8.4	7.2	3.0	0.5	
03	69.0	5.0	8.7		3.0		
04	88.0	6.0	8.2		2.5		
05	74.0	5.0	8.1		2.5		
06	51.0	3.0	7.1		2.8		
07	108.0	8.0	8.9		2.5		Well artesian pressure
08	155.0	10.0	7.7		2.3		0 psi
09	82.0	4.0	5.8		2.0		
10	120.0	9.0	9.0	7.1	2.4	0.5	
11	52.0	4.0	9.2		3.2		
12	77.0	5.0	7.8		2.8		
13	12.0	1.0	10.0		3.2		
14	84.0	6.0	8.6		2.2		
15	115.0	7.0	7.3		2.6		
16	52.0	4.0	9.2		2.8		
17	34.0	2.0	7.1	7.2	3.5	1.0	
18	59.0	4.0	8.1		3.5		
19	64.0	5.0	9.4		3.0		
20	79.0	6.0	9.1		3.1		
21	104.0	7.0	8.1		3.0		
22	133.0	10.0	9.0		3.0		
23	99.0	7.0	8.5	7.2	3.2	0.9	
24	92.0	6.0	7.8		1.5		
25	58.0	4.0	8.3		2.0		
26	86.0	7.0	9.8		3.0		
27	67.0	5.0	8.9		2.6		
28	111.0	8.0	8.6		2.5		
29	109.0	6.0	6.6		2.0		
30	84.0	6.0	8.6		2.6		
31	88.0	7.0	9.5	7.2	3.1	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 12-03-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PYS ID NO. 216-0924 C.U.P. NO. 2-031-0015X

NAME OF DRINKING WATER SYSTEM: QUEEN-LIPPS W.P.S.

LOCATION: 758 ST. JAMES BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: November, 1998

PLANT EFFLUENT PH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT _____, C.O., CERT. NO. C-_____

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2493.0	199.0	286.8	29.7	82.4	2.6	
AVERAGE	83.1	6.6	9.6	7.2	2.7	0.7	
MAXIMUM	130.0	10.0	11.4	7.2	3.5	1.0	
MINIMUM	25.0	2.0	8.0	7.1	1.0	0.5	
01	109.0	10.0	11.0		3.5		
02	95.0	9.0	11.4		3.0		
03	102.0	9.0	10.6		1.0		
04	115.0	10.0	10.4	7.2	3.0	1.0	
05	116.0	10.0	10.3		3.2		
06	138.0	10.0	9.2		3.0		
07	75.0	6.0	9.5		2.8		
08	67.0	5.0	8.9		3.0		
09	85.0	6.0	8.5		3.0		
10	103.0	8.0	8.5		2.6		
11	89.0	7.0	9.4		2.8		
12	68.0	5.0	8.8		3.0		
13	103.0	8.0	8.9	7.2	1.0		
14	99.0	5.0	10.3		2.5	0.5	
15	25.0	2.0	9.6		2.0		
16	103.0	8.0	9.3		2.9		
17	124.0	10.0	9.7		3.5		
18	69.0	6.0	10.4	7.2	2.5	0.6	
19	73.0	5.0	8.2		2.8		
20	102.0	8.0	9.4		3.0		
21	25.0	2.0	9.6		3.0		
22	34.0	3.0	10.6		2.6		
23	124.0	9.0	8.7		2.5		
24	83.0	7.0	10.1		2.0		
25	72.0	8.0	10.0		2.2		
26	81.0	6.0	8.9	7.1	2.0	0.5	
27	50.0	4.0	9.6		3.5		
28	65.0	5.0	9.2		2.6		
29	66.0	4.0	8.8		3.2		
30	77.0	6.0	9.3		3.5		

Well artesian pressure @ psi

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015X

NAME OF DRINKING WATER SYSTEM: QUEEN-AXERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: October, 1996


PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2350.0	148.0	236.1	36.0	88.7	4.2	
AVERAGE	75.8	4.8	7.6	7.2	2.9	0.8	
MAXIMUM	129.0	9.0	10.9	7.2	3.5	1.0	
MINIMUM	11.0	1.0	6.1	7.2	0.9	0.5	
01	65.0	4.0	7.4		3.5		
02	74.0	5.0	8.1	7.2	3.5	1.0	
03	47.0	3.0	7.7		3.5		
04	11.0	1.0	10.9		3.5		
05	71.0	6.0	10.1		3.0		
06	111.0	9.0	9.7		2.8		
07	40.0	3.0	9.0		3.1		Well artesian pressure
08	86.0	5.0	7.0	7.2	3.0	0.8	0 psi
09	66.0	4.0	7.3		2.6		
10	54.0	3.0	6.7		3.0		
11	59.0	3.0	6.1		3.0		
12	86.0	5.0	7.0		2.5		
13	95.0	6.0	7.6		3.5		
14	58.0	3.0	6.2	7.2	2.7	0.9	
15	73.0	4.0	6.6		3.2		
16	65.0	4.0	7.4		3.2		
17	78.0	5.0	7.7		3.5		
18	81.0	5.0	7.4		3.1		
19	94.0	6.0	7.7		3.0		
20	129.0	8.0	7.4		3.3		
21	74.0	4.0	6.5	7.2	3.0	1.0	
22	81.0	5.0	7.4		3.0		
23	68.0	4.0	7.1		2.5		
24	68.0	4.0	7.1		3.0		
25	108.0	7.0	7.8		3.0		
26	106.0	7.0	7.9		2.4		
27	119.0	7.0	7.1		2.2		
28	74.0	5.0	8.1		0.9		
29	74.0	5.0	8.1	7.2	2.2	0.5	
30	76.0	4.0	6.3		3.0		
31	59.0	4.0	8.1		1.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: September, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Paul J. Adams*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2680.0	--	212.0	288.2	36.0	88.7	6.0
AVERAGE	89.3		7.1	9.6	7.2	3.0	1.2
MAXIMUM	150.0		13.0	12.8	7.2	3.5	2.5
MINIMUM	41.0		4.0	6.3	7.2	1.2	0.4
01	47.0		5.0	12.8		2.5	
02	127.0		11.0	10.4		2.2	
03	62.0		5.0	9.7	7.2	1.2	0.4
04	78.0		7.0	10.8		2.0	
05	74.0		6.0	9.7		2.5	
06	41.0		4.0	11.7		2.0	
07	134.0		12.0	10.7		3.5	Well artesian pressure
08	150.0		13.0	10.4		3.1	0 psi
09	59.0		6.0	12.2	7.2	3.5	1.3
10	54.0		5.0	11.1		3.5	
11	61.0		5.0	9.8		3.5	
12	67.0		6.0	10.7		3.5	
13	108.0		10.0	11.1		3.5	
14	97.0		9.0	11.1		3.5	
15	125.0		10.0	9.6		3.5	
16	83.0		7.0	10.1	7.2	2.8	1.0
17	87.0		7.0	9.6		2.0	
18	88.0		7.0	9.5		2.9	
19	89.0		7.0	9.4		3.0	
20	84.0		7.0	10.0		3.0	
21	99.0		9.0	10.9		3.5	
22	111.0		10.0	10.8		2.2	
23	76.0		4.0	6.3	7.2	3.0	0.8
24	81.0		5.0	7.4		2.5	
25	98.0		6.0	7.3		3.0	
26	95.0		5.0	6.3		3.5	
27	86.0		5.0	7.0		3.5	
28	126.0		7.0	6.7		3.5	
29	129.0		8.0	7.4		3.3	
30	64.0		4.0	7.5	7.2	3.5	2.5

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

Counted copy
9/25

PWS ID NO. 216-0924 C.U.P. NO. 2-031-001

NAME OF DRINKING WATER SYS. QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Randy G Adams, Sr, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2753.0	239.0	327.8	29.2	91.5	3.0	
AVERAGE	88.8	7.7	10.6	7.3	3.0	0.8	
MAXIMUM	165.0	14.0	14.5	7.3	3.5	1.3	
MINIMUM	52.0	5.0	7.5	7.3	1.3	0.5	
01	97.0	9.0	11.1		3.0		
02	65.0	6.0	11.1		3.5		
03	52.0	5.0	11.5		3.5		
04	90.0	7.0	9.3		3.5		
05	97.0	9.0	11.1		2.9		
06	89.0	8.0	10.8	7.3	3.5	0.5	
07	65.0	6.0	11.1		3.5		Well artesian pressure 0 psi
08	76.0	7.0	11.0		3.5		
09	77.0	7.0	10.9		3.5		
10	165.0	14.0	10.2		3.5		
11	77.0	9.0	14.0		2.8		
12	64.0	6.0	11.2	7.3	3.5	1.3	
13	59.0	6.0	12.2		3.0		
14	58.0	6.0	12.4		3.2		
15	68.0	5.0	8.8		3.5		
16	84.0	7.0	10.0		3.0		
17	114.0	10.0	10.5		3.5		
18	133.0	11.0	9.9		3.5		
19	97.0	8.0	9.9	7.3	3.5	0.5	
20	86.0	7.0	9.8		3.5		
21	74.0	5.0	8.1		1.8		
22	80.0	5.0	7.5		2.5		
23	97.0	8.0	9.9		2.6		
24	141.0	11.0	9.4		1.9		
25	130.0	11.0	10.1		1.9		
26	88.0	7.0	9.5	7.3	1.3	0.7	
27	126.0	10.0	9.5		2.2		
28	89.0	8.0	10.8		2.5		
29	94.0	8.0	10.2		2.7		
30	63.0	6.0	11.4		2.7		
31	58.0	7.0	14.5		2.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 08-06-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00:

NAME OF DRINKING WATER SYS QUEEN-AXERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: August, 1996


PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

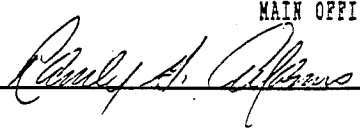

, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2753.0	239.0	327.8	29.2	91.5	3.0	
AVERAGE	88.8	7.7	10.6	7.3	3.0	0.8	
MAXIMUM	165.0	14.0	14.5	7.3	3.5	1.3	
MINIMUM	52.0	5.0	7.5	7.3	1.3	0.5	
01	97.0	9.0	11.1		3.0		
02	65.0	6.0	11.1		3.5		
03	52.0	5.0	11.5		3.5		
04	90.0	7.0	9.3		3.5		
05	97.0	9.0	11.1		2.9		
06	89.0	8.0	10.8	7.3	3.5	0.5	
07	65.0	6.0	11.1		3.5		Well artesian pressure
08	76.0	7.0	11.0		3.5		0 psi
09	77.0	7.0	10.9		3.5		
10	165.0	14.0	10.2		3.5		
11	77.0	9.0	14.0		2.8		
12	64.0	6.0	11.2	7.3	3.5	1.3	
13	59.0	6.0	12.2		3.0		
14	58.0	6.0	12.4		3.2		
15	68.0	5.0	8.8		3.5		
16	84.0	7.0	10.0		3.0		
17	114.0	10.0	10.5		3.5		
18	133.0	11.0	9.9		3.5		
19	97.0	8.0	9.9	7.3	3.5	0.5	
20	86.0	7.0	9.8		3.5		
21	74.0	5.0	8.1		1.8		
22	80.0	5.0	7.5		2.5		
23	97.0	8.0	9.9		2.6		
24	141.0	11.0	9.4		1.9		
25	130.0	11.0	10.1		1.9		
26	88.0	7.0	9.5	7.3	1.3	0.7	
27	126.0	10.0	9.5		2.2		
28	89.0	8.0	10.8		2.5		
29	94.0	8.0	10.2		2.7		
30	63.0	6.0	11.4		2.7		
31	58.0	7.0	14.5		2.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 08-06-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-00

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: July, 1996

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Rocky A. Adams Sr., C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3367.0	261.0	276.6	21.9	86.5	1.8	
AVERAGE	108.6	8.4	8.9	7.3	2.8	0.6	
MAXIMUM	174.0	15.0	12.0	7.3	3.5	0.8	
MINIMUM	36.0	2.0	4.1	7.3	1.0	0.4	
01	88.0	3.0	4.1		3.0		
02	103.0	10.0	11.6		2.8		
03	67.0	5.0	8.9		3.5		
04	50.0	3.0	7.2		3.5		
05	36.0	2.0	6.7	7.3	2.5	0.6	
06	38.0	3.0	9.5		3.5		
07	84.0	5.0	7.1		3.5		Well artesian pressure 0 psi
08	51.0	3.0	7.1		3.5		
09	57.0	4.0	8.4		3.5		
10	73.0	4.0	6.6		3.5		
11	63.0	3.0	5.7		2.7		
12	72.0	4.0	6.7		3.1		
13	108.0	6.0	6.7		2.8		
14	126.0	7.0	6.7		3.2		
15	174.0	11.0	7.6	7.3	1.5	0.4	
16	174.0	11.0	7.6		1.0		
17	128.0	11.0	10.3		3.0		
18	113.0	10.0	10.6		3.5		
19	135.0	12.0	10.7		3.0		
20	158.0	14.0	10.6		2.3		
21	138.0	12.0	10.4		1.9		
22	157.0	14.0	10.7		1.5		
23	120.0	10.0	10.0		2.2		
24	100.0	10.0	12.0		1.2		
25	125.0	12.0	11.5		3.5		
26	158.0	15.0	11.4	7.3	3.0	0.8	
27	119.0	6.0	6.0		3.2		
28	125.0	12.0	11.5		3.0		
29	144.0	13.0	10.8		3.5		
30	141.0	12.0	10.2		1.6		
31	142.0	14.0	11.8		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 07-17-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-001... NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.
 LOCATION: 758 ST. JOHNS BLUFF ROAD JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA, INC. REPORTING MONTH: June, 1996
 PLANT EFFLUENT pH: 7.3 (AVG.) NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT David E. Kimbrell, C.O., CERT. NO. C-6317

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2296.0	174.0	320.2	29.2	81.2	3.1	
AVERAGE	76.5	5.8	11.0	7.3	2.7	1.0	
MAXIMUM	159.0	12.0	60.0	7.3	3.5	1.6	
MINIMUM	0.0	0.0	5.9	7.3	1.0	0.6	
01	133.0	9.0	8.1		2.5		
02	121.0	9.0	8.9		1.5		
03	152.0	11.0	8.7	7.3	1.5		
04	128.0	10.0	9.4		1.0		
05	159.0	12.0	9.0		2.3		
06	140.0	11.0	9.4		2.1		
07	106.0	8.0	9.0		2.0		Well artesian pressure 0 psi
08	93.0	5.0	6.4		2.2		
09	114.0	9.0	9.5		3.5		
10	73.0	6.0	9.9	7.3	2.5		
11	57.0	5.0	10.5		3.5	0.9	
12	95.0	7.0	8.8		3.5		
13	69.0	5.0	8.7		3.0		
14	31.0	3.0	11.6		3.5		
15	31.0	3.0	11.6		3.0		
16	97.0	8.0	9.9		3.1		
17	67.0	5.0	8.9	7.3	3.2	1.6	
18	68.0	5.0	8.8		3.5		
19	33.0	2.0	7.3		3.5		
20	13.0	1.0	9.2		3.5		
21	2.0	1.0	60.0		3.5		
22	53.0	6.0	13.6		1.4		
23	0.0	0.0			2.7		
24	71.0	5.0	8.4	7.3	2.5		
25	83.0	6.0	8.7		1.8		
26	56.0	4.0	8.6		2.8	0.6	
27	34.0	2.0	7.1		2.6		
28	46.0	6.0	15.6		3.5		
29	70.0	5.0	8.6		2.5		
30	101.0	5.0	5.9		3.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: May, 1996

PLANT EFFLUENT pH: 7.3 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy A. Williams Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3039.0	--	210.0	188.0	14.5	60.5	1.0
AVERAGE	98.0		6.8	8.2	7.3	2.0	1.0
MAXIMUM	255.0		20.0	11.2	7.3	3.5	1.0
MINIMUM	0.0		0.0	4.2	7.2	0.0	1.0
01	0.0		0.0			0.0	5/1/96- 5/8/96 PLANT OFF LINE FOR REPAIRS.
02	0.0		0.0			0.0	
03	0.0		0.0			0.0	
04	0.0		0.0			0.0	
05	0.0		0.0			0.0	
06	0.0		0.0			0.0	
07	0.0		0.0			0.0	
08	0.0		0.0			3.5	Well artesian pressure 0 psi
09	14.0		1.0	8.6		3.5	
10	204.0		15.0	8.8		3.5	
11	234.0		17.0	8.7		1.6	
12	255.0		20.0	9.4		1.9	
13	128.0		12.0	11.2		3.0	
14	96.0		7.0	8.7		3.0	
15	150.0		13.0	10.4		3.0	
16	119.0		5.0	5.0		3.0	
17	131.0		12.0	11.0		2.5	
18	169.0		6.0	4.3		3.0	
19	121.0		7.0	6.9		2.4	
20	131.0		9.0	8.2		3.0	
21	98.0		7.0	8.6	7.2	3.5	1.0
22	122.0		9.0	8.8		1.0	
23	135.0		10.0	8.9		1.5	
24	129.0		9.0	8.4		2.0	
25	149.0		10.0	8.0		1.7	
26	147.0		11.0	9.0		3.0	
27	156.0		11.0	8.5		2.4	
28	85.0		3.0	4.2		2.0	
29	60.0		4.0	8.0	7.3	2.4	
30	118.0		6.0	6.1		1.9	
31	88.0		6.0	8.2		2.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 05-15-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: April, 1996

PLANT EFFLUENT PH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy H. Allen Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2147.0	185.0	149.2	21.6	47.4	3.7	
AVERAGE	134.2	11.6	9.9	7.2	3.0	1.2	
MAXIMUM	361.0	32.0	14.0	7.2	3.5	1.5	
MINIMUM	0.0	0.0	7.8	7.2	1.2	1.0	
01							04-01-96 THRU 04-14-96 PLANT OFF-LINE FOR PAINTING
02							Well artesian pressure 0 psi
03							
04							
05							
06							
07							
08							
09							
10							
11							
12							
13							
14							
15	146.0	17.0	14.0		2.4		
16	263.0	24.0	10.9		2.8		
17	294.0	27.0	11.0		3.5		
18	361.0	32.0	10.6	7.2	3.5	1.2	
19	103.0	10.0	11.6		2.0		
20	94.0	9.0	11.5		3.5		
21	140.0	12.0	10.3		3.5		
22	101.0	8.0	9.5		3.5		
23	95.0	7.0	8.8	7.2	3.3	1.5	
24	121.0	8.0	7.9		3.5		
25	92.0	6.0	7.8		3.5		
26	83.0	6.0	8.7		1.2		
27	124.0	9.0	8.7		3.5		
28	101.0	8.0	9.5		1.8		
29	29.0	2.0	8.3	7.2	3.0	1.0	
30	0.0	0.0			2.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-001

NAME OF DRINKING WATER SYSTEM: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy A. Olsen Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1522.0	91.0	302.6	28.8	75.1	5.0	
AVERAGE	49.1	3.6	12.1	7.2	3.0	1.3	
MAXIMUM	165.0	8.0	119.9	7.2	3.5	1.6	
MINIMUM	0.0	1.0	2.9	7.2	1.5	0.8	
01	14.0	1.0	8.6		3.1		Plant off-line for painting March 25, 1996
02	60.0	4.0	8.0		2.6		
03	114.0	7.0	7.4		2.3		
04	66.0	4.0	7.3	7.2	2.2	0.8	
05	62.0	4.0	7.7		2.0		
06	52.0	3.0	6.9		1.5		
07	35.0	2.0	6.9		3.5		
08	13.0	2.0	18.4		3.3		
09	1.0	1.0	119.9		3.0		
10	100.0	8.0	9.6		3.0		
11	47.0	3.0	7.7		3.1		
12	49.0	3.0	7.3	7.2	3.5	1.3	
13	59.0	4.0	8.1		3.5		
14	55.0	3.0	6.5		3.0		
15	38.0	2.0	6.3		3.0		
16	94.0	6.0	7.7		3.0		
17	105.0	7.0	8.0		3.2		
18	36.0	2.0	6.7	7.2	3.5	1.6	
19	54.0	3.0	6.7		3.5		
20	48.0	3.0	7.5		3.5		
21	52.0	3.0	6.9		3.5		
22	165.0	4.0	2.9		3.0		
23	86.0	5.0	7.0		3.5		
24	93.0	6.0	7.7		3.2		
25	24.0	1.0	5.0	7.2	2.6	1.3	
26	0.0						
27	0.0						
28	0.0						
29	0.0						
30	0.0						
31	0.0						

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031

NAME OF DRINKING WATER: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: February, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Randy H. Adams Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2023.0	130.0	220.0	36.0	77.1	4.8	
AVERAGE	69.8	4.5	7.6	7.2	2.7	1.0	
MAXIMUM	181.0	11.0	10.4	7.2	3.5	1.3	
MINIMUM	25.0	1.0	4.6	7.2	0.9	0.7	
01	47.0	3.0	7.7		3.2		ARTESIAN LEVEL 04 P S I
02	26.0	1.0	4.6	7.2	1.7	1.0	
03	25.0	1.0	4.8		2.6		
04	115.0	10.0	10.4		2.2		
05	181.0	11.0	7.3		2.5		
06	53.0	3.0	6.8		0.9		
07	47.0	3.0	7.7	7.2	3.0	0.9	
08	40.0	3.0	9.0		3.5		
09	65.0	4.0	7.4		3.5		
10	62.0	4.0	7.7		2.7		
11	118.0	7.0	7.1		3.5		
12	40.0	2.0	6.0	7.2	3.5	1.3	
13	49.0	3.0	7.3		3.5		
14	60.0	4.0	8.0		3.5		
15	52.0	4.0	9.2		3.0		
16	26.0	2.0	9.2		2.8		
17	93.0	5.0	6.4		3.5		
18	118.0	7.0	7.1		3.5		
19	73.0	5.0	8.2		1.5		
20	60.0	3.0	6.0	7.2	2.5	0.9	
21	67.0	5.0	8.9		2.0		
22	66.0	5.0	9.1		1.0		
23	76.0	5.0	7.9		3.5		
24	90.0	6.0	8.0		3.0		
25	114.0	7.0	7.4		1.4		
26	80.0	5.0	7.5	7.2	1.7	0.7	
27	75.0	5.0	8.0		2.3		
28	68.0	5.0	8.8		2.5		
29	37.0	2.0	6.5		3.1		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 216-1326 C.U.P. NO. 2-031-0015

NAME OF DRINKING WATER SYS: QUEEN-AKERS W.T.P.

LOCATION: 758 ST. JOHNS BLUFF ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: January, 1996

PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Paul G. Allen Sr.*, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	2435.0	147.2	282.0	35.8	92.6	7.2	
AVERAGE	78.5	4.7	9.4	7.2	3.0	1.4	
MAXIMUM	361.0	22.0	60.0	7.2	3.5	1.7	
MINIMUM	0.0	0.0	5.2	7.0	1.0	1.2	
01	2.0	1.0	60.0		2.8		WELL ARTESIAN LEVEL 0# PSI
02	17.0	1.0	7.1		3.5		
03	361.0	22.0	7.3		2.4		
04	231.0	14.0	7.3		1.7		
05	179.0	10.0	6.7	7.0	3.5	1.2	
06	256.0	15.0	7.0		3.5		
07	99.0	6.0	7.3		3.5		
08	96.0	6.0	7.5		3.5		
09	55.0	3.0	6.5		3.5		
10	62.0	4.0	7.7	7.2	3.5	1.4	
11	63.0	4.0	7.6		3.5		
12	23.0	1.0	5.2		3.5		
13	2.0	0.2	11.4		3.5		
14	94.0	6.0	7.7		3.0		
15	68.0	4.0	7.1	7.2	3.5	1.5	
16	66.0	4.0	7.3		3.5		
17	70.0	4.0	6.9		2.2		
18	54.0	3.0	6.7		1.0		
19	71.0	4.0	6.8		1.8		
20	14.0	1.0	8.6		3.5		
21	14.0	1.0	8.6		2.0		
22	71.0	4.0	6.8	7.2	3.5	1.4	
23	77.0	4.0	6.2		3.5		
24	87.0	5.0	6.9		2.8		
25	100.0	6.0	7.2		2.5		
26	16.0	2.0	15.0		3.5		
27	66.0	4.0	7.3		3.3		
28	0.0	0.0			2.1		
29	53.0	3.0	6.8	7.2	3.5	1.7	
30	43.0	3.0	8.4		2.5		
31	25.0	2.0	9.6		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 3

SAMPLE DATE: 01-15-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: HYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3458.0	213.0	231.2	144.0	49.6	18.0	
AVERAGE	111.5	6.9	7.5	7.2	1.6	0.9	
MAXIMUM	165.0	16.0	13.0	7.2	1.9	1.2	
MINIMUM	61.0	4.0	3.5	7.2	1.2	0.4	
01	77.0	5.0	7.8		1.5		
02	111.0	7.0	7.6	7.2	1.6	0.8	
03	148.0	9.0	7.3	7.2	1.6	0.9	
04	77.0	4.0	6.2	7.2	1.7	0.9	
05	135.0	6.0	5.3	7.2	1.7	1.1	
06	97.0	5.0	6.2	7.2	1.8	1.0	
07	108.0	5.0	5.6		1.6		
08	122.0	9.0	8.9		1.5		
09	114.0	8.0	8.4	7.2	1.6	0.8	
10	100.0	5.0	6.0	7.2	1.5	0.9	
11	107.0	7.0	7.9	7.2	1.5	1.0	
12	127.0	5.0	4.7	7.2	1.5	1.0	
13	103.0	5.0	5.8	7.2	1.5	1.0	
14	110.0	6.0	6.5		1.6		
15	117.0	6.0	6.2		1.6		
16	108.0	6.0	6.7	7.2	1.6	1.0	
17	67.0	4.0	7.2	7.2	1.7	1.2	
18	98.0	4.0	4.9	7.2	1.2	0.4	
19	152.0	9.0	7.1	7.2	1.4	0.4	
20	116.0	7.0	7.2	7.2	1.6	0.6	
21	165.0	10.0	7.3		1.6		
22	148.0	16.0	13.0		1.5		
23	76.0	5.0	7.9	7.2	1.6	0.8	
24	127.0	9.0	8.5		1.6		
25	92.0	9.0	11.7		1.6		
26	144.0	9.0	7.5	7.2	1.9	1.2	
27	90.0	7.0	9.3	7.2	1.8	1.0	
28	99.0	7.0	8.5		1.8		
29	123.0	9.0	8.8		1.6		
30	61.0	6.0	11.8	7.2	1.6	1.0	
31	139.0	4.0	3.5	7.2	1.7	1.0	

OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 12-04-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: GLEN GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3657.0	191.0	187.8	151.2	47.1	20.3	
AVERAGE	121.9	6.4	6.3	7.2	1.6	1.0	
MAXIMUM	180.0	10.0	7.7	7.2	1.8	1.2	
MINIMUM	71.0	3.0	4.8	7.2	1.4	0.8	
01	125.0	7.0	6.7	7.2	1.6	1.1	
02	107.0	6.0	6.7		1.6		
03	118.0	6.0	6.1		1.5		
04	180.0	8.0	5.3	7.2	1.7	1.1	
05	150.0	9.0	7.2	7.2	1.6	0.9	
06	108.0	5.0	5.6	7.2	1.8	1.2	
07	120.0	6.0	6.0	7.2	1.6	1.0	
08	145.0	7.0	5.8	7.2	1.6	0.8	
09	105.0	6.0	6.9		1.8		
10	124.0	7.0	6.8		1.5		
11	71.0	3.0	5.1	7.2	1.4	0.9	
12	130.0	7.0	6.5	7.2	1.7	1.1	
13	108.0	6.0	6.7	7.2	1.6	1.1	
14	147.0	8.0	6.5	7.2	1.6	1.1	
15	144.0	8.0	6.7	7.2	1.6	1.0	
16	106.0	5.0	5.7		1.6		
17	129.0	6.0	5.6		1.6		
18	111.0	6.0	6.5	7.2	1.7	0.9	
19	136.0	7.0	6.2	7.2	1.5	0.9	
20	116.0	5.0	5.2	7.2	1.5	0.9	
21	129.0	6.0	5.6	7.2	1.5	1.0	
22	78.0	5.0	7.7	7.2	1.6	1.0	
23	99.0	4.0	4.8		1.4		
24	135.0	7.0	6.2		1.4		
25	105.0	5.0	5.7	7.2	1.5	0.8	
26	159.0	10.0	7.5	7.2	1.6	0.9	
27	109.0	7.0	7.7	7.2	1.6	0.9	
28	139.0	7.0	6.0	7.2	1.4	0.9	
29	110.0	7.0	7.6	7.2	1.4	0.8	
30	114.0	5.0	5.3		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 11-13-96

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WWS ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: HYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Shickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4079.0	228.0		165.6	50.7	23.4	
AVERAGE	131.6	7.4		7.2	1.6	1.0	
MAXIMUM	180.0	11.0		7.2	1.8	1.2	
MINIMUM	75.0	3.0		7.2	1.0	0.7	
01	122.0	8.0		7.2	1.8	1.2	
02	113.0	7.0		7.2	1.8	1.0	
03	130.0	8.0		7.2	1.5	0.9	
04	121.0	6.0		7.2	1.6	0.9	
05	117.0	8.0			1.8		
06	104.0	5.0			1.8		
07	177.0	8.0		7.2	1.8	0.9	
08	75.0	3.0		7.2	1.7	1.1	
09	177.0	8.0		7.2	1.2	0.7	
10	99.0	6.0		7.2	1.5	0.7	
11	124.0	4.0		7.2	1.6	0.8	
12	123.0	8.0			1.0		
13	130.0	11.0			1.5		
14	134.0	7.0		7.2	1.7	0.9	
15	103.0	6.0		7.2	1.7	1.2	
16	162.0	10.0		7.2	1.7	1.0	
17	123.0	6.0		7.2	1.5	1.1	
18	138.0	8.0		7.2	1.6	1.1	
19	143.0	8.0			1.6		
20	125.0	8.0			1.6		
21	132.0	8.0		7.2	1.6	1.2	
22	180.0	9.0		7.2	1.6	1.2	
23	150.0	7.0		7.2	1.7	1.1	
24	135.0	10.0		7.2	1.5	1.1	
25	85.0	5.0		7.2	1.8	1.0	
26	130.0	5.0			1.8		
27	155.0	8.0			1.8		
28	112.0	8.0		7.2	1.8	0.9	
29	158.0	9.0		7.2	1.7	1.0	
30	154.0	8.0		7.2	1.7	1.2	
31	148.0	8.0		7.2	1.7	1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 10-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160529 C.U.P. NO. 2-031-0035M

NAME OF DRINKING WATER SYSTEM: HALL GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. St. Island, C.O., CERT. NO. C-7255

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4492.0	286.0	231.6	144.0	54.0	22.3	
AVERAGE	149.7	9.5	7.7	7.2	1.8	1.1	
MINIMUM	252.0	14.0	11.9	7.2	2.1	1.4	
MAXIMUM	92.0	6.0	5.8	7.2	1.4	0.9	
01	101.0	10.0	11.9		1.8		
02	190.0	12.0	7.6		1.8		
03	143.0	8.0	6.7	7.2	1.9	1.4	
04	158.0	9.0	6.8	7.2	1.9	1.4	
05	164.0	10.0	7.3	7.2	2.1	1.4	
06	185.0	11.0	7.1	7.2	1.6	1.1	
07	197.0	12.0	7.3		1.8		
08	131.0	8.0	7.3		1.8		
09	144.0	9.0	7.5	7.2	1.6	0.9	
10	198.0	14.0	8.5	7.2	1.6	1.0	
11	112.0	6.0	6.4	7.2	2.1	1.2	
12	252.0	14.0	6.7	7.2	1.8	1.0	
13	140.0	7.0	6.0	7.2	1.8	0.9	
14	171.0	10.0	7.0		1.6		
15	139.0	9.0	7.8		2.0		
16	178.0	13.0	8.8	7.2	1.8	1.0	
17	135.0	8.0	7.1	7.2	1.8	1.2	
18	130.0	7.0	6.5	7.2	1.6	1.0	
19	155.0	9.0	7.0	7.2	1.8	1.0	
20	130.0	10.0	9.2	7.2	1.8	1.1	
21	122.0	6.0	5.9		1.6		
22	92.0	6.0	7.8		1.4		
23	187.0	13.0	8.3	7.2	1.9	1.1	
24	124.0	6.0	5.8	7.2	1.9	1.1	
25	135.0	10.0	8.9	7.2	1.9	1.2	
26	185.0	13.0	8.4	7.2	1.7	1.2	
27	165.0	10.0	7.3	7.2	1.9	1.0	
28	108.0	7.0	7.8		1.8		
29	126.0	10.0	9.5		1.9		
30	95.0	9.0	11.4	7.2	2.0	1.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 09-19-96

S ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: GROVE WATER TREATMENT PLANT

CATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DIRECTION OF FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Williams, C.O., CERT. NO. C-7255

WELL NO.	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4263.0	291.0	275.8	158.7	57.8	25.9	
BRIDGE	137.5	9.4	8.9	7.2	1.9	1.2	
KIMMUM	250.0	35.0	52.5	7.4	2.4	1.6	
NIMMUM	80.0	3.0	3.6	7.2	1.3	0.7	
01	159.0	8.0	6.0	7.2	2.1	1.1	
02	100.0	3.0	3.6	7.4	2.0	1.4	
03	130.0	8.0	7.4		1.4		
04	80.0	35.0	52.5		2.4		
05	131.0	6.0	5.5	7.2	1.7	1.4	
06	119.0	10.0	10.1	7.2	1.5	1.0	
07	142.0	9.0	7.6	7.2	2.2	1.6	
08	100.0	8.0	9.6	7.2	2.0	1.2	
09	142.0	10.0	8.5	7.2	2.0	1.3	
10	119.0	8.0	8.1	7.2	1.8	1.2	
11	134.0	9.0	8.1		1.8		
12	88.0	4.0	5.5		1.9		
13	129.0	8.0	7.4	7.2	2.0	1.3	
14	124.0	6.0	5.8	7.2	2.0	1.3	
15	124.0	7.0	6.8	7.2	1.8	0.7	
16	96.0	7.0	8.8	7.2	1.8	0.9	
17	144.0	8.0	6.7		2.0		
18	135.0	9.0	8.0		2.0		
19	156.0	7.0	5.4	7.2	2.1	1.1	
20	99.0	8.0	9.7	7.2	2.0	1.0	
21	200.0	10.0	6.0	7.3	1.3	0.8	
22	149.0	10.0	8.1	7.2	1.7	1.0	
23	147.0	10.0	8.2	7.2	1.8	1.2	
24	151.0	10.0	7.9		1.8		
25	123.0	10.0	9.8		1.8		
26	179.0	14.0	9.4	7.2	1.9	1.4	
27	130.0	9.0	8.3	7.2	1.9	1.5	
28	131.0	9.0	8.2	7.2	1.9	1.2	
29	186.0	11.0	7.1	7.2	1.8	1.2	
30	166.0	10.0	7.2	7.2	1.8	1.1	
31	250.0	10.0	4.8		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 08-01-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160529 C.U.P. NO. 2-031-0035X NAME OF DRINKING WATER SYSTEM: GROVE WATER TREATMENT PLANT
 LOCATION: 6927 HANSON DRIVE NORTH JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: July 1996
 INFLUENT pH: 7.2(AVG) NO. OF SERVICES AT END OF MONTH: _____
 SIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 CERTIFY THIS REPORT IS CORRECT Banner E. Stuebeland, C.O., CERT. NO. C-7255

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4299.0	277.0	242.0	166.2	56.9	21.4	
JANUARY	138.7	8.9	7.8	7.2	1.8	0.9	
FEBRUARY	217.0	15.0	11.9	7.3	2.2	1.2	
MARCH	77.0	5.0	4.2	7.2	1.4	0.7	
01	140.0	9.0	7.7	7.3	1.9	0.9	
02	143.0	5.0	4.2	7.2	2.2	1.1	
03	153.0	10.0	7.8	7.2	1.7	0.7	
04	160.0	10.0	7.5	7.2	2.2	1.2	
05	77.0	5.0	7.8	7.3	2.0	1.1	
06	88.0	5.0	6.8		1.6		
07	118.0	6.0	6.1		1.4		
08	104.0	8.0	9.2	7.3	1.6	0.8	
09	100.0	6.0	7.2	7.2	1.8	0.8	
10	217.0	8.0	4.4	7.2	2.1	0.9	
11	116.0	8.0	8.3	7.2	1.5	0.7	
12	158.0	10.0	7.6	7.2	1.7	0.7	
13	121.0	9.0	8.9		1.7		
14	144.0	9.0	7.5		1.6		
15	115.0	8.0	8.3	7.2	1.7	0.8	
16	170.0	11.0	7.4	7.2	1.7	0.8	
17	143.0	9.0	7.6	7.2	1.8	1.0	
18	142.0	9.0	7.6	7.2	1.8	0.9	
19	122.0	9.0	8.9	7.2	1.8	0.8	
20	186.0	13.0	8.4		1.6		
21	135.0	12.0	10.7		1.7		
22	152.0	9.0	7.1	7.3	1.8	0.8	
23	154.0	12.0	9.4	7.3	1.8	1.0	
24	126.0	10.0	9.5	7.3	2.0	1.2	
25	151.0	15.0	11.9	7.2	1.8	0.9	
26	88.0	7.0	9.5	7.2	2.1	1.1	
27	165.0	12.0	8.7		2.1		
28	155.0	13.0	10.1		2.0		
29	186.0	9.0	5.8	7.2	2.2	1.2	
30	134.0	6.0	5.4	7.2	2.0	1.0	
31	128.0	5.0	4.7	7.2	2.0	1.0	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM: GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Stillland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3846.0	290.0	273.1	158.4	58.6	21.7	
AVERAGE	128.2	9.7	9.1	7.2	2.0	1.0	
MAXIMUM	207.0	16.0	11.7	7.2	2.4	1.2	
MINIMUM	85.0	7.0	7.0	7.2	1.0	0.4	
01	156.0	12.0	9.2	7.2	1.9	1.2	
02	207.0	16.0	9.3	7.2	1.8	1.2	
03	129.0	8.0	7.4	7.2	2.1	1.1	
04	175.0	12.0	8.2	7.2	2.4	1.2	
05	158.0	10.0	7.6	7.2	2.4	1.2	
06	206.0	12.0	7.0	7.2	2.1	1.0	
07	129.0	12.0	11.2	7.2	2.0	1.1	
08	124.0	8.0	7.7		2.0		
09	120.0	9.0	9.0		2.4		
10	85.0	7.0	9.9	7.2	1.0	0.4	
11	110.0	8.0	8.7	7.2	2.2	0.9	
12	111.0	7.0	7.6	7.2	2.0	1.1	
13	117.0	8.0	8.2	7.2	1.9	1.1	
14	133.0	12.0	10.8	7.2	1.9	1.1	
15	109.0	9.0	9.9		2.1		
16	135.0	10.0	8.9		1.8		
17	120.0	9.0	9.0	7.2	1.8	1.0	
18	116.0	9.0	9.3	7.2	2.0	0.9	
19	125.0	10.0	9.6	7.2	2.0	1.1	
20	106.0	7.0	7.9	7.2	2.0	1.0	
21	103.0	8.0	9.3	7.2	1.8	0.8	
22	120.0	10.0	10.0		1.8		
23	139.0	13.0	11.2		1.6		
24	123.0	12.0	11.7	7.2	1.7	0.9	
25	98.0	9.0	11.0	7.2	2.0	0.9	
26	142.0	11.0	9.3	7.2	1.9	0.9	
27	98.0	7.0	8.6	7.2	1.9	0.8	
28	114.0	7.0	7.4	7.2	2.1	0.8	
29	116.0	8.0	8.3		2.0		
30	122.0	10.0	9.8		2.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2160529 C.U.P. NO. 2-031-0035Y

NAME OF DRINKING WATER SYSTEM: HYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Steward, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	5418.0	373.0	259.3	158.2	58.9	22.3	
AVERAGE	174.8	12.0	8.4	7.2	1.9	1.0	
MAXIMUM	255.0	20.0	13.2	7.2	2.1	1.3	
MINIMUM	79.0	6.0	4.5	7.1	1.5	0.7	
01	79.0	6.0	9.1	7.1	2.0	1.0	
02	155.0	10.0	7.7	7.1	1.8	0.9	
03	138.0	10.0	8.7	7.2	1.8	0.7	
04	149.0	10.0	8.1		2.0		
05	172.0	12.0	8.4		1.8		
06	160.0	6.0	4.5	7.2	2.1	1.1	
07	155.0	10.0	7.7	7.2	1.9	1.1	
08	134.0	8.0	7.2	7.2	1.9	0.9	
09	194.0	9.0	5.6	7.2	1.9	0.9	
10	200.0	11.0	6.6	7.2	2.0	1.0	
11	145.0	11.0	9.1		2.0		
12	198.0	13.0	7.9		2.0		
13	100.0	10.0	12.0	7.2	1.8	0.8	
14	213.0	14.0	7.9	7.2	1.8	0.9	
15	173.0	11.0	7.6	7.2	1.9	0.9	
16	169.0	12.0	8.5	7.2	1.9	1.1	
17	173.0	12.0	8.3	7.2	2.1	1.1	
18	176.0	13.0	8.9		1.8		
19	203.0	11.0	6.5		1.8		
20	182.0	9.0	5.9	7.2	1.8	1.0	
21	150.0	12.0	9.6	7.2	1.5	0.8	
22	229.0	17.0	8.9	7.2	1.9	1.3	
23	255.0	15.0	7.1	7.2	2.1	1.3	
24	205.0	14.0	8.2	7.2	2.0	1.0	
25	230.0	17.0	8.9		1.8		
26	213.0	16.0	9.0		1.8		
27	238.0	20.0	10.1		2.0		
28	146.0	16.0	13.2	7.2	2.1	1.3	
29	149.0	12.0	9.7	7.2	1.8	1.0	
30	159.0	12.0	9.1	7.2	1.8	1.0	
31	176.0	14.0	9.5	7.2	2.0	1.2	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM. LYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland Jr., C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3882.0	230.0		122.4	57.0	16.6	
AVERAGE	129.4	7.7		7.2	1.9	1.0	
MAXIMUM	195.0	11.0		7.2	2.2	1.2	
MINIMUM	78.0	4.0		7.2	1.6	0.7	
01	108.0	4.0		7.2	1.8	0.7	
02	107.0	5.0			1.6		
03	108.0	5.0			1.8		
04	95.0	8.0			1.8		
05	115.0	7.0		7.2	1.8	0.9	
06	111.0	5.0			1.8		
07	118.0	8.0			1.8		
08	109.0	4.0		7.2	1.9	1.1	
09	99.0	7.0			2.1		
10	123.0	7.0			2.1		
11	171.0	8.0			2.0		
12	119.0	7.0		7.2	1.8	0.7	
13	131.0	7.0			1.6		
14	171.0	11.0			1.6		
15	78.0	7.0		7.2	1.8	1.0	
16	108.0	7.0			2.0		
17	130.0	9.0		7.2	2.0	1.0	
18	175.0	10.0		7.2	2.1	1.2	
19	132.0	5.0		7.2	2.0	1.2	
20	147.0	9.0			2.0		
21	119.0	6.0			2.2		
22	148.0	10.0		7.2	1.9	1.1	
23	181.0	11.0		7.2	2.0	1.1	
24	101.0	7.0		7.2	2.2	1.2	
25	195.0	11.0		7.2	1.9	0.8	
26	134.0	5.0		7.2	2.0	1.0	
27	158.0	11.0		7.2	1.6	0.7	
28	142.0	10.0		7.2	1.8	0.9	
29	113.0	9.0		7.2	2.0	0.9	
30	136.0	10.0		7.2	2.0	1.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-08-96

COMMENTS:

ID NO. 2160529 C.U.P. NO. 2-031-0035N NAME OF DRINKING WATER SYSTEM: GROVE WATER TREATMENT PLANT
 LOCATION: 6927 HANSON DRIVE NORTH JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: March 1996
 INFLUENT pH: 7.2(AVG) NO. OF SERVICES AT END OF MONTH: _____
 INLET FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Banner E. Stulland, C.O., CERT. NO. C-7255

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
APRIL	4874.0	202.0	205.1	50.6	59.0	6.5	
MARCH	157.2	6.5	6.6	7.2	1.9	0.9	
JANUARY	1463.0	16.0	17.9	7.3	2.5	1.1	
FEBRUARY	84.0	2.0	0.8	7.2	1.5	0.7	
01	89.0	4.0	5.4	7.2	2.0	0.9	
02	104.0	4.0	4.6		1.8		
03	161.0	5.0	3.7		1.5		
04	100.0	4.0	4.8	7.2	1.8	0.9	
05	92.0	3.0	3.9		1.8		
06	118.0	2.0	2.0		1.8		
07	138.0	8.0	7.0		1.8		
08	92.0	5.0	6.5		2.0		
09	112.0	7.0	7.5		1.8		
10	133.0	5.0	4.5		1.6		
11	94.0	5.0	6.4	7.2	1.6	0.7	
12	134.0	8.0	7.2		1.8		
13	91.0	5.0	6.6		2.3		
14	93.0	10.0	12.9		2.1		
15	119.0	7.0	7.1	7.2	2.0	0.9	
16	132.0	5.0	4.5		1.5		
17	98.0	6.0	7.3		1.8		
18	113.0	7.0	7.4	7.2	2.1	0.9	
19	136.0	9.0	7.9		1.9		
20	110.0	6.0	6.5		2.0		
21	84.0	5.0	7.1		2.0		
22	126.0	7.0	6.7	7.3	2.0	1.1	
23	134.0	8.0	7.2		2.1		
24	1463.0	10.0	0.8		2.1		
25	150.0	9.0	7.2	7.3	2.2	1.1	
26	107.0	16.0	17.9		2.2		
27	106.0	7.0	7.9		2.5		
28	152.0	10.0	7.9		1.7		
29	93.0	5.0	6.5		1.8		
30	100.0	4.0	4.8		1.8		
31	100.0	6.0	7.2		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-07-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160529 C.U.P. NO. 2-031-0035N

NAME OF DRINKING WATER SYSTEM HYDE GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3782.0	334.0	294.4	51.0	48.6	8.0	
AVERAGE	130.4	11.5	10.2	7.3	1.7	1.1	
MAXIMUM	197.0	143.0	116.7	7.3	2.3	1.5	
MINIMUM	79.0	2.0	2.6	7.2	1.4	0.5	
01	113.0	8.0	8.5		1.4		
02	96.0	5.0	6.3	7.3	1.4	0.5	
03	122.0	7.0	6.9		1.5		
04	131.0	10.0	9.2		1.5		
05	150.0	10.0	8.0	7.3	1.5	0.5	
06	141.0	10.0	8.5		1.5		
07	128.0	7.0	6.6		1.4		
08	144.0	8.0	6.7		1.9		
09	121.0	7.0	6.9	7.3	1.8	1.5	
10	134.0	7.0	6.3		1.6		
11	105.0	7.0	8.0		1.6		
12	134.0	8.0	7.2	7.3	1.9	1.4	
13	94.0	4.0	5.1		1.8		
14	155.0	8.0	6.2		1.5		
15	120.0	6.0	6.0		1.6		
16	121.0	5.0	5.0		1.4		
17	100.0	5.0	6.0		1.4		
18	115.0	4.0	4.2		1.6		
19	111.0	6.0	6.5		1.4	1.2	
20	181.0	10.0	6.6	7.3	1.4		
21	79.0	5.0	7.6		1.7		
22	139.0	8.0	6.9		1.7		
23	146.0	10.0	8.2	7.3	2.0	1.4	
24	147.0	143.0	116.7		2.0		
25	197.0	5.0	3.0		2.3		
26	157.0	6.0	4.6	7.2	2.1	1.5	
27	92.0	2.0	2.6		2.0		
28	140.0	7.0	6.0		1.9		
29	169.0	6.0	4.3		1.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160529 C.U.P. NO. 2-031-0035W

NAME OF DRINKING WATER SYSTEM:

GROVE WATER TREATMENT PLANT

LOCATION: 6927 HANSON DRIVE NORTH

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland

, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3937.0	197.0	186.5	65.7	47.0	4.2	
AVERAGE	127.0	6.4	6.0	7.3	1.5	0.5	
MAXIMUM	155.0	10.0	9.9	7.3	1.7	0.5	
MINIMUM	99.0	3.0	3.4	7.3	1.1	0.4	
01	107.0	3.0	3.4	7.3	1.6	0.5	
02	130.0	5.0	4.6		1.5		
03	131.0	6.0	5.5		1.6		
04	128.0	5.0	4.7		1.5		
05	142.0	5.0	4.2	7.3	1.4	0.5	
06	120.0	5.0	5.0		1.6		
07	133.0	8.0	7.2		1.4		
08	134.0	7.0	6.3	7.3	1.7	0.5	
09	129.0	8.0	7.4		1.6		
10	133.0	9.0	8.1		1.6		
11	144.0	9.0	7.5		1.6		
12	120.0	4.0	4.0	7.3	1.6	0.5	
13	114.0	5.0	5.3		1.5		
14	104.0	5.0	5.8		1.6		
15	136.0	8.0	7.1	7.3	1.6	0.4	
16	146.0	7.0	5.8		1.6		
17	107.0	5.0	5.6		1.6		
18	136.0	4.0	3.5		1.7		
19	155.0	6.0	4.6	7.3	1.5	0.4	
20	135.0	5.0	4.4		1.1		
21	124.0	6.0	5.8		1.2		
22	109.0	9.0	9.9	7.3	1.3	0.4	
23	128.0	6.0	5.6		1.3		
24	99.0	6.0	7.3		1.4		
25	115.0	6.0	6.3		1.5		
26	128.0	6.0	5.6	7.3	1.5	0.5	
27	120.0	8.0	8.0		1.6		
28	127.0	9.0	8.5		1.6		
29	121.0	6.0	6.0	7.3	1.5	0.5	
30	147.0	10.0	8.2		1.7		
31	135.0	6.0	5.3		1.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-15-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7616.0	197.0	96.7	148.0	43.6	13.1	
AVERAGE	245.7	6.4	3.1	7.4	1.4	0.7	
MAXIMUM	422.0	12.0	4.4	7.4	2.0	0.8	
MINIMUM	120.0	2.0	1.3	7.4	1.0	0.5	
01	270.0	5.0	2.2		1.2		
02	272.0	3.0	1.3	7.4	1.3	0.7	
03	228.0	4.0	2.1	7.4	1.2	0.6	
04	212.0	5.0	2.8	7.4	1.0	0.7	
05	208.0	4.0	2.3	7.4	1.2	0.6	
06	172.0	2.0	1.4	7.4	1.4	0.6	
07	285.0	7.0	2.9		1.2		
08	301.0	9.0	3.6		1.6		
09	237.0	6.0	3.0	7.4	1.4	0.7	
10	202.0	5.0	3.0	7.4	1.4	0.5	
11	255.0	6.0	2.8	7.4	1.2	0.6	
12	189.0	6.0	3.8	7.4	1.5	0.7	
13	327.0	8.0	2.9	7.4	1.4	0.7	
14	316.0	10.0	3.8		1.6		
15	221.0	8.0	4.3		1.6		
16	247.0	5.0	2.4	7.4	1.5	0.6	
17	201.0	5.0	3.0	7.4	1.6	0.8	
18	194.0	4.0	2.5	7.4	2.0	0.7	
19	422.0	12.0	3.4	7.4	1.6	0.7	
20	290.0	8.0	3.3	7.4	1.4	0.8	
21	298.0	9.0	3.6		1.6		
22	273.0	9.0	4.0		1.4		
23	195.0	7.0	4.3	7.4	1.4	0.7	
24	120.0	4.0	4.0		1.4		
25	242.0	5.0	2.5		1.5		
26	273.0	5.0	2.2	7.4	1.4	0.6	
27	238.0	8.0	4.0	7.4	1.2	0.6	
28	136.0	5.0	4.4		1.4		
29	311.0	9.0	3.5		1.4		
30	179.0	6.0	4.0	7.4	1.3	0.6	
31	302.0	8.0	3.2	7.4	1.3	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996


EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8359.0	236.0	101.7	153.6	41.8	12.2	
AVERAGE	278.6	7.9	3.4	7.3	1.4	0.6	
MAXIMUM	369.0	14.0	5.3	7.4	1.6	0.8	
MINIMUM	180.0	5.0	2.4	7.3	1.2	0.4	
01	268.0	7.0	3.1	7.3	1.4	0.6	
02	273.0	9.0	4.0		1.3		
03	369.0	11.0	3.6		1.3		
04	317.0	8.0	3.0	7.3	1.3	0.5	
05	354.0	7.0	2.4	7.3	1.4	0.7	
06	332.0	10.0	3.6	7.3	1.4	0.6	
07	247.0	7.0	3.4	7.3	1.6	0.7	
08	200.0	6.0	3.6	7.3	1.4	0.6	
09	310.0	8.0	3.1		1.4		
10	257.0	8.0	3.7		1.5		
11	362.0	14.0	4.6	7.4	1.4	0.4	
12	319.0	8.0	3.0	7.4	1.6	0.7	
13	251.0	6.0	2.9	7.4	1.4	0.6	
14	220.0	5.0	2.7	7.3	1.3	0.4	
15	324.0	10.0	3.7	7.3	1.2	0.4	
16	310.0	10.0	3.9		1.3		
17	354.0	8.0	2.7		1.4		
18	297.0	9.0	3.6	7.3	1.4	0.6	
19	239.0	6.0	3.0	7.3	1.2	0.5	
20	279.0	7.0	3.0	7.3	1.4	0.6	
21	204.0	5.0	2.9	7.3	1.5	0.8	
22	209.0	5.0	2.9	7.3	1.4	0.6	
23	255.0	6.0	2.8		1.4		
24	354.0	13.0	4.4		1.4		
25	361.0	9.0	3.0	7.3	1.6	0.8	
26	237.0	6.0	3.0	7.3	1.4	0.5	
27	180.0	8.0	5.3	7.3	1.4	0.6	
28	249.0	8.0	3.9	7.3	1.4	0.5	
29	201.0	6.0	3.6	7.3	1.3	0.5	
30	227.0	6.0	3.2		1.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 11-11-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WTS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *James L. Hill*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8330.0	181.0	80.7	167.9	40.5	12.7	
AVERAGE	268.7	5.8	2.6	7.3	1.3	0.6	
MAXIMUM	362.0	9.0	4.4	7.3	1.6	0.8	
MINIMUM	182.0	2.0	1.0	7.3	1.0	0.4	
01	236.0	4.0	2.0	7.3	1.2	0.6	
02	230.0	4.0	2.1	7.3	1.0	0.5	
03	203.0	4.0	2.4	7.3	1.2	0.4	
04	182.0	3.0	2.0	7.3	1.2	0.5	
05	362.0	5.0	1.7		1.2		
06	276.0	4.0	1.7		1.0		
07	314.0	3.0	1.1	7.3	1.0	0.4	
08	221.0	3.0	1.6	7.3	1.0	0.4	
09	236.0	2.0	1.0	7.3	1.2	0.4	
10	213.0	3.0	1.7	7.3	1.2	0.6	
11	261.0	5.0	2.3	7.3	1.0	0.5	
12	311.0	7.0	2.7		1.4		
13	356.0	9.0	3.0		1.5		
14	293.0	7.0	2.9	7.3	1.4	0.7	
15	332.0	8.0	2.9	7.3	1.4	0.6	
16	284.0	6.0	2.5	7.3	1.2	0.6	
17	217.0	8.0	4.4	7.3	1.4	0.5	
18	343.0	8.0	2.8	7.3	1.3	0.5	
19	301.0	7.0	2.8		1.4		
20	277.0	8.0	3.5		1.4		
21	274.0	5.0	2.2	7.3	1.4	0.7	
22	264.0	7.0	3.2	7.3	1.5	0.6	
23	208.0	6.0	3.5	7.3	1.4	0.5	
24	274.0	6.0	2.6	7.3	1.4	0.6	
25	256.0	8.0	3.8	7.3	1.4	0.8	
26	319.0	8.0	3.0		1.4		
27	272.0	8.0	3.5		1.6		
28	282.0	7.0	3.0	7.3	1.5	0.7	
29	291.0	6.0	2.5	7.3	1.5	0.5	
30	199.0	4.0	2.4	7.3	1.4	0.6	
31	243.0	8.0	4.0	7.3	1.4	0.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT James E. [Signature], C.O., CERT. NO. C-7537

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7986.0	174.0	77.9	146.3	43.2	13.3	
AVERAGE	266.2	5.8	2.6	7.3	1.4	0.7	
MAXIMUM	372.0	10.0	4.1	7.4	1.6	1.0	
MINIMUM	121.0	2.0	1.0	7.3	1.2	0.4	
01	254.0	5.0	2.4		1.5		
02	313.0	10.0	3.8		1.4		
03	295.0	10.0	4.1	7.3	1.4	0.8	
04	208.0	5.0	2.9	7.3	1.6	0.8	
05	249.0	6.0	2.9	7.3	1.4	0.6	
06	250.0	6.0	2.9	7.3	1.4	0.5	
07	372.0	8.0	2.6		1.2		
08	294.0	9.0	3.7		1.6		
09	263.0	5.0	2.3	7.3	1.4	0.6	
10	284.0	7.0	3.0	7.3	1.4	0.7	
11	245.0	6.0	2.9	7.3	1.6	0.7	
12	256.0	5.0	2.3	7.4	1.5	0.8	
13	219.0	5.0	2.7	7.4	1.4	0.6	
14	338.0	7.0	2.5		1.6		
15	253.0	8.0	3.8		1.5		
16	277.0	8.0	3.5	7.4	1.6	0.7	
17	292.0	10.0	4.1	7.3	1.4	0.6	
18	203.0	4.0	2.4	7.3	1.4	0.6	
19	312.0	9.0	3.5	7.3	1.5	0.8	
20	300.0	7.0	2.8	7.3	1.6	1.0	
21	326.0	4.0	1.5		1.5		
22	201.0	5.0	3.0		1.6		
23	282.0	3.0	1.3	7.3	1.4	0.4	
24	216.0	3.0	1.7	7.3	1.4	0.6	
25	222.0	3.0	1.6	7.3	1.2	0.5	
26	255.0	4.0	1.9	7.3	1.2	0.6	
27	345.0	3.0	1.0	7.3	1.4	0.6	
28	121.0	2.0	2.0		1.3		
29	302.0	4.0	1.6		1.4		
30	239.0	3.0	1.5	7.3	1.4	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 09-11-96

COMMENTS:

S ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: SN FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.


REPORTING MONTH: August 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7983.0	198.0	91.3	145.9	39.6	12.3	
AVERAGE	257.5	6.4	2.9	7.3	1.3	0.6	
MAXIMUM	348.0	15.0	6.5	7.3	2.0	0.9	
MINIMUM	129.0	2.0	0.8	7.2	0.9	0.4	
01	314.0	8.0	3.1	7.2	1.2	0.6	
02	212.0	6.0	3.4	7.3	1.4	0.5	
03	322.0	8.0	3.0		1.2		
04	348.0	13.0	4.5		1.4		
05	302.0	9.0	3.6	7.3	1.4	0.7	
06	307.0	8.0	3.1	7.3	1.2	0.8	
07	305.0	10.0	3.9	7.3	1.2	0.6	
08	231.0	8.0	4.2	7.3	1.2	0.7	
09	301.0	10.0	4.0	7.3	1.2	0.6	
10	295.0	8.0	3.3		1.2		
11	262.0	8.0	3.7		1.4		
12	217.0	3.0	1.7		1.3		
13	271.0	2.0	0.9	7.3	1.1	0.6	
14	196.0	4.0	2.4	7.3	1.0	0.5	
15	226.0	3.0	1.6	7.3	1.0	0.4	
16	239.0	2.0	1.0	7.3	1.0	0.6	
17	296.0	2.0	0.8		0.9		
18	247.0	4.0	1.9		1.0		
19	197.0	2.0	1.2		1.0		
20	280.0	3.0	1.3	7.3	1.2	0.7	
21	231.0	7.0	3.6	7.3	1.4	0.5	
22	265.0	7.0	3.2	7.3	1.3	0.6	
23	267.0	7.0	3.1	7.3	1.3	0.6	
24	276.0	6.0	2.6		1.4		
25	129.0	4.0	3.7		1.4		
26	323.0	8.0	3.0	7.3	1.2	0.4	
27	220.0	4.0	2.2	7.3	1.5	0.6	
28	192.0	7.0	4.4	7.3	1.2	0.6	
29	278.0	15.0	6.5	7.3	1.6	0.8	
30	203.0	5.0	3.0	7.3	2.0	0.9	
31	231.0	7.0	3.6		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 08-01-96

COMMENTS:

S ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM. GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *James S. [Signature]*, C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8537.0	192.0	84.7	167.4	36.8	12.6	
JANUARY	275.4	6.2	2.7	7.3	1.2	0.5	
FEBRUARY	362.0	10.0	4.5	7.3	1.4	0.8	
MARCH	178.0	2.0	0.7	7.2	1.0	0.2	
01	324.0	8.0	3.0	7.2	1.4	0.7	
02	292.0	6.0	2.5	7.2	1.0	0.4	
03	250.0	5.0	2.4	7.3	1.2	0.6	
04	362.0	9.0	3.0		1.2		
05	181.0	5.0	3.3	7.3	1.4	0.8	
06	284.0	6.0	2.5		1.0		
07	212.0	6.0	3.4		1.0		
08	264.0	10.0	4.5	7.3	1.2	0.6	
09	186.0	4.0	2.6	7.3	1.2	0.5	
10	243.0	6.0	3.0	7.3	1.2	0.4	
11	271.0	7.0	3.1	7.3	1.4	0.6	
12	178.0	5.0	3.4	7.3	1.4	0.6	
13	321.0	9.0	3.4		1.4		
14	324.0	10.0	3.7		1.2		
15	350.0	7.0	2.4	7.3	1.3	0.6	
16	265.0	7.0	3.2	7.3	1.2	0.5	
17	301.0	7.0	2.8	7.3	1.4	0.7	
18	296.0	4.0	1.6	7.3	1.2	0.5	
19	276.0	3.0	1.3	7.2	1.0	0.6	
20	359.0	2.0	0.7	7.2	1.2	0.7	
21	298.0	4.0	1.6		1.0		
22	265.0	4.0	1.8	7.2	1.0	0.4	
23	232.0	5.0	2.6	7.3	1.1	0.2	
24	262.0	5.0	2.3	7.3	1.2	0.5	
25	298.0	8.0	3.2	7.3	1.2	0.6	
26	182.0	5.0	3.3	7.3	1.2	0.6	
27	349.0	9.0	3.1		1.0		
28	316.0	8.0	3.0		1.0		
29	299.0	7.0	2.8	7.3	1.2	0.5	
30	226.0	5.0	2.7	7.3	1.2	0.4	
31	270.0	6.0	2.7	7.3	1.2	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 07-01-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *James E. ...*, C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7940.0	190.0	87.2	160.7	37.6	13.2	
AVERAGE	264.7	6.3	2.9	7.3	1.3	0.6	
MINIMUM	363.0	13.0	5.2	7.4	1.4	0.8	
MAXIMUM	154.0	3.0	1.4	7.2	1.0	0.4	
01	310.0	5.0	1.9	7.3	1.3	0.6	
02	320.0	7.0	2.6	7.3	1.4	0.6	
03	258.0	3.0	1.4	7.3	1.4	0.5	
04	270.0	6.0	2.7	7.3	1.2	0.7	
05	349.0	7.0	2.4	7.4	1.4	0.5	
06	275.0	6.0	2.6	7.4	1.4	0.8	
07	241.0	6.0	3.0	7.3	1.2	0.7	
08	306.0	5.0	2.0		1.2		
09	253.0	9.0	4.3		1.2		
10	222.0	8.0	4.3	7.3	1.4	0.6	
11	260.0	4.0	1.8	7.3	1.4	0.7	
12	323.0	7.0	2.6	7.3	1.2	0.5	
13	271.0	9.0	4.0	7.3	1.2	0.6	
14	217.0	5.0	2.8	7.3	1.2	0.5	
15	154.0	6.0	4.7		1.2		
16	316.0	8.0	3.0		1.1		
17	215.0	3.0	1.7	7.3	1.2	0.6	
18	214.0	5.0	2.8	7.3	1.0	0.5	
19	221.0	5.0	2.7	7.3	1.2	0.7	
20	212.0	4.0	2.3	7.3	1.2	0.6	
21	259.0	7.0	3.2	7.3	1.1	0.4	
22	261.0	7.0	3.2		1.4		
23	363.0	13.0	4.3		1.2		
24	335.0	8.0	2.9	7.3	1.2	0.7	
25	268.0	5.0	2.2	7.3	1.4	0.5	
26	206.0	9.0	5.2	7.3	1.4	0.7	
27	212.0	4.0	2.3	7.3	1.4	0.7	
28	204.0	5.0	2.9	7.2	1.1	0.5	
29	326.0	8.0	2.9		1.2		
30	299.0	6.0	2.4		1.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	9294.0	218.0	87.8	160.5	38.7	11.1	
AVERAGE	299.8	7.0	2.8	7.3	1.2	0.5	
MAXIMUM	436.0	11.0	4.4	7.3	1.4	0.7	
MINIMUM	184.0	4.0	1.6	7.2	1.0	0.4	
01	184.0	5.0	3.3	7.3	1.3	0.4	
02	276.0	6.0	2.6	7.3	1.4	0.4	
03	361.0	7.0	2.3	7.3	1.2	0.4	
04	328.0	9.0	3.3		1.2		
05	248.0	9.0	4.4		1.2		
06	298.0	5.0	2.0	7.3	1.3	0.5	
07	255.0	4.0	1.9	7.3	1.2	0.6	
08	259.0	6.0	2.8	7.3	1.4	0.4	
09	253.0	5.0	2.4	7.3	1.2	0.4	
10	259.0	4.0	1.9	7.3	1.2	0.7	
11	436.0	8.0	2.2		1.2		
12	381.0	5.0	1.6		1.2		
13	276.0	5.0	2.2	7.3	1.4	0.6	
14	260.0	5.0	2.3	7.3	1.0	0.4	
15	277.0	6.0	2.6	7.3	1.0	0.4	
16	294.0	7.0	2.9	7.3	1.4	0.6	
17	209.0	6.0	3.4	7.3	1.2	0.6	
18	296.0	7.0	2.8		1.2		
19	380.0	9.0	2.8		1.3		
20	325.0	8.0	3.0	7.2	1.3	0.6	
21	264.0	5.0	2.3	7.3	1.2		
22	272.0	7.0	3.1	7.3	1.2	0.5	
23	342.0	10.0	3.5	7.3	1.4	0.7	
24	371.0	9.0	2.9	7.3	1.2	0.6	
25	321.0	8.0	3.0		1.2		
26	335.0	11.0	3.9		1.4		
27	405.0	11.0	3.3		1.2		
28	270.0	9.0	4.0	7.3	1.3	0.5	
29	234.0	6.0	3.1	7.3	1.3	0.7	
30	280.0	8.0	3.4	7.3	1.2	0.5	
31	345.0	8.0	2.8	7.3	1.3	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 05-01-96

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM GREEN FOREST WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7751.0	172.0	80.6	131.1	41.1	10.2	
AVERAGE	258.4	5.7	2.7	7.3	1.4	0.6	
MAXIMUM	478.0	10.0	5.2	7.3	1.6	0.8	
MINIMUM	94.0	3.0	1.7	7.2	1.2	0.4	
01	176.0	3.0	2.0	7.3	1.4	0.6	
02	168.0	3.0	2.1		1.2		
03	195.0	4.0	2.5		1.2		
04	94.0	3.0	3.8		1.6		
05	140.0	4.0	3.4		1.6		
06	207.0	9.0	5.2		1.6		
07	199.0	4.0	2.4		1.6		
08	214.0	4.0	2.2	7.3	1.4	0.6	
09	218.0	3.0	1.7		1.4		
10	282.0	7.0	3.0		1.2		
11	234.0	5.0	2.6	7.3	1.4	0.8	
12	272.0	6.0	2.6	7.3	1.4	0.4	
13	357.0	9.0	3.0		1.4		
14	358.0	10.0	3.4		1.5		
15	229.0	6.0	3.1	7.3	1.2	0.5	
16	234.0	5.0	2.6	7.3	1.4	0.4	
17	251.0	6.0	2.9	7.2	1.4	0.6	
18	299.0	5.0	2.0	7.3	1.5	0.5	
19	248.0	4.0	1.9	7.3	1.2	0.6	
20	478.0	10.0	2.5		1.2		
21	290.0	8.0	3.3		1.2		
22	307.0	5.0	2.0	7.3	1.3	0.4	
23	266.0	6.0	2.7	7.3	1.5	0.6	
24	255.0	5.0	2.4	7.3	1.2	0.4	
25	251.0	4.0	1.9	7.2	1.2	0.8	
26	339.0	8.0	2.8	7.2	1.4	0.5	
27	415.0	9.0	2.6	7.3	1.4	0.7	
28	285.0	7.0	2.9	7.3	1.5	0.6	
29	262.0	5.0	2.3	7.3	1.2	0.8	
30	228.0	5.0	2.6	7.3	1.4	0.4	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 04-03-96

COMMENTS:

D NO. 2160565 C.U.P. NO. 2-031-0034W

NAME OF DRINKING WATER SYSTEM: Y FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

IN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

 , C.O., CERT. NO. C-7537

SAMPLE NO.	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED		mg/l	PLANT EFFLUENT	REMOTE TAP		
01	6803.0	135.0	75.1	51.1	39.6	3.7	
02	219.5	4.4	2.4	7.3	1.3	0.5	
03	322.0	7.0	4.1	7.3	1.5	0.7	
04	106.0	2.0	1.1	7.3	1.0	0.4	
05	236.0	3.0	1.5	7.3	1.4	0.5	
06	300.0	6.0	2.4		1.2		
07	322.0	5.0	1.9		1.4		
08	292.0	6.0	2.5	7.3	1.4	0.5	
09	222.0	3.0	1.6		1.2		
10	179.0	2.0	1.3		1.2		
11	221.0	5.0	2.7		1.2		
12	203.0	7.0	4.1	7.3	1.4	0.5	
13	217.0	2.0	1.1		1.5		
14	193.0	4.0	2.5		1.5		
15	185.0	4.0	2.6	7.3	1.2	0.6	
16	193.0	6.0	3.7		1.2		
17	194.0	6.0	3.7		1.0		
18	203.0	6.0	3.5		1.0		
19	206.0	6.0	3.5		1.2		
20	272.0	6.0	2.6		1.1		
21	247.0	3.0	1.5		1.2		
22	201.0	5.0	3.0	7.3	1.4	0.4	
23	221.0	4.0	2.2		1.0		
24	181.0	3.0	2.0		1.4		
25	194.0	3.0	1.9	7.3	1.4	0.7	
26	194.0	4.0	2.5		1.4		
27	288.0	5.0	2.1		1.2		
28	296.0	6.0	2.4		1.2		
29	106.0	3.0	3.4		1.4		
30	301.0	5.0	2.0	7.3	1.2	0.5	
31	191.0	3.0	1.9		1.4		
32	193.0	3.0	1.9		1.4		
33	196.0	3.0	1.8		1.2		
34	206.0	5.0	2.9		1.2		
35	150.0	3.0	2.4		1.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 03-06-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-003.

NAME OF DRINKING WATER SYS. GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	7954.0	164.0	71.9	50.4	40.3	4.0	
AVERAGE	274.3	5.7	2.5	7.2	1.4	0.6	
MAXIMUM	427.0	10.0	4.8	7.2	1.9	0.8	
MINIMUM	178.0	3.0	1.4	7.2	1.2	0.4	
01	262.0	7.0	3.2	7.2	1.3	0.7	
02	178.0	4.0	2.7		1.4		
03	313.0	7.0	2.7		1.4		
04	427.0	10.0	2.8		1.5		
05	350.0	8.0	2.7	7.2	1.2	0.4	
06	278.0	7.0	3.0	7.2	1.6	0.7	
07	202.0	8.0	4.8		1.4		
08	334.0	10.0	3.6		1.4		
09	225.0	6.0	3.2		1.2		
10	278.0	7.0	3.0		1.4		
11	362.0	5.0	1.7		1.3		
12	288.0	4.0	1.7		1.3		
13	235.0	5.0	2.6	7.2	1.5	0.8	
14	220.0	4.0	2.2		1.9		
15	257.0	5.0	2.3		1.6		
16	208.0	4.0	2.3		1.8		
17	318.0	5.0	1.9		1.6		
18	303.0	5.0	2.0	7.2	1.2	0.4	
19	401.0	10.0	3.0		1.4		
20	266.0	5.0	2.3		1.4		
21	310.0	6.0	2.3		1.4		
22	224.0	5.0	2.7	7.2	1.2	0.6	
23	230.0	4.0	2.1		1.2		
24	298.0	5.0	2.0		1.2		
25	256.0	3.0	1.4		1.3		
26	221.0	5.0	2.7		1.2		
27	258.0	3.0	1.4		1.2		
28	204.0	3.0	1.8	7.2	1.4	0.4	
29	248.0	4.0	1.9		1.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: GREEN FOREST WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 5537 GREEN FOREST DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Paul Tombroni, C.O., CERT. NO. C-5836

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8637.0	180.0	78.7	65.4	36.9	5.7	
AVERAGE	278.6	5.8	2.5	7.3	1.2	0.6	
MAXIMUM	431.0	10.0	4.7	7.4	1.4	0.8	
MINIMUM	103.0	3.0	1.4	7.1	1.0	0.5	
01	270.0	5.0	2.2		1.1		
02	286.0	5.0	2.1	7.3	1.0	0.7	
03	218.0	4.0	2.2		1.3		
04	242.0	4.0	2.0	7.2	1.1	0.7	
05	103.0	4.0	4.7		1.2		
06	248.0	5.0	2.4		1.2		
07	363.0	7.0	2.3		1.3		
08	317.0	9.0	3.4		1.4		
09	357.0	8.0	2.7	7.3	1.2	0.8	
10	267.0	5.0	2.2		1.3		
11	293.0	7.0	2.9	7.3	1.2	0.6	
12	277.0	6.0	2.6		1.2		
13	296.0	7.0	2.8		1.2		
14	279.0	8.0	3.4		1.3		
15	431.0	9.0	2.5		1.2		
16	218.0	4.0	2.2	7.2	1.2	0.5	
17	269.0	5.0	2.2		1.1		
18	244.0	4.0	2.0	7.3	1.3	0.6	
19	253.0	3.0	1.4		1.1		
20	319.0	5.0	1.9		1.0		
21	350.0	7.0	2.4		1.4		
22	345.0	7.0	2.4		1.3		
23	219.0	4.0	2.2	7.3	1.1	0.6	
24	249.0	4.0	1.9		1.2		
25	197.0	5.0	3.0	7.1	1.1	0.7	
26	204.0	5.0	2.9		1.1		
27	312.0	4.0	1.5		1.1		
28	347.0	10.0	3.5		1.1		
29	265.0	7.0	3.2		1.2		
30	363.0	7.0	2.3	7.4	1.3	0.5	
31	236.0	6.0	3.1		1.1		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 01-03-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

60565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

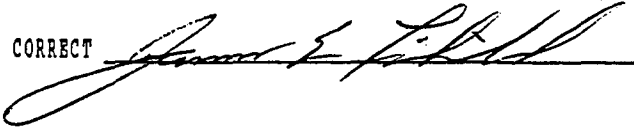

, C.O., CERT. NO. C-7537

DAYS ? MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8635.0	432.0	188.5	146.3	48.8	13.2	
AVERAGE	278.5	13.9	6.1	7.3	1.6	0.7	
MAXIMUM	342.0	24.0	10.7	7.4	2.4	1.0	
MINIMUM	180.0	6.0	2.6	7.3	0.5	0.4	
01	285.0	10.0	4.2		1.4		
02	266.0	9.0	4.1	7.3	1.4	0.4	
03	260.0	10.0	4.6	7.3	1.2	0.5	
04	300.0	17.0	6.8	7.3	1.0	0.5	
05	280.0	14.0	6.0	7.3	1.3	0.5	
06	227.0	15.0	7.9	7.3	1.0	0.6	
07	284.0	9.0	3.8		1.8		
08	292.0	11.0	4.5		2.2		
09	275.0	15.0	6.5	7.3	0.5	0.5	
10	273.0	18.0	7.9	7.3	2.4	1.0	
11	245.0	17.0	8.3	7.4	2.0	0.9	
12	342.0	22.0	7.7	7.4	1.8	0.8	
13	191.0	14.0	8.8	7.4	1.7	0.9	
14	286.0	14.0	5.9		2.0		
15	243.0	12.0	5.9		2.0		
16	273.0	6.0	2.6	7.3	1.8	0.7	
17	305.0	10.0	3.9	7.3	1.8	0.8	
18	313.0	12.0	4.6	7.3	1.4	0.6	
19	318.0	15.0	5.7	7.3	1.9	0.8	
20	334.0	20.0	7.2	7.3	1.5	0.7	
21	290.0	19.0	7.9		1.8		
22	304.0	24.0	9.5		1.8		
23	180.0	16.0	10.7	7.3	1.7	0.7	
24	301.0	24.0	9.6		1.6		
25	297.0	10.0	4.0		1.6		
26	295.0	10.0	4.1	7.3	1.2	0.6	
27	262.0	12.0	5.5	7.3	1.0	0.4	
28	273.0	10.0	4.4		1.0		
29	314.0	12.0	4.6		1.8		
30	200.0	9.0	5.4	7.3	1.6	0.7	
31	327.0	16.0	5.9	7.3	1.6	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

, C.O., CERT. NO. C-7537

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8781.0	312.0	127.8	155.2	43.4	13.1	
AVERAGE	292.7	10.4	4.3	7.4	1.4	0.6	
MAXIMUM	440.0	23.0	6.8	7.4	1.6	0.8	
MINIMUM	211.0	6.0	2.0	7.3	1.2	0.4	
01	303.0	14.0	5.5	7.4	1.2	0.7	
02	286.0	10.0	4.2		1.3		
03	440.0	23.0	6.3		1.5		
04	266.0	8.0	3.6	7.4	1.5	0.6	
05	232.0	8.0	4.1	7.4	1.4	0.7	
06	364.0	6.0	2.0	7.4	1.4	0.6	
07	291.0	12.0	4.9	7.4	1.2	0.5	
08	299.0	7.0	2.8	7.4	1.2	0.5	
09	211.0	6.0	3.4		1.4		
10	255.0	9.0	4.2		1.4		
11	335.0	10.0	3.6	7.3	1.5	0.7	
12	284.0	6.0	2.5	7.3	1.4	0.8	
13	248.0	14.0	6.8	7.4	1.5	0.4	
14	267.0	14.0	6.3	7.4	1.6	0.6	
15	280.0	8.0	3.4	7.4	1.5	0.6	
16	351.0	12.0	4.1		1.5		
17	289.0	8.0	3.3		1.6		
18	305.0	13.0	5.1	7.4	1.5	0.6	
19	270.0	11.0	4.9	7.4	1.5	0.7	
20	324.0	13.0	4.8	7.4	1.4	0.5	
21	219.0	8.0	4.4	7.4	1.2	0.7	
22	249.0	8.0	3.9	7.4	1.5	0.6	
23	279.0	12.0	5.2		1.5		
24	368.0	18.0	5.9		1.6		
25	295.0	12.0	4.9	7.4	1.5	0.8	
26	260.0	11.0	5.1	7.4	1.4	0.6	
27	220.0	7.0	3.8	7.4	1.6	0.7	
28	334.0	10.0	3.6	7.4	1.6	0.7	
29	310.0	8.0	3.1	7.4	1.5	0.5	
30	347.0	6.0	2.1		1.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

MS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: OAK HILL WATER TREATMENT PLANT - JAI HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS TREATED IN MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	8904.0	254.0	105.8	170.1	42.0	13.1	
AVERAGE	287.2	8.2	3.4	7.4	1.4	0.6	
MAXIMUM	416.0	16.0	5.6	7.4	1.7	0.8	
MINIMUM	182.0	4.0	1.6	7.3	1.0	0.1	
01	381.0	5.0	1.6	7.4	1.5	0.8	
02	252.0	7.0	3.3	7.4	1.2	0.4	
03	208.0	6.0	3.5	7.4	1.4	0.7	
04	232.0	6.0	3.1	7.3	1.4	0.6	
05	416.0	16.0	4.6		1.4		
06	369.0	16.0	5.2		1.7		
07	277.0	13.0	5.6	7.4	1.4	0.6	
08	186.0	6.0	3.9	7.4	1.5	0.6	
09	339.0	14.0	5.0	7.4	1.5	0.6	
10	267.0	11.0	4.9	7.4	1.5	0.8	
11	259.0	7.0	3.2	7.4	1.4	0.7	
12	299.0	4.0	1.6		1.5		
13	270.0	6.0	2.7		1.2		
14	296.0	4.0	1.6	7.4	1.4	0.6	
15	281.0	11.0	4.7	7.4	1.4	0.6	
16	182.0	4.0	2.6	7.4	1.5	0.8	
17	285.0	6.0	2.5	7.4	1.2	0.1	
18	348.0	8.0	2.8	7.4	1.3	0.4	
19	296.0	7.0	2.8		1.3		
20	266.0	11.0	5.0		1.5		
21	333.0	7.0	2.5	7.4	1.2	0.4	
22	204.0	6.0	3.5	7.4	1.4	0.6	
23	299.0	5.0	2.0	7.4	1.2	0.6	
24	260.0	5.0	2.3	7.4	1.2	0.4	
25	289.0	12.0	5.0	7.4	1.4	0.7	
26	302.0	12.0	4.8		1.4		
27	413.0	12.0	3.5		1.4		
28	275.0	4.0	1.7	7.4	1.4	0.6	
29	315.0	8.0	3.0	7.4	1.0	0.4	
30	241.0	7.0	3.5	7.4	1.0	0.5	
31	264.0	8.0	3.6	7.4	1.2	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 10-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160565 C.U.P. NO. 2-031-0034H

NAME OF DRINKING WATER SYSTEM: WILLOW WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996


AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	9439.0	319.0	122.7	147.2	44.7	14.2	
AVERAGE	314.6	10.6	4.1	7.4	1.5	0.7	
MAXIMUM	419.0	20.0	7.9	7.4	1.8	1.0	
MINIMUM	235.0	2.0	0.6	7.3	0.9	0.4	
01	298.0	3.0	1.2		1.7		
02	387.0	20.0	6.2		1.5		
03	365.0	3.0	1.0	7.4	1.6	0.9	
04	310.0	5.0	1.9	7.4	1.5	0.7	
05	282.0	7.0	3.0	7.4	1.5	0.8	
06	315.0	9.0	3.4	7.4	1.5	0.8	
07	348.0	10.0	3.4		1.4		
08	407.0	10.0	2.9		1.6		
09	419.0	10.0	2.9	7.4	1.4	0.6	
10	305.0	11.0	4.3	7.4	1.6	0.8	
11	285.0	12.0	5.1	7.4	1.5	0.7	
12	282.0	13.0	5.5	7.4	1.6	0.7	
13	235.0	5.0	2.6	7.4	1.6	0.8	
14	377.0	2.0	0.6		1.4		
15	345.0	14.0	4.9		0.9		
16	293.0	11.0	4.5	7.3	1.4	0.4	
17	306.0	17.0	6.7	7.3	1.6	0.7	
18	275.0	12.0	5.2	7.3	1.8	0.6	
19	299.0	10.0	4.0	7.3	1.6	0.9	
20	292.0	10.0	4.1	7.3	1.4	0.6	
21	261.0	9.0	4.1		1.5		
22	310.0	7.0	2.7		1.4		
23	350.0	19.0	6.5	7.3	1.4	0.5	
24	304.0	10.0	3.9	7.3	1.2	0.5	
25	307.0	14.0	5.5	7.3	1.6	0.7	
26	295.0	10.0	4.1	7.4	1.6	1.0	
27	346.0	16.0	5.5	7.4	1.4	0.8	
28	288.0	19.0	7.9		1.5		
29	305.0	14.0	5.5		1.6		
30	248.0	7.0	3.4	7.4	1.4	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160555 C.U.P. NO. 2-031-0034N NAME OF DRINKING WATER SYSTEM: HILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4905 DUCHESNEAU DRIVE JACKSONVILLE, FLA., DUVAL COUNTY

ISSUED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: August 1996

AVERAGE EFFLUENT PH: 7.5(AVG) NO. OF SERVICES AT END OF MONTH: _____

SIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT _____, C.O., CERT. NO. C-7537

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
TOTAL	10384.0	224.0	165.1	49.6	13.7
AVERAGE	335.0	7.2	7.5	1.6	0.7
MINIMUM	451.0	10.0	7.6	2.0	0.9
MINIMUM	261.0	2.0	7.4	1.3	0.4
01	291.0	7.0	7.6	2.0	0.9
02	279.0	6.0	7.5	1.6	
03	349.0	8.0	2.8	2.0	
04	430.0	9.0	2.5	2.0	
05	382.0	8.0	7.5	1.8	0.8
06	281.0	8.0	7.5	2.0	2.8
07	359.0	7.0	7.5	2.0	0.7
08	286.0	8.0	7.6	1.7	0.8
09	372.0	9.0	7.5	1.6	0.7
10	317.0	8.0		1.6	
11	341.0	8.0		1.6	
12	313.0	8.0	7.5	1.8	0.6
13	294.0	6.0	7.5	1.6	0.8
14	261.0	6.0	7.5	1.4	0.5
15	386.0	10.0	7.5	1.4	0.7
16	261.0	4.0	7.5	1.4	0.6
17	451.0	10.0		1.6	
18	395.0	8.0		1.6	
19	366.0	7.0	7.5	1.5	0.8
20	302.0	7.0	7.5	1.6	0.6
21	333.0	6.0	7.5	1.5	0.6
22	300.0	7.0	7.5	1.3	0.4
23	358.0	7.0	7.4	1.3	0.4
24	364.0	8.0		1.4	
25	327.0	8.0		1.6	
26	389.0	7.0	7.5	1.5	0.5
27	326.0	5.0	7.5	1.4	0.7
28	318.0	2.0	7.5	1.5	0.6
29	328.0	10.0	7.5	1.4	0.5
30	292.0	6.0	7.5	1.4	0.7
31	333.0	6.0		1.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 08-01-96

INITIALS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM W. HILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHESNEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

SIGNATURE FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT James E. Hill, C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10850.0	203.0	71.6	161.8	42.8	12.0	
AVERAGE	350.0	6.5	2.3	7.4	1.4	0.6	
MINIMUM	512.0	12.0	4.3	7.4	2.0	1.1	
MINIMUM	209.0	2.0	0.7	7.3	0.9	0.2	
01	379.0	10.0	3.2	7.4	1.0	0.4	
02	289.0	7.0	2.9	7.4	0.9	0.6	
03	309.0	10.0	3.9	7.4	1.1	0.5	
04	431.0	12.0	3.3		1.7		
05	256.0	8.0	3.8	7.4	2.0	0.6	
06	387.0	10.0	3.1		2.0		
07	264.0	6.0	2.7		2.0		
08	414.0	6.0	1.7	7.3	1.8	0.9	
09	209.0	5.0	2.9	7.4	2.0	1.1	
10	298.0	6.0	2.4	7.4	1.4	0.7	
11	301.0	6.0	2.4	7.4	1.6	0.6	
12	422.0	9.0	2.6	7.3	1.4	0.5	
13	294.0	5.0	2.0		1.3		
14	358.0	5.0	1.7		1.3		
15	409.0	3.0	0.9	7.3	1.3	0.4	
16	335.0	7.0	2.5	7.3	1.2	0.6	
17	322.0	2.0	0.7	7.3	1.2	0.5	
18	397.0	4.0	1.2	7.3	1.2	0.4	
19	280.0	10.0	4.3	7.4	1.0	0.6	
20	411.0	6.0	1.8	7.4	1.4	0.5	
21	465.0	5.0	1.3		1.2		
22	384.0	5.0	1.6	7.4	1.8		
23	385.0	12.0	3.7	7.4	1.0	0.6	
24	366.0	5.0	1.6	7.4	1.2	0.2	
25	385.0	4.0	1.2		1.2	0.5	
26	232.0	5.0	2.6	7.3	1.3		
27	370.0	5.0	1.6		1.5	0.4	
28	512.0	9.0	2.1		1.2		
29	330.0	4.0	1.5	7.3	1.4		
30	295.0	6.0	2.4	7.3	1.2	0.8	
31	361.0	6.0	2.0	7.3	1.0	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4

SAMPLE DATE: 07-01-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160565 C.U.P. NO. 2-031-0034X

NAME OF DRINKING WATER SYSTEM: K HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *James E. Fiddell*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10130.0	334.0	119.1	161.3	41.1	12.9	
AVERAGE	337.7	11.1	4.0	7.3	1.4	0.6	
MAXIMUM	441.0	20.0	8.5	7.4	2.2	0.9	
MINIMUM	241.0	4.0	1.7	7.3	0.9	0.4	
01	355.0	13.0	4.4	7.3	1.4	0.4	
02	383.0	17.0	5.3	7.3	1.5	0.6	
03	431.0	18.0	5.0	7.3	1.6	0.7	
04	406.0	17.0	5.0	7.3	1.4	0.6	
05	441.0	20.0	5.4	7.3	1.6	0.5	
06	406.0	20.0	5.9	7.3	1.2	0.7	
07	248.0	11.0	5.3	7.3	1.4	0.6	
08	388.0	16.0	4.9		1.5		
09	241.0	17.0	8.5		1.2		
10	255.0	10.0	4.7	7.3	1.4	0.7	
11	399.0	6.0	1.8	7.3	1.4	0.5	
12	280.0	4.0	1.7	7.3	1.4	0.7	
13	368.0	6.0	2.0	7.3	1.6	0.6	
14	323.0	8.0	3.0	7.3	1.4	0.5	
15	270.0	10.0	4.4		1.4		
16	433.0	14.0	3.9		1.6		
17	307.0	7.0	2.7	7.3	1.6	0.6	
18	312.0	12.0	4.6	7.3	1.5	0.8	
19	261.0	10.0	4.6	7.3	1.4	0.6	
20	302.0	13.0	5.2	7.4	2.2	0.9	
21	335.0	15.0	5.4	7.4	1.8	0.8	
22	286.0	7.0	2.9		1.1		
23	397.0	9.0	2.7		1.0		
24	361.0	8.0	2.7	7.4	1.0	0.4	
25	368.0	9.0	2.9	7.4	0.9	0.4	
26	263.0	5.0	2.3	7.4	1.0	0.5	
27	324.0	8.0	3.0	7.4	1.0	0.4	
28	357.0	8.0	2.7	7.4	1.2	0.4	
29	368.0	9.0	2.9		1.2		
30	262.0	7.0	3.2		1.2		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 06-12-96

COMMENTS.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM OAK HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *James E. [Signature]*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	10634.0	309.0	105.4	131.4	41.3	12.8	
AVERAGE	354.5	10.3	3.5	7.3	1.4	0.7	
MAXIMUM	559.0	17.0	6.1	7.3	1.6	1.1	
MINIMUM	240.0	2.0	0.8	7.3	1.0	0.4	
01	354.0	10.0	3.4	7.3	1.4	0.6	
02	290.0	11.0	4.6		1.4		
03	319.0	9.0	3.4		1.2		
04	290.0	9.0	3.7		1.4		
05	294.0	15.0	6.1		1.5		
06	324.0	15.0	5.6		1.6		
07	537.0	10.0	2.2		1.6		
08	285.0	4.0	1.7	7.3	1.4	0.8	
09	298.0	2.0	0.8		1.4		
10	354.0	9.0	3.1		1.2		
11	321.0	7.0	2.6	7.3	1.4	1.0	
12	284.0	5.0	2.1	7.3	1.6	0.5	
13	374.0	10.0	3.2		1.3		
14	484.0	17.0	4.2		1.5		
15	310.0	11.0	4.3	7.3	1.4	0.6	
16	317.0	12.0	4.5	7.3	1.6	0.8	
17	256.0	10.0	4.7	7.3	1.4	0.6	
18	401.0	15.0	4.5	7.3	1.4	0.4	
19	240.0	7.0	3.5	7.3	1.0	0.4	
20	493.0	15.0	3.7		1.2		
21	361.0	8.0	2.7		1.2		
22	412.0	9.0	2.6	7.3	1.4	0.7	
23	349.0	10.0	3.4	7.3	1.4	0.6	
24	408.0	13.0	3.8	7.3	1.2	1.0	
25	384.0	12.0	3.8	7.3	1.4	0.8	
26	333.0	11.0	4.0	7.3	1.6	1.1	
27	559.0	14.0	3.0	7.3	1.4	0.9	
28	370.0	12.0	3.9	7.3	1.2	0.6	
29	332.0	9.0	3.3	7.3	1.2	0.8	
30	301.0	8.0	3.2	7.3	1.4	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 04-08-96

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160565 C.U.P. NO. 2-031-0034N

NAME OF DRINKING WATER SYSTEM: HILL WATER TREATMENT PLANT - JAX HEIGHTS GRID
 JACKSONVILLE, FLA., DUVAL COUNTY

LOCATION: 4805 DUCHENEAU DRIVE

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

INFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT James E. [Signature], C.O., CERT. NO. C-7537

STATION	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
THLY TAL	9409.0	346.0	140.3	43.8	44.3	3.2	
BRIDGE	303.5	11.2	4.5	7.3	1.4	0.5	
INUM	431.0	28.0	9.5	7.3	2.0	0.7	
INUM	209.0	4.0	1.4	7.3	1.0	0.4	
01	309.0	22.0	8.5	7.3	1.5	0.6	
02	295.0	22.0	8.9		1.4		
03	277.0	22.0	9.5		1.6		
04	260.0	20.0	9.2	7.3	1.2	0.6	
05	367.0	28.0	9.2		1.4		
06	209.0	15.0	8.6		1.9		
07	325.0	22.0	8.1		1.9		
08	351.0	5.0	1.7	7.3	1.6	0.7	
09	305.0	6.0	2.4		1.7		
10	312.0	7.0	2.7		1.4		
11	257.0	12.0	5.6	7.3	1.0	0.5	
12	360.0	16.0	5.3		1.8		
13	244.0	12.0	5.9		1.6		
14	328.0	17.0	6.2		1.6		
15	298.0	10.0	4.0		2.0		
16	254.0	6.0	2.8		1.2		
17	431.0	5.0	1.4		1.5		
18	287.0	4.0	1.7	7.3	1.2	0.4	
19	320.0	12.0	4.5		1.2		
20	270.0	9.0	4.0		1.4		
21	262.0	8.0	3.7		1.4		
22	348.0	7.0	2.4		1.4		
23	246.0	6.0	2.9		1.4		
24	417.0	6.0	1.7		1.5		
25	308.0	6.0	2.3		1.5		
26	307.0	7.0	2.7	7.3	1.2	0.4	
27	322.0	6.0	2.2		1.2		
28	293.0	6.0	2.5		1.0		
29	297.0	6.0	2.4		1.0		
30	316.0	9.0	3.4		1.2		
31	234.0	7.0	3.6		1.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 03-05-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0034

NAME OF DRINKING WATER SYS1 OAK HILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.


REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	9077.0	530.0	204.0	58.3	56.2	5.8	
AVERAGE	313.0	18.3	7.0	7.3	1.9	0.7	
MAXIMUM	472.0	29.0	10.5	7.3	2.5	1.0	
MINIMUM	196.0	6.0	2.2	7.2	1.4	0.5	
01	344.0	7.0	2.4	7.3	1.6	0.7	
02	293.0	14.0	5.7		2.0		
03	317.0	20.0	7.6		2.1		
04	393.0	22.0	6.7		1.8		
05	382.0	21.0	6.6	7.2	2.0	0.6	
06	205.0	13.0	7.6	7.3	1.6	1.0	
07	321.0	24.0	9.0	7.3	1.8	0.8	
08	312.0	21.0	8.1		2.1		
09	327.0	23.0	8.4		2.0		
10	289.0	22.0	9.1		2.1		
11	304.0	22.0	8.7		2.0		
12	344.0	25.0	8.7		2.0		
13	244.0	18.0	8.9	7.3	2.5	0.7	
14	345.0	25.0	8.7		2.2		
15	221.0	10.0	5.4		2.0		
16	277.0	10.0	4.3		1.8		
17	334.0	12.0	4.3		2.4		
18	323.0	10.0	3.7		2.4		
19	345.0	25.0	8.7		2.4		
20	296.0	25.0	10.1	7.3	2.2	0.5	
21	321.0	23.0	8.6		2.0		
22	240.0	14.0	7.0		1.4		
23	328.0	6.0	2.2	7.3	1.7	0.7	
24	380.0	18.0	5.7		1.4		
25	472.0	29.0	7.4		1.8		
26	319.0	14.0	5.3		1.7		
27	297.0	26.0	10.5		1.6		
28	196.0	11.0	6.7	7.3	1.8	0.8	
29	308.0	20.0	7.8		1.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2160565 C.U.P. NO. 2-031-0034K

NAME OF DRINKING WATER SYSTEM: CREEK HILL WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 4805 DUCHENEAU DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Paul Tomlinson, C.O., CERT. NO. C-5836

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/l	EFFLUENT pH	RESIDUAL CHLORINE mg/l PLANT EFFLUENT	REMOTE TAP	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	9319.0	328.0	131.7	65.8	46.5	5.1	
AVERAGE	300.6	10.6	4.2	7.3	1.5	0.6	
MAXIMUM	507.0	24.0	8.9	7.4	1.8	0.8	
MINIMUM	191.0	3.0	1.4	7.1	1.2	0.4	
01	282.0	13.0	5.5		1.5		
02	336.0	12.0	4.3	7.4	1.6	0.5	
03	272.0	10.0	4.4		1.5		
04	264.0	10.0	4.5	7.4	1.6	0.4	
05	286.0	12.0	5.0		1.4		
06	307.0	10.0	3.9		1.6		
07	341.0	7.0	2.5		1.5		
08	377.0	10.0	3.2	7.2	1.4	0.5	
09	304.0	12.0	4.7		1.6		
10	314.0	16.0	6.1	7.4	1.6	0.7	
11	310.0	23.0	8.9		1.5		
12	328.0	12.0	4.4		1.5		
13	280.0	15.0	6.4		1.6		
14	242.0	10.0	5.0		1.6		
15	507.0	15.0	3.6		1.5		
16	237.0	6.0	3.0	7.1	1.6	0.8	
17	272.0	7.0	3.1		1.5		
18	305.0	10.0	3.9	7.2	1.6	0.7	
19	294.0	10.0	4.1		1.4		
20	310.0	14.0	5.4		1.5		
21	347.0	24.0	8.3		1.6		
22	191.0	10.0	6.3		1.8		
23	262.0	8.0	3.7	7.3	1.5	0.7	
24	288.0	5.0	2.1		1.4		
25	345.0	4.0	1.4	7.4	1.2	0.4	
26	200.0	3.0	1.8		1.4		
27	321.0	6.0	2.2		1.4		
28	332.0	8.0	2.9		1.4		
29	321.0	8.0	3.0		1.5		
30	296.0	8.0	3.2	7.4	1.3	0.4	
31	248.0	10.0	4.8		1.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 01-10-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

FILE NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996


AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18643.0	1180.0	239.4	146.8	72.5	23.4	
AVERAGE	601.4	38.1	7.7	7.3	2.3	1.2	
MINIMUM	850.0	65.0	12.6	7.4	3.0	2.1	
MINIMUM	422.0	25.0	4.2	7.3	1.5	0.6	
01	650.0	30.0	5.5		2.1		
02	485.0	30.0	7.4	7.4	1.9	0.8	
03	651.0	25.0	4.6	7.4	2.2	1.0	
04	627.0	30.0	5.7	7.4	1.6	0.7	
05	649.0	25.0	4.6	7.4	1.7	0.7	
06	520.0	25.0	5.8	7.4	1.8	0.6	
07	638.0	25.0	4.7		2.3		
08	652.0	25.0	4.6		1.6		
09	624.0	40.0	7.7	7.4	2.1	0.9	
10	519.0	25.0	5.8	7.4	1.5	0.7	
11	701.0	45.0	7.7	7.4	2.1	1.0	
12	435.0	35.0	9.7	7.3	2.4	1.2	
13	655.0	45.0	8.2	7.3	3.0	1.3	
14	605.0	50.0	9.9		2.8		
15	491.0	40.0	9.8		2.7		
16	596.0	40.0	8.1	7.3	2.5	2.0	
17	580.0	40.0	8.3	7.3	2.5	2.1	
18	530.0	40.0	9.1	7.3	2.8	2.0	
19	791.0	55.0	8.3	7.3	2.8	0.9	
20	563.0	40.0	8.5	7.3	2.8	1.6	
21	597.0	40.0	8.0		2.3		
22	572.0	50.0	10.5		2.6		
23	475.0	35.0	8.8	7.3	2.8	0.8	
24	850.0	45.0	6.4		2.5		
25	682.0	45.0	7.9		2.3		
26	523.0	45.0	10.3	7.3	2.2	0.9	
27	564.0	40.0	8.5	7.3	2.7	1.2	
28	715.0	25.0	4.2		2.5		
29	619.0	65.0	12.6		2.4		
30	422.0	35.0	10.0	7.3	2.4	1.5	
31	662.0	45.0	8.2	7.3	2.6	1.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 12-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER SYSTEM ID NO. 2160565 C.U.P. NO. 2-031-0039

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18859.0	900.0	173.4	155.9	52.1	14.2	
AVERAGE	628.6	30.0	5.8	7.4	1.7	0.7	
MAXIMUM	1252.0	45.0	8.1	7.5	2.3	1.0	
MINIMUM	460.0	20.0	4.1	7.4	1.0	0.4	
01	562.0	30.0	6.4	7.4	1.6	0.7	
02	654.0	35.0	6.4		1.2		
03	638.0	35.0	6.6		1.6		
04	671.0	30.0	5.4	7.4	1.8	0.7	
05	564.0	25.0	5.3	7.4	1.6	0.5	
06	725.0	30.0	5.0	7.4	1.8	0.8	
07	597.0	30.0	6.0	7.4	1.8	0.6	
08	494.0	30.0	7.3	7.4	1.8	1.0	
09	613.0	35.0	6.9		1.7		
10	545.0	30.0	6.6		2.0		
11	665.0	35.0	6.3	7.4	1.8	0.8	
12	684.0	30.0	5.3	7.5	1.5	0.6	
13	515.0	25.0	5.8	7.5	1.5	0.7	
14	491.0	20.0	4.9	7.5	1.7	0.5	
15	584.0	25.0	5.1	7.4	1.7	0.7	
16	599.0	30.0	6.0		1.5		
17	626.0	25.0	4.8		1.0		
18	600.0	30.0	6.0	7.4	1.8	0.5	
19	583.0	25.0	5.1	7.4	1.4	0.4	
20	704.0	35.0	6.0	7.5	1.6	0.6	
21	460.0	20.0	5.2	7.5	1.8	0.6	
22	589.0	40.0	8.1	7.4	1.9	0.8	
23	567.0	25.0	5.3		2.1		
24	695.0	35.0	6.0		2.1		
25	1252.0	45.0	4.3	7.4	1.5	0.7	
26	640.0	35.0	6.6	7.4	1.8	0.6	
27	545.0	25.0	5.5	7.4	2.0	0.8	
28	780.0	35.0	5.4	7.4	2.1	0.8	
29	633.0	30.0	5.7	7.4	2.3	0.8	
30	584.0	20.0	4.1		2.1		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

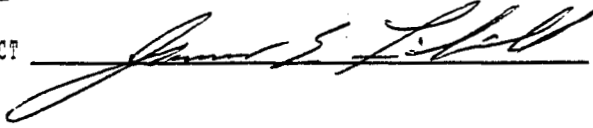

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	20027.0	990.0	184.4	170.4	49.9	17.1	
AVERAGE	646.0	31.9	5.9	7.4	1.6	0.7	
MAXIMUM	840.0	40.0	8.5	7.5	2.4	1.2	
MINIMUM	459.0	20.0	4.8	7.4	1.0	0.4	
01	709.0	35.0	5.9	7.4	1.5	0.7	
02	690.0	40.0	7.0	7.4	1.6	0.7	
03	620.0	35.0	6.8	7.4	1.7	1.0	
04	459.0	25.0	6.5	7.4	1.5	0.8	
05	657.0	30.0	5.5		1.5		
06	724.0	40.0	6.6		1.6		
07	780.0	40.0	6.2	7.4	1.0	0.4	
08	494.0	35.0	8.5	7.4	1.6	0.5	
09	654.0	35.0	6.4	7.4	1.6	0.7	
10	514.0	25.0	5.8	7.4	2.4	1.2	
11	670.0	35.0	6.3	7.4	1.7	0.8	
12	629.0	30.0	5.7		1.4		
13	626.0	30.0	5.8		1.5		
14	728.0	35.0	5.8	7.4	1.8	0.9	
15	616.0	25.0	4.9	7.4	1.7	0.6	
16	692.0	30.0	5.2	7.4	1.7	1.0	
17	563.0	25.0	5.3	7.4	1.7	0.8	
18	706.0	40.0	6.8	7.4	1.7	0.8	
19	621.0	35.0	6.8		1.8		
20	650.0	30.0	5.5		1.7		
21	598.0	30.0	6.0	7.4	1.3	0.5	
22	840.0	35.0	5.0	7.4	2.0	0.8	
23	658.0	35.0	6.4	7.4	1.4	0.6	
24	625.0	30.0	5.8	7.4	1.4	0.5	
25	499.0	20.0	4.8	7.5	1.4	0.8	
26	637.0	30.0	5.7		1.7		
27	775.0	40.0	6.2		1.5		
28	742.0	30.0	4.9	7.5	1.6	0.9	
29	740.0	35.0	5.7	7.4	1.3	0.6	
30	518.0	25.0	5.8	7.4	2.0	0.8	
31	593.0	25.0	5.1	7.4	1.6	0.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0039H

NAME OF DRINKING WATER SYSTEM: [] T ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *James E. Smith*, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	20839.0	890.0	153.9	140.0	43.0	12.4	
AVERAGE	694.6	29.7	5.1	7.4	1.4	0.7	
MAXIMUM	838.0	40.0	7.2	7.4	1.8	0.8	
MINIMUM	418.0	20.0	3.6	7.3	1.2	0.4	
01	664.0	25.0	4.5		1.4		
02	769.0	30.0	4.7		1.6		
03	748.0	30.0	4.8	7.4	1.2	0.7	
04	555.0	20.0	4.3	7.4	1.2	0.5	
05	677.0	40.0	7.1	7.4	1.4	0.8	
06	668.0	20.0	3.6	7.4	1.8	0.7	
07	749.0	30.0	4.8		1.4		
08	771.0	30.0	4.7		1.5		
09	516.0	20.0	4.7	7.4	1.4	0.4	
10	749.0	25.0	4.0	7.4	1.3	0.6	
11	685.0	25.0	4.4		1.2		
12	670.0	20.0	3.6	7.4	1.4	0.7	
13	556.0	20.0	4.3	7.3	1.6	0.6	
14	722.0	30.0	5.0		1.4		
15	716.0	25.0	4.2		1.3		
16	686.0	30.0	5.2	7.3	1.6	0.8	
17	838.0	35.0	5.0	7.3	1.3	0.7	
18	514.0	25.0	5.8	7.3	1.5	0.7	
19	798.0	40.0	6.0	7.4	1.4	0.8	
20	697.0	30.0	5.2	7.3	1.2	0.6	
21	706.0	35.0	5.9		1.5		
22	568.0	25.0	5.3		1.5		
23	815.0	35.0	5.2	7.3	1.5	0.6	
24	807.0	40.0	5.9	7.4	1.3	0.7	
25	740.0	35.0	5.7	7.4	1.3	0.5	
26	779.0	40.0	6.2	7.4	1.5	0.7	
27	698.0	30.0	5.2	7.4	1.6	0.5	
28	791.0	35.0	5.3		1.5		
29	769.0	40.0	6.2		1.4		
30	418.0	25.0	7.2	7.4	1.8	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7 SAMPLE DATE: 09-19-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT James S. Hill, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19611.0	825.0	170.1	161.4	43.3	21.1	
AVERAGE	632.6	26.6	5.5	7.3	1.4	1.0	
MAXIMUM	1338.0	50.0	12.7	7.4	1.9	7.0	
MINIMUM	287.0	15.0	3.4	7.3	0.8	0.4	
01	787.0	30.0	4.6	7.3	1.6	7.0	
02	464.0	20.0	5.2	7.4	1.2	0.9	
03	610.0	20.0	3.9		1.7		
04	740.0	30.0	4.9		1.5		
05	609.0	25.0	4.9	7.4	1.5	0.8	
06	651.0	25.0	4.6	7.4	1.4	0.7	
07	593.0	30.0	6.1	7.4	1.5	0.8	
08	706.0	20.0	3.4	7.4	1.7	0.6	
09	744.0	30.0	4.8	7.4	1.2	0.5	
10	367.0	25.0	8.2		1.1		
11	302.0	25.0	9.9		1.2		
12	287.0	20.0	8.4	7.4	1.7	0.7	
13	681.0	30.0	5.3	7.4	1.3	0.6	
14	580.0	25.0	5.2	7.3	1.4	0.8	
15	746.0	25.0	4.0	7.3	1.4	0.7	
16	631.0	25.0	4.8	7.3	1.5	0.8	
17	726.0	25.0	4.1		1.3		
18	1338.0	50.0	4.5		1.1		
19	356.0	15.0	5.1	7.3	1.2	0.5	
20	628.0	25.0	4.8	7.3	1.7	0.8	
21	561.0	25.0	5.3	7.3	1.7	0.8	
22	331.0	35.0	12.7	7.3	1.0	0.5	
23	332.0	25.0	9.0	7.3	1.9	0.7	
24	802.0	30.0	4.5		1.3		
25	938.0	30.0	3.8		0.8		
26	614.0	25.0	4.9	7.3	1.1	0.4	
27	694.0	25.0	4.3	7.3	1.2	0.7	
28	811.0	30.0	4.4	7.3	1.3	0.5	
29	723.0	30.0	5.0	7.3	1.6	0.7	
30	662.0	25.0	4.5	7.3	1.6	0.6	
31	597.0	25.0	5.0		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

7 SAMPLE DATE: 08-01-96

S ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM

EAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

MTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	22267.0	975.0	163.0	160.2	60.2	19.1	
AVERAGE	718.3	31.5	5.3	7.3	1.9	0.9	
MINIMUM	950.0	60.0	7.8	7.3	2.9	1.4	
MAXIMUM	398.0	20.0	3.9	7.2	1.1	0.5	
01	829.0	45.0	6.5	7.3	2.2	1.1	
02	789.0	50.0	7.6	7.3	2.4	0.8	
03	560.0	25.0	5.4	7.3	2.5	1.2	
04	867.0	45.0	6.2		2.3		
05	398.0	20.0	6.0	7.2	2.2	0.8	
06	757.0	35.0	5.5		2.3		
07	505.0	25.0	5.9		2.5		
08	829.0	30.0	4.3	7.3	2.3	1.1	
09	509.0	25.0	5.9	7.3	2.6	1.4	
10	925.0	60.0	7.8	7.3	2.3	1.0	
11	684.0	30.0	5.3	7.3	1.8	0.9	
12	590.0	30.0	6.1	7.2	2.5	1.1	
13	600.0	30.0	6.0		2.5		
14	668.0	30.0	5.4		2.9		
15	862.0	40.0	5.6	7.2	2.3	0.8	
16	657.0	30.0	5.5	7.2	1.8	0.8	
17	608.0	25.0	4.9	7.3	2.6	1.0	
18	695.0	25.0	4.3	7.3	1.1	0.5	
19	717.0	25.0	4.2	7.3	1.5	0.8	
20	783.0	35.0	5.4		1.2		
21	794.0	30.0	4.5		1.6		
22	950.0	35.0	4.4	7.3	1.2	0.7	
23	735.0	25.0	4.1	7.3	1.7	1.0	
24	613.0	20.0	3.9	7.3	1.6	0.8	
25	885.0	40.0	5.4	7.3	1.4	0.7	
26	493.0	20.0	4.9	7.3	1.3	0.6	
27	741.0	25.0	4.0		1.7		
28	859.0	30.0	4.2		1.4		
29	874.0	35.0	4.8	7.3	1.3	0.7	
30	796.0	30.0	4.5	7.3	1.4	0.5	
31	695.0	25.0	4.3	7.3	1.8	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7 SAMPLE DATE: 07-22-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	21281.0	1220.0	206.5	159.6	61.5	17.2	
AVERAGE	709.4	40.7	6.9	7.3	2.1	0.8	
MAXIMUM	1086.0	60.0	8.0	7.3	2.7	1.1	
MINIMUM	493.0	30.0	5.7	7.2	1.2	0.4	
01	757.0	45.0	7.1	7.2	2.1	0.6	
02	766.0	45.0	7.0	7.2	2.2	0.8	
03	864.0	55.0	7.6	7.2	1.4	0.8	
04	1086.0	60.0	6.6	7.3	1.2	0.6	
05	881.0	50.0	6.8	7.2	1.5	0.7	
06	736.0	40.0	6.5	7.2	1.2	0.4	
07	655.0	35.0	6.4	7.2	1.2	0.6	
08	688.0	40.0	7.0		1.9		
09	692.0	40.0	6.9		2.1		
10	557.0	35.0	7.5	7.2	2.2	0.9	
11	804.0	45.0	6.7	7.2	2.0	0.8	
12	726.0	40.0	6.6	7.2	2.4	1.0	
13	732.0	45.0	7.4	7.3	1.5	0.7	
14	521.0	30.0	6.9	7.3	2.0	0.9	
15	780.0	40.0	6.2		2.2		
16	858.0	50.0	7.0		2.4		
17	596.0	30.0	6.0	7.3	2.5	1.0	
18	800.0	45.0	6.7	7.3	2.1	0.8	
19	636.0	40.0	7.5	7.2	2.1	1.1	
20	662.0	35.0	6.3	7.3	2.2	1.0	
21	700.0	40.0	6.9	7.3	2.3	0.8	
22	622.0	35.0	6.8		2.2		
23	676.0	45.0	8.0		2.6		
24	690.0	40.0	7.0	7.3	2.2	0.6	
25	810.0	45.0	6.7	7.3	1.9	0.8	
26	521.0	30.0	6.9	7.3	2.2	0.7	
27	636.0	35.0	6.6	7.3	2.4	0.8	
28	700.0	45.0	7.7	7.3	2.5	0.8	
29	636.0	30.0	5.7		2.1		
30	493.0	30.0	7.3		2.7		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 06-20-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160565 C.U.P. NO. 2-031-0039W

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	25261.0	1410.0	209.7	158.8	52.9	13.8	
AVERAGE	814.9	45.5	6.8	7.2	1.7	0.6	
MAXIMUM	1196.0	60.0	11.1	7.3	2.8	1.5	
MINIMUM	594.0	25.0	3.8	7.2	1.1	0.4	
01	594.0	55.0	11.1	7.2	2.7	1.2	
02	708.0	45.0	7.6	7.2	2.8	1.5	
03	808.0	40.0	5.9	7.2	1.3	0.6	
04	830.0	50.0	7.2		2.2		
05	928.0	60.0	7.8		1.8		
06	770.0	40.0	6.2	7.2	2.3	0.8	
07	966.0	40.0	5.0	7.2	1.6	0.5	
08	747.0	30.0	4.8	7.2	1.8	0.4	
09	782.0	25.0	3.8	7.2	1.5	0.6	
10	695.0	40.0	6.9	7.2	2.4	0.4	
11	724.0	40.0	6.6		1.9		
12	922.0	50.0	6.5		2.0		
13	732.0	45.0	7.4	7.2	1.2	0.7	
14	925.0	50.0	6.5	7.2	1.6	0.5	
15	713.0	40.0	6.7	7.2	1.3	0.4	
16	719.0	50.0	8.3	7.2	1.2	0.4	
17	783.0	40.0	6.1	7.2	1.2	0.4	
18	913.0	55.0	7.2		1.7		
19	1029.0	55.0	6.4		1.4		
20	933.0	50.0	6.4	7.2	1.1	0.5	
21	749.0	45.0	7.2	7.2	1.2	0.8	
22	748.0	40.0	6.4	7.2	1.8	0.8	
23	1039.0	60.0	6.9	7.3	1.4	0.6	
24	856.0	45.0	6.3	7.3	1.8	0.4	
25	765.0	45.0	7.1		1.2		
26	1196.0	60.0	6.0		1.9		
27	810.0	45.0	6.7		1.5		
28	719.0	40.0	6.7	7.3	1.4	0.5	
29	708.0	45.0	7.6	7.3	1.6	0.6	
30	695.0	40.0	6.9	7.2	2.0	0.6	
31	755.0	45.0	7.2	7.2	2.1	0.6	

PWS ID NO. 2160565 C.U.P. NO. 2-031-0039

NAME OF DRINKING WATER SYSTEM WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	21653.0	820.0	136.0	124.2	58.5	13.7	
AVERAGE	721.8	27.3	4.5	7.3	2.0	0.8	
MAXIMUM	1012.0	40.0	5.7	7.4	2.7	1.2	
MINIMUM	420.0	10.0	2.4	7.3	1.0	0.4	
01	800.0	35.0	5.3	7.3	2.3	0.8	
02	705.0	30.0	5.1		2.1		
03	758.0	30.0	4.7		1.7		
04	627.0	30.0	5.7		2.1		
05	670.0	30.0	5.4		1.7		
06	770.0	35.0	5.5		1.8		
07	886.0	35.0	4.7		2.2		
08	753.0	35.0	5.6	7.3	1.7	1.0	
09	702.0	30.0	5.1		2.0		
10	645.0	25.0	4.7		2.3		
11	713.0	30.0	5.0	7.3	1.9	0.7	
12	630.0	20.0	3.8	7.3	1.5	0.6	
13	702.0	30.0	5.1		1.4		
14	795.0	35.0	5.3		2.0		
15	551.0	25.0	5.4	7.3	2.0	0.8	
16	934.0	40.0	5.1		2.5		
17	459.0	20.0	5.2	7.3	2.1	1.2	
18	883.0	35.0	4.8	7.3	2.6	1.0	
19	420.0	15.0	4.3	7.4	1.9	0.7	
20	802.0	35.0	5.2		2.2		
21	674.0	15.0	2.7		1.1		
22	997.0	25.0	3.0	7.3	1.1	0.5	
23	804.0	20.0	3.0	7.3	1.0	0.4	
24	505.0	10.0	2.4	7.3	2.7	1.0	
25	1012.0	40.0	4.7	7.3	2.6	1.2	
26	566.0	20.0	4.2	7.3	2.3	0.8	
27	964.0	35.0	4.4	7.3	1.9	0.6	
28	658.0	15.0	2.7	7.3	2.1	1.0	
29	721.0	20.0	3.3	7.3	2.3	0.8	
30	547.0	20.0	4.4	7.3	1.4	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7 SAMPLE DATE: 04-03-96

COMMENTS:

ID NO. 2160565 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996


EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

STATION	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
HLY							
AL	20954.0	905.0	162.4	51.1	79.9	5.2	
AGE	675.9	29.2	5.2	7.3	2.6	0.7	
MUM	884.0	40.0	6.7	7.3	14.9	0.9	
MUM	486.0	20.0	3.8	7.3	1.6	0.6	
01	655.0	30.0	5.5	7.3	2.2	0.9	
02	575.0	30.0	6.3		2.5		
03	539.0	30.0	6.7		2.6		
04	595.0	30.0	6.1	7.3	2.6	0.8	
05	775.0	30.0	4.6		2.1		
06	499.0	25.0	6.0		2.8		
07	732.0	25.0	4.1		1.8		
08	683.0	35.0	6.1	7.3	2.0	0.8	
09	689.0	30.0	5.2		2.2		
10	819.0	35.0	5.1		2.5		
11	622.0	30.0	5.8	7.3	14.9	0.6	
12	731.0	35.0	5.7		2.1		
13	745.0	25.0	4.0		2.0		
14	693.0	30.0	5.2		2.0		
15	701.0	30.0	5.1		2.3		
16	705.0	25.0	4.3		1.7		
17	747.0	30.0	4.8		1.9		
18	741.0	30.0	4.9	7.3	2.3	0.8	
19	629.0	25.0	4.8		2.5		
20	542.0	30.0	6.6		2.9		
21	625.0	20.0	3.8		2.2		
22	689.0	30.0	5.2	7.3	2.4	0.7	
23	703.0	30.0	5.1		2.0		
24	884.0	40.0	5.4		1.6		
25	624.0	30.0	5.8		1.9		
26	884.0	35.0	4.8	7.3	1.9	0.6	
27	486.0	20.0	4.9		2.5		
28	821.0	30.0	4.4		2.0		
29	592.0	30.0	6.1		1.9		
30	693.0	25.0	4.3		1.8		
31	536.0	25.0	5.6		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7 SAMPLE DATE: 03-06-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0035

NAME OF DRINKING WATER SYST WHEAT ROAD WATER TREATMENT PLANT - JAX HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996


PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

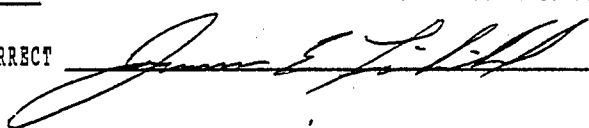

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17719.0	1225.0	240.0	51.0	61.2	4.5	
AVERAGE	611.0	42.2	8.3	7.3	2.1	0.6	
MAXIMUM	1019.0	65.0	10.8	7.3	3.0	0.8	
MINIMUM	408.0	15.0	4.4	7.2	1.3	0.5	
01	671.0	40.0	7.2	7.3	1.4	0.6	
02	525.0	35.0	8.0		2.4		
03	612.0	55.0	10.8		2.3		
04	762.0	65.0	10.2		2.5		
05	637.0	55.0	10.4	7.3	2.2	0.8	
06	576.0	40.0	8.3	7.3	1.8	0.6	
07	408.0	30.0	8.8		2.1		
08	734.0	55.0	9.0		2.3		
09	513.0	30.0	7.0		1.8		
10	538.0	45.0	10.0		2.4		
11	611.0	50.0	9.8		2.0		
12	692.0	50.0	8.7		1.8		
13	524.0	45.0	10.3	7.3	2.3	0.5	
14	515.0	30.0	7.0		2.8		
15	684.0	50.0	8.8		1.9		
16	495.0	30.0	7.3		2.0		
17	599.0	40.0	8.0		2.5		
18	571.0	40.0	8.4	7.3	2.4	0.6	
19	668.0	40.0	7.2		2.5		
20	583.0	40.0	8.2		2.2		
21	670.0	50.0	9.0		2.1		
22	432.0	30.0	8.3	7.3	2.0	0.8	
23	592.0	40.0	8.1		1.9		
24	805.0	50.0	7.5		1.3		
25	1019.0	55.0	6.5		1.5		
26	627.0	40.0	7.7		1.8		
27	652.0	55.0	10.1		1.7		
28	410.0	15.0	4.4	7.2	3.0	0.6	
29	594.0	25.0	5.1		2.3		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 02-21-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160565 C.U.P. NO. 2-031-0039H

NAME OF DRINKING WATER SYSTEM: WHEAT ROAD WATER TREATMENT PLANT - JAY HEIGHTS GRID

LOCATION: 7400 WHEAT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Paul Tombari, C.O., CERT. NO. C-5836

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	18142.0	1330.0	273.3	64.8	52.4	6.2	
AVERAGE	585.2	42.9	8.8	7.2	1.7	0.7	
MAXIMUM	727.0	55.0	12.4	7.3	2.0	0.8	
MINIMUM	485.0	30.0	6.4	7.1	1.1	0.5	
01	588.0	40.0	8.2		2.0		
02	590.0	45.0	9.2	7.2	1.8	0.7	
03	532.0	55.0	12.4		1.9		
04	610.0	50.0	9.8	7.2	1.9	0.8	
05	580.0	35.0	7.2		2.0		
06	581.0	35.0	7.2		1.8		
07	636.0	35.0	6.6		1.7		
08	566.0	30.0	6.4		1.8		
09	667.0	55.0	9.9	7.3	1.8	0.7	
10	561.0	45.0	9.6		2.0		
11	594.0	45.0	9.1	7.2	1.7	0.6	
12	601.0	50.0	10.0		1.7		
13	571.0	45.0	9.5		1.6		
14	522.0	40.0	9.2		1.8		
15	727.0	50.0	8.3		1.9		
16	488.0	35.0	8.6	7.2	1.9	0.7	
17	565.0	35.0	7.4		1.1		
18	608.0	40.0	7.9	7.1	1.7	0.7	
19	580.0	35.0	7.2		1.4		
20	590.0	50.0	10.2		2.0		
21	608.0	45.0	8.9		1.8		
22	562.0	45.0	9.6		1.7		
23	485.0	30.0	7.4	7.1	1.3	0.8	
24	630.0	50.0	9.5		1.5		
25	493.0	40.0	9.7	7.2	1.5	0.7	
26	568.0	35.0	7.4		1.7		
27	587.0	55.0	11.2		1.5		
28	588.0	45.0	9.2		1.5		
29	594.0	55.0	11.1		1.5		
30	707.0	40.0	6.8	7.3	1.4	0.5	
31	563.0	40.0	8.5		1.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 7

SAMPLE DATE: 01-10-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Stullman, C.O., CERT. NO. C-7255

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL			146.0		20.3	
AVERAGE			7.3		1.0	
MINIMUM			7.3		1.1	
MAXIMUM			7.3		0.8	
01						
02			7.3		1.0	
03			7.3		1.0	
04			7.3		1.1	
05			7.3		0.9	
06			7.3		1.0	
07						
08						
09			7.3		0.9	
10			7.3		1.1	
11			7.3		1.1	
12			7.3		1.1	
13			7.3		1.1	
14						
15						
16			7.3		1.0	
17			7.3		1.1	
18			7.3		1.0	
19			7.3		1.0	
20			7.3		0.8	
21						
22						
23			7.3		0.9	
24						
25						
26			7.3		0.9	
27			7.3		1.1	
28						
29						
30			7.3		1.1	
31			7.3		1.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 12-12-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL				138.7		20.4	
AVERAGE				7.3		1.1	
MAXIMUM				7.3		1.3	
MINIMUM				7.3		0.7	
01				7.3		1.1	
02							
03							
04				7.3		0.8	
05				7.3		1.2	
06				7.3		1.3	
07				7.3		1.2	
08				7.3		1.1	
09							
10							
11				7.3		0.7	
12				7.3		0.8	
13				7.3		1.2	
14				7.3		1.2	
15				7.3		1.0	
16							
17							
18				7.3		1.0	
19				7.3		0.9	
20				7.3		1.2	
21				7.3		1.1	
22				7.3		1.1	
23							
24							
25				7.3		1.1	
26				7.3		1.2	
27				7.3		1.2	
28							
29							
30							

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160634 C.U.P. NO. 2-031-0042H

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL				167.9		26.1	
AVERAGE				7.3		1.1	
MAXIMUM				7.3		1.4	
MINIMUM				7.3		0.7	
01				7.3		1.1	
02				7.3		0.8	
03				7.3		0.8	
04				7.3		1.0	
05							
06							
07				7.3		1.2	
08				7.3		0.7	
09				7.3		0.8	
10				7.3		1.1	
11				7.3		1.3	
12							
13							
14				7.3		0.9	
15				7.3		1.2	
16				7.3		1.2	
17				7.3		1.4	
18				7.3		1.4	
19							
20							
21				7.3		1.3	
22				7.3		1.0	
23				7.3		1.4	
24				7.3		1.4	
25				7.3		1.3	
26							
27							
28				7.3		1.3	
29				7.3		1.1	
30				7.3		1.2	
31				7.3		1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 10-17-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL				124.1		15.9	
AVERAGE				7.3		0.9	
MAXIMUM				7.3		1.2	
MINIMUM				7.3		0.7	
01							
02							
03				7.3		0.9	
04				7.3		1.2	
05				7.3		1.2	
06				7.3		1.0	
07							
08							
09				7.3		1.0	
10				7.3		1.2	
11				7.3		1.1	
12				7.3		0.7	
13							
14							
15							
16							
17				7.3		0.9	
18				7.3		0.7	
19				7.3		0.7	
20				7.3		0.7	
21				7.3		1.2	
22							
23							
24				7.3		1.0	
25				7.3		0.8	
26				7.3		0.8	
27				7.3		0.8	
28							
29							
30							

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 09-19-96

COMMENTS: Plant is off line for repairs. Water provided by city intertie.

ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Barnes E. Stiller

, C.O., CERT. NO. C-7255

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL				160.5		22.3	
AVERAGE				7.3		1.0	
MINIMUM				7.3		1.4	
MINIMUM				7.2		0.6	
01				7.2		1.1	
02				7.3		1.1	
03							
04							
05				7.3		0.8	
06				7.3		0.8	
07				7.3		1.3	
08				7.3		0.9	
09				7.3		0.6	
10							
11							
12				7.3		1.0	
13				7.3		1.0	
14				7.3		1.0	
15				7.3		1.4	
16				7.3		1.2	
17							
18							
19				7.3		0.8	
20				7.3		0.8	
21				7.3		0.7	
22				7.3		1.1	
23				7.3		1.0	
24							
25							
26				7.3		1.3	
27				7.3		1.3	
28				7.3		1.0	
29				7.3		1.0	
30				7.3		1.1	
31							

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 08-14-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

AS ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL			165.6		21.5	
AVERAGE			7.2		0.9	
MAXIMUM			7.2		1.2	
MINIMUM			7.2		0.7	
01			7.2		1.1	
02			7.2		1.1	
03			7.2		0.9	
04			7.2		0.7	
05			7.2		1.0	
06						
07						
08			7.2		0.9	
09			7.2		0.9	
10			7.2		1.0	
11			7.2		0.9	
12			7.2		0.9	
13						
14						
15			7.2		1.0	
16			7.2		1.0	
17			7.2		0.8	
18			7.2		0.9	
19			7.2		1.0	
20						
21						
22			7.2		1.1	
23			7.2		0.8	
24			7.2		0.8	
25			7.2		0.9	
26			7.2		0.7	
27						
28						
29			7.2		0.7	
30			7.2		1.2	
31			7.2		1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 07-18-96

IS ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland

, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	

MONTHLY TOTAL						17.5	
AVERAGE						0.9	
MAXIMUM						1.1	
MINIMUM						0.7	
01							
02							
03							
04						1.0	
05						0.8	
06						0.8	
07						1.1	
08							
09							
10						0.8	
11						0.7	
12						1.0	
13						1.0	
14						1.0	
15							
16							
17						0.9	
18						0.9	
19						1.0	
20						1.1	
21						0.8	
22							
23							
24						1.0	
25						0.7	
26						0.9	
27						1.0	
28						1.0	
29							
30							

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 06-24-96

COMMENTS: Plant off line for modifications Water provided by city intertia

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

SIGNATURE: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Ronald E. Stillman*, C.O., CERT. NO. C-7255

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY				158.4		20.1	
AVERAGE				7.2		0.9	
MINIMUM				7.2		1.3	
MAXIMUM				7.2		0.7	
01				7.2		1.0	
02				7.2		0.9	
03				7.2		0.7	
04							
05							
06				7.2		0.8	
07				7.2		0.8	
08				7.2		1.1	
09				7.2		1.3	
10				7.2		1.1	
11							
12							
13				7.2		0.8	
14				7.2		1.1	
15				7.2		0.9	
16				7.2		1.0	
17				7.2		0.9	
18							
19							
20				7.2		0.7	
21				7.2		0.8	
22				7.2		0.8	
23				7.2		0.8	
24				7.2		0.9	
25							
26							
27							
28				7.2		1.0	
29				7.2		1.1	
30				7.2		0.8	
31				7.2		0.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160634 C.U.P. NO. 2-031-0042K

NAME OF DRINKING WATER SYSTEM LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland Jr., C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL				108.0		14.8	
AVERAGE				7.2		1.0	
MAXIMUM				7.2		1.2	
MINIMUM				7.2		0.7	
01				7.2		1.0	
02							
03							
04							
05				7.2		1.1	
06							
07							
08				7.2		1.2	
09							
10							
11							
12				7.2		1.0	
13							
14							
15				7.2		0.7	
16							
17				7.2		0.9	
18				7.2		1.0	
19				7.2		1.0	
20							
21							
22				7.2		1.0	
23				7.2		0.8	
24				7.2		1.1	
25				7.2		1.0	
26				7.2		0.8	
27							
28							
29				7.2		1.1	
30				7.2		1.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 04-09-96

ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

AVERAGE EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Stishland, C.O., CERT. NO. C-7255

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP	
01						
02						
03						
04						
05						
06						
07						
08						
09						
10						
11						
12						
13						
14						
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						
27						
28						
29						
30						
31						

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 4 SAMPLE DATE: 03-14-96

REMARKS: Plant is out of service for modification. Water is supplied by city intertie.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160634 C.U.P. NO. 2-031-0042h

NAME OF DRINKING WATER SYSTEM LAKE FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP	

MONTHLY TOTAL

AVERAGE

MAXIMUM

MINIMUM

- 01
- 02
- 03
- 04
- 05
- 06
- 07
- 08
- 09
- 10
- 11
- 12
- 13
- 14
- 15
- 16
- 17
- 18
- 19
- 20
- 21
- 22
- 23
- 24
- 25
- 26
- 27
- 28
- 29

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160634 C.U.P. NO. 2-031-0042N

NAME OF DRINKING WATER SYSTEM: FOREST WATER TREATMENT PLANT

LOCATION: 1202 BUNKER HILL BLVD.

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

INFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL				65.3		7.9	
AVERAGE				7.3		0.9	
MAXIMUM				7.3		1.1	
MINIMUM				7.2		0.7	
01				7.2		0.9	
02							
03							
04							
05				7.2		0.9	
06							
07							
08				7.2		1.1	
09							
10							
11							
12				7.3		0.8	
13							
14							
15				7.3		0.9	
16							
17							
18							
19				7.3		0.8	
20							
21							
22				7.3		0.8	
23							
24							
25							
26				7.3		1.0	
27							
28							
29				7.2		0.7	
30							
31							

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

4 SAMPLE DATE: 01-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOFTON OAKS WATER TREATMENT PLANT

DN: 300 E. STEWART AVENUE

YULEE, FL ; MASSAU COUNTY

BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

Y FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

RTIFY THIS REPORT IS CORRECT Kenneth L. Lynch, C.O., CERT. NO. C-4016

S TH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	577.0	132.0	933.2	174.3	56.5	14.8	
AVERAGE	18.6	4.3	30.1	7.3	1.8	0.7	
MAXIMUM	38.6	6.0	57.1	7.3	2.3	1.0	
MINIMUM	10.5	3.0	9.3	7.2	1.5	0.5	
01	12.9	4.0	37.2		1.7		
02	15.8	4.0	30.4	7.2	1.8	0.7	
03	13.8	3.0	26.1	7.2	1.6	0.6	
04	12.9	3.0	27.9	7.2	1.5	0.6	
05	15.5	4.0	31.0	7.2	1.8	0.8	
06	17.2	6.0	41.9	7.2	1.6	0.7	
07	15.4	3.0	23.4		1.8		
08	11.5	4.0	41.7		1.8		
09	15.1	4.0	31.8	7.2	1.6	0.7	
10	14.0	3.0	25.7	7.2	1.5	0.5	
11	15.0	5.0	40.0	7.3	1.6	0.6	
12	15.1	4.0	31.8	7.3	1.8	0.6	
13	18.9	5.0	31.7	7.3	1.8	0.7	
14	18.1	4.0	26.5	7.3	2.3		
15	17.3	4.0	27.7	7.3	2.2		
16	17.8	5.0	33.7	7.3	2.2	1.0	
17	22.8	5.0	26.3	7.3	2.0	1.0	
18	10.5	5.0	57.1	7.3	2.0	0.8	
19	24.3	6.0	29.6	7.3	1.8	0.8	
20	19.5	5.0	30.8	7.3	1.6	0.7	
21	24.5	5.0	24.5	7.3	1.8		
22	17.2	6.0	41.9	7.3	1.7		
23	21.0	5.0	28.6	7.3	1.9	0.8	
24	12.8	4.0	37.5		1.9		
25	13.4	4.0	35.8		1.8		
26	34.7	4.0	13.8	7.3	1.9	0.7	
27	22.3	4.0	21.5	7.3	2.0	0.7	
28	38.6	3.0	9.3		2.1		
29	35.3	3.0	10.2		2.0		
30	14.8	4.0	32.4	7.2	1.8	0.9	
31	19.0	4.0	25.3	7.2	1.6	0.9	

ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM:

ON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Kenneth A. Lynch

, C.O., CERT. NO. C-4816

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	539.7	152.0	1036.5	151.6	48.8	15.0	
AVERAGE	18.0	5.1	34.6	7.2	1.6	0.7	
MAXIMUM	29.9	9.0	82.4	7.3	1.9	1.0	
MINIMUM	10.2	2.0	23.1	7.2	1.2	0.4	
01	27.3	6.0	26.4	7.2	1.8	0.8	
02	10.2	7.0	82.4		1.8		
03	21.7	5.0	27.6		1.9		
04	26.5	6.0	27.2	7.2	1.6	0.5	
05	18.4	7.0	45.7	7.2	1.7	0.5	
06	11.4	3.0	31.6	7.2	1.6	0.4	
07	18.3	7.0	45.9	7.2	1.5	0.4	
08	20.9	6.0	34.4	7.2	1.6	0.6	
09	19.7	5.0	30.5		1.2		
10	18.8	4.0	25.5		1.4		
11	13.6	6.0	52.9	7.2	1.3	0.8	
12	16.9	5.0	35.5	7.2	1.5	0.8	
13	15.6	4.0	30.8	7.2	1.8	1.0	
14	15.9	4.0	30.2	7.2	1.6	0.7	
15	19.4	6.0	37.1	7.2	1.6	0.8	
16	10.2	2.0	23.5		1.6		
17	14.2	3.0	25.4		1.6		
18	19.2	6.0	37.5	7.2	1.8	0.9	
19	13.5	4.0	35.6	7.2	1.6	0.7	
20	16.0	4.0	30.0	7.2	1.6	0.8	
21	13.7	3.0	26.3	7.2	1.6	0.7	
22	15.3	4.0	31.4	7.2	1.7	0.7	
23	16.1	5.0	37.3		1.6		
24	21.7	6.0	33.2		1.6		
25	29.9	9.0	36.1	7.2	1.8	0.7	
26	17.4	5.0	34.5	7.3	1.8	0.8	
27	15.6	3.0	23.1	7.3	1.7	0.8	
28	16.4	5.0	36.6	7.3	1.7	0.8	
29	22.6	5.0	26.5	7.3	1.7	0.8	
30	23.3	7.0	36.1		1.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 11-13-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOFTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth A. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	613.2	165.0	1044.0	180.0	53.6	20.2	
AVERAGE	19.8	5.3	33.7	7.2	1.7	0.9	
MAXIMUM	33.7	9.0	54.5	7.2	1.9	1.2	
MINIMUM	12.0	4.0	19.4	7.2	1.6	0.6	
01	12.1	4.0	39.7	7.2	1.8	1.2	
02	15.7	6.0	45.9	7.2	1.9	1.2	
03	15.4	7.0	54.5	7.2	1.8	1.0	
04	16.7	5.0	35.9	7.2	1.8	1.1	
05	15.5	4.0	31.0		1.8		
06	15.5	4.0	31.0		1.8		
07	18.1	5.0	33.1	7.2	1.7	1.0	
08	13.5	4.0	35.6	7.2	1.8	1.2	
09	16.4	5.0	36.6	7.2	1.7	1.0	
10	17.3	5.0	34.7	7.2	1.6	0.8	
11	24.0	5.0	25.0	7.2	1.8		
12	19.4	5.0	30.9		1.7		
13	16.0	5.0	37.5		1.6		
14	15.3	5.0	39.2	7.2	1.7	1.0	
15	18.6	6.0	38.7	7.2	1.8	0.8	
16	15.6	4.0	30.8	7.2	1.6	0.7	
17	17.3	5.0	34.7	7.2	1.8	0.8	
18	19.1	4.0	25.1	7.2	1.7	0.8	
19	12.0	4.0	40.0	7.2	1.6		
20	15.2	5.0	39.5	7.2	1.6		
21	30.9	5.0	19.4	7.2	1.8	0.7	
22	21.7	5.0	27.6	7.2	1.6	0.6	
23	21.2	5.0	28.3	7.2	1.8	0.8	
24	28.0	7.0	30.0	7.2	1.8	0.8	
25	33.7	7.0	24.9	7.2	1.6	0.7	
26	33.0	9.0	32.7		1.6		
27	30.2	6.0	23.8		1.6		
28	32.1	8.0	29.9	7.2	1.8	1.0	
29	16.1	5.0	37.3	7.2	1.7	1.0	
30	16.2	5.0	37.0	7.2	1.8	1.0	
31	21.4	6.0	33.6	7.2	1.9	1.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 10-17-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: TON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

INFLUENT pH: 6.9(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth L. Lynch*, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	620.3	163.0	966.2	137.6	49.5	23.1	
01	20.7	5.4	32.2	6.9	1.7	1.2	
02	33.2	10.0	51.9	7.2	2.2	1.3	
03	14.3	2.0	16.7	1.2	1.2	1.0	
04	14.4	2.0	16.7		1.4		
05	21.5	5.0	27.9		1.5		
06	21.0	5.0	28.6	7.2	1.6	1.2	
07	15.2	5.0	39.5	7.2	1.4	1.1	
08	20.5	5.0	29.3	7.2	1.6	1.3	
09	26.2	5.0	22.9	7.2	1.6	1.2	
10	24.8	5.0	24.2		1.4		
11	24.3	8.0	39.5		1.2		
12	18.5	8.0	51.9	1.2	1.4	1.0	
13	15.4	5.0	39.0	7.1	1.4	1.0	
14	14.3	5.0	42.0	7.1	1.6	1.2	
15	17.2	5.0	34.9	7.1	1.8	1.3	
16	28.1	6.0	25.6	7.1	1.7	1.3	
17	25.1	6.0	28.7		1.6		
18	21.3	4.0	22.5		1.8		
19	17.1	5.0	35.1	7.2	1.5	1.1	
20	17.7	4.0	27.1	7.2	1.6	1.0	
21	14.9	4.0	32.2	7.2	1.6	1.0	
22	18.1	5.0	33.1	7.2	1.6	1.0	
23	22.0	5.0	27.3	7.2	2.2	1.2	
24	19.3	5.0	31.1		2.0		
25	15.2	5.0	39.5		1.9		
26	19.5	6.0	36.9	7.2	2.0	1.3	
27	16.4	5.0	36.6	7.2	2.0	1.2	
28	28.1	7.0	29.9	7.2	1.8	1.1	
29	27.6	7.0	30.4	7.2	1.8	1.2	
30	31.0	10.0	38.7	7.2	1.6	1.1	
31	33.2	6.0	21.7		1.5		
32	15.4	4.0	31.2		1.6		
33	17.0	6.0	42.4	7.2	1.8	1.3	

WATER ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DIRECTION OF FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Thomas E. Lynch*, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	624.3	171.0	1051.0	158.3	55.6	29.2	
AVERAGE	20.1	5.5	33.9	7.2	1.8	1.3	
MINIMUM	33.0	9.0	57.9	7.3	2.1	1.5	
MAXIMUM	7.8	3.0	21.3	7.1	1.2	0.6	
01	24.0	8.0	40.0	7.2	1.8	1.4	
02	18.9	6.0	38.1	7.2	1.9	1.5	
03	12.4	4.0	38.7		1.6		
04	9.5	3.0	37.9		1.6		
05	25.5	7.0	32.9	7.2	1.8	1.5	
06	17.5	5.0	34.3	7.2	1.8	1.3	
07	17.3	5.0	34.7	7.2	1.8	1.2	
08	24.0	6.0	30.0	7.1	1.9	1.4	
09	21.7	5.0	27.6	7.2	1.8	1.3	
10	17.8	5.0	33.7		1.8		
11	13.2	4.0	36.4		1.9		
12	15.5	4.0	31.0	7.2	1.8	1.2	
13	7.8	3.0	46.2	7.2	1.5	1.0	
14	12.0	4.0	40.0	7.2	1.2	0.6	
15	19.6	4.0	24.5	7.2	2.0	1.5	
16	33.0	8.0	29.1	7.2	1.8	0.9	
17	22.1	6.0	32.6		1.8		
18	22.3	7.0	37.7		1.6		
19	22.5	4.0	21.3	7.2	2.0	1.0	
20	22.8	5.0	26.3	7.3	1.9	1.4	
21	20.4	7.0	41.2	7.3	2.1	1.5	
22	22.6	5.0	26.5	7.3	1.8	1.3	
23	25.1	6.0	28.7	7.2	1.6	1.2	
24	22.8	6.0	31.6		1.8		
25	29.4	6.0	24.5		2.0		
26	26.6	9.0	40.6	7.1	1.8	1.3	
27	19.6	7.0	42.9	7.1	1.8	1.4	
28	22.4	6.0	32.1	7.1	2.0	1.5	
29	20.7	5.0	29.0	7.2	1.8	1.3	
30	14.5	7.0	57.9	7.2	2.0	1.3	
31	20.8	4.0	23.1		1.6	1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 08-06-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454338 C.U.P. NO.
 LOCATION: 300 E. STEWART AVENUE
 OPERATED BY: UNITED WATER FLORIDA INC.
 INFLUENT EFFLUENT pH: 7.2(AVG)

NAME OF DRINKING WATER SYSTEM: LOFTON OAKS WATER TREATMENT PLANT
 YULBEE, FL ; NASSAU COUNTY
 REPORTING MONTH: July 1996
 NO. OF SERVICES AT END OF MONTH: _____

PEAK FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Kenneth R. Inghel, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	864.8	232.0	1087.9	158.4	60.1	31.9	
BRIDGE	27.9	7.5	35.1	7.2	1.9	1.5	
MINUM	54.6	15.0	103.8	7.3	2.2	1.6	
MINUM	8.0	2.0	18.6	7.1	1.6	1.0	
01	27.7	6.0	26.0	7.1	1.9	1.2	
02	26.7	6.0	27.0	7.1	2.0	1.4	
03	35.1	9.0	30.8	7.2	2.1	1.6	
04	8.6	3.0	41.9		1.8		
05	13.5	3.0	26.7	7.2	2.0	1.4	
06	8.0	2.0	30.0		2.0		
07	12.8	3.0	28.1		2.0		
08	15.1	5.0	39.7	7.2	1.8	1.1	
09	19.0	5.0	31.6	7.2	2.1	1.6	
10	9.9	4.0	48.5	7.2	2.2	1.6	
11	13.5	4.0	35.6	7.2	2.2	1.6	
12	23.5	5.0	25.5	7.2	2.0	1.6	
13	19.8	4.0	24.2		2.0		
14	13.3	6.0	54.1		1.8		
15	29.1	8.0	33.0	7.3	2.0	1.5	
16	19.6	6.0	36.7	7.3	2.0	1.6	
17	34.9	12.0	41.3	7.2	2.0	1.5	
18	26.7	8.0	36.0	7.2	1.8	1.4	
19	50.0	11.0	26.4	7.2	1.8	1.4	
20	54.6	15.0	33.0		1.6		
21	17.2	6.0	41.9		1.8		
22	31.3	15.0	57.5	7.2	2.0	1.6	
23	45.2	7.0	18.6	7.2	2.0	1.4	
24	31.3	5.0	19.2	7.2	1.9	1.4	
25	31.0	5.0	19.4	7.2	2.0	1.5	
26	10.4	9.0	103.8	7.2	2.0	1.6	
27	44.1	10.0	27.2		1.8		
28	45.8	12.0	31.4		1.8		
29	46.3	12.0	31.1	7.2	1.8	1.0	
30	50.2	12.0	28.7	7.2	2.0	1.4	
31	50.6	14.0	33.2	7.2	1.9	1.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 07-15-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM

FTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Kenneth L. Smyth*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	565.4	169.0	1156.5	156.2	52.8	26.9	
AVERAGE	18.8	5.6	38.6	7.1	1.8	1.2	
MAXIMUM	33.9	12.0	93.5	7.1	2.2	1.6	
MINIMUM	7.5	3.0	24.0	7.1	1.4	0.8	
01	27.8	8.0	34.5	7.1	1.6	1.2	
02	33.9	8.0	28.3	7.1	1.6	1.3	
03	31.8	7.0	26.4	7.1	1.6	1.3	
04	33.0	8.0	29.1	7.1	1.6	1.2	
05	33.2	8.0	28.9	7.1	1.7	1.2	
06	30.8	8.0	31.2	7.1	1.7	1.2	
07	17.6	5.0	34.1	7.1	1.7	1.3	
08	9.7	3.0	37.1		1.8		
09	12.8	4.0	37.5		1.6		
10	13.6	4.0	35.3	7.1	1.4	0.8	
11	17.9	6.0	40.2	7.1	1.6	0.9	
12	20.9	5.0	28.7	7.1	1.6	0.8	
13	21.7	6.0	33.2	7.1	1.7	1.0	
14	12.9	3.0	27.9	7.1	1.6	1.0	
15	10.7	5.0	56.1		1.6		
16	17.2	4.0	27.9		1.8		
17	17.6	5.0	34.1	7.1	1.8	1.3	
18	18.9	6.0	38.1	7.1	1.8	1.4	
19	7.5	4.0	64.0	7.1	1.8	1.3	
20	14.8	5.0	40.5	7.1	1.7	1.2	
21	10.3	3.0	35.0	7.1	1.8	1.3	
22	15.0	4.0	32.0		1.6		
23	20.0	4.0	24.0		1.8		
24	27.9	9.0	38.7	7.1	1.7	1.3	
25	15.4	12.0	93.5	7.1	2.2	1.5	
26	10.5	6.0	68.6	7.1	2.2	1.6	
27	17.7	5.0	33.9	7.1	2.1	1.4	
28	10.1	4.0	47.5	7.1	2.1	1.4	
29	17.4	5.0	34.5		2.0		
30	16.8	5.0	35.7		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 06-03-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: LOSTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

AVERAGE EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth L. Smith, C.O., CERT. NO. C-4016

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	815.5	229.0	1100.6	169.9	49.4	30.5	
AVERAGE	26.3	7.4	35.5	7.1	1.6	1.3	
MAXIMUM	38.0	11.0	58.8	7.2	2.0	1.8	
MINIMUM	8.6	4.0	22.1	7.0	1.0	0.6	
01	15.7	6.0	45.9	7.0	1.8	1.6	
02	20.4	7.0	41.2	7.0	1.9	1.6	
03	25.1	7.0	33.5	7.0	1.0	0.9	
04	24.6	5.0	24.4	7.0	1.4	1.2	
05	32.5	7.0	25.8	7.0	1.5	1.2	
06	20.4	10.0	58.8	7.0	1.6	1.4	
07	34.4	10.0	34.9	7.0	1.0	0.8	
08	26.5	8.0	36.2	7.0	1.9	1.6	
09	29.4	8.0	32.7	7.0	2.0	1.8	
10	31.8	8.0	30.2	7.0	1.9	1.5	
11	15.9	4.0	30.2		1.6		
12	28.6	9.0	37.8		1.8		
13	30.1	7.0	27.9	7.2	1.3	1.0	
14	18.5	6.0	38.9	7.2	1.5	1.3	
15	28.1	7.0	29.9	7.2	1.4	1.0	
16	32.0	7.0	26.3	7.2	1.5	1.1	
17	29.0	7.0	29.0	7.2	1.4	1.1	
18	33.7	8.0	28.5		1.6		
19	36.1	10.0	33.2		1.6		
20	29.4	9.0	36.7	7.1	1.0	0.6	
21	11.1	5.0	54.1	7.1	2.0	1.5	
22	27.7	7.0	30.3	7.1	1.9	1.5	
23	29.4	8.0	32.7	7.1	1.9	1.4	
24	38.0	7.0	22.1	7.1	1.8	1.5	
25	32.0	8.0	30.0		1.6		
26	28.7	7.0	29.3		1.5		
27	34.6	11.0	38.2		1.8		
28	8.6	4.0	55.8	7.1	1.7	1.3	
29	18.1	7.0	46.4	7.1	1.4	1.1	
30	20.6	7.0	40.8	7.1	1.5	1.2	
31	24.5	8.0	39.2	7.1	1.6	1.3	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 05-09-96

PWS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYST: LOPTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.0(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth V. Boyd, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	846.6	243.0	1047.7	105.1	58.8	22.1	
AVERAGE	28.2	8.1	34.9	7.0	2.0	1.6	
MAXIMUM	40.1	14.0	54.1	7.1	2.2	1.8	
MINIMUM	13.3	4.0	22.3	6.9	1.7	1.4	
01	13.3	6.0	54.1	7.0	1.7	1.4	
02	26.9	5.0	22.3	7.1	2.1		
03	21.0	5.0	28.6		2.0		
04	31.5	8.0	30.5	7.0	2.1	1.6	
05	40.1	12.0	35.9		2.0		
06	22.6	6.0	31.9		2.1		
07	22.0	7.0	38.2		2.0		
08	22.1	7.0	38.0	7.0	1.8	1.6	
09	20.6	6.0	35.0		1.9		
10	31.3	8.0	30.7		2.0		
11	31.9	8.0	30.1		1.8		
12	38.6	9.0	28.0		1.8		
13	32.1	9.0	33.6		2.1		
14	28.8	10.0	41.7		2.0		
15	26.0	10.0	46.2	7.0	2.0	1.8	
16	14.8	5.0	40.5		2.2		
17	17.9	5.0	33.5		2.0		
18	32.8	10.0	36.6		2.1		
19	32.5	12.0	44.3	7.1	2.1	1.5	
20	31.1	8.0	30.9		2.1		
21	34.5	7.0	24.3		2.0		
22	39.0	11.0	33.8	7.0	1.8	1.6	
23	30.0	8.0	32.0	6.9	1.8	1.6	
24	35.1	10.0	34.2	7.0	2.0	1.7	
25	37.6	10.0	31.9	7.0	1.8	1.5	
26	28.7	7.0	29.3	7.0	1.8	1.6	
27	34.4	10.0	34.9	7.0	2.1	1.6	
28	33.7	14.0	49.9	7.0	1.8	1.5	
29	17.5	4.0	27.4	7.0	2.0	1.6	
30	18.2	6.0	39.6	7.0	1.8	1.5	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-02-96

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULEE, FL ; NASSAU COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

INFLUENT pH: 7.0(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth J. Smyth, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
THLY							
TAL	568.7	190.0	1293.6	34.8	55.4	8.3	
RAGE	18.3	6.1	41.7	7.0	1.8	1.7	
IMUM	37.6	15.0	74.2	7.0	2.1	1.8	
IMUM	6.1	2.0	22.2	6.9	1.2	1.6	
01	6.1	3.0	59.0	6.9	2.0	1.7	
02	17.7	8.0	54.2		1.6		
03	22.3	10.0	53.8		1.2		
04	33.4	15.0	53.9		1.5		
05	18.3	8.0	52.5		2.0		
06	23.7	5.0	25.3	7.0	1.9	1.6	
07	11.7	5.0	51.3		1.9		
08	11.4	4.0	42.1		1.8		
09	9.7	6.0	74.2		1.6		
10	9.2	4.0	52.2		1.6		
11	9.4	2.0	25.5	7.0	2.1	1.8	
12	9.0	2.0	26.7		2.0		
13	17.4	4.0	27.6		1.6		
14	25.4	7.0	33.1		1.8		
15	36.7	9.0	29.4		1.8		
16	30.5	10.0	39.3		1.9		
17	23.7	7.0	35.4		1.8		
18	10.7	4.0	44.9	7.0	1.8	1.6	
19	10.2	4.0	47.1		1.8		
20	12.6	5.0	47.6		1.8		
21	15.7	5.0	38.2		1.6		
22	21.6	4.0	22.2		1.9		
23	37.6	13.0	41.5		1.8		
24	34.7	12.0	41.5		1.9		
25	25.3	6.0	28.5	6.9	1.8	1.6	
26	19.5	6.0	36.9		1.8		
27	13.5	5.0	44.4		1.8		
28	12.8	5.0	46.9		1.8		
29	17.9	4.0	26.8		1.7		
30	10.9	4.0	44.0		2.0		
31	10.1	4.0	47.5		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-05-96

REMARKS:

PWS ID NO. 2454338 C.U.P. NO.

NAME OF DRINKING WATER SYST: LOFTON OAKS WATER TREATMENT PLANT

LOCATION: 300 E. STEWART AVENUE

YULBEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.0(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth L. Lynch*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	999.0	324.0	1277.8	62.7	55.6	13.9	
AVERAGE	34.4	11.2	44.1	7.0	1.9	1.7	
MAXIMUM	106.1	56.0	317.0	7.0	2.2	1.9	
MINIMUM	16.4	4.0	23.2	6.9	1.5	1.5	
01	22.3	7.0	37.7	7.0	2.1	1.9	
02	19.5	6.0	36.9		1.9		
03	21.2	5.0	28.3		2.0		
04	25.1	7.0	33.5		2.0		
05	19.9	9.0	54.3	7.0	1.9	1.7	
06	18.3	7.0	45.9	6.9	1.9		
07	75.6	20.0	31.7		2.0		
08	41.3	10.0	29.1	6.9	2.0	1.9	
09	82.2	25.0	36.5	6.9	2.0	1.8	
10	106.1	25.0	28.3		2.1		
11	55.6	15.0	32.4		2.2		
12	30.0	8.0	32.0	7.0	2.0	1.7	
13	29.3	7.0	28.7		2.2		
14	42.8	9.0	25.2	7.0	1.9	1.7	
15	16.4	7.0	51.2		2.0		
16	21.2	56.0	317.0		1.9		
17	22.9	5.0	26.2		1.5		
18	20.7	4.0	23.2		1.6		
19	30.4	9.0	35.5		1.6		
20	24.1	7.0	34.9	7.0	1.8	1.5	
21	30.8	8.0	31.2		1.8		
22	32.5	8.0	29.5		1.8		
23	29.6	6.0	24.3		2.0		
24	34.6	11.0	38.2		1.9		
25	34.4	8.0	27.9		1.9		
26	45.0	12.0	32.0	7.0	2.0	1.7	
27	16.9	7.0	49.7		2.0		
28	26.7	8.0	36.0		1.8		
29	23.6	8.0	40.7		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 02-20-96

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454338 C.U.P. NO.
 LOCATION: 300 E. STEWART AVENUE
 OPERATED BY: UNITED WATER FLORIDA INC.
 INFLUENT EFFLUENT pH: 7.2(AVG)
 DAILY FLOW: _____

NAME OF DRINKING WATER SYSTEM: LORION OAKS WATER TREATMENT PLANT
 YULEE, FL ; NASSAU COUNTY
 REPORTING MONTH: January 1996
 NO. OF SERVICES AT END OF MONTH: _____
 MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth C. Ingh, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	827.8	159.0	782.4	36.0	55.8	5.1	
AVERAGE	26.7	5.1	25.2	7.2	1.8	1.0	
MINIMUM	157.7	27.0	87.3	7.5	2.2	1.4	
MINIMUM	4.0	1.0	7.4	7.1	0.9	0.9	
01	43.2	9.0	25.0		1.5		
02	44.5	8.0	21.6	7.5	2.2	1.4	
03	5.8	2.0	41.4		2.2		
04	5.6	2.0	42.9		2.2		
05	11.5	2.0	20.9		2.2		
06	16.0	2.0	15.0		2.2		
07	14.4	2.0	16.7		2.2		
08	20.9	3.0	17.2		2.2		
09	5.1	1.0	23.5	7.1	2.0	1.0	
10	6.9	1.0	17.4		2.2		
11	12.9	2.0	18.6		1.7		
12	6.9	1.0	17.4		2.0		
13	6.0	1.0	20.0		2.0		
14	11.5	1.0	10.4		1.9		
15	13.2	1.0	9.1	7.2	1.8	0.9	
16	38.5	4.0	12.5		1.5		
17	4.0	1.0	30.0		1.4		
18	16.2	1.0	7.4		1.8		
19	13.1	2.0	18.3		1.6		
20	4.5	1.0	26.7		0.9		
21	5.1	1.0	23.5		1.7		
22	14.6	2.0	16.4	7.1	1.8	0.9	
23	18.1	3.0	19.9		1.3		
24	19.0	5.0	31.6		1.6		
25	5.5	4.0	87.3		1.7		
26	7.5	4.0	64.0		1.9		
27	51.0	12.0	28.2		1.7		
28	55.5	12.0	25.9		1.6		
29	157.7	24.0	18.3	7.1	1.2	0.9	
30	83.8	18.0	25.8		1.6		
31	109.3	27.0	29.6		2.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160708 C.U.P. NO. 2-031-0039X NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT
 LOCATION: 2540 LANTANA AVENUE JACKSONVILLE, FLA., DUVAL COUNTY
 OWNED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: December 1996
 PLANT EFFLUENT pH: 7.3(AVG) NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	5001.0	427.0	322.2	146.0	52.9	13.7	
AVERAGE	161.3	13.8	10.4	7.3	1.7	0.7	
MAXIMUM	255.0	20.0	19.4	7.3	2.1	1.0	
MINIMUM	99.0	8.0	6.8	7.3	1.2	0.4	
01	117.0	9.0	9.2		1.6		
02	193.0	13.0	8.1	7.3	1.5	0.4	
03	198.0	13.0	7.9	7.3	1.5	0.6	
04	152.0	15.0	11.8	7.3	1.5	0.4	
05	188.0	17.0	10.9	7.3	1.5	0.5	
06	149.0	11.0	8.9	7.3	1.5	0.5	
07	137.0	8.0	7.0		1.6		
08	109.0	10.0	11.0		1.6		
09	159.0	9.0	6.8	7.3	1.4	0.4	
10	169.0	16.0	11.4	7.3	2.0	0.6	
11	185.0	20.0	13.0	7.3	1.9	0.6	
12	137.0	13.0	11.4	7.3	1.9	0.8	
13	177.0	17.0	11.5	7.3	2.1	0.8	
14	167.0	14.0	10.1		2.0		
15	99.0	16.0	19.4		2.0		
16	157.0	14.0	10.7	7.3	2.0	1.0	
17	149.0	14.0	11.3	7.3	1.8	0.9	
18	158.0	10.0	7.6	7.3	1.8	0.8	
19	181.0	16.0	10.6	7.3	2.0	0.8	
20	255.0	20.0	9.4	7.3	1.8	0.6	
21	177.0	14.0	9.5		1.2		
22	145.0	14.0	11.6		1.4		
23	149.0	11.0	8.9	7.3	1.6	0.7	
24	173.0	17.0	11.8		1.6		
25	158.0	11.0	8.4		1.6		
26	134.0	12.0	10.7	7.3	1.6	0.8	
27	175.0	16.0	11.0	7.3	1.8	0.9	
28	146.0	13.0	10.7		1.8		
29	192.0	15.0	9.4		1.8		
30	133.0	14.0	12.6	7.3	1.7	0.7	
31	183.0	15.0	9.8	7.3	1.8	0.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160708 C.U.P. NO. 2-031-0039X

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	5055.0	409.0	293.5	151.2	46.7	14.1	
AVERAGE	168.5	13.6	9.8	7.2	1.6	0.7	
MAXIMUM	231.0	21.0	16.5	7.2	1.8	0.9	
MINIMUM	99.0	3.0	3.6	7.2	1.2	0.4	
01	227.0	21.0	11.1	7.2	1.5	0.7	
02	231.0	20.0	10.4		1.6		
03	183.0	15.0	9.8		1.6		
04	143.0	12.0	10.1	7.2	1.6	0.8	
05	117.0	15.0	15.4	7.2	1.6	0.9	
06	216.0	17.0	9.4	7.2	1.8	0.9	
07	99.0	3.0	3.6	7.2	1.7	0.6	
08	202.0	15.0	8.9	7.2	1.2	0.4	
09	155.0	13.0	10.1		1.8		
10	157.0	12.0	9.2		1.6		
11	175.0	16.0	11.0	7.2	1.7	0.8	
12	149.0	12.0	9.7	7.2	1.8	0.8	
13	194.0	19.0	11.8	7.2	1.5	0.6	
14	135.0	13.0	11.6	7.2	1.5	0.6	
15	189.0	15.0	9.5	7.2	1.7	0.6	
16	137.0	12.0	10.5		1.6		
17	160.0	8.0	6.0		1.6		
18	190.0	13.0	8.2	7.2	1.5	0.7	
19	109.0	15.0	16.5	7.2	1.4	0.5	
20	231.0	15.0	7.8	7.2	1.4	0.7	
21	152.0	10.0	7.9	7.2	1.5	0.7	
22	173.0	12.0	8.3	7.2	1.7	0.6	
23	146.0	10.0	8.2		1.4		
24	151.0	15.0	11.9		1.4		
25	166.0	16.0	11.6	7.2	1.5	0.7	
26	142.0	11.0	9.3	7.2	1.6	0.6	
27	202.0	15.0	8.9	7.2	1.4	0.6	
28	166.0	12.0	8.7	7.2	1.4	0.5	
29	152.0	12.0	9.5	7.2	1.5	0.8	
30	206.0	15.0	8.7		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 11-13-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WWS ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	5163.0	401.0		165.6	49.4	16.4	
AVERAGE	166.5	12.9		7.2	1.6	0.7	
MAXIMUM	277.0	18.0		7.2	1.8	1.0	
MINIMUM	90.0	8.0		7.2	1.2	0.5	
01	156.0	14.0		7.2	1.5	0.7	
02	141.0	13.0		7.2	1.7	0.8	
03	90.0	8.0		7.2	1.8	0.8	
04	175.0	10.0		7.2	1.8	0.8	
05	216.0	10.0			1.6		
06	193.0	15.0			1.8		
07	217.0	17.0		7.2	1.8	0.8	
08	184.0	15.0		7.2	1.6	0.7	
09	231.0	15.0		7.2	1.7	0.7	
10	130.0	11.0		7.2	1.5	0.6	
11	193.0	15.0		7.2	1.6	0.8	
12	277.0	13.0			1.6		
13	149.0	16.0			1.8		
14	139.0	11.0		7.2	1.7	0.9	
15	162.0	13.0		7.2	1.7	1.0	
16	149.0	9.0		7.2	1.5	0.7	
17	159.0	10.0		7.2	1.4	0.5	
18	169.0	14.0		7.2	1.5	0.6	
19	158.0	15.0			1.8		
20	154.0	8.0			1.8		
21	155.0	12.0		7.2	1.6	0.6	
22	148.0	15.0		7.2	1.6	0.8	
23	163.0	15.0		7.2	1.4	0.8	
24	134.0	12.0		7.2	1.2	0.7	
25	197.0	14.0		7.2	1.5	0.8	
26	166.0	14.0			1.2		
27	169.0	13.0			1.8		
28	150.0	18.0		7.2	1.6	0.5	
29	178.0	12.0		7.2	1.4	0.6	
30	128.0	11.0		7.2	1.4	0.6	
31	133.0	13.0		7.2	1.5	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160708 C.U.P. NO. 2-031-0039H

NAME OF DRINKING WATER SYSTEM: VOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Stillland, C.O., CERT. NO. C-7255

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	4551.0	295.0	235.1	137.0	46.4	14.6	
AVERAGE	151.7	9.8	7.8	7.2	1.5	0.8	
MAXIMUM	215.0	17.0	11.2	7.3	1.8	1.0	
MINIMUM	107.0	3.0	2.9	7.2	1.3	0.4	
01	125.0	3.0	2.9		1.5		
02	179.0	5.0	3.4		1.4		
03	134.0	8.0	7.2	7.2	1.5	1.0	
04	215.0	11.0	6.1	7.2	1.5	0.8	
05	192.0	10.0	6.3	7.2	1.5	1.0	
06	134.0	7.0	6.3	7.2	1.4	1.0	
07	186.0	7.0	4.5		1.5		
08	127.0	10.0	9.4		1.4		
09	149.0	7.0	5.6	7.3	1.6	0.7	
10	161.0	7.0	5.2	7.3	1.6	0.6	
11	136.0	7.0	6.2	7.2	1.5	0.7	
12	142.0	9.0	7.6	7.2	1.7	0.9	
13	168.0	7.0	5.0		1.6		
14	147.0	10.0	8.2		1.7		
15	127.0	7.0	6.6		1.5		
16	154.0	11.0	8.6	7.2	1.4	0.6	
17	113.0	8.0	8.5	7.2	1.6	0.6	
18	150.0	10.0	8.0	7.2	1.3	0.4	
19	171.0	12.0	8.4	7.2	1.6	0.7	
20	131.0	11.0	10.1	7.2	1.6	0.8	
21	168.0	12.0	8.6		1.5		
22	164.0	15.0	11.0		1.6		
23	126.0	10.0	9.5	7.2	1.8	1.0	
24	182.0	17.0	11.2	7.2	1.8	1.0	
25	154.0	13.0	10.1	7.2	1.5	0.8	
26	141.0	11.0	9.4	7.2	1.7	0.8	
27	168.0	15.0	10.7	7.2	1.5	0.6	
28	169.0	15.0	10.7		1.6		
29	131.0	12.0	11.0		1.5		
30	107.0	8.0	9.0	7.2	1.5	0.6	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: OLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Hill, C.O., CERT. NO. C-7255

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
STERILE							
TOTAL	5099.0	203.0	150.1	152.6	39.8	10.5	
AVERAGE	164.5	6.5	4.8	7.3	1.3	0.5	
MINIMUM	204.0	13.0	8.9	7.3	1.8	1.3	
MINIMUM	102.0	3.0	2.6	7.2	0.8	0.0	
01	167.0	4.0	2.9	7.2	1.5	0.6	
02	174.0	4.0	2.8		1.4		
03	158.0	4.0	3.0		1.2		
04	151.0	7.0	5.6		1.2		
05	136.0	3.0	2.6	7.3	1.3	0.3	
06	176.0	5.0	3.4	7.3	1.1	0.3	
07	170.0	4.0	2.8	7.3	0.8	0.3	
08	147.0	4.0	3.3	7.3	1.0	0.3	
09	187.0	4.0	2.6	7.3	1.0	0.3	
10	156.0	4.0	3.1		1.1		
11	174.0	5.0	3.4		0.8		
12	194.0	6.0	3.7	7.3	1.0	0.4	
13	173.0	4.0	2.8	7.3	1.0	0.3	
14	164.0	4.0	2.9	7.3	1.0	0.3	
15	174.0	7.0	4.8	7.3	1.4	0.4	
16	157.0	7.0	5.4	7.3	1.0	0.4	
17	173.0	8.0	5.5		1.2		
18	143.0	10.0	8.4		1.4		
19	193.0	8.0	5.0	7.3	1.5	0.6	
20	171.0	7.0	4.9	7.3	1.5	0.6	
21	147.0	5.0	4.1	7.3	1.6	0.4	
22	102.0	7.0	8.2	7.3	1.4	0.4	
23	204.0	13.0	7.6	7.2	1.8	1.3	
24	166.0	11.0	8.0		1.7		
25	155.0	11.0	8.5		1.7		
26	153.0	9.0	7.1	7.2	1.5	1.1	
27	159.0	9.0	6.8	7.2	1.2	0.8	
28	161.0	12.0	8.9	7.2	1.4	0.8	
29	180.0	7.0	4.7	7.2	1.4	0.0	
30	193.0	5.0	3.1	7.2	1.4	0.6	
31	141.0	5.0	4.3		1.3		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 08-22-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Banner E. Strickland

, C.O., CERT. NO. C-7255

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	2562.4	91.0	1234.9	166.7	24.4	16.6	
PERAGE	160.2	5.7	77.2	7.2	1.5	0.7	
MINUM	219.0	9.0	1170.7	7.4	2.1	1.1	
MINUM	0.4	2.0	2.4	7.2	1.0	0.4	
01				7.2		1.0	
02				7.2		0.8	
03	176.0	5.0	3.4	7.2	1.3	0.8	
04	189.0	6.0	3.8	7.2	1.4	0.5	
05	156.0	6.0	4.6	7.4	1.0	0.4	
06	149.0	5.0	4.0		1.6		
07	166.0	8.0	5.8		1.4		
08	101.0	9.0	10.7	7.3	1.2	0.6	
09	167.0	7.0	5.0	7.3	1.4	0.7	
10				7.3		0.5	
11				7.3		0.5	
12				7.3		0.8	
13							
14	176.0	8.0	5.5		1.4		
15				7.3		0.8	
16				7.2		1.1	
17				7.2		1.1	
18				7.3		0.7	
19				7.3		0.5	
20							
21							
22				7.3		0.6	
23	160.0	4.0	3.0	7.2	1.5	0.6	
24	197.0	4.0	2.4	7.2	1.5	0.7	
25	219.0	5.0	2.7	7.2	2.1	0.9	
26	214.0	6.0	3.4	7.2	1.8	0.7	
27	97.0	2.0	2.5		1.8		
28							
29	207.0	6.0	3.5	7.2	1.6	0.8	
30	188.0	6.0	3.8	7.2	1.7	0.8	
31	0.4	4.0	1170.7	7.2	1.7	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 07-18-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: HOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP	
TOTAL			158.4		20.5	
AVERAGE			7.2		0.9	
MINIMUM			7.2		1.1	
MINIMUM			7.2		0.6	
01			7.2		0.8	
02			7.2		0.9	
03			7.2		0.8	
04			7.2		0.8	
05			7.2		0.8	
06			7.2		1.0	
07			7.2		1.0	
08						
09						
10			7.2		0.9	
11			7.2		1.1	
12			7.2		1.1	
13			7.2		1.0	
14			7.2		1.0	
15						
16						
17			7.2		0.8	
18			7.2		0.7	
19			7.2		0.7	
20			7.2		1.0	
21			7.2		0.8	
22						
23						
24			7.2		0.9	
25			7.2		0.7	
26			7.2		0.6	
27			7.2		0.7	
28			7.2		0.7	
29					0.9	
30					0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 06-24-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

SYSTEM ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

SIGNATURE FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Bronson E. Strickland

, C.O., CERT. NO. C-7255

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL				158.4		20.8	
AVERAGE				7.2		0.9	
MAXIMUM				7.2		1.2	
MINIMUM				7.2		0.7	
01				7.2		0.9	
02				7.2		0.9	
03				7.2		0.9	
04							
05							
06				7.2		0.7	
07				7.2		1.0	
08				7.2		1.2	
09				7.2		1.2	
10				7.2		0.8	
11							
12							
13				7.2		1.1	
14				7.2		0.8	
15				7.2		1.0	
16				7.2		0.9	
17				7.2		0.9	
18							
19							
20				7.2		0.8	
21				7.2		1.0	
22				7.2		1.0	
23				7.2		1.1	
24				7.2		1.0	
25							
26							
27							
28				7.2		1.0	
29				7.2		0.9	
30				7.2		0.9	
31				7.2		0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 05-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039X

NAME OF DRINKING WATER SYSTEM. MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, Jr., C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1404.0	50.0	116.1	15.2	13.1	
AVERAGE	156.0	5.6	7.3	1.7	0.8	
MAXIMUM	191.0	7.0	7.3	1.8	1.1	
MINIMUM	120.0	4.0	7.0	1.6	0.6	
01	191.0	6.0	7.2	1.8	0.7	
02	120.0	5.0		1.6		
03	187.0	6.0		1.8		
04	126.0	4.0		1.8		
05	165.0	6.0	7.2	1.6	0.7	
06	151.0	5.0		1.6		
07	154.0	6.0		1.6		
08	157.0	5.0	7.2	1.7	0.7	
09	153.0	7.0		1.7		
10						
11						
12			7.2		0.8	
13						
14						
15			7.3		0.8	
16			7.3		0.6	
17			7.3		0.6	
18			7.3		0.9	
19			7.3		0.7	
20						
21						
22			7.3		0.9	
23			7.3		1.0	
24			7.3		1.0	
25			7.3		0.8	
26			7.0		1.1	
27						
28						
29			7.3		0.9	
30			7.3		0.9	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 04-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160708 C.U.P. NO. 2-031-0039H NAME OF DRINKING WATER SYSTEM: OLIA GARDENS WATER TREATMENT PLANT
 ADDRESS: 2540 LANTANA AVENUE JACKSONVILLE, FLA., DUVAL COUNTY
 OPERATED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: March 1996
 EFFLUENT pH: 7.2(AVG) NO. OF SERVICES AT END OF MONTH: _____
 INLET FLOW: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Banner E. Stuehlend, C.O., CERT. NO. C-7255

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4824.0	202.0	155.9	64.7	52.5	6.9	
AVERAGE	155.6	6.5	5.0	7.2	1.7	0.8	
JANUARY	193.0	9.0	7.1	7.2	1.9	0.9	
FEBRUARY	120.0	3.0	2.9	7.1	1.4	0.7	
01	120.0	6.0	6.0	7.2	1.6	0.7	
02	153.0	5.0	3.9		1.8		
03	129.0	5.0	4.7		1.4		
04	169.0	8.0	5.7	7.2	1.5	0.7	
05	172.0	8.0	5.6		1.6		
06	164.0	7.0	5.1		1.6		
07	156.0	7.0	5.4		1.4		
08	137.0	7.0	6.1	7.2	1.6	0.8	
09	173.0	9.0	6.2		1.6		
10	180.0	8.0	5.3		1.8		
11	158.0	8.0	6.1	7.1	1.7	0.8	
12	135.0	8.0	7.1		1.8		
13	166.0	6.0	4.3		1.8		
14	156.0	7.0	5.4		1.8		
15	170.0	9.0	6.4	7.2	1.9	0.8	
16	162.0	8.0	5.9		1.5		
17	141.0	5.0	4.3		1.8		
18	135.0	6.0	5.3	7.2	1.6	0.8	
19	163.0	6.0	4.4		1.7		
20	128.0	5.0	4.7		1.7		
21	184.0	5.0	3.3		1.9		
22	123.0	3.0	2.9	7.2	1.8	0.9	
23	193.0	7.0	4.4		1.8		
24	165.0	6.0	4.4		1.6		
25	151.0	6.0	4.8	7.2	1.8	0.7	
26	151.0	6.0	4.8		1.9		
27	160.0	7.0	5.3		1.9		
28	174.0	6.0	4.1	7.2	1.6	0.7	
29	159.0	6.0	4.5		1.6		
30	155.0	7.0	5.4		1.8		
31	142.0	5.0	4.2		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-14-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160708 C.U.P. NO. 2-031-0039a

NAME OF DRINKING WATER SYSTEM: MAGNOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Banner E. Stillman, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	4696.0	172.0	129.0	58.4	41.9	6.4	
AVERAGE	161.9	5.9	4.4	7.3	1.4	0.8	
MAXIMUM	251.0	13.0	7.6	7.3	1.6	0.9	
MINIMUM	100.0	3.0	2.4	7.3	1.3	0.7	
01	152.0	3.0	2.4		1.4		
02	125.0	4.0	3.8	7.3	1.5	0.7	
03	156.0	5.0	3.8		1.4		
04	185.0	6.0	3.9		1.5		
05	251.0	6.0	2.9	7.3	1.5	0.9	
06	189.0	5.0	3.2		1.4		
07	223.0	5.0	2.7		1.4		
08	153.0	4.0	3.1		1.4		
09	161.0	5.0	3.7	7.3	1.5	0.8	
10	181.0	6.0	4.0		1.5		
11	149.0	6.0	4.8		1.5		
12	136.0	5.0	4.4	7.3	1.4	0.8	
13	137.0	6.0	5.3		1.5		
14	163.0	6.0	4.4		1.3		
15	100.0	5.0	6.0		1.5		
16	213.0	7.0	3.9	7.3	1.4	0.8	
17	160.0	6.0	4.5		1.3		
18	159.0	6.0	4.5		1.3		
19	153.0	7.0	5.5	7.3	1.4	0.8	
20	181.0	9.0	6.0		1.4		
21	144.0	5.0	4.2		1.4		
22	133.0	5.0	4.5		1.4		
23	112.0	4.0	4.3	7.3	1.4	0.7	
24	164.0	8.0	5.9		1.5		
25	206.0	13.0	7.6		1.4		
26	154.0	5.0	3.9	7.3	1.5	0.9	
27	135.0	6.0	5.3		1.6		
28	188.0	8.0	5.1		1.6		
29	133.0	6.0	5.4		1.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2160708 C.U.P. NO. 2-031-0039N

NAME OF DRINKING WATER SYSTEM: JOLIA GARDENS WATER TREATMENT PLANT

LOCATION: 2540 LANTANA AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

LANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Banner E. Strickland, C.O., CERT. NO. C-7255

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	5124.0	236.0	175.9	65.7	45.9	3.5	
AVERAGE	165.3	7.6	5.7	7.3	1.5	0.4	
MAXIMUM	339.0	14.0	9.1	7.3	1.7	0.5	
MINIMUM	92.0	4.0	3.0	7.3	1.3	0.3	
01	154.0	5.0	3.9		1.5		
02	145.0	5.0	4.1	7.3	1.5	0.4	
03	164.0	5.0	3.7		1.5		
04	178.0	8.0	5.4		1.5		
05	190.0	7.0	4.4	7.3	1.6	0.4	
06	145.0	4.0	3.3		1.6		
07	183.0	9.0	5.9		1.3		
08	278.0	14.0	6.0	7.3	1.4	0.4	
09	169.0	10.0	7.1		1.3		
10	187.0	14.0	9.0		1.4		
11	154.0	11.0	8.6		1.6		
12	160.0	9.0	6.8	7.3	1.5	0.5	
13	161.0	9.0	6.7		1.6		
14	197.0	13.0	7.9		1.6		
15	339.0	9.0	3.2	7.3	1.6	0.5	
16	125.0	9.0	8.6		1.6		
17	138.0	9.0	7.8		1.5		
18	92.0	5.0	6.5		1.5		
19	92.0	7.0	9.1	7.3	1.3	0.4	
20	156.0	6.0	4.6		1.3		
21	142.0	6.0	5.1		1.7		
22	152.0	7.0	5.5		1.5		
23	199.0	5.0	3.0	7.3	1.6	0.3	
24	130.0	6.0	5.5		1.3		
25	139.0	9.0	7.8		1.4		
26	163.0	6.0	4.4	7.3	1.4	0.3	
27	169.0	6.0	4.3		1.5		
28	160.0	6.0	4.5		1.4		
29	176.0	7.0	4.8	7.3	1.5	0.3	
30	137.0	4.0	3.5		1.5		
31	150.0	6.0	4.8		1.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 01-09-96

DRINK WATER TREATMENT PLANT DAILY OPERATION SUMM

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : December, 1996

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Robert DeMay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	13707	1019.0	278.5	28.1	71.1	3.2	
AVERAGE	442	32.9	9.0	7.0	2.3	0.8	
MAXIMUM	687	45.0	13.2	7.1	3.5	1.0	
MINIMUM	279	22.0	6.8	7.0	1.2	0.6	
01	496	45.0	10.9		2.2		
02	300	33.0	13.2		3.5		
03	440	25.0	6.8		2.5		
04	437	31.0	8.5	7.1	2.6	0.7	
05	379	27.0	8.5		2.3		
06	410	29.0	8.5		2.5		
07	445	29.0	7.8		2.5		Well #1 artesian pressure 9 psi
08	444	30.0	8.1		2.1		Well #2 artesian pressure 11 psi
09	437	29.0	8.0		2.4		
10	428	29.0	8.1		2.5		
11	445	36.0	9.7	7.0	2.5	1.0	
12	445	40.0	10.8		2.3		
13	435	35.0	9.6		1.5		
14	540	33.0	7.3		2.0		
15	279	22.0	9.5		2.2		
16	497	28.0	6.8		2.4		
17	419	27.0	7.7		2.1		
18	487	31.0	7.6	7.0	2.1	0.6	
19	410	24.0	7.0		2.7		
20	687	45.0	7.9		2.3		
21	450	36.0	9.6		2.0		
22	378	32.0	10.2		2.1		
23	476	42.0	10.6		1.8		
24	474	43.0	10.9		1.2		
25	326	25.0	9.2		2.0		
26	449	33.0	8.8	7.0	3.0	0.9	
27	545	39.0	8.6		2.3		
28	459	39.0	10.2		2.5		
29	413	36.0	10.5		2.5		
30	407	24.0	7.1		2.0		
31	470	42.0	10.7		2.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 12-03-96
 Isle of Palms-R System: 2 Date: 12-05-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: United Water Florida Inc.

REPORTING MONTH : November, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Milton J. Jernigan, C.O., CERT. NO. C- 2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14224	1099.0	278.2	28.3	66.9	3.0	
AVERAGE	474	36.6	9.3	7.1	2.2	0.8	
MAXIMUM	663	52.0	10.8	7.2	2.7	0.9	
MINIMUM	331	26.0	7.9	7.0	1.5	0.6	
01	663	52.0	9.4		2.2		
02	481	41.0	10.2		1.5		
03	505	40.0	9.5		2.3		
04	454	36.0	9.5	7.1	2.3	0.9	
05	515	38.0	8.8		2.1		
06	509	41.0	9.7		2.5		
07	461	38.0	9.9		2.1		Well #1 artesian pressure 8 psi
08	565	37.0	7.9		2.0		Well #2 artesian pressure 9 psi
09	422	35.0	9.9		2.4		
10	424	33.0	9.3		2.2		
11	455	35.0	9.2	7.0	2.0	0.7	
12	399	27.0	8.1		2.2		
13	431	39.0	10.8		2.7		
14	443	35.0	9.5		2.1		
15	499	39.0	9.4		2.1		
16	515	39.0	9.1		2.5		
17	331	26.0	9.4		2.7		
18	461	33.0	8.6	7.0	2.3	0.6	
19	477	33.0	8.3		2.5		
20	502	38.0	9.1		2.2		
21	384	31.0	9.7		2.2		
22	600	47.0	9.4		2.5		
23	444	33.0	8.9		2.0		
24	429	29.0	8.1		1.8		
25	527	40.0	9.1	7.2	2.4	0.8	
26	399	31.0	9.3		2.7		
27	474	38.0	9.6		2.2		
28	476	38.0	9.6		2.0		
29	470	37.0	9.4		2.0		
30	509	40.0	9.4		2.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robin H. DeWay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14196	1037.0	275.8	35.3	71.8	3.3	
AVERAGE	458	33.5	8.9	7.1	2.3	0.7	
MAXIMUM	563	44.0	13.3	7.1	3.5	0.8	
MINIMUM	243	22.0	5.3	7.0	1.2	0.5	
01	441	38.0	10.3		2.3		
02	425	38.0	10.7	7.1	2.0	0.7	
03	306	34.0	13.3		2.5		
04	461	31.0	8.1		3.5		
05	392	32.0	9.8		3.0		
06	243	25.0	12.3		2.9		
07	368	24.0	7.8		2.7		Well #1 artesian pressure 8 psi
08	408	33.0	9.7		3.3		Well #2 artesian pressure 10 psi
09	425	26.0	7.3	7.1	2.0	0.5	
10	304	28.0	11.0		2.3		
11	563	25.0	5.3		2.5		
12	419	31.0	8.9		2.2		
13	485	34.0	8.4		2.7		
14	390	22.0	6.8		1.2		
15	440	25.0	6.8		2.0		
16	463	26.0	6.7	7.0	1.9	0.6	
17	544	35.0	7.7		2.3		
18	426	25.0	7.0		2.1		
19	481	30.0	7.5		2.1		
20	539	34.0	7.6		1.8		
21	533	36.0	8.1		2.1		
22	492	35.0	8.5		2.5		
23	520	35.0	8.1	7.1	2.5	0.8	
24	491	44.0	10.7		2.4		
25	503	40.0	9.5		1.5		
26	520	41.0	9.5		2.4		
27	544	42.0	9.3		2.4		
28	516	42.0	9.8		2.3		
29	552	44.0	9.6		2.0		
30	510	41.0	9.6	7.0	2.1	0.7	
31	492	41.0	10.0		2.3		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 10-09-96
 Isle of Palms-B System: 2 Date: 10-14-96

DRINK WATER TREATMENT PLANT DAILY OPERATION SUMMA

PWS ID NO. 216-0924 C.U.P. NO. 2-031-0015N

NAME OF DRINKING WATER SYSTEM: MONUMENT ROAD W.T.P.

LOCATION: 1258 MONUMENT ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA, INC.

REPORTING MONTH: Septeaber, 1996


PLANT EFFLUENT pH: 7.2 (AVG.)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-2234

DAYS OF MONTH	TOTAL WATER TREATED THOUSAND GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		ZINC POLYPHOSPHATE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	LBS USED	MG/L	
MONTHLY TOTAL	32472.0	-3248	360.1	36.0	89.0	4.6	509	56.4	
AVERAGE	1082.4	108	12.0	7.2	3.0	0.9	17	1.9	
MAXIMUM	1280.0	140	14.1	7.2	3.5	1.8	20	1.9	
MINIMUM	887.0	90	11.0	7.2	1.0	0.3	14	1.8	
01	1090.0	100	11.0		3.3		17	1.9	
02	1001.0	100	12.0		2.9		16	1.9	
03	939.0	90	11.5	7.2	3.5	1.8	14	1.8	
04	1113.0	110	11.9		3.5		17	1.9	
05	1001.0	100	12.0		3.5		15	1.8	
06	907.0	90	11.9		2.5		14	1.9	
07	1228.0	120	11.7		2.3		19	1.9	Well artesian pressure
08	1210.0	120	11.9		1.0		19	1.9	
09	1043.0	105	12.1	7.2	1.4	0.3	16	1.9	
10	1002.0	100	12.0		3.5		16	1.9	
11	981.0	100	12.2		3.5		15	1.8	
12	1017.0	120	14.1		3.5		16	1.9	
13	1280.0	140	13.1		3.5		20	1.8	
14	887.0	100	13.5		3.5		14	1.9	
15	1117.0	110	11.8		3.5		18	1.9	
16	1074.0	105	11.7	7.2	3.5	1.2	17	1.9	
17	1051.0	105	12.0		3.5		16	1.8	
18	1130.0	110	11.7		3.5		18	1.9	
19	1168.0	115	11.8		3.5		18	1.9	
20	1193.0	118	11.9		3.5		19	1.9	
21	1058.0	105	11.9		3.0		17	1.9	
22	1058.0	105	11.9		3.0		17	1.9	
23	1027.0	100	11.7	7.2	3.5	0.8	16	1.9	
24	1162.0	115	11.9		2.8		18	1.9	
25	1175.0	115	11.7		2.2		18	1.9	
26	1143.0	110	11.5		2.7		18	1.9	
27	1135.0	110	11.6		2.0		18	1.9	
28	1213.0	120	11.9		1.8		20	1.9	
29	1122.0	115	12.3		2.5	0.5	18	1.9	
30	947.0	95	12.0	7.2	3.1		14	1.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH: August, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robin DeMay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17903	1403.0	298.9	28.2	72.4	2.1	
AVERAGE	578	45.3	9.6	7.1	2.3	0.5	
MAXIMUM	779	58.0	21.3	7.1	3.5	0.7	
MINIMUM	281	35.0	7.9	7.0	1.0	0.4	
01	607	51.0	10.1	7.1	3.0	0.5	
02	590	52.0	10.6		2.4		
03	542	48.0	10.6		1.0		
04	544	43.0	9.5		3.5		
05	644	46.0	8.6		2.9		
06	566	40.0	8.5		2.3		
07	541	38.0	8.4		1.6		Well #1 artesian pressure 8 psi
08	580	44.0	9.1	7.0	1.9	0.7	Well #2 artesian pressure 9 psi
09	753	58.0	9.2		2.0		
10	743	54.0	8.7		1.5		
11	452	35.0	9.3		2.0		
12	526	43.0	9.8		2.0		
13	539	44.0	9.8		2.0		
14	500	41.0	9.8		2.7		
15	482	36.0	9.0	7.0	2.5	0.4	
16	510	42.0	9.9		3.0		
17	595	52.0	10.5		3.0		
18	672	47.0	8.4		2.8		
19	679	45.0	7.9		3.2		
20	518	36.0	8.3		1.7		
21	607	46.0	9.1		1.5		
22	653	48.0	8.8		2.0		
23	532	40.0	9.0	7.1	2.2	0.5	
24	654	48.0	8.8		2.0		
25	779	54.0	8.3		2.7		
26	498	42.0	10.1		1.7		
27	527	46.0	10.5		2.5		
28	600	45.0	9.0		1.9		
29	533	41.0	9.2		3.0		
30	656	48.0	8.8		2.8		
31	281	50.0	21.3		3.1		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 08-05-96
 Isle of Palms-B System: 2 Date: 08-07-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER : JM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : July, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Robin Delaney, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE NG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17924	1384.0	288.7	28.2	83.4	2.3	
AVERAGE	578	44.6	9.3	7.1	2.7	0.6	
MAXIMUM	876	65.0	17.1	7.1	3.6	0.7	
MINIMUM	392	22.0	6.0	7.0	1.5	0.5	
01	601	42.0	8.4	7.0	2.8	0.6	
02	594	38.0	7.7		2.1		
03	564	48.0	10.2		2.4		
04	440	22.0	6.0		1.5		
05	483	34.0	8.4		2.5		
06	533	37.0	8.3		2.5		
07	462	34.0	8.8		1.5		Well #1 artesian pressure 6 psi
08	440	32.0	8.7		2.9		Well #2 artesian pressure 7 psi
09	465	33.0	8.5	7.1	2.1	0.7	
10	445	33.0	8.9		1.8		
11	472	35.0	8.9		2.0		
12	491	36.0	8.8		2.8		
13	477	35.0	8.8		3.5		
14	560	41.0	8.8		3.5		
15	488	39.0	9.6		3.0		
16	584	46.0	9.4		2.4		
17	510	42.0	9.9	7.1	2.7	0.5	
18	590	48.0	9.8		2.2		
19	599	41.0	8.2		3.0		
20	617	59.0	11.5		2.3		
21	619	51.0	9.9		3.0		
22	392	56.0	17.1		3.5		
23	766	62.0	9.7		2.6		
24	560	47.0	10.1	7.0	2.9		
25	652	50.0	9.2		3.3	0.5	
26	832	60.0	8.6		3.2		
27	789	59.0	9.0		3.6		
28	611	57.0	11.2		2.8		
29	747	46.0	7.4		2.9		
30	876	65.0	8.9		3.1		
31	665	56.0	10.1		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 07-15-96
 Isle of Palms-B System: 2 Date: 07-17-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : June, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Ron D. Price, C.O., CERT. NO. C-3902

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14945	1152.0	279.1	28.3	75.9	2.6	
AVERAGE	498	38.4	9.3	7.1	2.5	0.7	
MAXIMUM	676	65.0	13.1	7.1	3.5	0.9	
MINIMUM	290	18.0	5.6	7.0	1.7	0.4	
01	665	65.0	11.7		2.5		
02	452	41.0	10.9		2.5		
03	474	36.0	9.1	7.1	2.9	0.7	
04	590	43.0	8.7		3.5		
05	676	49.0	8.7		3.3		
06	538	40.0	8.9		2.1		
07	620	50.0	9.7		1.8		Well #1 artesian pressure 7 psi
08	459	38.0	9.9		1.7		Well #2 artesian pressure 8 psi
09	451	37.0	9.8		2.4		
10	483	41.0	10.2	7.0	1.8	0.4	
11	407	35.0	10.3		2.1		
12	521	43.0	9.9		2.3		
13	492	23.0	5.6		1.9		
14	591	38.0	7.7		2.0		
15	290	18.0	7.4		2.2		
16	472	28.0	7.1		2.4		
17	670	37.0	6.6		2.5		
18	497	43.0	10.4	7.1	1.9	0.9	
19	380	28.0	8.8		2.0		
20	391	30.0	9.2		3.0		
21	358	28.0	9.4		3.5		
22	452	34.0	9.0		3.0		
23	580	43.0	8.9		2.8		
24	503	38.0	9.1		3.0		
25	601	46.0	9.2		2.6		
26	586	40.0	8.2		3.3		
27	356	33.0	11.1	7.1	3.5	0.6	
28	557	45.0	9.7		3.0		
29	459	41.0	10.7		2.6		
30	374	41.0	13.1		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 06-03-96
 Isle of Palms-B System: 2 Date: 06-05-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : May, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Robert Dailley, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17825	1931.0	412.0	28.3	84.6	1.9	
AVERAGE	575	62.3	13.3	7.1	2.7	0.5	
MAXIMUM	826	74.0	16.0	7.1	3.5	0.8	
MINIMUM	417	53.0	9.4	7.0	1.0	0.1	
01	436	54.0	14.9		3.0		
02	454	58.0	15.3		3.5		
03	454	56.0	14.8		3.5		
04	826	69.0	10.0		3.5		
05	457	61.0	16.0		2.0		
06	615	67.0	13.1		2.9		
07	487	64.0	15.8	7.1	3.5	0.1	Well #1 artesian pressure 6 psi
08	663	70.0	12.7		1.8		Well #2 artesian pressure 8 psi
09	505	67.0	15.9		2.2		
10	516	67.0	15.6		2.6		
11	573	71.0	14.9		2.1		
12	603	74.0	14.7		2.9		
13	542	61.0	13.5		2.4		
14	517	56.0	13.0		3.0		
15	584	58.0	11.9		3.0	0.5	
16	584	70.0	14.4	7.1	2.7		
17	807	63.0	9.4		2.9		
18	710	65.0	11.0		3.0		
19	559	57.0	12.2		3.1		
20	503	58.0	13.8		2.4		
21	527	57.0	13.0		2.7		
22	629	60.0	11.4		3.5	0.8	
23	621	60.0	11.6	7.0	3.0		
24	728	68.0	11.2		3.2		
25	690	67.0	11.6		1.5		
26	744	64.0	10.3		1.0		
27	589	58.0	11.8		2.2		
28	500	57.0	13.7		2.9		
29	417	53.0	15.2	7.1	2.6	0.5	
30	434	53.0	14.6		2.8		
31	551	68.0	14.8		3.2		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 05-02-96
 Isle of Palms-B System: 2 Date: 05-13-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUM

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida Inc.

REPORTING MONTH : April, 1996

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT : Milton Diveraux, C.O., CERT. NO. C-2850

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14944	1408.0	342.3	28.1	75.2	2.3	
AVERAGE	498	46.9	11.4	7.0	2.5	0.6	
MAXIMUM	700	63.0	14.3	7.1	3.5	0.7	
MINIMUM	370	40.0	8.2	7.0	1.2	0.4	
01	370	40.0	13.0		3.0		
02	422	41.0	11.6		2.4		
03	459	42.0	11.0	7.1	2.7	0.6	
04	499	44.0	10.6		2.5		
05	402	42.0	12.5		2.5		
06	447	41.0	11.0		2.5		
07	505	44.0	10.4		2.5		Well #1 artesian pressure 8 psi
08	419	41.0	11.7		2.7		Well #2 artesian pressure 10 psi
09	436	43.0	11.8	7.0	2.1		
10	451	43.0	11.4		2.6	0.4	
11	562	45.0	9.6		3.5		
12	624	50.0	9.6		3.5		
13	531	46.0	10.4		3.0		
14	480	45.0	11.2		2.6		
15	395	43.0	13.1		1.8		
16	422	43.0	12.2		3.5		
17	463	44.0	11.4		2.7		
18	454	43.0	11.4	7.0	2.1		
19	485	43.0	10.6		2.3	0.6	
20	700	48.0	8.2		2.5		
21	532	50.0	11.3		1.2		
22	547	50.0	11.0		1.8		
23	547	52.0	11.4		2.3		
24	486	58.0	14.3		1.6		
25	578	60.0	12.4		2.5		
26	613	61.0	11.9	7.0	2.1	0.7	
27	695	63.0	10.9		2.5		
28	525	54.0	12.3		1.7		
29	472	45.0	11.4		3.5		
30	423	44.0	12.5		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: Isle of Palms-A System: 4 Date: 04-01-96
 Isle of Palms-B System: 2 Date: 04-02-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida, Inc.

REPORTING MONTH: March, 1996

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robin DeMay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	12116	1234.0	400.6	28.1	72.2	2.1	
AVERAGE	391	39.8	12.9	7.0	2.3	0.5	
MAXIMUM	542	52.0	31.7	7.1	3.5	0.7	
MINIMUM	125	31.0	6.9	7.0	1.0	0.3	
01	361	39.0	13.0	7.1	3.0	0.6	
02	388	42.0	13.0		1.5		
03	440	42.0	11.4		1.9		
04	470	43.0	11.0		2.0		
05	252	37.0	17.6		2.5		
06	329	37.0	13.5		1.6		
07	354	39.0	13.2	7.0	2.2	0.3	
08	410	32.0	9.4		2.8		
09	416	34.0	9.8		2.2		
10	291	44.0	18.1		2.6		
11	456	52.0	13.7		2.0		
12	338	36.0	12.8		2.6		
13	362	36.0	11.9		2.8		
14	416	36.0	10.4		1.7		
15	542	31.0	6.9	7.0	2.0	0.5	
16	477	39.0	9.8		1.0		
17	389	39.0	12.0		1.6		
18	327	37.0	13.6		2.2		
19	361	36.0	12.0		2.8		
20	287	35.0	14.6		2.6		
21	125	33.0	31.7		2.1		
22	458	38.0	9.9		3.5		
23	533	50.0	11.2		1.0		
24	360	44.0	14.7		1.5		
25	403	45.0	13.4		2.7		
26	454	43.0	11.4	7.0	3.5	0.7	
27	437	45.0	12.3		1.9		
28	420	42.0	12.0		3.5		
29	424	42.0	11.9		3.5		
30	418	42.0	12.0		2.8		
31	418	44.0	12.6		2.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: ISLE PALMS-A SYSTEM 4 SAMPLE DATE: 03-04-96
 ISLE PALMS-B SYSTEM 2 SAMPLE DATE: 03-14-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida, Inc.

REPORTING MONTH: February, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robert DeMay, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	14464	1001.0	245.4	28.2	67.8	2.4	
AVERAGE	499	34.5	8.5	7.1	2.3	0.6	
MAXIMUM	678	51.0	14.6	7.1	3.5	0.9	
MINIMUM	320	25.0	5.2	7.0	0.5	0.4	
01	422	35.0	9.9	7.0	2.3	0.9	
02	543	30.0	6.6		2.5		
03	455	32.0	8.4		1.0		
04	405	35.0	10.4		3.0		
05	610	29.0	5.7		1.8		
06	481	30.0	7.5		2.0		
07	436	29.0	8.0	7.0	3.5	0.4	
08	464	30.0	7.8		3.5		
09	579	25.0	5.2		2.3		
10	466	25.0	6.4		1.0		
11	407	30.0	8.8		0.9		
12	479	33.0	8.3		2.7		
13	476	30.0	7.6		3.5		
14	574	31.0	6.5		3.0		
15	379	29.0	9.2		2.1		
16	525	31.0	7.1		3.5		
17	510	31.0	7.3		3.5		
18	543	30.0	6.6		3.5		
19	474	36.0	9.1		0.5		
20	527	37.0	8.4	7.1	2.3	0.4	
21	518	38.0	8.8		1.8		
22	542	39.0	8.6		2.1		
23	585	42.0	8.6		2.0		
24	600	44.0	8.8		1.6		
25	678	51.0	9.0		2.4		
26	451	43.0	11.4		1.5		
27	453	43.0	11.4		2.5		
28	562	44.0	9.4	7.1	3.0	0.7	
29	320	39.0	14.6		2.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

ISLE PALMS-A SYSTEM
ISLE PALMS-B SYSTEM

4 SAMPLE DATE: 02-05-96
2 SAMPLE DATE: 02-08-96

DRINKING WATER TREATMENT PLANT DAILY OPERATION SUMMARY

PWS ID NO. 2160547 CUP NO. 2-031-0165UV

NAME OF DRINKING WATER SYSTEM: MARSH VIEW WTP

LOCATION: 14738 Marsh View Drive

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: United Water Florida, Inc.

REPORTING MONTH: January, 1996

PLANT EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT: Robert Dewley, C.O., CERT. NO. C-4311

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE MG/L		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	MG/L		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	12616	1185.0	355.7	28.3	86.5	1.5	
AVERAGE	407	38.2	11.5	7.1	2.8	0.4	
MAXIMUM	558	55.0	16.9	7.2	3.5	0.5	
MINIMUM	277	30.0	8.0	6.9	1.5	0.3	
01	341	38.0	13.4	6.9	2.6	0.5	
02	456	48.0	12.6		2.5		
03	293	36.0	14.7		3.0		
04	310	37.0	14.3		3.2		
05	501	50.0	12.0		3.0		
06	425	40.0	11.3		3.0		
07	558	55.0	11.8		2.7		
08	490	49.0	12.0		2.0		
09	404	41.0	12.2		3.5		
10	504	44.0	10.5		2.0		
11	375	39.0	12.5	7.2	2.5	0.3	
12	407	41.0	12.1		2.9		
13	412	40.0	11.6		3.5		
14	322	37.0	13.8		2.7		
15	500	41.0	9.8		3.1		
16	382	39.0	12.2		3.0		
17	277	39.0	16.9		2.7		
18	336	34.0	12.1	7.1	2.9	0.4	
19	320	32.0	12.0		3.3		
20	391	40.0	12.3		3.5		
21	323	34.0	12.6		2.5		
22	411	30.0	8.8		2.8		
23	419	33.0	9.4		2.0		
24	393	32.0	9.8		2.0		
25	391	35.0	10.7		3.0		
26	418	35.0	10.0	7.1	3.2	0.3	
27	435	35.0	9.6		3.5		
28	494	33.0	8.0		1.9		
29	417	34.0	9.8		1.5		
30	473	34.0	8.6		3.5		
31	438	30.0	8.2		3.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: ISLE PALMS-A SYSTEM 4 SAMPLE DATE: 01-04-96
 ISLE PALMS-B SYSTEM 2 SAMPLE DATE: 01-08-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULBE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth L. Lloyd, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	315.8	62.0	769.2	172.8	67.0	23.7	
AVERAGE	10.2	2.0	24.8	7.2	2.2	1.1	
MAXIMUM	17.3	2.0	36.4	7.2	7.9	1.6	
MINIMUM	6.6	2.0	13.9	7.2	1.6	0.6	
01	7.8	2.0	30.8		7.9		
02	12.2	2.0	19.7	7.2	1.8	1.0	
03	8.7	2.0	27.6	7.2	1.8	1.0	
04	10.2	2.0	23.5	7.2	1.9	0.8	
05	9.6	2.0	25.0	7.2	1.8	0.7	
06	10.7	2.0	22.4	7.2	2.0	0.9	
07	9.6	2.0	25.0		1.8		
08	6.6	2.0	36.4		2.0		
09	10.7	2.0	22.4	7.2	1.9	1.0	
10	11.8	2.0	20.3	7.2	1.8	0.7	
11	8.0	2.0	30.0	7.2	2.5	0.6	
12	8.2	2.0	29.3	7.2	2.2	1.5	
13	8.2	2.0	29.3	7.2	1.8	1.1	
14	11.1	2.0	21.6	7.2	2.0	1.4	
15	8.2	2.0	29.3	7.2	1.6		
16	11.2	2.0	21.4	7.2	2.1	1.3	
17	8.6	2.0	27.9	7.2	2.2	1.2	
18	6.7	2.0	35.8	7.2	2.3	1.3	
19	11.3	2.0	21.2	7.2	2.2	1.4	
20	13.2	2.0	18.2	7.2	2.0	1.6	
21	12.2	2.0	19.7	7.2	1.8		
22	8.9	2.0	27.0	7.2	1.6		
23	17.3	2.0	13.9	7.2	1.9	1.0	
24	7.8	2.0	30.8		1.8		
25	8.1	2.0	29.6		1.8		
26	11.7	2.0	20.5	7.2	2.0	1.4	
27	7.8	2.0	30.8	7.2	2.1	1.4	
28	14.5	2.0	16.6		2.1		
29	14.2	2.0	16.9		2.2		
30	10.5	2.0	22.9	7.2	2.0	1.2	
31	10.2	2.0	23.5	7.2	2.1	1.2	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: DUKE COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

PEAK FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth A. Snyder, C.O., CERT. NO. C-4016

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	291.5	60.0	785.2	151.2	56.2	22.9	
RANGE	9.7	2.0	26.2	7.2	1.9	1.1	
MINUM	16.3	2.0	42.1	7.2	2.4	1.4	
MINUM	5.7	2.0	14.7	7.2	1.4	0.4	
01	16.3	2.0	14.7	7.2	1.6	0.9	
02	5.7	2.0	42.1		1.8		
03	11.4	2.0	21.1		1.8		
04	12.6	2.0	19.0	7.2	1.8	1.2	
05	10.6	2.0	22.6	7.2	1.6	1.0	
06	6.0	2.0	40.0	7.2	2.0	1.0	
07	14.0	2.0	17.1	7.2	1.4	0.4	
08	10.3	2.0	23.3	7.2	1.7	0.9	
09	9.6	2.0	25.0		1.8		
10	9.9	2.0	24.2		1.6		
11	9.4	2.0	25.5	7.2	1.8	1.1	
12	8.4	2.0	28.6	7.2	1.8	1.2	
13	8.4	2.0	28.6	7.2	1.8	1.1	
14	9.6	2.0	25.0	7.2	1.8	1.0	
15	10.7	2.0	22.4	7.2	2.0	1.1	
16	7.5	2.0	32.0		1.9		
17	10.5	2.0	22.9		2.0		
18	10.7	2.0	22.4	7.2	1.8	1.0	
19	8.5	2.0	28.2	7.2	1.8	1.0	
20	12.0	2.0	20.0	7.2	1.9	1.0	
21	7.5	2.0	32.0	7.2	2.0	1.3	
22	7.9	2.0	30.4	7.2	1.8	1.2	
23	9.9	2.0	24.2		2.4		
24	9.5	2.0	25.3		2.4		
25	9.4	2.0	25.5	7.2	2.0	1.4	
26	7.4	2.0	32.4	7.2	2.1	1.4	
27	5.7	2.0	42.1	7.2	2.0	1.2	
28	9.3	2.0	25.8	7.2	1.9	1.2	
29	10.2	2.0	23.5	7.2	2.0	1.3	
30	12.6	2.0	19.0		1.9		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 11-13-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Kenneth L. Loyal*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	289.9	62.0	820.4	180.0	57.4	28.3	
AVERAGE	9.4	2.0	26.5	7.2	1.9	1.2	
MAXIMUM	12.7	2.0	40.7	7.2	2.2	1.6	
MINIMUM	5.9	2.0	18.9	7.2	1.5	0.8	
01	10.5	2.0	22.9	7.2	1.8	1.2	
02	9.3	2.0	25.8	7.2	1.6	1.1	
03	10.5	2.0	22.9	7.2	1.7	1.2	
04	10.1	2.0	23.8	7.2	1.8	1.2	
05	9.6	2.0	25.0		1.6		
06	9.5	2.0	25.3		1.5		
07	10.8	2.0	22.2	7.2	1.8	1.2	
08	8.2	2.0	29.3	7.2	1.6	1.0	
09	9.1	2.0	26.4	7.2	1.5	0.8	
10	10.0	2.0	24.0	7.2	1.6	0.9	
11	12.7	2.0	18.9	7.2	1.8	1.1	
12	10.2	2.0	23.5		2.0		
13	6.8	2.0	35.3		1.8		
14	10.5	2.0	22.9	7.2	1.5	1.5	
15	7.7	2.0	31.2	7.2	2.2	1.5	
16	8.9	2.0	27.0	7.2	2.0	1.4	
17	12.7	2.0	18.9	7.2	2.1	1.4	
18	8.3	2.0	28.9	7.2	2.0		
19	9.3	2.0	25.8	7.2	2.0		
20	8.1	2.0	29.6	7.2	2.0	1.2	
21	11.0	2.0	21.8	7.2	1.8	1.3	
22	5.9	2.0	40.7	7.2	1.8	1.2	
23	6.6	2.0	36.4	7.2	1.8	1.2	
24	6.6	2.0	36.4	7.2	1.9	1.2	
25	10.0	2.0	24.0	7.2	1.8	1.2	
26	9.6	2.0	25.0		2.2		
27	10.2	2.0	23.5		2.2		
28	9.6	2.0	25.0	7.2	2.2	1.6	
29	9.3	2.0	25.8	7.2	2.0	1.4	
30	9.3	2.0	25.8	7.2	1.8	1.3	
31	9.0	2.0	26.7	7.2	2.0	1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 10-17-96

ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: SAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Kenneth A. Lynch

, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	305.9	60.0	745.0	144.0	54.2	27.1	
AVERAGE	10.2	2.0	24.8	7.2	1.8	1.4	
MAXIMUM	14.4	2.0	52.2	7.2	2.2	1.7	
MINIMUM	4.6	2.0	16.7	7.2	1.5	1.1	
01	10.0	2.0	24.0		1.6		
02	10.4	2.0	23.1		1.6		
03	11.5	2.0	20.9	7.2	1.8	1.3	
04	8.1	2.0	29.6	7.2	1.6	1.2	
05	13.6	2.0	17.6	7.2	2.2	1.6	
06	10.0	2.0	24.0	7.2	2.2	1.7	
07	11.7	2.0	20.5		2.0		
08	10.8	2.0	22.2		1.8		
09	9.3	2.0	25.8	7.2	1.8	1.5	
10	9.7	2.0	24.7	7.2	1.8	1.4	
11	12.6	2.0	19.0	7.2	1.8	1.4	
12	11.6	2.0	20.7	7.2	1.9	1.4	
13	9.4	2.0	25.5	7.2	1.8	1.4	
14	10.7	2.0	22.4		1.8		
15	7.9	2.0	30.4		2.0		
16	13.8	2.0	17.4	7.2	1.6	1.2	
17	10.9	2.0	22.0	7.2	1.8	1.4	
18	6.6	2.0	36.4	7.2	1.8	1.3	
19	14.4	2.0	16.7	7.2	1.6	1.2	
20	4.6	2.0	52.2	7.2	1.8	1.4	
21	8.5	2.0	28.2		1.5		
22	9.9	2.0	24.2		1.8		
23	8.4	2.0	28.6	7.2	1.8	1.4	
24	11.1	2.0	21.6	7.2	1.6	1.1	
25	8.9	2.0	27.0	7.2	1.8	1.3	
26	10.2	2.0	23.5	7.2	1.9	1.3	
27	10.9	2.0	22.0	7.2	2.0	1.3	
28	13.1	2.0	18.3		1.9		
29	7.6	2.0	31.6		1.8		
30	9.7	2.0	24.7	7.2	1.8	1.3	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: DADE COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2365

CERTIFY THIS REPORT IS CORRECT *Kenneth C. Lynch*, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	307.9	62.0	782.2	157.7	56.1	30.4	
AVERAGE	9.9	2.0	25.2	7.2	1.8	1.4	
MINIMUM	14.2	2.0	37.5	7.2	2.0	1.5	
MINIMUM	6.4	2.0	16.9	7.0	1.6	1.0	
01	9.5	2.0	25.3	7.2	1.8	1.5	
02	12.7	2.0	18.9	7.2	1.8	1.4	
03	10.6	2.0	22.6		2.0		
04	8.0	2.0	30.0		2.0		
05	11.4	2.0	21.1		1.9		
06	9.0	2.0	26.7	7.1	2.0	1.5	
07	8.2	2.0	29.3	7.1	2.0	1.5	
08	11.1	2.0	21.6	7.0	1.8	1.3	
09	9.1	2.0	26.4	7.1	1.9	1.4	
10	10.0	2.0	24.0		1.8		
11	13.8	2.0	17.4		1.8		
12	7.4	2.0	32.4	7.1	1.7	1.3	
13	12.0	2.0	20.0	7.2	1.8	1.4	
14	7.8	2.0	30.8	7.2	1.6	1.2	
15	7.9	2.0	30.4	7.2	1.8	1.4	
16	10.1	2.0	23.8	7.2	1.8	1.4	
17	11.2	2.0	21.4		1.7		
18	6.7	2.0	35.8		1.8		
19	14.2	2.0	16.9	7.2	1.9	1.5	
20	7.6	2.0	31.6	7.2	1.8	1.4	
21	9.3	2.0	25.8	7.2	2.0	1.5	
22	11.4	2.0	21.1	7.2	1.9	1.5	
23	9.4	2.0	25.5	7.1	1.9	1.4	
24	9.4	2.0	25.5	7.2	1.8	1.4	
25	9.4	2.0	25.5		1.8		
26	14.2	2.0	16.9	7.2	1.6	1.0	
27	8.7	2.0	27.6	7.2	1.7	1.4	
28	10.2	2.0	23.5	7.2	1.6	1.3	
29	6.4	2.0	37.5	7.2	1.8	1.4	
30	12.6	2.0	19.0	7.2	1.7	1.3	
31	8.6	2.0	27.9		1.6		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 08-06-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth R. Boyd, C.O., CERT. NO. C-4016

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	330.7	62.0	717.7	158.4	52.3	30.0	
AVERAGE	10.7	2.0	23.2	7.2	1.7	1.4	
MINIMUM	14.4	2.0	32.0	7.2	2.0	1.6	
MINIMUM	7.5	2.0	16.7	7.2	1.0	0.8	
01	13.5	2.0	17.8	7.2	2.0	1.4	
02	14.1	2.0	17.0	7.2	2.0	1.6	
03	8.1	2.0	29.6	7.2	1.8	1.4	
04	8.1	2.0	29.6		1.6		
05	12.2	2.0	19.7	7.2	1.8	1.6	
06	9.0	2.0	26.7		1.6		
07	12.6	2.0	19.0		1.4		
08	14.4	2.0	16.7	7.2	1.6	1.4	
09	11.7	2.0	20.5	7.2	1.8	1.5	
10	12.5	2.0	19.2	7.2	1.0	0.8	
11	11.0	2.0	21.8	7.2	1.2	0.9	
12	7.8	2.0	30.8	7.2	1.2	0.9	
13	9.7	2.0	24.7		1.4		
14	9.7	2.0	24.7		1.2		
15	11.1	2.0	21.6	7.2	1.9	1.4	
16	12.0	2.0	20.0	7.2	1.8	1.4	
17	12.9	2.0	18.6	7.2	2.0	1.6	
18	7.5	2.0	32.0	7.2	1.9	1.6	
19	11.7	2.0	20.5	7.2	1.8	1.4	
20	10.3	2.0	23.3		1.8		
21	9.6	2.0	25.0		2.0		
22	9.1	2.0	26.4	7.2	1.8	1.6	
23	9.2	2.0	26.1	7.2	1.9	1.5	
24	10.6	2.0	22.6	7.2	1.9	1.5	
25	10.0	2.0	24.0	7.2	1.9	1.4	
26	11.9	2.0	20.2	7.2	1.7	1.0	
27	9.2	2.0	26.1		1.5		
28	9.7	2.0	24.7		1.6		
29	10.6	2.0	22.6	7.2	1.8	1.5	
30	10.1	2.0	23.8	7.2	1.8	1.4	
31	10.8	2.0	22.2	7.2	1.6	1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 07-15-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Kenneth R. Singh*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	361.1	60.0	614.6	165.8	52.8	28.4	
AVERAGE	12.0	2.0	20.5	7.2	1.8	1.3	
MAXIMUM	16.2	2.0	28.9	7.3	2.2	2.0	
MINIMUM	8.3	2.0	14.8	7.2	1.0	0.6	
01	11.1	2.0	21.6	7.2	1.8	1.5	
02	12.3	2.0	19.5	7.2	1.8	1.4	
03	16.2	2.0	14.8	7.2	2.2	2.0	
04	13.5	2.0	17.8	7.2	2.1	1.8	
05	9.3	2.0	25.8	7.2	2.1	1.6	
06	9.9	2.0	24.2	7.2	2.0	1.6	
07	14.9	2.0	16.1	7.2	2.0	1.7	
08	9.4	2.0	25.5		1.6		
09	14.1	2.0	17.0		1.6		
10	9.1	2.0	26.4	7.2	1.8	1.5	
11	13.2	2.0	18.2	7.2	1.2	0.7	
12	11.7	2.0	20.5	7.2	1.5	0.9	
13	11.0	2.0	21.8	7.2	1.6	1.0	
14	11.7	2.0	20.5	7.2	1.8	1.1	
15	11.4	2.0	21.1		1.6		
16	13.0	2.0	18.5		1.6		
17	13.1	2.0	18.3	7.3	1.8	1.2	
18	13.1	2.0	18.3	7.2	1.8	1.1	
19	13.0	2.0	18.5	7.2	1.8	1.2	
20	9.4	2.0	25.5	7.2	1.8	1.3	
21	11.8	2.0	20.3	7.2	1.0	0.6	
22	12.9	2.0	18.6		1.2		
23	10.4	2.0	23.1		1.6		
24	16.2	2.0	14.8	7.2	1.5	0.8	
25	8.3	2.0	28.9	7.2	2.1	1.4	
26	13.0	2.0	18.5	7.2	2.0	1.4	
27	10.5	2.0	22.9	7.2	2.0	1.4	
28	12.2	2.0	19.7	7.2	1.9	1.2	
29	12.0	2.0	20.0	7.3	2.0		
30	13.4	2.0	17.9		2.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454135 C.U.P. NO.
 LOCATION: 50 BOBBY MOORE CIRCLE
 OPERATED BY: UNITED WATER FLORIDA INC.
 INFLUENT pH: 7.2(AVG)
 INFLUENT FLOW: _____

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
 WATER TREATMENT PLANT
 YULEE, FL ; NASSAU COUNTY
 REPORTING MONTH: May 1996
 NO. OF SERVICES AT END OF MONTH: _____
 MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth E. Long, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	447.5	62.0	541.4	171.9	61.7	37.5	
AVERAGE	14.4	2.0	17.5	7.2	2.0	1.6	
MINIMUM	19.6	2.0	30.4	7.2	2.2	1.8	
MINIMUM	7.9	2.0	12.2	7.0	1.5	1.0	
01	17.4	2.0	13.8	7.0	2.0	1.5	
02	16.5	2.0	14.5	7.0	2.1	1.6	
03	11.1	2.0	21.6	7.1	1.8	1.4	
04	13.5	2.0	17.8	7.1	1.8	1.4	
05	19.0	2.0	12.6	7.1	1.8	1.4	
06	18.0	2.0	13.3	7.1	1.9	1.4	
07	19.1	2.0	12.6	7.2	1.5	1.0	
08	11.4	2.0	21.1	7.1	2.2	1.8	
09	14.6	2.0	16.4	7.2	2.2	1.7	
10	19.6	2.0	12.2	7.2	1.9	1.3	
11	13.4	2.0	17.9		1.8		
12	13.8	2.0	17.4		1.8		
13	16.5	2.0	14.5	7.2	2.2	1.6	
14	12.3	2.0	19.5	7.2	2.2	1.6	
15	13.7	2.0	17.5	7.2	2.0	1.6	
16	13.8	2.0	17.4	7.2	2.0	1.6	
17	12.3	2.0	19.5	7.2	2.2	1.7	
18	14.0	2.0	17.1		2.0		
19	17.0	2.0	14.1		1.8		
20	19.1	2.0	12.6	7.2	2.2	1.8	
21	13.5	2.0	17.8	7.2	2.0	1.7	
22	17.6	2.0	13.6	7.2	2.1	1.8	
23	7.9	2.0	30.4	7.2	2.1	1.8	
24	16.0	2.0	15.0	7.2	2.0	1.5	
25	12.1	2.0	19.8		2.2		
26	9.1	2.0	26.4		1.8		
27	16.9	2.0	14.2		2.0		
28	13.1	2.0	18.3	7.2	2.0	1.6	
29	9.9	2.0	24.2	7.2	2.1	1.6	
30	12.2	2.0	19.7	7.2	2.0	1.6	
31	13.1	2.0	18.3	7.2	2.0	1.5	

PWS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULBEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.0(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth L. Lynch*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	426.9	60.0	522.1	91.0	52.0	18.4	
AVERAGE	14.2	2.0	17.4	7.0	1.7	1.4	
MAXIMUM	20.5	2.0	24.2	7.0	1.9	1.6	
MINIMUM	9.9	2.0	11.7	7.0	1.0	1.2	
01	12.4	2.0	19.4	7.0	1.8	1.2	
02	16.7	2.0	14.4		1.1		
03	11.2	2.0	21.4		1.5		
04	12.9	2.0	18.6	7.0	1.8	1.3	
05	15.1	2.0	15.9		1.8		
06	14.0	2.0	17.1		1.8		
07	14.3	2.0	16.8		1.5		
08	20.5	2.0	11.7		1.0		
09	11.4	2.0	21.1	7.0	1.8	1.3	
10	12.6	2.0	19.0		1.9		
11	14.0	2.0	17.1		1.9		
12	9.9	2.0	24.2		1.7		
13	14.1	2.0	17.0		1.8		
14	15.0	2.0	16.0		1.6		
15	16.8	2.0	14.3	7.0	1.8	1.4	
16	10.5	2.0	22.9		1.8		
17	16.4	2.0	14.6		1.9		
18	10.0	2.0	24.0		1.8		
19	15.2	2.0	15.8	7.0	1.8	1.4	
20	15.0	2.0	16.0		1.8		
21	14.3	2.0	16.8		1.9		
22	20.0	2.0	12.0		1.9		
23	15.0	2.0	16.0	7.0	1.8	1.6	
24	15.2	2.0	15.8	7.0	1.8	1.5	
25	10.7	2.0	22.4	7.0	1.8	1.4	
26	14.2	2.0	16.9	7.0	1.6	1.4	
27	14.7	2.0	16.3	7.0	1.9	1.6	
28	13.7	2.0	17.5	7.0	1.8	1.6	
29	16.7	2.0	14.4	7.0	1.8	1.4	
30	14.4	2.0	16.7	7.0	1.8	1.3	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: DADE COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULBEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

EFFLUENT pH: (AVG)

NO. OF SERVICES AT END OF MONTH: _____

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Kenneth K. Snyder

, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	403.6	62.0	583.8		52.4	6.2	
AVERAGE	13.0	2.0	18.8		1.7	1.2	
MINIMUM	18.1	2.0	25.3		1.9	1.5	
MINIMUM	9.5	2.0	13.3		1.5	1.1	
01	10.4	2.0	23.1		1.7	1.2	
02	11.8	2.0	20.3		1.5		
03	11.4	2.0	21.1		1.5		
04	12.6	2.0	19.0		1.8		
05	10.5	2.0	22.9		1.6		
06	11.7	2.0	20.5		1.6	1.2	
07	12.2	2.0	19.7		1.6		
08	13.7	2.0	17.5		1.8		
09	15.5	2.0	15.5		1.8		
10	12.9	2.0	18.6		1.6		
11	14.4	2.0	16.7		1.8	1.5	
12	12.0	2.0	20.0		1.8		
13	11.5	2.0	20.9		1.8		
14	12.1	2.0	19.8		1.7		
15	14.4	2.0	16.7		1.8		
16	12.6	2.0	19.0		1.6		
17	11.7	2.0	20.5		1.6		
18	12.5	2.0	19.2		1.6	1.2	
19	13.9	2.0	17.3		1.8		
20	16.3	2.0	14.7		1.8		
21	10.9	2.0	22.0		1.6		
22	9.5	2.0	25.3		1.7		
23	16.0	2.0	15.0		1.7		
24	13.2	2.0	18.2		1.8		
25	18.1	2.0	13.3		1.6	1.1	
26	12.3	2.0	19.5		1.9		
27	11.7	2.0	20.5		1.8		
28	16.0	2.0	15.0		1.6		
29	12.7	2.0	18.9		1.6		
30	13.5	2.0	17.8		1.8		
31	15.6	2.0	15.4		1.5		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 03-05-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYS: NASSAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.0(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth C. Boyd*, C.O., CBRT. NO. C-4816

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	350.7	58.0	602.6	56.2	52.2	8.7	
AVERAGE	12.1	2.0	20.8	7.0	1.8	1.1	
MAXIMUM	20.1	2.0	35.8	7.2	2.1	1.5	
MINIMUM	6.7	2.0	11.9	7.0	1.4	0.8	
01	11.0	2.0	21.8	7.0	2.0	1.4	
02	11.1	2.0	21.6		1.9		
03	11.9	2.0	20.2		2.0		
04	18.9	2.0	12.7		2.0		
05	20.1	2.0	11.9	7.0	2.1	1.5	
06	11.7	2.0	20.5		2.0		
07	11.4	2.0	21.1		1.8		
08	10.3	2.0	23.3	7.2	1.4	0.8	
09	11.8	2.0	20.3		1.9		
10	13.2	2.0	18.2		1.8		
11	12.9	2.0	18.6		1.8		
12	9.5	2.0	25.3	7.0	1.9	1.2	
13	15.7	2.0	15.3		1.9		
14	9.5	2.0	25.3		2.0		
15	9.3	2.0	25.8		1.8		
16	13.7	2.0	17.5	7.0	1.8	1.0	
17	14.1	2.0	17.0		1.6		
18	10.0	2.0	24.0		1.5		
19	10.8	2.0	22.2		1.6		
20	13.3	2.0	18.0	7.0	1.8	1.0	
21	10.2	2.0	23.5		1.8		
22	11.3	2.0	21.2		1.8		
23	6.7	2.0	35.8	7.0	1.6	0.8	
24	11.7	2.0	20.5		1.8		
25	14.7	2.0	16.3		1.9		
26	12.3	2.0	19.5	7.0	1.7	1.0	
27	9.6	2.0	25.0		1.8		
28	11.6	2.0	20.7		1.6		
29	12.4	2.0	19.4		1.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454135 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: SAU COUNTY DETENTION FACILITY
WATER TREATMENT PLANT

LOCATION: 50 BOBBY MOORE CIRCLE

YULEE, FL ; HASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth A. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	447.9	62.0	552.8	35.4	63.8	6.2	
AVERAGE	14.4	2.0	17.8	7.1	2.1	1.2	
MAXIMUM	23.3	2.0	27.0	7.2	2.2	1.5	
MINIMUM	8.9	2.0	10.3	7.0	1.2	0.8	
01	14.4	2.0	16.7		2.1		
02	15.6	2.0	15.4	7.2	2.2	1.4	
03	13.2	2.0	18.2		2.1		
04	12.1	2.0	19.8		2.2		
05	18.8	2.0	12.8		2.2		
06	15.1	2.0	15.9		2.2		
07	9.5	2.0	25.3		2.2		
08	23.3	2.0	10.3		2.2		
09	19.1	2.0	12.6	7.0	2.0	1.5	
10	22.8	2.0	10.5		2.1		
11	15.2	2.0	15.8		2.2		
12	17.9	2.0	13.4		2.2		
13	15.0	2.0	16.0		2.2		
14	16.5	2.0	14.5		2.2		
15	17.7	2.0	13.6	7.1	2.2	1.4	
16	14.0	2.0	17.1		2.1		
17	16.9	2.0	14.2		2.1		
18	8.9	2.0	27.0		2.2		
19	20.1	2.0	11.9		2.2		
20	9.9	2.0	24.2		1.2		
21	11.2	2.0	21.4		1.4		
22	17.4	2.0	13.8	7.0	1.6	0.8	
23	9.8	2.0	24.5		1.6		
24	13.8	2.0	17.4		2.2		
25	10.0	2.0	24.0		2.2		
26	13.0	2.0	18.5		2.2		
27	12.3	2.0	19.5		2.2		
28	11.9	2.0	20.2		2.0		
29	13.5	2.0	17.8	7.1	2.1	1.1	
30	9.9	2.0	24.2		2.0		
31	9.1	2.0	26.4		2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 01-09-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S_ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

SIGNATURE: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellasont-Udstein, C.O., CERT. NO. C-3211

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3598.0	134	140.5	148.0	63.7	19.4	
AVERAGE	116.1	4	4.5	7.4	2.1	1.0	
MINIMUM	169.0	6	6.7	7.5	2.2	1.2	
MINIMUM	77.0	3	3.0	7.3	1.8	0.8	
01	95.0	4	5.1		2.0		
02	121.0	5	5.0	7.4	2.2	0.9	
03	101.0	4	4.8	7.4	2.2	1.1	
04	126.0	6	5.7	7.5	2.0	1.0	
05	113.0	5	5.3	7.4	2.2	0.8	
06	87.0	4	5.5	7.4	2.2	1.0	
07	107.0	6	6.7		2.0		
08	95.0	3	3.8		2.2		
09	106.0	4	4.5	7.4	2.0	1.0	
10	115.0	4	4.2	7.4	2.0	0.9	
11	106.0	3	3.4	7.4	1.9	0.9	
12	116.0	4	4.1	7.3	1.9	1.0	
13	121.0	3	3.0	7.4	2.0	1.0	
14	102.0	4	4.7		1.8		
15	125.0	5	4.8		2.0		
16	77.0	3	4.7	7.4	2.0	0.9	
17	117.0	3	3.1	7.4	1.9	0.9	
18	114.0	4	4.2	7.4	2.2	1.0	
19	160.0	5	3.8	7.4	2.2	1.1	
20	125.0	4	3.8	7.4	2.2	1.0	
21	132.0	5	4.5		2.0		
22	160.0	5	3.8		2.2		
23	94.0	5	6.4	7.4	2.0	0.9	
24	145.0	5	4.1		2.0		
25	138.0	5	4.3		2.0		
26	120.0	5	5.0	7.4	2.2	1.2	
27	95.0	4	5.1	7.4	2.0	0.9	
28	109.0	4	4.4		2.0		
29	80.0	3	4.5		2.0		
30	169.0	5	3.6	7.4	2.2	1.0	
31	127.0	5	4.7	7.4	2.0	0.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160852 C.U.P. NO. 2-031-0025UP

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellen T. Valente, C.O., CERT. NO. C-3211

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3320.0	120	131.6	140.8	60.9	18.3	
AVERAGE	110.7	4	4.4	7.4	2.0	0.9	
MAXIMUM	149.0	6	8.2	7.5	2.2	1.1	
MINIMUM	73.0	3	3.2	7.4	1.8	0.0	
01	89.0	4	5.4	7.4	2.0	1.0	
02	109.0	5	5.5		1.9		
03	135.0	5	4.4		1.9		
04	125.0	4	3.8	7.4	2.0	1.1	
05	114.0	3	3.2	7.4	2.0	1.1	
06	107.0	3	3.4	7.4	2.0	1.0	
07	95.0	3	3.8	7.5	2.0	0.9	
08	107.0	4	4.5	7.4	2.2	1.0	
09	131.0	5	4.6		2.0		
10	132.0	5	4.5		2.0		
11	87.0	3	4.1	7.4	1.8	0.9	
12	101.0	4	4.8	7.4	2.2	0.9	
13	107.0	4	4.5	7.4	2.2	1.1	
14	102.0	4	4.7	7.4	2.0	1.0	
15	73.0	5	8.2	7.4	2.1	0.9	
16	145.0	6	5.0		2.0		
17	88.0	3	4.1		2.1		
18	117.0	4	4.1	7.4	1.9	1.0	
19	101.0	4	4.8	7.5	2.0	0.9	
20	149.0	5	4.0	7.4	2.2	1.1	
21	88.0	3	4.1	7.4	2.2	0.9	
22	93.0	3	3.9	7.4	2.0	0.9	
23	116.0	4	4.1		2.2		
24	146.0	4	3.3		2.2		
25	102.0	3	3.5	7.4	2.0	0.8	
26	108.0	4	4.4	7.4	1.8	0.9	
27	117.0	4	4.1	7.4	2.0	0.9	
28	122.0	5	4.9		2.1		
29	107.0	4	4.5		1.9		
30	107.0	3	3.4		2.0	0.0	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 11-11-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2160852 C.U.P. NO. 2-031-0025UP

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Ellen T. Valentin

, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3543.0	122	127.7	170.3	64.6	22.9	
AVERAGE	114.3	4	4.1	7.4	2.1	1.0	
MAXIMUM	153.0	7	5.9	7.5	2.2	1.2	
MINIMUM	73.0	3	2.8	7.3	1.8	0.8	
01	128.0	3	2.8	7.4	2.0	1.0	
02	94.0	3	3.8	7.4	1.8	0.8	
03	114.0	4	4.2	7.4	1.9	0.9	
04	73.0	3	4.9	7.4	2.0	0.8	
05	130.0	6	5.5		2.0		
06	116.0	4	4.1		2.0		
07	116.0	4	4.1	7.5	2.2	1.2	
08	101.0	3	3.6	7.4	2.0	1.0	
09	116.0	4	4.1	7.4	2.2	1.0	
10	116.0	4	4.1	7.4	2.1	1.0	
11	137.0	5	4.4	7.4	2.0	0.9	
12	122.0	6	5.9		2.0		
13	124.0	5	4.8		2.2		
14	81.0	3	4.4	7.4	2.0	1.1	
15	117.0	3	3.1	7.4	2.0	1.0	
16	108.0	3	3.3	7.4	2.2	0.9	
17	98.0	3	3.7	7.4	2.2	1.1	
18	143.0	4	3.4	7.4	2.2	1.0	
19	117.0	3	3.1		2.2		
20	110.0	3	3.3		2.2		
21	96.0	3	3.8	7.4	2.0	1.0	
22	122.0	4	3.9	7.5	2.0	1.1	
23	108.0	3	3.3	7.4	2.2	1.0	
24	107.0	3	3.4	7.4	2.2	1.0	
25	116.0	4	4.1	7.4	2.2	1.1	
26	116.0	4	4.1		2.1		
27	153.0	7	5.5		2.2		
28	133.0	5	4.5	7.3	1.8	1.0	
29	101.0	4	4.8	7.4	2.2	0.9	
30	96.0	4	5.0	7.4	2.1	1.0	
31	134.0	5	4.5	7.4	2.2	1.1	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2150852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: WEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellavon T. Ullrich, C.O., CERT. NO. C-3211

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3566.0	126	127.1	147.9	57.4	19.2	
AVERAGE	118.9	4	4.2	7.4	1.9	1.0	
MAXIMUM	201.0	8	7.6	7.5	2.2	1.5	
MINIMUM	81.0	2	2.1	7.3	1.7	0.6	
01	152.0	7	5.5		1.8		
02	95.0	3	3.8		1.8		
03	117.0	2	2.1	7.4	1.7	0.9	
04	115.0	3	3.1	7.4	1.9	0.6	
05	126.0	4	3.8	7.3	1.9	0.8	
06	111.0	4	4.3	7.4	2.0	0.7	
07	120.0	4	4.0		1.8		
08	135.0	4	3.6		1.9		
09	143.0	5	4.2	7.4	1.9	1.0	
10	114.0	4	4.2	7.4	1.9	1.0	
11	108.0	4	4.4	7.4	1.7	1.5	
12	127.0	4	3.8	7.4	1.7	1.1	
13	115.0	3	3.1	7.5	2.1	1.0	
14	125.0	3	2.9		1.9		
15	108.0	4	4.4		1.8		
16	111.0	4	4.3	7.3	2.0	0.9	
17	121.0	4	4.0	7.4	2.1	0.9	
18	129.0	4	3.7	7.4	2.0	1.0	
19	101.0	4	4.8	7.4	1.9	1.1	
20	95.0	4	5.1	7.4	1.9	1.1	
21	131.0	4	3.7		2.2		
22	143.0	6	5.0		1.8		
23	103.0	4	4.7	7.4	2.0	0.8	
24	116.0	5	5.2	7.4	2.0	0.9	
25	108.0	5	5.6	7.4	1.9	0.8	
26	126.0	8	7.6	7.4	2.1	1.1	
27	102.0	3	3.5	7.4	2.0	0.9	
28	201.0	7	4.2		1.8		
29	87.0	3	4.1		2.0		
30	81.0	3	4.4	7.4	1.9	1.1	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 09-11-96

WS ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: JGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

ISSUED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: AUGUST 1996

LAST EFFLUENT PH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Ellsworth T. Veltch*, C.O., CERT. NO. C-3211

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALLS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALLS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
01	106.0	3	7.4	2.0	0.8
02	132.0	5	7.4	2.0	0.9
03	125.0	4	3.8	2.0	
04	134.0	4	3.6	1.7	
05	118.0	3	3.1	2.0	0.8
06	120.0	4	4.0	2.0	0.9
07	126.0	5	4.8	2.1	0.7
08	122.0	5	4.9	2.1	0.9
09	124.0	4	3.9	2.1	0.9
10	124.0	4	3.9	2.0	
11	97.0	3	3.7	1.9	
12	117.0	3	3.1	1.6	0.6
13	121.0	3	3.0	2.1	0.8
14	114.0	4	4.2	1.7	0.8
15	97.0	4	4.9	2.1	0.9
16	137.0	10	8.8	2.1	0.9
17	112.0	7	7.5	1.5	
18	112.0	5	5.4	2.0	
19	130.0	4	3.7	1.8	0.7
20	133.0	4	3.9	2.0	0.7
21	115.0	4	4.2	1.7	0.8
22	108.0	4	4.4	2.0	0.8
23	157.0	5	3.8	2.1	0.9
24	125.0	4	3.8	2.0	
25	120.0	3	3.0	2.0	
26	114.0	3	3.2	1.8	0.8
27	119.0	3	3.0	1.6	0.8
28	109.0	3	3.3	1.7	0.7
29	108.0	4	4.4	1.8	0.7
30	107.0	5	5.6	1.7	0.9
31	115.0	8	8.3	1.6	
AVERAGE	119.0	4	4.4	1.9	0.8
MINIMUM	97.0	3	3.0	1.5	0.6
TOTAL	3688.0	134	135.1	58.8	17.7

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160852 C.U.P. NO. 2-031-0025UF NAME OF DRINKING WATER SYSTEM: CATEGA HILLS WATER TREATMENT PLANT
 LOCATION: 5033 GREENWAY DRIVE JACKSONVILLE, FLA., DUVAL COUNTY
 OPERATED BY: UNITED WATER FLORIDA INC. REPORTING MONTH: July 1996
 EFFLUENT pH: 7.4(AVG) NO. OF SERVICES AT END OF MONTH: _____
 SIGNATURE: _____ MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Ellasan T. Uchati, C.O., CERT. NO. C-3211

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	4010.0	135	125.1	162.4	59.9	18.2	
BRIDGE	129.4	4	4.0	7.4	1.9	0.8	
CINUM	197.0	6	5.3	7.4	2.0	1.0	
CINUM	100.0	3	2.9	7.3	1.8	0.7	
01	118.0	3	3.1	7.4	1.8	0.7	
02	138.0	4	3.5	7.4	2.0	0.8	
03	102.0	3	3.5	7.3	2.0	0.7	
04	127.0	4	3.8		2.0		
05	110.0	4	4.4	7.4	2.0	0.9	
06	133.0	5	4.5		1.9		
07	114.0	4	4.2		2.0		
08	109.0	4	4.4	7.4	1.8	0.9	
09	118.0	4	4.1	7.3	1.9	1.0	
10	124.0	4	3.9	7.4	2.0	1.0	
11	149.0	6	4.8	7.4	2.0	0.9	
12	118.0	5	5.1	7.4	2.0	0.9	
13	119.0	5	5.0		1.8		
14	135.0	5	4.4		1.8		
15	126.0	5	4.8	7.4	2.0	0.8	
16	112.0	3	3.2	7.4	1.9	0.8	
17	126.0	3	2.9	7.4	1.9	0.7	
18	138.0	4	3.5	7.4	2.0	0.9	
19	197.0	5	3.0	7.3	1.8	0.8	
20	150.0	5	4.0		2.0		
21	100.0	3	3.6		2.0		
22	142.0	4	3.4	7.4	1.9	0.8	
23	135.0	5	4.4	7.4	1.9	0.8	
24	132.0	5	4.5	7.4	1.8	0.7	
25	124.0	4	3.9	7.3	2.0	0.7	
26	127.0	5	4.7	7.4	2.0	0.8	
27	135.0	6	5.3		1.9		
28	165.0	6	4.4		1.8		
29	116.0	3	3.1	7.4	2.0	0.8	
30	153.0	6	4.7	7.4	2.0	0.9	
31	118.0	3	3.1	7.4	2.0	0.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: HGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellenart Urtina, C.O., CERT. NO. C-3211

File copy

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3800.0	132	127.2	147.5	53.2	15.1	
AVERAGE	126.7	4	4.2	7.4	1.8	0.8	
WIMUK	165.0	6	7.6	7.4	2.0	0.9	
HIMUK	94.0	3	2.9	7.3	1.5	0.6	
01	165.0	4	2.9		1.6		
02	155.0	5	3.9		1.6		
03	107.0	4	4.5	7.4	1.8	0.6	
04	137.0	4	3.5	7.4	1.6	0.8	
05	160.0	6	4.5	7.3	1.7	0.6	
06	139.0	5	4.3	7.4	1.7	0.6	
07	103.0	5	5.8	7.4	1.5	0.7	
08	140.0	4	3.4		1.7		
09	119.0	4	4.0		1.7		
10	118.0	4	4.1	7.4	1.7	0.9	
11	135.0	4	3.6	7.4	1.9	0.9	
12	119.0	4	4.0	7.3	1.6	0.8	
13	138.0	4	3.5	7.4	1.8	0.7	
14	118.0	4	4.1	7.4	1.6	0.8	
15	97.0	4	4.9		1.8		
16	137.0	4	3.5		1.7		
17	110.0	3	3.3	7.4	1.9	0.7	
18	136.0	5	4.4	7.3	1.8	0.8	
19	122.0	5	4.9	7.4	1.7	0.8	
20	94.0	5	6.4	7.4	1.9	0.7	
21	144.0	5	4.2	7.4	1.8	0.6	
22	138.0	6	5.2		1.6		
23	117.0	4	4.1		1.8		
24	112.0	3	3.2	7.4	1.9	0.8	
25	110.0	3	3.3	7.4	2.0	0.7	
26	132.0	4	3.6	7.3	2.0	0.9	
27	120.0	4	4.0	7.3	2.0	0.8	
28	144.0	5	4.2	7.4	2.0	0.9	
29	139.0	5	4.3		2.0		
30	95.0	6	7.6		1.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160852 C.U.P. NO. 2-031-00250F

NAME OF DRINKING WATER SYSTEM: WILHELM HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

HIGH FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Ellen T. Valeri

, C.O., CERT. NO. C-3211

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	4225.0	151	135.8	183.8	56.0	17.1	
BRIDGE	136.3	5	4.4	7.4	1.8	0.8	
MINUM	195.0	10	9.7	7.4	2.0	0.9	
MINUM	80.0	3	2.5	7.3	1.6	0.6	
01	124.0	10	9.7	7.4	2.0	0.7	
02	105.0	5	5.7	7.4	1.6	0.8	
03	153.0	6	4.7	7.3	2.0	0.8	
04	136.0	5	4.4	7.3	2.0		
05	122.0	3	3.0	7.3	1.8		
06	133.0	5	4.5	7.4	1.8	0.7	
07	101.0	4	4.8	7.3	1.7	0.9	
08	152.0	5	3.9	7.4	1.9	0.9	
09	120.0	4	4.0	7.4	1.6	0.6	
10	118.0	3	3.1	7.3	2.0	0.7	
11	145.0	4	3.3	7.4	1.8		
12	149.0	5	4.0		2.0		
13	134.0	5	4.5	7.4	1.8	0.6	
14	121.0	5	5.0	7.4	1.7	0.8	
15	166.0	7	5.1	7.3	1.7	0.8	
16	153.0	6	4.7	7.3	1.8	0.6	
17	109.0	5	5.5	7.3	2.0	0.8	
18	132.0	5	4.5		1.8		
19	195.0	6	3.7		1.7		
20	122.0	4	3.9	7.4	1.9	0.8	
21	118.0	5	5.1	7.4	1.7	0.9	
22	121.0	6	6.0	7.3	1.7	0.8	
23	161.0	6	4.5	7.4	2.0	0.9	
24	190.0	4	2.5	7.4	1.7	0.9	
25	146.0	4	3.3		1.8		
26	151.0	4	3.2		1.6		
27	124.0	3	2.9		1.8		
28	127.0	3	2.8	7.3	1.8	0.7	
29	126.0	4	3.8	7.4	2.0	0.9	
30	80.0	4	6.0	7.3	1.6	0.7	
31	191.0	6	3.8	7.3	1.7	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 05-01-96

PWS ID NO. 2160852 C.U.P. NO. 2-031-0025U

NAME OF DRINKING WATER SYSTEM: ARTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ellsworth T. Valentin, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3665.0	125	123.5	103.3	56.1	11.1	
AVERAGE	122.2	4	4.1	7.4	1.9	0.8	
MAXIMUM	167.0	6	5.5	7.4	2.2	1.4	
MINIMUM	88.0	3	2.7	7.3	1.6	0.6	
01	118.0	4	4.1	7.3	1.8	0.8	
02	103.0	3	3.5		1.8		
03	118.0	3	3.1	7.4	2.0	1.0	
04	152.0	4	3.2		2.0		
05	124.0	4	3.9		1.8		
06	122.0	5	4.9		1.8		
07	116.0	4	4.1		1.8		
08	98.0	3	3.7	7.4	2.2	0.6	
09	115.0	4	4.2		2.0		
10	116.0	4	4.1	7.4	2.0	0.8	
11	107.0	4	4.5		1.9		
12	110.0	5	5.5	7.3	2.0	0.8	
13	129.0	5	4.7		2.2		
14	167.0	6	4.3		2.2		
15	118.0	5	5.1	7.4	1.8	0.7	
16	109.0	4	4.4		1.9		
17	102.0	4	4.7	7.4	1.9	0.7	
18	154.0	6	4.7		1.8		
19	88.0	4	5.5	7.4	2.0	0.8	
20	156.0	4	3.1		1.8		
21	122.0	3	3.0		1.8		
22	133.0	3	2.7	7.4	1.7	0.7	
23	124.0	3	2.9		1.7		
24	124.0	4	3.9	7.4	1.6	0.6	
25	108.0	3	3.3		1.9		
26	161.0	6	4.5	7.3	1.7	0.9	
27	150.0	6	4.8		1.6		
28	107.0	3	3.4	7.4	1.8	0.7	
29	119.0	5	5.0	7.4	1.6	0.6	
30	95.0	4	5.1	7.4	2.0	1.4	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-03-96

ID NO. 2160652 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: GA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

INFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Ellison T. Valentin, C.O., CERT. NO. C-3211

S TAP	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
TOTAL	3731.0	137	136.7	80.6	56.4	10.3	
RANGE	120.4	4	4.4	7.3	1.8	0.9	
MIN	162.0	6	6.2	7.4	2.0	1.2	
MAX	78.0	2	3.0	7.2	1.5	0.7	
01	143.0	4	3.4	7.2	1.9	1.2	
02	122.0	3	3.0		1.8		
03	93.0	3	3.9		1.5		
04	119.0	4	4.0	7.4	1.7	1.1	
05	117.0	6	6.2		2.0		
06	112.0	5	5.4		1.8		
07	115.0	5	5.2		1.8		
08	159.0	6	4.5	7.3	1.8	1.0	
09	118.0	5	5.1		1.9		
10	105.0	4	4.6		2.0		
11	110.0	4	4.4		1.9		
12	117.0	4	4.1	7.3	1.7	1.0	
13	131.0	5	4.6	7.4	1.7	0.9	
14	102.0	4	4.7		1.8		
15	136.0	5	4.4	7.3	1.7	0.9	
16	136.0	5	4.4		1.7		
17	162.0	5	3.7		2.0		
18	118.0	3	3.1	7.3	1.8	0.9	
19	104.0	3	3.5		1.9		
20	132.0	4	3.6	7.3	1.8	1.0	
21	114.0	4	4.2		2.0		
22	110.0	5	5.5		1.8		
23	111.0	4	4.3		1.8		
24	135.0	5	4.4		2.0		
25	124.0	5	4.8	7.3	1.7	0.7	
26	117.0	5	5.1		2.0		
27	103.0	5	5.8	7.4	1.7	0.8	
28	112.0	4	4.3		1.7		
29	152.0	6	4.7	7.4	2.0	0.8	
30	124.0	5	4.8		1.8		
31	78.0	2	3.1		1.7		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 03-05-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: ORTEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ellen T. Valentin, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3697.0	125	117.3	78.9	54.3	11.4	
AVERAGE	127.5	4	4.0	7.2	1.9	1.0	
MAXIMUM	162.0	6	5.5	7.2	2.2	1.2	
MINIMUM	101.0	2	2.4	7.1	1.5	0.9	
01	116.0	4	4.1	7.2	1.6	1.0	
02	162.0	6	4.4		1.9		
03	142.0	5	4.2		1.8		
04	122.0	3	3.0		1.8		
05	146.0	5	4.1	7.2	1.5	0.9	
06	142.0	5	4.2		1.9		
07	136.0	5	4.4	7.1	2.0	1.1	
08	114.0	5	5.3		2.0		
09	159.0	6	4.5	7.2	2.0	1.2	
10	117.0	4	4.1		2.0		
11	146.0	6	4.9		1.8		
12	104.0	4	4.6		2.1		
13	110.0	4	4.4	7.2	2.0	1.0	
14	123.0	3	2.9	7.2	1.5	1.1	
15	121.0	3	3.0		1.6		
16	117.0	4	4.1	7.2	1.6	0.9	
17	139.0	4	3.5		2.0		
18	132.0	4	3.6		2.0		
19	141.0	4	3.4	7.1	2.0	1.2	
20	124.0	5	4.8		2.0		
21	110.0	4	4.4		2.2		
22	135.0	5	4.4	7.1	2.0	1.0	
23	110.0	5	5.5		2.0		
24	140.0	5	4.3		2.0		
25	127.0	4	3.8		1.8		
26	116.0	4	4.1	7.2	2.0	1.0	
27	132.0	4	3.6		1.7		
28	113.0	3	3.2	7.2	1.7	1.0	
29	101.0	2	2.4		1.8		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 02-21-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2160852 C.U.P. NO. 2-031-0025UF

NAME OF DRINKING WATER SYSTEM: MEGA HILLS WATER TREATMENT PLANT

LOCATION: 5033 GREENWAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Ellawan T. Valentin, C.O., CERT. NO. C-3211

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	3783.0	114	112.7	78.9	56.9	10.9	
AVERAGE	122.0	4	3.6	7.2	1.8	1.0	
MAXIMUM	154.0	5	5.0	7.2	2.0	1.2	
MINIMUM	106.0	3	2.4	7.1	1.6	0.8	
01	120.0	4	4.0		1.8		
02	134.0	3	2.7		1.6		
03	118.0	4	4.1	7.2	2.0	1.0	
04	111.0	3	3.2		1.9		
05	112.0	3	3.2	7.2	1.9	0.9	
06	127.0	3	2.8		1.8		
07	151.0	3	2.4		1.7		
08	134.0	3	2.7	7.2	1.7	0.8	
09	120.0	3	3.0		1.9		
10	126.0	3	2.9	7.1	1.7	0.8	
11	119.0	4	4.0		1.8		
12	154.0	5	3.9	7.2	1.8	0.9	
13	121.0	4	4.0		1.8		
14	108.0	4	4.4		1.8		
15	136.0	4	3.5		1.7		
16	119.0	3	3.0		1.9		
17	119.0	4	4.0	7.1	1.8	1.1	
18	121.0	4	4.0		2.0		
19	112.0	4	4.3	7.2	1.7	1.0	
20	127.0	4	3.8		1.7		
21	133.0	5	4.5		2.0		
22	120.0	4	4.0	7.2	2.0	1.1	
23	112.0	3	3.2		1.8		
24	106.0	3	3.4	7.2	2.0	1.0	
25	117.0	3	3.1		1.8		
26	111.0	4	4.3		1.9		
27	120.0	5	5.0		1.9		
28	126.0	3	2.9		1.9		
29	120.0	4	4.0	7.2	2.0	1.1	
30	116.0	4	4.1		1.9		
31	113.0	4	4.2	7.1	1.7	1.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-04-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454286 C.U.P. NO. 2-089-0017- NMZR

NAME OF DRINKING WATER SYSTEM: OTTER RUN WATER TREATMENT PLANT

LOCATION: 0000 SOUTH LITTLEBERRY LANE

FERNANDINA BEACH, NASSAU COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

INFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Kenneth L. Lynch

_____, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
THLY TOTAL	3192.0	131	162.6	159.0	64.4	17.0	
AVERAGE	103.0	4	5.2	7.2	2.1	0.9	
MINIMUM	440.0	13	8.1	7.3	2.5	1.1	
MINIMUM	55.0	2	3.5	7.2	1.8	0.7	
01	55.0	3	6.5		1.9		
02	85.0	3	4.2	7.3	2.0	0.9	
03	83.0	3	4.3	7.3	2.1	0.7	
04	73.0	3	4.9	7.3	1.8	0.8	
05	84.0	3	4.3	7.3	2.1	0.8	
06	86.0	3	4.2	7.3	2.0	0.8	
07	57.0	2	4.2		2.0		
08	79.0	3	4.6		1.8		
09	94.0	5	6.4	7.3	2.1	0.8	
10	79.0	3	4.6	7.2	2.0	0.8	
11	74.0	3	4.9	7.2	2.2	1.0	
12	74.0	3	4.9	7.2	2.1	1.1	
13	94.0	4	5.1	7.2	1.9	1.0	
14	99.0	4	4.8	7.2	2.0		
15	126.0	5	4.8	7.2	2.0		
16	440.0	13	3.5	7.2	2.1	0.9	
17	154.0	6	4.7	7.2	2.0	0.8	
18	182.0	7	4.6	7.2	2.5	1.0	
19	74.0	5	8.1	7.2	2.2	0.9	
20	125.0	4	3.8	7.2	2.5	0.8	
21	88.0	5	6.8		2.4		
22	83.0	4	5.8		2.1		
23	133.0	4	3.6	7.2	2.3	0.8	
24	72.0	4	6.7		2.0		
25	65.0	4	7.4		2.2		
26	93.0	4	5.2	7.2	2.2	0.8	
27	75.0	4	6.4	7.2	1.9	0.7	
28	60.0	4	8.0		2.0		
29	100.0	5	6.0		2.2		
30	104.0	4	4.6	7.2	2.0	0.8	
31	102.0	4	4.7	7.2	1.8	0.8	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 12-10-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS LU NO. 2454286 C.U.P. NO. 2-089-0017- WNR

NAME OF DRINKING WATER SYSTEM: LAKE RUN WATER TREATMENT PLANT

LOCATION: 0000 SOUTH LITTLEBERRY LANE

FERNANDINA BEACH; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

PLANT EFFLUENT pH: 7.5(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Kenneth A. Lyden

, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1015.0	44	58.8	82.7	21.6	6.4	
AVERAGE	92.3	4	5.3	7.5	2.0	0.8	
MAXIMUM	111.0	5	8.2	7.6	2.2	1.0	
MINIMUM	72.0	3	3.8	7.5	1.6	0.6	
01							
02							
03							
04							
05							
06							
07							
08							
09							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20	73.0	5	8.2	7.5	2.2	0.6	
21	95.0	3	3.8	7.5	2.0	0.6	
22	102.0	4	4.7	7.5	2.0	0.8	
23	94.0	3	3.8	7.5	2.2		
24	83.0	5	7.2	7.5	1.6		
25	105.0	4	4.6	7.6	2.0	0.9	
26	111.0	4	4.3	7.6	1.8	0.8	
27	85.0	4	5.6	7.5	1.9	1.0	
28	72.0	4	6.7	7.5	1.9	0.9	
29	101.0	4	4.8	7.5	2.0	0.8	
30	94.0	4	5.1	7.5	2.0		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

SAMPLE DATE: 11-30-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

AS ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1996


PLANT EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	5613.0	208.9	137.6	228.2	59.2	18.8	1	
AVERAGE	181.1	6.7	4.4	7.4	1.9	0.9		
MAXIMUM	303.0	14.9	5.9	7.5	2.5	1.1		
MINIMUM	126.0	4.0	3.6	7.2	1.4	0.7		
01	155.0	5.7	4.4	7.3	2.3			
02	195.0	7.2	4.4	7.3	2.2	1.0		
03	197.0	7.7	4.7	7.3	1.9	0.8		
04	209.0	7.7	4.4	7.3	2.0	0.9		
05	206.0	7.6	4.4	7.3	2.1	1.0	1	
06	252.0	9.4	4.5	7.3	2.2	1.0		
07	169.0	6.3	4.5	7.3	2.0			
08	224.0	8.4	4.5	7.3	2.5			
09	252.0	9.4	4.5	7.3	2.3	1.0		
10	303.0	14.9	5.9	7.3	2.2	1.0		
11	269.0	8.0	3.6	7.3	2.1	1.0		
12	189.0	7.0	4.4	7.3	1.6	0.8		
13	189.0	7.0	4.4	7.3	1.8	0.9		
14	186.0	7.0	4.5	7.3	2.2			
15	203.0	7.4	4.4	7.4	1.5			
16	159.0	5.8	4.4	7.2	1.9	1.1		
17	130.0	4.3	4.0	7.3	2.0	1.0		
18	151.0	5.5	4.4	7.3	2.1	1.0		
19	167.0	6.2	4.5	7.3	2.1	1.1		
20	143.0	5.3	4.4	7.3	1.8	0.8		
21	192.0	7.0	4.4	7.4	1.6			
22	132.0	4.9	4.5	7.5	1.5			
23	136.0	5.7	5.0	7.4	1.4	0.7		
24	126.0	4.0	3.8	7.5	1.8	0.8		
25	176.0	6.8	4.6	7.4	2.1			
26	133.0	4.9	4.4	7.5	2.0	0.7		
27	143.0	5.0	4.2	7.5	1.6	0.7		
28	159.0	6.0	4.5	7.5	1.8			
29	162.0	6.0	4.4	7.5	1.7			
30	142.0	5.3	4.5	7.5	1.4	0.7		
31	164.0	5.5	4.0	7.5	1.5	0.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: Ponce de Leon System Grid Plant No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1996

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *John C. Shwood*, C.O., CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	4824.0	175.1	130.8	223.1	65.9	23.2	1	
AVERAGE	160.8	5.8	4.4	7.4	2.2	1.1		
MAXIMUM	261.0	9.6	4.6	7.6	2.8	1.9		
MINIMUM	113.0	4.2	3.9	7.3	1.0	0.9		
01	125.0	4.6	4.4	7.4	2.0	1.0		
02	181.0	6.6	4.4	7.3	1.8			
03	190.0	6.9	4.4	7.3	2.5			
04	149.0	5.4	4.3	7.5	2.0	1.0	1	
05	153.0	5.5	4.3	7.5	2.1	1.0		
06	144.0	5.3	4.4	7.5	2.2	1.0		
07	145.0	5.2	4.3	7.4	2.1	1.0		
08	163.0	5.9	4.3	7.4	2.3	1.1		
09	113.0	4.2	4.5	7.4	2.2			
10	182.0	6.2	4.1	7.3	2.3			
11	142.0	5.2	4.4	7.3	2.1	0.9		
12	157.0	5.6	4.3	7.3	2.2	1.0		
13	147.0	5.4	4.4	7.3	2.1	1.0		
14	169.0	5.9	4.2	7.3	2.0	0.9		
15	138.0	5.3	4.6	7.5	2.5	1.3		
16	154.0	5.6	4.4	7.5	2.8			
17	174.0	6.4	4.4	7.5	2.0			
18	157.0	5.8	4.4	7.5	2.7	1.4		
19	128.0	4.7	4.4	7.5	2.5	1.2		
20	175.0	6.4	4.4	7.5	2.4	1.1		
21	137.0	4.9	4.3	7.5	2.2	1.1		
22	164.0	6.0	4.4	7.5	2.2	1.0		
23	145.0	5.4	4.5	7.4	2.3			
24	155.0	5.7	4.4	7.5	2.6			
25	135.0	4.9	4.4	7.5	2.2	1.9		
26	201.0	6.6	3.9	7.4	2.5	1.3		
27	160.0	5.9	4.4	7.6	1.0	0.9		
28	203.0	7.5	4.4	7.5	1.5	1.0		
29	177.0	6.5	4.4	7.5	2.1	1.1		
30	261.0	9.6	4.4	7.5	2.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PEARCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1996

DRAWN EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

 C.O., CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GAL. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	RESIDUAL CHLORINE mg/L REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	4503.0	162.2	133.9	230.4	59.6	25.9	1	
AVERAGE	145.3	5.2	4.3	7.4	1.9	1.1		
MAXIMUM	229.0	8.3	4.5	7.6	3.0	1.6		
MINIMUM	97.0	3.1	3.4	7.3	1.0	0.9		
01	111.0	3.1	3.4	7.4	2.0	1.1		
02	110.0	4.0	4.4	7.4	1.8	1.0		
03	133.0	4.8	4.3	7.4	1.9	1.0		
04	118.0	4.3	4.4	7.4	2.0	1.0		
05	229.0	8.3	4.3	7.4	2.1			
06	97.0	3.6	4.5	7.4	2.0			
07	138.0	4.9	4.3	7.4	2.1	1.0		
08	134.0	4.8	4.3	7.4	2.1	0.9		
09	134.0	4.9	4.4	7.4	2.2	1.6		
10	125.0	4.5	4.3	7.4	2.5	1.5	1	
11	132.0	4.9	4.5	7.4	2.4	1.4		
12	139.0	5.1	4.4	7.4	1.0			
13	162.0	5.8	4.3	7.3	1.9			
14	134.0	4.8	4.3	7.4	1.4	1.0		
15	145.0	5.3	4.4	7.4	1.6	1.0		
16	150.0	5.4	4.3	7.4	1.6	1.1		
17	131.0	4.8	4.4	7.4	1.8	1.1		
18	154.0	5.6	4.4	7.4	1.5	1.0		
19	129.0	4.7	4.4	7.4	1.7			
20	156.0	5.7	4.4	7.3	2.0			
21	160.0	5.8	4.4	7.6	2.0	1.0		
22	153.0	5.5	4.3	7.5	1.6	1.0		
23	141.0	5.1	4.3	7.5	1.7	1.0		
24	184.0	6.3	4.1	7.5	3.0	1.4		
25	170.0	6.2	4.4	7.5	2.5	1.5		
26	147.0	5.4	4.4	7.5	1.7			
27	153.0	5.6	4.4	7.5	1.7			
28	147.0	5.3	4.3	7.5	1.8	1.0		
29	181.0	6.6	4.4	7.5	1.9	1.1		
30	156.0	5.7	4.4	7.5	2.0	1.1		
31	150.0	5.4	4.3	7.5	2.1	1.1		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554334 C.U.P. NO. 2-109-0209USN NAME OF DRINKING WATER SYSTEM: PL. DE LEON SYSTEM GRID PLANT No. 1
 LOCATION: GOODWIN BEACH COUNTY: ST. JOHNS
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: September 1996
 AVERAGE EFFLUENT pH: 7.4 (AVG) NO. OF SERVICES AT END OF MONTH: 88
 AVERAGE FLOW: 1.6 (MGD) MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT *[Signature]*, C.O., CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	4743.0	172.0	130.5	223.1	59.7	20.0	1	
AVERAGE	158.1	5.7	4.3	7.4	2.0	1.0		
MINIMUM	208.0	7.5	5.0	7.5	2.6	1.4		
MAXIMUM	43.0	1.5	4.0	7.4	0.8	0.4		
01	177.0	6.6	4.5	7.5	2.0			
02	140.0	5.0	4.3	7.5	1.8			
03	163.0	5.9	4.3	7.5	1.9	1.0		
04	43.0	1.5	4.2	7.5	2.1	1.1		
05	153.0	5.5	4.3	7.5	2.0	1.0		
06	184.0	6.6	4.3	7.5	2.1	1.0		
07	133.0	5.0	4.5	7.4	2.3			
08	168.0	6.1	4.4	7.5	2.2			
09	207.0	7.2	4.2	7.4	1.7	0.8		
10	172.0	7.1	5.0	7.4	1.8	0.8		
11	172.0	5.8	4.0	7.4	2.6	0.8		
12	135.0	4.9	4.4	7.4	0.8	0.4		
13	155.0	5.7	4.4	7.4	1.7	0.8		
14	138.0	5.0	4.3	7.4	2.1			
15	196.0	7.1	4.3	7.4	1.9			
16	137.0	4.9	4.3	7.4	1.9	1.4		
17	165.0	5.9	4.3	7.4	2.0	1.3		
18	183.0	6.6	4.3	7.4	2.1	1.0	1	
19	208.0	7.5	4.3	7.4	2.3	1.0		
20	160.0	5.8	4.4	7.4	2.0	1.2		
21	157.0	5.7	4.4	7.4	2.2			
22	130.0	4.7	4.3	7.4	1.8			
23	150.0	5.4	4.3	7.4	1.9	1.0		
24	161.0	5.4	4.0	7.4	1.5	1.0		
25	154.0	6.0	4.7	7.4	1.8	1.1		
26	167.0	6.1	4.4	7.4	2.3	1.4		
27	154.0	5.6	4.4	7.5	1.9	0.9		
28	159.0	5.8	4.4	7.5	2.2			
29	168.0	6.1	4.4	7.5	2.5			
30	154.0	5.5	4.3	7.5	2.3	1.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

OF DRINKING WATER SYSTEM: Ponce De Leon Grid Area LOCATION: Goodwin Beach

CITY: St. Johns REPORTING MONTH: August 1996

PROVIDED BY: United Water Florida Inc. NO. OF SERVICES AT END OF MONTH: 297

OFFICE PHONE No. (904) 725-2865 NO. OF SERVICES AT END OF MONTH: 88

CERTIFY THIS REPORT IS CORRECT Roger C. Shanon, C.O., CERT. NO. C-6202

PLANT NAME: Ponce De Leon	A1A SOUTH	A1A NORTH	PONCE DE LEON GRID
WTP No. 1	WTP No. 2	WTP No. 3	
ID No.: 2554334	2554334	2554334	
P. No.: 2-109-0209-USN	2-109-0110NMR	2-109-0110NMR	
SERVICES: 88	209		297

LINE	5492.0	33.0	1516.0	7041.0
AGE	177.2	1.1	48.9	227.1
IMUM	232.0	15.0	80.0	297.0
IMUM	133.0	0.0	22.0	169.0
01	194.0	0.0	68.0	262.0
02	204.0	0.0	42.0	246.0
03	163.0	0.0	40.0	203.0
04	184.0	2.0	58.0	244.0
05	170.0	0.0	50.0	220.0
06	170.0	0.0	60.0	230.0
07	195.0	1.0	64.0	260.0
08	192.0	2.0	61.0	255.0
09	214.0	1.0	75.0	290.0
10	211.0	1.0	74.0	286.0
11	133.0	0.0	40.0	173.0
12	176.0	0.0	35.0	211.0
13	149.0	0.0	40.0	189.0
14	175.0	0.0	39.0	214.0
15	232.0	0.0	41.0	273.0
16	196.0	15.0	69.0	280.0
17	159.0	0.0	63.0	222.0
18	177.0	0.0	43.0	220.0
19	205.0	2.0	56.0	263.0
20	152.0	6.0	42.0	200.0
21	168.0	0.0	49.0	217.0
22	177.0	0.0	45.0	222.0
23	217.0	0.0	80.0	297.0
24	149.0	0.0	44.0	193.0
25	156.0	2.0	48.0	206.0
26	154.0	0.0	31.0	185.0
27	168.0	0.0	34.0	202.0
28	146.0	1.0	22.0	169.0
29	167.0	0.0	40.0	207.0
30	159.0	0.0	27.0	186.0
31	180.0	0.0	36.0	216.0

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

OF DRINKING WATER SYSTEM: Ponce De Leon Grid System

LOCATION: Goodwin Beach

WATER TREATMENT PLANT: St. Johns

REPORTING MONTH: July 1996


OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 297

MAIN OFFICE PHONE No. (904) 725-2865

NO. OF SERVICES AT END OF MONTH: 88

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-6202

PLANT NAME: Ponce De Leon	A1A SOUTH	A1A NORTH	PONCE DE LEON GRID
PLANT No. WTP No. 1	WTP No. 2	WTP No. 3	

ID No.: 2554334	2554334	2554334	
P. No.: 2-109-0209-USN	2-109-0110NMR	2-109-0110NMR	
SERVICES: 88	209		297

AL	5571.0	33.0	1466.0	7070.0
TRANGE	179.7	1.1	47.3	228.1
IMMUN	280.0	21.0	87.0	363.0
IMMUN	136.0	0.0	23.0	168.0

01	206.0	0.0	41.0	247.0
02	141.0	0.0	32.0	173.0
03	199.0	0.0	44.0	243.0
04	181.0	0.0	58.0	239.0
05	161.0	0.0	41.0	202.0
06	151.0	0.0	33.0	184.0
07	159.0	1.0	37.0	197.0
08	141.0	0.0	27.0	168.0
09	145.0	0.0	23.0	168.0
10	159.0	0.0	34.0	193.0
11	149.0	0.0	26.0	175.0
12	152.0	21.0	26.0	199.0
13	161.0	1.0	41.0	203.0
14	169.0	5.0	38.0	212.0
15	204.0	1.0	38.0	243.0
16	152.0	0.0	27.0	179.0
17	173.0	0.0	50.0	223.0
18	172.0	0.0	58.0	230.0
19	210.0	0.0	63.0	273.0
20	176.0	0.0	49.0	225.0
21	203.0	0.0	79.0	282.0
22	219.0	0.0	58.0	277.0
23	190.0	0.0	50.0	240.0
24	195.0	0.0	50.0	245.0
25	222.0	0.0	51.0	273.0
26	136.0	0.0	48.0	184.0
27	280.0	0.0	83.0	363.0
28	234.0	1.0	87.0	322.0
29	163.0	3.0	59.0	225.0
30	190.0	0.0	60.0	250.0
31	178.0	0.0	55.0	233.0

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: June 1996

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

INFLUENT FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865


CERTIFY THIS REPORT IS CORRECT

Kenneth L. Fu

, C.O., CERT. NO. C-3323

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	5291.0	189.3	128.9	221.7	66.6	22.4	1	
AVERAGE	176.4	6.3	4.3	7.4	2.2	1.1		
MINIMUM	240.0	8.8	4.7	7.5	3.0	1.4		
MAXIMUM	99.0	3.6	4.1	7.3	1.5	0.9		
01	203.0	7.2	4.3	7.4	2.2			
02	178.0	6.3	4.2	7.5	2.0			
03	194.0	6.9	4.3	7.5	2.1	1.0		
04	192.0	6.9	4.3	7.5	2.0	1.0		
05	240.0	8.8	4.4	7.5	2.2	1.0	1	
06	228.0	8.0	4.2	7.5	2.1	1.0		
07	202.0	7.2	4.3	7.5	2.0	0.9		
08	182.0	6.6	4.4	7.5	1.5			
09	121.0	4.7	4.7	7.5	1.5			
10	172.0	6.1	4.3	7.4	3.0	1.4		
11	140.0	5.0	4.3	7.4	2.6	1.3		
12	185.0	6.6	4.3	7.4	2.5	1.2		
13	181.0	6.4	4.2	7.4	2.5	1.3		
14	204.0	7.4	4.4	7.4	2.3	1.3		
15	99.0	3.6	4.4	7.3	2.7			
16	178.0	6.4	4.3	7.3	2.1			
17	183.0	6.5	4.3	7.3	2.2	1.0		
18	168.0	6.0	4.3	7.3	2.1	1.0		
19	169.0	6.1	4.3	7.3	2.0	1.0		
20	191.0	6.5	4.1	7.4	2.7	1.1		
21	154.0	5.5	4.3	7.4	2.5	1.1		
22	199.0	7.2	4.3	7.3	2.2			
23	187.0	6.7	4.3	7.3	2.0			
24	195.0	6.9	4.2	7.3	2.0	1.0		
25	213.0	7.6	4.3	7.3	2.0	1.1		
26	136.0	4.9	4.3	7.3	2.4	1.2		
27	145.0	5.1	4.2	7.3	2.3	1.3		
28	156.0	5.5	4.2	7.3	2.1	1.2		
29	151.0	5.5	4.4	7.5	2.3			
30	145.0	5.2	4.3	7.4	2.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

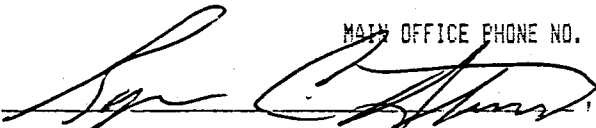ID NO. 2554334 C.U.P. NO. 2-109-0209USN NAME OF DRINKING WATER SYSTEM: F DE LEON SYSTEM GRID PLANT No. 1
 LOCATION: GOODWIN BEACH COUNTY: ST. JOHNS
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: May 1996
 INFLUENT EFFLUENT pH: 7.4 (AVG) NO. OF SERVICES AT END OF MONTH: 88
 INFLUENT FLOW: 1.6 (MGD) MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT  C.O., CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	5653.0	203.2	133.6	228.2	67.8	24.6	1	
RANGE	182.4	6.6	4.3	7.4	2.2	1.1		
MINIMUM	248.0	9.2	4.6	7.5	2.8	1.3		
MINIMUM	116.0	4.2	3.6	7.3	1.4	0.8		
01	151.0	5.5	4.4	7.5	1.4	0.8		
02	156.0	5.7	4.4	7.4	1.9	1.0	1	
03	196.0	5.8	3.6	7.5	1.7	0.8		
04	214.0	7.9	4.4	7.4	1.6			
05	116.0	4.2	4.3	7.4	1.8			
06	177.0	6.4	4.3	7.4	2.8	1.2		
07	151.0	5.4	4.3	7.4	2.3	1.2		
08	183.0	6.6	4.3	7.4	2.4	1.3		
09	171.0	6.1	4.3	7.4	2.3	1.3		
10	158.0	5.8	4.4	7.4	2.2	1.2		
11	192.0	7.0	4.4	7.5	1.7			
12	212.0	7.6	4.3	7.5	2.3			
13	181.0	6.5	4.3	7.4	2.1	1.0		
14	162.0	5.8	4.3	7.3	2.8	1.1		
15	198.0	6.8	4.1	7.3	2.2	1.1		
16	190.0	7.1	4.5	7.3	2.3	1.1		
17	181.0	6.5	4.3	7.3	2.4	1.1		
18	227.0	8.1	4.3	7.4	2.2			
19	148.0	5.3	4.3	7.3	2.5			
20	190.0	6.7	4.2	7.3	2.3	1.3		
21	145.0	5.1	4.2	7.3	2.2	1.3		
22	177.0	6.3	4.3	7.3	2.2	1.2		
23	184.0	6.5	4.2	7.3	2.1	1.2		
24	248.0	9.1	4.4	7.3	2.2	1.3		
25	221.0	8.0	4.3	7.3	2.6			
26	220.0	8.4	4.6	7.3	2.7			
27	240.0	9.2	4.6	7.3	2.2			
28	151.0	5.3	4.2	7.3	2.1	1.1		
29	174.0	6.4	4.4	7.3	2.0	1.0		
30	189.0	6.7	4.3	7.3	2.0	1.1		
31	150.0	5.4	4.3	7.4	2.3	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

3 ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GODDWIN BEACH

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: April 1996

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

AVERAGE FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Roger Atwood, C.O., CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY								
TOTAL	4614.0	168.2	131.2	219.9	59.6	18.7	1	
AVERAGE	153.8	5.6	4.4	7.3	2.0	0.9		
MAXIMUM	206.0	7.5	4.8	7.5	3.5	1.3		
MINIMUM	115.0	4.3	4.1	7.2	0.5	0.6		
01	145.0	4.9	4.1	7.3	1.9	0.7	1	
02	115.0	4.5	4.7	7.3	1.7	0.6		
03	185.0	6.8	4.4	7.3	1.6	0.6		
04	137.0	5.1	4.5	7.4	1.8	0.7		
05	149.0	5.3	4.3	7.2	2.0			
06	127.0	4.6	4.3	7.4	2.0			
07	160.0	5.8	4.4	7.3	1.9			
08	151.0	5.5	4.4	7.3	2.1	0.9		
09	139.0	5.0	4.3	7.3	2.0	0.9		
10	185.0	6.7	4.3	7.3	1.6	0.7		
11	162.0	5.9	4.4	7.3	1.9	0.8		
12	166.0	6.1	4.4	7.4	1.7	0.7		
13	184.0	7.3	4.8	7.5	0.5			
14	160.0	5.8	4.4	7.5	3.5			
15	139.0	5.1	4.4	7.5	3.0	1.3		
16	142.0	5.1	4.3	7.4	2.8	1.2		
17	172.0	6.3	4.4	7.3	2.2	1.0		
18	146.0	5.4	4.4	7.3	2.1	1.0		
19	152.0	5.5	4.3	7.3	1.6	0.8		
20	206.0	7.5	4.4	7.4	1.9			
21	140.0	5.1	4.4	7.3	2.3			
22	154.0	5.6	4.4	7.3	2.1	0.9		
23	133.0	4.7	4.2	7.2	2.1	1.0		
24	169.0	6.0	4.3	7.2	2.0	1.0		
25	175.0	6.4	4.4	7.3	2.0	1.0		
26	154.0	5.6	4.4	7.3	2.1	1.0		
27	151.0	5.5	4.4	7.3	1.8			
28	175.0	6.4	4.4	7.3	1.8			
29	122.0	4.4	4.3	7.3	2.3	1.0		
30	119.0	4.3	4.3	7.4	1.3	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NAME OF DRINKING WATER SYSTEM: Ponce De Leon Grid System LOCATION: Goodwin Beach
 COUNTY: St. Johns REPORTING MONTH: April 1996
 PROVIDED BY: United Water Florida Inc. NO. OF SERVICES AT END OF MONTH: 297

HOME OFFICE PHONE No. (904) 725-2865 NO. OF SERVICES AT END OF MONTH: 88

CERTIFY THIS REPORT IS CORRECT Roger Atwood, C.O., CERT. NO. C-6202

TREATMENT PLANT NAME: Ponce De Leon A1A SOUTH A1A NORTH PONCE DE LEON GRID
 TREATMENT No. WTP No. 1 WTP No. 2 WTP No. 3

PLANT ID No.: 2554334 2554334 2554334
 J.P. No.: 2-109-0209-USN 2-109-0110NMR 2-109-0110NMR
 NO. OF SERVICES: 88 209 297

TOTAL 4614.0 10.0 598.0 5222.0

AVERAGE 153.8 0.3 19.9 174.1

MAXIMUM 206.0 6.0 53.0 260.0

MINIMUM 115.0 0.0 3.0 123.0

01	145.0	0.0	9.0	154.0
02	115.0	0.0	8.0	123.0
03	185.0	0.0	13.0	198.0
04	137.0	0.0	10.0	147.0
05	149.0	0.0	19.0	168.0
06	127.0	0.0	7.0	134.0
07	160.0	0.0	19.0	179.0
08	151.0	0.0	8.0	159.0
09	139.0	0.0	13.0	152.0
10	185.0	0.0	15.0	200.0
11	162.0	0.0	32.0	194.0
12	166.0	0.0	18.0	184.0
13	184.0	0.0	22.0	206.0
14	160.0	0.0	11.0	171.0
15	139.0	0.0	4.0	143.0
16	142.0	0.0	3.0	145.0
17	172.0	0.0	9.0	181.0
18	146.0	0.0	15.0	161.0
19	152.0	0.0	14.0	166.0
20	206.0	1.0	53.0	260.0
21	140.0	2.0	32.0	174.0
22	154.0	0.0	27.0	181.0
23	133.0	0.0	13.0	146.0
24	169.0	0.0	26.0	195.0
25	175.0	0.0	27.0	202.0
26	154.0	6.0	28.0	188.0
27	151.0	0.0	52.0	203.0
28	175.0	0.0	53.0	228.0
29	122.0	1.0	24.0	147.0
30	119.0	0.0	14.0	133.0

ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: P DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: March 1996


AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

DESIGN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.D., CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	3998.0	142.5	132.7	228.3	66.3	17.1	1	
AVERAGE	129.0	4.6	4.3	7.4	2.1	0.8		
MINIMUM	186.0	6.7	4.5	7.5	2.9	1.1		
MINIMUM	62.0	2.3	3.9	7.2	1.3	0.4		
01	78.0	2.7	4.2	7.4	2.2	1.1		
02	123.0	4.5	4.4	7.3	2.9			
03	106.0	3.7	4.2	7.3	2.8			
04	127.0	4.5	4.3	7.3	2.6	0.8	1	
05	146.0	5.1	4.2	7.3	2.5	0.8		
06	160.0	5.9	4.4	7.5	2.8	0.8		
07	123.0	4.4	4.3	7.4	2.6	0.9		
08	165.0	5.4	3.9	7.4	2.5	0.9		
09	147.0	5.3	4.3	7.4	1.3			
10	118.0	4.2	4.3	7.3	2.0			
11	135.0	4.8	4.3	7.3	2.1	0.8		
12	136.0	4.9	4.3	7.3	1.3	0.8		
13	131.0	4.7	4.3	7.5	1.6	0.8		
14	143.0	5.1	4.3	7.5	1.8	0.9		
15	138.0	5.0	4.3	7.5	2.0	1.0		
16	149.0	5.4	4.3	7.5	2.0			
17	132.0	4.7	4.3	7.5	2.1			
18	121.0	4.3	4.3	7.5	1.9	0.8		
19	75.0	2.8	4.5	7.5	2.2	0.4		
20	119.0	4.1	4.1	7.4	2.7	0.9		
21	125.0	4.5	4.3	7.4	2.4	1.0		
22	186.0	6.7	4.3	7.4	2.4	1.0		
23	62.0	2.3	4.5	7.4	2.0			
24	154.0	5.6	4.4	7.4	2.2			
25	135.0	4.8	4.3	7.4	2.2	0.8		
26	136.0	4.8	4.2	7.2	1.7	0.6		
27	133.0	4.7	4.2	7.2	1.8	0.7		
28	116.0	4.2	4.3	7.2	1.9	0.6		
29	115.0	4.1	4.3	7.2	1.9	0.7		
30	136.0	4.9	4.3	7.2	2.1			
31	128.0	4.4	4.1	7.2	1.8			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: DE LEON SYSTEM GRID PLANT No. 1

LOCATION: GOODWIN BEACH

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: February 1996


AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

AVERAGE FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	4082.0	147.1	125.5	214.5	47.7	16.3	1	
RANGE	140.8	5.1	4.3	7.4	1.6	0.8		
MINIMUM	267.0	10.1	4.7	7.5	2.3	1.1		
MINIMUM	100.0	3.6	3.3	7.2	0.8	0.2		
01	100.0	3.6	4.3	7.4	2.0	1.0		
02	122.0	4.5	4.4	7.4	2.2	0.8		
03	159.0	6.0	4.5	7.4	1.3			
04	142.0	5.3	4.5	7.3	1.1			
05	267.0	10.1	4.5	7.5	1.5	1.1	1	
06	156.0	5.7	4.4	7.3	0.8	0.5		
07	135.0	4.9	4.4	7.4	0.9	0.8		
08	146.0	5.3	4.4	7.5	1.5	0.2		
09	149.0	5.4	4.3	7.2	1.6	0.6		
10	149.0	5.4	4.3	7.3	1.5			
11	131.0	4.7	4.3	7.3	1.6			
12	180.0	4.9	3.3	7.4	1.2	0.6		
13	135.0	4.8	4.3	7.5	1.4	0.8		
14	116.0	4.2	4.3	7.5	1.1	0.9		
15	122.0	4.4	4.3	7.4	1.3	0.8		
16	121.0	4.4	4.4	7.4	1.5	1.0		
17	113.0	4.1	4.4	7.4	1.3			
18	131.0	4.7	4.3	7.4	1.8			
19	143.0	5.1	4.3	7.3	1.5			
20	113.0	4.4	4.7	7.3	1.6	0.8		
21	135.0	4.5	4.0	7.3	1.8	0.9		
22	142.0	5.1	4.3	7.3	2.3	0.8		
23	139.0	5.0	4.3	7.3	2.1	0.8		
24	145.0	5.2	4.3	7.5	2.0			
25	171.0	6.6	4.6	7.5	2.2			
26	119.0	4.3	4.3	7.5	2.2	1.0		
27	144.0	5.2	4.3	7.5	2.1	1.0		
28	136.0	4.9	4.3	7.5	2.2	1.0		
29	121.0	4.4	4.4	7.5	2.1	0.9		

D NO. 2554334 C.U.P. NO. 2-109-0209USN

NAME OF DRINKING WATER SYSTEM: PONC LEON SYSTEM GRID PLANT No. 1

ION: GOODWIN BEACH

COUNTY: ST. JOHNS

BY: United Water Florida Inc.

REPORTING MONTH: January 1996

EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 88

IN FLOW: 1.6 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-6202

METER NO.	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
AL	4515.0	163.6	134.5	227.8	66.6	20.7	1	
AGE	145.6	5.3	4.3	7.3	2.1	0.9		
MUM	224.0	8.3	4.5	7.5	3.0	1.5		
MUM	88.0	3.1	4.2	7.3	1.5	0.6		
01	164.0	5.9	4.3	7.4	2.3			
02	88.0	3.1	4.2	7.3	2.6	1.1		
03	107.0	3.8	4.3	7.3	2.4	1.0		
04	121.0	4.4	4.4	7.3	2.3	1.0		
05	132.0	4.8	4.4	7.3	2.3	0.6		
06	139.0	5.0	4.3	7.3	2.6			
07	125.0	4.4	4.2	7.3	2.3			
08	224.0	8.3	4.4	7.3	2.0	0.6		
09	200.0	7.4	4.4	7.3	2.1	0.9		
10	178.0	6.5	4.4	7.3	2.0	0.9		
11	192.0	7.0	4.4	7.3	3.0	1.3	1	
12	150.0	5.5	4.4	7.3	2.6	1.5		
13	171.0	6.2	4.4	7.3	2.2			
14	145.0	5.4	4.5	7.3	2.0			
15	172.0	6.2	4.3	7.3	2.1	1.1		
16	152.0	5.5	4.3	7.3	1.9	1.0		
17	138.0	5.0	4.3	7.3	2.0	1.0		
18	137.0	4.9	4.3	7.4	1.8	0.9		
19	196.0	7.2	4.4	7.4	1.9	0.9		
20	117.0	4.2	4.3	7.5	1.5			
21	147.0	5.5	4.5	7.4	1.8			
22	115.0	4.2	4.4	7.4	1.8	0.8		
23	143.0	5.1	4.3	7.4	1.9	0.8		
24	135.0	4.8	4.3	7.4	1.9	0.7		
25	136.0	4.9	4.3	7.4	1.8	0.7		
26	132.0	4.8	4.4	7.4	2.2	0.8		
27	129.0	4.6	4.3	7.3	2.5			
28	131.0	4.8	4.4	7.4	2.3			
29	138.0	4.9	4.3	7.4	2.1	1.0		
30	116.0	4.1	4.2	7.4	2.2	1.0		
31	145.0	5.2	4.3	7.4	2.2	1.1		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WIS ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1996

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.D. CERT.NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
<hr/>								
MONTHLY TOTAL	55.0	3.0	107.6	228.3	39.4	13.5	1	
AVERAGE	1.8	0.1	9.0	7.4	1.3	0.6		
MAXIMUM	32.0	1.5	12.0	7.5	2.0	1.2		
MINIMUM	0.0	0.0	4.0	7.3	0.8	0.3		
<hr/>								
01	1.0	0.1	12.0	7.3	2.0			
02	0.0	0.0		7.3	1.8	0.8		
03	1.0	0.1	12.0	7.3	1.5	0.6		
04	0.0	0.0		7.3	1.3	0.6		
05	0.0	0.0		7.3	1.2	0.6	1	
06	0.0	0.0		7.3	1.0	0.5		
07	0.0	0.0		7.3	1.1			
08	0.0	0.0		7.3	1.4			
09	0.0	0.0		7.3	1.1	0.4		
10	1.0	0.1	12.0	7.3	1.5	0.9		
11	0.0	0.0		7.3	1.4	0.9		
12	32.0	1.5	5.6	7.3	1.3	0.6		
13	5.0	0.3	6.0	7.3	1.8	0.9		
14	0.0	0.0		7.4	1.2			
15	0.0	0.0		7.3	1.1			
16	2.0	0.2	12.0	7.3	1.5	1.2		
17	0.0	0.0		7.3	1.6	1.0		
18	0.0	0.0		7.3	1.4	0.5		
19	2.0	0.1	6.0	7.3	1.3	0.5		
20	2.0	0.1	6.0	7.4	0.8	0.4		
21	0.0	0.0		7.5	0.8			
22	1.0	0.1	12.0	7.5	0.8			
23	3.0	0.1	4.0	7.5	1.0	0.5		
24	0.0	0.0		7.4	1.3	0.5		
25	0.0	0.0		7.5	1.0			
26	0.0	0.0		7.4	1.1	0.7		
27	0.0	0.0		7.4	1.2	0.7		
28	1.0	0.1	12.0	7.4	1.0			
29	0.0	0.0		7.5	1.2			
30	3.0	0.2	8.0	7.5	1.2	0.3		
31	0.0	0.0		7.5	1.5	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2551325 C.U.P. NO. 2-109-011-0U

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1996


OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2855

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:  C.D. CERT. NO. C-6202

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		

MONTHLY TOTAL	3.0	0.4	36.0	222.3	32.6	11.5	1	
AVERAGE	0.1	0.0	12.0	7.4	1.1	0.5		
MAXIMUM	1.0	0.1	12.0	7.5	2.5	1.0		
MINIMUM	0.0	0.0	12.0	7.2	0.5	0.2		

01	0.0	0.0		7.5	1.0	0.4		
02	0.0	0.0		7.4	0.8			
03	0.0	0.0		7.4	1.2			
04	0.0	0.0		7.5	0.5	0.2	1	
05	0.0	0.0		7.5	0.9	0.3		
06	0.0	0.0		7.5	1.0	0.4		
07	0.0	0.0		7.5	1.1	0.4		
08	0.0	0.0		7.5	1.2	0.4		
09	0.0	0.0		7.5	1.1			
10	0.0	0.1		7.4	2.0			
11	0.0	0.0		7.4	1.7	1.0		
12	0.0	0.0		7.4	1.7	1.0		
13	0.0	0.0		7.4	1.5	0.9		
14	0.0	0.0		7.4	1.4	0.7		
15	0.0	0.0		7.5	0.8	0.4		
16	0.0	0.0		7.5	0.5			
17	0.0	0.0		7.5	0.5			
18	0.0	0.0		7.5	0.5	0.2		
19	0.0	0.0		7.2	0.5	0.2		
20	0.0	0.0		7.3	0.7	0.3		
21	0.0	0.0		7.3	0.9	0.4		
22	0.0	0.0		7.3	0.8	0.4		
23	0.0	0.0		7.4	0.7			
24	0.0	0.0		7.4	0.8			
25	0.0	0.0		7.4	0.6	0.9		
26	0.0	0.0		7.3	1.1	0.6		
27	0.0	0.0		7.3	1.1	0.5		
28	1.0	0.1	12.0	7.4	1.4	0.9		
29	1.0	0.1	12.0	7.4	2.1	1.0		
30	1.0	0.1	12.0	7.3	2.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

3 ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: October 1996

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

SIGNATURE FLOW: _____

CERTIFY THIS REPORT IS CORRECT:

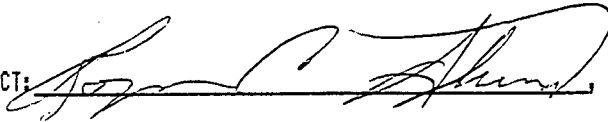

C.O. CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY	65.0	3.1	67.4	7.4	39.8	13.4	1	
WEEKLY	2.1	0.1	6.1	7.4	1.3	0.6		
MONTHLY	12.0	0.6	12.0	7.5	2.3	0.9		
QUARTERLY	0.0	0.0	4.0	7.3	0.5	0.2		
01	5.0	0.2	4.8	7.4	1.3	0.6		
02	0.0	0.0		7.4	1.6	0.8		
03	1.0	0.1	12.0	7.4	1.4	0.7		
04	5.0	0.3	7.2	7.4	1.3	0.7		
05	10.0	0.5	6.0	7.4	1.8			
06	11.0	0.5	5.5	7.4	2.3			
07	7.0	0.3	5.1	7.4	2.0	0.9		
08	5.0	0.2	4.8	7.4	1.8	0.7		
09	0.0	0.0		7.4	1.6	0.7		
10	0.0	0.0		7.4	1.4	0.6	1	
11	0.0	0.0		7.4	1.3	0.6		
12	0.0	0.0		7.4	1.5			
13	0.0	0.0		7.3	0.8			
14	0.0	0.0		7.3	0.9	0.4		
15	0.0	0.0		7.3	1.1	0.6		
16	0.0	0.0		7.3	1.2	0.5		
17	12.0	0.6	6.0	7.3	1.3	0.5		
18	2.0	0.1	6.0	7.3	2.0	0.9		
19	0.0	0.0		7.4	1.4			
20	0.0	0.0		7.5	1.2			
21	0.0	0.0		7.5	1.1	0.6		
22	0.0	0.0		7.5	1.1	0.4		
23	0.0	0.0		7.5	1.2	0.5		
24	3.0	0.1	4.0	7.5	1.4	0.6		
25	0.0	0.0		7.5	1.3	0.6		
26	0.0	0.0		7.5	0.6			
27	0.0	0.0		7.5	0.5			
28	4.0	0.2	6.0	7.5	0.9	0.5		
29	0.0	0.0		7.5	0.9	0.5		
30	0.0	0.0		7.5	0.8	0.2		
31	0.0	0.0		7.5	0.8	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-DU

NAME OF DRINKING WATER SYSTEM: PG. DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: September 1996

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DAILY FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.O. CERT.NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
9/1	58.0	3.0	44.2	223.1	40.6	15.9	1	
9/2	1.9	0.1	7.4	7.4	1.4	0.8		
9/3	39.0	1.7	12.0	7.5	3.0	1.3		
9/4	0.0	0.0	4.0	7.4	0.7	0.3		
9/5	0.0	0.0		7.5	1.7			
9/6	0.0	0.0		7.5	0.7			
9/7	0.0	0.0		7.5	1.0	0.4		
9/8	39.0	1.7	5.2	7.5	0.8	0.3		
9/9	0.0	0.0		7.5	1.6	0.7		
9/10	0.0	0.0		7.5	1.3	0.5		
9/11	0.0	0.0		7.4	1.0			
9/12	2.0	0.1	6.0	7.5	1.1			
9/13	3.0	0.1	4.0	7.4	1.5	0.8		
9/14	0.0	0.0		7.4	1.4	0.8		
9/15	3.0	0.2	8.0	7.4	3.0	1.3		
9/16	3.0	0.3	12.0	7.4	1.9	1.1	1	
9/17	0.0	0.0		7.4	1.8	1.1		
9/18	0.0	0.0		7.4	1.5			
9/19	0.0	0.0		7.4	1.4			
9/20	0.0	0.0		7.4	1.6	0.8		
9/21	0.0	0.0		7.4	1.2	0.5		
9/22	0.0	0.0		7.4	1.4	0.5		
9/23	8.0	0.6	9.0	7.4	1.0	0.8		
9/24	0.0	0.0		7.4	1.8	1.2		
9/25	0.0	0.0		7.4	1.5			
9/26	0.0	0.0		7.4	1.3			
9/27	0.0	0.0		7.4	1.4	1.1		
9/28	0.0	0.0		7.4	1.2	1.0		
9/29	0.0	0.0		7.4	1.4	1.0		
9/30	0.0	0.0		7.4	1.3	1.0		
9/31	0.0	0.0		7.5	0.7	0.3		
10/1	0.0	0.0		7.5	1.0			
10/2	0.0	0.0		7.5	1.0			
10/3	0.0	0.0		7.5	1.1	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONTE VEDRA LEON SYSTEM GRID PLANT No. 2

ADDRESS: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: August 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

WATER FLOW: _____

CERTIFY THIS REPORT IS CORRECT:




C.O. CERT. NO. C-6202

METER NO.	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
AL	33.0	3.8	106.8	7.3	56.5	15.8	1	
AGE	1.1	0.1	10.7	7.4	1.8	0.7		
MUM	15.0	2.1	18.0	7.5	3.0	1.0		
MUM	0.0	0.0	6.0	7.3	1.1	0.5		
01	0.0	0.0		7.3	1.2	0.5		
02	0.0	0.0		7.3	1.7	0.5		
03	0.0	0.0		7.4	2.0			
04	2.0	0.1	6.0	7.4	1.9			
05	0.0	0.0		7.4	1.8	0.6	1	
06	0.0	0.0		7.4	1.9	0.7		
07	1.0	0.1	12.0	7.4	1.6	0.6		
08	2.0	0.1	6.0	7.4	1.7	0.7		
09	1.0	0.1	12.0	7.4	1.5	0.6		
10	1.0	0.1	12.0	7.5	2.6			
11	0.0	0.0		7.5	1.3			
12	0.0	0.0		7.5	1.1	0.5		
13	0.0	0.0		7.4	1.8	0.7		
14	0.0	0.0		7.4	1.7	0.7		
15	0.0	0.0		7.4	1.5	0.7		
16	15.0	2.1	16.8	7.4	1.5	0.6		
17	0.0	0.0		7.4	2.9			
18	0.0	0.0		7.4	2.5			
19	2.0	0.1	6.0	7.4	1.8	1.0		
20	6.0	0.9	18.0	7.4	2.3	0.9		
21	0.0	0.0		7.4	2.0	1.0		
22	0.0	0.0		7.4	1.9	0.8		
23	0.0	0.0		7.4	1.8	1.0		
24	0.0	0.0		7.4	1.7			
25	2.0	0.1	6.0	7.4	1.5			
26	0.0	0.0		7.4	1.8	0.7		
27	0.0	0.0		7.4	1.6	0.6		
28	1.0	0.1	12.0	7.4	1.7	0.6		
29	0.0	0.0		7.4	3.0	0.9		
30	0.0	0.0		7.5	1.7	0.9		
31	0.0	0.0		7.5	1.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-0U NAME OF DRINKING WATER SYSTEM: F. DE LEON SYSTEM GRID PLANT No. 2
 LOCATION: 2722 South Ponte Vedra Blvd. COUNTY: St. Johns
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: July 1996
 MAINTAINED BY: United Water Florida Inc. NO. OF SERVICES AT END OF MONTH: 209
 INFLUENT EFFLUENT PH: 7.4 (AVG) MAIN OFFICE PHONE NO. (904) 725-2865

INFLUENT FLOW: _____
 I CERTIFY THIS REPORT IS CORRECT:  C.D. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
THLY	33.0	2.8	95.1	229.3	48.7	15.1	1	
RAGE	1.1	0.1	13.6	7.4	1.6	0.7		
IMUM	21.0	1.1	24.0	7.5	2.5	1.2		
IMUM	0.0	0.0	6.3	7.3	1.0	0.5		
01	0.0	0.0		7.4	2.1	1.2		
02	0.0	0.0		7.3	1.8	1.0		
03	0.0	0.0		7.3	2.3	0.8		
04	0.0	0.0		7.5	2.5			
05	0.0	0.0		7.4	2.0			
06	0.0	0.0		7.5	1.1			
07	1.0	0.1	12.0	7.5	1.1			
08	0.0	0.0		7.4	1.2	0.5	1	
09	0.0	0.0		7.4	1.3	0.5		
10	0.0	0.0		7.4	1.3	0.6		
11	0.0	0.0		7.4	1.4	0.6		
12	21.0	1.1	6.3	7.4	1.3	0.7		
13	1.0	0.1	12.0	7.3	1.5			
14	5.0	0.7	15.8	7.4	1.0			
15	1.0	0.1	12.0	7.4	2.2	1.2		
16	0.0	0.0		7.4	1.8	1.0		
17	0.0	0.0		7.4	1.5	0.8		
18	0.0	0.0		7.4	1.5	0.7		
19	0.0	0.0		7.4	1.4	0.7		
20	0.0	0.0		7.4	1.5			
21	0.0	0.0		7.4	1.7			
22	0.0	0.0		7.4	1.5	0.5		
23	0.0	0.0		7.4	1.6	0.5		
24	0.0	0.0		7.4	1.5	0.5		
25	0.0	0.0		7.4	1.9	0.6		
26	0.0	0.0		7.4	1.4	0.5		
27	0.0	0.0		7.3	1.2			
28	1.0	0.1	12.0	7.4	1.3			
29	3.0	0.6	24.0	7.4	1.5	0.7		
30	0.0	0.0		7.4	1.8	0.8		
31	0.0	0.0		7.4	1.5	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-00 NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 2
 LOCATION: 2722 South Ponte Vedra Blvd. COUNTY: St. Johns
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: June 1996
 RATED BY: United Water Florida Inc. NO. OF SERVICES AT END OF MONTH: 209
 INFLUENT PH: 7.4 (AVG) MAIN OFFICE PHONE NO. (904) 725-2865
 DRAIN FLOW: _____

CERTIFY THIS REPORT IS CORRECT: Kenneth F. O., C.O. CERT. NO. C-3323

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
THLY								
TAL	185.0	13.6	388.0	221.0	38.1	10.2	1	
AVERAGE	6.2	0.5	16.2	7.4	1.3	0.5		
MINIMUM	30.0	3.7	144.0	7.5	2.0	0.8		
MAXIMUM	0.0	0.0	0.0	7.3	0.5	0.3		
01	2.0	0.1	6.0	7.4	1.6			
02	3.0	0.1	4.0	7.4	1.4			
03	0.0	0.0		7.4	1.5	0.3		
04	0.0	0.0		7.4	1.3	0.4		
05	9.0	0.5	6.7	7.4	1.4	0.4	1	
06	16.0	1.4	10.5	7.4	1.2	0.5		
07	6.0	0.3	6.0	7.4	1.2	0.6		
08	3.0	0.2	8.0	7.5	0.5			
09	20.0	0.2	1.2	7.5	0.5			
10	0.0	2.2		7.5	0.8	0.3		
11	1.0	0.0	0.0	7.5	0.9	0.3		
12	1.0	0.1	12.0	7.4	1.0	0.3		
13	5.0	0.1	2.4	7.4	1.1	0.4		
14	1.0	0.2	24.0	7.4	1.3	0.5		
15	1.0	0.4	48.0	7.3	1.8			
16	1.0	0.4	48.0	7.3	1.2			
17	2.0	0.2	12.0	7.3	1.3	0.4		
18	2.0	0.1	6.0	7.3	1.3	0.5		
19	1.0	0.1	12.0	7.3	1.2	0.5		
20	6.0	0.1	2.0	7.3	1.2	0.6		
21	30.0	0.3	1.2	7.3	1.6	0.6		
22	20.0	3.7	22.2	7.3	1.3			
23	16.0	0.8	6.0	7.3	0.9			
24	30.0	0.7	2.8	7.3	1.1	0.6		
25	1.0	1.2	144.0	7.3	1.2	0.7		
26	0.0	0.1		7.3	1.2	0.8		
27	4.0	0.0	0.0	7.3	1.3	0.8		
28	4.0	0.1	3.0	7.3	2.0	0.7		
29	0.0	0.0		7.4	1.8			
30	0.0	0.0		7.4	2.0			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PL DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: May 1996


OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

INFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	35.0	3.1	115.0	228.8	40.6	12.7	1	
AVERAGE	1.1	0.1	12.8	7.4	1.3	0.6		
MINIMUM	10.0	0.9	36.0	7.4	2.0	1.0		
MAXIMUM	0.0	0.0	3.0	7.3	0.8	0.4		
01	0.0	0.0		7.3	1.8	0.8		
02	0.0	0.0		7.3	1.0	0.9	1	
03	0.0	0.0		7.4	0.9	0.6		
04	0.0	0.0		7.4	1.2			
05	0.0	0.0		7.4	1.3			
06	2.0	0.1	6.0	7.4	1.5	0.8		
07	0.0	0.0		7.4	1.4	0.6		
08	0.0	0.0		7.4	1.5	0.6		
09	0.0	0.0		7.4	1.3	0.5		
10	0.0	0.0		7.4	1.4	0.5		
11	0.0	0.0		7.4	1.0			
12	0.0	0.0		7.4	0.8			
13	0.0	0.0		7.4	1.1	0.6		
14	0.0	0.0		7.4	1.2	0.7		
15	0.0	0.0		7.4	1.1	0.5		
16	1.0	0.1	12.0	7.4	1.0	0.5		
17	0.0	0.0		7.4	1.2	0.6		
18	0.0	0.0		7.4	1.5			
19	0.0	0.0		7.4	1.3			
20	3.0	0.9	36.0	7.4	1.6	0.6		
21	0.0	0.0		7.4	1.6	0.6		
22	0.0	0.0		7.4	1.3	0.5		
23	0.0	0.0		7.4	1.1	0.4		
24	1.0	0.2	24.0	7.4	1.2	0.4		
25	4.0	0.2	6.0	7.4	2.0			
26	10.0	0.5	6.0	7.4	1.5			
27	4.0	0.2	6.0	7.4	1.1			
28	6.0	0.8	16.0	7.3	1.3	1.0		
29	0.0	0.0		7.3	1.5	1.0		
30	4.0	0.1	3.0	7.3	1.2			
31	0.0	0.0		7.3	1.7			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2551325 C.U.P. NO. 2-109-011-DU NAME OF DRINKING WATER SYSTEM: E DE LEON SYSTEM GRID PLANT No. 2
 LOCATION: 2722 South Ponte Vedra Blvd. COUNTY: St. Johns
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: April 1996
 OPERATED BY: United Water Florida Inc. NO. OF SERVICES AT END OF MONTH: 209
 AVERAGE EFFLUENT PH: 7.3 (AVG) MAIN OFFICE PHONE NO. (904) 725-2865

SIGNATURE: _____

CERTIFY THIS REPORT IS CORRECT: Roger Atwood, C.D. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE PLANT EFFLUENT	CHLORINE REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	10.0	1.4	102.0	219.5	40.0	11.9	1
PERCENTAGE	0.3	0.0	25.5	7.3	1.3	0.6	
MINIMUM	6.0	0.6	36.0	7.4	2.2	1.0	
MINIMUM	0.0	0.0	6.0	7.2	0.8	0.3	
01	0.0	0.0	7.3	1.5	0.8	1	
02	0.0	0.0	7.3	1.3	0.6		
03	0.0	0.0	7.3	1.1	0.6		
04	0.0	0.0	7.3	1.7	1.0		
05	0.0	0.0	7.3	1.9			
06	0.0	0.0	7.3	2.2			
07	0.0	0.0	7.2	1.1			
08	0.0	0.0	7.2	1.3	0.6		
09	0.0	0.0	7.2	1.3	0.5		
10	0.0	0.0	7.2	1.4	0.5		
11	0.0	0.0	7.2	1.3	0.5		
12	0.0	0.0	7.4	1.0	0.3		
13	0.0	0.0	7.4	1.1			
14	0.0	0.0	7.4	0.8			
15	0.0	0.0	7.4	0.9	0.4		
16	0.0	0.0	7.4	1.1	0.5		
17	0.0	0.0	7.4	1.1	0.5		
18	0.0	0.0	7.4	1.3	0.5		
19	0.0	0.0	7.4	1.1	0.4		
20	1.0	0.2	24.0	7.4	1.0		
21	2.0	0.6	36.0	7.3	1.8		
22	0.0	0.0	7.3	1.6	0.5		
23	0.0	0.0	7.3	1.4	0.5		
24	0.0	0.0	7.3	1.5	0.5		
25	0.0	0.0	7.3	1.4	0.5		
26	6.0	0.3	6.0	7.3	1.1	0.3	
27	0.0	0.0	7.3	1.4			
28	0.0	0.0	7.3	1.0			
29	1.0	0.3	36.0	7.3	1.8	1.0	
30	0.0	0.0	7.4	1.5	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PC DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: March 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

TREATMENT EFFLUENT PH: 7.3 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

WATER FLOW: _____

CERTIFY THIS REPORT IS CORRECT: *[Signature]*, C.O. CERT.NO. C-6202

WELL	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE PLANT EFFLUENT	CHLORINE REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
WELL 1	7.0	0.7	60.0	227.7	39.1	12.6	1
WELL 2	0.2	0.0	12.0	7.3	1.3	0.6	
WELL 3	2.0	0.3	18.0	7.5	1.8	0.9	
WELL 4	0.0	0.0	6.0	7.3	0.5	0.2	
01	0.0	0.0		7.4	1.3	0.6	
02	0.0	0.0		7.3	1.7		
03	0.0	0.0		7.3	1.5		
04	0.0	0.0		7.3	1.5	0.8	1
05	0.0	0.0		7.3	1.6	0.8	
06	0.0	0.0		7.3	1.5	0.9	
07	0.0	0.0		7.3	1.4	0.8	
08	0.0	0.0		7.3	1.3	0.6	
09	0.0	0.0		7.4	1.2		
10	1.0	0.1	12.0	7.5	1.5		
11	0.0	0.0		7.4	1.3	0.6	
12	0.0	0.0		7.5	1.0	0.7	
13	0.0	0.0		7.5	0.5	0.2	
14	0.0	0.0		7.5	0.9	0.4	
15	0.0	0.0		7.5	1.3	0.7	
16	0.0	0.0		7.4	0.5		
17	0.0	0.0		7.3	0.5		
18	0.0	0.0		7.3	0.8	0.2	
19	0.0	0.0		7.3	0.9	0.4	
20	2.0	0.1	6.0	7.3	1.4	0.8	
21	0.0	0.0		7.3	1.5	0.8	
22	0.0	0.0		7.3	1.2	0.6	
23	0.0	0.0		7.3	1.5		
24	2.0	0.3	18.0	7.3	1.3		
25	1.0	0.1	12.0	7.3	1.8	0.7	
26	0.0	0.0		7.3	1.6	0.6	
27	0.0	0.0		7.3	1.3	0.4	
28	1.0	0.1	12.0	7.3	1.3	0.5	
29	0.0	0.0		7.3	1.4	0.5	
30	0.0	0.0		7.3	1.4		
31	0.0	0.0		7.3	1.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2551325 C.U.P. NO. 2-109-011-0U

NAME OF DRINKING WATER SYSTEM: DE LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1996

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.3 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:

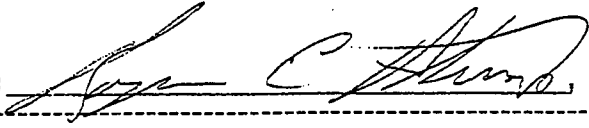

C.O. CERT.NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	5.0	1.4	138.0	7.3	32.6	13.3	1	
AVERAGE	0.2	0.0	34.5	7.3	1.1	0.7		
MAXIMUM	2.0	0.7	84.0	7.5	2.3	1.3		
MINIMUM	0.0	0.0	12.0	7.1	0.5	0.2		
01	1.0	0.1	12.0	7.4	1.2	0.5		
02	1.0	0.7	84.0	7.4	2.3	0.8		
03	0.0	0.0		7.3	0.7			
04	0.0	0.0		7.3	0.7			
05	0.0	0.0		7.3	0.7	0.2	1	
06	0.0	0.0		7.1	0.5	0.6		
07	0.0	0.0		7.4	0.5	0.8		
08	0.0	0.0		7.3	0.5	0.2		
09	0.0	0.0		7.4	0.6	0.2		
10	0.0	0.0		7.4	1.0			
11	0.0	0.0		7.4	0.8			
12	0.0	0.0		7.3	0.6	0.8		
13	0.0	0.0		7.2	0.7	0.6		
14	0.0	0.0		7.3	0.9	1.1		
15	0.0	0.0		7.3	0.9	1.3		
16	0.0	0.0		7.3	0.8	0.7		
17	0.0	0.0		7.3	1.0			
18	2.0	0.5	30.0	7.3	1.8			
19	1.0	0.1	12.0	7.3	2.0			
20	0.0	0.0		7.3	2.2	0.8		
21	0.0	0.0		7.3	1.6	0.5		
22	0.0	0.0		7.3	1.6	0.6		
23	0.0	0.0		7.3	1.5	0.6		
24	0.0	0.0		7.4	0.5			
25	0.0	0.0		7.5	1.0			
26	0.0	0.0		7.5	1.5	0.8		
27	0.0	0.0		7.5	1.6	0.8		
28	0.0	0.0		7.4	1.5	0.7		
29	0.0	0.0		7.4	1.4	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-0U

NAME OF DRINKING WATER SYSTEM: POND LEON SYSTEM GRID PLANT No. 2

LOCATION: 2722 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: January 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

INLET EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

INLET FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.O. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. DR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	12.0	0.9	74.0	227.9	37.2	15.0	1	
RANGE	0.4	0.0	12.3	7.4	1.2	0.7		
MINIMUM	6.0	0.4	24.0	7.5	1.6	1.5		
MINIMUM	0.0	0.0	2.0	7.3	0.5	0.3		
01	1.0	0.1	12.0	7.4	1.2			
02	1.0	0.1	12.0	7.3	1.3	1.5		
03	0.0	0.0		7.3	1.2	1.1		
04	0.0	0.0		7.3	1.2	1.0		
05	0.0	0.0		7.3	1.3	0.8		
06	0.0	0.0		7.3	0.5			
07	0.0	0.0		7.3	0.8			
08	0.0	0.0		7.3	0.9	0.6		
09	0.0	0.0		7.3	1.1	0.6		
10	0.0	0.0		7.3	1.3	0.6		
11	2.0	0.4	24.0	7.3	1.3	0.3	1	
12	0.0	0.0		7.3	1.6	0.4		
13	0.0	0.0		7.3	1.2			
14	0.0	0.0		7.3	1.0			
15	0.0	0.0		7.3	1.3	0.6		
16	0.0	0.0		7.3	1.5	0.6		
17	0.0	0.0		7.3	1.3	0.6		
18	0.0	0.0		7.3	1.4	0.6		
19	0.0	0.0		7.5	1.3	0.5		
20	0.0	0.0		7.5	1.0			
21	0.0	0.0		7.4	1.0			
22	0.0	0.0		7.4	1.1	0.7		
23	0.0	0.0		7.4	1.2	0.7		
24	1.0	0.1	12.0	7.4	1.2	0.6		
25	0.0	0.0		7.4	1.3	0.7		
26	0.0	0.0		7.4	1.5	0.7		
27	0.0	0.0		7.4	1.2			
28	6.0	0.1	2.0	7.4	1.0			
29	1.0	0.1	12.0	7.4	1.3	0.6		
30	0.0	0.0		7.4	1.4	0.6		
31	0.0	0.0		7.4	1.3	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2551325 C.U.P. NO. 2-109-011-OU

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

MYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	512.0	22.2	159.2	229.4	59.3	17.5	1	
AVERAGE	16.5	0.7	5.1	7.4	1.9	0.8		
MAXIMUM	47.0	2.1	6.0	7.5	3.0	1.3		
MINIMUM	4.0	0.1	3.0	7.3	1.0	0.4		
01	13.0	0.6	5.5	7.4	2.8			
02	21.0	0.8	4.6	7.4	2.6	1.0		
03	26.0	1.1	5.1	7.4	2.5	1.0		
04	23.0	1.1	5.7	7.4	1.9	1.0		
05	8.0	0.3	4.5	7.4	1.5	0.8	1	
06	17.0	0.8	5.6	7.4	1.5	0.7		
07	9.0	0.3	4.0	7.3	1.6			
08	9.0	0.4	5.3	7.3	3.0			
09	14.0	0.6	5.1	7.3	1.9	1.0		
10	17.0	0.8	5.6	7.4	2.1	0.9		
11	26.0	1.2	5.5	7.4	2.7	1.1		
12	47.0	2.1	5.4	7.4	2.5	1.1		
13	23.0	0.9	4.7	7.4	2.3	1.0		
14	18.0	0.8	5.3	7.5	2.8			
15	18.0	0.7	4.7	7.4	2.5			
16	14.0	0.6	5.1	7.4	2.8	1.3		
17	4.0	0.1	3.0	7.4	1.9	1.0		
18	8.0	0.4	6.0	7.4	1.6	0.8		
19	20.0	0.9	5.4	7.5	1.4	0.7		
20	36.0	1.6	5.3	7.4	1.5	0.7		
21	27.0	1.3	5.8	7.4	1.5			
22	4.0	0.2	6.0	7.4	1.5			
23	14.0	0.5	4.3	7.5	1.0	0.5		
24	6.0	0.3	6.0	7.4	1.8	0.4		
25	20.0	0.9	5.4	7.4	1.4			
26	10.0	0.4	4.8	7.4	1.8	0.7		
27	12.0	0.5	5.0	7.4	1.6	0.7		
28	15.0	0.5	4.0	7.4	1.3			
29	13.0	0.6	5.5	7.4	1.3			
30	13.0	0.6	5.5	7.4	1.4	0.6		
31	7.0	0.3	5.1	7.4	1.3	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

5 ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PLANT DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1996

OPERATED BY: United Water Florida Inc.


NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

SIGNATURE FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.D. CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	601.0	25.7	167.8	223.3	45.2	13.7	1	
AVERAGE	20.0	0.9	5.6	7.4	1.5	0.7		
MAXIMUM	42.0	1.7	21.0	7.5	2.6	1.1		
MINIMUM	4.0	0.3	3.8	7.4	0.5	0.2		
01	38.0	1.5	4.7	7.5	2.1	0.7		
02	42.0	1.7	4.9	7.5	2.5			
03	35.0	1.1	3.8	7.4	2.0			
04	17.0	0.8	5.6	7.4	1.0	0.5	1	
05	25.0	1.0	4.8	7.4	1.7	0.8		
06	4.0	0.7	21.0	7.4	1.2	0.6		
07	9.0	0.3	4.0	7.4	1.3	0.6		
08	19.0	0.8	5.1	7.4	1.3	0.6		
09	13.0	0.6	5.5	7.4	1.5			
10	18.0	0.8	5.3	7.4	1.8			
11	13.0	0.6	5.5	7.4	1.6	0.7		
12	14.0	0.6	5.1	7.4	1.5	0.7		
13	13.0	0.5	4.6	7.4	1.5	0.7		
14	14.0	0.7	6.0	7.4	1.6	0.7		
15	12.0	0.5	5.0	7.5	0.5	0.2		
16	14.0	0.6	5.1	7.5	1.0			
17	16.0	0.8	6.0	7.4	0.5			
18	14.0	0.6	5.1	7.5	1.5	0.7		
19	17.0	0.6	4.2	7.5	1.0	0.5		
20	19.0	0.8	5.1	7.5	1.1	0.5		
21	8.0	0.3	4.5	7.5	1.2	0.5		
22	26.0	1.1	5.1	7.5	1.1	0.5		
23	22.0	0.9	4.9	7.4	1.0			
24	22.0	1.0	5.5	7.5	1.3			
25	14.0	0.7	6.0	7.5	1.5	0.6		
26	17.0	0.6	4.2	7.5	2.0	0.9		
27	24.0	1.1	5.5	7.5	2.0	0.7		
28	32.0	1.4	5.2	7.4	2.5	0.9		
29	30.0	1.3	5.2	7.4	2.6	1.1		
30	40.0	1.7	5.1	7.4	1.8			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2551325 C.U.P. NO. 2-109-011-DU

NAME OF DRINKING WATER SYSTEM: DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1996


OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

SIGNATURE FLOW: _____

CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	RESIDUAL CHLORINE mg/L REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
DAILY	543.0	22.8	137.9	7.4	50.6	14.5	1	
WEEKLY	17.5	0.7	5.1	7.4	1.6	0.6		
MONTHLY	56.0	2.0	6.5	7.5	3.0	1.0		
QUARTERLY	0.0	0.0	3.5	7.3	0.8	0.3		
01	56.0	2.0	4.3	7.4	1.5	0.9		
02	19.0	0.9	5.7	7.4	1.6	0.9		
03	11.0	0.5	5.5	7.4	1.4	0.8		
04	2.0	0.1	6.0	7.4	1.2	0.5		
05	0.0	0.0		7.4	1.0			
06	0.0	0.0		7.4	1.0			
07	0.0	0.0		7.4	1.0	0.3		
08	0.0	0.0		7.4	0.8	0.3		
09	13.0	0.6	5.5	7.4	0.9	0.4		
10	17.0	0.5	3.5	7.4	1.2	0.5	1	
11	16.0	0.6	4.5	7.4	1.3	0.7		
12	20.0	0.6	3.6	7.4	3.0			
13	15.0	0.6	4.8	7.3	3.0			
14	21.0	0.9	5.1	7.3	2.6	1.0		
15	8.0	0.4	6.0	7.3	1.6	0.6		
16	22.0	0.9	4.9	7.3	1.7	0.6		
17	37.0	2.0	6.5	7.3	1.6	0.6		
18	34.0	1.4	4.9	7.3	2.3	0.8		
19	28.0	1.3	5.6	7.3	2.5			
20	30.0	1.2	4.8	7.3	2.6			
21	7.0	0.3	5.1	7.4	2.2	1.0		
22	18.0	0.8	5.3	7.4	2.0	0.9		
23	18.0	0.9	6.0	7.4	1.4	0.6		
24	16.0	0.6	4.5	7.4	0.9	0.4		
25	24.0	1.1	5.5	7.3	1.2	0.5		
26	16.0	0.7	5.2	7.5	1.0			
27	18.0	0.7	4.7	7.5	1.3			
28	12.0	0.6	6.0	7.5	1.3	0.6		
29	19.0	0.7	4.4	7.5	1.2	0.5		
30	26.0	1.1	5.1	7.5	2.3	0.5		
31	20.0	0.8	4.8	7.5	2.0	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-0U NAME OF DRINKING WATER SYSTEM: PON. LE LEDN SYSTEM GRID PLANT No. 3
 LOCATION: 2494 South Ponte Vedra Blvd. COUNTY: St. Johns
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: September 1996
 MAINTAINED BY: United Water Florida Inc. NO. OF SERVICES AT END OF MONTH: 209
 INFLUENT PH: 7.4 (AVG) MAIN OFFICE PHONE NO. (904) 725-2865

INFLUENT FLOW: _____

CERTIFY THIS REPORT IS CORRECT: *[Signature]* C.O. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	1170.0	52.6	161.8	222.1	60.0	19.1	1	
RANGE	39.0	1.8	5.4	7.4	2.0	1.0		
MINIMUM	74.0	3.6	6.0	7.5	3.0	1.3		
MINIMUM	23.0	1.0	4.9	7.3	1.2	0.7		
01	28.0	1.3	5.6	7.5	3.0			
02	34.0	1.5	5.3	7.5	2.2			
03	23.0	1.0	5.2	7.5	2.1	1.0		
04	74.0	3.6	5.8	7.5	2.5	1.3		
05	26.0	1.2	5.5	7.5	2.3	1.2		
06	42.0	1.9	5.4	7.5	2.1	1.0		
07	42.0	1.9	5.4	7.4	2.3			
08	39.0	1.9	5.8	7.4	1.8			
09	33.0	1.5	5.5	7.3	2.3	0.8		
10	36.0	1.6	5.3	7.3	2.1	0.8		
11	32.0	1.5	5.6	7.3	1.8	0.7		
12	37.0	1.5	4.9	7.3	1.6	0.7	1	
13	24.0	1.2	6.0	7.3	1.8	0.8		
14	45.0	2.0	5.3	7.3	1.3			
15	47.0	2.1	5.4	7.4	1.5			
16	30.0	1.3	5.2	7.4	1.4	0.7		
17	27.0	1.3	5.8	7.4	2.1	0.9		
18	52.0	2.3	5.3	7.4	2.0	0.9		
19	50.0	2.4	5.8	7.4	2.2	1.0		
20	52.0	2.3	5.3	7.4	2.3	1.2		
21	39.0	1.8	5.5	7.3	2.5			
22	43.0	2.0	5.6	7.4	2.8			
23	34.0	1.5	5.3	7.4	2.4	1.2		
24	38.0	1.6	5.1	7.4	2.0	1.0		
25	34.0	1.5	5.3	7.4	1.8	1.0		
26	29.0	1.2	5.0	7.4	1.7	1.1		
27	34.0	1.4	4.9	7.5	2.2	1.0		
28	56.0	2.4	5.1	7.5	1.2			
29	57.0	2.4	5.1	7.4	1.3			
30	33.0	1.5	5.5	7.4	1.4	0.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: POM

LEON SYSTEM GRID PLANT No. 3

ADDRESS: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

BY: United Water Florida Inc.

REPORTING MONTH: August 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

WATER FLOW: _____

I CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
LY	1516.0	75.9	184.6	230.0	58.4	20.7	1	
GE	48.9	2.4	6.0	7.4	1.9	0.9		
UM	80.0	4.9	8.5	7.5	3.0	1.3		
UM	22.0	1.1	5.1	7.3	0.8	0.3		
01	68.0	3.1	5.5	7.4	0.8	0.3		
02	42.0	2.1	6.0	7.4	1.1	0.4		
03	40.0	1.9	5.7	7.5	3.0			
04	58.0	2.9	6.0	7.4	2.3			
05	50.0	2.5	6.0	7.4	2.1	0.8	1	
06	60.0	2.9	5.8	7.4	1.7	0.8		
07	64.0	3.2	6.0	7.4	1.5	0.7		
08	61.0	2.9	5.7	7.4	1.5	0.6		
09	75.0	3.7	5.9	7.4	1.3	0.6		
10	74.0	3.8	6.2	7.4	2.0			
11	40.0	1.9	5.7	7.4	1.8			
12	35.0	1.7	5.8	7.4	1.7	0.9		
13	40.0	2.2	6.6	7.4	2.3	1.1		
14	39.0	1.9	5.8	7.4	2.1	1.0		
15	41.0	2.0	5.9	7.4	1.9	1.0		
16	69.0	4.9	8.5	7.4	1.6	1.0		
17	63.0	3.2	6.1	7.3	1.0			
18	43.0	2.1	5.9	7.4	0.9			
19	56.0	2.8	6.0	7.4	0.9	0.4		
20	42.0	2.2	6.3	7.4	1.7	0.8		
21	49.0	2.4	5.9	7.4	1.8	0.8		
22	45.0	2.2	5.9	7.4	1.5	0.7		
23	80.0	4.0	6.0	7.4	2.8	1.3		
24	44.0	2.1	5.7	7.5	2.1			
25	48.0	2.5	6.3	7.5	2.0			
26	31.0	1.4	5.4	7.5	2.0	1.0		
27	34.0	1.8	6.4	7.5	2.6	1.3		
28	22.0	1.1	6.0	7.5	2.4	1.3		
29	40.0	1.7	5.1	7.3	2.5	1.3		
30	27.0	1.2	5.3	7.5	2.5	1.3		
31	36.0	1.6	5.3	7.5	3.0	1.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: Ponce de Leon System Grid Plant No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: July 1996

MAINTAINED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

INLET EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

INLET FLOW: _____

CERTIFY THIS REPORT IS CORRECT: [Signature], C.O. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	1466.0	75.4	191.4	228.3	51.3	18.4	1	
MORNING	47.3	2.4	6.2	7.4	1.7	0.9		
AFTERNOON	87.0	4.5	6.9	7.5	2.5	1.5		
EVENING	23.0	1.1	5.6	7.3	0.5	0.3		
01	41.0	1.9	5.6	7.3	1.8	0.9		
02	32.0	1.8	6.8	7.3	2.3	1.2		
03	44.0	2.2	6.0	7.3	2.0	0.9		
04	58.0	3.0	6.2	7.5	0.5			
05	41.0	2.1	6.1	7.4	2.5			
06	33.0	1.9	6.9	7.5	2.5			
07	37.0	1.9	6.2	7.5	2.5			
08	27.0	1.3	5.8	7.5	2.5	1.5	1	
09	23.0	1.1	5.7	7.4	2.2	1.3		
10	34.0	1.8	6.4	7.4	2.3	1.3		
11	26.0	1.4	6.5	7.4	2.1	1.2		
12	26.0	1.3	6.0	7.4	2.0	1.0		
13	41.0	2.2	6.4	7.4	2.5			
14	38.0	2.0	6.3	7.4	2.0			
15	38.0	1.9	6.0	7.4	2.1	1.2		
16	27.0	1.3	5.8	7.3	0.5	0.3		
17	50.0	2.6	6.2	7.3	0.9	0.4		
18	58.0	2.9	6.0	7.3	1.3	0.6		
19	63.0	3.3	6.3	7.3	1.3	0.6		
20	49.0	2.6	6.4	7.3	1.2			
21	79.0	4.0	6.1	7.3	1.4			
22	58.0	3.0	6.2	7.3	1.6	1.0		
23	50.0	2.6	6.2	7.3	1.5	1.0		
24	50.0	2.5	6.0	7.3	1.5	0.8		
25	51.0	2.6	6.1	7.3	0.9	0.4		
26	48.0	2.5	6.3	7.3	1.2	0.7		
27	83.0	4.1	5.9	7.3	1.2			
28	87.0	4.5	6.2	7.4	0.8			
29	59.0	3.0	6.1	7.4	1.3	0.7		
30	60.0	3.0	6.0	7.4	1.4	0.7		
31	55.0	3.1	6.8	7.4	1.5	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: June 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

INFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

WASTEWATER FLOW: _____

CERTIFY THIS REPORT IS CORRECT: Kenneth A. ..., C.O. CERT. NO. C-3323

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	1018.0	49.2	167.5	222.4	47.5	12.7	1
AVERAGE	33.9	1.6	5.6	7.4	1.6	0.6	
MINIMUM	180.0	8.5	10.2	7.5	3.0	1.2	
MAXIMUM	5.0	0.2	4.0	7.2	0.6	0.2	
01	24.0	1.1	5.5	7.3	1.3		
02	33.0	1.3	4.7	7.5	1.4		
03	17.0	0.8	5.6	7.5	1.7	0.6	
04	15.0	0.5	4.0	7.5	1.5	0.6	
05	21.0	0.9	5.1	7.5	1.3	0.5	1
06	48.0	2.8	7.0	7.5	1.4	0.6	
07	18.0	0.9	6.0	7.5	1.2	0.5	
08	18.0	0.7	4.7	7.5	3.0		
09	33.0	2.8	10.2	7.5	1.2		
10	8.0	0.3	4.5	7.5	1.3	0.5	
11	5.0	0.2	4.8	7.5	1.0	0.5	
12	19.0	0.8	5.1	7.4	1.1	0.5	
13	41.0	1.6	4.7	7.4	1.1	0.5	
14	43.0	1.8	5.0	7.4	1.6	0.6	
15	21.0	0.9	5.1	7.3	1.0		
16	47.0	1.7	4.3	7.4	1.1		
17	31.0	1.2	4.6	7.4	0.6	0.2	
18	20.0	0.8	4.8	7.4	1.2	0.4	
19	37.0	1.6	5.2	7.4	1.4	0.5	
20	180.0	8.5	5.7	7.4	1.2	0.5	* High flows due to
21	104.0	6.5	7.5	7.4	1.1	0.3	* main break
22	8.0	0.4	6.0	7.4	0.6		
23	8.0	0.4	6.0	7.3	1.5		
24	12.0	0.6	6.0	7.3	1.4	0.6	
25	64.0	3.2	6.0	7.3	3.0	0.9	
26	32.0	1.6	6.0	7.4	2.8	0.6	
27	18.0	0.9	6.0	7.4	2.4	0.9	
28	28.0	1.4	6.0	7.4	2.8	1.2	
29	29.0	1.6	6.6	7.5	2.3		
30	35.0	1.4	4.7	7.2	3.0	1.2	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-0U NAME OF DRINKING WATER SYSTEM: F DE LEON SYSTEM GRID PLANT No. 3
 LOCATION: 2494 South Ponte Vedra Blvd. COUNTY: St. Johns
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: May 1996
 RATED BY: United Water Florida Inc. NO. OF SERVICES AT END OF MONTH: 209
 INFLUENT PH: 7.4 (AVG) MAIN OFFICE PHONE NO. (904) 725-2865

IGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

S PH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/L	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS	
		mg/L		PLANT EFFLUENT	REMOTE TAP		
THLY TAL	796.0	68.1	284.9	229.2	50.8	19.7	1
RAGE	25.7	2.2	9.2	7.4	1.6	0.9	
IMUM	58.0	8.2	24.0	7.5	3.3	1.9	
IMUM	4.0	0.2	2.8	7.3	0.5	0.2	
01	14.0	0.6	5.1	7.3	2.3	0.8	
02	16.0	1.9	14.3	7.3	1.8	0.9	1
03	17.0	0.4	2.8	7.4	2.0	0.8	
04	28.0	0.8	3.4	7.5	1.5		
05	20.0	0.5	3.0	7.4	1.3		
06	21.0	2.5	14.3	7.4	1.8	1.4	
07	29.0	3.4	14.1	7.4	2.2	1.6	
08	32.0	4.3	16.1	7.4	2.3	1.5	
09	43.0	5.6	15.6	7.4	1.0	0.3	
10	52.0	6.8	15.7	7.4	2.1	0.5	
11	23.0	0.6	3.1	7.4	3.0		
12	22.0	0.6	3.3	7.5	0.5		
13	22.0	0.6	3.3	7.5	1.2	0.4	
14	9.0	0.3	4.0	7.5	0.6	0.2	
15	24.0	0.9	4.5	7.5	1.0	0.3	
16	17.0	0.6	4.2	7.5	1.2	0.3	
17	22.0	0.7	3.8	7.4	1.1	0.4	
18	58.0	8.2	17.0	7.4	1.7		
19	38.0	5.4	17.1	7.4	1.8		
20	39.0	5.9	18.2	7.4	2.0	1.3	
21	14.0	2.4	20.6	7.4	2.6	1.4	
22	28.0	5.6	24.0	7.4	3.0	1.6	
23	23.0	0.9	4.7	7.4	3.3	1.9	
24	37.0	1.3	4.2	7.4	1.6	0.8	
25	30.0	1.4	5.6	7.4	0.8		
26	52.0	2.2	5.1	7.3	1.0		
27	39.0	1.7	5.2	7.3	1.1		
28	10.0	1.2	14.4	7.3	1.6	1.0	
29	5.0	0.2	4.8	7.3	1.3	0.8	
30	8.0	0.3	4.5	7.3	0.9	0.6	
31	4.0	0.3	9.0	7.3	1.2	0.9	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-00

NAME OF DRINKING WATER SYSTEM: DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: April 1996

MAINTAINED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

INFLUENT PH: 7.3 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

IGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT: Roger Atwood, C.O. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	598.0	60.9	336.0	220.4	59.9	18.2	1	
AVERAGE	19.9	2.0	11.2	7.3	2.0	0.9		
MINIMUM	53.0	6.3	25.2	7.4	3.3	1.4		
MAXIMUM	3.0	0.1	2.2	7.2	0.5	0.4		
01	9.0	0.6	8.0	7.4	1.5	0.8	1	
02	8.0	1.0	15.0	7.4	1.0	0.4		
03	13.0	1.6	14.8	7.4	1.2	0.5		
04	10.0	2.1	25.2	7.3	1.8	1.0		
05	19.0	2.2	13.9	7.4	2.5			
06	7.0	0.8	13.7	7.3	2.2			
07	19.0	1.8	11.4	7.2	2.8			
08	8.0	0.9	13.5	7.2	3.3	1.0		
09	13.0	1.0	9.2	7.2	2.8	1.0		
10	15.0	1.6	12.8	7.2	2.8	1.1		
11	32.0	3.9	14.6	7.2	3.0	1.1		
12	18.0	0.4	2.7	7.4	3.0	1.3		
13	22.0	0.6	3.3	7.4	0.8			
14	11.0	0.2	2.2	7.4	0.5			
15	4.0	0.1	3.0	7.4	0.7	0.4		
16	3.0	0.1	4.0	7.4	0.8	0.4		
17	9.0	0.3	4.0	7.4	1.0	0.4		
18	15.0	0.4	3.2	7.4	1.0	0.4		
19	14.0	0.4	3.4	7.4	0.9	0.4		
20	53.0	6.3	14.3	7.3	1.4			
21	32.0	3.2	12.0	7.4	2.5			
22	27.0	3.3	14.7	7.4	1.8	0.8		
23	13.0	1.6	14.8	7.4	2.6	1.3		
24	26.0	3.2	14.8	7.4	2.8	1.3		
25	27.0	3.7	16.4	7.4	2.6	1.3		
26	28.0	3.3	14.1	7.4	3.3	1.4		
27	52.0	5.2	12.0	7.3	3.0			
28	53.0	6.3	14.3	7.3	1.0			
29	24.0	2.9	14.5	7.3	2.8	1.0		
30	14.0	1.9	16.3	7.4	2.5	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2551325 C.U.P. NO. 2-109-011-DU

NAME OF DRINKING WATER SYSTEM: PO DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: March 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

INLET EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	277.0	30.5	344.6	229.5	65.6	18.3	1	
AVERAGE	8.9	1.0	12.8	7.4	2.1	0.9		
MINIMUM	31.0	3.7	21.3	7.5	3.0	1.4		
MAXIMUM	0.0	0.0	3.0	7.4	0.5	0.3		
01	9.0	1.3	17.3	7.4	2.3	0.7		
02	0.0	0.0		7.4	2.9			
03	8.0	0.9	13.5	7.4	2.5			
04	4.0	0.4	12.0	7.4	3.0	1.4	1	
05	13.0	1.4	12.9	7.4	2.5	1.3		
06	5.0	0.6	14.4	7.4	2.3	1.1		
07	9.0	0.9	12.0	7.4	2.2	1.0		
08	19.0	2.0	12.6	7.4	2.3	1.0		
09	4.0	0.7	21.0	7.4	2.1			
10	14.0	1.9	16.3	7.4	2.5			
11	0.0	0.0		7.4	2.8	1.2		
12	8.0	0.7	10.5	7.4	2.0	1.0		
13	8.0	0.8	12.0	7.4	3.0	1.4		
14	13.0	1.6	14.8	7.4	2.8	1.3		
15	10.0	1.2	14.4	7.4	2.0	0.8		
16	7.0	0.2	3.4	7.4	3.0			
17	8.0	0.2	3.0	7.5	0.5			
18	0.0	0.0		7.4	0.9	0.3		
19	10.0	1.1	13.2	7.4	0.6	0.4		
20	4.0	0.4	12.0	7.4	1.7	0.4		
21	9.0	1.6	21.3	7.4	1.6	0.5		
22	23.0	2.6	13.6	7.4	2.0	0.9		
23	24.0	2.3	11.5	7.4	2.3			
24	31.0	3.7	14.3	7.4	1.6			
25	4.0	0.4	12.0	7.4	2.2	0.7		
26	8.0	0.6	9.0	7.4	2.4	0.8		
27	8.0	0.9	13.5	7.4	2.1	0.8		
28	9.0	1.2	16.0	7.4	1.9	0.7		
29	0.0	0.3		7.4	1.6	0.6		
30	4.0	0.3	9.0	7.4	1.8			
31	4.0	0.3	9.0	7.4	2.2			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2551325 C.U.P. NO. 2-109-011-0U

NAME OF DRINKING WATER SYSTEM: DE LEON SYSTEM GRID PLANT No. 3

LOCATION: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

AVERAGE EFFLUENT PH: 7.3 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW: _____

CERTIFY THIS REPORT IS CORRECT:



C.O. CERT. NO. C-6202

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	393.0	45.7	376.0	211.7	69.8	17.7	1	
AVERAGE	13.6	1.6	14.5	7.3	2.4	0.9		
MAXIMUM	102.0	10.3	36.0	7.5	3.5	1.5		
MINIMUM	0.0	0.0	4.0	7.0	1.1	0.2		
01	0.0	0.0		7.4	1.2	0.5		
02	3.0	0.2	8.0	7.4	1.5	0.8		
03	4.0	0.9	27.0	7.3	2.7			
04	43.0	6.0	16.7	7.3	2.9			
05	102.0	10.3	12.1	7.3	1.1	0.2	1	
06	27.0	4.1	18.2	7.1	1.3	0.6		
07	13.0	2.2	20.3	7.0	2.8	0.8		
08	22.0	3.0	16.4	7.1	2.5	0.2		
09	18.0	2.2	14.7	7.3	2.3	0.6		
10	23.0	2.9	15.1	7.4	3.5			
11	16.0	2.3	17.3	7.4	3.5			
12	0.0	0.0		7.2	1.4	0.6		
13	5.0	0.9	21.6	7.1	1.5	0.8		
14	3.0	0.1	4.0	7.2	1.8	0.9		
15	9.0	1.1	14.7	7.2	2.5	1.3		
16	9.0	1.1	14.7	7.3	2.6	1.2		
17	8.0	0.9	13.5	7.3	2.5			
18	1.0	0.3	36.0	7.3	2.3			
19	6.0	0.4	8.0	7.4	2.5			
20	10.0	1.2	14.4	7.3	2.3	0.7		
21	8.0	0.7	10.5	7.3	2.1	0.7		
22	4.0	0.5	15.0	7.3	3.0	1.1		
23	5.0	0.7	16.8	7.3	3.0	1.1		
24	19.0	0.9	5.7	7.5	3.0			
25	18.0	1.8	12.0	7.4	3.0			
26	0.0	0.0		7.4	3.0	1.5		
27	9.0	0.4	5.3	7.4	2.8	1.4		
28	4.0	0.4	12.0	7.4	2.7	1.4		
29	4.0	0.2	6.0	7.4	2.5	1.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2551325 C.U.P. NO. 2-109-011-0U

NAME OF DRINKING WATER SYSTEM: PONCE DE LEON SYSTEM GRID PLANT No. 3

ADDRESS: 2494 South Ponte Vedra Blvd.

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: January 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 209

EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

IN FLOW: _____

VERIFY THIS REPORT IS CORRECT:  C.O. CERT. NO. C-6202

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
12/31	180.0	18.2	181.3	228.0	51.0	15.6	1	
12/30	5.8	0.6	7.6	7.4	1.6	0.7		
12/29	60.0	9.4	20.0	7.5	3.0	1.4		
12/28	0.0	0.0	3.0	7.3	0.8	0.4		
12/27	0.0	0.0		7.3	2.5			
12/26	2.0	0.1	6.0	7.3	2.6	1.3		
12/25	3.0	0.5	20.0	7.3	2.2	1.1		
12/24	0.0	0.0		7.3	2.6	1.4		
12/23	8.0	0.8	12.0	7.3	1.4	1.0		
12/22	12.0	1.8	18.0	7.3	0.8			
12/21	21.0	2.5	14.3	7.3	3.0			
12/20	60.0	9.4	18.8	7.3	2.6	1.3		
12/19	4.0	0.3	9.0	7.3	1.3	0.6		
12/18	4.0	0.2	6.0	7.3	1.8	0.8		
12/17	7.0	0.3	5.1	7.3	2.0	0.4	1	
12/16	4.0	0.2	6.0	7.3	2.2	0.6		
12/15	4.0	0.1	3.0	7.3	2.4			
12/14	5.0	0.2	4.8	7.3	2.0			
12/13	4.0	0.2	6.0	7.3	1.6	0.6		
12/12	7.0	0.2	3.4	7.3	1.4	0.5		
12/11	0.0	0.0		7.4	1.3	0.5		
12/10	4.0	0.1	3.0	7.4	1.1	0.4		
12/9	0.0	0.0		7.4	1.2	0.4		
12/8	4.0	0.2	6.0	7.5	1.0			
12/7	0.0	0.0		7.5	1.1			
12/6	4.0	0.2	6.0	7.4	1.0	0.6		
12/5	4.0	0.2	6.0	7.4	1.1	0.6		
12/4	0.0	0.0		7.4	1.3	0.6		
12/3	3.0	0.1	4.0	7.4	1.3	0.5		
12/2	2.0	0.1	6.0	7.4	1.1	0.5		
12/1	2.0	0.1	6.0	7.4	1.2			
11/30	5.0	0.2	4.8	7.4	1.7			
11/29	0.0	0.0		7.4	1.5	0.7		
11/28	4.0	0.1	3.0	7.4	1.3	0.6		
11/27	3.0	0.1	4.0	7.4	1.4	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2550908 C.U.P. NO. 2-109-011-BN

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: December 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

AVERAGE EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

SIGNATURE FLOW _____

CERTIFY THIS REPORT IS CORRECT: *J. J. [Signature]*, C.D. CERT. NO. 5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	1226.0	76.4	218.0	231.4	18.6	6.6	5	
AVERAGE	39.5	2.5	7.5	7.5	0.6	0.3		
MAXIMUM	87.0	5.0	33.3	7.5	1.5	0.7		
MINIMUM	0.0	0.0	0.2	7.2	0.5	0.2		
01	0.0	0.0		7.3	0.6			
02	1.0	0.1	12.0	7.5	0.5	0.5		
03	0.0	0.0		7.5	0.8	0.5		
04	2.0	0.1	6.0	7.5	0.5	0.5		
05	2.0	0.1	6.0	7.5	1.5	0.7	5	
06	25.0	0.1	0.5	7.5	0.5	0.6		
07	71.0	0.1	0.2	7.4	0.5			
08	1.0	0.1	12.0	7.4	0.5			
09	4.0	0.1	3.0	7.4	0.6	0.3		
10	49.0	0.1	0.2	7.4	0.5	0.2		
11	31.0	0.1	0.4	7.5	0.5	0.2		
12	6.0	0.1	2.0	7.5	0.5	0.2		
13	48.0	0.1	0.3	7.5	0.6	0.2		
14	36.0	0.1	0.3	7.5	0.5			
15	25.0	0.1	0.5	7.4	0.8			
16	31.0	0.1	0.4	7.4	0.7	0.2		
17	35.0	5.0	17.1	7.5	0.5	0.2		
18	87.0	5.0	6.9	7.5	0.5	0.2		
19	55.0	5.0	10.9	7.5	0.5	0.2		
20	62.0	5.0	9.7	7.5	0.5	0.2		
21	71.0	5.0	8.5	7.5	0.5			
22	75.0	5.0	8.0	7.2	0.5			
23	73.0	5.0	8.2	7.5	0.5	0.2		
24	62.0	5.0	9.7	7.5	0.6	0.3		
25	63.0	5.0	9.5	7.5	0.7	0.2		
26	79.0	5.0	7.6	7.5	0.7	0.3		
27	53.0	5.0	11.3	7.5	0.6	0.2		
28	53.0	5.0	11.3	7.5	0.5			
29	53.0	5.0	11.3	7.5	0.5			
30	55.0	5.0	10.9	7.5	0.7	0.2		
31	18.0	5.0	33.3	7.5	0.7	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponve Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: November 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

AVERAGE EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DIRECTION OF FLOW _____

CERTIFY THIS REPORT IS CORRECT: J. G. [Signature], C.O. CERT. NO. 5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	RESIDUAL CHLORINE mg/L REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	1559.0	101.3	89.2	7.5	30.0	14.2	5	
AVERAGE	52.0	3.4	6.9	7.5	1.0	0.7		
MINIMUM	197.0	11.0	9.9	7.5	2.9	1.5		
MAXIMUM	0.0	0.0	0.9	7.3	0.3	0.3		
01	197.0	11.0	6.7	7.5	0.9	0.6		
02	130.0	10.0	9.2	7.3	1.8			
03	141.0	10.0	8.5	7.4	2.2			
04	146.0	9.0	7.4	7.4	1.0	0.8	5	
05	191.0	10.0	6.3	7.4	1.2	0.4		
06	134.0	11.0	9.9	7.4	1.0	0.3		
07	169.0	10.0	7.1	7.5	1.1	1.1		
08	117.0	9.0	9.2	7.5	1.0	1.0		
09	172.0	11.0	7.7	7.5	1.0			
10	139.0	10.0	8.6	7.5	1.4			
11	0.0	0.0		7.5	1.2	0.6		
12	0.0	0.0		7.5	0.4	0.4		
13	0.0	0.0		7.5	0.7	0.7		
14	0.0	0.0		7.5	0.5	0.5		
15	0.0	0.0		7.4	2.9	1.1		
16	0.0	0.0		7.4	0.5			
17	0.0	0.0		7.5	1.0			
18	0.0	0.0		7.5	1.0	1.0		
19	0.0	0.0		7.5	0.8	0.4		
20	0.0	0.0		7.5	0.9	0.9		
21	2.0	0.1	6.0	7.5	0.7	0.7		
22	0.0	0.0		7.4	0.6	0.4		
23	0.0	0.0		7.5	0.7			
24	0.0	0.0		7.4	0.9			
25	0.0	0.0		7.5	0.9	0.9		
26	0.0	0.0		7.5	1.2	1.5		
27	0.0	0.0		7.5	0.9	0.9		
28	0.0	0.0		7.5	0.8			
29	14.0	0.1	0.9	7.5	0.5			
30	7.0	0.1	1.7	7.5	0.3			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

CATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

AVERAGE EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

SIGNATURE FLOW _____

CERTIFY THIS REPORT IS CORRECT: *[Signature]*, C.O. CERT. NO. 5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	3980.0	336.0	365.3	7.5	51.8	17.2	5	
AVERAGE	128.4	10.8	11.8	7.5	1.7	0.7		
MAXIMUM	210.0	17.0	33.3	7.6	3.0	1.0		
MINIMUM	54.0	4.0	4.4	7.3	0.5	0.2		
01	85.0	13.0	18.4	7.5	1.6	1.0		
02	147.0	16.0	13.1	7.5	0.7	0.7		
03	123.0	17.0	16.6	7.5	1.0	1.0		
04	151.0	14.0	11.1	7.3	0.9	0.2		
05	122.0	16.0	15.7	7.3	1.2			
06	72.0	15.0	25.0	7.4	0.8			
07	60.0	15.0	30.0	7.5	3.0	0.4		
08	54.0	15.0	33.3	7.5	3.0	0.8		
09	86.0	10.0	14.0	7.5	3.0	0.5		
10	80.0	10.0	15.0	7.5	2.2	0.7	5	
11	96.0	10.0	12.5	7.5	1.5	0.6		
12	82.0	10.0	14.6	7.3	3.0			
13	132.0	10.0	9.1	7.4	3.0			
14	112.0	10.0	10.7	7.5	1.5	0.8		
15	98.0	9.0	11.0	7.5	3.0	0.8		
16	180.0	11.0	7.3	7.5	1.0	1.0		
17	104.0	9.0	10.4	7.5	1.0	1.0		
18	165.0	6.0	4.4	7.5	0.7	0.7		
19	90.0	4.0	5.3	7.4	2.0			
20	138.0	6.0	5.2	7.6	1.1			
21	119.0	9.0	9.1	7.5	0.8	0.8		
22	182.0	10.0	6.6	7.5	0.7	0.7		
23	147.0	10.0	8.2	7.5	3.0	1.0		
24	169.0	10.0	7.1	7.5	1.6	0.9		
25	172.0	11.0	7.7	7.5	1.7	0.9		
26	203.0	10.0	5.9	7.5	3.0			
27	144.0	9.0	7.5	7.5	3.0			
28	198.0	11.0	6.7	7.5	0.9	0.9		
29	126.0	9.0	8.6	7.5	0.5	0.4		
30	210.0	11.0	6.3	7.5	0.7	0.7		
31	133.0	10.0	9.0	7.5	0.7	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Pon. /edra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

ID BY: United Water Florida Inc.

REPORTING MONTH: September 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

INLET EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DRAIN FLOW _____

I CERTIFY THIS REPORT IS CORRECT: Joe [Signature], C.O. CERT. NO. 5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/L	PLANT EFFLUENT	REMOTE TAP				
DAILY TOTAL	8963.0	443.0	188.3	224.5	72.0	21.3	5	
AVERAGE	298.8	14.8	6.3	7.5	2.4	1.1		
MINIMUM	439.0	17.0	10.0	7.5	3.0	2.5		
MAXIMUM	143.0	8.0	3.3	7.3	1.0	0.4		
01	362.0	15.0	5.0	7.5	3.0			
02	398.0	17.0	5.1	7.5	3.0			
03	286.0	13.0	5.5	7.5	3.0	1.1		
04	378.0	16.0	5.1	7.5	2.7	2.0		
05	439.0	12.0	3.3	7.5	1.1	1.1		
06	406.0	16.0	4.7	7.4	2.5	2.5		
07	277.0	16.0	6.9	7.3	2.6			
08	286.0	16.0	6.7	7.4	2.3			
09	428.0	17.0	4.8	7.5	1.0	1.0		
10	223.0	14.0	7.5	7.5	3.0	1.4		
11	250.0	17.0	8.2	7.5	1.7	1.0		
12	252.0	13.0	6.2	7.5	3.0	2.0		
13	370.0	14.0	4.5	7.5	1.1	1.1		
14	349.0	14.0	4.8	7.5	3.0			
15	426.0	16.0	4.5	7.5	2.0			
16	319.0	15.0	5.6	7.5	1.5	1.4		
17	156.0	13.0	10.0	7.5	3.0	1.4	5	
18	247.0	16.0	7.8	7.5	1.0	1.0		
19	230.0	17.0	8.9	7.5	1.0	0.5		
20	247.0	16.0	7.8	7.5	3.0	0.5		
21	143.0	8.0	6.7	7.4	2.5			
22	284.0	12.0	5.1	7.5	3.0			
23	217.0	14.0	7.7	7.5	3.0	0.4		
24	296.0	15.0	6.1	7.5	3.0	0.6		
25	252.0	16.0	7.6	7.5	3.0	0.5		
26	289.0	13.0	5.4	7.5	3.0	0.5		
27	339.0	15.0	5.3	7.5	1.0	0.4		
28	341.0	15.0	5.3	7.5	3.0			
29	233.0	17.0	8.8	7.5	3.0			
30	240.0	15.0	7.5	7.5	3.0	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Piedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: August 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

AVERAGE EFFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DAILY AVERAGE FLOW _____

CERTIFY THIS REPORT IS CORRECT: ASG, C.O. CERT. NO. 5577

METER	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
ADULT	10216.0	455.0	166.9	7.5	67.0	24.9	5	
AGE	329.5	14.7	5.4	7.5	2.2	1.1		
MUM	425.0	18.0	6.6	7.7	3.0	1.8		
MUM	251.0	11.0	3.8	7.4	0.7	0.2		
01	274.0	13.0	5.7	7.5	1.5	0.8		
02	390.0	15.0	4.6	7.5	2.5	1.4		
03	329.0	15.0	5.5	7.5	2.3			
04	338.0	17.0	6.0	7.5	3.0			
05	320.0	16.0	6.0	7.5	3.0	1.4		
06	292.0	13.0	5.3	7.5	3.0	1.0	5	
07	357.0	16.0	5.4	7.5	2.2	1.3		
08	347.0	11.0	3.8	7.5	3.0	1.5		
09	284.0	15.0	6.3	7.5	3.0	0.9		
10	284.0	15.0	6.3	7.4	2.8			
11	285.0	13.0	5.5	7.4	2.9			
12	400.0	17.0	5.1	7.5	2.5	1.8		
13	322.0	13.0	4.8	7.5	2.0	1.3		
14	391.0	18.0	5.5	7.5	1.2	1.2		
15	326.0	13.0	4.8	7.5	1.5	0.2		
16	351.0	17.0	5.8	7.5	1.2	1.2		
17	255.0	14.0	6.6	7.4	0.7			
18	317.0	17.0	6.4	7.4	1.2			
19	320.0	15.0	5.6	7.5	1.2	1.2		
20	337.0	14.0	5.0	7.5	2.3	1.4		
21	307.0	13.0	5.1	7.5	1.2	1.2		
22	339.0	15.0	5.3	7.5	3.0	1.5		
23	346.0	16.0	5.5	7.5	3.0	1.2		
24	290.0	12.0	5.0	7.7	3.0			
25	251.0	12.0	5.7	7.5	2.5			
26	425.0	18.0	5.1	7.5	3.0	0.9		
27	350.0	15.0	5.1	7.5	1.7	1.2		
28	314.0	14.0	5.4	7.5	1.1	1.1		
29	338.0	13.0	4.6	7.5	2.5	0.2		
30	406.0	15.0	4.4	7.5	1.0	1.0		
31	331.0	15.0	5.4	7.5	2.0			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Pe... Vebra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: June 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

INFLUENT PH: 7.5 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

INFLUENT FLOW _____

CERTIFY THIS REPORT IS CORRECT: [Signature], C.O. CERT. NO. 5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP			
DAILY TOTAL	9788.0	587.0	225.1	224.1	72.7	10.1	5	
AVERAGE	326.3	19.6	7.5	7.5	2.4	0.5		
MINIMUM	721.0	27.0	10.0	7.5	3.0	2.0		
MAXIMUM	187.0	13.0	3.0	7.3	0.5	0.2		
01	721.0	18.0	3.0	7.5	1.7			
02	333.0	13.0	4.7	7.3	0.7			
03	315.0	20.0	7.6	7.5	2.2	0.3		
04	334.0	18.0	6.5	7.5	1.7	0.2		
05	355.0	20.0	6.8	7.5	3.0	0.2		
06	313.0	20.0	7.7	7.5	2.0	0.3	5	
07	311.0	19.0	7.3	7.5	3.0	0.4		
08	374.0	26.0	8.3	7.5	2.4			
09	241.0	16.0	8.0	7.5	0.5			
10	366.0	23.0	7.5	7.5	3.0	0.2		
11	285.0	19.0	8.0	7.5	3.0	0.2		
12	365.0	20.0	6.6	7.5	3.0	2.0		
13	377.0	27.0	8.6	7.5	3.0	0.2		
14	282.0	20.0	8.5	7.5	2.5	0.3		
15	293.0	20.0	8.2	7.3	2.0			
16	204.0	17.0	10.0	7.4	2.7			
17	293.0	20.0	8.2	7.5	3.0	1.2		
18	327.0	19.0	7.0	7.5	3.0	0.2		
19	264.0	22.0	10.0	7.5	3.0	0.2		
20	332.0	19.0	6.9	7.5	3.0	0.2		
21	365.0	21.0	6.9	7.5	1.7	0.9		
22	225.0	17.0	9.1	7.4	1.0			
23	392.0	20.0	6.1	7.4	2.9			
24	370.0	20.0	6.5	7.5	3.0	0.2		
25	361.0	19.0	6.3	7.5	3.0	0.4		
26	334.0	21.0	7.5	7.5	1.2	0.3		
27	305.0	21.0	8.3	7.5	3.0	0.2		
28	294.0	21.0	8.6	7.5	3.0	2.0		
29	187.0	14.0	9.0	7.5	2.8			
30	270.0	17.0	7.6	7.3	2.7			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

2550908 C.U.P. NO. 2-109-011-9N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

ADDRESS: 71 State Road A1A

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: May 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

AVERAGE EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

WATER FLOW _____

CERTIFY THIS REPORT IS CORRECT: *L. J. [Signature]* , C.O. CERT. NO. 5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED		mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	7238.0	437.0	168.7	171.3	53.1	18.7	5	
AVERAGE	314.7	19.0	7.3	7.4	2.3	1.2		
MINIMUM	453.0	24.0	10.2	7.5	3.0	2.5		
MINIMUM	231.0	8.0	3.8	6.9	0.5	0.2		

01								
02								
03								
04								
05								
06								
07								
08								
09	251.0	8.0	3.8	6.9	2.0	0.2		Plant back in service after painting
10	231.0	15.0	7.8	7.5	0.5	0.2		
11	248.0	15.0	7.3	7.5	3.0			
12	355.0	15.0	5.1	7.4	3.0			
13	400.0	21.0	5.3	7.5	3.0	1.2	5	
14	343.0	19.0	6.6	7.5	0.5	0.2		
15	453.0	24.0	6.4	7.5	3.0	1.2		
16	362.0	17.0	5.6	7.5	2.5	1.0		
17	279.0	19.0	8.2	7.4	1.1	0.9		
18	284.0	23.0	9.7	7.3	1.6			
19	260.0	22.0	10.2	7.3	1.9			
20	309.0	18.0	7.0	7.5	3.0	2.0		
21	341.0	21.0	7.4	7.5	3.0	1.2		
22	316.0	20.0	7.6	7.5	3.0	1.4		
23	377.0	22.0	7.0	7.5	3.0	1.2		
24	286.0	18.0	7.6	7.5	2.6	1.1		
25	292.0	20.0	8.2	7.5	1.8			
26	290.0	20.0	8.3	7.5	2.3			
27	312.0	23.0	8.8	7.5	2.0			
28	267.0	18.0	8.1	7.5	3.0	1.2		
29	301.0	20.0	8.0	7.5	3.0	2.5		
30	312.0	19.0	7.3	7.5	2.1	1.4		
31	369.0	20.0	6.5	7.5	2.2	1.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: March 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1343

EFFLUENT PH: (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

IN FLOW _____

CERTIFY THIS REPORT IS CORRECT: *J. C. Ryan* C.O. CERT. NO. 2787
~~5577~~

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
				PLANT EFFLUENT	REMOTE TAP		
APR 01	0.0	0.0					5 Note: Plant taken off line due to painting
APR 02	0.0	0.0					
APR 03	0.0	0.0					
APR 04	0.0	0.0					
APR 05	0.0	0.0					
APR 06	0.0	0.0					
APR 07	0.0	0.0					
APR 08	0.0	0.0					
APR 09	0.0	0.0					
APR 10	0.0	0.0					
APR 11	0.0	0.0					
APR 12	0.0	0.0					
APR 13	0.0	0.0					
APR 14	0.0	0.0					
APR 15	0.0	0.0					
APR 16	0.0	0.0					
APR 17	0.0	0.0					
APR 18	0.0	0.0					
APR 19	0.0	0.0					
APR 20	0.0	0.0					
APR 21	0.0	0.0					
APR 22	0.0	0.0					
APR 23	0.0	0.0					
APR 24	0.0	0.0					
APR 25	0.0	0.0					
APR 26	0.0	0.0					
APR 27	0.0	0.0					
APR 28	0.0	0.0					
APR 29	0.0	0.0					
APR 30	0.0	0.0					
APR 31	0.0	0.0					

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2550908 C.U.P. NO. 2-109-011-8M

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1

LOCATION: 71 State Road A1A

COUNTY: St. Johns

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1996

OPERATED BY: United Water Florida Inc.

NO. OF SERVICES AT END OF MONTH: 1943

PLANT EFFLUENT PH: 7.4 (AVG)

MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW _____

I CERTIFY THIS REPORT IS CORRECT: *John A. Moran*, C.O. CERT. NO. 5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT PH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	10811.0	529.0	116.5	140.8	30.5	7.4	5	
AVERAGE	540.6	26.5	6.1	7.4	1.6	0.6		
MAXIMUM	1135.0	52.0	9.6	7.5	3.0	1.4		
MINIMUM	0.0	0.0	4.6	7.3	0.5	0.2		
01	1036.0	44.0	5.1	7.5	0.5	0.2		
02	712.0	50.0	8.4	7.5	0.5	0.2		
03	791.0	52.0	7.9	7.4	3.0			
04	1135.0	47.0	5.0	7.4	1.5			
05	1056.0	48.0	5.5	7.5	0.5	0.2	5	
06	774.0	35.0	5.4	7.5	1.4	0.7		
07	840.0	39.0	5.6	7.5	0.5	0.2		
08	1091.0	45.0	4.9	7.5	0.5	0.2		
09	213.0	17.0	9.6	7.4	2.3	0.3		
10	300.0	15.0	6.0	7.4	1.3			
11	369.0	15.0	4.9	7.3	1.3			
12	290.0	15.0	6.2	7.4	1.8	0.9		
13	306.0	17.0	6.7	7.4	3.0	1.0		
14	330.0	15.0	5.5	7.4	1.8	1.4		
15	394.0	15.0	4.6	7.4	2.3	1.1		
16	287.0	15.0	6.3	7.3	2.1	1.0		
17	280.0	15.0	6.4	7.3	2.0			
18	402.0	17.0	5.1	7.4	2.2			
19	205.0	13.0	7.6	7.3	2.0			
20								
21								
22								
23								
24								
25								
26								
27								
28								
29	0.0	0.0						

*Plant taken off line
for painting*

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2550908 C.U.P. NO. 2-109-011-8N NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 1
 LOCATION: 71 State Road A1A COUNTY: St. Johns
 OWNED BY: United Water Florida Inc. REPORTING MONTH: January 1996
 OPERATED BY: United Water Florida Inc. NO. OF SERVICES AT END OF MONTH: 1343
 PLANT EFFLUENT PH: 7.5 (AVG) MAIN OFFICE PHONE NO. (904) 725-2865

DESIGN FLOW _____

I CERTIFY THIS REPORT IS CORRECT: SA Misom C.O. CERT. NO. 9577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY								
TOTAL	18880.0	794.0	169.3	7.3	44.9	17.6	5	
AVERAGE	609.0	25.6	5.5	7.5	1.4	0.8		
MAXIMUM	1116.0	44.0	9.2	7.5	3.5	1.7		
MINIMUM	169.0	12.0	2.0	7.3	0.5	0.2		
01	303.0	15.0	5.9	7.3	2.7			
02	254.0	13.0	6.1	7.5	3.0	1.2		
03	399.0	18.0	5.4	7.5	1.7	1.7		
04	212.0	12.0	6.8	7.5	3.0	0.2		
05	495.0	15.0	4.4	7.5	1.4	1.4		
06	223.0	12.0	6.5	7.4	0.5			
07	385.0	17.0	5.3	7.3	0.0			
08	299.0	15.0	6.0	7.5	2.2	1.6		
09	256.0	14.0	6.6	7.5	3.5	1.6		
10	270.0	16.0	7.1	7.5	1.5	1.2		
11	283.0	14.0	5.9	7.5	2.5	1.3	5	
12	281.0	14.0	6.0	7.5	1.7	1.7		
13	315.0	16.0	6.1	7.5	1.2			
14	169.0	13.0	9.2	7.4	0.8			
15	898.0	15.0	2.0	7.5	0.5	0.2		
16	874.0	44.0	6.0	7.5	0.5	0.2		
17	852.0	43.0	6.1	7.5	3.0	0.3		
18	794.0	39.0	5.9	7.5	3.0	0.5		
19	633.0	30.0	5.7	7.5	3.0	1.7		
20	845.0	34.0	4.8	7.5	1.0			
21	904.0	34.0	4.5	7.5	0.5			
22	961.0	32.0	4.0	7.5	0.5	0.5		
23	861.0	35.0	4.9	7.5	0.5	0.2		
24	765.0	25.0	4.1	7.5	1.3	1.0		
25	1116.0	44.0	4.7	7.5	0.5	0.2		
26	1036.0	38.0	4.4	7.5	0.7	0.3		
27	711.0	27.0	4.6	7.5	0.6			
28	1086.0	40.0	4.4	7.5	1.1			
29	904.0	38.0	5.0	7.5	0.5	0.2		
30	819.0	35.0	5.1	7.5	0.7	0.2		
31	767.0	36.0	5.6	7.5	0.5	0.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: December 1996

AVERAGE EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Loa my, C.O., CERT. NO. C-5577

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		

MONTHLY TOTAL	29560.0	1232.0	155.9	7.5	66.9	14.2	4	
AVERAGE	953.5	39.7	5.0	7.5	2.2	0.6		
MAXIMUM	1363.0	55.0	5.6	7.5	3.0	1.4		
MINIMUM	691.0	29.0	4.3	7.4	1.2	0.2		

01	863.0	37.0	5.1	7.5	1.8			
02	922.0	39.0	5.1	7.5	3.0	0.9		
03	724.0	31.0	5.1	7.5	1.9	0.5	4	
04	1231.0	50.0	4.9	7.5	1.3	0.2		
05	884.0	38.0	5.2	7.5	1.8	0.2		
06	1276.0	52.0	4.9	7.5	2.7	0.3		
07	691.0	30.0	5.2	7.4	2.8			
08	959.0	40.0	5.0	7.4	3.0			
09	763.0	35.0	5.5	7.4	2.4	0.8		
10	1363.0	55.0	4.8	7.4	2.8	0.5		
11	886.0	38.0	5.1	7.5	1.5	0.3		
12	960.0	40.0	5.0	7.5	3.0	0.5		
13	972.0	35.0	4.3	7.5	2.8	0.5		
14	1043.0	37.0	4.3	7.5	2.5			
15	891.0	39.0	5.3	7.5	2.9			
16	1079.0	42.0	4.7	7.5	2.3	0.6		
17	707.0	31.0	5.3	7.5	2.0	0.5		
18	1000.0	42.0	5.0	7.5	1.2	0.8		
19	732.0	33.0	5.4	7.5	2.3	1.0		
20	1189.0	48.0	4.8	7.5	1.5	1.0		
21	1103.0	46.0	5.0	7.5	2.0			
22	700.0	29.0	5.0	7.5	1.8			
23	964.0	40.0	5.0	7.5	1.6	0.5		
24	1059.0	44.0	5.0	7.4	2.0	1.4		
25	808.0	38.0	5.6	7.4	2.6	0.8		
26	851.0	35.0	5.1	7.4	2.2	1.0		
27	1036.0	43.0	5.0	7.4	1.8	0.9		
28	823.0	35.0	5.1	7.4	2.3			
29	982.0	41.0	5.0	7.4	2.0			
30	824.0	35.0	5.1	7.4	1.5	0.5		
31	1275.0	53.0	5.0	7.5	1.6	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 2

CATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1996

AVERAGE EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DIRECTION OF FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Joe [Signature], C.O., CERT. NO. C-5577

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	31592.0	1272.0	148.4	224.7	59.7	14.1	4	
AVERAGE	1053.1	42.4	4.9	7.5	2.0	0.7		
MAXIMUM	1351.0	54.0	10.7	7.6	3.0	2.2		
MINIMUM	448.0	27.0	3.3	7.4	1.0	0.2		
01	1151.0	47.0	4.9	7.5	2.0	0.6		
02	802.0	34.0	5.1	7.4	2.4			
03	1212.0	50.0	5.0	7.4	2.1			
04	875.0	38.0	5.2	7.5	2.5	1.1	4	
05	1102.0	46.0	5.0	7.5	2.4	1.0		
06	1123.0	47.0	5.0	7.5	2.1	0.8		
07	1001.0	42.0	5.0	7.5	1.9	0.4		
08	764.0	30.0	4.7	7.5	2.2	0.2		
09	448.0	40.0	10.7	7.5	2.1			
10	1158.0	43.0	4.5	7.4	2.2			
11	1127.0	47.0	5.0	7.5	3.0	0.6		
12	1058.0	43.0	4.9	7.5	2.0	0.4		
13	1109.0	45.0	4.9	7.5	1.0	0.2		
14	1177.0	48.0	4.9	7.5	2.2	0.2		
15	1102.0	44.0	4.8	7.5	1.7	0.7		
16	902.0	38.0	5.1	7.5	1.7			
17	1248.0	51.0	4.9	7.5	1.5			
18	1097.0	45.0	4.9	7.5	1.4	0.7		
19	824.0	35.0	5.1	7.5	1.5	1.4		
20	1229.0	50.0	4.9	7.5	1.0	0.2		
21	987.0	27.0	3.3	7.5	1.8	0.2		
22	1123.0	40.0	4.3	7.5	1.9	0.3		
23	1169.0	42.0	4.3	7.5	2.5			
24	1089.0	38.0	4.2	7.4	1.5			
25	946.0	35.0	4.4	7.5	3.0	2.2		
26	1126.0	45.0	4.8	7.5	3.0	1.5		
27	959.0	35.0	4.4	7.5	2.3	0.9		
28	1319.0	52.0	4.7	7.6	1.7	0.2		
29	1014.0	41.0	4.9	7.5	1.6	0.3		
30	1351.0	54.0	4.8	7.5	1.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1996

AVERAGE EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *[Signature]*, C.O., CERT. NO. C-5577

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	29348.0	1124.0	141.9	231.9	64.8	10.2	4	
AVERAGE	946.7	36.3	4.6	7.5	2.1	0.4		
MAXIMUM	1181.0	49.0	5.7	7.5	3.0	1.4		
MINIMUM	702.0	24.0	3.1	7.3	1.3	0.2		
01	773.0	28.0	4.3	7.5	1.9	1.0		
02	889.0	29.0	3.9	7.5	1.7	0.2		
03	939.0	24.0	3.1	7.5	1.5	0.2		
04	720.0	26.0	4.3	7.4	1.3	0.2		
05	1074.0	38.0	4.2	7.3	2.0			
06	879.0	28.0	3.8	7.4	1.4			
07	759.0	28.0	4.4	7.5	1.3	0.6		
08	765.0	29.0	4.5	7.5	1.8	1.3		
09	860.0	30.0	4.2	7.5	2.0	0.2	4	
10	848.0	27.0	3.8	7.5	3.0	1.0		
11	846.0	29.0	4.1	7.5	2.1	0.2		
12	905.0	29.0	3.8	7.4	1.8			
13	1046.0	44.0	5.0	7.4	1.9			
14	924.0	39.0	5.1	7.5	1.7	0.2		
15	910.0	38.0	5.0	7.5	2.5	0.5		
16	1090.0	45.0	5.0	7.5	1.4	0.2		
17	702.0	31.0	5.3	7.5	2.3	0.2		
18	1078.0	41.0	4.6	7.5	2.2	0.2		
19	765.0	24.0	3.8	7.5	2.5			
20	1150.0	35.0	3.7	7.5	3.0			
21	945.0	40.0	5.1	7.5	2.6	0.8		
22	1115.0	46.0	5.0	7.5	2.5	0.2		
23	982.0	46.0	5.6	7.5	2.3	0.4		
24	1061.0	44.0	5.0	7.5	2.5	0.2		
25	1181.0	44.0	4.5	7.5	2.0	0.4		
26	970.0	39.0	4.8	7.5	3.0			
27	923.0	39.0	5.1	7.5	1.8			
28	1067.0	45.0	5.1	7.5	2.3	0.2		
29	1061.0	45.0	5.1	7.5	2.0	0.2		
30	1176.0	49.0	5.0	7.5	2.5	0.2		
31	945.0	45.0	5.7	7.5	2.0	1.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Port Hedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

EFFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *[Signature]*, C.O., CERT. NO. C-5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	30687.0	1316.0	158.1	224.6	67.1	7.5	4	
RANGE	1022.9	43.9	5.3	7.5	2.2	0.4		
MINIMUM	1288.0	60.0	7.1	7.5	3.0	1.5		
MAXIMUM	724.0	29.0	3.1	7.4	0.5	0.2		
01	983.0	49.0	6.0	7.5	2.7			
02	1030.0	51.0	5.9	7.5	3.0			
03	782.0	40.0	6.1	7.5	3.0	0.5		
04	1009.0	52.0	6.2	7.5	2.2	0.2		
05	987.0	44.0	5.3	7.5	3.0	0.9		
06	882.0	43.0	5.9	7.5	3.0	1.5		
07	1052.0	52.0	5.9	7.4	2.7			
08	912.0	44.0	5.8	7.4	2.8			
09	976.0	49.0	6.0	7.5	3.0	0.6		
10	724.0	40.0	6.6	7.5	3.0	0.2		
11	731.0	43.0	7.1	7.5	1.9	0.5		
12	817.0	43.0	6.3	7.5	3.0	0.2	4	
13	730.0	37.0	6.1	7.5	3.0	0.2		
14	985.0	49.0	6.0	7.5	1.4			
15	1170.0	57.0	5.8	7.5	1.8			
16	762.0	38.0	6.0	7.5	3.0	0.3		
17	1000.0	38.0	4.6	7.5	0.5	0.2		
18	1163.0	30.0	3.1	7.5	1.0	0.3		
19	1251.0	44.0	4.2	7.5	1.7	0.2		
20	1224.0	38.0	3.7	7.5	2.3	0.2		
21	937.0	29.0	3.7	7.4	2.8			
22	1288.0	39.0	3.6	7.5	3.0			
23	1026.0	38.0	4.4	7.4	1.4	0.4		
24	1106.0	38.0	4.1	7.5	2.5	0.3		
25	1256.0	38.0	3.6	7.5	2.0	0.2		
26	1168.0	37.0	3.8	7.5	2.2	0.2		
27	1277.0	51.0	4.8	7.5	0.5	0.2		
28	1247.0	50.0	4.8	7.5	1.4			
29	1112.0	60.0	6.5	7.5	1.0			
30	1100.0	55.0	6.0	7.5	2.3	0.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

D NO. 2550308 C.U.P. NO. 2-109-011-8N NAME OF DRINKING WATER SYSTEM: Polk County Water Treatment Plant WTP No. 2

ION: 2 Corona Road COUNTY: ST. JOHNS

BY: United Water Florida Inc. REPORTING MONTH: August 1996

EFFLUENT pH: 7.5 (AVG) NO. OF SERVICES AT END OF MONTH: 1343

IN FLOW: MAIN OFFICE PHONE NO. (904) 725-2855

VERIFY THIS REPORT IS CORRECT ADG my, C.O., CERT. NO. C-5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE	EFFLUENT pH	RESIDUAL CHLORINE PLANT EFFLUENT mg/L	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
8/1	36530.0	1703.0	178.5	7.3	79.6	20.0	4	
8/2	1178.4	54.9	5.8	7.5	2.6	0.9		
8/3	1534.0	80.0	11.7	7.5	3.5	1.5		
8/4	513.0	43.0	4.0	7.3	1.2	0.2		
01	1370.0	48.0	4.2	7.5	3.0	0.9		
02	1000.0	47.0	5.6	7.5	2.3	0.2		
03	1104.0	52.0	5.7	7.5	1.6			
04	1312.0	65.0	5.9	7.5	1.7			
05	1328.0	59.0	5.3	7.5	2.5	0.7	4	
06	1505.0	64.0	5.1	7.5	2.5	0.7		
07	1347.0	61.0	5.4	7.5	2.8	1.0		
08	1506.0	50.0	4.0	7.5	2.7	1.4		
09	1369.0	67.0	5.9	7.5	2.8	0.9		
10	1534.0	69.0	5.4	7.5	2.1			
11	900.0	44.0	5.9	7.5	1.7			
12	1066.0	53.0	6.0	7.5	2.5	0.6		
13	1030.0	50.0	5.8	7.5	3.0	1.0		
14	946.0	49.0	6.2	7.5	3.0	0.9		
15	1053.0	51.0	5.8	7.5	3.0	0.9		
16	1217.0	52.0	5.1	7.5	3.0	1.3		
17	1317.0	55.0	5.0	7.3	2.8			
18	1511.0	69.0	5.5	7.4	2.5			
19	1339.0	61.0	5.5	7.5	3.0	0.9		
20	1133.0	54.0	5.7	7.5	2.7	1.0		
21	1079.0	50.0	5.6	7.5	3.0	1.5		
22	1373.0	62.0	5.4	7.5	2.8	0.3		
23	1441.0	80.0	6.7	7.5	1.2	1.2		
24	513.0	50.0	11.7	7.5	2.1			
25	1300.0	46.0	4.2	7.4	2.8			
26	1073.0	58.0	6.5	7.4	3.5	1.2		
27	1170.0	52.0	5.3	7.5	3.0	1.1		
28	962.0	47.0	5.9	7.5	3.0	1.1		
29	852.0	43.0	6.1	7.5	3.0	0.6		
30	980.0	48.0	5.9	7.5	1.8	0.6		
31	900.0	47.0	6.3	7.5	2.2			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: July 1996


INLET EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.D., CERT. NO. C-5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	31584.0	1497.0	180.0	231.8	81.0	10.1	4	
AVERAGE	1018.8	48.3	5.8	7.5	2.6	0.5		
MINIMUM	1615.0	72.0	6.8	7.5	23.0	1.4		
MINIMUM	671.0	32.0	3.2	7.4	0.5	0.2		
01	870.0	40.0	5.5	7.4	1.2	0.3		
02	1024.0	46.0	5.4	7.5	2.3	0.2		
03	900.0	39.0	5.2	7.5	23.0	0.2		
04	935.0	47.0	6.0	7.5	0.8			
05	1071.0	49.0	5.5	7.5	0.5	0.2		
06	720.0	41.0	6.8	7.5	3.0			
07	769.0	42.0	6.6	7.5	3.0			
08	826.0	45.0	6.5	7.5	2.5	0.9		
09	671.0	37.0	6.6	7.5	3.0	0.3		
10	757.0	43.0	6.8	7.5	1.2	1.1		
11	810.0	44.0	6.5	7.5	3.0	0.2		
12	680.0	37.0	6.5	7.4	2.7	0.9		
13	808.0	45.0	6.8	7.4	2.3			
14	847.0	43.0	6.1	7.4	2.2			
15	854.0	45.0	6.3	7.5	2.0	0.8	4	
16	819.0	42.0	6.2	7.5	1.7	0.5		
17	828.0	41.0	5.9	7.5	1.5	0.2		
18	991.0	53.0	6.4	7.5	1.5	0.2		
19	1018.0	47.0	5.5	7.5	2.2	0.2		
20	1251.0	59.0	5.7	7.5	1.0			
21	997.0	48.0	5.8	7.5	3.3			
22	1172.0	56.0	5.7	7.5	1.7	0.2		
23	1157.0	54.0	5.6	7.5	1.2	0.3		
24	1192.0	57.0	5.7	7.5	2.5	1.4		
25	1388.0	72.0	6.2	7.5	2.3	1.0		
26	1125.0	44.0	4.7	7.5	0.5	0.2		
27	1615.0	70.0	5.2	7.4	2.8			
28	1331.0	50.0	4.5	7.5	1.8			
29	1592.0	71.0	5.4	7.4	1.1	0.4		
30	1215.0	32.0	3.2	7.4	1.7	0.2		
31	1351.0	57.0	5.1	7.5	1.5	0.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: F Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: June 1996

AVERAGE EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2855

I CERTIFY THIS REPORT IS CORRECT *[Signature]*, C.O., CERT. NO. C-5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	27324.0	1226.0	163.2	224.2	58.3	8.2	4	
AVERAGE	910.8	40.9	5.4	7.5	1.9	0.4		
MINIMUM	1258.0	64.0	7.3	7.5	3.0	1.4		
MINIMUM	243.0	12.0	4.1	7.3	0.5	0.2		
01	243.0	12.0	5.9	7.5	1.9			
02	1149.0	51.0	5.3	7.4	0.5			
03	1007.0	39.0	4.5	7.5	0.7	0.3		
04	964.0	37.0	4.6	7.5	2.3	1.4		
05	1189.0	49.0	4.9	7.5	1.6	0.2	4	
06	1083.0	49.0	5.4	7.5	0.9	0.6		
07	975.0	43.0	5.3	7.5	2.5	0.5		
08	1059.0	64.0	7.3	7.5	2.5			
09	827.0	45.0	6.5	7.5	1.8			
10	873.0	43.0	5.9	7.5	2.7	0.2		
11	829.0	42.0	6.1	7.5	3.0	0.2		
12	958.0	43.0	5.4	7.5	3.0	0.2		
13	859.0	33.0	4.6	7.5	3.0	0.2		
14	817.0	37.0	5.4	7.5	2.8	0.3		
15	897.0	39.0	5.2	7.4	2.5			
16	795.0	41.0	6.2	7.3	2.2			
17	926.0	41.0	5.3	7.5	2.0	1.1		
18	941.0	40.0	5.1	7.5	2.5	0.2		
19	1067.0	45.0	5.1	7.5	2.5	1.3		
20	790.0	40.0	6.1	7.5	2.5	0.2		
21	854.0	36.0	5.1	7.5	2.0	0.3		
22	753.0	35.0	5.6	7.3	2.5			
23	892.0	40.0	5.4	7.4	1.9			
24	870.0	44.0	6.1	7.5	1.0	0.2		
25	1141.0	43.0	4.5	7.5	0.5	0.2		
26	703.0	37.0	6.3	7.5	2.0	0.2		
27	838.0	43.0	6.2	7.5	1.7	0.2		
28	893.0	41.0	5.5	7.5	1.0	0.2		
29	874.0	30.0	4.1	7.4	0.8			
30	1258.0	45.0	4.3	7.5	1.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-2N

NAME OF DRINKING WATER SYSTEM: Ponte Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: May 1996

INLET EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Sanjay A. Misra, C.O., CERT. NO. C-5577

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	35170.0	1379.0	147.0	231.9	56.9	11.1	4	
AVERAGE	1134.5	44.5	4.7	7.5	1.8	0.5		
MINIMUM	1588.0	65.0	6.1	7.5	3.0	1.2		
MINIMUM	736.0	4.0	0.4	7.4	0.5	0.2		
01	1188.0	46.0	4.6	7.5	0.5	0.2		
02	1191.0	45.0	4.5	7.5	1.0	0.2	4	
03	1353.0	56.0	5.0	7.5	1.0			
04	1588.0	35.0	2.6	7.4	0.9			
05	1092.0	43.0	4.7	7.5	0.8	0.8		
06	1143.0	53.0	5.6	7.4	2.1	0.2		
07	1233.0	47.0	4.6	7.5	2.5	0.2		
08	1334.0	57.0	5.1	7.5	1.6	0.2		
09	958.0	43.0	5.4	7.5	3.0	0.2		
10	1098.0	37.0	4.0	7.5	3.0	1.2		
11	1050.0	40.0	4.6	7.5	2.2			
12	1080.0	41.0	4.6	7.4	1.5			
13	1009.0	33.0	3.9	7.5	1.0	1.0		
14	787.0	35.0	5.3	7.5	3.0	0.8		
15	1062.0	46.0	5.2	7.5	2.2	0.2		
16	1095.0	39.0	4.3	7.5	2.2	0.9		
17	882.0	45.0	6.1	7.4	1.0	0.8		
18	1499.0	62.0	5.0	7.4	1.8			
19	1069.0	43.0	4.8	7.5	1.4			
20	1105.0	45.0	4.9	7.5	3.0	0.7		
21	919.0	31.0	4.0	7.5	2.5	1.2		
22	1383.0	55.0	4.8	7.5	2.2	0.3		
23	1164.0	47.0	4.8	7.5	2.0	0.3		
24	1232.0	58.0	5.6	7.5	1.6	0.2		
25	1324.0	63.0	5.7	7.5	2.0			
26	1421.0	65.0	5.5	7.5	2.1			
27	1584.0	61.0	4.6	7.4	1.4			
28	736.0	31.0	5.1	7.5	2.1	0.7		
29	754.0	37.0	5.9	7.5	2.0	0.2		
30	767.0	36.0	5.6	7.5	1.5	0.4		
31	1070.0	4.0	0.4	7.5	1.8	0.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponce Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: March 1996

AVERAGE EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

JE Dwyer

, C.O., CERT. NO. ~~C-5577~~ ²⁷⁸⁷

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
THLY TOTAL	32742.0	1424.0	163.2	231.2	71.9	16.0	4	
RANGE	1056.2	45.9	5.3	7.5	2.3	0.8		
MINIMUM	1320.0	62.0	7.8	7.5	3.5	2.0		
MINIMUM	660.0	31.0	4.0	7.1	1.1	0.2		
01	1075.0	53.0	5.9	7.5	1.8	0.3		
02	1050.0	53.0	6.1	7.4	2.7			
03	1106.0	48.0	5.2	7.4	2.5			
04	1176.0	48.0	4.9	7.5	1.7	0.2		
05	1014.0	51.0	6.0	7.5	2.8	0.7		
06	970.0	44.0	5.4	7.5	2.2	0.5		
07	1031.0	47.0	5.5	7.5	2.7	0.7		
08	1168.0	51.0	5.2	7.5	3.0	0.7		
09	769.0	50.0	7.8	7.1	2.7			
10	818.0	31.0	4.5	7.5	2.5			
11	1196.0	42.0	4.2	7.4	2.0	0.8		
12	660.0	34.0	6.2	7.5	3.0	1.5		
13	1219.0	41.0	4.0	7.5	3.0	2.0		
14	986.0	33.0	4.0	7.5	2.7	1.0		
15	1132.0	38.0	4.0	7.5	2.8	0.8		
16	1159.0	40.0	4.1	7.5	2.0			
17	1320.0	44.0	4.0	7.5	1.1			
18	946.0	34.0	4.3	7.5	1.6	0.2		
19	932.0	33.0	4.2	7.4	1.6	0.2		
20	1032.0	36.0	4.2	7.5	2.5	1.0		
21	1177.0	51.0	5.2	7.3	1.7	0.2		
22	1143.0	58.0	6.1	7.4	1.4	0.3		
23	1148.0	56.0	5.9	7.4	1.2			
24	1316.0	62.0	5.7	7.4	1.7			
25	1108.0	54.0	5.8	7.5	2.0	0.2		
26	1181.0	56.0	5.7	7.5	3.0	0.9		
27	982.0	50.0	6.1	7.5	2.5	0.4		
28	930.0	45.0	5.8	7.5	2.2	2.0		
29	934.0	43.0	5.5	7.5	3.0	1.4		
30	981.0	48.0	5.9	7.5	2.8			
31	1083.0	50.0	5.5	7.5	3.5			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2550908 C.U.P. NO. 2-109-011-8N

NAME OF DRINKING WATER SYSTEM: Ponce Vedra WTP No. 2

LOCATION: 2 Corona Road

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1996


PLANT EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1343

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-5577

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	19681.0	815.0	104.0	164.2	52.7	11.2	4	
AVERAGE	937.2	38.8	5.0	7.5	2.4	0.7		
MAXIMUM	1456.0	62.0	5.4	7.6	3.5	1.8		
MINIMUM	559.0	25.0	4.0	7.3	1.2	0.2		
01								
02								
03								
04								
05								
06								
07								
08				7.5	3.0	1.5		
09	658.0	26.0	4.7	7.5	3.5	0.3		* Plant back in servi
10	833.0	28.0	4.0	7.5	3.5			after painting
11	810.0	29.0	4.3	7.4	1.6			
12	736.0	28.0	4.6	7.4	1.9	0.2		
13	762.0	34.0	5.4	7.4	2.8	0.6		
14	712.0	30.0	5.1	7.4	2.9	0.5		
15	768.0	30.0	4.7	7.4	2.8	0.6		
16	809.0	34.0	5.0	7.4	2.5	1.0		
17	559.0	25.0	5.4	7.4	2.3			
18	962.0	40.0	5.0	7.4	2.7			
19	705.0	29.0	4.9	7.3	2.0			
20	1179.0	50.0	5.1	7.6	1.2	1.0		
21	931.0	39.0	5.0	7.6	1.9	1.4		
22	1257.0	54.0	5.2	7.5	2.3	1.8		
23	852.0	36.0	5.1	7.5	1.8	0.8		
24	1456.0	62.0	5.1	7.5	2.3			
25	1315.0	56.0	5.1	7.5	2.5			
26	1299.0	54.0	5.0	7.5	2.2	0.5		
27	1070.0	45.0	5.0	7.5	1.6	0.3		
28	1222.0	52.0	5.1	7.5	2.7	0.5		
29	786.0	34.0	5.2	7.5	2.7	0.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: December 1996

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

Robert J. Garraway

, C.O., CERT. NO. C-5698

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	95797.0	2728.0	105.1	230.0	54.1	11.3	30	
AVERAGE	3090.2	88.0	3.4	7.4	1.7	0.6		
MAXIMUM	3463.0	120.0	4.5	7.6	3.0	0.7		
MINIMUM	2456.0	40.0	1.4	7.3	1.1	0.4		
01	2973.0	90.0	3.6	7.4	1.6			
02	3056.0	90.0	3.5	7.4	1.7	0.5		
03	3255.0	100.0	3.7	7.4	1.8	0.6		
04	3224.0	100.0	3.7	7.4	1.5	0.7		
05	3216.0	90.0	3.4	7.4	1.8	0.6	15	
06	3188.0	90.0	3.4	7.4	1.5	0.5		
07	2952.0	80.0	3.3	7.4	1.8			
08	3035.0	100.0	4.0	7.4	2.2			
09	3313.0	100.0	3.6	7.5	1.1	0.5		
10	3296.0	100.0	3.6	7.5	1.4	0.4		
11	3463.0	80.0	2.8	7.6	1.4	0.5		
12	3242.0	100.0	3.7	7.5	1.3	0.5	15	
13	3267.0	120.0	4.4	7.3	1.6	0.6		
14	3099.0	90.0	3.5	7.4	1.4			
15	3076.0	90.0	3.5	7.4	1.7			
16	3303.0	40.0	1.4	7.4	1.7	0.6		
17	3297.0	100.0	3.6	7.5	1.1	0.4		
18	3140.0	120.0	4.5	7.5	1.8	0.6		
19	3040.0	85.0	3.4	7.4	2.0	0.7		
20	2992.0	85.0	3.4	7.4	1.6	0.5		
21	2811.0	85.0	3.7	7.4	3.0			
22	2734.0	70.0	3.1	7.4	2.0			
23	3029.0	50.0	2.0	7.4	1.6	0.5		
24	2864.0	70.0	2.9	7.4	1.7			
25	2456.0	80.0	3.9	7.4	2.8			
26	3014.0	80.0	3.2	7.4	1.8	0.7		
27	3094.0	80.0	3.1	7.5	1.7	0.6		
28	2930.0	80.0	3.3	7.4	1.9			
29	2921.0	100.0	3.3	7.4	2.0			
30	3197.0	90.0	3.4	7.3	1.8	0.7		
31	3320.0	90.0	3.2	7.4	1.8	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: November 1996

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

Renters Garaway

, C.O., CERT. NO. C-5698

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
DAILY	99191.0	3120.0	116.1	222.7	62.8	10.4	30	
AVERAGE	3306.4	104.0	3.9	7.4	2.1	0.5		
MAXIMUM	3687.0	140.0	6.6	7.5	2.9	0.8		
MINIMUM	2700.0	50.0	2.0	7.2	1.0	0.4		
01	3520.0	140.0	4.7	7.5	1.9	0.7		
02	3416.0	120.0	4.2	7.4	2.4			
03	3359.0	120.0	4.3	7.3	2.8			
04	3493.0	100.0	3.4	7.5	2.8	0.6		
05	3573.0	110.0	3.7	7.5	1.8	0.4		
06	3597.0	120.0	3.3	7.4	2.7	0.5		
07	3687.0	120.0	3.9	7.4	2.4	0.5	15	
08	3284.0	110.0	4.0	7.4	2.5	0.4		
09	3168.0	110.0	4.0	7.4	2.8			
10	3011.0	100.0	4.0	7.4	2.0			
11	3496.0	120.0	4.1	7.4	2.1	0.5		
12	3358.0	120.0	4.3	7.4	1.4	0.6		
13	3401.0	130.0	4.6	7.2	1.5	0.7		
14	3452.0	130.0	4.5	7.5	2.5	0.8	15	
15	3318.0	120.0	4.3	7.4	2.2	0.7		
16	3136.0	100.0	3.8	7.4	2.5			
17	3183.0	100.0	3.8	7.5	2.0			
18	3410.0	120.0	4.2	7.5	2.0	0.5		
19	3434.0	130.0	4.5	7.5	2.0	0.4		
20	3511.0	140.0	4.8	7.4	2.9	0.4		
21	3138.0	110.0	4.2	7.4	2.2	0.5		
22	3165.0	120.0	4.5	7.5	1.7	0.4		
23	3098.0	60.0	2.3	7.4	2.8			
24	3167.0	90.0	3.4	7.4	2.6			
25	3402.0	70.0	2.5	7.4	1.6	0.6		
26	3276.0	50.0	6.6	7.5	1.0	0.7		
27	3270.0	90.0	3.3	7.4	1.4	0.5		
28	2700.0	50.0	2.2	7.4	1.5			
29	3145.0	70.0	2.7	7.5	1.4			
30	3023.0	50.0	2.0	7.4	1.4			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

3 ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: KUMUL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: October 1996

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DIRECTION OF FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

Penelope Saraway

, C.O., CERT. NO. C-5698

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	104250.0	3430.0	122.0	230.1	57.5	13.6	30	
AVERAGE	3362.9	110.6	3.9	7.4	1.9	0.6		
MAXIMUM	3704.0	190.0	6.5	7.6	2.8	0.7		
MINIMUM	2971.0	60.0	2.3	7.3	1.0	0.5		
01	3365.0	110.0	3.9	7.4	2.0	0.6		
02	3505.0	120.0	4.1	7.4	1.4	0.7		
03	3360.0	120.0	4.3	7.4	1.2	0.6		
04	3260.0	90.0	3.3	7.3	1.9	0.7		
05	3130.0	100.0	3.8	7.4	2.6			
06	3026.0	100.0	4.0	7.4	2.4			
07	3187.0	110.0	4.1	7.4	1.7	0.6		
08	3268.0	120.0	4.4	7.4	1.0	0.5		
09	3342.0	120.0	4.3	7.4	2.8	0.7	15	
10	3492.0	120.0	4.1	7.4	2.8	0.6		
11	3212.0	80.0	2.9	7.3	2.8	0.7		
12	3117.0	100.0	3.8	7.4	2.2			
13	2971.0	90.0	3.6	7.3	2.8			
14	3515.0	130.0	4.4	7.4	1.4	0.6	15	
15	3515.0	120.0	4.0	7.4	1.9	0.5		
16	3544.0	80.0	2.7	7.5	1.8	0.5		
17	3361.0	110.0	3.9	7.5	1.2	0.6		
18	3500.0	190.0	6.5	7.5	2.2	0.5		
19	3144.0	130.0	5.0	7.5	1.9			
20	3067.0	60.0	2.3	7.5	1.7			
21	3476.0	100.0	3.5	7.6	1.9	0.5		
22	3608.0	80.0	2.7	7.4	1.4	0.5		
23	3370.0	110.0	3.9	7.3	1.0	0.5		
24	3510.0	100.0	3.4	7.4	1.0	0.5		
25	3535.0	140.0	4.8	7.5	1.0	0.5		
26	3383.0	120.0	4.3	7.5	2.0			
27	3117.0	110.0	4.2	7.5	2.2			
28	3519.0	110.0	3.8	7.4	1.9	0.7		
29	3704.0	120.0	3.9	7.4	1.7	0.7		
30	3645.0	120.0	4.0	7.4	1.7	0.6		
31	3502.0	120.0	4.1	7.5	2.0	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: September 1996

INLET EFFLUENT pH: 7.5 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

Robert G. Garroway

, C.O., CERT. NO. C-5698

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	107895.0	3700.0	123.4	223.5	53.2	13.2	30	
AVERAGE	3596.5	123.3	4.1	7.5	1.8	0.6		
MINIMUM	4089.0	190.0	5.8	7.5	2.6	0.8		
MINIMUM	3277.0	90.0	3.2	7.3	0.8	0.5		
01	3277.0	100.0	3.7	7.4	2.4			
02	3390.0	110.0	3.9	7.3	2.6	0.8		
03	3746.0	115.0	3.7	7.4	2.4	0.7		
04	3619.0	115.0	3.8	7.5	1.0	0.5		
05	3693.0	130.0	4.2	7.5	1.4	0.6		
06	3672.0	120.0	3.9	7.4	1.8	0.7		
07	3395.0	90.0	3.2	7.5	1.4			
08	3354.0	100.0	3.6	7.5	1.6			
09	3613.0	120.0	4.0	7.5	1.9	0.6	15	
10	3465.0	120.0	4.2	7.4	1.4	0.5		
11	3381.0	130.0	4.6	7.5	1.6	0.7		
12	3530.0	110.0	3.7	7.5	2.0	0.6		
13	3534.0	120.0	4.1	7.5	1.0	0.7		
14	3294.0	120.0	4.4	7.5	2.1			
15	3447.0	110.0	3.8	7.5	1.8			
16	3688.0	110.0	3.6	7.4	1.0	0.7	15	
17	3825.0	120.0	3.8	7.5	0.8	0.6		
18	3702.0	160.0	5.2	7.5	0.8	0.6		
19	3365.0	150.0	5.3	7.4	1.6	0.7		
20	3606.0	110.0	3.7	7.4	1.8	0.7		
21	3340.0	120.0	4.3	7.4	2.6			
22	3334.0	150.0	5.3	7.4	2.6			
23	4089.0	130.0	3.8	7.4	2.0	0.5		
24	4075.0	120.0	3.5	7.5	1.5	0.5		
25	3850.0	140.0	4.4	7.5	2.0	0.5		
26	3916.0	190.0	5.8	7.4	2.0	0.6		
27	3756.0	150.0	4.8	7.5	2.3	0.7		
28	3686.0	110.0	3.6	7.5	1.7			
29	3383.0	100.0	3.5	7.5	2.3			
30	3870.0	130.0	4.0	7.3	1.8	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: R. LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

ISSUED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: August 1996

EFFLUENT PH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 1945

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

R. J. ..., C.O., CERT. NO. C-5698

3	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
	mg/l			PLANT EFFLUENT	REMOTE TAP		

THLY	119884.0	3780.0	123.4	230.8	54.7	10.8	30	
RAGE	3673.7	121.9	4.0	7.4	1.8	0.5		
MDM	4179.0	150.0	4.9	7.6	2.6	0.7		
MDM	3406.0	90.0	3.1	7.3	0.8	0.2		

01	4179.0	150.0	4.3	7.4	1.6	0.5		
02	3576.0	120.0	4.0	7.4	1.8	0.6		
03	3406.0	100.0	3.5	7.4	1.8			
04	3529.0	100.0	3.4	7.4	2.3			
05	3837.0	120.0	3.8	7.5	2.2	0.4		
06	4102.0	120.0	3.5	7.4	1.4	0.4		
07	3896.0	120.0	3.7	7.4	0.8	0.3		
08	3756.0	130.0	4.1	7.4	1.4	0.4	15	
09	3742.0	130.0	4.2	7.4	2.0	0.5		
10	3662.0	130.0	4.2	7.4	2.4			
11	3453.0	120.0	4.1	7.4	2.6			
12	3572.0	130.0	4.4	7.4	2.2	0.4		
13	3695.0	120.0	3.9	7.6	1.0	0.2	15	
14	3474.0	140.0	4.8	7.5	1.9	0.5		
15	3656.0	110.0	3.6	7.3	1.6	0.6		
16	3455.0	110.0	3.8	7.5	1.5	0.3		
17	3472.0	110.0	3.8	7.5	1.8			
18	3413.0	120.0	4.2	7.5	2.0			
19	3841.0	130.0	4.1	7.5	2.2	0.7		
20	3691.0	130.0	4.2	7.4	1.1	0.6		
21	3667.0	120.0	3.9	7.5	1.1	0.6		
22	3846.0	130.0	4.1	7.5	2.0	0.5		
23	3776.0	140.0	4.4	7.5	1.8	0.7		
24	3552.0	90.0	3.1	7.5	2.0			
25	3433.0	100.0	3.5	7.5	2.2			
26	3943.0	120.0	3.7	7.4	1.7	0.6		
27	3805.0	100.0	3.1	7.6	1.7	0.7		
28	3780.0	130.0	4.1	7.4	1.0	0.4		
29	3758.0	130.0	4.2	7.4	1.6	0.4		
30	3511.0	140.0	4.8	7.4	2.0	0.5		
31	3406.0	140.0	4.9	7.4	2.0			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: July 1996

EFFLUENT pH: 7.1 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

Prentice Barroway

, C.O., CERT. NO. C-5698

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	112600.0	3570.0	117.8	220.2	47.9	11.4	30	
AVERAGE	3632.3	115.2	3.8	7.1	1.5	0.5		
1MUM	4447.0	160.0	4.8	7.6	2.4	0.8		
1MUM	2868.0	80.0	2.7	6.9	0.8	0.3		
01	3536.0	90.0	2.7	7.0	1.8	0.7		
02	3631.0	130.0	4.3	7.0	2.1	0.6	15	
03	3500.0	90.0	3.0	7.0	0.8	0.3	15	
04	3194.0	100.0	3.8	6.9	1.8			
05	3336.0	120.0	4.3	7.1	1.0	0.5		
06	3065.0	100.0	3.9	7.0	2.1			
07	3128.0	80.0	3.1	7.0	1.9			
08	3525.0	120.0	4.1	6.9	2.0	0.6		
09	3343.0	80.0	2.9	6.9	0.9	0.5		
10	3415.0	130.0	4.6	6.9	1.1	0.6		
11	3490.0	110.0	3.8	7.0	1.8	0.5		
12	3542.0	100.0	3.9	6.9	0.9	0.6		
13	2868.0	100.0	3.9	7.0	2.0			
14	3147.0	100.0	3.8	7.0	2.3			
15	3485.0	110.0	4.1	6.9	1.7	0.6		
16	3585.0	100.0	3.3	7.0	1.4	0.6		
17	3557.0	100.0	3.4	7.0	1.0	0.6		
18	3630.0	140.0	4.6	7.1	1.9	0.7		
19	3730.0	100.0	3.2	7.0	2.0	0.8		
20	3618.0	120.0	4.0	7.0	2.2			
21	3455.0	120.0	4.2	7.0	2.4			
22	3840.0	120.0	3.8	7.0	1.0	0.4		
23	4017.0	160.0	4.8	7.0	1.0	0.4		
24	3743.0	110.0	3.5	7.0	1.4	0.5		
25	4103.0	130.0	3.8	7.6	1.0	0.3		
26	4165.0	150.0	4.3	7.5	1.1	0.4		
27	4031.0	130.0	3.9	7.5	1.8			
28	3620.0	110.0	3.6	7.5	1.8			
29	4409.0	120.0	3.2	7.5	1.2	0.3		
30	4445.0	150.0	4.0	7.5	1.5	0.4		
31	4447.0	150.0	4.0	7.5	1.0	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: June 1996

EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

INFLUENT FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT Preston Sarraway, C.O., CERT. NO. C-5698

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
6/1	102732.0	3100.0	108.4	7.0	45.2	10.5	30	
6/2	3424.4	103.3	3.6	7.0	1.5	0.5		
6/3	3837.0	120.0	4.5	7.1	2.2	0.7		
6/4	3086.0	80.0	2.6	6.7	0.8	0.3		
6/5	3142.0	100.0	3.8	7.0	1.0			
6/6	3271.0	90.0	3.3	7.0	1.0			
6/7	3540.0	100.0	3.3	7.0	0.8	0.4		
6/8	3575.0	100.0	3.4	6.9	0.8	0.7		
6/9	3682.0	110.0	3.6	7.0	1.0	0.6		
6/10	3837.0	120.0	3.8	7.0	1.0	0.6	15	
6/11	3433.0	100.0	3.5	7.0	1.3	0.5		
6/12	3103.0	100.0	3.9	7.0	2.0			
6/13	3166.0	100.0	3.8	7.0	2.0			
6/14	3463.0	110.0	3.8	7.0	2.0	0.4		
6/15	3597.0	120.0	3.9	7.0	1.1	0.3		
6/16	3650.0	120.0	3.9	7.0	2.0	0.5		
6/17	3722.0	120.0	3.8	7.0	1.7	0.5	15	
6/18	3361.0	100.0	3.6	7.0	1.8	0.4		
6/19	3086.0	110.0	4.3	7.0	1.6			
6/20	3339.0	80.0	2.9	6.9	1.8			
6/21	3520.0	110.0	3.8	7.0	2.0	0.4		
6/22	3587.0	90.0	3.2	6.9	1.0	0.5		
6/23	3477.0	100.0	3.5	6.9	1.0	0.5		
6/24	3487.0	120.0	4.1	7.0	1.6	0.6		
6/25	3311.0	110.0	4.0	7.1	1.8	0.7		
6/26	3132.0	100.0	3.8	7.1	2.0			
6/27	3215.0	80.0	3.0	7.0	1.9			
6/28	3529.0	80.0	2.7	6.9	1.3	0.6		
6/29	3739.0	90.0	2.6	6.9	1.0	0.5		
6/30	3535.0	120.0	4.1	6.7	0.8	0.7		
6/1	3469.0	110.0	3.8	6.9	1.8	0.7		
6/2	3229.0	90.0	3.0	6.9	1.9	0.4		
6/3	3201.0	120.0	4.5	6.9	2.0			
6/4	3234.0	100.0	3.7	6.9	2.2			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160980 C.U.P. NO. 2-031-0036N NAME OF DRINKING WATER SYSTEM: ROYAL LAKES WATER TREATMENT PLANT
 LOCATION: 8509 WESTERN WAY DRIVE JACKSONVILLE, FLA., DUVAL COUNTY
 OPERATED BY: JACKSONVILLE SUBURBAN UTILITIES REPORTING MONTH: May 1996
 INFLUENT EFFLUENT pH: 7.0 (AVG) NO. OF SERVICES AT END OF MONTH: 1946
 SIGN FLOW: _____ MAIN OFFICE PHONE NO. (904) 721-4600
 I CERTIFY THIS REPORT IS CORRECT Prentiss Daraway, C.O., CERT. NO. C-5698

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	106799.0	3270.0	113.9	218.0	39.2	10.8	30	
AVERAGE	3445.1	105.5	3.7	7.0	1.3	0.5		
MINIMUM	3929.0	135.0	4.9	7.2	2.0	0.7		
MINIMUM	3111.0	80.0	2.7	6.8	0.8	0.3		
01	3329.0	110.0	4.0	7.1	1.0	0.6		
02	3407.0	90.0	3.2	7.1	1.0	0.7		
03	3326.0	90.0	3.2	7.2	1.4	0.4		
04	3144.0	90.0	3.4	7.0	1.1			
05	3250.0	90.0	3.3	7.0	1.6			
06	3672.0	90.0	2.9	7.1	1.2	0.3		
07	3445.0	90.0	3.1	6.9	1.0	0.3		
08	3538.0	90.0	3.1	7.0	1.0	0.3	15	
09	3523.0	100.0	3.4	7.1	1.0	0.5	15	
10	3244.0	100.0	3.7	7.0	0.9	0.6		
11	3190.0	80.0	3.0	7.0	1.0			
12	3111.0	80.0	3.1	7.0	1.2			
13	3503.0	80.0	2.7	7.2	1.0	0.3		
14	3485.0	120.0	4.1	7.2	1.2	0.4		
15	3665.0	120.0	3.9	7.1	1.0	0.4		
16	3629.0	133.0	4.4	7.1	1.1	0.3		
17	3427.0	133.0	4.7	6.8	1.4	0.5		
18	3298.0	133.0	4.9	7.0	2.0			
19	3370.0	133.0	4.7	6.9	2.0			
20	3646.0	135.0	4.4	6.9	1.6	0.5		
21	3566.0	133.0	4.5	7.1	1.3	0.7		
22	3639.0	130.0	4.3	7.1	1.2	0.7		
23	3929.0	110.0	3.4	7.1	1.9	0.7		
24	3583.0	120.0	4.0	7.0	1.8	0.7		
25	3248.0	100.0	3.7	7.0	1.4			
26	3168.0	90.0	3.4	7.0	1.7			
27	3496.0	90.0	3.1	6.9	1.8			
28	3566.0	100.0	3.4	7.0	1.0	0.6		
29	3446.0	90.0	3.1	7.0	0.8	0.4		
30	3478.0	100.0	3.5	7.1	0.8	0.5		
31	3478.0	120.0	4.3	7.0	0.8	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: JACKSONVILLE SUBURBAN UTILITIES

REPORTING MONTH: April 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DAILY FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

Penelope Sweeney

, C.O., CERT. NO. C-5698

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
DAILY	94749.0	2880.0	109.1	210.7	46.0	11.2	30	
AVERAGE	3158.3	96.0	3.6	7.0	1.5	0.5		
MAXIMUM	3529.0	110.0	4.1	7.1	2.6	0.7		
MINIMUM	2617.0	70.0	3.2	6.9	0.7	0.3		
01	3207.0	110.0	4.1	7.1	1.4	0.6		
02	3118.0	100.0	3.8	7.0	1.2	0.4		
03	3125.0	100.0	3.8	7.1	1.1	0.5		
04	3276.0	100.0	3.7	7.0	1.2	0.6	15	
05	3056.0	90.0	3.5	7.0	1.4			
06	2676.0	80.0	3.6	7.1	2.5			
07	2617.0	70.0	3.2	7.1	2.6			
08	3135.0	90.0	3.4	6.9	1.5	0.6		
09	3222.0	90.0	3.4	7.0	0.8	0.3		
10	3203.0	100.0	3.7	7.0	1.6	0.6	15	
11	3170.0	90.0	3.4	7.0	1.5	0.5		
12	3140.0	90.0	3.4	7.0	1.6	0.6		
13	3009.0	90.0	3.6	7.0	2.2			
14	3074.0	90.0	3.5	7.1	2.0			
15	3091.0	90.0	3.5	7.1	1.7	0.7		
16	3116.0	100.0	3.9	7.0	0.8	0.7		
17	3189.0	100.0	3.8	6.9	0.8	0.6		
18	3273.0	100.0	3.7	7.0	0.9	0.5		
19	3136.0	100.0	3.8	7.0	1.2	0.6		
20	2952.0	90.0	3.7	7.1	2.0			
21	3088.0	90.0	3.5	7.0	2.5			
22	3252.0	100.0	3.7	6.9	1.2	0.5		
23	3415.0	110.0	3.9	7.0	1.4	0.3		
24	3402.0	110.0	3.9	7.0	1.4	0.6		
25	3529.0	110.0	3.7	7.0	1.3	0.4		
26	3209.0	100.0	3.7	7.1	1.3	0.5		
27	3136.0	90.0	3.4	7.0	2.2			
28	3395.0	100.0	3.5	7.0	2.4			
29	3471.0	110.0	3.8	7.1	1.6	0.7		
30	3067.0	90.0	3.5	7.1	0.7	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IB NO: 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: LAKE LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DIRECTION OF FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT Prenter Galloway, C.O., CERT. NO. C-5698

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
DAILY TOTAL	93846.0	2810.0	111.1	216.4	49.0	9.8	30	
AVERAGE	3027.3	90.6	3.6	7.0	1.6	0.5		
MAXIMUM	3458.0	100.0	4.0	7.1	2.5	0.8		
MINIMUM	2670.0	80.0	3.0	6.9	1.0	0.3		
01	2885.0	80.0	3.3	6.9	1.7	0.5		
02	3076.0	80.0	3.1	6.9	2.0			
03	2934.0	80.0	3.3	7.0	1.4			
04	3373.0	100.0	3.6	6.9	1.5	0.4		
05	3084.0	100.0	3.9	6.9	1.0	0.5	15	
06	3458.0	100.0	3.5	6.9	1.2	0.3		
07	3050.0	100.0	3.9	6.9	1.0	0.4		
08	3007.0	100.0	4.0	6.9	1.4	0.4		
09	2807.0	80.0	3.4	6.9	2.2			
10	2670.0	80.0	3.6	7.0	2.5			
11	2941.0	80.0	3.3	6.9	1.5	0.5		
12	3156.0	80.0	3.0	7.1	1.6	0.3		
13	3419.0	100.0	3.5	7.0	1.2	0.3		
14	3175.0	100.0	3.8	7.1	1.4	0.8	15	
15	3123.0	100.0	3.8	7.0	1.3	0.6		
16	2992.0	80.0	3.2	6.9	2.0			
17	2908.0	80.0	3.3	7.0	2.0			
18	3161.0	100.0	3.8	7.0	1.4	0.4		
19	2989.0	90.0	3.6	7.1	1.1	0.3		
20	2833.0	100.0	4.0	7.0	1.4	0.5		
21	2950.0	90.0	3.7	7.0	1.8	0.7		
22	3053.0	100.0	3.9	7.1	2.2	0.6		
23	2889.0	80.0	3.3	7.0	1.5			
24	2833.0	80.0	3.4	7.1	2.2			
25	3103.0	100.0	3.9	6.9	1.5	0.5		
26	3205.0	100.0	3.7	7.0	1.4	0.3		
27	3092.0	100.0	3.9	7.0	1.6	0.4		
28	3035.0	100.0	4.0	7.0	1.4	0.5		
29	2974.0	90.0	3.6	7.0	1.6	0.6		
30	2844.0	80.0	3.4	7.0	1.4			
31	2827.0	80.0	3.4	7.0	1.6			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2190980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: AL LAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

I CERTIFY THIS REPORT IS CORRECT Prentiss Larraway, C.O., CERT. NO. C-5698

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	88270.0	2440.0	95.9	203.2	35.0	9.4	30	
AVERAGE	3043.8	84.1	3.3	7.0	1.2	0.4		
MAXIMUM	3301.0	110.0	4.5	7.1	2.0	1.0		
MINIMUM	2683.0	50.0	1.9	6.9	0.7	0.3		
01	3082.0	90.0	3.5	7.1	1.0	0.7		
02	2971.0	90.0	3.6	7.0	1.1	0.5		
03	2686.0	90.0	4.0	7.0	0.9			
04	2838.0	90.0	3.8	7.0	1.5			
05	3301.0	80.0	2.9	6.9	0.9	0.6		
06	3088.0	60.0	2.3	7.0	1.0	0.8		
07	2887.0	80.0	3.3	7.0	0.9	0.3		
08	3082.0	50.0	1.9	7.0	2.0	0.3	15	
09	3070.0	90.0	3.5	7.0	1.3	0.7		
10	2953.0	50.0	2.0	7.0	1.4			
11	2952.0	110.0	4.5	7.1	1.3			
12	3079.0	100.0	3.9	7.0	1.2	1.0		
13	3100.0	70.0	2.7	7.1	0.8	0.3	15	
14	3067.0	70.0	2.7	7.1	0.8	0.3		
15	3079.0	70.0	2.7	7.1	0.7	0.3		
16	2908.0	70.0	2.8	7.1	1.0	0.3		
17	2846.0	100.0	4.2	7.1	1.0			
18	2683.0	100.0	4.2	7.0	1.1			
19	3119.0	100.0	3.8	7.0	1.8	0.4		
20	3229.0	85.0	3.2	6.9	0.9	0.3		
21	3130.0	85.0	3.3	7.0	0.9	0.4		
22	3175.0	50.0	1.9	6.9	1.3	0.4		
23	3076.0	50.0	2.0	6.9	1.2	0.4		
24	3039.0	100.0	3.9	7.1	1.4			
25	3050.0	100.0	3.9	7.0	2.0			
26	3267.0	100.0	3.7	6.9	1.4	0.3		
27	3288.0	110.0	4.0	7.0	1.0	0.3		
28	3225.0	100.0	3.7	6.9	1.6	0.4		
29	3000.0	100.0	4.0	7.0	1.6	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160980 C.U.P. NO. 2-031-0036N

NAME OF DRINKING WATER SYSTEM: ROKAWAKES WATER TREATMENT PLANT

LOCATION: 8509 WESTERN WAY DRIVE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 1946

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 721-4600

CERTIFY THIS REPORT IS CORRECT

René L. Lurway

, C.O., CERT. NO. C-5698

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL WATER SAMPLES	BACTERIOLOGICAL MCI VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	91724.0	2520.0	102.8	218.0	46.1	7.6	30	
AVERAGE	2958.8	81.3	3.3	7.0	1.5	0.3		
MAXIMUM	3167.0	100.0	4.1	7.1	2.8	0.5		
MINIMUM	2695.0	50.0	1.9	6.9	0.8	0.2		
01	2774.0	95.0	4.1	7.0	2.5	0.4		
02	2949.0	95.0	3.6	7.0	1.4	0.3		
03	3011.0	95.0	3.8	7.0	1.4	0.3		
04	2960.0	100.0	3.9	7.1	1.5	0.3		
05	2894.0	100.0	4.1	7.1	1.4	0.4		
06	2919.0	100.0	4.1	7.1	2.4		15	
07	2940.0	100.0	4.1	7.0	2.1			
08	3167.0	85.0	3.8	7.1	1.5	0.3		
09	3040.0	85.0	3.3	7.0	1.3	0.4		
10	3000.0	85.0	3.4	7.1	1.4	0.3		
11	2925.0	85.0	3.5	7.0	1.3	0.3		
12	2854.0	85.0	3.6	7.0	1.4	0.3	15	
13	2696.0	60.0	2.7	7.0	2.0			
14	2695.0	70.0	3.1	6.9	1.8			
15	3125.0	50.0	1.9	7.0	1.4	0.4		
16	3045.0	50.0	2.0	6.9	1.3	0.3		
17	3079.0	80.0	3.1	7.0	1.2	0.3		
18	3056.0	70.0	2.7	7.0	1.3	0.3		
19	2994.0	80.0	3.2	7.0	1.6	0.4		
20	2732.0	80.0	3.5	7.0	2.4			
21	2812.0	80.0	3.4	7.1	0.8			
22	3027.0	80.0	3.2	7.1	1.0	0.5		
23	3036.0	80.0	3.2	7.1	1.0	0.4		
24	3068.0	80.0	3.1	7.1	1.0	0.3		
25	3078.0	80.0	3.1	7.1	1.0	0.2		
26	2982.0	80.0	3.1	6.9	0.8	0.3		
27	2806.0	80.0	3.4	7.0	2.0			
28	2765.0	80.0	3.5	7.0	2.8			
29	3096.0	80.0	3.1	7.1	1.0	0.3		
30	3119.0	80.0	3.1	7.1	1.0	0.3		
31	3080.0	70.0	3.1	7.1	1.1	0.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: December 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

SIGNATURE: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas E Jones, C.O., CERT. NO. C-002710

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GAL. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	59961.0	4280.0	265.8	216.4	69.0	11.1	25	
AVERAGE	1934.2	138.1	8.6	7.0	2.2	0.6		
MAXIMUM	2187.0	200.0	13.2	7.0	3.0	1.3		
MINIMUM	1752.0	110.0	6.8	6.8	0.9	0.2		
01	2062.0	200.0	11.6	7.0	1.3			
02	1827.0	150.0	9.8	7.0	2.6	0.5		
03	2187.0	200.0	11.0	7.0	2.7	0.3		
04	1925.0	130.0	8.1	6.8	1.8	0.5	12	
05	1783.0	120.0	8.1	7.0	1.7	0.5	13	
06	1856.0	120.0	7.8	7.0	2.0	0.6		
07	1842.0	120.0	7.8	7.0	2.0			
08	2027.0	120.0	7.1	6.8	2.8			
09	1817.0	200.0	13.2	7.0	0.9	0.5		
10	1929.0	120.0	7.5	7.0	2.9	0.4		
11	2112.0	140.0	7.9	7.0	1.7	0.5		
12	1932.0	140.0	8.7	7.0	2.0	0.5		
13	1752.0	160.0	11.0	6.9	2.5	0.4		
14	1884.0	120.0	7.6	7.0	2.0			
15	2075.0	120.0	6.9	6.9	2.6			
16	1849.0	110.0	7.1	7.0	2.5	0.3		
17	1781.0	150.0	10.1	7.0	3.0	0.5		
18	1840.0	120.0	7.8	7.0	1.5	0.6		
19	1928.0	120.0	7.5	7.0	3.0	1.0		
20	2010.0	120.0	7.2	7.0	2.3	0.5		
21	1956.0	120.0	7.4	7.0	1.0			
22	1952.0	110.0	6.8	7.0	1.5			
23	1899.0	120.0	7.6	7.0	2.4	0.5		
24	1932.0	150.0	9.3	7.0	2.0			
25	1848.0	110.0	7.1	7.0	2.4			
26	1902.0	140.0	8.8	7.0	3.0	1.3		
27	1950.0	140.0	8.6	7.0	3.0	0.9		
28	1926.0	130.0	8.1	7.0	2.6			
29	2059.0	190.0	11.4	7.0	2.7			
30	2072.0	140.0	8.1	7.0	2.5	0.2		
31	2047.0	150.0	8.8	7.0	2.1	0.6		

WELL SAMPLES TAKEN: 12-04-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: November 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

WASTEWATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Thomas J. Jones

, C.O., CERT. NO. C-002710

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	RESIDUAL CHLORINE mg/L REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	64591.0	4520.0	254.3	209.3	52.9	11.4	25	
AVERAGE	2153.0	150.7	8.5	7.0	1.8	0.6		
MAXIMUM	2401.0	220.0	12.6	7.0	3.0	0.9		
MINIMUM	1906.0	110.0	5.5	6.9	1.0	0.3		
01	2243.0	140.0	7.5	7.0	3.0	0.5		
02	2401.0	140.0	7.0	7.0	1.0			
03	2393.0	110.0	5.5	7.0	1.0			
04	2253.0	130.0	6.9	7.0	1.5	0.7	12	
05	2359.0	200.0	10.2	7.0	1.0	0.7		
06	2311.0	160.0	8.3	6.9	1.8	0.4		
07	2252.0	180.0	9.6	7.0	2.2	0.4		
08	2024.0	140.0	8.3	7.0	1.8	0.6		
09	2242.0	120.0	6.4	6.9	1.9			
10	2234.0	140.0	7.5	7.0	1.4			
11	2268.0	120.0	6.3	6.9	2.0	0.6	13	
12	2184.0	160.0	8.8	7.0	1.9	0.7		
13	2232.0	160.0	8.6	6.9	1.1	0.8		
14	2110.0	160.0	9.1	6.9	1.6	0.3		
15	2065.0	160.0	9.6	6.9	1.0	0.8		
16	2091.0	120.0	7.2	7.0	1.9			
17	2232.0	220.0	11.8	7.0	1.9			
18	2125.0	180.0	10.8	7.0	1.8	0.4		
19	2111.0	120.0	6.8	7.0	2.0	0.5		
20	2112.0	180.0	10.2	7.0	2.2	0.4		
21	2005.0	160.0	9.6	6.9	1.0	0.5		
22	1906.0	200.0	12.6	7.0	1.9	0.9		
23	2052.0	150.0	8.8	7.0	1.0			
24	2308.0	150.0	7.8	7.0	1.1			
25	1974.0	140.0	8.5	7.0	3.0	0.8		
26	1967.0	140.0	8.5	7.0	2.7	0.8		
27	1964.0	140.0	8.5	7.0	2.0	0.6		
28	2119.0	120.0	7.0	7.0	1.9			
29	2051.0	120.0	7.0	7.0	2.1			
30	2003.0	160.0	9.6	7.0	2.2			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

AS ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas Jones, C.O., CERT. NO. C-002710

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	66971.0	4860.0	268.6	215.9	50.8	11.7	25	
AVERAGE	2160.4	156.8	8.7	7.0	1.6	0.5		
MAXIMUM	2479.0	210.0	12.1	7.0	3.0	0.9		
MINIMUM	1838.0	110.0	6.3	6.9	1.0	0.3		
01	2026.0	180.0	10.8	7.0	2.0	0.5		
02	1938.0	160.0	9.9	7.0	1.8	0.4		
03	1936.0	140.0	8.9	7.0	1.0	0.5		
04	1896.0	140.0	8.9	7.0	2.6	0.6		
05	2004.0	120.0	7.2	6.9	1.5			
06	2131.0	160.0	9.0	7.0	2.0			
07	1838.0	120.0	8.0	6.9	1.2	0.5		
08	2366.0	160.0	8.1	6.9	1.0	0.5		
09	2148.0	120.0	6.9	6.9	1.1	0.4		
10	1927.0	110.0	6.8	7.0	1.2	0.3		
11	1971.0	210.0	9.7	6.9	1.2	0.8		
12	2069.0	120.0	7.0	6.9	1.9			
13	2305.0	160.0	8.3	7.0	3.0			
14	2125.0	180.0	10.2	7.0	2.5	0.6	12	
15	2056.0	140.0	8.2	7.0	1.5	0.7		
16	2052.0	140.0	8.2	6.9	1.6	0.7		
17	1999.0	140.0	8.4	7.0	1.6	0.5	13	
18	1988.0	200.0	12.1	7.0	2.2	0.4		
19	2212.0	180.0	9.8	6.9	1.5			
20	2290.0	120.0	6.3	7.0	1.9			
21	2194.0	140.0	7.7	7.0	1.0	0.6		
22	2274.0	140.0	7.4	6.9	2.4	0.4		
23	2304.0	200.0	10.4	7.0	2.2	0.9		
24	2368.0	180.0	9.1	7.0	1.3	0.5		
25	2294.0	180.0	9.5	6.9	1.9	0.4		
26	2446.0	180.0	9.0	6.9	1.5			
27	2479.0	200.0	9.7	7.0	1.9			
28	2290.0	160.0	8.4	7.0	1.0	0.3		
29	2382.0	160.0	8.0	7.0	1.0	0.4		
30	2338.0	160.0	8.4	7.0	1.3	0.4		
31	2325.0	160.0	8.3	7.0	1.0	0.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

IF THIS REPORT IS CORRECT

Thomas G. Jones

, C.O., CERT. NO. C-002710

TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
71095.0	5050.0	257.3	209.4	58.4	9.4	25	
2369.8	168.3	8.6	7.0	1.9	0.5		
2817.0	220.0	10.6	7.0	3.0	0.9		
2009.0	120.0	6.4	6.9	1.0	0.2		
021.0	150.0	8.9	7.0	2.0			
188.0	180.0	9.9	7.0	1.7			
152.0	140.0	8.2	6.9	2.5	0.3		
09.0	160.0	9.6	7.0	2.5	0.5		
33.0	140.0	7.7	7.0	2.5	0.4		
19.0	180.0	9.6	7.0	2.1	0.2		
6.0	200.0	9.0	6.9	2.4			
7.0	200.0	8.5	7.0	1.9			
.0	160.0	9.1	7.0	3.0	0.4		
.0	160.0	9.2	7.0	2.7	0.5		
0	160.0	8.9	6.9	2.6	0.4		
0	160.0	8.9	7.0	1.8	0.5	12	
)	160.0	8.4	7.0	1.8	0.3		
	160.0	8.0	7.0	2.0			
	160.0	7.5	6.9	2.0			
	160.0	8.4	7.0	1.2	0.4	13	
	120.0	6.5	7.0	1.0	0.3		
	180.0	9.5	7.0	1.0	0.5		
	200.0	9.9	7.0	1.0	0.4		
	160.0	8.0	7.0	1.1	0.4		
	160.0	7.9	7.0	1.5			
	220.0	10.1	7.0	1.2			
	180.0	8.4	6.9	2.5	0.5		
	140.0	6.4	7.0	2.8	0.4		
	160.0	7.3	6.9	2.0	0.8		
	180.0	8.3	7.0	1.0	0.9		
	160.0	7.6	7.0	2.0	0.8		
	180.0	7.8	7.0	1.7			
	220.0	10.6	7.0	1.9			
	160.0	9.2	7.0	3.0	0.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: August 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas S Jones, C.O., CERT. NO. C-002710

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
8/1	77130.0	5380.0	264.6	216.3	48.5	9.5	25	
8/2	2488.1	173.5	8.5	7.0	1.6	0.4		
8/3	3043.0	210.0	10.1	7.0	3.0	0.7		
8/4	2049.0	100.0	5.8	6.9	0.9	0.3		
8/5	2479.0	180.0	8.7	7.0	3.0	0.3		
8/6	2330.0	160.0	8.4	7.0	1.0	0.4		
8/7	2354.0	180.0	9.0	6.9	1.2			
8/8	2497.0	190.0	9.1	7.0	3.0			
8/9	2607.0	170.0	7.8	6.9	1.0	0.3		
8/10	2545.0	200.0	9.5	7.0	1.0	0.3		
8/11	2377.0	200.0	10.1	7.0	2.0	0.5	12	
8/12	2452.0	160.0	7.8	7.0	1.2	0.6		
8/13	2504.0	140.0	6.7	7.0	1.0	0.4		
8/14	2755.0	160.0	7.0	7.0	1.0			
8/15	2355.0	190.0	9.7	7.0	1.2			
8/16	2110.0	160.0	9.1	7.0	2.0	0.7		
8/17	2101.0	170.0	9.7	7.0	1.8	0.5	13	
8/18	2049.0	140.0	8.2	7.0	2.5	0.3		
8/19	3043.0	140.0	8.2	6.9	1.6	0.4		
8/20	2068.0	100.0	5.8	6.9	1.8	0.5		
8/21	2364.0	160.0	8.1	7.0	1.9			
8/22	2593.0	190.0	8.8	7.0	1.7			
8/23	2654.0	170.0	7.7	6.9	1.4	0.4		
8/24	2453.0	190.0	9.3	7.0	1.3	0.5		
8/25	2498.0	170.0	8.2	7.0	2.6	0.3		
8/26	2740.0	200.0	8.8	7.0	1.2	0.5		
8/27	2615.0	180.0	8.3	7.0	2.6	0.4		
8/28	2892.0	180.0	7.5	6.9	2.0			
8/29	2979.0	200.0	9.1	6.9	1.5			
8/30	2478.0	190.0	9.2	7.0	1.0	0.4		
8/31	2531.0	210.0	10.0	7.0	1.0	0.5		
	2639.0	180.0	8.3	7.0	0.9	0.4		
	2586.0	190.0	8.8	7.0	1.1	0.5		
	2341.0	170.0	8.7	7.0	1.0	0.4		
	2141.0	160.0	9.0	7.0	1.0			

ALL SAMPLES TAKEN: 08-07-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

D NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: SAN JOSE WATER TREATMENT PLANT

LOCATION: 7128 BALBOA ROAD

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: July 1996

EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

IN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Thomas E. Jones, C.O., CERT. NO. C-002710

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALLONS	GALS. OR LBS. USED	mg/L	PLANT EFFLUENT	REMOTE TAP			
DAILY	80826.0	5690.0	259.0	216.4	44.0	12.0	25	
AVERAGE	2607.3	183.5	8.4	7.0	1.4	0.5		
10/10/96	3539.0	300.0	12.6	7.1	3.0	1.0		
10/11/96	1926.0	120.0	6.2	6.9	1.0	0.2		
01	2367.0	150.0	7.6	7.0	1.5	0.2	12	
02	2503.0	160.0	7.7	7.0	1.6	0.3		
03	2532.0	180.0	8.5	7.0	1.9	0.4		
04	2377.0	180.0	9.1	6.9	1.2			
05	2012.0	140.0	8.3	7.0	2.2	0.5		
06	1926.0	120.0	7.5	7.0	2.3			
07	2103.0	140.0	8.0	7.0	1.0			
08	2054.0	140.0	8.0	6.9	1.1	0.3		
09	1995.0	120.0	7.2	6.9	1.0	0.4		
10	2319.0	120.0	6.2	7.0	1.0	0.5		
11	2160.0	120.0	6.6	7.0	3.0	0.9		
12	2322.0	140.0	7.2	7.0	1.0	1.0		
13	2270.0	160.0	8.5	7.0	1.3			
14	2405.0	180.0	9.0	7.0	1.5			
15	2379.0	160.0	8.1	6.9	1.3	0.7		
16	2380.0	160.0	8.1	7.0	1.4	0.9		
17	2391.0	180.0	9.0	7.0	1.5	0.8		
18	2607.0	180.0	8.2	7.0	1.0	0.2		
19	2853.0	300.0	12.6	7.0	1.0	0.3		
20	3034.0	200.0	7.9	7.0	1.0			
21	3103.0	220.0	8.5	7.1	1.1			
22	2989.0	220.0	8.8	7.0	1.0	0.3	13	
23	3094.0	240.0	9.3	7.0	1.0	0.4		
24	2775.0	200.0	8.3	6.9	1.4	0.5		
25	2888.0	200.0	8.3	7.0	1.2	0.6		
26	2915.0	200.0	8.2	7.0	1.8	0.7		
27	3296.0	200.0	7.3	7.0	1.9			
28	3539.0	250.0	8.5	6.9	1.7			
29	3153.0	250.0	9.5	7.0	1.5	0.7		
30	3173.0	240.0	9.1	6.9	1.6	0.7		
31	2912.0	240.0	9.9	7.0	1.0	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: June 1995

EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

IN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Thomas Jones

, C.O., CERT. NO. C-002710

WELL	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	mg/L	EFFLUENT pH	RESIDUAL CHLORINE mg/L PLANT EFFLUENT	REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
WELL								
WELL								
WELL								
WELL								
01	2576.0	200.0	8.9	7.0	1.5			
02	2936.0	200.0	8.2	6.9	1.2			
03	2522.0	180.0	8.6	7.0	0.9	0.5		
04	2719.0	220.0	9.7	7.0	1.0	0.7		
05	2906.0	220.0	9.1	6.9	1.7	0.8		
06	2936.0	220.0	9.0	6.9	1.9	0.9	12	
07	2497.0	180.0	8.7	7.0	2.0	1.0		
08	2212.0	160.0	8.7	7.0	1.2			
09	2284.0	180.0	9.5	7.0	2.0			
10	2178.0	160.0	8.8	7.0	1.0	1.0		
11	2125.0	160.0	9.0	6.9	1.0	0.5		
12	2219.0	140.0	7.6	7.0	1.6	0.4		
13	2206.0	180.0	9.8	7.0	2.0	0.3		
14	2068.0	140.0	8.1	6.9	1.8	0.5		
15	2032.0	180.0	10.6	7.0	1.9			
16	2157.0	160.0	8.9	7.0	2.3			
17	2130.0	160.0	9.0	7.0	2.3	0.3	13	
18	2324.0	140.0	7.4	6.9	1.3	0.4		
19	2224.0	140.0	7.7	6.9	1.0	0.4		
20	2167.0	160.0	8.9	7.0	1.1	0.3		
21	1960.0	120.0	7.2	7.0	1.0	0.3		
22	2045.0	140.0	8.4	7.0	2.3			
23	2303.0	160.0	8.3	6.9	2.9			
24	2216.0	140.0	7.6	6.9	0.9	0.3		
25	2455.0	180.0	8.8	7.0	1.5	0.4		
26	2213.0	160.0	8.7	7.0	1.0	0.3		
27	2011.0	160.0	9.5	7.0	1.2	0.4		
28	1916.0	120.0	7.5	7.0	1.5	0.5		
29	2162.0	140.0	7.8	7.0	2.2			
30	2351.0	170.0	8.7	7.0	1.8			

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: May 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Thomas B. Jones

, C.O., CERT. NO. C-002710

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
4/1	84490.0	5930.0	261.1	215.7	38.6	11.6	25	
4/2	2725.5	191.3	8.4	7.0	1.2	0.5		
4/3	3199.0	240.0	10.1	7.0	2.5	0.9		
4/4	2135.0	120.0	6.2	6.8	0.7	0.2		
4/5	2135.0	120.0	6.7	7.0	1.3	0.6	12	
4/6	2365.0	150.0	7.6	7.0	1.0	0.8		
4/7	2346.0	150.0	7.7	6.9	0.9	0.7		
4/8	2724.0	220.0	9.7	7.0	1.1			
4/9	2905.0	200.0	8.3	6.8	1.8			
4/10	2682.0	220.0	9.8	6.9	1.2	0.7	13	
4/11	2694.0	200.0	8.9	6.9	0.9	0.7		
4/12	2706.0	220.0	9.8	6.9	0.7	0.6		
4/13	2711.0	200.0	8.9	7.0	0.7	0.6		
4/14	2737.0	140.0	6.2	7.0	1.0	0.7		
4/15	2925.0	200.0	8.3	7.0	1.0			
4/16	2977.0	200.0	8.1	6.9	2.0			
4/17	2838.0	200.0	8.5	7.0	0.9	0.2		
4/18	2712.0	170.0	7.5	7.0	0.9	0.3		
4/19	2690.0	150.0	6.7	6.9	2.0	0.2		
4/20	2821.0	200.0	8.5	6.9	1.0	0.3		
4/21	2904.0	180.0	7.4	7.0	1.0	0.3		
4/22	3150.0	200.0	7.6	7.0	1.0			
4/23	3199.0	200.0	7.5	7.0	1.2			
4/24	2918.0	210.0	8.6	6.9	1.5	0.4		
4/25	2369.0	200.0	10.1	6.9	1.4	0.4		
4/26	2723.0	220.0	9.7	7.0	1.0	0.6		
4/27	2985.0	220.0	8.8	7.0	2.5	0.6		
4/28	2980.0	200.0	8.1	7.0	1.2	0.5		
4/29	3143.0	220.0	8.4	7.0	1.7			
4/30	2832.0	220.0	9.3	6.9	1.3			
4/31	3009.0	240.0	9.6	7.0	1.3			
5/1	2378.0	180.0	9.1	6.9	1.5	0.4		
5/2	2226.0	140.0	7.5	7.0	1.6	0.5		
5/3	2356.0	180.0	9.2	7.0	1.0	0.6		
5/4	2350.0	180.0	9.0	7.0	1.0	0.9		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2160995 C.U.P. NO. 2-031-0033 NAME OF DRINKING WATER SYSTEM: Jose Water Treatment Plant

LOCATION: 7128 Balboa Road Jacksonville, Fla., Duval County

ISSUED BY: United Water Florida Inc. REPORTING MONTH: April 1996

AVERAGE EFFLUENT pH: 7.0 (AVG) NO. OF SERVICES AT END OF MONTH: 3838

PHONE NO.: _____ MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas B. Jones, C.O., CERT. NO. C-002710

YS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE BALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE PLANT EFFLUENT mg/L	RESIDUAL CHLORINE REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
TOTAL	71133.0	5150.0	209.1	49.6	9.9	25	
ERAGE	2371.1	171.7	7.0	1.7	0.5		
MINUM	2873.0	240.0	7.0	3.0	0.8		
MINUM	1875.0	80.0	6.9	0.8	0.2		
01	1875.0	160.0	7.0	3.0	0.3		
02	1925.0	100.0	7.0	2.9	0.2		
03	2082.0	120.0	6.9	1.3	0.3	12	
04	2103.0	180.0	7.0	1.5	0.4		
05	2229.0	200.0	7.0	1.4			
06	1973.0	190.0	7.0	2.1			
07	2166.0	160.0	7.0	3.0			
08	2256.0	180.0	6.9	2.3	0.4		
09	2287.0	190.0	7.0	2.0	0.6		
10	2323.0	190.0	7.0	1.8	0.5		
11	2358.0	120.0	7.0	1.9	0.7		
12	2355.0	80.0	7.0	1.4	0.5		
13	2689.0	120.0	7.0	1.8		13	
14	2756.0	200.0	6.9	1.9			
15	2204.0	200.0	7.0	1.5	0.2		
16	2118.0	240.0	7.0	3.0	0.5		
17	2388.0	240.0	7.0	1.0	0.8		
18	2404.0	160.0	7.0	1.0	0.5		
19	2439.0	200.0	6.9	0.8	0.4		
20	2529.0	180.0	7.0	1.0			
21	2648.0	180.0	7.0	2.0			
22	2562.0	160.0	6.9	1.0	0.4		
23	2588.0	180.0	6.9	0.9	0.3		
24	2651.0	190.0	6.9	0.8	0.4		
25	2585.0	150.0	7.0	1.1	0.8		
26	2476.0	160.0	7.0	1.8	0.6		
27	2816.0	160.0	7.0	1.6			
28	2873.0	190.0	7.0	1.0			
29	2345.0	190.0	6.9	1.5	0.5		
30	1930.0	180.0	6.9	1.3	0.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

DONE NEW FORMAT

ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: March 1996

AVERAGE EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DAILY FLOW: -----

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Thomas E. Jones, C.O., CERT. NO. C-002710

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/L	EFFLUENT pH	RESIDUAL CHLORINE PLANT EFFLUENT mg/L	RESIDUAL CHLORINE REMOTE TAP	NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
DAILY TOTAL	62468.0	4150.0	249.7	215.8	64.1	12.9	25	
AVERAGE	2015.1	133.9	8.1	7.0	2.1	0.6		
MAXIMUM	2431.0	250.0	12.3	7.0	3.1	1.4		
MINIMUM	1768.0	100.0	5.5	6.9	0.7	0.2		
01	1817.0	110.0	7.3	6.9	2.2	0.8		
02	1768.0	110.0	7.5	7.0	2.0			
03	2007.0	120.0	7.2	6.9	2.3			
04	1912.0	160.0	10.0	7.0	2.6	0.5	12	DUO
05	1973.0	130.0	7.9	6.9	3.0	0.2		
06	1968.0	110.0	6.7	7.0	3.1	0.6		
07	1849.0	180.0	11.7	7.0	2.8	0.5		
08	1910.0	120.0	7.6	6.9	1.5	0.5		
09	2067.0	120.0	7.2	6.9	2.0			
10	2006.0	160.0	9.6	7.0	2.5			
11	1855.0	140.0	9.1	7.0	3.0	0.7		
12	1921.0	120.0	7.5	7.0	2.3	1.1		
13	1970.0	110.0	6.6	6.9	1.6	1.4	13	TRIAL
14	1934.0	130.0	8.1	6.9	1.6	0.6		
15	2060.0	130.0	7.6	7.0	1.7	0.6		
16	2431.0	250.0	12.3	7.0	2.3			
17	2370.0	170.0	8.6	7.0	2.7			
18	1839.0	160.0	10.4	7.0	2.0	0.7		
19	1933.0	120.0	7.4	6.9	1.5	0.8		
20	1917.0	120.0	7.5	7.0	1.6	0.7		
21	2318.0	100.0	6.2	7.0	2.0	0.5		
22	1997.0	140.0	8.4	7.0	1.7	0.6		
23	2106.0	110.0	6.3	7.0	1.7			
24	2405.0	110.0	5.5	6.9	1.8			
25	2173.0	110.0	6.1	7.0	1.9	0.2		
26	2123.0	120.0	6.8	6.9	0.9	0.5		
27	1934.0	150.0	9.3	6.9	0.7	0.4		
28	1810.0	150.0	9.9	7.0	2.3	0.5		
29	2048.0	110.0	6.6	7.0	3.0	0.5		
30	2056.0	140.0	8.4	6.9	0.8			
31	1991.0	140.0	8.4	7.0	3.0			

WELL SAMPLES TAKEN 03/04/96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

Done. New Format

WS ID NO. 2160995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: San Jose Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

OWNED BY: United Water Florida Inc.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Thomas G. Jones, C.O., CERT. NO. C-002710

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	ag/L		PLANT EFFLUENT	REMOTE TAP		
MONTHLY TOTAL	61274.0	4420.0	254.3	202.0	59.5	13.7	25	
AVERAGE	2112.9	152.4	8.8	7.0	2.1	0.7		
MAXIMUM	2511.0	220.0	12.1	7.1	3.0	2.5		
MINIMUM	1793.0	100.0	5.9	6.8	1.0	0.2		
01	2073.0	140.0	8.1	6.9	1.0	0.4		
02	1901.0	180.0	11.4	7.0	1.0	0.5		
03	2004.0	160.0	9.6	7.1	1.2			
04	2404.0	140.0	7.0	7.0	3.0			
05	2479.0	150.0	7.3	7.0	1.2	0.3		
06	2117.0	180.0	10.2	7.0	2.2	0.2		
07	2082.0	190.0	11.0	7.0	2.8	0.4		
08	2005.0	140.0	8.4	6.9	3.0	0.2	12	
09	1975.0	140.0	8.5	7.0	2.5	0.8		
10	2160.0	160.0	8.9	7.0	2.7			
11	2189.0	220.0	12.1	6.8	3.0			
12	2063.0	160.0	9.3	7.0	2.3	0.7		
13	1926.0	120.0	7.5	7.0	1.5	0.8		
14	2048.0	100.0	5.9	7.0	1.5	0.5		
15	1916.0	120.0	7.5	7.0	1.3	0.7		
16	2049.0	140.0	8.2	7.0	1.8	0.6		
17	2024.0	140.0	8.3	7.0	2.8			
18	2170.0	160.0	8.8	7.0	3.0			
19	2101.0	140.0	8.0	7.0	2.1			
20	2092.0	140.0	8.0	7.0	2.2	2.5		
21	2091.0	160.0	9.2	6.8	1.6	1.4		
22	2076.0	140.0	9.2	6.9	1.6	0.5		
23	2110.0	140.0	8.0	6.9	2.1	0.7		
24	2293.0	160.0	8.4	6.9	1.7			
25	2511.0	160.0	7.6	7.0	2.3			
26	2194.0	140.0	8.8	6.9	2.5	0.5	13	
27	2203.0	160.0	8.7	7.0	2.0	0.7		
28	2225.0	180.0	9.7	7.0	1.9	0.7		
29	1793.0	160.0	10.7	6.9	1.7	0.6		

86F486L

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NEW FORMAT

ID NO. 21E0995 C.U.P. NO. 2-031-0033

NAME OF DRINKING WATER SYSTEM: S.W. Lake Water Treatment Plant

LOCATION: 7128 Balboa Road

Jacksonville, Fla., Duval County

ID BY: United Water Florida Inc.

REPORTING MONTH: January 1996

INFLUENT pH: 7.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 3838

IGN FLOW: -----

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Thomas G. Jones

, C.O., CERT. NO. C-002710

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
THLY								
TOTAL	62412.0	4570.0	273.1	216.2	75.3	13.0	25	
AVERAGE	2013.3	147.4	8.8	7.0	2.4	0.6		
MINIMUM	2431.0	200.0	11.0	7.1	3.0	1.2		
MINIMUM	1823.0	100.0	6.0	6.9	1.0	0.2		
96-01	1925.0	160.0	9.6	7.0	2.6			
96-02	1901.0	170.0	10.7	6.9	3.0	0.7		
96-03	2431.0	200.0	9.9	7.0	3.0	0.6	12	
96-04	2003.0	170.0	10.2	7.1	2.1	0.4		
96-05	1837.0	120.0	8.0	7.0	2.0	0.4		
96-06	1938.0	160.0	10.1	7.0	3.0			
96-07	2300.0	200.0	10.4	6.9	3.0			
96-08	2365.0	180.0	9.1	6.9	1.0	0.8	13	
96-09	2090.0	160.0	9.6	7.0	1.0	0.6		
96-10	1969.0	160.0	9.8	7.0	2.8	1.2		
96-11	1898.0	140.0	8.8	7.0	3.0	0.6		
96-12	1823.0	160.0	10.7	7.1	2.6	0.4		
96-13	1998.0	160.0	9.6	7.0	3.0			
96-14	2033.0	140.0	8.3	7.0	3.0			
96-15	2065.0	140.0	8.4	6.9	3.0	0.6		
96-16	1903.0	140.0	8.9	7.0	3.0	0.4		
96-17	1971.0	120.0	7.3	7.0	3.0	0.8		
96-18	1900.0	110.0	6.9	6.9	1.6	0.4		
96-19	1841.0	100.0	6.7	7.0	1.7	0.6		
96-20	1940.0	140.0	8.9	7.0	1.0			
96-21	1971.0	180.0	11.0	6.9	3.0			
96-22	1957.0	100.0	6.0	7.0	3.0	1.0		
96-23	1942.0	170.0	10.8	7.0	2.1	0.6		
96-24	1903.0	110.0	6.9	6.9	2.0	0.2		
96-25	1841.0	100.0	6.5	7.0	3.0	0.2		
96-26	1907.0	160.0	6.3	7.0	1.5	0.8		
96-27	2232.0	180.0	9.8	6.9	3.0			
96-28	2234.0	190.0	10.2	7.0	3.0			
96-29	2145.0	150.0	8.6	6.9	2.8	0.3		
96-30	2091.0	120.0	6.9	7.0	1.5	0.9		
96-31	2058.0	140.0	8.2	6.9	2.0	0.4		

7
25
42

JLP
*

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 254368 C.U.P. NO.

ION: 2740-1 CR 210 W.

BY: United Water Florida Inc.

EFFLUENT pH: 7.3 (AVG)

FLOW: .100 (MGD)

NAME OF DRINKING WATER SYSTEM: ST JOHNS FOREST WATER TREATMENT PLANT

COUNTY: ST. JOHNS

REPORTING MONTH: December 1996

NO. OF SERVICES AT END OF MONTH: 24

MAIN OFFICE PHONE NO. (904) 725-2865

IF THIS REPORT IS CORRECT

Michael A. Stein

C.O., CERT. NO. C-4789

TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP		
1619.0	40.9	96.8	218.3	42.6	11.9	2	
52.2	1.3	3.1	7.3	1.4	0.5		
104.0	2.1	5.2	7.4	2.3	1.0		
26.0	0.6	1.5	7.1	0.5	0.2		
46.0	2.0	5.2	7.1	2.3			
35.0	0.9	3.1	7.2	1.4	0.5		
38.0	1.0	3.2	7.2	1.8	0.9		
49.0	1.2	2.9	7.2	1.7	1.0		
43.0	1.1	3.1	7.2	1.6	0.9	2	
62.0	1.7	3.3	7.2	1.7	0.5		
26.0	0.7	3.2	7.2	1.6			
44.0	1.1	3.0	7.2	0.5			
45.0	1.1	2.9	7.2	1.4	0.5		
36.0	0.6	2.0	7.2	1.5	0.6		
48.0	1.2	3.0	7.2	1.4	0.4		
82.0	2.1	3.1	7.2	1.3	0.4		
56.0	1.4	3.0	7.2	1.5	0.5		
38.0	0.9	2.8	7.3	0.7			
64.0	1.7	3.2	7.3	0.5			
49.0	1.2	2.9	7.3	1.0	0.2		
41.0	1.3	3.8	7.3	1.5	0.4		
43.0	0.9	2.5	7.3	1.3	0.5		
55.0	1.4	3.1	7.3	1.4	0.4		
45.0	1.1	2.9	7.3	1.6	0.6		
57.0	1.4	2.9	7.4	1.4			
102.0	1.4	1.6	7.4	1.6			
104.0	1.3	1.5	7.4	1.5	0.5		
55.0	1.4	3.1	7.3	1.3	0.4		
54.0	1.4	3.1	7.4	1.2	0.4		
54.0	1.4	3.1	7.4	1.1	0.4		
40.0	1.0	3.0	7.3	1.4	0.5		
44.0	1.8	4.0	7.3	1.3	0.5		
45.0	1.5	4.0	7.4	1.8	0.5		
53.0	1.6	3.6	7.4	1.0	0.2		
36.0	2.1	4.5		1.3	0.2		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: December 1996

AVERAGE EFFLUENT pH: 8.0 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DAILY SIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Lawrence P. Wilky, C.O., CERT. NO. C-6345

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
MONTHLY TOTAL	9863.0	1100.0	419.1	249.3	84.4	31.3	9.0	3.8	2	
AVERAGE	318.2	35.5	13.5	8.0	2.7	1.5	3.0	1.3		
MAXIMUM	405.0	50.0	20.7	8.2	4.1	3.0	3.0	1.6		
MINIMUM	227.0	18.0	9.2	7.2	1.3	0.5	3.0	1.1		
01	338.0	27.0	9.6	7.3	2.8		3.0	1.1		
02	227.0	18.0	9.5	7.2	3.1	1.1	3.0	1.6	2	
03	310.0	36.0	13.9	7.2	3.2	1.3	3.0	1.2		
04	324.0	45.0	16.7	8.2	2.5	1.3				
05	329.0	39.0	14.2	8.2	2.8	1.7				
06	277.0	30.0	13.0	8.2	1.7	1.9				
07	236.0	31.0	15.8	8.2	2.8					
08	306.0	39.0	15.3	8.1	2.5					
09	315.0	35.0	13.3	8.2	3.1	0.6				
10	316.0	28.0	10.6	8.2	2.7	0.5				
11	269.0	21.0	9.4	8.2	2.6	0.7				
12	267.0	46.0	20.7	8.2	2.8	0.8				
13	292.0	33.0	13.6	8.2	2.9	1.4				
14	324.0	31.0	11.5	8.0	1.5					
15	334.0	28.0	10.1	8.1	1.3					
16	330.0	39.0	14.2	8.1	2.9	0.7				
17	338.0	46.0	16.3	8.2	2.5	1.5				
18	246.0	42.0	20.5	8.2	3.0	1.8				
19	298.0	39.0	15.7	8.2	2.8	0.9				
20	250.0	33.0	15.8	8.0	3.2	1.9				
21	311.0	38.0	14.7	8.1	2.8					
22	397.0	41.0	12.4	8.1	3.0					
23	360.0	50.0	16.7	8.0	2.9	2.0				
24	394.0	50.0	15.2	8.2	3.0	1.9				
25	280.0	36.0	15.4	8.2	2.8					
26	389.0	45.0	13.9	8.2	2.6	2.9				
27	368.0	34.0	11.1	8.2	4.1	3.0				
28	405.0	36.0	10.7	7.9	3.0					
29	286.0	24.0	10.1	8.0	2.8					
30	344.0	29.0	10.1	8.0	2.6	2.1				
31	403.0	31.0	9.2	8.0	2.1	1.3				

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: November 1996

PLANT EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Laura P. Kelly

, C.O., CERT. NO. C-6345

MYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
MONTHLY TOTAL	11593.0	871.0	270.8	219.8	68.8	18.7	90.0	29.2	2	
AVERAGE	386.4	29.0	9.0	7.3	2.3	0.9	3.0	1.0		
MAXIMUM	537.0	40.0	9.7	7.5	3.1	1.5	3.0	1.6		
MINIMUM	222.0	17.0	7.4	7.2	0.9	0.6	3.0	0.7		
01	498.0	39.0	9.4	7.3	1.6	0.8	3.0	0.7		
02	537.0	40.0	8.9	7.4	2.1		3.0	0.7		
03	399.0	30.0	9.0	7.2	2.3		3.0	0.9		
04	425.0	31.0	8.8	7.3	2.8	0.8	3.0	0.8	2	
05	456.0	36.0	9.5	7.3	2.9	1.1	3.0	0.8		
06	468.0	35.0	9.0	7.3	2.0	0.7	3.0	0.8		
07	437.0	30.0	8.2	7.4	1.5	0.6	3.0	0.8		
08	342.0	26.0	9.1	7.4	2.4	0.7	3.0	1.1		
09	470.0	36.0	9.2	7.4	3.0		3.0	0.8		
10	326.0	22.0	8.1	7.3	2.4		3.0	1.1		
11	365.0	28.0	9.2	7.3	2.2	1.0	3.0	1.0		
12	483.0	36.0	8.9	7.3	1.4	0.7	3.0	0.7		
13	420.0	32.0	9.1	7.4	2.2	0.7	3.0	0.9		
14	380.0	30.0	9.5	7.4	2.0	0.6	3.0	0.9		
15	315.0	23.0	8.8	7.3	2.3	0.9	3.0	1.1		
16	421.0	31.0	8.8	7.4	1.8		3.0	0.9		
17	298.0	22.0	8.9	7.5	1.5		3.0	1.2		
18	370.0	28.0	9.1	7.4	2.2	0.9	3.0	1.0		
19	365.0	27.0	8.9	7.4	2.1	1.0	3.0	1.0		
20	396.0	29.0	8.8	7.4	2.3	0.9	3.0	0.9		
21	285.0	23.0	9.7	7.3	3.1	1.1	3.0	1.3		
22	222.0	18.0	9.7	7.2	3.1	1.0	3.0	1.6		
23	433.0	33.0	9.1	7.4	0.9		3.0	0.8		
24	375.0	29.0	9.3	7.3	2.5		3.0	1.0		
25	322.0	26.0	9.7	7.3	1.8	0.7	3.0	1.1		
26	340.0	26.0	9.2	7.2	3.1	0.9	3.0	1.1		
27	462.0	36.0	9.4	7.2	3.1	1.1	3.0	0.8		
28	363.0	28.0	9.3	7.2	2.8	1.5	3.0	1.0		
29	391.0	24.0	7.4	7.3	2.5	1.0	3.0	0.9		
30	229.0	17.0	8.9	7.3	2.9		3.0	1.6		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

3 ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: October 1996

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Steven P. Kelly*, C.O., CERT. NO. C-6345

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
DAILY TOTAL	11039.0	832.0	281.1	227.8	64.7	15.9	93.0	34.4	2	
AVERAGE	356.1	26.8	9.1	7.3	2.1	0.7	3.0	1.1		
MAXIMUM	556.0	42.0	11.8	7.4	3.0	1.2	3.0	2.7		
MINIMUM	132.0	13.0	6.1	7.3	1.0	0.2	3.0	0.6		
01	132.0	13.0	11.8	7.4	1.6	0.5	3.0	2.7		
02	258.0	19.0	8.8	7.4	3.0	1.1	3.0	1.4		
03	281.0	21.0	9.0	7.3	3.0	1.2	3.0	1.3		
04	296.0	26.0	10.5	7.3	2.5	0.9	3.0	1.2		
05	275.0	14.0	6.1	7.4	1.8		3.0	1.3		
06	308.0	23.0	9.0	7.4	1.1		3.0	1.2		
07	239.0	17.0	8.5	7.4	1.6	0.9	3.0	1.5		
08	250.0	18.0	8.6	7.3	2.6	0.8	3.0	1.4		
09	310.0	26.0	10.1	7.3	1.0	0.4	3.0	1.2		
10	308.0	22.0	8.6	7.4	1.4	0.2	3.0	1.2		
11	267.0	19.0	8.5	7.3	2.3	0.5	3.0	1.3		
12	302.0	23.0	9.1	7.3	1.9		3.0	1.2		
13	321.0	26.0	9.7	7.3	1.1		3.0	1.1		
14	443.0	36.0	9.8	7.4	1.3	0.3	3.0	0.8	2	
15	383.0	29.0	9.1	7.4	1.3	0.5	3.0	0.9		
16	321.0	23.0	8.6	7.4	2.5	0.7	3.0	1.1		
17	211.0	16.0	9.1	7.3	2.9	0.6	3.0	1.7		
18	400.0	29.0	8.7	7.3	2.7	1.2	3.0	0.9		
19	322.0	24.0	8.9	7.4	2.5		3.0	1.1		
20	364.0	27.0	8.9	7.3	2.3		3.0	1.0		
21	402.0	30.0	9.0	7.3	2.9	0.8	3.0	0.9		
22	385.0	29.0	9.0	7.3	2.8	0.6	3.0	0.9		
23	467.0	35.0	9.0	7.4	2.5	0.6	3.0	0.8		
24	443.0	33.0	8.9	7.4	1.9	0.5	3.0	0.8		
25	393.0	29.0	8.9	7.3	2.9	0.5	3.0	0.9		
26	556.0	41.0	8.8	7.4	1.4		3.0	0.6		
27	543.0	42.0	9.3	7.4	1.0		3.0	0.7		
28	500.0	39.0	9.4	7.4	2.6	0.6	3.0	0.7		
29	503.0	38.0	9.1	7.3	2.5	0.7	3.0	0.7		
30	427.0	33.0	9.3	7.3	2.2	1.2	3.0	0.8		
31	429.0	32.0	9.0	7.3	1.6	0.6	3.0	0.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OWNED BY: United Water Florida Inc.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

DESIGN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Lawrence P. Utley

, C.O., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L	PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L			
MONTHLY TOTAL	13946.0	1024.0	274.3	221.2	60.9	15.8	90.0	27.0	2	
AVERAGE	464.9	34.1	9.1	7.4	2.0	0.8	3.0	0.9		
MINIMUM	747.0	55.0	17.8	7.5	3.0	1.3	3.0	3.3		
MAXIMUM	108.0	16.0	6.7	7.3	1.0	0.3	3.0	0.5		
01	301.0	24.0	9.6	7.5	1.9		3.0	1.2		
02	108.0	16.0	17.8	7.5	1.3		3.0	3.3		
03	280.0	22.0	9.4	7.4	2.9	1.0	3.0	1.3		
04	300.0	23.0	9.2	7.4	2.5	1.3	3.0	1.2		
05	350.0	26.0	8.9	7.4	2.5	1.1	3.0	1.0		
06	410.0	31.0	9.1	7.3	3.0	1.3	3.0	0.9		
07	680.0	38.0	6.7	7.3	2.6		3.0	0.5		
08	456.0	35.0	9.2	7.3	2.2		3.0	0.8		
09	430.0	30.0	8.4	7.3	2.3	0.7	3.0	0.8		
10	424.0	28.0	7.9	7.3	2.0	0.4	3.0	0.8		
11	348.0	23.0	7.9	7.3	1.7	0.6	3.0	1.0		
12	260.0	27.0	12.5	7.3	2.5	0.8	3.0	1.4	2	
13	508.0	35.0	8.3	7.4	2.0	0.7	3.0	0.7		
14	635.0	46.0	8.7	7.4	1.5		3.0	0.6		
15	527.0	40.0	9.1	7.4	2.0		3.0	0.7		
16	374.0	26.0	8.3	7.3	2.0	0.4	3.0	1.0		
17	402.0	31.0	9.3	7.4	2.7	0.3	3.0	0.9		
18	482.0	36.0	9.0	7.4	2.5	0.5	3.0	0.7		
19	450.0	34.0	9.1	7.3	2.0	0.6	3.0	0.8		
20	540.0	40.0	8.9	7.4	1.4	0.6	3.0	0.7		
21	481.0	38.0	9.5	7.3	1.7		3.0	0.7		
22	567.0	39.0	8.3	7.4	1.5		3.0	0.6		
23	600.0	43.0	8.6	7.4	2.0	0.7	3.0	0.6		
24	639.0	47.0	8.8	7.4	2.5	0.9	3.0	0.6		
25	683.0	51.0	9.0	7.4	1.9	0.9	3.0	0.5		
26	478.0	34.0	8.5	7.4	2.1	1.3	3.0	0.8		
27	645.0	47.0	8.7	7.3	1.9	1.0	3.0	0.6		
28	747.0	55.0	8.8	7.4	1.0		3.0	0.5		
29	373.0	28.0	9.0	7.5	1.1		3.0	1.0		
30	468.0	31.0	7.9	7.4	1.7	0.7	3.0	0.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P NAME OF DRINKING WATER SYSTEM: S JOHN'S NORTH WATER TREATMENT PLANT
 LOCATION: 2369 Hawkcrest Woods Dr. COUNTY: ST. JOHNS
 PROVIDED BY: United Water Florida Inc. REPORTING MONTH: August 1996
 INFLUENT EFFLUENT pH: 7.3 (AVG) NO. OF SERVICES AT END OF MONTH: 297
 INFLUENT FLOW: 0.180 (MGD) MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT Sam P. Usby, C.O., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
MONTHLY TOTAL	13708.0	1044.0	283.4	227.8	53.3	17.1	93.0	27.2	2	
AVERAGE	442.2	33.7	9.1	7.3	1.7	0.8	3.0	0.9		
MINIMUM	737.0	57.0	10.6	7.5	3.0	1.2	3.0	1.4		
MINIMUM	255.0	19.0	8.2	7.1	0.1	0.3	3.0	0.5		
01	638.0	48.0	9.0	7.3	1.3	0.4	3.0	0.6		
02	465.0	35.0	9.0	7.4	1.5	1.0	3.0	0.8		
03	344.0	25.0	8.7	7.5	1.0		3.0	1.0		
04	474.0	36.0	9.1	7.5	1.2		3.0	0.8		
05	512.0	39.0	9.1	7.4	1.5	0.6	3.0	0.7		
06	510.0	36.0	8.5	7.4	1.0	0.4	3.0	0.7		
07	495.0	38.0	9.2	7.4	1.3	0.3	3.0	0.7	2	
08	368.0	28.0	9.1	7.4	0.1	0.7	3.0	1.0		
09	469.0	36.0	9.2	7.3	2.0	0.6	3.0	0.8		
10	402.0	31.0	9.3	7.3	2.1		3.0	0.9		
11	376.0	28.0	8.9	7.3	1.8		3.0	1.0		
12	255.0	19.0	8.9	7.3	2.2	1.2	3.0	1.4		
13	389.0	29.0	8.9	7.3	1.4	0.9	3.0	0.9		
14	263.0	22.0	10.0	7.4	2.0	0.9	3.0	1.4		
15	387.0	29.0	9.0	7.4	1.4	0.7	3.0	0.9		
16	309.0	23.0	8.9	7.4	2.4	0.9	3.0	1.2		
17	571.0	45.0	9.5	7.3	2.9		3.0	0.6		
18	432.0	34.0	9.4	7.4	1.4		3.0	0.8		
19	499.0	34.0	8.2	7.4	2.8	0.9	3.0	0.7		
20	465.0	41.0	10.6	7.4	1.8	0.9	3.0	0.8		
21	667.0	50.0	9.0	7.3	1.3	0.8	3.0	0.5		
22	548.0	42.0	9.2	7.3	2.3	1.0	3.0	0.7		
23	737.0	57.0	9.3	7.3	2.4	0.8	3.0	0.5		
24	409.0	33.0	9.7	7.4	1.5		3.0	0.9		
25	628.0	47.0	9.0	7.3	1.9		3.0	0.6		
26	334.0	25.0	9.0	7.3	3.0	0.9	3.0	1.1		
27	467.0	36.0	9.3	7.3	2.4	0.9	3.0	0.8		
28	374.0	28.0	9.0	7.3	1.3	0.7	3.0	1.0		
29	348.0	27.0	9.3	7.2	1.7	0.8	3.0	1.0		
30	318.0	24.0	9.1	7.1	1.3	0.8	3.0	1.1		
31	255.0	19.0	8.9	7.5	1.1		3.0	1.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: July 1996

INFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

INFLUENT FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Louise P. White

, C.O., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALLONS	GALS. OR LBS. USED	mg/L	PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L			
7/1	14877.0	1217.0	310.0	227.5	53.8	13.7	93.0	26.6	2	
7/2	479.9	39.3	10.0	7.3	1.7	0.6	3.0	0.9		
7/3	830.0	81.0	29.1	7.5	2.8	1.0	3.0	1.8		
7/4	196.0	15.0	8.9	7.3	0.5	0.4	3.0	0.4		
7/5	352.0	27.0	9.2	7.3	1.6	0.6	3.0	1.0	2	
7/6	505.0	40.0	9.5	7.4	2.8	0.6	3.0	0.7		
7/7	464.0	36.0	9.3	7.4	2.0	0.5	3.0	0.8		
7/8	334.0	81.0	29.1	7.4	0.9		3.0	1.1		
7/9	371.0	29.0	9.4	7.3	2.8	0.6	3.0	1.0		
7/10	255.0	20.0	9.4	7.5	2.0		3.0	1.4		
7/11	234.0	19.0	9.7	7.4	1.7		3.0	1.5		
7/12	323.0	24.0	8.9	7.3	2.3	1.0	3.0	1.1		
7/13	196.0	15.0	9.2	7.4	2.1	0.7	3.0	1.8		
7/14	314.0	24.0	9.2	7.4	2.4	0.9	3.0	1.1		
7/15	319.0	24.0	9.0	7.3	1.9	0.8	3.0	1.1		
7/16	382.0	30.0	9.4	7.3	2.1	0.7	3.0	0.9		
7/17	465.0	35.0	9.0	7.3	2.0		3.0	0.8		
7/18	279.0	22.0	9.5	7.3	2.3		3.0	1.3		
7/19	474.0	37.0	9.4	7.3	2.0	0.6	3.0	0.8		
7/20	363.0	28.0	9.3	7.3	1.8	0.5	3.0	1.0		
7/21	388.0	30.0	9.3	7.4	1.5	0.5	3.0	0.9		
7/22	548.0	43.0	9.4	7.3	1.4	0.5	3.0	0.7		
7/23	488.0	42.0	10.3	7.3	1.8	0.7	3.0	0.7		
7/24	527.0	42.0	9.6	7.3	1.5		3.0	0.7		
7/25	662.0	52.0	9.4	7.3	1.7		3.0	0.5		
7/26	567.0	44.0	9.3	7.3	1.3	0.6	3.0	0.6		
7/27	653.0	51.0	9.4	7.4	1.1	0.6	3.0	0.6		
7/28	565.0	44.0	9.3	7.4	1.5	0.5	3.0	0.6		
7/29	564.0	45.0	9.6	7.3	1.5	0.7	3.0	0.6		
7/30	788.0	62.0	9.4	7.3	2.5	0.7	3.0	0.5		
7/31	830.0	66.0	9.5	7.3	0.7		3.0	0.4		
7/1	622.0	48.0	9.3	7.4	0.5		3.0	0.6		
7/2	715.0	54.0	9.1	7.3	1.1	0.4	3.0	0.5		
7/3	795.0	62.0	9.4	7.3	1.0	0.5	3.0	0.5		
7/4	535.0	41.0	9.2	7.3	2.0	0.5	3.0	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

IGN: 2369 Hawkecrest Woods Dr.

COUNTY: ST. JOHNS

BY: United Water Florida Inc.

REPORTING MONTH: June 1996

EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

IN FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2855

IIFY THIS REPORT IS CORRECT Laura P. Wilky, C.O., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL NCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
6/1	12274.0	802.0	247.6	219.9	60.5	16.7	90.0	30.5	2	
6/2	409.1	26.7	8.3	7.3	2.0	0.8	3.0	1.0		
6/3	685.0	50.0	15.6	7.5	3.1	1.4	3.0	2.7		
6/4	131.0	15.0	4.1	7.2	0.7	0.5	3.0	0.5		
6/5	505.0	38.0	9.0	7.3	1.5		3.0	0.7		
6/6	555.0	40.0	8.6	7.2	0.9		3.0	0.6		
6/7	459.0	34.0	8.7	7.3	1.0	0.7	3.0	0.8		
6/8	591.0	42.0	8.5	7.3	1.0	0.6	3.0	0.6		
6/9	685.0	50.0	8.8	7.3	2.8	1.0	3.0	0.5		
6/10	628.0	45.0	8.6	7.4	1.5	0.9	3.0	0.6	2	
6/11	571.0	29.0	6.1	7.3	2.8	0.7	3.0	0.6		
6/12	131.0	17.0	15.6	7.4	1.0		3.0	2.7		
6/13	374.0	27.0	8.7	7.4	1.2		3.0	1.0		
6/14	304.0	22.0	8.7	7.3	1.7	0.7	3.0	1.2		
6/15	299.0	21.0	8.4	7.4	2.1	0.8	3.0	1.2		
6/16	420.0	30.0	8.6	7.4	2.5	0.9	3.0	0.9		
6/17	379.0	28.0	8.9	7.4	1.3	0.6	3.0	0.9		
6/18	258.0	17.0	7.9	7.3	3.0	1.0	3.0	1.4		
6/19	353.0	25.0	8.5	7.3	2.4		3.0	1.0		
6/20	204.0	18.0	10.6	7.2	2.2		3.0	1.8		
6/21	498.0	20.0	4.8	7.2	2.1	0.8	3.0	0.7		
6/22	498.0	28.0	6.7	7.3	2.5	1.0	3.0	0.7		
6/23	498.0	22.0	5.3	7.3	2.8	0.9	3.0	0.7		
6/24	498.0	17.0	4.1	7.4	2.6	0.8	3.0	0.7		
6/25	498.0	20.0	4.8	7.3	3.1	0.9	3.0	0.7		
6/26	498.0	27.0	6.5	7.3	1.1		3.0	0.7		
6/27	498.0	25.0	6.0	7.4	2.3		3.0	0.7		
6/28	310.0	24.0	9.3	7.4	2.5	1.0	3.0	1.2		
6/29	333.0	26.0	9.4	7.4	3.0	0.9	3.0	1.1		
6/30	330.0	26.0	9.5	7.4	2.1	0.5	3.0	1.1		
6/1	254.0	19.0	9.0	7.3	2.5	0.6	3.0	1.4		
6/2	193.0	15.0	9.3	7.3	2.3	1.4	3.0	1.9		
6/3	333.0	26.0	9.4	7.2	2.0		3.0	1.1		
6/4	305.0	24.0	9.3	7.5	0.7		3.0	1.2		

FLOW METER OUT OF SERVICE 6-17 TO 6-23 USED LAST MONTHS AVERAGE.

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: S.T. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: May 1996

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

INFLUENT FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Lance P. Kelly

, C.O., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/L	PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mq/L				
01	19295.0	1458.0	280.2	227.2	59.3	13.7	93.0	19.1	2	
02	622.4	47.0	9.0	7.3	1.9	0.6	3.0	0.6		
03	914.0	73.0	11.1	7.5	3.0	0.9	3.0	1.1		
04	331.0	24.0	5.7	7.2	0.9	0.4	3.0	0.4		
05	466.0	35.0	9.0	7.3	3.0	0.7	3.0	0.8	2	
06	472.0	33.0	8.4	7.3	1.8	0.6	3.0	0.8		
07	587.0	28.0	5.7	7.3	2.0	0.8	3.0	0.6		
08	523.0	37.0	8.5	7.2	0.9		3.0	0.7		
09	702.0	57.0	9.7	7.3	1.4		3.0	0.5		
10	638.0	51.0	9.6	7.3	1.7	0.5	3.0	0.6		
11	591.0	47.0	9.5	7.3	2.4	0.8	3.0	0.6		
12	568.0	46.0	9.7	7.4	2.8	0.6	3.0	0.6		
13	679.0	46.0	8.1	7.4	2.7	0.6	3.0	0.5		
14	560.0	52.0	11.1	7.3	1.6	0.4	3.0	0.6		
15	714.0	54.0	9.1	7.5	0.9		3.0	0.5		
16	625.0	52.0	10.0	7.5	1.0		3.0	0.6		
17	680.0	55.0	9.7	7.4	1.5	0.7	3.0	0.5		
18	579.0	45.0	9.3	7.4	1.6	0.5	3.0	0.6		
19	613.0	47.0	9.2	7.3	2.8	0.7	3.0	0.6		
20	723.0	62.0	10.3	7.3	1.5	0.5	3.0	0.5		
21	914.0	66.0	8.7	7.3	2.3	0.7	3.0	0.4		
22	629.0	45.0	8.6	7.3	1.3		3.0	0.6		
23	897.0	73.0	9.8	7.3	1.2		3.0	0.4		
24	724.0	59.0	9.8	7.3	1.5	0.6	3.0	0.5		
25	466.0	35.0	9.0	7.4	2.5	0.5	3.0	0.8		
26	663.0	50.0	9.0	7.4	2.3	0.5	3.0	0.5		
27	722.0	51.0	8.5	7.3	2.3	0.6	3.0	0.5		
28	852.0	63.0	8.9	7.3	2.7	0.5	3.0	0.4		
29	857.0	62.0	8.7	7.3	1.5		3.0	0.4		
30	637.0	46.0	8.7	7.3	1.8		3.0	0.6		
31	649.0	48.0	8.9	7.3	1.8		3.0	0.6		
32	358.0	26.0	8.7	7.3	1.1	0.6	3.0	1.0		
33	331.0	24.0	8.7	7.3	2.6	0.6	3.0	1.1		
34	359.0	26.0	8.7	7.3	2.0	0.8	3.0	1.0		
35	517.0	37.0	8.6	7.3	2.8	0.9	3.0	0.7		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P NAME OF DRINKING WATER SYSTEM: JOHNS NORTH WATER TREATMENT PLANT
 LOCATION: 2369 Hawkcrest Woods Dr. COUNTY: ST. JOHNS
 OPERATED BY: United Water Florida Inc. REPORTING MONTH: April 1996
 INFLUENT EFFLUENT pH: 7.3 (AVG) NO. OF SERVICES AT END OF MONTH: 297
 INFLUENT FLOW: 0.180 (MGD) MAIN OFFICE PHONE NO. (904) 725-2865
 I CERTIFY THIS REPORT IS CORRECT James P. White, C.O., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
MONTHLY TOTAL	14951.0	1038.0	250.0	220.0	47.6	10.2	90.0	23.5	2	
AVERAGE	498.4	34.6	8.3	7.3	1.6	0.5	3.0	0.8		
MINIMUM	774.0	59.0	13.5	7.4	3.0	0.8	3.0	1.6		
MINIMUM	222.0	16.0	4.7	7.2	0.5	0.3	3.0	0.5		
01	297.0	17.0	6.9	7.3	1.6	0.7	3.0	1.2		
02	222.0	25.0	13.5	7.3	2.3	0.3	3.0	1.6		
03	436.0	26.0	7.2	7.3	3.0	0.4	3.0	0.8	2	
04	473.0	24.0	6.1	7.3	1.4	0.3	3.0	0.8		
05	420.0	21.0	6.0	7.2	1.8		3.0	0.9		
06	362.0	22.0	7.3	7.3	1.5		3.0	1.0		
07	449.0	28.0	7.5	7.3	0.9		3.0	0.8		
08	413.0	25.0	7.3	7.3	1.3	0.6	3.0	0.9		
09	487.0	32.0	7.9	7.3	0.9	0.5	3.0	0.7		
10	481.0	30.0	7.5	7.3	1.1	0.3	3.0	0.7		
11	466.0	33.0	8.5	7.4	0.9	0.5	3.0	0.8		
12	581.0	33.0	6.8	7.4	2.0	0.6	3.0	0.6		
13	624.0	36.0	6.9	7.4	0.5		3.0	0.6		
14	609.0	24.0	4.7	7.4	0.5		3.0	0.6		
15	254.0	16.0	7.6	7.3	1.0	0.3	3.0	1.4		
16	379.0	29.0	9.2	7.3	1.0	0.3	3.0	0.9		
17	476.0	32.0	8.1	7.4	1.5	0.4	3.0	0.8		
18	490.0	43.0	10.5	7.4	1.3	0.3	3.0	0.7		
19	662.0	54.0	9.8	7.3	1.4	0.4	3.0	0.5		
20	411.0	30.0	8.8	7.4	1.7		3.0	0.9		
21	774.0	59.0	9.1	7.3	1.8		3.0	0.5		
22	484.0	37.0	9.2	7.3	2.4	0.8	3.0	0.7		
23	537.0	42.0	9.4	7.3	1.5	0.5	3.0	0.7		
24	530.0	39.0	8.8	7.4	2.9	0.6	3.0	0.7		
25	536.0	44.0	9.9	7.4	2.3	0.5	3.0	0.7		
26	757.0	58.0	9.2	7.3	2.1	0.7	3.0	0.5		
27	694.0	57.0	9.9	7.3	2.0		3.0	0.5		
28	618.0	48.0	9.3	7.3	1.5		3.0	0.6		
29	593.0	42.0	8.5	7.4	1.1	0.5	3.0	0.6		
30	436.0	32.0	8.8	7.4	2.4	0.7	3.0	0.8		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: S. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: March 1996

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

INFLUENT FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

Samuel P. Wilby

, C.O., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
	GALS. OR LBS. USED	mg/L	PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L				
DAILY TOTAL	11136.0	628.0	207.4	226.7	50.6	12.0	90.0	33.2	2	
AVERAGE	359.2	20.3	6.7	7.3	1.6	0.5	3.0	1.1		
MINIMUM	806.0	47.0	7.8	7.5	3.0	1.0	3.0	2.1		
MAXIMUM	172.0	10.0	4.2	7.1	0.5	0.3	3.0	0.4		
01	271.0	15.0	6.6	7.3	1.5	0.3	3.0	1.3		
02	172.0	10.0	7.0	7.3	1.1		3.0	2.1		
03	441.0	25.0	6.8	7.3	2.3		3.0	0.8		
04	365.0	20.0	6.6	7.4	2.2	0.4	3.0	1.0	2	
05	374.0	22.0	7.1	7.3	1.1	0.5	3.0	1.0		
06	350.0	19.0	6.5	7.3	1.0	0.4	3.0	1.0		
07	240.0	13.0	6.5	7.3	1.4	0.5	3.0	1.5		
08	279.0	10.0	4.3	7.3	1.8	0.6	3.0	1.3		
09	343.0	12.0	4.2	7.1	1.9	0.6	3.0	1.0		
10	204.0	12.0	7.1	7.2	1.5		3.0	1.8		
11	239.0	14.0	7.0	7.2	1.9	0.8	3.0	1.5		
12	329.0	19.0	6.9	7.3	1.7	1.0	3.0	1.1		
13	393.0	22.0	6.7	7.3	1.4	0.7	3.0	0.9		
14	438.0	25.0	6.8	7.3	1.8	0.9	3.0	0.8		
15	602.0	37.0	7.4	7.3	1.5	1.0	3.0	0.6		
16	557.0	36.0	7.8	7.5	0.5		3.0	0.6		
17	453.0	28.0	7.4	7.5	1.2		3.0	0.8		
18	280.0	15.0	6.4	7.3	1.8	0.7	3.0	1.3		
19	336.0	20.0	7.1	7.3	1.0	0.3	3.0	1.1		
20	241.0	14.0	7.0	7.3	1.8	0.5	3.0	1.5		
21	467.0	27.0	6.9	7.3	1.1	0.3	3.0	0.8		
22	368.0	22.0	7.2	7.3	1.4	0.5	3.0	1.0		
23	806.0	47.0	7.0	7.3	1.8		3.0	0.4		
24	383.0	21.0	6.6	7.4	1.0		3.0	0.9		
25	352.0	20.0	6.8	7.4	2.8	0.3	3.0	1.0		
26	463.0	28.0	7.3	7.4	3.0	0.4	3.0	0.8		
27	250.0	14.0	6.7	7.3	2.3	0.3	3.0	1.4		
28	239.0	13.0	6.5	7.3	2.5	0.5	3.0	1.5		
29	373.0	20.0	6.4	7.3	1.9	0.5	3.0	1.0		
30	277.0	14.0	6.1	7.3	1.1		3.0	1.3		
31	251.0	14.0	6.7	7.3	1.3					

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 2369 Hawkcrest Woods Dr.

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: February 1996

AVERAGE EFFLUENT pH: 7.4 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

AVERAGE FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Lawrence P. W. Edley, C.O., CERT. NO. C-6345

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
DAILY	10881.0	665.0	213.3	213.4	60.2	15.6	87.0	29.9	2	
AVERAGE	375.2	22.9	7.4	7.4	2.1	0.8	3.0	1.0		
MAXIMUM	721.0	44.0	8.4	7.5	3.0	1.1	3.0	1.6		
MINIMUM	221.0	13.0	5.7	7.3	1.0	0.3	3.0	0.5		
01	315.0	20.0	7.6	7.3	2.8	0.9	3.0	1.1		
02	289.0	19.0	7.9	7.3	3.0	1.1	3.0	1.2		
03	221.0	15.0	8.1	7.3	2.8		3.0	1.6		
04	264.0	17.0	7.7	7.3	3.0		3.0	1.4		
05	333.0	22.0	7.9	7.4	2.8	0.6	3.0	1.1		
06	282.0	18.0	7.7	7.4	1.1	0.6	3.0	1.3		
07	227.0	15.0	7.9	7.4	1.8	0.7	3.0	1.6		
08	435.0	29.0	8.0	7.3	1.4	0.5	3.0	0.8		
09	434.0	29.0	8.0	7.3	1.3	0.6	3.0	0.8		
10	378.0	24.0	7.6	7.3	1.4		3.0	1.0		
11	416.0	29.0	8.4	7.4	2.7		3.0	0.9		
12	312.0	21.0	8.1	7.4	1.7	0.8	3.0	1.2		
13	342.0	23.0	8.1	7.4	2.6	1.0	3.0	1.1		
14	343.0	20.0	7.0	7.3	3.0	1.1	3.0	1.0		
15	374.0	21.0	6.7	7.3	1.1	0.9	3.0	1.0		
16	357.0	19.0	6.4	7.3	1.5	1.0	3.0	1.0		
17	423.0	22.0	6.2	7.4	2.0		3.0	0.9		
18	430.0	24.0	6.7	7.3	1.3		3.0	0.8		
19	251.0	15.0	7.2	7.4	1.8		3.0	1.4		
20	311.0	19.0	7.3	7.4	2.7	0.9	3.0	1.2		
21	498.0	27.0	6.5	7.4	2.3	0.7	3.0	0.7	2	
22	511.0	35.0	8.2	7.4	3.0	1.0	3.0	0.7		
23	466.0	26.0	6.7	7.3	2.5	0.8	3.0	0.8		
24	371.0	23.0	7.4	7.5	1.5		3.0	1.0		
25	721.0	44.0	7.3	7.4	1.0		3.0	0.5		
26	445.0	28.0	7.6	7.4	1.1	0.3	3.0	0.8		
27	522.0	31.0	7.1	7.4	3.0	1.0	3.0	0.7		
28	356.0	17.0	5.7	7.4	3.0	0.8	3.0	1.0		
29	254.0	13.0	6.1	7.3	1.0	0.3	3.0	1.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2554345 C.U.P. NO. 3-109-0243P

NAME OF DRINKING WATER SYSTEM: ST. JOHNS NORTH WATER TREATMENT PLANT

LOCATION: 1363 BIGLIGE AVENUE

COUNTY: ST. JOHNS

OPERATED BY: United Water Florida Inc.

REPORTING MONTH: January 1996

AVERAGE EFFLUENT pH: 7.3 (AVG)

NO. OF SERVICES AT END OF MONTH: 297

AVERAGE FLOW: 0.180 (MGD)

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

James P. Willey

, C.D., CERT. NO. C-6345

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/L		ZINC POLYPHOSPHATE		NUMBER OF SAMPLES TAKEN	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/L		PLANT EFFLUENT	REMOTE TAP	GALS. OR LBS USED	Mg/L		
MONTHLY TOTAL	8562.0	566.0	246.2	227.6	59.1	16.1	93.0	43.1	2	
AVERAGE	276.2	18.3	7.9	7.3	1.9	0.7	3.0	1.4		
MINIMUM	465.0	34.0	12.2	7.4	3.0	1.0	3.0	2.3		
MINIMUM	158.0	9.0	5.6	7.3	1.0	0.6	3.0	0.8		
01	163.0	9.0	6.6	7.4	2.2		3.0	2.2		
02	200.0	13.0	7.8	7.3	3.0	0.8	3.0	1.8		
03	185.0	11.0	7.1	7.3	3.0	0.6	3.0	1.9		
04	316.0	23.0	8.7	7.3	2.3	0.7	3.0	1.1		
05	204.0	13.0	7.6	7.3	1.1	0.7	3.0	1.8		
06	306.0	20.0	7.8	7.3	3.0		3.0	1.2		
07	232.0	15.0	7.8	7.4	2.0		3.0	1.6		
08	288.0	19.0	7.9	7.4	2.5	0.9	3.0	1.3	2	
09	306.0	20.0	7.8	7.4	1.8	0.8	3.0	1.2		
10	326.0	21.0	7.7	7.3	2.8	0.8	3.0	1.1		
11	226.0	15.0	8.0	7.3	2.1	0.7	3.0	1.6		
12	310.0	21.0	8.1	7.3	1.0	0.8	3.0	1.2		
13	310.0	21.0	8.1	7.4	1.8		3.0	1.2		
14	279.0	18.0	7.7	7.4	1.6		3.0	1.3		
15	312.0	20.0	7.7	7.4	1.4	0.6	3.0	1.2		
16	397.0	27.0	8.2	7.3	1.6	0.8	3.0	0.9		
17	286.0	19.0	8.0	7.3	1.8	0.6	3.0	1.3		
18	246.0	16.0	7.8	7.3	1.8	0.8	3.0	1.5		
19	278.0	20.0	8.6	7.4	1.3	0.7	3.0	1.3		
20	243.0	17.0	8.4	7.4	1.1		3.0	1.5		
21	342.0	16.0	5.6	7.4	1.0		3.0	1.1		
22	167.0	17.0	12.2	7.3	1.0	0.6	3.0	2.2		
23	323.0	21.0	7.8	7.3	1.2	0.6	3.0	1.1		
24	212.0	13.0	7.4	7.3	2.3	1.0	3.0	1.7		
25	289.0	19.0	7.9	7.3	2.0	0.7	3.0	1.2		
26	259.0	17.0	7.9	7.3	2.4	0.8	3.0	1.4		
27	288.0	18.0	7.5	7.3	1.8		3.0	1.3		
28	465.0	34.0	8.8	7.3	2.0		3.0	0.8		
29	284.0	18.0	7.6	7.4	2.2	0.7	3.0	1.3		
30	362.0	25.0	8.3	7.4	1.9	0.7	3.0	1.0		
31	158.0	10.0	7.6	7.4	2.1	0.7	3.0	2.3		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

AVERAGE EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

James E. Ladd

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1669.0	41.0	97.0	148.4	43.6	12.1	
AVERAGE	53.8	1.3	3.1	7.4	1.4	0.6	
MAXIMUM	76.0	2.0	10.0	7.5	2.0	0.8	
MINIMUM	12.0	1.0	1.8	7.4	0.2	0.0	
01	57.0	1.0	2.1		1.8		
02	56.0	1.0	2.1	7.5	1.8	0.6	
03	44.0	1.0	2.7	7.4	0.4	0.7	
04	48.0	1.0	2.5	7.4	0.2	0.3	
05	54.0	1.0	2.2	7.4	1.4	0.4	
06	48.0	1.0	2.5	7.4	1.8	0.7	
07	52.0	2.0	4.6		1.6		
08	51.0	1.0	2.4		1.6		
09	12.0	1.0	10.0	7.5	0.4	0.5	
10	58.0	2.0	4.1	7.5	0.8	0.5	
11	44.0	1.0	2.7	7.5	1.4	0.7	
12	64.0	1.0	1.9	7.4	2.0	0.7	
13	54.0	1.0	2.2	7.4	1.4	0.5	
14	52.0	1.0	2.3		1.4		
15	45.0	2.0	5.3		1.6		
16	58.0	1.0	2.1	7.4	1.6	0.7	
17	61.0	2.0	3.9	7.4	1.4	0.6	
18	50.0	1.0	2.4	7.4	1.4	0.0	
19	71.0	2.0	3.4	7.4	1.2	0.6	
20	65.0	1.0	1.8	7.4	1.5	0.8	
21	57.0	1.0	2.1		1.6		
22	64.0	1.0	1.9		1.4		
23	44.0	1.0	2.7	7.4	1.5	0.6	
24	62.0	2.0	3.9		1.4		
25	49.0	2.0	4.9		1.4		
26	65.0	2.0	3.7	7.4	1.6	0.8	
27	54.0	1.0	2.2	7.4	1.7	0.8	
28	64.0	2.0	3.8		1.6		
29	47.0	1.0	2.6		1.6		
30	76.0	2.0	3.2	7.4	1.6	0.8	
31	43.0	1.0	2.8	7.4	1.5	0.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996


PLANT EFFLUENT pH: 7.4(AVG)

NO. OF SERVICES AT END OF MONTH: _____

ENSIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

MAY MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1570.0	37.0	86.5	155.8	69.6	14.5	
AVERAGE	52.3	1.2	2.9	7.4	2.3	0.7	
MAXIMUM	74.0	2.0	5.0	7.5	21.2	1.2	
MINIMUM	37.0	1.0	1.6	7.4	1.1	0.2	
01	51.0	1.0	2.4	7.5	1.4	0.6	
02	47.0	1.0	2.6		1.4		
03	74.0	1.0	1.6		1.2		
04	54.0	1.0	2.2	7.4	1.1	0.5	
05	39.0	1.0	3.1	7.4	1.1	0.5	
06	56.0	1.0	2.1	7.4	1.2	0.4	
07	53.0	1.0	2.3	7.4	1.2	0.5	
08	41.0	1.0	2.9	7.4	1.4	0.5	
09	59.0	1.0	2.0		1.4		
10	49.0	1.0	2.4		1.5		
11	61.0	1.0	2.0	7.4	1.4	0.6	
12	51.0	1.0	2.4	7.4	1.2	0.5	
13	60.0	1.0	2.0	7.5	1.1	0.2	
14	51.0	1.0	2.4	7.4	1.5	0.2	
15	37.0	1.0	3.2	7.4	1.9	0.5	
16	63.0	1.0	1.9		1.6		
17	48.0	1.0	2.5		1.8		
18	55.0	2.0	4.4	7.4	2.4	0.8	
19	49.0	2.0	4.9	7.5	2.2	0.6	
20	48.0	1.0	2.5	7.5	2.0	0.8	
21	48.0	2.0	5.0	7.4	2.2	0.9	
22	43.0	1.0	2.8	7.4	2.0	1.1	
23	53.0	1.0	2.3		2.2		
24	61.0	1.0	2.0		2.2		
25	62.0	2.0	3.9	7.4	2.0	1.0	
26	48.0	2.0	5.0	7.4	2.0	1.2	
27	44.0	1.0	2.7	7.4	21.2	1.0	
28	61.0	1.0	2.0	7.4	2.0	1.0	
29	53.0	2.0	4.5	7.4	1.8	1.1	
30	51.0	2.0	6.7		2.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WTS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996


PLANT EFFLUENT pH: 7.5(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

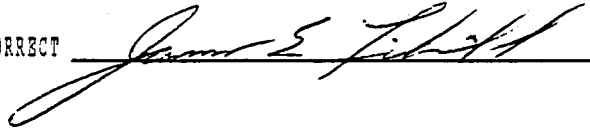

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1735.0	35.0	76.7	172.0	43.1	13.9	
AVERAGE	56.0	1.1	2.5	7.5	1.4	0.6	
MAXIMUM	76.0	2.0	4.9	7.5	1.6	0.8	
MINIMUM	33.0	1.0	1.6	7.4	1.2	0.4	
01	61.0	2.0	3.9	7.5	1.2	0.6	
02	50.0	1.0	2.4	7.5	1.4	0.5	
03	54.0	1.0	2.2	7.5	1.5	0.8	
04	33.0	1.0	3.6	7.5	1.4	0.5	
05	61.0	1.0	2.0		1.4		
06	71.0	1.0	1.7		1.2		
07	56.0	1.0	2.1	7.5	1.5	0.7	
08	49.0	1.0	2.4	7.5	1.4	0.6	
09	55.0	1.0	2.2	7.5	1.4	0.6	
10	53.0	2.0	4.5	7.5	1.5	0.7	
11	52.0	1.0	2.3	7.5	1.5	0.5	
12	59.0	1.0	2.0		1.4		
13	61.0	2.0	3.9		1.4		
14	63.0	1.0	1.9	7.5	1.4	0.7	
15	60.0	1.0	2.0	7.5	1.6	0.7	
16	47.0	1.0	2.6	7.5	1.4	0.4	
17	62.0	1.0	1.9	7.5	1.2	0.6	
18	55.0	1.0	2.2	7.5	1.6	0.6	
19	60.0	1.0	2.0		1.5		
20	63.0	1.0	1.9		1.6		
21	49.0	1.0	2.4	7.5	1.4	0.7	
22	61.0	1.0	2.0	7.5	1.3	0.6	
23	52.0	1.0	2.3	7.5	1.4	0.7	
24	53.0	1.0	2.3	7.5	1.3	0.5	
25	55.0	1.0	2.2	7.4	1.2	0.6	
26	64.0	1.0	1.9		1.2		
27	76.0	1.0	1.6		1.6		
28	48.0	1.0	2.5	7.4	1.4	0.5	
29	60.0	1.0	2.0	7.4	1.2	0.6	
30	43.0	1.0	2.8	7.4	1.2	0.7	
31	49.0	2.0	4.9	7.4	1.4	0.5	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: TIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

PLANT EFFLUENT pH: 7.5(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

MYS E MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1595.0	34.0	77.3	150.0	41.3	12.6	
AVERAGE	53.2	1.1	2.6	7.5	1.4	0.6	
MAXIMUM	72.0	3.0	6.1	7.5	1.6	0.8	
MINIMUM	33.0	1.0	1.8	7.5	1.2	0.5	
01	46.0	1.0	2.6		1.5		
02	60.0	1.0	2.0		1.4		
03	58.0	1.0	2.1	7.5	1.4	0.6	
04	47.0	1.0	2.6	7.5	1.2	0.7	
05	45.0	1.0	2.7	7.5	1.4	0.7	
06	51.0	1.0	2.4	7.5	1.4	0.5	
07	34.0	1.0	3.5		1.5		
08	52.0	1.0	2.3		1.4		
09	56.0	1.0	2.1	7.5	1.4	0.5	
10	59.0	1.0	2.0	7.5	1.2	0.6	
11	49.0	1.0	2.4	7.5	1.4	0.6	
12	50.0	1.0	2.4	7.5	1.4	0.5	
13	44.0	1.0	2.7	7.5	1.4	0.5	
14	61.0	1.0	2.0		1.2		
15	65.0	1.0	1.8		1.4		
16	47.0	1.0	2.6	7.5	1.4	0.6	
17	58.0	1.0	2.1	7.5	1.2	0.5	
18	51.0	1.0	2.4	7.5	1.2	0.5	
19	59.0	3.0	6.1	7.5	1.2	0.7	
20	33.0	1.0	3.6	7.5	1.4	0.7	
21	64.0	2.0	3.8		1.5		
22	72.0	2.0	3.3		1.6		
23	49.0	1.0	2.4	7.5	1.5	0.8	
24	54.0	1.0	2.2	7.5	1.4	0.7	
25	56.0	1.0	2.1	7.5	1.4	0.8	
26	59.0	1.0	2.0	7.5	1.2	0.6	
27	61.0	1.0	2.0	7.5	1.6	0.8	
28	53.0	1.0	2.3		1.5		
29	54.0	1.0	2.2		1.4		
30	48.0	1.0	2.5	7.5	1.2	0.7	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 09-11-96

ERIC NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: STIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996


AVERAGE EFFLUENT pH: 7.5(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1682.0	32.0	71.5	149.0	40.1	11.7	
BRIDGE	54.3	1.0	2.3	7.5	1.3	0.6	
MINUM	74.0	2.0	3.2	7.5	2.2	0.8	
MINUM	41.0	1.0	1.8	7.4	1.0	0.4	
01	50.0	1.0	2.4	7.4	1.2	0.7	
02	49.0	1.0	2.4	7.5	2.2	0.6	
03	53.0	1.0	2.3		1.2		
04	74.0	2.0	3.2		1.4		
05	49.0	1.0	2.4	7.5	1.2	0.7	
06	55.0	1.0	2.2	7.5	1.2	0.5	
07	62.0	1.0	1.9	7.5	1.4	0.7	
08	51.0	1.0	2.4	7.5	1.2	0.4	
09	63.0	1.0	1.9	7.5	1.2	0.6	
10	54.0	1.0	2.2		1.3		
11	56.0	1.0	2.1		1.4		
12	41.0	1.0	2.9		1.2		
13	58.0	1.0	2.1	7.5	1.2	0.6	
14	55.0	1.0	2.2	7.5	1.4	0.8	
15	51.0	1.0	2.4	7.5	1.6	0.4	
16	42.0	1.0	2.9	7.4	1.2	0.5	
17	60.0	1.0	2.0		1.4		
18	62.0	1.0	1.9		1.2		
19	57.0	1.0	2.1		1.2		
20	55.0	1.0	2.2	7.4	1.2	0.5	
21	53.0	1.0	2.3	7.4	1.2	0.6	
22	68.0	1.0	1.8	7.5	1.2	0.5	
23	48.0	1.0	2.5	7.4	1.0	0.5	
24	56.0	1.0	2.1		1.2		
25	67.0	1.0	1.8		1.2		
26	52.0	1.0	2.3	7.4	1.4	0.7	
27	47.0	1.0	2.6	7.4	1.2	0.5	
28	53.0	1.0	2.3	7.4	1.2	0.6	
29	51.0	1.0	2.4	7.4	1.2	0.7	
30	41.0	1.0	2.9	7.4	1.5	0.6	
31	49.0	1.0	2.4		1.3		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2

SAMPLE DATE: 08-15-96

S ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: METIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996


AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1738.0	36.0	82.3	168.5	35.1	12.5	
AVERAGE	56.1	1.2	2.7	7.3	1.1	0.5	
MAXIMUM	88.0	3.0	7.5	7.4	1.4	0.8	
MINIMUM	16.0	1.0	1.4	7.3	1.0	0.4	
01	65.0	1.0	1.8	7.4	1.2	0.5	
02	56.0	1.0	2.1	7.4	1.2	0.6	
03	58.0	1.0	2.1	7.4	1.0	0.4	
04	69.0	3.0	5.2		1.1		
05	41.0	2.0	5.9	7.3	1.2	0.5	
06	61.0	1.0	2.0		1.4		
07	60.0	1.0	2.0		1.1		
08	50.0	1.0	2.4	7.4	1.2	0.4	
09	36.0	1.0	3.3	7.4	1.0	0.5	
10	16.0	1.0	7.5	7.4	1.1	0.4	
11	85.0	2.0	2.8	7.3	1.0	0.6	
12	42.0	1.0	2.9	7.3	1.2	0.7	
13	50.0	1.0	2.4		1.2		
14	70.0	2.0	3.4		1.0		
15	55.0	1.0	2.2	7.3	1.1	0.6	
16	53.0	1.0	2.3	7.3	1.0	0.5	
17	42.0	1.0	2.9	7.3	1.2	0.6	
18	59.0	1.0	2.0	7.3	1.2	0.8	
19	63.0	1.0	1.9	7.3	1.2	0.5	
20	47.0	1.0	2.6	7.3	1.4	0.7	
21	62.0	1.0	1.9		1.2		
22	72.0	1.0	1.7	7.3	1.1	0.6	
23	58.0	1.0	2.1	7.3	1.0	0.5	
24	50.0	1.0	2.4	7.3	1.2	0.5	
25	50.0	1.0	2.4	7.3	1.1	0.5	
26	48.0	1.0	2.5	7.3	1.0	0.5	
27	66.0	1.0	1.8		1.0		
28	88.0	1.0	1.4		1.0		
29	57.0	1.0	2.1	7.3	1.2	0.6	
30	51.0	1.0	2.4	7.3	1.1	0.4	
31	58.0	1.0	2.1	7.3	1.2	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 07-22-96

COMMENTS: Flow totalizer out of service on the 7th & 8th flow taken from noon run time

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PLANT ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: JETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT

, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1731.0	37.0	78.9	161.3	37.8	13.3	
AVERAGE	57.7	1.2	2.6	7.3	1.3	0.6	
MAXIMUM	81.0	3.0	6.0	7.4	1.6	0.8	
MINIMUM	29.0	1.0	1.6	7.2	1.0	0.4	
01	62.0	2.0	3.9	7.3	1.3	0.6	
02	81.0	2.0	3.0	7.3	1.4	0.6	
03	59.0	1.0	2.0	7.3	1.2	0.7	
04	75.0	1.0	1.6	7.2	1.2	0.5	
05	70.0	3.0	5.1	7.2	1.4	0.7	
06	63.0	2.0	3.8	7.2	1.2	0.4	
07	49.0	1.0	2.4	7.3	1.2	0.5	
08	64.0	1.0	1.9		1.2		
09	63.0	1.0	1.9		1.2		
10	29.0	1.0	4.1	7.3	1.1	0.5	
11	64.0	1.0	1.9	7.3	1.1	0.4	
12	63.0	1.0	1.9	7.4	1.6	0.7	
13	48.0	1.0	2.5	7.4	1.4	0.6	
14	60.0	1.0	2.0	7.3	1.4	0.8	
15	49.0	1.0	2.4		1.2		
16	76.0	1.0	1.6		1.2		
17	55.0	1.0	2.2	7.4	1.1	0.4	
18	57.0	1.0	2.1	7.3	1.2	0.7	
19	41.0	1.0	2.9	7.4	1.2	0.5	
20	53.0	1.0	2.3	7.4	1.2	0.6	
21	57.0	1.0	2.1	7.4	1.0	0.6	
22	68.0	1.0	1.8		1.0		
23	49.0	1.0	2.4		1.2		
24	64.0	1.0	1.9	7.4	1.2	0.6	
25	60.0	1.0	2.0	7.4	1.2	0.8	
26	52.0	1.0	2.3	7.4	1.4	0.7	
27	43.0	1.0	2.8	7.4	1.6	0.7	
28	55.0	1.0	2.2	7.3	1.3	0.7	
29	62.0	2.0	3.9		1.4		
30	40.0	2.0	6.0		1.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: JONETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996


AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	1927.0	43.0	91.4	160.3	40.1	12.3	
AVERAGE	62.2	1.4	2.9	7.3	1.3	0.6	
MINIMUM	103.0	2.0	8.0	7.3	1.4	0.8	
MAXIMUM	15.0	1.0	1.5	7.2	1.0	0.4	
01	62.0	2.0	3.9	7.3	1.4	0.5	
02	42.0	2.0	5.7	7.3	1.2	0.6	
03	38.0	2.0	6.3	7.3	1.2	0.5	
04	35.0	1.0	3.4		1.4		
05	55.0	1.0	2.2		1.3		
06	15.0	1.0	8.0	7.3	1.4	0.6	
07	68.0	1.0	1.8	7.3	1.2	0.4	
08	61.0	1.0	2.0	7.3	1.4	0.5	
09	52.0	2.0	4.6	7.3	1.2	0.7	
10	47.0	1.0	2.6	7.3	1.4	0.6	
11	77.0	1.0	1.6		1.4		
12	80.0	2.0	3.0		1.4		
13	68.0	1.0	1.8	7.3	1.4	0.6	
14	61.0	1.0	2.0	7.3	1.0	0.4	
15	50.0	1.0	2.4	7.3	1.4	0.8	
16	64.0	1.0	1.9	7.3	1.2	0.6	
17	72.0	2.0	3.3	7.3	1.2	0.4	
18	76.0	2.0	3.2		1.2		
19	83.0	2.0	2.9		1.3		
20	79.0	1.0	1.5	7.2	1.2	0.5	
21	55.0	1.0	2.2	7.3	1.4	0.7	
22	59.0	1.0	2.0	7.3	1.2	0.4	
23	77.0	1.0	1.6	7.3	1.4	0.6	
24	63.0	1.0	1.9	7.3	1.3	0.5	
25	103.0	2.0	2.3		1.4		
26	86.0	2.0	2.8		1.2		
27	75.0	1.0	1.6		1.4		
28	41.0	1.0	2.9	7.2	1.4	0.6	
29	56.0	1.0	2.1	7.2	1.2	0.5	
30	48.0	2.0	5.0	7.3	1.2	0.7	
31	79.0	2.0	3.0	7.3	1.2	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 05-13-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041F

NAME OF DRINKING WATER SYSTEM VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT  , C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1588.0	33.0	78.3	116.5	39.9	9.3	
AVERAGE	52.9	1.1	2.6	7.3	1.3	0.6	
MAXIMUM	79.0	2.0	6.3	7.3	1.6	0.8	
MINIMUM	37.0	1.0	1.6	7.2	0.5	0.4	
01	38.0	2.0	6.3	7.2	1.0	0.6	
02	55.0	1.0	2.2		0.5		
03	50.0	1.0	2.4		1.4		
04	47.0	1.0	2.6		1.2		
05	46.0	1.0	2.6		1.4		
06	53.0	1.0	2.3		1.2		
07	51.0	1.0	2.4		1.2		
08	45.0	1.0	2.7	7.2	1.4	0.8	
09	43.0	2.0	5.6		1.6		
10	58.0	1.0	2.1		1.4		
11	49.0	1.0	2.4	7.3	1.4	0.5	
12	40.0	1.0	3.0	7.2	1.5	0.7	
13	57.0	1.0	2.1		1.6		
14	77.0	1.0	1.6		1.6		
15	45.0	1.0	2.7	7.3	1.5	0.7	
16	39.0	1.0	3.1	7.3	1.4	0.5	
17	39.0	1.0	3.1	7.3	1.4	0.4	
18	57.0	1.0	2.1	7.3	1.5	0.4	
19	37.0	1.0	3.2	7.3	1.6	0.8	
20	79.0	2.0	3.0		1.4		
21	58.0	1.0	2.1		1.3		
22	65.0	1.0	1.8	7.3	1.5	0.6	
23	53.0	1.0	2.3	7.3	1.4	0.8	
24	64.0	1.0	1.9	7.3	1.4	0.4	
25	49.0	1.0	2.4	7.3	1.2	0.6	
26	64.0	1.0	1.9		1.1		
27	74.0	1.0	1.6	7.3	1.2	0.5	
28	47.0	1.0	2.6	7.3	1.4	0.4	
29	61.0	1.0	2.0		1.0		
30	48.0	1.0	2.5	7.3	1.2	0.6	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-08-96

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OPERATED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

IN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *James E. L. [Signature]*, C.O., CERT. NO. C-7537

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
APR 01	1489.0	34.0	87.7	43.8	39.3	2.8	
APR 02	48.0	1.1	2.8	7.3	1.3	0.5	
APR 03	67.0	2.0	5.9	7.3	1.5	0.6	
APR 04	28.0	1.0	1.8	7.3	1.0	0.4	
APR 05	44.0	1.0	2.7	7.3	1.2	0.6	
APR 06	45.0	1.0	2.7		1.5		
APR 07	46.0	2.0	5.2		1.4		
APR 08	42.0	1.0	2.9	7.3	1.4	0.4	
APR 09	50.0	1.0	2.4		1.3		
APR 10	51.0	1.0	2.4		1.4		
APR 11	43.0	1.0	2.8		1.2		
APR 12	61.0	1.0	2.0	7.3	1.2		
APR 13	57.0	1.0	2.1		1.3	0.5	
APR 14	53.0	1.0	2.3		1.3		
APR 15	44.0	1.0	2.7	7.3	1.2	0.4	
APR 16	41.0	2.0	5.9		1.2		
APR 17	28.0	1.0	4.3		1.2		
APR 18	55.0	1.0	2.2		1.4		
APR 19	40.0	1.0	3.0		1.4		
APR 20	58.0	1.0	2.1		1.4		
APR 21	67.0	1.0	1.8		1.2		
APR 22	45.0	1.0	2.7	7.3	1.2	0.5	
APR 23	48.0	1.0	2.5		1.4		
APR 24	37.0	1.0	3.2		1.2		
APR 25	59.0	1.0	2.0		1.2		
APR 26	43.0	1.0	2.8		1.2		
APR 27	38.0	1.0	3.2		1.2		
APR 28	63.0	1.0	1.9		1.2		
APR 29	47.0	1.0	2.6		1.3		
APR 30	46.0	1.0	2.6	7.3	1.0	0.4	
APR 31	50.0	1.0	2.4		1.2		
APR 32	42.0	1.0	2.9		1.2		
APR 33	50.0	1.0	2.4		1.2		
APR 34	51.0	2.0	4.7		1.2		
APR 35	45.0	1.0	2.7		1.4		

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-07-96

REMARKS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-004

NAME OF DRINKING WATER SYS: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., -DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996


PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT



, C.O., CERT. NO. C-7537

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1525.0	31.0	71.3	50.4	38.7	3.2	
AVERAGE	52.6	1.1	2.5	7.2	1.3	0.5	
MAXIMUM	69.0	2.0	3.8	7.3	1.6	0.8	
MINIMUM	37.0	1.0	1.9	7.1	1.0	0.2	
01	56.0	1.0	2.1	7.1	1.3	0.8	
02	50.0	1.0	2.4		1.4		
03	54.0	1.0	2.2		1.4		
04	56.0	1.0	2.1		1.4		
05	63.0	2.0	3.8	7.2	1.6	0.6	
06	52.0	1.0	2.3	7.2	1.6	0.4	
07	54.0	1.0	2.2	7.1	1.4	0.2	
08	54.0	1.0	2.2		1.4		
09	56.0	1.0	2.1		1.2		
10	46.0	1.0	2.6		1.4		
11	54.0	1.0	2.2		1.4		
12	55.0	1.0	2.2		1.3		
13	51.0	1.0	2.4	7.3	1.0	0.2	
14	37.0	1.0	3.2		1.0		
15	55.0	1.0	2.2		1.0		
16	39.0	1.0	3.1		1.4		
17	54.0	1.0	2.2		1.4		
18	55.0	1.0	2.2		1.4		
19	69.0	2.0	3.5		1.5		
20	51.0	1.0	2.4	7.3	1.2	0.6	
21	53.0	1.0	2.3		1.3		
22	42.0	1.0	2.9		1.5		
23	51.0	1.0	2.4		1.4		
24	58.0	1.0	2.1		1.3		
25	63.0	1.0	1.9		1.3		
26	59.0	1.0	2.0		1.2		
27	41.0	1.0	2.9		1.2		
28	38.0	1.0	3.2	7.2	1.4	0.4	
29	59.0	1.0	2.0		1.4		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

PWS ID NO. 2161218 C.U.P. NO. 2-031-0041N

NAME OF DRINKING WATER SYSTEM: VENETIA TERRACE WATER TREATMENT PLANT

LOCATION: 5190 ENSIGN AVENUE

JACKSONVILLE, FLA., DUVAL COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Paul Dombroski, C.O., CERT. NO. C-5836

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	1549.0	--31.0	77.7	65.8	36.4	5.9	
AVERAGE	50.0	1.0	2.5	7.3	1.2	0.7	
MAXIMUM	73.0	1.0	3.9	7.4	1.5	0.8	
MINIMUM	31.0	1.0	1.6	7.2	1.0	0.5	
01	72.0	1.0	1.7		1.1		
02	48.0	1.0	2.5	7.3	1.2	0.5	
03	45.0	1.0	2.7		1.1		
04	48.0	1.0	2.5	7.4	1.0	0.6	
05	52.0	1.0	2.3		1.2		
06	56.0	1.0	2.1		1.4		
07	68.0	1.0	1.8		1.3		
08	73.0	1.0	1.6	7.2	1.2	0.8	
09	69.0	1.0	1.7		1.2		
10	47.0	1.0	2.6	7.3	1.2	0.6	
11	59.0	1.0	2.0		1.2		
12	59.0	1.0	2.0		1.1		
13	53.0	1.0	2.3		1.2		
14	51.0	1.0	2.4		1.2		
15	48.0	1.0	2.5		1.3		
16	40.0	1.0	3.0	7.4	1.2	0.6	
17	40.0	1.0	3.0		1.1		
18	53.0	1.0	2.3	7.3	1.2	0.8	
19	31.0	1.0	3.9		1.1		
20	46.0	1.0	2.6		1.1		
21	49.0	1.0	2.4		1.4		
22	42.0	1.0	2.9		1.2		
23	54.0	1.0	2.2	7.3	1.0	0.5	
24	47.0	1.0	2.6		1.1		
25	45.0	1.0	2.7	7.4	1.2	0.8	
26	31.0	1.0	3.9		1.2		
27	36.0	1.0	3.3		1.0		
28	49.0	1.0	2.4		1.0		
29	48.0	1.0	2.5		1.0		
30	47.0	1.0	2.6	7.2	1.2	0.7	
31	43.0	1.0	2.8		1.5		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: December 1996

PLANT EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth A. Sneyd, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	30.8	7.75	1425.7	175.5	57.5	46.5	
AVERAGE	1.0	0.25	46.0	7.3	1.9	1.9	
MAXIMUM	2.8	0.25	150.0	7.4	2.5	2.5	
MINIMUM	0.2	0.25	10.7	7.2	1.4	1.4	
01	0.9	0.25	33.3		2.0	2.0	
02	0.8	0.25	37.5	7.2	2.0	2.0	
03	2.5	0.25	12.0	7.2	1.8	1.8	
04	2.8	0.25	10.7	7.2	1.4	1.4	
05	2.2	0.25	13.6	7.2	1.8	1.8	
06	1.9	0.25	15.8	7.2	1.6	1.6	
07	1.5	0.25	20.0		1.6		
08	1.1	0.25	27.3		1.8		
09	0.9	0.25	33.3	7.2	1.5	1.5	
10	1.8	0.25	16.7	7.2	2.0	2.0	
11	1.8	0.25	16.7	7.3	2.1	2.1	
12	0.5	0.25	60.0	7.2	2.5	2.5	
13	0.2	0.25	150.0	7.3	2.0	2.0	
14	0.4	0.25	75.0	7.3	2.5	2.5	
15	0.5	0.25	60.0	7.4	1.8	1.8	
16	0.3	0.25	100.0	7.4	2.0	2.0	
17	0.3	0.25	100.0	7.4	1.8	1.8	
18	0.4	0.25	75.0	7.4	1.5	1.5	
19	1.0	0.25	30.0	7.4	1.8	1.8	
20	0.8	0.25	37.5	7.4	1.6	1.6	
21	1.3	0.25	23.1	7.4	1.8	1.8	
22	0.8	0.25	37.5	7.4	1.8	1.8	
23	0.8	0.25	37.5	7.4	1.9	1.9	
24	0.8	0.25	37.5		1.9		
25	0.7	0.25	42.9		2.0		
26	0.6	0.25	50.0	7.4	1.9	1.9	
27	0.6	0.25	50.0	7.4	1.9	1.9	
28	0.3	0.25	100.0		1.9		
29	1.0	0.25	30.0		1.7		
30	0.6	0.25	50.0	7.3	1.8	1.8	
31	0.7	0.25	42.9	7.3	1.8	1.7	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

YS ID NO. 2454310 C.U.P. NO. () STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; MASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: November 1996

PLANT EFFLUENT PH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth A. Snyder, C.O., CERT. NO. C-4016

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	EFFLUENT PH	RESIDUAL CHLORINE mg/l	BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
MONTHLY TOTAL	23.1	7.50	151.7	61.1	43.7
AVERAGE	0.8	0.25	7.2	2.0	2.1
MINIMUM	2.3	0.25	7.3	2.7	2.7
MAXIMUM	0.2	0.25	7.2	1.2	1.5
01	0.4	0.25	7.2	2.2	2.2
02	0.4	0.25	7.2	2.2	2.2
03	0.8	0.25	7.2	2.2	2.2
04	0.3	0.25	7.2	2.2	2.2
05	0.7	0.25	7.2	2.2	2.2
06	0.2	0.25	7.2	2.2	2.2
07	0.8	0.25	7.2	2.2	2.2
08	0.9	0.25	7.2	2.2	2.2
09	0.8	0.25	7.2	2.2	2.2
10	0.5	0.25	7.2	2.2	2.2
11	1.2	0.25	7.2	1.9	1.8
12	1.2	0.25	7.3	2.0	2.0
13	0.5	0.25	7.2	2.0	2.0
14	0.8	0.25	7.2	2.5	2.5
15	0.8	0.25	7.2	2.5	2.5
16	0.8	0.25	7.2	2.3	2.3
17	0.4	0.25	7.2	2.3	2.7
18	0.4	0.25	7.2	2.4	2.4
19	0.4	0.25	7.2	2.0	2.0
20	0.6	0.25	7.2	2.3	2.3
21	0.5	0.25	7.2	1.4	2.1
22	0.6	0.25	7.2	1.4	1.4
23	0.5	0.25	7.2	1.2	1.6
24	0.7	0.25	7.3	1.5	1.5
25	1.1	0.25	7.3	1.6	1.6
26	1.2	0.25	7.3	1.6	1.6
27	1.2	0.25	7.3	1.6	1.6
28	1.2	0.25	7.3	1.6	1.6
29	0.9	0.25	7.3	1.9	1.9
30	2.3	0.25	7.3	2.0	2.0

DRINKING TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: October 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth L. Lynch, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17.0	7.75	2058.2	208.6	67.0	62.6	
AVERAGE	0.5	0.25	66.4	7.2	2.2	2.2	
MAXIMUM	1.4	0.25	150.0	7.2	2.2	2.2	
MINIMUM	0.2	0.25	21.4	7.1	1.8	1.8	
01	0.3	0.25	100.0	7.1	2.2	2.2	
02	0.4	0.25	75.0	7.2	2.2	2.2	
03	0.6	0.25	50.0	7.2	2.2	2.2	
04	0.5	0.25	60.0	7.2	2.2	2.2	
05	0.5	0.25	60.0	7.2	2.2	2.2	
06	0.5	0.25	60.0	7.2	2.2	2.2	
07	0.8	0.25	37.5	7.2	2.2	2.2	
08	0.4	0.25	75.0	7.2	2.2	2.2	
09	0.7	0.25	42.9	7.2	2.2	2.2	
10	0.6	0.25	50.0	7.2	2.2	2.2	
11	0.7	0.25	42.9	7.2	2.2	2.2	
12	0.6	0.25	50.0		2.2		
13	0.5	0.25	60.0		2.2		
14	0.5	0.25	60.0	7.2	2.2	2.2	
15	0.5	0.25	60.0	7.2	2.2	2.2	
16	0.7	0.25	42.9	7.2	2.2	2.2	
17	0.4	0.25	75.0	7.2	2.2	2.2	
18	0.5	0.25	60.0	7.1	2.2	2.2	
19	0.5	0.25	60.0	7.2	2.2	2.2	
20	0.5	0.25	60.0	7.2	2.2	2.2	
21	0.5	0.25	60.0	7.2	2.2	2.2	
22	0.5	0.25	60.0	7.2	2.2	2.2	
23	1.4	0.25	21.4	7.2	2.2	2.2	
24	1.2	0.25	25.0	7.2	2.2	2.2	
25	0.7	0.25	42.9	7.2	1.8	1.8	
26	0.7	0.25	42.9	7.2	1.8	1.8	
27	0.4	0.25	75.0	7.2	1.8	1.8	
28	0.2	0.25	150.0	7.2	2.2	2.2	
29	0.3	0.25	100.0	7.2	2.2	2.2	
30	0.2	0.25	150.0	7.2	2.2	2.2	
31	0.2	0.25	150.0	7.2	2.2	2.2	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: September 1996

AVERAGE EFFLUENT pH: 7.3(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DIRECTION OF FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth E. Lynch, C.O., CERT. NO. C-4016

DAYS	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	18.9	7.50	1828.3	146.3	64.7	43.9	
AVERAGE	0.6	0.25	60.9	7.3	2.2	2.2	
MAXIMUM	1.4	0.25	150.0	8.2	2.2	2.2	
MINIMUM	0.2	0.25	21.4	7.1	1.9	2.1	
01	0.6	0.25	50.0		2.0		
02	0.8	0.25	37.5		2.0		
03	0.6	0.25	50.0	7.1	2.1	2.1	
04	0.3	0.25	100.0	7.1	2.2	2.2	
05	1.4	0.25	21.4	7.1	2.2	2.2	
06	1.1	0.25	27.3	7.2	2.2	2.2	
07	1.3	0.25	23.1		2.2		
08	0.4	0.25	75.0		2.0		
09	0.2	0.25	150.0	7.1	2.2	2.2	
10	1.0	0.25	30.0	7.1	2.2	2.2	
11	0.6	0.25	50.0	7.1	2.2	2.2	
12	1.0	0.25	30.0	7.1	2.2	2.2	
13	0.7	0.25	42.9	7.2	2.2	2.2	
14	0.5	0.25	60.0		2.2		
15	0.5	0.25	60.0		2.2		
16	0.6	0.25	50.0	8.2	2.2	2.2	
17	0.4	0.25	75.0	8.2	2.2	2.2	
18	0.2	0.25	150.0	8.2	2.2	2.2	
19	0.8	0.25	37.5	7.3	2.2	2.2	
20	0.6	0.25	50.0	7.2	2.2	2.2	
21	0.8	0.25	37.5		2.1		
22	0.5	0.25	60.0		2.0		
23	0.3	0.25	100.0	7.2	2.2	2.2	
24	0.4	0.25	75.0	7.2	2.2	2.2	
25	0.6	0.25	50.0	7.2	2.2	2.2	
26	0.3	0.25	100.0	7.2	2.2	2.2	
27	0.9	0.25	33.3	7.2	2.2	2.2	
28	0.7	0.25	42.9		1.9		
29	0.3	0.25	100.0		2.2		
30	0.5	0.25	60.0	7.1	2.2	2.2	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

SE ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: 70 STATION WATER TREATMENT PLANT

LOCATION: YULBEE AMOCO STATE ROAD A1A

YULBEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: August 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Kenneth A. Hayden*, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE GALS. OR LBS. USED	CHLORINE mg/l	EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
					PLANT EFFLUENT	REMOTE TAP	
DAILY TOTAL	30.5	7.75	1226.2	165.7	65.1	49.3	
AVERAGE	1.0	0.25	39.6	7.2	2.1	2.1	
MINIMUM	3.4	0.25	100.0	7.3	2.2	2.2	
MAXIMUM	0.3	0.25	8.8	7.1	1.4	1.4	
01	0.9	0.25	33.3	7.2	1.4	1.4	
02	1.5	0.25	20.0		1.5		
03	1.3	0.25	23.1		2.2		
04	0.5	0.25	60.0		2.2		
05	0.7	0.25	42.9	7.2	2.1	2.1	
06	0.7	0.25	42.9	7.2	2.2	2.2	
07	1.1	0.25	27.3	7.2	2.2	2.2	
08	1.4	0.25	21.4	7.2	2.2	2.2	
09	1.3	0.25	23.1	7.3	2.2	2.2	
10	0.8	0.25	37.5		2.2		
11	1.1	0.25	27.3		2.2		
12	0.7	0.25	42.9	7.2	2.2	2.2	
13	1.2	0.25	25.0	7.2	2.1	2.1	
14	0.4	0.25	75.0	7.1	2.1	2.2	
15	1.5	0.25	20.0	7.1	2.1	2.2	
16	3.4	0.25	8.8	7.1	2.1	2.2	
17	1.2	0.25	25.0	7.2	2.1	2.2	
18	0.3	0.25	100.0		2.1		
19	0.9	0.25	33.3	7.2	2.1	2.2	
20	0.5	0.25	60.0	7.2	2.1	2.2	
21	0.6	0.25	50.0	7.2	2.1	2.2	
22	1.8	0.25	16.7	7.2	2.0	2.0	
23	0.9	0.25	33.3	7.2	2.0	2.1	
24	0.8	0.25	37.5	7.3	2.2	2.2	
25	0.8	0.25	37.5		2.2		
26	0.8	0.25	37.5	7.3	2.2	2.2	
27	0.3	0.25	100.0	7.3	2.2	2.2	
28	0.5	0.25	60.0	7.2	2.2	2.2	
29	1.0	0.25	30.0	7.2	2.2	2.2	
30	0.8	0.25	37.5	7.2	2.2	2.2	
31	0.8	0.25	37.5		2.0		

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

S ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: ANOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE ANOCO STATE ROAD A1A

YULEE, FL ; MASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: July 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

WATER FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth L. Lynch, C.O., CERT. NO. C-4016

MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	24.1	7.75	1532.8	158.8	58.2	42.0	
AVERAGE	0.8	0.25	49.4	7.2	1.9	1.9	
MINIMUM	3.4	0.25	150.0	7.3	2.2	2.2	
MAXIMUM	0.2	0.25	8.8	7.1	1.2	1.4	
01	0.4	0.25	75.0	7.3	2.2	2.2	
02	0.6	0.25	50.0	7.2	2.2	2.2	
03	0.8	0.25	37.5	7.2	2.2	2.2	
04	0.8	0.25	37.5		1.8		
05	1.0	0.25	30.0	7.3	2.0	2.0	
06	0.9	0.25	33.3		1.6		
07	1.1	0.25	27.3		1.2		
08	0.4	0.25	75.0	7.2	1.8	1.8	
09	0.8	0.25	37.5	7.2	2.0	2.0	
10	0.4	0.25	75.0	7.2	2.2	2.2	
11	0.9	0.25	33.3	7.3	2.2	2.2	
12	0.7	0.25	42.9	7.3	2.2	2.2	
13	0.7	0.25	42.9		2.2		
14	0.5	0.25	60.0		2.2		
15	0.6	0.25	50.0	7.1	1.6	1.6	
16	0.6	0.25	50.0	7.2	1.8	1.8	
17	0.6	0.25	50.0	7.2	1.4	1.4	
18	0.9	0.25	33.3	7.2	1.8	1.8	
19	1.0	0.25	30.0	7.2	1.6	1.6	
20	0.8	0.25	37.5		1.8		
21	0.6	0.25	50.0		1.8		
22	0.3	0.25	100.0	7.2	2.0	2.0	
23	0.7	0.25	42.9	7.2	1.8	1.8	
24	0.4	0.25	75.0	7.2	1.8	1.8	
25	0.6	0.25	50.0	7.2	1.6	1.6	
26	1.1	0.25	27.3	7.2	2.0	2.0	
27	0.9	0.25	33.3		1.8		
28	3.4	0.25	8.8		1.8		
29	0.2	0.25	150.0	7.3	1.6	1.6	
30	0.8	0.25	37.5	7.2	2.2	2.2	
31	0.6	0.25	50.0	7.2	1.8	1.8	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: JCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: June 1996

PLANT EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Kenneth A. Lynch*, C.O., CERT. NO. C-4016

DAYS MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	19.6	7.50	1818.7	180.6	64.5	60.0	
AVERAGE	0.7	0.25	60.6	7.2	2.2	2.1	
MAXIMUM	1.3	0.25	300.0	7.4	2.2	2.2	
MINIMUM	0.1	0.25	23.1	7.1	1.3	1.2	
01	0.6	0.25	50.0	7.4	2.2	2.2	
02	0.6	0.25	50.0	7.2	2.2	2.2	
03	0.6	0.25	50.0	7.1	2.2	2.2	
04	0.4	0.25	75.0	7.1	2.2	2.2	
05	0.5	0.25	60.0	7.3	2.2	2.2	
06	0.5	0.25	60.0	7.3	2.2	2.2	
07	0.7	0.25	42.9	7.2	2.2	2.2	
08	0.4	0.25	75.0		2.0	2.0	
09	0.7	0.25	42.9		1.8	1.8	
10	0.6	0.25	50.0	7.2	2.2	2.2	
11	0.5	0.25	60.0	7.2	2.2	2.2	
12	0.5	0.25	60.0	7.2	1.3	1.2	
13	0.4	0.25	75.0	7.2	2.2	2.2	
14	0.7	0.25	42.9	7.2	2.2	2.2	
15	1.0	0.25	30.0	7.2	2.2	2.2	
16	1.3	0.25	23.1		2.2	2.2	
17	1.0	0.25	30.0	7.3	2.2	2.2	
18	0.2	0.25	150.0	7.2	2.2	2.2	
19	0.6	0.25	50.0	7.2	2.2	2.2	
20	0.5	0.25	60.0	7.2	2.2	2.2	
21	0.8	0.25	37.5	7.2	2.2	2.2	
22	0.8	0.25	37.5		2.2		
23	0.7	0.25	42.9		2.2		
24	1.0	0.25	30.0	7.2	2.2	2.2	
25	0.1	0.25	300.0	7.2	2.2	2.2	
26	0.3	0.25	100.0	7.2	2.2	2.2	
27	0.9	0.25	33.3	7.2	2.2	2.2	
28	1.0	0.25	30.0	7.3	2.2	2.2	
29	0.9	0.25	33.3	7.3	2.2	2.2	
30	0.8	0.25	37.5	7.3	2.2	2.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN:

2 SAMPLE DATE: 06-03-96

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

WATER ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: May 1996

AVERAGE EFFLUENT pH: 7.2(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT Kenneth E. Hughes, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	33.2	7.75	1203.7	201.2	68.2	61.6	
AVERAGE	1.1	0.25	38.8	7.2	2.2	2.2	
MAXIMUM	3.6	0.25	100.0	7.5	2.2	2.2	
MINIMUM	0.3	0.25	8.3	7.0	2.2	2.2	
01	0.9	0.25	33.3	7.0	2.2	2.2	
02	0.9	0.25	33.3	7.0	2.2	2.2	
03	0.8	0.25	37.5	7.1	2.2	2.2	
04	1.4	0.25	21.4	7.0	2.2	2.2	
05	0.8	0.25	37.5	7.1	2.2	2.2	
06	0.8	0.25	37.5	7.1	2.2	2.2	
07	1.0	0.25	30.0	7.1	2.2	2.2	
08	0.3	0.25	100.0	7.1	2.2	2.2	
09	1.0	0.25	30.0	7.1	2.2	2.2	
10	1.4	0.25	21.4	7.1	2.2	2.2	
11	0.8	0.25	37.5	7.1	2.2	2.2	
12	1.1	0.25	27.3	7.1	2.2	2.2	
13	2.5	0.25	12.0	7.1	2.2	2.2	
14	1.7	0.25	17.6	7.1	2.2	2.2	
15	0.8	0.25	37.5	7.1	2.2	2.2	
16	3.6	0.25	8.3	7.1	2.2	2.2	
17	1.5	0.25	20.0	7.0	2.2	2.2	
18	1.2	0.25	25.0	7.0	2.2	2.2	
19	1.1	0.25	27.3	7.0	2.2	2.2	
20	1.2	0.25	25.0	7.5	2.2	2.2	
21	0.5	0.25	60.0	7.5	2.2	2.2	
22	0.7	0.25	42.9	7.4	2.2	2.2	
23	0.5	0.25	60.0	7.4	2.2	2.2	
24	1.1	0.25	27.3	7.4	2.2	2.2	
25	0.4	0.25	75.0		2.2		
26	0.4	0.25	75.0		2.2		
27	2.6	0.25	11.5		2.2		
28	0.5	0.25	60.0	7.4	2.2	2.2	
29	0.4	0.25	75.0	7.5	2.2	2.2	
30	0.5	0.25	60.0	7.4	2.2	2.2	
31	0.8	0.25	37.5	7.4	2.2	2.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 05-09-96

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; MASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: April 1996

PLANT EFFLUENT pH: 7.0(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT *Kenneth C. High*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	31.6	7.50	977.3	97.6	65.8	65.8	
AVERAGE	1.1	0.25	32.6	7.0	2.2	2.2	
MAXIMUM	3.1	0.25	60.0	7.0	2.2	2.2	
MINIMUM	0.5	0.25	9.7	6.9	2.1	2.1	
01	1.1	0.25	27.3	6.9	2.2	2.2	
02	0.7	0.25	42.9	6.9	2.2	2.2	
03	0.6	0.25	50.0		2.2	2.2	
04	1.3	0.25	23.1		2.1	2.1	
05	1.5	0.25	20.0	6.9	2.2	2.2	
06	1.0	0.25	30.0		2.2	2.2	
07	1.0	0.25	30.0		2.2	2.2	
08	1.4	0.25	21.4		2.2	2.2	
09	1.1	0.25	27.3	7.0	2.2	2.2	
10	0.7	0.25	42.9		2.2	2.2	
11	1.0	0.25	30.0		2.2	2.2	
12	1.4	0.25	21.4		2.2	2.2	
13	0.9	0.25	33.3		2.2	2.2	
14	0.7	0.25	42.9		2.2	2.2	
15	0.7	0.25	42.9	6.9	2.2	2.2	
16	1.7	0.25	17.6		2.2	2.2	
17	0.8	0.25	37.5		2.2	2.2	
18	1.0	0.25	30.0		2.2	2.2	
19	1.0	0.25	30.0	7.0	2.2	2.2	
20	1.0	0.25	30.0		2.2	2.2	
21	1.0	0.25	30.0		2.2	2.2	
22	3.1	0.25	9.7		2.2	2.2	
23	0.5	0.25	60.0	7.0	2.2	2.2	
24	0.6	0.25	50.0	7.0	2.1	2.1	
25	0.8	0.25	37.5	7.0	2.2	2.2	
26	0.8	0.25	37.5	7.0	2.2	2.2	
27	1.1	0.25	27.3	7.0	2.2	2.2	
28	0.8	0.25	37.5	7.0	2.2	2.2	
29	1.5	0.25	20.0	7.0	2.2	2.2	
30	0.8	0.25	37.5	7.0	2.2	2.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 04-02-96

COMMENTS:

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: March 1996

AVERAGE EFFLUENT pH: 7.0(AVG)

NO. OF SERVICES AT END OF MONTH: _____

INLET FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT Kenneth A. Boyd, C.O., CERT. NO. C-4016

DATE	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
APRIL							
MARCH	35.0	7.75	1190.0	48.7	67.8	61.4	
MARCH	1.1	0.25	38.4	7.0	2.2	2.2	
MARCH	4.1	0.25	75.0	7.0	2.2	2.2	
MARCH	0.4	0.25	7.3	6.9	2.0	2.0	
01	0.8	0.25	37.5	6.9	2.2	2.2	
02	0.7	0.25	42.9		2.0		
03	0.7	0.25	42.9		2.2		
04	0.6	0.25	50.0		2.2		
05	0.4	0.25	75.0	7.0	2.2	2.2	
06	0.5	0.25	60.0		2.2	2.2	
07	0.5	0.25	60.0		2.0	2.0	
08	0.9	0.25	33.3	7.0	2.2	2.2	
09	3.0	0.25	10.0		2.2	2.2	
10	0.8	0.25	37.5		2.2	2.2	
11	0.6	0.25	50.0	6.9	2.2	2.2	
12	2.6	0.25	11.5		2.2	2.2	
13	2.3	0.25	13.0		2.2	2.2	
14	0.6	0.25	50.0		2.2	2.2	
15	0.7	0.25	42.9		2.2	2.2	
16	0.9	0.25	33.3		2.2	2.2	
17	0.6	0.25	50.0		2.2	2.2	
18	1.4	0.25	21.4	7.0	2.2	2.2	
19	0.7	0.25	42.9	7.0	2.2	2.2	
20	0.5	0.25	60.0		2.2	2.2	
21	1.1	0.25	27.3		2.2	2.2	
22	1.0	0.25	30.0		2.2	2.2	
23	3.2	0.25	9.4		2.2	2.2	
24	0.8	0.25	37.5		2.2	2.2	
25	1.0	0.25	30.0	6.9	2.2	2.2	
26	0.5	0.25	60.0		2.2	2.2	
27	0.5	0.25	60.0		2.2	2.2	
28	1.6	0.25	18.8		2.2	2.2	
29	0.7	0.25	42.9		2.2	2.2	
30	4.1	0.25	7.3		2.2	2.2	
31	0.7	0.25	42.9		2.2	2.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 03-05-96

PWS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYST AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULEE AMOCO STATE ROAD A1A

YULEE, FL ; HASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: February 1996

PLANT EFFLUENT pH: 7.0(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

I CERTIFY THIS REPORT IS CORRECT

Kenneth L. Lynch

, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	22.6	7.25	1373.6	48.9	63.0	63.0	
AVERAGE	0.8	0.25	47.4	7.0	2.2	2.2	
MAXIMUM	2.9	0.25	100.0	7.0	2.2	2.2	
MINIMUM	0.3	0.25	10.3	6.9	1.8	1.8	
01	0.5	0.25	60.0	7.0	2.2	2.2	
02	0.4	0.25	75.0		2.0	2.0	
03	0.5	0.25	60.0		2.2	2.2	
04	0.6	0.25	50.0		2.2	2.2	
05	0.9	0.25	33.3	7.0	1.8	1.8	
06	0.7	0.25	42.9		2.0	2.0	
07	0.6	0.25	50.0	7.0	2.2	2.2	
08	0.7	0.25	42.9		2.2	2.2	
09	0.5	0.25	60.0		2.2	2.2	
10	1.0	0.25	30.0		2.2	2.2	
11	0.4	0.25	75.0		2.2	2.2	
12	0.3	0.25	100.0	7.0	2.2	2.2	
13	0.6	0.25	50.0		2.2	2.2	
14	1.1	0.25	27.3		2.2	2.2	
15	0.9	0.25	33.3		2.2	2.2	
16	0.5	0.25	60.0		2.2	2.2	
17	1.5	0.25	20.0		2.2	2.2	
18	1.2	0.25	25.0		2.2	2.2	
19	0.7	0.25	42.9		2.2	2.2	
20	2.9	0.25	10.3	6.9	2.2	2.2	
21	0.6	0.25	50.0		2.2	2.2	
22	0.7	0.25	42.9		2.2	2.2	
23	0.8	0.25	37.5	7.0	2.2	2.2	
24	0.7	0.25	42.9		2.2	2.2	
25	1.0	0.25	30.0		2.2	2.2	
26	0.8	0.25	37.5	7.0	2.2	2.2	
27	0.5	0.25	60.0		2.2	2.2	
28	0.4	0.25	75.0		2.2	2.2	
29	0.6	0.25	50.0		2.2	2.2	

DRINKING WATER TREATMENT PLANT DAILY OPERATIONAL SUMMARY

IS ID NO. 2454310 C.U.P. NO.

NAME OF DRINKING WATER SYSTEM: AMOCO STATION WATER TREATMENT PLANT

LOCATION: YULBE AMOCO STATE ROAD A1A

YULBE, FL ; NASSAU COUNTY

OWNED BY: UNITED WATER FLORIDA INC.

REPORTING MONTH: January 1996

PLANT EFFLUENT pH: 7.1(AVG)

NO. OF SERVICES AT END OF MONTH: _____

DESIGN FLOW: _____

MAIN OFFICE PHONE NO. (904) 725-2865

CERTIFY THIS REPORT IS CORRECT *Kenneth A. Hyde*, C.O., CERT. NO. C-4016

DAYS OF MONTH	TOTAL WATER TREATED IN THOUSANDS OF GALLONS	CHLORINE		EFFLUENT pH	RESIDUAL CHLORINE mg/l		BACTERIOLOGICAL MCL VIOLATIONS AND COMMENTS
		GALS. OR LBS. USED	mg/l		PLANT EFFLUENT	REMOTE TAP	
MONTHLY TOTAL	17.5	7.75	1913.1	35.7	67.3	63.2	
AVERAGE	0.6	0.25	61.7	7.1	2.2	2.2	
MAXIMUM	1.1	0.25	150.0	7.4	2.2	2.2	
MINIMUM	0.2	0.25	27.3	7.0	2.0	2.0	
01	1.0	0.25	30.0		2.2	2.2	
02	0.8	0.25	37.5		2.0	2.0	
03	0.3	0.25	100.0	7.4	2.2	2.2	
04	0.7	0.25	42.9		2.2	2.2	
05	1.1	0.25	27.3		2.2	2.2	
06	0.6	0.25	50.0		2.2	2.2	
07	0.7	0.25	42.9		2.2	2.2	
08	0.6	0.25	50.0		2.2	2.2	
09	0.6	0.25	50.0		2.2	2.2	
10	0.6	0.25	50.0	7.0	2.0	2.0	
11	0.4	0.25	75.0		2.2	2.2	
12	0.4	0.25	75.0		2.2	2.2	
13	0.8	0.25	37.5		2.2	2.2	
14	0.5	0.25	60.0		2.2	2.2	
15	0.6	0.25	50.0	7.0	2.2	2.2	
16	0.7	0.25	42.9		2.2	2.2	
17	0.6	0.25	50.0		2.2	2.2	
18	0.5	0.25	60.0		2.2	2.2	
19	1.1	0.25	27.3		2.1	2.2	
20	0.2	0.25	150.0		2.0	.	
21	0.5	0.25	60.0		2.0		
22	0.6	0.25	50.0	7.1	2.2	2.0	
23	0.4	0.25	75.0		2.2	2.2	
24	0.5	0.25	60.0		2.2	2.2	
25	0.4	0.25	75.0		2.2	2.2	
26	0.4	0.25	75.0		2.2	2.2	
27	0.4	0.25	75.0		2.2	2.2	
28	0.5	0.25	60.0		2.2	2.2	
29	0.4	0.25	75.0	7.2	2.2	2.2	
30	0.3	0.25	100.0		2.2	2.2	
31	0.3	0.25	100.0		2.2	2.2	

NUMBER OF BACTERIOLOGICAL SAMPLES TAKEN: 2 SAMPLE DATE: 01-09-96