



FILE

March 17, 1999

Mr. Thomas A. O'Neill  
Public Works Director  
City of New Port Richey  
Public Works Department  
6420 Pine Hill Road  
Port Richey, Florida 34668

980242-SU

RE: Lindrick Service Corporation Bulk Wastewater Treatment Agreement  
PN # 9805

Dear Tom:

Enclosed, please find a copy of the following items:

- 1) Letter to Dr. Richard D. Garrity dated March 12, 1999.
- 2) Bi-monthly Update to DEP dated March 10, 1999.
- 3) Project Progress site plan.
- 4) Site plan with collection system chloride sampling results.

As part of the request to DEP to amend the Consent Order described in my letter to Dr. Garrity, I respectfully request on behalf of the Lindrick Service Corporation that the Bulk Wastewater Treatment Agreement be amended as well. We propose that the last sentence of Section VII., E., Page 7 be changed to the following:

Provided, however, if within **15 months** of the execution of this agreement Lindrick fails to provide the required proof that its chloride levels are less than 600 mg/l and Lindrick fails to connect to the City System as provided in provision III.A. hereof, this agreement shall terminate and becomes null and void.

Your continued cooperation and assistance in successful completion of this project is appreciated.

Please feel free to call on me at your convenience should you have any questions.

Sincerely,

*Edward G. Coppock*

Edward G. Coppock, P.E.  
Director of Engineering Services

cc: Joe Borda, P.E., A.I.A., Lindrick Service Corporation  
Jake Varn, Esquire

AFA  
APP  
CAF  
CMU  
CTR  
EAG  
LEG  
MAS  
OPC  
RRR  
SEC  
WAW  
GTH

DOCUMENT NUMBER - DATE

05645 MAY -4 99

FPSC-RECORDS/REPORTING



**FAXED**

VIA FACSIMILE

April 8, 1999

Mr. Thomas A. O'Neill  
Public Works Director  
City of New Port Richey  
Public Works Department  
6420 Pine Hill Road  
Port Richey, Florida 34668

RE: Lindrick Service Corporation Bulk Wastewater Treatment Agreement  
PN # 9805

Dear Tom:

As a follow up to my letter dated March 17, 1999, I am writing to request the status of the Lindrick Service Corporation's proposed amendment to the Bulk Wastewater Treatment Agreement. Has the extension of time been granted or scheduled as an agenda item before the City Commission? We can be available to attend the City Commission when the item is up for consideration.

Please let me know the status at your earliest convenience as we are quickly approaching completion of the transfer pump station.

Sincerely,

A handwritten signature in black ink that reads "Edward G. Coppock". The signature is written in a cursive style.

Edward G. Coppock, P.E.  
Director of Engineering Services

cc: Joe Borda, P.E., A.I.A., Lindrick Service Corporation  
Jake Varn, Esquire

EC:ec

P:\1998\9805\L0408Oneil.doc

## Lindrick Service Corporation - Collection System Rehabilitation Influent Composite Sampling

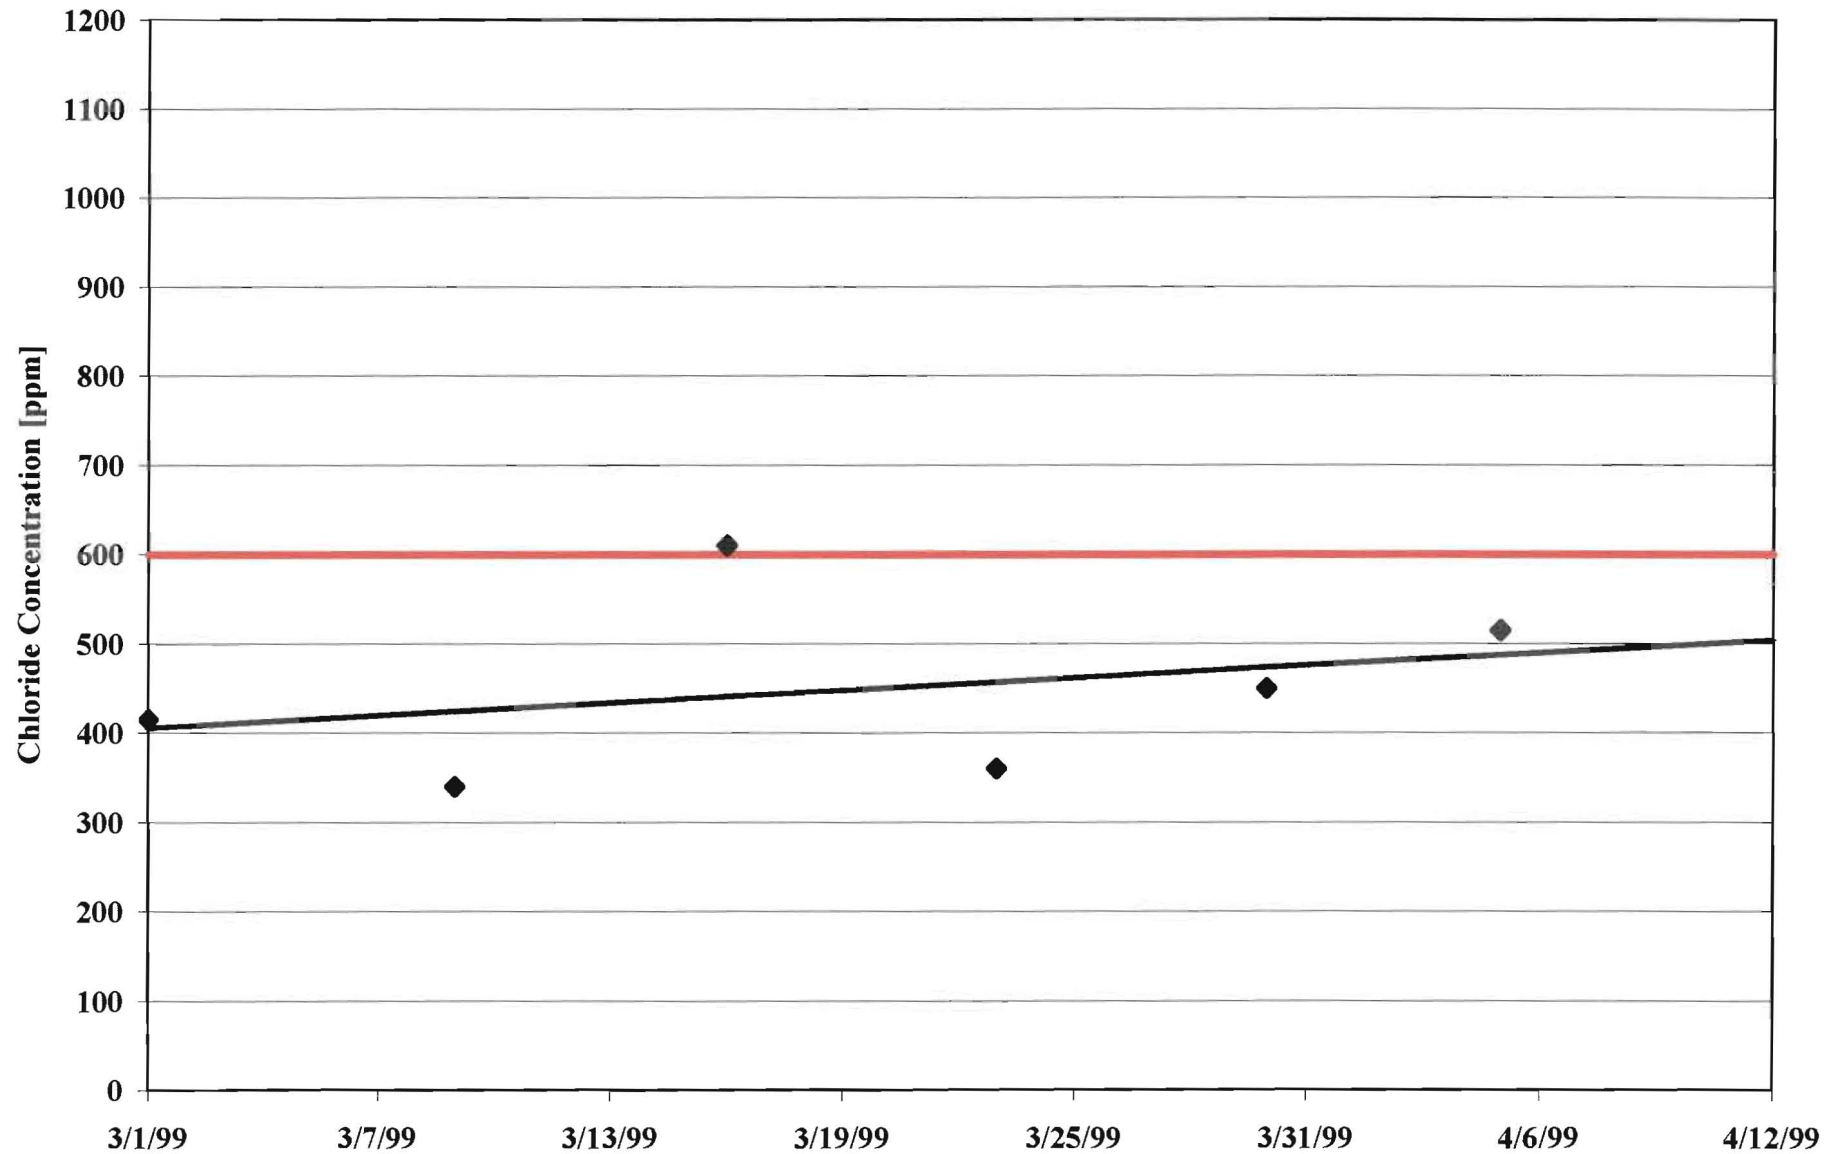


Figure 1. Composite chloride samples from influent.

# Lindrick Service Corporation - Collection System Rehabilitation Effluent Composite Sampling

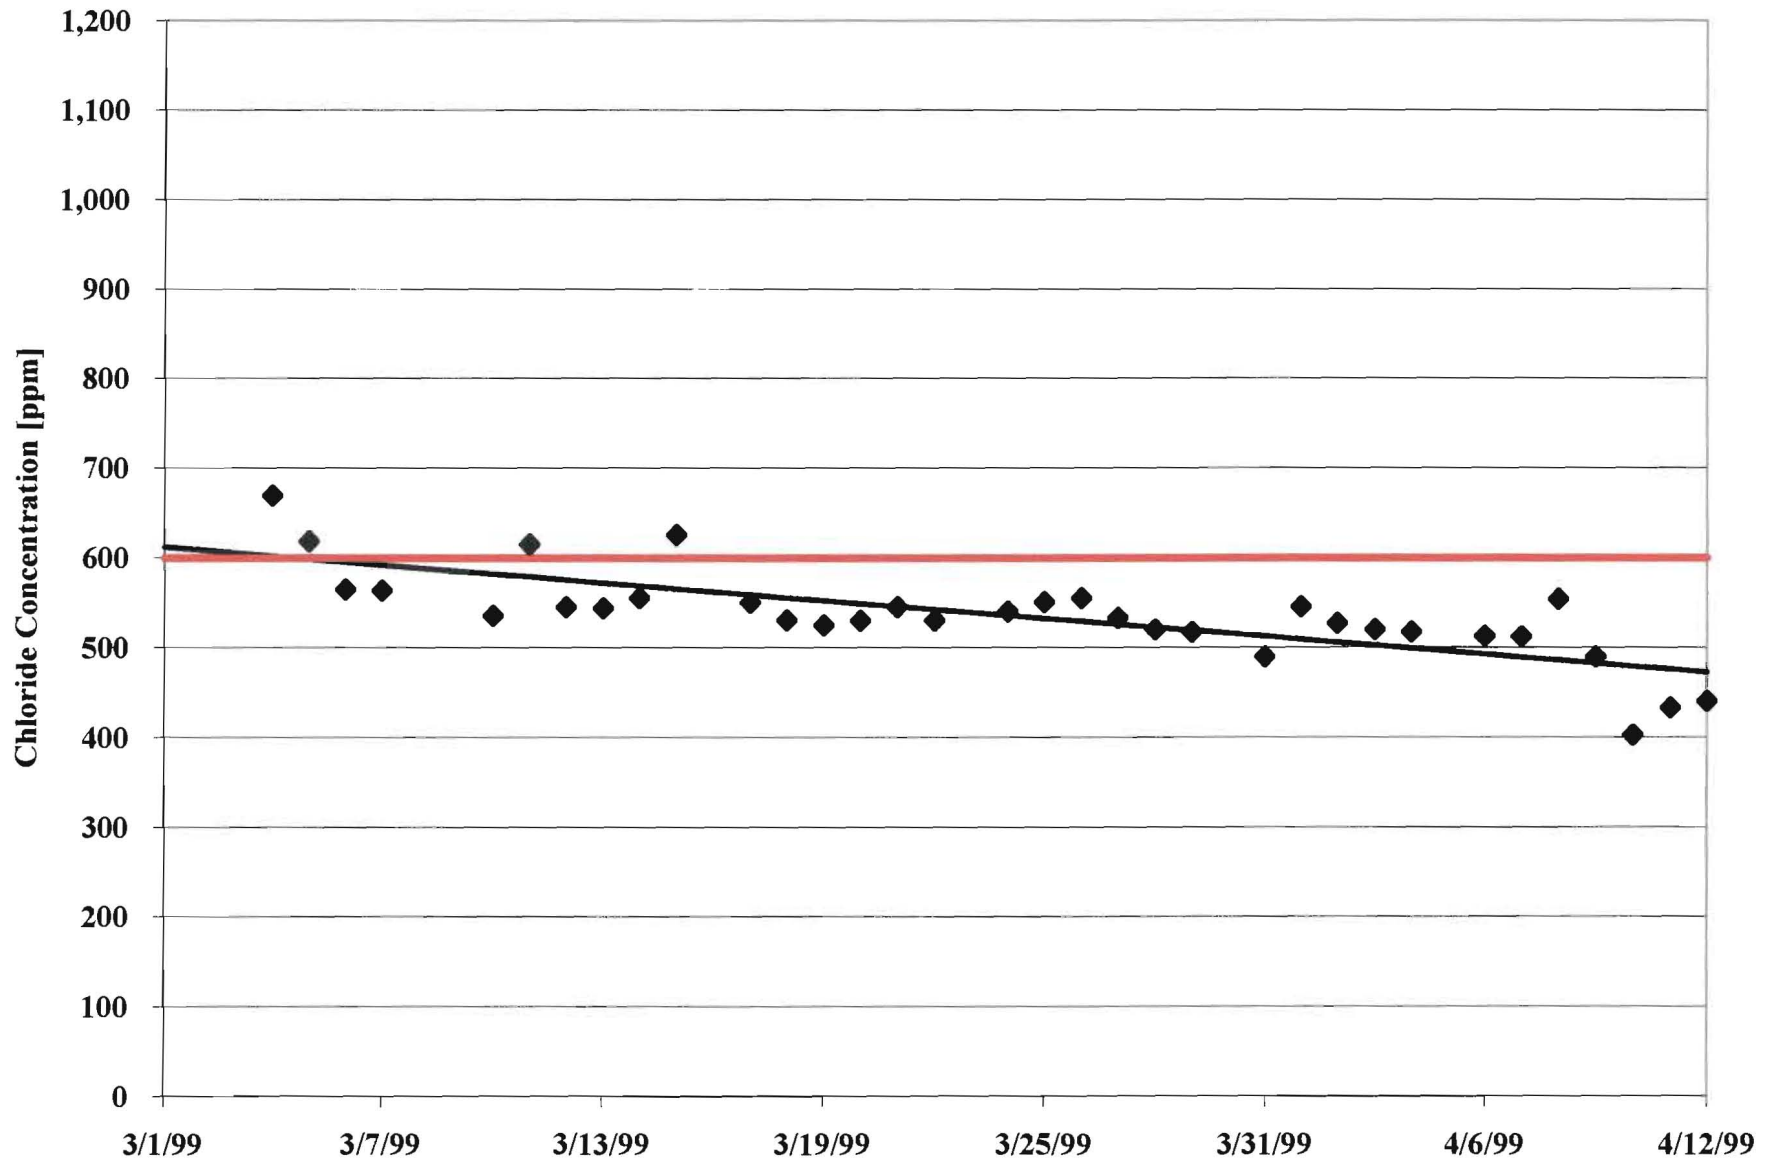


Figure 2. Composite chloride samples from effluent.



# Lindrick Service Corporation - Collection System Rehabilitation

## Influent Grab Samples - 8 PM vs. Influent Grab Samples - 8 AM

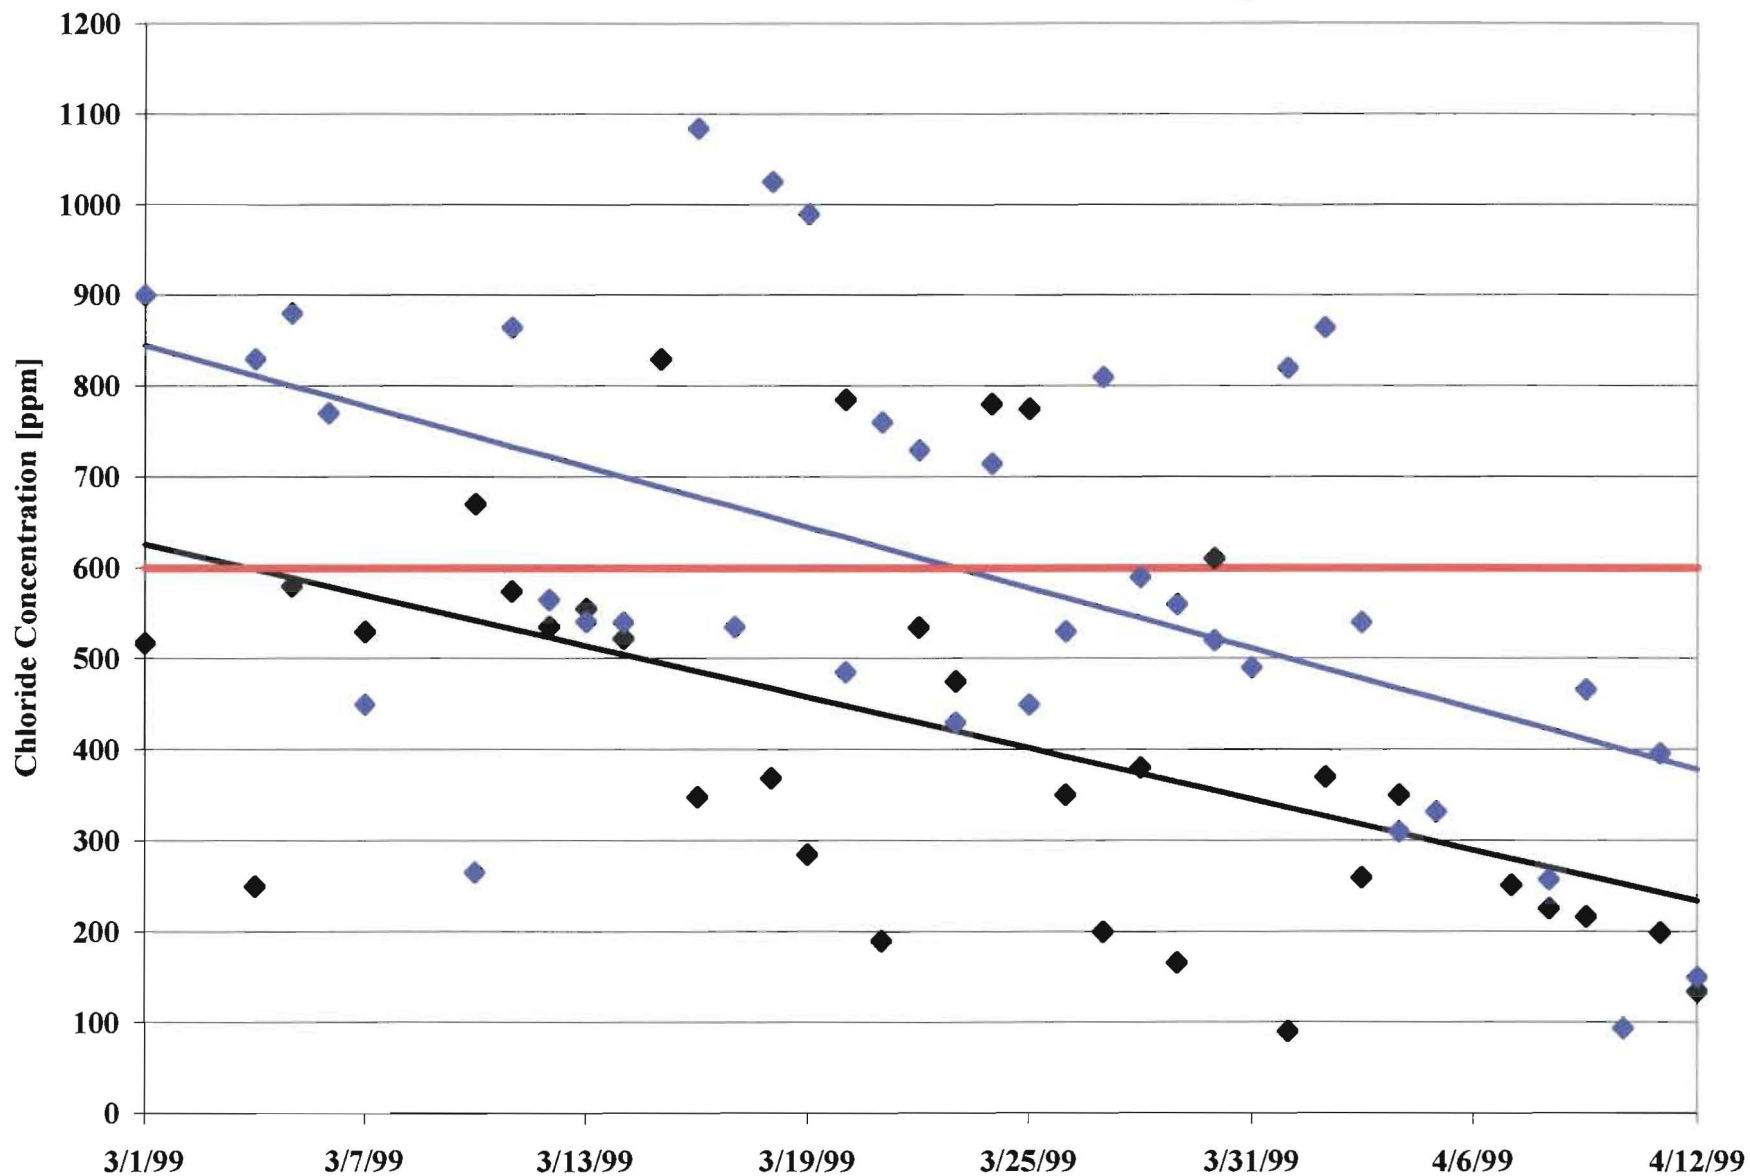


Figure 3. Influent chloride concentrations from grab samples taken at 8 AM and 8 PM.

# Lindrick Service Corporation - Collection System Rehabilitation

## Effluent Grab Samples - 8 PM vs. Effluent Grab Samples - 8 AM

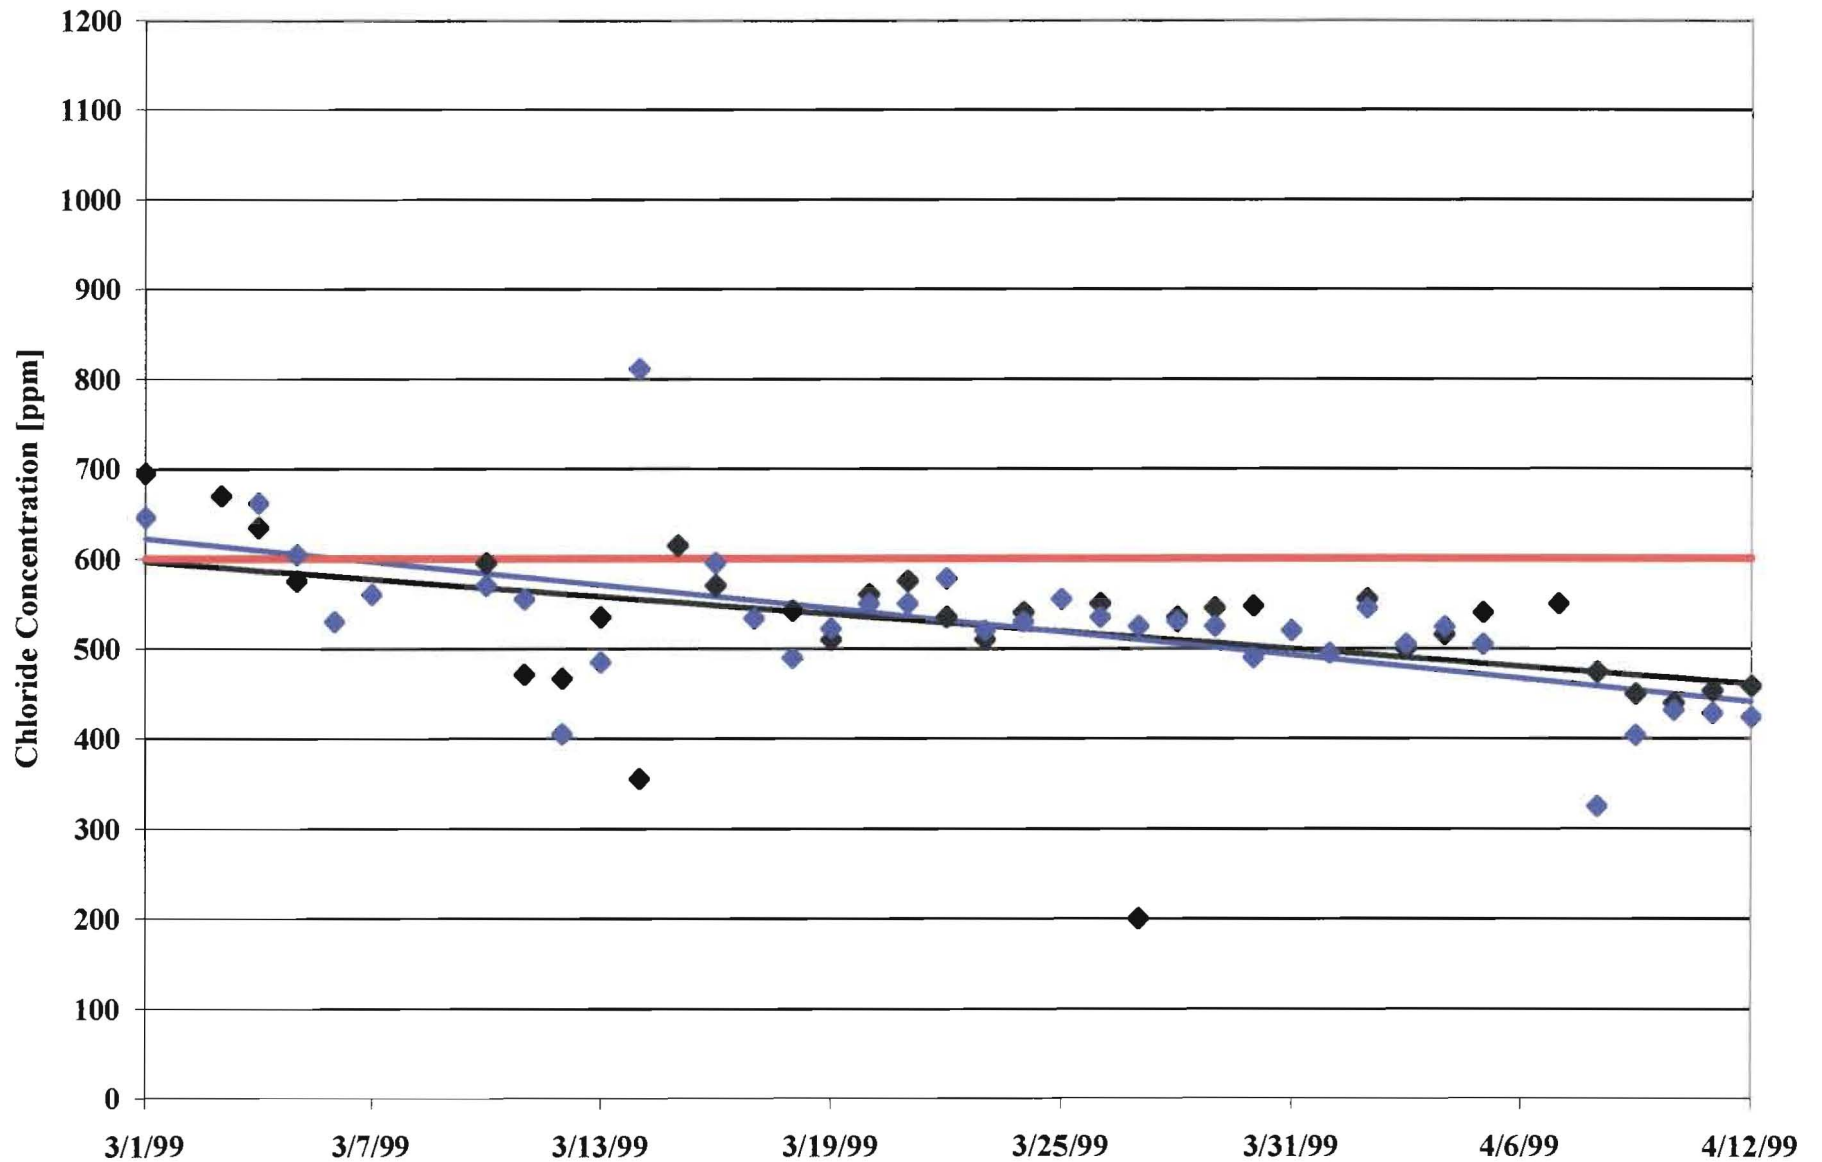


Figure 4. Effluent chloride concentrations from grab samples taken at 8 AM and 8 PM.