



March 31, 2000

Blanca S. Bayo, Director  
Florida Public Service Commission  
Division of Records & Reporting  
2540 Shumard Oak Boulevard  
Tallahassee, Florida 32399-0850

#000000-

Dear Ms. Bayo:

In accordance with Section 186.801, Florida Statutes and Rule 25-22.071, Florida Administrative Code, Gainesville Regional Utilities' hereby submits 25 copies of its 2000 Ten Year Site Plan for your review. Should you have any questions regarding this Ten Year Site Plan, please contact me at (352) 334-3400 x1272 or:

Roger Westphal (Generation Planning) 352.334.3400x1289  
Todd Kamhoot (Forecasting) 352.334.3400x1280

Sincerely,

Ed Regan  
Strategic Planning Director

Enclosures

- \_\_\_ DFA
- \_\_\_ APP
- \_\_\_ CAF
- \_\_\_ CMU
- \_\_\_ STR
- \_\_\_ EAG
- \_\_\_ LEG
- \_\_\_ MAS
- \_\_\_ OPC
- \_\_\_ RRR
- \_\_\_ SEC
- \_\_\_ WAW
- \_\_\_ OTH

File: PSC - Ten Year Site Plan

I:\u0070\98\typs.psc\cover letter.doc

DOCUMENT NUMBER - DATE

04044 APR-38

PSC - RECORDS / REPORTING

**GAINESVILLE REGIONAL UTILITIES**

**2000 TEN-YEAR SITE PLAN**



**Submitted to:**

**The Florida Public Service Commission**

**April 1, 2000**

---

## TABLE OF CONTENTS

	<u>Page</u>
1. INTRODUCTION .....	1
2. DESCRIPTION OF EXISTING FACILITIES .....	2
2.1 GENERATION .....	2
2.1.1 Generating Units .....	2
2.1.1.1 Steam Turbines .....	2
2.1.1.2 Gas Turbines .....	3
2.1.1.3 Environmental Considerations .....	3
2.1.2 Generating Plant Sites .....	3
2.1.2.1 John R. Kelly Plant .....	3
2.1.2.2 Deerhaven Plant .....	5
2.2 TRANSMISSION .....	5
2.2.1 The Transmission Network .....	5
2.2.2 Transmission Lines .....	5
2.2.3 State Interconnections .....	7
2.3 DISTRIBUTION .....	7
2.4 WHOLESALE ENERGY .....	8
2.5 EXPORT COMMITMENTS .....	9
3. FORECAST OF ELECTRIC ENERGY & DEMAND REQUIREMENTS .....	13
3.1 FORECAST ASSUMPTIONS AND DATA SOURCES .....	13
3.2 DOCUMENTATION OF CUSTOMER, ENERGY, AND SEASONAL PEAK DEMAND FORECASTS .....	15
3.2.1 Residential Sector .....	15
3.2.2 General Service Non-Demand Sector .....	17
3.2.3 General Service Demand Sector .....	18
3.2.4 Large Power Sector .....	19
3.2.5 Outdoor Lighting Sector .....	20
3.2.6 Wholesale Energy Sales .....	21
3.2.7 Total System Sales, Net Energy for Load, Seasonal Peak Demands, and DSM Impacts .....	22
3.2.8 Low Band and High Band Forecast Scenarios .....	23
3.3 DOCUMENTATION OF ENERGY SOURCES AND FUEL REQUIREMENTS .....	24
3.3.1 Fuels Used by System .....	24
3.3.2 Methodology .....	25

3.4	DEMAND-SIDE MANAGEMENT PLAN .....	26
3.4.1	Demand-Side Management Plan .....	26
3.4.2	Gainesville Energy Advisory Committee .....	28
3.4.3	Supply Side Programs .....	29
3.5	FUEL PRICE FORECAST ASSUMPTIONS.....	29
3.5.1	Oil .....	30
3.5.2	Coal .....	30
3.5.3	Natural Gas .....	32
3.5.4	Nuclear .....	32
<b>4.</b>	<b>FORECAST OF FACILITIES REQUIREMENTS.....</b>	<b>49</b>
4.1	GENERATION RETIREMENTS AND ADDITIONS .....	49
4.1.1	Least-Cost Planning Selection .....	49
4.1.2	Green Pricing .....	50
4.2	RESERVE MARGIN AND SCHEDULED MAINTENANCE .....	51
4.3	DISTRIBUTION SYSTEM ADDITIONS.....	51
<b>5.</b>	<b>ENVIRONMENTAL AND LAND USE INFORMATION.....</b>	<b>58</b>
5.1	DESCRIPTION OF POTENTIAL SITES FOR NEW GENERATING FACILITIES .....	58
5.2	DESCRIPTION OF PREFERRED SITES FOR NEW GENERATING FACILITIES .....	58
5.3	STATUS OF APPLICATION FOR SITE CERTIFICATION.....	60

## 1. INTRODUCTION

The 2000 Ten-Year Site Plan for Gainesville Regional Utilities (GRU) is submitted to the Florida Public Service Commission pursuant to Section 186.801, Florida Statutes. The contents of this report conform to information requirements listed in Form PSC/EAG 43, as specified by Rule 25-22.072, Florida Administrative Code. The five sections of the 2000 Ten-Year Site Plan are:

Introduction

Description of Existing Facilities

Forecast of Electric Energy and Demand Requirements

Forecast of Facilities Requirements

Environmental and Land Use Information

Gainesville Regional Utilities is a municipal electric, natural gas, water, wastewater, and telecommunications utility system. The GRU retail electric system service area includes the City of Gainesville and the surrounding urban area. The highest net integrated peak demand recorded to date on GRU's electrical system was 419 megawatts on August 2, 1999. Net summer capability is 550 megawatts. In consideration of the load forecast, reserve margin requirements, and system reliability, GRU's Electric System will require additional generating capacity before 2009. An extensive three-year integrated resource planning study has revealed that repowering J. R. Kelly Unit 8 as a nominal 110 megawatt combined-cycle unit is the best and most robust choice when subjected to an exhaustive array of scenarios. Benefits of this choice include the opportunity to improve operating efficiency; reduce emission rates; reduce total emissions; and better participate in the redevelopment of downtown Gainesville, while increasing the electric system's capacity at a time when the reserve margin for Peninsular Florida is getting tight. The Gainesville City Commission has approved moving the installation target date to 2001.

## 2. DESCRIPTION OF EXISTING FACILITIES

The City of Gainesville owns a fully integrated electric power production, transmission, and distribution system (herein referred to as "the System"). GRU is the City of Gainesville enterprise arm that has the responsibility to operate and maintain the System. In addition to retail electric service, GRU also provides wholesale electric service to the City of Alachua (Alachua) and to Clay Electric Cooperative, Inc. (Clay). GRU's distribution system serves approximately 130 square miles and 76,597 customers (December, 1999). The general locations of GRU electric facilities and the electric system service area are shown in Figure 2.1.

### 2.1 GENERATION

The existing generating facilities operated by GRU are tabulated in Schedule 1, found at the end of this chapter. Two types of generating units are located at the System's two generating plant sites: steam turbines and gas turbines.

The present summer net capability is 550 MW and the winter net capability is 563 MW<sup>1</sup>. Currently, the System's energy is produced by four fossil fuel steam turbines, six combustion turbines, and a 1.4% ownership share of the Crystal River 3 nuclear unit, which is operated by Florida Power Corporation (FPC).

#### 2.1.1 Generating Units

**2.1.1.1 Steam Turbines.** The System's four operational steam turbines are powered by fossil fuels and Crystal River 3 is nuclear powered. John R. Kelly (Kelly) 6, a fossil steam turbine, was placed in cold standby in August, 1989 and is no longer considered operational for planning purposes. The fossil fueled steam turbines

---

<sup>1</sup> Net capability is that specified by the "SERC Guideline Number Two for Uniform Generator Ratings for Reporting." The winter rating will normally exceed the summer rating because generating plant efficiencies are increased by lower ambient air temperatures and lower cooling water temperatures.

comprise 70.1% of the System's net summer capability and produced 88.8% of the electric energy supplied by the System in 1999. These units range in size from 23.2 MW to 228.4 MW. The System's 11.0 MW share of Crystal River 3 nuclear unit comprises 2.0% of the System's net summer capability.

Both Deerhaven 2 and Crystal River 3 are used for base load purposes, while Kelly 7 and 8 and Deerhaven 1 are used for intermediate loading.


**2.1.1.2 Gas Turbines.** The System's six industrial gas turbines make up 27.8% of the System's summer generating capability. These units are utilized for peaking purposes only because their energy conversion efficiencies are considerably lower than steam units. As a result, they yield higher operating costs and are consequently unsuitable for base load operation. Gas turbines are advantageous in that they can be started and placed on line in thirty minutes or less. The System's gas turbines are most economically used as peaking units during high demand periods when base and intermediate units cannot serve all of the System loads.

**2.1.1.3 Environmental Considerations.** All of the System's steam turbines, except for Crystal River 3, utilize recirculating cooling towers with a mechanical draft for the cooling of condensed steam. Crystal River 3 uses a once-through cooling system aided by helper towers. Only Deerhaven 2 has flue gas cleaning equipment.

## **2.1.2 Generating Plant Sites**

The locations of the two generating plants owned by the City of Gainesville are shown on Figure 2.1.

**2.1.2.1 John R. Kelly Plant.** The Kelly Station is located in southeast Gainesville near the downtown business district and consists of three steam turbines (including Kelly 6, which is in cold standby), three gas turbines, and the associated cooling facilities, fuel storage, pumping equipment, transmission and distribution equipment.

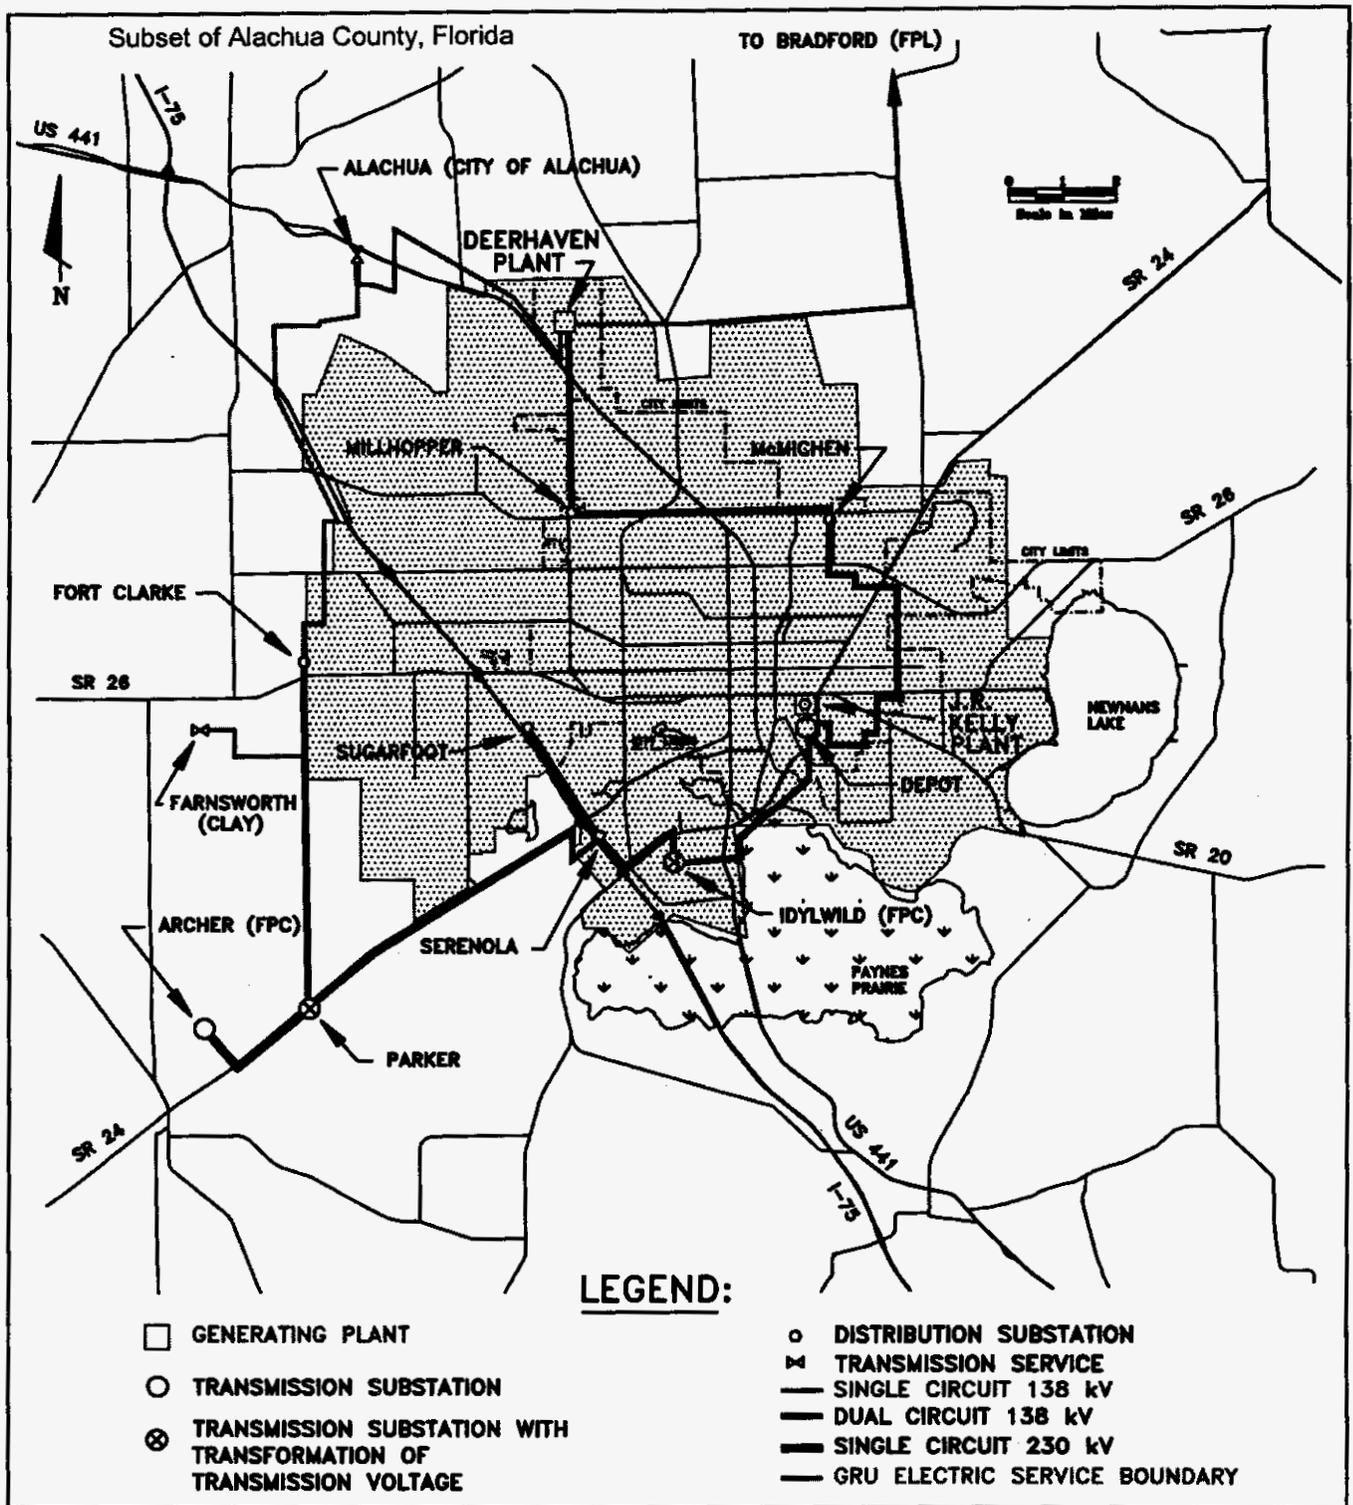

**FIGURE 2.1 Gainesville Regional Electric Facilities**

**2.1.2.2 Deerhaven Plant.** The Deerhaven Station is located six miles northwest of Gainesville. The site is a 1,116 acre parcel of partially forested land. The facility consists of two steam turbines, three gas turbines, and the associated cooling facilities, fuel storage, pumping equipment and transmission equipment. With the addition of Deerhaven 2 in 1981, the site now includes coal unloading and storage facilities and a zero discharge water treatment plant, which treats water effluent from both steam units.

## **2.2 TRANSMISSION**

### **2.2.1 The Transmission Network**

GRU's bulk power transmission network consists of a 138 kV loop connecting the following:

- 1) GRU's two generating stations,
- 2) GRU's six distribution substations,
- 3) Three interties with Florida Power Corporation,
- 4) An intertie with Florida Power and Light Company,
- 5) An interconnection with Clay at Farnsworth Substation, and
- 6) An interconnection with the City of Alachua at Alachua No. 1 Substation

Refer to Figure 2.1 for line geographical locations and Figure 2.2 for electrical connectivity and line numbers.

### **2.2.2 Transmission Lines**

The ratings for all of GRU's transmission lines are given in Table 2.1. The load ratings for GRU's transmission lines were developed in Appendix 6.1 of GRU's Long-Range Transmission Planning Study, March 1991. Refer to Figure 2.2 for a one-line diagram of GRU's electric system. The criteria for normal and emergency loading are taken to be:

Normal loading: conductor temperature not to exceed 100° C (212° F).

Emergency loading: conductor temperature not to exceed 125° C (257° F).

The present transmission network consists of the following:

<u>Line</u>	<u>Circuit Miles</u>	<u>Conductor</u>
138 KV double circuit	80.87	795 MCM ACSR
138 KV single circuit	16.47	1192 MCM ACSR
138 KV single circuit	20.60	795 MCM ACSR
230 KV single circuit	<u>2.51</u>	795 MCM ACSR
Total	120.45	

As part of the Long-Range Transmission Planning Study, March 1991, the transmission system was subjected to scenario analysis. Each scenario represents a system configuration with different contingencies modeled. A contingency is an occurrence that depends on chance or uncertain conditions and, as used here, represents various equipment failures that may occur. The following conclusions were drawn from this analysis:

Reliability contingencies:

- (a) Single contingency transmission line and generator outages (the failure of any one generator or any one transmission line) -- No identifiable problems.
- (b) All right-of-way outages (two lines - common pole) -- No problems if a 20 MVAR capacitor bank is installed at Sugarfoot Substation. GRU's 138 kV/24 MVAR capacitor installation at Sugarfoot Substation was completed July, 1993.

- (c) Meeting future load and interchange requirements -- No identifiable problems.

### **2.2.3 State Interconnections**


The System is currently interconnected with FPC and Florida Power and Light (FPL) at a total of four separate points. The System interconnects with FPC's Archer Substation via a 230 kV transmission line to the System's Parker Substation with 224 MVA of transformation capacity from 230 kV to 138 kV. The System also interconnects with FPC's Idylwild Substation with two separate circuits via a 168 MVA 138/69 kV transformer at the Idylwild Substation. The System interconnects with FPL via a 138 kV tie between FPL's Bradford Substation and the System's Deerhaven Substation. This interconnection has a thermal capacity of 222 MVA.

## **2.3 DISTRIBUTION**

The System has six major distribution substations connected to the transmission network: Millhopper, McMichen, Serenola, Sugarfoot, Ft. Clarke, and Kelly Substations. The locations of these substations are shown on Figure 2.1.

GRU's current distribution substations are all connected to the 138 kV bulk power transmission network with dual feeds. This prevents the outage of a single transmission line from causing the outage of a distribution station. GRU serves its retail customers through a 12.47 kV distribution network. The distribution substations, their present rated transformer capabilities and present number of circuits are listed in Table 2.2.

The last substation added by GRU, Sugarfoot, was brought on-line in 1986 to serve the growing load in the area of State Road 26 and Interstate Highway I-75. McMichen, Serenola, Ft. Clarke, and Kelly Substations currently consist of two transformers of equal size allowing these stations to be loaded under normal conditions

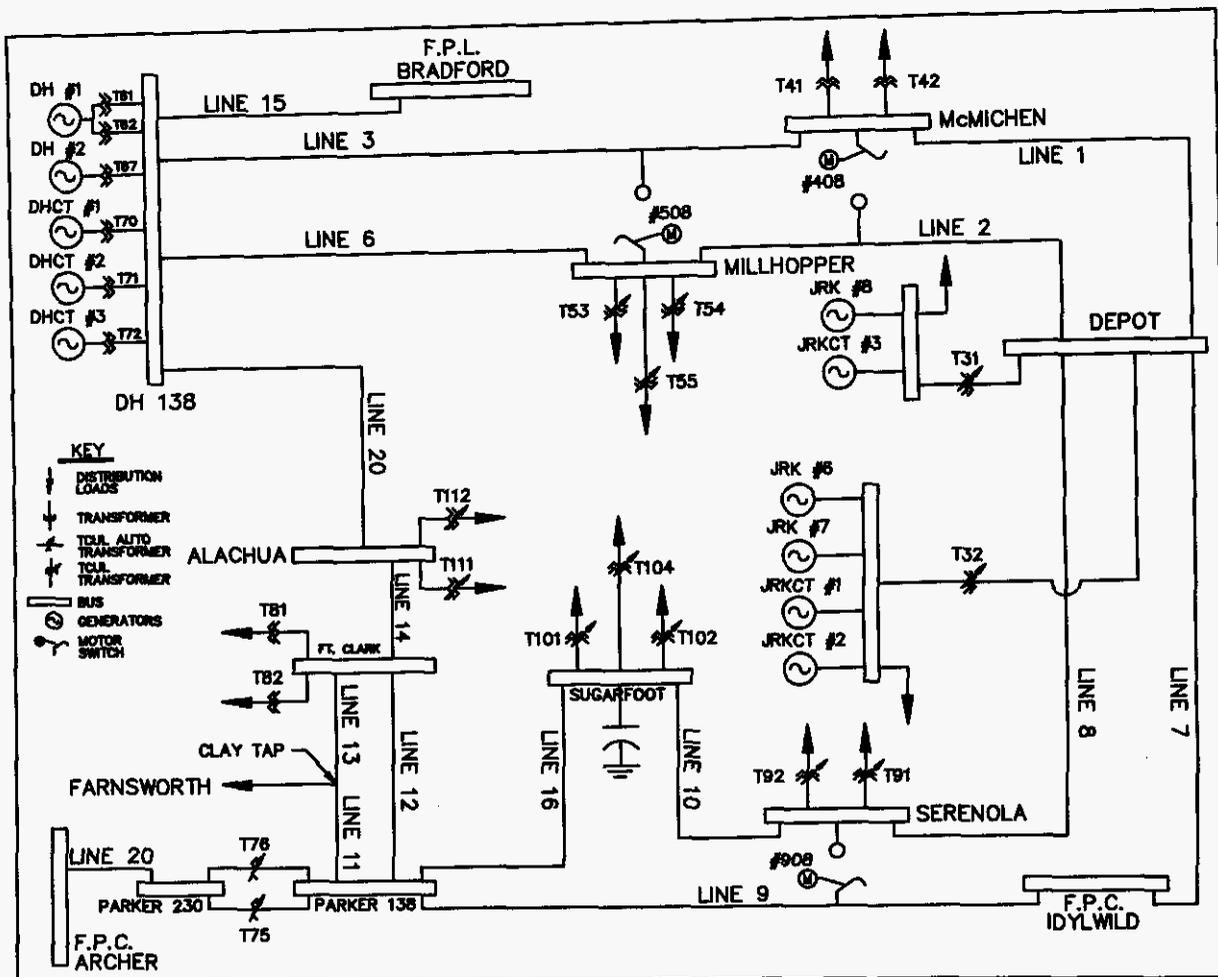

**FIGURE 2.2 Gainesville Regional Utilities Electric System One-Line Diagram.**

to 80 percent of the capabilities shown in Table 2.2. Millhopper and Sugarfoot Substations currently consist of three transformers of equal size allowing both of these substations to be loaded under normal conditions to 100 percent of the capability shown in Table 2.2.

## 2.4 WHOLESALE ENERGY

The System provides wholesale electric service to Clay Electric Cooperative (Clay) through a contract between GRU and Seminole Electric Cooperative (Seminole), of which Clay is a member. The System began the 138 kV service at Clay's Farnsworth

Substation in February 1975. This substation is supplied through a 2.4 mile radial line connected to the System's transmission facilities.

The System also provides wholesale electric service to the City of Alachua at two points of service. The Alachua No. 1 Substation is supplied with GRU's looped 138 kV transmission system. Approximately 400 residences and a few commercial customers within Alachua's city limits are served by a 12.47 kV distribution circuit, known as the Hague point of service. The System provides approximately 89% of Alachua's energy requirements with the remainder being supplied by Alachua's generation entitlements from the Crystal River 3 and St. Lucie 2 nuclear units. Energy supplied to Alachua by these nuclear units is wheeled over GRU's transmission network, with GRU providing generation backup in the event of outages of these nuclear units.

## **2.5 EXPORT COMMITMENTS**

GRU has a Schedule D firm interchange service commitment with the City of Starke (Starke). The agreement with Starke is non-unit specific and provides for the sale of System capacity (includes reserves). This agreement was renewed January 1, 1994 and continues through 2003, with optional three year extensions available indefinitely and allows Starke the option to expand the capacity commitment. This agreement was assigned to the FMPA in 1998 when Starke became an "All Requirements" member of FMPA.

GRU has a Schedule D firm interchange service commitment with the Florida Municipal Power Agency (FMPA). The agreement with FMPA is unit specific with Deerhaven Unit #2 (DH2) and provides capacity through 2002.

GRU has a Service Schedule J - Negotiated Interchange Service with Seminole Electric Cooperative, Inc. to provide firm electric capacity and energy from its generation and purchased power resources between December of 1999 and February

of 2000.

GRU has a negotiated Transaction with The Energy Authority, Inc. to provide electric capacity and associated energy to JEA from its generation and purchased power resources from December of 1999 through February of 2000 and from May 15, 2000 through September 15, 2000.

These sale schedules are contemplated herein and are consistent with GRU's needs for generating capacity and associated reserve margins. Schedules 7.1 and 7.2 at the end of Section 4 summarize GRU's reserve margins.

**TABLE 2.1**  
**SUMMER POWER FLOW LIMITS**

<u>Line Number</u>	<u>Description</u>	<u>Normal (MVA)</u>	<u>Limiting Device</u>	<u>Emergency (MVA)</u>	<u>Limiting Device</u>
1	McMichen - Depot East	245.7	Conductor	288.3	Conductor
2	Millhopper - Depot West	245.7	Conductor	288.3	Conductor
3	Deerhaven - McMichen	245.7	Conductor	288.3	Conductor
6	Deerhaven - Millhopper	245.7	Conductor	288.3	Conductor
7	Depot East - Idylwild	205.6	Line Trap	205.6	Line Trap
8	Depot West - Serenola	245.7	Conductor	288.3	Conductor
9	Idylwild - Parker	205.6	Line Trap	205.6	Line Trap
10	Serenola - Sugarfoot	245.7	Conductor	288.3	Conductor
11	Parker - Clay Tap	245.7	Conductor	288.3	Conductor
12	Parker - Ft. Clarke	245.7	Conductor	288.3	Conductor
13	Clay Tap - Ft. Clarke	245.7	Conductor	288.3	Conductor
14	Ft. Clarke - Alachua	313.0	Conductor	369.1	Conductor
15	Deerhaven - Bradford	222.0	Transformer	222.0	Transformer
16	Sugarfoot - Parker	245.7	Conductor	288.3	Conductor
20	Parker - Archer	179.2	Transformer	224.0	Transformer
22	Alachua - Deerhaven	313.0	Conductor	369.1	Conductor
xx	Clay Tap - Farnsworth	245.7	Conductor	288.3	Conductor
xx	Idylwild - FPC	168.0	Transformer	168.0	Transformer

TABLE 2.2

CURRENT SUBSTATION TRANSFORMATION AND CIRCUITS

---

<u>STATION</u>	<u>TRANSFORMER RATED CAPABILITY</u>	<u>NUMBER OF CIRCUITS</u>
Millhopper	100.8 MVA	8
McMichen	44.8 MVA	6
J. R. Kelly <sup>2</sup>	112.0 MVA	18
Serenola	67.2 MVA	8
Sugarfoot	100.8 MVA	7
Ft. Clarke	44.8 MVA	4

---

---

<sup>2</sup> J. R. Kelly is a Generating Station (115 MW) as well as a distribution Substation.

Schedule 1

EXISTING GENERATING FACILITIES  
(As of December 31, 1999)

(1) Plant Name	(2) Unit No.	(3) Location	(4) Unit Type	(5) Fuel		(6) Fuel Transport		(9) Alt. Fuel Days Use	(10) Commercial In-Service Month/Year	(11) Expected Retirement Month/Year	(12) Gen. Max. Nameplate kW	(13) Net Capability		(14) Status Notes
				Pri.	Alt.	Pri.	Alt.					Summer MW	Winter MW	
J. R. Kelly		12-001 (Alachua Co., Section 4, Township 10 S, Range 20E) (GRU)										115	118	
	8		ST	NG	FO6	PL	TK	8	4/65	Unknown	50,000	50	50	
	7		ST	NG	FO6	PL	TK	0	8/61	Unknown	25,000	23	23	
	6		ST	NG	FO6	PL	TK	0	3/58	Unknown	18,750	15	15	M (1)
	3		GT	NG	FO2	PL	TK	0	5/69	Unknown	16,320	14	15	
	2		GT	NG	FO2	PL	TK	0	9/68	Unknown	16,320	14	15	
	1		GT	NG	FO2	PL	TK	0	2/68	Unknown	16,320	14	15	
Deerhaven		12-001 (Alachua Co., Sections 26,27,35, Township 8 S, Range 19 E) (GRU)										424	434	
	2		ST	BIT		RR			10/81	Unknown	250,750	228	228	
	1		ST	NG	FO6	PL	TK	11	8/72	Unknown	75,000	85	85	
	3		GT	NG	FO2	PL	TK	1	1/96	Unknown	96,135	75	81	
	2		GT	NG	FO2	PL	TK	0	8/76	Unknown	24,600	18	20	
	1		GT	NG	FO2	PL	TK	0	7/76	Unknown	24,600	18	20	
Crystal River (818/815)	3	12-017 (Citrus Co., Section 33, Township 17 S, Range 16 E) (FPC)	NP	UR			TK		3/77	Unknown		11	11	
System Total												550	563	

Unit Type  
GT = Gas Turbine  
NP = Nuclear Power  
ST = Steam

Fuel Type  
NG = Natural Gas  
BIT = Bituminous Coal  
UR = Uranium  
FO6 = Fuel Oil #6 (Residual)  
FO2 = Fuel Oil #2 (Distillate)

Transportation Method  
PL = Pipe Line  
RR = Railroad  
TK = Truck

Status  
M = Cold standby,  
extended cold shutdown  
or long-term reserve  
shutdown.

Notes: (1) JRK Unit 6 was placed in cold standby in August, 1989.

### 3. FORECAST OF ELECTRIC ENERGY AND DEMAND REQUIREMENTS

Section 3 includes documentation of GRU's forecast of number of customers, energy sales and seasonal peak demands, as well as a forecast of energy sources and fuel requirements and an overview of GRU's involvement in demand-side management programs.

The accompanying tables provide historical and forecast information for calendar years 1990-2009. Energy sales and number of customers are tabulated in Schedules 2.1, 2.2 and 2.3. Schedules 3.1, 3.1H and 3.1L give components of summer peak demand for the base case, high band forecast and low band forecast. Schedules 3.2, 3.2H and 3.2L present the components of winter peak demand for each forecast scenario. Schedules 3.3, 3.3H and 3.3L similarly present components of net energy for load. Short-term monthly load data is presented in Schedule 4. Projected net energy requirements for the System, by method of generation, are shown in Schedule 6.1. The percentage breakdowns of energy shown in Schedule 6.1 are given in Schedule 6.2. The quantities of fuel expected to be used to generate the energy requirements shown in Schedule 6.1 are given by fuel type in Schedule 5.

#### 3.1 FORECAST ASSUMPTIONS AND DATA SOURCES

- (1) All regression analyses were based on annual data. Historical data were assimilated for calendar years 1970 through 1998. System data, such as net energy for load, seasonal peak demands, customer counts and energy sales, were obtained from GRU records and sources.
- (2) Estimates and projections of Alachua County population were obtained from the Florida Population Studies, February, 1999 (Bulletin No. 123), published by the Bureau of Economic and Business Research (BEBR) at the University of Florida.
- (3) Normal weather conditions were assumed. Normal heating degree days and cooling degree days are projected to equal the median value of the available data for the Gainesville Municipal Airport weather station (1984-1998).

- (4) All income and price figures were adjusted for inflation, and indexed to a base year of 1986, using a price index developed to represent inflationary trends in Alachua County. This "Alachua County Price Index" is developed by comparing changes in the Consumer Price Index (U.S. Bureau of Labor Statistics) and the Florida Price Level Index (Florida Department of Education). Inflation is assumed to be 3% per year for each year of the forecast.
- (5) The U. S. Department of Commerce provided historical estimates of total income and per capita income for Alachua County. The BEBR projected income levels for Alachua County in The Florida Long Term Economic Forecast 1998.
- (6) The Florida Long Term Economic Forecast 1998 and Florida Population Studies, Bulletin 122, were used to estimate and project the number of persons per household (household size) in Alachua County.
- (7) The Florida Long Term Economic Forecast 1998 was the source for historical estimates and projections of non-agricultural employment in Alachua County.
- (8) GRU's corporate model was the basis for projections of the average price of 1,000 kWh of electricity for all customer classes. GRU's corporate model evaluates projected revenue and revenue requirements for the forecast horizon and determines revenue sufficiency under prevailing prices. If revenue from present pricing is insufficient, pricing changes are programmed in and become GRU's official pricing program plan. Programmed price increases from the model for all retail customer classes are projected to be less than the rate of inflation, yielding declining real prices of electricity over the forecast horizon.
- (9) Estimates of energy and demand reductions resulting from demand-side management programs were incorporated into all retail forecasts. Programs outlined in both GRU's 1990 Energy Conservation Plan and GRU's 1996 Demand-Side Management Plan, both submitted to the FPSC, are incorporated in this forecast. GRU's demand-side management programs are described in more detail later in this section.
- (10) The City of Alachua will generate (via generation entitlement shares of Florida Power Corporation and Florida Power and Light nuclear units) approximately 8,077 MWh of its annual energy requirements.

## 3.2 DOCUMENTATION OF CUSTOMER, ENERGY AND SEASONAL PEAK DEMAND FORECASTS

Number of customers, energy sales and seasonal peak demands were forecast from 2000 through 2009. Separate energy sales forecasts were developed for each of the following customer classes: residential, general service non-demand, general service demand, large power, outdoor lighting, sales to Clay, and sales to Alachua. Separate forecasts of number of customers were developed for residential, general service non-demand, general service demand and large power retail rate classifications. The basis for these independent forecasts originated with the development of least-squares regression models. All modeling was performed in-house using the Statistical Analysis System (SAS)<sup>3</sup>. The following text describes the regression equations utilized to forecast energy sales and number of customers.

### 3.2.1 Residential Sector

The equation of the model developed to project residential average annual energy use (kilowatt-hours per year) specifies average use as a function of household income in Alachua County, residential price of electricity and weather variation, measured by heating degree days and cooling degree days. The form of this equation is as follows:

$$\begin{aligned} \text{RESAVUSE} = & 4468.1 + 0.12 (\text{HHY86}) - 17.65 (\text{RESPR86}) \\ & + 0.71 (\text{HDD}) + 0.92 (\text{CDD}) \end{aligned}$$

Where:

RESAVUSE	=	Average Annual Residential Energy Use
HHY86	=	Average Household Income
RESPR86	=	Residential Price, Dollars per 1000 kWh
HDD	=	Annual Heating Degree Days
CDD	=	Annual Cooling Degree Days

---

<sup>3</sup> SAS is the registered trademark of SAS Institute, Inc., Cary, NC.

Adjusted R<sup>2</sup> = 0.8869  
 DF (error) = 23  
 t - statistics:  
 Intercept = 3.70  
 HHY86 = 7.24  
 RESPR86 = -2.82  
 HDD = 4.06  
 CDD = 4.75

Projections of the average annual number of residential customers were developed from a linear regression model stating the number of customers as a function of Alachua County population. The residential customer model specifications are:

$$RESCUS = -27847 + 435.4 (POP)$$

Where:

RESCUS = Number of Residential Customers  
 POP = Alachua County Population (thousands)

Adjusted R<sup>2</sup> = 0.9946  
 DF (error) = 19  
 t - statistics:  
 Intercept = -21.87  
 POP = 60.75

The product of forecasted values of average use and number of customers yielded the projected energy sales for the residential sector.

### 3.2.2 General Service Non-Demand Sector

The general service non-demand customer class includes non-residential customers with maximum annual demands generally less than 50 kilowatts (kW). Average annual energy use per general service non-demand customer has exhibited neither an increasing nor decreasing trend over the past 20 years. From 1979 through 1998, average annual consumption ranged from a low of 26,049 kWh in 1997 to a high of 28,968 kWh in 1990. Some, but not a sufficient amount, of the variation in historical use was fit using regression models. Therefore, average use was projected to remain constant at 27,563 kWh (the median of the historical series) per customer per year.

The number of general service non-demand customers was projected using an equation specifying customers as a function of population in Alachua County. The specifications of the general service non-demand customer model are as follows:

$$GNDCUS = -5210.9 + 59.44 (POP)$$

Where:

GNDCUS = Number of General Service Non-Demand Customers

POP = Alachua County Population (thousands)

Adjusted R<sup>2</sup> = 0.9814

DF (error) = 19

t - statistics:

Intercept = -16.04

POP = 32.51

Forecasted energy sales to general service non-demand customers were derived from the product of projected number of customers and the projected average annual use per customer.

### 3.2.3 General Service Demand Sector

The general service demand customer class includes non-residential customers with established annual maximum demands generally of at least 50 kW but less than 1,000 kW. Average annual energy use per customer was projected using an equation specifying average use as a function of per capita income for residents of Alachua County. A significant portion of the energy load in this sector is from large retailers such as department stores and grocery stores, whose business activity is related to income levels of area residents. Average energy use projections for general service demand customers result from the following model:

$$DEMAVUSE = 367.53 + 0.0124 (PCY86)$$

Where:

DEMAVUSE = Average Annual Energy Use for General Service Demand Customers (MWh per Year)

PCY86 = Per Capita Income in Alachua County

Adjusted  $R^2$  = 0.7604

DF (error) = 18

t - statistics:

Intercept = 17.60

PCY86 = 7.83

The annual average number of customers was projected based on the results of a regression model in which Alachua County population was the independent variable. The specifications of the general service demand customer model are as follows:

$$DEMCUS = -478.90 + 5.65 (POP)$$

Where:

DEMCUS = Number of General Service Demand Customers

POP = Alachua County Population (thousands)

Adjusted R<sup>2</sup> = 0.9628  
 DF (error) = 19  
 t - statistics:  
 Intercept = -10.86  
 POP = 22.77

The forecast of energy sales to general service demand customers was the resultant product of projected number of customers and projected average annual use per customer.

### 3.2.4 Large Power Sector

The large power customer class includes 17 customers with billing demands of at least 1,000 kW. Analyses of average annual energy use were based on historical observations from 1976 through 1998. The model developed to project average use by large power customers includes Alachua County nonagricultural employment and large power price of electricity as independent variables. Energy use, per customer, is expected to increase due to the periodic expansion of existing facilities. This growth is measured in the model by local employment levels. Anticipated load growth in this customer class was also explicitly added to include the addition of one new facility. The specifications of the large power average use model are as follows:

$$LPAVUSE = 10296 + 19.60 (NONAG) - 59.24 (LPPR86)$$

Where:

LPAVUSE = Average Annual Energy Consumption (MWh per Year)  
 NONAG = Alachua County Nonagricultural Employment (000's)  
 LPPR86 = Average Price for 1,000 kWh in the Large Power Sector

Adjusted R<sup>2</sup> = 0.8845  
 DF (error) = 20

t - statistics:

INTERCEPT = 5.85  
NONAG = 2.04  
LPPR86 = -3.17

The forecast of energy sales to the large power sector was derived from the product of projected average use per customer and the projected number of large power customers.

### 3.2.5 Outdoor Lighting Sector

The outdoor lighting sector consists of streetlight, traffic light, and rental light accounts. Outdoor lighting energy sales account for less than 1.5% of total energy sales. Outdoor lighting energy sales were forecast using a model which specified lighting energy as a function of the number of residential customers. The specifications of this model are as follows:

$$LGTMWH = -7551.7 + 0.42 (RESCUS)$$

Where:

LGTMWH = Outdoor Lighting Energy Sales  
RESCUS = Number of Residential Customers

$$\text{Adjusted } R^2 = 0.9125$$

$$\text{DF (error)} = 7$$

t - statistics:

Intercept = -2.70  
RESCUS = 9.19

### 3.2.6 Wholesale Energy Sales

The System presently serves two wholesale customers: Clay Electric Cooperative, Inc. (Clay) at the Farnsworth Substation and, the City of Alachua (Alachua) at the Alachua No. 1 Substation and at the Hague Point of Service. Approximately 11% of Alachua's 1999 energy requirements were met through generation entitlements of nuclear generating units operated by Florida Power Corporation and Florida Power and Light. Each wholesale delivery point serves an urban area that is either included in, or adjacent to the Gainesville Urban Area.

Sales to Clay were modeled with an equation in which total county income was the independent variable. The form of this equation is as follows:

$$CLYMWH = -33084 + 31.75 (COY86)$$

Where:

CLYMWH = Megawatt-Hour Sales to Clay

COY86 = Total Personal Income (Alachua County)

Adjusted R<sup>2</sup> = 0.9460

DF (error) = 15

t - statistics:

Intercept = -6.88

COY86 = 16.78

Net energy requirements for Alachua were estimated using a model in which City of Alachua total income and cooling degree days were the independent variables. City of Alachua total income is the product of City of Alachua population and Alachua County per capita income. Population projections were developed by modeling City of Alachua population as a function of Alachua County population. The model used to develop projections of sales to the City of Alachua is of the following form:

$$ALANEL = -30650 + 0.91 (ALAY86) + 6.11 (CDD)$$

Where:

ALANEL = Net Energy Requirements of Alachua

ALAY86 = City of Alachua Total Income

CDD = Cooling Degree Days

Adjusted R<sup>2</sup> = 0.9767

DF (error) = 14

t - statistics:

Intercept = -4.47

ALAPOP = 25.75

CDD = 2.59

To obtain a final forecast of the System's sales to Alachua, projected net energy requirements were reduced by 8,077 MWh reflecting the City of Alachua's nuclear generation entitlements.

### **3.2.7 Total System Sales, Net Energy for Load, Seasonal Peak Demands and DSM Impacts**

The forecast of total system energy sales was derived by summing energy sales projections for each customer class; residential, general service non-demand, general service demand, large power, outdoor lighting, sales to Clay, and sales to Alachua. Net energy for load was then forecast by applying a "delivered efficiency" factor for the System to total energy sales. The projected "delivered efficiency" factor (0.9507) was the median of total energy sales divided by net energy for load from 1984 through 1998.

The forecasts of seasonal peak demands were derived from forecasts of annual net energy for load and assumed that the winter peak will occur in January of each year and the summer peak will occur in August of each year. The average ratio of the most recent 17 years' monthly net energy for load for January and August, as a portion of annual net energy for load, was applied to projected annual net energy for load to

obtain estimates of January and August net energy for load over the forecast horizon. The medians of the past 17 years' load factors for January and August were applied to January and August net energy for load projections, yielding seasonal peak demand projections. Load data has converged over time to a point that winter peak demands are forecast to be equal for January and February. Likewise, the data indicates that summer peak demands are likely to be equal in July and August. Adjustments to seasonal peak demands were included explicitly to account for impacts from demand-side management programs.

Transmission and distribution line loss improvement programs undertaken by GRU have resulted in relatively stable losses ranging from 4% to 6% of net generation. Post 1981 load factors and energy allocation factors are believed to reflect the most recent trends in appliance efficiencies, appliance penetrations, response to electricity prices and response to customer and utility induced conservation efforts.

### **3.2.8 Low Band and High Band Forecast Scenarios**

Much of the error in long-term forecasts results from variation in expected customer growth, while a primary determinant of short-term forecast error is weather variation. GRU bands its forecasts with a long-term perspective for resource planning purposes by allowing assumptions underlying customer growth to vary. Projections of one independent variable in each customer class were allowed to vary from the base case assumptions in order to develop the banded forecasts. The fundamental variable used to develop alternative forecast scenarios was the series of population projections for Alachua County. Low band and high band forecast scenarios were derived from the same equations used to develop the base case forecasts. Low band and high band population scenarios were set to approximately equal the midpoints of the BEBR low-to-medium and medium-to-high population projections, respectively.

In the residential, general service non-demand, and general service demand revenue sectors, banded energy sales forecasts resulted from banded customer

forecasts, which were developed from banded county population projections. Forecasts of average annual energy use per customer were not modified. In the large power sector, non-agricultural employment was the primary explanatory variable used to forecast use per customer. Employment projections were originally derived from population projections. Banded employment projections were input into the original equation yielding alternative energy sales scenarios for this class. Sales to Clay were modeled as a function of total county income. Total county income was projected as the product of per capita income and population. Banded income projections were input into the original equation yielding alternative forecasts of sales to Clay. Sales to Alachua were modeled as a function of City of Alachua total income, which was derived from City of Alachua population and county per capita income. City of Alachua population was projected from a model which stated City population to be a function of county population. Banded City of Alachua population projections, yielding banded City of Alachua income projections, were input into the original equation to obtain alternative scenarios of energy sales to the City of Alachua. Impacts of demand-side management programs were also allowed to vary based upon the ratio of low-to-base and base-to-high band population projections, respectively.

### **3.3 DOCUMENTATION OF ENERGY SOURCES AND FUEL REQUIREMENTS**

#### **3.3.1 Fuels Used by System**

Presently, the system is capable of using coal, residual oil, distillate oil, natural gas, and a small percentage of nuclear fuel to satisfy its fuel requirements. Since the completion of the Deerhaven 2 coal-fired unit, the System has relied upon coal to fulfill much of its fuel requirements. It should be noted that these fuel requirements are those necessary to serve native load and existing schedule D contracts only. The System expects to market coal and natural gas based electric energy to other utilities in an expanding and increasingly open marketplace. To the extent that the System realizes these extra "outside" sales, actual consumption of these fuels will likely exceed the base case requirements indicated in Table 3.5.

### **3.3.2 Methodology**

The fuel use projections were produced using the Electric Generation Expansion Analysis System (EGEAS) developed under Electric Power Research Institute guidance and maintained by Stone & Webster Management Consultants. This is the same software the System uses to perform long-range integrated resource planning. EGEAS has the ability to model a variety of technologies from thermal units to DSM options and include the effects of environmental limits, of dual fuel units, of reliability constraints, and of maintenance scheduling, to list only a few. The optimization process uses piece-wise linear and cumulants techniques. The production modeling process uses a load-duration curve convolution and probability process.

The input data to this model includes:

- (1) Long-term forecast of System electric energy and power demand needs;
- (2) Projected fuel prices, outage parameters, nuclear refueling cycle (as needed), and maintenance schedules for each generating unit in the System;
- (3) Similar data for the new plants that will be added to the system to maintain system reliability.

The output of this model includes:

- (1) Monthly, yearly and total out-of-pocket operating fuel expenses and their dispersion among various generating units; and
- (2) Monthly and yearly capacity factors, energy production, hours of operation, fuel utilization, and heat rates for each unit in the system.

## **3.4 DEMAND-SIDE MANAGEMENT**

### **3.4.1 Demand-Side Management Plan**

Demand and energy forecasts and generation expansion plans outlined in this Ten Year Site Plan are consistent with GRU's 1990 Energy Conservation Plan and GRU's 1996 Demand-Side Management Plan. The System forecast reflects historical program implementations recorded under both plans and projected program implementations scheduled in the 1996 DSM Plan. Both plans address a similar array of DSM measures and both plans were designed for the purpose of conserving the resources utilized by the System in a manner most cost effective to the customers of GRU.

The 1996 DSM Plan contains programs which increase the efficiency of energy consumption and reduce the consumption of scarce natural resources. DSM programs are available for all native customers, including commercial and industrial customers, and are designed to effectively reduce and control the growth rates of electric consumption and weather sensitive peak demands.

GRU is active in the following conservation efforts: residential and commercial energy audits; low income household weatherization and natural gas extension; promotion of natural gas in residential construction; promotion of natural gas for cooling and dehumidification; promotion of natural gas for displacement of electric water heating and space heating in existing structures; commercial lighting efficiency and maintenance services; customer conservation education and information programs; the Trade Alliance Program, which offers a series of workshops providing technical assistance to builders, contractors, installers, code officials and home buyers covering topics such as: *Build Green and Profit, Home Buyer's Seminar, Code Workshops, Energy Star Homes, and Uncontrolled Airflow*; and the Business Partner's Program, which offers a series of workshops pertaining to energy and power conservation in the commercial and industrial sectors.

GRU is evaluating the implementation of additional conservation efforts including programs addressing high-efficiency air conditioning, heat recovery, duct leakage, mobile home roof coatings, commercial natural gas water heating and thermal energy storage systems. GRU is also investigating customer demand for a second-generation green-pricing program for solar-derived electricity and plans to implement a new program this year.

GRU has also produced numerous *factsheets*, publications and videos which are available at no charge to customers to assist them in making informed decisions effecting their energy utilization patterns. Examples include: Passive Solar Design-Factors for North Central Florida, a booklet which provides detailed solar and environmental data for passive solar designs in this area; Solar Guidebook, a brochure which explains common applications of solar energy in Gainesville; and The Energy Book, a guide to saving home energy dollars.

The expected effect of DSM program participation was derived from a comparative analysis of historical load and energy consumption of DSM program participants and non-participants. The methodology upon which the currently approved plan is based includes consideration of what would happen anyway, the fact that the conservation induced by utility involvement tends to "buy" conservation at the margin, adjustment for behavioral rebound and price elasticity effects and effects of abnormal weather. Known interactions between measures and programs were accounted for when possible. At the end of each device's life cycle, the energy and demand savings assumed to have been induced by GRU are reduced to zero to represent the retirement of the given device. Projected penetration rates were based on historical levels of program implementations and tied to escalation rates paralleling service area population growth.

DSM program implementations are expected to provide 13 MW of summer peak reduction, 21 MW of winter peak reduction and 72 GWh of annual energy savings by the year 2009. These figures represent cumulative impacts of programs since 1980. The System's projections of energy sales and peak demands reflect the effects of these DSM programs.

#### **3.4.2 Gainesville Energy Advisory Committee**

The Gainesville Energy Advisory Committee (GEAC) is a nine-member citizen group that is charged with formulating recommendations to the Gainesville City Commission concerning national, state and local energy-related issues. The GEAC offers advice and guidance on energy management studies and consumer awareness programs. The GEAC's efforts have resulted in numerous contributions, accomplishments, and achievements for the City of Gainesville. Specifically, the GEAC helped establish a residential energy audit program in 1979. The GEAC was initially involved in the ratemaking process in 1980 which ultimately lead to the approval of an inverted block residential rate and a voluntary residential time-of-use rate. The GEAC recognized *Solar Month* in October of 1991 by sponsoring a seminar to foster the viability of solar energy as an alternative to conventional means of energy supply. Representatives from Sandia National Laboratories, the Florida Solar Energy Center, FPC, and GRU gave presentations on various solar projects and technologies. A recommendation from GEAC followed the Solar Day Seminars for GRU to investigate offering its citizen-ratepayers the option of contributing to photovoltaic power production through monthly donations on their utility bills. The interest generated by the seminars along with grant money from the State of Florida Department of Community Affairs and the Utility PhotoVoltaic Group and donations from GRU customers and friends of solar energy resulted in a 10 kilowatt PV system at the Electric System Control Center (ESCC). GRU solicited public input on its solar water heater rebate program through the GEAC, and the committee in turn formally supported the program. The GEAC sponsored a Biomass Seminar for a joint meeting of the Gainesville City Commission

and the Alachua County Commission. The GEAC has strongly supported the EPA's Energy Star program, and helped GRU earn EPA's 1998 Utility Ally of the Year award.

### **3.4.3 Supply Side Programs**

Deerhaven 2 is also contributing to reduced oil use by other utilities through the Florida Energy Broker. Prior to the addition of Deerhaven Unit 2 in 1982, the System was relying on oil and natural gas for over 90% of native load energy requirements. In 1999, oil-fired generation comprised 2.4% of total net generation, natural gas-fired generation contributed 29.8%, nuclear fuel contributed 5.3%, and coal-fired generation provided 62.5% of total net generation. The PV system at ESCC provides slightly more than 10 kilowatts of capacity at solar noon on clear days.

The System has several programs to improve the adequacy and reliability of the transmission and distribution systems, which will also result in decreased energy losses. Each year the major distribution feeders are evaluated to determine whether the costs of reconductoring will produce an internal rate of return sufficient to justify expenses when compared to the savings realized from reduced distribution losses, and if so, reconductoring is recommended. Generating units are continually evaluated to ensure that they are maintaining design efficiencies. Transmission facilities are also studied to determine the potential savings from loss reductions achieved by the installation of capacitor banks. System losses have stabilized in the range of 4% to 6% of net generation as reflected in the forecasted relationship of total energy sales to net energy for load.

### **3.5 FUEL PRICE FORECAST ASSUMPTIONS**

Forecast prices for each type of fossil fuel analyzed by GRU were generally developed in two parts. Short-term monthly forecasts extending through 2000 were developed in-house by GRU's Fuels Department staff. Long-term fuel price forecasts were developed based upon forecasts of the U.S. Department of Energy's Energy Information Administration (EIA) as published in the Annual Energy Outlook 1999. In

essence, the end-point of the GRU short-term forecasts became the starting point for the long-term forecasts, subject to adjustment such that escalation rates within the long-term forecasts were consistent with those in EIA forecasts. EIA's real price projections were converted to "nominal" by application of EIA's forecast Implicit Price Deflator. Fossil fuel transportation costs were forecast separately from fuel commodity costs. Forecast fuel commodity costs and transportation costs were aggregated to develop forecast delivered fuel costs. The following documentation describes GRU's fuel price forecasts by fuel type.

### **3.5.1 Oil**

GRU does not have access to waterborne deliveries of oil and there are no pipelines in this area. Consequently, GRU relies on "spot" or as needed purchases from nearby vendors. The cost for purchasing and then trucking relatively insignificant quantities of oil to GRU's generating sites usually makes oil the most expensive and less favored of fuel sources available to GRU. Accordingly, short-term oil price forecasts for No.6 (residual oil) and No.2 (distillate or diesel oil) were based on actual costs to GRU over the past four years and on near term expectations for this limited market. An additional cost component, representing freight charges, was added to yield the final delivered oil price forecasts.

Based on the above factors, the price of No.2 oil delivered to GRU is expected to increase 5.0% annually while the actual volume of oil used remains small. Based on the above factors, the price of No.6 oil delivered to GRU is expected to increase 6.7% annually while the actual volume of oil used remains small.

### **3.5.2 Coal**

Coal is the primary fuel used by GRU to generate electricity. Abundant U.S. supplies of coal and increasing technological improvement in mining methods as well as the cost of new coal plants, competition from other fuels and a better labor environment will tend to limit the price increases of coal. Resource planning studies

require forecasts of three types of coal: low sulphur compliance coal, which is presently used by the System; pulverized coal for flue gas desulphurization; and fluidized bed combustion coal.

The short-term forecast price of low sulfur compliance coal was based on GRU's contractual options with its coal supplier. The long-term forecast price of low sulfur compliance coal was developed by applying the long term EIA forecast in the same manner as explained previously. Base line prices were determined for pulverized coal for flue gas desulphurization and fluidized bed compatible coal by utilizing a combination of acknowledged transactions and confidential state of the trade discussions with buyers and sellers of coal as reported in Coal Week. The base line prices were then escalated by applying the long term EIA forecast in the same manner as described previously.

GRU's long term contract with CSXT allows for delivery of coal through 2019. The short-term forecast transportation rate for all coals was based on actual rates from the pertinent coal supply districts for aluminum cars and four-hour loading facilities and on known contractual provisions. The long-term forecast of transportation rates was developed by applying the long term Rail Cost Adjustment Factor indices, adjusted and unadjusted, to the short term forecast. The indices were based on forecasts supplied by Fieldston, a coal transportation consulting company.

Based on the above factors, the price for coal delivered to GRU is expected to increase at an average annual rate of 0.8%, 1.0%, and 0.9% for low sulphur compliance coal, pulverized coal for flue gas desulphurization, and fluidized bed compatible coal, respectively.

### **3.5.3 Natural Gas**

Natural gas is expected to experience a higher rate of growth in demand than other fuels. Following a two-year period of low and stable prices, the forecast reflects the beginning of a modest increase in the price for natural gas.

GRU's purchases natural gas via arrangements with producers and marketers connected with the Florida Gas Transmission (FGT) interstate pipeline. The starting point for GRU's gas cost is the weighted average cost of gas (WACOG). The sum of the following components make up GRU's delivered cost of natural gas: the WACOG; Florida Gas Transmission's (FGT) fuel charge; FGT's transportation charge; and FGT's reservation charge.

Short-term natural gas prices were projected based upon recent trends in historical prices and price trends in the NYMEX gas futures market. The long-term forecast was then developed by applying the long term EIA forecast in the same manner as described previously.

Based on the above factors, the price of natural gas delivered to GRU is expected to increase at an annual rate of 3.9%.

### **3.5.4 Nuclear Fuel**

GRU's nuclear fuel price forecast is based on Florida Power Corporation's (FPC) forecast of nuclear fuel prices. The FPC forecast projects the price of nuclear fuel to increase approximately 2.8% per year through the forecast horizon.

**Schedule 2.1**  
**History and Forecast of Energy Consumption and**  
**Number of Customers by Customer Class**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	RURAL AND RESIDENTIAL				COMMERCIAL *			
	Service Area Population	Persons per Household	GWh	Average Number of Customers	Average kWh per Customer	GWh	Average Number of Customers	Average kWh per Customer
1990	129,432	2.40	594	53,930	11,023	481	6,394	75,240
1991	131,873	2.39	602	55,177	10,906	491	6,527	75,222
1992	135,678	2.39	610	56,769	10,739	507	6,730	75,284
1993	141,163	2.39	637	59,064	10,778	524	6,998	74,824
1994	145,460	2.39	649	60,862	10,670	558	7,059	79,024
1995	148,491	2.39	704	62,130	11,329	590	7,305	80,767
1996	151,591	2.39	718	63,427	11,313	594	7,539	78,813
1997	155,713	2.39	705	65,152	10,817	598	7,750	77,193
1998	159,466	2.39	777	66,722	11,649	640	7,868	81,363
1999	164,503	2.40	763	68,543	11,137	648	8,095	80,036
2000	167,133	2.40	791	69,639	11,361	666	8,302	80,222
2001	170,476	2.40	810	71,032	11,406	683	8,511	80,288
2002	173,924	2.40	829	72,469	11,439	701	8,725	80,383
2003	177,268	2.40	847	73,862	11,466	719	8,934	80,494
2004	180,507	2.40	864	75,211	11,487	736	9,136	80,563
2005	183,746	2.40	882	76,561	11,517	753	9,337	80,677
2006	186,985	2.40	900	77,910	11,554	771	9,539	80,799
2007	190,120	2.40	918	79,217	11,593	788	9,734	80,975
2008	193,254	2.40	937	80,523	11,640	806	9,930	81,142
2009	196,389	2.40	956	81,829	11,683	823	10,125	81,247

\* Commercial represents GS Non-Demand and GS Demand Rate Classes.

**Schedule 2.2**  
**History and Forecast of Energy Consumption and**  
**Number of Customers by Customer Class**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)
Year	<u>GWh</u>	<u>Average Number of Customers</u>	<u>Average MWh per Customer</u>	<u>Railroads and Railways GWh</u>	<u>Street and Highway Lighting GWh</u>	<u>Other Sales to Public Authorities GWh</u>	<u>Total Sales to Ultimate Consumers GWh</u>
		INDUSTRIAL **					
1990	126	14	9,024	0	16	0	1,218
1991	128	14	9,392	0	16	0	1,237
1992	128	13	9,853	0	16	0	1,261
1993	132	13	10,121	0	16	0	1,308
1994	134	13	10,344	0	18	0	1,359
1995	137	13	10,521	0	18	0	1,449
1996	148	15	9,893	0	19	0	1,479
1997	151	15	10,059	0	21	0	1,475
1998	157	15	10,443	0	21	0	1,595
1999	173	17	10,188	0	22	0	1,606
2000	188	18	10,437	0	22	0	1,668
2001	189	18	10,526	0	23	0	1,706
2002	191	18	10,607	0	24	0	1,745
2003	192	18	10,681	0	24	0	1,783
2004	194	18	10,756	0	25	0	1,818
2005	195	18	10,834	0	25	0	1,855
2006	196	18	10,907	0	26	0	1,893
2007	198	18	10,979	0	27	0	1,931
2008	199	18	11,051	0	27	0	1,969
2009	200	18	11,122	0	28	0	2,006

\*\* Industrial represents Large Power Rate Class.

**Schedule 2.3**  
**History and Forecast of Energy Consumption and**  
**Number of Customers by Customer Class**

(1)	(2)	(3)	(4)	(5)	(6)
<u>Year</u>	Sales For Resale <u>GWh</u>	Utility Use and Losses <u>GWh</u>	Net Energy for Load <u>GWh</u>	Other <u>Customers</u>	Total Number of <u>Customers</u>
1990	85	60	1,363	0	60,338
1991	90	85	1,411	0	61,718
1992	93	70	1,424	0	63,512
1993	94	100	1,502	0	66,075
1994	91	69	1,519	0	67,934
1995	101	97	1,648	0	69,448
1996	105	75	1,659	0	70,981
1997	104	82	1,661	0	72,917
1998	108	76	1,779	0	74,605
1999	109	83	1,798	0	76,655
2000	114	92	1,874	0	77,959
2001	119	95	1,920	0	79,561
2002	124	97	1,966	0	81,212
2003	129	99	2,010	0	82,813
2004	133	101	2,053	0	84,365
2005	138	103	2,097	0	85,916
2006	143	106	2,142	0	87,468
2007	148	108	2,186	0	88,969
2008	152	110	2,231	0	90,470
2009	157	112	2,276	0	91,972

**Schedule 3.1  
History and Forecast of Summer Peak Demand  
Base Case**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
<u>Year</u>	<u>Total</u>	<u>Wholesale</u>	<u>Retail</u>	<u>Interruptible</u>	<u>Residential Load Management</u>	<u>Residential Conservation</u>	<u>Comm./Ind. Load Management</u>	<u>Comm./Ind. Conservation</u>	<u>Net Firm Demand</u>
1990	317	21	284	0	0	8	0	4	305
1991	310	21	276	0	0	9	0	4	297
1992	334	23	297	0	0	9	0	5	320
1993	355	23	316	0	0	10	0	6	339
1994	347	21	310	0	0	9	0	7	331
1995	377	24	337	0	0	9	0	7	361
1996	380	24	341	0	0	8	0	7	365
1997	388	24	349	0	0	8	0	7	373
1998	411	26	370	0	0	8	0	7	396
1999	434	26	393	0	0	8	0	7	419
2000	424	26	383	0	0	8	0	7	409
2001	434	27	393	0	0	7	0	7	420
2002	444	28	402	0	0	7	0	7	430
2003	454	30	410	0	0	7	0	7	440
2004	464	31	419	0	0	7	0	7	450
2005	473	32	427	0	0	7	0	7	459
2006	483	33	436	0	0	8	0	6	469
2007	493	34	445	0	0	8	0	6	479
2008	503	35	454	0	0	8	0	6	489
2009	511	36	462	0	0	8	0	5	498

**Schedule 3.1H  
History and Forecast of Summer Peak Demand  
High Band Forecast**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
<u>Year</u>	<u>Total</u>	<u>Wholesale</u>	<u>Retail</u>	<u>Interruptible</u>	<u>Residential Load Management</u>	<u>Residential Conservation</u>	<u>Comm./Ind. Load Management</u>	<u>Comm./Ind. Conservation</u>	<u>Net Firm Demand</u>
1990	317	21	284	0	0	8	0	4	305
1991	310	21	276	0	0	9	0	4	297
1992	334	23	297	0	0	9	0	5	320
1993	355	23	316	0	0	10	0	6	339
1994	347	21	310	0	0	9	0	7	331
1995	377	24	337	0	0	9	0	7	361
1996	380	24	341	0	0	8	0	7	365
1997	388	24	349	0	0	8	0	7	373
1998	411	26	370	0	0	8	0	7	396
1999	434	26	393	0	0	8	0	7	419
2000	432	26	391	0	0	8	0	8	417
2001	447	27	405	0	0	7	0	8	432
2002	461	28	418	0	0	7	0	7	446
2003	475	30	430	0	0	7	0	7	460
2004	490	31	444	0	0	8	0	7	475
2005	504	32	457	0	0	8	0	7	489
2006	518	33	470	0	0	8	0	7	503
2007	533	34	484	0	0	8	0	6	518
2008	548	35	498	0	0	9	0	6	533
2009	562	36	511	0	0	9	0	6	547

**Schedule 3.1L  
History and Forecast of Summer Peak Demand  
Low Band Forecast**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
<u>Year</u>	<u>Total</u>	<u>Wholesale</u>	<u>Retail</u>	<u>Interruptible</u>	Residential Load <u>Management</u>	Residential Conservation	Comm./Ind. Load <u>Management</u>	Comm./Ind. Conservation	<u>Net Firm Demand</u>
1990	317	21	284	0	0	8	0	4	305
1991	310	21	276	0	0	9	0	4	297
1992	334	23	297	0	0	9	0	5	320
1993	355	23	316	0	0	10	0	6	339
1994	347	21	310	0	0	9	0	7	331
1995	377	24	337	0	0	9	0	7	361
1996	380	24	341	0	0	8	0	7	365
1997	388	24	349	0	0	8	0	7	373
1998	411	26	370	0	0	8	0	7	396
1999	434	26	393	0	0	8	0	7	419
2000	417	26	376	0	0	7	0	7	402
2001	424	27	383	0	0	7	0	7	410
2002	430	28	388	0	0	7	0	7	416
2003	436	30	393	0	0	7	0	7	423
2004	441	31	397	0	0	7	0	6	428
2005	447	32	402	0	0	7	0	6	434
2006	453	33	407	0	0	7	0	6	440
2007	459	34	412	0	0	7	0	6	446
2008	464	35	417	0	0	7	0	5	452
2009	469	36	421	0	0	7	0	5	457

**Schedule 3.2**  
**History and Forecast of Winter Peak Demand**  
**Base Case**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
<u>Year</u>	<u>Total</u>	<u>Wholesale</u>	<u>Retail</u>	<u>Interruptible</u>	<u>Residential Load Management</u>	<u>Residential Conservation</u>	<u>Comm./Ind. Load Management</u>	<u>Comm./Ind. Conservation</u>	<u>Net Firm Demand</u>
1990	246	20	205	0	0	17	0	4	225
1991	262	22	216	0	0	20	0	4	238
1992	306	25	253	0	0	23	0	5	278
1993	290	22	237	0	0	25	0	6	259
1994	319	23	262	0	0	27	0	7	285
1995	350	25	289	0	0	29	0	7	314
1996	381	28	317	0	0	29	0	7	345
1997	321	26	258	0	0	30	0	7	284
1998	301	23	240	0	0	30	0	7	263
1999	389	28	323	0	0	31	0	7	351
2000	368	26	306	0	0	29	0	7	332
2001	376	27	315	0	0	28	0	6	342
2002	384	28	323	0	0	27	0	6	351
2003	391	29	331	0	0	26	0	5	360
2004	399	31	338	0	0	26	0	5	369
2005	407	32	346	0	0	25	0	4	378
2006	415	33	355	0	0	24	0	3	388
2007	423	34	364	0	0	23	0	3	398
2008	431	35	373	0	0	21	0	2	408
2009	439	36	382	0	0	19	0	1	418

**Schedule 3.2H  
History and Forecast of Winter Peak Demand  
High Band Forecast**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
<u>Year</u>	<u>Total</u>	<u>Wholesale</u>	<u>Retail</u>	<u>Interruptible</u>	<u>Residential Load Management</u>	<u>Residential Conservation</u>	<u>Comm./Ind. Load Management</u>	<u>Comm./Ind. Conservation</u>	<u>Net Firm Demand</u>
1990	246	20	205	0	0	17	0	4	225
1991	262	22	216	0	0	20	0	4	238
1992	306	25	253	0	0	23	0	5	278
1993	290	22	237	0	0	25	0	6	259
1994	319	23	262	0	0	27	0	7	285
1995	350	25	289	0	0	29	0	7	314
1996	381	28	317	0	0	29	0	7	345
1997	321	26	258	0	0	30	0	7	284
1998	301	23	240	0	0	30	0	7	263
1999	389	28	323	0	0	31	0	7	351
2000	374	26	312	0	0	30	0	7	338
2001	386	27	324	0	0	29	0	6	351
2002	398	28	336	0	0	28	0	6	364
2003	410	29	348	0	0	28	0	5	377
2004	422	31	359	0	0	27	0	5	390
2005	434	32	371	0	0	27	0	4	403
2006	445	33	383	0	0	26	0	4	416
2007	457	34	396	0	0	24	0	3	430
2008	470	35	410	0	0	23	0	2	445
2009	482	36	423	0	0	21	0	1	459

**Schedule 3.2L  
History and Forecast of Winter Peak Demand  
Low Band Forecast**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
<u>Year</u>	<u>Total</u>	<u>Wholesale</u>	<u>Retail</u>	<u>Interruptible</u>	<u>Residential Load Management</u>	<u>Residential Conservation</u>	<u>Comm./Ind. Load Management</u>	<u>Comm./Ind. Conservation</u>	<u>Net Firm Demand</u>
1990	246	20	205	0	0	17	0	4	225
1991	262	22	216	0	0	20	0	4	238
1992	306	25	253	0	0	23	0	5	278
1993	290	22	237	0	0	25	0	6	259
1994	319	23	262	0	0	27	0	7	285
1995	350	25	289	0	0	29	0	7	314
1996	381	28	317	0	0	29	0	7	345
1997	321	26	258	0	0	30	0	7	284
1998	301	23	240	0	0	30	0	7	263
1999	389	28	323	0	0	31	0	7	351
2000	361	26	300	0	0	28	0	7	326
2001	366	27	306	0	0	27	0	6	333
2002	372	28	312	0	0	26	0	6	340
2003	376	29	317	0	0	25	0	5	346
2004	381	31	321	0	0	25	0	4	352
2005	386	32	326	0	0	24	0	4	358
2006	390	33	331	0	0	22	0	3	364
2007	395	34	337	0	0	21	0	2	371
2008	398	35	342	0	0	19	0	2	377
2009	402	36	347	0	0	18	0	1	383

**Schedule 3.3**  
**History and Forecast of Net Energy for Load - GWH**  
**Base Case**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
<u>Year</u>	<u>Total</u>	<u>Residential Conservation</u>	<u>Comm./Ind. Conservation</u>	<u>Retail</u>	<u>Wholesale</u>	<u>Utility Use &amp; Losses</u>	<u>Net Energy for Load</u>	<u>Load Factor %</u>
1990	1,407	34	10	1,217	85	61	1,363	51.01%
1991	1,460	37	12	1,236	90	85	1,411	54.23%
1992	1,479	41	14	1,261	93	70	1,424	50.80%
1993	1,563	44	17	1,308	94	100	1,502	50.58%
1994	1,581	44	18	1,359	91	69	1,519	52.39%
1995	1,711	43	20	1,449	101	98	1,648	52.11%
1996	1,721	42	21	1,479	105	75	1,659	51.89%
1997	1,726	44	21	1,475	104	82	1,661	50.83%
1998	1,847	47	21	1,595	108	76	1,779	51.28%
1999	1,869	50	21	1,606	109	83	1,798	48.99%
2000	1,945	50	21	1,673	109	92	1,874	52.30%
2001	1,991	50	20	1,711	114	95	1,920	52.19%
2002	2,037	52	19	1,750	119	97	1,966	52.19%
2003	2,082	53	18	1,787	124	99	2,010	52.15%
2004	2,126	55	18	1,823	129	101	2,053	52.08%
2005	2,171	57	17	1,859	134	104	2,097	52.15%
2006	2,216	58	16	1,897	139	106	2,142	52.14%
2007	2,259	59	14	1,934	144	108	2,186	52.10%
2008	2,303	60	13	1,972	149	110	2,231	52.08%
2009	2,348	60	12	2,010	154	112	2,276	52.17%

**Schedule 3.3H  
History and Forecast of Net Energy for Load - GWH  
High Band Forecast**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
<u>Year</u>	<u>Total</u>	<u>Residential Conservation</u>	<u>Comm./Ind. Conservation</u>	<u>Retail</u>	<u>Wholesale</u>	<u>Utility Use &amp; Losses</u>	<u>Net Energy for Load</u>	<u>Load Factor %</u>
1990	1,407	34	10	1,217	85	61	1,363	51.01%
1991	1,460	37	12	1,236	90	85	1,411	54.23%
1992	1,479	41	14	1,261	93	70	1,424	50.80%
1993	1,563	44	17	1,308	94	100	1,502	50.58%
1994	1,581	44	18	1,359	91	69	1,519	52.39%
1995	1,711	43	20	1,449	101	98	1,648	52.11%
1996	1,721	42	21	1,479	105	75	1,659	51.89%
1997	1,726	44	21	1,475	104	82	1,661	50.83%
1998	1,847	47	21	1,595	108	76	1,779	51.28%
1999	1,869	50	21	1,606	109	83	1,798	48.99%
2000	1,982	50	22	1,707	109	94	1,910	52.29%
2001	2,048	52	21	1,764	114	97	1,975	52.19%
2002	2,113	53	20	1,820	119	100	2,039	52.19%
2003	2,179	56	19	1,876	124	104	2,104	52.21%
2004	2,244	58	19	1,931	129	107	2,167	52.08%
2005	2,311	61	18	1,988	134	110	2,232	52.11%
2006	2,377	62	17	2,046	139	113	2,298	52.15%
2007	2,444	64	15	2,104	144	117	2,365	52.12%
2008	2,512	65	14	2,164	149	120	2,433	52.11%
2009	2,579	66	13	2,222	154	124	2,500	52.17%

**Schedule 3.3L  
History and Forecast of Net Energy for Load - GWH  
Low Band Forecast**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
<u>Year</u>	<u>Total</u>	<u>Residential Conservation</u>	<u>Comm./Ind. Conservation</u>	<u>Retail</u>	<u>Wholesale</u>	<u>Utility Use &amp; Losses</u>	<u>Net Energy for Load</u>	<u>Load Factor %</u>
1990	1,407	34	10	1,217	85	61	1,363	51.01%
1991	1,460	37	12	1,236	90	85	1,411	54.23%
1992	1,479	41	14	1,261	93	70	1,424	50.80%
1993	1,563	44	17	1,308	94	100	1,502	50.58%
1994	1,581	44	18	1,359	91	69	1,519	52.39%
1995	1,711	43	20	1,449	101	98	1,648	52.11%
1996	1,721	42	21	1,479	105	75	1,659	51.89%
1997	1,726	44	21	1,475	104	82	1,661	50.83%
1998	1,847	47	21	1,595	108	76	1,779	51.28%
1999	1,869	50	21	1,606	109	83	1,798	48.99%
2000	1,913	49	21	1,644	109	91	1,844	52.36%
2001	1,943	49	20	1,667	114	93	1,874	52.18%
2002	1,972	50	19	1,690	119	94	1,903	52.22%
2003	1,999	51	18	1,711	124	95	1,930	52.09%
2004	2,026	53	17	1,731	129	96	1,956	52.17%
2005	2,053	54	16	1,751	134	98	1,983	52.16%
2006	2,078	55	15	1,771	139	99	2,009	52.12%
2007	2,103	55	13	1,791	144	100	2,035	52.09%
2008	2,128	55	12	1,811	149	101	2,061	52.05%
2009	2,151	55	11	1,829	154	102	2,085	52.08%

Schedule 4

Previous Year and 2-Year Forecast of Peak Demand and Net Energy for Load

(1)	(2)	(3)	(4)	(5)	(6)	(7)
Month	ACTUAL		FORECAST			
	1999		2000		2001	
	Peak Demand	NEL	Peak Demand	NEL	Peak Demand	NEL
	(MW)	(GWh)	(MW)	(GWh)	(MW)	(GWh)
JAN	351	133	332	146	342	150
FEB	278	115	328	126	335	129
MAR	250	123	280	133	287	136
APR	322	145	294	131	301	135
MAY	337	152	349	158	358	162
JUN	358	164	397	178	407	182
JUL	413	192	408	193	418	198
AUG	419	197	409	197	420	201
SEP	368	171	386	180	396	185
OCT	315	149	338	153	346	156
NOV	252	122	292	134	299	137
DEC	298	134	314	145	321	148

**Schedule 5  
Fuel Requirements**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
Fuel Type		Units		Actual 1998	Actual 1999	2000	2001	2002	2003	2004	2005	2006	2007	2008	2009
(1) NUCLEAR		Btu x 10 <sup>12</sup>		0.9	0.9	0.7	0.9	0.7	0.7	0.9	0.7	0.7	0.9	0.7	0.7
(2) COAL	Total	1000 Tons		570	424	565	600	604	591	581	589	610	615	623	613
(3) RESIDUAL (1)	Total	1000 bbl		37	70	0	0	0	0	0	0	0	0	0	0
(4)	Steam	1000 bbl		37	70	0	0	0	0	0	0	0	0	0	0
(5)	CC (2)	1000 bbl		0	0	0	0	0	0	0	0	0	0	0	0
(6)	CT (3)	1000 bbl		0	0	0	0	0	0	0	0	0	0	0	0
(7)	Diesel	1000 bbl		0	0	0	0	0	0	0	0	0	0	0	0
(8) DISTILLATE (4)	Total	1000 bbl		1	1	0	0	0	0	0	0	0	0	0	0
(9)	Steam	1000 bbl		0	0	0	0	0	0	0	0	0	0	0	0
(10)	CC (2)	1000 bbl		0	0	0	0	0	0	0	0	0	0	0	0
(11)	CT (3)	1000 bbl		1	1	0	0	0	0	0	0	0	0	0	0
(12)	Diesel	1000 bbl		0	0	0	0	0	0	0	0	0	0	0	0
(13) NATURAL GAS	Total	cf x 10 <sup>6</sup>		4,739	6,083	6,589	4,926	5,260	4,465	5,072	5,382	5,176	5,376	5,703	6,435
(14)	Steam	cf x 10 <sup>6</sup>		3,448	4,892	3,998	1,202	1,021	777	1,055	1,129	1,003	1,094	1,229	1,500
(15)	CC (2)	cf x 10 <sup>6</sup>		0	0	0	3,173	3,726	3,383	3,480	3,660	3,744	3,781	3,915	4,036
(16)	CT (3)	cf x 10 <sup>6</sup>		1,292	1,191	2,591	551	513	305	537	593	429	501	559	899
(17) Other (Specify)		Btu x 10 <sup>12</sup>		0	0	0	0	0	0	0	0	0	0	0	0

**Notes:**

- (1) RESIDUAL - INCLUDES #4, #5, AND #6 OIL.
- (2) CC - COMBINED CYCLE UNIT.
- (3) CT - COMBUSTION TURBINE UNIT (INCLUDES DIESEL).
- (4) DISTILLATE - INCLUDES #1 AND #2 OIL, KEROSENE, JET FUEL AND AMOUNTS USED AT COAL BURNING PLANTS FOR FLAME STABILIZATION AND FOR STARTUP.

**Schedule 6.1  
Energy Sources**

(1)	(2)	(3)	(4)	(5) Actual 1998	(6) Actual 1999	(7) 2000	(8) 2001	(9) 2002	(10) 2003	(11) 2004	(12) 2005	(13) 2006	(14) 2007	(15) 2008	(16) 2009
<b>CAPABILITY/FUEL TYPE</b>															
(1)	Annual Firm Interchange <sup>(1)</sup>		GWh	-98	134	-146	-184	-184	-1	0	0	0	0	0	0
(2)	NUCLEAR		GWh	89	88	71	82	71	71	82	71	71	82	71	71
(3)	Residual	Total	GWh	20	39	0	0	0	0	0	0	0	0	0	0
(4)		Steam	GWh	20	39	0	0	0	0	0	0	0	0	0	0
(5)		CC	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(6)		CT	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(7)		Diesel	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(8)	Distillate	Total	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(9)		Steam	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(10)		CC	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(11)		CT	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(12)		Diesel	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(13)	Natural Gas	Total	GWh	396	490	534	519	567	464	519	551	541	559	595	663
(14)		Steam	GWh	299	404	348	105	89	68	92	99	88	96	108	133
(15)		CC	GWh	0	0	0	376	443	376	390	411	424	429	449	467
(16)		CT	GWh	97	86	186	38	35	20	37	41	29	34	38	63
(17)	Other (Specify)														
	Coal		GWh	1,373	1,027	1,415	1,503	1,512	1,476	1,452	1,475	1,530	1,545	1,565	1,542
	Other Purch/Sales		GWh	-1	20	0	0	0	0	0	0	0	0	0	0
(18)	Net Energy for Load			1,779	1,798	1,874	1,920	1,966	2,010	2,053	2,097	2,142	2,186	2,231	2,276

Notes: (1) Net energy purchased(+)/sold(-) to other utilities within Peninsular Florida.  
 (2) Net energy purchased(+)/sold(-) to other entities.  
 Row: (17) Other (Specified)

**Schedule 6.2  
Energy Sources**

(1)	(2)	(3)	(4)	(5) Actual 1998	(6) Actual 1999	(7) 2000	(8) 2001	(9) 2002	(10) 2003	(11) 2004	(12) 2005	(13) 2006	(14) 2007	(15) 2008	(16) 2009
<b>CAPABILITY/FUEL TYPE</b>															
(1)	Annual Firm Interchange <sup>(1)(2)</sup>		GWh	-5.5%	7.5%	-7.8%	-9.6%	-9.4%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(2)	NUCLEAR		GWh	5.0%	4.9%	3.8%	4.3%	3.6%	3.5%	4.0%	3.4%	3.3%	3.8%	3.2%	3.1%
(3)	Residual	Total	GWh	1.1%	2.2%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(4)		Steam	GWh	1.1%	2.2%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(5)		CC	GWh	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(6)		CT	GWh	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(7)		Diesel	GWh	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(8)	Distillate	Total	GWh	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(9)		Steam	GWh	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(10)		CC	GWh	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(11)		CT	GWh	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(12)		Diesel	GWh	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(13)	Natural Gas	Total	GWh	22.3%	27.3%	28.5%	27.0%	28.8%	23.1%	25.3%	26.3%	25.3%	25.6%	26.7%	29.1%
(14)		Steam	GWh	16.8%	22.5%	18.6%	5.5%	4.5%	3.4%	4.5%	4.7%	4.1%	4.4%	4.8%	5.8%
(15)		CC	GWh	0.0%	0.0%	0.0%	19.6%	22.5%	18.7%	19.0%	19.6%	19.8%	19.6%	20.1%	20.5%
(16)		CT	GWh	5.5%	4.8%	9.9%	2.0%	1.8%	1.0%	1.8%	2.0%	1.4%	1.6%	1.7%	2.8%
(17)	Coal		GWh	77.2%	57.1%	75.5%	78.3%	76.9%	73.4%	70.7%	70.3%	71.4%	70.7%	70.1%	67.8%
(17)	Non-Firm Interchange		GWh	-0.1%	1.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(18)	Net Energy for Load			100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Notes: (1) Economy interchange not included for 1998-2003 (schedule D & G only).  
 (2) Net energy purchased(+)/sold(-) to other utilities within Peninsular Florida.  
 Row: (17) Other (Specify)

## 4. FORECAST OF FACILITIES REQUIREMENTS

### 4.1 GENERATION RETIREMENTS AND ADDITIONS

#### 4.1.1 Least-Cost Planning Selection

The System does not expect to retire any of its currently operating generating units prior to 2011. One of the recommendations from the Integrated Resource Least-Cost Planning Study, prepared by Stone & Webster Management Consultants, Inc. (S&W), New York, March 1992, was to "continue the current level of operation and maintenance at the Kelly Station and implement the maintenance suggestions contained in Stone & Webster Engineering Corporation's report." Further, Stone & Webster Engineering Corporation found no reason to recommend the System retire any currently operating units and suggested that these units should continue to operate through 2010. The System's newest combustion turbine (DHCT3) at the Deerhaven Station, entered commercial operation January 26, 1996. As an option, this CT was sited to accommodate conversion to combined-cycle capacity, via the addition of a heat-recovery steam generator and small steam turbine.

GRU performed an integrated least-cost planning study to determine the best plan for serving our customers well into the next century. This process took several years and involved: several RFPs to discover unknown options from other Utilities and Power Marketers; multiple sensitivities using combinations of high, base, low, and constant differential fuel price forecasts and high, base, and low load and energy forecasts; combinations of investors, purchase, partnership, and sole ownership of new generating facilities, reconfiguring and repowering of existing facilities; as well as, continuing to evaluate and refine, as necessary, existing conservation and load control options. The modeling tools used for the least-cost planning was the EGEAS model described in Chapter 3 and EXPAN which uses analytical, probabilistic, and graphical tools and provides enhanced expansion plan risk analysis. GRU used a planning criteria of 15% operating reserve margin (suggested for emergency power pricing

purposes by Florida Public Service Commission Rule 25-6.035). The optimization is based on lowest net present value of revenue requirements, considering the net present value of the optimization time frame. Schedule 9 is included at the end of this section.

In consideration of the load forecast, reserve margin requirements, and system reliability, GRU's Electric System will require additional generating capacity before 2007. An extensive three-year integrated resource planning study has revealed that repowering J. R. Kelly Unit 8 as a nominal 110 megawatt combined-cycle unit is the best and most robust choice when subjected to an exhaustive array of scenarios. These scenarios included several partnership options and partnerships on the repowering of J. R. Kelly Unit 8 and still the best and most robust choice for GRU's customers was for GRU to do this project. Because of the opportunity to improve operating efficiency, reduce emission rates, reduce total emissions, and better participate in the redevelopment of downtown Gainesville, while increasing the electric system's capacity at a time when the reserve margin for Peninsular Florida is getting tight, The Gainesville City Commission has approved moving the installation target date to 2001. Schedule 8 provides a listing of proposed changes to the System's generation facilities.

#### **4.1.2 Green Pricing**

Photovoltaic systems have demonstrated remarkable reductions in cost over the last decade and have the potential to somewhat offset GRU's summer peaks. Although not considered cost-effective in the planning horizon, the Community has demonstrated a philosophical commitment to such systems by participating in a contribution campaign which has allowed customers to either make direct contributions or enroll to contribute on a monthly basis via their utility bill. Green-pricing was used, in conjunction with State and Federal grants, to build the 10 kilowatt photovoltaic array at ESCC.

The Gainesville City Commission has authorized GRU to proceed with offering a new PV program in a joint project with the Florida Municipal Electric Association and the Florida Solar Energy Center. The program design is in the formative stages and will most likely be designed on the basis of a capacity-based subscription.

#### **4.2 RESERVE MARGIN AND SCHEDULED MAINTENANCE**

Available generating capacities are compared with System summer peak demands in Schedule 7.1 and System winter peak demands in Schedule 7.2. Higher peak demands in summer and lower unit operating efficiencies in summer result in lower reserve margins during the summer season than in winter. Summer reserve margins are forecast to be at least 22% (of peak demand) through 2009.

#### **4.3 DISTRIBUTION SYSTEM ADDITIONS**

Two new identical mini-power delivery substations (PDS) are planned for the GRU system. The first, to be located near the intersection of SW Williston Road and SW 23<sup>rd</sup> Terrace in Gainesville, will be installed by the summer of 2000. The second, to be located in the 8500 block of SW Archer Road, is planned for the summer of 2002.

These new PDSs have been planned in response to heavy loading on the existing Serenola and Sugarfoot substations, with more major load development planned for those areas.

Each PDS will consist of one 138-12.47 KV, 33.6 MVA, wye-wye substation transformer with a maximum of four distribution circuits. The proximity of these new PDSs to other, existing adjacent area substations will allow for backup in the event of a substation transformer failure.


**Schedule 7.1**  
**Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Summer Peak**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)
Year	Total Installed Capacity MW	Firm Capacity Import MW	Firm Capacity Export MW	QF MW	Total Capacity Available MW	System Firm Summer Peak Demand MW	Reserve Margin1 before Maintenance MW	% of Peak	Scheduled Maintenance MW	Reserve Margin1 after Maintenance MW	% of Peak
1990	452	0	63	0	389	305	84	28%	0	84	28%
1991	452	0	53	0	399	297	102	34%	0	102	34%
1992	452	0	43	0	409	320	89	28%	0	89	28%
1993	452	0	33	0	419	339	80	24%	0	80	24%
1994	452	0	13	0	439	331	108	33%	0	108	33%
1995	452	0	33	0	419	361	58	16%	0	58	16%
1996	527	18	43	0	502	365	137	38%	0	137	38%
1997	527	30	85	0	472	373	99	27%	0	99	27%
1998	550	31	73	0	508	396	112	28%	0	112	28%
1999	550	32	110	0	472	419	53	13%	14	39	9%
2000	550	0	78	0	472	409	63	15%	0	63	15%
2001	610	0	43	0	567	420	147	35%	0	147	35%
2002	610	0	43	0	567	430	137	32%	0	137	32%
2003	610	0	3	0	607	440	167	38%	0	167	38%
2004	610	0	0	0	610	450	160	36%	0	160	36%
2005	610	0	0	0	610	459	151	33%	0	151	33%
2006	610	0	0	0	610	469	141	30%	0	141	30%
2007	610	0	0	0	610	479	131	27%	0	131	27%
2008	610	0	0	0	610	489	121	25%	0	121	25%
2009	610	0	0	0	610	498	112	22%	0	112	22%

(1) GRU provides reserve margin backup for 3 MW Schedule D contract with the City of Starke.

# Summer Peak Demand and Generation Capacity

53

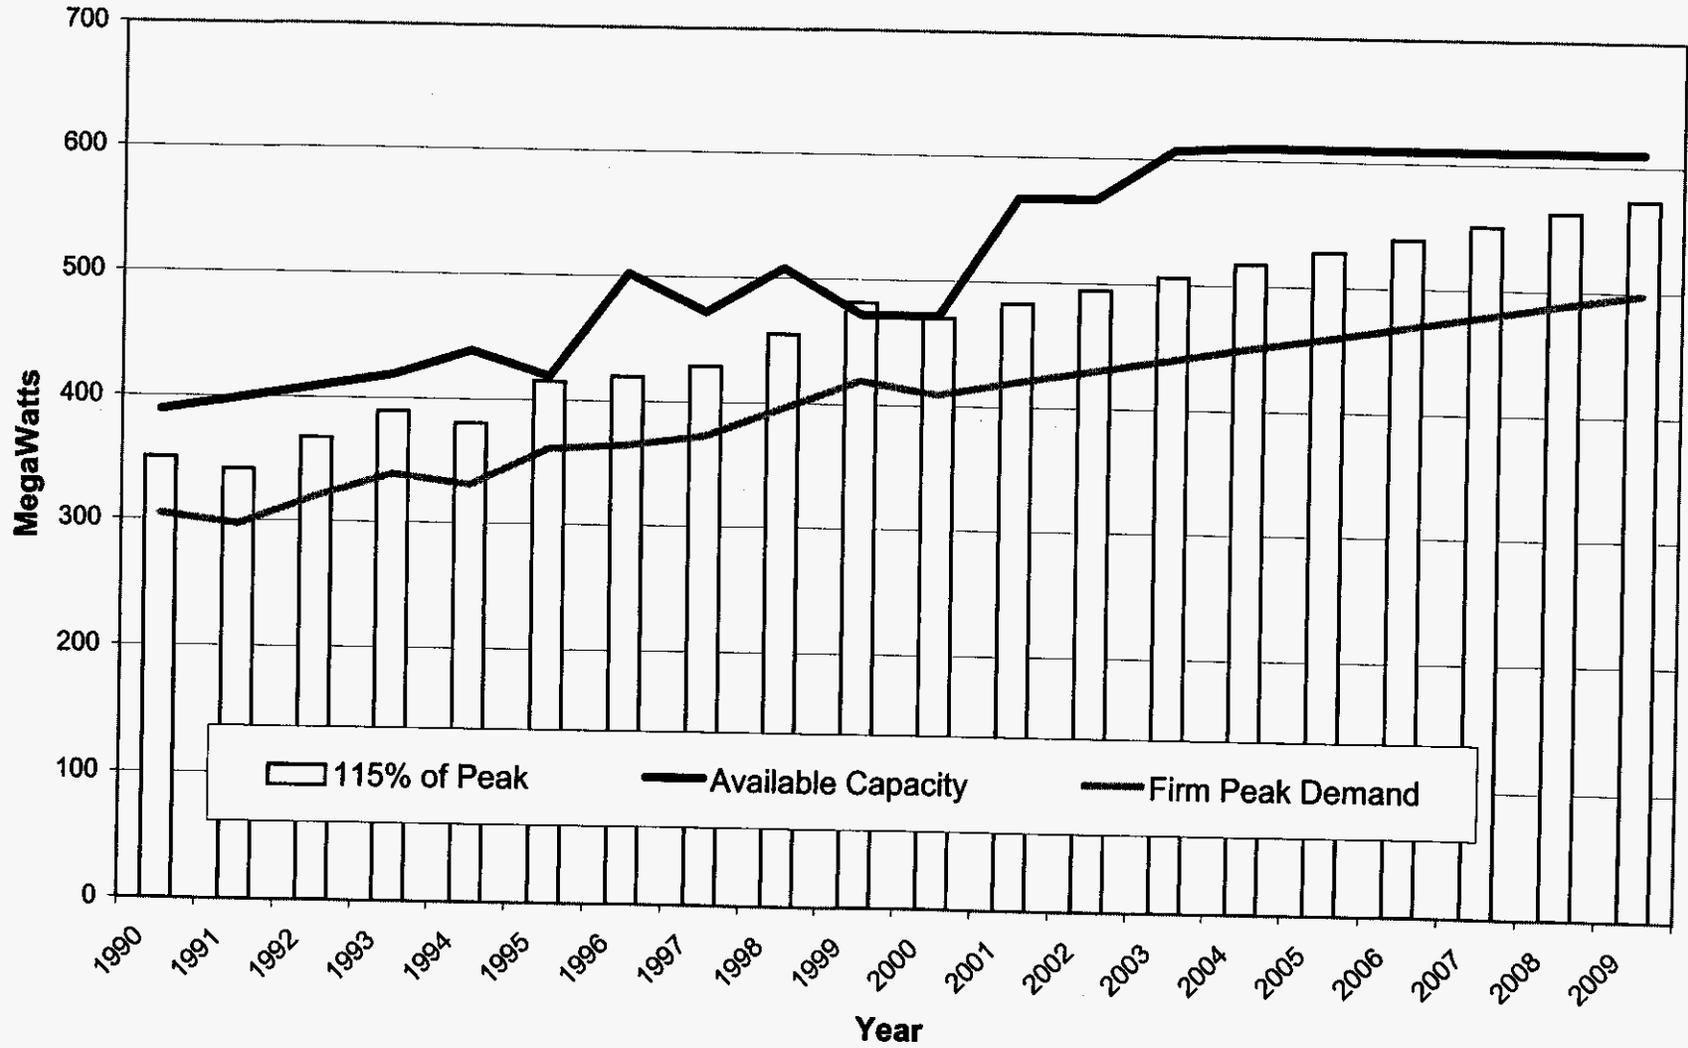


**Schedule 7.2**  
**Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Winter Peak**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)
<u>Year</u>	<u>Total Installed Capacity MW</u>	<u>Firm Capacity Import MW</u>	<u>Firm Capacity Export MW</u>	<u>QF MW</u>	<u>Total Capacity Available MW</u>	<u>System Firm Winter Peak Demand MW</u>	<u>Reserve Margin1 before Maintenance MW</u>	<u>% of Peak</u>	<u>Scheduled Maintenance MW</u>	<u>Reserve Margin1 after Maintenance MW</u>	<u>% of Peak</u>
1989 /90	459	0	33	0	426	225	201	89%	0	201	89%
1990 /91	459	0	53	0	406	238	168	71%	0	168	71%
1991 /92	459	0	43	0	416	278	138	50%	0	138	50%
1992 /93	459	0	33	0	426	259	167	64%	0	167	64%
1993 /94	459	0	13	0	446	285	161	56%	0	161	56%
1994 /95	459	0	33	0	426	314	112	36%	0	112	36%
1995 /96	540	0	33	0	507	345	162	47%	0	162	47%
1996 /97	540	18	43	0	515	284	231	81%	0	231	81%
1997 /98	540	30	23	0	547	282	265	94%	0	265	94%
1998 /99	563	31	88	0	506	351	155	44%	0	155	44%
1999 /00	563	0	88	0	475	332	143	43%	15	128	39%
2000 /01	513	0	43	0	470	342	128	37%	0	128	37%
2001 /02	623	0	43	0	580	351	229	65%	0	229	65%
2002 /03	623	0	3	0	620	360	260	72%	0	260	72%
2003 /04	623	0	0	0	623	369	254	69%	0	254	69%
2004 /05	623	0	0	0	623	378	245	65%	0	245	65%
2005 /06	623	0	0	0	623	388	235	61%	0	235	61%
2006 /07	623	0	0	0	623	398	225	57%	0	225	57%
2007 /08	623	0	0	0	623	408	215	53%	0	215	53%
2008 /09	623	0	0	0	623	418	205	49%	0	205	49%

(1) GRU provides reserve margin backup for 3 MW Schedule D contract with the City of Starke.

# Winter Peak Demand and Generation Capacity

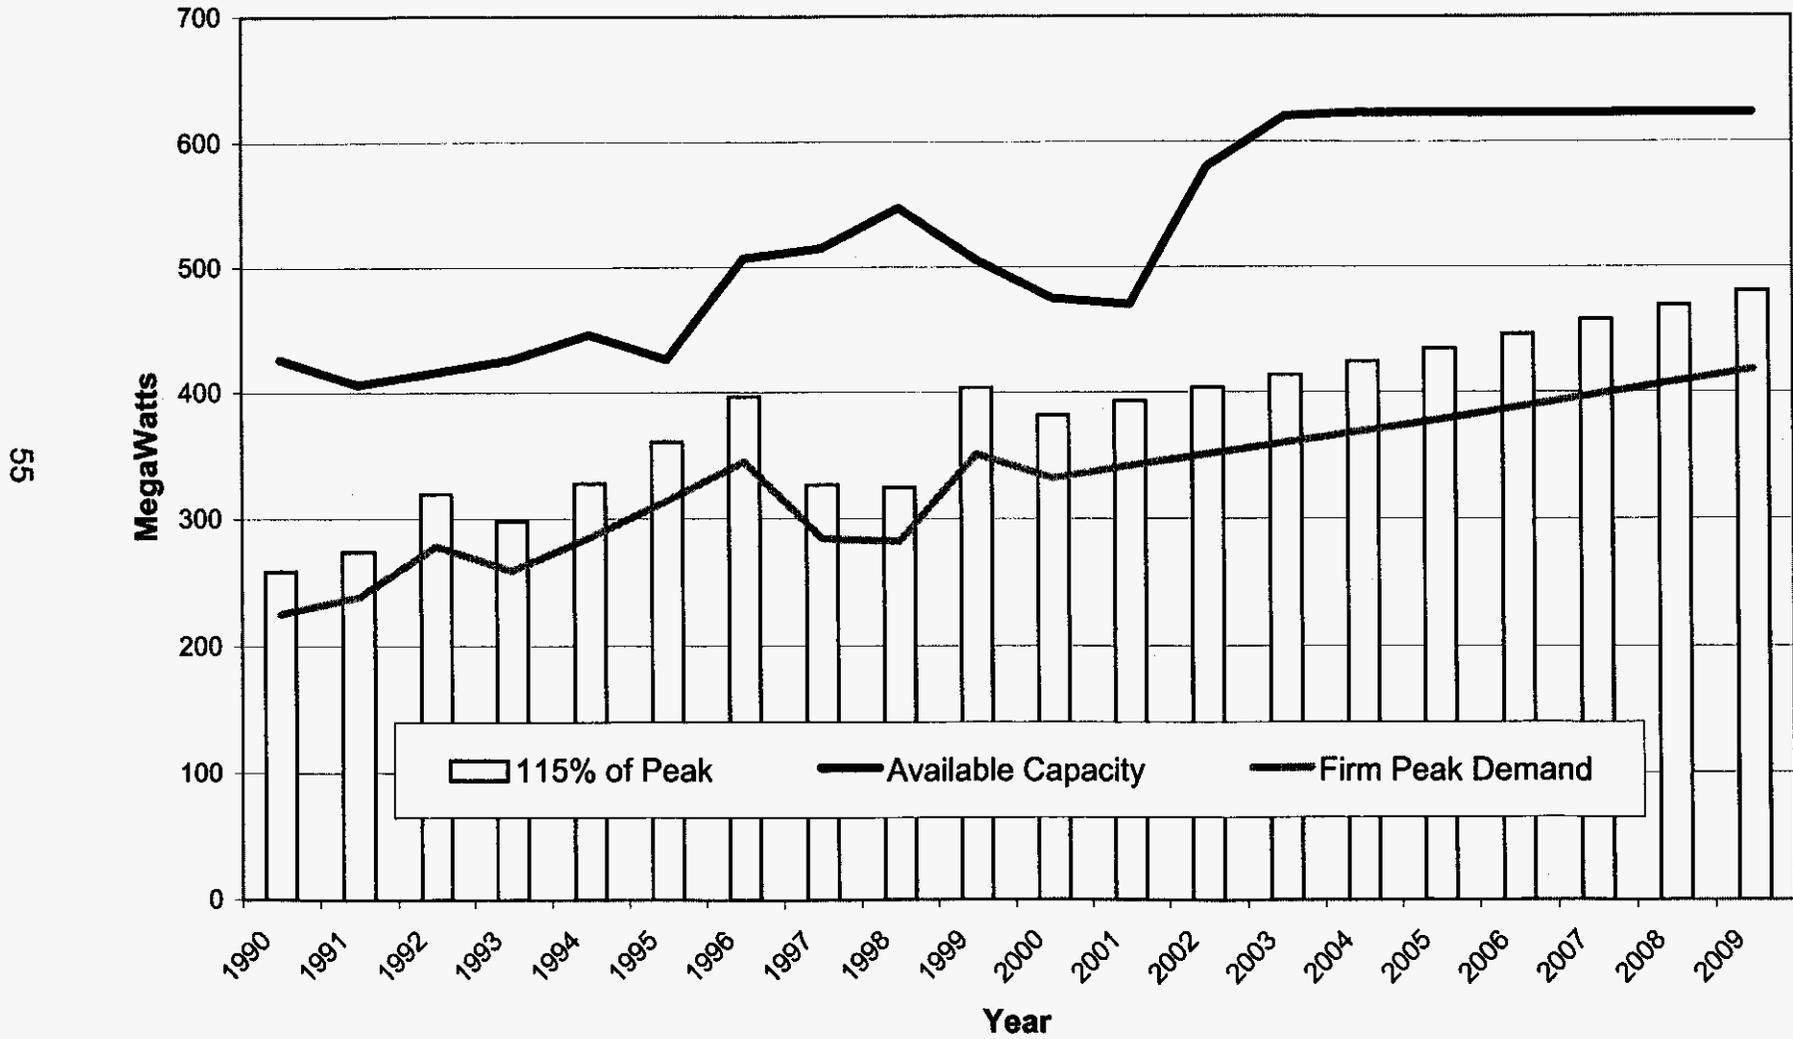

Schedule 8

PLANNED AND PROSPECTIVE GENERATING FACILITY ADDITIONS AND CHANGES

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)
Plant Name	Unit No.	Location	Unit Type	Fuel		Fuel Transport		Const. Start Mo/Yr	Commercial In-Service Mo/Yr	Expected Retirement Mo/Yr	Gen. Max. Nameplate kW	Net Capability		Status
				Pri.	Alt.	Pri.	Alt.					Summer MW	Winter MW	
J. R. Kelly	8	12-001	ST	NG	FO6	PL	TK		4/65	11/00	(50,000)	(50)	(50)	RP <sup>1</sup>
	8	(Alachua Co.,	CW	WH				11/00	2/01		50,000	40	40	RP <sup>2</sup>
	4	Section 4, Township 10 S, Range 20E) (GRU)	CT	NG	FO2	PL	TK	1/00	2/01		96,135	70	70	U <sup>3</sup>

Unit Type	Fuel Type	Transportation Method	Status
ST = Steam	NG = Natural Gas	PL = Pipe Line	RP = Proposed for repowering
CT = Combined Cycle - Combustion Turbine Portion	FO6 = Fuel Oil #6 (Residual)	TK = Truck	U = Under construction, less than 50% complete (based on construction time to first electrical date).
CW = Combined Cycle - Steam Turbine - Waste Heat Boiler Only	FO2 = Fuel Oil #2 (Distillate)		
	WH = Waste Heat		

- Notes: (1) Will be taken out of service September 2, 2000 to begin conversion to heat recovery steam source.  
 (2) To be on line as a Combined-Cycle, February 2001, part of J.R. Kelly CC Unit 1.  
 (3) GE 7EA CT will be Waste Heat Source for J.R. Kelly Unit 8, part of J.R. Kelly CC Unit 1.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

(1) Plant Name and Unit Number:	J.R. Kelly CC1
(2) Capacity	
a. Summer:	110 MW (nominal)
b. Winter:	110 MW (nominal)
(3) Technology Type:	Combined-Cycle
(4) Anticipated Construction Timing	
a. Field construction start-date:	January, 2000
b. Commercial in-service date:	February, 2001
(5) Fuel	
a. Primary fuel:	Natural Gas
b. Alternate fuel:	Fuel Oil #2 (Distillate)
(6) Air Pollution Control Strategy:	Dry Low NOx Burners Water Injection Fuel Specification
(7) Cooling Method:	Closed-Loop Cooling Tower
(8) Total Site Area:	67,000 square feet
(9) Construction Status:	In-Progress
(10) Certification Status:	Not Applicable
(11) Status with Federal Agencies:	Pending
(12) Projected Unit Performance Data	
Planned Outage Factor (POF):	5.75%
Forced Outage Factor (FOF):	1.32%
Equivalent Availability Factor (EAF):	83.61%
Resulting Capacity Factor (%):	52%
Average Net Operating Heat Rate (ANOHR):	~8,000 Btu/kWh
(13) Projected Unit Financial Data	
Book Life (Years):	30
Total Installed Cost (In-Service Year \$/kW):	\$374.50
Direct Construction Cost (\$/kW):	\$68.18
AFUDC Amount (\$/kW):	\$10.70
Escalation:	3.00%
Fixed O&M (\$/kW-Yr):	\$12.80
Variable O&M (\$/MWh):	\$2.90
K Factor:	n/a

## 5. ENVIRONMENTAL AND LAND USE INFORMATION

### 5.1 DESCRIPTION OF POTENTIAL SITES FOR NEW GENERATING FACILITIES

Not applicable.

### 5.2 DESCRIPTION OF PREFERRED SITES FOR NEW GENERATING FACILITIES

Gainesville Regional Utilities is constructing a repowering project at its existing John R. Kelly Generating Station located at 605 SE 3<sup>rd</sup> Street in downtown Gainesville. This site has been used for power generation since 1912.

The project will entail repowering of the existing Unit 8 turbine-generator with a new simple cycle combustion turbine and a heat recovery steam generator. The 110 MW (nominal) unit will operate in a combined cycle mode and will be fired with either natural gas (primary fuel) or distillate oil (backup fuel). The new combined cycle unit is projected to be in commercial service by February 2001.

#### Land Use and Environmental Features

- a. The location of the John R. Kelly Generating Station ("Site") is indicated on Figure 1.
- b. The general layout of the proposed combined cycle unit on the Site is indicated on Figure 2.
- c. Figure 3 provides a photographic depiction of the land use and cover of the existing site and adjacent areas.
- d. The existing land use of the site is industrial; surrounding land uses are primarily residential to the north and east, mixed residential/commercial to the west and industrial to the south.
- e. The site and surrounding areas are highly urbanized and provide little habitat

area with the exception of a large wooded parcel of land to the southwest of the site. Sweetwater Branch, a drainage creek for a large portion of downtown Gainesville, flows through the Site in a concrete culvert that becomes an open channel prior to the creek leaving the Site.

- f. Not applicable.
- g. The City of Gainesville's land use designation for the Site is "public facilities", in reference to GRU. Adjacent areas include a mixture of residential, commercial and industrial land uses. The Site and surrounding area is shown in Figure 3.
- h. This site was selected because it provided for the optimal integration of new and existing generating equipment to meet GRU's future generation needs.
- i. The site is located in the St. John's River Water Management District. The entire District has been designated a water resource caution area. The only surface water resource on the site and adjacent areas is Sweetwater Branch.
- j. There are no notable geologic features on this site or adjacent areas.
- k. No increase in water quantities for potable uses is projected. Cooling water quantities will depend on the operating capacities of the steam generating units. The water allocation in the existing consumptive use permit should be sufficient to accommodate the requirements of the Site in the future. The combined cycle unit will utilize water injection for controlling nitrogen oxide (NOx) emissions only while firing distillate fuel oil. Hence, quantities will depend on the use of this fuel.
- l. Water for potable use and for the NOx control system will be supplied via the City's potable water system. Water will be supplied by an on-site Floridan well for cooling tower make-up. Auxiliary cooling water will be partly once-through, supplied by the City's water system.
- m. Not applicable.
- n. Cooling tower blowdown, low-volume waste and stormwater will continue to be discharged to Sweetwater Branch pursuant to the facility's NPDES permit. No new discharges are projected.
- o. A new fuel unloading facility will be constructed. Several existing bulk residual fuel oil tank systems will be retired because of the reduced usage of this fuel at

the Site.




Air and Noise Emissions

- p. The new unit will be equipped with dry low-NOx combustors and water injection for NOx control while firing natural gas and distillate fuel oil, respectively. Low sulfur, low nitrogen distillate fuel oil will displace the use of residual fuel oil in existing Unit 8 and result in lower sulfur dioxide and particulate matter emission rates while firing fuel oil.
- q. The new unit will be equipped with noise abatement equipment including silencers and an acoustic barrier wall. The predicted noise impact is insignificant.

**5.3 STATUS OF APPLICATION FOR SITE CERTIFICATION**

Not applicable.

Figure 1

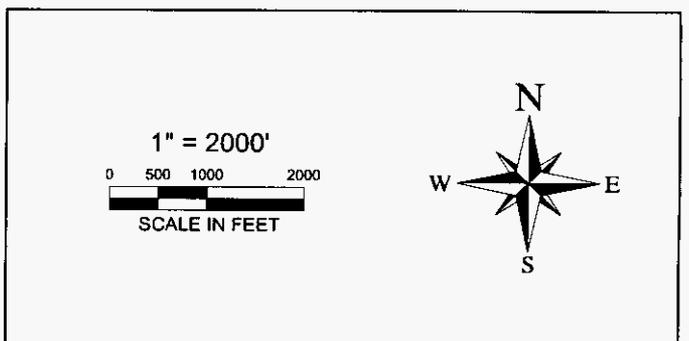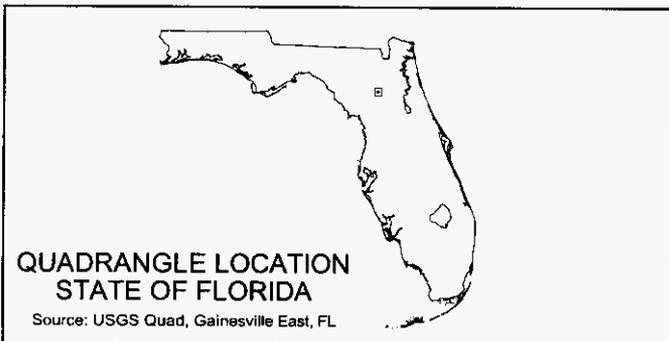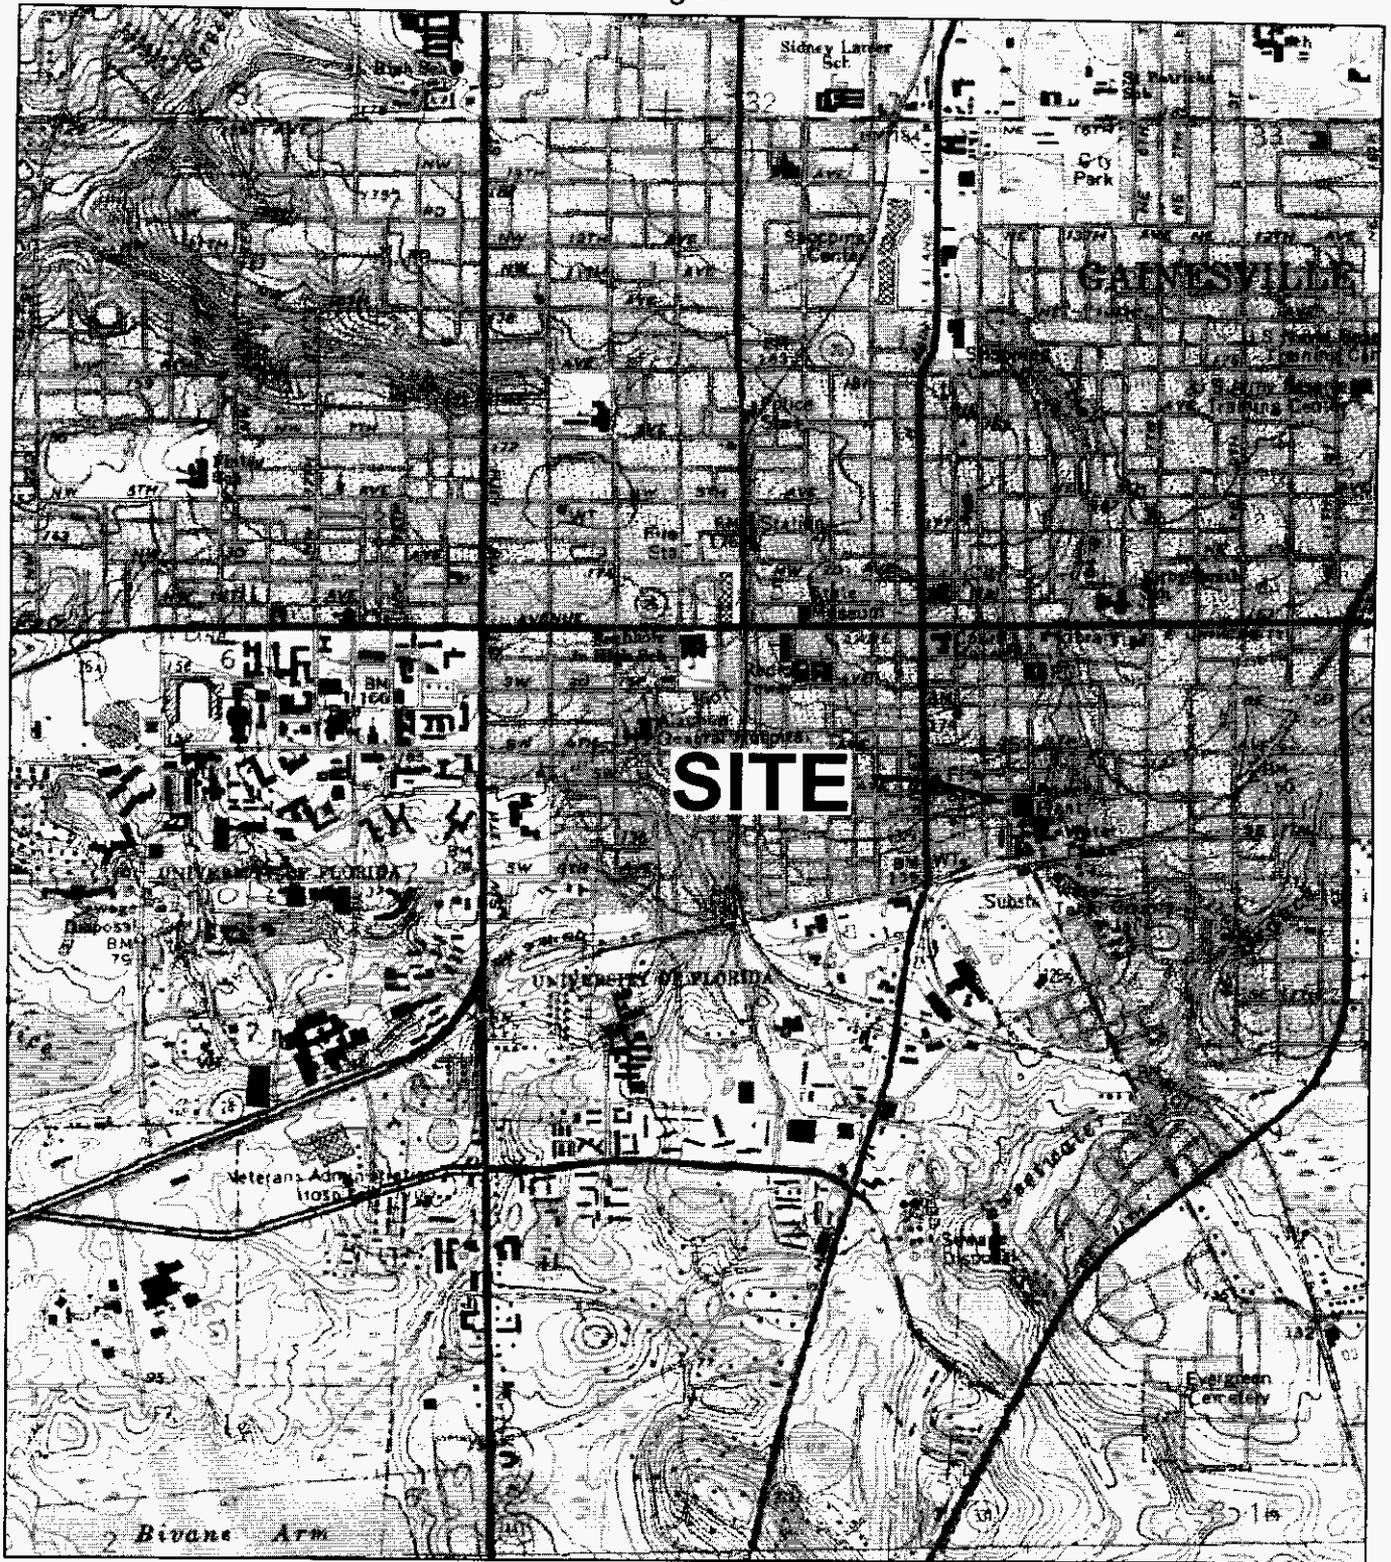

# SITE LAYOUT

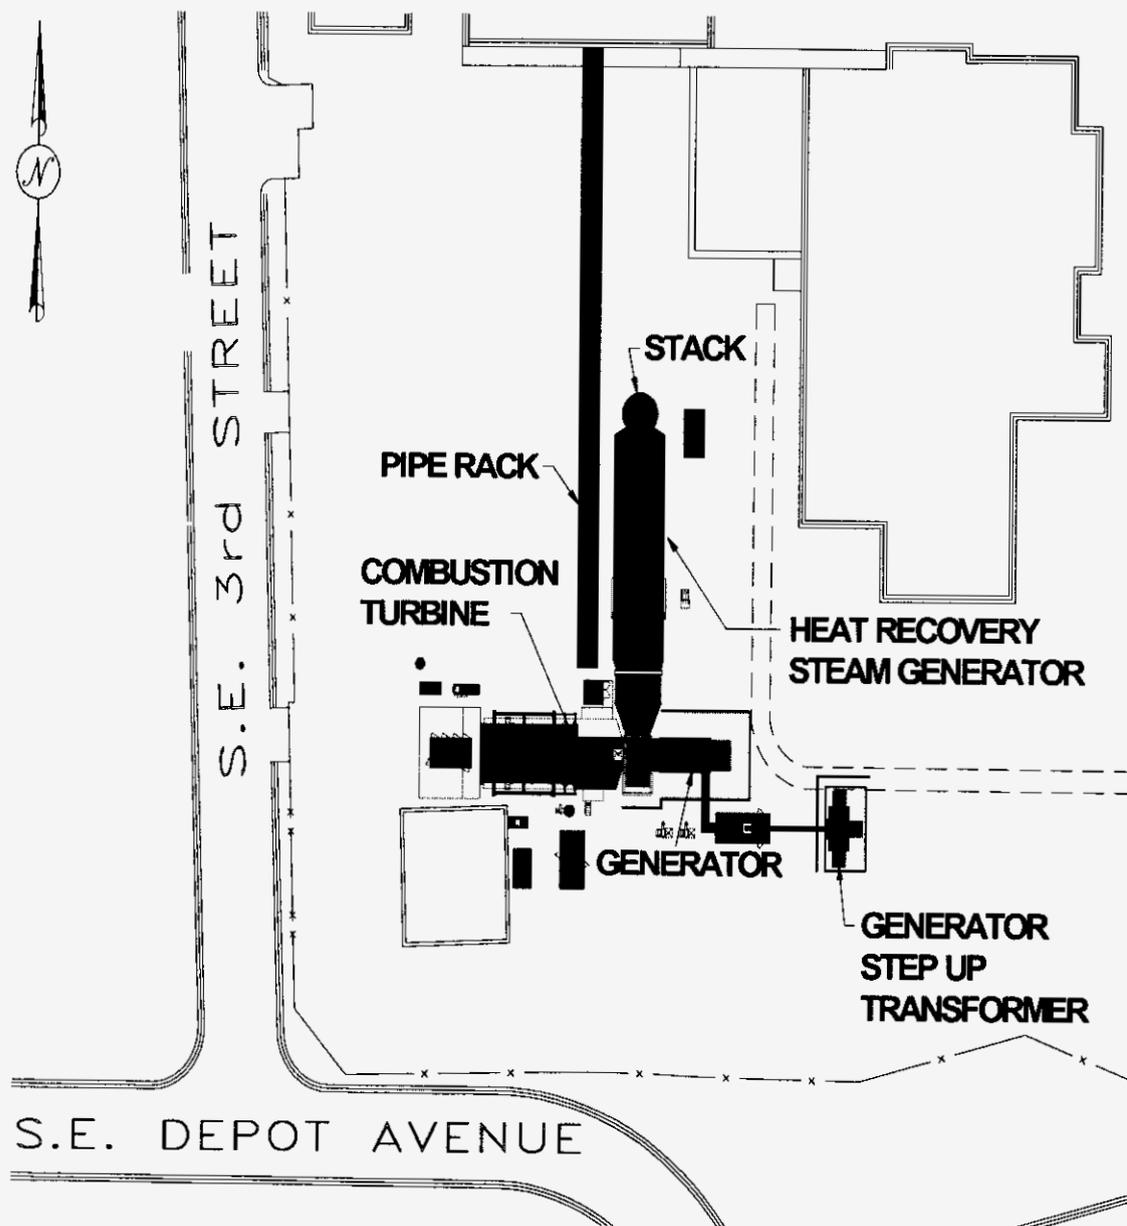


Figure 2