

ORIGINAL

UTILITIES, INC. OF FLORIDA

Docket No. 020271-WS

020071-WS

Response to PSC Request

Dated July 19, 2002

Item 16

Pinellas County

Lake Tarpon

Note: Although letter from Pinellas County Health Department is dated September 7, 2000, the inspection is for the time period ending July, 2001. Letter received by our office September 12, 2001. See copy attached.

AUS _____
CAF _____
CMP _____
COM _____
CTR _____
ECR _____
GCL _____
OPC _____
MMS _____
SEC _____
OTH _____

DOCUMENT NUMBER-DATE

09250 SEP-3 8

FPSC-COMMISSION CLERK

PINELLAS COUNTY HEALTH DEPARTMENT

ROUTE: DR *DK*

PF *PK*

19.1.637



John O. Agwunobi, M.D., M.B.A
Acting Secretary

Jeb Bush
Governor

September 7, 2000

Donald Rasmussen, Vice President
Utilities, Inc. of Florida
200 Weathersfield Avenue
Altamonte Springs, FL 32714

JW

RE: **PUBLIC WATER SYSTEM ANNUAL INSPECTION**
Lake Tarpon Mobile Home Village.
PWSID # 6521000

Dear Mr. Rasmussen:

This letter is to notify you that the Pinellas County Health Department, Environmental Engineering Division has completed the annual inspection of your Lake Tarpon Mobile Home Village Public Water System as of the end of July 2001. During the inspection it was noted that your operator personnel have been diligently working toward maintaining and operating the system in full accordance with applicable Florida Administrative Code. The water system's equipment (i.e. well pump, gas chlorine disinfection system and other associated equipment) was found to be in generally good repair and operational order.

Please continue to insure that all the testable back-flow prevention devices are checked annually by state certified back-flow personnel and provide the test results to our office confirming such. We wish to thank you and your staff for the cooperation we have received and encourage you to continue your fine operation. If you have any questions or if we can ever be of any assistance to you please contact our office.

Sincerely,

David H. Hansen

David H. Hansen
Environmental Specialist II
Environmental Engineering Division


D. Wayne Wyatt
D. Wayne Wyatt, Assistant Director, Environmental Engineering Division
Steve Habrey, Operator, Lake Tarpon MHV

(2)


Lake Tarpon MHV Water Treatment Plant




Hydropneumatic Water Tank

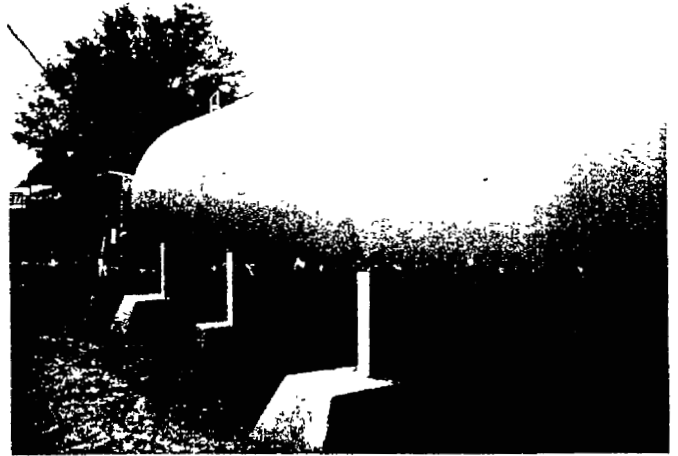

Turbine Well Pump and check valve

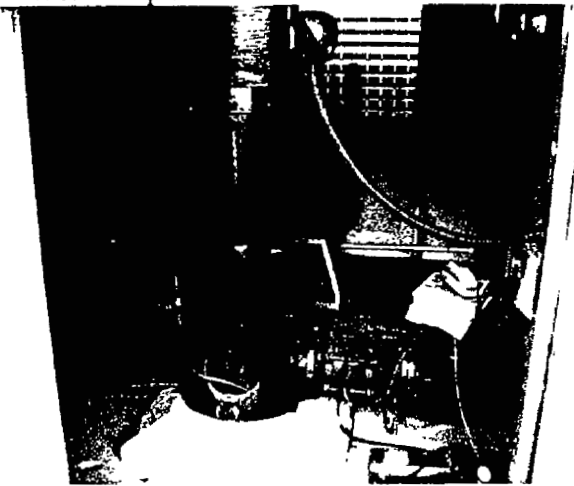


Influent line on right, effluent line from tank on left

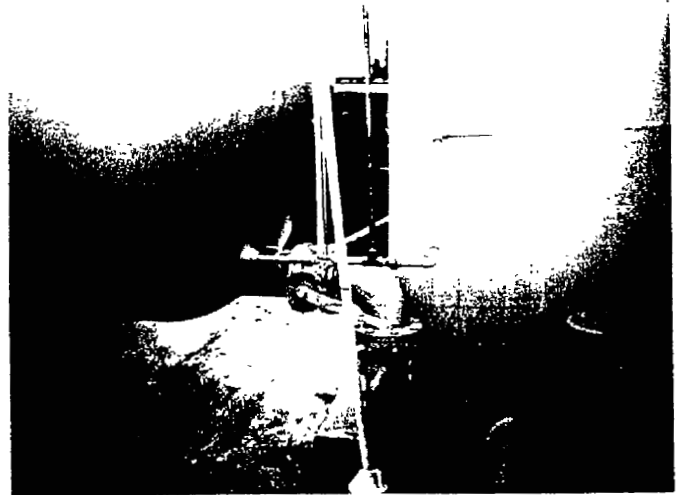


Raw Sample Tap




Water Meter

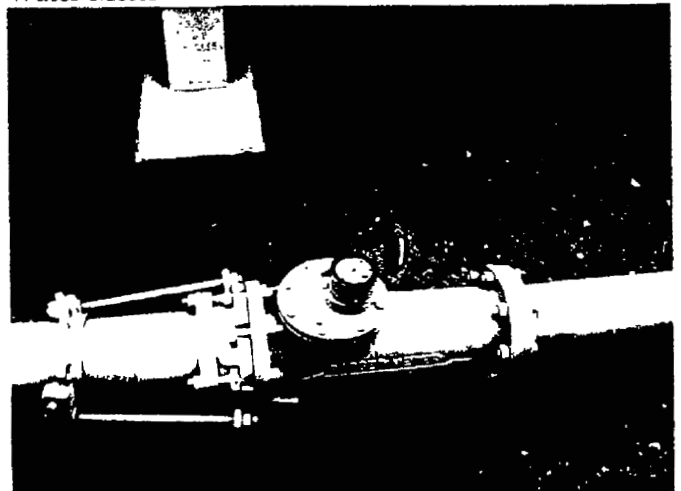

North influent end of tank

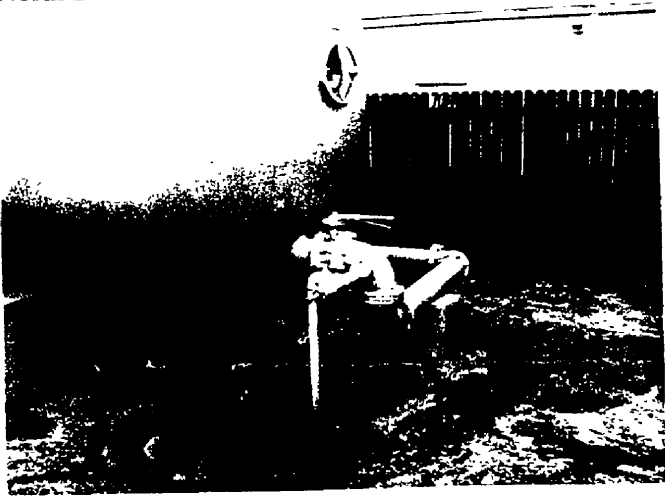

Chlorine Room and Scales

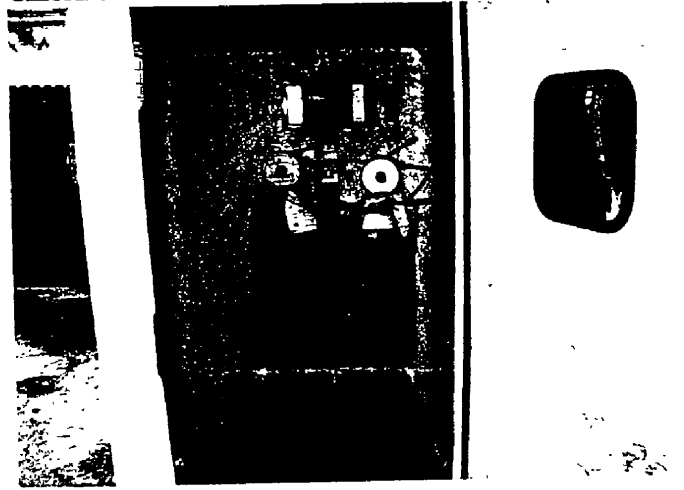


South effluent end of tank



Extra chlorine gas cylinders chained




Pressure relief valve

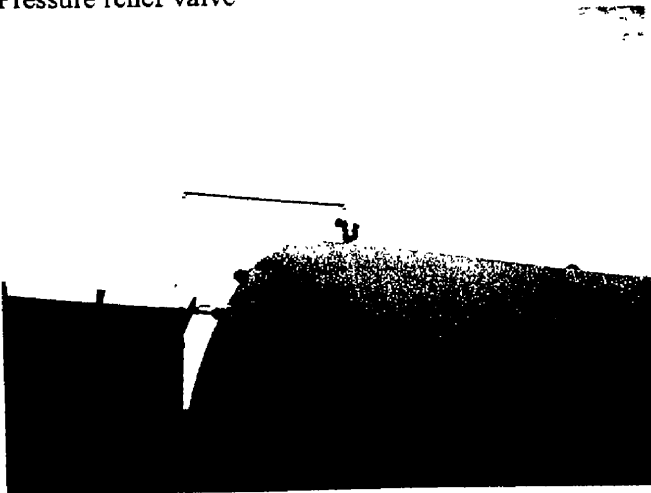

Chlorine gas feed roto meter



Scales

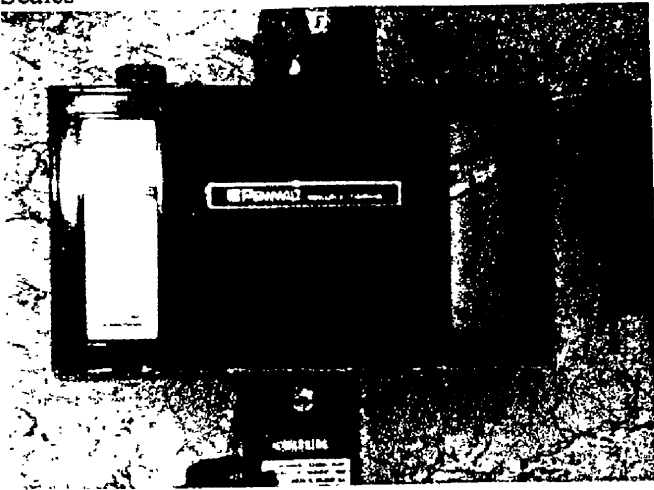

Lost of disinfection auto dialer



Lost of disinfection Alarm

