

Progress Energy Florida Ten-Year Site Plan

April 2005

2005-2014

Submitted to:
Florida Public Service Commission



TABLE OF CONTENTS

	Page
List of Required Schedules.....	i
List of Tables and Figures.....	ii
Code Identification Sheet.....	iii
Introduction.....	1
<u>CHAPTER 1 DESCRIPTION OF EXISTING FACILITIES</u>	
Existing Facilities Overview.....	1-1
Service Area Map (Figure 1.1).....	1-3
Electric System Map (Figure 1.2).....	1-4
Existing Generating Facilities (Schedule 1).....	1-5
<u>CHAPTER 2 FORECAST OF ELECTRIC POWER DEMAND AND ENERGY CONSUMPTION</u>	
Overview.....	2-1
Energy Consumption and Demand Forecast Schedules.....	2-3
History and Forecast of Energy Consumption and Number of Customers by Customer Class (Sch. 2.1-2.3)....	2-4
History and Forecast of Base, High, and Low Summer Peak Demand (MW) (Sch. 3.1.1-3.1.3).....	2-7
History and Forecast of Base, High, and Low Winter Peak Demand (MW) (Sch. 3.2.1-3.2.3).....	2-10
History and Forecast of Base, High, and Low Annual Net Energy for Load (GWh) (Sch. 3.3.1-3.3.3).....	2-13
Previous Year Actual and Two-Year Forecast of Peak Demand and Net Energy for Load by Month (Sch. 4)...	2-16
Fuel Requirements and Energy Sources.....	2-17
Fuel Requirements (Sch. 5).....	2-18
Energy Sources (GWh) (Sch. 6.1).....	2-19
Energy Sources (Percent) (Sch. 6.2).....	2-20
Forecasting Methods and Procedures.....	2-21
Introduction.....	2-21
Forecast Assumptions.....	2-21
Customer, Energy, and Demand Forecast (Figure 2.1).....	2-22
General Assumptions.....	2-23
Short-Term Economic Assumptions.....	2-25
Long-Term Economic Assumptions.....	2-26
Forecast Methodology.....	2-28
Energy and Customer Forecast.....	2-28
Peak Demand Forecast.....	2-32
High and Low Forecast Scenarios.....	2-34

Conservation Goals	2-35
Residential Programs.....	2-36
Commercial/Industrial (C/I) Programs.....	2-37
Research and Development Programs	2-40

CHAPTER 3 FORECAST OF FACILITIES REQUIREMENTS

Resource Planning Forecast.....	3-1
Overview of Current Forecast.....	3-1
Total Capacity Resources Of Power Plants and Purchased Power Contracts (Table 3.1).....	3-4
Qualifying Facility Generation Contracts (Table 3.2).....	3-5
Forecast of Capacity, Demand and Scheduled Maintenance at Time of Summer Peak (Sch. 7.1).....	3-6
Forecast of Capacity, Demand and Scheduled Maintenance at Time of Winter Peak (Sch. 7.2).....	3-7
Planned and Prospective Generating Facility Additions and Changes (Sch. 8).....	3-8
Status Report and Specifications of Proposed Generating Facilities (Sch. 9).....	3-9
Status Report and Specifications of Proposed Directly Associated Transmission Lines (Sch. 10).....	3-16
Integrated Resource Planning Overview.....	3-18
IRP Process Overview (Figure 3.1).....	3-19
The IRP Process.....	3-20
Key Corporate Forecasts.....	3-23
Current Planning Results.....	3-24
Transmission Planning.....	3-24
List of Proposed Bulk Transmission Line Additions (Table 3.3).....	3-26

CHAPTER 4 ENVIRONMENTAL AND LAND USE INFORMATION

Preferred Sites.....	4-1
Hines Energy Complex Site.....	4-2
Hines Energy Complex Site (Polk County) (Figure 4.1).....	4-4
Intercession City Site.....	4-5
Intercession City Site (Osceola County) (Figure 4.2).....	4-6
DeBary Site.....	4-7
DeBary Site (Volusia County) (Figure 4.3).....	4-8
Anclote Site.....	4-9
Anclote Site (Pasco County) (Figure 4.4).....	4-10
Bartow Site.....	4-11
Bartow Site (Pinellas County) (Figure 4.5).....	4-12

LIST OF REQUIRED SCHEDULES

<u>Schedule</u>	<u>Page</u>
1 Existing Generating Facilities.....	1-5
2.1 History and Forecast of Energy Consumption and Number of Customers by Customer Class (Rural and Residential and Commercial).....	2-4
2.2 History and Forecast of Energy Consumption and Number of Customers by Customer Class (Industrial and Other).....	2-5
2.3 History and Forecast of Energy Consumption and Number of Customers by Customer Class (Net Energy for Load).....	2-6
3.1.1 History and Forecast of Summer Peak Demand (MW) - Base Case.....	2-7
3.1.2 History and Forecast of Summer Peak Demand (MW) - High Load Forecast.....	2-8
3.1.3 History and Forecast of Summer Peak Demand (MW) - Low Load Forecast.....	2-9
3.2.1 History and Forecast of Winter Peak Demand (MW) - Base Case.....	2-10
3.2.2 History and Forecast of Winter Peak Demand (MW) - High Load Forecast.....	2-11
3.2.3 History and Forecast of Winter Peak Demand (MW) - Low Load Forecast.....	2-12
3.3.1 History and Forecast of Annual Net Energy for Load (GWh) - Base Case.....	2-13
3.3.2 History and Forecast of Annual Net Energy for Load (GWh) - High Load Forecast.....	2-14
3.3.3 History and Forecast of Annual Net Energy for Load (GWh) -Low Load Forecast.....	2-15
4 Previous Year Actual and Two-Year Forecast of Peak Demand and Net Energy for Load by Month.....	2-16
5 Fuel Requirements.....	2-18
6.1 Energy Sources (GWh).....	2-19
6.2 Energy Sources (Percent).....	2-20
7.1 Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Summer Peak.....	3-6
7.2 Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Winter Peak.....	3-7
8 Planned and Prospective Generating Facility Additions and Changes	3-8
9 Status Report and Specifications of Proposed Generating Facilities	3-9
10 Status Report and Specifications of Proposed Directly Associated Transmission Lines	3-16

**LIST OF
TABLES AND FIGURES**

<u>Tables</u>	<u>Page</u>
3.1 Total Capacity Resources of Power Plants and Purchased Power Contracts.....	3-4
3.2 Qualifying Facility Generation Contracts.....	3-5
3.3 List of Proposed Bulk Transmission Line Additions.....	3-26

<u>Figures</u>	<u>Page</u>
1.1 Service Area Map.....	1-3
1.2 Electric System Map.....	1-4
2.1 Customer, Energy, and Demand Forecast.....	2-22
3.1 IRP Process Overview.....	3-19
4.1 Hines Energy Complex Site (Polk County).....	4-4
4.2 Intercession City Site (Osceola County).....	4-6
4.3 DeBary Site (Volusia County).....	4-8
4.4 Anclote Site (Pasco County).....	4-10
4.5 Bartow Site (Pinellas County).....	4-12

CODE IDENTIFICATION SHEET

Generating Unit Type

ST - Steam Turbine - Non-Nuclear
NP - Steam Power - Nuclear
GT - Gas Turbine (Combustion Turbine)
CC - Combined-cycle
SPP - Small Power Producer
COG - Cogeneration Facility

Fuel Type

NUC - Nuclear (Uranium)
NG - Natural Gas
RFO - No. 6 Residual Fuel Oil
DFO - No. 2 Distillate Fuel Oil
BIT - Bituminous Coal
MSW - Municipal Solid Waste
WH - Waste Heat
BIO - Biomass

Fuel Transportation

WA - Water
TK - Truck
RR - Railroad
PL - Pipeline
UN - Unknown

Future Generating Unit Status

A - Generating unit capability increased
FC - Existing generator planned for conversion to another fuel or energy source
P - Planned for installation but not authorized; not under construction
RP - Proposed for repowering or life extension
RT - Existing generator scheduled for retirement
T - Regulatory approval received but not under construction
U - Under construction, less than or equal to 50% complete
V - Under construction, more than 50% complete

This page intentionally left blank

INTRODUCTION

Section 186.801 of the Florida Statutes requires electric generating utilities to submit a Ten-Year Site Plan (TYSP) to the Florida Public Service Commission (FPSC). The TYSP includes historical and projected data pertaining to the utility's load and resource needs as well as a review of those needs. It is compiled in accordance with FPSC Rules 25-22.070 through 25.072, Florida Administrative Code.

Progress Energy Florida's (PEF's) TYSP is based on projections of long-term planning requirements that are dynamic in nature and subject to change. These planning documents should be used for general guidance concerning PEF's planning assumptions and projections, and should not be taken as an assurance that particular events discussed in the TYSP will materialize or that particular plans will be implemented. Information and projections pertinent to periods further out in time are inherently subject to greater uncertainty.

The TYSP document contains four chapters as described below:

CHAPTER 1

DESCRIPTION OF EXISTING FACILITIES

CHAPTER 2

FORECAST OF ELECTRICAL POWER DEMAND AND ENERGY CONSUMPTION

CHAPTER 3

FORECAST OF FACILITIES REQUIREMENTS

CHAPTER 4

ENVIRONMENTAL AND LAND USE INFORMATION

This page intentionally left blank

CHAPTER 1

*DESCRIPTION OF
EXISTING FACILITIES*



This page intentionally left blank

CHAPTER 1
DESCRIPTION OF EXISTING FACILITIES

EXISTING FACILITIES OVERVIEW

OWNERSHIP

Progress Energy Florida (PEF) is a wholly owned subsidiary of Progress Energy, Inc. (Progress Energy), a registered holding company under the Public Utility Holding Company Act (PUHCA) of 1935. Progress Energy and its subsidiaries, including PEF, are subject to the regulatory provisions of the PUHCA. Progress Energy is the parent company of PEF and certain other subsidiaries.

AREA OF SERVICE

PEF provided electric service during 2004 to an average of 1.5 million customers in Florida. Its service area covers approximately 20,000 square miles and includes the densely populated areas around Orlando, as well as the cities of St. Petersburg and Clearwater. PEF is interconnected with 21 municipal and 9 rural electric cooperative systems. PEF is subject to the rules and regulations of the Federal Energy Regulatory Commission (FERC) and the Florida Public Service Commission (FPSC). PEF's Service Area is shown in Figure 1.1.

TRANSMISSION/DISTRIBUTION

At December 31, 2004, PEF had approximately 5,000 circuit miles of transmission lines including 200 miles of 500 kV lines and about 1,500 miles of 230 kV lines, 22,000 circuit miles of overhead distribution conductor and 13,000 circuit miles of underground distribution cable. Distribution and transmission substations in service had a transformer capacity of approximately 45,000,000 kVA in 616 transformers. Distribution line transformers numbered approximately 365,000 with an aggregate capacity of approximately 18,000,000 kVA. A map of the Electric System can be found in Figure 1.2.

ENERGY MANAGEMENT


PEF customers participating in the company's residential Energy Management program are managing future growth and costs. Approximately 361,000 customers participated in the Energy

Management program at the end of the year, contributing about 725,000 kW of winter peak-shaving capacity for use during high load periods.

TOTAL CAPACITY RESOURCE

As of December 31, 2004, PEF had total summer capacity resources of approximately 9,769 MW consisting of installed capacity of 8,475 MW (excluding Crystal River 3 joint ownership) and 1,294 MW of firm purchased power. Additional information on PEF's existing generating resources is shown on Schedule 1 and Table 3.1.

FIGURE 1.1
PROGRESS ENERGY FLORIDA
Service Area Map

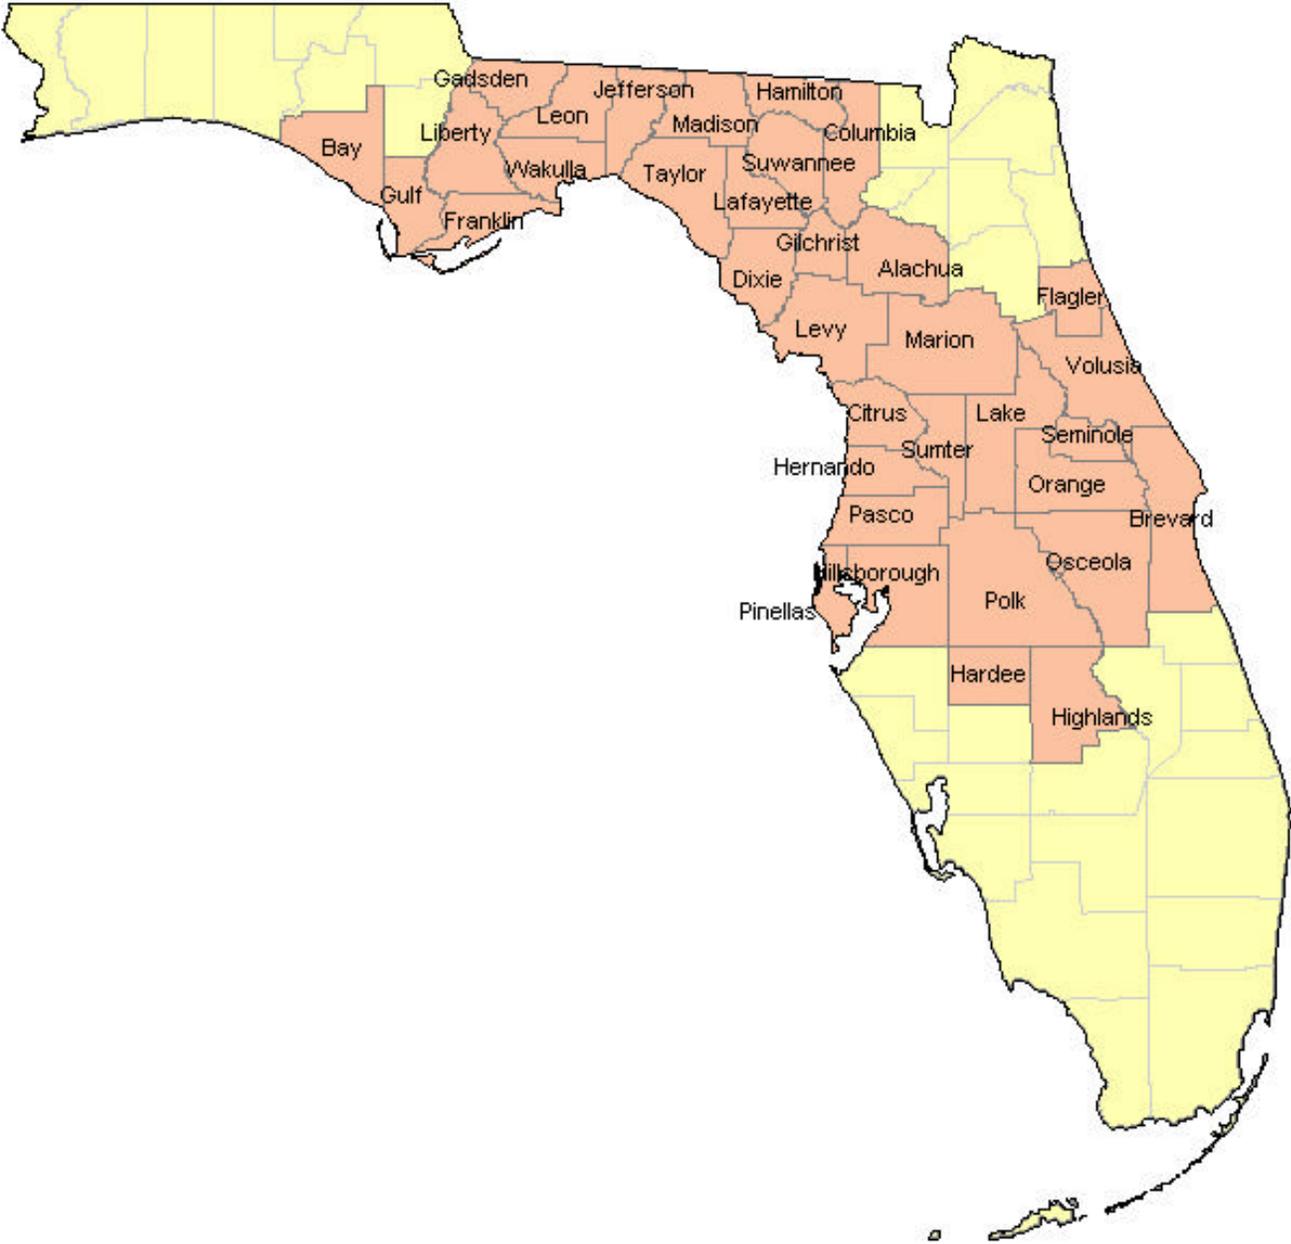

PROGRESS ENERGY FLORIDA

SCHEDULE 1

EXISTING GENERATING FACILITIES

AS OF DECEMBER 31, 2004

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)
PLANT NAME	UNIT NO.	LOCATION (COUNTY)	UNIT TYPE	FUEL PRI.	FUEL ALT.	FUEL PRI.	TRANSPORT ALT.	ALT. FUEL DAYS USE	COM'L IN-SERVICE MO./YEAR	EXPECTED RETIREMENT MO./YEAR	GEN. MAX. NAMEPLATE KW	SUMMER CAPABILITY MW	NET CAPABILITY WINTH MW
STEAM													
ANCLOTE	1	PASCO	ST	RFO	NG	PL	PL		10/74		556,200	498	522
ANCLOTE	2	PASCO	ST	RFO	NG	PL	PL		10/78		556,200	495	522
BARTOW	1	PINELLAS	ST	RFO		WA			09/58		127,500	121	123
BARTOW	2	PINELLAS	ST	RFO		WA			08/61		127,500	119	121
BARTOW	3	PINELLAS	ST	RFO	NG	WA	PL		07/63		239,360	204	208
CRYSTAL RIVER	1	CITRUS	ST	BIT		WA,RR			10/66		440,550	379	383
CRYSTAL RIVER	2	CITRUS	ST	BIT		WA,RR			11/69		523,800	486	491
CRYSTAL RIVER	3 *	CITRUS	ST	NUC		TK			03/77		890,460	769	788
CRYSTAL RIVER	4	CITRUS	ST	BIT		WA,RR			12/82		739,260	720	735
CRYSTAL RIVER	5	CITRUS	ST	BIT		WA,RR			10/84		739,260	717	732
SUWANNEE RIVER	1	SUWANNEE	ST	RFO	NG	TK	PL		11/53		34,500	32	33
SUWANNEE RIVER	2	SUWANNEE	ST	RFO		TK			11/54		37,500	31	32
SUWANNEE RIVER	3	SUWANNEE	ST	RFO	NG	TK	PL		10/56		75,000	80	81
												4,651	4,771
COMBINED-CYCLE													
HINES ENERGY COMPLEX	1	POLK	CC	NG	DFO	PL	TK	6	04/99		546,550	482	529
HINES ENERGY COMPLEX	2	POLK	CC	NG	DFO	PL	TK	6	12/03		598,000	516	582
TIGER BAY	1	POLK	CC	NG		PL			08/97		278,223	207	223
												1,205	1,334
COMBUSTION TURBINE													
AVON PARK	P1	HIGHLANDS	GT	NG	DFO	PL	TK	3	12/68		33,790	26	32
AVON PARK	P2	HIGHLANDS	GT	DFO		TK			12/68		33,790	26	32
BARTOW	P1, P3	PINELLAS	GT	DFO		WA			5/72-6/72		111,400	92	106
BARTOW	P2	PINELLAS	GT	NG	DFO	PL	WA	8	06/72		55,700	46	53
BARTOW	P4	PINELLAS	GT	NG	DFO	PL	WA	8	06/72		55,700	49	60
BAYBORO	P1-P4	PINELLAS	GT	DFO		WA,TK			04/73		226,800	184	232
DEBARY	P1-P6	VOLUSIA	GT	DFO		TK			12/75-04/76		401,220	324	390
DEBARY	P7-P9	VOLUSIA	GT	NG	DFO	PL	TK	8	10/92		345,000	258	279
DEBARY	P10	VOLUSIA	GT	DFO		TK			10/92		115,000	85	93
HIGGINS	P1-P2	PINELLAS	GT	NG	DFO	PL	TK		03/69-04/69		67,580	54	64
HIGGINS	P3-P4	PINELLAS	GT	NG	DFO	PL	TK	1	12/70-01/71		85,850	68	70
INTERCESSION CITY	P1-P6	OSCEOLA	GT	DFO		PL,TK			05/74		340,200	294	366
INTERCESSION CITY	P7-P10	OSCEOLA	GT	NG	DFO	PL	PL,TK	5	10/93		460,000	352	376
INTERCESSION CITY	P11 **	OSCEOLA	GT	DFO		PL,TK			01/97		165,000	143	170
INTERCESSION CITY	P12-P14	OSCEOLA	GT	NG	DFO	PL	PL,TK	5	12/00		345,000	252	294
RIO PINAR	P1	ORANGE	GT	DFO		TK			11/70		19,290	13	16
SUWANNEE RIVER	P1	SUWANNEE	GT	NG	DFO	PL	TK	10	10/80		61,200	55	67
SUWANNEE RIVER	P2	SUWANNEE	GT	DFO		TK			10/80		61,200	54	67
SUWANNEE RIVER	P3	SUWANNEE	GT	NG	DFO	PL	TK	10	11/80		61,200	55	67
TURNER	P1-P2	VOLUSIA	GT	DFO		TK			10/70		38,580	26	32
TURNER	P3	VOLUSIA	GT	DFO		TK			08/74		71,200	65	82
TURNER	P4	VOLUSIA	GT	DFO		TK			08/74		71,200	63	80
UNIV. OF FLA.	P1	ALACHUA	GT	NG		PL			01/94		43,000	35	41
												2,619	3,069
* REPRESENTS APPROXIMATELY 91.8% PEF OWNERSHIP OF UNIT													
** SUMMER CAPABILITY (JUNE THROUGH SEPTEMBER) OWNED BY GEORGIA POWER COMPANY													
											TOTAL RESOURCES (MW)	8,475	9,174

This page intentionally left blank

CHAPTER 2

*FORECAST OF
ELECTRIC POWER DEMAND
AND ENERGY CONSUMPTION*



This page intentionally left blank

CHAPTER 2
FORECAST OF ELECTRIC POWER DEMAND
AND
ENERGY CONSUMPTION

OVERVIEW

The following Schedules 2, 3 and 4 represent PEF's history and forecast of customers, energy sales (GWh), and peak demand (MW). High and low scenarios are also presented for sensitivity purposes.

The base case was developed using assumptions to predict a forecast with a 50/50 probability, or most likely scenario. The high and low scenarios, which have a 90/10 probability of occurrence or an 80 percent probability of an outcome falling between the high and low cases, employed a Monte Carlo simulation procedure that studied 1,000 possible outcomes of retail demand and energy.

PEF's customer growth is expected to average 1.7 percent between 2005 and 2014, less than the ten-year historical average of 2.2 percent. The ten-year historical growth rate falls to 2.0 percent when accounting for the creation of PEF's Seasonal Service Rate tariff, which artificially inflates customer growth figures. Slower population growth -- based on the latest projection from the University of Florida's Bureau of Economic and Business Research -- and economic conditions less favorable for the housing/construction industry result in a lower base case customer projection when compared to the higher historical growth rate. This translates into lower projected energy and demand growth rates from historic rate levels.

Net energy for load (NEL), which had grown at an average of 3.3 percent between 1995 and 2004, is expected to increase by 2.5 percent per year from 2005-2014 in the base case, 2.8 percent in the high case and 2.2 percent in the low case. A lower contribution from the wholesale jurisdiction, which grew an average of 9.9 percent between 1995 and 2004, results in lower expected system growth going forward than the historic rate. Retail NEL, which grew at a

2.9 percent average rate historically, is expected to grow 2.6 percent over the next ten years. Wholesale NEL is expected to average just 1.4 percent between 2005 and 2014.

Summer net firm demand is expected to grow an average of 2.9 percent per year during the next ten years. This matches the average annual growth rate experienced throughout the last ten years. High and low summer growth rates for net firm demand are 3.2 percent and 2.6 percent per year, respectively. Winter net firm demand is projected to grow at 2.8 percent per year after having declined by 0.3 percent per year from 1995 to 2004. The low historical growth figure is driven by a mild weather peak day in 2004. High and low winter net firm demand growth rates are 3.1 percent and 2.5 percent, respectively.

Summer net firm retail demand is expected to grow an average of 2.4 percent per year during the next ten years; this compares to the 3.6 percent average annual growth rate experienced throughout the last ten years. High and low summer growth rates for net firm retail demand are 2.8 percent and 2.1 percent per year, respectively. Winter net firm retail demand is projected to grow at approximately 2.1 percent per year after having remained flat from 1995 to 2004. Again, a mild 2004 peak day causes this anomaly. High and low winter net firm retail demand growth rates are 2.5 percent and 1.8 percent, respectively.

ENERGY CONSUMPTION AND DEMAND FORECAST SCHEDULES

<u>SCHEDULE</u>	<u>DESCRIPTION</u>
2.1, 2.2 and 2.3	History and Forecast of Energy Consumption and Number of Customers by Customer Class
3.1.1, 3.1.2 and 3.1.3	History and Forecast of Base, High and Low Summer Peak Demand (MW)
3.2.1, 3.2.2 and 3.2.3	History and Forecast of Base, High, and Low Winter Peak Demand (MW)
3.3.1, 3.3.2 and 3.3.3	History and Forecast of Base, High and Low Annual Net Energy for Load (GWh)
4	Previous Year Actual and Two-Year Forecast of Peak Demand and Net Energy for Load by Month

PROGRESS ENERGY FLORIDA

SCHEDULE 2.1
HISTORY AND FORECAST OF ENERGY CONSUMPTION AND
NUMBER OF CUSTOMERS BY CUSTOMER CLASS

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
RURAL AND RESIDENTIAL						COMMERCIAL		
YEAR	PEF POPULATION	MEMBERS PER HOUSEHOLD	GWh	AVERAGE NO. OF CUSTOMERS	AVERAGE KWh CONSUMPTION PER CUSTOMER	GWh	AVERAGE NO. OF CUSTOMERS	AVERAGE KWh CONSUMPTION PER CUSTOMER
1995	2,801,105	2.491	14,938	1,124,679	13,282	8,612	126,189	68,247
1996	2,847,802	2.494	15,481	1,141,671	13,560	8,848	129,440	68,356
1997	2,895,266	2.495	15,080	1,160,611	12,993	9,257	132,504	69,862
1998	2,959,509	2.502	16,526	1,182,786	13,972	9,999	136,345	73,336
1999	3,047,293	2.511	16,245	1,213,470	13,387	10,327	140,897	73,295
2000	3,044,449	2.467	17,116	1,234,286	13,867	10,813	143,475	75,368
2001	3,141,867	2.465	17,604	1,274,672	13,810	11,061	146,983	75,251
2002	3,207,661	2.465	18,754	1,301,515	14,409	11,420	150,577	75,842
2003	3,286,782	2.468	19,429	1,331,914	14,587	11,553	154,294	74,876
2004	3,348,630	2.454	19,347	1,364,677	14,177	11,734	158,780	73,898
2005	3,397,566	2.449	20,069	1,387,564	14,464	12,521	161,148	77,701
2006	3,457,712	2.447	20,602	1,412,969	14,581	12,998	164,319	79,101
2007	3,517,107	2.445	21,139	1,438,524	14,695	13,440	167,509	80,235
2008	3,581,336	2.446	21,669	1,463,871	14,803	13,861	170,672	81,212
2009	3,645,405	2.448	22,201	1,489,119	14,909	14,296	173,820	82,244
2010	3,702,998	2.446	22,742	1,514,200	15,019	14,736	176,945	83,281
2011	3,757,423	2.441	23,288	1,539,080	15,131	15,196	180,043	84,404
2012	3,809,526	2.436	23,837	1,563,793	15,243	15,663	183,119	85,533
2013	3,853,021	2.426	24,394	1,588,391	15,358	16,135	186,180	86,662
2014	3,891,403	2.413	24,959	1,612,925	15,475	16,613	189,232	87,790

PROGRESS ENERGY FLORIDA

SCHEDULE 2.2

HISTORY AND FORECAST OF ENERGY CONSUMPTION AND
NUMBER OF CUSTOMERS BY CUSTOMER CLASS

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)
	INDUSTRIAL						
YEAR	GWh	AVERAGE NO. OF CUSTOMERS	AVERAGE KWh CONSUMPTION PER CUSTOMER	RAILROADS AND RAILWAYS GWh	STREET & HIGHWAY LIGHTING GWh	OTHER SALES TO PUBLIC AUTHORITIES GWh	TOTAL SALES TO ULTIMATE CONSUMERS GWh
1995	3,864	3,143	1,229,399	0	27	2,058	29,499
1996	4,224	2,927	1,443,116	0	26	2,205	30,784
1997	4,188	2,830	1,479,859	0	27	2,299	30,851
1998	4,375	2,707	1,616,180	0	27	2,459	33,386
1999	4,334	2,629	1,648,536	0	27	2,509	33,442
2000	4,249	2,535	1,676,134	0	28	2,626	34,832
2001	3,872	2,551	1,517,836	0	28	2,698	35,263
2002	3,835	2,535	1,512,821	0	28	2,822	36,859
2003	4,001	2,643	1,513,810	0	29	2,946	37,957
2004	4,069	2,733	1,488,840	0	28	3,016	38,193
2005	4,403	2,813	1,565,205	0	28	3,264	40,286
2006	4,485	2,813	1,594,218	0	28	3,384	41,497
2007	4,561	2,813	1,621,534	0	28	3,505	42,673
2008	4,600	2,813	1,635,285	0	28	3,617	43,775
2009	4,638	2,813	1,648,721	0	28	3,729	44,892
2010	4,670	2,813	1,660,209	0	28	3,843	46,020
2011	4,701	2,813	1,671,100	0	28	3,966	47,180
2012	4,731	2,813	1,681,991	0	28	4,095	48,354
2013	4,757	2,813	1,691,157	0	28	4,221	49,535
2014	4,780	2,813	1,699,167	0	28	4,344	50,724

PROGRESS ENERGY FLORIDA

SCHEDULE 2.3
HISTORY AND FORECAST OF ENERGY CONSUMPTION AND
NUMBER OF CUSTOMERS BY CUSTOMER CLASS

(1)	(2)	(3)	(4)	(5)	(6)
YEAR	SALES FOR RESALE GWh	UTILITY USE & LOSSES GWh	NET ENERGY FOR LOAD GWh	OTHER CUSTOMERS (AVERAGE NO.)	TOTAL NO. OF CUSTOMERS
1995	1,846	2,322	33,667	17,774	1,271,785
1996	2,089	1,842	34,715	18,035	1,292,073
1997	1,758	1,996	34,605	18,562	1,314,507
1998	2,340	2,037	37,763	19,013	1,340,851
1999	3,267	2,451	39,160	19,601	1,376,597
2000	3,732	2,678	41,242	20,004	1,400,299
2001	3,839	1,830	40,933	20,752	1,444,958
2002	3,173	2,534	42,567	21,156	1,475,783
2003	3,359	2,595	43,911	21,665	1,510,516
2004	4,301	2,773	45,268	22,437	1,548,627
2005	4,572	2,773	47,630	22,922	1,574,447
2006	3,518	2,885	47,900	23,499	1,603,600
2007	3,753	2,945	49,372	24,079	1,632,925
2008	3,748	3,044	50,567	24,660	1,662,016
2009	3,674	3,082	51,648	25,241	1,690,993
2010	4,275	3,246	53,541	25,822	1,719,780
2011	4,427	3,275	54,882	26,403	1,748,339
2012	4,554	3,354	56,263	26,984	1,776,709
2013	4,706	3,435	57,676	27,565	1,804,949
2014	5,242	3,555	59,520	28,144	1,833,114

PROGRESS ENERGY FLORIDA

SCHEDULE 3.1.1
HISTORY AND FORECAST OF SUMMER PEAK DEMAND (MW)
BASE CASE

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(OTH)	(10)
YEAR	TOTAL	WHOLESALE	RETAIL	INTERRUPTIBLE	RESIDENTIAL	RESIDENTIAL	COMM. / IND.	COMM. / IND.	OTHER	NET FIRM
					LOAD	CONSERVATION	LOAD	CONSERVATION	DEMAND	
					MANAGEMENT	MANAGEMENT	MANAGEMENT	CONSERVATION	REDUCTIONS	DEMAND
1995	7,523	959	6,564	269	503	64	40	106	160	6,381
1996	7,470	828	6,642	309	565	69	41	120	167	6,199
1997	7,786	874	6,912	288	555	78	41	131	170	6,523
1998	8,367	943	7,424	291	438	97	42	142	182	7,175
1999	9,039	1,326	7,713	292	505	113	45	153	183	7,747
2000	8,911	1,319	7,592	277	455	127	48	155	75	7,774
2001	8,841	1,117	7,724	283	414	139	54	156	75	7,720
2002	9,421	1,203	8,218	305	390	153	43	159	75	8,296
2003	8,886	887	7,999	300	347	172	44	164	75	7,785
2004	9,554	1,071	8,483	531	283	188	37	166	75	8,274
2005	9,547	948	8,599	633	258	203	38	167	75	8,172
2006	9,808	993	8,815	420	228	214	39	169	75	8,663
2007	10,085	1,063	9,022	417	202	223	40	171	75	8,957
2008	10,298	1,093	9,205	413	179	232	41	172	75	9,186
2009	10,452	1,063	9,388	409	158	241	42	174	75	9,353
2010	10,802	1,213	9,589	400	140	250	43	176	75	9,719
2011	11,007	1,217	9,790	401	124	259	45	177	75	9,926
2012	11,218	1,230	9,988	402	109	269	46	179	75	10,138
2013	11,436	1,251	10,185	403	97	279	47	180	75	10,355
2014	11,651	1,269	10,382	404	86	289	48	182	75	10,567

Historical Values (1995 - 2004):

Col. (2) = recorded peak + implemented load control + residential and commercial/industrial conservation and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = Residential Heat Works load control, voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

Projected Values (2005 - 2014):

Cols. (2) - (4) = forecasted peak without load control, conservation, and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

PROGRESS ENERGY FLORIDA

SCHEDULE 3.1.2
HISTORY AND FORECAST OF SUMMER PEAK DEMAND (MW)
HIGH LOAD FORECAST

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(OTH)	(10)
YEAR	TOTAL	WHOLESALE	RETAIL	INTERRUPTIBLE	RESIDENTIAL LOAD MANAGEMENT	RESIDENTIAL CONSERVATION	COMM. / IND. LOAD MANAGEMENT	COMM. / IND. CONSERVATION	OTHER DEMAND REDUCTIONS	NET FIRM DEMAND
1995	7,523	959	6,564	269	503	64	40	106	160	6,381
1996	7,470	828	6,642	309	565	69	41	120	167	6,199
1997	7,786	874	6,912	288	555	78	41	131	170	6,523
1998	8,367	943	7,424	291	438	97	42	142	182	7,175
1999	9,039	1,326	7,713	292	505	113	45	153	183	7,747
2000	8,911	1,319	7,592	277	455	127	48	155	75	7,774
2001	8,841	1,117	7,724	283	414	139	54	156	75	7,720
2002	9,421	1,203	8,218	305	390	153	43	159	75	8,296
2003	8,886	887	7,999	300	347	172	44	164	75	7,785
2004	9,554	1,071	8,483	531	283	188	37	166	75	8,274
2005	9,711	948	8,763	633	258	203	38	167	75	8,336
2006	9,990	993	8,997	420	228	214	39	169	75	8,844
2007	10,298	1,063	9,236	417	202	223	40	171	75	9,170
2008	10,542	1,093	9,449	413	179	232	41	172	75	9,430
2009	10,709	1,063	9,645	409	158	241	42	174	75	9,609
2010	11,077	1,213	9,865	400	140	250	43	176	75	9,994
2011	11,314	1,217	10,096	401	124	259	45	177	75	10,232
2012	11,591	1,230	10,361	402	109	269	46	179	75	10,510
2013	11,852	1,251	10,601	403	97	279	47	180	75	10,771
2014	12,136	1,269	10,866	404	86	289	48	182	75	11,052

Historical Values (1995 - 2004):

Col. (2) = recorded peak + implemented load control + residential and commercial/industrial conservation and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = Residential Heat Works load control, voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

Projected Values (2005 - 2014):

Cols. (2) - (4) = forecasted peak without load control, conservation, and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

PROGRESS ENERGY FLORIDA

SCHEDULE 3.1.3

HISTORY AND FORECAST OF SUMMER PEAK DEMAND (MW)

LOW LOAD FORECAST

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(OTH)	(10)
YEAR	TOTAL	WHOLESALE	RETAIL	INTERRUPTIBLE	RESIDENTIAL	RESIDENTIAL	COMM. / IND.	COMM. / IND.	OTHER	NET FIRM
					LOAD	CONSERVATION	LOAD	CONSERVATION	DEMAND	

1995	7,523	959	6,564	269	503	64	40	106	160	6,381
1996	7,470	828	6,642	309	565	69	41	120	167	6,199
1997	7,786	874	6,912	288	555	78	41	131	170	6,523
1998	8,367	943	7,424	291	438	97	42	142	182	7,175
1999	9,039	1,326	7,713	292	505	113	45	153	183	7,747
2000	8,911	1,319	7,592	277	455	127	48	155	75	7,774
2001	8,841	1,117	7,724	283	414	139	54	156	75	7,720
2002	9,421	1,203	8,218	305	390	153	43	159	75	8,296
2003	8,886	887	7,999	300	347	172	44	164	75	7,785
2004	9,554	1,071	8,483	531	283	188	37	166	75	8,274
2005	9,382	948	8,434	633	258	203	38	167	75	8,007
2006	9,637	993	8,644	420	228	214	39	169	75	8,491
2007	9,889	1,063	8,827	417	202	223	40	171	75	8,761
2008	10,091	1,093	8,998	413	179	232	41	172	75	8,979
2009	10,202	1,063	9,138	409	158	241	42	174	75	9,102
2010	10,518	1,213	9,306	400	140	250	43	176	75	9,435
2011	10,670	1,217	9,452	401	124	259	45	177	75	9,588
2012	10,854	1,230	9,624	402	109	269	46	179	75	9,773
2013	11,043	1,251	9,792	403	97	279	47	180	75	9,962
2014	11,192	1,269	9,922	404	86	289	48	182	75	10,108

Historical Values (1995 - 2004):

Col. (2) = recorded peak + implemented load control + residential and commercial/industrial conservation and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = Residential Heat Works load control, voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

Projected Values (2005 - 2014):

Cols. (2) - (4) = forecasted peak without load control, conservation, and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

PROGRESS ENERGY FLORIDA

SCHEDULE 3.2.1
HISTORY AND FORECAST OF WINTER PEAK DEMAND (MW)
BASE CASE

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(OTH)	(10)
YEAR	TOTAL	WHOLESALE	RETAIL	RESIDENTIAL		COMM. / IND.		COMM. / IND. CONSERVATION	OTHER DEMAND REDUCTIONS	NET FIRM DEMAND
				INTERRUPTIBLE	LOAD MANAGEMENT	RESIDENTIAL CONSERVATION	LOAD MANAGEMENT			
1994/95	9,084	1,145	7,939	281	997	101	5	75	131	7,494
1995/96	10,562	1,489	9,073	255	1,156	106	15	95	201	8,734
1996/97	8,486	1,235	7,251	290	917	133	16	104	190	6,836
1997/98	7,752	941	6,811	318	663	164	17	112	168	6,310
1998/99	10,473	1,741	8,732	305	874	196	18	117	187	8,776
1999/00	10,040	1,728	8,312	225	849	229	20	119	182	8,416
2000/01	11,450	1,984	9,466	255	809	254	29	120	194	9,789
2001/02	10,676	1,624	9,052	285	770	278	24	121	188	9,010
2002/03	11,555	1,538	10,017	271	768	313	27	124	200	9,852
2003/04	9,290	1,167	8,123	498	761	343	24	125	218	7,321
2004/05	11,207	1,771	9,436	793	725	371	26	125	252	8,914
2005/06	11,144	1,502	9,642	432	696	405	28	127	255	9,200
2006/07	11,654	1,807	9,847	433	671	429	30	128	259	9,704
2007/08	11,869	1,825	10,045	428	649	453	31	130	262	9,915
2008/09	12,098	1,856	10,242	424	631	479	33	132	266	10,133
2009/10	12,486	2,049	10,438	415	615	506	35	133	269	10,513
2010/11	12,739	2,106	10,633	417	603	534	37	135	272	10,742
2011/12	12,991	2,165	10,826	418	593	566	38	136	276	10,964
2012/13	13,248	2,230	11,018	419	586	597	40	138	279	11,189
2013/14	13,504	2,295	11,209	420	581	628	42	139	282	11,412

Historical Values (1995 - 2004):

Col. (2) = recorded peak + implemented load control + residential and commercial/industrial conservation and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = Residential Heat Works load control, voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

Projected Values (2005 - 2014):

Cols. (2) - (4) = forecasted peak without load control, conservation, and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

PROGRESS ENERGY FLORIDA

SCHEDULE 3.2.2
HISTORY AND FORECAST OF WINTER PEAK DEMAND (MW)
HIGH LOAD FORECAST

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(OTH)	(10)
YEAR	TOTAL	WHOLESALE	RETAIL	INTERRUPTIBLE	RESIDENTIAL		COMM. / IND.		OTHER DEMAND REDUCTIONS	NET FIRM DEMAND
					LOAD MANAGEMENT	RESIDENTIAL CONSERVATION	LOAD MANAGEMENT	COMM. / IND. CONSERVATION		
1994/95	9,084	1,145	7,939	281	997	101	5	75	131	7,494
1995/96	10,562	1,489	9,073	255	1,156	106	15	95	201	8,734
1996/97	8,486	1,235	7,251	290	917	133	16	104	190	6,836
1997/98	7,752	941	6,811	318	663	164	17	112	168	6,310
1998/99	10,473	1,741	8,732	305	874	196	18	117	187	8,776
1999/00	10,040	1,728	8,312	225	849	229	20	119	182	8,416
2000/01	11,450	1,984	9,466	255	809	254	29	120	194	9,789
2001/02	10,676	1,624	9,052	285	770	278	24	121	188	9,010
2002/03	11,555	1,538	10,017	271	768	313	27	124	200	9,852
2003/04	9,290	1,167	8,123	498	761	343	24	125	218	7,321
2004/05	11,385	1,771	9,613	793	725	371	26	125	252	9,091
2005/06	11,341	1,502	9,839	432	696	405	28	127	255	9,397
2006/07	11,882	1,807	10,075	433	671	429	30	128	259	9,933
2007/08	12,132	1,825	10,307	428	649	453	31	130	262	10,177
2008/09	12,374	1,856	10,517	424	631	479	33	132	266	10,409
2009/10	12,781	2,049	10,732	415	615	506	35	133	269	10,808
2010/11	13,067	2,106	10,961	417	603	534	37	135	272	11,070
2011/12	13,387	2,165	11,222	418	593	566	38	136	276	11,360
2012/13	13,688	2,230	11,458	419	586	597	40	138	279	11,629
2013/14	14,015	2,295	11,720	420	581	628	42	139	282	11,923

Historical Values (1995 - 2004):

Col. (2) = recorded peak + implemented load control + residential and commercial/industrial conservation and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = Residential Heat Works load control, voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

Projected Values (2005 - 2014):

Cols. (2) - (4) = forecasted peak without load control, conservation, and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

PROGRESS ENERGY FLORIDA

SCHEDULE 3.2.3
HISTORY AND FORECAST OF WINTER PEAK DEMAND (MW)
LOW LOAD FORECAST

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(OTH)	(10)
YEAR	TOTAL	WHOLESALE	RETAIL	RESIDENTIAL		COMM. / IND.		COMM. / IND. CONSERVATION	OTHER DEMAND REDUCTIONS	NET FIRM DEMAND
				INTERRUPTIBLE	MANAGEMENT	RESIDENTIAL CONSERVATION	LOAD MANAGEMENT			
1994/95	9,084	1,145	7,939	281	997	101	5	75	131	7,494
1995/96	10,562	1,489	9,073	255	1,156	106	15	95	201	8,734
1996/97	8,486	1,235	7,251	290	917	133	16	104	190	6,836
1997/98	7,752	941	6,811	318	663	164	17	112	168	6,310
1998/99	10,473	1,741	8,732	305	874	196	18	117	187	8,776
1999/00	10,040	1,728	8,312	225	849	229	20	119	182	8,416
2000/01	11,450	1,984	9,466	255	809	254	29	120	194	9,789
2001/02	10,676	1,624	9,052	285	770	278	24	121	188	9,010
2002/03	11,555	1,538	10,017	271	768	313	27	124	200	9,852
2003/04	9,290	1,167	8,123	498	761	343	24	125	218	7,321
2004/05	11,027	1,771	9,255	793	725	371	26	125	252	8,733
2005/06	10,960	1,502	9,458	432	696	405	28	127	255	9,016
2006/07	11,442	1,807	9,635	433	671	429	30	128	259	9,493
2007/08	11,646	1,825	9,821	428	649	453	31	130	262	9,691
2008/09	11,829	1,856	9,972	424	631	479	33	132	266	9,864
2009/10	12,183	2,049	10,134	415	615	506	35	133	269	10,210
2010/11	12,379	2,106	10,273	417	603	534	37	135	272	10,382
2011/12	12,604	2,165	10,439	418	593	566	38	136	276	10,577
2012/13	12,832	2,230	10,602	419	586	597	40	138	279	10,773
2013/14	13,021	2,295	10,726	420	581	628	42	139	282	10,929

Historical Values (1995 - 2004):

Col. (2) = recorded peak + implemented load control + residential and commercial/industrial conservation and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = Residential Heat Works load control, voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

Projected Values (2005 - 2014):

Cols. (2) - (4) = forecasted peak without load control, conservation, and customer-owned self-service cogeneration.

Cols. (5) - (9) = cumulative conservation and load control capabilities at peak. Col. (8) includes commercial load management and standby generation.

Col. (OTH) = voltage reduction and customer-owned self-service cogeneration.

Col. (10) = (2) - (5) - (6) - (7) - (8) - (9) - (OTH).

PROGRESS ENERGY FLORIDA

SCHEDULE 3.3.1
HISTORY AND FORECAST OF ANNUAL NET ENERGY FOR LOAD (GWh)
BASE CASE

(1)	(2)	(3)	(4)	(OTH)	(5)	(6)	(7)	(8)	(9)
YEAR	TOTAL	RESIDENTIAL CONSERVATION	COMM. / IND. CONSERVATION	OTHER ENERGY REDUCTIONS*	RETAIL	WHOLESALE	UTILITY USE & LOSSES	NET ENERGY FOR LOAD	LOAD FACTOR (%) **
1995	34,696	234	246	549	29,499	1,846	2,322	33,667	49.8
1996	35,812	249	285	562	30,785	2,089	1,841	34,715	44.9
1997	35,753	268	317	563	30,850	1,758	1,997	34,605	49.0
1998	38,950	289	333	565	33,387	2,340	2,036	37,763	53.9
1999	40,376	312	339	565	33,441	3,267	2,452	39,160	50.0
2000	42,486	334	345	565	34,832	3,732	2,678	41,242	50.5
2001	42,200	354	349	564	35,263	3,839	1,831	40,933	47.5
2002	43,860	377	352	564	36,859	3,173	2,535	42,567	50.0
2003	45,232	400	357	564	37,957	3,359	2,595	43,911	47.7
2004	46,617	424	360	565	38,193	4,301	2,774	45,268	56.5
2005	49,002	445	363	564	40,286	4,620	2,724	47,630	61.0
2006	49,289	459	365	564	41,497	3,565	2,838	47,900	59.4
2007	50,778	474	368	564	42,673	3,761	2,938	49,372	58.1
2008	51,992	489	371	565	43,775	3,748	3,044	50,567	58.1
2009	53,090	504	374	564	44,892	3,674	3,082	51,648	58.2
2010	55,001	519	377	564	46,020	4,275	3,246	53,541	58.1
2011	56,362	536	380	564	47,180	4,427	3,275	54,882	58.3
2012	57,763	552	383	565	48,354	4,554	3,355	56,263	58.4
2013	59,194	568	386	564	49,535	4,706	3,435	57,676	58.8
2014	61,057	585	389	564	50,724	5,242	3,554	59,520	59.5

* Column (OTH) includes Conservation Energy For Lighting and Public Authority Customers, Customer-Owned Self-service Cogeneration and Load Control Programs.

** Load Factors for historical years are calculated using the actual winter peak demand except the 1998 and 2004 historical load factors which are based on the actual summer peak demand.
Load Factors for future years are calculated using the net firm winter peak demand (Schedule 3.2.1)

PROGRESS ENERGY FLORIDA

SCHEDULE 3.3.2
HISTORY AND FORECAST OF ANNUAL NET ENERGY FOR LOAD (GWh)
HIGH LOAD FORECAST

(1)	(2)	(3)	(4)	(OTH)	(5)	(6)	(7)	(8)	(9)
YEAR	TOTAL	RESIDENTIAL CONSERVATION	COMM. / IND. CONSERVATION	OTHER ENERGY REDUCTIONS*	RETAIL	WHOLESALE	UTILITY USE & LOSSES	NET ENERGY FOR LOAD	LOAD FACTOR (%) **
1995	34,696	234	246	549	29,499	1,846	2,322	33,667	49.8
1996	35,812	249	285	562	30,785	2,089	1,841	34,715	44.9
1997	35,753	268	317	563	30,850	1,758	1,997	34,605	49.0
1998	38,950	289	333	565	33,387	2,340	2,036	37,763	53.9
1999	40,376	312	339	565	33,441	3,267	2,452	39,160	50.0
2000	42,486	334	345	565	34,832	3,732	2,678	41,242	50.5
2001	42,200	354	349	564	35,263	3,839	1,831	40,933	47.5
2002	43,860	377	352	564	36,859	3,173	2,535	42,567	50.0
2003	45,232	400	357	564	37,957	3,359	2,595	43,911	47.7
2004	46,617	424	360	565	38,193	4,301	2,774	45,268	56.5
2005	49,904	445	363	564	41,094	4,620	2,818	48,532	60.9
2006	50,256	459	365	564	42,401	3,565	2,901	48,867	59.4
2007	51,915	474	368	564	43,736	3,761	3,012	50,509	58.0
2008	53,292	489	371	565	44,995	3,748	3,124	51,867	58.0
2009	54,471	504	374	564	46,188	3,674	3,167	53,029	58.2
2010	56,487	519	377	564	47,411	4,275	3,341	55,027	58.1
2011	58,039	536	380	564	48,743	4,427	3,389	56,559	58.3
2012	59,800	552	383	565	50,261	4,554	3,485	58,300	58.4
2013	61,478	568	386	564	51,668	4,706	3,586	59,960	58.9
2014	63,726	585	389	564	53,222	5,242	3,725	62,189	59.5

* Column (OTH) includes Conservation Energy For Lighting and Public Authority Customers, Customer-Owned Self-service Cogeneration and Load Control Programs.

** Load Factors for historical years are calculated using the actual winter peak demand except the 1998 and 2004 historical load factors which are based on the actual summer peak demand.

Load Factors for future years are calculated using the net firm winter peak demand (Schedule 3.2.2)

PROGRESS ENERGY FLORIDA

SCHEDULE 3.3.3
HISTORY AND FORECAST OF ANNUAL NET ENERGY FOR LOAD (GWh)
LOW LOAD FORECAST

(1)	(2)	(3)	(4)	(OTH)	(5)	(6)	(7)	(8)	(9)
YEAR	TOTAL	RESIDENTIAL CONSERVATION	COMM. / IND. CONSERVATION	OTHER ENERGY REDUCTIONS*	RETAIL	WHOLESALE	UTILITY USE & LOSSES	NET ENERGY FOR LOAD	LOAD FACTOR (%) **
1995	34,696	234	246	549	29,499	1,846	2,322	33,667	49.8
1996	35,812	249	285	562	30,785	2,089	1,841	34,715	44.9
1997	35,753	268	317	563	30,850	1,758	1,997	34,605	49.0
1998	38,950	289	333	565	33,387	2,340	2,036	37,763	53.9
1999	40,376	312	339	565	33,441	3,267	2,452	39,160	50.0
2000	42,486	334	345	565	34,832	3,732	2,678	41,242	50.5
2001	42,200	354	349	564	35,263	3,839	1,831	40,933	47.5
2002	43,860	377	352	564	36,859	3,173	2,535	42,567	50.0
2003	45,232	400	357	564	37,957	3,359	2,595	43,911	47.7
2004	46,617	424	360	565	38,193	4,301	2,774	45,268	56.5
2005	48,094	445	363	564	39,469	4,620	2,633	46,722	61.1
2006	48,382	459	365	564	40,650	3,565	2,778	46,993	59.5
2007	49,735	474	368	564	41,695	3,761	2,873	48,329	58.1
2008	50,871	489	371	565	42,730	3,748	2,968	49,446	58.1
2009	51,741	504	374	564	43,631	3,674	2,994	50,299	58.2
2010	53,458	519	377	564	44,581	4,275	3,142	51,998	58.1
2011	54,532	536	380	564	45,465	4,427	3,160	53,052	58.3
2012	55,778	552	383	565	46,493	4,554	3,231	54,278	58.4
2013	57,034	568	386	564	47,518	4,706	3,292	55,516	58.8
2014	58,536	585	389	564	48,358	5,242	3,399	56,999	59.5

* Column (OTH) includes Conservation Energy For Lighting and Public Authority Customers, Customer-Owned Self-service Cogeneration and Load Control Programs.

** Load Factors for historical years are calculated using the actual winter peak demand except the 1998 and 2004 historical load factors which are based on the actual summer peak demand.
Load Factors for future years are calculated using the net firm winter peak demand (Schedule 3.2.3)

PROGRESS ENERGY FLORIDA

SCHEDULE 4

PREVIOUS YEAR ACTUAL AND TWO-YEAR FORECAST OF PEAK DEMAND
AND NET ENERGY FOR LOAD BY MONTH

(1) MONTH	(2) ACTUAL		(4) FORECAST		(6) FORECAST	
	(3) 2004		(5) 2005		(7) 2006	
	PEAK DEMAND	NEL	PEAK DEMAND	NEL	PEAK DEMAND	NEL
	MW	GWh	MW	GWh	MW	GWh
JANUARY	8,748	3,504	8,914	3,735	9,200	3,695
FEBRUARY	7,791	3,090	7,115	3,362	7,335	3,303
MARCH	6,017	3,171	6,008	3,601	6,216	3,553
APRIL	6,760	3,176	6,691	3,483	6,956	3,409
MAY	8,446	3,960	7,659	4,195	7,965	4,142
JUNE	9,125	4,481	8,021	4,390	8,494	4,490
JULY	9,058	4,621	8,147	4,762	8,641	4,884
AUGUST	8,842	4,432	8,172	4,802	8,663	4,918
SEPTEMBER	8,628	4,064	7,689	4,369	8,136	4,444
OCTOBER	8,324	3,900	7,146	3,904	7,561	3,945
NOVEMBER	7,313	3,237	5,792	3,379	6,149	3,422
DECEMBER	8,303	3,632	7,356	3,648	7,899	3,695
TOTAL		45,268		47,630		47,900

NOTE: "Actual" = "Total" - "Interruptible" - "Res. LM" - "C/I LM" - "Voltage Reduction & Standby Generation"

FUEL REQUIREMENTS AND ENERGY SOURCES

PEF's two-year actual and ten-year projected nuclear, coal, oil, and gas requirements (by fuel units) are shown on Schedule 5. PEF's two-year actual and ten-year projected energy sources, in GWh and percent, are shown by fuel type on Schedules 6.1 and 6.2, respectively. PEF's fuel requirements and energy sources reflect a diverse fuel supply system that is not dependent on any one-fuel source. Natural gas consumption is projected to increase as plants and purchases with tolling agreements are added to meet future load growth. PEF's coal and nuclear generation is projected to remain relatively stable over the ten-year planning horizon.

PROGRESS ENERGY FLORIDA

SCHEDULE 5
FUEL REQUIREMENTS

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
-ACTUAL-															
	<u>FUEL REQUIREMENTS</u>		<u>UNITS</u>	<u>2003</u>	<u>2004</u>	<u>2005</u>	<u>2006</u>	<u>2007</u>	<u>2008</u>	<u>2009</u>	<u>2010</u>	<u>2011</u>	<u>2012</u>	<u>2013</u>	<u>2014</u>
(1)	NUCLEAR		TRILLION BTU	62	69	63	68	63	69	52	68	63	69	63	68
(2)	COAL		1,000 TON	6,173	5,915	6,057	5,729	5,889	5,714	6,006	6,017	5,975	5,816	5,926	5,899
(3)	RESIDUAL	TOTAL	1,000 BBL	10,701	10,864	11,446	8,989	12,026	9,860	10,469	10,942	10,462	9,177	9,761	8,675
(4)		STEAM	1,000 BBL	10,701	10,864	11,446	8,989	12,026	9,860	10,469	10,942	10,462	9,177	9,761	8,675
(5)		CC	1,000 BBL	0	0	0	0	0	0	0	0	0	0	0	0
(6)		CT	1,000 BBL	0	0	0	0	0	0	0	0	0	0	0	0
(7)		DIESEL	1,000 BBL	0	0	0	0	0	0	0	0	0	0	0	0
(8)	DISTILLATE	TOTAL	1,000 BBL	1,076	1,019	686	338	677	281	458	457	343	302	364	396
(9)		STEAM	1,000 BBL	119	152	24	33	26	33	29	25	30	39	37	37
(10)		CC	1,000 BBL	32	2	0	0	0	0	0	0	0	0	0	0
(11)		CT	1,000 BBL	925	865	662	305	651	248	429	432	313	263	327	359
(12)		DIESEL	1,000 BBL	0	0	0	0	0	0	0	0	0	0	0	0
(13)	NATURAL GAS	TOTAL	1,000 MCF	52,180	62,674	73,574	84,254	76,014	97,740	107,511	115,288	139,461	155,781	164,852	193,811
(14)		STEAM	1,000 MCF	832	1,071	0	0	0	0	0	0	0	0	0	0
(15)		CC	1,000 MCF	36,370	45,816	54,459	72,237	65,640	89,075	96,852	106,856	131,758	148,981	156,603	185,456
(16)		CT	1,000 MCF	14,978	15,787	19,115	12,016	10,374	8,665	10,659	8,433	7,702	6,800	8,249	8,355
(17)	OTHER (SPECIFY)														
	SEASONAL PURCHASE	CT	1,000 BBL	N/A	N/A	0	0	19	0	2	0	0	0	0	0
	SEASONAL PURCHASE	CC	1,000 MCF	N/A	N/A	0	0	0	0	0	5,038	6,875	7,065	7,510	6,647
	SEASONAL PURCHASE	CT	1,000 MCF	N/A	N/A	4,852	1,978	6,893	5,171	6,681	5,372	4,865	4,350	5,253	489

PROGRESS ENERGY FLORIDA

SCHEDULE 6.1

ENERGY SOURCES (GWh)

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
-ACTUAL-															
<u>ENERGY SOURCES</u>			<u>UNITS</u>	<u>2003</u>	<u>2004</u>	<u>2005</u>	<u>2006</u>	<u>2007</u>	<u>2008</u>	<u>2009</u>	<u>2010</u>	<u>2011</u>	<u>2012</u>	<u>2013</u>	<u>2014</u>
(1)	ANNUAL FIRM INTERCHANGE 1/		GWh	97	417	922	1,501	2,018	1,791	1,980	1,878	1,496	1,407	1,493	1,018
(2)	NUCLEAR		GWh	6,039	6,703	6,069	6,636	6,089	6,655	5,087	6,636	6,143	6,655	6,143	6,636
(3)	COAL		GWh	16,111	15,063	15,723	14,797	15,267	14,753	15,550	15,595	15,501	15,035	15,369	15,260
(4)	RESIDUAL	TOTAL	GWh	6,785	6,981	7,044	5,387	7,458	5,940	6,358	6,657	6,329	5,447	5,841	5,065
(5)		STEAM	GWh	6,785	6,981	7,044	5,387	7,458	5,940	6,358	6,657	6,329	5,447	5,841	5,065
(6)		CC	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(7)		CT	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(8)		DIESEL	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(9)	DISTILLATE	TOTAL	GWh	405	361	274	125	269	102	177	179	128	108	134	146
(10)		STEAM	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(11)		CC	GWh	19	2	0	0	0	0	0	0	0	0	0	0
(12)		CT	GWh	386	359	274	125	269	102	177	179	128	108	134	146
(13)		DIESEL	GWh	0	0	0	0	0	0	0	0	0	0	0	0
(14)	NATURAL GAS	TOTAL	GWh	6,155	7,516	9,288	11,220	10,132	13,353	14,618	15,837	19,383	21,698	22,931	26,958
(15)		STEAM	GWh	83	106	0	0	0	0	0	0	0	0	0	0
(16)		CC	GWh	4,938	6,227	7,763	10,230	9,262	12,613	13,725	15,116	18,714	21,098	22,227	26,250
(17)		CT	GWh	1,134	1,183	1,525	989	869	740	893	721	669	599	704	709
(18)	OTHER 2/														
	QF PURCHASES		GWh	5,022	4,685	4,727	4,718	4,595	4,485	4,470	4,466	4,463	4,463	4,250	3,042
	IMPORT FROM OUT OF STATE		GWh	3,555	3,862	3,583	3,517	3,545	3,488	3,408	2,293	1,439	1,451	1,515	1,394
	EXPORT TO OUT OF STATE		GWh	-258	-320	0	0	0	0	0	0	0	0	0	0
(19)	NET ENERGY FOR LOAD		GWh	43,911	45,268	47,630	47,900	49,372	50,567	51,648	53,541	54,882	56,263	57,676	59,520

1/ NET ENERGY PURCHASED (+) OR SOLD (-) WITHIN THE FRCC REGION.

2/ NET ENERGY PURCHASED (+) OR SOLD (-).

PROGRESS ENERGY FLORIDA

SCHEDULE 6.2

ENERGY SOURCES (PERCENT)

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
-ACTUAL-															
			UNITS	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014
(1)	ANNUAL FIRM INTERCHANGE 1/		%	0.2%	0.9%	1.9%	3.1%	4.1%	3.5%	3.8%	3.5%	2.7%	2.5%	2.6%	1.7%
(2)	NUCLEAR		%	13.8%	14.8%	12.7%	13.9%	12.3%	13.2%	9.8%	12.4%	11.2%	11.8%	10.7%	11.1%
(3)	COAL		%	36.7%	33.3%	33.0%	30.9%	30.9%	29.2%	30.1%	29.1%	28.2%	26.7%	26.6%	25.6%
(4)	RESIDUAL	TOTAL	%	15.5%	15.4%	14.8%	11.2%	15.1%	11.7%	12.3%	12.4%	11.5%	9.7%	10.1%	8.5%
(5)		STEAM	%	15.5%	15.4%	14.8%	11.2%	15.1%	11.7%	12.3%	12.4%	11.5%	9.7%	10.1%	8.5%
(6)		CC	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(7)		CT	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(8)		DIESEL	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(9)	DISTILLATE	TOTAL	%	0.9%	0.8%	0.6%	0.3%	0.5%	0.2%	0.3%	0.3%	0.2%	0.2%	0.2%	0.2%
(10)		STEAM	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(11)		CC	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(12)		CT	%	0.9%	0.8%	0.6%	0.3%	0.5%	0.2%	0.3%	0.3%	0.2%	0.2%	0.2%	0.2%
(13)		DIESEL	%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(14)	NATURAL GAS	TOTAL	%	14.0%	16.6%	19.5%	23.4%	20.5%	26.4%	28.3%	29.6%	35.3%	38.6%	39.8%	45.3%
(15)		STEAM	%	0.2%	0.2%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(16)		CC	%	11.2%	13.8%	16.3%	21.4%	18.8%	24.9%	26.6%	28.2%	34.1%	37.5%	38.5%	44.1%
(17)		CT	%	2.6%	2.6%	3.2%	2.1%	1.8%	1.5%	1.7%	1.3%	1.2%	1.1%	1.2%	1.2%
(18)	OTHER 2/														
	QF PURCHASES		%	11.4%	10.3%	9.9%	9.8%	9.3%	8.9%	8.7%	8.3%	8.1%	7.9%	7.4%	5.1%
	IMPORT FROM OUT OF STATE		%	8.1%	8.5%	7.5%	7.3%	7.2%	6.9%	6.6%	4.3%	2.6%	2.6%	2.6%	2.3%
	EXPORT TO OUT OF STATE		%	-0.6%	-0.7%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
(19)	NET ENERGY FOR LOAD		%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

1/ NET ENERGY PURCHASED (+) OR SOLD (-) WITHIN THE FRCC REGION.

2/ NET ENERGY PURCHASED (+) OR SOLD (-).

FORECASTING METHODS AND PROCEDURES

INTRODUCTION


Accurate forecasts of long-range electric energy consumption, customer growth and peak demand are essential elements in electric utility planning. Accurate projections of a utility's future load growth require a forecasting methodology with the ability to account for a variety of factors influencing electric energy usage over the planning horizon. PEF's forecasting framework utilizes a set of econometric models to achieve this end. This chapter will describe the underlying methodology of the customer, energy, and peak demand forecasts including any assumptions incorporated within each. Also included is a description of how Demand-Side Management (DSM) impacts the forecast, the development of high and low forecast scenarios and a review of DSM programs.

Figure 2.1, entitled "Customer, Energy and Demand Forecast", gives a general description of PEF's forecasting process. Highlighted in the diagram is a disaggregated modeling approach that blends the impacts of average class usage as well as customer growth based on a specific set of assumptions for each class. Also accounted for is some direct contact with large customers. These inputs provide the forecaster at PEF with the tools needed to frame the most likely scenario of the company's future demand.

FORECAST ASSUMPTIONS

The first step in any forecasting effort is the development of assumptions upon which the forecast is based. The Corporate Planning Department develops these assumptions based on discussions with a number of departments within PEF, as well as through the research efforts of a number of external sources. These assumptions specify major factors that influence the level of customers, energy sales, or peak demand over the forecast horizon. The following set of assumptions forms the basis for the forecast presented in this document.

FIGURE 2.1
Customer, Energy, and Demand Forecast

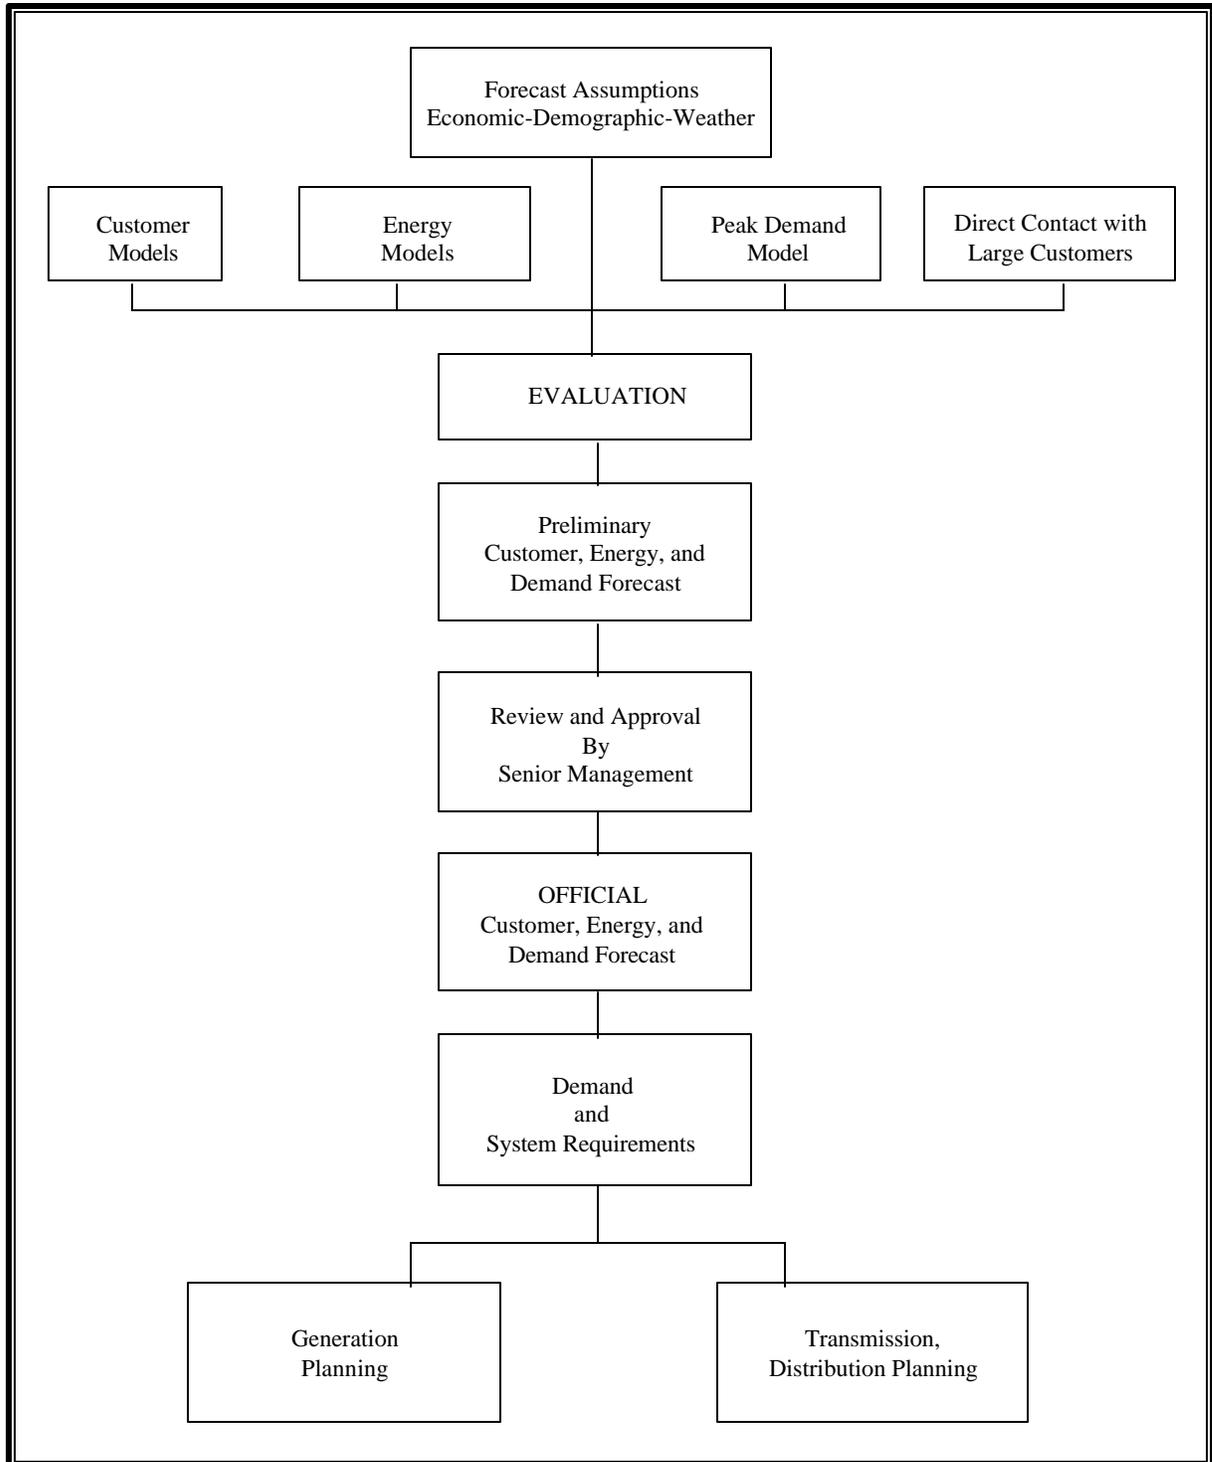

GENERAL ASSUMPTIONS

1. Normal weather conditions are assumed over the forecast horizon using a sales-weighted average of conditions at the St. Petersburg, Orlando and Tallahassee weather stations. For kilowatt-hour sales projections, normal weather is based on a historical thirty-year average of service area weighted billing month degree-days. Seasonal peak demand projections are based on a thirty-year historical average of system-weighted temperatures at time of seasonal peak.
2. The population projections produced by the Bureau of Economic and Business Research (BEBR) at the University of Florida as published in "Florida Population Studies Bulletin No. 138 (February 2004) provide the basis for development of the customer forecast. State and national economic assumptions produced by Economy.Com in their national and Florida forecasts (February, 2004) are also incorporated.
3. Within the Progress Energy Florida (PEF) service area the phosphate mining industry is the dominant sector in the industrial sales class. Five major customers accounted for nearly 30% of the industrial class MWh sales in 2003. These energy intensive customers mine and process phosphate-based fertilizer products for the global marketplace. Both supply and demand conditions for their products are dictated by global conditions that include, but are not limited to, foreign competition, national/international agricultural industry conditions, exchange-rate fluctuations, and international trade pacts. Load and energy consumption at the PEF-served mining or chemical processing sites depend heavily on plant operations, which are heavily influenced by the state of these global conditions as well as local conditions. After years of excess mining capacity and weak product pricing power, the industry has consolidated down to fewer players in time to take advantage of better market conditions. A weaker U.S currency value on the foreign exchange is expected to help the industry in two ways. First, American farm commodities will be more competitive overseas and lead to higher crop production at home. This will result in greater demand for fertilizer products. Second, a weak U.S. dollar results in U.S. fertilizer producers becoming more price competitive relative to foreign producers. Going forward, energy consumption is expected to increase – as we have recently experienced - to the levels just below that experienced in the late 1990 boom period. A significant risk to this projection lies in the continued high price of natural gas, which is a major

factor of production. Operations at several sites in the U.S. have already scaled back or shutdown due to profitability concerns caused by high energy prices. The energy projection for this industry assumes no major reductions or shutdowns of operations in the service territory.

4. PEF supplies load and energy service to wholesale customers on a "full", "partial" and "supplemental" requirement basis. Full requirements (FR) customers' demand and energy is assumed to grow at a rate that approximates their historical trend. Partial requirements (PR) customer load is assumed to reflect the current contractual obligations received by PEF as of May 31, 2004. The forecast of energy and demand to PR customers reflects the nature of the stratified load they have contracted for, plus their ability to receive dispatched energy from power marketers any time it is more economical for them to do so. Contracts for PR service included in this forecast are with FMPA, New Smyrna Beach, Tallahassee, Homestead, Reedy Creek Utilities, Florida Power & Light, and Seminole Electric Cooperative, Inc. (SECI). PEF's contractual arrangement with SECI includes a "supplemental" service contract (1983 contract) for service over and above stated levels they commit to supply themselves. The firm PR contract with SECI includes 150 MW of stratified intermediate service (October 1995 contract) which is projected to continue through the forecast horizon. The firm PR contract with SECI also includes amendments to provide an additional 150 MW of stratified intermediate service beginning June 2006, and 150 MW of stratified peaking service beginning December 2006. Agreements to provide interruptible service at three individual SECI metering sites have also been included in this projection. A full requirement contract has also been added to the forecast starting in 2010 and lasting through the forecast horizon. Finally, a 50MW contract – the “Market Mitigation Sale” – will be sold to SECI through March 2007.
5. This forecast assumes that PEF will successfully renew all future franchise agreements.
6. This forecast incorporates demand and energy reductions from PEF's dispatchable and non-dispatchable DSM programs required to meet the approved goals set by the Florida Public Service Commission.

7. Expected energy and demand reductions from self-service cogeneration are also included in this forecast. PEF will supply the supplemental load of self-service cogeneration customers. While PEF offers "standby" service to all cogeneration customers, the forecast does not assume an unplanned need for standby power.
8. This forecast assumes that the regulatory environment and the obligation to serve our retail customers will continue throughout the forecast horizon. Regarding wholesale customers, the company does not plan for generation resources unless a long-term contract is in place. Current FR customers are assumed to renew their contracts with PEF except those who have given notice to terminate. Current PR contracts are projected to terminate as terms reach their expiration date. Deviation from these assumptions can occur based on information provided by the Progress Energy Ventures term marketing organization.

SHORT-TERM ECONOMIC ASSUMPTIONS

The short-term economic outlook (one year out) calls for a gradual strengthening of national and State economic growth as the recovery from the recent recession takes hold and terrorism fears subside. As this forecast was developed, signs of an improving economy were beginning to be reflected in reported GDP growth. Employment growth had just commenced after a long period of contraction. Monetary policy announcements suggested a return to more normal levels of interest rates and monetary growth. A fifty-year low in market interest rates - coaxed by the Federal Reserve Board (FED) – and lower Federal tax rates appear to have stimulated the U.S. economy enough to warrant a less accommodative monetary policy.

The extremely accommodative fiscal and monetary policies since late 2001, the passage of time from the terror attack of 9/11, and the working off of excess investment of the “bubble” economy, have put the U.S. and Florida economies on track for reasonably consistent growth for the foreseeable future. As consumer confidence rebounds, more reasonable returns on investment will enable businesses to resume hiring. A weaker dollar should make domestic producers more competitive.

Particular sectors of the economy that have been performing well include the housing industry and the individual consumer. Both have been credited with fueling the limited economic advances of the past two years. The multi-generational low in interest rates and expansion of credit has stimulated an unprecedented level of housing construction. The record level of mortgage refinancing and lowering of Federal taxes have acted to put added money in people's pockets, further stimulating demand.

While most signs point toward an improving economic environment, there are some risks that were considered in the development of this forecast. Market prices for energy have been very high for an extended period at this point. Historically, high oil prices have resulted in starving economic growth. Fears of a shortage in supplies has kept natural gas prices high as well and has placed increased burden on manufacturers who rely upon reasonably priced fuel as a major source of production.

An additional risk comes as the FED increases interest rates. Some economists believe that the housing sector has been over-simulated by record-low interest rates. Others believe that Americans have "loaded up" on debt and will be negatively impacted by higher debt-service as interest rates rise. The FED must carefully balance the risks staving off higher inflation without starving economic growth. Higher inflation could force up market-driven interest rates faster than the FED would prefer. This event would certainly hurt the housing sector as well as consumer spending. This forecast tries to balance this and other risks by incorporating the National and State economic projections developed by Economy.Com.

LONG-TERM ECONOMIC ASSUMPTIONS

The long-term economic outlook assumes that changes in economic and demographic conditions will follow a trended behavior pattern. The main focus involves identifying these trends. No attempt is made to predict business cycle fluctuations during this period.

Population Growth Trends

This forecast assumes Florida will experience slower in-migration and population growth over parts of the long term, as reflected in the BEBR projections.

Florida's climate and low cost of living have historically attracted a major share of the retirement population from the eastern half of the United States. This will continue to occur, but at less than historic rates for several reasons. First, Americans entering retirement age during the late 1990s and early twenty-first century were born during the Great Depression era of the 1930s. This decade experienced a low birth rate due to the economic conditions at that time. Now that this generation is retiring, there exists a smaller pool of retirees capable of migrating to Florida. As we enter into the second decade of the new century and the baby-boom generation enters retirement age, the reverse effect can be expected.

Second, the enormous growth in population and corresponding development of the 1980s and 1990s made portions of Florida less desirable for retirement living. This diminished the quality of retiree life, and along with increasing competition from neighboring states, is expected to cause a slight decline in Florida's share of these prospective new residents over the long term.

Another reason for a population growth slowdown deals with a younger age cohort. With the bulk of Florida's in-migrants under age 45, the baby boom generation born between 1945 and 1963 helped fuel the rapid population increase Florida experienced during the 1980s. In fact, slower population in-migration to Florida can be expected as the baby boom generation enters the 40s and 50s age bracket. This age group has been significantly characterized as immobile when studies focusing on interstate population flows or job changes are conducted.

Economic Growth Trends

Florida's rapid population growth of the 1980s created a period of strong job creation, especially in the service sector industries. While the service-oriented economy expanded to support an increasing population level, there were also significant numbers of corporations migrating to Florida capitalizing on the low cost, low tax business environment. This being the case, increased job opportunities in Florida created greater in-migration among the nation's working age population. Florida's ability to attract businesses from other states because of its "comparative advantage" is expected to continue throughout the forecast period but at a less significant level. Florida's successful effort to attract a "big league" biotech firm, Script's

Research, has the potential to draw a whole new growth industry to the State, the same way Disney and NASA once did.

The forecast assumes negative growth in real electricity price. That is, the change in the nominal price of electricity over time is expected to be less than the overall rate of inflation. This also implies that fuel price escalation will track at or below the general rate of inflation throughout the forecast horizon.

Real personal incomes are assumed to increase throughout the forecast period thereby boosting the average customer's ability to purchase electricity -- especially since the price of electricity is expected to increase at a rate below general inflation. As incomes grow faster than the price of electricity, consumers, on average, will remain inclined to purchase additional electric appliances and increase their utilization of existing end-uses.

FORECAST METHODOLOGY

The PEF forecast of customers, energy sales and peak demand is developed using customer class-specific econometric models. These models are expressly designed to capture class-specific variation over time. By modeling customer growth and average energy usage individually, the forecaster can better capture subtle changes in existing customer usage as well as growth from new customers. Peak demand models are projected on a disaggregated basis as well. This allows for appropriate handling of individual assumptions in the areas of wholesale contracts, load management and interruptible service.

ENERGY AND CUSTOMER FORECAST

In the retail jurisdiction, customer class models have been specified showing a historical relationship to weather and economic/demographic indicators using monthly data for sales models and annual data for customer models. Sales are regressed against "driver" variables that best explain monthly fluctuations over the historical sample period. Forecasts of these input variables are either derived internally or come from a review of the latest projections made by several independent forecasting concerns. The external sources of data include Economy.Com and the University of Florida's Bureau of Economic and Business Research. Internal company forecasts are

used for projections of electricity price, weather conditions and the length of the billing month. Normal weather, which is assumed throughout the forecast horizon, is based on the 30-year average of heating and cooling degree-days by month as measured at the St Petersburg, Orlando and Tallahassee weather stations. Projections of PEF's demand-side management (conservation programs) are also incorporated as reductions to the forecast. Specific sectors are modeled as follows:

Residential Sector

Residential kWh usage per customer is modeled as a function of real Florida personal income, cooling degree-days, heating degree-days, the real price of electricity to the residential class and the average number of billing days in each sales month. This equation captures significant variation in residential usage caused by economic cycles, weather fluctuations, electric price movements and sales month duration. Projections of kWh usage per customer combined with the customer forecast provide the forecast of total residential energy sales. The residential customer forecast is developed by correlating annual customer growth with PEF service area population growth and mortgage rates. County level population projections for the 29 counties, in which PEF serves residential customers, are provided by the BEBR.

Commercial Sector

Commercial kWh use per customer is forecast based on commercial (non-agricultural, non-manufacturing and non-governmental) employment, the real price of electricity to the commercial class, the average number of billing days in each sales month and heating and cooling degree-days. The measure of cooling degree-days utilized here differs slightly from that used in the residential sector reflecting the unique behavior pattern of this class with respect to its cooling needs. Commercial customers are projected as a function of the number of residential customers served.

Industrial Sector

Energy sales to this sector are separated into two sub-sectors. A significant portion of industrial energy use is consumed by the phosphate mining industry. Because this one industry comprises nearly a 30% share of the total industrial class, it is separated and modeled apart from the rest of the class. The term "non-phosphate industrial" is used to refer to those customers who comprise the

remaining portion of total industrial class sales. Both groups are impacted significantly by changes in economic activity. However, adequately explaining sales levels requires separate explanatory variables. Non-phosphate industrial energy sales are modeled using Florida manufacturing employment and a Florida industrial production index developed by Economy.Com, the real price of electricity to the industrial class, and the average number of sales month billing days.

The industrial phosphate mining industry is modeled using customer-specific information with respect to expected market conditions. Since this sub-sector is comprised of only five customers, the forecast is dependent upon information received from direct customer contact. PEF industrial customer representatives provide specific phosphate customer information regarding customer production schedules, inventory levels, area mine-out and start-up predictions, and changes in self-generation or energy supply situations over the forecast horizon.

Street Lighting

Electricity sales to the street and highway lighting class are projected to increase due to growth in the service area population base. Because this class comprised less than 0.01% of PEF's 2004 electric sales and just 0.1% of total customers, a simple time trend was used to project energy consumption and customer growth in this class.

Public Authorities

Energy sales to public authorities (SPA), comprised mostly of government operated services, is also projected to grow with the size of the service area. The level of government services, and thus energy use per customer, can be tied to the population base, as well as to the state of the economy. Factors affecting population growth will affect the need for additional governmental services (i.e., schools, city services, etc.) thereby increasing SPA energy usage per customer. Government employment has been determined to be the best indicator of the level of government services provided. This variable, along with heating and cooling degree-days, the real price of electricity and the average number of sales month billing days, results in a significant level of explained variation over the historical sample period. Intercept shift variables are also included in this model to account for the large change in school-related energy use in the billing months of January, July and August. SPA customers are projected linearly as a function of a time-trend.

Sales for Resale Sector

The Sales for Resale sector encompasses all firm sales to other electric power entities. This includes sales to other utilities (municipal or investor-owned) as well as power agencies (Rural Electric Authority or Municipal).

Seminole Electric Cooperative, Incorporated (SECI) is a wholesale, or sales for resale, customer of PEF on both a supplemental contract basis and contract demand basis. Under the supplemental contract, PEF provides service for those energy requirements above the level of generation capacity served by either SECI's own facilities or its firm purchase obligations. Monthly supplemental energy is developed using an average of several years' historical load shape of total load in the PEF control area, subtracting out the level of SECI "committed" capacity from each hour. Beyond supplemental service, PEF has an agreement with SECI to serve stratified intermediate and peaking energy. This agreement involves serving 150 MW of stratified intermediate demand that is assumed to remain a requirement on the PEF system throughout the forecast horizon. This contract has been amended to provide an additional 150 MW stratified intermediate product and a 150 MW stratified peaking product beginning in 2006. Energy usage under this contract is projected using typical intermediate and peak load factors, respectively. Agreements to provide non-firm or interruptible service are currently in effect between PEF and SECI at three separate metering points amounting to an estimated 50 MW. Two new contracts were signed in 2004. A full requirements service contract was agreed to for 150 MW beginning in 2010 and a 50 MW contract – the "Market Mitigation Sale" begins in January 2005 and ends in March 2007.

The municipal sales for resale class includes a number of customers, divergent not only in scope of service, (i.e., full or partial requirement), but also in composition of ultimate consumers. Each customer is modeled separately in order to accurately reflect its individual profile. The majority of customers in this class are municipalities whose full energy requirements are met by PEF. The full requirement customers are modeled individually using local weather station data and population growth trends. Since the ultimate consumers of electricity in this sector are, to a large degree, residential and commercial customers, it is assumed that their use patterns will follow those of the PEF retail-based residential and commercial customer classes. PEF serves partial requirement

service (PR) to municipalities such as New Smyrna Beach (NSB), Homestead and Tallahassee, and other power providers like Florida Municipal Power Agency (FMPA) and Florida Power & Light. In each case, these customers contract with PEF for a specific level and type of demand needed to provide their particular electrical system with an appropriate level of reliability. The terms of the FMPA and NSB contracts are subject to change each year via a letter of “declared” MW nomination. More specifically, this means that the level and type of demand and energy under contract can increase or decrease for each year a value is nominated. The energy forecast for each contract is derived using its historical load factors where enough history exists, or typical load factors for a given type of contracted stratified load. The energy projections for the Florida Municipal Power Agency (FMPA) also include a "losses service contract" for energy PEF supplies to FMPA for transmission losses incurred when "wheeling" power to their ultimate customers in PEF's transmission area. This projection is based on the projected requirements of the aggregated needs of the cities of Ocala, Leesburg and Bushnell.

PEAK DEMAND FORECAST

The forecast of peak demand also employs a disaggregated econometric methodology. For seasonal (winter and summer) peak demands, as well as each month of the year, PEF's coincident system peak is dissected into five major components. These components consist of potential firm retail load, conservation and load management program capability, wholesale demand, company use demand and interruptible demand.

Potential firm retail load refers to projections of PEF retail hourly seasonal net peak demand (excluding the non-firm interruptible/curtailable/standby services) before the cumulative effects of any conservation activity or the activation of PEF's Load Management program. The historical values of this series are constructed to show the size of PEF's firm retail net peak demand assuming no utility-induced conservation or load control had taken place. The value of constructing such a "clean" series enables the forecaster to observe and correlate the underlying trend in retail peak demand to total system customer levels and coincident weather conditions at the time of the peak without the impacts of year-to-year variation in conservation activity or load control reductions. Seasonal peaks are projected using historical seasonal peak data regardless of which month the peak occurred. The projections become the potential retail demand projection for the month of January (winter) and August (summer) since this is typically when the seasonal peaks occur. The non-

seasonal peak months are projected the same as the seasonal peaks, but the analysis is limited to the specific month being projected.

Energy conservation and direct load control estimates are consistent with PEF's DSM goals that have been approved by the Florida Public Service Commission. These estimates are incorporated into the MW forecast. Projections of dispatchable and cumulative non-dispatchable DSM are subtracted from the projection of potential firm retail demand resulting in a projected series of retail demand figures one would expect to occur.

Sales for Resale demand projections represent load supplied by PEF to other electric utilities such as SECI, FMPA, and other electric distribution companies. The SECI supplemental demand projection is based on a trend of their historical demand within the PEF control area. The level of MW to be served by PEF is dependent upon the amount of generation resources SECI supplies itself or contracts from others. An assumption has been made that beyond the last year of committed capacity declaration (five years out), SECI will shift their level of self-serve resources to meet their base and intermediate load needs. For FMPA and NSB demand projections, historical ratios of coincident-to-contract levels of demand are applied to future MW contract levels. Demand requirements continue at the MW level indicated by the final year in their respective contract declaration letter. The full requirements municipal demand forecast is estimated for individual cities using linear econometric equations modeling both weather and economic impacts specific to each locale. The seasonal (winter and summer) projections become the January and August peak values, respectively. The non-seasonal peak months are calculated using monthly allocation factors derived from applying the historical relationship between each winter month (November to March) relative to the winter peak, and each summer month (April to October) in relation to the summer peak demand.

PEF "company use" at the time of system peak is estimated using load research metering studies and is assumed to remain stable over the forecast horizon. The interruptible and curtailable service (IS and CS) load component is developed from historic trends, as well as the incorporation of specific information obtained from PEF's large industrial accounts by field representatives.

Each of the peak demand components described above is a positive value except for the DSM program MW impacts and IS and CS load. These impacts represent a reduction in peak demand and are assigned a negative value. Total system peak demand is then calculated as the arithmetic sum of the five components.

HIGH AND LOW FORECAST SCENARIOS

The high and low bandwidth scenarios around the base MWh energy sales forecast are developed using a Monte Carlo simulation applied to a multivariate regression model that closely replicates the base retail MWh energy forecast in aggregate. This model accounts for variation in Gross Domestic Product, retail customers and electricity price. The base forecasts for these variables were developed based on input from Economy.Com and internal company price projections. Variation around the base forecast predictor variables used in the Monte Carlo simulation was based on an 80 percent confidence interval calculated around variation in each variable's historic growth rate. While the total number of degree-days (weather) was also incorporated into the model specification, the high and low scenarios do not attempt to capture extreme weather conditions. Normal weather conditions were assumed in all three scenarios.

The Monte Carlo simulation was produced through the estimation of 1,000 scenarios for each year of the forecast horizon. These simulations allowed for random normal variation in the growth trajectories of the economic input variables (while accounting for cross-correlation amongst these variables), as well as simultaneous variation in the equation (model error) and coefficient estimates. These scenarios were then sorted and rank ordered from one to a thousand, while the simulated scenario with no variation was adjusted to equal the base forecast.

The low retail scenario was chosen from among the ranked scenarios resulting in a bandwidth forecast reflecting an approximate probability of occurrence of 0.10. The high retail scenario similarly represents a bandwidth forecast with an approximate probability of occurrence of 0.90. In both scenarios the high and low peak demand bandwidth forecasts are projected from the energy forecasts using the load factor implicit in the base forecast scenario.

CONSERVATION

PEF's historical DSM performance is shown in the following tables, which compare the conservation savings actually achieved through PEF's DSM programs for the reporting years of 2000-2004 with the Commission-approved conservations goals for those same years.

Historical Residential Conservation Savings Goals and Achievements

Year	Cumulative Summer MW		Cumulative Winter MW		* Annual Cumulative GWh Energy	
	Goal	Achieved	Goal	Achieved	Goal	Achieved
2000	10	17	30	35	15	21
2001	20	29	64	72	32	42
2002	32	43	102	111	50	65
2003	45	59	142	152	69	90
2004	58	74	185	186	88	114

Historical Commercial/Industrial Conservation Savings Goals and Achievements

Year	Cumulative Summer MW		Cumulative Winter MW		* Annual Cumulative GWh Energy	
	Goal	Achieved	Goal	Achieved	Goal	Achieved
2000	4	12	4	12	2	6
2001	8	18	7	17	4	10
2002	11	28	11	24	6	14
2003	15	35	15	29	8	18
2004	19	59	18	52	10	21

* Represents only the annual energy contribution not the total cumulative energy savings over the life of the measures.

On August 9, 2004, the FPSC issued a PAA Order approving new conservation goals for PEF that span the ten-year period from 2005 through 2014 (in Docket 040031-EG, Order No. PSC-04-0769-PAA-EG). In that same PAA Order, the Commission also approved a new DSM Plan for PEF that was specifically designed to meet the new conservation goals. The PAA Order was

subsequently made effective and final in a Consummating Order (PSC-04-0852-CO-EG) issued by the Commission on September 1, 2004.

The forecasts contained in this Ten-Year Site Plan document are based on PEF's new DSM Plan and, therefore, appropriately reflect the level of DSM savings required to meet the Commission-established conservation goals. PEF's DSM Plan consists of five residential programs, seven commercial and industrial programs, and one research and development program. The programs are subject to periodic monitoring and evaluation for the purpose of ensuring that all DSM resources are acquired in a cost-effective manner and that the program savings are durable. Following is a brief description of these programs.

RESIDENTIAL PROGRAMS

Home Energy Check Program

This energy audit program provides customers with an analysis of their current energy use and recommendations on how they can save on their electricity bills through low-cost or no-cost energy-saving practices and measures. The Home Energy Check program offers PEF customers the following types of audits: Type 1: Free Walk-Through Audit (Home Energy Check); Type 2: Customer-completed Mail In Audit (Do It Yourself Home Energy Check); Type 3: Online Home Energy Check (Internet Option)-a customer-completed audit; Type 4: Phone Assisted Audit –A customer assisted survey of structure and appliance use; Type 5: Computer Assisted Audit; Type 6: Home Energy Rating Audit (Class I, II, III). The Home Energy Check Program serves as the foundation of the Home Energy Improvement Program in that the audit is a prerequisite for participation in the energy saving measures offered in the Home Energy Improvement Program.

Home Energy Improvement Program

This is the umbrella program to increase energy efficiency for existing residential homes. It combines efficiency improvements to the thermal envelope with upgraded electric appliances. The program provides incentives for attic insulation upgrades, duct testing and repair, and high efficiency electric heat pumps.

Residential New Construction Program

This program promotes energy efficient new home construction in order to provide customers with more efficient dwellings combined with improved environmental comfort. The program provides education and information to the design and building community on energy efficient equipment and construction. It also facilitates the design and construction of energy efficient homes by working directly with the builders to comply with program requirements. The program provides incentives to the builder for high efficiency electric heat pumps and high performance windows. The highest level of the program incorporates the Environmental Protection Agency's Energy Star Homes Program and qualifies participants for cooperative advertising.

Low Income Weatherization Assistance Program

This umbrella program seeks to improve energy efficiency for low-income customers in existing residential dwellings. It combines efficiency improvements to the thermal envelope with upgraded electric appliances. The program provides incentives for attic insulation upgrades, duct testing and repair, reduced air infiltration, water heater wrap, HVAC maintenance, high efficiency heat pumps, heat recovery units, and dedicated heat pump water heaters.

Residential Energy Management Program

This is a voluntary customer program that allows PEF to reduce peak demand and thus defer generation construction. Peak demand is reduced by interrupting service to selected electrical equipment with radio controlled switches installed on the customer's premises. These interruptions are at PEF's option, during specified time periods, and coincident with hours of peak demand. Participating customers receive a monthly credit on their electricity bills.

COMMERCIAL/INDUSTRIAL (C/I) PROGRAMS

Business Energy Check Program

This energy audit program provides commercial and industrial customers with an assessment of the current energy usage at their facilities, recommendations on how they can improve the environmental conditions of their facilities while saving on their electricity bills, and information on low-cost energy efficiency measures. The Business Energy Check consists of the following

types of audits: A free walk-through audit, and a paid walk-through audit. Small business customers also have the option to complete a Business Energy Check online at Progress Energy's website. In most cases, this program is a prerequisite for participation in the other C/I programs.

Better Business Program

This is the umbrella efficiency program for existing commercial and industrial customers. The program provides customers with information, education, and advice on energy-related issues and incentives on efficiency measures that are cost-effective to PEF and its customers. The Better Business Program promotes energy efficient heating, ventilation, air conditioning (HVAC), and some building retrofit measures (in particular, ceiling insulation upgrade, duct leakage test and repair, energy-recovery ventilation and Energy Star cool roof coating products.)

Commercial/Industrial New Construction Program

The primary goal of this program is to foster the design and construction of energy efficient buildings. The new construction program: 1) provides education and information to the design community on all aspects of energy efficient building design; 2) requires that the building design, at a minimum, surpass the state energy code; 3) provides financial incentives for specific energy efficient equipment; and 4) provides energy design awards to building design teams. Incentives will be provided for high efficiency HVAC equipment, energy recovery ventilation and Energy Star cool roof coating products.

Innovation Incentive Program

This program promotes a reduction in demand and energy by subsidizing energy conservation projects for customers in PEF's service territory. The intent of the program is to encourage legitimate energy efficiency measures that reduce kW demand and/or kWh energy, but are not addressed by other programs. Energy efficiency opportunities are identified by PEF representatives during a Business Energy Check audit. If a candidate project meets program specifications, it will be eligible for an incentive payment, subject to PEF approval.

Commercial Energy Management Program (Rate Schedule GSLM-1)

This direct load control program reduces PEF's demand during peak or emergency conditions. As described in PEF's DSM Plan, this program is currently closed to new participants. It is applicable to existing program participants who have electric space cooling equipment suitable for interruptible operation and are eligible for service under the Rate Schedule GS-1, GST-1, GSD-1, or GSDD-1. The program is also applicable to existing participants who have any of the following electrical equipment installed on permanent residential structures and utilized for domestic (household) purposes: 1) water heater(s), 2) central electric heating systems(s), 3) central electric cooling system(s), and/or 4) swimming pool pump(s). Customers receive a monthly credit on their bills depending on the type of equipment in the program and the interruption schedule.

Standby Generation Program

This demand control program reduces PEF's demand based upon the indirect control of customer generation equipment. This is a voluntary program available to all commercial, industrial, and agricultural customers who have on-site generation capability and are willing to reduce their PEF demand when PEF deems it necessary. The customers participating in the Standby Generation program receive a monthly credit on their electricity bills according to the demonstrated ability of the customer to reduce demand at PEF's request.

Interruptible Service Program

This direct load control program reduces PEF's demand at times of capacity shortage during peak or emergency conditions. The program is available to qualified non-residential customers with an average billing demand of 500 kW or more, who are willing to have their power interrupted. PEF will have remote control of the circuit breaker or disconnect switch supplying the customer's equipment. In return for this ability to interrupt load, customers participating in the Interruptible Service program receive a monthly interruptible demand credit applied to their electric bills.

Curtable Service

This direct load control program reduces PEF's demand at times of capacity shortage during peak or emergency conditions. The program is available to qualified non-residential customers with an average billing demand of 500 kW or more, who are willing to curtail 25 percent of their average monthly billing demand. Customers participating in the Curtable Service program receive a monthly curtable demand credit applied to their electric bills.

RESEARCH AND DEVELOPMENT PROGRAMS

Technology Development Program

The primary purpose of this program is to establish a system to "Aggressively pursue research, development and demonstration projects jointly with others as well as individual projects" (Rule 25-17.001, {5}(f), Florida Administration Code). PEF will undertake certain development, educational and demonstration projects that have promise to become cost-effective demand reduction and energy efficiency programs. In most cases, each demand reduction and energy efficiency project that is proposed and investigated under this program requires field testing with actual customers.

CHAPTER 3

*FORECAST OF
FACILITIES REQUIREMENTS*



This page intentionally left blank

CHAPTER 3
FORECAST OF FACILITIES REQUIREMENTS

RESOURCE PLANNING FORECAST

OVERVIEW OF CURRENT FORECAST

Supply-Side Resources

PEF has a summer total capacity resource of 9,769 MW, as shown in Table 3.1. This capacity resource includes utility purchased power (474 MW), non-utility purchased power (820 MW), combustion turbine (2,619 MW, 143 MW of which is owned by Georgia Power for the months June through September), nuclear (769 MW), fossil steam (3,882 MW) and combined-cycle plants (1,205 MW). Table 3.2 shows PEF's contracts for firm capacity provided by Qualifying Facilities (QFs).

Demand-Side Programs

Total DSM resources are shown in Schedules 3.1.1 and 3.2.1 of Chapter 2. These programs include Non-Dispatchable DSM, Interruptible Load, and Dispatchable Load Control resources. PEF's 2005 Ten-Year Site Plan Demand-Side Management projections are consistent with the DSM Goals established by the Commission in Docket No. 040031-EG.

Capacity and Demand Forecast

PEF's forecasts of capacity and demand for the projected summer and winter peaks are shown in Schedules 7.1 and 7.2, respectively. PEF's forecasts of capacity and demand are based on serving expected growth in retail requirements in its regulated service area and meeting commitments to wholesale power customers who have entered into supply contracts with PEF. In its planning process, PEF balances its supply plan for the needs of retail and wholesale customers and endeavors to ensure that cost-effective resources are available to meet the needs across the customer base. Over the years, as wholesale markets have grown more competitive, PEF has remained active in the competitive solicitations while planning in a manner that maintains an appropriate balance of commitments and resources within the overall regulated supply framework.

Base Expansion Plan

PEF's planned supply resource additions and changes are shown in Schedule 8 and are referred to as PEF's Base Expansion Plan. This Plan includes 3,357 MW (summer rating) of proposed new capacity additions through the summer of 2014. As identified in Schedule 8, PEF's next planned need is the Hines 3 Unit, a 516 MW (summer) power block with a December 2005 in-service date. PEF's self-build option for Hines Unit 3 was determined to be the most cost-effective alternative (FPSC Docket No. 020953-EI, Order No. PSC-03-0175-FOF-EI, issued February 4, 2003). After Hines 3, the next planned unit is Hines 4, 461 MW (summer) power block with a December 2007 in-service date. Hines Unit 4 was granted its Need Certificate by the FPSC in November 2004 (Docket No. 040817-EI, Order No. PSC-04-1168-FOF-EI).

PEF's Base Expansion Plan projects requirements for additional combined-cycle units with proposed in-service dates of 2009, 2010, 2012, 2013 and 2014. These high efficiency gas-fired combined-cycle units, together with the Central Power & Lime Purchase from December 2005 through December 2015, the Shady Hills Purchase from December 2006 through April 2014, and the Southern Company Purchase from June 2010 through December 2015 help the PEF system meet the growing energy requirements of its customer base and also contribute to meeting the requirements of the 1990 Clean Air Act Amendments. Fuel switching, SO₂ emission allowance purchases, re-dispatching of system generation and technology improvements are additional options available to PEF to ensure compliance with these important environmental requirements. Status reports and specifications for new generation facilities are included in Schedule 9. As shown in Schedule 10, there are no new transmission lines associated with the Hines 3 combined-cycle unit, and only one new line (Hines-West Lake Wales 230 kV) required for the Hines 4 combined-cycle unit.

Current planning studies identify gas-fired units as the most economic alternatives for system expansion over the ten-year planning term. New coal units may become a competitive option beyond the ten-year timeframe should forecasted gas prices continue to increase versus coal over that term. The uncertainties associated with fuel price forecasts and the long lead times required to site, permit, license, engineer, and construct a coal unit will require additional study of coal options in the next planning cycle.

The recently issued Clean Air Interstate Rule (CAIR) may impact PEF's need for new capacity. While a compliance plan has not yet been finalized, some alternatives may impact the capacity of existing and/or future generation resources, resulting in a need for additional capacity. Once the compliance plan has been finalized, PEF will quantify the impacts on generating resources and determine if any additional capacity is needed.

TABLE 3.1

PROGRESS ENERGY FLORIDA

TOTAL CAPACITY RESOURCES OF

POWER PLANTS AND PURCHASED POWER CONTRACTS

AS OF DECEMBER 31, 2004

PLANTS	NUMBER OF UNITS	SUMMER NET DEPENDABLE CAPABILITY (MW)
Nuclear Steam		
Crystal River	<u>1</u>	<u>769</u> (1)
Total Nuclear Steam	1	769
Fossil Steam		
Crystal River	4	2,302
Anclote	2	993
Paul L. Bartow	3	444
Suwannee River	<u>3</u>	<u>143</u>
Total Fossil Steam	12	3,882
Combined-cycle		
Hines Energy Complex	2	998
Tiger Bay	<u>1</u>	<u>207</u>
Total Combined-cycle	3	1,205
Combustion Turbine		
DeBary	10	667
Intercession City	14	1,041 (2)
Bayboro	4	184
Bartow	4	187
Suwannee	3	164
Turner	4	154
Higgins	4	122
Avon Park	2	52
University of Florida	1	35
Rio Pinar	<u>1</u>	<u>13</u>
Total Combustion Turbine	47	2,619
Total Units	63	
Total Net Generating Capability		8,475
<i>(1) Adjusted for sale of approximately 8.2% of total capacity</i>		
<i>(2) Includes 143 MW owned by Georgia Power Company (Jun-Sep)</i>		
Purchased Power		
Qualifying Facility Contracts	19	820
Investor Owned Utilities	2	474
TOTAL CAPACITY RESOURCES		9,769

TABLE 3.2
PROGRESS ENERGY FLORIDA
QUALIFYING FACILITY GENERATION CONTRACTS
AS OF DECEMBER 31, 2004

Facility Name	Firm Capacity (MW)
Bay County Resource Recovery	11.0
Cargill	15.0
Dade County Resource Recovery	43.0
El Dorado	114.2
Jefferson Power	2.0
Lake Cogen	110.0
Lake County Resource Recovery	12.8
LFC Jefferson	8.5
LFC Madison	8.5
Mulberry	79.2
Orange Cogen (CFR-Biogen)	74.0
Orlando Cogen	79.2
Pasco Cogen	109.0
Pasco County Resource Recovery	23.0
Pinellas County Resource Recovery	54.8
Ridge Generating Station	39.6
Royster	30.8
US Agrichem	5.6
TOTAL	820.20

PROGRESS ENERGY FLORIDA

SCHEDULE 7.1

FORECAST OF CAPACITY, DEMAND AND SCHEDULED MAINTENANCE

AT TIME OF SUMMER PEAK

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	
	TOTAL	FIRM	FIRM		TOTAL	SYSTEM FIRM						
	INSTALLED	CAPACITY	CAPACITY		CAPACITY	SUMMER PEAK	RESERVE MARGIN		SCHEDULED	RESERVE MARGIN		
	CAPACITY	IMPORT	EXPORT	QF	AVAILABLE	DEMAND	BEFORE MAINTENANCE		MAINTENANCE	AFTER MAINTENANCE		
YEAR	MW	MW	MW	MW	MW	MW	MW	% OF PEAK	MW	MW	% OF PEAK	
2005	8,332	799	*	0	820	9,951	8,173	1,778	22%	0	1,778	22%
2006	8,848	767	*	0	820	10,435	8,663	1,772	20%	0	1,772	20%
2007	8,848	1,087		0	802	10,737	8,958	1,779	20%	0	1,779	20%
2008	9,309	1,087		0	787	11,183	9,187	1,996	22%	0	1,996	22%
2009	9,309	1,087		0	787	11,183	9,353	1,830	20%	0	1,830	20%
2010	9,785	1,098		0	787	11,670	9,719	1,951	20%	0	1,951	20%
2011	10,261	1,028		0	787	12,076	9,926	2,150	22%	0	2,150	22%
2012	10,737	1,028		0	787	12,552	10,138	2,414	24%	0	2,414	24%
2013	10,737	1,028		0	677	12,442	10,355	2,087	20%	0	2,087	20%
2014	11,689	550		0	490	12,729	10,567	2,162	20%	0	2,162	20%

* Progress Energy is pursuing seasonal purchases of approximately 300 MW in 2005 and 150 MW in 2006. The deals are not yet consummated as of the time of the Ten-Year Site Plan filing. Since the purchase is expected to be from peaking capacity, no energy impact has been included in the plan at this time.

The recently issued Clean Air Interstate Rule (CAIR) may impact PEF's need for new capacity. While a compliance plan has not yet been finalized, some alternatives may impact the capacity of existing and/or future generation resources, resulting in a need for additional capacity. Once the compliance plan has been finalized, PEF will quantify the impacts on generating resources and determine if any additional capacity is needed.

PROGRESS ENERGY FLORIDA

SCHEDULE 7.2

FORECAST OF CAPACITY, DEMAND AND SCHEDULED MAINTENANCE

AT TIME OF WINTER PEAK

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)
YEAR	TOTAL	FIRM	FIRM	QF	TOTAL	SYSTEM FIRM	RESERVE MARGIN BEFORE MAINTENANCE	% OF PEAK	SCHEDULED	RESERVE MARGIN	% OF PEAK
	INSTALLED	CAPACITY	CAPACITY		CAPACITY	WINTER PEAK			MAINTENANCE	AFTER MAINTENANC	
	CAPACITY	IMPORT	EXPORT		AVAILABLE	DEMAND			MAINTENANCE	MAINTENANCE	
	MW	MW	MW	MW	MW	MW	MW		MW	MW	
2004 / 05	9,174	672 *	0	820	10,666	8,914	1,752	20%	0	1,752	20%
2005 / 06	9,756	767	0	820	11,343	9,201	2,142	23%	0	2,142	23%
2006 / 07	9,756	1,287	0	802	11,844	9,704	2,140	22%	0	2,140	22%
2007 / 08	10,273	1,129	0	787	12,188	9,916	2,272	23%	0	2,272	23%
2008 / 09	10,273	1,129	0	787	12,188	10,133	2,055	20%	0	2,055	20%
2009 / 10	10,821	1,129	0	787	12,736	10,514	2,222	21%	0	2,222	21%
2010 / 11	11,369	1,140	0	787	13,295	10,741	2,554	24%	0	2,554	24%
2011 / 12	11,369	1,070	0	787	13,225	10,963	2,262	21%	0	2,262	21%
2012 / 13	11,917	1,070	0	787	13,773	11,189	2,584	23%	0	2,584	23%
2013 / 14	12,465	1,070	0	502	14,037	11,411	2,626	23%	0	2,626	23%

* Includes Seasonal Purchase of 188 MW in 2004/05.

The recently issued Clean Air Interstate Rule (CAIR) may impact PEF's need for new capacity. While a compliance plan has not yet been finalized, some alternatives may impact the capacity of existing and/or future generation resources, resulting in a need for additional capacity. Once the compliance plan has been finalized, PEF will quantify the impacts on generating resources and determine if any additional capacity is needed.

PROGRESS ENERGY FLORIDA

SCHEDULE 8
 PLANNED AND PROSPECTIVE GENERATING FACILITY ADDITIONS AND CHANGES

AS OF JANUARY 1, 2004 THROUGH DECEMBER 31, 2014

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
PLANT NAME	UNIT NO.	LOCATION (COUNTY)	UNIT TYPE	FUEL PRI.	FUEL ALT.	TRANSPORT PRI.	TRANSPORT ALT.	CONST.	COM'L IN-	EXPECTED	GEN. MAX.	NET CAPABILITY		STATUS	NOTES
								START MO. / YR	SERVICE MO. / YR	RETIREMENT MO. / YR	NAMEPLATE KW	SUMMER MW	WINTER MW		
HINES ENERGY COMPLEX	3	POLK	CC	NG	DFO	PL	TK	9/2003	12/2005			516	582	V	
HINES ENERGY COMPLEX	4	POLK	CC	NG	DFO	PL	TK	12/2005	12/2007			461	517	T	
HINES ENERGY COMPLEX	5	POLK	CC	NG	DFO	PL	TK	5/2007	12/2009			476	548	P	
HINES ENERGY COMPLEX	6	POLK	CC	NG	DFO	PL	TK	5/2008	12/2010			476	548	P	
COMBINED-CYCLE	1	UNKNOWN	CC	NG	DFO	PL	UN	10/2009	5/2012			476	548	P	
COMBINED-CYCLE	2	UNKNOWN	CC	NG	DFO	PL	UN	5/2011	12/2013			476	548	P	
COMBINED-CYCLE	3	UNKNOWN	CC	NG	DFO	PL	UN	10/2011	5/2014			476	548	P	

PROGRESS ENERGY FLORIDA

SCHEDULE 9

STATUS REPORT AND SPECIFICATIONS OF PROPOSED GENERATING FACILITIES

AS OF JANUARY 1, 2005

(1)	Plant Name and Unit Number:	HINES ENERGY COMPLEX UNIT #3
(2)	Capacity	
	a. Summer:	516
	b. Winter:	582
(3)	Technology Type:	COMBINED-CYCLE
(4)	Anticipated Construction Timing	
	a. Field construction start date:	9/2003
	b. Commercial in-service date:	12/2005 (EXPECTED)
(5)	Fuel	
	a. Primary fuel:	NATURAL GAS
	b. Alternate fuel:	DISTILLATE FUEL OIL
(6)	Air Pollution Control Strategy:	DRY LOW NO _x COMBUSTION with SELECTIVE CATALYTIC REDUCTION
(7)	Cooling Method:	COOLING POND
(8)	Total Site Area:	8,200 ACRES
(9)	Construction Status:	UNDER CONSTRUCTION, MORE THAN 50% COMPLETE
(10)	Certification Status:	SITE PERMITTED
(11)	Status with Federal Agencies:	SITE PERMITTED
(12)	Projected Unit Performance Data	
	a. Planned Outage Factor (POF):	5.8 %
	b. Forced Outage Factor (FOF):	3.0 %
	c. Equivalent Availability Factor (EAF):	91.4 %
	d. Resulting Capacity Factor (%):	75.0 %
	e. Average Net Operating Heat Rate (ANOHR):	7,114 BTU/kWh
(13)	Projected Unit Financial Data	
	a. Book Life (Years):	25
	b. Total Installed Cost (In-service year \$/kW):	435.57
	c. Direct Construction Cost (\$/kW):	389.18
	d. AFUDC Amount (\$/kW):	46.39
	e. Escalation (\$/kW):	0.00
	f. Fixed O&M (\$/kW-yr):	1.35
	g. Variable O&M (\$/MWh):	2.15
	h. K Factor:	NO CALCULATION

PROGRESS ENERGY FLORIDA

SCHEDULE 9

STATUS REPORT AND SPECIFICATIONS OF PROPOSED GENERATING FACILITIES

AS OF JANUARY 1, 2005

(1)	Plant Name and Unit Number:	HINES ENERGY COMPLEX UNIT #4
(2)	Capacity	
	a. Summer:	461
	b. Winter:	517
(3)	Technology Type:	COMBINED-CYCLE
(4)	Anticipated Construction Timing	
	a. Field construction start date:	12/2005
	b. Commercial in-service date:	12/2007 (EXPECTED)
(5)	Fuel	
	a. Primary fuel:	NATURAL GAS
	b. Alternate fuel:	DISTILLATE FUEL OIL
(6)	Air Pollution Control Strategy:	DRY LOW NO _x COMBUSTION with SELECTIVE CATALYTIC REDUCTION
(7)	Cooling Method:	COOLING POND
(8)	Total Site Area:	8,200 ACRES
(9)	Construction Status:	REGULATORY APPROVAL RECEIVED, NOT UNDER CONSTRUCTION
(10)	Certification Status:	SITE PERMITTED
(11)	Status with Federal Agencies:	SITE PERMITTED
(12)	Projected Unit Performance Data	
	a. Planned Outage Factor (POF):	6.0 %
	b. Forced Outage Factor (FOF):	3.0 %
	c. Equivalent Availability Factor (EAF):	91.2 %
	d. Resulting Capacity Factor (%):	62.0 %
	e. Average Net Operating Heat Rate (ANOHR):	7,390 BTU/kWh
(13)	Projected Unit Financial Data	
	a. Book Life (Years):	25
	b. Total Installed Cost (In-service year \$/kW):	479.69
	c. Direct Construction Cost (\$/kW):	429.40
	d. AFUDC Amount (\$/kW):	50.29
	e. Escalation (\$/kW):	0.00
	f. Fixed O&M (\$/kW-yr):	1.23
	g. Variable O&M (\$/MWh):	2.32
	h. K Factor:	NO CALCULATION

PROGRESS ENERGY FLORIDA

**SCHEDULE 9
STATUS REPORT AND SPECIFICATIONS OF PROPOSED GENERATING FACILITIES**

AS OF JANUARY 1, 2005

(1)	Plant Name and Unit Number:	HINES ENERGY COMPLEX UNIT #5 *
(2)	Capacity	
	a. Summer:	476
	b. Winter:	548
(3)	Technology Type:	COMBINED-CYCLE
(4)	Anticipated Construction Timing	
	a. Field construction start date:	5/2007
	b. Commercial in-service date:	12/2009 (EXPECTED)
(5)	Fuel	
	a. Primary fuel:	NATURAL GAS
	b. Alternate fuel:	DISTILLATE FUEL OIL
(6)	Air Pollution Control Strategy:	DRY LOW NO _x COMBUSTION with SELECTIVE CATALYTIC REDUCTION
(7)	Cooling Method:	COOLING POND
(8)	Total Site Area:	8,200 ACRES
(9)	Construction Status:	PLANNED
(10)	Certification Status:	SITE PERMITTED
(11)	Status with Federal Agencies:	SITE PERMITTED
(12)	Projected Unit Performance Data	
	a. Planned Outage Factor (POF):	6.9 %
	b. Forced Outage Factor (FOF):	4.6 %
	c. Equivalent Availability Factor (EAF):	88.8 %
	d. Resulting Capacity Factor (%):	57.0 %
	e. Average Net Operating Heat Rate (ANOHR):	7,309 BTU/kWh
(13)	Projected Unit Financial Data	
	a. Book Life (Years):	25
	b. Total Installed Cost (In-service year \$/kW):	500.16
	c. Direct Construction Cost (\$/kW):	387.01
	d. AFUDC Amount (\$/kW):	72.97
	e. Escalation (\$/kW):	40.18
	f. Fixed O&M (\$/kW-yr):	2.92
	g. Variable O&M (\$/MWh):	1.63
	h. K Factor:	NO CALCULATION

* Progress Energy continues to evaluate alternative sites as well as repowering of existing units.

PROGRESS ENERGY FLORIDA

**SCHEDULE 9
STATUS REPORT AND SPECIFICATIONS OF PROPOSED GENERATING FACILITIES**

AS OF JANUARY 1, 2005

(1)	Plant Name and Unit Number:	HINES ENERGY COMPLEX UNIT #6 *
(2)	Capacity	
	a. Summer:	476
	b. Winter:	548
(3)	Technology Type:	COMBINED-CYCLE
(4)	Anticipated Construction Timing	
	a. Field construction start date:	5/2008
	b. Commercial in-service date:	12/2010 (EXPECTED)
(5)	Fuel	
	a. Primary fuel:	NATURAL GAS
	b. Alternate fuel:	DISTILLATE FUEL OIL
(6)	Air Pollution Control Strategy:	DRY LOW NO _x COMBUSTION with SELECTIVE CATALYTIC REDUCTION
(7)	Cooling Method:	COOLING POND
(8)	Total Site Area:	8,200 ACRES
(9)	Construction Status:	PLANNED
(10)	Certification Status:	SITE PERMITTED
(11)	Status with Federal Agencies:	SITE PERMITTED
(12)	Projected Unit Performance Data	
	a. Planned Outage Factor (POF):	6.9 %
	b. Forced Outage Factor (FOF):	4.6 %
	c. Equivalent Availability Factor (EAF):	88.8 %
	d. Resulting Capacity Factor (%):	57.0 %
	e. Average Net Operating Heat Rate (ANOHR):	7,309 BTU/kWh
(13)	Projected Unit Financial Data	
	a. Book Life (Years):	25
	b. Total Installed Cost (In-service year \$/kW):	512.66
	c. Direct Construction Cost (\$/kW):	387.01
	d. AFUDC Amount (\$/kW):	74.80
	e. Escalation (\$/kW):	50.85
	f. Fixed O&M (\$/kW-yr):	2.92
	g. Variable O&M (\$/MWh):	1.63
	h. K Factor:	NO CALCULATION

* Progress Energy continues to evaluate alternative sites as well as repowering of existing units.

PROGRESS ENERGY FLORIDA

**SCHEDULE 9
STATUS REPORT AND SPECIFICATIONS OF PROPOSED GENERATING FACILITIES**

AS OF JANUARY 1, 2005

(1)	Plant Name and Unit Number:	COMBINED-CYCLE 1
(2)	Capacity	
	a. Summer:	476
	b. Winter:	548
(3)	Technology Type:	COMBINED-CYCLE
(4)	Anticipated Construction Timing	
	a. Field construction start date:	10/2009
	b. Commercial in-service date:	5/2012 (EXPECTED)
(5)	Fuel	
	a. Primary fuel:	NATURAL GAS
	b. Alternate fuel:	DISTILLATE FUEL OIL
(6)	Air Pollution Control Strategy:	DRY LOW NO _x COMBUSTION with SELECTIVE CATALYTIC REDUCTION
(7)	Cooling Method:	UNKNOWN
(8)	Total Site Area:	UNKNOWN ACRES
(9)	Construction Status:	PLANNED
(10)	Certification Status:	PLANNED
(11)	Status with Federal Agencies:	PLANNED
(12)	Projected Unit Performance Data	
	a. Planned Outage Factor (POF):	6.9 %
	b. Forced Outage Factor (FOF):	4.6 %
	c. Equivalent Availability Factor (EAF):	88.8 %
	d. Resulting Capacity Factor (%):	57.0 %
	e. Average Net Operating Heat Rate (ANOHR):	7,309 BTU/kWh
(13)	Projected Unit Financial Data	
	a. Book Life (Years):	25
	b. Total Installed Cost (In-service year \$/kW):	538.62
	c. Direct Construction Cost (\$/kW):	387.01
	d. AFUDC Amount (\$/kW):	78.60
	e. Escalation (\$/kW):	73.01
	f. Fixed O&M (\$/kW-yr):	2.92
	g. Variable O&M (\$/MWh):	1.63
	h. K Factor:	NO CALCULATION

PROGRESS ENERGY FLORIDA

SCHEDULE 9

STATUS REPORT AND SPECIFICATIONS OF PROPOSED GENERATING FACILITIES

AS OF JANUARY 1, 2005

(1)	Plant Name and Unit Number:	COMBINED-CYCLE 2
(2)	Capacity	
	a. Summer:	476
	b. Winter:	548
(3)	Technology Type:	COMBINED-CYCLE
(4)	Anticipated Construction Timing	
	a. Field construction start date:	5/2011
	b. Commercial in-service date:	12/2013 (EXPECTED)
(5)	Fuel	
	a. Primary fuel:	NATURAL GAS
	b. Alternate fuel:	DISTILLATE FUEL OIL
(6)	Air Pollution Control Strategy:	DRY LOW NO _x COMBUSTION with SELECTIVE CATALYTIC REDUCTION
(7)	Cooling Method:	UNKNOWN
(8)	Total Site Area:	UNKNOWN ACRES
(9)	Construction Status:	PLANNED
(10)	Certification Status:	PLANNED
(11)	Status with Federal Agencies:	PLANNED
(12)	Projected Unit Performance Data	
	a. Planned Outage Factor (POF):	6.9 %
	b. Forced Outage Factor (FOF):	4.6 %
	c. Equivalent Availability Factor (EAF):	88.8 %
	d. Resulting Capacity Factor (%):	57.0 %
	e. Average Net Operating Heat Rate (ANOHR):	7,309 BTU/kWh
(13)	Projected Unit Financial Data	
	a. Book Life (Years):	25
	b. Total Installed Cost (In-service year \$/kW):	552.08
	c. Direct Construction Cost (\$/kW):	387.01
	d. AFUDC Amount (\$/kW):	80.55
	e. Escalation (\$/kW):	84.52
	f. Fixed O&M (\$/kW-yr):	2.92
	g. Variable O&M (\$/MWh):	1.63
	h. K Factor:	NO CALCULATION

PROGRESS ENERGY FLORIDA

SCHEDULE 9

STATUS REPORT AND SPECIFICATIONS OF PROPOSED GENERATING FACILITIES

AS OF JANUARY 1, 2005

(1)	Plant Name and Unit Number:	COMBINED-CYCLE 3
(2)	Capacity	
	a. Summer:	476
	b. Winter:	548
(3)	Technology Type:	COMBINED-CYCLE
(4)	Anticipated Construction Timing	
	a. Field construction start date:	10/2011
	b. Commercial in-service date:	5/2014 (EXPECTED)
(5)	Fuel	
	a. Primary fuel:	NATURAL GAS
	b. Alternate fuel:	DISTILLATE FUEL OIL
(6)	Air Pollution Control Strategy:	DRY LOW NO _x COMBUSTION with SELECTIVE CATALYTIC REDUCTION
(7)	Cooling Method:	UNKNOWN
(8)	Total Site Area:	UNKNOWN ACRES
(9)	Construction Status:	PLANNED
(10)	Certification Status:	PLANNED
(11)	Status with Federal Agencies:	PLANNED
(12)	Projected Unit Performance Data	
	a. Planned Outage Factor (POF):	6.9 %
	b. Forced Outage Factor (FOF):	4.6 %
	c. Equivalent Availability Factor (EAF):	88.8 %
	d. Resulting Capacity Factor (%):	57.0 %
	e. Average Net Operating Heat Rate (ANOHR):	7,309 BTU/kWh
(13)	Projected Unit Financial Data	
	a. Book Life (Years):	25
	b. Total Installed Cost (In-service year \$/kW):	565.88
	c. Direct Construction Cost (\$/kW):	387.01
	d. AFUDC Amount (\$/kW):	82.56
	e. Escalation (\$/kW):	96.31
	f. Fixed O&M (\$/kW-yr):	2.92
	g. Variable O&M (\$/MWh):	1.63
	h. K Factor:	NO CALCULATION

PROGRESS ENERGY FLORIDA

SCHEDULE 10

STATUS REPORT AND SPECIFICATIONS OF PROPOSED DIRECTLY ASSOCIATED TRANSMISSION LINES

HINES UNIT #3

- | | | |
|-----|-------------------------------------|-----|
| (1) | POINT OF ORIGIN AND TERMINATION: | N/A |
| (2) | NUMBER OF LINES: | N/A |
| (3) | RIGHT-OF-WAY: | N/A |
| (4) | LINE LENGTH: | N/A |
| (5) | VOLTAGE: | N/A |
| (6) | ANTICIPATED CONSTRUCTION TIMING: | N/A |
| (7) | ANTICIPATED CAPITAL INVESTMENT: | N/A |
| (8) | SUBSTATIONS: | N/A |
| (9) | PARTICIPATION WITH OTHER UTILITIES: | N/A |
-

PROGRESS ENERGY FLORIDA

SCHEDULE 10

STATUS REPORT AND SPECIFICATIONS OF PROPOSED DIRECTLY ASSOCIATED TRANSMISSION LINES

HINES UNIT #4

- | | |
|---|--|
| (1) POINT OF ORIGIN AND TERMINATION: | West Lake Wales Substation-Hines Energy Complex |
| (2) NUMBER OF LINES: | 1 |
| (3) RIGHT-OF-WAY: | Existing Hines Energy Complex Site and new transmission Right of Way |
| (4) LINE LENGTH: | 21 |
| (5) VOLTAGE: | 230kV |
| (6) ANTICIPATED CONSTRUCTION TIMING: | 5/2007 |
| (7) ANTICIPATED CAPITAL INVESTMENT: | \$26,500,000 |
| (8) SUBSTATIONS: | N/A |
| (9) PARTICIPATION WITH OTHER UTILITIES: | N/A |
-


INTEGRATED RESOURCE PLANNING OVERVIEW

PEF employs an Integrated Resource Planning (IRP) process to determine the most cost-effective mix of supply- and demand-side alternatives that will reliably satisfy our customers' future demand and energy needs. PEF's IRP process incorporates state-of-the-art computer models used to evaluate a wide range of future generation alternatives and cost-effective conservation and dispatchable demand-side management programs on a consistent and integrated basis.

An overview of PEF's IRP Process is shown in Figure 3.1. The process begins with the development of various forecasts, including demand and energy, fuel prices, and economic assumptions. Future supply- and demand-side resource alternatives are identified and extensive cost and operating data are collected to enable these to be modeled in detail. These alternatives are optimized together to determine the most cost-effective plan for PEF to pursue over the next ten years to meet the company's reliability criteria. The resulting ten-year plan, the Integrated Optimal Plan, is then tested under different relevant sensitivity scenarios to identify variances, if any, which would warrant reconsideration of any of the base plan assumptions. If the plan is judged robust under sensitivity analysis and works within the corporate framework, it evolves as the Base Expansion Plan. This process is discussed in more detail in the following section titled "The IRP Process".

The Integrated Resource Plan provides PEF with substantial guidance in assessing and optimizing the Company's overall resource mix on both the supply side and the demand side. When a decision supporting a significant resource commitment is being developed (e.g. plant construction, power purchase, DSM program implementation), the Company will move forward with directional guidance from the IRP and delve much further into the specific levels of examination required. This more detailed assessment will typically address very specific technical requirements and cost estimates, detailed corporate financial considerations, and the most current dynamics of the business and regulatory environments.

FIGURE 3.1
IRP Process Overview

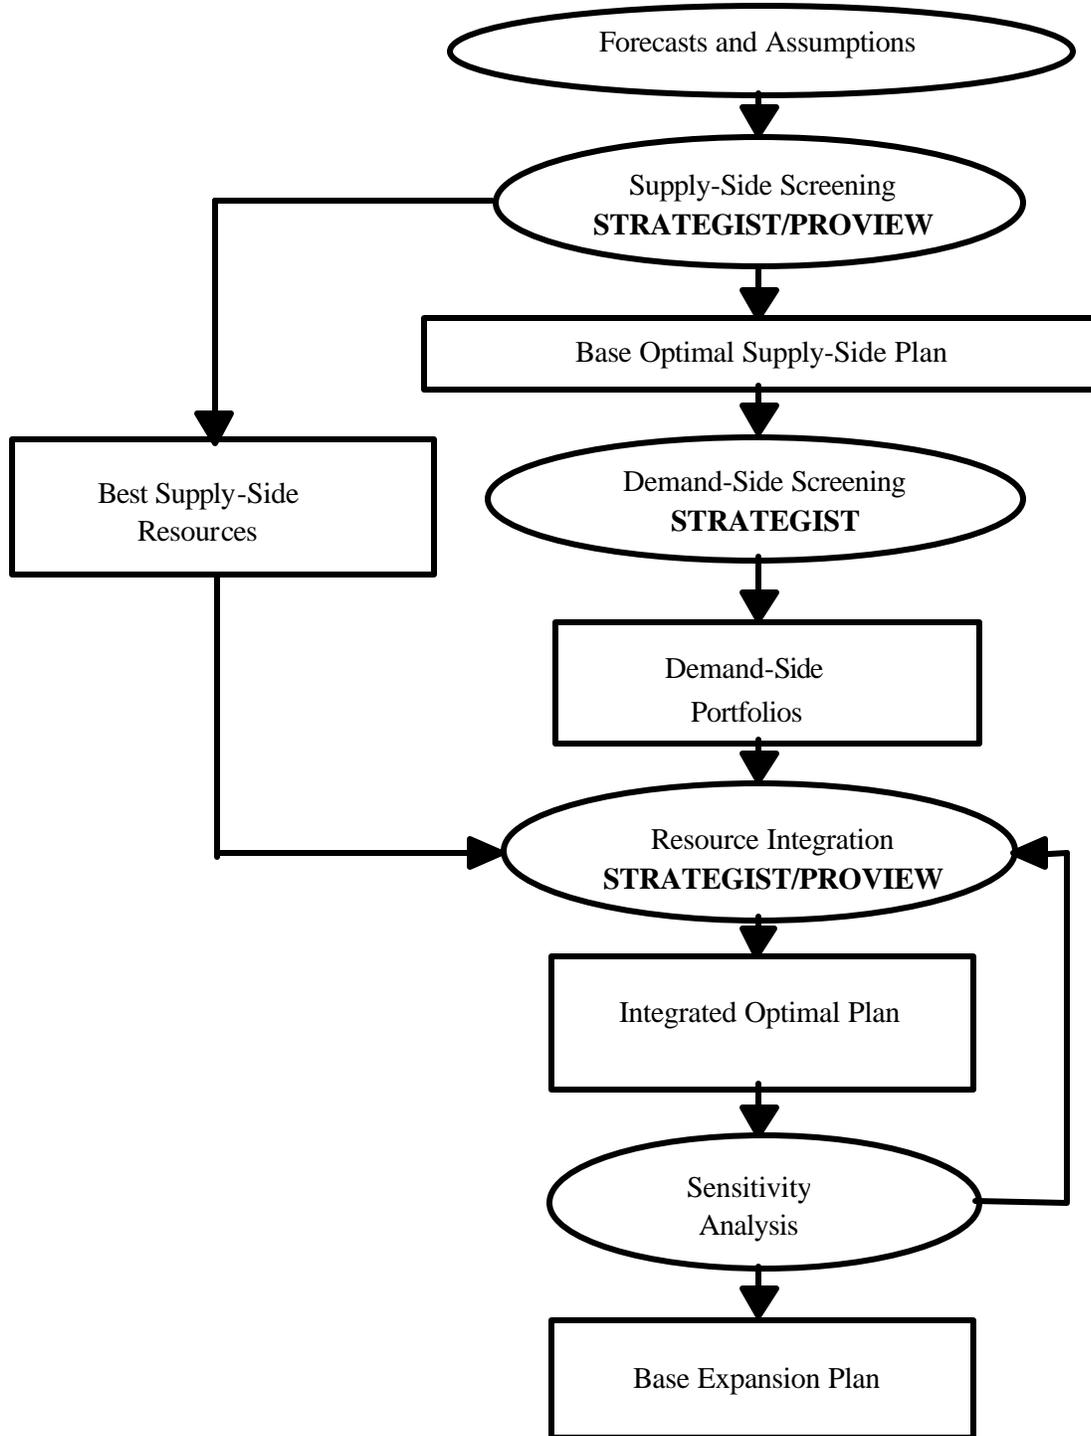

THE IRP PROCESS

Forecasts and Assumptions

The evaluation of possible supply- and demand-side alternatives, and development of the optimal plan, is an integral part of the IRP process. These steps together comprise the integration process that begins with the development of forecasts and collection of input data. Base forecasts that reflect PEF's view of the most likely future scenarios are developed, along with high and low forecasts that reflect alternative future scenarios. Computer models used in the process are brought up-to-date to reflect this data, along with the latest operating parameters and maintenance schedules for PEF's existing generating units. This establishes a consistent starting point for all further analysis.

Reliability Criteria

Utilities require a margin of generating capacity above the firm demands of their customers in order to provide reliable service. Periodic scheduled outages are required to perform maintenance and inspections of generating plant equipment and to refuel nuclear plants. At any given time during the year, some capacity may be out of service due to unanticipated equipment failures resulting in forced outages of generation units. Adequate reserve capacity must be available to accommodate these outages and to compensate for higher than projected peak demand due to forecast uncertainty and abnormal weather. In addition, some capacity must be available for operating reserves to maintain the balance between supply and demand on a moment-to-moment basis.

PEF plans its resources in a manner consistent with utility industry planning practices, and employs both deterministic and probabilistic reliability criteria in the resource planning process. A Reserve Margin criterion is used as a deterministic measure of PEF's ability to meet its forecasted seasonal peak load with firm capacity. The FPSC approved a joint proposal from the investor-owned utilities in peninsular Florida to increase the minimum planning Reserve Margin level to 20 percent (Docket No. 981890-EU, Order No. PSC-99-2507-S-EU). PEF thus plans its resources to satisfy the 20 percent minimum Reserve Margin criterion.

Loss of Load Probability (LOLP) is a probabilistic criterion that measures the probability that a company will be unable to meet its load throughout the year. While Reserve Margin only considers

the peak load and amount of installed resources, LOLP also takes into account generating unit sizes, capacity mix, maintenance scheduling, unit availabilities, and capacity assistance available from other utilities. A standard probabilistic reliability threshold commonly used in the electric utility industry, and the criterion employed by PEF, is a maximum of one day in ten years loss of load probability.

PEF has based its resource planning on the use of dual reliability criteria since the early 1990s, a practice that has been accepted by the FPSC. PEF's resource portfolio is designed to satisfy the minimum 20% Reserve Margin requirement and probabilistic analyses are conducted to ensure that the one day in ten years LOLP criterion is also satisfied. By using both the Reserve Margin and LOLP planning criteria, PEF's resource portfolio is designed to have sufficient capacity available to meet customer peak demand, and to provide reliable generation service under all expected load conditions.

Supply-Side Screening

Potential supply-side resources are screened to determine those that are the most cost-effective. Data used for the screening analysis is compiled from various industry sources and PEF's experiences. The wide range of resource options is pre-screened to set aside those that do not warrant a detailed cost-effectiveness analysis. Typical screening criteria are costs, fuel source, technology maturity, environmental parameters, and overall resource feasibility.

Economic evaluation of generation alternatives is performed using the PROVIEW module of the STRATEGIST optimization program. The optimization program evaluates revenue requirements for specific resource plans generated from multiple combinations of future resource additions that meet system reliability criteria and other system constraints. All resource plans are then ranked by system revenue requirements. The optimization run produces the optimal supply-side resource plan, which is considered the "Base Optimal Supply-Side Plan."

Demand-Side Screening

Like supply-side resources, data for large numbers of potential demand-side resources is also collected. These resources are pre-screened to eliminate those alternatives that are still in research

and development, addressed by other regulations (building code), or not applicable to PEF's customers. The demand-side screening module of STRATEGIST, DCE, is updated with cost data and load impact parameters for each potential DSM measure to be evaluated.

The Base Optimal Supply-Side Plan is used to establish avoidable units for screening future demand-side resources. Each future demand-side alternative is individually tested in this plan over the ten-year planning horizon to determine the benefit or detriment that the addition of this demand-side resource provides to the overall system. DCE calculates the benefits and costs for each demand-side measure evaluated and reports the appropriate ratios for the Rate Impact Measure (RIM), the Total Resource Cost Test (TRC), and the Participant Test. Demand-side programs that pass the RIM test are then bundled together to create demand-side portfolios. These portfolios contain the appropriate DSM options and make the optimization solvable with the STRATEGIST model.

Resource Integration and the Integrated Optimal Plan

The cost-effective generation alternatives and the demand-side portfolios developed in the screening process can then be optimized together to formulate an Integrated Optimal Plan. The optimization program considers all possible future combinations of supply- and demand-side alternatives that meet the company's reliability criteria in each year of the ten-year study period and reports those that provide both flexibility and low revenue requirements for PEF's ratepayers.

Developing the Base Expansion Plan

The plans that provide the lowest revenue requirements are then further tested using sensitivity analysis. The economics of the plan may be evaluated under high and low forecast scenarios for load, fuel, and financial assumptions, or any other sensitivities which, in the judgment of the planner, are relevant given existing circumstances **to** ensure that the plan does not unduly burden the company or the ratepayers if the future unfolds in a manner significantly different from the base forecasts. From the sensitivity assessment, the ten-year plan that is identified as achieving the best balance of flexibility and cost is then reviewed within the corporate framework to determine how the plan potentially impacts or is impacted by many other factors. If the plan is judged robust under this review, it evolves as the Base Expansion Plan.

KEY CORPORATE FORECASTS

Fuel Forecast

Base Fuel Case: The base case fuel price forecast was developed using short-term and long-term market price projections from industry-recognized sources. Coal prices are expected to be relatively stable month to month; however, oil and natural gas prices are expected to be more volatile on a day-to-day and month-to-month basis.

In the short term, the base cost for coal is based on the existing contractual structure between Progress Fuels Corporation (PFC) and Progress Energy Florida and both contract and spot market coal and transportation arrangements between PFC and its various suppliers. For the longer term, the costs are based on market forecasts reflective of expected market conditions. Oil and natural gas prices are estimated based on current and expected contracts and spot purchase arrangements as well as near-term and long-term market forecasts. Oil and natural gas commodity prices are driven primarily by open market forces of supply and demand. Natural gas firm transportation cost is determined primarily by pipeline tariff rates and tends to change less frequently than commodity prices.

Financial Forecast

The key financial assumptions used in PEF's most recent planning studies were 48% debt and 52% equity PEF capital structure, projected debt cost of 6.5%, and an equity return of 12.0%. These assumptions resulted in a weighted average cost of capital of 9.36% and an after-tax discount rate of 8.16%. In recent planning work, PEF did not test the sensitivity of the base resource plan to varying financial assumptions. This is due to the fact that the most economical options are combined-cycle (CC) and combustion turbine (CT) gas-fired units with relatively short construction lead times and low capital costs. These options have lower capital costs than other alternatives; therefore, higher financial assumptions would not be expected to alter the results in any significant way.

Lower cost of capital escalation rates would favor options with longer construction lead times and higher capital costs. However, PEF does not expect escalation rates to go much lower than the current base case forecast. Consequently, PEF does not believe that financial assumption sensitivity cases are needed.

CURRENT PLANNING RESULTS

TYSP Supply-Side Resources

In this TYSP, PEF's supply-side resources include the projected combined-cycle expansion of the Hines Energy Complex (HEC) with Units 3 through 6 forecasted to be in-service by December 2005, 2007, 2009, and 2010. As new advancements in combined-cycle technologies mature, PEF will continue to examine the merits of these new alternatives to ensure the lowest possible expansion costs. PEF will also continue to evaluate alternatives to construction at Hines, including alternative sites and the repowering of existing units. The TYSP also includes three generic combined-cycle units with planned in-service dates of May 2012, December 2013, and May 2014. The Company is currently conducting detailed analyses of generation sites and has not finalized its decision on the preferred site(s) for the future generic combined-cycle units

TRANSMISSION PLANNING

PEF's transmission planning assessment practices are developed to test the ability of the planned system to meet the reliability criteria as outlined in the FERC Form 715 filing. This involves the use of load flow and transient stability programs to model various contingency situations that may occur, and determining if the system response meets the reliability criteria. In general, this involves running simulations for the loss of any single line, generator, or transformer. PEF normally runs this analysis for system load levels from minimum to peak for all possible contingencies, and for both summer and winter. Additional studies are performed to determine the system response to credible, less probable criteria, to assure the system meets PEF and Florida Reliability Coordinating Council, Inc. (FRCC) criteria. These studies include the loss of multiple generators or lines, and combinations of each, and some load loss is permissible under these more severe disturbances. These credible, less probable scenarios are also evaluated at various load levels, since some of the more severe situations occur at average or minimum load conditions. In particular, critical fault clearing times are typically the shortest (most severe) at minimum load conditions, with just a few large base load units supplying the system needs.

As noted in the PEF reliability criteria, some remedial actions are allowed to reduce system loadings, in particular, sectionalizing is allowed to reduce loading on lower voltage lines for bulk system contingencies, but the risk to load on the sectionalized system must be reasonable (it

would not be considered prudent to operate for long periods with a sectionalized system). In addition, the number of remedial action steps and the overall complexity of the scheme are evaluated to determine overall acceptability.

Presently, PEF uses the following reference documents to calculate Available Transfer Capability (ATC) for required transmission path postings on the Florida Open Access Same-Time Information System (OASIS):

- FRCC: FRCC ATC Calculation and Coordination Procedures, November 4, 2003, which is posted on the FRCC website: (<http://www.frcc.com/downloads/frccatc.pdf>)
- NERC: Transmission Transfer Capability, May 1, 1995
- NERC: Available Transfer Capability – Definitions and Determination, July 30, 1996

PEF uses the FRCC Capacity Benefit Margin (CBM) methodology to assess its CBM needs. This methodology is:

“FRCC Transmission Providers make an assessment of the CBM needed on their respective systems by using either deterministic or probabilistic generation reliability analysis. The appropriate amount of transmission interface capability is then reserved for CBM on a per interface basis, taking into account the amount of generation available on other interconnected systems, the respective load peaking diversities of those systems, and Transmission Reliability Margin (TRM). Operating reserves may be included if appropriate in TRM and subsequently subtracted from the CBM if needed.”

PEF currently has zero CBM reserved on each of its interfaces (posted paths). PEF’s CBM on each path is currently established through the transmission provider functions within PEF using deterministic and probabilistic generation reliability analysis.

Currently, PEF proposes no bulk transmission additions that must be certified under the Florida Transmission Line Siting Act (TLSA). PEF’s proposed bulk transmission line additions are shown below:

**TABLE 3.3
PROGRESS ENERGY FLORIDA**

LIST OF PROPOSED BULK TRANSMISSION LINE ADDITIONS

2005-2014

MVA RATING WINTER	LINE OWNERSHIP	TERMINALS		LINE LENGTH (CKT.- MILES)	COMMERCIAL IN-SERVICE DATE (MO./YEAR)	NOMINAL VOLTAGE (kV)
1141	PEF/FPL	VANDOLAH	WHIDDEN	14	6/2005	230
1141	PEF	LAKE BRYAN	WINDERMERE #1	10 *	10 / 2006	230
1141	PEF	LAKE BRYAN	WINDERMERE #2	10	10 / 2006	230
1141	PEF	HINES ENERGY COMPLEX	WEST LAKE WALES #1	21	5 / 2007	230
1141	PEF	INTERCESSION CITY	GIFFORD	10	4 / 2008	230
1141	PEF	HINES ENERGY COMPLEX	WEST LAKE WALES #2	21	5 / 2009	230
1141	PEF/FPL	VANDOLAH	CHARLOTTE	55*	5/2009	230
1141	PEF	INTERCESSION CITY	WEST LAKE WALES #1	30 *	6 / 2010	230
1141	PEF	INTERCESSION CITY	WEST LAKE WALES #2	30	6 / 2010	230

* Rebuild existing circuit

CHAPTER 4

*ENVIRONMENTAL AND
LAND USE INFORMATION*



This page intentionally left blank

CHAPTER 4
ENVIRONMENTAL AND LAND USE INFORMATION

PREFERRED SITES

PEF's base expansion plan proposes new combined-cycle generation at the Hines Energy Complex (HEC) site in Polk County. Although not delineated in the base expansion plan, new proposed peaking simple-cycle combustion turbine generation site options include Intercession City (Osceola County) and DeBary (Volusia County). While the Intercession City, DeBary, and Hines sites are suitable for new generation, PEF continues to evaluate other available options for future supply alternatives, including the potential repowering of existing Bartow steam units.

The next proposed combined-cycle units at the HEC site are scheduled for commercial operation in December 2005 and December 2007. PEF continues to pursue siting opportunities for undesignated combined-cycle units with a commercial operation date of 2012 and beyond. PEF's existing sites, as identified in Table 3.1 of Chapter 3, include the capability to further develop generation. All appropriate permitting requirements will be addressed for PEF's preferred sites as discussed in the following site descriptions. The base expansion plan does not currently include any potential new sites for generating additions. Therefore, detailed environmental or land use data are not included.

HINES ENERGY COMPLEX SITE

In 1990, PEF completed a statewide search for a new 3,000 MW coal capable power plant site. As a result of this work, a large tract of mined-out phosphate land in south central Polk County was selected as the primary alternative. This 8,200-acre site is located south of the City of Bartow, near the cities of Fort Meade and Homeland, south of S.R. 640 and west of U.S. 17/98 (reference Figure 4.1). It is an area that has been extensively mined and remains predominantly unreclaimed.

The Governor and cabinet approved site certification for ultimate site development and construction of the first 470 MW increment on January 25, 1994, in accordance with the rules of the Power Plant Siting Act. Due to the thorough screening during the selection process, and the disturbed nature of the site, there were no major environmental limitations. As would be the situation at any location in the state, air emissions and water consumption were significant issues during the licensing process.

The site's initial preparation involved moving over 10 million cubic yards of soil and draining 4 billion gallons of water. Construction of the energy complex will recycle the land for a beneficial use and promote habitat restoration.

The Hines Energy Complex is visited by several species of wildlife, including alligators, bobcats, turtles, and over 50 species of birds. The Hines site also contains a wildlife corridor, which creates a continuous connection between the Peace River and the Alafia River.

PEF arranged for the City of Bartow to provide treated effluent for cooling pond make-up. The complex's cooling pond initially covered 722 acres with an eventual expansion to 2,500 acres.

The Hines Energy Complex is designed and permitted to be a zero discharge site. This means that there will be no discharges to surface waters either from the power plant facilities or from storm water runoff. Based on this design, storm water runoff from the site can be used as cooling pond make-up, minimizing groundwater withdrawals.

The Florida Department of Environmental Protection air rules currently list all of Polk County as attainment for ambient air quality standards. The environmental impact on the site will be

minimized by PEF's close coordination with regulatory agencies to ensure compliance with all applicable environmental regulations.

As future generation units are added, the remaining network of on-site clay settling ponds will be converted to cooling ponds and combustion waste storage areas to support power plant operations. Given the disturbed nature of the property, considerable development has been required in order to make it usable for electric utility application. An industrial rail network and an adequate road system service the site.

The first combined-cycle unit at this site, with a capacity of 482 MW summer, began commercial operation in April 1999. The transmission improvements associated with this first unit were the rebuilding of the 230/115 kV double circuit Barcola to Ft. Meade line by increasing the conductor sizes and converting the line to double circuit 230 kV operation.

The second combined-cycle unit at this site entered commercial operation in December 2003 with seasonal capacity ratings of 516 MW summer. The transmission improvement associated with the second combined-cycle unit at this site involved the addition of a 230 kV circuit from the Hines Energy Complex to Barcola.


The third HEC combined-cycle unit is planned for commercial operation in December 2005 with seasonal capacity ratings of 516 MW summer, and requires no transmission upgrades.

The fourth HEC combined-cycle unit is planned for commercial operation in December 2007 with seasonal capacity ratings of 461 MW summer. The transmission improvements associated with the fourth combined-cycle unit at this site involved the addition of a 230 kV circuit from the Hines Energy Complex to West Lake-Wales and associated substation expansion and breaker replacements.

The HEC is also PEF's preferred site for future Hines 5 and 6 combined-cycle units required in 2009 and 2010, respectively.

FIGURE 4.1

Hines Energy Complex Site (Polk County)

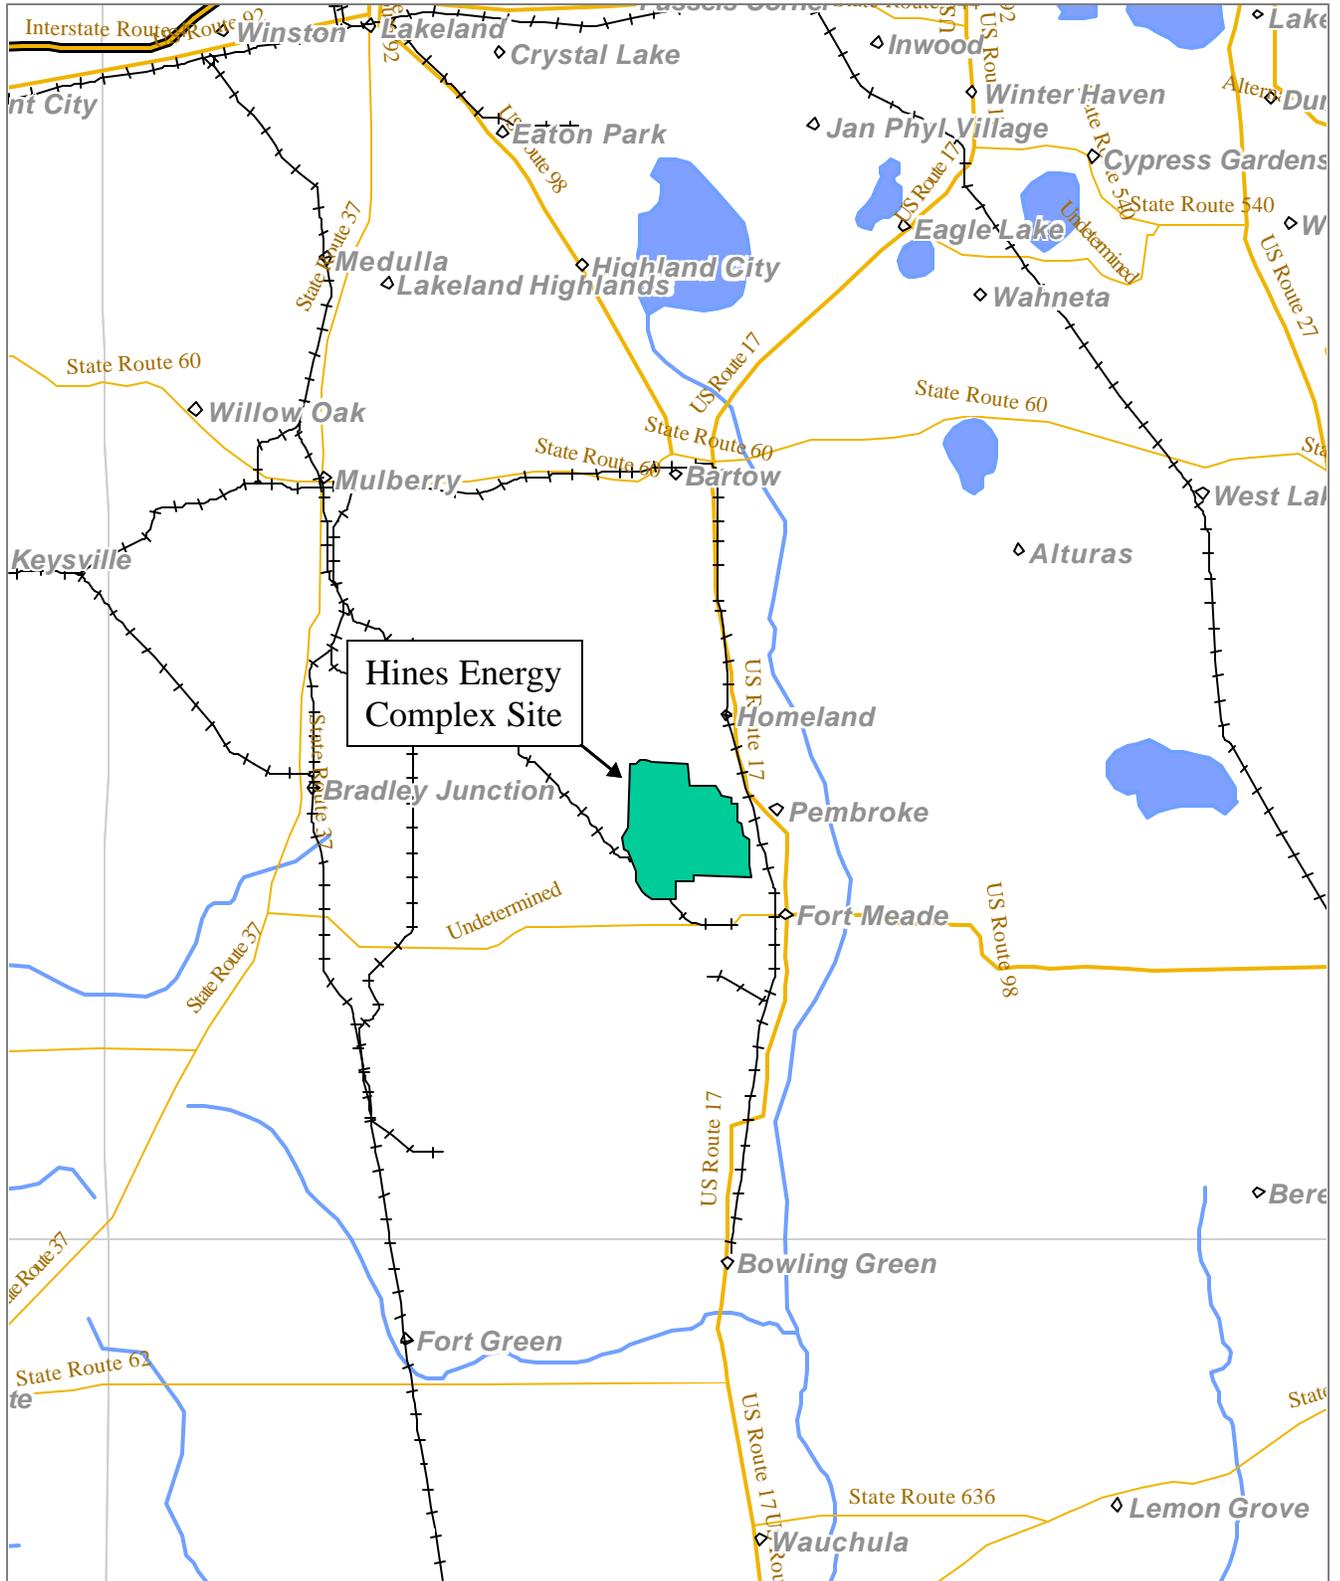

INTERCESSION CITY SITE

Intercession City was chosen as a potential site for installation of peaking combustion turbine units.


The Intercession City site (Figure 4.2) consists of 162 acres in Osceola County, two miles west of Intercession City. The site is immediately west of Reedy Creek and the adjacent Reedy Creek Swamp. The site is adjacent to a secondary effluent pipeline from a municipal wastewater treatment plant, an oil pipeline, and natural gas supply from the Florida Gas Transmission (FGT) and Gulfstream pipelines.

The Florida Department of Environmental Protection air rules currently list all of Osceola County as attainment for ambient air quality standards. The environmental impact on the site will be minimized by PEF's close coordination with regulatory agencies to ensure compliance with all applicable environmental regulations.

Transmission modifications will be required to accommodate additional combustion turbine peaking units at this site.

FIGURE 4.2

Intercession City Site (Osceola County)

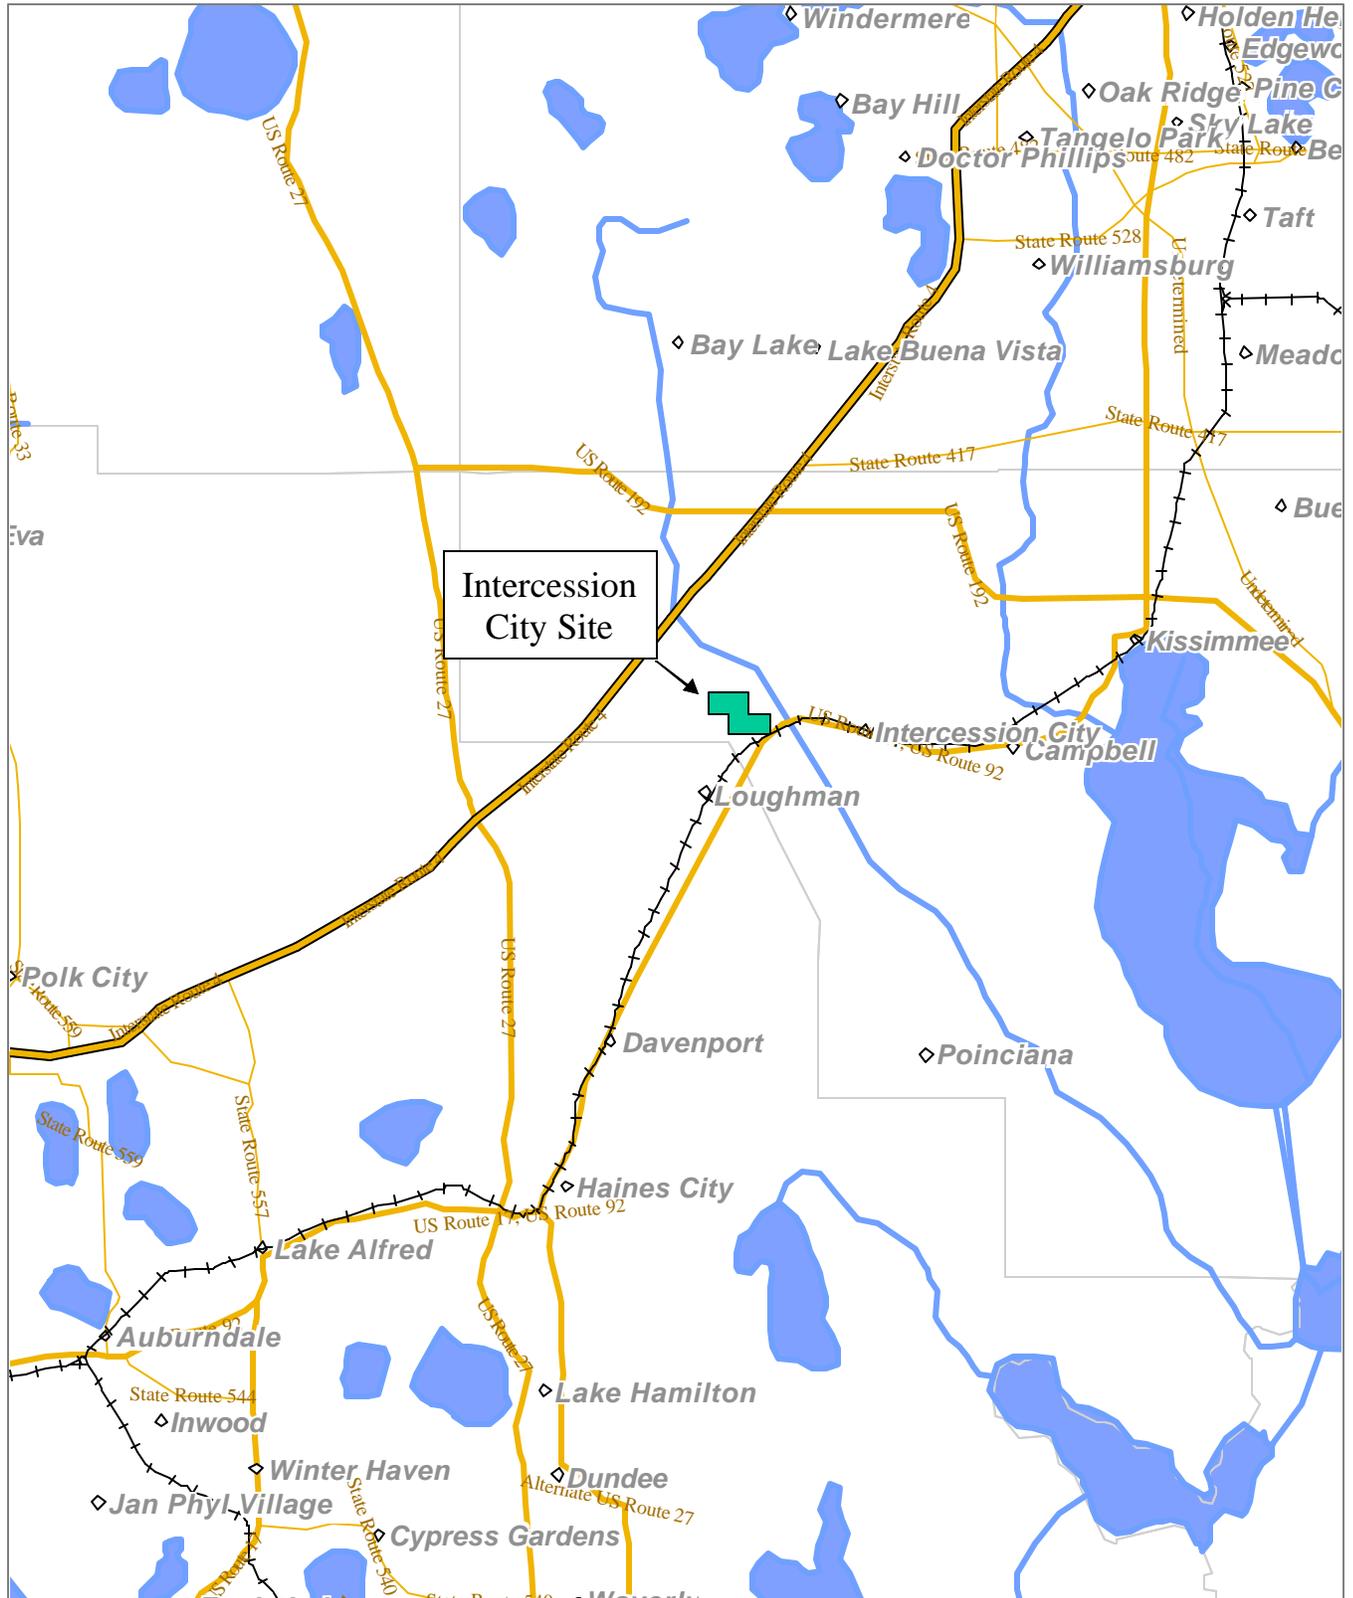

DEBARY SITE


DeBary was chosen as a potential site for installation of peaking combustion turbine units.

The DeBary site (Figure 4.3) consists of 2,210 acres in Volusia County, immediately west of the town of DeBary. The site is bordered on the west by the St. Johns River and on the north by Blue Springs State Park. This site is adjacent to an oil pipeline and natural gas supply from the Florida Gas Transmission (FGT) pipeline.

The Florida Department of Environmental Protection air rules currently list all of Volusia County as attainment for ambient air quality standards. The environmental impact on the site will be minimized by PEF's close coordination with regulatory agencies to ensure compliance with all applicable environmental regulations.

Transmission modifications will be required to accommodate additional combustion turbine peaking units at this site.

FIGURE 4.3
DeBary Site (Volusia County)

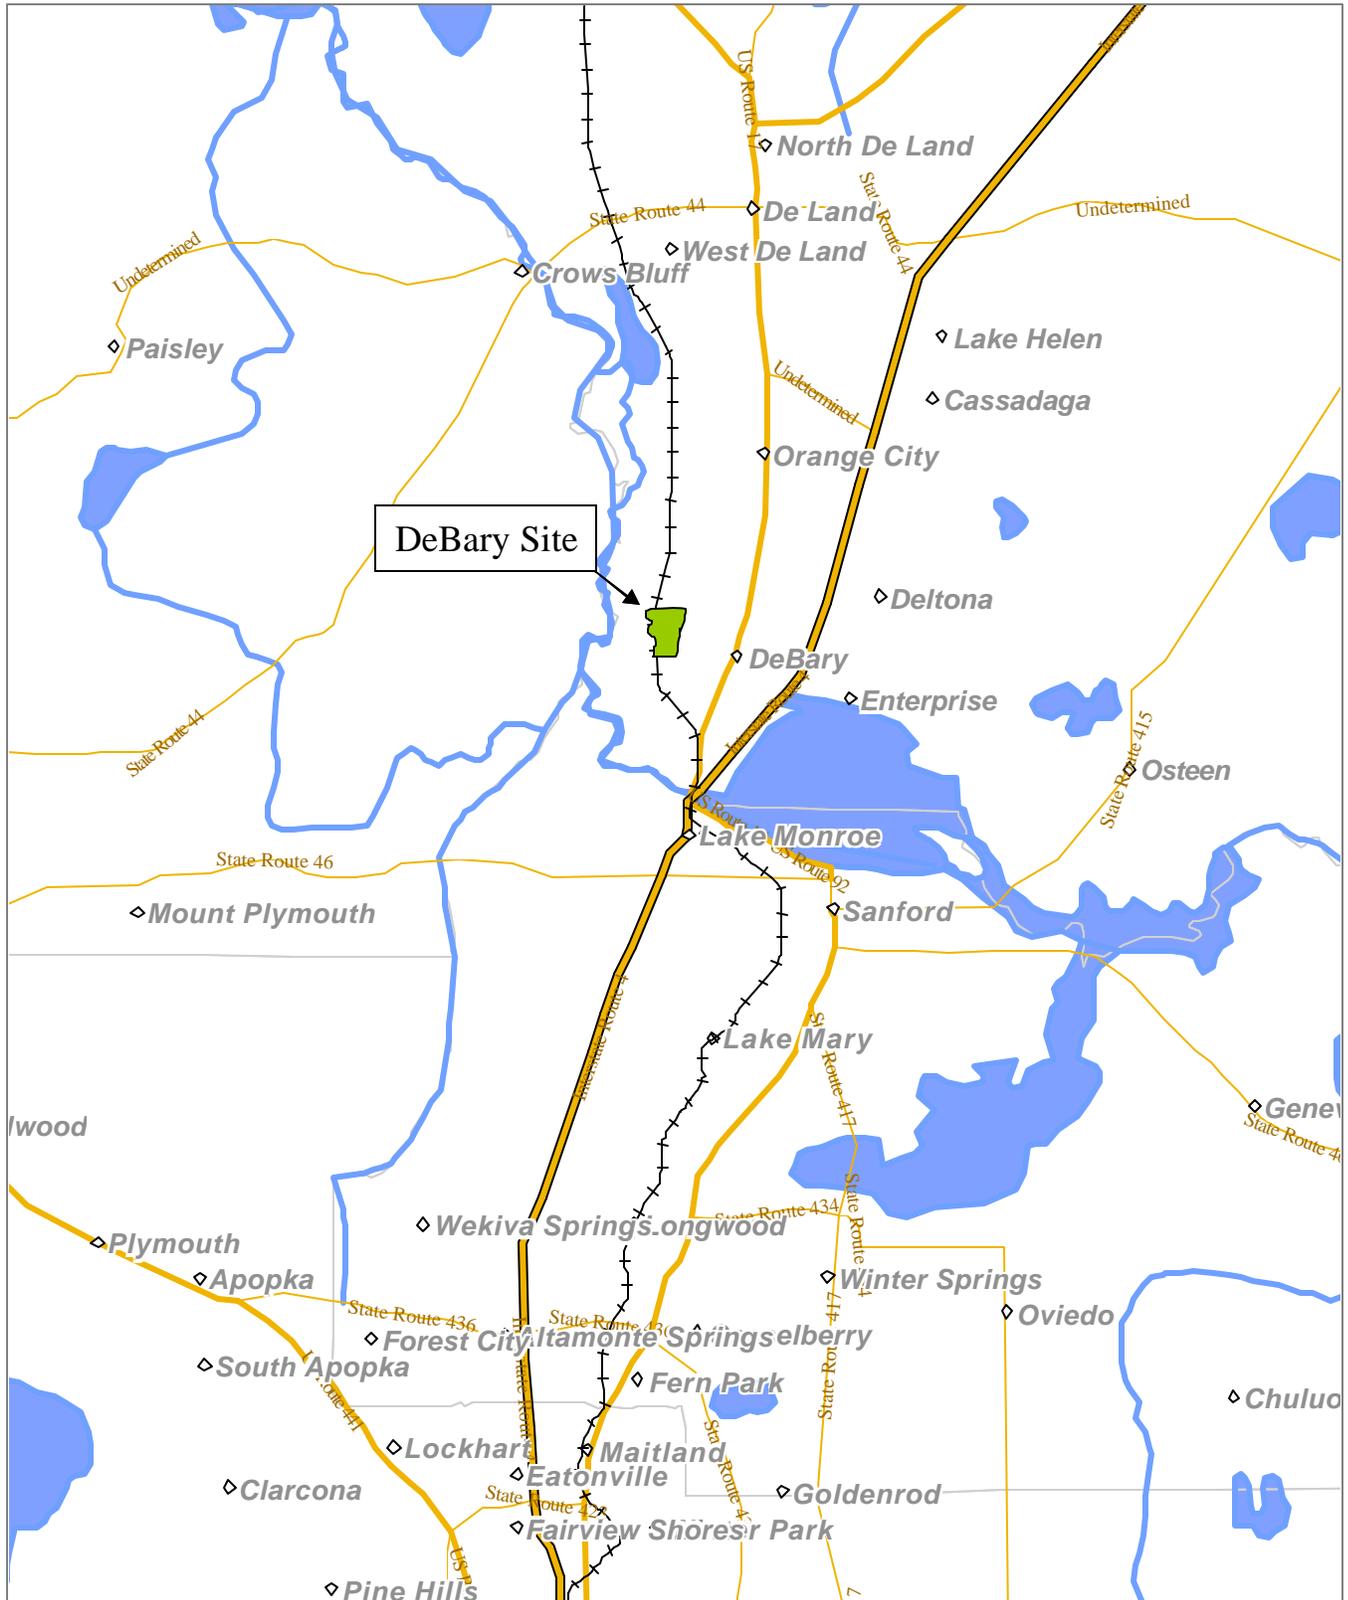

ANCLOTE SITE

Anclote was chosen as a potential site for installation of peaking combustion turbine units.

The Anclote site (Figure 4.4) consists of approximately 400 acres in Pasco County. The site is located in Holiday Florida at the mouth of the Anclote River. The site receives make-up water from the city of Tarpon Springs, fuel oil through a pipeline from the Bartow plant, and natural gas supply from the Florida Gas Transmission (FGT) pipeline.

The Florida Department of Environmental Protection air rules currently list all of Pasco County as attainment for ambient air quality standards. The environmental impact on the site will be minimized by PEF's close coordination with regulatory agencies to ensure compliance with all applicable environmental regulations.

Transmission modifications will be required to accommodate additional combustion turbine peaking units at this site.

FIGURE 4.4
Anclote (Pasco County)



BARTOW SITE

Bartow was chosen as a potential site for additional generation.

The Bartow site (Figure 4.5) consists of 1348 acres in Pinellas County, on the west shore of Tampa Bay. The site is on Weedon Island, north of downtown St. Petersburg. The site is adjacent to a barge fuel oil off-loading facility and natural gas supply from the Florida Gas Transmission (FGT) pipeline.

The Florida Department of Environmental Protection air rules currently list all of Pinellas County as attainment for ambient air quality standards. The environmental impact on the site will be minimized by PEF's close coordination with regulatory agencies to ensure compliance with all applicable environmental regulations.

Transmission modifications will be required to accommodate the potential repowering of existing Bartow steam units.

FIGURE 4.5
Bartow Site (Pinellas County)

