

REDACTED

BEFORE THE
FLORIDA PUBLIC SERVICE COMMISSION

In re: Tampa Electric Company's)
Petition for an Increase in Base)
Rates and Miscellaneous Service)
Charges.)

DOCKET NO. 080317-EI
FILED: NOVEMBER 7, 2008

TAMPA ELECTRIC COMPANY'S
ANSWERS TO THIRD REQUEST FOR
PRODUCTION OF DOCUMENTS (NOS. 39-40)
OF THE
FLORIDA INDUSTRIAL POWER USERS GROUP

Tampa Electric files its Answers to Production of Documents (Nos. 39-40) propounded and served on October 8, 2008, by the Florida Industrial Power Users Group.

COM _____
ECR |_____
GCL _____
OPC _____
RCP _____
SSC _____
SGA _____
ADM _____
CLK _____

DOCUMENT NUMBER-DATE

10441 NOV-7 08

FPSC-COMMISSION CLERK

**TAMPA ELECTRIC COMPANY
DOCKET NO. 080317-EI
INDEX TO FIPUG'S THIRD REQUEST FOR
PRODUCTION OF DOCUMENTS (NOS. 39-40)**

<u>Number</u>	<u>Subject</u>	<u>Bates Stamped Page</u>
39	Provide all manuals, protocols, memorandum or any other material used to determine the priority of the loads to be curtailed during: a. A state wide shortage; and b. A system shortage.	1
40	Provide all documents, memoranda or any other material that indicates that the curtailments on September 29 and 30, 2008 complied with the interruption priorities provided by the customers.	75

DOCUMENT NUMBER-DATE

10441 NOV-7 8

FPSC-COMMISSION CLERK

**TAMPA ELECTRIC COMPANY
DOCKET NO. 080317-EI
FIPUG'S THIRD REQUEST FOR
PRODUCTION OF DOCUMENTS
DOCUMENT NO. 39
BATES STAMPED PAGES: 1 - 74
FILED: NOVEMBER 7, 2008**

- 39.** Provide all manuals, protocols, memorandum or any other material used to determine the priority of the loads to be curtailed during:
- a. A state wide shortage; and
 - b. A system shortage.
- A.** Attached are the requested documents used to determine the priority of the loads to be curtailed during a state-wide and system shortage.

CAPACITY AND ENERGY EMERGENCY PLAN

TAMPA ELECTRIC
COMPANY

TABLE OF CONTENTS

I.	PURPOSE.....	3
II.	DEFINITIONS	3
III.	AUTHORITY	4
	A. EMERGENCY DECLARATION	4
	B. ENERGY EMERGENCY COORDINATOR.....	4
	C. IMPLEMENTATION PLAN.....	5
IV.	EMERGENCY PLAN.....	6
	A. FORECASTED CAPACITY DEFICIENCY	7
	B. IMMINENT CAPACITY DEFICIENCY	8
	C. SUDDEN CAPACITY DEFICIENCY	8

**TAMPA ELECTRIC COMPANY
CAPACITY AND ENERGY EMERGENCY PLAN**

I. PURPOSE

The purpose of this Plan is twofold:

1. to establish a systematic and effective means of anticipating, assessing and responding, in an appropriate and coordinated manner, to a capacity/energy emergency, and
2. To maintain compliance with Control Performance and Disturbance Control Standards during a capacity/energy emergency.

At any step in the plan, the Energy System Operator has the responsibility and authority to shed firm load in order to ensure the reliability of the Eastern Interconnection and the Bulk Grid. The load reduction part of this plan must be capable of being implemented within 30 minutes

II. DEFINITIONS

Daily Capacity Assessment – An assessment to determine if Tampa Electric's planned resources will meet the demand. This assessment is entered daily into the Florida Transaction Management System (FTMS).

Forecasted Capacity Deficiency – A deficiency that is forecasted within the next 7 days.

Imminent Capacity Deficiency – A deficiency that is forecasted to occur within the next 6 - 8 hours.

Sudden Capacity Deficiency – A capacity deficiency that has suddenly occurred due to the loss of a generating resource or a transaction.

Control Performance Standard – To maintain interconnection steady state frequency within defined limits by balancing real power demand and supply in real-time.

Disturbance Control Standard – To ensure the Balancing Authority is able to utilize its Contingency Reserves to balance resources and demand and return Interconnection frequency to within defined limits following a disturbance.

III. AUTHORITY

A. EMERGENCY DECLARATION

- | <u>Activity</u> | <u>Person Responsible</u> |
|---|------------------------------------|
| 1. Regularly monitor the Capacity of the System and notify the Director, Energy Control Center of Forecasted Deficiencies. | Manager, Grid Operations |
| 2. Alert the Vice President, Energy Delivery, anytime forecasted resources will not meet forecasted firm load requirements. | Director,
Energy Control Center |

If an energy emergency needs to be declared, this Officer will notify the TEC President to announce the declaration.

- | | |
|---|--|
| 3. Declare an energy emergency when necessary and notify the President of the Florida Reliability Coordinating Council ("FRCC") and the Director of Reliability of the existence of an energy emergency on the TEC system. Implement all or any part of this Plan in cooperation with the FRCC. Implement the Generating Capacity Emergency of the Florida Reliability Coordinating Council's (FRCC) Generating Capacity Shortage Plan upon the declaration of an Emergency Alert by the Florida Public Service Commission or upon the declaration of any Energy Emergency by the Governor of the State of Florida. | TEC President or by
delegation to:

Vice President
Energy Delivery |
|---|--|

B. ENERGY EMERGENCY COORDINATOR

- | <u>Activity</u> | <u>Person Responsible</u> |
|--|--|
| 1. After the energy emergency is declared, the Energy Emergency Coordinator is required to coordinate all activities involved in implementing the Energy Emergency Plan. | Director,
Energy Control Center
Alternate: Emergency
Manager, Energy Delivery |

C. IMPLEMENTATION PLAN

The individuals below will assist the Energy Emergency Coordinator and be responsible for implementing the part of the plan listed by their title.

	<u>Activity</u>	<u>Person Responsible</u>
1.	Continuously assess Capacity/Energy Deficiency	Manager, Grid Operations
	Notify FRCC Security Coordinator and neighboring entities	
2.	Communicate with the Federal Energy Regulatory Commission via:emergency@ferc.gov	Manager, Grid Operations
3.	Communicate with TEC Employees	Director, Corporate Communication
4.	Communicate with media and public	TEC Public Information Officer
5.	Communicate with Governmental organizations	VP Governmental Affairs, VP Regulatory Affairs
6.	Communicate with Firm Wholesale power customers	Manager, C&I Customer Services
7.	Purchase power and control sales	Director, Wholesale Marketing & Fuels, Director, Business Marketing and Sales
8.	Obtain approval to waive/modify environmental restrictions	Vice President Energy Supply
9.	Facilitate the TEC energy use curtailment	TEC Emergency Manager
9A.	Curtail TEC energy use	VP Technology and Support Services, VP Energy Supply, VP Energy Delivery
10.	Promote load conservation (voluntary and mandatory)	Director, Energy & Market Planning, Director, Business

<u>Activity</u>	<u>Person Responsible</u>
	Marketing and Sales
11. Utilize Load Management, Stand-by Generator, Interruptible Load, and Voltage Control	Manager, Grid Operations
12. Curtail customer load	Manager, System Service

IV. EMERGENCY PLAN

When an energy emergency is declared, the following steps and actions may be taken to reduce risks to the interconnected system, to minimize the effect of the capacity shortage upon customers and to ensure compliance with the Control Performance and Disturbance Control Standards.

This plan shall be reviewed and updated annually. A copy of this plan shall be provided to the FRCC Reliability Coordinator and is available on line to Tampa Electric's neighboring Transmission Operators and Balancing Authorities.

A. FORECASTED CAPACITY DEFICIENCY

1. Begin daily calls to review plans for next several days. **Energy Supply, Grid Operations, WM&S, C&I Customer Services, and Fuels**
2. If forecasted capacity deficiency is due to fuel shortages, quantify fuel amount and future deliveries/inventories. **Fuels**
3. Run unit commitment for next 7 days and develop plan to meet load requirements within fuel constraints. Include utilization of alternate fuels to optimize fuel supply where applicable. **Operations Planning**
4. Ensure all available generation is ready to be placed on-line and for generation that is on-line, the output is available to be maximized. **Energy Supply**
5. Discontinue Non-Firm Sales. **WM&S**
6. Ensure nonfirm secondary ATC's are updated. **GPOS**
7. Purchase all available power that can be Imported. **WM&S**
8. Plan to Utilize Load Management, Interruptible Load, and Voltage Control. **Grid Operations**
9. Notify FRCC Security Coordinator and neighboring entities as steps in the plan are implemented. **Grid Operations**
10. Inform Tampa Electric Employees. **Corporate Communications**
11. Make Public Appeals. **Corporate Communications**
12. Appeal to large Industrial and Commercial Customers to reduce non-essential energy use and to use alternate fuels or maximize customer- owned generation that uses fuel that is not in short supply and maximize customer owned generation. **C&I Customer Services**
13. Ask Cogenerators and IPP's to maximize output and availability. **C&I Customer Services**
14. Request Customer Services On-Call is at ECC. **Grid Operations**
15. Request Gov't to implement programs to achieve energy reductions. **Gov't Affairs**
16. Reduce TEC energy usage. **Building Services, Energy Supply, Energy Delivery**

17. Notify Gov't agencies as steps of the plan are implemented. **Gov't Affairs/Regulatory**
18. Start Procedures to Obtain Approval to Suspend/Modify Limiting Environmental Rules. **Environmental**
19. Notify Firm Sales Contracts (RCI, STC, FPC, WAU, & FT MEADE) of Impending Curtailments on a Pro-Rata Basis. **WM&S**
20. Ready the Load Curtailment Plan. **System Service**

B. IMMINENT CAPACITY DEFICIENCY

1. If forecasted capacity deficiency is due to fuel shortages, swap to alternate fuel. **Energy Supply**
2. Ensure all available generation is on-line and maximum output is available. **Energy Supply**
3. Customer Services On-Call at the ECC. **Grid Operations**
4. Discontinue Non-Firm Sales. **WM&S**
5. Purchase all available power that can be imported. **WM&S**
6. Implement Load Management and Standby Generators. If plan to drop firm load, do not implement Load Management. **Grid Operations**
7. Notify and then drop Interruptible Load Customers. Try to give 15 minutes notice. **Grid Operations**
8. Implement Voltage Control. **System Service**
9. Purchase Emergency Power. **Grid Operations/WM&S**
10. Notify the FRCC Security Coordinator to declare an Energy Emergency Alert 3 and notify neighboring entities. **Grid Operations**
11. Drop firm sales in the same proportion of planned firm load curtailment. (FPC, RCI, & STC) (Ft Meade and WAU are not scheduled, notify city. No means to interrupt a portion of their load at this time). **Grid Operations**
12. Implement the Load Curtailment Plan. **System Service**

C. SUDDEN CAPACITY DEFICIENCY

1. Utilize shaft spinning reserves. **Grid Operations**
2. Call for operating reserves. (Mandatory for loss of 200 MW's or greater). **Grid Operations**
3. Maximize output of all generation. **Energy Supply**
4. Implement Load Management and Standby Generators. If plan to drop firm load, do not implement Load Management. **Grid Operations**
5. Notify and then drop Interruptible Load Customers. Try to give 15 minutes notice. **Grid Operations**
6. Implement Voltage Control. **System Service**
7. Purchase Emergency Power. **Grid Operations/WM&S**
8. Notify the FRCC Security Coordinator to declare an Energy Emergency Alert 3 notify neighboring entitles. **Grid Operations**
9. Drop firm sales in the same proportion of planned firm load curtailment. (FPC, RCI, & STC) (Ft Meade and WAU are not scheduled, notify city. No means to interrupt a portion of their load at this time.) **Grid Operations**
10. Implement the Load Curtailment Plan. **System Service**

REVISION HISTORY

Frank Busot	5/21/2007
Stephen Joseph	04/2008

TAMPA ELECTRIC
FIRM LOAD CURTAILMENT PLAN

Table of Contents

1.0	EXECUTIVE SUMMARY	1
2.0	<u>GENERAL</u>	1
3.0	<u>Firm Load Curtailment - Circuit Priorities</u>	2
3.1	<u>Circuit Priority Definitions</u>	3
4.0	ACTION PLAN	4
4.1	System Service	4
5.0	RISK MANAGEMENT	5
5.1	System Service	5

FIRM LOAD
CURTAILMENT PLAN

1.0 EXECUTIVE SUMMARY

The purpose of the Firm Load Curtailment Plan is to document operating procedures in System Service to be followed when Tampa Electric Company (TEC or Company) experiences a power shortage due to forced outages of generating units or other unforeseen emergencies. These procedures help System Service to be prepared to effectively manage any firm load curtailment requirement.

2.0 GENERAL

Peak loads are forecasted for winter and summer; however, winter peaks are more difficult to predict. Winter peaks normally result from extreme cold weather periods of short duration which do not occur at TEC every year. Summer peaks are experienced during extended periods of hot weather which does occur at TEC every year. Consequently, each year TEC meets with the other utilities to discuss and gather information for scheduling maintenance of TEC's generation facilities. TEC uses the aforementioned information, in addition to the forecasted loads, to minimize planned outages during seasonal peak load periods. The schedule is updated as conditions change.

2.1 Responsibility

The Energy Emergency Coordinator is responsible for the implementation of the Company's Firm Load Curtailment Plan. The Director of the Energy Control Center is the Coordinator. In the event that he is unavailable, a designated alternate will be assigned by the Energy Emergency Coordinator.

The Coordinator has the authority to use manpower, equipment, and other resources within the organization (Energy Delivery (ED)) to implement Firm Load Curtailment. The use of resources outside ED necessitates the involvement of the Incident Command System. For further information, consult Tampa Electric's Emergency Response Plan which is available on TECO Energy intranet and updated regularly.

2.2 Voltage Control

The decision to implement Voltage Control is the responsibility of the Energy System Operator, Grid Operations. Voltage Control will occur after implementation of Prime Time Load Management, stand-by generator program and curtailing interruptible load but prior to activating the Firm Load Curtailment plan. When Voltage Control is implemented, System Service will seek to reduce voltage on circuits as much as possible while remaining within Tariff limits and report to Grid Operations the expected load reduction. Voltage Control will remain implemented during Firm Load Curtailment.

FIRM LOAD
CURTAILMENT PLAN

2.3 Firm Load Curtailment

System Service is responsible for maintaining the Firm Load Curtailment Plan and promptly implementing the plan when needed. Implementation of the Firm Load Curtailment Plan is initiated by the Energy System Operator, Grid Operations and is carried out by the Distribution System Operator, System Service. The Firm Load Curtailment Plan can be implemented within 30minutes as per NERC requirement EOP-001-0 R2. The FRCC Reliability Coordinator can also direct the Energy System Operator to shed load. The major considerations provided for in the plan are as follows:

A. **Firm Load Schedule**

All distribution circuits are reviewed and classified as outlined in the Priority Customers List, which is controlled and maintained by the Operation Division Engineering Team (ODET).

Priority "1", "2", and "3" circuits are to be included in the firm load switching schedule unless otherwise directed by the Coordinator.

B. **Additional Information**

The Firm Load Curtailment Plan strives to hold individual feeder outages to 15 minutes duration at a time. Every effort will be made to avoid curtailment of electric service to critical Customers, including hospitals, national defense installations, and those facilities essential to the health, safety, and welfare of the community.

1. System Service will curtail firm load as needed, and the load will be curtailed according to circuit priorities.
2. System Service will notify Customer Services when the emergency ends.

3.0 Firm Load Curtailment - Circuit Priorities

With assistance from various sources, including City/County Emergency Services officials, circuit priority definitions for the Firm Load Curtailment are developed. The priorities emphasize a significant concern for those facilities essential to the health, safety, and welfare of the community and safety infrastructure. This includes hospitals, water, sewer, law enforcement, fire, BMS, Tampa Electric, communications, schools, national defense, and critical transportation facilities.

Priority "5" circuits are excluded from firm load curtailment. Priority "4" circuits can be rotated on a limited basis (no longer than 15 minutes off) if instructed by the

FIRM LOAD
CURTAILMENT PLAN

Coordinator. Priority "1", "2", and "3" circuits can be rotated as needed. Priority "4" circuits may be upgraded to "5" should the critical facility's backup generation fail.

Operating engineers have been instrumental in identifying priority "1", "2", "3", "4" and "5" facilities. This information is loaded into the Energy Management System's Firm Load Curtailment computer program.

3.1 Circuit Priority Definitions

Priority "1"

Customers less than 500 KVA demand.

Priority "2"

Customers of 500 KVA or more demand.

Priority "3"

Facilities similar to those described in Priorities 4 and 5 that have their own, full load, emergency power generation. If their emergency power fails, these facilities will be upgraded to priority "4" or "5" as deemed appropriate. In addition, this category includes facilities providing important public services. Such facilities include supermarkets, home improvement/building supply centers, local banks, financial transaction facilities, insurance facilities, hotels, malls, etc. This priority may also include agricultural facilities that have a major impact on local food supply. The priorities of agricultural facilities can fluctuate from high to low depending on the season (and their ultimate impact on Priority 4 & 5 facilities such as milk producers supplying milk to schools).

Priority "4"

These may include some of the same types of facilities described for Priority 5. These facilities provide significant public services but are deemed to be somewhat less critical by government agencies. Such facilities include schools, nursing homes, grocery distribution/large cold storage facilities, local water and sewer facilities, local fire and police stations, special needs facilities, and fuel transfer/loading facilities (ports).

Priority "5"

Facilities that have been identified as "critical" to public health and safety by governmental agencies. These include hospitals and emergency medical facilities, emergency shelters, main fire stations, main police stations, prisons/jails, fire rescue facilities, master water pumping and wastewater facilities, major communications facilities (i.e., TV, radio, and telecom transmitters), Tampa International Airport, MacDill Air Force Base, critical electric utility facilities, and facilities having critical impact on the environment.

FIRM LOAD
CURTAILMENT PLAN

4.0 ACTION PLAN

4.1 System Service

System Service is responsible for implementing the Voltage Control and Firm Load Curtailment Plans and restoring service during and after the curtailment period at the direction of the Energy System Operator, Grid Operations. System Service is responsible for notifying the Coordinator (or his alternate) and Customer Services of impending implementation of the Firm Load Curtailment Plan. Grid Operations is responsible for notifying the Reliability Coordinator and Adjacent Balancing Authorities.

Voltage Control

The implementation of voltage control is the responsibility of the Distribution System Operator. System Service will reduce voltage by adjusting voltage levels through the SCADA/EMS systems. System Service will set levels based on communicated requirements from Grid Operations. If the Megawatts needs can not be accomplished using the Voltage Control program, System Service will notify Grid Operations.

Firm Load Rotation

The implementation of Firm Load Curtailment is the responsibility of the Distribution System Operator. When notified by Grid Operations, System Service will reduce load by activating the load curtailment program through the SCADA/EMS systems.

Non-critical firm load is rotated, as required by Grid Operations, off 15 minutes and on a minimum of 15 minutes. Circuits with priority "1", "2" and "3" will be rotated. Priority "4" and "5" circuits are not to be rotated unless otherwise directed by the Coordinator.

FIRM LOAD
CURTAILMENT PLAN

5.0 RISK MANAGEMENT

Additional involvement by the Risk Management department in the Firm Load Curtailment Plan will be directed by the Coordinator.

5.1 System Service

As soon as possible following each firm load curtailment event, System Service shall:

1. Document all outage activity and forward copies to Risk Management, Grid Operations, and Customer Services.
2. Document all system changes, cold load pickup problems, LTC voltage level changes, load transfers, etc., and send to the Operations Engineers.
3. Answer PSC requests and inquiries.
4. Meet with City/County EOC's to review actions, and determine if improvements are needed.

Annual Review and Dissemination

This plan shall be reviewed and updated annually. A copy of this plan shall be provided to the FRCC Reliability Coordinator and is available on line to Tampa Electric's neighboring Transmission Operators and Balancing Authorities

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIGUR'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

CUST. NAME	STATION	STATUS	QTY	AMT	DATE	REMARKS
CD GENERATORS						
CF INDUSTRIES		CLOSED	30	1	1	02/25/08
AUBURNDALE POWER		CLOSED	113	0	113	02/25/08
INDUSTRIAL						
IMC AGRICO		CLOSED	7	0	7	20
IMC AGRICO		CLOSED	0	0	0	12
CARGILL FERTILIZER		CLOSED	0	18	18	18
CARGILL FERTILIZER		CLOSED	0	18	18	18
CARGILL FERTILIZER		CLOSED	0	18	18	18
PARILAN HYDROLYZ		CLOSED	0	18	18	18
			TOTAL CARGILL REPORT		36	
			TOTAL CARGILL SCHEDULES		36	
			CARGILL NET		36	
HOUSE						
AGRI FOS LIC		TRIP	0	1	1	
IMC AGRICO		CLOSED	22	2	2	
IMC AGRICO		CLOSED	0	3	3	
MOSAIC						
IMC AGRICO		CLOSED	0	4	4	
IMC AGRICO		CLOSED	0	5	5	
IMC AGRICO		CLOSED	0	6	6	
CARGILL FERTILIZER		CLOSED	0	7	7	
AGRI FOS LIC		CLOSED	0	8	8	
IMC AGRICO		TRIP	0	8	8	
IMC AGRICO		CLOSED	0	10	10	
IMC AGRICO		CLOSED	0	11	11	
IMC AGRICO		CLOSED	0	12	12	
IMC AGRICO		CLOSED	0	13	13	
OTHER INTERRUPTIBLES						
ST LEO COLLEGE		CLOSED	0	02/25/08		
IMC AGRICO		CLOSED	0	02/25/08		
INTERNATIONAL PAPER		CLOSED	3	02/25/08		
BALL CORPORATION		CLOSED	0	02/25/08		
GAF BUILDING MATERIAL		CLOSED	1	02/25/08		
PASCO BD. PUB. INST.		CLOSED	1	02/25/08		
TRADEMARK NITROGEN		CLOSED	1	02/25/08		
VULCAN		CLOSED	1	02/25/08		
JAMES HARDIE BLDG		CLOSED	1	02/25/08		
JAMES HARDIE BLDG		CLOSED	0	02/25/08		
HERITAGE PLASTICS		CLOSED	1	02/25/08		
INTERNATIONAL PAPER		CLOSED	1	02/25/08		
CF INDUSTRIES		CLOSED	0	02/25/08		
US AGRI CHEMICALS		CLOSED	0	02/25/08		
CONAGRA INC.		CLOSED	2	02/25/08		
THE DAVID JOSEPH CO.		CLOSED	1	02/25/08		
BARNETT TECHNOLOGY		CLOSED	1	02/25/08		
LAFARGE CORR.		CLOSED	1	02/25/08		
GAFFIN INDUSTRIES		CLOSED	0	02/25/08		
VERIZON		CLOSED	1	02/25/08		
JOHNSON CONTROL		CLOSED	0	02/25/08		
METAL INDUSTRIES		CLOSED	1	02/25/08		
CURTAILABLE LOAD						
ODYSSEY MANUFACTURING		CLOSED 15 Minute Notice Prior	5			

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

CSA	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	BELMONT HEIGHTS	13034		1				
	BELMONT HEIGHTS	13035	26201-43172	4	4			Police
	BELMONT HEIGHTS	13035	26041-42962	5				Red Cross Shelter
	BELMONT HEIGHTS	13035	25991-43074					Grocery Store
	BELMONT HEIGHTS	13035	26045-43044					Grocery Store
	BELMONT HEIGHTS	13036		4	4			Nursing Home
	BELMONT HEIGHTS	13036	27162-42755	5				Critical Site - 500 KW gen
	BELMONT HEIGHTS	13036	26853-42954	4				Back-up Shelter
	BELMONT HEIGHTS	13037	26166-42604	4	3			Back-up Shelter
	BELMONT HEIGHTS	13037	25830-42533	5				Red Cross Shelter (not in 08)
CSA	CROSS CREEK	14099						Only grocery store in area
	CROSS CREEK	14100	30763-48623	5				Red Cross Shelter (not in 08)
	CROSS CREEK	14101	29598-48387	5				Red Cross Shelter
	CROSS CREEK	14102	29760-48989	5				Red Cross Shelter
	CROSS CREEK	14102	30940-48540	4				Cell Site
CSA	ELEVENTH AVE East	13178	26590-41633	4	4			Pump Station
	ELEVENTH AVE East	13178	26422-41409	4	4			Important Svc
	ELEVENTH AVE East	13180		1				
	ELEVENTH AVE East	13181	26068-41712	4	5			Pump Station
	ELEVENTH AVE East	13181	25942-41939	4	3			Fire
	ELEVENTH AVE East	13181	25935-41870	5	5			Main Police
	ELEVENTH AVE East	13183	26752-41767	1				Res/Commercial
	ELEVENTH AVE East	13183	27111-41980					Grocery Store
	ELEVENTH AVE East	13183	26813-41940	3				School
	ELEVENTH AVE West	13175	26382-42272	4	3			Fire
	ELEVENTH AVE West	13175	26999-42447	3	4			Govt Svc
	ELEVENTH AVE West	13175	26650-42386	4	5			Important Svc
	ELEVENTH AVE West	13176		5				Red Cross Shelter
	ELEVENTH AVE West	13176	26810-42118	3	4			Govt Svc
	ELEVENTH AVE West	13176	26521-42133	3				School
	ELEVENTH AVE West	13176	26870-42126	3				Cell Site
	ELEVENTH AVE West	13177	26068-41712	4	3			Pump Station
	ELEVENTH AVE West	13177	25935-41870	5	5			Main Police
	ELEVENTH AVE West	13177	26020-41620	4	4			Police
	ELEVENTH AVE West	13177		4				Dialysis Center
	ELEVENTH AVE West	13184	26516-41732	4	3			Telecom - Non transmission

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	ESTUARY	13942		2	2			Res/Commercial
	ESTUARY	13942	25647-41350	3	3			Important Svc
	ESTUARY	13943	25355-41255	5	5			Medical / Gov
	ESTUARY	13943	25449-41335	1	1			Res/Commercial
	ESTUARY	13944		1				Res/Commercial
CSA	FERN STREET	13042	25386-43776	3				School
	FERN STREET	13042	25432-43867	3	5			Alcohol Treatment
	FERN STREET	13043	25140-44152					Grocery Store
	FERN STREET	13044		4	5			Pump Station
	FERN STREET	13044	25215-43123	3	3			Telecom - Non transmission
	FERN STREET	13044	25012-43188	3				Grocery Store
	FERN STREET	13044	25255-42985	3				School
	FERN STREET	13045	25430-42922	4	3			Fire Station
	FERN STREET	13045	25466-43359					Grocery Store
CSA	FIFTY SIXTH ST North	13223	27388-42893	4	4			Fire Station
	FIFTY SIXTH ST North	13223	27299-43080	5				Critical Cell Site - 50KW gen
	FIFTY SIXTH ST North	13466		1				
	FIFTY SIXTH ST North	13468		1				
	FIFTY SIXTH ST North	13469	27450-43447	1				Res/Commercial
	FIFTY SIXTH ST North	13469	27804-43569	3				School
	FIFTY SIXTH ST North	13221		3	3			TV - Non transmission
	FIFTY SIXTH ST North	13222	27990-42984	1				Res/Commercial
	FIFTY SIXTH ST North	13224	27302-43042	2	2			Res/Commercial
	FIFTY SIXTH ST North	13467	27558-43654	1				Res/Commercial
	FIFTY SIXTH ST North	13467	27429-43616	3				School
	FIFTY SIXTH ST North	13467	27806-43645	1				Res/Commercial
	FIFTY SIXTH ST North	13467	28089-44177	4	4			Lift Station
	FIFTY SIXTH ST North	13467	29761-45220	4	5			Lift Station
CSA	FLORIDA AVE North	13836		1				
	FLORIDA AVE North	13837		4				Nursing Home
	FLORIDA AVE North	13837	24890-46244	4				Hills Co Lift Station
	FLORIDA AVE North	13840		1				
	FLORIDA AVE North	13840	25307-46846	4	4			Nursing Home
	FLORIDA AVE South	13835						Grocery Store
	FLORIDA AVE South	13838	25307-46846	4	4			Medical
	FLORIDA AVE South	13838	25999-46321	4				Cell Site - 50KW gen

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	FLORIDA AVE South	13839	25779-47933	4	3			Water / Sewage
	FLORIDA AVE South	13839	25834-48069	4	3			Water / Sewage
	FLORIDA AVE South	13839	24793-47246	4				Hills Co Lift Station
	FLORIDA AVE South	13839	25170-47128					Grocery Store
CSA	FORTY SIXTH ST East	13496	26214-45419	4	4			Nursing w/o Critical Care
	FORTY SIXTH ST East	13496	26017-45405	3	5			Mail
	FORTY SIXTH ST East	13496	26156-45333					Grocery Store
	FORTY SIXTH ST East	13497		1				Res/Commercial
	FORTY SIXTH ST East	13497	26617-45166	4	4			Police
	FORTY SIXTH ST East	13497	26327-44831	1				Res/Commercial
	FORTY SIXTH ST East	13498	26377-44724	1				Res/Commercial
	FORTY SIXTH ST East	13498	26736-44982	5	5			Hospital
	FORTY SIXTH ST East	13498	26747-44973	4				Dialysis Center
	FORTY SIXTH ST East	13499	26631-45026	2	4			Res/Commercial
	FORTY SIXTH ST East	13499	26647-44836	2	2			Res/Commercial
	FORTY SIXTH ST West	13050		3	3			Medical
	FORTY SIXTH ST West	13050	26208-45468	5	5			Medical / Emergency
	FORTY SIXTH ST West	13050	26348-45537	5	4			Special Needs Shelter
	FORTY SIXTH ST West	13050		5	4			Medical / Emergency
	FORTY SIXTH ST West	13050	26377-45619	5	4			Hospital
	FORTY SIXTH ST West	13050	26210-45650	5	5			Hospital
	FORTY SIXTH ST West	13051	26966-45296	5				Red Cross Shelter
	FORTY SIXTH ST West	13052		1				
	FORTY SIXTH ST West	13052	26868-45095	1				Res/Commercial
	FORTY SIXTH ST West	13053		1				Res/Commercial
	FORTY SIXTH ST West	13053	26773-45111	3				Cell Site
	FORTY SIXTH ST West	13053	26680-45006	2	2			Res/Commercial
CSA	FOURTEENTH ST	13046	25595-42477	5	5			Govt / Critical
	FOURTEENTH ST	13046	25703-42768	4	4			Nursing w/o Critical Care
	FOURTEENTH ST	13048	25745-42623	4				Cell Site
	FOURTEENTH ST	13047	25444-41968	4	4			Pump Station
	FOURTEENTH ST	13047	25536-41812	5	5			TECO
	FOURTEENTH ST	13048	25645-42238	5	4			Nursing w/ Critical Care
	FOURTEENTH ST	13048	26166-42604	5	4			Radio Transmitter
	FOURTEENTH ST	13048	25402-42240	5	5			Fire / Critical
	FOURTEENTH ST	13048	25378-42681					Grocery Store

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	FOURTEENTH ST	13049		1				
CSA	FOWLER AVE East	13829		4	3			Lift Station
	FOWLER AVE East	13829	27905-45245	5	4			Red Cross Shelter
	FOWLER AVE East	13830	27965-45009	4				Back-up Shelter
	FOWLER AVE East	13830	27566-44620	4	5			Water / Sewage
	FOWLER AVE East	13830	27604-44524	4	3			Water / Sewage
	FOWLER AVE East	13831	27444-45261	4	5			Lift Station
	FOWLER AVE East	13832	27894-45478	3	2			Telecom - Non transmission
	FOWLER AVE West	13825	27275-45104	5	5			Govt / Critical
	FOWLER AVE West	13825	27275-45104	5	5			Main Police
	FOWLER AVE West	13825	27386-45008	4	5			Water / Sewage
	FOWLER AVE West	13825		4	4			Govt Svc
	FOWLER AVE West	13825		4				Assisted Living
	FOWLER AVE West	13825	27278-44863	3	3			Telecom - Non transmission
	FOWLER AVE West	13826		4	2			Lift Station
	FOWLER AVE West	13826	28471-45355	4	4			Lift Station
	FOWLER AVE West	13826	28443-46005	3	3			Financial Svc
	FOWLER AVE West	13826	28285-44882	5	5			TECO
	FOWLER AVE West	13826		4	3			Lift Station
	FOWLER AVE West	13826	28254-45388	3	4			
	FOWLER AVE West	13827	27446-44927	4	5			Water / Sewage
	FOWLER AVE West	13828	27171-45193					Grocery Store
	FOWLER AVE West	13828		4				Hospice Facility
	FOWLER AVE West	13828		4				Temple Terrace Corp Offices
	FOWLER AVE West	13828		4				Dialysis Center
CSA	GTE COLLIER	14010		3	4			Telecom - Non transmission
	GTE COLLIER	14010		4	3			Fire
	GTE COLLIER	14010		4				Telecom Corp Offices
	GTE COLLIER	14010	28173-45860	3				Telecom - Non transmission
	GTE COLLIER	14010	28068-45574	4	4			Fire Station #2
	GTE COLLIER	14010	28028-45572	4	4			
	GTE COLLIER	14010	28055-45452	4	4			Verizon Data Services
	GTE COLLIER	14011		3	4			Telecom - Non transmission
	GTE COLLIER	14011	28214-45958	4	4			
	GTE COLLIER	14011	28331-46066	3	3			
	GTE COLLIER	14011		3				Financial Svc

22

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	GTE COLLIER	14011	28537-46077	1				Res/Commercial
	GTE COLLIER	14012		4	3			Fire
	GTE COLLIER	14012	28671-46486	4	4			
	GTE COLLIER	14012	28643-45696	4				Cell Site
	GTE COLLIER	14012	29433-46307	5				Critical Cell Site - 50KW gen
CSA	HARBOUR ISLAND	14059		1				
	HARBOUR ISLAND	14064		3	4			
	HARBOUR ISLAND	14065		2	2			Res/Commercial
CSA	HARNEY RD	14040	28255-43897	4	4			Lift Station
	HARNEY RD	14040	28091-44596	4	5			Lift Station
	HARNEY RD	14040	28586-44400					Grocery Store
	HARNEY RD	14041	28435-44041	3				Cell Site - 50KW gen
	HARNEY RD	14042	27961-43957	4	4			Lift Station
CSA	HOOKE'S POINT	13250		1				
	HOOKE'S POINT	13251	25680-40960	3				Cell Site
	HOOKE'S POINT	13252		1				
	HOOKE'S POINT	13253		1				
CSA	JUNEAU East	13417	25039-44535	3	4			School
	JUNEAU East	13417	25223-44576	4	4			Govt Svc
	JUNEAU East	13417		3				Mall
	JUNEAU East	13418	24965-44360	3				
	JUNEAU East	13418	25039-44535	3	4			School
	JUNEAU East	13419	24828-43805	2				Res/Commercial
	JUNEAU East	13419	24774-44242	3				
	JUNEAU East	13419	24323-43701					Grocery Store
	JUNEAU East	13419	24485-43633	3				Cell Site - 50KW gen
	JUNEAU East	13420		1				
	JUNEAU West	13021	24032-44928	4	4			Lift Station
	JUNEAU West	13021		2	2			Res/Commercial
	JUNEAU West	13021	24351-44266					Grocery Store
	JUNEAU West	13022		1				
	JUNEAU West	13023	23796-44159	1				Res/Commercial
	JUNEAU West	13024	24947-43809	1				Res/Commercial
	JUNEAU West	13024		4				Nursing Home
	JUNEAU West	13024						
	JUNEAU West	13024						

23

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	LAKE MAGDELENE	13932		1				
	LAKE MAGDELENE	13934	24055-46379	4	4			Nursing w/ Critical Care
	LAKE MAGDELENE	13934		4				Nursing Home
	LAKE MAGDELENE	13934	23820-45965	4	4			Lift Station
	LAKE MAGDELENE	13934	23669-46007	4				Hills Co Lift Station
	LAKE MAGDELENE	13934	23820-46410	3	3			Telecom - Non transmission
	LAKE MAGDELENE	13934	23794-46458					Grocery Store
	LAKE MAGDELENE	13935	24910-46551	3				School
	LAKE MAGDELENE	13939		4	4			Lift Station
	LAKE MAGDELENE	13939	23987-45911	4				Hills Co Lift Station
	LAKE MAGDELENE	13939	24063-45858	4	4			Govt Svc
	LAKE MAGDELENE	13939	24052-45807	3	2			Govt Svc
CSA	MARION STREET	13560		5	5			Downtown
	MARION STREET	13561		5	5			Downtown
	MARION STREET	13562		5	5			Downtown
	MARION STREET	13563		5	5			Downtown
	MARION STREET	13564		5	5			Downtown
	MARION STREET	13565		5	5			Downtown
CSA	MARITIME North	13546	25960-41322	4	3			Fire
	MARITIME North	13546	26090-40586	1				Res/Commercial
	MARITIME North	13546	26101-40468	1				Res/Commercial
	MARITIME North	13550		1				
	MARITIME North	13551	25744-40647	1	1			Res/Commercial
	MARITIME North	13554	25928-40560	4	3			Water / Sewage
	MARITIME South	13547	25697-40670	1				Res/Commercial
	MARITIME South	13547	25928-40560	4	3			Water / Sewage
	MARITIME South	13552	25805-40285	1				Res/Commercial
	MARITIME South	13553	25928-40560	4	3			Water / Sewage
CSA	MCFARLAND	13104		1				
	MCFARLAND	13105	25109-45132	3				Cell Site
	MCFARLAND	13106	25488-45666	4	3			Pump Station
	MCFARLAND	13108	25700-45675	4	3			Fire
	MCFARLAND	13107	25124-45829					Grocery Store
	MCFARLAND	13107		1				Res/Commercial
	MCFARLAND	13107						
	MCFARLAND	13107						

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	MCKINLEY East	13054		1				
	MCKINLEY East	13055	26510-44938	2	2			Res/Commercial
	MCKINLEY East	13055	26456-44863	2	2			Res/Commercial
	MCKINLEY East	13055	26335-45085	2	4			Res/Commercial
	MCKINLEY East	13057		1				
	MCKINLEY East	13858		1				
	MCKINLEY West	13858						
	MCKINLEY West	13844	26210-45650	5	5			Hospital
	MCKINLEY West	13845	26299-44471	2	2			Res/Commercial
CSA	PEBBLECREEK North	14094		1				
	PEBBLECREEK North	14095		1				
	PEBBLECREEK North	14096		1				
	PEBBLECREEK South	14089	28621-48372	1				Grocery Store
	PEBBLECREEK South	14089	28645-48624	3				Cell Site
	PEBBLECREEK South	14090	28535-48997	4				Back-up Shelter
	PEBBLECREEK South	14090	28536-48559					Grocery Store
	PEBBLECREEK South	14090	28480-48918					Grocery Store
	PEBBLECREEK South	14091	28249-47923	3				Home Improvement Center
	PEBBLECREEK South	14091	28260-47950					Grocery Store
CSA	PINE LAKE North	13185		1				
	PINE LAKE North	13186	24561-45378	5				Red Cross Shelter
	PINE LAKE North	13188	23940-45249	4	4			Water / Sewage
	PINE LAKE North	13188	24102-45190	1	3			
	PINE LAKE North	13188	24029-45219	1	4			
	PINE LAKE North	13633	23726-45720	4	4			Fire
	PINE LAKE North	13633	23712-45483	4				Hills Co Lift Station
	PINE LAKE South	13187		1				
	PINE LAKE South	13630	25124-45829					Grocery Store
	PINE LAKE South	13630	24991-45704	4	4			Nursing w/o Critical Care
	PINE LAKE South	13631		4				Nursing Home
	PINE LAKE South	13632		1				
CSA	PLYMOUTH ST East	13092	24617-42489	4	4			Pump Station
	PLYMOUTH ST East	13093	25184-43058	3				Cell Site
	PLYMOUTH ST East	13093	25184-42808	3	3			School
	PLYMOUTH ST East	13094	25064-42064	4	4			Alcohol Treatment
	PLYMOUTH ST East	13094	25205-42079	5				TEC Critical Site - 50KW gen

25

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	PLYMOUTH ST East	13094		4	4			Res/Commercial
	PLYMOUTH ST East	13094		3				
	PLYMOUTH ST West	13088	25008-42841	3				School
	PLYMOUTH ST West	13088	24715-42647	5	5			Hospital
	PLYMOUTH ST West	13088	24904-42852	4	5			Pump Station
	PLYMOUTH ST West	13089	24841-41760	5	4			Govt / Critical
	PLYMOUTH ST West	13089	24847-42160	4	4			Nursing w/o Critical Care
	PLYMOUTH ST West	13090	24626-43193	4	4			Pump Station
	PLYMOUTH ST West	13091	25296-42569	4	3			Fire
	PLYMOUTH ST West	13091	25250-42857	4				Back-up Shelter
CSA	SENECA	13590	25768-45163	3				School
	SENECA	13590	25378-45237					Grocery Store
	SENECA	13591	26047-44956	3				School
	SENECA	13591	25833-44667	4	5			Pump Station
	SENECA	13592		3				Mail
	SENECA	13592		1	4			Not Found
	SENECA	13592	25208-44831	1	4			Not Found
	SENECA	13593	24984-44808	5				Red Cross Shelter
	SENECA	13593	24990-44869	5				Red Cross Shelter
CSA	SUNSET LANE East	13097	25882-48196	4	4			Water / Sewage
	SUNSET LANE East	13097	24982-48420	2	3			Res/Commercial
	SUNSET LANE East	13097	26493-47974	4				Cell Site
	SUNSET LANE East	13993		1				
	SUNSET LANE West	13096	25054-48770	4	4			Fire
	SUNSET LANE West	13096	25254-48658	3				School
	SUNSET LANE West	13096	24502-48964					Grocery Store
	SUNSET LANE West	13098	24529-48099	3	2			
	SUNSET LANE West	13098	24796-48316	4				Hills Co Lift Station
	SUNSET LANE West	13098	25142-48370	3				Cell Site
	SUNSET LANE West	13098	25104-48387					Grocery Store
	SUNSET LANE West	13098	24738-48197	4				Hills Co Lift Station
	SUNSET LANE West	13099	26136-49394	3				Cell Site
CSA	TAMPA PALMS East	13717		4	5			Water / Sewage
	TAMPA PALMS East	13717	27665-47410	4	3			Fire
	TAMPA PALMS East	13717		3	3			Insurance
	TAMPA PALMS East	13717						

26

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	TAMPA PALMS East	13717	28020-47548	3				Cell Site
	TAMPA PALMS East	13717		4	5			Water / Sewage
	TAMPA PALMS East	13717	28114-47543	4	5			Water / Sewage
	TAMPA PALMS East	13718	27542-46874	4				Back-up Shelter
	TAMPA PALMS East	13719		1				
	TAMPA PALMS West	13713		5				Red Cross Shelter
	TAMPA PALMS West	13713	27381-47136	4				Cell Site
	TAMPA PALMS West	13714	27762-47396	3				Home Improvement Center
	TAMPA PALMS West	13715	27122-46914					Grocery Store
	TAMPA PALMS West	13716	28443-46005	3	3			Financial Svc
CSA	TEMPLE TERRACE North	13026	27069-44505					Grocery Store
	TEMPLE TERRACE North	13028	27819-44105	4	4			Lift Station
	TEMPLE TERRACE North	13028	28109-44838	4	3			Lift Station
	TEMPLE TERRACE North	13028	27965-44404	4	3			Lift Station
	TEMPLE TERRACE North	13028	27949-44215	4	5			Important Svc
	TEMPLE TERRACE North	13028	27382-44475	4	3			Fire
	TEMPLE TERRACE North	13028		4	3			Water / Sewage
	TEMPLE TERRACE North	13028	27843-44204	4	3			Lift Station
	TEMPLE TERRACE North	13028	27647-44496	4	3			Water / Sewage
	TEMPLE TERRACE North	13028	27524-44558	4	4			Water / Sewage
	TEMPLE TERRACE North	13028	28109-44838	4	4			Govt Svc
	TEMPLE TERRACE North	13029		4	3			Fire
	TEMPLE TERRACE North	13029		4				Assisted Living
	TEMPLE TERRACE North	13029	24330-44490	4				Grocery Store
	TEMPLE TERRACE North	13029	27264-44524					Grocery Store
	TEMPLE TERRACE North	13029		3	3			Telecom - Non transmission
	TEMPLE TERRACE North	13029	27225-44722	4	4			Lift Station
	TEMPLE TERRACE North	13029	27352-44516	5				Red Cross Shelter (not in 08)
	TEMPLE TERRACE South	13027		4	3			Lift Station
	TEMPLE TERRACE South	13027	27645-44167	4	3			Lift Station
	TEMPLE TERRACE South	13027	28108-44952	4	4			Lift Station
	TEMPLE TERRACE South	13027	27572-43831	4	3			Lift Station
	TEMPLE TERRACE South	13027	24361-44333					Grocery Store
	TEMPLE TERRACE South	13204	27240-44210	4	5			Lift Station
	TEMPLE TERRACE South	13204	26501-43714	4	3			Pump Station
	TEMPLE TERRACE South	13205		1				

27

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUGS THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	THIRD AVENUE	13397	25516-41815	5	5			TECO
	THIRD AVENUE	13397		2	4			Res/Commercial
	THIRD AVENUE	13397		1	4			Nursing Home
	THIRD AVENUE	13398		2	2			Res/Commercial
	THIRD AVENUE	13399		1				
	THIRD AVENUE	13400	25226-41685	4	5			Jail
	THIRD AVENUE	13400	25479-41757	3	4			School
	THIRD AVENUE	13400	25311-41541	5	3			Main Fire
	THIRD AVENUE	13400	25250-41660	3	4			Important Svc
CSA	THIRTIETH STREET	13158	26750-43630	4	4			Pump Station
	THIRTIETH STREET	13158	26780-43757	4	4			Pump Station
	THIRTIETH STREET	13158	26828-43644	4				Back-up Shelter
	THIRTIETH STREET	13158	26615-43557	5				Red Cross Shelter
	THIRTIETH STREET	13159	26169-43371	5	5			Govt / Critical
	THIRTIETH STREET	13159	26150-43412	5	5			Govt / Critical
	THIRTIETH STREET	13159	25945-43586	4	3			Back-up Shelter
	THIRTIETH STREET	13159		5	5			TECO
	THIRTIETH STREET	13180		4	3			Pump Station
	THIRTIETH STREET	13600	27341-42475	4	3			Fire
	THIRTIETH STREET	13600		3	2			Medical
	THIRTIETH STREET	13600	25928-43194	5	5			Special Needs Shelter
	THIRTIETH STREET	13600	26161-43304	5	5			Emergency
	THIRTIETH STREET	13600	26015-43285	5	5			Govt / Critical
CSA	TROUT CREEK North	13988		1				
	TROUT CREEK North	13989		1				
	TROUT CREEK North	13990	28528-49594					Grocery Store
	TROUT CREEK South	13985		1				
	TROUT CREEK South	13986	28758-49304	5				Red Cross Shelter
	TROUT CREEK South	13986	28710-49386	5				Red Cross Shelter
	TROUT CREEK South	13987	28696-49963					Grocery Store
CSA	TWENTY SEVENTH ST Nor	13350	26185-45650	5	5			Hospital
	TWENTY SEVENTH ST Nor	13351	26043-46169					Grocery Store
	TWENTY SEVENTH ST Nor	13351	25826-46230	4				Back-up Shelter
	TWENTY SEVENTH ST Nor	13352	25950-45489	4	4			Nursing w/o Critical Care
	TWENTY SEVENTH ST Nor	13352						
	TWENTY SEVENTH ST Nor	13352						

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	TWENTY SEVENTH ST Sou	13348	25894-46032	3	3			Govt Svc
	TWENTY SEVENTH ST Sou	13348	25947-45764	3				Cell Site
	TWENTY SEVENTH ST Sou	13348		1	4			
	TWENTY SEVENTH ST Sou	13349	26329-45857	5	5			Hospital
	TWENTY SEVENTH ST Sou	13349	26142-46298	3				Important Svc
	TWENTY SEVENTH ST Sou	13349	26301-46035	3	4			Govt Svc
	TWENTY SEVENTH ST Sou	13349	26136-46173	3	4			
	TWENTY SEVENTH ST Sou	13353	25956-45365	3	5			Mall
	TWENTY SEVENTH ST Sou	13354	26136-46173	2	4			Res/Commercial
	TWENTY SEVENTH ST Sou	13354	26301-46035	3	4			Govt Svc
	TWENTY SEVENTH ST Sou	13354	26091-45863	4				Back-up Shelter
	TWENTY SEVENTH ST Sou	13354	26057-46259					Grocery Store
	TWENTY SEVENTH ST Sou	13354	26129-45830					Grocery Store
	TWENTY SEVENTH ST Sou	13354	26233-45734	3				Medical
CSA	UNIV. OF SO. FLA. East	13363		1				
	UNIV. OF SO. FLA. East	13364	26747-45954	4	4			Nursing Home
	UNIV. OF SO. FLA. East	13364		4				Dialysis Center
	UNIV. OF SO. FLA. East	13366	26233-45734	5	5			Medical
	UNIV. OF SO. FLA. East	13366	26377-45619	5	5			Hospital
	UNIV. OF SO. FLA. East	13366	26379-45534	5	5			Hospital
	UNIV. OF SO. FLA. East	13366	26481-45767	3	3			Medical
	UNIV. OF SO. FLA. East	13366	26262-45567	3	3			Medical
	UNIV. OF SO. FLA. East	13369	26734-45308	5	5			Main Police
	UNIV. OF SO. FLA. East	13369		5				Special Needs Shelter
	UNIV. OF SO. FLA. West	13362	26610-45829	5	4			Nursing w/ Critical Care
	UNIV. OF SO. FLA. West	13362	23616-45857	5	5			Hospital
	UNIV. OF SO. FLA. West	13362		4				Dialysis Center
	UNIV. OF SO. FLA. West	13365	27894-45478	3	2			Telecom - Non transmission
	UNIV. OF SO. FLA. West	13365	27968-45698	3	3			Telecom - Non transmission
	UNIV. OF SO. FLA. West	13367	25292-45927	4	4			Medical
	UNIV. OF SO. FLA. West	13367	26486-45965	4	4			Nursing w/o Critical Care
	UNIV. OF SO. FLA. West	13368		1				
CSA	WASHINGTON ST North	13258		3				
	WASHINGTON ST North	13260		3				
	WASHINGTON ST North	13262		3				
	WASHINGTON ST North	13264		3				

29

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
CSA	WASHINGTON ST South	13259		3				
	WASHINGTON ST South	13261		3				
	WASHINGTON ST South	13263		3				
	WASHINGTON ST South	13265		3				
CSA	YUKON North	13946		1				
	YUKON North	13947		5	5			TECO
	YUKON North	13947	26095-43660	4	4			Pump Station
	YUKON North	13948	26587-44561	4	4			Pump Station
	YUKON North	13948	26594-44552	4	3			Fire
	YUKON South	13100	26020-44381	3				School
	YUKON South	13100	2583-44667	4	5			Water / Sewage
	YUKON South	13100	26069-44050	5	5			Govt / Critical
	YUKON South	13101	25389-44248	4	3			Fire
	YUKON South	13101	25248-44317	3	3			Medical
	YUKON South	13101	25220-44306	3	3			Govt Svc
	YUKON South	13101	25238-44448					Grocery Store
	YUKON South	13101	25241-44378		3			Home Improvement Center
	YUKON South	13102			2			Res/Commercial
	YUKON South	13102	26833-44666		4	5		Pump Station
	YUKON South	13102	26188-44591		5	3		Fire / Critical
	YUKON South	13103	25562-44223		4			Back-up Shelter
	YUKON South	13103	25434-44145		5			TEC Critical Site - 50KW gen
YUKON South	13103	25569-43980		4	3		Pump Station	

30

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
DCSA	BLANTON	13813	33942-58680	2	2				
	BLANTON	13813	33653-57888	2	2				
	BLANTON	13815	33670-58090	2	2				
DCSA	DADE CITY	13328	33838-56548	4	4			Nursing Home	
	DADE CITY	13328	33670-56387	3	3			School	
	DADE CITY	13329	33985-58468	5	5			Police	
	DADE CITY	13329	33836-56478	5	4			Water Dept	
	DADE CITY	13329	33980-58688	5	5			TECO Ops	
	DADE CITY	13329	33979-56568	4	4			Fire Station	
	DADE CITY	13329	33962-56644	5	5			Hospital	
	DADE CITY	13329	34146-56566	4	4			Phone	
	DADE CITY	13329	33868-56488	4	5			College	
	DADE CITY	13330	33014-57059	3	3			Cell Site - 50KW gen	
	DADE CITY	13331		3	3			Sheriff	
	DCSA	FORT KING North	13004	33583-56373	5	5			Hospital
		FORT KING North	13004	33520-56909	5	5			Hospital
		FORT KING North	13004	33628-56390	6	5			Water
		FORT KING North	13004	33632-56288	4	4			Nursing Home
FORT KING North		13004	33574-56034	4	4			Nursing Home	
FORT KING North		13004		4	4			Dialysis Center	
FORT KING North		13006	33898-55414	4	4			Radio	
FORT KING North		13006	34820-54402	4	4			Critical Site - 50KW gen	
FORT KING North		13006	33880-54005	5	5				
FORT KING North		13006	34408-54802	2	2				
FORT KING North		13006	34263-54801	2	2				
FORT KING North		13006	34359-54631	2	2				
FORT KING North		13006	34194-54823	2	2				
FORT KING North		13423	34073-55374	4	4			Grocery Store	
FORT KING North		13423	34035-55638	1	1			Pump	
FORT KING North	13423	33685-55489	2	2			Grocery Store		
FORT KING South	13005	34020-55826	1	1			School		
DCSA	PASCO PACKING	2400		3	3			Interruptable	
	PASCO PACKING	4160		2	2			Interruptable	
	PASCO PACKING	4160		2	2				

REDACTED

TAMPA ELECTRIC COMPANY
DOCKET NO. 080317-EI
FIPUG'S THIRD REQUEST FOR PODS
FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
DCSA	SAN ANTONIO	13431	31137-55457	2	2			
	SAN ANTONIO	13431	31214-55498	2	2			
	SAN ANTONIO	13432	31824-55989	2	2			Interruptable

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
ESA	BELL SHOALS	13729	31600-37518	5	5			TV
	BELL SHOALS	13729	32218-36677	5	5			Radio
	BELL SHOALS	13729	32496-37780	3	3			TV
	BELL SHOALS	13729	31485-37480	5	5			TV
	BELL SHOALS	13729	32218-36677	5	5			TV
	BELL SHOALS	13729	31511-37767	5	5			TV
	BELL SHOALS	13731	30791-38310					Grocery Store
	BELL SHOALS	13732	31317-36700	4	4			Sheriff
	BELL SHOALS	13732	31761-36468	4	4			Hills County Lift Station
	BELL SHOALS	13733	31324-36632	4	4			
	BELL SHOALS	13733	31323-38032	4	4			
	BELL SHOALS	13038	31268-40052	1	1			Reserve Shelter
	BLOOMINGDALE	13038	31172-40252	3	1			Cell Site
	BLOOMINGDALE	13039	31132-39429	3	3			
	BLOOMINGDALE	13039	30847-39873	3	3			
BLOOMINGDALE	13039	30669-39996	1	1				
BLOOMINGDALE	13040	31295-39253	4	4				
BLOOMINGDALE	13040	31398-38993	4	4			Hills County Lift Station	
BLOOMINGDALE	13040	31563-38325					Grocery Store	
BLOOMINGDALE	13040	31175-39361					Grocery Store	
BLOOMINGDALE	13041	31745-39623	3	3			Reserve Shelter	
BLOOMINGDALE	14109	31857-39236	5	5				
BLOOMINGDALE	14110			1				
BLOOMINGDALE	14111			1				
BLOOMINGDALE	14112	31750-39457	3	3			Reserve Shelter	
BLOOMINGDALE	14112	31767-39840	4	4			Cell Site	
BLOOMINGDALE	14112	32130-38498					Grocery Store	
BLOOMINGDALE	14112						Fire Station	
BRANDON East	13225	31092-41037	5	5			Sheriff	
BRANDON East	13225	31082-41040	5	4			Grocery Store	
BRANDON East	13225	31068-41050					School	
BRANDON East	13225	31068-41171	3	3			School	
BRANDON East	13225	31124-41155	3	3				
BRANDON East	13225	31172-41145	4	4				
BRANDON East	13225	31043-41387	4	4				
BRANDON East	13225	31214-41284	4	4			Hills County Lift Station	

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
ESA	BRANDON East	13226	31092-41037	5	5				
	BRANDON East	13226	31422-41122		3			Grocery Store	
	BRANDON East	13226	31495-41087	3	2			Home Improvement Center	
	BRANDON East	13227	31295-40520	2	2				
	BRANDON East	13231	31316-40987	3				Cell Site	
	BRANDON West	13228	30855-40877	4	4			Hospital Office Complex	
	BRANDON West	13228	30705-40960					Grocery Store	
	BRANDON West	13228	30452-40658	4	4			Nursing Home	
	BRANDON West	13228	30690-40960					Grocery Store	
	BRANDON West	13229	30903-41213	4	4				
	BRANDON West	13229	30892-41032	4	4				
	BRANDON West	13229	30751-41252	4	4			Hills County Lift Station	
	BRANDON West	13229	30737-41377	4	4				
	BRANDON West	13229	30782-41048	4				Dialysis Center	
	BRANDON West	13229	30735-41533	4	4			Senior Living Center	
	BRANDON West	13230	30817-40782	5	5			Back up to relay svc	
	ESA	BRANDON West	13230	30750-40571	4	4			
		BUCKHORN	13705	30341-39125	4	4			Hills County Lift Station
BUCKHORN		13705	30702-39424	4	4				
BUCKHORN		13705		4	4			Nursing Home	
BUCKHORN		13705	30354-39288	4	4			Hills County Lift Station	
BUCKHORN		13705	30402-39377	4				Cell Site	
BUCKHORN		13705	30702-39424	4	4			Water Pump	
BUCKHORN		13706	29001-38476	3	3			Environmental	
BUCKHORN		13706	29645-39324					Grocery Store	
BUCKHORN		13706	29712-39317					Grocery Store	
BUCKHORN		13707	29732-39936	4	4				
BUCKHORN		13708	29223-39303	3				Home Improvement Center	
BUCKHORN		13708	29371-38937					Grocery Store	
BUCKHORN		13709	30019-39216	5				Red Cross Shelter	
BUCKHORN		13712	29402-38675	3	3			Sheriff	
BUCKHORN		13712	29193-38606	4	4				
BUCKHORN		13712	30184-39267	4	4				
BUCKHORN		13712	29701-38577	3					
BUCKHORN		13710	30493-39660	5	5			Hills County Lift Station	
BUCKHORN		13710	30495-39610	5	4			EMS	

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
ESA	BUCKHORN	13711		1				
ESA	CLARKWILD	13458		1				
	CLARKWILD	13459	30409-45359	4	4			Fire Station
	CLARKWILD	13460	32365-47975	3				Cell Site
	CLARKWILD	13461	29480-45149	3	5			
	CLARKWILD	13461	28899-44774	4	4			
ESA	FAIRGROUNDS	13211	28608-42675	4	4			
	FAIRGROUNDS	13211	28843-42614	4	4			
	FAIRGROUNDS	13211	28642-42613	4	4			
	FAIRGROUNDS	13213	28539-42874	4	4			
	FAIRGROUNDS	13213	28782-43404	4	4			Sheriff
	FAIRGROUNDS	13213	30377-43368	5	5			Fire Station
	FAIRGROUNDS	13213	29442-44227	5	3			Red Cross Shelter
	FAIRGROUNDS	13213	28847-43402	5	5			Airport
	FAIRGROUNDS	13213		1	1			
	FAIRGROUNDS	13214		5	5			
	FAIRGROUNDS	13214	28199-42446	4	4			TEC Staging Area
ESA	INDIAN CREEK	14341		1				Residential load
ESA	LAKEWOOD	13454	30277-41890	4	4			Reserve Shelter
	LAKEWOOD	13454	30279-41896	3	3			Reserve Shelter
	LAKEWOOD	13454	29440-41536	4				Cell Site - 50KW gen
	LAKEWOOD	13455	30460-41155	4	3			Reserve Shelter
	LAKEWOOD	13458	30341-41234	5	4			Shelter
	LAKEWOOD	13455	30171-41060	4	4			Hills Co Lift Station
	LAKEWOOD	13456		1				
	LAKEWOOD	13457	30644-41183	4	3			Reserve Shelter
	LAKEWOOD	13457	30461-41242	4	4			Nursing Home
	LAKEWOOD	14114	29621-41770	5	3			Red Cross Shelter
	LAKEWOOD	14115	29567-40973	2	2			
	LAKEWOOD	14115	29485-41034	2	2			
	LAKEWOOD	14117	30610-40829	4	4			
	LAKEWOOD	14117	30723-40826	5	5			Hospital
	LAKEWOOD	14116	30297-40879	5	5			Hills Co Lift Station
	LAKEWOOD	14116	30373-40916					Grocery Store
	LAKEWOOD	14116	30082-40913	4	3			Sheriff Dist 2 Office
	LAKEWOOD	14116	30537-40906	4				Dialysis Center
	LAKEWOOD	14116						
	LAKEWOOD	14116						

35

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
ESA	MADISON	13169	28419-40102	5				Red Cross Shelter	
	MADISON	13169	28411-40024	5				Red Cross Shelter	
	MADISON	13169	28555-40199	4	4			Lift Station	
	MADISON	13170	28587-39123	5				Red Cross Shelter	
	MADISON	13171	28498-38789	4	3			Reserve Shelter	
	MADISON	13171	28111-39282	4				Hills Co Lift Station	
	MADISON	13171	28149-39442	4	4			Sheriff	
	MADISON	13171	28161-39338	3	3			Environmental	
	MADISON	13171	28095-39233	3	3			Environmental	
	MADISON	13171	28352-39027	2	2				
	MADISON	13172			1				
	MADISON	13495	28084-40326	5	5				Fire Dept
	MADISON	13495	28103-40303	5	5				Fire Station
	MADISON	13495	28118-40260	4	4				Sheriff
	MADISON	13495	27453-40086	2	2				
	MADISON	13173	28879-40054	2	2				
	MADISON	13173	29040-39641	3					Cell Site
	ESA	MASSARO	14196	28293-41656	2	2			INTER-ODYSSEY MFG
MASSARO		14197	28290-41939	4	4				
MASSARO		14197	28184-41889	4	4				
MASSARO		14197	28295-41671	4	4				
MASSARO		14197	28308-41702	1	1				
MASSARO		14198	28217-41156	5	5			TEC Operations Ctr	
MASSARO		14198	28107-41716	4	4				
MASSARO		14198	28107-41715	4	4				
MASSARO		14198	28484-41471	4	4				
MASSARO		14198	28474-41342	3	3				
MASSARO		14198	28375-41391	4				Hospice Pharmacy Facility	
MASSARO		14199			2	2			
MASSARO		14199	28674-41597	2	2				
MASSARO		14199	28230-41939	3	3			Main Switch - Relay	
ESA		ORIENT PARK	13084	28341-42147	3	3			Cell Site - 50KW gen
	ORIENT PARK	13085	28217-41158	5	5			ECC BLDG	
	ORIENT PARK	13085	28230-41272	5	5			ECC BLDG	
	ORIENT PARK	13085	27917-41812	4	4			Orient Road Jail	
	ORIENT PARK	13085	28034-41758	4	3				
	ORIENT PARK	13085							

36

TAMPA ELECTRIC COMPANY
DOCKET NO. 080317-EI
FIPUG'S THIRD REQUEST FOR PODS
FILED: NOVEMBER 7, 2008

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
ESA	ORIENT PARK	13065	27965-41865	2	2			INTER-GRIFFIN IND
	ORIENT PARK	13066	27159-41961	4	4			
	ORIENT PARK	13066		2	2			
	ORIENT PARK	13067	27975-42331	2	2			
	ORIENT PARK	13063	27768-42262	4	4			
	ORIENT PARK	13063	26864-42760	4	4			
	ORIENT PARK	13063	27778-42487	4	4			Sheriff
	ORIENT PARK	13063	27737-42177	4	4			Reserve Shelter
	ORIENT PARK	13063	28004-42597	3	2			FS Property
	ORIENT PARK	13063	27661-42471	2	2			
	ORIENT PARK	13063		2	2			
	ORIENT PARK	13064		2	2			
	ESA	PEACH AVENUE	13006	30871-44181	5	4		
PEACH AVENUE		13006	30303-43790	4	4			Sheriff
PEACH AVENUE		13006	30453-43495	3	4			School
PEACH AVENUE		13006	30103-44222	4	4			
PEACH AVENUE		13006	30878-43997		2			
PEACH AVENUE		13006	30838-44917		2			
PEACH AVENUE		13006	30490-43734		1			
PEACH AVENUE		13009	29530-43237		4			
PEACH AVENUE		13009	30128-43389		2			
PEACH AVENUE		13010			1			Cell Site
PEACH AVENUE		13011			1			
PEARSON ROAD South		13685	32513-38008		4			Cell Site - 50KW gen
PEARSON ROAD South		13685	32662-39133		4			Red Cross Shelter
PEARSON ROAD South	13686	32571-39878		5	3		Hills Co Lift Station	
PEARSON ROAD South	13686	32464-40032		4	4			
PEARSON ROAD South	13686	32871-39498		4	4			
PEARSON ROAD South	13687	33402-39881		5	3		Red Cross Shelter	
PEARSON ROAD South	13687	32891-40082		4	4			
PEARSON ROAD North	13690	32206-39392					Grocery Store	
PEARSON ROAD North	13691	32939-39398		5	5		Fire Station	
PEARSON ROAD North	13692			1	1			
PEARSON ROAD North	13693	32220-38693		5	3		Red Cross Shelter	
PEARSON ROAD North	13693	32172-38457		4	4		Hills Co Lift Station	
PEARSON ROAD North	13693							

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
ESA	PORT SUTTON	13324	27231-40336	5	4			Radio	
	PORT SUTTON	13324	27205-40613	2	2				
	PORT SUTTON	13325	26125-39744	4	4				
	PORT SUTTON	13325		1	2			Environmental	
	PORT SUTTON	13326	27155-39225	3	3				
	PORT SUTTON	13326		3	3				
	PORT SUTTON	13326	27125-38765	2	2			INTERR. GAF BLDG MAT	
	PORT SUTTON	13326		1	1				
	PORT SUTTON	13326	27155-39225	4	4			Chemical (Campill)	
	PORT SUTTON	13327	28400-39926	5	5			GAN STATION	
	PORT SUTTON	13327	26500-39877	1	1			INTERR. KinderMorgan	
	ESA	PROVIDENCE RD East	13310	26664-39844	2	2			
		PROVIDENCE RD East	13678	30317-40413	4	4			Nursing Home
		PROVIDENCE RD East	13679	29660-40362	3				Home Improvement Center
		PROVIDENCE RD East	13679	29528-40391					Grocery Store
PROVIDENCE RD East		13679	29449-40141	4				Hills Co Lift Station	
PROVIDENCE RD East		13680	29270-40419	4	4				
PROVIDENCE RD East		13680	29496-40574	4	4			Grocery Store	
PROVIDENCE RD East		13681	29478-40723	3	5				
PROVIDENCE RD West		13682	29607-40719	1	1				
PROVIDENCE RD West		13683	29989-40776	4	4			Nursing Home	
PROVIDENCE RD West		13683	30001-40825	4	4			Cell Site	
PROVIDENCE RD West		13683	29662-40666	4	4			Nursing Home	
PROVIDENCE RD West		13683	29945-40799	1	1			Grocery Store	
PROVIDENCE RD West		13684	29764-40398	1	1				
ESA		SEVENTY EIGHTH ST	13132	28133-41185	1	5			ECC BLDG
	SEVENTY EIGHTH ST	13132	28217-41158	5	5			ECC BLDG	
	SEVENTY EIGHTH ST	13132	28230-41272	5	5			ECC BLDG	
	SEVENTY EIGHTH ST	13133	28152-41078	1	1			Grocery Store	
	SEVENTY EIGHTH ST	13134		1					
ESA	S. SEFFNER East	13127	31496-41543	4				Hills Co Lift Station	
	S. SEFFNER East	13127	31522-41771	4				Hills Co Lift Station	
	S. SEFFNER East	13128	31031-42556	5	5			Fire Station	
	S. SEFFNER East	13129	31085-41769	5	5			Grocery Store	

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
ESA	S. SEFFNER East	13129	30971-41777					Grocery Store
	S. SEFFNER East	13130	30690-42501					Grocery Store
	S. SEFFNER East	13130	30728-42658					Grocery Store
ESA	S. SEFFNER West	13576		1				
	S. SEFFNER West	13577	30462-41803	4	4			Hills Co Lift Station
	S. SEFFNER West	13579	31994-42253	5	5			Substation Power
	S. SEFFNER West	13579	31101-42636	4				Cell Site
	S. SEFFNER West	13679	31257-42696	4	4			
	S. SEFFNER West	13579	31410-42334	4				Hills Co Lift Station
	S. SEFFNER West	13579	31096-42373	4	4			Lift Station
	S. SEFFNER West	13579	31832-42443					
ESA	ST CLOUD	13796	32867-41067	3	3			Fire Dept
	ST CLOUD	13796		2				
	ST CLOUD	13793	31744-41067					Grocery Store
	ST CLOUD	13795	31849-41774	2				
	ST CLOUD	13795						
	ST CLOUD	13797		1				
	ST CLOUD	13798	32115-40740	5	3			Red Cross Shelter
	ST CLOUD	13798	32152-40944					Grocery Store
	ST CLOUD	13798	31790-40947					Grocery Store
	ST CLOUD	13798	31878-40789	4				Hills Co Lift Station
	ST CLOUD	13798						
	ST CLOUD	13799			1			
ESA	SR 574 West	13501	28850-42522	1	1			
	SR 574 West	13501	28667-42431					Grocery Store
	SR 574 West	13502	29398-42625	3	3			
	SR 574 West	13502	29164-42475	3	3			
	SR 574 West	13504	29184-42312	4	4			
	SR 574 West	13504	29373-42351	3	3			
	SR 574 West	13504	29305-42481	3	3			
	SR 574 West	13504		1	1			
	SR 574 East	13505	29305-42481	3	3			
	SR 574 East	13505	29164-42475	3	3			
	SR 574 East	13505	29348-42554	3				FS Property
	SR 574 East	13506		5	5			Jail
	SR 574 East	13506		2	2			

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
ESA	SR 574 East	13507		1				
	SR 574 East	13509	29760-42260	4	4			Nursing Home
	SR 574 East	13509	30360-42637	4	4			Grocery Store
	SR 574 East	13509	30068-42840	4	4			
	SR 574 East	13509	30012-42851	4	4			Hills Co Lift Station
	SR 60 North	13951		1				
	SR 60 North	13952	28905-41400	4	4			
	SR 60 North	13952		2	2			
	SR 60 North	13952	28230-41939	2	2			Lift Station
	SR 60 North	13952	28655-40199	4	4			Lift Station
SR 60 North	13955	28599-41025	4	4			Home Improvement Center	
SR 60 South	13953	29005-41261	3	3			WATER DEPT WAE06091	
SR 60 South	13953	29031-41541	4	4			Sheriff	
SR 60 South	13953	28934-41864	4	4			Jail	
SR 60 South	13953		4	4				
SR 60 South	13953	29155-41530	4	4			Pumping Station	
SR 60 South	13954	28710-41229	4	4			Lift Station	
SR 60 South	13954	28474-41342	4	4				
SR 60 South	13954	28559-41114	5	5			TEC Critical Site	
SR 60 South	13954		3	3				
SR 60 South	13956	29155-41131	4	4			Fire Station	
SR 60 South	13956	28775-40419	3	3			Home Improvement Center	
ESA	TWELFTH AVENUE	13433		1				
	TWELFTH AVENUE	13433		1				
	TWELFTH AVENUE	13434	27870-41362	4	4			
	TWELFTH AVENUE	13434	27780-41116	4	4			
	TWELFTH AVENUE	13434	27986-41160	4	4			Sheriff
	TWELFTH AVENUE	13434	27955-41179	4	4			Grocery Store
	TWELFTH AVENUE	13434	28142-41308	1				
	TWELFTH AVENUE	13435	28182-40743	4	4			
	TWELFTH AVENUE	13435	26225-40702	4	4			
	TWELFTH AVENUE	13435		1				
	TWELFTH AVENUE	13435		1				
	TWELFTH AVENUE	13436	27383-40887	4	4			Lift Station
	TWELFTH AVENUE	13436	27417-41155	4	4			
	TWELFTH AVENUE	13436		4	4			

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
ESA	TWELFTH AVENUE	13436	27071-40746	4				Cell Site - 50KW gen
	TWELFTH AVENUE	13436	27106-40880	2	2			
ESA	WOODBERRY	14207	28871-41724	3	3			
	WOODBERRY	14208	28830-41847	3	3			
	WOODBERRY	14208	28809-41856	3	3			
	WOODBERRY	14209	28881-41891	3	3			
	WOODBERRY	14209	28871-41891	3	3			

Operations Engineers' Circuit Priority Listing for Storm Restoration and Undertrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
PCSA	ALEXANDER RD West	13119		4	4				
	ALEXANDER RD West	13120	35874-42944	5	3				
	ALEXANDER RD West	13120	35586-43115	4	4			Red Cross Shelter	
	ALEXANDER RD West	13120	35054-42787	4	4				
	ALEXANDER RD West	13120		4	4				
	ALEXANDER RD West	13120		4	4				
	ALEXANDER RD West	13120	36024-42770					1	
	ALEXANDER RD West	13463		4	4				
	ALEXANDER RD West	13463	34828-43482	4	4				
	ALEXANDER RD West	13463		3	3				
	ALEXANDER RD West	13463	35216-43549	2	2				
	ALEXANDER RD West	13464	35615-43399	5	5				
	ALEXANDER RD West	13464	35944-43675					1	
	ALEXANDER RD West	13464	35950-43513	3	3				
	ALEXANDER RD West	13464	35216-43549	4	4				
	ALEXANDER RD East	13121	34971-43381	4	1				
	ALEXANDER RD East	13121	35702-43492	4	4				
	ALEXANDER RD East	13122	35690-43906	5	5				
	ALEXANDER RD East	13122		4	5				
	ALEXANDER RD East	13123	35992-43718	5	5				
	ALEXANDER RD East	13123	35946-43746	3	3				
	ALEXANDER RD East	13123	35680-43421	5					
	ALEXANDER RD East	13462	36445-43128	4	4				
	ALEXANDER RD East	13462	36031-43370					1	
	ALEXANDER RD East	13462	36137-42918					1	
	PCSA	CORONET	13980		1				
		CORONET	13982		1				
CORONET		13983		4	4				
CORONET		13983	37431-42623	5	3			Water Plant	
CORONET		13983	38026-42898	3	1			Fire Station	
CORONET		13983	38116-44020	2	2				
CORONET		13983	38039-43946					1	
CORONET		13983	37432-42238	1	1			Grocery Dist. Ctr	
CORONET		13983	37330-42141	1	1				
CORONET		13983	37864-42664	1	1				
CORONET		13983							

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Using for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
P-CSA	CORONET	13984	36270-42664	5	4			Fire Station #1.
	CORONET	13984	36533-42623	5				Police Dept. H.O.
	CORONET	13984	36616-43080		4			Grocery Dist. Ctr
	CORONET	13984	36276-42762	4				Cell Site
	CORONET	13984	38115-42970		1			Grocery Store
	CORONET	13984	36645-42906		1			Grocery Store
	FISHAWK	14119	32504-37771	5	3			Red Cross Shelter
	FISHAWK	14120	33308-38063	4	5			Red Cross Shelter
	FISHAWK	14120	32542-38413	2	2			Back-up Shelter
	FISHAWK	14120	33495-38245		1			Grocery Store
P-CSA	FISHAWK	14121	33342-38286	3	1			Master Pumping Station
	FISHAWK	14121	34330-37699	4	5			Cell Site - 100KW gen
	GALLAGHER RD	13722	31868-42927	4	1			Radio
	GALLAGHER RD	13722	32469-43691	1	1			
	GALLAGHER RD	13722	32007-42655	1	1			
	GALLAGHER RD	13722	32061-42584	1	1			
	GALLAGHER RD	13722	32136-42614	1	1			
	GALLAGHER RD	13722	32258-43605	1	1			
	GALLAGHER RD	13723	30850-43501	5	5			Red Cross Shelter
	GALLAGHER RD	13724		4	4			Fire Station
P-CSA	GALLAGHER RD	13724	33334-42127	1	1			
	GALLAGHER RD	13724	33064-41987	1	1			Cell Site - 50KW gen
	GALLAGHER RD	13724	32786-42066	4				
	GALLAGHER RD	13724	32962-42265	1	1			
	GALLAGHER RD	13724	32992-42113	1	1			
	GALLAGHER RD	13724	33162-42452	1	1			
	GALLAGHER RD	13724	32344-42418	1	1			
	HAMPTON	13655	35743-48244	1	1			
	HAMPTON	13655	35151-42745	4	4			
	HAMPTON	13655	35986-42698	3	2			
P-CSA	HAMPTON	13655	35661-41561	1	1			Grocery Store
	HAMPTON	13655	35365-42390	1	1			Home Imp. Center
	HAMPTON	13655	34416-40531	1	1			
	HAMPTON	13655	35594-42379	1	1			

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
PCSA	HAMPTON	13656	34477-41362	5	3			Red Cross Shelter	
	HAMPTON	13656	34115-40665	5	5			Red Cross Shelter	
	HAMPTON	13657	35559-42019	3	3			School	
	HAMPTON	13657	37698-42278	4	3			Back-up Shelter	
	HAMPTON	13657	37730-41830	1	1				
	HAMPTON	13657	37328-41704	1	1				
	HAMPTON	13668			4	4			
	HAMPTON	13668	34556-42326		4	4			
	HAMPTON	13668			3	2			
	HAMPTON	13668	33994-42172		1	1			
	HAMPTON	13668	34230-42470		1	1			
	PCSA	HOPEWELL	13146	35946-39814	1	1			
HOPEWELL		13146	35390-39233	1	1				
HOPEWELL		13146	36040-47098	3					
HOPEWELL		13146	34027-39318	1	1				
HOPEWELL		13146	35827-39654	1	1				
HOPEWELL		13146	36223-39144	1	1				
HOPEWELL		13146	34419-39259	1	1				
HOPEWELL		13147			1	1			
HOPEWELL		13148	36824-38865		4	4			
HOPEWELL		13148	37305-38468		4	4			
HOPEWELL		13148	36693-39105		1	1			
HOPEWELL		13148	37732-40311		1	1			
PCSA		IMPERIALAKES	13850		1	1			
		IMPERIALAKES	13853	40364-40655	3	1			Only Grocery Store in area
	IMPERIALAKES	13853	40962-40836	2	2			Grocery Store	
	IMPERIALAKES	13854		1	1				
PCSA	KIRKLAND RD	13388	33128-43357	3	3				
	KIRKLAND RD	13388	33828-43818	1	1				
	KIRKLAND RD	13388	32040-44511	3				Cell Site - 50KW gen	
	KIRKLAND RD	13389	33194-42901	3	3			School	
	KIRKLAND RD	13389	33287-42985	4	5			Radio	
	KIRKLAND RD	13389	33750-43468	1	1				
	KIRKLAND RD	13389	33473-43593	1	1				
	KIRKLAND RD	13390		3	3				
	KIRKLAND RD	13390	33906-42526	1	1				

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
PCSA	KIRKLAND RD	13390	33801-42455	1	1			
	KIRKLAND RD	13390	33689-42922	1	1			
	KIRKLAND RD	13390	34064-43022	1	1			
	KIRKLAND RD	13390	33320-44143	1	1			
	KIRKLAND RD	13390	33764-44284	1	1			
	KIRKLAND RD	13391	31952-45512	4	4			
	KIRKLAND RD	13391	32810-44739	3	3			
	KIRKLAND RD	13391	32310-44282	1	1			
	KIRKLAND RD	13391	32411-44347	1	1			
	KIRKLAND RD	13391	31884-44720	1	1			
PCSA	KNIGHTS	13805	34967-48024	5	3			Red Cross Shelter
	KNIGHTS	13805	34087-45989	1	1			
	KNIGHTS	13805	33485-45825	1	1			
	KNIGHTS	13807		4	4			Fire Station
	KNIGHTS	13807	34317-45084	5	4			Red Cross Shelter
	KNIGHTS	13807	34714-45371	3	3			
	KNIGHTS	13807	34666-45017	3	3			
	KNIGHTS	13807	34616-45233	3	3			
	KNIGHTS	13807	34989-45560	1	1			
	KNIGHTS	13807	34646-45240	1	1			
	KNIGHTS	13807	34086-45760	1	1			
	KNIGHTS	13807	34989-45560	1	1			
	KNIGHTS	13807	35564-45081	1	1			
	KNIGHTS	13808	35321-46322	1	1			
KNIGHTS	13808	35335-46748	1	1				
KNIGHTS	13808	35265-47432	3	5				
PCSA	MULBERRY West	13007		5	5			TEC Station Power
	MULBERRY West	13009		2	2			
	MULBERRY West	13009	40143-39739	3	1			Cell Site - 50KW gen
	MULBERRY West	13011		1	1			
	MULBERRY East	13008		5	5			TEC Station Power
	MULBERRY East	13008	41703-37375	4	5			TV
	MULBERRY East	13010	40678-40083	5	5			TEC Station Power
PCSA	MULBERRY East	13010	40589-39489	5	5			Fire Station
	PINECREST	13785		4	4			
PCSA	PINECREST	13785	32850-37541	5	3			Red Cross Shelter

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
PCSA	PINECREST	13785		3	3	[REDACTED]	[REDACTED]		
	PINECREST	13785	34959-37991	1	1				
	PINECREST	13785	35171-37992	1	1				
	PINECREST	13786	38889-38474	4	4				
	PINECREST	13786	36704-37128	1	1				
	PINECREST	13787	34424-39239	4	3				
	PINECREST	13787	35232-37758	3	3				
	PINECREST	13787		3	3				
	PINECREST	13787		3	3				
	PINECREST	13787		3	3				
PCSA	PLANT CITY	13124	36488-43816	5	3			Red Cross Shelter	
	PLANT CITY	13124	38030-44105	2	1				
	PLANT CITY	13125	36323-43719	3	1			School	
	PLANT CITY	13125		3	3				
	PLANT CITY	13125	36170-43904	2	2				
	PLANT CITY	13125	37887-44125	1	1				
	PLANT CITY	13412	35542-43548	4	4				
	PLANT CITY	13412	36140-43572	4	4				
	PLANT CITY	13412	36447-43310		1			Grocery Store	
	PLANT CITY	13414	38178-44066	4	4				
	PLANT CITY	13414	36072-43846	4	4			Water Plant	
	PLANT CITY	13414	35372-43817	4	4				
	PLANT CITY	13414	36070-44479	4	4				
	PLANT CITY	13414	36132-43994	3	1			School	
	PLANT CITY	13414	36016-43612	3	3				
	PCSA	POLK POWER	14050		4	4			
		POLK POWER	14051		5	5			
PCSA	SYDNEY RD	14000		4	4				
	SYDNEY RD	14001		4	4				
	SYDNEY RD	14001	34525-42437	3	3			School	
	SYDNEY RD	14002		1	1				
	SYDNEY RD	14004		1	1				

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
PCSA	TERRACE	13959	36072-45507	1	1	[REDACTED]	[REDACTED]	
	TERRACE	13959	36399-44913	1	1			
	TERRACE	13959	35994-45303	1	1			
	TERRACE	13959	36808-46511	1	1			
	TERRACE	13959	35597-44980	1	1			
	TERRACE	13961	36393-44720	1	1			
	TERRACE	13961	36385-44757	1	1			
	TERRACE	13962	36224-44537	4	4			
	TERRACE	13962	36919-44361	4	4			
	TERRACE	13962		3	3			
	TERRACE	13962	37065-44516	1	1			
	TERRACE	13962	35926-44753	1	1			
	TERRACE	13241	35690-43806	5	4			
	PCSA	WILSON	13241	35298-43872	4			4
WILSON		13241	34828-44144	4	4			Nursing Home
WILSON		13241	35131-43782	4	4			
WILSON		13241	35155-43921	4	4			
WILSON		13241	35410-43873	3	3			School
WILSON		13241	35223-43898	5	5			Red Cross Shelter
WILSON		13241	35918-44458	3	2			
WILSON		13241	34660-44199	4				Cell Site - 45KW gen
WILSON		13241	34623-44184	3	5			
WILSON		13241	35226-43790	5				TEC Incident Base
WILSON		13242	33873-44536	1	1			
WILSON		13242	33977-44713	1	1			
WILSON		13242	35135-44118					Grocery Store
WILSON		13242	35140-44318	1	1			
WILSON		13243		4	4			
WILSON		13243	35484-44038	4	4			
WILSON		13243	35940-44160	4	4			
WILSON		13243	35506-44038	4	4			
WILSON		13243	358124-4269	5	3			Red Cross Shelter
WILSON		13243		3	3			Fire Station
WILSON	13243	35918-44458	3	3				

47

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
SHSA	CALOOSA	13233	29336-34383	3	3	[REDACTED]	[REDACTED]	
	CALOOSA	13235	28044-33810	5	3			Red Cross Shelter
	CALOOSA	13235	28075-33871	3	3			School
	CALOOSA	13235		4	4			
	CALOOSA	13236	34752-35296	4	4			Sheriff
	CALOOSA	13236	35391-33814	4	4			Sheriff
	CALOOSA	13236	34482-34562	4				Cell Site - 50KW gen
	CALOOSA	13236	31073-35128	4				Cell Site
	CALOOSA	13236		2				
	CALOOSA	13236	35274-33563	4	4			Environmental
	CALOOSA	13236	29670-35083	4	3			
	CALOOSA	13236	30790-34508	2				
	CALOOSA	13236	32801-34074	2				
	CALOOSA	13236	30862-34214	2				
	CALOOSA	13236	30983-34313	2				
	CALOOSA	13236	32030-34844	2				
	CALOOSA	13236	30841-34508	2				
	CALOOSA	13236	32733-33974	2				
	CALOOSA	13236	32640-33938	2				
	CALOOSA	13237		1				
CALOOSA	13238		1					
SHSA	DEL WEBB	13438	27074-32281	2		[REDACTED]	[REDACTED]	
	DEL WEBB	13438	27296-32030	2				
	DEL WEBB	13438	27223-32180	2				
	DEL WEBB	13438	27834-32956	3				Home Imp Center
	DEL WEBB	13439	28164-32857	5	5			Southbay Hospital
	DEL WEBB	13439	28164-32857	5	5			Hospital
	DEL WEBB	13439	28121-33091	4				Hospice Facility
	DEL WEBB	13439	28516-32896		5			Grocery Store
	DEL WEBB	13439	28133-32762	4	4			
	DEL WEBB	13439	28099-32881	4				Nursing Home
	DEL WEBB	13439	28226-33145	4	4			Hills Co Lift Station
	DEL WEBB	13439	28530-32848	4				
	DEL WEBB	13440	27661-33236	5	5			Nursing Home
	DEL WEBB	13440	28103-33126	5	5			Nursing Home
	DEL WEBB	13440	28020-32912		5			Grocery Store

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
SHSA	DEL WEBB	13440	28133-33261	4	4			
	DEL WEBB	13440	27687-33307	4	4			Hills Co Lift Station
	DEL WEBB	13440	27960-32917	4				Nursing Home
	DEL WEBB	13440	28005-33022	4	4			Nursing Home
	DEL WEBB	13440	28031-32903	4				Dialysis Center
	DEL WEBB	13440	27871-32985	4				Hospice Corp Office
	DEL WEBB	13441		1				
	DEL WEBB	13488		1				
	DEL WEBB	13489	28268-32606	4	4			Hills Co Lift Station
	DEL WEBB	13489		4	4			
	DEL WEBB	13489	28529-32830	3	3			
	DEL WEBB	13494	28485-32724	4	4			Nursing Home
	DEL WEBB	13494	28761-32799	4	3			Fire Station
	DEL WEBB	13494	28535-32738	4				Grocery Store
	DEL WEBB	13494	28640-32783	4	3			Fire Station
SHSA	DESAL	14200		5	5			
	DESAL	14201		5	5			
SHSA	EAST BAY	13340		5	5			Power Plant
	EAST BAY	13340		5	5			Power Plant
	EAST BAY	13340	27127-36000	4	4			Power Plant
	EAST BAY	13340	27572-35451	4				DESAL Plant
	EAST BAY	13340	27889-35801	2				Cell Site
	EAST BAY	13340	27705-35542	2				
	EAST BAY	13340	27735-35616	2				
	EAST BAY	13341	28230-35761	3	4			School
	EAST BAY	13341	29385-35706	4	4			
	EAST BAY	13341	29385-35706	5				
	EAST BAY	13341	28607-35856	4	4			Sheriff
	EAST BAY	13341	28395-35718	4	4			
	EAST BAY	13341	29554-36036	3				School
	EAST BAY	13341	29470-36049	2				Fish Farm
	EAST BAY	13342	28099-35828	5				Red Cross Shelter
	EAST BAY	13342	27738-36979	2				Fish Farm
	EAST BAY	13342	27717-37208	4				Cell Site - 50KW gen
	EAST BAY	13342	28200-35780	4				Back-up Shelter

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
SHSA	EAST BAY	13343	28020-35308	3				School	
	EAST BAY	13344		1					
SHSA	FIRST STREET	13896	25629-33131	4	4			Sheriff	
	FIRST STREET	13896	25688-33558	2				Fish Farm	
	FIRST STREET	13896	25806-33502	3				Fish Farm	
	FIRST STREET	13896		2					
	FIRST STREET	13896	24685-33415	4				Hills Co Lift Station	
	FIRST STREET	13896	25858-33348	1	1				
	FIRST STREET	13896	25878-33074	4				Hills Co Lift Station	
	FIRST STREET	13896	25815-33360	1	1				
	FIRST STREET	13898		1					
	FIRST STREET	13899	25977-33013	3	3				
	FIRST STREET	13899	26026-33354					Grocery Store	
	FIRST STREET	13900	26265-33378	2				Fish Farm	
	FIRST STREET	13900	26254-33284	2	3				
	FIRST STREET	13900	26115-33591					Grocery Store	
	SHSA	GIBSONTON	13017	27999-37222	2				
		GIBSONTON	13017	27936-37421	2				Fish Farm
GIBSONTON		13017	27950-37316	2				Fish Farm	
GIBSONTON		13017	27968-37420	2					
GIBSONTON		13017	28435-37280	3	3	Fish Farm			
GIBSONTON		13019	28450-37807	5	5	Fire Station			
GIBSONTON		13019	27936-37792	3	3				
GIBSONTON		13020	27717-37492	4	4	Sheriff			
GIBSONTON		13020	27626-38058	3	3	Environmental			
GIBSONTON		13020							
SHSA	GULF CITY	13254	24166-31176	1	1				
	GULF CITY	13258	24410-31679	3		Cell Site			
SHSA	MILLER MAC	13777	27071-34838	4		Hills Co Lift Station			
	MILLER MAC	13780	26737-34757	5	5	Fire & Rescue			
	MILLER MAC	13780	26785-34703	4	4				
	MILLER MAC	13780	26835-35083	4	4				
	MILLER MAC	13780	26474-34946	4	4				
	MILLER MAC	13780	26819-34748	4	4	Hills Co Lift Station			
	MILLER MAC	13781	27164-35009	4	4	Hills Co Lift Station			
	MILLER MAC	13781	27314-35057			Grocery Store			
	MILLER MAC	13781	27220-34846			Grocery Store			

50

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
SHSA	RHODINE ROAD	13645	29328-36758	4	4			
	RHODINE ROAD	13645	28744-36862	2				Fish Farm
	RHODINE ROAD	13645	30074-36934	2				Fish Farm
	RHODINE ROAD	13645	28945-37654	2				Fish Farm
	RHODINE ROAD	13645	29280-37312	2				Fish Farm
	RHODINE ROAD	13645	30074-36995	2				Fish Farm
	RHODINE ROAD	13645	30171-36703	2				Fish Farm
	RHODINE ROAD	13645	29176-37015	2				Fish Farm
	RHODINE ROAD	13645	28926-37546	2				Fish Farm
	RHODINE ROAD	13646	29774-36412	5				Red Cross Shelter
	RHODINE ROAD	13648	31226-36560	5	4			TV
	RHODINE ROAD	13648	32218-36675	5	4			TV
	RHODINE ROAD	13648	32218-36675	5	4			
	RHODINE ROAD	13648	32218-36675	5	4			
	RHODINE ROAD	13648	31387-37083	5	4			TV
	RHODINE ROAD	13648	31388-37095	5	4			TV
	RHODINE ROAD	13648	31567-36708	4				Cell Site
	RHODINE ROAD	13649	29890-37689	5	3			Spec Needs Shelter
	RHODINE ROAD	13649	29535-38284	4	3			Fire Station
	RHODINE ROAD	13650	29860-37240	5				Red Cross Shelter
	RHODINE ROAD	13651	29793-35999	3				
	RHODINE ROAD	13651	30648-36099	3	3			School
	RHODINE ROAD	13652	31192-35742	2				
SHSA	RIVERVIEW	14020	29961-37883	5	3			Spec Needs Shelter
	RIVERVIEW	14020	29726-37854	4	4			Lift Station
	RIVERVIEW	14020	29299-37652	2				Fish Farm
	RIVERVIEW	14020	29498-38127					Grocery Store
	RIVERVIEW	14020	29443-37880	4				Cell Site
	RIVERVIEW	14020	30167-37887					Grocery Store
	RIVERVIEW	14020	29499-38045	2				Grocery Store
	RIVERVIEW	14021		5	5			TEC Station Power
	RIVERVIEW	14022	31088-37888	4	4			Waste Water
	RIVERVIEW	14022	30898-37726	5				Red Cross Shelter
	RIVERVIEW	14022	30871-37824	4				
	RIVERVIEW	14023	30401-37624	4	3			Back-up Shelter
	RIVERVIEW	14023						

51

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
SHSA	RUSKIN	13001	26181-32732	4	4			
	RUSKIN	13001	26530-32680	2				
	RUSKIN	13001	26540-32706	2				
	RUSKIN	13001	26013-32772	4				Hills Co Lift Station
	RUSKIN	13002		5	5			TEC Station Power
	RUSKIN	13002	25991-33085	4	4			Emergency Med Station
	RUSKIN	13002	26580-33249	4				Cell Site - 50KW gen
	RUSKIN	13002	25991-33085	4	4			Fire & Sheriff
	RUSKIN	13002	26084-33253	2	2			
	RUSKIN	13002	26152-33273	2	2			
	RUSKIN	13002	26130-33253	2	2			
	RUSKIN	13002	26152-33284	2	2			
	RUSKIN	13002	26154-33319	2	2			
	RUSKIN	13002	26093-33252	2	2			
	RUSKIN	13002	26170-33250	2	2			
	RUSKIN	13002	26897-33161	5				Red Cross Shelter
	RUSKIN	13003	27485-33033	5	5			TEC Operations Ctr
	RUSKIN	13003	27182-31562	2	3			
	RUSKIN	13003	27560-33045	4	4			Waste Water
	RUSKIN	13003		4	3			Fire Dept
	RUSKIN	13003	27364-32912	4	3			Sheriff
	RUSKIN	13003	26911-31390	2				
	RUSKIN	13003	26970-31422	2				
	RUSKIN	13003	26976-32562	2				
	RUSKIN	13003	27060-31502	2				
	RUSKIN	13003	27150-31499	2				
	RUSKIN	13003	32321-33089	2				Fish Farm
	RUSKIN	13003	27393-31498	2				Fish Farm
	RUSKIN	13003	27316-31901	2				Fish Farm
	RUSKIN	13003	27421-31599	2				Fish Farm
	RUSKIN	13003	27197-31732	2				Fish Farm
	RUSKIN	13003	27315-31562	2				Fish Farm
	RUSKIN	13003	27284-31901	2				
	RUSKIN	13003	27284-31732	2				
	RUSKIN	13003	27283-31354	2				Fish Farm
	RUSKIN	13003	27278-31498	2				

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason			
SHSA	RUSKIN	13003	27249-31698	2		[REDACTED]	[REDACTED]	Fish Farm			
	RUSKIN	13003	27246-31355	2				Fish Farm			
	RUSKIN	13003	27232-31498	2				Fish Farm			
	RUSKIN	13003	27212-31301	2				Fish Farm			
	RUSKIN	13003	27384-31566	2				Fish Farm			
	RUSKIN	13003	32422-30725	2				Fish Farm			
	RUSKIN	13817	26144-32452	3	3						
	RUSKIN	13817	26098-32452	3	3						
	RUSKIN	13817	26111-32381	3	3						
	RUSKIN	13817	26189-32184	3	3						
	RUSKIN	13817	26330-32223	3	3						
	RUSKIN	13817	26006-32247	3	3						
	SHSA	SUN CITY	13302	29128-32902	4						Grocery Store
		SUN CITY	13303	30229-32716	3			4			School
SUN CITY		13303	30227-32716	3	3			School			
SUN CITY		13303	30212-32703	3	3			School			
SUN CITY		13303	30212-32726	3	3			School			
SUN CITY		13303		4	5			Airport			
SUN CITY		13303		4	4						
SUN CITY		13303	30129-32611	4	4			Sheriff			
SUN CITY		13303	29818-33041	4	4			Sheriff			
SUN CITY		13303	29680-32858	4	4			Hills Co Lift Station			
SUN CITY		13303		4	4						
SUN CITY		13303	32347-33310	3	3			Fish Farm			
SUN CITY		13303	32279-33277	3	3			Fish Farm			
SUN CITY		13303	32355-30748	3	3			Fish Farm			
SUN CITY		13303	32204-31514	3	3			Fish Farm			
SUN CITY		13303	32267-32575	3	3			Fish Farm			
SUN CITY		13303	32018-31988	3	3						
SUN CITY		13303	30238-33056	4	4			Hills Co Lift Station			
SUN CITY		13303	32043-32180	3	3						
SUN CITY		13303	32321-33099	2	2						
SUN CITY		13303	28569-33215	4	4						
SUN CITY		13303	30124-32606	5	4			Sheriff			
SUN CITY		13304			4	4					
SUN CITY	13304										

53

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
SHSA	SUN CITY	13305	29521-31705	3	3			Fish Farm
	SUN CITY	13305	29463-31749	3	3			Fish Farm
	SUN CITY	13305	29682-31782	3	3			Fish Farm
	SUN CITY	13305	29794-32010	3	3			Fish Farm
	SUN CITY	13305	29388-31846	3	3			Fish Farm
	SUN CITY	13305	28962-31966	3	3			Fish Farm
	SUN CITY	13305	29417-31876	3	3			
	SUN CITY	13305	29184-31546	3	3			
	SUN CITY	13305	29325-32014	3	3			
	SUN CITY	13305	29680-31884	3	3			
	SUN CITY	13305	29130-31612	3	3			
	SUN CITY	13305	29554-31749	3	3			
	SUN CITY	13305	29488-31796	3	3			
	SUN CITY	14144	28569-33215	4	4			
	SUN CITY	14144	29118-32952	4				Cell Site
	SUN CITY	14144	32822-30936	1	1			
	SUN CITY	14144		4	4			
	SUN CITY	14144	28928-33195	4	4			
	SUN CITY	14144	28538-33229	4	4			
	SUN CITY	14145		1				

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	BAYCOURT	13080	23740-39485		2			Grocery Store
	BAYCOURT	13081	24138-40274	5	4			COT Pump
	BAYCOURT		24089-40116	4				Nursing Home
	BAYCOURT		24119-40060	4	4			Nursing Home
WSA	BAYCOURT	13082		1				
	BOYSCOUT	13761	23282-41853	5	3			Fire Station
	BOYSCOUT		23085-41921	3	2			Mall
	BOYSCOUT			3	2			
	BOYSCOUT	13762	23282-41853	5	3			Fire Station
	BOYSCOUT	13764	23112-41836	2	2			
	BOYSCOUT		23199-41632	3				School
	BOYSCOUT		23238-41733	3				School
	BOYSCOUT		23120-41600	3				FS Property
	BOYSCOUT		23240-41726	3				School
WSA	CARROLLWD VIL East	13535	22997-45810	5	5			Wellfield
	CARROLLWD VIL East		22997-45810	5	4			Waste Water
	CARROLLWD VIL East		22840-44966	3				Reserve Shelter
	CARROLLWD VIL East	13538	23712-45483	5	4			Pump Station
	CARROLLWD VIL East			5	4			Pump Station
	CARROLLWD VIL East		23632-45720					Grocery Store
	CARROLLWD VIL East	13539	23258-45837	4	4			Waste Water
	CARROLLWD VIL East		23464-45404	4				Hills Co Lift Station
	CARROLLWD VIL East		23032-45928	4	4			Pump Station
	CARROLLWD VIL West	13540	22591-46259					Grocery Store
	CARROLLWD VIL West	13541	23131-45928	5	5			Pump Station
	CARROLLWD VIL West			1				
	CARROLLWD VIL West		23132-45928	4	4			Pump Station
	CARROLLWD VIL West	13544		4	5			
	CARROLLWD VIL West		22547-45790	3	3			School
	CARROLLWD VIL West		22484-45601					Grocery Store
	CARROLLWD VIL West		22523-45807	5	5			Well
	CARROLLWD VIL West		23022-45813	5	5			Waste Water
	CARROLLWD VIL West			1				
	WSA	CASEY ROAD	13745	23288-45104				1
CASEY ROAD			23234-45106	4		Dialysis Center		
CASEY ROAD		13747	23759-45341	5	3	Medical		

55

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUGS THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
WSA	CASEY ROAD	13747	23726-45053	4	3	[REDACTED]	[REDACTED]		
	CASEY ROAD	13748	23730-44845	4	4				
	CASEY ROAD		23737-44755					Grocery Store	
	CASEY ROAD		23888-44782	4	4			Wellfield	
	CASEY ROAD		23856-44869	4	3				
	CASEY ROAD		23960-45030	4	4			Hills Co Lift Station	
	CASEY ROAD	13749			1				
	CASEY ROAD	13750	23010-44825	5	4			Pump Station	
	CLEARVIEW	13737	23970-41295	5	3			TV Station	
	CLEARVIEW	13738	23431-41945	3				FS Property	
WSA	CLEARVIEW			3	2				
	CLEARVIEW			4				Nursing Home	
	CLEARVIEW	13739		5	3			Jail	
	CLEARVIEW		23441-41764	5	2				
	CLEARVIEW		23085-41921	3	2				
	CLEARVIEW			3				Home Imp Center	
	CLEARVIEW		23085-41921	2	2				
	CLEARVIEW	13740	24230-41889	3	3			School	
	CLEARVIEW		24055-41744	3				School	
	CLEARVIEW		23909-41721	4	3				
	CLEARVIEW		24218-41522	3					
	WSA	COOLIDGE East	13076		3	3			Interruptable
	WSA	COOLIDGE East		22822-43416	2				Hills Co Lift Station
		COOLIDGE East		23169-43226	4				
COOLIDGE East		13077	23327-43290	5	4			Pump Station	
COOLIDGE East			23279-42665	3	4				
COOLIDGE East			23367-43272	3				School	
COOLIDGE East			23555-42834	4				Cell Site - 50KW gen	
COOLIDGE East			23364-42852	4	4			Pump Station	
COOLIDGE East			23064-42854	5	4			TIA	
COOLIDGE East			23064-42843	5	4			TIA	
COOLIDGE East		13078	23234-43754	3	2			School	
COOLIDGE East		13079	23737-43721	5	5			Hospital	
COOLIDGE East			23575-43377	1	2				
COOLIDGE East			23602-43330	1	2				
COOLIDGE East			23664-43646	2	2				

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	COOLIDGE West	13530		1	1			
	COOLIDGE West	13531	22561-43141	5	5			TIA
	COOLIDGE West		22546-43123	5	5			TIA
	COOLIDGE West		22759-42926	5	4			TIA
	COOLIDGE West		23278-43212	3	4			School
	COOLIDGE West		23064-43071	5	4			HCAA
	COOLIDGE West			3	3			
	COOLIDGE West	13532		1	2			
	COOLIDGE West	13533	23845-43355	4	4			Pump Station
	COOLIDGE West		23752-43790	5	5			Hospital
WSA	CYPRESS ST East	13447		3				
	CYPRESS ST East		23025-41537	3				FS Property
	CYPRESS ST East		23028-41627	3				FS Property
	CYPRESS ST East			2				
	CYPRESS ST East	13448		2				
	CYPRESS ST East	13449		2				
	CYPRESS ST East			2				
	CYPRESS ST East		22773-41312	3				FS Property
	CYPRESS ST East	13452		3				
	CYPRESS ST East			2				
	CYPRESS ST East			3				
	CYPRESS ST West	13446		2				
	CYPRESS ST West	13450		2				
	CYPRESS ST West	13451	22607-41419	5	3			Radio Station
	CYPRESS ST West			3				
	CYPRESS ST West			3				
	CYPRESS ST West	13453	22514-41698	5	5			TIA
	CYPRESS ST West		22250-42023	3				FS Property
CYPRESS ST West		21594-42222	3				FS Property	
CYPRESS ST West		21572-42074	3				FS Property	
WSA	DALE MABRY East	13586		1	1			
	DALE MABRY East	13587	23914-47023	4	4			Hills Co Lift Station
	DALE MABRY East		23751-47259	4	4			Nursing Home
	DALE MABRY East		23843-46999	4	3			Elec Co-op
	DALE MABRY East		23704-46967	3	4			School
	DALE MABRY East	13589	23645-48348	4	2			Hills Co Lift Station

57

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	DALE MABRY East	13589	23703-48306	3				School
	DALE MABRY West	13582	23771-47816	4	5			Water
	DALE MABRY West		23771-47855	4	5			Water
	DALE MABRY West		23782-47810	5	5			Well Pump
	DALE MABRY West		23774-47855	4	5			Pump Station
	DALE MABRY West		23786-47414	4				Cell Site - 50KW gen
	DALE MABRY West		23785-48007	4				Grocery Store
	DALE MABRY West	13583	22731-48010	4	3			Water
	DALE MABRY West	13584	23339-47013	4	4			Lift Station
	DALE MABRY West	13585		2				
	DALE MABRY West		23726-46740	4	4			Grocery Store
	DALE MABRY West	13189		4	4			Pump Station
	DOUBLE BRNCH North		18956-44735	5	4			Pump Station
	DOUBLE BRNCH North		18953-44911	2				Radio
	DOUBLE BRNCH North		18943-44759	4				
DOUBLE BRNCH North			2				Cell Site	
DOUBLE BRNCH North	13192	19276-45655	4	4			Interruption	
DOUBLE BRNCH North		19280-45376	4				Waste Water	
DOUBLE BRNCH North		18085-45098	2	2			Cell Site	
DOUBLE BRNCH North		19347-45362	2	2				
DOUBLE BRNCH North			4	4			Lift Station	
DOUBLE BRNCH North	13194		1	1				
DOUBLE BRNCH North	13190		4	4				
DOUBLE BRNCH South							Sewage Plant	
DOUBLE BRNCH South		18158-44606					Grocery Store	
DOUBLE BRNCH South	13191	18289-44727	3	1			Grocery Store	
DOUBLE BRNCH South			1	1			Cell Site - 40KW gen	
DOUBLE BRNCH South	13196		1	1				
DOUBLE BRNCH South	13891		23102-46398	4	4		Hills Co Lift Station	
EHFRICH ROAD East			23131-46869	3	3		School	
EHFRICH ROAD East			23339-47013	4			Hills Co Lift Station	
EHFRICH ROAD East	13892		23734-46935	3	4		School	
EHFRICH ROAD East				2				
EHFRICH ROAD East			23860-46887	3			Home Imp Center	
EHFRICH ROAD East	13895			4	3		Pump Station	
EHFRICH ROAD East			23811-46144	4			Cell Site	

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	EHRlich ROAD West	13886		4	3			Pump Station
	EHRlich ROAD West	13888	22891-46728	4	4			Hills Co Lift Station
	EHRlich ROAD West		23042-46455	4	4			Hills Co Lift Station
	EHRlich ROAD West		22500-46485	4				Nursing Home
	EHRlich ROAD West	13889	22730-46303	3	4			School
	EHRlich ROAD West		22473-46365					Grocery Store
	EHRlich ROAD West	13890	23302-46461	4				Nursing Home
	EHRlich ROAD West		23356-46759	4	4			Hills Co Lift Station
	EHRlich ROAD West		23315-46463	4				Hills Co Lift Station
WSA	EL PRADO	13610	23718-39793	3				Home Imp Center
	EL PRADO	13611		3				
	EL PRADO	13612	23195-39872	3				School
	EL PRADO		22995-40020	3				Cell Site
	EL PRADO	13613	23515-39678	3				School
	EL PRADO		23531-39540	2				
	EL PRADO		23550-39550	2				
WSA	GEORGE RD North	13513	22414-42850	5	5			TIA
	GEORGE RD North			4				Diagnosis Center
	GEORGE RD North	13514	22440-42600	5	5			TIA
	GEORGE RD North		22145-42682	4				Hills Co Lift Station
	GEORGE RD North	13516		2				
	GEORGE RD North		22248-43683	3				Cell Site - 50KW gen
	GEORGE RD North		22288-43310	4	3			Hills Co Lift Station
	GEORGE RD South	13510	21870-43388	3	4			School
	GEORGE RD South	13511	21853-42794	4	4			Hills Co Lift Station
	GEORGE RD South		22056-42766	4	4			Hills Co Lift Station
	GEORGE RD South	13512	21710-42873	3	4			School
	GEORGE RD South		21685-42735	5	4			Pump Station
	GEORGE RD South		21673-42736	5	4			TIA Facility
	GEORGE RD South		21408-42767	4	3			Hills Co Lift Station
	GEORGE RD South	13517		2	2			
	GEORGE RD South		21878-43341	3				School
WSA	GRANADA	13753	23772-39902					Grocery Store
	GRANADA		23896-40258	3				School
	GRANADA	13754		1	1			
	GRANADA	13756		4				

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason	
WSA	GRAY ST North	13196		1	1				
	GRAY ST North	13199		4	1			Nursing Home	
	GRAY ST North	13200	23247-41527	3				FS Property	
	GRAY ST North	13201		1	1				
	GRAY ST South	13012	23032-41222	3				FS Property	
	GRAY ST South		23032-41222	3				FS Property	
	GRAY ST South	13013	23098-41453	3				FS Property	
	GRAY ST South		23173-41539	3				FS Property	
	GRAY ST South	13014		1	1				
	GRAY ST South	13016	23017-41356	4	4			Pump Station	
	GRAY ST South	13016		2					
	WSA	HABANA North	13136	24463-42895	5	4			Kindred Hospital
HABANA North			24494-43075	3				School	
HABANA North		13137	24191-42651	5	5			Hospital	
HABANA North			24121-42675	5	5			Hospital	
HABANA North		13217	23858-42658	3	4				
HABANA North		13219	24696-43406	4	4			Pump Station	
HABANA North			24400-43440	3				School	
HABANA North			24393-43193					Grocery Store	
HABANA North		13138		5	3			Fire Station	
HABANA South		13139	24463-42895	5	5			Kindred Hospital	
HABANA South			24398-42999	4	4			Medical	
HABANA South				4				Dialysis Center	
HABANA South			24169-42749	4	4			Nursing Home	
HABANA South			24251-43090					Grocery Store	
HABANA South		13218		1	1				
HABANA South		13220	24939-43043	4				Nursing Home	
WSA		HENDERSON	13870	22261-44821	5	4			Fire Station
		HENDERSON	13871	22478-45355	3	3			Water
	HENDERSON		22432-45470		2			Grocery Store	
	HENDERSON			3	2				
	HENDERSON		22656-45488	4				Nursing Home	
	HENDERSON	13872	22180-46106	4	3			Hills Co Lift Station	
	HENDERSON	13873	21598-46019	5	4			Fire Station	
	HENDERSON		21987-45700	4	4			Pump Station	
	HENDERSON		22178-45523					Grocery Store	

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason			
WSA	HIMES East	13059	23687-38493	4	4			Pump Station			
	HIMES East		23321-38755	3				School			
	HIMES East	13062		1	1						
	HIMES East	13064	24294-39418	4				Nursing Home			
	HIMES East		24244-39240	3				School			
	HIMES East	13065		1	1						
	HIMES West	13060	23766-39383	5	3			Fire Station			
	HIMES West		23977-39439	4				Nursing Home			
	HIMES West		23803-39376	4				Nursing Home			
	HIMES West		23583-39247	3				Home Imp Center			
	HIMES West	13061	23728-39033	3				School			
	HIMES West	13063	22959-38027	3				School			
	WSA	HYDE PARK North	13140	24807-41303							Grocery Store
		HYDE PARK North	13141	24832-41030	3						School
HYDE PARK North				1							
HYDE PARK North		13142	25106-41126	3	2						
HYDE PARK North				2	2						
HYDE PARK North			25109-41176			Grocery Store					
HYDE PARK North		13143	25132-40993	5	5	Hospital					
HYDE PARK South		13358	24325-40647	4	2						
HYDE PARK South											
HYDE PARK South		13359	24894-41068	3		Grocery Store					
HYDE PARK South		13360	25153-41095	5		School					
HYDE PARK South			25266-40356	4		Hospital					
WSA	IVY STREET	13066		1	1			Pump Station			
	IVY STREET	13067	24115-42546	5	5			Hospital			
	IVY STREET		24230-42648	4	4						
	IVY STREET		24290-42413					Grocery Store			
	IVY STREET	13068		1	1						
	IVY STREET	13069	24141-42088	4				Nursing Home			
WSA	JACKSON RD East	13154	21281-42987	4	3			Pump Station			
	JACKSON RD East		21219-43072	3				Home Imp Center			
	JACKSON RD East	13155	20781-43453					Grocery Store			
	JACKSON RD East		20704-43519	4				Cell Site			
	JACKSON RD East		20458-43145	4				Hills Co Lift Station			
	JACKSON RD East		20664-43528					Grocery Store			

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	JACKSON RD East	13156	21490-43368	5	5			Hospital
	JACKSON RD East			4				School
	JACKSON RD East		21487-42889	3				Hills Co Lift Station
	JACKSON RD East		21347-43318	4	3			Pump Station
	JACKSON RD East	13157	21452-43732	5	4			School
	JACKSON RD East		21417-43828	3				Fire Station
	JACKSON RD West	13480	21130-43278	6	4			Hills Co Lift Station
	JACKSON RD West		21092-43325	4	2			Grocery Store
	JACKSON RD West		21156-43236	3				School
	JACKSON RD West	13481	21842-43780	3	3			Lift Station
	JACKSON RD West	13482	21565-43722	4	4			Nursing Home
	JACKSON RD West		21287-43328	4	4			Grocery Store
	JACKSON RD West		21663-43211	4	3			Lift Station
	JACKSON RD West	13483	21824-43567	4	4			Water
WSA	KEYSTONE East	13070	21590-47461	4	4			Red Cross Shelter
	KEYSTONE East		21463-47460	3	2			Red Cross Shelter
	KEYSTONE East	13071	21382-46312	5	2			Cell Site
	KEYSTONE East		21241-46223	5	2			Grocery Store
	KEYSTONE East		21270-46182	5	2			Waste Water
	KEYSTONE East		21700-46755	4	4			Waste Water
	KEYSTONE East		21420-46235	4	4			Water
	KEYSTONE East			1	2			Waste Water
	KEYSTONE West	13405	20730-46843	4	5			Waste Water
	KEYSTONE West	13406	29470-46008	4	4			Waste Water
	KEYSTONE West			4	4			Waste Water
	KEYSTONE West		20333-45681	4	5			Waste Water
	KEYSTONE West			1	1			
	KEYSTONE West			1	1			
WSA	LOIS AVENUE (4KV)	4050		1	1			
	LOIS AVENUE (4KV)	4051		1	1			
	LOIS AVENUE (4KV)	4052		1	1			
	LOIS AVENUE (4KV)	4054		1	1			
WSA	LOIS AVENUE East	13206	23687-40370	4	4			Nursing Home
	LOIS AVENUE East		23809-40370	4	4			Hills Co Lift Station
	LOIS AVENUE East	13207	23342-40756	4	1			School
	LOIS AVENUE East		23373-40713	4	4			School
WSA	LOIS AVENUE East	13208	23246-40507	5	5			Pump Station
	LOIS AVENUE East			5	5			

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	LOIS AVENUE East	13210		1	1			
	LOIS AVENUE West	13072	23566-40753	5	3			Fire Station
	LOIS AVENUE West		23723-40519	3	4			School
	LOIS AVENUE West		23721-40571	4	4			Cell Site
	LOIS AVENUE West	13073	23246-40507	4	4			Pump Station
	MACDILL East	13605		5	1			Military
	MACDILL West	CB 2690	22896-38280	5	5			Fire Station
	MACDILL West	13606		3	4			
	MACDILL West			3				
	MACDILL West		22878-38310	3				School
WSA	MANHATTAN East	CB 2646	22667-39371	4	4			Military
	MANHATTAN East	13109		5	5			
	MANHATTAN East			3	4			
	MANHATTAN East	13111	23250-39591	5	5			Hospital
	MANHATTAN East		23287-39496	4	4			Nursing Home
	MANHATTAN East		23084-39682	4	4			Pump Station
	MANHATTAN East		23000-39484	4	4			Grocery Store
	MANHATTAN East		23166-39433	4	2			Grocery Store
	MANHATTAN East	13112	22966-39036	4	3			Pump Station
	MANHATTAN East		23057-38810	3	3			School
WSA	MANHATTAN East			4	4			
	MANHATTAN East	13113	23096-38921	3	3			School
	MANHATTAN East		23296-39288	3	3			Cell Site - 50KW gen
	MANHATTAN East		23347-39186	3	3			Radio/TV
	MANHATTAN East		23254-39224	2	2			
	MANHATTAN West	13110	23474-39411	6	4			
	MANHATTAN West		23401-39493	3	2			Pump Station
	MANHATTAN West	13114	23108-39216	4	2			
	MANHATTAN West		22818-39179	2	2			TV
	MANHATTAN West		23970-41295	5	3			Dialysis Center
MATANZAS	MATANZAS North	13161		4	4			
	MATANZAS North			1	1			
	MATANZAS North	13164	24180-41036	5	5			Hospital
	MATANZAS North	13165	24770-41263	5	3			Fire Station
	MATANZAS North	13166	25083-41264	5	3			Nursing Home
MATANZAS North		24637-41184	5	4			Cell Site - 50KW gen	

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	MATANZAS South	13182	23584-40845	3				School
	MATANZAS South		23604-40785		2			Grocery Store
	MATANZAS South	13163		2				
	MATANZAS South			2				
	MATANZAS South	13167	24420-41348	5	4			Dialysis Center
	MATANZAS South		24120-41246	4				Red Cross
	MATANZAS South		24094-41115	4	4			Cell Site
	MATANZAS South		24120-41076	4				Nursing Home
	MATANZAS South		24152-41210	4				School
	MATANZAS South	13669	20069-44398	4	3			Pump Station
WSA	MEADOW PARK			1				
	MEADOW PARK		20268-44696	4				School
	MEADOW PARK	13670	20345-44040	5	3			Radio
	MEADOW PARK		20527-44139	3	3			School
	MEADOW PARK		20554-43854	3				School
	MEADOW PARK	13671		6	3			Pump Station
	MEADOW PARK			2				
	MEADOW PARK	13672	19454-44374	3	3			
	MEADOW PARK		20404-43402	4				Hills Co Lift Station
	MEADOW PARK		19414-44094	4				Hills Co Lift Station
WSA	PAGLEN RD North	14032	21423-45592	4	4			Pump Station
	PAGLEN RD North	14035		2				
	PAGLEN RD North	14037		1	1			
	PAGLEN RD South	14030	21500-46096	3	2			School
	PAGLEN RD South	14031	20817-45548	4	5			Potable Water
	PAGLEN RD South		20890-44977	4				School
	PAGLEN RD South			4	3			Waste Water
	PAGLEN RD South			4	4			Well
	PAGLEN RD South		21260-44986	4	4			Grocery Store
	PAGLEN RD South		21116-45478	4	4			Pump Station
WSA	PATTERSON RD East	14036		2	2			
	PATTERSON RD East	13865		2	2			
	PATTERSON RD East		21729-44662	2	2			
	PATTERSON RD East		22403-44328	3	3			Home Imp Center

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	PATTERSON RD East	13866		1				
	PATTERSON RD East	13868		1				
	PATTERSON RD West	13660	21840-44301					Grocery Store
	PATTERSON RD West		21888-44346					Grocery Store
	PATTERSON RD West		21924-44165					Grocery Store
	PATTERSON RD West		21853-44348	4				Hills Co Ltr Station
	PATTERSON RD West		22167-43877	4	1			TIA
	PATTERSON RD West	13863	22512-43301	5	5			Pump Station
	PATTERSON RD West	13864	22573-43483	2	2			FAA
	PATTERSON RD West		22553-44079	4	5			
	PATTERSON RD West		22512-43301	5	5			
	PATTERSON RD West	13867	22423-43433	2	2			Hospital
	PATTERSON RD West	13375	26162-41011	5	5			
	PATTERSON RD West	13376		3	4			
WSA	PLANT AVENUE East			3				FS Property
	PLANT AVENUE East		88888-11111	3				
	PLANT AVENUE East	13377		3	1			
	PLANT AVENUE East	13378		3				
	PLANT AVENUE East	13379	25296-40727	4				Nursing Home
	PLANT AVENUE East			3	2			
	PLANT AVENUE West	13381	26199-41210	5	5			Pump Station
	PLANT AVENUE West		25225-41215	3				
	PLANT AVENUE West	13382	26479-40083	5	4			Airport
	PLANT AVENUE West		25153-41193	5				Hospital
	PLANT AVENUE West		25475-40418	5	3			Fire Station
	PLANT AVENUE West			2	3			
	PLANT AVENUE West		25360-40710	5	4			Military
	PLANT AVENUE West	13383		3	4			
WSA	PLANT AVENUE West	13384		5	5			Radio
	PLANT AVENUE West			5	5			Radio
	PLANT AVENUE West	13385		3	4			
	ROCKY CREEK North	13572	21305-44335	4	3			Pump Station
	ROCKY CREEK North	13573	20867-44779	5	3			Station Power
	ROCKY CREEK North		21655-44588	5	5			Reserve Shelter
	ROCKY CREEK North	13574	21432-44218	4				Grocery Store
	ROCKY CREEK North	13575	21169-44273					Grocery Store

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	ROCKY CREEK South	13425	21193-44388	5	5			Waste Water
	ROCKY CREEK South			5	4			Pump Station
	ROCKY CREEK South	13426	21188-43782	4	4			Pump Station
	ROCKY CREEK South			4				
	ROCKY CREEK South	13427		1	1			
WSA	ROCKY CREEK South	13428		1	1			
	ROME AVENUE	13522		5	4			Radio Disp.
	ROME AVENUE		24566-41751	3				School
	ROME AVENUE		24576-41700	4				Cell Site
	ROME AVENUE		24248-41842	3				School
	ROME AVENUE		24670-41843	3				School
	ROME AVENUE	13523	24287-41807	5	3			Fire Station
	ROME AVENUE	13524	24850-41820	5	2			TV
	ROME AVENUE		24928-41750	3				School
	ROME AVENUE		24751-41671	3				Reserve Shelter
WSA	SILVER DOLLAR	13274		4	2			College
	SILVER DOLLAR	13275		1				
WSA	SKYWAY North	13317	22423-42417	5	5			TIA
	SKYWAY North	13318		5	5			TIA
	SKYWAY North	13319		5	5			TIA
	SKYWAY North			5	3			Pump Station
	SKYWAY North	13320		5	5			TIA
	SKYWAY South	13270	21940-42477	2	2			
	SKYWAY South	13275		5	5			TIA
	SKYWAY South			5	5			TIA
	SKYWAY South	13276		5	5			TIA
	SKYWAY South	13321		5	5			TIA
	SKYWAY South	13322	22226-42517	3	2			
	SKYWAY South			3				
	SKYWAY South	13323		1				
	WSA	STADIUM	13518	24115-42549	5	5		
STADIUM			24044-23660	5				Red Cross Shelter
STADIUM			24084-42525	5	3			Pump Station
STADIUM			24121-42675	5	5			Hospital

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	STADIUM	13518		4				Dialysis Center
	STADIUM	13519		1	2			
	STADIUM	13520		4	5			College
	STADIUM	13520	23795-41881	4				Cell Site
	STADIUM		23720-41974					Grocery Store
	STADIUM			1				
	STADIUM	13521	23862-42442	5	5			Station Power
	STADIUM		23781-42451	3	4			
	STADIUM			5	2			TV
WSA	SUNLAKE	14069	23543-48577	4	3			Hills Co Lift Station
	SUNLAKE		23082-48690	4	3			Lift Station
	SUNLAKE		23579-48636	4	3			Lift Station
	SUNLAKE		22893-48704	4	3			Lift Station
	SUNLAKE	14070	23391-48833	4	3			Lift Station
	SUNLAKE		22983-49486	4	3			Hills Co Lift Station
	SUNLAKE		23267-49307	4	3			Lift Station
	SUNLAKE		23547-49186	4	3			Lift Station
WSA	SUNLAKE	14070	23167-49093	4	3			Lift Station
	SUNLAKE	14071		1	1			
WSA	TAMPA BAY BLVD	13635	23864-42432	4	6			College
	TAMPA BAY BLVD		23732-42508	3	4			
	TAMPA BAY BLVD		23858-42657	3	3			
	TAMPA BAY BLVD	13636	23010-41983	5	5			TIA
	TAMPA BAY BLVD		23085-41921	3	2			
	TAMPA BAY BLVD		23227-42034	2	2			
	TAMPA BAY BLVD		23058-42038	3	4			
	TAMPA BAY BLVD		23033-42105	5				TIA
	TAMPA BAY BLVD		23201-42072	3				FS Property
	TAMPA BAY BLVD				4			
	TAMPA BAY BLVD	13637	23078-42706	5	4			
	TAMPA BAY BLVD		23034-42387	5	3			
	TAMPA BAY BLVD		23487-42560	5	4			Fire Station
	TAMPA BAY BLVD	13638	23646-42608	5	4			Jail
	TAMPA BAY BLVD			5	4			College
	TAMPA BAY BLVD			4	4			Jail
	TAMPA BAY BLVD		23507-42606	5	3			Jail
	TAMPA BAY BLVD	13639		1	1			
WSA	TURKEY FORD	13677	22860-48998	5				Red Cross Shelter
	TURKEY FORD			4	4			
	TURKEY FORD		22782-48486	4	4			Lift Station

REDACTED

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WSA	TURKEY FORD	13677	22545-48779	4				Hills Co Lift Station
	TURKEY FORD		22805-49183	5				Red Cross Shelter
	TURKEY FORD	13678	22389-47874	5	4			Fire Station
	TURKEY FORD		22118-47696	4				Hills Co Lift Station
	TURKEY FORD		21496-47924					Grocery Store
	TURKEY FORD	13679		5	4			Sheriff
	TURKEY FORD		22617-46413	4	4			Lift Station
	TURKEY FORD		22500-46485	4	4			Nursing Home
	TURKEY FORD		22317-47118	3				School
TURKEY FORD		21373-47494	5		Red Cross Shelter			
WSA	WATERS AVE East	13332	23683-44384	4	3			Red Cross Shelter
	WATERS AVE East		23730-44845	4	3			Pump Station
	WATERS AVE East		23574-44554	4				Lift Station
	WATERS AVE East		23784-44256		2			Cell Site - 50KW gen
	WATERS AVE East	13336	22808-44305	1				Grocery Store
	WATERS AVE East	13336	22997-44302	3				
	WATERS AVE East	13337	23568-44415	5	4			Home Imp Center
	WATERS AVE East		23932-44570	2	2			Fire Station
	WATERS AVE East		23045-44285	4	3			
	WATERS AVE East	13338	23096-43975	2	3			Lift Station
	WATERS AVE West	13333		1				
	WATERS AVE West		23620-44106					Grocery Store
	WATERS AVE West		23245-43942	5	3			Reserve Shelter
	WATERS AVE West			5	4			Radio
	WATERS AVE West	13334		1				
	WATERS AVE West	13335		2				
	WATERS AVE West		22870-44047	2				
	WATERS AVE West		23011-43883	2				
	WATERS AVE West	13338		5	5			TEC Ops Ctr
	WATERS AVE West		22691-43851	2	2			
WATERS AVE West		23258-44001	3	3	School			
WATERS AVE West		22871-43603	2	2				
WATERS AVE West			3	2	School			

69

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason			
WSA	WAYNE ROAD	13624	21331-49182	4	4			Waste Water			
	WAYNE ROAD	13624	19200-48482	4				Cell Site - 50KW gen			
	WAYNE ROAD	13621		1							
WSA	WAYNE ROAD	13622	21743-49120	3	1			Cell Site - 50KW gen			
	WESTCHASE East	14079	19955-45072	4	2			Lift Station			
	WESTCHASE East	14079	20761-45260	4				School			
	WESTCHASE East	14079	19862-45395					Grocery Store			
	WESTCHASE East	14080	19856-45230	4	4			Fire Station			
	WESTCHASE East	14080	19856-45230	4	3			Hills Co LIR Station			
	WESTCHASE East	14081	20470-46008	4	4			Sewer Plant			
	WESTCHASE East	14081	20283-45840	4	4			Waste Water			
	WESTCHASE East	14081		5				Red Cross Shelter			
	WESTCHASE East	14081	19575-45945	5	3			Red Cross Shelter			
	WESTCHASE West	14082		1	1						
	WESTCHASE West	14083		1							
	WESTCHASE West	14083	19513-45965	3	3						
	WESTCHASE West	14084		1	1			School			
	WSA	WOODLANDS East	13480		1						
		WOODLANDS East	13483		1						
		WOODLANDS East	13484		1						
WOODLANDS East		13484	17237-45497	3		Cell Site					
WOODLANDS East		13484	17493-45170			Grocery Store					
WOODLANDS East		13484	17226-45521			Grocery Store					
WOODLANDS West		13481		1							
WOODLANDS West		13482		1							
WOODLANDS West		13482	18135-44989			Grocery Store					
WOODLANDS West		13485	18379-44848	4	4	Nursing Home					
WOODLANDS West		13485	18469-44966	3	2	School					
WOODLANDS West		13486	18286-44804			Grocery Store					

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WHSA	ARIANA East	13281	46816-45199	2	2			> 500 KVA
	ARIANA East	13282	46555-45145	2	1			> 500 KVA
	ARIANA East	13282	46720-45093	3	5			Sewer w/Generator
	ARIANA East	13282	46773-44562	2	2			> 500 KVA
	ARIANA East	13283	47446-44898	3	4			Water w/Generator
	ARIANA East	13283	47378-45426	4	4			Nursing Home
	ARIANA East	13283	47638-44944	3	2			School
	ARIANA East	13283	47265-45139	3				Grocery Store
	ARIANA East	13283	47193-45308	3				Grocery Store
	ARIANA West	13278	47430-44428	3	2			School
	ARIANA West	13278	47056-44807	4	4			Medical Service Facility
	ARIANA West	13279	46552-45270	2				> 500 KVA
	ARIANA West	13279	46486-45814	4				Fuel Xfer/Loading Facility
	ARIANA West	13279	46433-45184	2	2			> 500 KVA
	ARIANA West	13279	46785-45588	5	3			Police w/Generator (EOC)
	ARIANA West	13279	46813-45485	3	2			School
	ARIANA West	13279	46250-45150	5	5			Station Power
	ARIANA West	13279	46660-45500	3	5			Water w/Generator
	ARIANA West	13280	46815-45199	2	2			> 500 KVA
	WHSA	BERKLEY RD	13695	45916-45464	3			
BERKLEY RD		13695	45962-45778	3	2			School
BERKLEY RD		13696		2				
BERKLEY RD		13697		2				
BERKLEY RD		13698	45984-46234	5	3			Communications
BERKLEY RD		13699	46631-45375	2	2			> 500 KVA
WHSA	BIRDSEYE	2421	46725-44893	2				> 500 KVA
WHSA	CUTRALE	13928	46537-45298	3				> 500 KVA
WHSA	CYPRESS GARDENS	13150	49508-43501	4	4			> 500 KVA
	CYPRESS GARDENS	13150	49800-43408	4	4			Nursing Home
	CYPRESS GARDENS	13151	50142-42786	3				Local Water
	CYPRESS GARDENS	13151	50138-42702	4	4			Grocery Store
	CYPRESS GARDENS	13151	51281-42611	3	3			Nursing Home
	CYPRESS GARDENS	13151	50132-42944	4	4			Financial Transaction Facility
	CYPRESS GARDENS	13152	50127-43075	3				Nursing Home
	CYPRESS GARDENS	13152	49865-43644	4	4			Grocery Store
	CYPRESS GARDENS	13152						Local Water
	CYPRESS GARDENS	13152						

70

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
W-HSA	CYPRESS GARDENS	13153	50144-43098	5	4			Fire Station w/Generator
	CYPRESS GARDENS	13153	50488-43272	4	4			Local Water
W-HSA	DAIRY RD	13370	47233-45838	3	2			School
	DAIRY RD	13371	46659-45680	3	3			Fire Dept w/Generator
	DAIRY RD	13371	46676-45760	5	4			Hospital (Hospice)
	DAIRY RD	13371	46851-45841	3	2			School
	DAIRY RD	13371	46665-45590	4	4			Nursing Home
	DAIRY RD	13371	46638-45919	5	2			Red Cross Shlir
	DAIRY RD	13372	46864-45590	5	3			Communications
	DAIRY RD	13372	47068-45806	2				> 500 KVA
	DAIRY RD	13372	47039-45828	2	2			> 500 KVA
	DAIRY RD	13372	47048-45763	2				> 500 KVA
	DAIRY RD	13372	47000-45845	2	2			> 500 KVA
	DAIRY RD	13373	47770-44920	3	2			School
	DAIRY RD	13373	47993-45428	3				Landing Zone
W-HSA	E. WINTER HAVEN East	13309	46604-43680	3	2			Cold Storage/Agri Facility
	E. WINTER HAVEN East	13311	49087-43985	3	2			School
	E. WINTER HAVEN East	13311	48963-44014	3	2			School
	E. WINTER HAVEN East	13311	49015-44065	4				Medical Services Facility
	E. WINTER HAVEN East	13313	48861-44304	5	5			Hospital
	E. WINTER HAVEN East	13313	48762-44163	5	3			Communications
	E. WINTER HAVEN East	13313	48718-44170	3	2			School
	E. WINTER HAVEN East	13313	48725-44125	5				Communications
	E. WINTER HAVEN East	13313	48790-44114	5				Red Cross EOC
	E. WINTER HAVEN East	13313	49027-44067	4	4			Medical Services Facility
	E. WINTER HAVEN East	13313	48814-44219	4	4			Medical Services Facility
	E. WINTER HAVEN East	13315	48685-44250	5	3			Fire Station w/Generator
	E. WINTER HAVEN East	13315	48738-43679	3				Home Imp Ctr
	E. WINTER HAVEN East	13315	48685-44250	3				EOC-City Hall Annex
	E. WINTER HAVEN West	13308	49122-43770	5	2			Red Cross Shlir
	E. WINTER HAVEN West	13308	48954-43644	4				Medical Services Facility
	E. WINTER HAVEN West	13308	48373-43438	4	4			Nursing Home
	E. WINTER HAVEN West	13310	48575-44292	4				Nursing Home
	E. WINTER HAVEN West	13310	48750-43952	4	4			Medical Services Facility
	E. WINTER HAVEN West	13312	48830-43569	5	5			Hospital
	E. WINTER HAVEN West	13312	48814-43914	4	4			Medical Services Facility

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WWSA	E. WINTER HAVEN West	13314	48792-43371	5				TEC Incidence Base
	E. WINTER HAVEN West	13314	48704-43457	3	5			Water w/Generator
WWSA	GORDONVILLE	13030	45088-43630	4	4			Landfill
	GORDONVILLE	13030	40652-47264	5	4			Wastewater Facility
	GORDONVILLE	13030	48868-41772	2	1			> 500 KVA
	GORDONVILLE	13031	47580-42302	3	2			School
WWSA	JAN PHYL North	13967	46908-43319	5	3			Master Water Pump
	JAN PHYL North	13968	47780-43867	3				Communications w/Gen
	JAN PHYL North	13968						
	JAN PHYL North	13968						
	JAN PHYL North	13968	47362-44362	3	3			County Sheriff
	JAN PHYL South	13284	47369-44438	3	2			School
	JAN PHYL South	13284	46158-43715	4	4			Local Government Facility
	JAN PHYL South	13295	47649-43908	5	4			Fire Station w/Generator
	JAN PHYL South	13296	47899-42758	3	2			School
	JAN PHYL South	13296	47620-43829	3	4			Local sewer w/Generator
	JAN PHYL South	13297	47746-43851	3				Grocery Store
WWSA	LAKE ALFRED	13115	48956-45459	3	2			School
	LAKE ALFRED	13115	48708-45383	5	3			Communications
	LAKE ALFRED	13115	48746-46824	5				EOC
	LAKE ALFRED	13115	48733-46670	3	5			Local Water w/Generator
	LAKE ALFRED	13115	48757-46653	3	5			City Fire Station w/Generator
	LAKE ALFRED	13115	48757-46653	3	3			Police w/Generator
	LAKE ALFRED	13115	49083-48822	3	5			Local Sewer w/Generator
	LAKE ALFRED	13115	48777-46674	4	4			Nursing Home
	LAKE ALFRED	13115	48077-47004	3	2			School
	LAKE ALFRED	13117	48602-46578	4	4			Nursing Home
	LAKE ALFRED	13117	48527-46455	3	2			School
	LAKE ALFRED	13118	48742-48824	3	5			City Fire Station w/Generator
	LAKE ALFRED	13118	48647-45838	2	2			> 500 KVA
WWSA	LAKE GUM	13924	48956-50248	5	3			Correctional Facility
	LAKE GUM	13924	48800-50487	5	3			Correctional Facility
	LAKE GUM	13927	48795-47161	5	2			Red Cross Shelter
	LAKE GUM	13927	48765-47197	3	2			School
	LAKE GUM	13927	48735-47074	3	2			School
	LAKE GUM	13927	49251-48939	2	2			> 500 KVA

REDACTED

TAMPA ELECTRIC COMPANY
 DOCKET NO. 080317-EI
 FIPUG'S THIRD REQUEST FOR PODS
 FILED: NOVEMBER 7, 2008

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WUSA	LAKE JULIANA	13769	46641-46512	1	3			Agriculture
	LAKE JULIANA	13770	46641-46512	3	4			Local Water w/Generator
	LAKE JULIANA	13772	48773-47384	5	5			Station Power
	LAKE JULIANA	13772	45781-46350	5	4			Communications
	LAKE JULIANA	13772	45258-47398	3	4			Local Sewer w/Generator
	LAKE JULIANA	13772		3	4			Fire Station w/Generator
	LAKE REGION	13442	48872-44258	3	2			School
	LAKE REGION	13442	49280-44533	3	2			Communications
	LAKE REGION	13443	50367-43974	5	2			School
	LAKE REGION	13444	49584-44115	3	4			Nursing Home
WUSA	LAKE RUBY	13916	50927-42957	3	2			School
	LAKE RUBY	13918	50710-42464	3	4			Water w/Generator
	LAKE RUBY	13918	50710-42464	4	4			Fire Station
	LAKE RUBY	13919	51281-42611	3	2			Financial Transaction Facility
	LAKE RUBY	13920	51319-42450	3	2			Grocery Store
	LAKE RUBY	13921	51343-43085	3	5			Local Sewer w/Generator
	LAKE RUBY	13922	50943-41571	3	4			Local Sewer w/Generator
	LAKE SILVER North	13291	48636-44656	4	4			Medical Services Facility
	LAKE SILVER North	13291	48636-44656	4	4			Nursing Home
	LAKE SILVER North	13291	48619-44802	3	2			Home Imp Ctr
WUSA	LAKE SILVER North	13291	48645-44731	3	5			Operation Center
	LAKE SILVER North	13292	48794-44511	3	5			Local Police w/Generator
	LAKE SILVER North	13292	48213-44383	3	2			School
	LAKE SILVER North	13292	49091-44592	3	3			Local Water w/Generator
	LAKE SILVER North	13292	48866-44566	4	4			Nursing Home
	LAKE SILVER North	13293	49159-44969	5	2			Red Cross Shelter
	LAKE SILVER North	13288	48072-44883	3	2			School
	LAKE SILVER South	13288	48861-44304	5	5			Hospital
	LAKE SILVER South	13289	48774-44297	4	4			Medical Services Facility
	LAKE SILVER South	13289	48731-45219	3	5			Local Sewer w/Generator
WUSA	LAKE SILVER South	13289	48663-44876	5	3			Communication Facility
	LAKE SILVER South	13289	48601-46113	4	4			Medical Services Facility
	LAKE SILVER South	13290	47960-44362	4	4			School
	LAKE SILVER South	13290		3	3			

Operations Engineers' Circuit Priority Listing for Storm Restoration and Underfrequency Events

SVC Area	Substation Name	Circuit Number	Grid	Storm Priority	UF Priority	Customer Name	Address	Reason
WWSA	LAKE WINTERSET	13659	48825-41882	3	4			Fire Station w/Generator
	LAKE WINTERSET	13660	48895-41309	4	4			Local Water
	LAKE WINTERSET	13660	49023-41574	3				School
	LAKE WINTERSET	13660	49393-41519	3	5			Local Sewer w/Generator
	LAKE WINTERSET	13661	50352-41642	5	2			Red Cross Shelter
	LAKE WINTERSET	13661	50199-41910	3	4			Local Water w/Generator
WWSA	LUCERNE PARK	13971	50167-45898	4	3			Grocery Distribution
	LUCERNE PARK	13972	49742-46824	3	4			Fire Station w/Generator
	LUCERNE PARK	13972	49647-45938	2	2			> 500 KVA
	LUCERNE PARK	13972	51104-46122	3	4			Local Water w/Generator
	LUCERNE PARK	13972	51180-46131	3	2			School
	LUCERNE PARK	13973		2				> 500 KVA
WWSA	POLK CITY	13298	45303-53916	3	3			Communications w/Generator
	POLK CITY	13299	45738-48438	3	2			School
	POLK CITY	13299	45557-48889	5	5			Station Power
	POLK CITY	13299	45780-48424	3	3			School
WWSA	SOUTH ELOISE	13470	48168-42483	5	2			Red Cross Shlr
	SOUTH ELOISE	13470	48080-42354	3	4			Local Sewer w/Generator
	SOUTH ELOISE	13470	48355-42857	5	2			Red Cross Shlr
	SOUTH ELOISE	13471	48039-43171	3	2			School
	SOUTH ELOISE	13471	48544-43465	3				School
	SOUTH ELOISE	13473	47929-42452	5	5			Police Station w/Gen (EOC)
	SOUTH ELOISE	13473	47761-42492	3	5			Fire Station w/Generator
	SOUTH ELOISE	13473	47580-42302	3	2			School
	SOUTH ELOISE	13473	47779-42500	3	5			Local Water w/Generator
	SOUTH ELOISE	13479	48670-43314	3	3			Master Lift Station w/Gen
	SOUTH ELOISE	13479	48643-42778	3	2			School
	SOUTH ELOISE	13479	48630-42840	4	2			Large Cold Storage Facility

74

**TAMPA ELECTRIC COMPANY
DOCKET NO. 080317-EI
FIPUG'S THIRD REQUEST FOR
PRODUCTION OF DOCUMENTS
DOCUMENT NO. 40
BATES STAMPED PAGES: 75 - 84
FILED: NOVEMBER 7, 2008**

- 40.** Provide all documents, memoranda or any other material that indicates that the curtailments on September 29 and 30, 2008 complied with the interruption priorities provided by the customers.
- A.** Attached are the requested documents that indicate the curtailments on September 29 and 30, 2008 complied with the interruption priorities.

Disturbance Documentation Operating Reserves

During any disturbance (whether at TEC's request or another company's) that requires Operating Reserves to be called, please provide the following information. *If there is more than 1 event in the 15 min. timeframe, please use a separate form for each event.*

Name of person filling out the documentation: MANKOWSKI
Date of Operating Reserves request: 9/29/08
Amount of Operating Reserves request: 3/4
Time of Operating Reserves request: 0632
ACE at time of Operating Reserves request: -13
Time to restore to pre-disturbance value:
(Time not to exceed 15 min.) 8

Use of DSM

Use of Interruptible Customers

Print out the ACE chart after returning the system to its pre-disturbance condition.

Provide this information to the Manager of Grid Operations.

1. Title: Disturbance Control Performance

2. Number: BAL-002-0

3. Purpose:

The purpose of the Disturbance Control Standard (DCS) is to ensure the Balancing Authority is able to utilize its Contingency Reserve to balance resources and demand and return Interconnection frequency within defined limits following a Reportable Disturbance. Because generator failures are far more common than significant losses of load and because Contingency Reserve activation does not typically apply to the loss of load, the application of DCS is limited to the loss of supply and does not apply to the loss of load.


4. Applicability:

4.1.

R4. A Balancing Authority or Reserve Sharing Group shall meet the Disturbance Recovery Criterion within the Disturbance Recovery Period for 100% of Reportable Disturbances. The Disturbance Recovery Criterion is:

R4.1. A Balancing Authority shall return its ACE to zero if its ACE just prior to the Reportable Disturbance was positive or equal to zero. For negative initial ACE values just prior to the Disturbance, the Balancing Authority shall return ACE to its pre-Disturbance value.

R4.2. The default Disturbance Recovery Period is 15 minutes after the start of a Reportable Disturbance. This period may be adjusted to better suit the needs of an Interconnection based on analysis approved by the NERC Operating Committee.

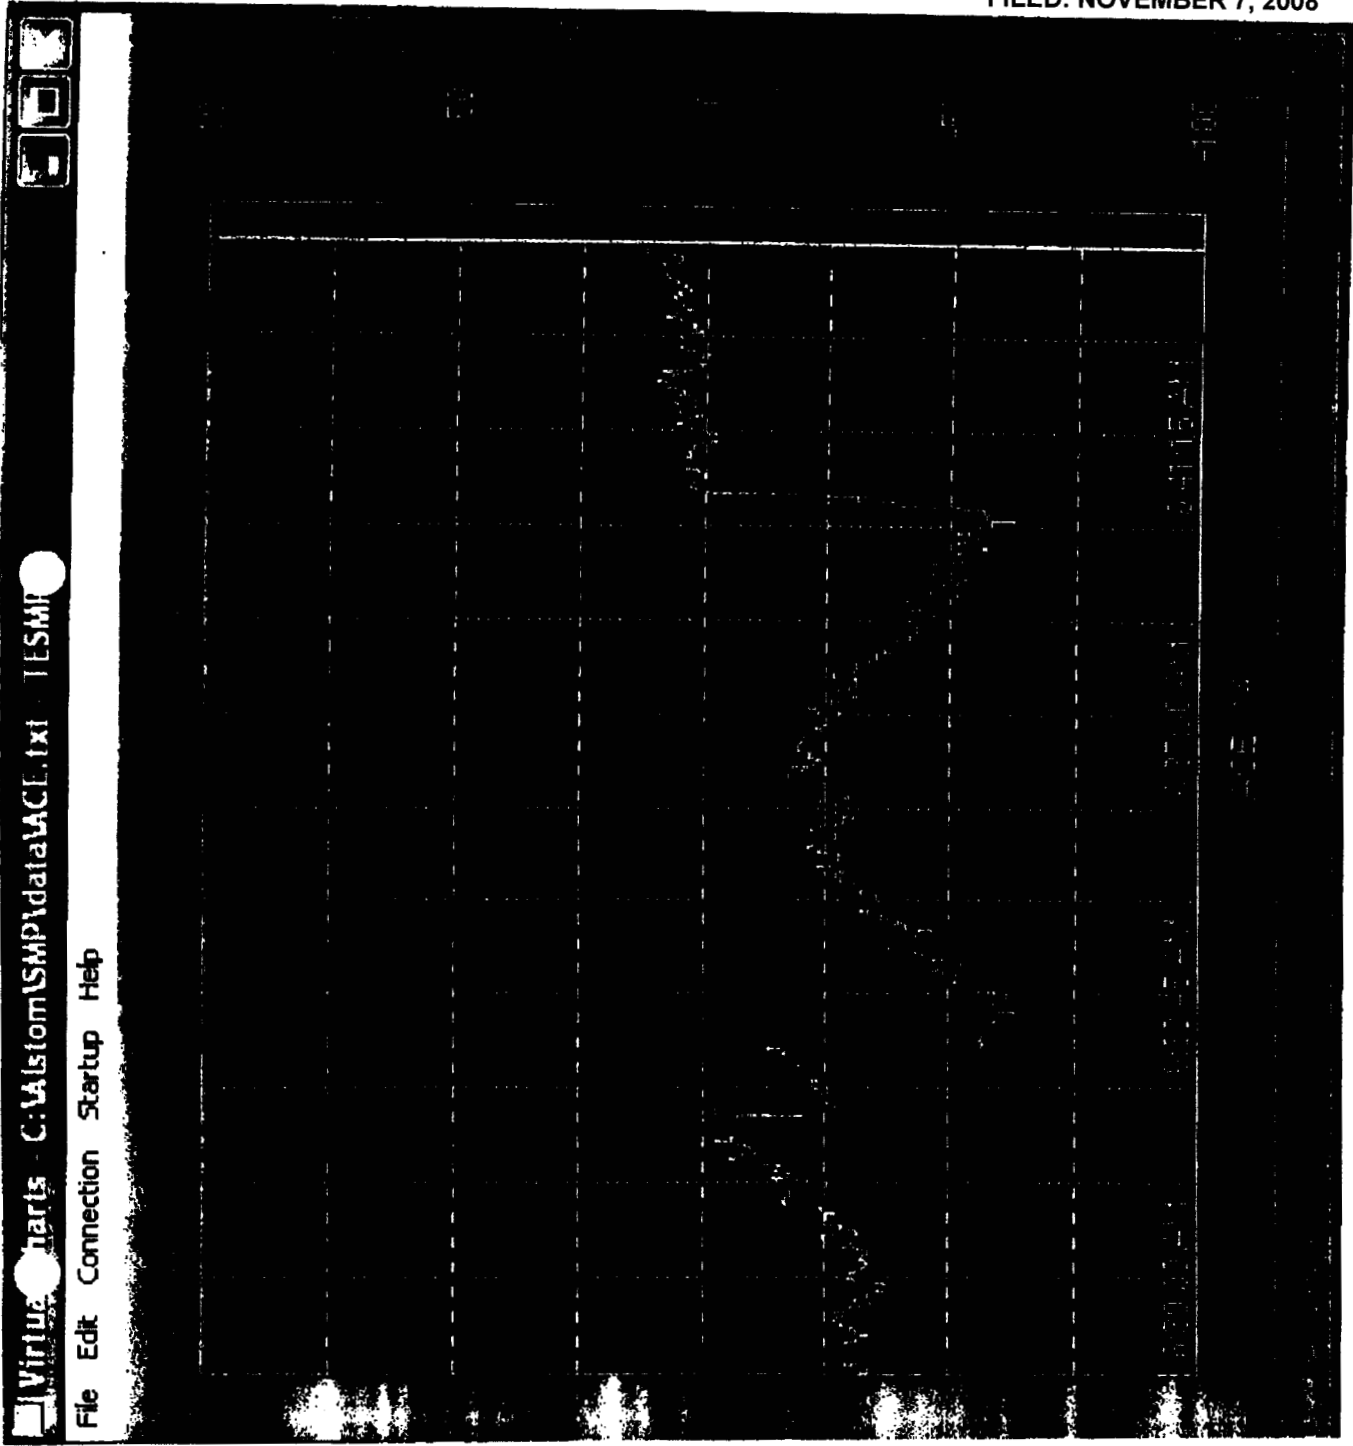

BATES STAMPED

PAGES 78 – 79

ARE REDACTED.

Disturbance Documentation Operating Reserves

During any disturbance (whether at TEC's request or another company's) that requires Operating Reserves to be called, please provide the following information. *If there is more than 1 event in the 15 min. timeframe, please use a separate form for each event.*

Name of person filling out the documentation: EHL
Date of Operating Reserves request: 09/30/2008
Amount of Operating Reserves request: 3/4
Time of Operating Reserves request: 13:31
ACE at time of Operating Reserves request: -2
Time to restore to pre-disturbance value:
(Time not to exceed 15 min.) 12 MIN

- Use of DSM
 Use of Interruptible Customers
 Print out the ACE chart after returning the system to its pre-disturbance condition.
 Provide this information to the Manager of Grid Operations.

1. Title: Disturbance Control Performance

2. Number: BAL-002-0

3. Purpose:

The purpose of the Disturbance Control Standard (DCS) is to ensure the Balancing Authority is able to utilize its Contingency Reserve to balance resources and demand and return Interconnection frequency within defined limits following a Reportable Disturbance. Because generator failures are far more common than significant losses of load and because Contingency Reserve activation does not typically apply to the loss of load, the application of DCS is limited to the loss of supply and does not apply to the loss of load.


4. Applicability:

4.1.

R4. A Balancing Authority or Reserve Sharing Group shall meet the Disturbance Recovery Criterion within the Disturbance Recovery Period for 100% of Reportable Disturbances. The Disturbance Recovery Criterion is:

R4.1. A Balancing Authority shall return its ACE to zero if its ACE just prior to the Reportable Disturbance was positive or equal to zero. For negative initial ACE values just prior to the Disturbance, the Balancing Authority shall return ACE to its pre-Disturbance value.

R4.2. The default Disturbance Recovery Period is 15 minutes after the start of a Reportable Disturbance. This period may be adjusted to better suit the needs of an Interconnection based on analysis approved by the NERC Operating Committee.

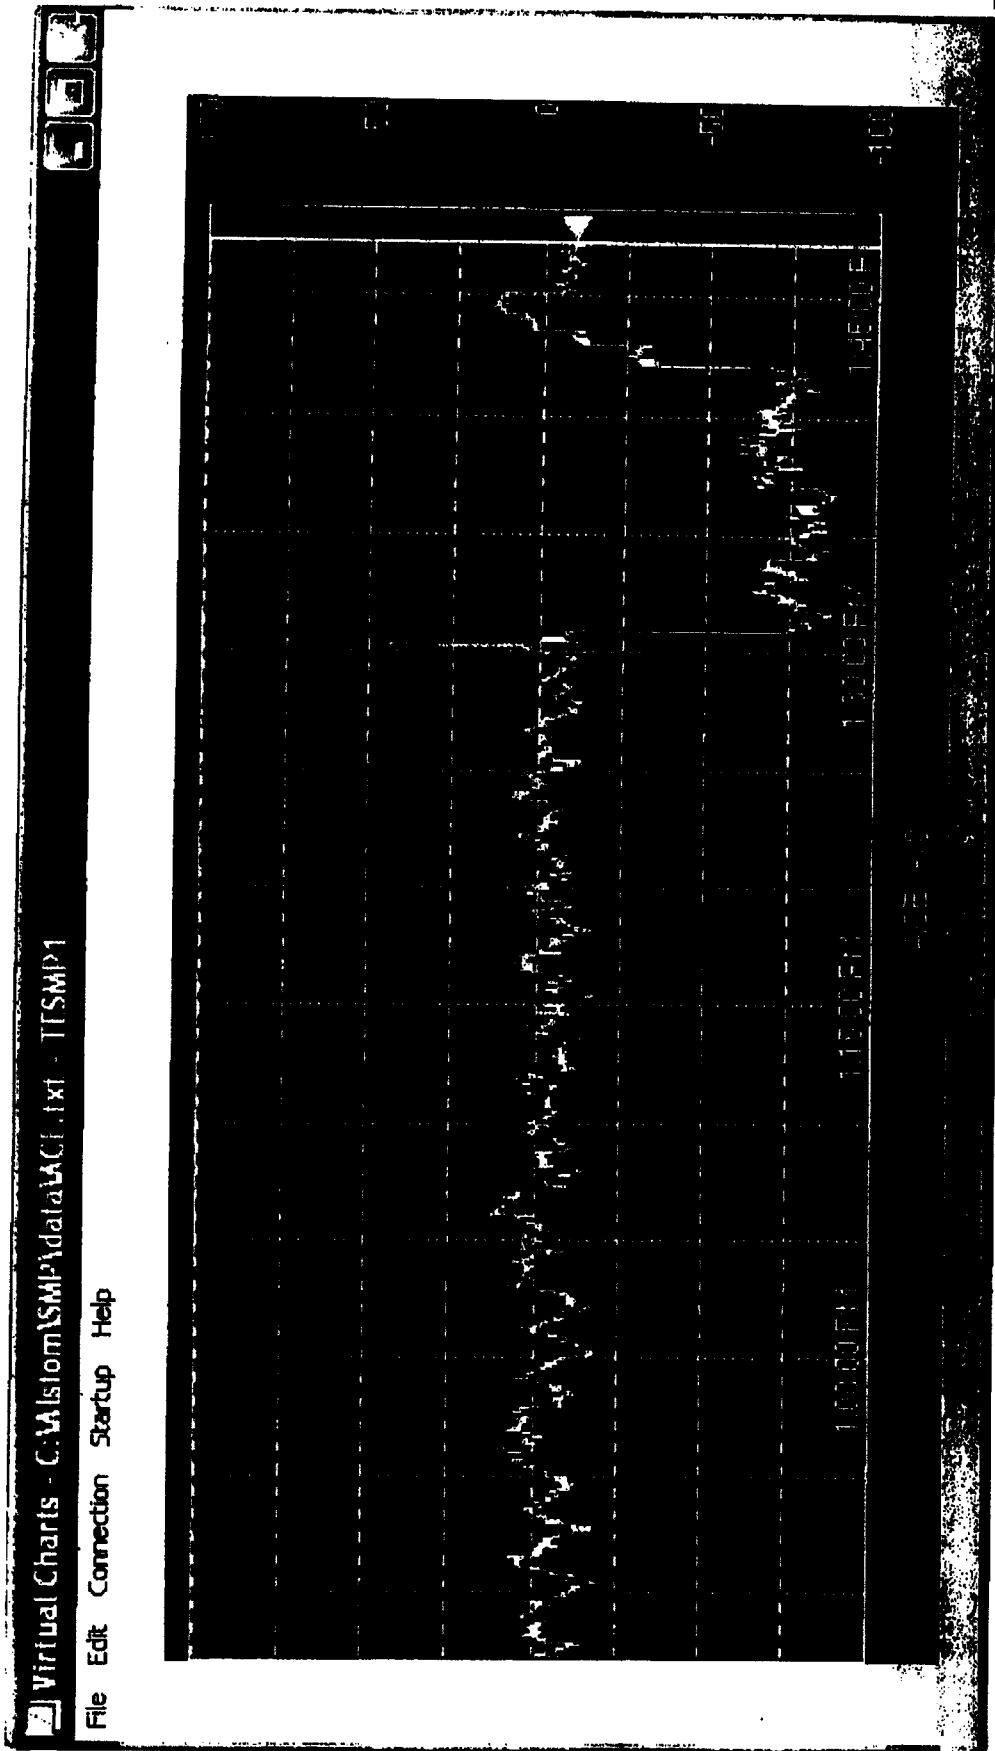

BATES STAMPED

PAGES 82 – 84

ARE REDACTED.