

Ruth Nettles

From: Trina Collins [TCollins@RSBattorneys.com]
Sent: Monday, October 05, 2009 1:04 PM
To: Filings@psc.state.fl.us
Cc: jphoy@uiwater.com; keweeks@uiwater.com; pcflynn@uiwater.com; Martin Friedman; Christian W. Marcelli; Trina Collins
Subject: Filing in Docket No. 090349-WS; Cypress Lake Utilities, Inc.'s Application for a Limited Proceeding Water and Wastewater Rate Increase in Polk County, Florida
Importance: High
Attachments: PSC Clerk 02 (2nd RAI).ltr.pdf

- a. Martin S. Friedman, Esq.
Christian W. Marcelli, Esq.
Rose, Sundstrom & Bentley, LLP
Sanlando Center
2180 W. State Road 434, Suite 2118
Longwood, FL 32779
Phone: (407) 830-6331
Fax: (407) 830-8522
Email: cmarcelli@rsbattorneys.com
- b. Docket No. 090349-WS; Cypress Lakes Utilities, Inc.'s Application for a Limited Proceeding Water and Wastewater Rate Increase in Polk County, Florida - Filing the Utility's response to the Commission Staff's second data request dated September 14, 2009, in order to complete its analysis in the above referenced docket.
- c. Cypress Lake Utilities, Inc.
- d. 95 Pages.
- e. Letter to Commission Clerk - 3 pages; response attachments - 92 pages.

10/5/2009

DOCUMENT NUMBER-DATE
10261 OCT-5 8
FPSC-COMMISSION CLERK

LAW OFFICES
ROSE, SUNDSTROM & BENTLEY, LLP
2548 BLAIRSTONE PINES DRIVE
TALLAHASSEE, FLORIDA 32301

FREDERICK L. ASCHAUER, JR.
CHRIS H. BENTLEY, P.A.
ROBERT C. BRANNAN
F. MARSHALL DETERDING
JOHN R. JENKINS, P.A.
KYLE L. KEMPER
STEVEN T. MINDLIN, P.A.
CHASITY H. O'STEEN
WILLIAM E. SUNDSTROM, P.A.
DIANE D. TREMOR, P.A.
JOHN L. WHARTON

ROBERT M. C. ROSE (1924-2006)

(850) 877-6555
FAX (850) 656-4029
www.tsbattorneys.com

REPLY TO CENTRAL FLORIDA OFFICE

CENTRAL FLORIDA OFFICE
SANLANDO CENTER
2180 W. STATE ROAD 434, SUITE 2118
LONGWOOD, FLORIDA 32779
(407) 830-6331
FAX (407) 830-8522

MARTIN S. FRIEDMAN, P.A.
BRIDGET M. GRIMSLEY
CHRISTIAN W. MARCELLI
BRIAN J. STREET

October 5, 2009

E-FILING

Ann Cole, Commission Clerk
Office of Commission Clerk
Florida Public Service Commission
2540 Shumard Oak Boulevard
Tallahassee, FL 32399

Re: Docket No. 090349-WS; Cypress Lake Utilities, Inc.'s Application for a Limited
Proceeding Water and Wastewater Rate Increase in Polk County, Florida
Our File No. 30057.182

Dear Ms. Cole:

Enclosed for filing in the above-referenced docket is the response of Cypress Lake Utilities, Inc.'s (the "Company") to Staff's second data request dated September 14, 2009. Staff has requested the following information in order to complete its analysis in the above-referenced docket.

1. Please provide the utility's current Water Use Permit issued by the Southwest Florida Water Management District, including any and all attachments and exhibits to the permit.

RESPONSE: Please see the attached Water Use Permit, dated June 7, 2007, issued by the Southwest Management District and related documents.

2. Please provide any and all correspondence between the utility and the Southwest Florida Water Management District for the period January 1, 2004 through present.

RESPONSE: Please see the attached correspondence between the Utility and Southwest Florida Water Management District.

DOCUMENT NUMBER-DATE

10261 OCT-5 09

FPSC-COMMISSION CLERK

3. Please provide, for each month during the period January 2004 through December 2008, water system data regarding the number of bills rendered and the number of gallons sold. This information should be provided, by customer class, meter size and usage block, for each month during the period requested. Please provide the information in the format shown below. To the extent the gallons sold in a particular customer class are not associated with an inclining-block rate charge, please list the gallons under the Block 1 column.

RESPONSE: Please see the attached document titled, "Item 3 – Monthly Water Data."

4. Please provide water system data regarding the names, physical addresses and billing data for each customer who received irrigation service during the test period. Please provide the information, by customer class and meter size, in the format shown below.

RESPONSE: Please see the attached document titled, "Item 4 – Irrigation Customers," for the data regarding the names, physical addresses and billing data for each customer who received irrigation service during the test period. Unfortunately, our new billing system does not differentiate between a customer receiving water service and a customer receiving irrigation service because they are on the same rate structure. The data prior to the conversion has been provided in response to Item 3. After May of 2008, however, the data is combined into the appropriate meter size category.

5. Please provide, for each month during the period January 2004 through December 2008, wastewater system data regarding the number of bills rendered and the number of gallons sold. The residential wastewater gallons sold should represent capped volume sold. This information should be provided, by customer class and meter size, for each month during the period requested. Please provide the information in the format shown below.

RESPONSE: Please see the attached document titled, "Item 5 – Wastewater System Data."

Ann Cole, Commission Clerk
Office of Commission Clerk
Florida Public Service Commission
October 5, 2009
Page 3

Should you or the Staff have any questions regarding this filing, please do not hesitate to give me a call.

Very truly yours,



CHRISTIAN W. MARCELLI
For the Firm

CWM/tlc
Enclosures

cc: John Hoy, Chief Regulatory Officer (via e-mail) (w/enclosures)
Ms. Kirsten Weeks (via e-mail) (w/enclosures)
Patrick C. Flynn, Regional Director (via e-mail) (w/enclosures)

M:\1 ALTAMONTE\UTILITIES INC\CYPRESS LAKES\ (.182) 2009 RATE CASE\RESPONSE to Staff's Second Data Request\PSC Clerk 01.txt. (Filing Response to Staff's Second Data Request).doc



An Equal Opportunity Employer

Southwest Florida Water Management District

Bartow Service Office
170 Century Boulevard
Bartow, Florida 33830-7700
(883) 534-1448 or
1-800-492-7882 (FL only)
SUNCOM 572-6200

Lecanto Service Office
Suite 228
3800 West Sovereign Path
Lecanto, Florida 34461-6070
(352) 527-8131

2379 Broad Street, Brooksville, Florida 34604-6899
(352) 796-7211 or 1-800-423-1476 (FL only)
SUNCOM 628-4150 TDD only 1-800-231-6103 (FL only)
On the internet at: WaterMatters.org

Sarasota Service Office
6750 Fruitville Road
Sarasota, Florida 34240-9711
(941) 377-3722 or
1-800-320-3503 (FL only)
SUNCOM 531-6900

Tampa Service Office
7601 Highway 301 North
Tampa, Florida 33637-6759
(813) 965-7481 or
1-800-836-0797 (FL only)
SUNCOM 574-0070

RECEIVED

JUN 11 2007

UTILITIES, INC.

- Talmadge G. "Jerry" Rice**
Chair, Pasco
- Judith C. Whitehead**
Vice Chair, Hernando
- Nell Coombes**
Secretary, Polk
- JeanWor E. Clouseby**
Treasurer, Hillsborough
- Thomas G. Dabney**
Sarasota
- Heldi E. McCree**
Hillsborough
- Sallie Parks**
Pinellas
- Todd Prossman**
Pinellas
- Maritta Rovira-Fordno**
Hillsborough
- Patsy C. Symons**
DeSoto

- David L. Moore**
Executive Director
- William S. Bilenky**
General Counsel

June 7, 2007

Patrick C. Flynn
Cypress Lakes Utilities, Inc.
200 Weathersfield Avenue
Altamonte Springs, FL 32714

Subject: Final Agency Action Transmittal Letter
General Water Use Permit No. 20013043.000

Dear Mr. Flynn:

Your Water Use Permit has been approved. Final approval is contingent upon no objection to the District's action being received by the District within the time frames described below.

You or any person whose substantial interests are affected by the District's action regarding a permit may request an administrative hearing in accordance with Sections 120.569 and 120.57, Florida Statutes, (F.S.), and Chapter 28-106, Florida Administrative Code, (F.A.C.), of the Uniform Rules of Procedure. A request for hearing must (1) explain how the substantial interests of each person requesting the hearing will be affected by the District's action, or proposed action; (2) state all material facts disputed by the person requesting the hearing or state that there are no disputed facts; and (3) otherwise comply with Chapter 28-106, F.A.C. Copies of Sections 28-106.201 and 28-106.301, F.A.C., are enclosed for your reference. A request for hearing must be filed with (received by) the Agency Clerk of the District at the District's Brooksville address within 21 days of receipt of this notice. Receipt is deemed to be the fifth day after the date on which this notice is deposited in the United States mail. Failure to file a request for hearing within this time period shall constitute a waiver of any right you or such person may have to request a hearing under Sections 120.569 and 120.57, F.S. Mediation pursuant to Section 120.573, F.S. to settle an administrative dispute regarding the District's action in this matter is not available prior to the filing of a request for hearing.

Enclosed is a 'Noticing Packet' that provides information regarding District Rule, 40D-1.1010, F.A.C. which addresses the notification of persons having substantial interests that may be affected by the District's action in this matter. The packet contains guidelines on how to provide notice of the District's action, and a notice that you may use.

Please be advised that the Governing Board has formulated a water shortage plan as referenced in Condition 4 of the Standard Water Use Permit Conditions (Exhibit A), and will implement such a plan during periods of water shortage. You will be notified during a declared water shortage of any change in the conditions of your Permit or any suspension of your Permit, or of any restriction on your use of water for the duration of any declared water shortage. Please further note that water conservation is a condition of your Permit and should be practiced at all times.

DOCUMENT NUMBER-DATE


10261 OCT-5 8

COMMISSION CLERK

June 7, 2007

The ID tags for your withdrawals shall be installed by a District representative. This representative will attempt to contact you within 30 days to discuss placement of your tags. If you have any questions or concerns regarding your tags, please contact Mark M. Alford at extension 6110, in the Bartow Regulation Department. If you have any questions or concerns regarding your permit or any other information, please contact this office at extension 4360.

Sincerely,



Paul W. O'Neil, Jr., P.E., Director
Regulation Performance Management Department

PWO:jjm

Enclosures: Approved Permit, Rules 28-106.201 and 28-106.301, F.A.C., and Noticing Packet

cc: File of Record
George J. McDonald, P.E., McDonald Group International, Inc.

**SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT
WATER USE
GENERAL
PERMIT NO. 20013043.000**

EXPIRATION DATE: June 7, 2017

PERMIT ISSUE DATE: June 7, 2007

The Permittee is responsible for submitting an application to renew this permit no sooner than one year prior to the expiration date, and no later than the end of the last business day before the expiration date, whether or not the Permittee receives prior notification by mail. Failure to submit a renewal application prior to the expiration date and continuing to withdraw water after the expiration date is a violation of Chapter 373, Florida Statutes, and Chapter 40D-2, Florida Administrative Code, and may result in a monetary penalty and/or loss of the right to use the water. Issuance of a renewal of this permit is contingent upon District approval.

TYPE OF APPLICATION: New

GRANTED TO: Cypress Lakes Utilities, Inc.
200 Weathersfield Avenue
Altamonte Springs, FL 32714

PROJECT NAME: Not Specified

WATER USE CAUTION AREA: N/A

TOTAL QUANTITIES AUTHORIZED UNDER THIS PERMIT (in gpd)

ANNUAL AVERAGE	331,200 gpd
PEAK MONTH	447,100 gpd

PROPERTY LOCATION: 0.1695 owned and 227 serviced acres in Polk County, approximately 9 miles north of the city of Lakeland and 1 mile south of the intersection of U.S. Highway 98 and Ridge Road.

ABSTRACT: This is a renewal of an expired permit (WUP No.20011531.002) for public supply in northwest Polk County outside of the Southern Water Use Caution Area for a mobile home community. There is a decrease in quantities due to the use of reclaimed water for landscape irrigation, the quantities for two golf course clubhouses and a maintenance building moved to another water use permit and a reduced per capita.

WATER USE TABLE (In gallons per day)

<u>Use</u>	<u>Annual Average</u>	<u>Peak Month</u>
Public Supply:	331,200	447,100

SERVICE AREA NAME

Cypress Lakes Utilities, Inc.

USE TYPE

POPULATION SERVED

PER CAPITA RATE

Residential Mobile Home
Other Metered Uses

Total Public Supply: 2,184 Gross 118 gpd/person

WITHDRAWAL POINT QUANTITY TABLE

Water use from these withdrawal points are restricted to the quantities given below:

<u>I.D. NO.</u> <u>PERMITTEE/ DISTRICT</u>	<u>DIAM.</u> <u>(IN.)</u>	<u>DEPTH</u> <u>TTL./CSD.FT.</u> <u>(feet bls)</u>	<u>USE</u>	<u>GALLONS PER DAY</u>	
				<u>AVERAGE</u>	<u>PEAK MONTH</u>
1 / 3	12	563 / 105	B	331,200	447,100
2 / 6	10	550 / 105	B	331,200	447,100 Wellfield Flexibility

B = Public Supply

District I.D. No. 3 and 6 formerly District I.D. No. 3 and 6 on Water Use Permit No. 20011531.002.

WITHDRAWAL POINT LOCATION TABLE

<u>DISTRICT</u> <u>I.D. NO.</u>	<u>LATITUDE/LONGITUDE</u>	<u>SECTION/TOWNSHIP/RANGE</u>
3	281020.27/815926.42	34/26/23
6	281019.80/815927.35	34/26/23

SPECIAL CONDITIONS:

All conditions referring to approval by the Regulation Department Director, Resource Regulation, shall refer to the Director, Bartow Regulation Department, Resource Regulation.

- All reports required by the permit shall be submitted to the District on or before the tenth day of the month following data collection and shall be addressed to:

Permit Data Section, Regulation Performance Management Department
Southwest Florida Water Management District
2379 Broad Street
Brooksville, Florida 34604-6899

Unless otherwise indicated, three copies of each plan or report, with the exception of pumpage, rainfall, evapotranspiration, water level or water quality data which require one copy, are required by the permit.

- The Permittee shall investigate the feasibility of using reclaimed water as a water source and submit a report describing the feasibility to the Permit Data Section, Regulation Performance Management Department, by April 1, 2012. The report shall contain an analysis of reclaimed

water sources for the area, including the relative location of these sources to the Permittee's property, the quantity of reclaimed water available, the projected date of availability, costs associated with obtaining the reclaimed water, and an implementation schedule for reuse, if feasible. Infeasibility shall be supported with a detailed explanation.

3. The Permittee shall meter withdrawals from surface waters and/or the ground water resources, and meter readings from each withdrawal facility shall be recorded on a monthly basis within the last week of the month. The meter readings shall be reported to the Data Management Section, Regulation Performance Management Department on or before the tenth day of the following month. District-supplied scanning forms shall be used to submit the meter readings unless another arrangement for submission of this data has been approved by the District. The following withdrawal facilities shall be metered:

Existing permitted withdrawal facilities shall continue to be metered with non-resettable, totalizing flow meters or other flow measuring devices as approved by the Regulation Department Director, District ID Nos. 3 and 6, Permittee ID Nos. 1 and 2.

The meters shall adhere to the following descriptions and shall be installed or maintained as follows:

- A. The meters shall be non-resettable, totalizing flow meters that have a totalizer of sufficient magnitude to retain total gallon data for a minimum of the three highest consecutive months permitted quantities. If other measuring devices are proposed, prior to installation, approval shall be obtained in writing from the Regulation Department Director.
- B. The Permittee shall report non-use on all metered standby withdrawal facilities on the scanning form or approved alternative reporting method.
- C. If a metered withdrawal facility is not used during any given month, the meter report shall be submitted to the District indicating the same meter reading as was submitted the previous month.
- D. The flow meters or other approved devices shall have and maintain an accuracy within five percent of the actual flow as installed.
- E. Accuracy testing requirements:
1. For newly metered withdrawal points, the flow meter installation shall be designed for inline field access for meter accuracy testing.
 2. The meter shall be tested for accuracy on-site, as installed, every five years beginning from the date of its installation for new meters or from the date of initial issuance of this permit containing the metering condition with an accuracy test requirement for existing meters.
 3. The testing frequency will be decreased if the Permittee demonstrates to the satisfaction of the District that a longer period of time for testing is warranted.
 4. The test will be accepted by the District only if performed by a person knowledgeable in the testing equipment used.
 5. If the actual flow is found to be greater than 5% different from the measured flow, within 30 days, the Permittee shall have the meter re-calibrated, repaired, or replaced, whichever is necessary. Documentation of the test and a certificate of re-calibration, if applicable, shall be submitted within 30 days of each test or re-calibration.
- F. The meter shall be installed according to the manufacturer's instructions for achieving accurate flow to the specifications above, or it shall be installed in a straight length of pipe where there is at least an upstream length equal to ten (10) times the outside pipe diameter and a downstream length equal to two (2) times the outside pipe diameter. Where there is not at least a length of ten diameters upstream available, flow straightening vanes shall be used in the upstream line.
- G. Broken or malfunctioning meter:
1. If the meter or other flow measuring device malfunctions or breaks, the Permittee shall notify the District within 15 days of discovering the malfunction or breakage.

2. The meter must be replaced with a repaired or new meter, subject to the same specifications given above, within 30 days of the discovery.
 3. If the meter is removed from the withdrawal point for any other reason, it shall be replaced with another meter having the same specifications given above, or the meter shall be reinstalled within 30 days of its removal from the withdrawal. In either event, a fully functioning meter shall not be off the withdrawal point for more than 60 consecutive days.
- H. While the meter is not functioning correctly, the Permittee shall keep track of the total amount of time the withdrawal point was used for each month and multiply those minutes times the pump capacity (in gallons per minute) for total gallons. The estimate of the number of gallons used each month during that period shall be submitted on District scanning forms and noted as estimated per instructions on the form. If the data is submitted by another approved method, the fact that it is estimated must be indicated. The reason for the necessity to estimate pumpage shall be reported with the estimate.
- I. In the event a new meter is installed to replace a broken meter, it and its installation shall meet the specifications of this condition. The permittee shall notify the District of the replacement with the first submittal of meter readings from the new meter.
4. Any wells not in use, and in which pumping equipment is not installed shall be capped or valved in a water tight manner in accordance with Subsection 62-532.500(3)(a)(4), F.A.C.
 5. The average day, peak monthly, and maximum daily, if applicable, quantities for District ID Nos. 3 and 6, Permittee ID Nos. 1 and 2, shown above in the production withdrawal table are estimates based on historic and/or projected distribution of pumpage, and are for water use inventory and impact analysis purposes. The quantities listed in the table for these individual sources are not intended to dictate the distribution of pumpage from permitted sources. The Permittee may make adjustments in pumpage distribution as necessary up to 331,200 gallons per day on an average basis, up to 447,100 gallons per day on a peak monthly basis, so long as adverse environmental impacts do not result and other conditions of this Permit are complied with. In all cases, the total average annual daily withdrawal, the total peak monthly daily withdrawal, and the total crop protection daily withdrawal are limited to the quantities set forth above.
 6. The Permittee shall:
 - A. Incorporate best water management practices, specifically including but not limited to irrigation practices, as recommended for the permitted activities in reports and publications by the IFAS.
 - B. Limit daytime irrigation to the greatest extent practicable to reduce losses from evaporation. Daytime irrigation for purposes of system maintenance, control of heat stress, crop protection, plant establishment, or for other reasons which require daytime irrigation are permissible; but should be limited to the minimum amount necessary as indicated by best management practices.
 - C. Implement a leak detection and repair program as an element of an ongoing system maintenance program. This program shall include a system-wide inspection at least once per year.
 - D. Evaluate the feasibility of improving the efficiency of the current irrigation system or converting to a more efficient system. This condition includes implementation of the improvements or conversion when determined to be operationally and economically feasible.
 7. Compliance with the allocated standard annual average quantity and drought annual average quantities is based on a rolling 12-month calculation where the current pumpage is added to the pumpage for the previous 11 months, and the total is then divided by the number of days in those 12 months for gallons per day. If the Permittee exceeds the allocated standard annual average quantity or drought annual average quantities during any month, within 30 days the Permittee must submit a report to the District that includes reasons why the allocated quantities were exceeded, efforts already

taken to attempt meeting the allocated quantities, and a plan to bring the permit into compliance. Reports for Permittees not achieving the allocated quantities are subject to District approval. Justification for exceeding the allocated quantities does not constitute a waiver of the District's authority to enforce the terms and conditions of the permit.

8. By **August 1, 2008**, the Permittee shall adopt a water conservation oriented rate structure. The Permittee shall submit a report describing the rate structure and its estimated effectiveness within one year following adoption.
9. The Permittee shall read each customer's meter and bill the customer no less frequently than bi-monthly (every other month), and the customer's billing period usage shall be indicated on each bill. In addition, the Permittee shall provide the following information to all water customers at least once each calendar year:
 - A. Rate structure information describing applicable fixed and variable charges rates, minimum quantity charges, block size and pricing, seasonal rates, and applicable months. If billing units are not in gallons, a means to convert the billing units to gallons must be described to the customer with this information.
 - B. Historical billing period usage averaged over the three previous years for the applicable customer class.
10. The Permittee shall adhere to the adjusted gross per capita (AGPC) requirements below:
 - A. The AGPC daily water use rate shall be no greater than 150 gallons per day (gpd) per person. The Permittee shall calculate the AGPC rate as described in the Annual Report Condition on this permit and shall submit the calculations with the Annual Report by April 1 of each year.
 - B. If the AGPC rate is greater than 150 gpd per person, the Permittee shall submit a report that documents why this rate was exceeded, measures previously or currently taken to reduce their AGPC rate, and a plan that describes additional measures and implementation dates for those measures to bring their AGPC rate to or below 150 gpd per person. This report shall be submitted with the Annual Report by April 1 for each year the AGPC rate exceeds 150 gpd per person.

Reports for Permittees not achieving the required adjusted gross per capita rate are subject to District approval. Justification for exceeding the adjusted gross per capita rate does not constitute a waiver of the District's authority to enforce the terms and conditions of the permit.

STANDARD CONDITIONS:

The Permittee shall comply with the Standard Conditions attached hereto, incorporated herein by reference as Exhibit "A" and made a part hereof.



Authorized Signature
SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

This permit, issued under the provision of Chapter 373, Florida Statutes and Florida Administrative Code 40D-2, authorizes the Permittee to withdraw the quantities outlined above, and may require various activities to be performed by the Permittee as described in the permit, including the Special Conditions. This permit does not convey to the Permittee any property rights or privileges other than those specified herein, nor relieve the Permittee from complying with any applicable local government, state, or federal law, rule, or ordinance.

40D-2
Exhibit "A"
WATER USE PERMIT CONDITIONS

STANDARD CONDITIONS

1. If any of the statements in the application and in the supporting data are found to be untrue and inaccurate, or if the Permittee fails to comply with all of the provisions of Chapter 373, F.S., Chapter 40D, or the conditions set forth herein, the Governing Board shall revoke this permit in accordance with Rule 40D-2.341, following notice and hearing.
2. This permit is issued based on information provided by the Permittee demonstrating that the use of water is reasonable and beneficial, consistent with the public interest, and will not interfere with any existing legal use of water. If, during the term of the permit, it is determined by the District that the use is not reasonable and beneficial, in the public interest, or does impact an existing legal use of water, the Governing Board shall modify this permit or shall revoke this permit following notice and hearing.
3. The Permittee shall not deviate from any of the terms or conditions of this permit without written approval by the District.
4. In the event the District declares that a Water Shortage exists pursuant to Chapter 40D-21, the District shall alter, modify, or declare inactive all or parts of this permit as necessary to address the water shortage.
5. The District shall collect water samples from any withdrawal point listed in the permit or shall require the Permittee to submit water samples when the District determines there is a potential for adverse impacts to water quality.
6. The Permittee shall provide access to an authorized District representative to enter the property at any reasonable time to inspect the facility and make environmental or hydrologic assessments. The Permittee shall either accompany District staff onto the property or make provision for access onto the property.
7. Issuance of this permit does not exempt the Permittee from any other District permitting requirements.
8. The Permittee shall cease or reduce surface water withdrawal as directed by the District if water levels in lakes fall below applicable minimum water level established in Chapter 40D-8 or rates of flow in streams fall below the minimum levels established in Chapter 40D-8.
9. The Permittee shall cease or reduce withdrawal as directed by the District if water levels in aquifers fall below the minimum levels established by the Governing Board.
10. The Permittee shall practice water conservation to increase the efficiency of transport, application, and use, as well as to decrease waste and to minimize runoff from the property. At such time as the Governing Board adopts specific conservation requirements for the Permittee's water use classification, this permit shall be subject to those requirements upon notice and after a reasonable period for compliance.
11. The District may establish special regulations for Water Use Caution Areas. At such time as the Governing Board adopts such provisions, this permit shall be subject to them upon notice and after a reasonable period for compliance.

12. The Permittee shall mitigate any adverse impact to existing legal uses caused by withdrawals. When adverse impacts occur or are imminent, the District shall require the Permittee to mitigate the impacts. Adverse impacts include:
 - A. A reduction in water levels which impairs the ability of the well to produce water;
 - B. Significant reduction in levels or flows in water bodies such as lakes, impoundments, wetlands, springs, streams or other watercourses; or
 - C. Significant inducement of natural or manmade contaminants into a water supply or into a usable portion of any aquifer water body.
13. The Permittee shall mitigate any adverse impact to environmental features or offsite land uses as a result of withdrawals. When adverse impacts occur or are imminent, the District shall require the Permittee to mitigate the impacts. Adverse impacts include:
 - A. Significant reduction in levels or flows in water bodies such as lakes, impoundments, wetlands, springs, streams or other watercourses;
 - B. Sinkholes or subsidence caused by reduction in water levels;
 - C. Damage to crops and other vegetation causing financial harm to the owner; and
 - D. Damage to the habitat of endangered or threatened species.
14. When necessary to analyze impacts to the water resource or existing users, the District shall require the Permittee to install flow metering or other measuring devices to record withdrawal quantities and submit the data to the District.
15. A District identification tag shall be prominently displayed at each withdrawal point by permanently affixing the tag to the withdrawal facility.
16. The Permittee shall notify the District within 30 days of the sale or conveyance of permitted water withdrawal facilities or the land on which the facilities are located.
17. All permits issued pursuant to these Rules are contingent upon continued ownership or legal control of all property on which pumps, wells, diversions or other water withdrawal facilities are located.
18. The annual average daily withdrawal quantity is determined by calculating the total quantity of water to be withdrawn over a 1-year period, divided by 365 days, which results in a gallons per day (gpd) quantity pursuant to Basis of Review, Section 3.2, Permitted Withdrawal Quantities. This is a running 12-month average, whereby each month the annual average daily quantity is recalculated based on the previous 12-month pumpage.



GENERAL WATER USE PERMIT APPLICATION

SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

2379 BROAD STREET • BROOKSVILLE, FL 34609-6899 • (352) 796-7211 or FLORIDA WATS 1 (800) 423-1476
(SEE LAST PAGE OF THIS FORM FOR YOUR LOCAL PERMITTING OFFICE)

USE FOR QUANTITIES OF 100,000 TO 499,999 GALLONS PER DAY

THIS FORM MUST BE COMPLETED FOR ALL APPLICANTS REQUESTING ANNUAL AVERAGE QUANTITIES BETWEEN 100,000 GALLONS PER DAY AND 499,999 GPD. OTHER APPLICANTS MUST COMPLETE THE APPLICATION FORM APPROPRIATE FOR THE PROPOSED WITHDRAWALS. THIS INFORMATION IS REQUESTED IN ACCORDANCE WITH RULES 40D-2.101 AND 40D-2.301, FLORIDA ADMINISTRATIVE CODE.

*AN ASTERISK IDENTIFIES ITEMS TO BE INDICATED ON SITE MAP; YOU MAY USE THE MAP REQUESTED IN ITEM IV, SECTION B OF THE WUP APPLICATION.

PLEASE SUBMIT TWO COPIES OF THIS APPLICATION ALONG WITH TWO COPIES OF THE APPROPRIATE SUPPLEMENTAL FROM (IF REQUIRED), DRAWINGS, CALCULATIONS, ETC.

I. GENERAL INFORMATION

1. Type of Application (Check One): New Renewal Modification

2. Water Use Permit Number (If application is for renewal or modification): 2011531.001

NOTE: "Applicant" is the name under which the permit will be issued (examples: Robert Jones; Baker Groves, Inc., Acme Industries, City of Sundale.) All correspondence will be addressed to the applicant unless an alternate contact is requested.

NAME Cypress Lakes Utilities, Inc. TELEPHONE (407) 869-1919

ADDRESS 200 Weathersfield Avenue COUNTY Polk

CITY, STATE, ZIP Altamonte Springs, FL 32714

NAME George McDonald, P.E. COMPANY: McDonald Group International, Inc.

ADDRESS 9030 S Brittany Path TELEPHONE (352) 637-1652

CITY, STATE, ZIP Inverness, FL 34452

3. OWNER (IF OTHER THAN APPLICANT)

NAME Same as Applicant

ADDRESS TELEPHONE ()

CITY, STATE, ZIP

II. PROPERTY CONTROL

1. Provide a legal description of the property served by this application. Attached

2. This property is: Owned by the applicant Leased by the applicant Applicant has other legal control

3. Leased property: Provide a copy of either (check type of document that is attached):

Copy of lease Letter signed by the property owner describing the lease arrangement and the duration of the lease

NOTE: Permits will not be issued for a duration longer than the lease, unless the lease is renewable. If renewable, the applicant may be required by Permit Condition to provide a copy of the renewed lease at the appropriate time. The property owner and the lessee must sign this application in Section VII.

4. Other Legal Control: If the applicant has legal control over the property other than a lease agreement, please provide a description on an attached sheet. Attached N/A

III. CLASSIFICATION

SECTION A - Quantity

1. Annual average quantity applied for, in gallons per day (gpd). This quantity should reflect the amount needed six years and ten years hence, or for the remainder of permit duration, if the application is for a modification:

6 years: 395,500 (gpd) 10 years: 673,000 (gpd) Other: _____ (gpd)

2. Indicate the requested peak monthly pumpage quantity. See Section 3 of the *Basis of Review* for an explanation of this quantity.

6 years: 395,500 (gpd) 10 years: 673,000 (gpd) Other: _____ (gpd)

SECTION B - Water Use

3. Water Use Permit Number (If application is for renewal or modification):

4. Indicate all that apply. Information Supplements must be filled out for all uses. See Section 3 of the *Basis of Review* for explanations of the use classifications.

Public Supply Recreation or Aesthetic Agriculture
 Industrial or Commercial Mining or Dewatering

5. Indicate the date on which the use of water was initiated or is proposed for initiation (month/day/year): n/a

6. Indicate the quantity and source of any reuse water used by the applicant:

Quantity 240000 gpd; Source Cypress Lakes Wastewater Treatment Plant

IV. SITE/WITHDRAWAL INFORMATION

SECTION A - Acreage

1. Number of acres Owned: <1; Leased: 0; Serviced 227.

2. Describe the location of the property contained in this application by Section, Township, Range, 1/4 Section:

Section 34, Township 26S, Range 23E, 1/4 Section SE.

SECTION B - Location Maps

3. Provide a recent aerial map showing: (a) a north arrow; (b) a scale designation - all maps should have a minimum scale of 1" = 2,000'; (c) landmarks such as roads and political boundaries; (d) property boundaries - include approximate lengths of boundaries in feet; (e) withdrawal point locations - label withdrawal points, indicate the distance from the withdrawal points to the nearest property boundaries in feet, *(If the withdrawal points are located on non-contiguous parcels, provide separate large-scale maps in addition to a large-scale map which includes all parcels); (f) the area serviced or irrigated, *(If the area serviced or irrigated is a distance from the withdrawal locations, provide separate map(s).

* May require separate or additional maps.

4. Use a Map (not necessarily an aerial) or a sketch of the applicant's property and surrounding area to indicate:

- a. Approximate location of other wells not owned by the applicant including domestic wells, irrigation wells, public water supply wells, etc. within the distance set forth in Item 5, Table 1, below. Supplemental locations at a greater distance may be required.
- b. Location of monitoring wells, including reference numbers.
- c. Wetlands greater than 0.5 acre in size, covering the area within the distance set forth in Item 5, below. Substantial off-site drawdown impacts may require additional aerial coverage. Mining applicants requirements differ, and are provided on the Mining and Dewatering Supplemental Form, Form No. WUP-6.

SECTION C - Adjacent Property Owners

5. Submit a listing of the names and mailing addresses of property owners near the property contained in this application, based on the quantity to be withdrawn and the table provided below. You may choose a distance from either your property boundary or your withdrawal point. The District may require additional potentially affected property owners to be submitted.

Section C, Item 5 continued on Page 3

TABLE 1 - FOR WELL OR MINE PIT WITHDRAWALS OF:

Average GPD on an Annual Basis	OR	Maximum GPD During Any Single Day	Provide Information on the Following:
More than 99,999 but less than 500,000 gpd		More than 1,000,000 but not more than 5,000,000 gpd	All property owners within 660' of the well, or within 100' of the property boundary
		More than 5,000,000 but not more than 10,000,000 gpd	All property owners within 1,320' of the well, or within 200' of your property boundary
		More than 10,000,000	All property owners within 2,640' of the well, or within 400' of your property boundary

TABLE 2 - FOR SURFACE WATER WITHDRAWALS:

If your withdrawal is from a lake with a surface area of 80 acres or less, list below all riparian owners on the lake or impoundment.

If your withdrawal is from a lake larger than 80 acres, list below all riparian owners in either direction 660' from point where applicant's property intersects the shoreline.

If your withdrawal is from a stream and if the maximum daily average pumpage is less than 5,000,000 gpd, list below all riparian owners 660' upstream and 1,320' downstream from your property boundaries at the shoreline.

If your withdrawal is from a stream and if the maximum daily average pumpage is greater than or equal to 5,000,000 gpd, list below all riparian owners 1,320' upstream and 2,640' downstream from your property boundaries at the shoreline.

Name	Mailing Address
Cypress Lakes Assoc. Ltd	PO BOX 22550 St Petersburg FL 33716

SECTION D - Withdrawal Points

6. **Groundwater Withdrawals.** Include all wells on property greater than 2 inches in diameter, whether active or inactive, and whether existing or proposed, in the table on the following page:

- TABLE LEGEND:**
- SWFWMD I.D. No.** - the withdrawal number assigned by the District, if existing.
 - Owner I.D. No.** - the owner's I.D. number.
 - Construction Date** - the approximate date that withdrawal point became operable.
 - Average Withdrawal Rate** - the total quantity of water to be withdrawn in one year divided by 365, in gpd.
 - Peak Monthly Withdrawal Rate** - the maximum quantity to be withdrawn in a single month, in gpd.
 - Maximum Daily Withdrawal Rate** - the maximum quantity to be withdrawn in any single day, in gpd.
 - Standby** - refers to status of wells that would not be used unless another well becomes inoperable.
 - Cap** - the well is capped.
 - Meter** - refers to whether a flow meter is installed: if several withdrawals are connected to the same meter. (ganged), indicate by placing a letter character (a,,b, etc.) instead of a check mark, linking those interconnected withdrawals by like characters.
 - Monitor** - refers to water level or water quality monitors. Indicate the type of monitor by placing an L (Level), Q (Quality), or both in the space provided. The absence of checkmarks or letters indicates active status.
 - Mainline Diameter** - refers to the outside diameter of the main discharge pipe.
 - Proposed** - check if the withdrawal point is proposed rather than existing.

Section D, continued from Page 3

I.D. No. SWFWMD	I.D. No. Owner	Casing Diameter	Total Depth	Depth Cased	Constr. Date	Pump Capacity (gpm)	Withdrawal Rate		Max Daily	Status (check)			Proposed	Mainline Diameter
							Average Annual	Peak Month		Mon	Stdby	Cap		
3	1	12	563	105	1987	660	395500	673000					✓	8 in
6	2	10	550	105	1990	700	395500	673000			✓		✓	6 in

7. Indicate the future use of any capped source:

n/a

8. Indicate the parameters sampled for any monitor wells listed above:

n/a

9. **Surface Water Withdrawals** - See the Groundwater withdrawal section above for explanation of most terms. Source name is the name of a lake, stream, or other waterbody

I.D. No. SWFWMD	I.D. No. Owner	Source Name	Lake Acreage	Intake Diameter	Pump Capacity (gpm)	Withdrawal Rate		Max Daily	Status (check)			Proposed	Mainline Diameter
						Average Annual	Peak Month		Active	Stdby	Metered		
	n/a												

10. **Other Sources.** Describe any other resources of water, such as from utilities, treated waste water effluent, etc. List annual average and peak month quantities for each additional source:

V. IMPACTS

Are you aware of any adverse impacts that your withdrawals have or may have on other water users, off-site land uses, the water resources, or environmental features? If so, provide a detailed explanation of the impact and your plans to deal with it.

None Anticipated

Explanation Attached

VI. HYDROGEOLOGY

Provide any information available on regional and site-specific hydrogeology, including aquifer characteristics, for all aquifers existing in the area of your withdrawals. Provide documentation and references in support of this information. If you do not have such information, hydrogeologic testing may be required either as additional information in support of your application, as a condition of the permit, or both. The district may use appropriate regional data in lieu of or in addition to submitted information to assess the impacts of your withdrawals. New hydrogeologic testing should follow the guidelines of Part C, Permit Information Manual.

VII. APPLICANT CERTIFICATION

I hereby certify that the information contained herein is true and accurate and that I have legal authority to undertake the activities described herein and execute this application.

Applicant Signature

Date

I hereby certify that the applicant has sufficient legal control of the property described in this application.

Property Owner (if other than applicant)

Date


APPLICANT CHECK LIST:

Attachments requested in support of this application:

	<i>Attached</i>	<i>N/A</i>
1. (Section II-1) Copy of Legal Description	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2. (Section II-2) Copy of Current Lease	<input type="checkbox"/>	<input type="checkbox"/>
3. (Section II-3) Description of Other Legal Property Control	<input type="checkbox"/>	<input type="checkbox"/>
4. (Section IV-3) Aerial Map	<input type="checkbox"/>	<input type="checkbox"/>
5. (Section IV-4) Site Map	<input type="checkbox"/>	<input type="checkbox"/>
6. (Section IV-5) Adjacent Property Owners	<input type="checkbox"/>	<input type="checkbox"/>
7. (Section VI) Hydrologic Information	<input type="checkbox"/>	<input type="checkbox"/>
8. Appropriate Supplemental Form	<input type="checkbox"/>	<input type="checkbox"/>

Southwest Florida Water Management District Regulation Service Regions

District applications for water use, well construction, and environmental resource permits may be submitted to any District Service Office. Permitting evaluation and field services for projects within the designated regions will be conducted by the appropriate service office. In Manatee and Sarasota Counties, well construction permits are issued locally.

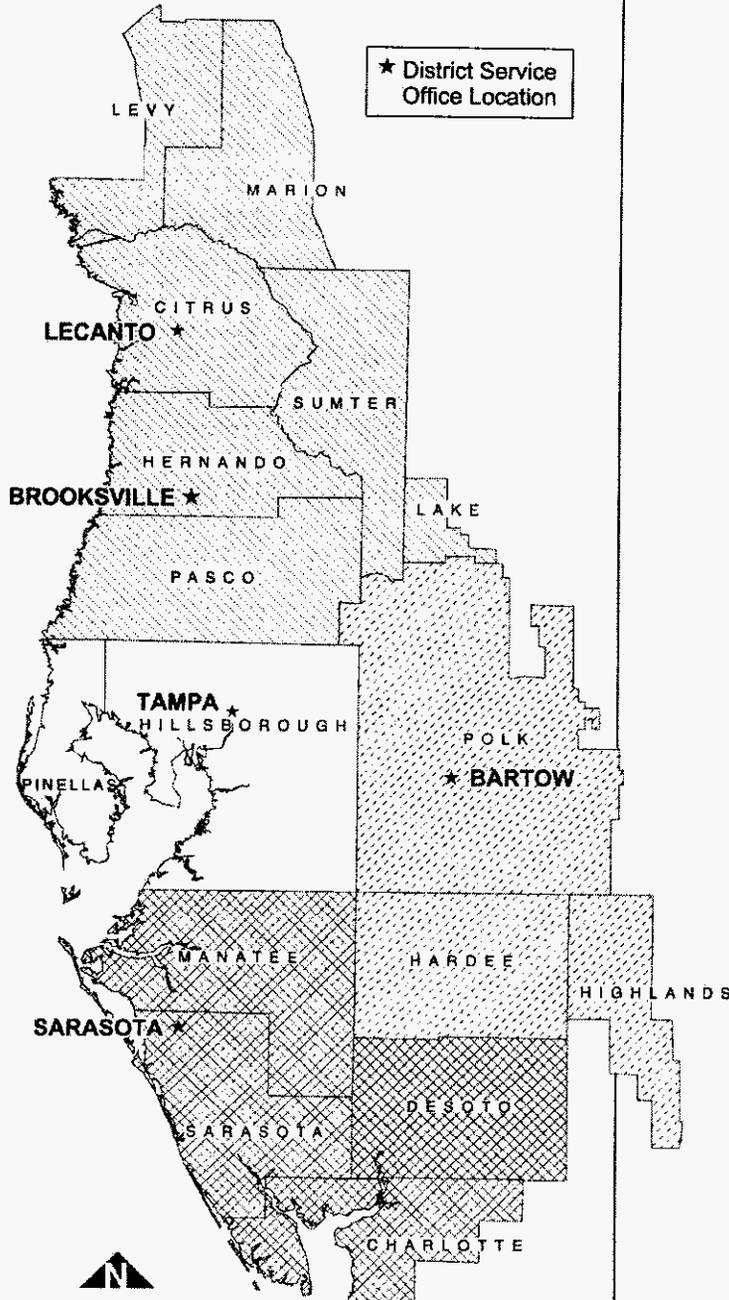

Full Permitting Services Available:

BROOKSVILLE SERVICE OFFICE 
 2379 Broad Street
 Brooksville, Florida 34604-6899
 ADA Representative: Charlotte Booth
 Phone (352) 796-7211
 Toll Free 1-800-423-1476*
 Suncom 628-4150

TAMPA SERVICE OFFICE 
 7601 U.S. Hwy. 301 N.
 Tampa, Florida 33637-6759
 ADA Representative: Patty McLeod
 Phone (813) 985-7481
 Toll Free 1-800-836-0797*
 Suncom 578-2070

BARTOW SERVICE OFFICE 
 170 Century Blvd.
 Bartow, Florida 33830-7700
 ADA Representative: Sandra McDonald
 Phone (863) 534-1448
 Toll Free 1-800-492-7862*
 Suncom 572-6200

SARASOTA SERVICE OFFICE 
 6750 Fruitville Road
 Sarasota, Florida 34240-9711
 ADA Representative: Bonnie Kasper
 Phone (941) 377-3722
 Toll Free 1-800-320-3503*
 Suncom 531-6900

Service Office Only:
LECANTO SERVICE OFFICE
 3600 W. Sovereign Path – Suite 226
 Lecanto, Florida 34461-8070
 Phone (352) 527-8131
 Suncom 667-3271

The District does not discriminate based on disability. Anyone requiring reasonable accommodation as provided for in the ADA should contact the Records and Data Department (352) 796-7211 or 1-800-423-1476 *. TDD only: 1-800-231-6103 *

*All 1-800 telephone numbers are for Florida only.



WATER USE PERMIT APPLICATION SUPPLEMENTAL FORM SOUTHWEST FLORIDA WATER MANAGEMENT DISTRICT

2379 BROAD STREET • BROOKSVILLE, FL 34609-6899 • (352) 796-7211 or FLORIDA WATS 1 (800) 423-1476

PUBLIC SUPPLY

ANSWER ALL QUESTIONS. IF A QUESTION IS NOT APPLICABLE, ENTER N/A. IF MORE SPACE IS NEEDED, ATTACH ADDITIONAL SHEETS AND REFER TO THE APPLICATION QUESTION NUMBER. PROVIDE DOCUMENTATION AND REFERENCES WHERE APPROPRIATE. IF THERE ARE OTHER USES, COMPLETE THE APPROPRIATE SUPPLEMENTAL FORM (S). THIS INFORMATION IS REQUESTED IN ACCORDANCE WITH RULES 40D-2.101 AND 40D-2.301, FLORIDA ADMINISTRATIVE CODE.

*AN ASTERISK INDENTIFIES ITEMS TO BE INDICATED ON SITE MAP; YOU MAY USE THE MAP REQUESTED IN ITEM IV, SECTION B OF THE WUP APPLICATION.

PLEASE SUBMIT **THREE COPIES** OF THIS SUPPLEMENTAL FORM ALONG WITH YOUR APPLICATION, DRAWINGS, CALCULATIONS, ETC.

I. GENERAL INFORMATION

APPLICANT: Cypress Lakes Utilities, Inc. WUP No. (If Existing): 2011531.001
(Same as shown on WUP application)

II. SITE / FACILITY INFORMATION

SECTION A - Wastewater Treatment

1. Describe existing and proposed wastewater treatment plants and major treated effluent transmission lines within the area serviced; include DEP rated capacity, potential capacity, disposal area, and method of treatment.

Wastewater Treatment Plant 0.240 MGD capacity FLA013123, reclaimed water is reused on the Cypress Lakes golf course

SECTION B - Fire Flow

2. Describe fire flow and standby capacity.

Fire flow capacity is provided by the two operating supply wells.

SECTION C - Wellfield Operation Schedule

3. Describe the typical wellfield operation schedule. Include in the description those wells that are primary, secondary (peaking), stand - by and the well rotation schedule, if any.

Both wells alternate duty per last permit modification

SECTION D - Surface Water Management

4. Is a surface water management system proposed? Yes No ; Existing? Yes Permit No. _____ No

If "yes" provide an evaluation of the impact of the proposed withdrawal on the surface water system, and conversely, the impact of the surface water management system on the withdrawal and water availability at the project site must be submitted. Attached N/A

III. WATER USE

SECTION A - Annual Average Quantities in gallons per day (gpd)

	Present	Projected 6 Year	Projected 10 Year
1. Residential Single Family	162,093	316,250	316,250
2. Residential Multi-Family			
3. Other Metered Uses			
4. Other Uses (gpd)	62,121	79,250	79,250
5. TOTAL AVERAGE WATER USE (GPD)	286,335	474,750	474,750

SECTION B - Other Uses (Itemized)

You must complete this section if the Other Use quantity in Section A exceeds 15%. Please provide calculations and references for each component identified below. If the other use quantity in Section A is 15% or less, you are not required to complete this section but may do so, at your option.

6. Commercial/Industrial non-process	6,000	6,000	6,000
7. Commercial/Industrial process			
8. Recreation Irrigation	33,700	33,700	33,700
9. Fire Fighting (testing, etc.)			
10. Water Utility Use			
11. Treatment Losses			
12. Unaccounted Use	22,421	39,550	39,550
13. TOTAL OTHER USES (Enter on Line 4, above)			

SECTION C -Recreation Irrigation

14. If any of the projected water use will be for irrigation of golf courses or recreational areas (excluding residential lawns and landscaping), respond to items a through c below. If these quantities are greater than 100,000 gpd average annual, you must fill out the Recreational Supplemental Information form.

- a. Type(s) of vegetation to be irrigated general landscaping
- b. Area in acres which will be irrigated, for each type of vegetation (include on map) 15
- c. Type of Irrigation System(s) spray irrigation

SECTION D -Seasonal Fluctuations

15. If a significant seasonal and/or tourist population is experienced, describe how this influences per-capita water use.

See enclosed report

SECTION E -Peak Month Quantity (gpd)

	Present	Projected 6 Year	Projected 10 Year
16. Provide the quantity needed in the peak month	335000	673000	673000

17. Provide documentation and calculations for these quantities. Attached

SECTION C - Maps Pertaining to Service (You may use the map requested in Item IV, Section B of the application form, if appropriate)

7. Provide a map or maps of the area supplied including outlines of the current Service Area(s), Wholesale Area(s), and projected Service Area(s) and Wholesale Area(s) for a minimum time equal to the duration of the permit. Indicate locations of the following items on the map(s), as applicable:
- a. water withdrawal sites;
 - b. water level and water quality monitoring sites;
 - c. raw water treatment facilities and wastewater disposal or discharge sites;
 - d. major water transmission mains, including existing, planned, and potential intersystem connections;
 - e. wastewater treatment sites and treated wastewater transmission facilities (including major transmission lines and interconnections);
 - f. any proposed construction associated with measures referenced in the required water conservation plan for public supply systems of 500,000 average gpd or greater;
 - g. water storage facilities;
 - h. major landmarks, such as roads, rivers, and lakes.

All maps must include a north arrow and have the scale indicated. A legend must be provided to define any symbols not otherwise identified. If any of the required information is located beyond the limits of the service area map(s), provide additional maps as needed to locate the remaining items. Include a separate map if the withdrawal locations are not contiguous with the area served, or if the well parcels are not on contiguous owned/controlled property. All maps should be of a scale of 1" = 2000' or larger, however other scales may be accepted.

8. Provide written agreements from all wholesale water purchasers stating that they will abide by the terms and conditions of the permit. Attached N/A
9. Provide a letter indicating that the local government has adopted provisions for the enforcement of the Water Conservation Act, Section 553.14, F.S. Attached N/A

VII. WATER CONSERVATION

Attach a description of water conservation practices currently employed or planned. If planned, include an estimated time-frame for implementation. Attached N/A



An Equal Opportunity Employer

Southwest Florida Water Management District

2379 Broad Street, Brooksville, Florida 34604-6899
(352) 796-7211 or 1-800-423-1476 (FL only)
SUNCOM 628-4150 TDD only 1-800-231-6103 (FL only)
On the Internet at: WaterMatters.org

Bartow Service Office
170 Century Boulevard
Bartow, Florida 33830-7700
(863) 534-1448 or
1-800-492-7862 (FL only)
SUNCOM 572-6200

Lecanto Service Office
Suite 226
3600 West Sovereign Path
Lecanto, Florida 34461-8070
(352) 527-8131

Sarasota Service Office
6750 Fruitville Road
Sarasota, Florida 34240-9711
(941) 377-3722 or
1-800-320-3503 (FL only)
SUNCOM 531-6900

Tampa Service Office
7601 Highway 301 North
Tampa, Florida 33637-6759
(813) 985-7481 or
1-800-836-0797 (FL only)
SUNCOM 578-2070

March 16, 2007

Talmadge G. "Jerry" Rice
Chair, Pasco

Judith C. Whitehead
Vice Chair, Hernando

Neli Combee
Secretary, Polk

Jennifer E. Closshey
Treasurer, Hillsborough

Thomas G. Dabney
Sarasota

Heidi B. McCree
Hillsborough

Sallie Parks
Pinellas

Todd Pressman
Pinellas

Maritza Rovira-Forino
Hillsborough

Patsy C. Symons
DeSoto

David L. Moore
Executive Director

William S. Blenky
General Counsel

George McDonald, P.E.
McDonald Group International, Inc.
9030 South Brittany Path
Inverness, FL 34452

Subject: Request for Additional Information
Water Use Permit Application No.: 20013043.000
Project Name: Not Specified
County: Polk

Reference: Chapters 40D-1 and 40D-2, Florida Administrative Code

Dear Mr. McDonald:

The water use permit application you submitted is being reviewed. The additional information listed below is necessary before we can complete our review.

1. A permit renewal application was not timely submitted prior to the expiration of Water Use Permit No. 20011531.002 that expired on February 5, 2007. Consequently, a new permit application is necessary for this project, and with requested quantities greater than 100,000 gallons per day (gpd), requires a processing fee of \$250.00. An additional \$65.00 is needed to complete the processing fee. This application will remain incomplete until the District receives the appropriate fee. [40D-2.091, 40D-2.101, and 40D-2.301, Florida Administrative Code (F.A.C.).]
2. Please verify the signatory for this permit application. Who signed the application form? Is the individual authorized to sign for Cypress Lakes Utilities? Provide documentation for the individual's authorization to sign on the water use permit application. [40D-2.091, 40D-2.101, and 40D-2.301, F.A.C.]
3. Please provide a list of names and complete mailing addresses of all current owners of adjacent properties within 660 feet of the withdrawal points or within 100 feet of the property boundary. [40D-2.091, F.A.C.; 40D-2.101, F.A.C.; 40D-2.301, F.A.C.; 4.1, Basis of Review.]
4. Please explain the relationship between Cypress Lakes Utilities, Inc., Cypress Lakes Associates, Ltd., and Cypress Lakes Venture. Cypress Lakes Associates and Cypress Lakes Venture are no longer listed as active corporate entities in the State of Florida. Is there a homeowners association representing the mobile homes or is there a Florida-licensed corporation having ownership of the 227 acre service area? [40D-2.091, F.A.C., 40D-2.101, F.A.C.; 40D-2.301, F.A.C.; 41, Basis of Review]
5. Withdrawal quantities are based on documentation supporting a reasonable demand and beneficial use. The per capita daily water use is calculated by adding the quantities for residential use, other metered uses and other uses, then divided by the adjusted population of the service area. The monthly pumpage records and total buildout projections does not support the requested quantities. Please revise the supporting calculations accordingly and also incorporate and verify seasonal population estimates. [40D-2.091, F.A.C., 40D-2.101, F.A.C.; 40D-2.301, F.A.C.; 41, Basis of Review.]

6. Please reevaluate the peak month coefficient of 1.7 as it does not correspond with the historical data. Based on the past 5 years of pumpage data the District calculated a 1.35 coefficient. [40D-2.091, F.A.C., 40D-2.101, F.A.C.; 40D-2.301, F.A.C.; 41, Basis of Review]
7. Please outline on an aerial map the lawn and landscape areas irrigated by the Utilities. Based on Part III, Section C of the Public Supply Supplemental Form, there are 15 acres of landscaping irrigated by the water supply wells. [40D-2.091, F.A.C., 40D-2.101, F.A.C.; 40D-2.301, F.A.C.; 41, Basis of Review]
8. Ground water models were not submitted with the application. Modeling is needed to provide reasonable assurance that the proposed ground-water withdrawals will not cause adverse impacts to existing legal users and adjacent wetland systems. The District recommends using the District Wide Regional Model (DWRM). Each model simulation must be signed and sealed by a Florida licensed professional geologist or professional engineer, and include a hard copy and a CD of the .RPT and .GWV files created for each modeling simulation (if the DWRM is used) submitted in support of this application. A narrative explaining the results of each modeling simulation shall be provided which includes a discussion for the surficial aquifer and Upper Floridan aquifer system with respect to any proposed impacts.

Please provide a digital ortho map, for each aquifer simulated, with drawdown contours overlaid for each modeling simulation that includes the location of all the features mentioned above. For the surficial aquifer contours, please begin at 0.1-foot drawdown contour and show 0.1-foot incremental increases. [40D-2.091, F.A.C., 40D-2.101, F.A.C.; 40D-2.301, F.A.C.; 41, Basis of Review]

Please ensure that your response is received within 30 days from the date of this letter. The information requested must be delivered to the Bartow Service Office to be considered received within that time-frame. The response must reference the permit application number and include three copies of all requested information. Failure to provide the requested information within 30 days will delay the application's processing and will result in the application being processed for denial.

If the additional information cannot be provided within the stated time period, you may make a written request for a time extension, provided that an acceptable justification for the time extension accompanies the request. The time extension request should be received within 30 days from the date of this letter.

Please contact me at the Bartow Service Office, extension 6102, if you have questions concerning the information requested or the District's procedures.

Sincerely,



Judith A. Richtar, P.G.
Bartow Regulation Department

JAR:knh

cc: File of Record 20013043.000
Patrick C Flynn, Regional Manager, Cypress Lakes Utilities, Inc.
Cashier, Finance Department
M. Balsler



April 11, 2007

Judy A. Richtar, P.G.
Water Use Permitting
Southwest Florida Water Management District
2379 Broad Street
Brooksville FL 34609-6899

Subject Cypress Lakes Utilities Inc, Water Use Permit Renewal

Dear Ms. Richtar,

In reply to your recent request for additional information, and after discussion and receipt of information from the permittee, the following comments are offered:

1) **Permit Application Fee:**

Enclosed, please see a check for \$65 additional payment for the application fee.

2) **Signatory for the Permit Application**

Patrick Flynn signed the application. He is delegated by the Board of Directors of the permittee to sign for the applicant. See enclosed letter of authorization.

3) **Adjacent Property Owners**

Enclosed, please see a print out from a map from the Polk County Property Appraiser's Office showing the property owned by Cypress Lakes Utilities where the wells are located and also the parcel identifications for the adjacent properties. Attached to this response letter is a list of the apparent property owner's with their addresses as obtained from the property appraiser's office.

4) **Relationship Between Entities**

Cypress Lakes Utilities Inc. is the entity that owns the parcel on which the wells are located and is the water supply utility.

You indicated that Cypress Lakes Associates Ltd is not at present an active Florida corporation. Nonetheless, this is the entity, who, according to the Polk County Property Appraiser's office, owns the property surrounding the parcel owned by Cypress Lakes Utilities in the service area. We have no further information regarding the active or inactive status of this corporation.

Cypress Lakes Venture appears to have been the original recipient of the WUP in 1986, We have no further information on this entity except that your letter states it is no longer listed as an active corporation in Florida.

5) and 6) Seasonal Adjustments to Population Estimates, Gallons Per Capita and Maximum Month Projected Demand

Reviewing the last water use permit renewal package, it appears that the year round population was estimated based on assuming 35% year round occupancy, and assuming the seasonal population was there 6 months out of the year.

In 2006, there were 1280 homes served by the utility. We have assumed a population of 2.25 persons per home for a total of 2880 persons. Using the assumption of 35% year round occupancy there are 1008 year round residents. The weighted monthly average of these figures yields an adjusted annualized population of 2448 persons. $[(12 \text{ mos} \times 1008 \text{ residents} + 6 \text{ mos} \times 2880 \text{ residents}) / 12 \text{ mos}]$.

For build out, there are expected to be 1,667 homes. Using 2.25 persons per home there could be 3751 persons but continuing with the assumption of 35% year round occupancy there would be 1313 year round residents. The weighted monthly average of these figures yields an adjusted annualized future population of 3,118 persons.

Making the same seasonal adjustment for all years between 2001 and 2006, it can be seen that the adjusted per capita usage varies from 36 to 72 GPCD. For making future projections, a value of 70 GPCD is judged reasonable.

With respect to maximum month to annual average ratios, the data used in the report came from MOR data from the Florida Department of Environmental Protection. On page 8 of the supplemental report there was a detailed table indicating the maximum month demand and the annual average demand for each year going back to 1999. The years with high maximum month to annual average days were 1999 (3.06), 2000 (1.83), and 2002 (1.67). The value you mentioned in your letter of 1.35 appears to mostly closely come from the last three years of data.

The Basis of Review Manual states:

The Peak Month Quantity is determined by identifying average monthly use (in gpd) from pumpage records for each calendar month for a period **not to exceed the preceding 5 years**. The 31 consecutive days or the month with the greatest pumpage in each year is determined and identified as the peak month quantity (in gpd). The peak month quantity is then divided by the recorded annual average daily withdrawal quantity for that year. This division results in the peak month coefficient. The most appropriate peak month coefficient, based on the years reviewed, is then used as a multiplier to determine proposed peak month withdrawal.

Based therefore on the FDEP MOR data, and using the data 2001 to 2006, it appears to me that 1.67 is the appropriate peak month factor to use.

After making all of these adjustments, I have redone the calculation table provided in the report, and have attached a copy.

Future projected requirements are 0.223 MGD annual average and 0.373 MGD maximum month.

April 12, 2007
Cypress Lakes
Page Three

7) Location of 15 acres of Landscape Irrigation

The permittee will provide under separate cover an aerial map showing the location of the 15 acres that is irrigated .

8) Groundwater Model

The permittee takes exception to your request for the permittee to provide a groundwater model for the following reasons:

- a) No increase in permitted capacity is requested over the previous permit; with no increase in permitted demand, there would be no increase in previously permitted impact; and
- b) It appears from the public record of the last permit renewal, the District had a model performed, I can't tell if it was done by the water management district or by others. The title indicates that it was the Jacob-Hantush Steady State Ground Water Flow Model, Robert G. Perry, Water Use Permitting, Brooksville Permitting Department.

I trust this information will be sufficient, please contact me if any questions.


Sincerely,
McDONALD GROUP INTERNATIONAL, INC..

George J. McDonald, P.E.

Cc
Mike Wilson

Polk County Property Appraiser

Internet Mapping

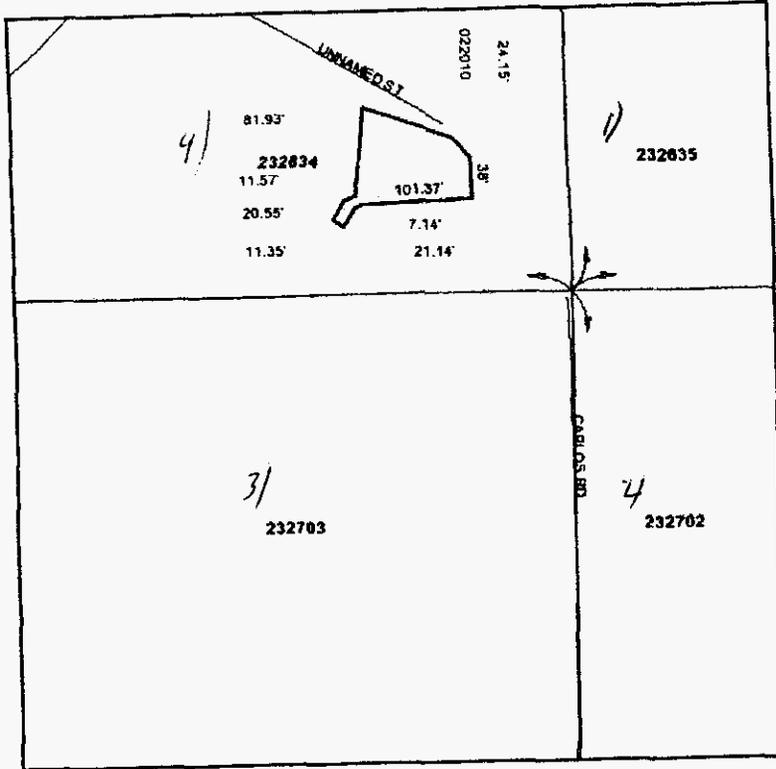

DISCLAIMER: All maps are worksheets used for illustrative purposes only. They are not surveys. The information is provided "as is."

Parcel Info

Parcel ID: 232634000000022010

Owner 1: CYPRESS LAKES UTILITIES INC

Legal Desc: WATER TREATMENT FACILITY DESC AS COMM AT SE COR OF SEC 34 RUN W 208.28 FT N 62.58 FT TO POB N 55 DEG 35' 25" W 11.35 FT N 30 DEG 08' 37" E 20.55 FT N 68 DEG 53' 05" E 11.57 FT N 04 DEG 48' 35" E 81.93 FT S 70 DEG 40' 59" E 87.15 FT S 41 DEG 58' 43" E 24.15 FT S 01 DEG 32' 04" E 38 FT S 87 DEG 41' 13" W 101.37 FT S 70 DEG 00' 08" W 7.14 FT S 34 DEG 02' 09" W 21.14 FT TO POB

Property (DOR) Use Code: 9670 (Sewage/Borrow Pits/Spray Fields)

Acreeage: 0.17 Acres

Value Summary

Value Name	Price
Building Value	\$0
Extra Feature Value	\$0
Land Value (Market)	\$100
Just Market Value	\$100
Assessed Value	\$100
Exempt Value	\$0

Adjacent Property Owners

According to Polk County Property Appraiser's Maps:

- 1) North East of Property Owner by Cypress Lakes Utilities Inc.

PRIME HOMES AT THE ESTATES OF PORTOFINO
21218 SAINT ANDREWS BLVD
BOCA RATON
FL33433-2449

- 2) South East of Property Owned by Cypress Lakes Utilities, Inc.

PRIME HOMES AT THE ESTATES OF PORTOFINO
21218 SAINT ANDREWS BLVD
BOCA RATON FL 33433-2449

- 3) South and West of the Property Owned by Cypress Lakes Utilities, Inc.

CASH JUDITH H
9215 MAX CASH RD
LAKELAND, FL 33810-1480

- 4) To West, North and Surrounding Property Owned by Cypress Lakes Utilities;

CYPRESS LAKES ASSOC LTD
10000 US HIGHWAY 98
LAKELAND, FL 33810

Year	Annual Average	Max Month	Ratio MM/ADF	Commercial	Irrigation	Unaccounted @ 10%	Residential Use	Number of Homes	Population	35% year Round Population	Annual Adjusted Population	Demand/Pers on
1999	251336	768000	3.06	6000	33700	25134	186503	936	2106	737	1790	104
2000	120209	220258	1.83	6000	33700	12021	68488	984	2214	775	1882	36
2001	201191	246100	1.22	6000	33700	20119	141372	1032	2322	813	1974	72
2002	201077	335000	1.67	6000	33700	20108	141269	1081	2432	851	2067	68
2003	165977	211000	1.27	6000	33700	16598	109680	1128	2538	888	2157	51
2004	183587	225000	1.23	6000	33700	18359	125529	1177	2648	927	2251	56
2005	177676	225000	1.27	6000	33700	17768	120208	1225	2756	965	2343	51
2006	224215	293667	1.31	6000	33700	22421	162093	1280	2880	1008	2448	66
2007	178723	244851	1.37	6000	33700	17872	121151	1335	3004	1051	2553	70
2008	186220	268157	1.44	6000	33700	18622	127898	1391	3130	1095	2660	70
2009	193583	289407	1.50	6000	33700	19358	134525	1446	3254	1139	2765	70
2010	200946	311467	1.55	6000	33700	20095	141152	1501	3377	1182	2871	70
2011	208443	348100	1.67	6000	33700	20844	147899	1557	3503	1226	2978	70
2012	215940	360620	1.67	6000	33700	21594	154646	1613	3629	1270	3085	70
2013	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70
2014	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70
2015	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70
2016	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70
2017	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70
2018	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70
2019	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70
2020	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70
2021	223170	372693	1.67	6000	33700	22317	161153	1667	3751	1313	3188	70

DELEGATION OF AUTHORITY


Cypress Lakes Utilities, Inc.

Pursuant to the Articles of Incorporation of the Company, the undersigned Chairman and Chief Executive Officer of the Company hereby delegates to Patrick Flynn (*Delegate*) the right, power and authority to perform the following actions on behalf of the Company:

1. To apply for and negotiate with any governmental regulatory agency with regard to certificates of authority, permits, licenses and other matters regulated by such agency relating to the business and operations of the Company (*Regulated Matters*);
2. To execute and deliver, in the form acceptable to the Delegate, any application or agreements relating to the Regulated Matters;
3. Any and all other documents and instruments necessary to complete the foregoing transactions.

This Delegation will automatically terminate on the earlier to occur of the election of the Delegate as an officer of the Company, or the termination of the employment of the Delegate.

Signed this 1st day of July, 2003.


James Camaren, Chairman and
Chief Executive Officer

Water Use Permit Application

*Supplemental Engineering Report
Cypress Lakes Utilities, Inc.
Water Use Permit 2011531.001*

JANUARY 2007

PREPARED FOR CYPRESS LAKES UTILITIES INC. BY



McDONALD GROUP INTERNATIONAL, INC.

C.A.-0007580

GEORGE J. McDONALD, P.E. 9030 S. BRITTANY PATH INVERNESS FLORIDA 34452
WATER, WASTEWATER & ENVIRONMENTAL ENGINEERING TOLL FREE NATIONWIDE: (877) 593-2364
FAX (352)637-3679 VOICE (352) 637-1652
E-MAIL: gmcdonald@mcdonaldgroup.com
WEB SITE: www.mcdonaldgroup.com

Table of Contents

Introduction	1
General	1
Authorization	1
Information Sources Used	1
Location Map	2
USGS Map	3
Service Area Map	4
Service Area and Facility History	5
Existing Vegetative Cover	5
Aquifer	5
Historical Water Usage and Per Capita Consumption	6
Total Historical Demand	6
Non Residential Water Uses	7
Population and Per Capita Usage	8
Projected Water Demand	9
Existing Water Supply and Wastewater Treatment Systems	10
Water Plant	10
Wellfield	10
Wastewater Plant	11
Water Conservation Plan	12
Goals and Evaluation Criteria	12
Institutional Limitations	12
Metering	12
Reuse	12
Conservation Activities	12
Consumer Information	12
Timetable for Implementation	13
Appendix	14
Water Use Raw Data	15

Introduction

General

The purpose of this report is to provide supplemental engineering data in support of the Cypress Lakes Utilities, Inc. application to renew its current water use permit, which expires February 5, 2007..

The scope of this report includes:

- a review of the existing service area
- an analysis of current usage and per capita consumption
- reviews information pertaining to the existing water supply and wastewater treatment facilities
- Project future demands based on historic per capita usage

Cypress Lakes Utilities, Inc. is located west of US 98 in Polk County, and approximately five miles north of Lakeland.

A location map (street and USGS) is shown on the following page.

The current permit provides an allocation of 395,000 gallons per day annual average and 673,000 gallons per day in the peak month. Water is supplied from two wells which alternate duty.

The current permit also provides irrigation of 15 acres at 30.2 inches per year.

Cypress Lakes Utilities owns 0.17 acres for the water supply facility, but does not own the 227 acre service area.


Authorization

This report has been prepared by McDonald Group International, Inc., George J. McDonald, P.E., as authorized by Cypress Lakes Utilities, Inc.


Information Sources Used

This report has been compiled from information provided by representatives of Cypress Lakes Utilities Inc. and as found in public records. The accuracy of the information and conclusions contained in this report relies on these sources.


Location Map

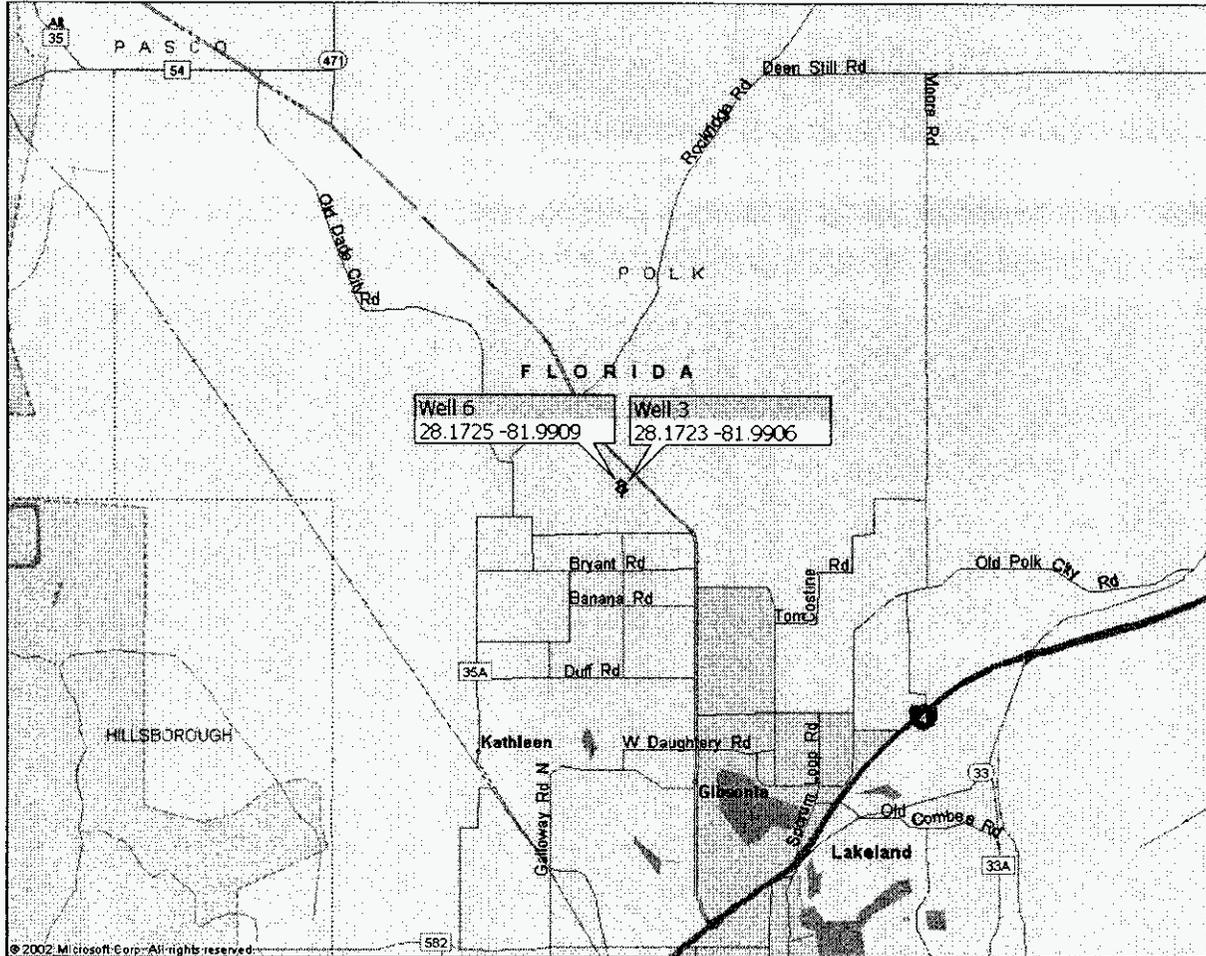

USGS Map

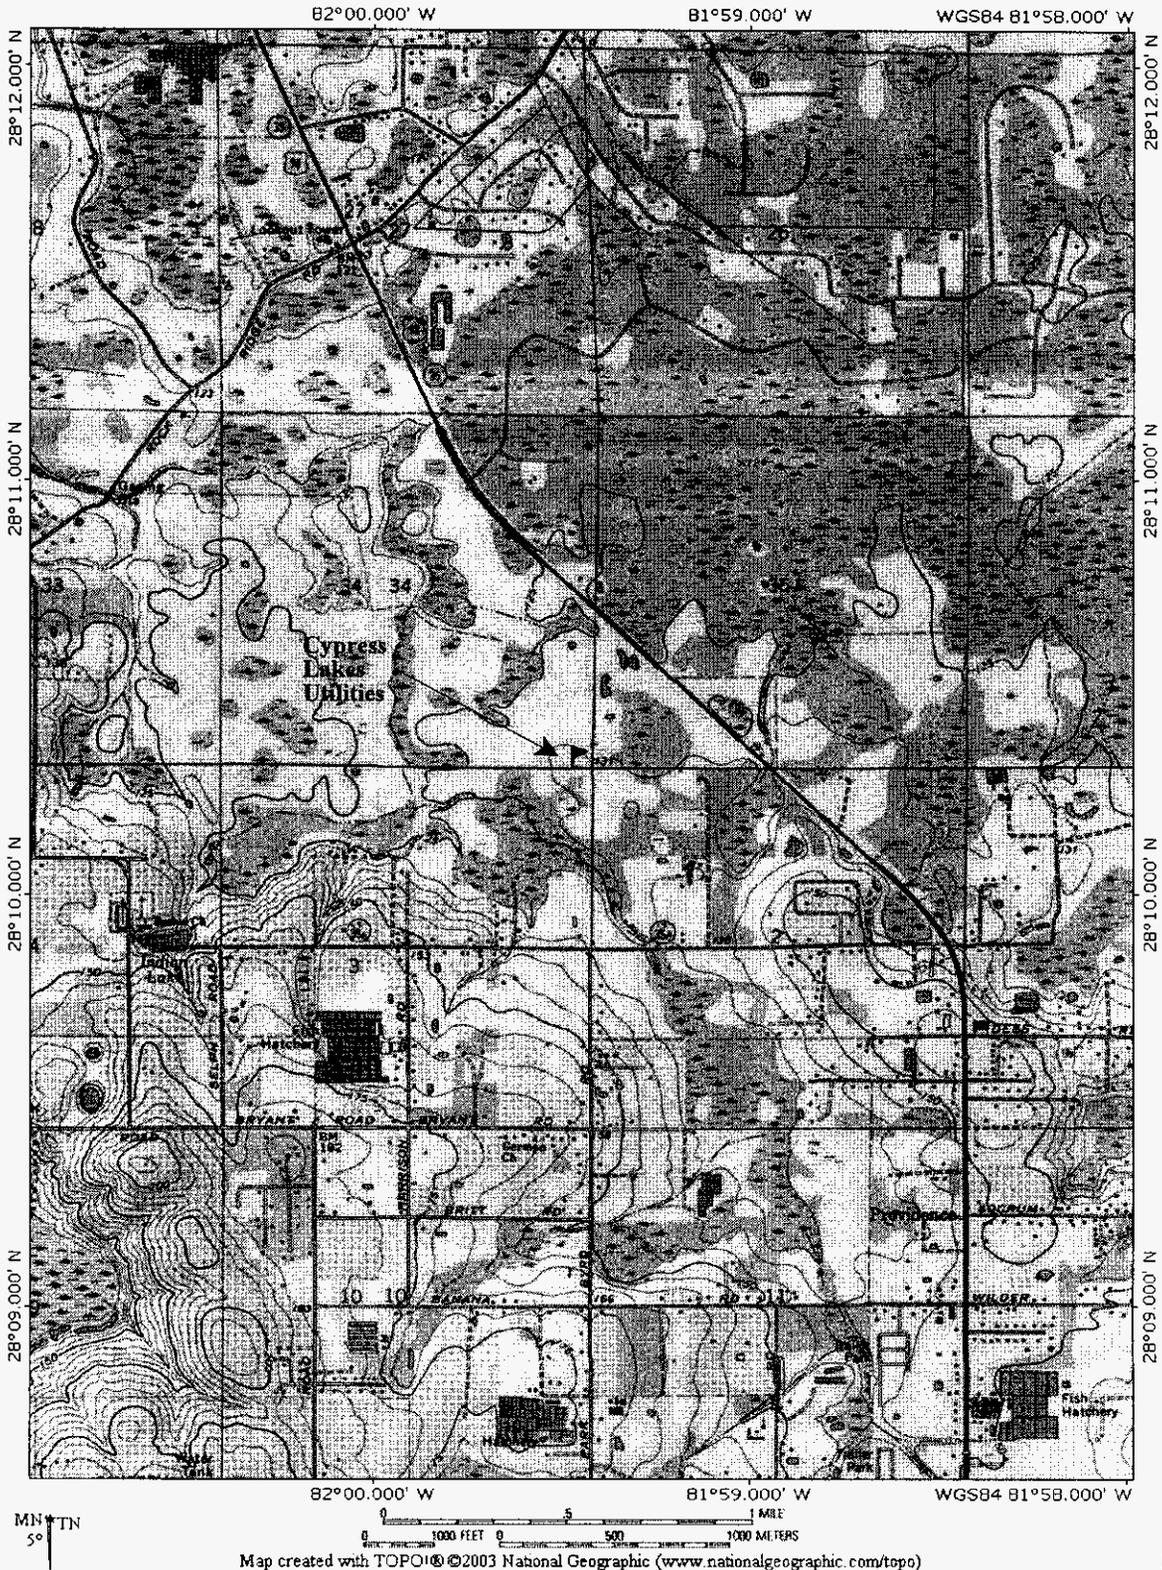


Service Area Map



LEGEND

- EFFLUENT TO HOLDING POND
- EFFLUENT TO IRRIGATION PONDS
- EFFLUENT TO PUMP STATION

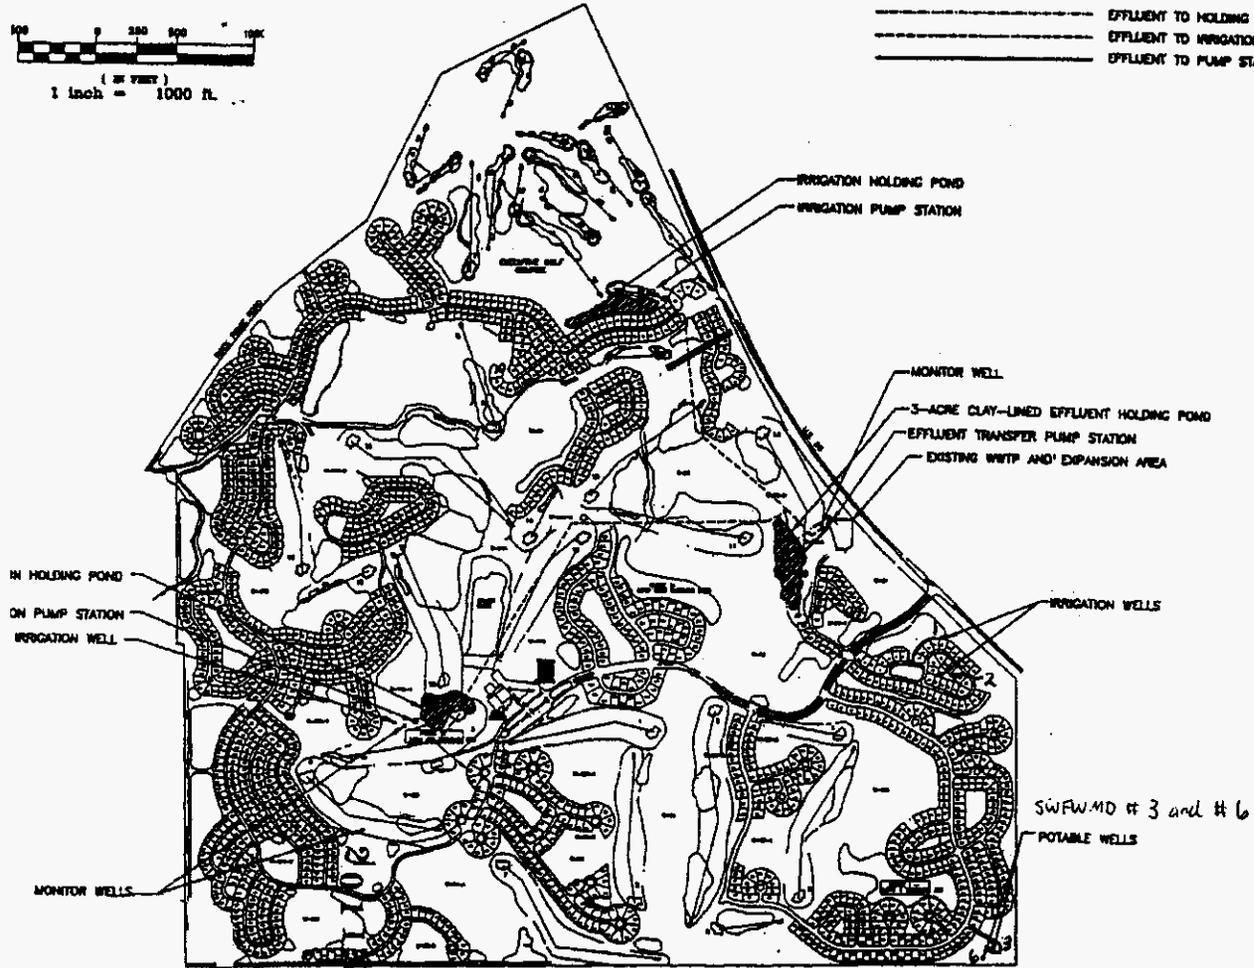

Service Area and Facility History

Cypress Lakes is a mobile home community located to the north of Lakeland just west of US 98. Cypress Lakes Utilities Inc. serves this development. There are approximately 1280 mobile homes served by the utility at present. At buildout, the community will have 1,667 mobile homes.

There are four known water supply wells associated with the Cypress Lakes community. Two wells are irrigation only and are 4" diameter. They are not owned by the permittee nor are they part of this water use permit renewal application. The other two water supply wells are larger diameter, are owned and operated by Cypress Lakes Utilities, and are part of this application.

Cypress Lakes Utilities also operates a wastewater treatment plant which produces reclaimed water for use on the golf course at Cypress Lakes.

Water uses requested under this application include public supply of drinking water for residential demand, some incidental landscaping irrigation, and other uses.

Existing Vegetative Cover

The development of the community has long since altered the vegetative characteristics of the land. There are developed resort areas, single family home sites, roadways, utilities, all within the boundaries of the community.

Aquifer


The project utilizes water from the Floridan aquifer system.

Historical Water Usage and Per Capita Consumption

Total Historical Demand


Historical water usage information was obtained from the monthly operating reports filed with the Florida Department of Environmental Protection. These are equal to the amount of water pumped out of the ground as the only treatment is by chlorination.

The average daily consumption for each month from 1999 to the present was tracked. The historical record is shown in the figure below:

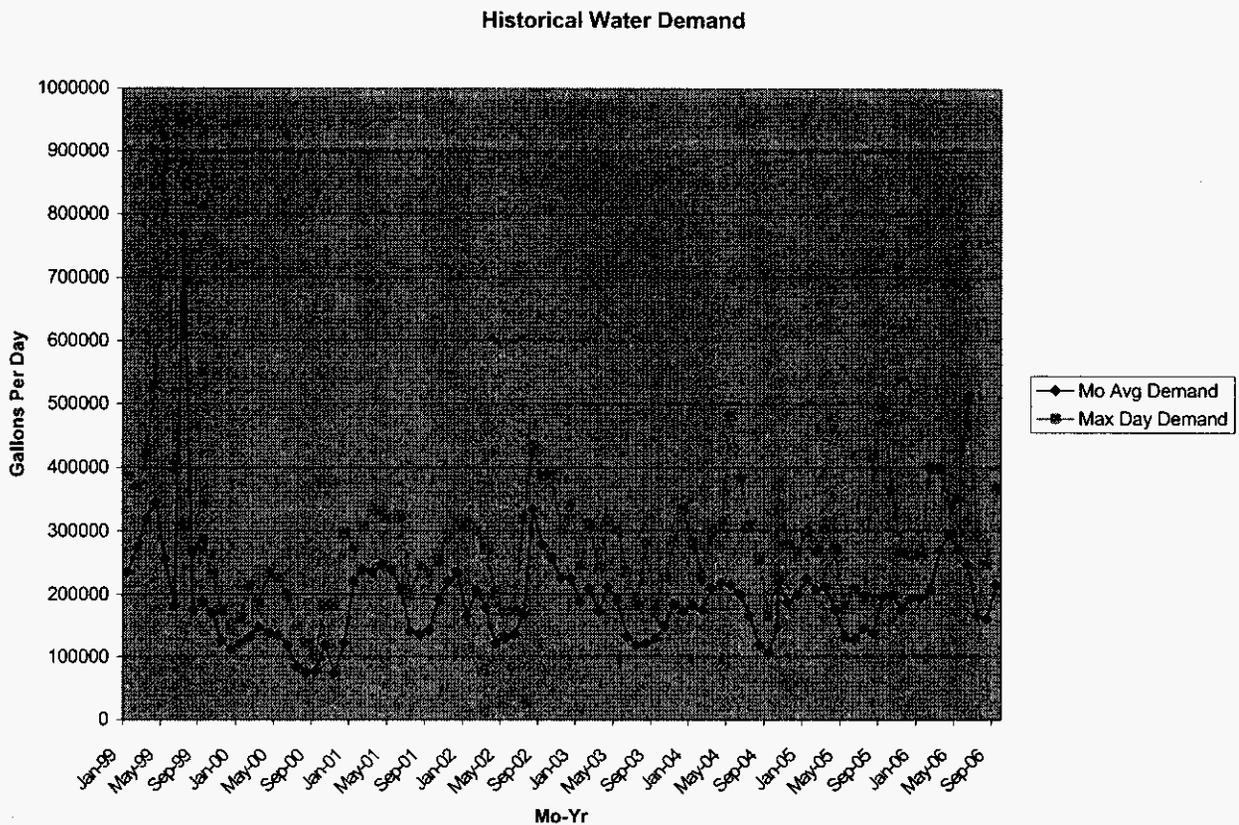

As can be seen there is some seasonal variation in consumption during the course of each year.

Viewed by year, the historical demand has been as follows:

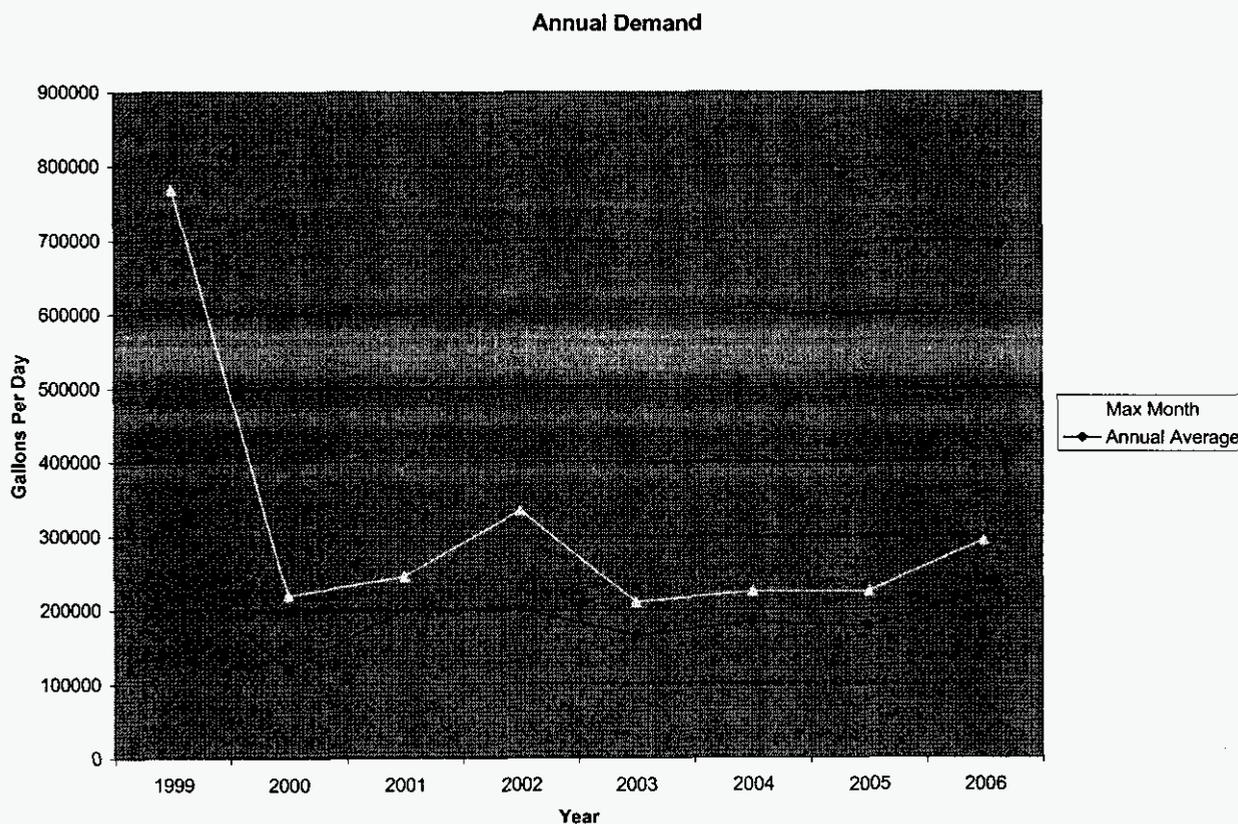

Non Residential Water Uses

Non residential water use falls in three main categories: commercial use, irrigation, and unaccounted for use.

Based on a review of prior year data, the commercial use is associated with the operation of the community sales offices and appears to be 6000 gallons per day on average .

Incidental aesthetic landscape irrigation uses account for 33,700 gallons per day. This is based on information found in the SWFWMD's files for this permit indicating a maximum of 15 acres irrigated at 30.2 inches per year.

Unaccounted for use is assumed to be 10% of the total water produced.

The only treatment provided by the existing water plant is chlorination. There is no filtration or other process that generates a waste stream. As a consequence, in plant water usage is negligible

Population and Per Capita Usage

In 1999, there were 936 homes served by the utility. In 2006, there were reported 1280 homes served. There is a maximum of 1667 homes at build-out.

Occupancy of each unit has been assumed, based on a review of documentation found in the water management district's files, of 2.25 persons per mobile home unit.

Per capita usage is considered residential usage divided by the estimated population.

Residential usage is taken as total water produced less non residential usage as described above.

Based on this, the historical record indicates per capita usage has been as follows:

Year	Annual Average	Max Month	Ratio MM/ADF	Commercial	Irrigation	Unaccounted @ 10%	Residential Use	Number of Homes	Population	Demand/Pers on
1999	251336	768000	3.06	6000	33700	25134	186503	936	2106	89
2000	120209	220258	1.83	6000	33700	12021	68488	984	2213	31
2001	201191	246100	1.22	6000	33700	20119	141372	1032	2322	61
2002	201077	335000	1.67	6000	33700	20108	141269	1081	2431	58
2003	165977	211000	1.27	6000	33700	16598	109680	1128	2538	43
2004	183587	225000	1.23	6000	33700	18359	125529	1177	2647	47
2005	177676	225000	1.27	6000	33700	17768	120208	1225	2756	44
2006	224215	293667	1.31	6000	33700	22421	162093	1280	2880	56

Projected Water Demand

The current permit provides an allocation of 395,000 gallons per day annual average and 673,000 gallons per day in the peak month.

No change in this allocation is proposed.

The ratio of the peak month to the annual average has varied from 1.22 to 3.06 since 1999. Maintaining the current allocation results in a ratio of 1.7

The per capita usage has varied from 43 gallons per day per capita to 89 gallons per day per capita.

At buildout there would be 1667 mobile homes, or a total of an 3,571 persons.

Future residential demand would be the total allocation (395,500 gpd) less commercial usage (6000 gpd), less aesthetic irrigation use (33,700 gpd) less unaccounted for usage (39,550 gpd). Residential demand would thus be 316,250 gpd.

Per capita usage would therefore be 84 gallons per day, which is both a reasonable figure as well as a figure that is close to the historical high for the period reviewed.

It is assumed that buildout will be reached within six years.

Looking therefore at both past as well as future demand, the following is seen:

Year	Annual Average	Max Month	Ratio MM/ADF	Commercial	Irrigation	Unaccounted @ 10%	Residential Use	Number of Homes	Population	Demand/Pers on
1999	251336	768000	3.06	6000	33700	25134	186503	936	2106	89
2000	120209	220258	1.83	6000	33700	12021	68488	984	2214	31
2001	201191	246100	1.22	6000	33700	20119	141372	1032	2322	61
2002	201077	335000	1.67	6000	33700	20108	141269	1081	2432	58
2003	165977	211000	1.27	6000	33700	16598	109680	1128	2538	43
2004	183587	225000	1.23	6000	33700	18359	125529	1177	2648	47
2005	177676	225000	1.27	6000	33700	17768	120208	1225	2756	44
2006	224215	293667	1.31	6000	33700	22421	162093	1280	2880	56
2007	252477	345893	1.37	6000	33700	25248	187529	1335	3004	62
2008	276076	397549	1.44	6000	33700	27608	208768	1391	3130	67
2009	300032	446421	1.49	6000	33700	30003	230329	1446	3254	71
2010	323989	497589	1.54	6000	33700	32399	251890	1501	3377	75
2011	347587	500526	1.44	6000	33700	34759	273129	1557	3503	78
2012	371544	583629	1.57	6000	33700	37154	294689	1613	3629	81
2013	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84
2014	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84
2015	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84
2016	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84
2017	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84
2018	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84
2019	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84
2020	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84
2021	395500	673000	1.70	6000	33700	39550	316250	1667	3751	84

Existing Water Supply and Wastewater Treatment Systems

Water Plant


The existing water supply system consists of two wells which pump to a pair of hydropneumatic tanks. These tanks maintain system pressure when the pumps are not operating. The only treatment provided is chlorination. A sketch of the well site appears below.

Wellfield

There are presently two wells. These are fairly deep wells, one 12", and one 10" pulling from the Floridan aquifer. The wells are respectively 563 feet deep and 550 feet deep.

An aerial photo map shows the resort area and well field and accompanies this application

The two wells in the wellfield are intended to be operated in a lead and lag mode, with each well alternating lead duty.

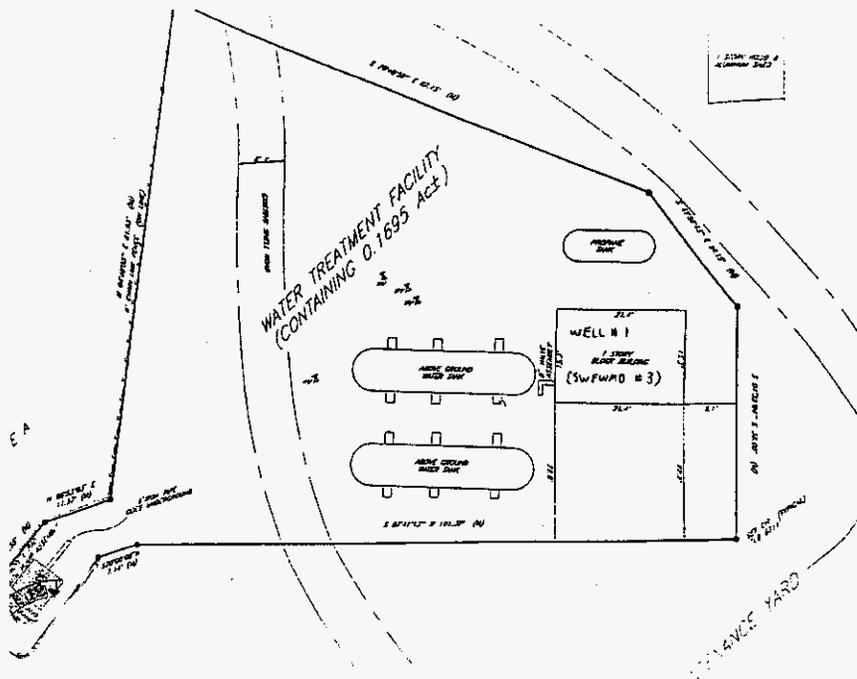

Wastewater Plant

Cypress Lakes Utilities, Inc. owns a wastewater treatment plant at Cypress Lakes and which provides treatment of sewage from Cypress Lakes..

This facility is considered a Class I reliable treatment plant, providing disinfection, secondary treatment and filtration.

Reclaimed water is reused on the golf course at Cypress Lakes.

Water Conservation Plan

This water conservation statement is submitted in accordance with Water Use Permit application information requirements in support of this water use permit renewal application. A more detailed conservation plan accompanies this report.

What follows is a general outline of the plan.

Cypress Lakes Utilities Inc. proposes the following policies and practices as their an-going water conservation program:

Goals and Evaluation Criteria

It will be the goal of the Cypress Lakes Utilities to keep per capita consumption of finished drinking water used for domestic consumption below 100 gpd

In addition, it will be a goal to keep leakage/unaccounted for losses within the system to less than 10%.

Institutional Limitations

Cypress Lakes Utilities Inc is a utility regulated by the Public Services Commission (PSC).

Cypress Lakes Utilities will stay current with regulations promulgated by the SFWMD related to water use and water conservation

Metering

Meters have been installed throughout the service area and users are charged based on usage. Meters are periodically checked for accuracy.

Reuse

Reclaimed water from the wastewater treatment plant will continue to be reused on the golf course.

Conservation Activities

The measurable criteria that were considered in selecting which activities were deemed most suitable for developing a conservation plan are current usage and per capita consumption. Suitable activities to work towards those goals include distribution of information to staff and consumers, leak detection, and implementation of applicable regulatory requirements.

Consumer Information

Consumer Information distribution is a relatively low cost method that the Utility will use to maintain low per capita water consumption.

Messages and memoranda will periodically be printed to advise staff and consumers of activities they can do to conserve water. Examples are:

- Report leaks
- use landscaping with minimal irrigation requirements (xeriscaping).

- replace fixtures as appropriate with low flow devices
- comply with all regulatory directives concerning lawn watering restrictions, car washing, etc.

Leak Detection and Maintenance

Cypress Lakes Utilities Inc. has an on-going program to annually inspect and repair leaks.

The permittee will continue to repair system leaks on an as- needed basis.

Timetable for Implementation

Leak detection, maintenance, and staff/consumer education are on going activities.

Appendix

Water Use Raw Data

Mo-Yr	Month Average	Max Day
Jan-99	234903	387000
Feb-99	273429	371000
Mar-99	318903	420000
Apr-99	344500	531000
May-99	255677	923000
Jun-99	182467	400000
Jul-99	768000	310000
Aug-99	174710	268000
Sep-99	187433	288000
Oct-99	169761	233000
Nov-99	125267	176000
Dec-99	111000	144000
Jan-00	121323	163000
Feb-00	131172	215000
Mar-00	147355	187000
Apr-00	137733	235000
May-00	134968	227000

Mo-Yr	Month Average	Max Day
Jun-00	117833	197000
Jul-00	85742	148000
Aug-00	74677	122000
Sep-00	76333	102000
Oct-00	118839	183000
Nov-00	75066	180000
Dec-00	121419	299000
Jan-01	220258	276000
Feb-01	239571	309000
Mar-01	234161	334000
Apr-01	246100	331000
May-01	237677	321000
Jun-01	209166	325000
Jul-01	140550	197000
Aug-01	135000	245000
Sep-01	142000	234000
Oct-01	192000	254000

Mo-Yr	Month Average	Max Day
Nov-01	220000	296000
Dec-01	234000	311000
Jan-02	165000	313000
Feb-02	206000	300000
Mar-02	179000	273000
Apr-02	121000	204000
May-02	130000	173000
Jun-02	136000	177000
Jul-02	168000	321000
Aug-02	335000	435000
Sep-02	279000	387000
Oct-02	257000	389000
Nov-02	226000	301000
Dec-02	224000	342000
Jan-03	188000	246000
Feb-03	209000	312000
Mar-03	172000	243000

Mo-Yr	Month Average	Max Day
Apr-03	211000	317000
May-03	189633	302000
Jun-03	132700	236000
Jul-03	117774	186000
Aug-03	121000	284000
Sep-03	129000	174000
Oct-03	149000	227000
Nov-03	183600	285000
Dec-03	173000	336000
Jan-04	182000	281000
Feb-04	174844	228000
Mar-04	209000	301000
Apr-04	218000	316000
May-04	215000	482000
Jun-04	200000	380000
Jul-04	166000	310000
Aug-04	119000	258000

Mo-Yr	Month Average	Max Day
Sep-04	106000	165000
Oct-04	147600	228000
Oct-04	222000	375000
Nov-04	186000	279000
Dec-04	198193	269000
Jan-05	225000	300000
Feb-05	207000	270000
Mar-05	211333	303000
Apr-05	175129	274000
May-05	131400	176000
Jun-05	126935	205500
Jul-05	144970	196000
Aug-05	137166	417000
Sep-05	194000	492000
Oct-05	197400	363000
Nov-05	175000	266000
Dec-05	192226	264000

Mo-Yr	Month Average	Max Day
Jan-06	192226	264000
Feb-06	206250	400000
Mar-06	268774	399000
Apr-06	293667	344000
May-06	271016	351000
Jun-06	247000	509000
Jul-06	164000	292000
Aug-06	160000	248000
Sep-06	215000	369000

Item II - 1

Legal Description of Property

Parcel 1: Water Treatment Facility

A parcel of land lying in Section 34, Township 26 South, Range 23 East, Polk County, Florida being more particularly described as follows:

Commence at the Southeast corner of said Section 34, thence South 89 deg. 22'28" West, along the South line of said Section 34, for 208.28 feet; thence North 00 deg. 37'32" West, leaving the South line of said Section 34, for 62.58 feet to the Point of Beginning; thence North 55 deg. 35'25" West, for 11.35 feet; thence North 30 deg. 08'37" East for 20.55 feet; thence North 68 deg. 53'05" East, for 11.57 feet; thence North 04 deg. 48'35" East, for 81.93 feet; thence South 70 deg. 40'59" East, for 87.15 feet; thence South 41 deg. 58'43" East, for 24.15 feet; thence South 01 deg. 32'04" East for 38.00 feet; thence South 87 deg. 41'13" West for 101.37 feet; thence South 70 deg. 00'08" West for 7.14 feet; thence South 34 deg. 02'09" West for 21.14 feet to the Point of Beginning.

ISTR # 98169268
 OR BK 04130 PG 0287
 RECORDED 11/13/98 07:13 AM
 RICHARD W. METZS CLERK OF COURT
 POLK COUNTY
 DEC. TAX PD(F.S. 201.02) 350.00
 DISPUTY CLERK S Metzels

PREPARED BY AND RETURN TO:
 ROGER A. LARSON, ESQUIRE
 JOHNSON, BLAKELY, POPE, BOKOR,
 RUPPEL & BURNS, P.A.
 811 CHESTNUT STREET
 CLEARWATER, FL 33756

STATUTORY WARRANTY DEED

THIS INDENTURE, is made on 27th day of October, 1998, between CYPRESS LAKES ASSOCIATES, LTD., a Florida limited partnership, whose address is 11300 4th Street North, Suite 200, St. Petersburg, Florida 33716 ("Grantor"), and CYPRESS LAKES UTILITIES, INC., a Florida corporation, whose address is 200 Weathersfield Avenue, Altamonte Springs, Florida 32714 ("Grantee").

WITNESSETH:

Grantor, for and in consideration of Ten Dollars (\$10.00) and other good and valuable consideration to Grantor in hand paid by Grantee, the receipt and sufficiency of which are hereby acknowledged, has granted, bargained and sold to Grantee, and Grantee's heirs, successors and assigns forever, the following described land, situated in Polk County, Florida:

**LEGAL DESCRIPTION - SEE EXHIBIT "A" ATTACHED
 HERETO AND INCORPORATED HEREIN.**

**THIS CONVEYANCE IS SUBJECT TO THE EXCEPTIONS TO
 TITLE SET FORTH ON EXHIBIT "B" ATTACHED HERETO
 AND INCORPORATED HEREIN.**

**SUBJECT to applicable land use and zoning restrictions and to
 easements, reservations and restrictions of record, if any,
 which are specifically not reimposed or extended hereby, and
 to taxes for the year 1998 and subsequent years.**

Grantor does hereby fully warrant the title to said land and will defend the same against the lawful claims of all persons whomsoever

R
 JOHNSON BLAKELY POPE RUPPELL BURNS
 ROGER A. LARSON ESQUIRE
 811 CHESTNUT ST. P O BOX 1368
 CLEARWATER, FL 33757-1368

~~CONFIDENTIAL~~

The tax parcel number for the aforescribed property is as to Parcel 1: 342623-000000-01202; and as to Parcel 2: 342623-000000-014010. tax identification number for the Grantee is 59-3530354.

IN WITNESS WHEREOF, Grantor has hereunto set Grantor's hand and seal the day and year first above written.

Signed, sealed and delivered in the presence of:

CYPRESS LAKES ASSOCIATES, LTD., a Florida limited partnership

By: Community Investment Corporation
General Partner

[Signature]

By: [Signature]
Name: M STEVEN SEMBLER
Its: V.ice President

Christian D. Regel
Print name

[Signature]

[Signature]
Print name

(Corporate Seal)

STATE OF FLORIDA)
COUNTY OF Pinellas)

The foregoing instrument was acknowledged before me this 27 day of October, 1998, by M. Steven Sembler as President of Community Investment Corporation, General Partner of CYPRESS LAKES ASSOCIATES, LTD., a Florida limited partnership, on behalf of the partnership. (He) [She] [is personally known to me] [has produced _____ as identification].

[Signature]
Notary Public
Print name Laura L. Raigoza
My commission expires: 11/06/01

09/29/98 10:14 AM d-1 #0164077.01/mme




EXHIBIT "A"

Parcel 1: Water Treatment Facility

A parcel of land lying in Section 34, Township 26 South, Range 23 East, Polk County, Florida being more particularly described as follows:

Commence at the Southeast corner of said Section 34, thence South 89 deg. 22'28" West, along the South line of said Section 34, for 208.28 feet; thence North 00 deg. 37'32" West, leaving the South line of said Section 34, for 62.58 feet to the Point of Beginning; thence North 55 deg. 35'25" West, for 11.35 feet; thence North 30 deg. 08'37" East for 20.55 feet; thence North 68 deg. 53'05" East, for 11.57 feet; thence North 04 deg. 48'35" East, for 81.93 feet; thence South 70 deg. 40'59" East, for 87.15 feet; thence South 41 deg. 58'43" East, for 24.15 feet; thence South 01 deg. 32'04" East for 38.00 feet; thence South 87 deg. 41'13" West for 101.37 feet; thence South 70 deg. 00'08" West for 7.14 feet; thence South 34 deg. 02'09" West for 21.14 feet to the Point of Beginning.

Parcel 2: Sewage Treatment Facility

A tract of land lying in Section 34, Township 26 South, Range 23 East, Polk County, Florida, being more particularly described as follows:

Commence at the Southeast corner of Section 34, Township 26 South, Range 23 East, Polk County, Florida; thence North 00 deg. 48'46" West, along the Easterly line of said Section 34, a distance of 2270.65 feet to the Southerly right of way of State Road #700 and #35, also known as U.S. Highway 98 (160 feet wide); thence North 47 deg. 17'40" West, along the Southerly right of way of said U.S. Highway 98 a distance of 1297.31 feet to a point on a curve to the right of which the radius point lies North 42 deg. 42'05" East, a radial distance of 5824.26 feet; thence along the arc in a Northwesterly direction, passing through a central angle of 06 deg. 26'52", an arc length of 655.45 feet to a point along said curve; thence South 49 deg. 08'58" West, a distance of 57.61 feet to the Point of Beginning of the Sewage Treatment Facility; thence South 10 deg. 18'32" East, a distance of 237.43 feet; thence South 02 deg. 07'38" East, a distance of 59.01 feet; thence South 53 deg. 02'17" West, a distance of 66.47 feet; thence North 43 deg. 24'57" West, a distance of 73.58 feet; thence North 36 deg. 27'45" West, a distance of 199.36 feet; thence North 74 deg. 43'47" East, a distance of 70.39 feet; thence North 27 deg. 01'16" West, a distance of 12.48 feet; thence North 52 deg. 17'35" East, a distance of 145.67 feet to the Point of Beginning.

Parcel 3

The benefits, appurtenant to Parcel 2, derived from right of way easement recorded in OR Book 3668, page 1198, Public Records of Polk County, Florida.

2011531.01

EXHIBIT "B"**EXCEPTIONS**

1. Covenants, conditions, restrictions and easements as recorded in O.R. Book 3668, Page 1174, together with such additions and amendments as from time to time may be made, and any possible charges and/or assessments, Public Records of Polk County, Florida, but deleting any covenant, condition or restriction indicating a preference, limitation or discrimination based on race, color, religion, sex, handicap, familial status, or national origin to the extent such covenants, conditions or restrictions violate 42 USC 3604(c).
2. Terms and conditions of Right of Way Easement recorded in O.R. Book 3668, Page 1198, Public Records of Polk County, Florida.
3. Covenants, conditions, restrictions and easements as recorded in O.R. Book 2922, Page 1436, as amended by O.R. Book 4004, page 484, together with such additions and amendments as from time to time may be made, and any possible charges and/or assessments, Public Records of Polk County, Florida, but deleting any covenant, condition or restriction indicating a preference, limitation or discrimination based on race, color, religion, sex, handicap, familial status, or national origin to the extent such covenants, conditions or restrictions violate 42 USC 3604(c).
4. Developers Rights contained therein Assigned by O.R. Book 3668, page 1200, and Notice recorded in O.R. Book 3612, page 1322, Public Records of Polk County, Florida.
5. Subject to easement recorded in Deed Book 660, Page 455, Public Records of Polk County, Florida.
6. Reservation of drainage easement recorded in O.R. Book 1520, Page 1124, Public Records of Polk County, Florida.
7. Subject to easement recorded in O.R. Book 2613, Page 2018, Public Records of Polk County, Florida.
8. Subject to easement recorded in O.R. Book 2613, Page 2021, Public Records of Polk County, Florida.
9. Subject to easement recorded in O.R. Book 2628, Page 1962, Public Records of Polk County, Florida.
10. Private Access Easement recorded in O.R. Book 2908, Page 995, Public Records of Polk County, Florida.
11. Subject to easement recorded in O.R. Book 3546, Page 1687, Public Records of Polk County, Florida.
12. Subject to easement recorded in O.R. Book 3546, Page 1692, Public Records of Polk County, Florida.

0167798.01/mme

GENERAL
WATER CONSERVATION PLAN
by
CYPRESS LAKES UTILITIES, INC.

TABLE OF CONTENTS

I.	PURPOSE	1
II.	WATER CONSERVATION PROGRAM AND IMPLEMENTATION SCHEDULE	1
III.	UNACCOUNTED FOR WATER REDUCTION PLAN	5
IV.	SELECTION OF CORRECTIVE MEASURES	6
V.	WATER CONSERVATION BEST MANAGEMENT PRACTICES	7
VI.	CUSTOMER CONSERVATION PROGRAMS	9
VII.	PUBLIC EDUCATION/EMPLOYEE AWARENESS	10
VIII.	WATER CONSERVATION PLAN IMPLEMENTATION SCHEDULE	11
	APPENDIX "A"	
	FLUSHING RECORD	15
	WATER LOSS RECORD	16
	METER REPLACEMENTS	17
	FIRE DEPARTMENT WATER LOSS USE	18

I. PURPOSE

The purpose of this document is to produce a water conservation plan for all of our systems operated within the Southwest Florida Water Management District. This plan will address the features of a water conservation plan which will be employed in all of our systems and will propose a timetable for implementing the various activities required to increase accountability for water consumption.

The ultimate goal of this plan is to help focus water conservation efforts by determination of system efficiencies and identification of water loss sources. Corrective action will be taken to attain a minimum discrepancy of 10 percent between water pumped and water used.

II. WATER CONSERVATION PROGRAM AND IMPLEMENTATION SCHEDULE

A. EXISTING WATER CONSERVATION ACTIVITIES

Cypress Lakes Utilities, Inc. presently practices several activities to reduce the amount of unaccounted for water. Reduction of unaccounted for water reduces withdrawal quantities and thus enhances conservation of one of Florida's most precious natural resources.

Water distribution maps are updated whenever new construction occurs in our service area. Files are maintained of the distribution systems and Monthly Operating Reports (MORs) updated on an annual basis to keep the system files current.

The billing and accounting system is computerized and records are produced every month based on the quantity of water read at the meters. Meter readings at the plant are read daily and recorded on a log.

Meter records are computerized and can be summarized based on the size of meter and customer number. This data can be used to quickly verify recorded flows and pinpoint any areas where inaccurate recordings may be prevalent.

Construction activity within our service areas oftentimes requires usage of water for various activities. To prevent excessive consumption of water, each contractor is required to obtain a meter prior to commencing water usage. All water used in the construction activity is metered and the quantity recorded at the end of the job. This activity is performed on an as-needed basis and enable us to reduce quantities of unaccounted for water consumption.

Meters not in use are locked. This activity is performed on a daily basis within our service area~' when an account becomes delinquent or inactive. Meters are removed when excessive tampering with the locks occurs or when a service becomes permanently disconnected. This activity prevents tampering with the meters and reduces quantities of unauthorized and unrecorded water consumption.

System operators monitor flow rates on a daily basis to record the water pumped into the system. Excessive pumpage is indicative of a leak and prompts a system investigation to determine whether any visible signs of leakage are evident. Customer calls to the Customer Service Representatives concerning system leakage are investigated promptly to determine whether the leakage is from our distribution and transmission system.

System pressures are monitored on a daily basis to verify that sufficient pressure is maintained in the distribution system. Low pressures signify the possibility of a leak and prompt the system operator to investigate whenever a leak has occurred. Customer calls concerning low pressure are referred by the Customer Service Representative to the operator in charge of the system. The operator proceeds to investigate the low pressure complaint to determine whether the cause is due to a system leak or blockage. Corrective action is taken as required to correct the deficiency.

Water treatment system components are cleaned as required by manufacturers recommendations for the equipment utilized. Customer complaints to the Customer Service Representative concerning excessive consumption are handled by asking specific questions concerning unusual circumstances which would increase water usage such as company, landscaping, filling of a swimming pool or other non-regular occurrences. If the cause of excessive consumption cannot be isolated then a system operator is sent to the customer to investigate.

The system operator seeks further information from the customer and investigates any obvious signs of water consumption such as new sod, evidence of leaks or other contributing factors which might lead to an increased amount of consumption. If no evidence is found, the customer is given the opportunity to have the meter field checked to verify its accuracy. On occasion, the meter is removed and sent to an independent lab for a flow check. Inaccurate meters are replaced when significant errors are detected. Water plant equipment is replaced on an as needed basis when it becomes

obsolete, treatment upgrade is required or when repair is not cost-effective.

Leaks in the production facility, transmission lines and distribution system are repaired when they are discovered by Operations personnel. Every effort is made to minimize lost water due to the main break by shutting off applicable valves to minimize water loss until the leak can be repaired. The repaired leak is checked under normal system operation parameters to verify that leakage has been eliminated before the main or item of equipment is placed back into service.

Customer complaints concerning excessive consumption result in a check of their meters by operations personnel and a check for system leaks. If a system leak is responsible then repairs are promptly executed. A customer is responsible for any repairs to their plumbing.

B. Water Use Efficiency Assessment

Water use is assessed on a yearly basis for each system. Data for the year is included as a MOR summary with each individual system's water audit. Distribution system maps are updated as changes to the system occur. Information on the distribution system pipe sizes, quantities and lengths can be obtained by consulting the annual reports prepared for the Public Service Commission.

Most systems are self-contained and no interconnections occur with other suppliers. Water sold is produced from the system wells. These are deep wells and pump through the treatment plant into hydropneumatic tanks prior to entering the distribution system. The number of wells varies by system. No surface water sources are used to supplement water supplies in any of our systems.

All water flow from the wells to the distribution system is metered. Meter accuracy varies by the type of meter used but falls within the limits listed in the table below:

METER TYPE	ACCURACY LIMITS IN PERCENT			
	MAXIMUM RATE	INTERMEDIATE RATE	REPAIRED	
Displacement	98.5-101.5	98.5-101.5	95-101.5	90-101.5
current	97-103	97-103	95-103	90-103
compound*	97-103	97-103	97-103	90-103

- The minimum required accuracy for compound meters at any rate within the "changeover" range of flows shall be 85%.

Meter log books and totalizer records are recorded on a monthly basis. Customer meters are tested in the field by system operators

and replaced when accuracy limits exceed the tolerance listed above. Field test meters are currently in use to increase the efficiency and frequency of meter testing.

Presently water loss due to inaccurate meters is not adjusted unless accuracy exceeds the limits in the table above. Adjustments to the customers are made on their next bill. The amount of adjustments has historically been small and does not seem to have a significant impact on unaccounted for water quantities.

The predominant users in our systems are residential with a small percentage of commercial users. Meters at these commercial facilities are replaced when calibration data indicates the meter is outside the accuracy tolerance limits. Testing meters have been purchased in order to implement a testing program.

Residential water sales and other uses are metered in each system. Meter readings are accomplished monthly and data logged into the computer. Water usage complaints are handled by the customer service representative and relayed to the Area Manager. These customer complaints for excessive usage are tested for leaks and adjustments made to the customers bills as required. Residential water consumption for each system is shown on the MOR summary sheets for each service area.

Billing procedures are reviewed as needed and adjustments made if conditions warrant. Leaks are detected and repaired if they are within our distribution system. Customer leaks are determined and the customer informed. The customer is responsible for repairing leakage within their structure.

Unaccounted for water is defined as the difference between the quantity of water pumped and the quantity of water sold. Areas where the discrepancy between water pumped and water sold exceeds 10 percent will incorporate the elements of the Unaccounted for Water Procedure included as part of the general water conservation plan.

III. UNACCOUNTED FOR WATER REDUCTION PLAN

Unaccounted for water (UFW) is the difference between the amount of water a utility produces and the amount of water that it can account for in sales and other known uses for a given period. Unaccounted for water can result from:

- (a) inaccurate or incomplete record-keeping
- (b) meter error, stuck meters
- (c) leaks, breaks
- (d) unmetered uses, such as fire fighting, line flushing, irrigation, plant use, lift station use, and
- (e) water theft or unauthorized use.

UFW should be reduced to a minimal level to reduce production and maintenance costs associated with water loss and to increase the Company's earning potential. The Florida Public Service Commission allows up to 10 per cent unaccounted for water. If our UFW percentage is over the allowable 10 percent, the Commission deducts operating expenses for the gallons not accounted for.

It is the responsibility of the Area Manager to assure that:

1. accurate and complete records are maintained
2. problems associated with UFW are corrected immediately
3. the forms are accurately completed
4. the forms are attached to the MORs and forwarded to the Regional Operations Manager in Altamonte Springs
5. problems are researched and documented and corrective action is taken as quickly as possible.

Accurate and detailed record-keeping is the basis for accounting for the Utility's water. Record-keeping includes three components:

1. the utility's billing system and metered uses
2. estimates and records of unmetered water used to fill tank trucks, fire department use, cleaning flushing, draining tanks, washdowns
3. leaks, breaks and meter change records.

The following procedure will allow for accurate and timely determinations to be made regarding water uses and losses.

Flushing Record is to be used whenever lines, hydrants, tanks, etc. are flushed.

Water Loss Record is to be used whenever there are line/main/service breaks and whenever a meter is changed out.

A sample of these forms is included to illustrate its use. Sample forms are in Appendix "A" of this report. All applicable sections should be filled in on a daily basis for each occurrence of the aforementioned items.

Fire Department Water Form Use is to be forwarded to the fire departments that use water produced by our facilities. A sample of this form is included. It will be forwarded to the fire departments along with a letter requesting that the form be used and forwarded to the Area Manager by the 15th day of the following month.

The forms outlined above must be filled out by all applicable

personnel, attached to the monthly MORs and forwarded to the Regional Operations Manager by the 20th of the month following completion of the MORs.

The Customer Service Representative will provide a water sold report to the Operations Assistant as the systems are billed. The Operations Assistant will coordinate sold gallons to water produced and calculate UFW gallons and percentages using the MORs, other use information provided the field personnel and the reports received from the Customer Service Representative.

Any system that reflects a significant fluctuation or a negative percentage and/or a percentage over 10 must be analyzed and investigated. The Operations Assistant will forward a copy of the problem system's data to the Vice President or Regional Operations Manager who will determine the UFW problem. If the field personnel need assistance in determining the cause, they will request help from the Area Manager, Regional Operations Manager and/or Vice President. When the problem has been determined, the cause and corrective action will be documented and forwarded to the Regional Operations Manager. When possible, the information will be corrected and updated data will be distributed.

IV. SELECTION OF CORRECTIVE MEASURES

The Frequency of Activity table in the Water Conservation Plan is presented on the following page of this plan in order to graphically illustrate those items which have been implemented and which will be implemented. This plan is to be utilized for all systems within the Southwest Florida Water Management District. Items marked with a "P" in this table are explained and an implementation timetable is given. Items marked with "I" have already been implemented.

FREQUENCY OF ACTIVITY TABLE

FREQUENCY OF ACTIVITY						ACTIVITY
Weekly	Monthly	Yearly	Other	Not Feasible	Not Applicable	
					X	Update utility master plan
		I				Update water distribution maps
		P				Repeat water use efficiency assessment
	I					Computerize billing & accounting system
		P				Inspect and recalibrate all master meters
	I					Computerize records for each meter by type, size, serial # usage, repair history, etc.
		P				Establish use logs with fire departments
					X	Install fire line use meters in buildings
					X	Recalibrate all domestic meters prior to overhaul
				X		Telemeter system controls
			P			Install taps for in-line testing of meters over 3"
					X	Cover all finished water reservoirs
					X	Provide convenient source of water for const. contractors
			I			Require contractors to use portable meters
				X		Increase frequency of meter reading
I						Lock or remove meters not in use
	I					Monitor flow rates for leak and clog detection system wide
	I					Monitor sys. pressures for leak and clog detection sys.wide
			I			Clean sys. components (seals, valves, filters, meters, etc.)
				X		Check line pressure system-wide
			I			Repair leaks in production facility
			I			Repair leaks in transmission lines
			I			Repair leaks in distribution system
			I			Detect and repair customer site leaks
				X		Establish a water main replacement program
						Other (please explain)

Repeat water use efficiency assessment. This item to the review of records to determine whether our water pumped and water billed limits fall within acceptable limits. Our goal is to achieve no more than a 10% discrepancy between these figures.

Inspect and recalibrate all master meters. This item refers to the totalizing flow meters presently used at our water plant sites. Presently, these meters are not calibrated on a regular basis and they may not be accurately measuring the amount of water actually pumped into the distribution system. Presently meters are inspected annually.

Establish use logs with fire departments. Logs have been prepared to distribute to fire departments. These will be mailed to each fire department in our service area with an explanatory letter defining its purpose. A copy of the proposed use log is shown in Appendix "A".

Install taps for in-line testing of meters over three inches. This item will be performed in conjunction with the recalibration of master meter program. Taps will be installed in the lines when the calibration of the meter occurs. It is anticipated that taps can be installed on all plant flow meters within a 7 year time frame.

V. WATER CONSERVATION BEST MANAGEMENT PRACTICES

A. Production Facility Process Water

Water treatment plants situated within the service areas covered by this water conservation plan contain the following basic elements: wells, disinfection using chlorine and a hydropneumatic tank. The predominant water usage within all of the plants is for chlorination. Water is drawn from the piping downstream from the meter and also injected downstream from the meter. There is no unaccounted for water in this process.

B. Water Use Monitoring

The raw water supply from the wells is monitored using a flow meter. Recent checks of the meter by SWFWMD indicated that the meter was recording high. Piping will need to be reconfigured or a different style of meter selected in order to increase accuracy.

VI. CUSTOMER CONSERVATION PROGRAMS

A. Water Audits

Water audits play an important role in developing increased customer awareness of water usage by various facilities in the home. We do not possess the manpower to perform these audits for our customers but are proposing to implement a program to assist the customer in determining their own usages.

Attached to this general water conservation plan for all systems is a copy of a form distributed by the Water Management District to assist the customer in estimating their water consumption. A copy of the form titled "Home Water Use" is presented in appendix A of this document. Initially, this document will be sent to those customers who call our office complaining of high water bills, with an explanation for the purpose of the literature. We anticipate that the increased awareness by the customer of where the water goes will lead to individual conservation efforts in order to reduce their monthly billing rate. We believe that initially targeting this group will result in the greatest benefit as these customers will be more inclined to reduce consumption.

Customer complaints concerning high consumption are presently investigated by our operations staff. Individual meters are equipped such that leakage can be ascertained by our staff. Leakage which is due to our distribution system is repaired immediately. The customer is kept informed of the results of our investigation and promptly notified if the leak is determined to be within their system. This notification enables the customer to arrange for their own repairs without unnecessary delay resulting in a decrease of wasted water.

B. Domestic Plumbing Retrofitting Programs

Presently we are preparing to distribute conservation kits to our customers as the need dictates. We have received literature from various companies which manufacture the devices and have investigated the items to be furnished and the ease of installation of each kit. Initially, these kits will be distributed to those customers complaining of excessive usage or have expressed an interest in conserving water. Although we do not have the personnel to install the kits for these customers, we believe that this type of customer would be most likely to install or arrange for installation of the devices.

C. Non-Domestic Retrofitting Programs for Large Volume Users of Water

Systems served by our company are predominantly residential in scope. Non-domestic systems primarily consist of small businesses which are serviced by 2-inch or less meters. Large volume users in our system are primarily for irrigation and a retrofitting plan does not apply.

D. New Construction Programs

Utility systems owned and operated by our firm are predominantly built out. We generally acquire a system from the developer near the end of subdivision construction which does not give us the opportunity to provide construction water conservation incentives. Meters are provided to contractors for individual homesite construction and water usage recorded. This item is not applicable for our situation.

E. Outdoor Conservation Programs for Customers

Presently we provide xeriscaping information at our office for those customers interested in this type of landscaping. The literature that we provide is the Southwest Florida Water Management District Plant Guide. This booklet contains much useful information pertaining to drought tolerant plants such as shape, height, growth rate, salt tolerance, water requirements and other useful information required for a customer to make an appropriate plant selection to meet their landscaping requirements. This literature is provided upon request to our customers.

VII. PUBLIC EDUCATION / EMPLOYEE AWARENESS

A. Existing Activities

Within the Southwest Florida Water Management DL area the extent of our employees is limited which direct bearing on the types of programs we presently offer. Water bills are processed on a monthly basis and consist of post-cards which are mailed to our customers. Use of bill stuffers is not practical with the type of billing system that we currently utilize.

Our facilities are predominantly residential and most of them are built out. As a result of our system demographics, any public awareness and conservation efforts must be directed to current users to be most effective. Presently, we do not conduct any public education programs but we do plan to increase our efforts in this direction as

circumstances permit. Upon request, we do conduct tours of our water and wastewater facilities for those individuals or groups interested in our facilities. Public tours help to increase the knowledge of those who participate in the event and, hopefully, lead to increased quality of relationships between us and our customers.

B. Proposed Activities

As mentioned in the previous section, we are increasing our efforts to increase customer awareness of water usage. Literature pertaining to water usage will be given to those customers who complain of high bills in order to help them become more aware of their usage habits and help them in their conservation efforts. This literature is the "Home Water Use" survey as published by the water management district. Because the largest majority of our users are residential, it is believed that this document would provide the most effect in reducing water consumption.

Many customers are not aware of the water use restrictions which govern their consumption of water. This is especially true for those people who are moving to this area from other states where restrictions are uncommon. We believe that it is beneficial to make these new citizens aware of the water restrictions imposed within their service area and will distribute a summary of these rules to each new customer when they obtain service.

VIII. WATER CONSERVATION PLAN IMPLEMENTATION SCHEDULE

A. General

This water conservation plan is proposed for all of our systems within the jurisdiction of the Southwest Florida Water Management District. Several water conserving efforts are already practiced by our firm and have been shown as implemented in previous sections of this document. The implementation schedule in this report covers those items which have identified as plan to implement (P) in previous sections of this plan summary of these items and their implementation is presented in part B of this section.

B. Implementation Schedule Summary

Repeat water use efficiency assessment .Water use records will be reviewed annually to determine whether the discrepancy between pumped and accounted for water exceeds 10%.

Inspect and Recalibrate all Master Meters .Master meters are defined as those meters which measure the quantity of water pumped from a well. Presently meters are inspected annually but are not calibrated. Broken meters are replaced when they are discovered.

Establish Use Logs with Fire Departments .Presently our systems are situated outside of municipalities and the fire departments serving these areas vary. Water used within the service areas will be predominantly for testing of hydrants and occasionally for fire fighting. A use log as shown in Appendix A will be distributed to fire departments in order to achieve greater accountability for water used by this source. These logs and an explanation of their purpose will be distributed to various fire departments.

Establish Flushing and Water Loss Records .Proposed forms to be used to quantify these quantities are presented in Appendix A of this report. Operators will provide estimates of the water used on a monthly. Quantities of water used for these purposes will be combined with quantity sold in order to better control the unaccounted for portion of water in each distribution system. These forms will provide a more accurate estimation of water used for these purposes which, we believe, constitutes the greatest portion of our unsold water.

Use Special Mailings to Provide Water Conservation Tips and Information to Our Customers .A copy of the form titled "Home Water Use" will be distributed to those customers complaining of high water bills. We anticipate that these customers will be most likely to use the form because they have expressed an interest in their water consumption and are financially motivated to reduce it

Distribute Plumbing Conservation Kits - We contacted various manufacturers of these kits and already have a kit for distribution. The kit to be distributed contains tablets for leak detection, a toilet tank bag to reduce the quantity of water used in each flush, shower head water savers and instructions for installation. These kits are being distributed to those customers complaining of excessive consumption or to those interested in water conservation.

Distribute Water Conservation Rules - A summary of the water management district conservation rules will be given to our new customers upon initiation of service. This literature will be most beneficial to them because many have relocated to our area from other states where conservation rules are non existent

WATER CONSERVATION PLAN APPENDIX A

Item 3: Water System Data

Month/Yr	Customer Class	Meter Size	No of Bills	Monthly Water Gallons Sold		
				Gals Sold Block 1 (000's)	Gals Sold Block 2 (000's)	Gals Sold Block 3 (000's)
January 2004	Residential	5/8"	1175	2424	1804	318
February 2004	Residential	5/8"	1177	2831	1073	276
March 2004	Residential	5/8"	1187	2864	1215	160
April 2004	Residential	5/8"	1196	2544	2466	350
May 2004	Residential	5/8"	1183	2489	1957	423
June 2004	Residential	5/8"	1189	1916	2836	635
July 2004	Residential	5/8"	1183	2047	1789	427
August 2004	Residential	5/8"	1190	2063	857	266
September 2004	Residential	5/8"	1186	2014	515	78
October 2004	Residential	5/8"	1190	1998	415	107
November 2004	Residential	5/8"	1189	2388	1092	126
December 2004	Residential	5/8"	1194	2315	2303	618
January 2005	Residential	5/8"	1228	2514	1506	247
February 2005	Residential	5/8"	1225	2817	1281	311
March 2005	Residential	5/8"	1233	2731	1955	357
April 2005	Residential	5/8"	1242	2674	2192	431
May 2005	Residential	5/8"	1262	2549	2004	369
June 2005	Residential	5/8"	1262	2250	1363	402
July 2005	Residential	5/8"	1258	2135	702	326
August 2005	Residential	5/8"	1265	1967	451	224
September 2005	Residential	5/8"	1259	2075	1199	652
October 2005	Residential	5/8"	1265	2197	968	368
November 2005	Residential	5/8"	1287	2478	835	219
December 2005	Residential	5/8"	1284	2651	1566	346
January 2006	Residential	5/8"	1309	2744	929	199
February 2006	Residential	5/8"	1295	2913	1395	311
March 2006	Residential	5/8"	1305	2958	1672	210
April 2006	Residential	5/8"	1351	2388	3438	1058
May 2006	Residential	5/8"	1364	2206	3587	1427
June 2006	Residential	5/8"	1355	2018	3074	1607
July 2006	Residential	5/8"	1367	2318	1710	920
August 2006	Residential	5/8"	1363	2146	1082	442
September 2006	Residential	5/8"	1368	2114	1083	455
October 2006	Residential	5/8"	1373	2265	1079	245
November 2006	Residential	5/8"	1378	2338	2456	799
December 2006	Residential	5/8"	1381	2568	2407	853
January 2007	Residential	5/8"	1385	2777	1835	403
February 2007	Residential	5/8"	1390	3000	2104	263
March 2007	Residential	5/8"	1390	3151	1493	192
April 2007	Residential	5/8"	1397	2895	2848	523
May 2007	Residential	5/8"	1405	3047	2010	680
June 2007	Residential	5/8"	1396	2353	2747	872
July 2007	Residential	5/8"	1397	2348	1116	445
August 2007	Residential	5/8"	1398	2366	945	442
September 2007	Residential	5/8"	1401	2332	1012	182
October 2007	Residential	5/8"	1400	2388	691	161
November 2007	Residential	5/8"	1411	2810	1114	252
December 2007	Residential	5/8"	1421	2939	1508	428
January 2008	Residential	5/8"	1412	3003	1820	200
February 2008	Residential	5/8"	1408	3317	1245	143
March 2008	Residential	5/8"	1406	3264	1341	129
April 2008	Residential	5/8"	1411	3340	1320	187
May 2008	Residential	5/8"	1416	3179	1473	200
June 2008	Residential	5/8"	1404	2311	2376	657
July 2008	Residential	5/8"	1409	2367	1604	737
August 2008	Residential	5/8"	1414	2213	594	243
September 2008	Residential	5/8"	1416	2202	779	214
October 2008	Residential	5/8"	1425	2389	1417	286
November 2008	Residential	5/8"	1417	2692	1238	240
December 2008	Residential	5/8"	1426	2998	1308	253
January 2004	General Service	5/8"	2	16 N/A	N/A	
February 2004	General Service	5/8"	2	9 N/A	N/A	
March 2004	General Service	5/8"	2	33 N/A	N/A	
April 2004	General Service	5/8"	2	38 N/A	N/A	
May 2004	General Service	5/8"	2	10 N/A	N/A	
June 2004	General Service	5/8"	2	30 N/A	N/A	
July 2004	General Service	5/8"	2	27 N/A	N/A	

Item 3: Water System Data

Month/Yr	Customer Class	Meter Size	No of Bills	Monthly Water Gallons Sold		
				Gals Sold Block 1 (000's)	Gals Sold Block 2 (000's)	Gals Sold Block 3 (000's)
August 2004	General Service	5/8"	2	14	N/A	N/A
September 2004	General Service	5/8"	2	5	N/A	N/A
October 2004	General Service	5/8"	2	4	N/A	N/A
November 2004	General Service	5/8"	2	23	N/A	N/A
December 2004	General Service	5/8"	2	32	N/A	N/A
January 2005	General Service	5/8"	2	21	N/A	N/A
February 2005	General Service	5/8"	2	24	N/A	N/A
March 2005	General Service	5/8"	2	24	N/A	N/A
April 2005	General Service	5/8"	2	28	N/A	N/A
May 2005	General Service	5/8"	2	26	N/A	N/A
June 2005	General Service	5/8"	2	23	N/A	N/A
July 2005	General Service	5/8"	2	19	N/A	N/A
August 2005	General Service	5/8"	2	10	N/A	N/A
September 2005	General Service	5/8"	2	26	N/A	N/A
October 2005	General Service	5/8"	2	19	N/A	N/A
November 2005	General Service	5/8"	2	20	N/A	N/A
December 2005	General Service	5/8"	2	24	N/A	N/A
January 2006	General Service	5/8"	2	20	N/A	N/A
February 2006	General Service	5/8"	2	21	N/A	N/A
March 2006	General Service	5/8"	2	20	N/A	N/A
April 2006	General Service	5/8"	2	22	N/A	N/A
May 2006	General Service	5/8"	2	19	N/A	N/A
June 2006	General Service	5/8"	2	16	N/A	N/A
July 2006	General Service	5/8"	2	13	N/A	N/A
August 2006	General Service	5/8"	2	6	N/A	N/A
September 2006	General Service	5/8"	2	11	N/A	N/A
October 2006	General Service	5/8"	2	8	N/A	N/A
November 2006	General Service	5/8"	2	19	N/A	N/A
December 2006	General Service	5/8"	4	66	N/A	N/A
January 2007	General Service	5/8"	4	41	N/A	N/A
February 2007	General Service	5/8"	4	45	N/A	N/A
March 2007	General Service	5/8"	4	29	N/A	N/A
April 2007	General Service	5/8"	4	68	N/A	N/A
May 2007	General Service	5/8"	4	58	N/A	N/A
June 2007	General Service	5/8"	4	49	N/A	N/A
July 2007	General Service	5/8"	4	28	N/A	N/A
August 2007	General Service	5/8"	4	30	N/A	N/A
September 2007	General Service	5/8"	4	23	N/A	N/A
October 2007	General Service	5/8"	4	10	N/A	N/A
November 2007	General Service	5/8"	4	37	N/A	N/A
December 2007	General Service	5/8"	4	27	N/A	N/A
January 2008	General Service	5/8"	4	26	N/A	N/A
February 2008	General Service	5/8"	4	19	N/A	N/A
March 2008	General Service	5/8"	4	24	N/A	N/A
April 2008	General Service	5/8"	4	33	N/A	N/A
May 2008	General Service	5/8"	4	21	N/A	N/A
June 2008	General Service	5/8"	20	48	N/A	N/A
July 2008	General Service	5/8"	20	28	N/A	N/A
August 2008	General Service	5/8"	20	17	N/A	N/A
September 2008	General Service	5/8"	20	14	N/A	N/A
October 2008	General Service	5/8"	20	15	N/A	N/A
November 2008	General Service	5/8"	20	20	N/A	N/A
December 2008	General Service	5/8"	20	26	N/A	N/A
January 2004	General Service	1"	1	65	N/A	N/A
February 2004	General Service	1"	1	57	N/A	N/A
March 2004	General Service	1"	1	60	N/A	N/A
April 2004	General Service	1"	1	65	N/A	N/A
May 2004	General Service	1"	1	46	N/A	N/A
June 2004	General Service	1"	1	61	N/A	N/A
July 2004	General Service	1"	1	92	N/A	N/A
August 2004	General Service	1"	1	68	N/A	N/A
September 2004	General Service	1"	1	54	N/A	N/A
October 2004	General Service	1"	1	71	N/A	N/A
November 2004	General Service	1"	1	65	N/A	N/A
December 2004	General Service	1"	1	61	N/A	N/A
January 2005	General Service	1"	1	38	N/A	N/A
February 2005	General Service	1"	1	52	N/A	N/A

Item 3: Water System Data

Month/Yr	Customer Class	Meter Size	No of Bills	Monthly Water Gallons Sold		
				Gals Sold Block 1 (000' s)	Gals Sold Block 2 (000' s)	Gals Sold Block 3 (000' s)
March 2005	General Service	1"	1	35	N/A	N/A
April 2005	General Service	1"	1	45	N/A	N/A
May 2005	General Service	1"	1	41	N/A	N/A
June 2005	General Service	1"	1	57	N/A	N/A
July 2005	General Service	1"	1	37	N/A	N/A
August 2005	General Service	1"	1	39	N/A	N/A
September 2005	General Service	1"	1	58	N/A	N/A
October 2005	General Service	1"	1	51	N/A	N/A
November 2005	General Service	1"	1	46	N/A	N/A
December 2005	General Service	1"	1	34	N/A	N/A
January 2006	General Service	1"	1	35	N/A	N/A
February 2006	General Service	1"	1	32	N/A	N/A
March 2006	General Service	1"	1	19	N/A	N/A
April 2006	General Service	1"	1	38	N/A	N/A
May 2006	General Service	1"	1	39	N/A	N/A
June 2006	General Service	1"	1	38	N/A	N/A
July 2006	General Service	1"	1	41	N/A	N/A
August 2006	General Service	1"	1	47	N/A	N/A
September 2006	General Service	1"	1	55	N/A	N/A
October 2006	General Service	1"	1	52	N/A	N/A
November 2006	General Service	1"	1	47	N/A	N/A
December 2006	General Service	1"	1	38	N/A	N/A
January 2007	General Service	1"	1	45	N/A	N/A
February 2007	General Service	1"	1	43	N/A	N/A
March 2007	General Service	1"	1	37	N/A	N/A
April 2007	General Service	1"	1	44	N/A	N/A
May 2007	General Service	1"	1	44	N/A	N/A
June 2007	General Service	1"	1	41	N/A	N/A
July 2007	General Service	1"	1	46	N/A	N/A
August 2007	General Service	1"	1	41	N/A	N/A
September 2007	General Service	1"	1	42	N/A	N/A
October 2007	General Service	1"	1	43	N/A	N/A
November 2007	General Service	1"	1	40	N/A	N/A
December 2007	General Service	1"	1	33	N/A	N/A
January 2008	General Service	1"	1	33	N/A	N/A
February 2008	General Service	1"	1	31	N/A	N/A
March 2008	General Service	1"	1	36	N/A	N/A
April 2008	General Service	1"	1	48	N/A	N/A
May 2008	General Service	1"	1	63	N/A	N/A
June 2008	General Service	1"	15	33	N/A	N/A
July 2008	General Service	1"	16	179	N/A	N/A
August 2008	General Service	1"	16	57	N/A	N/A
September 2008	General Service	1"	16	47	N/A	N/A
October 2008	General Service	1"	16	49	N/A	N/A
November 2008	General Service	1"	16	49	N/A	N/A
December 2008	General Service	1"	16	49	N/A	N/A
January 2004	General Service	1.5"	2	83	N/A	N/A
February 2004	General Service	1.5"	2	75	N/A	N/A
March 2004	General Service	1.5"	2	76	N/A	N/A
April 2004	General Service	1.5"	2	119	N/A	N/A
May 2004	General Service	1.5"	2	99	N/A	N/A
June 2004	General Service	1.5"	2	114	N/A	N/A
July 2004	General Service	1.5"	2	82	N/A	N/A
August 2004	General Service	1.5"	2	76	N/A	N/A
September 2004	General Service	1.5"	2	69	N/A	N/A
October 2004	General Service	1.5"	2	128	N/A	N/A
November 2004	General Service	1.5"	2	115	N/A	N/A
December 2004	General Service	1.5"	2	147	N/A	N/A
January 2005	General Service	1.5"	2	149	N/A	N/A
February 2005	General Service	1.5"	2	88	N/A	N/A
March 2005	General Service	1.5"	2	25	N/A	N/A
April 2005	General Service	1.5"	2	184	N/A	N/A
May 2005	General Service	1.5"	2	83	N/A	N/A
June 2005	General Service	1.5"	2	66	N/A	N/A
July 2005	General Service	1.5"	2	70	N/A	N/A
August 2005	General Service	1.5"	2	62	N/A	N/A
September 2005	General Service	1.5"	2	59	N/A	N/A

Item 3: Water System Data

Month/Yr	Customer Class	Meter Size	No of Bills	Monthly Water Gallons Sold		
				Gals Sold Block 1 (000' s)	Gals Sold Block 2 (000' s)	Gals Sold Block 3 (000' s)
October 2005	General Service	1.5"	2	58	N/A	N/A
November 2005	General Service	1.5"	2	59	N/A	N/A
December 2005	General Service	1.5"	2	68	N/A	N/A
January 2006	General Service	1.5"	3	150	N/A	N/A
February 2006	General Service	1.5"	2	97	N/A	N/A
March 2006	General Service	1.5"	2	106	N/A	N/A
April 2006	General Service	1.5"	2	114	N/A	N/A
May 2006	General Service	1.5"	1	90	N/A	N/A
June 2006	General Service	1.5"	1	64	N/A	N/A
July 2006	General Service	1.5"	1	55	N/A	N/A
August 2006	General Service	1.5"	1	49	N/A	N/A
September 2006	General Service	1.5"	1	41	N/A	N/A
October 2006	General Service	1.5"	1	32	N/A	N/A
November 2006	General Service	1.5"	1	61	N/A	N/A
December 2006	General Service	1.5"	1	44	N/A	N/A
January 2007	General Service	1.5"	1	55	N/A	N/A
February 2007	General Service	1.5"	1	59	N/A	N/A
March 2007	General Service	1.5"	2	70	N/A	N/A
April 2007	General Service	1.5"	2	247	N/A	N/A
May 2007	General Service	1.5"	2	66	N/A	N/A
June 2007	General Service	1.5"	2	74	N/A	N/A
July 2007	General Service	1.5"	2	53	N/A	N/A
August 2007	General Service	1.5"	2	51	N/A	N/A
September 2007	General Service	1.5"	3	46	N/A	N/A
October 2007	General Service	1.5"	1	37	N/A	N/A
November 2007	General Service	1.5"	1	55	N/A	N/A
December 2007	General Service	1.5"	1	44	N/A	N/A
January 2008	General Service	1.5"	1	53	N/A	N/A
February 2008	General Service	1.5"	1	60	N/A	N/A
March 2008	General Service	1.5"	1	71	N/A	N/A
April 2008	General Service	1.5"	1	65	N/A	N/A
May 2008	General Service	1.5"	1	67	N/A	N/A
June 2008	General Service	1.5"	4	248	N/A	N/A
July 2008	General Service	1.5"	4	97	N/A	N/A
August 2008	General Service	1.5"	4	149	N/A	N/A
September 2008	General Service	1.5"	4	123	N/A	N/A
October 2008	General Service	1.5"	4	105	N/A	N/A
November 2008	General Service	1.5"	4	92	N/A	N/A
December 2008	General Service	1.5"	4	102	N/A	N/A
January 2004	General Service Irrigation	5/8"	15	24	N/A	N/A
February 2004	General Service Irrigation	5/8"	15	7	N/A	N/A
March 2004	General Service Irrigation	5/8"	15	4	N/A	N/A
April 2004	General Service Irrigation	5/8"	15	15	N/A	N/A
May 2004	General Service Irrigation	5/8"	15	25	N/A	N/A
June 2004	General Service Irrigation	5/8"	15	31	N/A	N/A
July 2004	General Service Irrigation	5/8"	15	27	N/A	N/A
August 2004	General Service Irrigation	5/8"	15	8	N/A	N/A
September 2004	General Service Irrigation	5/8"	15	12	N/A	N/A
October 2004	General Service Irrigation	5/8"	15	0	N/A	N/A
November 2004	General Service Irrigation	5/8"	15	1	N/A	N/A
December 2004	General Service Irrigation	5/8"	15	15	N/A	N/A
January 2005	General Service Irrigation	5/8"	15	21	N/A	N/A
February 2005	General Service Irrigation	5/8"	15	10	N/A	N/A
March 2005	General Service Irrigation	5/8"	15	5	N/A	N/A
April 2005	General Service Irrigation	5/8"	15	8	N/A	N/A
May 2005	General Service Irrigation	5/8"	15	20	N/A	N/A
June 2005	General Service Irrigation	5/8"	15	20	N/A	N/A
July 2005	General Service Irrigation	5/8"	15	3	N/A	N/A
August 2005	General Service Irrigation	5/8"	15	26	N/A	N/A
September 2005	General Service Irrigation	5/8"	15	5	N/A	N/A
October 2005	General Service Irrigation	5/8"	16	13	N/A	N/A
November 2005	General Service Irrigation	5/8"	16	36	N/A	N/A
December 2005	General Service Irrigation	5/8"	16	4	N/A	N/A
January 2006	General Service Irrigation	5/8"	16	5	N/A	N/A
February 2006	General Service Irrigation	5/8"	16	7	N/A	N/A
March 2006	General Service Irrigation	5/8"	16	9	N/A	N/A
April 2006	General Service Irrigation	5/8"	16	10	N/A	N/A

Item 3: Water System Data

Month/Yr	Customer Class	Meter Size	No of Bills	Monthly Water Gallons Sold		
				Gals Sold Block 1 (000's)	Gals Sold Block 2 (000's)	Gals Sold Block 3 (000's)
May 2006	General Service Irrigation	5/8"	16	42	N/A	N/A
June 2006	General Service Irrigation	5/8"	16	37	N/A	N/A
July 2006	General Service Irrigation	5/8"	16	13	N/A	N/A
August 2006	General Service Irrigation	5/8"	16	3	N/A	N/A
September 2006	General Service Irrigation	5/8"	16	10	N/A	N/A
October 2006	General Service Irrigation	5/8"	16	2	N/A	N/A
November 2006	General Service Irrigation	5/8"	16	79	N/A	N/A
December 2006	General Service Irrigation	5/8"	16	9	N/A	N/A
January 2007	General Service Irrigation	5/8"	16	11	N/A	N/A
February 2007	General Service Irrigation	5/8"	16	4	N/A	N/A
March 2007	General Service Irrigation	5/8"	16	12	N/A	N/A
April 2007	General Service Irrigation	5/8"	16	29	N/A	N/A
May 2007	General Service Irrigation	5/8"	16	25	N/A	N/A
June 2007	General Service Irrigation	5/8"	16	25	N/A	N/A
July 2007	General Service Irrigation	5/8"	16	3	N/A	N/A
August 2007	General Service Irrigation	5/8"	16	5	N/A	N/A
September 2007	General Service Irrigation	5/8"	16	7	N/A	N/A
October 2007	General Service Irrigation	5/8"	16	5	N/A	N/A
November 2007	General Service Irrigation	5/8"	16	1	N/A	N/A
December 2007	General Service Irrigation	5/8"	16	6	N/A	N/A
January 2008	General Service Irrigation	5/8"	16	6	N/A	N/A
February 2008	General Service Irrigation	5/8"	16	6	N/A	N/A
March 2008	General Service Irrigation	5/8"	16	3	N/A	N/A
April 2008	General Service Irrigation	5/8"	16	7	N/A	N/A
May 2008	General Service Irrigation	5/8"	16	7	N/A	N/A
June 2008	General Service Irrigation	5/8"	0	0	N/A	N/A
July 2008	General Service Irrigation	5/8"	0	0	N/A	N/A
August 2008	General Service Irrigation	5/8"	0	0	N/A	N/A
September 2008	General Service Irrigation	5/8"	0	0	N/A	N/A
October 2008	General Service Irrigation	5/8"	0	0	N/A	N/A
November 2008	General Service Irrigation	5/8"	0	0	N/A	N/A
December 2008	General Service Irrigation	5/8"	0	0	N/A	N/A
January 2004	General Service Irrigation	1"	14	0	N/A	N/A
February 2004	General Service Irrigation	1"	14	3	N/A	N/A
March 2004	General Service Irrigation	1"	14	1	N/A	N/A
April 2004	General Service Irrigation	1"	14	4	N/A	N/A
May 2004	General Service Irrigation	1"	14	4	N/A	N/A
June 2004	General Service Irrigation	1"	14	8	N/A	N/A
July 2004	General Service Irrigation	1"	14	4	N/A	N/A
August 2004	General Service Irrigation	1"	14	2	N/A	N/A
September 2004	General Service Irrigation	1"	14	0	N/A	N/A
October 2004	General Service Irrigation	1"	14	0	N/A	N/A
November 2004	General Service Irrigation	1"	14	4	N/A	N/A
December 2004	General Service Irrigation	1"	14	5	N/A	N/A
January 2005	General Service Irrigation	1"	14	12	N/A	N/A
February 2005	General Service Irrigation	1"	14	11	N/A	N/A
March 2005	General Service Irrigation	1"	14	12	N/A	N/A
April 2005	General Service Irrigation	1"	14	18	N/A	N/A
May 2005	General Service Irrigation	1"	14	10	N/A	N/A
June 2005	General Service Irrigation	1"	14	2	N/A	N/A
July 2005	General Service Irrigation	1"	14	0	N/A	N/A
August 2005	General Service Irrigation	1"	14	0	N/A	N/A
September 2005	General Service Irrigation	1"	14	2	N/A	N/A
October 2005	General Service Irrigation	1"	14	8	N/A	N/A
November 2005	General Service Irrigation	1"	14	13	N/A	N/A
December 2005	General Service Irrigation	1"	14	15	N/A	N/A
January 2006	General Service Irrigation	1"	14	3	N/A	N/A
February 2006	General Service Irrigation	1"	14	5	N/A	N/A
March 2006	General Service Irrigation	1"	14	17	N/A	N/A
April 2006	General Service Irrigation	1"	14	20	N/A	N/A
May 2006	General Service Irrigation	1"	14	19	N/A	N/A
June 2006	General Service Irrigation	1"	14	19	N/A	N/A
July 2006	General Service Irrigation	1"	14	8	N/A	N/A
August 2006	General Service Irrigation	1"	14	1	N/A	N/A
September 2006	General Service Irrigation	1"	14	0	N/A	N/A
October 2006	General Service Irrigation	1"	14	1	N/A	N/A
November 2006	General Service Irrigation	1"	14	3	N/A	N/A

Item 3: Water System Data

Month/Yr	Customer Class	Meter Size	No of Bills	Monthly Water Gallons Sold		
				Gals Sold Block 1 (000' s)	Gals Sold Block 2 (000' s)	Gals Sold Block 3 (000' s)
December 2006	General Service Irrigation	1"	14	3 N/A	N/A	N/A
January 2007	General Service Irrigation	1"	14	1 N/A	N/A	N/A
February 2007	General Service Irrigation	1"	14	0 N/A	N/A	N/A
March 2007	General Service Irrigation	1"	14	7 N/A	N/A	N/A
April 2007	General Service Irrigation	1"	14	6 N/A	N/A	N/A
May 2007	General Service Irrigation	1"	14	42 N/A	N/A	N/A
June 2007	General Service Irrigation	1"	14	4 N/A	N/A	N/A
July 2007	General Service Irrigation	1"	14	2 N/A	N/A	N/A
August 2007	General Service Irrigation	1"	14	0 N/A	N/A	N/A
September 2007	General Service Irrigation	1"	14	1 N/A	N/A	N/A
October 2007	General Service Irrigation	1"	14	0 N/A	N/A	N/A
November 2007	General Service Irrigation	1"	14	0 N/A	N/A	N/A
December 2007	General Service Irrigation	1"	14	1 N/A	N/A	N/A
January 2008	General Service Irrigation	1"	14	1 N/A	N/A	N/A
February 2008	General Service Irrigation	1"	15	45 N/A	N/A	N/A
March 2008	General Service Irrigation	1"	15	49 N/A	N/A	N/A
April 2008	General Service Irrigation	1"	15	12 N/A	N/A	N/A
May 2008	General Service Irrigation	1"	15	13 N/A	N/A	N/A
June 2008	General Service Irrigation	1"	0	0 N/A	N/A	N/A
July 2008	General Service Irrigation	1"	0	0 N/A	N/A	N/A
August 2008	General Service Irrigation	1"	0	0 N/A	N/A	N/A
September 2008	General Service Irrigation	1"	0	0 N/A	N/A	N/A
October 2008	General Service Irrigation	1"	0	0 N/A	N/A	N/A
November 2008	General Service Irrigation	1"	0	0 N/A	N/A	N/A
December 2008	General Service Irrigation	1"	0	0 N/A	N/A	N/A
January 2004	General Service Irrigation	1.5"	2	45 N/A	N/A	N/A
February 2004	General Service Irrigation	1.5"	2	15 N/A	N/A	N/A
March 2004	General Service Irrigation	1.5"	2	14 N/A	N/A	N/A
April 2004	General Service Irrigation	1.5"	2	36 N/A	N/A	N/A
May 2004	General Service Irrigation	1.5"	2	34 N/A	N/A	N/A
June 2004	General Service Irrigation	1.5"	2	68 N/A	N/A	N/A
July 2004	General Service Irrigation	1.5"	2	62 N/A	N/A	N/A
August 2004	General Service Irrigation	1.5"	2	37 N/A	N/A	N/A
September 2004	General Service Irrigation	1.5"	2	0 N/A	N/A	N/A
October 2004	General Service Irrigation	1.5"	2	2 N/A	N/A	N/A
November 2004	General Service Irrigation	1.5"	2	36 N/A	N/A	N/A
December 2004	General Service Irrigation	1.5"	2	109 N/A	N/A	N/A
January 2005	General Service Irrigation	1.5"	2	41 N/A	N/A	N/A
February 2005	General Service Irrigation	1.5"	2	54 N/A	N/A	N/A
March 2005	General Service Irrigation	1.5"	2	65 N/A	N/A	N/A
April 2005	General Service Irrigation	1.5"	1	43 N/A	N/A	N/A
May 2005	General Service Irrigation	1.5"	2	137 N/A	N/A	N/A
June 2005	General Service Irrigation	1.5"	2	78 N/A	N/A	N/A
July 2005	General Service Irrigation	1.5"	2	44 N/A	N/A	N/A
August 2005	General Service Irrigation	1.5"	2	37 N/A	N/A	N/A
September 2005	General Service Irrigation	1.5"	2	28 N/A	N/A	N/A
October 2005	General Service Irrigation	1.5"	2	113 N/A	N/A	N/A
November 2005	General Service Irrigation	1.5"	2	39 N/A	N/A	N/A
December 2005	General Service Irrigation	1.5"	2	63 N/A	N/A	N/A
January 2006	General Service Irrigation	1.5"	2	61 N/A	N/A	N/A
February 2006	General Service Irrigation	1.5"	2	56 N/A	N/A	N/A
March 2006	General Service Irrigation	1.5"	2	22 N/A	N/A	N/A
April 2006	General Service Irrigation	1.5"	2	23 N/A	N/A	N/A
May 2006	General Service Irrigation	1.5"	3	102 N/A	N/A	N/A
June 2006	General Service Irrigation	1.5"	3	84 N/A	N/A	N/A
July 2006	General Service Irrigation	1.5"	3	102 N/A	N/A	N/A
August 2006	General Service Irrigation	1.5"	3	144 N/A	N/A	N/A
September 2006	General Service Irrigation	1.5"	3	105 N/A	N/A	N/A
October 2006	General Service Irrigation	1.5"	3	44 N/A	N/A	N/A
November 2006	General Service Irrigation	1.5"	3	100 N/A	N/A	N/A
December 2006	General Service Irrigation	1.5"	3	57 N/A	N/A	N/A
January 2007	General Service Irrigation	1.5"	3	79 N/A	N/A	N/A
February 2007	General Service Irrigation	1.5"	3	19 N/A	N/A	N/A
March 2007	General Service Irrigation	1.5"	3	139 N/A	N/A	N/A
April 2007	General Service Irrigation	1.5"	3	62 N/A	N/A	N/A
May 2007	General Service Irrigation	1.5"	3	50 N/A	N/A	N/A
June 2007	General Service Irrigation	1.5"	3	96 N/A	N/A	N/A

Item 3: Water System Data

Month/Yr	Customer Class	Meter Size	No of Bills	Monthly Water Gallons Sold		
				Gals Sold Block 1 (000's)	Gals Sold Block 2 (000's)	Gals Sold Block 3 (000's)
July 2007	General Service Irrigation	1.5"	3	54	N/A	N/A
August 2007	General Service Irrigation	1.5"	3	51	N/A	N/A
September 2007	General Service Irrigation	1.5"	3	59	N/A	N/A
October 2007	General Service Irrigation	1.5"	3	53	N/A	N/A
November 2007	General Service Irrigation	1.5"	3	23	N/A	N/A
December 2007	General Service Irrigation	1.5"	3	71	N/A	N/A
January 2008	General Service Irrigation	1.5"	3	81	N/A	N/A
February 2008	General Service Irrigation	1.5"	3	30	N/A	N/A
March 2008	General Service Irrigation	1.5"	3	32	N/A	N/A
April 2008	General Service Irrigation	1.5"	3	35	N/A	N/A
May 2008	General Service Irrigation	1.5"	3	94	N/A	N/A
June 2008	General Service Irrigation	1.5"	0	0	N/A	N/A
July 2008	General Service Irrigation	1.5"	0	0	N/A	N/A
August 2008	General Service Irrigation	1.5"	0	0	N/A	N/A
September 2008	General Service Irrigation	1.5"	0	0	N/A	N/A
October 2008	General Service Irrigation	1.5"	0	0	N/A	N/A
November 2008	General Service Irrigation	1.5"	0	0	N/A	N/A
December 2008	General Service Irrigation	1.5"	0	0	N/A	N/A
January 2004	General Service Irrigation	2"	4	127	N/A	N/A
February 2004	General Service Irrigation	2"	4	0	N/A	N/A
March 2004	General Service Irrigation	2"	4	78	N/A	N/A
April 2004	General Service Irrigation	2"	4	100	N/A	N/A
May 2004	General Service Irrigation	2"	4	125	N/A	N/A
June 2004	General Service Irrigation	2"	4	411	N/A	N/A
July 2004	General Service Irrigation	2"	4	384	N/A	N/A
August 2004	General Service Irrigation	2"	4	183	N/A	N/A
September 2004	General Service Irrigation	2"	4	161	N/A	N/A
October 2004	General Service Irrigation	2"	4	57	N/A	N/A
November 2004	General Service Irrigation	2"	4	171	N/A	N/A
December 2004	General Service Irrigation	2"	4	423	N/A	N/A
January 2005	General Service Irrigation	2"	4	164	N/A	N/A
February 2005	General Service Irrigation	2"	4	147	N/A	N/A
March 2005	General Service Irrigation	2"	4	141	N/A	N/A
April 2005	General Service Irrigation	2"	4	380	N/A	N/A
May 2005	General Service Irrigation	2"	4	348	N/A	N/A
June 2005	General Service Irrigation	2"	4	232	N/A	N/A
July 2005	General Service Irrigation	2"	4	148	N/A	N/A
August 2005	General Service Irrigation	2"	4	209	N/A	N/A
September 2005	General Service Irrigation	2"	4	14	N/A	N/A
October 2005	General Service Irrigation	2"	4	247	N/A	N/A
November 2005	General Service Irrigation	2"	4	122	N/A	N/A
December 2005	General Service Irrigation	2"	4	172	N/A	N/A
January 2006	General Service Irrigation	2"	4	340	N/A	N/A
February 2006	General Service Irrigation	2"	4	149	N/A	N/A
March 2006	General Service Irrigation	2"	4	97	N/A	N/A
April 2006	General Service Irrigation	2"	4	188	N/A	N/A
May 2006	General Service Irrigation	2"	4	273	N/A	N/A
June 2006	General Service Irrigation	2"	4	298	N/A	N/A
July 2006	General Service Irrigation	2"	4	442	N/A	N/A
August 2006	General Service Irrigation	2"	4	122	N/A	N/A
September 2006	General Service Irrigation	2"	4	236	N/A	N/A
October 2006	General Service Irrigation	2"	4	93	N/A	N/A
November 2006	General Service Irrigation	2"	4	260	N/A	N/A
December 2006	General Service Irrigation	2"	4	173	N/A	N/A
January 2007	General Service Irrigation	2"	4	177	N/A	N/A
February 2007	General Service Irrigation	2"	4	202	N/A	N/A
March 2007	General Service Irrigation	2"	4	120	N/A	N/A
April 2007	General Service Irrigation	2"	4	143	N/A	N/A
May 2007	General Service Irrigation	2"	4	390	N/A	N/A
June 2007	General Service Irrigation	2"	4	446	N/A	N/A
July 2007	General Service Irrigation	2"	4	226	N/A	N/A
August 2007	General Service Irrigation	2"	4	205	N/A	N/A
September 2007	General Service Irrigation	2"	4	299	N/A	N/A
October 2007	General Service Irrigation	2"	4	214	N/A	N/A
November 2007	General Service Irrigation	2"	4	153	N/A	N/A
December 2007	General Service Irrigation	2"	4	200	N/A	N/A
January 2008	General Service Irrigation	2"	4	184	N/A	N/A

Item 3: Water System Data

Month/Yr	Customer Class	Meter Size	No of Bills	Monthly Water Gallons Sold		
				Gals Sold Block 1 (000's)	Gals Sold Block 2 (000's)	Gals Sold Block 3 (000's)
February 2008	General Service Irrigation	2"	4	132	N/A	N/A
March 2008	General Service Irrigation	2"	4	143	N/A	N/A
April 2008	General Service Irrigation	2"	4	156	N/A	N/A
May 2008	General Service Irrigation	2"	4	292	N/A	N/A
June 2008	General Service Irrigation	2"	4	699	N/A	N/A
July 2008	General Service Irrigation	2"	4	310	N/A	N/A
August 2008	General Service Irrigation	2"	4	38	N/A	N/A
September 2008	General Service Irrigation	2"	4	33	N/A	N/A
October 2008	General Service Irrigation	2"	4	147	N/A	N/A
November 2008	General Service Irrigation	2"	4	181	N/A	N/A
December 2008	General Service Irrigation	2"	4	226	N/A	N/A

Item 4 - Irrigation Customers

NAME	ADDRESS	START_DT	END_DT	IRRG CUSTOMERS
CYPRESS LAKES IRRIG	ROBELLINI CT	3-Jun-99	NULL	IRRG
CYPRESS LAKES,POST OFC	CYPRESS LAKES DR	3-Jun-99	NULL	IRRG
CYPRESS LAKES ASSOCIATION	L/S #1 BIG CYPRESS BLVD	20-Apr-99	NULL	IRRG
CYPRESS LAKES,IRRIGATION	GOLFVIEW DR	14-Jun-99	NULL	IRRG
CYPRESS LAKES IRRG	MOORHEN DR	1-Jun-99	NULL	IRRG
CYPRESS LAKES,IRRIGATION	GREENVIEW CIR	3-Jun-99	NULL	IRRG
CYPRESS LAKES ASSOCIATION	CORNER OF PURPLE MARTIN DR	16-Jan-08	NULL	IRRG
CYPRESS LAKES,IRRIGATION	GOLFVIEW CIR	14-Jun-99	NULL	IRRG
CYPRESS LAKES ASSOCIATES	SAWGRASS IRRG	21-May-99	NULL	IRRG
CYPRESS LAKES,IRRIGATION	LAKE CIRCLE DR	26-May-99	NULL	IRRG
CYPRESS LAKES L/S #4	CYPRESS LAKES BLVD	13-May-99	NULL	IRRG
CYPRESS LAKES IRRG	MALLARD	19-Mar-99	NULL	IRRG
CYPRESS LAKES L/S #3	CYPRESS LAKES BLVD	27-Apr-99	NULL	IRRG
CYPRESS LAKES IRRG	SPATTERDOCK CT	27-May-99	NULL	IRRG
CYPRESS LAKES IRRG	LAKEVIEW TERR IRRG	2-Jun-99	NULL	IRRG
CYPRESS LAKES ASSOCIATION,CLUB HOUSE	CYPRESS LAKES BLVD	25-Mar-99	NULL	IRRG
CYPRESS LAKES SALES OFC,IRRIGATION	CYPRESS LAKES BLVD	29-Apr-99	NULL	IRRG
CYPRESS LAKES ASSOCIATION,CLUB HOUSE	CYPRESS LAKES BLVD	18-Mar-99	NULL	IRRG
CYPRESS LAKES ASSOC PHASE 7	CYPRESS LAKES BLVD	14-Dec-00	NULL	IRRG
CYPRESS LAKES ASSOCIATION,CLUB HOUSE	CYPRESS LAKES BLVD	18-Mar-99	NULL	IRRG
CYPRESS LAKES ASSOCIATES,ENTRANCE	CYPRESS LAKES BLVD	17-Oct-00	NULL	IRRG
CYPRESS LAKES ASSOCIATION	CYPRESS LAKES BLVD	23-Mar-99	NULL	IRRG
CYPRESS LAKES	IRRG BIG CYPRESS BLVD	8-Jan-99	NULL	IRRG
CYPRESS LAKES IRRG	SAND TRAP CIR	15-Jul-99	NULL	IRRG
CYPRESS LAKES IRRG	LITTLE CYPRESS DR	25-Feb-99	NULL	IRRG
CYPRESS LAKES ASSOC CULDASAC	SPIKERUSH CT	11-Jan-01	NULL	IRRG
CYPRESS LAKES ASSOC,CULDESAC	FOX BRANCH CT	14-Jul-05	NULL	IRRG
CYPRESS LAKES	IRRG BOGIE CIR	15-Jun-99	NULL	IRRG
CYPRESS LAKES ASSOCIATION,IRRIGATION	CYPRESS LAKES BLVD	13-Apr-99	NULL	IRRG
CYPRESS LAKES IRRIG	PRESWICK PASS	15-Jun-99	NULL	IRRG
CYPRESS LAKES,IRRIGATION	BIRDIE CIR	15-Jul-99	NULL	IRRG
CYPRESS LAKES	ENTRANCE IRRIGATION	8-Jan-99	NULL	IRRG
CYPRESS LAKES IRRG	PAR CIR	24-Jun-99	NULL	IRRG
CYPRESS LAKES IRRG	MOCKINGBIRD LN	22-Jun-99	NULL	IRRG
CYPRESS LAKES IRRG	SANDCRANE TRL	15-Jul-99	NULL	IRRG
CYPRESS LAKES,IRRIGATION	DUFFER CIR	13-Jul-99	NULL	IRRG
CYPRESS LAKES IRRG	MULLIGAN DR	15-Jul-99	NULL	IRRG
CYPRESS LAKES ASSOC IRRG	ULTRA DR	15-Jul-99	NULL	IRRG

ACCT	RATE	MTR
1338810000	248WGENS	1"
1738810000	248WGENS	1"
1918810000	248WGENS	1"
2448810000	248WGENS	1"
3138810000	248WGENS	1"
3538810000	248WGENS	1"
3762500000	248WGENS	1"
4248810000	248WGENS	1"
4628810000	248WGENS	1"
5928810000	248WGENS	1"
6228810000	248WGENS	1"
7808810000	248WGENS	1"
8028810000	248WGENS	1"
8728810000	248WGENS	1"
8838810000	248WGENS	1"
1218810000	248WGENS	1.5"
6428810000	248WGENS	1.5"
8018810000	248WGENS	1.5"
4578810000	248WGENS	2"
5518810000	248WGENS	2"
8378810000	248WGENS	2"
9318810000	248WGENS	2"
0408810000	248WGENS	5/8"
0758810000	248WGENS	5/8"
1708810000	248WGENS	5/8"
1778810000	248WGENS	5/8"
2248600000	248WGENS	5/8"
2648810000	248WGENS	5/8"
2718810000	248WGENS	5/8"
2848810000	248WGENS	5/8"
3458810000	248WGENS	5/8"
4508810000	248WGENS	5/8"
6158810000	248WGENS	5/8"
7948810000	248WGENS	5/8"
8068810000	248WGENS	5/8"
8258810000	248WGENS	5/8"
8558810000	248WGENS	5/8"
8858810000	248WGENS	5/8"

Item 5: Wastewater System Data

				Monthly Wastewater Gallons Sold	
Month/Yr	Customer Class	Meter Size	No of Bills	Gallons Sold	
January 2004	Residential	5/8"	1175	4020	
February 2004	Residential	5/8"	1177	3845	
March 2004	Residential	5/8"	1187	3968	
April 2004	Residential	5/8"	1196	4692	
May 2004	Residential	5/8"	1183	4277	
June 2004	Residential	5/8"	1189	4406	
July 2004	Residential	5/8"	1183	3637	
August 2004	Residential	5/8"	1190	2888	
September 2004	Residential	5/8"	1186	2477	
October 2004	Residential	5/8"	1190	2382	
November 2004	Residential	5/8"	1189	3348	
December 2004	Residential	5/8"	1194	4421	
January 2005	Residential	5/8"	1228	4267	
February 2005	Residential	5/8"	1225	4409	
March 2005	Residential	5/8"	1233	5043	
April 2005	Residential	5/8"	1242	5297	
May 2005	Residential	5/8"	1262	4922	
June 2005	Residential	5/8"	1262	4015	
July 2005	Residential	5/8"	1258	3163	
August 2005	Residential	5/8"	1265	2642	
September 2005	Residential	5/8"	1259	3926	
October 2005	Residential	5/8"	1265	3533	
November 2005	Residential	5/8"	1287	3532	
December 2005	Residential	5/8"	1284	4563	
January 2006	Residential	5/8"	1309	3602	
February 2006	Residential	5/8"	1295	4197	
March 2006	Residential	5/8"	1305	4416	
April 2006	Residential	5/8"	1351	5562	
May 2006	Residential	5/8"	1364	5608	
June 2006	Residential	5/8"	1355	4982	
July 2006	Residential	5/8"	1367	4004	
August 2006	Residential	5/8"	1363	3190	
September 2006	Residential	5/8"	1368	3182	
October 2006	Residential	5/8"	1373	3225	
November 2006	Residential	5/8"	1378	4624	
December 2006	Residential	5/8"	1381	4812	
January 2007	Residential	5/8"	1385	4415	
February 2007	Residential	5/8"	1390	4860	
March 2007	Residential	5/8"	1390	4465	
April 2007	Residential	5/8"	1397	5412	
May 2007	Residential	5/8"	1405	4919	
June 2007	Residential	5/8"	1396	4843	
July 2007	Residential	5/8"	1397	3404	
August 2007	Residential	5/8"	1398	3202	
September 2007	Residential	5/8"	1401	3256	
October 2007	Residential	5/8"	1400	3016	
November 2007	Residential	5/8"	1411	3824	
December 2007	Residential	5/8"	1421	4361	
January 2008	Residential	5/8"	1412	4581	

Item 5: Wastewater System Data

				Monthly Wastewater Gallons Sold	
Month/Yr	Customer Class	Meter Size	No of Bills	Gallons Sold	
February 2008	Residential	5/8"	1408	4433	
March 2008	Residential	5/8"	1406	4428	
April 2008	Residential	5/8"	1411	4528	
May 2008	Residential	5/8"	1416	4499	
June 2008	Residential	5/8"	1404	4465	
July 2008	Residential	5/8"	1409	3909	
August 2008	Residential	5/8"	1414	2771	
September 2008	Residential	5/8"	1416	2916	
October 2008	Residential	5/8"	1425	3637	
November 2008	Residential	5/8"	1417	3796	
December 2008	Residential	5/8"	1426	4198	
January 2004	Residential	3/4"	0	0	
February 2004	Residential	3/4"	1	3	
March 2004	Residential	3/4"	0	0	
April 2004	Residential	3/4"	0	0	
May 2004	Residential	3/4"	0	0	
June 2004	Residential	3/4"	0	0	
July 2004	Residential	3/4"	0	0	
August 2004	Residential	3/4"	0	0	
September 2004	Residential	3/4"	0	0	
October 2004	Residential	3/4"	0	0	
November 2004	Residential	3/4"	0	0	
December 2004	Residential	3/4"	0	0	
January 2005	Residential	3/4"	0	0	
February 2005	Residential	3/4"	0	0	
March 2005	Residential	3/4"	0	0	
April 2005	Residential	3/4"	0	0	
May 2005	Residential	3/4"	0	0	
June 2005	Residential	3/4"	0	0	
July 2005	Residential	3/4"	0	0	
August 2005	Residential	3/4"	0	0	
September 2005	Residential	3/4"	0	0	
October 2005	Residential	3/4"	0	0	
November 2005	Residential	3/4"	0	0	
December 2005	Residential	3/4"	0	0	
January 2006	Residential	3/4"	0	0	
February 2006	Residential	3/4"	0	0	
March 2006	Residential	3/4"	0	0	
April 2006	Residential	3/4"	0	0	
May 2006	Residential	3/4"	0	0	
June 2006	Residential	3/4"	0	0	
July 2006	Residential	3/4"	0	0	
August 2006	Residential	3/4"	0	0	
September 2006	Residential	3/4"	0	0	
October 2006	Residential	3/4"	0	0	
November 2006	Residential	3/4"	0	0	
December 2006	Residential	3/4"	0	0	
January 2007	Residential	3/4"	0	0	

Item 5: Wastewater System Data

				Monthly Wastewater Gallons Sold	
Month/Yr	Customer Class	Meter Size	No of Bills	Gallons Sold	
February 2007	Residential	3/4"	0	0	0
March 2007	Residential	3/4"	0	0	0
April 2007	Residential	3/4"	0	0	0
May 2007	Residential	3/4"	0	0	0
June 2007	Residential	3/4"	0	0	0
July 2007	Residential	3/4"	0	0	0
August 2007	Residential	3/4"	0	0	0
September 2007	Residential	3/4"	0	0	0
October 2007	Residential	3/4"	0	0	0
November 2007	Residential	3/4"	0	0	0
December 2007	Residential	3/4"	0	0	0
January 2008	Residential	3/4"	0	0	0
February 2008	Residential	3/4"	0	0	0
March 2008	Residential	3/4"	0	0	0
April 2008	Residential	3/4"	0	0	0
May 2008	Residential	3/4"	0	0	0
June 2008	Residential	3/4"	0	0	0
July 2008	Residential	3/4"	0	0	0
August 2008	Residential	3/4"	0	0	0
September 2008	Residential	3/4"	0	0	0
October 2008	Residential	3/4"	0	0	0
November 2008	Residential	3/4"	0	0	0
December 2008	Residential	3/4"	0	0	0
January 2004	General Service	5/8"	2	16	16
February 2004	General Service	5/8"	2	9	9
March 2004	General Service	5/8"	2	33	33
April 2004	General Service	5/8"	2	38	38
May 2004	General Service	5/8"	2	10	10
June 2004	General Service	5/8"	2	30	30
July 2004	General Service	5/8"	2	27	27
August 2004	General Service	5/8"	2	14	14
September 2004	General Service	5/8"	2	5	5
October 2004	General Service	5/8"	2	4	4
November 2004	General Service	5/8"	2	23	23
December 2004	General Service	5/8"	2	32	32
January 2005	General Service	5/8"	2	21	21
February 2005	General Service	5/8"	2	24	24
March 2005	General Service	5/8"	2	24	24
April 2005	General Service	5/8"	2	28	28
May 2005	General Service	5/8"	2	26	26
June 2005	General Service	5/8"	2	23	23
July 2005	General Service	5/8"	2	19	19
August 2005	General Service	5/8"	2	10	10
September 2005	General Service	5/8"	2	26	26
October 2005	General Service	5/8"	2	19	19
November 2005	General Service	5/8"	2	20	20
December 2005	General Service	5/8"	2	24	24
January 2006	General Service	5/8"	2	20	20

Item 5: Wastewater System Data

				Monthly Wastewater Gallons Sold	
Month/Yr	Customer Class	Meter Size	No of Bills	Gallons Sold	
February 2006	General Service	5/8"	2	21	
March 2006	General Service	5/8"	2	20	
April 2006	General Service	5/8"	2	22	
May 2006	General Service	5/8"	2	19	
June 2006	General Service	5/8"	2	16	
July 2006	General Service	5/8"	2	13	
August 2006	General Service	5/8"	2	6	
September 2006	General Service	5/8"	2	11	
October 2006	General Service	5/8"	2	8	
November 2006	General Service	5/8"	2	19	
December 2006	General Service	5/8"	3	51	
January 2007	General Service	5/8"	3	41	
February 2007	General Service	5/8"	3	45	
March 2007	General Service	5/8"	3	29	
April 2007	General Service	5/8"	3	64	
May 2007	General Service	5/8"	3	54	
June 2007	General Service	5/8"	3	48	
July 2007	General Service	5/8"	3	28	
August 2007	General Service	5/8"	3	30	
September 2007	General Service	5/8"	3	23	
October 2007	General Service	5/8"	3	10	
November 2007	General Service	5/8"	3	37	
December 2007	General Service	5/8"	3	26	
January 2008	General Service	5/8"	3	24	
February 2008	General Service	5/8"	3	20	
March 2008	General Service	5/8"	3	24	
April 2008	General Service	5/8"	3	32	
May 2008	General Service	5/8"	3	21	
June 2008	General Service	5/8"	3	17	
July 2008	General Service	5/8"	3	15	
August 2008	General Service	5/8"	3	15	
September 2008	General Service	5/8"	3	8	
October 2008	General Service	5/8"	3	13	
November 2008	General Service	5/8"	3	12	
December 2008	General Service	5/8"	3	18	
January 2004	General Service	1"	1	65	
February 2004	General Service	1"	1	57	
March 2004	General Service	1"	1	60	
April 2004	General Service	1"	1	65	
May 2004	General Service	1"	1	46	
June 2004	General Service	1"	1	61	
July 2004	General Service	1"	1	92	
August 2004	General Service	1"	1	68	
September 2004	General Service	1"	1	54	
October 2004	General Service	1"	1	71	
November 2004	General Service	1"	1	65	
December 2004	General Service	1"	1	61	
January 2005	General Service	1"	1	38	

Item 5: Wastewater System Data

				Monthly Wastewater Gallons Sold	
Month/Yr	Customer Class	Meter Size	No of Bills	Gallons Sold	
February 2005	General Service	1"	1	52	
March 2005	General Service	1"	1	35	
April 2005	General Service	1"	1	45	
May 2005	General Service	1"	1	41	
June 2005	General Service	1"	1	57	
July 2005	General Service	1"	1	37	
August 2005	General Service	1"	1	39	
September 2005	General Service	1"	1	58	
October 2005	General Service	1"	1	51	
November 2005	General Service	1"	1	46	
December 2005	General Service	1"	1	34	
January 2006	General Service	1"	1	35	
February 2006	General Service	1"	1	32	
March 2006	General Service	1"	1	19	
April 2006	General Service	1"	1	38	
May 2006	General Service	1"	1	39	
June 2006	General Service	1"	1	38	
July 2006	General Service	1"	1	41	
August 2006	General Service	1"	1	47	
September 2006	General Service	1"	1	55	
October 2006	General Service	1"	1	52	
November 2006	General Service	1"	1	47	
December 2006	General Service	1"	1	38	
January 2007	General Service	1"	1	45	
February 2007	General Service	1"	1	43	
March 2007	General Service	1"	1	37	
April 2007	General Service	1"	1	44	
May 2007	General Service	1"	1	44	
June 2007	General Service	1"	1	41	
July 2007	General Service	1"	1	46	
August 2007	General Service	1"	1	41	
September 2007	General Service	1"	1	42	
October 2007	General Service	1"	1	43	
November 2007	General Service	1"	1	40	
December 2007	General Service	1"	1	33	
January 2008	General Service	1"	1	34	
February 2008	General Service	1"	1	30	
March 2008	General Service	1"	1	36	
April 2008	General Service	1"	1	48	
May 2008	General Service	1"	1	63	
June 2008	General Service	1"	0	0	
July 2008	General Service	1"	1	164	
August 2008	General Service	1"	1	54	
September 2008	General Service	1"	1	44	
October 2008	General Service	1"	1	45	
November 2008	General Service	1"	1	37	
December 2008	General Service	1"	1	37	
January 2004	General Service	1.5"	2	83	

Item 5: Wastewater System Data

				Monthly Wastewater Gallons Sold	
Month/Yr	Customer Class	Meter Size	No of Bills	Gallons Sold	
February 2004	General Service	1.5"	2	75	
March 2004	General Service	1.5"	2	76	
April 2004	General Service	1.5"	2	119	
May 2004	General Service	1.5"	2	99	
June 2004	General Service	1.5"	2	114	
July 2004	General Service	1.5"	2	82	
August 2004	General Service	1.5"	2	76	
September 2004	General Service	1.5"	2	69	
October 2004	General Service	1.5"	2	128	
November 2004	General Service	1.5"	2	115	
December 2004	General Service	1.5"	2	147	
January 2005	General Service	1.5"	2	149	
February 2005	General Service	1.5"	2	88	
March 2005	General Service	1.5"	2	25	
April 2005	General Service	1.5"	2	184	
May 2005	General Service	1.5"	2	83	
June 2005	General Service	1.5"	2	66	
July 2005	General Service	1.5"	2	70	
August 2005	General Service	1.5"	2	62	
September 2005	General Service	1.5"	2	59	
October 2005	General Service	1.5"	2	58	
November 2005	General Service	1.5"	2	59	
December 2005	General Service	1.5"	2	68	
January 2006	General Service	1.5"	2	145	
February 2006	General Service	1.5"	2	97	
March 2006	General Service	1.5"	2	106	
April 2006	General Service	1.5"	2	100	
May 2006	General Service	1.5"	1	90	
June 2006	General Service	1.5"	1	64	
July 2006	General Service	1.5"	1	55	
August 2006	General Service	1.5"	1	49	
September 2006	General Service	1.5"	1	41	
October 2006	General Service	1.5"	1	32	
November 2006	General Service	1.5"	1	61	
December 2006	General Service	1.5"	1	44	
January 2007	General Service	1.5"	1	55	
February 2007	General Service	1.5"	1	59	
March 2007	General Service	1.5"	1	66	
April 2007	General Service	1.5"	1	82	
May 2007	General Service	1.5"	1	66	
June 2007	General Service	1.5"	1	58	
July 2007	General Service	1.5"	1	41	
August 2007	General Service	1.5"	1	47	
September 2007	General Service	1.5"	1	43	
October 2007	General Service	1.5"	1	37	
November 2007	General Service	1.5"	1	55	
December 2007	General Service	1.5"	1	44	
January 2008	General Service	1.5"	1	53	
February 2008	General Service	1.5"	1	60	

Item 5: Wastewater System Data

				Monthly Wastewater Gallons Sold	
Month/Yr	Customer Class	Meter Size	No of Bills	Gallons Sold	
March 2008	General Service	1.5"	1	71	
April 2008	General Service	1.5"	1	64	
May 2008	General Service	1.5"	1	67	
June 2008	General Service	1.5"	1	63	
July 2008	General Service	1.5"	1	52	
August 2008	General Service	1.5"	1	47	
September 2008	General Service	1.5"	1	53	
October 2008	General Service	1.5"	1	49	
November 2008	General Service	1.5"	1	46	
December 2008	General Service	1.5"	1	51	