



124 kW Option

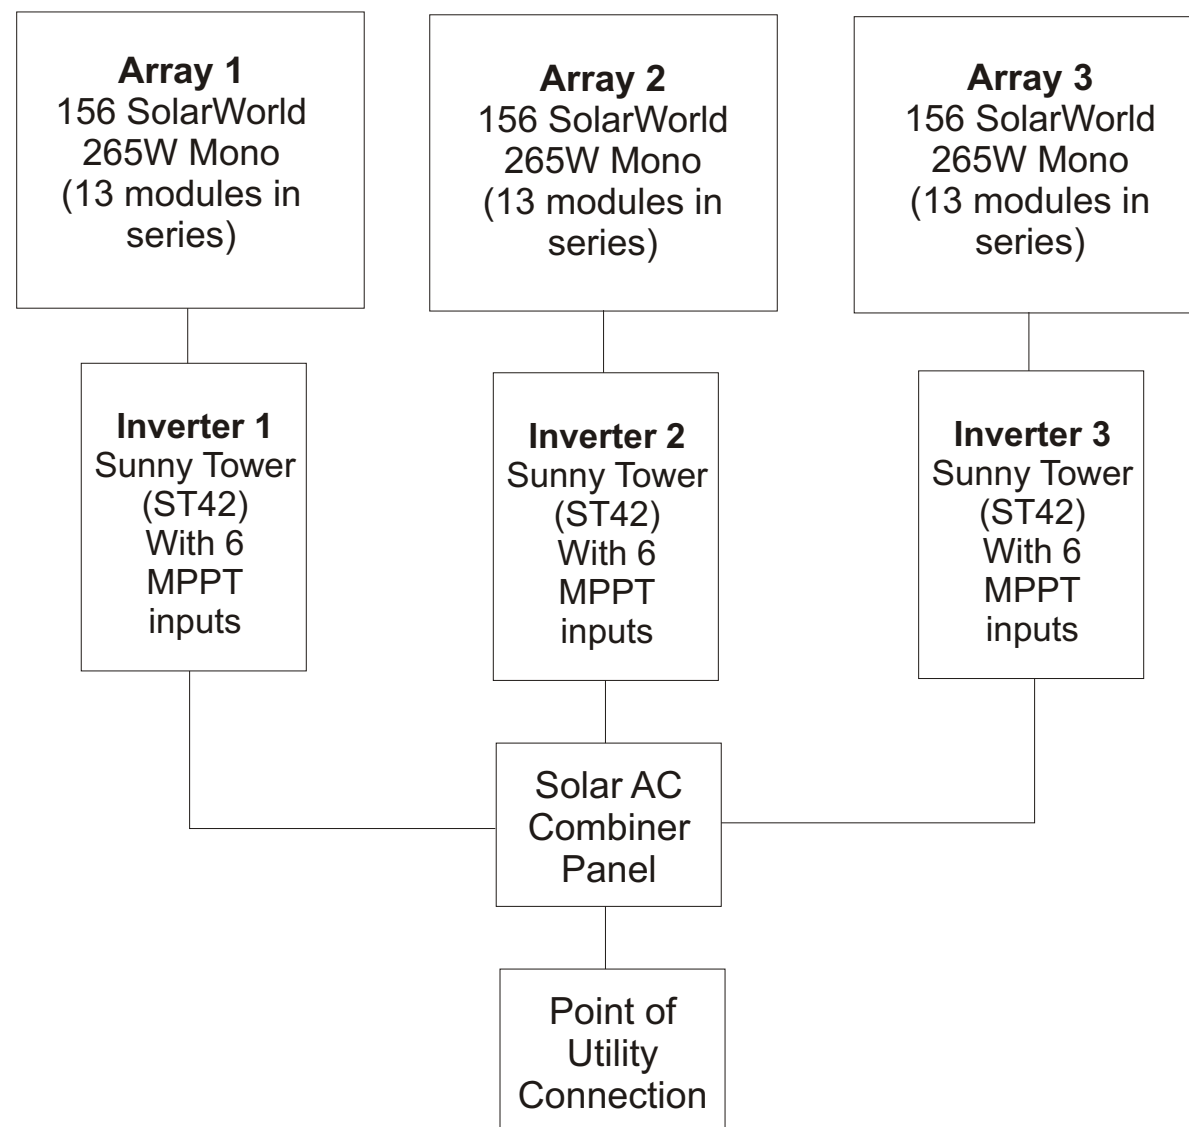

25 kW Base Bid

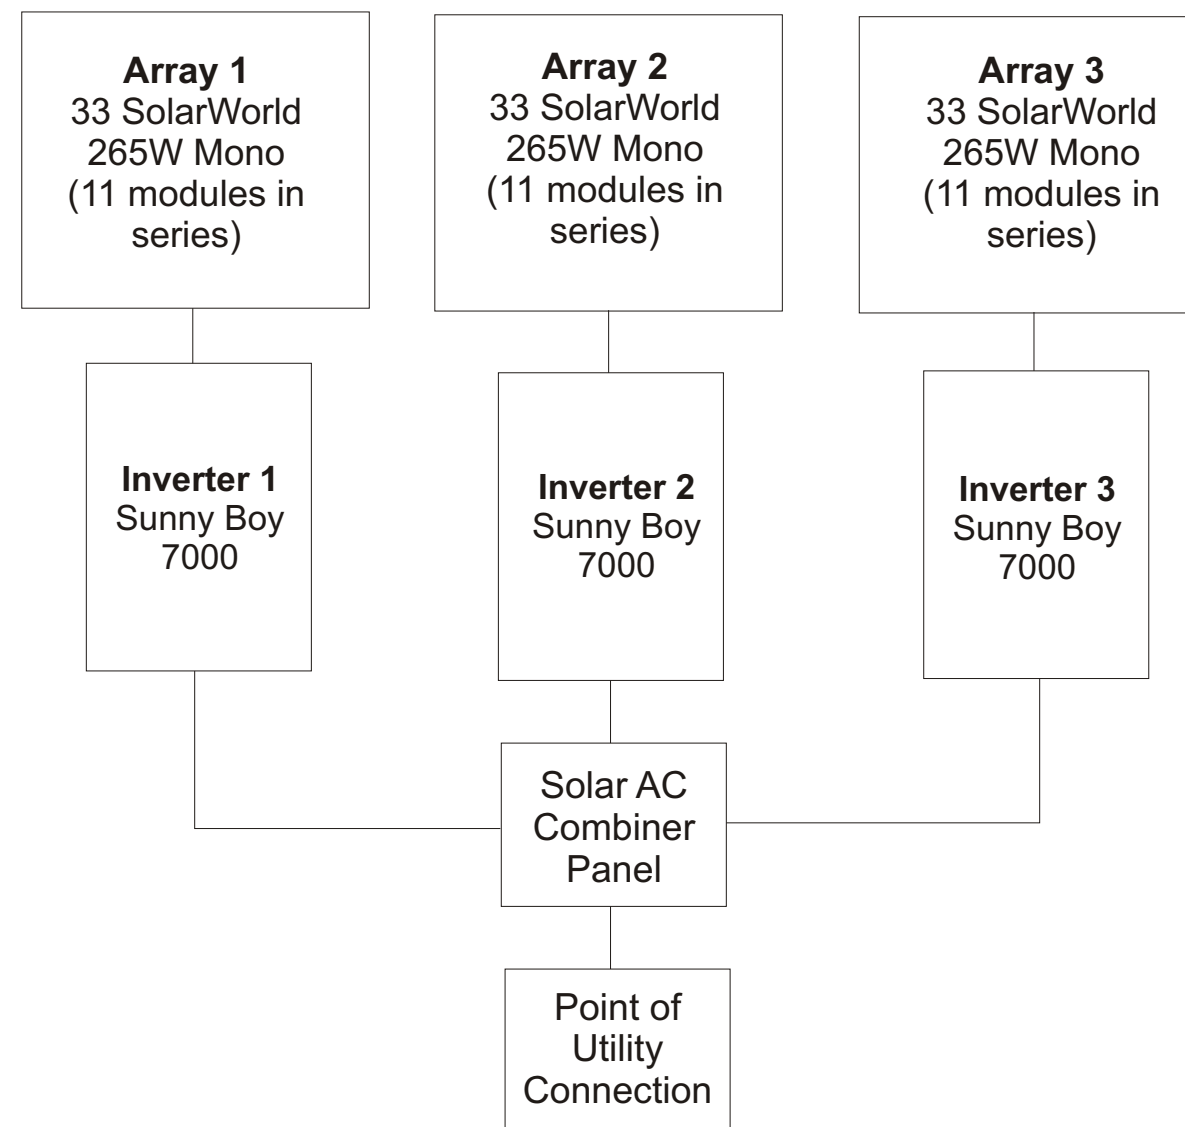

Notes


Electrical 1-Line Diagram

FPL 152405
DSM-14

Prepared for:
NEXtera Energy

Kennedy Space Center

Electrical Schematic

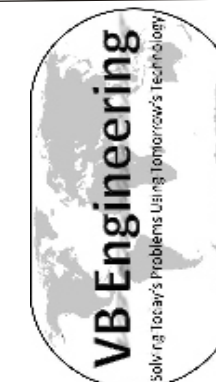

Certification of Authorization #2846
3601 N. Dixie Hwy, Suite 16, Boca Raton, FL 33431
P:561-750-8677 F:561-750-0518

A-00

00