



SUNNY HILLS - WATER TOWNSHIP 2 N / RANGE 13,14 W

FILED 4/7/2022
DOCUMENT NO. 02303-2022
FPSC - COMMISSION CLERK

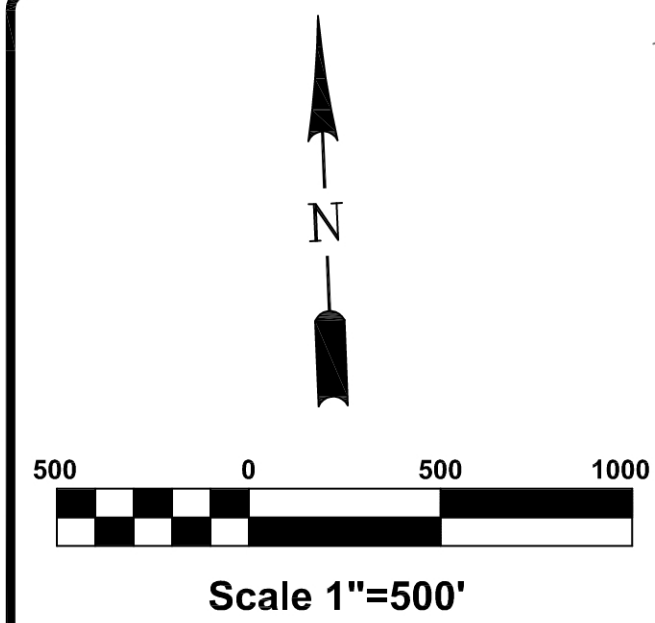

LEGEND

INACTIVE WATER CUSTOMER	▲
COMMERCIAL WATER CUSTOMER	▲
WATER CUSTOMER	▲
2" BLOW-OFF VALVE	⊕
FIRE HYDRANT	⊕
REDUCER	⊕
SECTION LINE	—
SERVICE AREA BOUNDARY	—
16" WATER (271 LF)	—
14" WATER (2,448 LF)	—
12" WATER (197 LF)	—
10" WATER (1,545 LF)	—
8" WATER (4,729 LF)	—
6" WATER (17,267 LF)	—
4" WATER (8,168 LF)	—
1" WATER (898 LF)	—

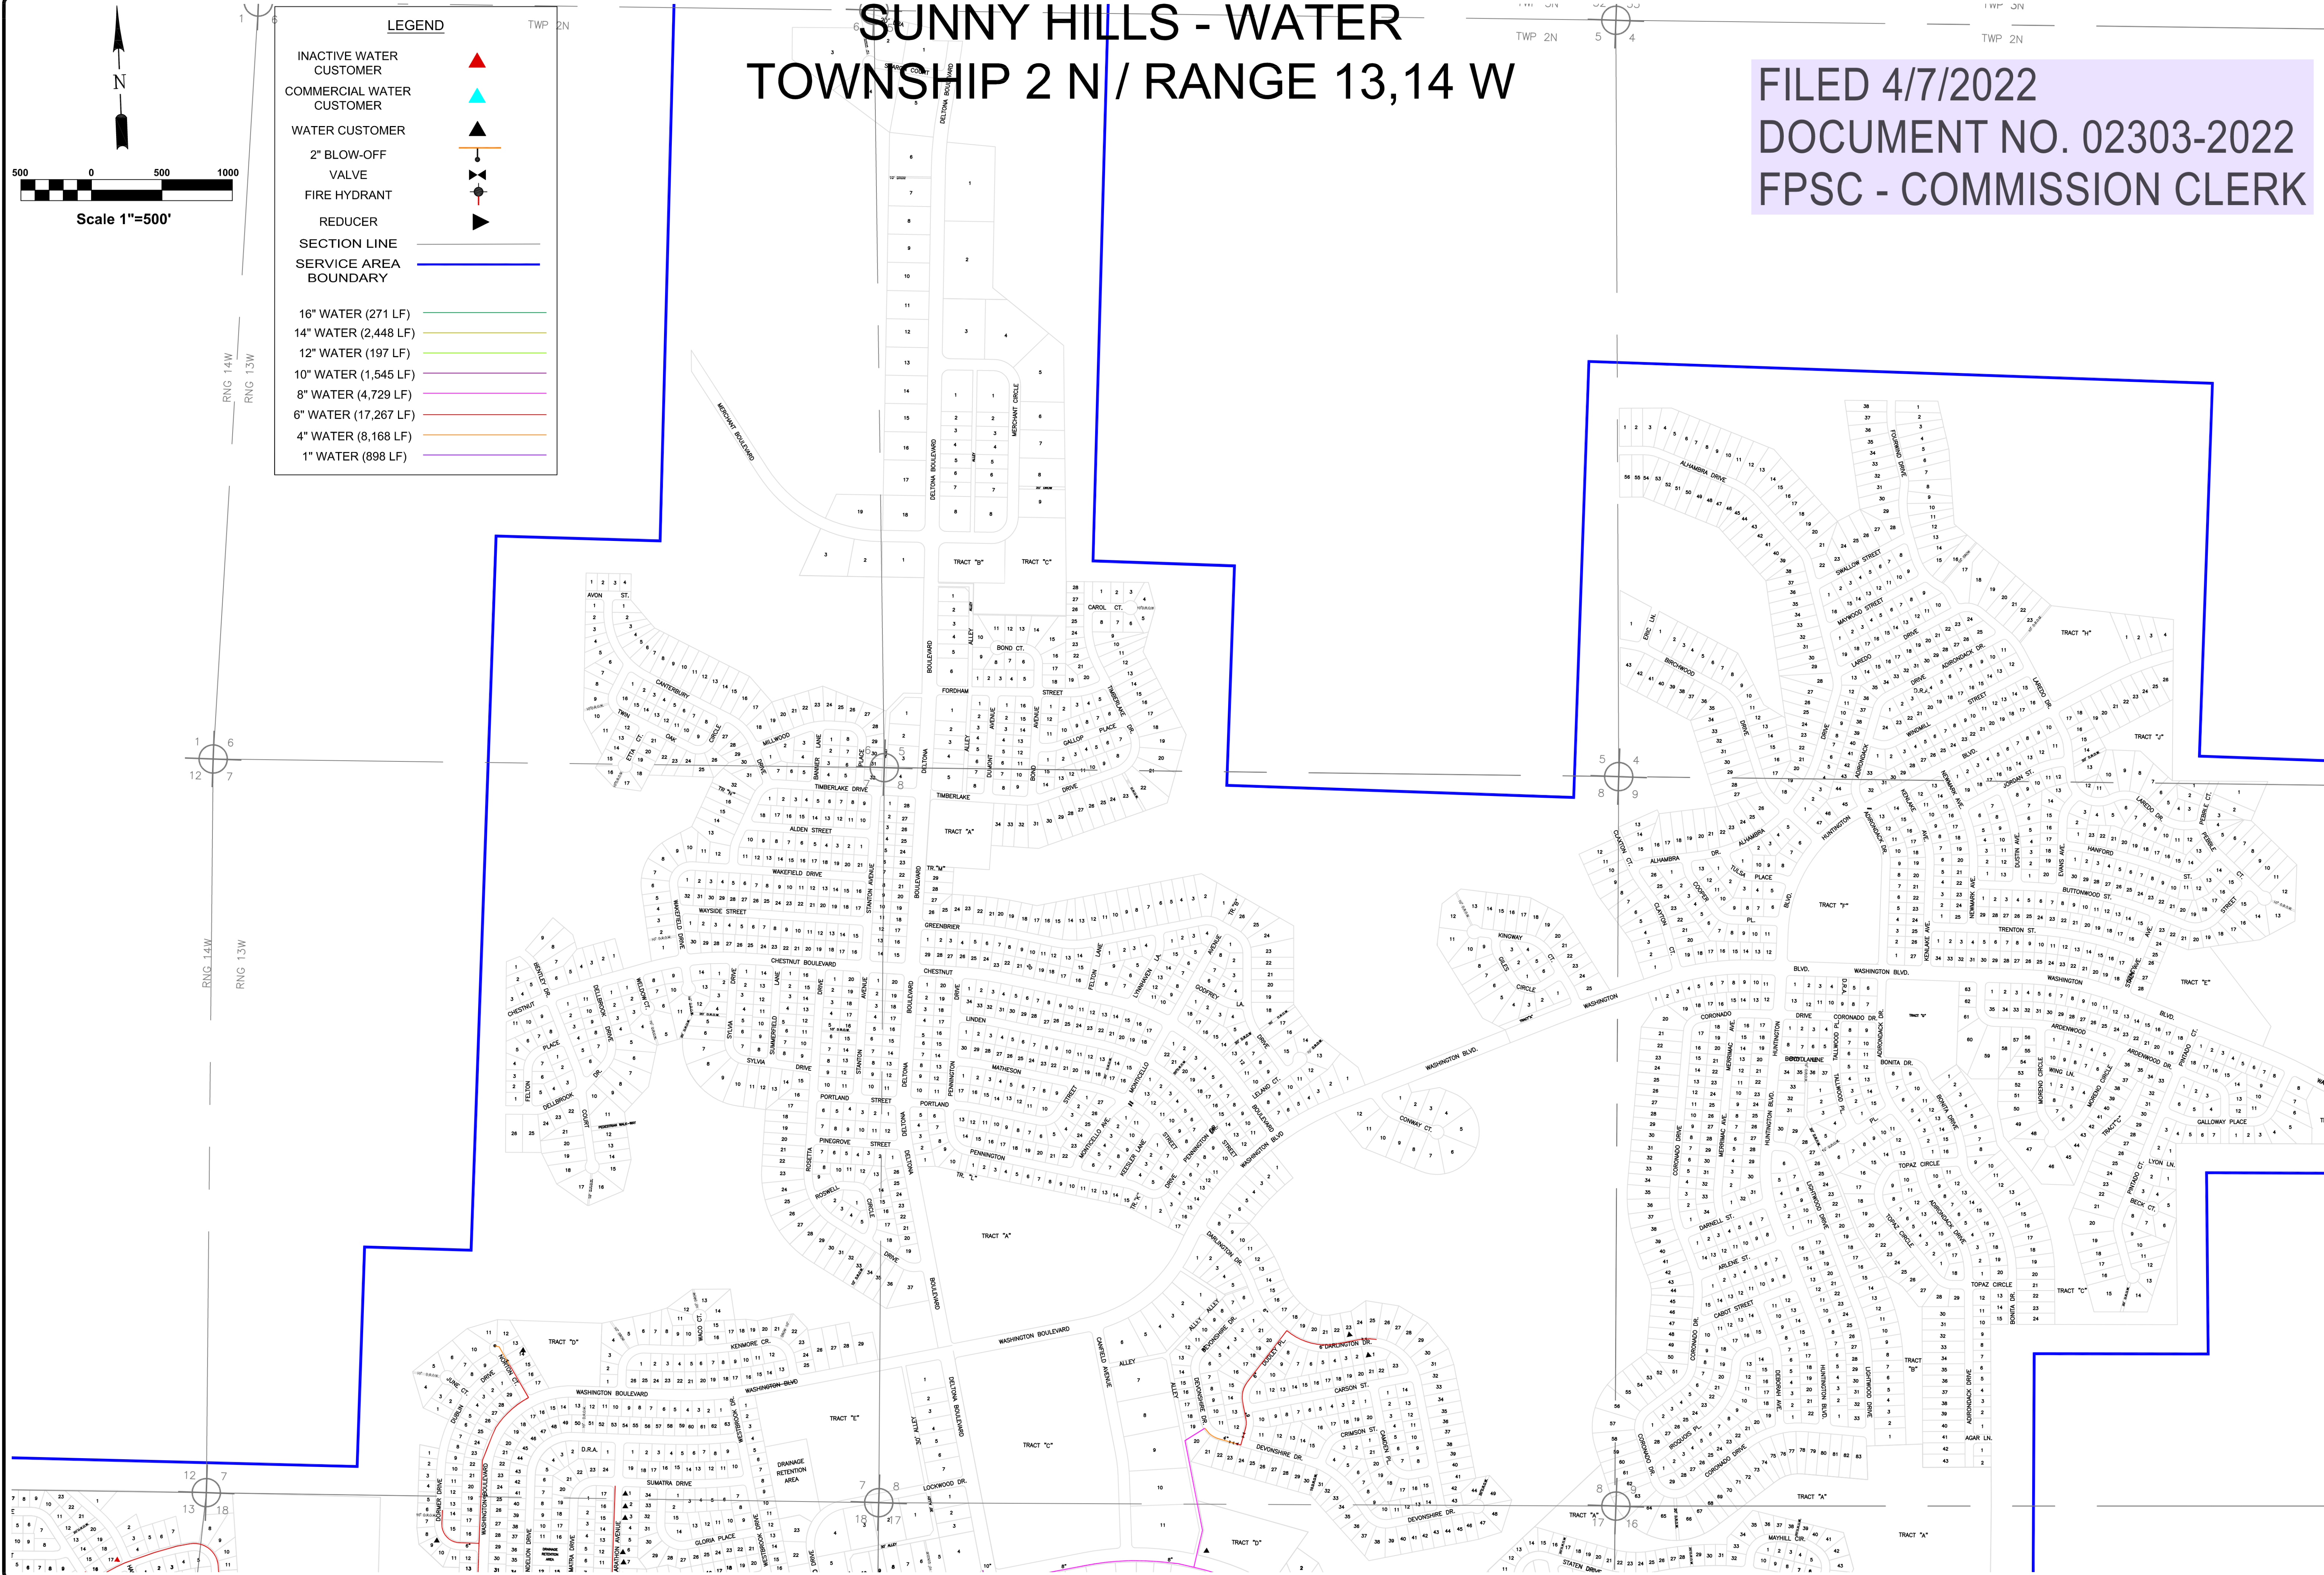

<p>ENGINEERING</p> <p>Designer: KK Date: 3/28/2022</p> <p>Drawn By: KK Scale: AS SHOWN</p> <p>Checked By: KK Revision No.</p>	<p>SUNNY HILLS UTILITIES UTILITY MAPPING SHEET 2 WASHINGTON COUNTY, FLORIDA</p>	<p>4939 CROSS BAYOU BOULEVARD NEW PORT RICHEY, FL 34652 (727) 848-8292 (727) 848-7701 FL COA NO. 9754 & FL REG. NO. 45129</p>	
<p>Project No. 11</p>	<p>3</p>	<p>11</p>	<p>11</p>