

AUSLEY & McMULLEN

ATTORNEYS AND COUNSELORS AT LAW

123 SOUTH CALHOUN STREET
P.O. BOX 391 (ZIP 32302)
TALLAHASSEE, FLORIDA 32301
(850) 224-9115 FAX (850) 222-7560

March 1, 2022

VIA: ELECTRONIC MAIL

Mr. Tom Ballinger, Director
Division of Engineer
Florida Public Service Commission
Room 215J – Gerald L. Gunter Building
2540 Shumard Oak Boulevard
Tallahassee, FL 32399-0850
tballing@psc.state.fl.us

Re: Wood Pole Inspection and Annual Reliability Performance Reports

Dear Mr. Ballinger:

Submitted herewith is Tampa Electric Company's 2021 Wood Pole Inspection and Annual Reliability Performance Report. In addition, similar to last year, Tampa Electric will submit the annual update of Storm Protection Plan activities, which includes the legacy Storm Hardening activities, on June 1, 2022.

Please let me know if you have any questions.

Sincerely,



Malcolm N. Means

MNM/bmp
Enclosure

cc: Mark Roche, TECO
TECO Regulatory



TECO[®]
TAMPA ELECTRIC
AN EMERA COMPANY

2021
ANNUAL WOOD POLE
INSPECTION REPORT
&
ANNUAL RELIABILITY
PERFORMANCE REPORT

FILED: March 1, 2022



Table of Contents

Summary of 2021 Wood Pole Inspection and Reliability Performance Report.....	1
Tampa Electric’s Wood Pole Inspection Program.....	3
Annual Wood Pole Inspection Report.....	7
Section IV – Rule 25-6.0455 F.A.C.....	8
2021 Reliability Performance.....	8
Generation Events.....	12
Transmission Events.....	12
Extreme Weather.....	13
Other Distribution.....	14
Distribution Substation.....	14
2021 Adjusted Distribution Reliability.....	20
Three Percent Feeder.....	21
Regional Reliability Indices.....	23
Regional Reliability Trends.....	24
Overhead – Underground Reliability.....	26
Five-Year Trends – Reliability Performance.....	26
Reliability-Related Customer Complaints.....	28
Appendix-Annual Reliability Performance Report.....	31
Reliability Appendix A	32
Form PSC/ECR 102-1(a)(8/06).....	32
Form 102 – Part II – Actual.....	33
Form 102 – Part III – Actual.....	34
Form 102 – Part III continued – Actual.....	35
Reliability Appendix B.....	36
Form PSC/ECR 102-1(b)(8/06).....	36
Form 103 - PART II – Adjusted.....	37

2021 Annual Reliability Performance Report

Form 103 - PART III – Adjusted.....	38
Form 103 Part III continued Adjusted.....	39
Actual Data: CMI, CI and Documented Exclusions.....	40
2021 Adjustments: Planned Distribution Outage Events.....	41
Feeder Specific and Attached Laterals Data.....	103

SUMMARY OF 2021

WOOD POLE INSPECTION AND ANNUAL RELIABILITY PERFORMANCE REPORT

In 2021, Tampa Electric continued the performance of the company's second year of its first Storm Protection Plan ("SPP"). The company's 2020-2029 Storm Protection Plan provides a comprehensive approach to protect and strengthen its electric utility infrastructure to withstand extreme weather conditions as well as to reduce restoration costs and outage times in a prudent, practical and cost-effective manner. As part of the company's prior three-year Storm Hardening Plan and the new SPP, Tampa Electric continued to perform the required system hardening activities such as equipment upgrades, system and equipment maintenance, upgrading of distribution wood structures, replacement of transmission wood structures and the company's distribution and transmission inspection processes. As agreed upon in the Commission's Staff workshop that was conducted on January 21, 2021, the company will submit the annual update of SPP activities, which includes the legacy storm hardening activities, on June first of each year.

Tampa Electric's 2021 distribution reliability Florida Public Service Commission ("FPSC") indices showed improvement when compared to 2020, in Momentary Average Interruption Event ("MAIFle"). System Average Interruption Duration Index ("SAIDI"), System Average Interruption Frequency Index ("SAIFI"), Actual Customer Average Interruption Duration Index ("CAIDI"), Average Duration of Outage Events ("L-Bar"), and Customers Experiencing More than Five Interruptions ("CEMI-5") showed unfavorable results in 2021 as compared to 2020. The improvements in MAIFle are attributed to a decrease in breaker events. The unfavorable performance in the other distribution reliability indices are attributed to two severe weather events combined with longer restoration times.

The following pages include the following reports:

2021 Annual Reliability Performance Report

1. Tampa Electric's 2021 Annual Wood Pole Inspection Report as required by Docket Nos. 20070634-EI and 20070635-TL, Order No. PSC-2007-0918-PAA-PU issued November 14, 2007.
2. Tampa Electric's 2021 Annual Distribution Service Reliability Report as required by Rule 25-6.0342 FAC.

Tampa Electric's Wood Pole Inspection Program

Tampa Electric's Wood Pole Inspection Initiative is part of a comprehensive program initiated by the FPSC for Florida investor-owned electric utilities to harden the electric system against severe weather.

This inspection program complies with Order No. PSC-2006-0144-PAA-EI, issued February 27, 2006 in Docket No. 20060078-EI which requires each investor-owned electric utility to implement an inspection program of its wooden transmission and distribution poles on an eight-year cycle based on the requirements of the National Electrical Safety Code ("NESC"). Tampa Electric has approximately 285,000 distribution and lighting wood poles and 26,000 transmission poles appropriate for inspection for a total pole inspection population of approximately 311,000. Approximately 12.5 percent of the known system will be targeted for inspections annually although the actual number of poles may vary from year to year due to recently constructed circuits, de-energized circuits, reconfigured circuits, etc. This program provides a systematic identification of poles that require repair, reinforcement, or replacement to meet strength requirements of the NESC.

The wood pole inspections will be conducted on a substation circuit basis with a goal of inspecting the entire wood pole population every eight years. An average of 35,625 wooden distribution poles will be inspected annually with each pole receiving a visual inspection, a sound and bore procedure, and a groundline/excavation inspection (except for chromated copper arsenate "CCA" poles less than 16 years of age.)

Inspection Method and Procedure: Tampa Electric will utilize three basic inspection procedures for determining the condition of wooden poles. These procedures include a visual inspection, sound and bore, and excavation when required.

Visual Inspection: An initial visual inspection shall be made on all poles from the ground line to the pole top to determine the condition of the pole before any additional inspection work is completed. The visual inspection shall include a review

2021 Annual Reliability Performance Report

of the pole condition itself and any attachments to the pole for conditions that jeopardize reliability and are in need of replacement, repair or minor follow-up. After a pole passes the initial visual inspection, the balance of the required inspection methods will be performed.

Sound and Bore: After passing the visual inspection, the pole shall be sounded to a minimum height of seven feet above the ground line to locate any rotten conditions or pockets of decay inside the pole. Borings shall be made to determine the location and extent of internal decay or voids. All borings shall be plugged with preservative treated wooden dowels. After the pole has passed the sound and bore inspection, an excavation inspection will be performed, if required.

Excavation: For poles requiring excavation, the pole shall be excavated to a minimum depth of 18 inches below the ground line. Any external decay shall be removed to expose the remaining sound wood. The remaining pole strength shall be calculated.

For a pole in concrete or pavement where excavation is not possible, Tampa Electric will utilize a shell boring technique. This will consist of boring two 3/8-inch holes at a 60-degree angle to a depth of 16 to 18 inches below ground level. Upon withdrawing the drill bit, the technician will examine the condition of the wood shavings to determine whether decay is present. A "Shell Gauge" is used to determine the thickness of the shell, which is then used to calculate the pole strength. All borings shall be plugged as previously described.

Hardware Inspection: The inspector shall inspect all of Tampa Electric's guying, grounding provisions and hardware that is visible from the ground. Any deficiencies or problems will be corrected as directed or reported to Tampa Electric to correct.

Inspection and Treatment Labeling: After completion of the ground line inspection, an aluminum tag identifying the contractor and date of inspection shall be attached

2021 Annual Reliability Performance Report

to the pole above the birthmark. Additionally, a tag shall be attached identifying any preservative treatments applied and the date of application.

Data Collection: The collected data shall be managed in a database and include information related to pole class, material, vintage, location, pole strength and any pole deficiencies that required follow-up actions, if any.

Inspection in Conjunction with Other Field Work: As part of day-to-day operations, operation personnel are at times required to climb poles to perform different types of field work. Prior to climbing any pole, personnel will assess the condition of the pole. This will include a visual check and may include sounding to determine pole integrity. This type of inspection will supplement the systematic inspection approach otherwise outlined in this pole inspection program.

Disposition of Poles: Poles with early-stage decay that do not require remediation to meet the NESC strength requirements shall be treated with an appropriate preservative treatment. Poles with moderate decay that have substantial sound wood shall be considered for reinforcement. Analysis shall be performed to determine if reinforcement will bring the deficient pole into compliance with the requirements of the NESC. If it is determined that the pole can be reinforced, the pole shall be treated with an appropriate preservative treatment and may be reinforced or replaced if needed. Poles with advanced decay shall fail the inspection and be replaced.

Shared Poles: Tampa Electric supports the Commission's effort to establish pole inspection requirements on the owners of all utility poles. Tampa Electric will coordinate with third-party owners of utility poles that carry the company's facilities. With regard to the third-party's inspection process, the company will rely upon the third-party's inspection requirements and share data requested by the third-party to be utilized in their inspection procedure. Tampa Electric will cooperate, as requested, in the work associated with pole replacement where joint use exists. Third-party

2021 Annual Reliability Performance Report

poles are visually inspected and sounded for internal decay. Issues found are provided to the third-party owner for resolution.

Chromated Copper Arsenate Pole Inspections: In Docket No. 20080219-EI, Order No. PSC-2008-0615-PAA-EI, issued September 23, 2008, the FPSC approved a modification to Tampa Electric's Wood Pole Inspection Program involving chromated copper arsenate ("CCA") poles. Specifically, the modification requires CCA treated poles less than 16 years of age to be sound and selectively bored. Selective boring shall be performed on poles suspected of internal decay. Additionally, one percent of the annual number of CCA treated poles inspected less than 16 years of age shall be excavated to validate this inspection method. Finally, all CCA treated poles over 16 years of age shall be excavated.

Reporting: Tampa Electric will file the Annual Wood Pole Inspection Report, as an inclusion to the company's Annual Report and Annual Reliability Performance Reports, by March 1st of each year in full accordance with the reporting requirements set forth in Docket No. 20070634-EI, Order No. PSC-2007-0918-PAA-PU, issued November 14, 2007. The report will contain the methods used to determine the strength and structural integrity of wooden poles, the selection criteria for inspected poles, a summary of the results of the inspections, the cause(s) of inspection failures, and the corrective action taken for the failures. The 2021 Annual Wood Pole Inspection Report is on the next page:

Annual Wood Pole Inspection Report:

ORDER NO. PSC-2007-0918-PAA-PU DOCKET NOS. 20070634-EI, 20070635-TL TAMPA ELECTRIC COMPANY Annual Wood Pole Inspection Report 2021												
a	b	c	d	e	f	g	h	i	j	k	l	m
Total # of Wooden Poles in the Company Inventory	# of Pole Inspections Planned this Annual Inspection	# of Poles Inspected this Annual Inspection	# of Poles Failing Inspection this Annual Inspection	Pole Failure Rate (%) this Annual Inspection	# of Poles Designated for Replacement this Annual Inspection	Total # of Poles Replaced this Annual Inspection	# of Poles Requiring Minor Follow-up this Annual Inspection (Anchors/Guys)	# of Poles Overloaded this Annual Inspection	Methods(s) V = Visual E = Excavation P = Prod S = Sound B = Bore R = Resistograph	# of Pole Inspections Planned for Next Annual Inspection Cycle	Total # of Poles Inspected (Cumulative) in the 8-Year Cycle to Date	% of Poles Inspected (Cumulative) in the 8-Year Cycle to Date
Distribution and Transmission				Distribution Reinforcement 0.00%	Distribution Reinforcement 0	Distribution Reinforcement 0	Distribution 67	Distribution Poles Overloaded 0	VESB	** Distribution 35,625	Distribution 285,142	Distribution 100.05%
CYCLE THREE WOOD POLE POPULATION				Distribution Replacement 4.02%	Distribution Replacement 1,458	Distribution Replacement 417	Transmission 67	Transmission 0	VESB	Transmission 538	Transmission 5,512	Transmission 145.28%
Distribution 285,000	Distribution 19,650	Distribution 19,861	Distribution 798	Distribution 4.02%	Distribution 1,458	Distribution 417	Distribution 67	Distribution 0		** Distribution 35,625	Distribution 285,142	Distribution 100.05%
*Transmission	Transmission 215	Transmission 284	Transmission 32	Transmission 11.27%	Transmission 32	Transmission 637	Transmission 0	Transmission 0		Transmission 538	Transmission 5,512	Transmission 145.28%
3,794	Total 19,865	Total 20,145	Total 830	Total 11.27%	Total 1,490	Total 1,054	Total 67	Total 0		Total 36,163	Total 290,654	Total 100.64%
Total Poles 288,794												
If b - c > 0, provide explanation	Availability of contract resources was limited in 2021 and internal resources were focused on customer driven work											
If d - g > 0, provide explanation	Pole inspections charged from region based to circuit based in 2016. Circuits to be inspected are selected by a combination of poor reliability circuits and selection criteria for inspections											

SECTION IV – Rule 25-6.0455 F.A.C.

2021 Reliability Performance

1) Overview

Tampa Electric’s 2021 distribution reliability FPSC indices showed a drop in performance in all the reliability indices when compared to 2020, except for MAIFle. The improvements in MAIFle are attributed to a decrease in breaker events. The increase in SAIDI, CAIDI, SAIFI, CEMI-5 and the slight increase in L-Bar is attributed to two severe weather events. Tampa Electric would have experienced a favorable increase in all reliability indices in 2021, but experienced significant outages during a two-day unnamed storm in April in addition to Hurricane Elsa. Tampa Electric’s actual system reliability indices without the two-day unnamed storm in April and Hurricane Elsa would have been the following:

SAIDI:	63.51
CAIDI:	65.45
SAIFI:	0.97
MAIFle:	6.33
L-BAR:	143.95
CEMI-5:	1.18%

In 2021, Tampa Electric continued to use the Institute of Electrical and Electronics Engineers (“IEEE”) 2.5 Beta methodology for calculating internal reliability indices reporting that was implemented in the company in 2019. In addition, the 2.5 Beta methodology is also used for incentive goals within the company. The IEEE methodology is the industry standard for Reliability measurement and comparison. The table below shows the actual reliability performance for 2021 as compared to 2020 using the IEEE Methodology:

Tampa Electric's 2021 Reliability Performance Summary IEEE 2.5 Beta methodology				
ACTUAL	2020	2021	Difference	Percent Change
SAIDI	73.12	70.43	-2.69	-3.68%
CAIDI	58.35	63.56	5.21	8.93%
SAIFI	1.25	1.11	-0.14	-11.20%
MAIFle	7.81	6.45	-1.36	-17.41%
L-BAR	161.70	144.24	-17.46	-10.80%
CEMI-5	1.14%	1.01%	-0.13%	-11.19%

2) Summary

Tampa Electric’s actual 2021 SAIDI increased by 21.04 minutes as compared to 2020, representing a 26.80 percent increase. The adjusted 2021 adjusted SAIDI increased by 16.61 minutes as compared to 2020 representing a 24.46 percent increase. Actual 2021 CAIDI increased by 8.52 minutes as compared to 2020 representing a 13.21 percent increase. The adjusted 2021 CAIDI increased by 7.07 minutes as compared to 2020 representing a 9.79 percent increase. Actual 2021 SAIFI increased by 0.14 interruptions as compared to 2020 representing a 11.48 percent increase. The adjusted 2021 SAIFI increased by 0.13 interruptions as compared to 2020 representing a 13.83 percent increase. Actual 2021 MAIFle decreased by 1.05 events as compared to 2020 representing a 12.32 percent decrease. The adjusted 2021 MAIFle decreased by 1.29 events as compared to 2020 representing a 16.56 percent decrease. A summary table of Tampa Electric’s reliability performance for 2021 as compared to 2020 is below:

2021 Annual Reliability Performance Report

Tampa Electric's 2021 Reliability Performance Summary				
ACTUAL	2020	2021	Difference	Percent Change
SAIDI	78.51	99.55	21.04	26.80%
CAIDI	64.52	73.04	8.52	13.21%
SAIFI	1.22	1.36	0.14	11.48%
MAIFle	8.52	7.47	-1.05	-12.32%
L-BAR	163.70	167.77	4.07	2.49%
CEMI-5	1.99%	2.59%	0.60%	30.15%
ADJUSTED	2020	2021	Difference	Percent Change
SAIDI	67.90	84.51	16.61	24.46%
CAIDI	72.23	79.30	7.07	9.79%
SAIFI	0.94	1.07	0.13	13.83%
MAIFle	7.79	6.50	-1.29	-16.56%
L-BAR	166.49	174.83	8.34	5.01%
CEMI-5	1.13%	1.18%	0.05%	4.42%

Tampa Electric experienced an increase of 86 overall outages in 2021 as compared to 2020. Six primary outage causes in 2021 had a decrease in outages and five primary outage causes had an increase in outages as compared to 2020. The following six primary causes had a decrease of 2,624 outages as compared to 2020:

- Vegetation decreased by 1,025
- Bad Connection decreased by 686
- Electrical decreased by 373
- Lightning decreased by 321
- Unknown decreased by 121
- Vehicle decreased by 98

The following five primary causes had an increase of 2,710 outages as compared to 2020:

- Down Wire increased by 656
- Animals increased by 567
- Defective Equipment increased by 521
- Other Weather increased by 883
- All Remaining Causes increased by 83

2021 Annual Reliability Performance Report

In comparison to the last five-year average, Tampa Electric experienced 128 less outages in 2021, as compared to 2020, representing a 1.28 percent decrease. For the 2021 outage causes, six of the eleven categories are lower when compared to the five-year average totals. Here is the listing of how the eleven categories changed as compared to the five-year average:

- Vegetation decreased by 38.59 percent
- Lightning decreased by 34.39 percent
- Animals increased by 21.21 percent
- Unknown decreased by 9.26 percent
- Bad Connection decreased by 56.55 percent
- Electrical decreased by 37.29 percent
- Down Wire increased by 105.67 percent
- Vehicle decreased by 21.42 percent
- Other Weather increased by 330.35 percent
- Defective Equipment increased by 383.77 percent
- All Remaining Causes increased by 28.58 percent

Tampa Electric currently tracks outage records in the company's Distribution Outage Database ("DOD") according to the date, duration, customer affected, cause, equipment-type, associated field reports, breaker operations, etc., and uses this information to track and report interdepartmental, intercompany, and external regulatory requests as required.

Tampa Electric continues reviewing system performance and related metrics on a daily basis. Primary areas of focus include incremental and year-to-date semi-weekly SAIDI, CAIDI and SAIFI performance for Transmission, Substation and Distribution, year-to-date MAIFle and associated breaker operations, customer outages by system and service area and major unplanned outages. In addition, Tampa Electric reviews the status of de-energized underground cables, reclosers, online capacitor banks and streetlights previously identified as needing maintenance.

2021 Annual Reliability Performance Report

In 2021, Tampa Electric continued the company's increased focus on the priority of feeder restoration activities. One example of this priority is the review and report of lessons learned on feeder outages where the outage duration exceeded acceptable thresholds. This review and report are done semi-weekly in pursuit of continued improvements with response time.

In addition to reviewing semi-weekly performance as noted above, the company analyzes Distribution circuit performance, including feeders represented on the three percent feeder list, through a number of different ongoing processes. These processes include tree trimming analysis and circuit analysis.

3) Conclusion

Tampa Electric's 2021 distribution reliability indices showed a decline in all the reliability indices when compared to 2020 except for MAIFle.

Generation Events

Tampa Electric experienced no outages due to generation events that would have impacted Distribution Reliability. Because of this, there are no exclusions in the company's 2021 Annual Distribution Reliability Report related to generation outage events.

Transmission Events

1) Transmission Outage Summary

In 2021, there were no transmission outages that affected customers. As a result, there were zero (0) Customer Minutes of Interruption ("CMI") and zero (0) Customer Interruptions ("CI") excluded from the 2021 Annual Distribution Reliability Report per Rule 25-6.0455.

2) Equipment Failure Outages

There were no outages attributed to wood poles, static wires and splices, crossarm failures in 2021.

3) Vehicle Collision Outages

There were no outages due to vehicle collisions with poles and guy wire in 2021.

4) Human Error Outages

There were no outages due to human error in 2021.

5) Vegetation Related Outages

There were no outages due to vegetation in 2021.

6) Animal Related Outages

There were no outages related to animals in 2021.

7) Clearance Outages

There were no outages due to insufficient clearance in 2021.

8) Other and Weather Outages

There were no outages related to weather and other circumstances in 2021.

9) Transmission Outage Detail

69 kV Circuit

There were no outages on the 69 kV circuits in 2021.

138 kV Circuit

There were no outages on the 138 kV circuits in 2021.

230 kV Circuit

There were no outages on the 230 kV circuits in 2021.

Extreme Weather

Tampa Electric experienced no extreme weather events during 2021 which affected transmission customers in the company's service territory.

Other Distribution – Adjustments

In 2021, there were 3,287 Other Distribution outages that affected customers. A total of 8,956,635 CMI and 229,697 CI were excluded from the 2021 Annual Distribution Reliability Report per Rule 25-6.0455. All outages were attributed to planned events as noted within the 2021 Adjustments: Other Distribution Outage Events in Reliability Appendix B.

Distribution Substation

1) Distribution Substation Adjustments

In 2021, there were 107 Distribution Substation outages that affected customers. A total of 3,944,119 CMI and 100,689 CI were excluded from the 2021 Annual Distribution Reliability Report per Rule 25-6.0455. All outages were attributed to substation equipment as noted within the 2021 Adjustments: Substation Outage Events in Reliability Appendix B.

2) Patterns and Trends – Distribution Substation Reliability Performance

In 2021, Substation outages due to breaker failures was the leading substation outage contributor to SAIDI. Events such as a failed interrupter, hydraulic operator or severe damage in the high voltage compartment weighs in the decision to replace a circuit breaker. In addition to the cause of the failure being a reason for replacing the breaker, the age, condition, and lack of spare parts are other factors considered when replacement is necessary.

The second leading substation outage contributor to SAIDI in 2021 was due to transformer failures. In 2021, six substation distribution transformers failed causing customer interruptions. The failed transformers ranged from 37 to 46 years old. Tampa Electric performs regular maintenance and testing on all transformers to monitor the health of a transformer for safe and reliable operation.

In 2021, Substation outages due to circuit breaker mechanism mis-operation were the third leading contributor to SAIDI. Tampa Electric currently has a program in place to

replace aging and problematic circuit breakers. Since 2008, the total number of 13 kV circuit breakers that have been replaced through a 13-kV circuit breaker replacement program and failed circuit breakers is 333. In 2021, 43 circuit breakers and associated circuit protection relaying were replaced as part of the company's capital asset replacement program or failed circuit breakers.

3) Process to Promote Substation Reliability

Tampa Electric's Substation Department utilizes the following processes and activities to determine the actions to promote substation reliability:

- Routine substation inspections
- Root cause analysis of outages
- Track and review of all substation outages

Tampa Electric findings support the following ongoing activities:

- Review of all mis-operation of circuit breakers
- Installation of animal protection in substations
- Install microprocessor-based relays for reclosing in all new construction and upgrade projects
- Replace station wide static under frequency relays with feeder-based microprocessor under frequency relays in all new construction projects
- Replacing 13 kV circuit breakers that have been identified as problem breakers
- Increased lightning withstand protection on Tampa Electric Large Autotransformers
- An improved standard of all bushings on all new transformers and circuit breakers
- Implementation of automatic bus restoration schemes in stations with multiple transformers and microprocessor-based relay protection schemes.

2021 Annual Reliability Performance Report

The tables and exhibits that follow provide number of distribution substation inspections performed by year and the SAIDI Impact in minutes for distribution substation outages by cause. This information is used to gauge and track the substation reliability.

Table 1: Substation Inspections by Year

Substation Inspections		
Year	Distribution Substations	Transmission Substations
2018	418	145
2019	327	152
2020	373	164
2021	460	218

Exhibit 1: 2021 Distribution Substation Outages

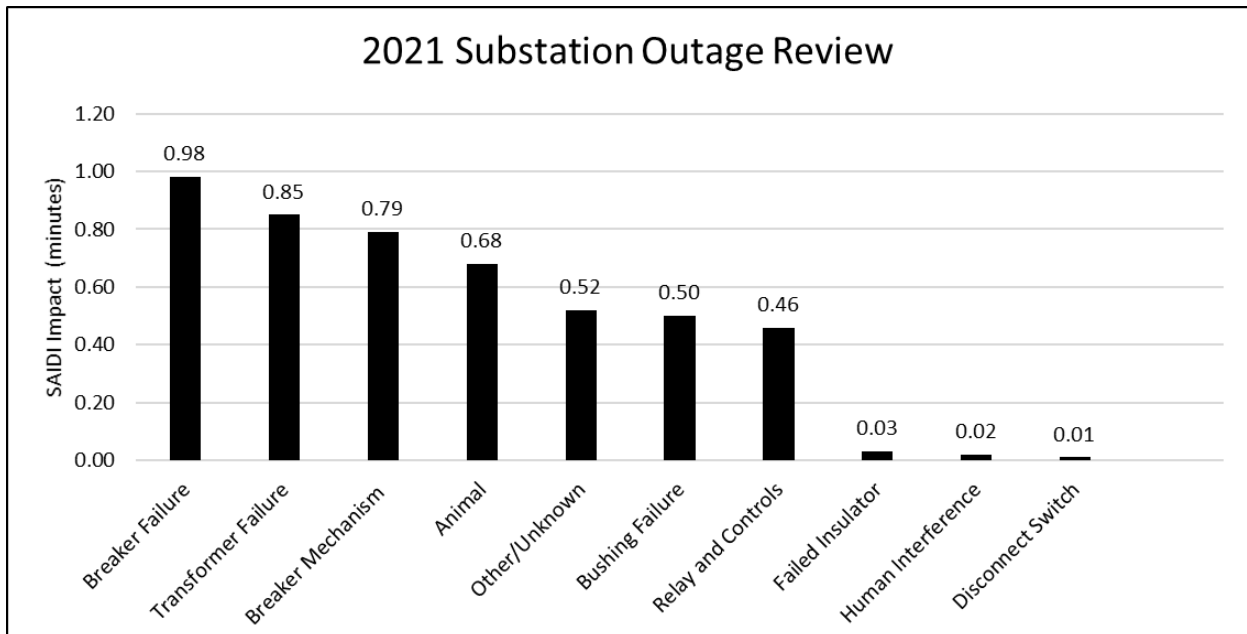


Exhibit 2: 2020 Distribution Substation Outages

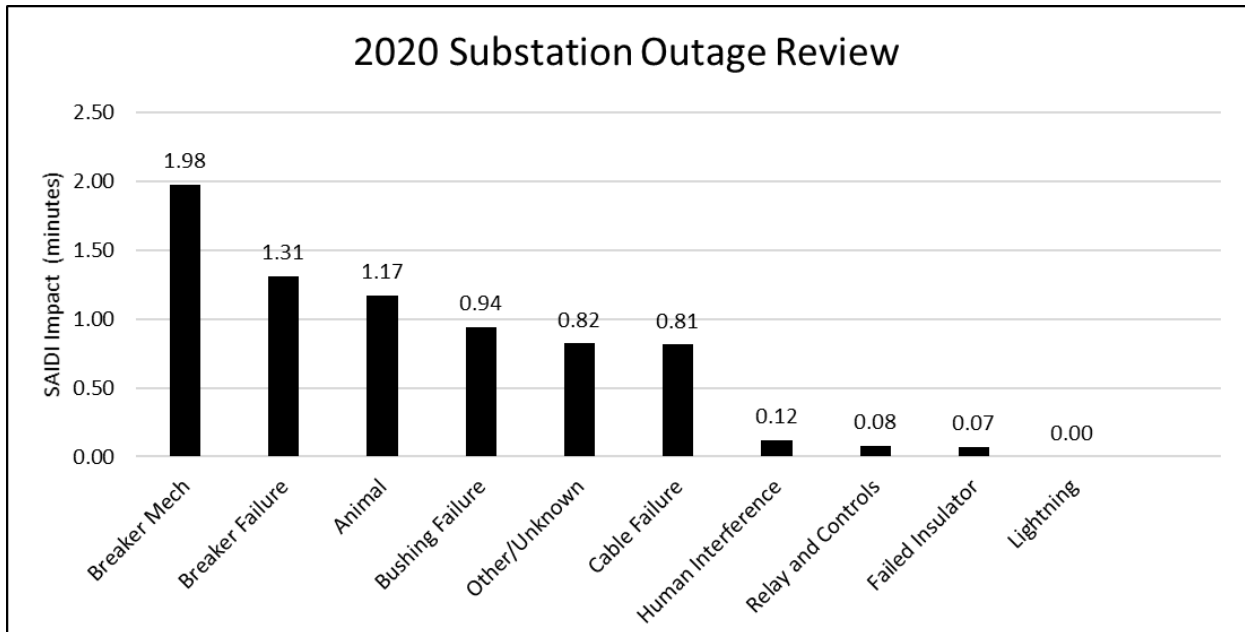


Exhibit 3: 2019 Distribution Substation Outages

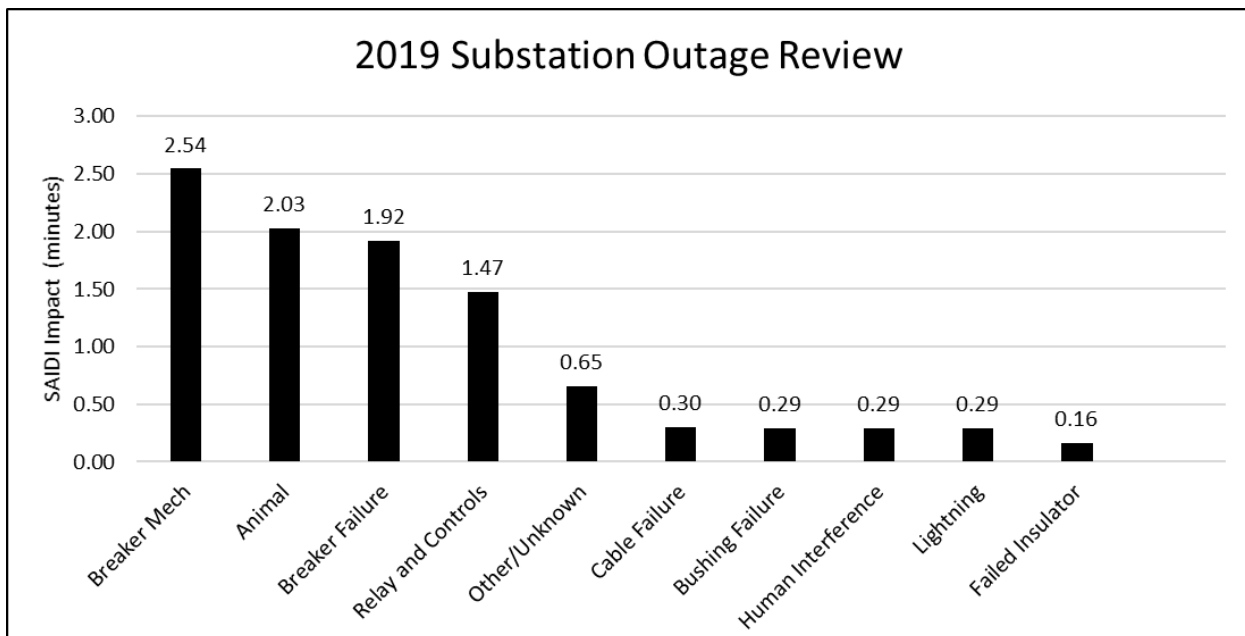


Exhibit 4: 2018 Distribution Substation Outages


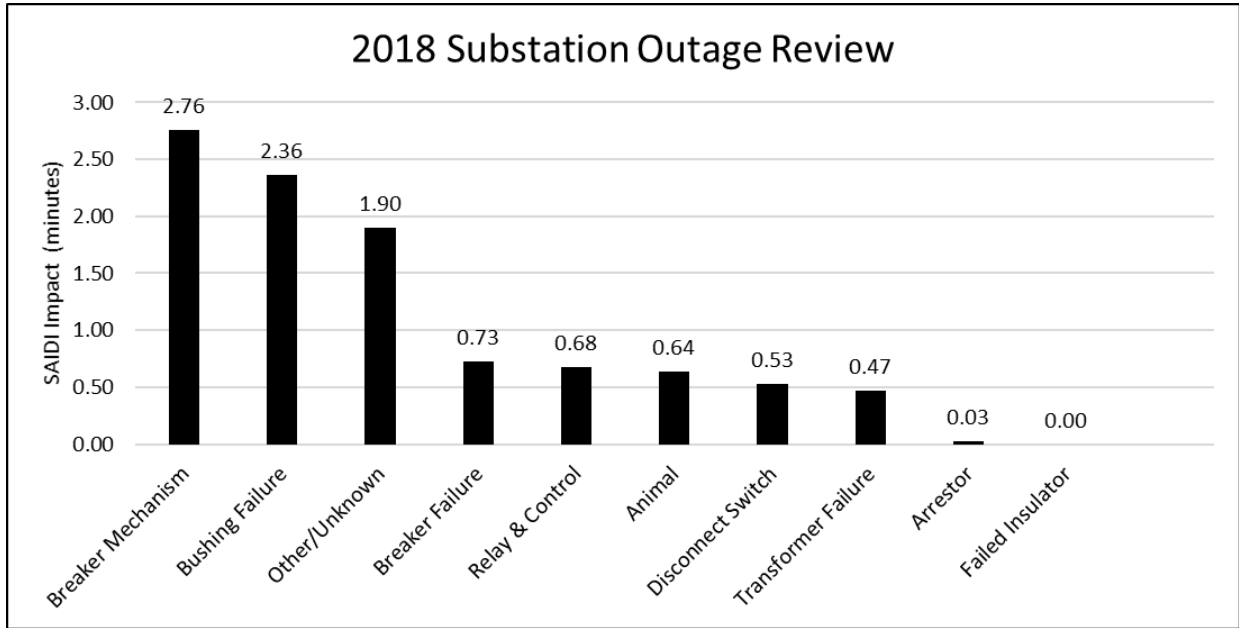


Exhibit 5: 2017 Distribution Substation Outages

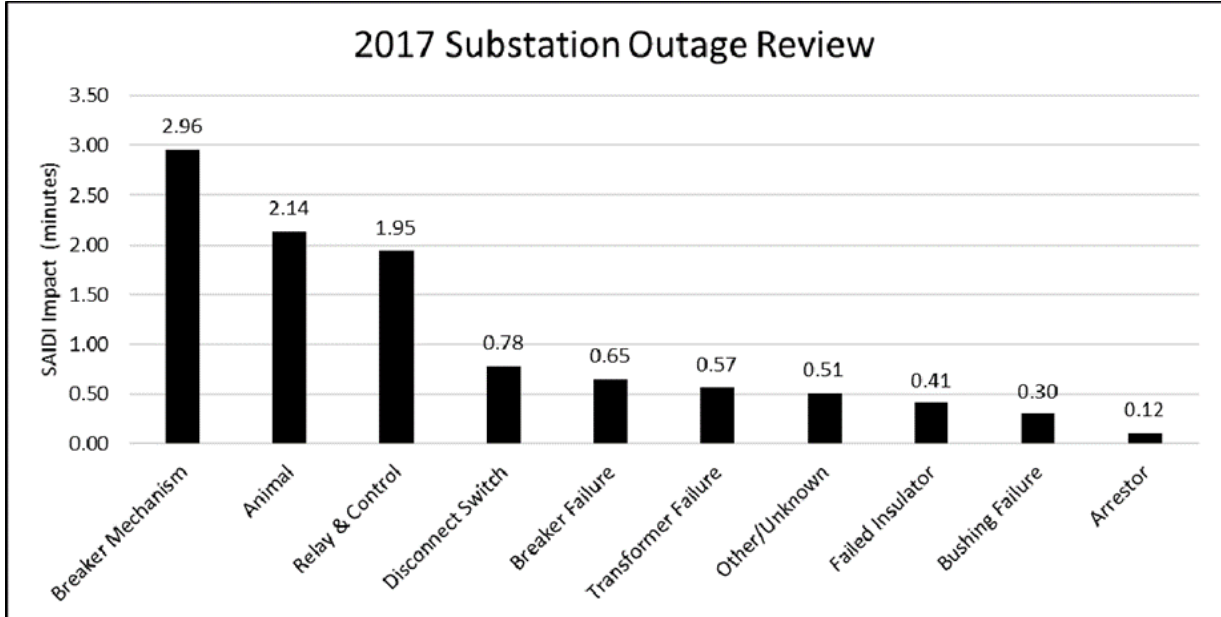

Note 1: The SAIDI impact excluded from substation outages in 2017 due to Hurricane Irma was 27.20 minutes.

Exhibit 6: Substation Outages due to Breaker Failure

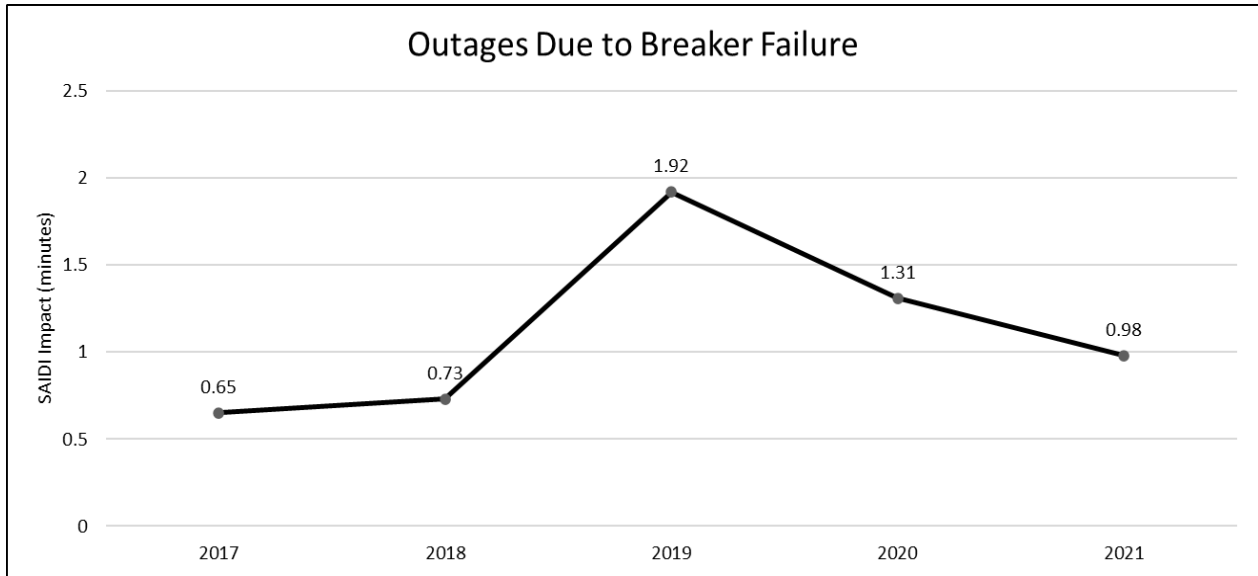


Exhibit 7: Substation Outages due to Transformer Failure


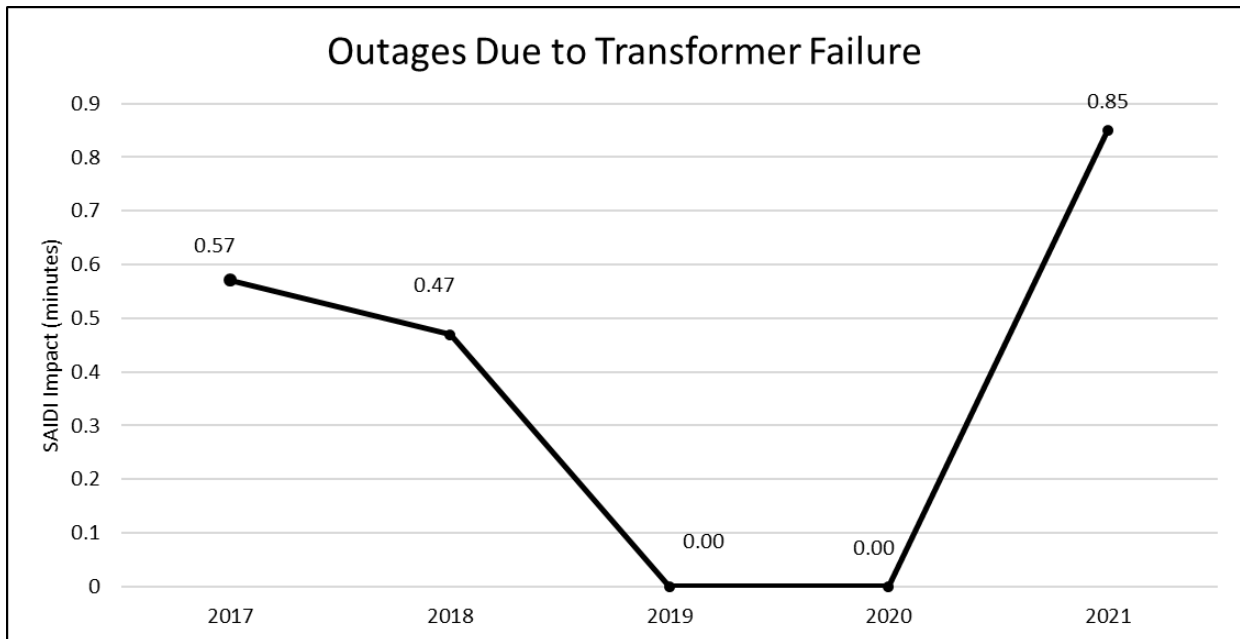


Exhibit 8: Substation Outages due to Breaker Mechanism

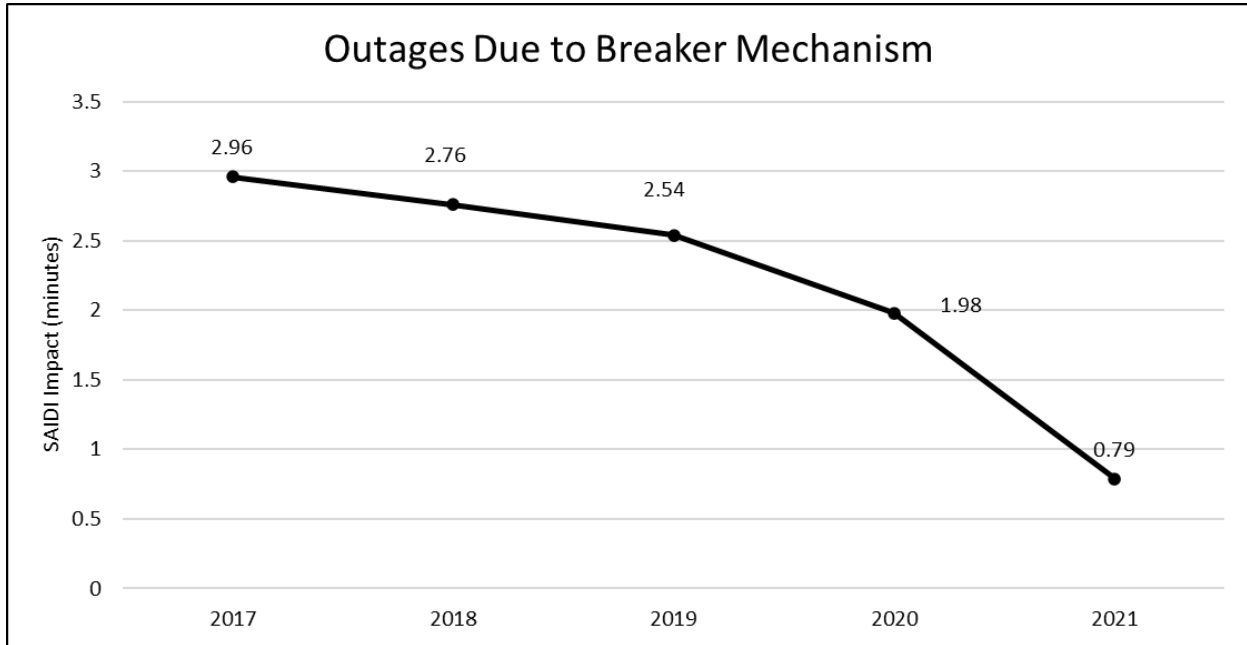

2021 Adjusted Distribution Reliability

1) Causes of Outages

	2017	2018	2019	2020	2021
Vegetation	2,108	2,614	2,357	2,434	1,409
Animals	1,632	1,372	1,788	1,162	1,729
Lightning	1,258	1,981	1,436	1,340	1,019
Electrical	1,113	1,162	1,034	1,052	679
Bad Connection	770	962	861	1,078	392
Unknown	972	1,270	1,356	1,152	1,031
Down Wire	611	557	564	476	1,132
Vehicle	401	360	387	398	300
Other Weather	278	404	214	328	1,211
Defective Equipment	122	135	141	105	626
All Remaining Causes	249	286	366	285	368
System Totals	9,514	11,103	10,504	9,810	9,896

2) Three Percent Feeder

In 2021, Tampa Electric has identified nine circuits that have been listed once before in the prior five years. These circuits include:

- Mulberry Circuit 13010
- Madison Avenue Circuit 13171
- Dade City Circuit 13328
- Kirkland Road Circuit 13388
- Kirkland Road Circuit 13390
- Clarkwild Circuit 13460
- Fowler Avenue Circuit 13830
- Trout Creek Circuit 13988
- Wilderness Circuit 14218

Actual events for Mulberry Circuit 13010 included six circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: replaced primary wires, transformers, poles, and cables. In addition, the company conducted tree trimming on this circuit.

Actual events for Madison Avenue Circuit 13171 included six circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: fuse coordination study and pole replacements.

Actual events for Dade City Circuit 13328 included five circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: replaced transformers, lightning arrestors, switchgear, primary conductor and poles. In addition, the company conducted tree trimming on this circuit.

Actual events for Kirkland Road Circuit 13388 included eight circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: replaced underground primary cables, transformers, poles, switchgear and reframed poles. In addition, the company completed tree trimming on this circuit.

2021 Annual Reliability Performance Report

Actual events for Kirkland Road Circuit 13390 included five circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: replaced primary wires, crossarms, poles, cutouts, and underground primary cable. In addition, the company conducted tree trimming on this circuit.

Actual events for Clarkwild Circuit 13460 included three circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: conducted tree trimming on the circuit.

Actual events for Fowler Avenue Circuit 13830 included two circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: conducted tree trimming on the circuit, cable replacement, and transformer replacements.

Actual events for Trout Creek Circuit 13988 included three circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: replaced cut outs, PMH-9 switchgear, cables, poles, and connectors.

Actual events for Wilderness Circuit 14218 included two circuit outages as reported. The company completed corrective activities on this circuit in 2021 by performing the following: replaced cut outs, PMH switchgear, cables, poles, and connectors.

Other circuits identified in both “Actual” and “Adjusted” reports have had maintenance activities performed as noted on the Three Percent Feeder Report. The company will continue to monitor circuit outage performance as part of its daily and ongoing review of system reliability and will respond accordingly.

Regional Reliability Indices

1) Summary

Table 3 below represents customer by service area for 2021. Dade City, Plant City and Winter Haven have the fewest customers and represent the most rural, lowest customer density per line mile in comparison to the other four Tampa Electric service areas. Actual reliability indices for the rural areas have carried from those of the most urban, densely populated areas for this period. This is due to the greater distance travel for service restoration in rural areas.

In 2021, SAIDI by service areas increased, as compared to 2020, in all areas except the Dade City service area as shown in Table 4 below. The 2021 SAIDI performance compared to the five-year average increased for six of the seven service areas. Actual results by service areas and year have varied for the five-year period.

In 2021, CAIDI by service areas increased, as compared to 2020 in all of the service areas except for the Dade City, Eastern, and Western service areas as shown in Table 5 below. The 2021 CAIDI performance compared to the five-year average increased for four of the seven service areas. Actual results by service areas and year have varied for the five-year period.

In 2021, SAIFI by service areas increased, as compared to 2020, in all areas except for the Dade City service area as shown in Table 6 below. The 2021 SAIFI performance compared to the five-year average increased for six of the seven service areas. Actual results by service areas and year have varied for the five-year period.

In 2021, MAIFLe by service areas decreased, as compared to 2020, in all service areas as shown in Table 7 below. The 2021 MAIFLe performance compared to the five-year average decreased for all seven service areas. Actual results by service areas and year have varied for the five-year period.

2021 Annual Reliability Performance Report

2) Regional Reliability Trends

Table 3 : Number of Customers by Service Area Per Year

	2017	2018	2019	2020	2021
Central	202,572	205,611	209,057	211,631	215,086
Dade City	14,801	14,954	15,305	15,604	15,873
Eastern	122,667	125,030	127,437	129,781	131,248
Plant City	61,187	62,131	63,502	63,954	64,369
South Hillsborough	80,194	84,636	91,219	96,568	101,875
Western	203,805	206,962	210,151	211,714	214,077
Winter Haven	74,403	75,778	78,282	80,016	81,794
System	759,629	775,102	794,953	809,268	824,322

Table 4 : SAIDI by Service Area Per Year

	2017	2018	2019	2020	2021
Central	63.83	86.82	63.23	57.67	63.81
Dade City	153.49	168.45	190.69	186.24	138.06
Eastern	63.49	85.29	83.46	55.72	64.67
Plant City	91.97	112.22	113.54	107.09	157.34
South Hillsborough	84.42	98.82	52.39	52.53	61.23
Western	70.79	96.68	77.47	71.00	76.51
Winter Haven	75.65	92.71	67.35	70.68	152.04
System	72.99	94.70	75.87	67.90	84.51

Table 5 : CAIDI by Service Area Per Year

	2017	2018	2019	2020	2021
Central	78.10	83.28	69.54	75.18	79.08
Dade City	73.25	85.19	88.56	83.38	68.43
Eastern	71.53	85.65	72.43	65.65	63.79
Plant City	63.83	72.30	71.08	71.07	83.68
South Hillsborough	70.37	68.99	51.91	54.80	56.70
Western	71.65	86.35	77.53	82.62	78.79
Winter Haven	62.31	73.07	66.63	68.48	129.33
System	70.94	80.31	70.75	72.23	79.30

Table 6 : SAIFI by Service Area Per Year

	2017	2018	2019	2020	2021
Central	0.82	1.04	0.91	0.77	0.81
Dade City	2.10	1.98	2.15	2.23	2.02
Eastern	0.89	1.00	1.15	0.85	1.01
Plant City	1.44	1.55	1.60	1.51	1.88
South Hillsborough	1.20	1.43	1.01	0.96	1.08
Western	0.99	1.12	1.00	0.86	0.97
Winter Haven	1.21	1.27	1.01	1.03	1.18
System	1.03	1.18	1.07	0.94	1.07

Table 7 : MAIFIE by Service Area Per Year

	2017	2018	2019	2020	2021
Central	7.87	8.08	7.86	6.36	5.37
Dade City	14.17	14.76	12.29	10.51	6.51
Eastern	8.76	10.15	10.81	6.40	5.96
Plant City	12.78	14.72	13.74	10.81	7.49
South Hillsborough	10.84	11.05	9.37	8.26	5.95
Western	8.40	8.26	9.45	7.75	7.56
Winter Haven	9.66	9.95	10.70	10.40	7.48
System	9.16	9.63	9.76	7.79	6.50

Table 8 : CEMI% by Service Area Per Year

	2017	2018	2019	2020	2021
Central	0.18%	1.41%	0.81%	0.29%	0.71%
Dade City	6.64%	4.73%	11.17%	7.67%	1.56%
Eastern	1.79%	0.77%	2.10%	1.00%	1.94%
Plant City	3.02%	1.10%	4.03%	3.38%	5.43%
South Hillsborough	2.43%	2.93%	4.62%	2.92%	0.90%
Western	0.30%	1.19%	1.69%	0.33%	0.28%
Winter Haven	0.20%	2.23%	0.39%	0.47%	0.51%
System	1.07%	1.54%	2.13%	1.13%	1.18%

Overhead – Underground Reliability

1) Five-Year Trends – Reliability Performance


Table 9 : Outages per Year

System Totals	2017	2018	2019	2020	2021
Number of Outages Events (N)	9,514	11,103	10,504	9,810	9,896
System Average Duration (L-Bar)	177.04	179.74	173.09	166.49	174.83
Average Restoration Time (CAIDI)	70.94	80.31	70.75	72.23	79.30

Overhead	2017	2018	2019	2020	2021
Number of Outages Events (N)	7,731	9,087	8,571	8,018	7,993
System Average Duration (L-Bar)	168.21	171.85	165.79	158.36	169.78
Average Restoration Time (CAIDI)	65.45	75.55	65.24	67.75	75.46

Underground	2017	2018	2019	2020	2021
Number of Outages Events (N)	1,783	2,016	1,933	1,792	1,903
System Average Duration (L-Bar)	215.32	214.57	205.47	202.88	196.05
Average Restoration Time (CAIDI)	118.20	124.44	112.95	110.27	108.54

Exhibit 9: Overhead to Underground Outage Duration

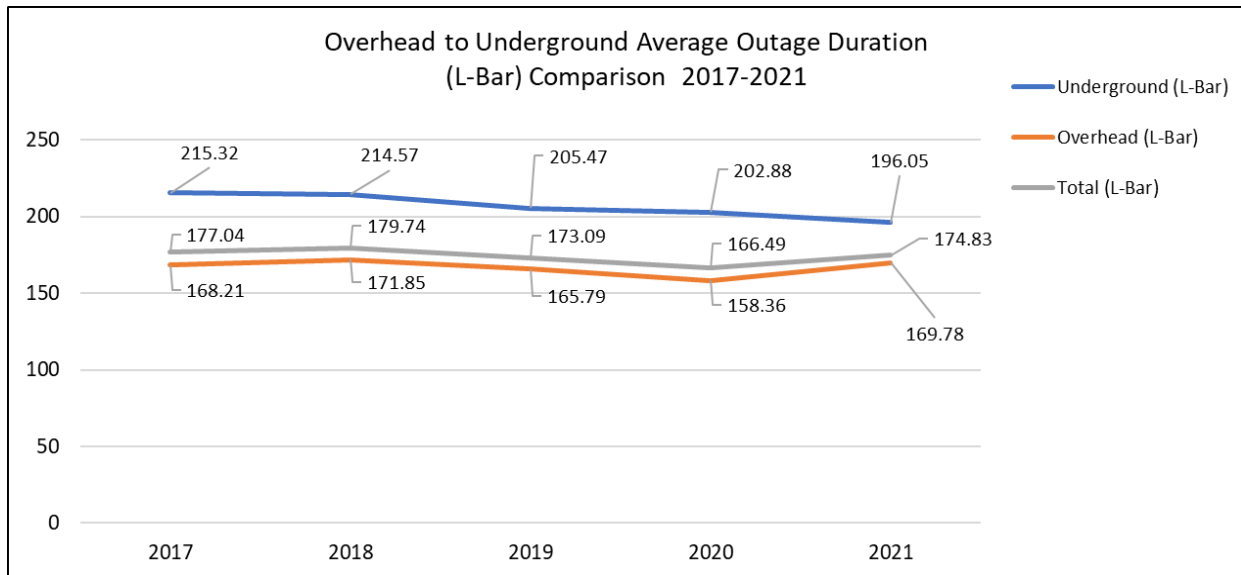

2) Tracking Overhead to Underground Reliability Performance

Tampa Electric tracks outage records in the company's DOD according to cause and equipment type. These equipment types are designed and associated with the overhead and underground systems. Reporting capability allows the company to track CMI, CI, Number of outages, Average Duration and CAIDI as referenced in Section C – Overhead to Underground in the Appendix. In addition, separate reporting was undertaken in order to align miles and customers for overhead and underground distribution.

The company tracks and reports MAIFle by system and circuit. Interruption data is electronically captured, recorded and tracked at each individual distribution circuit breaker. As a result, a momentary interruption occurring down-line from the circuit breaker in which the circuit breaker does not operate is not currently captured and cannot be reported.

The company currently measures CEMI-5 through a query that is run through the company's DMS. There is no option to run a query for overhead or underground systems. Therefore, the company is unable to provide CEMI-5 as previously requested by Commission Staff.

3) Underground Distribution System Conversions

Over the past ten years, the Dana Shores Civic Association and Tampa Electric have been working with Hillsborough County to create and execute a Municipal Service Benefit Units ("MSBU") ordinance and initiate the first project under this new mechanism. The MSBU provides an opportunity for neighborhoods to set up self-elected taxing districts that would fund capital upgrade through annual Ad Valorem taxes. At the end of 2021, the project had nine homes remaining to be converted from overhead to underground. The company is projecting that these remaining homes will be converted prior to the 2022 storm season.

Reliability-Related Customer Complaints

In 2021, Tampa Electric experienced a decrease of seven (7) formal service-related complaints as logged by the Florida Division of Consumer Affairs and noted in Exhibit 10 below. In addition, service-related complaints as tracked by the company and including FPSC Formal, Three-Day, Transfer-Connect, eWarm Transfer and Executive Level decreased 32 complaints in 2021 as noted in Exhibit 11 below. In comparison to the five-year average, overall complaints decreased by 49.38 percent in 2021.

When comparing, formal complaints logged against the company to reliability performance (Exhibits 12 and 13 below) over the last five years, the reliability performance has varied, and complaints have tracked accordingly. The company believes that a continued focus on activities such as vegetation management, circuit review activity and resulting line improvements and other maintenance activities will contribute toward minimizing service-related complaints in 2022 and beyond.

Tampa Electric's current process for responding to all service-related complaints includes the central intake and coordination of complaint resolution through the company's Quality Assurance Department and extends out to operations engineers who are responsible for the daily oversight of feeders in their respective service area. Operations engineers are involved in customer interactions, identifying needs and corrective measures and are responsible for coordination through to completion. Working through and responding to complaints at a region/service area level provides the company an opportunity to be aware of any trends that may occur for a given feeder or lateral.

In addition, the group of Operations Engineers and System Reliability meet monthly to review common areas of concern across the system and identifies opportunities for improvement.

**Exhibit 10: Tampa Electric Formal Reliability Complaints
Filed with the FPSC by Year**

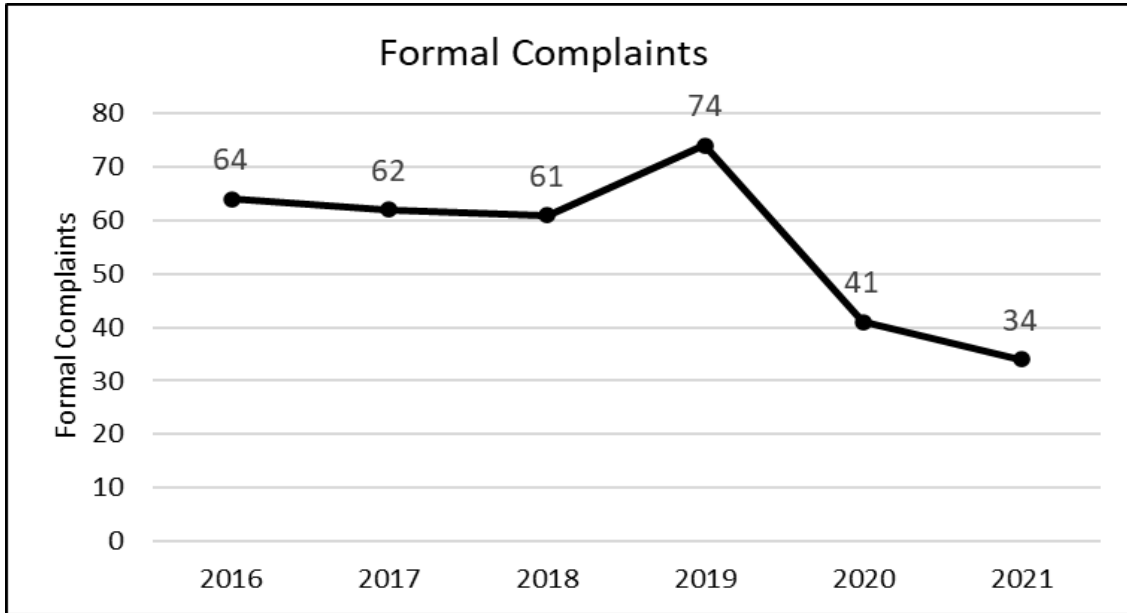


Exhibit 11: Tampa Electric Service Complaints by Year

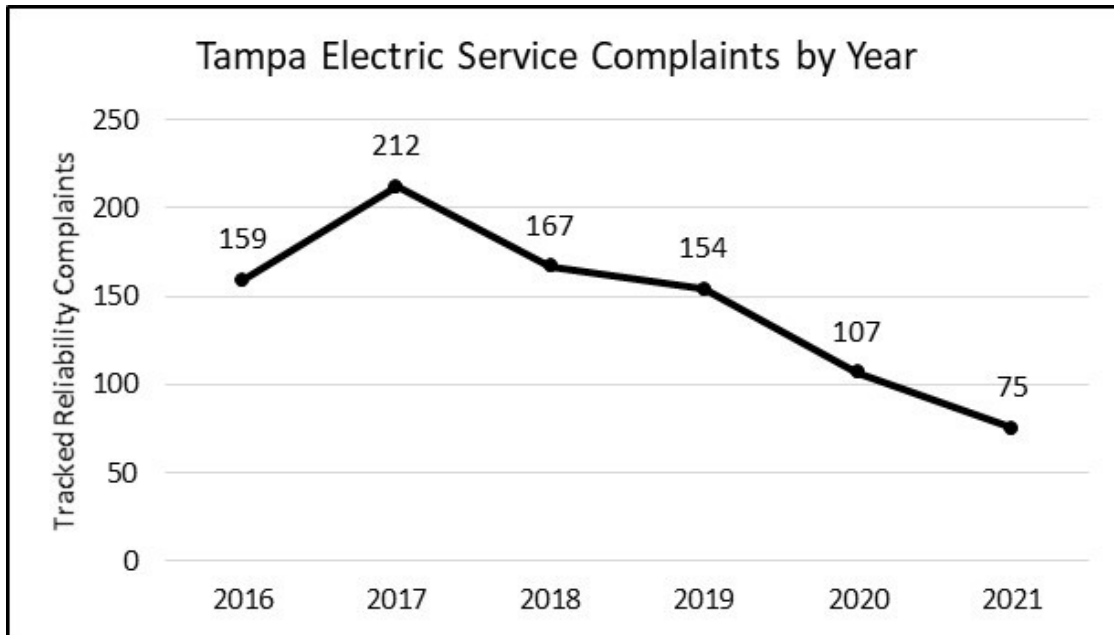


Exhibit 12: Formal Complaints vs. SAIDI by Year


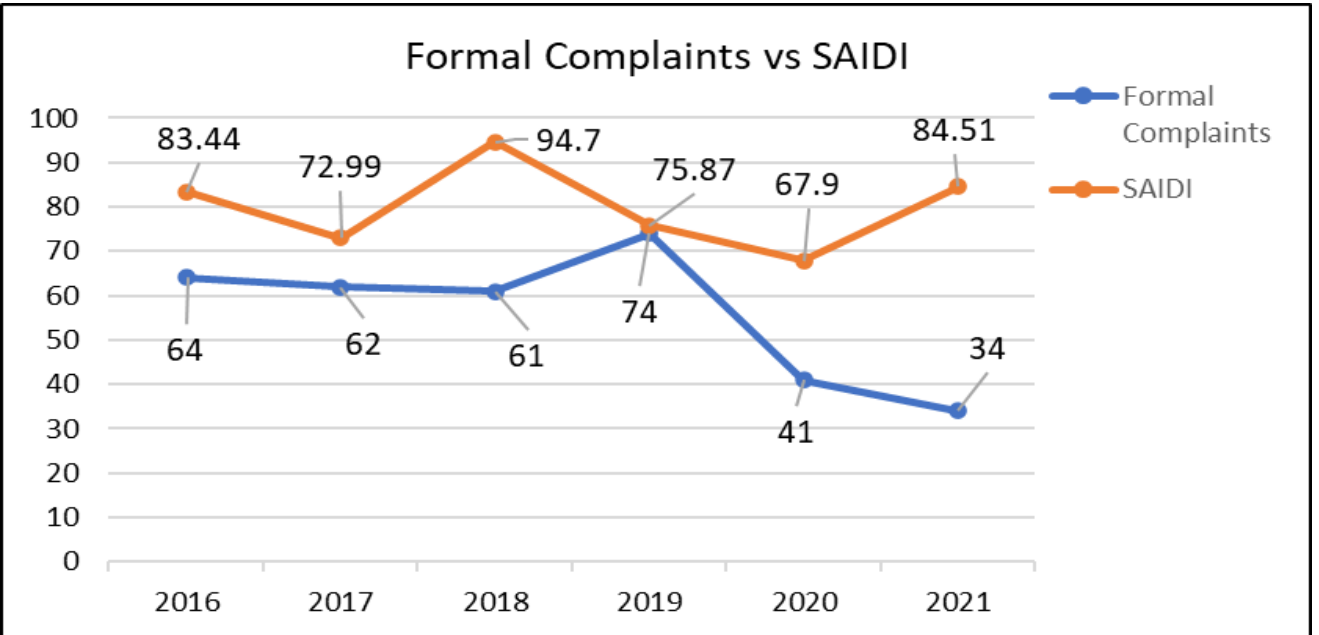


Exhibit 13: Formal Complaints vs. MAIFle by Year



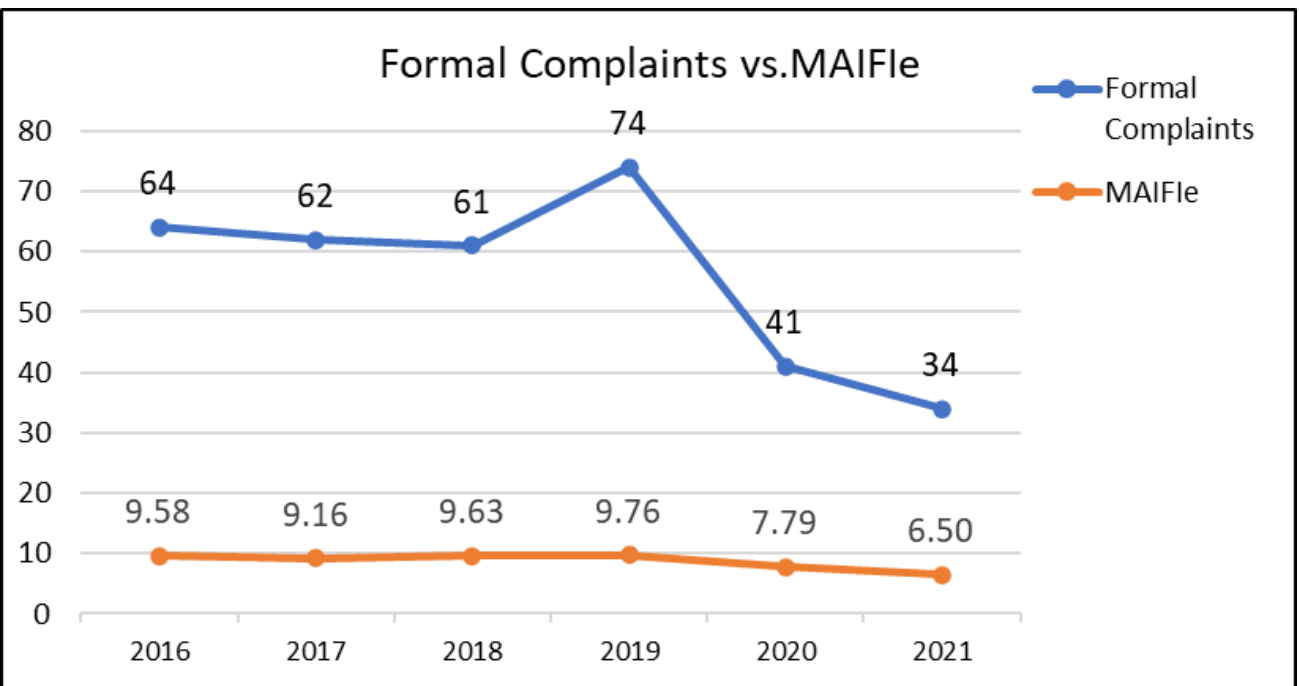

TECO[®]
TAMPA ELECTRIC
AN EMERA COMPANY

APPENDIX

2021

ANNUAL RELIABILITY PERFORMANCE REPORT

2021 Annual Reliability Performance Report

Reliability Appendix A

Form PSC/ECR 102-1(a)(8/06)

Primary Causes of Outage Events			
Utility Name: Tampa Electric			Year: 2021
Cause (a)	Number of Outages Events (N) (b)	Average Duration (L-Bar) (c)	Average Restoration Time (CAIDI) (d)
Planned Outage	3,501	140.73	39.26
Animals	1,738	111.22	75.71
Vegetation	1,483	193.00	79.84
Other Weather	1,273	287.34	150.16
Down Wire	1,141	178.07	78.02
Unknown	1,038	113.84	42.62
Lightning	1,031	211.87	130.09
Electrical	694	132.60	51.76
Defective Equipment	634	189.66	87.65
Bad Connection	398	190.21	67.59
Vehicle	301	173.73	77.63
Human Interference	159	174.43	40.06
Other	97	141.20	73.19
Substation Equipment	71	222.88	53.15
Fire	22	137.09	76.42
Transmission Equipment	16	159.93	81.27
Customer Owned Equipment	9	217.94	95.49
Unassigned	1	42.73	42.73
Structure	0	0.00	0.00
Total	13,607	167.77	73.04

Note: L-Bar and CAIDI are expressed in minutes.

Form 102 – Part II – Actual

FPSC Annual Report - 3 Percent Feeder List (Actual)

Primary Circuit Id. No. or Name (a)	Substation Origin (b)	Location (c)	Number of Customers				Circuit Outages "N" (h)	Avg. Duration "L-Bar" (i)	CAIDI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (n)
			Residential (d)	Commercial (e)	Industrial (f)	Total (g)						
13967	JAN PHYL	Winter Haven	1,676	54	0	1,730	25	539.63	89.43	N	0	4/6,5/28,9/10,4/26,12/21,10/24
13388	KIRKLAND RD	Plant City	646	118	0	764	21	108.94	41.66	N	2	10/21, 8/31, 11/22, 11/29, 6/14, 12/6, 5/12, 8/28, 11/14, 11/20, 6/2, 9/4, 5/21, 4/19, 4/26, 3/15, 9/22, 8/14, 6/24, 12/12, 11/7, 6/17, 7/6, 3/24, 2/18
14025	RIVERVIEW	South Hillsborough	2,992	169	0	3,161	18	71.74	35.64	N	0	1/15, 1/6, 2/26, 3/20, 4/11, 4/16, 4/17, 4/2, 5/10, 6/14, 6/15, 6/28, 7/1, 7/19, 7/20, 7/21, 7/7, 8/10, 8/16, 8/18, 9/28, 10/11, 10/14, 10/30, 10/4, 12/12
13418	JUNEAU	Central	1,469	108	0	1,597	16	128.09	30.46	N	0	
13121	ALEX RD	Plant City	728	127	0	855	16	64.70	6.15	N	0	5/3, 4/5, 2/12, 7/16, 7/18, 8/31, 2/28, 8/4, 4/5, 3/12, 8/15, 1/5, 12/6
13962	TERRACE	Plant City	1,162	151	0	1,313	15	162.13	42.25	Y	1	9/10, 2/2, 11/24, 8/13, 7/16, 7/6, 2/22, 6/29, 5/18, 4/13, 8/25, 4/14, 10/14, 7/30, 8/25, 8/24, 8/12, 11/6, 10/16, 12/6, 9/16, 10/20, 5/15, 8/4, 2/5, 7/1, 7/2, 12/16, 9/3
13010	MULBERRY	Plant City	1,511	204	0	1,715	14	104.18	68.22	Y	2	1/11, 1/13, 12/15, 12/27, 6/11, 9/3, 9/13, 2/17, 5/31, 2/6, 11/16, 7/14, 10/7, 7/13
13028	TEMP TER	Central	1,910	139	0	2,049	13	62.18	47.97	N	2	04/17, 09/16, 05/14, 02/24, 08/26, 11/18, 07/16, 04/23, 10/29, 05/09, 05/21, 01/14, 10/29
13228	BRANDON	Eastern	712	409	0	1,121	11	88.83	34.35	N	0	4/14, 8/16, 12/6, 8/19, 10/27, 1/27, 5/7, 7/2, 6/7
13036	BELMONT	Central	1,212	144	0	1,356	10	138.18	49.81	N	0	5/6, 2/22, 05/16, 09/22, 11/23, 2/7, 7/22, 11/20, 9/3, 2/28, 1/29, 5/14, 12/30, 11/11, 1/22, 12/30, 9/2, 9/17, 8/20, 11/11, 10/27, 10/13
13460	CLARKWILD	Eastern	1,047	153	0	1,200	10	213.98	54.15	Y	2	12/6, 10/5, 5/18, 2/11, 7/26, 4/20, 7/2, 6/3
13326	PORT SUTTON	Eastern	240	218	0	458	10	108.49	67.43	N	0	
13390	KIRKLAND RD	Plant City	1,571	240	0	1,811	10	437.78	226.83	N	1	7/22, 1/19, 6/21, 4/9, 6/16, 2/24, 4/16, 4/21, 6/21, 10/12, 5/28, 4/2, 6/14, 6/21, 6/7, 6/17, 8/6, 6/11, 7/27, 8/2, 4/20, 11/18, 3/13, 4/1, 6/23, 8/10, 6/11, 7/6, 9/21, 3/1, 3/27, 9/21, 3/1, 11/15, 7/19, 10/20, 9/26, 11/23, 6/25, 6/28, 6/29, 5/31, 8/5, 6/13, 8/20, 4/20, 12/16, 4/21, 10/19, 3/25, 4/30, 4/29, 5/27, 10/25, 8/12, 6/25, 8/12, 3/13, 7/2, 4/29, 8/20, 4/27, 6/26, 9/17, 7/13, 9/2
13740	CLEARVIEW	Western	1,249	147	0	1,396	10	74.79	20.65	N	0	
14102	CROSSCRK	Central	1,861	120	0	1,981	9	86.41	43.26	N	1	5/20, 5/19, 5/16, 2/1, 5/25, 8/10, 7/22, 8/12, 4/9, 8/13, 4/5, 4/23, 11/10
14012	GTE COLLIER	Central	1,462	234	0	1,696	9	105.04	38.04	Y	1	12/5, 11/27, 10/22, 8/30, 3/2, 12/28, 12/27, 10/1, 1/29, 9/1, 5/7, 10/1, 6/11
13988	TROUT CREEK	Central	1,427	37	0	1,464	9	124.45	101.46	Y	2	1/18, 6/17, 1/13, 1/19, 3/29, 9/21, 2/20, 1/28, 3/29, 1/7, 5/17, 1/7, 10/14, 5/12
14218	WILDERNES	Central	2,449	201	0	2,650	9	168.64	73.47	Y	1	10/18, 11/23, 6/28, 1/17, 6/25, 4/22, 1/5, 5/12, 10/20, 1/4, 11/29, 6/11, 1/11, 2/26, 9/1
13328	DADE CITY	Dade City	421	176	0	597	9	112.70	53.33	N	1	1/8, 7/27, 6/3, 9/3, 5/9, 7/6, 12/6, 2/5, 4/23, 3/9, 3/24, 6/14, 8/12, 10/28, 6/5, 11/27, 6/4
13461	CLARKWILD	Eastern	1,193	172	0	1,365	9	167.07	99.94	N	0	12/29, 9/22, 9/21, 4/15, 7/12
13171	MAPISON AV	Eastern	1,582	173	0	1,755	9	150.65	65.64	N	1	12/6
13984	CORONET	Plant City	775	127	0	902	9	205.27	92.18	N	0	5/4, 3/24, 11/11, 11/22, 1/15, 8/30, 5/31, 12/14, 4/28, 3/22, 7/30, 6/9, 10/21, 1/14, 10/6, 12/15, 2/28
13112	MANHATTAN AV	Western	2,273	220	0	2,493	9	69.89	34.60	N	2	4/9, 12/28, 10/16, 7/2, 1/18, 5/2, 9/7, 9/28, 10/27, 11/18, 8/28, 9/9, 7/22, 6/11, 1/15, 1/20, 4/30, 10/19, 10/15, 7/15, 9/13, 6/13, 5/6, 11/21, 11/28, 2/10, 6/3, 7/7, 7/12, 7/12, 9/13, 8/11, 9/16, 8/10, 10/28, 6/5, 6/6
13830	FOWLER	Central	629	25	0	654	8	144.66	44.13	N	1	9/18, 7/1, 4/7, 6/20, 9/2, 1/29, 9/22, 7/19, 8/19, 7/20, 6/20, 9/21, 8/5, 4/23, 11/18, 8/20
13562	MARION ST	Central	0	14	0	14	8	5.03	5.03	N	0	
13989	PLYMOUTH ST	Central	1,069	100	0	1,169	8	166.82	92.74	N	0	3/10, 6/13, 10/1, 9/13, 1/14, 2/26, 3/1, 3/4, 11/18, 7/2, 6/18, 2/4, 8/6, 7/15, 4/29, 4/14, 11/10, 5/31, 6/17, 8/26, 10/20, 5/20, 8/19, 1/8, 5/16, 5/29, 4/23, 3/10
13953	SR 60	Eastern	8	384	0	392	8	97.39	36.18	N	0	
13389	KIRKLAND RD	Plant City	1,002	134	0	1,136	8	152.27	57.37	N	0	5/20, 8/23, 12/13, 8/23, 3/26, 12/2, 2/14, 6/16, 12/12, 6/24, 7/22, 10/25, 7/18, 8/9, 7/13
13007	MULBERRY	Plant City	334	253	0	587	8	141.56	60.92	Y	3	12/14, 4/28, 11/10, 7/9, 11/20, 10/21, 2/2, 6/15, 12/13, 9/25, 11/24, 6/7, 3/29, 12/17, 7/28, 10/4, 3/5, 9/18, 4/9, 3/5, 6/4, 2/26, 2/21, 2/15, 3/21, 5/26, 3/30, 7/28, 3/28
14002	SYDNEY RD	Plant City	782	35	0	817	8	115.19	71.63	N	0	4/2, 7/14, 11/15, 6/21, 12/6, 5/23, 1/3, 1/4, 2/6, 4/2, 2/20, 2/6, 2/23, 1/21, 2/11
14146	SUN CITY	South Hillsborough	670	149	0	819	8	86.34	77.05	N	0	3/5, 6/2, 9/7, 9/27, 9/29, 10/11, 10/25, 11/2, 11/12, 12/3, 12/6, 12/16

2021 Annual Reliability Performance Report

Form 102 – Part III – Actual

ANNUAL DISTRIBUTION RELIABILITY REPORT - 2021

Utility Name: Tampa Electric

SAIDI: System Average Interruption Duration Index		
= <u>Sum of All Customer Minutes Interrupted (CMI)</u>	<u>82,064,031</u>	99.55
Total number of Customers Served (C)	824,322	
CAIDI: System Average Interruption Duration Index		
= <u>Sum of All Customer Minutes Interrupted (CMI)</u>	<u>82,064,031</u>	73.04
Total number of Customer Interruptions (CI)	1,123,476	
SAIFI: System Average Interruption Frequency Index		
= <u>Total number of Customer Interruptions (CI)</u>	<u>1,123,476</u>	1.36
Total number of Customers Served (C)	824,322	
MAIFle: Momentary Average Interruption Event		
= <u>Sum of All Customer Momentary Interruption Events (CME)</u>	<u>6,157,055</u>	7.47
Total number of Customers Served (C)	824,322	
L-Bar:		
= Minutes of Interruption	<u>2,282,891</u>	167.77
Total number of Outages	13,607	

District	C	CMI	CI	CME	CEMI-5
Central	215,086	16,137,509	240,474	1,311,491	3,178
Dade City	15,873	2,333,188	39,469	140,212	1,885
Eastern	131,248	11,205,641	167,425	904,069	3,801
Plant City	64,369	11,464,523	153,987	584,028	8,198
South Hillsborough	101,875	7,501,788	131,030	696,356	1,733
Western	214,077	20,068,519	274,869	1,811,345	1,305
Winter Haven	81,794	13,352,863	116,207	709,554	1,280
System Total:	824,322	82,064,031	1,123,461	6,157,055	21,380

2021 Annual Reliability Performance Report

Form 102 – Part III continued – Actual

Service Reliability Indices - Actual					
Utility Name: Tampa Electric			Year: 2021		
District or Service Area (a)	SAIDI	CAIDI	SAIFI	MAIFle	CEMI-5%
Central	75.03	67.11	1.12	6.10	1.48%
Dade City	146.99	59.11	2.49	8.83	11.88%
Eastern	85.38	66.93	1.28	6.89	2.90%
Plant City	178.11	74.45	2.39	9.07	12.74%
South Hillsborough	73.64	57.25	1.29	6.84	1.70%
Western	93.74	73.01	1.28	8.46	0.61%
Winter Haven	163.25	114.91	1.42	8.67	1.56%
System Total:	99.55	73.04	1.36	7.47	2.59%

Form PSC/ECR 102-3, Docket No. 20011351-EI, Rule 25-6.0455(c)

Note: L-Bar and CAIDI are expressed in minutes

2021 Annual Reliability Performance Report

Reliability Appendix B

Form PSC/ECR 102-1(b) (8/06)

Causes of Outage Events - Adjusted			
Utility Name: Tampa Electric		Year: 2021	
Cause (a)	Number of Outages Events (N)	Average Duration (L-Bar)	Average Restoration Time (CAIDI)
1. Animals	1,729	110.77	75.04
2. Vegetation	1,409	184.43	77.67
3. Other Weather	1,211	288.40	140.29
4. Down Wire	1,132	177.65	76.36
5. Unknown	1,031	113.34	42.43
6. Lightning	1,019	210.94	137.63
7. Electrical	679	131.94	51.78
8. Defective Equipment	626	187.72	87.32
All Remaining Causes	1,060	182.85	71.71
Total	9,896	174.83	79.30

Note: L-Bar and CAIDI are expressed in minutes.

Form 103 - PART II – Adjusted

FPSC Annual Report - 3 Percent Feeder List (Adjusted)

Primary Circuit Id. No. or Name	Substation Origin (b)	Location (c)	Number of Customers			Circuit Outages "N" (h)	Avg. Duration "L-Bar" (i)	CADI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (n)	
			Residential (d)	Commercial (e)	Industrial (f)							Total (g)
13867	JAN PHYL	Winter Haven	1,676	54	0	1,730	24	569.80	118.03	N	0	4/6, 5/28, 9/10, 4/26, 12/21, 10/24
13010	MULBERRY	Plant City	1,511	204	0	1,715	14	97.66	67.13	Y	2	1/11, 1/13, 12/15, 12/27, 6/11, 9/13, 9/13, 2/17, 5/31, 2/6, 11/16, 7/14, 10/7, 7/13
13228	BRANDON	Eastern	712	409	0	1,121	10	94.65	44.60	N	0	4/14, 8/16, 12/6, 8/19, 10/27, 1/27, 5/7, 7/2, 8/7
13460	CLARKWILD	Eastern	1,047	153	0	1,200	10	233.08	60.94	Y	2	8/20, 11/11, 10/27, 10/13
13390	KIRKLAND RD	Plant City	1,571	240	0	1,811	10	497.96	264.08	N	1	7/22, 1/19, 6/21, 4/9, 6/16, 2/24, 4/16, 4/21, 6/21, 10/12, 5/28, 4/2, 6/14, 6/21, 6/7, 6/17, 8/6, 6/11, 7/27, 8/2, 4/20, 11/18, 3/13, 4/1, 6/23, 8/10, 6/11, 7/6, 9/21, 3/1, 3/27, 9/21, 3/1, 11/15, 7/19, 7/19, 10/20, 9/26, 11/23, 6/25, 6/28, 8/29, 5/31, 8/5, 6/13, 8/20, 4/20, 10/14, 5/12
13988	TROUT CREEK	Central	1,427	37	0	1,464	9	146.42	101.18	Y	2	1/18, 6/17, 1/13, 1/19, 3/29, 9/21, 2/20, 1/28, 3/29, 1/7, 5/17, 1/7
14218	WILDERNES	Central	2,449	201	0	2,650	9	202.03	73.59	Y	1	10/18, 11/23, 6/28, 1/17, 6/25, 4/22, 1/5, 5/12, 10/20, 1/4, 11/29
13326	PORT SUTTON	Eastern	240	218	0	458	9	111.38	82.55	N	0	12/6, 10/5, 5/18, 2/11, 7/26, 4/20, 7/2, 8/3
13600	FOWLER	Central	629	25	0	654	8	144.74	42.61	N	1	8/18, 7/1, 4/7, 6/20, 9/2, 1/29, 9/22, 7/19, 8/19, 7/20, 6/20, 5/21, 8/5, 4/23, 11/18, 8/20
13089	PLYMOUTH ST	Central	1,099	100	0	1,199	8	156.65	88.30	N	0	3/10, 6/13, 10/1, 9/13, 1/14, 2/26, 3/1, 3/4, 11/18, 7/2, 6/18, 2/4, 8/6, 7/15, 4/29, 4/14, 11/10, 5/31, 6/17, 8/26, 10/20, 5/20, 8/19, 1/8
13853	SR 60	Eastern	8	384	0	392	8	86.38	35.43	N	0	5/16, 5/29, 4/23, 3/10
13388	KIRKLAND RD	Plant City	646	118	0	764	8	146.04	51.41	N	2	10/21, 8/31, 11/22, 11/29, 6/14, 12/6, 5/12, 9/28, 11/14, 11/20, 6/2, 8/4, 5/21, 4/19, 4/26, 3/15, 9/22, 9/14, 6/24, 12/12, 1/17, 6/17, 7/6, 3/24, 2/18
14002	SYDNEY RD	Plant City	782	35	0	817	8	99.80	68.50	N	0	4/2, 7/14, 11/15, 6/21, 12/6, 5/23, 1/3, 1/4, 2/6, 4/2, 5/2, 2/20, 2/6, 2/23, 1/21, 2/11
14146	SUN CITY	South Hillsborough	670	149	0	819	8	103.40	78.05	N	0	3/5, 8/2, 9/7, 9/27, 9/29, 10/11, 10/25, 11/2, 11/12, 12/3, 12/6, 12/16
13838	FLORIDA AV	Central	1,594	218	0	1,812	7	194.35	230.24	N	0	3/26, 7/9, 11/15, 2/10, 4/18, 7/26, 10/28, 5/28, 6/19, 1/3, 10/7, 2/26, 3/18, 12/13, 8/12, 3/5, 11/19, 1/4, 5/27, 12/28
13097	SUNST LN	Central	1,349	95	0	1,444	7	183.23	81.28	N	0	3/4, 10/18, 10/20, 4/23, 11/2, 7/7, 6/24, 4/15, 4/8, 7/13, 8/26, 9/24, 3/18, 9/1, 12/30, 7/30, 8/26, 2/12, 5/12, 12/13, 4/12, 4/22, 7/9, 12/28
13328	DADE CITY	Dade City	421	176	0	597	7	123.47	65.39	N	1	1/8, 7/27, 6/3, 9/3, 5/9, 7/8, 12/6, 2/5, 4/23, 3/9, 3/24, 6/14, 8/12, 10/28, 6/5, 1/27, 6/4
13213	FAIRGROUNDS	Eastern	1,067	406	0	1,473	7	123.10	30.43	Y	4	11/2, 10/27, 10/15
13171	MADISON AV	Eastern	1,582	173	0	1,755	7	150.19	26.59	N	1	12/6
13389	KIRKLAND RD	Plant City	1,002	134	0	1,136	7	156.19	58.27	N	0	5/20, 8/23, 12/13, 8/23, 3/26, 12/2, 2/14, 6/16, 12/12, 6/24, 7/22, 10/25, 7/18, 8/9, 7/13
13059	HIMES	Western	1,152	89	0	1,241	7	89.64	54.80	N	0	7/15, 7/16, 11/18, 19/28, 6/17, 11/18, 3/29, 8/13, 12/2, 5/21, 5/27, 4/14, 11/9, 12/16, 12/16, 8/19, 7/7, 3/1, 5/28, 2/26, 11/28, 6/15, 2/18, 4/6, 9/8, 9/8, 11/24, 2/5
13104	MCFARLAND	Central	627	289	0	916	6	135.91	45.16	N	0	4/28, 3/20, 3/30, 2/19, 2/10, 3/26, 6/17, 4/11, 11/18, 10/11, 3/3, 11/15, 10/11, 9/29, 11/3, 9/29, 11/15, 10/20
13231	BRANDON	Eastern	1,201	105	0	1,306	6	125.94	98.97	N	0	10/13, 1/13, 7/16, 10/8, 4/27, 10/17
133214	FAIRGROUNDS	Eastern	547	185	0	732	6	245.17	98.46	N	0	5/14, 8/26
13693	PEARSON RD	Eastern	848	27	0	875	6	137.49	90.10	N	0	6/18, 6/14, 1/20
13885	PROVIDENCE RD	Eastern	1,143	55	0	1,198	6	259.23	71.83	N	0	11/29, 4/16
13884	CORONET	Plant City	775	127	0	902	6	224.13	107.27	N	0	5/4, 3/24, 11/11, 11/22, 1/15, 8/30, 5/31, 12/14, 4/28, 3/22, 7/30, 6/9, 10/21, 11/4, 10/6, 12/15, 2/28
CB_14578	STRIMONS	Plant City	1	16	0	17	6	122.97	74.30	N	0	9/20, 12/19
CB_14316	WOLFBRCH	South Hillsborough	665	28	0	693	6	155.30	122.05	N	0	6/22, 10/14
13140	HYDE PARK	Western	1,213	162	0	1,375	6	132.77	87.11	N	0	3/12, 4/26, 11/13, 10/8, 12/6, 6/21, 1/22, 1/29, 4/21, 1/15, 9/24, 7/8, 1/20, 4/23, 3/1
14274	SILVERDOL	Western	967	134	0	1,101	6	146.06	84.31	Y	2	4/20, 5/20, 9/10, 6/9, 7/5, 6, 12/13, 4/26, 6/11, 1/24, 11/6, 10/6, 8/16, 11/24, 11/6, 10/6, 8/16, 11/19, 6/8, 8/29, 8/28, 4/6, 3/3, 6/3, 3/28
13482	WOODLAND	Western	1,420	164	0	1,584	6	210.63	128.44	N	1	5/12, 12/8, 8/10, 11/29, 5/10, 4/16, 5/7, 9/30, 12/22, 5/3
13470	S.ELOISE	Winter Haven	2,260	196	0	2,456	6	312.24	178.56	N	0	3/1, 4/14, 1/11, 6/14, 4/15, 5/16, 7/7, 7/8, 7/10, 4/9, 6/16, 4/29

2021 Annual Reliability Performance Report

Form 103 - PART III – Adjusted

PART III ANNUAL DISTRIBUTION RELIABILITY REPORT - 2021 Utility Name: Tampa Electric

SAIDI: System Average Interruption Duration Index		
= <u>Sum of All Customer Minutes Interrupted (CMI)</u>	69,661,264	84.51
Total number of Customers Served (C)	824,322	
CAIDI: System Average Interruption Duration Index		
= <u>Sum of All Customer Minutes Interrupted (CMI)</u>	69,661,264	79.30
Total number of Customer Interruptions (CI)	878,475	
SAIFI: System Average Interruption Frequency Index		
= <u>Total number of Customer Interruptions (CI)</u>	878,475	1.07
Total number of Customers Served (C)	824,322	
MAIFle: Momentary Average Interruption Event		
= <u>Sum of All Customer Momentary Interruption Events (CME)</u>	5,359,279	6.50
Total number of Customers Served (C)	824,322	
L-Bar:		
= <u>Minutes of Interruption</u>	1,730,109	174.85
Total number of Outages	9,895	

District	C	CMI	CI	CME	CEMI-5
Central	215,086	13,724,079	173,556	1,155,714	1,523
Dade City	15,873	2,191,482	32,023	103,378	248
Eastern	131,248	8,487,743	133,067	781,978	2,546
Plant City	64,369	10,127,842	121,035	482,118	3,495
South Hillsborough	101,875	6,237,624	110,014	606,296	917
Western	214,077	16,380,379	207,914	1,618,036	597
Winter Haven	81,794	12,512,114	100,866	611,759	418
System Total:	824,322	69,661,264	878,475	5,359,279	9,744

2021 Annual Reliability Performance Report

Form 103 Part III continued Adjusted

Service Reliability Indices - Adjusted					
Utility Name: Tampa Electric			Year: 2021		
District or Service Area (a)	SAIDI (b)	CAIDI (c)	SAIFI (d)	MAIFle (e)	CEMI-5% (f)
Central	63.81	79.08	0.81	5.37	0.71%
Dade City	138.06	68.43	2.02	6.51	1.56%
Eastern	64.67	63.79	1.01	5.96	1.94%
Plant City	157.34	83.68	1.88	7.49	5.43%
South Hillsborough	61.23	56.70	1.08	5.95	0.90%
Western	76.52	78.78	0.97	7.56	0.28%
Winter Haven	152.97	124.05	1.23	7.48	0.51%
System Total:	84.51	79.30	1.07	6.50	1.18%

Form PSC/ECR 102-3, Docket No. 20011351-EI, Rule 25-6.0455(c)

Note: L-Bar and CAIDI are expressed in minutes

2021 Annual Reliability Performance Report

Actual Data: CMI, CI and Documented Exclusions

2021	CMI		CI	
	Value	% of Actual	Value	% of Actual
Reported Actual Data	86,825,173	100.00%	1,230,459	100.00%
Documented Exclusions				
Planned Service Interruptions	8,956,635	10.32%	229,697	18.67%
Named Storm	4,273,751	4.92%	22,076	1.79%
Tornadoes	0.00	0.00%	0.00	0.00%
Ice on Lines	0.00	0.00%	0.00	0.00%
Planned Load Management Events	0.00	0.00%	0.00	0.00%
Generation/Transmission Events	3,933,494	4.53%	100,196	8.14%
Extreme Weather (EOC Activation/Fire)	0.00	0.00%	0.00	0.00%
Reported Adjusted Data	69,661,293	80.23%	878,490	71.40%

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Service-Crew	PLANNED OUTAGE	2021-01-01 08:22:17.000	199.72	1
UG Other	PLANNED OUTAGE	2021-01-02 16:05:11.000	76.82	1
Circuit Out	PLANNED OUTAGE	2021-01-03 10:47:30.000	9,555.42	1,615
OH Other	PLANNED OUTAGE	2021-01-03 14:00:21.000	207.30	2
Circuit Out	PLANNED OUTAGE	2021-01-03 22:20:29.000	25,773.67	835
OH Other	PLANNED OUTAGE	2021-01-04 07:39:23.000	76.62	1
Connections	PLANNED OUTAGE	2021-01-04 08:06:48.000	96.20	1
Service-Crew	PLANNED OUTAGE	2021-01-04 08:13:28.000	277.53	1
OH Other	PLANNED OUTAGE	2021-01-04 08:45:35.000	1,178.27	4
URD Outage	PLANNED OUTAGE	2021-01-04 08:52:59.000	290.30	6
OH Other	PLANNED OUTAGE	2021-01-04 10:15:25.000	1,210.92	5
OH Other	PLANNED OUTAGE	2021-01-04 10:39:39.000	1,441.47	8
URD Outage	PLANNED OUTAGE	2021-01-04 11:01:12.000	1,116.97	7
URD Outage	PLANNED OUTAGE	2021-01-04 16:28:45.000	500.90	6
OH Other	PLANNED OUTAGE	2021-01-04 18:36:31.000	1.48	1
OH Other	PLANNED OUTAGE	2021-01-05 08:36:50.000	128.17	1
OH Other	PLANNED OUTAGE	2021-01-05 08:41:57.000	1,696.67	4
OH Other	PLANNED OUTAGE	2021-01-05 09:14:08.000	2,661.47	8
URD Outage	PLANNED OUTAGE	2021-01-05 09:36:03.000	695.80	6
OH Other	PLANNED OUTAGE	2021-01-05 10:24:16.000	386.27	8
OH Other	PLANNED OUTAGE	2021-01-05 10:27:13.000	638.47	2
URD Outage	PLANNED OUTAGE	2021-01-05 15:56:58.000	627.30	9
OH Other	PLANNED OUTAGE	2021-01-05 20:12:47.000	425.37	1
OH Other	PLANNED OUTAGE	2021-01-06 07:51:16.000	862.50	3
OH Other	PLANNED OUTAGE	2021-01-06 07:58:21.000	852.43	2
OH Other	PLANNED OUTAGE	2021-01-06 08:30:51.000	89.15	1
OH Other	PLANNED OUTAGE	2021-01-06 08:34:10.000	34.83	1
OH Other	PLANNED OUTAGE	2021-01-06 09:22:43.000	570.90	6
OH Other	PLANNED OUTAGE	2021-01-06 09:24:31.000	1,523.47	8
OH Other	PLANNED OUTAGE	2021-01-06 09:25:26.000	1,050.93	8
OH Other	PLANNED OUTAGE	2021-01-06 09:33:10.000	726.27	4
URD Outage	PLANNED OUTAGE	2021-01-06 09:48:02.000	458.27	8
URD Outage	PLANNED OUTAGE	2021-01-06 10:57:09.000	1,020.58	5
URD Outage	PLANNED OUTAGE	2021-01-06 11:20:46.000	301.75	5
URD Outage	PLANNED OUTAGE	2021-01-06 13:40:13.000	292.40	6
OH Other	PLANNED OUTAGE	2021-01-06 16:45:06.000	419.90	3
OH Other	PLANNED OUTAGE	2021-01-07 08:28:37.000	1,080.85	3
URD Outage	PLANNED OUTAGE	2021-01-07 08:31:08.000	1,280.58	5
OH Other	PLANNED OUTAGE	2021-01-07 09:09:07.000	1,434.53	8
URD Outage	PLANNED OUTAGE	2021-01-07 10:23:05.000	448.23	7
URD Outage	PLANNED OUTAGE	2021-01-07 10:38:56.000	378.70	7
URD Outage	PLANNED OUTAGE	2021-01-07 10:56:49.000	259.07	8
URD Outage	PLANNED OUTAGE	2021-01-07 12:59:09.000	217.17	5
OH Other	PLANNED OUTAGE	2021-01-07 13:06:57.000	1,093.08	13
OH Other	PLANNED OUTAGE	2021-01-07 13:24:25.000	857.80	3
URD Outage	PLANNED OUTAGE	2021-01-07 13:46:43.000	4,517.20	24
URD Outage	PLANNED OUTAGE	2021-01-07 15:47:50.000	603.90	9
URD Outage	PLANNED OUTAGE	2021-01-07 22:34:59.000	319.92	1
Circuit Out	PLANNED OUTAGE	2021-01-08 03:11:41.000	4,722.83	1,318
URD Outage	PLANNED OUTAGE	2021-01-08 09:48:23.000	442.87	1
OH Other	PLANNED OUTAGE	2021-01-08 09:52:31.000	439.00	1
URD Outage	PLANNED OUTAGE	2021-01-08 17:01:30.000	5,780.93	16
URD Outage	PLANNED OUTAGE	2021-01-09 07:50:49.000	1,431.85	3
URD Outage	PLANNED OUTAGE	2021-01-09 09:02:22.000	381.42	1
URD Outage	PLANNED OUTAGE	2021-01-11 08:51:35.000	56.42	1
OH Other	PLANNED OUTAGE	2021-01-11 10:20:15.000	2,024.40	8

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
URD Outage	PLANNED OUTAGE	2021-01-11 10:54:28.000	2,629.80	30
URD Outage	PLANNED OUTAGE	2021-01-11 12:08:15.000	732.78	7
Circuit Out	PLANNED OUTAGE	2021-01-11 18:08:39.000	9,023.30	1,893
OH Other	PLANNED OUTAGE	2021-01-11 23:24:26.000	1,149.35	3
OH Other	PLANNED OUTAGE	2021-01-12 06:37:24.000	161.60	1
OH Other	PLANNED OUTAGE	2021-01-12 08:10:29.000	2,256.57	14
OH Other	PLANNED OUTAGE	2021-01-12 08:14:55.000	8,220.27	16
OH Other	PLANNED OUTAGE	2021-01-12 08:34:34.000	2,289.23	7
OH Other	PLANNED OUTAGE	2021-01-12 09:12:50.000	1,509.67	7
OH Other	PLANNED OUTAGE	2021-01-12 11:21:11.000	138.82	1
URD Outage	PLANNED OUTAGE	2021-01-12 11:38:40.000	1,487.73	14
URD Outage	PLANNED OUTAGE	2021-01-12 12:38:53.000	713.90	6
OH Other	PLANNED OUTAGE	2021-01-12 15:23:51.000	3,391.30	33
OH Other	PLANNED OUTAGE	2021-01-12 17:01:04.000	1,574.93	16
URD Outage	PLANNED OUTAGE	2021-01-13 06:52:46.000	196.43	2
OH Other	PLANNED OUTAGE	2021-01-13 08:34:32.000	654.60	2
OH Other	PLANNED OUTAGE	2021-01-13 09:19:03.000	592.50	3
URD Outage	PLANNED OUTAGE	2021-01-13 09:44:38.000	1,347.03	14
URD Outage	PLANNED OUTAGE	2021-01-13 10:59:48.000	658.33	10
URD Outage	PLANNED OUTAGE	2021-01-13 12:32:28.000	335.08	5
URD Outage	PLANNED OUTAGE	2021-01-13 14:07:40.000	306.40	2
URD Outage	PLANNED OUTAGE	2021-01-14 07:34:17.000	2,184.80	6
OH Other	PLANNED OUTAGE	2021-01-14 07:45:41.000	462.87	2
OH Other	PLANNED OUTAGE	2021-01-14 08:23:16.000	3,273.20	14
OH Other	PLANNED OUTAGE	2021-01-14 08:27:47.000	257.93	2
OH Other	PLANNED OUTAGE	2021-01-14 08:55:10.000	1,415.33	5
URD Outage	PLANNED OUTAGE	2021-01-14 09:35:14.000	332.80	13
OH Other	PLANNED OUTAGE	2021-01-14 09:39:25.000	148.58	1
URD Outage	PLANNED OUTAGE	2021-01-14 17:03:01.000	253.00	5
URD Outage	PLANNED OUTAGE	2021-01-14 21:36:59.000	1,446.30	3
OH Other	PLANNED OUTAGE	2021-01-15 08:13:28.000	57.53	1
OH Other	PLANNED OUTAGE	2021-01-15 08:33:32.000	643.83	5
URD Outage	PLANNED OUTAGE	2021-01-15 08:56:18.000	259.30	6
URD Outage	PLANNED OUTAGE	2021-01-15 09:18:00.000	556.37	2
OH Other	PLANNED OUTAGE	2021-01-15 09:22:31.000	1,520.70	6
URD Outage	PLANNED OUTAGE	2021-01-15 09:42:53.000	341.40	6
URD Outage	PLANNED OUTAGE	2021-01-15 11:03:01.000	193.02	1
OH Other	PLANNED OUTAGE	2021-01-15 11:46:35.000	2,145.65	13
OCR, Sec	PLANNED OUTAGE	2021-01-15 19:29:56.000	2,045.33	118
OH Other	PLANNED OUTAGE	2021-01-15 19:44:52.000	15,419.20	736
Step Restoration	PLANNED OUTAGE	2021-01-16 07:28:57.000	13,846.80	66
URD Outage	PLANNED OUTAGE	2021-01-16 09:04:37.000	421.17	1
Circuit Out	PLANNED OUTAGE	2021-01-16 14:23:33.000	81,015.90	2,422
Circuit Out	PLANNED OUTAGE	2021-01-16 14:23:43.000	36,440.53	1,076
Circuit Out	PLANNED OUTAGE	2021-01-16 14:42:44.000	4,032.00	896
Circuit Out	PLANNED OUTAGE	2021-01-17 04:28:36.000	1,387.75	793
OH Other	PLANNED OUTAGE	2021-01-18 09:23:00.000	2,796.13	8
OH Other	PLANNED OUTAGE	2021-01-18 09:27:32.000	197.47	1
OH Other	PLANNED OUTAGE	2021-01-18 10:35:38.000	552.70	2
Circuit Out	PLANNED OUTAGE	2021-01-19 01:16:44.000	13,987.00	1,970
OH Other	PLANNED OUTAGE	2021-01-19 07:51:55.000	84.08	1
OH Other	PLANNED OUTAGE	2021-01-19 08:37:01.000	131.57	2
URD Outage	PLANNED OUTAGE	2021-01-19 08:45:07.000	131.20	1
URD Outage	PLANNED OUTAGE	2021-01-19 08:56:28.000	187.53	1
OH Other	PLANNED OUTAGE	2021-01-19 09:19:54.000	974.73	4
URD Outage	PLANNED OUTAGE	2021-01-19 09:20:49.000	133.38	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-01-19 09:21:53.000	1,183.13	4
OH Other	PLANNED OUTAGE	2021-01-19 09:33:00.000	1,005.57	2
OH Other	PLANNED OUTAGE	2021-01-19 09:38:05.000	872.65	3
URD Outage	PLANNED OUTAGE	2021-01-19 10:02:57.000	217.33	1
OH Other	PLANNED OUTAGE	2021-01-19 11:34:09.000	501.67	7
OH Other	PLANNED OUTAGE	2021-01-19 11:34:10.000	38.83	1
OH Other	PLANNED OUTAGE	2021-01-19 11:43:22.000	1,098.00	9
URD Outage	PLANNED OUTAGE	2021-01-19 11:58:45.000	661.83	11
URD Outage	PLANNED OUTAGE	2021-01-19 13:13:46.000	343.80	6
OH Other	PLANNED OUTAGE	2021-01-19 13:44:32.000	374.15	7
URD Outage	PLANNED OUTAGE	2021-01-19 14:38:31.000	213.67	5
OH Other	PLANNED OUTAGE	2021-01-19 14:48:46.000	1,311.68	7
URD Outage	PLANNED OUTAGE	2021-01-20 08:08:30.000	60.87	2
URD Outage	PLANNED OUTAGE	2021-01-20 08:41:40.000	649.47	8
URD Outage	PLANNED OUTAGE	2021-01-20 09:13:15.000	1,079.33	4
OH Other	PLANNED OUTAGE	2021-01-20 09:59:54.000	422.40	1
OH Other	PLANNED OUTAGE	2021-01-20 10:04:33.000	13,045.52	41
OH Other	PLANNED OUTAGE	2021-01-20 11:15:56.000	260.25	5
URD Outage	PLANNED OUTAGE	2021-01-20 11:22:06.000	8,513.33	25
Circuit Out	PLANNED OUTAGE	2021-01-20 11:26:44.000	4,582.80	1,608
URD Outage	PLANNED OUTAGE	2021-01-20 11:57:22.000	1,271.60	12
OH Other	PLANNED OUTAGE	2021-01-20 12:16:19.000	461.30	6
URD Outage	PLANNED OUTAGE	2021-01-20 14:11:01.000	765.73	8
OH Other	PLANNED OUTAGE	2021-01-20 16:27:23.000	48.62	1
URD Outage	PLANNED OUTAGE	2021-01-20 16:59:43.000	252.00	4
OH Other	PLANNED OUTAGE	2021-01-20 19:13:16.000	478.40	6
URD Outage	PLANNED OUTAGE	2021-01-21 09:02:57.000	7,366.17	52
URD Outage	PLANNED OUTAGE	2021-01-21 09:28:25.000	5,175.60	12
OH Other	PLANNED OUTAGE	2021-01-21 09:38:57.000	292.03	1
OH Other	PLANNED OUTAGE	2021-01-21 11:01:24.000	55.90	6
URD Outage	PLANNED OUTAGE	2021-01-21 11:47:15.000	2,355.15	21
OH Other	PLANNED OUTAGE	2021-01-21 12:18:46.000	681.92	7
OH Other	PLANNED OUTAGE	2021-01-21 13:07:42.000	1,005.27	4
URD Outage	PLANNED OUTAGE	2021-01-21 13:09:48.000	238.30	6
URD Outage	PLANNED OUTAGE	2021-01-21 14:06:19.000	408.60	6
URD Outage	PLANNED OUTAGE	2021-01-21 16:18:35.000	408.48	1
UG Other	PLANNED OUTAGE	2021-01-22 08:49:31.000	542.43	1
OH Other	PLANNED OUTAGE	2021-01-22 09:14:26.000	577.20	4
OH Other	PLANNED OUTAGE	2021-01-22 10:24:58.000	358.33	2
Service-Crew	PLANNED OUTAGE	2021-01-22 12:07:31.000	76.48	1
UG Other	PLANNED OUTAGE	2021-01-22 12:38:28.000	2,103.75	75
OH Other	PLANNED OUTAGE	2021-01-23 09:36:05.000	49.92	1
Circuit Out	PLANNED OUTAGE	2021-01-23 10:15:04.000	2,468.10	866
PLF	PLANNED OUTAGE	2021-01-24 08:42:10.000	453.83	2
PLF	PLANNED OUTAGE	2021-01-24 10:50:20.000	1,660.00	25
OH Other	PLANNED OUTAGE	2021-01-25 08:22:54.000	71.78	1
OH Other	PLANNED OUTAGE	2021-01-25 09:15:05.000	273.40	12
UG Other	PLANNED OUTAGE	2021-01-25 09:37:57.000	15,659.15	102
PLF	PLANNED OUTAGE	2021-01-25 10:04:33.000	60.25	3
TX Repaired (OH)	PLANNED OUTAGE	2021-01-25 10:26:28.000	432.87	2
PLF	PLANNED OUTAGE	2021-01-25 12:15:25.000	18.68	1
OH Other	PLANNED OUTAGE	2021-01-25 13:08:44.000	532.27	4
PLF	PLANNED OUTAGE	2021-01-25 13:13:38.000	14.67	1
UG Other	PLANNED OUTAGE	2021-01-25 13:22:57.000	1,167.75	27
PLF	PLANNED OUTAGE	2021-01-25 15:31:40.000	1,166.67	20
OH Other	PLANNED OUTAGE	2021-01-25 19:14:57.000	819.12	7

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-01-25 21:03:47.000	110.82	1
PLF	PLANNED OUTAGE	2021-01-26 07:38:32.000	34.95	3
OH Other	PLANNED OUTAGE	2021-01-26 08:21:09.000	211.58	5
PLF	PLANNED OUTAGE	2021-01-26 08:23:18.000	900.63	2
PLF	PLANNED OUTAGE	2021-01-26 08:28:47.000	5,102.10	18
UG Other	PLANNED OUTAGE	2021-01-26 09:42:29.000	3,079.80	36
PLF	PLANNED OUTAGE	2021-01-26 09:59:12.000	1,889.17	25
UG Other	PLANNED OUTAGE	2021-01-26 10:04:41.000	1,763.10	18
PLF	PLANNED OUTAGE	2021-01-26 10:07:20.000	67.47	1
OH Other	PLANNED OUTAGE	2021-01-26 11:03:26.000	65.57	1
OH Other	PLANNED OUTAGE	2021-01-26 11:28:47.000	1,053.33	4
PLF	PLANNED OUTAGE	2021-01-26 11:46:24.000	246.60	1
PLF	PLANNED OUTAGE	2021-01-26 12:17:49.000	58.42	1
PLF	PLANNED OUTAGE	2021-01-26 12:24:57.000	821.67	20
PLF	PLANNED OUTAGE	2021-01-26 12:30:31.000	1,818.15	9
PLF	PLANNED OUTAGE	2021-01-26 13:19:27.000	153.73	1
PLF	PLANNED OUTAGE	2021-01-26 14:29:08.000	245.13	4
PLF	PLANNED OUTAGE	2021-01-26 15:05:04.000	92.10	2
TX Repaired (OH)	PLANNED OUTAGE	2021-01-27 08:50:52.000	734.53	2
TX Repaired (OH)	PLANNED OUTAGE	2021-01-27 09:17:31.000	1,636.20	3
UG Other	PLANNED OUTAGE	2021-01-27 09:57:01.000	177.25	5
TX Repaired (OH)	PLANNED OUTAGE	2021-01-27 11:28:06.000	3,728.55	9
OH Other	PLANNED OUTAGE	2021-01-27 11:33:40.000	53.33	1
OH Other	PLANNED OUTAGE	2021-01-27 13:36:31.000	1,144.40	4
Circuit Out	PLANNED OUTAGE	2021-01-27 13:52:33.000	841.80	244
PLF	PLANNED OUTAGE	2021-01-27 16:02:46.000	251.73	2
UG Other	PLANNED OUTAGE	2021-01-27 16:02:46.000	10,446.93	83
OH Other	PLANNED OUTAGE	2021-01-27 18:42:59.000	31.02	1
Circuit Out	PLANNED OUTAGE	2021-01-27 20:11:33.000	60,743.10	1,398
PLF	PLANNED OUTAGE	2021-01-28 05:56:32.000	252.33	2
PLF	PLANNED OUTAGE	2021-01-28 09:45:18.000	55.95	1
UG Other	PLANNED OUTAGE	2021-01-28 09:59:46.000	241.37	2
UG Other	PLANNED OUTAGE	2021-01-28 10:19:01.000	95.17	5
Circuit Out	PLANNED OUTAGE	2021-01-28 16:36:18.000	1,885.00	975
UG Other	PLANNED OUTAGE	2021-01-29 08:58:29.000	102.77	1
OH Other	PLANNED OUTAGE	2021-01-29 10:53:49.000	2,377.50	10
UG Other	PLANNED OUTAGE	2021-01-29 23:00:55.000	134.40	1
OH Other	PLANNED OUTAGE	2021-01-30 09:32:04.000	48,022.80	168
PLF	PLANNED OUTAGE	2021-01-31 12:18:00.000	55.10	2
UG Other	PLANNED OUTAGE	2021-01-31 14:39:04.000	92.93	1
Circuit Out	PLANNED OUTAGE	2021-01-31 17:11:50.000	98.75	79
PLF	PLANNED OUTAGE	2021-01-31 23:45:00.000	32,904.00	120
UG Other	PLANNED OUTAGE	2021-02-01 02:55:53.000	10,097.45	121
TX Repaired (OH)	PLANNED OUTAGE	2021-02-01 08:06:16.000	1,377.80	4
PLF	PLANNED OUTAGE	2021-02-01 08:25:43.000	12.42	1
TX Replaced (OH)	PLANNED OUTAGE	2021-02-01 08:40:34.000	962.65	3
OH Other	PLANNED OUTAGE	2021-02-01 09:03:41.000	179.32	1
UG Other	PLANNED OUTAGE	2021-02-01 09:39:21.000	163.87	4
UG Other	PLANNED OUTAGE	2021-02-01 09:47:30.000	553.85	11
PLF	PLANNED OUTAGE	2021-02-01 10:02:01.000	447.33	4
TX Repaired (OH)	PLANNED OUTAGE	2021-02-01 12:00:46.000	429.73	4
UG Other	PLANNED OUTAGE	2021-02-01 12:28:50.000	1,805.53	14
UG Other	PLANNED OUTAGE	2021-02-01 13:35:21.000	215.75	3
Circuit Out	PLANNED OUTAGE	2021-02-01 15:20:52.000	1,953.00	1,674
URD Outage	PLANNED OUTAGE	2021-02-01 22:53:33.000	261.73	2
OH Other	PLANNED OUTAGE	2021-02-02 07:40:34.000	1,835.80	4

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-02-02 08:39:12.000	2,930.85	9
UG Other	PLANNED OUTAGE	2021-02-02 08:41:54.000	350.07	4
OH Other	PLANNED OUTAGE	2021-02-02 09:01:12.000	605.27	2
UG Other	PLANNED OUTAGE	2021-02-02 09:09:17.000	336.27	8
OH Other	PLANNED OUTAGE	2021-02-02 09:42:32.000	2,100.13	8
TX Repaired (PM)	PLANNED OUTAGE	2021-02-02 09:48:58.000	127.50	5
UG Other	PLANNED OUTAGE	2021-02-02 10:25:50.000	2,599.95	13
TX Repaired (OH)	PLANNED OUTAGE	2021-02-02 10:47:17.000	2,012.67	8
UG Other	PLANNED OUTAGE	2021-02-02 10:56:01.000	216.65	3
OH Other	PLANNED OUTAGE	2021-02-02 11:58:11.000	252.67	2
PLF	PLANNED OUTAGE	2021-02-02 12:54:05.000	537.10	6
TX Repaired (PM)	PLANNED OUTAGE	2021-02-02 12:54:05.000	537.10	6
OH Other	PLANNED OUTAGE	2021-02-02 16:27:49.000	221.58	1
Circuit Out	PLANNED OUTAGE	2021-02-02 18:24:48.000	4,032.00	960
OH Other	PLANNED OUTAGE	2021-02-02 20:38:24.000	2,627.00	15
PLF	PLANNED OUTAGE	2021-02-03 07:37:40.000	18.50	1
OH Other	PLANNED OUTAGE	2021-02-03 08:21:27.000	1,183.70	3
UG Other	PLANNED OUTAGE	2021-02-03 09:22:25.000	568.65	9
PLF	PLANNED OUTAGE	2021-02-03 09:37:28.000	1,085.00	14
UG Other	PLANNED OUTAGE	2021-02-03 10:33:21.000	2,829.45	25
PLF	PLANNED OUTAGE	2021-02-03 10:37:19.000	4,762.80	42
OH Other	PLANNED OUTAGE	2021-02-03 10:57:34.000	1,640.93	8
UG Other	PLANNED OUTAGE	2021-02-03 11:11:17.000	678.93	8
UG Other	PLANNED OUTAGE	2021-02-03 11:24:25.000	336.93	1
UG Other	PLANNED OUTAGE	2021-02-03 11:38:11.000	5,913.83	74
OH Other	PLANNED OUTAGE	2021-02-03 11:40:44.000	1,190.00	4
TX Repaired (OH)	PLANNED OUTAGE	2021-02-03 12:29:23.000	2,060.93	13
UG Other	PLANNED OUTAGE	2021-02-03 13:25:35.000	512.13	8
OH Other	PLANNED OUTAGE	2021-02-03 23:51:17.000	214.17	10
OH Other	PLANNED OUTAGE	2021-02-03 23:55:04.000	230.10	13
OH Other	PLANNED OUTAGE	2021-02-04 09:00:29.000	442.45	1
OH Other	PLANNED OUTAGE	2021-02-04 09:01:59.000	441.13	1
OH Other	PLANNED OUTAGE	2021-02-04 09:41:27.000	649.77	2
UG Other	PLANNED OUTAGE	2021-02-04 11:21:34.000	344.92	5
PLF	PLANNED OUTAGE	2021-02-04 11:27:43.000	256.13	4
UG Other	PLANNED OUTAGE	2021-02-04 13:11:17.000	284.50	6
UG Other	PLANNED OUTAGE	2021-02-04 14:20:53.000	118.97	2
PLF	PLANNED OUTAGE	2021-02-05 08:46:19.000	429.97	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-05 10:59:34.000	1,578.67	8
TX Repaired (OH)	PLANNED OUTAGE	2021-02-05 13:18:33.000	97.40	2
PLF	PLANNED OUTAGE	2021-02-05 13:25:33.000	179.80	2
PLF	PLANNED OUTAGE	2021-02-05 13:33:18.000	34.32	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-05 15:43:06.000	1,598.50	6
Circuit Out	PLANNED OUTAGE	2021-02-05 16:45:48.000	10,332.00	1,435
TX Repaired (OH)	PLANNED OUTAGE	2021-02-05 21:53:39.000	1,020.40	6
TX Repaired (OH)	PLANNED OUTAGE	2021-02-06 04:35:26.000	291.33	8
TX Repaired (OH)	PLANNED OUTAGE	2021-02-06 09:28:09.000	4,685.57	14
TX Repaired (OH)	PLANNED OUTAGE	2021-02-07 00:54:18.000	4,196.40	13
TX Repaired (OH)	PLANNED OUTAGE	2021-02-07 07:59:40.000	999.47	8
OCR, Sec	PLANNED OUTAGE	2021-02-07 08:39:55.000	4,605.65	7
Circuit Out	PLANNED OUTAGE	2021-02-07 12:30:04.000	18,471.33	1,030
Circuit Out	PLANNED OUTAGE	2021-02-07 15:38:48.000	2,232.00	360
OCR, Sec	PLANNED OUTAGE	2021-02-08 08:20:39.000	15,302.57	41
OH Other	PLANNED OUTAGE	2021-02-08 09:04:13.000	3,205.03	11
TX Repaired (OH)	PLANNED OUTAGE	2021-02-08 10:05:46.000	423.50	6
UG Other	PLANNED OUTAGE	2021-02-08 10:35:11.000	1,081.13	4

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (OH)	PLANNED OUTAGE	2021-02-08 13:01:20.000	378.33	4
TX Repaired (OH)	PLANNED OUTAGE	2021-02-08 16:06:22.000	275.47	4
Circuit Out	PLANNED OUTAGE	2021-02-08 17:16:20.000	1,255.73	1,108
Primary Wire	PLANNED OUTAGE	2021-02-09 08:08:54.000	27,846.00	63
PLF	PLANNED OUTAGE	2021-02-09 08:32:31.000	37.48	1
UG Other	PLANNED OUTAGE	2021-02-09 08:39:38.000	65.37	1
PLF	PLANNED OUTAGE	2021-02-09 08:41:34.000	373.72	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-09 08:41:34.000	6,353.18	17
TX Repaired (OH)	PLANNED OUTAGE	2021-02-09 09:12:57.000	2,843.87	8
OH Other	PLANNED OUTAGE	2021-02-09 09:17:47.000	532.40	3
PLF	PLANNED OUTAGE	2021-02-09 11:43:00.000	559.08	5
TX Repaired (OH)	PLANNED OUTAGE	2021-02-09 12:03:23.000	532.67	4
OH Other	PLANNED OUTAGE	2021-02-09 14:23:07.000	140.33	2
Circuit Out	PLANNED OUTAGE	2021-02-09 15:49:29.000	18,722.58	1,129
TX Repaired (PM)	PLANNED OUTAGE	2021-02-10 01:48:16.000	559.72	11
TX Repaired (OH)	PLANNED OUTAGE	2021-02-10 07:49:17.000	2,082.87	4
TX Repaired (OH)	PLANNED OUTAGE	2021-02-10 07:49:26.000	524.53	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-10 07:49:32.000	461.18	1
PLF	PLANNED OUTAGE	2021-02-10 08:03:42.000	379.00	1
OH Other	PLANNED OUTAGE	2021-02-10 08:35:20.000	3,459.17	10
OH Other	PLANNED OUTAGE	2021-02-10 08:54:26.000	2,643.87	8
TX Repaired (OH)	PLANNED OUTAGE	2021-02-10 09:02:51.000	1,167.83	7
PLF	PLANNED OUTAGE	2021-02-10 09:04:01.000	2,651.68	8
TX Repaired (OH)	PLANNED OUTAGE	2021-02-10 09:04:01.000	662.23	2
PLF	PLANNED OUTAGE	2021-02-10 09:45:11.000	800.33	20
UG Other	PLANNED OUTAGE	2021-02-10 09:45:11.000	117.60	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-10 10:08:22.000	254.55	1
UG Other	PLANNED OUTAGE	2021-02-10 10:08:43.000	468.80	16
TX Repaired (OH)	PLANNED OUTAGE	2021-02-10 10:13:31.000	195.07	4
TX Repaired (OH)	PLANNED OUTAGE	2021-02-10 10:20:25.000	1,236.33	5
PLF	PLANNED OUTAGE	2021-02-10 10:28:40.000	717.55	3
TX Repaired (PM)	PLANNED OUTAGE	2021-02-10 10:30:05.000	72.78	1
PLF	PLANNED OUTAGE	2021-02-10 11:18:18.000	1,913.82	13
UG Other	PLANNED OUTAGE	2021-02-10 11:18:18.000	15,348.80	63
PLF	PLANNED OUTAGE	2021-02-10 12:39:44.000	1,285.27	13
UG Other	PLANNED OUTAGE	2021-02-11 08:39:51.000	2,388.92	13
Switchgear	PLANNED OUTAGE	2021-02-11 09:09:24.000	20,377.80	108
TX Repaired (OH)	PLANNED OUTAGE	2021-02-11 09:30:27.000	993.20	6
TX Replaced (OH)	PLANNED OUTAGE	2021-02-11 09:54:59.000	858.50	3
TX Replaced (PM)	PLANNED OUTAGE	2021-02-11 10:03:31.000	10,234.98	34
UG Other	PLANNED OUTAGE	2021-02-11 10:03:31.000	4,353.65	21
Switch 600 amp	PLANNED OUTAGE	2021-02-11 10:51:21.000	1,543.00	4
TX Repaired (OH)	PLANNED OUTAGE	2021-02-11 11:26:35.000	245.25	5
#REF!	PLANNED OUTAGE	2021-02-11 12:25:38.000	2,048.57	74
TX Repaired (PM)	PLANNED OUTAGE	2021-02-11 14:13:44.000	694.00	8
OH Other	PLANNED OUTAGE	2021-02-12 06:57:19.000	32.43	1
PLF	PLANNED OUTAGE	2021-02-12 08:35:22.000	283.62	1
TX Repaired (PM)	PLANNED OUTAGE	2021-02-12 09:25:26.000	1,672.67	26
URD Outage	PLANNED OUTAGE	2021-02-12 10:03:29.000	120.80	2
Switch 600 amp	PLANNED OUTAGE	2021-02-12 10:05:58.000	360.00	1
OH Other	PLANNED OUTAGE	2021-02-12 10:48:45.000	1,689.17	10
URD Outage	PLANNED OUTAGE	2021-02-12 12:14:29.000	329.67	5
PLF	PLANNED OUTAGE	2021-02-12 12:17:38.000	1,114.60	6
Connections	PLANNED OUTAGE	2021-02-12 12:46:27.000	61.55	1
UG Other	PLANNED OUTAGE	2021-02-12 14:19:48.000	612.75	15
Circuit Out	PLANNED OUTAGE	2021-02-13 13:10:32.000	9,287.87	1,699

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Circuit Out	PLANNED OUTAGE	2021-02-13 22:18:08.000	3,201.92	499
TX Repaired (OH)	PLANNED OUTAGE	2021-02-14 21:58:17.000	1,649.40	12
URD Outage	PLANNED OUTAGE	2021-02-14 22:30:43.000	757.60	3
Circuit Out	PLANNED OUTAGE	2021-02-15 00:50:11.000	926.75	337
TX Replaced (PM)	PLANNED OUTAGE	2021-02-15 07:49:32.000	4,530.00	8
TX Repaired (OH)	PLANNED OUTAGE	2021-02-15 08:18:02.000	1,061.67	7
PLF	PLANNED OUTAGE	2021-02-15 08:20:04.000	297.30	1
TX Repaired (PM)	PLANNED OUTAGE	2021-02-15 08:54:15.000	642.58	11
URD Outage	PLANNED OUTAGE	2021-02-15 09:07:46.000	360.80	6
URD Outage	PLANNED OUTAGE	2021-02-15 11:13:53.000	456.80	8
URD Outage	PLANNED OUTAGE	2021-02-15 12:11:40.000	671.60	8
Primary Wire	PLANNED OUTAGE	2021-02-15 12:50:31.000	267.48	1
URD Outage	PLANNED OUTAGE	2021-02-15 15:29:24.000	338.00	6
PLF	PLANNED OUTAGE	2021-02-15 16:20:47.000	1,538.90	6
OCR, Sec	PLANNED OUTAGE	2021-02-15 16:32:03.000	25,308.80	704
URD Outage	PLANNED OUTAGE	2021-02-16 07:54:16.000	26,087.50	125
OH Other	PLANNED OUTAGE	2021-02-16 08:01:33.000	255.45	1
URD Outage	PLANNED OUTAGE	2021-02-16 08:23:18.000	195.08	5
OH Other	PLANNED OUTAGE	2021-02-16 08:25:56.000	1,377.73	4
PLF	PLANNED OUTAGE	2021-02-16 08:28:00.000	42.12	1
PLF	PLANNED OUTAGE	2021-02-16 09:07:05.000	108.00	1
URD Outage	PLANNED OUTAGE	2021-02-16 09:08:08.000	932.60	12
URD Outage	PLANNED OUTAGE	2021-02-16 09:15:01.000	391.40	6
URD Outage	PLANNED OUTAGE	2021-02-16 10:14:01.000	2,065.93	19
URD Outage	PLANNED OUTAGE	2021-02-16 11:05:39.000	661.83	11
URD Outage	PLANNED OUTAGE	2021-02-16 11:19:17.000	68.72	1
URD Outage	PLANNED OUTAGE	2021-02-16 12:03:48.000	4,979.72	31
OH Other	PLANNED OUTAGE	2021-02-16 12:28:46.000	1,309.18	11
URD Outage	PLANNED OUTAGE	2021-02-16 13:57:06.000	533.50	10
URD Outage	PLANNED OUTAGE	2021-02-17 08:02:30.000	552.07	1
URD Outage	PLANNED OUTAGE	2021-02-17 09:27:40.000	766.97	7
UG Other	PLANNED OUTAGE	2021-02-17 09:34:43.000	14,276.30	42
UG Other	PLANNED OUTAGE	2021-02-17 09:39:47.000	507.73	8
PLF	PLANNED OUTAGE	2021-02-17 09:47:14.000	482.83	10
UG Other	PLANNED OUTAGE	2021-02-17 10:10:28.000	3,397.33	8
TX Repaired (OH)	PLANNED OUTAGE	2021-02-17 10:18:42.000	271.60	3
UG Other	PLANNED OUTAGE	2021-02-17 10:27:06.000	23,995.10	78
PLF	PLANNED OUTAGE	2021-02-17 10:36:39.000	369.13	2
TX Repaired (OH)	PLANNED OUTAGE	2021-02-17 10:36:54.000	109.10	1
URD Outage	PLANNED OUTAGE	2021-02-17 10:53:14.000	423.20	8
UG Other	PLANNED OUTAGE	2021-02-17 12:07:19.000	88.68	1
URD Outage	PLANNED OUTAGE	2021-02-17 13:43:51.000	340.60	6
TX Repaired (PM)	PLANNED OUTAGE	2021-02-17 13:47:09.000	288.10	6
UG Other	PLANNED OUTAGE	2021-02-17 14:27:36.000	2,160.10	62
Circuit Out	PLANNED OUTAGE	2021-02-17 15:08:24.000	16,995.33	1,924
PLF	PLANNED OUTAGE	2021-02-17 22:08:14.000	1,612.40	8
URD Outage	PLANNED OUTAGE	2021-02-18 08:37:17.000	173.75	5
UG Other	PLANNED OUTAGE	2021-02-18 08:46:43.000	203.60	3
UG Other	PLANNED OUTAGE	2021-02-18 09:00:36.000	668.53	8
URD Outage	PLANNED OUTAGE	2021-02-18 09:02:29.000	140.33	5
UG Other	PLANNED OUTAGE	2021-02-18 09:13:43.000	374.00	6
TX Replaced (OH)	PLANNED OUTAGE	2021-02-18 09:14:07.000	2,140.50	10
UG Other	PLANNED OUTAGE	2021-02-18 09:20:01.000	307.20	6
UG Other	PLANNED OUTAGE	2021-02-18 09:57:28.000	256.67	5
UG Other	PLANNED OUTAGE	2021-02-18 10:12:10.000	408.33	5
UG Other	PLANNED OUTAGE	2021-02-18 10:27:44.000	555.87	8

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (OH)	PLANNED OUTAGE	2021-02-18 10:38:53.000	41.12	1
UG Other	PLANNED OUTAGE	2021-02-18 10:47:52.000	3,701.13	11
UG Other	PLANNED OUTAGE	2021-02-18 11:09:33.000	476.93	7
OH Other	PLANNED OUTAGE	2021-02-18 13:05:52.000	3,156.00	20
UG Other	PLANNED OUTAGE	2021-02-18 13:19:26.000	316.50	6
TX Repaired (OH)	PLANNED OUTAGE	2021-02-19 00:15:22.000	1,943.80	8
TX Replaced (OH)	PLANNED OUTAGE	2021-02-19 08:34:44.000	1,312.92	5
PLF	PLANNED OUTAGE	2021-02-19 08:47:04.000	194.17	2
URD Outage	PLANNED OUTAGE	2021-02-19 09:13:19.000	400.05	7
TX Repaired (OH)	PLANNED OUTAGE	2021-02-19 11:39:28.000	1,967.47	14
Circuit Out	PLANNED OUTAGE	2021-02-19 18:09:52.000	2,517.50	1,007
Circuit Out	PLANNED OUTAGE	2021-02-20 06:53:15.000	4,472.25	603
UG Other	PLANNED OUTAGE	2021-02-20 15:03:18.000	558.52	23
PLF	PLANNED OUTAGE	2021-02-21 15:03:00.000	32,385.33	80
PLF	PLANNED OUTAGE	2021-02-22 07:16:40.000	122.33	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-22 08:14:30.000	59.67	1
TX Repaired (PM)	PLANNED OUTAGE	2021-02-22 08:40:23.000	49.03	1
PLF	PLANNED OUTAGE	2021-02-22 08:42:16.000	3,910.50	18
TX Replaced (OH)	PLANNED OUTAGE	2021-02-22 09:52:26.000	473.20	1
TX Repaired (PM)	PLANNED OUTAGE	2021-02-22 09:52:33.000	222.83	5
TX Replaced (OH)	PLANNED OUTAGE	2021-02-22 10:10:12.000	1,274.58	5
TX Repaired (PM)	PLANNED OUTAGE	2021-02-22 11:21:37.000	359.00	5
TX Replaced (PM)	PLANNED OUTAGE	2021-02-22 14:08:08.000	1,171.10	14
Service - Non Crew	PLANNED OUTAGE	2021-02-22 17:55:27.000	127.55	1
TX Replaced (OH)	PLANNED OUTAGE	2021-02-23 08:19:01.000	1,862.33	4
OH Other	PLANNED OUTAGE	2021-02-23 08:19:46.000	464.30	1
TX Replaced (PM)	PLANNED OUTAGE	2021-02-23 08:42:53.000	413.10	6
TX Replaced (PM)	PLANNED OUTAGE	2021-02-23 09:41:36.000	1,366.23	17
TX Repaired (OH)	PLANNED OUTAGE	2021-02-23 10:22:11.000	4,441.88	13
TX Repaired (PM)	PLANNED OUTAGE	2021-02-23 13:02:32.000	1,091.40	6
TX Replaced (PM)	PLANNED OUTAGE	2021-02-24 08:00:25.000	5,983.47	16
TX Repaired (OH)	PLANNED OUTAGE	2021-02-24 08:04:33.000	254.53	1
PLF	PLANNED OUTAGE	2021-02-24 08:31:24.000	8,478.25	33
TX Replaced (PM)	PLANNED OUTAGE	2021-02-24 08:56:16.000	792.00	22
Circuit Out	PLANNED OUTAGE	2021-02-24 10:11:33.000	1,831.68	1,067
PLF	PLANNED OUTAGE	2021-02-24 11:09:12.000	200.68	1
Circuit Out	PLANNED OUTAGE	2021-02-24 11:13:36.000	12,128.67	2,260
TX Repaired (OH)	PLANNED OUTAGE	2021-02-24 12:06:46.000	490.35	3
Pole	PLANNED OUTAGE	2021-02-24 15:13:54.000	100.07	4
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 07:52:15.000	178.00	6
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 08:30:54.000	66.83	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 08:34:55.000	225.92	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 08:41:34.000	342.90	6
TX Repaired (PM)	PLANNED OUTAGE	2021-02-25 09:06:51.000	232.00	3
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 09:08:22.000	3,061.25	25
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 09:32:48.000	937.53	2
TX Repaired (PM)	PLANNED OUTAGE	2021-02-25 10:45:29.000	133.25	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 11:07:45.000	2,646.15	13
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 11:50:46.000	1,410.57	11
TX Repaired (OH)	PLANNED OUTAGE	2021-02-25 22:32:22.000	2,832.60	36
Circuit Out	PLANNED OUTAGE	2021-02-26 07:40:50.000	1,143.67	94
TX Replaced (OH)	PLANNED OUTAGE	2021-02-26 07:41:14.000	490.85	1
TX Repaired (OH)	PLANNED OUTAGE	2021-02-26 07:50:50.000	142.35	1
TX Replaced (PM)	PLANNED OUTAGE	2021-02-26 08:52:42.000	2,850.80	6
Service-Crew	PLANNED OUTAGE	2021-02-26 09:09:06.000	163.90	1
PLF	PLANNED OUTAGE	2021-02-26 09:12:09.000	3,004.00	15

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Replaced (OH)	PLANNED OUTAGE	2021-02-26 09:15:34.000	2,777.48	7
TX Replaced (PM)	PLANNED OUTAGE	2021-02-26 09:39:53.000	194.67	4
TX Repaired (OH)	PLANNED OUTAGE	2021-02-26 10:57:29.000	970.90	6
TX Replaced (PM)	PLANNED OUTAGE	2021-02-26 11:21:23.000	539.07	13
TX Replaced (PM)	PLANNED OUTAGE	2021-02-26 16:37:56.000	1,446.40	6
UG Other	PLANNED OUTAGE	2021-02-27 18:09:43.000	115.28	1
Circuit Out	PLANNED OUTAGE	2021-02-27 22:38:41.000	5,738.38	2,477
Circuit Out	PLANNED OUTAGE	2021-02-28 06:20:39.000	1,964.67	842
OH Other	PLANNED OUTAGE	2021-02-28 14:44:23.000	30.62	1
TX Replaced (OH)	PLANNED OUTAGE	2021-03-01 08:14:55.000	241.05	1
TX Replaced (OH)	PLANNED OUTAGE	2021-03-01 08:38:13.000	2,924.13	7
TX Repaired (OH)	PLANNED OUTAGE	2021-03-01 10:43:38.000	216.15	1
TX Repaired (OH)	PLANNED OUTAGE	2021-03-01 11:05:11.000	113.35	1
TX Repaired (OH)	PLANNED OUTAGE	2021-03-01 11:23:30.000	730.80	4
OH Other	PLANNED OUTAGE	2021-03-01 12:25:47.000	76.22	1
Circuit Out	PLANNED OUTAGE	2021-03-01 19:47:58.000	5,961.27	1,478
TX Repaired (OH)	PLANNED OUTAGE	2021-03-02 08:31:27.000	2,845.80	6
Connections	PLANNED OUTAGE	2021-03-02 09:15:43.000	68.28	1
OH Other	PLANNED OUTAGE	2021-03-02 09:16:22.000	1,912.67	10
PLF	PLANNED OUTAGE	2021-03-02 09:16:22.000	3,828.00	20
OH Other	PLANNED OUTAGE	2021-03-02 09:36:57.000	536.50	2
Primary Wire	PLANNED OUTAGE	2021-03-02 12:49:57.000	40.05	1
PLF	PLANNED OUTAGE	2021-03-02 21:18:34.000	273.08	1
Circuit Out	PLANNED OUTAGE	2021-03-02 22:10:56.000	1,176.67	706
TX Repaired (OH)	PLANNED OUTAGE	2021-03-03 06:57:29.000	551.80	1
Primary Wire	PLANNED OUTAGE	2021-03-03 07:53:43.000	15,641.80	197
OH Other	PLANNED OUTAGE	2021-03-03 08:19:54.000	1,288.25	5
PLF	PLANNED OUTAGE	2021-03-03 08:56:24.000	86.77	1
OH Other	PLANNED OUTAGE	2021-03-03 08:57:12.000	432.38	1
UG Other	PLANNED OUTAGE	2021-03-03 09:00:10.000	2,615.40	12
OH Other	PLANNED OUTAGE	2021-03-03 09:12:12.000	3,764.55	9
OH Other	PLANNED OUTAGE	2021-03-03 09:13:03.000	2,088.17	5
OH Other	PLANNED OUTAGE	2021-03-03 09:20:20.000	2,457.90	6
PLF	PLANNED OUTAGE	2021-03-03 10:09:02.000	1,680.00	14
UG Other	PLANNED OUTAGE	2021-03-03 10:17:14.000	214.58	5
OH Other	PLANNED OUTAGE	2021-03-03 10:49:34.000	641.30	2
PLF	PLANNED OUTAGE	2021-03-03 11:36:00.000	350.67	5
PLF	PLANNED OUTAGE	2021-03-03 13:34:10.000	42,443.80	426
OH Other	PLANNED OUTAGE	2021-03-03 14:14:41.000	234.02	19
PLF	PLANNED OUTAGE	2021-03-03 21:27:44.000	975.77	146
UG Other	PLANNED OUTAGE	2021-03-04 07:48:44.000	88.27	1
OH Other	PLANNED OUTAGE	2021-03-04 08:44:25.000	3,090.08	11
UG Other	PLANNED OUTAGE	2021-03-04 08:55:01.000	1,889.53	7
OH Other	PLANNED OUTAGE	2021-03-04 09:20:25.000	978.00	4
PLF	PLANNED OUTAGE	2021-03-04 09:23:23.000	284.05	13
OH Other	PLANNED OUTAGE	2021-03-04 09:28:37.000	1,892.00	8
OH Other	PLANNED OUTAGE	2021-03-04 09:28:51.000	312.35	1
UG Other	PLANNED OUTAGE	2021-03-04 09:58:06.000	808.80	9
PLF	PLANNED OUTAGE	2021-03-04 10:06:03.000	1,600.27	8
TX Replaced (PM)	PLANNED OUTAGE	2021-03-04 11:58:40.000	1,887.92	25
TX Replaced (PM)	PLANNED OUTAGE	2021-03-04 12:29:24.000	633.50	7
OH Other	PLANNED OUTAGE	2021-03-05 07:37:50.000	48.17	1
TX Replaced (PM)	PLANNED OUTAGE	2021-03-05 09:22:45.000	724.00	12
UG Other	PLANNED OUTAGE	2021-03-05 10:11:13.000	416.97	14
UG Other	PLANNED OUTAGE	2021-03-05 17:47:17.000	248.33	1
UG Other	PLANNED OUTAGE	2021-03-06 07:50:18.000	314.13	2

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-03-06 11:28:13.000	1.32	1
OH Other	PLANNED OUTAGE	2021-03-08 08:33:18.000	65.70	1
OH Other	PLANNED OUTAGE	2021-03-08 08:37:08.000	85.87	1
#REF!	PLANNED OUTAGE	2021-03-08 08:58:09.000	1,327.75	3
TX Replaced (OH)	PLANNED OUTAGE	2021-03-08 09:12:40.000	1,713.73	4
Pole	PLANNED OUTAGE	2021-03-08 09:23:35.000	412.95	1
OH Other	PLANNED OUTAGE	2021-03-08 09:38:08.000	1,663.40	6
UG Other	PLANNED OUTAGE	2021-03-08 10:31:11.000	9,979.93	56
OH Other	PLANNED OUTAGE	2021-03-08 11:03:07.000	1,096.93	8
UG Other	PLANNED OUTAGE	2021-03-08 11:06:10.000	1,238.88	21
UG Other	PLANNED OUTAGE	2021-03-08 14:27:07.000	613.78	7
OH Other	PLANNED OUTAGE	2021-03-08 19:41:11.000	3.63	2
Circuit Out	PLANNED OUTAGE	2021-03-08 20:38:35.000	17,810.33	1,190
TX Replaced (PM)	PLANNED OUTAGE	2021-03-08 23:19:31.000	1,267.93	4
UG Other	PLANNED OUTAGE	2021-03-08 23:19:31.000	1,900.45	6
UG Other	PLANNED OUTAGE	2021-03-09 07:25:51.000	54.15	1
TX Repaired (PM)	PLANNED OUTAGE	2021-03-09 08:07:31.000	19,485.42	25
TX Repaired (OH)	PLANNED OUTAGE	2021-03-09 08:31:44.000	58.27	1
PLF	PLANNED OUTAGE	2021-03-09 08:45:02.000	4,232.67	40
Switch 600 amp	PLANNED OUTAGE	2021-03-09 09:01:24.000	459.23	2
TX Replaced (OH)	PLANNED OUTAGE	2021-03-09 09:09:38.000	1,208.53	4
TX Replaced (OH)	PLANNED OUTAGE	2021-03-09 09:21:22.000	2,069.90	7
TX Repaired (PM)	PLANNED OUTAGE	2021-03-09 09:30:19.000	48.75	1
PLF	PLANNED OUTAGE	2021-03-09 09:34:51.000	3,323.23	13
TX Replaced (PM)	PLANNED OUTAGE	2021-03-09 09:38:38.000	2,228.63	15
TX Repaired (OH)	PLANNED OUTAGE	2021-03-09 10:02:55.000	1,740.90	7
OH Other	PLANNED OUTAGE	2021-03-09 10:09:36.000	807.87	2
TX Replaced (PM)	PLANNED OUTAGE	2021-03-09 10:14:20.000	3,266.80	22
PLF	PLANNED OUTAGE	2021-03-09 10:40:35.000	3,666.75	15
UG Other	PLANNED OUTAGE	2021-03-09 11:26:32.000	648.30	96
Pole	PLANNED OUTAGE	2021-03-09 11:57:55.000	509.00	3
UG Other	PLANNED OUTAGE	2021-03-09 14:00:46.000	1,594.60	21
UG Other	PLANNED OUTAGE	2021-03-09 16:25:02.000	50.97	1
OH Other	PLANNED OUTAGE	2021-03-10 08:04:42.000	46.30	1
TX Repaired (OH)	PLANNED OUTAGE	2021-03-10 08:16:32.000	1,232.37	22
TX Replaced (OH)	PLANNED OUTAGE	2021-03-10 08:20:54.000	1,860.50	5
UG Other	PLANNED OUTAGE	2021-03-10 08:39:38.000	38.30	6
TX Repaired (OH)	PLANNED OUTAGE	2021-03-10 09:18:22.000	1,066.60	6
TX Repaired (OH)	PLANNED OUTAGE	2021-03-10 10:22:25.000	189.50	6
TX Repaired (OH)	PLANNED OUTAGE	2021-03-10 10:30:17.000	105.60	1
TX Replaced (OH)	PLANNED OUTAGE	2021-03-10 10:33:46.000	3,882.67	64
TX Repaired (OH)	PLANNED OUTAGE	2021-03-10 11:54:25.000	140.27	2
OH Other	PLANNED OUTAGE	2021-03-10 12:21:59.000	68.02	1
TX Replaced (PM)	PLANNED OUTAGE	2021-03-10 12:40:36.000	1,644.40	6
TX Replaced (PM)	PLANNED OUTAGE	2021-03-10 12:42:27.000	1,904.02	23
TX Replaced (PM)	PLANNED OUTAGE	2021-03-10 13:18:21.000	35,454.25	38
TX Repaired (OH)	PLANNED OUTAGE	2021-03-10 14:51:12.000	155.03	2
TX Replaced (PM)	PLANNED OUTAGE	2021-03-11 08:09:02.000	436.78	1
TX Repaired (OH)	PLANNED OUTAGE	2021-03-11 08:35:14.000	1,831.43	7
TX Replaced (OH)	PLANNED OUTAGE	2021-03-11 08:55:04.000	2,577.40	7
TX Replaced (PM)	PLANNED OUTAGE	2021-03-11 10:08:40.000	569.70	9
UG Other	PLANNED OUTAGE	2021-03-11 10:08:40.000	164.27	7
TX Repaired (OH)	PLANNED OUTAGE	2021-03-11 10:18:27.000	628.35	9
Switchgear	PLANNED OUTAGE	2021-03-11 19:24:28.000	5,755.50	10
Circuit Out	PLANNED OUTAGE	2021-03-12 07:39:31.000	5,222.82	623
TX Repaired (PM)	PLANNED OUTAGE	2021-03-12 09:36:19.000	228.78	7

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (PM)	PLANNED OUTAGE	2021-03-12 22:33:33.000	257.40	12
PLF	PLANNED OUTAGE	2021-03-13 07:52:40.000	984.00	9
Switch 600 amp	PLANNED OUTAGE	2021-03-13 09:15:24.000	868.73	2
UG Other	PLANNED OUTAGE	2021-03-13 09:15:24.000	923.70	2
Switch 600 amp	PLANNED OUTAGE	2021-03-14 08:31:12.000	736.00	20
PLF	PLANNED OUTAGE	2021-03-15 08:18:28.000	5,202.87	123
OH Other	PLANNED OUTAGE	2021-03-15 08:43:48.000	37.20	1
TX Repaired (OH)	PLANNED OUTAGE	2021-03-15 09:20:25.000	764.13	11
TX Replaced (OH)	PLANNED OUTAGE	2021-03-15 09:29:14.000	1,689.83	5
TX Repaired (PM)	PLANNED OUTAGE	2021-03-15 09:54:48.000	1,669.00	15
TX Repaired (PM)	PLANNED OUTAGE	2021-03-15 10:29:53.000	1,229.87	16
OH Other	PLANNED OUTAGE	2021-03-15 12:38:03.000	454.63	2
TX Repaired (PM)	PLANNED OUTAGE	2021-03-15 13:45:30.000	1,107.83	23
TX Replaced (OH)	PLANNED OUTAGE	2021-03-16 08:12:15.000	1,880.67	7
TX Replaced (OH)	PLANNED OUTAGE	2021-03-16 08:15:46.000	737.67	2
PLF	PLANNED OUTAGE	2021-03-16 08:27:14.000	4,488.80	12
TX Repaired (OH)	PLANNED OUTAGE	2021-03-16 08:57:46.000	928.27	16
OH Other	PLANNED OUTAGE	2021-03-16 10:16:26.000	25.57	1
TX Replaced (OH)	PLANNED OUTAGE	2021-03-16 10:22:54.000	1,894.40	6
TX Repaired (PM)	PLANNED OUTAGE	2021-03-16 10:26:31.000	193.40	6
TX Repaired (PM)	PLANNED OUTAGE	2021-03-16 11:00:31.000	216.68	1
TX Repaired (OH)	PLANNED OUTAGE	2021-03-16 12:41:22.000	1,052.00	6
TX Repaired (PM)	PLANNED OUTAGE	2021-03-16 16:21:18.000	1,089.78	7
Circuit Out	PLANNED OUTAGE	2021-03-16 16:42:53.000	69,396.67	872
PLF	PLANNED OUTAGE	2021-03-17 01:45:04.000	4,307.40	9
OH Other	PLANNED OUTAGE	2021-03-17 07:49:42.000	103.30	1
Primary Wire	PLANNED OUTAGE	2021-03-17 08:30:03.000	12,664.80	36
Primary Wire	PLANNED OUTAGE	2021-03-17 09:17:30.000	319.80	1
TX Repaired (PM)	PLANNED OUTAGE	2021-03-17 09:32:07.000	16,933.60	86
TX Replaced (PM)	PLANNED OUTAGE	2021-03-17 09:38:59.000	527.10	6
Primary Wire	PLANNED OUTAGE	2021-03-17 10:04:30.000	228.52	1
TX Replaced (PM)	PLANNED OUTAGE	2021-03-17 11:34:35.000	518.33	10
OH Other	PLANNED OUTAGE	2021-03-17 12:24:13.000	112.78	1
TX Repaired (PM)	PLANNED OUTAGE	2021-03-17 18:18:44.000	172.10	1
TX Replaced (OH)	PLANNED OUTAGE	2021-03-18 08:07:20.000	3,970.63	7
Service-Crew	PLANNED OUTAGE	2021-03-18 08:13:10.000	94.83	1
OH Other	PLANNED OUTAGE	2021-03-18 08:32:10.000	2,168.27	4
OH Other	PLANNED OUTAGE	2021-03-18 09:35:37.000	1,438.45	3
OH Other	PLANNED OUTAGE	2021-03-18 09:56:51.000	2,388.63	14
TX Replaced (PM)	PLANNED OUTAGE	2021-03-18 12:15:42.000	944.80	12
Circuit Out	PLANNED OUTAGE	2021-03-18 13:46:21.000	3,866.93	1,706
Circuit Out	PLANNED OUTAGE	2021-03-18 16:18:20.000	3,784.00	1,419
Connections	PLANNED OUTAGE	2021-03-19 08:22:36.000	236.40	1
PLF	PLANNED OUTAGE	2021-03-19 08:43:59.000	92.57	1
TX Repaired (PM)	PLANNED OUTAGE	2021-03-19 09:12:18.000	609.50	10
TX Repaired (OH)	PLANNED OUTAGE	2021-03-19 09:53:27.000	1,999.80	11
TX Repaired (OH)	PLANNED OUTAGE	2021-03-19 13:45:11.000	1,449.62	11
Circuit Out	PLANNED OUTAGE	2021-03-19 15:54:44.000	11,894.63	2,683
Circuit Out	PLANNED OUTAGE	2021-03-20 12:43:01.000	19.70	1
OH Other	PLANNED OUTAGE	2021-03-22 09:18:39.000	1,343.53	4
OH Other	PLANNED OUTAGE	2021-03-22 09:18:51.000	2,348.97	7
OH Other	PLANNED OUTAGE	2021-03-22 12:02:50.000	1,288.35	7
OH Other	PLANNED OUTAGE	2021-03-22 12:14:46.000	219.15	9
OH Other	PLANNED OUTAGE	2021-03-22 12:28:06.000	67.90	1
OH Other	PLANNED OUTAGE	2021-03-22 13:17:16.000	433.53	4
UG Other	PLANNED OUTAGE	2021-03-22 18:08:40.000	122.33	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-03-23 07:52:41.000	1,873.07	4
TX Replaced (PM)	PLANNED OUTAGE	2021-03-23 09:04:07.000	2,642.10	6
OH Other	PLANNED OUTAGE	2021-03-23 09:54:23.000	3,499.65	9
OH Other	PLANNED OUTAGE	2021-03-23 09:55:19.000	50.68	1
Switchgear	PLANNED OUTAGE	2021-03-23 10:35:57.000	820.37	2
OH Other	PLANNED OUTAGE	2021-03-23 11:18:48.000	91.30	2
UG Other	PLANNED OUTAGE	2021-03-24 07:35:56.000	7,385.70	21
OH Other	PLANNED OUTAGE	2021-03-24 07:44:50.000	1,827.33	4
OH Other	PLANNED OUTAGE	2021-03-24 07:53:44.000	1,070.70	2
OH Other	PLANNED OUTAGE	2021-03-24 08:09:09.000	248.90	1
OH Other	PLANNED OUTAGE	2021-03-24 08:34:15.000	6,208.85	23
PLF	PLANNED OUTAGE	2021-03-24 09:11:38.000	307.37	1
OH Other	PLANNED OUTAGE	2021-03-24 09:16:31.000	2,578.05	9
UG Other	PLANNED OUTAGE	2021-03-24 09:30:39.000	446.53	8
PLF	PLANNED OUTAGE	2021-03-24 09:45:51.000	562.47	22
TX Replaced (PM)	PLANNED OUTAGE	2021-03-24 10:06:10.000	1,150.05	11
OH Other	PLANNED OUTAGE	2021-03-24 11:07:01.000	452.65	3
OH Other	PLANNED OUTAGE	2021-03-24 12:27:02.000	55.85	1
UG Other	PLANNED OUTAGE	2021-03-24 13:49:37.000	1,817.10	6
Switch 600 amp	PLANNED OUTAGE	2021-03-24 16:10:27.000	52.90	1
UG Other	PLANNED OUTAGE	2021-03-24 21:47:19.000	2,298.80	12
PLF	PLANNED OUTAGE	2021-03-25 07:50:29.000	112.53	1
OH Other	PLANNED OUTAGE	2021-03-25 08:07:30.000	9,630.00	12
OH Other	PLANNED OUTAGE	2021-03-25 08:52:20.000	655.03	2
OH Other	PLANNED OUTAGE	2021-03-25 08:52:27.000	327.52	1
OH Other	PLANNED OUTAGE	2021-03-25 09:53:42.000	6,195.58	13
OH Other	PLANNED OUTAGE	2021-03-25 10:29:22.000	2,165.68	7
UG Other	PLANNED OUTAGE	2021-03-25 10:42:50.000	819.75	9
OH Other	PLANNED OUTAGE	2021-03-25 12:09:59.000	340.43	2
PLF	PLANNED OUTAGE	2021-03-25 13:16:41.000	2,717.05	49
TX Repaired (OH)	PLANNED OUTAGE	2021-03-26 08:32:42.000	141.23	1
TX Repaired (OH)	PLANNED OUTAGE	2021-03-26 08:34:09.000	281.13	2
UG Other	PLANNED OUTAGE	2021-03-27 21:09:26.000	883.60	2
OH Other	PLANNED OUTAGE	2021-03-27 23:05:44.000	185.33	10
Circuit Out	PLANNED OUTAGE	2021-03-29 08:01:53.000	1,410.22	443
UG Other	PLANNED OUTAGE	2021-03-29 09:23:58.000	218.73	4
UG Other	PLANNED OUTAGE	2021-03-29 09:33:21.000	90.65	1
UG Other	PLANNED OUTAGE	2021-03-29 10:23:35.000	1,524.80	24
UG Other	PLANNED OUTAGE	2021-03-29 10:47:09.000	1,361.00	10
UG Other	PLANNED OUTAGE	2021-03-29 10:52:22.000	801.30	18
OH Other	PLANNED OUTAGE	2021-03-29 10:56:43.000	3,051.83	10
PLF	PLANNED OUTAGE	2021-03-29 10:56:49.000	1,831.30	6
UG Other	PLANNED OUTAGE	2021-03-29 11:05:48.000	956.25	17
UG Other	PLANNED OUTAGE	2021-03-29 11:48:16.000	60.78	1
OH Other	PLANNED OUTAGE	2021-03-29 14:56:37.000	377.70	6
OH Other	PLANNED OUTAGE	2021-03-30 06:06:04.000	148.93	1
PLF	PLANNED OUTAGE	2021-03-30 08:58:17.000	409.67	5
OH Other	PLANNED OUTAGE	2021-03-30 09:06:10.000	1,172.73	14
OH Other	PLANNED OUTAGE	2021-03-30 09:11:42.000	1,032.27	2
UG Other	PLANNED OUTAGE	2021-03-30 10:03:59.000	526.65	9
OH Other	PLANNED OUTAGE	2021-03-30 10:18:19.000	78.68	1
UG Other	PLANNED OUTAGE	2021-03-30 10:40:39.000	2,698.75	15
PLF	PLANNED OUTAGE	2021-03-30 10:47:49.000	2,999.57	58
PLF	PLANNED OUTAGE	2021-03-30 16:14:59.000	5,918.90	39
PLF	PLANNED OUTAGE	2021-03-30 16:46:17.000	473.20	56
Service-Crew	PLANNED OUTAGE	2021-03-31 06:50:15.000	223.75	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-03-31 08:09:55.000	11,500.65	21
OH Other	PLANNED OUTAGE	2021-03-31 08:19:25.000	4,297.33	8
OH Other	PLANNED OUTAGE	2021-03-31 09:10:14.000	1,460.10	3
OH Other	PLANNED OUTAGE	2021-03-31 09:16:17.000	480.50	1
UG Other	PLANNED OUTAGE	2021-03-31 09:38:46.000	252.93	4
OH Other	PLANNED OUTAGE	2021-03-31 09:52:20.000	2,658.10	6
UG Other	PLANNED OUTAGE	2021-03-31 10:11:39.000	243.60	9
UG Other	PLANNED OUTAGE	2021-03-31 11:33:35.000	335.00	6
Service-Crew	PLANNED OUTAGE	2021-03-31 11:34:51.000	300.15	1
OH Other	PLANNED OUTAGE	2021-03-31 12:20:41.000	3,539.00	12
OH Other	PLANNED OUTAGE	2021-03-31 13:45:15.000	211.18	1
UG Other	PLANNED OUTAGE	2021-03-31 15:45:40.000	454.53	7
UG Other	PLANNED OUTAGE	2021-04-01 07:59:34.000	11,130.35	21
UG Other	PLANNED OUTAGE	2021-04-01 09:45:56.000	386.67	5
OH Other	PLANNED OUTAGE	2021-04-01 10:00:48.000	700.57	2
OH Other	PLANNED OUTAGE	2021-04-01 10:01:03.000	700.17	2
UG Other	PLANNED OUTAGE	2021-04-01 10:01:35.000	2,527.20	36
PLF	PLANNED OUTAGE	2021-04-01 10:22:46.000	79,919.38	359
UG Other	PLANNED OUTAGE	2021-04-01 10:22:46.000	11,395.93	68
UG Other	PLANNED OUTAGE	2021-04-01 11:26:34.000	318.40	6
PLF	PLANNED OUTAGE	2021-04-01 13:52:52.000	176.18	1
TX Replaced (PM)	PLANNED OUTAGE	2021-04-01 15:04:35.000	1,079.05	3
UG Other	PLANNED OUTAGE	2021-04-02 09:57:54.000	774.43	2
TX Replaced (PM)	PLANNED OUTAGE	2021-04-03 08:35:41.000	85.28	1
OH Other	PLANNED OUTAGE	2021-04-05 10:07:57.000	837.13	4
OH Other	PLANNED OUTAGE	2021-04-05 11:23:25.000	1,848.23	7
Primary Wire	PLANNED OUTAGE	2021-04-05 11:25:17.000	53.38	1
OH Other	PLANNED OUTAGE	2021-04-05 11:43:57.000	184.18	1
OH Other	PLANNED OUTAGE	2021-04-05 12:23:34.000	618.40	6
OH Other	PLANNED OUTAGE	2021-04-05 12:47:07.000	528.35	3
OH Other	PLANNED OUTAGE	2021-04-05 13:39:47.000	642.33	5
OH Other	PLANNED OUTAGE	2021-04-05 16:25:34.000	733.63	13
OH Other	PLANNED OUTAGE	2021-04-05 20:22:38.000	481.80	11
OH Other	PLANNED OUTAGE	2021-04-06 08:51:25.000	2,528.50	13
TX Replaced (PM)	PLANNED OUTAGE	2021-04-06 09:16:18.000	720.93	8
TX Replaced (PM)	PLANNED OUTAGE	2021-04-06 09:27:05.000	193.75	3
TX Replaced (PM)	PLANNED OUTAGE	2021-04-06 09:46:50.000	299.33	8
OH Other	PLANNED OUTAGE	2021-04-06 09:59:32.000	1,732.20	6
TX Replaced (PM)	PLANNED OUTAGE	2021-04-06 10:31:52.000	513.68	7
PLF	PLANNED OUTAGE	2021-04-06 10:43:16.000	2,957.72	11
TX Replaced (PM)	PLANNED OUTAGE	2021-04-06 10:47:50.000	294.23	7
UG Other	PLANNED OUTAGE	2021-04-06 11:58:46.000	196.52	1
TX Replaced (PM)	PLANNED OUTAGE	2021-04-06 12:05:03.000	376.25	7
OH Other	PLANNED OUTAGE	2021-04-07 07:44:10.000	63.83	1
UG Other	PLANNED OUTAGE	2021-04-07 09:12:27.000	1,668.98	13
PLF	PLANNED OUTAGE	2021-04-07 09:15:26.000	5,494.25	15
Pole	PLANNED OUTAGE	2021-04-07 09:31:50.000	3,973.20	11
PLF	PLANNED OUTAGE	2021-04-07 09:35:51.000	12.63	1
PLF	PLANNED OUTAGE	2021-04-07 09:42:47.000	4,610.28	11
OH Other	PLANNED OUTAGE	2021-04-07 10:38:06.000	3,986.80	12
OH Other	PLANNED OUTAGE	2021-04-07 10:43:26.000	989.95	3
PLF	PLANNED OUTAGE	2021-04-07 10:46:51.000	37.88	1
Circuit Out	PLANNED OUTAGE	2021-04-07 11:56:55.000	3,421.83	838
Pole	PLANNED OUTAGE	2021-04-07 12:27:53.000	4,731.00	20
OH Other	PLANNED OUTAGE	2021-04-07 12:29:27.000	461.70	3
Circuit Out	PLANNED OUTAGE	2021-04-07 14:21:57.000	3,442.50	850

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-04-07 14:28:58.000	249.00	6
PLF	PLANNED OUTAGE	2021-04-07 15:01:23.000	5,976.83	218
PLF	PLANNED OUTAGE	2021-04-07 15:13:30.000	102.73	2
UG Other	PLANNED OUTAGE	2021-04-07 16:21:51.000	5,579.25	43
Circuit Out	PLANNED OUTAGE	2021-04-07 18:34:35.000	4,045.33	1,480
OH Other	PLANNED OUTAGE	2021-04-08 08:15:26.000	322.95	1
OH Other	PLANNED OUTAGE	2021-04-08 08:45:00.000	4,273.73	14
OH Other	PLANNED OUTAGE	2021-04-08 09:17:40.000	3,469.70	13
UG Other	PLANNED OUTAGE	2021-04-08 10:34:42.000	305.50	5
UG Other	PLANNED OUTAGE	2021-04-08 10:51:58.000	1,196.80	11
UG Other	PLANNED OUTAGE	2021-04-08 11:40:40.000	640.00	10
UG Other	PLANNED OUTAGE	2021-04-08 12:13:01.000	355.70	6
OH Other	PLANNED OUTAGE	2021-04-08 12:17:41.000	385.07	4
UG Other	PLANNED OUTAGE	2021-04-08 13:39:05.000	888.55	13
TX Replaced (PM)	PLANNED OUTAGE	2021-04-08 14:10:22.000	8,168.12	13
UG Other	PLANNED OUTAGE	2021-04-08 14:16:45.000	6,842.92	11
OH Other	PLANNED OUTAGE	2021-04-09 09:11:11.000	4,438.00	12
OH Other	PLANNED OUTAGE	2021-04-09 10:36:10.000	98.83	1
OH Other	PLANNED OUTAGE	2021-04-09 10:56:49.000	2,729.50	10
OH Other	PLANNED OUTAGE	2021-04-09 17:28:14.000	45.77	1
OH Other	PLANNED OUTAGE	2021-04-09 19:10:11.000	129.82	1
Primary Wire	PLANNED OUTAGE	2021-04-10 11:09:11.000	3,885.45	824
TX Repaired (PM)	PLANNED OUTAGE	2021-04-10 11:12:10.000	146.17	5
PLF	PLANNED OUTAGE	2021-04-10 12:41:02.000	1,099.73	4
Circuit Out	PLANNED OUTAGE	2021-04-10 18:44:23.000	6,346.62	1,715
Circuit Out	PLANNED OUTAGE	2021-04-10 21:01:30.000	5,011.90	1,314
Circuit Out	PLANNED OUTAGE	2021-04-11 03:33:55.000	128,661.98	1,261
OH Other	PLANNED OUTAGE	2021-04-11 07:02:36.000	4,737.83	106
OH Other	PLANNED OUTAGE	2021-04-11 07:29:09.000	215,883.90	18
OH Other	PLANNED OUTAGE	2021-04-11 08:30:37.000	933.83	130
Circuit Out	PLANNED OUTAGE	2021-04-11 14:05:43.000	21,526.75	1,975
UG Other	PLANNED OUTAGE	2021-04-11 17:05:57.000	211.93	22
Circuit Out	PLANNED OUTAGE	2021-04-11 18:39:39.000	10,565.45	1,393
Circuit Out	PLANNED OUTAGE	2021-04-11 18:41:01.000	8,576.47	1,837
Circuit Out	PLANNED OUTAGE	2021-04-12 17:30:51.000	10,623.60	1,404
PLF	PLANNED OUTAGE	2021-04-13 09:49:25.000	880.83	2
Primary Wire	PLANNED OUTAGE	2021-04-13 14:19:18.000	184.55	1
OH Other	PLANNED OUTAGE	2021-04-13 22:05:17.000	1,819.42	7
TX Repaired (OH)	PLANNED OUTAGE	2021-04-14 09:17:51.000	548.22	1
OH Other	PLANNED OUTAGE	2021-04-14 10:06:32.000	422.67	8
PLF	PLANNED OUTAGE	2021-04-15 01:08:58.000	110.80	1
TX Repaired (OH)	PLANNED OUTAGE	2021-04-15 09:22:59.000	5,077.40	12
TX Repaired (OH)	PLANNED OUTAGE	2021-04-15 09:26:46.000	2,100.08	5
URD Outage	PLANNED OUTAGE	2021-04-15 09:41:36.000	521.60	3
PLF	PLANNED OUTAGE	2021-04-15 10:07:09.000	652.50	9
TX Repaired (OH)	PLANNED OUTAGE	2021-04-15 10:34:34.000	309.75	7
TX Repaired (OH)	PLANNED OUTAGE	2021-04-15 16:38:09.000	135.47	2
TX Replaced (OH)	PLANNED OUTAGE	2021-04-16 08:52:52.000	3,570.23	11
UG Other	PLANNED OUTAGE	2021-04-16 10:01:25.000	402.97	7
OH Other	PLANNED OUTAGE	2021-04-16 10:48:31.000	495.67	5
PLF	PLANNED OUTAGE	2021-04-17 09:31:08.000	5,140.98	173
OH Other	PLANNED OUTAGE	2021-04-18 09:31:36.000	5,276.15	11
Cap Bank	PLANNED OUTAGE	2021-04-18 12:00:07.000	804.00	670
OH Other	PLANNED OUTAGE	2021-04-19 06:23:49.000	36.18	1
PLF	PLANNED OUTAGE	2021-04-19 11:02:56.000	675.07	8
PLF	PLANNED OUTAGE	2021-04-19 15:04:34.000	20.90	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-04-19 15:45:33.000	41.37	1
Circuit Out	PLANNED OUTAGE	2021-04-20 10:28:31.000	16.80	14
PLF	PLANNED OUTAGE	2021-04-20 11:33:45.000	107.07	4
PLF	PLANNED OUTAGE	2021-04-20 13:32:15.000	9,831.90	78
PLF	PLANNED OUTAGE	2021-04-21 08:46:38.000	2,125.67	10
TX Repaired (PM)	PLANNED OUTAGE	2021-04-21 08:47:57.000	2,628.65	19
Switch 600 amp	PLANNED OUTAGE	2021-04-21 09:04:25.000	194.43	1
OH Other	PLANNED OUTAGE	2021-04-21 11:40:14.000	49.33	10
OH Other	PLANNED OUTAGE	2021-04-21 11:46:21.000	493.17	10
PLF	PLANNED OUTAGE	2021-04-21 12:06:41.000	561.00	68
Switch 600 amp	PLANNED OUTAGE	2021-04-21 12:46:29.000	464.87	19
OH Other	PLANNED OUTAGE	2021-04-21 14:48:07.000	454.00	6
OH Other	PLANNED OUTAGE	2021-04-21 17:40:40.000	75.33	1
Secondary Wire	PLANNED OUTAGE	2021-04-21 18:12:52.000	2,316.80	6
OH Other	PLANNED OUTAGE	2021-04-22 05:17:03.000	540.53	4
TX Repaired (OH)	PLANNED OUTAGE	2021-04-22 08:39:46.000	450.17	2
TX Repaired (OH)	PLANNED OUTAGE	2021-04-22 08:44:29.000	3,515.33	10
PLF	PLANNED OUTAGE	2021-04-22 09:17:58.000	2,186.33	35
TX Repaired (OH)	PLANNED OUTAGE	2021-04-22 09:28:57.000	454.07	2
TX Repaired (PM)	PLANNED OUTAGE	2021-04-22 09:48:40.000	7,551.67	20
OH Other	PLANNED OUTAGE	2021-04-22 10:19:42.000	268.08	1
OH Other	PLANNED OUTAGE	2021-04-22 10:37:04.000	515.92	5
OH Other	PLANNED OUTAGE	2021-04-22 11:35:54.000	961.33	4
PLF	PLANNED OUTAGE	2021-04-23 12:13:04.000	443.10	6
PLF	PLANNED OUTAGE	2021-04-23 23:17:03.000	344.22	1
PLF	PLANNED OUTAGE	2021-04-23 23:17:05.000	343.67	1
PLF	PLANNED OUTAGE	2021-04-23 23:34:03.000	1,493.33	5
PLF	PLANNED OUTAGE	2021-04-23 23:34:19.000	653.63	2
PLF	PLANNED OUTAGE	2021-04-23 23:36:09.000	597.30	2
PLF	PLANNED OUTAGE	2021-04-24 09:19:32.000	2,211.52	13
PLF	PLANNED OUTAGE	2021-04-24 09:51:44.000	162.33	2
PLF	PLANNED OUTAGE	2021-04-24 10:04:41.000	322.95	3
PLF	PLANNED OUTAGE	2021-04-24 10:35:58.000	635.52	1
OCR, Sec	PLANNED OUTAGE	2021-04-24 12:16:27.000	540.87	427
OH Other	PLANNED OUTAGE	2021-04-24 15:52:16.000	3,295.00	15
Switchgear	PLANNED OUTAGE	2021-04-24 22:48:46.000	11,436.73	38
Switchgear	PLANNED OUTAGE	2021-04-24 22:49:02.000	30,370.70	101
Switchgear	PLANNED OUTAGE	2021-04-24 22:49:12.000	32,457.60	108
Switchgear	PLANNED OUTAGE	2021-04-24 22:50:13.000	599.03	2
OCR, Sec	PLANNED OUTAGE	2021-04-25 00:34:37.000	6,099.57	243
OCR, Sec	PLANNED OUTAGE	2021-04-25 01:11:40.000	9,356.88	41
PLF	PLANNED OUTAGE	2021-04-25 08:55:16.000	385.92	1
OH Other	PLANNED OUTAGE	2021-04-25 12:56:29.000	173.40	4
Switch 600 amp	PLANNED OUTAGE	2021-04-26 13:48:54.000	49.95	1
OCR, Sec	PLANNED OUTAGE	2021-04-26 16:06:06.000	18,640.50	774
OH Other	PLANNED OUTAGE	2021-04-26 16:06:06.000	23.93	1
Circuit Out	PLANNED OUTAGE	2021-04-26 21:40:35.000	1.23	1
Circuit Out	PLANNED OUTAGE	2021-04-26 21:41:37.000	2,520.00	300
UG Other	PLANNED OUTAGE	2021-04-26 21:46:30.000	5.75	1
TX Repaired (OH)	PLANNED OUTAGE	2021-04-27 08:12:13.000	1,582.15	3
PLF	PLANNED OUTAGE	2021-04-27 08:38:43.000	435.00	1
UG Other	PLANNED OUTAGE	2021-04-27 09:03:22.000	981.95	3
OH Other	PLANNED OUTAGE	2021-04-27 09:13:32.000	320.80	1
OH Other	PLANNED OUTAGE	2021-04-27 09:17:44.000	3,863.50	10
UG Other	PLANNED OUTAGE	2021-04-27 09:55:30.000	498.00	4
OH Other	PLANNED OUTAGE	2021-04-27 09:59:04.000	1,118.33	5

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-04-27 10:08:40.000	2,873.30	59
OH Other	PLANNED OUTAGE	2021-04-27 10:09:30.000	1,058.33	25
OH Other	PLANNED OUTAGE	2021-04-27 10:33:53.000	3,270.83	10
OH Other	PLANNED OUTAGE	2021-04-27 11:25:42.000	2,133.83	14
UG Other	PLANNED OUTAGE	2021-04-27 11:25:42.000	1,890.00	14
UG Other	PLANNED OUTAGE	2021-04-27 11:26:03.000	2,012.03	14
UG Other	PLANNED OUTAGE	2021-04-27 12:02:28.000	1,561.87	8
UG Other	PLANNED OUTAGE	2021-04-27 12:04:59.000	462.20	6
Circuit Out	PLANNED OUTAGE	2021-04-27 12:27:47.000	3,236.08	2,311
PLF	PLANNED OUTAGE	2021-04-27 12:32:44.000	19.32	1
PLF	PLANNED OUTAGE	2021-04-27 13:40:29.000	51.33	1
UG Other	PLANNED OUTAGE	2021-04-27 16:29:56.000	106.87	2
UG Other	PLANNED OUTAGE	2021-04-28 05:57:52.000	692.47	13
Service-Crew	PLANNED OUTAGE	2021-04-28 07:52:00.000	58.00	1
PLF	PLANNED OUTAGE	2021-04-28 08:05:06.000	9,388.80	48
PLF	PLANNED OUTAGE	2021-04-28 08:42:14.000	7,328.30	114
OH Other	PLANNED OUTAGE	2021-04-28 08:42:35.000	3,410.17	7
UG Other	PLANNED OUTAGE	2021-04-28 09:05:59.000	4,026.90	9
TX Replaced (OH)	PLANNED OUTAGE	2021-04-28 09:25:34.000	805.60	2
TX Replaced (PM)	PLANNED OUTAGE	2021-04-28 09:46:15.000	3,712.80	9
TX Replaced (PM)	PLANNED OUTAGE	2021-04-28 09:56:50.000	2,825.32	7
TX Replaced (PM)	PLANNED OUTAGE	2021-04-28 11:45:35.000	1,763.00	6
PLF	PLANNED OUTAGE	2021-04-28 11:51:57.000	81.78	1
TX Replaced (PM)	PLANNED OUTAGE	2021-04-28 11:59:51.000	940.68	11
PLF	PLANNED OUTAGE	2021-04-28 12:07:06.000	7,792.40	506
UG Other	PLANNED OUTAGE	2021-04-28 13:25:59.000	786.50	15
TX Replaced (PM)	PLANNED OUTAGE	2021-04-28 14:15:39.000	683.40	4
PLF	PLANNED OUTAGE	2021-04-29 00:10:22.000	199.02	1
TX Repaired (OH)	PLANNED OUTAGE	2021-04-29 08:12:34.000	9,986.90	21
PLF	PLANNED OUTAGE	2021-04-29 08:20:45.000	10,823.03	46
OH Other	PLANNED OUTAGE	2021-04-29 08:39:06.000	727.20	3
Switch 600 amp	PLANNED OUTAGE	2021-04-29 09:09:22.000	968.60	12
OH Other	PLANNED OUTAGE	2021-04-29 09:15:23.000	648.67	2
OH Other	PLANNED OUTAGE	2021-04-29 09:34:31.000	2,652.17	10
OH Other	PLANNED OUTAGE	2021-04-29 09:40:46.000	2,237.90	6
TX Repaired (PM)	PLANNED OUTAGE	2021-04-29 09:49:25.000	1,230.25	7
UG Other	PLANNED OUTAGE	2021-04-29 10:06:41.000	120.43	2
UG Other	PLANNED OUTAGE	2021-04-29 10:33:39.000	1,114.80	9
UG Other	PLANNED OUTAGE	2021-04-29 11:42:34.000	2,370.75	15
OH Other	PLANNED OUTAGE	2021-04-29 12:23:44.000	7.70	2
OH Other	PLANNED OUTAGE	2021-04-29 13:57:53.000	389.50	3
Circuit Out	PLANNED OUTAGE	2021-04-30 03:52:30.000	2,024.40	207
TX Repaired (OH)	PLANNED OUTAGE	2021-04-30 08:19:10.000	1,906.67	10
TX Repaired (PM)	PLANNED OUTAGE	2021-04-30 08:31:47.000	177.55	1
PLF	PLANNED OUTAGE	2021-04-30 13:05:57.000	1,072.28	49
TX Repaired (PM)	PLANNED OUTAGE	2021-04-30 15:46:08.000	158.20	2
PLF	PLANNED OUTAGE	2021-05-01 09:14:11.000	276.70	1
OH Other	PLANNED OUTAGE	2021-05-01 09:26:38.000	259.47	8
PLF	PLANNED OUTAGE	2021-05-01 09:32:48.000	128.05	1
PLF	PLANNED OUTAGE	2021-05-01 21:21:09.000	49,437.50	150
Circuit Out	PLANNED OUTAGE	2021-05-01 21:40:07.000	7,496.32	1,319
OH Other	PLANNED OUTAGE	2021-05-02 17:08:54.000	353.30	6
OH Other	PLANNED OUTAGE	2021-05-02 18:38:40.000	3,109.33	22
OH Other	PLANNED OUTAGE	2021-05-03 09:38:15.000	474.37	14
UG Other	PLANNED OUTAGE	2021-05-03 10:02:19.000	963.07	8
PLF	PLANNED OUTAGE	2021-05-03 11:04:27.000	101.95	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-05-03 11:04:50.000	101.55	1
UG Other	PLANNED OUTAGE	2021-05-03 11:26:06.000	780.73	7
UG Other	PLANNED OUTAGE	2021-05-03 12:01:37.000	1,559.60	21
OH Other	PLANNED OUTAGE	2021-05-03 14:20:04.000	1,083.13	7
OH Other	PLANNED OUTAGE	2021-05-03 14:49:55.000	64.08	1
PLF	PLANNED OUTAGE	2021-05-04 04:42:53.000	7,314.00	20
OH Other	PLANNED OUTAGE	2021-05-04 08:20:15.000	1,467.17	5
TX Repaired (OH)	PLANNED OUTAGE	2021-05-04 08:34:28.000	816.67	7
TX Repaired (PM)	PLANNED OUTAGE	2021-05-04 08:49:37.000	582.80	8
TX Repaired (PM)	PLANNED OUTAGE	2021-05-04 09:07:47.000	1,056.50	10
PLF	PLANNED OUTAGE	2021-05-04 09:08:08.000	2,425.73	23
TX Repaired (PM)	PLANNED OUTAGE	2021-05-04 09:22:21.000	569.18	1
TX Repaired (PM)	PLANNED OUTAGE	2021-05-04 10:19:05.000	298.33	5
TX Repaired (PM)	PLANNED OUTAGE	2021-05-04 10:26:20.000	905.57	7
PLF	PLANNED OUTAGE	2021-05-04 11:14:10.000	343.53	1
TX Repaired (PM)	PLANNED OUTAGE	2021-05-04 11:54:15.000	985.65	9
TX Repaired (OH)	PLANNED OUTAGE	2021-05-04 12:27:13.000	299.97	1
TX Repaired (OH)	PLANNED OUTAGE	2021-05-04 12:43:02.000	887.58	5
TX Repaired (PM)	PLANNED OUTAGE	2021-05-04 13:22:17.000	857.97	7
PLF	PLANNED OUTAGE	2021-05-04 14:32:56.000	759.07	8
TX Repaired (PM)	PLANNED OUTAGE	2021-05-04 14:58:40.000	758.17	10
UG Other	PLANNED OUTAGE	2021-05-05 09:15:26.000	2,828.53	8
UG Other	PLANNED OUTAGE	2021-05-05 09:16:13.000	231.15	9
UG Other	PLANNED OUTAGE	2021-05-05 09:23:23.000	589.60	8
OH Other	PLANNED OUTAGE	2021-05-05 09:39:32.000	980.15	3
UG Other	PLANNED OUTAGE	2021-05-05 09:50:07.000	1,065.75	7
UG Other	PLANNED OUTAGE	2021-05-05 10:06:45.000	124.17	5
UG Other	PLANNED OUTAGE	2021-05-05 10:25:07.000	1,695.30	6
OH Other	PLANNED OUTAGE	2021-05-05 10:56:44.000	731.80	3
UG Other	PLANNED OUTAGE	2021-05-05 11:07:57.000	191.85	3
UG Other	PLANNED OUTAGE	2021-05-05 11:29:25.000	1,387.80	9
UG Other	PLANNED OUTAGE	2021-05-05 13:09:09.000	2,443.20	24
UG Other	PLANNED OUTAGE	2021-05-05 13:10:01.000	211.90	3
OH Other	PLANNED OUTAGE	2021-05-05 13:20:40.000	1,282.17	10
OH Other	PLANNED OUTAGE	2021-05-05 19:19:19.000	98.93	7
OH Other	PLANNED OUTAGE	2021-05-06 08:37:50.000	2,836.50	45
OH Other	PLANNED OUTAGE	2021-05-06 08:46:50.000	1,494.80	4
UG Other	PLANNED OUTAGE	2021-05-06 08:57:18.000	1,385.40	9
OH Other	PLANNED OUTAGE	2021-05-06 08:59:04.000	381.87	2
PLF	PLANNED OUTAGE	2021-05-06 08:59:04.000	675.43	2
Circuit Out	PLANNED OUTAGE	2021-05-06 09:40:01.000	704.85	37
UG Other	PLANNED OUTAGE	2021-05-06 10:10:27.000	857.73	8
OH Other	PLANNED OUTAGE	2021-05-06 10:54:29.000	1,967.72	11
UG Other	PLANNED OUTAGE	2021-05-06 11:15:41.000	472.33	4
PLF	PLANNED OUTAGE	2021-05-06 17:48:54.000	655.20	6
OH Other	PLANNED OUTAGE	2021-05-06 22:57:31.000	746.83	10
OCR, Sec	PLANNED OUTAGE	2021-05-07 03:38:52.000	6,054.92	565
OH Other	PLANNED OUTAGE	2021-05-07 03:48:37.000	1.07	1
OH Other	PLANNED OUTAGE	2021-05-07 04:23:56.000	405.78	1
UG Other	PLANNED OUTAGE	2021-05-07 09:51:34.000	125.83	1
TX Repaired (OH)	PLANNED OUTAGE	2021-05-07 11:14:13.000	65.73	8
PLF	PLANNED OUTAGE	2021-05-07 17:48:17.000	1,394.58	25
TX Repaired (PM)	PLANNED OUTAGE	2021-05-07 18:32:03.000	602.33	5
Circuit Out	PLANNED OUTAGE	2021-05-08 09:57:54.000	3,492.67	845
UG Other	PLANNED OUTAGE	2021-05-08 11:20:03.000	1,369.90	7
TX Repaired (OH)	PLANNED OUTAGE	2021-05-08 20:25:07.000	1,202.53	8

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-05-08 23:57:40.000	268.75	5
Circuit Out	PLANNED OUTAGE	2021-05-09 09:18:41.000	791.63	254
OH Other	PLANNED OUTAGE	2021-05-09 09:43:22.000	19.90	1
PLF	PLANNED OUTAGE	2021-05-09 20:45:47.000	115.50	5
OH Other	PLANNED OUTAGE	2021-05-09 21:19:18.000	1,320.30	163
PLF	PLANNED OUTAGE	2021-05-10 00:30:38.000	195.32	1
UG Other	PLANNED OUTAGE	2021-05-10 06:58:02.000	700.67	5
TX Repaired (OH)	PLANNED OUTAGE	2021-05-10 09:15:06.000	428.13	4
UG Other	PLANNED OUTAGE	2021-05-10 09:24:55.000	1,404.30	9
OH Other	PLANNED OUTAGE	2021-05-10 09:58:21.000	1,006.67	8
UG Other	PLANNED OUTAGE	2021-05-10 10:18:31.000	837.65	11
Circuit Out	PLANNED OUTAGE	2021-05-10 10:55:20.000	12,089.25	1,791
OH Other	PLANNED OUTAGE	2021-05-10 10:57:58.000	1,151.58	5
OH Other	PLANNED OUTAGE	2021-05-10 11:57:10.000	540.75	3
UG Other	PLANNED OUTAGE	2021-05-10 20:16:49.000	134.17	2
PLF	PLANNED OUTAGE	2021-05-11 08:30:21.000	580.65	36
UG Other	PLANNED OUTAGE	2021-05-11 09:12:14.000	497.60	2
UG Other	PLANNED OUTAGE	2021-05-11 10:00:25.000	298.60	1
PLF	PLANNED OUTAGE	2021-05-11 10:21:39.000	2,475.70	19
UG Other	PLANNED OUTAGE	2021-05-11 11:28:50.000	842.93	4
OH Other	PLANNED OUTAGE	2021-05-11 12:03:48.000	1,138.30	6
UG Other	PLANNED OUTAGE	2021-05-11 13:51:46.000	263.17	10
OH Other	PLANNED OUTAGE	2021-05-11 15:57:40.000	1,961.30	11
UG Other	PLANNED OUTAGE	2021-05-12 08:36:31.000	957.10	6
OH Other	PLANNED OUTAGE	2021-05-12 08:39:06.000	745.67	4
PLF	PLANNED OUTAGE	2021-05-12 09:14:22.000	802.00	6
UG Other	PLANNED OUTAGE	2021-05-12 10:09:18.000	1,048.58	5
UG Other	PLANNED OUTAGE	2021-05-12 10:35:13.000	134.15	3
OH Other	PLANNED OUTAGE	2021-05-12 11:33:03.000	612.87	2
PLF	PLANNED OUTAGE	2021-05-12 16:27:45.000	6,254.95	21
OH Other	PLANNED OUTAGE	2021-05-12 21:13:11.000	361.30	3
OH Other	PLANNED OUTAGE	2021-05-12 21:17:11.000	117.43	1
OH Other	PLANNED OUTAGE	2021-05-13 07:53:14.000	517.77	14
OH Other	PLANNED OUTAGE	2021-05-13 08:16:59.000	4,270.40	17
UG Other	PLANNED OUTAGE	2021-05-13 08:18:08.000	2,003.87	8
OH Other	PLANNED OUTAGE	2021-05-13 08:34:14.000	5,586.15	9
PLF	PLANNED OUTAGE	2021-05-13 08:41:32.000	2,839.90	42
PLF	PLANNED OUTAGE	2021-05-13 10:14:14.000	740.00	20
PLF	PLANNED OUTAGE	2021-05-13 10:30:57.000	2,455.13	7
OH Other	PLANNED OUTAGE	2021-05-13 11:01:12.000	164.95	1
UG Other	PLANNED OUTAGE	2021-05-13 12:00:50.000	2,141.50	5
OH Other	PLANNED OUTAGE	2021-05-13 12:29:44.000	76.42	1
UG Other	PLANNED OUTAGE	2021-05-13 12:56:08.000	2,788.27	32
Circuit Out	PLANNED OUTAGE	2021-05-13 17:56:52.000	2,360.40	1,124
TX Repaired (OH)	PLANNED OUTAGE	2021-05-14 21:58:11.000	1,939.13	29
OH Other	PLANNED OUTAGE	2021-05-14 23:09:58.000	109.10	6
PLF	PLANNED OUTAGE	2021-05-15 01:43:21.000	721.00	10
UG Other	PLANNED OUTAGE	2021-05-15 08:06:43.000	377.77	2
PLF	PLANNED OUTAGE	2021-05-15 08:24:21.000	293.00	20
PLF	PLANNED OUTAGE	2021-05-15 08:28:29.000	63.75	3
UG Other	PLANNED OUTAGE	2021-05-15 09:40:05.000	666.87	1
UG Other	PLANNED OUTAGE	2021-05-15 10:40:53.000	428.67	4
PLF	PLANNED OUTAGE	2021-05-15 17:14:47.000	571.97	2
TX Repaired (OH)	PLANNED OUTAGE	2021-05-15 17:36:25.000	224.47	1
OH Other	PLANNED OUTAGE	2021-05-16 00:03:16.000	1,107.00	12
Circuit Out	PLANNED OUTAGE	2021-05-16 08:02:51.000	1,133.93	466

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-05-16 20:28:47.000	144.22	1
UG Other	PLANNED OUTAGE	2021-05-16 21:03:35.000	875.33	8
UG Other	PLANNED OUTAGE	2021-05-16 21:17:33.000	286.40	3
UG Other	PLANNED OUTAGE	2021-05-16 21:24:25.000	88.58	1
UG Other	PLANNED OUTAGE	2021-05-16 21:31:44.000	772.80	9
UG Other	PLANNED OUTAGE	2021-05-16 21:39:17.000	516.13	7
PLF	PLANNED OUTAGE	2021-05-17 09:29:52.000	531.17	5
OH Other	PLANNED OUTAGE	2021-05-17 10:56:33.000	673.53	4
PLF	PLANNED OUTAGE	2021-05-17 23:18:32.000	1,236.30	6
PLF	PLANNED OUTAGE	2021-05-18 09:17:03.000	738.00	18
PLF	PLANNED OUTAGE	2021-05-18 09:42:19.000	88.53	1
OH Other	PLANNED OUTAGE	2021-05-18 11:17:48.000	718.47	4
OH Other	PLANNED OUTAGE	2021-05-18 13:25:00.000	21.75	1
TX Repaired (OH)	PLANNED OUTAGE	2021-05-18 17:25:22.000	1,089.25	15
OH Other	PLANNED OUTAGE	2021-05-19 00:28:42.000	723.98	11
OH Other	PLANNED OUTAGE	2021-05-19 00:46:49.000	1,001.70	21
TX Repaired (OH)	PLANNED OUTAGE	2021-05-19 08:43:50.000	1,555.40	4
OH Other	PLANNED OUTAGE	2021-05-19 09:45:49.000	1,017.35	3
PLF	PLANNED OUTAGE	2021-05-19 12:29:51.000	368.95	1
PLF	PLANNED OUTAGE	2021-05-19 14:54:09.000	131.28	1
OH Other	PLANNED OUTAGE	2021-05-19 18:33:15.000	543.10	6
OH Other	PLANNED OUTAGE	2021-05-19 19:01:17.000	1,519.50	6
PLF	PLANNED OUTAGE	2021-05-19 20:42:00.000	15,811.87	140
PLF	PLANNED OUTAGE	2021-05-19 23:41:02.000	510.45	3
UG Other	PLANNED OUTAGE	2021-05-20 08:34:00.000	1,500.50	6
UG Other	PLANNED OUTAGE	2021-05-20 09:21:52.000	365.50	1
OH Other	PLANNED OUTAGE	2021-05-20 09:56:18.000	2,400.00	9
OH Other	PLANNED OUTAGE	2021-05-20 10:34:48.000	622.73	4
PLF	PLANNED OUTAGE	2021-05-20 11:12:53.000	3.02	1
UG Other	PLANNED OUTAGE	2021-05-20 11:25:16.000	364.52	1
PLF	PLANNED OUTAGE	2021-05-20 11:37:15.000	172.98	1
OH Other	PLANNED OUTAGE	2021-05-20 12:02:34.000	1,218.67	8
PLF	PLANNED OUTAGE	2021-05-20 17:00:39.000	629.40	6
PLF	PLANNED OUTAGE	2021-05-20 18:23:01.000	90.60	6
UG Other	PLANNED OUTAGE	2021-05-21 00:19:21.000	3,130.33	20
PLF	PLANNED OUTAGE	2021-05-21 06:47:47.000	231.17	10
Switch 600 amp	PLANNED OUTAGE	2021-05-21 08:02:53.000	222.03	1
OH Other	PLANNED OUTAGE	2021-05-21 08:10:19.000	3,991.20	9
UG Other	PLANNED OUTAGE	2021-05-21 08:40:25.000	1,993.60	32
PLF	PLANNED OUTAGE	2021-05-21 21:48:01.000	594.40	2
Circuit Out	PLANNED OUTAGE	2021-05-22 05:46:21.000	7,503.60	296
PLF	PLANNED OUTAGE	2021-05-22 07:46:41.000	612.20	1
OH Other	PLANNED OUTAGE	2021-05-22 08:54:23.000	119.32	1
OH Other	PLANNED OUTAGE	2021-05-22 12:54:02.000	142.23	2
UG Other	PLANNED OUTAGE	2021-05-22 20:36:52.000	2,330.53	11
Circuit Out	PLANNED OUTAGE	2021-05-23 08:12:44.000	1,237.57	542
OCR, Sec	PLANNED OUTAGE	2021-05-24 07:26:09.000	6,756.80	984
UG Other	PLANNED OUTAGE	2021-05-24 09:16:21.000	885.73	28
UG Other	PLANNED OUTAGE	2021-05-24 09:45:12.000	5,636.00	16
UG Other	PLANNED OUTAGE	2021-05-24 09:46:31.000	376.80	1
UG Other	PLANNED OUTAGE	2021-05-24 09:51:23.000	5,956.53	16
UG Other	PLANNED OUTAGE	2021-05-24 10:04:06.000	959.90	3
PLF	PLANNED OUTAGE	2021-05-24 10:13:40.000	4,069.67	29
UG Other	PLANNED OUTAGE	2021-05-24 10:47:15.000	496.60	26
UG Other	PLANNED OUTAGE	2021-05-24 12:07:02.000	2,525.40	12
UG Other	PLANNED OUTAGE	2021-05-24 12:07:42.000	2,518.00	12

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-05-24 12:18:41.000	361.67	7
UG Other	PLANNED OUTAGE	2021-05-24 12:22:24.000	1,272.95	7
PLF	PLANNED OUTAGE	2021-05-24 13:51:02.000	1,384.05	15
UG Other	PLANNED OUTAGE	2021-05-24 14:06:33.000	152.67	8
UG Other	PLANNED OUTAGE	2021-05-24 16:19:32.000	2,197.08	5
UG Other	PLANNED OUTAGE	2021-05-24 17:06:56.000	436.80	6
OH Other	PLANNED OUTAGE	2021-05-24 18:07:20.000	107.02	1
PLF	PLANNED OUTAGE	2021-05-25 06:21:28.000	10,124.60	213
TX Repaired (OH)	PLANNED OUTAGE	2021-05-25 08:37:26.000	2,415.78	11
UG Other	PLANNED OUTAGE	2021-05-25 08:41:44.000	1,217.70	3
OH Other	PLANNED OUTAGE	2021-05-25 08:45:52.000	1,050.08	5
PLF	PLANNED OUTAGE	2021-05-25 08:54:54.000	3,821.07	8
UG Other	PLANNED OUTAGE	2021-05-25 09:00:51.000	1,045.47	8
OH Other	PLANNED OUTAGE	2021-05-25 09:04:09.000	171.15	3
URD Outage	PLANNED OUTAGE	2021-05-25 09:27:54.000	3,152.85	7
PLF	PLANNED OUTAGE	2021-05-25 09:28:41.000	5,973.20	24
PLF	PLANNED OUTAGE	2021-05-25 09:50:12.000	559.07	8
OH Other	PLANNED OUTAGE	2021-05-25 09:51:28.000	2,555.00	12
OH Other	PLANNED OUTAGE	2021-05-25 09:55:30.000	1,967.17	11
UG Other	PLANNED OUTAGE	2021-05-25 09:55:46.000	358.07	2
PLF	PLANNED OUTAGE	2021-05-25 10:37:37.000	2,279.57	22
Circuit Out	PLANNED OUTAGE	2021-05-25 11:05:21.000	7,968.00	1,494
UG Other	PLANNED OUTAGE	2021-05-25 11:45:40.000	2,412.87	17
PLF	PLANNED OUTAGE	2021-05-25 11:50:42.000	889.47	14
UG Other	PLANNED OUTAGE	2021-05-25 12:56:59.000	487.20	6
UG Other	PLANNED OUTAGE	2021-05-25 13:14:35.000	3,612.00	15
UG Other	PLANNED OUTAGE	2021-05-25 13:58:13.000	104.58	5
OH Other	PLANNED OUTAGE	2021-05-25 14:28:40.000	407.70	6
UG Other	PLANNED OUTAGE	2021-05-25 15:52:45.000	323.53	4
Circuit Out	PLANNED OUTAGE	2021-05-26 06:46:48.000	77,445.48	2,669
UG Other	PLANNED OUTAGE	2021-05-26 08:48:47.000	1,515.17	10
UG Other	PLANNED OUTAGE	2021-05-26 09:01:18.000	54.85	1
UG Other	PLANNED OUTAGE	2021-05-26 09:17:25.000	429.23	1
TX Repaired (PM)	PLANNED OUTAGE	2021-05-26 09:30:52.000	1,252.53	8
UG Other	PLANNED OUTAGE	2021-05-26 09:40:44.000	1,397.73	11
OH Other	PLANNED OUTAGE	2021-05-26 10:04:31.000	3,009.07	13
OH Other	PLANNED OUTAGE	2021-05-26 10:10:44.000	1,352.60	6
OH Other	PLANNED OUTAGE	2021-05-26 10:21:50.000	879.82	11
OH Other	PLANNED OUTAGE	2021-05-26 11:15:29.000	361.70	2
UG Other	PLANNED OUTAGE	2021-05-26 11:38:46.000	321.73	4
UG Other	PLANNED OUTAGE	2021-05-26 12:08:36.000	1,081.05	9
PLF	PLANNED OUTAGE	2021-05-26 12:42:08.000	1,487.20	12
UG Other	PLANNED OUTAGE	2021-05-26 13:28:50.000	741.73	8
UG Other	PLANNED OUTAGE	2021-05-26 14:08:07.000	3,724.65	27
PLF	PLANNED OUTAGE	2021-05-26 15:03:14.000	70.77	1
UG Other	PLANNED OUTAGE	2021-05-27 03:43:56.000	51.00	12
UG Other	PLANNED OUTAGE	2021-05-27 08:17:39.000	877.92	7
TX Repaired (OH)	PLANNED OUTAGE	2021-05-27 08:23:35.000	897.40	4
OH Other	PLANNED OUTAGE	2021-05-27 08:23:38.000	1,082.78	7
UG Other	PLANNED OUTAGE	2021-05-27 08:48:55.000	395.40	1
UG Other	PLANNED OUTAGE	2021-05-27 08:55:03.000	263.72	1
PLF	PLANNED OUTAGE	2021-05-27 09:21:28.000	1,874.95	21
PLF	PLANNED OUTAGE	2021-05-27 09:24:50.000	246.53	1
PLF	PLANNED OUTAGE	2021-05-27 10:18:52.000	339.43	2
PLF	PLANNED OUTAGE	2021-05-27 11:34:46.000	367.60	4
UG Other	PLANNED OUTAGE	2021-05-28 08:04:25.000	1,462.50	25

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-05-28 09:14:56.000	260.78	1
OH Other	PLANNED OUTAGE	2021-05-28 09:25:57.000	844.78	7
UG Other	PLANNED OUTAGE	2021-05-28 09:26:17.000	119.75	1
UG Other	PLANNED OUTAGE	2021-05-28 11:48:09.000	1,392.00	6
PLF	PLANNED OUTAGE	2021-05-29 12:05:24.000	9,025.25	15
OH Other	PLANNED OUTAGE	2021-05-29 12:51:46.000	606.60	9
OCR, Sec	PLANNED OUTAGE	2021-05-29 17:53:57.000	9,530.13	167
UG Other	PLANNED OUTAGE	2021-05-29 18:28:27.000	35.52	1
UG Other	PLANNED OUTAGE	2021-05-29 18:41:19.000	4,925.33	35
OH Other	PLANNED OUTAGE	2021-05-29 20:34:45.000	108.28	1
OCR, Sec	PLANNED OUTAGE	2021-05-30 21:37:43.000	9,421.12	697
OCR, Sec	PLANNED OUTAGE	2021-05-30 21:54:35.000	1,208.72	347
TX Repaired (OH)	PLANNED OUTAGE	2021-05-31 08:21:50.000	1,264.00	8
TX Repaired (OH)	PLANNED OUTAGE	2021-06-01 09:19:29.000	3,174.27	19
PLF	PLANNED OUTAGE	2021-06-01 14:01:41.000	50.52	1
OH Other	PLANNED OUTAGE	2021-06-01 16:00:08.000	21.92	1
OH Other	PLANNED OUTAGE	2021-06-01 20:37:56.000	75.80	3
OH Other	PLANNED OUTAGE	2021-06-02 08:37:18.000	1,526.40	3
OH Other	PLANNED OUTAGE	2021-06-02 08:40:40.000	4,471.02	7
TX Repaired (PM)	PLANNED OUTAGE	2021-06-02 08:46:56.000	560.13	8
TX Repaired (OH)	PLANNED OUTAGE	2021-06-02 09:02:40.000	584.40	9
UG Other	PLANNED OUTAGE	2021-06-02 10:59:22.000	232.25	3
UG Other	PLANNED OUTAGE	2021-06-02 17:50:20.000	725.20	7
PLF	PLANNED OUTAGE	2021-06-02 20:01:17.000	4,674.20	12
UG Other	PLANNED OUTAGE	2021-06-02 22:14:23.000	288.40	1
PLF	PLANNED OUTAGE	2021-06-02 22:29:35.000	4,524.00	120
Primary Wire	PLANNED OUTAGE	2021-06-03 01:34:44.000	3,608.73	266
Circuit Out	PLANNED OUTAGE	2021-06-03 08:41:48.000	18.67	14
OH Other	PLANNED OUTAGE	2021-06-03 10:25:25.000	136.60	1
TX Repaired (OH)	PLANNED OUTAGE	2021-06-03 13:51:48.000	3,704.35	13
Circuit Out	PLANNED OUTAGE	2021-06-03 19:02:26.000	307,798.80	1,322
UG Other	PLANNED OUTAGE	2021-06-03 21:31:21.000	425.72	1
OH Other	PLANNED OUTAGE	2021-06-04 08:18:50.000	211.70	1
UG Other	PLANNED OUTAGE	2021-06-04 08:36:39.000	2,459.23	19
Circuit Out	PLANNED OUTAGE	2021-06-04 20:14:26.000	1,862.23	1,489
PLF	PLANNED OUTAGE	2021-06-05 00:17:58.000	3,920.20	51
Circuit Out	PLANNED OUTAGE	2021-06-05 08:06:58.000	10,680.67	1,480
OH Other	PLANNED OUTAGE	2021-06-05 09:08:06.000	1,683.73	4
OH Other	PLANNED OUTAGE	2021-06-05 09:13:09.000	241.33	8
Circuit Out	PLANNED OUTAGE	2021-06-05 10:54:08.000	44,633.42	2,117
OH Other	PLANNED OUTAGE	2021-06-05 12:49:45.000	454.35	3
OH Other	PLANNED OUTAGE	2021-06-05 12:58:15.000	393.40	7
UG Other	PLANNED OUTAGE	2021-06-05 13:28:19.000	247.17	2
Circuit Out	PLANNED OUTAGE	2021-06-05 13:52:55.000	60,244.43	1,364
OH Other	PLANNED OUTAGE	2021-06-05 13:52:55.000	89.42	2
PLF	PLANNED OUTAGE	2021-06-05 22:31:55.000	1,227.92	35
PLF	PLANNED OUTAGE	2021-06-05 22:44:56.000	2,052.20	93
OH Other	PLANNED OUTAGE	2021-06-06 14:03:44.000	205.50	2
PLF	PLANNED OUTAGE	2021-06-06 20:51:23.000	399.00	42
Circuit Out	PLANNED OUTAGE	2021-06-07 01:16:12.000	6,126.17	2,065
PLF	PLANNED OUTAGE	2021-06-07 08:15:22.000	1,842.17	14
PLF	PLANNED OUTAGE	2021-06-07 08:42:33.000	74.40	1
UG Other	PLANNED OUTAGE	2021-06-07 08:48:51.000	662.20	3
OH Other	PLANNED OUTAGE	2021-06-07 08:54:38.000	4,620.20	12
UG Other	PLANNED OUTAGE	2021-06-07 10:56:29.000	194.00	1
OH Other	PLANNED OUTAGE	2021-06-07 11:12:27.000	222.30	2

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-06-07 12:36:54.000	286.50	3
Circuit Out	PLANNED OUTAGE	2021-06-07 19:44:36.000	3,337.50	250
TX Repaired (PM)	PLANNED OUTAGE	2021-06-08 08:14:27.000	614.60	6
TX Repaired (OH)	PLANNED OUTAGE	2021-06-08 09:01:11.000	595.87	2
PLF	PLANNED OUTAGE	2021-06-08 09:09:07.000	277.80	1
PLF	PLANNED OUTAGE	2021-06-08 09:27:32.000	96.70	1
TX Repaired (PM)	PLANNED OUTAGE	2021-06-08 10:06:48.000	1,384.92	5
TX Replaced (OH)	PLANNED OUTAGE	2021-06-08 10:07:35.000	6,895.77	34
TX Repaired (OH)	PLANNED OUTAGE	2021-06-08 10:44:56.000	316.67	5
PLF	PLANNED OUTAGE	2021-06-08 11:42:20.000	124.47	1
TX Repaired (OH)	PLANNED OUTAGE	2021-06-08 13:08:49.000	1,410.25	5
TX Repaired (PM)	PLANNED OUTAGE	2021-06-08 14:44:04.000	117.45	3
PLF	PLANNED OUTAGE	2021-06-08 22:55:54.000	873.20	12
PLF	PLANNED OUTAGE	2021-06-09 07:47:53.000	73.08	1
PLF	PLANNED OUTAGE	2021-06-09 08:03:29.000	226.18	1
UG Other	PLANNED OUTAGE	2021-06-09 08:28:13.000	3,165.20	6
OH Other	PLANNED OUTAGE	2021-06-09 08:28:22.000	1,583.75	3
TX Repaired (OH)	PLANNED OUTAGE	2021-06-09 08:40:09.000	712.87	4
PLF	PLANNED OUTAGE	2021-06-09 08:43:48.000	1,660.20	12
TX Repaired (OH)	PLANNED OUTAGE	2021-06-09 09:17:33.000	450.13	1
UG Other	PLANNED OUTAGE	2021-06-09 09:48:04.000	1,474.35	9
OCR, Sec	PLANNED OUTAGE	2021-06-09 10:14:26.000	19,153.00	642
UG Other	PLANNED OUTAGE	2021-06-09 10:57:34.000	2,581.45	17
OH Other	PLANNED OUTAGE	2021-06-09 10:58:55.000	85.68	1
UG Other	PLANNED OUTAGE	2021-06-09 12:04:22.000	344.40	2
UG Other	PLANNED OUTAGE	2021-06-09 12:38:57.000	908.67	8
PLF	PLANNED OUTAGE	2021-06-09 13:34:46.000	471.33	8
UG Other	PLANNED OUTAGE	2021-06-09 14:28:49.000	1,349.60	8
UG Other	PLANNED OUTAGE	2021-06-09 15:00:08.000	368.47	4
PLF	PLANNED OUTAGE	2021-06-09 15:01:54.000	39.40	12
OH Other	PLANNED OUTAGE	2021-06-09 16:19:43.000	5,012.93	41
OH Other	PLANNED OUTAGE	2021-06-09 19:32:20.000	424.88	13
PLF	PLANNED OUTAGE	2021-06-09 21:24:41.000	351.45	1
UG Other	PLANNED OUTAGE	2021-06-09 21:35:45.000	458.55	9
TX Replaced (PM)	PLANNED OUTAGE	2021-06-09 21:38:59.000	417.75	9
OH Other	PLANNED OUTAGE	2021-06-09 21:53:04.000	32.88	1
UG Other	PLANNED OUTAGE	2021-06-10 08:15:32.000	6,709.05	17
TX Repaired (OH)	PLANNED OUTAGE	2021-06-10 08:27:49.000	835.60	4
OH Other	PLANNED OUTAGE	2021-06-10 09:08:48.000	8,497.23	26
PLF	PLANNED OUTAGE	2021-06-10 09:23:44.000	241.53	1
OH Other	PLANNED OUTAGE	2021-06-10 10:36:26.000	219.00	6
OH Other	PLANNED OUTAGE	2021-06-10 13:33:26.000	223.50	3
UG Other	PLANNED OUTAGE	2021-06-10 18:24:27.000	298.85	3
OH Other	PLANNED OUTAGE	2021-06-10 19:36:11.000	411.38	1
OH Other	PLANNED OUTAGE	2021-06-11 08:06:59.000	626.35	3
OH Other	PLANNED OUTAGE	2021-06-11 08:23:28.000	387.67	2
UG Other	PLANNED OUTAGE	2021-06-11 08:44:09.000	1,528.00	12
PLF	PLANNED OUTAGE	2021-06-11 09:01:27.000	262.70	1
OH Other	PLANNED OUTAGE	2021-06-11 09:23:43.000	324.42	5
OH Other	PLANNED OUTAGE	2021-06-11 11:39:51.000	31.80	2
OH Other	PLANNED OUTAGE	2021-06-12 02:01:55.000	1,013.60	3
OH Other	PLANNED OUTAGE	2021-06-12 06:44:59.000	321.65	21
OH Other	PLANNED OUTAGE	2021-06-12 07:44:44.000	1,347.15	21
OH Other	PLANNED OUTAGE	2021-06-12 12:53:45.000	1,028.25	9
OCR, Sec	PLANNED OUTAGE	2021-06-13 18:02:01.000	4,258.33	1,022
UG Other	PLANNED OUTAGE	2021-06-14 09:40:21.000	1,778.23	7

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switchgear	PLANNED OUTAGE	2021-06-14 10:05:09.000	248.08	1
Circuit Out	PLANNED OUTAGE	2021-06-14 10:30:13.000	12,783.50	865
UG Other	PLANNED OUTAGE	2021-06-14 13:07:46.000	837.75	5
UG Other	PLANNED OUTAGE	2021-06-14 13:42:52.000	474.07	4
Switchgear	PLANNED OUTAGE	2021-06-14 14:13:36.000	16.47	1
OH Other	PLANNED OUTAGE	2021-06-14 16:39:40.000	793.60	12
PLF	PLANNED OUTAGE	2021-06-14 16:55:09.000	345.38	17
PLF	PLANNED OUTAGE	2021-06-14 16:56:51.000	354.98	19
PLF	PLANNED OUTAGE	2021-06-15 02:23:33.000	37,352.00	84
PLF	PLANNED OUTAGE	2021-06-15 07:32:46.000	6,645.87	16
PLF	PLANNED OUTAGE	2021-06-15 08:43:24.000	2,522.67	8
PLF	PLANNED OUTAGE	2021-06-15 09:03:33.000	461.42	49
PLF	PLANNED OUTAGE	2021-06-15 09:17:16.000	7,481.20	111
PLF	PLANNED OUTAGE	2021-06-15 10:26:07.000	414.05	7
PLF	PLANNED OUTAGE	2021-06-15 11:09:20.000	1,945.03	59
PLF	PLANNED OUTAGE	2021-06-15 11:35:01.000	160.77	1
UG Other	PLANNED OUTAGE	2021-06-15 11:49:53.000	1,844.47	4
OH Other	PLANNED OUTAGE	2021-06-15 15:47:18.000	78.03	2
PLF	PLANNED OUTAGE	2021-06-15 16:57:54.000	727.47	16
UG Other	PLANNED OUTAGE	2021-06-16 08:13:18.000	544.53	8
OH Other	PLANNED OUTAGE	2021-06-16 08:51:50.000	887.80	1
PLF	PLANNED OUTAGE	2021-06-16 09:13:44.000	328.50	2
PLF	PLANNED OUTAGE	2021-06-16 10:33:14.000	129.50	2
Circuit Out	PLANNED OUTAGE	2021-06-16 10:35:55.000	7,036.40	2,001
OH Other	PLANNED OUTAGE	2021-06-16 10:35:55.000	32.52	4
PLF	PLANNED OUTAGE	2021-06-16 10:40:17.000	1,904.53	16
OH Other	PLANNED OUTAGE	2021-06-16 10:55:06.000	357.03	1
TX Repaired (OH)	PLANNED OUTAGE	2021-06-16 13:47:12.000	219.50	6
OH Other	PLANNED OUTAGE	2021-06-16 14:46:47.000	663.00	3
UG Other	PLANNED OUTAGE	2021-06-16 15:46:45.000	51.38	1
UG Other	PLANNED OUTAGE	2021-06-16 19:19:58.000	112.00	6
PLF	PLANNED OUTAGE	2021-06-16 23:48:14.000	5,138.50	239
OH Other	PLANNED OUTAGE	2021-06-17 01:27:23.000	227.60	3
UG Other	PLANNED OUTAGE	2021-06-17 02:13:32.000	553.07	17
OH Other	PLANNED OUTAGE	2021-06-17 04:39:40.000	1,667.50	21
OH Other	PLANNED OUTAGE	2021-06-17 04:51:33.000	13,972.50	135
TX Repaired (OH)	PLANNED OUTAGE	2021-06-17 06:09:25.000	3,254.70	6
OH Other	PLANNED OUTAGE	2021-06-17 06:14:45.000	365.40	18
TX Repaired (PM)	PLANNED OUTAGE	2021-06-17 08:57:22.000	2,502.92	25
OH Other	PLANNED OUTAGE	2021-06-17 09:02:09.000	46.27	2
UG Other	PLANNED OUTAGE	2021-06-17 10:38:19.000	1,777.08	25
OH Other	PLANNED OUTAGE	2021-06-17 11:11:26.000	295.17	1
OH Other	PLANNED OUTAGE	2021-06-17 11:11:40.000	294.93	1
OH Other	PLANNED OUTAGE	2021-06-17 11:50:23.000	256.22	1
OCR, Sec	PLANNED OUTAGE	2021-06-17 12:05:15.000	2,896.20	12
OH Other	PLANNED OUTAGE	2021-06-17 13:04:13.000	702.40	6
UG Other	PLANNED OUTAGE	2021-06-17 13:05:03.000	415.90	6
UG Other	PLANNED OUTAGE	2021-06-17 14:36:29.000	85.67	1
OH Other	PLANNED OUTAGE	2021-06-17 18:56:02.000	81.80	1
PLF	PLANNED OUTAGE	2021-06-17 20:18:25.000	205.05	3
PLF	PLANNED OUTAGE	2021-06-17 21:14:41.000	520.33	35
PLF	PLANNED OUTAGE	2021-06-17 21:49:43.000	1,876.20	12
PLF	PLANNED OUTAGE	2021-06-18 01:13:44.000	219.20	1
OCR, Sec	PLANNED OUTAGE	2021-06-18 13:18:47.000	2,590.80	34
OH Other	PLANNED OUTAGE	2021-06-18 15:48:58.000	1,028.67	8
OH Other	PLANNED OUTAGE	2021-06-18 16:27:16.000	523.60	7

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-06-18 18:45:04.000	17,253.90	171
OH Other	PLANNED OUTAGE	2021-06-18 21:00:45.000	393.85	3
PLF	PLANNED OUTAGE	2021-06-19 19:32:47.000	194.35	3
PLF	PLANNED OUTAGE	2021-06-19 21:28:33.000	2,049.58	25
OH Other	PLANNED OUTAGE	2021-06-20 20:57:04.000	413.83	13
UG Other	PLANNED OUTAGE	2021-06-20 22:40:27.000	2,755.38	31
PLF	PLANNED OUTAGE	2021-06-20 23:31:32.000	260.02	1
OH Other	PLANNED OUTAGE	2021-06-21 05:16:03.000	1,739.83	11
OH Other	PLANNED OUTAGE	2021-06-21 10:19:47.000	1,225.67	5
Circuit Out	PLANNED OUTAGE	2021-06-21 13:34:05.000	9,937.03	1,322
PLF	PLANNED OUTAGE	2021-06-22 00:46:23.000	351.53	1
UG Other	PLANNED OUTAGE	2021-06-22 08:19:22.000	1,516.80	9
OH Other	PLANNED OUTAGE	2021-06-22 08:29:47.000	3,646.60	12
PLF	PLANNED OUTAGE	2021-06-22 09:27:47.000	7,574.40	32
PLF	PLANNED OUTAGE	2021-06-22 09:27:52.000	2,084.50	22
PLF	PLANNED OUTAGE	2021-06-22 09:29:22.000	1,175.58	5
UG Other	PLANNED OUTAGE	2021-06-22 10:34:18.000	764.67	10
PLF	PLANNED OUTAGE	2021-06-22 10:41:02.000	135.55	1
OH Other	PLANNED OUTAGE	2021-06-22 21:42:33.000	160.20	3
PLF	PLANNED OUTAGE	2021-06-23 08:26:51.000	197.70	1
TX Repaired (PM)	PLANNED OUTAGE	2021-06-23 09:10:36.000	1,229.33	8
TX Repaired (OH)	PLANNED OUTAGE	2021-06-23 09:11:33.000	3,611.65	21
PLF	PLANNED OUTAGE	2021-06-23 09:18:59.000	321.42	7
UG Other	PLANNED OUTAGE	2021-06-23 09:56:02.000	960.15	9
UG Other	PLANNED OUTAGE	2021-06-23 10:05:59.000	32.08	7
PLF	PLANNED OUTAGE	2021-06-23 11:15:14.000	84.23	7
OH Other	PLANNED OUTAGE	2021-06-23 12:16:55.000	1,227.45	9
PLF	PLANNED OUTAGE	2021-06-23 12:21:29.000	916.13	8
UG Other	PLANNED OUTAGE	2021-06-23 15:11:53.000	24.85	3
PLF	PLANNED OUTAGE	2021-06-23 16:21:03.000	193.80	4
PLF	PLANNED OUTAGE	2021-06-24 01:02:26.000	1,968.63	14
Connections	PLANNED OUTAGE	2021-06-24 01:16:20.000	5,360.60	1,641
UG Other	PLANNED OUTAGE	2021-06-24 08:31:11.000	228.90	3
UG Other	PLANNED OUTAGE	2021-06-24 08:47:23.000	385.95	1
UG Other	PLANNED OUTAGE	2021-06-24 09:17:44.000	28.60	1
UG Other	PLANNED OUTAGE	2021-06-24 09:47:59.000	280.60	6
OH Other	PLANNED OUTAGE	2021-06-24 10:08:38.000	199.70	3
OH Other	PLANNED OUTAGE	2021-06-24 10:21:34.000	446.68	1
UG Other	PLANNED OUTAGE	2021-06-24 10:32:19.000	200.83	5
PLF	PLANNED OUTAGE	2021-06-24 18:54:15.000	25,830.90	19
Circuit Out	PLANNED OUTAGE	2021-06-24 21:07:29.000	23,315.50	1,105
Circuit Out	PLANNED OUTAGE	2021-06-25 01:09:06.000	10,116.67	1,214
TX Replaced (OH)	PLANNED OUTAGE	2021-06-25 06:56:38.000	2,529.67	10
PLF	PLANNED OUTAGE	2021-06-25 08:03:40.000	8,604.30	46
PLF	PLANNED OUTAGE	2021-06-25 08:25:43.000	401.30	3
UG Other	PLANNED OUTAGE	2021-06-25 08:54:13.000	302.83	5
PLF	PLANNED OUTAGE	2021-06-25 08:57:37.000	475.90	3
UG Other	PLANNED OUTAGE	2021-06-25 09:03:38.000	3,274.20	12
PLF	PLANNED OUTAGE	2021-06-25 09:49:41.000	7,199.40	26
Switchgear	PLANNED OUTAGE	2021-06-25 10:33:36.000	298.73	2
UG Other	PLANNED OUTAGE	2021-06-25 13:13:56.000	1,246.50	9
PLF	PLANNED OUTAGE	2021-06-25 13:38:37.000	377.65	7
OH Other	PLANNED OUTAGE	2021-06-25 14:12:40.000	1,637.67	20
OCR, Sec	PLANNED OUTAGE	2021-06-25 20:03:55.000	418.60	276
TX Repaired (OH)	PLANNED OUTAGE	2021-06-26 10:06:20.000	1,588.18	7
PLF	PLANNED OUTAGE	2021-06-26 14:01:31.000	377.73	4

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-06-26 15:35:37.000	1,192.87	29
PLF	PLANNED OUTAGE	2021-06-26 16:10:27.000	317.75	5
OH Other	PLANNED OUTAGE	2021-06-26 19:39:24.000	1,754.40	9
PLF	PLANNED OUTAGE	2021-06-26 20:14:32.000	501.00	5
UG Other	PLANNED OUTAGE	2021-06-27 04:39:36.000	113.87	8
PLF	PLANNED OUTAGE	2021-06-27 08:10:04.000	173.77	1
OH Other	PLANNED OUTAGE	2021-06-27 19:51:18.000	19.62	1
Switch 600 amp	PLANNED OUTAGE	2021-06-27 20:45:39.000	25,966.35	171
PLF	PLANNED OUTAGE	2021-06-27 20:51:45.000	4,696.67	40
Circuit Out	PLANNED OUTAGE	2021-06-27 21:12:41.000	5,363.60	1,518
UG Other	PLANNED OUTAGE	2021-06-27 22:00:15.000	1,781.50	7
UG Other	PLANNED OUTAGE	2021-06-28 01:39:13.000	31.32	1
PLF	PLANNED OUTAGE	2021-06-28 09:26:51.000	292.97	11
OH Other	PLANNED OUTAGE	2021-06-28 09:52:22.000	92.77	1
UG Other	PLANNED OUTAGE	2021-06-28 11:11:39.000	3,515.20	26
UG Other	PLANNED OUTAGE	2021-06-28 11:28:03.000	1,536.67	8
UG Other	PLANNED OUTAGE	2021-06-28 11:31:35.000	2,069.47	11
OH Other	PLANNED OUTAGE	2021-06-28 12:43:40.000	1,034.93	8
PLF	PLANNED OUTAGE	2021-06-29 00:12:28.000	492.03	1
Switch 600 amp	PLANNED OUTAGE	2021-06-29 01:03:10.000	29,423.40	171
OH Other	PLANNED OUTAGE	2021-06-29 07:42:49.000	9,271.85	21
OH Other	PLANNED OUTAGE	2021-06-29 08:48:59.000	107.73	2
UG Other	PLANNED OUTAGE	2021-06-29 08:55:53.000	668.90	2
PLF	PLANNED OUTAGE	2021-06-29 09:00:35.000	277.23	1
PLF	PLANNED OUTAGE	2021-06-29 09:00:40.000	276.07	1
PLF	PLANNED OUTAGE	2021-06-29 09:27:53.000	877.73	4
OH Other	PLANNED OUTAGE	2021-06-29 10:09:39.000	2,071.88	7
Switch 600 amp	PLANNED OUTAGE	2021-06-29 11:06:24.000	862.65	9
OH Other	PLANNED OUTAGE	2021-06-29 11:38:24.000	313.20	8
UG Other	PLANNED OUTAGE	2021-06-29 13:08:06.000	1,376.40	36
TX Repaired (PM)	PLANNED OUTAGE	2021-06-29 13:41:37.000	150.60	4
TX Repaired (PM)	PLANNED OUTAGE	2021-06-29 13:46:29.000	407.60	8
OH Other	PLANNED OUTAGE	2021-06-29 13:47:15.000	123.28	1
PLF	PLANNED OUTAGE	2021-06-29 16:35:30.000	1,304.33	43
OH Other	PLANNED OUTAGE	2021-06-29 17:34:29.000	1,827.93	7
UG Other	PLANNED OUTAGE	2021-06-29 18:51:11.000	823.55	3
Circuit Out	PLANNED OUTAGE	2021-06-29 19:03:12.000	3,392.13	988
OCR, Sec	PLANNED OUTAGE	2021-06-29 19:10:34.000	306.37	26
Circuit Out	PLANNED OUTAGE	2021-06-29 21:09:16.000	55,425.07	1,142
OH Other	PLANNED OUTAGE	2021-06-29 21:28:01.000	314.77	7
Primary Wire	PLANNED OUTAGE	2021-06-30 02:09:34.000	811.50	1
OH Other	PLANNED OUTAGE	2021-06-30 06:51:37.000	180.22	11
UG Other	PLANNED OUTAGE	2021-06-30 08:32:05.000	359.90	6
OH Other	PLANNED OUTAGE	2021-06-30 08:52:42.000	1,510.60	6
PLF	PLANNED OUTAGE	2021-06-30 08:56:43.000	123.22	1
TX Repaired (PM)	PLANNED OUTAGE	2021-06-30 09:39:35.000	256.10	1
OH Other	PLANNED OUTAGE	2021-06-30 09:43:59.000	2,190.65	11
UG Other	PLANNED OUTAGE	2021-06-30 10:14:35.000	406.87	4
UG Other	PLANNED OUTAGE	2021-06-30 10:14:46.000	404.53	4
TX Repaired (OH)	PLANNED OUTAGE	2021-06-30 10:15:53.000	4,968.00	9
UG Other	PLANNED OUTAGE	2021-06-30 10:37:54.000	220.27	2
PLF	PLANNED OUTAGE	2021-06-30 11:36:00.000	1,293.75	15
UG Other	PLANNED OUTAGE	2021-06-30 12:56:05.000	173.53	4
UG Other	PLANNED OUTAGE	2021-06-30 14:44:25.000	427.67	5
UG Other	PLANNED OUTAGE	2021-06-30 15:52:11.000	62.13	8
PLF	PLANNED OUTAGE	2021-06-30 16:06:55.000	889.90	3

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-06-30 16:28:27.000	179.25	3
PLF	PLANNED OUTAGE	2021-06-30 17:19:40.000	639.20	6
UG Other	PLANNED OUTAGE	2021-06-30 17:57:46.000	796.50	10
OH Other	PLANNED OUTAGE	2021-06-30 21:13:50.000	1,503.02	7
Circuit Out	PLANNED OUTAGE	2021-06-30 22:56:30.000	50,588.18	1,551
OCR, Sec	PLANNED OUTAGE	2021-06-30 23:25:01.000	1,268.53	268
OH Other	PLANNED OUTAGE	2021-06-30 23:40:26.000	4.27	1
Tap or Riser	PLANNED OUTAGE	2021-06-30 23:40:26.000	3.13	1
TX Repaired (OH)	PLANNED OUTAGE	2021-07-01 00:36:54.000	1,452.40	6
TX Repaired (OH)	PLANNED OUTAGE	2021-07-01 01:18:35.000	1,344.00	8
Circuit Out	PLANNED OUTAGE	2021-07-01 02:18:12.000	56,229.63	1,633
UG Other	PLANNED OUTAGE	2021-07-01 08:22:12.000	2,285.90	6
TX Repaired (OH)	PLANNED OUTAGE	2021-07-01 08:46:37.000	2,405.90	6
TX Repaired (PM)	PLANNED OUTAGE	2021-07-01 09:51:03.000	283.30	6
OH Other	PLANNED OUTAGE	2021-07-01 10:15:50.000	532.58	7
PLF	PLANNED OUTAGE	2021-07-01 11:18:32.000	2,836.67	50
TX Repaired (OH)	PLANNED OUTAGE	2021-07-01 11:46:49.000	1,132.00	5
TX Repaired (PM)	PLANNED OUTAGE	2021-07-01 12:38:32.000	479.62	7
PLF	PLANNED OUTAGE	2021-07-01 18:09:35.000	1,942.67	94
TX Repaired (OH)	PLANNED OUTAGE	2021-07-01 19:11:20.000	1,027.65	9
TX Repaired (OH)	PLANNED OUTAGE	2021-07-01 20:33:59.000	318.60	12
PLF	PLANNED OUTAGE	2021-07-01 21:42:39.000	3,132.13	26
TX Repaired (OH)	PLANNED OUTAGE	2021-07-01 22:29:49.000	1,199.10	18
TX Repaired (PM)	PLANNED OUTAGE	2021-07-01 22:50:02.000	537.53	2
TX Replaced (OH)	PLANNED OUTAGE	2021-07-01 23:25:28.000	1,346.53	8
TX Repaired (OH)	PLANNED OUTAGE	2021-07-02 00:36:45.000	379.40	2
TX Repaired (OH)	PLANNED OUTAGE	2021-07-02 00:37:36.000	189.80	1
OH Other	PLANNED OUTAGE	2021-07-02 00:47:34.000	343.27	4
UG Other	PLANNED OUTAGE	2021-07-02 01:06:59.000	5,544.83	19
UG Other	PLANNED OUTAGE	2021-07-02 07:41:50.000	1,127.70	6
UG Other	PLANNED OUTAGE	2021-07-02 08:52:56.000	905.80	12
UG Other	PLANNED OUTAGE	2021-07-02 10:35:11.000	5,508.40	12
UG Other	PLANNED OUTAGE	2021-07-02 13:23:17.000	2,050.42	25
PLF	PLANNED OUTAGE	2021-07-02 15:23:31.000	1,409.40	18
OCR, Sec	PLANNED OUTAGE	2021-07-02 17:44:43.000	2,148.55	291
OH Other	PLANNED OUTAGE	2021-07-02 18:04:00.000	454.67	8
Circuit Out	PLANNED OUTAGE	2021-07-03 01:45:42.000	7,249.00	1,318
PLF	PLANNED OUTAGE	2021-07-03 14:29:14.000	612.52	13
PLF	PLANNED OUTAGE	2021-07-03 16:42:42.000	183.70	1
PLF	PLANNED OUTAGE	2021-07-03 16:42:48.000	365.87	2
TX Repaired (OH)	PLANNED OUTAGE	2021-07-04 11:22:53.000	826.47	4
OH Other	PLANNED OUTAGE	2021-07-04 12:10:29.000	312.38	1
TX Repaired (OH)	PLANNED OUTAGE	2021-07-04 14:35:01.000	203.02	13
Oil Switch	PLANNED OUTAGE	2021-07-04 17:18:27.000	4,574.13	136
PLF	PLANNED OUTAGE	2021-07-04 18:55:25.000	456.75	7
Circuit Out	PLANNED OUTAGE	2021-07-04 20:53:13.000	791.38	461
PLF	PLANNED OUTAGE	2021-07-04 21:23:15.000	2,794.40	14
PLF	PLANNED OUTAGE	2021-07-04 23:37:39.000	134.55	3
PLF	PLANNED OUTAGE	2021-07-05 00:33:50.000	415.10	6
PLF	PLANNED OUTAGE	2021-07-05 16:34:29.000	1,893.88	13
Circuit Out	PLANNED OUTAGE	2021-07-05 17:14:30.000	1,005.33	928
PLF	PLANNED OUTAGE	2021-07-05 18:23:35.000	36.58	1
PLF	PLANNED OUTAGE	2021-07-05 22:29:05.000	3,846.50	15
PLF	PLANNED OUTAGE	2021-07-05 22:57:44.000	125.15	1
UG Other	PLANNED OUTAGE	2021-07-06 07:56:57.000	542.08	5
PLF	PLANNED OUTAGE	2021-07-06 09:19:30.000	2,366.00	26

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-07-06 10:12:40.000	938.75	5
UG Other	PLANNED OUTAGE	2021-07-06 11:21:41.000	1,021.00	6
UG Other	PLANNED OUTAGE	2021-07-06 12:13:49.000	940.93	8
TX Repaired (OH)	PLANNED OUTAGE	2021-07-08 01:00:42.000	176.53	4
Circuit Out	PLANNED OUTAGE	2021-07-08 05:09:52.000	4,876.17	1,721
TX Repaired (OH)	PLANNED OUTAGE	2021-07-08 08:30:23.000	403.80	3
TX Repaired (OH)	PLANNED OUTAGE	2021-07-08 10:02:00.000	5,453.03	17
TX Repaired (OH)	PLANNED OUTAGE	2021-07-08 10:32:40.000	987.33	10
OH Other	PLANNED OUTAGE	2021-07-08 10:51:45.000	218.68	1
OH Other	PLANNED OUTAGE	2021-07-08 11:06:01.000	379.17	5
TX Repaired (OH)	PLANNED OUTAGE	2021-07-08 11:07:31.000	1,610.77	22
OH Other	PLANNED OUTAGE	2021-07-08 12:51:12.000	460.15	3
PLF	PLANNED OUTAGE	2021-07-08 14:29:07.000	163.62	1
OH Other	PLANNED OUTAGE	2021-07-08 19:28:10.000	2,372.93	13
UG Other	PLANNED OUTAGE	2021-07-08 23:49:40.000	1,922.40	16
TX Repaired (OH)	PLANNED OUTAGE	2021-07-09 09:47:05.000	3,657.87	11
TX Repaired (PM)	PLANNED OUTAGE	2021-07-09 11:24:13.000	535.50	2
PLF	PLANNED OUTAGE	2021-07-09 14:39:13.000	938.47	7
PLF	PLANNED OUTAGE	2021-07-09 16:22:48.000	60.97	2
OCR, Sec	PLANNED OUTAGE	2021-07-09 19:50:01.000	908.50	395
PLF	PLANNED OUTAGE	2021-07-09 21:12:47.000	342.83	11
PLF	PLANNED OUTAGE	2021-07-10 00:32:48.000	138.13	16
PLF	PLANNED OUTAGE	2021-07-10 08:14:55.000	269.80	1
UG Other	PLANNED OUTAGE	2021-07-10 08:31:10.000	585.02	11
PLF	PLANNED OUTAGE	2021-07-10 09:13:36.000	383.90	2
Circuit Out	PLANNED OUTAGE	2021-07-10 16:08:20.000	81,207.07	1,607
OH Other	PLANNED OUTAGE	2021-07-10 22:41:03.000	15,607.13	94
Circuit Out	PLANNED OUTAGE	2021-07-10 23:36:54.000	2,283.13	1,489
PLF	PLANNED OUTAGE	2021-07-11 03:54:59.000	3,982.50	18
TX Repaired (OH)	PLANNED OUTAGE	2021-07-11 07:48:26.000	1,039.00	12
TX Repaired (PM)	PLANNED OUTAGE	2021-07-11 14:16:19.000	1,190.67	8
PLF	PLANNED OUTAGE	2021-07-12 02:48:19.000	77.03	1
UG Other	PLANNED OUTAGE	2021-07-12 08:35:06.000	233.60	2
UG Other	PLANNED OUTAGE	2021-07-12 08:41:07.000	670.70	6
PLF	PLANNED OUTAGE	2021-07-12 08:49:17.000	142.18	1
UG Other	PLANNED OUTAGE	2021-07-12 10:17:54.000	787.65	9
PLF	PLANNED OUTAGE	2021-07-12 12:04:48.000	340.30	6
PLF	PLANNED OUTAGE	2021-07-12 17:04:55.000	543.30	18
UG Other	PLANNED OUTAGE	2021-07-12 19:41:00.000	305.87	1
TX Repaired (OH)	PLANNED OUTAGE	2021-07-13 02:00:04.000	691.00	3
OH Other	PLANNED OUTAGE	2021-07-13 02:19:06.000	177.42	1
OH Other	PLANNED OUTAGE	2021-07-13 08:08:24.000	903.60	2
UG Other	PLANNED OUTAGE	2021-07-13 08:45:25.000	2,495.17	22
PLF	PLANNED OUTAGE	2021-07-13 08:51:20.000	12,358.50	33
OH Other	PLANNED OUTAGE	2021-07-13 11:48:08.000	2,088.00	9
TX Repaired (PM)	PLANNED OUTAGE	2021-07-13 12:47:11.000	1,401.67	10
TX Repaired (OH)	PLANNED OUTAGE	2021-07-13 12:50:51.000	170.33	1
UG Other	PLANNED OUTAGE	2021-07-13 14:35:37.000	1,441.00	6
UG Other	PLANNED OUTAGE	2021-07-13 17:30:45.000	7,863.50	30
PLF	PLANNED OUTAGE	2021-07-13 19:00:07.000	198.90	3
PLF	PLANNED OUTAGE	2021-07-13 23:17:17.000	17.37	1
PLF	PLANNED OUTAGE	2021-07-14 08:35:50.000	109.60	8
UG Other	PLANNED OUTAGE	2021-07-14 09:09:06.000	483.82	7
PLF	PLANNED OUTAGE	2021-07-14 09:50:12.000	1,060.58	5
UG Other	PLANNED OUTAGE	2021-07-14 10:00:34.000	5,369.75	47
OH Other	PLANNED OUTAGE	2021-07-14 10:58:56.000	1,043.25	5

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-07-14 11:43:49.000	258.47	4
UG Other	PLANNED OUTAGE	2021-07-14 13:51:12.000	1,380.40	4
OH Other	PLANNED OUTAGE	2021-07-14 17:02:42.000	3,728.60	12
PLF	PLANNED OUTAGE	2021-07-14 17:23:45.000	658.08	5
PLF	PLANNED OUTAGE	2021-07-14 20:48:42.000	357.88	1
OH Other	PLANNED OUTAGE	2021-07-14 23:43:34.000	498.33	20
UG Other	PLANNED OUTAGE	2021-07-15 08:59:19.000	1,244.20	3
OH Other	PLANNED OUTAGE	2021-07-15 09:02:32.000	390.55	1
UG Other	PLANNED OUTAGE	2021-07-15 09:05:58.000	865.93	4
OH Other	PLANNED OUTAGE	2021-07-15 09:10:59.000	286.90	2
OH Other	PLANNED OUTAGE	2021-07-15 09:58:03.000	84.53	1
OH Other	PLANNED OUTAGE	2021-07-15 10:01:18.000	164.77	2
UG Other	PLANNED OUTAGE	2021-07-15 10:33:59.000	979.33	8
OH Other	PLANNED OUTAGE	2021-07-15 10:38:20.000	466.00	8
TX Repaired (PM)	PLANNED OUTAGE	2021-07-15 10:45:46.000	257.67	4
URD Outage	PLANNED OUTAGE	2021-07-15 10:47:05.000	431.10	3
OH Other	PLANNED OUTAGE	2021-07-15 12:09:20.000	1,141.82	7
UG Other	PLANNED OUTAGE	2021-07-15 12:43:52.000	297.75	5
UG Other	PLANNED OUTAGE	2021-07-15 13:41:39.000	8,725.00	125
UG Other	PLANNED OUTAGE	2021-07-15 13:44:20.000	368.25	5
PLF	PLANNED OUTAGE	2021-07-15 17:37:03.000	1,459.55	3
PLF	PLANNED OUTAGE	2021-07-15 19:46:00.000	159.18	1
Circuit Out	PLANNED OUTAGE	2021-07-16 00:37:55.000	17.73	14
Circuit Out	PLANNED OUTAGE	2021-07-16 00:43:43.000	1.47	1
Circuit Out	PLANNED OUTAGE	2021-07-16 04:04:21.000	2.10	1
TX Repaired (OH)	PLANNED OUTAGE	2021-07-16 08:32:08.000	1,652.53	8
OH Other	PLANNED OUTAGE	2021-07-16 11:56:17.000	289.27	1
TX Repaired (OH)	PLANNED OUTAGE	2021-07-16 12:26:28.000	51.90	1
OH Other	PLANNED OUTAGE	2021-07-16 13:14:09.000	75.48	1
PLF	PLANNED OUTAGE	2021-07-16 13:39:53.000	2,561.07	32
OCR, Sec	PLANNED OUTAGE	2021-07-16 14:15:19.000	577.80	36
OH Other	PLANNED OUTAGE	2021-07-16 16:32:12.000	329.47	8
PLF	PLANNED OUTAGE	2021-07-16 16:48:40.000	243.73	1
PLF	PLANNED OUTAGE	2021-07-16 16:52:28.000	117.58	1
PLF	PLANNED OUTAGE	2021-07-16 19:52:12.000	239.60	3
UG Other	PLANNED OUTAGE	2021-07-16 22:19:53.000	6.03	1
OH Other	PLANNED OUTAGE	2021-07-17 07:37:19.000	173.90	2
PLF	PLANNED OUTAGE	2021-07-17 07:57:54.000	336.28	1
UG Other	PLANNED OUTAGE	2021-07-17 13:20:08.000	3,612.80	16
UG Other	PLANNED OUTAGE	2021-07-17 16:37:13.000	337.00	12
PLF	PLANNED OUTAGE	2021-07-17 23:03:49.000	45,089.23	127
UG Other	PLANNED OUTAGE	2021-07-17 23:03:49.000	12,181.42	106
UG Other	PLANNED OUTAGE	2021-07-18 04:54:20.000	185.18	41
UG Other	PLANNED OUTAGE	2021-07-18 04:54:36.000	276.25	65
OH Other	PLANNED OUTAGE	2021-07-18 08:06:14.000	612.53	2
Pole	PLANNED OUTAGE	2021-07-18 08:48:10.000	5,097.17	14
UG Other	PLANNED OUTAGE	2021-07-18 11:13:33.000	1,557.67	10
OCR, Sec	PLANNED OUTAGE	2021-07-18 13:26:12.000	1,394.33	470
OH Other	PLANNED OUTAGE	2021-07-18 13:33:49.000	1.63	1
OH Other	PLANNED OUTAGE	2021-07-18 13:34:14.000	1.43	1
Circuit Out	PLANNED OUTAGE	2021-07-18 20:44:00.000	60,582.20	327
Circuit Out	PLANNED OUTAGE	2021-07-18 23:18:30.000	27,138.80	884
OH Other	PLANNED OUTAGE	2021-07-19 08:40:47.000	713.40	4
OH Other	PLANNED OUTAGE	2021-07-19 09:04:12.000	1,485.33	5
UG Other	PLANNED OUTAGE	2021-07-19 10:37:13.000	631.95	9
UG Other	PLANNED OUTAGE	2021-07-19 13:42:04.000	1,330.08	11

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-07-19 14:53:01.000	896.27	2
OCR, Sec	PLANNED OUTAGE	2021-07-19 19:11:54.000	2,038.20	516
PLF	PLANNED OUTAGE	2021-07-20 05:11:21.000	85.77	1
PLF	PLANNED OUTAGE	2021-07-20 06:56:54.000	71.85	1
OH Other	PLANNED OUTAGE	2021-07-20 07:26:43.000	232.67	8
OH Other	PLANNED OUTAGE	2021-07-20 08:31:54.000	693.53	2
UG Other	PLANNED OUTAGE	2021-07-20 08:33:16.000	959.97	2
TX Repaired (PM)	PLANNED OUTAGE	2021-07-20 09:21:03.000	747.72	7
OH Other	PLANNED OUTAGE	2021-07-20 09:37:35.000	1,716.00	5
UG Other	PLANNED OUTAGE	2021-07-20 09:50:51.000	695.73	8
PLF	PLANNED OUTAGE	2021-07-20 09:59:42.000	337.50	6
UG Other	PLANNED OUTAGE	2021-07-20 10:03:42.000	181.83	10
OH Other	PLANNED OUTAGE	2021-07-20 10:03:57.000	517.67	2
OH Other	PLANNED OUTAGE	2021-07-20 10:09:20.000	507.93	2
UG Other	PLANNED OUTAGE	2021-07-20 10:10:45.000	858.20	6
UG Other	PLANNED OUTAGE	2021-07-20 10:11:01.000	1,080.40	6
UG Other	PLANNED OUTAGE	2021-07-20 11:08:30.000	451.42	5
UG Other	PLANNED OUTAGE	2021-07-20 12:19:48.000	370.27	4
UG Other	PLANNED OUTAGE	2021-07-20 12:38:24.000	567.93	7
TX Replaced (OH)	PLANNED OUTAGE	2021-07-20 13:07:36.000	3,338.00	10
UG Other	PLANNED OUTAGE	2021-07-20 13:07:36.000	3,003.75	9
UG Other	PLANNED OUTAGE	2021-07-20 13:55:16.000	188.85	3
TX Repaired (OH)	PLANNED OUTAGE	2021-07-20 13:58:32.000	849.95	3
UG Other	PLANNED OUTAGE	2021-07-20 13:59:57.000	415.57	7
TX Replaced (PM)	PLANNED OUTAGE	2021-07-20 16:11:02.000	1,097.70	9
OH Other	PLANNED OUTAGE	2021-07-20 18:30:37.000	10.72	1
UG Other	PLANNED OUTAGE	2021-07-20 18:30:41.000	11.22	1
OH Other	PLANNED OUTAGE	2021-07-20 18:31:26.000	20.35	2
UG Other	PLANNED OUTAGE	2021-07-20 18:34:12.000	7.67	1
UG Other	PLANNED OUTAGE	2021-07-20 18:34:14.000	14.80	2
Circuit Out	PLANNED OUTAGE	2021-07-20 20:40:34.000	4,170.67	1,472
OH Other	PLANNED OUTAGE	2021-07-20 21:46:45.000	1,127.70	1
OH Other	PLANNED OUTAGE	2021-07-21 07:40:06.000	4,234.50	10
UG Other	PLANNED OUTAGE	2021-07-21 08:50:16.000	756.00	6
UG Other	PLANNED OUTAGE	2021-07-21 09:01:55.000	3,772.77	37
UG Other	PLANNED OUTAGE	2021-07-21 09:28:46.000	1,232.13	8
PLF	PLANNED OUTAGE	2021-07-21 09:40:38.000	1,202.83	7
UG Other	PLANNED OUTAGE	2021-07-21 10:31:16.000	445.73	4
PLF	PLANNED OUTAGE	2021-07-21 10:39:36.000	122.20	3
PLF	PLANNED OUTAGE	2021-07-21 10:59:18.000	1,699.82	1
UG Other	PLANNED OUTAGE	2021-07-21 12:03:11.000	494.20	7
UG Other	PLANNED OUTAGE	2021-07-21 12:35:10.000	1,434.13	16
UG Other	PLANNED OUTAGE	2021-07-21 13:16:46.000	864.42	11
UG Other	PLANNED OUTAGE	2021-07-21 13:19:34.000	64.08	1
UG Other	PLANNED OUTAGE	2021-07-21 13:29:40.000	210.20	4
UG Other	PLANNED OUTAGE	2021-07-21 14:22:25.000	582.00	12
UG Other	PLANNED OUTAGE	2021-07-21 14:25:48.000	779.57	7
UG Other	PLANNED OUTAGE	2021-07-21 14:27:36.000	769.65	7
OH Other	PLANNED OUTAGE	2021-07-21 15:49:09.000	122.93	2
UG Other	PLANNED OUTAGE	2021-07-22 08:20:35.000	429.13	1
UG Other	PLANNED OUTAGE	2021-07-22 08:34:37.000	512.52	7
UG Other	PLANNED OUTAGE	2021-07-22 08:50:01.000	755.80	12
TX Repaired (OH)	PLANNED OUTAGE	2021-07-22 08:56:52.000	615.30	7
OH Other	PLANNED OUTAGE	2021-07-22 09:00:50.000	3,593.00	10
UG Other	PLANNED OUTAGE	2021-07-22 09:07:38.000	299.37	7
PLF	PLANNED OUTAGE	2021-07-22 09:58:16.000	1,544.75	5

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-07-22 10:01:20.000	1,094.72	19
PLF	PLANNED OUTAGE	2021-07-22 10:05:33.000	295.42	1
PLF	PLANNED OUTAGE	2021-07-22 10:07:11.000	588.50	2
OH Other	PLANNED OUTAGE	2021-07-22 10:13:08.000	1,908.50	6
UG Other	PLANNED OUTAGE	2021-07-22 10:23:32.000	80.52	1
UG Other	PLANNED OUTAGE	2021-07-22 10:41:15.000	7,018.80	24
OH Other	PLANNED OUTAGE	2021-07-22 11:23:53.000	268.75	5
PLF	PLANNED OUTAGE	2021-07-22 12:01:00.000	8.55	1
PLF	PLANNED OUTAGE	2021-07-22 12:14:13.000	5.57	1
UG Other	PLANNED OUTAGE	2021-07-22 12:28:19.000	84.95	3
UG Other	PLANNED OUTAGE	2021-07-22 13:18:24.000	208.13	4
UG Other	PLANNED OUTAGE	2021-07-22 13:28:03.000	3,888.95	31
UG Other	PLANNED OUTAGE	2021-07-22 14:19:46.000	369.73	4
UG Other	PLANNED OUTAGE	2021-07-22 16:14:29.000	1,898.75	15
UG Other	PLANNED OUTAGE	2021-07-22 16:27:40.000	1,482.67	8
PLF	PLANNED OUTAGE	2021-07-22 18:26:46.000	932.35	29
PLF	PLANNED OUTAGE	2021-07-22 19:27:37.000	4,973.27	28
PLF	PLANNED OUTAGE	2021-07-23 07:44:11.000	272.52	1
UG Other	PLANNED OUTAGE	2021-07-23 09:07:41.000	313.48	7
OH Other	PLANNED OUTAGE	2021-07-23 09:10:38.000	1,158.00	9
PLF	PLANNED OUTAGE	2021-07-23 09:44:26.000	115.92	1
UG Other	PLANNED OUTAGE	2021-07-23 10:42:48.000	2,573.70	23
UG Other	PLANNED OUTAGE	2021-07-23 11:01:04.000	1,128.15	23
UG Other	PLANNED OUTAGE	2021-07-23 12:37:25.000	2,035.60	21
UG Other	PLANNED OUTAGE	2021-07-23 14:12:59.000	64.17	1
UG Other	PLANNED OUTAGE	2021-07-23 23:53:23.000	433.42	5
Circuit Out	PLANNED OUTAGE	2021-07-25 00:40:33.000	1,580.45	433
UG Other	PLANNED OUTAGE	2021-07-25 17:34:42.000	4,747.35	9
PLF	PLANNED OUTAGE	2021-07-25 18:43:35.000	395.98	1
OH Other	PLANNED OUTAGE	2021-07-26 07:07:35.000	1,441.05	3
UG Other	PLANNED OUTAGE	2021-07-26 08:18:56.000	608.43	1
PLF	PLANNED OUTAGE	2021-07-26 09:00:39.000	116.25	1
OH Other	PLANNED OUTAGE	2021-07-26 09:57:38.000	941.05	3
UG Other	PLANNED OUTAGE	2021-07-26 10:19:43.000	452.75	5
OH Other	PLANNED OUTAGE	2021-07-26 10:20:51.000	293.17	2
PLF	PLANNED OUTAGE	2021-07-26 11:31:35.000	364.13	4
PLF	PLANNED OUTAGE	2021-07-26 12:11:52.000	656.27	8
UG Other	PLANNED OUTAGE	2021-07-26 15:10:11.000	535.90	6
UG Other	PLANNED OUTAGE	2021-07-26 22:00:41.000	2,193.60	6
UG Other	PLANNED OUTAGE	2021-07-26 22:00:58.000	563.33	2
UG Other	PLANNED OUTAGE	2021-07-26 22:02:47.000	280.43	1
PLF	PLANNED OUTAGE	2021-07-26 23:38:02.000	263.20	1
UG Other	PLANNED OUTAGE	2021-07-27 00:30:57.000	6,539.50	87
Circuit Out	PLANNED OUTAGE	2021-07-27 01:40:29.000	2,195.70	1,126
UG Other	PLANNED OUTAGE	2021-07-27 08:54:31.000	950.25	9
OH Other	PLANNED OUTAGE	2021-07-27 09:01:55.000	1,756.60	12
PLF	PLANNED OUTAGE	2021-07-27 09:05:12.000	246.57	2
UG Other	PLANNED OUTAGE	2021-07-27 09:11:11.000	8,816.00	95
TX Repaired (PM)	PLANNED OUTAGE	2021-07-27 09:29:29.000	33.43	1
OH Other	PLANNED OUTAGE	2021-07-27 10:32:20.000	1,293.67	5
TX Repaired (OH)	PLANNED OUTAGE	2021-07-27 10:57:46.000	999.50	6
TX Repaired (PM)	PLANNED OUTAGE	2021-07-27 11:09:36.000	155.80	2
TX Replaced (PM)	PLANNED OUTAGE	2021-07-27 11:28:17.000	383.87	8
TX Replaced (PM)	PLANNED OUTAGE	2021-07-27 11:34:01.000	256.27	8
UG Other	PLANNED OUTAGE	2021-07-27 11:39:23.000	2,770.30	78
OH Other	PLANNED OUTAGE	2021-07-27 12:03:48.000	163.17	5

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2021-07-27 12:17:31.000	862.60	6
PLF	PLANNED OUTAGE	2021-07-27 13:55:14.000	344.25	5
UG Other	PLANNED OUTAGE	2021-07-27 14:37:52.000	326.80	6
UG Other	PLANNED OUTAGE	2021-07-27 15:10:12.000	114.10	3
UG Other	PLANNED OUTAGE	2021-07-27 16:01:17.000	449.25	9
UG Other	PLANNED OUTAGE	2021-07-27 16:06:21.000	560.30	6
TX Repaired (OH)	PLANNED OUTAGE	2021-07-27 22:17:10.000	104.70	3
UG Other	PLANNED OUTAGE	2021-07-28 08:41:44.000	908.25	7
UG Other	PLANNED OUTAGE	2021-07-28 08:46:04.000	1,789.00	5
OH Other	PLANNED OUTAGE	2021-07-28 08:52:12.000	533.07	4
TX Repaired (PM)	PLANNED OUTAGE	2021-07-28 08:53:23.000	46.12	1
TX Replaced (PM)	PLANNED OUTAGE	2021-07-28 09:34:22.000	18,555.00	50
UG Other	PLANNED OUTAGE	2021-07-28 09:36:57.000	475.47	8
UG Other	PLANNED OUTAGE	2021-07-28 09:37:18.000	235.67	4
UG Other	PLANNED OUTAGE	2021-07-28 09:44:34.000	777.90	6
UG Other	PLANNED OUTAGE	2021-07-28 10:21:29.000	234.50	10
UG Other	PLANNED OUTAGE	2021-07-28 11:15:51.000	622.93	8
TX Replaced (PM)	PLANNED OUTAGE	2021-07-28 11:30:28.000	2,121.35	11
PLF	PLANNED OUTAGE	2021-07-28 11:44:35.000	940.10	119
UG Other	PLANNED OUTAGE	2021-07-28 13:35:03.000	646.05	9
OH Other	PLANNED OUTAGE	2021-07-28 14:22:21.000	332.40	9
PLF	PLANNED OUTAGE	2021-07-28 15:06:27.000	1,348.75	13
TX Repaired (OH)	PLANNED OUTAGE	2021-07-28 15:40:35.000	326.75	3
PLF	PLANNED OUTAGE	2021-07-28 21:18:39.000	435.57	2
PLF	PLANNED OUTAGE	2021-07-29 01:32:15.000	1,655.20	6
UG Other	PLANNED OUTAGE	2021-07-29 06:56:01.000	1,029.17	25
TX Repaired (PM)	PLANNED OUTAGE	2021-07-29 08:22:14.000	597.10	6
PLF	PLANNED OUTAGE	2021-07-29 08:34:16.000	788.30	3
UG Other	PLANNED OUTAGE	2021-07-29 08:43:58.000	1,561.45	33
UG Other	PLANNED OUTAGE	2021-07-29 08:56:49.000	742.35	7
Switch 600 amp	PLANNED OUTAGE	2021-07-29 09:49:57.000	3,630.75	705
OH Other	PLANNED OUTAGE	2021-07-29 09:50:50.000	506.13	4
TX Repaired (PM)	PLANNED OUTAGE	2021-07-29 09:55:23.000	1,105.10	6
UG Other	PLANNED OUTAGE	2021-07-29 10:04:58.000	356.33	5
PLF	PLANNED OUTAGE	2021-07-29 10:10:14.000	265.27	1
UG Other	PLANNED OUTAGE	2021-07-29 10:25:54.000	597.40	12
UG Other	PLANNED OUTAGE	2021-07-29 13:04:14.000	426.07	7
PLF	PLANNED OUTAGE	2021-07-30 09:19:43.000	45,384.00	120
TX Repaired (PM)	PLANNED OUTAGE	2021-07-30 12:31:58.000	7,084.27	14
TX Repaired (OH)	PLANNED OUTAGE	2021-07-30 13:09:58.000	1,484.33	10
TX Repaired (PM)	PLANNED OUTAGE	2021-07-30 13:15:11.000	1,047.93	11
Circuit Out	PLANNED OUTAGE	2021-07-30 14:39:53.000	175,341.72	1,285
Circuit Out	PLANNED OUTAGE	2021-07-30 16:43:14.000	1,666.00	840
TX Repaired (PM)	PLANNED OUTAGE	2021-07-30 21:13:20.000	1,122.00	10
PLF	PLANNED OUTAGE	2021-07-30 23:31:23.000	2,985.53	38
OH Other	PLANNED OUTAGE	2021-07-31 20:37:30.000	425.15	3
Circuit Out	PLANNED OUTAGE	2021-08-01 08:55:04.000	28,918.32	1,943
UG Other	PLANNED OUTAGE	2021-08-01 14:52:20.000	3,071.50	10
Circuit Out	PLANNED OUTAGE	2021-08-01 18:05:12.000	34,173.78	1,357
TX Replaced (OH)	PLANNED OUTAGE	2021-08-02 09:06:53.000	1,856.75	5
UG Other	PLANNED OUTAGE	2021-08-02 09:11:36.000	1,220.25	5
UG Other	PLANNED OUTAGE	2021-08-02 09:45:07.000	295.85	3
UG Other	PLANNED OUTAGE	2021-08-02 10:25:04.000	1,205.75	7
OH Other	PLANNED OUTAGE	2021-08-02 11:28:21.000	110.87	2
UG Other	PLANNED OUTAGE	2021-08-02 11:29:59.000	170.67	4
UG Other	PLANNED OUTAGE	2021-08-02 12:22:30.000	230.50	10

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OCR, Sec	PLANNED OUTAGE	2021-08-02 12:54:18.000	2,301.60	168
Primary Wire	PLANNED OUTAGE	2021-08-02 13:15:55.000	31,861.67	700
UG Other	PLANNED OUTAGE	2021-08-02 13:18:01.000	454.30	7
OH Other	PLANNED OUTAGE	2021-08-02 13:43:30.000	1,551.25	5
UG Other	PLANNED OUTAGE	2021-08-02 13:50:48.000	2,047.10	22
UG Other	PLANNED OUTAGE	2021-08-02 14:23:13.000	1,126.00	15
Circuit Out	PLANNED OUTAGE	2021-08-02 15:00:05.000	107,610.00	1,888
UG Other	PLANNED OUTAGE	2021-08-02 15:07:02.000	6,373.80	4
OH Other	PLANNED OUTAGE	2021-08-02 18:43:30.000	66.10	6
OCR, Sec	PLANNED OUTAGE	2021-08-02 21:37:29.000	1,002.53	206
Circuit Out	PLANNED OUTAGE	2021-08-03 00:25:24.000	500,622.30	2,214
UG Other	PLANNED OUTAGE	2021-08-03 10:28:02.000	512.25	9
PLF	PLANNED OUTAGE	2021-08-03 10:46:35.000	4,279.92	115
UG Other	PLANNED OUTAGE	2021-08-03 12:02:16.000	8,202.13	104
OH Other	PLANNED OUTAGE	2021-08-03 13:35:34.000	134.07	4
OH Other	PLANNED OUTAGE	2021-08-03 14:04:27.000	1,215.13	11
UG Other	PLANNED OUTAGE	2021-08-03 15:54:05.000	1,096.55	7
Circuit Out	PLANNED OUTAGE	2021-08-04 06:33:27.000	13,620.83	467
TX Repaired (PM)	PLANNED OUTAGE	2021-08-04 08:46:59.000	1,413.00	12
UG Other	PLANNED OUTAGE	2021-08-04 09:49:44.000	798.42	11
UG Other	PLANNED OUTAGE	2021-08-04 10:05:54.000	529.25	3
UG Other	PLANNED OUTAGE	2021-08-04 10:08:20.000	720.30	7
UG Other	PLANNED OUTAGE	2021-08-04 10:09:29.000	613.00	6
UG Other	PLANNED OUTAGE	2021-08-04 10:12:36.000	473.67	5
UG Other	PLANNED OUTAGE	2021-08-04 10:52:48.000	1,190.93	8
UG Other	PLANNED OUTAGE	2021-08-04 11:13:21.000	251.08	5
PLF	PLANNED OUTAGE	2021-08-04 11:14:45.000	102.65	1
TX Repaired (PM)	PLANNED OUTAGE	2021-08-04 13:16:02.000	670.20	12
UG Other	PLANNED OUTAGE	2021-08-04 13:46:37.000	458.33	10
UG Other	PLANNED OUTAGE	2021-08-04 17:03:43.000	91.43	1
Circuit Out	PLANNED OUTAGE	2021-08-04 17:29:52.000	2,817.53	1,233
Circuit Out	PLANNED OUTAGE	2021-08-04 20:50:12.000	2,960.28	761
Circuit Out	PLANNED OUTAGE	2021-08-04 20:56:22.000	2.65	1
OH Other	PLANNED OUTAGE	2021-08-04 20:56:39.000	2.53	1
OH Other	PLANNED OUTAGE	2021-08-05 07:00:19.000	1,978.00	4
OH Other	PLANNED OUTAGE	2021-08-05 08:32:06.000	855.70	6
TX Repaired (PM)	PLANNED OUTAGE	2021-08-05 09:07:19.000	328.03	2
TX Replaced (OH)	PLANNED OUTAGE	2021-08-05 09:17:07.000	1,488.40	4
OH Other	PLANNED OUTAGE	2021-08-05 09:35:39.000	755.10	6
UG Other	PLANNED OUTAGE	2021-08-05 09:37:25.000	2,419.78	7
TX Replaced (PM)	PLANNED OUTAGE	2021-08-05 09:40:43.000	1,445.73	4
PLF	PLANNED OUTAGE	2021-08-05 09:50:33.000	82.25	5
UG Other	PLANNED OUTAGE	2021-08-05 10:51:56.000	4,156.27	32
TX Repaired (OH)	PLANNED OUTAGE	2021-08-05 11:11:18.000	486.73	4
TX Replaced (OH)	PLANNED OUTAGE	2021-08-05 11:53:13.000	196.48	1
UG Other	PLANNED OUTAGE	2021-08-05 12:30:23.000	465.80	4
UG Other	PLANNED OUTAGE	2021-08-05 12:54:16.000	791.25	9
OCR, Sec	PLANNED OUTAGE	2021-08-05 16:24:54.000	1,225.17	10
TX Repaired (OH)	PLANNED OUTAGE	2021-08-05 17:08:13.000	385.85	3
OH Other	PLANNED OUTAGE	2021-08-06 08:24:45.000	7,066.15	13
OH Other	PLANNED OUTAGE	2021-08-06 08:35:51.000	1,969.00	6
UG Other	PLANNED OUTAGE	2021-08-06 08:45:41.000	590.55	9
UG Other	PLANNED OUTAGE	2021-08-06 09:01:29.000	304.15	7
OH Other	PLANNED OUTAGE	2021-08-06 09:26:12.000	93.50	3
UG Other	PLANNED OUTAGE	2021-08-06 09:52:33.000	300.75	9
OH Other	PLANNED OUTAGE	2021-08-06 10:09:07.000	3,988.75	25

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-08-06 10:25:53.000	298.25	3
OCR, Sec	PLANNED OUTAGE	2021-08-06 14:02:56.000	4,724.23	239
UG Other	PLANNED OUTAGE	2021-08-06 14:14:36.000	173.45	3
TX Repaired (OH)	PLANNED OUTAGE	2021-08-07 13:41:31.000	72.73	1
PLF	PLANNED OUTAGE	2021-08-07 14:59:10.000	948.47	41
UG Other	PLANNED OUTAGE	2021-08-09 08:47:39.000	841.60	8
UG Other	PLANNED OUTAGE	2021-08-09 09:02:05.000	1,688.85	9
UG Other	PLANNED OUTAGE	2021-08-09 09:14:40.000	3,614.70	18
OH Other	PLANNED OUTAGE	2021-08-09 10:21:07.000	805.70	6
OH Other	PLANNED OUTAGE	2021-08-09 10:25:27.000	1,085.80	4
UG Other	PLANNED OUTAGE	2021-08-09 10:27:54.000	159.65	3
UG Other	PLANNED OUTAGE	2021-08-09 10:35:39.000	755.87	8
TX Replaced (OH)	PLANNED OUTAGE	2021-08-09 10:40:43.000	661.17	2
OH Other	PLANNED OUTAGE	2021-08-09 10:41:05.000	1,986.70	6
OH Other	PLANNED OUTAGE	2021-08-09 10:55:17.000	962.38	7
UG Other	PLANNED OUTAGE	2021-08-09 11:00:44.000	6,427.33	62
TX Replaced (OH)	PLANNED OUTAGE	2021-08-09 11:06:20.000	2,463.65	7
UG Other	PLANNED OUTAGE	2021-08-09 11:10:38.000	509.73	8
UG Other	PLANNED OUTAGE	2021-08-09 11:56:46.000	601.50	9
UG Other	PLANNED OUTAGE	2021-08-09 12:03:49.000	480.67	5
OH Other	PLANNED OUTAGE	2021-08-09 12:14:07.000	118.72	1
PLF	PLANNED OUTAGE	2021-08-09 12:47:28.000	90.05	3
OH Other	PLANNED OUTAGE	2021-08-09 13:31:45.000	87.93	1
UG Other	PLANNED OUTAGE	2021-08-09 13:59:25.000	597.55	37
Circuit Out	PLANNED OUTAGE	2021-08-09 15:33:31.000	3,685.63	1,099
OH Other	PLANNED OUTAGE	2021-08-09 19:06:18.000	582.15	9
Circuit Out	PLANNED OUTAGE	2021-08-09 21:51:55.000	1,150.92	600
OH Other	PLANNED OUTAGE	2021-08-09 22:07:18.000	64.02	1
TX Replaced (OH)	PLANNED OUTAGE	2021-08-10 08:36:26.000	5,697.50	15
UG Other	PLANNED OUTAGE	2021-08-10 08:44:56.000	12,526.87	41
UG Other	PLANNED OUTAGE	2021-08-10 08:58:43.000	166.13	1
TX Replaced (OH)	PLANNED OUTAGE	2021-08-10 09:07:51.000	1,981.50	6
TX Replaced (PM)	PLANNED OUTAGE	2021-08-10 09:08:58.000	4,920.00	25
UG Other	PLANNED OUTAGE	2021-08-10 09:20:33.000	1,332.72	13
UG Other	PLANNED OUTAGE	2021-08-10 09:20:42.000	1,019.17	10
UG Other	PLANNED OUTAGE	2021-08-10 09:36:56.000	1,276.13	17
UG Other	PLANNED OUTAGE	2021-08-10 09:58:22.000	174.65	1
UG Other	PLANNED OUTAGE	2021-08-10 10:00:32.000	435.73	8
TX Replaced (OH)	PLANNED OUTAGE	2021-08-10 10:15:34.000	534.25	1
OH Other	PLANNED OUTAGE	2021-08-10 10:17:29.000	449.75	1
UG Other	PLANNED OUTAGE	2021-08-10 10:43:47.000	3,751.80	37
OH Other	PLANNED OUTAGE	2021-08-10 10:45:46.000	3,161.60	13
UG Other	PLANNED OUTAGE	2021-08-10 10:55:46.000	1,132.80	6
UG Other	PLANNED OUTAGE	2021-08-10 10:58:45.000	721.33	10
UG Other	PLANNED OUTAGE	2021-08-10 11:09:18.000	275.60	6
OH Other	PLANNED OUTAGE	2021-08-10 11:12:20.000	276.33	5
UG Other	PLANNED OUTAGE	2021-08-10 12:28:41.000	131.33	8
PLF	PLANNED OUTAGE	2021-08-10 13:26:38.000	127.77	2
UG Other	PLANNED OUTAGE	2021-08-10 14:04:57.000	312.00	8
OH Other	PLANNED OUTAGE	2021-08-10 15:24:57.000	44.75	1
Circuit Out	PLANNED OUTAGE	2021-08-10 17:16:11.000	11,274.53	2,141
OH Other	PLANNED OUTAGE	2021-08-10 18:29:36.000	986.88	11
PLF	PLANNED OUTAGE	2021-08-10 18:40:12.000	1,895.63	43
UG Other	PLANNED OUTAGE	2021-08-11 08:18:11.000	703.97	7
UG Other	PLANNED OUTAGE	2021-08-11 08:51:12.000	214.70	1
UG Other	PLANNED OUTAGE	2021-08-11 08:53:47.000	4,805.73	38

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-08-11 09:20:14.000	467.40	9
UG Other	PLANNED OUTAGE	2021-08-11 09:24:46.000	4,193.75	25
UG Other	PLANNED OUTAGE	2021-08-11 10:05:17.000	345.07	4
OH Other	PLANNED OUTAGE	2021-08-11 10:13:03.000	287.25	9
UG Other	PLANNED OUTAGE	2021-08-11 11:15:18.000	639.50	6
PLF	PLANNED OUTAGE	2021-08-11 11:41:47.000	680.83	19
UG Other	PLANNED OUTAGE	2021-08-11 12:41:52.000	2,618.75	25
UG Other	PLANNED OUTAGE	2021-08-11 12:43:00.000	2,595.00	25
UG Other	PLANNED OUTAGE	2021-08-11 13:23:07.000	341.95	7
UG Other	PLANNED OUTAGE	2021-08-11 13:29:36.000	57.80	1
UG Other	PLANNED OUTAGE	2021-08-11 13:37:43.000	565.03	22
OH Other	PLANNED OUTAGE	2021-08-11 17:33:37.000	76,495.65	179
UG Other	PLANNED OUTAGE	2021-08-11 17:33:37.000	427.35	1
Circuit Out	PLANNED OUTAGE	2021-08-11 18:37:33.000	931.17	2
PLF	PLANNED OUTAGE	2021-08-11 18:37:33.000	15,361.77	34
Circuit Out	PLANNED OUTAGE	2021-08-11 18:37:47.000	45,348.60	778
TX Repaired (OH)	PLANNED OUTAGE	2021-08-11 19:46:58.000	375.33	10
OH Other	PLANNED OUTAGE	2021-08-11 20:58:09.000	1,344.38	11
Circuit Out	PLANNED OUTAGE	2021-08-11 22:06:58.000	21,125.00	650
OH Other	PLANNED OUTAGE	2021-08-12 06:07:10.000	2,899.05	7
PLF	PLANNED OUTAGE	2021-08-12 07:20:26.000	1,102.22	41
UG Other	PLANNED OUTAGE	2021-08-12 08:48:28.000	112.73	4
UG Other	PLANNED OUTAGE	2021-08-12 08:48:49.000	886.00	15
UG Other	PLANNED OUTAGE	2021-08-12 08:51:03.000	1,280.70	9
UG Other	PLANNED OUTAGE	2021-08-12 08:59:29.000	515.00	6
UG Other	PLANNED OUTAGE	2021-08-12 09:39:35.000	2,029.87	32
PLF	PLANNED OUTAGE	2021-08-12 09:42:23.000	9,163.33	25
UG Other	PLANNED OUTAGE	2021-08-12 10:17:16.000	1,300.95	7
TX Repaired (OH)	PLANNED OUTAGE	2021-08-12 10:40:56.000	836.00	6
UG Other	PLANNED OUTAGE	2021-08-12 10:46:22.000	225.50	6
Primary Wire	PLANNED OUTAGE	2021-08-12 11:20:05.000	2,330.35	19
UG Other	PLANNED OUTAGE	2021-08-12 11:22:10.000	28.93	1
UG Other	PLANNED OUTAGE	2021-08-12 12:17:48.000	734.30	7
UG Other	PLANNED OUTAGE	2021-08-12 13:07:28.000	318.73	7
OCR, Sec	PLANNED OUTAGE	2021-08-12 16:28:43.000	1,087.57	826
Circuit Out	PLANNED OUTAGE	2021-08-12 19:10:09.000	2,580.15	927
PLF	PLANNED OUTAGE	2021-08-12 19:35:35.000	1,325.42	5
PLF	PLANNED OUTAGE	2021-08-12 22:46:22.000	2,682.92	47
PLF	PLANNED OUTAGE	2021-08-13 02:17:14.000	36.02	1
UG Other	PLANNED OUTAGE	2021-08-13 08:22:11.000	753.87	8
TX Replaced (PM)	PLANNED OUTAGE	2021-08-13 09:07:07.000	4,365.18	13
UG Other	PLANNED OUTAGE	2021-08-13 09:57:18.000	951.20	8
OH Other	PLANNED OUTAGE	2021-08-13 14:53:47.000	418.70	2
OH Other	PLANNED OUTAGE	2021-08-13 19:25:43.000	297.97	2
PLF	PLANNED OUTAGE	2021-08-14 08:44:58.000	183.08	1
TX Repaired (PM)	PLANNED OUTAGE	2021-08-14 20:01:32.000	395.63	11
OCR, Sec	PLANNED OUTAGE	2021-08-15 15:36:46.000	3,570.12	71
OH Other	PLANNED OUTAGE	2021-08-16 09:22:32.000	257.05	3
OH Other	PLANNED OUTAGE	2021-08-16 09:56:49.000	1,919.00	6
UG Other	PLANNED OUTAGE	2021-08-16 10:10:48.000	507.50	7
UG Other	PLANNED OUTAGE	2021-08-16 11:26:28.000	3,212.77	7
PLF	PLANNED OUTAGE	2021-08-16 11:29:27.000	334.60	21
PLF	PLANNED OUTAGE	2021-08-16 13:56:45.000	466.40	11
UG Other	PLANNED OUTAGE	2021-08-16 20:28:39.000	149.25	9
OH Other	PLANNED OUTAGE	2021-08-16 21:10:50.000	137.70	9
OCR, Sec	PLANNED OUTAGE	2021-08-16 23:22:00.000	17,890.98	759

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Primary Wire	PLANNED OUTAGE	2021-08-16 23:22:00.000	74.70	2
UG Other	PLANNED OUTAGE	2021-08-17 00:47:32.000	334.25	7
UG Other	PLANNED OUTAGE	2021-08-17 04:01:17.000	137.45	1
UG Other	PLANNED OUTAGE	2021-08-17 04:01:37.000	274.57	2
TX Replaced (PM)	PLANNED OUTAGE	2021-08-17 09:05:48.000	271.33	5
UG Other	PLANNED OUTAGE	2021-08-17 09:07:20.000	771.50	15
OH Other	PLANNED OUTAGE	2021-08-17 09:17:59.000	732.60	3
UG Other	PLANNED OUTAGE	2021-08-17 09:20:57.000	146.20	4
TX Replaced (PM)	PLANNED OUTAGE	2021-08-17 09:29:43.000	655.00	10
TX Replaced (PM)	PLANNED OUTAGE	2021-08-17 09:51:47.000	88.20	1
TX Replaced (PM)	PLANNED OUTAGE	2021-08-17 09:57:20.000	1,699.60	24
TX Replaced (PM)	PLANNED OUTAGE	2021-08-17 10:00:48.000	1,012.65	9
TX Replaced (PM)	PLANNED OUTAGE	2021-08-17 11:25:12.000	197.50	6
OH Other	PLANNED OUTAGE	2021-08-17 13:51:14.000	393.30	38
PLF	PLANNED OUTAGE	2021-08-18 08:16:46.000	268.80	24
TX Repaired (OH)	PLANNED OUTAGE	2021-08-18 08:40:02.000	106.10	6
UG Other	PLANNED OUTAGE	2021-08-18 08:42:24.000	653.58	11
UG Other	PLANNED OUTAGE	2021-08-18 09:18:01.000	730.67	10
UG Other	PLANNED OUTAGE	2021-08-18 09:22:54.000	302.35	1
TX Repaired (OH)	PLANNED OUTAGE	2021-08-18 10:06:33.000	505.13	4
OH Other	PLANNED OUTAGE	2021-08-18 11:02:05.000	398.07	2
UG Other	PLANNED OUTAGE	2021-08-18 11:04:15.000	624.17	14
OH Other	PLANNED OUTAGE	2021-08-18 11:56:55.000	1,562.25	9
OH Other	PLANNED OUTAGE	2021-08-18 11:59:11.000	2,088.83	10
OH Other	PLANNED OUTAGE	2021-08-18 12:48:31.000	231.23	2
PLF	PLANNED OUTAGE	2021-08-18 13:45:43.000	609.60	12
UG Other	PLANNED OUTAGE	2021-08-18 14:38:07.000	797.77	14
UG Other	PLANNED OUTAGE	2021-08-19 07:56:30.000	2,954.23	22
OCR, Sec	PLANNED OUTAGE	2021-08-19 08:36:11.000	2,566.40	401
OH Other	PLANNED OUTAGE	2021-08-19 08:36:11.000	12.72	2
UG Other	PLANNED OUTAGE	2021-08-19 08:36:59.000	574.53	4
UG Other	PLANNED OUTAGE	2021-08-19 08:44:22.000	1,701.70	17
UG Other	PLANNED OUTAGE	2021-08-19 09:08:24.000	365.73	8
OH Other	PLANNED OUTAGE	2021-08-19 09:10:44.000	111.23	1
UG Other	PLANNED OUTAGE	2021-08-19 09:15:42.000	112.33	4
PLF	PLANNED OUTAGE	2021-08-19 09:42:32.000	142.30	3
PLF	PLANNED OUTAGE	2021-08-19 09:45:13.000	110.25	1
UG Other	PLANNED OUTAGE	2021-08-19 09:52:36.000	120.58	5
UG Other	PLANNED OUTAGE	2021-08-19 09:59:28.000	1,718.50	42
UG Other	PLANNED OUTAGE	2021-08-19 10:17:50.000	424.90	7
Circuit Out	PLANNED OUTAGE	2021-08-19 10:32:35.000	2,886.72	1,589
UG Other	PLANNED OUTAGE	2021-08-19 10:53:05.000	956.82	17
OH Other	PLANNED OUTAGE	2021-08-19 13:17:22.000	232.80	8
PLF	PLANNED OUTAGE	2021-08-19 19:07:07.000	158.05	1
TX Repaired (OH)	PLANNED OUTAGE	2021-08-19 19:13:09.000	727.47	4
UG Other	PLANNED OUTAGE	2021-08-19 21:17:37.000	4,469.47	8
UG Other	PLANNED OUTAGE	2021-08-19 22:11:20.000	1,165.47	4
UG Other	PLANNED OUTAGE	2021-08-20 00:00:06.000	43.03	2
UG Other	PLANNED OUTAGE	2021-08-20 08:41:26.000	3,482.93	37
UG Other	PLANNED OUTAGE	2021-08-20 08:56:11.000	129.47	1
UG Other	PLANNED OUTAGE	2021-08-20 08:57:19.000	273.00	9
UG Other	PLANNED OUTAGE	2021-08-20 09:32:57.000	317.33	8
OH Other	PLANNED OUTAGE	2021-08-20 10:00:21.000	748.00	12
TX Repaired (OH)	PLANNED OUTAGE	2021-08-20 10:00:21.000	2,615.00	12
UG Other	PLANNED OUTAGE	2021-08-20 10:19:33.000	44.00	1
OH Other	PLANNED OUTAGE	2021-08-20 10:29:51.000	55.07	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-08-20 10:29:58.000	71.27	2
UG Other	PLANNED OUTAGE	2021-08-20 11:30:33.000	24.97	7
OH Other	PLANNED OUTAGE	2021-08-20 12:05:57.000	1,114.40	12
OH Other	PLANNED OUTAGE	2021-08-20 12:28:12.000	371.60	8
UG Other	PLANNED OUTAGE	2021-08-20 12:28:12.000	44.28	1
OH Other	PLANNED OUTAGE	2021-08-20 13:19:02.000	6.37	1
UG Other	PLANNED OUTAGE	2021-08-20 14:22:02.000	1,734.67	4
TX Replaced (OH)	PLANNED OUTAGE	2021-08-20 16:15:45.000	594.10	2
OH Other	PLANNED OUTAGE	2021-08-20 19:53:07.000	78.82	1
PLF	PLANNED OUTAGE	2021-08-20 23:31:11.000	124.97	1
OH Other	PLANNED OUTAGE	2021-08-21 07:22:53.000	794.55	3
PLF	PLANNED OUTAGE	2021-08-21 08:08:13.000	458.03	1
PLF	PLANNED OUTAGE	2021-08-21 10:24:57.000	237.60	1
OH Other	PLANNED OUTAGE	2021-08-21 10:43:14.000	13.27	1
OH Other	PLANNED OUTAGE	2021-08-21 12:49:32.000	66.08	5
PLF	PLANNED OUTAGE	2021-08-21 14:12:49.000	898.17	10
OH Other	PLANNED OUTAGE	2021-08-21 15:45:57.000	367.62	7
PLF	PLANNED OUTAGE	2021-08-21 20:53:43.000	57,101.00	179
UG Other	PLANNED OUTAGE	2021-08-22 00:52:56.000	613.73	2
UG Other	PLANNED OUTAGE	2021-08-22 13:25:32.000	24.08	1
PLF	PLANNED OUTAGE	2021-08-22 16:49:17.000	46.75	3
OH Other	PLANNED OUTAGE	2021-08-22 17:02:01.000	1.92	1
UG Other	PLANNED OUTAGE	2021-08-23 08:27:58.000	192.03	2
UG Other	PLANNED OUTAGE	2021-08-23 09:12:52.000	351.80	4
UG Other	PLANNED OUTAGE	2021-08-23 09:23:57.000	295.87	7
OH Other	PLANNED OUTAGE	2021-08-23 09:28:13.000	293.70	3
UG Other	PLANNED OUTAGE	2021-08-23 10:25:47.000	516.33	5
UG Other	PLANNED OUTAGE	2021-08-23 10:29:44.000	378.00	6
OH Other	PLANNED OUTAGE	2021-08-23 11:58:52.000	63.13	1
OH Other	PLANNED OUTAGE	2021-08-23 12:09:59.000	538.27	22
OH Other	PLANNED OUTAGE	2021-08-23 12:33:16.000	532.50	10
UG Other	PLANNED OUTAGE	2021-08-23 13:17:26.000	74.15	1
OH Other	PLANNED OUTAGE	2021-08-23 13:36:29.000	96.00	6
UG Other	PLANNED OUTAGE	2021-08-23 14:23:39.000	153.10	6
PLF	PLANNED OUTAGE	2021-08-23 19:10:40.000	439.83	91
PLF	PLANNED OUTAGE	2021-08-23 19:14:01.000	60.82	41
UG Other	PLANNED OUTAGE	2021-08-23 20:52:40.000	81.25	65
OH Other	PLANNED OUTAGE	2021-08-24 07:07:47.000	350.73	1
UG Other	PLANNED OUTAGE	2021-08-24 08:39:50.000	283.37	2
PLF	PLANNED OUTAGE	2021-08-24 08:40:32.000	2,939.87	34
OH Other	PLANNED OUTAGE	2021-08-24 09:17:48.000	199.68	1
UG Other	PLANNED OUTAGE	2021-08-24 09:41:17.000	305.07	4
UG Other	PLANNED OUTAGE	2021-08-24 09:43:58.000	216.35	3
OH Other	PLANNED OUTAGE	2021-08-24 10:35:15.000	333.33	100
PLF	PLANNED OUTAGE	2021-08-24 10:44:08.000	453.70	26
OH Other	PLANNED OUTAGE	2021-08-24 10:47:29.000	244.80	1
UG Other	PLANNED OUTAGE	2021-08-24 10:52:20.000	74.00	8
UG Other	PLANNED OUTAGE	2021-08-24 11:09:58.000	412.80	6
UG Other	PLANNED OUTAGE	2021-08-24 11:23:38.000	432.80	8
OH Other	PLANNED OUTAGE	2021-08-24 11:26:46.000	2,847.60	14
UG Other	PLANNED OUTAGE	2021-08-24 11:33:17.000	116.35	1
OH Other	PLANNED OUTAGE	2021-08-24 11:33:50.000	215.13	2
OH Other	PLANNED OUTAGE	2021-08-24 12:16:38.000	1,699.42	5
OH Other	PLANNED OUTAGE	2021-08-24 12:30:03.000	144.68	1
OH Other	PLANNED OUTAGE	2021-08-24 14:09:41.000	78.17	2
OH Other	PLANNED OUTAGE	2021-08-24 14:54:16.000	202.83	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (OH)	PLANNED OUTAGE	2021-08-24 16:59:12.000	168.60	2
UG Other	PLANNED OUTAGE	2021-08-24 19:31:25.000	127.40	98
Circuit Out	PLANNED OUTAGE	2021-08-24 19:46:45.000	137.10	1
TX Repaired (OH)	PLANNED OUTAGE	2021-08-24 19:50:46.000	836.83	10
OH Other	PLANNED OUTAGE	2021-08-24 20:57:06.000	45.13	1
UG Other	PLANNED OUTAGE	2021-08-24 21:47:48.000	11.58	1
UG Other	PLANNED OUTAGE	2021-08-24 22:46:30.000	37.33	1
Circuit Out	PLANNED OUTAGE	2021-08-24 23:16:40.000	3,748.77	1,257
PLF	PLANNED OUTAGE	2021-08-24 23:19:12.000	12,583.20	42
UG Other	PLANNED OUTAGE	2021-08-24 23:19:12.000	299.08	1
TX Replaced (OH)	PLANNED OUTAGE	2021-08-25 02:37:31.000	1,258.00	5
UG Other	PLANNED OUTAGE	2021-08-25 05:27:18.000	591.97	14
PLF	PLANNED OUTAGE	2021-08-25 06:52:40.000	5,440.00	80
UG Other	PLANNED OUTAGE	2021-08-25 08:23:27.000	909.67	10
TX Repaired (OH)	PLANNED OUTAGE	2021-08-25 08:34:04.000	347.75	3
TX Replaced (PM)	PLANNED OUTAGE	2021-08-25 08:45:17.000	182.80	3
UG Other	PLANNED OUTAGE	2021-08-25 09:00:19.000	543.33	8
PLF	PLANNED OUTAGE	2021-08-25 09:55:30.000	10,822.77	34
OH Other	PLANNED OUTAGE	2021-08-25 10:03:07.000	303.75	9
UG Other	PLANNED OUTAGE	2021-08-25 10:06:49.000	1,179.15	21
UG Other	PLANNED OUTAGE	2021-08-25 10:07:37.000	693.70	7
UG Other	PLANNED OUTAGE	2021-08-25 10:38:55.000	287.53	4
PLF	PLANNED OUTAGE	2021-08-25 10:39:17.000	307.37	1
OH Other	PLANNED OUTAGE	2021-08-25 13:03:19.000	580.53	4
OH Other	PLANNED OUTAGE	2021-08-25 14:01:35.000	266.43	2
UG Other	PLANNED OUTAGE	2021-08-25 14:54:19.000	352.17	1
PLF	PLANNED OUTAGE	2021-08-25 17:01:14.000	36.80	2
UG Other	PLANNED OUTAGE	2021-08-25 20:21:28.000	6,001.33	17
OH Other	PLANNED OUTAGE	2021-08-25 22:10:55.000	220.80	16
OH Other	PLANNED OUTAGE	2021-08-26 00:06:16.000	40.27	16
OH Other	PLANNED OUTAGE	2021-08-26 03:19:14.000	280.58	7
UG Other	PLANNED OUTAGE	2021-08-26 07:47:36.000	240.35	1
OH Other	PLANNED OUTAGE	2021-08-26 08:32:22.000	952.97	11
UG Other	PLANNED OUTAGE	2021-08-26 08:57:57.000	677.83	5
UG Other	PLANNED OUTAGE	2021-08-26 09:05:40.000	502.48	7
OH Other	PLANNED OUTAGE	2021-08-26 09:25:11.000	110.10	2
OH Other	PLANNED OUTAGE	2021-08-26 09:59:52.000	55.18	1
OH Other	PLANNED OUTAGE	2021-08-26 10:00:01.000	479.70	3
OH Other	PLANNED OUTAGE	2021-08-26 10:12:22.000	255.63	1
UG Other	PLANNED OUTAGE	2021-08-26 11:01:25.000	738.27	8
OH Other	PLANNED OUTAGE	2021-08-26 12:19:26.000	1,491.32	13
UG Other	PLANNED OUTAGE	2021-08-26 12:20:41.000	1,049.40	11
OH Other	PLANNED OUTAGE	2021-08-26 12:21:48.000	1,131.50	10
PLF	PLANNED OUTAGE	2021-08-26 14:08:46.000	388.70	78
UG Other	PLANNED OUTAGE	2021-08-26 15:04:03.000	910.00	13
UG Other	PLANNED OUTAGE	2021-08-26 15:47:29.000	398.00	15
OH Other	PLANNED OUTAGE	2021-08-26 17:52:18.000	2,046.50	15
UG Other	PLANNED OUTAGE	2021-08-26 18:14:17.000	37.92	1
UG Other	PLANNED OUTAGE	2021-08-26 20:56:34.000	117.63	1
UG Other	PLANNED OUTAGE	2021-08-26 22:06:19.000	264.00	6
OH Other	PLANNED OUTAGE	2021-08-26 22:29:58.000	325.40	12
UG Other	PLANNED OUTAGE	2021-08-26 23:53:11.000	225.07	1
UG Other	PLANNED OUTAGE	2021-08-27 10:40:54.000	550.40	8
OH Other	PLANNED OUTAGE	2021-08-27 10:44:12.000	463.50	6
UG Other	PLANNED OUTAGE	2021-08-27 10:54:45.000	1,236.52	13
OH Other	PLANNED OUTAGE	2021-08-27 13:20:39.000	173.33	8

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-08-27 14:38:09.000	218.80	8
OH Other	PLANNED OUTAGE	2021-08-27 14:58:28.000	50.58	5
OH Other	PLANNED OUTAGE	2021-08-27 15:16:19.000	1,726.08	11
OH Other	PLANNED OUTAGE	2021-08-27 16:01:31.000	1,074.45	9
UG Other	PLANNED OUTAGE	2021-08-27 21:18:34.000	841.20	8
UG Other	PLANNED OUTAGE	2021-08-28 18:14:57.000	19.78	1
OCR, Sec	PLANNED OUTAGE	2021-08-29 01:50:00.000	4,644.00	1,161
OCR, Sec	PLANNED OUTAGE	2021-08-29 03:34:14.000	8,128.75	929
UG Other	PLANNED OUTAGE	2021-08-29 09:08:36.000	399.58	1
OH Other	PLANNED OUTAGE	2021-08-29 23:34:52.000	159.00	6
UG Other	PLANNED OUTAGE	2021-08-30 08:56:03.000	391.90	6
UG Other	PLANNED OUTAGE	2021-08-30 09:15:16.000	926.50	10
UG Other	PLANNED OUTAGE	2021-08-30 09:54:43.000	1,178.55	9
UG Other	PLANNED OUTAGE	2021-08-30 09:56:33.000	426.13	8
UG Other	PLANNED OUTAGE	2021-08-30 09:56:36.000	53.53	1
Circuit Out	PLANNED OUTAGE	2021-08-30 10:25:44.000	20.07	14
UG Other	PLANNED OUTAGE	2021-08-30 10:42:10.000	1,182.53	8
UG Other	PLANNED OUTAGE	2021-08-30 11:06:20.000	391.77	7
UG Other	PLANNED OUTAGE	2021-08-30 12:01:08.000	498.00	8
UG Other	PLANNED OUTAGE	2021-08-30 13:04:27.000	217.10	6
Circuit Out	PLANNED OUTAGE	2021-08-30 13:45:01.000	18.20	14
UG Other	PLANNED OUTAGE	2021-08-30 13:46:28.000	264.50	6
OCR, Sec	PLANNED OUTAGE	2021-08-30 17:47:04.000	1,836.47	652
UG Other	PLANNED OUTAGE	2021-08-30 21:05:35.000	266.40	9
UG Other	PLANNED OUTAGE	2021-08-30 21:17:00.000	127.82	1
UG Other	PLANNED OUTAGE	2021-08-30 22:15:02.000	17.92	1
OH Other	PLANNED OUTAGE	2021-08-31 00:01:40.000	1,222.50	10
OH Other	PLANNED OUTAGE	2021-08-31 01:19:46.000	44.15	1
UG Other	PLANNED OUTAGE	2021-08-31 08:49:56.000	415.83	5
UG Other	PLANNED OUTAGE	2021-08-31 08:51:18.000	343.07	8
UG Other	PLANNED OUTAGE	2021-08-31 09:02:31.000	332.33	10
UG Other	PLANNED OUTAGE	2021-08-31 09:23:00.000	123.07	4
UG Other	PLANNED OUTAGE	2021-08-31 09:52:28.000	1,077.20	8
UG Other	PLANNED OUTAGE	2021-08-31 10:29:35.000	513.07	8
UG Other	PLANNED OUTAGE	2021-08-31 12:49:11.000	3,705.92	35
OH Other	PLANNED OUTAGE	2021-08-31 17:30:36.000	70.85	3
OH Other	PLANNED OUTAGE	2021-08-31 17:35:42.000	52.85	3
UG Other	PLANNED OUTAGE	2021-09-01 09:26:47.000	166.23	1
Pole	PLANNED OUTAGE	2021-09-01 10:53:00.000	247.58	1
UG Other	PLANNED OUTAGE	2021-09-01 16:28:53.000	276.20	3
UG Other	PLANNED OUTAGE	2021-09-01 16:45:27.000	315.07	4
OCR, Sec	PLANNED OUTAGE	2021-09-01 20:29:23.000	1,910.42	875
PLF	PLANNED OUTAGE	2021-09-01 23:59:10.000	2,785.40	12
OH Other	PLANNED OUTAGE	2021-09-02 04:23:36.000	765.05	11
UG Other	PLANNED OUTAGE	2021-09-02 08:14:29.000	518.80	6
UG Other	PLANNED OUTAGE	2021-09-02 09:15:47.000	264.70	6
UG Other	PLANNED OUTAGE	2021-09-02 09:18:53.000	729.80	4
UG Other	PLANNED OUTAGE	2021-09-02 09:19:41.000	1,021.53	7
OH Other	PLANNED OUTAGE	2021-09-02 10:04:19.000	339.70	3
UG Other	PLANNED OUTAGE	2021-09-02 10:06:18.000	5,218.85	21
UG Other	PLANNED OUTAGE	2021-09-02 10:34:20.000	910.65	9
OH Other	PLANNED OUTAGE	2021-09-02 13:40:47.000	376.80	12
OH Other	PLANNED OUTAGE	2021-09-02 17:10:50.000	368.70	18
OH Other	PLANNED OUTAGE	2021-09-03 04:55:03.000	125.23	2
UG Other	PLANNED OUTAGE	2021-09-03 08:37:30.000	316.40	24
OH Other	PLANNED OUTAGE	2021-09-03 10:21:05.000	85.00	5

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-09-03 13:04:53.000	19.38	1
OH Other	PLANNED OUTAGE	2021-09-03 20:19:51.000	25.23	1
OH Other	PLANNED OUTAGE	2021-09-03 23:25:40.000	124.02	1
OH Other	PLANNED OUTAGE	2021-09-04 01:56:45.000	145.58	5
OH Other	PLANNED OUTAGE	2021-09-05 04:42:00.000	631.00	10
UG Other	PLANNED OUTAGE	2021-09-05 23:04:47.000	373.47	8
UG Other	PLANNED OUTAGE	2021-09-05 23:12:45.000	41.05	1
OH Other	PLANNED OUTAGE	2021-09-06 08:37:19.000	302.50	1
OH Other	PLANNED OUTAGE	2021-09-06 08:38:29.000	301.67	1
Circuit Out	PLANNED OUTAGE	2021-09-06 11:11:53.000	9,321.73	1,208
UG Other	PLANNED OUTAGE	2021-09-06 20:05:34.000	575.03	2
OH Other	PLANNED OUTAGE	2021-09-06 20:52:25.000	57.80	1
OH Other	PLANNED OUTAGE	2021-09-06 22:24:11.000	17.90	3
OH Other	PLANNED OUTAGE	2021-09-06 22:50:06.000	96.00	9
UG Other	PLANNED OUTAGE	2021-09-07 00:34:43.000	57.30	1
OH Other	PLANNED OUTAGE	2021-09-07 11:12:55.000	167.00	5
OH Other	PLANNED OUTAGE	2021-09-07 12:19:55.000	77.60	1
TX Repaired (PM)	PLANNED OUTAGE	2021-09-07 12:24:46.000	340.08	7
Service - Non Crew	PLANNED OUTAGE	2021-09-07 14:16:40.000	139.33	1
OH Other	PLANNED OUTAGE	2021-09-07 17:23:40.000	201.50	1
OH Other	PLANNED OUTAGE	2021-09-08 04:52:21.000	6,309.58	95
OH Other	PLANNED OUTAGE	2021-09-08 07:08:05.000	161.58	1
OCR, Sec	PLANNED OUTAGE	2021-09-08 08:22:16.000	28,577.00	492
UG Other	PLANNED OUTAGE	2021-09-08 08:38:15.000	257.73	8
UG Other	PLANNED OUTAGE	2021-09-08 08:38:23.000	580.18	7
OH Other	PLANNED OUTAGE	2021-09-08 09:08:34.000	100.25	3
UG Other	PLANNED OUTAGE	2021-09-08 10:01:18.000	204.87	4
UG Other	PLANNED OUTAGE	2021-09-08 10:37:54.000	656.25	9
OH Other	PLANNED OUTAGE	2021-09-08 11:02:49.000	433.20	9
UG Other	PLANNED OUTAGE	2021-09-08 12:00:29.000	906.00	8
UG Other	PLANNED OUTAGE	2021-09-08 13:24:38.000	231.80	4
OH Other	PLANNED OUTAGE	2021-09-08 17:21:54.000	47.45	3
TX Replaced (OH)	PLANNED OUTAGE	2021-09-08 19:29:23.000	3,494.98	7
TX Replaced (OH)	PLANNED OUTAGE	2021-09-08 20:05:16.000	2,317.00	5
TX Replaced (OH)	PLANNED OUTAGE	2021-09-08 20:26:36.000	425.77	1
PLF	PLANNED OUTAGE	2021-09-09 08:26:31.000	3,898.50	46
OH Other	PLANNED OUTAGE	2021-09-09 09:18:35.000	136.83	2
OH Other	PLANNED OUTAGE	2021-09-09 09:36:42.000	14.35	3
UG Other	PLANNED OUTAGE	2021-09-09 10:40:22.000	528.62	7
UG Other	PLANNED OUTAGE	2021-09-09 10:40:29.000	210.50	3
UG Other	PLANNED OUTAGE	2021-09-10 04:53:43.000	86.93	8
OH Other	PLANNED OUTAGE	2021-09-10 06:09:48.000	102.35	1
OH Other	PLANNED OUTAGE	2021-09-10 09:27:47.000	4,014.27	56
OH Other	PLANNED OUTAGE	2021-09-10 10:11:32.000	6,144.68	35
OH Other	PLANNED OUTAGE	2021-09-10 12:28:28.000	37.72	1
OH Other	PLANNED OUTAGE	2021-09-10 12:53:03.000	125.70	1
OH Other	PLANNED OUTAGE	2021-09-10 14:16:25.000	117.18	1
OH Other	PLANNED OUTAGE	2021-09-10 14:16:41.000	14.88	1
OH Other	PLANNED OUTAGE	2021-09-10 14:18:31.000	303.20	8
OH Other	PLANNED OUTAGE	2021-09-10 14:48:04.000	119.43	2
OH Other	PLANNED OUTAGE	2021-09-10 15:01:21.000	152.25	1
OH Other	PLANNED OUTAGE	2021-09-10 16:26:50.000	99.48	1
OH Other	PLANNED OUTAGE	2021-09-10 16:35:15.000	1,088.73	4
UG Other	PLANNED OUTAGE	2021-09-11 17:34:04.000	36.02	1
UG Other	PLANNED OUTAGE	2021-09-11 18:15:34.000	295.50	18
Circuit Out	PLANNED OUTAGE	2021-09-12 07:21:10.000	908.83	410

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-09-12 12:42:03.000	392.30	3
OH Other	PLANNED OUTAGE	2021-09-12 13:27:31.000	1,412.55	9
UG Other	PLANNED OUTAGE	2021-09-12 15:55:03.000	52.38	1
OH Other	PLANNED OUTAGE	2021-09-12 16:09:18.000	314.98	1
UG Other	PLANNED OUTAGE	2021-09-12 16:13:12.000	166.20	1
OH Other	PLANNED OUTAGE	2021-09-12 17:15:14.000	178.30	6
OH Other	PLANNED OUTAGE	2021-09-13 03:26:51.000	5,293.60	16
OH Other	PLANNED OUTAGE	2021-09-13 09:20:58.000	216.53	1
UG Other	PLANNED OUTAGE	2021-09-13 10:19:44.000	347.43	1
UG Other	PLANNED OUTAGE	2021-09-13 10:35:23.000	459.90	1
UG Other	PLANNED OUTAGE	2021-09-13 10:59:09.000	191.40	66
OH Other	PLANNED OUTAGE	2021-09-13 14:15:04.000	3,598.90	34
OH Other	PLANNED OUTAGE	2021-09-13 16:23:59.000	1,838.20	39
OH Other	PLANNED OUTAGE	2021-09-13 17:58:53.000	217.70	21
OH Other	PLANNED OUTAGE	2021-09-13 18:14:55.000	223.57	38
OH Other	PLANNED OUTAGE	2021-09-13 18:21:29.000	687.17	70
OH Other	PLANNED OUTAGE	2021-09-13 20:16:45.000	122.90	3
OH Other	PLANNED OUTAGE	2021-09-13 22:11:26.000	1,448.00	16
OH Other	PLANNED OUTAGE	2021-09-13 22:18:24.000	668.27	8
OH Other	PLANNED OUTAGE	2021-09-13 22:19:50.000	574.70	7
Circuit Out	PLANNED OUTAGE	2021-09-13 22:54:38.000	49,669.33	1,050
Circuit Out	PLANNED OUTAGE	2021-09-13 23:24:23.000	438.75	25
UG Other	PLANNED OUTAGE	2021-09-14 04:18:22.000	438.55	7
OH Other	PLANNED OUTAGE	2021-09-14 07:51:40.000	442.50	6
UG Other	PLANNED OUTAGE	2021-09-14 08:26:37.000	214.92	1
UG Other	PLANNED OUTAGE	2021-09-14 08:36:46.000	309.27	4
UG Other	PLANNED OUTAGE	2021-09-14 08:36:53.000	980.42	5
UG Other	PLANNED OUTAGE	2021-09-14 09:47:56.000	121.70	2
UG Other	PLANNED OUTAGE	2021-09-14 11:28:16.000	122.85	3
OH Other	PLANNED OUTAGE	2021-09-14 11:57:08.000	51.70	3
OH Other	PLANNED OUTAGE	2021-09-14 13:32:47.000	1,455.83	10
OH Other	PLANNED OUTAGE	2021-09-14 14:52:33.000	2,498.15	17
OH Other	PLANNED OUTAGE	2021-09-14 15:58:25.000	82.13	2
UG Other	PLANNED OUTAGE	2021-09-14 16:23:54.000	144.67	8
UG Other	PLANNED OUTAGE	2021-09-14 16:46:06.000	2,483.87	8
OH Other	PLANNED OUTAGE	2021-09-14 19:35:47.000	277.38	17
UG Other	PLANNED OUTAGE	2021-09-14 20:06:05.000	5,465.35	19
UG Other	PLANNED OUTAGE	2021-09-15 08:00:31.000	686.12	7
UG Other	PLANNED OUTAGE	2021-09-15 08:33:27.000	108.35	3
UG Other	PLANNED OUTAGE	2021-09-15 09:13:09.000	203.93	4
UG Other	PLANNED OUTAGE	2021-09-15 09:24:53.000	3.47	1
UG Other	PLANNED OUTAGE	2021-09-15 10:12:43.000	122.58	5
TX Repaired (PM)	PLANNED OUTAGE	2021-09-15 10:30:11.000	579.15	9
OH Other	PLANNED OUTAGE	2021-09-15 10:48:10.000	1,005.40	11
UG Other	PLANNED OUTAGE	2021-09-15 11:14:31.000	265.77	7
UG Other	PLANNED OUTAGE	2021-09-15 11:24:36.000	270.78	11
OH Other	PLANNED OUTAGE	2021-09-15 11:30:13.000	15.65	3
UG Other	PLANNED OUTAGE	2021-09-15 12:26:41.000	353.38	7
UG Other	PLANNED OUTAGE	2021-09-15 13:11:59.000	15.40	14
UG Other	PLANNED OUTAGE	2021-09-15 18:32:04.000	496.30	7
OH Other	PLANNED OUTAGE	2021-09-15 21:10:53.000	318.60	6
UG Other	PLANNED OUTAGE	2021-09-16 08:04:39.000	1,778.48	17
UG Other	PLANNED OUTAGE	2021-09-16 08:25:39.000	214.60	4
UG Other	PLANNED OUTAGE	2021-09-16 08:33:16.000	124.55	1
OH Other	PLANNED OUTAGE	2021-09-16 09:10:36.000	1,223.20	12
UG Other	PLANNED OUTAGE	2021-09-16 09:13:47.000	409.20	8

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-09-16 09:27:38.000	373.58	5
OH Other	PLANNED OUTAGE	2021-09-16 09:38:02.000	427.98	1
UG Other	PLANNED OUTAGE	2021-09-16 10:12:14.000	646.67	5
UG Other	PLANNED OUTAGE	2021-09-16 10:44:21.000	449.98	7
OH Other	PLANNED OUTAGE	2021-09-16 11:11:31.000	57.03	1
OH Other	PLANNED OUTAGE	2021-09-16 13:21:59.000	3,267.33	29
OH Other	PLANNED OUTAGE	2021-09-16 13:35:29.000	26.95	1
UG Other	PLANNED OUTAGE	2021-09-16 14:25:11.000	517.60	8
OH Other	PLANNED OUTAGE	2021-09-16 15:28:38.000	569.62	11
OH Other	PLANNED OUTAGE	2021-09-16 15:59:20.000	114.87	2
TX Repaired (OH)	PLANNED OUTAGE	2021-09-17 08:50:14.000	550.60	3
TX Replaced (OH)	PLANNED OUTAGE	2021-09-17 08:53:50.000	202.90	1
OH Other	PLANNED OUTAGE	2021-09-17 09:28:47.000	416.05	3
OH Other	PLANNED OUTAGE	2021-09-17 12:33:35.000	28.13	1
UG Other	PLANNED OUTAGE	2021-09-18 06:54:32.000	215.33	8
OCR, Sec	PLANNED OUTAGE	2021-09-18 07:54:12.000	1,293.50	130
TX Replaced (OH)	PLANNED OUTAGE	2021-09-18 07:54:12.000	13,575.00	45
OH Other	PLANNED OUTAGE	2021-09-18 08:04:13.000	18,257.30	61
UG Other	PLANNED OUTAGE	2021-09-18 09:01:28.000	1,193.47	4
OH Other	PLANNED OUTAGE	2021-09-18 13:03:38.000	15,803.67	130
UG Other	PLANNED OUTAGE	2021-09-18 13:08:01.000	113.20	3
OH Other	PLANNED OUTAGE	2021-09-18 15:29:13.000	36.20	1
OH Other	PLANNED OUTAGE	2021-09-18 22:22:14.000	777.00	42
OH Other	PLANNED OUTAGE	2021-09-19 14:22:02.000	16.03	1
OH Other	PLANNED OUTAGE	2021-09-19 18:34:49.000	563.85	21
OH Other	PLANNED OUTAGE	2021-09-19 23:41:17.000	359.40	4
OH Other	PLANNED OUTAGE	2021-09-20 00:04:16.000	127.13	2
UG Other	PLANNED OUTAGE	2021-09-20 09:01:10.000	891.55	11
UG Other	PLANNED OUTAGE	2021-09-20 09:04:41.000	327.00	4
TX Replaced (OH)	PLANNED OUTAGE	2021-09-20 09:16:30.000	212.55	1
UG Other	PLANNED OUTAGE	2021-09-20 09:59:16.000	330.40	6
UG Other	PLANNED OUTAGE	2021-09-20 10:51:40.000	259.95	9
UG Other	PLANNED OUTAGE	2021-09-20 11:20:58.000	469.20	8
UG Other	PLANNED OUTAGE	2021-09-20 12:25:37.000	724.53	13
UG Other	PLANNED OUTAGE	2021-09-20 12:27:07.000	379.40	6
OH Other	PLANNED OUTAGE	2021-09-20 12:45:59.000	27.53	1
TX Repaired (OH)	PLANNED OUTAGE	2021-09-20 13:12:54.000	292.10	2
TX Replaced (PM)	PLANNED OUTAGE	2021-09-20 15:42:14.000	13.47	1
TX Replaced (OH)	PLANNED OUTAGE	2021-09-20 16:50:31.000	259.88	1
UG Other	PLANNED OUTAGE	2021-09-21 08:40:20.000	457.07	8
OH Other	PLANNED OUTAGE	2021-09-21 09:10:33.000	832.65	3
TX Replaced (PM)	PLANNED OUTAGE	2021-09-21 09:27:24.000	580.30	2
OH Other	PLANNED OUTAGE	2021-09-21 09:28:52.000	1,796.80	32
UG Other	PLANNED OUTAGE	2021-09-21 09:30:00.000	618.20	11
TX Replaced (OH)	PLANNED OUTAGE	2021-09-21 09:35:11.000	179.60	1
UG Other	PLANNED OUTAGE	2021-09-21 09:46:38.000	189.33	2
UG Other	PLANNED OUTAGE	2021-09-21 09:49:33.000	459.08	5
OH Other	PLANNED OUTAGE	2021-09-21 11:30:31.000	155.13	4
UG Other	PLANNED OUTAGE	2021-09-21 11:41:07.000	51.47	1
OH Other	PLANNED OUTAGE	2021-09-21 12:04:22.000	77.50	10
OH Other	PLANNED OUTAGE	2021-09-21 12:11:21.000	776.92	5
OH Other	PLANNED OUTAGE	2021-09-21 13:33:52.000	328.00	5
OH Other	PLANNED OUTAGE	2021-09-21 13:56:37.000	45.27	1
OH Other	PLANNED OUTAGE	2021-09-21 13:57:02.000	68.33	1
OH Other	PLANNED OUTAGE	2021-09-21 14:35:31.000	445.90	3
TX Repaired (PM)	PLANNED OUTAGE	2021-09-21 14:37:23.000	146.88	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-09-21 14:38:36.000	51.27	1
UG Other	PLANNED OUTAGE	2021-09-21 16:06:18.000	58.12	1
OH Other	PLANNED OUTAGE	2021-09-21 18:44:43.000	653.22	7
OH Other	PLANNED OUTAGE	2021-09-22 09:08:34.000	53.73	1
UG Other	PLANNED OUTAGE	2021-09-22 09:19:59.000	8,989.20	22
OH Other	PLANNED OUTAGE	2021-09-22 09:20:09.000	216.50	6
UG Other	PLANNED OUTAGE	2021-09-22 09:39:01.000	92.77	1
UG Other	PLANNED OUTAGE	2021-09-22 09:42:33.000	401.87	4
OH Other	PLANNED OUTAGE	2021-09-22 09:53:06.000	910.23	7
OH Other	PLANNED OUTAGE	2021-09-22 10:10:40.000	811.35	3
OH Other	PLANNED OUTAGE	2021-09-22 10:12:54.000	238.47	7
OH Other	PLANNED OUTAGE	2021-09-22 10:13:58.000	504.93	8
PLF	PLANNED OUTAGE	2021-09-22 10:25:45.000	45.10	1
OH Other	PLANNED OUTAGE	2021-09-22 10:31:46.000	94.97	1
UG Other	PLANNED OUTAGE	2021-09-22 11:03:51.000	122.37	1
OH Other	PLANNED OUTAGE	2021-09-22 11:16:09.000	114.67	8
UG Other	PLANNED OUTAGE	2021-09-22 12:00:12.000	612.03	14
OH Other	PLANNED OUTAGE	2021-09-22 12:20:03.000	2,199.17	7
OH Other	PLANNED OUTAGE	2021-09-22 12:34:45.000	194.63	2
OH Other	PLANNED OUTAGE	2021-09-22 15:48:48.000	75.83	2
OH Other	PLANNED OUTAGE	2021-09-22 16:33:13.000	928.00	29
OH Other	PLANNED OUTAGE	2021-09-23 08:01:05.000	134.70	9
OH Other	PLANNED OUTAGE	2021-09-23 08:51:26.000	614.48	7
UG Other	PLANNED OUTAGE	2021-09-23 09:03:01.000	284.80	2
OH Other	PLANNED OUTAGE	2021-09-23 09:11:36.000	12,394.30	41
UG Other	PLANNED OUTAGE	2021-09-23 09:22:07.000	566.40	3
OH Other	PLANNED OUTAGE	2021-09-23 09:49:36.000	411.60	9
UG Other	PLANNED OUTAGE	2021-09-23 09:54:19.000	139.03	2
UG Other	PLANNED OUTAGE	2021-09-23 10:03:17.000	34.60	1
OH Other	PLANNED OUTAGE	2021-09-23 10:08:48.000	115.13	1
UG Other	PLANNED OUTAGE	2021-09-23 11:29:27.000	375.60	8
UG Other	PLANNED OUTAGE	2021-09-23 11:33:28.000	219.00	4
OH Other	PLANNED OUTAGE	2021-09-23 12:29:07.000	465.40	3
OH Other	PLANNED OUTAGE	2021-09-23 22:37:16.000	350.72	11
OH Other	PLANNED OUTAGE	2021-09-24 04:34:11.000	593.23	13
OH Other	PLANNED OUTAGE	2021-09-24 06:14:58.000	72.65	1
UG Other	PLANNED OUTAGE	2021-09-24 08:19:23.000	538.33	5
UG Other	PLANNED OUTAGE	2021-09-24 08:46:47.000	359.52	37
UG Other	PLANNED OUTAGE	2021-09-24 09:12:21.000	395.07	4
OH Other	PLANNED OUTAGE	2021-09-24 09:29:58.000	175.75	1
UG Other	PLANNED OUTAGE	2021-09-24 09:59:22.000	1,892.38	17
UG Other	PLANNED OUTAGE	2021-09-24 10:46:32.000	416.60	6
UG Other	PLANNED OUTAGE	2021-09-24 13:16:35.000	639.90	9
OH Other	PLANNED OUTAGE	2021-09-24 13:38:48.000	429.15	9
UG Other	PLANNED OUTAGE	2021-09-24 13:45:12.000	655.52	37
OH Other	PLANNED OUTAGE	2021-09-25 02:48:57.000	384.75	9
OH Other	PLANNED OUTAGE	2021-09-26 04:02:19.000	7,049.90	1,914
OH Other	PLANNED OUTAGE	2021-09-26 07:49:56.000	282.85	1
Circuit Out	PLANNED OUTAGE	2021-09-26 17:46:37.000	14,995.23	763
OH Other	PLANNED OUTAGE	2021-09-27 09:39:58.000	130.27	8
UG Other	PLANNED OUTAGE	2021-09-27 10:44:02.000	5,075.25	45
TX Replaced (OH)	PLANNED OUTAGE	2021-09-27 10:52:17.000	170.00	2
UG Other	PLANNED OUTAGE	2021-09-27 12:04:00.000	543.42	5
UG Other	PLANNED OUTAGE	2021-09-27 12:04:05.000	434.07	4
OH Other	PLANNED OUTAGE	2021-09-27 13:34:57.000	398.00	4
OH Other	PLANNED OUTAGE	2021-09-27 17:32:37.000	93.10	2

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (OH)	PLANNED OUTAGE	2021-09-27 19:09:12.000	695.87	8
UG Other	PLANNED OUTAGE	2021-09-28 08:22:27.000	408.67	4
TX Repaired (OH)	PLANNED OUTAGE	2021-09-28 08:24:57.000	464.40	4
OH Other	PLANNED OUTAGE	2021-09-28 09:32:53.000	385.93	4
UG Other	PLANNED OUTAGE	2021-09-28 10:09:27.000	241.07	2
UG Other	PLANNED OUTAGE	2021-09-28 10:17:37.000	671.73	8
UG Other	PLANNED OUTAGE	2021-09-28 10:38:25.000	208.60	7
UG Other	PLANNED OUTAGE	2021-09-28 11:18:00.000	1.72	1
OH Other	PLANNED OUTAGE	2021-09-28 11:19:55.000	2.33	2
OH Other	PLANNED OUTAGE	2021-09-28 11:42:36.000	910.65	9
UG Other	PLANNED OUTAGE	2021-09-28 11:44:11.000	220.93	8
OH Other	PLANNED OUTAGE	2021-09-28 11:47:30.000	349.60	24
UG Other	PLANNED OUTAGE	2021-09-28 12:35:16.000	523.35	9
PLF	PLANNED OUTAGE	2021-09-28 13:41:05.000	5,024.00	157
OH Other	PLANNED OUTAGE	2021-09-28 14:50:49.000	110.15	3
TX Repaired (OH)	PLANNED OUTAGE	2021-09-28 17:41:34.000	326.70	6
PLF	PLANNED OUTAGE	2021-09-29 08:36:05.000	127.97	1
OH Other	PLANNED OUTAGE	2021-09-29 09:14:58.000	1,156.93	8
UG Other	PLANNED OUTAGE	2021-09-29 09:38:40.000	68.83	1
UG Other	PLANNED OUTAGE	2021-09-29 09:58:23.000	498.75	3
OH Other	PLANNED OUTAGE	2021-09-29 11:17:45.000	471.20	2
OH Other	PLANNED OUTAGE	2021-09-29 11:19:25.000	988.65	13
OH Other	PLANNED OUTAGE	2021-09-29 11:23:24.000	73.55	1
UG Other	PLANNED OUTAGE	2021-09-29 13:34:57.000	106.13	2
UG Other	PLANNED OUTAGE	2021-09-30 08:24:28.000	12.00	6
UG Other	PLANNED OUTAGE	2021-09-30 08:26:06.000	13.07	7
UG Other	PLANNED OUTAGE	2021-09-30 09:14:08.000	645.67	5
PLF	PLANNED OUTAGE	2021-09-30 09:15:48.000	950.60	49
OH Other	PLANNED OUTAGE	2021-09-30 09:20:27.000	939.60	8
PLF	PLANNED OUTAGE	2021-09-30 09:40:14.000	4,323.20	42
PLF	PLANNED OUTAGE	2021-09-30 10:31:29.000	1,236.80	24
UG Other	PLANNED OUTAGE	2021-09-30 10:31:29.000	318.00	6
OH Other	PLANNED OUTAGE	2021-09-30 11:09:09.000	2,695.00	28
UG Other	PLANNED OUTAGE	2021-09-30 12:34:31.000	64.83	2
OH Other	PLANNED OUTAGE	2021-09-30 12:39:44.000	3,857.97	13
OH Other	PLANNED OUTAGE	2021-09-30 17:56:38.000	371.00	10
OH Other	PLANNED OUTAGE	2021-09-30 19:09:38.000	526.33	2
TX Replaced (OH)	PLANNED OUTAGE	2021-10-01 07:55:36.000	3,161.07	8
OH Other	PLANNED OUTAGE	2021-10-01 08:06:42.000	172.35	3
TX Repaired (OH)	PLANNED OUTAGE	2021-10-01 08:36:52.000	2,636.50	5
TX Repaired (PM)	PLANNED OUTAGE	2021-10-01 08:55:54.000	12,836.40	18
PLF	PLANNED OUTAGE	2021-10-01 09:12:02.000	544.25	5
PLF	PLANNED OUTAGE	2021-10-01 09:40:33.000	4,125.33	32
PLF	PLANNED OUTAGE	2021-10-01 10:50:25.000	1,157.50	30
TX Repaired (OH)	PLANNED OUTAGE	2021-10-01 19:24:50.000	642.75	9
OH Other	PLANNED OUTAGE	2021-10-01 21:45:32.000	52.47	2
TX Repaired (PM)	PLANNED OUTAGE	2021-10-02 07:43:46.000	320.43	2
UG Other	PLANNED OUTAGE	2021-10-02 07:51:50.000	203.77	1
TX Repaired (PM)	PLANNED OUTAGE	2021-10-02 07:51:58.000	202.92	1
UG Other	PLANNED OUTAGE	2021-10-02 07:53:49.000	298.00	1
OH Other	PLANNED OUTAGE	2021-10-02 12:47:50.000	2,028.67	20
OH Other	PLANNED OUTAGE	2021-10-02 13:50:09.000	748.85	17
UG Other	PLANNED OUTAGE	2021-10-02 17:19:29.000	343.87	4
OH Other	PLANNED OUTAGE	2021-10-03 09:35:36.000	347.78	1
TX Replaced (OH)	PLANNED OUTAGE	2021-10-03 09:35:43.000	728.23	2
UG Other	PLANNED OUTAGE	2021-10-03 14:58:13.000	63.03	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-10-03 19:01:34.000	65.47	4
OH Other	PLANNED OUTAGE	2021-10-03 20:05:53.000	548.17	11
OH Other	PLANNED OUTAGE	2021-10-03 20:06:00.000	89.37	7
OH Other	PLANNED OUTAGE	2021-10-04 02:09:57.000	273.08	5
OH Other	PLANNED OUTAGE	2021-10-04 03:39:11.000	74.45	1
OH Other	PLANNED OUTAGE	2021-10-04 08:46:59.000	1,631.55	9
UG Other	PLANNED OUTAGE	2021-10-04 09:12:41.000	957.83	10
UG Other	PLANNED OUTAGE	2021-10-04 09:33:30.000	751.67	10
OH Other	PLANNED OUTAGE	2021-10-04 10:30:11.000	209.80	1
OH Other	PLANNED OUTAGE	2021-10-04 11:04:34.000	266.95	1
TX Replaced (OH)	PLANNED OUTAGE	2021-10-04 12:03:36.000	502.17	2
Circuit Out	PLANNED OUTAGE	2021-10-04 14:37:13.000	4,891.33	580
OH Other	PLANNED OUTAGE	2021-10-04 18:43:02.000	18.90	1
OH Other	PLANNED OUTAGE	2021-10-04 20:09:53.000	2,001.80	12
UG Other	PLANNED OUTAGE	2021-10-05 03:28:02.000	158.08	1
OH Other	PLANNED OUTAGE	2021-10-05 08:04:12.000	171.75	1
UG Other	PLANNED OUTAGE	2021-10-05 08:50:06.000	979.55	13
UG Other	PLANNED OUTAGE	2021-10-05 09:11:46.000	318.00	5
UG Other	PLANNED OUTAGE	2021-10-05 09:13:57.000	60.23	2
OH Other	PLANNED OUTAGE	2021-10-05 10:02:57.000	149.10	1
UG Other	PLANNED OUTAGE	2021-10-05 10:34:59.000	238.00	8
UG Other	PLANNED OUTAGE	2021-10-05 11:32:02.000	199.62	7
UG Other	PLANNED OUTAGE	2021-10-05 12:09:52.000	539.82	7
TX Repaired (OH)	PLANNED OUTAGE	2021-10-05 12:31:12.000	117.57	1
OH Other	PLANNED OUTAGE	2021-10-05 13:03:19.000	1,361.38	49
OH Other	PLANNED OUTAGE	2021-10-05 15:46:47.000	49.33	1
TX Replaced (PM)	PLANNED OUTAGE	2021-10-05 18:37:54.000	3,624.88	19
OH Other	PLANNED OUTAGE	2021-10-05 18:58:57.000	20.90	1
Circuit Out	PLANNED OUTAGE	2021-10-05 19:56:07.000	413.47	14
OH Other	PLANNED OUTAGE	2021-10-05 21:17:30.000	4,312.73	11
OH Other	PLANNED OUTAGE	2021-10-05 22:01:50.000	73.68	1
OH Other	PLANNED OUTAGE	2021-10-05 23:36:35.000	159.47	1
UG Other	PLANNED OUTAGE	2021-10-06 02:04:50.000	43.40	14
TX Repaired (OH)	PLANNED OUTAGE	2021-10-06 03:55:21.000	304.27	4
OH Other	PLANNED OUTAGE	2021-10-06 08:58:56.000	473.08	7
UG Other	PLANNED OUTAGE	2021-10-06 09:02:17.000	478.00	8
UG Other	PLANNED OUTAGE	2021-10-06 09:05:49.000	171.17	5
UG Other	PLANNED OUTAGE	2021-10-06 09:13:58.000	3,803.58	13
UG Other	PLANNED OUTAGE	2021-10-06 09:28:06.000	1,298.27	13
UG Other	PLANNED OUTAGE	2021-10-06 09:57:05.000	623.00	7
OH Other	PLANNED OUTAGE	2021-10-06 10:01:38.000	257.33	2
OH Other	PLANNED OUTAGE	2021-10-06 10:18:08.000	33.65	1
UG Other	PLANNED OUTAGE	2021-10-06 11:27:15.000	243.75	9
UG Other	PLANNED OUTAGE	2021-10-06 12:14:31.000	353.87	8
TX Repaired (OH)	PLANNED OUTAGE	2021-10-06 13:32:42.000	118.53	8
OH Other	PLANNED OUTAGE	2021-10-06 16:01:18.000	873.08	5
OH Other	PLANNED OUTAGE	2021-10-06 16:30:49.000	290.60	4
UG Other	PLANNED OUTAGE	2021-10-06 21:01:41.000	554.03	11
UG Other	PLANNED OUTAGE	2021-10-07 04:42:26.000	14.23	1
OH Other	PLANNED OUTAGE	2021-10-07 08:05:21.000	458.53	8
UG Other	PLANNED OUTAGE	2021-10-07 09:00:06.000	1,285.00	30
UG Other	PLANNED OUTAGE	2021-10-07 09:24:02.000	662.27	4
TX Repaired (OH)	PLANNED OUTAGE	2021-10-07 09:35:37.000	164.37	1
OH Other	PLANNED OUTAGE	2021-10-07 10:35:40.000	124.75	3
UG Other	PLANNED OUTAGE	2021-10-07 11:24:52.000	2,005.90	26
UG Other	PLANNED OUTAGE	2021-10-07 12:34:18.000	2,854.68	23

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-10-07 12:51:48.000	137.37	2
PLF	PLANNED OUTAGE	2021-10-07 12:55:32.000	330.33	5
UG Other	PLANNED OUTAGE	2021-10-07 15:06:36.000	21.58	1
OH Other	PLANNED OUTAGE	2021-10-07 17:05:01.000	113.33	8
PLF	PLANNED OUTAGE	2021-10-07 19:21:08.000	1,446.32	77
OH Other	PLANNED OUTAGE	2021-10-08 08:00:36.000	1,199.73	8
Circuit Out	PLANNED OUTAGE	2021-10-08 12:31:59.000	13,990.25	2,615
OH Other	PLANNED OUTAGE	2021-10-08 13:11:58.000	185.80	3
OH Other	PLANNED OUTAGE	2021-10-08 15:38:22.000	17.00	3
OH Other	PLANNED OUTAGE	2021-10-08 15:45:03.000	1,286.72	7
OH Other	PLANNED OUTAGE	2021-10-08 19:07:00.000	5,773.23	37
OH Other	PLANNED OUTAGE	2021-10-08 19:31:32.000	8,449.07	64
OH Other	PLANNED OUTAGE	2021-10-08 19:34:42.000	22,844.80	177
UG Other	PLANNED OUTAGE	2021-10-08 19:48:16.000	115.10	1
OH Other	PLANNED OUTAGE	2021-10-09 07:27:36.000	6,986.70	21
OH Other	PLANNED OUTAGE	2021-10-09 09:38:57.000	787.38	119
OH Other	PLANNED OUTAGE	2021-10-09 10:07:15.000	960.38	29
OH Other	PLANNED OUTAGE	2021-10-09 15:52:12.000	696.87	4
OH Other	PLANNED OUTAGE	2021-10-09 18:16:53.000	868.67	5
OH Other	PLANNED OUTAGE	2021-10-09 18:26:05.000	1,576.75	7
OH Other	PLANNED OUTAGE	2021-10-09 19:18:38.000	998.25	9
OH Other	PLANNED OUTAGE	2021-10-11 02:30:34.000	35.58	7
OH Other	PLANNED OUTAGE	2021-10-11 02:42:30.000	44,359.98	1,279
OH Other	PLANNED OUTAGE	2021-10-11 09:37:38.000	16.85	3
OH Other	PLANNED OUTAGE	2021-10-11 10:02:38.000	3,153.33	22
OH Other	PLANNED OUTAGE	2021-10-11 10:43:00.000	364.20	6
OH Other	PLANNED OUTAGE	2021-10-11 12:02:23.000	350.27	2
UG Other	PLANNED OUTAGE	2021-10-11 12:25:43.000	101.97	1
OH Other	PLANNED OUTAGE	2021-10-11 12:45:38.000	351.33	4
OH Other	PLANNED OUTAGE	2021-10-11 16:03:52.000	1,981.82	7
OH Other	PLANNED OUTAGE	2021-10-12 06:51:12.000	357.13	4
UG Other	PLANNED OUTAGE	2021-10-12 06:53:33.000	2,075.73	28
OH Other	PLANNED OUTAGE	2021-10-12 08:36:24.000	429.60	4
UG Other	PLANNED OUTAGE	2021-10-12 09:11:21.000	7,879.20	24
UG Other	PLANNED OUTAGE	2021-10-12 09:26:33.000	28.38	13
OH Other	PLANNED OUTAGE	2021-10-12 09:31:17.000	210.10	2
OH Other	PLANNED OUTAGE	2021-10-12 09:35:09.000	106.33	1
UG Other	PLANNED OUTAGE	2021-10-12 09:35:13.000	891.45	9
OH Other	PLANNED OUTAGE	2021-10-12 10:15:16.000	335.20	4
OH Other	PLANNED OUTAGE	2021-10-12 10:22:27.000	1,730.75	805
UG Other	PLANNED OUTAGE	2021-10-12 10:29:15.000	333.30	9
OH Other	PLANNED OUTAGE	2021-10-12 10:54:51.000	221.40	2
UG Other	PLANNED OUTAGE	2021-10-12 11:12:00.000	41.70	9
UG Other	PLANNED OUTAGE	2021-10-12 11:41:20.000	712.13	7
OH Other	PLANNED OUTAGE	2021-10-12 12:33:19.000	35.47	2
OH Other	PLANNED OUTAGE	2021-10-12 13:04:33.000	27.93	4
UG Other	PLANNED OUTAGE	2021-10-12 13:10:17.000	766.98	17
PLF	PLANNED OUTAGE	2021-10-12 17:09:41.000	251.98	13
PLF	PLANNED OUTAGE	2021-10-12 17:30:20.000	186.17	10
PLF	PLANNED OUTAGE	2021-10-12 17:58:56.000	136.62	7
UG Other	PLANNED OUTAGE	2021-10-12 19:32:00.000	548.22	7
OH Other	PLANNED OUTAGE	2021-10-13 07:58:57.000	461.73	2
OH Other	PLANNED OUTAGE	2021-10-13 08:27:27.000	1,304.90	6
OH Other	PLANNED OUTAGE	2021-10-13 08:27:43.000	655.25	3
OH Other	PLANNED OUTAGE	2021-10-13 08:47:47.000	206.00	4
UG Other	PLANNED OUTAGE	2021-10-13 08:50:10.000	321.73	4

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-10-13 09:03:43.000	470.40	6
UG Other	PLANNED OUTAGE	2021-10-13 09:07:29.000	21.60	8
UG Other	PLANNED OUTAGE	2021-10-13 09:07:37.000	23.10	9
OH Other	PLANNED OUTAGE	2021-10-13 09:10:38.000	316.83	2
UG Other	PLANNED OUTAGE	2021-10-13 09:13:46.000	931.03	17
OH Other	PLANNED OUTAGE	2021-10-13 10:09:41.000	711.87	8
UG Other	PLANNED OUTAGE	2021-10-13 10:44:16.000	252.47	4
PLF	PLANNED OUTAGE	2021-10-13 11:03:51.000	99.00	1
OH Other	PLANNED OUTAGE	2021-10-13 12:47:18.000	225.87	4
OH Other	PLANNED OUTAGE	2021-10-13 13:43:55.000	510.40	16
OH Other	PLANNED OUTAGE	2021-10-13 14:12:22.000	5,218.40	66
OH Other	PLANNED OUTAGE	2021-10-13 20:27:53.000	146.53	8
UG Other	PLANNED OUTAGE	2021-10-14 07:44:05.000	22,923.75	75
UG Other	PLANNED OUTAGE	2021-10-14 08:40:50.000	516.55	1
OH Other	PLANNED OUTAGE	2021-10-14 08:56:51.000	2,363.07	8
UG Other	PLANNED OUTAGE	2021-10-14 08:59:25.000	501.95	1
UG Other	PLANNED OUTAGE	2021-10-14 09:05:03.000	549.15	7
UG Other	PLANNED OUTAGE	2021-10-14 09:20:26.000	1,060.80	4
UG Other	PLANNED OUTAGE	2021-10-14 09:27:02.000	299.20	4
TX Repaired (PM)	PLANNED OUTAGE	2021-10-14 09:29:42.000	622.40	12
OH Other	PLANNED OUTAGE	2021-10-14 09:34:46.000	130.47	1
UG Other	PLANNED OUTAGE	2021-10-14 09:57:53.000	3,882.90	43
UG Other	PLANNED OUTAGE	2021-10-14 12:33:06.000	1,158.50	21
OH Other	PLANNED OUTAGE	2021-10-14 12:59:56.000	5,824.20	18
OH Other	PLANNED OUTAGE	2021-10-14 13:18:46.000	26.28	1
OH Other	PLANNED OUTAGE	2021-10-14 16:48:27.000	491.70	9
OH Other	PLANNED OUTAGE	2021-10-14 19:43:08.000	125.65	1
OH Other	PLANNED OUTAGE	2021-10-14 20:29:49.000	9.62	1
Circuit Out	PLANNED OUTAGE	2021-10-14 21:41:32.000	7,633.90	1,574
TX Replaced (PM)	PLANNED OUTAGE	2021-10-14 23:50:58.000	2,989.00	10
UG Other	PLANNED OUTAGE	2021-10-15 08:11:48.000	755.17	10
OH Other	PLANNED OUTAGE	2021-10-15 08:54:32.000	183.72	1
UG Other	PLANNED OUTAGE	2021-10-15 08:58:44.000	321.73	4
OH Other	PLANNED OUTAGE	2021-10-15 11:32:39.000	1,501.20	12
OH Other	PLANNED OUTAGE	2021-10-15 12:48:34.000	143.93	4
OH Other	PLANNED OUTAGE	2021-10-15 13:52:21.000	229.23	23
OH Other	PLANNED OUTAGE	2021-10-15 13:57:37.000	3,664.00	20
OH Other	PLANNED OUTAGE	2021-10-15 14:42:36.000	272.33	2
TX Repaired (OH)	PLANNED OUTAGE	2021-10-15 17:00:55.000	4.43	2
PLF	PLANNED OUTAGE	2021-10-15 17:56:54.000	6,977.73	59
UG Other	PLANNED OUTAGE	2021-10-16 08:40:03.000	1,954.70	3
UG Other	PLANNED OUTAGE	2021-10-16 10:01:45.000	569.88	1
UG Other	PLANNED OUTAGE	2021-10-16 18:27:18.000	29.97	1
UG Other	PLANNED OUTAGE	2021-10-16 18:38:38.000	731.73	7
OH Other	PLANNED OUTAGE	2021-10-16 18:47:02.000	205.00	1
UG Other	PLANNED OUTAGE	2021-10-16 21:39:35.000	11.35	1
OH Other	PLANNED OUTAGE	2021-10-17 09:10:20.000	195.93	1
OH Other	PLANNED OUTAGE	2021-10-17 23:13:58.000	10.73	1
OH Other	PLANNED OUTAGE	2021-10-18 08:52:27.000	1,023.75	91
OH Other	PLANNED OUTAGE	2021-10-18 08:57:43.000	3,397.33	28
OH Other	PLANNED OUTAGE	2021-10-18 10:12:09.000	363.08	1
OH Other	PLANNED OUTAGE	2021-10-18 15:39:52.000	262.60	4
OH Other	PLANNED OUTAGE	2021-10-18 16:36:03.000	167.90	6
OH Other	PLANNED OUTAGE	2021-10-18 17:17:52.000	273.70	6
PLF	PLANNED OUTAGE	2021-10-19 08:23:11.000	184.38	1
OH Other	PLANNED OUTAGE	2021-10-19 08:27:11.000	1,164.13	8

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (OH)	PLANNED OUTAGE	2021-10-19 08:32:20.000	175.30	1
PLF	PLANNED OUTAGE	2021-10-19 08:34:20.000	144.62	1
TX Repaired (OH)	PLANNED OUTAGE	2021-10-19 08:53:09.000	544.20	18
UG Other	PLANNED OUTAGE	2021-10-19 08:54:35.000	331.53	4
UG Other	PLANNED OUTAGE	2021-10-19 09:28:55.000	766.17	6
UG Other	PLANNED OUTAGE	2021-10-19 10:16:11.000	248.80	6
UG Other	PLANNED OUTAGE	2021-10-19 10:23:50.000	22,740.25	65
UG Other	PLANNED OUTAGE	2021-10-19 10:27:03.000	4,094.80	12
OH Other	PLANNED OUTAGE	2021-10-19 11:04:41.000	74.15	1
UG Other	PLANNED OUTAGE	2021-10-19 11:15:44.000	939.17	10
OH Other	PLANNED OUTAGE	2021-10-19 11:28:51.000	1,156.90	6
OH Other	PLANNED OUTAGE	2021-10-19 11:32:22.000	553.20	9
OH Other	PLANNED OUTAGE	2021-10-19 13:00:00.000	682.27	8
UG Other	PLANNED OUTAGE	2021-10-19 13:25:40.000	28.73	1
UG Other	PLANNED OUTAGE	2021-10-19 13:33:04.000	10,817.40	66
UG Other	PLANNED OUTAGE	2021-10-19 16:16:29.000	2,247.92	65
UG Other	PLANNED OUTAGE	2021-10-19 16:49:19.000	45.73	28
UG Other	PLANNED OUTAGE	2021-10-19 17:11:56.000	341.55	33
UG Other	PLANNED OUTAGE	2021-10-19 18:12:32.000	3,326.53	122
UG Other	PLANNED OUTAGE	2021-10-19 18:12:41.000	3,857.13	144
UG Other	PLANNED OUTAGE	2021-10-19 20:23:34.000	373.37	2
OH Other	PLANNED OUTAGE	2021-10-19 21:35:59.000	219.90	6
UG Other	PLANNED OUTAGE	2021-10-19 23:07:46.000	20,087.95	123
UG Other	PLANNED OUTAGE	2021-10-19 23:08:49.000	398.85	3
UG Other	PLANNED OUTAGE	2021-10-19 23:56:28.000	1,281.45	9
OH Other	PLANNED OUTAGE	2021-10-20 08:45:31.000	809.67	7
OH Other	PLANNED OUTAGE	2021-10-20 08:51:06.000	965.60	12
UG Other	PLANNED OUTAGE	2021-10-20 08:58:56.000	401.77	2
TX Replaced (OH)	PLANNED OUTAGE	2021-10-20 09:03:26.000	251.70	1
TX Replaced (PM)	PLANNED OUTAGE	2021-10-20 09:24:57.000	2,240.67	8
OH Other	PLANNED OUTAGE	2021-10-20 09:43:05.000	7,556.30	38
OH Other	PLANNED OUTAGE	2021-10-20 09:48:24.000	352.05	3
UG Other	PLANNED OUTAGE	2021-10-20 09:50:28.000	442.35	9
OH Other	PLANNED OUTAGE	2021-10-20 09:55:00.000	50.08	1
OH Other	PLANNED OUTAGE	2021-10-20 09:56:08.000	415.67	2
OH Other	PLANNED OUTAGE	2021-10-20 10:09:13.000	1,377.17	10
PLF	PLANNED OUTAGE	2021-10-20 11:09:07.000	808.40	12
OH Other	PLANNED OUTAGE	2021-10-20 11:11:17.000	354.40	12
OH Other	PLANNED OUTAGE	2021-10-20 12:27:52.000	81.55	7
UG Other	PLANNED OUTAGE	2021-10-20 12:36:21.000	504.12	7
UG Other	PLANNED OUTAGE	2021-10-20 13:05:36.000	341.70	9
OH Other	PLANNED OUTAGE	2021-10-20 15:15:42.000	326.12	17
OH Other	PLANNED OUTAGE	2021-10-20 23:39:25.000	288.92	1
UG Other	PLANNED OUTAGE	2021-10-21 04:43:16.000	7,896.00	90
OH Other	PLANNED OUTAGE	2021-10-21 08:36:08.000	819.00	10
UG Other	PLANNED OUTAGE	2021-10-21 08:54:52.000	372.00	5
UG Other	PLANNED OUTAGE	2021-10-21 09:11:43.000	1,036.10	13
UG Other	PLANNED OUTAGE	2021-10-21 10:02:49.000	238.67	10
UG Other	PLANNED OUTAGE	2021-10-21 10:27:28.000	1,083.12	13
OH Other	PLANNED OUTAGE	2021-10-21 10:40:35.000	3,072.98	13
OH Other	PLANNED OUTAGE	2021-10-21 10:42:20.000	1,942.80	12
UG Other	PLANNED OUTAGE	2021-10-21 11:05:28.000	574.93	8
UG Other	PLANNED OUTAGE	2021-10-21 13:50:58.000	175.75	5
OH Other	PLANNED OUTAGE	2021-10-22 09:15:51.000	289.87	4
OH Other	PLANNED OUTAGE	2021-10-22 09:30:57.000	187.40	1
OH Other	PLANNED OUTAGE	2021-10-22 10:45:28.000	390.70	6

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-10-22 15:24:36.000	21,149.55	129
UG Other	PLANNED OUTAGE	2021-10-22 15:48:30.000	496.67	20
OH Other	PLANNED OUTAGE	2021-10-22 16:23:08.000	12,469.62	554
OH Other	PLANNED OUTAGE	2021-10-22 16:23:20.000	24,942.93	1,124
OH Other	PLANNED OUTAGE	2021-10-22 21:50:07.000	19.43	1
OH Other	PLANNED OUTAGE	2021-10-23 06:39:22.000	3,602.07	761
UG Other	PLANNED OUTAGE	2021-10-24 00:43:35.000	394.95	9
OH Other	PLANNED OUTAGE	2021-10-24 16:23:29.000	10,367.33	40
OH Other	PLANNED OUTAGE	2021-10-24 19:39:11.000	1,650.83	25
OH Other	PLANNED OUTAGE	2021-10-24 20:48:20.000	606.45	13
UG Other	PLANNED OUTAGE	2021-10-24 22:25:04.000	134.13	8
UG Other	PLANNED OUTAGE	2021-10-25 06:56:53.000	156.33	7
OH Other	PLANNED OUTAGE	2021-10-25 08:33:05.000	1,344.27	4
UG Other	PLANNED OUTAGE	2021-10-25 08:45:53.000	449.05	3
UG Other	PLANNED OUTAGE	2021-10-25 09:48:21.000	71.73	1
OH Other	PLANNED OUTAGE	2021-10-25 11:10:49.000	76.23	2
OH Other	PLANNED OUTAGE	2021-10-25 11:13:25.000	95.57	94
OH Other	PLANNED OUTAGE	2021-10-25 11:21:08.000	297.80	4
UG Other	PLANNED OUTAGE	2021-10-25 11:30:01.000	752.87	4
OH Other	PLANNED OUTAGE	2021-10-25 12:06:46.000	37.13	2
OH Other	PLANNED OUTAGE	2021-10-25 13:41:00.000	38.40	2
OH Other	PLANNED OUTAGE	2021-10-25 16:51:01.000	411.80	12
OH Other	PLANNED OUTAGE	2021-10-25 17:14:02.000	116.52	1
UG Other	PLANNED OUTAGE	2021-10-25 18:16:20.000	398.40	12
OH Other	PLANNED OUTAGE	2021-10-25 23:12:35.000	23.40	1
OH Other	PLANNED OUTAGE	2021-10-26 08:11:38.000	29.37	1
OH Other	PLANNED OUTAGE	2021-10-26 08:25:28.000	173.25	5
OH Other	PLANNED OUTAGE	2021-10-26 08:36:23.000	1,088.00	15
OH Other	PLANNED OUTAGE	2021-10-26 08:51:36.000	266.73	4
OH Other	PLANNED OUTAGE	2021-10-26 08:56:43.000	1,386.25	25
OH Other	PLANNED OUTAGE	2021-10-26 09:03:33.000	812.90	3
UG Other	PLANNED OUTAGE	2021-10-26 09:31:43.000	3,066.40	16
UG Other	PLANNED OUTAGE	2021-10-26 10:13:13.000	418.60	6
OH Other	PLANNED OUTAGE	2021-10-26 10:52:47.000	123.47	2
OH Other	PLANNED OUTAGE	2021-10-26 11:39:34.000	1,240.07	11
OH Other	PLANNED OUTAGE	2021-10-26 12:51:03.000	353.80	1
OH Other	PLANNED OUTAGE	2021-10-26 13:47:10.000	380.45	7
OH Other	PLANNED OUTAGE	2021-10-26 16:17:37.000	121.05	9
OH Other	PLANNED OUTAGE	2021-10-27 08:20:07.000	2,702.12	19
TX Repaired (OH)	PLANNED OUTAGE	2021-10-27 09:43:16.000	587.30	6
OH Other	PLANNED OUTAGE	2021-10-27 09:48:15.000	2,324.33	10
OH Other	PLANNED OUTAGE	2021-10-27 09:53:58.000	369.83	7
TX Repaired (OH)	PLANNED OUTAGE	2021-10-27 10:19:57.000	35.52	1
OH Other	PLANNED OUTAGE	2021-10-27 10:34:02.000	1,792.93	17
OH Other	PLANNED OUTAGE	2021-10-27 10:57:50.000	140.60	4
OH Other	PLANNED OUTAGE	2021-10-27 10:58:38.000	1,329.03	13
PLF	PLANNED OUTAGE	2021-10-27 11:22:09.000	5,966.00	43
TX Repaired (OH)	PLANNED OUTAGE	2021-10-27 11:23:38.000	949.08	7
UG Other	PLANNED OUTAGE	2021-10-27 11:59:06.000	500.10	9
OH Other	PLANNED OUTAGE	2021-10-27 12:34:25.000	65.27	1
UG Other	PLANNED OUTAGE	2021-10-27 13:37:26.000	495.90	3
OH Other	PLANNED OUTAGE	2021-10-27 15:22:35.000	894.00	12
UG Other	PLANNED OUTAGE	2021-10-27 17:00:12.000	281.92	5
OH Other	PLANNED OUTAGE	2021-10-28 09:09:31.000	188.97	1
OH Other	PLANNED OUTAGE	2021-10-28 09:23:28.000	209.60	6
OH Other	PLANNED OUTAGE	2021-10-28 09:58:27.000	165.60	3

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-10-28 10:31:12.000	484.42	5
UG Other	PLANNED OUTAGE	2021-10-28 10:58:06.000	77.55	3
UG Other	PLANNED OUTAGE	2021-10-28 11:16:24.000	58.68	1
UG Other	PLANNED OUTAGE	2021-10-28 11:22:13.000	443.80	28
OH Other	PLANNED OUTAGE	2021-10-28 11:41:31.000	219.80	2
UG Other	PLANNED OUTAGE	2021-10-28 11:48:16.000	46,857.33	311
OH Other	PLANNED OUTAGE	2021-10-28 12:47:58.000	45.70	6
OH Other	PLANNED OUTAGE	2021-10-28 15:24:02.000	59.80	23
OH Other	PLANNED OUTAGE	2021-10-28 16:09:07.000	2,592.30	9
UG Other	PLANNED OUTAGE	2021-10-28 17:55:58.000	345.25	5
OH Other	PLANNED OUTAGE	2021-10-28 18:19:14.000	160.17	10
OH Other	PLANNED OUTAGE	2021-10-29 07:09:20.000	1,212.93	8
UG Other	PLANNED OUTAGE	2021-10-29 08:53:24.000	214.30	3
UG Other	PLANNED OUTAGE	2021-10-29 09:06:36.000	412.30	6
OH Other	PLANNED OUTAGE	2021-10-29 09:09:58.000	209.53	2
UG Other	PLANNED OUTAGE	2021-10-29 10:46:43.000	345.87	8
OH Other	PLANNED OUTAGE	2021-10-29 11:40:27.000	39,847.02	1,205
OH Other	PLANNED OUTAGE	2021-10-29 13:12:08.000	121.83	1
OH Other	PLANNED OUTAGE	2021-10-29 13:37:35.000	542.13	8
OH Other	PLANNED OUTAGE	2021-10-29 13:56:55.000	553.20	6
OH Other	PLANNED OUTAGE	2021-10-29 14:04:30.000	829.35	9
OH Other	PLANNED OUTAGE	2021-10-29 14:34:40.000	315.42	5
OH Other	PLANNED OUTAGE	2021-10-29 16:49:24.000	737.10	7
OH Other	PLANNED OUTAGE	2021-10-29 17:57:42.000	471.90	11
OH Other	PLANNED OUTAGE	2021-10-29 20:19:37.000	786.00	72
OH Other	PLANNED OUTAGE	2021-10-30 18:11:02.000	8,166.08	7
OCR, Sec	PLANNED OUTAGE	2021-10-30 18:17:33.000	5,062.63	182
OH Other	PLANNED OUTAGE	2021-10-31 08:35:17.000	1,382.33	110
OH Other	PLANNED OUTAGE	2021-10-31 10:13:38.000	851.60	12
OH Other	PLANNED OUTAGE	2021-10-31 16:24:53.000	706.77	14
OH Other	PLANNED OUTAGE	2021-10-31 18:06:20.000	1,639.33	40
UG Other	PLANNED OUTAGE	2021-10-31 19:20:45.000	164.60	12
UG Other	PLANNED OUTAGE	2021-11-01 09:05:28.000	904.20	18
UG Other	PLANNED OUTAGE	2021-11-01 09:40:53.000	562.33	5
UG Other	PLANNED OUTAGE	2021-11-01 09:41:54.000	6,235.80	57
UG Other	PLANNED OUTAGE	2021-11-01 09:52:50.000	887.00	20
UG Other	PLANNED OUTAGE	2021-11-01 11:13:11.000	65.28	1
UG Other	PLANNED OUTAGE	2021-11-01 11:15:24.000	3,070.00	24
OH Other	PLANNED OUTAGE	2021-11-01 11:15:48.000	2,791.37	14
UG Other	PLANNED OUTAGE	2021-11-01 11:17:30.000	1,552.85	13
OH Other	PLANNED OUTAGE	2021-11-01 12:58:46.000	155.85	3
UG Other	PLANNED OUTAGE	2021-11-01 13:25:48.000	1,703.22	13
UG Other	PLANNED OUTAGE	2021-11-01 13:38:08.000	201.50	5
OH Other	PLANNED OUTAGE	2021-11-01 17:06:29.000	34.27	1
OH Other	PLANNED OUTAGE	2021-11-01 18:12:10.000	115.93	4
OH Other	PLANNED OUTAGE	2021-11-01 19:20:24.000	2,234.40	9
UG Other	PLANNED OUTAGE	2021-11-02 08:39:30.000	343.08	5
UG Other	PLANNED OUTAGE	2021-11-02 08:40:41.000	105.97	17
OH Other	PLANNED OUTAGE	2021-11-02 08:59:38.000	549.40	3
UG Other	PLANNED OUTAGE	2021-11-02 09:00:26.000	2,689.60	32
OH Other	PLANNED OUTAGE	2021-11-02 09:06:31.000	1,607.78	7
UG Other	PLANNED OUTAGE	2021-11-02 09:35:56.000	186.40	4
OH Other	PLANNED OUTAGE	2021-11-02 10:13:11.000	291.30	3
UG Other	PLANNED OUTAGE	2021-11-02 10:23:18.000	139.42	7
UG Other	PLANNED OUTAGE	2021-11-02 10:28:27.000	4,481.48	17
UG Other	PLANNED OUTAGE	2021-11-02 10:48:09.000	282.50	6

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-11-02 11:42:12.000	86.80	7
UG Other	PLANNED OUTAGE	2021-11-02 11:58:54.000	395.83	10
UG Other	PLANNED OUTAGE	2021-11-02 12:22:56.000	226.35	9
UG Other	PLANNED OUTAGE	2021-11-02 13:06:00.000	415.17	10
UG Other	PLANNED OUTAGE	2021-11-02 14:36:18.000	5,554.73	4
OH Other	PLANNED OUTAGE	2021-11-02 17:21:33.000	50.42	1
UG Other	PLANNED OUTAGE	2021-11-02 22:00:48.000	339.25	1
OH Other	PLANNED OUTAGE	2021-11-03 08:58:45.000	486.45	9
OH Other	PLANNED OUTAGE	2021-11-03 09:17:39.000	1,339.00	5
TX Repaired (OH)	PLANNED OUTAGE	2021-11-03 09:28:13.000	29.30	1
UG Other	PLANNED OUTAGE	2021-11-03 09:29:26.000	487.60	6
PLF	PLANNED OUTAGE	2021-11-03 09:48:35.000	673.67	4
UG Other	PLANNED OUTAGE	2021-11-03 10:45:16.000	277.10	6
UG Other	PLANNED OUTAGE	2021-11-03 10:47:16.000	944.25	9
TX Repaired (PM)	PLANNED OUTAGE	2021-11-03 10:50:05.000	80.48	1
UG Other	PLANNED OUTAGE	2021-11-03 11:02:05.000	242.65	3
UG Other	PLANNED OUTAGE	2021-11-03 11:48:05.000	2,455.25	23
OH Other	PLANNED OUTAGE	2021-11-03 12:01:41.000	260.65	3
OH Other	PLANNED OUTAGE	2021-11-03 12:10:34.000	82.47	1
TX Repaired (PM)	PLANNED OUTAGE	2021-11-03 13:35:28.000	1,332.47	23
OH Other	PLANNED OUTAGE	2021-11-03 15:04:27.000	32.00	2
UG Other	PLANNED OUTAGE	2021-11-03 18:02:28.000	22.17	5
OH Other	PLANNED OUTAGE	2021-11-04 08:28:10.000	3,239.87	22
UG Other	PLANNED OUTAGE	2021-11-04 09:05:21.000	1,001.00	12
UG Other	PLANNED OUTAGE	2021-11-04 09:43:04.000	1,236.20	28
UG Other	PLANNED OUTAGE	2021-11-04 10:15:48.000	890.23	17
UG Other	PLANNED OUTAGE	2021-11-04 10:46:16.000	689.45	3
UG Other	PLANNED OUTAGE	2021-11-04 12:52:41.000	504.27	8
OH Other	PLANNED OUTAGE	2021-11-04 13:14:14.000	78.05	7
OH Other	PLANNED OUTAGE	2021-11-04 13:38:39.000	310.13	8
PLF	PLANNED OUTAGE	2021-11-04 14:16:00.000	29.03	2
PLF	PLANNED OUTAGE	2021-11-04 14:43:44.000	5.07	2
TX Repaired (OH)	PLANNED OUTAGE	2021-11-04 14:49:38.000	19.50	1
PLF	PLANNED OUTAGE	2021-11-05 05:15:52.000	8,264.57	74
Circuit Out	PLANNED OUTAGE	2021-11-05 05:37:38.000	3,969.00	945
OH Other	PLANNED OUTAGE	2021-11-05 05:42:43.000	2,815.68	19
OH Other	PLANNED OUTAGE	2021-11-05 06:27:19.000	25.97	1
Circuit Out	PLANNED OUTAGE	2021-11-05 07:02:22.000	4,232.27	944
Circuit Out	PLANNED OUTAGE	2021-11-05 12:58:11.000	3,161.48	899
UG Other	PLANNED OUTAGE	2021-11-05 14:30:41.000	704.95	3
Primary Wire	PLANNED OUTAGE	2021-11-05 15:47:24.000	884.17	5
Primary Wire	PLANNED OUTAGE	2021-11-05 15:57:57.000	17,457.55	35
UG Other	PLANNED OUTAGE	2021-11-05 17:05:46.000	74.97	2
PLF	PLANNED OUTAGE	2021-11-05 20:20:11.000	23,898.00	40
PLF	PLANNED OUTAGE	2021-11-05 21:03:21.000	25,181.00	60
OH Other	PLANNED OUTAGE	2021-11-05 21:10:34.000	231.00	30
UG Other	PLANNED OUTAGE	2021-11-05 21:16:22.000	7,322.80	24
OH Other	PLANNED OUTAGE	2021-11-05 22:32:05.000	3,321.67	20
Circuit Out	PLANNED OUTAGE	2021-11-06 03:29:18.000	15,276.25	844
OH Other	PLANNED OUTAGE	2021-11-06 04:33:23.000	285.10	6
TX Repaired (OH)	PLANNED OUTAGE	2021-11-06 08:35:53.000	306.28	17
OH Other	PLANNED OUTAGE	2021-11-06 12:18:41.000	179.00	5
PLF	PLANNED OUTAGE	2021-11-07 01:14:17.000	332.00	20
UG Other	PLANNED OUTAGE	2021-11-07 08:00:11.000	67.50	1
UG Other	PLANNED OUTAGE	2021-11-07 08:10:41.000	396.60	2
UG Other	PLANNED OUTAGE	2021-11-08 05:26:02.000	59.63	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-11-08 06:35:06.000	23.57	2
UG Other	PLANNED OUTAGE	2021-11-08 08:50:44.000	700.00	6
UG Other	PLANNED OUTAGE	2021-11-08 09:12:10.000	2,358.00	30
UG Other	PLANNED OUTAGE	2021-11-08 09:59:18.000	149.75	5
UG Other	PLANNED OUTAGE	2021-11-08 09:59:32.000	377.65	13
OH Other	PLANNED OUTAGE	2021-11-08 12:35:45.000	788.80	8
OH Other	PLANNED OUTAGE	2021-11-08 14:17:11.000	139.70	2
UG Other	PLANNED OUTAGE	2021-11-08 19:31:33.000	406.75	2
UG Other	PLANNED OUTAGE	2021-11-08 20:03:39.000	729.75	9
TX Repaired (PM)	PLANNED OUTAGE	2021-11-08 21:05:43.000	108.27	1
UG Other	PLANNED OUTAGE	2021-11-08 22:58:21.000	584.05	3
OH Other	PLANNED OUTAGE	2021-11-09 08:34:19.000	1,247.20	4
OH Other	PLANNED OUTAGE	2021-11-09 08:45:16.000	1,368.27	2
UG Other	PLANNED OUTAGE	2021-11-09 08:47:23.000	1,293.67	2
TX Repaired (PM)	PLANNED OUTAGE	2021-11-09 09:07:33.000	2,386.63	22
UG Other	PLANNED OUTAGE	2021-11-09 09:32:17.000	92.92	1
OH Other	PLANNED OUTAGE	2021-11-09 10:08:56.000	154.08	1
OH Other	PLANNED OUTAGE	2021-11-09 10:48:19.000	270.80	6
OH Other	PLANNED OUTAGE	2021-11-09 11:00:30.000	65.45	3
OH Other	PLANNED OUTAGE	2021-11-09 11:37:44.000	174.30	6
UG Other	PLANNED OUTAGE	2021-11-09 12:20:53.000	1,035.20	12
PLF	PLANNED OUTAGE	2021-11-09 13:01:03.000	1,775.00	20
TX Repaired (PM)	PLANNED OUTAGE	2021-11-09 13:28:42.000	96.13	14
TX Repaired (PM)	PLANNED OUTAGE	2021-11-09 13:44:06.000	1,404.20	14
OH Other	PLANNED OUTAGE	2021-11-09 13:50:27.000	81.75	9
OH Other	PLANNED OUTAGE	2021-11-09 18:41:39.000	689.87	13
OH Other	PLANNED OUTAGE	2021-11-09 20:30:54.000	348.30	6
OH Other	PLANNED OUTAGE	2021-11-09 23:58:18.000	36.78	1
OH Other	PLANNED OUTAGE	2021-11-10 07:33:07.000	72.92	5
OH Other	PLANNED OUTAGE	2021-11-10 08:30:32.000	58.40	8
OH Other	PLANNED OUTAGE	2021-11-10 08:52:17.000	625.40	3
UG Other	PLANNED OUTAGE	2021-11-10 09:01:21.000	1,391.65	13
UG Other	PLANNED OUTAGE	2021-11-10 09:35:13.000	79.25	1
OH Other	PLANNED OUTAGE	2021-11-10 09:39:20.000	1,241.00	6
UG Other	PLANNED OUTAGE	2021-11-10 10:04:38.000	86.37	1
OH Other	PLANNED OUTAGE	2021-11-10 10:44:06.000	173.15	1
UG Other	PLANNED OUTAGE	2021-11-10 13:16:40.000	55.50	1
UG Other	PLANNED OUTAGE	2021-11-10 14:14:55.000	12.00	1
UG Other	PLANNED OUTAGE	2021-11-10 14:29:45.000	19.90	3
OH Other	PLANNED OUTAGE	2021-11-10 17:16:32.000	231.90	9
Circuit Out	PLANNED OUTAGE	2021-11-11 05:20:59.000	43,877.00	1,479
OH Other	PLANNED OUTAGE	2021-11-11 08:08:57.000	116.33	1
UG Other	PLANNED OUTAGE	2021-11-11 09:04:11.000	197.58	5
OH Other	PLANNED OUTAGE	2021-11-11 09:07:05.000	70.70	1
UG Other	PLANNED OUTAGE	2021-11-11 09:14:54.000	1,139.33	5
OH Other	PLANNED OUTAGE	2021-11-11 09:20:58.000	354.90	13
UG Other	PLANNED OUTAGE	2021-11-11 10:57:33.000	214.43	2
OH Other	PLANNED OUTAGE	2021-11-11 11:56:25.000	656.75	5
UG Other	PLANNED OUTAGE	2021-11-11 13:15:22.000	73.30	1
OH Other	PLANNED OUTAGE	2021-11-11 13:31:05.000	181.97	2
OH Other	PLANNED OUTAGE	2021-11-11 13:59:56.000	160.60	11
UG Other	PLANNED OUTAGE	2021-11-11 16:03:45.000	230.25	45
UG Other	PLANNED OUTAGE	2021-11-11 16:11:10.000	11,478.40	48
UG Other	PLANNED OUTAGE	2021-11-11 16:12:16.000	6,446.70	27
UG Other	PLANNED OUTAGE	2021-11-11 16:13:36.000	14,380.80	56
OH Other	PLANNED OUTAGE	2021-11-11 17:08:48.000	93.25	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-11-11 18:12:31.000	23.42	1
OH Other	PLANNED OUTAGE	2021-11-11 19:22:44.000	1,929.75	465
UG Other	PLANNED OUTAGE	2021-11-11 22:04:43.000	215.00	3
UG Other	PLANNED OUTAGE	2021-11-12 08:58:51.000	22.07	1
UG Other	PLANNED OUTAGE	2021-11-12 09:02:10.000	216.83	5
UG Other	PLANNED OUTAGE	2021-11-12 09:14:25.000	472.67	2
UG Other	PLANNED OUTAGE	2021-11-12 09:25:19.000	597.83	10
OH Other	PLANNED OUTAGE	2021-11-12 10:45:16.000	255.97	1
OH Other	PLANNED OUTAGE	2021-11-12 11:06:49.000	26.47	1
OH Other	PLANNED OUTAGE	2021-11-12 12:26:58.000	124.75	3
UG Other	PLANNED OUTAGE	2021-11-12 13:19:04.000	19.47	1
OH Other	PLANNED OUTAGE	2021-11-12 13:54:59.000	33.50	2
UG Other	PLANNED OUTAGE	2021-11-12 14:25:50.000	533.00	10
Circuit Out	PLANNED OUTAGE	2021-11-12 14:31:43.000	387.55	337
URD Outage	PLANNED OUTAGE	2021-11-12 21:38:24.000	19.70	1
UG Other	PLANNED OUTAGE	2021-11-12 23:03:44.000	1,038.30	3
UG Other	PLANNED OUTAGE	2021-11-12 23:59:07.000	488.15	3
UG Other	PLANNED OUTAGE	2021-11-13 08:19:40.000	119,232.22	311
UG Other	PLANNED OUTAGE	2021-11-13 08:32:35.000	95,322.40	258
UG Other	PLANNED OUTAGE	2021-11-13 08:32:45.000	101,425.67	274
UG Other	PLANNED OUTAGE	2021-11-13 08:45:46.000	10,364.60	29
UG Other	PLANNED OUTAGE	2021-11-13 09:36:32.000	6,466.02	19
UG Other	PLANNED OUTAGE	2021-11-13 23:18:53.000	61.33	5
OH Other	PLANNED OUTAGE	2021-11-14 21:49:20.000	47.50	1
OH Other	PLANNED OUTAGE	2021-11-15 08:47:23.000	462.70	2
OH Other	PLANNED OUTAGE	2021-11-15 09:47:04.000	111.83	10
OH Other	PLANNED OUTAGE	2021-11-15 09:51:54.000	1,584.75	9
OH Other	PLANNED OUTAGE	2021-11-15 10:51:08.000	72.80	1
TX Repaired (OH)	PLANNED OUTAGE	2021-11-15 12:15:05.000	583.92	7
OH Other	PLANNED OUTAGE	2021-11-15 13:00:51.000	123.92	1
UG Other	PLANNED OUTAGE	2021-11-16 07:33:26.000	35.37	2
UG Other	PLANNED OUTAGE	2021-11-16 08:08:32.000	6,575.80	244
PLF	PLANNED OUTAGE	2021-11-16 08:23:34.000	15,619.85	53
UG Other	PLANNED OUTAGE	2021-11-16 08:54:57.000	156.18	1
OH Other	PLANNED OUTAGE	2021-11-16 09:14:05.000	297.55	3
OH Other	PLANNED OUTAGE	2021-11-16 09:39:21.000	539.35	1
OH Other	PLANNED OUTAGE	2021-11-16 09:45:22.000	154.70	1
OH Other	PLANNED OUTAGE	2021-11-16 10:14:14.000	92.00	6
UG Other	PLANNED OUTAGE	2021-11-16 10:31:13.000	334.00	12
UG Other	PLANNED OUTAGE	2021-11-16 11:46:43.000	183.05	3
UG Other	PLANNED OUTAGE	2021-11-16 12:43:14.000	263.53	4
OH Other	PLANNED OUTAGE	2021-11-16 21:33:22.000	186.20	7
PLF	PLANNED OUTAGE	2021-11-17 08:16:10.000	2,324.00	15
TX Repaired (PM)	PLANNED OUTAGE	2021-11-17 08:39:55.000	834.00	9
TX Repaired (PM)	PLANNED OUTAGE	2021-11-17 08:49:15.000	727.50	9
OH Other	PLANNED OUTAGE	2021-11-17 09:34:58.000	2,826.13	8
UG Other	PLANNED OUTAGE	2021-11-17 09:45:43.000	94.00	4
UG Other	PLANNED OUTAGE	2021-11-17 10:26:38.000	148.13	4
OCR, Sec	PLANNED OUTAGE	2021-11-17 11:05:21.000	1,365.42	29
UG Other	PLANNED OUTAGE	2021-11-17 11:27:36.000	121.33	4
UG Other	PLANNED OUTAGE	2021-11-17 12:06:41.000	384.92	5
OH Other	PLANNED OUTAGE	2021-11-17 12:37:05.000	51.67	2
UG Other	PLANNED OUTAGE	2021-11-17 14:07:52.000	126.90	9
OH Other	PLANNED OUTAGE	2021-11-17 14:16:18.000	49.07	4
PLF	PLANNED OUTAGE	2021-11-17 16:17:25.000	193.52	1
OH Other	PLANNED OUTAGE	2021-11-17 16:45:25.000	57.50	5

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (PM)	PLANNED OUTAGE	2021-11-17 16:48:05.000	35.55	3
OH Other	PLANNED OUTAGE	2021-11-17 21:37:31.000	842.00	12
PLF	PLANNED OUTAGE	2021-11-17 22:33:12.000	443.47	1
UG Other	PLANNED OUTAGE	2021-11-17 22:36:49.000	206.67	1
UG Other	PLANNED OUTAGE	2021-11-18 09:00:21.000	425.10	9
OH Other	PLANNED OUTAGE	2021-11-18 09:00:35.000	7,599.17	25
UG Other	PLANNED OUTAGE	2021-11-18 09:54:11.000	365.33	8
UG Other	PLANNED OUTAGE	2021-11-18 10:54:48.000	452.00	10
UG Other	PLANNED OUTAGE	2021-11-18 11:31:19.000	1,949.75	5
PLF	PLANNED OUTAGE	2021-11-18 18:43:08.000	139.50	2
TX Repaired (OH)	PLANNED OUTAGE	2021-11-18 20:24:15.000	944.17	11
PLF	PLANNED OUTAGE	2021-11-18 22:03:08.000	45,034.45	119
PLF	PLANNED OUTAGE	2021-11-18 22:03:57.000	376.52	1
TX Repaired (OH)	PLANNED OUTAGE	2021-11-18 22:04:29.000	12.50	1
UG Other	PLANNED OUTAGE	2021-11-19 09:36:05.000	323.55	1
OH Other	PLANNED OUTAGE	2021-11-19 13:37:13.000	923.85	9
OH Other	PLANNED OUTAGE	2021-11-19 14:19:21.000	196.00	12
Circuit Out	PLANNED OUTAGE	2021-11-19 14:54:16.000	1,415.75	809
UG Other	PLANNED OUTAGE	2021-11-19 18:32:37.000	854.75	3
UG Other	PLANNED OUTAGE	2021-11-20 00:23:10.000	99.02	1
OCR, Sec	PLANNED OUTAGE	2021-11-20 14:52:52.000	10,649.22	37
PLF	PLANNED OUTAGE	2021-11-20 18:45:41.000	136.48	1
UG Other	PLANNED OUTAGE	2021-11-21 03:37:07.000	206.20	4
UG Other	PLANNED OUTAGE	2021-11-21 19:56:58.000	364.37	1
UG Other	PLANNED OUTAGE	2021-11-22 09:54:55.000	26.18	1
PLF	PLANNED OUTAGE	2021-11-22 10:13:26.000	7,687.47	16
OH Other	PLANNED OUTAGE	2021-11-22 11:37:14.000	1.87	1
OH Other	PLANNED OUTAGE	2021-11-22 12:22:03.000	43.47	1
OCR, Sec	PLANNED OUTAGE	2021-11-22 14:42:51.000	196.95	13
Circuit Out	PLANNED OUTAGE	2021-11-23 07:28:54.000	2,245.83	539
OH Other	PLANNED OUTAGE	2021-11-23 08:01:29.000	613.65	3
OH Other	PLANNED OUTAGE	2021-11-23 08:32:45.000	297.90	2
OH Other	PLANNED OUTAGE	2021-11-23 08:47:58.000	516.45	3
UG Other	PLANNED OUTAGE	2021-11-23 10:32:41.000	64.00	5
TX Repaired (OH)	PLANNED OUTAGE	2021-11-23 10:42:28.000	70.67	4
Circuit Out	PLANNED OUTAGE	2021-11-23 10:56:13.000	79,156.53	2,584
Circuit Out	PLANNED OUTAGE	2021-11-23 10:56:16.000	113,472.00	3,546
PLF	PLANNED OUTAGE	2021-11-23 12:06:30.000	577.00	3
UG Other	PLANNED OUTAGE	2021-11-23 12:30:49.000	115.00	2
OH Other	PLANNED OUTAGE	2021-11-23 13:21:56.000	58.65	3
UG Other	PLANNED OUTAGE	2021-11-23 15:04:11.000	1,680.00	6
OH Other	PLANNED OUTAGE	2021-11-23 15:33:33.000	6,981.80	42
UG Other	PLANNED OUTAGE	2021-11-23 15:57:18.000	25.82	1
OH Other	PLANNED OUTAGE	2021-11-23 23:16:49.000	613.98	11
OH Other	PLANNED OUTAGE	2021-11-24 08:30:12.000	136.28	1
OH Other	PLANNED OUTAGE	2021-11-24 08:48:09.000	494.25	5
PLF	PLANNED OUTAGE	2021-11-24 08:48:10.000	102.73	2
UG Other	PLANNED OUTAGE	2021-11-24 08:49:22.000	349.83	2
OH Other	PLANNED OUTAGE	2021-11-24 08:52:49.000	1,188.00	8
UG Other	PLANNED OUTAGE	2021-11-24 08:53:40.000	1,485.27	4
UG Other	PLANNED OUTAGE	2021-11-24 10:11:15.000	73.50	2
OH Other	PLANNED OUTAGE	2021-11-24 12:17:22.000	50.10	2
OH Other	PLANNED OUTAGE	2021-11-24 15:17:15.000	182.38	1
UG Other	PLANNED OUTAGE	2021-11-24 15:32:46.000	96.47	1
Service - Non Crew	PLANNED OUTAGE	2021-11-24 19:45:40.000	31.68	1
OH Other	PLANNED OUTAGE	2021-11-24 20:07:15.000	153.20	4

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-11-24 20:07:28.000	306.67	8
UG Other	PLANNED OUTAGE	2021-11-24 20:22:48.000	584.38	7
UG Other	PLANNED OUTAGE	2021-11-24 20:25:17.000	21.42	5
UG Other	PLANNED OUTAGE	2021-11-24 20:26:44.000	59.60	3
OH Other	PLANNED OUTAGE	2021-11-25 02:26:37.000	49.53	4
UG Other	PLANNED OUTAGE	2021-11-25 15:36:28.000	209.50	1
UG Other	PLANNED OUTAGE	2021-11-25 18:24:52.000	292.37	14
OH Other	PLANNED OUTAGE	2021-11-25 20:04:37.000	593.00	10
Primary Wire	PLANNED OUTAGE	2021-11-26 02:59:32.000	1,866.78	3
UG Other	PLANNED OUTAGE	2021-11-26 03:23:52.000	1,611.93	2
OH Other	PLANNED OUTAGE	2021-11-26 05:52:41.000	2,000.25	9
OH Other	PLANNED OUTAGE	2021-11-26 10:46:20.000	740.47	2
PLF	PLANNED OUTAGE	2021-11-27 07:35:58.000	469.40	2
UG Other	PLANNED OUTAGE	2021-11-27 08:54:26.000	17.70	1
OH Other	PLANNED OUTAGE	2021-11-27 10:39:06.000	420.15	3
OH Other	PLANNED OUTAGE	2021-11-29 08:56:51.000	191.63	2
OH Other	PLANNED OUTAGE	2021-11-29 09:41:23.000	19,451.68	55
OH Other	PLANNED OUTAGE	2021-11-29 09:56:45.000	1,414.20	4
OH Other	PLANNED OUTAGE	2021-11-29 11:34:07.000	216.27	2
OH Other	PLANNED OUTAGE	2021-11-29 11:35:59.000	1,492.87	14
PLF	PLANNED OUTAGE	2021-11-29 11:52:58.000	1,213.50	90
OH Other	PLANNED OUTAGE	2021-11-29 12:34:50.000	12.55	1
UG Other	PLANNED OUTAGE	2021-11-29 13:35:23.000	14.20	1
UG Other	PLANNED OUTAGE	2021-11-29 16:14:50.000	117.00	5
OH Other	PLANNED OUTAGE	2021-11-29 16:37:40.000	42.75	5
OH Other	PLANNED OUTAGE	2021-11-30 04:54:51.000	5,078.67	208
UG Other	PLANNED OUTAGE	2021-11-30 08:38:36.000	364.35	7
OH Other	PLANNED OUTAGE	2021-11-30 08:41:43.000	221.00	1
TX Repaired (OH)	PLANNED OUTAGE	2021-11-30 08:42:03.000	378.00	2
OH Other	PLANNED OUTAGE	2021-11-30 08:43:06.000	439.83	2
UG Other	PLANNED OUTAGE	2021-11-30 08:59:12.000	1,702.67	5
UG Other	PLANNED OUTAGE	2021-11-30 09:14:00.000	1,138.10	6
TX Repaired (OH)	PLANNED OUTAGE	2021-11-30 12:19:35.000	241.58	1
OH Other	PLANNED OUTAGE	2021-11-30 13:09:11.000	156.83	5
OH Other	PLANNED OUTAGE	2021-12-01 09:50:14.000	337.13	4
OH Other	PLANNED OUTAGE	2021-12-01 10:39:44.000	725.20	14
OH Other	PLANNED OUTAGE	2021-12-01 10:41:49.000	448.80	9
OH Other	PLANNED OUTAGE	2021-12-01 10:44:22.000	210.90	3
Switch 600 amp	PLANNED OUTAGE	2021-12-01 10:49:08.000	203.85	1
TX Repaired (OH)	PLANNED OUTAGE	2021-12-01 11:58:46.000	52.95	9
Switch 600 amp	PLANNED OUTAGE	2021-12-01 12:12:13.000	215.90	1
OH Other	PLANNED OUTAGE	2021-12-01 14:07:49.000	18.17	1
PLF	PLANNED OUTAGE	2021-12-02 08:43:57.000	2,050.40	11
UG Other	PLANNED OUTAGE	2021-12-02 08:59:18.000	493.97	2
UG Other	PLANNED OUTAGE	2021-12-02 09:00:56.000	24.43	1
TX Repaired (PM)	PLANNED OUTAGE	2021-12-02 09:07:00.000	446.25	7
TX Repaired (OH)	PLANNED OUTAGE	2021-12-02 09:54:23.000	247.60	6
UG Other	PLANNED OUTAGE	2021-12-02 09:54:42.000	1,084.83	10
OH Other	PLANNED OUTAGE	2021-12-02 10:03:14.000	260.28	1
OH Other	PLANNED OUTAGE	2021-12-02 10:26:45.000	5.53	2
OH Other	PLANNED OUTAGE	2021-12-02 10:27:04.000	106.40	3
UG Other	PLANNED OUTAGE	2021-12-02 11:06:27.000	364.47	7
PLF	PLANNED OUTAGE	2021-12-02 11:52:15.000	18.48	1
PLF	PLANNED OUTAGE	2021-12-02 11:52:53.000	458.15	7
OH Other	PLANNED OUTAGE	2021-12-02 12:53:39.000	108.70	2
OH Other	PLANNED OUTAGE	2021-12-02 12:55:27.000	52.68	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
UG Other	PLANNED OUTAGE	2021-12-02 19:47:56.000	845.73	8
PLF	PLANNED OUTAGE	2021-12-03 02:33:46.000	187.32	1
TX Repaired (OH)	PLANNED OUTAGE	2021-12-03 08:51:10.000	391.00	10
TX Repaired (OH)	PLANNED OUTAGE	2021-12-03 09:03:21.000	92.40	7
UG Other	PLANNED OUTAGE	2021-12-03 13:57:20.000	1,015.33	8
Service-Crew	PLANNED OUTAGE	2021-12-03 17:44:58.000	276.83	1
TX Replaced (PM)	PLANNED OUTAGE	2021-12-04 06:56:20.000	385.57	2
TX Replaced (PM)	PLANNED OUTAGE	2021-12-04 06:58:35.000	384.47	2
OH Other	PLANNED OUTAGE	2021-12-04 07:22:54.000	37.05	3
Switchgear	PLANNED OUTAGE	2021-12-04 07:35:31.000	3,551.57	14
OH Other	PLANNED OUTAGE	2021-12-04 11:22:36.000	67.73	16
PLF	PLANNED OUTAGE	2021-12-05 09:19:06.000	2,320.27	11
PLF	PLANNED OUTAGE	2021-12-05 10:17:48.000	85.55	1
OH Other	PLANNED OUTAGE	2021-12-05 14:35:22.000	37,862.80	919
OH Other	PLANNED OUTAGE	2021-12-06 08:44:30.000	695.47	2
UG Other	PLANNED OUTAGE	2021-12-06 08:47:02.000	313.87	1
OH Other	PLANNED OUTAGE	2021-12-06 08:53:54.000	308.15	1
TX Repaired (PM)	PLANNED OUTAGE	2021-12-06 09:05:23.000	946.75	7
OH Other	PLANNED OUTAGE	2021-12-06 09:26:44.000	549.67	2
UG Other	PLANNED OUTAGE	2021-12-06 10:08:08.000	5,126.20	12
UG Other	PLANNED OUTAGE	2021-12-06 10:28:21.000	416.93	8
UG Other	PLANNED OUTAGE	2021-12-06 10:48:51.000	325.73	1
TX Repaired (PM)	PLANNED OUTAGE	2021-12-06 11:05:44.000	46.42	1
OH Other	PLANNED OUTAGE	2021-12-06 11:21:43.000	1,458.42	5
UG Other	PLANNED OUTAGE	2021-12-06 17:15:30.000	1,193.73	7
UG Other	PLANNED OUTAGE	2021-12-06 18:18:02.000	63.22	1
PLF	PLANNED OUTAGE	2021-12-06 23:52:43.000	11,289.67	22
PLF	PLANNED OUTAGE	2021-12-07 00:06:04.000	231.50	1
OH Other	PLANNED OUTAGE	2021-12-07 06:56:15.000	868.20	12
OH Other	PLANNED OUTAGE	2021-12-07 08:52:11.000	3,749.80	12
UG Other	PLANNED OUTAGE	2021-12-07 08:52:46.000	158.57	1
TX Repaired (OH)	PLANNED OUTAGE	2021-12-07 08:56:06.000	304.55	1
TX Repaired (OH)	PLANNED OUTAGE	2021-12-07 08:59:36.000	614.23	2
TX Repaired (OH)	PLANNED OUTAGE	2021-12-07 09:05:26.000	1,799.17	10
PLF	PLANNED OUTAGE	2021-12-07 09:14:28.000	3,045.75	9
OH Other	PLANNED OUTAGE	2021-12-07 09:50:18.000	288.02	1
UG Other	PLANNED OUTAGE	2021-12-07 09:58:29.000	1,344.47	4
OH Other	PLANNED OUTAGE	2021-12-07 10:06:47.000	454.67	11
OH Other	PLANNED OUTAGE	2021-12-07 10:22:39.000	392.23	1
OH Other	PLANNED OUTAGE	2021-12-07 10:55:36.000	135.20	4
OH Other	PLANNED OUTAGE	2021-12-07 11:41:37.000	1,579.35	9
TX Repaired (PM)	PLANNED OUTAGE	2021-12-07 11:51:54.000	542.00	12
UG Other	PLANNED OUTAGE	2021-12-07 12:14:09.000	2,121.87	16
UG Other	PLANNED OUTAGE	2021-12-07 13:03:08.000	150.20	6
PLF	PLANNED OUTAGE	2021-12-07 14:18:32.000	62.30	3
PLF	PLANNED OUTAGE	2021-12-07 16:16:04.000	83.18	23
OCR, Sec	PLANNED OUTAGE	2021-12-07 17:13:51.000	792.18	29
OH Other	PLANNED OUTAGE	2021-12-08 08:24:11.000	725.17	2
TX Repaired (OH)	PLANNED OUTAGE	2021-12-08 08:52:20.000	1,010.33	7
OH Other	PLANNED OUTAGE	2021-12-08 08:52:30.000	1,593.00	10
OH Other	PLANNED OUTAGE	2021-12-08 09:04:14.000	2,066.00	10
UG Other	PLANNED OUTAGE	2021-12-08 09:16:13.000	164.77	1
UG Other	PLANNED OUTAGE	2021-12-08 09:19:43.000	398.20	6
OH Other	PLANNED OUTAGE	2021-12-08 09:37:00.000	202.43	1
OCR, Sec	PLANNED OUTAGE	2021-12-08 11:40:14.000	8,720.40	559
OH Other	PLANNED OUTAGE	2021-12-08 13:58:16.000	338.33	10

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-12-08 14:54:53.000	359.00	12
OH Other	PLANNED OUTAGE	2021-12-08 15:24:16.000	369.47	4
Circuit Out	PLANNED OUTAGE	2021-12-08 16:08:04.000	14,019.83	854
UG Other	PLANNED OUTAGE	2021-12-09 07:40:03.000	14.18	1
UG Other	PLANNED OUTAGE	2021-12-09 08:10:20.000	3,648.75	21
TX Replaced (PM)	PLANNED OUTAGE	2021-12-09 09:13:01.000	269.70	3
UG Other	PLANNED OUTAGE	2021-12-09 09:55:16.000	39.07	1
OH Other	PLANNED OUTAGE	2021-12-09 09:58:55.000	566.93	8
OH Other	PLANNED OUTAGE	2021-12-09 10:17:09.000	3,154.25	11
PLF	PLANNED OUTAGE	2021-12-09 11:45:52.000	2,314.35	3
UG Other	PLANNED OUTAGE	2021-12-09 11:52:29.000	506.60	17
PLF	PLANNED OUTAGE	2021-12-09 15:42:16.000	899.27	18
UG Other	PLANNED OUTAGE	2021-12-09 18:21:56.000	316.32	1
UG Other	PLANNED OUTAGE	2021-12-09 18:44:15.000	865.87	4
UG Other	PLANNED OUTAGE	2021-12-09 19:21:23.000	148.20	4
OH Other	PLANNED OUTAGE	2021-12-10 08:28:39.000	237.77	1
UG Other	PLANNED OUTAGE	2021-12-10 08:44:37.000	879.43	7
UG Other	PLANNED OUTAGE	2021-12-10 09:30:33.000	7,530.40	16
PLF	PLANNED OUTAGE	2021-12-10 09:38:19.000	106.03	2
OH Other	PLANNED OUTAGE	2021-12-10 11:01:12.000	84.58	1
OH Other	PLANNED OUTAGE	2021-12-10 11:51:50.000	474.30	6
OH Other	PLANNED OUTAGE	2021-12-10 12:38:45.000	190.93	16
PLF	PLANNED OUTAGE	2021-12-10 14:48:04.000	432.37	2
Circuit Out	PLANNED OUTAGE	2021-12-10 15:00:35.000	3,565.93	601
Circuit Out	PLANNED OUTAGE	2021-12-11 02:33:04.000	40,462.50	747
OH Other	PLANNED OUTAGE	2021-12-11 02:33:04.000	385.82	7
PLF	PLANNED OUTAGE	2021-12-11 02:33:30.000	415.47	38
UG Other	PLANNED OUTAGE	2021-12-11 07:44:45.000	1,639.07	8
Switch 600 amp	PLANNED OUTAGE	2021-12-11 07:50:50.000	80,196.03	360
UG Other	PLANNED OUTAGE	2021-12-11 15:06:49.000	96.47	4
PLF	PLANNED OUTAGE	2021-12-11 15:58:10.000	180.12	107
OH Other	PLANNED OUTAGE	2021-12-12 08:13:21.000	202.77	14
OH Other	PLANNED OUTAGE	2021-12-12 14:13:53.000	136.80	8
PLF	PLANNED OUTAGE	2021-12-13 08:47:13.000	3,194.33	70
PLF	PLANNED OUTAGE	2021-12-13 08:47:24.000	1,973.45	29
PLF	PLANNED OUTAGE	2021-12-13 09:19:03.000	1,657.60	12
PLF	PLANNED OUTAGE	2021-12-13 09:29:09.000	8,076.13	28
PLF	PLANNED OUTAGE	2021-12-13 09:29:17.000	8,644.00	30
PLF	PLANNED OUTAGE	2021-12-13 09:50:23.000	31.85	1
PLF	PLANNED OUTAGE	2021-12-13 10:07:55.000	9,258.70	19
OH Other	PLANNED OUTAGE	2021-12-13 11:16:26.000	438.00	5
PLF	PLANNED OUTAGE	2021-12-13 11:19:17.000	229.83	1
PLF	PLANNED OUTAGE	2021-12-13 12:25:44.000	3,690.70	34
UG Other	PLANNED OUTAGE	2021-12-13 13:00:31.000	147.07	2
OH Other	PLANNED OUTAGE	2021-12-13 13:38:41.000	319.48	29
UG Other	PLANNED OUTAGE	2021-12-13 18:42:11.000	2,020.00	12
OH Other	PLANNED OUTAGE	2021-12-14 08:50:21.000	562.70	2
UG Other	PLANNED OUTAGE	2021-12-14 09:26:25.000	75.57	1
OH Other	PLANNED OUTAGE	2021-12-14 09:47:32.000	254.98	1
UG Other	PLANNED OUTAGE	2021-12-14 09:57:33.000	399.75	195
UG Other	PLANNED OUTAGE	2021-12-14 09:59:45.000	370.50	195
OH Other	PLANNED OUTAGE	2021-12-14 10:31:49.000	997.15	7
UG Other	PLANNED OUTAGE	2021-12-14 10:40:27.000	1,891.40	6
OH Other	PLANNED OUTAGE	2021-12-14 11:59:12.000	8.27	1
OH Other	PLANNED OUTAGE	2021-12-14 12:36:13.000	338.50	6
PLF	PLANNED OUTAGE	2021-12-14 12:54:01.000	763.60	24

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-12-14 13:04:22.000	24.27	1
OH Other	PLANNED OUTAGE	2021-12-14 14:54:53.000	39.73	4
UG Other	PLANNED OUTAGE	2021-12-14 20:54:11.000	249.07	2
OH Other	PLANNED OUTAGE	2021-12-15 08:02:53.000	1,925.50	5
UG Other	PLANNED OUTAGE	2021-12-15 08:21:21.000	144.77	1
UG Other	PLANNED OUTAGE	2021-12-15 08:43:52.000	7,107.98	17
OCR, Sec	PLANNED OUTAGE	2021-12-15 08:48:29.000	10,962.22	127
PLF	PLANNED OUTAGE	2021-12-15 09:17:11.000	315.33	2
UG Other	PLANNED OUTAGE	2021-12-15 09:36:24.000	895.30	7
TX Repaired (OH)	PLANNED OUTAGE	2021-12-15 10:17:07.000	1,053.00	18
Service - Non Crew	PLANNED OUTAGE	2021-12-15 10:31:59.000	20.30	1
PLF	PLANNED OUTAGE	2021-12-15 10:46:24.000	3,838.10	21
PLF	PLANNED OUTAGE	2021-12-15 11:27:10.000	196.73	4
#REF!	PLANNED OUTAGE	2021-12-15 11:53:08.000	1,028.87	11
OH Other	PLANNED OUTAGE	2021-12-16 07:57:18.000	1,664.80	12
PLF	PLANNED OUTAGE	2021-12-16 08:24:01.000	4,932.37	73
PLF	PLANNED OUTAGE	2021-12-16 08:24:40.000	1,941.20	69
OH Other	PLANNED OUTAGE	2021-12-16 08:28:15.000	691.60	2
PLF	PLANNED OUTAGE	2021-12-16 08:34:51.000	339.08	1
PLF	PLANNED OUTAGE	2021-12-16 08:52:54.000	4,217.20	104
OH Other	PLANNED OUTAGE	2021-12-16 09:04:37.000	232.37	2
OH Other	PLANNED OUTAGE	2021-12-16 09:30:44.000	30.80	1
UG Other	PLANNED OUTAGE	2021-12-16 09:39:13.000	3,115.35	189
PLF	PLANNED OUTAGE	2021-12-16 10:08:47.000	48.35	1
UG Other	PLANNED OUTAGE	2021-12-16 10:15:25.000	2,243.20	48
UG Other	PLANNED OUTAGE	2021-12-16 10:15:36.000	1,212.47	26
UG Other	PLANNED OUTAGE	2021-12-16 12:26:16.000	690.32	7
UG Other	PLANNED OUTAGE	2021-12-16 12:27:28.000	746.00	8
OH Other	PLANNED OUTAGE	2021-12-16 12:42:39.000	2,769.00	45
Circuit Out	PLANNED OUTAGE	2021-12-16 14:19:45.000	6,462.17	1,337
Pole	PLANNED OUTAGE	2021-12-16 16:11:41.000	151.67	2
OH Other	PLANNED OUTAGE	2021-12-16 22:26:22.000	722.15	3
PLF	PLANNED OUTAGE	2021-12-17 08:20:56.000	10,348.10	42
PLF	PLANNED OUTAGE	2021-12-17 10:22:58.000	1,438.50	45
OH Other	PLANNED OUTAGE	2021-12-17 12:06:27.000	92.67	8
UG Other	PLANNED OUTAGE	2021-12-18 04:29:12.000	39.27	1
OH Other	PLANNED OUTAGE	2021-12-18 10:10:49.000	267.43	1
OH Other	PLANNED OUTAGE	2021-12-18 11:39:29.000	1,488.43	7
UG Other	PLANNED OUTAGE	2021-12-18 18:13:19.000	61.80	12
UG Other	PLANNED OUTAGE	2021-12-18 19:30:29.000	2,478.00	12
Circuit Out	PLANNED OUTAGE	2021-12-19 11:05:05.000	908.80	426
OH Other	PLANNED OUTAGE	2021-12-19 14:05:50.000	1,944.97	74
UG Other	PLANNED OUTAGE	2021-12-19 14:46:29.000	170.50	11
OH Other	PLANNED OUTAGE	2021-12-19 17:34:46.000	132.42	7
OH Other	PLANNED OUTAGE	2021-12-19 19:27:18.000	1,446.50	12
OH Other	PLANNED OUTAGE	2021-12-19 22:36:04.000	432.17	5
UG Other	PLANNED OUTAGE	2021-12-19 23:52:41.000	629.25	5
UG Other	PLANNED OUTAGE	2021-12-20 09:17:54.000	284.93	1
UG Other	PLANNED OUTAGE	2021-12-20 09:22:55.000	78.92	1
OH Other	PLANNED OUTAGE	2021-12-20 09:25:50.000	328.45	1
OH Other	PLANNED OUTAGE	2021-12-20 09:31:20.000	221.93	1
OH Other	PLANNED OUTAGE	2021-12-20 09:40:57.000	4,273.75	13
UG Other	PLANNED OUTAGE	2021-12-20 09:53:13.000	304.62	1
OH Other	PLANNED OUTAGE	2021-12-20 11:11:00.000	375.00	4
TX Repaired (OH)	PLANNED OUTAGE	2021-12-20 11:24:47.000	870.80	6
OH Other	PLANNED OUTAGE	2021-12-20 11:51:20.000	147.75	1

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-12-21 12:04:10.000	53.13	4
OCR, Sec	PLANNED OUTAGE	2021-12-22 02:47:10.000	5,024.40	53
UG Other	PLANNED OUTAGE	2021-12-22 04:58:43.000	21.62	1
PLF	PLANNED OUTAGE	2021-12-22 08:19:00.000	367.47	8
OH Other	PLANNED OUTAGE	2021-12-22 08:36:18.000	182.07	2
UG Other	PLANNED OUTAGE	2021-12-22 08:39:36.000	73.03	1
PLF	PLANNED OUTAGE	2021-12-22 09:16:04.000	207.43	1
UG Other	PLANNED OUTAGE	2021-12-22 09:20:35.000	113.63	1
OH Other	PLANNED OUTAGE	2021-12-22 09:24:20.000	1,088.27	16
PLF	PLANNED OUTAGE	2021-12-22 09:30:59.000	222.12	1
PLF	PLANNED OUTAGE	2021-12-22 09:31:53.000	721.50	10
UG Other	PLANNED OUTAGE	2021-12-22 10:42:55.000	6.75	1
PLF	PLANNED OUTAGE	2021-12-22 11:25:31.000	1,688.70	26
OH Other	PLANNED OUTAGE	2021-12-22 16:03:05.000	45.87	4
TX Repaired (OH)	PLANNED OUTAGE	2021-12-22 18:24:36.000	667.82	17
TX Repaired (PM)	PLANNED OUTAGE	2021-12-23 08:14:14.000	221.20	3
TX Repaired (PM)	PLANNED OUTAGE	2021-12-23 08:27:25.000	335.80	6
TX Repaired (PM)	PLANNED OUTAGE	2021-12-23 08:33:29.000	350.87	4
TX Repaired (PM)	PLANNED OUTAGE	2021-12-23 09:02:33.000	251.00	4
TX Repaired (PM)	PLANNED OUTAGE	2021-12-23 09:35:20.000	241.40	4
TX Repaired (PM)	PLANNED OUTAGE	2021-12-23 09:49:31.000	477.63	7
UG Other	PLANNED OUTAGE	2021-12-23 11:03:25.000	48.73	34
OH Other	PLANNED OUTAGE	2021-12-23 12:43:22.000	837.83	5
OH Other	PLANNED OUTAGE	2021-12-23 19:37:24.000	107.25	9
Primary Wire	PLANNED OUTAGE	2021-12-23 22:13:41.000	66.00	1
PLF	PLANNED OUTAGE	2021-12-25 09:18:21.000	1,798.30	21
PLF	PLANNED OUTAGE	2021-12-25 10:08:51.000	279.07	14
OH Other	PLANNED OUTAGE	2021-12-25 21:01:50.000	352.73	11
PLF	PLANNED OUTAGE	2021-12-26 09:21:40.000	213.67	5
TX Repaired (PM)	PLANNED OUTAGE	2021-12-26 14:42:44.000	114.93	4
TX Repaired (OH)	PLANNED OUTAGE	2021-12-26 16:10:35.000	458.33	11
UG Other	PLANNED OUTAGE	2021-12-26 21:22:03.000	169.57	1
PLF	PLANNED OUTAGE	2021-12-27 02:25:47.000	44.55	1
TX Repaired (OH)	PLANNED OUTAGE	2021-12-27 08:44:00.000	2,630.77	13
TX Repaired (PM)	PLANNED OUTAGE	2021-12-27 08:44:29.000	237.90	6
UG Other	PLANNED OUTAGE	2021-12-27 09:18:17.000	1,057.70	3
TX Repaired (PM)	PLANNED OUTAGE	2021-12-27 09:39:42.000	360.58	5
UG Other	PLANNED OUTAGE	2021-12-27 09:41:37.000	1,272.60	12
UG Other	PLANNED OUTAGE	2021-12-27 10:04:34.000	492.30	6
OH Other	PLANNED OUTAGE	2021-12-27 10:23:09.000	19.48	1
Oil Switch	PLANNED OUTAGE	2021-12-27 10:25:17.000	35.33	2
PLF	PLANNED OUTAGE	2021-12-27 10:30:11.000	311.53	1
PLF	PLANNED OUTAGE	2021-12-27 10:31:31.000	256.12	1
UG Other	PLANNED OUTAGE	2021-12-27 11:11:15.000	309.92	5
PLF	PLANNED OUTAGE	2021-12-27 11:57:05.000	143.55	1
UG Other	PLANNED OUTAGE	2021-12-27 11:57:19.000	598.50	9
UG Other	PLANNED OUTAGE	2021-12-27 13:34:44.000	274.20	4
PLF	PLANNED OUTAGE	2021-12-27 13:50:38.000	2,549.25	165
OH Other	PLANNED OUTAGE	2021-12-27 14:10:25.000	10.33	1
PLF	PLANNED OUTAGE	2021-12-27 14:27:52.000	24.28	1
OH Other	PLANNED OUTAGE	2021-12-27 15:23:19.000	2.72	1
TX Repaired (OH)	PLANNED OUTAGE	2021-12-27 15:23:43.000	4.82	1
PLF	PLANNED OUTAGE	2021-12-27 16:01:29.000	66.48	1
PLF	PLANNED OUTAGE	2021-12-27 17:55:10.000	333.90	3
PLF	PLANNED OUTAGE	2021-12-27 19:02:40.000	280.70	6
PLF	PLANNED OUTAGE	2021-12-27 22:43:08.000	3,516.95	45

2021 Annual Reliability Performance Report

2021 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	2021-12-28 08:22:02.000	1,153.65	9
UG Other	PLANNED OUTAGE	2021-12-28 08:42:35.000	387.07	4
UG Other	PLANNED OUTAGE	2021-12-28 08:49:24.000	513.60	6
OH Other	PLANNED OUTAGE	2021-12-28 09:07:32.000	1,240.60	6
UG Other	PLANNED OUTAGE	2021-12-28 10:43:15.000	666.98	7
OH Other	PLANNED OUTAGE	2021-12-28 10:50:58.000	1,519.50	9
PLF	PLANNED OUTAGE	2021-12-28 11:31:17.000	837.60	16
UG Other	PLANNED OUTAGE	2021-12-28 12:12:02.000	39.35	1
UG Other	PLANNED OUTAGE	2021-12-28 12:56:48.000	339.90	6
UG Other	PLANNED OUTAGE	2021-12-28 12:56:58.000	283.33	5
UG Other	PLANNED OUTAGE	2021-12-28 13:01:56.000	944.27	8
OH Other	PLANNED OUTAGE	2021-12-28 13:23:24.000	96.43	2
OH Other	PLANNED OUTAGE	2021-12-28 14:03:06.000	45.88	1
UG Other	PLANNED OUTAGE	2021-12-28 20:50:24.000	997.58	5
OH Other	PLANNED OUTAGE	2021-12-28 23:36:52.000	58.22	7
OH Other	PLANNED OUTAGE	2021-12-29 01:10:47.000	30,172.63	781
OH Other	PLANNED OUTAGE	2021-12-29 08:18:16.000	315.47	1
UG Other	PLANNED OUTAGE	2021-12-29 08:22:30.000	299.00	3
OH Other	PLANNED OUTAGE	2021-12-29 08:29:23.000	1,253.47	7
OH Other	PLANNED OUTAGE	2021-12-29 09:04:04.000	231.25	5
UG Other	PLANNED OUTAGE	2021-12-29 09:13:20.000	478.92	7
UG Other	PLANNED OUTAGE	2021-12-29 09:24:26.000	387.60	8
OH Other	PLANNED OUTAGE	2021-12-29 09:53:35.000	431.15	1
UG Other	PLANNED OUTAGE	2021-12-29 10:25:13.000	175.80	4
UG Other	PLANNED OUTAGE	2021-12-29 11:23:55.000	28.50	3
UG Other	PLANNED OUTAGE	2021-12-29 11:26:40.000	375.43	7
UG Other	PLANNED OUTAGE	2021-12-29 11:29:45.000	2.45	1
OH Other	PLANNED OUTAGE	2021-12-29 11:33:35.000	717.75	11
UG Other	PLANNED OUTAGE	2021-12-29 11:42:16.000	866.25	11
UG Other	PLANNED OUTAGE	2021-12-29 11:45:36.000	95.55	21
UG Other	PLANNED OUTAGE	2021-12-29 12:30:53.000	416.53	8
OH Other	PLANNED OUTAGE	2021-12-29 13:49:57.000	687.05	13
UG Other	PLANNED OUTAGE	2021-12-29 20:56:58.000	1,098.60	3
OH Other	PLANNED OUTAGE	2021-12-29 21:09:51.000	194.55	3
UG Other	PLANNED OUTAGE	2021-12-30 06:13:00.000	676.08	5
UG Other	PLANNED OUTAGE	2021-12-30 08:25:32.000	688.50	6
UG Other	PLANNED OUTAGE	2021-12-30 09:04:14.000	659.98	7
UG Other	PLANNED OUTAGE	2021-12-30 09:19:01.000	356.50	5
UG Other	PLANNED OUTAGE	2021-12-30 11:19:42.000	2,293.62	19

2021 Annual Reliability Performance Report

2021 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	2021-01-01 02:49:14.000	2,364.62	31
Substation	FPSC Commission Rule 26-6.0455	2021-01-08 07:18:26.000	85,213.77	1,049
Substation	FPSC Commission Rule 26-6.0455	2021-01-08 09:22:45.000	1,920.00	1,280
Substation	FPSC Commission Rule 26-6.0455	2021-01-09 13:16:45.000	3,065.33	484
Substation	FPSC Commission Rule 26-6.0455	2021-01-13 20:32:28.000	40,680.67	695
Substation	FPSC Commission Rule 26-6.0455	2021-02-04 05:45:17.000	2,525.22	1,471
Substation	FPSC Commission Rule 26-6.0455	2021-02-05 03:14:57.000	61,712.73	1,846
Substation	FPSC Commission Rule 26-6.0455	2021-02-05 03:15:36.000	21.30	1
Substation	FPSC Commission Rule 26-6.0455	2021-02-09 16:59:56.000	228,114.88	4,804
Substation	FPSC Commission Rule 26-6.0455	2021-02-09 17:00:27.000	16,056.90	1,878
Substation	FPSC Commission Rule 26-6.0455	2021-02-09 17:00:47.000	87,684.07	1,588
Substation	FPSC Commission Rule 26-6.0455	2021-02-09 17:00:48.000	24,998.60	1,033
Substation	FPSC Commission Rule 26-6.0455	2021-02-09 17:00:56.000	45,374.93	824
Substation	FPSC Commission Rule 26-6.0455	2021-02-11 07:12:10.000	50,676.00	1,236
Substation	FPSC Commission Rule 26-6.0455	2021-02-11 07:12:15.000	73,838.92	1,391
Substation	FPSC Commission Rule 26-6.0455	2021-03-21 12:06:12.000	60,005.60	1,257
Substation	FPSC Commission Rule 26-6.0455	2021-03-29 18:31:46.000	14,560.00	312
Substation	FPSC Commission Rule 26-6.0455	2021-04-01 10:47:00.000	14,264.00	1,783
Substation	FPSC Commission Rule 26-6.0455	2021-05-02 03:13:20.000	160,769.60	2,258
Substation	FPSC Commission Rule 26-6.0455	2021-05-03 14:25:05.000	4,158.00	1,485
Substation	FPSC Commission Rule 26-6.0455	2021-05-05 10:16:00.000	315.70	154
Substation	FPSC Commission Rule 26-6.0455	2021-05-14 09:56:26.000	10,710.67	2,588
Substation	FPSC Commission Rule 26-6.0455	2021-05-14 10:04:39.000	7,874.13	2,588
Substation	FPSC Commission Rule 26-6.0455	2021-06-02 06:54:15.000	4,422.40	2,073
Substation	FPSC Commission Rule 26-6.0455	2021-06-02 08:19:59.000	1,752.00	1,168
Substation	FPSC Commission Rule 26-6.0455	2021-06-02 18:35:37.000	8,554.42	488
Substation	FPSC Commission Rule 26-6.0455	2021-06-02 19:47:01.000	1,352.00	78
Substation	FPSC Commission Rule 26-6.0455	2021-06-13 09:00:50.000	3,406.17	1,910
Substation	FPSC Commission Rule 26-6.0455	2021-06-13 12:35:00.000	14,124.93	3,016
Substation	FPSC Commission Rule 26-6.0455	2021-06-13 12:35:10.000	13,677.20	3,309
Substation	FPSC Commission Rule 26-6.0455	2021-06-21 21:41:09.000	22,414.10	786
Substation	FPSC Commission Rule 26-6.0455	2021-06-22 20:46:16.000	110,431.30	1,454
Substation	FPSC Commission Rule 26-6.0455	2021-06-22 23:28:59.000	294,749.40	3,366
Substation	FPSC Commission Rule 26-6.0455	2021-06-22 23:29:15.000	56,531.67	634
Substation	FPSC Commission Rule 26-6.0455	2021-06-23 23:22:30.000	482,287.13	3,692
Substation	FPSC Commission Rule 26-6.0455	2021-06-25 03:03:09.000	5,251.73	688
Substation	FPSC Commission Rule 26-6.0455	2021-06-25 03:03:25.000	68,343.60	1,348
Substation	FPSC Commission Rule 26-6.0455	2021-06-25 03:04:22.000	2,173.17	1,105
Substation	FPSC Commission Rule 26-6.0455	2021-06-25 03:04:23.000	55,707.35	1,149
Substation	FPSC Commission Rule 26-6.0455	2021-06-25 18:07:05.000	9,820.90	3,706
Substation	FPSC Commission Rule 26-6.0455	2021-06-25 18:09:05.000	8,800.90	1,054
Substation	FPSC Commission Rule 26-6.0455	2021-06-25 18:09:44.000	148,443.10	1,283
Substation	FPSC Commission Rule 26-6.0455	2021-06-25 18:10:18.000	203,690.10	2,463
Substation	FPSC Commission Rule 26-6.0455	2021-07-03 07:23:26.000	75,418.55	1,437
Substation	FPSC Commission Rule 26-6.0455	2021-07-03 07:24:15.000	119,338.92	2,993
Substation	FPSC Commission Rule 26-6.0455	2021-07-03 07:24:29.000	254,789.87	3,240
Substation	FPSC Commission Rule 26-6.0455	2021-07-06 06:07:45.000	237,728.45	1,226
Substation	FPSC Commission Rule 26-6.0455	2021-07-09 14:31:05.000	20,324.60	2,019
Substation	FPSC Commission Rule 26-6.0455	2021-07-11 08:05:04.000	1,920.80	686
Substation	FPSC Commission Rule 26-6.0455	2021-07-11 17:20:16.000	20,033.77	322
Substation	FPSC Commission Rule 26-6.0455	2021-07-21 20:25:09.000	4,687.45	1,167
Substation	FPSC Commission Rule 26-6.0455	2021-07-25 16:00:04.000	81,451.00	3,662
Substation	FPSC Commission Rule 26-6.0455	2021-07-28 10:35:52.000	25,492.80	1,692
Substation	FPSC Commission Rule 26-6.0455	2021-07-28 10:36:24.000	72,320.73	1,274
Substation	FPSC Commission Rule 26-6.0455	2021-07-28 10:36:35.000	16,938.72	1,379

2021 Annual Reliability Performance Report

2021 Adjustments: Substation Outage Events

Substation	FPSC Commission Rule 26-6.0455	2021-08-11 03:56:44.000	877.30	6
Substation	FPSC Commission Rule 26-6.0455	2021-08-14 19:29:20.000	12,734.28	503
Substation	FPSC Commission Rule 26-6.0455	2021-08-31 20:19:48.000	320,453.17	4,512
Substation	FPSC Commission Rule 26-6.0455	2021-09-04 15:39:57.000	987.70	714
Substation	FPSC Commission Rule 26-6.0455	2021-10-14 17:39:49.000	138,224.45	3,687
Substation	FPSC Commission Rule 26-6.0455	2021-10-30 01:07:14.000	10,751.03	481
Substation	FPSC Commission Rule 26-6.0455	2021-11-22 10:27:45.000	3,024.45	1,269
Substation	FPSC Commission Rule 26-6.0455	2021-11-22 10:27:49.000	3,157.17	1,121

2021 Adjustments: Transmission Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
None				

Feeder Specific and Attached Laterals Data

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13001	SHA	N/A	12.344	835	80875	777	N/A	5.313	654	3311	34	0
13002	SHA	N/A	0.257	23	477	1	N/A	0.603	9	0	0	1
13003	SHA	N/A	23.811	598	62961	775	N/A	2.475	202	6561	41	0
13004	DCA	N/A	9.947	531	59680	478	N/A	11.792	707	384	1	0
13005	DCA	N/A	6.304	269	62901	272	N/A	2.704	421	23759	65	0
13006	DCA	N/A	23.172	832	59284	416	N/A	10.489	888	912	12	12
13007	PCA	N/A	29.465	496	192809	1294	N/A	3.954	59	301	1	0
13008	PCA	N/A	17.457	436	8259	187	N/A	1.553	11	0	0	0
13009	PCA	N/A	3.012	73	7902	91	N/A	0.992	42	0	0	0
13010	PCA	N/A	7.707	498	137727	1533	N/A	11.820	1143	4166	29	9
13011	PCA	N/A	27.219	1580	308151	3282	N/A	1.059	90	0	0	13
13012	WSA	N/A	0.449	56	0	0	N/A	0.113	6	0	0	0
13013	WSA	N/A	0.174	15	32	3	N/A	1.438	163	0	0	0
13014	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13016	WSA	N/A	0.778	153	7098	39	N/A	0.688	49	7	1	0
13017	SHA	N/A	8.393	378	29806	339	N/A	9.752	1142	11223	56	7
13018	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13019	SHA	N/A	11.248	698	5014	27	N/A	9.624	815	395	1	12
13020	SHA	N/A	17.573	1351	64212	768	N/A	15.350	1287	0	0	8
13021	CSA	N/A	3.473	233	5794	73	N/A	5.556	1056	19258	158	0
13022	CSA	N/A	3.284	464	9082	122	N/A	0.705	326	11954	57	0
13023	CSA	N/A	8.361	1017	27296	240	N/A	2.170	401	65	1	1
13024	CSA	N/A	7.482	859	19356	86	N/A	1.241	179	1670	26	0
13026	CSA	N/A	3.043	296	3085	54	N/A	5.048	1569	30438	166	7
13027	CSA	N/A	9.077	699	19276	89	N/A	1.942	319	2071	53	9
13028	CSA	N/A	5.412	599	106434	1114	N/A	4.583	1495	2816	46	12
13029	CSA	N/A	5.949	526	10128	85	N/A	3.109	568	1057	8	0
13030	WHA	N/A	29.143	955	35810	603	N/A	13.631	867	6318	62	13
13031	WHA	N/A	12.835	557	49670	422	N/A	5.467	304	0	0	0
13034	CSA	N/A	9.952	1311	11215	156	N/A	0.725	167	307	1	0
13035	CSA	N/A	4.985	503	11047	106	N/A	0.711	85	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Through December 31, 2021
2	Yes	4.402	0.096	0	0	0	4.306	147	58174	3773	12%	6.98
0	Yes	3.106	2.415	0	0	0	0.691	0	0	0	8%	5.27
2	Yes	7.853	0.029	0	0	0	7.824	109	24059	563	-1%	3.89
1	Yes	4.265	0.000	0	0	0	4.265	110	4493	1172	10%	7.08
0	Yes	1.670	0.282	0	0	0	1.388	34	48192	579	8%	3.88
5	Yes	6.093	0.166	0	0	0	5.927	102	0	0	4%	7.22
3	Yes	3.563	0.251	0	0	0	3.312	33	73265	1208	6%	6.34
0	Yes	0.890	0.014	0	0	0	0.876	1	24204	447	-5%	2.62
1	Yes	2.263	0.091	0	0	0	2.173	36	35826	126	-3%	3.27
3	Yes	5.420	0.823	0	19912	608	4.597	108	129767	3437	3%	7.23
5	Yes	6.138	0.425	0	0	0	5.713	92	25415	2018	-11%	6.21
0	Yes	0.557	0.090	0	0	0	0.467	24	0	0	-5%	0.85
0	Yes	1.505	0.819	0	0	0	0.687	87	0	0	1%	3.57
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.237	0.395	0	0	0	0.843	30	17763	259	-6%	3.82
0	Yes	2.641	0.682	22	0	0	1.959	36	0	0	-37%	6.25
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
2	Yes	4.330	1.077	87	0	0	3.252	31	0	0	-4%	8.61
0	Yes	6.991	1.070	42	0	0	5.921	197	172674	8326	111%	10.91
0	Yes	3.171	0.210	0	105	2	2.961	81	46596	4127	-12%	6.16
0	Yes	0.923	0.106	0	0	0	0.817	18	31265	802	-7%	2.32
1	Yes	2.508	0.098	0	0	0	2.411	109	0	0	3%	6.07
0	Yes	1.885	0.122	0	0	0	1.763	95	0	0	-4%	4.36
3	Yes	1.286	0.045	0	0	0	1.241	78	100794	1930	-1%	5.72
4	Yes	1.195	0.455	0	42642	1049	0.740	37	0	0	2%	4.79
4	Yes	1.798	0.231	0	0	0	1.567	33	201603	1924	2%	6.27
0	Yes	1.220	0.291	0	0	0	0.928	33	17731	1506	11%	5.39
2	Yes	5.345	0.095	0	0	0	5.250	84	0	0	4%	8.39
1	Yes	4.539	0.000	0	0	0	4.539	58	970785	808	2%	3.19
0	Yes	1.900	0.038	0	0	0	1.862	127	64598	1573	-5%	4.96
2	Yes	2.266	0.019	0	0	0	2.247	98	28942	688	-5%	5.01

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13036	CSA	N/A	8.791	1004	80271	747	N/A	2.182	261	35115	96	0
13037	CSA	N/A	5.489	613	3412	25	N/A	1.663	339	0	0	0
13038	ESA	N/A	6.201	363	15304	212	N/A	4.006	218	821	17	0
13039	ESA	N/A	7.297	475	20317	244	N/A	8.374	753	7023	65	0
13040	ESA	N/A	0.351	7	17597	154	N/A	13.343	1071	4240	80	0
13041	ESA	N/A	5.719	335	110294	1733	N/A	14.884	1026	9757	73	0
13042	CSA	N/A	8.174	1200	37980	456	N/A	0.244	91	0	0	3
13043	CSA	N/A	12.488	1804	64517	404	N/A	1.283	401	0	0	0
13044	CSA	N/A	12.331	1788	173700	1680	N/A	0.377	89	0	0	1
13045	CSA	N/A	6.867	1013	32117	306	N/A	0.054	17	0	0	0
13046	CSA	N/A	8.035	1202	18219	173	N/A	0.111	5	0	0	0
13047	CSA	N/A	3.858	618	13685	59	N/A	0.267	166	0	0	0
13048	CSA	N/A	8.434	1325	19236	232	N/A	0.356	25	0	0	0
13049	CSA	N/A	5.678	732	2295	9	N/A	2.084	499	0	0	0
13050	CSA	N/A	0.050	0	0	0	N/A	0.892	27	2529	33	0
13051	CSA	N/A	1.422	98	8202	104	N/A	4.410	850	532	2	0
13052	CSA	N/A	0.643	40	0	0	N/A	0.625	144	0	0	0
13053	CSA	N/A	9.062	1280	33266	577	N/A	1.993	314	3708	16	0
13054	CSA	N/A	0.121	0	0	0	N/A	1.204	440	0	0	0
13055	CSA	N/A	0.123	0	0	0	N/A	0.381	24	0	0	0
13057	CSA	N/A	0.181	4	10636	162	N/A	0.820	178	0	0	0
13059	WSA	N/A	6.420	950	126573	2157	N/A	0.638	139	0	0	0
13060	WSA	N/A	4.687	800	20149	281	N/A	1.943	568	0	0	0
13061	WSA	N/A	3.527	456	4496	36	N/A	0.386	30	172	24	0
13062	WSA	N/A	4.845	585	1024	12	N/A	0.147	15	27	1	0
13063	WSA	N/A	5.731	499	14654	121	N/A	7.262	1494	173	2	0
13064	WSA	N/A	8.897	1016	139907	2168	N/A	4.756	724	0	0	8
13065	WSA	N/A	8.910	1103	34517	257	N/A	2.177	470	631	15	0
13066	WSA	N/A	2.954	461	20821	366	N/A	0.000	0	0	0	0
13067	WSA	N/A	5.324	681	14033	222	N/A	0.423	4	53	1	0
13068	WSA	N/A	5.552	861	54619	347	N/A	1.553	348	212	1	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded Through December 31, 2021
0	Yes	3.082	0.732	0	0	0	2.350	122	118980	2752	6%	6.14
0	Yes	2.895	0.078	0	0	0	2.817	175	74176	1140	-1%	4.65
0	Yes	2.556	0.212	0	0	0	2.344	67	0	0	10%	4.25
1	Yes	3.075	0.073	0	0	0	3.002	60	0	0	7%	6.67
0	Yes	2.688	1.907	0	0	0	0.781	3	0	0	-9%	5.76
1	Yes	5.172	0.313	0	0	0	4.859	111	2029	556	17%	9.47
2	Yes	2.660	0.055	0	0	0	2.605	193	0	0	1%	5.10
0	Yes	2.034	0.046	0	0	0	1.988	162	0	0	-4%	8.34
0	Yes	0.889	0.029	0	0	0	0.860	62	0	0	-9%	7.47
0	Yes	1.969	0.106	0	0	0	1.863	183	0	0	-3%	4.62
0	Yes	3.073	0.000	0	0	0	3.073	275	49571	1481	-4%	5.19
0	Yes	1.319	0.071	0	0	0	1.247	104	0	0	0%	3.07
0	Yes	2.453	0.132	0	0	0	2.321	202	0	0	-3%	5.79
0	Yes	1.686	0.051	0	0	0	1.634	139	0	0	-8%	4.33
0	Yes	1.980	1.539	0	0	0	0.442	2	0	0	4%	5.43
2	Yes	1.997	0.148	0	0	0	1.849	53	1451	1102	17%	4.88
0	Yes	1.762	0.087	0	0	0	1.674	13	0	0	8%	6.55
0	Yes	2.499	0.126	0	0	0	2.373	153	0	0	95%	12.31
0	Yes	1.553	0.538	0	0	0	1.015	8	2860	448	5%	2.21
0	Yes	3.417	1.485	0	0	0	1.932	8	0	0	-13%	3.19
0	Yes	1.534	0.146	0	0	0	1.388	8	4438	192	-8%	7.55
0	Yes	2.013	0.088	0	0	0	1.925	172	0	0	9%	5.26
0	Yes	1.922	0.000	0	0	0	1.922	144	61661	1460	6%	5.72
0	Yes	2.181	0.000	0	0	0	2.181	191	35611	1318	1%	2.94
0	Yes	1.817	0.000	0	0	0	1.817	138	0	0	8%	2.71
1	Yes	2.857	0.000	0	0	0	2.857	166	0	0	-4%	6.97
1	Yes	1.990	0.000	0	0	0	1.990	184	0	0	5%	8.72
0	Yes	0.596	0.000	0	0	0	0.596	61	0	0	-1%	6.19
0	Yes	0.587	0.051	0	0	0	0.536	76	0	0	-3%	2.14
0	Yes	1.552	0.368	0	0	0	1.184	78	0	0	8%	6.80
0	Yes	1.277	0.029	0	0	0	1.249	63	0	0	-3%	5.02

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13069	WSA	N/A	3.909	559	19281	162	N/A	1.096	369	334	1	0
13070	WSA	N/A	13.268	385	92913	1001	N/A	5.857	194	124	1	0
13071	WSA	N/A	6.362	132	45725	524	N/A	17.860	1248	112530	1197	0
13072	WSA	N/A	6.432	700	67379	395	N/A	0.469	11	0	0	0
13073	WSA	N/A	3.429	419	55485	341	N/A	7.023	347	2121	22	4
13076	WSA	N/A	2.164	103	26275	165	N/A	1.512	93	4673	55	0
13077	WSA	N/A	8.246	678	105835	764	N/A	1.851	45	0	0	0
13078	WSA	N/A	7.248	1051	29386	409	N/A	0.309	89	0	0	0
13079	WSA	N/A	4.570	552	8853	149	N/A	2.584	550	9142	105	0
13080	WSA	N/A	7.953	1119	164221	864	N/A	1.241	543	907	9	5
13081	WSA	N/A	2.838	443	214165	2253	N/A	1.527	423	4143	26	3
13082	WSA	N/A	6.345	818	59163	508	N/A	0.998	220	608	11	0
13084	ESA	N/A	3.914	176	15777	57	N/A	2.034	42	2025	10	0
13085	ESA	N/A	2.145	57	206	5	N/A	0.236	4	0	0	0
13086	ESA	N/A	3.408	286	26062	72	N/A	1.495	11	0	0	0
13087	ESA	N/A	4.243	373	13952	237	N/A	2.587	322	5037	61	0
13088	CSA	N/A	3.430	391	23306	123	N/A	1.259	316	0	0	0
13089	CSA	N/A	7.669	849	130202	556	N/A	0.793	339	967	4	0
13090	CSA	N/A	4.631	643	21046	275	N/A	1.511	349	1024	2	0
13091	CSA	N/A	9.820	1634	12548	63	N/A	0.311	27	0	0	0
13092	CSA	N/A	5.399	641	20194	247	N/A	0.294	10	0	0	0
13093	CSA	N/A	6.062	939	5853	61	N/A	0.102	176	0	0	0
13094	CSA	N/A	6.429	807	31028	305	N/A	2.458	358	0	0	0
13095	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13096	CSA	N/A	19.709	705	112248	1444	N/A	11.695	521	0	0	1
13097	CSA	N/A	14.363	596	218045	2019	N/A	22.000	768	2507	9	0
13098	CSA	N/A	10.074	566	33241	211	N/A	10.182	587	2331	6	0
13099	CSA	N/A	11.322	392	23029	122	N/A	21.124	864	3450	8	0
13100	CSA	N/A	5.745	506	13764	107	N/A	1.017	80	0	0	0
13101	CSA	N/A	2.884	325	11219	103	N/A	0.727	171	0	0	4
13102	CSA	N/A	5.896	838	29185	124	N/A	0.368	82	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	2.089	0.048	0	0	0	2.041	141	85803	1076	7%	5.23
1	Yes	3.367	0.323	0	0	0	3.044	24	0	0	-3%	3.74
1	Yes	2.338	0.060	0	0	0	2.279	20	0	0	-4%	8.96
0	Yes	0.552	0.161	0	0	0	0.391	34	0	0	6%	5.59
0	Yes	2.001	0.156	0	0	0	1.845	92	35398	781	4%	6.98
0	Yes	1.597	0.000	0	0	0	1.597	41	7035	262	-13%	4.82
0	Yes	3.178	0.161	0	0	0	3.017	150	83877	1684	-8%	6.40
0	Yes	1.081	0.059	0	0	0	1.022	14	0	0	-20%	4.62
0	Yes	2.361	0.131	0	334026	1500	2.230	136	79770	1507	-12%	5.67
0	Yes	2.287	0.160	0	0	0	2.127	133	130257	1779	1%	7.72
0	Yes	0.917	0.195	0	0	0	0.723	61	0	0	-5%	5.70
0	Yes	0.440	0.066	0	0	0	0.374	26	16285	514	2%	5.74
0	Yes	2.452	0.242	0	0	0	2.210	40	9969	574	9%	4.53
0	Yes	1.226	0.371	0	0	0	0.855	9	0	0	2%	3.74
0	Yes	3.404	0.371	0	0	0	3.033	52	48474	1317	1%	6.02
0	Yes	2.795	0.406	0	0	0	2.390	117	0	0	-2%	5.61
0	Yes	1.212	0.042	0	0	0	1.169	64	1596	766	-28%	2.11
0	Yes	0.979	0.235	0	0	0	0.744	24	97174	1997	-13%	5.27
0	Yes	2.536	0.393	0	0	0	2.142	82	20821	1056	62%	8.43
0	Yes	2.646	0.239	0	0	0	2.407	135	0	0	-9%	5.96
0	Yes	1.372	0.186	0	0	0	1.185	126	68356	791	-2%	3.11
0	Yes	1.626	0.214	0	0	0	1.412	119	0	0	-4%	3.91
1	Yes	3.373	0.880	0	0	0	2.493	142	53022	1211	15%	7.90
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
2	Yes	3.370	0.099	0	0	0	3.271	89	50153	699	0%	8.19
0	Yes	6.751	2.106	0	0	0	4.645	96	261774	5071	5%	7.84
0	Yes	4.521	0.075	0	0	0	4.447	117	0	0	-4%	6.70
2	Yes	6.269	0.074	0	0	0	6.195	53	38017	1235	2%	7.89
0	Yes	2.630	0.215	0	0	0	2.416	110	0	0	7%	6.47
2	Yes	2.274	0.000	0	0	0	2.274	170	0	0	2%	3.50
0	Yes	3.825	0.127	0	108918	1154	3.698	254	113130	1154	-4%	4.42

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13103	CSA	N/A	3.414	632	9613	141	N/A	0.338	1	0	0	0
13104	CSA	N/A	5.096	454	27173	162	N/A	1.703	383	981	3	13
13105	CSA	N/A	6.715	611	10293	82	N/A	2.831	488	1192	3	0
13106	CSA	N/A	3.542	602	1672	48	N/A	5.574	2147	33053	101	0
13107	CSA	N/A	3.810	529	4385	25	N/A	6.098	998	41152	362	0
13108	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13109	WSA	N/A	4.135	753	9116	90	N/A	4.293	1755	96402	393	0
13110	WSA	N/A	0.985	41	13863	82	N/A	3.173	365	0	0	0
13111	WSA	N/A	3.433	452	57815	1115	N/A	1.509	341	0	0	2
13112	WSA	N/A	11.842	1301	132390	2035	N/A	7.475	1048	2086	53	12
13113	WSA	N/A	3.246	414	7202	39	N/A	0.702	294	0	0	0
13114	WSA	N/A	3.339	315	38473	263	N/A	10.353	3307	3377	62	1
13115	WHA	N/A	6.578	502	113750	1022	N/A	2.828	207	0	0	1
13116	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13117	WHA	N/A	13.065	751	77215	1589	N/A	29.633	1086	17634	319	0
13118	WHA	N/A	12.124	773	360617	4605	N/A	21.405	1726	1927	27	10
13119	PCA	N/A	1.627	31	0	0	N/A	2.138	631	0	0	0
13120	PCA	N/A	2.704	62	1186	17	N/A	9.903	963	5756	64	0
13121	PCA	N/A	3.257	95	3542	27	N/A	7.330	699	0	0	0
13122	PCA	N/A	4.008	373	4753	47	N/A	0.986	66	2584	8	0
13123	PCA	N/A	7.559	756	5342	114	N/A	1.645	247	4274	44	0
13124	PCA	N/A	6.749	354	24821	213	N/A	3.535	183	2923	9	2
13125	PCA	N/A	4.003	443	3300	16	N/A	3.539	362	0	0	0
13126	PCA	N/A	7.826	236	12953	193	N/A	2.775	238	72	1	1
13127	ESA	N/A	5.378	273	16228	85	N/A	20.647	1458	22597	139	3
13128	ESA	N/A	9.307	582	49027	713	N/A	7.941	621	13400	91	0
13129	ESA	N/A	2.836	249	17914	84	N/A	5.495	435	863	10	0
13130	ESA	N/A	5.825	363	19677	83	N/A	4.546	462	1804	10	0
13132	ESA	N/A	1.638	41	204	2	N/A	1.834	111	0	0	1
13133	ESA	N/A	13.766	1389	95356	1168	N/A	4.088	765	545	22	0
13134	ESA	N/A	2.141	174	2796	19	N/A	2.620	218	5758	41	0
13136	WSA	N/A	4.368	498	30115	247	N/A	0.368	5	0	0	0
13137	WSA	N/A	0.933	152	4106	20	N/A	1.247	538	0	0	0
13138	WSA	N/A	4.118	471	3881	121	N/A	2.937	875	9976	224	0
13139	WSA	N/A	5.834	559	124814	706	N/A	3.356	873	2681	45	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	1.894	0.162	0	0	0	1.732	175	95660	2304	2%	3.57
2	Yes	2.161	0.140	0	0	0	2.021	89	102679	2732	3%	5.30
0	Yes	1.613	0.000	0	0	0	1.613	49	615622	1254	-5%	6.22
0	Yes	1.267	0.084	0	0	0	1.183	79	0	0	3%	6.07
0	Yes	3.228	0.043	0	0	0	3.184	167	0	0	-1%	7.03
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	2.751	1.218	0	0	0	1.533	118	0	0	-1%	5.33
0	Yes	2.142	0.306	0	0	0	1.836	33	30137	906	-2%	5.71
2	Yes	1.969	0.451	0	0	0	1.517	51	7983	902	19%	4.86
0	Yes	4.662	0.210	0	0	0	4.452	254	0	0	8%	8.72
0	Yes	1.049	0.170	0	0	0	0.879	39	0	0	9%	1.90
2	Yes	3.389	1.497	0	0	0	1.892	99	0	0	0%	8.89
1	Yes	2.257	0.067	0	0	0	2.190	65	0	0	9%	5.40
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
2	Yes	4.331	1.146	0	124642	1873	3.185	99	0	0	12%	7.59
10	Yes	7.698	1.091	0	0	0	6.607	177	0	0	7%	10.69
0	Yes	2.270	0.082	0	0	0	2.188	19	0	0	12%	6.44
0	Yes	3.157	0.990	0	0	0	2.167	26	7393	1514	31%	8.07
0	Yes	3.121	0.311	0	0	0	2.810	66	10634	853	9%	8.88
0	Yes	1.424	0.088	0	0	0	1.335	55	10624	493	-3%	5.24
0	Yes	2.984	0.033	0	0	0	2.951	131	0	0	19%	4.57
0	Yes	3.680	0.018	0	0	0	3.661	120	0	0	-30%	4.29
0	Yes	3.591	1.098	0	0	0	2.493	128	0	0	3%	5.98
0	Yes	5.115	0.148	0	0	0	4.967	26	0	0	-4%	2.71
1	Yes	4.097	0.000	0	0	0	4.097	117	152834	1833	-1%	8.34
2	Yes	3.364	0.028	0	0	0	3.336	110	0	0	2%	5.72
0	Yes	2.008	0.130	0	0	0	1.877	50	0	0	-6%	4.49
0	Yes	3.567	0.042	0	0	0	3.525	145	0	0	-4%	4.81
1	Yes	0.863	0.112	0	0	0	0.752	22	0	0	26%	2.47
1	Yes	2.823	0.000	0	0	0	2.823	70	0	0	4%	7.74
0	Yes	1.195	0.122	0	0	0	1.073	56	0	0	-10%	1.71
0	Yes	1.431	0.081	0	0	0	1.350	30	1280	486	11%	2.97
0	Yes	1.378	0.162	0	0	0	1.216	99	0	0	-27%	3.09
0	Yes	1.238	0.030	0	0	0	1.209	38	0	0	-9%	4.78
0	Yes	1.699	0.044	0	0	0	1.655	67	47968	1119	-6%	7.58

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13140	WSA	N/A	3.307	441	20857	182	N/A	1.502	902	240	2	0
13141	WSA	N/A	2.576	528	11916	76	N/A	0.950	502	0	0	1
13142	WSA	N/A	2.588	582	1864	16	N/A	1.939	1182	0	0	0
13143	WSA	N/A	7.702	1252	37479	299	N/A	0.644	133	4833	18	10
13146	PCA	N/A	27.769	659	60446	384	N/A	3.392	76	807	2	0
13147	PCA	N/A	31.477	1127	37852	571	N/A	9.451	561	4195	15	3
13148	PCA	N/A	31.120	683	191686	596	N/A	1.373	46	95	1	5
13150	WHA	N/A	4.436	370	44752	290	N/A	6.104	218	260	1	0
13151	WHA	N/A	1.841	40	11673	225	N/A	10.778	1076	528	1	0
13152	WHA	N/A	3.429	323	28991	282	N/A	8.756	556	66617	550	0
13153	WHA	N/A	7.303	720	93494	794	N/A	4.144	344	152	1	0
13154	WSA	N/A	3.601	392	20731	127	N/A	8.591	1448	1916	9	0
13155	WSA	N/A	3.719	401	6268	96	N/A	12.184	1304	7319	99	0
13156	WSA	N/A	2.199	211	1243	20	N/A	3.914	942	1382	24	0
13157	WSA	N/A	0.866	64	0	0	N/A	10.131	574	17100	146	0
13158	CSA	N/A	6.942	662	24396	145	N/A	3.155	1014	4426	48	0
13159	CSA	N/A	12.433	1369	74547	458	N/A	2.013	233	0	0	12
13160	CSA	N/A	4.945	566	33977	211	N/A	2.036	397	538	1	1
13161	WSA	N/A	3.417	429	7027	155	N/A	0.183	58	102	1	0
13162	WSA	N/A	5.814	573	13585	116	N/A	1.038	82	0	0	0
13163	WSA	N/A	5.589	829	94901	503	N/A	0.571	136	0	0	0
13164	WSA	N/A	5.759	791	37235	473	N/A	0.871	29	0	0	0
13165	WSA	N/A	1.812	265	0	0	N/A	0.428	56	0	0	0
13166	WSA	N/A	2.899	763	898	24	N/A	1.102	284	2996	11	0
13167	WSA	N/A	7.726	1364	21369	271	N/A	0.864	407	669	9	0
13169	ESA	N/A	0.786	4	40584	228	N/A	10.430	1043	0	0	0
13170	ESA	N/A	0.292	1	159	1	N/A	16.870	2132	5027	56	0
13171	ESA	N/A	9.461	637	25336	380	N/A	10.759	1038	2889	49	20
13172	ESA	N/A	5.497	353	36976	296	N/A	3.007	202	68	1	0
13173	ESA	N/A	3.271	474	3872	20	N/A	14.334	1755	0	0	0
13174	ESA	N/A	1.688	0	3056	42	N/A	13.398	3073	50	1	1
13175	CSA	N/A	16.966	1914	17723	146	N/A	0.953	37	290	3	4
13176	CSA	N/A	8.158	880	59806	389	N/A	1.190	93	34	2	0
13177	CSA	N/A	3.268	335	21949	172	N/A	0.433	10	0	0	0
13178	CSA	N/A	3.058	114	1312	15	N/A	0.492	95	0	0	0

2021 Annual Reliability Performance Report

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Through December 31, 2021
0	Yes	0.548	0.255	0	0	0	0.293	48	100417	1211	-5%	3.86
1	Yes	1.448	0.377	0	0	0	1.071	144	0	0	5%	5.74
0	Yes	1.107	0.280	0	0	0	0.827	70	0	0	-1%	5.31
0	Yes	3.400	1.329	0	0	0	2.070	175	0	0	13%	9.27
0	Yes	9.908	0.465	0	0	0	9.443	80	28551	820	4%	3.46
0	Yes	6.086	0.017	0	0	0	6.068	69	74375	5128	-1%	7.72
2	Yes	4.349	0.070	0	0	0	4.278	61	373189	2126	-6%	3.42
0	Yes	3.493	0.374	2	0	0	3.119	97	0	0	-6%	7.73
0	Yes	3.570	0.052	0	0	0	3.517	24	0	0	3%	5.32
1	Yes	3.097	0.126	0	0	0	2.971	148	0	0	12%	5.88
2	Yes	1.398	0.038	0	0	0	1.360	56	14560	312	3%	4.72
0	Yes	1.350	0.000	0	0	0	1.350	93	0	0	-6%	6.90
0	Yes	3.100	1.037	0	0	0	2.063	68	0	0	-3%	6.95
0	Yes	2.140	0.069	0	0	0	2.071	69	0	0	-6%	4.35
0	Yes	1.219	0.342	0	0	0	0.877	75	0	0	-6%	3.41
0	Yes	2.057	0.063	0	0	0	1.995	123	90978	3337	7%	5.66
5	Yes	3.474	0.094	0	0	0	3.380	197	16057	1878	2%	7.70
0	Yes	1.056	0.282	0	0	0	0.774	30	45375	824	-3%	5.64
0	Yes	0.507	0.055	0	0	0	0.452	61	10817	333	-5%	2.50
0	Yes	1.389	0.020	0	0	0	1.370	185	33472	1963	4%	7.14
0	Yes	1.602	0.082	0	0	0	1.520	194	309825	2146	7%	7.02
0	Yes	1.802	0.356	0	0	0	1.446	41	120614	2441	1%	5.82
0	Yes	0.496	0.317	0	0	0	0.179	6	0	0	-1%	3.21
0	Yes	4.108	0.743	0	0	0	3.365	248	0	0	9%	7.74
0	Yes	1.470	0.039	0	0	0	1.431	139	101841	3304	1%	7.52
0	Yes	3.646	1.641	0	0	0	2.004	21	0	0	30%	7.45
0	Yes	4.881	1.949	0	0	0	2.932	11	0	0	-12%	10.24
1	Yes	4.091	0.146	0	0	0	3.945	91	217905	8826	3%	8.98
0	Yes	3.558	0.114	0	0	0	3.444	66	0	0	14%	3.38
0	Yes	3.862	1.943	12	0	0	1.919	20	0	0	70%	7.54
2	Yes	2.766	0.349	0	0	0	2.416	18	0	0	-20%	8.53
2	Yes	4.186	0.227	0	0	0	3.960	162	0	0	-3%	8.88
0	Yes	3.728	0.359	0	0	0	3.369	116	39229	1066	-6%	7.34
0	Yes	1.693	0.197	0	0	0	1.497	118	0	0	4%	3.48
1	Yes	2.996	0.384	0	0	0	2.612	60	20625	813	-16%	4.62

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13180	CSA	N/A	2.200	277	2862	15	N/A	0.549	56	0	0	0
13181	CSA	N/A	3.726	327	658	3	N/A	1.341	880	0	0	0
13183	CSA	N/A	6.627	376	13207	204	N/A	0.621	22	0	0	0
13184	CSA	N/A	1.555	75	586	9	N/A	0.431	28	1159	12	0
13185	CSA	N/A	2.543	220	3102	30	N/A	7.857	1074	10368	1152	0
13186	CSA	N/A	4.028	434	13847	331	N/A	0.399	107	3145	75	0
13187	CSA	N/A	5.948	551	49074	269	N/A	4.864	652	0	0	0
13188	CSA	N/A	5.250	444	10215	69	N/A	5.287	600	17472	82	0
13189	WSA	N/A	0.000	0	2777	24	N/A	0.000	0	0	0	0
13190	WSA	N/A	7.834	620	19613	212	N/A	8.530	467	13320	51	0
13191	WSA	N/A	5.707	516	54311	358	N/A	4.104	260	2284	36	0
13192	WSA	N/A	4.216	231	10955	44	N/A	7.775	787	1322	10	0
13193	WSA	N/A	0.000	0	0	0	N/A	10.905	902	12561	71	0
13194	WSA	N/A	6.025	242	48529	291	N/A	1.945	203	917	15	0
13195	WSA	N/A	2.993	71	6753	38	N/A	3.281	14	0	0	0
13198	WSA	N/A	3.892	510	10011	60	N/A	2.652	303	0	0	0
13199	WSA	N/A	4.513	855	3646	55	N/A	0.680	142	0	0	0
13200	WSA	N/A	0.359	22	0	0	N/A	0.390	1	0	0	0
13201	WSA	N/A	2.718	396	1698	6	N/A	0.686	469	0	0	5
13204	CSA	N/A	5.197	578	23406	317	N/A	4.228	1209	20244	194	0
13205	CSA	N/A	3.809	285	171083	846	N/A	2.836	535	3844	64	0
13206	WSA	N/A	10.169	1447	61750	789	N/A	0.167	30	0	0	0
13207	WSA	N/A	9.493	992	65243	519	N/A	0.518	27	3680	9	0
13208	WSA	N/A	4.410	457	15030	41	N/A	0.903	48	104	8	0
13210	WSA	N/A	7.242	828	126674	1501	N/A	0.287	4	0	0	5
13211	ESA	N/A	1.960	68	1484	5	N/A	6.970	737	21748	132	0
13213	ESA	N/A	17.629	773	14954	1192	N/A	7.748	667	0	0	2
13214	ESA	N/A	5.966	434	1999	14	N/A	4.375	223	376	1	0
13215	ESA	N/A	0.047	2	0	0	N/A	0.278	1	0	0	0
13217	WSA	N/A	2.925	325	6097	44	N/A	1.846	185	0	0	0
13218	WSA	N/A	5.512	581	26421	156	N/A	2.117	773	2000	36	0
13219	WSA	N/A	8.843	1276	18997	256	N/A	1.938	392	4034	75	1
13220	WSA	N/A	4.592	464	93267	1647	N/A	1.477	250	0	0	0
13221	CSA	N/A	3.922	140	11612	117	N/A	5.787	1282	6872	81	0
13222	CSA	N/A	2.534	189	18881	275	N/A	1.963	19	0	0	0

2021 Annual Reliability Performance Report

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	1.436	0.563	0	0	0	0.873	47	1007	411	0%	4.02
0	Yes	2.141	0.169	0	0	0	1.972	89	13785	2530	0%	6.23
0	Yes	1.238	0.216	0	0	0	1.023	55	36356	1338	-2%	3.06
0	Yes	2.078	0.397	0	0	0	1.681	71	0	0	-20%	1.99
0	Yes	1.244	0.062	0	0	0	1.183	73	68344	1348	-3%	4.09
0	Yes	2.228	0.000	0	0	0	2.228	149	5252	688	6%	2.98
0	Yes	2.301	0.070	0	0	0	2.231	127	0	0	-2%	5.20
0	Yes	2.616	0.018	0	0	0	2.598	107	78931	2289	1%	5.57
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	2%	7.82
0	Yes	4.417	0.471	0	0	0	3.946	142	55973	1199	-7%	7.25
0	Yes	3.102	0.243	0	0	0	2.859	75	0	0	-4%	6.11
0	Yes	4.333	0.398	0	0	0	3.935	27	39822	1209	-2%	7.01
0	Yes	4.847	1.771	0	0	0	3.076	2	0	0	-2%	3.80
0	Yes	1.333	0.117	0	0	0	1.216	19	0	0	-18%	2.23
0	Yes	3.294	0.806	3	0	0	2.488	29	5730	109	13%	5.60
0	Yes	2.961	0.358	0	0	0	2.603	171	0	0	3%	3.73
0	Yes	0.706	0.166	0	0	0	0.540	53	154348	2076	3%	3.94
0	Yes	0.648	0.054	0	0	0	0.594	47	0	0	9%	2.71
1	Yes	2.507	0.947	0	32703	402	1.561	94	18249	572	-2%	5.17
0	Yes	2.513	0.237	0	0	0	2.276	130	0	0	6%	4.45
0	Yes	1.127	0.392	0	0	0	0.735	29	153386	4653	-2%	3.09
0	Yes	1.212	0.152	0	0	0	1.060	94	41706	1264	3%	7.29
0	Yes	0.656	0.157	0	0	0	0.499	19	0	0	10%	6.91
0	Yes	1.202	0.173	2	0	0	1.029	89	45588	555	-4%	3.60
1	Yes	2.368	0.273	0	0	0	2.095	104	0	0	1%	5.41
0	Yes	2.233	0.322	0	0	0	1.911	17	0	0	0%	9.90
5	Yes	4.760	1.294	0	0	0	3.466	125	145390	4077	-19%	7.12
0	Yes	2.988	0.271	0	48396	137	2.717	69	23668	604	17%	4.44
0	Yes	1.666	0.993	0	0	0	0.673	8	0	0	9%	2.57
0	Yes	2.940	0.792	0	0	0	2.148	73	15659	585	-5%	4.22
0	Yes	2.000	0.166	0	0	0	1.835	79	0	0	2%	4.74
1	Yes	2.645	0.136	0	0	0	2.509	190	7445	1794	5%	7.60
0	Yes	1.351	0.077	0	0	0	1.275	24	0	0	-10%	2.91
0	Yes	3.001	0.168	0	0	0	2.832	45	49747	1461	-6%	5.44
0	Yes	2.378	0.413	0	0	0	1.965	48	0	0	-1%	4.46

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13223	CSA	N/A	4.441	314	2585	94	N/A	1.638	57	0	0	0
13224	CSA	N/A	10.139	1037	29068	127	N/A	1.336	346	25681	81	0
13225	ESA	N/A	5.838	456	17661	214	N/A	4.595	376	0	0	0
13226	ESA	N/A	3.136	285	13820	70	N/A	6.476	925	6089	45	5
13227	ESA	N/A	6.114	462	23859	433	N/A	9.906	811	5278	21	17
13228	ESA	N/A	3.982	267	7548	164	N/A	5.680	762	1598	7	0
13229	ESA	N/A	8.112	670	72241	1082	N/A	4.389	614	1534	16	0
13230	ESA	N/A	3.713	244	17415	42	N/A	5.167	842	11822	109	0
13231	ESA	N/A	4.639	457	14401	165	N/A	8.554	751	0	0	0
13232	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13233	SHA	N/A	6.674	84	147550	1032	N/A	18.499	1312	14132	86	5
13234	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13235	SHA	N/A	0.006	0	7515	100	N/A	30.871	3005	463	7	0
13236	SHA	N/A	61.184	623	21488	482	N/A	20.018	1293	4862	52	0
13237	SHA	N/A	0.237	0	0	0	N/A	34.505	2609	0	0	0
13238	SHA	N/A	0.019	0	42738	214	N/A	24.707	1710	683	3	0
13239	SHA	N/A	0.918	13	453	9	N/A	24.348	2418	0	0	0
13240	SHA	N/A	2.925	41	0	0	N/A	5.605	416	0	0	0
13241	PCA	N/A	11.291	935	86032	754	N/A	5.739	625	17456	78	0
13242	PCA	N/A	10.642	336	14941	267	N/A	3.902	377	17751	118	1
13243	PCA	N/A	10.723	861	146158	2382	N/A	2.228	378	0	0	0
13250	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13251	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13252	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13253	CSA	N/A	0.080	0	0	0	N/A	0.000	0	0	0	0
13254	SHA	N/A	21.663	698	68687	314	N/A	11.660	1004	0	0	0
13255	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13256	SHA	N/A	21.671	568	72515	1006	N/A	7.156	795	3134	20	0
13258	CSA	N/A	0.000	0	0	0	N/A	0.659	6	140	7	0
13259	CSA	N/A	0.000	0	0	0	N/A	1.582	0	0	0	0
13260	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13261	CSA	N/A	0.000	0	0	0	N/A	1.245	0	0	0	0
13262	CSA	N/A	0.000	0	0	0	N/A	0.064	357	0	0	0
13263	CSA	N/A	0.000	0	0	0	N/A	0.236	0	0	0	0
13264	CSA	N/A	0.000	0	0	0	N/A	1.550	0	0	0	0

2021 Annual Reliability Performance Report

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
1	Yes	2.858	0.106	0	0	0	2.752	67	1502	455	7%	3.53
1	Yes	3.071	0.827	0	0	0	2.244	71	0	0	0%	7.46
0	Yes	0.587	0.064	0	0	0	0.523	12	0	0	4%	4.09
3	Yes	2.636	0.127	0	0	0	2.509	40	36316	1243	-3%	7.17
7	Yes	2.999	0.033	0	0	0	2.966	77	16543	2087	-7%	6.48
0	Yes	3.473	0.160	0	0	0	3.313	85	41149	1129	-6%	6.67
1	Yes	2.355	0.108	0	0	0	2.247	103	0	0	3%	6.01
1	Yes	2.673	0.262	7	0	0	2.411	111	0	0	-5%	4.87
1	Yes	3.455	0.174	0	0	0	3.281	92	69184	1307	-31%	4.27
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	5.664	1.772	0	0	0	3.892	11	0	0	44%	3.77
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	7.390	4.211	0	0	0	3.179	3	0	0	13%	10.76
4	Yes	9.622	2.820	0	51200	515	6.803	51	96926	1361	36%	8.16
0	Yes	5.100	3.584	0	0	0	1.516	3	0	0	2%	11.62
0	Yes	5.705	4.744	0	0	0	0.962	0	4158	1485	-23%	6.18
0	Yes	5.598	3.525	0	0	0	2.073	5	0	0	11%	10.56
0	Yes	2.657	1.266	0	0	0	1.390	4	0	0	NEW	3.47
0	Yes	2.353	0.000	0	0	0	2.353	107	162993	4093	1%	6.86
0	Yes	3.606	0.101	0	0	0	3.505	90	91523	2986	3%	3.91
0	Yes	2.383	0.172	0	0	0	2.211	143	101501	2795	-5%	6.42
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.457	0.021	0	0	0	0.435	0	0	0	-1%	5.54
3	Yes	12.597	0.115	0	0	0	12.482	145	126869	1149	-5%	6.17
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.993	0.281	0	0	0	1.713	6	0	0	1%	4.04
0	Yes	0.341	0.341	0	0	0	0.000	0	0	0	6%	4.58
0	Yes	0.723	0.723	0	0	0	0.000	0	0	0	-1%	5.29
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.682	0.682	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.982	0.982	0	0	0	0.000	0	0	0	-23%	2.69
0	Yes	1.140	1.140	0	0	0	0.000	0	38477	257	848%	0.28
0	Yes	1.536	1.517	0	0	0	0.019	0	0	0	28%	1.23
0	Yes			0	0	0		0	0	0	1%	5.52

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13265	CSA	N/A	0.000	0	0	0	N/A	0.492	40	0	0	0
13267	PCA	N/A	0.224	1	3957	27	N/A	1.278	11	0	0	0
13268	PCA	N/A	28.668	670	32522	277	N/A	6.853	203	358	11	0
13269	PCA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13270	WSA	N/A	0.386	29	6434	156	N/A	4.279	503	0	0	0
13275	WSA	N/A	0.000	0	0	0	N/A	1.265	3	0	0	0
13276	WSA	N/A	0.000	0	0	0	N/A	2.612	11	0	0	0
13278	WHA	N/A	7.896	715	9664	67	N/A	1.031	86	0	0	0
13279	WHA	N/A	9.110	989	10696	123	N/A	1.695	35	85	1	0
13280	WHA	N/A	2.751	98	0	0	N/A	0.605	3	0	0	0
13281	WHA	N/A	0.000	0	34	1	N/A	0.182	2	0	0	0
13282	WHA	N/A	0.000	0	0	0	N/A	0.107	1	177	1	0
13283	WHA	N/A	0.000	0	0	0	N/A	0.177	2	0	0	0
13288	WHA	N/A	0.945	97	272	5	N/A	1.877	110	0	0	0
13289	WHA	N/A	3.955	264	24040	228	N/A	1.964	274	53	1	0
13290	WHA	N/A	5.046	579	22412	218	N/A	1.273	343	0	0	0
13291	WHA	N/A	3.058	282	5129	55	N/A	3.522	335	1399	17	0
13292	WHA	N/A	2.781	303	354	10	N/A	1.716	152	228298	568	0
13293	WHA	N/A	8.409	1024	21058	370	N/A	4.110	508	0	0	0
13294	WHA	N/A	13.510	742	3489	29	N/A	3.267	161	56366	1875	0
13295	WHA	N/A	2.775	284	7056	48	N/A	11.248	936	46850	239	0
13296	WHA	N/A	9.490	398	19076	274	N/A	12.929	1221	8893	86	0
13297	WHA	N/A	5.983	570	41373	338	N/A	5.851	704	8166	82	0
13298	WHA	N/A	133.110	1156	162676	2330	N/A	5.211	53	352	207	4
13299	WHA	N/A	17.673	579	76696	973	N/A	23.292	1056	12371	137	0
13302	SHA	N/A	2.812	257	58783	876	N/A	20.235	1482	30914	208	0
13303	SHA	N/A	107.942	1796	159837	1630	N/A	5.169	377	0	0	12
13304	SHA	N/A	0.756	8	13277	4723	N/A	24.084	2022	1728	22	0
13305	SHA	N/A	0.000	0	35328	335	N/A	18.266	1091	14522	108	0
13308	WHA	N/A	6.724	634	34624	1064	N/A	3.499	546	27025	117	24
13309	WHA	N/A	2.527	293	30629	261	N/A	0.364	28	0	0	3
13310	WHA	N/A	2.096	361	5079	45	N/A	0.642	32	0	0	0
13311	WHA	N/A	5.897	656	8749	118	N/A	0.480	102	0	0	0
13312	WHA	N/A	4.429	485	12010	138	N/A	2.056	353	2594	36	0
13313	WHA	N/A	2.389	332	7086	67	N/A	1.234	108	0	0	2

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Through December 31, 2021
0	Yes	0.612	0.612	0	882	100	0.000	0	0	0	25%	3.37
1	Yes	3.017	0.382	0	0	0	2.634	7	0	0	-7%	6.61
0	Yes	6.859	0.146	0	0	0	6.713	134	203849	1740	-6%	5.89
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.542	0.513	0	0	0	1.029	4	0	0	3%	2.06
0	Yes	2.542	2.542	0	0	0	0.000	0	0	0	8%	2.48
0	Yes	1.683	1.683	0	0	0	0.000	0	0	0	0%	6.26
1	Yes	3.988	0.112	0	0	0	3.877	209	0	0	-8%	4.98
0	Yes	5.803	0.971	0	0	0	4.832	226	1920	1280	-2%	6.56
0	Yes	2.826	0.332	0	0	0	2.494	54	0	0	-8%	4.87
0	Yes	0.940	0.935	0	0	0	0.005	0	877	6	-14%	6.93
0	Yes	0.943	0.929	0	0	0	0.013	0	386	4	-3%	6.44
0	Yes	0.999	0.995	0	0	0	0.003	0	607	6	-20%	6.05
0	Yes	1.515	0.219	0	0	0	1.295	26	0	0	0%	5.68
0	Yes	2.956	0.174	0	0	0	2.782	99	0	0	-7%	3.27
2	Yes	2.995	0.139	0	0	0	2.856	177	358551	1266	2%	3.95
0	Yes	2.154	0.000	0	0	0	2.154	35	0	0	-2%	4.81
0	Yes	2.460	0.119	0	0	0	2.341	130	0	0	8%	3.01
0	Yes	3.427	0.071	0	0	0	3.356	154	0	0	11%	5.60
3	Yes	5.487	0.292	0	839	154	5.195	164	0	0	-3%	6.96
0	Yes	4.009	0.908	0	0	0	3.101	48	0	0	-3%	5.16
0	Yes	4.201	0.176	0	0	0	4.025	103	97085	1728	-4%	6.81
0	Yes	3.831	0.119	0	0	0	3.712	160	9217	1418	4%	5.88
12	Yes	24.108	0.000	0	0	0	24.108	112	234396	2868	1%	6.02
2	Yes	9.154	3.974	0	0	0	5.180	63	0	0	7%	9.67
0	Yes	2.994	1.480	0	0	0	1.514	7	0	0	-4%	6.31
3	Yes	4.378	0.527	0	0	0	3.851	51	0	0	0%	8.20
0	Yes	5.147	3.263	0	0	0	1.885	3	44644	1999	3%	7.55
0	Yes	3.050	2.720	0	0	0	0.330	0	0	0	-52%	3.26
4	Yes	3.958	0.330	0	0	0	3.628	188	148835	1275	8%	6.31
0	Yes	1.675	0.039	0	0	0	1.636	46	0	0	28%	4.11
0	Yes	1.363	0.054	0	0	0	1.308	16	21416	470	2%	3.03
0	Yes	2.961	0.064	0	0	0	2.897	167	0	0	17%	4.59
0	Yes	2.940	0.119	0	0	0	2.821	79	0	0	9%	7.40
2	Yes	2.062	0.436	0	0	0	1.627	43	0	0	2%	5.55

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13314	WHA	N/A	2.081	125	24407	137	N/A	2.100	281	218	3	2
13315	WHA	N/A	0.000	0	0	0	N/A	0.291	13	0	0	0
13316	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13317	WSA	N/A	0.779	0	0	0	N/A	5.401	1371	213	2	0
13318	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13319	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13320	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13321	WSA	N/A	0.000	0	0	0	N/A	1.479	6	8	2	0
13322	WSA	N/A	0.017	0	0	0	N/A	1.760	506	260407	487	0
13323	WSA	N/A	1.456	175	4332	47	N/A	4.598	108	0	0	0
13324	ESA	N/A	6.243	239	12989	130	N/A	0.388	12	0	0	0
13325	ESA	N/A	1.008	15	1729	25	N/A	0.620	6	0	0	0
13326	ESA	N/A	8.627	299	1069	11	N/A	3.496	114	69	1	0
13327	ESA	N/A	2.659	21	678	3	N/A	1.177	7	0	0	0
13328	DCA	N/A	6.261	556	72937	244	N/A	0.665	22	240	1	0
13329	DCA	N/A	8.261	618	4188	63	N/A	0.549	48	123	1	1
13330	DCA	N/A	35.482	1319	194375	3439	N/A	9.021	481	237	3	22
13331	DCA	N/A	27.467	1223	133948	505	N/A	4.354	151	1812	25	14
13332	WSA	N/A	2.223	104	0	0	N/A	10.128	1666	65075	457	0
13333	WSA	N/A	1.495	72	1793	15	N/A	2.742	411	1	1	0
13334	WSA	N/A	4.333	653	138187	1379	N/A	0.900	227	3512	44	0
13335	WSA	N/A	1.386	34	0	0	N/A	2.255	18	0	0	0
13336	WSA	N/A	2.426	58	164	1	N/A	2.937	172	859	5	0
13337	WSA	N/A	2.737	233	1508	15	N/A	4.661	1980	9141	127	0
13338	WSA	N/A	3.504	145	1323	5	N/A	1.907	213	922	2	0
13339	WSA	N/A	0.478	3	0	0	N/A	5.331	1220	0	0	0
13340	SHA	N/A	1.443	28	174	2	N/A	7.710	1035	0	0	0
13341	SHA	N/A	3.571	103	14459	249	N/A	6.733	648	0	0	0
13342	SHA	N/A	8.555	423	2152	25	N/A	8.184	886	152	1	0
13343	SHA	N/A	2.210	49	3296	27	N/A	11.157	1343	1364	4	0
13344	SHA	N/A	0.497	20	83848	1064	N/A	0.961	260	40	1	0
13345	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13346	SHA	N/A	2.801	65	9028	104	N/A	14.071	1462	4530	82	0
13347	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13348	CSA	N/A	3.740	652	705	13	N/A	5.634	1779	0	0	1

2021 Annual Reliability Performance Report

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
1	Yes	2.342	0.335	0	0	0	2.007	49	63486	951	7%	3.70
0	Yes	0.582	0.582	0	0	0	0.000	0	0	0	-35%	0.86
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	5.585	4.439	0	178350	2863	1.146	6	0	0	-1%	4.84
0	Yes	1.202	1.202	0	0	0	0.000	0	0	0	0%	0.07
0	Yes	0.934	0.934	0	0	0	0.000	0	0	0	0%	0.06
0	Yes	1.121	1.121	0	0	0	0.000	0	0	0	0%	0.07
0	Yes	2.256	2.256	0	0	0	0.000	0	0	0	0%	1.27
0	Yes	3.141	2.798	1	29220	525	0.343	1	70538	499	32%	3.18
0	Yes	2.282	1.336	0	0	0	0.946	36	0	0	-8%	1.83
0	Yes	3.744	0.096	0	0	0	3.648	33	0	0	8%	3.24
0	Yes	2.643	0.109	0	0	0	2.534	12	268	39	-1%	4.57
3	Yes	5.939	0.367	0	0	0	5.572	58	151987	1843	18%	7.10
1	Yes	1.289	0.066	0	0	0	1.223	6	0	0	105%	2.44
0	Yes	1.405	0.066	0	0	0	1.338	34	94030	2312	4%	3.41
0	Yes	2.669	0.056	0	0	0	2.613	144	189004	2358	2%	4.30
4	Yes	4.823	0.203	0	0	0	4.620	166	83514	6315	2%	6.76
6	Yes	3.907	0.108	0	0	0	3.800	110	8161	1395	3%	4.39
0	Yes	1.887	0.056	0	0	0	1.830	62	0	0	-5%	5.28
0	Yes	2.355	0.185	0	0	0	2.170	85	40084	574	4%	4.45
0	Yes	2.395	0.313	0	0	0	2.082	66	0	0	-8%	5.72
0	Yes	1.728	0.494	0	0	0	1.234	7	0	0	-5%	4.24
0	Yes	1.659	0.255	0	0	0	1.404	6	0	0	6%	6.01
0	Yes	2.675	0.160	0	0	0	2.515	175	0	0	-8%	6.40
0	Yes	3.345	0.137	0	0	0	3.208	24	1060	390	13%	5.27
1	Yes	1.601	1.171	0	0	0	0.430	0	0	0	-2%	8.73
0	Yes	3.795	0.407	0	0	0	3.389	21	4332	1048	-61%	4.20
0	Yes	3.138	0.452	16	0	0	2.686	27	3141	760	9%	4.54
0	Yes	5.688	0.591	0	0	0	5.097	56	11692	2656	11%	8.80
0	Yes	4.792	2.909	0	0	0	1.883	8	6407	1368	8%	8.68
0	Yes	2.136	0.330	0	0	0	1.806	4	13085	1996	-71%	2.58
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	7.212	2.364	0	0	0	4.848	31	114523	4597	2%	10.51
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	2.677	0.352	0	0	0	2.324	229	0	0	4%	7.14

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13349	CSA	N/A	0.093	0	153	8	N/A	0.103	1	0	0	0
13350	CSA	N/A	0.150	74	9771	86	N/A	1.674	386	6785	16	0
13351	CSA	N/A	2.800	472	11456	175	N/A	5.350	1402	54117	348	2
13352	CSA	N/A	0.934	132	8643	135	N/A	5.184	1466	18160	192	0
13353	CSA	N/A	0.000	0	0	0	N/A	1.069	4	0	0	0
13354	CSA	N/A	1.407	21	109	1	N/A	7.637	1755	20554	128	0
13355	CSA	N/A	0.000	0	0	0	N/A	0.145	3	0	0	0
13358	WSA	N/A	4.235	943	18245	397	N/A	1.375	401	1387	18	0
13359	WSA	N/A	6.054	675	20997	76	N/A	2.124	166	32	1	3
13360	WSA	N/A	0.076	9	0	0	N/A	0.019	0	0	0	0
13361	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13362	CSA	N/A	0.000	0	0	0	N/A	0.823	230	0	0	0
13363	CSA	N/A	0.000	0	0	0	N/A	0.000	0	8042	50	0
13364	CSA	N/A	0.093	0	49432	234	N/A	0.343	248	0	0	0
13365	CSA	N/A	2.035	348	26661	66	N/A	7.663	882	24008	157	0
13366	CSA	N/A	0.000	0	281	1	N/A	0.591	6	0	0	0
13367	CSA	N/A	0.010	0	0	0	N/A	0.710	8	75	1	0
13368	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13369	CSA	N/A	0.000	0	0	0	N/A	0.002	0	0	0	0
13370	WHA	N/A	8.082	777	1003	10	N/A	4.730	504	3290	16	2
13371	WHA	N/A	7.034	448	24304	191	N/A	6.808	727	5048	14	0
13372	WHA	N/A	2.363	241	2713	17	N/A	1.149	41	0	0	0
13373	WHA	N/A	18.881	1814	14806	335	N/A	4.281	391	0	0	0
13374	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13375	WSA	N/A	0.000	0	0	0	N/A	0.023	0	0	0	0
13376	WSA	N/A	0.000	0	0	0	N/A	0.286	0	0	0	0
13377	WSA	N/A	4.120	951	18644	474	N/A	2.000	147	0	0	6
13378	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13379	WSA	N/A	0.000	0	0	0	N/A	0.034	0	0	0	0
13380	WSA	N/A	0.000	0	0	0	N/A	0.055	401	0	0	0
13381	WSA	N/A	0.000	0	0	0	N/A	0.198	0	0	0	0
13382	WSA	N/A	0.000	0	0	0	N/A	0.097	0	0	0	0
13383	WSA	N/A	0.000	0	0	0	N/A	0.913	7	0	0	0
13384	WSA	N/A	0.000	0	0	0	N/A	0.017	0	0	0	0
13385	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	1.601	0.719	0	0	0	0.881	11	0	0	-41%	2.30
0	Yes	0.694	0.397	0	0	0	0.297	8	0	0	13%	6.13
4	Yes	2.177	1.143	0	0	0	1.034	30	4464	1873	1%	5.54
0	Yes	2.010	0.860	0	0	0	1.150	46	0	0	-5%	3.97
0	Yes	3.102	3.102	0	0	0	0.000	0	0	0	-9%	2.78
0	Yes	2.352	0.084	0	0	0	2.269	47	5131	1811	36%	8.68
0	Yes	1.026	0.752	0	0	0	0.274	2	0	0	-11%	5.90
0	Yes	2.591	0.801	0	0	0	1.790	194	0	0	0%	8.72
2	Yes	3.498	1.405	0	0	0	2.092	96	0	0	-5%	5.73
0	Yes	1.642	0.806	0	0	0	0.837	2	0	0	4%	0.09
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.397	0.076	0	0	0	0.322	2	0	0	-70%	1.91
0	Yes	0.137	0.080	0	0	0	0.058	0	0	0	0%	0.00
0	Yes	0.386	0.086	0	0	0	0.300	2	0	0	-1%	0.93
1	Yes	5.259	1.684	0	0	0	3.575	20	0	0	-2%	7.36
0	Yes	1.249	0.837	0	0	0	0.412	4	0	0	-2%	7.43
0	Yes	1.534	0.765	0	0	0	0.769	1	2125	16	364%	6.45
0	Yes	0.089	0.089	0	0	0	0.000	0	0	0	-30%	2.83
0	Yes	0.149	0.149	0	0	0	0.000	0	0	0	-31%	3.43
3	Yes	3.055	0.176	0	0	0	2.879	213	5677	1494	7%	7.30
1	Yes	2.571	0.123	12	0	0	2.448	52	3973	1198	7%	5.44
0	Yes	1.307	0.113	0	0	0	1.194	20	0	0	2%	5.72
2	Yes	5.282	0.849	0	0	0	4.432	215	0	0	-3%	9.05
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.931	0.931	0	0	0	0.000	0	0	0	21%	1.92
0	Yes	0.855	0.855	0	0	0	0.000	0	0	0	16%	1.72
3	Yes	3.011	0.782	0	0	0	2.229	83	0	0	-1%	5.55
0	Yes	0.015	0.015	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.038	1.038	0	9048	18	0.000	0	0	0	-15%	5.26
0	Yes	0.155	0.155	0	0	0	0.000	0	0	0	-18%	0.32
0	Yes	0.376	0.376	0	0	0	0.000	0	0	0	-7%	0.52
0	Yes	1.174	1.174	0	0	0	0.000	0	0	0	47%	7.75
0	Yes	0.975	0.975	0	0	0	0.000	0	0	0	26%	3.28
0	Yes	0.795	0.795	0	0	0	0.000	0	0	0	-3%	3.68
0	Yes	0.024	0.024	0	0	0	0.000	0	3165	1202	0%	0.00

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13388	PCA	N/A	17.248	487	94697	993	N/A	8,441	175	0	0	0
13389	PCA	N/A	17.131	931	76849	942	N/A	1,605	53	0	0	17
13390	PCA	N/A	33.520	1190	93199	1403	N/A	4,736	431	8246	82	20
13391	PCA	N/A	47.862	1170	22154	355	N/A	6,976	353	3603	26	10
13397	CSA	N/A	0.398	49	0	0	N/A	0.245	42	0	0	0
13398	CSA	N/A	0.473	15	0	0	N/A	0.829	941	157	1	0
13399	CSA	N/A	0.791	41	997	3	N/A	0.123	1	0	0	0
13400	CSA	N/A	2.211	126	0	0	N/A	1.364	1110	0	0	0
13405	WSA	N/A	9.246	189	1127	7	N/A	2.213	115	0	0	0
13406	WSA	N/A	1.370	28	1013	2	N/A	5.940	267	762	2	0
13407	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13408	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13412	PCA	N/A	1.213	102	280	3	N/A	0.026	1	0	0	0
13414	PCA	N/A	9.475	739	21063	331	N/A	1.706	51	0	0	0
13417	CSA	N/A	4.859	633	5553	57	N/A	1.341	38	2121	23	0
13418	CSA	N/A	9.191	1230	84203	792	N/A	1.046	222	0	0	0
13419	CSA	N/A	10.603	1422	77718	697	N/A	0.616	59	4259	8	0
13420	CSA	N/A	3.863	413	8737	57	N/A	5.407	1465	22257	153	0
13422	DCA	N/A	28.723	957	55941	1631	N/A	9.789	433	7364	31	22
13423	DCA	N/A	28.158	682	39174	382	N/A	3.859	569	11468	107	0
13425	WSA	N/A	1.273	4	80710	720	N/A	14.354	1641	21634	147	0
13426	WSA	N/A	5.750	406	38518	533	N/A	12.031	1359	8795	234	0
13427	WSA	N/A	0.003	2	852	4	N/A	3.951	291	251	1	0
13428	WSA	N/A	1.276	52	27522	364	N/A	9.008	1207	34147	248	0
13430	DCA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13431	DCA	N/A	36.600	748	15148	275	N/A	13.267	485	169	2	24
13432	DCA	N/A	3.808	59	10949	61	N/A	16.549	706	0	0	0
13433	ESA	N/A	8.891	289	7667	275	N/A	3.589	236	4989	27	15
13434	ESA	N/A	9.805	842	27353	2567	N/A	4.367	558	0	0	0
13435	ESA	N/A	8.234	395	7204	65	N/A	1.929	368	0	0	0
13436	ESA	N/A	12.948	719	11221	96	N/A	5.470	491	13041	87	0
13438	SHA	N/A	0.998	101	9372	60	N/A	22.555	2988	22838	90	0
13439	SHA	N/A	2.805	315	15679	247	N/A	7.326	485	5133	69	0
13440	SHA	N/A	3.078	7	662	12	N/A	19.595	1591	6302	37	0
13441	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Through December 31, 2021
0	Yes	5.025	0.892	0	39504	793	4.133	117	184601	4433	-5%	6.02
1	Yes	6.321	0.035	0	0	0	6.286	181	243088	4711	4%	5.14
4	Yes	6.442	0.297	0	0	0	6.145	238	104291	3654	-5%	6.43
6	Yes	8.960	0.238	0	0	0	8.722	190	56180	1640	-2%	7.12
0	Yes	1.074	0.072	0	0	0	1.002	70	959	172	7%	2.38
1	Yes	1.709	1.460	230	0	0	0.249	3	43045	1188	8%	4.23
0	Yes	0.384	0.256	0	0	0	0.128	12	21	1	-44%	1.01
0	Yes	2.982	1.288	0	0	0	1.694	39	18254	642	8%	4.28
0	Yes	2.962	0.534	0	0	0	2.428	26	20034	322	-6%	1.62
0	Yes	5.384	1.386	0	32144	328	3.998	30	27792	330	-44%	3.20
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.640	0.055	0	0	0	0.584	23	17956	804	-82%	1.20
1	Yes	2.717	0.040	0	0	0	2.677	123	28122	956	2%	5.54
0	Yes	3.232	0.391	0	0	0	2.841	191	0	0	2%	5.15
0	Yes	1.838	0.108	0	0	0	1.729	165	0	0	1%	6.08
0	Yes	1.642	0.143	0	0	0	1.499	146	0	0	-1%	7.29
0	Yes	2.103	0.074	0	0	0	2.030	134	0	0	0%	6.62
6	Yes	8.630	0.252	0	0	0	8.377	111	0	0	-1%	5.83
3	Yes	2.711	0.183	0	0	0	2.528	66	70446	1135	-2%	4.44
0	Yes	2.484	0.918	0	0	0	1.566	7	0	0	-12%	6.18
0	Yes	1.147	0.072	0	0	0	1.075	17	45916	1782	-2%	7.13
0	Yes	0.164	0.076	0	0	0	0.088	0	0	0	-3%	1.28
0	Yes	2.870	0.354	0	0	0	2.516	66	87542	1295	3%	5.23
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
3	Yes	7.569	2.518	0	0	0	5.052	109	71588	1269	5%	6.23
1	Yes	3.391	1.084	0	0	0	2.307	43	24537	784	-1%	6.28
0	Yes	3.644	0.366	0	0	0	3.279	55	0	0	0%	7.01
1	Yes	4.251	0.100	0	0	0	4.151	213	2839	1151	-6%	6.50
0	Yes	3.753	0.101	0	0	0	3.652	58	0	0	14%	4.80
3	Yes	4.640	0.117	0	0	0	4.523	211	19137	1236	-6%	5.99
1	Yes	5.503	3.641	0	0	0	1.862	12	0	0	-4%	8.71
1	Yes	4.150	0.717	0	0	0	3.433	159	0	0	-8%	5.19
0	Yes	8.295	2.430	0	0	0	5.865	17	191963	4336	15%	7.81
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13442	WHA	N/A	13.717	598	6826	111	N/A	21.945	1863	13565	164	0
13443	WHA	N/A	9.552	655	55170	636	N/A	9.461	813	6888	99	7
13444	WHA	N/A	4.018	353	6482	65	N/A	1.602	212	0	0	0
13446	WSA	N/A	0.001	4	0	0	N/A	0.693	91	0	0	0
13447	WSA	N/A	1.637	55	9850	111	N/A	1.095	28	42	1	0
13448	WSA	N/A	1.327	105	12485	59	N/A	2.137	426	0	0	0
13449	WSA	N/A	2.701	244	9216	91	N/A	1.466	170	6499	26	0
13450	WSA	N/A	0.603	24	0	0	N/A	1.907	60	2955	3	0
13451	WSA	N/A	0.114	0	13410	58	N/A	2.810	90	3021	17	0
13452	WSA	N/A	0.200	7	0	0	N/A	0.185	1	646	2	0
13453	WSA	N/A	0.136	6	135	1	N/A	4.511	25	0	0	0
13454	ESA	N/A	4.097	399	36782	419	N/A	12.085	1949	1799	8	0
13455	ESA	N/A	2.901	208	16342	257	N/A	3.202	775	12239	50	0
13456	ESA	N/A	1.733	156	2850	53	N/A	3.082	813	60	24	0
13457	ESA	N/A	2.201	107	2576	211	N/A	5.192	694	23345	161	0
13458	ESA	N/A	15.078	481	8782	109	N/A	4.332	70	1645	29	2
13459	ESA	N/A	10.692	405	20170	129	N/A	13.426	557	2515	10	4
13460	ESA	N/A	37.636	946	313771	3235	N/A	3.729	237	0	0	25
13461	ESA	N/A	27.473	1029	59731	739	N/A	9.508	292	394	2	42
13462	PCA	N/A	4.277	199	48200	432	N/A	10.614	740	13497	91	4
13463	PCA	N/A	1.514	259	3159	14	N/A	0.196	11	36739	888	0
13464	PCA	N/A	5.527	457	2136	9	N/A	2.448	188	0	0	0
13466	CSA	N/A	2.193	186	4959	15	N/A	0.829	136	0	0	0
13467	CSA	N/A	0.000	0	0	0	N/A	0.239	3	0	0	0
13468	CSA	N/A	5.660	618	97410	1141	N/A	2.696	822	18993	122	1
13469	CSA	N/A	2.022	100	10005	58	N/A	7.896	689	0	0	0
13470	WHA	N/A	35.495	2028	23976	81	N/A	7.963	408	4654	33	0
13471	WHA	N/A	4.491	449	1008	19	N/A	4.734	536	18731	100	0
13473	WHA	N/A	13.348	895	20796	371	N/A	5.166	403	791	7	0
13479	WHA	N/A	9.064	471	8600	57	N/A	4.476	319	250	2	0
13480	WSA	N/A	0.749	9	2408	31	N/A	11.483	1615	27679	64	0
13481	WSA	N/A	0.000	0	0	0	N/A	6.769	749	24321	243	0
13482	WSA	N/A	0.876	11	2311	20	N/A	16.013	1583	54270	335	0
13483	WSA	N/A	2.801	369	19255	99	N/A	15.854	1384	148306	811	0
13484	WSA	N/A	0.182	4	8582	45	N/A	10.536	1379	11607	95	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
2	Yes	2.836	0.134	0	0	0	2.702	77	0	0	6%	10.49
5	Yes	3.185	0.047	0	0	0	3.138	76	35843	3135	5%	6.97
0	Yes	2.449	0.193	0	0	0	2.256	122	0	0	9%	3.21
0	Yes	1.246	1.246	0	2855	22	0.000	0	6783	75	0%	2.90
0	Yes	0.958	0.133	0	0	0	0.825	18	6900	231	-7%	6.17
0	Yes	1.148	0.675	0	0	0	0.473	18	0	0	-3%	3.04
0	Yes	1.660	0.940	0	0	0	0.720	26	0	0	0%	4.79
0	Yes	2.197	0.995	0	0	0	1.201	49	0	0	2%	6.19
0	Yes	1.199	0.262	0	0	0	0.937	15	4639	80	7%	4.09
0	Yes	0.765	0.153	0	0	0	0.613	30	0	0	9%	1.04
0	Yes	4.377	3.909	0	56250	554	0.469	12	0	0	1%	5.51
0	Yes	2.321	0.216	0	0	0	2.105	129	0	0	-3%	7.05
0	Yes	2.114	0.134	0	0	0	1.981	38	0	0	4%	4.02
0	Yes	2.465	0.695	0	0	0	1.770	37	0	0	-5%	3.74
0	Yes	2.560	0.069	0	0	0	2.491	65	42212	865	12%	4.83
0	Yes	8.287	0.604	0	0	0	7.682	108	1465	28	-14%	2.94
2	Yes	7.994	3.275	0	0	0	4.719	120	19437	1023	-3%	5.25
4	Yes	7.273	0.120	0	38313	1245	7.153	75	3194	424	-8%	5.00
7	Yes	7.228	0.412	0	0	0	6.816	105	638644	6747	0%	7.90
4	Yes	4.100	0.491	0	0	0	3.609	85	79661	1035	-5%	9.06
0	Yes	2.939	0.022	0	0	0	2.917	68	0	0	55%	2.37
0	Yes	4.075	0.097	0	0	0	3.978	119	0	0	311%	9.25
0	Yes	1.765	0.124	0	0	0	1.641	68	0	0	-11%	4.89
0	Yes	1.892	1.876	0	0	0	0.016	0	0	0	-9%	2.58
0	Yes	2.667	0.097	0	0	0	2.570	96	105483	3050	2%	4.60
0	Yes	4.041	0.494	0	0	0	3.547	56	0	0	-2%	7.48
3	Yes	6.467	0.263	0	0	0	6.203	139	151963	2396	5%	9.06
0	Yes	4.002	0.528	0	0	0	3.474	95	251590	2097	1%	4.34
1	Yes	2.448	0.026	0	0	0	2.422	62	152286	2485	11%	5.80
1	Yes	4.751	0.053	0	0	0	4.698	98	0	0	10%	6.25
0	Yes	0.961	0.021	0	0	0	0.940	6	0	0	-2%	5.04
0	Yes	5.619	2.609	0	0	0	3.010	3	0	0	8%	3.64
1	Yes	2.623	0.746	0	0	0	1.877	6	383718	3155	1%	7.07
0	Yes	1.971	1.673	0	0	0	0.298	4	205038	2394	-1%	6.64
0	Yes	4.057	1.000	0	0	0	3.056	25	583273	2724	-10%	5.05

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13485	WSA	N/A	2.907	130	43216	305	N/A	7.509	755	12606	121	0
13488	SHA	N/A	0.914	86	143332	3926	N/A	18.895	2514	5274	95	0
13489	SHA	N/A	6.140	269	43700	121	N/A	3.765	194	0	0	0
13490	WSA	N/A	2.905	432	4289	39	N/A	3.608	419	22942	100	0
13491	WSA	N/A	1.381	59	3937	25	N/A	9.811	1654	55379	378	0
13492	WSA	N/A	5.234	564	7296	61	N/A	2.522	208	5550	65	0
13493	WSA	N/A	2.133	260	12667	66	N/A	3.497	308	0	0	0
13494	SHA	N/A	0.329	2	109430	1514	N/A	3.669	416	40096	1027	0
13495	ESA	N/A	2.551	207	826	5	N/A	9.579	1053	0	0	4
13496	CSA	N/A	1.095	71	15191	125	N/A	0.983	200	3280	12	0
13497	CSA	N/A	0.111	4	0	0	N/A	1.108	126	517	1	0
13498	CSA	N/A	0.000	0	0	0	N/A	0.395	0	0	0	0
13499	CSA	N/A	0.045	0	560	6	N/A	0.598	39	404	1	0
13500	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13501	ESA	N/A	0.903	15	1615	30	N/A	1.951	51	1034	22	0
13502	ESA	N/A	3.945	200	43164	487	N/A	9.633	1675	14324	119	0
13503	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13504	ESA	N/A	0.132	4	0	0	N/A	1.252	13	0	0	0
13505	ESA	N/A	3.254	195	8228	171	N/A	5.547	891	0	0	0
13506	ESA	N/A	2.754	88	21099	196	N/A	4.970	584	641	3	0
13507	ESA	N/A	0.050	0	0	0	N/A	1.755	31	312	2	0
13509	ESA	N/A	6.666	315	50427	403	N/A	12.852	1611	31785	189	0
13510	WSA	N/A	3.422	379	5066	52	N/A	8.211	1108	26304	83	0
13511	WSA	N/A	3.348	386	21764	59	N/A	4.006	290	561	10	0
13512	WSA	N/A	3.505	442	152263	1318	N/A	8.073	1382	42854	201	0
13513	WSA	N/A	0.848	27	0	0	N/A	1.569	190	115	1	0
13514	WSA	N/A	1.847	215	8449	140	N/A	3.455	367	12355	53	0
13516	WSA	N/A	4.027	473	118190	1468	N/A	3.758	376	578	1	0
13517	WSA	N/A	4.188	446	31813	421	N/A	3.366	1009	0	0	2
13518	WSA	N/A	0.272	23	0	0	N/A	0.196	3	0	0	0
13519	WSA	N/A	0.644	28	1843	8	N/A	0.119	88	0	0	0
13520	WSA	N/A	1.151	120	2839	10	N/A	2.858	416	0	0	0
13521	WSA	N/A	0.006	0	0	0	N/A	1.885	18	0	0	0
13522	WSA	N/A	10.681	1402	30768	256	N/A	1.205	755	270	162	0
13523	WSA	N/A	6.963	840	196168	1773	N/A	1.456	538	661	21	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	2.583	0.188	0	0	0	2.395	19	147709	902	-5%	6.78
1	Yes	3.378	0.835	0	0	0	2.542	207	379930	2796	-5%	6.76
1	Yes	4.561	0.807	0	0	0	3.753	72	58647	520	-1%	3.73
0	Yes	1.929	0.070	0	0	0	1.858	94	0	0	-15%	4.01
0	Yes	2.939	0.068	0	0	0	2.871	58	232921	5280	-2%	5.17
0	Yes	2.020	0.276	0	0	0	1.744	48	0	0	-2%	5.88
0	Yes	2.091	0.489	0	0	0	1.603	95	0	0	-3%	2.89
0	Yes	2.627	1.027	0	0	0	1.601	8	43710	376	2%	2.25
0	Yes	3.606	2.222	0	0	0	1.384	41	36189	1159	34%	4.13
0	Yes	1.925	0.086	0	0	0	1.839	15	20227	288	-38%	2.53
0	Yes	3.511	2.408	0	0	0	1.103	6	0	0	8%	6.81
0	Yes	0.766	0.766	0	0	0	0.000	0	0	0	-22%	3.79
0	Yes	3.317	1.684	0	0	0	1.633	4	0	0	-1%	6.08
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.834	0.210	0	0	0	1.624	7	0	0	-3%	5.55
0	Yes	3.578	1.141	0	89328	841	2.436	57	0	0	1%	8.14
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.943	1.112	0	0	0	0.831	4	0	0	5%	3.08
0	Yes	2.807	1.360	0	0	0	1.446	40	0	0	-3%	4.92
0	Yes	4.368	1.744	0	20332	710	2.624	33	0	0	11%	4.74
2	Yes	1.689	1.378	0	0	0	0.312	2	3051	70	22%	4.37
0	Yes	4.097	0.736	0	0	0	3.361	47	10493	3850	6%	8.21
0	Yes	1.837	0.070	0	0	0	1.767	36	0	0	3%	6.07
0	Yes	2.320	0.390	0	0	0	1.930	97	0	0	-6%	4.95
0	Yes	2.269	0.288	0	0	0	1.981	36	0	0	0%	6.46
0	Yes	0.947	0.561	0	0	0	0.387	11	0	0	3%	4.23
0	Yes	3.524	0.211	0	0	0	3.313	40	0	0	-5%	3.99
0	Yes	1.886	0.122	0	0	0	1.764	74	0	0	-2%	4.82
0	Yes	1.759	0.068	0	0	0	1.691	22	0	0	-4%	6.30
0	Yes	1.382	0.374	0	0	0	1.007	61	0	0	0%	4.39
0	Yes	1.061	0.023	0	0	0	1.038	67	0	0	3%	2.35
0	Yes	2.214	0.516	0	0	0	1.698	57	48404	596	-8%	4.31
0	Yes	0.749	0.332	0	0	0	0.417	11	0	0	4%	4.36
1	Yes	2.795	1.496	0	0	0	1.299	175	0	0	3%	6.85
0	Yes	2.805	0.227	0	0	0	2.579	351	0	0	16%	6.13

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13524	WSA	N/A	0.945	125	0	0	0	1.249	101	0	0	0
13525	WSA	N/A	0.000	0	0	0	0	0.000	0	0	0	0
13526	WSA	N/A	0.000	0	0	0	0	0.000	0	0	0	0
13530	WSA	N/A	5.448	876	37868	249	N/A	0.000	0	0	0	0
13531	WSA	N/A	2.389	62	11244	153	N/A	4.210	83	866	24	0
13532	WSA	N/A	4.181	368	8343	95	N/A	1.005	51	0	0	9
13533	WSA	N/A	2.302	256	28489	2367	N/A	6.176	1506	20126	122	7
13535	WSA	N/A	5.238	300	19241	157	N/A	15.085	1835	832	110	3
13538	WSA	N/A	0.234	5	9919	51	N/A	13.676	914	19134	145	0
13539	WSA	N/A	0.616	11	5494	41	N/A	12.443	1059	6578	84	0
13540	WSA	N/A	0.200	5	0	0	N/A	6.727	708	0	0	0
13541	WSA	N/A	0.000	0	6335	61	N/A	15.148	1001	18640	123	0
13544	WSA	N/A	0.625	30	4527	17	N/A	4.811	708	0	0	0
13546	CSA	N/A	7.151	314	7933	28	N/A	3.120	38	648	1	0
13547	CSA	N/A	4.104	308	0	0	N/A	1.787	209	593	2	0
13551	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13552	CSA	N/A	2.733	51	533	3	N/A	1.150	14	436	5	0
13553	CSA	N/A	0.000	0	0	0	N/A	1.286	0	0	0	0
13554	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13560	CSA	N/A	0.000	0	0	0	N/A	0.144	0	0	0	0
13561	CSA	N/A	0.000	0	0	0	N/A	0.153	0	0	0	0
13562	CSA	N/A	0.000	0	0	0	N/A	0.245	0	0	0	0
13563	CSA	N/A	0.000	0	0	0	N/A	0.346	0	0	0	0
13564	CSA	N/A	0.000	0	0	0	N/A	0.455	257	0	0	0
13565	CSA	N/A	0.000	0	0	0	N/A	0.373	0	0	0	0
13566	CSA	N/A	0.000	0	0	0	N/A	1.507	600	4264	88	0
13567	CSA	N/A	0.000	0	0	0	N/A	0.032	510	0	0	0
13572	WSA	N/A	0.758	68	553	9	N/A	9.358	946	20787	96	0
13573	WSA	N/A	0.457	10	673	4	N/A	10.539	1054	23736	131	0
13574	WSA	N/A	2.984	231	12424	113	N/A	5.472	609	12839	208	0
13575	WSA	N/A	0.453	13	1067	21	N/A	5.424	594	0	0	0
13576	ESA	N/A	2.896	221	15546	117	N/A	14.622	1438	13257	147	0
13577	ESA	N/A	2.908	34	5074	23	N/A	9.102	36	9239	72	0
13579	ESA	N/A	6.249	192	12538	42	N/A	17.633	1381	4299	28	0
13582	WSA	N/A	5.862	177	107798	650	N/A	15.475	1127	42061	227	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded Through December 31, 2021
0	Yes	1.263	0.329	0	0	0	0.933	81	0	0	0%	8.46
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.851	0.184	0	0	0	0.667	0	80443	1243	2%	3.93
0	Yes	3.063	0.841	0	0	0	2.222	38	0	0	-48%	2.03
0	Yes	1.928	0.038	0	0	0	1.891	53	0	0	-8%	4.86
6	Yes	2.942	0.019	0	0	0	2.924	98	1615	466	4%	5.91
2	Yes	2.121	0.078	0	0	0	2.043	105	99121	2223	-9%	7.86
0	Yes	2.404	1.068	1	0	0	1.336	11	3049	924	0%	6.36
0	Yes	2.016	0.115	0	0	0	1.901	10	0	0	5%	4.96
0	Yes	1.948	0.078	0	0	0	1.871	4	7097	705	-7%	2.71
0	Yes	1.544	1.544	0	0	0	0.000	0	0	0	0%	5.29
0	Yes	2.055	0.062	0	0	0	1.993	10	0	0	-5%	2.97
0	Yes	4.823	0.946	4	0	0	3.877	78	103741	1932	1%	8.81
0	Yes	3.467	0.152	0	0	0	3.316	81	0	0	8%	4.41
0	Yes	0.345	0.104	0	0	0	0.241	0	0	0	-42%	0.63
0	Yes	1.946	0.058	0	0	0	1.888	4	0	0	-7%	5.15
0	Yes	0.588	0.588	0	0	0	0.000	0	0	0	45%	4.59
0	Yes	0.316	0.316	0	0	0	0.000	0	0	0	-28%	4.60
0	Yes	2.341	2.341	0	0	0	0.000	0	0	0	-3%	1.92
0	Yes	3.713	3.713	0	0	0	0.000	0	0	0	-4%	2.48
0	Yes	3.012	3.012	0	0	0	0.000	0	0	0	-4%	2.58
0	Yes	2.242	2.242	0	0	0	0.000	0	0	0	-6%	2.19
0	Yes	2.059	2.059	0	0	0	0.000	0	0	0	-5%	2.81
0	Yes	2.551	2.551	0	0	0	0.000	0	0	0	-4%	2.17
0	Yes	1.222	1.222	0	0	0	0.000	0	0	0	28%	1.34
0	Yes	1.056	1.056	0	0	0	0.000	0	0	0	-6%	0.81
0	Yes	1.126	0.205	0	0	0	0.920	10	0	0	2%	3.92
0	Yes	1.027	0.274	0	0	0	0.752	5	0	0	-10%	4.43
0	Yes	1.887	0.149	0	0	0	1.738	54	0	0	6%	4.13
0	Yes	1.034	0.116	0	0	0	0.918	21	0	0	-3%	2.57
0	Yes	4.800	0.401	0	0	0	4.399	141	98455	1766	-3%	7.55
0	Yes	3.338	0.014	0	0	0	3.325	7	0	0	-2%	4.65
1	Yes	3.330	0.155	0	0	0	3.175	88	0	0	3%	7.77
0	Yes	6.396	2.562	1	0	0	3.833	37	0	0	-1%	9.10

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13583	WSA	N/A	4.583	117	10577	199	N/A	6.527	381	778	2	0
13584	WSA	N/A	0.191	1	854	7	N/A	10.337	952	17607	110	0
13585	WSA	N/A	0.506	17	701	13	N/A	7.088	1404	10631	57	0
13586	WSA	N/A	8.042	189	1383	8	N/A	12.875	1079	3290	20	0
13587	WSA	N/A	1.641	7	3410	77	N/A	14.451	2258	16940	173	0
13588	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13589	WSA	N/A	0.539	3	259	108	N/A	10.661	1333	8439	49	0
13590	CSA	N/A	3.181	374	46628	997	N/A	2.743	859	2742	36	0
13591	CSA	N/A	7.967	1072	33677	259	N/A	1.465	517	6378	41	0
13592	CSA	N/A	7.504	1226	21752	2255	N/A	1.585	141	0	0	0
13593	CSA	N/A	5.557	562	15290	239	N/A	1.238	151	30123	373	8
13594	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13598	CSA	N/A	0.000	0	0	0	N/A	0.012	0	0	0	0
13599	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13600	CSA	N/A	6.106	617	23118	117	N/A	1.777	497	9192	65	0
13601	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13602	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13605	WSA	N/A	2.628	238	11251	130	N/A	1.754	424	0	0	0
13606	WSA	N/A	0.754	36	1736	12	N/A	0.387	196	0	0	0
13607	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13608	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13610	WSA	N/A	5.833	650	16690	258	N/A	1.684	670	15344	55	1
13611	WSA	N/A	3.257	371	14709	106	N/A	0.247	54	61500	244	0
13612	WSA	N/A	7.821	1003	22178	242	N/A	1.022	361	8068	17	0
13613	WSA	N/A	5.370	730	14502	53	N/A	0.862	288	19437	212	0
13614	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13621	WSA	N/A	15.590	415	5048	63	N/A	4.166	75	0	0	2
13622	WSA	N/A	20.273	797	27784	1055	N/A	13.071	674	3248	19	1
13624	WSA	N/A	16.160	388	85610	659	N/A	10.448	287	941	6	0
13630	CSA	N/A	5.795	701	37781	185	N/A	1.698	283	362	2	12
13631	CSA	N/A	5.465	431	11304	134	N/A	9.771	924	5305	61	6
13632	CSA	N/A	5.257	500	2005	39	N/A	0.563	120	0	0	0
13633	CSA	N/A	2.109	95	15611	54	N/A	7.145	891	9587	105	12
13635	WSA	N/A	0.052	0	0	0	N/A	2.595	22	194	1	0
13636	WSA	N/A	0.042	0	0	0	N/A	0.578	4	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	3.288	0.224	0	0	0	3.065	11	74260	1006	-17%	4.95
0	Yes	2.136	0.045	0	0	0	2.091	8	82695	900	-14%	4.15
0	Yes	1.647	0.440	0	0	0	1.207	11	0	0	-4%	5.84
0	Yes	3.341	0.701	0	0	0	2.639	30	0	0	1%	6.74
0	Yes	3.031	1.174	0	144904	2260	1.857	7	0	0	8%	8.03
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	5.123	2.330	0	0	0	2.793	8	0	0	2%	6.97
0	Yes	3.164	0.031	0	0	0	3.133	157	215141	3254	-7%	5.83
0	Yes	3.752	0.121	0	26957	864	3.631	259	0	0	24%	10.38
1	Yes	1.993	0.126	0	0	0	1.867	95	0	0	-8%	4.81
3	Yes	2.566	0.144	0	0	0	2.422	121	59639	1698	-12%	3.54
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.913	0.913	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.525	0.143	0	0	0	1.382	58	24999	1033	0%	6.45
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.837	0.197	0	0	0	0.640	23	0	0	6%	2.59
0	Yes	1.435	0.046	0	0	0	1.389	72	0	0	-45%	1.56
0	Yes	0.003	0.003	0	0	0	0.000	0	0	0	8%	9.53
0	Yes	0.003	0.003	0	0	0	0.000	0	0	0	-8%	13.42
0	Yes	1.312	0.227	0	0	0	1.085	55	0	0	-2%	5.61
0	Yes	0.906	0.165	0	0	0	0.741	20	0	0	9%	2.40
0	Yes	1.356	0.140	0	0	0	1.216	43	0	0	5%	5.12
0	Yes	1.490	0.263	0	0	0	1.227	96	0	0	-9%	3.55
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
2	Yes	3.091	0.016	0	0	0	3.076	31	1354	511	-7%	2.67
2	Yes	2.073	0.058	0	0	0	2.014	14	114242	2892	1%	9.83
2	Yes	3.377	0.044	0	0	0	3.334	45	1871	706	-3%	4.08
1	Yes	3.701	0.358	0	0	0	3.343	229	0	0	-2%	5.82
2	Yes	2.290	0.322	0	0	0	1.968	91	0	0	-2%	6.74
0	Yes	2.152	0.086	0	0	0	2.066	100	988	714	-1%	2.68
5	Yes	3.800	0.308	0	0	0	3.492	122	2173	1105	-11%	6.31
0	Yes	2.809	1.363	0	0	0	1.447	15	0	0	-20%	6.86
0	Yes	1.873	0.732	0	998	42	1.140	5	0	0	3%	5.58

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13637	WSA	N/A	1.035	50	0	0	N/A	0.923	88	0	0	0
13638	WSA	N/A	2.245	220	21509	69	N/A	0.961	130	0	0	0
13639	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13640	WSA	N/A	0.000	0	0	0	N/A	2.471	2	0	0	0
13641	WSA	N/A	0.000	0	0	0	N/A	1.406	16	0	0	0
13642	WSA	N/A	0.000	0	0	0	N/A	0.259	2	0	0	0
13643	WSA	N/A	0.000	0	0	0	N/A	0.787	15	0	0	0
13645	SHA	N/A	4.024	103	9469	193	N/A	31.133	3089	69398	1018	1
13646	SHA	N/A	0.159	0	5869	50	N/A	17.770	1700	1698	5	0
13647	SHA	N/A	1.196	71	11241	163	N/A	22.324	1906	6129	65	0
13648	SHA	N/A	22.941	449	9139	273	N/A	18.187	740	83	1	0
13649	SHA	N/A	4.930	322	13453	174	N/A	2.676	258	0	0	0
13650	SHA	N/A	0.687	33	3989	12	N/A	16.983	1907	31503	186	0
13651	SHA	N/A	3.182	154	3635	27	N/A	14.576	1666	20933	123	0
13652	SHA	N/A	4.091	208	16560	182	N/A	33.915	2462	0	0	0
13655	PCA	N/A	7.354	322	11485	98	N/A	7.101	703	0	0	0
13656	PCA	N/A	39.168	1154	106323	1875	N/A	9.302	571	187	20	7
13657	PCA	N/A	20.578	476	47594	1079	N/A	6.798	262	109	1	0
13659	WHA	N/A	4.528	116	130763	484	N/A	12.626	974	1982	10	0
13660	WHA	N/A	2.562	40	623	4	N/A	3.527	156	320	2	0
13661	WHA	N/A	6.814	342	6440	148	N/A	21.077	1526	34380	653	0
13662	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13668	PCA	N/A	9.186	284	6517	369	N/A	21.450	1537	3937	11	0
13669	WSA	N/A	2.495	173	92990	591	N/A	10.611	1117	1041	108	0
13670	WSA	N/A	1.209	5	203	1	N/A	7.213	611	2847	30	0
13671	WSA	N/A	0.105	0	4134	69	N/A	11.724	1648	10871	90	0
13672	WSA	N/A	3.978	275	20492	284	N/A	12.560	2630	8847	167	0
13673	WSA	N/A	1.069	0	68729	680	N/A	10.559	1032	4602	37	0
13674	WSA	N/A	1.027	1	0	0	N/A	10.038	1244	12619	97	0
13677	WSA	N/A	4.717	94	120835	658	N/A	21.595	965	75091	276	0
13678	WSA	N/A	4.923	100	7627	199	N/A	19.105	2403	127158	2506	0
13679	WSA	N/A	9.280	343	9739	1104	N/A	16.253	872	2789	11	0
13685	ESA	N/A	2.509	113	15720	91	N/A	17.894	1280	0	0	0
13686	ESA	N/A	3.107	92	9080	76	N/A	15.936	1209	5293	62	1
13687	ESA	N/A	16.286	512	27410	801	N/A	13.529	967	14027	30	0

2021 Annual Reliability Performance Report

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	2.050	0.280	0	0	0	1.770	31	0	0	-1%	1.58
0	Yes	1.840	0.509	0	0	0	1.331	35	0	0	-9%	2.23
0	Yes	0.420	0.420	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	3.355	3.355	0	0	0	0.000	0	0	0	-12%	7.47
0	Yes	3.581	3.581	0	0	0	0.000	0	962	6	24%	2.13
0	Yes	3.321	3.321	0	0	0	0.000	0	0	0	-5%	3.00
0	Yes	3.377	3.377	0	0	0	0.000	0	0	0	22%	3.41
0	Yes	7.129	3.466	9	0	0	3.663	29	243578	2743	3%	11.72
0	Yes	4.708	1.568	0	0	0	3.141	8	0	0	-4%	7.17
0	Yes	4.737	3.970	0	0	0	0.767	16	0	0	-2%	9.67
3	Yes	7.836	1.967	0	0	0	5.869	110	56345	1077	4%	6.06
0	Yes	1.718	0.121	14	0	0	1.597	49	0	0	1%	2.61
0	Yes	4.242	2.297	0	0	0	1.946	21	0	0	-1%	7.79
0	Yes	6.518	1.741	0	0	0	4.777	56	0	0	-6%	9.16
0	Yes	7.967	5.408	0	0	0	2.559	19	0	0	19%	9.94
1	Yes	3.218	0.083	0	0	0	3.135	71	0	0	-2%	3.99
2	Yes	8.894	0.345	0	0	0	8.549	166	6520	1836	-3%	8.87
0	Yes	2.667	0.168	0	0	0	2.498	90	11163	132	-1%	3.79
0	Yes	3.693	0.879	0	0	0	2.815	63	59031	1105	9%	5.09
0	Yes	3.899	1.212	0	0	0	2.687	5	0	0	-26%	1.90
0	Yes	5.614	1.955	0	0	0	3.659	49	6810	1849	4%	9.45
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	3.181	2.053	17	6383	1915	1.128	19	0	0	17%	8.93
0	Yes	2.639	0.609	16	0	0	2.030	45	0	0	0%	5.07
0	Yes	0.899	0.110	0	0	0	0.788	1	0	0	2%	2.78
0	Yes	3.165	1.727	0	0	0	1.439	20	0	0	-3%	6.01
0	Yes	4.355	0.838	0	0	0	3.517	22	0	0	4%	8.60
0	Yes	3.178	1.032	0	0	0	2.146	10	0	0	1%	5.05
0	Yes	4.274	1.451	2	0	0	2.823	11	0	0	-6%	5.48
1	Yes	6.238	3.506	0	0	0	2.733	18	15673	2177	23%	8.48
0	Yes	3.121	0.288	0	0	0	2.832	13	203690	2463	-8%	7.24
1	Yes	4.827	0.474	0	0	0	4.353	77	148443	1283	3%	8.67
0	Yes	4.974	2.219	0	0	0	2.755	67	306829	4279	1%	8.35
1	Yes	2.772	0.126	0	0	0	2.647	73	85412	2000	0%	7.92
1	Yes	6.519	0.223	110	0	0	6.295	217	67801	3298	-3%	8.05

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13689	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13690	ESA	N/A	1.761	88	125190	758	N/A	11.486	776	0	0	0
13691	ESA	N/A	0.898	29	73	1	N/A	10.999	877	0	0	0
13692	ESA	N/A	1.108	22	10762	62	N/A	6.768	635	25670	165	0
13693	ESA	N/A	4.835	196	6061	76	N/A	7.482	623	0	0	0
13695	WHA	N/A	9.325	693	11740	109	N/A	15.478	970	14652	153	0
13696	WHA	N/A	13.536	1365	14903	214	N/A	1.767	93	0	0	19
13697	WHA	N/A	14.115	718	114032	1161	N/A	1.357	13	173	1	0
13698	WHA	N/A	16.919	1063	159744	1077	N/A	2.368	15	583	6	0
13699	WHA	N/A	5.945	293	15006	118	N/A	9.762	1032	19178	164	0
13701	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13705	ESA	N/A	8.625	515	29719	249	N/A	11.905	1001	1472	13	0
13706	ESA	N/A	3.789	193	749	4	N/A	10.936	1495	11025	26	0
13707	ESA	N/A	1.187	56	4655	23	N/A	8.384	1101	845	8	0
13708	ESA	N/A	1.369	64	77	1	N/A	13.360	1399	29405	157	0
13709	ESA	N/A	6.196	568	59156	560	N/A	8.134	608	557	1	0
13710	ESA	N/A	6.682	338	34066	292	N/A	15.341	2342	13999	56	0
13711	ESA	N/A	1.240	5	25543	2479	N/A	17.567	2731	8267	97	1
13712	ESA	N/A	8.415	428	20548	188	N/A	6.062	555	7250	33	0
13713	CSA	N/A	0.000	0	0	0	N/A	0.040	2	0	0	0
13714	CSA	N/A	0.470	7	0	0	N/A	15.735	3343	36586	307	0
13715	CSA	N/A	0.614	5	4681	175	N/A	8.880	2886	1559	35	0
13716	CSA	N/A	0.016	0	3178	36	N/A	7.105	578	382	6	0
13717	CSA	N/A	1.862	4	4704	86	N/A	8.799	528	503	4	0
13718	CSA	N/A	0.008	0	0	0	N/A	19.080	1074	9994	88	0
13719	CSA	N/A	0.226	1	28426	348	N/A	25.270	1387	0	0	0
13720	PCA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13722	PCA	N/A	9.831	421	7276	73	N/A	1.889	73	0	0	0
13723	PCA	N/A	14.647	416	31563	562	N/A	4.066	200	1839	8	2
13724	PCA	N/A	28.665	752	70886	566	N/A	13.342	588	1861	11	0
13729	ESA	N/A	2.017	42	16505	280	N/A	10.562	934	1561	9	0
13731	ESA	N/A	0.094	1	198	44	N/A	11.070	898	37441	231	0
13732	ESA	N/A	0.099	21	793	41	N/A	16.562	1251	10513	135	0
13733	ESA	N/A	1.858	2	11245	79	N/A	26.753	1923	0	0	0
13737	WSA	N/A	3.932	501	25610	157	N/A	0.613	115	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	2.760	1.197	0	0	0	1.563	28	61504	878	-6%	5.95
0	Yes	3.459	0.934	0	130342	920	2.525	16	96232	920	-5%	5.28
0	Yes	2.170	0.163	0	0	0	2.008	15	39061	666	-6%	2.84
0	Yes	3.680	0.993	0	82525	883	2.687	62	213394	2525	-4%	5.55
2	Yes	3.174	0.040	0	0	0	3.134	108	256452	1826	19%	9.12
4	Yes	4.570	0.142	0	0	0	4.428	218	25633	1727	-1%	8.95
0	Yes	3.268	0.435	0	0	0	2.833	65	0	0	-5%	2.84
1	Yes	5.431	0.657	0	0	0	4.775	109	0	0	-1%	7.11
0	Yes	2.026	0.509	0	0	0	1.517	12	82787	1312	0%	4.45
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	3.244	0.144	0	0	0	3.100	61	0	0	-4%	6.99
0	Yes	2.789	0.225	0	0	0	2.564	66	0	0	21%	7.61
0	Yes	3.437	0.924	0	0	0	2.513	17	125417	2339	-4%	4.89
0	Yes	4.047	0.726	0	0	0	3.321	23	96065	2775	-14%	7.89
0	Yes	2.665	0.121	0	0	0	2.544	51	0	0	2%	4.92
3	Yes	3.168	0.274	0	0	0	2.894	66	26024	2725	-2%	10.36
2	Yes	4.283	1.028	0	0	0	3.255	14	0	0	-5%	9.82
0	Yes	5.735	0.920	0	0	0	4.815	141	0	0	2%	5.68
0	Yes	0.252	0.071	0	0	0	0.180	0	0	0	0%	0.01
2	Yes	5.001	2.277	0	0	0	2.723	27	294749	3366	1%	9.27
0	Yes	5.219	2.168	2	0	0	3.051	36	0	0	2%	6.97
0	Yes	4.385	0.783	0	0	0	3.602	57	176156	2533	-10%	3.21
0	Yes	5.370	2.277	0	0	0	3.093	15	0	0	9%	5.98
0	Yes	3.790	2.702	0	0	0	1.088	0	0	0	1%	6.74
0	Yes	4.225	1.952	0	0	0	2.274	15	0	0	-5%	6.20
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	3.443	0.019	0	0	0	3.424	84	0	0	20%	6.73
2	Yes	4.500	0.072	0	0	0	4.428	55	2008	1095	18%	3.84
1	Yes	6.205	0.073	16	0	0	6.133	137	0	0	0%	7.17
0	Yes	2.563	0.073	0	0	0	2.490	12	0	0	-2%	5.76
0	Yes	2.510	1.295	0	0	0	1.215	3	0	0	-2%	4.20
0	Yes	2.027	1.883	0	0	0	0.144	0	0	0	-3%	7.39
0	Yes	6.075	3.399	0	0	0	2.676	14	0	0	11%	10.53
0	Yes	2.568	0.353	0	0	0	2.215	181	53388	783	2%	4.47

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13738	WSA	N/A	1.752	166	100672	1352	N/A	2.085	476	0	0	0
13739	WSA	N/A	0.827	45	2604	21	N/A	0.828	117	1011	1	0
13740	WSA	N/A	10.441	1343	21236	242	N/A	0.180	2	0	0	0
13745	WSA	N/A	1.348	33	24109	127	N/A	16.937	1825	10014	91	0
13747	WSA	N/A	1.420	139	1398	20	N/A	2.497	480	21785	115	0
13748	WSA	N/A	4.297	368	37749	345	N/A	7.897	736	18239	119	3
13749	WSA	N/A	1.769	229	27527	182	N/A	9.720	1229	11105	37	0
13750	WSA	N/A	1.757	78	18589	106	N/A	6.215	680	86114	807	0
13751	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13753	WSA	N/A	3.889	625	322	3	N/A	0.089	1	0	0	0
13754	WSA	N/A	7.488	1219	53664	619	N/A	1.059	250	13937	168	4
13756	WSA	N/A	2.682	815	54877	323	N/A	1.276	685	0	0	0
13761	WSA	N/A	0.338	6	2379	35	N/A	1.810	1037	0	0	0
13762	WSA	N/A	0.159	5	255	2	N/A	1.664	24	0	0	0
13763	WSA	N/A	0.000	0	0	0	N/A	0.027	0	0	0	0
13764	WSA	N/A	0.159	0	732	2	N/A	1.304	462	0	0	0
13765	WSA	N/A	0.000	0	0	0	N/A	0.478	4	0	0	0
13766	WSA	N/A	0.000	0	0	0	N/A	1.230	16	0	0	0
13769	WHA	N/A	16.452	368	16586	272	N/A	23.978	1467	10850	100	0
13770	WHA	N/A	3.983	182	35950	360	N/A	24.666	1734	17479	204	0
13772	WHA	N/A	10.221	396	10702	74	N/A	7.691	114	357	12	0
13777	SHA	N/A	2.115	250	1637	12	N/A	12.383	789	18198	108	4
13780	SHA	N/A	7.012	659	16072	197	N/A	9.900	761	14265	91	0
13781	SHA	N/A	0.235	17	60	1	N/A	0.703	39	6318	41	0
13782	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13785	PCA	N/A	28.261	433	60200	789	N/A	9.327	292	13316	140	4
13786	PCA	N/A	43.954	795	39371	134	N/A	3.648	33	0	0	0
13787	PCA	N/A	41.517	871	85267	853	N/A	8.854	131	0	0	0
13793	ESA	N/A	3.736	191	28591	249	N/A	12.812	1444	11439	116	3
13794	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13795	ESA	N/A	4.117	144	29110	288	N/A	16.141	1232	24646	211	0
13796	ESA	N/A	6.377	168	14538	189	N/A	9.317	1353	16493	37	0
13797	ESA	N/A	4.282	166	36925	345	N/A	16.642	1294	21807	86	0
13798	ESA	N/A	3.479	193	189175	639	N/A	10.104	1041	25144	254	0
13799	ESA	N/A	2.656	126	63307	618	N/A	11.539	1713	5389	15	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	2.384	0.957	70	0	0	1.426	76	0	0	-14%	5.43
0	Yes	1.454	0.454	0	0	0	0.999	18	0	0	-10%	2.77
0	Yes	1.368	0.290	0	0	0	1.077	87	45145	1382	0%	6.13
5	Yes	2.412	0.568	0	0	0	1.844	17	0	0	6%	7.50
0	Yes	1.570	0.222	0	0	0	1.348	31	0	0	-1%	3.33
1	Yes	3.800	0.394	0	51935	1179	3.406	65	0	0	1%	7.01
0	Yes	2.143	0.309	0	23616	1501	1.834	41	0	0	-6%	5.29
0	Yes	1.700	0.310	0	77991	767	1.350	12	0	0	-9%	3.78
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.880	0.033	0	0	0	1.847	182	0	0	1%	4.60
0	Yes	0.742	0.133	0	0	0	0.609	43	4091	1461	-1%	6.60
0	Yes	1.409	0.216	0	0	0	1.193	128	0	0	1%	5.94
1	Yes	1.599	0.645	0	0	0	0.955	18	0	0	-5%	3.02
0	Yes	3.047	2.027	0	0	0	1.020	13	0	0	-7%	5.68
0	Yes	0.527	0.527	0	0	0	0.000	0	0	0	7%	2.66
0	Yes	0.879	0.124	0	0	0	0.754	12	3065	484	10%	4.85
0	Yes	0.926	0.926	110	0	0	0.000	0	983	15	4%	1.65
0	Yes	2.432	2.432	0	0	0	0.000	0	1382	16	-4%	1.31
1	Yes	7.441	1.743	0	0	0	5.698	47	0	0	14%	7.47
0	Yes	4.975	0.866	0	0	0	4.110	129	0	0	-3%	8.84
1	Yes	13.025	6.816	0	0	0	6.209	57	0	0	-15%	3.89
0	Yes	4.718	2.361	0	0	0	2.357	116	150151	1990	-38%	5.71
0	Yes	2.276	0.550	0	0	0	1.726	71	114072	1479	17%	8.58
0	Yes	1.104	0.175	0	0	0	0.929	11	0	0	9%	9.14
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	3.408	0.393	0	0	0	3.015	40	51188	2750	0%	4.11
2	Yes	5.549	0.561	0	0	0	4.988	100	66476	916	-6%	3.75
1	Yes	8.788	0.207	0	0	0	8.581	165	0	0	6%	6.45
3	Yes	3.163	0.722	0	0	0	2.440	55	0	0	-8%	6.77
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	3.495	0.141	0	0	0	3.354	64	0	0	-1%	7.79
0	Yes	3.567	0.542	0	0	0	3.024	52	0	0	-4%	5.08
0	Yes	3.282	0.057	0	0	0	3.226	68	58007	3045	3%	9.13
0	Yes	2.088	0.251	0	0	0	1.838	27	17254	2014	-6%	6.52
0	Yes	2.769	0.286	0	0	0	2.483	53	0	0	-4%	6.68

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13805	PCA	N/A	47.138	1102	79995	1008	N/A	4.863	84	38	1	43
13807	PCA	N/A	34.757	1041	48131	335	N/A	3.019	94	1111	7	54
13808	PCA	N/A	102.075	1855	146367	1204	N/A	6.512	128	137	3	52
13813	DCA	N/A	44.649	756	103467	517	N/A	8.622	128	4779	35	17
13815	DCA	N/A	38.958	544	12841	107	N/A	8.163	136	249	2	1
13817	SHA	N/A	14.204	757	102839	2253	N/A	13.602	1117	1351	6	0
13818	SHA	N/A	1.745	12	282	2	N/A	11.657	951	0	0	0
13819	SHA	N/A	0.611	1	0	0	N/A	1.422	21	0	0	0
13820	SHA	N/A	2.746	66	0	0	N/A	1.341	60	4058	38	0
13822	SHA	N/A	1.895	46	5203	49	N/A	19.920	1471	6471	20	0
13823	SHA	N/A	0.000	0	0	0	N/A	0.011	0	0	0	0
13824	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13825	SHA	N/A	7.129	779	8825	88	N/A	2.154	621	617	2	0
13826	CSA	N/A	3.623	221	16060	194	N/A	6.223	1497	21477	186	5
13827	CSA	N/A	3.991	358	7252	101	N/A	3.407	386	20520	127	0
13828	CSA	N/A	5.748	470	145629	812	N/A	3.459	851	9105	32	4
13829	CSA	N/A	1.033	40	10588	93	N/A	8.331	790	23463	202	0
13830	CSA	N/A	3.688	294	9386	59	N/A	5.845	296	0	0	5
13831	CSA	N/A	0.613	108	233	4	N/A	5.516	1174	0	0	0
13832	CSA	N/A	2.976	255	21122	175	N/A	1.366	148	0	0	0
13833	CSA	N/A	0.000	0	0	0	N/A	0.024	0	0	0	0
13834	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13835	CSA	N/A	5.362	635	77464	590	N/A	3.681	722	0	0	0
13836	CSA	N/A	4.167	160	12689	54	N/A	12.588	553	15583	74	0
13837	CSA	N/A	4.013	437	65984	329	N/A	7.588	612	13816	112	0
13838	CSA	N/A	9.401	656	28603	443	N/A	6.580	1012	44334	402	16
13839	CSA	N/A	6.680	329	16103	109	N/A	16.840	782	5668	50	0
13840	CSA	N/A	6.948	319	6923	88	N/A	10.110	1549	7286	29	20
13843	CSA	N/A	0.220	2	0	0	N/A	0.168	1	0	0	0
13844	CSA	N/A	0.130	3	5584	22	N/A	2.724	720	1557	8	0
13845	CSA	N/A	0.000	0	0	0	N/A	3.709	0	0	0	0
13850	PCA	N/A	0.083	2	960	1	N/A	13.995	889	8255	164	0
13851	PCA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13853	PCA	N/A	2.116	16	39797	315	N/A	27.411	1396	93458	602	0
13854	PCA	N/A	10.489	609	5614	12	N/A	15.737	1390	0	0	13

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Through December 31, 2021
6	Yes	5.651	0.025	0	0	0	5.626	94	23198	1245	-6%	5.64
6	Yes	6.950	0.097	0	0	0	6.853	145	6481	1111	-4%	5.83
8	Yes	15.137	0.241	0	0	0	14.896	176	180841	6136	-4%	8.17
1	Yes	5.122	0.025	0	0	0	5.097	53	61197	697	4%	3.70
2	Yes	6.323	0.265	0	0	0	6.058	30	38068	671	-1%	2.87
1	Yes	6.497	1.161	22	0	0	5.337	127	0	0	-46%	5.93
0	Yes	5.776	1.700	9	0	0	4.076	5	0	0	18%	4.18
0	Yes	2.741	0.825	0	0	0	1.916	5	0	0	13%	1.81
0	Yes	2.679	1.530	0	0	0	1.148	17	0	0	-4%	1.17
0	0	5.702	3.745	37	0	0	1.957	19	0	0	NEW	5.78
0	0	0.476	0.206	0	0	0	0.270	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	2.574	0.017	0	0	0	2.557	169	0	0	3%	6.16
3	Yes	4.472	1.873	0	0	0	2.599	113	14605	3584	-3%	5.34
0	Yes	1.142	0.034	0	0	0	1.108	57	3980	1592	4%	3.57
1	Yes	1.703	0.146	0	0	0	1.557	39	0	0	-3%	6.32
0	Yes	3.266	0.046	0	0	0	3.220	21	36280	846	-2%	3.73
0	Yes	2.965	0.000	0	0	0	2.965	66	250818	6645	168%	10.64
0	Yes	1.447	0.027	0	0	0	1.420	75	49846	1288	6%	3.37
0	Yes	1.498	0.877	0	0	0	0.621	14	0	0	-1%	2.48
0	Yes	0.068	0.068	0	0	0	0.000	0	0	0	7%	6.58
0	Yes	0.111	0.111	0	0	0	0.000	0	0	0	-13%	2.89
0	Yes	1.393	0.018	0	0	0	1.375	29	0	0	-5%	5.05
1	Yes	1.686	0.073	0	0	0	1.613	27	0	0	7%	5.47
0	Yes	2.688	0.525	0	0	0	2.162	54	0	0	-6%	4.80
1	Yes	4.679	0.158	0	0	0	4.521	211	125351	1811	0%	6.83
1	Yes	5.586	0.123	0	0	0	5.463	106	0	0	-6%	7.82
0	Yes	4.843	0.173	0	0	0	4.669	183	0	0	0%	7.01
0	Yes	1.645	1.222	0	0	0	0.423	0	0	0	-45%	3.85
0	Yes	2.812	0.774	0	749	338	2.039	14	2433	1482	4%	6.27
0	Yes	0.662	0.662	0	0	0	0.000	0	0	0	6%	4.40
0	Yes	1.863	0.796	0	51534	888	1.067	1	0	0	-10%	3.93
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	4.421	2.880	0	0	0	1.542	10	0	0	-2%	7.92
3	Yes	5.307	0.837	0	0	0	4.470	50	0	0	-1%	8.52

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13858	CSA	N/A	0.000	0	0	0	0	0.236	0	0	0	0
13859	CSA	N/A	0.000	0	0	0	0	0.000	0	0	0	0
13860	WSA	N/A	1.862	49	3629	57	N/A	8.171	988	27455	252	0
13863	WSA	N/A	0.762	19	1021	4	N/A	7.311	700	50217	271	0
13864	WSA	N/A	2.199	108	77117	180	N/A	1.658	190	214	3	0
13865	WSA	N/A	2.726	135	5765	48	N/A	15.586	1592	17704	77	0
13866	WSA	N/A	3.567	158	68	4	N/A	4.590	291	1822	5	0
13867	WSA	N/A	1.849	108	27089	58	N/A	1.897	42	325	1	0
13868	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13869	WSA	N/A	0.160	4	275	1	N/A	6.849	563	160	2	0
13870	WSA	N/A	3.513	66	4623	622	N/A	14.435	1765	16312	148	0
13871	WSA	N/A	0.333	1	0	0	N/A	8.158	977	14868	113	0
13872	WSA	N/A	0.003	0	5106	44	N/A	11.433	913	17119	86	0
13873	WSA	N/A	2.274	43	21310	151	N/A	15.497	1403	66037	780	0
13878	ESA	N/A	1.990	42	21419	226	N/A	8.839	1461	0	0	0
13879	ESA	N/A	0.132	3	5091	39	N/A	8.653	2286	0	0	0
13880	ESA	N/A	0.164	1	110	2	N/A	8.134	1651	0	0	0
13881	ESA	N/A	0.000	0	0	0	N/A	1.741	95	0	0	0
13882	ESA	N/A	0.000	0	0	0	N/A	2.235	336	0	0	0
13883	ESA	N/A	1.226	28	0	0	N/A	4.880	1379	2231	85	0
13884	ESA	N/A	0.313	0	21646	188	N/A	11.703	1616	35139	384	0
13885	ESA	N/A	0.565	7	31506	442	N/A	9.960	1182	0	0	0
13886	WSA	N/A	0.000	0	0	0	N/A	11.794	1144	36137	212	0
13888	WSA	N/A	0.836	16	692	5	N/A	11.663	1150	11638	75	0
13889	WSA	N/A	6.841	284	61987	1476	N/A	13.664	1380	11069	109	0
13890	WSA	N/A	0.484	17	12984	106	N/A	7.255	659	11123	62	0
13891	WSA	N/A	0.006	0	976	49	N/A	17.161	1359	3215	31	0
13892	WSA	N/A	1.602	66	4370	54	N/A	7.331	906	6734	104	0
13893	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13895	WSA	N/A	0.758	85	78	1	N/A	2.134	205	1022	27	0
13896	SHA	N/A	7.831	790	29122	193	N/A	10.202	1109	45391	287	0
13897	SHA	N/A	3.172	21	541	7	N/A	16.514	1216	12905	123	0
13898	SHA	N/A	0.756	7	182978	2749	N/A	33.418	2314	13075	83	0
13899	SHA	N/A	7.092	496	42501	566	N/A	6.185	785	0	0	0
13900	SHA	N/A	1.830	25	1764	29	N/A	22.214	2238	1880	29	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	Yes	0.442	0.442	0	0	0	0.000	0	0	0	-26%	4.25
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.501	0.017	0	0	0	1.485	7	2803	1013	-2%	5.46
0	Yes	1.527	0.616	0	0	0	0.911	12	0	0	-20%	2.74
0	Yes	2.622	0.158	0	0	0	2.464	81	51134	530	5%	6.99
0	Yes	4.684	0.652	0	0	0	4.032	47	388008	8871	-2%	8.91
0	Yes	3.348	0.159	0	0	0	3.190	28	46847	949	-2%	6.21
0	Yes	2.151	0.193	0	0	0	1.958	53	18679	240	8%	5.61
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.105	0.095	0	0	0	1.010	9	0	0	-6%	5.41
0	Yes	2.388	0.090	0	0	0	2.298	24	0	0	-7%	6.75
0	Yes	1.724	0.327	0	775	21	1.397	9	19136	960	20%	4.83
0	Yes	1.521	1.437	9	0	0	0.084	0	62450	1842	1%	3.76
0	Yes	0.742	0.017	0	0	0	0.725	5	0	0	-1%	7.27
0	Yes	2.617	0.413	0	0	0	2.204	22	0	0	-6%	5.82
0	Yes	2.857	1.723	0	0	0	1.133	9	0	0	-2%	7.11
0	Yes	2.521	1.352	0	0	0	1.169	10	0	0	-4%	7.55
0	Yes	1.784	1.184	0	0	0	0.601	2	0	0	4%	3.55
0	Yes	1.272	1.272	0	0	0	0.000	0	0	0	2%	2.97
0	Yes	2.292	0.564	0	0	0	1.728	27	0	0	-2%	6.26
0	Yes	2.201	0.278	0	0	0	1.923	11	67125	1611	-6%	6.44
0	Yes	2.648	0.888	0	0	0	1.761	12	409498	6007	-6%	4.75
0	Yes	2.026	1.618	0	0	0	0.407	1	0	0	23%	5.57
0	Yes	2.575	0.452	0	0	0	2.122	10	0	0	2%	5.42
4	Yes	3.287	0.325	0	0	0	2.962	63	3966	394	-1%	9.92
3	Yes	1.654	0.070	0	0	0	1.584	59	28305	727	3%	3.75
0	Yes	2.319	1.566	0	0	0	0.752	14	67283	2909	7%	7.10
0	Yes	2.709	0.116	0	0	0	2.592	21	58338	986	-4%	6.10
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	2.203	0.077	0	0	0	2.127	15	47184	995	-34%	4.19
0	Yes	5.210	2.321	7	0	0	2.889	65	93338	1823	16%	6.81
0	Yes	6.373	3.747	0	0	0	2.626	10	109469	3413	22%	4.57
2	Yes	12.444	8.002	0	0	0	4.442	9	260323	6666	-2%	9.71
0	Yes	3.932	0.115	0	0	0	3.818	107	143662	4495	0%	6.72
2	Yes	5.642	1.063	0	0	0	4.579	18	160770	2258	1%	8.73

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13901	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13906	ESA	N/A	8.352	507	78674	685	N/A	17.073	1130	5829	50	0
13909	ESA	N/A	7.455	548	28198	202	N/A	3.803	63	0	0	6
13910	ESA	N/A	6.617	334	36966	180	N/A	10.154	809	0	0	8
13911	ESA	N/A	9.050	814	51009	637	N/A	7.111	915	1244	4	1
13916	WHA	N/A	2.298	129	4480	71	N/A	12.988	1639	6453	50	0
13917	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13918	WHA	N/A	1.897	91	809	18	N/A	10.646	742	133383	708	0
13919	WHA	N/A	0.015	0	0	0	N/A	1.079	31	0	0	0
13920	WHA	N/A	1.860	67	52851	1013	N/A	11.419	1513	167168	2118	0
13921	WHA	N/A	2.432	173	2949	43	N/A	6.055	601	34160	174	0
13922	WHA	N/A	0.310	10	482	2	N/A	32.804	2326	80	1	0
13923	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13924	WHA	N/A	47.610	430	37956	324	N/A	4.153	70	156	1	1
13927	WHA	N/A	25.272	762	64487	698	N/A	11.766	1091	197245	905	0
13928	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13929	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13930	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13932	CSA	N/A	0.821	145	592	11	N/A	3.614	257	32399	214	0
13934	CSA	N/A	1.308	13	872	2	N/A	8.983	1164	3922	52	0
13935	CSA	N/A	1.852	100	1255	7	N/A	4.393	398	7648	30	0
13939	CSA	N/A	2.305	78	24976	600	N/A	11.213	1052	26572	920	5
13940	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13942	CSA	N/A	0.107	32	0	0	N/A	1.661	1196	0	0	0
13943	CSA	N/A	0.832	45	18099	338	N/A	1.478	768	864	4	0
13944	CSA	N/A	0.241	9	0	0	N/A	0.752	457	0	0	0
13945	CSA	N/A	0.000	0	0	0	N/A	0.476	244	0	0	0
13946	CSA	N/A	8.043	1285	56807	393	N/A	0.139	34	234	28	0
13947	CSA	N/A	6.485	1109	56448	953	N/A	0.051	1	0	0	0
13948	CSA	N/A	5.270	683	10842	128	N/A	2.844	463	0	0	0
13951	ESA	N/A	0.997	66	8353	107	N/A	1.788	101	441	1	0
13952	ESA	N/A	0.385	8	0	0	N/A	2.491	51	163	1	0
13953	ESA	N/A	4.108	165	54337	522	N/A	6.158	217	1103	19	0
13954	ESA	N/A	0.407	4	0	0	N/A	2.730	85	7926	112	0
13955	ESA	N/A	0.694	34	0	0	N/A	0.429	18	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	4.038	0.112	0	0	0	3.926	67	0	0	13%	8.50
1	Yes	3.074	0.592	0	0	0	2.482	120	0	0	-3%	5.50
2	Yes	3.804	0.083	0	0	0	3.721	159	0	0	13%	6.08
0	Yes	3.731	0.170	0	0	0	3.561	104	111417	1786	1%	6.64
0	Yes	1.441	0.067	0	0	0	1.374	16	0	0	0%	5.95
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	2.511	0.182	0	0	0	2.329	17	44788	1277	-3%	3.65
1	Yes	0.789	0.216	0	0	0	0.574	13	0	0	-39%	1.13
1	Yes	2.105	0.364	0	0	0	1.741	11	0	0	4%	6.07
0	Yes	1.729	0.154	0	0	0	1.575	44	24596	793	8%	2.95
0	Yes	5.730	2.091	0	0	0	3.640	4	0	0	7%	8.18
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
6	Yes	30.154	0.435	0	0	0	29.719	146	0	0	-6%	5.04
1	Yes	6.059	0.322	0	0	0	5.738	78	0	0	4%	7.91
0	Yes	0.005	0.005	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	1.627	0.052	0	0	0	1.575	25	0	0	245%	7.53
0	Yes	2.348	0.123	0	0	0	2.225	30	0	0	-5%	6.16
0	Yes	2.471	0.288	0	0	0	2.182	82	6388	579	11%	3.52
5	Yes	2.891	0.078	0	0	0	2.813	80	37116	2415	-13%	5.25
0	Yes	0.017	0.017	0	0	0	0.000	0	0	0	NEW	16.72
0	Yes	1.385	1.307	389	140198	3097	0.079	5	0	0	-3%	4.02
0	Yes	3.480	2.593	165	0	0	0.887	87	55572	1287	15%	6.65
0	Yes	1.525	1.293	0	0	0	0.232	10	0	0	49%	1.54
0	Yes	1.141	1.141	0	0	0	0.000	0	0	0	19436584%	2.75
0	Yes	2.787	0.061	0	0	0	2.726	213	0	0	-9%	4.27
0	Yes	1.180	0.119	0	0	0	1.062	133	0	0	-3%	3.34
0	Yes	3.086	0.070	0	0	0	3.016	152	127790	1300	5%	6.36
0	Yes	2.278	0.623	0	0	0	1.654	29	8642	184	6%	4.02
0	Yes	1.114	0.209	0	0	0	0.905	8	10964	119	5%	3.13
0	Yes	2.588	0.220	3	28520	1173	2.367	28	3685	760	6%	8.00
0	Yes	2.351	0.455	0	0	0	1.896	17	0	0	-13%	3.58
0	Yes	1.386	0.222	10	0	0	1.163	10	1242	61	-5%	0.49

2021 Annual Reliability Performance Report

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13956	ESA	N/A	0.000	0	43	1	N/A	2.731	758	19053	199	0
13957	ESA	N/A	0.162	1	123	3	N/A	3.349	401	133	1	0
13959	PCA	N/A	13.407	431	68744	142	N/A	3.097	215	0	0	0
13960	PCA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13961	PCA	N/A	19.428	503	36742	517	N/A	20.291	1552	42468	284	0
13962	PCA	N/A	18.600	734	42436	289	N/A	6.609	440	333	2	0
13963	ESA	N/A	3.371	222	4347	21	N/A	1.768	91	0	0	0
13964	ESA	N/A	7.055	470	16174	581	N/A	0.543	3	0	0	13
13965	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13967	WHA	N/A	3.594	258	1723	14	N/A	14.110	1379	101	1	0
13968	WHA	N/A	5.278	568	2298	25	N/A	1.501	361	8607	58	0
13971	WHA	N/A	0.181	0	0	0	N/A	1.183	6	0	0	0
13972	WHA	N/A	3.864	55	35813	577	N/A	26.284	2181	1646	180	0
13973	WHA	N/A	1.563	6	10390	108	N/A	22.368	2308	19607	225	0
13974	WHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
13980	PCA	N/A	0.977	4	0	0	N/A	0.000	0	0	0	0
13982	PCA	N/A	1.267	15	3659	33	N/A	0.000	0	0	0	0
13983	PCA	N/A	4.527	181	8819	147	N/A	2.669	147	9428	56	0
13984	PCA	N/A	9.929	302	3348	30	N/A	9.657	511	15248	137	0
13985	CSA	N/A	0.015	0	0	0	N/A	8.085	1446	7133	61	0
13986	CSA	N/A	1.129	6	169	1	N/A	14.905	1100	0	0	0
13987	CSA	N/A	0.029	0	9252	57	N/A	10.779	1094	10486	77	0
13988	CSA	N/A	0.000	0	4473	14	N/A	14.458	1464	543	2	0
13989	CSA	N/A	0.003	0	2530	20	N/A	19.542	1576	18976	151	0
13990	CSA	N/A	0.247	0	0	0	N/A	16.129	1157	8334	65	0
13991	CSA	N/A	0.366	6	397	7	N/A	26.996	2048	6963	27	0
13992	CSA	N/A	0.000	0	0	0	N/A	14.415	1048	0	0	0
13993	CSA	N/A	4.983	152	203481	2559	N/A	14.940	945	644	2	0
13994	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14000	PCA	N/A	16.539	574	24235	186	N/A	1.948	59	0	0	0
14001	PCA	N/A	3.008	66	8862	51	N/A	1.182	43	0	0	0
14002	PCA	N/A	0.472	0	117381	419	N/A	14.006	815	13273	156	0
14004	PCA	N/A	0.052	1	1094	2	N/A	0.220	2	0	0	0
14010	CSA	N/A	0.000	0	0	0	N/A	2.392	58	0	0	0
14011	CSA	N/A	0.738	8	3251	90	N/A	6.401	1067	268	1	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Through December 31, 2021
0	Yes	2.086	0.726	0	0	0	1.360	8	79382	765	-2%	3.00
0	Yes	2.147	1.663	0	0	0	0.484	5	0	0	10%	4.09
0	Yes	6.060	0.023	0	0	0	6.037	110	0	0	-2%	3.11
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
4	Yes	7.841	1.272	0	0	0	6.569	62	123003	6242	-9%	7.65
1	Yes	5.035	0.462	0	0	0	4.574	145	185434	3514	-5%	9.15
0	Yes	2.712	1.013	0	0	0	1.699	52	0	0	-4%	3.34
2	Yes	1.979	0.221	0	0	0	1.759	34	0	0	-6%	3.89
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	3.618	0.060	0	0	0	3.557	108	94006	1727	5%	7.57
0	Yes	2.972	0.056	0	0	0	2.915	179	84114	3497	5%	3.64
0	Yes	0.326	0.104	0	0	0	0.222	1	0	0	-9%	1.56
0	Yes	3.345	0.265	0	0	0	3.080	12	102820	2197	6%	9.22
0	Yes	3.880	1.466	0	0	0	2.414	66	0	0	6%	8.16
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	2.688	0.078	0	0	0	2.610	2	0	0	-33%	0.08
0	Yes	1.556	0.247	0	0	0	1.309	8	0	0	-100%	0.00
0	Yes	2.243	0.189	0	0	0	2.054	68	0	0	2%	1.86
1	Yes	6.288	1.058	0	0	0	5.230	113	8208	897	0%	8.66
3	Yes	2.810	0.272	10	0	0	2.538	14	0	0	90%	8.78
0	Yes	3.081	2.003	0	0	0	1.078	4	0	0	-5%	5.97
0	Yes	6.097	2.843	0	0	0	3.253	7	0	0	-2%	5.05
0	Yes	3.354	3.354	0	102026	1859	0.000	0	230706	1463	1%	6.89
0	Yes	4.043	2.012	0	0	0	2.032	5	129967	1576	-5%	6.56
0	Yes	3.460	2.468	0	0	0	0.993	0	55479	1155	-5%	6.06
0	Yes	6.534	4.320	0	0	0	2.213	10	124978	2055	-34%	7.03
0	Yes	7.128	5.552	0	0	0	1.577	1	92668	1047	2%	6.79
1	Yes	4.965	0.177	0	0	0	4.789	94	0	0	4%	6.09
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	-100%	0.00
0	Yes	4.064	0.328	0	0	0	3.736	74	44800	1430	-19%	6.49
0	Yes	1.355	0.129	0	0	0	1.225	7	0	0	10%	0.64
0	Yes	3.596	2.948	0	113610	2827	0.648	4	44652	816	-42%	4.08
0	Yes	0.431	0.038	0	0	0	0.392	1	0	0	-36%	0.80
0	Yes	1.847	1.847	0	0	0	0.000	0	0	0	-2%	6.64
0	Yes	2.803	2.295	0	0	0	0.508	2	0	0	6%	9.52

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14012	CSA	N/A	11.005	730	128406	2268	N/A	6,492	930	56704	521	0
14013	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14014	CSA	N/A	0.735	18	0	0	N/A	1.454	340	0	0	0
14015	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14016	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14020	SHA	N/A	3.510	153	94602	1239	N/A	19,715	2010	3526	18	0
14021	SHA	N/A	7.852	296	19641	331	N/A	11,846	823	17792	181	0
14022	SHA	N/A	1.048	4	6577	71	N/A	13,333	870	112	1	0
14023	SHA	N/A	13.366	409	15437	114	N/A	7,510	554	8025	60	1
14024	SHA	N/A	7.809	550	79202	1175	N/A	14,144	1365	12726	65	0
14025	SHA	N/A	9.471	266	150000	1846	N/A	33,778	2872	105454	943	4
14026	SHA	N/A	3.322	66	25984	226	N/A	6,211	316	23104	93	0
14030	WSA	N/A	5.913	246	55748	1897	N/A	27,463	2148	19353	163	12
14031	WSA	N/A	7.449	388	110895	845	N/A	14,278	1741	25827	177	0
14032	WSA	N/A	2.193	53	70432	991	N/A	10,332	1304	1096	26	0
14035	WSA	N/A	0.935	75	3982	58	N/A	2,213	303	0	0	0
14036	WSA	N/A	0.000	0	0	0	N/A	0.828	18	58	1	0
14037	WSA	N/A	0.702	3	0	0	N/A	18,940	2024	1020	3	0
14038	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14040	CSA	N/A	5.044	253	82290	928	N/A	12,140	1493	26017	215	0
14041	CSA	N/A	12.339	538	94516	2146	N/A	13,801	748	2854	13	1
14042	CSA	N/A	2.385	110	50395	1441	N/A	11,611	1194	5894	15	4
14043	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14045	CSA	N/A	0.285	3	0	0	N/A	1,062	7	0	0	0
14046	CSA	N/A	6.659	262	2940	10	N/A	3,882	152	0	0	1
14050	PCA	N/A	33.428	485	51016	870	N/A	2,814	6	802	3	2
14051	PCA	N/A	1.763	0	0	0	N/A	0.067	0	0	0	0
14059	CSA	N/A	0.067	2	0	0	N/A	2,245	1300	2450	13	0
14060	CSA	N/A	0.000	0	0	0	N/A	0.539	7	0	0	0
14064	CSA	N/A	0.000	0	0	0	N/A	0.943	444	0	0	0
14065	CSA	N/A	0.000	0	0	0	N/A	7,023	1465	0	0	0
14066	CSA	N/A	0.000	0	0	0	N/A	0.158	10	0	0	0
14067	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14068	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14069	WSA	N/A	4.059	208	10952	237	N/A	21,111	1159	7799	87	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
4	Yes	7.565	0.770	0	0	0	6.796	68	5989	1687	3%	8.13
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.343	0.065	0	0	0	0.278	1	0	0	20%	2.74
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	5.117	0.568	0	0	0	4.548	58	94802	4324	-3%	10.99
0	Yes	2.770	0.059	0	0	0	2.710	73	0	0	4%	6.51
0	Yes	2.766	0.476	0	0	0	2.290	13	0	0	6%	5.48
0	Yes	6.413	0.221	0	0	0	6.191	93	169050	2103	4%	5.73
1	Yes	4.873	0.144	0	0	0	4.729	126	0	0	-3%	8.84
0	Yes	8.092	3.413	12	0	0	4.679	46	8508	2868	10%	13.28
0	Yes	2.684	1.044	0	0	0	1.640	9	0	0	137%	5.80
3	Yes	2.480	0.398	0	0	0	2.082	40	0	0	4%	11.12
0	Yes	2.607	0.417	0	0	0	2.190	30	102543	2101	2%	8.12
0	Yes	2.802	1.211	0	0	0	1.591	41	171058	2810	-3%	6.18
1	Yes	1.662	0.950	0	0	0	0.712	4	0	0	2%	3.92
0	Yes	1.308	1.254	0	0	0	0.054	0	0	0	-7%	2.03
0	Yes	3.740	2.267	0	89476	2014	1.473	1	0	0	-5%	8.21
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	4.312	0.126	0	0	0	4.186	116	54367	1823	6%	6.90
1	Yes	5.233	0.512	2	0	0	4.721	68	0	0	-28%	6.17
1	Yes	3.231	0.102	0	0	0	3.129	49	0	0	-49%	5.30
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	1.509	1.509	0	0	0	0.000	0	0	0	NEW	4.02
0	0	4.375	1.046	0	0	0	3.329	69	0	0	NEW	8.26
3	Yes	10.940	0.774	0	0	0	10.166	11	35214	2014	-51%	1.66
0	Yes	0.034	0.000	0	0	0	0.034	0	0	0	-100%	0.00
0	Yes	2.002	2.002	1	0	0	0.000	0	0	0	-20%	4.74
0	Yes	0.836	0.836	0	0	0	0.000	0	0	0	-26%	2.36
0	Yes	2.317	2.317	208	0	0	0.000	0	0	0	12%	7.34
0	Yes	1.523	1.523	143	0	0	0.000	0	90944	1597	-9%	4.72
0	Yes	0.892	0.892	0	0	0	0.000	0	0	0	-75%	0.83
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
2	Yes	6.612	4.990	0	0	0	1.621	15	16939	1379	0%	7.76

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14070	WSA	N/A	0.078	4	1570	123	N/A	18,733	1,177	43494	397	0
14071	WSA	N/A	8.259	345	71665	697	N/A	23,280	1327	9543	42	0
14079	WSA	N/A	0.406	0	2048	7	N/A	14,641	1233	18356	106	0
14080	WSA	N/A	0.028	0	6022	51	N/A	15,954	1396	13937	84	0
14081	WSA	N/A	1.041	81	130630	1246	N/A	11,955	1569	32781	326	0
14082	WSA	N/A	0.000	0	26279	146	N/A	13,321	1057	28229	213	0
14083	WSA	N/A	0.000	0	0	0	N/A	16,117	1729	18053	111	0
14084	WSA	N/A	0.114	5	31734	492	N/A	15,763	1157	12551	99	0
14089	CSA	N/A	0.080	3	0	0	N/A	9,926	724	64	1	0
14090	CSA	N/A	0.123	0	0	0	N/A	9,007	675	0	0	0
14091	CSA	N/A	0.217	0	0	0	N/A	11,255	1034	15181	185	0
14092	CSA	N/A	0.001	0	235	10	N/A	18,050	1570	5715	38	0
14094	CSA	N/A	0.029	1	133	1	N/A	10,250	1476	0	0	0
14095	CSA	N/A	0.000	0	0	0	N/A	15,850	1175	1381	4	0
14096	CSA	N/A	0.000	0	0	0	N/A	14,024	1328	672	314	0
14099	CSA	N/A	2.609	41	4452	45	N/A	10,475	680	3700	24	0
14100	CSA	N/A	0.000	0	0	0	N/A	20,035	1990	0	0	0
14101	CSA	N/A	0.000	0	2603	51	N/A	20,707	1532	0	0	0
14102	CSA	N/A	2.116	47	70193	614	N/A	18,537	1920	0	0	0
14103	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14104	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14109	ESA	N/A	0.446	4	9365	107	N/A	5,309	654	39685	691	0
14110	ESA	N/A	3.676	153	5238	205	N/A	15,262	659	0	0	0
14111	ESA	N/A	7.178	485	34842	184	N/A	7,933	684	9956	96	0
14112	ESA	N/A	2.899	104	4139	37	N/A	13,127	891	7847	44	0
14114	ESA	N/A	6.031	303	92269	887	N/A	14,259	1314	37432	271	0
14115	ESA	N/A	0.842	9	4706	171	N/A	3,341	121	0	0	0
14116	ESA	N/A	1.237	64	2677	22	N/A	1,968	375	3076	8	0
14117	ESA	N/A	1.130	82	0	0	N/A	1,983	85	22769	102	0
14119	PCA	N/A	0.168	3	0	0	N/A	29,634	2245	3807	12	0
14120	PCA	N/A	0.531	5	3982	47	N/A	14,246	956	7449	49	0
14121	PCA	N/A	1.002	7	3277	31	N/A	11,589	742	30323	86	1
14122	PCA	N/A	0.000	0	0	0	N/A	22,938	1350	45119	364	0
14123	PCA	N/A	5.824	167	5953	27	N/A	14,597	891	3995	16	0
14124	PCA	N/A	4.732	96	13307	23	N/A	13,760	887	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
1	Yes	3.831	1.447	0	0	0	2.384	19	68234	1202	-3%	7.16
2	Yes	8.177	4.673	0	0	0	3.504	31	263510	6253	-1%	9.35
0	Yes	6.761	4.617	1	0	0	2.144	2	375623	3700	-8%	6.39
0	Yes	2.730	2.155	0	0	0	0.575	0	259863	4239	0%	6.67
0	Yes	3.651	3.004	0	0	0	0.647	21	171669	3332	-3%	7.56
0	Yes	2.922	2.922	0	0	0	0.000	0	0	0	-9%	5.47
0	Yes	4.597	4.334	0	0	0	0.263	1	284037	3439	-1%	7.57
0	Yes	3.272	1.353	0	0	0	1.920	3	0	0	-7%	7.13
0	Yes	4.205	2.629	0	0	0	1.576	5	42340	734	-66%	3.76
0	Yes	4.866	3.572	0	0	39673	1.294	13	0	0	6%	5.87
0	Yes	4.311	2.558	0	0	0	1.754	1	0	0	-7%	5.84
0	Yes	3.472	2.516	0	0	0	0.956	5	0	0	NEW	7.14
0	Yes	5.498	3.914	0	0	0	1.584	11	0	0	2%	7.13
0	Yes	3.191	3.191	0	0	0	0.000	0	0	0	-3%	5.56
0	Yes	4.992	4.151	0	0	0	0.841	0	0	0	1%	6.45
0	Yes	6.793	2.446	0	0	0	4.348	13	12234	1826	-3%	4.48
0	Yes	3.790	3.790	0	0	0	0.000	0	0	0	-7%	7.40
0	Yes	5.654	5.654	0	0	123740	0.000	0	0	0	-6%	7.16
0	Yes	6.973	5.072	1	0	23055	1.902	25	0	0	-6%	8.95
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	1.882	0.355	0	0	0	1.527	20	0	0	1%	2.96
0	Yes	2.532	0.140	0	0	0	2.392	14	0	0	0%	5.32
0	Yes	2.917	0.036	0	0	0	2.881	64	0	0	8%	6.56
0	Yes	3.046	0.213	0	0	0	2.833	33	0	0	0%	7.59
1	Yes	2.987	0.148	0	0	0	2.839	21	0	0	-6%	6.79
0	Yes	3.009	1.707	1	0	0	1.302	15	9081	330	6%	5.57
0	Yes	1.936	0.154	0	0	0	1.783	54	60938	1475	-10%	3.42
0	Yes	1.820	0.195	0	0	0	1.625	37	19284	418	-1%	6.23
0	Yes	5.284	3.595	1	0	0	1.690	2	0	0	-2%	11.84
0	Yes	4.763	2.950	0	0	0	1.813	13	50587	497	12%	9.97
2	Yes	1.813	0.388	0	0	0	1.425	4	0	0	-10%	4.68
0	Yes	3.235	3.047	0	0	0	0.188	0	0	0	-20%	8.71
0	Yes	6.611	2.982	0	0	0	3.629	48	0	0	-1%	6.65
1	Yes	6.415	2.954	0	0	0	3.461	84	43271	1064	-20%	5.35

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14143	SHA	N/A	0.000	0	0	0	0	0.000	0	0	0	0
14144	SHA	N/A	7.129	576	20471	104	N/A	15.133	1259	27122	179	0
14145	SHA	N/A	0.139	1	182	1	N/A	21.309	1690	28354	341	0
14146	SHA	N/A	23.657	647	105813	381	N/A	7.805	174	676	3	0
14147	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14196	ESA	N/A	0.000	0	0	0	N/A	0.071	0	0	0	0
14197	ESA	N/A	1.900	29	51	1	N/A	0.715	33	56	1	0
14198	ESA	N/A	1.962	55	2473	10	N/A	3.320	218	0	0	0
14199	ESA	N/A	0.916	33	0	0	N/A	0.550	14	0	0	0
14200	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14201	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14202	SHA	N/A	2.951	28	1239	8	N/A	12.459	1020	23770	38	0
14203	SHA	N/A	1.405	7	224	3	N/A	1.102	7	0	0	0
14207	ESA	N/A	0.151	2	0	0	N/A	0.000	0	0	0	0
14208	ESA	N/A	0.000	0	0	0	N/A	0.047	2	0	0	0
14209	ESA	N/A	0.000	0	515	1	N/A	0.000	0	0	0	0
14210	ESA	N/A	0.000	0	0	0	N/A	0.006	0	0	0	0
14216	CSA	N/A	6.663	138	1849	21	N/A	20.289	1662	51050	129	0
14217	CSA	N/A	5.215	28	601	2	N/A	7.979	686	0	0	0
14218	CSA	N/A	0.061	2	0	0	N/A	41.138	2700	922	5	0
14219	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14220	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14221	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14226	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14227	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14228	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14229	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14230	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14231	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14232	CSA	N/A	0.000	0	0	0	N/A	0.000	5	0	0	0
14233	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14266	CSA	N/A	2.183	137	7644	81	N/A	9.908	2406	20000	43	0
14267	CSA	N/A	0.000	0	0	0	N/A	18.943	1585	0	0	0
14268	CSA	N/A	0.000	0	0	0	N/A	11.660	869	0	0	0
14269	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	3.005	0.246	0	0	0	2.759	31	0	0	-7%	6.17
0	Yes	5.522	3.608	15	0	0	1.914	4	0	0	0%	6.88
2	0	6.459	1.432	0	0	0	5.027	47	236713	4013	NEW	4.84
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.013	0.013	0	0	0	0.000	0	0	0	-8%	6.15
0	Yes	2.226	0.137	1	0	0	2.089	18	1911	210	-3%	2.30
0	Yes	3.509	1.112	0	0	0	2.397	51	37438	343	-3%	5.34
1	Yes	2.733	0.615	0	0	0	2.119	20	9235	312	4%	6.37
0	Yes	0.068	0.068	0	0	0	0.000	0	0	0	10%	7.16
0	Yes	0.098	0.098	0	0	0	0.000	0	0	0	3%	8.96
1	Yes	5.881	1.289	0	0	0	4.592	4	0	0	664%	6.01
0	Yes	2.417	1.383	0	0	0	1.034	6	0	0	NEW	0.80
0	Yes	0.231	0.046	0	0	0	0.185	0	0	0	60%	2.07
0	Yes	0.326	0.146	0	0	0	0.180	0	0	0	-1%	2.43
0	Yes	0.503	0.082	0	0	0	0.421	0	0	0	-19%	5.69
0	Yes	0.187	0.187	0	0	0	0.000	0	0	0	-13%	1.72
0	Yes	4.465	0.460	0	0	0	4.005	1	96045	1787	-2%	7.83
0	Yes	3.328	1.263	6	18709	675	2.066	3	0	0	1%	3.52
0	Yes	13.313	10.670	0	282285	2178	2.643	0	76940	2711	24%	10.77
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.020	0.000	0	0	0	0.020	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.028	0.028	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
1	Yes	4.319	0.424	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	4.149	2.396	0	0	0	3.895	66	0	0	2%	7.40
0	Yes	3.000	1.664	0	0	0	1.753	4	0	0	0%	6.52
0	0	0.000	0.000	0	0	0	1.337	0	0	0	-4%	3.71
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00

A) Circuit	B) Division	C) Number of OH Lateral Lines	D) Number of OH Lateral Miles	E) Number of Customers Served on OH Lateral Lines	F) CMI for OH Lateral Lines	G) CI for OH Lateral Lines	H) Number of URD Lateral Lines	I) Number of URD Lateral Miles	J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14274	WSA	N/A	29,298	529	97152	504	N/A	16,825	489	6272	39	0
14275	WSA	N/A	1,439	9	5878	29	N/A	23,785	1310	24905	215	0
14306	DCA	N/A	17,230	436	52838	158	N/A	1,885	21	0	0	0
14310	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14341	ESA	N/A	6,438	24	172	1	N/A	0.000	0	0	0	0
14349	WSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14350	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14355	ESA	N/A	2,183	92	183465	1239	N/A	9,437	2620	1252	4	0
14356	ESA	N/A	1,167	27	21107	195	N/A	5,944	1687	5805	90	0
14357	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14358	CSA	N/A	0.200	3	0	0	N/A	6,566	1083	2664	8	0
14529	SHA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14576	ESA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14577	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
14937	CSA	N/A	0.000	0	0	0	N/A	0.000	0	0	0	0
			0.000	0	0	0		0.000	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder of Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31, 2020	(Z) Recorded Peak Load Recorded through December 31, 2021
1	Yes	5.817	0.689	0	0	0	5.128	94	88753	2061	-7%	5.53
1	Yes	5.480	3.089	0	0	0	2.391	8	0	0	-6%	7.41
1	Yes	3.634	0.506	0	0	0	3.128	74	40084	536	9%	2.79
0	Yes	0.403	0.115	0	0	0	0.288	0	0	0	8%	13.68
0	Yes	1.041	0.087	0	0	0	0.954	0	0	0	5%	0.08
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.013	0.013	0	0	0	0.000	0	0	0	6%	4.90
0	Yes	2.217	0.539	0	0	0	1.678	26	0	0	6%	8.25
0	Yes	3.550	2.291	0	0	0	1.259	26	0	0	-1%	7.18
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	2.421	1.690	0	0	0	0.731	10	0	0	1%	5.54
0	Yes	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00
0	Yes	0.004	0.000	0	0	0	0.004	0	0	0	0%	0.00
0	0	0.000	0.000	0	0	0	0.000	0	0	0	0%	0.00