



Attorneys and Counselors at Law
123 South Calhoun Street
P.O. Box 391 32302
Tallahassee, FL 32301
P: (850) 224-9115
F: (850) 222-7560
ausley.com

March 1, 2024

VIA: ELECTRONIC MAIL

Mr. Tom Ballinger, Director
Division of Engineer
Florida Public Service Commission
Room 215J – Gerald L. Gunter Building
2540 Shumard Oak Boulevard
Tallahassee, FL 32399-0850
tballing@psc.state.fl.us

Re: Wood Pole Inspection and Annual Reliability Performance Reports

Dear Mr. Ballinger:

Submitted herewith is Tampa Electric Company's 2023 Wood Pole Inspection and Annual Reliability Performance Report. In addition, similar to last year, Tampa Electric will submit the annual update of Storm Protection Plan activities, which includes the legacy Storm Hardening activities, on June 3, 2024.

Please let me know if you have any questions.

Sincerely,

A handwritten signature in blue ink that reads 'Malcolm N. Means'.

Malcolm N. Means

MNM/bml

Enclosure

cc: Ashley Sizemore, TECO
TECO Regulatory



TECO[®]
TAMPA ELECTRIC
AN EMERA COMPANY

2023
ANNUAL WOOD POLE
INSPECTION REPORT
&
ANNUAL RELIABILITY
PERFORMANCE REPORT

FILED: March 1, 2024



Table of Contents

Summary of 2023 Wood Pole Inspection and Reliability Performance Report.....	1
Tampa Electric’s Wood Pole Inspection Program.....	3
Annual Wood Pole Inspection Report.....	7
Section IV – Rule 25-6.0455 F.A.C.....	8
2023 Reliability Performance.....	8
Generation Events.....	11
Transmission Events.....	12
Extreme Weather.....	14
Other Distribution.....	14
Distribution Substation.....	14
2023 Adjusted Distribution Reliability.....	20
Three Percent Feeder.....	21
Regional Reliability Indices.....	24
Regional Reliability Trends.....	26
Overhead – Underground Reliability.....	29
Five-Year Trends – Reliability Performance.....	29
Reliability-Related Customer Complaints.....	31
Appendix-Annual Reliability Performance Report.....	35
Reliability Appendix A	36
Form PSC/ECR 102-1(a)(8/06).....	36
Form 102 – Part II – Actual.....	37
Form 102 – Part III – Actual.....	38
Form 102 – Part III continued – Actual.....	39
Reliability Appendix B.....	40
Form PSC/ECR 102-1(b)(8/06).....	40
Form 103 - PART II – Adjusted.....	41
Form 103 - PART III – Adjusted.....	42

2023 Annual Reliability Performance Report

Form 103 Part III continued Adjusted.....	43
Actual Data: CMI, CI and Documented Exclusions.....	44
2023 Adjustments: Planned Distribution Outage Events.....	45
Feeder Specific and Attached Laterals Data.....	182

SUMMARY OF 2023

WOOD POLE INSPECTION AND ANNUAL RELIABILITY PERFORMANCE REPORT

In 2023, Tampa Electric continued the performance of the company's fourth year of its Storm Protection Plan ("SPP"). The company's 2022-2031 Storm Protection Plan is Tampa Electric's second SPP and provides a comprehensive approach to protect and strengthen its electric utility infrastructure to withstand extreme weather conditions as well as to reduce restoration costs and outage times in a prudent, practical, and cost-effective manner. As part of the company's prior three-year Storm Hardening Plans and SPPs, Tampa Electric continued to perform the required system hardening activities such as equipment upgrades, system and equipment maintenance, upgrading of distribution wood structures, replacement of transmission wood structures and the company's distribution and transmission inspection processes. As agreed upon in the Commission's Staff workshop that was conducted on January 21, 2021, the company will submit the annual update of SPP activities, which includes the legacy storm hardening activities, on June first of each year.

Tampa Electric's 2023 distribution reliability "Adjusted" indices showed improvement when compared to 2022, in System Average Interruption Duration Index ("SAIDI"), System Average Interruption Frequency Index ("SAIFI"), Momentary Average Interruption Event ("MAIFle"), Average Duration of Outage Events ("L-Bar"), and Customers Experiencing More than Five Interruptions ("CEMI-5"). Customer Average Interruption Duration Index ("CAIDI") showed slightly unfavorable results in 2023 as compared to 2022. Tampa Electric's 2023 distribution reliability "Actual" indices showed significant improvement in performance in all the reliability indices when compared to 2022.

The following pages include the following reports:

2023 Annual Reliability Performance Report

1. Tampa Electric's 2023 Annual Wood Pole Inspection Report as required by Docket Nos. 20070634-EI and 20070635-TL, Order No. PSC-2007-0918-PAA-PU issued November 14, 2007.
2. Tampa Electric's 2023 Annual Distribution Service Reliability Report as required by Rule 25-6.0342 FAC.

Tampa Electric's Wood Pole Inspection Program

Tampa Electric's Wood Pole Inspection Initiative is part of a comprehensive program initiated by the FPSC for Florida investor-owned electric utilities to harden the electric system against severe weather.

This inspection program complies with Order No. PSC-2006-0144-PAA-EI, issued February 27, 2006, in Docket No. 20060078-EI which requires each investor-owned electric utility to implement an inspection program of its wooden transmission and distribution poles on an eight-year cycle based on the requirements of the National Electrical Safety Code ("NESC"). Tampa Electric has approximately 285,000 distribution and lighting wood poles and 25,000 transmission poles appropriate for inspection for a total pole inspection population of approximately 310,000. Approximately 12.5 percent of the known system will be targeted for inspections annually although the actual number of poles may vary from year to year due to recently constructed circuits, de-energized circuits, reconfigured circuits, etc. This program provides a systematic identification of poles that require repair, reinforcement, or replacement to meet strength requirements of the NESC.

The wood pole inspections will be conducted on a substation circuit basis with a goal of inspecting the entire wood pole population every eight years. An average of 35,625 wooden distribution poles will be inspected annually with each pole receiving a visual inspection, a sound and bore procedure, and a groundline/excavation inspection (except for chromated copper arsenate "CCA" poles less than 16 years of age.)

Inspection Method and Procedure: Tampa Electric utilizes three basic inspection procedures for determining the condition of wooden poles. These procedures include a visual inspection, sound and bore, and excavation when required.

Visual Inspection: An initial visual inspection shall be made on all poles from the ground line to the pole top to determine the condition of the pole before any additional inspection work is completed. The visual inspection shall include a review

2023 Annual Reliability Performance Report

of the pole condition itself and any attachments to the pole for conditions that jeopardize reliability and are in need of replacement, repair or minor follow-up. After a pole passes the initial visual inspection, the balance of the required inspection methods will be performed.

Sound and Bore: After passing the visual inspection, the pole shall be sounded to a minimum height of seven feet above the ground line to locate any rotten conditions or pockets of decay inside the pole. Borings shall be made to determine the location and extent of internal decay or voids. All borings shall be plugged with preservative treated wooden dowels. After the pole has passed the sound and bore inspection, an excavation inspection will be performed, if required.

Excavation: For poles requiring excavation, the pole shall be excavated to a minimum depth of 18 inches below the ground line. Any external decay shall be removed to expose the remaining sound wood. The remaining pole strength shall be calculated.

For a pole in concrete or pavement where excavation is not possible, Tampa Electric will utilize a shell boring technique. This will consist of boring two 3/8-inch holes at a 60-degree angle to a depth of 16 to 18 inches below ground level. Upon withdrawing the drill bit, the technician will examine the condition of the wood shavings to determine whether decay is present. A "Shell Gauge" is used to determine the thickness of the shell, which is then used to calculate the pole strength. All borings shall be plugged as previously described.

Hardware Inspection: The inspector shall inspect all of Tampa Electric's guying, grounding provisions and hardware that is visible from the ground. Any deficiencies or problems will be corrected as directed or reported to Tampa Electric to correct.

Inspection and Treatment Labeling: After completion of the ground line inspection, an aluminum tag identifying the contractor and date of inspection shall be attached

2023 Annual Reliability Performance Report

to the pole above the birthmark. Additionally, a tag shall be attached identifying any preservative treatments applied and the date of application.

Data Collection: The collected data shall be managed in a database and include information related to pole class, material, vintage, location, pole strength and any pole deficiencies that required follow-up actions, if any.

Inspection in Conjunction with Other Field Work: As part of day-to-day operations, operation personnel are at times required to climb poles to perform different types of field work. Prior to climbing any pole, personnel will assess the condition of the pole. This will include a visual check and may include sounding to determine pole integrity. This type of inspection will supplement the systematic inspection approach otherwise outlined in this pole inspection program.

Disposition of Poles: Poles with early-stage decay that do not require remediation to meet the NESC strength requirements shall be treated with an appropriate preservative treatment. Poles with moderate decay that have substantial sound wood shall be considered for reinforcement. Analysis shall be performed to determine if reinforcement will bring the deficient pole into compliance with the requirements of the NESC. If it is determined that the pole can be reinforced, the pole shall be treated with an appropriate preservative treatment and may be reinforced or replaced if needed. Poles with advanced decay shall fail the inspection and be replaced.

Shared Poles: Tampa Electric supports the Commission's effort to establish pole inspection requirements on the owners of all utility poles. Tampa Electric will coordinate with third-party owners of utility poles that carry the company's facilities. With regard to the third-party's inspection process, the company will rely upon the third-party's inspection requirements and share data requested by the third-party to be utilized in their inspection procedure. Tampa Electric will cooperate, as requested, in the work associated with pole replacement where joint use exists. Third-party poles

2023 Annual Reliability Performance Report

are visually inspected and sounded for internal decay. Issues found are provided to the third-party owner for resolution.

Chromated Copper Arsenate Pole Inspections: In Docket No. 20080219-EI, Order No. PSC-2008-0615-PAA-EI, issued September 23, 2008, the FPSC approved a modification to Tampa Electric's Wood Pole Inspection Program involving chromated copper arsenate ("CCA") poles. Specifically, the modification requires CCA treated poles less than 16 years of age to be sound and selectively bored. Selective boring shall be performed on poles suspected of internal decay. Additionally, one percent of the annual number of CCA treated poles inspected less than 16 years of age shall be excavated to validate this inspection method. Finally, all CCA treated poles over 16 years of age shall be excavated.

Reporting: Tampa Electric will file the Annual Wood Pole Inspection Report, as an inclusion to the company's Annual Report and Annual Reliability Performance Reports, by March 1st of each year in full accordance with the reporting requirements set forth in Docket No. 20070634-EI, Order No. PSC-2007-0918-PAA-PU, issued November 14, 2007. The report will contain the methods used to determine the strength and structural integrity of wooden poles, the selection criteria for inspected poles, a summary of the results of the inspections, the cause(s) of inspection failures, and the corrective action taken for the failures. The 2023 Annual Wood Pole Inspection Report is on the next page:

Annual Wood Pole Inspection Report:

TAMPA ELECTRIC COMPANY Annual Wood Pole Inspection Report 2023												
ORDER NO. PSC-2007-0918-PAA-FU DOCKET NOS. 20070634-EI, 20070635-TL												
a	b	c	d	e	f	g	h	i	j	k	l	m
Total # of Wooden Poles in the Company Inventory	# of Pole Inspections Planned this Annual Inspection	# of Poles Inspected this Annual Inspection	# of Poles Failing Inspection this Annual Inspection	Pole Failure Rate (%) this Annual Inspection	# of Poles Designated for Replacement this Annual Inspection	Total # of Poles Replaced this Annual Inspection	# of Poles Requiring Minor Follow-up this Annual Inspection (Anchors/Guys)	# of Poles Overloaded this Annual Inspection	Methods(s) V = Visual E = Excavation P = Prod S = Sound B = Bore R = Resistograph	# of Pole Inspections Planned for Next Annual Inspection Cycle	Total # of Poles Inspected (Cumulative) in the 8-Year Cycle to Date	% of Poles Inspected (Cumulative) in the 8-Year Cycle to Date
Distribution and Transmission				Distribution Reinforcement 0.82%	Distribution Reinforcement 299	Distribution Reinforcement 299						
CYCLE THREE WOOD POLE POPULATION				Distribution Replacement 2.91%	Distribution Replacement 1,064	Distribution Replacement 488						
Distribution 285,000	Distribution 35,625	Distribution 36,601	Distribution 1,363	Distribution 3.72%	Distribution 1,363	Distribution 787	Distribution 194	Distribution Poles Overloaded 0	VESB	** Distribution 35,625	Distribution 72,380	Distribution 25.40%
Transmission 3,077	Transmission 404	Transmission 448	Transmission 141	Transmission 31.47%	Transmission 463	Transmission 466	Transmission 0	Transmission 0	VESB	Transmission 472	Transmission 448	Transmission 14.56%
Total Poles 288,077	Total 36,029	Total 37,049	Total 1,504		Total 1,826	Total 1,253	Total 194	Total 0		Total 36,097	Total 72,828	Total 25.28%
If b - c > 0, provide explanation	Contract process and negotiations caused a gap in work execution											
If d - g > 0, provide explanation	Pole inspections changed from region based to circuit based in 2016. Circuits to be inspected are selected by a combination of poor reliability circuits and circuits due for inspection											
Description of selection criteria for inspections												

SECTION IV – Rule 25-6.0455 F.A.C.

2023 Reliability Performance

1) Overview

Tampa Electric’s 2023 distribution reliability “Actual” indices showed a significant improvement in performance in all reliability indices when compared to 2022. Tampa Electric’s distribution reliability “Adjusted” indices showed improvements in SAIDI, SAIFI, MAIFle, LBar, and CEMI5. The favorable results in these reliability indices were due to the investments the company has been making through vegetation management, the utilization of smart devices, hardening feeders, and converting overhead systems to underground. CAIDI showed a slight decline in performance for 2023 as compared to 2022. The unfavorable results in CAIDI are attributed to slightly longer response times to outages in three of the company’s seven operating centers. It is worth noting that CAIDI set an all-time record low in 2022, with 2023 being the second lowest in the history of the company and still lower than the five-year average.

2) Summary

Tampa Electric’s actual 2023 SAIDI decreased by 750.71 minutes as compared to 2022, representing a 91.03 percent decrease. The adjusted 2023 SAIDI decreased by 12.12 minutes as compared to 2022, representing a 17.47 percent decrease. The actual 2023 CAIDI decreased by 312.50 minutes as compared to 2022, representing an 83.59 percent decrease. The adjusted 2023 CAIDI increased by 2.83 minutes as compared to 2022, representing a 4.22 percent increase. The actual 2023 SAIFI decreased by 1.00 interruptions as compared to 2022, representing a 45.31 percent decrease. The adjusted 2023 SAIFI decreased by 0.22 interruptions as compared to 2022, representing a 20.81 percent decrease. The actual 2023 MAIFle decreased by 3.97 events as compared to 2022, representing a 35.27 percent decrease. The adjusted 2023 MAIFle decreased by 0.96 events as compared to 2022, representing a 13.04 percent decrease.

A summary table of Tampa Electric’s reliability performance for 2023 as compared to 2022 is below:

2023 Annual Reliability Performance Report

Tampa Electric's 2023 Reliability Performance Summary				
ACTUAL	2022	2023	Difference	Percent Change
SAIDI	824.72	74.01	-750.71	-91.03%
CAIDI	373.85	61.35	-312.50	-83.59%
SAIFI	2.21	1.21	-1.00	-45.31%
MAIFLe	11.26	7.29	-3.97	-35.27%
L-BAR	328.93	122.76	-206.17	-62.68%
CEMI-5	4.09%	1.11%	-2.98%	-72.88%
ADJUSTED	2022	2023	Difference	Percent Change
SAIDI	69.40	57.27	-12.12	-17.47%
CAIDI	67.13	69.96	2.83	4.22%
SAIFI	1.03	0.82	-0.22	-20.81%
MAIFLe	7.40	6.44	-0.96	-13.04%
L-BAR	141.78	130.33	-11.45	-8.08%
CEMI-5	0.46%	0.12%	-0.34%	-73.75%

Note: In developing the reliability indices for 2023, the company found an issue in the reporting which affected the 2022 Actual Indices due to a misrepresentation of an outage that occurred during Hurricane Ian. 2022 Adjusted Indices were unaffected by this issue. The issue was corrected, and the revised 2022 Actual Indices above reflect the correction.

Tampa Electric experienced a decrease of 967 overall outages in 2023 as compared to 2022. Six primary outage causes in 2023 had a decrease in outages and five primary outage causes had an increase in outages as compared to 2022.

The following six primary causes had a decrease of 1,494 outages as compared to 2022:

- Vegetation decreased by 190
- Unknown decreased by 136
- Lightning decreased by 775
- Other Weather decreased by 158

2023 Annual Reliability Performance Report

- Electrical decreased by 222
- Bad Connection decreased by 13

The following five primary causes had an increase of 525 outages as compared to 2022:

- Animals increased by 209
- Down Wire increased by 203
- Defective Equipment increased by 15
- Vehicle increased by 32
- All Remaining Causes increased by 66

In comparison to the last five-year average, Tampa Electric experienced less outages in 2023, as compared to 2022. For the 2023 outage causes, six of the eleven categories are lower when compared to the five-year average totals. Here is the listing of how the eleven categories changed as compared to the five-year average:

- Animals decreased by 10.46 percent
- Bad Connection decreased by 56.76 percent
- Defective Equipment increased by 54.99 percent
- Down Wire increased by 30.78 percent
- Electrical decreased by 41.03 percent
- Lighting decreased by 35.65 percent
- Other Weather decreased by 8.35 percent
- Unknown decreased by 15.45 percent
- Vegetation decreased by 23.71 percent
- Vehicle decreased by 19.08 percent
- All Remaining Causes decreased by 34.85 percent

Tampa Electric currently tracks outage records in the company's Distribution Outage Database ("DOD") according to the date, duration, customer affected, cause, equipment-type, associated field reports, breaker operations, etc., and uses this information to track

2023 Annual Reliability Performance Report

and report interdepartmental, intercompany, and external regulatory requests as required.

Tampa Electric continues reviewing system performance and related metrics on a daily basis. Primary areas of focus include incremental and year-to-date semi-weekly SAIDI, CAIDI and SAIFI performance for Transmission, Substation and Distribution, year-to-date MAIFle and associated breaker operations, customer outages by system and service area and major unplanned outages. In addition, Tampa Electric reviews the status of de-energized underground cables, reclosers, online capacitor banks and streetlights previously identified as needing maintenance.

In 2023, Tampa Electric continued the company's increased focus on the priority of feeder restoration activities. One example of this priority is the review and report of lessons learned on feeder outages where the outage duration exceeded acceptable thresholds. This review and report are done semi-weekly in pursuit of continued improvements with response time.

In addition to reviewing semi-weekly performance as noted above, the company analyzes Distribution circuit performance, including feeders represented on the three percent feeder list, through a number of different ongoing processes. These processes include tree trimming analysis and circuit analysis.

3) Conclusion

Tampa Electric's 2023 distribution "Adjusted" reliability indices showed improvement in all the reliability indices when compared to 2022, except for CAIDI.

Generation Events

Tampa Electric experienced no outages due to generation events that would have impacted Distribution Reliability. Because of this, there are no exclusions in the company's 2023 Annual Distribution Reliability Report related to generation outage events.

Transmission Events

1) Transmission Outage Summary

In 2023, there were three transmission outages that affected customers. As a result, there were 117,112 Customer Minutes of Interruption (“CMI”) and 3,009 Customer Interruptions (“CI”) excluded from the 2023 Annual Distribution Reliability Report per Rule 25-6.0455.

2) Equipment Failure Outages

There were no outages attributed to wood poles, static wires and splices, crossarm failures in 2023.

3) Vehicle Collision Outages

There was one outage due to vehicle collisions with poles and guy wire in 2023.

4) Human Error Outages

There were no outages due to human error in 2023.

5) Vegetation Related Outages

There was one outage due to vegetation in 2023.

6) Animal Related Outages

There were no outages related to animals in 2023.

7) Clearance Outages

There were no outages due to insufficient clearance in 2023.

8) Other and Weather Outages

There was one outage related to weather and other circumstances in 2023.

9) Transmission Outage Detail

69 kV Circuit

May 2023

Date: 4/24/2023

Circuit: 66829

Customers Affected: 248

SAIDI Impact: 1.62 (sec)

Discussion: Service was interrupted due to weather in the area. The weather passed, and the circuit was returned to service.

Event: Localized

May 2023

Date: 5/6/2023

Circuit: 66067

Customers Affected: 1,186

SAIDI Impact: 6.14 (sec)

Discussion: Service was interrupted when a vehicle came in contact with pole. The pole was replaced, and circuit was returned to service.

Event: Localized

June 2023

Date: 6/4/2023

Circuit: 66090

Customers Affected: 1,575

SAIDI Impact: 4.61 (sec)

Discussion: Service was interrupted when a tree brushed circuit. The tree was cleared, and circuit was returned to service.

Event: Localized

138 kV Circuit

There were no outages on the 138 kV circuits in 2023.

230 kV Circuit

There were no outages on the 230 kV circuits in 2023.

Extreme Weather

Tampa Electric experienced one extreme weather event during 2023 which affected transmission customers in the company's service territory.

Other Distribution – Adjustments

In 2023, there were 5,669 Other Distribution outages that affected customers. A total of 14,283,675 CMI and 335,056 CI were excluded from the 2023 Annual Distribution Reliability Report per Rule 25-6.0455. All outages were attributed to planned events as noted within the 2023 Adjustments: Other Distribution Outage Events in Reliability Appendix B.

Distribution Substation

1) Distribution Substation Adjustments

In 2023, there were 201 Distribution Substation outages that affected customers. A total of 5,987,501 CMI and 140,257 CI were excluded from the 2023 Annual Distribution Reliability Report per Rule 25-6.0455. All outages were attributed to substation equipment as noted within the 2023 Adjustments: Substation Outage Events in Reliability Appendix B.

2) Patterns and Trends – Distribution Substation Reliability Performance

In 2023, Substation outages due to circuit breaker mechanism mis-operation was the leading contributor to SAIDI. Tampa Electric currently has a program in place to replace aging and problematic circuit breakers. Since 2008, the total number of 13-kV circuit breakers that have been replaced through a 13-kV circuit breaker replacement program and failed circuit breakers is 395. In 2023, 41 circuit breakers and associated circuit protection relaying were replaced as part of the company's capital asset replacement program for failed circuit breakers.

The second leading substation outage contributor to SAIDI in 2023 was due to animal contact. Tampa Electric installs animal guards on all 13kV circuit breaker terminals and

bus insulators, when possible. Occasionally, animals get around the guards and make contact with the 13kV bus.

In 2023, Substation outages due to breaker failures was the third leading substation outage contributor to SAIDI. Events such as a failed interrupter, hydraulic operator or severe damage in the high voltage compartment weighs in the decision to replace a circuit breaker. In addition to the cause of the failure being a reason for replacing the breaker, the age, condition, and lack of spare parts are other factors considered when replacement is necessary.

3) Process to Promote Substation Reliability

Tampa Electric's Substation Department utilizes the following processes and activities to determine the actions to promote substation reliability:

- Routine substation inspections
- Root cause analysis of outages
- Track and review of all substation outages

Tampa Electric findings support the following ongoing activities:

- Review of all mis-operation of circuit breakers
- Installation of animal protection in substations
- Install microprocessor-based relays for reclosing in all new construction and upgrade projects
- Replace station wide static under frequency relays with feeder-based microprocessor under frequency relays in all new construction projects
- Replacing 13-kV circuit breakers that have been identified as problem breakers
- Increased lightning withstand protection on Tampa Electric Large Autotransformers
- An improved standard of all bushings on all new transformers and circuit breakers

2023 Annual Reliability Performance Report

- Implementation of automatic bus restoration schemes in stations with multiple transformers and microprocessor-based relay protection schemes.

The tables and exhibits that follow provide the number of distribution substation inspections performed by year and the SAIDI Impact in minutes for distribution substation outages by cause. This information is used to gauge and track the substation reliability.

Table 1: Substation Inspections by Year

Substation Inspections		
Year	Distribution Substations	Transmission Substations
2020	373	164
2021	460	218
2022	411	196
2023	615	318

Exhibit 1: 2023 Distribution Substation Outages

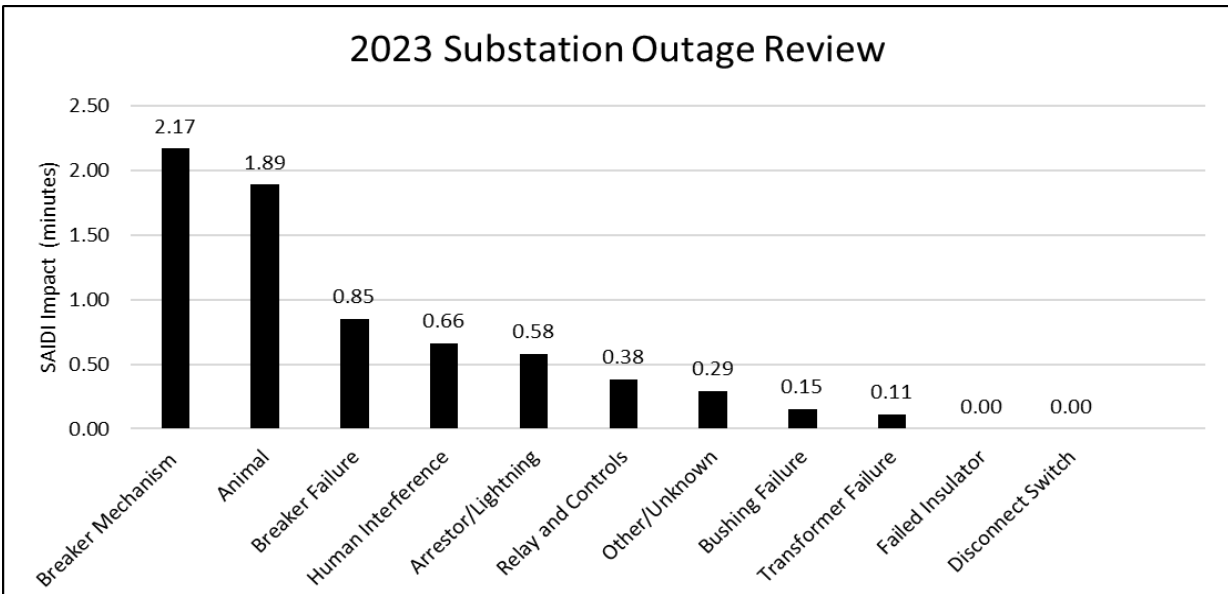


Exhibit 2: 2022 Distribution Substation Outages

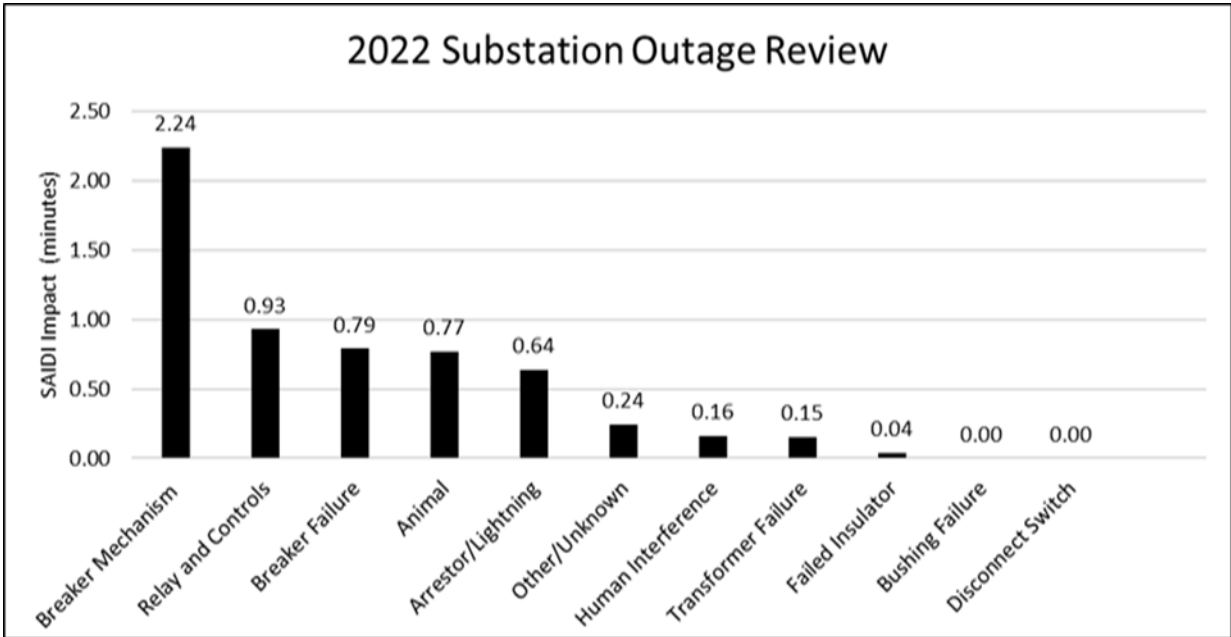


Exhibit 3: 2021 Distribution Substation Outages

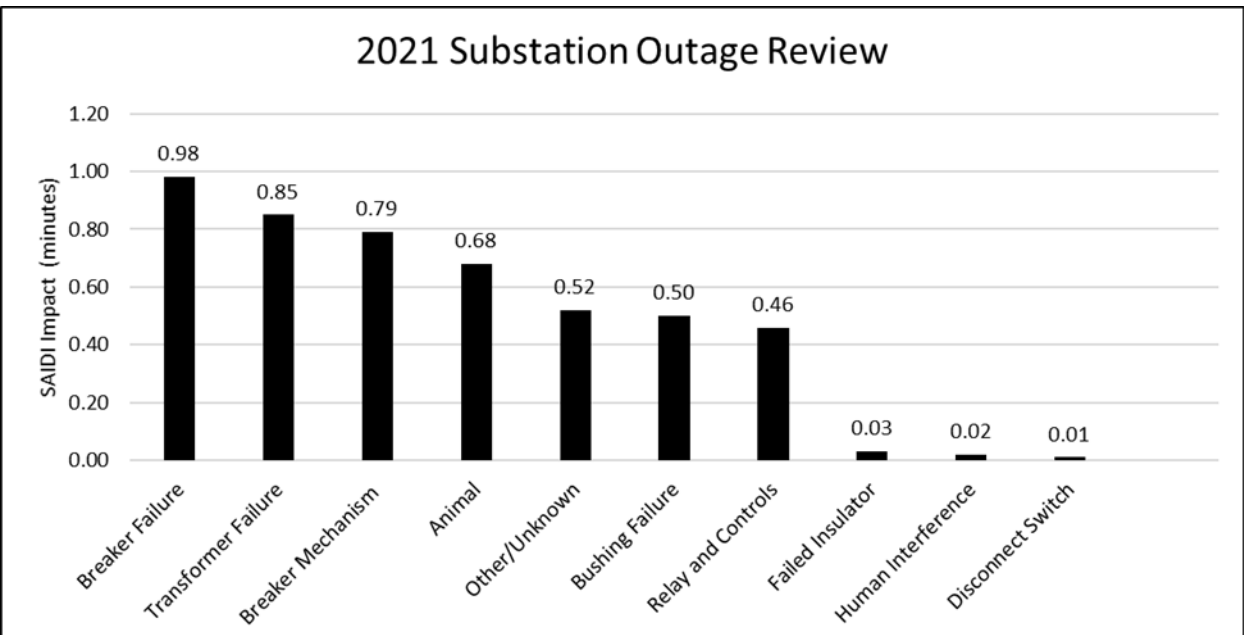


Exhibit 4: 2020 Distribution Substation Outages

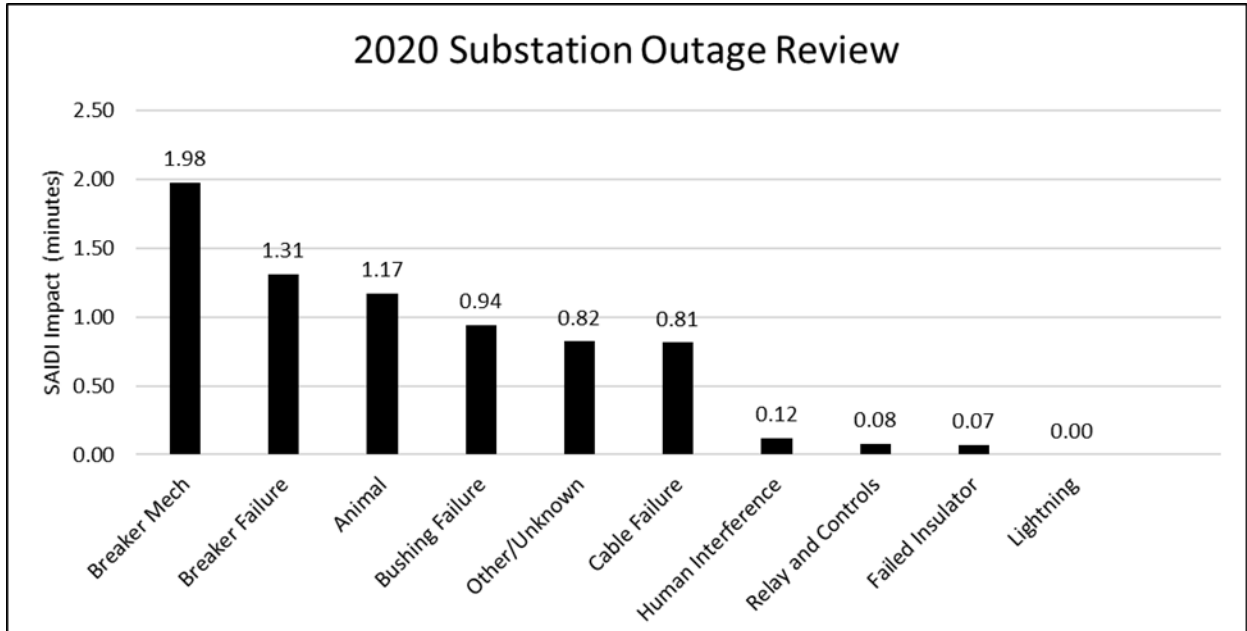


Exhibit 5: 2019 Distribution Substation Outages

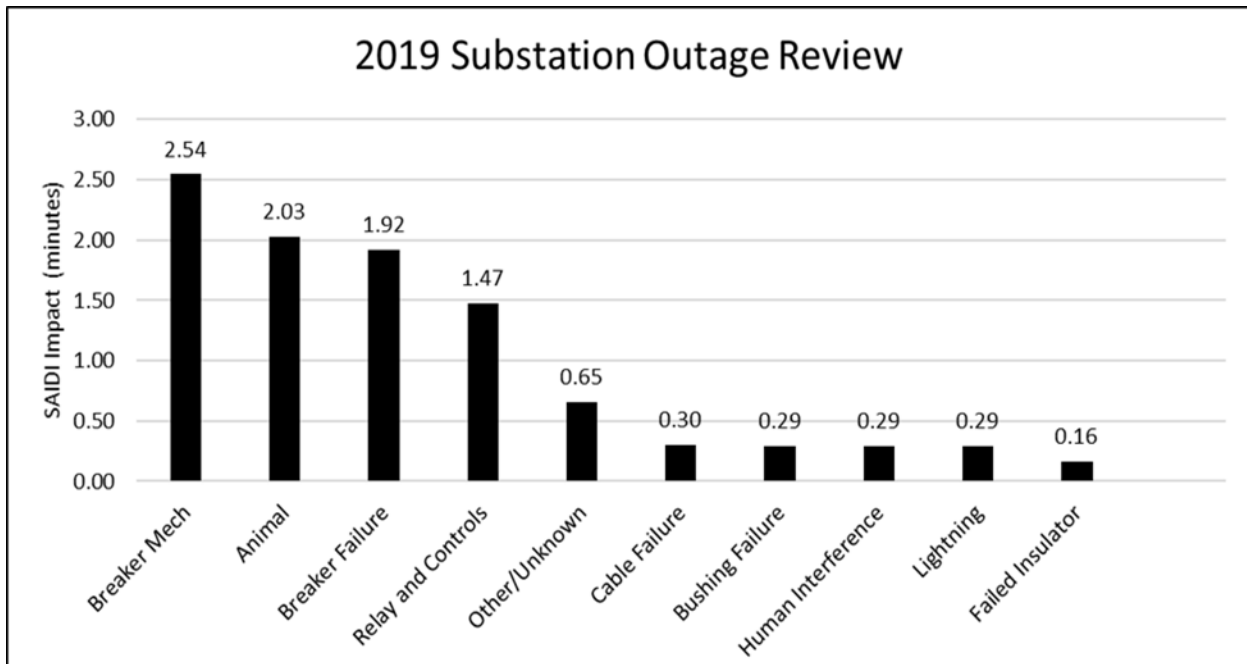


Exhibit 6: Substation Outages due to Breaker Mechanism

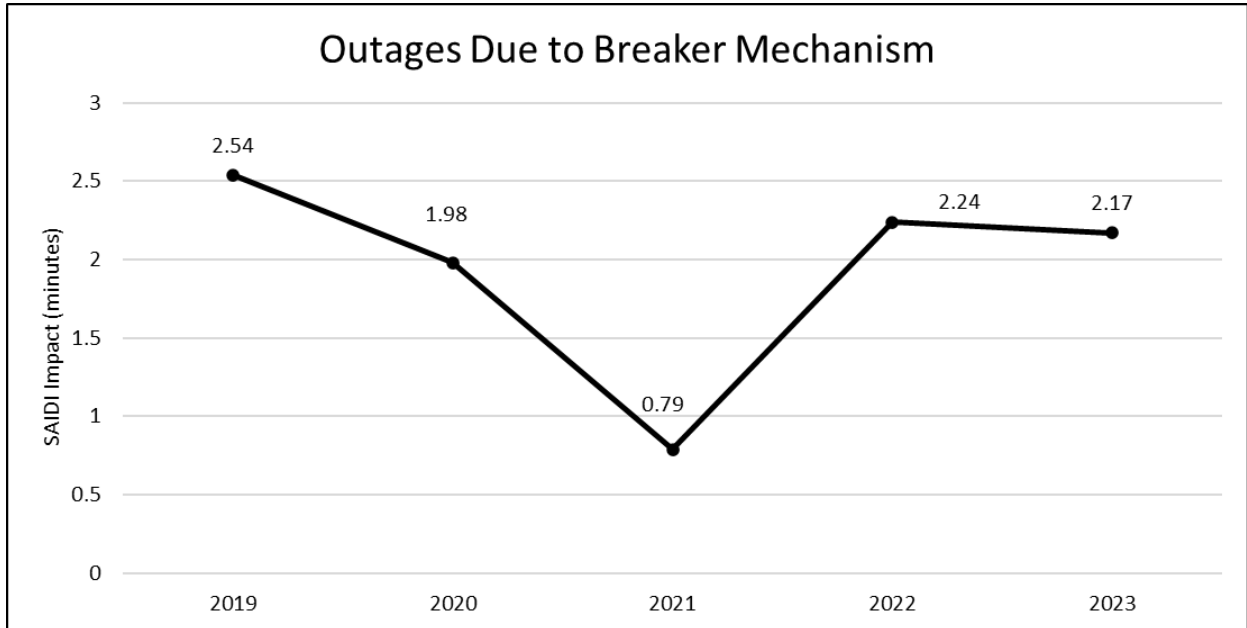


Exhibit 7: Substation Outages due to Animal Contact


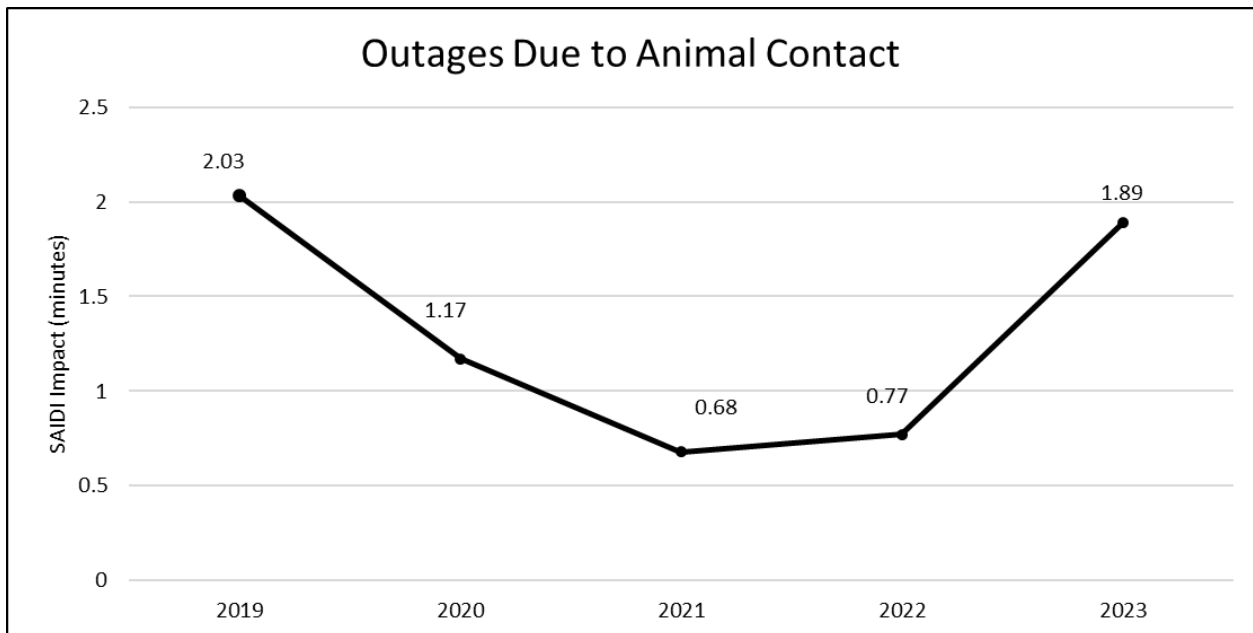


Exhibit 8: Substation Outages due to Breaker Failure

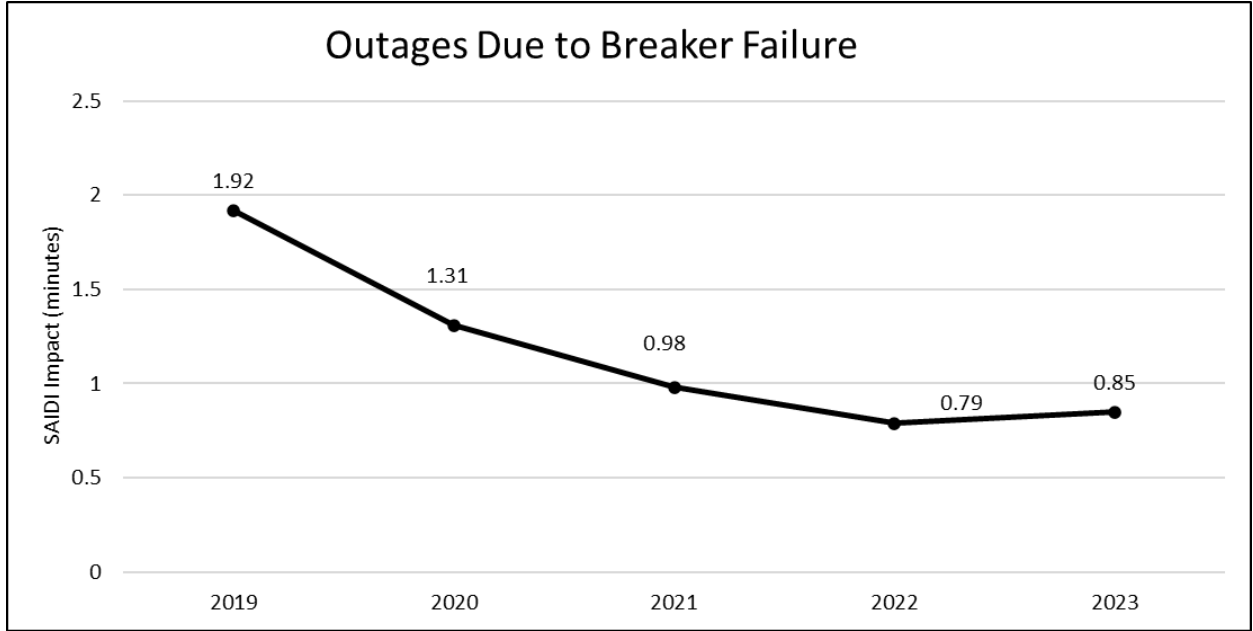

2023 Adjusted Distribution Reliability

1) Causes of Outages

	2019	2020	2021	2022	2023
Vegetation	2,357	2,434	1,409	1,593	1,403
Animals	1,788	1,162	1,729	1,038	1,247
Lightning	1,436	1,340	1,019	1,567	792
Electrical	1,034	1,052	679	683	461
Bad Connection	861	1,078	392	258	245
Unknown	1,356	1,152	1,031	1,075	939
Down Wire	564	476	1,132	877	1,080
Vehicle	387	398	300	220	252
Other Weather	214	328	1,211	711	553
Defective Equipment	141	105	626	684	699
All Remaining Causes	366	285	368	506	573
System Totals	10,504	9,810	9,896	9,212	8,244

2) Three Percent Feeder

In 2023, Tampa Electric has identified seventeen circuits that have been listed once before in the prior five years. These circuits include:

- Mulberry Circuit 13007
- Mulberry Circuit 13008
- Mulberry Circuit 13011
- Hopewell Circuit 13147
- Habana Avenue Circuit 13218
- Gulf City Circuit 13254
- Kirkland Circuit 13388
- Pearson Road Circuit 13691
- Pearson Road Circuit 13693
- Berkley Circuit 13696
- Granada Circuit 13756
- Blanton Circuit 13813
- Lake Gum Circuit 13924
- Estuary Circuit 13942
- Trout Creek Circuit 13988
- Fishhawk Circuit 14123
- Sun City Circuit 14146

Actual events for Mulberry Circuit 13007 included nine circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced wire taps, transformers, and replaced failed overhead conductor. In addition, the company conducted tree trimming on this circuit.

Actual events for Mulberry Circuit 13008 included two circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced overhead conductor, repaired capacitor bank, replaced transformer and tree trimming on the circuit.

2023 Annual Reliability Performance Report

Actual events for Mulberry Circuit 13011 included three circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced overhead conductor, replaced failed poles and transformers. In addition, the company conducted tree trimming on this circuit.

Actual events for Hopewell Circuit 13147 included four circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced poles and overhead conductor and refused line fuses. In addition, the company completed tree trimming on this circuit.

Actual events for Habana Ave Circuit 13218 included three circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced multiple transformers, de-vined poles and conducted tree trimming on the circuit.

Actual events for Gulf City Circuit 13254 included three circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: conducted tree trimming on the circuit, pole replacements and transformer replacements.

Actual events for Kirkland Road Circuit 13388 included five circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced leaking transformers, broken poles, and overhead conductor, as well as conducted tree trimming on the circuit.

Actual events for Pearson Road Circuit 13691 included two circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: repaired capacitor bank and replaced transformer.

2023 Annual Reliability Performance Report

Actual events for Pearson Road 13693 included two circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced fuse cut outs, blown lightning arrestors and an overhead conductor.

Actual events for Berkley Circuit 13696 included five circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced transformers, lightning arrestors, and primary insulators as well as repair overhead conductor. In addition, the company also conducted tree trimming on this circuit.

Actual events for Granada Circuit 13756 included three circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: conducted some tree trimming on the circuit, replaced a capacitor bank and a transformer.

Actual events for Blanton Circuit 13813 included five circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: Replaced broken cross arm, repaired overhead conductor and performed tree trimming on the circuit.

Actual events for Lake Gum 13924 included two circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: removed avian debris from switches, replaced overhead and underground conductor, replaced multiple transformers, and conducted tree trimming on the circuit.

Actual events for Estuary Circuit 13942 included two circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced lightning arrestors and replaced multiple switchgears.

2023 Annual Reliability Performance Report

Actual events for Trout Creek Circuit 13988 included three circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced underground conductor and replaced leaking transformer.

Actual events for Fishhawk Circuit 14123 included three circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced underground conductor, replaced blown lightning arrestors, replaced transformer, and replaced capacitor bank fuses. In addition, the company conducted some tree trimming on the circuit.

Actual events for Sun City Circuit 14146 included four circuit outages as reported. The company completed corrective activities on this circuit in 2023 by performing the following: replaced multiple transformers, replaced multiple poles, and conducted some tree trimming on the circuit.

Other circuits identified in both “Actual” and “Adjusted” reports have had maintenance activities performed as noted on the Three Percent Feeder Report. The company will continue to monitor circuit outage performance as part of its daily and ongoing review of system reliability and will respond accordingly.

Regional Reliability Indices

1) Summary

Table 3 below represents customers by service area for 2023. Dade City, Plant City and Winter Haven have the fewest customers and represent the most rural, lowest customer density per line mile in comparison to the other four Tampa Electric service areas. Actual reliability indices for the rural areas have varied from those of the most urban, densely populated areas for this period. This is due to the greater distance travel for service restoration in rural areas.

2023 Annual Reliability Performance Report

In 2023, SAIDI by service area decreased, as compared to 2022, in all areas except the Central service area as shown in Table 4 below. The 2023 SAIDI performance compared to the five-year average decreased for all seven service areas. Actual results by service areas and year have varied for the five-year period.

In 2023, CAIDI by service area decreased, as compared to 2022 in four service areas and increased in the Central, Dade City, and Eastern service areas as shown in Table 5 below. The 2023 CAIDI performance compared to the five-year average decreased for four of the seven service areas. Actual results by service areas and year have varied for the five-year period.

In 2023, SAIFI by service area decreased, as compared to 2022, in all areas except for the Central service areas as shown in Table 6 below. The 2023 SAIFI performance compared to the five-year average decreased for all service areas, with the exception of the Winter Haven service area. Actual results by service areas and year have varied for the five-year period.

In 2023, MAIFLe by service area decreased, as compared to 2022, in all service areas as shown in Table 7 below. The 2023 MAIFLe performance compared to the five-year average decreased in all seven service areas. Actual results by service areas and year have varied for the five-year period.

2) Regional Reliability Trends

Table 3 : Number of Customers by Service Area Per Year

	2019	2020	2021	2022	2023
Central	209,057	211,631	215,086	217,724	219,838
Dade City	15,305	15,604	15,873	16,246	16,928
Eastern	127,437	129,781	131,248	133,486	134,994
Plant City	63,502	63,954	64,369	65,198	66,261
South Hillsborough	91,219	96,568	101,875	107,101	110,875
Western	210,151	211,714	214,077	215,985	217,506
Winter Haven	78,282	80,016	81,794	84,575	86,931
System	794,953	809,268	824,322	840,315	853,333

Table 4 : SAIDI by Service Area Per Year

	2019	2020	2021	2022	2023
Central	63.23	57.67	63.81	40.66	54.72
Dade City	190.69	186.24	138.06	142.63	94.93
Eastern	83.46	55.72	64.67	57.06	50.81
Plant City	113.54	107.09	157.34	128.88	85.52
South Hillsborough	52.39	52.53	61.23	75.04	50.67
Western	77.47	71.00	76.51	70.24	46.64
Winter Haven	67.35	70.68	152.04	93.66	78.15
System	75.87	67.90	84.51	69.40	57.27

Table 5 : CAIDI by Service Area Per Year

	2019	2020	2021	2022	2023
Central	69.54	75.18	79.08	60.79	78.19
Dade City	88.56	83.38	68.43	57.15	87.99
Eastern	72.43	65.65	63.79	59.45	67.35
Plant City	71.08	71.07	83.68	70.85	67.51
South Hillsborough	51.91	54.80	56.70	69.83	62.84
Western	77.53	82.62	78.79	73.94	70.01
Winter Haven	66.63	68.48	129.33	68.49	66.08
System	70.75	72.23	79.30	67.13	69.96

Table 6 : SAIFI by Service Area Per Year

	2019	2020	2021	2022	2023
Central	0.91	0.77	0.81	0.67	0.70
Dade City	2.15	2.23	2.02	2.50	1.08
Eastern	1.15	0.85	1.01	0.96	0.75
Plant City	1.60	1.51	1.88	1.82	1.27
South Hillsborough	1.01	0.96	1.08	1.07	0.81
Western	1.00	0.86	0.97	0.95	0.67
Winter Haven	1.01	1.03	1.18	1.37	1.18
System	1.07	0.94	1.07	1.03	0.82

Table 7 : MAIFle by Service Area Per Year

	2019	2020	2021	2022	2023
Central	7.86	6.36	5.37	5.47	5.39
Dade City	12.29	10.51	6.51	8.64	6.45
Eastern	10.81	6.40	5.96	7.10	6.45
Plant City	13.74	10.81	7.49	8.27	7.85
South Hillsborough	9.37	8.26	5.95	7.90	4.71
Western	9.45	7.75	7.56	8.59	7.30
Winter Haven	10.70	10.40	7.48	8.33	8.06
System	9.76	7.79	6.50	7.40	6.44

Table 8 : CEMI% by Service Area Per Year

	2019	2020	2021	2022	2023
Central	0.81%	0.29%	0.12%	0.02%	0.06%
Dade City	11.17%	7.67%	0.09%	4.95%	0.72%
Eastern	2.10%	1.00%	1.09%	0.11%	0.05%
Plant City	4.03%	3.38%	2.32%	0.81%	0.64%
South Hillsborough	4.62%	2.92%	0.29%	0.28%	0.00%
Western	1.69%	0.33%	0.07%	0.29%	0.05%
Winter Haven	0.39%	0.47%	0.18%	1.64%	0.19%
System	2.13%	1.13%	0.46%	0.46%	0.12%

Overhead – Underground Reliability

1) Five-Year Trends – Reliability Performance


Table 9 : Outages per Year

System Totals	2019	2020	2021	2022	2023
Number of Outages Events (N)	10,504	9,810	9,896	9,212	8,244
System Average Duration (L-Bar)	173.09	166.49	174.83	141.78	130.35
Average Restoration Time (CAIDI)	70.75	72.23	79.30	67.13	69.96

Overhead	2019	2020	2021	2022	2023
Number of Outages Events (N)	8,571	8,018	7,993	7,802	6,612
System Average Duration (L-Bar)	165.79	158.36	169.78	135.66	120.27
Average Restoration Time (CAIDI)	65.24	67.75	75.46	64.21	65.86

Underground	2019	2020	2021	2022	2023
Number of Outages Events (N)	1,933	1,792	1,903	1,410	1,632
System Average Duration (L-Bar)	205.47	202.88	196.05	175.66	171.18
Average Restoration Time (CAIDI)	112.95	110.27	108.54	106.75	107.41

Exhibit 9: Overhead to Underground Outage Duration

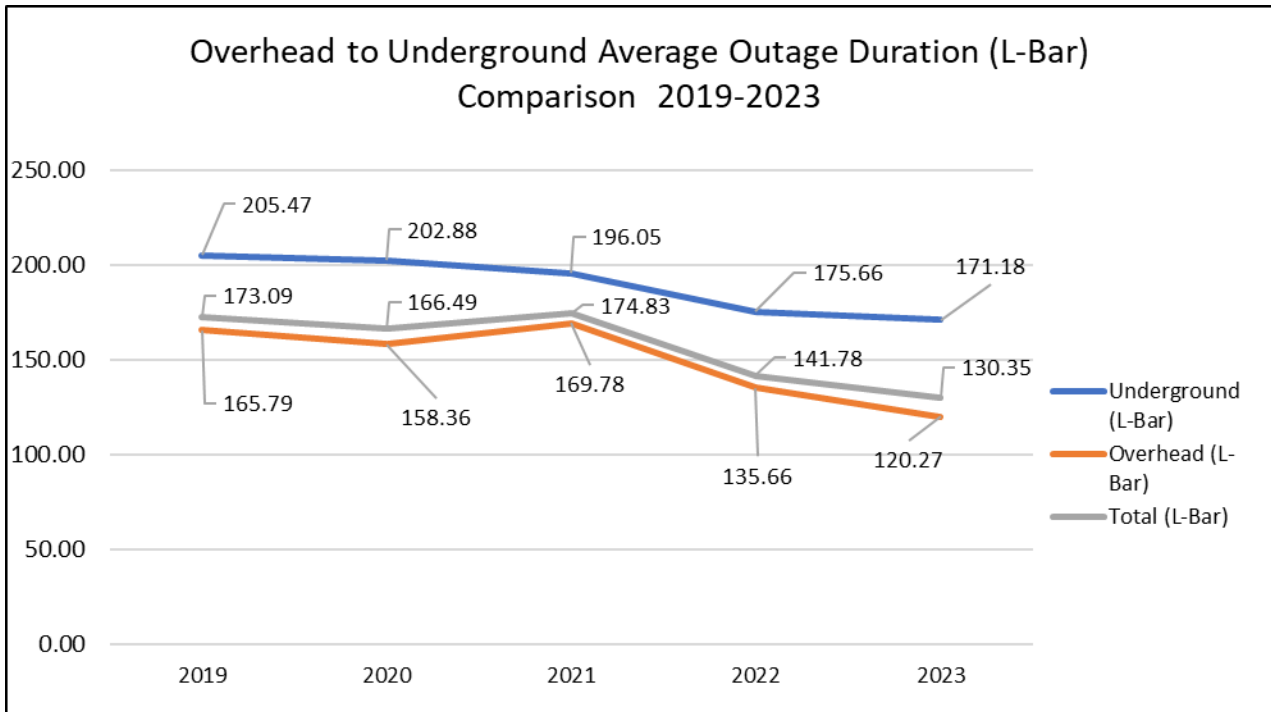

2) Tracking Overhead to Underground Reliability Performance

Tampa Electric tracks outage records in the company’s DOD according to cause and equipment type. These equipment types are designed and associated with the overhead and underground systems. Reporting capability allows the company to track CMI, CI, Number of outages, Average Duration and CAIDI as referenced in Section C – Overhead to Underground in the Appendix. In addition, separate reporting was undertaken in order to align miles and customers for overhead and underground distribution.

The company tracks and reports MAIFle by system and circuit. Interruption data is electronically captured, recorded and tracked at each individual distribution circuit breaker. As a result, a momentary interruption occurring down-line from the circuit breaker in which the circuit breaker does not operate is not currently captured and cannot be reported.

The company currently measures CEMI-5 through a query that is run through the company's DMS. There is no option to run a query for overhead or underground systems. Therefore, the company is unable to provide CEMI-5 as previously requested by Commission Staff.

3) Underground Distribution System Conversions

Tampa Electric completed the system conversion of the Dana Shores Civic Association in 2022. Tampa Electric's Storm Protection Plan is converting overhead distribution laterals for extreme weather hardening within the company's Distribution Lateral Undergrounding Program. Updates for accomplishments within this program are provided in the company's Storm Protection Plan Annual Report that is provided to the Commission on June 1 of each year.

Reliability-Related Customer Complaints

In 2023, Tampa Electric experienced an increase of ten (10) formal service-related complaints as logged by the Florida Division of Consumer Affairs and noted in Exhibit 10 below. In addition, service-related complaints as tracked by the company and including FPSC Formal, Three-Day, Transfer-Connect, Warm Transfer and Executive Level increased 13 complaints in 2023 as noted in Exhibit 11 below. In comparison to the five-year average, overall complaints decreased by 14.2 percent in 2023.

When comparing formal complaints logged against the company to reliability performance (Exhibits 12 and 13 below) over the last five years, the reliability performance has varied, and complaints have tracked accordingly. The company believes that a continued focus on activities such as vegetation management, circuit review activity and resulting line improvements and other maintenance activities will contribute toward minimizing service-related complaints in 2024 and beyond.

Tampa Electric's current process for responding to all service-related complaints includes the central intake and coordination of complaint resolution through the

2023 Annual Reliability Performance Report

company's Quality Assurance Department and extends out to operations engineers who are responsible for the daily oversight of feeders in their respective service area. Operations engineers are involved in customer interactions, identifying needs and corrective measures and are responsible for coordination through to completion. Working through and responding to complaints at a region/service area level provides the company an opportunity to be aware of any trends that may occur for a given feeder or lateral.

In addition, the group of Operations Engineers and System Reliability meet monthly to review common areas of concern across the system and identifies opportunities for improvement.

**Exhibit 10: Tampa Electric Formal Reliability Complaints
Filed with the FPSC by Year**

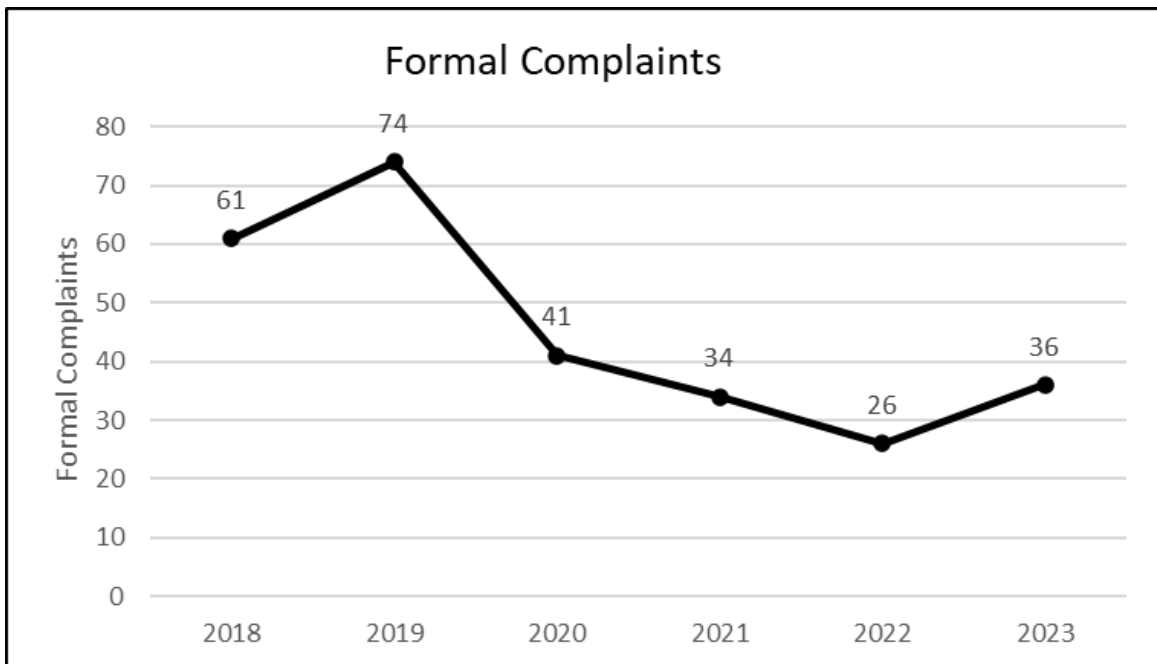


Exhibit 11: Tampa Electric Service Complaints by Year

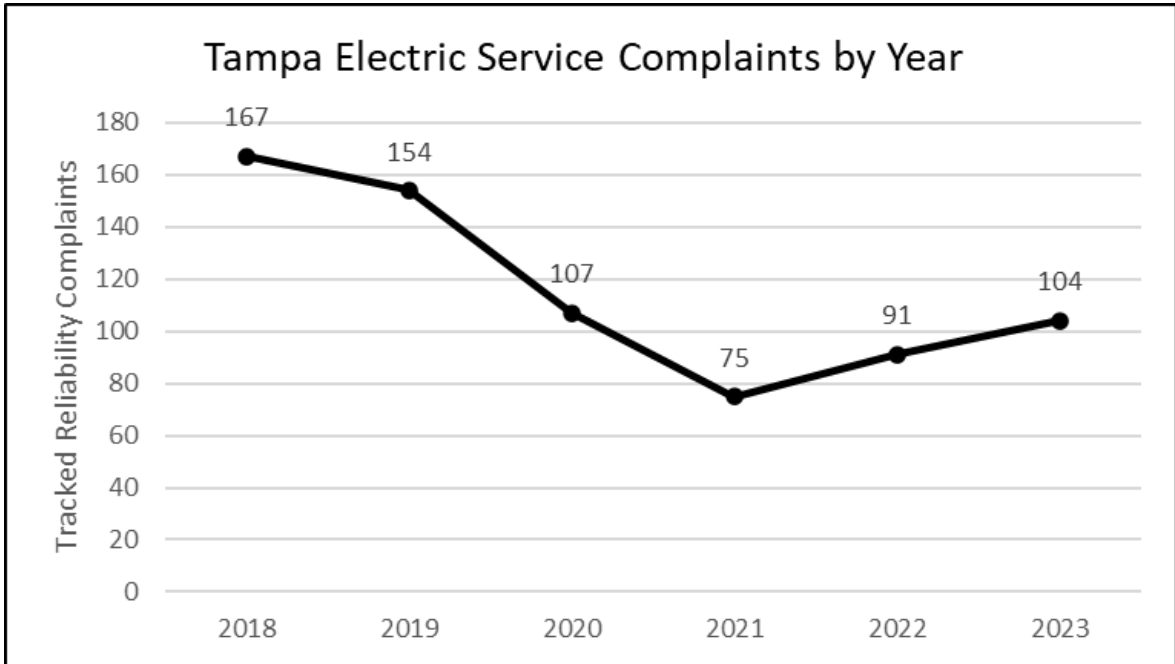


Exhibit 12: Formal Complaints vs. SAIDI by Year


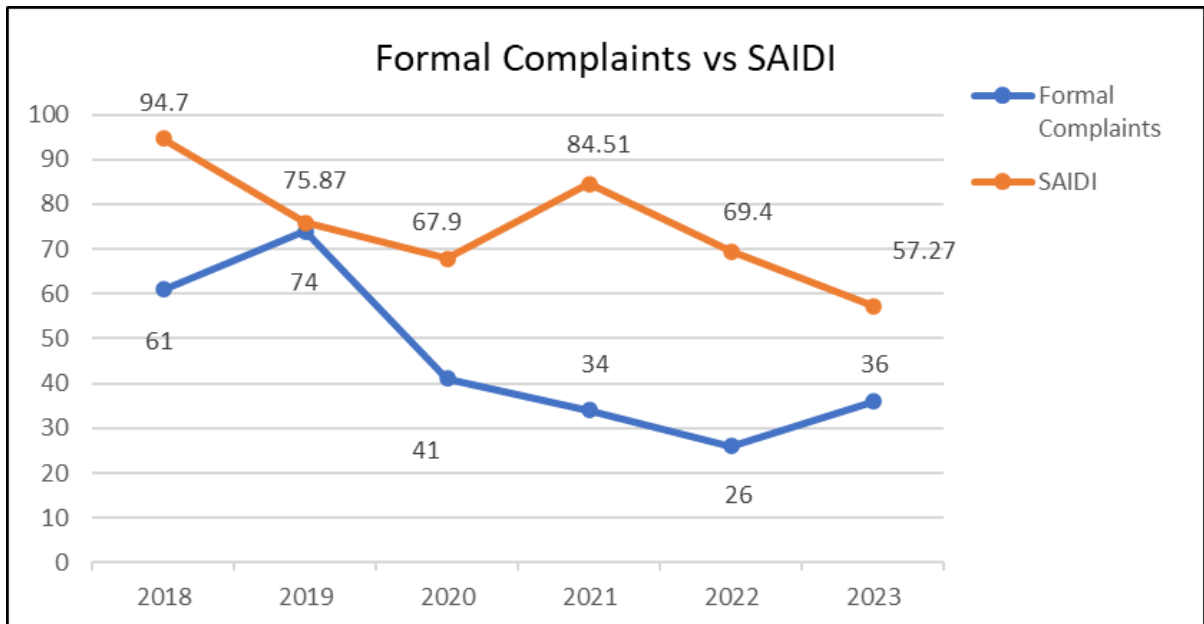


Exhibit 13: Formal Complaints vs. MAIFle by Year



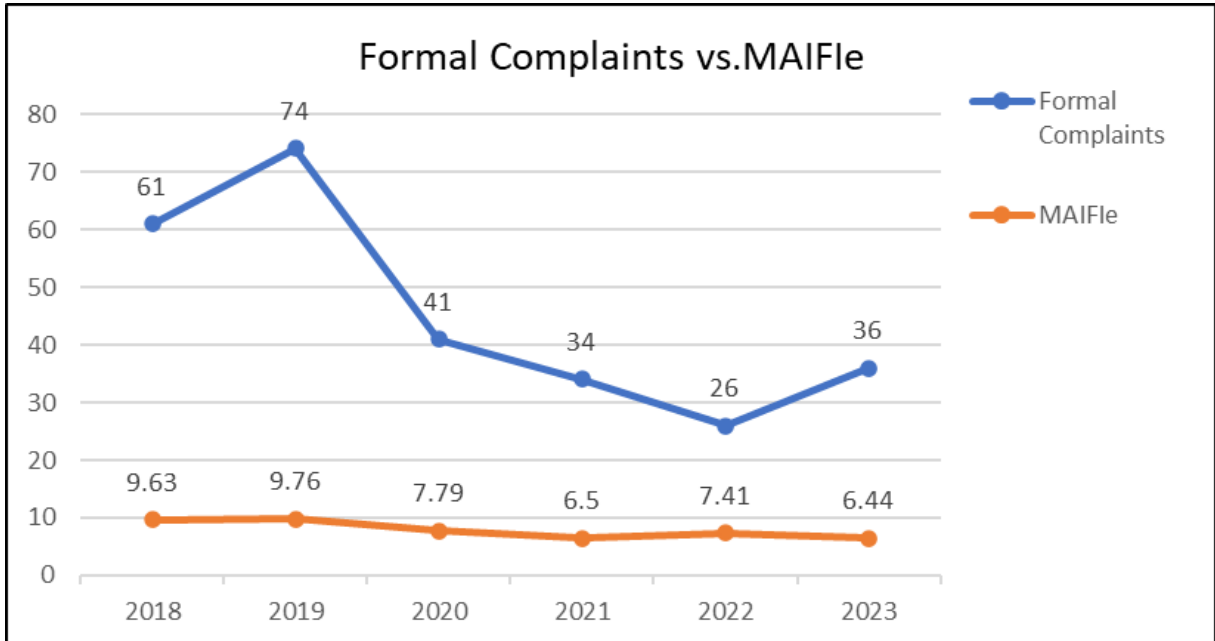

TECO[®]
TAMPA ELECTRIC
AN EMERA COMPANY

APPENDIX

2023

ANNUAL RELIABILITY PERFORMANCE REPORT

2023 Annual Reliability Performance Report

Reliability Appendix A

Form PSC/ECR 102-1(a)(8/06)

Primary Causes of Outage Events			
Utility Name: Tampa Electric			Year: 2023
Cause (a)	Number of Outages Events (N) (b)	Average Duration (L-Bar) (c)	Average Restoration Time (CAIDI) (d)
Planned Outage	5,397	106.24	37.69
Vegetation	1,505	141.14	79.69
Animals	1,251	76.24	57.13
Down Wire	1,097	153.78	81.87
Unknown	944	91.60	43.40
Lightning	811	145.18	74.24
Defective Equipment	702	175.55	110.11
Other Weather	640	154.04	86.29
Electrical	466	151.23	52.48
Vehicle	260	147.49	80.57
Bad Connection	253	156.25	59.29
Other	188	121.18	85.99
Substation Equipment	182	180.84	70.99
Human Interference	146	120.73	36.82
Fire	37	207.94	83.35
Transmission Equipment	22	59.68	33.20
Customer Owned Equipment	2	98.53	125.13
Total	13,903	122.76	61.35

Note: L-Bar and CAIDI are expressed in minutes.

2023 Annual Reliability Performance Report

Form 102 – Part III – Actual

ANNUAL DISTRIBUTION RELIABILITY REPORT - 2023

Utility Name: Tampa Electric

SAIDI: System Average Interruption Duration Index		
= <u>Sum of All Customer Minutes Interrupted (CMI)</u>	<u>63,162,863</u>	74.01
Total number of Customers Served (C)	853,333	
CAIDI: System Average Interruption Duration Index		
= <u>Sum of All Customer Minutes Interrupted (CMI)</u>	<u>63,162,863</u>	61.35
Total number of Customer Interruptions (CI)	1,029,566	
SAIFI: System Average Interruption Frequency Index		
= <u>Total number of Customer Interruptions (CI)</u>	<u>1,029,566</u>	1.21
Total number of Customers Served (C)	853,333	
MAIFe: Momentary Average Interruption Event		
= <u>Sum of All Customer Momentary Interruption Events (CME)</u>	<u>6,221,378</u>	7.29
Total number of Customers Served (C)	853,333	
L-Bar:		
= Minutes of Interruption	<u>1,706,801</u>	122.76
Total number of Outages	13,903	

District	C	CMI	CI	CME	CEMI-5
Central	219,838	15,006,349	230,955	1,334,562	1,411
Dade City	16,928	1,921,084	27,671	121,959	367
Eastern	134,994	8,124,544	144,671	990,910	2,227
Plant City	66,261	8,096,423	127,192	577,524	2,783
South Hillsborough	110,875	6,900,286	123,972	599,439	439
Western	217,506	14,258,346	221,458	1,776,009	1,075
Winter Haven	86,931	8,855,830	153,647	820,975	1,162
System Total:	853,333	63,162,863	1,029,566	6,221,378	9,464

2023 Annual Reliability Performance Report

Form 102 – Part III continued – Actual

Service Reliability Indices - Actual					
Utility Name: Tampa Electric			Year: 2023		
District or Service Area (a)	SAIDI	CAIDI	SAIFI	MAIFle	CEMI-5%
Central	68.26	64.98	1.05	6.07	0.64%
Dade City	113.49	69.43	1.63	7.20	2.17%
Eastern	60.18	56.16	1.07	7.34	1.65%
Plant City	122.19	63.66	1.92	8.72	4.20%
South Hillsborough	62.23	55.66	1.12	5.41	0.40%
Western	65.55	64.38	1.02	8.17	0.49%
Winter Haven	101.87	57.64	1.77	9.44	1.34%
System Total:	74.01	61.35	1.21	7.29	1.11%

Form PSC/ECR 102-3, Docket No. 20011351-EI, Rule 25-6.0455(c)

Note: L-Bar and CAIDI are expressed in minutes

2023 Annual Reliability Performance Report

Reliability Appendix B

Form PSC/ECR 102-1(b) (8/06)

Causes of Outage Events - Adjusted			
Utility Name: Tampa Electric		Year: 2023	
Cause (a)	Number of Outages Events (N)	Average Duration (L-Bar)	Average Restoration Time (CAIDI)
1. Vegetation	1,403	137.02	77.67
2. Animals	1,247	76.14	57.11
3. Down Wire	1,080	151.89	81.96
4. Unknown	939	90.81	43.35
5. Lightning	792	146.01	74.06
6. Defective Equipment	699	175.10	110.10
7. Other Weather	553	133.31	82.67
8. Electrical	461	151.44	52.33
9. Vehicle	252	149.88	81.05
10. Bad Connection	245	154.77	58.53
11. All Remaining Causes	573	141.06	54.48
Total	8,244	130.35	69.96

Note: L-Bar and CAIDI are expressed in minutes.

2023 Annual Reliability Performance Report

Form 103 - PART III – Adjusted

PART III ANNUAL DISTRIBUTION RELIABILITY REPORT - 2023 Utility Name: Tampa Electric

SAIDI: System Average Interruption Duration Index		
= <u>Sum of All Customer Minutes Interrupted (CMI)</u>	48,877,820	57.27
Total number of Customers Served (C)	853,333	
CAIDI: System Average Interruption Duration Index		
= <u>Sum of All Customer Minutes Interrupted (CMI)</u>	48,877,820	69.96
Total number of Customer Interruptions (CI)	698,675	
SAIFI: System Average Interruption Frequency Index		
= <u>Total number of Customer Interruptions (CI)</u>	698,675	0.82
Total number of Customers Served (C)	853,333	
MAIFle: Momentary Average Interruption Event		
= <u>Sum of All Customer Momentary Interruption Events (CME)</u>	5,492,737	6.44
Total number of Customers Served (C)	853,333	
L-Bar:		
= <u>Minutes of Interruption</u>	1,074,579	130.35
Total number of Outages	8,244	

District	C	CMI	CI	CME	CEMI-5
Central	219,838	12,029,985	153,862	1,181,149	130
Dade City	16,928	1,607,031	18,263	109,241	122
Eastern	134,994	6,926,096	103,061	870,422	68
Plant City	66,261	5,730,922	85,493	520,199	425
South Hillsborough	110,875	5,618,472	89,416	522,669	0
Western	217,506	10,171,774	145,767	1,588,537	114
Winter Haven	86,931	6,793,540	102,813	700,520	163
System Total:	853,333	48,877,820	698,675	5,492,737	1,022

2023 Annual Reliability Performance Report

Form 103 Part III continued Adjusted

Service Reliability Indices - Adjusted					
Utility Name: Tampa Electric			Year: 2023		
District or Service Area (a)	SAIDI (b)	CAIDI (c)	SAIFI (d)	MAIFle (e)	CEMI-5% (f)
Central	54.72	78.19	0.70	5.37	0.06%
Dade City	94.93	87.99	1.08	6.45	0.72%
Eastern	50.81	67.35	0.75	6.45	0.05%
Plant City	85.52	67.51	1.27	7.85	0.64%
South Hillsborough	50.67	62.84	0.81	4.71	0.00%
Western	46.64	70.01	0.67	7.30	0.05%
Winter Haven	78.15	66.08	1.18	8.06	0.19%
System Total:	57.27	69.96	0.82	6.44	0.12%

Form PSC/ECR 102-3, Docket No. 20011351-EI, Rule 25-6.0455(c)

Note: L-Bar and CAIDI are expressed in minutes

2023 Annual Reliability Performance Report

Actual Data: CMI, CI and Documented Exclusions

2023	CMI		CI	
	Value	% of Actual	Value	% of Actual
Reported Actual Data	69,856,805	100.00%	1,199,793	100.00%
Documented Exclusions				
Planned Service Interruptions	0	0.00%	0	0.00%
Named Storm	6,161,613	8.82%	143,266	11.94%
Tornadoes	0	0.00%	0	0.00%
Ice on Lines	0	0.00%	0	0.00%
Planned Load Management Events	14,283,675	20.45%	335,056	27.93%
Generation/Transmission Events	3,340,989	4.78%	40,877	3.41%
Extreme Weather (EOC Activation/Fire)	0	0.00%	0	0.00%
Reported Adjusted Data	48,877,820	69.97%	686,675	57.23%

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	1/1/2023 9:09	683.45	3
Transformer	PLANNED OUTAGE	1/1/2023 16:02	461.53	7
Transformer Bank	PLANNED OUTAGE	1/1/2023 18:15	164.05	3
Transformer	PLANNED OUTAGE	1/2/2023 17:08	57.50	3
Switch	PLANNED OUTAGE	1/2/2023 20:00	3,123.75	17
Transformer	PLANNED OUTAGE	1/3/2023 8:24	275.47	4
Transformer	PLANNED OUTAGE	1/3/2023 8:34	740.83	10
Transformer	PLANNED OUTAGE	1/3/2023 8:44	337.67	4
Transformer	PLANNED OUTAGE	1/3/2023 8:55	296.00	10
PLF	PLANNED OUTAGE	1/3/2023 9:42	1,199.87	4
PLF	PLANNED OUTAGE	1/3/2023 9:48	219.10	14
PLF	PLANNED OUTAGE	1/3/2023 10:19	266.85	1
Transformer	PLANNED OUTAGE	1/3/2023 10:55	126.53	4
Transformer	PLANNED OUTAGE	1/3/2023 11:47	183.30	3
Transformer	PLANNED OUTAGE	1/3/2023 12:50	1,513.42	11
Switch	PLANNED OUTAGE	1/3/2023 13:11	511.00	10
PLF	PLANNED OUTAGE	1/3/2023 13:15	139.67	5
Transformer	PLANNED OUTAGE	1/3/2023 13:21	1,239.35	7
Transformer	PLANNED OUTAGE	1/3/2023 13:24	839.12	11
Transformer	PLANNED OUTAGE	1/3/2023 13:48	251.07	4
PLF	PLANNED OUTAGE	1/3/2023 13:50	55.43	1
Transformer	PLANNED OUTAGE	1/3/2023 13:50	131.00	3
Transformer	PLANNED OUTAGE	1/3/2023 16:35	74.20	7
Transformer Bank	PLANNED OUTAGE	1/3/2023 17:54	18.78	1
Transformer	PLANNED OUTAGE	1/3/2023 20:09	40.60	1
Transformer	PLANNED OUTAGE	1/3/2023 20:38	141.20	12
Switch	PLANNED OUTAGE	1/3/2023 22:55	105.67	1
PLF	PLANNED OUTAGE	1/3/2023 22:55	422.67	4
Transformer Bank	PLANNED OUTAGE	1/4/2023 1:46	406.75	5
Transformer Bank	PLANNED OUTAGE	1/4/2023 3:16	30.92	5
Service point	PLANNED OUTAGE	1/4/2023 3:24	260.50	1
Transformer	PLANNED OUTAGE	1/4/2023 8:14	236.13	1
Transformer	PLANNED OUTAGE	1/4/2023 8:17	1,244.25	7
Switch	PLANNED OUTAGE	1/4/2023 8:52	492.25	11
Transformer	PLANNED OUTAGE	1/4/2023 9:04	873.60	8
Transformer	PLANNED OUTAGE	1/4/2023 9:04	152.35	3
Switch	PLANNED OUTAGE	1/4/2023 9:23	351.23	2
Transformer	PLANNED OUTAGE	1/4/2023 9:32	3,017.30	11
Transformer	PLANNED OUTAGE	1/4/2023 9:41	144.73	2
Switch	PLANNED OUTAGE	1/4/2023 9:42	204.23	11
PLF	PLANNED OUTAGE	1/4/2023 9:43	4,728.97	26
Transformer	PLANNED OUTAGE	1/4/2023 9:45	593.07	2
Switch	PLANNED OUTAGE	1/4/2023 10:01	389.07	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	1/4/2023 10:03	103.33	2
Primary Wire	PLANNED OUTAGE	1/4/2023 10:03	44.40	2
Transformer	PLANNED OUTAGE	1/4/2023 10:19	1,234.20	9
Primary Wire	PLANNED OUTAGE	1/4/2023 10:47	113.95	1
Transformer	PLANNED OUTAGE	1/4/2023 11:17	1,521.33	5
PLF	PLANNED OUTAGE	1/4/2023 11:34	309.30	3
Primary Wire	PLANNED OUTAGE	1/4/2023 11:40	141.73	4
Switch	PLANNED OUTAGE	1/4/2023 11:45	450.33	10
Switch	PLANNED OUTAGE	1/4/2023 11:45	380.55	9
PLF	PLANNED OUTAGE	1/4/2023 11:47	91.13	4
Transformer	PLANNED OUTAGE	1/4/2023 12:10	650.50	10
Transformer	PLANNED OUTAGE	1/4/2023 12:15	138.37	2
Service point	PLANNED OUTAGE	1/4/2023 12:47	130.67	1
PLF	PLANNED OUTAGE	1/4/2023 13:29	25.23	1
Transformer	PLANNED OUTAGE	1/4/2023 14:23	74.47	1
Transformer	PLANNED OUTAGE	1/4/2023 17:20	227.25	9
Transformer	PLANNED OUTAGE	1/4/2023 18:26	361.05	9
Transformer	PLANNED OUTAGE	1/4/2023 19:24	624.75	9
Transformer	PLANNED OUTAGE	1/5/2023 8:03	62.55	9
Transformer	PLANNED OUTAGE	1/5/2023 8:24	239.60	2
Transformer	PLANNED OUTAGE	1/5/2023 8:52	744.80	4
Transformer	PLANNED OUTAGE	1/5/2023 9:03	643.20	4
Transformer	PLANNED OUTAGE	1/5/2023 9:03	1,002.70	6
Transformer Bank	PLANNED OUTAGE	1/5/2023 9:04	180.02	7
Transformer	PLANNED OUTAGE	1/5/2023 9:12	141.77	2
Transformer	PLANNED OUTAGE	1/5/2023 9:46	32.77	1
Transformer	PLANNED OUTAGE	1/5/2023 10:00	77.30	1
Transformer	PLANNED OUTAGE	1/5/2023 11:09	1,332.30	18
Transformer	PLANNED OUTAGE	1/5/2023 12:11	335.07	7
PLF	PLANNED OUTAGE	1/5/2023 17:17	528.65	3
Switch	PLANNED OUTAGE	1/5/2023 18:06	8,466.08	19
Transformer	PLANNED OUTAGE	1/5/2023 18:51	414.05	7
Transformer	PLANNED OUTAGE	1/6/2023 8:33	131.67	1
Transformer	PLANNED OUTAGE	1/6/2023 9:05	1,223.60	8
PLF	PLANNED OUTAGE	1/6/2023 10:33	50.00	3
PLF	PLANNED OUTAGE	1/6/2023 10:49	23.52	1
Transformer	PLANNED OUTAGE	1/6/2023 12:14	115.27	4
Transformer	PLANNED OUTAGE	1/6/2023 12:54	144.65	11
Transformer	PLANNED OUTAGE	1/6/2023 12:54	154.00	11
Transformer	PLANNED OUTAGE	1/6/2023 13:56	124.97	2
PLF	PLANNED OUTAGE	1/7/2023 8:56	163.98	1
Transformer	PLANNED OUTAGE	1/7/2023 14:59	37.67	5
Transformer	PLANNED OUTAGE	1/8/2023 7:57	624.50	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/8/2023 21:26	865.65	9
PLF	PLANNED OUTAGE	1/9/2023 8:19	9,884.65	29
Transformer	PLANNED OUTAGE	1/9/2023 9:41	71.80	3
Transformer	PLANNED OUTAGE	1/9/2023 9:44	3,133.00	26
Transformer	PLANNED OUTAGE	1/9/2023 9:47	4.40	3
PLF	PLANNED OUTAGE	1/9/2023 10:14	352.35	9
Transformer	PLANNED OUTAGE	1/9/2023 12:43	91.20	1
Transformer	PLANNED OUTAGE	1/9/2023 13:04	198.75	9
Transformer	PLANNED OUTAGE	1/9/2023 14:51	157.50	21
Transformer	PLANNED OUTAGE	1/9/2023 16:00	5,455.30	34
PLF	PLANNED OUTAGE	1/10/2023 8:21	886.67	25
Switch	PLANNED OUTAGE	1/10/2023 8:24	27.80	4
Switch	PLANNED OUTAGE	1/10/2023 8:24	193.33	5
Primary Wire	PLANNED OUTAGE	1/10/2023 8:48	3,429.82	19
Transformer	PLANNED OUTAGE	1/10/2023 8:51	339.27	4
Transformer	PLANNED OUTAGE	1/10/2023 9:29	43.18	1
Transformer	PLANNED OUTAGE	1/10/2023 9:30	737.20	8
Switch	PLANNED OUTAGE	1/10/2023 10:22	221.87	1
Transformer	PLANNED OUTAGE	1/10/2023 10:24	1,225.20	12
Transformer	PLANNED OUTAGE	1/10/2023 10:29	769.20	8
Transformer	PLANNED OUTAGE	1/10/2023 10:51	712.25	15
Transformer	PLANNED OUTAGE	1/10/2023 10:51	114.85	3
PLF	PLANNED OUTAGE	1/10/2023 14:02	11.47	1
Transformer	PLANNED OUTAGE	1/10/2023 14:04	154.53	19
PLF	PLANNED OUTAGE	1/10/2023 18:18	62.87	1
Transformer	PLANNED OUTAGE	1/11/2023 8:37	1,193.58	5
Transformer	PLANNED OUTAGE	1/11/2023 8:38	1,431.20	6
PLF	PLANNED OUTAGE	1/11/2023 8:38	1,429.75	5
Transformer	PLANNED OUTAGE	1/11/2023 8:42	2,774.57	46
Transformer	PLANNED OUTAGE	1/11/2023 9:42	107.67	10
Switch	PLANNED OUTAGE	1/11/2023 10:12	212.23	1
Switch	PLANNED OUTAGE	1/11/2023 10:12	212.65	1
Primary Wire	PLANNED OUTAGE	1/11/2023 10:20	1,735.77	7
Transformer	PLANNED OUTAGE	1/11/2023 10:40	427.47	7
Transformer	PLANNED OUTAGE	1/11/2023 11:29	1,736.00	7
Transformer	PLANNED OUTAGE	1/11/2023 11:39	570.47	4
Transformer	PLANNED OUTAGE	1/11/2023 11:41	276.85	3
Transformer	PLANNED OUTAGE	1/11/2023 12:05	205.33	2
Transformer	PLANNED OUTAGE	1/11/2023 12:09	73.73	2
Transformer	PLANNED OUTAGE	1/11/2023 12:24	514.80	6
PLF	PLANNED OUTAGE	1/11/2023 13:14	463.83	5
Transformer	PLANNED OUTAGE	1/11/2023 13:52	58.53	2
Transformer	PLANNED OUTAGE	1/11/2023 18:43	158.43	7

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	1/11/2023 23:54	181.27	1
Transformer	PLANNED OUTAGE	1/12/2023 8:12	533.77	2
Transformer	PLANNED OUTAGE	1/12/2023 9:25	1,066.67	5
Transformer	PLANNED OUTAGE	1/12/2023 9:25	852.13	4
Transformer	PLANNED OUTAGE	1/12/2023 10:02	1,477.47	14
Switch	PLANNED OUTAGE	1/12/2023 10:04	311.73	7
PLF	PLANNED OUTAGE	1/12/2023 10:27	297.08	1
Service point	PLANNED OUTAGE	1/12/2023 10:37	164.48	1
Service point	PLANNED OUTAGE	1/12/2023 10:43	203.73	1
Transformer	PLANNED OUTAGE	1/12/2023 11:31	584.13	8
Transformer	PLANNED OUTAGE	1/12/2023 12:20	257.13	4
Transformer	PLANNED OUTAGE	1/12/2023 13:50	255.57	17
Transformer Bank	PLANNED OUTAGE	1/12/2023 18:37	125.35	3
Transformer	PLANNED OUTAGE	1/12/2023 23:07	65.57	2
Transformer	PLANNED OUTAGE	1/13/2023 1:46	640.00	10
Breaker	PLANNED OUTAGE	1/13/2023 6:40	800.00	384
Breaker	PLANNED OUTAGE	1/13/2023 8:14	28,268.20	2076
Breaker	PLANNED OUTAGE	1/13/2023 8:28	82.98	13
Breaker	PLANNED OUTAGE	1/13/2023 8:28	4,567.20	2076
Transformer Bank	PLANNED OUTAGE	1/13/2023 9:26	98.85	1
Transformer	PLANNED OUTAGE	1/13/2023 9:48	454.90	6
Transformer	PLANNED OUTAGE	1/13/2023 10:32	1,134.93	14
Transformer	PLANNED OUTAGE	1/13/2023 12:54	623.25	9
PLF	PLANNED OUTAGE	1/13/2023 17:10	109.60	2
Service point	PLANNED OUTAGE	1/13/2023 18:23	25.43	1
Transformer	PLANNED OUTAGE	1/13/2023 22:55	155.47	8
Transformer	PLANNED OUTAGE	1/14/2023 3:11	706.43	2
Breaker	PLANNED OUTAGE	1/14/2023 5:46	1,365.00	630
Transformer	PLANNED OUTAGE	1/14/2023 16:51	20.42	7
Transformer Bank	PLANNED OUTAGE	1/14/2023 22:35	111.70	1
Transformer	PLANNED OUTAGE	1/15/2023 23:07	175.17	10
Transformer Bank	PLANNED OUTAGE	1/16/2023 4:44	190.28	1
Breaker	PLANNED OUTAGE	1/16/2023 6:59	3.68	1
Transformer	PLANNED OUTAGE	1/16/2023 7:13	189.67	10
Transformer	PLANNED OUTAGE	1/16/2023 8:50	462.23	7
Switch	PLANNED OUTAGE	1/16/2023 8:58	1,218.35	21
Switch	PLANNED OUTAGE	1/16/2023 9:35	701.40	3
Transformer	PLANNED OUTAGE	1/16/2023 10:28	495.47	8
PLF	PLANNED OUTAGE	1/16/2023 10:53	295.28	1
Transformer	PLANNED OUTAGE	1/16/2023 11:04	655.50	9
Transformer	PLANNED OUTAGE	1/16/2023 11:21	225.25	15
Service point	PLANNED OUTAGE	1/16/2023 11:35	208.93	1
Transformer	PLANNED OUTAGE	1/16/2023 12:34	334.20	6

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/16/2023 17:47	124.00	10
Transformer	PLANNED OUTAGE	1/16/2023 17:56	1,116.83	10
Transformer	PLANNED OUTAGE	1/17/2023 8:27	9,135.50	30
Transformer	PLANNED OUTAGE	1/17/2023 9:17	290.32	1
Transformer	PLANNED OUTAGE	1/17/2023 9:17	483.30	6
Transformer	PLANNED OUTAGE	1/17/2023 11:20	1,372.00	8
Transformer	PLANNED OUTAGE	1/17/2023 11:33	1,779.07	11
Transformer Bank	PLANNED OUTAGE	1/17/2023 12:02	592.72	11
Transformer	PLANNED OUTAGE	1/17/2023 12:42	356.67	25
Transformer	PLANNED OUTAGE	1/17/2023 17:00	372.58	5
Breaker	PLANNED OUTAGE	1/17/2023 17:39	4,365.73	1912
Switch	PLANNED OUTAGE	1/18/2023 6:00	200,739.00	420
Transformer	PLANNED OUTAGE	1/18/2023 9:06	1,958.88	13
Transformer	PLANNED OUTAGE	1/18/2023 9:06	1,952.60	13
Transformer	PLANNED OUTAGE	1/18/2023 9:16	197.10	2
Switch	PLANNED OUTAGE	1/18/2023 9:54	801.60	32
Switch	PLANNED OUTAGE	1/18/2023 10:02	193.28	1
Transformer	PLANNED OUTAGE	1/18/2023 10:04	1,225.58	5
Switch	PLANNED OUTAGE	1/18/2023 10:29	931.87	29
Transformer	PLANNED OUTAGE	1/18/2023 11:02	578.25	9
Switch	PLANNED OUTAGE	1/18/2023 11:14	617.33	20
PLF	PLANNED OUTAGE	1/18/2023 11:49	5,747.32	29
Switch	PLANNED OUTAGE	1/18/2023 11:57	268.67	20
Transformer Bank	PLANNED OUTAGE	1/18/2023 12:09	2,144.85	9
Switch	PLANNED OUTAGE	1/18/2023 12:28	701.53	34
Switch	PLANNED OUTAGE	1/18/2023 12:57	1,178.00	38
Transformer	PLANNED OUTAGE	1/18/2023 13:14	445.65	9
Transformer Bank	PLANNED OUTAGE	1/18/2023 13:27	60.70	3
Switch	PLANNED OUTAGE	1/18/2023 13:37	323.70	26
Switch	PLANNED OUTAGE	1/18/2023 13:57	447.20	24
PLF	PLANNED OUTAGE	1/18/2023 15:04	132.55	11
PLF	PLANNED OUTAGE	1/18/2023 20:09	690.13	4
Transformer	PLANNED OUTAGE	1/18/2023 22:46	296.50	10
Transformer	PLANNED OUTAGE	1/19/2023 8:24	733.47	8
Transformer	PLANNED OUTAGE	1/19/2023 9:14	1,543.75	25
PLF	PLANNED OUTAGE	1/19/2023 9:24	5,772.50	30
Transformer	PLANNED OUTAGE	1/19/2023 9:28	1,144.30	6
Transformer	PLANNED OUTAGE	1/19/2023 10:07	897.40	12
Transformer	PLANNED OUTAGE	1/19/2023 10:25	229.93	4
Transformer	PLANNED OUTAGE	1/19/2023 10:59	109.43	2
Transformer	PLANNED OUTAGE	1/19/2023 11:17	310.75	5
Transformer	PLANNED OUTAGE	1/19/2023 11:31	694.67	10
Transformer	PLANNED OUTAGE	1/19/2023 12:02	262.17	22

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/19/2023 12:08	420.00	2
Transformer	PLANNED OUTAGE	1/19/2023 12:11	340.08	7
Transformer	PLANNED OUTAGE	1/19/2023 12:27	208.15	3
Transformer	PLANNED OUTAGE	1/19/2023 12:46	468.30	6
Transformer	PLANNED OUTAGE	1/19/2023 13:14	179.42	5
Service point	PLANNED OUTAGE	1/19/2023 14:26	17.97	1
Transformer	PLANNED OUTAGE	1/19/2023 15:04	156.90	6
Transformer	PLANNED OUTAGE	1/20/2023 8:30	645.00	18
Transformer	PLANNED OUTAGE	1/20/2023 8:52	1,611.15	9
Transformer	PLANNED OUTAGE	1/20/2023 9:00	226.33	1
PLF	PLANNED OUTAGE	1/20/2023 9:07	616.53	17
Transformer	PLANNED OUTAGE	1/20/2023 9:14	1,123.83	22
Primary Wire	PLANNED OUTAGE	1/20/2023 9:23	657.10	6
Switch	PLANNED OUTAGE	1/20/2023 9:35	1,499.12	17
Transformer	PLANNED OUTAGE	1/20/2023 9:36	531.17	5
Switch	PLANNED OUTAGE	1/20/2023 9:39	414.60	6
PLF	PLANNED OUTAGE	1/20/2023 9:42	409.27	2
Transformer	PLANNED OUTAGE	1/20/2023 9:44	545.13	13
Transformer	PLANNED OUTAGE	1/20/2023 9:52	98.10	27
Transformer	PLANNED OUTAGE	1/20/2023 10:00	724.95	27
Transformer	PLANNED OUTAGE	1/20/2023 10:06	1,115.80	6
PLF	PLANNED OUTAGE	1/20/2023 10:30	10,848.42	67
Transformer	PLANNED OUTAGE	1/20/2023 11:28	1,007.47	16
Transformer	PLANNED OUTAGE	1/20/2023 17:00	73.60	8
Transformer	PLANNED OUTAGE	1/21/2023 0:09	247.20	8
Breaker	PLANNED OUTAGE	1/21/2023 2:46	2,629.67	1127
Transformer	PLANNED OUTAGE	1/21/2023 7:58	141.60	1
PLF	PLANNED OUTAGE	1/21/2023 8:02	2,816.70	6
Transformer	PLANNED OUTAGE	1/21/2023 10:26	101.32	1
PLF	PLANNED OUTAGE	1/21/2023 15:36	561.47	1
PLF	PLANNED OUTAGE	1/21/2023 17:21	1,675.07	2
Switch	PLANNED OUTAGE	1/21/2023 20:15	295.50	2
Switch	PLANNED OUTAGE	1/21/2023 21:11	890.37	2
Switch	PLANNED OUTAGE	1/21/2023 23:00	15.67	2
PLF	PLANNED OUTAGE	1/22/2023 18:33	412.07	1
Switch	PLANNED OUTAGE	1/23/2023 2:01	471.65	1
Transformer	PLANNED OUTAGE	1/23/2023 2:03	450.63	11
Breaker	PLANNED OUTAGE	1/23/2023 2:11	6,186.25	1515
Transformer	PLANNED OUTAGE	1/23/2023 8:24	1,545.73	4
PLF	PLANNED OUTAGE	1/23/2023 8:25	8,205.75	21
Switch	PLANNED OUTAGE	1/23/2023 8:55	210.42	1
Transformer	PLANNED OUTAGE	1/23/2023 8:56	346.07	1
Transformer	PLANNED OUTAGE	1/23/2023 8:56	1,027.25	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	1/23/2023 9:32	804.00	3
PLF	PLANNED OUTAGE	1/23/2023 9:39	254.53	1
Transformer	PLANNED OUTAGE	1/23/2023 9:51	619.20	3
PLF	PLANNED OUTAGE	1/23/2023 9:51	205.52	1
Transformer	PLANNED OUTAGE	1/23/2023 10:16	64.12	1
Primary Wire	PLANNED OUTAGE	1/23/2023 10:35	9,941.10	39
Transformer	PLANNED OUTAGE	1/23/2023 10:42	44.83	2
PLF	PLANNED OUTAGE	1/24/2023 1:13	352.22	7
Primary Wire	PLANNED OUTAGE	1/24/2023 7:28	291.40	4
Transformer	PLANNED OUTAGE	1/24/2023 8:00	3,209.85	9
Transformer	PLANNED OUTAGE	1/24/2023 8:34	97.07	2
Transformer	PLANNED OUTAGE	1/24/2023 8:42	1,525.75	5
Transformer	PLANNED OUTAGE	1/24/2023 8:42	365.20	2
Transformer	PLANNED OUTAGE	1/24/2023 9:02	5.57	1
Breaker	PLANNED OUTAGE	1/24/2023 9:14	2,828.00	1414
Breaker	PLANNED OUTAGE	1/24/2023 9:14	2.50	1
Breaker	PLANNED OUTAGE	1/24/2023 9:14	2.30	1
Transformer	PLANNED OUTAGE	1/24/2023 9:20	615.00	6
Transformer	PLANNED OUTAGE	1/24/2023 9:29	598.55	3
Transformer	PLANNED OUTAGE	1/24/2023 9:34	1,064.50	5
Transformer	PLANNED OUTAGE	1/24/2023 10:12	55.03	1
Transformer	PLANNED OUTAGE	1/24/2023 10:46	2,758.00	10
Switch	PLANNED OUTAGE	1/24/2023 11:17	871.73	28
Transformer	PLANNED OUTAGE	1/24/2023 12:48	33.00	5
Transformer	PLANNED OUTAGE	1/24/2023 13:09	199.33	2
PLF	PLANNED OUTAGE	1/24/2023 13:42	114.03	2
Service point	PLANNED OUTAGE	1/24/2023 13:49	57.00	1
Switch	PLANNED OUTAGE	1/24/2023 13:58	326.80	8
Transformer	PLANNED OUTAGE	1/24/2023 14:17	456.60	4
Transformer	PLANNED OUTAGE	1/24/2023 15:11	60.00	6
Switch	PLANNED OUTAGE	1/25/2023 1:28	4,800.60	63
Switch	PLANNED OUTAGE	1/25/2023 6:45	1,067.30	6
Transformer	PLANNED OUTAGE	1/25/2023 8:47	2,726.62	7
Transformer	PLANNED OUTAGE	1/25/2023 8:50	4,272.45	13
Transformer	PLANNED OUTAGE	1/25/2023 8:58	1,858.65	9
Transformer	PLANNED OUTAGE	1/25/2023 9:06	152.90	2
Switch	PLANNED OUTAGE	1/25/2023 9:44	618.13	8
Transformer	PLANNED OUTAGE	1/25/2023 10:10	413.33	4
Transformer	PLANNED OUTAGE	1/25/2023 10:29	254.20	3
Transformer	PLANNED OUTAGE	1/25/2023 10:38	1,732.38	7
PLF	PLANNED OUTAGE	1/25/2023 10:41	10.43	2
Switch	PLANNED OUTAGE	1/25/2023 10:42	200.90	1
Transformer	PLANNED OUTAGE	1/25/2023 10:59	62.52	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	1/25/2023 11:14	4.25	3
Switch	PLANNED OUTAGE	1/25/2023 12:19	289.80	1
Switch	PLANNED OUTAGE	1/25/2023 13:31	16.02	1
Transformer	PLANNED OUTAGE	1/25/2023 14:09	2,094.60	9
Transformer	PLANNED OUTAGE	1/25/2023 17:22	35.12	1
Breaker	PLANNED OUTAGE	1/25/2023 23:48	4,013.20	1016
Transformer Bank	PLANNED OUTAGE	1/26/2023 1:21	620.43	2
Breaker	PLANNED OUTAGE	1/26/2023 5:09	89.10	33
PLF	PLANNED OUTAGE	1/26/2023 8:23	5,605.60	16
Switch	PLANNED OUTAGE	1/26/2023 8:55	408.40	8
Transformer	PLANNED OUTAGE	1/26/2023 9:05	51.00	3
Transformer	PLANNED OUTAGE	1/26/2023 9:07	69.50	2
Transformer	PLANNED OUTAGE	1/26/2023 9:11	3,593.50	15
Transformer	PLANNED OUTAGE	1/26/2023 9:14	278.07	4
Transformer	PLANNED OUTAGE	1/26/2023 9:16	216.17	10
PLF	PLANNED OUTAGE	1/26/2023 10:51	566.60	6
Transformer	PLANNED OUTAGE	1/26/2023 13:17	41.22	1
PLF	PLANNED OUTAGE	1/26/2023 18:28	133.28	1
PLF	PLANNED OUTAGE	1/26/2023 21:52	27.30	1
Switch	PLANNED OUTAGE	1/27/2023 1:22	40.33	1
Transformer	PLANNED OUTAGE	1/27/2023 8:12	264.67	8
Transformer	PLANNED OUTAGE	1/27/2023 10:42	148.92	5
Transformer Bank	PLANNED OUTAGE	1/27/2023 12:13	24.20	4
Transformer Bank	PLANNED OUTAGE	1/27/2023 12:19	210.13	4
Transformer Bank	PLANNED OUTAGE	1/27/2023 12:32	270.90	3
Transformer	PLANNED OUTAGE	1/27/2023 22:23	507.60	9
PLF	PLANNED OUTAGE	1/28/2023 8:47	166.80	1
Transformer	PLANNED OUTAGE	1/28/2023 9:14	843.20	6
Transformer	PLANNED OUTAGE	1/28/2023 19:01	1,090.67	10
Transformer	PLANNED OUTAGE	1/28/2023 19:30	4,325.80	12
Recloser	PLANNED OUTAGE	1/28/2023 20:31	124.20	4
Primary Wire	PLANNED OUTAGE	1/29/2023 0:38	195.70	1
Transformer	PLANNED OUTAGE	1/29/2023 8:00	114.55	1
Switch	PLANNED OUTAGE	1/29/2023 14:18	362.85	9
Switch	PLANNED OUTAGE	1/29/2023 20:38	5,968.00	15
Transformer	PLANNED OUTAGE	1/29/2023 21:21	146.53	7
Primary Wire	PLANNED OUTAGE	1/30/2023 7:48	385.03	1
Primary Wire	PLANNED OUTAGE	1/30/2023 7:48	2,874.22	31
Transformer	PLANNED OUTAGE	1/30/2023 8:46	467.27	4
PLF	PLANNED OUTAGE	1/30/2023 9:21	345.20	2
PLF	PLANNED OUTAGE	1/30/2023 9:39	3,547.33	17
Transformer	PLANNED OUTAGE	1/30/2023 10:26	60.75	3
Switch	PLANNED OUTAGE	1/30/2023 12:10	276.13	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	1/30/2023 12:57	193.90	2
Switch	PLANNED OUTAGE	1/30/2023 13:12	263.43	7
Transformer	PLANNED OUTAGE	1/30/2023 13:20	101.15	1
Breaker	PLANNED OUTAGE	1/30/2023 13:59	1,470.25	15
Breaker	PLANNED OUTAGE	1/30/2023 13:59	31,179.17	875
Breaker	PLANNED OUTAGE	1/30/2023 13:59	52,325.07	821
Transformer	PLANNED OUTAGE	1/30/2023 17:13	148.52	7
Service point	PLANNED OUTAGE	1/30/2023 17:44	82.62	1
Transformer	PLANNED OUTAGE	1/30/2023 19:20	107.00	5
Transformer	PLANNED OUTAGE	1/30/2023 20:13	1,131.27	4
Transformer	PLANNED OUTAGE	1/31/2023 1:00	228.08	7
PLF	PLANNED OUTAGE	1/31/2023 8:49	398.70	9
Transformer	PLANNED OUTAGE	1/31/2023 9:07	327.40	4
Transformer	PLANNED OUTAGE	1/31/2023 9:27	115.88	1
PLF	PLANNED OUTAGE	1/31/2023 9:50	169.23	1
PLF	PLANNED OUTAGE	1/31/2023 10:17	136.00	30
Switch	PLANNED OUTAGE	1/31/2023 10:45	431.33	8
Transformer	PLANNED OUTAGE	1/31/2023 11:28	295.15	3
Transformer	PLANNED OUTAGE	1/31/2023 11:46	1,272.05	13
Transformer	PLANNED OUTAGE	1/31/2023 14:26	475.67	4
Transformer	PLANNED OUTAGE	1/31/2023 18:13	817.20	6
Transformer	PLANNED OUTAGE	1/31/2023 19:08	269.58	5
PLF	PLANNED OUTAGE	2/1/2023 8:25	2,205.00	50
Transformer	PLANNED OUTAGE	2/1/2023 8:28	24.75	5
Transformer	PLANNED OUTAGE	2/1/2023 9:11	453.60	4
Primary Wire	PLANNED OUTAGE	2/1/2023 9:21	4,183.83	13
Transformer	PLANNED OUTAGE	2/1/2023 9:22	1,249.83	10
Transformer	PLANNED OUTAGE	2/1/2023 9:58	6,459.58	37
Switch	PLANNED OUTAGE	2/1/2023 10:16	115.58	5
PLF	PLANNED OUTAGE	2/1/2023 10:21	2,301.52	17
Transformer	PLANNED OUTAGE	2/1/2023 10:44	553.80	13
Transformer	PLANNED OUTAGE	2/1/2023 11:33	222.57	2
Transformer	PLANNED OUTAGE	2/1/2023 12:28	661.83	5
Transformer	PLANNED OUTAGE	2/1/2023 12:57	92.15	1
Transformer	PLANNED OUTAGE	2/1/2023 14:02	105.80	4
Transformer	PLANNED OUTAGE	2/1/2023 16:31	207.90	6
Transformer	PLANNED OUTAGE	2/1/2023 16:32	189.93	7
Transformer	PLANNED OUTAGE	2/1/2023 16:49	19.98	1
Switch	PLANNED OUTAGE	2/1/2023 23:33	1,012.92	25
PLF	PLANNED OUTAGE	2/2/2023 0:01	743.33	2
Breaker	PLANNED OUTAGE	2/2/2023 6:28	11,952.77	1153
Transformer Bank	PLANNED OUTAGE	2/2/2023 7:58	186.15	1
PLF	PLANNED OUTAGE	2/2/2023 8:15	24,141.00	65

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/2/2023 8:17	2,884.95	9
Transformer	PLANNED OUTAGE	2/2/2023 8:19	2,923.95	9
Transformer	PLANNED OUTAGE	2/2/2023 8:21	1,728.70	6
Transformer	PLANNED OUTAGE	2/2/2023 8:22	2,887.67	10
Transformer	PLANNED OUTAGE	2/2/2023 9:27	901.08	5
Transformer	PLANNED OUTAGE	2/2/2023 9:44	275.90	3
PLF	PLANNED OUTAGE	2/2/2023 9:57	186.70	1
Transformer	PLANNED OUTAGE	2/2/2023 10:02	174.40	4
Switch	PLANNED OUTAGE	2/2/2023 10:21	287.70	2
Transformer	PLANNED OUTAGE	2/2/2023 11:16	1,058.17	7
Transformer	PLANNED OUTAGE	2/2/2023 11:37	699.93	4
Transformer	PLANNED OUTAGE	2/2/2023 12:26	936.10	11
PLF	PLANNED OUTAGE	2/2/2023 13:37	2,420.00	50
Transformer	PLANNED OUTAGE	2/2/2023 14:34	204.87	4
Transformer	PLANNED OUTAGE	2/2/2023 15:31	271.87	8
PLF	PLANNED OUTAGE	2/2/2023 18:11	308.58	1
Transformer	PLANNED OUTAGE	2/2/2023 22:09	2,360.28	7
Service point	PLANNED OUTAGE	2/2/2023 22:42	7.72	1
Switch	PLANNED OUTAGE	2/2/2023 23:09	447.15	3
Transformer	PLANNED OUTAGE	2/3/2023 9:45	357.20	8
Transformer	PLANNED OUTAGE	2/3/2023 9:46	171.87	4
PLF	PLANNED OUTAGE	2/3/2023 11:00	39.20	4
Switch	PLANNED OUTAGE	2/4/2023 9:05	715.70	2
Breaker	PLANNED OUTAGE	2/4/2023 9:27	2,399.35	1021
TX Repaired (OH)	PLANNED OUTAGE	2/4/2023 17:19	7,025.20	42
PLF	PLANNED OUTAGE	2/4/2023 18:49	3,227.93	14
Breaker	PLANNED OUTAGE	2/6/2023 1:27	36,905.40	2727
Transformer	PLANNED OUTAGE	2/6/2023 8:31	107.87	4
PLF	PLANNED OUTAGE	2/6/2023 8:36	3,470.70	18
PLF	PLANNED OUTAGE	2/6/2023 8:37	8,141.00	42
Transformer	PLANNED OUTAGE	2/6/2023 9:09	368.20	7
Transformer	PLANNED OUTAGE	2/6/2023 9:42	1,364.00	8
Transformer	PLANNED OUTAGE	2/6/2023 9:42	309.55	3
Transformer	PLANNED OUTAGE	2/6/2023 10:23	396.43	7
Transformer	PLANNED OUTAGE	2/6/2023 10:37	291.17	5
Transformer	PLANNED OUTAGE	2/6/2023 11:24	791.23	14
Transformer	PLANNED OUTAGE	2/6/2023 11:32	1,954.33	4
Primary Wire	PLANNED OUTAGE	2/6/2023 12:15	3,663.17	10
Transformer	PLANNED OUTAGE	2/6/2023 13:08	535.97	14
Transformer	PLANNED OUTAGE	2/6/2023 16:09	493.33	5
PLF	PLANNED OUTAGE	2/6/2023 17:02	580.05	9
PLF	PLANNED OUTAGE	2/7/2023 8:53	20,229.00	66
PLF	PLANNED OUTAGE	2/7/2023 8:54	13,211.03	43

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2/7/2023 9:03	10,292.05	43
PLF	PLANNED OUTAGE	2/7/2023 9:07	159.52	1
Transformer	PLANNED OUTAGE	2/7/2023 9:25	396.92	5
Transformer	PLANNED OUTAGE	2/7/2023 9:41	1,123.85	7
Transformer	PLANNED OUTAGE	2/7/2023 10:26	269.85	7
Switch	PLANNED OUTAGE	2/7/2023 10:55	5,269.18	11
PLF	PLANNED OUTAGE	2/7/2023 10:57	2,759.50	6
Transformer	PLANNED OUTAGE	2/7/2023 11:00	328.22	1
Transformer	PLANNED OUTAGE	2/7/2023 11:31	2,577.20	8
PLF	PLANNED OUTAGE	2/7/2023 12:23	5,721.30	13
Transformer Bank	PLANNED OUTAGE	2/7/2023 16:50	290.00	3
PLF	PLANNED OUTAGE	2/7/2023 19:58	3,266.10	9
Breaker	PLANNED OUTAGE	2/8/2023 6:20	3,325.88	463
PLF	PLANNED OUTAGE	2/8/2023 6:29	510.10	2
Transformer	PLANNED OUTAGE	2/8/2023 8:46	1,987.20	6
Transformer	PLANNED OUTAGE	2/8/2023 8:50	5,254.93	16
Transformer	PLANNED OUTAGE	2/8/2023 8:56	216.35	1
PLF	PLANNED OUTAGE	2/8/2023 9:27	3,910.20	19
PLF	PLANNED OUTAGE	2/8/2023 9:35	2,567.07	13
Transformer	PLANNED OUTAGE	2/8/2023 9:55	29.68	1
Transformer	PLANNED OUTAGE	2/8/2023 10:12	2,422.80	9
PLF	PLANNED OUTAGE	2/8/2023 10:33	48.10	1
Service point	PLANNED OUTAGE	2/8/2023 10:57	27.63	1
PLF	PLANNED OUTAGE	2/8/2023 10:59	12.90	1
Transformer	PLANNED OUTAGE	2/8/2023 11:16	92.43	1
Transformer	PLANNED OUTAGE	2/8/2023 12:03	176.30	2
Transformer	PLANNED OUTAGE	2/8/2023 12:03	71.18	1
Transformer	PLANNED OUTAGE	2/8/2023 12:22	81.08	1
Transformer	PLANNED OUTAGE	2/8/2023 12:51	73.20	4
Transformer	PLANNED OUTAGE	2/8/2023 19:11	136.50	5
Service point	PLANNED OUTAGE	2/8/2023 22:21	94.32	1
Transformer	PLANNED OUTAGE	2/9/2023 7:47	2,115.75	9
Transformer	PLANNED OUTAGE	2/9/2023 8:13	841.25	5
Transformer	PLANNED OUTAGE	2/9/2023 8:13	1,696.80	8
Transformer	PLANNED OUTAGE	2/9/2023 8:35	1,337.00	15
PLF	PLANNED OUTAGE	2/9/2023 9:21	166.13	1
PLF	PLANNED OUTAGE	2/9/2023 9:34	5,756.30	33
PLF	PLANNED OUTAGE	2/9/2023 9:35	1,386.93	8
Transformer	PLANNED OUTAGE	2/9/2023 10:37	53.98	1
Transformer	PLANNED OUTAGE	2/9/2023 10:43	11.25	9
Transformer Bank	PLANNED OUTAGE	2/9/2023 10:48	71.77	1
PLF	PLANNED OUTAGE	2/9/2023 12:07	91.12	1
Transformer	PLANNED OUTAGE	2/9/2023 12:20	5.87	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	2/9/2023 12:57	338.15	3
Transformer	PLANNED OUTAGE	2/9/2023 12:59	136.62	1
Transformer	PLANNED OUTAGE	2/9/2023 13:18	168.98	1
Transformer	PLANNED OUTAGE	2/9/2023 23:15	2,843.63	14
Switch	PLANNED OUTAGE	2/9/2023 23:22	3,885.70	61
Transformer Bank	PLANNED OUTAGE	2/10/2023 9:13	576.30	9
Switch	PLANNED OUTAGE	2/10/2023 9:24	161.33	8
PLF	PLANNED OUTAGE	2/10/2023 9:37	101.18	1
Transformer	PLANNED OUTAGE	2/10/2023 10:04	241.63	1
PLF	PLANNED OUTAGE	2/10/2023 11:06	55.43	1
Transformer	PLANNED OUTAGE	2/10/2023 11:11	55.10	2
Transformer	PLANNED OUTAGE	2/10/2023 13:33	7.68	1
Switch	PLANNED OUTAGE	2/11/2023 1:35	903.80	12
Transformer	PLANNED OUTAGE	2/11/2023 3:51	3,761.87	8
Transformer	PLANNED OUTAGE	2/11/2023 3:51	2,257.58	5
Transformer	PLANNED OUTAGE	2/11/2023 3:52	2,701.70	6
Transformer	PLANNED OUTAGE	2/11/2023 3:57	1,973.07	16
Breaker	PLANNED OUTAGE	2/11/2023 4:39	15,987.90	822
Breaker	PLANNED OUTAGE	2/11/2023 4:39	12,699.60	684
PLF	PLANNED OUTAGE	2/11/2023 8:43	479.97	1
Transformer Bank	PLANNED OUTAGE	2/11/2023 16:43	89.40	2
Switch	PLANNED OUTAGE	2/11/2023 17:14	3,302.00	20
Breaker	PLANNED OUTAGE	2/11/2023 19:27	15.90	3
Breaker	PLANNED OUTAGE	2/11/2023 19:27	5.10	1
Transformer	PLANNED OUTAGE	2/12/2023 3:45	24.15	7
Transformer Bank	PLANNED OUTAGE	2/12/2023 3:51	2,370.33	5
Transformer	PLANNED OUTAGE	2/12/2023 9:22	530.20	6
Switch	PLANNED OUTAGE	2/12/2023 10:10	13,728.00	1430
Transformer	PLANNED OUTAGE	2/12/2023 11:03	176.67	8
Transformer Bank	PLANNED OUTAGE	2/12/2023 11:47	7.77	2
Transformer	PLANNED OUTAGE	2/12/2023 14:02	24.00	3
Transformer	PLANNED OUTAGE	2/12/2023 14:12	489.27	2
Transformer	PLANNED OUTAGE	2/12/2023 17:16	247.80	7
Transformer	PLANNED OUTAGE	2/12/2023 19:21	53.08	5
Transformer	PLANNED OUTAGE	2/12/2023 20:04	189.58	7
Breaker	PLANNED OUTAGE	2/12/2023 21:04	900.58	535
PLF	PLANNED OUTAGE	2/13/2023 0:14	204.53	1
Service point	PLANNED OUTAGE	2/13/2023 0:44	43.18	1
Transformer	PLANNED OUTAGE	2/13/2023 2:59	283.50	2
Transformer	PLANNED OUTAGE	2/13/2023 8:23	144.18	1
Transformer	PLANNED OUTAGE	2/13/2023 8:42	750.50	10
PLF	PLANNED OUTAGE	2/13/2023 9:00	656.27	92
Transformer	PLANNED OUTAGE	2/13/2023 9:46	1,050.80	6

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/13/2023 9:46	1,610.55	9
PLF	PLANNED OUTAGE	2/13/2023 11:00	252.57	2
Transformer	PLANNED OUTAGE	2/13/2023 11:06	1,780.50	10
Primary Wire	PLANNED OUTAGE	2/13/2023 12:04	997.05	9
Switch	PLANNED OUTAGE	2/13/2023 12:24	92.20	1
Service point	PLANNED OUTAGE	2/13/2023 13:13	78.08	1
Switch	PLANNED OUTAGE	2/13/2023 13:25	607.40	12
Switch	PLANNED OUTAGE	2/13/2023 13:43	189.55	3
Service point	PLANNED OUTAGE	2/13/2023 14:38	16.12	1
Transformer	PLANNED OUTAGE	2/13/2023 15:24	126.87	11
PLF	PLANNED OUTAGE	2/13/2023 16:42	582.45	3
PLF	PLANNED OUTAGE	2/13/2023 17:14	1,027.83	10
PLF	PLANNED OUTAGE	2/13/2023 17:50	303.13	1
PLF	PLANNED OUTAGE	2/13/2023 17:50	606.17	2
Transformer	PLANNED OUTAGE	2/13/2023 17:55	13.40	3
Transformer	PLANNED OUTAGE	2/14/2023 4:08	384.15	3
Transformer	PLANNED OUTAGE	2/14/2023 8:10	406.58	7
Service point	PLANNED OUTAGE	2/14/2023 8:16	47.63	1
Transformer	PLANNED OUTAGE	2/14/2023 8:32	103.35	1
Transformer	PLANNED OUTAGE	2/14/2023 9:09	1,188.30	9
PLF	PLANNED OUTAGE	2/14/2023 9:11	40.78	1
Switch	PLANNED OUTAGE	2/14/2023 9:14	507.60	8
Transformer	PLANNED OUTAGE	2/14/2023 9:15	178.85	1
Transformer	PLANNED OUTAGE	2/14/2023 9:22	358.53	4
Transformer	PLANNED OUTAGE	2/14/2023 9:39	70.05	1
Transformer	PLANNED OUTAGE	2/14/2023 10:24	64.40	3
Switch	PLANNED OUTAGE	2/14/2023 10:54	979.95	9
Switch	PLANNED OUTAGE	2/14/2023 11:10	462.83	5
Transformer	PLANNED OUTAGE	2/14/2023 11:46	1,322.87	4
Transformer	PLANNED OUTAGE	2/14/2023 12:17	4.68	1
Transformer	PLANNED OUTAGE	2/14/2023 12:38	138.20	1
Transformer	PLANNED OUTAGE	2/14/2023 12:46	1,191.00	9
Transformer	PLANNED OUTAGE	2/14/2023 13:25	54.63	2
Transformer	PLANNED OUTAGE	2/14/2023 13:28	108.13	8
Switch	PLANNED OUTAGE	2/14/2023 13:33	61.60	44
PLF	PLANNED OUTAGE	2/14/2023 13:37	144.80	4
Transformer	PLANNED OUTAGE	2/14/2023 17:35	215.40	4
Switch	PLANNED OUTAGE	2/14/2023 22:59	117.90	2
Transformer	PLANNED OUTAGE	2/15/2023 8:20	977.90	6
Transformer	PLANNED OUTAGE	2/15/2023 8:21	1,290.27	8
Transformer	PLANNED OUTAGE	2/15/2023 8:58	236.73	4
PLF	PLANNED OUTAGE	2/15/2023 9:01	1,402.40	8
Switch	PLANNED OUTAGE	2/15/2023 9:03	1,293.97	11

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	2/15/2023 9:06	292.37	1
Transformer	PLANNED OUTAGE	2/15/2023 9:21	1,607.33	10
PLF	PLANNED OUTAGE	2/15/2023 9:36	582.37	2
PLF	PLANNED OUTAGE	2/15/2023 10:08	7,489.20	72
Transformer	PLANNED OUTAGE	2/15/2023 10:09	452.20	3
Transformer	PLANNED OUTAGE	2/15/2023 11:16	136.07	1
Transformer	PLANNED OUTAGE	2/15/2023 11:16	135.78	1
Transformer	PLANNED OUTAGE	2/15/2023 13:16	164.80	6
Transformer	PLANNED OUTAGE	2/15/2023 13:29	421.80	6
Transformer Bank	PLANNED OUTAGE	2/15/2023 17:51	114.80	6
Transformer Bank	PLANNED OUTAGE	2/16/2023 5:44	472.87	4
Switch	PLANNED OUTAGE	2/16/2023 7:41	45,322.57	661
Switch	PLANNED OUTAGE	2/16/2023 8:39	131.47	2
Transformer	PLANNED OUTAGE	2/16/2023 8:52	3,873.13	13
Transformer	PLANNED OUTAGE	2/16/2023 8:58	1,096.93	8
Transformer	PLANNED OUTAGE	2/16/2023 9:00	102.10	3
PLF	PLANNED OUTAGE	2/16/2023 9:31	352.90	3
PLF	PLANNED OUTAGE	2/16/2023 9:33	12,820.83	50
PLF	PLANNED OUTAGE	2/16/2023 9:38	3,766.97	26
PLF	PLANNED OUTAGE	2/16/2023 9:38	5,212.80	36
PLF	PLANNED OUTAGE	2/16/2023 9:38	1,448.67	10
PLF	PLANNED OUTAGE	2/16/2023 10:18	7,457.10	63
PLF	PLANNED OUTAGE	2/16/2023 10:19	172.67	1
Service point	PLANNED OUTAGE	2/16/2023 11:43	32.28	1
PLF	PLANNED OUTAGE	2/16/2023 14:01	1,931.70	47
Transformer Bank	PLANNED OUTAGE	2/16/2023 20:25	166.80	3
Transformer	PLANNED OUTAGE	2/17/2023 1:20	292.50	15
PLF	PLANNED OUTAGE	2/17/2023 8:36	1,000.77	7
Transformer	PLANNED OUTAGE	2/17/2023 8:43	841.28	7
PLF	PLANNED OUTAGE	2/17/2023 8:44	193.95	1
Transformer Bank	PLANNED OUTAGE	2/17/2023 8:49	26.45	1
Transformer	PLANNED OUTAGE	2/17/2023 16:34	1,167.27	4
Transformer	PLANNED OUTAGE	2/17/2023 18:47	175.20	12
Switch	PLANNED OUTAGE	2/17/2023 20:10	141.60	3
Breaker	PLANNED OUTAGE	2/17/2023 21:00	3.03	1
Breaker	PLANNED OUTAGE	2/17/2023 21:00	9.20	3
Transformer	PLANNED OUTAGE	2/18/2023 9:20	86.80	8
Transformer	PLANNED OUTAGE	2/18/2023 23:56	573.45	9
PLF	PLANNED OUTAGE	2/19/2023 7:18	183.17	1
Transformer	PLANNED OUTAGE	2/19/2023 7:55	348.07	2
Transformer	PLANNED OUTAGE	2/19/2023 7:57	171.65	1
Transformer Bank	PLANNED OUTAGE	2/19/2023 14:55	328.87	1
Transformer	PLANNED OUTAGE	2/19/2023 17:25	236.93	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/19/2023 19:46	135.60	9
Transformer	PLANNED OUTAGE	2/19/2023 20:17	205.90	6
PLF	PLANNED OUTAGE	2/19/2023 20:24	502.47	4
Transformer	PLANNED OUTAGE	2/20/2023 9:03	1,260.40	12
Transformer	PLANNED OUTAGE	2/20/2023 9:05	708.33	4
PLF	PLANNED OUTAGE	2/20/2023 9:10	269.47	1
Transformer	PLANNED OUTAGE	2/20/2023 9:13	974.00	4
Transformer	PLANNED OUTAGE	2/20/2023 9:21	318.33	1
Transformer	PLANNED OUTAGE	2/20/2023 10:51	1,160.17	10
Transformer	PLANNED OUTAGE	2/20/2023 11:06	1,216.80	13
Transformer	PLANNED OUTAGE	2/20/2023 11:09	7,559.17	25
Transformer	PLANNED OUTAGE	2/20/2023 11:21	5,346.40	16
Transformer	PLANNED OUTAGE	2/20/2023 11:46	902.42	7
Transformer	PLANNED OUTAGE	2/20/2023 13:07	297.05	13
Transformer	PLANNED OUTAGE	2/20/2023 13:44	110.85	3
Transformer	PLANNED OUTAGE	2/20/2023 14:50	269.60	8
Transformer Bank	PLANNED OUTAGE	2/20/2023 17:00	259.13	2
Transformer	PLANNED OUTAGE	2/21/2023 8:41	56.05	1
PLF	PLANNED OUTAGE	2/21/2023 9:07	376.13	8
PLF	PLANNED OUTAGE	2/21/2023 9:33	229.60	1
PLF	PLANNED OUTAGE	2/21/2023 9:43	10,766.00	42
PLF	PLANNED OUTAGE	2/21/2023 9:50	547.20	3
PLF	PLANNED OUTAGE	2/21/2023 10:00	219.47	1
PLF	PLANNED OUTAGE	2/21/2023 11:26	6,445.60	42
Transformer	PLANNED OUTAGE	2/21/2023 13:04	634.93	8
Transformer	PLANNED OUTAGE	2/21/2023 13:06	418.80	3
Transformer	PLANNED OUTAGE	2/21/2023 14:12	44.65	1
PLF	PLANNED OUTAGE	2/21/2023 14:17	230.53	2
Recloser	PLANNED OUTAGE	2/21/2023 15:04	3,080.73	44
Recloser	PLANNED OUTAGE	2/21/2023 15:04	3,080.73	44
PLF	PLANNED OUTAGE	2/21/2023 17:40	1,134.47	13
Transformer	PLANNED OUTAGE	2/21/2023 17:56	112.17	2
OH Other	PLANNED OUTAGE	2/21/2023 18:10	71.92	5
Transformer	PLANNED OUTAGE	2/21/2023 18:14	389.50	30
Transformer	PLANNED OUTAGE	2/22/2023 1:57	1,550.63	11
Circuit Out	PLANNED OUTAGE	2/22/2023 5:40	4,342.13	857
Transformer	PLANNED OUTAGE	2/22/2023 8:32	273.30	3
Transformer Bank	PLANNED OUTAGE	2/22/2023 8:49	9,682.33	20
Transformer Bank	PLANNED OUTAGE	2/22/2023 8:50	4,849.00	10
Transformer	PLANNED OUTAGE	2/22/2023 9:19	1,766.70	18
Transformer	PLANNED OUTAGE	2/22/2023 9:59	374.73	11
Transformer	PLANNED OUTAGE	2/22/2023 10:29	204.70	3
Transformer	PLANNED OUTAGE	2/22/2023 11:21	851.25	5

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	2/22/2023 11:40	112.13	1
Transformer	PLANNED OUTAGE	2/22/2023 12:38	216.20	4
Transformer Bank	PLANNED OUTAGE	2/22/2023 12:50	73.23	2
Transformer	PLANNED OUTAGE	2/22/2023 13:04	305.25	3
Transformer	PLANNED OUTAGE	2/22/2023 14:01	400.67	8
Transformer	PLANNED OUTAGE	2/22/2023 14:26	349.92	5
Transformer	PLANNED OUTAGE	2/22/2023 14:29	32.63	2
Transformer	PLANNED OUTAGE	2/22/2023 15:51	440.92	1
Breaker	PLANNED OUTAGE	2/22/2023 18:13	34.57	34
PLF	PLANNED OUTAGE	2/22/2023 19:18	682.10	2
Primary Wire	PLANNED OUTAGE	2/22/2023 19:18	1,027.70	3
OH Other	PLANNED OUTAGE	2/22/2023 19:37	147.57	19
Breaker	PLANNED OUTAGE	2/22/2023 22:05	2,129.60	16
PLF	PLANNED OUTAGE	2/23/2023 6:57	1,353.60	12
PLF	PLANNED OUTAGE	2/23/2023 8:50	1,426.95	27
PLF	PLANNED OUTAGE	2/23/2023 8:50	5,535.20	33
Transformer	PLANNED OUTAGE	2/23/2023 8:51	1,097.27	4
Transformer	PLANNED OUTAGE	2/23/2023 8:54	496.33	10
PLF	PLANNED OUTAGE	2/23/2023 9:22	7,588.17	55
Transformer	PLANNED OUTAGE	2/23/2023 9:27	1,905.07	8
PLF	PLANNED OUTAGE	2/23/2023 9:53	1,582.53	44
PLF	PLANNED OUTAGE	2/23/2023 9:53	1,184.80	24
Transformer	PLANNED OUTAGE	2/23/2023 10:08	29.18	1
Transformer	PLANNED OUTAGE	2/23/2023 10:11	506.35	3
Service point	PLANNED OUTAGE	2/23/2023 10:13	97.33	1
Transformer	PLANNED OUTAGE	2/23/2023 11:06	106.17	5
PLF	PLANNED OUTAGE	2/23/2023 11:13	931.95	19
Transformer	PLANNED OUTAGE	2/23/2023 11:30	202.05	9
Transformer	PLANNED OUTAGE	2/23/2023 11:33	38.10	2
Switch	PLANNED OUTAGE	2/23/2023 11:34	12.40	1
Switch	PLANNED OUTAGE	2/23/2023 11:34	68.58	5
PLF	PLANNED OUTAGE	2/23/2023 12:07	990.27	8
PLF	PLANNED OUTAGE	2/23/2023 12:07	750.60	6
Transformer	PLANNED OUTAGE	2/23/2023 12:13	1,530.13	8
Primary Wire	PLANNED OUTAGE	2/23/2023 12:36	569.30	6
Transformer	PLANNED OUTAGE	2/23/2023 13:17	68.50	5
Transformer	PLANNED OUTAGE	2/23/2023 13:24	85.25	1
Transformer	PLANNED OUTAGE	2/23/2023 14:40	148.68	11
PLF	PLANNED OUTAGE	2/23/2023 15:00	2.48	1
PLF	PLANNED OUTAGE	2/23/2023 19:56	253.67	5
PLF	PLANNED OUTAGE	2/24/2023 0:24	277.37	1
Switch	PLANNED OUTAGE	2/24/2023 1:20	325.33	2
Switch	PLANNED OUTAGE	2/24/2023 9:18	585.25	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (PM)	PLANNED OUTAGE	2/24/2023 9:38	560.67	10
Transformer Bank	PLANNED OUTAGE	2/24/2023 11:10	135.85	3
Transformer	PLANNED OUTAGE	2/24/2023 12:06	844.62	11
PLF	PLANNED OUTAGE	2/24/2023 19:58	461.10	3
Transformer Bank	PLANNED OUTAGE	2/25/2023 8:39	522.78	1
Switch	PLANNED OUTAGE	2/25/2023 12:53	3,095.73	13
Transformer Bank	PLANNED OUTAGE	2/25/2023 17:24	61.82	1
Transformer Bank	PLANNED OUTAGE	2/25/2023 19:08	183.15	1
PLF	PLANNED OUTAGE	2/26/2023 8:24	3,827.55	17
Transformer	PLANNED OUTAGE	2/26/2023 12:37	54.30	1
Transformer Bank	PLANNED OUTAGE	2/26/2023 18:35	63.28	1
Transformer	PLANNED OUTAGE	2/27/2023 8:22	181.30	7
Transformer	PLANNED OUTAGE	2/27/2023 8:56	619.50	7
Transformer	PLANNED OUTAGE	2/27/2023 9:21	418.25	7
PLF	PLANNED OUTAGE	2/27/2023 9:38	65.63	1
Transformer	PLANNED OUTAGE	2/27/2023 10:01	479.38	7
Transformer	PLANNED OUTAGE	2/27/2023 10:04	115.93	2
Transformer	PLANNED OUTAGE	2/27/2023 10:07	399.47	8
Transformer	PLANNED OUTAGE	2/27/2023 10:27	17.03	2
Transformer	PLANNED OUTAGE	2/27/2023 10:29	800.80	8
Transformer	PLANNED OUTAGE	2/27/2023 10:30	758.40	9
Service point	PLANNED OUTAGE	2/27/2023 10:39	67.10	1
Transformer	PLANNED OUTAGE	2/27/2023 10:42	1,478.17	10
Transformer	PLANNED OUTAGE	2/27/2023 11:35	292.80	8
Breaker	PLANNED OUTAGE	2/27/2023 11:43	53.20	1
Transformer	PLANNED OUTAGE	2/27/2023 12:40	350.93	4
Transformer	PLANNED OUTAGE	2/27/2023 12:41	449.60	8
Transformer	PLANNED OUTAGE	2/27/2023 12:58	274.15	3
Transformer	PLANNED OUTAGE	2/27/2023 13:27	25.60	1
Service point	PLANNED OUTAGE	2/27/2023 14:36	71.07	1
PLF	PLANNED OUTAGE	2/27/2023 16:32	849.53	2
Service point	PLANNED OUTAGE	2/27/2023 17:13	92.28	1
PLF	PLANNED OUTAGE	2/28/2023 0:52	26.78	1
PLF	PLANNED OUTAGE	2/28/2023 1:53	244.75	1
Transformer	PLANNED OUTAGE	2/28/2023 2:03	53.67	4
Transformer	PLANNED OUTAGE	2/28/2023 7:50	78.90	6
Transformer	PLANNED OUTAGE	2/28/2023 8:36	259.50	5
Transformer	PLANNED OUTAGE	2/28/2023 8:43	309.00	5
Transformer	PLANNED OUTAGE	2/28/2023 8:46	178.93	2
Transformer	PLANNED OUTAGE	2/28/2023 11:04	165.30	6
PLF	PLANNED OUTAGE	2/28/2023 11:31	7.62	1
Transformer	PLANNED OUTAGE	2/28/2023 12:17	857.33	4
Transformer	PLANNED OUTAGE	2/28/2023 12:51	483.80	6

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Primary Wire	PLANNED OUTAGE	2/28/2023 14:25	25.30	6
Breaker	PLANNED OUTAGE	2/28/2023 14:25	3,170.93	752
Service point	PLANNED OUTAGE	2/28/2023 16:47	62.30	1
Transformer	PLANNED OUTAGE	2/28/2023 22:25	365.20	12
Transformer	PLANNED OUTAGE	3/1/2023 0:06	93.60	6
Primary Wire	PLANNED OUTAGE	3/1/2023 6:28	1,955.25	3
Transformer	PLANNED OUTAGE	3/1/2023 9:06	1,640.75	5
PLF	PLANNED OUTAGE	3/1/2023 9:51	196.20	1
Transformer	PLANNED OUTAGE	3/1/2023 10:22	1,366.57	11
PLF	PLANNED OUTAGE	3/1/2023 10:40	2,696.83	55
Transformer	PLANNED OUTAGE	3/1/2023 11:15	435.03	2
PLF	PLANNED OUTAGE	3/1/2023 11:29	4,098.13	16
Transformer	PLANNED OUTAGE	3/1/2023 11:45	346.27	7
Transformer	PLANNED OUTAGE	3/1/2023 11:48	774.33	5
Transformer	PLANNED OUTAGE	3/1/2023 16:19	78.80	1
Transformer	PLANNED OUTAGE	3/1/2023 20:11	3,725.40	9
PLF	PLANNED OUTAGE	3/2/2023 8:08	4,807.00	114
Transformer	PLANNED OUTAGE	3/2/2023 8:38	237.63	1
Service point	PLANNED OUTAGE	3/2/2023 8:54	67.50	1
Switch	PLANNED OUTAGE	3/2/2023 9:17	76.53	2
Transformer	PLANNED OUTAGE	3/2/2023 9:23	1.30	1
PLF	PLANNED OUTAGE	3/2/2023 9:54	1,035.55	3
Switch	PLANNED OUTAGE	3/2/2023 9:57	63.00	2
PLF	PLANNED OUTAGE	3/2/2023 10:03	3,939.07	31
Transformer	PLANNED OUTAGE	3/2/2023 10:14	1,319.92	5
Transformer	PLANNED OUTAGE	3/2/2023 10:26	767.90	7
Transformer	PLANNED OUTAGE	3/2/2023 10:38	81.60	4
Transformer	PLANNED OUTAGE	3/2/2023 10:39	143.60	8
PLF	PLANNED OUTAGE	3/2/2023 10:57	16.65	3
Transformer	PLANNED OUTAGE	3/2/2023 10:57	9.20	6
Switch	PLANNED OUTAGE	3/2/2023 10:57	182.60	6
Switch	PLANNED OUTAGE	3/2/2023 11:29	455.47	4
Recloser	PLANNED OUTAGE	3/2/2023 11:35	3.17	1
Recloser	PLANNED OUTAGE	3/2/2023 11:35	3.25	1
Recloser	PLANNED OUTAGE	3/2/2023 11:35	6.23	2
Recloser	PLANNED OUTAGE	3/2/2023 11:35	3.12	1
Recloser	PLANNED OUTAGE	3/2/2023 11:35	3,599.75	1155
Recloser	PLANNED OUTAGE	3/2/2023 11:35	3.93	1
Recloser	PLANNED OUTAGE	3/2/2023 11:35	3.05	1
Switch	PLANNED OUTAGE	3/2/2023 11:45	5.18	1
Switch	PLANNED OUTAGE	3/2/2023 11:53	53.63	2
Transformer	PLANNED OUTAGE	3/2/2023 12:27	686.30	6
Switch	PLANNED OUTAGE	3/2/2023 12:30	104.25	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	3/2/2023 13:24	1.00	1
Switch	PLANNED OUTAGE	3/2/2023 13:29	19.32	1
Switch	PLANNED OUTAGE	3/2/2023 13:45	169.53	4
Switch	PLANNED OUTAGE	3/2/2023 13:49	41.73	1
Transformer	PLANNED OUTAGE	3/3/2023 9:08	1,086.17	5
Transformer	PLANNED OUTAGE	3/3/2023 9:43	1,644.90	9
PLF	PLANNED OUTAGE	3/3/2023 9:57	11.73	2
PLF	PLANNED OUTAGE	3/3/2023 12:28	601.52	17
PLF	PLANNED OUTAGE	3/3/2023 12:47	2,240.25	45
PLF	PLANNED OUTAGE	3/3/2023 12:47	2,538.95	87
Transformer	PLANNED OUTAGE	3/3/2023 13:05	476.00	3
Transformer	PLANNED OUTAGE	3/3/2023 13:15	154.33	2
Breaker	PLANNED OUTAGE	3/3/2023 13:53	19,735.80	762
Breaker	PLANNED OUTAGE	3/3/2023 14:14	25,276.88	1687
PLF	PLANNED OUTAGE	3/3/2023 15:26	147.30	9
PLF	PLANNED OUTAGE	3/3/2023 19:48	753.55	7
Breaker	PLANNED OUTAGE	3/3/2023 19:51	1,819.77	709
PLF	PLANNED OUTAGE	3/3/2023 19:54	3,982.25	255
Recloser	PLANNED OUTAGE	3/3/2023 20:00	1,501.50	455
Recloser	PLANNED OUTAGE	3/3/2023 20:00	4.55	1
Recloser	PLANNED OUTAGE	3/3/2023 20:00	4.60	1
Transformer	PLANNED OUTAGE	3/3/2023 20:51	144.20	7
Breaker	PLANNED OUTAGE	3/3/2023 21:00	40.50	1
Breaker	PLANNED OUTAGE	3/3/2023 21:01	121.20	3
Breaker	PLANNED OUTAGE	3/3/2023 22:37	1,427.20	446
PLF	PLANNED OUTAGE	3/4/2023 1:02	146.30	7
Switch	PLANNED OUTAGE	3/4/2023 6:06	9,676.00	16
Switch	PLANNED OUTAGE	3/4/2023 7:49	449.30	2
Transformer	PLANNED OUTAGE	3/4/2023 11:07	191.10	9
Transformer	PLANNED OUTAGE	3/4/2023 15:05	87.15	1
Transformer	PLANNED OUTAGE	3/4/2023 16:13	114.70	6
Transformer	PLANNED OUTAGE	3/4/2023 16:32	42.35	7
Breaker	PLANNED OUTAGE	3/5/2023 4:15	86,647.87	172
Breaker	PLANNED OUTAGE	3/5/2023 4:15	231,731.50	1155
PLF	PLANNED OUTAGE	3/5/2023 7:08	577.20	2
Recloser	PLANNED OUTAGE	3/5/2023 11:49	10.73	1
Recloser	PLANNED OUTAGE	3/5/2023 11:49	11.23	1
Switch	PLANNED OUTAGE	3/5/2023 11:49	4,785.08	455
PLF	PLANNED OUTAGE	3/5/2023 12:56	454.40	12
PLF	PLANNED OUTAGE	3/5/2023 13:27	27.93	2
PLF	PLANNED OUTAGE	3/5/2023 16:37	46.30	3
PLF	PLANNED OUTAGE	3/6/2023 8:13	6,252.00	24
PLF	PLANNED OUTAGE	3/6/2023 8:20	17,236.80	63

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/6/2023 8:21	140.67	1
Transformer	PLANNED OUTAGE	3/6/2023 9:29	48.73	1
Transformer	PLANNED OUTAGE	3/6/2023 9:34	1,705.43	7
PLF	PLANNED OUTAGE	3/6/2023 10:07	287.08	1
Transformer	PLANNED OUTAGE	3/6/2023 10:25	7.35	3
Transformer	PLANNED OUTAGE	3/6/2023 11:02	578.13	16
Transformer	PLANNED OUTAGE	3/6/2023 11:44	950.47	4
Transformer	PLANNED OUTAGE	3/6/2023 11:49	32.00	6
Transformer	PLANNED OUTAGE	3/6/2023 11:59	546.30	6
Transformer	PLANNED OUTAGE	3/6/2023 12:09	160.20	3
Transformer Bank	PLANNED OUTAGE	3/6/2023 13:21	46.90	2
Transformer	PLANNED OUTAGE	3/6/2023 14:34	74.43	2
Transformer Bank	PLANNED OUTAGE	3/6/2023 15:16	48.23	2
Service point	PLANNED OUTAGE	3/6/2023 15:35	63.57	1
Transformer	PLANNED OUTAGE	3/6/2023 17:42	100.73	2
Switch	PLANNED OUTAGE	3/6/2023 19:39	4,077.53	62
Transformer	PLANNED OUTAGE	3/7/2023 8:57	1,178.75	5
PLF	PLANNED OUTAGE	3/7/2023 9:59	588.03	13
Transformer	PLANNED OUTAGE	3/7/2023 10:56	603.90	2
Transformer	PLANNED OUTAGE	3/7/2023 11:52	396.93	4
Transformer	PLANNED OUTAGE	3/7/2023 11:57	46.70	6
Transformer	PLANNED OUTAGE	3/7/2023 12:02	186.43	2
PLF	PLANNED OUTAGE	3/7/2023 12:02	80.00	30
Switch	PLANNED OUTAGE	3/7/2023 12:04	295.83	5
Transformer	PLANNED OUTAGE	3/7/2023 12:18	38.40	2
Transformer	PLANNED OUTAGE	3/7/2023 13:42	48.00	8
Transformer	PLANNED OUTAGE	3/7/2023 17:18	346.05	9
Primary Wire	PLANNED OUTAGE	3/8/2023 8:33	637.80	9
Transformer	PLANNED OUTAGE	3/8/2023 8:41	3,139.50	9
Transformer	PLANNED OUTAGE	3/8/2023 9:39	5,624.73	28
PLF	PLANNED OUTAGE	3/8/2023 9:51	23.37	1
PLF	PLANNED OUTAGE	3/8/2023 9:51	17.33	1
Transformer Bank	PLANNED OUTAGE	3/8/2023 9:52	1,698.60	6
Switch	PLANNED OUTAGE	3/8/2023 11:03	105.13	1
Transformer	PLANNED OUTAGE	3/8/2023 11:45	849.20	4
Service point	PLANNED OUTAGE	3/8/2023 12:25	10.78	1
PLF	PLANNED OUTAGE	3/8/2023 13:55	285.60	8
PLF	PLANNED OUTAGE	3/8/2023 13:59	168.33	5
Transformer	PLANNED OUTAGE	3/8/2023 14:00	65.57	2
Transformer	PLANNED OUTAGE	3/8/2023 18:38	359.92	7
Breaker	PLANNED OUTAGE	3/8/2023 19:33	6,059.73	1472
PLF	PLANNED OUTAGE	3/8/2023 21:59	8,001.00	20
Transformer	PLANNED OUTAGE	3/8/2023 22:02	107.45	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	3/9/2023 5:51	5,668.33	475
Transformer	PLANNED OUTAGE	3/9/2023 8:32	109.10	2
Transformer	PLANNED OUTAGE	3/9/2023 8:43	451.33	5
Transformer	PLANNED OUTAGE	3/9/2023 9:14	402.40	6
PLF	PLANNED OUTAGE	3/9/2023 11:16	193.98	1
PLF	PLANNED OUTAGE	3/9/2023 11:16	121.00	2
Breaker	PLANNED OUTAGE	3/9/2023 11:35	6,418.32	143
Transformer Bank	PLANNED OUTAGE	3/9/2023 12:33	1,391.17	10
PLF	PLANNED OUTAGE	3/9/2023 13:29	231.35	7
PLF	PLANNED OUTAGE	3/9/2023 14:26	110.22	1
Breaker	PLANNED OUTAGE	3/9/2023 14:32	3,245.47	808
Transformer	PLANNED OUTAGE	3/9/2023 14:47	258.30	6
PLF	PLANNED OUTAGE	3/9/2023 17:08	559.13	2
Transformer Bank	PLANNED OUTAGE	3/9/2023 17:34	15.93	1
PLF	PLANNED OUTAGE	3/9/2023 20:49	338.07	1
Transformer	PLANNED OUTAGE	3/9/2023 22:29	516.83	7
Transformer	PLANNED OUTAGE	3/10/2023 8:10	60.75	1
Switch	PLANNED OUTAGE	3/10/2023 9:50	554.50	10
Transformer	PLANNED OUTAGE	3/10/2023 10:00	746.58	5
Transformer	PLANNED OUTAGE	3/10/2023 10:59	193.60	16
Transformer	PLANNED OUTAGE	3/10/2023 13:36	87.25	5
Breaker	PLANNED OUTAGE	3/10/2023 13:48	6,084.87	1652
Transformer	PLANNED OUTAGE	3/10/2023 17:10	80.08	5
Breaker	PLANNED OUTAGE	3/10/2023 19:36	3,161.30	939
PLF	PLANNED OUTAGE	3/11/2023 0:06	2,944.50	18
PLF	PLANNED OUTAGE	3/11/2023 1:24	332.00	15
PLF	PLANNED OUTAGE	3/11/2023 3:34	143.62	1
PLF	PLANNED OUTAGE	3/11/2023 8:37	156.55	1
PLF	PLANNED OUTAGE	3/11/2023 8:38	155.78	1
Switch	PLANNED OUTAGE	3/11/2023 9:15	182.10	1
PLF	PLANNED OUTAGE	3/11/2023 16:42	171.90	2
PLF	PLANNED OUTAGE	3/11/2023 17:56	57.80	2
PLF	PLANNED OUTAGE	3/12/2023 19:49	566.10	74
PLF	PLANNED OUTAGE	3/12/2023 21:14	273.17	2
Transformer	PLANNED OUTAGE	3/13/2023 9:06	261.20	4
Transformer	PLANNED OUTAGE	3/13/2023 9:26	453.33	4
PLF	PLANNED OUTAGE	3/13/2023 9:49	44.43	2
Primary Wire	PLANNED OUTAGE	3/13/2023 9:55	92.20	1
Switch	PLANNED OUTAGE	3/13/2023 11:03	85.80	3
Transformer	PLANNED OUTAGE	3/13/2023 12:21	682.50	7
Transformer	PLANNED OUTAGE	3/13/2023 12:24	563.33	8
Service point	PLANNED OUTAGE	3/13/2023 14:41	43.95	1
Switch	PLANNED OUTAGE	3/13/2023 16:22	41.37	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	3/13/2023 17:57	704.30	3
Switch	PLANNED OUTAGE	3/13/2023 17:57	5,403.08	23
Transformer	PLANNED OUTAGE	3/13/2023 19:04	83.33	4
Transformer	PLANNED OUTAGE	3/13/2023 19:18	3,839.50	10
Service point	PLANNED OUTAGE	3/13/2023 21:54	21.28	1
Service point	PLANNED OUTAGE	3/13/2023 21:54	39.65	1
Transformer	PLANNED OUTAGE	3/13/2023 21:54	140.93	7
Service point	PLANNED OUTAGE	3/13/2023 21:54	22.20	1
Transformer	PLANNED OUTAGE	3/13/2023 23:44	53.47	1
Transformer	PLANNED OUTAGE	3/14/2023 7:39	533.40	7
Transformer	PLANNED OUTAGE	3/14/2023 7:46	197.30	1
Transformer	PLANNED OUTAGE	3/14/2023 8:31	351.00	3
Transformer	PLANNED OUTAGE	3/14/2023 8:37	466.67	5
Transformer	PLANNED OUTAGE	3/14/2023 8:42	227.83	1
Transformer	PLANNED OUTAGE	3/14/2023 8:54	56.95	17
Transformer	PLANNED OUTAGE	3/14/2023 8:54	1,958.12	17
Transformer	PLANNED OUTAGE	3/14/2023 8:57	2,488.73	14
Transformer	PLANNED OUTAGE	3/14/2023 9:13	519.63	7
PLF	PLANNED OUTAGE	3/14/2023 9:19	365.33	16
PLF	PLANNED OUTAGE	3/14/2023 9:19	2,113.53	14
PLF	PLANNED OUTAGE	3/14/2023 9:19	2,385.33	16
Switch	PLANNED OUTAGE	3/14/2023 9:32	443.70	1
Switch	PLANNED OUTAGE	3/14/2023 9:32	443.53	1
Transformer	PLANNED OUTAGE	3/14/2023 10:33	148.30	1
Transformer Bank	PLANNED OUTAGE	3/14/2023 10:38	288.93	4
Transformer	PLANNED OUTAGE	3/14/2023 12:40	61.57	1
Transformer	PLANNED OUTAGE	3/14/2023 13:15	331.92	7
Transformer	PLANNED OUTAGE	3/14/2023 13:56	120.50	2
Transformer	PLANNED OUTAGE	3/14/2023 15:42	956.00	6
Transformer	PLANNED OUTAGE	3/14/2023 17:15	204.63	2
Transformer	PLANNED OUTAGE	3/14/2023 17:21	18.87	1
Transformer	PLANNED OUTAGE	3/14/2023 17:21	18.18	1
PLF	PLANNED OUTAGE	3/14/2023 17:31	156.08	1
Breaker	PLANNED OUTAGE	3/15/2023 0:54	6,075.00	1500
Breaker	PLANNED OUTAGE	3/15/2023 7:47	675.75	477
Transformer	PLANNED OUTAGE	3/15/2023 9:08	587.87	8
Transformer	PLANNED OUTAGE	3/15/2023 9:41	277.45	1
Transformer	PLANNED OUTAGE	3/15/2023 10:03	25.32	1
PLF	PLANNED OUTAGE	3/15/2023 10:05	491.90	2
Transformer	PLANNED OUTAGE	3/15/2023 10:44	882.35	7
Transformer	PLANNED OUTAGE	3/15/2023 10:58	142.33	10
Transformer	PLANNED OUTAGE	3/15/2023 11:05	504.60	2
Transformer	PLANNED OUTAGE	3/15/2023 11:40	494.05	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	3/15/2023 12:04	376.40	4
Transformer	PLANNED OUTAGE	3/15/2023 12:42	390.35	3
Transformer	PLANNED OUTAGE	3/15/2023 13:14	285.73	4
Transformer	PLANNED OUTAGE	3/15/2023 13:24	704.83	10
Transformer	PLANNED OUTAGE	3/15/2023 13:40	54.52	1
Transformer	PLANNED OUTAGE	3/15/2023 14:15	1,670.50	10
Transformer	PLANNED OUTAGE	3/15/2023 14:16	721.23	11
Transformer Bank	PLANNED OUTAGE	3/16/2023 4:11	450.33	7
Transformer	PLANNED OUTAGE	3/16/2023 8:34	767.00	3
Transformer	PLANNED OUTAGE	3/16/2023 9:05	335.60	2
Transformer	PLANNED OUTAGE	3/16/2023 9:21	525.80	6
Transformer	PLANNED OUTAGE	3/16/2023 9:59	823.00	6
Transformer Bank	PLANNED OUTAGE	3/16/2023 10:17	256.80	3
Transformer	PLANNED OUTAGE	3/16/2023 10:18	473.20	4
Transformer	PLANNED OUTAGE	3/16/2023 10:19	231.97	2
Switch	PLANNED OUTAGE	3/16/2023 10:46	280.67	1
Transformer	PLANNED OUTAGE	3/16/2023 10:58	1,497.60	8
Transformer	PLANNED OUTAGE	3/16/2023 11:24	473.07	8
Transformer	PLANNED OUTAGE	3/16/2023 11:34	358.25	5
Transformer	PLANNED OUTAGE	3/16/2023 13:02	266.17	5
Transformer	PLANNED OUTAGE	3/16/2023 14:10	164.40	6
Transformer	PLANNED OUTAGE	3/16/2023 14:19	243.08	5
Transformer	PLANNED OUTAGE	3/16/2023 14:50	42.37	2
Transformer Bank	PLANNED OUTAGE	3/16/2023 16:43	216.40	1
Transformer	PLANNED OUTAGE	3/16/2023 17:34	52.10	6
Switch	PLANNED OUTAGE	3/16/2023 20:20	833.98	11
Transformer	PLANNED OUTAGE	3/16/2023 23:27	254.67	4
Transformer	PLANNED OUTAGE	3/17/2023 8:12	320.60	6
PLF	PLANNED OUTAGE	3/17/2023 8:42	143.55	1
Transformer	PLANNED OUTAGE	3/17/2023 9:40	487.30	6
Transformer	PLANNED OUTAGE	3/17/2023 9:43	536.25	9
Transformer	PLANNED OUTAGE	3/17/2023 9:45	2,967.60	12
Switch	PLANNED OUTAGE	3/17/2023 10:16	228.13	8
Transformer	PLANNED OUTAGE	3/17/2023 10:49	118.43	2
Transformer	PLANNED OUTAGE	3/17/2023 10:50	149.33	8
Transformer	PLANNED OUTAGE	3/17/2023 12:16	169.27	4
Switch	PLANNED OUTAGE	3/18/2023 7:33	130.47	1
Switch	PLANNED OUTAGE	3/18/2023 7:33	130.47	1
Breaker	PLANNED OUTAGE	3/18/2023 19:50	2,291.40	1206
PLF	PLANNED OUTAGE	3/19/2023 8:56	1,074.50	105
Transformer	PLANNED OUTAGE	3/19/2023 9:22	1,210.55	33
Transformer	PLANNED OUTAGE	3/19/2023 22:11	846.83	10
PLF	PLANNED OUTAGE	3/20/2023 8:11	53.87	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/20/2023 8:29	540.80	3
Transformer	PLANNED OUTAGE	3/20/2023 8:53	335.38	1
Transformer	PLANNED OUTAGE	3/20/2023 8:53	1,103.78	7
Transformer	PLANNED OUTAGE	3/20/2023 8:53	697.75	3
Transformer	PLANNED OUTAGE	3/20/2023 8:58	303.90	6
Transformer	PLANNED OUTAGE	3/20/2023 9:26	88.17	2
Service point	PLANNED OUTAGE	3/20/2023 10:06	40.12	1
PLF	PLANNED OUTAGE	3/20/2023 10:06	38.87	1
PLF	PLANNED OUTAGE	3/20/2023 10:19	271.53	1
Transformer	PLANNED OUTAGE	3/20/2023 10:20	932.45	17
Transformer	PLANNED OUTAGE	3/20/2023 10:27	542.33	10
PLF	PLANNED OUTAGE	3/20/2023 10:53	76.23	2
Transformer	PLANNED OUTAGE	3/20/2023 13:36	442.40	8
Switch	PLANNED OUTAGE	3/20/2023 14:34	39.77	1
Transformer	PLANNED OUTAGE	3/20/2023 14:34	44.18	1
Switch	PLANNED OUTAGE	3/20/2023 14:34	78.13	2
Service point	PLANNED OUTAGE	3/20/2023 16:19	59.72	1
Switch	PLANNED OUTAGE	3/20/2023 16:46	228.30	6
Breaker	PLANNED OUTAGE	3/21/2023 3:42	6,580.70	474
Transformer	PLANNED OUTAGE	3/21/2023 8:19	363.90	3
Transformer	PLANNED OUTAGE	3/21/2023 8:32	461.93	4
Transformer	PLANNED OUTAGE	3/21/2023 8:39	191.40	18
Transformer	PLANNED OUTAGE	3/21/2023 8:58	238.77	1
Transformer	PLANNED OUTAGE	3/21/2023 9:02	583.20	9
Transformer	PLANNED OUTAGE	3/21/2023 9:06	1,222.70	6
Transformer	PLANNED OUTAGE	3/21/2023 9:17	909.60	12
Transformer	PLANNED OUTAGE	3/21/2023 9:27	885.45	9
PLF	PLANNED OUTAGE	3/21/2023 9:29	188.17	2
PLF	PLANNED OUTAGE	3/21/2023 9:29	342.20	4
PLF	PLANNED OUTAGE	3/21/2023 9:29	93.97	1
Transformer	PLANNED OUTAGE	3/21/2023 9:31	486.20	3
PLF	PLANNED OUTAGE	3/21/2023 9:33	135.02	1
Switch	PLANNED OUTAGE	3/21/2023 9:38	82.13	2
Transformer	PLANNED OUTAGE	3/21/2023 9:51	843.10	6
Transformer	PLANNED OUTAGE	3/21/2023 10:39	214.80	8
Transformer	PLANNED OUTAGE	3/21/2023 11:05	215.85	3
PLF	PLANNED OUTAGE	3/21/2023 11:08	269.47	2
Transformer	PLANNED OUTAGE	3/21/2023 11:44	1,522.65	9
Transformer	PLANNED OUTAGE	3/21/2023 11:51	93.50	1
Switch	PLANNED OUTAGE	3/21/2023 12:43	234.80	6
Transformer	PLANNED OUTAGE	3/21/2023 13:13	1,325.60	16
Transformer	PLANNED OUTAGE	3/21/2023 13:55	222.00	18
PLF	PLANNED OUTAGE	3/21/2023 20:15	9,363.25	43

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	3/21/2023 20:18	260.13	8
Switch	PLANNED OUTAGE	3/22/2023 7:42	622.98	1
Transformer Bank	PLANNED OUTAGE	3/22/2023 7:49	509.47	1
Transformer	PLANNED OUTAGE	3/22/2023 8:52	1,238.88	7
PLF	PLANNED OUTAGE	3/22/2023 9:04	187.77	2
Transformer	PLANNED OUTAGE	3/22/2023 9:16	455.00	5
Switch	PLANNED OUTAGE	3/22/2023 9:27	10,068.93	52
Switch	PLANNED OUTAGE	3/22/2023 9:28	192.85	1
Transformer Bank	PLANNED OUTAGE	3/22/2023 9:34	447.30	3
Transformer	PLANNED OUTAGE	3/22/2023 11:47	573.20	8
Transformer	PLANNED OUTAGE	3/22/2023 12:07	53.68	1
Transformer	PLANNED OUTAGE	3/22/2023 12:37	1,095.80	2
Switch	PLANNED OUTAGE	3/22/2023 13:09	210.53	8
Switch	PLANNED OUTAGE	3/22/2023 13:47	2,113.32	37
Switch	PLANNED OUTAGE	3/22/2023 14:03	178.80	6
Transformer Bank	PLANNED OUTAGE	3/22/2023 15:01	1,098.15	9
Transformer	PLANNED OUTAGE	3/23/2023 8:20	1,145.90	6
Transformer	PLANNED OUTAGE	3/23/2023 9:31	445.20	6
Transformer	PLANNED OUTAGE	3/23/2023 9:37	198.02	1
PLF	PLANNED OUTAGE	3/23/2023 10:06	77.15	1
Transformer	PLANNED OUTAGE	3/23/2023 10:48	207.33	1
Transformer Bank	PLANNED OUTAGE	3/23/2023 11:00	203.60	4
PLF	PLANNED OUTAGE	3/23/2023 11:11	268.33	2
Switch	PLANNED OUTAGE	3/23/2023 11:51	325.43	13
Transformer	PLANNED OUTAGE	3/23/2023 12:02	20.90	3
Transformer	PLANNED OUTAGE	3/23/2023 21:23	126.80	8
Transformer	PLANNED OUTAGE	3/24/2023 0:26	53.77	1
Switch	PLANNED OUTAGE	3/24/2023 1:18	144.40	1
Switch	PLANNED OUTAGE	3/24/2023 8:33	135.50	1
Transformer	PLANNED OUTAGE	3/24/2023 8:35	15.97	1
Transformer	PLANNED OUTAGE	3/24/2023 8:45	1,007.60	3
Transformer	PLANNED OUTAGE	3/24/2023 19:34	144.13	8
Transformer	PLANNED OUTAGE	3/24/2023 22:00	98.33	5
Switch	PLANNED OUTAGE	3/25/2023 6:30	31,255.00	665
Switch	PLANNED OUTAGE	3/25/2023 7:31	21.82	1
Switch	PLANNED OUTAGE	3/25/2023 7:31	21.82	1
PLF	PLANNED OUTAGE	3/25/2023 10:57	231.60	4
PLF	PLANNED OUTAGE	3/25/2023 14:35	1,390.13	8
Transformer Bank	PLANNED OUTAGE	3/25/2023 16:05	199.82	19
PLF	PLANNED OUTAGE	3/25/2023 18:09	517.73	8
Switch	PLANNED OUTAGE	3/25/2023 20:08	426.00	8
PLF	PLANNED OUTAGE	3/25/2023 20:42	361.60	8
Switch	PLANNED OUTAGE	3/26/2023 10:19	188.00	5

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/26/2023 14:12	262.20	9
Transformer	PLANNED OUTAGE	3/26/2023 15:14	101.43	2
PLF	PLANNED OUTAGE	3/27/2023 8:22	49.47	2
Transformer	PLANNED OUTAGE	3/27/2023 9:17	553.95	27
Transformer	PLANNED OUTAGE	3/27/2023 9:40	252.00	1
Transformer	PLANNED OUTAGE	3/27/2023 9:41	347.60	4
PLF	PLANNED OUTAGE	3/27/2023 9:45	232.80	1
Service point	PLANNED OUTAGE	3/27/2023 10:22	248.30	1
Transformer	PLANNED OUTAGE	3/27/2023 11:08	56.15	1
Transformer	PLANNED OUTAGE	3/27/2023 12:17	149.32	1
Transformer	PLANNED OUTAGE	3/27/2023 12:42	597.50	6
Switch	PLANNED OUTAGE	3/27/2023 21:39	469.42	43
Switch	PLANNED OUTAGE	3/27/2023 21:50	456.80	4
Breaker	PLANNED OUTAGE	3/28/2023 7:38	1,964.60	418
Transformer	PLANNED OUTAGE	3/28/2023 8:19	385.30	6
PLF	PLANNED OUTAGE	3/28/2023 9:00	2,056.20	9
Transformer	PLANNED OUTAGE	3/28/2023 9:04	91.60	4
Switch	PLANNED OUTAGE	3/28/2023 9:46	2,409.87	16
PLF	PLANNED OUTAGE	3/28/2023 10:05	58.32	1
Transformer	PLANNED OUTAGE	3/28/2023 10:16	923.70	9
Transformer	PLANNED OUTAGE	3/28/2023 10:45	190.82	1
Transformer	PLANNED OUTAGE	3/28/2023 10:55	119.10	2
Transformer	PLANNED OUTAGE	3/28/2023 11:02	227.30	2
Switch	PLANNED OUTAGE	3/28/2023 11:08	350.35	7
Switch	PLANNED OUTAGE	3/28/2023 11:08	357.00	6
Transformer	PLANNED OUTAGE	3/28/2023 12:54	569.22	7
Transformer	PLANNED OUTAGE	3/28/2023 14:49	142.10	1
PLF	PLANNED OUTAGE	3/28/2023 15:46	3,780.00	108
Switch	PLANNED OUTAGE	3/28/2023 15:46	1,400.00	40
PLF	PLANNED OUTAGE	3/28/2023 15:46	6,440.00	184
PLF	PLANNED OUTAGE	3/28/2023 15:46	2,660.00	76
Transformer	PLANNED OUTAGE	3/28/2023 16:51	1,893.60	6
Transformer	PLANNED OUTAGE	3/28/2023 17:29	38.00	10
Transformer	PLANNED OUTAGE	3/28/2023 17:55	12.25	1
PLF	PLANNED OUTAGE	3/28/2023 18:55	21,421.17	122
Transformer	PLANNED OUTAGE	3/28/2023 19:01	131.30	6
PLF	PLANNED OUTAGE	3/29/2023 8:38	176.03	1
Transformer	PLANNED OUTAGE	3/29/2023 9:01	425.00	4
Transformer	PLANNED OUTAGE	3/29/2023 9:25	615.20	8
Transformer	PLANNED OUTAGE	3/29/2023 9:32	290.20	4
Transformer	PLANNED OUTAGE	3/29/2023 9:40	263.50	1
Transformer	PLANNED OUTAGE	3/29/2023 10:36	357.55	1
Transformer	PLANNED OUTAGE	3/29/2023 10:37	280.25	5

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	3/29/2023 10:48	1,128.85	3
PLF	PLANNED OUTAGE	3/29/2023 11:07	240.60	1
Transformer	PLANNED OUTAGE	3/29/2023 11:10	272.30	7
Transformer	PLANNED OUTAGE	3/29/2023 12:41	765.90	9
Switch	PLANNED OUTAGE	3/29/2023 12:51	770.33	10
Switch	PLANNED OUTAGE	3/29/2023 16:09	426.23	19
Switch	PLANNED OUTAGE	3/29/2023 16:09	969.60	6
Transformer	PLANNED OUTAGE	3/29/2023 17:11	754.93	16
Transformer	PLANNED OUTAGE	3/29/2023 18:59	122.27	4
PLF	PLANNED OUTAGE	3/30/2023 9:04	299.82	1
PLF	PLANNED OUTAGE	3/30/2023 13:28	90.00	3
Transformer	PLANNED OUTAGE	3/30/2023 17:17	142.92	1
Transformer	PLANNED OUTAGE	3/30/2023 21:35	2,343.17	10
Transformer	PLANNED OUTAGE	3/30/2023 21:57	225.33	8
Breaker	PLANNED OUTAGE	3/30/2023 22:15	9,058.40	1014
Recloser	PLANNED OUTAGE	3/30/2023 22:15	7,588.00	840
Recloser	PLANNED OUTAGE	3/30/2023 22:15	8.85	1
Transformer	PLANNED OUTAGE	3/31/2023 10:16	890.75	7
Transformer	PLANNED OUTAGE	3/31/2023 10:20	834.90	6
Transformer	PLANNED OUTAGE	3/31/2023 10:54	234.52	1
Transformer	PLANNED OUTAGE	3/31/2023 18:45	36.20	2
Transformer	PLANNED OUTAGE	3/31/2023 19:03	337.30	2
PLF	PLANNED OUTAGE	3/31/2023 20:37	2,245.95	27
PLF	PLANNED OUTAGE	4/1/2023 4:56	232.90	2
PLF	PLANNED OUTAGE	4/1/2023 14:13	967.80	3
Transformer	PLANNED OUTAGE	4/1/2023 18:58	213.80	6
Transformer	PLANNED OUTAGE	4/1/2023 19:09	127.20	8
PLF	PLANNED OUTAGE	4/1/2023 19:30	1,206.57	7
Transformer	PLANNED OUTAGE	4/1/2023 19:44	753.15	9
PLF	PLANNED OUTAGE	4/2/2023 11:57	30.60	2
Transformer	PLANNED OUTAGE	4/3/2023 8:36	182.10	3
PLF	PLANNED OUTAGE	4/3/2023 8:55	378.57	2
Transformer	PLANNED OUTAGE	4/3/2023 9:02	171.13	2
Transformer	PLANNED OUTAGE	4/3/2023 9:05	453.25	7
Transformer	PLANNED OUTAGE	4/3/2023 9:27	2,156.00	12
Transformer	PLANNED OUTAGE	4/3/2023 9:54	263.87	2
Transformer	PLANNED OUTAGE	4/3/2023 11:04	209.60	4
PLF	PLANNED OUTAGE	4/3/2023 11:11	350.15	3
Transformer	PLANNED OUTAGE	4/3/2023 12:06	726.83	7
Transformer	PLANNED OUTAGE	4/3/2023 12:08	971.50	10
Transformer	PLANNED OUTAGE	4/3/2023 12:20	45.50	10
Transformer	PLANNED OUTAGE	4/3/2023 13:36	517.88	7
Transformer	PLANNED OUTAGE	4/3/2023 13:41	394.67	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	4/3/2023 17:17	70.50	2
Switch	PLANNED OUTAGE	4/3/2023 17:21	541.60	6
PLF	PLANNED OUTAGE	4/3/2023 19:40	921.73	4
PLF	PLANNED OUTAGE	4/4/2023 7:43	71.38	1
Transformer	PLANNED OUTAGE	4/4/2023 8:40	360.55	3
Transformer	PLANNED OUTAGE	4/4/2023 8:44	420.67	8
Transformer	PLANNED OUTAGE	4/4/2023 9:03	189.75	3
Transformer	PLANNED OUTAGE	4/4/2023 9:22	1,186.80	9
Switch	PLANNED OUTAGE	4/4/2023 9:26	542.00	15
Transformer	PLANNED OUTAGE	4/4/2023 9:38	284.50	5
PLF	PLANNED OUTAGE	4/4/2023 9:54	8,838.32	497
PLF	PLANNED OUTAGE	4/4/2023 10:33	1,046.80	6
Switch	PLANNED OUTAGE	4/4/2023 11:14	270.20	7
Transformer	PLANNED OUTAGE	4/4/2023 11:32	341.50	5
Transformer	PLANNED OUTAGE	4/4/2023 14:20	323.95	33
Transformer	PLANNED OUTAGE	4/4/2023 16:01	375.90	9
Switch	PLANNED OUTAGE	4/4/2023 17:22	3,408.90	22
Transformer	PLANNED OUTAGE	4/4/2023 21:46	932.98	11
PLF	PLANNED OUTAGE	4/4/2023 22:54	2,327.07	62
Transformer	PLANNED OUTAGE	4/5/2023 8:33	474.80	6
Transformer	PLANNED OUTAGE	4/5/2023 8:38	1,390.32	17
Transformer	PLANNED OUTAGE	4/5/2023 8:55	300.07	2
Switch	PLANNED OUTAGE	4/5/2023 9:18	3,474.33	35
Transformer	PLANNED OUTAGE	4/5/2023 9:22	490.43	2
Transformer Bank	PLANNED OUTAGE	4/5/2023 9:36	346.58	1
Transformer	PLANNED OUTAGE	4/5/2023 9:37	264.80	4
Transformer	PLANNED OUTAGE	4/5/2023 11:02	156.90	2
Recloser	PLANNED OUTAGE	4/5/2023 11:22	991.60	24
Transformer	PLANNED OUTAGE	4/5/2023 12:23	1,341.17	13
Breaker	PLANNED OUTAGE	4/5/2023 13:49	15,963.17	142
Breaker	PLANNED OUTAGE	4/5/2023 13:52	1,827.35	681
Breaker	PLANNED OUTAGE	4/5/2023 13:52	2,967.25	415
Breaker	PLANNED OUTAGE	4/5/2023 13:52	106,497.35	1077
Breaker	PLANNED OUTAGE	4/5/2023 13:52	108,373.17	1030
Transformer	PLANNED OUTAGE	4/5/2023 14:48	568.37	17
Switch	PLANNED OUTAGE	4/5/2023 18:15	575.17	10
Transformer	PLANNED OUTAGE	4/5/2023 20:35	512.95	1
Switch	PLANNED OUTAGE	4/5/2023 22:33	4,614.47	19
Transformer	PLANNED OUTAGE	4/6/2023 9:28	327.50	5
Switch	PLANNED OUTAGE	4/6/2023 10:13	298.20	3
Transformer	PLANNED OUTAGE	4/6/2023 11:13	1,074.70	6
Transformer	PLANNED OUTAGE	4/6/2023 11:52	50.08	5
Switch	PLANNED OUTAGE	4/6/2023 12:23	233.80	4

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	4/6/2023 13:25	494.87	4
Switch	PLANNED OUTAGE	4/6/2023 19:51	280.17	5
PLF	PLANNED OUTAGE	4/7/2023 4:22	902.80	3
Transformer	PLANNED OUTAGE	4/7/2023 9:26	233.92	7
Breaker	PLANNED OUTAGE	4/7/2023 10:13	19,508.87	1438
Service point	PLANNED OUTAGE	4/7/2023 17:00	271.20	1
PLF	PLANNED OUTAGE	4/7/2023 23:20	675.35	39
Transformer	PLANNED OUTAGE	4/8/2023 1:22	440.67	10
PLF	PLANNED OUTAGE	4/8/2023 7:30	450.63	2
PLF	PLANNED OUTAGE	4/8/2023 7:30	31,995.60	156
PLF	PLANNED OUTAGE	4/8/2023 9:42	1,166.92	5
Transformer	PLANNED OUTAGE	4/8/2023 19:22	844.25	11
Recloser	PLANNED OUTAGE	4/9/2023 12:14	250.50	45
Recloser	PLANNED OUTAGE	4/9/2023 12:14	6.25	1
Switch	PLANNED OUTAGE	4/9/2023 17:19	285.75	5
Transformer	PLANNED OUTAGE	4/9/2023 20:13	389.37	2
Transformer	PLANNED OUTAGE	4/10/2023 9:05	11,270.25	27
Transformer	PLANNED OUTAGE	4/10/2023 9:44	133.68	13
Transformer	PLANNED OUTAGE	4/10/2023 10:10	307.25	5
Switch	PLANNED OUTAGE	4/10/2023 10:38	260.00	24
PLF	PLANNED OUTAGE	4/10/2023 10:47	427.87	2
PLF	PLANNED OUTAGE	4/10/2023 11:41	13.63	2
Transformer	PLANNED OUTAGE	4/10/2023 12:27	680.80	12
Breaker	PLANNED OUTAGE	4/10/2023 16:23	14,573.00	1770
Transformer	PLANNED OUTAGE	4/10/2023 17:36	94.65	9
Transformer	PLANNED OUTAGE	4/11/2023 1:24	105.40	6
Transformer	PLANNED OUTAGE	4/11/2023 8:17	670.10	3
Transformer	PLANNED OUTAGE	4/11/2023 8:20	279.50	5
Transformer	PLANNED OUTAGE	4/11/2023 8:38	264.87	1
Switch	PLANNED OUTAGE	4/11/2023 8:48	3,418.25	11
PLF	PLANNED OUTAGE	4/11/2023 9:01	4,412.00	10
PLF	PLANNED OUTAGE	4/11/2023 9:04	74.93	1
Transformer	PLANNED OUTAGE	4/11/2023 10:04	878.67	8
PLF	PLANNED OUTAGE	4/11/2023 10:08	91.98	1
Transformer	PLANNED OUTAGE	4/11/2023 10:39	434.28	1
Service point	PLANNED OUTAGE	4/11/2023 11:35	78.32	1
Service point	PLANNED OUTAGE	4/11/2023 11:35	1,240.53	16
Service point	PLANNED OUTAGE	4/11/2023 11:39	226.12	1
Transformer	PLANNED OUTAGE	4/11/2023 12:01	359.85	3
Transformer	PLANNED OUTAGE	4/11/2023 12:37	281.63	2
Breaker	PLANNED OUTAGE	4/11/2023 16:00	5,603.20	1751
Switch	PLANNED OUTAGE	4/11/2023 16:03	2,925.98	17
Transformer	PLANNED OUTAGE	4/11/2023 17:49	63.10	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	4/11/2023 21:05	391.70	6
Service point	PLANNED OUTAGE	4/12/2023 0:30	216.47	1
Service point	PLANNED OUTAGE	4/12/2023 0:30	217.32	1
Service point	PLANNED OUTAGE	4/12/2023 0:48	198.27	1
PLF	PLANNED OUTAGE	4/12/2023 3:01	118.92	1
PLF	PLANNED OUTAGE	4/12/2023 3:01	109.47	1
PLF	PLANNED OUTAGE	4/12/2023 3:27	444.58	5
PLF	PLANNED OUTAGE	4/12/2023 3:27	883.67	5
Service point	PLANNED OUTAGE	4/12/2023 8:20	476.17	1
Transformer	PLANNED OUTAGE	4/12/2023 8:35	4,978.23	22
PLF	PLANNED OUTAGE	4/12/2023 8:49	13,935.02	217
PLF	PLANNED OUTAGE	4/12/2023 9:27	408.30	2
Transformer	PLANNED OUTAGE	4/12/2023 9:52	706.18	7
Transformer	PLANNED OUTAGE	4/12/2023 9:52	82.83	5
Transformer	PLANNED OUTAGE	4/12/2023 9:52	2,613.10	6
Transformer	PLANNED OUTAGE	4/12/2023 9:53	408.90	6
Primary Wire	PLANNED OUTAGE	4/12/2023 10:18	541.07	4
Switch	PLANNED OUTAGE	4/12/2023 10:22	215.30	1
Transformer	PLANNED OUTAGE	4/12/2023 10:57	289.57	2
Transformer	PLANNED OUTAGE	4/12/2023 11:52	43.53	1
Transformer	PLANNED OUTAGE	4/12/2023 12:52	952.05	11
Transformer Bank	PLANNED OUTAGE	4/12/2023 13:15	58.85	3
Switch	PLANNED OUTAGE	4/12/2023 15:15	15,037.00	33
Transformer	PLANNED OUTAGE	4/12/2023 18:19	173.67	5
Breaker	PLANNED OUTAGE	4/12/2023 21:04	17,377.05	909
Transformer	PLANNED OUTAGE	4/12/2023 21:24	922.55	3
Switch	PLANNED OUTAGE	4/13/2023 0:25	40,987.92	329
Switch	PLANNED OUTAGE	4/13/2023 0:25	8,077.60	439
Transformer	PLANNED OUTAGE	4/13/2023 2:02	1,116.08	5
PLF	PLANNED OUTAGE	4/13/2023 2:05	1,107.00	5
PLF	PLANNED OUTAGE	4/13/2023 2:05	1,092.42	5
Transformer	PLANNED OUTAGE	4/13/2023 8:08	494.90	3
Transformer	PLANNED OUTAGE	4/13/2023 10:06	655.03	2
Transformer	PLANNED OUTAGE	4/13/2023 10:10	324.43	1
Transformer	PLANNED OUTAGE	4/13/2023 10:37	867.88	7
Transformer	PLANNED OUTAGE	4/13/2023 11:32	203.73	2
Transformer	PLANNED OUTAGE	4/13/2023 12:20	173.62	11
Transformer	PLANNED OUTAGE	4/13/2023 12:57	647.33	8
Recloser	PLANNED OUTAGE	4/13/2023 13:34	808.50	66
Recloser	PLANNED OUTAGE	4/13/2023 13:34	74.08	7
Recloser	PLANNED OUTAGE	4/13/2023 13:34	4,572.00	432
Service point	PLANNED OUTAGE	4/13/2023 15:03	43.25	1
Service point	PLANNED OUTAGE	4/13/2023 15:48	42.33	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Service point	PLANNED OUTAGE	4/13/2023 16:00	90.07	1
PLF	PLANNED OUTAGE	4/13/2023 16:04	6.83	1
PLF	PLANNED OUTAGE	4/13/2023 18:10	173.30	1
Transformer	PLANNED OUTAGE	4/13/2023 20:21	52.35	3
PLF	PLANNED OUTAGE	4/14/2023 2:59	12,972.42	17
PLF	PLANNED OUTAGE	4/14/2023 3:59	72.35	1
Recloser	PLANNED OUTAGE	4/14/2023 5:16	3,573.90	198
Transformer	PLANNED OUTAGE	4/14/2023 8:46	1,108.95	9
PLF	PLANNED OUTAGE	4/14/2023 11:12	507.20	48
Switch	PLANNED OUTAGE	4/14/2023 11:27	934.70	6
Transformer	PLANNED OUTAGE	4/14/2023 12:13	72.20	2
Transformer Bank	PLANNED OUTAGE	4/14/2023 12:55	106.38	1
Transformer	PLANNED OUTAGE	4/14/2023 13:54	112.20	4
Transformer	PLANNED OUTAGE	4/14/2023 15:51	134.40	8
Transformer	PLANNED OUTAGE	4/14/2023 18:09	1,236.53	4
Transformer	PLANNED OUTAGE	4/14/2023 19:57	597.67	5
Transformer	PLANNED OUTAGE	4/15/2023 7:05	626.40	8
Transformer	PLANNED OUTAGE	4/15/2023 8:23	987.87	8
PLF	PLANNED OUTAGE	4/15/2023 9:51	574.53	2
Breaker	PLANNED OUTAGE	4/15/2023 19:29	306.90	62
PLF	PLANNED OUTAGE	4/16/2023 7:06	5,011.00	10
Transformer	PLANNED OUTAGE	4/16/2023 17:51	153.50	2
Transformer	PLANNED OUTAGE	4/16/2023 21:58	404.62	11
Breaker	PLANNED OUTAGE	4/17/2023 0:07	2,818.33	1900
Breaker	PLANNED OUTAGE	4/17/2023 1:39	8,880.67	770
PLF	PLANNED OUTAGE	4/17/2023 9:31	155.60	12
Transformer Bank	PLANNED OUTAGE	4/17/2023 9:52	773.17	10
Breaker	PLANNED OUTAGE	4/17/2023 9:58	5,187.23	946
Breaker	PLANNED OUTAGE	4/17/2023 11:29	738.30	69
Breaker	PLANNED OUTAGE	4/17/2023 11:35	4.68	1
Breaker	PLANNED OUTAGE	4/17/2023 11:35	4.68	1
Breaker	PLANNED OUTAGE	4/17/2023 11:35	18.73	4
Breaker	PLANNED OUTAGE	4/17/2023 11:35	1,746.88	373
Breaker	PLANNED OUTAGE	4/17/2023 11:35	4.68	1
Primary Wire	PLANNED OUTAGE	4/17/2023 12:04	1,079.98	7
Breaker	PLANNED OUTAGE	4/17/2023 12:15	3,334.50	494
Transformer	PLANNED OUTAGE	4/17/2023 12:22	110.42	5
Breaker	PLANNED OUTAGE	4/17/2023 12:29	40,004.40	1224
Breaker	PLANNED OUTAGE	4/17/2023 12:29	6,637.05	63
Breaker	PLANNED OUTAGE	4/17/2023 12:29	64,855.00	1308
Breaker	PLANNED OUTAGE	4/17/2023 13:19	1,308.00	1308
Transformer Bank	PLANNED OUTAGE	4/17/2023 15:39	217.05	9
PLF	PLANNED OUTAGE	4/17/2023 17:32	5,858.48	31

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	4/17/2023 20:33	10.18	1
PLF	PLANNED OUTAGE	4/18/2023 8:20	5,409.50	30
PLF	PLANNED OUTAGE	4/18/2023 8:24	28,881.50	141
Transformer	PLANNED OUTAGE	4/18/2023 8:42	434.00	6
Switch	PLANNED OUTAGE	4/18/2023 9:15	120.10	2
Switch	PLANNED OUTAGE	4/18/2023 9:36	731.87	8
PLF	PLANNED OUTAGE	4/18/2023 10:09	1,510.17	13
Transformer	PLANNED OUTAGE	4/18/2023 10:43	598.75	5
Transformer	PLANNED OUTAGE	4/18/2023 13:53	498.80	3
Transformer	PLANNED OUTAGE	4/18/2023 13:59	102.20	7
Breaker	PLANNED OUTAGE	4/18/2023 15:05	65,287.47	1552
PLF	PLANNED OUTAGE	4/18/2023 17:59	3,848.25	21
Transformer	PLANNED OUTAGE	4/18/2023 20:02	294.20	12
Transformer	PLANNED OUTAGE	4/19/2023 8:20	857.55	9
PLF	PLANNED OUTAGE	4/19/2023 9:11	697.33	10
Primary Wire	PLANNED OUTAGE	4/19/2023 9:15	7,620.00	24
Transformer	PLANNED OUTAGE	4/19/2023 10:21	337.75	7
Transformer	PLANNED OUTAGE	4/19/2023 11:57	551.02	7
Transformer	PLANNED OUTAGE	4/19/2023 12:01	337.78	13
Transformer	PLANNED OUTAGE	4/19/2023 16:31	253.20	9
Primary Wire	PLANNED OUTAGE	4/20/2023 8:35	163.82	1
PLF	PLANNED OUTAGE	4/20/2023 8:46	112.67	26
PLF	PLANNED OUTAGE	4/20/2023 9:02	9,840.13	26
Switch	PLANNED OUTAGE	4/20/2023 9:47	227.73	1
Switch	PLANNED OUTAGE	4/20/2023 9:47	216.25	1
Transformer	PLANNED OUTAGE	4/20/2023 18:37	56.20	2
Transformer	PLANNED OUTAGE	4/20/2023 19:18	377.25	9
Service point	PLANNED OUTAGE	4/20/2023 19:22	17.33	1
Transformer	PLANNED OUTAGE	4/20/2023 20:56	1,385.50	10
Transformer	PLANNED OUTAGE	4/21/2023 1:13	342.90	9
Transformer	PLANNED OUTAGE	4/21/2023 8:26	286.33	4
PLF	PLANNED OUTAGE	4/21/2023 9:14	96.50	5
Transformer Bank	PLANNED OUTAGE	4/21/2023 9:19	2,546.00	19
Service point	PLANNED OUTAGE	4/21/2023 9:19	134.05	1
PLF	PLANNED OUTAGE	4/21/2023 9:24	141.33	10
Transformer	PLANNED OUTAGE	4/21/2023 16:16	118.75	1
Transformer	PLANNED OUTAGE	4/21/2023 18:49	21.75	5
Transformer	PLANNED OUTAGE	4/22/2023 6:11	1,769.00	10
PLF	PLANNED OUTAGE	4/22/2023 8:26	339.75	1
PLF	PLANNED OUTAGE	4/22/2023 8:33	394.80	1
PLF	PLANNED OUTAGE	4/22/2023 8:41	72.65	1
PLF	PLANNED OUTAGE	4/23/2023 7:14	852.32	1
Service point	PLANNED OUTAGE	4/23/2023 22:35	38.37	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	4/24/2023 8:37	152.97	2
Transformer	PLANNED OUTAGE	4/24/2023 8:39	27.87	11
Transformer	PLANNED OUTAGE	4/24/2023 8:54	519.53	4
Transformer	PLANNED OUTAGE	4/24/2023 10:08	250.35	9
Transformer	PLANNED OUTAGE	4/24/2023 10:32	100.00	4
Transformer	PLANNED OUTAGE	4/24/2023 12:01	571.80	6
Transformer	PLANNED OUTAGE	4/24/2023 12:29	302.33	2
Transformer	PLANNED OUTAGE	4/24/2023 14:22	34.47	4
Breaker	PLANNED OUTAGE	4/24/2023 17:14	7,099.20	348
Breaker	PLANNED OUTAGE	4/24/2023 17:14	5,742.17	263
PLF	PLANNED OUTAGE	4/24/2023 18:24	751.20	3
Transformer Bank	PLANNED OUTAGE	4/24/2023 19:11	24.85	1
Transformer	PLANNED OUTAGE	4/24/2023 20:07	178.80	8
Breaker	PLANNED OUTAGE	4/24/2023 21:12	3,496.35	1793
PLF	PLANNED OUTAGE	4/24/2023 22:21	20.47	1
Switch	PLANNED OUTAGE	4/25/2023 7:28	414.43	1
Switch	PLANNED OUTAGE	4/25/2023 7:29	414.33	1
Transformer	PLANNED OUTAGE	4/25/2023 8:28	2,253.20	8
Transformer	PLANNED OUTAGE	4/25/2023 9:20	391.75	5
Transformer	PLANNED OUTAGE	4/25/2023 9:26	148.10	2
Primary Wire	PLANNED OUTAGE	4/25/2023 9:50	2,245.33	10
PLF	PLANNED OUTAGE	4/25/2023 9:57	116.65	3
Transformer	PLANNED OUTAGE	4/25/2023 10:10	315.12	7
Transformer	PLANNED OUTAGE	4/25/2023 10:41	1.00	1
Transformer	PLANNED OUTAGE	4/25/2023 10:46	82.95	3
Recloser	PLANNED OUTAGE	4/25/2023 10:53	1,822.83	10
PLF	PLANNED OUTAGE	4/25/2023 11:28	201.48	1
Transformer	PLANNED OUTAGE	4/25/2023 11:42	337.90	6
Transformer	PLANNED OUTAGE	4/25/2023 12:02	336.73	2
Transformer Bank	PLANNED OUTAGE	4/25/2023 12:18	50.78	1
Transformer	PLANNED OUTAGE	4/25/2023 12:32	340.33	4
Transformer	PLANNED OUTAGE	4/25/2023 13:45	726.73	1
Transformer	PLANNED OUTAGE	4/25/2023 13:45	737.07	1
Transformer	PLANNED OUTAGE	4/25/2023 13:59	884.40	11
Switch	PLANNED OUTAGE	4/25/2023 13:59	451.92	11
Transformer	PLANNED OUTAGE	4/25/2023 14:45	34.45	3
Breaker	PLANNED OUTAGE	4/25/2023 21:37	8,383.67	140
Breaker	PLANNED OUTAGE	4/25/2023 21:37	8,074.15	357
Breaker	PLANNED OUTAGE	4/25/2023 21:37	158.93	4
Breaker	PLANNED OUTAGE	4/25/2023 21:37	51,684.97	154
Breaker	PLANNED OUTAGE	4/25/2023 21:37	335.62	1
Transformer Bank	PLANNED OUTAGE	4/25/2023 23:10	450.10	7
Transformer	PLANNED OUTAGE	4/25/2023 23:18	502.93	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Service point	PLANNED OUTAGE	4/26/2023 1:50	109.37	1
Transformer	PLANNED OUTAGE	4/26/2023 7:06	178.92	1
Transformer	PLANNED OUTAGE	4/26/2023 8:13	315.52	1
Transformer	PLANNED OUTAGE	4/26/2023 8:37	586.08	5
Primary Wire	PLANNED OUTAGE	4/26/2023 8:45	13,027.40	318
Transformer	PLANNED OUTAGE	4/26/2023 9:09	256.50	9
Transformer	PLANNED OUTAGE	4/26/2023 9:23	236.72	1
Recloser	PLANNED OUTAGE	4/26/2023 9:35	3,754.83	10
Service point	PLANNED OUTAGE	4/26/2023 9:51	18.07	1
Transformer	PLANNED OUTAGE	4/26/2023 11:12	478.00	6
Transformer	PLANNED OUTAGE	4/26/2023 11:34	438.27	4
Transformer	PLANNED OUTAGE	4/26/2023 11:50	1,021.87	4
Transformer	PLANNED OUTAGE	4/26/2023 14:52	121.73	8
OH Other	PLANNED OUTAGE	4/26/2023 16:31	95.67	1
OH Other	PLANNED OUTAGE	4/26/2023 16:31	75,985.80	794
PLF	PLANNED OUTAGE	4/26/2023 17:42	202.35	9
Breaker	PLANNED OUTAGE	4/26/2023 20:22	1,551.25	17
Breaker	PLANNED OUTAGE	4/26/2023 20:22	49,424.27	1378
Breaker	PLANNED OUTAGE	4/26/2023 20:22	20,076.32	631
PLF	PLANNED OUTAGE	4/26/2023 21:05	456.87	1
Breaker	PLANNED OUTAGE	4/26/2023 21:16	16,061.65	627
Breaker	PLANNED OUTAGE	4/26/2023 21:16	5,338.67	80
Breaker	PLANNED OUTAGE	4/26/2023 21:48	22,279.40	627
Switch	PLANNED OUTAGE	4/26/2023 23:21	476.90	6
Service point	PLANNED OUTAGE	4/27/2023 0:30	221.35	1
Transformer	PLANNED OUTAGE	4/27/2023 7:58	332.10	2
Switch	PLANNED OUTAGE	4/27/2023 9:29	11,400.33	92
Switch	PLANNED OUTAGE	4/27/2023 9:58	517.07	8
Transformer	PLANNED OUTAGE	4/27/2023 9:59	443.33	8
Switch	PLANNED OUTAGE	4/27/2023 10:06	306.48	7
Transformer	PLANNED OUTAGE	4/27/2023 10:11	82.40	3
Transformer	PLANNED OUTAGE	4/27/2023 10:15	24.28	1
Transformer	PLANNED OUTAGE	4/27/2023 10:15	24.50	1
Transformer Bank	PLANNED OUTAGE	4/27/2023 10:34	319.20	3
Transformer	PLANNED OUTAGE	4/27/2023 10:50	1,428.40	12
Transformer	PLANNED OUTAGE	4/27/2023 10:55	244.65	3
Transformer Bank	PLANNED OUTAGE	4/27/2023 12:54	156.70	6
PLF	PLANNED OUTAGE	4/27/2023 13:34	683.60	8
Transformer	PLANNED OUTAGE	4/27/2023 13:36	206.93	4
Service point	PLANNED OUTAGE	4/27/2023 13:41	44.73	1
Transformer	PLANNED OUTAGE	4/27/2023 14:26	697.67	4
Transformer	PLANNED OUTAGE	4/27/2023 14:30	220.03	1
Transformer Bank	PLANNED OUTAGE	4/27/2023 16:13	1,337.85	9

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Service point	PLANNED OUTAGE	4/27/2023 16:17	151.37	1
Service point	PLANNED OUTAGE	4/27/2023 16:17	150.97	1
Switch	PLANNED OUTAGE	4/27/2023 16:28	1,106.93	4
Service point	PLANNED OUTAGE	4/27/2023 16:31	137.35	1
Breaker	PLANNED OUTAGE	4/27/2023 21:47	2,586.73	4
Breaker	PLANNED OUTAGE	4/27/2023 21:47	753,405.50	1165
Breaker	PLANNED OUTAGE	4/27/2023 22:32	40,294.67	752
Recloser	PLANNED OUTAGE	4/27/2023 23:30	2,611.20	8
PLF	PLANNED OUTAGE	4/28/2023 2:38	21,252.03	86
Breaker	PLANNED OUTAGE	4/28/2023 2:42	56,085.80	1453
Recloser	PLANNED OUTAGE	4/28/2023 2:57	2,727.03	46
Recloser	PLANNED OUTAGE	4/28/2023 4:09	21,127.00	571
Breaker	PLANNED OUTAGE	4/28/2023 4:38	1.75	1
Breaker	PLANNED OUTAGE	4/28/2023 4:38	4,023.50	3095
Breaker	PLANNED OUTAGE	4/28/2023 4:38	3,703.00	2116
Breaker	PLANNED OUTAGE	4/28/2023 4:38	1.62	1
Breaker	PLANNED OUTAGE	4/28/2023 6:17	15.92	1
Breaker	PLANNED OUTAGE	4/28/2023 6:17	15.85	1
Breaker	PLANNED OUTAGE	4/28/2023 6:17	15.88	1
Breaker	PLANNED OUTAGE	4/28/2023 6:17	9,396.00	1392
Transformer	PLANNED OUTAGE	4/28/2023 6:21	9,390.40	12
Breaker	PLANNED OUTAGE	4/28/2023 6:50	5,878.37	427
Breaker	PLANNED OUTAGE	4/28/2023 6:50	74.08	5
Breaker	PLANNED OUTAGE	4/28/2023 6:50	14.85	1
Transformer Bank	PLANNED OUTAGE	4/28/2023 7:33	36.85	1
PLF	PLANNED OUTAGE	4/28/2023 7:55	206.10	2
Transformer Bank	PLANNED OUTAGE	4/28/2023 8:50	36.73	2
Transformer	PLANNED OUTAGE	4/28/2023 9:24	59.63	1
PLF	PLANNED OUTAGE	4/28/2023 9:34	803.00	11
Transformer	PLANNED OUTAGE	4/28/2023 9:34	257.83	5
PLF	PLANNED OUTAGE	4/28/2023 9:35	105.30	2
PLF	PLANNED OUTAGE	4/28/2023 10:20	223.50	1
Breaker	PLANNED OUTAGE	4/28/2023 11:40	54,300.40	1763
Breaker	PLANNED OUTAGE	4/28/2023 11:40	31.57	1
PLF	PLANNED OUTAGE	4/28/2023 13:11	178.75	25
Transformer	PLANNED OUTAGE	4/28/2023 16:17	331.80	4
Transformer	PLANNED OUTAGE	4/28/2023 16:19	63.90	6
Transformer	PLANNED OUTAGE	4/28/2023 16:20	38.20	4
Transformer	PLANNED OUTAGE	4/28/2023 17:02	328.20	6
PLF	PLANNED OUTAGE	4/28/2023 17:39	513.00	6
Transformer	PLANNED OUTAGE	4/28/2023 18:13	389.20	6
Transformer	PLANNED OUTAGE	4/28/2023 20:37	266.67	10
Transformer	PLANNED OUTAGE	4/28/2023 23:16	71.57	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	4/29/2023 4:45	31.75	1
Service point	PLANNED OUTAGE	4/29/2023 9:05	24.52	1
Transformer	PLANNED OUTAGE	4/29/2023 13:00	2,380.67	5
PLF	PLANNED OUTAGE	4/29/2023 13:04	1,930.00	100
OH Other	PLANNED OUTAGE	4/29/2023 13:08	437.47	4
PLF	PLANNED OUTAGE	4/29/2023 14:22	235.50	5
OH Other	PLANNED OUTAGE	4/29/2023 14:57	449.60	12
Breaker	PLANNED OUTAGE	4/29/2023 15:26	7,819.42	911
PLF	PLANNED OUTAGE	4/29/2023 16:16	141.00	6
PLF	PLANNED OUTAGE	4/29/2023 17:05	108.40	12
Transformer	PLANNED OUTAGE	4/29/2023 17:17	37.50	5
Switch	PLANNED OUTAGE	4/29/2023 18:28	20,809.62	509
Switch	PLANNED OUTAGE	4/29/2023 18:28	668.20	2
Transformer	PLANNED OUTAGE	4/29/2023 18:36	1,018.05	9
Transformer	PLANNED OUTAGE	4/29/2023 19:43	414.00	9
Breaker	PLANNED OUTAGE	4/29/2023 19:44	20,443.55	1839
Transformer	PLANNED OUTAGE	4/29/2023 21:01	33.02	1
Transformer	PLANNED OUTAGE	4/29/2023 21:28	93.10	1
Transformer	PLANNED OUTAGE	4/29/2023 22:02	451.07	8
PLF	PLANNED OUTAGE	4/29/2023 22:58	588.23	2
Transformer	PLANNED OUTAGE	4/29/2023 23:12	580.80	8
Breaker	PLANNED OUTAGE	4/30/2023 6:31	4,361.00	294
Transformer	PLANNED OUTAGE	4/30/2023 9:54	389.00	4
Breaker	PLANNED OUTAGE	4/30/2023 10:40	14,321.87	2498
Breaker	PLANNED OUTAGE	4/30/2023 10:47	81.43	14
PLF	PLANNED OUTAGE	4/30/2023 11:20	209.43	1
Transformer	PLANNED OUTAGE	4/30/2023 11:24	148.78	1
PLF	PLANNED OUTAGE	4/30/2023 12:36	2,264.73	161
PLF	PLANNED OUTAGE	4/30/2023 13:45	229.95	7
Primary Wire	PLANNED OUTAGE	4/30/2023 14:02	4,183.67	22
Transformer	PLANNED OUTAGE	4/30/2023 15:50	49.17	5
Recloser	PLANNED OUTAGE	4/30/2023 16:24	1,164.57	46
Transformer	PLANNED OUTAGE	4/30/2023 20:29	167.17	5
PLF	PLANNED OUTAGE	5/1/2023 3:37	459.65	29
Service point	PLANNED OUTAGE	5/1/2023 5:20	40.15	1
Service point	PLANNED OUTAGE	5/1/2023 5:20	38.22	1
Transformer	PLANNED OUTAGE	5/1/2023 9:13	263.55	7
Switch	PLANNED OUTAGE	5/1/2023 10:39	1,066.20	4
Transformer	PLANNED OUTAGE	5/1/2023 11:10	305.55	1
Transformer	PLANNED OUTAGE	5/1/2023 11:14	53.20	12
Transformer	PLANNED OUTAGE	5/1/2023 11:27	157.00	1
Transformer	PLANNED OUTAGE	5/1/2023 12:07	620.60	6
PLF	PLANNED OUTAGE	5/1/2023 12:10	285.20	4

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/1/2023 12:14	136.57	2
PLF	PLANNED OUTAGE	5/1/2023 13:35	79.50	9
Transformer	PLANNED OUTAGE	5/1/2023 15:33	193.50	5
Transformer Bank	PLANNED OUTAGE	5/1/2023 17:48	2,893.00	15
PLF	PLANNED OUTAGE	5/2/2023 9:25	144.47	1
PLF	PLANNED OUTAGE	5/2/2023 9:39	463.00	4
Transformer	PLANNED OUTAGE	5/2/2023 9:44	105.33	2
Transformer	PLANNED OUTAGE	5/2/2023 10:23	1,801.62	11
Transformer	PLANNED OUTAGE	5/2/2023 11:17	168.25	5
PLF	PLANNED OUTAGE	5/2/2023 11:58	6.70	3
Transformer	PLANNED OUTAGE	5/2/2023 12:49	195.50	2
Transformer	PLANNED OUTAGE	5/2/2023 13:08	686.03	11
Transformer	PLANNED OUTAGE	5/2/2023 13:52	87.08	11
PLF	PLANNED OUTAGE	5/2/2023 17:59	118.60	1
Transformer	PLANNED OUTAGE	5/2/2023 21:13	54.45	3
Transformer	PLANNED OUTAGE	5/2/2023 23:15	206.60	4
Transformer Bank	PLANNED OUTAGE	5/3/2023 6:51	194.73	1
Transformer	PLANNED OUTAGE	5/3/2023 8:44	565.02	7
PLF	PLANNED OUTAGE	5/3/2023 8:55	203.67	4
PLF	PLANNED OUTAGE	5/3/2023 9:20	1,255.73	8
Transformer	PLANNED OUTAGE	5/3/2023 9:46	224.87	4
Transformer	PLANNED OUTAGE	5/3/2023 10:20	647.05	3
Switch	PLANNED OUTAGE	5/3/2023 10:40	151.20	6
Transformer	PLANNED OUTAGE	5/3/2023 10:41	410.53	2
Transformer	PLANNED OUTAGE	5/3/2023 10:47	3,165.63	14
Breaker	PLANNED OUTAGE	5/3/2023 11:30	2,264.28	1319
Transformer	PLANNED OUTAGE	5/3/2023 11:40	846.53	4
Transformer	PLANNED OUTAGE	5/3/2023 16:54	204.15	9
Transformer	PLANNED OUTAGE	5/3/2023 19:52	115.47	8
PLF	PLANNED OUTAGE	5/3/2023 23:07	173.33	1
PLF	PLANNED OUTAGE	5/3/2023 23:55	339.80	1
PLF	PLANNED OUTAGE	5/4/2023 9:36	997.00	15
Transformer	PLANNED OUTAGE	5/4/2023 10:32	892.73	7
Transformer Bank	PLANNED OUTAGE	5/4/2023 11:20	177.52	1
Transformer	PLANNED OUTAGE	5/4/2023 13:08	1,605.07	16
Transformer	PLANNED OUTAGE	5/4/2023 14:09	1,314.83	10
Transformer	PLANNED OUTAGE	5/4/2023 14:35	326.27	4
Service point	PLANNED OUTAGE	5/4/2023 14:41	31.50	1
Transformer	PLANNED OUTAGE	5/4/2023 19:44	317.22	7
Transformer	PLANNED OUTAGE	5/4/2023 19:47	298.27	8
Transformer Bank	PLANNED OUTAGE	5/5/2023 8:12	50.80	4
Transformer	PLANNED OUTAGE	5/5/2023 9:05	12.30	3
Transformer	PLANNED OUTAGE	5/5/2023 9:39	232.60	6

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	5/5/2023 10:04	482.13	4
Transformer	PLANNED OUTAGE	5/5/2023 10:41	244.17	10
PLF	PLANNED OUTAGE	5/5/2023 18:26	56.07	2
Transformer	PLANNED OUTAGE	5/6/2023 0:49	1,004.40	3
Breaker	PLANNED OUTAGE	5/6/2023 6:39	61,206.20	946
PLF	PLANNED OUTAGE	5/6/2023 11:26	1,563.50	59
Transformer	PLANNED OUTAGE	5/6/2023 12:50	588.27	8
Transformer	PLANNED OUTAGE	5/6/2023 17:38	36.70	3
PLF	PLANNED OUTAGE	5/6/2023 20:31	239.93	4
PLF	PLANNED OUTAGE	5/6/2023 21:42	1,754.83	10
PLF	PLANNED OUTAGE	5/6/2023 23:52	4,370.70	102
Service point	PLANNED OUTAGE	5/7/2023 2:13	48.82	1
Switch	PLANNED OUTAGE	5/7/2023 9:22	299.02	1
Transformer Bank	PLANNED OUTAGE	5/7/2023 11:06	9.60	1
PLF	PLANNED OUTAGE	5/7/2023 12:10	796.02	7
Transformer	PLANNED OUTAGE	5/7/2023 19:35	456.75	21
Transformer	PLANNED OUTAGE	5/7/2023 21:38	106.03	1
Transformer	PLANNED OUTAGE	5/7/2023 21:39	378.00	21
Transformer	PLANNED OUTAGE	5/7/2023 22:03	77.98	1
Transformer	PLANNED OUTAGE	5/7/2023 22:03	79.40	1
Transformer	PLANNED OUTAGE	5/7/2023 22:18	126.00	2
Switch	PLANNED OUTAGE	5/8/2023 2:41	41.70	1
Transformer	PLANNED OUTAGE	5/8/2023 8:49	1,586.17	5
Transformer	PLANNED OUTAGE	5/8/2023 9:18	356.10	6
Transformer	PLANNED OUTAGE	5/8/2023 9:36	549.33	5
Switch	PLANNED OUTAGE	5/8/2023 10:29	180.98	1
Transformer	PLANNED OUTAGE	5/8/2023 11:06	472.60	6
Transformer	PLANNED OUTAGE	5/8/2023 11:07	549.60	8
Transformer	PLANNED OUTAGE	5/8/2023 11:57	291.30	9
PLF	PLANNED OUTAGE	5/8/2023 12:39	248.80	6
Transformer	PLANNED OUTAGE	5/8/2023 12:50	243.28	1
Transformer Bank	PLANNED OUTAGE	5/8/2023 13:13	66.23	2
Transformer	PLANNED OUTAGE	5/8/2023 13:27	297.97	7
PLF	PLANNED OUTAGE	5/8/2023 16:18	401.20	34
Switch	PLANNED OUTAGE	5/8/2023 18:15	1,824.80	12
PLF	PLANNED OUTAGE	5/9/2023 1:15	769.30	14
Recloser	PLANNED OUTAGE	5/9/2023 8:33	1,079.58	5
Transformer	PLANNED OUTAGE	5/9/2023 8:37	447.13	4
PLF	PLANNED OUTAGE	5/9/2023 9:02	292.92	95
Transformer	PLANNED OUTAGE	5/9/2023 9:04	2,341.33	10
PLF	PLANNED OUTAGE	5/9/2023 9:06	123.82	1
PLF	PLANNED OUTAGE	5/9/2023 9:06	126.20	1
PLF	PLANNED OUTAGE	5/9/2023 9:21	264.35	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/9/2023 9:34	282.13	8
PLF	PLANNED OUTAGE	5/9/2023 9:52	731.17	2
Transformer	PLANNED OUTAGE	5/9/2023 10:23	469.47	7
PLF	PLANNED OUTAGE	5/9/2023 11:04	17.80	2
Transformer Bank	PLANNED OUTAGE	5/9/2023 11:42	287.42	5
Transformer	PLANNED OUTAGE	5/9/2023 11:44	256.23	1
Transformer	PLANNED OUTAGE	5/9/2023 12:00	238.58	1
Transformer	PLANNED OUTAGE	5/9/2023 12:18	444.67	8
PLF	PLANNED OUTAGE	5/9/2023 13:14	232.02	1
Switch	PLANNED OUTAGE	5/9/2023 13:22	365.28	7
Transformer	PLANNED OUTAGE	5/9/2023 18:09	80.85	3
PLF	PLANNED OUTAGE	5/9/2023 19:25	396.38	1
Transformer	PLANNED OUTAGE	5/9/2023 19:30	384.95	1
Transformer	PLANNED OUTAGE	5/9/2023 19:41	373.12	1
Transformer	PLANNED OUTAGE	5/10/2023 8:33	204.17	2
Transformer	PLANNED OUTAGE	5/10/2023 8:48	434.60	1
Switch	PLANNED OUTAGE	5/10/2023 9:29	4,031.88	49
PLF	PLANNED OUTAGE	5/10/2023 11:34	370.10	1
PLF	PLANNED OUTAGE	5/10/2023 11:42	361.20	2
Switch	PLANNED OUTAGE	5/10/2023 12:02	111.03	2
Transformer	PLANNED OUTAGE	5/10/2023 12:30	527.67	4
Primary Wire	PLANNED OUTAGE	5/10/2023 12:37	10.67	10
Transformer	PLANNED OUTAGE	5/10/2023 13:55	1,239.70	14
Transformer	PLANNED OUTAGE	5/10/2023 14:23	2,055.40	12
PLF	PLANNED OUTAGE	5/10/2023 14:27	567.42	11
Transformer	PLANNED OUTAGE	5/10/2023 17:29	42.97	2
Transformer	PLANNED OUTAGE	5/10/2023 18:01	58.42	5
Transformer	PLANNED OUTAGE	5/10/2023 18:22	241.83	5
PLF	PLANNED OUTAGE	5/10/2023 18:36	1,073.10	3
Switch	PLANNED OUTAGE	5/10/2023 22:42	140.68	1
Transformer	PLANNED OUTAGE	5/10/2023 23:38	124.35	9
Transformer Bank	PLANNED OUTAGE	5/10/2023 23:41	712.83	7
Primary Wire	PLANNED OUTAGE	5/11/2023 6:24	1,406.40	16
Transformer	PLANNED OUTAGE	5/11/2023 8:39	132.90	9
Transformer	PLANNED OUTAGE	5/11/2023 8:48	946.67	8
Transformer	PLANNED OUTAGE	5/11/2023 9:55	307.35	3
Transformer	PLANNED OUTAGE	5/11/2023 10:05	476.13	8
Transformer	PLANNED OUTAGE	5/11/2023 11:03	30.47	2
Transformer Bank	PLANNED OUTAGE	5/11/2023 11:10	696.30	3
Transformer	PLANNED OUTAGE	5/11/2023 12:44	41.50	1
Primary Wire	PLANNED OUTAGE	5/11/2023 13:24	194.63	2
Transformer	PLANNED OUTAGE	5/11/2023 15:11	91.50	1
Transformer	PLANNED OUTAGE	5/11/2023 17:01	1,376.33	10

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/11/2023 17:08	946.75	7
Transformer	PLANNED OUTAGE	5/11/2023 17:59	881.07	7
Transformer	PLANNED OUTAGE	5/11/2023 21:53	398.33	10
PLF	PLANNED OUTAGE	5/11/2023 22:02	30.87	1
Transformer	PLANNED OUTAGE	5/12/2023 9:06	1,000.18	7
Transformer	PLANNED OUTAGE	5/12/2023 9:24	644.30	6
Transformer Bank	PLANNED OUTAGE	5/12/2023 10:15	1,089.90	18
PLF	PLANNED OUTAGE	5/12/2023 10:18	179.10	6
Transformer	PLANNED OUTAGE	5/12/2023 10:51	47.70	2
Transformer	PLANNED OUTAGE	5/12/2023 12:18	363.90	6
Transformer	PLANNED OUTAGE	5/12/2023 14:05	187.20	9
Primary Wire	PLANNED OUTAGE	5/12/2023 22:16	349.20	27
Transformer	PLANNED OUTAGE	5/13/2023 8:03	159.90	1
PLF	PLANNED OUTAGE	5/13/2023 8:10	378.00	1
Transformer	PLANNED OUTAGE	5/13/2023 8:21	73.48	1
Transformer	PLANNED OUTAGE	5/13/2023 11:11	32.65	3
Transformer	PLANNED OUTAGE	5/13/2023 12:11	321.60	8
Transformer Bank	PLANNED OUTAGE	5/13/2023 12:51	273.60	9
Transformer	PLANNED OUTAGE	5/13/2023 12:52	673.20	12
Transformer	PLANNED OUTAGE	5/13/2023 13:00	9.48	1
Transformer	PLANNED OUTAGE	5/13/2023 13:00	9.48	1
Transformer	PLANNED OUTAGE	5/13/2023 13:03	35.30	6
Transformer Bank	PLANNED OUTAGE	5/13/2023 13:39	200.20	7
Transformer	PLANNED OUTAGE	5/13/2023 14:35	184.50	9
PLF	PLANNED OUTAGE	5/13/2023 18:36	1,207.80	12
Primary Wire	PLANNED OUTAGE	5/13/2023 19:52	3,708.75	25
Recloser	PLANNED OUTAGE	5/13/2023 20:51	28,834.40	1897
PLF	PLANNED OUTAGE	5/13/2023 21:33	257.17	1
PLF	PLANNED OUTAGE	5/13/2023 21:35	1,254.40	4
PLF	PLANNED OUTAGE	5/13/2023 23:18	8,064.83	53
PLF	PLANNED OUTAGE	5/13/2023 23:25	144.20	1
PLF	PLANNED OUTAGE	5/13/2023 23:27	142.20	1
PLF	PLANNED OUTAGE	5/14/2023 2:03	397.80	18
PLF	PLANNED OUTAGE	5/14/2023 2:04	188.85	9
PLF	PLANNED OUTAGE	5/14/2023 2:59	1,463.20	6
Switch	PLANNED OUTAGE	5/14/2023 9:09	155.05	1
PLF	PLANNED OUTAGE	5/14/2023 11:25	1,364.00	24
PLF	PLANNED OUTAGE	5/14/2023 11:27	106.05	21
PLF	PLANNED OUTAGE	5/14/2023 11:27	1,137.50	21
Transformer	PLANNED OUTAGE	5/14/2023 11:44	2,153.55	7
Transformer	PLANNED OUTAGE	5/14/2023 16:56	183.33	8
Transformer	PLANNED OUTAGE	5/15/2023 0:20	15.73	1
Switch	PLANNED OUTAGE	5/15/2023 8:25	679.82	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	5/15/2023 8:56	403.80	4
PLF	PLANNED OUTAGE	5/15/2023 9:16	132.93	4
Transformer	PLANNED OUTAGE	5/15/2023 9:19	144.95	1
Transformer	PLANNED OUTAGE	5/15/2023 9:59	398.93	4
Transformer Bank	PLANNED OUTAGE	5/15/2023 11:33	38.32	1
Transformer	PLANNED OUTAGE	5/15/2023 11:45	626.33	5
Transformer	PLANNED OUTAGE	5/15/2023 11:47	144.07	1
Transformer	PLANNED OUTAGE	5/15/2023 11:51	1,004.80	8
Transformer	PLANNED OUTAGE	5/15/2023 11:56	410.53	4
Switch	PLANNED OUTAGE	5/15/2023 12:09	521.73	2
PLF	PLANNED OUTAGE	5/15/2023 15:35	196.20	4
PLF	PLANNED OUTAGE	5/15/2023 15:42	100.27	2
PLF	PLANNED OUTAGE	5/15/2023 18:11	90.95	1
Service point	PLANNED OUTAGE	5/15/2023 19:39	4.20	1
Transformer	PLANNED OUTAGE	5/15/2023 22:23	303.12	13
Primary Wire	PLANNED OUTAGE	5/16/2023 5:33	362.40	2
Transformer	PLANNED OUTAGE	5/16/2023 8:13	782.83	7
Transformer	PLANNED OUTAGE	5/16/2023 8:19	782.40	2
Transformer	PLANNED OUTAGE	5/16/2023 8:56	302.70	6
Transformer Bank	PLANNED OUTAGE	5/16/2023 9:08	120.77	1
Transformer	PLANNED OUTAGE	5/16/2023 10:27	7,339.00	41
Transformer	PLANNED OUTAGE	5/16/2023 13:21	217.20	6
Switch	PLANNED OUTAGE	5/16/2023 17:44	639.77	17
Transformer	PLANNED OUTAGE	5/16/2023 18:05	278.95	21
Transformer Bank	PLANNED OUTAGE	5/16/2023 18:56	36.33	2
Switch	PLANNED OUTAGE	5/16/2023 19:14	617.07	13
Transformer	PLANNED OUTAGE	5/16/2023 19:50	184.25	3
PLF	PLANNED OUTAGE	5/16/2023 20:02	43.83	2
Transformer	PLANNED OUTAGE	5/16/2023 20:50	830.47	2
Transformer	PLANNED OUTAGE	5/16/2023 20:51	72.53	8
Transformer	PLANNED OUTAGE	5/17/2023 3:08	1,162.67	8
Transformer	PLANNED OUTAGE	5/17/2023 8:21	329.53	4
Transformer	PLANNED OUTAGE	5/17/2023 9:23	318.60	3
Transformer	PLANNED OUTAGE	5/17/2023 9:50	338.20	4
Transformer	PLANNED OUTAGE	5/17/2023 10:09	117.02	1
Transformer	PLANNED OUTAGE	5/17/2023 10:09	123.18	1
Transformer	PLANNED OUTAGE	5/17/2023 10:51	414.60	6
PLF	PLANNED OUTAGE	5/17/2023 12:02	277.30	6
Transformer	PLANNED OUTAGE	5/17/2023 12:25	429.00	5
Transformer Bank	PLANNED OUTAGE	5/17/2023 13:53	116.53	1
PLF	PLANNED OUTAGE	5/18/2023 0:34	20.20	2
Transformer	PLANNED OUTAGE	5/18/2023 8:08	393.33	4
PLF	PLANNED OUTAGE	5/18/2023 8:12	2,763.67	20

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/18/2023 8:50	241.27	11
Transformer	PLANNED OUTAGE	5/18/2023 9:06	1,044.55	3
PLF	PLANNED OUTAGE	5/18/2023 9:09	401.17	1
Transformer	PLANNED OUTAGE	5/18/2023 9:10	560.93	8
PLF	PLANNED OUTAGE	5/18/2023 9:33	139.33	1
Switch	PLANNED OUTAGE	5/18/2023 9:45	12.12	1
Service point	PLANNED OUTAGE	5/18/2023 9:53	16.82	1
Transformer	PLANNED OUTAGE	5/18/2023 10:03	275.92	5
Transformer	PLANNED OUTAGE	5/18/2023 10:16	1,009.00	6
Switch	PLANNED OUTAGE	5/18/2023 10:20	203.00	5
Primary Wire	PLANNED OUTAGE	5/18/2023 10:25	10.28	1
Switch	PLANNED OUTAGE	5/18/2023 10:26	79.50	18
Switch	PLANNED OUTAGE	5/18/2023 10:30	2,978.97	14
Transformer	PLANNED OUTAGE	5/18/2023 11:15	685.80	6
Switch	PLANNED OUTAGE	5/18/2023 11:33	1,235.85	21
Transformer	PLANNED OUTAGE	5/18/2023 13:21	72.80	7
Transformer	PLANNED OUTAGE	5/18/2023 13:27	100.73	2
Switch	PLANNED OUTAGE	5/18/2023 17:18	118.40	1
PLF	PLANNED OUTAGE	5/18/2023 18:50	34.47	1
PLF	PLANNED OUTAGE	5/18/2023 19:04	98.58	5
PLF	PLANNED OUTAGE	5/18/2023 19:04	58.00	3
PLF	PLANNED OUTAGE	5/19/2023 6:57	16.27	2
Transformer	PLANNED OUTAGE	5/19/2023 8:36	85.95	1
Transformer	PLANNED OUTAGE	5/19/2023 9:53	596.93	8
Breaker	PLANNED OUTAGE	5/19/2023 20:39	40.88	1
Breaker	PLANNED OUTAGE	5/19/2023 20:39	122.65	3
Switch	PLANNED OUTAGE	5/19/2023 22:25	24,455.47	32
Transformer	PLANNED OUTAGE	5/20/2023 4:16	21.33	2
Transformer	PLANNED OUTAGE	5/20/2023 8:11	154.27	1
Breaker	PLANNED OUTAGE	5/20/2023 17:38	9,730.80	1431
Switch	PLANNED OUTAGE	5/20/2023 21:34	850.45	3
PLF	PLANNED OUTAGE	5/21/2023 2:04	1,388.67	10
TX Repaired (PM)	PLANNED OUTAGE	5/21/2023 4:23	1,142.27	26
PLF	PLANNED OUTAGE	5/21/2023 9:46	390.08	5
Breaker	PLANNED OUTAGE	5/21/2023 18:45	9,426.67	1120
Breaker	PLANNED OUTAGE	5/22/2023 3:49	33,839.75	1281
Switch	PLANNED OUTAGE	5/22/2023 7:46	30.07	1
Switch	PLANNED OUTAGE	5/22/2023 7:47	60.13	2
Switch	PLANNED OUTAGE	5/22/2023 7:47	29.90	1
Transformer	PLANNED OUTAGE	5/22/2023 9:20	1,602.58	5
Transformer	PLANNED OUTAGE	5/22/2023 9:20	2,889.60	9
Transformer	PLANNED OUTAGE	5/22/2023 9:43	891.33	7
Transformer	PLANNED OUTAGE	5/22/2023 9:50	1,587.00	5

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/22/2023 9:51	763.07	8
Transformer	PLANNED OUTAGE	5/22/2023 11:33	2,745.23	11
OH Other	PLANNED OUTAGE	5/22/2023 13:49	1,620.73	23
Transformer	PLANNED OUTAGE	5/22/2023 13:55	609.50	5
PLF	PLANNED OUTAGE	5/22/2023 14:02	2,630.43	23
Transformer	PLANNED OUTAGE	5/22/2023 14:08	1,243.87	8
Transformer	PLANNED OUTAGE	5/22/2023 14:09	1,273.73	8
Transformer	PLANNED OUTAGE	5/22/2023 15:34	2,939.77	86
Transformer	PLANNED OUTAGE	5/22/2023 16:22	94.83	2
Service point	PLANNED OUTAGE	5/22/2023 17:04	3.70	1
PLF	PLANNED OUTAGE	5/23/2023 4:05	227.20	4
Transformer	PLANNED OUTAGE	5/23/2023 4:48	261.60	4
Transformer	PLANNED OUTAGE	5/23/2023 4:52	110.85	3
PLF	PLANNED OUTAGE	5/23/2023 5:31	41.80	3
Primary Wire	PLANNED OUTAGE	5/23/2023 9:02	231.33	2
TX Repaired (PM)	PLANNED OUTAGE	5/23/2023 9:45	125.33	1
Transformer	PLANNED OUTAGE	5/23/2023 10:16	232.78	1
Transformer	PLANNED OUTAGE	5/23/2023 10:41	17.80	12
Transformer	PLANNED OUTAGE	5/23/2023 10:57	240.93	8
Transformer	PLANNED OUTAGE	5/23/2023 11:09	241.30	3
Transformer	PLANNED OUTAGE	5/23/2023 11:40	145.93	4
PLF	PLANNED OUTAGE	5/23/2023 11:40	2,238.00	60
PLF	PLANNED OUTAGE	5/23/2023 13:52	421.88	17
Switch	PLANNED OUTAGE	5/23/2023 15:16	471.45	3
Transformer	PLANNED OUTAGE	5/23/2023 15:21	71.65	1
PLF	PLANNED OUTAGE	5/23/2023 18:04	138.05	1
Transformer	PLANNED OUTAGE	5/23/2023 19:31	33.07	8
Primary Wire	PLANNED OUTAGE	5/23/2023 19:34	55,914.67	128
Circuit Out	PLANNED OUTAGE	5/23/2023 19:38	113,201.40	1262
Service point	PLANNED OUTAGE	5/23/2023 20:43	93,112.00	904
Service point	PLANNED OUTAGE	5/23/2023 20:43	5,562.57	38
Service point	PLANNED OUTAGE	5/23/2023 20:52	425.37	1
Breaker	PLANNED OUTAGE	5/23/2023 22:28	13,300.87	524
Primary Wire	PLANNED OUTAGE	5/23/2023 23:10	3,156.22	19
Primary Wire	PLANNED OUTAGE	5/23/2023 23:10	3,193.27	19
Transformer	PLANNED OUTAGE	5/24/2023 7:45	743.80	4
Transformer	PLANNED OUTAGE	5/24/2023 7:48	736.93	4
Transformer	PLANNED OUTAGE	5/24/2023 8:21	601.13	4
Transformer	PLANNED OUTAGE	5/24/2023 8:41	677.73	8
Transformer	PLANNED OUTAGE	5/24/2023 8:48	674.00	6
Transformer	PLANNED OUTAGE	5/24/2023 9:06	1,011.33	10
Transformer	PLANNED OUTAGE	5/24/2023 9:15	340.67	7
Transformer	PLANNED OUTAGE	5/24/2023 9:16	768.13	7

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/24/2023 10:11	445.60	8
Transformer Bank	PLANNED OUTAGE	5/24/2023 11:04	122.42	5
Transformer	PLANNED OUTAGE	5/24/2023 11:10	866.93	8
PLF	PLANNED OUTAGE	5/24/2023 11:20	2,389.80	28
Transformer	PLANNED OUTAGE	5/24/2023 11:20	46.40	8
Transformer	PLANNED OUTAGE	5/24/2023 11:36	1.15	1
Transformer	PLANNED OUTAGE	5/24/2023 11:36	1.13	1
Transformer	PLANNED OUTAGE	5/24/2023 11:44	488.27	8
Transformer	PLANNED OUTAGE	5/24/2023 12:46	359.88	11
Service point	PLANNED OUTAGE	5/24/2023 12:57	26.37	1
Transformer	PLANNED OUTAGE	5/24/2023 13:23	316.20	9
Transformer	PLANNED OUTAGE	5/24/2023 14:01	971.60	7
Transformer	PLANNED OUTAGE	5/24/2023 14:02	689.58	5
Transformer	PLANNED OUTAGE	5/24/2023 15:05	639.17	10
PLF	PLANNED OUTAGE	5/24/2023 15:20	1,345.70	6
Transformer Bank	PLANNED OUTAGE	5/24/2023 16:12	22,588.85	367
Breaker	PLANNED OUTAGE	5/24/2023 18:25	36,893.97	497
PLF	PLANNED OUTAGE	5/24/2023 20:52	1,059.00	10
PLF	PLANNED OUTAGE	5/25/2023 0:06	926.53	8
Recloser	PLANNED OUTAGE	5/25/2023 2:45	9,129.50	30
PLF	PLANNED OUTAGE	5/25/2023 3:59	31,176.75	45
Transformer	PLANNED OUTAGE	5/25/2023 7:35	2,209.40	12
Transformer	PLANNED OUTAGE	5/25/2023 8:21	237.25	1
PLF	PLANNED OUTAGE	5/25/2023 8:24	321.30	18
Transformer	PLANNED OUTAGE	5/25/2023 8:31	422.10	21
Transformer	PLANNED OUTAGE	5/25/2023 8:31	571.20	6
Transformer	PLANNED OUTAGE	5/25/2023 8:31	951.73	8
Transformer	PLANNED OUTAGE	5/25/2023 8:31	949.47	8
Transformer	PLANNED OUTAGE	5/25/2023 8:39	163.75	5
Transformer	PLANNED OUTAGE	5/25/2023 8:48	190.50	5
PLF	PLANNED OUTAGE	5/25/2023 9:09	999.70	39
PLF	PLANNED OUTAGE	5/25/2023 9:10	1,341.00	54
PLF	PLANNED OUTAGE	5/25/2023 9:25	192.62	1
PLF	PLANNED OUTAGE	5/25/2023 10:09	8,826.13	32
PLF	PLANNED OUTAGE	5/25/2023 10:09	276.38	1
PLF	PLANNED OUTAGE	5/25/2023 10:11	274.42	1
Transformer	PLANNED OUTAGE	5/25/2023 10:18	892.33	5
Transformer	PLANNED OUTAGE	5/25/2023 10:28	429.90	6
Transformer	PLANNED OUTAGE	5/25/2023 11:24	781.07	8
Transformer	PLANNED OUTAGE	5/25/2023 11:24	878.40	9
Transformer	PLANNED OUTAGE	5/25/2023 11:36	712.60	7
Transformer Bank	PLANNED OUTAGE	5/25/2023 11:42	618.30	6
Transformer	PLANNED OUTAGE	5/25/2023 12:03	58.60	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/25/2023 12:37	6,334.47	52
Transformer	PLANNED OUTAGE	5/25/2023 12:42	665.70	21
PLF	PLANNED OUTAGE	5/25/2023 13:22	760.67	10
Transformer Bank	PLANNED OUTAGE	5/25/2023 13:25	6.30	6
Transformer Bank	PLANNED OUTAGE	5/25/2023 13:26	7.10	6
Transformer	PLANNED OUTAGE	5/25/2023 13:32	393.67	4
Transformer	PLANNED OUTAGE	5/25/2023 13:46	147.70	7
Transformer Bank	PLANNED OUTAGE	5/25/2023 14:38	57.37	1
Transformer	PLANNED OUTAGE	5/25/2023 19:48	2,752.20	18
Transformer	PLANNED OUTAGE	5/25/2023 19:49	1,681.17	11
PLF	PLANNED OUTAGE	5/25/2023 19:55	58.27	2
PLF	PLANNED OUTAGE	5/25/2023 20:14	3,050.67	5
PLF	PLANNED OUTAGE	5/25/2023 20:28	4,242.00	18
PLF	PLANNED OUTAGE	5/25/2023 21:19	811.13	2
PLF	PLANNED OUTAGE	5/25/2023 21:20	733.27	4
Transformer	PLANNED OUTAGE	5/26/2023 9:46	821.75	15
Transformer Bank	PLANNED OUTAGE	5/26/2023 10:38	171.47	2
Transformer Bank	PLANNED OUTAGE	5/26/2023 15:15	659.80	3
Transformer	PLANNED OUTAGE	5/26/2023 21:22	190.50	10
PLF	PLANNED OUTAGE	5/26/2023 23:36	21.58	1
PLF	PLANNED OUTAGE	5/27/2023 13:24	170.25	5
PLF	PLANNED OUTAGE	5/27/2023 14:11	19.83	1
PLF	PLANNED OUTAGE	5/27/2023 14:55	66.60	2
PLF	PLANNED OUTAGE	5/27/2023 16:10	104.83	10
PLF	PLANNED OUTAGE	5/27/2023 16:24	95.55	1
Transformer	PLANNED OUTAGE	5/28/2023 6:59	682.60	6
Recloser	PLANNED OUTAGE	5/28/2023 13:30	576.67	20
Recloser	PLANNED OUTAGE	5/28/2023 13:30	4,495.83	166
Transformer	PLANNED OUTAGE	5/28/2023 13:30	540.05	1
Breaker	PLANNED OUTAGE	5/28/2023 19:15	56,225.03	1298
PLF	PLANNED OUTAGE	5/29/2023 19:01	109.50	1
Service point	PLANNED OUTAGE	5/29/2023 21:10	65.13	1
Transformer	PLANNED OUTAGE	5/29/2023 22:14	25.33	19
Transformer	PLANNED OUTAGE	5/29/2023 22:14	1,299.33	4
Transformer	PLANNED OUTAGE	5/30/2023 8:24	58.55	3
PLF	PLANNED OUTAGE	5/30/2023 8:38	950.70	3
PLF	PLANNED OUTAGE	5/30/2023 9:03	194.85	1
PLF	PLANNED OUTAGE	5/30/2023 9:18	341.10	6
Service point	PLANNED OUTAGE	5/30/2023 9:20	130.10	1
Transformer	PLANNED OUTAGE	5/30/2023 9:20	588.67	5
PLF	PLANNED OUTAGE	5/30/2023 9:38	58.80	3
Transformer Bank	PLANNED OUTAGE	5/30/2023 9:54	82.43	1
Transformer Bank	PLANNED OUTAGE	5/30/2023 9:56	61.52	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	5/30/2023 10:01	63.60	1
Transformer	PLANNED OUTAGE	5/30/2023 10:07	171.00	3
Transformer	PLANNED OUTAGE	5/30/2023 10:16	417.20	8
Transformer	PLANNED OUTAGE	5/30/2023 10:40	407.20	12
Transformer	PLANNED OUTAGE	5/30/2023 10:41	192.20	6
Transformer	PLANNED OUTAGE	5/30/2023 11:13	214.08	1
Transformer	PLANNED OUTAGE	5/30/2023 13:24	426.00	8
Transformer	PLANNED OUTAGE	5/30/2023 13:46	392.93	8
Transformer	PLANNED OUTAGE	5/30/2023 14:09	77.95	1
Transformer Bank	PLANNED OUTAGE	5/30/2023 14:51	241.60	2
Transformer	PLANNED OUTAGE	5/30/2023 15:24	339.10	6
Transformer	PLANNED OUTAGE	5/30/2023 19:16	781.35	3
Breaker	PLANNED OUTAGE	5/31/2023 7:03	20,724.53	3379
Transformer	PLANNED OUTAGE	5/31/2023 7:59	634.25	5
PLF	PLANNED OUTAGE	5/31/2023 8:17	281.30	2
Transformer	PLANNED OUTAGE	5/31/2023 8:31	1,363.20	8
PLF	PLANNED OUTAGE	5/31/2023 8:56	8,230.37	49
Transformer	PLANNED OUTAGE	5/31/2023 9:13	707.60	24
Transformer	PLANNED OUTAGE	5/31/2023 9:41	138.60	3
Transformer	PLANNED OUTAGE	5/31/2023 9:41	239.43	11
Transformer	PLANNED OUTAGE	5/31/2023 9:43	1,136.00	10
PLF	PLANNED OUTAGE	5/31/2023 9:56	433.92	5
Transformer	PLANNED OUTAGE	5/31/2023 10:15	371.70	9
Transformer	PLANNED OUTAGE	5/31/2023 10:44	40.73	1
Transformer Bank	PLANNED OUTAGE	5/31/2023 10:56	3,392.77	11
PLF	PLANNED OUTAGE	5/31/2023 10:56	8,639.40	28
Transformer	PLANNED OUTAGE	5/31/2023 10:58	939.25	3
Switch	PLANNED OUTAGE	5/31/2023 11:00	750.87	7
Service point	PLANNED OUTAGE	5/31/2023 11:38	16.35	1
PLF	PLANNED OUTAGE	5/31/2023 11:45	865.73	4
Transformer	PLANNED OUTAGE	5/31/2023 11:57	543.20	24
Transformer	PLANNED OUTAGE	5/31/2023 12:11	1,485.60	9
PLF	PLANNED OUTAGE	5/31/2023 12:13	3,938.00	40
Transformer	PLANNED OUTAGE	5/31/2023 13:58	34.65	11
Transformer	PLANNED OUTAGE	5/31/2023 14:05	101.17	10
Transformer	PLANNED OUTAGE	5/31/2023 14:22	295.10	6
PLF	PLANNED OUTAGE	5/31/2023 14:24	195.63	2
Transformer	PLANNED OUTAGE	5/31/2023 15:12	6.70	6
Transformer	PLANNED OUTAGE	5/31/2023 15:13	6.80	6
Transformer	PLANNED OUTAGE	5/31/2023 15:14	21.70	6
Transformer Bank	PLANNED OUTAGE	5/31/2023 16:05	16.87	11
Transformer Bank	PLANNED OUTAGE	5/31/2023 16:06	15.77	11
Transformer Bank	PLANNED OUTAGE	5/31/2023 16:08	16.50	11

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	5/31/2023 16:10	491.88	11
PLF	PLANNED OUTAGE	5/31/2023 17:22	3,689.50	15
Transformer	PLANNED OUTAGE	6/1/2023 9:04	165.03	2
PLF	PLANNED OUTAGE	6/1/2023 9:39	585.43	26
Transformer	PLANNED OUTAGE	6/1/2023 10:49	57.78	1
Transformer	PLANNED OUTAGE	6/1/2023 12:52	21.75	9
Transformer	PLANNED OUTAGE	6/1/2023 12:52	619.67	10
Transformer Bank	PLANNED OUTAGE	6/1/2023 12:59	314.95	3
Transformer Bank	PLANNED OUTAGE	6/1/2023 13:47	47.20	1
PLF	PLANNED OUTAGE	6/1/2023 14:10	2,032.92	41
PLF	PLANNED OUTAGE	6/1/2023 14:29	355.35	9
Transformer Bank	PLANNED OUTAGE	6/1/2023 15:45	8.50	2
Transformer Bank	PLANNED OUTAGE	6/1/2023 16:04	31.30	2
PLF	PLANNED OUTAGE	6/1/2023 16:47	151.92	5
Transformer	PLANNED OUTAGE	6/1/2023 18:40	255.13	4
PLF	PLANNED OUTAGE	6/1/2023 21:22	241.70	3
PLF	PLANNED OUTAGE	6/1/2023 21:25	1,371.90	18
Transformer	PLANNED OUTAGE	6/1/2023 21:38	1,079.20	4
PLF	PLANNED OUTAGE	6/2/2023 0:00	637.00	2
Transformer	PLANNED OUTAGE	6/2/2023 12:47	336.43	1
PLF	PLANNED OUTAGE	6/2/2023 16:34	62.40	2
Transformer	PLANNED OUTAGE	6/2/2023 17:14	376.67	5
OH Other	PLANNED OUTAGE	6/2/2023 17:59	14,957.42	1195
Transformer	PLANNED OUTAGE	6/2/2023 19:29	277.02	11
Recloser	PLANNED OUTAGE	6/2/2023 21:52	527.00	31
Breaker	PLANNED OUTAGE	6/2/2023 23:09	2,600.97	314
PLF	PLANNED OUTAGE	6/2/2023 23:19	126.37	1
Transformer	PLANNED OUTAGE	6/3/2023 8:00	1,254.60	6
Transformer	PLANNED OUTAGE	6/3/2023 8:55	651.80	12
Breaker	PLANNED OUTAGE	6/3/2023 9:43	16,214.00	737
Transformer	PLANNED OUTAGE	6/3/2023 10:21	15.18	1
Transformer	PLANNED OUTAGE	6/4/2023 13:49	68.03	13
Recloser	PLANNED OUTAGE	6/4/2023 18:55	15,018.75	445
Recloser	PLANNED OUTAGE	6/4/2023 18:55	6,475.27	23
Recloser	PLANNED OUTAGE	6/4/2023 18:55	81.12	1
Breaker	PLANNED OUTAGE	6/4/2023 19:08	7,995.00	738
PLF	PLANNED OUTAGE	6/4/2023 19:45	625.90	11
PLF	PLANNED OUTAGE	6/4/2023 22:53	5,250.90	6
OH Other	PLANNED OUTAGE	6/4/2023 23:13	888.43	11
Recloser	PLANNED OUTAGE	6/4/2023 23:13	968.00	12
Breaker	PLANNED OUTAGE	6/4/2023 23:18	9,060.80	809
OH Other	PLANNED OUTAGE	6/4/2023 23:33	60.67	1
OH Other	PLANNED OUTAGE	6/4/2023 23:34	60.18	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	6/4/2023 23:37	56.85	1
PLF	PLANNED OUTAGE	6/4/2023 23:53	358.47	2
PLF	PLANNED OUTAGE	6/5/2023 3:01	11,061.87	56
PLF	PLANNED OUTAGE	6/5/2023 3:03	2,057.25	15
PLF	PLANNED OUTAGE	6/5/2023 5:20	77.75	15
Transformer	PLANNED OUTAGE	6/5/2023 8:52	133.15	3
Transformer	PLANNED OUTAGE	6/5/2023 9:24	415.73	8
Transformer	PLANNED OUTAGE	6/5/2023 9:53	366.07	4
Transformer	PLANNED OUTAGE	6/5/2023 9:56	669.25	5
Transformer	PLANNED OUTAGE	6/5/2023 9:57	507.27	4
PLF	PLANNED OUTAGE	6/5/2023 10:30	641.72	1
Transformer	PLANNED OUTAGE	6/5/2023 10:40	265.23	1
Transformer	PLANNED OUTAGE	6/5/2023 10:41	311.33	4
Transformer Bank	PLANNED OUTAGE	6/5/2023 10:42	389.00	5
Transformer	PLANNED OUTAGE	6/5/2023 10:55	511.83	10
PLF	PLANNED OUTAGE	6/5/2023 11:49	193.53	1
Transformer	PLANNED OUTAGE	6/5/2023 12:11	237.13	4
Transformer	PLANNED OUTAGE	6/5/2023 12:24	246.48	1
Recloser	PLANNED OUTAGE	6/5/2023 12:51	36.42	1
Transformer	PLANNED OUTAGE	6/5/2023 12:58	433.53	4
Transformer	PLANNED OUTAGE	6/5/2023 13:11	395.60	8
Transformer	PLANNED OUTAGE	6/5/2023 14:35	466.90	6
Transformer	PLANNED OUTAGE	6/5/2023 14:36	120.80	4
Transformer Bank	PLANNED OUTAGE	6/5/2023 14:36	157.42	5
PLF	PLANNED OUTAGE	6/5/2023 15:02	3.90	1
PLF	PLANNED OUTAGE	6/5/2023 20:40	976.53	2
Transformer	PLANNED OUTAGE	6/5/2023 20:45	44.55	3
PLF	PLANNED OUTAGE	6/5/2023 21:08	188.15	1
Transformer	PLANNED OUTAGE	6/5/2023 23:09	1,508.10	11
PLF	PLANNED OUTAGE	6/6/2023 2:07	873.50	2
PLF	PLANNED OUTAGE	6/6/2023 2:42	420.08	1
Transformer	PLANNED OUTAGE	6/6/2023 4:54	747.60	9
Transformer	PLANNED OUTAGE	6/6/2023 5:12	491.83	2
Transformer	PLANNED OUTAGE	6/6/2023 6:27	587.85	9
Transformer	PLANNED OUTAGE	6/6/2023 8:31	55.25	5
Transformer	PLANNED OUTAGE	6/6/2023 8:38	632.10	7
Transformer	PLANNED OUTAGE	6/6/2023 8:47	738.85	7
Transformer	PLANNED OUTAGE	6/6/2023 8:51	1,035.60	9
Transformer	PLANNED OUTAGE	6/6/2023 9:17	341.80	2
Transformer	PLANNED OUTAGE	6/6/2023 9:20	87.45	1
Transformer	PLANNED OUTAGE	6/6/2023 9:45	1,695.75	17
Transformer	PLANNED OUTAGE	6/6/2023 9:50	390.10	6
Transformer	PLANNED OUTAGE	6/6/2023 10:27	483.07	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/6/2023 10:27	1,629.98	13
PLF	PLANNED OUTAGE	6/6/2023 10:38	36.63	2
Transformer	PLANNED OUTAGE	6/6/2023 11:27	413.90	6
Transformer	PLANNED OUTAGE	6/6/2023 11:42	643.77	7
Transformer	PLANNED OUTAGE	6/6/2023 12:23	546.20	6
Transformer	PLANNED OUTAGE	6/6/2023 13:39	537.33	10
Transformer	PLANNED OUTAGE	6/6/2023 14:48	145.07	4
Switch	PLANNED OUTAGE	6/6/2023 18:18	999.93	2
Transformer	PLANNED OUTAGE	6/6/2023 18:31	3,508.80	12
Transformer	PLANNED OUTAGE	6/6/2023 21:00	682.10	6
Transformer	PLANNED OUTAGE	6/6/2023 22:25	192.67	5
Transformer	PLANNED OUTAGE	6/6/2023 22:53	23.20	6
Transformer	PLANNED OUTAGE	6/6/2023 22:54	12.50	6
Transformer	PLANNED OUTAGE	6/7/2023 8:14	1,901.10	6
Transformer	PLANNED OUTAGE	6/7/2023 9:02	623.23	7
Transformer	PLANNED OUTAGE	6/7/2023 9:14	273.50	6
Transformer	PLANNED OUTAGE	6/7/2023 9:33	303.00	5
Transformer	PLANNED OUTAGE	6/7/2023 10:12	633.50	7
Transformer	PLANNED OUTAGE	6/7/2023 10:51	314.83	5
Transformer	PLANNED OUTAGE	6/7/2023 11:33	140.93	4
PLF	PLANNED OUTAGE	6/7/2023 11:57	191.80	3
Transformer	PLANNED OUTAGE	6/7/2023 12:28	404.13	8
Transformer	PLANNED OUTAGE	6/7/2023 12:31	536.00	12
PLF	PLANNED OUTAGE	6/7/2023 13:01	6.50	3
Transformer	PLANNED OUTAGE	6/7/2023 13:18	4,690.40	26
Transformer	PLANNED OUTAGE	6/7/2023 13:27	576.60	9
Transformer	PLANNED OUTAGE	6/7/2023 13:37	639.57	7
Breaker	PLANNED OUTAGE	6/7/2023 14:46	8,168.93	788
Breaker	PLANNED OUTAGE	6/7/2023 14:46	2,208.05	237
Transformer Bank	PLANNED OUTAGE	6/7/2023 16:51	134.20	2
Transformer	PLANNED OUTAGE	6/7/2023 18:18	666.75	21
Transformer	PLANNED OUTAGE	6/7/2023 20:17	578.75	25
PLF	PLANNED OUTAGE	6/8/2023 0:16	417.67	7
Transformer	PLANNED OUTAGE	6/8/2023 8:38	1,372.33	10
Primary Wire	PLANNED OUTAGE	6/8/2023 8:48	366.93	2
Transformer	PLANNED OUTAGE	6/8/2023 8:53	671.30	6
Transformer	PLANNED OUTAGE	6/8/2023 8:54	997.50	9
Transformer	PLANNED OUTAGE	6/8/2023 8:59	191.07	4
Transformer	PLANNED OUTAGE	6/8/2023 9:18	640.80	8
Transformer	PLANNED OUTAGE	6/8/2023 9:31	306.80	4
Transformer	PLANNED OUTAGE	6/8/2023 9:36	142.40	2
OH Other	PLANNED OUTAGE	6/8/2023 9:43	4,133.80	66
OH Other	PLANNED OUTAGE	6/8/2023 9:43	262.60	4

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/8/2023 10:43	450.27	8
Transformer	PLANNED OUTAGE	6/8/2023 10:58	531.00	6
Transformer	PLANNED OUTAGE	6/8/2023 10:59	786.30	9
Transformer	PLANNED OUTAGE	6/8/2023 11:07	98.13	2
Transformer	PLANNED OUTAGE	6/8/2023 11:10	1,089.00	9
Transformer	PLANNED OUTAGE	6/8/2023 11:10	969.33	8
Transformer	PLANNED OUTAGE	6/8/2023 11:12	6.80	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	8.30	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	9.90	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	11.50	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	13.10	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	14.60	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	16.20	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	17.80	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	19.40	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	21.00	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	22.50	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	24.20	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	25.70	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	27.30	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	30.40	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	32.00	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	33.60	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	35.20	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	36.80	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	38.30	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	39.90	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	41.50	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	44.70	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	46.20	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	47.80	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	49.40	6
Transformer	PLANNED OUTAGE	6/8/2023 11:12	50.00	6
Transformer	PLANNED OUTAGE	6/8/2023 11:28	941.80	34
Transformer	PLANNED OUTAGE	6/8/2023 11:52	525.80	6
Transformer Bank	PLANNED OUTAGE	6/8/2023 12:02	151.80	1
PLF	PLANNED OUTAGE	6/8/2023 12:11	50.60	4
Transformer	PLANNED OUTAGE	6/8/2023 12:22	475.67	10
Transformer	PLANNED OUTAGE	6/8/2023 12:47	345.92	7
Transformer	PLANNED OUTAGE	6/8/2023 13:00	97.20	8
Transformer	PLANNED OUTAGE	6/8/2023 13:06	1,402.80	24
Transformer	PLANNED OUTAGE	6/8/2023 13:54	506.45	7
Breaker	PLANNED OUTAGE	6/8/2023 15:22	1,379.83	17

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	6/8/2023 15:22	12,753.97	634
Breaker	PLANNED OUTAGE	6/8/2023 15:22	40,782.15	1377
Transformer Bank	PLANNED OUTAGE	6/8/2023 19:38	56.40	2
Service point	PLANNED OUTAGE	6/8/2023 19:41	22.72	1
Transformer	PLANNED OUTAGE	6/8/2023 21:24	70.35	3
PLF	PLANNED OUTAGE	6/8/2023 21:25	1,462.20	6
PLF	PLANNED OUTAGE	6/9/2023 9:00	1,065.67	5
Transformer	PLANNED OUTAGE	6/9/2023 9:11	136.43	1
Transformer	PLANNED OUTAGE	6/9/2023 9:16	107.15	3
Transformer	PLANNED OUTAGE	6/9/2023 10:44	94.80	4
Transformer	PLANNED OUTAGE	6/9/2023 11:34	518.67	20
Recloser	PLANNED OUTAGE	6/9/2023 11:40	257,372.40	556
Transformer	PLANNED OUTAGE	6/9/2023 12:07	2,527.03	47
Transformer	PLANNED OUTAGE	6/9/2023 13:58	654.93	4
Transformer	PLANNED OUTAGE	6/9/2023 15:12	728.12	7
Transformer	PLANNED OUTAGE	6/10/2023 0:11	565.60	3
Transformer	PLANNED OUTAGE	6/10/2023 1:07	123.73	1
PLF	PLANNED OUTAGE	6/10/2023 8:36	239.65	1
Transformer	PLANNED OUTAGE	6/10/2023 9:06	16.18	1
Transformer	PLANNED OUTAGE	6/10/2023 13:03	31.33	5
Transformer	PLANNED OUTAGE	6/10/2023 13:04	65.55	3
Transformer	PLANNED OUTAGE	6/10/2023 13:48	166.42	5
PLF	PLANNED OUTAGE	6/10/2023 15:58	4,847.20	332
PLF	PLANNED OUTAGE	6/10/2023 19:35	5,764.00	30
Switch	PLANNED OUTAGE	6/10/2023 20:13	1,209.50	123
Transformer	PLANNED OUTAGE	6/10/2023 22:26	260.55	9
Transformer	PLANNED OUTAGE	6/10/2023 22:56	21.60	9
Breaker	PLANNED OUTAGE	6/11/2023 8:46	11,134.00	1140
Transformer	PLANNED OUTAGE	6/11/2023 9:12	260.60	4
Transformer	PLANNED OUTAGE	6/11/2023 12:41	76.53	2
PLF	PLANNED OUTAGE	6/11/2023 13:12	327.17	13
Transformer	PLANNED OUTAGE	6/11/2023 13:32	98.08	5
Transformer	PLANNED OUTAGE	6/11/2023 14:18	28.40	4
Transformer	PLANNED OUTAGE	6/11/2023 15:22	201.15	3
Transformer	PLANNED OUTAGE	6/11/2023 15:24	57.13	2
Transformer	PLANNED OUTAGE	6/11/2023 16:18	48.40	6
Transformer	PLANNED OUTAGE	6/11/2023 16:34	75.07	4
Breaker	PLANNED OUTAGE	6/11/2023 19:38	987.40	6
Transformer	PLANNED OUTAGE	6/12/2023 9:16	172.95	1
Transformer	PLANNED OUTAGE	6/12/2023 9:23	187.47	4
PLF	PLANNED OUTAGE	6/12/2023 9:29	3,753.75	45
Transformer	PLANNED OUTAGE	6/12/2023 9:36	444.50	7
Transformer	PLANNED OUTAGE	6/12/2023 9:48	2,700.00	20

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/12/2023 9:56	1,644.75	15
Transformer	PLANNED OUTAGE	6/12/2023 10:52	182.92	5
Transformer	PLANNED OUTAGE	6/12/2023 11:09	198.37	2
PLF	PLANNED OUTAGE	6/12/2023 11:37	1,991.85	21
Transformer	PLANNED OUTAGE	6/12/2023 12:04	1,290.57	7
Transformer	PLANNED OUTAGE	6/12/2023 12:17	781.20	12
Transformer	PLANNED OUTAGE	6/12/2023 12:36	1,089.78	7
PLF	PLANNED OUTAGE	6/12/2023 13:10	97.97	1
Transformer	PLANNED OUTAGE	6/12/2023 13:15	97.10	1
Transformer	PLANNED OUTAGE	6/12/2023 14:33	1,078.00	20
Breaker	PLANNED OUTAGE	6/12/2023 15:08	9,995.30	917
Breaker	PLANNED OUTAGE	6/12/2023 15:23	3.20	3
Transformer	PLANNED OUTAGE	6/12/2023 16:57	517.50	5
Transformer	PLANNED OUTAGE	6/12/2023 18:05	425.85	9
PLF	PLANNED OUTAGE	6/12/2023 19:16	615.07	8
PLF	PLANNED OUTAGE	6/12/2023 21:28	1,653.75	15
Transformer	PLANNED OUTAGE	6/13/2023 1:43	8.03	1
Transformer Bank	PLANNED OUTAGE	6/13/2023 6:18	1,865.33	8
Transformer	PLANNED OUTAGE	6/13/2023 8:10	326.42	5
Transformer	PLANNED OUTAGE	6/13/2023 8:33	782.80	12
Transformer	PLANNED OUTAGE	6/13/2023 8:48	586.27	8
Transformer	PLANNED OUTAGE	6/13/2023 9:02	599.00	4
Transformer	PLANNED OUTAGE	6/13/2023 9:49	421.40	7
Transformer	PLANNED OUTAGE	6/13/2023 10:01	349.10	1
Transformer	PLANNED OUTAGE	6/13/2023 10:24	660.33	4
PLF	PLANNED OUTAGE	6/13/2023 10:55	829.93	4
PLF	PLANNED OUTAGE	6/13/2023 10:57	1,314.67	5
Transformer	PLANNED OUTAGE	6/13/2023 10:58	987.30	9
Service point	PLANNED OUTAGE	6/13/2023 11:43	4.57	1
PLF	PLANNED OUTAGE	6/13/2023 11:46	1,966.35	9
Transformer	PLANNED OUTAGE	6/13/2023 11:48	74.60	3
Transformer	PLANNED OUTAGE	6/13/2023 12:02	45.33	1
Transformer	PLANNED OUTAGE	6/13/2023 13:08	1,086.87	7
Transformer	PLANNED OUTAGE	6/13/2023 14:02	457.47	4
Transformer	PLANNED OUTAGE	6/13/2023 14:20	50.00	4
Transformer	PLANNED OUTAGE	6/13/2023 14:36	1,338.00	10
Transformer	PLANNED OUTAGE	6/13/2023 15:43	89.65	3
Transformer	PLANNED OUTAGE	6/13/2023 17:35	17.48	1
Transformer	PLANNED OUTAGE	6/13/2023 18:28	24.93	2
Transformer	PLANNED OUTAGE	6/13/2023 23:10	76.40	6
Transformer	PLANNED OUTAGE	6/14/2023 3:37	231.70	3
Transformer	PLANNED OUTAGE	6/14/2023 8:39	1,159.43	14
Transformer	PLANNED OUTAGE	6/14/2023 8:41	348.83	7

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/14/2023 9:31	8.40	7
Transformer	PLANNED OUTAGE	6/14/2023 9:32	17.73	7
Transformer	PLANNED OUTAGE	6/14/2023 9:55	95.43	7
Transformer	PLANNED OUTAGE	6/14/2023 10:43	1,317.00	9
Transformer	PLANNED OUTAGE	6/14/2023 11:24	634.95	3
Transformer	PLANNED OUTAGE	6/14/2023 12:25	1,860.27	32
Transformer	PLANNED OUTAGE	6/14/2023 13:30	105.93	2
Transformer	PLANNED OUTAGE	6/14/2023 13:45	172.00	5
Primary Wire	PLANNED OUTAGE	6/14/2023 15:07	10,552.75	85
Primary Wire	PLANNED OUTAGE	6/14/2023 15:07	10,964.27	19
Transformer	PLANNED OUTAGE	6/14/2023 16:28	63.75	9
Transformer	PLANNED OUTAGE	6/14/2023 16:36	3,606.87	7
PLF	PLANNED OUTAGE	6/14/2023 17:28	252.83	1
Primary Wire	PLANNED OUTAGE	6/14/2023 19:02	4,834.90	14
PLF	PLANNED OUTAGE	6/14/2023 20:10	2,135.00	25
PLF	PLANNED OUTAGE	6/14/2023 20:16	1,598.67	20
PLF	PLANNED OUTAGE	6/14/2023 20:18	51.25	1
PLF	PLANNED OUTAGE	6/14/2023 20:19	49.67	1
Transformer	PLANNED OUTAGE	6/14/2023 20:29	494.27	8
Recloser	PLANNED OUTAGE	6/14/2023 22:39	2,177.45	321
PLF	PLANNED OUTAGE	6/14/2023 22:46	1.68	1
Switch	PLANNED OUTAGE	6/14/2023 23:37	455.43	2
PLF	PLANNED OUTAGE	6/15/2023 8:24	76.30	1
Transformer	PLANNED OUTAGE	6/15/2023 8:53	393.50	2
Transformer	PLANNED OUTAGE	6/15/2023 9:02	276.20	2
Transformer	PLANNED OUTAGE	6/15/2023 9:11	262.13	2
Recloser	PLANNED OUTAGE	6/15/2023 9:21	2,126.13	136
Transformer	PLANNED OUTAGE	6/15/2023 9:26	116.48	1
Transformer	PLANNED OUTAGE	6/15/2023 9:28	330.65	3
PLF	PLANNED OUTAGE	6/15/2023 9:40	1,054.17	5
PLF	PLANNED OUTAGE	6/15/2023 9:42	138.67	8
Transformer	PLANNED OUTAGE	6/15/2023 12:23	445.75	5
Transformer	PLANNED OUTAGE	6/15/2023 14:37	996.30	9
PLF	PLANNED OUTAGE	6/15/2023 18:19	1,424.85	7
Transformer	PLANNED OUTAGE	6/15/2023 23:43	108.35	1
Transformer	PLANNED OUTAGE	6/16/2023 0:55	179.80	3
UG Other	PLANNED OUTAGE	6/16/2023 6:18	308.60	4
PLF	PLANNED OUTAGE	6/16/2023 6:52	20.38	1
Transformer	PLANNED OUTAGE	6/16/2023 8:50	298.53	4
Transformer	PLANNED OUTAGE	6/16/2023 9:24	873.23	23
Transformer	PLANNED OUTAGE	6/16/2023 9:43	6,803.50	33
PLF	PLANNED OUTAGE	6/16/2023 9:53	68.57	1
PLF	PLANNED OUTAGE	6/16/2023 10:05	3,824.55	27

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/16/2023 11:39	222.80	4
Transformer	PLANNED OUTAGE	6/16/2023 12:10	99.40	7
Transformer	PLANNED OUTAGE	6/16/2023 12:48	871.00	10
Transformer	PLANNED OUTAGE	6/16/2023 13:25	31.58	1
Breaker	PLANNED OUTAGE	6/16/2023 16:09	4,640.00	960
Transformer	PLANNED OUTAGE	6/16/2023 16:54	946.27	8
Transformer	PLANNED OUTAGE	6/16/2023 16:57	1,383.10	6
Switch	PLANNED OUTAGE	6/16/2023 17:12	14,829.75	585
Switch	PLANNED OUTAGE	6/16/2023 19:24	35.42	1
Recloser	PLANNED OUTAGE	6/16/2023 19:34	2,610.07	49
Breaker	PLANNED OUTAGE	6/16/2023 19:34	11,769.55	247
Breaker	PLANNED OUTAGE	6/16/2023 19:34	27,816.25	595
Transformer	PLANNED OUTAGE	6/17/2023 7:27	864.93	4
Breaker	PLANNED OUTAGE	6/17/2023 8:03	1,794.33	5
Service point	PLANNED OUTAGE	6/17/2023 12:45	59.70	1
Transformer	PLANNED OUTAGE	6/17/2023 13:33	291.60	8
Transformer	PLANNED OUTAGE	6/17/2023 14:01	1,492.83	10
Transformer	PLANNED OUTAGE	6/17/2023 14:12	138.33	1
Transformer	PLANNED OUTAGE	6/17/2023 14:51	541.17	10
Transformer Bank	PLANNED OUTAGE	6/17/2023 16:00	50.33	5
Transformer	PLANNED OUTAGE	6/17/2023 16:00	10.50	1
Transformer	PLANNED OUTAGE	6/17/2023 18:53	22.50	3
Transformer	PLANNED OUTAGE	6/17/2023 18:53	203.65	3
Recloser	PLANNED OUTAGE	6/18/2023 0:41	98.87	4
Recloser	PLANNED OUTAGE	6/18/2023 0:41	23,675.10	954
Transformer	PLANNED OUTAGE	6/18/2023 3:27	1,453.80	6
Transformer	PLANNED OUTAGE	6/18/2023 3:27	690.15	3
Transformer	PLANNED OUTAGE	6/18/2023 3:28	2,742.80	12
Recloser	PLANNED OUTAGE	6/18/2023 4:23	1,230.57	551
Transformer	PLANNED OUTAGE	6/18/2023 11:35	206.83	2
PLF	PLANNED OUTAGE	6/18/2023 14:58	528.10	6
Transformer	PLANNED OUTAGE	6/18/2023 15:23	108.40	6
PLF	PLANNED OUTAGE	6/18/2023 15:52	369.50	5
Transformer	PLANNED OUTAGE	6/18/2023 17:28	121.80	6
PLF	PLANNED OUTAGE	6/19/2023 8:37	12,657.67	65
Transformer	PLANNED OUTAGE	6/19/2023 8:39	175.00	10
Transformer	PLANNED OUTAGE	6/19/2023 8:56	6.17	5
Transformer	PLANNED OUTAGE	6/19/2023 10:32	69.15	3
Transformer	PLANNED OUTAGE	6/19/2023 11:04	717.73	8
PLF	PLANNED OUTAGE	6/19/2023 13:21	21.73	1
Transformer	PLANNED OUTAGE	6/19/2023 13:25	531.87	8
Transformer	PLANNED OUTAGE	6/19/2023 13:28	158.30	3
UG Other	PLANNED OUTAGE	6/19/2023 17:42	28,141.12	29

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	6/19/2023 23:15	1,035.30	34
Transformer	PLANNED OUTAGE	6/20/2023 4:47	5,881.60	12
Transformer	PLANNED OUTAGE	6/20/2023 10:01	1,246.10	17
Transformer	PLANNED OUTAGE	6/20/2023 10:04	190.40	8
Transformer	PLANNED OUTAGE	6/20/2023 10:58	1,453.25	5
Transformer Bank	PLANNED OUTAGE	6/20/2023 11:25	96.48	7
Transformer Bank	PLANNED OUTAGE	6/20/2023 11:25	31.10	2
Transformer	PLANNED OUTAGE	6/20/2023 12:09	1,075.50	10
Transformer	PLANNED OUTAGE	6/20/2023 12:31	757.80	9
Transformer	PLANNED OUTAGE	6/20/2023 15:47	1,581.20	8
PLF	PLANNED OUTAGE	6/20/2023 16:40	439.17	1
Switch	PLANNED OUTAGE	6/20/2023 17:00	2,538.60	6
Transformer	PLANNED OUTAGE	6/20/2023 17:55	541.80	14
Transformer	PLANNED OUTAGE	6/20/2023 18:36	1,769.33	10
PLF	PLANNED OUTAGE	6/20/2023 18:36	2,482.60	12
PLF	PLANNED OUTAGE	6/20/2023 18:54	439.60	8
Breaker	PLANNED OUTAGE	6/20/2023 19:17	1,321.25	5
Transformer	PLANNED OUTAGE	6/20/2023 20:06	674.33	10
Breaker	PLANNED OUTAGE	6/20/2023 20:51	81,203.47	752
Transformer	PLANNED OUTAGE	6/20/2023 20:52	531.25	5
PLF	PLANNED OUTAGE	6/20/2023 23:38	30,512.78	73
PLF	PLANNED OUTAGE	6/20/2023 23:43	18,755.73	44
PLF	PLANNED OUTAGE	6/20/2023 23:45	18,039.93	43
Primary Wire	PLANNED OUTAGE	6/21/2023 7:44	1,863.40	4
Transformer	PLANNED OUTAGE	6/21/2023 9:42	1,203.73	16
PLF	PLANNED OUTAGE	6/21/2023 10:42	1,427.17	10
Transformer	PLANNED OUTAGE	6/21/2023 11:15	991.95	17
Transformer	PLANNED OUTAGE	6/21/2023 12:57	969.83	23
Transformer	PLANNED OUTAGE	6/21/2023 13:05	363.70	6
Transformer	PLANNED OUTAGE	6/21/2023 13:07	1,306.78	7
PLF	PLANNED OUTAGE	6/21/2023 13:09	85.00	10
Transformer	PLANNED OUTAGE	6/21/2023 13:21	293.00	6
Transformer	PLANNED OUTAGE	6/21/2023 14:19	37.27	1
Service point	PLANNED OUTAGE	6/21/2023 14:39	17.13	1
PLF	PLANNED OUTAGE	6/21/2023 14:42	302.57	29
Transformer	PLANNED OUTAGE	6/21/2023 15:00	239.80	6
Service point	PLANNED OUTAGE	6/21/2023 15:13	101.43	1
Breaker	PLANNED OUTAGE	6/21/2023 16:30	4,995.00	1332
Breaker	PLANNED OUTAGE	6/21/2023 16:30	5,108.75	1525
PLF	PLANNED OUTAGE	6/21/2023 18:27	223.57	1
Transformer	PLANNED OUTAGE	6/21/2023 21:17	428.80	6
PLF	PLANNED OUTAGE	6/21/2023 23:15	55.12	1
Transformer	PLANNED OUTAGE	6/22/2023 9:23	45.80	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	6/22/2023 9:35	1,494.00	6
PLF	PLANNED OUTAGE	6/22/2023 9:35	6,539.00	65
Transformer	PLANNED OUTAGE	6/22/2023 9:47	876.40	4
Transformer	PLANNED OUTAGE	6/22/2023 10:52	3,431.67	10
Transformer	PLANNED OUTAGE	6/22/2023 11:04	767.92	5
PLF	PLANNED OUTAGE	6/22/2023 11:06	26.17	2
PLF	PLANNED OUTAGE	6/22/2023 11:32	19.53	1
Transformer	PLANNED OUTAGE	6/22/2023 11:41	865.00	10
PLF	PLANNED OUTAGE	6/22/2023 11:58	39.73	2
Primary Wire	PLANNED OUTAGE	6/22/2023 13:51	183.83	10
Transformer	PLANNED OUTAGE	6/22/2023 14:33	438.97	2
Breaker	PLANNED OUTAGE	6/22/2023 14:59	36,468.37	2141
Transformer	PLANNED OUTAGE	6/22/2023 15:46	45.00	4
Transformer	PLANNED OUTAGE	6/22/2023 16:19	1,369.33	13
Transformer	PLANNED OUTAGE	6/22/2023 17:06	26.73	4
PLF	PLANNED OUTAGE	6/22/2023 17:58	677.73	4
Breaker	PLANNED OUTAGE	6/22/2023 18:57	148.52	7
Transformer	PLANNED OUTAGE	6/22/2023 19:06	145.25	7
Service point	PLANNED OUTAGE	6/22/2023 19:07	23.48	1
Breaker	PLANNED OUTAGE	6/22/2023 19:19	662.30	2
PLF	PLANNED OUTAGE	6/22/2023 19:21	229.05	1
Transformer	PLANNED OUTAGE	6/22/2023 19:28	20.07	7
Transformer	PLANNED OUTAGE	6/22/2023 19:31	15.40	7
PLF	PLANNED OUTAGE	6/22/2023 20:49	1,951.95	7
PLF	PLANNED OUTAGE	6/22/2023 21:10	296.50	1
PLF	PLANNED OUTAGE	6/22/2023 21:25	12.35	1
Recloser	PLANNED OUTAGE	6/22/2023 21:30	394.92	35
Transformer	PLANNED OUTAGE	6/22/2023 22:23	56.42	5
PLF	PLANNED OUTAGE	6/22/2023 22:26	367.47	1
Transformer	PLANNED OUTAGE	6/22/2023 22:59	33.37	2
PLF	PLANNED OUTAGE	6/22/2023 23:13	7.10	2
Transformer	PLANNED OUTAGE	6/23/2023 1:25	83.40	4
Switch	PLANNED OUTAGE	6/23/2023 2:22	148.15	1
Transformer	PLANNED OUTAGE	6/23/2023 2:34	245.10	3
Transformer	PLANNED OUTAGE	6/23/2023 3:26	3,116.75	7
Transformer Bank	PLANNED OUTAGE	6/23/2023 6:11	290.00	8
Transformer	PLANNED OUTAGE	6/23/2023 7:35	66.18	1
Transformer Bank	PLANNED OUTAGE	6/23/2023 8:06	356.17	2
Transformer	PLANNED OUTAGE	6/23/2023 8:59	1,199.00	15
Transformer	PLANNED OUTAGE	6/23/2023 9:07	99.10	6
PLF	PLANNED OUTAGE	6/23/2023 9:23	14.55	1
Transformer	PLANNED OUTAGE	6/23/2023 9:48	230.65	7
Transformer Bank	PLANNED OUTAGE	6/23/2023 10:51	94.13	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/23/2023 11:38	182.42	5
Transformer	PLANNED OUTAGE	6/23/2023 14:25	114.85	3
Transformer	PLANNED OUTAGE	6/23/2023 14:27	70.80	6
Breaker	PLANNED OUTAGE	6/23/2023 15:24	8,820.00	1960
Breaker	PLANNED OUTAGE	6/23/2023 15:30	4,631.37	1486
Transformer	PLANNED OUTAGE	6/23/2023 18:23	90.13	8
Transformer Bank	PLANNED OUTAGE	6/23/2023 20:24	122.77	2
PLF	PLANNED OUTAGE	6/23/2023 21:08	4,401.20	24
PLF	PLANNED OUTAGE	6/24/2023 12:10	563.75	11
Transformer	PLANNED OUTAGE	6/24/2023 13:20	98.97	2
Transformer	PLANNED OUTAGE	6/24/2023 16:07	207.25	1
Transformer	PLANNED OUTAGE	6/24/2023 16:10	1,382.53	4
Transformer	PLANNED OUTAGE	6/24/2023 18:29	379.68	1
Transformer	PLANNED OUTAGE	6/24/2023 18:46	367.03	1
PLF	PLANNED OUTAGE	6/24/2023 21:28	1,188.83	7
Transformer	PLANNED OUTAGE	6/25/2023 1:04	294.58	7
PLF	PLANNED OUTAGE	6/25/2023 7:33	534.77	1
PLF	PLANNED OUTAGE	6/25/2023 9:17	379.97	1
Transformer	PLANNED OUTAGE	6/25/2023 10:16	144.32	7
OH Other	PLANNED OUTAGE	6/25/2023 13:11	59.08	1
Transformer	PLANNED OUTAGE	6/25/2023 13:31	115.87	2
Transformer	PLANNED OUTAGE	6/25/2023 14:30	236.72	7
Transformer	PLANNED OUTAGE	6/25/2023 15:24	130.30	2
Breaker	PLANNED OUTAGE	6/25/2023 15:32	18,973.33	800
Switch	PLANNED OUTAGE	6/25/2023 17:40	15,707.90	258
Transformer	PLANNED OUTAGE	6/25/2023 18:49	1,086.30	9
Transformer	PLANNED OUTAGE	6/25/2023 20:50	10.95	9
Transformer	PLANNED OUTAGE	6/25/2023 20:50	16.65	9
Transformer	PLANNED OUTAGE	6/26/2023 0:29	9.78	1
Transformer	PLANNED OUTAGE	6/26/2023 8:16	441.75	5
PLF	PLANNED OUTAGE	6/26/2023 8:23	917.67	20
Transformer	PLANNED OUTAGE	6/26/2023 9:33	264.75	1
Transformer	PLANNED OUTAGE	6/26/2023 10:05	532.20	9
PLF	PLANNED OUTAGE	6/26/2023 10:12	19.27	1
PLF	PLANNED OUTAGE	6/26/2023 10:31	1.00	1
Switch	PLANNED OUTAGE	6/26/2023 10:42	312.00	2
Transformer	PLANNED OUTAGE	6/26/2023 11:28	687.68	11
Transformer	PLANNED OUTAGE	6/26/2023 12:41	234.67	5
Transformer	PLANNED OUTAGE	6/26/2023 13:14	335.53	7
Transformer	PLANNED OUTAGE	6/26/2023 13:15	219.60	2
PLF	PLANNED OUTAGE	6/26/2023 13:41	313.67	10
Transformer	PLANNED OUTAGE	6/26/2023 14:26	133.95	3
Transformer	PLANNED OUTAGE	6/26/2023 14:55	8.70	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/26/2023 15:36	22.83	1
Transformer	PLANNED OUTAGE	6/26/2023 18:46	353.47	11
PLF	PLANNED OUTAGE	6/26/2023 22:18	2,149.77	11
PLF	PLANNED OUTAGE	6/27/2023 0:46	144.15	3
Transformer	PLANNED OUTAGE	6/27/2023 6:03	440.42	5
Transformer	PLANNED OUTAGE	6/27/2023 8:21	1,107.80	3
Transformer	PLANNED OUTAGE	6/27/2023 8:48	265.65	1
Transformer	PLANNED OUTAGE	6/27/2023 9:28	670.17	10
Recloser	PLANNED OUTAGE	6/27/2023 9:38	159.10	3
PLF	PLANNED OUTAGE	6/27/2023 9:49	170.80	1
PLF	PLANNED OUTAGE	6/27/2023 10:56	179.13	1
PLF	PLANNED OUTAGE	6/27/2023 11:04	20.33	1
PLF	PLANNED OUTAGE	6/27/2023 11:43	322.95	1
Transformer	PLANNED OUTAGE	6/27/2023 11:54	332.83	10
PLF	PLANNED OUTAGE	6/27/2023 12:18	6.60	4
Transformer	PLANNED OUTAGE	6/27/2023 13:09	660.80	8
Transformer	PLANNED OUTAGE	6/27/2023 13:13	620.10	6
Transformer	PLANNED OUTAGE	6/27/2023 13:55	1,000.80	9
Transformer	PLANNED OUTAGE	6/27/2023 15:19	211.08	5
Transformer Bank	PLANNED OUTAGE	6/27/2023 15:58	47.77	1
Transformer	PLANNED OUTAGE	6/27/2023 16:18	105.23	7
UG Other	PLANNED OUTAGE	6/27/2023 16:52	1,665.73	52
Transformer Bank	PLANNED OUTAGE	6/27/2023 17:09	34.88	1
PLF	PLANNED OUTAGE	6/27/2023 17:28	2,910.27	52
Transformer	PLANNED OUTAGE	6/27/2023 22:03	1,957.25	15
Transformer	PLANNED OUTAGE	6/28/2023 1:10	335.77	1
Transformer	PLANNED OUTAGE	6/28/2023 1:48	250.50	5
Switch	PLANNED OUTAGE	6/28/2023 4:31	2,675.40	1029
Transformer	PLANNED OUTAGE	6/28/2023 5:09	21.63	2
Transformer	PLANNED OUTAGE	6/28/2023 8:04	994.13	32
Transformer	PLANNED OUTAGE	6/28/2023 8:35	3,006.20	6
Transformer	PLANNED OUTAGE	6/28/2023 8:36	654.15	9
Transformer	PLANNED OUTAGE	6/28/2023 8:52	3,689.85	9
Transformer	PLANNED OUTAGE	6/28/2023 8:58	2,953.00	6
Transformer	PLANNED OUTAGE	6/28/2023 9:20	608.40	4
Transformer	PLANNED OUTAGE	6/28/2023 9:54	657.42	5
Transformer	PLANNED OUTAGE	6/28/2023 9:55	759.20	8
Transformer	PLANNED OUTAGE	6/28/2023 10:00	3,890.00	15
Transformer Bank	PLANNED OUTAGE	6/28/2023 10:08	45.03	2
Transformer	PLANNED OUTAGE	6/28/2023 10:41	565.47	8
PLF	PLANNED OUTAGE	6/28/2023 11:11	939.43	2
Transformer	PLANNED OUTAGE	6/28/2023 11:33	322.10	3
Transformer	PLANNED OUTAGE	6/28/2023 13:24	494.00	6

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/28/2023 13:24	656.67	8
PLF	PLANNED OUTAGE	6/28/2023 15:51	95.13	4
Transformer Bank	PLANNED OUTAGE	6/28/2023 16:37	83.75	3
Transformer	PLANNED OUTAGE	6/28/2023 17:43	46.20	1
Transformer	PLANNED OUTAGE	6/28/2023 21:38	404.95	7
PLF	PLANNED OUTAGE	6/29/2023 3:03	218.63	2
Transformer	PLANNED OUTAGE	6/29/2023 5:57	682.30	6
Transformer	PLANNED OUTAGE	6/29/2023 8:53	641.43	2
Transformer Bank	PLANNED OUTAGE	6/29/2023 9:09	971.33	10
Transformer	PLANNED OUTAGE	6/29/2023 9:11	514.80	8
PLF	PLANNED OUTAGE	6/29/2023 9:30	705.03	13
Transformer Bank	PLANNED OUTAGE	6/29/2023 9:45	247.85	1
Transformer	PLANNED OUTAGE	6/29/2023 9:47	16.23	1
Transformer	PLANNED OUTAGE	6/29/2023 10:13	489.83	10
PLF	PLANNED OUTAGE	6/29/2023 10:15	213.63	2
PLF	PLANNED OUTAGE	6/29/2023 10:48	264.20	1
Transformer	PLANNED OUTAGE	6/29/2023 11:14	235.00	4
Transformer	PLANNED OUTAGE	6/29/2023 13:42	24.05	1
PLF	PLANNED OUTAGE	6/29/2023 14:05	324.70	17
PLF	PLANNED OUTAGE	6/29/2023 15:26	351.80	12
Transformer	PLANNED OUTAGE	6/29/2023 15:40	61.85	3
Transformer	PLANNED OUTAGE	6/29/2023 15:41	1,755.00	13
Transformer	PLANNED OUTAGE	6/29/2023 18:17	31.53	1
Transformer Bank	PLANNED OUTAGE	6/29/2023 18:21	164.15	3
Transformer Bank	PLANNED OUTAGE	6/29/2023 19:44	98.63	2
PLF	PLANNED OUTAGE	6/29/2023 21:57	151.37	1
PLF	PLANNED OUTAGE	6/29/2023 21:58	860.37	53
Recloser	PLANNED OUTAGE	6/29/2023 22:06	2,669.15	759
Recloser	PLANNED OUTAGE	6/29/2023 22:06	4.68	1
Recloser	PLANNED OUTAGE	6/29/2023 22:06	4.78	1
Recloser	PLANNED OUTAGE	6/29/2023 22:06	4.88	1
Recloser	PLANNED OUTAGE	6/29/2023 22:06	5.05	1
Recloser	PLANNED OUTAGE	6/29/2023 22:06	4.97	1
Recloser	PLANNED OUTAGE	6/29/2023 22:06	5.12	1
PLF	PLANNED OUTAGE	6/29/2023 22:20	726.25	5
Transformer	PLANNED OUTAGE	6/29/2023 22:21	1,380.25	15
Breaker	PLANNED OUTAGE	6/30/2023 4:25	35,624.63	1283
Breaker	PLANNED OUTAGE	6/30/2023 4:55	6,648.17	1130
Transformer Bank	PLANNED OUTAGE	6/30/2023 7:12	342.13	8
PLF	PLANNED OUTAGE	6/30/2023 9:14	351.75	3
Transformer	PLANNED OUTAGE	6/30/2023 9:14	1,674.33	10
PLF	PLANNED OUTAGE	6/30/2023 9:36	321.60	6
PLF	PLANNED OUTAGE	6/30/2023 9:55	1,000.67	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	6/30/2023 19:30	41.80	1
Transformer	PLANNED OUTAGE	7/1/2023 1:32	1,029.23	7
Transformer	PLANNED OUTAGE	7/1/2023 4:11	134.13	4
Transformer Bank	PLANNED OUTAGE	7/1/2023 5:09	1,454.83	7
PLF	PLANNED OUTAGE	7/1/2023 11:27	3,584.73	34
Transformer	PLANNED OUTAGE	7/1/2023 11:51	355.47	4
Recloser	PLANNED OUTAGE	7/1/2023 13:32	10,923.63	629
Recloser	PLANNED OUTAGE	7/1/2023 13:32	25.85	1
Recloser	PLANNED OUTAGE	7/1/2023 13:52	351.13	92
PLF	PLANNED OUTAGE	7/1/2023 13:52	253.00	66
Transformer	PLANNED OUTAGE	7/1/2023 13:58	922.33	4
Transformer Bank	PLANNED OUTAGE	7/1/2023 20:08	391.97	11
Transformer	PLANNED OUTAGE	7/2/2023 18:30	8,949.42	55
OH Other	PLANNED OUTAGE	7/2/2023 20:02	1,977.42	61
OH Other	PLANNED OUTAGE	7/2/2023 20:02	474.67	16
Transformer	PLANNED OUTAGE	7/2/2023 22:12	1,592.13	8
PLF	PLANNED OUTAGE	7/2/2023 23:22	149.87	2
Transformer	PLANNED OUTAGE	7/3/2023 4:33	393.87	8
PLF	PLANNED OUTAGE	7/3/2023 8:43	121.08	1
Transformer	PLANNED OUTAGE	7/3/2023 8:46	119.60	1
Transformer	PLANNED OUTAGE	7/3/2023 8:55	558.90	9
Transformer	PLANNED OUTAGE	7/3/2023 10:11	285.67	5
Switch	PLANNED OUTAGE	7/3/2023 10:55	480.02	1
PLF	PLANNED OUTAGE	7/3/2023 15:33	448.70	21
Transformer	PLANNED OUTAGE	7/3/2023 17:59	3,229.92	7
Transformer	PLANNED OUTAGE	7/3/2023 17:59	2,771.50	6
Transformer	PLANNED OUTAGE	7/3/2023 17:59	5,437.20	23
Switch	PLANNED OUTAGE	7/3/2023 20:48	205.00	6
PLF	PLANNED OUTAGE	7/3/2023 23:15	275.02	1
PLF	PLANNED OUTAGE	7/3/2023 23:31	1,343.10	6
Transformer	PLANNED OUTAGE	7/4/2023 7:57	73.70	6
PLF	PLANNED OUTAGE	7/4/2023 10:29	14.00	1
Breaker	PLANNED OUTAGE	7/4/2023 11:34	15,882.77	1583
Transformer	PLANNED OUTAGE	7/4/2023 17:16	1,172.08	5
PLF	PLANNED OUTAGE	7/4/2023 17:17	4,298.20	12
PLF	PLANNED OUTAGE	7/4/2023 17:27	1,069.20	3
Transformer	PLANNED OUTAGE	7/4/2023 18:17	100.03	2
Transformer	PLANNED OUTAGE	7/4/2023 22:29	1,066.33	20
Transformer	PLANNED OUTAGE	7/5/2023 8:15	3,711.63	14
Transformer	PLANNED OUTAGE	7/5/2023 8:44	159.87	4
PLF	PLANNED OUTAGE	7/5/2023 9:16	701.87	7
PLF	PLANNED OUTAGE	7/5/2023 9:16	838.13	8
PLF	PLANNED OUTAGE	7/5/2023 9:30	62.80	4

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/5/2023 9:37	512.53	8
Transformer	PLANNED OUTAGE	7/5/2023 11:23	1,371.25	15
Transformer	PLANNED OUTAGE	7/5/2023 11:40	739.60	6
Transformer	PLANNED OUTAGE	7/5/2023 12:00	660.80	6
Transformer	PLANNED OUTAGE	7/5/2023 18:14	69.90	6
Transformer	PLANNED OUTAGE	7/5/2023 23:17	209.00	3
Transformer	PLANNED OUTAGE	7/5/2023 23:17	1,715.40	27
Transformer	PLANNED OUTAGE	7/5/2023 23:35	1,317.67	5
Breaker	PLANNED OUTAGE	7/6/2023 7:45	4,171.20	792
Transformer	PLANNED OUTAGE	7/6/2023 9:02	104.40	3
PLF	PLANNED OUTAGE	7/6/2023 9:20	360.10	1
Transformer	PLANNED OUTAGE	7/6/2023 9:40	843.33	8
Transformer	PLANNED OUTAGE	7/6/2023 9:43	7,059.90	18
Transformer	PLANNED OUTAGE	7/6/2023 9:54	311.25	3
Transformer	PLANNED OUTAGE	7/6/2023 10:24	1,386.50	5
Service point	PLANNED OUTAGE	7/6/2023 11:06	203.13	1
Transformer	PLANNED OUTAGE	7/6/2023 11:53	30.30	6
Transformer	PLANNED OUTAGE	7/6/2023 11:54	952.67	10
Transformer	PLANNED OUTAGE	7/6/2023 12:15	19.70	3
Transformer	PLANNED OUTAGE	7/6/2023 12:29	13,869.87	32
Transformer	PLANNED OUTAGE	7/6/2023 12:42	172.33	4
PLF	PLANNED OUTAGE	7/6/2023 13:45	51.55	1
PLF	PLANNED OUTAGE	7/6/2023 13:47	1,714.00	120
PLF	PLANNED OUTAGE	7/6/2023 13:47	49.52	1
Transformer	PLANNED OUTAGE	7/6/2023 14:25	457.02	17
Primary Wire	PLANNED OUTAGE	7/6/2023 15:42	36,662.90	687
Primary Wire	PLANNED OUTAGE	7/6/2023 16:23	13,029.50	1265
Breaker	PLANNED OUTAGE	7/6/2023 16:23	10,466.30	1079
Transformer	PLANNED OUTAGE	7/6/2023 16:33	246.35	1
PLF	PLANNED OUTAGE	7/6/2023 17:52	4,233.00	17
Transformer Bank	PLANNED OUTAGE	7/6/2023 20:42	339.30	13
Transformer	PLANNED OUTAGE	7/7/2023 8:11	41.75	5
Transformer	PLANNED OUTAGE	7/7/2023 8:22	107.53	4
Transformer	PLANNED OUTAGE	7/7/2023 9:12	296.33	5
Transformer	PLANNED OUTAGE	7/7/2023 9:24	1,048.80	8
Transformer	PLANNED OUTAGE	7/7/2023 9:26	910.58	7
Service point	PLANNED OUTAGE	7/7/2023 9:35	43.18	1
Transformer	PLANNED OUTAGE	7/7/2023 9:56	617.70	9
Transformer Bank	PLANNED OUTAGE	7/7/2023 9:56	168.67	2
Transformer	PLANNED OUTAGE	7/7/2023 10:00	342.85	3
Transformer	PLANNED OUTAGE	7/7/2023 10:02	94.13	1
Transformer	PLANNED OUTAGE	7/7/2023 10:10	35.43	1
Transformer Bank	PLANNED OUTAGE	7/7/2023 12:00	492.40	12

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/7/2023 12:10	708.40	8
Transformer	PLANNED OUTAGE	7/7/2023 12:13	666.00	8
Breaker	PLANNED OUTAGE	7/7/2023 12:35	9,954.00	1512
Transformer	PLANNED OUTAGE	7/7/2023 12:51	885.90	9
Transformer	PLANNED OUTAGE	7/7/2023 13:13	15.37	2
Transformer	PLANNED OUTAGE	7/7/2023 14:47	636.00	12
PLF	PLANNED OUTAGE	7/7/2023 15:25	952.93	4
PLF	PLANNED OUTAGE	7/7/2023 21:32	37.80	3
Switch	PLANNED OUTAGE	7/8/2023 5:04	1,889.07	64
Transformer	PLANNED OUTAGE	7/8/2023 7:11	23.83	2
Transformer	PLANNED OUTAGE	7/8/2023 8:28	1,688.40	7
Transformer	PLANNED OUTAGE	7/8/2023 9:30	125.33	5
Transformer	PLANNED OUTAGE	7/8/2023 14:12	191.70	1
Transformer	PLANNED OUTAGE	7/8/2023 14:38	2,390.85	11
Transformer	PLANNED OUTAGE	7/8/2023 14:41	915.13	7
Transformer	PLANNED OUTAGE	7/8/2023 15:41	299.75	11
Transformer	PLANNED OUTAGE	7/8/2023 16:50	308.33	10
PLF	PLANNED OUTAGE	7/8/2023 17:46	53.07	4
Transformer	PLANNED OUTAGE	7/8/2023 18:58	668.00	6
Transformer	PLANNED OUTAGE	7/8/2023 20:50	11.90	6
Transformer	PLANNED OUTAGE	7/8/2023 23:01	19.25	3
Transformer	PLANNED OUTAGE	7/9/2023 1:19	46.37	2
Transformer	PLANNED OUTAGE	7/9/2023 6:30	52.13	2
Transformer	PLANNED OUTAGE	7/9/2023 13:58	31.03	1
Transformer	PLANNED OUTAGE	7/9/2023 14:44	210.05	3
PLF	PLANNED OUTAGE	7/9/2023 15:04	2,304.38	19
Transformer	PLANNED OUTAGE	7/9/2023 15:57	52.93	2
Transformer	PLANNED OUTAGE	7/9/2023 17:49	533.52	7
Transformer	PLANNED OUTAGE	7/9/2023 21:13	4,546.13	16
Transformer	PLANNED OUTAGE	7/9/2023 22:05	1,072.87	7
Transformer	PLANNED OUTAGE	7/9/2023 22:42	82.32	1
Transformer	PLANNED OUTAGE	7/10/2023 2:50	505.35	9
PLF	PLANNED OUTAGE	7/10/2023 8:39	1,388.10	14
PLF	PLANNED OUTAGE	7/10/2023 9:02	156.03	2
Transformer	PLANNED OUTAGE	7/10/2023 9:18	1,262.17	10
Transformer	PLANNED OUTAGE	7/10/2023 9:19	1,151.20	12
Transformer Bank	PLANNED OUTAGE	7/10/2023 9:26	650.65	11
Transformer	PLANNED OUTAGE	7/10/2023 9:31	909.88	11
Transformer	PLANNED OUTAGE	7/10/2023 9:34	633.73	7
Transformer	PLANNED OUTAGE	7/10/2023 9:38	76.88	1
Transformer	PLANNED OUTAGE	7/10/2023 9:49	30.67	10
Transformer	PLANNED OUTAGE	7/10/2023 9:52	942.67	10
Transformer	PLANNED OUTAGE	7/10/2023 10:56	599.55	7

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/10/2023 11:16	776.25	9
Transformer	PLANNED OUTAGE	7/10/2023 11:18	278.80	12
Primary Wire	PLANNED OUTAGE	7/10/2023 11:25	815.92	5
Transformer	PLANNED OUTAGE	7/10/2023 11:53	498.00	8
Transformer	PLANNED OUTAGE	7/10/2023 12:15	84.30	2
Transformer	PLANNED OUTAGE	7/10/2023 12:57	53.38	1
Transformer	PLANNED OUTAGE	7/10/2023 13:01	364.20	6
Transformer	PLANNED OUTAGE	7/10/2023 13:13	306.23	2
Transformer	PLANNED OUTAGE	7/10/2023 13:24	122.90	2
Transformer	PLANNED OUTAGE	7/10/2023 13:29	543.17	5
Transformer	PLANNED OUTAGE	7/10/2023 14:40	21.87	8
Transformer	PLANNED OUTAGE	7/10/2023 15:39	231.10	6
PLF	PLANNED OUTAGE	7/10/2023 17:49	191.95	3
PLF	PLANNED OUTAGE	7/10/2023 19:11	36.20	4
Transformer	PLANNED OUTAGE	7/10/2023 19:22	1,186.67	25
PLF	PLANNED OUTAGE	7/10/2023 19:36	784.55	3
Transformer	PLANNED OUTAGE	7/10/2023 20:37	118.60	1
Transformer	PLANNED OUTAGE	7/10/2023 20:54	9,798.58	31
Breaker	PLANNED OUTAGE	7/10/2023 21:03	6,362.93	3568
Primary Wire	PLANNED OUTAGE	7/10/2023 21:15	1,091.50	6
Transformer	PLANNED OUTAGE	7/10/2023 21:57	1,965.87	8
Primary Wire	PLANNED OUTAGE	7/11/2023 1:50	5,066.60	21
Transformer	PLANNED OUTAGE	7/11/2023 5:30	206.67	4
PLF	PLANNED OUTAGE	7/11/2023 8:44	1,110.90	63
PLF	PLANNED OUTAGE	7/11/2023 8:46	61.33	4
Service point	PLANNED OUTAGE	7/11/2023 8:54	10.05	1
Transformer	PLANNED OUTAGE	7/11/2023 9:27	2,994.00	36
Transformer	PLANNED OUTAGE	7/11/2023 10:03	1,903.63	23
Transformer	PLANNED OUTAGE	7/11/2023 10:11	322.27	8
Transformer	PLANNED OUTAGE	7/11/2023 10:41	374.27	4
Transformer	PLANNED OUTAGE	7/11/2023 11:11	261.07	8
Transformer	PLANNED OUTAGE	7/11/2023 11:52	341.37	11
Transformer	PLANNED OUTAGE	7/11/2023 11:55	613.82	13
Transformer	PLANNED OUTAGE	7/11/2023 12:05	149.23	11
Transformer	PLANNED OUTAGE	7/11/2023 12:14	1,038.67	16
PLF	PLANNED OUTAGE	7/11/2023 14:08	7,821.67	65
PLF	PLANNED OUTAGE	7/11/2023 15:40	1,284.97	7
Primary Wire	PLANNED OUTAGE	7/12/2023 8:50	5,145.17	10
Transformer	PLANNED OUTAGE	7/12/2023 9:06	386.85	9
Transformer Bank	PLANNED OUTAGE	7/12/2023 9:08	163.48	1
Transformer	PLANNED OUTAGE	7/12/2023 9:17	1,136.00	4
Transformer	PLANNED OUTAGE	7/12/2023 9:34	427.80	9
PLF	PLANNED OUTAGE	7/12/2023 9:36	651.10	6

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/12/2023 10:00	111.50	10
Transformer	PLANNED OUTAGE	7/12/2023 10:44	456.50	6
Transformer	PLANNED OUTAGE	7/12/2023 11:20	975.45	7
Transformer	PLANNED OUTAGE	7/12/2023 11:20	1,360.33	11
Transformer	PLANNED OUTAGE	7/12/2023 11:57	353.80	6
PLF	PLANNED OUTAGE	7/12/2023 12:00	1,467.00	15
Transformer	PLANNED OUTAGE	7/12/2023 12:34	380.67	8
Transformer	PLANNED OUTAGE	7/12/2023 13:39	115.38	7
Transformer	PLANNED OUTAGE	7/12/2023 13:46	348.78	1
PLF	PLANNED OUTAGE	7/12/2023 16:06	1,399.47	64
PLF	PLANNED OUTAGE	7/12/2023 16:14	371.13	1
Transformer	PLANNED OUTAGE	7/12/2023 17:25	73.45	1
Transformer	PLANNED OUTAGE	7/12/2023 17:25	73.17	1
Transformer	PLANNED OUTAGE	7/12/2023 22:21	190.95	9
Transformer	PLANNED OUTAGE	7/12/2023 23:44	253.80	4
Transformer	PLANNED OUTAGE	7/13/2023 5:12	67.90	2
Transformer	PLANNED OUTAGE	7/13/2023 5:33	308.13	4
Transformer Bank	PLANNED OUTAGE	7/13/2023 7:48	145.20	3
Transformer	PLANNED OUTAGE	7/13/2023 9:24	344.70	9
Transformer	PLANNED OUTAGE	7/13/2023 9:28	573.07	7
Transformer	PLANNED OUTAGE	7/13/2023 9:45	734.43	11
Transformer	PLANNED OUTAGE	7/13/2023 9:50	1,364.35	13
PLF	PLANNED OUTAGE	7/13/2023 10:47	1,274.40	24
Transformer Bank	PLANNED OUTAGE	7/13/2023 11:06	237.83	10
Transformer	PLANNED OUTAGE	7/13/2023 11:19	2,333.33	16
Transformer	PLANNED OUTAGE	7/13/2023 11:30	95.55	7
Transformer	PLANNED OUTAGE	7/13/2023 12:35	652.80	12
Transformer	PLANNED OUTAGE	7/13/2023 12:39	201.30	3
Transformer	PLANNED OUTAGE	7/13/2023 14:51	491.60	8
Transformer	PLANNED OUTAGE	7/13/2023 15:06	504.62	13
PLF	PLANNED OUTAGE	7/13/2023 16:13	50.83	1
Transformer	PLANNED OUTAGE	7/13/2023 17:59	140.72	1
PLF	PLANNED OUTAGE	7/13/2023 18:18	12,741.33	40
PLF	PLANNED OUTAGE	7/13/2023 19:11	4,306.87	28
PLF	PLANNED OUTAGE	7/13/2023 19:54	3,423.73	148
Service point	PLANNED OUTAGE	7/13/2023 19:58	1.72	1
Transformer	PLANNED OUTAGE	7/13/2023 23:19	223.33	10
Transformer	PLANNED OUTAGE	7/14/2023 7:55	72.67	4
PLF	PLANNED OUTAGE	7/14/2023 9:24	487.77	2
PLF	PLANNED OUTAGE	7/14/2023 10:02	48.20	1
Transformer	PLANNED OUTAGE	7/14/2023 12:17	3,510.25	15
Transformer	PLANNED OUTAGE	7/14/2023 14:40	67.70	2
Transformer	PLANNED OUTAGE	7/14/2023 14:51	782.50	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/14/2023 19:34	2,527.20	13
Transformer	PLANNED OUTAGE	7/14/2023 19:35	2,539.55	13
Recloser	PLANNED OUTAGE	7/14/2023 22:12	5,292.97	97
Breaker	PLANNED OUTAGE	7/14/2023 22:12	48.37	1
Breaker	PLANNED OUTAGE	7/14/2023 22:12	78,383.80	1804
Breaker	PLANNED OUTAGE	7/14/2023 22:12	63.22	1
Breaker	PLANNED OUTAGE	7/14/2023 22:59	3,300.27	208
Breaker	PLANNED OUTAGE	7/14/2023 22:59	126.93	8
Transformer	PLANNED OUTAGE	7/14/2023 23:23	464.25	9
Transformer	PLANNED OUTAGE	7/15/2023 0:15	15.90	9
Transformer	PLANNED OUTAGE	7/15/2023 5:16	355.73	2
Transformer Bank	PLANNED OUTAGE	7/15/2023 15:19	657.00	10
Transformer	PLANNED OUTAGE	7/15/2023 15:37	565.93	13
Primary Wire	PLANNED OUTAGE	7/15/2023 17:44	377.30	1
PLF	PLANNED OUTAGE	7/15/2023 18:14	177.80	3
Breaker	PLANNED OUTAGE	7/16/2023 11:37	2,767.50	82
Breaker	PLANNED OUTAGE	7/16/2023 11:38	38,918.00	1220
Recloser	PLANNED OUTAGE	7/16/2023 11:38	230.65	7
Breaker	PLANNED OUTAGE	7/16/2023 11:38	14,752.00	461
Breaker	PLANNED OUTAGE	7/16/2023 11:38	32.00	1
Transformer	PLANNED OUTAGE	7/16/2023 12:11	96.93	4
Transformer	PLANNED OUTAGE	7/16/2023 12:36	48.20	4
Transformer	PLANNED OUTAGE	7/16/2023 13:00	42.80	4
Transformer	PLANNED OUTAGE	7/16/2023 13:11	43.87	4
Transformer	PLANNED OUTAGE	7/16/2023 13:22	23.57	2
Transformer	PLANNED OUTAGE	7/16/2023 13:57	60.27	4
Transformer	PLANNED OUTAGE	7/16/2023 14:39	170.70	3
PLF	PLANNED OUTAGE	7/16/2023 14:48	49.20	4
Transformer	PLANNED OUTAGE	7/16/2023 15:41	16.98	1
Transformer	PLANNED OUTAGE	7/16/2023 16:01	2,255.00	5
Service point	PLANNED OUTAGE	7/16/2023 19:24	251.27	1
PLF	PLANNED OUTAGE	7/16/2023 19:59	1,866.13	16
Transformer	PLANNED OUTAGE	7/16/2023 21:50	70.52	1
Service point	PLANNED OUTAGE	7/16/2023 23:18	12.97	1
Service point	PLANNED OUTAGE	7/16/2023 23:18	13.93	1
PLF	PLANNED OUTAGE	7/17/2023 2:13	5,681.33	40
PLF	PLANNED OUTAGE	7/17/2023 4:40	12,949.33	40
Transformer	PLANNED OUTAGE	7/17/2023 9:39	3,824.80	12
Transformer	PLANNED OUTAGE	7/17/2023 10:52	2,207.92	25
Transformer	PLANNED OUTAGE	7/17/2023 14:42	1,061.93	4
PLF	PLANNED OUTAGE	7/17/2023 16:54	5,937.50	10
Transformer	PLANNED OUTAGE	7/17/2023 17:35	99.47	4
Primary Wire	PLANNED OUTAGE	7/17/2023 21:06	493.00	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	7/18/2023 7:58	2,461.05	9
PLF	PLANNED OUTAGE	7/18/2023 8:29	426.70	2
Transformer	PLANNED OUTAGE	7/18/2023 8:51	694.98	7
Transformer	PLANNED OUTAGE	7/18/2023 9:05	377.00	6
Breaker	PLANNED OUTAGE	7/18/2023 9:49	10.97	1
Breaker	PLANNED OUTAGE	7/18/2023 9:49	11,050.67	1184
Breaker	PLANNED OUTAGE	7/18/2023 9:49	11.00	1
Breaker	PLANNED OUTAGE	7/18/2023 9:49	11.05	1
Breaker	PLANNED OUTAGE	7/18/2023 9:49	11.10	1
Breaker	PLANNED OUTAGE	7/18/2023 9:49	11.17	1
Primary Wire	PLANNED OUTAGE	7/18/2023 10:07	235.13	1
Transformer	PLANNED OUTAGE	7/18/2023 10:30	718.50	9
Transformer	PLANNED OUTAGE	7/18/2023 11:05	765.60	6
PLF	PLANNED OUTAGE	7/18/2023 11:13	7,094.17	50
Transformer	PLANNED OUTAGE	7/18/2023 11:52	806.60	12
Transformer	PLANNED OUTAGE	7/18/2023 12:07	793.47	8
Transformer	PLANNED OUTAGE	7/18/2023 12:14	554.53	8
Transformer	PLANNED OUTAGE	7/18/2023 12:24	29.33	4
PLF	PLANNED OUTAGE	7/18/2023 19:19	8,303.17	22
PLF	PLANNED OUTAGE	7/18/2023 19:34	25.90	3
Breaker	PLANNED OUTAGE	7/18/2023 20:13	147.17	2
Transformer	PLANNED OUTAGE	7/18/2023 21:28	485.40	9
Transformer	PLANNED OUTAGE	7/19/2023 8:35	1,089.33	10
OH Other	PLANNED OUTAGE	7/19/2023 8:50	5,014.00	30
Transformer	PLANNED OUTAGE	7/19/2023 9:05	281.57	2
OH Other	PLANNED OUTAGE	7/19/2023 9:37	720.77	7
Transformer	PLANNED OUTAGE	7/19/2023 9:44	51.13	1
Transformer	PLANNED OUTAGE	7/19/2023 9:50	1,908.60	6
OH Other	PLANNED OUTAGE	7/19/2023 10:21	262.93	32
Service point	PLANNED OUTAGE	7/19/2023 12:00	23.20	1
OH Other	PLANNED OUTAGE	7/19/2023 12:02	1,131.67	20
Transformer	PLANNED OUTAGE	7/19/2023 12:16	145.33	2
Service point	PLANNED OUTAGE	7/19/2023 12:35	1.13	1
Transformer	PLANNED OUTAGE	7/19/2023 12:40	179.47	8
Transformer	PLANNED OUTAGE	7/19/2023 13:37	1,401.50	30
Transformer Bank	PLANNED OUTAGE	7/19/2023 14:21	111.50	6
OH Other	PLANNED OUTAGE	7/19/2023 15:18	3,474.75	123
OH Other	PLANNED OUTAGE	7/19/2023 15:46	3.70	1
Transformer	PLANNED OUTAGE	7/19/2023 19:00	342.13	1
Switch 600 amp	PLANNED OUTAGE	7/19/2023 20:18	1,046.85	1
OH Other	PLANNED OUTAGE	7/19/2023 21:06	12,653.55	117
Breaker	PLANNED OUTAGE	7/19/2023 21:26	12,288.90	2691
PLF	PLANNED OUTAGE	7/19/2023 21:52	2,988.88	187

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	7/19/2023 22:17	39,507.60	1752
Primary Wire	PLANNED OUTAGE	7/19/2023 22:51	461.60	6
PLF	PLANNED OUTAGE	7/19/2023 22:51	7,683.33	100
PLF	PLANNED OUTAGE	7/19/2023 22:52	76.38	1
Transformer	PLANNED OUTAGE	7/19/2023 23:48	494.63	11
Transformer	PLANNED OUTAGE	7/20/2023 0:15	219.87	8
Service point	PLANNED OUTAGE	7/20/2023 0:15	56.08	1
Transformer	PLANNED OUTAGE	7/20/2023 0:26	15.23	1
Transformer	PLANNED OUTAGE	7/20/2023 0:40	13.30	7
Transformer Bank	PLANNED OUTAGE	7/20/2023 2:23	338.40	4
Transformer	PLANNED OUTAGE	7/20/2023 5:44	3,678.77	11
PLF	PLANNED OUTAGE	7/20/2023 8:21	515.70	6
Transformer	PLANNED OUTAGE	7/20/2023 8:42	912.30	6
PLF	PLANNED OUTAGE	7/20/2023 9:32	332.62	1
Primary Wire	PLANNED OUTAGE	7/20/2023 9:45	2,046.65	3
Transformer	PLANNED OUTAGE	7/20/2023 9:59	336.20	6
Transformer	PLANNED OUTAGE	7/20/2023 10:13	2,133.27	11
PLF	PLANNED OUTAGE	7/20/2023 10:47	5,840.60	53
Primary Wire	PLANNED OUTAGE	7/20/2023 11:45	6,374.18	19
PLF	PLANNED OUTAGE	7/20/2023 11:51	271.05	3
Transformer Bank	PLANNED OUTAGE	7/20/2023 12:00	283.33	5
Transformer	PLANNED OUTAGE	7/20/2023 12:29	242.90	14
PLF	PLANNED OUTAGE	7/20/2023 13:08	8.52	1
PLF	PLANNED OUTAGE	7/20/2023 13:08	8.33	1
PLF	PLANNED OUTAGE	7/20/2023 13:08	1,234.92	145
Transformer	PLANNED OUTAGE	7/20/2023 13:18	212.85	11
Transformer	PLANNED OUTAGE	7/20/2023 13:28	44.50	6
Transformer	PLANNED OUTAGE	7/20/2023 14:08	873.87	8
Transformer	PLANNED OUTAGE	7/20/2023 15:22	1,176.13	4
PLF	PLANNED OUTAGE	7/20/2023 16:35	4,771.20	36
Breaker	PLANNED OUTAGE	7/20/2023 18:04	34,006.60	1158
PLF	PLANNED OUTAGE	7/20/2023 18:28	881.50	10
Recloser	PLANNED OUTAGE	7/20/2023 21:48	2,479.55	101
Recloser	PLANNED OUTAGE	7/21/2023 0:34	657.60	4
Transformer	PLANNED OUTAGE	7/21/2023 6:08	602.30	2
PLF	PLANNED OUTAGE	7/21/2023 8:11	203.25	1
Transformer	PLANNED OUTAGE	7/21/2023 8:52	1,202.30	6
Primary Wire	PLANNED OUTAGE	7/21/2023 9:07	326.00	2
Transformer	PLANNED OUTAGE	7/21/2023 10:59	1,124.53	8
PLF	PLANNED OUTAGE	7/21/2023 12:10	214.67	5
PLF	PLANNED OUTAGE	7/21/2023 14:26	606.83	11
PLF	PLANNED OUTAGE	7/21/2023 14:26	800.13	17
Primary Wire	PLANNED OUTAGE	7/21/2023 15:44	506.00	11

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	7/21/2023 17:49	2,630.67	16
PLF	PLANNED OUTAGE	7/22/2023 0:19	38.07	4
Transformer Bank	PLANNED OUTAGE	7/22/2023 8:22	1,896.42	7
Transformer Bank	PLANNED OUTAGE	7/22/2023 8:22	181.87	1
PLF	PLANNED OUTAGE	7/22/2023 14:13	1,197.90	33
Transformer	PLANNED OUTAGE	7/22/2023 15:52	61.00	1
Transformer	PLANNED OUTAGE	7/22/2023 16:55	47.90	2
Transformer	PLANNED OUTAGE	7/23/2023 8:01	280.17	10
PLF	PLANNED OUTAGE	7/23/2023 9:44	2,130.00	9
Transformer	PLANNED OUTAGE	7/23/2023 16:47	75.80	12
Transformer	PLANNED OUTAGE	7/23/2023 17:59	662.60	12
Transformer	PLANNED OUTAGE	7/23/2023 19:13	238.97	1
PLF	PLANNED OUTAGE	7/24/2023 0:10	1,356.60	36
PLF	PLANNED OUTAGE	7/24/2023 0:53	198.78	1
PLF	PLANNED OUTAGE	7/24/2023 1:42	35.00	2
Transformer	PLANNED OUTAGE	7/24/2023 2:05	3.07	1
Transformer	PLANNED OUTAGE	7/24/2023 2:06	49.13	2
Transformer	PLANNED OUTAGE	7/24/2023 8:23	589.33	10
Transformer	PLANNED OUTAGE	7/24/2023 8:31	705.60	9
Transformer	PLANNED OUTAGE	7/24/2023 8:33	52.72	1
Transformer	PLANNED OUTAGE	7/24/2023 8:46	424.58	5
Transformer	PLANNED OUTAGE	7/24/2023 9:04	213.13	1
Transformer	PLANNED OUTAGE	7/24/2023 9:49	921.45	9
Switch	PLANNED OUTAGE	7/24/2023 9:54	592.00	2
Service point	PLANNED OUTAGE	7/24/2023 10:11	174.15	1
PLF	PLANNED OUTAGE	7/24/2023 10:52	19.77	2
Transformer	PLANNED OUTAGE	7/24/2023 11:05	655.60	8
PLF	PLANNED OUTAGE	7/24/2023 12:24	63.35	1
PLF	PLANNED OUTAGE	7/24/2023 13:11	1,130.17	10
Service point	PLANNED OUTAGE	7/24/2023 13:44	163.98	1
PLF	PLANNED OUTAGE	7/24/2023 13:55	121.55	11
Transformer	PLANNED OUTAGE	7/24/2023 15:22	1,032.17	10
Transformer	PLANNED OUTAGE	7/24/2023 17:52	306.80	8
PLF	PLANNED OUTAGE	7/24/2023 18:25	292.58	1
PLF	PLANNED OUTAGE	7/24/2023 21:06	418.60	1
Transformer	PLANNED OUTAGE	7/25/2023 0:21	402.00	8
Primary Wire	PLANNED OUTAGE	7/25/2023 8:12	18,881.85	39
Transformer	PLANNED OUTAGE	7/25/2023 8:18	122.22	1
Transformer	PLANNED OUTAGE	7/25/2023 8:32	716.10	7
Switch	PLANNED OUTAGE	7/25/2023 8:33	885.23	2
Switch	PLANNED OUTAGE	7/25/2023 8:33	442.62	1
Service point	PLANNED OUTAGE	7/25/2023 9:21	59.88	1
Transformer Bank	PLANNED OUTAGE	7/25/2023 10:23	1,417.47	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/25/2023 11:22	462.13	8
Transformer	PLANNED OUTAGE	7/25/2023 13:04	462.47	7
Transformer Bank	PLANNED OUTAGE	7/25/2023 13:22	8.13	8
Transformer Bank	PLANNED OUTAGE	7/25/2023 13:23	9.33	8
Transformer Bank	PLANNED OUTAGE	7/25/2023 13:24	10.67	8
PLF	PLANNED OUTAGE	7/25/2023 14:13	36.63	1
Primary Wire	PLANNED OUTAGE	7/25/2023 14:43	200.95	3
Breaker	PLANNED OUTAGE	7/25/2023 15:49	11,022.58	1895
Breaker	PLANNED OUTAGE	7/25/2023 15:49	6.07	1
PLF	PLANNED OUTAGE	7/25/2023 17:09	259.60	44
Transformer	PLANNED OUTAGE	7/25/2023 18:04	415.98	1
Transformer	PLANNED OUTAGE	7/25/2023 18:08	184.80	12
Switch	PLANNED OUTAGE	7/25/2023 18:23	232.63	14
PLF	PLANNED OUTAGE	7/25/2023 20:54	387.63	1
Recloser	PLANNED OUTAGE	7/25/2023 21:44	796.50	90
Transformer	PLANNED OUTAGE	7/25/2023 21:48	1,836.93	8
Transformer	PLANNED OUTAGE	7/26/2023 8:45	2,169.77	17
PLF	PLANNED OUTAGE	7/26/2023 8:51	498.70	1
Transformer	PLANNED OUTAGE	7/26/2023 8:57	434.47	14
Transformer	PLANNED OUTAGE	7/26/2023 9:39	258.13	4
Transformer	PLANNED OUTAGE	7/26/2023 10:16	123.43	1
Transformer	PLANNED OUTAGE	7/26/2023 10:26	905.87	8
PLF	PLANNED OUTAGE	7/26/2023 11:12	417.07	8
Transformer	PLANNED OUTAGE	7/26/2023 11:18	362.37	14
Transformer	PLANNED OUTAGE	7/26/2023 12:05	162.40	12
Transformer	PLANNED OUTAGE	7/26/2023 12:11	116.33	1
Transformer	PLANNED OUTAGE	7/26/2023 12:56	96.40	2
Transformer	PLANNED OUTAGE	7/26/2023 14:27	87.03	7
Transformer	PLANNED OUTAGE	7/26/2023 17:20	33.77	1
Transformer	PLANNED OUTAGE	7/26/2023 20:22	511.47	2
Transformer Bank	PLANNED OUTAGE	7/27/2023 5:27	529.40	3
Breaker	PLANNED OUTAGE	7/27/2023 5:32	29,493.17	1138
Primary Wire	PLANNED OUTAGE	7/27/2023 6:14	2,601.00	30
PLF	PLANNED OUTAGE	7/27/2023 6:57	3,221.88	79
Transformer Bank	PLANNED OUTAGE	7/27/2023 6:57	1,250.80	4
PLF	PLANNED OUTAGE	7/27/2023 10:28	312.67	4
Breaker	PLANNED OUTAGE	7/27/2023 11:24	1,870.90	706
Transformer	PLANNED OUTAGE	7/27/2023 12:40	411.50	3
PLF	PLANNED OUTAGE	7/27/2023 12:45	20,303.85	183
Transformer	PLANNED OUTAGE	7/27/2023 12:51	990.00	8
Transformer	PLANNED OUTAGE	7/27/2023 13:04	9.13	4
Transformer	PLANNED OUTAGE	7/27/2023 13:12	323.47	4
Transformer	PLANNED OUTAGE	7/27/2023 15:25	181.15	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	7/27/2023 20:11	524.97	1
Transformer	PLANNED OUTAGE	7/28/2023 0:44	122.50	3
Transformer	PLANNED OUTAGE	7/28/2023 9:02	162.67	5
PLF	PLANNED OUTAGE	7/28/2023 9:27	723.20	16
PLF	PLANNED OUTAGE	7/28/2023 9:27	56.07	2
Transformer	PLANNED OUTAGE	7/28/2023 10:06	253.20	4
PLF	PLANNED OUTAGE	7/28/2023 11:37	1,298.67	10
Transformer	PLANNED OUTAGE	7/28/2023 18:14	484.68	13
Transformer Bank	PLANNED OUTAGE	7/28/2023 18:37	111.13	4
PLF	PLANNED OUTAGE	7/28/2023 19:13	397.80	27
Transformer	PLANNED OUTAGE	7/28/2023 20:11	1,049.42	5
PLF	PLANNED OUTAGE	7/28/2023 20:51	982.50	18
Transformer	PLANNED OUTAGE	7/28/2023 21:53	2,622.40	16
PLF	PLANNED OUTAGE	7/28/2023 23:09	16,708.75	75
Primary Wire	PLANNED OUTAGE	7/28/2023 23:10	749.50	3
Transformer	PLANNED OUTAGE	7/28/2023 23:24	504.00	8
PLF	PLANNED OUTAGE	7/28/2023 23:29	204.18	1
Transformer	PLANNED OUTAGE	7/29/2023 7:23	169.47	8
PLF	PLANNED OUTAGE	7/29/2023 7:28	452.12	1
PLF	PLANNED OUTAGE	7/29/2023 7:39	342.25	1
Transformer	PLANNED OUTAGE	7/29/2023 8:40	146.55	1
PLF	PLANNED OUTAGE	7/29/2023 11:58	119.37	2
Transformer	PLANNED OUTAGE	7/29/2023 12:47	310.50	6
Transformer	PLANNED OUTAGE	7/29/2023 13:45	274.27	8
Transformer	PLANNED OUTAGE	7/29/2023 14:21	534.57	14
Transformer	PLANNED OUTAGE	7/29/2023 15:30	90.27	4
Transformer	PLANNED OUTAGE	7/29/2023 17:02	51.80	2
Transformer	PLANNED OUTAGE	7/29/2023 21:23	392.67	8
Transformer	PLANNED OUTAGE	7/29/2023 23:35	193.50	5
Transformer	PLANNED OUTAGE	7/30/2023 0:36	129.38	7
Transformer	PLANNED OUTAGE	7/30/2023 0:55	9.68	7
Primary Wire	PLANNED OUTAGE	7/30/2023 1:11	8,407.18	19
Service point	PLANNED OUTAGE	7/30/2023 2:30	15.08	1
Transformer	PLANNED OUTAGE	7/30/2023 9:40	142.80	9
Transformer	PLANNED OUTAGE	7/30/2023 13:30	10.75	1
Breaker	PLANNED OUTAGE	7/30/2023 16:16	6,226.35	1209
Breaker	PLANNED OUTAGE	7/30/2023 16:22	48.22	11
PLF	PLANNED OUTAGE	7/30/2023 16:22	2,152.88	11
Breaker	PLANNED OUTAGE	7/30/2023 16:45	233,989.58	3209
Breaker	PLANNED OUTAGE	7/30/2023 18:08	5,156.53	2536
Breaker	PLANNED OUTAGE	7/30/2023 18:08	2,054.98	1019
Switch	PLANNED OUTAGE	7/30/2023 19:33	1,096.78	7
Switch	PLANNED OUTAGE	7/30/2023 20:28	939.07	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	7/30/2023 20:53	29.10	2
Transformer	PLANNED OUTAGE	7/30/2023 21:10	6,630.67	16
Transformer	PLANNED OUTAGE	7/31/2023 2:39	282.80	8
Transformer	PLANNED OUTAGE	7/31/2023 9:10	298.10	6
Primary Wire	PLANNED OUTAGE	7/31/2023 9:31	245.70	54
Primary Wire	PLANNED OUTAGE	7/31/2023 9:36	12,121.05	57
Transformer	PLANNED OUTAGE	7/31/2023 10:38	882.93	8
Transformer	PLANNED OUTAGE	7/31/2023 13:02	124.80	4
Transformer	PLANNED OUTAGE	7/31/2023 13:33	20.53	4
Transformer	PLANNED OUTAGE	7/31/2023 13:49	107.40	4
Transformer	PLANNED OUTAGE	7/31/2023 13:50	1,769.07	8
Transformer	PLANNED OUTAGE	7/31/2023 13:59	4,740.07	733
Switch	PLANNED OUTAGE	7/31/2023 16:06	11,706.10	98
Switch	PLANNED OUTAGE	7/31/2023 16:11	572.92	5
Transformer	PLANNED OUTAGE	7/31/2023 20:36	601.27	4
PLF	PLANNED OUTAGE	7/31/2023 22:27	1,606.00	6
Switch	PLANNED OUTAGE	8/1/2023 0:36	11.30	3
PLF	PLANNED OUTAGE	8/1/2023 1:42	1,249.80	18
PLF	PLANNED OUTAGE	8/1/2023 1:42	1,030.20	17
Transformer	PLANNED OUTAGE	8/1/2023 3:05	12.83	10
PLF	PLANNED OUTAGE	8/1/2023 8:35	1,802.10	9
Transformer	PLANNED OUTAGE	8/1/2023 8:39	463.60	6
Service point	PLANNED OUTAGE	8/1/2023 8:45	81.10	1
Transformer	PLANNED OUTAGE	8/1/2023 9:32	82.90	6
Transformer	PLANNED OUTAGE	8/1/2023 10:21	1,506.67	8
Transformer	PLANNED OUTAGE	8/1/2023 11:09	177.15	9
PLF	PLANNED OUTAGE	8/1/2023 11:36	81.60	6
Transformer	PLANNED OUTAGE	8/1/2023 11:38	84.97	1
Transformer	PLANNED OUTAGE	8/1/2023 16:09	177.73	4
PLF	PLANNED OUTAGE	8/1/2023 16:15	2,685.75	45
Breaker	PLANNED OUTAGE	8/1/2023 18:43	89.47	61
Transformer	PLANNED OUTAGE	8/1/2023 20:11	490.13	4
Service point	PLANNED OUTAGE	8/2/2023 2:15	1,177.42	5
PLF	PLANNED OUTAGE	8/2/2023 4:16	190.40	48
Service point	PLANNED OUTAGE	8/2/2023 4:29	101.72	1
Transformer	PLANNED OUTAGE	8/2/2023 4:32	7,637.00	30
Transformer	PLANNED OUTAGE	8/2/2023 8:04	1,827.50	43
Transformer	PLANNED OUTAGE	8/2/2023 8:22	3,548.67	10
Transformer	PLANNED OUTAGE	8/2/2023 8:50	3,006.00	8
PLF	PLANNED OUTAGE	8/2/2023 8:55	321.07	1
PLF	PLANNED OUTAGE	8/2/2023 8:56	254.07	4
Transformer	PLANNED OUTAGE	8/2/2023 9:27	1,029.33	16
Transformer Bank	PLANNED OUTAGE	8/2/2023 9:34	757.90	6

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/2/2023 9:57	172.20	2
Transformer	PLANNED OUTAGE	8/2/2023 9:58	352.43	2
Transformer Bank	PLANNED OUTAGE	8/2/2023 10:40	690.40	8
Transformer	PLANNED OUTAGE	8/2/2023 10:40	139.42	7
Transformer	PLANNED OUTAGE	8/2/2023 10:57	1,150.93	16
PLF	PLANNED OUTAGE	8/2/2023 11:04	225.63	1
Transformer	PLANNED OUTAGE	8/2/2023 13:40	137.50	10
Transformer	PLANNED OUTAGE	8/2/2023 16:49	66.20	1
Transformer	PLANNED OUTAGE	8/2/2023 19:13	3.47	1
Transformer	PLANNED OUTAGE	8/2/2023 23:27	79.40	3
PLF	PLANNED OUTAGE	8/3/2023 0:09	2,380.30	26
PLF	PLANNED OUTAGE	8/3/2023 6:51	26.85	1
Transformer	PLANNED OUTAGE	8/3/2023 9:01	4,166.42	17
Transformer	PLANNED OUTAGE	8/3/2023 9:13	434.00	10
Transformer	PLANNED OUTAGE	8/3/2023 9:57	19.67	10
Transformer	PLANNED OUTAGE	8/3/2023 9:59	28.17	10
Transformer	PLANNED OUTAGE	8/3/2023 9:59	13.83	10
Service - Non Crew	PLANNED OUTAGE	8/3/2023 10:58	32.95	1
PLF	PLANNED OUTAGE	8/3/2023 11:12	3,918.13	14
PLF	PLANNED OUTAGE	8/3/2023 11:36	1,137.50	15
Transformer	PLANNED OUTAGE	8/3/2023 12:27	216.70	6
Transformer	PLANNED OUTAGE	8/3/2023 13:17	64.93	8
Transformer	PLANNED OUTAGE	8/3/2023 13:26	9.47	8
Transformer	PLANNED OUTAGE	8/3/2023 13:28	40.93	8
Transformer	PLANNED OUTAGE	8/3/2023 14:29	442.67	8
Service - Non Crew	PLANNED OUTAGE	8/3/2023 15:45	141.17	7
Transformer	PLANNED OUTAGE	8/3/2023 16:26	966.70	21
Transformer	PLANNED OUTAGE	8/3/2023 16:53	258.07	7
Transformer	PLANNED OUTAGE	8/3/2023 18:02	128.85	1
Transformer	PLANNED OUTAGE	8/3/2023 19:04	115.33	4
Transformer	PLANNED OUTAGE	8/3/2023 20:01	14.53	1
Transformer	PLANNED OUTAGE	8/3/2023 20:56	1,267.17	5
Transformer	PLANNED OUTAGE	8/3/2023 21:34	660.60	6
Transformer Bank	PLANNED OUTAGE	8/4/2023 1:01	106.95	3
PLF	PLANNED OUTAGE	8/4/2023 5:43	6,209.10	18
Recloser	PLANNED OUTAGE	8/4/2023 7:32	7,969.77	746
Service point	PLANNED OUTAGE	8/4/2023 8:31	266.22	1
Transformer	PLANNED OUTAGE	8/4/2023 8:56	340.80	9
Transformer	PLANNED OUTAGE	8/4/2023 9:05	161.12	7
Transformer	PLANNED OUTAGE	8/4/2023 9:50	22.70	2
Transformer	PLANNED OUTAGE	8/4/2023 9:52	1,206.60	12
Transformer	PLANNED OUTAGE	8/4/2023 9:54	135.00	6
Transformer	PLANNED OUTAGE	8/4/2023 10:31	1,491.70	14

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/4/2023 10:31	103.28	1
Transformer	PLANNED OUTAGE	8/4/2023 11:53	444.50	7
Recloser	PLANNED OUTAGE	8/4/2023 12:45	18,374.40	1044
Breaker	PLANNED OUTAGE	8/4/2023 14:51	5,439.15	459
Switch	PLANNED OUTAGE	8/4/2023 15:38	3,306.27	724
Switch	PLANNED OUTAGE	8/4/2023 15:38	1,460.50	690
Service point	PLANNED OUTAGE	8/4/2023 17:00	241.67	1
Transformer	PLANNED OUTAGE	8/4/2023 17:34	43.60	3
Service point	PLANNED OUTAGE	8/4/2023 18:08	93.05	1
Breaker	PLANNED OUTAGE	8/4/2023 18:18	44,646.68	233
Breaker	PLANNED OUTAGE	8/4/2023 18:18	72,442.50	1170
Transformer	PLANNED OUTAGE	8/4/2023 20:02	58.17	5
Transformer	PLANNED OUTAGE	8/4/2023 20:15	204.75	13
PLF	PLANNED OUTAGE	8/5/2023 0:07	102.20	6
Transformer	PLANNED OUTAGE	8/5/2023 0:19	38.53	1
Transformer	PLANNED OUTAGE	8/5/2023 0:22	113.80	4
Transformer	PLANNED OUTAGE	8/5/2023 8:55	3,236.13	26
Transformer	PLANNED OUTAGE	8/5/2023 8:57	967.87	8
Transformer	PLANNED OUTAGE	8/5/2023 10:59	84.93	26
PLF	PLANNED OUTAGE	8/5/2023 12:05	5,761.80	22
Breaker	PLANNED OUTAGE	8/5/2023 18:11	19,168.80	882
PLF	PLANNED OUTAGE	8/5/2023 19:15	188.88	7
Service point	PLANNED OUTAGE	8/5/2023 23:55	251.75	15
Transformer	PLANNED OUTAGE	8/6/2023 0:38	68.47	1
Transformer	PLANNED OUTAGE	8/6/2023 1:32	41.83	1
Transformer	PLANNED OUTAGE	8/6/2023 2:28	16.57	1
Transformer	PLANNED OUTAGE	8/6/2023 3:07	28.23	1
URD Cable Cut	PLANNED OUTAGE	8/6/2023 14:34	6,840.87	28
URD Cable Cut	PLANNED OUTAGE	8/6/2023 14:53	129.93	1
Transformer	PLANNED OUTAGE	8/6/2023 16:19	83.77	2
PLF	PLANNED OUTAGE	8/6/2023 16:48	3,004.00	12
Transformer	PLANNED OUTAGE	8/6/2023 17:38	365.20	12
Service point	PLANNED OUTAGE	8/6/2023 19:12	149.95	1
Transformer	PLANNED OUTAGE	8/6/2023 19:43	141.00	2
Transformer	PLANNED OUTAGE	8/7/2023 8:15	335.67	5
Transformer	PLANNED OUTAGE	8/7/2023 8:41	2,993.00	15
Transformer Bank	PLANNED OUTAGE	8/7/2023 9:33	57.23	2
Transformer	PLANNED OUTAGE	8/7/2023 9:43	42.58	1
Transformer	PLANNED OUTAGE	8/7/2023 10:36	1,284.00	8
Transformer	PLANNED OUTAGE	8/7/2023 11:13	549.07	8
Transformer	PLANNED OUTAGE	8/7/2023 11:39	560.70	6
PLF	PLANNED OUTAGE	8/7/2023 11:43	194.00	4
PLF	PLANNED OUTAGE	8/7/2023 11:58	1,642.90	21

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/7/2023 11:58	2,302.50	30
PLF	PLANNED OUTAGE	8/7/2023 12:29	1,504.53	14
Transformer	PLANNED OUTAGE	8/7/2023 13:37	314.42	7
Transformer	PLANNED OUTAGE	8/7/2023 13:39	494.93	8
PLF	PLANNED OUTAGE	8/7/2023 13:43	1,374.27	2
Transformer	PLANNED OUTAGE	8/7/2023 14:19	36.10	3
Transformer	PLANNED OUTAGE	8/7/2023 14:21	1,205.40	14
Transformer	PLANNED OUTAGE	8/7/2023 14:24	513.80	7
Transformer	PLANNED OUTAGE	8/7/2023 21:13	1,195.33	5
Transformer	PLANNED OUTAGE	8/8/2023 9:39	1,034.72	7
PLF	PLANNED OUTAGE	8/8/2023 10:12	137.10	9
PLF	PLANNED OUTAGE	8/8/2023 16:16	228.27	1
PLF	PLANNED OUTAGE	8/8/2023 16:29	231.95	3
Transformer	PLANNED OUTAGE	8/8/2023 18:21	130.87	13
Transformer	PLANNED OUTAGE	8/8/2023 18:32	95.98	13
Transformer	PLANNED OUTAGE	8/8/2023 18:39	45.07	13
Transformer	PLANNED OUTAGE	8/8/2023 18:43	1,630.42	13
Transformer	PLANNED OUTAGE	8/8/2023 19:05	285.20	8
Transformer	PLANNED OUTAGE	8/8/2023 19:34	519.17	7
Transformer	PLANNED OUTAGE	8/8/2023 19:35	5,181.87	16
Transformer	PLANNED OUTAGE	8/8/2023 21:32	352.50	9
Transformer	PLANNED OUTAGE	8/8/2023 23:22	1,263.60	8
Transformer	PLANNED OUTAGE	8/9/2023 6:21	947.57	1
Transformer	PLANNED OUTAGE	8/9/2023 9:19	7,451.00	20
PLF	PLANNED OUTAGE	8/9/2023 9:23	275.00	6
Transformer Bank	PLANNED OUTAGE	8/9/2023 9:26	133.75	1
Transformer	PLANNED OUTAGE	8/9/2023 9:45	570.80	6
Transformer	PLANNED OUTAGE	8/9/2023 9:48	491.00	15
Transformer	PLANNED OUTAGE	8/9/2023 10:21	48.50	15
PLF	PLANNED OUTAGE	8/9/2023 11:42	42.23	1
Transformer	PLANNED OUTAGE	8/9/2023 11:52	516.33	10
Transformer	PLANNED OUTAGE	8/9/2023 12:10	737.10	3
PLF	PLANNED OUTAGE	8/9/2023 14:48	72.75	15
Transformer	PLANNED OUTAGE	8/9/2023 16:26	14.78	1
Transformer	PLANNED OUTAGE	8/9/2023 18:24	1,224.50	10
Transformer	PLANNED OUTAGE	8/10/2023 0:41	728.17	5
Transformer	PLANNED OUTAGE	8/10/2023 8:13	613.25	5
PLF	PLANNED OUTAGE	8/10/2023 8:39	173.03	1
PLF	PLANNED OUTAGE	8/10/2023 8:43	124.30	6
Primary Wire	PLANNED OUTAGE	8/10/2023 9:23	440.10	9
Transformer	PLANNED OUTAGE	8/10/2023 10:06	98.83	5
Transformer	PLANNED OUTAGE	8/10/2023 10:42	607.07	8
Transformer	PLANNED OUTAGE	8/10/2023 11:14	555.33	10

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/10/2023 11:15	455.70	6
PLF	PLANNED OUTAGE	8/10/2023 11:25	30.15	1
Transformer	PLANNED OUTAGE	8/10/2023 11:47	1,034.08	5
Transformer	PLANNED OUTAGE	8/10/2023 12:34	1,252.00	12
Transformer	PLANNED OUTAGE	8/10/2023 13:20	527.60	8
PLF	PLANNED OUTAGE	8/10/2023 13:38	190.53	8
PLF	PLANNED OUTAGE	8/10/2023 14:03	570.40	8
Transformer	PLANNED OUTAGE	8/10/2023 14:05	394.57	7
Breaker	PLANNED OUTAGE	8/10/2023 14:14	831.00	277
Breaker	PLANNED OUTAGE	8/10/2023 14:14	2,846.83	1102
Transformer	PLANNED OUTAGE	8/10/2023 14:25	368.28	19
Transformer Bank	PLANNED OUTAGE	8/10/2023 14:31	469.95	9
Transformer Bank	PLANNED OUTAGE	8/10/2023 15:23	16.80	9
Transformer Bank	PLANNED OUTAGE	8/10/2023 15:25	11.70	9
Transformer	PLANNED OUTAGE	8/10/2023 16:02	171.45	9
Transformer	PLANNED OUTAGE	8/10/2023 16:28	564.00	10
Transformer	PLANNED OUTAGE	8/10/2023 16:35	300.27	8
PLF	PLANNED OUTAGE	8/10/2023 16:51	93.50	1
Transformer	PLANNED OUTAGE	8/10/2023 18:59	2,595.27	11
Transformer	PLANNED OUTAGE	8/11/2023 3:32	1,238.93	8
Transformer	PLANNED OUTAGE	8/11/2023 8:51	1,681.40	12
PLF	PLANNED OUTAGE	8/11/2023 9:02	120.57	1
Transformer	PLANNED OUTAGE	8/11/2023 10:47	2,857.13	17
Transformer	PLANNED OUTAGE	8/11/2023 11:57	1,877.52	19
Switch	PLANNED OUTAGE	8/11/2023 13:07	22,620.00	1170
Switch	PLANNED OUTAGE	8/11/2023 13:07	7,258.08	1255
Switch	PLANNED OUTAGE	8/11/2023 13:07	11,583.02	983
Recloser	PLANNED OUTAGE	8/11/2023 15:13	42,288.40	924
Transformer	PLANNED OUTAGE	8/11/2023 20:31	3,416.80	12
Transformer Bank	PLANNED OUTAGE	8/12/2023 14:03	211.43	2
Transformer	PLANNED OUTAGE	8/12/2023 17:07	97.58	5
Transformer	PLANNED OUTAGE	8/12/2023 17:20	1,708.58	7
PLF	PLANNED OUTAGE	8/12/2023 18:47	2,499.60	9
PLF	PLANNED OUTAGE	8/13/2023 5:53	184.88	1
PLF	PLANNED OUTAGE	8/13/2023 6:50	4,204.67	53
Transformer	PLANNED OUTAGE	8/13/2023 10:04	84.67	10
Transformer	PLANNED OUTAGE	8/13/2023 12:25	207.35	3
PLF	PLANNED OUTAGE	8/13/2023 13:46	9,636.03	26
PLF	PLANNED OUTAGE	8/13/2023 14:57	1,482.95	57
Recloser	PLANNED OUTAGE	8/13/2023 19:06	5,280.00	10
Transformer	PLANNED OUTAGE	8/13/2023 19:08	1,318.17	10
PLF	PLANNED OUTAGE	8/13/2023 19:23	12,419.33	26
Transformer	PLANNED OUTAGE	8/13/2023 20:15	2,215.20	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	8/14/2023 4:51	5.10	1
Service point	PLANNED OUTAGE	8/14/2023 5:12	1.15	1
Recloser	PLANNED OUTAGE	8/14/2023 6:19	7,057.63	149
Transformer	PLANNED OUTAGE	8/14/2023 10:44	247.65	13
PLF	PLANNED OUTAGE	8/14/2023 11:25	30.50	1
Switch	PLANNED OUTAGE	8/14/2023 11:31	7.70	1
Transformer Bank	PLANNED OUTAGE	8/14/2023 11:46	38.20	2
PLF	PLANNED OUTAGE	8/14/2023 11:56	8.93	2
Transformer	PLANNED OUTAGE	8/14/2023 13:51	509.95	7
Transformer	PLANNED OUTAGE	8/14/2023 13:57	26.57	2
Recloser	PLANNED OUTAGE	8/14/2023 14:24	12,359.37	599
Recloser	PLANNED OUTAGE	8/14/2023 14:24	471.68	13
Transformer	PLANNED OUTAGE	8/14/2023 15:41	113.05	7
PLF	PLANNED OUTAGE	8/14/2023 17:39	962.60	12
Transformer	PLANNED OUTAGE	8/14/2023 19:15	1,281.32	11
Transformer	PLANNED OUTAGE	8/14/2023 21:31	540.83	10
PLF	PLANNED OUTAGE	8/14/2023 22:05	665.85	23
Transformer	PLANNED OUTAGE	8/14/2023 22:10	188.67	2
Transformer	PLANNED OUTAGE	8/14/2023 22:25	120.98	7
PLF	PLANNED OUTAGE	8/14/2023 22:34	3,865.53	23
Transformer	PLANNED OUTAGE	8/14/2023 23:05	275.57	14
Primary Wire	PLANNED OUTAGE	8/15/2023 8:41	22.63	7
Primary Wire	PLANNED OUTAGE	8/15/2023 8:44	1,051.40	6
Primary Wire	PLANNED OUTAGE	8/15/2023 8:45	1,497.33	8
Primary Wire	PLANNED OUTAGE	8/15/2023 9:16	1,314.30	9
PLF	PLANNED OUTAGE	8/15/2023 9:21	483.60	2
Transformer	PLANNED OUTAGE	8/15/2023 9:31	1,161.75	9
Switch	PLANNED OUTAGE	8/15/2023 10:07	273.13	2
Transformer	PLANNED OUTAGE	8/15/2023 11:59	77.12	1
Transformer	PLANNED OUTAGE	8/15/2023 12:58	311.15	7
PLF	PLANNED OUTAGE	8/15/2023 13:20	51.37	1
PLF	PLANNED OUTAGE	8/15/2023 13:29	66.43	2
Recloser	PLANNED OUTAGE	8/15/2023 13:59	13,045.07	1136
Service point	PLANNED OUTAGE	8/15/2023 14:08	37.98	1
PLF	PLANNED OUTAGE	8/15/2023 20:51	412.73	2
Transformer	PLANNED OUTAGE	8/15/2023 22:55	794.42	5
Transformer	PLANNED OUTAGE	8/16/2023 8:46	212.05	1
Transformer	PLANNED OUTAGE	8/16/2023 9:16	397.75	3
Primary Wire	PLANNED OUTAGE	8/16/2023 9:31	2,539.80	9
Transformer	PLANNED OUTAGE	8/16/2023 9:35	26.78	1
Transformer	PLANNED OUTAGE	8/16/2023 10:03	104.80	4
Transformer	PLANNED OUTAGE	8/16/2023 10:21	593.72	7
Transformer Bank	PLANNED OUTAGE	8/16/2023 10:22	192.03	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/16/2023 10:28	571.83	2
Transformer	PLANNED OUTAGE	8/16/2023 11:02	39.60	1
Transformer	PLANNED OUTAGE	8/16/2023 12:24	43.10	2
Transformer	PLANNED OUTAGE	8/16/2023 12:24	606.60	12
PLF	PLANNED OUTAGE	8/16/2023 13:03	92.00	3
Transformer Bank	PLANNED OUTAGE	8/16/2023 13:56	1,187.20	8
Recloser	PLANNED OUTAGE	8/16/2023 18:01	3,698.40	402
PLF	PLANNED OUTAGE	8/16/2023 19:28	1,823.83	5
Breaker	PLANNED OUTAGE	8/16/2023 21:48	6,102.00	1695
PLF	PLANNED OUTAGE	8/16/2023 23:01	970.55	21
PLF	PLANNED OUTAGE	8/16/2023 23:47	71.40	21
PLF	PLANNED OUTAGE	8/16/2023 23:51	220.50	21
Primary Wire	PLANNED OUTAGE	8/17/2023 0:00	223.33	5
Recloser	PLANNED OUTAGE	8/17/2023 0:27	1,258.67	80
Transformer Bank	PLANNED OUTAGE	8/17/2023 6:13	22.97	2
Transformer	PLANNED OUTAGE	8/17/2023 7:51	722.60	4
Transformer	PLANNED OUTAGE	8/17/2023 8:16	901.77	13
Transformer	PLANNED OUTAGE	8/17/2023 8:31	1,151.50	7
PLF	PLANNED OUTAGE	8/17/2023 9:05	192.10	1
PLF	PLANNED OUTAGE	8/17/2023 9:05	704.27	8
Transformer	PLANNED OUTAGE	8/17/2023 9:40	371.20	2
Transformer	PLANNED OUTAGE	8/17/2023 10:24	78.88	1
Transformer	PLANNED OUTAGE	8/17/2023 10:27	486.60	9
Transformer	PLANNED OUTAGE	8/17/2023 10:28	585.33	8
Transformer	PLANNED OUTAGE	8/17/2023 10:49	1,692.80	8
PLF	PLANNED OUTAGE	8/17/2023 11:13	209.40	9
PLF	PLANNED OUTAGE	8/17/2023 11:13	22.63	1
Transformer	PLANNED OUTAGE	8/17/2023 12:09	131.77	2
PLF	PLANNED OUTAGE	8/17/2023 12:17	1.08	1
Transformer	PLANNED OUTAGE	8/17/2023 12:52	80.67	8
Transformer	PLANNED OUTAGE	8/17/2023 13:12	1,375.37	11
PLF	PLANNED OUTAGE	8/17/2023 16:18	2,047.47	176
PLF	PLANNED OUTAGE	8/17/2023 16:18	12.57	1
PLF	PLANNED OUTAGE	8/17/2023 16:19	10.60	1
Transformer	PLANNED OUTAGE	8/17/2023 18:33	141.62	1
PLF	PLANNED OUTAGE	8/17/2023 18:56	387.10	6
Transformer	PLANNED OUTAGE	8/17/2023 18:57	62.93	1
PLF	PLANNED OUTAGE	8/17/2023 19:32	762.53	14
Transformer	PLANNED OUTAGE	8/17/2023 21:37	903.00	6
Transformer	PLANNED OUTAGE	8/18/2023 0:06	434.93	16
Transformer	PLANNED OUTAGE	8/18/2023 8:43	628.17	10
Transformer	PLANNED OUTAGE	8/18/2023 8:55	60.00	6
Transformer	PLANNED OUTAGE	8/18/2023 8:56	853.87	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/18/2023 8:59	129.87	1
Transformer	PLANNED OUTAGE	8/18/2023 11:59	1,452.00	11
Service point	PLANNED OUTAGE	8/18/2023 15:07	18.42	1
PLF	PLANNED OUTAGE	8/18/2023 15:46	4,489.07	38
Transformer	PLANNED OUTAGE	8/18/2023 16:20	117.90	18
Recloser	PLANNED OUTAGE	8/18/2023 17:49	62,059.50	810
Switch	PLANNED OUTAGE	8/18/2023 21:20	6,863.50	105
Switch	PLANNED OUTAGE	8/18/2023 21:20	326.75	5
Recloser	PLANNED OUTAGE	8/19/2023 6:24	261.60	18
Recloser	PLANNED OUTAGE	8/19/2023 6:39	67.20	18
Recloser	PLANNED OUTAGE	8/19/2023 6:43	90.90	18
Recloser	PLANNED OUTAGE	8/19/2023 6:47	19.20	18
PLF	PLANNED OUTAGE	8/19/2023 10:20	917.25	3
PLF	PLANNED OUTAGE	8/19/2023 10:20	4,280.03	14
Transformer	PLANNED OUTAGE	8/19/2023 11:09	485.95	3
Transformer	PLANNED OUTAGE	8/19/2023 11:16	120.42	1
Transformer	PLANNED OUTAGE	8/19/2023 12:29	149.08	5
Transformer	PLANNED OUTAGE	8/19/2023 12:39	294.47	14
Transformer	PLANNED OUTAGE	8/19/2023 13:00	5.25	5
Transformer	PLANNED OUTAGE	8/19/2023 13:05	101.33	8
Transformer	PLANNED OUTAGE	8/19/2023 13:18	11.07	8
Service point	PLANNED OUTAGE	8/19/2023 16:31	216.77	1
Transformer	PLANNED OUTAGE	8/19/2023 16:58	16.30	1
Service point	PLANNED OUTAGE	8/19/2023 20:24	13.85	1
Primary Wire	PLANNED OUTAGE	8/19/2023 20:50	10,979.10	33
Transformer	PLANNED OUTAGE	8/19/2023 22:11	7,025.12	31
Primary Wire	PLANNED OUTAGE	8/19/2023 23:34	168.73	1
Service point	PLANNED OUTAGE	8/20/2023 0:09	133.90	1
PLF	PLANNED OUTAGE	8/20/2023 4:23	1,131.43	13
Transformer	PLANNED OUTAGE	8/20/2023 4:55	115.33	5
Transformer	PLANNED OUTAGE	8/20/2023 11:06	1,288.00	6
Transformer	PLANNED OUTAGE	8/20/2023 12:06	47.15	1
Transformer	PLANNED OUTAGE	8/20/2023 12:15	397.50	6
Transformer	PLANNED OUTAGE	8/20/2023 13:43	141.92	5
Breaker	PLANNED OUTAGE	8/20/2023 15:09	2,194.00	1097
PLF	PLANNED OUTAGE	8/20/2023 15:38	2,750.40	16
Recloser	PLANNED OUTAGE	8/20/2023 17:59	5,363.52	31
Transformer	PLANNED OUTAGE	8/20/2023 18:16	57.53	1
Transformer	PLANNED OUTAGE	8/20/2023 19:56	1,927.67	4
Primary Wire	PLANNED OUTAGE	8/21/2023 8:19	4,000.15	11
Transformer	PLANNED OUTAGE	8/21/2023 8:19	63.25	5
PLF	PLANNED OUTAGE	8/21/2023 8:24	18,269.10	53
Transformer	PLANNED OUTAGE	8/21/2023 8:39	329.48	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/21/2023 9:35	515.40	9
Transformer	PLANNED OUTAGE	8/21/2023 11:22	111.23	1
Transformer	PLANNED OUTAGE	8/21/2023 12:45	2,498.12	37
Transformer	PLANNED OUTAGE	8/21/2023 13:42	122.47	2
Transformer	PLANNED OUTAGE	8/21/2023 14:34	302.43	2
PLF	PLANNED OUTAGE	8/21/2023 14:41	10,534.77	182
Primary Wire	PLANNED OUTAGE	8/21/2023 18:59	2,057.20	24
Transformer	PLANNED OUTAGE	8/21/2023 19:22	996.50	3
Transformer	PLANNED OUTAGE	8/21/2023 19:27	94.37	2
Transformer	PLANNED OUTAGE	8/21/2023 20:22	189.93	4
Transformer	PLANNED OUTAGE	8/22/2023 0:15	20.70	1
Transformer	PLANNED OUTAGE	8/22/2023 8:32	313.02	7
PLF	PLANNED OUTAGE	8/22/2023 9:29	41.70	1
Transformer Bank	PLANNED OUTAGE	8/22/2023 9:44	306.07	4
Transformer	PLANNED OUTAGE	8/22/2023 10:04	448.40	3
Transformer	PLANNED OUTAGE	8/22/2023 10:18	184.00	5
Transformer	PLANNED OUTAGE	8/22/2023 10:40	27.15	1
Transformer	PLANNED OUTAGE	8/22/2023 12:08	162.40	2
Transformer Bank	PLANNED OUTAGE	8/22/2023 13:30	320.95	7
Service point	PLANNED OUTAGE	8/22/2023 15:42	23.08	1
Transformer	PLANNED OUTAGE	8/22/2023 18:33	58.73	2
Transformer	PLANNED OUTAGE	8/22/2023 20:21	205.13	4
PLF	PLANNED OUTAGE	8/22/2023 22:59	983.05	3
Transformer Bank	PLANNED OUTAGE	8/22/2023 23:30	16.65	1
Transformer	PLANNED OUTAGE	8/22/2023 23:32	3,585.33	10
Transformer	PLANNED OUTAGE	8/23/2023 5:20	573.60	12
Transformer	PLANNED OUTAGE	8/23/2023 6:41	161.67	10
Transformer	PLANNED OUTAGE	8/23/2023 8:32	2,787.30	9
Transformer	PLANNED OUTAGE	8/23/2023 9:15	577.43	2
Transformer	PLANNED OUTAGE	8/23/2023 9:27	257.33	1
Transformer Bank	PLANNED OUTAGE	8/23/2023 9:55	582.87	7
PLF	PLANNED OUTAGE	8/23/2023 10:28	74.42	1
Transformer	PLANNED OUTAGE	8/23/2023 10:32	308.70	3
Transformer	PLANNED OUTAGE	8/23/2023 13:59	130.17	10
Transformer	PLANNED OUTAGE	8/23/2023 15:53	28.90	1
Transformer	PLANNED OUTAGE	8/23/2023 16:41	368.17	10
PLF	PLANNED OUTAGE	8/23/2023 19:25	3,922.20	36
Transformer	PLANNED OUTAGE	8/23/2023 19:47	433.40	12
Transformer	PLANNED OUTAGE	8/23/2023 20:07	231.00	14
Transformer	PLANNED OUTAGE	8/23/2023 21:07	351.07	8
Transformer	PLANNED OUTAGE	8/24/2023 4:36	321.90	2
Transformer	PLANNED OUTAGE	8/24/2023 4:59	1,110.93	8
PLF	PLANNED OUTAGE	8/24/2023 5:55	2,453.33	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	8/24/2023 8:42	169.47	2
PLF	PLANNED OUTAGE	8/24/2023 9:56	40.25	1
PLF	PLANNED OUTAGE	8/24/2023 11:02	40.93	8
PLF	PLANNED OUTAGE	8/24/2023 11:07	32.93	8
Transformer	PLANNED OUTAGE	8/24/2023 12:33	46.07	2
Transformer	PLANNED OUTAGE	8/25/2023 1:48	517.10	6
PLF	PLANNED OUTAGE	8/25/2023 4:12	274.67	10
Transformer	PLANNED OUTAGE	8/25/2023 9:36	84.73	4
Switch	PLANNED OUTAGE	8/25/2023 9:41	340.73	2
Transformer	PLANNED OUTAGE	8/25/2023 10:43	22.22	1
Transformer	PLANNED OUTAGE	8/25/2023 10:43	22.20	1
Transformer	PLANNED OUTAGE	8/25/2023 11:04	350.47	7
Transformer	PLANNED OUTAGE	8/25/2023 13:46	185.07	16
Transformer	PLANNED OUTAGE	8/25/2023 15:41	28.38	13
Breaker	PLANNED OUTAGE	8/25/2023 19:32	1,531.00	1531
Switch	PLANNED OUTAGE	8/26/2023 0:19	19.60	3
Transformer	PLANNED OUTAGE	8/26/2023 9:42	103.95	3
Transformer	PLANNED OUTAGE	8/26/2023 10:32	760.30	2
Transformer	PLANNED OUTAGE	8/26/2023 11:18	212.77	26
Transformer	PLANNED OUTAGE	8/26/2023 19:43	9,223.07	26
Transformer	PLANNED OUTAGE	8/27/2023 7:52	151.60	12
Transformer	PLANNED OUTAGE	8/27/2023 11:56	228.20	4
PLF	PLANNED OUTAGE	8/27/2023 12:15	1,610.33	20
Transformer	PLANNED OUTAGE	8/27/2023 14:22	188.87	4
Transformer	PLANNED OUTAGE	8/27/2023 15:57	19.03	1
Transformer Bank	PLANNED OUTAGE	8/27/2023 16:42	4,370.60	6
PLF	PLANNED OUTAGE	8/27/2023 19:04	1,728.60	36
Transformer	PLANNED OUTAGE	8/27/2023 19:35	837.90	6
Transformer	PLANNED OUTAGE	8/27/2023 19:35	1,116.15	9
PLF	PLANNED OUTAGE	8/27/2023 20:24	1,214.95	3
Primary Wire	PLANNED OUTAGE	8/27/2023 21:34	2,133.10	6
PLF	PLANNED OUTAGE	8/27/2023 22:06	1,499.00	30
PLF	PLANNED OUTAGE	8/28/2023 0:43	8,278.42	55
PLF	PLANNED OUTAGE	8/28/2023 1:04	190.67	1
Primary Wire	PLANNED OUTAGE	8/28/2023 3:40	204.60	6
PLF	PLANNED OUTAGE	8/28/2023 4:47	420.60	1
Primary Wire	PLANNED OUTAGE	8/28/2023 9:51	1,319.02	29
Transformer	PLANNED OUTAGE	8/28/2023 11:38	584.62	7
Switch	PLANNED OUTAGE	8/28/2023 12:07	182.57	2
Transformer	PLANNED OUTAGE	8/28/2023 12:11	43.98	1
Transformer Bank	PLANNED OUTAGE	8/28/2023 12:12	12.53	8
Transformer	PLANNED OUTAGE	8/28/2023 12:44	1,639.95	29
Transformer	PLANNED OUTAGE	8/28/2023 12:44	422.93	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/28/2023 13:34	2,149.00	42
TX Repaired (OH)	PLANNED OUTAGE	8/28/2023 13:40	54.97	2
Transformer	PLANNED OUTAGE	8/28/2023 14:04	59.57	2
Transformer	PLANNED OUTAGE	8/28/2023 15:55	276.03	7
Primary Wire	PLANNED OUTAGE	8/29/2023 6:02	465.53	4
PLF	PLANNED OUTAGE	8/29/2023 8:34	175.50	1
PLF	PLANNED OUTAGE	8/29/2023 8:45	9,067.67	55
Transformer	PLANNED OUTAGE	8/29/2023 10:04	2,801.88	17
PLF	PLANNED OUTAGE	8/29/2023 10:17	73.03	1
Switch	PLANNED OUTAGE	8/29/2023 11:05	214.40	2
UG Other	PLANNED OUTAGE	8/29/2023 13:00	1,964.53	16
Transformer	PLANNED OUTAGE	8/29/2023 14:01	570.40	16
Transformer	PLANNED OUTAGE	8/29/2023 14:17	327.53	17
Transformer	PLANNED OUTAGE	8/29/2023 14:26	802.83	5
Breaker	PLANNED OUTAGE	8/29/2023 14:29	12,073.30	942
PLF	PLANNED OUTAGE	8/29/2023 14:31	7,441.87	88
PLF	PLANNED OUTAGE	8/29/2023 14:31	5,159.58	61
PLF	PLANNED OUTAGE	8/29/2023 14:31	3,014.07	29
PLF	PLANNED OUTAGE	8/29/2023 14:32	4,238.70	71
PLF	PLANNED OUTAGE	8/29/2023 14:40	1,285.20	17
PLF	PLANNED OUTAGE	8/29/2023 14:46	1,555.00	30
Switch	PLANNED OUTAGE	8/29/2023 14:47	221.10	6
Switch	PLANNED OUTAGE	8/29/2023 14:47	21,520.40	584
TX Repaired (OH)	PLANNED OUTAGE	8/29/2023 15:18	69.55	1
TX Repaired (OH)	PLANNED OUTAGE	8/29/2023 15:26	119.13	2
Switch	PLANNED OUTAGE	8/29/2023 15:33	11,982.07	941
Switch	PLANNED OUTAGE	8/29/2023 15:48	21.60	18
PLF	PLANNED OUTAGE	8/29/2023 15:49	736.83	10
PLF	PLANNED OUTAGE	8/29/2023 15:51	49.40	12
PLF	PLANNED OUTAGE	8/29/2023 16:04	100.47	1
PLF	PLANNED OUTAGE	8/29/2023 16:11	376.37	14
TX Repaired (OH)	PLANNED OUTAGE	8/29/2023 16:17	50.05	1
Transformer	PLANNED OUTAGE	8/29/2023 16:37	25.55	1
Primary Wire	PLANNED OUTAGE	8/29/2023 16:37	2,470.33	10
PLF	PLANNED OUTAGE	8/29/2023 16:44	418.20	6
TX Repaired (OH)	PLANNED OUTAGE	8/29/2023 16:56	293.90	1
PLF	PLANNED OUTAGE	8/29/2023 16:57	2,795.10	66
PLF	PLANNED OUTAGE	8/29/2023 17:14	466.20	3
PLF	PLANNED OUTAGE	8/29/2023 17:14	157.32	1
Primary Wire	PLANNED OUTAGE	8/29/2023 17:17	780.83	2
OH Other	PLANNED OUTAGE	8/29/2023 17:19	1,620.90	27
TX Repaired (OH)	PLANNED OUTAGE	8/29/2023 17:27	140.45	3
Transformer Bank	PLANNED OUTAGE	8/29/2023 17:42	88.52	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (OH)	PLANNED OUTAGE	8/29/2023 18:41	105.32	1
TX Replaced (PM)	PLANNED OUTAGE	8/29/2023 18:42	1,967.98	13
OH Other	PLANNED OUTAGE	8/29/2023 18:48	717.40	6
PLF	PLANNED OUTAGE	8/29/2023 19:13	3,168.55	77
PLF	PLANNED OUTAGE	8/29/2023 19:17	888.07	22
Service - Crew	PLANNED OUTAGE	8/29/2023 21:32	165.65	1
TX Repaired (OH)	PLANNED OUTAGE	8/29/2023 22:37	441.20	6
PLF	PLANNED OUTAGE	8/29/2023 22:49	595.93	28
PLF	PLANNED OUTAGE	8/29/2023 22:53	50.15	3
TX Repaired (PM)	PLANNED OUTAGE	8/29/2023 23:22	2,303.75	3
Breaker	PLANNED OUTAGE	8/29/2023 23:23	8,041.95	1449
Breaker	PLANNED OUTAGE	8/29/2023 23:23	20,378.78	319
TX Repaired (OH)	PLANNED OUTAGE	8/29/2023 23:29	47.98	1
PLF	PLANNED OUTAGE	8/29/2023 23:44	5,180.08	55
PLF	PLANNED OUTAGE	8/30/2023 0:03	10,195.50	45
Transformer	PLANNED OUTAGE	8/30/2023 0:18	3,179.25	5
Recloser	PLANNED OUTAGE	8/30/2023 0:18	1,299.47	44
Primary Wire	PLANNED OUTAGE	8/30/2023 0:28	13,277.60	42
Transformer	PLANNED OUTAGE	8/30/2023 0:34	511.20	8
PLF	PLANNED OUTAGE	8/30/2023 0:38	306.67	5
OCR, Sec.	PLANNED OUTAGE	8/30/2023 0:38	27,229.73	443
PLF	PLANNED OUTAGE	8/30/2023 0:46	56.72	1
Primary Wire	PLANNED OUTAGE	8/30/2023 0:49	3,514.20	4
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 0:51	28,545.83	85
PLF	PLANNED OUTAGE	8/30/2023 0:57	1,128.92	23
PLF	PLANNED OUTAGE	8/30/2023 1:04	8,238.40	48
PLF	PLANNED OUTAGE	8/30/2023 1:04	2,362.03	14
OH Other	PLANNED OUTAGE	8/30/2023 1:06	342,501.60	1044
OH Other	PLANNED OUTAGE	8/30/2023 1:06	273,936.37	658
OH Other	PLANNED OUTAGE	8/30/2023 1:17	345.28	1
OH Other	PLANNED OUTAGE	8/30/2023 1:17	8,632.08	25
OH Other	PLANNED OUTAGE	8/30/2023 1:17	1,381.13	4
PLF	PLANNED OUTAGE	8/30/2023 1:21	6,239.60	38
PLF	PLANNED OUTAGE	8/30/2023 1:32	29,878.00	30
Service point	PLANNED OUTAGE	8/30/2023 1:34	406.97	1
PLF	PLANNED OUTAGE	8/30/2023 1:36	6,231.00	15
PLF	PLANNED OUTAGE	8/30/2023 1:45	17,192.65	29
Transformer	PLANNED OUTAGE	8/30/2023 1:47	450.03	1
PLF	PLANNED OUTAGE	8/30/2023 1:54	37,033.33	55
OH Other	PLANNED OUTAGE	8/30/2023 1:54	333.48	1
PLF	PLANNED OUTAGE	8/30/2023 1:54	4,137.83	61
PLF	PLANNED OUTAGE	8/30/2023 1:56	3,406.08	7
Primary Wire	PLANNED OUTAGE	8/30/2023 2:01	9,668.63	14

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Circuit Out	PLANNED OUTAGE	8/30/2023 2:01	70,679.73	2032
PLF	PLANNED OUTAGE	8/30/2023 2:02	856.58	19
OH Other	PLANNED OUTAGE	8/30/2023 2:11	2,062.00	4
Primary Wire	PLANNED OUTAGE	8/30/2023 2:19	17,242.20	1674
Transformer	PLANNED OUTAGE	8/30/2023 2:21	1,647.27	4
Breaker	PLANNED OUTAGE	8/30/2023 2:24	19,315.80	588
Primary Wire	PLANNED OUTAGE	8/30/2023 2:32	206.70	3
Primary Wire	PLANNED OUTAGE	8/30/2023 2:38	653.55	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 2:48	361.75	1
Primary Wire	PLANNED OUTAGE	8/30/2023 3:04	7,192.25	15
Transformer	PLANNED OUTAGE	8/30/2023 3:07	1,287.73	4
PLF	PLANNED OUTAGE	8/30/2023 3:07	257.93	1
Transformer	PLANNED OUTAGE	8/30/2023 3:09	4,823.00	7
PLF	PLANNED OUTAGE	8/30/2023 3:26	7,863.35	29
Transformer Bank	PLANNED OUTAGE	8/30/2023 3:29	6,361.60	12
PLF	PLANNED OUTAGE	8/30/2023 3:38	33,817.13	268
PLF	PLANNED OUTAGE	8/30/2023 3:47	20,943.48	41
PLF	PLANNED OUTAGE	8/30/2023 3:51	2,374.52	7
Primary Wire	PLANNED OUTAGE	8/30/2023 3:52	483.22	79
Primary Wire	PLANNED OUTAGE	8/30/2023 3:52	3,829.03	626
PLF	PLANNED OUTAGE	8/30/2023 3:56	54,224.00	320
Breaker	PLANNED OUTAGE	8/30/2023 3:57	95,576.67	2705
Primary Wire	PLANNED OUTAGE	8/30/2023 3:59	8,852.67	14
Primary Wire	PLANNED OUTAGE	8/30/2023 4:00	334.28	1
OCR, Sec.	PLANNED OUTAGE	8/30/2023 4:02	183.87	56
OCR, Sec.	PLANNED OUTAGE	8/30/2023 4:02	3.52	1
OCR, Sec.	PLANNED OUTAGE	8/30/2023 4:02	3.25	1
OCR, Sec.	PLANNED OUTAGE	8/30/2023 4:02	58.27	23
OCR, Sec.	PLANNED OUTAGE	8/30/2023 4:02	1,238.17	437
OCR, Sec.	PLANNED OUTAGE	8/30/2023 4:02	82.65	29
OH Other	PLANNED OUTAGE	8/30/2023 4:06	11,761.00	15
OH Other	PLANNED OUTAGE	8/30/2023 4:06	1,168.70	29
OH Other	PLANNED OUTAGE	8/30/2023 4:06	3,638.62	89
OH Other	PLANNED OUTAGE	8/30/2023 4:06	12,044.20	294
OH Other	PLANNED OUTAGE	8/30/2023 4:06	40.85	1
OH Other	PLANNED OUTAGE	8/30/2023 4:06	40.85	1
OH Other	PLANNED OUTAGE	8/30/2023 4:06	5,433.05	133
Transformer Bank	PLANNED OUTAGE	8/30/2023 4:14	1,089.80	3
PLF	PLANNED OUTAGE	8/30/2023 4:27	5,362.00	140
PLF	PLANNED OUTAGE	8/30/2023 4:38	9,788.13	13
PLF	PLANNED OUTAGE	8/30/2023 4:54	12,604.55	21
PLF	PLANNED OUTAGE	8/30/2023 4:56	221.82	1
Switchgear	PLANNED OUTAGE	8/30/2023 4:57	60,390.00	440

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switchgear	PLANNED OUTAGE	8/30/2023 4:57	154,751.25	1423
PLF	PLANNED OUTAGE	8/30/2023 5:00	10,486.93	53
Transformer	PLANNED OUTAGE	8/30/2023 5:14	3,367.82	7
OH Other	PLANNED OUTAGE	8/30/2023 5:22	11,862.17	515
OH Other	PLANNED OUTAGE	8/30/2023 5:22	506.73	22
OH Other	PLANNED OUTAGE	8/30/2023 5:22	229.17	10
Breaker	PLANNED OUTAGE	8/30/2023 5:30	6,156.00	540
Breaker	PLANNED OUTAGE	8/30/2023 5:30	1,282.35	103
Primary Wire	PLANNED OUTAGE	8/30/2023 5:31	3,112.08	11
PLF	PLANNED OUTAGE	8/30/2023 5:34	3,638.48	13
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 5:36	208.07	2
Primary Wire	PLANNED OUTAGE	8/30/2023 5:39	9,315.20	48
Primary Wire	PLANNED OUTAGE	8/30/2023 5:49	62,345.83	65
PLF	PLANNED OUTAGE	8/30/2023 5:51	3,238.55	19
PLF	PLANNED OUTAGE	8/30/2023 5:53	69,574.05	91
PLF	PLANNED OUTAGE	8/30/2023 6:00	484.50	45
PLF	PLANNED OUTAGE	8/30/2023 6:00	1,024.50	5
PLF	PLANNED OUTAGE	8/30/2023 6:00	5,926.15	29
PLF	PLANNED OUTAGE	8/30/2023 6:00	16,994.25	83
PLF	PLANNED OUTAGE	8/30/2023 6:00	204.35	1
PLF	PLANNED OUTAGE	8/30/2023 6:04	6,109.20	36
OCR, Sec.	PLANNED OUTAGE	8/30/2023 6:04	24,724.23	322
OH Other	PLANNED OUTAGE	8/30/2023 6:06	247.20	1
PLF	PLANNED OUTAGE	8/30/2023 6:09	6,426.70	42
PLF	PLANNED OUTAGE	8/30/2023 6:09	918.10	6
PLF	PLANNED OUTAGE	8/30/2023 6:12	6,729.07	88
PLF	PLANNED OUTAGE	8/30/2023 6:12	152.87	2
PLF	PLANNED OUTAGE	8/30/2023 6:12	76.42	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 6:14	3,161.25	5
OH Other	PLANNED OUTAGE	8/30/2023 6:15	380.67	8
PLF	PLANNED OUTAGE	8/30/2023 6:17	2,021.85	27
PLF	PLANNED OUTAGE	8/30/2023 6:17	1,349.63	2
Primary Wire	PLANNED OUTAGE	8/30/2023 6:21	2,436.93	7
Service point	PLANNED OUTAGE	8/30/2023 6:24	250.20	1
OH Other	PLANNED OUTAGE	8/30/2023 6:27	393.67	4
PLF	PLANNED OUTAGE	8/30/2023 6:40	26.12	1
Transformer	PLANNED OUTAGE	8/30/2023 6:41	2,227.17	7
Transformer	PLANNED OUTAGE	8/30/2023 6:42	6,446.00	10
PLF	PLANNED OUTAGE	8/30/2023 6:50	14,851.20	96
PLF	PLANNED OUTAGE	8/30/2023 6:52	166.35	1
Transformer	PLANNED OUTAGE	8/30/2023 6:57	308.52	1
PLF	PLANNED OUTAGE	8/30/2023 6:57	116.55	111
PLF	PLANNED OUTAGE	8/30/2023 7:01	72,345.00	105

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	8/30/2023 7:01	106,748.50	155
PLF	PLANNED OUTAGE	8/30/2023 7:01	688.58	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 7:02	2,536.07	4
OH Other	PLANNED OUTAGE	8/30/2023 7:06	2,378.17	10
UG Other	PLANNED OUTAGE	8/30/2023 7:07	14,741.02	31
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 7:13	194.35	1
Switch	PLANNED OUTAGE	8/30/2023 7:14	12,749.15	849
PLF	PLANNED OUTAGE	8/30/2023 7:15	6,220.43	14
PLF	PLANNED OUTAGE	8/30/2023 7:15	2,413.35	27
Transformer	PLANNED OUTAGE	8/30/2023 7:15	1,958.47	4
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 7:17	493.70	3
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 7:19	20.77	2
Invalid	PLANNED OUTAGE	8/30/2023 7:23	61,841.72	911
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 7:25	1,588.30	7
Transformer	PLANNED OUTAGE	8/30/2023 7:28	1,104.60	4
PLF	PLANNED OUTAGE	8/30/2023 7:37	641.67	7
PLF	PLANNED OUTAGE	8/30/2023 7:37	144,864.08	1745
Primary Wire	PLANNED OUTAGE	8/30/2023 7:37	5,300.28	7
Service - Crew	PLANNED OUTAGE	8/30/2023 7:38	360.70	3
Primary Wire	PLANNED OUTAGE	8/30/2023 7:40	1,212.67	8
Primary Wire	PLANNED OUTAGE	8/30/2023 7:42	173,481.00	1155
PLF	PLANNED OUTAGE	8/30/2023 7:43	5,069.17	35
PLF	PLANNED OUTAGE	8/30/2023 7:47	455.93	1
Transformer	PLANNED OUTAGE	8/30/2023 7:54	1,265.80	3
PLF	PLANNED OUTAGE	8/30/2023 7:57	6,026.17	55
Service - Crew	PLANNED OUTAGE	8/30/2023 8:00	57.65	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 8:04	143.37	1
PLF	PLANNED OUTAGE	8/30/2023 8:15	32,494.72	31
PLF	PLANNED OUTAGE	8/30/2023 8:15	35,722.50	55
PLF	PLANNED OUTAGE	8/30/2023 8:15	6,418.10	78
PLF	PLANNED OUTAGE	8/30/2023 8:15	1,727.95	21
PLF	PLANNED OUTAGE	8/30/2023 8:15	1,048.23	1
PLF	PLANNED OUTAGE	8/30/2023 8:15	18,695.68	43
Breaker	PLANNED OUTAGE	8/30/2023 8:21	31,129.80	117
Transformer	PLANNED OUTAGE	8/30/2023 8:24	1,734.20	12
Breaker	PLANNED OUTAGE	8/30/2023 8:27	62,203.05	1519
Transformer	PLANNED OUTAGE	8/30/2023 8:29	2,139.67	4
Transformer	PLANNED OUTAGE	8/30/2023 8:30	5,320.00	10
OCR, Sec.	PLANNED OUTAGE	8/30/2023 8:31	10,370.22	911
Recloser	PLANNED OUTAGE	8/30/2023 8:32	1,859.00	39
PLF	PLANNED OUTAGE	8/30/2023 8:33	70.52	1
Primary Wire	PLANNED OUTAGE	8/30/2023 8:50	1,387.50	15
PLF	PLANNED OUTAGE	8/30/2023 8:51	18,517.15	59

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	8/30/2023 8:55	2,482.58	5
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 9:00	1,345.70	3
Service point	PLANNED OUTAGE	8/30/2023 9:05	6.02	1
PLF	PLANNED OUTAGE	8/30/2023 9:06	968.23	2
Switch 600 amp	PLANNED OUTAGE	8/30/2023 9:20	10,578.23	58
Primary Wire	PLANNED OUTAGE	8/30/2023 9:22	2,984.27	8
PLF	PLANNED OUTAGE	8/30/2023 9:54	12,154.73	92
PLF	PLANNED OUTAGE	8/30/2023 9:55	588.93	7
PLF	PLANNED OUTAGE	8/30/2023 10:06	278.33	1
OCR, Sec.	PLANNED OUTAGE	8/30/2023 10:08	306.20	6
OCR, Sec.	PLANNED OUTAGE	8/30/2023 10:08	1,867.60	322
PLF	PLANNED OUTAGE	8/30/2023 10:11	3,044.60	13
PLF	PLANNED OUTAGE	8/30/2023 10:12	1,600.65	9
Transformer	PLANNED OUTAGE	8/30/2023 10:14	1,592.00	6
PLF	PLANNED OUTAGE	8/30/2023 10:15	139.87	1
Primary Wire	PLANNED OUTAGE	8/30/2023 10:22	339.30	3
Primary Wire	PLANNED OUTAGE	8/30/2023 10:22	1,065.20	4
Recloser	PLANNED OUTAGE	8/30/2023 10:24	2,892.97	118
PLF	PLANNED OUTAGE	8/30/2023 10:26	2,719.90	118
PLF	PLANNED OUTAGE	8/30/2023 10:28	439.40	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 10:39	64.22	1
Transformer Bank	PLANNED OUTAGE	8/30/2023 10:39	931.30	3
Primary Wire	PLANNED OUTAGE	8/30/2023 10:43	2,553.50	6
Recloser	PLANNED OUTAGE	8/30/2023 10:48	4,388.05	31
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 10:51	123.10	1
Breaker	PLANNED OUTAGE	8/30/2023 10:51	16,938.72	469
Breaker	PLANNED OUTAGE	8/30/2023 10:52	114,284.23	2066
Breaker	PLANNED OUTAGE	8/30/2023 10:52	16,935.67	460
Breaker	PLANNED OUTAGE	8/30/2023 10:52	41,958.00	1080
OCR, Sec.	PLANNED OUTAGE	8/30/2023 11:00	538.40	6
OCR, Sec.	PLANNED OUTAGE	8/30/2023 11:00	646.00	152
Breaker	PLANNED OUTAGE	8/30/2023 11:18	19,949.77	443
Transformer	PLANNED OUTAGE	8/30/2023 11:32	2,358.27	8
OH Other	PLANNED OUTAGE	8/30/2023 11:36	1,538.00	5
Transformer	PLANNED OUTAGE	8/30/2023 11:40	286.62	1
PLF	PLANNED OUTAGE	8/30/2023 11:41	1,253.75	15
Transformer	PLANNED OUTAGE	8/30/2023 11:43	487.80	4
Transformer	PLANNED OUTAGE	8/30/2023 11:45	20.97	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 11:45	301.48	1
Transformer	PLANNED OUTAGE	8/30/2023 11:51	1,817.32	7
PLF	PLANNED OUTAGE	8/30/2023 11:53	2,391.78	19
PLF	PLANNED OUTAGE	8/30/2023 12:01	2,653.60	31
Breaker	PLANNED OUTAGE	8/30/2023 12:03	3,473.38	391

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
OH Other	PLANNED OUTAGE	8/30/2023 12:19	92.17	1
PLF	PLANNED OUTAGE	8/30/2023 12:24	21,126.20	73
PLF	PLANNED OUTAGE	8/30/2023 12:46	13,131.25	75
PLF	PLANNED OUTAGE	8/30/2023 12:57	1,353.60	27
OH Other	PLANNED OUTAGE	8/30/2023 12:57	134.07	2
PLF	PLANNED OUTAGE	8/30/2023 13:04	1,523.98	61
PLF	PLANNED OUTAGE	8/30/2023 13:09	951.73	8
PLF	PLANNED OUTAGE	8/30/2023 13:14	501.73	1
PLF	PLANNED OUTAGE	8/30/2023 13:17	1,013.17	10
Transformer	PLANNED OUTAGE	8/30/2023 13:21	684.60	12
PLF	PLANNED OUTAGE	8/30/2023 13:34	222.75	3
Primary Wire	PLANNED OUTAGE	8/30/2023 13:42	4,482.80	14
PLF	PLANNED OUTAGE	8/30/2023 13:47	394.45	7
Transformer	PLANNED OUTAGE	8/30/2023 13:55	488.40	12
OH Other	PLANNED OUTAGE	8/30/2023 14:00	13,018.60	1094
Transformer	PLANNED OUTAGE	8/30/2023 14:13	2,376.00	15
PLF	PLANNED OUTAGE	8/30/2023 14:13	2.92	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 14:16	404.25	9
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 14:16	553.95	3
Primary Wire	PLANNED OUTAGE	8/30/2023 14:21	442.65	39
Primary Wire	PLANNED OUTAGE	8/30/2023 14:21	33.05	3
Breaker	PLANNED OUTAGE	8/30/2023 14:24	1,021.25	129
PLF	PLANNED OUTAGE	8/30/2023 14:24	136.03	1
Breaker	PLANNED OUTAGE	8/30/2023 14:37	9,831.73	322
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 14:37	120.40	1
Transformer	PLANNED OUTAGE	8/30/2023 14:39	559.00	4
Transformer	PLANNED OUTAGE	8/30/2023 14:39	421.10	3
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 14:42	202.97	1
Primary Wire	PLANNED OUTAGE	8/30/2023 14:46	571.20	4
Transformer	PLANNED OUTAGE	8/30/2023 15:01	423.50	3
PLF	PLANNED OUTAGE	8/30/2023 15:15	172.70	11
OH Other	PLANNED OUTAGE	8/30/2023 15:22	2,978.98	11
Transformer	PLANNED OUTAGE	8/30/2023 15:25	286.50	9
Transformer	PLANNED OUTAGE	8/30/2023 15:42	894.75	9
Primary Wire	PLANNED OUTAGE	8/30/2023 15:55	489.37	2
Breaker	PLANNED OUTAGE	8/30/2023 15:55	77,530.48	1547
Transformer	PLANNED OUTAGE	8/30/2023 15:58	89.85	1
TX Repaired (PM)	PLANNED OUTAGE	8/30/2023 15:58	107.55	1
OH Other	PLANNED OUTAGE	8/30/2023 16:04	258.75	5
Primary Wire	PLANNED OUTAGE	8/30/2023 16:18	844.67	10
OH Other	PLANNED OUTAGE	8/30/2023 16:27	205.93	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 16:35	344.00	2
OH Other	PLANNED OUTAGE	8/30/2023 16:40	122.80	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	8/30/2023 16:46	1,465.33	16
Transformer	PLANNED OUTAGE	8/30/2023 16:48	1,335.53	13
Transformer	PLANNED OUTAGE	8/30/2023 16:51	2,767.13	2
PLF	PLANNED OUTAGE	8/30/2023 16:59	618.15	13
Service - Crew	PLANNED OUTAGE	8/30/2023 17:00	590.80	3
Primary Wire	PLANNED OUTAGE	8/30/2023 17:18	217.37	1
Primary Wire	PLANNED OUTAGE	8/30/2023 17:18	90,986.83	1889
PLF	PLANNED OUTAGE	8/30/2023 17:26	9,733.07	19
Transformer	PLANNED OUTAGE	8/30/2023 17:36	110.13	2
Transformer	PLANNED OUTAGE	8/30/2023 17:45	123.17	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 18:25	351.20	1
Transformer Bank	PLANNED OUTAGE	8/30/2023 18:32	308.12	7
OH Other	PLANNED OUTAGE	8/30/2023 18:51	57.18	1
Transformer Bank	PLANNED OUTAGE	8/30/2023 19:16	10.38	7
PLF	PLANNED OUTAGE	8/30/2023 19:50	1,911.72	19
Primary Wire	PLANNED OUTAGE	8/30/2023 19:59	327.48	1
Primary Wire	PLANNED OUTAGE	8/30/2023 19:59	982.00	3
Service - Crew	PLANNED OUTAGE	8/30/2023 20:22	52.43	1
TX Repaired (OH)	PLANNED OUTAGE	8/30/2023 20:27	296.50	5
Service - Crew	PLANNED OUTAGE	8/30/2023 20:37	442.53	1
Switch	PLANNED OUTAGE	8/30/2023 20:43	260.00	104
Primary Wire	PLANNED OUTAGE	8/30/2023 21:00	165.50	3
Primary Wire	PLANNED OUTAGE	8/30/2023 21:59	509.63	2
PLF	PLANNED OUTAGE	8/30/2023 22:19	46.05	1
PLF	PLANNED OUTAGE	8/30/2023 23:07	132.73	1
Service point	PLANNED OUTAGE	8/30/2023 23:51	103.37	1
Service point	PLANNED OUTAGE	8/31/2023 0:01	50.68	1
PLF	PLANNED OUTAGE	8/31/2023 0:45	2,438.00	69
PLF	PLANNED OUTAGE	8/31/2023 1:29	807.53	4
PLF	PLANNED OUTAGE	8/31/2023 1:29	9,119.67	109
TX Repaired (OH)	PLANNED OUTAGE	8/31/2023 4:04	401.75	5
PLF	PLANNED OUTAGE	8/31/2023 4:59	139.73	1
PLF	PLANNED OUTAGE	8/31/2023 5:05	8,390.55	63
TX Repaired (OH)	PLANNED OUTAGE	8/31/2023 5:17	846.70	3
Transformer	PLANNED OUTAGE	8/31/2023 7:01	253.65	19
Primary Wire	PLANNED OUTAGE	8/31/2023 7:27	439.37	7
Primary Wire	PLANNED OUTAGE	8/31/2023 7:27	2,573.43	41
Service point	PLANNED OUTAGE	8/31/2023 7:34	90.03	1
PLF	PLANNED OUTAGE	8/31/2023 7:50	1,811.40	18
TX Repaired (OH)	PLANNED OUTAGE	8/31/2023 7:52	34.63	2
URD Cable Cut	PLANNED OUTAGE	8/31/2023 7:59	82.83	7
Primary Wire	PLANNED OUTAGE	8/31/2023 8:18	1,649.33	4
Transformer	PLANNED OUTAGE	8/31/2023 8:34	1,298.27	7

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Service point	PLANNED OUTAGE	8/31/2023 8:35	78.50	1
Transformer	PLANNED OUTAGE	8/31/2023 8:43	1,425.97	11
Transformer	PLANNED OUTAGE	8/31/2023 9:16	1,276.50	15
Transformer	PLANNED OUTAGE	8/31/2023 9:50	733.33	10
Service point	PLANNED OUTAGE	8/31/2023 10:15	112.27	1
Transformer	PLANNED OUTAGE	8/31/2023 10:19	1,136.67	11
Transformer	PLANNED OUTAGE	8/31/2023 11:03	44.83	10
Transformer	PLANNED OUTAGE	8/31/2023 11:04	343.92	5
Transformer Bank	PLANNED OUTAGE	8/31/2023 11:17	29.00	1
Transformer	PLANNED OUTAGE	8/31/2023 11:46	3,356.40	8
Transformer	PLANNED OUTAGE	8/31/2023 12:03	28.78	11
Transformer	PLANNED OUTAGE	8/31/2023 12:06	22.55	11
Transformer	PLANNED OUTAGE	8/31/2023 13:43	682.50	15
Transformer	PLANNED OUTAGE	8/31/2023 13:54	1,585.60	6
Transformer	PLANNED OUTAGE	8/31/2023 15:18	2,237.77	11
UG Other	PLANNED OUTAGE	8/31/2023 15:47	2,406.15	9
Service point	PLANNED OUTAGE	8/31/2023 16:20	40.17	1
Service point	PLANNED OUTAGE	8/31/2023 16:20	40.08	1
Service point	PLANNED OUTAGE	8/31/2023 16:20	39.95	1
Transformer	PLANNED OUTAGE	8/31/2023 18:03	372.52	31
PLF	PLANNED OUTAGE	8/31/2023 18:12	138.27	2
Transformer Bank	PLANNED OUTAGE	8/31/2023 18:14	67.32	1
Transformer	PLANNED OUTAGE	8/31/2023 18:58	400.05	9
Transformer	PLANNED OUTAGE	8/31/2023 20:03	99.00	9
Transformer	PLANNED OUTAGE	8/31/2023 20:41	1,954.40	12
Transformer	PLANNED OUTAGE	8/31/2023 23:41	380.10	9
PLF	PLANNED OUTAGE	8/31/2023 23:42	1,012.35	17
Transformer	PLANNED OUTAGE	9/1/2023 8:01	16.75	5
Transformer	PLANNED OUTAGE	9/1/2023 8:04	1,628.13	8
Transformer	PLANNED OUTAGE	9/1/2023 9:17	75.57	2
Transformer	PLANNED OUTAGE	9/1/2023 10:24	1,219.62	13
Transformer	PLANNED OUTAGE	9/1/2023 11:31	148.40	6
Transformer	PLANNED OUTAGE	9/1/2023 11:33	403.52	11
Transformer	PLANNED OUTAGE	9/1/2023 11:33	1,254.00	10
PLF	PLANNED OUTAGE	9/1/2023 11:55	7,368.43	14
PLF	PLANNED OUTAGE	9/1/2023 13:37	637.20	108
Transformer	PLANNED OUTAGE	9/1/2023 13:44	81.83	5
Service point	PLANNED OUTAGE	9/1/2023 16:03	18.62	1
Primary Wire	PLANNED OUTAGE	9/1/2023 16:14	5,829.87	32
Transformer	PLANNED OUTAGE	9/1/2023 18:44	217.50	9
PLF	PLANNED OUTAGE	9/2/2023 0:26	31.12	1
PLF	PLANNED OUTAGE	9/2/2023 2:08	322.90	6
Primary Wire	PLANNED OUTAGE	9/2/2023 4:00	8,373.87	16

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/2/2023 5:48	288.60	12
Transformer	PLANNED OUTAGE	9/2/2023 9:16	726.35	3
Transformer	PLANNED OUTAGE	9/2/2023 10:10	910.47	2
PLF	PLANNED OUTAGE	9/2/2023 10:10	307.68	1
Transformer	PLANNED OUTAGE	9/2/2023 14:24	118.07	4
Transformer	PLANNED OUTAGE	9/2/2023 15:58	1,211.80	12
Transformer	PLANNED OUTAGE	9/2/2023 17:09	145.30	6
Transformer	PLANNED OUTAGE	9/2/2023 18:30	480.75	9
Transformer	PLANNED OUTAGE	9/3/2023 0:00	35.85	3
Transformer	PLANNED OUTAGE	9/3/2023 12:07	23.43	1
Transformer	PLANNED OUTAGE	9/3/2023 12:07	18.57	1
Transformer	PLANNED OUTAGE	9/3/2023 12:20	305.08	5
Transformer	PLANNED OUTAGE	9/3/2023 13:05	15.15	1
Transformer	PLANNED OUTAGE	9/3/2023 13:56	41.52	1
Transformer	PLANNED OUTAGE	9/3/2023 14:40	50.03	1
Transformer Bank	PLANNED OUTAGE	9/3/2023 14:51	101.05	3
Transformer	PLANNED OUTAGE	9/3/2023 15:31	54.30	1
Transformer	PLANNED OUTAGE	9/3/2023 16:38	53.20	2
PLF	PLANNED OUTAGE	9/3/2023 21:16	963.00	18
PLF	PLANNED OUTAGE	9/3/2023 21:44	41.15	1
Transformer	PLANNED OUTAGE	9/3/2023 22:30	702.20	6
Transformer	PLANNED OUTAGE	9/4/2023 0:25	48.50	2
Transformer	PLANNED OUTAGE	9/4/2023 1:43	34.47	2
Transformer	PLANNED OUTAGE	9/4/2023 2:00	27.58	1
Transformer	PLANNED OUTAGE	9/4/2023 2:04	27.03	1
PLF	PLANNED OUTAGE	9/4/2023 7:12	2,081.70	6
Transformer	PLANNED OUTAGE	9/4/2023 14:04	504.53	11
Transformer	PLANNED OUTAGE	9/4/2023 14:24	413.33	16
Transformer	PLANNED OUTAGE	9/4/2023 14:54	127.98	7
PLF	PLANNED OUTAGE	9/4/2023 15:15	300.93	1
Transformer	PLANNED OUTAGE	9/4/2023 16:38	289.70	1
Transformer	PLANNED OUTAGE	9/4/2023 16:43	1,294.00	8
Transformer	PLANNED OUTAGE	9/4/2023 17:42	47.68	1
Transformer	PLANNED OUTAGE	9/4/2023 18:12	165.92	11
Transformer	PLANNED OUTAGE	9/5/2023 0:46	47.25	3
Transformer	PLANNED OUTAGE	9/5/2023 1:08	36.13	4
Transformer	PLANNED OUTAGE	9/5/2023 1:22	72.83	2
Transformer Bank	PLANNED OUTAGE	9/5/2023 8:29	1,532.87	4
Transformer	PLANNED OUTAGE	9/5/2023 9:34	634.00	6
Transformer	PLANNED OUTAGE	9/5/2023 9:36	84.23	2
PLF	PLANNED OUTAGE	9/5/2023 10:48	3,093.20	76
PLF	PLANNED OUTAGE	9/5/2023 11:29	515.53	76
PLF	PLANNED OUTAGE	9/5/2023 11:29	136.80	76

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	9/5/2023 11:36	3,725.27	76
PLF	PLANNED OUTAGE	9/5/2023 12:48	255.53	1
Transformer	PLANNED OUTAGE	9/5/2023 13:15	148.75	3
Transformer	PLANNED OUTAGE	9/5/2023 14:16	426.70	6
Transformer	PLANNED OUTAGE	9/5/2023 15:35	37.55	1
Transformer Bank	PLANNED OUTAGE	9/5/2023 16:18	168.15	9
Transformer	PLANNED OUTAGE	9/5/2023 19:50	276.70	6
Transformer	PLANNED OUTAGE	9/5/2023 23:42	10.02	1
Transformer	PLANNED OUTAGE	9/5/2023 23:57	35.27	2
Service point	PLANNED OUTAGE	9/6/2023 1:13	8.25	1
Breaker	PLANNED OUTAGE	9/6/2023 6:45	13,238.55	351
Breaker	PLANNED OUTAGE	9/6/2023 7:06	11,128.40	647
Transformer	PLANNED OUTAGE	9/6/2023 8:40	105.20	3
Transformer	PLANNED OUTAGE	9/6/2023 8:42	1,413.87	11
Transformer Bank	PLANNED OUTAGE	9/6/2023 8:52	79.87	4
Transformer	PLANNED OUTAGE	9/6/2023 9:44	85.80	3
Transformer	PLANNED OUTAGE	9/6/2023 10:23	149.53	2
Transformer	PLANNED OUTAGE	9/6/2023 11:07	1,401.20	8
Transformer	PLANNED OUTAGE	9/6/2023 11:16	116.88	1
PLF	PLANNED OUTAGE	9/6/2023 11:26	44.73	1
Transformer	PLANNED OUTAGE	9/6/2023 11:35	1,291.15	7
Transformer	PLANNED OUTAGE	9/6/2023 11:56	132.07	4
Transformer	PLANNED OUTAGE	9/6/2023 11:58	250.27	8
Transformer	PLANNED OUTAGE	9/6/2023 12:16	304.00	10
Transformer	PLANNED OUTAGE	9/6/2023 12:53	1,738.82	19
Primary Wire	PLANNED OUTAGE	9/6/2023 13:10	153.40	13
Transformer	PLANNED OUTAGE	9/6/2023 13:46	54.37	7
Transformer	PLANNED OUTAGE	9/6/2023 13:49	271.47	8
Transformer	PLANNED OUTAGE	9/6/2023 14:59	145.60	2
Transformer	PLANNED OUTAGE	9/6/2023 15:02	187.00	3
Transformer Bank	PLANNED OUTAGE	9/6/2023 18:21	680.33	20
Pole	PLANNED OUTAGE	9/7/2023 2:26	2,940.33	10
Transformer	PLANNED OUTAGE	9/7/2023 9:23	1,548.17	7
Transformer	PLANNED OUTAGE	9/7/2023 9:57	205.00	1
Transformer	PLANNED OUTAGE	9/7/2023 10:10	583.50	6
Transformer	PLANNED OUTAGE	9/7/2023 10:16	2,294.95	7
Transformer	PLANNED OUTAGE	9/7/2023 12:06	169.70	6
Transformer	PLANNED OUTAGE	9/7/2023 13:10	313.83	2
Transformer	PLANNED OUTAGE	9/7/2023 13:16	279.50	6
Transformer	PLANNED OUTAGE	9/7/2023 13:28	1,802.27	14
PLF	PLANNED OUTAGE	9/7/2023 14:06	1,512.37	59
Transformer	PLANNED OUTAGE	9/7/2023 14:41	137.83	5
Transformer	PLANNED OUTAGE	9/7/2023 15:15	27.53	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/7/2023 15:52	334.75	3
Transformer	PLANNED OUTAGE	9/7/2023 15:58	82.53	8
Transformer	PLANNED OUTAGE	9/7/2023 16:08	28.40	8
Transformer	PLANNED OUTAGE	9/7/2023 16:08	10.53	8
Transformer	PLANNED OUTAGE	9/7/2023 16:12	12.00	8
Transformer Bank	PLANNED OUTAGE	9/7/2023 16:55	450.67	4
PLF	PLANNED OUTAGE	9/7/2023 19:45	1,380.40	102
PLF	PLANNED OUTAGE	9/8/2023 8:47	466.73	2
Transformer	PLANNED OUTAGE	9/8/2023 8:59	108.10	6
Transformer	PLANNED OUTAGE	9/8/2023 9:35	287.20	2
PLF	PLANNED OUTAGE	9/8/2023 9:54	74.40	2
Transformer	PLANNED OUTAGE	9/8/2023 10:08	238.93	7
Transformer	PLANNED OUTAGE	9/8/2023 10:08	183.60	12
Transformer	PLANNED OUTAGE	9/8/2023 10:41	40.50	1
PLF	PLANNED OUTAGE	9/8/2023 11:46	101.40	2
Transformer	PLANNED OUTAGE	9/8/2023 14:43	15.68	1
Transformer	PLANNED OUTAGE	9/8/2023 15:26	1,404.82	31
Transformer	PLANNED OUTAGE	9/8/2023 15:58	684.00	18
PLF	PLANNED OUTAGE	9/8/2023 18:38	384.42	1
PLF	PLANNED OUTAGE	9/9/2023 6:09	425.47	8
Transformer	PLANNED OUTAGE	9/9/2023 12:25	168.10	6
Transformer	PLANNED OUTAGE	9/9/2023 14:26	67.45	3
Transformer	PLANNED OUTAGE	9/9/2023 16:30	1,062.00	5
Transformer	PLANNED OUTAGE	9/9/2023 17:07	1,706.60	14
Transformer	PLANNED OUTAGE	9/9/2023 19:35	589.53	4
PLF	PLANNED OUTAGE	9/10/2023 0:15	67.10	6
PLF	PLANNED OUTAGE	9/10/2023 4:56	616.18	11
Transformer	PLANNED OUTAGE	9/10/2023 9:55	57.80	6
Transformer	PLANNED OUTAGE	9/10/2023 10:01	39.15	9
Transformer	PLANNED OUTAGE	9/10/2023 10:32	545.13	17
Transformer Bank	PLANNED OUTAGE	9/10/2023 15:39	52.73	2
Transformer	PLANNED OUTAGE	9/10/2023 16:43	1,022.58	5
Transformer Bank	PLANNED OUTAGE	9/10/2023 19:49	140.33	5
Transformer	PLANNED OUTAGE	9/10/2023 21:53	431.30	6
Transformer	PLANNED OUTAGE	9/10/2023 21:57	68.68	1
Transformer	PLANNED OUTAGE	9/10/2023 23:56	83.60	8
Transformer	PLANNED OUTAGE	9/11/2023 0:10	9.60	8
Transformer	PLANNED OUTAGE	9/11/2023 0:11	14.93	8
PLF	PLANNED OUTAGE	9/11/2023 8:15	885.20	4
Transformer	PLANNED OUTAGE	9/11/2023 9:47	227.70	2
Transformer	PLANNED OUTAGE	9/11/2023 9:47	1,031.20	6
Transformer	PLANNED OUTAGE	9/11/2023 9:48	1,843.42	11
Transformer	PLANNED OUTAGE	9/11/2023 10:02	217.15	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/11/2023 10:06	396.13	2
Transformer	PLANNED OUTAGE	9/11/2023 10:15	61.75	1
Transformer	PLANNED OUTAGE	9/11/2023 12:03	495.58	5
Primary Wire	PLANNED OUTAGE	9/11/2023 12:07	42.60	6
Transformer	PLANNED OUTAGE	9/11/2023 13:25	51.40	1
Transformer	PLANNED OUTAGE	9/11/2023 13:36	470.20	12
Transformer	PLANNED OUTAGE	9/11/2023 16:27	720.55	3
Transformer	PLANNED OUTAGE	9/11/2023 16:31	16.00	6
Transformer	PLANNED OUTAGE	9/11/2023 16:31	11.50	6
Transformer	PLANNED OUTAGE	9/11/2023 17:35	156.68	7
PLF	PLANNED OUTAGE	9/11/2023 18:48	49.55	3
PLF	PLANNED OUTAGE	9/11/2023 20:48	46.18	1
Service point	PLANNED OUTAGE	9/11/2023 23:32	352.62	1
Transformer	PLANNED OUTAGE	9/12/2023 8:53	194.37	7
PLF	PLANNED OUTAGE	9/12/2023 8:54	1,353.92	55
Transformer	PLANNED OUTAGE	9/12/2023 8:59	3,434.93	8
Transformer	PLANNED OUTAGE	9/12/2023 9:01	87.07	1
PLF	PLANNED OUTAGE	9/12/2023 9:19	301.58	55
PLF	PLANNED OUTAGE	9/12/2023 9:19	2,927.27	38
PLF	PLANNED OUTAGE	9/12/2023 9:25	675.58	55
Transformer	PLANNED OUTAGE	9/12/2023 9:45	36.87	4
Transformer	PLANNED OUTAGE	9/12/2023 9:54	3,164.20	12
Transformer Bank	PLANNED OUTAGE	9/12/2023 10:16	170.40	8
Transformer	PLANNED OUTAGE	9/12/2023 11:56	326.13	4
Transformer	PLANNED OUTAGE	9/12/2023 13:29	969.00	12
Transformer	PLANNED OUTAGE	9/12/2023 14:21	97.00	15
Transformer	PLANNED OUTAGE	9/12/2023 14:42	61.42	5
Transformer	PLANNED OUTAGE	9/12/2023 15:11	33.17	5
Transformer	PLANNED OUTAGE	9/12/2023 15:54	290.80	4
Transformer	PLANNED OUTAGE	9/12/2023 16:19	17.93	1
Transformer	PLANNED OUTAGE	9/12/2023 16:31	78.42	1
Transformer	PLANNED OUTAGE	9/12/2023 16:45	12.12	1
PLF	PLANNED OUTAGE	9/12/2023 18:00	2,517.73	8
Breaker	PLANNED OUTAGE	9/12/2023 19:04	6,337.30	998
Breaker	PLANNED OUTAGE	9/12/2023 19:04	4,578.35	721
PLF	PLANNED OUTAGE	9/12/2023 20:41	248.70	9
Transformer	PLANNED OUTAGE	9/12/2023 22:26	790.95	3
Transformer	PLANNED OUTAGE	9/12/2023 22:44	505.67	10
Service point	PLANNED OUTAGE	9/13/2023 4:50	154.75	1
Transformer	PLANNED OUTAGE	9/13/2023 8:55	320.87	4
Transformer	PLANNED OUTAGE	9/13/2023 8:55	452.00	5
Transformer	PLANNED OUTAGE	9/13/2023 9:34	65.63	1
Transformer	PLANNED OUTAGE	9/13/2023 10:10	17.67	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/13/2023 10:29	16.53	4
Transformer	PLANNED OUTAGE	9/13/2023 10:37	6.50	6
Transformer	PLANNED OUTAGE	9/13/2023 10:58	1,706.52	17
Transformer	PLANNED OUTAGE	9/13/2023 11:24	3,132.20	6
Transformer	PLANNED OUTAGE	9/13/2023 12:03	391.55	3
Transformer	PLANNED OUTAGE	9/13/2023 12:33	113.75	7
Transformer	PLANNED OUTAGE	9/13/2023 12:40	129.08	5
Transformer	PLANNED OUTAGE	9/13/2023 12:50	24.03	7
Transformer	PLANNED OUTAGE	9/13/2023 12:53	22.75	7
Transformer	PLANNED OUTAGE	9/13/2023 13:00	1,051.92	13
Transformer	PLANNED OUTAGE	9/13/2023 13:52	330.20	4
Transformer	PLANNED OUTAGE	9/13/2023 14:16	1,495.00	10
Transformer	PLANNED OUTAGE	9/13/2023 14:42	1,061.75	31
Breaker	PLANNED OUTAGE	9/13/2023 14:46	45.80	1
Breaker	PLANNED OUTAGE	9/13/2023 14:46	31,580.03	718
PLF	PLANNED OUTAGE	9/13/2023 18:19	1,108.33	2
Transformer	PLANNED OUTAGE	9/13/2023 18:41	21.43	1
Transformer	PLANNED OUTAGE	9/13/2023 19:23	18.58	1
PLF	PLANNED OUTAGE	9/13/2023 20:11	786.20	4
Transformer Bank	PLANNED OUTAGE	9/13/2023 20:47	11.37	2
PLF	PLANNED OUTAGE	9/14/2023 0:50	407.25	27
PLF	PLANNED OUTAGE	9/14/2023 1:43	21.33	1
Transformer	PLANNED OUTAGE	9/14/2023 3:25	30.07	4
Transformer	PLANNED OUTAGE	9/14/2023 3:33	7.40	4
PLF	PLANNED OUTAGE	9/14/2023 8:38	985.25	21
Transformer	PLANNED OUTAGE	9/14/2023 8:42	1,356.03	17
PLF	PLANNED OUTAGE	9/14/2023 9:01	113.55	1
PLF	PLANNED OUTAGE	9/14/2023 9:53	228.65	17
PLF	PLANNED OUTAGE	9/14/2023 10:08	42.50	17
PLF	PLANNED OUTAGE	9/14/2023 10:19	4,627.47	14
Transformer	PLANNED OUTAGE	9/14/2023 10:21	63.35	3
Transformer	PLANNED OUTAGE	9/14/2023 10:46	125.20	4
PLF	PLANNED OUTAGE	9/14/2023 10:52	83.40	4
PLF	PLANNED OUTAGE	9/14/2023 10:52	3,271.02	13
Transformer	PLANNED OUTAGE	9/14/2023 10:56	128.05	3
PLF	PLANNED OUTAGE	9/14/2023 11:07	197.60	1
Transformer	PLANNED OUTAGE	9/14/2023 13:12	78.30	9
Transformer	PLANNED OUTAGE	9/14/2023 13:13	6,594.13	44
Transformer	PLANNED OUTAGE	9/14/2023 13:13	168.67	1
Transformer	PLANNED OUTAGE	9/14/2023 14:56	34.28	1
Transformer	PLANNED OUTAGE	9/14/2023 15:34	20.62	1
Transformer	PLANNED OUTAGE	9/14/2023 15:50	195.50	17
Transformer	PLANNED OUTAGE	9/14/2023 16:04	487.47	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Recloser	PLANNED OUTAGE	9/14/2023 17:10	6,634.55	177
Recloser	PLANNED OUTAGE	9/14/2023 17:10	355.35	9
Transformer	PLANNED OUTAGE	9/14/2023 17:53	579.67	4
PLF	PLANNED OUTAGE	9/14/2023 20:02	416.63	1
Transformer Bank	PLANNED OUTAGE	9/14/2023 20:09	390.60	1
Transformer	PLANNED OUTAGE	9/15/2023 1:29	34.42	1
Transformer	PLANNED OUTAGE	9/15/2023 2:09	74.93	4
TX Replaced (OH)	PLANNED OUTAGE	9/15/2023 9:14	431.50	1
PLF	PLANNED OUTAGE	9/15/2023 9:15	2,489.08	35
Transformer	PLANNED OUTAGE	9/15/2023 11:22	99.70	6
Transformer	PLANNED OUTAGE	9/15/2023 11:38	7.50	6
PLF	PLANNED OUTAGE	9/15/2023 13:32	110.80	1
Transformer	PLANNED OUTAGE	9/15/2023 13:37	102.05	3
Transformer	PLANNED OUTAGE	9/15/2023 14:23	62.25	3
Transformer	PLANNED OUTAGE	9/15/2023 15:05	41.07	2
Transformer	PLANNED OUTAGE	9/15/2023 16:14	15.65	3
PLF	PLANNED OUTAGE	9/15/2023 16:18	20.43	2
Transformer	PLANNED OUTAGE	9/15/2023 17:00	72.00	3
Transformer	PLANNED OUTAGE	9/15/2023 18:06	1,285.33	8
Transformer	PLANNED OUTAGE	9/15/2023 18:49	174.00	1
PLF	PLANNED OUTAGE	9/16/2023 8:41	234.47	1
OCR, Sec.	PLANNED OUTAGE	9/16/2023 9:28	42,143.33	376
PLF	PLANNED OUTAGE	9/16/2023 13:26	72.77	1
Transformer	PLANNED OUTAGE	9/16/2023 14:24	15.53	1
Transformer	PLANNED OUTAGE	9/16/2023 14:49	407.17	7
Transformer	PLANNED OUTAGE	9/16/2023 14:54	36.90	1
PLF	PLANNED OUTAGE	9/16/2023 15:14	191.95	3
Transformer	PLANNED OUTAGE	9/16/2023 15:36	69.98	1
Transformer	PLANNED OUTAGE	9/16/2023 16:50	41.85	1
Transformer	PLANNED OUTAGE	9/16/2023 17:46	1,762.33	10
Transformer	PLANNED OUTAGE	9/17/2023 1:24	79.65	3
Transformer	PLANNED OUTAGE	9/17/2023 1:51	38.30	3
Transformer	PLANNED OUTAGE	9/17/2023 12:04	424.70	6
Transformer	PLANNED OUTAGE	9/17/2023 14:05	119.35	3
Transformer	PLANNED OUTAGE	9/17/2023 15:07	143.00	4
Transformer	PLANNED OUTAGE	9/17/2023 15:11	747.07	4
Transformer	PLANNED OUTAGE	9/17/2023 16:16	71.87	4
Transformer	PLANNED OUTAGE	9/17/2023 16:39	74.37	2
Transformer	PLANNED OUTAGE	9/17/2023 18:12	1,355.68	13
Transformer	PLANNED OUTAGE	9/17/2023 18:17	248.07	4
Transformer	PLANNED OUTAGE	9/17/2023 19:27	56.02	1
Transformer	PLANNED OUTAGE	9/17/2023 23:32	215.10	9
Transformer	PLANNED OUTAGE	9/18/2023 3:24	24.80	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/18/2023 9:14	35.32	1
Transformer	PLANNED OUTAGE	9/18/2023 10:03	513.60	4
PLF	PLANNED OUTAGE	9/18/2023 10:17	333.57	1
Service point	PLANNED OUTAGE	9/18/2023 10:51	33.67	1
Transformer	PLANNED OUTAGE	9/18/2023 11:45	543.27	2
Transformer	PLANNED OUTAGE	9/18/2023 14:16	179.80	4
Breaker	PLANNED OUTAGE	9/18/2023 14:20	12,762.75	1365
Transformer	PLANNED OUTAGE	9/18/2023 18:20	70.87	4
Transformer	PLANNED OUTAGE	9/18/2023 19:21	1,561.17	29
Transformer	PLANNED OUTAGE	9/18/2023 20:45	85.15	3
Transformer	PLANNED OUTAGE	9/18/2023 21:14	27.62	1
Service point	PLANNED OUTAGE	9/18/2023 22:48	210.30	1
Transformer	PLANNED OUTAGE	9/18/2023 23:34	27.37	2
Transformer	PLANNED OUTAGE	9/18/2023 23:43	153.17	10
Transformer	PLANNED OUTAGE	9/19/2023 0:11	26.30	2
Transformer	PLANNED OUTAGE	9/19/2023 0:30	69.53	4
Transformer	PLANNED OUTAGE	9/19/2023 8:59	138.95	7
Transformer	PLANNED OUTAGE	9/19/2023 9:12	390.67	4
Transformer	PLANNED OUTAGE	9/19/2023 10:17	2,415.00	7
Transformer	PLANNED OUTAGE	9/19/2023 11:13	127.50	1
PLF	PLANNED OUTAGE	9/19/2023 11:46	108.67	1
PLF	PLANNED OUTAGE	9/19/2023 12:17	619.85	3
Transformer	PLANNED OUTAGE	9/19/2023 13:37	135.80	4
Transformer	PLANNED OUTAGE	9/19/2023 14:04	3,292.85	11
Transformer	PLANNED OUTAGE	9/19/2023 14:17	289.93	4
Transformer	PLANNED OUTAGE	9/19/2023 15:30	143.27	4
Transformer	PLANNED OUTAGE	9/19/2023 16:00	710.73	4
Transformer	PLANNED OUTAGE	9/19/2023 16:02	116.83	1
PLF	PLANNED OUTAGE	9/19/2023 17:08	436.60	6
Transformer	PLANNED OUTAGE	9/19/2023 19:57	801.38	7
PLF	PLANNED OUTAGE	9/19/2023 22:01	259.07	1
Transformer	PLANNED OUTAGE	9/20/2023 0:30	81.35	3
Primary Wire	PLANNED OUTAGE	9/20/2023 7:43	1,364.93	4
Primary Wire	PLANNED OUTAGE	9/20/2023 7:43	1,964.00	10
Transformer	PLANNED OUTAGE	9/20/2023 8:28	530.22	1
Transformer	PLANNED OUTAGE	9/20/2023 9:55	274.08	5
Transformer	PLANNED OUTAGE	9/20/2023 10:46	385.73	8
Transformer	PLANNED OUTAGE	9/20/2023 10:46	703.05	3
Transformer	PLANNED OUTAGE	9/20/2023 12:06	1,156.78	19
Transformer	PLANNED OUTAGE	9/20/2023 13:11	261.07	4
Transformer	PLANNED OUTAGE	9/20/2023 13:11	60.60	1
PLF	PLANNED OUTAGE	9/20/2023 16:58	3,668.25	67
Transformer	PLANNED OUTAGE	9/20/2023 18:30	266.27	8

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	9/20/2023 19:06	418.00	2
Transformer	PLANNED OUTAGE	9/20/2023 19:49	178.67	5
Transformer	PLANNED OUTAGE	9/20/2023 20:57	63.07	1
Transformer	PLANNED OUTAGE	9/20/2023 20:58	62.07	1
Transformer	PLANNED OUTAGE	9/20/2023 21:12	48.35	1
PLF	PLANNED OUTAGE	9/20/2023 22:00	34.97	1
PLF	PLANNED OUTAGE	9/20/2023 22:10	295.60	8
Recloser	PLANNED OUTAGE	9/20/2023 23:42	340.65	3
Transformer	PLANNED OUTAGE	9/21/2023 8:52	638.40	9
Transformer	PLANNED OUTAGE	9/21/2023 9:11	2,114.70	7
Transformer	PLANNED OUTAGE	9/21/2023 9:16	2,299.38	7
Transformer	PLANNED OUTAGE	9/21/2023 9:17	2,566.33	10
Primary Wire	PLANNED OUTAGE	9/21/2023 9:25	821.95	3
PLF	PLANNED OUTAGE	9/21/2023 9:41	331.73	4
Service point	PLANNED OUTAGE	9/21/2023 10:04	13.92	1
Transformer	PLANNED OUTAGE	9/21/2023 10:17	383.27	4
Service point	PLANNED OUTAGE	9/21/2023 10:36	37.90	1
Transformer	PLANNED OUTAGE	9/21/2023 10:52	49.93	4
PLF	PLANNED OUTAGE	9/21/2023 12:18	176.53	1
Transformer	PLANNED OUTAGE	9/21/2023 13:05	168.00	5
Transformer	PLANNED OUTAGE	9/21/2023 14:28	163.10	2
Transformer	PLANNED OUTAGE	9/21/2023 14:30	80.95	3
Transformer	PLANNED OUTAGE	9/21/2023 15:10	61.20	3
Transformer	PLANNED OUTAGE	9/21/2023 15:10	1,001.25	3
Transformer	PLANNED OUTAGE	9/21/2023 15:21	608.17	10
Transformer	PLANNED OUTAGE	9/21/2023 15:31	50.93	1
Transformer	PLANNED OUTAGE	9/21/2023 15:31	50.60	1
PLF	PLANNED OUTAGE	9/21/2023 17:03	25.47	1
Transformer	PLANNED OUTAGE	9/21/2023 20:11	160.13	4
PLF	PLANNED OUTAGE	9/21/2023 21:47	607.02	43
Recloser	PLANNED OUTAGE	9/22/2023 7:50	1,940.83	50
Primary Wire	PLANNED OUTAGE	9/22/2023 8:26	788.20	3
Transformer Bank	PLANNED OUTAGE	9/22/2023 8:45	221.80	4
Transformer	PLANNED OUTAGE	9/22/2023 9:18	267.87	8
PLF	PLANNED OUTAGE	9/22/2023 9:35	146.22	1
Primary Wire	PLANNED OUTAGE	9/22/2023 10:04	634.88	11
PLF	PLANNED OUTAGE	9/22/2023 12:42	2,529.87	106
PLF	PLANNED OUTAGE	9/22/2023 13:14	21.07	1
Transformer	PLANNED OUTAGE	9/22/2023 13:49	82.60	1
Transformer	PLANNED OUTAGE	9/22/2023 14:46	341.17	2
Transformer	PLANNED OUTAGE	9/22/2023 15:13	119.30	2
Transformer	PLANNED OUTAGE	9/22/2023 15:20	47.30	2
Transformer	PLANNED OUTAGE	9/22/2023 15:47	23.27	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/22/2023 16:17	35.77	2
Transformer	PLANNED OUTAGE	9/22/2023 16:47	54.90	3
Transformer	PLANNED OUTAGE	9/22/2023 17:23	85.53	4
Transformer	PLANNED OUTAGE	9/22/2023 17:36	6.08	5
Transformer	PLANNED OUTAGE	9/22/2023 17:52	28.57	1
Transformer	PLANNED OUTAGE	9/22/2023 17:52	102.33	2
Transformer	PLANNED OUTAGE	9/22/2023 19:37	154.95	9
Transformer Bank	PLANNED OUTAGE	9/22/2023 22:21	43.67	4
PLF	PLANNED OUTAGE	9/22/2023 22:56	289.30	22
Transformer	PLANNED OUTAGE	9/23/2023 6:16	312.07	4
Transformer	PLANNED OUTAGE	9/23/2023 7:42	370.00	1
Transformer	PLANNED OUTAGE	9/23/2023 8:21	98.75	1
Switch	PLANNED OUTAGE	9/23/2023 8:25	340.50	1
PLF	PLANNED OUTAGE	9/23/2023 8:47	3,045.70	14
Transformer	PLANNED OUTAGE	9/23/2023 13:55	66.57	1
Transformer	PLANNED OUTAGE	9/23/2023 16:45	45.35	3
Transformer	PLANNED OUTAGE	9/23/2023 18:12	75.03	2
Transformer	PLANNED OUTAGE	9/23/2023 18:39	11.55	1
Transformer	PLANNED OUTAGE	9/23/2023 20:58	121.45	7
Transformer	PLANNED OUTAGE	9/23/2023 21:16	119.58	7
PLF	PLANNED OUTAGE	9/24/2023 5:25	7,016.53	26
PLF	PLANNED OUTAGE	9/24/2023 5:25	1,580.17	19
PLF	PLANNED OUTAGE	9/24/2023 5:25	5,919.10	22
Transformer	PLANNED OUTAGE	9/24/2023 9:59	246.87	1
Transformer	PLANNED OUTAGE	9/24/2023 15:50	120.10	3
Transformer	PLANNED OUTAGE	9/24/2023 18:48	50.78	1
Transformer	PLANNED OUTAGE	9/24/2023 19:17	942.67	8
Transformer	PLANNED OUTAGE	9/24/2023 21:23	9,060.80	21
Transformer	PLANNED OUTAGE	9/25/2023 2:19	1,289.28	7
PLF	PLANNED OUTAGE	9/25/2023 4:18	3,285.87	16
Transformer	PLANNED OUTAGE	9/25/2023 9:15	602.33	10
PLF	PLANNED OUTAGE	9/25/2023 9:39	682.50	42
PLF	PLANNED OUTAGE	9/25/2023 10:04	1,601.82	13
Transformer	PLANNED OUTAGE	9/25/2023 10:55	1,421.50	2
Transformer	PLANNED OUTAGE	9/25/2023 11:19	493.50	2
PLF	PLANNED OUTAGE	9/25/2023 11:37	458.53	4
Transformer Bank	PLANNED OUTAGE	9/25/2023 12:08	515.05	3
Transformer	PLANNED OUTAGE	9/25/2023 13:41	114.77	2
PLF	PLANNED OUTAGE	9/25/2023 13:45	8.90	2
Transformer Bank	PLANNED OUTAGE	9/25/2023 14:02	175.23	7
Transformer	PLANNED OUTAGE	9/25/2023 16:39	3,364.72	11
Transformer	PLANNED OUTAGE	9/25/2023 16:42	370.75	1
Transformer	PLANNED OUTAGE	9/25/2023 17:07	62,524.73	46

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/25/2023 23:06	31.30	2
PLF	PLANNED OUTAGE	9/26/2023 9:31	41,842.67	160
PLF	PLANNED OUTAGE	9/26/2023 9:31	5,761.80	22
PLF	PLANNED OUTAGE	9/26/2023 10:09	224.83	1
PLF	PLANNED OUTAGE	9/26/2023 10:40	426.23	2
PLF	PLANNED OUTAGE	9/26/2023 10:41	185.02	1
PLF	PLANNED OUTAGE	9/26/2023 10:45	4,186.00	24
Transformer	PLANNED OUTAGE	9/26/2023 10:45	1,524.70	6
Transformer	PLANNED OUTAGE	9/26/2023 12:00	265.97	2
PLF	PLANNED OUTAGE	9/26/2023 13:32	26.33	1
PLF	PLANNED OUTAGE	9/26/2023 13:45	271.95	37
Transformer	PLANNED OUTAGE	9/26/2023 14:28	579.70	11
Transformer	PLANNED OUTAGE	9/26/2023 15:22	124.83	10
Switch	PLANNED OUTAGE	9/26/2023 15:34	4,480.67	715
Transformer	PLANNED OUTAGE	9/26/2023 16:23	701.70	6
PLF	PLANNED OUTAGE	9/26/2023 17:09	202.67	1
Transformer Bank	PLANNED OUTAGE	9/26/2023 18:04	623.73	8
Transformer	PLANNED OUTAGE	9/27/2023 8:27	316.93	8
Transformer	PLANNED OUTAGE	9/27/2023 8:32	509.80	3
PLF	PLANNED OUTAGE	9/27/2023 8:43	14,539.00	62
Transformer	PLANNED OUTAGE	9/27/2023 9:36	66.63	2
PLF	PLANNED OUTAGE	9/27/2023 9:47	1,450.97	58
PLF	PLANNED OUTAGE	9/27/2023 10:04	256.87	4
Transformer	PLANNED OUTAGE	9/27/2023 10:07	17.30	1
PLF	PLANNED OUTAGE	9/27/2023 10:26	205.42	17
Transformer	PLANNED OUTAGE	9/27/2023 10:33	1,096.70	11
Transformer	PLANNED OUTAGE	9/27/2023 10:33	792.13	8
Breaker	PLANNED OUTAGE	9/27/2023 11:13	7.68	1
Breaker	PLANNED OUTAGE	9/27/2023 11:13	583.33	70
Breaker	PLANNED OUTAGE	9/27/2023 11:36	244.57	58
Transformer	PLANNED OUTAGE	9/27/2023 13:22	705.00	6
Transformer	PLANNED OUTAGE	9/27/2023 13:33	39.35	1
Transformer	PLANNED OUTAGE	9/27/2023 13:59	1,138.50	10
Transformer	PLANNED OUTAGE	9/27/2023 14:00	1,240.25	11
Transformer	PLANNED OUTAGE	9/27/2023 14:18	106.57	1
Transformer	PLANNED OUTAGE	9/27/2023 16:28	56.67	4
PLF	PLANNED OUTAGE	9/27/2023 18:18	822.60	9
Transformer	PLANNED OUTAGE	9/27/2023 21:13	82.50	9
Transformer	PLANNED OUTAGE	9/27/2023 21:27	7,452.50	30
PLF	PLANNED OUTAGE	9/27/2023 22:44	5,746.43	13
Transformer Bank	PLANNED OUTAGE	9/27/2023 22:50	2,450.25	27
PLF	PLANNED OUTAGE	9/28/2023 9:07	3,667.40	12
Transformer	PLANNED OUTAGE	9/28/2023 9:17	335.03	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/28/2023 9:32	543.78	7
Transformer	PLANNED OUTAGE	9/28/2023 9:54	294.90	3
Service point	PLANNED OUTAGE	9/28/2023 9:57	207.62	1
Transformer	PLANNED OUTAGE	9/28/2023 11:40	1,664.95	7
Transformer	PLANNED OUTAGE	9/28/2023 11:40	219.03	1
Transformer	PLANNED OUTAGE	9/28/2023 11:41	136.10	6
Transformer	PLANNED OUTAGE	9/28/2023 12:14	462.00	6
PLF	PLANNED OUTAGE	9/28/2023 12:19	943.00	20
Transformer	PLANNED OUTAGE	9/28/2023 12:43	1,552.28	11
Transformer Bank	PLANNED OUTAGE	9/28/2023 12:51	275.00	4
Transformer	PLANNED OUTAGE	9/28/2023 14:34	88.57	1
Transformer	PLANNED OUTAGE	9/28/2023 15:17	453.33	10
Transformer	PLANNED OUTAGE	9/28/2023 16:55	87.83	2
Transformer	PLANNED OUTAGE	9/28/2023 17:01	34.58	1
PLF	PLANNED OUTAGE	9/28/2023 17:22	407.40	2
Transformer	PLANNED OUTAGE	9/28/2023 18:12	131.60	3
PLF	PLANNED OUTAGE	9/28/2023 21:28	440.43	1
PLF	PLANNED OUTAGE	9/28/2023 22:43	541.37	2
PLF	PLANNED OUTAGE	9/28/2023 23:29	211.83	1
Transformer	PLANNED OUTAGE	9/29/2023 9:51	646.43	11
Recloser	PLANNED OUTAGE	9/29/2023 10:17	441.10	6
Transformer Bank	PLANNED OUTAGE	9/29/2023 10:24	256.53	13
Transformer	PLANNED OUTAGE	9/29/2023 10:27	143.25	15
Transformer	PLANNED OUTAGE	9/29/2023 10:37	757.30	6
Transformer	PLANNED OUTAGE	9/29/2023 10:53	245.10	6
Transformer	PLANNED OUTAGE	9/29/2023 12:24	92.00	4
Transformer	PLANNED OUTAGE	9/29/2023 12:47	149.63	2
Transformer	PLANNED OUTAGE	9/29/2023 12:48	192.70	6
Transformer	PLANNED OUTAGE	9/29/2023 13:02	44.90	1
Transformer	PLANNED OUTAGE	9/29/2023 13:07	709.50	10
Transformer	PLANNED OUTAGE	9/29/2023 14:04	378.07	4
Transformer	PLANNED OUTAGE	9/29/2023 14:15	370.53	8
Transformer	PLANNED OUTAGE	9/29/2023 15:20	341.00	5
Switch	PLANNED OUTAGE	9/29/2023 15:29	142.03	1
Transformer	PLANNED OUTAGE	9/29/2023 15:45	48.27	1
Transformer	PLANNED OUTAGE	9/29/2023 15:50	533.07	8
Transformer	PLANNED OUTAGE	9/29/2023 15:59	55.27	2
Transformer	PLANNED OUTAGE	9/29/2023 16:27	51.33	1
Transformer	PLANNED OUTAGE	9/29/2023 16:39	22.73	1
Transformer	PLANNED OUTAGE	9/29/2023 17:50	103.27	4
Transformer	PLANNED OUTAGE	9/29/2023 19:24	34.00	2
Transformer	PLANNED OUTAGE	9/29/2023 19:50	23.93	1
PLF	PLANNED OUTAGE	9/29/2023 22:58	287.50	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	9/30/2023 2:40	52.33	2
Transformer	PLANNED OUTAGE	9/30/2023 7:55	1,302.53	2
Service point	PLANNED OUTAGE	9/30/2023 8:19	547.02	1
Transformer	PLANNED OUTAGE	9/30/2023 13:35	717.80	12
Transformer	PLANNED OUTAGE	9/30/2023 14:03	107.90	3
Transformer	PLANNED OUTAGE	9/30/2023 14:29	87.50	3
Transformer	PLANNED OUTAGE	9/30/2023 14:35	94.13	2
Transformer	PLANNED OUTAGE	9/30/2023 15:39	139.87	4
Transformer	PLANNED OUTAGE	9/30/2023 15:40	34.65	1
Recloser	PLANNED OUTAGE	10/1/2023 1:04	3,054.10	14
Switch	PLANNED OUTAGE	10/1/2023 10:06	263.45	1
Transformer	PLANNED OUTAGE	10/1/2023 11:57	48.35	3
Transformer	PLANNED OUTAGE	10/1/2023 12:15	72.67	4
PLF	PLANNED OUTAGE	10/1/2023 12:16	922.77	47
Transformer	PLANNED OUTAGE	10/1/2023 13:01	123.93	4
Transformer Bank	PLANNED OUTAGE	10/1/2023 14:27	39.63	2
Service point	PLANNED OUTAGE	10/1/2023 14:43	2.35	1
Transformer Bank	PLANNED OUTAGE	10/1/2023 14:49	187.50	6
Transformer	PLANNED OUTAGE	10/1/2023 15:03	52.72	1
Service point	PLANNED OUTAGE	10/1/2023 15:44	159.98	1
Transformer	PLANNED OUTAGE	10/1/2023 17:50	50.40	2
Transformer	PLANNED OUTAGE	10/1/2023 18:40	734.83	10
Transformer Bank	PLANNED OUTAGE	10/1/2023 22:21	134.55	1
Transformer Bank	PLANNED OUTAGE	10/1/2023 22:21	86.07	4
Transformer	PLANNED OUTAGE	10/2/2023 8:31	1,129.25	15
PLF	PLANNED OUTAGE	10/2/2023 8:48	170.63	1
Transformer	PLANNED OUTAGE	10/2/2023 9:48	248.70	6
Transformer	PLANNED OUTAGE	10/2/2023 9:55	403.47	8
PLF	PLANNED OUTAGE	10/2/2023 10:23	5.78	1
Transformer Bank	PLANNED OUTAGE	10/2/2023 11:33	55.83	1
Transformer	PLANNED OUTAGE	10/2/2023 11:52	596.07	4
Transformer Bank	PLANNED OUTAGE	10/2/2023 12:57	206.93	2
Transformer	PLANNED OUTAGE	10/2/2023 13:10	183.05	7
Transformer	PLANNED OUTAGE	10/2/2023 13:50	398.70	2
Transformer	PLANNED OUTAGE	10/2/2023 14:29	776.97	26
PLF	PLANNED OUTAGE	10/2/2023 17:23	607.20	16
PLF	PLANNED OUTAGE	10/2/2023 18:02	40.00	16
PLF	PLANNED OUTAGE	10/2/2023 18:05	60.80	16
PLF	PLANNED OUTAGE	10/2/2023 18:05	22.40	16
PLF	PLANNED OUTAGE	10/2/2023 18:07	16.80	16
PLF	PLANNED OUTAGE	10/2/2023 18:08	29.07	16
PLF	PLANNED OUTAGE	10/2/2023 18:10	476.53	16
Breaker	PLANNED OUTAGE	10/2/2023 19:51	8,919.73	1612

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/2/2023 20:23	187.90	3
PLF	PLANNED OUTAGE	10/2/2023 22:50	1,262.93	37
Transformer	PLANNED OUTAGE	10/3/2023 7:19	399.27	2
Transformer	PLANNED OUTAGE	10/3/2023 8:09	957.73	8
Transformer	PLANNED OUTAGE	10/3/2023 8:57	1,003.58	5
Transformer	PLANNED OUTAGE	10/3/2023 8:57	1,113.90	6
Primary Wire	PLANNED OUTAGE	10/3/2023 9:06	2,201.73	8
Transformer	PLANNED OUTAGE	10/3/2023 9:12	708.77	2
PLF	PLANNED OUTAGE	10/3/2023 9:38	3,090.40	48
PLF	PLANNED OUTAGE	10/3/2023 9:42	1,094.40	18
Transformer	PLANNED OUTAGE	10/3/2023 9:45	991.47	16
Transformer	PLANNED OUTAGE	10/3/2023 10:35	47.45	3
Transformer	PLANNED OUTAGE	10/3/2023 10:40	43.53	4
Transformer	PLANNED OUTAGE	10/3/2023 10:45	311.85	11
Transformer	PLANNED OUTAGE	10/3/2023 11:02	255.02	11
Transformer	PLANNED OUTAGE	10/3/2023 11:09	234.20	3
Transformer	PLANNED OUTAGE	10/3/2023 11:35	286.07	4
Transformer	PLANNED OUTAGE	10/3/2023 11:45	199.85	3
Transformer	PLANNED OUTAGE	10/3/2023 12:03	231.83	5
Transformer	PLANNED OUTAGE	10/3/2023 13:11	72.35	3
Transformer	PLANNED OUTAGE	10/3/2023 13:12	158.20	7
Transformer	PLANNED OUTAGE	10/3/2023 13:24	173.90	3
Transformer	PLANNED OUTAGE	10/3/2023 13:46	156.60	12
Transformer	PLANNED OUTAGE	10/3/2023 13:57	152.10	2
Transformer	PLANNED OUTAGE	10/3/2023 17:50	25.57	1
Transformer	PLANNED OUTAGE	10/3/2023 18:31	64.10	3
Transformer	PLANNED OUTAGE	10/3/2023 19:44	80.83	2
Transformer	PLANNED OUTAGE	10/3/2023 20:29	187.92	5
Transformer Bank	PLANNED OUTAGE	10/3/2023 23:11	23.28	1
PLF	PLANNED OUTAGE	10/3/2023 23:47	2,171.07	8
Transformer	PLANNED OUTAGE	10/4/2023 0:50	20.33	1
Transformer	PLANNED OUTAGE	10/4/2023 0:50	2,723.50	39
Transformer	PLANNED OUTAGE	10/4/2023 2:11	19.22	1
Transformer	PLANNED OUTAGE	10/4/2023 9:42	281.70	2
PLF	PLANNED OUTAGE	10/4/2023 9:49	330.93	17
PLF	PLANNED OUTAGE	10/4/2023 9:58	37.87	1
PLF	PLANNED OUTAGE	10/4/2023 11:12	29.48	1
Transformer	PLANNED OUTAGE	10/4/2023 11:18	302.53	4
Transformer	PLANNED OUTAGE	10/4/2023 11:19	18,169.87	244
Transformer	PLANNED OUTAGE	10/4/2023 11:48	151.73	2
Transformer Bank	PLANNED OUTAGE	10/4/2023 12:01	46.20	1
Transformer	PLANNED OUTAGE	10/4/2023 12:34	3.83	1
Transformer	PLANNED OUTAGE	10/4/2023 12:36	295.50	10

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	10/4/2023 12:45	184.13	1
PLF	PLANNED OUTAGE	10/4/2023 12:45	183.03	1
Transformer	PLANNED OUTAGE	10/4/2023 12:47	98.80	1
Transformer	PLANNED OUTAGE	10/4/2023 13:33	1,291.50	10
Transformer	PLANNED OUTAGE	10/4/2023 15:36	304.73	7
Transformer	PLANNED OUTAGE	10/4/2023 15:41	442.00	15
Transformer	PLANNED OUTAGE	10/4/2023 18:12	671.75	15
Transformer	PLANNED OUTAGE	10/4/2023 20:35	157.47	4
Transformer	PLANNED OUTAGE	10/4/2023 23:55	2,405.52	11
Transformer Bank	PLANNED OUTAGE	10/5/2023 8:31	946.05	3
Transformer	PLANNED OUTAGE	10/5/2023 9:22	242.90	2
Transformer	PLANNED OUTAGE	10/5/2023 9:27	693.40	6
Transformer	PLANNED OUTAGE	10/5/2023 9:30	346.65	3
Transformer	PLANNED OUTAGE	10/5/2023 9:41	279.13	2
Transformer	PLANNED OUTAGE	10/5/2023 9:44	346.85	3
Transformer	PLANNED OUTAGE	10/5/2023 9:45	19,801.60	168
Transformer	PLANNED OUTAGE	10/5/2023 9:57	1,084.42	11
Transformer	PLANNED OUTAGE	10/5/2023 10:48	126.60	3
Transformer Bank	PLANNED OUTAGE	10/5/2023 11:43	67.97	1
Transformer	PLANNED OUTAGE	10/5/2023 11:48	658.60	4
Transformer	PLANNED OUTAGE	10/5/2023 11:48	981.90	6
Transformer	PLANNED OUTAGE	10/5/2023 12:30	93.22	1
Transformer	PLANNED OUTAGE	10/5/2023 12:49	866.55	9
Transformer	PLANNED OUTAGE	10/5/2023 13:13	4,340.00	31
Transformer	PLANNED OUTAGE	10/5/2023 13:18	1,072.50	9
PLF	PLANNED OUTAGE	10/5/2023 13:37	114.70	3
Transformer	PLANNED OUTAGE	10/5/2023 16:53	78.75	3
Transformer	PLANNED OUTAGE	10/5/2023 18:09	5.52	1
Transformer	PLANNED OUTAGE	10/5/2023 20:54	10,136.53	68
Transformer	PLANNED OUTAGE	10/6/2023 1:15	835.60	6
Transformer	PLANNED OUTAGE	10/6/2023 7:30	917.80	6
Transformer	PLANNED OUTAGE	10/6/2023 8:06	107.23	1
PLF	PLANNED OUTAGE	10/6/2023 8:11	3,580.20	13
PLF	PLANNED OUTAGE	10/6/2023 8:28	3,107.80	12
Transformer	PLANNED OUTAGE	10/6/2023 8:54	484.20	12
PLF	PLANNED OUTAGE	10/6/2023 10:06	11,171.07	28
Transformer Bank	PLANNED OUTAGE	10/6/2023 10:10	166.87	4
Transformer	PLANNED OUTAGE	10/6/2023 11:40	723.50	10
Transformer	PLANNED OUTAGE	10/6/2023 11:50	265.60	4
Transformer	PLANNED OUTAGE	10/6/2023 12:09	99.10	3
Transformer Bank	PLANNED OUTAGE	10/6/2023 17:30	635.72	7
PLF	PLANNED OUTAGE	10/6/2023 20:19	666.00	9
PLF	PLANNED OUTAGE	10/6/2023 20:27	1,098.52	19

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	10/7/2023 7:39	339.63	1
PLF	PLANNED OUTAGE	10/7/2023 8:42	228.62	1
Transformer	PLANNED OUTAGE	10/7/2023 14:58	235.40	12
Transformer	PLANNED OUTAGE	10/7/2023 15:21	454.93	4
Transformer	PLANNED OUTAGE	10/7/2023 15:48	280.00	12
Transformer	PLANNED OUTAGE	10/7/2023 18:09	862.70	6
Transformer	PLANNED OUTAGE	10/7/2023 22:55	76.00	2
Breaker	PLANNED OUTAGE	10/8/2023 1:30	1,190.00	7
Breaker	PLANNED OUTAGE	10/8/2023 1:30	16,935.57	802
PLF	PLANNED OUTAGE	10/8/2023 15:11	8,186.22	29
PLF	PLANNED OUTAGE	10/8/2023 15:11	282.18	1
PLF	PLANNED OUTAGE	10/8/2023 15:11	564.37	2
PLF	PLANNED OUTAGE	10/8/2023 15:11	282.15	1
PLF	PLANNED OUTAGE	10/8/2023 15:11	846.35	3
PLF	PLANNED OUTAGE	10/8/2023 15:11	7,606.35	27
PLF	PLANNED OUTAGE	10/8/2023 15:11	76,194.00	270
PLF	PLANNED OUTAGE	10/8/2023 15:11	844.95	3
PLF	PLANNED OUTAGE	10/8/2023 15:11	11,542.87	41
PLF	PLANNED OUTAGE	10/8/2023 15:13	14,014.17	50
PLF	PLANNED OUTAGE	10/9/2023 3:58	151.20	4
Switch	PLANNED OUTAGE	10/9/2023 6:02	953.55	27
Transformer	PLANNED OUTAGE	10/9/2023 7:52	469.22	1
Transformer	PLANNED OUTAGE	10/9/2023 10:24	246.67	8
Transformer	PLANNED OUTAGE	10/9/2023 10:30	344.92	5
PLF	PLANNED OUTAGE	10/9/2023 11:25	8,086.90	134
PLF	PLANNED OUTAGE	10/9/2023 11:35	285.90	1
PLF	PLANNED OUTAGE	10/9/2023 12:53	100.90	3
Transformer	PLANNED OUTAGE	10/9/2023 14:08	235.08	5
PLF	PLANNED OUTAGE	10/9/2023 15:41	112.98	1
Transformer	PLANNED OUTAGE	10/9/2023 19:02	134.00	5
Transformer	PLANNED OUTAGE	10/9/2023 23:21	239.67	5
Transformer	PLANNED OUTAGE	10/10/2023 8:22	880.35	3
Transformer	PLANNED OUTAGE	10/10/2023 9:02	1,138.75	3
Transformer	PLANNED OUTAGE	10/10/2023 10:02	1,418.75	5
OH Other	PLANNED OUTAGE	10/10/2023 10:57	21.05	1
Transformer	PLANNED OUTAGE	10/10/2023 12:03	933.45	9
Transformer	PLANNED OUTAGE	10/10/2023 12:10	1,076.72	11
Transformer	PLANNED OUTAGE	10/10/2023 13:48	17.55	9
Transformer	PLANNED OUTAGE	10/10/2023 13:48	19.25	11
Transformer	PLANNED OUTAGE	10/10/2023 13:50	9.75	9
Transformer	PLANNED OUTAGE	10/10/2023 14:50	126.67	4
Transformer	PLANNED OUTAGE	10/10/2023 15:22	4.75	3
Transformer	PLANNED OUTAGE	10/10/2023 15:30	89.45	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/10/2023 17:43	61.40	4
Transformer	PLANNED OUTAGE	10/10/2023 17:59	8.80	4
UG Other	PLANNED OUTAGE	10/11/2023 3:21	73.63	2
Transformer	PLANNED OUTAGE	10/11/2023 10:04	2,566.93	32
Transformer	PLANNED OUTAGE	10/11/2023 10:25	569.80	14
Transformer	PLANNED OUTAGE	10/11/2023 10:31	2,780.00	8
Transformer	PLANNED OUTAGE	10/11/2023 10:58	410.10	3
PLF	PLANNED OUTAGE	10/11/2023 13:08	1,431.37	46
Transformer	PLANNED OUTAGE	10/11/2023 13:15	27.40	1
Transformer	PLANNED OUTAGE	10/11/2023 13:16	266.33	4
Transformer	PLANNED OUTAGE	10/11/2023 13:16	461.88	7
OH Other	PLANNED OUTAGE	10/11/2023 13:32	14.15	1
Transformer	PLANNED OUTAGE	10/11/2023 18:30	20.38	1
PLF	PLANNED OUTAGE	10/12/2023 0:46	1,124.00	16
PLF	PLANNED OUTAGE	10/12/2023 1:56	25.07	16
PLF	PLANNED OUTAGE	10/12/2023 2:15	1,296.67	4
Transformer	PLANNED OUTAGE	10/12/2023 7:16	15.75	3
Transformer	PLANNED OUTAGE	10/12/2023 7:16	5.17	1
Transformer	PLANNED OUTAGE	10/12/2023 7:16	5.08	1
PLF	PLANNED OUTAGE	10/12/2023 8:13	215.50	1
Transformer	PLANNED OUTAGE	10/12/2023 9:03	54.25	7
Transformer	PLANNED OUTAGE	10/12/2023 9:09	442.93	8
Transformer	PLANNED OUTAGE	10/12/2023 9:12	8.28	7
PLF	PLANNED OUTAGE	10/12/2023 9:15	4,177.28	53
Transformer	PLANNED OUTAGE	10/12/2023 11:29	111.50	5
Breaker	PLANNED OUTAGE	10/12/2023 13:07	13,155.73	1451
PLF	PLANNED OUTAGE	10/12/2023 13:29	179.33	8
PLF	PLANNED OUTAGE	10/12/2023 13:54	46.67	8
Transformer	PLANNED OUTAGE	10/12/2023 21:28	1,546.67	10
Switch	PLANNED OUTAGE	10/12/2023 22:11	1,111.20	2
Transformer	PLANNED OUTAGE	10/13/2023 0:38	663.15	9
OH Other	PLANNED OUTAGE	10/13/2023 5:02	15,276.25	1111
PLF	PLANNED OUTAGE	10/13/2023 8:00	2,837.45	11
Transformer Bank	PLANNED OUTAGE	10/13/2023 8:06	52.80	2
Transformer	PLANNED OUTAGE	10/13/2023 9:34	403.33	5
Transformer	PLANNED OUTAGE	10/13/2023 9:36	96.27	2
Transformer	PLANNED OUTAGE	10/13/2023 10:27	61.20	4
Transformer	PLANNED OUTAGE	10/13/2023 11:19	7,283.27	14
Transformer	PLANNED OUTAGE	10/13/2023 12:31	65.17	2
Transformer	PLANNED OUTAGE	10/13/2023 13:13	145.67	5
Transformer	PLANNED OUTAGE	10/13/2023 14:55	49.93	2
Transformer	PLANNED OUTAGE	10/13/2023 15:14	1,822.33	10
Transformer	PLANNED OUTAGE	10/13/2023 15:29	1,281.85	31

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/13/2023 17:41	1,572.73	31
Transformer	PLANNED OUTAGE	10/13/2023 21:28	276.00	6
Transformer	PLANNED OUTAGE	10/13/2023 23:34	953.08	5
PLF	PLANNED OUTAGE	10/14/2023 8:13	265.90	6
Transformer	PLANNED OUTAGE	10/14/2023 12:22	674.33	28
Transformer	PLANNED OUTAGE	10/14/2023 14:56	256.80	1
Transformer	PLANNED OUTAGE	10/14/2023 16:36	288.30	9
Breaker	PLANNED OUTAGE	10/14/2023 18:09	6,030.93	1408
Transformer	PLANNED OUTAGE	10/15/2023 7:57	141.80	2
Breaker	PLANNED OUTAGE	10/15/2023 9:08	923.00	923
Transformer	PLANNED OUTAGE	10/15/2023 10:02	124.27	8
Transformer	PLANNED OUTAGE	10/15/2023 12:56	92.85	3
Transformer	PLANNED OUTAGE	10/15/2023 14:09	80.47	2
Transformer	PLANNED OUTAGE	10/15/2023 18:13	50.60	1
Service point	PLANNED OUTAGE	10/16/2023 0:51	7.27	1
Transformer	PLANNED OUTAGE	10/16/2023 8:01	398.60	1
PLF	PLANNED OUTAGE	10/16/2023 9:55	236.13	1
Transformer	PLANNED OUTAGE	10/16/2023 10:24	112.83	1
Transformer	PLANNED OUTAGE	10/16/2023 11:19	344.93	4
Transformer Bank	PLANNED OUTAGE	10/16/2023 11:35	292.90	2
PLF	PLANNED OUTAGE	10/16/2023 11:41	1,577.63	19
Transformer Bank	PLANNED OUTAGE	10/16/2023 12:54	119.43	1
Transformer	PLANNED OUTAGE	10/16/2023 14:24	45.00	1
Transformer	PLANNED OUTAGE	10/16/2023 16:20	1,875.93	4
Transformer	PLANNED OUTAGE	10/16/2023 16:50	34.40	2
Transformer	PLANNED OUTAGE	10/16/2023 17:39	441.60	8
Transformer	PLANNED OUTAGE	10/16/2023 19:58	585.15	9
PLF	PLANNED OUTAGE	10/16/2023 21:51	46.60	2
PLF	PLANNED OUTAGE	10/16/2023 22:16	162.00	4
Transformer	PLANNED OUTAGE	10/16/2023 23:47	56.27	4
Transformer	PLANNED OUTAGE	10/17/2023 0:07	66.20	4
Switch	PLANNED OUTAGE	10/17/2023 0:47	4,770.40	24
Switch	PLANNED OUTAGE	10/17/2023 0:47	59,562.88	301
PLF	PLANNED OUTAGE	10/17/2023 9:29	105.50	3
Transformer	PLANNED OUTAGE	10/17/2023 9:29	258.92	1
Transformer Bank	PLANNED OUTAGE	10/17/2023 9:38	533.55	3
PLF	PLANNED OUTAGE	10/17/2023 9:39	251.73	1
Transformer	PLANNED OUTAGE	10/17/2023 9:58	948.40	4
Transformer	PLANNED OUTAGE	10/17/2023 10:19	3,064.67	8
Transformer Bank	PLANNED OUTAGE	10/17/2023 10:26	18.83	1
Transformer	PLANNED OUTAGE	10/17/2023 10:40	660.47	4
Transformer	PLANNED OUTAGE	10/17/2023 10:50	596.40	7
Transformer	PLANNED OUTAGE	10/17/2023 11:04	27.32	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/17/2023 11:04	29.57	1
Transformer	PLANNED OUTAGE	10/17/2023 11:07	444.70	3
Transformer	PLANNED OUTAGE	10/17/2023 11:54	374.10	3
Transformer	PLANNED OUTAGE	10/17/2023 12:01	1,411.05	9
Transformer	PLANNED OUTAGE	10/17/2023 13:27	586.02	7
Transformer	PLANNED OUTAGE	10/17/2023 14:41	223.33	5
PLF	PLANNED OUTAGE	10/17/2023 16:25	91.17	2
PLF	PLANNED OUTAGE	10/17/2023 21:58	336.10	6
Transformer	PLANNED OUTAGE	10/17/2023 22:56	166.25	7
Transformer	PLANNED OUTAGE	10/18/2023 9:32	294.55	1
Transformer	PLANNED OUTAGE	10/18/2023 10:20	573.75	5
Transformer Bank	PLANNED OUTAGE	10/18/2023 10:40	459.93	2
PLF	PLANNED OUTAGE	10/18/2023 11:11	670.28	1
PLF	PLANNED OUTAGE	10/18/2023 11:13	668.02	1
PLF	PLANNED OUTAGE	10/18/2023 11:14	593.15	1
PLF	PLANNED OUTAGE	10/18/2023 11:16	665.90	1
PLF	PLANNED OUTAGE	10/18/2023 11:20	661.02	1
PLF	PLANNED OUTAGE	10/18/2023 11:22	659.25	1
PLF	PLANNED OUTAGE	10/18/2023 11:25	656.43	1
OH Other	PLANNED OUTAGE	10/18/2023 11:37	18.75	1
Transformer	PLANNED OUTAGE	10/18/2023 13:17	2,092.50	31
Transformer	PLANNED OUTAGE	10/18/2023 14:46	1,813.60	6
Transformer Bank	PLANNED OUTAGE	10/18/2023 17:11	52.85	3
Transformer	PLANNED OUTAGE	10/18/2023 18:00	7.90	3
Transformer	PLANNED OUTAGE	10/18/2023 19:49	7.50	6
Transformer	PLANNED OUTAGE	10/18/2023 20:48	334.05	9
Transformer	PLANNED OUTAGE	10/18/2023 21:11	63.97	2
Transformer	PLANNED OUTAGE	10/18/2023 21:26	41.55	9
Transformer	PLANNED OUTAGE	10/18/2023 21:32	9.75	9
Transformer	PLANNED OUTAGE	10/18/2023 21:33	15.45	9
Transformer	PLANNED OUTAGE	10/18/2023 21:36	505.65	9
PLF	PLANNED OUTAGE	10/19/2023 8:18	6,558.50	30
Switch	PLANNED OUTAGE	10/19/2023 8:42	175.95	1
Transformer	PLANNED OUTAGE	10/19/2023 9:45	559.07	7
Transformer	PLANNED OUTAGE	10/19/2023 9:59	1,048.02	13
Switch	PLANNED OUTAGE	10/19/2023 10:36	332.67	1
Transformer Bank	PLANNED OUTAGE	10/19/2023 10:45	780.60	9
Switch	PLANNED OUTAGE	10/19/2023 11:00	133.77	1
Transformer	PLANNED OUTAGE	10/19/2023 11:25	48.15	3
PLF	PLANNED OUTAGE	10/19/2023 11:33	219.70	13
Transformer	PLANNED OUTAGE	10/19/2023 11:45	50.75	5
Transformer	PLANNED OUTAGE	10/19/2023 11:52	98.00	1
Transformer	PLANNED OUTAGE	10/19/2023 12:25	735.83	10

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/19/2023 13:12	840.67	8
PLF	PLANNED OUTAGE	10/19/2023 15:16	289.80	12
Transformer Bank	PLANNED OUTAGE	10/19/2023 16:10	233.70	3
Transformer	PLANNED OUTAGE	10/19/2023 16:18	990.45	9
Transformer	PLANNED OUTAGE	10/19/2023 16:43	438.60	12
Transformer	PLANNED OUTAGE	10/19/2023 19:42	610.20	12
Transformer	PLANNED OUTAGE	10/19/2023 21:26	61.60	3
PLF	PLANNED OUTAGE	10/19/2023 23:04	437.00	2
Transformer	PLANNED OUTAGE	10/19/2023 23:13	376.37	14
Breaker	PLANNED OUTAGE	10/20/2023 5:40	31,239.77	1901
PLF	PLANNED OUTAGE	10/20/2023 6:13	294.95	1
Transformer	PLANNED OUTAGE	10/20/2023 8:37	3,166.65	27
Transformer	PLANNED OUTAGE	10/20/2023 9:17	116.85	3
Transformer Bank	PLANNED OUTAGE	10/20/2023 9:33	140.80	1
Transformer	PLANNED OUTAGE	10/20/2023 9:46	123.97	2
Transformer Bank	PLANNED OUTAGE	10/20/2023 9:53	222.37	1
Transformer	PLANNED OUTAGE	10/20/2023 10:01	518.05	13
PLF	PLANNED OUTAGE	10/20/2023 11:38	48.03	2
Transformer	PLANNED OUTAGE	10/20/2023 14:07	21.10	2
PLF	PLANNED OUTAGE	10/20/2023 18:07	176.20	12
PLF	PLANNED OUTAGE	10/21/2023 8:08	1,014.55	3
PLF	PLANNED OUTAGE	10/21/2023 8:10	256.70	1
Transformer	PLANNED OUTAGE	10/23/2023 8:10	1,059.57	2
Transformer	PLANNED OUTAGE	10/23/2023 8:57	432.80	4
Transformer	PLANNED OUTAGE	10/23/2023 9:25	20.75	5
Transformer	PLANNED OUTAGE	10/23/2023 9:39	315.47	2
PLF	PLANNED OUTAGE	10/23/2023 9:46	134.47	2
PLF	PLANNED OUTAGE	10/23/2023 9:46	64.95	1
Transformer	PLANNED OUTAGE	10/23/2023 10:13	137.85	1
Recloser	PLANNED OUTAGE	10/23/2023 10:54	304.00	16
PLF	PLANNED OUTAGE	10/23/2023 10:58	138.60	1
Transformer	PLANNED OUTAGE	10/23/2023 13:12	327.40	6
Transformer	PLANNED OUTAGE	10/23/2023 14:12	56.45	1
Recloser	PLANNED OUTAGE	10/23/2023 17:54	11,516.80	708
Breaker	PLANNED OUTAGE	10/23/2023 18:34	39,331.05	1331
Switch	PLANNED OUTAGE	10/23/2023 21:21	4,191.07	68
Switch	PLANNED OUTAGE	10/23/2023 21:21	20,725.50	337
UG Other	PLANNED OUTAGE	10/24/2023 8:39	730.03	11
Transformer	PLANNED OUTAGE	10/24/2023 9:01	83.67	4
Transformer	PLANNED OUTAGE	10/24/2023 9:09	347.50	5
Transformer	PLANNED OUTAGE	10/24/2023 9:16	404.83	14
Transformer	PLANNED OUTAGE	10/24/2023 9:56	291.58	5
PLF	PLANNED OUTAGE	10/24/2023 10:15	23.68	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/24/2023 10:38	1,996.87	7
Primary Wire	PLANNED OUTAGE	10/24/2023 11:29	1,045.07	2
Transformer	PLANNED OUTAGE	10/24/2023 12:06	308.58	7
Transformer	PLANNED OUTAGE	10/24/2023 12:09	1,164.45	9
Transformer	PLANNED OUTAGE	10/24/2023 12:42	1,034.17	10
Transformer Bank	PLANNED OUTAGE	10/24/2023 13:27	45.43	2
Transformer	PLANNED OUTAGE	10/24/2023 14:15	209.08	5
PLF	PLANNED OUTAGE	10/24/2023 15:05	186.80	3
Recloser	PLANNED OUTAGE	10/24/2023 15:59	5,895.00	675
Transformer	PLANNED OUTAGE	10/25/2023 3:18	111.45	1
PLF	PLANNED OUTAGE	10/25/2023 8:09	966.40	3
Transformer	PLANNED OUTAGE	10/25/2023 9:53	243.65	3
PLF	PLANNED OUTAGE	10/25/2023 10:02	12.45	1
PLF	PLANNED OUTAGE	10/25/2023 10:15	66.22	1
Transformer	PLANNED OUTAGE	10/25/2023 11:03	705.95	7
Switch	PLANNED OUTAGE	10/25/2023 11:12	13.57	1
Switch	PLANNED OUTAGE	10/25/2023 11:12	1,295.00	140
Transformer	PLANNED OUTAGE	10/25/2023 11:14	863.87	8
Switch	PLANNED OUTAGE	10/25/2023 11:25	265.22	1
Switch	PLANNED OUTAGE	10/25/2023 11:26	36,754.00	141
Transformer	PLANNED OUTAGE	10/25/2023 13:23	589.40	7
Recloser	PLANNED OUTAGE	10/25/2023 14:10	47.17	1
Recloser	PLANNED OUTAGE	10/25/2023 14:10	10,329.20	238
Transformer	PLANNED OUTAGE	10/25/2023 16:14	189.33	4
Transformer	PLANNED OUTAGE	10/25/2023 19:19	89.32	1
PLF	PLANNED OUTAGE	10/26/2023 8:49	1,653.60	6
Transformer	PLANNED OUTAGE	10/26/2023 8:50	1,271.90	7
PLF	PLANNED OUTAGE	10/26/2023 9:36	8,080.80	24
Transformer	PLANNED OUTAGE	10/26/2023 9:52	290.55	3
Transformer	PLANNED OUTAGE	10/26/2023 10:10	295.52	7
Transformer	PLANNED OUTAGE	10/26/2023 10:57	222.13	16
Transformer	PLANNED OUTAGE	10/26/2023 11:05	153.20	3
Transformer	PLANNED OUTAGE	10/26/2023 11:29	6.65	3
PLF	PLANNED OUTAGE	10/26/2023 11:43	167.57	11
Transformer	PLANNED OUTAGE	10/26/2023 11:56	100.20	2
PLF	PLANNED OUTAGE	10/26/2023 12:28	41.20	1
Recloser	PLANNED OUTAGE	10/26/2023 13:25	4,156.67	430
Recloser	PLANNED OUTAGE	10/26/2023 13:25	5,454.00	606
Recloser	PLANNED OUTAGE	10/26/2023 13:25	12.85	1
PLF	PLANNED OUTAGE	10/26/2023 13:32	3,708.60	28
Transformer	PLANNED OUTAGE	10/26/2023 16:17	8.23	1
Transformer	PLANNED OUTAGE	10/26/2023 23:33	137.70	9
Transformer	PLANNED OUTAGE	10/27/2023 9:26	1,299.58	25

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	10/27/2023 12:05	374.67	8
Transformer	PLANNED OUTAGE	10/27/2023 12:40	258.18	7
Transformer	PLANNED OUTAGE	10/27/2023 13:16	41.17	1
Transformer	PLANNED OUTAGE	10/27/2023 13:29	402.40	16
Transformer	PLANNED OUTAGE	10/27/2023 14:10	299.73	16
Transformer	PLANNED OUTAGE	10/27/2023 14:40	67.50	10
Transformer	PLANNED OUTAGE	10/27/2023 14:44	343.23	14
Transformer	PLANNED OUTAGE	10/27/2023 15:09	49.93	14
Transformer	PLANNED OUTAGE	10/27/2023 15:25	327.00	10
Transformer	PLANNED OUTAGE	10/27/2023 16:03	368.20	12
Transformer	PLANNED OUTAGE	10/27/2023 20:38	67.83	2
Transformer	PLANNED OUTAGE	10/27/2023 23:00	363.50	10
PLF	PLANNED OUTAGE	10/28/2023 0:27	624.25	33
Transformer	PLANNED OUTAGE	10/28/2023 2:14	24.10	2
PLF	PLANNED OUTAGE	10/28/2023 2:25	25.72	1
PLF	PLANNED OUTAGE	10/28/2023 3:09	732.68	1
PLF	PLANNED OUTAGE	10/28/2023 12:36	12,008.25	81
PLF	PLANNED OUTAGE	10/28/2023 15:13	443.30	6
TX Replaced (PM)	PLANNED OUTAGE	10/28/2023 15:40	308.25	45
TX Replaced (PM)	PLANNED OUTAGE	10/28/2023 15:40	858.07	4
Breaker	PLANNED OUTAGE	10/28/2023 17:20	4.83	1
Breaker	PLANNED OUTAGE	10/28/2023 17:20	4.83	1
Breaker	PLANNED OUTAGE	10/28/2023 17:20	4.83	1
Breaker	PLANNED OUTAGE	10/28/2023 17:20	4.83	1
Breaker	PLANNED OUTAGE	10/28/2023 17:20	4.83	1
Breaker	PLANNED OUTAGE	10/28/2023 17:20	4.83	1
Breaker	PLANNED OUTAGE	10/28/2023 17:20	4,659.33	964
OH Other	PLANNED OUTAGE	10/28/2023 18:33	130.47	1
OH Other	PLANNED OUTAGE	10/28/2023 18:33	130.88	1
Transformer Bank	PLANNED OUTAGE	10/28/2023 18:39	31.60	2
Transformer	PLANNED OUTAGE	10/29/2023 0:47	35.50	2
Transformer	PLANNED OUTAGE	10/29/2023 1:37	91.47	4
Transformer	PLANNED OUTAGE	10/29/2023 12:04	221.75	5
Transformer	PLANNED OUTAGE	10/29/2023 12:41	131.33	4
Transformer	PLANNED OUTAGE	10/29/2023 13:06	56.57	2
Transformer	PLANNED OUTAGE	10/29/2023 13:21	49.00	3
Transformer	PLANNED OUTAGE	10/29/2023 14:31	63.05	3
Transformer	PLANNED OUTAGE	10/29/2023 15:00	32.70	2
Transformer	PLANNED OUTAGE	10/30/2023 0:50	78.00	3
Service point	PLANNED OUTAGE	10/30/2023 8:28	533.58	1
PLF	PLANNED OUTAGE	10/30/2023 8:29	319.25	1
Transformer	PLANNED OUTAGE	10/30/2023 10:08	31.60	2
PLF	PLANNED OUTAGE	10/30/2023 10:31	248.93	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	10/30/2023 10:55	969.75	5
Transformer	PLANNED OUTAGE	10/30/2023 11:13	80.07	2
PLF	PLANNED OUTAGE	10/30/2023 11:27	87.73	1
Service point	PLANNED OUTAGE	10/30/2023 11:52	23.47	1
Transformer	PLANNED OUTAGE	10/30/2023 12:44	349.83	10
Transformer	PLANNED OUTAGE	10/30/2023 12:46	20.48	1
Transformer	PLANNED OUTAGE	10/30/2023 12:54	127.20	1
PLF	PLANNED OUTAGE	10/30/2023 13:04	801.90	9
Transformer	PLANNED OUTAGE	10/30/2023 13:07	59.08	1
Transformer	PLANNED OUTAGE	10/30/2023 14:07	18.37	1
PLF	PLANNED OUTAGE	10/30/2023 14:16	27.93	1
Transformer	PLANNED OUTAGE	10/30/2023 18:33	107.67	4
Transformer	PLANNED OUTAGE	10/30/2023 19:04	125.47	4
Transformer	PLANNED OUTAGE	10/31/2023 0:09	27.75	1
Transformer	PLANNED OUTAGE	10/31/2023 1:04	39.80	2
PLF	PLANNED OUTAGE	10/31/2023 8:24	211.67	20
PLF	PLANNED OUTAGE	10/31/2023 8:24	3,313.00	20
Transformer	PLANNED OUTAGE	10/31/2023 8:53	2,336.17	10
Transformer	PLANNED OUTAGE	10/31/2023 8:53	1,885.60	8
Transformer	PLANNED OUTAGE	10/31/2023 8:55	455.67	5
Transformer	PLANNED OUTAGE	10/31/2023 9:17	2,989.20	47
Transformer	PLANNED OUTAGE	10/31/2023 10:14	39.20	2
PLF	PLANNED OUTAGE	10/31/2023 10:25	41.95	1
PLF	PLANNED OUTAGE	10/31/2023 10:48	525.75	3
Transformer	PLANNED OUTAGE	10/31/2023 10:53	14.27	4
Transformer	PLANNED OUTAGE	10/31/2023 10:56	60.25	3
PLF	PLANNED OUTAGE	10/31/2023 11:05	92.00	20
Transformer	PLANNED OUTAGE	10/31/2023 11:23	106.55	3
Transformer	PLANNED OUTAGE	10/31/2023 11:50	311.73	8
Transformer	PLANNED OUTAGE	10/31/2023 12:38	33.55	1
Transformer Bank	PLANNED OUTAGE	10/31/2023 13:55	126.75	1
PLF	PLANNED OUTAGE	10/31/2023 14:08	97.77	2
Transformer	PLANNED OUTAGE	10/31/2023 14:38	78.65	3
Transformer	PLANNED OUTAGE	10/31/2023 14:42	46.00	2
Transformer	PLANNED OUTAGE	10/31/2023 15:04	103.13	4
Transformer	PLANNED OUTAGE	10/31/2023 15:30	34.13	2
Transformer	PLANNED OUTAGE	10/31/2023 17:50	14.48	1
Transformer Bank	PLANNED OUTAGE	10/31/2023 18:49	85.25	1
Transformer Bank	PLANNED OUTAGE	10/31/2023 18:52	947.00	4
Transformer	PLANNED OUTAGE	10/31/2023 19:00	171.13	4
UG Other	PLANNED OUTAGE	11/1/2023 6:29	9,851.60	44
UG Other	PLANNED OUTAGE	11/1/2023 6:29	5,969.60	26
Primary Wire	PLANNED OUTAGE	11/1/2023 8:21	4,715.25	9

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/1/2023 9:11	649.73	2
Transformer	PLANNED OUTAGE	11/1/2023 9:26	864.75	5
Transformer	PLANNED OUTAGE	11/1/2023 9:32	85.20	1
Transformer	PLANNED OUTAGE	11/1/2023 9:50	183.90	6
PLF	PLANNED OUTAGE	11/1/2023 10:02	432.13	8
Transformer Bank	PLANNED OUTAGE	11/1/2023 10:26	72.32	1
Transformer	PLANNED OUTAGE	11/1/2023 11:24	285.85	3
PLF	PLANNED OUTAGE	11/1/2023 11:59	45.70	2
Transformer	PLANNED OUTAGE	11/1/2023 12:12	132.60	2
PLF	PLANNED OUTAGE	11/1/2023 12:26	148.50	45
Transformer	PLANNED OUTAGE	11/1/2023 12:56	85.10	3
PLF	PLANNED OUTAGE	11/1/2023 13:18	2.13	2
Transformer	PLANNED OUTAGE	11/1/2023 13:45	70.98	1
Transformer	PLANNED OUTAGE	11/1/2023 14:19	317.10	9
Transformer	PLANNED OUTAGE	11/1/2023 18:41	471.70	1
Breaker	PLANNED OUTAGE	11/1/2023 21:39	31,577.47	1471
Breaker	PLANNED OUTAGE	11/1/2023 21:39	21.10	1
Breaker	PLANNED OUTAGE	11/1/2023 21:39	21.48	1
Breaker	PLANNED OUTAGE	11/1/2023 21:39	21.40	1
Breaker	PLANNED OUTAGE	11/1/2023 21:39	21.30	1
Transformer	PLANNED OUTAGE	11/1/2023 22:04	19.73	2
Transformer	PLANNED OUTAGE	11/2/2023 1:23	242.70	9
Transformer	PLANNED OUTAGE	11/2/2023 1:28	291.20	12
Recloser	PLANNED OUTAGE	11/2/2023 2:44	178.08	5
Transformer	PLANNED OUTAGE	11/2/2023 5:27	119.13	4
Transformer	PLANNED OUTAGE	11/2/2023 7:44	249.80	4
Transformer	PLANNED OUTAGE	11/2/2023 8:48	78.10	2
PLF	PLANNED OUTAGE	11/2/2023 9:21	311.53	2
Transformer	PLANNED OUTAGE	11/2/2023 9:23	309.27	2
Transformer	PLANNED OUTAGE	11/2/2023 9:38	49.95	3
Transformer	PLANNED OUTAGE	11/2/2023 9:58	505.00	6
Transformer	PLANNED OUTAGE	11/2/2023 10:14	87.75	3
Transformer	PLANNED OUTAGE	11/2/2023 10:43	131.00	4
Transformer	PLANNED OUTAGE	11/2/2023 11:07	1,185.08	5
Transformer	PLANNED OUTAGE	11/2/2023 11:50	40.77	2
Transformer	PLANNED OUTAGE	11/2/2023 12:22	116.60	3
Transformer	PLANNED OUTAGE	11/2/2023 12:35	6.45	1
Transformer	PLANNED OUTAGE	11/2/2023 12:36	102.42	1
Transformer	PLANNED OUTAGE	11/2/2023 14:09	57.30	2
PLF	PLANNED OUTAGE	11/2/2023 14:39	41.17	1
PLF	PLANNED OUTAGE	11/2/2023 14:40	41.53	1
PLF	PLANNED OUTAGE	11/2/2023 14:41	61.67	4
PLF	PLANNED OUTAGE	11/2/2023 14:41	939.40	61

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/2/2023 14:56	382.40	16
Transformer	PLANNED OUTAGE	11/2/2023 14:58	156.92	7
Transformer	PLANNED OUTAGE	11/2/2023 15:20	17.07	16
Transformer	PLANNED OUTAGE	11/2/2023 15:21	40.00	16
Transformer	PLANNED OUTAGE	11/2/2023 15:22	19.20	16
Transformer	PLANNED OUTAGE	11/2/2023 15:26	208.83	10
Transformer	PLANNED OUTAGE	11/2/2023 16:13	114.20	6
PLF	PLANNED OUTAGE	11/2/2023 17:24	279.17	1
Transformer	PLANNED OUTAGE	11/2/2023 18:56	26.30	2
Transformer	PLANNED OUTAGE	11/2/2023 21:58	84.85	3
Transformer	PLANNED OUTAGE	11/2/2023 23:32	538.40	6
PLF	PLANNED OUTAGE	11/3/2023 8:41	145.62	1
PLF	PLANNED OUTAGE	11/3/2023 8:41	147.90	1
PLF	PLANNED OUTAGE	11/3/2023 8:41	144.60	1
PLF	PLANNED OUTAGE	11/3/2023 8:41	13.10	6
PLF	PLANNED OUTAGE	11/3/2023 8:49	1,336.33	10
PLF	PLANNED OUTAGE	11/3/2023 8:49	1,638.40	12
Transformer	PLANNED OUTAGE	11/3/2023 9:22	742.30	3
Switch	PLANNED OUTAGE	11/3/2023 9:22	1,986.67	8
Switch	PLANNED OUTAGE	11/3/2023 9:22	496.63	2
Transformer Bank	PLANNED OUTAGE	11/3/2023 11:41	19.57	2
Recloser	PLANNED OUTAGE	11/3/2023 14:00	456.22	31
Transformer	PLANNED OUTAGE	11/3/2023 14:00	18.55	3
PLF	PLANNED OUTAGE	11/3/2023 14:10	294.47	4
PLF	PLANNED OUTAGE	11/4/2023 0:25	2,690.00	25
Transformer	PLANNED OUTAGE	11/4/2023 8:33	353.47	1
Transformer	PLANNED OUTAGE	11/4/2023 9:57	184.05	3
Transformer	PLANNED OUTAGE	11/4/2023 10:27	2,308.95	9
Breaker	PLANNED OUTAGE	11/5/2023 21:50	3,721.10	381
Transformer	PLANNED OUTAGE	11/6/2023 5:38	108.60	6
PLF	PLANNED OUTAGE	11/6/2023 7:35	1,063.47	16
Transformer	PLANNED OUTAGE	11/6/2023 8:03	593.13	41
PLF	PLANNED OUTAGE	11/6/2023 8:23	9,186.33	28
Recloser	PLANNED OUTAGE	11/6/2023 8:38	346.50	15
PLF	PLANNED OUTAGE	11/6/2023 9:15	1,368.95	33
Transformer	PLANNED OUTAGE	11/6/2023 9:47	3,427.73	8
PLF	PLANNED OUTAGE	11/6/2023 9:56	3,590.97	34
Transformer	PLANNED OUTAGE	11/6/2023 11:45	161.47	7
Transformer	PLANNED OUTAGE	11/6/2023 12:36	31.40	2
Transformer	PLANNED OUTAGE	11/6/2023 15:51	154.30	2
Transformer	PLANNED OUTAGE	11/6/2023 18:06	86.65	1
Transformer	PLANNED OUTAGE	11/6/2023 20:16	260.33	4
Switch	PLANNED OUTAGE	11/7/2023 2:05	5,482.13	304

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	11/7/2023 8:38	207.88	1
Transformer	PLANNED OUTAGE	11/7/2023 8:45	611.20	12
PLF	PLANNED OUTAGE	11/7/2023 9:03	365.40	4
Transformer Bank	PLANNED OUTAGE	11/7/2023 9:03	404.43	1
Transformer	PLANNED OUTAGE	11/7/2023 9:11	305.32	1
Transformer	PLANNED OUTAGE	11/7/2023 10:06	155.45	1
Transformer	PLANNED OUTAGE	11/7/2023 10:08	671.47	32
Transformer	PLANNED OUTAGE	11/7/2023 10:29	80.00	32
PLF	PLANNED OUTAGE	11/7/2023 12:30	117.77	2
Transformer	PLANNED OUTAGE	11/7/2023 12:59	556.27	7
Transformer	PLANNED OUTAGE	11/7/2023 13:25	246.25	5
Transformer	PLANNED OUTAGE	11/7/2023 13:25	48.62	1
PLF	PLANNED OUTAGE	11/7/2023 14:27	317.03	2
Transformer	PLANNED OUTAGE	11/7/2023 15:52	706.40	4
Transformer	PLANNED OUTAGE	11/7/2023 15:52	1,229.32	7
Transformer	PLANNED OUTAGE	11/7/2023 16:42	256.67	5
Switch	PLANNED OUTAGE	11/7/2023 16:55	1,803.20	112
Transformer	PLANNED OUTAGE	11/7/2023 17:59	192.93	4
PLF	PLANNED OUTAGE	11/8/2023 0:38	373.93	4
Transformer	PLANNED OUTAGE	11/8/2023 0:38	477.00	5
PLF	PLANNED OUTAGE	11/8/2023 8:44	198.52	1
Transformer	PLANNED OUTAGE	11/8/2023 9:06	592.65	9
Service point	PLANNED OUTAGE	11/8/2023 9:07	213.13	1
Switch	PLANNED OUTAGE	11/8/2023 9:21	392.40	2
Transformer	PLANNED OUTAGE	11/8/2023 10:12	29.25	9
Transformer	PLANNED OUTAGE	11/8/2023 10:12	22.20	9
Transformer	PLANNED OUTAGE	11/8/2023 10:25	188.07	1
Transformer	PLANNED OUTAGE	11/8/2023 10:25	939.33	5
Transformer	PLANNED OUTAGE	11/8/2023 10:38	21.15	1
Transformer	PLANNED OUTAGE	11/8/2023 10:59	176.10	2
Transformer	PLANNED OUTAGE	11/8/2023 13:01	327.75	5
Transformer	PLANNED OUTAGE	11/8/2023 13:31	477.60	12
Transformer	PLANNED OUTAGE	11/8/2023 14:11	32.80	12
PLF	PLANNED OUTAGE	11/8/2023 16:11	77.17	2
Service point	PLANNED OUTAGE	11/8/2023 16:51	9.53	1
Breaker	PLANNED OUTAGE	11/8/2023 18:41	1,755.45	423
Breaker	PLANNED OUTAGE	11/8/2023 18:41	4.15	1
PLF	PLANNED OUTAGE	11/8/2023 18:41	12,077.82	53
Switch	PLANNED OUTAGE	11/9/2023 0:14	424.37	2
PLF	PLANNED OUTAGE	11/9/2023 1:42	218.72	1
Transformer	PLANNED OUTAGE	11/9/2023 5:48	108.03	1
Transformer	PLANNED OUTAGE	11/9/2023 7:58	38.12	1
Transformer	PLANNED OUTAGE	11/9/2023 8:35	347.52	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/9/2023 8:53	2,649.00	12
Transformer	PLANNED OUTAGE	11/9/2023 8:59	1,520.40	8
Transformer	PLANNED OUTAGE	11/9/2023 9:24	72.67	1
Transformer	PLANNED OUTAGE	11/9/2023 10:26	251.90	6
Transformer	PLANNED OUTAGE	11/9/2023 10:31	12.28	1
Transformer	PLANNED OUTAGE	11/9/2023 10:45	80.38	13
Transformer	PLANNED OUTAGE	11/9/2023 10:52	22.32	13
Transformer	PLANNED OUTAGE	11/9/2023 10:53	85.15	1
Transformer	PLANNED OUTAGE	11/9/2023 10:53	62.62	13
Transformer	PLANNED OUTAGE	11/9/2023 10:56	25.78	13
Transformer	PLANNED OUTAGE	11/9/2023 11:16	11.22	1
Transformer	PLANNED OUTAGE	11/9/2023 12:01	15.07	4
Transformer	PLANNED OUTAGE	11/9/2023 13:04	327.70	3
Transformer	PLANNED OUTAGE	11/9/2023 13:33	115.38	7
PLF	PLANNED OUTAGE	11/9/2023 17:20	12.78	1
PLF	PLANNED OUTAGE	11/9/2023 20:16	1,154.60	4
Transformer	PLANNED OUTAGE	11/9/2023 21:23	614.70	6
Transformer	PLANNED OUTAGE	11/9/2023 21:25	144.90	7
Transformer	PLANNED OUTAGE	11/9/2023 21:34	178.93	4
Transformer	PLANNED OUTAGE	11/9/2023 22:20	116.25	3
Transformer	PLANNED OUTAGE	11/9/2023 22:28	148.18	17
Transformer	PLANNED OUTAGE	11/9/2023 23:03	124.70	6
Transformer	PLANNED OUTAGE	11/9/2023 23:24	11.80	6
Transformer	PLANNED OUTAGE	11/9/2023 23:26	6.70	6
PLF	PLANNED OUTAGE	11/10/2023 2:58	722.67	4
PLF	PLANNED OUTAGE	11/10/2023 6:23	560.05	23
PLF	PLANNED OUTAGE	11/10/2023 9:04	451.67	4
Transformer	PLANNED OUTAGE	11/10/2023 9:16	80.70	3
Transformer	PLANNED OUTAGE	11/10/2023 9:23	36.25	5
PLF	PLANNED OUTAGE	11/10/2023 9:37	106.50	1
Transformer	PLANNED OUTAGE	11/10/2023 11:36	320.47	4
Transformer	PLANNED OUTAGE	11/10/2023 12:14	141.47	2
Transformer Bank	PLANNED OUTAGE	11/10/2023 12:21	108.78	1
Transformer	PLANNED OUTAGE	11/10/2023 13:27	20.50	2
Transformer	PLANNED OUTAGE	11/10/2023 13:54	22.22	1
Service point	PLANNED OUTAGE	11/10/2023 14:13	15.10	1
Service point	PLANNED OUTAGE	11/10/2023 17:00	17.43	1
Transformer	PLANNED OUTAGE	11/10/2023 19:11	173.37	7
Transformer	PLANNED OUTAGE	11/10/2023 19:15	167.60	4
PLF	PLANNED OUTAGE	11/11/2023 8:16	483.30	1
PLF	PLANNED OUTAGE	11/11/2023 8:24	471.97	1
PLF	PLANNED OUTAGE	11/11/2023 8:28	942.93	2
PLF	PLANNED OUTAGE	11/11/2023 8:31	468.15	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	11/11/2023 8:53	1,190.80	4
PLF	PLANNED OUTAGE	11/11/2023 8:53	479.27	1
PLF	PLANNED OUTAGE	11/11/2023 9:02	1,272.40	3
TX Replaced (OH)	PLANNED OUTAGE	11/11/2023 14:08	6,592.00	30
TX Replaced (OH)	PLANNED OUTAGE	11/11/2023 14:08	219.12	1
Transformer	PLANNED OUTAGE	11/11/2023 15:47	1,218.73	4
Transformer	PLANNED OUTAGE	11/11/2023 16:42	5.07	2
Transformer	PLANNED OUTAGE	11/11/2023 16:42	1.85	1
Transformer	PLANNED OUTAGE	11/11/2023 16:54	1,039.70	6
Transformer	PLANNED OUTAGE	11/11/2023 17:43	47.53	1
Pole	PLANNED OUTAGE	11/12/2023 6:57	4,101.20	8
Transformer	PLANNED OUTAGE	11/12/2023 13:16	25.78	1
Transformer	PLANNED OUTAGE	11/12/2023 13:41	17.17	5
Transformer	PLANNED OUTAGE	11/12/2023 13:44	66.43	2
Transformer	PLANNED OUTAGE	11/12/2023 14:10	61.97	2
Transformer	PLANNED OUTAGE	11/12/2023 14:40	86.73	4
Transformer	PLANNED OUTAGE	11/12/2023 14:53	131.83	5
Pole	PLANNED OUTAGE	11/12/2023 15:08	21.98	1
Primary Wire	PLANNED OUTAGE	11/13/2023 8:04	2,221.33	16
Recloser	PLANNED OUTAGE	11/13/2023 9:16	886.00	4
Transformer	PLANNED OUTAGE	11/13/2023 9:24	606.35	3
Transformer	PLANNED OUTAGE	11/13/2023 9:25	1,024.67	5
Transformer	PLANNED OUTAGE	11/13/2023 9:56	59.58	5
Transformer	PLANNED OUTAGE	11/13/2023 9:56	41.93	4
Transformer	PLANNED OUTAGE	11/13/2023 10:24	75.58	5
PLF	PLANNED OUTAGE	11/13/2023 10:55	336.40	2
Transformer	PLANNED OUTAGE	11/13/2023 11:02	38.40	1
Transformer	PLANNED OUTAGE	11/13/2023 11:22	172.20	7
Transformer	PLANNED OUTAGE	11/13/2023 11:56	236.90	6
Transformer	PLANNED OUTAGE	11/13/2023 12:36	20.07	4
PLF	PLANNED OUTAGE	11/13/2023 13:02	90.33	1
PLF	PLANNED OUTAGE	11/13/2023 13:31	44.93	1
Transformer	PLANNED OUTAGE	11/13/2023 19:11	258.83	10
Service point	PLANNED OUTAGE	11/13/2023 19:46	18.63	1
PLF	PLANNED OUTAGE	11/14/2023 9:09	58.62	1
Transformer	PLANNED OUTAGE	11/14/2023 9:32	530.55	9
Transformer	PLANNED OUTAGE	11/14/2023 9:34	23.90	1
PLF	PLANNED OUTAGE	11/14/2023 9:46	182.68	1
Transformer	PLANNED OUTAGE	11/14/2023 10:16	22.53	2
Transformer	PLANNED OUTAGE	11/14/2023 10:31	13.95	9
Transformer	PLANNED OUTAGE	11/14/2023 10:33	24.30	9
Transformer	PLANNED OUTAGE	11/14/2023 10:36	15.45	9
Transformer	PLANNED OUTAGE	11/14/2023 10:50	292.10	6

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
PLF	PLANNED OUTAGE	11/14/2023 11:33	253.85	1
Transformer	PLANNED OUTAGE	11/14/2023 12:13	21.43	1
Transformer	PLANNED OUTAGE	11/14/2023 14:17	653.70	18
Transformer	PLANNED OUTAGE	11/14/2023 14:49	17,699.33	40
Transformer	PLANNED OUTAGE	11/14/2023 14:57	665.50	11
Breaker	PLANNED OUTAGE	11/14/2023 15:21	10,134.13	1708
Breaker	PLANNED OUTAGE	11/14/2023 15:21	5.92	1
PLF	PLANNED OUTAGE	11/15/2023 2:44	1,616.13	136
Primary Wire	PLANNED OUTAGE	11/15/2023 6:26	515.17	5
Breaker	PLANNED OUTAGE	11/15/2023 6:43	17,318.88	1109
Transformer	PLANNED OUTAGE	11/15/2023 8:27	5,572.07	38
Transformer	PLANNED OUTAGE	11/15/2023 8:41	657.73	8
PLF	PLANNED OUTAGE	11/15/2023 8:48	294.22	1
PLF	PLANNED OUTAGE	11/15/2023 9:02	227.03	1
Transformer	PLANNED OUTAGE	11/15/2023 9:43	260.73	4
PLF	PLANNED OUTAGE	11/15/2023 9:54	337.50	3
Transformer	PLANNED OUTAGE	11/15/2023 10:02	640.40	8
Transformer	PLANNED OUTAGE	11/15/2023 10:49	715.70	3
PLF	PLANNED OUTAGE	11/15/2023 10:55	239.63	26
PLF	PLANNED OUTAGE	11/15/2023 11:16	113.90	3
Recloser	PLANNED OUTAGE	11/15/2023 12:17	815.50	5
Transformer	PLANNED OUTAGE	11/15/2023 13:17	89.58	5
Transformer	PLANNED OUTAGE	11/15/2023 15:03	43.05	3
PLF	PLANNED OUTAGE	11/15/2023 21:28	1,330.67	20
Transformer	PLANNED OUTAGE	11/16/2023 7:42	2,090.00	8
PLF	PLANNED OUTAGE	11/16/2023 8:57	31.43	1
Transformer	PLANNED OUTAGE	11/16/2023 9:37	181.30	3
Transformer	PLANNED OUTAGE	11/16/2023 9:41	37.18	1
Transformer	PLANNED OUTAGE	11/16/2023 10:59	741.85	3
Transformer	PLANNED OUTAGE	11/16/2023 11:57	20.27	1
Transformer	PLANNED OUTAGE	11/16/2023 13:22	35.05	3
Transformer	PLANNED OUTAGE	11/16/2023 14:21	124.07	2
Transformer	PLANNED OUTAGE	11/16/2023 14:45	25.07	1
Transformer	PLANNED OUTAGE	11/16/2023 15:10	22.27	1
Transformer	PLANNED OUTAGE	11/16/2023 15:36	70.50	3
Transformer	PLANNED OUTAGE	11/16/2023 16:48	18.78	1
Breaker	PLANNED OUTAGE	11/16/2023 17:24	793.60	93
Breaker	PLANNED OUTAGE	11/16/2023 17:24	2,230.82	977
Breaker	PLANNED OUTAGE	11/16/2023 17:24	2.28	1
Breaker	PLANNED OUTAGE	11/16/2023 17:24	2.28	1
Breaker	PLANNED OUTAGE	11/16/2023 17:24	2.28	1
Breaker	PLANNED OUTAGE	11/16/2023 17:24	1.92	1
Breaker	PLANNED OUTAGE	11/16/2023 17:24	2.17	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Breaker	PLANNED OUTAGE	11/16/2023 17:24	2.33	1
Transformer	PLANNED OUTAGE	11/16/2023 21:26	290.13	4
PLF	PLANNED OUTAGE	11/16/2023 21:38	273.08	1
Transformer Bank	PLANNED OUTAGE	11/17/2023 3:25	261.20	2
PLF	PLANNED OUTAGE	11/17/2023 9:57	768.97	2
PLF	PLANNED OUTAGE	11/17/2023 10:54	14.77	1
Transformer Bank	PLANNED OUTAGE	11/17/2023 11:35	269.15	7
Transformer	PLANNED OUTAGE	11/17/2023 14:38	83.97	1
Transformer	PLANNED OUTAGE	11/17/2023 18:33	13.38	1
Transformer	PLANNED OUTAGE	11/17/2023 19:11	16.55	1
Transformer	PLANNED OUTAGE	11/17/2023 19:31	23.52	1
Transformer	PLANNED OUTAGE	11/17/2023 21:28	87.30	9
Transformer Bank	PLANNED OUTAGE	11/17/2023 23:30	822.85	7
PLF	PLANNED OUTAGE	11/18/2023 10:05	234.87	1
PLF	PLANNED OUTAGE	11/18/2023 10:21	218.88	1
Transformer	PLANNED OUTAGE	11/18/2023 13:41	24.13	1
Transformer	PLANNED OUTAGE	11/18/2023 15:39	16.60	1
Transformer	PLANNED OUTAGE	11/18/2023 15:51	1,612.17	34
Transformer	PLANNED OUTAGE	11/18/2023 15:55	114.13	8
Recloser	PLANNED OUTAGE	11/19/2023 11:07	1,552.00	120
Recloser	PLANNED OUTAGE	11/19/2023 11:07	167.92	13
Transformer	PLANNED OUTAGE	11/19/2023 14:17	92.73	2
Transformer	PLANNED OUTAGE	11/20/2023 9:13	508.50	6
Transformer	PLANNED OUTAGE	11/20/2023 9:55	2,763.90	18
Transformer	PLANNED OUTAGE	11/20/2023 10:43	48.33	2
Transformer	PLANNED OUTAGE	11/20/2023 10:53	226.68	7
Service point	PLANNED OUTAGE	11/20/2023 13:08	112.03	1
Transformer	PLANNED OUTAGE	11/20/2023 13:58	733.50	9
PLF	PLANNED OUTAGE	11/20/2023 14:25	3,073.60	102
Transformer	PLANNED OUTAGE	11/20/2023 14:35	211.25	5
Transformer	PLANNED OUTAGE	11/20/2023 16:09	135.00	5
Breaker	PLANNED OUTAGE	11/20/2023 16:58	7,765.50	558
Transformer Bank	PLANNED OUTAGE	11/20/2023 19:29	894.05	3
Primary Wire	PLANNED OUTAGE	11/20/2023 19:32	147.40	1
Transformer	PLANNED OUTAGE	11/21/2023 8:51	324.83	2
Transformer	PLANNED OUTAGE	11/21/2023 8:55	85.83	2
Transformer	PLANNED OUTAGE	11/21/2023 8:55	70.68	1
PLF	PLANNED OUTAGE	11/21/2023 9:03	118.87	1
PLF	PLANNED OUTAGE	11/21/2023 9:20	279.95	1
PLF	PLANNED OUTAGE	11/21/2023 9:23	694.77	2
PLF	PLANNED OUTAGE	11/21/2023 9:24	1,038.35	3
Transformer	PLANNED OUTAGE	11/21/2023 9:28	44.70	1
Transformer	PLANNED OUTAGE	11/21/2023 9:32	77.90	2

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/21/2023 9:42	184.53	4
Transformer	PLANNED OUTAGE	11/21/2023 9:44	336.53	2
Transformer	PLANNED OUTAGE	11/21/2023 9:44	164.53	1
Transformer	PLANNED OUTAGE	11/21/2023 9:44	975.33	7
Transformer	PLANNED OUTAGE	11/21/2023 9:50	158.75	1
Transformer	PLANNED OUTAGE	11/21/2023 9:58	25.23	1
PLF	PLANNED OUTAGE	11/21/2023 10:21	400.73	1
Transformer	PLANNED OUTAGE	11/21/2023 10:29	953.33	8
Transformer	PLANNED OUTAGE	11/21/2023 11:08	206.05	1
Transformer	PLANNED OUTAGE	11/21/2023 11:11	48.87	2
Transformer	PLANNED OUTAGE	11/21/2023 11:27	65.20	2
Transformer	PLANNED OUTAGE	11/21/2023 11:52	72.13	2
Transformer	PLANNED OUTAGE	11/21/2023 12:18	44.73	2
Transformer	PLANNED OUTAGE	11/21/2023 12:56	213.85	7
Transformer Bank	PLANNED OUTAGE	11/21/2023 17:27	120.80	4
Transformer Bank	PLANNED OUTAGE	11/22/2023 7:44	1,568.50	3
Transformer	PLANNED OUTAGE	11/22/2023 9:05	183.77	2
Transformer	PLANNED OUTAGE	11/22/2023 13:57	17,247.92	25
Breaker	PLANNED OUTAGE	11/22/2023 16:13	21,073.73	1876
Breaker	PLANNED OUTAGE	11/22/2023 16:13	12.02	1
Breaker	PLANNED OUTAGE	11/22/2023 16:13	11.22	1
Breaker	PLANNED OUTAGE	11/22/2023 16:13	11.90	1
Breaker	PLANNED OUTAGE	11/24/2023 5:28	3,869.50	426
Breaker	PLANNED OUTAGE	11/24/2023 5:28	8.90	1
Breaker	PLANNED OUTAGE	11/24/2023 5:28	6,426.53	628
Breaker	PLANNED OUTAGE	11/24/2023 5:28	10.23	1
PLF	PLANNED OUTAGE	11/24/2023 7:27	24,165.75	105
Breaker	PLANNED OUTAGE	11/24/2023 8:38	12,874.40	627
Breaker	PLANNED OUTAGE	11/24/2023 8:38	20.53	1
Breaker	PLANNED OUTAGE	11/24/2023 8:38	20.53	1
Transformer	PLANNED OUTAGE	11/25/2023 1:34	20.83	1
Transformer	PLANNED OUTAGE	11/25/2023 8:00	179.80	2
Transformer	PLANNED OUTAGE	11/25/2023 12:49	278.83	10
Transformer	PLANNED OUTAGE	11/25/2023 13:23	170.10	6
Transformer	PLANNED OUTAGE	11/25/2023 14:42	47.03	2
Transformer	PLANNED OUTAGE	11/25/2023 14:53	85.47	4
Transformer	PLANNED OUTAGE	11/25/2023 23:56	64.30	3
Transformer	PLANNED OUTAGE	11/26/2023 12:19	192.75	3
Transformer	PLANNED OUTAGE	11/26/2023 14:02	102.25	3
Transformer	PLANNED OUTAGE	11/26/2023 14:53	21.18	1
Transformer	PLANNED OUTAGE	11/26/2023 15:27	167.77	7
Transformer Bank	PLANNED OUTAGE	11/26/2023 19:41	228.13	8
Primary Wire	PLANNED OUTAGE	11/26/2023 20:43	4,554.30	34

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	11/27/2023 9:40	40.67	2
Transformer	PLANNED OUTAGE	11/27/2023 9:43	2,607.58	13
Transformer	PLANNED OUTAGE	11/27/2023 10:15	23.48	1
Transformer	PLANNED OUTAGE	11/27/2023 10:56	692.53	4
Transformer	PLANNED OUTAGE	11/27/2023 10:57	1,008.50	6
PLF	PLANNED OUTAGE	11/27/2023 11:11	3,329.70	33
Transformer	PLANNED OUTAGE	11/27/2023 11:15	434.68	11
Transformer	PLANNED OUTAGE	11/27/2023 12:38	203.07	1
Transformer	PLANNED OUTAGE	11/27/2023 12:57	21.88	1
Transformer	PLANNED OUTAGE	11/27/2023 13:18	77.07	4
Transformer	PLANNED OUTAGE	11/27/2023 13:31	93.47	4
Transformer	PLANNED OUTAGE	11/27/2023 14:10	197.67	20
Transformer	PLANNED OUTAGE	11/27/2023 14:20	91.33	20
Transformer	PLANNED OUTAGE	11/27/2023 16:03	50.90	3
Primary Wire	PLANNED OUTAGE	11/27/2023 18:29	640.27	4
Primary Wire	PLANNED OUTAGE	11/27/2023 19:14	364.80	2
Transformer	PLANNED OUTAGE	11/27/2023 21:41	214.55	7
Transformer	PLANNED OUTAGE	11/28/2023 0:15	37.57	2
Transformer Bank	PLANNED OUTAGE	11/28/2023 9:00	995.67	5
Primary Wire	PLANNED OUTAGE	11/28/2023 9:01	2,208.43	11
Transformer	PLANNED OUTAGE	11/28/2023 9:24	47.80	6
Transformer	PLANNED OUTAGE	11/28/2023 9:34	706.07	2
PLF	PLANNED OUTAGE	11/28/2023 10:01	229.37	1
Transformer	PLANNED OUTAGE	11/28/2023 10:25	697.40	66
Transformer	PLANNED OUTAGE	11/28/2023 10:37	52.37	1
Transformer	PLANNED OUTAGE	11/28/2023 10:38	572.40	8
Transformer	PLANNED OUTAGE	11/28/2023 10:43	65.33	7
Transformer	PLANNED OUTAGE	11/28/2023 10:43	632.40	9
Transformer	PLANNED OUTAGE	11/28/2023 10:56	59.42	5
Service point	PLANNED OUTAGE	11/28/2023 10:57	20.97	1
Transformer	PLANNED OUTAGE	11/28/2023 11:18	30.53	1
Transformer	PLANNED OUTAGE	11/28/2023 11:24	27.17	1
Transformer Bank	PLANNED OUTAGE	11/28/2023 15:43	113.87	2
Transformer	PLANNED OUTAGE	11/28/2023 16:51	631.33	10
OCR, Sec.	PLANNED OUTAGE	11/28/2023 17:33	1,203.40	1094
Transformer	PLANNED OUTAGE	11/28/2023 17:54	43.83	10
Transformer	PLANNED OUTAGE	11/28/2023 17:57	12.33	10
PLF	PLANNED OUTAGE	11/28/2023 18:55	221.87	2
Transformer	PLANNED OUTAGE	11/28/2023 19:32	1,617.47	8
Transformer	PLANNED OUTAGE	11/28/2023 19:42	1,638.27	8
Transformer	PLANNED OUTAGE	11/29/2023 0:50	343.35	21
Service point	PLANNED OUTAGE	11/29/2023 1:04	4.15	1
Transformer	PLANNED OUTAGE	11/29/2023 8:56	1,346.75	5

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Switch	PLANNED OUTAGE	11/29/2023 9:01	6,151.93	22
Switch	PLANNED OUTAGE	11/29/2023 9:12	11,880.33	145
Transformer	PLANNED OUTAGE	11/29/2023 9:37	66.30	6
Transformer	PLANNED OUTAGE	11/29/2023 9:48	20.30	6
Transformer	PLANNED OUTAGE	11/29/2023 9:49	8.80	6
Transformer	PLANNED OUTAGE	11/29/2023 9:58	1,792.35	7
Service point	PLANNED OUTAGE	11/29/2023 9:59	259.53	1
Switch	PLANNED OUTAGE	11/29/2023 10:34	27,450.50	138
Transformer	PLANNED OUTAGE	11/29/2023 10:54	288.05	7
Transformer	PLANNED OUTAGE	11/29/2023 11:42	2.22	1
Transformer	PLANNED OUTAGE	11/29/2023 12:57	374.55	9
Transformer	PLANNED OUTAGE	11/29/2023 13:21	378.58	7
Transformer	PLANNED OUTAGE	11/29/2023 13:39	19.50	9
Transformer	PLANNED OUTAGE	11/29/2023 13:41	1,500.90	9
Transformer Bank	PLANNED OUTAGE	11/29/2023 22:42	44.87	1
PLF	PLANNED OUTAGE	11/30/2023 1:39	348.60	2
Service point	PLANNED OUTAGE	11/30/2023 5:02	64.95	1
PLF	PLANNED OUTAGE	11/30/2023 7:32	174.45	3
Transformer	PLANNED OUTAGE	11/30/2023 7:45	38.48	1
Transformer	PLANNED OUTAGE	11/30/2023 8:21	49.40	2
Transformer Bank	PLANNED OUTAGE	11/30/2023 8:38	164.40	3
Transformer	PLANNED OUTAGE	11/30/2023 8:50	70.10	3
Transformer	PLANNED OUTAGE	11/30/2023 8:52	21.77	1
Transformer	PLANNED OUTAGE	11/30/2023 9:04	744.45	9
Transformer	PLANNED OUTAGE	11/30/2023 9:06	923.47	8
Transformer	PLANNED OUTAGE	11/30/2023 9:18	12.55	1
PLF	PLANNED OUTAGE	11/30/2023 9:36	323.60	4
Transformer	PLANNED OUTAGE	11/30/2023 9:54	803.17	5
Transformer	PLANNED OUTAGE	11/30/2023 9:56	4,902.93	32
Transformer	PLANNED OUTAGE	11/30/2023 10:02	25.05	1
Transformer	PLANNED OUTAGE	11/30/2023 10:03	112.90	3
Transformer	PLANNED OUTAGE	11/30/2023 10:03	220.00	6
Transformer	PLANNED OUTAGE	11/30/2023 10:03	149.80	4
Transformer	PLANNED OUTAGE	11/30/2023 10:03	190.67	5
Transformer	PLANNED OUTAGE	11/30/2023 10:42	492.67	5
Transformer	PLANNED OUTAGE	11/30/2023 10:52	37.47	1
Transformer	PLANNED OUTAGE	11/30/2023 10:54	113.23	2
Transformer	PLANNED OUTAGE	11/30/2023 11:13	144.40	8
Transformer	PLANNED OUTAGE	11/30/2023 11:37	27.70	2
Transformer	PLANNED OUTAGE	11/30/2023 11:56	31.35	3
Transformer	PLANNED OUTAGE	11/30/2023 12:59	88.97	1
Transformer	PLANNED OUTAGE	11/30/2023 22:21	39.20	2
Transformer	PLANNED OUTAGE	12/1/2023 0:15	12.15	9

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer Bank	PLANNED OUTAGE	12/1/2023 0:20	33.23	1
Transformer	PLANNED OUTAGE	12/1/2023 7:40	76.53	7
PLF	PLANNED OUTAGE	12/1/2023 9:57	1,186.80	4
Transformer	PLANNED OUTAGE	12/1/2023 10:21	35.13	2
Transformer	PLANNED OUTAGE	12/1/2023 11:44	8,299.20	24
TX Repaired (OH)	PLANNED OUTAGE	12/1/2023 14:56	62.13	1
Transformer	PLANNED OUTAGE	12/1/2023 17:17	6.90	2
PLF	PLANNED OUTAGE	12/1/2023 17:54	72.40	2
Transformer	PLANNED OUTAGE	12/1/2023 20:58	1,170.15	3
Transformer	PLANNED OUTAGE	12/2/2023 2:03	1,091.75	11
Transformer	PLANNED OUTAGE	12/2/2023 19:35	1,479.20	8
Transformer	PLANNED OUTAGE	12/3/2023 3:45	552.30	18
PLF	PLANNED OUTAGE	12/3/2023 8:10	1,002.70	2
Transformer	PLANNED OUTAGE	12/3/2023 8:48	328.10	1
PLF	PLANNED OUTAGE	12/3/2023 9:18	608.85	1
PLF	PLANNED OUTAGE	12/3/2023 9:44	1,165.43	2
PLF	PLANNED OUTAGE	12/3/2023 9:44	1,176.07	2
PLF	PLANNED OUTAGE	12/3/2023 11:16	215.73	1
Service point	PLANNED OUTAGE	12/3/2023 13:17	157.83	1
Recloser	PLANNED OUTAGE	12/3/2023 21:00	516.93	8
Recloser	PLANNED OUTAGE	12/3/2023 21:07	464.67	8
Breaker	PLANNED OUTAGE	12/3/2023 22:24	23,702.70	63
Breaker	PLANNED OUTAGE	12/3/2023 22:24	32,357.50	86
Transformer	PLANNED OUTAGE	12/4/2023 8:37	1,708.40	4
Transformer	PLANNED OUTAGE	12/4/2023 9:42	802.50	15
Service point	PLANNED OUTAGE	12/4/2023 11:14	270.78	1
Transformer	PLANNED OUTAGE	12/4/2023 11:29	66.33	2
Transformer	PLANNED OUTAGE	12/4/2023 11:33	65.98	1
Transformer	PLANNED OUTAGE	12/4/2023 11:43	713.00	15
PLF	PLANNED OUTAGE	12/4/2023 11:53	911.17	110
Transformer	PLANNED OUTAGE	12/4/2023 11:54	293.83	10
Transformer	PLANNED OUTAGE	12/4/2023 12:38	121.60	6
Transformer	PLANNED OUTAGE	12/4/2023 13:38	430.00	15
PLF	PLANNED OUTAGE	12/4/2023 15:34	3,749.33	40
Transformer Bank	PLANNED OUTAGE	12/4/2023 20:50	446.80	2
UG Other	PLANNED OUTAGE	12/5/2023 7:13	259.43	1
Switch	PLANNED OUTAGE	12/5/2023 8:06	3,363.00	18
Transformer	PLANNED OUTAGE	12/5/2023 8:26	312.27	4
Transformer	PLANNED OUTAGE	12/5/2023 9:14	738.33	10
Recloser	PLANNED OUTAGE	12/5/2023 9:35	3,801.13	37
Transformer	PLANNED OUTAGE	12/5/2023 9:50	136.20	2
Service point	PLANNED OUTAGE	12/5/2023 9:50	45.87	1
Transformer	PLANNED OUTAGE	12/5/2023 10:19	156.40	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/5/2023 11:27	5,073.95	109
Transformer	PLANNED OUTAGE	12/5/2023 11:53	23.13	1
Transformer	PLANNED OUTAGE	12/5/2023 12:29	156.42	5
Transformer	PLANNED OUTAGE	12/5/2023 12:57	24.60	2
Transformer	PLANNED OUTAGE	12/5/2023 14:29	63.80	2
PLF	PLANNED OUTAGE	12/5/2023 15:12	21.17	2
Transformer	PLANNED OUTAGE	12/5/2023 15:42	958.50	10
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	4,394.60	438
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	10.03	1
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	10.03	1
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	10,035.90	3717
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	5.40	2
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	5.40	2
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	2.73	1
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	2.73	1
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	2.73	1
Breaker	PLANNED OUTAGE	12/5/23 2:13 PM	2.73	1
PLF	PLANNED OUTAGE	12/6/2023 1:40	279.23	2
PLF	PLANNED OUTAGE	12/6/2023 8:31	875.50	17
Transformer	PLANNED OUTAGE	12/6/2023 9:22	46.03	2
Transformer	PLANNED OUTAGE	12/6/2023 9:42	1,034.73	11
Transformer	PLANNED OUTAGE	12/6/2023 10:05	76.57	2
PLF	PLANNED OUTAGE	12/6/2023 11:10	1,260.23	14
Transformer	PLANNED OUTAGE	12/6/2023 12:10	313.87	8
PLF	PLANNED OUTAGE	12/6/2023 12:12	99.13	2
Transformer	PLANNED OUTAGE	12/6/2023 12:53	110.20	2
Transformer	PLANNED OUTAGE	12/6/2023 13:46	73.90	1
Switch	PLANNED OUTAGE	12/6/2023 16:01	2,451.87	56
Switch	PLANNED OUTAGE	12/6/2023 16:01	102,964.95	363
Transformer	PLANNED OUTAGE	12/6/2023 18:05	16.40	1
Transformer	PLANNED OUTAGE	12/6/2023 20:34	530.73	4
Transformer	PLANNED OUTAGE	12/6/2023 23:31	1,894.13	16
Transformer	PLANNED OUTAGE	12/6/2023 23:37	1,444.80	7
Transformer Bank	PLANNED OUTAGE	12/6/2023 23:43	1,282.20	12
Transformer	PLANNED OUTAGE	12/7/2023 0:14	924.20	12
Primary Wire	PLANNED OUTAGE	12/7/2023 0:29	1,547.53	4
Primary Wire	PLANNED OUTAGE	12/7/2023 0:29	765.73	2
Primary Wire	PLANNED OUTAGE	12/7/2023 0:29	2,364.50	6
Transformer	PLANNED OUTAGE	12/7/2023 7:48	271.87	2
Transformer Bank	PLANNED OUTAGE	12/7/2023 8:19	199.10	2
Transformer	PLANNED OUTAGE	12/7/2023 8:20	686.73	2
Transformer	PLANNED OUTAGE	12/7/2023 8:21	401.52	1
Primary Wire	PLANNED OUTAGE	12/7/2023 8:57	3,169.50	18

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
TX Repaired (PM)	PLANNED OUTAGE	12/7/2023 9:42	173.30	1
Transformer	PLANNED OUTAGE	12/7/2023 10:58	23.32	1
PLF	PLANNED OUTAGE	12/7/2023 11:28	13.85	3
Transformer	PLANNED OUTAGE	12/7/2023 12:33	43.07	2
Transformer	PLANNED OUTAGE	12/7/2023 12:41	120.70	3
PLF	PLANNED OUTAGE	12/7/2023 16:42	577.75	1
Transformer	PLANNED OUTAGE	12/7/2023 16:56	5,608.20	36
Transformer Bank	PLANNED OUTAGE	12/7/2023 16:58	279.22	1
Transformer	PLANNED OUTAGE	12/7/2023 23:11	216.27	4
Breaker	PLANNED OUTAGE	12/8/2023 7:35	16,766.00	1245
Breaker	PLANNED OUTAGE	12/8/2023 7:35	13.47	1
Breaker	PLANNED OUTAGE	12/8/2023 7:35	13.47	1
Transformer	PLANNED OUTAGE	12/8/2023 7:51	142.40	6
Transformer	PLANNED OUTAGE	12/8/2023 8:24	503.53	7
Recloser	PLANNED OUTAGE	12/8/2023 9:18	125.23	1
Transformer Bank	PLANNED OUTAGE	12/8/2023 9:22	13.70	2
Transformer	PLANNED OUTAGE	12/8/2023 9:25	80.00	3
PLF	PLANNED OUTAGE	12/8/2023 9:32	147.42	1
Transformer	PLANNED OUTAGE	12/8/2023 11:01	34.80	2
Transformer Bank	PLANNED OUTAGE	12/8/2023 11:06	18.17	2
Service point	PLANNED OUTAGE	12/8/2023 12:37	123.50	1
Transformer	PLANNED OUTAGE	12/8/2023 13:11	603.20	13
Transformer Bank	PLANNED OUTAGE	12/8/2023 13:15	23.18	1
Transformer	PLANNED OUTAGE	12/8/2023 13:27	37.70	1
Transformer	PLANNED OUTAGE	12/8/2023 14:18	56.40	2
Transformer	PLANNED OUTAGE	12/8/2023 15:11	175.87	4
Transformer	PLANNED OUTAGE	12/8/2023 16:41	21.40	1
Transformer	PLANNED OUTAGE	12/8/2023 17:09	711.10	6
Transformer	PLANNED OUTAGE	12/9/2023 3:45	69.50	6
Transformer	PLANNED OUTAGE	12/9/2023 7:18	814.38	1
Transformer	PLANNED OUTAGE	12/9/2023 9:36	32.67	10
Transformer	PLANNED OUTAGE	12/9/2023 15:44	760.80	12
Recloser	PLANNED OUTAGE	12/9/2023 16:53	1,966.95	9
PLF	PLANNED OUTAGE	12/9/2023 19:48	433.23	2
Transformer Bank	PLANNED OUTAGE	12/9/2023 19:56	119.30	2
PLF	PLANNED OUTAGE	12/9/2023 21:13	7.82	1
Transformer	PLANNED OUTAGE	12/10/2023 2:28	14.02	1
PLF	PLANNED OUTAGE	12/10/2023 7:32	239.73	8
PLF	PLANNED OUTAGE	12/10/2023 8:05	228.78	1
PLF	PLANNED OUTAGE	12/10/2023 8:05	228.97	1
Transformer	PLANNED OUTAGE	12/10/2023 17:31	122.97	7
Transformer	PLANNED OUTAGE	12/10/2023 19:34	217.82	7
PLF	PLANNED OUTAGE	12/11/2023 0:17	1,589.75	5

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Primary Wire	PLANNED OUTAGE	12/11/2023 0:35	9,895.05	33
Transformer	PLANNED OUTAGE	12/11/2023 2:17	1,329.72	11
Transformer	PLANNED OUTAGE	12/11/2023 2:17	1,326.40	12
Transformer	PLANNED OUTAGE	12/11/2023 2:17	1,242.45	11
Transformer	PLANNED OUTAGE	12/11/2023 2:17	457.07	4
Transformer	PLANNED OUTAGE	12/11/2023 2:17	1,532.92	13
Transformer	PLANNED OUTAGE	12/11/2023 3:26	622.10	2
PLF	PLANNED OUTAGE	12/11/2023 7:04	189.80	12
PLF	PLANNED OUTAGE	12/11/2023 7:35	1,885.37	163
PLF	PLANNED OUTAGE	12/11/2023 8:30	7,073.27	28
Transformer	PLANNED OUTAGE	12/11/2023 8:35	27.22	1
Transformer	PLANNED OUTAGE	12/11/2023 8:53	204.33	1
Recloser	PLANNED OUTAGE	12/11/2023 9:15	8,893.05	101
Transformer	PLANNED OUTAGE	12/11/2023 9:32	1,487.50	21
Transformer	PLANNED OUTAGE	12/11/2023 9:34	172.40	4
Transformer	PLANNED OUTAGE	12/11/2023 11:04	69.83	10
Transformer	PLANNED OUTAGE	12/11/2023 11:04	30.47	4
Transformer	PLANNED OUTAGE	12/11/2023 11:04	20.25	3
Transformer	PLANNED OUTAGE	12/11/2023 11:16	705.60	8
Transformer	PLANNED OUTAGE	12/11/2023 11:51	51.43	2
Transformer	PLANNED OUTAGE	12/11/2023 12:04	21.95	1
Transformer	PLANNED OUTAGE	12/11/2023 12:24	214.55	7
Transformer	PLANNED OUTAGE	12/11/2023 12:34	55.17	2
Transformer	PLANNED OUTAGE	12/11/2023 12:50	31.97	1
Transformer	PLANNED OUTAGE	12/11/2023 13:12	532.23	7
Transformer	PLANNED OUTAGE	12/11/2023 15:09	69.95	3
Transformer	PLANNED OUTAGE	12/11/2023 16:04	2,400.67	13
Transformer	PLANNED OUTAGE	12/11/2023 16:17	2,318.33	13
Transformer	PLANNED OUTAGE	12/11/2023 16:25	701.50	138
Transformer	PLANNED OUTAGE	12/11/2023 16:30	2,187.47	13
Transformer	PLANNED OUTAGE	12/11/2023 20:13	338.80	8
Breaker	PLANNED OUTAGE	12/11/2023 23:21	6,382.93	1088
Breaker	PLANNED OUTAGE	12/11/2023 23:21	5.58	1
Breaker	PLANNED OUTAGE	12/11/2023 23:21	5.82	1
Breaker	PLANNED OUTAGE	12/11/2023 23:21	5.95	1
Breaker	PLANNED OUTAGE	12/11/2023 23:21	5.63	1
Breaker	PLANNED OUTAGE	12/11/2023 23:21	5.77	1
Breaker	PLANNED OUTAGE	12/11/2023 23:38	12,099.00	1090
Breaker	PLANNED OUTAGE	12/11/2023 23:38	11.20	1
Breaker	PLANNED OUTAGE	12/11/2023 23:38	11.07	1
Breaker	PLANNED OUTAGE	12/11/2023 23:38	10.90	1
PLF	PLANNED OUTAGE	12/12/2023 8:38	165.75	1
Transformer	PLANNED OUTAGE	12/12/2023 9:20	158.92	1

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/12/2023 9:26	6,580.60	26
PLF	PLANNED OUTAGE	12/12/2023 9:33	1,508.08	5
Transformer	PLANNED OUTAGE	12/12/2023 9:55	3,652.73	34
Transformer	PLANNED OUTAGE	12/12/2023 9:56	321.00	6
PLF	PLANNED OUTAGE	12/12/2023 10:11	274.17	50
Transformer	PLANNED OUTAGE	12/12/2023 10:19	301.35	7
Transformer	PLANNED OUTAGE	12/12/2023 10:22	1,485.00	15
PLF	PLANNED OUTAGE	12/12/2023 10:39	964.00	16
PLF	PLANNED OUTAGE	12/12/2023 11:22	34.50	6
PLF	PLANNED OUTAGE	12/12/2023 11:41	277.07	16
Transformer	PLANNED OUTAGE	12/12/2023 12:31	105.90	2
Transformer	PLANNED OUTAGE	12/12/2023 13:17	18.70	11
Transformer	PLANNED OUTAGE	12/12/2023 14:07	154.73	4
Transformer	PLANNED OUTAGE	12/12/2023 17:55	258.95	3
PLF	PLANNED OUTAGE	12/12/2023 19:49	334.12	1
Transformer	PLANNED OUTAGE	12/13/2023 8:31	1,020.40	12
Transformer	PLANNED OUTAGE	12/13/2023 8:42	307.80	2
Recloser	PLANNED OUTAGE	12/13/2023 8:45	677.70	9
PLF	PLANNED OUTAGE	12/13/2023 8:57	1,979.90	13
PLF	PLANNED OUTAGE	12/13/2023 9:23	424.15	3
PLF	PLANNED OUTAGE	12/13/2023 9:31	12,290.20	29
Transformer	PLANNED OUTAGE	12/13/2023 9:47	54.50	3
Transformer	PLANNED OUTAGE	12/13/2023 9:50	989.70	9
PLF	PLANNED OUTAGE	12/13/2023 9:51	6,303.03	17
Transformer	PLANNED OUTAGE	12/13/2023 10:04	514.17	2
Transformer	PLANNED OUTAGE	12/13/2023 10:08	152.62	1
Transformer	PLANNED OUTAGE	12/13/2023 10:20	240.92	1
Transformer	PLANNED OUTAGE	12/13/2023 10:22	127.47	4
PLF	PLANNED OUTAGE	12/13/2023 10:29	1,547.55	27
Transformer	PLANNED OUTAGE	12/13/2023 10:52	67.93	1
Transformer	PLANNED OUTAGE	12/13/2023 11:00	1,032.83	5
Transformer	PLANNED OUTAGE	12/13/2023 11:49	960.75	9
Transformer	PLANNED OUTAGE	12/13/2023 13:24	565.95	11
Transformer	PLANNED OUTAGE	12/13/2023 14:11	565.83	7
Transformer	PLANNED OUTAGE	12/13/2023 14:25	670.50	5
Transformer	PLANNED OUTAGE	12/13/2023 14:52	49.93	2
PLF	PLANNED OUTAGE	12/13/2023 15:10	16,710.03	103
PLF	PLANNED OUTAGE	12/13/2023 15:10	1,528.00	16
Transformer	PLANNED OUTAGE	12/13/2023 15:37	18.23	1
PLF	PLANNED OUTAGE	12/13/2023 22:13	13,635.00	54
Transformer	PLANNED OUTAGE	12/14/2023 1:03	720.83	10
Transformer	PLANNED OUTAGE	12/14/2023 8:12	10,761.30	18
Primary Wire	PLANNED OUTAGE	12/14/2023 8:37	8,152.87	29

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/14/2023 8:51	110.50	1
Transformer	PLANNED OUTAGE	12/14/2023 9:14	1,571.15	7
Transformer	PLANNED OUTAGE	12/14/2023 9:14	224.45	1
PLF	PLANNED OUTAGE	12/14/2023 9:29	33.45	3
PLF	PLANNED OUTAGE	12/14/2023 9:29	699.90	18
PLF	PLANNED OUTAGE	12/14/2023 10:27	77.93	2
PLF	PLANNED OUTAGE	12/14/2023 10:27	21.85	3
PLF	PLANNED OUTAGE	12/14/2023 10:28	58.87	2
Transformer	PLANNED OUTAGE	12/14/2023 12:06	178.50	5
PLF	PLANNED OUTAGE	12/14/2023 12:20	405.18	7
Transformer	PLANNED OUTAGE	12/14/2023 12:33	1,701.00	180
Transformer	PLANNED OUTAGE	12/14/2023 13:04	255.10	2
Transformer	PLANNED OUTAGE	12/14/2023 13:21	620.25	3
Transformer Bank	PLANNED OUTAGE	12/14/2023 13:24	115.70	2
PLF	PLANNED OUTAGE	12/14/2023 13:25	10,569.60	54
PLF	PLANNED OUTAGE	12/14/2023 13:25	20,532.75	105
Transformer	PLANNED OUTAGE	12/14/2023 13:36	226.40	6
Recloser	PLANNED OUTAGE	12/14/2023 13:57	1,039.65	239
PLF	PLANNED OUTAGE	12/14/2023 13:57	1,132.95	273
Breaker	PLANNED OUTAGE	12/14/2023 14:54	3,694.42	1031
Breaker	PLANNED OUTAGE	12/14/2023 14:54	3.58	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.67	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.67	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.67	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.63	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.60	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.58	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.57	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.55	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.53	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.50	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.50	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.45	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.43	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.42	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	1.40	1
PLF	PLANNED OUTAGE	12/14/2023 15:12	12.33	10
PLF	PLANNED OUTAGE	12/14/2023 15:12	8.98	7
PLF	PLANNED OUTAGE	12/14/2023 15:12	2.47	2
PLF	PLANNED OUTAGE	12/14/2023 15:12	3.85	3
PLF	PLANNED OUTAGE	12/14/2023 15:12	3.25	3
PLF	PLANNED OUTAGE	12/14/2023 15:12	14.73	13
PLF	PLANNED OUTAGE	12/14/2023 15:31	5,499.23	38

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/14/2023 15:50	130.32	1
PLF	PLANNED OUTAGE	12/14/2023 16:46	153.53	2
Transformer	PLANNED OUTAGE	12/14/2023 17:57	1,266.77	2
PLF	PLANNED OUTAGE	12/14/2023 18:56	452.90	1
Transformer	PLANNED OUTAGE	12/14/2023 20:44	283.65	9
PLF	PLANNED OUTAGE	12/14/2023 23:28	325.33	4
Transformer	PLANNED OUTAGE	12/15/2023 1:10	639.33	28
Transformer	PLANNED OUTAGE	12/15/2023 8:25	883.03	2
Transformer	PLANNED OUTAGE	12/15/2023 10:10	39.42	1
PLF	PLANNED OUTAGE	12/15/2023 12:39	1,258.40	13
Transformer	PLANNED OUTAGE	12/15/2023 13:35	915.37	7
PLF	PLANNED OUTAGE	12/15/2023 15:54	294.00	14
Transformer	PLANNED OUTAGE	12/15/2023 16:25	433.65	7
PLF	PLANNED OUTAGE	12/15/2023 17:08	229.43	2
Transformer	PLANNED OUTAGE	12/16/2023 0:21	424.45	3
PLF	PLANNED OUTAGE	12/16/2023 2:45	16,499.17	130
Recloser	PLANNED OUTAGE	12/16/2023 10:01	5,109.25	573
Breaker	PLANNED OUTAGE	12/16/2023 16:11	9,625.60	564
Transformer	PLANNED OUTAGE	12/16/2023 18:23	760.20	1
PLF	PLANNED OUTAGE	12/16/2023 19:54	3,337.72	61
OH Other	PLANNED OUTAGE	12/16/2023 20:46	15,795.87	701
OH Other	PLANNED OUTAGE	12/16/2023 20:46	22.53	1
OH Other	PLANNED OUTAGE	12/16/2023 20:46	22.53	1
OH Other	PLANNED OUTAGE	12/16/2023 20:46	22.53	1
PLF	PLANNED OUTAGE	12/16/2023 20:53	2,116.93	8
Recloser	PLANNED OUTAGE	12/16/2023 21:59	137.50	11
Transformer	PLANNED OUTAGE	12/16/2023 23:43	552.80	3
PLF	PLANNED OUTAGE	12/16/2023 23:43	1,637.25	9
Breaker	PLANNED OUTAGE	12/16/2023 23:54	11,070.58	929
Recloser	PLANNED OUTAGE	12/17/2023 1:03	11,745.07	704
Service point	PLANNED OUTAGE	12/17/2023 1:26	2.12	1
Switch	PLANNED OUTAGE	12/17/2023 6:22	70,005.87	598
Switch	PLANNED OUTAGE	12/17/2023 6:22	11,201.45	39
Switch	PLANNED OUTAGE	12/17/2023 6:22	120.35	1
PLF	PLANNED OUTAGE	12/17/2023 7:04	33,904.73	2716
PLF	PLANNED OUTAGE	12/17/2023 7:04	12.48	1
UG Other	PLANNED OUTAGE	12/17/2023 7:17	3.25	1
UG Other	PLANNED OUTAGE	12/17/2023 7:17	2.37	1
UG Other	PLANNED OUTAGE	12/17/2023 7:17	2.47	1
UG Other	PLANNED OUTAGE	12/17/2023 7:17	5,038.00	1832
PLF	PLANNED OUTAGE	12/17/2023 8:59	1,219.55	3
Recloser	PLANNED OUTAGE	12/17/2023 10:31	36,243.07	1187
Recloser	PLANNED OUTAGE	12/17/2023 10:31	533.45	141

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Recloser	PLANNED OUTAGE	12/17/2023 10:31	34.47	1
Transformer	PLANNED OUTAGE	12/17/2023 11:25	586.20	4
Transformer	PLANNED OUTAGE	12/17/2023 11:51	713.33	4
Transformer	PLANNED OUTAGE	12/17/2023 12:49	623.90	3
Transformer	PLANNED OUTAGE	12/17/2023 13:04	465.50	5
Recloser	PLANNED OUTAGE	12/17/2023 15:46	4,025.60	444
Transformer	PLANNED OUTAGE	12/17/2023 16:28	104.10	3
Transformer	PLANNED OUTAGE	12/17/2023 16:28	997.30	3
Service point	PLANNED OUTAGE	12/17/2023 16:28	25.87	1
Service point	PLANNED OUTAGE	12/17/2023 17:03	297.70	1
PLF	PLANNED OUTAGE	12/18/2023 8:49	58.63	1
Transformer	PLANNED OUTAGE	12/18/2023 8:50	59.20	2
PLF	PLANNED OUTAGE	12/18/2023 9:20	117.20	24
Transformer	PLANNED OUTAGE	12/18/2023 9:32	1,012.58	5
Transformer	PLANNED OUTAGE	12/18/2023 9:53	1,065.00	9
PLF	PLANNED OUTAGE	12/18/2023 9:59	226.07	1
Transformer	PLANNED OUTAGE	12/18/2023 10:09	310.98	1
Transformer	PLANNED OUTAGE	12/18/2023 11:28	70.03	2
Transformer	PLANNED OUTAGE	12/18/2023 12:09	44.00	6
Transformer	PLANNED OUTAGE	12/18/2023 12:44	374.50	3
Transformer	PLANNED OUTAGE	12/18/2023 13:18	265.50	9
Transformer	PLANNED OUTAGE	12/18/2023 14:21	650.83	10
Transformer	PLANNED OUTAGE	12/18/2023 15:06	679.50	9
Transformer	PLANNED OUTAGE	12/18/2023 15:11	8.80	3
Transformer	PLANNED OUTAGE	12/18/2023 15:11	4.40	3
Transformer	PLANNED OUTAGE	12/18/2023 15:31	1,447.18	31
PLF	PLANNED OUTAGE	12/19/2023 7:58	9,078.87	31
Transformer	PLANNED OUTAGE	12/19/2023 8:26	1,097.60	7
Transformer	PLANNED OUTAGE	12/19/2023 8:30	371.43	2
PLF	PLANNED OUTAGE	12/19/2023 8:37	10,621.63	31
PLF	PLANNED OUTAGE	12/19/2023 8:44	1,611.80	6
Transformer	PLANNED OUTAGE	12/19/2023 9:36	1,159.42	5
PLF	PLANNED OUTAGE	12/19/2023 9:37	118.93	1
PLF	PLANNED OUTAGE	12/19/2023 9:43	10,556.53	124
PLF	PLANNED OUTAGE	12/19/2023 10:10	2,473.00	20
Service point	PLANNED OUTAGE	12/19/2023 10:44	64.83	1
PLF	PLANNED OUTAGE	12/19/2023 11:03	1,563.03	13
Transformer	PLANNED OUTAGE	12/19/2023 12:44	1,085.70	21
Transformer	PLANNED OUTAGE	12/19/2023 14:02	51.07	4
Transformer	PLANNED OUTAGE	12/19/2023 14:46	324.40	8
PLF	PLANNED OUTAGE	12/19/2023 21:54	3,159.87	52
Transformer	PLANNED OUTAGE	12/20/2023 2:03	78.27	8
Transformer	PLANNED OUTAGE	12/20/2023 8:05	1,554.93	7

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/20/2023 9:04	602.17	5
PLF	PLANNED OUTAGE	12/20/2023 9:07	78.15	1
Transformer	PLANNED OUTAGE	12/20/2023 9:17	231.27	1
Switch	PLANNED OUTAGE	12/20/2023 9:19	2,114.70	14
PLF	PLANNED OUTAGE	12/20/2023 9:35	215.43	1
Primary Wire	PLANNED OUTAGE	12/20/2023 10:03	2,059.83	34
Transformer	PLANNED OUTAGE	12/20/2023 10:32	19.05	1
Transformer Bank	PLANNED OUTAGE	12/20/2023 12:01	48.13	1
Transformer	PLANNED OUTAGE	12/20/2023 12:18	984.75	15
Transformer	PLANNED OUTAGE	12/20/2023 12:29	28.67	8
Service point	PLANNED OUTAGE	12/20/2023 12:35	48.37	1
Transformer	PLANNED OUTAGE	12/20/2023 13:54	450.00	5
Service point	PLANNED OUTAGE	12/20/2023 14:18	66.23	1
PLF	PLANNED OUTAGE	12/20/2023 15:58	3,367.97	46
Transformer	PLANNED OUTAGE	12/20/2023 16:11	146.90	3
Transformer	PLANNED OUTAGE	12/20/2023 17:18	360.80	6
Transformer	PLANNED OUTAGE	12/20/2023 17:29	306.08	5
PLF	PLANNED OUTAGE	12/20/2023 22:23	795.25	3
Transformer	PLANNED OUTAGE	12/21/2023 0:17	43.45	11
Transformer	PLANNED OUTAGE	12/21/2023 0:36	122.33	5
Transformer	PLANNED OUTAGE	12/21/2023 8:24	915.87	8
Primary Wire	PLANNED OUTAGE	12/21/2023 8:26	18,720.85	223
Transformer	PLANNED OUTAGE	12/21/2023 8:50	146.60	3
PLF	PLANNED OUTAGE	12/21/2023 9:10	4,064.08	7
Transformer	PLANNED OUTAGE	12/21/2023 9:12	190.93	8
Transformer	PLANNED OUTAGE	12/21/2023 9:26	32.63	1
Transformer	PLANNED OUTAGE	12/21/2023 9:32	140.92	5
Transformer	PLANNED OUTAGE	12/21/2023 9:54	323.52	7
Transformer	PLANNED OUTAGE	12/21/2023 10:17	2,863.75	25
PLF	PLANNED OUTAGE	12/21/2023 10:19	5,124.57	94
PLF	PLANNED OUTAGE	12/21/2023 10:19	1,409.63	26
PLF	PLANNED OUTAGE	12/21/2023 11:02	2,761.00	30
PLF	PLANNED OUTAGE	12/21/2023 11:03	1,554.08	17
PLF	PLANNED OUTAGE	12/21/2023 11:20	160.92	1
Transformer	PLANNED OUTAGE	12/21/2023 11:21	336.17	5
Transformer	PLANNED OUTAGE	12/21/2023 11:58	32.60	2
Transformer	PLANNED OUTAGE	12/21/2023 12:46	315.30	6
Transformer	PLANNED OUTAGE	12/21/2023 13:37	141.75	5
Breaker	PLANNED OUTAGE	12/21/2023 16:56	100.52	1
PLF	PLANNED OUTAGE	12/21/2023 17:47	387.00	3
Transformer	PLANNED OUTAGE	12/22/2023 5:31	149.45	1
Transformer	PLANNED OUTAGE	12/22/2023 8:46	878.75	25
Transformer	PLANNED OUTAGE	12/22/2023 9:17	127.40	3

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/22/2023 10:02	112.08	25
Transformer	PLANNED OUTAGE	12/22/2023 13:01	231.20	6
Transformer	PLANNED OUTAGE	12/22/2023 13:54	159.40	6
Transformer	PLANNED OUTAGE	12/22/2023 14:52	17.25	1
Transformer	PLANNED OUTAGE	12/22/2023 20:21	222.93	4
Transformer	PLANNED OUTAGE	12/22/2023 20:38	145.37	14
Transformer	PLANNED OUTAGE	12/22/2023 22:57	1,021.00	10
Transformer	PLANNED OUTAGE	12/23/2023 8:45	637.85	3
Transformer	PLANNED OUTAGE	12/23/2023 12:53	51.30	2
Transformer	PLANNED OUTAGE	12/23/2023 17:17	149.90	6
Transformer	PLANNED OUTAGE	12/23/2023 19:05	85.50	15
PLF	PLANNED OUTAGE	12/24/2023 13:55	98.03	2
Recloser	PLANNED OUTAGE	12/24/2023 20:22	9,734.47	604
Transformer	PLANNED OUTAGE	12/24/2023 22:13	83.20	8
PLF	PLANNED OUTAGE	12/25/2023 18:43	680.77	26
Transformer	PLANNED OUTAGE	12/25/2023 21:40	273.00	12
Transformer	PLANNED OUTAGE	12/26/2023 0:13	195.43	11
PLF	PLANNED OUTAGE	12/26/2023 0:50	72.80	7
PLF	PLANNED OUTAGE	12/26/2023 9:41	823.33	4
Transformer	PLANNED OUTAGE	12/26/2023 17:28	10.68	1
Transformer	PLANNED OUTAGE	12/26/2023 17:47	15.40	1
Transformer	PLANNED OUTAGE	12/26/2023 18:21	18.20	1
Transformer Bank	PLANNED OUTAGE	12/27/2023 8:27	2,594.40	12
Primary Wire	PLANNED OUTAGE	12/27/2023 10:10	15,095.47	64
Transformer	PLANNED OUTAGE	12/27/2023 10:58	70.80	6
Transformer	PLANNED OUTAGE	12/27/2023 11:40	6.93	2
Transformer	PLANNED OUTAGE	12/27/2023 11:43	49.77	2
Transformer	PLANNED OUTAGE	12/27/2023 12:28	2,237.00	60
PLF	PLANNED OUTAGE	12/28/2023 6:13	143.95	1
OH Other	PLANNED OUTAGE	12/28/2023 6:56	303.60	18
Switch	PLANNED OUTAGE	12/28/2023 7:09	6,005.33	32
Transformer	PLANNED OUTAGE	12/28/2023 9:02	117.27	1
PLF	PLANNED OUTAGE	12/28/2023 9:17	297.53	1
Breaker	PLANNED OUTAGE	12/28/2023 9:56	1,528.10	59
Transformer	PLANNED OUTAGE	12/28/2023 10:29	4,904.67	14
PLF	PLANNED OUTAGE	12/28/2023 12:03	188.60	2
PLF	PLANNED OUTAGE	12/28/2023 12:58	212.90	6
Transformer	PLANNED OUTAGE	12/28/2023 13:47	96.98	11
Service point	PLANNED OUTAGE	12/28/2023 14:04	7.85	1
PLF	PLANNED OUTAGE	12/28/2023 17:00	663.30	9
Transformer	PLANNED OUTAGE	12/29/2023 3:10	76.63	2
Transformer	PLANNED OUTAGE	12/29/2023 4:09	89.70	6
Transformer	PLANNED OUTAGE	12/29/2023 4:10	74.75	5

2023 Annual Reliability Performance Report

2023 Adjustments: Other Distribution Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transformer	PLANNED OUTAGE	12/29/2023 7:55	1,411.00	12
Transformer	PLANNED OUTAGE	12/29/2023 7:56	373.17	5
Transformer	PLANNED OUTAGE	12/29/2023 8:33	247.08	5
Transformer	PLANNED OUTAGE	12/29/2023 8:36	645.90	2
Transformer	PLANNED OUTAGE	12/29/2023 8:51	7.45	1
Transformer	PLANNED OUTAGE	12/29/2023 8:54	286.92	5
Connections	PLANNED OUTAGE	12/29/2023 9:22	32.35	3
Transformer	PLANNED OUTAGE	12/29/2023 9:32	224.20	4
Transformer	PLANNED OUTAGE	12/29/2023 9:33	51.10	3
Transformer	PLANNED OUTAGE	12/29/2023 9:59	849.77	13
Transformer	PLANNED OUTAGE	12/29/2023 10:41	71.07	2
PLF	PLANNED OUTAGE	12/29/2023 11:01	135.20	4
Transformer	PLANNED OUTAGE	12/29/2023 11:04	265.00	5
Transformer	PLANNED OUTAGE	12/29/2023 11:52	860.50	6
Transformer	PLANNED OUTAGE	12/29/2023 12:58	42.23	14
Transformer	PLANNED OUTAGE	12/29/2023 14:55	232.42	5
Service point	PLANNED OUTAGE	12/29/2023 18:01	27.22	1
Service point	PLANNED OUTAGE	12/29/2023 20:09	17.52	1
Service point	PLANNED OUTAGE	12/29/2023 20:31	35.90	1
Transformer Bank	PLANNED OUTAGE	12/30/2023 3:01	38.60	2
Breaker	PLANNED OUTAGE	12/30/2023 6:33	11,810.50	1817
Breaker	PLANNED OUTAGE	12/30/2023 6:33	6.50	1
Breaker	PLANNED OUTAGE	12/30/2023 6:33	6.50	1
Breaker	PLANNED OUTAGE	12/30/2023 6:33	6.50	1
Transformer	PLANNED OUTAGE	12/30/2023 7:27	158.32	7
Transformer	PLANNED OUTAGE	12/30/2023 8:03	46.37	2
Transformer	PLANNED OUTAGE	12/30/2023 8:35	198.33	10
Transformer	PLANNED OUTAGE	12/30/2023 21:56	103.13	4
Transformer	PLANNED OUTAGE	12/30/2023 23:31	2,021.80	11
PLF	PLANNED OUTAGE	12/31/2023 3:26	154.17	2
Transformer	PLANNED OUTAGE	12/31/2023 6:24	285.07	4
Transformer	PLANNED OUTAGE	12/31/2023 17:08	183.40	7
Transformer	PLANNED OUTAGE	12/31/2023 17:08	53.10	9
Transformer	PLANNED OUTAGE	12/31/2023 17:58	882.60	9
PLF	PLANNED OUTAGE	12/31/2023 20:49	3,365.67	10
Transformer	PLANNED OUTAGE	12/31/2023 23:51	211.80	12
			14,283,675.40	335,056

2023 Annual Reliability Performance Report

2023 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	1/13/23 8:54 AM	2,579.50	1155
Substation	FPSC Commission Rule 26-6.0455	1/24/23 6:27 PM	198,009.47	1202
Substation	FPSC Commission Rule 26-6.0455	1/24/23 6:27 PM	18,577.82	149
Substation	FPSC Commission Rule 26-6.0455	1/24/23 7:25 PM	192.60	6
Substation	FPSC Commission Rule 26-6.0455	1/29/23 2:26 PM	34,380.40	888
Substation	FPSC Commission Rule 26-6.0455	1/29/23 2:26 PM	47,369.70	1022
Substation	FPSC Commission Rule 26-6.0455	1/29/23 2:26 PM	12,440.00	622
Substation	FPSC Commission Rule 26-6.0455	1/29/23 2:26 PM	34,544.53	1064
Substation	FPSC Commission Rule 26-6.0455	1/30/23 11:11 AM	48,636.00	756
Substation	FPSC Commission Rule 26-6.0455	2/4/23 8:28 AM	532,753.33	1256
Substation	FPSC Commission Rule 26-6.0455	2/4/23 8:28 AM	25,804.35	143
Substation	FPSC Commission Rule 26-6.0455	2/4/23 8:28 AM	93,070.63	946
Substation	FPSC Commission Rule 26-6.0455	2/5/23 5:55 AM	120,377.50	1614
Substation	FPSC Commission Rule 26-6.0455	2/6/23 7:34 AM	28,273.07	1856
Substation	FPSC Commission Rule 26-6.0455	2/9/23 8:05 PM	74,973.70	753
Substation	FPSC Commission Rule 26-6.0455	2/9/23 8:05 PM	194,720.50	1885
Substation	FPSC Commission Rule 26-6.0455	2/16/23 9:24 AM	2,036.60	1797
Substation	FPSC Commission Rule 26-6.0455	2/16/23 9:24 AM	1,952.73	1723
Substation	FPSC Commission Rule 26-6.0455	2/16/23 9:24 AM	1,496.00	1320
Substation	FPSC Commission Rule 26-6.0455	2/16/23 9:24 AM	719.67	635
Substation	FPSC Commission Rule 26-6.0455	2/25/23 7:27 AM	1.40	1
Substation	FPSC Commission Rule 26-6.0455	2/25/23 7:27 AM	1.52	1
Substation	FPSC Commission Rule 26-6.0455	2/25/23 7:27 AM	1.68	1
Substation	FPSC Commission Rule 26-6.0455	2/25/23 7:27 AM	931.97	766
Substation	FPSC Commission Rule 26-6.0455	2/25/23 7:27 AM	1.60	1
Substation	FPSC Commission Rule 26-6.0455	3/3/23 6:55 PM	1,879.47	1762
Substation	FPSC Commission Rule 26-6.0455	3/6/23 6:21 PM	9,216.90	418
Substation	FPSC Commission Rule 26-6.0455	3/6/23 6:22 PM	2,611.70	123
Substation	FPSC Commission Rule 26-6.0455	3/6/23 6:23 PM	24,362.80	1243
Substation	FPSC Commission Rule 26-6.0455	3/10/23 8:38 AM	945.48	799
Substation	FPSC Commission Rule 26-6.0455	3/12/23 10:04 AM	1,706.55	367
Substation	FPSC Commission Rule 26-6.0455	3/12/23 10:04 AM	51.15	11
Substation	FPSC Commission Rule 26-6.0455	3/12/23 10:04 AM	2,793.43	463
Substation	FPSC Commission Rule 26-6.0455	3/12/23 10:04 AM	8,772.30	1083
Substation	FPSC Commission Rule 26-6.0455	3/12/23 10:04 AM	16.20	2
Substation	FPSC Commission Rule 26-6.0455	3/12/23 10:04 AM	98,548.20	1908
Substation	FPSC Commission Rule 26-6.0455	3/12/23 10:04 AM	1,807.75	35
Substation	FPSC Commission Rule 26-6.0455	4/3/23 11:12 AM	20,381.20	812
Substation	FPSC Commission Rule 26-6.0455	4/3/23 11:12 AM	37,677.02	1661
Substation	FPSC Commission Rule 26-6.0455	4/3/23 11:12 AM	3,136.50	123
Substation	FPSC Commission Rule 26-6.0455	4/23/23 4:39 AM	21,890.07	202
Substation	FPSC Commission Rule 26-6.0455	4/23/23 4:39 AM	414.27	4
Substation	FPSC Commission Rule 26-6.0455	4/23/23 4:39 AM	12,000.58	197
Substation	FPSC Commission Rule 26-6.0455	4/23/23 9:28 PM	159,876.77	1558
Substation	FPSC Commission Rule 26-6.0455	5/6/23 7:58 AM	53,874.00	730
Substation	FPSC Commission Rule 26-6.0455	5/6/23 8:00 AM	136,209.17	1975
Substation	FPSC Commission Rule 26-6.0455	5/6/23 8:06 AM	89,908.65	1269
Substation	FPSC Commission Rule 26-6.0455	5/8/23 11:02 PM	37,096.27	668
Substation	FPSC Commission Rule 26-6.0455	5/13/23 6:33 AM	65,551.57	803
Substation	FPSC Commission Rule 26-6.0455	5/13/23 6:33 AM	20,142.43	311
Substation	FPSC Commission Rule 26-6.0455	5/13/23 6:33 AM	40,677.00	630

2023 Annual Reliability Performance Report

2023 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	5/13/23 6:33 AM	25,841.90	402
Substation	FPSC Commission Rule 26-6.0455	5/13/23 6:33 AM	59,436.15	927
Substation	FPSC Commission Rule 26-6.0455	5/13/23 6:33 AM	7,417.50	115
Substation	FPSC Commission Rule 26-6.0455	5/13/23 6:33 AM	44,871.75	693
Substation	FPSC Commission Rule 26-6.0455	5/17/23 4:54 AM	3,285.07	2032
Substation	FPSC Commission Rule 26-6.0455	5/23/23 3:03 AM	1,042.13	977
Substation	FPSC Commission Rule 26-6.0455	5/26/23 9:29 AM	39,831.00	660
Substation	FPSC Commission Rule 26-6.0455	5/26/23 9:29 AM	123.63	2
Substation	FPSC Commission Rule 26-6.0455	5/31/23 5:17 AM	589.10	274
Substation	FPSC Commission Rule 26-6.0455	5/31/23 5:17 AM	83.85	39
Substation	FPSC Commission Rule 26-6.0455	5/31/23 5:17 AM	982.55	457
Substation	FPSC Commission Rule 26-6.0455	5/31/23 5:17 AM	92.45	43
Substation	FPSC Commission Rule 26-6.0455	6/1/23 8:53 AM	6,781.02	1841
Substation	FPSC Commission Rule 26-6.0455	6/1/23 8:53 AM	5,462.57	1142
Substation	FPSC Commission Rule 26-6.0455	6/1/23 8:53 AM	5,830.88	1219
Substation	FPSC Commission Rule 26-6.0455	6/1/23 8:53 AM	10.27	2
Substation	FPSC Commission Rule 26-6.0455	6/1/23 8:53 AM	200.20	39
Substation	FPSC Commission Rule 26-6.0455	6/1/23 8:53 AM	4,050.20	789
Substation	FPSC Commission Rule 26-6.0455	6/4/23 5:58 PM	4,378.00	1592
Substation	FPSC Commission Rule 26-6.0455	6/19/23 8:18 PM	155,456.72	1511
Substation	FPSC Commission Rule 26-6.0455	6/21/23 4:41 PM	101,480.87	1484
Substation	FPSC Commission Rule 26-6.0455	6/25/23 7:11 AM	35,084.00	1074
Substation	FPSC Commission Rule 26-6.0455	6/25/23 7:11 AM	14,092.17	658
Substation	FPSC Commission Rule 26-6.0455	6/25/23 7:11 AM	10,211.33	1445
Substation	FPSC Commission Rule 26-6.0455	7/1/23 6:49 AM	164,110.92	2345
Substation	FPSC Commission Rule 26-6.0455	7/1/23 6:49 AM	107,717.70	1413
Substation	FPSC Commission Rule 26-6.0455	7/10/23 7:57 AM	7,840.33	2735
Substation	FPSC Commission Rule 26-6.0455	7/10/23 7:57 AM	4,947.87	1726
Substation	FPSC Commission Rule 26-6.0455	7/10/23 7:57 AM	3,150.47	1099
Substation	FPSC Commission Rule 26-6.0455	7/10/23 8:39 PM	347.47	2
Substation	FPSC Commission Rule 26-6.0455	7/10/23 8:39 PM	2,327.15	763
Substation	FPSC Commission Rule 26-6.0455	7/10/23 8:39 PM	19,718.50	113
Substation	FPSC Commission Rule 26-6.0455	7/10/23 8:39 PM	71,159.18	409
Substation	FPSC Commission Rule 26-6.0455	7/10/23 8:42 PM	38,346.30	411
Substation	FPSC Commission Rule 26-6.0455	7/10/23 10:53 PM	40.27	1
Substation	FPSC Commission Rule 26-6.0455	7/12/23 7:43 PM	8,368.23	1387
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	14,195.60	276
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	771.50	15
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	102.87	2
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	94,133.40	1812
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	6,545.70	126
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	14,862.47	286
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	14,734.50	282
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	783.75	15
Substation	FPSC Commission Rule 26-6.0455	7/18/23 1:47 AM	24,662.00	649
Substation	FPSC Commission Rule 26-6.0455	7/18/23 2:02 AM	87,713.82	1859
Substation	FPSC Commission Rule 26-6.0455	7/18/23 6:07 PM	51,706.67	800
Substation	FPSC Commission Rule 26-6.0455	7/18/23 6:07 PM	107,692.20	1813
Substation	FPSC Commission Rule 26-6.0455	7/18/23 6:08 PM	23,921.08	1555
Substation	FPSC Commission Rule 26-6.0455	7/20/23 6:11 PM	30,957.33	1040
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	46,153.30	578

2023 Annual Reliability Performance Report

2023 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	4,152.20	52
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	4,072.35	51
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	73,811.02	919
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	15,717.00	234
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	59,778.33	890
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	6,448.00	96
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	5,524.35	117
Substation	FPSC Commission Rule 26-6.0455	7/26/23 6:22 PM	56,009.25	803
Substation	FPSC Commission Rule 26-6.0455	7/28/23 5:22 PM	30,168.57	802
Substation	FPSC Commission Rule 26-6.0455	7/28/23 5:22 PM	55,901.45	1353
Substation	FPSC Commission Rule 26-6.0455	7/28/23 5:22 PM	59,958.27	1132
Substation	FPSC Commission Rule 26-6.0455	7/28/23 5:22 PM	72,425.00	1500
Substation	FPSC Commission Rule 26-6.0455	8/2/23 8:21 AM	12,125.00	1875
Substation	FPSC Commission Rule 26-6.0455	8/2/23 3:24 PM	89,336.00	1718
Substation	FPSC Commission Rule 26-6.0455	8/10/23 1:29 PM	54.00	18
Substation	FPSC Commission Rule 26-6.0455	8/10/23 1:29 PM	774.00	258
Substation	FPSC Commission Rule 26-6.0455	8/11/23 12:38 PM	8,517.67	1265
Substation	FPSC Commission Rule 26-6.0455	8/11/23 12:38 PM	21,509.58	1235
Substation	FPSC Commission Rule 26-6.0455	8/11/23 12:38 PM	29,346.45	1471
Substation	FPSC Commission Rule 26-6.0455	8/11/23 12:42 PM	73.37	2
Substation	FPSC Commission Rule 26-6.0455	8/11/23 12:42 PM	12,949.22	353
Substation	FPSC Commission Rule 26-6.0455	8/11/23 12:42 PM	19,854.20	444
Substation	FPSC Commission Rule 26-6.0455	8/11/23 12:42 PM	18,549.03	599
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	169,804.72	1981
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	124,637.05	1263
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	63,792.70	723
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	142,649.10	1601
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	143,712.20	2242
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	25,319.55	369
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	3,352.40	58
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	74,344.33	1084
Substation	FPSC Commission Rule 26-6.0455	8/20/23 8:41 AM	31,885.20	612
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	10.22	1
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	5,359.17	545
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	10.22	1
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	40.87	4
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	15,498.68	1517
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	38,553.00	852
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	10.22	1
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	5,508.75	325
Substation	FPSC Commission Rule 26-6.0455	9/14/23 11:37 AM	10.22	1
Substation	FPSC Commission Rule 26-6.0455	9/18/23 1:25 PM	8,774.50	763
Substation	FPSC Commission Rule 26-6.0455	9/18/23 1:25 PM	1,314.13	112
Substation	FPSC Commission Rule 26-6.0455	9/18/23 1:25 PM	4,512.00	423.00
Substation	FPSC Commission Rule 26-6.0455	9/20/23 3:55 PM	16,545.67	245
Substation	FPSC Commission Rule 26-6.0455	9/20/23 4:08 PM	22,220.27	1,366
Substation	FPSC Commission Rule 26-6.0455	9/21/23 12:47 PM	26.87	1
Substation	FPSC Commission Rule 26-6.0455	9/21/23 12:47 PM	9,113.75	575
Substation	FPSC Commission Rule 26-6.0455	9/21/23 12:47 PM	18,584.75	1,185
Substation	FPSC Commission Rule 26-6.0455	9/21/23 12:47 PM	16.00	1
Substation	FPSC Commission Rule 26-6.0455	9/21/23 12:47 PM	28,672.00	1,792

2023 Annual Reliability Performance Report

2023 Adjustments: Substation Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	9/21/23 12:47 PM	4,670.40	288
Substation	FPSC Commission Rule 26-6.0455	9/22/23 11:26 AM	20,426.70	426
Substation	FPSC Commission Rule 26-6.0455	9/22/23 11:26 AM	28,290.93	766.00
Substation	FPSC Commission Rule 26-6.0455	9/22/23 11:26 AM	3,193.90	114
Substation	FPSC Commission Rule 26-6.0455	9/24/23 2:36 PM	5,418.80	1311
Substation	FPSC Commission Rule 26-6.0455	9/24/23 2:36 PM	98,618.50	1770
Substation	FPSC Commission Rule 26-6.0455	10/22/23 8:18 AM	1,188.00	792
Substation	FPSC Commission Rule 26-6.0455	10/23/23 9:36 PM	107.40	12
Substation	FPSC Commission Rule 26-6.0455	10/23/23 9:36 PM	41,297.92	1075
Substation	FPSC Commission Rule 26-6.0455	10/23/23 9:36 PM	1,992.33	215
Substation	FPSC Commission Rule 26-6.0455	10/26/23 8:42 AM	128,087.33	1832
Substation	FPSC Commission Rule 26-6.0455	10/26/23 8:42 AM	70.23	1
Substation	FPSC Commission Rule 26-6.0455	10/26/23 8:42 AM	70.37	1
Substation	FPSC Commission Rule 26-6.0455	10/26/23 8:42 AM	69.47	1
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	1,339.07	913
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	1,179.20	804
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	168.67	115
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	934.27	637
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	1,182.13	806
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	1,479.87	1009
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	174.53	119
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	1.42	1
Substation	FPSC Commission Rule 26-6.0455	11/2/23 6:45 AM	1.42	1
Substation	FPSC Commission Rule 26-6.0455	11/4/23 12:06 AM	2,589.30	1233
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:53 AM	3,797.50	50
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:53 AM	25.22	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:53 AM	26,250.55	1041
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:53 AM	90,306.20	1194
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:53 AM	13,753.47	1691
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:53 AM	1,659.20	204
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:53 AM	788.93	97
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:53 AM	8.13	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	73.98	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	73.97	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	73.93	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	77.62	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	73.80	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	96,502.10	1238
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	77.37	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	77.50	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	77.75	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	78.07	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	77.83	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	78.23	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	467.70	6
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	73.73	1
Substation	FPSC Commission Rule 26-6.0455	12/23/23 11:55 AM	73.68	1
			5,987,470.98	140,256

2023 Annual Reliability Performance Report

2023 Adjustments: Transmission Outage Events

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	4/24/2023 16:18	1,104.80	12
Transmission	FPSC Commission Rule 26-6.0455	4/24/2023 16:18	21,727.73	236
Transmission	FPSC Commission Rule 26-6.0455	5/6/2023 2:51	7,025.03	146
Transmission	FPSC Commission Rule 26-6.0455	5/6/2023 2:51	40,267.97	434
Transmission	FPSC Commission Rule 26-6.0455	5/6/2023 2:51	22,559.73	248
Transmission	FPSC Commission Rule 26-6.0455	5/6/2023 2:56	2,256.15	39
Transmission	FPSC Commission Rule 26-6.0455	5/6/2023 2:56	2,870.25	43
Transmission	FPSC Commission Rule 26-6.0455	5/6/2023 3:32	11,486.20	276
Transmission	FPSC Commission Rule 26-6.0455	6/4/2023 18:02	3,643.58	115
Transmission	FPSC Commission Rule 26-6.0455	6/4/2023 18:02	34,175.70	762
Transmission	FPSC Commission Rule 26-6.0455	6/4/2023 18:51	12,442.08	325
Transmission	FPSC Commission Rule 26-6.0455	6/4/2023 18:51	14,553.22	373
			174,112.45	3,009

Feeder Specific Report



Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13001	South Hillsborough	N/A	12.42	837	38442.6	1008	N/A	5.18	680	0	0	0
13002	South Hillsborough	N/A	0.26	18	0	0	N/A	0.83	11	0	0	0
13003	South Hillsborough	N/A	23.65	592	5846.15	103	N/A	2.52	206	0	0	0
13004	Dade City	N/A	10.03	518	18233.12	126	N/A	14.67	917	0	0	0
13005	Dade City	N/A	6.31	254	8367.317	279	N/A	2.7	448	0	0	0
13006	Dade City	N/A	21.65	808	253457.7	3691	N/A	12.49	902	38414.47	124	0
13007	Plant City	N/A	29.35	481	52898.63	471	N/A	4.05	75	0	0	0
13008	Plant City	N/A	17.53	424	42082.7	214	N/A	1.6	18	0	0	0
13009	Plant City	N/A	3.01	72	10017.68	108	N/A	0.99	45	68.117	1	0
13010	Plant City	N/A	7.27	473	253375.8	3193	N/A	15.02	1264	5025.95	21	0
13011	Plant City	N/A	27.83	1563	57018.38	1147	N/A	1.09	94	154.217	2	0
13012	Western	N/A	0.45	58	117.15	3	N/A	0.11	11	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	4.34	0.1	0	0	0	4.24	127	0	0	12.46%	7.76
0	Yes	3.29	2.6	0	0	0	0.69	1	0	0	10.39%	5.63
0	Yes	7.86	0.03	0	0	0	7.83	104	1737.4	876	10.26%	4.3
0	Yes	4.25	0	0	0	0	4.25	108	0	0	12.82%	8.01
0	Yes	1.67	0.28	0	0	0	1.39	35	0	0	8.33%	3.9
0	Yes	6.09	0.16	0	0	0	5.93	97	97575.7	1163	1.67%	7.32
0	Yes	3.57	0.25	0	0	0	3.32	33	65602.15	2279	-2.71%	6.81
0	Yes	0.89	0.01	0	0	0	0.88	2	36529.2	861	9.58%	2.63
0	Yes	2.26	0.09	0	0	0	2.17	32	0	0	10.33%	3.31
0	Yes	5.51	0.89	0	0	0	4.62	104	109187.6	1840	6.62%	7.57
0	Yes	6.14	0.43	0	0	0	5.71	76	93930.93	5014	10.88%	7.54
0	Yes	0.56	0.09	0	0	0	0.47	22	0	0	-8.89%	0.82

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13013	Western	N/A	0.17	15	79.167	5	N/A	1.4	191	0	0	0
13016	Western	N/A	0.74	164	5055.767	68	N/A	0.52	104	7345.983	11	0
13017	South Hillsborough	N/A	8.47	363	23159.83	244	N/A	9.75	1161	20839.68	71	0
13019	South Hillsborough	N/A	11.21	679	584.733	7	N/A	9.76	903	0	0	0
13020	South Hillsborough	N/A	17.66	1299	69815.75	931	N/A	15.49	1316	6049.533	60	0
13021	Central	N/A	2.01	165	1472.083	36	N/A	6.15	1115	0	0	0
13022	Central	N/A	3.28	467	0	0	N/A	0.7	324	0	0	0
13023	Central	N/A	8.34	1012	29556.23	308	N/A	2.04	399	0	0	0
13024	Central	N/A	7.52	855	48052.45	224	N/A	1.22	183	0	0	0
13026	Central	N/A	1.89	213	87901.47	1898	N/A	6.78	1656	2315.8	19	0
13027	Central	N/A	9.08	698	128397.7	1479	N/A	2.11	423	6401.467	39	0
13028	Central	N/A	5.41	600	49301.83	775	N/A	4.58	1470	0	0	0
13029	Central	N/A	5.95	517	4925.1	52	N/A	3.31	674	0	0	0
13030	Winter Haven	N/A	28.5	834	46972.9	1442	N/A	14.55	1007	14837.85	123	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.51	0.82	0	0	0	0.69	84	0	0	-16.76%	2.83
0	Yes	1.56	0.68	0	0	0	0.88	31	0	0	2.82%	4.01
0	Yes	2.63	0.67	10	0	0	1.96	35	0	0	5.83%	6.35
0	Yes	4.47	1.17	3	0	0	3.3	29	0	0	13.21%	9.51
0	Yes	6.98	1.07	24	0	0	5.91	182	0	0	6.60%	11.3
0	Yes	3.41	0.39	0	0	0	3.02	80	0	0	-6.20%	6.05
0	Yes	0.93	0.11	0	0	0	0.82	16	0	0	6.78%	2.52
0	Yes	2.43	0.1	0	0	0	2.33	88	0	0	1.11%	6.37
0	Yes	1.89	0.12	0	0	0	1.77	95	141566	4648	5.97%	4.79
0	Yes	1.34	0.04	0	0	0	1.3	76	0	0	7.13%	6.01
0	Yes	1.2	0.46	0	0	0	0.74	36	39312.38	2301	5.22%	5.04
0	Yes	1.8	0.23	0	0	0	1.57	29	0	0	0.32%	6.32
0	Yes	1.22	0.29	0	0	0	0.93	33	0	0	8.16%	5.3
0	Yes	5.55	0.3	0	0	0	5.25	73	0	0	2.35%	8.7

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13031	Winter Haven	N/A	10.71	477	143164.1	1643	N/A	8.47	572	89.783	1	0
13034	Central	N/A	10.11	1328	1805.25	22	N/A	0.73	167	0	0	0
13035	Central	N/A	4.96	494	14869.25	138	N/A	0.73	94	0	0	0
13036	Central	N/A	8.85	971	2150.333	12	N/A	1.41	273	0	0	0
13037	Central	N/A	5.49	595	4046.283	64	N/A	1.66	338	0	0	0
13038	Eastern	N/A	6.37	372	9571.4	112	N/A	5.46	249	0	0	0
13039	Eastern	N/A	7.29	475	9369.483	91	N/A	8.5	746	0	0	0
13040	Eastern	N/A	0.34	7	14390.83	159	N/A	13.26	1068	34477.03	247	0
13041	Eastern	N/A	5.41	317	67791.27	942	N/A	14.75	1023	26470.93	155	0
13042	Central	N/A	8.34	1179	23289.58	704	N/A	0.24	119	0	0	0
13043	Central	N/A	12.51	1825	71315	685	N/A	1.29	484	2347.35	3	0
13044	Central	N/A	11.16	1642	43403.48	721	N/A	0.38	14	3.417	1	0
13045	Central	N/A	6.88	1004	6540.483	188	N/A	0.1	18	0	0	0
13046	Central	N/A	8.08	1194	11829.77	96	N/A	0.11	5	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	6.86	0	0	0	0	6.86	106	7743.167	1901	23.14%	4.31
0	Yes	1.85	0.03	0	0	0	1.82	110	0	0	5.17%	5.49
0	Yes	2.27	0.02	0	0	0	2.25	81	0	0	3.00%	5.15
0	Yes	3.91	1.53	0	0	0	2.38	124	113133.1	1371	-4.19%	5.95
0	Yes	2.9	0.08	0	0	0	2.82	172	0	0	-2.38%	4.92
0	Yes	2.21	0.1	0	0	0	2.11	68	0	0	1.36%	4.46
0	Yes	3.07	0.07	0	0	0	3	56	10228.53	1268	6.82%	7.05
0	Yes	2.58	1.9	0	0	0	0.68	3	0	0	-0.70%	5.66
0	Yes	4.82	0.16	0	0	0	4.66	108	55574.87	1982	7.33%	8.05
0	Yes	2.52	0.06	0	0	0	2.46	167	0	0	-17.55%	4.37
0	Yes	2.04	0.05	0	0	0	1.99	133	0	0	2.21%	8.78
0	Yes	2.05	0.18	0	0	0	1.87	138	76943.7	1819	1.89%	8.07
0	Yes	1.96	0.1	0	0	0	1.86	178	0	0	5.76%	4.96
0	Yes	2.99	0	0	0	0	2.99	255	0	0	-0.78%	5.1

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13047	Central	N/A	3.61	609	49474.32	338	N/A	0.27	167	46.517	1	0
13048	Central	N/A	8.17	1240	2495.35	17	N/A	0.79	55	0	0	0
13049	Central	N/A	5.87	690	73926.03	1465	N/A	2.11	499	3046.5	54	0
13050	Central	N/A	0.05	0	0	0	N/A	0.82	24	0	0	0
13051	Central	N/A	1.41	83	4570.117	60	N/A	4.47	959	0	0	0
13052	Central	N/A	0.64	40	153.633	2	N/A	0.63	144	0	0	0
13053	Central	N/A	9.04	1242	21097.6	188	N/A	2.26	312	0	0	0
13054	Central	N/A	0.12	0	0	0	N/A	1.17	440	216.5	1	0
13055	Central	N/A	0.12	0	253.267	2	N/A	0.38	25	191.317	1	0
13057	Central	N/A	0.18	4	0	0	N/A	1.04	177	38292.42	166	0
13059	Western	N/A	6.58	735	1537.65	27	N/A	0.76	142	0	0	0
13060	Western	N/A	4.72	795	80777.87	901	N/A	1.93	571	2615.8	12	0
13061	Western	N/A	3.52	447	13567.5	128	N/A	0.5	32	0	0	0
13062	Western	N/A	4.76	591	1760.55	36	N/A	0.15	15	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.4	0.07	0	0	0	1.33	97	0	0	4.44%	3.06
0	Yes	2.64	0.13	0	0	0	2.51	203	0	0	4.71%	6.22
0	Yes	1.63	0.05	0	0	0	1.58	128	0	0	-0.43%	4.6
0	Yes	1.98	1.54	3	0	0	0.44	2	0	0	5.96%	5.69
0	Yes	2.02	0.17	0	0	0	1.85	50	254196.4	1086	-3.20%	4.54
0	Yes	1.77	0.09	0	0	0	1.68	12	0	0	-4.91%	7.16
0	Yes	2.55	0.13	0	0	0	2.42	158	0	0	5.06%	6.64
0	Yes	1.56	0.54	0	0	0	1.02	7	0	0	4.10%	2.03
0	Yes	3.42	1.49	1	0	0	1.93	5	8947.05	98	11.34%	3.24
0	Yes	1.53	0.15	2	0	0	1.38	8	19243.47	193	-19.44%	5.72
0	Yes	1.86	0.08	0	0	0	1.78	168	0	0	2.16%	5.21
0	Yes	1.9	0	0	0	0	1.9	131	0	0	3.22%	6.09
0	Yes	2.19	0	0	0	0	2.19	189	42087.17	670	12.41%	3.26
0	Yes	1.91	0	0	0	0	1.91	122	0	0	-0.74%	2.68

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13063	Western	N/A	5.43	706	9862.067	49	N/A	8.37	1700	2363.4	202	0
13064	Western	N/A	8.84	1013	326552.8	1332	N/A	4.71	810	0	0	0
13065	Western	N/A	8.65	1062	27157.25	800	N/A	2.21	471	0	0	0
13066	Western	N/A	2.95	455	6807.217	50	N/A	0	0	0	0	0
13067	Western	N/A	5.36	689	3000.533	29	N/A	0.42	14	443.1	1	0
13068	Western	N/A	5.56	850	4848.867	31	N/A	1.46	333	6334.267	52	0
13069	Western	N/A	3.87	533	13793.8	141	N/A	1.14	408	41.1	1	0
13070	Western	N/A	13.32	381	23238.13	251	N/A	5.85	196	0	0	0
13071	Western	N/A	4.59	127	13921.5	163	N/A	27.88	1347	3534.8	24	0
13072	Western	N/A	6.44	700	11042.17	75	N/A	0.47	44	0	0	0
13073	Western	N/A	3.44	481	1897.533	21	N/A	7.24	352	23767.37	133	0
13076	Western	N/A	2.14	101	14184.27	176	N/A	1.6	124	9.383	1	0
13077	Western	N/A	7.84	654	48372.57	385	N/A	1.85	58	0	0	0
13078	Western	N/A	7.11	1030	9905.983	54	N/A	1	123	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.12	0	0	0	0	3.12	167	0	0	7.61%	7.64
0	Yes	2.07	0.02	0	0	0	2.05	166	12148.8	1974	0.71%	8.46
0	Yes	0.91	0	0	0	0	0.91	83	38238.98	3191	0.33%	6.12
0	Yes	0.59	0.05	0	0	0	0.54	76	0	0	0.45%	2.21
0	Yes	1.54	0.37	0	0	0	1.17	63	0	0	20.67%	7.24
0	Yes	1.28	0.03	0	0	0	1.25	63	0	0	6.00%	5.3
0	Yes	2.13	0.05	0	0	0	2.08	151	0	0	0.36%	5.52
0	Yes	3.37	0.32	0	0	0	3.05	23	112634.4	599	1.03%	3.94
0	Yes	3.09	0.84	0	0	0	2.25	25	0	0	4.61%	9.31
0	Yes	0.52	0.16	0	0	0	0.36	33	0	0	11.22%	5.45
0	Yes	2	0.16	1	0	0	1.84	82	0	0	-12.58%	5.77
0	Yes	1.61	0	0	0	0	1.61	38	0	0	-8.55%	5.03
0	Yes	3.21	0.16	0	0	0	3.05	147	73221.2	1714	8.24%	7.36
0	Yes	1.06	0.06	0	0	0	1	14	0	0	0.96%	5.25

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13079	Western	N/A	4.19	529	16206.13	130	N/A	3.29	783	12343.23	43	0
13080	Western	N/A	7.89	1116	12556.15	90	N/A	1.35	551	0	0	0
13081	Western	N/A	2.9	453	20083.6	242	N/A	1.53	600	0	0	0
13082	Western	N/A	6.38	800	20810.3	200	N/A	1	311	0	0	0
13084	Eastern	N/A	3.93	170	19363.93	148	N/A	2.03	88	4361.8	12	0
13085	Eastern	N/A	2.44	61	5487.933	46	N/A	0.41	8	0	0	0
13086	Eastern	N/A	3.3	274	1236.833	8	N/A	1.04	13	0	0	0
13087	Eastern	N/A	4.24	358	11674.35	76	N/A	2.59	324	0	0	0
13088	Central	N/A	3.5	412	17887.97	168	N/A	1.63	339	1724.5	3	0
13089	Central	N/A	7.21	860	10423.27	168	N/A	1.16	357	0	0	0
13090	Central	N/A	4.65	640	39423.47	285	N/A	1.5	350	0	0	0
13091	Central	N/A	6.13	1183	10133.48	75	N/A	0.09	25	0	0	0
13092	Central	N/A	5.49	650	19062.98	282	N/A	0.36	54	0	0	0
13093	Central	N/A	3.95	802	16738.23	153	N/A	1.57	153	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.39	0.13	0	0	0	2.26	128	0	0	1.15%	6.17
0	Yes	2.35	0.16	0	0	0	2.19	126	0	0	6.22%	7.86
0	Yes	0.94	0.24	0	0	0	0.7	52	0	0	5.93%	5.72
0	Yes	0.44	0.07	0	0	0	0.37	23	0	0	6.55%	6.18
0	Yes	2.48	0.24	0	0	0	2.24	38	13104.93	266	47.14%	5.15
0	Yes	1.25	0.37	0	0	0	0.88	8	0	0	13.57%	3.18
0	Yes	3.4	0.37	0	0	0	3.03	47	26114.92	341	5.19%	5.47
0	Yes	2.79	0.4	0	0	0	2.39	114	160522.9	797	0.35%	5.72
0	Yes	1.16	0.04	0	0	0	1.12	61	0	0	7.39%	2.76
0	Yes	1.31	0.96	0	0	0	0.35	20	0	0	2.72%	5.29
0	Yes	2.52	0.4	0	0	0	2.12	80	0	0	4.55%	5.28
0	Yes	2.75	0.24	0	0	0	2.51	182	248189.8	6039	4.44%	6.59
0	Yes	1.35	0.19	0	0	0	1.16	128	0	0	5.70%	3.34
0	Yes	1.35	0.21	0	0	0	1.14	114	11288.67	1180	4.01%	4.15

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13094	Central	N/A	6.2	796	45117.57	387	N/A	2.48	474	855.867	17	0
13095	Central	N/A	3.79	323	124.267	1	N/A	0.33	30	0	0	0
13096	Central	N/A	19.73	698	171957.1	911	N/A	11.6	524	727.1	3	0
13097	Central	N/A	14.41	596	43554.77	1113	N/A	24.88	786	13197.23	81	0
13098	Central	N/A	10.1	558	17802.6	110	N/A	10.75	601	0	0	0
13099	Central	N/A	8.72	321	414556.6	3664	N/A	25.92	910	20187.58	184	0
13100	Central	N/A	5.71	502	14406.65	63	N/A	1.17	82	0	0	0
13101	Central	N/A	2.31	319	4677.217	41	N/A	0.74	191	0	0	0
13102	Central	N/A	5.31	808	38716.2	271	N/A	1.8	76	0	0	0
13103	Central	N/A	3.39	613	9288.533	49	N/A	0.34	16	0	0	0
13104	Central	N/A	3.76	433	150012.4	377	N/A	4.88	494	0	0	0
13105	Central	N/A	6.31	597	38408.6	516	N/A	3.57	500	0	0	0
13106	Central	N/A	3.43	454	22654.88	251	N/A	6.02	2177	4940.45	41	0
13107	Central	N/A	3.12	447	11500.78	81	N/A	6.75	1031	15059.97	71	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.85	1.13	0	0	0	2.72	145	2295	68	8.20%	9.24
0	Yes	2.64	0.94	0	0	0	1.7	45	0	0	0.00%	0
0	Yes	3.38	0.1	0	0	0	3.28	83	0	0	2.72%	7.93
0	Yes	6.75	2.1	0	0	0	4.65	95	0	0	19.58%	8.55
0	Yes	4.52	0.07	0	0	0	4.45	110	0	0	-10.34%	6.85
0	Yes	6.24	0.07	0	0	0	6.17	53	26669.32	809	17.79%	8.54
0	Yes	2.42	0	0	0	0	2.42	109	0	0	-34.93%	3.93
0	Yes	2.14	0	0	0	0	2.14	165	1674.067	1348	-2.01%	3.41
0	Yes	3.83	0.13	0	0	0	3.7	247	0	0	3.17%	4.56
0	Yes	1.89	0.16	0	0	0	1.73	167	175639.8	798	-6.23%	3.46
0	Yes	2.15	0.14	0	0	0	2.01	85	0	0	-1.98%	5.45
0	Yes	1.62	0	0	0	0	1.62	48	67257.95	1139	-2.07%	6.16
0	Yes	1.26	0.08	0	0	0	1.18	72	0	0	3.11%	6.3
0	Yes	3.3	0.15	0	0	0	3.15	154	21916.53	1652	1.73%	7.05

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Sectionalizing Devices on the Lateral
13109	Western	N/A	3.8	752	113036.2	453	N/A	4.5	1851	7935.883	363	0
13110	Western	N/A	0.96	41	364.5	1	N/A	3.17	373	0	0	0
13111	Western	N/A	3.4	530	12797.72	187	N/A	1.43	326	219.933	3	0
13112	Western	N/A	11.51	1303	13019.62	135	N/A	7.85	1388	1402.683	8	0
13113	Western	N/A	3.21	409	4966.85	50	N/A	1.7	289	0	0	0
13114	Western	N/A	3.3	304	12663	187	N/A	10.39	3396	6584.733	88	0
13115	Winter Haven	N/A	6.55	491	2154.5	55	N/A	2.82	210	4382.083	23	0
13117	Winter Haven	N/A	11.85	723	4106.733	30	N/A	29.67	1148	1019.483	3	0
13118	Winter Haven	N/A	9.65	748	1567.533	23	N/A	25.89	1834	358.8	18	0
13119	Plant City	N/A	1.61	30	0	0	N/A	2.14	631	0	0	0
13120	Plant City	N/A	2.5	61	13317.95	79	N/A	10.97	960	6157.75	71	0
13121	Plant City	N/A	3.33	92	24182.33	200	N/A	7.35	702	0	0	0
13122	Plant City	N/A	4	361	4348.717	27	N/A	1.06	71	101.133	1	0
13123	Plant City	N/A	7.55	733	5237.317	66	N/A	1.64	277	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.75	1.3	0	0	0	1.45	117	0	0	16.67%	6.3
0	Yes	2.15	0.31	0	0	0	1.84	25	0	0	-4.80%	4.76
0	Yes	1.97	0.45	0	0	0	1.52	47	3491.817	879	3.26%	4.75
0	Yes	4.83	0.21	0	0	0	4.62	264	0	0	13.37%	9.75
0	Yes	1.05	0.17	0	0	0	0.88	39	0	0	-44.41%	1.89
0	Yes	3.43	1.47	0	0	0	1.96	99	0	0	9.22%	9.83
0	Yes	2.23	0.07	0	0	0	2.16	63	0	0	-9.23%	4.72
0	Yes	5.55	1.15	0	0	0	4.4	89	20860.45	2613	5.42%	7.59
0	Yes	9.06	1.1	0	0	0	7.96	149	61752	664	-18.26%	9.89
0	Yes	2.28	0.09	0	0	0	2.19	18	0	0	-16.53%	6.01
0	Yes	3.17	1	0	0	0	2.17	26	69499.87	1048	5.81%	6.56
0	Yes	3.11	0.31	0	0	0	2.8	64	20263.08	858	-9.64%	7.59
0	Yes	1.43	0.09	0	0	0	1.34	52	51050.2	1420	-7.55%	4.9
0	Yes	2.98	0.03	0	0	0	2.95	131	69141.95	1137	1.60%	5.08

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13124	Plant City	N/A	6.85	344	10744.18	90	N/A	3.57	182	0	0	0
13125	Plant City	N/A	4	433	2651.933	17	N/A	3.54	368	0	0	0
13126	Plant City	N/A	17.36	481	46239.43	741	N/A	3.37	292	5914.167	38	0
13127	Eastern	N/A	5.41	273	11526.67	153	N/A	20.32	1455	17637.12	155	0
13128	Eastern	N/A	9.28	582	119481.8	1144	N/A	7.92	619	755.983	1	0
13129	Eastern	N/A	2.86	252	8135.733	79	N/A	5.5	422	1140.283	31	0
13130	Eastern	N/A	5.83	358	40013.6	276	N/A	4.55	513	7498.45	69	0
13132	Eastern	N/A	1.63	38	1155.917	11	N/A	1.84	118	64.933	4	0
13133	Eastern	N/A	13.52	1377	268796.3	2055	N/A	4.62	1066	26707.3	43	0
13134	Eastern	N/A	2.15	173	2451.633	18	N/A	2.63	216	0	0	0
13136	Western	N/A	4.39	494	24113.72	292	N/A	0.35	8	0	0	0
13137	Western	N/A	0.97	170	0	0	N/A	1.17	547	0	0	0
13138	Western	N/A	2.95	452	3829.483	42	N/A	3.93	803	1511.133	8	0
13139	Western	N/A	5.84	550	29882.87	318	N/A	3.38	925	15273.98	161	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.67	0.03	0	0	0	3.64	112	25530.37	626	-11.48%	4.78
0	Yes	3.59	1.1	0	0	0	2.49	128	2848.9	919	-22.53%	6.74
0	Yes	6.69	0.61	0	0	0	6.08	35	66828.97	1389	58.48%	5.23
0	Yes	4.09	0	0	0	0	4.09	115	0	0	2.99%	8.96
0	Yes	3.37	0.03	0	0	0	3.34	103	138699.9	2144	2.88%	6.07
0	Yes	2.01	0.13	0	0	0	1.88	49	0	0	12.20%	4.6
0	Yes	3.57	0.04	0	0	0	3.53	138	0	0	-30.00%	5.11
0	Yes	1.01	0.13	0	0	0	0.88	18	0	0	13.81%	2.39
0	Yes	2.8	0	0	0	0	2.8	62	38027.27	2401	7.31%	8.37
0	Yes	1.19	0.12	0	0	0	1.07	53	0	0	12.78%	2.03
0	Yes	1.43	0.08	0	0	0	1.35	27	0	0	1.43%	2.84
0	Yes	1.38	0.16	0	0	0	1.22	99	0	0	-28.21%	2.8
0	Yes	1.43	0.13	0	0	0	1.3	38	0	0	-8.37%	4.49
0	Yes	1.7	0.04	0	0	0	1.66	65	0	0	0.40%	7.53

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Sectionalizing Devices on the Lateral
13140	Western	N/A	3.22	435	22468.82	345	N/A	1.51	898	0	0	0
13141	Western	N/A	2.49	500	13136.38	176	N/A	1.03	501	0	0	0
13142	Western	N/A	2.59	593	18769.7	253	N/A	1.96	1188	0	0	0
13143	Western	N/A	7.74	1224	47551.77	376	N/A	0.65	157	625.667	10	0
13146	Plant City	N/A	27.85	648	13308.43	109	N/A	3.39	83	397.517	3	0
13147	Plant City	N/A	31.44	1126	51993.57	606	N/A	9.23	559	3071.367	10	0
13148	Plant City	N/A	29.45	651	6206.8	45	N/A	1.44	53	0	0	0
13150	Winter Haven	N/A	4.36	371	1144.183	31	N/A	6.24	229	333.567	2	0
13151	Winter Haven	N/A	1.76	39	10965.93	39	N/A	12.14	1072	11726.65	42	0
13152	Winter Haven	N/A	3.43	324	1157.517	48	N/A	8.76	606	32019.05	160	0
13153	Winter Haven	N/A	7.29	706	112759.4	635	N/A	4.4	345	0	0	0
13154	Western	N/A	3.6	395	911.05	4	N/A	8.58	1483	0	0	0
13155	Western	N/A	3.81	391	5206.25	32	N/A	12.18	1292	11658.98	84	0
13156	Western	N/A	2.22	212	38877.52	321	N/A	3.91	950	10051.53	34	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.6	0.25	0	0	0	0.35	37	108329.7	2715	12.05%	4.93
0	Yes	1.45	0.38	0	0	0	1.07	141	0	0	69.66%	9.84
0	Yes	1.11	0.28	0	0	0	0.83	71	0	0	6.04%	5.62
0	Yes	3.4	1.33	24	0	0	2.07	182	0	0	4.05%	8.22
0	Yes	9.89	0.4	0	0	0	9.49	72	46068	792	6.86%	3.74
0	Yes	6.09	0.02	0	0	0	6.07	68	472973.3	6883	2.34%	7.88
0	Yes	6.04	0.07	0	0	0	5.97	66	0	0	-2.43%	3.61
0	Yes	3.49	0.37	0	0	0	3.12	91	0	0	3.00%	8.24
0	Yes	3.57	0.05	0	0	0	3.52	23	0	0	5.89%	5.93
0	Yes	3.1	0.13	0	0	0	2.97	144	64255	1065	1.80%	6.21
0	Yes	1.4	0.04	0	0	0	1.36	46	34371.2	1104	7.91%	4.64
0	Yes	1.35	0	0	0	0	1.35	87	173787.4	4038	3.52%	7.35
0	Yes	3.05	1.04	0	0	0	2.01	59	17556.2	1750	-1.39%	7.1
0	Yes	2.14	0.07	0	0	0	2.07	66	115453.6	1042	10.00%	5.17

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13157	Western	N/A	0.87	65	0	0	N/A	10.34	573	18540.43	152	0
13158	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13159	Central	N/A	11.68	1344	66638.67	571	N/A	2.1	317	0	0	0
13160	Central	N/A	4.95	556	3715.783	37	N/A	2.04	390	0	0	0
13161	Western	N/A	3.49	439	4358.65	97	N/A	0.19	58	0	0	0
13162	Western	N/A	5.76	575	4186.8	44	N/A	1.47	270	766.817	18	0
13163	Western	N/A	5.65	837	30502.82	262	N/A	0.59	138	0	0	0
13164	Western	N/A	5.82	777	131997.9	2115	N/A	0.9	51	1277.65	33	0
13165	Western	N/A	1.81	274	433.767	14	N/A	0.35	54	0	0	0
13166	Western	N/A	3.24	762	3675.383	56	N/A	1.16	538	165	1	0
13167	Western	N/A	7.73	1328	39940.8	373	N/A	0.88	428	163.15	3	0
13169	Eastern	N/A	0.79	4	287.317	1	N/A	10.43	1370	347.267	1	0
13170	Eastern	N/A	0.29	1	544.717	30	N/A	16.85	2126	4311.4	31	0
13171	Eastern	N/A	9.04	619	32508.25	645	N/A	12.07	1127	320.617	1	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.22	0.34	0	0	0	0.88	72	0	0	-3.61%	3.47
0	Yes	0.86	0.86	0	0	0	0	0	43.9	1	-42.25%	2.98
0	Yes	2.22	0.09	0	0	0	2.13	150	0	0	-2.59%	7.51
0	Yes	0.81	0.06	0	0	0	0.75	29	0	0	-45.02%	3.09
0	Yes	0.51	0.06	0	0	0	0.45	56	0	0	9.60%	2.74
0	Yes	1.39	0.02	0	0	0	1.37	142	0	0	-0.41%	7.27
0	Yes	1.58	0.08	0	0	0	1.5	188	15694	1140	4.41%	7.1
0	Yes	1.77	0.36	0	0	0	1.41	30	0	0	3.51%	5.9
0	Yes	0.48	0.3	0	0	0	0.18	2	0	0	12.19%	3.59
0	Yes	3.81	0.81	0	0	0	3	221	0	0	2.53%	7.69
0	Yes	1.47	0.04	0	0	0	1.43	130	0	0	-3.78%	7.89
0	Yes	3.65	1.65	0	0	0	2	18	79390.95	1383	-0.13%	7.49
0	Yes	4.89	1.96	0	0	0	2.93	11	0	0	8.15%	9.95
0	Yes	4.1	0.15	0	0	0	3.95	79	0	0	2.92%	9.16

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13172	Eastern	N/A	6.65	392	424736.2	1422	N/A	3.87	273	0	0	0
13173	Eastern	N/A	3.27	469	8004.367	131	N/A	15.12	2157	26330.43	82	0
13174	Eastern	N/A	1.4	7	217.233	2	N/A	13.17	3051	37802.05	411	0
13175	Central	N/A	16.64	1862	12549.5	93	N/A	1.09	47	880.367	2	0
13176	Central	N/A	7.75	775	1853.767	39	N/A	3.69	195	0	0	0
13177	Central	N/A	3.29	332	29105.52	361	N/A	0.45	51	0	0	0
13178	Central	N/A	3.1	109	1259.333	6	N/A	0.7	167	527.267	2	0
13180	Central	N/A	2.18	268	316.233	7	N/A	0.61	111	0	0	0
13181	Central	N/A	3.7	300	108248.6	1194	N/A	1.46	889	0	0	0
13183	Central	N/A	6.52	353	1894.2	7	N/A	0.62	37	0	0	0
13184	Central	N/A	1.55	70	55.633	1	N/A	0.44	33	548	5	0
13185	Central	N/A	2.54	218	47198.07	302	N/A	7.8	1058	0	0	0
13186	Central	N/A	4.59	500	5072.6	36	N/A	0.67	121	0	0	0
13187	Central	N/A	5.95	553	22475.43	298	N/A	4.86	650	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.54	0.11	0	63100.23	718	3.43	64	0	0	-6.10%	3.85
0	Yes	3.87	1.94	5	0	0	1.93	13	0	0	14.37%	8.12
0	Yes	2.78	0.36	0	0	0	2.42	16	0	0	8.55%	8.25
0	Yes	4.52	0.23	0	0	0	4.29	160	0	0	-4.13%	8.81
0	Yes	3.76	0.36	0	0	0	3.4	108	88415.9	2019	10.44%	8.25
0	Yes	1.76	0.26	0	0	0	1.5	112	31085.6	488	5.59%	3.59
0	Yes	2.99	0.38	0	0	0	2.61	55	9351.133	533	20.00%	5.52
0	Yes	1.43	0.56	0	0	0	0.87	36	18810	297	-23.24%	3.27
0	Yes	2.14	0.17	0	0	0	1.97	89	0	0	6.12%	6.24
0	Yes	1.26	0.22	0	0	0	1.04	49	27812.17	434	22.49%	3.54
0	Yes	2.12	0.4	0	0	0	1.72	67	0	0	20.71%	2.39
0	Yes	1.25	0.06	0	0	0	1.19	68	0	0	10.31%	4.28
0	Yes	2.23	0	0	0	0	2.23	147	32363.5	766	5.96%	3.2
0	Yes	2.33	0.07	0	0	0	2.26	119	0	0	4.90%	5.35

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13188	Central	N/A	4.88	410	9680.033	79	N/A	6.01	630	3796.25	39	0
13189	Western	N/A	2.21	144	5732.867	41	N/A	1.92	77	922.417	12	0
13190	Western	N/A	7.75	606	11115.45	196	N/A	8.61	465	406.2	7	0
13191	Western	N/A	5.35	482	12642.4	125	N/A	4.18	289	828.867	7	0
13192	Western	N/A	3.9	279	29390.6	102	N/A	8.18	828	4247.317	82	0
13193	Western	N/A	0	0	3870.533	8	N/A	10.23	829	2090.25	27	0
13194	Western	N/A	4.97	193	19598.58	187	N/A	2.22	124	0	0	0
13195	Western	N/A	0.72	70	622.85	3	N/A	2.12	16	0	0	0
13198	Western	N/A	3.8	566	21336.92	172	N/A	2.56	209	523.65	73	0
13199	Western	N/A	4.38	828	7797.933	155	N/A	1.16	207	0	0	0
13200	Western	N/A	0.36	22	0	0	N/A	0.39	5	0	0	0
13201	Western	N/A	2.75	388	1424.583	5	N/A	0.71	475	0	0	0
13204	Central	N/A	5.07	568	5769.75	76	N/A	5.37	1232	2951.55	7	0
13205	Central	N/A	1.06	69	17935.85	111	N/A	7.99	750	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.61	0.02	0	0	0	2.59	108	68868.83	1195	2.13%	5.75
0	Yes	1.86	0.14	0	0	0	1.72	73	18203.72	290	-24.52%	5.51
0	Yes	4.41	0.46	0	0	0	3.95	141	0	0	2.13%	7.66
0	Yes	3.44	0.24	0	0	0	3.2	92	55631.95	868	-4.46%	6.21
0	Yes	4.33	0.4	0	0	0	3.93	25	3351.15	2013	-8.68%	6.94
0	Yes	4.99	1.91	0	0	0	3.08	2	765998.1	1660	4.12%	3.54
0	Yes	1.33	0.12	0	0	0	1.21	19	0	0	-14.00%	2.15
0	Yes	1.43	0.78	2	0	0	0.65	27	0	0	-23.56%	3.44
0	Yes	3.11	0.46	0	0	0	2.65	177	40980.53	956	38.29%	4.84
0	Yes	0.91	0.17	0	0	0	0.74	72	0	0	6.22%	4.78
0	Yes	0.64	0.05	0	0	0	0.59	46	0	0	-12.26%	2.72
0	Yes	2.51	0.95	0	0	0	1.56	91	0	0	4.51%	5.33
0	Yes	2.57	0.23	0	0	0	2.34	122	220688.8	3717	6.68%	4.79
0	Yes	1.13	0.39	0	0	0	0.74	21	100.1	33	-6.88%	2.98

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13206	Western	N/A	10.09	1409	14269.33	333	N/A	0.16	30	0	0	0
13207	Western	N/A	9.06	894	37318.68	326	N/A	0.97	56	1754.967	34	0
13208	Western	N/A	3.98	322	3620.567	25	N/A	2.9	172	0	0	0
13210	Western	N/A	7.03	879	20689.28	354	N/A	1.39	30	0	0	0
13211	Eastern	N/A	1.43	64	4711.483	32	N/A	7.27	604	12501	55	0
13213	Eastern	N/A	17.86	716	77595.52	569	N/A	11.57	1030	4090.233	84	0
13214	Eastern	N/A	5.97	428	10500.08	107	N/A	4.4	238	4392.5	70	0
13215	Eastern	N/A	0.05	2	0	0	N/A	0.28	3	0	0	0
13217	Western	N/A	2.82	309	1499.267	23	N/A	1.91	189	0	0	0
13218	Western	N/A	5.51	573	58290.77	774	N/A	2.08	774	0	0	0
13219	Western	N/A	8.78	1301	70735.08	1291	N/A	2.01	390	16315.05	204	0
13220	Western	N/A	4.54	401	27375.1	282	N/A	1.51	297	2184.8	8	0
13221	Central	N/A	3.84	130	3030.9	31	N/A	5.79	1259	0	0	0
13222	Central	N/A	2.53	186	3385.75	15	N/A	1.9	38	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.24	0.13	0	0	0	1.11	100	0	0	2.57%	7.59
0	Yes	0.83	0.16	0	0	0	0.67	24	0	0	11.59%	7.03
0	Yes	1.22	0.17	0	28380.4	563	1.05	95	0	0	4.17%	3.75
0	Yes	2.38	0.28	0	0	0	2.1	105	0	0	1.64%	5.59
0	Yes	2.24	0.33	0	0	0	1.91	16	25732.45	554	-16.22%	6.87
0	Yes	5.38	1.91	0	0	0	3.47	117	18695.03	1744	23.28%	8.26
0	Yes	2.97	0.26	0	0	0	2.71	66	0	0	-0.65%	4.57
0	Yes	1.66	0.99	0	0	0	0.67	8	0	0	10.00%	2.64
0	Yes	2.94	0.79	0	0	0	2.15	70	0	0	7.78%	4.85
0	Yes	2	0.17	0	0	0	1.83	76	193742.6	2347	9.56%	4.93
0	Yes	2.66	0.14	0	0	0	2.52	194	0	0	-0.27%	7.38
0	Yes	1.36	0.08	0	0	0	1.28	22	0	0	3.67%	3.11
0	Yes	3.09	0.17	0	0	0	2.92	42	68784.43	1444	5.68%	5.58
0	Yes	2.45	0.48	0	0	0	1.97	47	0	0	12.76%	4.86

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13223	Central	N/A	4.48	326	6999.217	109	N/A	1.64	91	215.033	1	0
13224	Central	N/A	10.02	954	19100.2	252	N/A	1.34	359	0	0	0
13225	Eastern	N/A	5.81	432	10406.15	106	N/A	4.6	378	0	0	0
13226	Eastern	N/A	2.97	328	12911.15	160	N/A	7.58	959	865.667	7	0
13227	Eastern	N/A	5.95	454	27188.88	351	N/A	9.92	834	4279.667	64	0
13228	Eastern	N/A	3.98	253	54846.3	808	N/A	5.71	1165	29109.48	69	0
13229	Eastern	N/A	8.12	682	8225.55	75	N/A	4.35	596	0	0	0
13230	Eastern	N/A	3.71	235	1136.817	104	N/A	5.09	876	6045.333	57	0
13231	Eastern	N/A	4.64	423	48484.2	275	N/A	8.64	756	18430.17	112	0
13233	South Hillsborough	N/A	6.72	79	20200.23	203	N/A	18.86	1739	44.117	1	0
13235	South Hillsborough	N/A	0.01	0	0	0	N/A	30.87	3009	5431.067	11	0
13236	South Hillsborough	N/A	3.25	34	0	0	N/A	2.82	287	0	0	0
13237	South Hillsborough	N/A	0.1	0	291.2	2	N/A	34.48	2593	1277.367	16	0
13238	South Hillsborough	N/A	0.02	0	118.6	2	N/A	25.92	1951	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.86	0.11	0	0	0	2.75	66	0	0	10.37%	3.83
0	Yes	3.25	0.83	0	0	0	2.42	66	76725.87	1412	4.26%	7.84
0	Yes	0.58	0.06	0	0	0	0.52	7	0	0	9.74%	4.28
0	Yes	2.64	0.13	0	0	0	2.51	34	0	0	6.18%	8.07
0	Yes	3.15	0.03	0	0	0	3.12	78	0	0	7.26%	7.83
0	Yes	3.54	0.23	0	0	0	3.31	79	0	0	-1.67%	7.08
0	Yes	2.36	0.11	0	0	0	2.25	88	0	0	7.32%	6.01
0	Yes	2.67	0.26	0	0	0	2.41	105	0	0	16.30%	5.35
0	Yes	3.45	0.17	0	0	0	3.28	90	91181.5	1290	2.10%	6.33
0	Yes	5.69	1.8	0	0	0	3.89	11	0	0	44.79%	6.95
0	Yes	7.39	4.21	0	0	0	3.18	3	0	0	21.29%	12.25
0	Yes	3.59	0.38	0	0	0	3.21	6	0	0	-79.87%	1.57
0	Yes	5.23	3.58	0	240898.6	2533	1.65	4	0	0	21.52%	12.76
0	Yes	5.78	4.8	0	0	0	0.98	0	0	0	9.71%	7.68

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13239	South Hillsborough	N/A	0.92	14	491.283	8	N/A	26.02	2723	771.5	10	0
13240	South Hillsborough	N/A	0.86	16	0	0	N/A	7.87	984	0	0	0
13241	Plant City	N/A	11	872	350194.8	723	N/A	5.74	583	5276.333	44	0
13242	Plant City	N/A	10.62	337	31541.12	267	N/A	3.67	382	127.7	2	0
13243	Plant City	N/A	9.55	805	103396.8	1493	N/A	5.93	456	2476.567	50	0
13250	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13251	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13252	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13253	Central	N/A	0.09	0	0	0	N/A	0	0	0	0	0
13254	South Hillsborough	N/A	21.61	696	92340.4	746	N/A	11.72	1059	11806	124	0
13256	South Hillsborough	N/A	21.63	557	20965.02	173	N/A	7.04	790	15713.68	54	0
13258	Central	N/A	0	0	0	0	N/A	0.66	28	0	0	0
13259	Central	N/A	0	0	0	0	N/A	1.47	65	0	0	0
13260	Central	N/A	0	0	0	0	N/A	0	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	5.94	3.85	0	0	0	2.09	5	0	0	10.58%	11.5
0	Yes	3.48	1.22	0	0	0	2.26	9	0	0	52.19%	4.87
0	Yes	2.66	0	0	0	0	2.66	87	0	0	-2.57%	6.82
0	Yes	3.61	0.1	0	0	0	3.51	84	0	0	11.09%	5.11
0	Yes	2.4	0.17	0	0	0	2.23	139	0	0	1.64%	6.81
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	0.46	0.02	0	0	0	0.44	0	0	0	33.27%	7.45
0	Yes	12.58	0.11	0	493.75	15	12.47	131	37108.33	1825	5.29%	7.16
0	Yes	1.99	0.28	0	0	0	1.71	4	150127.2	1340	11.43%	4.68
0	Yes	0.34	0.34	0	0	0	0	0	0	0	35.57%	6.25
0	Yes	0.76	0.76	0	30689.55	55	0	0	0	0	9.77%	5.17
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13261	Central	N/A	0	0	0	0	N/A	1.24	11	0	0	0
13262	Central	N/A	0	0	0	0	N/A	0.07	0	0	0	0
13263	Central	N/A	0	0	0	0	N/A	0.24	2	0	0	0
13264	Central	N/A	0	0	54.433	1	N/A	1.6	932	0	0	0
13265	Central	N/A	0	0	0	0	N/A	0.49	52	0	0	0
13267	Plant City	N/A	0	0	0	0	N/A	1.28	12	159.1	1	0
13268	Plant City	N/A	2.43	81	8669.383	86	N/A	1.41	12	0	0	0
13269	Plant City	N/A	0.16	4	58.8	1	N/A	2.46	42	0	0	0
13270	Western	N/A	0.36	29	2814.717	127	N/A	4.28	498	2292.8	24	0
13275	Western	N/A	0	0	0	0	N/A	1.35	4	0	0	0
13276	Western	N/A	0	0	0	0	N/A	2.4	10	0	0	0
13278	Winter Haven	N/A	7.9	666	3438.117	46	N/A	1.05	97	0	0	0
13279	Winter Haven	N/A	9.16	941	8982.933	91	N/A	1.69	52	717.2	22	0
13280	Winter Haven	N/A	2.75	95	1711.017	15	N/A	0.62	12	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.78	0.78	0	4079.017	17	0	0	0	0	6.93%	2.47
0	Yes	0.7	0.7	0	0	0	0	0	0	0	0.00%	0.02
0	Yes	1.15	1.15	0	0	0	0	0	0	0	0.83%	1.21
0	Yes	1.52	1.5	15	0	0	0.02	0	0	0	1.71%	5.95
0	Yes	0.61	0.61	0	0	0	0	0	0	0	-46.15%	2.31
0	Yes	2.14	0.47	0	0	0	1.67	4	0	0	-10.70%	8.93
0	Yes	2.88	0.09	0	0	0	2.79	8	0	0	-52.03%	3.07
0	Yes	1.99	0.16	0	0	0	1.83	7	0	0	100.00%	1.71
0	Yes	1.5	0.51	0	0	0	0.99	4	11378.17	466	15.56%	2.08
0	Yes	2.32	2.32	0	0	0	0	0	0	0	-0.33%	2.99
0	Yes	1.68	1.68	0	0	0	0	0	1413.733	10	-31.25%	2.2
0	Yes	3.99	0.11	0	0	0	3.88	198	124274.3	2665	11.17%	6.67
0	Yes	5.77	0.97	0	0	0	4.8	217	0	0	3.75%	6.64
0	Yes	2.91	0.33	0	0	0	2.58	49	2149.233	151	-13.18%	3.82

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13281	Winter Haven	N/A	0	0	0	0	N/A	0.18	5	0	0	0
13282	Winter Haven	N/A	0	0	0	0	N/A	0.11	3	0	0	0
13283	Winter Haven	N/A	0	0	0	0	N/A	0.23	7	0	0	0
13288	Winter Haven	N/A	1.02	83	0	0	N/A	1.94	119	0	0	0
13289	Winter Haven	N/A	4.02	267	14648.85	788	N/A	1.9	291	0	0	0
13290	Winter Haven	N/A	5.05	581	22607.82	398	N/A	1.24	341	0	0	0
13291	Winter Haven	N/A	6.7	553	53552.95	775	N/A	7.71	885	0	0	0
13292	Winter Haven	N/A	2.74	287	3948.517	39	N/A	1.72	154	0	0	0
13293	Winter Haven	N/A	8.41	991	14738.75	80	N/A	4.11	538	1374.917	5	0
13294	Winter Haven	N/A	13.51	723	6189.283	167	N/A	3.33	186	5137.25	18	0
13295	Winter Haven	N/A	2.72	274	34416.57	407	N/A	11.22	934	5501.55	82	0
13296	Winter Haven	N/A	8.23	370	19163.53	175	N/A	16.32	1292	20048.55	162	0
13297	Winter Haven	N/A	5.59	431	658.717	9	N/A	8	956	20010.9	111	0
13298	Winter Haven	N/A	135.7	1169	75753.62	984	N/A	6.71	61	1696.767	2	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.95	0.94	0	0	0	0.01	0	38	12	47.27%	9.72
0	Yes	1.22	1.21	0	0	0	0.01	0	0	0	4.68%	6.49
0	Yes	1.24	1.24	0	0	0	0	0	0	0	-1.82%	6.48
0	Yes	1.52	0.22	0	0	0	1.3	25	0	0	1.38%	5.88
0	Yes	2.95	0.17	0	0	0	2.78	87	0	0	10.00%	3.85
0	Yes	3.01	0.12	0	0	0	2.89	159	0	0	14.17%	4.11
0	Yes	4.51	0.74	0	0	0	3.77	79	172781.5	3007	75.32%	8.24
0	Yes	2.49	0.12	0	0	0	2.37	130	0	0	2.33%	3.07
0	Yes	3.41	0.07	0	0	0	3.34	130	99164.47	1636	5.47%	5.59
0	Yes	5.42	0.3	0	0	0	5.12	138	0	0	-15.43%	5.92
0	Yes	3.77	0.62	0	0	0	3.15	44	43154.6	1259	4.00%	5.2
0	Yes	4.88	0.72	0	0	0	4.16	102	42649.97	3484	20.86%	8.46
0	Yes	3.84	0.12	0	0	0	3.72	152	0	0	-8.21%	5.14
0	Yes	24	0	0	0	0	24	101	367428	3940	10.48%	6.85

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13299	Winter Haven	N/A	15.01	479	56503.6	1782	N/A	23.92	1257	264.083	1	0
	South											
13302	Hillsborough	N/A	2.81	213	109527.2	724	N/A	20.29	1500	24723.05	258	0
	South											
13303	Hillsborough	N/A	106.06	1703	65911.47	724	N/A	5.22	380	4862.55	93	0
	South											
13304	Hillsborough	N/A	0.76	9	46444.22	673	N/A	24.08	2110	19182.3	112	0
	South											
13305	Hillsborough	N/A	0	0	0	0	N/A	22.43	1476	0	0	0
13308	Winter Haven	N/A	6.19	614	43582.13	455	N/A	3.49	543	12452.28	73	0
13309	Winter Haven	N/A	2.5	271	1801.6	35	N/A	0.36	46	0	0	0
13310	Winter Haven	N/A	2.06	355	1990.55	41	N/A	0.68	221	0	0	0
13311	Winter Haven	N/A	5.87	672	4614.333	42	N/A	0.61	99	0	0	0
13312	Winter Haven	N/A	3.96	464	857.033	17	N/A	2.55	403	74.717	2	0
13313	Winter Haven	N/A	2.27	235	3387.95	45	N/A	1.35	143	0	0	0
13314	Winter Haven	N/A	1.55	34	2274.567	36	N/A	3.01	408	324.067	1	0
13315	Winter Haven	N/A	0	0	0	0	N/A	0.33	13	0	0	0
13317	Western	N/A	0.78	0	61.883	1	N/A	5.5	1425	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.92	0.51	0	0	0	3.41	39	10446	1741	22.50%	8.82
0	Yes	3.02	1.48	0	0	0	1.54	7	0	0	-2.88%	6.41
0	Yes	6.02	1.08	0	0	0	4.94	61	367830.1	2190	2.27%	9
0	Yes	5.1	3.21	0	0	0	1.89	3	55739.17	2110	5.92%	8.05
0	Yes	3.45	3.12	0	0	0	0.33	0	0	0	33.03%	4.39
0	Yes	3.87	0.24	0	0	0	3.63	172	0	0	0.47%	6.43
0	Yes	1.7	0.04	0	0	0	1.66	44	0	0	-1.05%	3.76
0	Yes	1.36	0.05	0	0	0	1.31	17	0	0	9.31%	3.17
0	Yes	2.97	0.17	0	0	0	2.8	142	0	0	15.48%	3.58
0	Yes	3.21	0.12	0	0	0	3.09	75	0	0	3.80%	7.37
0	Yes	2.14	0.52	0	0	0	1.62	36	0	0	-12.24%	5.88
0	Yes	2.47	0.61	0	0	0	1.86	44	0	0	14.32%	4.23
0	Yes	0.58	0.58	0	0	0	0	0	0	0	-6.67%	0.84
0	Yes	3.79	3.47	0	0	0	0.32	3	27383.03	506	-20.75%	5.31

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13318	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13319	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13320	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13321	Western	N/A	0	0	0	0	N/A	1.39	6	0	0	0
13322	Western	N/A	0.01	0	0	0	N/A	1.62	508	5923.35	9	0
13323	Western	N/A	0.36	170	0	0	N/A	4.61	119	0	0	0
13324	Eastern	N/A	6.26	235	6778.133	27	N/A	0.39	12	0	0	0
13325	Eastern	N/A	0.98	14	0	0	N/A	0.62	10	0	0	0
13326	Eastern	N/A	8.74	285	2056.1	273	N/A	3.79	126	136.933	1	0
13327	Eastern	N/A	2.64	22	210.883	1	N/A	0.77	13	0	0	0
13328	Dade City	N/A	6.22	532	49546.82	771	N/A	0.67	39	0	0	0
13329	Dade City	N/A	8.45	576	10718	110	N/A	1.19	75	4886.333	20	0
13330	Dade City	N/A	35.56	1297	133877	672	N/A	10.33	480	6200.817	18	0
13331	Dade City	N/A	27.64	1182	93251.68	732	N/A	4.38	154	2162.2	19	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.17	1.17	0	0	0	0	0	0	0	-30.00%	0.07
0	Yes	0.97	0.97	0	0	0	0	0	0	0	-40.00%	0.06
0	Yes	1.12	1.12	0	0	0	0	0	0	0	-30.00%	0.07
0	Yes	2.12	2.12	0	0	0	0	0	0	0	-52.00%	1.92
0	Yes	3.1	2.74	1	0	0	0.36	2	0	0	17.24%	3.4
0	Yes	1.52	1.33	0	0	0	0.19	31	0	0	18.67%	1.78
0	Yes	3.77	0.1	0	0	0	3.67	31	0	0	-2.31%	3.81
0	Yes	2.65	0.11	0	0	0	2.54	12	0	0	0.31%	6.42
0	Yes	5.94	0.37	0	0	0	5.57	52	22637.22	534	4.64%	8.79
0	Yes	1.33	0.07	0	0	0	1.26	7	2865.233	43	-49.35%	1.57
0	Yes	1.51	0.07	0	0	0	1.44	36	0	0	2.06%	3.47
0	Yes	2.62	0.06	0	0	0	2.56	127	0	0	0.71%	4.23
0	Yes	4.81	0.2	0	0	0	4.61	157	0	0	7.91%	7.23
0	Yes	3.88	0.11	0	0	0	3.77	93	0	0	1.49%	4.77

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13332	Western	N/A	1.92	86	85756.22	351	N/A	10.96	1689	2731.283	41	0
13333	Western	N/A	1.14	113	625.433	7	N/A	3.15	356	415.867	2	0
13334	Western	N/A	3.66	592	10564.37	136	N/A	2.58	301	0	0	0
13335	Western	N/A	1.38	33	0	0	N/A	1.82	27	0	0	0
13336	Western	N/A	2.43	57	2503.25	4	N/A	2.94	207	0	0	0
13337	Western	N/A	2.76	230	12634.22	1069	N/A	4.66	1973	2092.317	29	0
13338	Western	N/A	3.46	135	343.867	2	N/A	2.43	242	0	0	0
13339	Western	N/A	0.48	3	0	0	N/A	5.33	1225	0	0	0
13340	South Hillsborough	N/A	1.41	29	0	0	N/A	8.24	1110	14127.9	159	0
13341	South Hillsborough	N/A	3.55	95	14155.63	238	N/A	6.7	671	906.5	2	0
13342	South Hillsborough	N/A	8.49	406	1881.333	18	N/A	8.85	942	0	0	0
13343	South Hillsborough	N/A	2.26	51	113.233	1	N/A	11.26	1345	0	0	0
13344	South Hillsborough	N/A	0.5	19	230.8	6	N/A	1.16	263	0	0	0
13346	South Hillsborough	N/A	0.68	9	0	0	N/A	9.87	897	4273.683	16	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.88	0.06	0	0	0	1.82	57	0	0	-1.89%	5.2
0	Yes	2.26	0.19	0	0	0	2.07	83	0	0	14.47%	4.35
0	Yes	2.39	0.31	0	0	0	2.08	75	0	0	3.45%	5.69
0	Yes	2.16	0.94	0	0	0	1.22	7	0	0	2.25%	4.09
0	Yes	1.52	0.12	0	0	0	1.4	6	0	0	29.81%	6.88
0	Yes	2.69	0.16	0	0	0	2.53	171	67217.85	2371	-5.45%	6.24
0	Yes	3.63	0.14	0	0	0	3.49	24	2233.333	800	17.55%	6.23
0	Yes	1.62	1.22	1	0	0	0.4	0	6791.333	1220	2.50%	7.79
0	Yes	3.79	0.4	0	0	0	3.39	18	0	0	62.41%	4.71
0	Yes	3.51	1.21	9	0	0	2.3	23	0	0	25.13%	4.88
0	Yes	6.06	0.97	0	0	0	5.09	54	0	0	-1.47%	9.36
0	Yes	4.8	2.91	0	0	0	1.89	8	0	0	6.15%	6.9
0	Yes	2.19	0.83	0	0	0	1.36	3	0	0	-10.77%	2.32
0	Yes	5.13	2.37	0	0	0	2.76	32	0	0	-34.95%	6.83

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13348	Central	N/A	3.74	668	88667.82	1552	N/A	5.82	1855	6478.367	17	0
13349	Central	N/A	0.09	0	0	0	N/A	0.1	3	0	0	0
13350	Central	N/A	0.15	71	0	0	N/A	1.84	386	2361.517	99	0
13351	Central	N/A	2.78	453	25957.95	365	N/A	5.4	1394	49809	479	0
13352	Central	N/A	0.74	127	9947.183	25	N/A	5.8	1660	13577.8	132	0
13353	Central	N/A	0	0	0	0	N/A	0.85	99	0	0	0
13354	Central	N/A	1.33	12	67979.08	644	N/A	7.84	1767	12412.87	92	0
13355	Central	N/A	0	0	0	0	N/A	0.06	2	0	0	0
13358	Western	N/A	4.26	946	8953.05	112	N/A	1.48	589	0	0	0
13359	Western	N/A	6.21	671	34027.4	133	N/A	2.32	179	0	0	0
13360	Western	N/A	0.08	9	0	0	N/A	0.02	47	0	0	0
13362	Central	N/A	0	0	0	0	N/A	0.82	232	835.967	3	0
13363	Central	N/A	0	0	0	0	N/A	0.01	0	0	0	0
13364	Central	N/A	0.09	0	12326.92	53	N/A	0.34	301	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.67	0.35	0	0	0	2.32	207	0	0	3.22%	7.38
0	Yes	1.6	0.72	0	0	0	0.88	10	0	0	19.31%	2.41
0	Yes	0.68	0.39	0	0	0	0.29	6	0	0	16.04%	4.92
0	Yes	2.17	1.14	0	0	0	1.03	31	0	0	-3.73%	5.42
0	Yes	2.1	0.94	0	0	0	1.16	45	0	0	3.63%	4.85
0	Yes	2.58	2.58	0	0	0	0	0	0	0	-2.17%	2.71
0	Yes	2.43	0.08	0	0	0	2.35	56	711409.5	7319	-1.32%	8.23
0	Yes	1.01	0.74	0	0	0	0.27	2	0	0	-18.51%	4.8
0	Yes	2.54	0.77	0	0	0	1.77	199	0	0	-39.12%	5.54
0	Yes	3.37	1.41	0	0	0	1.96	85	79139.28	941	6.21%	6.16
0	Yes	1.65	0.81	0	0	0	0.84	2	0	0	-10.00%	0.09
0	Yes	0.4	0.08	0	0	0	0.32	1	0	0	-2.04%	1.92
0	Yes	1.03	0.97	0	0	0	0.06	0	0	0	3875.00%	1.59
0	Yes	0.39	0.09	0	0	0	0.3	2	0	0	-2.22%	0.88

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13365	Central	N/A	2.04	342	6884.667	102	N/A	7.74	924	0	0	0
13366	Central	N/A	0	0	0	0	N/A	0.53	5	0	0	0
13367	Central	N/A	0.01	0	0	0	N/A	0.72	158	0	0	0
13368	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13369	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13370	Winter Haven	N/A	8.07	766	70159.37	1604	N/A	4.95	501	46548.67	348	0
13371	Winter Haven	N/A	7.2	455	2421.233	26	N/A	9.64	756	6162.083	52	0
13372	Winter Haven	N/A	2.37	238	851.4	16	N/A	1.16	55	1537.6	8	0
13373	Winter Haven	N/A	14.26	1468	110594.3	1160	N/A	0.55	129	0	0	0
13375	Western	N/A	0	0	0	0	N/A	0.02	0	0	0	0
13376	Western	N/A	0	0	0	0	N/A	0.18	21	0	0	0
13377	Western	N/A	4.12	938	10704.25	87	N/A	2.1	168	0	0	0
13378	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13379	Western	N/A	0	0	0	0	N/A	0.29	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	5.55	2	0	0	0	3.55	15	52866.6	1278	20.94%	7.22
0	Yes	1.23	0.82	0	0	0	0.41	4	0	0	-43.21%	4.56
0	Yes	1.51	0.76	0	5305.683	189	0.75	1	0	0	11.73%	6.67
0	Yes	0.09	0.09	0	0	0	0	0	0	0	4.59%	2.96
0	Yes	0.15	0.15	0	0	0	0	1	0	0	30.17%	4.66
0	Yes	3.06	0.18	0	0	0	2.88	194	0	0	7.94%	7.34
0	Yes	2.58	0.12	0	0	0	2.46	45	75660.98	1232	7.41%	5.8
0	Yes	1.3	0.11	0	0	0	1.19	16	0	0	-0.89%	5.55
0	Yes	3.9	0.19	0	0	0	3.71	189	986304.5	4307	-12.57%	6.47
0	Yes	0.91	0.91	0	0	0	0	0	0	0	-10.00%	1.89
0	Yes	1.03	1.03	0	0	0	0	0	0	0	-10.00%	1.53
0	Yes	3.01	0.78	0	0	0	2.23	79	0	0	4.36%	5.74
0	Yes	0.01	0.01	0	0	0	0	0	0	0	0.00%	0
0	Yes	0.98	0.98	0	0	0	0	0	0	0	-17.85%	5.34

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13380	Western	N/A	0	0	0	0	0	0.06	401	0	0	0
13381	Western	N/A	0	0	0	0	0	0.15	2	0	0	0
13382	Western	N/A	0	0	0	0	0	0.26	0	0	0	0
13383	Western	N/A	0	0	0	0	0	0.91	8	4435.5	6	0
13384	Western	N/A	0	0	0	0	0	0.01	8	0	0	0
13385	Western	N/A	0	0	0	0	0	0	0	0	0	0
13388	Plant City	N/A	17.26	473	37644.23	224	N/A	8.45	183	4434.333	14	0
13389	Plant City	N/A	17.2	920	19597.7	295	N/A	1.67	59	0	0	0
13390	Plant City	N/A	31.51	1151	266598.8	3669	N/A	12.15	433	3944.017	22	0
13391	Plant City	N/A	47.88	1155	391326.5	4304	N/A	7.04	358	4854.517	14	0
13397	Central	N/A	0.31	57	0	0	N/A	0.35	47	0	0	0
13398	Central	N/A	0.47	13	68.683	1	N/A	1.37	1624	0	0	0
13399	Central	N/A	0.8	38	6296.783	74	N/A	0.13	15	0	0	0
13400	Central	N/A	1.9	116	106154.9	1495	N/A	1.39	1351	518.383	1	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.16	0.16	0	0	0	0	0	0	0	30.00%	0.39
0	Yes	0.19	0.19	0	0	0	0	0	0	0	6.67%	0.64
0	Yes	1.12	1.12	0	0	0	0	0	0	0	1.67%	5.49
0	Yes	0.97	0.97	2	133.1	3	0	0	0	0	-12.00%	3.08
0	Yes	0.81	0.81	0	0	0	0	0	0	0	-16.58%	3.17
0	Yes	0.02	0.02	0	0	0	0	0	0	0	0.00%	0
0	Yes	5.03	0.86	0	0	0	4.17	115	84716.48	2141	6.27%	6.27
0	Yes	6.34	0.04	0	0	0	6.3	163	0	0	2.71%	4.93
0	Yes	6.45	0.3	0	0	0	6.15	215	0	0	4.56%	7.11
0	Yes	8.97	0.24	0	0	0	8.73	189	78070.45	2011	6.76%	7.9
0	Yes	1.11	0.11	0	0	0	1	62	0	0	0.00%	2.05
0	Yes	2.03	1.78	228	0	0	0.25	3	0	0	37.32%	5.74
0	Yes	0.39	0.24	0	0	0	0.15	8	0	0	147.83%	1.71
0	Yes	3.01	1.29	0	0	0	1.72	32	221042.2	1500	6.00%	4.59

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13405	Western	N/A	9.31	181	6541.75	75	N/A	2.76	116	0	0	0
13406	Western	N/A	1.37	28	8511.367	54	N/A	5.95	273	3411.733	13	0
13410	Plant City	N/A	4.85	409	1924.8	31	N/A	2.86	231	0	0	0
13412	Plant City	N/A	1.2	96	0	0	N/A	0.03	1	0	0	0
13414	Plant City	N/A	8.88	536	10553.62	178	N/A	5.15	280	157.2	1	0
13417	Central	N/A	4.85	687	16990.17	55	N/A	1.34	66	0	0	0
13418	Central	N/A	8.52	1109	40631.37	126	N/A	2.24	287	0	0	0
13419	Central	N/A	10.58	1375	124777.6	1064	N/A	1.05	106	0	0	0
13420	Central	N/A	3.86	409	9290.983	47	N/A	6.35	1522	2959.367	38	0
13422	Dade City	N/A	29.01	927	60952.03	702	N/A	13.35	504	2490.283	28	0
13423	Dade City	N/A	28.23	631	66351.37	1500	N/A	9.92	722	2228.683	6	0
13425	Western	N/A	0.62	4	86428.63	933	N/A	15.02	1622	46483.42	526	0
13426	Western	N/A	5.75	399	51.833	1	N/A	12.12	1361	8493.2	60	0
13427	Western	N/A	0	1	17103.32	81	N/A	3.95	290	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.96	0.53	0	0	0	2.43	26	0	0	5.00%	1.89
0	Yes	5.09	1.09	0	0	0	4	28	6911.333	280	-9.12%	3.09
0	Yes	4.34	1.24	0	0	0	3.1	168	0	0	100.00%	4.19
0	Yes	0.63	0.05	0	0	0	0.58	20	0	0	-40.91%	0.65
0	Yes	6.8	0.39	0	0	0	6.41	195	54767	2420	44.44%	7.8
0	Yes	3.1	0.26	0	0	0	2.84	186	71516.37	864	4.12%	5.31
0	Yes	1.84	0.11	0	0	0	1.73	156	0	0	5.73%	6.46
0	Yes	1.64	0.14	0	0	0	1.5	145	100647	1590	1.53%	7.31
0	Yes	2.09	0.08	0	0	0	2.01	134	0	0	4.33%	6.5
0	Yes	8.69	0.27	0	0	0	8.42	107	0	0	8.28%	6.28
0	Yes	2.72	0.19	0	0	0	2.53	63	0	0	7.11%	4.82
0	Yes	2.51	0.92	0	0	0	1.59	7	0	0	1.75%	6.41
0	Yes	1.15	0.07	0	0	0	1.08	15	0	0	-1.78%	7.17
0	Yes	0.17	0.08	0	0	0	0.09	0	0	0	-3.08%	1.26

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13428	Western	N/A	0.83	49	7602.167	52	N/A	9.25	1059	6074.917	47	0
13430	Dade City	N/A	29.76	556	168887	1129	N/A	14.12	479	2862.817	15	0
13431	Dade City	N/A	10.32	141	55493.63	173	N/A	20.28	194	5	2	0
13432	Dade City	N/A	3.81	48	3351.617	17	N/A	16.58	731	2910.05	39	0
13433	Eastern	N/A	8.79	274	5202.867	28	N/A	3.63	337	403.333	22	0
13434	Eastern	N/A	9.75	844	143556.2	1475	N/A	4.37	571	96.517	1	0
13435	Eastern	N/A	8.31	374	24280.3	164	N/A	1.93	394	37.267	2	0
13436	Eastern	N/A	11.74	649	57614.97	2164	N/A	6.82	485	3308.8	47	0
13438	South Hillsborough	N/A	1	100	2.967	1	N/A	22.57	2986	6368.733	26	0
13439	South Hillsborough	N/A	2.8	312	2997.533	35	N/A	7.22	507	2240.333	45	0
13440	South Hillsborough	N/A	2.05	1	643.45	8	N/A	20.72	1893	6093.1	59	0
13442	Winter Haven	N/A	13.81	604	49283.48	911	N/A	23.84	1958	9980.2	132	0
13443	Winter Haven	N/A	9.45	607	18287.78	145	N/A	9.75	970	28975.4	221	0
13444	Winter Haven	N/A	4.01	333	14192.7	85	N/A	1.6	209	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.33	0.78	0	0	0	2.55	68	0	0	23.78%	5.57
0	Yes	5.03	1.23	0	0	0	3.8	95	133567.7	1103	100.00%	5.13
0	Yes	11.96	7.12	0	0	0	4.84	25	92916.6	1317	-73.00%	1.62
0	Yes	3.39	1.08	0	0	0	2.31	41	0	0	7.42%	6.66
0	Yes	3.63	0.37	0	0	0	3.26	52	0	0	13.70%	8.3
0	Yes	4.32	0.1	0	0	0	4.22	208	90147.75	1617	2.46%	6.66
0	Yes	3.75	0.1	0	0	0	3.65	57	0	0	16.00%	4.64
0	Yes	4.65	0.12	0	0	0	4.53	197	13191.47	1328	-1.19%	6.62
0	Yes	5.5	3.64	0	0	0	1.86	13	53182.28	3089	4.32%	9.18
0	Yes	4.16	0.71	0	0	0	3.45	159	0	0	-1.52%	4.53
0	Yes	8.41	2.43	0	0	0	5.98	17	0	0	6.70%	10.03
0	Yes	2.83	0.13	0	0	0	2.7	79	0	0	7.30%	10.73
0	Yes	3.19	0.05	0	0	0	3.14	76	0	0	12.12%	7.4
0	Yes	2.45	0.19	0	0	0	2.26	117	0	0	9.67%	3.29

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13446	Western	N/A	0	3	0	0	N/A	0.72	89	0	0	0
13447	Western	N/A	1.63	52	25.217	1	N/A	0.99	45	291.383	2	0
13448	Western	N/A	1.32	99	0	0	N/A	2.56	720	0	0	0
13449	Western	N/A	2.51	233	21038	100	N/A	1.71	189	0	0	0
13450	Western	N/A	0.6	20	5388.233	18	N/A	1.91	65	1589.867	11	0
13451	Western	N/A	0.15	1	6681.967	67	N/A	2.47	95	1786.283	7	0
13452	Western	N/A	0.2	8	111.033	1	N/A	0.19	5	0	0	0
13453	Western	N/A	0.14	4	941.267	6	N/A	4.51	29	0	0	0
13454	Eastern	N/A	3.19	199	5575.233	77	N/A	14.3	1266	6401.45	45	0
13455	Eastern	N/A	2.9	208	7153.833	97	N/A	3.23	777	4788	54	0
13456	Eastern	N/A	1.63	148	5634.233	52	N/A	3.08	813	9908.333	25	0
13457	Eastern	N/A	2.19	108	1352.883	14	N/A	5.34	697	35157.27	215	0
13458	Eastern	N/A	15.25	467	9808.15	141	N/A	4.46	112	1252.3	42	0
13459	Eastern	N/A	10.37	390	7755.15	101	N/A	15.6	546	11451.3	31	0

2023 Annual Reliability Performance Report

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.25	1.25	0	0	0	0	0	0	0	6.07%	2.97
0	Yes	0.95	0.12	0	0	0	0.83	18	0	0	-9.44%	4.89
0	Yes	1.15	0.68	0	0	0	0.47	17	0	0	29.62%	3.37
0	Yes	1.8	1.02	0	0	0	0.78	25	0	0	9.07%	4.69
0	Yes	2.2	1	0	0	0	1.2	39	2864.033	107	-0.81%	6.15
0	Yes	1.17	0.27	0	0	0	0.9	15	4116.967	113	2.20%	4.19
0	Yes	0.75	0.14	0	0	0	0.61	30	0	0	10.00%	0.99
0	Yes	4.36	3.89	1	0	0	0.47	10	0	0	-3.62%	5.59
0	Yes	2.3	0.22	0	0	0	2.08	42	0	0	10.16%	6.94
0	Yes	2.1	0.13	0	0	0	1.97	37	55138.7	1016	6.83%	4.38
0	Yes	2.47	0.7	0	0	0	1.77	36	81084.92	993	2.25%	4.09
0	Yes	2.61	0.07	0	0	0	2.54	69	0	0	8.54%	4.45
0	Yes	8.27	0.59	0	0	0	7.68	95	0	0	10.94%	3.55
0	Yes	8	3.28	0	0	0	4.72	106	42287.3	1043	14.36%	6.29

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13460	Eastern	N/A	37.59	906	259576.5	2719	N/A	3.83	242	0	0	0
13461	Eastern	N/A	26.72	946	183175.5	2213	N/A	13.51	360	12047.38	56	0
13462	Plant City	N/A	3.22	199	5181.55	69	N/A	12.08	763	8.467	1	0
13463	Plant City	N/A	1.56	248	4087.05	18	N/A	0.25	15	51.217	1	0
13464	Plant City	N/A	5.25	440	27844.83	446	N/A	2.63	171	0	0	0
13466	Central	N/A	1.73	124	467.55	3	N/A	1.13	151	0	0	0
13467	Central	N/A	0	0	0	0	N/A	0.24	4	0	0	0
13468	Central	N/A	5.01	535	13670.53	63	N/A	3.47	856	913.95	9	0
13469	Central	N/A	1.99	100	152.917	1	N/A	8.5	713	8911.433	26	0
13470	Winter Haven	N/A	31.55	1756	83414.28	779	N/A	8.42	539	0	0	0
13471	Winter Haven	N/A	4.42	436	12292.18	91	N/A	4.87	524	1455.1	6	0
13473	Winter Haven	N/A	11.92	907	47086.02	1468	N/A	12.59	651	877.183	7	0
13479	Winter Haven	N/A	9	453	5594.467	39	N/A	4.44	337	0	0	0
13480	Western	N/A	0.75	5	14544.12	93	N/A	11.5	1606	18937.8	115	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	7.3	0.12	0	0	0	7.18	70	152494.6	3236	5.69%	5.39
0	Yes	7.91	0.41	0	0	0	7.5	114	0	0	6.10%	8.17
0	Yes	4.1	0.49	0	0	0	3.61	74	0	0	8.40%	10.19
0	Yes	2.94	0.02	0	0	0	2.92	66	86528.82	364	-7.92%	2.21
0	Yes	4.43	0.1	0	0	0	4.33	125	21294.17	750	-11.14%	9.33
0	Yes	1.76	0.12	0	0	0	1.64	66	0	0	27.48%	6.82
0	Yes	1.9	1.88	0	0	0	0.02	0	0	0	-11.11%	2.24
0	Yes	2.67	0.1	0	0	0	2.57	97	0	0	-2.11%	4.63
0	Yes	4.04	0.49	0	0	0	3.55	49	0	0	4.68%	8.5
0	Yes	4.16	0.05	0	0	0	4.11	106	93557.6	498	-11.88%	8.9
0	Yes	4.07	0.61	0	0	0	3.46	82	64590.53	1034	9.02%	4.47
0	Yes	3.27	0.04	0	0	0	3.23	93	157036.3	3863	18.04%	6.61
0	Yes	4.82	0.05	0	0	0	4.77	85	0	0	4.55%	6.9
0	Yes	0.96	0.02	0	0	0	0.94	6	0	0	17.39%	5.4

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13481	Western	N/A	0	0	0	0	N/A	6.67	753	980.95	13	0
13482	Western	N/A	0.88	11	19437.65	135	N/A	15.6	1578	17438.67	105	0
13483	Western	N/A	2.79	355	5163.683	55	N/A	15.24	1370	405.8	6	0
13484	Western	N/A	0.18	4	9372.1	67	N/A	11.23	1450	23099.75	182	0
13485	Western	N/A	2.91	119	28969.87	379	N/A	7.46	768	107824.1	255	0
13488	South Hillsborough	N/A	0.92	87	0	0	N/A	18.92	2512	21233.52	150	0
13489	South Hillsborough	N/A	6.14	259	4775.15	460	N/A	3.83	196	2527.833	29	0
13490	Western	N/A	2.85	422	6485.8	125	N/A	3.54	415	10434.7	60	0
13491	Western	N/A	0.6	53	11.733	1	N/A	12.38	1667	33316.98	202	0
13492	Western	N/A	5.23	571	4325.7	76	N/A	2.53	233	134.2	2	0
13493	Western	N/A	2.13	260	4242.567	36	N/A	3.5	321	14370.72	131	0
13494	South Hillsborough	N/A	0.33	2	24947	260	N/A	3.53	416	0	0	0
13495	Eastern	N/A	2.62	199	2551.917	24	N/A	10.28	1192	0	0	0
13496	Central	N/A	1.1	73	29971.33	91	N/A	1.1	384	1521.483	11	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	5.57	2.56	0	0	0	3.01	3	0	0	6.29%	3.72
0	Yes	2.64	0.77	0	0	0	1.87	6	0	0	4.29%	7.3
0	Yes	1.97	1.67	0	0	0	0.3	3	0	0	-28.79%	6.48
0	Yes	4.06	1	0	0	0	3.06	24	0	0	22.17%	5.62
0	Yes	2.58	0.19	0	0	0	2.39	19	0	0	-9.12%	6.18
0	Yes	3.38	0.84	0	0	0	2.54	204	10714.12	2759	3.33%	7.13
0	Yes	4.56	0.81	0	22644.07	742	3.75	67	4174.2	81	3.68%	3.94
0	Yes	1.94	0.08	0	0	0	1.86	96	44071.6	922	0.67%	4.53
0	Yes	3.06	0.21	0	0	0	2.85	57	0	0	-0.37%	5.38
0	Yes	2.02	0.28	0	0	0	1.74	39	41486.22	1754	8.36%	6.61
0	Yes	2.09	0.49	0	0	0	1.6	93	67704	672	2.07%	2.96
0	Yes	2.63	1.03	0	0	0	1.6	7	0	0	1.56%	3.25
0	Yes	3.52	2.13	0	0	0	1.39	40	0	0	19.77%	5.27
0	Yes	1.93	0.09	0	0	0	1.84	13	0	0	-1.07%	2.78

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13497	Central	N/A	0.11	3	0	0	N/A	1.32	135	0	0	0
13498	Central	N/A	0	0	0	0	N/A	0.44	0	0	0	0
13499	Central	N/A	0.04	0	0	0	N/A	0.6	47	41.75	1	0
13500	Eastern	N/A	0	0	0	0	N/A	0	0	0	0	0
13501	Eastern	N/A	0.92	16	16127.73	53	N/A	1.95	62	0	0	0
13502	Eastern	N/A	3.74	188	13886.03	148	N/A	9.76	1597	264.533	5	0
13504	Eastern	N/A	0.13	4	0	0	N/A	1.25	13	0	0	0
13505	Eastern	N/A	3.17	175	27407.53	240	N/A	5.7	895	1558.267	7	0
13506	Eastern	N/A	2.83	87	20454.62	305	N/A	4.98	593	2036.667	8	0
13507	Eastern	N/A	0.05	0	0	0	N/A	1.88	34	0	0	0
13509	Eastern	N/A	6.42	281	53650.6	844	N/A	14.74	1808	8194.733	107	0
13510	Western	N/A	3.02	336	8396.483	81	N/A	9.5	1197	12241.03	186	0
13511	Western	N/A	3.26	383	27463.87	783	N/A	4.07	299	0	0	0
13512	Western	N/A	3.5	433	47310.77	443	N/A	8.04	1379	28578.15	215	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.51	2.41	0	0	0	1.1	4	0	0	-18.62%	6.47
0	Yes	0.77	0.77	0	0	0	0	0	0	0	-11.36%	4.29
0	Yes	3.33	1.67	0	0	0	1.66	4	10801.2	48	-1.05%	6.6
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	1.84	0.21	0	0	0	1.63	7	0	0	-17.12%	6.05
0	Yes	3.6	1.31	0	0	0	2.29	62	0	0	-5.71%	7.26
0	Yes	2.01	1.19	0	0	0	0.82	4	0	0	16.25%	3.72
0	Yes	2.81	1.36	0	0	0	1.45	39	0	0	13.80%	5.69
0	Yes	4.36	1.74	0	0	0	2.62	29	99431.38	1417	0.64%	4.73
0	Yes	1.69	1.38	0	0	0	0.31	2	3073.567	130	8.44%	4.88
0	Yes	4.2	0.83	0	0	0	3.37	47	0	0	21.08%	8.96
0	Yes	1.96	0.07	0	0	0	1.89	36	0	0	2.83%	6.17
0	Yes	2.32	0.39	0	0	0	1.93	85	0	0	2.80%	5.14
0	Yes	2.27	0.29	0	0	0	1.98	36	0	0	-0.61%	6.56

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13513	Western	N/A	0.85	26	3191.367	17	N/A	1.61	246	63.85	1	0
13514	Western	N/A	1.3	155	5216.917	92	N/A	5.24	456	0	0	0
13516	Western	N/A	3.75	467	1567.5	8	N/A	5.01	379	10796.58	66	0
13517	Western	N/A	4.08	427	47736.78	408	N/A	3.5	1019	10948.27	165	0
13518	Western	N/A	0.27	25	120.367	1	N/A	0.2	3	0	0	0
13519	Western	N/A	0.67	33	0	0	N/A	0.12	89	0	0	0
13520	Western	N/A	0.7	83	124.367	2	N/A	4.06	451	0	0	0
13521	Western	N/A	0.01	0	0	0	N/A	1.89	24	0	0	0
13522	Western	N/A	9.58	1231	28759.82	302	N/A	0.76	378	0	0	0
13523	Western	N/A	4.63	532	8332.267	22	N/A	1.84	971	0	0	0
13524	Western	N/A	0.94	120	0	0	N/A	1.25	101	0	0	0
13526	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13530	Western	N/A	5.42	876	9943.383	69	N/A	0	0	0	0	0
13531	Western	N/A	2.15	47	645.583	8	N/A	5.02	180	943.933	2	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.95	0.56	0	0	0	0.39	8	0	0	12.00%	3.92
0	Yes	3.63	0.32	0	0	0	3.31	42	0	0	23.33%	4.44
0	Yes	1.89	0.12	0	0	0	1.77	74	91899.47	1842	-46.14%	4.74
0	Yes	1.87	0.07	0	0	0	1.8	36	0	0	3.38%	6.72
0	Yes	1.39	0.37	0	0	0	1.02	59	0	0	-4.22%	4.31
0	Yes	1.03	0.02	0	0	0	1.01	63	0	0	-5.00%	0.76
0	Yes	2.24	0.53	0	0	0	1.71	56	0	0	11.32%	4.23
0	Yes	0.75	0.33	0	0	0	0.42	12	0	0	27.14%	4.45
0	Yes	1.87	0.69	0	0	0	1.18	158	0	0	-19.44%	5.8
0	Yes	2.06	0.1	0	0	0	1.96	261	0	0	-28.13%	4.6
0	Yes	1.26	0.33	0	0	0	0.93	71	0	0	-15.00%	7.82
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	0.85	0.18	0	0	0	0.67	0	0	0	-7.03%	3.44
0	Yes	3.16	0.95	0	0	0	2.21	41	9883.667	331	106.36%	4.54

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13532	Western	N/A	4.26	346	53387.23	247	N/A	1.02	77	0	0	0
13533	Western	N/A	2.36	253	602.183	36	N/A	9.09	1566	26031.73	172	0
13535	Western	N/A	4.75	270	82093.25	1044	N/A	16.19	1871	10191.83	62	0
13538	Western	N/A	0.23	5	379.317	2	N/A	14.02	909	13533.92	133	0
13539	Western	N/A	0.62	11	9585.067	161	N/A	12.99	1069	0	0	0
13540	Western	N/A	0.2	4	0	0	N/A	6.73	700	0	0	0
13541	Western	N/A	0	0	638.817	2	N/A	15	1001	20508.33	182	0
13544	Western	N/A	0.49	30	0	0	N/A	5.17	706	2511.333	20	0
13546	Central	N/A	6.52	303	269.183	5	N/A	3.2	54	0	0	0
13547	Central	N/A	3.99	309	37201.62	325	N/A	1.78	221	421.4	4	0
13551	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13552	Central	N/A	2.79	47	0	0	N/A	1.32	20	0	0	0
13553	Central	N/A	0	2	0	0	N/A	1.21	1	0	0	0
13554	Central	N/A	0	0	0	0	N/A	0	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.94	0.04	0	0	0	1.9	53	2757.117	488	91.35%	9.95
0	Yes	2.99	0.07	0	0	0	2.92	93	0	0	13.21%	6.34
0	Yes	2.16	0.08	0	0	0	2.08	90	0	0	4.05%	8.22
0	Yes	2.41	1.07	1	0	0	1.34	11	0	0	4.13%	6.56
0	Yes	2.02	0.12	0	0	0	1.9	8	52682.17	1078	29.74%	5.06
0	Yes	1.96	0.08	0	0	0	1.88	4	0	0	6.92%	2.78
0	Yes	1.54	1.54	0	60218.65	997	0	0	0	0	-1.32%	5.23
0	Yes	2.09	0.12	0	0	0	1.97	10	0	0	-6.45%	2.9
0	Yes	5.25	0.96	1	0	0	4.29	78	18538.25	435	-6.69%	8.79
0	Yes	3.51	0.15	0	0	0	3.36	72	0	0	2.66%	4.63
0	Yes	0.37	0.11	0	0	0	0.26	0	0	0	-8.00%	0.46
0	Yes	1.9	0.05	0	0	0	1.85	4	0	0	-1.34%	5.17
0	Yes	0.6	0.6	0	0	0	0	0	0	0	-29.84%	4.02
0	Yes	0.34	0.34	0	0	0	0	0	0	0	38.25%	3.94

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13560	Central	N/A	0	0	0	0	0	0.16	0	0	0	0
13561	Central	N/A	0	0	0	0	0	0.15	0	0	0	0
13562	Central	N/A	0	0	0	0	0	0.44	0	0	0	0
13563	Central	N/A	0	0	0	0	0	0.36	0	0	0	0
13564	Central	N/A	0	0	0	0	0	0.57	361	0	0	0
13565	Central	N/A	0	0	0	0	0	0.39	1	0	0	0
13566	Central	N/A	0	0	0	0	0	1.45	612	0	0	0
13567	Central	N/A	0	0	243.533	2	N/A	0.04	505	0	0	0
13572	Western	N/A	0.76	68	6742.017	62	N/A	9.26	950	8117.333	41	0
13573	Western	N/A	0.46	5	11754.38	70	N/A	10.74	1052	7779.483	65	0
13574	Western	N/A	2.81	232	4818.4	20	N/A	6.02	606	6467.6	69	0
13575	Western	N/A	0.35	6	22366.65	355	N/A	6.01	599	0	0	0
13576	Eastern	N/A	2.89	222	3670.533	34	N/A	14.59	1446	34519.9	305	0
13577	Eastern	N/A	3.09	224	2196.6	8	N/A	9.16	740	3010.45	11	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.33	2.33	0	0	0	0	0	0	0	-1.03%	1.92
0	Yes	3.96	3.96	0	0	0	0	0	0	0	8.81%	2.47
0	Yes	3.11	3.11	0	0	0	0	0	0	0	-2.90%	2.68
0	Yes	2.24	2.24	0	0	0	0	0	0	0	-0.45%	2.2
0	Yes	2.16	2.16	0	0	0	0	0	0	0	-3.50%	3.31
0	Yes	2.73	2.73	0	0	0	0	0	0	0	-5.94%	2.06
0	Yes	1.14	1.14	0	0	0	0	0	0	0	18.33%	1.42
0	Yes	1.11	1.11	0	0	0	0	0	0	0	11.25%	0.89
0	Yes	1.13	0.21	0	0	0	0.92	8	0	0	0.54%	3.72
0	Yes	1.02	0.27	0	0	0	0.75	5	0	0	2.22%	4.6
0	Yes	1.78	0.04	0	0	0	1.74	54	0	0	5.25%	4.21
0	Yes	1.04	0.12	0	0	0	0.92	17	0	0	6.80%	2.67
0	Yes	4.8	0.4	0	0	0	4.4	146	176746.9	3615	2.50%	7.79
0	Yes	3.35	0.02	0	0	0	3.33	93	0	0	5.65%	4.86

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13579	Eastern	N/A	6.16	189	4599.883	59	N/A	18.07	1391	29000.4	231	0
13582	Western	N/A	5.83	178	39156.62	745	N/A	16.58	1126	77447.37	609	0
13583	Western	N/A	4.58	118	625.117	14	N/A	6.52	380	0	0	0
13584	Western	N/A	0.19	1	19301.65	109	N/A	10.34	948	33715.47	299	0
13585	Western	N/A	0.51	17	0	0	N/A	7.13	1402	0	0	0
13586	Western	N/A	4.37	97	1108.45	14	N/A	20.88	1172	25984.33	216	0
13587	Western	N/A	1.53	5	23519.22	175	N/A	14.42	2246	49874.92	424	0
13589	Western	N/A	0.15	4	0	0	N/A	11.53	1334	18882.38	77	0
13590	Central	N/A	2.72	330	117985	1601	N/A	4.04	1228	3033.8	50	0
13591	Central	N/A	7.95	1061	27359.82	172	N/A	2.44	609	8916.4	102	0
13592	Central	N/A	6.29	1024	4251.65	51	N/A	2.55	161	0	0	0
13593	Central	N/A	4.55	536	83.6	3	N/A	1.4	129	0	0	0
13598	Central	N/A	0	0	0	0	N/A	0.02	0	0	0	0
13600	Central	N/A	6.16	607	86227.97	1321	N/A	1.78	501	5.867	1	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.36	0.15	0	0	0	3.21	87	0	0	3.03%	7.83
0	Yes	5.81	2.05	1	0	0	3.76	35	3852.133	1336	5.00%	9.66
0	Yes	3.1	0.22	0	0	0	2.88	10	0	0	3.27%	5.06
0	Yes	2.14	0.05	0	0	0	2.09	7	0	0	-54.02%	4.46
0	Yes	1.65	0.44	0	0	0	1.21	9	0	0	-0.82%	6.05
0	Yes	3.5	0.86	0	0	0	2.64	29	38539.83	1299	2.21%	6.95
0	Yes	2.85	1.05	0	0	0	1.8	6	0	0	-0.68%	7.35
0	Yes	4.98	2.2	0	0	0	2.78	8	0	0	-19.33%	7.18
0	Yes	3.29	0.03	0	6973.617	1667	3.26	177	16771.35	1713	6.39%	6.49
0	Yes	3.76	0.12	0	0	0	3.64	255	0	0	3.89%	6.41
0	Yes	2.06	0.16	0	0	0	1.9	107	0	0	-25.30%	5.52
0	Yes	2.56	0.14	0	0	0	2.42	117	0	0	54.55%	3.91
0	Yes	1.82	1.82	0	0	0	0	0	117.133	2	100.00%	1.18
0	Yes	1.52	0.14	0	0	0	1.38	60	11484	1160	0.74%	6.8

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13601	Central	N/A	5.8	645	189862.5	1582	N/A	5.25	1018	9223.617	54	0
13605	Western	N/A	2.65	353	49476.52	237	N/A	1.76	295	2655.8	14	0
13606	Western	N/A	0.75	25	1396.8	9	N/A	0.39	191	0	0	0
13607	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13608	Western	N/A	0	0	0	0	N/A	0	2	0	0	0
13610	Western	N/A	5.79	648	98.55	2	N/A	1.68	668	12620.83	47	0
13611	Western	N/A	3.27	366	10081.27	162	N/A	0.59	400	0	0	0
13612	Western	N/A	7.42	836	4974.417	78	N/A	1.77	393	34251.67	179	0
13613	Western	N/A	5.37	726	16061.35	119	N/A	0.86	285	0	0	0
13614	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13621	Western	N/A	15.6	410	17610.63	158	N/A	4.17	78	3631.017	23	0
13622	Western	N/A	20.37	760	631176.8	3008	N/A	13.15	679	0	0	0
13624	Western	N/A	15.74	370	36754.82	1272	N/A	11.08	292	5964.833	47	0
13630	Central	N/A	5.79	682	35644.73	272	N/A	1.73	303	69692.67	107	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.06	0.05	0	0	0	2.01	116	99924.33	2934	100.00%	5.49
0	Yes	0.83	0.2	0	0	0	0.63	18	0	0	-3.20%	2.42
0	Yes	1.44	0.05	0	0	0	1.39	71	0	0	-22.14%	1.09
0	Yes	0	0	0	0	0	0	0	0	0	-0.43%	9.26
0	Yes	0	0	0	1170.067	2	0	0	0	0	6.67%	14.4
0	Yes	1.24	0.23	0	35956.67	1340	1.01	46	289519.2	2696	1.21%	5.87
0	Yes	0.9	0.16	0	0	0	0.74	17	0	0	14.35%	2.63
0	Yes	1.37	0.14	0	0	0	1.23	42	0	0	8.40%	5.42
0	Yes	1.49	0.26	0	0	0	1.23	91	0	0	-5.26%	3.6
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	3.1	0.02	0	0	0	3.08	32	0	0	0.74%	2.72
0	Yes	2.07	0.06	0	0	0	2.01	9	80920.85	1459	-7.22%	9
0	Yes	3.87	0.04	0	0	0	3.83	52	23454.68	1131	3.33%	4.34
0	Yes	3.71	0.36	0	0	0	3.35	227	0	0	1.34%	6.04

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13631	Central	N/A	5.46	422	29601.62	590	N/A	10.05	942	19862.45	161	0
13632	Central	N/A	5.26	466	20327.38	209	N/A	0.56	120	0	0	0
13633	Central	N/A	1.54	82	692.7	16	N/A	7.92	911	19308.68	91	0
13635	Western	N/A	0.05	0	0	0	N/A	2.6	25	383.4	4	0
13636	Western	N/A	0.04	1	0	0	N/A	0.54	8	34.067	2	0
13637	Western	N/A	0.69	48	93.8	1	N/A	1.4	93	246.8	1	0
13638	Western	N/A	2.11	202	2582.867	53	N/A	0.85	134	383.05	1	0
13639	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
13640	Western	N/A	0	0	0	0	N/A	2.18	8	0	0	0
13641	Western	N/A	0	0	0	0	N/A	1.23	18	0	0	0
13642	Western	N/A	0	0	0	0	N/A	0.25	5	0	0	0
13643	Western	N/A	0	0	0	0	N/A	1.58	11	0	0	0
13645	South Hillsborough	N/A	1.67	21	0	0	N/A	20.29	1832	80.917	1	0
13646	South Hillsborough	N/A	0.16	1	0	0	N/A	17.77	1710	11321.77	42	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.29	0.32	0	0	0	1.97	90	114431.5	1943	0.00%	7.1
0	Yes	2.15	0.09	0	0	0	2.06	98	0	0	1.54%	2.64
0	Yes	3.92	0.31	0	0	0	3.61	132	0	0	-5.90%	5.74
0	Yes	2.94	1.52	0	0	0	1.42	14	0	0	14.78%	5.28
0	Yes	1.87	0.73	0	0	0	1.14	3	0	0	8.48%	4.99
0	Yes	3.17	1.63	0	0	0	1.54	31	0	0	-55.48%	1.87
0	Yes	2.11	0.51	0	0	0	1.6	45	0	0	11.90%	2.35
0	Yes	0.42	0.42	0	0	0	0	0	0	0	0.00%	0
0	Yes	3.39	3.39	0	312.7	2	0	0	907.4	6	12.73%	4.96
0	Yes	3.6	3.6	0	0	0	0	0	0	0	-1.58%	1.87
0	Yes	3.25	3.25	0	0	0	0	0	0	0	37.14%	4.8
0	Yes	6.76	6.76	0	0	0	0	0	0	0	119.17%	2.63
0	Yes	5.2	2.77	9	0	0	2.43	20	0	0	20.32%	7.46
0	Yes	4.73	1.59	0	0	0	3.14	8	0	0	18.95%	9.04

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13647	South Hillsborough	N/A	1.28	72	0	0	N/A	22.41	1905	0	0	0
13648	South Hillsborough	N/A	16.29	370	23607.82	336	N/A	18.1	915	0	0	0
13649	South Hillsborough	N/A	5.01	325	8501.233	115	N/A	2.68	265	0	0	0
13650	South Hillsborough	N/A	0	0	0	0	N/A	10.3	1009	362.9	1	0
13651	South Hillsborough	N/A	3.2	152	7155.2	96	N/A	14.59	1663	3624.917	17	0
13652	South Hillsborough	N/A	3.5	195	136	2	N/A	11.22	846	2758.433	37	0
13655	Plant City	N/A	7.36	281	3446.967	46	N/A	7.1	705	1094.583	5	0
13656	Plant City	N/A	39.26	1142	43911.1	611	N/A	9.53	584	73290.07	444	0
13657	Plant City	N/A	11.06	275	872.667	17	N/A	2.61	153	778.517	9	0
13659	Winter Haven	N/A	3.7	98	28525.38	1223	N/A	14.84	1099	20424.52	115	0
13660	Winter Haven	N/A	2.28	37	4877.25	45	N/A	6	583	11617	20	0
13661	Winter Haven	N/A	6.66	336	11431.37	161	N/A	22.73	1623	507.917	7	0
13668	Plant City	N/A	9.28	283	1219.233	13	N/A	21.45	1542	4534.75	63	0
13669	Western	N/A	1.4	104	57.267	1	N/A	13.99	1173	5742.683	71	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	4.74	3.97	0	0	0	0.77	14	0	0	100.00%	10.31
0	Yes	6.96	1.83	0	0	0	5.13	97	155707	1374	5.42%	7.59
0	Yes	1.72	0.12	7	0	0	1.6	44	0	0	20.00%	3.12
0	Yes	3.43	2.21	0	0	0	1.22	2	0	0	-38.63%	4.91
0	Yes	6.51	1.75	0	0	0	4.76	49	0	0	11.46%	9.92
0	Yes	3.51	1.96	0	0	0	1.55	14	84437.5	1050	-60.09%	4.63
0	Yes	3.23	0.08	0	0	0	3.15	68	0	0	10.77%	4.32
0	Yes	8.89	0.35	0	0	0	8.54	152	92402.48	1867	8.51%	9.44
0	Yes	3.89	0.18	0	0	0	3.71	106	59961.3	988	-34.74%	2.48
0	Yes	4.57	0.99	0	0	0	3.58	80	113832.7	1214	6.35%	5.53
0	Yes	4.37	1.68	0	0	0	2.69	5	0	0	-36.15%	3.32
0	Yes	5.59	1.98	0	0	0	3.61	46	127567.6	1998	9.26%	10.38
0	Yes	3.17	2.05	8	0	0	1.12	26	0	0	-4.65%	9.44
0	Yes	2.62	0.61	16	0	0	2.01	46	0	0	-0.18%	5.59

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13670	Western	N/A	0.44	2	11675.02	67	N/A	8.64	611	16325.57	98	0
13671	Western	N/A	0.11	0	2912	45	N/A	13.2	1735	26807.05	193	0
13672	Western	N/A	2.45	109	13095.82	136	N/A	15.19	2703	35230.98	166	0
13673	Western	N/A	0.14	0	235.833	1	N/A	14.69	1206	0	0	0
13674	Western	N/A	0.15	0	264.7	2	N/A	9.96	1067	0	0	0
13677	Western	N/A	4.74	90	2188.45	759	N/A	21.68	1072	5569	19	0
13678	Western	N/A	1.87	65	133.533	1	N/A	22.63	2442	2473.433	34	0
13679	Western	N/A	9.26	343	113997.9	2678	N/A	17.33	885	4770.983	26	0
13685	Eastern	N/A	2.36	103	7081.917	370	N/A	17.93	1283	30735.03	110	0
13686	Eastern	N/A	3.1	101	12654.65	37	N/A	16.3	1229	8610.533	24	0
13687	Eastern	N/A	15.49	524	39068.97	224	N/A	13.98	1015	6259.067	54	0
13690	Eastern	N/A	1.75	88	8306.833	84	N/A	11.54	772	0	0	0
13691	Eastern	N/A	0.89	28	39734.92	614	N/A	11	876	7958.483	67	0
13692	Eastern	N/A	1.09	21	6213.2	66	N/A	6.68	634	25140.28	184	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.9	0.11	0	0	0	0.79	1	0	0	9.23%	2.84
0	Yes	3.12	1.67	0	0	0	1.45	20	0	0	5.83%	6.35
0	Yes	4.36	0.84	0	0	0	3.52	17	174490.4	2910	-2.65%	8.08
0	Yes	4.1	1.95	0	0	0	2.15	10	0	0	-11.21%	5.86
0	Yes	5.07	2.25	2	0	0	2.82	10	0	0	10.47%	4.75
0	Yes	7.19	4.46	1	0	0	2.73	16	0	0	24.62%	8.1
0	Yes	3.73	0.91	0	0	0	2.82	14	64106.28	2558	9.87%	8.24
0	Yes	4.84	0.48	0	0	0	4.36	73	63017.8	1294	-3.30%	9.38
0	Yes	4.65	1.9	0	0	0	2.75	63	0	0	-17.36%	8.76
0	Yes	2.78	0.13	0	0	0	2.65	59	82710.67	1360	8.59%	8.47
0	Yes	7.25	0.22	0	0	0	7.03	190	45412.47	1718	5.63%	9.19
0	Yes	2.76	1.2	0	0	0	1.56	24	0	0	0.85%	5.95
0	Yes	3.41	0.86	0	0	0	2.55	14	0	0	-3.57%	5.4
0	Yes	2.17	0.12	0	0	0	2.05	14	0	0	-0.97%	3.07

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Sectionalizing Devices on the Lateral
13693	Eastern	N/A	4.92	191	1378.75	17	N/A	7.49	624	0	0	0
13695	Winter Haven	N/A	9.34	689	2443.533	43	N/A	17.22	1126	0	0	0
13696	Winter Haven	N/A	13.54	1280	138686.4	1511	N/A	1.78	102	57.017	1	0
13697	Winter Haven	N/A	14.04	674	8888.717	79	N/A	2.9	63	0	0	0
13698	Winter Haven	N/A	16.92	1043	90823.48	936	N/A	2.47	23	0	0	0
13699	Winter Haven	N/A	5.28	274	19057.82	404	N/A	12.4	1028	4182.95	12	0
13705	Eastern	N/A	8.68	495	21014.53	270	N/A	11.91	997	37697.4	198	0
13706	Eastern	N/A	3.81	184	29439.08	173	N/A	10.95	1500	8349.55	141	0
13707	Eastern	N/A	1.19	56	723.75	11	N/A	8.38	1092	12786.9	126	0
13708	Eastern	N/A	1.18	47	52541.8	559	N/A	14.11	1751	0	0	0
13709	Eastern	N/A	6.21	551	17164.93	210	N/A	8.13	611	37.35	1	0
13710	Eastern	N/A	6.23	291	27593.08	1691	N/A	16.39	2356	23983.6	214	0
13711	Eastern	N/A	1.24	11	3091.233	37	N/A	17.76	2717	1822.7	33	0
13712	Eastern	N/A	8.5	422	3173.883	44	N/A	6.2	554	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.69	0.99	0	0	0	2.7	63	117017.9	1759	-2.45%	5.17
0	Yes	3.17	0.04	0	0	0	3.13	99	0	0	23.75%	9.9
0	Yes	4.57	0.14	0	0	0	4.43	197	422804.6	5408	-2.09%	8.42
0	Yes	3.45	0.62	0	0	0	2.83	65	9462.367	758	6.21%	3.08
0	Yes	5.45	0.66	0	0	0	4.79	104	172902.6	1154	11.38%	7.24
0	Yes	2.03	0.51	0	0	0	1.52	14	225205.8	1311	14.88%	4.71
0	Yes	3.24	0.14	0	0	0	3.1	54	0	0	1.14%	7.08
0	Yes	2.77	0.2	0	133670.8	1750	2.57	59	0	0	2.11%	7.76
0	Yes	3.43	0.92	0	0	0	2.51	17	0	0	-1.60%	4.92
0	Yes	4.08	0.73	0	0	0	3.35	23	0	0	1.46%	8.32
0	Yes	2.64	0.12	0	0	0	2.52	51	3477.267	1213	-0.41%	4.88
0	Yes	3.12	0.23	0	0	0	2.89	65	282285.5	2734	-0.10%	10.19
0	Yes	4.29	1.04	0	117139.3	2739	3.25	13	0	0	-0.90%	9.91
0	Yes	5.74	0.93	0	0	0	4.81	127	2693.6	1092	2.78%	5.55

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13713	Central	N/A	0	0	0	0	N/A	0.04	1	0	0	0
13714	Central	N/A	0.47	6	9624.083	80	N/A	15.74	3348	0	0	0
13715	Central	N/A	0.61	5	4723.5	101	N/A	10.74	3261	4653.733	11	0
13716	Central	N/A	0.02	0	0	0	N/A	7.11	578	0	0	0
13717	Central	N/A	1.86	6	869.017	208	N/A	8.86	537	13067.65	113	0
13718	Central	N/A	0.01	0	1774.9	27	N/A	18.92	1070	6919.95	22	0
13719	Central	N/A	0.23	0	0	0	N/A	26.57	1437	71.583	1	0
13722	Plant City	N/A	9.67	401	3660.85	120	N/A	2.77	75	0	0	0
13723	Plant City	N/A	14.69	403	39485.52	575	N/A	4.07	203	0	0	0
13724	Plant City	N/A	27.6	743	211426.3	2356	N/A	17.17	598	10828.53	36	0
13729	Eastern	N/A	2.02	37	6959	68	N/A	10.72	931	8164.067	18	0
13731	Eastern	N/A	0.1	1	0	0	N/A	11.25	894	14541.07	95	0
13732	Eastern	N/A	0.1	21	0	0	N/A	16.58	1249	12014.12	107	0
13733	Eastern	N/A	1.77	2	86.05	1	N/A	26.59	1965	6339.583	67	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.25	0.07	0	0	0	0.18	0	0	0	0.00%	0.01
0	Yes	5.02	2.3	0	0	0	2.72	28	0	0	-0.33%	8.97
0	Yes	5.24	2.19	1	0	0	3.05	39	0	0	6.00%	7.95
0	Yes	4.38	0.78	0	0	0	3.6	59	0	0	-0.66%	3.02
0	Yes	5.37	2.28	0	0	0	3.09	14	0	0	8.21%	5.8
0	Yes	3.96	2.87	0	0	0	1.09	0	0	0	-1.37%	6.46
0	Yes	4.22	1.95	0	0	0	2.27	15	0	0	15.26%	6.57
0	Yes	3.46	0.02	0	0	0	3.44	82	0	0	-7.61%	6.19
0	Yes	4.5	0.07	0	0	0	4.43	48	0	0	4.50%	4.18
0	Yes	6.36	0.22	16	0	0	6.14	136	0	0	4.65%	7.43
0	Yes	2.56	0.07	0	0	0	2.49	11	0	0	3.51%	5.9
0	Yes	2.85	1.63	0	0	0	1.22	2	0	0	-18.08%	4.26
0	Yes	1.92	1.78	0	0	0	0.14	0	0	0	0.26%	7.72
0	Yes	6.08	3.4	0	0	0	2.68	14	0	0	6.70%	10.67

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13737	Western	N/A	3.45	453	2617.633	21	N/A	1.29	138	0	0	0
13738	Western	N/A	1.69	162	25062.4	388	N/A	2.37	489	20.7	1	0
13739	Western	N/A	0.83	44	346.533	1	N/A	0.83	121	0	0	0
13740	Western	N/A	10.34	1327	43794.43	301	N/A	0.19	4	0	0	0
13741	Western	N/A	0.04	1	0	0	N/A	0.51	369	0	0	0
13742	Western	N/A	0	0	0	0	N/A	0.23	77	0	0	0
13743	Western	N/A	2.81	311	0	0	N/A	0.69	529	0	0	0
13745	Western	N/A	0.63	27	15016.28	876	N/A	16.32	1809	55504.37	415	0
13747	Western	N/A	1.35	133	5292.9	73	N/A	2.69	474	29003	168	0
13748	Western	N/A	4.28	372	9803.383	57	N/A	7.92	759	11444.75	213	0
13749	Western	N/A	1.78	201	1057.833	6	N/A	9.73	1239	11002.25	55	0
13750	Western	N/A	1.52	75	1413.433	13	N/A	6.26	671	12301.87	35	0
13753	Western	N/A	3.92	606	3989.767	52	N/A	0.09	10	0	0	0
13754	Western	N/A	7.3	1187	193808	1380	N/A	1.05	268	5927.95	51	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.56	0.35	0	0	0	2.21	169	0	0	-1.59%	4.33
0	Yes	2.41	0.96	7	0	0	1.45	77	0	0	6.83%	6.41
0	Yes	1.45	0.45	0	0	0	1	18	0	0	-6.67%	2.8
0	Yes	1.38	0.3	0	0	0	1.08	80	52089.42	1411	10.70%	6.31
0	Yes	0.55	0.55	0	0	0	0	0	0	0	34.58%	3.23
0	Yes	0.32	0.32	0	0	0	0	0	0	0	0.00%	0.5
0	Yes	3.04	1.67	0	0	0	1.37	210	9775.85	159	100.00%	3.38
0	Yes	2.95	0.42	0	0	0	2.53	21	0	0	1.01%	6.97
0	Yes	1.56	0.22	0	0	0	1.34	33	0	0	0.88%	3.43
0	Yes	3.79	0.39	0	0	0	3.4	62	140328.4	2373	-1.39%	7.1
0	Yes	2.14	0.31	0	0	0	1.83	35	0	0	0.00%	5.5
0	Yes	1.71	0.32	0	0	0	1.39	11	0	0	-17.38%	3.47
0	Yes	1.88	0.03	0	0	0	1.85	176	0	0	16.92%	4.56
0	Yes	0.85	0.14	3	0	0	0.71	56	0	0	-36.19%	6.7

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13756	Western	N/A	2.33	799	98233.8	988	N/A	1.35	923	0	0	0
13761	Western	N/A	0.34	5	539.133	30	N/A	1.71	1047	0	0	0
13762	Western	N/A	0.16	5	0	0	N/A	1.93	33	0	0	0
13763	Western	N/A	0	0	0	0	N/A	0.03	0	0	0	0
13764	Western	N/A	0.16	2	284.617	4	N/A	1.3	473	0	0	0
13765	Western	N/A	0	0	0	0	N/A	0.52	4	0	0	0
13766	Western	N/A	0	0	0	0	N/A	1.24	17	0	0	0
13769	Winter Haven	N/A	15.7	354	21800.08	229	N/A	25.45	1900	7060.6	42	0
13770	Winter Haven	N/A	3.18	177	59365.32	605	N/A	29.54	1963	11476.63	74	0
13772	Winter Haven	N/A	5.96	277	61626.05	645	N/A	5.88	53	7447.6	22	0
13777	South Hillsborough	N/A	2.12	251	15720.6	119	N/A	12.42	803	31653.8	177	0
13780	South Hillsborough	N/A	6.83	658	7267.417	243	N/A	9.79	759	25789.67	142	0
13781	South Hillsborough	N/A	0.23	18	0	0	N/A	0.7	69	0	0	0
13785	Plant City	N/A	24.06	375	149766.2	1346	N/A	36.03	394	1013.167	8	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.61	0.37	0	0	0	1.24	110	129821	3463	24.49%	6.1
0	Yes	1.61	0.65	0	0	0	0.96	15	82306.75	1065	14.29%	3.2
0	Yes	3.03	2.02	0	0	0	1.01	15	0	0	-13.04%	4.87
0	Yes	0.53	0.53	0	0	0	0	0	93.033	2	12.96%	3.05
0	Yes	0.88	0.13	0	0	0	0.75	10	0	0	-1.06%	4.65
0	Yes	0.85	0.85	12	0	0	0	0	0	0	-6.11%	1.69
0	Yes	2.43	2.43	0	0	0	0	0	0	0	17.33%	1.76
0	Yes	7.46	1.76	0	0	0	5.7	45	0	0	21.23%	9.82
0	Yes	4.92	0.87	0	0	0	4.05	115	0	0	16.11%	10.45
0	Yes	7.51	3.86	0	0	0	3.65	15	0	0	3.21%	2.89
0	Yes	4.72	2.36	0	0	0	2.36	112	43176.6	1156	12.13%	6.84
0	Yes	2.48	0.55	0	71656.5	1481	1.93	78	53949.35	1491	10.56%	7.96
0	Yes	1.11	0.18	0	0	0	0.93	11	0	0	-2.99%	6.5
0	Yes	9.09	6.07	0	0	0	3.02	39	41538	504	16.67%	4.9

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13786	Plant City	N/A	44.08	794	16062.57	122	N/A	3.7	37	0	0	0
13787	Plant City	N/A	41.79	861	33891.55	912	N/A	10.01	154	139,333	1	0
13793	Eastern	N/A	3.76	199	37817.07	473	N/A	12.87	1438	28628.12	175	0
13795	Eastern	N/A	4.09	145	50165.45	536	N/A	17.7	1281	14416.1	106	0
13796	Eastern	N/A	6.77	141	31782.27	318	N/A	10.84	1336	25205.85	206	0
13797	Eastern	N/A	4.28	173	3088.2	63	N/A	18.77	1287	8282.85	69	0
13798	Eastern	N/A	3.51	185	8793.5	78	N/A	10.01	1062	5434.55	73	0
13799	Eastern	N/A	2.6	113	1629.683	11	N/A	11.55	1710	9193.6	94	0
13805	Plant City	N/A	47.65	1103	39756.83	3371	N/A	5.52	91	13989.78	24	0
13807	Plant City	N/A	34.04	1004	37679.5	250	N/A	3.76	91	111,533	1	0
13808	Plant City	N/A	100.52	1806	149865.2	1346	N/A	7.48	134	6482.9	91	0
13813	Dade City	N/A	44.72	742	68372.08	469	N/A	9.57	146	601,133	4	0
13815	Dade City	N/A	38.04	525	22995.95	601	N/A	14.42	158	3335,467	20	0
13817	South Hillsborough	N/A	13.88	747	7369.65	54	N/A	13.66	1258	60.65	1	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	5.77	0.56	0	0	0	5.21	94	0	0	12.05%	4.37
0	Yes	8.92	0.34	0	0	0	8.58	142	0	0	1.88%	7.03
0	Yes	3.14	0.77	0	0	0	2.37	54	0	0	1.39%	7.3
0	Yes	3.54	0.14	0	0	0	3.4	59	48.95	2	3.88%	8.31
0	Yes	3.38	0.54	0	0	0	2.84	39	175782.8	1676	-0.56%	5.37
0	Yes	3.57	0.35	0	0	0	3.22	65	0	0	-1.65%	8.95
0	Yes	2.09	0.25	0	0	0	1.84	25	0	0	1.03%	6.87
0	Yes	2.78	0.29	0	0	0	2.49	46	0	0	0.59%	6.84
0	Yes	5.66	0.03	0	0	0	5.63	93	0	0	10.88%	6.32
0	Yes	7.97	0.1	0	0	0	7.87	172	0	0	8.17%	6.49
0	Yes	16.86	0.24	0	0	0	16.62	175	0	0	8.43%	9
0	Yes	5.13	0.03	0	0	0	5.1	52	123066.8	2783	-0.27%	3.69
0	Yes	6.32	0.26	0	0	0	6.06	28	0	0	1.00%	3.03
0	Yes	6.6	1.16	22	0	0	5.44	115	0	0	10.88%	7.54

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13818	South Hillsborough	N/A	1.07	10	0	0	0	N/A	13.46	1167	0	0
13819	South Hillsborough	N/A	0.51	3	849.583	4	N/A	1.49	84	0	0	0
13820	South Hillsborough	N/A	2.75	67	90.75	1	N/A	1.78	125	2028.567	38	0
13822	South Hillsborough	N/A	1.81	45	2063.917	37	N/A	19.86	1530	0	0	0
13823	Central	N/A	0	0	0	0	N/A	0.01	0	0	0	0
13825	Central	N/A	7.13	765	193689.7	798	N/A	2.12	618	0	0	0
13826	Central	N/A	3.62	216	139576.1	2685	N/A	6.79	1589	2856	14	0
13827	Central	N/A	3.99	355	26896.63	240	N/A	3.41	388	16751.25	135	0
13828	Central	N/A	5.74	457	13120.6	170	N/A	3.78	976	0	0	0
13829	Central	N/A	1.03	40	3123.1	36	N/A	8.34	787	17605.1	156	0
13830	Central	N/A	3.69	293	7262.417	32	N/A	5.19	297	7201.8	27	0
13831	Central	N/A	0.36	108	733.95	12	N/A	5.87	1086	12258.17	148	0
13832	Central	N/A	2.98	250	42372.57	117	N/A	1.37	147	3671.6	40	0
13833	Central	N/A	0	0	0	0	N/A	0.02	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	5.79	1.71	2	0	0	4.08	6	0	0	20.22%	5.41
0	Yes	2.74	0.83	0	0	0	1.91	4	0	0	8.46%	1.41
0	Yes	2.69	1.54	0	0	0	1.15	11	12831.12	371	5.00%	1.26
0	Yes	5.78	3.8	29	0	0	1.98	18	0	0	7.02%	6.1
0	Yes	0.49	0.22	0	0	0	0.27	0	0	0	1737.50%	1.47
0	Yes	2.58	0.02	0	0	0	2.56	166	0	0	3.73%	6.12
0	Yes	4.29	1.69	0	0	0	2.6	108	0	0	-0.19%	5.38
0	Yes	1.14	0.03	0	0	0	1.11	56	0	0	5.65%	3.55
0	Yes	1.7	0.15	0	0	0	1.55	35	0	0	6.62%	7.09
0	Yes	3.27	0.05	0	0	0	3.22	19	26155.15	846	-1.82%	3.78
0	Yes	3.63	0.66	0	0	0	2.97	65	0	0	3.33%	4.03
0	Yes	1.45	0.03	0	0	0	1.42	73	0	0	-4.32%	3.54
0	Yes	1.51	0.9	0	0	0	0.61	13	0	0	7.41%	2.32
0	Yes	0.07	0.07	0	0	0	0	1	0	0	-39.35%	3.53

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13834	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
13835	Central	N/A	4.17	454	36628.62	304	N/A	5.66	817	0	0	0
13836	Central	N/A	3.47	155	14116.57	621	N/A	15.63	558	9990.717	86	0
13837	Central	N/A	4.01	428	11870.68	89	N/A	7.58	612	7179.333	70	0
13838	Central	N/A	9.25	631	30630.68	399	N/A	6.59	1000	2881.1	79	0
13839	Central	N/A	6.77	323	3640.317	67	N/A	17.19	827	0	0	0
13840	Central	N/A	6.94	310	9606	111	N/A	10.15	1543	64.75	1	0
13843	Central	N/A	0.22	3	0	0	N/A	0.17	2	0	0	0
13844	Central	N/A	0.14	4	536.05	3	N/A	2.78	729	0	0	0
13845	Central	N/A	0	0	0	0	N/A	3.95	1	0	0	0
13850	Plant City	N/A	0.08	2	13052.45	60	N/A	14.31	888	26991.65	187	0
13853	Plant City	N/A	2.12	20	93975.13	713	N/A	27.86	1465	147986.9	1293	0
13854	Plant City	N/A	10.49	600	8849.467	39	N/A	15.74	1382	24472.15	149	0
13858	Central	N/A	0	0	0	0	N/A	0.24	0	0	0	0

2023 Annual Reliability Performance Report

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.11	0.11	0	0	0	0	0	0	0	15.29%	3.62
0	Yes	1.38	0.03	0	0	0	1.35	24	0	0	4.27%	5.62
0	Yes	2.52	0.89	0	0	0	1.63	23	0	0	-5.66%	4.83
0	Yes	2.69	0.53	0	0	0	2.16	54	3079.833	1087	2.11%	5.33
0	Yes	4.73	0.1	0	0	0	4.63	206	230053.3	5481	2.28%	7.17
0	Yes	5.58	0.12	0	0	0	5.46	106	120651.1	1252	2.97%	8.68
0	Yes	4.84	0.17	0	0	0	4.67	179	46306.8	2031	3.14%	6.89
0	Yes	1.64	1.22	0	0	0	0.42	0	0	0	-8.31%	3.64
0	Yes	2.79	0.74	0	0	0	2.05	16	96307.08	2235	8.88%	6.5
0	Yes	0.44	0.44	0	0	0	0	0	0	0	16.49%	3.39
0	Yes	1.87	0.8	0	0	0	1.07	1	0	0	4.74%	3.98
0	Yes	4.56	3.02	0	0	0	1.54	9	68963.03	1042	1.37%	8.11
0	Yes	5.31	0.84	0	0	0	4.47	47	0	0	5.60%	8.87
0	Yes	0.44	0.44	0	0	0	0	0	0	0	-24.69%	4.24

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13859	Central	N/A	0	0	0	0	N/A	0.01	0	0	0	0
13860	Western	N/A	1.61	49	157.333	2	N/A	11	1130	6202.933	138	0
13863	Western	N/A	0.74	21	9045.533	152	N/A	7.45	705	23130.27	113	0
13864	Western	N/A	1.84	79	9881.583	111	N/A	2.8	289	491.233	2	0
13865	Western	N/A	2.18	136	174.6	2	N/A	16.06	1609	18469.3	162	0
13866	Western	N/A	1.57	98	0	0	N/A	3.63	168	0	0	0
13867	Western	N/A	1.7	102	11864.33	21	N/A	2	92	2107.367	5	0
13869	Western	N/A	0.16	3	571.867	2	N/A	6.93	565	157.25	1	0
13870	Western	N/A	2.38	38	852.267	10	N/A	15.41	1776	14341.9	104	0
13871	Western	N/A	2.66	64	2739.783	501	N/A	9.62	1121	11142.78	73	0
13872	Western	N/A	0	0	5794.633	63	N/A	11.4	922	2964.95	13	0
13873	Western	N/A	2.19	41	10434.53	274	N/A	15.43	1405	24226.9	224	0
13878	Eastern	N/A	1.99	42	2709.667	42	N/A	8.85	1494	2366.933	16	0
13879	Eastern	N/A	0.13	3	0	0	N/A	8.64	2277	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.12	2.12	0	0	0	0	0	0	0	2254.55%	2.59
0	Yes	1.5	0.02	0	0	0	1.48	7	0	0	-1.80%	5.99
0	Yes	1.75	0.84	0	0	0	0.91	15	51715.67	713	-4.19%	2.97
0	Yes	2.68	0.26	0	0	0	2.42	65	0	0	-42.39%	3.86
0	Yes	5.11	1.06	0	0	0	4.05	49	5405.867	1792	4.55%	9.2
0	Yes	2.53	0.16	0	0	0	2.37	23	0	0	-10.31%	5.83
0	Yes	2.15	0.19	0	0	0	1.96	51	0	0	-19.06%	4.29
0	Yes	1.11	0.1	0	0	0	1.01	9	38435.58	1061	-1.25%	5.53
0	Yes	1.89	0.03	0	0	0	1.86	25	0	0	0.29%	6.82
0	Yes	3.09	0.42	0	0	0	2.67	15	0	0	-0.19%	5.39
0	Yes	1.53	1.44	1	0	0	0.09	0	0	0	-1.79%	3.83
0	Yes	0.74	0.02	0	0	0	0.72	5	86455.42	1451	1.51%	7.41
0	Yes	2.63	0.41	0	0	0	2.22	22	0	0	4.74%	5.97
0	Yes	2.84	1.72	0	0	0	1.12	9	0	0	0.30%	6.72

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13880	Eastern	N/A	0.15	2	71583.53	1360	N/A	8.2	1661	0	0	0
13881	Eastern	N/A	0	0	0	0	N/A	1.74	121	0	0	0
13882	Eastern	N/A	0	0	0	0	N/A	2.24	395	0	0	0
13883	Eastern	N/A	1.1	29	28.433	1	N/A	5.94	1372	124.75	1	0
13884	Eastern	N/A	0.31	1	11095.4	79	N/A	11.48	1609	18683.27	166	0
13885	Eastern	N/A	0.57	7	78.417	1	N/A	9.97	1196	9959.95	49	0
13886	Western	N/A	0	0	382.733	1	N/A	11.63	1143	72019.15	691	0
13888	Western	N/A	0.84	16	4450.717	40	N/A	11.66	1148	20318.65	195	0
13889	Western	N/A	6.89	278	54316.17	1567	N/A	13.69	1429	65628.97	158	0
13890	Western	N/A	0.17	17	3429.1	51	N/A	7.14	661	66.65	1	0
13891	Western	N/A	0.01	0	594.467	3	N/A	17.36	1367	17841.98	191	0
13892	Western	N/A	1.58	68	9336	215	N/A	7.28	904	121.567	1	0
13895	Western	N/A	0.76	80	7474.167	19	N/A	2.15	229	0	0	0
13896	South Hillsborough	N/A	7.84	768	109971.8	921	N/A	10.21	1142	1610.483	24	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.51	1.35	0	0	0	1.16	9	0	0	2.11%	7.76
0	Yes	1.78	1.18	0	0	0	0.6	4	0	0	-15.85%	3.45
0	Yes	1.27	1.27	0	0	0	0	0	0	0	-24.15%	3.11
0	Yes	2.75	1.03	0	0	0	1.72	30	0	0	-14.26%	5.23
0	Yes	2.2	0.28	0	0	0	1.92	10	0	0	-2.31%	6.35
0	Yes	2.65	0.89	0	0	0	1.76	12	0	0	-1.43%	4.83
0	Yes	2.18	1.76	0	75353.68	1145	0.42	1	0	0	-17.22%	4.47
0	Yes	2.59	0.44	0	0	0	2.15	10	0	0	11.37%	5.68
0	Yes	3.3	0.33	0	0	0	2.97	56	0	0	5.10%	10.51
0	Yes	1.63	0.07	0	0	0	1.56	59	0	0	0.54%	3.72
0	Yes	2.25	1.48	0	0	0	0.77	14	0	0	-1.18%	6.72
0	Yes	2.69	0.12	0	0	0	2.57	18	0	0	9.84%	6.7
0	Yes	2.23	0.21	0	0	0	2.02	15	0	0	-0.24%	4.19
0	Yes	5.23	2.3	10	0	0	2.93	61	376480.6	5580	12.95%	6.89

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13897	South Hillsborough	N/A	2.38	23	18792.97	85	N/A	19.51	1294	57496.97	275	0
13898	South Hillsborough	N/A	0.77	9	0	0	N/A	20.95	1759	6394.6	23	0
13899	South Hillsborough	N/A	7.05	494	1826.5	25	N/A	6.43	826	0	0	0
13900	South Hillsborough	N/A	1.83	25	626499.4	6904	N/A	22.4	2300	1911.267	10	0
13901	South Hillsborough	N/A	0	0	0	0	N/A	15.51	965	12649.17	65	0
13906	Eastern	N/A	8.58	465	42891.52	1448	N/A	17.47	1154	16537.48	108	0
13909	Eastern	N/A	7.42	526	28828.03	366	N/A	3.94	71	163.6	2	0
13910	Eastern	N/A	6.62	335	47996.92	545	N/A	10.17	803	17617.57	163	0
13911	Eastern	N/A	9.05	798	43525.9	372	N/A	7.15	933	10155.6	108	0
13916	Winter Haven	N/A	1.65	135	4110.95	57	N/A	13.98	1647	40402.62	152	0
13918	Winter Haven	N/A	1.9	89	559.433	6	N/A	10.82	749	13737.45	63	0
13919	Winter Haven	N/A	0.01	0	0	0	N/A	1.08	36	0	0	0
13920	Winter Haven	N/A	1.42	62	635.7	68	N/A	12.28	1515	17135.78	110	0
13921	Winter Haven	N/A	2.43	167	26731.05	145	N/A	6.06	601	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	7.41	4.78	0	4282.133	1184	2.63	9	135132.7	2870	14.04%	5.93
0	Yes	9.39	4.92	0	0	0	4.47	6	4317.75	1515	15.00%	5.98
0	Yes	3.94	0.11	0	0	0	3.83	104	144890.5	1801	8.99%	7.52
0	Yes	5.6	1.07	0	0	0	4.53	20	0	0	12.09%	9.64
0	Yes	4.46	3.8	0	0	0	0.66	0	130156.1	964	10.00%	6.38
0	Yes	4.04	0.11	0	9062.083	1673	3.93	63	69692.65	1671	3.82%	9.24
0	Yes	3.07	0.59	0	0	0	2.48	111	120004.5	1406	3.52%	5.59
0	Yes	3.81	0.08	0	0	0	3.73	152	28802.58	1891	-0.98%	6.04
0	Yes	3.74	0.16	0	0	0	3.58	87	0	0	-1.08%	6.43
0	Yes	1.44	0.07	0	0	0	1.37	14	0	0	8.52%	6.62
0	Yes	2.5	0.19	0	0	0	2.31	15	0	0	-4.55%	4.2
0	Yes	0.78	0.2	0	0	0	0.58	13	0	0	75.00%	0.7
0	Yes	2.51	0.33	0	0	0	2.18	13	5630.4	1564	14.81%	6.2
0	Yes	1.68	0.1	0	0	0	1.58	43	0	0	10.36%	3.09

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13922	Winter Haven	N/A	0.31	10	0	0	N/A	33.09	2335	0	0	0
13924	Winter Haven	N/A	46.84	413	23976.85	1294	N/A	14.76	406	2134.583	15	0
13927	Winter Haven	N/A	25.01	727	103718.4	1432	N/A	12.18	1092	844.3	2	0
13928	Winter Haven	N/A	0	1	0	0	N/A	0	0	0	0	0
13929	South Hillsborough	N/A	0	0	0	0	N/A	0	0	0	0	0
13930	South Hillsborough	N/A	0	0	0	0	N/A	0	0	0	0	0
13932	Central	N/A	1.23	144	2.567	1	N/A	4.64	258	28707.25	73	0
13934	Central	N/A	0.66	10	36980.75	358	N/A	9.27	1126	12615.68	63	0
13935	Central	N/A	1.85	99	0	0	N/A	5.9	451	8878.217	91	0
13939	Central	N/A	1.89	81	35460.52	485	N/A	12.44	1074	26446.83	206	0
13940	Eastern	N/A	0	0	0	0	N/A	0	0	0	0	0
13942	Central	N/A	0.11	35	1635.3	9	N/A	1.74	1416	0	0	0
13943	Central	N/A	0.28	11	0	0	N/A	0.42	59	0	0	0
13944	Central	N/A	0.14	7	0	0	N/A	0.75	260	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	5.7	1.99	0	0	0	3.71	4	19262.87	4697	-4.18%	7.57
0	Yes	31.82	2.05	0	0	0	29.77	146	148442.8	2178	22.69%	6.38
0	Yes	6.05	0.32	0	0	0	5.73	68	40865.4	1971	2.87%	8.95
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	1.59	0.05	0	0	0	1.54	24	115356.3	505	1.89%	2.16
0	Yes	2.38	0.12	0	0	0	2.26	30	0	0	-2.67%	6.2
0	Yes	2.47	0.29	0	0	0	2.18	81	40982.33	649	33.88%	4.11
0	Yes	3.04	0.08	0	0	0	2.96	80	0	0	2.22%	5.98
0	Yes	0.02	0.02	0	0	0	0	0	0	0	-0.53%	16.81
0	Yes	1.52	1.49	375	509613.2	3226	0.03	5	3448.8	36	-14.45%	3.02
0	Yes	1.78	0.94	0	0	0	0.84	80	15772.9	143	-5.00%	3.04
0	Yes	1.61	1.47	0	0	0	0.14	9	0	0	2.00%	1.02

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13945	Central	N/A	0	0	0	0	N/A	0.48	248	0	0	0
13946	Central	N/A	8.01	1242	9144.483	123	N/A	0.27	39	0	0	0
13947	Central	N/A	6.85	1105	24338.12	324	N/A	0.4	4	0	0	0
13948	Central	N/A	4.18	662	128307.3	1309	N/A	4.13	467	11344.23	36	0
13951	Eastern	N/A	1	58	936.433	6	N/A	1.79	107	37.483	1	0
13952	Eastern	N/A	0.38	12	2381.883	31	N/A	2.56	66	0	0	0
13953	Eastern	N/A	4.2	150	27692.13	402	N/A	7.48	240	8744.25	15	0
13954	Eastern	N/A	0.41	4	374.767	4	N/A	2.88	94	3105.267	33	0
13955	Eastern	N/A	0.69	32	0	0	N/A	0.43	18	2139	12	0
13956	Eastern	N/A	0.04	0	641	5	N/A	2.76	756	0	0	0
13957	Eastern	N/A	0.16	1	97.5	2	N/A	3.36	406	259.283	5	0
13959	Plant City	N/A	23.6	444	2178.267	14	N/A	35.85	1433	3964.567	10	0
13961	Plant City	N/A	1.43	110	9031.9	123	N/A	8.7	680	150.483	2	0
13962	Plant City	N/A	2.13	424	9146.817	81	N/A	4.7	297	2403.333	6	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.14	1.14	0	0	0	0	0	0	0	-8.78%	2.7
0	Yes	2.78	0.06	0	0	0	2.72	206	73231.65	1493	-0.72%	4.14
0	Yes	2.67	0.12	0	0	0	2.55	162	0	0	19.83%	4.23
0	Yes	3.32	0.07	0	0	0	3.25	155	240548.8	5077	1.80%	6.22
0	Yes	2.28	0.63	0	0	0	1.65	27	0	0	-42.42%	3.57
0	Yes	1.11	0.21	0	0	0	0.9	5	4093.85	61	-6.06%	3.1
0	Yes	2.56	0.19	0	0	0	2.37	27	38997.05	411	-18.30%	7.19
0	Yes	2.35	0.45	0	0	0	1.9	15	0	0	-31.08%	2.55
0	Yes	1.38	0.22	1	0	0	1.16	7	0	0	-32.86%	0.47
0	Yes	2.09	0.73	0	0	0	1.36	8	56304	765	-22.76%	2.24
0	Yes	2.15	1.67	0	0	0	0.48	5	11212.85	407	-24.09%	3.34
0	Yes	15.24	4.72	0	0	0	10.52	102	0	0	70.61%	5.63
0	Yes	1.89	0.13	0	0	0	1.76	10	0	0	-42.16%	5.09
0	Yes	4.09	1.27	0	0	0	2.82	106	0	0	-23.58%	6.19

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13963	Eastern	N/A	3.45	219	8045.667	46	N/A	1.98	105	0	0	0
13964	Eastern	N/A	7.05	430	13971.05	85	N/A	0.57	5	0	0	0
13967	Winter Haven	N/A	3.59	252	36503.95	221	N/A	14.11	1372	0	0	0
13968	Winter Haven	N/A	5.27	577	22352.57	332	N/A	1.5	448	0	0	0
13971	Winter Haven	N/A	0.03	0	325.283	1	N/A	17.38	1658	0	0	0
13972	Winter Haven	N/A	2.28	54	271864.2	1207	N/A	26.82	2181	56224.45	253	0
13973	Winter Haven	N/A	1.22	5	12878.5	129	N/A	9.21	838	36133.15	243	0
13974	Winter Haven	N/A	0	0	0	0	N/A	0	0	0	0	0
13980	Plant City	N/A	0.98	2	0	0	N/A	0.34	6	0	0	0
13982	Plant City	N/A	11.7	329	1734.217	27	N/A	3.99	97	0	0	0
13983	Plant City	N/A	24.89	596	184612.7	1114	N/A	19.49	473	4685.167	49	0
13984	Plant City	N/A	9.83	301	4135.967	20	N/A	10.69	643	4251.583	41	0
13985	Central	N/A	0.02	0	78965.17	837	N/A	8.08	1453	492.133	8	0
13986	Central	N/A	1.13	4	530.133	6	N/A	15.01	1097	3988.25	10	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	2.71	1.01	0	0	0	1.7	47	58276.1	1067	-10.86%	3.12
0	Yes	2.05	0.23	0	0	0	1.82	29	6352.517	923	25.00%	4
0	Yes	3.62	0.06	0	0	0	3.56	105	45352.2	1731	6.76%	7.26
0	Yes	2.98	0.06	0	0	0	2.92	145	74058.83	2334	4.86%	3.67
0	Yes	3.41	1.43	0	0	0	1.98	53	181163.3	1700	277.89%	7.18
0	Yes	3.35	0.27	0	0	0	3.08	12	187491	7786	-19.64%	8.92
0	Yes	1.33	0.14	0	0	0	1.19	14	67210.47	588	-46.99%	4.4
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	2.74	0.08	0	0	0	2.66	2	33403.97	758	0.00%	0
0	Yes	4.4	0.25	0	0	0	4.15	91	0	0	100.00%	2.89
0	Yes	3.87	0.68	0	0	0	3.19	89	75254	2379	241.88%	5.47
0	Yes	6.23	1.08	0	0	0	5.15	100	8995.717	1971	5.70%	9.09
0	Yes	2.81	0.27	1	0	0	2.54	11	0	0	3.55%	4.96
0	Yes	3.08	2	0	0	0	1.08	4	0	0	0.99%	6.14

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13987	Central	N/A	0.03	0	0	0	0	10.93	1085	4714.5	86	0
13988	Central	N/A	0	0	158.033	2	N/A	14.46	1463	0	0	0
13989	Central	N/A	0	0	778.017	3	N/A	20.11	1736	53603.92	563	0
13990	Central	N/A	0.25	0	59.783	1	N/A	15.93	1153	1511.3	7	0
13991	Central	N/A	0.37	6	4337.3	22	N/A	26.87	2048	12088.15	103	0
13992	Central	N/A	0	0	0	0	N/A	14.41	1048	0	0	0
13993	Central	N/A	4.39	144	41608.13	581	N/A	20.73	1039	30846.88	190	0
13994	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14000	Plant City	N/A	18.89	623	21001.6	117	N/A	2.71	74	249.467	2	0
14001	Plant City	N/A	0.61	2	6443.6	62	N/A	0.89	41	0	0	0
14002	Plant City	N/A	0.02	0	6789.533	44	N/A	14.03	813	2187.167	10	0
14004	Plant City	N/A	0.05	1	724.867	4	N/A	0.22	3	0	0	0
14010	Central	N/A	0	0	0	0	N/A	2.25	51	3144.867	4	0
14011	Central	N/A	0.74	7	76.867	2	N/A	6.34	1071	1178.333	2	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	6.09	2.84	0	0	0	3.25	7	0	0	4.73%	5.31
0	Yes	3.35	3.35	0	191037.8	1462	0	0	138124.5	2927	4.69%	6.7
0	Yes	4.22	2.39	0	0	0	1.83	5	0	0	8.27%	7.33
0	Yes	3.45	2.46	0	0	0	0.99	0	0	0	6.71%	6.2
0	Yes	6.52	4.31	0	0	0	2.21	9	45697.8	1332	2.57%	10.79
0	Yes	7.13	5.55	0	0	0	1.58	1	137056.7	1018	-18.81%	5.18
0	Yes	4.97	0.18	0	0	0	4.79	94	0	0	4.37%	5.73
0	Yes	0.1	0.1	0	0	0	0	0	0	0	0.00%	0
0	Yes	4.88	0.31	0	0	0	4.57	77	0	0	-25.17%	4.49
0	Yes	0.46	0.13	0	0	0	0.33	0	0	0	75.00%	0.7
0	Yes	3.6	2.95	0	0	0	0.65	4	0	0	5.75%	4.23
0	Yes	0.43	0.04	0	0	0	0.39	1	0	0	67.50%	1.34
0	Yes	1.89	1.89	0	0	0	0	0	0	0	9.96%	7.62
0	Yes	2.85	2.34	0	0	0	0.51	1	0	0	-1.24%	9.55

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14012	Central	N/A	11.03	699	25285.93	1087	N/A	7.34	1241	18632.57	251	0
14014	Central	N/A	0.7	17	1149.7	4	N/A	2.48	441	0	0	0
14020	South Hillsborough	N/A	2.42	92	9404.167	112	N/A	12.9	1265	12536.75	109	0
14021	South Hillsborough	N/A	7.84	299	47086.62	654	N/A	11.81	822	211.15	1	0
14022	South Hillsborough	N/A	1.05	4	1754.017	19	N/A	13.34	878	2229.117	19	0
14023	South Hillsborough	N/A	13.31	406	6278.367	54	N/A	8.24	668	369.917	1	0
14024	South Hillsborough	N/A	7.69	530	4812.45	55	N/A	14.67	1406	2948.4	68	0
14025	South Hillsborough	N/A	0.96	52	0	0	N/A	9.06	842	0	0	0
14026	South Hillsborough	N/A	3.15	61	43.917	1	N/A	6.21	367	5177.567	189	0
14030	Western	N/A	4	96	60125.58	636	N/A	33.87	2302	61190.7	560	0
14031	Western	N/A	7.46	375	2142.917	33	N/A	14.21	1739	11563.63	89	0
14032	Western	N/A	1.64	51	1002.733	10	N/A	10.16	1323	11081.4	506	0
14035	Western	N/A	0.93	71	3335	575	N/A	2.21	340	35791.98	246	0
14036	Western	N/A	0	0	158.733	2	N/A	0.82	34	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	7.72	0.87	0	0	0	6.85	64	55269.53	1980	6.20%	8.56
0	Yes	0.34	0.06	0	0	0	0.28	1	0	0	-4.98%	2.86
0	Yes	4.04	0.61	0	0	0	3.43	29	38799.67	1394	-29.38%	7.98
0	Yes	2.77	0.06	0	0	0	2.71	61	0	0	2.79%	6.99
0	Yes	2.74	0.48	0	0	0	2.26	13	0	0	0.88%	5.75
0	Yes	6.58	0.38	0	0	0	6.2	93	0	0	74.50%	10.47
0	Yes	5.24	0.45	0	0	0	4.79	124	295609	5882	9.32%	9.62
0	Yes	3.28	1.8	0	0	0	1.48	17	0	0	6.49%	3.94
0	Yes	2.71	1.04	0	0	0	1.67	8	0	0	6.80%	2.67
0	Yes	3.43	1.35	0	0	0	2.08	39	52864.33	2371	5.59%	11.72
0	Yes	2.65	0.44	0	0	0	2.21	26	9111.483	2136	2.98%	8.65
0	Yes	2.89	1.31	0	0	0	1.58	39	0	0	0.47%	6.43
0	Yes	1.66	0.95	0	0	0	0.71	4	0	0	-14.75%	3.41
0	Yes	1.31	1.26	0	0	0	0.05	0	1894.167	66	12.50%	2.25

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14037	Western	N/A	0.7	3	9640.767	95	N/A	18.98	2021	0	0	0
14040	Central	N/A	3.93	244	28953.77	170	N/A	16.12	1542	62720.65	457	0
14041	Central	N/A	12.38	516	17390.47	165	N/A	16.74	1056	5433.583	44	0
14042	Central	N/A	2.37	104	9864.933	66	N/A	11.56	1194	23131.98	221	0
14045	Central	N/A	0.28	3	0	0	N/A	1.06	8	0	0	0
14046	Central	N/A	6.75	248	20997.75	320	N/A	4.01	204	0	0	0
14050	Plant City	N/A	34.04	458	35335.17	419	N/A	2.98	7	0	0	0
14051	Plant City	N/A	1.76	0	0	0	N/A	0.07	0	0	0	0
14059	Central	N/A	0.07	2	191.033	2	N/A	2.25	1344	270.8	2	0
14060	Central	N/A	0	0	0	0	N/A	0.53	31	0	0	0
14064	Central	N/A	0	0	0	0	N/A	0.94	448	0	0	0
14065	Central	N/A	0	0	0	0	N/A	7.02	1463	0	0	0
14066	Central	N/A	0	0	0	0	N/A	0.16	12	0	0	0
14069	Western	N/A	3.92	212	2242.967	187	N/A	21.25	1169	1325.75	5	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.72	2.27	2	0	0	1.45	2	0	0	2.07%	8.37
0	Yes	4.52	0.35	0	0	0	4.17	110	0	0	10.83%	7.47
0	Yes	5.23	0.51	2	0	0	4.72	67	0	0	27.35%	7.87
0	Yes	3.23	0.1	0	0	0	3.13	45	529775.1	1347	10.98%	5.66
0	Yes	1.51	1.51	0	0	0	0	0	0	0	-5.49%	5.34
0	Yes	4.37	1.05	0	0	0	3.32	62	40572.13	904	-5.88%	7.69
0	Yes	10.79	0.77	0	0	0	10.02	10	112217.6	945	9.37%	1.75
0	Yes	0.04	0	0	0	0	0.04	0	0	0	0.00%	0
0	Yes	2	2	1	335023	1147	0	0	0	0	7.78%	5.82
0	Yes	0.84	0.84	0	0	0	0	0	0	0	-60.71%	2.22
0	Yes	2.32	2.32	212	0	0	0	0	0	0	-14.24%	7.71
0	Yes	1.52	1.52	140	0	0	0	0	0	0	8.06%	4.96
0	Yes	0.88	0.88	0	0	0	0	0	0	0	14.67%	0.86
0	Yes	6.65	5.03	0	0	0	1.62	11	0	0	-3.33%	7.54

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14070	Western	N/A	0.08	7	0	0	N/A	18.93	1176	4244.45	7	0
14071	Western	N/A	8.26	341	40000.55	742	N/A	23.28	1329	1653.833	14	0
14079	Western	N/A	0.41	0	0	0	N/A	14.65	1230	7444	39	0
14080	Western	N/A	0.01	0	0	0	N/A	16.88	1446	9069.667	28	0
14081	Western	N/A	1.04	80	0	0	N/A	11.95	1566	32128.03	266	0
14082	Western	N/A	0	0	0	0	N/A	13.35	1056	14910.03	56	0
14083	Western	N/A	0	0	0	0	N/A	15.95	1723	2810.767	17	0
14084	Western	N/A	0.11	5	3517.467	46	N/A	15.76	1160	33127.92	230	0
14089	Central	N/A	0.16	3	204.483	1	N/A	19.86	726	7339	52	0
14090	Central	N/A	0.11	0	0	0	N/A	9.09	676	2768.467	9	0
14091	Central	N/A	0.22	0	0	0	N/A	12.73	1032	22942.25	130	0
14092	Central	N/A	0	0	5354.783	61	N/A	17.04	1406	111400.9	363	0
14094	Central	N/A	0.03	2	4277.867	104	N/A	10.22	1471	10608.75	75	0
14095	Central	N/A	0	0	0	0	N/A	18.15	1177	1251.1	6	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.83	1.45	0	0	0	2.38	15	0	0	1.39%	7.3
0	Yes	8.17	4.67	0	0	0	3.5	30	40332.33	1702	-0.42%	9.56
0	Yes	6.55	4.41	1	0	0	2.14	1	0	0	-25.56%	6.7
0	Yes	2.75	2.16	0	0	0	0.59	0	0	0	15.08%	7.02
0	Yes	3.65	3	0	0	0	0.65	21	49426.55	1667	-1.05%	7.52
0	Yes	3.08	3.08	0	0	0	0	0	45145.67	1055	0.69%	5.84
0	Yes	4.6	4.34	0	117314.2	1719	0.26	1	0	0	2.13%	7.66
0	Yes	3.27	1.35	0	67975.22	1168	1.92	3	0	0	-100.00%	0
0	Yes	8.42	5.26	0	0	0	3.16	7	0	0	3.19%	3.88
0	Yes	4.65	3.36	0	0	0	1.29	12	0	0	2.45%	5.86
0	Yes	4.43	2.68	0	0	0	1.75	1	71363.25	1035	0.00%	5.86
0	Yes	3.48	2.52	0	0	0	0.96	4	0	0	0.29%	6.92
0	Yes	5.52	3.94	0	0	0	1.58	10	0	0	-1.10%	7.22
0	Yes	3.19	3.19	0	0	0	0	0	0	0	0.53%	5.68

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14096	Central	N/A	0	0	0	0	0 N/A	14.49	1322	1596.2	170	0
14099	Central	N/A	2.69	43	1097.8	45	N/A	10.56	685	0	0	0
14100	Central	N/A	0	0	0	0	N/A	21	2052	0	0	0
14101	Central	N/A	0	0	0	0	N/A	20.71	1531	0	0	0
14102	Central	N/A	1.85	46	1651.7	28	N/A	18.63	1842	3107.833	10	0
14109	Eastern	N/A	0.45	4	0	0	N/A	5.33	656	4855.717	48	0
14110	Eastern	N/A	3.25	146	3853.167	51	N/A	15.44	698	0	0	0
14111	Eastern	N/A	7.18	483	30808.9	232	N/A	7.93	685	0	0	0
14112	Eastern	N/A	2.9	107	7100.083	131	N/A	13.14	900	13829.38	149	0
14114	Eastern	N/A	6.04	303	23791.33	243	N/A	14.07	1313	8825.917	105	0
14115	Eastern	N/A	0.86	9	0	0	N/A	3.31	133	7314.45	26	0
14116	Eastern	N/A	0.94	62	21.767	2	N/A	2.35	374	2595.45	11	0
14117	Eastern	N/A	1.13	73	0	0	N/A	1.94	98	0	0	0
14119	Plant City	N/A	0.17	3	0	0	N/A	29.51	2246	2734.6	12	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	5.38	4.54	0	0	0	0.84	0	0	0	14.47%	6.25
0	Yes	7.05	2.7	0	0	0	4.35	11	44526.68	697	2.44%	4.62
0	Yes	3.96	3.96	0	0	0	0	0	0	0	3.67%	7.63
0	Yes	5.65	5.65	0	0	0	0	0	0	0	1.40%	7.25
0	Yes	6.96	5.06	1	0	0	1.9	17	0	0	0.11%	8.99
0	Yes	1.7	0.27	0	0	0	1.43	21	0	0	-2.94%	3.3
0	Yes	2.53	0.14	0	0	0	2.39	14	0	0	12.31%	5.84
0	Yes	2.92	0.04	0	0	0	2.88	63	0	0	9.51%	6.68
0	Yes	3.05	0.21	0	0	0	2.84	31	0	0	5.95%	7.84
0	Yes	3.01	0.15	0	0	0	2.86	21	100727.1	3250	-3.87%	7.21
0	Yes	2.88	1.58	1	0	0	1.3	14	0	0	1.25%	5.67
0	Yes	1.94	0.15	0	0	0	1.79	51	0	0	23.33%	4.07
0	Yes	1.82	0.2	0	0	0	1.62	36	0	0	3.79%	6.02
0	Yes	5.28	3.59	1	0	0	1.69	2	170233.5	2252	3.92%	12.47

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14120	Plant City	N/A	0.35	3	5749.6	93	N/A	14.36	965	10824.68	37	0
14121	Plant City	N/A	0.48	9	13911.62	72	N/A	11.52	742	0	0	0
14122	Plant City	N/A	0	0	9320.75	45	N/A	22.94	1345	4721.15	23	0
14123	Plant City	N/A	5.85	157	2184.333	8	N/A	14.59	891	102711.9	1080	0
14124	Plant City	N/A	4.79	100	10699.55	77	N/A	13.98	885	0	0	0
14144	South Hillsborough	N/A	7.13	573	84333.17	1108	N/A	15.07	1264	4376.7	9	0
14145	South Hillsborough	N/A	0.19	2	51.533	1	N/A	22.12	1749	0	0	0
14146	South Hillsborough	N/A	23.62	622	22282.92	259	N/A	23.64	963	63.217	1	0
14187	Winter Haven	N/A	2.71	82	235.05	4	N/A	3.21	155	0	0	0
14188	Winter Haven	N/A	3.68	101	0	0	N/A	3.84	73	0	0	0
14196	Eastern	N/A	0	0	0	0	N/A	0.07	1	0	0	0
14197	Eastern	N/A	1.91	30	493.467	11	N/A	0.74	50	297.067	3	0
14198	Eastern	N/A	1.96	48	76.117	2	N/A	3.54	249	1205.917	4	0
14199	Eastern	N/A	0.92	30	1866.733	11	N/A	0.55	24	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	4.92	2.93	0	0	0	1.99	13	56869.42	962	7.04%	10.49
0	Yes	2.68	1.29	0	0	0	1.39	5	0	0	4.40%	5.22
0	Yes	3.24	3.05	0	0	0	0.19	0	0	0	10.25%	8.93
0	Yes	6.74	3.08	0	0	0	3.66	47	5530.5	1068	-3.62%	6.65
0	Yes	6.72	3.26	0	0	0	3.46	78	0	0	1.96%	5.71
0	Yes	2.97	0.21	0	0	0	2.76	30	135117.6	1861	0.95%	6.36
0	Yes	5.52	3.61	0	0	0	1.91	3	0	0	7.54%	7.42
0	Yes	9.46	4.53	0	0	0	4.93	45	104585.9	4327	48.47%	8.76
0	Yes	6.02	4.34	0	0	0	1.68	15	0	0	-9.29%	2.54
0	Yes	5.4	3.02	0	0	0	2.38	37	0	0	-5.22%	2.18
0	Yes	0.02	0.02	0	0	0	0	0	0	0	3.91%	6.65
0	Yes	2.24	0.14	1	0	0	2.1	18	0	0	-3.33%	2.32
0	Yes	3.51	1.11	0	0	0	2.4	46	0	0	2.83%	5.45
0	Yes	2.73	0.61	0	0	0	2.12	19	17858.22	221	-10.91%	4.9

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14200	South Hillsborough	N/A	0	0	0	0	N/A	0	0	0	0	0
14201	South Hillsborough	N/A	0	0	0	0	N/A	0	0	0	0	0
14202	South Hillsborough	N/A	3.26	25	1431.45	4	N/A	12.61	1057	18083.52	82	0
14203	South Hillsborough	N/A	1.4	5	74.383	1	N/A	1.23	8	0	0	0
14207	Eastern	N/A	0.15	2	0	0	N/A	0	0	0	0	0
14208	Eastern	N/A	0	0	0	0	N/A	0.05	1	0	0	0
14209	Eastern	N/A	0	0	0	0	N/A	0	0	0	0	0
14210	Eastern	N/A	0	0	0	0	N/A	0.01	1	0	0	0
14216	Central	N/A	5.62	124	37431.48	114	N/A	0.04	1	24506.67	176	0
14217	Central	N/A	5.22	24	599.833	5	N/A	8.15	722	2548.933	8	0
14218	Central	N/A	0.06	2	30773.83	58	N/A	23.9	1888	203.233	1	0
14219	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14221	Central	N/A	0	0	0	0	N/A	20.64	1660	0	0	0
14222	Central	N/A	0	0	0	0	N/A	21.26	1110	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	0.07	0.07	0	0	0	0	0	0	0	-21.23%	5.12
0	Yes	0.1	0.1	0	0	0	0	0	0	0	-14.88%	7.15
0	Yes	5.88	1.29	0	78601.48	3710	4.59	5	143336.6	1118	-6.88%	4.47
0	Yes	2.42	1.38	0	0	0	1.04	6	0	0	-22.78%	2.78
0	Yes	0.24	0.05	0	0	0	0.19	0	0	0	11.20%	2.78
0	Yes	0.33	0.15	0	0	0	0.18	0	0	0	29.26%	3.49
0	Yes	0.5	0.08	0	0	0	0.42	0	0	0	-74.10%	1.01
0	Yes	0.19	0.19	0	0	0	0	0	0	0	6.82%	2.35
0	Yes	4.51	0.05	0	0	0	4.46	3	0	0	-92.39%	0.57
0	Yes	3.17	1.1	0	0	0	2.07	3	0	0	2.34%	3.5
0	Yes	6.48	3.97	0	3406.05	29	2.51	0	218846.8	2835	-34.96%	7.48
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	4.54	2.78	0	0	0	1.76	1	0	0	100.00%	6.91
0	Yes	9.18	9.05	0	0	0	0.13	0	0	0	100.00%	4.54

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14226	Central	N/A	0.33	29	735.2	4	N/A	0.72	301	0	0	0
14227	Central	N/A	0	0	0	0	N/A	0.04	29	0	0	0
14228	Central	N/A	0	0	0	0	N/A	0.26	523	0	0	0
14229	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14230	Central	N/A	0	0	0	0	N/A	0.04	402	0	0	0
14231	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14232	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14258	South Hillsborough	N/A	14.01	154	23270.22	144	N/A	12.72	883	0	0	0
14259	South Hillsborough	N/A	40.86	339	67294.83	1007	N/A	4.14	116	0	0	0
14260	South Hillsborough	N/A	0.59	2	0	0	N/A	31.43	2034	4604.917	22	0
14261	South Hillsborough	N/A	4.84	83	600.75	3	N/A	15.34	405	0	0	0
14266	Central	N/A	2.2	134	5465.783	40	N/A	10.44	2473	14319	37	0
14267	Central	N/A	0	0	2593.5	30	N/A	19.13	1590	4153.567	49	0
14268	Central	N/A	0	0	279.267	1	N/A	11.83	867	18976.65	93	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	1.99	1.94	0	0	0	0.05	3	18854.57	324	3.57%	0.58
0	Yes	0.74	0.74	0	0	0	0	0	0	0	30.91%	0.72
0	Yes	0.94	0.94	0	0	0	0	0	0	0	0.89%	1.13
0	Yes	0.71	0.71	0	0	0	0	0	0	0	0.00%	0
0	Yes	0.84	0.84	0	0	0	0	0	0	0	100.00%	0.36
0	Yes	0.33	0.33	0	0	0	0	0	0	0	100.00%	0.01
0	Yes	0.39	0.39	0	0	0	0	0	0	0	100.00%	0.02
0	Yes	5.52	2.72	0	0	0	2.8	39	118425	2137	100.00%	4.18
0	Yes	1.35	0.21	0	0	0	1.14	7	1715.233	330	100.00%	2.57
0	Yes	7.5	5.15	0	0	0	2.35	1	0	0	100.00%	8.33
0	Yes	6.3	2.02	0	0	0	4.28	21	0	0	100.00%	1.93
0	Yes	4.33	0.43	0	0	0	3.9	64	0	0	0.38%	7.83
0	Yes	4.15	2.4	0	0	0	1.75	3	0	0	-2.77%	6.32
0	Yes	3	1.66	0	0	0	1.34	0	0	0	-2.12%	3.69

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14274	Western	N/A	28.48	515	23150.75	304	N/A	21.69	505	7700.833	94	0
14275	Western	N/A	1.43	9	0	0	N/A	23.79	1321	196288.7	1295	0
14306	Dade City	N/A	17.18	421	52061.72	237	N/A	1.97	23	0	0	0
14310	Eastern	N/A	0	0	0	0	N/A	0	0	0	0	0
14316	South Hillsborough	N/A	0	0	0	0	N/A	12.69	1018	31471.7	225	0
14317	South Hillsborough	N/A	0.22	3	172.35	3	N/A	39.75	2663	14124.95	81	0
14319	South Hillsborough	N/A	0	1	0	0	N/A	5.73	538	0	0	0
14320	South Hillsborough	N/A	0.36	50	0	0	N/A	8.64	859	2167.4	24	0
14341	Eastern	N/A	5.74	24	858.05	2	N/A	1.42	4	0	0	0
14350	Western	N/A	0	0	0	0	N/A	0	0	0	0	0
14355	Eastern	N/A	2.19	92	114783.1	2325	N/A	9.44	2620	8617.45	141	0
14356	Eastern	N/A	0.93	26	17303.37	1719	N/A	6.33	1677	5870.683	19	0
14358	Eastern	N/A	0.2	7	0	0	N/A	6.59	1085	13413.4	143	0
14367	South Hillsborough	N/A	0	0	0	0	N/A	0	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	6.12	1.01	0	0	0	5.11	92	0	0	16.86%	5.96
0	Yes	5.47	3.09	1	13377.3	183	2.38	11	2436.15	1341	-7.59%	8.04
0	Yes	3.64	0.51	0	0	0	3.13	66	27889.9	393	8.18%	2.38
0	Yes	0.41	0.12	0	0	0	0.29	0	0	0	-37.31%	11.66
0	Yes	3.8	3.8	0	0	0	0	0	0	0	-36.60%	2.98
0	Yes	10.87	9.8	0	0	0	1.07	8	0	0	22.40%	12.73
0	Yes	2.55	2.55	0	0	0	0	0	0	0	21.76%	2.07
0	Yes	3.4	1.98	0	0	0	1.42	9	0	0	-20.75%	4.2
0	Yes	1.36	0.41	0	0	0	0.95	0	10801.35	70	100.00%	0.1
0	Yes	0.02	0.02	0	0	0	0	0	0	0	-3.91%	4.42
0	Yes	2.22	0.54	0	0	0	1.68	27	0	0	0.83%	8.47
0	Yes	3.55	2.29	0	0	0	1.26	10	0	0	7.18%	7.61
0	Yes	2.42	1.69	0	0	0	0.73	7	0	0	18.00%	6.49
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customer s Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customer s Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14396	South Hillsborough	N/A	1.59	72	25925.08	413	N/A	14.98	2020	6091.1	78	0
14397	South Hillsborough	N/A	2.11	47	3659.4	38	N/A	4.37	567	0	0	0
14398	South Hillsborough	N/A	5.87	173	13861.3	142	N/A	17.49	1379	13291.18	86	0
14399	South Hillsborough	N/A	4.7	123	124899.4	1355	N/A	24.77	2250	0	0	0
14529	Central	N/A	0	0	0	0	N/A	0	0	0	0	0
14937	Winter Haven South	N/A	2.75	163	2169.083	14	N/A	0.88	28	198.55	1	0
13647	Hillsborough	N/A	1.28	0	9166.633	70	N/A	22.41	0	0	0	0
14578	Plant City	N/A	0	0	27068.22	921	N/A	3.3	0	0	0	0

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
0	Yes	3.2	1.43	0	0	0	1.77	45	58779.75	2165	100.00%	7.14
0	Yes	5.81	3.76	0	0	0	2.05	4	217728.8	3991	100.00%	4.11
0	Yes	4.63	1.76	6	0	0	2.87	20	0	0	10.72%	7.64
0	Yes	2.68	1.05	0	0	0	1.63	6	0	0	11.95%	9.18
0	Yes	0	0	0	0	0	0	0	0	0	0.00%	0
0	Yes	4.5	0.87	0	0	0	3.63	70	0	0	100.00%	4.91
0	Yes	4.74	3.97	0	0	0	0.77	0	0	0	-100.00%	0
0	Yes	7.92	7.9	0	0	0	0.02	0	8509.133	70	5.00%	1.68