Report
02/27/2026

AUSLEY MCMULLEN
Attorneys and Counselors at Law
123 South Calhoun Street
P.O. Box 391 32302
Tallahassee, FL 32301
P: (850) 224-9115
F: (850) 222-7560
ausley.com

February 27, 2026

VIA: ELECTRONIC MAIL

Mr. Tom Ballinger, Director
Division of Engineer
Florida Public Service Commission
Room 215J – Gerald L. Gunter Building
2540 Shumard Oak Boulevard
Tallahassee, FL 32399-0850
tballing@psc.state.fl.us

Re: Wood Pole Inspection and Annual Reliability Performance Reports

Dear Mr. Ballinger:

Submitted herewith is Tampa Electric Company's 2025 Wood Pole Inspection and Annual Reliability Performance Reports.

Please let me know if you have any questions.

Sincerely,

Malcolm N. Means

MNM/bml
Enclosure
cc: Ashley Sizemore, TEC
TEC Regulatory

2025
ANNUAL WOOD POLE INSPECTION REPORT
&
ANNUAL RELIABILITY PERFORMANCE REPORT

FILED: February 27, 2026

Table of Contents

Wood Pole Inspection and Reliability Performance Report....2
Tampa Electric's Wood Pole Inspection Program....4
Annual Wood Pole Inspection Report....8
Section IV – Rule 25-6.0455 F.A.C. 9
Reliability Performance 9
Outage Events & Details 12
Extreme Weather 16
Other Distribution – Adjustments....16
Distribution Substation 16
Adjusted Distribution Reliability 23
Three Percent Feeder 23
Regional Reliability Indices & Trends 26
Overhead – Underground Reliability 30
Reliability-Related Customer Complaints 31
Appendix A – Actual Data 36
Form 102 – Part II Three Percent Feeder List – Actual 37
Annual Distribution Service Reliability Report – Actual....39
Appendix B – Adjusted Data 41
Form 103 - Part II Three Percent Feeder List – Adjusted 42
Annual Distribution Service Reliability Report - Adjusted....45
Appendix C - CMI, CI and Documented Exclusions....47
Appendix D – Adjustments: Planned Distribution, Substation, and Transmission Outage Events....48
Appendix E - Feeder Specific and Attached Laterals Data 283

SUMMARY OF 2025

Wood Pole Inspection and Reliability Performance Report

In 2025, Tampa Electric continued the performance of the fourth year of its current Storm Protection Plan ("SPP"). The company's 2022-2031 Storm Protection Plan is Tampa Electric's second SPP and provides a comprehensive approach to protect and strengthen its electric utility infrastructure to withstand extreme weather conditions as well as to reduce restoration costs and outage times in a practical, and cost-effective manner. As part of the company's prior Storm Hardening Plans and SPPs, Tampa Electric continued to perform the required system hardening activities such as equipment upgrades, system and equipment maintenance, upgrading of distribution wood structures, replacement of transmission wood structures and the company's distribution and transmission inspection processes.

Tampa Electric's 2025 distribution reliability "Actual" indices showed improved performance in all reliability indices when compared to 2024. Tampa Electric's distribution reliability "Adjusted" MAIFIe and L-Bar metrics performed better in 2025 compared to 2024. MAIFIe improved from the deployment of reclosers throughout Tampa Electric's service territory. The addition of these reclosers reduced both the "Actual" and "Adjusted" MAIFIe values since the circuit breakers experienced less breaker operations. Additional ongoing efforts, such as SPP and grid modernization, continue to demonstrate consistent improvement to the company's overall system reliability. Tampa Electric was not impacted by any major storms in 2025 which also contributed to the improvement of the company's "Actual" indices.

The following reports are included below:

1. Tampa Electric's 2025 Annual Wood Pole Inspection Report as required by Order No. PSC-2007-0918-PAA-PU issued on November 14, 2007, in Docket Nos. 20070634-EI and 20070635-TL.
2. Tampa Electric's 2025 Annual Distribution Service Reliability Report as required by Florida Administrative Code ("FAC") Rule 25-6.0342.

Tampa Electric's Wood Pole Inspection Program

Tampa Electric's Wood Pole Inspection Program is part of a comprehensive program initiated by the Florida Public Service Commission ("FPSC") for Florida investor-owned electric utilities to harden the electric system against severe weather.

This inspection program complies with Order No. PSC-2006-0144-PAA-EI, issued February 27, 2006, in Docket No. 20060078-EI which requires each investor-owned electric utility to implement an inspection program of its wooden transmission and distribution poles on an eight-year cycle based on the requirements of the National Electrical Safety Code ("NESC"). Tampa Electric has approximately 285,000 distribution and lighting wood poles and 25,000 transmission structures appropriate for inspection for a total pole inspection population of approximately 310,000. Approximately 12.5 percent of the known system will be targeted for inspections annually although the actual number of poles may vary from year to year due to recently constructed circuits, de-energized circuits, reconfigured circuits, etc. This program provides a systematic identification of poles that require repair, reinforcement, or replacement to meet the strength requirements of the NESC.

The wood pole inspections will be conducted on a substation circuit basis with a goal of inspecting the entire wood pole population every eight years. An average of 35,625 wooden distribution poles will be inspected annually with each pole receiving a visual inspection, a sound and bore procedure, and a groundline/excavation inspection (except for chromated copper arsenate "CCA" poles less than 16 years of age).

Inspection Method and Procedure

Tampa Electric utilizes three basic inspection procedures for determining the condition of wooden poles. These procedures include a visual inspection, sound and bore, and excavation when required.

Visual Inspection: An initial visual inspection shall be made on all poles from the ground line to the pole top to determine the condition of the pole before any additional inspection work is completed. The visual inspection shall include a review of the pole condition itself and any attachments to the pole for conditions that jeopardize reliability and are in need of replacement, repair or minor follow-up. After a pole passes the initial visual inspection, the balance of the required inspection methods will be performed.

Sound and Bore: After passing the visual inspection, the pole shall be sounded to a minimum height of seven feet above the ground line to locate any rotten conditions or pockets of decay inside the pole. Borings shall be made to determine the location and extent of internal decay or voids. All borings shall be plugged with preservative treated wooden dowels. After the pole has passed the sound and bore inspection, an excavation inspection will be performed, if required.

Excavation: For poles requiring excavation, the pole shall be excavated to a minimum depth of 18 inches below the ground line. Any external decay shall be removed to expose the remaining sound wood. The remaining pole strength shall be calculated.

For a pole in concrete or pavement where excavation is not possible, Tampa Electric will utilize a shell boring technique. This will consist of boring two 3/8-inch holes at a 60-degree angle to a depth of 16 to 18 inches below ground level. Upon withdrawing the drill bit, the technician will examine the condition of the wood shavings to determine whether decay is present. A “Shell Gauge” is used to determine the thickness of the shell, which is then used to calculate the pole strength. All borings shall be plugged as previously described.

Hardware Inspection: Tampa Electric shall inspect all of the guying, grounding provisions and hardware that is visible from the ground. Any deficiencies or problems will be corrected as directed or reported to Tampa Electric to correct.

Inspection and Treatment Labeling: After completion of the ground line inspection, an aluminum tag identifying the contractor and date of inspection shall be attached to the pole above the birthmark. Additionally, a tag shall be attached identifying any preservative treatments applied and the date of application.

Data Collection: The collected data shall be managed in a database and include information related to pole class, material, vintage, location, pole strength, and any pole deficiencies that required follow-up actions.

Inspection in Conjunction with Other Field Work: As part of day-to-day operations, operation personnel are at times required to climb poles to perform different types of field work. Prior to climbing any pole, personnel will assess the condition of the pole. This will include a visual check and may include sounding to determine pole integrity. This type of inspection will supplement the systematic inspection approach outlined in this pole inspection program.

Disposition of Poles: Poles with early-stage decay that do not require remediation to meet the NESC strength requirements shall be treated with an appropriate preservative treatment. Poles with moderate decay that have substantial sound wood shall be considered for reinforcement. Analysis shall be performed to determine if reinforcement will bring the deficient pole into compliance with the requirements of the NESC. If it is determined that the pole can be reinforced, the pole shall be treated with appropriate preservative treatment and may be reinforced or replaced if needed. Poles with advanced decay shall fail the inspection and be replaced.

Shared Poles: Tampa Electric supports the Commission's effort to establish pole inspection requirements on the owners of all utility poles. Tampa Electric will coordinate with third-party owners of utility poles that carry the company's facilities. Regarding the third-party's inspection process, the company will rely upon the third-party's inspection requirements and share data requested by the third-party to be utilized in their inspection procedure. Tampa Electric will cooperate, as requested, in

the work associated with pole replacement where joint use exists. Third-party poles are visually inspected and sounded for internal decay. Issues found are provided to the third-party owner for resolution.

Chromated Copper Arsenate Pole Inspections: The FPSC approved a modification to Tampa Electric's Wood Pole Inspection program involving chromated copper arsenate ("CCA") poles in Order No. PSC-2008-0615-PAA-EI, issued on September 23, 2008, in Docket No. 20080219-EI. Specifically, the modification requires CCA treated poles less than 16 years of age to be sound and selectively bored. Selective boring shall be performed on poles suspected of internal decay. Additionally, one percent of the annual number of CCA treated poles inspected less than 16 years of age shall be excavated to validate this inspection method. Finally, all CCA treated poles over 16 years of age shall be excavated.

Reporting: Tampa Electric will file the Annual Wood Pole Inspection Report, as an inclusion to the company's Annual Reliability Performance Reports, by March 1st of each year in full accordance with the reporting requirements set forth in Order No. PSC-2007-0918-PAA-PU, issued on November 14, 2007, in Docket No. 20070634-EI. The report will contain the methods used to determine the strength and structural integrity of wooden poles, the selection criteria for inspected poles, a summary of the results of the inspections, the cause(s) of inspection failures, and the corrective action taken for the failures. The 2025 Annual Wood Pole Inspection Report is on the next page:

Annual Wood Pole Inspection Report

ORDER NO. PSC-2007-0918-PAA-PU
DOCKET NOS. 20070634-EI, 20070635-TL

TAMPA ELECTRIC COMPANY
Annual Wood Pole Inspection Report
2025

a	b	c	d	e	f	g	h	i	j	k	l	m
Total # of Wooden Poles in the Company Inventory	# of Pole Inspections Planned this Annual Inspection	# of Poles Inspected this Annual Inspection	# of Poles Failing Inspection this Annual Inspection	Pole Failure Rate (%) this Annual Inspection	# of Poles Designated for Replacement this Annual Inspection	Total # of Poles Replaced this Annual Inspection	# of Poles Requiring Minor Follow-up this Annual Inspection (Anchors/Guys)	# of Poles Overloaded this Annual Inspection	Methods(s) V = Visual E = Excavation P = Prod S = Sound B = Bore R = Resistograph	# of Pole Inspections Planned for Next Annual Inspection Cycle	Total # of Poles Inspected (Cumulative) in the 8-Year Cycle to Date	% of Poles Inspected (Cumulative) in the 8-Year Cycle to Date
Distribution and Transmission				Distribution Reinforcement 0.00%	Distribution Reinforcement 374	Distribution Reinforcement 0						
				Distribution Replacement 5.76%	Distribution Replacement 2,243	Distribution Replaced 452						
CYCLE THREE WOOD POLE POPULATION								Distribution Poles				
Distribution 285,000	Distribution 35,625	Distribution 38,951	Distribution 2,243	Distribution 5.76%	Distribution 350	Distribution 452	Distribution 405	Overloaded 0	VESB	** Distribution 35,625	Distribution 165,739	Distribution 58.15%
Transmission	Transmission	Transmission	Transmission	Transmission	Transmission	Transmission	Transmission	Transmission	VESB	Transmission	Transmission	Transmission
1,956	122	52	4	7.69%	471	600	0	0		326	665	34.00%
Total Poles 286,956	Total 35,747	Total 39,003	Total 2,247		Total 821	Total 1,052	Total 405	Total 0		Total 35,951	Total 166,404	Total 57.99%
If b - c > 0, provide explanation	Planned totals did not account for the poles being changed out prior to inspection.											
If d - g > 0, provide explanation	Currently replacing poles failed on previous cycles. Pole are not inspected and replaced in same calendar year.											
Description of selection criteria for inspections	Pole inspections changed from region based to circuit based in 2016. Circuits to be inspected are selected by a combination of poor reliability circuits and circuits due for inspection											

Section IV – Rule 25-6.0455 F.A.C.

Reliability Performance

Tampa Electric's 2025 distribution reliability "Actual" indices showed improved performance in all reliability indices when compared to 2024. Tampa Electric's distribution reliability "Adjusted" MAIFIe and L-Bar metrics performed better in 2025 compared to 2024. MAIFIe improved from the deployment of reclosers throughout Tampa Electric's service territory. The addition of these reclosers reduced both the "Actual" and "Adjusted" MAIFIe values since the circuit breakers experienced less breaker operations. Additional ongoing efforts, such as SPP and grid modernization, continue to demonstrate consistent improvement to the company's overall system reliability. Tampa Electric was not impacted by any major storms in 2025 which also contributed to the improvement of the company's "Actual" indices.

Exhibit 1 is a summary of Tampa Electric's reliability performance for 2025 as compared to 2024.

Exhibit 1: Tampa Electric's 2025 Reliability Performance Summary

Actual	**2024**	**2025**	**Difference**	**Percent Change**
SAIDI	4,226.61	98.24	-4,128.37	-97.68%
CAIDI	1,192.84	67.86	-1,124.98	-94.31%
SAIFI	3.54	1.45	-2.09	-59.04%
MAIFIe	9.44	5.67	-3.77	-39.94%
L_Bar	904.07	119.42	-784.65	-86.79%
CEMI-5	5.14%	2.26%	-3.00%	-55.97%
Adjusted	**2024**	**2025**	**Difference**	**Percent Change**
SAIDI	69.31	77.66	8.35	12.05%
CAIDI	67.39	74.43	7.04	10.45%
SAIFI	1.03	1.04	0.01	0.97%
MAIFIe	5.43	5.09	-0.34	-6.26%
L_Bar	164.22	136.54	-27.68	-16.86%
CEMI-5	0.28%	0.70%	1.00%	152.56%

Tampa Electric experienced a decrease of 295 overall outages in 2025 as compared to 2024. Exhibit 2 details the primary cause of outage events per year. Compared to 2024, outages that were caused primarily by electrical, vegetation, and all remaining causes decreased while the remaining primary causes increased.

Exhibit 2: Cause of Outage Events by Year

PSC Group	2021	2022	2023	2024	2025	Five Year Average	Percent Change (Current Year vs. Five Year Average)
Animals	1,728	1,038	1,247	1,061	1,599	1,335	19.78%
Bad Connection	392	258	245	326	434	331	31.12%
Defective Equipment	626	684	699	772	933	743	25.57%
Down Wire	1,132	877	1,080	1,013	1,175	1,055	11.37%
Electrical	679	683	461	895	559	655	-14.66%
Lightning	1,019	1,567	792	1,174	1,180	1,146	2.97%
Other Weather	1,211	711	553	971	1,182	926	27.75%
Unknown	1,031	1,075	940	1,461	1,762	1,254	40.51%
Vegetation	1,409	1,593	1,403	2,357	1,581	1,669	-5.27%
Vehicle	300	220	252	301	451	305	47.87%
All Remaining Causes	368	506	572	1,612	792	770	2.86%
Total	**9,895**	**9,212**	**8,244**	**11,943**	**11,648**	**10,188**	**14.33%**

Tampa Electric experienced fewer outages in 2025 as compared to 2024. However, 2025 had more outages when compared to the five-year average. Outages that were caused primarily by electrical and vegetation were lower in 2025 when compared to the five-year average. The other outage causes increased when compared to the five-year average.

Tampa Electric currently tracks outage records in the company's Distribution Outage Database ("DOD") according to the date, duration, customer affected, cause, equipment-type, associated field reports, breaker operations, etc., and

uses this information to track and report interdepartmental, intercompany, and external regulatory requests as required.

Tampa Electric continues to review system performance and related metrics on a daily basis. Primary areas of focus include incremental and year-to-date semi-weekly SAIDI, CAIDI, and SAIFI performance for Transmission, Substation and Distribution, year-to-date MAIFIe and associated breaker operations, customer outages by system and service area and major unplanned outages. In addition, Tampa Electric reviews the status of de-energized underground cables, reclosers, online capacitor banks, and streetlights previously identified as needing maintenance.

In 2025, Tampa Electric continued the company's increased focus on the priority of feeder restoration activities. One example of this priority is the review and report of lessons learned on feeder outages where the outage duration exceeded acceptable thresholds. This review and report are done periodically in pursuit of continued improvements with response time.

In addition to periodically reviewing performance as noted above, the company analyzes distribution circuit performance, including feeders represented on the three percent feeder list, through a number of different ongoing processes. These processes include tree trimming analysis and circuit analysis.

Tampa Electric's distribution "Adjusted" MAIFIe and L-Bar performed better in 2025 compared to 2024. "Adjusted" SAIDI, CAIDI, SAIFI and CEMI-5 showed a performance decline relative to 2024. Tampa Electric's distribution "Actual" metrics all performed better in 2025 when compared to 2024. The long-term trend (5-10 years) for all metrics shows consistent improvement demonstrating the effectiveness of our ongoing efforts.

Outage Events & Details

Generation Events

Tampa Electric did not experience any outages due to generation events that would have impacted Distribution Reliability. Because of this, there are no exclusions related to generation outage events.

Transmission Events

In 2025, there were 14 transmission outages that affected customers. As a result, there were 2,685,463 Customer Minutes of Interruption (“CMI”) and 175,764 Customer Interruptions (“CI”) excluded from the 2025 Annual Distribution Service Reliability Report per FAC Rule 25-6.0455. All outages were attributed to transmission equipment as noted within the 2025 Adjustments: Transmission Outage Events in Reliability Appendix D.

Equipment Failure Outages

There were four outages attributed to wood poles, static wires and associated splices, and crossarm failures.

Vehicle Collision Outages

There were two outages due to vehicle collisions with poles and guy wire.

Human Error Outages

There were zero outages due to human error.

Vegetation Related Outages

There was one outage due to vegetation.

Animal Related Outages

There were two outages related to animals.

Clearance Outages

There were no outages due to insufficient clearance.

Other and Weather Outages

There were five outages related to weather and other circumstances.

Transmission Outage Detail

69 kV Circuit

February 2025

Date: 2/03/2025 Circuit: 66051
Customers Affected: 9,903 SAIDI Impact: 2.41 (sec)
Discussion: Service was interrupted due to animal nest debris. The debris was removed, and the circuit was returned to service.
Event: Localized

Date: 2/20/2025 Circuit: 66652
Customers Affected: 3,417 SAIDI Impact: 0.44 (sec)
Discussion: Service was interrupted due to animal nest debris. The nest debris was removed, and the circuit was returned to service.
Event: Localized

March 2025

Date: 3/02/2025 Circuit: 66839
Customers Affected: 4,988 SAIDI Impact: 0.86 (sec)
Discussion: Service was interrupted when a vehicle came in contact with a pole. The pole was replaced, and the circuit was returned to service.
Event: Localized

Date: 3/03/2025 Circuit: 66007
Customers Affected: 37,429 SAIDI Impact: 11.63 (sec)

Discussion: Service was interrupted when a vehicle came in contact with down guys. The down guys were replaced, and the circuit was returned to service.
Event: Localized

Date: 3/05/2025 Circuit: 66838
Customers Affected: 5,391 SAIDI Impact: 11.95 (sec)
Discussion: Service was interrupted with no identified cause. The circuit was returned to service.

May 2025

Date: 5/04/2025 Circuit: 66832
Customers Affected: 14,406 SAIDI Impact: 46.97 (sec)
Discussion: Service was interrupted due to a pole on fire. The pole was replaced, and the circuit was returned to service.
Event: Localized

Date: 5/13/2025 Circuit: 66838
Customers Affected: 5,576 SAIDI Impact: 4.77 (sec)
Discussion: Service was interrupted with no identified cause. The circuit was returned to service.
Event: Localized

Date: 5/15/2025 Circuit: 66837
Customers Affected: 16,772 SAIDI Impact: 4.10 (sec)
Discussion: Service was interrupted with no identified cause. The circuit was returned to service.
Event: Localized

Date: 5/21/2025 Circuit: 66016
Customers Affected: 15,385 SAIDI Impact: 1.21 (sec)

Discussion: Service was interrupted due to a fallen tree. The tree was removed, and the circuit was returned to service.
Event: Localized

June 2025

Date: 6/11/2025 Circuit: 66426
Customers Affected: 13,548 SAIDI Impact: 37.36 (sec)
Discussion: Service was interrupted due to crossarm failure. The crossarm was replaced, and the circuit was returned to service.
Event: Localized

July 2025

Date: 7/29/2025 Circuit: 66436
Customers Affected: 17,773 SAIDI Impact: 13.73 (sec)
Discussion: Service was interrupted with no identified cause. The circuit was returned to service. Event: Localized

August 2025

Date: 08/22/2025 Circuit: 66046
Customers Affected: 22,165 SAIDI Impact: 31.39 (sec)
Discussion: Service was interrupted due to a splice failure. Equipment was replaced, and circuits were returned to service.
Event: Localized

Date: 08/31/2025 Circuit: 66011
Customers Affected: 6,797 SAIDI Impact: 7.02 (sec)
Discussion: Service was interrupted due to weather in the area. The weather passed, and the circuit was returned to service. Event: Localized

138 kV Circuit

There were no outages on the 138kV circuits in 2025.

230 kV Circuit

April 2025

Date: 04/23/2025 Circuit: 230412

Customers Affected: 1,737 SAIDI Impact: 10.09(sec)

Discussion: Service was interrupted due to conductor deadened failure. The conductor was replaced, and the circuit was returned to service.

Event: Localized

Extreme Weather

Tampa Electric experienced no extreme weather events during 2025 which affected transmission customers.

Other Distribution – Adjustments

In 2025, there were 9,031 Other Distribution outages that affected customers. A total of 20,786,034 CMI and 388,555 CI were excluded from the 2025 Annual Distribution Service Reliability Report per FAC Rule 25-6.0455. All outages were attributed to planned events as noted within the 2025 Adjustments: Other Distribution Outage Events in Reliability Appendix D.

Distribution Substation

Distribution Substation Adjustments

In 2025, there were 300 Distribution Substation outages that affected customers. A total of 6,155,216 CMI and 131,163 CI were excluded from the 2025 Annual Distribution Service Reliability Report per FAC Rule 25-6.0455. All outages were attributed to substation equipment as noted within the 2025 Adjustments: Substation Outage Events in Reliability Appendix D.

Patterns and Trends – Distribution Substation Reliability Performance

In 2025, animal contact was the leading contributor to substation outages affecting SAIDI (see Exhibit 4). When possible, Tampa Electric installs animal guards on all 13kV circuit breaker terminals, transformers, low side bushings, and bus

insulators. Occasionally, animals get around the guards and make contact with the 13kV bus.

The second leading contributor to SAIDI in 2025 was substation outages due to breaker failure/relay controls. Tampa Electric has upgraded the relay and protection scheme to improve reliability and reduce future outages.

The third leading substation outage contributor to SAIDI in 2025 was due to circuit breaker mis-operation. Tampa Electric currently has a program in place to replace aging and problematic circuit breakers.

Process to Promote Substation Reliability

Tampa Electric's Substation Department utilizes the following processes and activities to determine the actions to promote substation reliability:

- Routine substation inspections
- Root cause analysis of outages
- Track and review all substation outages

Tampa Electric performs the following actions as needed, based on the outcomes of the substation inspections and outage root cause analysis:

- Review of all circuit breaker mis-operation
- Installation of animal protection in substations
- Install microprocessor-based relays for reclosing in all new construction and upgrading projects
- Replace station wide static under frequency relays with feeder-based microprocessor under frequency relays in all new construction projects
- Replacing 13-kV circuit breakers that have been identified as problem breakers
- Increased lightning withstand protection on Tampa Electric Large Autotransformers

- An improved standard of all bushings on all new transformers and circuit breakers
- Implementation of automatic bus restoration schemes in stations with multiple transformers and microprocessor-based relay protection schemes.

The exhibits that follow provide the number of distribution substation inspections performed by year and the SAIDI impact in minutes for distribution substation outages by cause. This information is used to gauge and track the substation reliability.

Exhibit 3: Substation Inspections by Year

Year	Distribution Substations Inspections	Transmission Substations Inspections
2021	460	218
2022	411	196
2023	615	318
2024	524	414
2025	532	336

Exhibit 4: 2025 Distribution Substation Outages

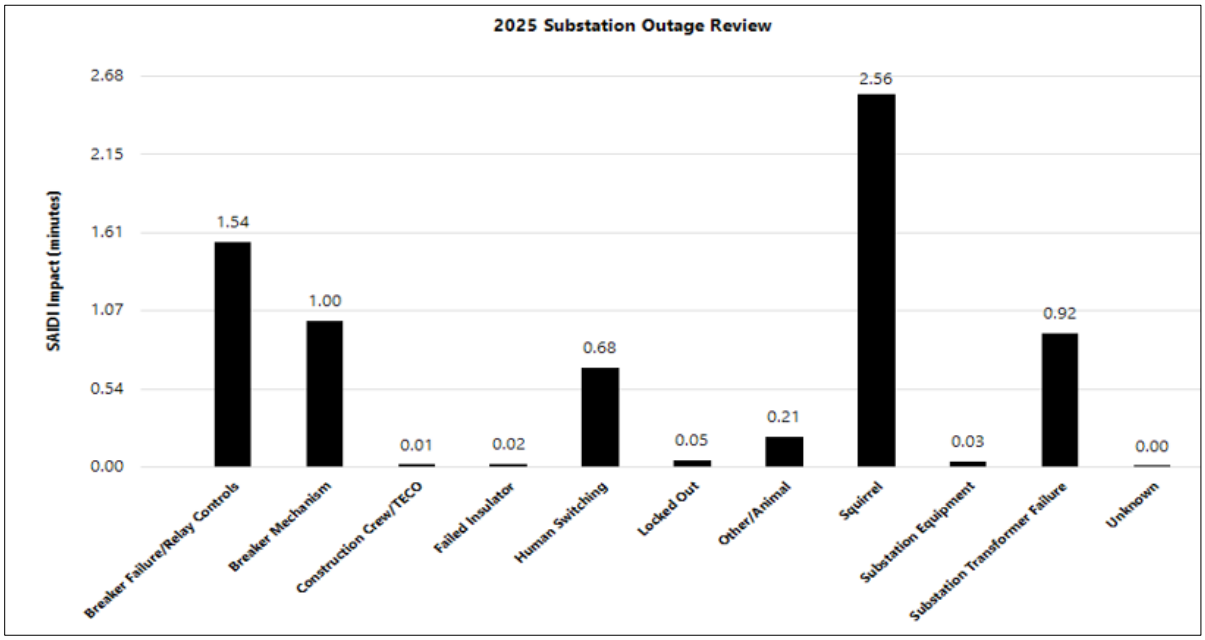

Exhibit 5: 2024 Distribution Substation Outages

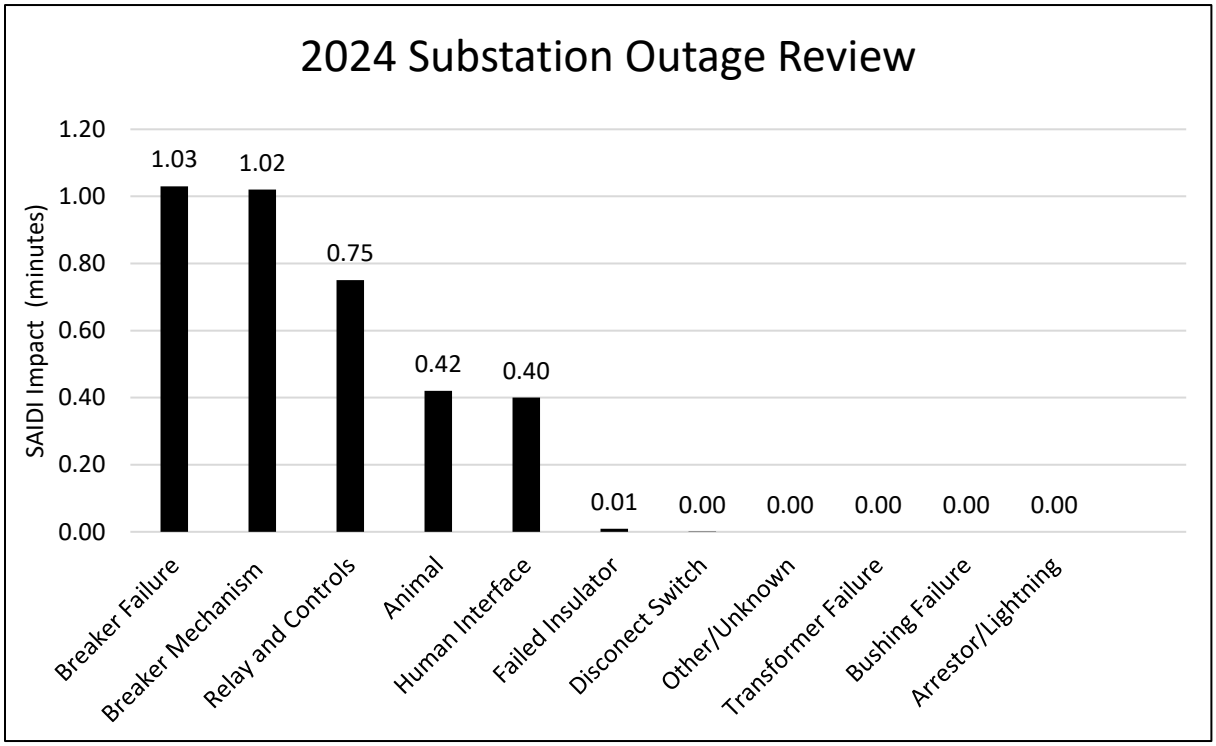

Exhibit 6: 2023 Distribution Substation Outages

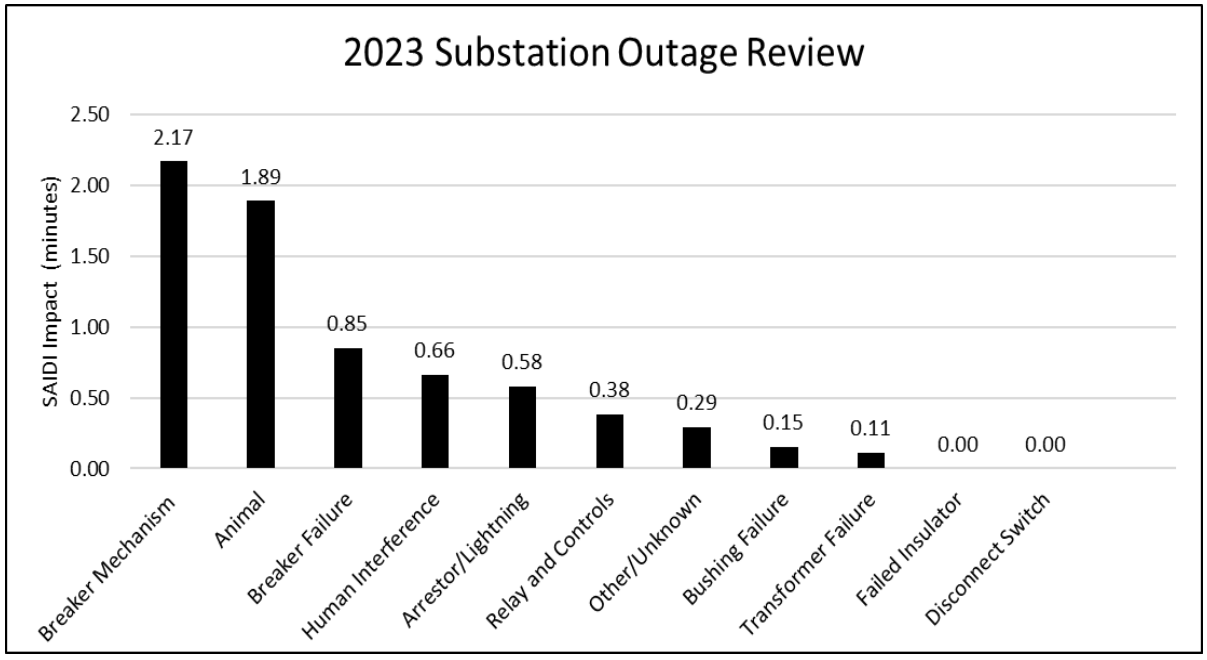

Exhibit 7: 2022 Distribution Substation Outages

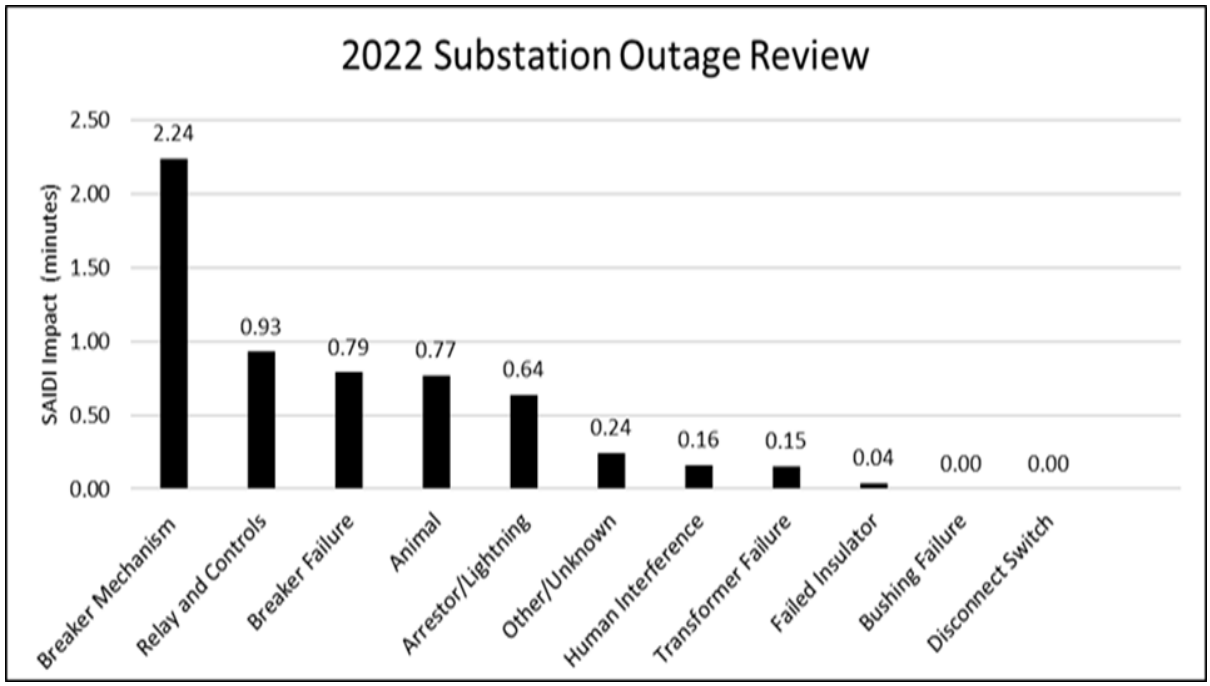

Exhibit 8: 2021 Distribution Substation Outages

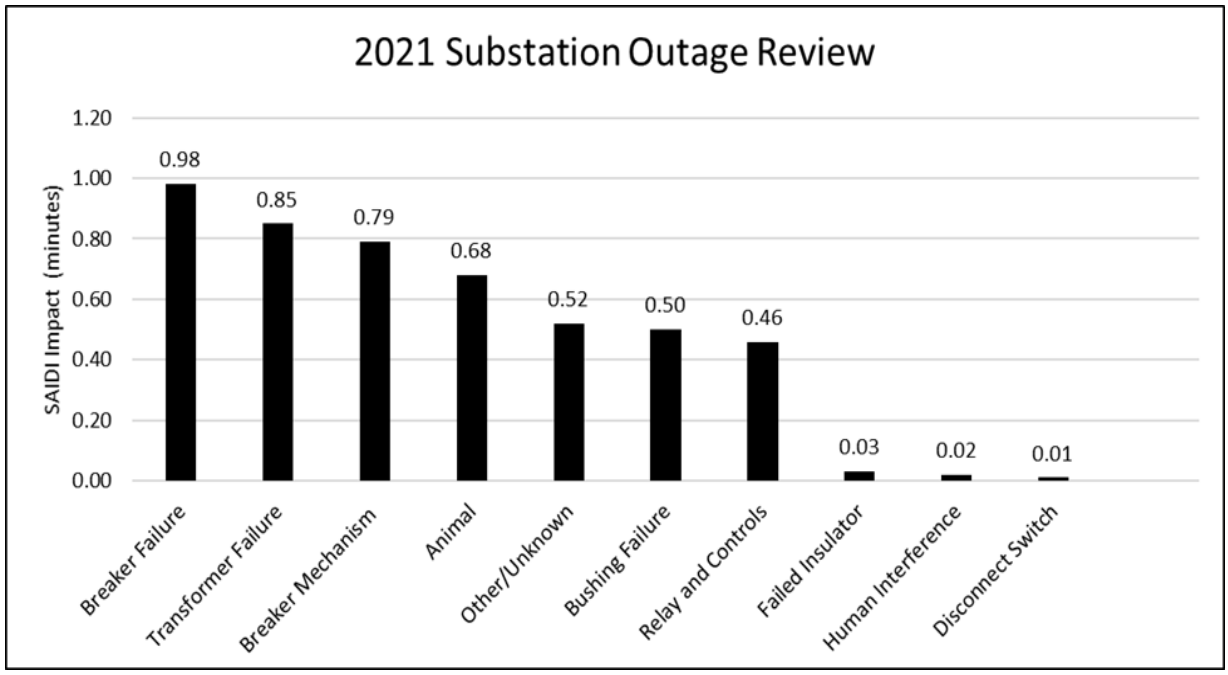

Exhibit 9: Substation Outages due to Animal

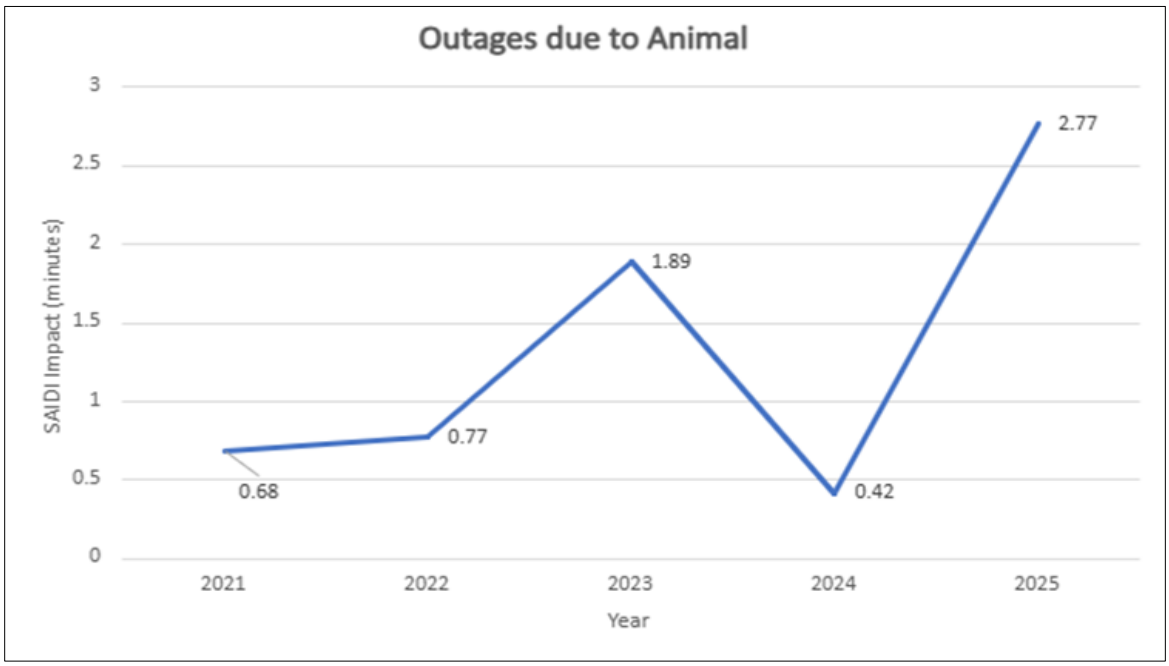

Exhibit 10: Substation Outages due to Relay and Controls

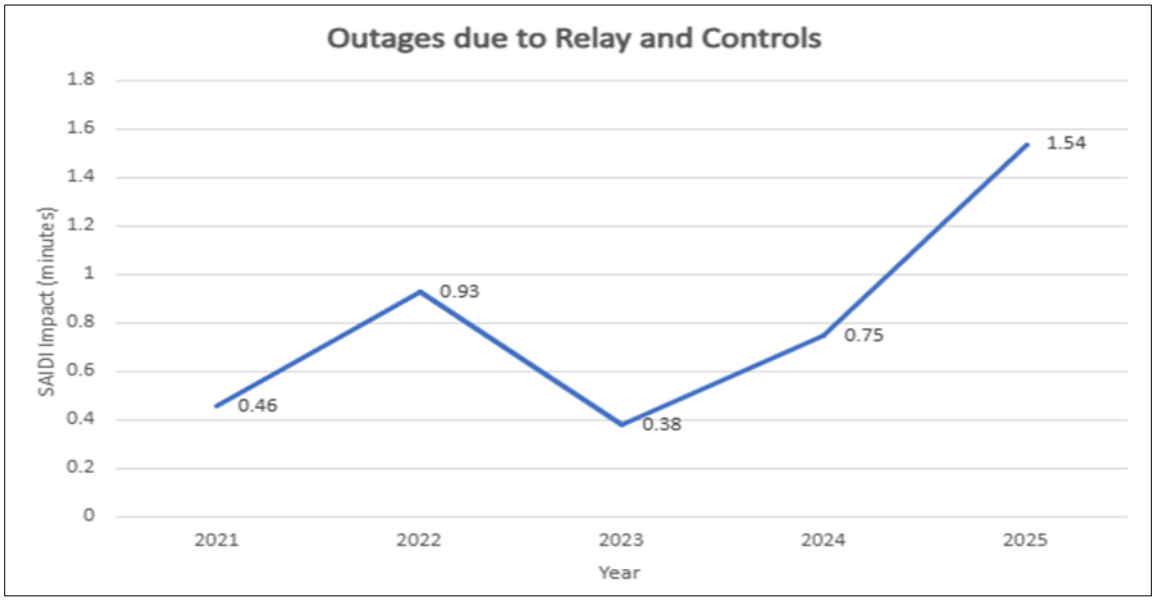

Exhibit 11: Substation Outages due to Breaker Mechanisms

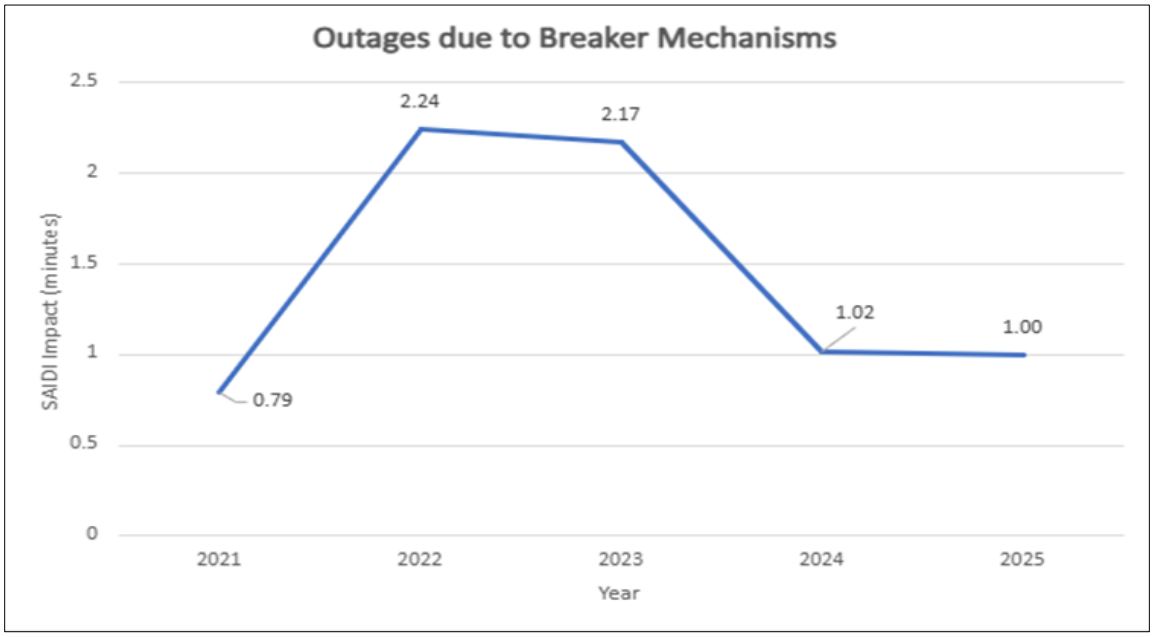

Adjusted Distribution Reliability

Three Percent Feeder

In 2025, Tampa Electric identified 17 circuits that have been listed once before in the prior five years. These circuits include:

1. Mulberry Circuit 13008
2. Eleventh Avenue Circuit 13178
3. Double Branch Circuit 13191
4. Ruskin Circuit 13817
5. Lake Silver Circuit 13290
6. Sun City Circuit 13305
7. East Winter Haven Circuit 13308
8. East Winter Haven Circuit 13311
9. Plant City Circuit 13414
10. Clarkwild Circuit 13459
11. Clarkwild Circuit 13461
12. South Eloise Circuit 13470
13. State Road 574 Circuit 13502
14. Berkley Circuit 13696
15. Ruskin Circuit 13820
16. First Street Circuit 13898
17. Estuary Circuit 13942

Actual events for Mulberry 13008 included 2 circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the poles, transformers, and added animal guards. In addition, the company conducted tree trimming on this circuit.

Actual events for Eleventh Avenue Circuit 13178 included three circuit outages as reported. The company completed corrective activities on this circuit in 2025 by

performing the following: replaced the transformers and the overhead conductor. In addition, the company conducted tree trimming on this circuit.

Actual events for Double Branch Circuit 13191 included four circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the overhead conductor, replaced the pole top insulator, replaced lightning arrestors, and replaced transformers. In addition, the company conducted tree trimming on this circuit.

Actual events for Ruskin Circuit 13817 included one circuit outage as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the transformers, added animal guards, and replaced poles. In addition, the company completed tree trimming on this circuit.

Actual events for Lake Silver Circuit 13290 included three circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced poles, the overhead conductor, and blown lightning arrestors. In addition, the company conducted tree trimming on the circuit.

Actual events for Sun City Circuit 13305 included two circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: conducted tree trimming on the circuit, replaced the overhead primary conductor, transformers, and poles.

Actual events for East Winter Haven Circuit 13308 included one circuit outage as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the underground cable, added an animal guard, and conducted tree trimming on the circuit.

Actual events for East Winter Haven Circuit 13311 included one circuit outage as reported. The company completed corrective activities on this circuit in 2025 by

performing the following: added an animal guard and conducted tree trimming on the circuit.

Actual events for Plant City Circuit 13414 included two circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the primary switch, lightning arrestors, and poles. In addition, the company also conducted tree trimming.

Actual events for Clarkwild Circuit 13459 included one circuit outage as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the transformers and underground cables as well as repaired the overhead conductors. In addition, the company also conducted tree trimming on this circuit.

Actual events for Clarkwild Circuit 13461 included five circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the transformers, replaced the primary line fuses, added an animal guard, and replaced the underground cable.

Actual events for South Eloise Circuit 13470 included one circuit outage as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the transformers, added an animal guard, and underground conductor as well as repaired overhead primary conductor. In addition, the company also performed tree trimming on the circuit.

Actual events for State Road 574 Circuit 13502 included one circuit outage as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the pole, repaired the overhead and underground primary conductor, and conducted tree trimming on the circuit.

Actual events for Berkley Circuit 13696 included five circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing

the following: de-vined pole, repaired the overhead primary conductor, added an animal guard, replaced the cut outs, and replaced the burnt taps.

Actual events for Ruskin Circuit 13820 included two circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: replaced the transformers, the overhead and underground primary conductors, replaced the switchgear padmounted equipment ("PME"), and poles.

Actual events for First Street Circuit 13898 included two circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: added an animal guard and the company conducted some tree trimming on the circuit.

Actual events for Estuary Circuit 13942 included four circuit outages as reported. The company completed corrective activities on this circuit in 2025 by performing the following: repaired the underground primary conductor and replaced the transformers and poles.

Other circuits identified in both the "Actual" and "Adjusted" reports have had maintenance activities performed as noted in the Three Percent Feeder Reports, Form 102 – Part II – Actual and Form 103 – Part II – Adjusted. The company will continue to monitor circuit outage performance as part of its daily and ongoing review of system reliability and will respond accordingly.

Regional Reliability Indices & Trends

Exhibit 12 below represents customers by service area for 2025. Dade City, Plant City and Winter Haven have the fewest customers and represent the most rural, lowest customer density per line mile in comparison to the other four Tampa Electric service areas. Actual reliability indices for rural areas have varied from those of the most urban, densely populated areas for this period. This is due to the greater distance of travel for service restoration in rural areas.

Exhibit 12: Number of Customers by Service Area

Service Area	2021	2022	2023	2024	2025
Central	215,086	217,724	219,838	222,973	225,835
Dade City	15,873	16,246	16,928	17,949	18,890
Eastern	131,248	133,486	134,994	136,599	137,651
Plant City	64,369	65,198	66,261	67,754	68,930
South Hillsborough	101,875	107,101	110,875	114,875	116,595
Western	214,077	215,985	217,506	219,415	220,666
Winter Haven	81,794	84,575	86,931	90,430	92,274
Total	**824,322**	**840,315**	**853,333**	**869,995**	**880,841**

When compared to 2024, SAIDI by service area decreased in all areas with the exception of Central, Plant City, South Hillsborough, and Western service areas as shown in Exhibit 13 below. The 2025 SAIDI performance, when compared to the five-year average, decreased in all areas with the exception of Dade City, Plant City, and Winter Haven service areas.

Exhibit 13: SAIDI by Service Area

Service Area	2021	2022	2023	2024	2025	Five Year Average
Central	63.81	40.66	54.72	45.28	59.08	52.71
Dade City	138.06	142.63	94.93	196.59	136.59	141.76
Eastern	64.67	57.06	51.31	81.85	79.87	66.95
Plant City	157.34	128.88	86.49	89.70	113.68	115.22
South Hillsborough	61.23	75.04	50.67	68.14	80.07	67.03
Western	76.52	70.24	46.76	61.90	74.12	65.91
Winter Haven	152.97	93.66	78.15	88.53	86.32	99.93
Total	**84.50**	**69.40**	**57.27**	**69.31**	**77.66**	**71.63**

When compared to 2024, CAIDI by service area increased in all service areas with the exception of Dade City and Eastern as shown in Exhibit 14 below. The 2025

CAIDI performance, when compared to the five-year average, increased for all service areas with the exception of Dade City, Eastern, and Winter Haven.

Exhibit 14: CAIDI by Service Area

Service Area	2021	2022	2023	2024	2025	Five Year Average
Central	79.08	60.79	78.19	70.85	73.47	72.47
Dade City	68.43	57.15	87.99	77.84	65.06	71.30
Eastern	63.79	59.45	67.20	70.35	63.11	64.78
Plant City	83.68	70.85	67.03	54.85	76.54	70.59
South Hillsborough	56.70	69.83	62.84	62.23	82.60	66.84
Western	78.78	73.94	69.78	70.52	82.62	75.13
Winter Haven	124.05	68.49	66.08	67.35	72.21	79.63
System	**79.30**	**67.13**	**69.96**	**67.39**	**74.43**	**71.64**

When compared to 2024, SAIFI by service area increased in all service areas with the exception of Dade City, Plant City, South Hillsborough, and Winter Haven, as shown in Exhibit 15 below. The 2025 SAIFI performance, when compared to the five-year average, increased for all service areas with the exception of Plant City, South Hillsborough, and Winter Haven.

Exhibit 15: SAIFI by Service Area

Service Area	2021	2022	2023	2024	2025	Five Year Average
Central	0.81	0.67	0.70	0.64	0.80	0.72
Dade City	2.02	2.50	1.08	2.53	2.10	2.04
Eastern	1.01	0.96	0.76	1.16	1.27	1.03
Plant City	1.88	1.82	1.29	1.64	1.49	1.62
South Hillsborough	1.08	1.07	0.81	1.09	0.97	1.01
Western	0.97	0.95	0.67	0.88	0.90	0.87
Winter Haven	1.23	1.37	1.18	1.31	1.20	1.26
Total	**1.07**	**1.03**	**0.82**	**1.03**	**1.04**	**1.00**

When compared to 2024, MAIFIe by service area decreased in all service areas with the exception of Central and Western service areas as shown in Exhibit 16 below. The 2025 MAIFIe performance, when compared to the five-year average, decreased in all service areas.

Exhibit 16: MAIFIe by Service Area

Service Area	2021	2022	2023	2024	2025	Five Year Average
Central	5.37	5.47	5.37	4.34	4.50	5.01
Dade City	6.51	8.64	6.45	6.91	6.26	6.96
Eastern	5.96	7.10	6.45	6.30	6.14	6.39
Plant City	7.49	8.27	7.85	7.23	5.74	7.32
South Hillsborough	5.95	7.90	4.71	4.03	2.72	5.06
Western	7.56	8.59	7.30	5.89	5.96	7.06
Winter Haven	7.48	8.33	8.06	5.85	5.22	6.99
System	**6.50**	**7.40**	**6.43**	**5.43**	**5.09**	**6.17**

When compared to 2024, CEMI% by service area increased in all service areas with the exception of the Dade City service area as shown in Exhibit 17 below. The 2025 CEMI% performance, when compared to the five-year average, increased in all service areas with the exception of Dade City. Central and South Hillsborough service areas remained the same.

Exhibit 17: CEMI% by Service Area

Service Area	2021	2022	2023	2024	2025	Five Year Average
Central	0.12%	0.02%	0.06%	0.02%	0.05%	0.05%
Dade City	0.09%	4.95%	0.72%	4.56%	1.43%	2.35%
Eastern	1.09%	0.11%	0.05%	0.86%	1.17%	0.66%
Plant City	2.32%	0.81%	0.64%	0.26%	3.76%	1.56%
South Hillsborough	0.29%	0.28%	0.00%	0.02%	0.15%	0.15%
Western	0.07%	0.29%	0.05%	0.00%	0.16%	0.12%
Winter Haven	0.18%	1.64%	0.19%	0.18%	1.12%	0.66%
Total	**0.46%**	**0.46%**	**0.12%**	**0.28%**	**0.70%**	**0.40%**

Overhead – Underground Reliability

Five-Year Trends – Reliability Performance

Exhibit 18: Outages per Year

System Totals (Distribution Outages)	**2021**	**2022**	**2023**	**2024**	**2025**
Number of Outages Events (N)	9,895	9,212	8,244	11,943	11,648
System Average Duration (L-BAR)	174.85	141.78	130.35	164.22	136.54
Average Restoration Time (CAIDI)	79.30	67.13	69.96	67.39	74.43

Overhead (Distribution Outages)	**2021**	**2022**	**2023**	**2024**	**2025**
Number of Outages Events (N)	7,992	7,802	6,612	9,293	8,273
System Average Duration (L-BAR)	169.80	135.66	120.27	155.61	120.52
Average Restoration Time (CAIDI)	75.46	64.21	65.86	62.19	66.03

Underground (Distribution Outages)	**2021**	**2022**	**2023**	**2024**	**2025**
Number of Outages Events (N)	1,903	1,410	1,632	2,650	3,375
System Average Duration (L-BAR)	196.05	175.66	171.18	194.41	175.81
Average Restoration Time (CAIDI)	108.54	106.75	107.41	121.49	120.26

Exhibit 19: Overhead and Underground Outage Duration

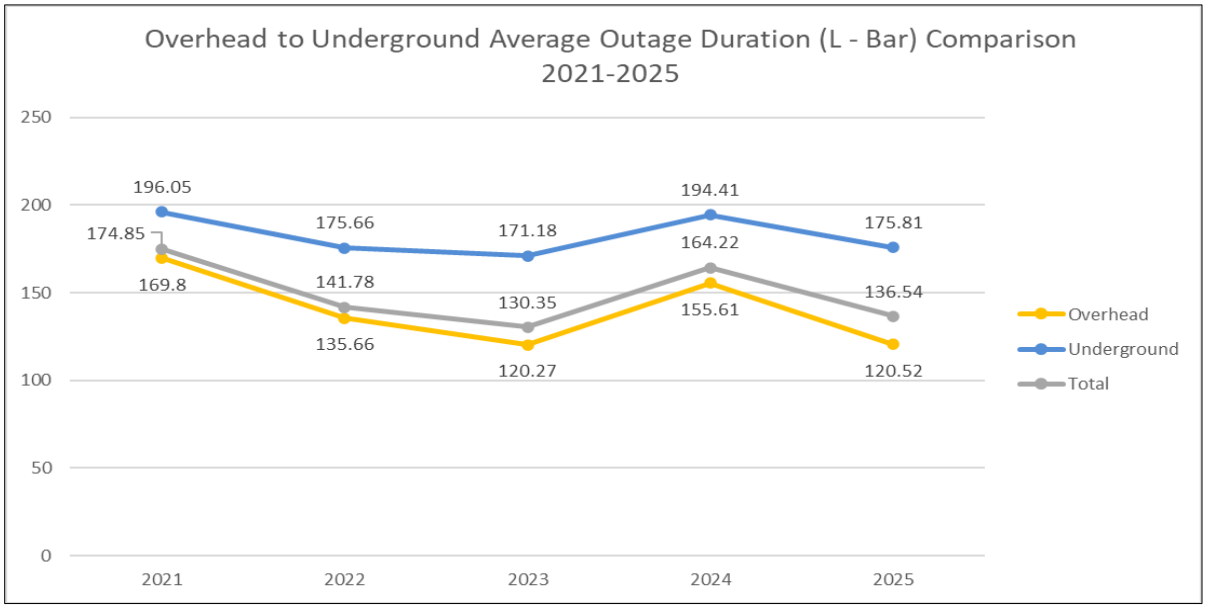

Tracking Overhead and Underground Reliability Performance

Tampa Electric tracks outage records in the company's DOD according to the cause and equipment type. These equipment types are designed and associated with the overhead and underground systems. Reporting capability allows the company to track the CMI, CI, Number of outages, Average Duration, and CAIDI. In addition, separate reporting was undertaken in order to align miles and customers for overhead and underground distribution.

The company tracks and reports MAIFIe by system and circuit. Interruption data is electronically captured, recorded, and tracked at each individual distribution circuit breaker. As a result, a momentary interruption occurring down-line from the circuit breaker in which the circuit breaker does not operate is not able to be captured and reported.

The company currently measures CEMI-5 through a query that is run through the company's distribution management system ("DMS"). There is no option in DMS to run a query for overhead or underground systems.

Underground Distribution System Conversions

Tampa Electric's Storm Protection Plan is converting overhead distribution laterals for extreme weather hardening within the company's Distribution Lateral Undergrounding Program. Updates for accomplishments within this program are provided in the company's Storm Protection Plan Annual Status Report that is provided to the Commission on June 1 of each year.

Reliability-Related Customer Complaints

In 2025, Tampa Electric experienced an increase of 62 formal service-related complaints as logged by the Florida Division of Consumer Affairs and noted in Exhibit 20. In comparison to the five-year average, overall formal complaints increased by 110% percent in 2025. In addition, service-related complaints as

tracked by the company and including FPSC Formal, Three-Day, Transfer-Connect, Warm Transfer, and Executive Level decreased by 41 complaints in 2025 as noted in Exhibit 21 below. In comparison to the five-year average, service-related complaints tracked by the company decreased by 40% in 2025.

Exhibits 22 and 23 compare the FPSC Formal complaints to the company's reliability performance over the last five years. Over the past four years the complaints tracked with the reliability performance. In 2025, complaints were higher than the reliability performance, with two-thirds of the total complaints received in August alone, due to high bill concerns driven by consumption. The company's continued focus on activities such as vegetation management, circuit review activity, resulting line improvements and other maintenance activities will contribute toward minimizing service-related complaints in 2026 and beyond.

Tampa Electric's current process for responding to all service-related complaints includes the central intake and coordination of complaint resolution through the company's Executive Solutions Department and extends out to operations engineers who are responsible for the daily oversight of feeders in their respective service area. Operations Engineers are involved in customer interactions, identifying needs and corrective measures, and are responsible for coordination through completion. Working through and responding to complaints at a region/service area level provides the company with an opportunity to be aware of any trends that may occur for a given feeder or lateral.

In addition, the group of Operations Engineers and System Reliability meets monthly to review common areas of concern across the system and identify opportunities for improvement.

Exhibit 20: Tampa Electric Formal Reliability Complaints Filed with the FPSC by Year

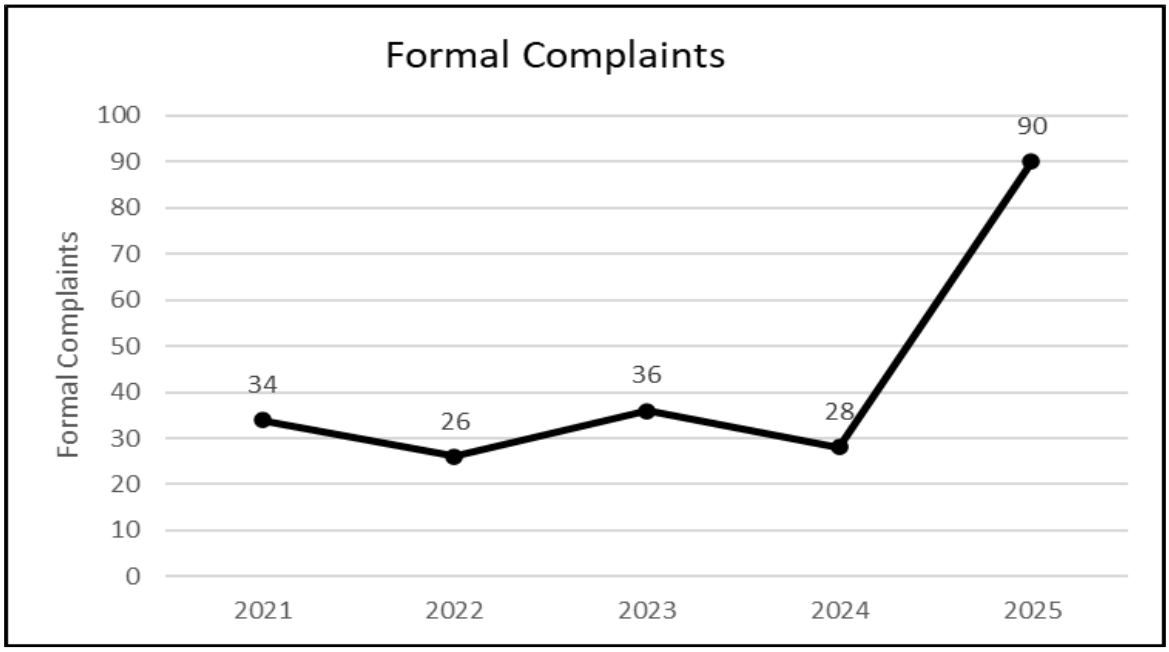

Exhibit 21: Tampa Electric Service Complaints by Year

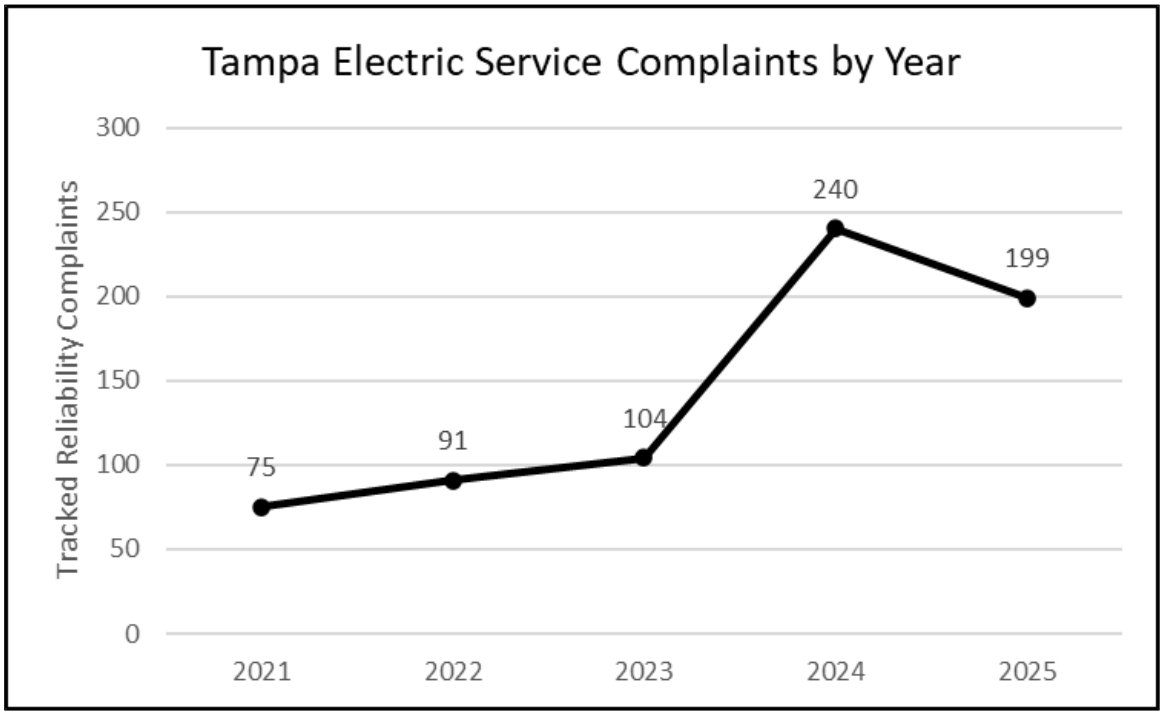

Exhibit 22: Formal Complaints vs. SAIDI by Year

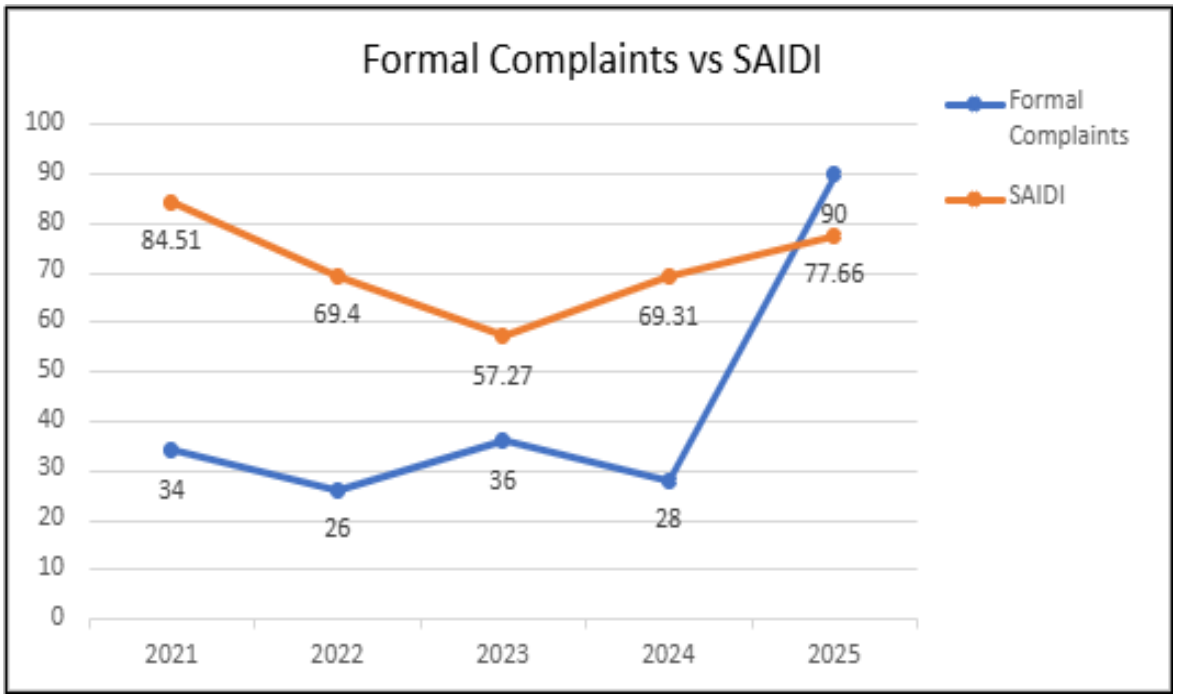

Exhibit 23: Formal Complaints vs. MAIFIe by Year

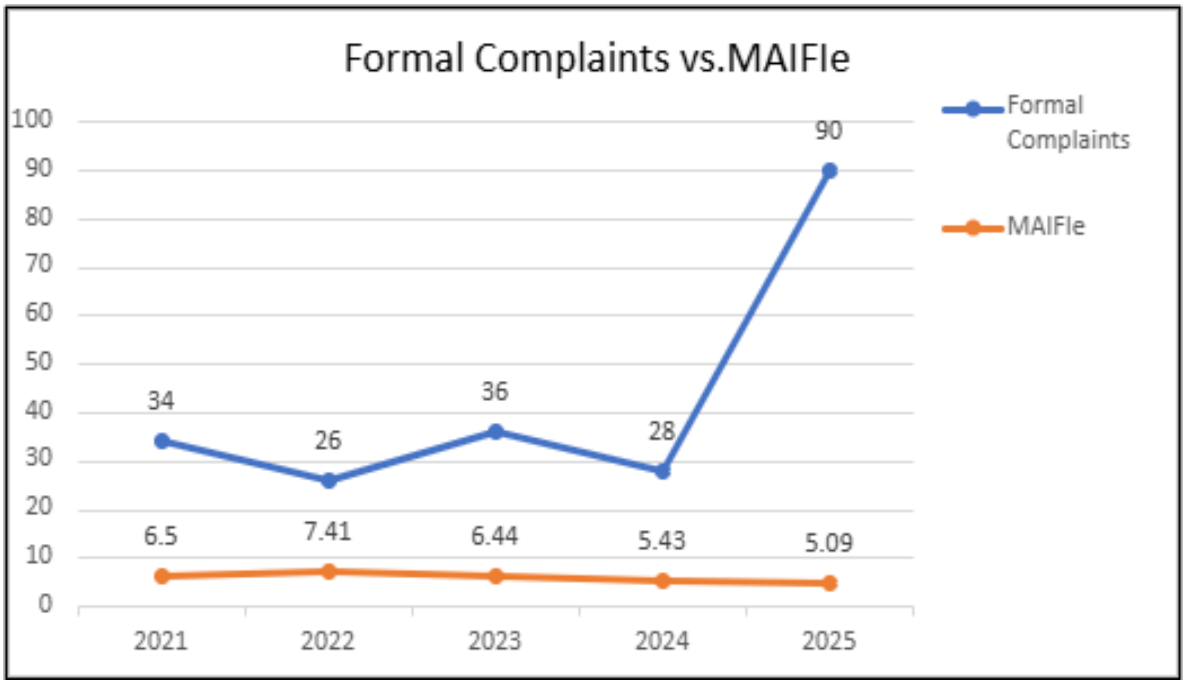

APPENDIX

2025

ANNUAL RELIABILITY PERFORMANCE REPORT

Appendix A – Actual Data

Form PSC/ECR 102-1(a)(8/06)

Primary Causes of Outage Events – Actual

Primary Causes of Outage Events - Actual			
Utility Name: Tampa Electric			Year: 2025
Cause (a)	**Number of Outages Events (N)** (b)	**Average Duration (L-Bar)** (c)	**Average Restoration Time (CAIDI)** (d)
Planned Outage	8,847	96.90	50.92
Unknown	1,762	88.93	40.68
Animals	1,599	84.86	63.43
Vegetation	1,581	146.55	88.29
Other Weather	1,182	121.94	61.22
Lightning	1,180	179.45	108.04
Down Wire	1,175	159.54	98.42
Defective Equipment	933	202.17	95.06
Electrical	559	136.48	83.25
Vehicle	451	161.14	90.65
Bad Connection	434	151.91	75.73
Other	247	140.03	163.16
Human Interference	229	135.27	44.38
Substation Equipment	193	208.01	73.86
Fire	115	101.67	56.80
Transmission Equipment	9	129.10	54.01
Customer Owned Equipment	2	495.22	523.31
Total	**20,498**	**119.42**	**67.86**

Note: L-Bar and CAIDI are expressed in minutes.

Form 102 – Part II Three Percent Feeder List – Actual

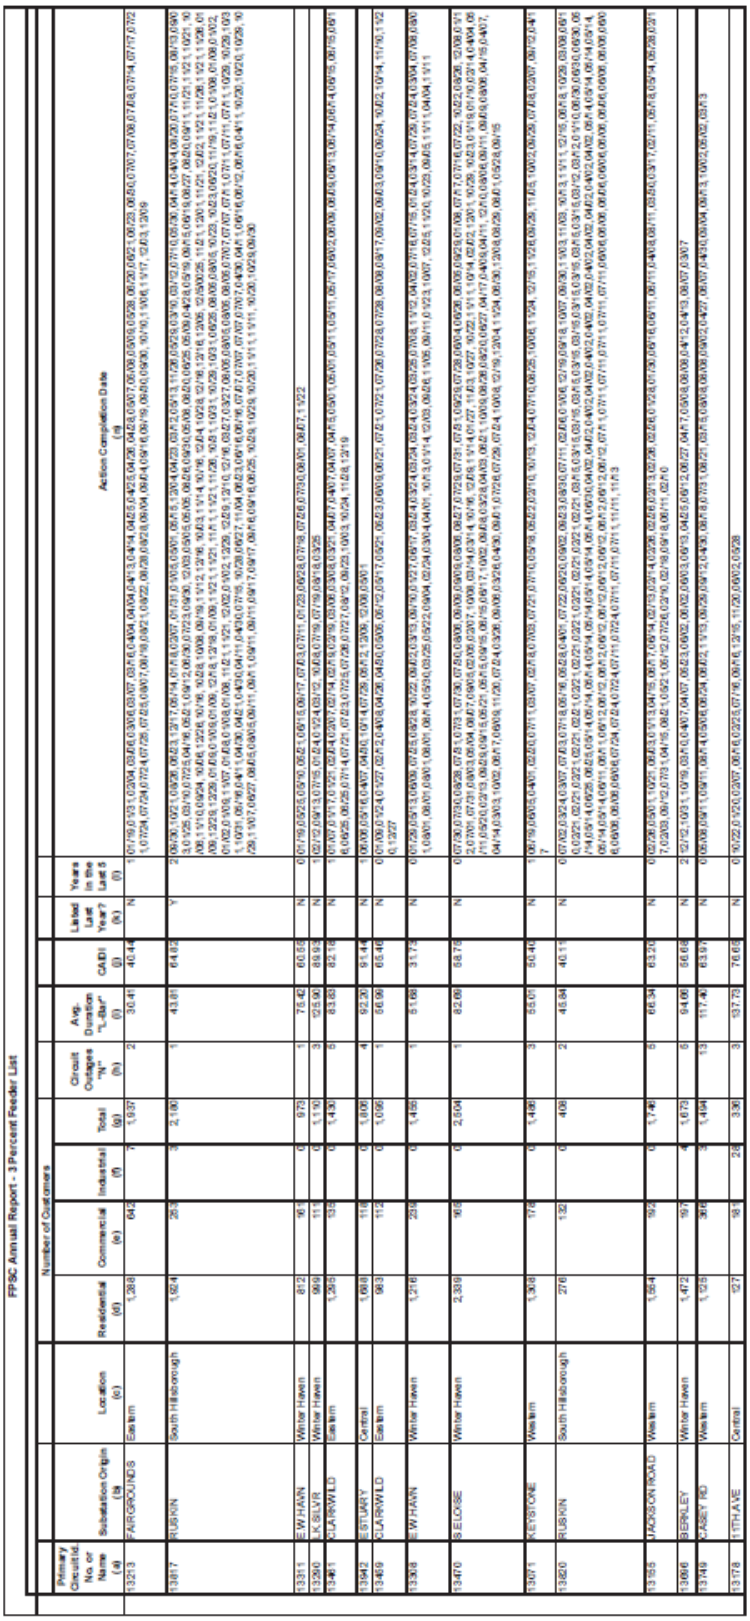

FPSC Annual Report - 3 Percent Feeder List

Primary Circuit Id. No. or Name (a)	Substation Origin (b)	Location (c)	Number of Customers				Total (g)	Circuit Outages "N" (h)	Avg. Duration "L_Bar" (i)	CAIDI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (m)
			Residential (d)	Commercial (e)	Industrial (f)								
13213	FAIRGROUNDS	Eastern	1,268	642	7	1,937	2	30.41	40.44	N	1	01/19/21,03/04,03/06,03/07,03/16,04/04,04/04,04/13,04/14,04/25,04/26,04/28,0/0/07,06/06,0/0/09,0/0/28,06/26,09/21,06/23,06/30,07/07,07/08,07/08,07/14,07/17,07/2 1,07/24,07/24,07/24,07/25,07/25,09/07,06/18,09/21,09/22,06/26,09/28,09/04,09/14,09/16,09/19,09/30,10/10,10/06,11/17,12/03,12/09
13817	RUSKIN	South Hillsborough	1,924	283	3	2,180	1	43.81	64.62	Y	2	06/30,10/21,09/26,06/21,12/17,06/14,01/16,03/07,01/31,03/09,03/01,05/15,12/04,04/23,03/12,05/18,03/26,03/16,03/12,07/10,06/30,04/14,04/20,06/20,07/10,06/30, 3,0/1/25,03/10,07/25,04/16,06/21,09/12,06/30,07/23,09/09,03/05,06/05,06/26,09/30,06/25,05/09,04/28,09/19,06/15,06/16,09/27,06/20,09/11,11/21,12/21,10/21, 06,11/10,09/24,10/06,12/06,10/16,10/23,10/16,06/18,11/12,12/16,10/23,11/14,10/16,12/04,10/28,12/16,12/05,12/30/25,11/21,12/01,11/21,12/23,12/21,11/28,01 01/02,01/09,11/07,01/28,01/08,01/08,01/08,11/21,12/23,12/02,01/02,12/29,12/29,12/10,12/16,03/27,06/05,03/05,03/05,06/05,06/05,07/07,07/07,07/11,07/11,07/11,07/25,07/25,07/25

FPSC Annual Report - 3 Percent Feeder List

	Primary Circuit Id. No. or Name (a)	Substation Origin (b)	Location (c)	Number of Customers				Circuit Outages "N" (h)	Avg. Duration "L-Bar" (i)	CAIDI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (m)
				Residential (d)	Commercial (e)	Industrial (f)	Total (g)						
	13305	SUN CITY	South Hillsborough	1,704	190	0	1,894	2	46.98	33.04	N	0	07/30,07/22,03/14,04/12,0,307, 12,05, 11,05,1,108, 10,27,0,305,0,9/11, 05/17, 10/24,06/11, 03/18,03/20, 12/04,07/06,07/03, 06/05,03/02,06/05,05/22,06/05,04/15,0,4/15,04/15,0,4/15,04/15,0,4/15,04/15,04/15,0,4/15,04/15,04/15,0,4/15,04

Form 102 – Part III

Annual Distribution Service Reliability Report – Actual

SAIDI: System Average Interruption Duration Index

= Sum of All Customer Minutes Interrupted (CMI)	86,544,561	**98.25**
Total number of Customers Served (C)	880,841	

CAIDI: Customer Average Interruption Duration Index

= Sum of All Customer Minutes Interrupted (CMI)	86,544,561	**67.86**
Total number of Customers Interruptions (CI)	1,275,303	

SAIFI: System Average Interruption Frequency Index

= Total number of Customers Interruptions (CI)	1,275,303	**1.45**
Total number of Customers Served (C)	880,841	

MAIFIe: Momentary Average Interruption Event

= Sum of All Customer Momentary Interruption Events (CME)	4,994,656	**5.67**
Total number of Customers Served (C)	880,841	

LBar

= Minutes of Interruption	2,447,780	**119.42**
Total number of Outages	20,498	

District	C	CMI	CI	CME	# Cust > 5
Central	225,835	16,625,416	251,326	1,119,728	1,188
Dade City	18,890	3,083,801	47,995	133,988	755
Eastern	137,651	14,909,122	233,563	946,869	4,435
Plant City	68,930	10,071,675	149,044	441,980	5,491
South Hillsborough	116,595	11,407,093	169,380	371,855	1,635
Unknown	0	65,976	570	0	0
Western	220,666	20,886,816	284,177	1,439,385	3,435
Winter Haven	92,274	9,494,662	139,248	540,851	3,007
System Total:	880,841	86,544,561	1,275,303	4,994,656	19,946

Form 102 – Part III continued

Service Reliability Indices – Actual

Service Reliability Indices					
Utility Name: Tampa Electric				Year: 2025	
District or Service Area	**SAIDI** (b)	**CAIDI** (c)	**SAIFI** (d)	**MAIFIe** (e)	**CEMI-5 %** (f)
Central	73.62	66.15	1.11	4.96	0.53%
Dade City	163.25	64.25	2.54	7.09	4.00%
Eastern	108.31	63.83	1.70	6.88	3.22%
Plant City	146.11	67.58	2.16	6.41	7.97%
South Hillsborough	97.83	67.35	1.45	3.19	1.40%
Unknown	0.00	115.75	0.00	0.00	0.00%
Western	94.65	73.50	1.29	6.52	1.56%
Winter Haven	102.90	68.19	1.51	5.86	3.26%
System Total:	98.24	67.86	1.45	5.67	2.26%

Form PSC/ECR 102-3, Docket No. 011351-EI, Rule 25-6.0455(c)
Notes: L-Bar and CAIDI are expressed in minutes

Appendix B – Adjusted Data

Form PSC/ECR 102-1(b) (8/06)

Primary Causes of Outage Events - Adjusted

Causes of Outage Events - Adjusted

Utility Name: Tampa Electric Year: 2025

Cause (a)	Number of Outage Events(N) (b)	Average Duration(L-Bar) (c)	Average Restoration Time (CAIDI) (d)
Vegetation	1,581	146.55	88.29
Animals	1,599	84.86	63.43
Down Wire	1,175	159.54	98.42
Unknown	1,762	88.93	40.68
Lightning	1,180	179.45	108.04
Defective Equipment	933	202.17	95.06
Other Weather	1,182	121.94	61.22
Electrical	559	136.48	83.25
Vehicle	451	161.14	90.65
Bad Connection	434	151.91	75.73
All Remaining Causes	792	150.90	66.28
Total	**11,648**	**136.54**	**74.43**

Note: L-Bar and CAIDI are expressed in minutes.

Form 103 - Part II Three Percent Feeder List – Adjusted

FPSC Annual Report - 3 Percent Feeder List

Primary Circuit Id. No. or Name (a)	Substation Origin (b)	Location (c)	Number of Customers				Circuit Outages "N" (h)	Avg. Duration "L_dur" (i)	CAIDI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (m)
			Residential (d)	Commercial (e)	Industrial (f)	Total (g)						
13917	RUSKIN	South Hillsborough	1,824	253	3	2,180	1	43.06	85.12	N	1	03/30,10/21,03/26,09/23,12/17,03/14,01/18,03/07,01/21,01/05,03/01,03/15,12/04,04/23,09/12,09/13,11/26,05/29,03/10,03/12,07/15,05/30,04/04,04/04,09/20,07/23,03/15,08/31,10/06,03/11,05/03,07/21,04/06,09/20,09/23,12/23,03/23,03/30,03/27,03/16,03/27,03/29,03/28,03/29,03/28,03/29,03/28

FPSC Annual Report - 3 Percent Feeder List

Primary Circuit Id. No. or Name (a)	Substation Origin (b)	Location (c)	Number of Customers				Circuit Outages "N" (h)	Avg. Duration "L-Bar" (i)	CAIDI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (m)
			Residential (d)	Commercial (e)	Industrial (f)	Total (g)						
13305	SUN CITY	South Hillsborough	1,704	190	0	1,894	2	39.39	20.61	N	0	07/10,07/27,09/14,04/12,03/07,12/05,11/08,10/27,03/06,05/11,09/07,10/24,06/11,03/18,03/20,12/04,07/06,07/03,06/05,05/22,06/05,05/22,06/05,05/22

FPSC Annual Report - 3 Percent Feeder List

	Primary Circuit Id, No. or Name (a)	Substation Origin (b)	Location (c) Water/Haven	Number of Customers				Circuit Outages "N" (h)	Avg. Duration "L_Bar" (i)	CAIDI (j)	Listed Last Year? (k)	Years in the Last 5 (l)	Action Completion Date (m)
				Residential (d)	Commercial (e)	Industrial (f)	Total (g)						
	13024	LAKE GUM		1,482	366	4	1,852	3	130.49	90.29	N	2	1/1/10,1 1/06,1 1/06,0305,12/10,12/15,12/23,12/10,12/23,04/16,12/23,04/28,0 1/05,01/05,10/16,10/14,11/23,10/18,10/04,10/01,10/01,12/04,1 1/01,01/16,10/21,01/13,10/20,10/20,11/04,05/21,05/07,12/23,02/07/28,10/31/202,06/22,07/31,06/26,04/30,07/14,07/15,07/19,07/19,0 2,04/04,07/15,06/20,09/09,07/23,03/21,08/17,10/20,01/02,1 0/09,10/09,09/26,09/25,03/02,12/08,02/1 1,06/06,06/12,07/21,04/21,02/28,01/3 ,05/06,12/03,06/13,06/24,12/17,12/28,11/11,01/12,06/11,12/23,10/15,03/31,06/03,03/11,03/22,09/26,06/19,0 1/29,07/03,03/31,04/16,1 1/16, 06/26,06/11,06/04,04/07,03/20,1 1/20,09/23,03/31,04/04,03/13,05/10,06/17,06/25,05/07
	14090	PEBBLE CREEK	Central	600	89	0	689	3	103.67	65.00	N	0	05/19,06/17,05/19,06/02,04/18,04/23,04/28,05/14,04/07,06/13,04/30,03/08,08/20,07/23,08/15,03/20,08/13,04/09,04/08,03/31,06/20,0 6/08,05/27,03/17,03/17,02/14,04/21,02/21,10/1 0,06/1 4,06/02,04/14,06/03,05/23,03/24,03/25,1 1/03,1 1/03,0 1/07,10/31,10/14,10/14,11 /12,1 1/12,04/29,06/23,04/07,03/13,07/25,03/10,07/22,03/24,01/06
	13015	BLANTON	Dade City	643	102	0	745	4	197.39	108.65	Y	3	1/1/10,1 1/06,1 1/06,0305,12/10,12/15,12/23,12/10,12/23,04/16,12/23,04/28,0 1/05,01/05,10/16,10/14,11/23,10/18,10/04,10/01,10/01,12/04,1 1/01,01/16,10/21,01/13,10/20,10/20,11/04,05/21,05/07,12/23,02/07/28,10/31/202,06/22,07/31,06/26,04/30,07/14,07/15,07/19,07/19,0 2,04/04,07/15,06/20,09/09,07/23,03/21,08/17,10/20,01/02,1 0/09,10/09,09/26,09/25,03/02,12/08,02/1 1,06/06,06/12,07/21,04/21,02/28,01/3 ,05/06,12/03,06/13,06/24,12/17,12/28,11/11,01/12,06/11,12/23,10/15,03/31,06/03,03/11,03/22,09/26,06/19,0 1/29,07/03,03/31,04/16,1 1/16, 06/26,06/11,06/04,04/07,03/20,1 1/20,09/23,03/31,04/04,03/13,05/10,06/17,06/25,05/07
	13229	DADE CITY	Dade City	534	263	0	797	4	93.98	32.62	N	0	05/19,06/17,05/19,06/02,04/18,04/23,04/28,05/14,04/07,06/13,04/30,03/08,08/20,07/23,08/15,03/20,08/13,04/09,04/08,03/31,06/20,0 6/08,05/27,03/17,03/17,02/14,04/21,02/21,10/1 0,06/1 4,06/02,04/14,06/03,05/23,03/24,03/25,1 1/03,1 1/03,0 1/07,10/31,10/14,10/14,11 /12,1 1/12,04/29,06/23,04/07,03/13,07/25,03/10,07/22,03/24,01/06
	13062	SR 574	Eastern	2,483	148	0	2,631	1	105.63	8.14	N	0	1/03,01/14,01/30,01/31,03/05,03/26,03/07,04/08,04/10,04/29,04/29,04/30,05/07,05/09,05/10,05/14,05/19,05/21,05/30,06/02,06/04,06/06,0 6/7,06/27,07/14,07/27,08/12,08/18,08/29,09/15,09/22,10/21,12/08
	13020	GIBSONTON	South Hillsborough	2,619	239	5	2,863	4	81.14	20.79	N	0	03/04,01/19,12/16,04/29,01/07,07/28,07/08,03/01,01/31,03/29,04/16,04/09,10/14,04/24,03/27,12/15,12/15,11/01,09/24,11/02,11/14,05/26,1 /17,09/25,06/23,10/28,12/15,12/30,05/22,04/20,12/02,12/08,02/1 1,07/24,04/17,02/21,02/28,04/07,07/21,03/24,04/07,02/21,02/28,4,07/14,08/20,08/18,01/29,07/1 0,07/07,12/03
	13114	MANHATTAN AV	Westm	974	97	3	2,074	1	63.96	11.62	N	0	03/05,04/03,03/18,10/13,10/29,03/25,05/12,03/25,01/12,01/16,09/11,04/27,05/28,05/27,07/16,04/21,05/19,05/19,03/03,02/03,02/03,02/03,02/03,3 /21,06/1 2,06/1 0,04/27,08/08,03/1 0,03/28,06/1 3,06/1 6,06/05,06/04,06/27,07/10,07/06,01/22,01/16,06/13,03/23,03/12,01/03,03/02,03/27,03 /22,07/31,03/17,03/12,08/25,04/29,07/22,09/23,09/30,03/03,06/04,09/10,05/24,02/21,02/23,09/09,03/20,03/09,03/18,10/23,12/16,12/16,07/ 26,09/14,07/30,06/28,04/06,01/26,03/1 0,04/21,04/28
	13024	JUNEAU	Central	971	86	0	1,057	3	57.76	30.17	N	0	01/13,03/20,03/07,03/09,04/22,05/16,03/07,05/23,06/1 1,06/19,05/25,03/26,01/31,05/09,04/29,03/03,06/20,07/13,08/1 1,08/13,07/16,11/10,0 7/20,09/06,08/3 1,03/17,07/28,09/03,03/18,08/18,05/08,12/09,11/22,11/16,10/23,10/23,11/11,11/14,1 1/07,1 1/13,1 1/07,1 1/10,03/28,01/16,06 /10,03/07,08/03,03/16,06/30,09/20,09/26,09/08
	13013	BLANTON	Dade City	901	74	0	975	3	125.18	50.27	N	2	04/28,1 1/10,1 1/06,1 1/10,1 1/06,1 1/06,1 1/06,12/19,12/16,12/31,12/16,1 1/03,11/03,12/30,12/29,09/24,09/01,09/03,02/03,1 0/23,06/24,0 5/06,10/10,10/19,09/25,09/14,09/07,06/18,06/27,06/18,06/12,07/15,07/15,09/16,09/18,09/20,09/19,07/14,03/15,04/24,09/12,07 /17,09/14,07/23,09/27,09/09,03/11,04/23,08/17,09/01,07/31,02/19,01/06,09/08,04/1 4,01/13,10/23,12/03,09/30,01/26,06/12,08/ 13,11/12,11/03,09/28,12/18,01/15,09/20,01/15,01/19,11/14,10/10,07/28,05/21,09/12,09/19,05/28,12/10,07/16,09/17,09/04,03/15,08/13,1 1/1 3,0 1/15,03/03,09/30,09/06,07/12,04/21,03/14,08/14,1 2/30,09/19,09/02,09/09,05/28,07/24,04/22,08/20,06/20,09/15,06/1 1,02/28,08/15,08/01 /07/13,08/20,06/17,07/16,06/09,06/26,04/24,07/03,04/15,01/07,02/18,03/06,02/19,07/09,09/19,04/22,03/06,03/03,03/19,10/20,01/07,0 9/30,03/07,09/19,07/06
	13225	BRANDON	Eastern	752	44	0	796	1	117.29	71.82	N	0	1/22,02/19,04/28,06/02,06/09,06/10,03/31,03/31,01/27,1 1/07,05/26,03/17,03/17,09/08,09/06,03/10,09/23,07/28,04/09,04/03,09/1 0,06/26,0 8/06,06/1 7,06/1 7,03/23,06/20,08/1 1,04/12,07/22,12/16,10/29,11/24,10/13,01/24,02/17,01/11
	13090	1ST ST	South Hillsborough	1,855	214	4	2,073	2	70.12	36.43	N	2	03/19,04/22,06/16,1 0/06,1 2/19,08/16,08/08,03/30,1 2/02,08/20,12/17,07/29,1 0/02,1 1/12,1 1/10,1 1/21,1 1/21,09/08,09/25,04/03,09/04,09/04,0 1/05,10/10,11/20,12/21,10/16,10/07,05/16,05/27,01/14,01/08,01/12,01/21,08/09,06/09,01/10,03/04,06/11,09/11,09/04,08/25,03/11,03/11,03/ /11,03/11,03/11,03/11,03/11,03/11,03/11,08/23,08/23,1 1/12,08/23,01/16,12/19,03/20,03/20,02/27,05/24,05/24,09/26,06/ 03,05/29,05/23,05/28,05/28,05/27,05/07,05/07,05/07,05/07,05/07,05/07,01/09,07/07,10/24,05/30,06/03,06/03,05/30,06/09,06/05,09/30 3,06/03,03/20,03/20,03/20,03/25,03/25,03/25,04/02,04/02,04/02,04/02,04/02,04/02,10/17,10/17,06/17,11/21,11/21,02/27,02/26 ,03/20,12/21,10/16
3%	13010	EL PRADO	Westm	1,190	107	0	1,317	7	59.66	65.13	N	1	09/15,04/16,03/19,09/09,07/21,03/27,10/02,09/11,03/27,03/16,03/19,03/07,07/29,03/14,07/16,01/16,08/14,01/16,01/21,02/06,01/13,0 4/06,04/06,03/16,05/1 1,06/01,06/04,02/13,06/06,09/1 5,07/31,07/07,07/03,07/10,04/30,04/28,03/21,07/22,08/01,07/15,05/14,02/05,06/13,06 /02,03/26,03/26,09/11,09/04,03/17,03/19,03/19,11/04,09/07,03/04,12/01,12/16,10/29,10/27,11/21,10/24,10/17,12/06,12/07,11/20,10/22,10/ 09,11/20,01/22

Form 103 - Part III

Annual Distribution Service Reliability Report - Adjusted

SAIDI: System Average Interruption Duration Index

= Sum of All Customer Minutes Interrupted (CMI)	68,410,068	**77.66**
Total number of Customers Served (C)	880,841	

CAIDI: Customer Average Interruption Duration Index

= Sum of All Customer Minutes Interrupted (CMI)	68,410,068	**74.43**
Total number of Customers Interruptions (CI)	919,178	

SAIFI: System Average Interruption Frequency Index

= Total number of Customers Interruptions (CI)	919,178	**1.04**
Total number of Customers Served (C)	880,841	

MAIFIe: Momentary Average Interruption Event

= Sum of All Customer Momentary Interruption Events (CME)	4,489,597	**5.10**
Total number of Customers Served (C)	880,841	

LBar

= Minutes of Interruption	1,590,473	**136.54**
Total number of Outages	11,648	

District	C	CMI	CI	CME	# Cust > 5
Central	225,835	13,341,988	181,609	1,016,863	118
Dade City	18,890	2,580,246	39,660	118,253	271
Eastern	137,651	10,994,248	174,221	844,635	1,614
Plant City	68,930	7,835,686	102,375	395,708	2,591
South Hillsborough	116,595	9,335,257	113,011	317,196	172
Western	220,666	16,357,042	197,985	1,315,137	351
Winter Haven	92,274	7,965,603	110,317	481,805	1,038
System Total:	880,841	68,410,068	919,178	4,489,597	6,155

Form 103 Part III continued

Service Reliability Indices – Adjusted

Service Reliability Indices

Utility Name: Tampa Electric — Year: 2025

District or Service Area	SAIDI (b)	CAIDI (c)	SAIFI (d)	MAIFIe (e)	CEMI-5 % (f)
Central	59.08	73.47	0.80	4.50	0.05%
Dade City	136.59	65.06	2.10	6.26	1.43%
Eastern	79.87	63.11	1.27	6.14	1.17%
Plant City	113.68	76.54	1.49	5.74	3.76%
South Hillsborough	80.07	82.60	0.97	2.72	0.15%
Western	74.12	82.62	0.90	5.96	0.16%
Winter Haven	86.32	72.21	1.20	5.22	1.12%
System Total:	77.66	74.43	1.04	5.09	0.70%

Form PSC/ECR 102-3, Docket No. 011351-EI, Rule 25-6.0455(c)
Notes: L-Bar and CAIDI are expressed in minutes

Appendix C - CMI, CI and Documented Exclusions

2025	CMI		CI	
	Value	**% of Actual**	**Value**	**% of Actual**
Reported Actual Data	98,036,782	100.00%	1,614,660	100.00%
Documented Exclusion				
Planned Service Interruptions	20,786,034	21.20%	388,555	24.06%
Storm	0	0.00%	0	0.00%
Tornado	0	0.00%	0	0.00%
Ice on lines	0	0.00%	0	0.00%
Planned load management event	0	0.00%	0	0.00%
Generation or transmission event	8,840,680	9.02%	306,927	19.01%
Extreme weather or fire event	0	0.00%	0	0.00%
Reported Adjusted Data	68,410,068	69.78%	919,178	56.93%

Note: If the outage is excluded by multiple exclusions the highest priority is selected.

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	1/1/2025	50.45	3
Transformer Bank	Planned Outage	1/1/2025	6,776.35	21
Primary Wire	Planned Outage	1/1/2025	1,316.00	15
PLF	Planned Outage	1/2/2025	516.60	3
Transformer Bank	Planned Outage	1/2/2025	92.32	1
Transformer	Planned Outage	1/2/2025	170.53	8
Transformer Bank	Planned Outage	1/2/2025	660.22	7
Transformer	Planned Outage	1/2/2025	201.20	3
Transformer	Planned Outage	1/2/2025	2,112.28	13
Transformer	Planned Outage	1/2/2025	46.27	2
Transformer	Planned Outage	1/2/2025	38.72	1
Transformer	Planned Outage	1/2/2025	773.30	3
Transformer	Planned Outage	1/2/2025	43.02	1
Transformer	Planned Outage	1/2/2025	57.40	2
Transformer	Planned Outage	1/2/2025	165.60	1
None	Planned Outage	1/2/2025	176.85	9
Transformer	Planned Outage	1/2/2025	439.65	3
Transformer	Planned Outage	1/2/2025	291.00	6
OH Other	Planned Outage	1/2/2025	44,730.00	1260
Service point	Planned Outage	1/3/2025	7.00	1
Transformer	Planned Outage	1/3/2025	1,003.50	15
Transformer	Planned Outage	1/3/2025	1,535.20	8
Transformer	Planned Outage	1/3/2025	612.27	7
Transformer	Planned Outage	1/3/2025	791.75	5
Breaker	Planned Outage	1/3/2025	7.92	1
Breaker	Planned Outage	1/3/2025	7.92	1
Breaker	Planned Outage	1/3/2025	7.92	1
Breaker	Planned Outage	1/3/2025	8.78	1
Breaker	Planned Outage	1/3/2025	10,172.92	1285
Breaker	Planned Outage	1/3/2025	8.72	1
Breaker	Planned Outage	1/3/2025	7.92	1
Breaker	Planned Outage	1/3/2025	7.92	1
Breaker	Planned Outage	1/3/2025	7.92	1
None	Planned Outage	1/3/2025	1,541.47	22
None	Planned Outage	1/3/2025	1,832.62	31
Transformer	Planned Outage	1/3/2025	60.95	1
Transformer	Planned Outage	1/3/2025	184.50	5
Transformer	Planned Outage	1/4/2025	369.33	8
PLF	Planned Outage	1/4/2025	847.12	7
Transformer	Planned Outage	1/4/2025	323.07	2
None	Planned Outage	1/4/2025	1,231.30	6
None	Planned Outage	1/4/2025	280.00	25

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	1/4/2025	9,780.48	647
Transformer	Planned Outage	1/4/2025	241.07	8
OH Other	Planned Outage	1/4/2025	2,021.47	8
Transformer	Planned Outage	1/4/2025	189.30	9
None	Planned Outage	1/5/2025	6,108.80	166
None	Planned Outage	1/5/2025	36.30	1
Transformer	Planned Outage	1/5/2025	62.60	12
PLF	Planned Outage	1/5/2025	748.67	2
PLF	Planned Outage	1/6/2025	204.50	2
PLF	Planned Outage	1/6/2025	253.05	1
Transformer Bank	Planned Outage	1/6/2025	4,281.75	11
None	Planned Outage	1/6/2025	323.85	9
Transformer	Planned Outage	1/6/2025	1,844.70	9
Transformer	Planned Outage	1/6/2025	1,563.33	10
Transformer	Planned Outage	1/6/2025	199.27	14
Transformer	Planned Outage	1/6/2025	23.43	1
PLF	Planned Outage	1/6/2025	42.07	4
Transformer	Planned Outage	1/6/2025	54.93	2
Transformer	Planned Outage	1/6/2025	133.60	3
Transformer	Planned Outage	1/6/2025	391.42	5
Transformer	Planned Outage	1/6/2025	166.93	4
PLF	Planned Outage	1/6/2025	36.60	3
Transformer	Planned Outage	1/6/2025	1,747.67	14
Transformer	Planned Outage	1/6/2025	213.90	6
PLF	Planned Outage	1/6/2025	350.80	12
PLF	Planned Outage	1/6/2025	173.25	5
Transformer Bank	Planned Outage	1/6/2025	126.27	2
Transformer Bank	Planned Outage	1/6/2025	42.83	1
PLF	Planned Outage	1/6/2025	1,526.87	74
Transformer	Planned Outage	1/7/2025	439.90	2
Transformer	Planned Outage	1/7/2025	250.95	3
Transformer	Planned Outage	1/7/2025	433.17	10
Transformer	Planned Outage	1/7/2025	58.17	2
PLF	Planned Outage	1/7/2025	3,490.00	10
PLF	Planned Outage	1/7/2025	2,172.22	7
Transformer	Planned Outage	1/7/2025	87.17	5
Transformer	Planned Outage	1/7/2025	177.25	3
PLF	Planned Outage	1/7/2025	25.70	1
Transformer	Planned Outage	1/7/2025	637.47	14
PLF	Planned Outage	1/7/2025	10.77	1
Transformer	Planned Outage	1/7/2025	127.80	1
Transformer Bank	Planned Outage	1/7/2025	38.48	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	1/7/2025	332.40	2
Transformer	Planned Outage	1/7/2025	165.15	3
PLF	Planned Outage	1/7/2025	448.07	2
Transformer	Planned Outage	1/7/2025	116.27	1
PLF	Planned Outage	1/7/2025	133.88	1
Transformer	Planned Outage	1/7/2025	313.33	8
Transformer	Planned Outage	1/7/2025	39.13	2
Transformer	Planned Outage	1/7/2025	192.13	8
Transformer	Planned Outage	1/7/2025	307.43	2
Transformer Bank	Planned Outage	1/7/2025	66.95	1
Transformer	Planned Outage	1/7/2025	26.22	13
Transformer Bank	Planned Outage	1/7/2025	368.85	9
Breaker	Planned Outage	1/7/2025	6.72	1
Breaker	Planned Outage	1/7/2025	2,368.80	756
PLF	Planned Outage	1/7/2025	311.67	22
Transformer	Planned Outage	1/8/2025	617.10	11
PLF	Planned Outage	1/8/2025	124.63	1
PLF	Planned Outage	1/8/2025	447.13	2
Transformer	Planned Outage	1/8/2025	130.63	2
PLF	Planned Outage	1/8/2025	1,168.18	31
None	Planned Outage	1/8/2025	7,003.25	545
Transformer	Planned Outage	1/8/2025	11.33	2
PLF	Planned Outage	1/8/2025	300.32	1
Transformer Bank	Planned Outage	1/8/2025	1,423.33	8
Transformer	Planned Outage	1/8/2025	68.80	2
PLF	Planned Outage	1/8/2025	357.43	2
Transformer	Planned Outage	1/8/2025	232.10	2
Transformer	Planned Outage	1/8/2025	521.55	9
Transformer	Planned Outage	1/8/2025	41.40	2
Transformer	Planned Outage	1/8/2025	46.83	2
Transformer Bank	Planned Outage	1/8/2025	150.53	2
Transformer	Planned Outage	1/8/2025	482.27	4
Transformer	Planned Outage	1/8/2025	171.73	7
Transformer	Planned Outage	1/8/2025	282.80	3
Transformer	Planned Outage	1/8/2025	847.50	9
Transformer	Planned Outage	1/8/2025	94.15	3
Transformer	Planned Outage	1/8/2025	60.90	3
PLF	Planned Outage	1/8/2025	246.63	49
Transformer	Planned Outage	1/8/2025	23.48	1
Transformer	Planned Outage	1/8/2025	30.53	2
PLF	Planned Outage	1/8/2025	900.53	11
Transformer Bank	Planned Outage	1/8/2025	357.40	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	1/8/2025	180.93	2
Breaker	Planned Outage	1/8/2025	9,330.27	232
Transformer	Planned Outage	1/8/2025	149.87	4
Transformer	Planned Outage	1/9/2025	18.67	2
None	Planned Outage	1/9/2025	112.53	8
Transformer	Planned Outage	1/9/2025	65.15	1
Transformer	Planned Outage	1/9/2025	444.45	9
Transformer	Planned Outage	1/9/2025	1,463.47	28
Transformer	Planned Outage	1/9/2025	22.52	1
Transformer	Planned Outage	1/9/2025	577.20	3
PLF	Planned Outage	1/9/2025	8,515.73	28
Transformer	Planned Outage	1/9/2025	582.17	5
Transformer	Planned Outage	1/9/2025	83.50	3
None	Planned Outage	1/9/2025	371.25	15
Primary Wire	Planned Outage	1/9/2025	1,050.80	8
Primary Wire	Planned Outage	1/9/2025	1,306.17	10
Transformer	Planned Outage	1/9/2025	5,292.70	14
Transformer	Planned Outage	1/9/2025	220.98	1
Transformer	Planned Outage	1/9/2025	53.20	3
Transformer	Planned Outage	1/9/2025	2,143.10	6
Transformer	Planned Outage	1/9/2025	905.33	4
Transformer	Planned Outage	1/9/2025	244.73	2
PLF	Planned Outage	1/9/2025	189.45	1
Transformer	Planned Outage	1/9/2025	157.60	6
None	Planned Outage	1/9/2025	87.53	2
Transformer	Planned Outage	1/9/2025	237.25	3
Transformer	Planned Outage	1/9/2025	2,007.80	12
Breaker	Planned Outage	1/9/2025	2,059.20	54
Breaker	Planned Outage	1/9/2025	44,997.33	1180
Breaker	Planned Outage	1/9/2025	46,799.70	1214
Breaker	Planned Outage	1/9/2025	56.15	1
Breaker	Planned Outage	1/9/2025	45,489.00	1180
Breaker	Planned Outage	1/9/2025	55.87	1
Breaker	Planned Outage	1/9/2025	56.05	1
Breaker	Planned Outage	1/9/2025	51.82	1
Breaker	Planned Outage	1/9/2025	51.82	1
Breaker	Planned Outage	1/9/2025	56.10	1
Breaker	Planned Outage	1/9/2025	55.98	1
Breaker	Planned Outage	1/9/2025	34,496.80	806
Breaker	Planned Outage	1/9/2025	2,081.70	54
Breaker	Planned Outage	1/9/2025	55.93	1
Breaker	Planned Outage	1/9/2025	51.82	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	1/9/2025	51.82	1
Breaker	Planned Outage	1/9/2025	108.42	5
Breaker	Planned Outage	1/9/2025	411.98	19
Breaker	Planned Outage	1/9/2025	32,155.20	864
Breaker	Planned Outage	1/9/2025	411.98	19
Breaker	Planned Outage	1/9/2025	86.73	4
Breaker	Planned Outage	1/9/2025	27,304.10	822
Breaker	Planned Outage	1/9/2025	22,659.08	1045
Transformer	Planned Outage	1/9/2025	148.85	1
Transformer	Planned Outage	1/9/2025	152.73	1
PLF	Planned Outage	1/9/2025	6.65	1
Transformer	Planned Outage	1/9/2025	2,850.10	22
PLF	Planned Outage	1/9/2025	998.47	34
Transformer	Planned Outage	1/9/2025	570.47	2
Transformer	Planned Outage	1/9/2025	181.60	8
Transformer	Planned Outage	1/9/2025	67.82	1
PLF	Planned Outage	1/9/2025	270.22	1
Transformer	Planned Outage	1/9/2025	1,367.73	8
None	Planned Outage	1/10/2025	629.10	9
Transformer	Planned Outage	1/10/2025	234.93	8
Breaker	Planned Outage	1/10/2025	21,296.20	2742
Breaker	Planned Outage	1/10/2025	8.62	1
Breaker	Planned Outage	1/10/2025	8.72	1
Transformer	Planned Outage	1/10/2025	31.70	1
Transformer Bank	Planned Outage	1/10/2025	18.27	1
Transformer	Planned Outage	1/10/2025	1,522.38	7
Transformer	Planned Outage	1/10/2025	264.30	2
Transformer Bank	Planned Outage	1/10/2025	249.70	11
Transformer Bank	Planned Outage	1/10/2025	137.65	3
Transformer	Planned Outage	1/10/2025	318.83	5
Transformer	Planned Outage	1/10/2025	85.77	2
Transformer	Planned Outage	1/11/2025	408.10	11
Transformer	Planned Outage	1/11/2025	57.87	7
Breaker	Planned Outage	1/11/2025	86.55	1
Breaker	Planned Outage	1/11/2025	42.48	1
Breaker	Planned Outage	1/11/2025	57.38	1
Breaker	Planned Outage	1/11/2025	57.38	1
Breaker	Planned Outage	1/11/2025	57.38	1
Breaker	Planned Outage	1/11/2025	49.77	1
Breaker	Planned Outage	1/11/2025	13.02	1
Breaker	Planned Outage	1/11/2025	26.12	1
PLF	Planned Outage	1/11/2025	198.95	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	1/11/2025	15,698.12	557
Transformer	Planned Outage	1/11/2025	1,307.13	28
None	Planned Outage	1/12/2025	37.05	9
PLF	Planned Outage	1/12/2025	231.37	2
Switch	Planned Outage	1/12/2025	3,468.40	6
Transformer	Planned Outage	1/12/2025	174.50	6
Transformer	Planned Outage	1/13/2025	7.40	4
Transformer	Planned Outage	1/13/2025	96.80	4
Transformer	Planned Outage	1/13/2025	7.10	6
PLF	Planned Outage	1/13/2025	373.75	3
Transformer	Planned Outage	1/13/2025	15.00	3
Transformer	Planned Outage	1/13/2025	585.20	11
Transformer	Planned Outage	1/13/2025	267.50	6
Transformer	Planned Outage	1/13/2025	75.00	2
PLF	Planned Outage	1/13/2025	5,010.00	20
Transformer	Planned Outage	1/13/2025	1,007.97	11
PLF	Planned Outage	1/13/2025	183.30	2
Primary Wire	Planned Outage	1/13/2025	7.00	7
Transformer	Planned Outage	1/13/2025	272.08	5
Transformer	Planned Outage	1/13/2025	57.62	1
Primary Wire	Planned Outage	1/13/2025	1,394.75	7
Transformer	Planned Outage	1/13/2025	842.10	9
Transformer Bank	Planned Outage	1/13/2025	55.10	1
Transformer	Planned Outage	1/13/2025	168.75	1
Transformer	Planned Outage	1/13/2025	86.80	3
Transformer	Planned Outage	1/13/2025	294.78	1
Transformer	Planned Outage	1/13/2025	515.32	7
Transformer	Planned Outage	1/13/2025	350.27	2
Transformer	Planned Outage	1/13/2025	78.67	4
Transformer	Planned Outage	1/13/2025	15.42	1
PLF	Planned Outage	1/13/2025	11.47	8
Transformer	Planned Outage	1/13/2025	93.20	4
None	Planned Outage	1/13/2025	462.00	10
Transformer	Planned Outage	1/13/2025	3,068.00	10
Transformer	Planned Outage	1/13/2025	438.47	4
Transformer	Planned Outage	1/13/2025	6.88	1
Transformer	Planned Outage	1/13/2025	927.33	13
PLF	Planned Outage	1/13/2025	251.32	1
Breaker	Planned Outage	1/13/2025	16,023.00	588
Transformer Bank	Planned Outage	1/13/2025	5,778.67	16
None	Planned Outage	1/13/2025	229.67	4
Switch	Planned Outage	1/13/2025	1,671.10	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	1/14/2025	86.42	1
Transformer	Planned Outage	1/14/2025	34.23	1
Transformer	Planned Outage	1/14/2025	81.47	1
PLF	Planned Outage	1/14/2025	12,302.50	25
Transformer	Planned Outage	1/14/2025	22.93	1
PLF	Planned Outage	1/14/2025	17,020.50	70
Transformer	Planned Outage	1/14/2025	10.23	2
Transformer	Planned Outage	1/14/2025	96.00	4
Transformer	Planned Outage	1/14/2025	239.92	5
Transformer Bank	Planned Outage	1/14/2025	295.57	1
Transformer	Planned Outage	1/14/2025	27.33	1
Transformer	Planned Outage	1/14/2025	213.00	1
Transformer	Planned Outage	1/14/2025	26.63	1
Transformer Bank	Planned Outage	1/14/2025	23.22	1
Transformer	Planned Outage	1/14/2025	151.23	2
Transformer	Planned Outage	1/14/2025	40.73	1
Transformer	Planned Outage	1/14/2025	707.42	13
Breaker	Planned Outage	1/14/2025	11.78	1
Breaker	Planned Outage	1/14/2025	11.78	1
Breaker	Planned Outage	1/14/2025	14,222.48	1207
Breaker	Planned Outage	1/14/2025	11.78	1
Transformer	Planned Outage	1/14/2025	712.33	5
Transformer	Planned Outage	1/14/2025	73.30	6
Transformer	Planned Outage	1/14/2025	177.33	7
Transformer	Planned Outage	1/14/2025	54.30	3
Transformer	Planned Outage	1/14/2025	62.60	4
Transformer	Planned Outage	1/14/2025	248.40	8
Transformer	Planned Outage	1/14/2025	179.95	3
Transformer	Planned Outage	1/14/2025	1,664.10	9
Transformer	Planned Outage	1/14/2025	61.70	6
Breaker	Planned Outage	1/14/2025	22,021.80	1524
Breaker	Planned Outage	1/14/2025	6.83	1
Transformer Bank	Planned Outage	1/14/2025	46.25	3
Transformer	Planned Outage	1/15/2025	376.40	8
Transformer	Planned Outage	1/15/2025	682.70	6
Transformer	Planned Outage	1/15/2025	636.77	7
Transformer	Planned Outage	1/15/2025	557.80	6
Transformer	Planned Outage	1/15/2025	2,701.77	7
Transformer	Planned Outage	1/15/2025	356.85	1
Primary Wire	Planned Outage	1/15/2025	1,102.53	4
Transformer Bank	Planned Outage	1/15/2025	16.45	1
Transformer	Planned Outage	1/15/2025	184.33	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	1/15/2025	909.95	3
Transformer	Planned Outage	1/15/2025	106.67	8
Transformer Bank	Planned Outage	1/15/2025	87.60	4
Transformer	Planned Outage	1/15/2025	216.58	1
Transformer	Planned Outage	1/15/2025	21.73	2
Transformer	Planned Outage	1/15/2025	88.48	1
None	Planned Outage	1/15/2025	1,343.77	13
Transformer	Planned Outage	1/15/2025	669.43	14
None	Planned Outage	1/15/2025	414.60	12
Transformer	Planned Outage	1/15/2025	237.70	3
Transformer	Planned Outage	1/15/2025	105.33	4
Transformer	Planned Outage	1/15/2025	108.45	9
Transformer	Planned Outage	1/16/2025	39.42	5
Transformer	Planned Outage	1/16/2025	110.87	4
Transformer	Planned Outage	1/16/2025	2,111.55	9
Transformer	Planned Outage	1/16/2025	45.97	2
Transformer	Planned Outage	1/16/2025	644.13	4
Transformer	Planned Outage	1/16/2025	1,695.33	10
None	Planned Outage	1/16/2025	439.60	3
PLF	Planned Outage	1/16/2025	6,992.87	29
None	Planned Outage	1/16/2025	714.15	9
Transformer	Planned Outage	1/16/2025	5.53	4
Transformer	Planned Outage	1/16/2025	1,001.67	4
None	Planned Outage	1/16/2025	373.70	6
Transformer	Planned Outage	1/16/2025	672.33	10
Transformer Bank	Planned Outage	1/16/2025	188.90	2
Transformer	Planned Outage	1/16/2025	327.58	5
PLF	Planned Outage	1/16/2025	392.90	3
Transformer	Planned Outage	1/16/2025	615.87	4
Transformer	Planned Outage	1/16/2025	259.67	5
Transformer	Planned Outage	1/16/2025	55.48	1
Transformer	Planned Outage	1/16/2025	1,102.73	17
Transformer	Planned Outage	1/16/2025	74.63	2
Transformer	Planned Outage	1/16/2025	2.03	2
Transformer	Planned Outage	1/16/2025	2.37	2
None	Planned Outage	1/16/2025	9,044.60	82
None	Planned Outage	1/16/2025	3,037.20	24
Transformer	Planned Outage	1/16/2025	718.80	12
Invalid	Planned Outage	1/16/2025	371.30	3
None	Planned Outage	1/17/2025	1,639.33	8
None	Planned Outage	1/17/2025	181.75	5
Transformer	Planned Outage	1/17/2025	236.50	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	1/17/2025	246.50	2
Transformer	Planned Outage	1/17/2025	114.05	1
Transformer	Planned Outage	1/17/2025	257.02	1
PLF	Planned Outage	1/17/2025	5,899.67	20
Transformer	Planned Outage	1/17/2025	848.50	6
None	Planned Outage	1/17/2025	554.75	7
Transformer	Planned Outage	1/17/2025	563.53	4
Transformer	Planned Outage	1/17/2025	405.90	11
Transformer	Planned Outage	1/17/2025	773.27	7
Transformer	Planned Outage	1/17/2025	163.30	2
Transformer	Planned Outage	1/17/2025	539.70	7
Transformer	Planned Outage	1/17/2025	283.70	3
Transformer	Planned Outage	1/17/2025	20.83	2
Transformer	Planned Outage	1/17/2025	49.23	2
Transformer	Planned Outage	1/17/2025	171.30	2
Transformer	Planned Outage	1/17/2025	74.75	3
Transformer	Planned Outage	1/17/2025	197.17	7
Transformer	Planned Outage	1/17/2025	882.00	3
Transformer	Planned Outage	1/17/2025	276.32	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	88,536.00	1240
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Invalid	Planned Outage	1/18/2025	71.40	1
Transformer	Planned Outage	1/18/2025	784.10	2
Transformer	Planned Outage	1/18/2025	332.68	1
Transformer	Planned Outage	1/18/2025	241.60	1
None	Planned Outage	1/18/2025	272.80	12
PLF	Planned Outage	1/18/2025	8,447.32	131
None	Planned Outage	1/18/2025	7.80	1
None	Planned Outage	1/18/2025	7.93	1
None	Planned Outage	1/18/2025	7.30	1
None	Planned Outage	1/18/2025	7.93	1
None	Planned Outage	1/18/2025	6,536.90	998
None	Planned Outage	1/18/2025	6.95	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	1/18/2025	241.20	6
Transformer Bank	Planned Outage	1/19/2025	76.13	2
Transformer	Planned Outage	1/19/2025	227.50	5
Transformer	Planned Outage	1/19/2025	285.70	6
Transformer	Planned Outage	1/19/2025	628.80	16
PLF	Planned Outage	1/19/2025	1,756.30	6
Transformer	Planned Outage	1/19/2025	99.50	15
None	Planned Outage	1/19/2025	12,094.45	29
PLF	Planned Outage	1/19/2025	1,156.80	9
Transformer	Planned Outage	1/19/2025	2,505.83	5
Transformer	Planned Outage	1/19/2025	3,541.70	6
None	Planned Outage	1/19/2025	1,567.80	18
Transformer	Planned Outage	1/19/2025	3,893.63	11
PLF	Planned Outage	1/19/2025	316.20	12
Transformer Bank	Planned Outage	1/20/2025	32.17	1
Transformer	Planned Outage	1/20/2025	138.00	5
Transformer	Planned Outage	1/20/2025	160.20	3
Transformer Bank	Planned Outage	1/20/2025	124.10	6
Transformer	Planned Outage	1/20/2025	36.33	2
PLF	Planned Outage	1/20/2025	5,367.20	16
Transformer	Planned Outage	1/20/2025	34.63	1
Transformer	Planned Outage	1/20/2025	308.13	2
Transformer	Planned Outage	1/20/2025	540.00	10
Transformer	Planned Outage	1/20/2025	94.47	4
Transformer	Planned Outage	1/20/2025	91.10	6
Transformer	Planned Outage	1/20/2025	82.75	3
Transformer	Planned Outage	1/20/2025	28.60	2
Transformer	Planned Outage	1/20/2025	145.45	3
Transformer	Planned Outage	1/20/2025	71.30	2
Transformer	Planned Outage	1/20/2025	1,047.00	6
Transformer	Planned Outage	1/21/2025	108.33	4
Transformer Bank	Planned Outage	1/21/2025	67.10	2
Transformer Bank	Planned Outage	1/21/2025	46.87	2
PLF	Planned Outage	1/21/2025	40.83	1
None	Planned Outage	1/21/2025	3,037.07	16
Transformer	Planned Outage	1/21/2025	12.02	1
Breaker	Planned Outage	1/21/2025	407,480.02	1339
Transformer	Planned Outage	1/21/2025	109.87	4
Transformer	Planned Outage	1/21/2025	120.65	3
Transformer	Planned Outage	1/21/2025	263.80	4
Transformer	Planned Outage	1/21/2025	130.75	5
PLF	Planned Outage	1/21/2025	779.30	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	1/21/2025	68.02	11
Transformer	Planned Outage	1/21/2025	145.93	4
Service point	Planned Outage	1/21/2025	12.82	1
Transformer	Planned Outage	1/21/2025	32.90	6
Breaker	Planned Outage	1/21/2025	3,074.33	92
Transformer Bank	Planned Outage	1/21/2025	34.03	1
PLF	Planned Outage	1/21/2025	1,008.33	4
Invalid	Planned Outage	1/21/2025	1,744.80	9
Breaker	Planned Outage	1/22/2025	414.00	92
PLF	Planned Outage	1/22/2025	353.33	16
PLF	Planned Outage	1/22/2025	191.20	24
Transformer Bank	Planned Outage	1/22/2025	45.25	1
Breaker	Planned Outage	1/22/2025	36.37	1
Breaker	Planned Outage	1/22/2025	29,493.37	811
Breaker	Planned Outage	1/22/2025	36.37	1
Switch	Planned Outage	1/22/2025	358.57	1
Switch	Planned Outage	1/22/2025	1,434.27	4
Switch	Planned Outage	1/22/2025	14,686.93	224
Transformer	Planned Outage	1/22/2025	529.87	8
Transformer	Planned Outage	1/22/2025	36.98	1
PLF	Planned Outage	1/22/2025	6,203.00	20
Transformer	Planned Outage	1/22/2025	395.02	1
Transformer	Planned Outage	1/22/2025	3,160.13	8
Transformer	Planned Outage	1/22/2025	123.20	8
Switch	Planned Outage	1/22/2025	331.10	1
Transformer Bank	Planned Outage	1/22/2025	203.65	1
Transformer	Planned Outage	1/22/2025	249.80	1
Switch	Planned Outage	1/22/2025	320.35	1
Switch	Planned Outage	1/22/2025	4,139.85	13
Switch	Planned Outage	1/22/2025	318.38	1
Switch	Planned Outage	1/22/2025	312.75	1
None	Planned Outage	1/22/2025	63.63	1
Transformer	Planned Outage	1/22/2025	681.13	4
Switch	Planned Outage	1/22/2025	784.00	12
Switch	Planned Outage	1/22/2025	667.42	1
Breaker	Planned Outage	1/22/2025	4,924.50	1407
Breaker	Planned Outage	1/22/2025	3.50	1
Breaker	Planned Outage	1/22/2025	3.50	1
Breaker	Planned Outage	1/22/2025	3.50	1
Breaker	Planned Outage	1/22/2025	3.50	1
Breaker	Planned Outage	1/22/2025	364.00	104
Breaker	Planned Outage	1/22/2025	3.50	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	1/22/2025	44.32	1
Transformer	Planned Outage	1/22/2025	427.20	6
Transformer	Planned Outage	1/22/2025	640.33	4
Transformer	Planned Outage	1/22/2025	21.07	4
Transformer	Planned Outage	1/22/2025	2,128.53	8
PLF	Planned Outage	1/22/2025	1,854.55	87
Transformer	Planned Outage	1/22/2025	494.20	4
Transformer	Planned Outage	1/22/2025	357.33	5
Switch	Planned Outage	1/22/2025	27.07	2
Transformer Bank	Planned Outage	1/22/2025	1,444.00	24
Transformer	Planned Outage	1/22/2025	305.73	8
Transformer	Planned Outage	1/22/2025	31.93	4
PLF	Planned Outage	1/22/2025	137.58	5
Handhole	Planned Outage	1/22/2025	380.15	1
Handhole	Planned Outage	1/22/2025	410.15	1
Handhole	Planned Outage	1/22/2025	346.70	1
PLF	Planned Outage	1/23/2025	927.75	1
PLF	Planned Outage	1/23/2025	3,086.60	66
Transformer	Planned Outage	1/23/2025	2,116.32	43
Transformer	Planned Outage	1/23/2025	4,473.15	9
PLF	Planned Outage	1/23/2025	4,972.75	15
Transformer	Planned Outage	1/23/2025	864.80	8
Transformer	Planned Outage	1/23/2025	31.80	4
Transformer	Planned Outage	1/23/2025	166.10	3
Transformer	Planned Outage	1/23/2025	554.33	2
Switch	Planned Outage	1/23/2025	1,768.60	6
PLF	Planned Outage	1/23/2025	743.75	21
Transformer	Planned Outage	1/23/2025	153.18	7
PLF	Planned Outage	1/23/2025	2,742.00	40
PLF	Planned Outage	1/23/2025	18.23	1
Transformer	Planned Outage	1/23/2025	179.40	6
Transformer	Planned Outage	1/23/2025	482.13	16
Transformer	Planned Outage	1/23/2025	244.62	13
PLF	Planned Outage	1/23/2025	5,965.53	43
Transformer	Planned Outage	1/23/2025	147.47	7
PLF	Planned Outage	1/23/2025	2,105.67	5
Primary Wire	Planned Outage	1/23/2025	689.85	3
Breaker	Planned Outage	1/23/2025	3,014.85	909
Transformer Bank	Planned Outage	1/23/2025	82.80	2
Transformer	Planned Outage	1/24/2025	821.33	8
Transformer	Planned Outage	1/24/2025	4,260.90	14
Transformer	Planned Outage	1/24/2025	1,030.53	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	1/24/2025	166.23	2
Transformer	Planned Outage	1/24/2025	2,254.08	11
Transformer	Planned Outage	1/24/2025	241.30	2
PLF	Planned Outage	1/24/2025	152.07	1
PLF	Planned Outage	1/24/2025	75.60	1
Transformer	Planned Outage	1/24/2025	127.65	1
Transformer	Planned Outage	1/24/2025	856.67	8
Transformer	Planned Outage	1/24/2025	228.80	12
Transformer	Planned Outage	1/24/2025	8.72	1
Transformer	Planned Outage	1/24/2025	209.67	4
Transformer	Planned Outage	1/24/2025	177.83	2
Transformer	Planned Outage	1/24/2025	182.50	6
PLF	Planned Outage	1/25/2025	420.83	50
Transformer	Planned Outage	1/25/2025	352.07	1
PLF	Planned Outage	1/25/2025	62.08	1
PLF	Planned Outage	1/25/2025	4,396.83	74
Transformer	Planned Outage	1/25/2025	135.33	2
Transformer	Planned Outage	1/25/2025	151.80	4
Breaker	Planned Outage	1/25/2025	14.68	1
Breaker	Planned Outage	1/25/2025	13.92	1
Breaker	Planned Outage	1/25/2025	14.07	1
Breaker	Planned Outage	1/25/2025	28,695.22	2009
Breaker	Planned Outage	1/25/2025	14.83	1
Breaker	Planned Outage	1/25/2025	13.98	1
Transformer	Planned Outage	1/25/2025	761.20	6
Transformer	Planned Outage	1/25/2025	80.20	3
Transformer Bank	Planned Outage	1/25/2025	140.80	3
Transformer Bank	Planned Outage	1/25/2025	162.07	11
Transformer	Planned Outage	1/25/2025	66.00	8
Transformer	Planned Outage	1/25/2025	2,517.67	10
PLF	Planned Outage	1/26/2025	12.17	2
Transformer	Planned Outage	1/26/2025	28.07	2
Transformer	Planned Outage	1/26/2025	75.15	3
Transformer	Planned Outage	1/26/2025	98.75	3
Transformer	Planned Outage	1/26/2025	10.92	1
Transformer	Planned Outage	1/26/2025	142.78	13
Service point	Planned Outage	1/26/2025	17.88	1
PLF	Planned Outage	1/26/2025	186.40	16
Transformer Bank	Planned Outage	1/26/2025	53.57	1
Transformer	Planned Outage	1/26/2025	19.70	3
Transformer	Planned Outage	1/26/2025	181.70	3
Transformer	Planned Outage	1/26/2025	77.15	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	1/27/2025	558.03	2
PLF	Planned Outage	1/27/2025	10,286.22	41
Transformer	Planned Outage	1/27/2025	289.93	2
Transformer	Planned Outage	1/27/2025	127.48	1
Transformer	Planned Outage	1/27/2025	1,704.60	4
Transformer	Planned Outage	1/27/2025	277.33	8
Transformer	Planned Outage	1/27/2025	243.60	2
Transformer	Planned Outage	1/27/2025	43.88	1
Transformer	Planned Outage	1/27/2025	44.17	1
Transformer	Planned Outage	1/27/2025	147.50	3
Transformer	Planned Outage	1/27/2025	85.27	1
Transformer Bank	Planned Outage	1/27/2025	847.40	4
Transformer	Planned Outage	1/27/2025	517.20	6
PLF	Planned Outage	1/27/2025	10,237.15	33
Transformer	Planned Outage	1/27/2025	227.40	6
Transformer	Planned Outage	1/27/2025	653.92	5
Transformer	Planned Outage	1/27/2025	74.50	3
Transformer	Planned Outage	1/27/2025	86.75	1
PLF	Planned Outage	1/27/2025	651.53	4
PLF	Planned Outage	1/27/2025	212.42	5
PLF	Planned Outage	1/27/2025	147.40	1
PLF	Planned Outage	1/27/2025	37.37	1
Transformer	Planned Outage	1/27/2025	41.33	5
Transformer	Planned Outage	1/27/2025	1,017.58	5
Transformer	Planned Outage	1/27/2025	407.70	9
Transformer	Planned Outage	1/28/2025	24.33	2
Transformer	Planned Outage	1/28/2025	7.35	3
Transformer Bank	Planned Outage	1/28/2025	113.43	1
None	Planned Outage	1/28/2025	794.40	12
Transformer	Planned Outage	1/28/2025	961.80	6
PLF	Planned Outage	1/28/2025	11,048.13	41
Transformer	Planned Outage	1/28/2025	231.33	10
Transformer	Planned Outage	1/28/2025	133.93	4
Transformer	Planned Outage	1/28/2025	2,474.50	6
Transformer	Planned Outage	1/28/2025	236.50	3
Transformer	Planned Outage	1/28/2025	165.53	2
Transformer	Planned Outage	1/28/2025	401.75	5
Transformer Bank	Planned Outage	1/28/2025	30.20	1
PLF	Planned Outage	1/28/2025	21,172.67	349
Transformer	Planned Outage	1/28/2025	49.00	2
PLF	Planned Outage	1/28/2025	212.10	9
Transformer	Planned Outage	1/28/2025	40.10	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	1/28/2025	1,109.33	16
Transformer	Planned Outage	1/28/2025	26.45	1
Transformer	Planned Outage	1/28/2025	114.50	3
Transformer	Planned Outage	1/28/2025	270.20	6
Transformer Bank	Planned Outage	1/28/2025	53.13	1
Transformer	Planned Outage	1/28/2025	701.73	2
Transformer	Planned Outage	1/28/2025	28.40	3
Transformer	Planned Outage	1/28/2025	277.95	9
PLF	Planned Outage	1/28/2025	151.83	1
Transformer Bank	Planned Outage	1/29/2025	62.07	2
Transformer	Planned Outage	1/29/2025	315.27	4
PLF	Planned Outage	1/29/2025	301.82	1
PLF	Planned Outage	1/29/2025	11,686.93	32
PLF	Planned Outage	1/29/2025	359.85	1
PLF	Planned Outage	1/29/2025	356.85	1
Transformer	Planned Outage	1/29/2025	492.97	2
Transformer	Planned Outage	1/29/2025	114.08	1
Transformer	Planned Outage	1/29/2025	1,470.70	6
Transformer	Planned Outage	1/29/2025	155.77	2
Transformer	Planned Outage	1/29/2025	439.87	2
Transformer	Planned Outage	1/29/2025	286.93	1
Transformer	Planned Outage	1/29/2025	1,147.73	4
Transformer	Planned Outage	1/29/2025	421.40	7
Switch	Planned Outage	1/29/2025	386.53	2
PLF	Planned Outage	1/29/2025	30.85	1
Transformer	Planned Outage	1/29/2025	218.08	5
Transformer	Planned Outage	1/29/2025	255.30	6
Transformer	Planned Outage	1/29/2025	822.27	14
Transformer	Planned Outage	1/29/2025	30.50	5
PLF	Planned Outage	1/29/2025	15.02	1
Transformer	Planned Outage	1/29/2025	529.50	15
Transformer	Planned Outage	1/29/2025	316.95	9
Transformer	Planned Outage	1/29/2025	521.70	9
Transformer	Planned Outage	1/29/2025	257.55	9
Transformer	Planned Outage	1/29/2025	194.08	5
Transformer	Planned Outage	1/29/2025	193.92	5
Transformer	Planned Outage	1/29/2025	856.40	12
Transformer	Planned Outage	1/29/2025	326.27	4
PLF	Planned Outage	1/29/2025	1,199.45	3
Transformer	Planned Outage	1/29/2025	25.73	4
Transformer	Planned Outage	1/29/2025	69.60	6
Transformer	Planned Outage	1/29/2025	1,370.85	13

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	1/29/2025	316.33	4
Transformer	Planned Outage	1/29/2025	3.10	1
Transformer	Planned Outage	1/29/2025	1.02	1
None	Planned Outage	1/29/2025	446.00	1
Transformer Bank	Planned Outage	1/29/2025	35.00	4
Transformer Bank	Planned Outage	1/29/2025	43.20	6
Transformer	Planned Outage	1/29/2025	13.53	7
Transformer	Planned Outage	1/29/2025	536.08	7
Transformer	Planned Outage	1/29/2025	107.20	6
Transformer	Planned Outage	1/29/2025	294.47	7
Transformer	Planned Outage	1/29/2025	154.87	1
Transformer	Planned Outage	1/30/2025	446.25	7
Transformer Bank	Planned Outage	1/30/2025	1,623.75	5
Transformer	Planned Outage	1/30/2025	877.67	5
Transformer	Planned Outage	1/30/2025	3,370.25	13
Transformer	Planned Outage	1/30/2025	11,457.60	21
None	Planned Outage	1/30/2025	250.08	5
Transformer	Planned Outage	1/30/2025	220.60	1
Transformer Bank	Planned Outage	1/30/2025	89.35	1
Transformer	Planned Outage	1/30/2025	2,193.83	10
Primary Wire	Planned Outage	1/30/2025	597.70	6
Transformer	Planned Outage	1/30/2025	50.63	2
Transformer	Planned Outage	1/30/2025	1,335.53	13
None	Planned Outage	1/30/2025	4,380.35	39
Transformer	Planned Outage	1/30/2025	165.27	4
Transformer	Planned Outage	1/30/2025	135.77	1
Transformer	Planned Outage	1/30/2025	23.80	1
PLF	Planned Outage	1/30/2025	2,338.23	14
Transformer	Planned Outage	1/30/2025	16.20	1
Transformer	Planned Outage	1/30/2025	152.30	2
Switch	Planned Outage	1/30/2025	1,282.27	2
Transformer	Planned Outage	1/30/2025	95.63	2
PLF	Planned Outage	1/30/2025	451.25	15
Transformer	Planned Outage	1/30/2025	266.00	6
Transformer	Planned Outage	1/31/2025	116.33	5
Transformer Bank	Planned Outage	1/31/2025	68.43	2
Transformer	Planned Outage	1/31/2025	204.52	7
Transformer	Planned Outage	1/31/2025	1,126.20	12
Transformer	Planned Outage	1/31/2025	163.90	2
Transformer Bank	Planned Outage	1/31/2025	556.77	2
Transformer	Planned Outage	1/31/2025	96.50	10
Breaker	Planned Outage	1/31/2025	3.97	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	1/31/2025	6,069.00	1530
Transformer	Planned Outage	1/31/2025	283.58	5
Transformer	Planned Outage	1/31/2025	3,026.17	10
Transformer	Planned Outage	1/31/2025	2.87	1
Breaker	Planned Outage	1/31/2025	7.85	1
Breaker	Planned Outage	1/31/2025	7.78	1
Breaker	Planned Outage	1/31/2025	7.90	1
Breaker	Planned Outage	1/31/2025	3,817.50	1527
Breaker	Planned Outage	1/31/2025	2.93	1
Breaker	Planned Outage	1/31/2025	2.92	1
Breaker	Planned Outage	1/31/2025	6.57	1
Breaker	Planned Outage	1/31/2025	6.12	1
Breaker	Planned Outage	1/31/2025	6.23	1
Breaker	Planned Outage	1/31/2025	5.55	1
Breaker	Planned Outage	1/31/2025	5.75	1
Breaker	Planned Outage	1/31/2025	5.50	1
Breaker	Planned Outage	1/31/2025	5.78	1
Breaker	Planned Outage	1/31/2025	5.90	1
Breaker	Planned Outage	1/31/2025	6.07	1
Breaker	Planned Outage	1/31/2025	6.23	1
Breaker	Planned Outage	1/31/2025	6.35	1
Breaker	Planned Outage	1/31/2025	7,441.20	1272
Breaker	Planned Outage	1/31/2025	5.40	1
Breaker	Planned Outage	1/31/2025	5.60	1
Breaker	Planned Outage	1/31/2025	5.65	1
Breaker	Planned Outage	1/31/2025	5.92	1
Breaker	Planned Outage	1/31/2025	5.60	1
Breaker	Planned Outage	1/31/2025	5.77	1
Breaker	Planned Outage	1/31/2025	5.93	1
Breaker	Planned Outage	1/31/2025	6.07	1
Breaker	Planned Outage	1/31/2025	6.03	1
Breaker	Planned Outage	1/31/2025	6.18	1
Transformer	Planned Outage	1/31/2025	23.68	7
PLF	Planned Outage	1/31/2025	1,506.20	2
Transformer	Planned Outage	1/31/2025	16.30	1
Transformer	Planned Outage	1/31/2025	112.12	7
PLF	Planned Outage	2/1/2025	366.37	2
Transformer	Planned Outage	2/1/2025	6,758.07	17
Transformer	Planned Outage	2/1/2025	7.07	1
Transformer	Planned Outage	2/2/2025	356.25	5
Breaker	Planned Outage	2/2/2025	38,684.95	2451
PLF	Planned Outage	2/2/2025	253.32	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	2/2/2025	212.13	4
Transformer	Planned Outage	2/2/2025	187.35	9
Transformer	Planned Outage	2/2/2025	49.25	3
Switch	Planned Outage	2/2/2025	1,078.20	9
Transformer	Planned Outage	2/2/2025	559.22	13
Transformer	Planned Outage	2/2/2025	292.40	24
Transformer	Planned Outage	2/2/2025	71.47	2
Transformer	Planned Outage	2/2/2025	381.70	6
Invalid	Planned Outage	2/3/2025	290.92	5
PLF	Planned Outage	2/3/2025	49,499.83	230
Switch	Planned Outage	2/3/2025	34,182.40	196
Transformer	Planned Outage	2/3/2025	1,214.63	13
Transformer	Planned Outage	2/3/2025	353.97	7
PLF	Planned Outage	2/3/2025	469.75	15
Transformer	Planned Outage	2/3/2025	789.87	8
Primary Wire	Planned Outage	2/3/2025	670.00	24
PLF	Planned Outage	2/3/2025	6,525.20	33
Transformer	Planned Outage	2/3/2025	1,894.55	7
Transformer	Planned Outage	2/3/2025	286.17	17
None	Planned Outage	2/3/2025	669.00	36
Service point	Planned Outage	2/3/2025	24.48	1
Transformer	Planned Outage	2/3/2025	72.60	4
PLF	Planned Outage	2/3/2025	210.12	1
Transformer	Planned Outage	2/3/2025	89.02	7
None	Planned Outage	2/3/2025	760.33	10
Primary Wire	Planned Outage	2/3/2025	663.60	9
Switch	Planned Outage	2/3/2025	285.47	1
Switch	Planned Outage	2/3/2025	285.80	1
Transformer	Planned Outage	2/3/2025	343.93	7
Transformer	Planned Outage	2/3/2025	111.65	11
Transformer	Planned Outage	2/3/2025	2,098.60	4
Transformer	Planned Outage	2/3/2025	600.10	3
PLF	Planned Outage	2/3/2025	265.20	1
Transformer	Planned Outage	2/4/2025	313.17	10
Transformer	Planned Outage	2/4/2025	19.00	4
Transformer	Planned Outage	2/4/2025	2,332.63	14
Transformer	Planned Outage	2/4/2025	165.18	1
Transformer	Planned Outage	2/4/2025	250.67	10
Transformer	Planned Outage	2/4/2025	257.67	1
Transformer	Planned Outage	2/4/2025	159.68	11
Transformer	Planned Outage	2/4/2025	584.80	8
Transformer	Planned Outage	2/4/2025	377.00	12

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	2/4/2025	1,987.70	13
Transformer	Planned Outage	2/4/2025	297.37	11
PLF	Planned Outage	2/4/2025	587.70	2
Transformer Bank	Planned Outage	2/4/2025	33.42	1
Transformer Bank	Planned Outage	2/4/2025	585.08	5
Transformer	Planned Outage	2/4/2025	2,114.40	6
Service point	Planned Outage	2/4/2025	40.70	1
Transformer	Planned Outage	2/4/2025	45.03	1
Transformer	Planned Outage	2/4/2025	5.03	1
PLF	Planned Outage	2/4/2025	801.07	4
PLF	Planned Outage	2/4/2025	200.05	1
PLF	Planned Outage	2/5/2025	428.40	4
Transformer	Planned Outage	2/5/2025	39.20	4
Transformer	Planned Outage	2/5/2025	251.00	6
Transformer	Planned Outage	2/5/2025	228.00	2
Transformer Bank	Planned Outage	2/5/2025	64.47	2
Transformer	Planned Outage	2/5/2025	797.83	10
Service point	Planned Outage	2/5/2025	277.65	1
None	Planned Outage	2/5/2025	1,963.22	41
None	Planned Outage	2/5/2025	43.60	1
None	Planned Outage	2/5/2025	685.00	20
Transformer Bank	Planned Outage	2/5/2025	509.53	2
Transformer	Planned Outage	2/5/2025	117.90	3
Transformer	Planned Outage	2/5/2025	301.00	7
Transformer	Planned Outage	2/5/2025	67.20	2
Transformer	Planned Outage	2/5/2025	99.73	2
Transformer	Planned Outage	2/5/2025	1,569.15	11
None	Planned Outage	2/5/2025	847.30	37
Transformer	Planned Outage	2/5/2025	56.10	3
Transformer	Planned Outage	2/5/2025	1,106.75	5
Transformer	Planned Outage	2/5/2025	43.02	1
Transformer	Planned Outage	2/5/2025	419.50	10
Transformer Bank	Planned Outage	2/5/2025	230.80	8
Transformer	Planned Outage	2/5/2025	4.45	1
Transformer	Planned Outage	2/5/2025	3,500.73	4
Transformer	Planned Outage	2/5/2025	129.45	9
Transformer	Planned Outage	2/5/2025	986.50	6
PLF	Planned Outage	2/5/2025	238.75	1
PLF	Planned Outage	2/6/2025	15,381.60	51
Transformer Bank	Planned Outage	2/6/2025	105.80	3
Transformer	Planned Outage	2/6/2025	135.42	5
Transformer	Planned Outage	2/6/2025	45.93	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	2/6/2025	157.57	2
Transformer Bank	Planned Outage	2/6/2025	177.47	8
Transformer	Planned Outage	2/6/2025	169.67	5
Transformer	Planned Outage	2/6/2025	3,965.60	12
Transformer	Planned Outage	2/6/2025	3,048.67	10
PLF	Planned Outage	2/6/2025	1,127.30	6
Transformer	Planned Outage	2/6/2025	351.20	1
Transformer	Planned Outage	2/6/2025	176.97	2
PLF	Planned Outage	2/6/2025	758.00	20
Transformer	Planned Outage	2/6/2025	65.08	5
Transformer	Planned Outage	2/6/2025	8.32	1
PLF	Planned Outage	2/6/2025	1,012.70	3
Transformer	Planned Outage	2/6/2025	458.40	4
None	Planned Outage	2/6/2025	140.35	1
Transformer	Planned Outage	2/6/2025	113.10	6
PLF	Planned Outage	2/6/2025	85.18	1
PLF	Planned Outage	2/6/2025	310.33	2
PLF	Planned Outage	2/6/2025	301.32	1
Transformer	Planned Outage	2/6/2025	174.60	6
Transformer	Planned Outage	2/6/2025	58.92	1
Transformer	Planned Outage	2/6/2025	39.80	2
Transformer	Planned Outage	2/6/2025	34.55	3
Transformer	Planned Outage	2/6/2025	183.00	2
Transformer	Planned Outage	2/6/2025	1,136.85	13
Service point	Planned Outage	2/6/2025	11.70	1
Primary Wire	Planned Outage	2/6/2025	461.65	3
Transformer	Planned Outage	2/6/2025	441.10	11
Transformer	Planned Outage	2/6/2025	2,039.70	18
Transformer Bank	Planned Outage	2/6/2025	420.67	1
Transformer	Planned Outage	2/6/2025	286.40	8
Transformer	Planned Outage	2/7/2025	200.75	5
PLF	Planned Outage	2/7/2025	500.13	2
Transformer	Planned Outage	2/7/2025	224.70	7
PLF	Planned Outage	2/7/2025	701.23	2
Transformer	Planned Outage	2/7/2025	348.60	1
PLF	Planned Outage	2/7/2025	4,804.80	21
None	Planned Outage	2/7/2025	127.13	1
Transformer	Planned Outage	2/7/2025	3.40	3
Breaker	Planned Outage	2/7/2025	8.62	1
Breaker	Planned Outage	2/7/2025	8.62	1
Breaker	Planned Outage	2/7/2025	3.22	1
Breaker	Planned Outage	2/7/2025	8.62	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	2/7/2025	8.62	1
Breaker	Planned Outage	2/7/2025	8.62	1
Breaker	Planned Outage	2/7/2025	1,670.40	576
PLF	Planned Outage	2/7/2025	68.75	1
Transformer	Planned Outage	2/7/2025	130.55	7
None	Planned Outage	2/7/2025	1,037.18	13
Transformer	Planned Outage	2/7/2025	59.13	4
PLF	Planned Outage	2/7/2025	125.15	1
Transformer	Planned Outage	2/7/2025	91.23	7
Transformer	Planned Outage	2/7/2025	85.83	10
Transformer	Planned Outage	2/7/2025	206.27	8
Transformer	Planned Outage	2/7/2025	377.87	8
Transformer	Planned Outage	2/8/2025	247.58	5
Breaker	Planned Outage	2/8/2025	51,098.40	1208
Transformer	Planned Outage	2/8/2025	286.42	5
PLF	Planned Outage	2/9/2025	236.00	4
Switch	Planned Outage	2/9/2025	1,061.25	9
Transformer	Planned Outage	2/9/2025	392.75	5
Transformer	Planned Outage	2/9/2025	74.67	1
Transformer	Planned Outage	2/9/2025	81.67	7
Transformer	Planned Outage	2/9/2025	135.95	1
Transformer	Planned Outage	2/9/2025	867.77	7
Transformer	Planned Outage	2/9/2025	76.00	5
Transformer	Planned Outage	2/9/2025	7.27	1
Transformer	Planned Outage	2/9/2025	7.17	1
Transformer	Planned Outage	2/9/2025	829.60	4
None	Planned Outage	2/10/2025	4,619.73	64
Transformer	Planned Outage	2/10/2025	487.00	5
Transformer	Planned Outage	2/10/2025	4,494.50	10
Transformer	Planned Outage	2/10/2025	6,610.80	12
Transformer	Planned Outage	2/10/2025	720.18	7
PLF	Planned Outage	2/10/2025	8,088.30	38
Transformer	Planned Outage	2/10/2025	416.73	2
Transformer	Planned Outage	2/10/2025	107.90	3
Primary Wire	Planned Outage	2/10/2025	13,121.25	45
Primary Wire	Planned Outage	2/10/2025	279.72	1
Transformer	Planned Outage	2/10/2025	1,695.80	6
Transformer	Planned Outage	2/10/2025	164.70	3
Transformer	Planned Outage	2/10/2025	114.08	5
Transformer	Planned Outage	2/10/2025	67.37	2
Transformer	Planned Outage	2/10/2025	226.33	2
Transformer	Planned Outage	2/10/2025	2,410.95	9

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	2/10/2025	255.73	1
Transformer	Planned Outage	2/10/2025	453.37	2
Transformer	Planned Outage	2/10/2025	1,188.80	12
Transformer	Planned Outage	2/10/2025	241.93	2
Primary Wire	Planned Outage	2/10/2025	2,946.35	11
PLF	Planned Outage	2/10/2025	1,468.60	12
Transformer	Planned Outage	2/11/2025	20.20	2
Transformer	Planned Outage	2/11/2025	1,374.13	8
Transformer	Planned Outage	2/11/2025	182.75	1
Primary Wire	Planned Outage	2/11/2025	10,020.72	23
Transformer	Planned Outage	2/11/2025	2,810.67	10
Transformer	Planned Outage	2/11/2025	623.20	4
Transformer	Planned Outage	2/11/2025	763.80	4
Transformer	Planned Outage	2/11/2025	495.93	4
Transformer	Planned Outage	2/11/2025	69.47	4
None	Planned Outage	2/11/2025	253.30	1
None	Planned Outage	2/11/2025	252.95	1
Transformer	Planned Outage	2/11/2025	2,200.30	6
Transformer	Planned Outage	2/11/2025	153.67	5
Transformer	Planned Outage	2/11/2025	258.47	2
Transformer	Planned Outage	2/11/2025	60.53	1
Transformer	Planned Outage	2/11/2025	223.33	4
PLF	Planned Outage	2/11/2025	229.40	1
None	Planned Outage	2/12/2025	503.07	8
Transformer	Planned Outage	2/12/2025	6,045.00	13
Transformer	Planned Outage	2/12/2025	2,601.60	16
Transformer	Planned Outage	2/12/2025	5,282.40	12
Transformer	Planned Outage	2/12/2025	595.07	4
Transformer Bank	Planned Outage	2/12/2025	261.23	1
Transformer	Planned Outage	2/12/2025	198.80	8
Transformer	Planned Outage	2/12/2025	88.17	2
PLF	Planned Outage	2/12/2025	3,838.70	46
Transformer	Planned Outage	2/12/2025	249.73	8
PLF	Planned Outage	2/12/2025	18.58	5
PLF	Planned Outage	2/12/2025	325.67	5
PLF	Planned Outage	2/12/2025	981.63	7
Transformer	Planned Outage	2/12/2025	2,636.80	8
PLF	Planned Outage	2/12/2025	960.87	7
Transformer	Planned Outage	2/12/2025	255.20	11
PLF	Planned Outage	2/12/2025	662.50	3
Transformer Bank	Planned Outage	2/12/2025	113.20	1
PLF	Planned Outage	2/12/2025	8,942.15	203

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	2/12/2025	82.87	4
Transformer	Planned Outage	2/12/2025	26.27	1
Transformer	Planned Outage	2/12/2025	1,430.50	15
PLF	Planned Outage	2/12/2025	266.70	1
Transformer	Planned Outage	2/12/2025	63.13	2
Transformer	Planned Outage	2/12/2025	367.87	8
Transformer	Planned Outage	2/12/2025	371.92	5
Transformer	Planned Outage	2/12/2025	218.10	3
PLF	Planned Outage	2/12/2025	10.60	6
Transformer	Planned Outage	2/12/2025	359.53	1
Transformer	Planned Outage	2/12/2025	461.63	11
Transformer	Planned Outage	2/12/2025	3,897.50	25
Transformer	Planned Outage	2/12/2025	186.53	8
Transformer Bank	Planned Outage	2/12/2025	619.58	5
Transformer	Planned Outage	2/12/2025	713.70	6
Transformer	Planned Outage	2/12/2025	46.93	1
PLF	Planned Outage	2/12/2025	1,307.33	53
None	Planned Outage	2/13/2025	2,538.60	12
Transformer	Planned Outage	2/13/2025	168.70	7
Transformer	Planned Outage	2/13/2025	93.92	5
Transformer	Planned Outage	2/13/2025	3,439.65	9
Transformer	Planned Outage	2/13/2025	3,808.50	10
Transformer Bank	Planned Outage	2/13/2025	352.30	1
Transformer Bank	Planned Outage	2/13/2025	351.02	1
Transformer	Planned Outage	2/13/2025	6,836.00	20
PLF	Planned Outage	2/13/2025	5,661.60	21
Transformer	Planned Outage	2/13/2025	150.97	2
None	Planned Outage	2/13/2025	578.93	4
None	Planned Outage	2/13/2025	595.63	2
Transformer	Planned Outage	2/13/2025	544.58	5
Transformer	Planned Outage	2/13/2025	4,842.72	31
Transformer	Planned Outage	2/13/2025	36.33	2
PLF	Planned Outage	2/13/2025	1,974.40	12
Transformer	Planned Outage	2/13/2025	199.83	10
Transformer	Planned Outage	2/13/2025	92.37	2
Transformer	Planned Outage	2/13/2025	172.60	4
Transformer	Planned Outage	2/13/2025	790.35	9
Transformer	Planned Outage	2/13/2025	16.73	1
Transformer	Planned Outage	2/13/2025	95.95	3
Transformer	Planned Outage	2/13/2025	85.30	2
Transformer	Planned Outage	2/13/2025	252.23	7
Transformer	Planned Outage	2/13/2025	829.95	11

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Service point	Planned Outage	2/13/2025	85.23	1
Transformer Bank	Planned Outage	2/13/2025	748.07	14
Service point	Planned Outage	2/13/2025	32.47	1
Invalid	Planned Outage	2/13/2025	21.60	1
PLF	Planned Outage	2/13/2025	224.28	1
Transformer	Planned Outage	2/13/2025	128.25	3
Transformer	Planned Outage	2/14/2025	125.70	2
Transformer	Planned Outage	2/14/2025	986.85	9
Transformer	Planned Outage	2/14/2025	2,388.45	9
Transformer	Planned Outage	2/14/2025	328.35	9
Transformer	Planned Outage	2/14/2025	3,093.00	10
Transformer	Planned Outage	2/14/2025	61.90	1
None	Planned Outage	2/14/2025	676.20	12
Transformer	Planned Outage	2/14/2025	716.47	4
Transformer	Planned Outage	2/14/2025	174.17	5
None	Planned Outage	2/14/2025	1,670.00	25
Transformer	Planned Outage	2/14/2025	851.00	15
Transformer	Planned Outage	2/14/2025	34.17	5
PLF	Planned Outage	2/14/2025	258.75	1
OH Other	Planned Outage	2/14/2025	225.47	4
Transformer	Planned Outage	2/14/2025	64.07	1
Primary Wire	Planned Outage	2/14/2025	1,014.07	28
Transformer	Planned Outage	2/14/2025	308.35	7
Transformer	Planned Outage	2/14/2025	591.40	12
Transformer	Planned Outage	2/14/2025	1,362.67	10
Primary Wire	Planned Outage	2/14/2025	411.60	7
PLF	Planned Outage	2/14/2025	92.47	1
None	Planned Outage	2/14/2025	2,063.33	20
Service point	Planned Outage	2/14/2025	95.15	1
Transformer	Planned Outage	2/15/2025	263.27	4
Transformer Bank	Planned Outage	2/15/2025	607.60	3
PLF	Planned Outage	2/15/2025	680.60	2
Transformer	Planned Outage	2/15/2025	3,138.40	8
Transformer	Planned Outage	2/15/2025	98.50	5
PLF	Planned Outage	2/15/2025	177.42	1
PLF	Planned Outage	2/15/2025	176.73	1
Breaker	Planned Outage	2/15/2025	1.37	1
Breaker	Planned Outage	2/15/2025	1.50	1
Breaker	Planned Outage	2/15/2025	1.58	1
Breaker	Planned Outage	2/15/2025	1.28	1
Breaker	Planned Outage	2/15/2025	1.45	1
Breaker	Planned Outage	2/15/2025	3,613.50	2190

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	2/16/2025	478.20	4
PLF	Planned Outage	2/16/2025	333.02	29
Switch	Planned Outage	2/16/2025	795.90	9
PLF	Planned Outage	2/16/2025	319.15	39
PLF	Planned Outage	2/16/2025	8.18	1
Transformer	Planned Outage	2/16/2025	195.07	11
Breaker	Planned Outage	2/16/2025	19.25	1
Breaker	Planned Outage	2/16/2025	19.05	1
Breaker	Planned Outage	2/16/2025	34,385.25	1805
Breaker	Planned Outage	2/16/2025	19.25	1
Breaker	Planned Outage	2/16/2025	18.77	1
PLF	Planned Outage	2/17/2025	14,241.35	123
PLF	Planned Outage	2/17/2025	26.97	1
Transformer	Planned Outage	2/17/2025	72.55	3
Transformer	Planned Outage	2/17/2025	2,810.13	11
Transformer	Planned Outage	2/17/2025	924.65	3
Transformer	Planned Outage	2/17/2025	621.92	5
Transformer	Planned Outage	2/17/2025	1,060.40	4
None	Planned Outage	2/17/2025	2,265.07	16
PLF	Planned Outage	2/17/2025	184.33	20
PLF	Planned Outage	2/17/2025	253.67	4
Transformer	Planned Outage	2/17/2025	448.62	1
Transformer	Planned Outage	2/17/2025	437.48	1
Transformer	Planned Outage	2/17/2025	167.90	3
PLF	Planned Outage	2/17/2025	129.98	1
Transformer	Planned Outage	2/17/2025	840.30	6
Transformer	Planned Outage	2/17/2025	354.60	4
Transformer	Planned Outage	2/17/2025	189.87	8
Transformer	Planned Outage	2/17/2025	356.13	8
Transformer	Planned Outage	2/17/2025	1,408.17	5
PLF	Planned Outage	2/17/2025	66.10	2
Transformer	Planned Outage	2/17/2025	487.47	2
None	Planned Outage	2/17/2025	618.40	8
Transformer	Planned Outage	2/17/2025	114.13	1
Transformer	Planned Outage	2/17/2025	418.83	2
Transformer	Planned Outage	2/17/2025	224.80	4
Transformer	Planned Outage	2/17/2025	247.00	10
Transformer	Planned Outage	2/17/2025	1,580.60	12
Transformer	Planned Outage	2/17/2025	96.33	5
PLF	Planned Outage	2/17/2025	81.95	1
Transformer	Planned Outage	2/17/2025	204.92	5
Transformer	Planned Outage	2/17/2025	36.60	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	2/17/2025	37.00	3
Transformer	Planned Outage	2/17/2025	291.17	10
Transformer	Planned Outage	2/17/2025	187.20	8
Transformer	Planned Outage	2/17/2025	43.82	1
Transformer	Planned Outage	2/17/2025	220.60	4
PLF	Planned Outage	2/17/2025	133.48	1
PLF	Planned Outage	2/18/2025	273.67	2
Transformer Bank	Planned Outage	2/18/2025	175.27	2
PLF	Planned Outage	2/18/2025	1,223.30	13
Transformer	Planned Outage	2/18/2025	243.03	2
Transformer Bank	Planned Outage	2/18/2025	548.80	2
None	Planned Outage	2/18/2025	735.50	10
Transformer	Planned Outage	2/18/2025	200.17	10
Transformer	Planned Outage	2/18/2025	62.80	4
Transformer	Planned Outage	2/18/2025	35.37	2
Transformer	Planned Outage	2/18/2025	3,147.60	8
Transformer	Planned Outage	2/18/2025	234.75	9
PLF	Planned Outage	2/18/2025	355.35	3
Transformer	Planned Outage	2/18/2025	1,112.88	7
PLF	Planned Outage	2/18/2025	1,291.00	20
PLF	Planned Outage	2/18/2025	445.55	7
PLF	Planned Outage	2/18/2025	243.70	1
Transformer	Planned Outage	2/18/2025	242.20	3
PLF	Planned Outage	2/18/2025	95.20	16
Transformer	Planned Outage	2/18/2025	349.50	6
Transformer	Planned Outage	2/18/2025	138.33	5
Transformer	Planned Outage	2/18/2025	343.50	15
PLF	Planned Outage	2/18/2025	1,023.00	186
None	Planned Outage	2/18/2025	183.87	2
Transformer	Planned Outage	2/18/2025	248.00	8
PLF	Planned Outage	2/18/2025	408.20	3
None	Planned Outage	2/18/2025	192.38	7
Breaker	Planned Outage	2/18/2025	12.88	1
Breaker	Planned Outage	2/18/2025	11.50	1
Invalid	Planned Outage	2/18/2025	25,051.40	2316
Breaker	Planned Outage	2/18/2025	10.68	1
Breaker	Planned Outage	2/18/2025	12.88	1
Breaker	Planned Outage	2/18/2025	22.53	2
Breaker	Planned Outage	2/18/2025	25,272.60	2308
Breaker	Planned Outage	2/18/2025	11.40	1
Breaker	Planned Outage	2/18/2025	10.60	1
Switch	Planned Outage	2/18/2025	1,613.65	59

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
OH Other	Planned Outage	2/18/2025	304.33	11
Transformer	Planned Outage	2/18/2025	972.17	5
Transformer	Planned Outage	2/18/2025	413.93	14
Transformer	Planned Outage	2/18/2025	188.40	9
Transformer	Planned Outage	2/18/2025	20.90	2
Transformer	Planned Outage	2/19/2025	11.28	1
Transformer	Planned Outage	2/19/2025	37.63	2
Transformer	Planned Outage	2/19/2025	11.30	1
Transformer	Planned Outage	2/19/2025	588.58	7
Transformer	Planned Outage	2/19/2025	44.70	1
Transformer	Planned Outage	2/19/2025	593.60	4
PLF	Planned Outage	2/19/2025	1,347.15	9
Transformer	Planned Outage	2/19/2025	302.10	19
Transformer	Planned Outage	2/19/2025	402.10	2
Transformer	Planned Outage	2/19/2025	322.00	15
Transformer	Planned Outage	2/19/2025	721.17	5
Primary Wire	Planned Outage	2/19/2025	5,320.25	15
PLF	Planned Outage	2/19/2025	216.08	1
Transformer	Planned Outage	2/19/2025	518.40	6
Transformer	Planned Outage	2/19/2025	1,291.67	10
None	Planned Outage	2/19/2025	413.75	5
Transformer	Planned Outage	2/19/2025	32.75	5
Transformer	Planned Outage	2/19/2025	142.80	9
Transformer Bank	Planned Outage	2/19/2025	124.67	2
Transformer	Planned Outage	2/19/2025	372.00	4
Transformer	Planned Outage	2/19/2025	719.37	7
Transformer	Planned Outage	2/19/2025	1,495.32	7
Transformer	Planned Outage	2/19/2025	70.60	4
Transformer	Planned Outage	2/19/2025	202.08	5
Transformer	Planned Outage	2/19/2025	642.40	3
Breaker	Planned Outage	2/19/2025	8.05	1
Breaker	Planned Outage	2/19/2025	8.05	1
Breaker	Planned Outage	2/19/2025	16,638.10	2274
PLF	Planned Outage	2/19/2025	322.47	7
Transformer	Planned Outage	2/19/2025	373.20	18
Switch	Planned Outage	2/20/2025	484.57	2
Transformer	Planned Outage	2/20/2025	28.70	2
Transformer	Planned Outage	2/20/2025	43.85	3
Transformer	Planned Outage	2/20/2025	1,249.17	10
PLF	Planned Outage	2/20/2025	3,352.75	15
PLF	Planned Outage	2/20/2025	23.45	1
Transformer Bank	Planned Outage	2/20/2025	296.85	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	2/20/2025	284.37	1
Transformer	Planned Outage	2/20/2025	927.00	5
Transformer	Planned Outage	2/20/2025	927.17	5
Transformer	Planned Outage	2/20/2025	25.20	3
PLF	Planned Outage	2/20/2025	162.77	1
Transformer	Planned Outage	2/20/2025	30.20	2
PLF	Planned Outage	2/20/2025	1,390.13	4
Transformer	Planned Outage	2/20/2025	83.20	3
Transformer	Planned Outage	2/20/2025	3,277.45	33
Transformer	Planned Outage	2/20/2025	26.22	1
Transformer	Planned Outage	2/20/2025	314.85	3
None	Planned Outage	2/20/2025	157.93	4
PLF	Planned Outage	2/20/2025	51.17	1
Transformer	Planned Outage	2/20/2025	1,173.00	5
None	Planned Outage	2/20/2025	2,990.40	712
None	Planned Outage	2/20/2025	4.20	1
None	Planned Outage	2/20/2025	4.20	1
None	Planned Outage	2/20/2025	4.20	1
None	Planned Outage	2/20/2025	4.20	1
None	Planned Outage	2/20/2025	377.10	6
Transformer	Planned Outage	2/20/2025	2,133.37	7
Transformer	Planned Outage	2/21/2025	265.20	12
Transformer	Planned Outage	2/21/2025	61.53	13
PLF	Planned Outage	2/21/2025	99.43	1
Transformer	Planned Outage	2/21/2025	206.88	1
Transformer Bank	Planned Outage	2/21/2025	1,962.17	10
Transformer	Planned Outage	2/21/2025	160.50	3
Transformer	Planned Outage	2/21/2025	1,799.67	10
Transformer	Planned Outage	2/21/2025	50.27	8
Transformer	Planned Outage	2/21/2025	70.47	7
Transformer	Planned Outage	2/21/2025	873.42	47
Transformer	Planned Outage	2/21/2025	166.67	5
Breaker	Planned Outage	2/21/2025	3,971.73	352
Breaker	Planned Outage	2/21/2025	10,877.50	950
Breaker	Planned Outage	2/21/2025	11.00	1
Switch	Planned Outage	2/22/2025	315.93	1
Primary Wire	Planned Outage	2/22/2025	398.58	1
Transformer	Planned Outage	2/22/2025	112.60	12
Transformer	Planned Outage	2/22/2025	158.67	7
Transformer	Planned Outage	2/22/2025	48.20	4
Breaker	Planned Outage	2/22/2025	4.78	1
Breaker	Planned Outage	2/22/2025	4.93	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	2/22/2025	4.02	1
Breaker	Planned Outage	2/22/2025	4.72	1
Breaker	Planned Outage	2/22/2025	4.87	1
Breaker	Planned Outage	2/22/2025	5,055.25	1095
Breaker	Planned Outage	2/22/2025	4.53	1
Breaker	Planned Outage	2/22/2025	4.63	1
Transformer Bank	Planned Outage	2/22/2025	257.72	1
None	Planned Outage	2/23/2025	64.50	1
PLF	Planned Outage	2/23/2025	227.60	4
Switch	Planned Outage	2/23/2025	976.20	9
Transformer	Planned Outage	2/23/2025	669.93	13
Transformer	Planned Outage	2/23/2025	49.17	2
PLF	Planned Outage	2/24/2025	333.42	1
Switch	Planned Outage	2/24/2025	22,543.50	1017
Transformer Bank	Planned Outage	2/24/2025	874.53	2
Switch	Planned Outage	2/24/2025	22,793.98	931
Breaker	Planned Outage	2/24/2025	20,625.33	80
Breaker	Planned Outage	2/24/2025	515.23	2
Switch	Planned Outage	2/24/2025	55.27	4
PLF	Planned Outage	2/24/2025	751.13	19
Primary Wire	Planned Outage	2/24/2025	57,594.30	207
None	Planned Outage	2/24/2025	5.57	1
None	Planned Outage	2/24/2025	683.18	229
None	Planned Outage	2/24/2025	5.47	1
None	Planned Outage	2/24/2025	307.50	205
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	16,575.40	1852
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
Breaker	Planned Outage	2/24/2025	8.95	1
None	Planned Outage	2/24/2025	146.40	24
None	Planned Outage	2/24/2025	12,883.60	1039
Transformer	Planned Outage	2/25/2025	159.93	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	2/25/2025	7,554.17	250
Breaker	Planned Outage	2/25/2025	61.22	1
Breaker	Planned Outage	2/25/2025	6,366.53	104
Breaker	Planned Outage	2/25/2025	151.90	7
Breaker	Planned Outage	2/25/2025	38,040.10	1753
Primary Wire	Planned Outage	2/25/2025	1,556.10	7
Breaker	Planned Outage	2/25/2025	1,311.47	16
Breaker	Planned Outage	2/25/2025	19,124.75	681
Breaker	Planned Outage	2/25/2025	5,789.77	806
Breaker	Planned Outage	2/25/2025	7.13	1
Breaker	Planned Outage	2/25/2025	7.25	1
Transformer Bank	Planned Outage	2/25/2025	213.80	2
PLF	Planned Outage	2/25/2025	4,590.30	26
Transformer	Planned Outage	2/25/2025	1,391.25	3
Transformer	Planned Outage	2/25/2025	1,393.65	3
Transformer	Planned Outage	2/25/2025	4,822.53	14
Transformer	Planned Outage	2/25/2025	2,786.80	6
Transformer Bank	Planned Outage	2/25/2025	226.67	4
Transformer	Planned Outage	2/25/2025	498.90	9
PLF	Planned Outage	2/25/2025	1,155.52	41
PLF	Planned Outage	2/25/2025	953.70	34
None	Planned Outage	2/25/2025	128.33	14
Transformer	Planned Outage	2/25/2025	419.50	6
Transformer	Planned Outage	2/25/2025	25.28	1
PLF	Planned Outage	2/25/2025	190.27	1
Transformer	Planned Outage	2/25/2025	410.87	1
Transformer	Planned Outage	2/25/2025	463.70	3
Transformer	Planned Outage	2/25/2025	722.90	6
Transformer	Planned Outage	2/25/2025	181.55	1
Transformer	Planned Outage	2/25/2025	179.35	3
Transformer	Planned Outage	2/25/2025	2,029.25	15
None	Planned Outage	2/25/2025	225.20	6
Transformer	Planned Outage	2/25/2025	2,349.97	13
Transformer	Planned Outage	2/25/2025	1,047.67	14
Transformer Bank	Planned Outage	2/25/2025	379.97	2
Transformer	Planned Outage	2/25/2025	977.10	6
Transformer	Planned Outage	2/25/2025	1,631.00	14
Transformer	Planned Outage	2/25/2025	328.83	5
Invalid	Planned Outage	2/26/2025	62.52	1
Transformer	Planned Outage	2/26/2025	34.77	7
PLF	Planned Outage	2/26/2025	2,932.67	20
Transformer Bank	Planned Outage	2/26/2025	169.35	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	2/26/2025	402.27	4
PLF	Planned Outage	2/26/2025	2,218.50	6
Transformer	Planned Outage	2/26/2025	138.90	1
Transformer	Planned Outage	2/26/2025	2,810.40	16
Switch	Planned Outage	2/26/2025	2,602.73	4
PLF	Planned Outage	2/26/2025	4,043.17	17
Transformer	Planned Outage	2/26/2025	12.42	1
Transformer	Planned Outage	2/26/2025	124.50	3
Transformer	Planned Outage	2/26/2025	249.23	2
Transformer Bank	Planned Outage	2/26/2025	51.05	1
PLF	Planned Outage	2/26/2025	1,741.80	6
PLF	Planned Outage	2/26/2025	6,937.22	19
Transformer	Planned Outage	2/26/2025	125.53	4
Transformer	Planned Outage	2/26/2025	547.40	4
Transformer Bank	Planned Outage	2/26/2025	469.42	5
PLF	Planned Outage	2/26/2025	74.55	1
PLF	Planned Outage	2/26/2025	511.47	2
Transformer	Planned Outage	2/26/2025	176.40	4
Primary Wire	Planned Outage	2/26/2025	85.20	3
None	Planned Outage	2/26/2025	27.07	1
Transformer	Planned Outage	2/26/2025	1,305.87	16
Transformer	Planned Outage	2/26/2025	41.53	2
Transformer	Planned Outage	2/26/2025	504.75	15
PLF	Planned Outage	2/26/2025	1.02	1
Transformer	Planned Outage	2/26/2025	196.20	2
Transformer	Planned Outage	2/26/2025	122.55	9
PLF	Planned Outage	2/26/2025	83.80	3
Transformer	Planned Outage	2/26/2025	493.35	9
Transformer	Planned Outage	2/26/2025	858.43	13
Breaker	Planned Outage	2/26/2025	68,818.17	2135
Breaker	Planned Outage	2/26/2025	32.23	1
None	Planned Outage	2/27/2025	761.68	23
PLF	Planned Outage	2/27/2025	1,725.97	7
PLF	Planned Outage	2/27/2025	341.70	2
PLF	Planned Outage	2/27/2025	341.80	2
Transformer Bank	Planned Outage	2/27/2025	798.27	4
Switch	Planned Outage	2/27/2025	495.40	4
Transformer	Planned Outage	2/27/2025	434.40	6
Transformer	Planned Outage	2/27/2025	689.87	4
PLF	Planned Outage	2/27/2025	3,023.17	10
Transformer	Planned Outage	2/27/2025	1,073.80	4
PLF	Planned Outage	2/27/2025	5,295.93	19

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	2/27/2025	1,770.27	22
Transformer	Planned Outage	2/27/2025	442.35	3
Transformer	Planned Outage	2/27/2025	1,714.70	13
Transformer	Planned Outage	2/27/2025	1,830.27	8
Switch	Planned Outage	2/27/2025	499.40	4
Transformer	Planned Outage	2/27/2025	874.93	8
Transformer	Planned Outage	2/27/2025	244.00	8
PLF	Planned Outage	2/27/2025	2,560.80	24
Transformer	Planned Outage	2/27/2025	267.87	4
Transformer	Planned Outage	2/27/2025	93.63	2
Transformer	Planned Outage	2/27/2025	463.07	4
Transformer	Planned Outage	2/27/2025	531.70	6
Transformer	Planned Outage	2/27/2025	177.20	6
Transformer Bank	Planned Outage	2/27/2025	100.93	4
Transformer	Planned Outage	2/27/2025	218.83	10
Transformer	Planned Outage	2/27/2025	157.38	7
PLF	Planned Outage	2/27/2025	592.67	40
Service point	Planned Outage	2/27/2025	213.85	1
PLF	Planned Outage	2/28/2025	146.73	1
Transformer	Planned Outage	2/28/2025	40.93	4
Transformer Bank	Planned Outage	2/28/2025	60.02	1
Transformer Bank	Planned Outage	2/28/2025	650.13	4
Transformer	Planned Outage	2/28/2025	610.70	6
Primary Wire	Planned Outage	2/28/2025	395.60	1
Transformer	Planned Outage	2/28/2025	220.25	5
Transformer	Planned Outage	2/28/2025	786.53	4
Transformer Bank	Planned Outage	2/28/2025	426.78	1
Transformer	Planned Outage	2/28/2025	665.47	2
None	Planned Outage	2/28/2025	570.00	9
Transformer	Planned Outage	2/28/2025	396.20	7
Transformer	Planned Outage	2/28/2025	306.37	14
Transformer	Planned Outage	2/28/2025	792.67	5
Transformer	Planned Outage	2/28/2025	366.83	5
PLF	Planned Outage	2/28/2025	262.48	1
Transformer	Planned Outage	2/28/2025	100.92	5
Service point	Planned Outage	2/28/2025	121.52	1
Transformer	Planned Outage	2/28/2025	65.80	6
Transformer	Planned Outage	2/28/2025	820.70	6
Transformer	Planned Outage	2/28/2025	133.00	7
TX Repaired (PM)	Planned Outage	2/28/2025	2,343.15	127
TX Repaired (PM)	Planned Outage	2/28/2025	18.45	1
TX Repaired (PM)	Planned Outage	2/28/2025	2,389.60	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	2/28/2025	1,187.12	13
Transformer	Planned Outage	2/28/2025	129.87	8
Transformer	Planned Outage	2/28/2025	33.20	8
Transformer	Planned Outage	2/28/2025	208.95	7
Transformer	Planned Outage	2/28/2025	1,209.67	5
PLF	Planned Outage	2/28/2025	198.93	4
Breaker	Planned Outage	3/1/2025	71,137.00	1276
Transformer	Planned Outage	3/1/2025	42.60	3
Transformer Bank	Planned Outage	3/1/2025	855.60	9
Transformer	Planned Outage	3/1/2025	1,510.43	1
Transformer	Planned Outage	3/1/2025	464.85	3
PLF	Planned Outage	3/1/2025	272.80	2
Transformer	Planned Outage	3/1/2025	311.90	2
Transformer	Planned Outage	3/1/2025	552.65	3
PLF	Planned Outage	3/1/2025	107.00	1
Transformer	Planned Outage	3/1/2025	34.87	1
Transformer	Planned Outage	3/1/2025	157.73	14
PLF	Planned Outage	3/1/2025	206.40	8
Invalid	Planned Outage	3/2/2025	75.00	1
Invalid	Planned Outage	3/2/2025	99,874.35	1329
Invalid	Planned Outage	3/2/2025	15.00	1
Transformer Bank	Planned Outage	3/2/2025	2,039.33	7
Transformer Bank	Planned Outage	3/2/2025	18.92	1
PLF	Planned Outage	3/2/2025	382.00	3
Transformer	Planned Outage	3/2/2025	26.83	7
Transformer	Planned Outage	3/3/2025	18.78	7
Transformer	Planned Outage	3/3/2025	25.67	7
Transformer	Planned Outage	3/3/2025	2,164.20	9
PLF	Planned Outage	3/3/2025	7,740.80	41
Transformer	Planned Outage	3/3/2025	603.20	6
Transformer	Planned Outage	3/3/2025	621.90	6
Transformer	Planned Outage	3/3/2025	1,063.95	9
Transformer	Planned Outage	3/3/2025	123.48	1
Transformer	Planned Outage	3/3/2025	267.98	7
Transformer	Planned Outage	3/3/2025	407.33	8
Transformer	Planned Outage	3/3/2025	1,130.75	5
Transformer	Planned Outage	3/3/2025	1,990.08	13
Transformer	Planned Outage	3/3/2025	109.53	1
PLF	Planned Outage	3/3/2025	482.83	5
Transformer	Planned Outage	3/3/2025	983.77	11
Transformer Bank	Planned Outage	3/3/2025	2,121.82	7
Transformer	Planned Outage	3/3/2025	280.42	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	3/3/2025	1,564.17	10
PLF	Planned Outage	3/3/2025	230.57	2
PLF	Planned Outage	3/3/2025	19.90	1
Transformer	Planned Outage	3/3/2025	43.33	2
Transformer Bank	Planned Outage	3/3/2025	524.07	2
PLF	Planned Outage	3/4/2025	474.93	16
Transformer	Planned Outage	3/4/2025	79.60	2
Transformer Bank	Planned Outage	3/4/2025	1,674.20	4
Transformer	Planned Outage	3/4/2025	134.00	5
Transformer	Planned Outage	3/4/2025	18.85	3
Transformer	Planned Outage	3/4/2025	1,303.13	11
Transformer	Planned Outage	3/4/2025	220.92	5
None	Planned Outage	3/4/2025	84.93	2
Transformer	Planned Outage	3/4/2025	224.62	1
Transformer	Planned Outage	3/4/2025	498.13	4
Transformer Bank	Planned Outage	3/4/2025	51.53	1
Transformer	Planned Outage	3/4/2025	707.20	3
Transformer	Planned Outage	3/4/2025	184.00	12
Transformer Bank	Planned Outage	3/4/2025	777.07	8
Transformer Bank	Planned Outage	3/4/2025	858.10	6
Transformer	Planned Outage	3/4/2025	95.40	6
Transformer Bank	Planned Outage	3/4/2025	225.17	1
PLF	Planned Outage	3/5/2025	696.20	12
Transformer Bank	Planned Outage	3/5/2025	1,676.00	8
Transformer	Planned Outage	3/5/2025	701.95	3
Transformer Bank	Planned Outage	3/5/2025	740.27	4
Transformer	Planned Outage	3/5/2025	118.67	8
Transformer	Planned Outage	3/5/2025	255.53	4
Transformer Bank	Planned Outage	3/5/2025	32.27	4
Transformer	Planned Outage	3/5/2025	512.27	4
Invalid	Planned Outage	3/5/2025	76.72	1
PLF	Planned Outage	3/5/2025	2,118.67	20
Transformer	Planned Outage	3/5/2025	103.20	8
PLF	Planned Outage	3/5/2025	2,427.33	22
Transformer Bank	Planned Outage	3/5/2025	33.15	1
Transformer	Planned Outage	3/5/2025	1,560.33	5
Transformer	Planned Outage	3/5/2025	37.65	9
PLF	Planned Outage	3/5/2025	697.90	7
None	Planned Outage	3/5/2025	741.80	6
Transformer	Planned Outage	3/5/2025	310.17	10
Transformer	Planned Outage	3/5/2025	344.50	6
Transformer	Planned Outage	3/5/2025	18.20	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	3/5/2025	32.97	1
Transformer	Planned Outage	3/6/2025	169.75	7
PLF	Planned Outage	3/6/2025	127.63	14
Transformer	Planned Outage	3/6/2025	1,092.20	6
PLF	Planned Outage	3/6/2025	5,108.40	44
PLF	Planned Outage	3/6/2025	5,686.45	49
Transformer	Planned Outage	3/6/2025	897.00	10
Transformer	Planned Outage	3/6/2025	125.15	1
Transformer Bank	Planned Outage	3/6/2025	190.70	6
Transformer	Planned Outage	3/6/2025	2,657.40	12
Transformer	Planned Outage	3/6/2025	252.13	8
None	Planned Outage	3/6/2025	420.47	14
PLF	Planned Outage	3/6/2025	336.40	2
Transformer	Planned Outage	3/6/2025	36.47	2
Transformer	Planned Outage	3/6/2025	299.65	13
Transformer	Planned Outage	3/6/2025	135.10	6
PLF	Planned Outage	3/6/2025	486.20	12
Transformer Bank	Planned Outage	3/6/2025	56.75	5
Transformer	Planned Outage	3/6/2025	153.37	1
Transformer	Planned Outage	3/6/2025	416.50	7
Transformer	Planned Outage	3/6/2025	91.70	6
Transformer Bank	Planned Outage	3/6/2025	121.33	7
Transformer Bank	Planned Outage	3/6/2025	199.87	8
Transformer	Planned Outage	3/6/2025	646.60	6
Transformer	Planned Outage	3/6/2025	114.33	1
None	Planned Outage	3/6/2025	630.47	4
Transformer Bank	Planned Outage	3/6/2025	332.03	1
Transformer Bank	Planned Outage	3/6/2025	502.90	3
PLF	Planned Outage	3/7/2025	384.07	2
PLF	Planned Outage	3/7/2025	7,622.07	28
None	Planned Outage	3/7/2025	741.95	11
Transformer	Planned Outage	3/7/2025	1,483.07	7
Transformer	Planned Outage	3/7/2025	1,386.33	10
Transformer	Planned Outage	3/7/2025	155.62	1
Primary Wire	Planned Outage	3/7/2025	1,005.58	55
Transformer	Planned Outage	3/7/2025	403.15	3
Transformer	Planned Outage	3/7/2025	41.53	2
Transformer	Planned Outage	3/7/2025	2.17	2
Transformer	Planned Outage	3/7/2025	2.37	2
Transformer	Planned Outage	3/7/2025	35.47	1
None	Planned Outage	3/7/2025	652.82	23
Breaker	Planned Outage	3/7/2025	11,316.40	1489

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	3/8/2025	5.78	1
Transformer	Planned Outage	3/8/2025	158.00	12
Transformer	Planned Outage	3/8/2025	13.47	1
PLF	Planned Outage	3/8/2025	84.47	1
Transformer	Planned Outage	3/8/2025	129.00	3
Switch	Planned Outage	3/8/2025	194.60	4
PLF	Planned Outage	3/8/2025	3,598.75	15
PLF	Planned Outage	3/8/2025	87.37	2
None	Planned Outage	3/8/2025	8,428.57	22
Transformer	Planned Outage	3/8/2025	87.73	1
Transformer Bank	Planned Outage	3/9/2025	194.17	5
Transformer	Planned Outage	3/9/2025	404.67	8
Breaker	Planned Outage	3/9/2025	6,083.00	2310
Breaker	Planned Outage	3/9/2025	2.97	1
Breaker	Planned Outage	3/9/2025	2.88	1
Breaker	Planned Outage	3/9/2025	3.07	1
Breaker	Planned Outage	3/9/2025	3.23	1
Breaker	Planned Outage	3/9/2025	2.33	1
Breaker	Planned Outage	3/9/2025	3.23	1
Transformer	Planned Outage	3/9/2025	43.67	4
Transformer Bank	Planned Outage	3/10/2025	12.08	1
PLF	Planned Outage	3/10/2025	2,758.60	13
Transformer	Planned Outage	3/10/2025	54.92	1
Transformer	Planned Outage	3/10/2025	55.40	2
Transformer	Planned Outage	3/10/2025	388.80	3
Transformer	Planned Outage	3/10/2025	449.80	3
Transformer	Planned Outage	3/10/2025	132.88	7
PLF	Planned Outage	3/10/2025	4,933.12	17
Transformer	Planned Outage	3/10/2025	1,274.30	6
PLF	Planned Outage	3/10/2025	684.53	2
PLF	Planned Outage	3/10/2025	1,032.00	12
PLF	Planned Outage	3/10/2025	983.92	5
Transformer	Planned Outage	3/10/2025	256.17	10
Transformer	Planned Outage	3/10/2025	262.43	2
Transformer	Planned Outage	3/10/2025	447.73	8
PLF	Planned Outage	3/10/2025	357.75	5
Transformer	Planned Outage	3/10/2025	159.13	7
Breaker	Planned Outage	3/10/2025	98.07	1
Breaker	Planned Outage	3/10/2025	98.33	1
Breaker	Planned Outage	3/10/2025	98.37	1
Breaker	Planned Outage	3/10/2025	98.37	1
Breaker	Planned Outage	3/10/2025	98.37	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	3/10/2025	98.37	1
Breaker	Planned Outage	3/10/2025	223,292.33	2270
Breaker	Planned Outage	3/10/2025	98.25	1
Transformer	Planned Outage	3/10/2025	3,058.75	5
Service - Crew	Planned Outage	3/10/2025	435.88	1
Transformer	Planned Outage	3/10/2025	574.25	3
Breaker	Planned Outage	3/10/2025	1,152.30	69
Breaker	Planned Outage	3/10/2025	8.10	1
Breaker	Planned Outage	3/10/2025	8.37	1
Breaker	Planned Outage	3/10/2025	7,115.50	1330
PLF	Planned Outage	3/10/2025	3,232.67	13
Transformer	Planned Outage	3/10/2025	44.87	1
Transformer	Planned Outage	3/11/2025	222.15	9
PLF	Planned Outage	3/11/2025	271.35	3
Transformer Bank	Planned Outage	3/11/2025	56.57	1
Transformer	Planned Outage	3/11/2025	3,906.70	14
Transformer Bank	Planned Outage	3/11/2025	163.15	1
Transformer Bank	Planned Outage	3/11/2025	302.63	2
Transformer Bank	Planned Outage	3/11/2025	109.60	2
Transformer	Planned Outage	3/11/2025	204.15	1
Transformer	Planned Outage	3/11/2025	1,020.75	5
PLF	Planned Outage	3/11/2025	981.75	17
PLF	Planned Outage	3/11/2025	517.50	2
Transformer	Planned Outage	3/11/2025	319.83	5
Transformer	Planned Outage	3/11/2025	978.75	9
PLF	Planned Outage	3/11/2025	6,133.33	23
Transformer	Planned Outage	3/11/2025	2,242.57	7
Transformer	Planned Outage	3/11/2025	734.85	9
Transformer	Planned Outage	3/11/2025	443.17	5
Transformer	Planned Outage	3/11/2025	193.13	4
PLF	Planned Outage	3/11/2025	1,451.80	17
Transformer	Planned Outage	3/11/2025	569.50	15
PLF	Planned Outage	3/11/2025	1,837.50	9
Transformer Bank	Planned Outage	3/11/2025	46.03	1
Transformer Bank	Planned Outage	3/11/2025	594.40	6
Transformer	Planned Outage	3/11/2025	149.58	1
PLF	Planned Outage	3/11/2025	1,327.73	26
Transformer	Planned Outage	3/11/2025	1,384.13	8
Transformer	Planned Outage	3/11/2025	1,216.02	7
Transformer Bank	Planned Outage	3/11/2025	859.20	8
Transformer	Planned Outage	3/11/2025	124.93	8
Transformer	Planned Outage	3/11/2025	201.30	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	3/11/2025	60.93	4
Invalid	Planned Outage	3/11/2025	46.17	1
Transformer Bank	Planned Outage	3/11/2025	152.07	1
Transformer	Planned Outage	3/11/2025	1,333.50	5
PLF	Planned Outage	3/11/2025	1,015.75	3
PLF	Planned Outage	3/11/2025	323.52	1
Transformer	Planned Outage	3/12/2025	279.30	9
Transformer	Planned Outage	3/12/2025	157.43	2
Transformer	Planned Outage	3/12/2025	278.60	1
Transformer Bank	Planned Outage	3/12/2025	722.17	5
Transformer	Planned Outage	3/12/2025	80.57	2
Transformer	Planned Outage	3/12/2025	1,501.83	5
None	Planned Outage	3/12/2025	72.10	1
Transformer	Planned Outage	3/12/2025	124.63	2
Transformer	Planned Outage	3/12/2025	140.07	4
Transformer	Planned Outage	3/12/2025	202.95	1
None	Planned Outage	3/12/2025	759.05	3
Transformer	Planned Outage	3/12/2025	1,550.75	5
PLF	Planned Outage	3/12/2025	2,664.53	32
PLF	Planned Outage	3/12/2025	5,313.00	15
Transformer	Planned Outage	3/12/2025	1,997.55	9
Transformer	Planned Outage	3/12/2025	3,315.47	16
Transformer	Planned Outage	3/12/2025	754.70	6
Transformer	Planned Outage	3/12/2025	118.10	3
Transformer	Planned Outage	3/12/2025	149.10	7
Transformer	Planned Outage	3/12/2025	407.28	7
Transformer	Planned Outage	3/12/2025	56.82	1
Transformer	Planned Outage	3/12/2025	535.73	14
None	Planned Outage	3/12/2025	989.00	15
Transformer	Planned Outage	3/12/2025	71.98	1
None	Planned Outage	3/12/2025	624.75	5
Transformer	Planned Outage	3/12/2025	3,709.17	25
Transformer	Planned Outage	3/12/2025	106.60	13
Transformer	Planned Outage	3/12/2025	49.72	1
Transformer	Planned Outage	3/12/2025	256.80	4
Transformer	Planned Outage	3/12/2025	88.10	1
None	Planned Outage	3/12/2025	1,786.80	24
PLF	Planned Outage	3/12/2025	1,814.53	8
Transformer	Planned Outage	3/12/2025	72.13	4
Transformer	Planned Outage	3/12/2025	442.80	6
Transformer	Planned Outage	3/12/2025	15.68	1
PLF	Planned Outage	3/13/2025	1,386.13	16

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	3/13/2025	171.33	1
PLF	Planned Outage	3/13/2025	96.17	2
Transformer	Planned Outage	3/13/2025	176.93	8
Transformer	Planned Outage	3/13/2025	757.52	7
Transformer	Planned Outage	3/13/2025	877.30	6
None	Planned Outage	3/13/2025	5,437.80	19
PLF	Planned Outage	3/13/2025	438.75	3
PLF	Planned Outage	3/13/2025	144.67	1
Transformer	Planned Outage	3/13/2025	677.37	7
PLF	Planned Outage	3/13/2025	6,640.20	31
Transformer	Planned Outage	3/13/2025	691.07	8
Transformer	Planned Outage	3/13/2025	938.60	1
Transformer	Planned Outage	3/13/2025	873.45	9
Transformer	Planned Outage	3/13/2025	70.23	2
PLF	Planned Outage	3/13/2025	275.03	1
Transformer	Planned Outage	3/13/2025	467.50	5
Transformer	Planned Outage	3/13/2025	5,552.27	16
Transformer	Planned Outage	3/13/2025	1,295.55	9
Service point	Planned Outage	3/13/2025	93.03	1
Transformer	Planned Outage	3/13/2025	142.78	13
Transformer	Planned Outage	3/13/2025	127.43	2
Transformer	Planned Outage	3/13/2025	36.75	1
Transformer	Planned Outage	3/13/2025	1,659.20	4
Transformer	Planned Outage	3/13/2025	2,078.93	4
Transformer	Planned Outage	3/13/2025	50.53	8
PLF	Planned Outage	3/13/2025	2,201.73	14
Transformer Bank	Planned Outage	3/13/2025	377.18	1
Transformer Bank	Planned Outage	3/13/2025	3,060.67	10
Transformer	Planned Outage	3/14/2025	37.47	4
Transformer	Planned Outage	3/14/2025	80.70	3
PLF	Planned Outage	3/14/2025	60.00	6
Transformer Bank	Planned Outage	3/14/2025	743.67	2
PLF	Planned Outage	3/14/2025	1,082.33	20
PLF	Planned Outage	3/14/2025	1,622.33	20
Transformer	Planned Outage	3/14/2025	358.35	1
PLF	Planned Outage	3/14/2025	1,684.70	51
None	Planned Outage	3/14/2025	3,799.50	18
Transformer	Planned Outage	3/14/2025	158.08	1
Transformer	Planned Outage	3/14/2025	732.70	3
Transformer	Planned Outage	3/14/2025	601.35	3
Transformer	Planned Outage	3/14/2025	677.17	5
PLF	Planned Outage	3/14/2025	412.53	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	3/14/2025	704.70	6
PLF	Planned Outage	3/14/2025	35.40	1
Transformer	Planned Outage	3/14/2025	330.75	7
Transformer	Planned Outage	3/14/2025	117.13	4
Transformer	Planned Outage	3/14/2025	408.17	10
Transformer	Planned Outage	3/14/2025	366.00	8
PLF	Planned Outage	3/14/2025	206.00	2
PLF	Planned Outage	3/14/2025	483.60	9
PLF	Planned Outage	3/14/2025	259.75	5
PLF	Planned Outage	3/14/2025	259.42	5
PLF	Planned Outage	3/14/2025	236.50	5
PLF	Planned Outage	3/14/2025	17.02	1
Transformer	Planned Outage	3/14/2025	1,953.05	11
PLF	Planned Outage	3/15/2025	425.47	1
Transformer	Planned Outage	3/15/2025	552.73	1
PLF	Planned Outage	3/15/2025	857.33	4
PLF	Planned Outage	3/15/2025	210.08	1
Transformer	Planned Outage	3/15/2025	40.87	1
Transformer	Planned Outage	3/15/2025	95.63	2
Transformer	Planned Outage	3/15/2025	42.73	2
None	Planned Outage	3/15/2025	2,063.33	50
Transformer	Planned Outage	3/16/2025	33.83	10
PLF	Planned Outage	3/16/2025	102.20	14
PLF	Planned Outage	3/16/2025	6.27	1
PLF	Planned Outage	3/16/2025	6.28	1
PLF	Planned Outage	3/16/2025	200.55	1
PLF	Planned Outage	3/16/2025	1,456.88	61
PLF	Planned Outage	3/16/2025	99.87	1
Transformer	Planned Outage	3/16/2025	289.80	4
Transformer	Planned Outage	3/16/2025	56.40	8
PLF	Planned Outage	3/16/2025	41.82	1
PLF	Planned Outage	3/16/2025	8,278.23	211
Switch	Planned Outage	3/16/2025	2,278.50	62
Switch	Planned Outage	3/16/2025	4.30	3
None	Planned Outage	3/16/2025	992.25	27
Switch	Planned Outage	3/16/2025	9.92	7
Transformer	Planned Outage	3/17/2025	896.00	7
Transformer	Planned Outage	3/17/2025	311.47	1
Transformer	Planned Outage	3/17/2025	63.20	2
Transformer	Planned Outage	3/17/2025	120.27	1
Transformer Bank	Planned Outage	3/17/2025	3,439.75	3
Transformer	Planned Outage	3/17/2025	451.37	11

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	3/17/2025	393.50	15
Transformer	Planned Outage	3/17/2025	43.27	1
Transformer	Planned Outage	3/17/2025	179.75	1
Transformer	Planned Outage	3/17/2025	550.58	5
Transformer	Planned Outage	3/17/2025	366.53	8
Transformer	Planned Outage	3/17/2025	118.42	5
None	Planned Outage	3/17/2025	325.27	28
None	Planned Outage	3/17/2025	328.00	3
Transformer	Planned Outage	3/17/2025	304.15	11
Transformer	Planned Outage	3/17/2025	112.53	2
Transformer	Planned Outage	3/17/2025	131.00	12
Transformer Bank	Planned Outage	3/17/2025	1,464.83	2
Transformer Bank	Planned Outage	3/17/2025	21.97	1
Transformer	Planned Outage	3/17/2025	514.25	11
Service point	Planned Outage	3/17/2025	20.95	1
Transformer Bank	Planned Outage	3/17/2025	561.20	8
Transformer	Planned Outage	3/17/2025	49.27	4
Transformer Bank	Planned Outage	3/17/2025	115.00	4
Transformer	Planned Outage	3/17/2025	728.10	9
Transformer	Planned Outage	3/17/2025	247.93	4
Transformer	Planned Outage	3/17/2025	55.30	3
Transformer Bank	Planned Outage	3/17/2025	65.07	2
Transformer	Planned Outage	3/17/2025	88.05	3
PLF	Planned Outage	3/17/2025	1,799.00	10
None	Planned Outage	3/17/2025	21.80	2
Invalid	Planned Outage	3/18/2025	2,117.60	3
Transformer	Planned Outage	3/18/2025	3,078.53	22
PLF	Planned Outage	3/18/2025	81.55	1
Transformer	Planned Outage	3/18/2025	69.75	3
Transformer	Planned Outage	3/18/2025	1,260.83	5
Transformer	Planned Outage	3/18/2025	775.65	3
Transformer	Planned Outage	3/18/2025	658.87	2
Transformer	Planned Outage	3/18/2025	260.55	3
Transformer	Planned Outage	3/18/2025	374.33	10
Transformer	Planned Outage	3/18/2025	282.83	5
PLF	Planned Outage	3/18/2025	125.67	1
Transformer	Planned Outage	3/18/2025	149.58	5
Transformer	Planned Outage	3/18/2025	138.03	1
Transformer	Planned Outage	3/18/2025	236.40	6
Transformer	Planned Outage	3/18/2025	690.13	4
Transformer	Planned Outage	3/18/2025	619.00	12
Transformer	Planned Outage	3/18/2025	62.75	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	3/18/2025	54.35	3
Transformer	Planned Outage	3/18/2025	17.85	1
Transformer	Planned Outage	3/18/2025	312.00	8
Transformer	Planned Outage	3/18/2025	269.25	3
Transformer	Planned Outage	3/18/2025	117.95	3
PLF	Planned Outage	3/18/2025	466.63	2
Transformer	Planned Outage	3/18/2025	3,995.02	11
PLF	Planned Outage	3/19/2025	220.73	4
Primary Wire	Planned Outage	3/19/2025	387.60	2
Transformer	Planned Outage	3/19/2025	818.80	8
Transformer	Planned Outage	3/19/2025	642.73	4
Primary Wire	Planned Outage	3/19/2025	507.25	3
Transformer	Planned Outage	3/19/2025	788.08	5
Transformer	Planned Outage	3/19/2025	231.50	5
Transformer	Planned Outage	3/19/2025	415.40	3
Transformer	Planned Outage	3/19/2025	815.47	8
Transformer	Planned Outage	3/19/2025	106.60	4
Transformer	Planned Outage	3/19/2025	345.17	2
Transformer	Planned Outage	3/19/2025	979.20	8
Service point	Planned Outage	3/19/2025	105.05	1
Transformer	Planned Outage	3/19/2025	71.73	1
Transformer	Planned Outage	3/19/2025	299.33	4
Transformer	Planned Outage	3/19/2025	315.47	8
Transformer	Planned Outage	3/19/2025	197.00	5
PLF	Planned Outage	3/19/2025	11,468.00	47
Transformer	Planned Outage	3/20/2025	50.30	1
Transformer Bank	Planned Outage	3/20/2025	127.80	4
Primary Wire	Planned Outage	3/20/2025	14,007.00	42
Breaker	Planned Outage	3/20/2025	653.33	70
Transformer	Planned Outage	3/20/2025	199.50	6
None	Planned Outage	3/20/2025	8,002.80	24
Transformer Bank	Planned Outage	3/20/2025	179.32	1
Transformer	Planned Outage	3/20/2025	6,488.80	24
Transformer	Planned Outage	3/20/2025	43.23	2
Transformer	Planned Outage	3/20/2025	3,373.77	7
PLF	Planned Outage	3/20/2025	2,702.05	13
Transformer	Planned Outage	3/20/2025	50.32	1
Transformer	Planned Outage	3/20/2025	456.07	4
Transformer	Planned Outage	3/20/2025	119.53	1
Transformer	Planned Outage	3/20/2025	297.37	1
Transformer	Planned Outage	3/20/2025	521.67	10
Transformer	Planned Outage	3/20/2025	1,684.33	10

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Switch	Planned Outage	3/20/2025	232.53	2
Transformer	Planned Outage	3/20/2025	40.67	4
None	Planned Outage	3/20/2025	47.62	1
None	Planned Outage	3/20/2025	285.90	6
None	Planned Outage	3/20/2025	3,122.90	66
Transformer	Planned Outage	3/20/2025	984.40	8
None	Planned Outage	3/20/2025	613.10	6
Switch	Planned Outage	3/20/2025	283.17	5
Breaker	Planned Outage	3/20/2025	53.97	1
Breaker	Planned Outage	3/20/2025	35.03	1
Switch	Planned Outage	3/20/2025	46.67	1
Switch	Planned Outage	3/20/2025	42.17	1
Switch	Planned Outage	3/20/2025	35.82	1
Transformer	Planned Outage	3/20/2025	680.63	2
Invalid	Planned Outage	3/20/2025	84.63	2
Breaker	Planned Outage	3/20/2025	7,047.80	524
Breaker	Planned Outage	3/20/2025	7,047.80	524
Breaker	Planned Outage	3/20/2025	1,076.00	80
PLF	Planned Outage	3/20/2025	102.30	3
Transformer	Planned Outage	3/20/2025	413.12	7
Transformer Bank	Planned Outage	3/20/2025	1,127.05	3
PLF	Planned Outage	3/20/2025	296.55	3
Transformer	Planned Outage	3/20/2025	311.50	15
Transformer Bank	Planned Outage	3/20/2025	606.37	2
PLF	Planned Outage	3/21/2025	205.60	4
Transformer Bank	Planned Outage	3/21/2025	360.53	8
Transformer Bank	Planned Outage	3/21/2025	89.55	3
Breaker	Planned Outage	3/21/2025	15,499.83	1130
Breaker	Planned Outage	3/21/2025	13.87	1
Breaker	Planned Outage	3/21/2025	13.43	1
Breaker	Planned Outage	3/21/2025	13.53	1
Breaker	Planned Outage	3/21/2025	13.67	1
Breaker	Planned Outage	3/21/2025	13.77	1
Transformer	Planned Outage	3/21/2025	472.43	2
Transformer	Planned Outage	3/21/2025	163.13	2
Transformer	Planned Outage	3/21/2025	934.35	3
PLF	Planned Outage	3/21/2025	455.87	2
Breaker	Planned Outage	3/21/2025	32,767.58	1937
Breaker	Planned Outage	3/21/2025	17.12	1
Breaker	Planned Outage	3/21/2025	17.18	1
Breaker	Planned Outage	3/21/2025	17.27	1
Breaker	Planned Outage	3/21/2025	17.03	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	3/21/2025	43.72	1
PLF	Planned Outage	3/21/2025	164.00	5
Transformer	Planned Outage	3/21/2025	25.90	2
Transformer	Planned Outage	3/21/2025	22.03	1
None	Planned Outage	3/21/2025	17.62	1
Transformer	Planned Outage	3/21/2025	202.33	2
None	Planned Outage	3/21/2025	1,268.70	18
Transformer	Planned Outage	3/22/2025	120.12	1
PLF	Planned Outage	3/22/2025	3,078.90	18
PLF	Planned Outage	3/22/2025	670.50	6
Transformer	Planned Outage	3/22/2025	64.63	1
Transformer	Planned Outage	3/22/2025	285.27	1
Transformer	Planned Outage	3/23/2025	252.42	5
Transformer	Planned Outage	3/23/2025	338.53	8
PLF	Planned Outage	3/23/2025	48.83	1
PLF	Planned Outage	3/23/2025	320.40	1
Primary Wire	Planned Outage	3/23/2025	402.22	1
Service point	Planned Outage	3/23/2025	352.03	1
Primary Wire	Planned Outage	3/23/2025	1,042.05	3
Transformer	Planned Outage	3/23/2025	2,908.27	16
Transformer	Planned Outage	3/23/2025	126.00	2
Service point	Planned Outage	3/24/2025	48.63	1
Service point	Planned Outage	3/24/2025	49.22	1
Transformer	Planned Outage	3/24/2025	96.07	4
Transformer	Planned Outage	3/24/2025	117.50	6
Transformer Bank	Planned Outage	3/24/2025	440.70	1
PLF	Planned Outage	3/24/2025	8,544.47	26
Transformer	Planned Outage	3/24/2025	519.20	6
Transformer	Planned Outage	3/24/2025	986.80	12
Transformer	Planned Outage	3/24/2025	138.75	15
Transformer	Planned Outage	3/24/2025	638.25	9
Transformer	Planned Outage	3/24/2025	38.80	2
None	Planned Outage	3/24/2025	839.65	7
PLF	Planned Outage	3/24/2025	783.55	3
Primary Wire	Planned Outage	3/24/2025	1,056.25	5
Transformer	Planned Outage	3/24/2025	719.03	11
Transformer	Planned Outage	3/24/2025	418.05	3
None	Planned Outage	3/24/2025	415.20	8
None	Planned Outage	3/24/2025	545.33	8
PLF	Planned Outage	3/24/2025	1,036.45	57
None	Planned Outage	3/24/2025	163.67	4
Transformer	Planned Outage	3/24/2025	379.00	10

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	3/24/2025	754.50	10
UG Other	Planned Outage	3/24/2025	156.37	1
Transformer Bank	Planned Outage	3/24/2025	1,723.33	4
Transformer	Planned Outage	3/24/2025	361.60	16
PLF	Planned Outage	3/24/2025	339.12	1
Transformer	Planned Outage	3/25/2025	3,286.93	16
PLF	Planned Outage	3/25/2025	192.50	1
Transformer Bank	Planned Outage	3/25/2025	1,628.27	8
Transformer	Planned Outage	3/25/2025	587.70	3
Breaker	Planned Outage	3/25/2025	10,465.00	780
Transformer	Planned Outage	3/25/2025	2,347.40	12
Transformer	Planned Outage	3/25/2025	2,458.17	14
None	Planned Outage	3/25/2025	1,109.80	62
Breaker	Planned Outage	3/25/2025	60.73	2
None	Planned Outage	3/25/2025	5,656.20	44
Transformer	Planned Outage	3/25/2025	192.80	8
Service point	Planned Outage	3/25/2025	123.75	1
PLF	Planned Outage	3/25/2025	305.70	2
PLF	Planned Outage	3/25/2025	427.00	12
Transformer	Planned Outage	3/25/2025	70.33	2
Transformer	Planned Outage	3/25/2025	1,072.40	6
Transformer	Planned Outage	3/25/2025	686.00	7
Transformer	Planned Outage	3/25/2025	218.20	4
Transformer	Planned Outage	3/25/2025	3.53	1
Transformer	Planned Outage	3/25/2025	62.10	1
Transformer Bank	Planned Outage	3/25/2025	46.15	1
Transformer Bank	Planned Outage	3/25/2025	116.93	4
Transformer	Planned Outage	3/25/2025	724.62	7
Transformer	Planned Outage	3/25/2025	238.87	1
Transformer	Planned Outage	3/25/2025	77.77	2
Transformer	Planned Outage	3/25/2025	1,261.75	7
PLF	Planned Outage	3/25/2025	1,529.83	10
Transformer	Planned Outage	3/25/2025	79.38	11
Transformer	Planned Outage	3/25/2025	93.07	1
Transformer	Planned Outage	3/25/2025	299.47	16
Breaker	Planned Outage	3/26/2025	39,457.83	310
Breaker	Planned Outage	3/26/2025	55,936.50	445
Transformer Bank	Planned Outage	3/26/2025	1,124.55	9
Transformer	Planned Outage	3/26/2025	87.68	1
Transformer	Planned Outage	3/26/2025	28.50	3
Transformer	Planned Outage	3/26/2025	169.20	6
Transformer	Planned Outage	3/26/2025	229.70	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	3/26/2025	1,155.95	3
Transformer	Planned Outage	3/26/2025	415.08	5
Transformer Bank	Planned Outage	3/26/2025	413.40	1
Transformer	Planned Outage	3/26/2025	346.00	8
Transformer	Planned Outage	3/26/2025	11.60	8
Transformer	Planned Outage	3/26/2025	9.47	8
Transformer	Planned Outage	3/26/2025	13.73	8
Transformer	Planned Outage	3/26/2025	15.73	8
Transformer	Planned Outage	3/26/2025	17.87	8
Transformer	Planned Outage	3/26/2025	17.47	8
Transformer	Planned Outage	3/26/2025	447.33	8
Transformer	Planned Outage	3/26/2025	140.25	5
Transformer	Planned Outage	3/26/2025	13.60	3
Transformer	Planned Outage	3/26/2025	88.10	6
Transformer	Planned Outage	3/26/2025	29.77	1
PLF	Planned Outage	3/26/2025	176.83	1
Transformer	Planned Outage	3/26/2025	643.65	7
Transformer Bank	Planned Outage	3/26/2025	222.53	1
Transformer	Planned Outage	3/26/2025	52.65	1
Transformer	Planned Outage	3/26/2025	1,114.80	8
Transformer	Planned Outage	3/26/2025	1,330.00	15
Transformer	Planned Outage	3/26/2025	190.40	7
Transformer	Planned Outage	3/26/2025	475.93	2
Transformer	Planned Outage	3/26/2025	41.70	1
Transformer	Planned Outage	3/26/2025	160.20	2
Transformer	Planned Outage	3/26/2025	341.87	8
Transformer	Planned Outage	3/26/2025	343.17	10
Transformer	Planned Outage	3/26/2025	764.40	12
PLF	Planned Outage	3/26/2025	346.00	6
PLF	Planned Outage	3/26/2025	114.90	2
Transformer Bank	Planned Outage	3/26/2025	9.20	1
None	Planned Outage	3/26/2025	204.67	8
Transformer Bank	Planned Outage	3/26/2025	152.13	2
Transformer Bank	Planned Outage	3/26/2025	1,399.20	9
Transformer	Planned Outage	3/26/2025	1,124.43	7
Transformer	Planned Outage	3/26/2025	274.12	1
Transformer	Planned Outage	3/26/2025	528.50	2
Transformer	Planned Outage	3/26/2025	35.40	4
PLF	Planned Outage	3/26/2025	2,571.07	8
Transformer Bank	Planned Outage	3/27/2025	1.32	1
PLF	Planned Outage	3/27/2025	319.50	1
PLF	Planned Outage	3/27/2025	221.15	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Primary Wire	Planned Outage	3/27/2025	4,005.20	12
PLF	Planned Outage	3/27/2025	1,904.28	13
None	Planned Outage	3/27/2025	4,995.90	39
None	Planned Outage	3/27/2025	48.82	1
Primary Wire	Planned Outage	3/27/2025	246.93	2
PLF	Planned Outage	3/27/2025	4,512.73	26
None	Planned Outage	3/27/2025	5,169.60	27
Transformer	Planned Outage	3/27/2025	624.00	13
Transformer	Planned Outage	3/27/2025	37.38	1
Transformer	Planned Outage	3/27/2025	60.70	3
Transformer	Planned Outage	3/27/2025	132.58	5
Transformer	Planned Outage	3/27/2025	15.80	2
Transformer Bank	Planned Outage	3/27/2025	84.17	2
Transformer	Planned Outage	3/27/2025	386.47	4
Transformer	Planned Outage	3/27/2025	241.40	6
Transformer Bank	Planned Outage	3/27/2025	99.95	1
Transformer	Planned Outage	3/27/2025	1.03	1
Transformer	Planned Outage	3/27/2025	34.88	7
Transformer	Planned Outage	3/27/2025	28.00	8
Transformer	Planned Outage	3/27/2025	3.93	1
Transformer	Planned Outage	3/27/2025	530.93	8
Transformer	Planned Outage	3/27/2025	728.75	11
Transformer	Planned Outage	3/27/2025	129.98	1
Transformer	Planned Outage	3/27/2025	94.05	1
Transformer	Planned Outage	3/27/2025	94.05	1
Transformer	Planned Outage	3/27/2025	182.10	6
PLF	Planned Outage	3/27/2025	69.33	26
None	Planned Outage	3/27/2025	630.30	11
Transformer Bank	Planned Outage	3/27/2025	2,986.35	9
Invalid	Planned Outage	3/27/2025	132.20	3
PLF	Planned Outage	3/28/2025	844.60	12
Transformer	Planned Outage	3/28/2025	326.25	9
Transformer	Planned Outage	3/28/2025	1,438.33	5
Transformer	Planned Outage	3/28/2025	486.60	3
Transformer	Planned Outage	3/28/2025	280.73	1
None	Planned Outage	3/28/2025	228.60	2
Transformer	Planned Outage	3/28/2025	1,343.50	6
Transformer	Planned Outage	3/28/2025	8,286.45	9
PLF	Planned Outage	3/28/2025	1,326.50	10
Transformer Bank	Planned Outage	3/28/2025	38.05	1
None	Planned Outage	3/28/2025	74.00	10
Transformer	Planned Outage	3/28/2025	27.30	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	3/28/2025	261.60	8
Transformer	Planned Outage	3/28/2025	220.40	6
Transformer	Planned Outage	3/28/2025	595.10	33
Transformer	Planned Outage	3/28/2025	176.27	16
None	Planned Outage	3/28/2025	7,720.20	108
PLF	Planned Outage	3/29/2025	19.60	3
Transformer	Planned Outage	3/29/2025	186.57	1
Switch	Planned Outage	3/29/2025	994.70	6
Switch	Planned Outage	3/29/2025	888.65	3
Switch	Planned Outage	3/29/2025	3,977.20	24
Switch	Planned Outage	3/29/2025	1,184.87	4
Switch	Planned Outage	3/29/2025	1,184.87	4
Switch	Planned Outage	3/29/2025	1,324.13	8
Switch	Planned Outage	3/29/2025	15,388.40	93
Switch	Planned Outage	3/29/2025	994.40	6
Switch	Planned Outage	3/29/2025	1,656.33	10
Switch	Planned Outage	3/29/2025	662.87	4
Switch	Planned Outage	3/29/2025	1,488.00	9
Switch	Planned Outage	3/29/2025	1,652.67	10
Switch	Planned Outage	3/29/2025	13,566.90	82
Switch	Planned Outage	3/29/2025	1,158.03	7
Switch	Planned Outage	3/29/2025	28,907.08	175
Switch	Planned Outage	3/29/2025	993.20	6
Switch	Planned Outage	3/29/2025	994.60	6
Switch	Planned Outage	3/29/2025	1,652.17	10
Switch	Planned Outage	3/29/2025	190,338.80	1173
Switch	Planned Outage	3/29/2025	5,629.83	34
Switch	Planned Outage	3/29/2025	994.30	6
Switch	Planned Outage	3/29/2025	2,369.73	8
Switch	Planned Outage	3/29/2025	828.92	5
Switch	Planned Outage	3/29/2025	2,044.23	7
Switch	Planned Outage	3/29/2025	497.05	3
Switch	Planned Outage	3/29/2025	991.20	6
Switch	Planned Outage	3/29/2025	115.13	4
Switch	Planned Outage	3/29/2025	28.80	1
Switch	Planned Outage	3/29/2025	27.60	1
Switch	Planned Outage	3/30/2025	571.20	1
Transformer	Planned Outage	3/30/2025	1,010.20	12
Service point	Planned Outage	3/30/2025	158.85	1
None	Planned Outage	3/30/2025	10,599.05	21
None	Planned Outage	3/30/2025	2,762.70	6
None	Planned Outage	3/30/2025	2,756.00	30

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	3/31/2025	36.17	1
PLF	Planned Outage	3/31/2025	831.60	44
PLF	Planned Outage	3/31/2025	360.93	8
Transformer Bank	Planned Outage	3/31/2025	480.00	2
PLF	Planned Outage	3/31/2025	88.53	1
Transformer	Planned Outage	3/31/2025	71.90	3
Transformer	Planned Outage	3/31/2025	4,043.60	12
Transformer	Planned Outage	3/31/2025	210.65	11
Transformer	Planned Outage	3/31/2025	82.28	1
Transformer	Planned Outage	3/31/2025	849.57	7
None	Planned Outage	3/31/2025	2,153.67	28
Transformer	Planned Outage	3/31/2025	1,066.60	4
Transformer	Planned Outage	3/31/2025	1,462.20	9
PLF	Planned Outage	3/31/2025	2,118.92	5
Transformer	Planned Outage	3/31/2025	213.90	9
Transformer	Planned Outage	3/31/2025	520.80	7
Transformer	Planned Outage	3/31/2025	791.83	10
Transformer	Planned Outage	3/31/2025	1,129.08	5
Transformer	Planned Outage	3/31/2025	413.47	8
Transformer	Planned Outage	3/31/2025	1,689.33	8
Transformer	Planned Outage	3/31/2025	196.37	1
Transformer	Planned Outage	3/31/2025	20.87	4
Transformer	Planned Outage	3/31/2025	2,168.17	10
Transformer	Planned Outage	3/31/2025	118.53	8
Transformer	Planned Outage	3/31/2025	968.47	2
Transformer Bank	Planned Outage	3/31/2025	1,866.67	8
Transformer	Planned Outage	3/31/2025	489.87	11
PLF	Planned Outage	4/1/2025	1,314.70	3
Breaker	Planned Outage	4/1/2025	10,232.02	737
Transformer	Planned Outage	4/1/2025	594.32	13
Transformer	Planned Outage	4/1/2025	77.97	1
Transformer	Planned Outage	4/1/2025	4,023.00	12
Transformer	Planned Outage	4/1/2025	26.13	4
Transformer	Planned Outage	4/1/2025	48.03	2
Primary Wire	Planned Outage	4/1/2025	112.27	4
Primary Wire	Planned Outage	4/1/2025	470.83	2
Transformer Bank	Planned Outage	4/1/2025	134.73	4
Transformer	Planned Outage	4/1/2025	148.25	5
PLF	Planned Outage	4/1/2025	66.23	1
Transformer	Planned Outage	4/1/2025	408.20	12
PLF	Planned Outage	4/1/2025	286.67	16
Transformer	Planned Outage	4/1/2025	96.95	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	4/1/2025	15.33	1
Transformer	Planned Outage	4/1/2025	64.05	3
Transformer Bank	Planned Outage	4/1/2025	99.00	5
Transformer	Planned Outage	4/1/2025	731.47	13
None	Planned Outage	4/1/2025	34,969.20	69
PLF	Planned Outage	4/1/2025	2,312.65	23
Transformer	Planned Outage	4/1/2025	3,027.90	9
None	Planned Outage	4/1/2025	1,819.57	13
Breaker	Planned Outage	4/1/2025	40.52	1
Breaker	Planned Outage	4/1/2025	75,124.13	2024
Transformer Bank	Planned Outage	4/1/2025	383.50	6
Transformer	Planned Outage	4/1/2025	4,241.97	11
Transformer	Planned Outage	4/2/2025	67.47	2
Transformer Bank	Planned Outage	4/2/2025	405.13	2
Transformer	Planned Outage	4/2/2025	205.20	8
Transformer	Planned Outage	4/2/2025	1,628.88	17
Primary Wire	Planned Outage	4/2/2025	214.35	3
Transformer	Planned Outage	4/2/2025	192.00	8
Transformer	Planned Outage	4/2/2025	63.10	3
Transformer	Planned Outage	4/2/2025	791.50	6
Transformer	Planned Outage	4/2/2025	29.55	1
Transformer	Planned Outage	4/2/2025	32.57	1
Transformer	Planned Outage	4/2/2025	871.00	10
None	Planned Outage	4/2/2025	2,227.25	59
None	Planned Outage	4/2/2025	37.75	1
None	Planned Outage	4/2/2025	24,866.05	87
PLF	Planned Outage	4/2/2025	418.67	4
Transformer	Planned Outage	4/2/2025	219.85	1
Transformer	Planned Outage	4/2/2025	111.05	1
PLF	Planned Outage	4/2/2025	38.47	1
Transformer	Planned Outage	4/2/2025	120.40	14
PLF	Planned Outage	4/2/2025	7.07	1
None	Planned Outage	4/2/2025	168.03	1
None	Planned Outage	4/2/2025	74.13	1
None	Planned Outage	4/2/2025	1,108.50	15
Transformer	Planned Outage	4/2/2025	91.23	1
Transformer	Planned Outage	4/2/2025	35.42	1
Transformer	Planned Outage	4/2/2025	273.17	1
Transformer	Planned Outage	4/3/2025	146.70	6
PLF	Planned Outage	4/3/2025	1,512.93	8
Transformer	Planned Outage	4/3/2025	24.92	5
Transformer	Planned Outage	4/3/2025	250.17	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	4/3/2025	236.02	7
Transformer	Planned Outage	4/3/2025	100.00	5
Transformer	Planned Outage	4/3/2025	917.50	6
Transformer	Planned Outage	4/3/2025	50.63	2
Transformer	Planned Outage	4/3/2025	648.67	8
PLF	Planned Outage	4/3/2025	247.92	1
Transformer	Planned Outage	4/3/2025	299.48	7
Transformer	Planned Outage	4/3/2025	1,067.00	10
Transformer	Planned Outage	4/3/2025	755.30	6
Transformer	Planned Outage	4/3/2025	43.85	3
Primary Wire	Planned Outage	4/3/2025	6,822.55	21
Primary Wire	Planned Outage	4/3/2025	1,884.98	7
PLF	Planned Outage	4/3/2025	255.10	1
Transformer	Planned Outage	4/3/2025	32.57	2
Transformer	Planned Outage	4/3/2025	96.33	2
PLF	Planned Outage	4/3/2025	44.10	1
PLF	Planned Outage	4/3/2025	552.73	1
Transformer	Planned Outage	4/3/2025	74.50	2
Transformer	Planned Outage	4/3/2025	563.60	8
Transformer	Planned Outage	4/3/2025	1,051.73	4
Transformer	Planned Outage	4/3/2025	2,666.73	13
Transformer	Planned Outage	4/3/2025	206.53	2
Transformer	Planned Outage	4/3/2025	46.03	2
Transformer	Planned Outage	4/3/2025	284.47	4
Transformer Bank	Planned Outage	4/3/2025	242.60	2
Transformer	Planned Outage	4/3/2025	174.52	1
Transformer	Planned Outage	4/3/2025	300.30	2
Transformer	Planned Outage	4/3/2025	29.80	6
PLF	Planned Outage	4/3/2025	138.73	1
Transformer	Planned Outage	4/3/2025	36.87	2
None	Planned Outage	4/3/2025	714.60	6
Transformer	Planned Outage	4/4/2025	109.55	7
Transformer	Planned Outage	4/4/2025	163.65	9
Transformer	Planned Outage	4/4/2025	963.50	15
Transformer	Planned Outage	4/4/2025	214.65	1
Transformer	Planned Outage	4/4/2025	966.07	4
Transformer	Planned Outage	4/4/2025	1,225.47	13
Switch	Planned Outage	4/4/2025	212.37	1
Transformer	Planned Outage	4/4/2025	172.08	7
Transformer	Planned Outage	4/4/2025	40.80	4
PLF	Planned Outage	4/4/2025	579.50	6
PLF	Planned Outage	4/4/2025	460.00	23

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	4/4/2025	79.73	4
PLF	Planned Outage	4/4/2025	1,073.33	56
Transformer	Planned Outage	4/4/2025	24.20	2
Transformer Bank	Planned Outage	4/4/2025	724.85	7
PLF	Planned Outage	4/4/2025	30.22	1
Transformer	Planned Outage	4/5/2025	5,561.55	51
Switch	Planned Outage	4/5/2025	679.13	4
PLF	Planned Outage	4/5/2025	17.30	3
Transformer	Planned Outage	4/5/2025	25.20	4
Service - Crew	Planned Outage	4/5/2025	1,452.42	5
Transformer	Planned Outage	4/5/2025	4,957.52	11
Transformer	Planned Outage	4/5/2025	296.40	12
Breaker	Planned Outage	4/5/2025	2,782.00	520
Breaker	Planned Outage	4/5/2025	9.33	1
Breaker	Planned Outage	4/5/2025	12.45	1
Transformer Bank	Planned Outage	4/5/2025	36.25	5
PLF	Planned Outage	4/6/2025	899.60	12
PLF	Planned Outage	4/6/2025	334.93	1
Breaker	Planned Outage	4/6/2025	26,838.93	196
Transformer	Planned Outage	4/6/2025	845.10	6
Transformer	Planned Outage	4/6/2025	179.20	8
Transformer	Planned Outage	4/6/2025	1,132.47	4
PLF	Planned Outage	4/7/2025	269.25	1
PLF	Planned Outage	4/7/2025	865.00	30
PLF	Planned Outage	4/7/2025	1,584.75	5
Transformer	Planned Outage	4/7/2025	184.13	4
Transformer	Planned Outage	4/7/2025	85.20	3
Transformer	Planned Outage	4/7/2025	63.93	4
Transformer	Planned Outage	4/7/2025	218.82	1
PLF	Planned Outage	4/7/2025	115.70	2
PLF	Planned Outage	4/7/2025	44.37	2
Transformer	Planned Outage	4/7/2025	94.67	10
Transformer	Planned Outage	4/7/2025	116.08	5
Transformer	Planned Outage	4/7/2025	496.60	3
PLF	Planned Outage	4/7/2025	26.50	2
Transformer	Planned Outage	4/7/2025	561.45	3
PLF	Planned Outage	4/7/2025	365.03	1
Transformer	Planned Outage	4/7/2025	47.55	3
PLF	Planned Outage	4/7/2025	3.87	2
Transformer	Planned Outage	4/7/2025	67.20	4
None	Planned Outage	4/7/2025	18.03	1
Transformer	Planned Outage	4/7/2025	797.83	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	4/7/2025	8.75	1
PLF	Planned Outage	4/7/2025	22.85	3
PLF	Planned Outage	4/7/2025	9.37	1
Transformer	Planned Outage	4/7/2025	97.67	2
None	Planned Outage	4/7/2025	21.62	1
None	Planned Outage	4/7/2025	19,861.33	931
None	Planned Outage	4/7/2025	20.53	1
Transformer Bank	Planned Outage	4/7/2025	75.83	5
Service point	Planned Outage	4/7/2025	49.05	1
PLF	Planned Outage	4/7/2025	186.50	1
PLF	Planned Outage	4/7/2025	552.50	39
PLF	Planned Outage	4/7/2025	75.72	7
None	Planned Outage	4/8/2025	266.07	4
PLF	Planned Outage	4/8/2025	39.45	1
Breaker	Planned Outage	4/8/2025	19,612.80	1728
Breaker	Planned Outage	4/8/2025	11.75	1
Breaker	Planned Outage	4/8/2025	8.57	1
Breaker	Planned Outage	4/8/2025	8.75	1
Breaker	Planned Outage	4/8/2025	15,552.00	1728
Breaker	Planned Outage	4/8/2025	9,963.03	1163
Primary Wire	Planned Outage	4/8/2025	371.83	5
Primary Wire	Planned Outage	4/8/2025	61,203.77	823
PLF	Planned Outage	4/8/2025	56.62	1
Breaker	Planned Outage	4/8/2025	12,432.65	1707
Breaker	Planned Outage	4/8/2025	7.28	1
Breaker	Planned Outage	4/8/2025	7.28	1
Breaker	Planned Outage	4/8/2025	7.28	1
Breaker	Planned Outage	4/8/2025	7.28	1
None	Planned Outage	4/8/2025	430.85	7
PLF	Planned Outage	4/8/2025	2,064.67	5
Transformer	Planned Outage	4/8/2025	2,066.25	5
Transformer	Planned Outage	4/8/2025	194.43	1
PLF	Planned Outage	4/8/2025	6,111.25	15
PLF	Planned Outage	4/8/2025	1,650.73	22
Transformer	Planned Outage	4/8/2025	4,321.33	8
Transformer	Planned Outage	4/8/2025	86.93	4
Transformer	Planned Outage	4/8/2025	428.33	4
Transformer	Planned Outage	4/8/2025	314.32	1
Transformer	Planned Outage	4/8/2025	449.10	6
Transformer	Planned Outage	4/8/2025	1,665.18	7
PLF	Planned Outage	4/8/2025	120.20	1
Transformer	Planned Outage	4/8/2025	149.00	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	4/8/2025	81.17	2
Transformer	Planned Outage	4/8/2025	922.20	6
Transformer	Planned Outage	4/8/2025	30.80	8
Transformer	Planned Outage	4/8/2025	4,501.05	37
Transformer	Planned Outage	4/8/2025	31.10	6
Transformer	Planned Outage	4/8/2025	30.57	1
Transformer	Planned Outage	4/8/2025	695.42	5
Transformer	Planned Outage	4/8/2025	251.10	6
Transformer	Planned Outage	4/8/2025	2,627.50	25
Transformer	Planned Outage	4/8/2025	161.27	4
Transformer	Planned Outage	4/8/2025	76.50	9
Transformer	Planned Outage	4/8/2025	155.93	4
Transformer	Planned Outage	4/8/2025	439.90	6
Transformer	Planned Outage	4/8/2025	39.82	1
Transformer	Planned Outage	4/8/2025	317.40	4
Transformer	Planned Outage	4/8/2025	388.83	1
Transformer	Planned Outage	4/8/2025	86.57	7
Transformer	Planned Outage	4/8/2025	147.00	5
PLF	Planned Outage	4/8/2025	2,041.65	9
Transformer Bank	Planned Outage	4/8/2025	2,242.28	13
Transformer Bank	Planned Outage	4/9/2025	161.17	2
Transformer	Planned Outage	4/9/2025	220.80	9
Transformer	Planned Outage	4/9/2025	4,391.10	9
Transformer	Planned Outage	4/9/2025	418.90	3
Transformer	Planned Outage	4/9/2025	603.10	6
PLF	Planned Outage	4/9/2025	472.70	1
Transformer	Planned Outage	4/9/2025	2,785.35	31
Transformer	Planned Outage	4/9/2025	104.55	1
Transformer	Planned Outage	4/9/2025	236.83	2
PLF	Planned Outage	4/9/2025	741.83	5
PLF	Planned Outage	4/9/2025	1,804.40	12
Transformer	Planned Outage	4/9/2025	101.60	1
Transformer	Planned Outage	4/9/2025	23.05	1
Transformer	Planned Outage	4/9/2025	1,301.85	9
Transformer	Planned Outage	4/9/2025	1,033.40	6
Transformer	Planned Outage	4/9/2025	39.53	2
Transformer	Planned Outage	4/9/2025	501.78	7
Transformer	Planned Outage	4/9/2025	662.00	10
Transformer	Planned Outage	4/9/2025	12.67	2
Transformer	Planned Outage	4/9/2025	21.43	1
Transformer	Planned Outage	4/9/2025	562.67	4
Transformer	Planned Outage	4/9/2025	22.95	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	4/9/2025	878.50	21
Transformer	Planned Outage	4/9/2025	705.50	6
Transformer	Planned Outage	4/9/2025	118.98	1
None	Planned Outage	4/9/2025	676.40	8
Transformer	Planned Outage	4/9/2025	1,152.43	14
Transformer	Planned Outage	4/9/2025	626.50	7
Transformer	Planned Outage	4/9/2025	2,537.73	14
PLF	Planned Outage	4/9/2025	2,284.35	9
PLF	Planned Outage	4/10/2025	272.50	1
Transformer	Planned Outage	4/10/2025	6,020.55	17
Transformer	Planned Outage	4/10/2025	753.93	4
Transformer	Planned Outage	4/10/2025	827.40	6
Primary Wire	Planned Outage	4/10/2025	6,759.20	51
Transformer	Planned Outage	4/10/2025	1,576.75	7
PLF	Planned Outage	4/10/2025	77.55	3
Transformer	Planned Outage	4/10/2025	25.38	1
Primary Wire	Planned Outage	4/10/2025	206.90	2
Transformer	Planned Outage	4/10/2025	21.50	1
PLF	Planned Outage	4/10/2025	3,319.73	16
Transformer Bank	Planned Outage	4/10/2025	456.10	2
Transformer	Planned Outage	4/10/2025	20.17	1
PLF	Planned Outage	4/10/2025	313.40	2
PLF	Planned Outage	4/10/2025	316.83	1
Transformer	Planned Outage	4/10/2025	117.33	5
Transformer	Planned Outage	4/10/2025	887.47	16
None	Planned Outage	4/10/2025	637.85	3
None	Planned Outage	4/10/2025	237.73	1
Transformer	Planned Outage	4/10/2025	35.20	2
Transformer	Planned Outage	4/10/2025	652.00	8
PLF	Planned Outage	4/10/2025	129.80	2
Transformer	Planned Outage	4/10/2025	434.00	8
PLF	Planned Outage	4/10/2025	2,675.87	56
Transformer	Planned Outage	4/10/2025	544.25	7
PLF	Planned Outage	4/10/2025	30.13	1
Transformer	Planned Outage	4/10/2025	46.33	10
PLF	Planned Outage	4/10/2025	263.27	11
Transformer	Planned Outage	4/10/2025	89.50	10
PLF	Planned Outage	4/10/2025	1,527.33	116
Transformer	Planned Outage	4/10/2025	4,533.53	13
Transformer	Planned Outage	4/11/2025	1,096.55	7
Transformer	Planned Outage	4/11/2025	274.42	5
Transformer	Planned Outage	4/11/2025	771.52	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	4/11/2025	53.10	27
Transformer	Planned Outage	4/11/2025	280.90	2
None	Planned Outage	4/11/2025	3,171.15	27
Transformer	Planned Outage	4/11/2025	88.20	7
Transformer	Planned Outage	4/11/2025	200.85	3
Transformer	Planned Outage	4/11/2025	274.70	2
Transformer	Planned Outage	4/11/2025	451.20	3
Transformer	Planned Outage	4/11/2025	252.00	12
Transformer	Planned Outage	4/11/2025	161.83	5
Breaker	Planned Outage	4/11/2025	79,299.73	1931
Transformer Bank	Planned Outage	4/11/2025	300.07	4
Primary Wire	Planned Outage	4/12/2025	590.67	20
Primary Wire	Planned Outage	4/12/2025	6,460.92	205
Transformer Bank	Planned Outage	4/12/2025	88.77	1
Breaker	Planned Outage	4/12/2025	17,680.00	1632
Breaker	Planned Outage	4/12/2025	10.83	1
Transformer Bank	Planned Outage	4/12/2025	162.07	1
Transformer Bank	Planned Outage	4/12/2025	323.47	2
Transformer	Planned Outage	4/12/2025	14.20	1
Transformer	Planned Outage	4/12/2025	139.90	6
Breaker	Planned Outage	4/12/2025	12,761.12	1229
Breaker	Planned Outage	4/12/2025	10.62	1
Breaker	Planned Outage	4/12/2025	10.15	1
Breaker	Planned Outage	4/12/2025	10.40	1
Breaker	Planned Outage	4/12/2025	10.48	1
Breaker	Planned Outage	4/12/2025	10.57	1
Breaker	Planned Outage	4/12/2025	10.67	1
Breaker	Planned Outage	4/12/2025	10.28	1
Breaker	Planned Outage	4/12/2025	10.75	1
Breaker	Planned Outage	4/12/2025	10.73	1
Breaker	Planned Outage	4/12/2025	10.30	1
Breaker	Planned Outage	4/12/2025	10.75	1
Breaker	Planned Outage	4/12/2025	10.75	1
Transformer	Planned Outage	4/12/2025	132.65	3
TX Repaired (OH)	Planned Outage	4/13/2025	390.47	2
PLF	Planned Outage	4/13/2025	289.65	1
Transformer	Planned Outage	4/13/2025	297.08	1
Transformer	Planned Outage	4/14/2025	319.20	12
Transformer	Planned Outage	4/14/2025	281.73	2
PLF	Planned Outage	4/14/2025	13,516.10	39
Transformer	Planned Outage	4/14/2025	1,102.33	10
Transformer	Planned Outage	4/14/2025	86.17	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	4/14/2025	131.37	14
Transformer	Planned Outage	4/14/2025	356.50	6
Transformer	Planned Outage	4/14/2025	413.20	4
Transformer	Planned Outage	4/14/2025	705.92	5
Transformer	Planned Outage	4/14/2025	32.13	8
Transformer	Planned Outage	4/14/2025	292.45	3
Transformer	Planned Outage	4/14/2025	500.37	2
PLF	Planned Outage	4/14/2025	344.25	17
Transformer	Planned Outage	4/14/2025	71.20	6
Transformer	Planned Outage	4/14/2025	2,725.95	9
Transformer	Planned Outage	4/14/2025	121.80	6
Transformer Bank	Planned Outage	4/14/2025	91.48	1
PLF	Planned Outage	4/14/2025	326.58	1
Transformer	Planned Outage	4/14/2025	412.88	7
TX Repaired (OH)	Planned Outage	4/14/2025	21.95	1
Transformer	Planned Outage	4/14/2025	190.93	4
Transformer	Planned Outage	4/14/2025	20.67	2
Transformer Bank	Planned Outage	4/14/2025	53.07	1
Transformer	Planned Outage	4/14/2025	86.40	6
PLF	Planned Outage	4/14/2025	38.60	6
Transformer	Planned Outage	4/14/2025	91.43	2
Transformer	Planned Outage	4/14/2025	322.50	9
PLF	Planned Outage	4/14/2025	902.10	3
Transformer	Planned Outage	4/14/2025	134.00	4
Transformer	Planned Outage	4/14/2025	944.60	3
Transformer	Planned Outage	4/15/2025	1,543.73	7
Transformer Bank	Planned Outage	4/15/2025	135.80	6
Transformer	Planned Outage	4/15/2025	357.35	7
Transformer	Planned Outage	4/15/2025	1,175.00	3
Transformer Bank	Planned Outage	4/15/2025	184.57	1
Transformer	Planned Outage	4/15/2025	390.03	1
Transformer	Planned Outage	4/15/2025	1,656.50	10
PLF	Planned Outage	4/15/2025	7,166.40	32
PLF	Planned Outage	4/15/2025	409.65	1
None	Planned Outage	4/15/2025	389.78	1
Switch	Planned Outage	4/15/2025	388.30	1
PLF	Planned Outage	4/15/2025	222.07	4
Transformer	Planned Outage	4/15/2025	392.53	1
Transformer	Planned Outage	4/15/2025	133.33	5
Transformer	Planned Outage	4/15/2025	170.00	3
PLF	Planned Outage	4/15/2025	2,289.82	19
Transformer	Planned Outage	4/15/2025	443.32	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Switch	Planned Outage	4/15/2025	52,459.48	269
Switch	Planned Outage	4/15/2025	722.07	4
Switch	Planned Outage	4/15/2025	4,671.33	28
Transformer	Planned Outage	4/15/2025	200.40	4
Transformer Bank	Planned Outage	4/15/2025	267.22	1
Transformer	Planned Outage	4/15/2025	1,433.10	9
Transformer	Planned Outage	4/15/2025	167.75	5
Transformer	Planned Outage	4/15/2025	1,139.92	5
Transformer	Planned Outage	4/15/2025	210.70	1
Transformer	Planned Outage	4/15/2025	138.67	4
Switch	Planned Outage	4/15/2025	25,683.60	612
Transformer	Planned Outage	4/15/2025	82.70	2
Transformer	Planned Outage	4/15/2025	101.53	2
None	Planned Outage	4/15/2025	1,062.95	21
Transformer	Planned Outage	4/15/2025	132.55	3
Transformer	Planned Outage	4/15/2025	94.33	5
Transformer	Planned Outage	4/15/2025	495.60	2
Transformer	Planned Outage	4/15/2025	244.50	9
Transformer Bank	Planned Outage	4/15/2025	68.57	1
None	Planned Outage	4/16/2025	692.47	13
PLF	Planned Outage	4/16/2025	162.97	1
Transformer	Planned Outage	4/16/2025	1,290.50	6
Transformer	Planned Outage	4/16/2025	99.20	12
Transformer	Planned Outage	4/16/2025	396.67	14
None	Planned Outage	4/16/2025	118.00	1
Transformer	Planned Outage	4/16/2025	1,455.17	10
Transformer	Planned Outage	4/16/2025	156.10	2
Transformer	Planned Outage	4/16/2025	484.85	1
Transformer	Planned Outage	4/16/2025	48.40	2
Transformer	Planned Outage	4/16/2025	34.05	9
Transformer	Planned Outage	4/16/2025	255.80	6
Transformer	Planned Outage	4/16/2025	64.73	2
Transformer	Planned Outage	4/16/2025	1,223.25	9
Transformer	Planned Outage	4/16/2025	1,326.53	8
PLF	Planned Outage	4/16/2025	58.85	1
PLF	Planned Outage	4/16/2025	2,173.75	37
Transformer Bank	Planned Outage	4/16/2025	654.85	3
Transformer	Planned Outage	4/16/2025	669.92	1
Transformer	Planned Outage	4/16/2025	51.90	2
Transformer	Planned Outage	4/16/2025	86.92	5
Transformer	Planned Outage	4/16/2025	155.63	2
Transformer	Planned Outage	4/16/2025	742.93	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	4/16/2025	208.03	2
None	Planned Outage	4/16/2025	1,753.00	4
Transformer	Planned Outage	4/16/2025	621.72	7
Transformer	Planned Outage	4/16/2025	36.77	1
Transformer	Planned Outage	4/16/2025	188.00	5
Transformer	Planned Outage	4/16/2025	142.23	2
Transformer	Planned Outage	4/16/2025	527.42	5
Transformer	Planned Outage	4/16/2025	89.73	4
Transformer	Planned Outage	4/16/2025	75.00	2
Transformer	Planned Outage	4/16/2025	28.00	1
Transformer	Planned Outage	4/16/2025	716.67	8
Transformer	Planned Outage	4/16/2025	77.43	2
Transformer	Planned Outage	4/16/2025	191.23	2
Transformer	Planned Outage	4/16/2025	318.17	5
Transformer Bank	Planned Outage	4/16/2025	329.55	1
Transformer	Planned Outage	4/16/2025	1,491.33	4
Transformer	Planned Outage	4/16/2025	363.33	4
Transformer	Planned Outage	4/17/2025	57.22	1
Primary Wire	Planned Outage	4/17/2025	1,869.93	14
Transformer	Planned Outage	4/17/2025	523.25	7
Transformer	Planned Outage	4/17/2025	958.42	7
Transformer Bank	Planned Outage	4/17/2025	2,188.70	6
Transformer	Planned Outage	4/17/2025	186.32	7
PLF	Planned Outage	4/17/2025	10,395.73	44
Primary Wire	Planned Outage	4/17/2025	236.93	2
Transformer	Planned Outage	4/17/2025	3,816.05	21
Transformer	Planned Outage	4/17/2025	63.73	4
PLF	Planned Outage	4/17/2025	1,545.75	15
Transformer	Planned Outage	4/17/2025	389.17	2
Transformer	Planned Outage	4/17/2025	896.00	10
Transformer	Planned Outage	4/17/2025	63.33	5
Transformer	Planned Outage	4/17/2025	70.05	3
Transformer	Planned Outage	4/17/2025	94.20	6
Transformer	Planned Outage	4/17/2025	534.08	5
None	Planned Outage	4/17/2025	894.25	7
Transformer	Planned Outage	4/17/2025	74.60	3
Transformer Bank	Planned Outage	4/17/2025	1,203.15	3
Transformer	Planned Outage	4/17/2025	156.98	1
Transformer	Planned Outage	4/17/2025	524.30	7
PLF	Planned Outage	4/17/2025	60.00	3
Transformer	Planned Outage	4/17/2025	165.43	7
Transformer	Planned Outage	4/17/2025	643.33	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	4/17/2025	813.80	3
Transformer	Planned Outage	4/17/2025	233.25	3
Transformer	Planned Outage	4/18/2025	26.13	1
Transformer	Planned Outage	4/18/2025	101.25	3
Transformer Bank	Planned Outage	4/18/2025	32.07	4
None	Planned Outage	4/18/2025	31,321.27	574
Transformer	Planned Outage	4/18/2025	99.33	10
PLF	Planned Outage	4/18/2025	587.40	66
Transformer Bank	Planned Outage	4/18/2025	1,100.37	22
PLF	Planned Outage	4/19/2025	579.20	24
PLF	Planned Outage	4/19/2025	34.80	8
PLF	Planned Outage	4/19/2025	209.33	16
PLF	Planned Outage	4/19/2025	26.83	2
PLF	Planned Outage	4/20/2025	3,808.67	40
PLF	Planned Outage	4/20/2025	1,885.33	20
PLF	Planned Outage	4/20/2025	10,070.00	106
PLF	Planned Outage	4/20/2025	3,808.67	40
PLF	Planned Outage	4/20/2025	1,845.33	20
Transformer Bank	Planned Outage	4/20/2025	3.40	2
Transformer	Planned Outage	4/20/2025	2,061.33	5
PLF	Planned Outage	4/20/2025	453.20	4
Transformer	Planned Outage	4/20/2025	226.23	2
PLF	Planned Outage	4/20/2025	934.65	31
Transformer	Planned Outage	4/21/2025	2,353.65	13
Transformer	Planned Outage	4/21/2025	165.25	5
Transformer	Planned Outage	4/21/2025	155.95	3
Transformer Bank	Planned Outage	4/21/2025	146.13	4
Transformer	Planned Outage	4/21/2025	49.28	1
Transformer	Planned Outage	4/21/2025	1,321.75	5
Transformer	Planned Outage	4/21/2025	824.95	3
Transformer	Planned Outage	4/21/2025	290.40	12
Transformer	Planned Outage	4/21/2025	253.05	9
Service point	Planned Outage	4/21/2025	16.03	1
Transformer	Planned Outage	4/21/2025	139.83	5
Service point	Planned Outage	4/21/2025	220.78	1
Transformer	Planned Outage	4/21/2025	501.75	5
Transformer	Planned Outage	4/21/2025	24.12	1
Transformer	Planned Outage	4/21/2025	95.87	4
Transformer	Planned Outage	4/21/2025	180.17	5
Service - Crew	Planned Outage	4/21/2025	161.80	1
Transformer	Planned Outage	4/21/2025	156.42	5
Transformer	Planned Outage	4/21/2025	108.47	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	4/21/2025	100.33	4
Transformer	Planned Outage	4/21/2025	110.47	4
None	Planned Outage	4/21/2025	77.40	6
Transformer	Planned Outage	4/21/2025	70.00	3
Transformer	Planned Outage	4/21/2025	260.87	13
Transformer	Planned Outage	4/21/2025	213.42	5
PLF	Planned Outage	4/21/2025	581.90	6
PLF	Planned Outage	4/21/2025	605.90	6
PLF	Planned Outage	4/21/2025	417.70	6
PLF	Planned Outage	4/21/2025	433.20	6
PLF	Planned Outage	4/21/2025	601.50	6
PLF	Planned Outage	4/21/2025	588.90	6
PLF	Planned Outage	4/21/2025	285.50	6
PLF	Planned Outage	4/21/2025	405.80	6
PLF	Planned Outage	4/21/2025	425.50	6
PLF	Planned Outage	4/21/2025	210.00	10
Transformer	Planned Outage	4/21/2025	1,121.25	5
PLF	Planned Outage	4/21/2025	43.62	1
Transformer	Planned Outage	4/21/2025	37.47	8
Transformer	Planned Outage	4/21/2025	669.20	6
None	Planned Outage	4/21/2025	609.10	6
None	Planned Outage	4/21/2025	26.25	5
Breaker	Planned Outage	4/21/2025	16,474.90	1311
Primary Wire	Planned Outage	4/21/2025	3,191.93	52
None	Planned Outage	4/21/2025	220.20	3
Transformer	Planned Outage	4/21/2025	616.35	3
Transformer	Planned Outage	4/21/2025	531.65	3
PLF	Planned Outage	4/22/2025	56.18	1
Switch	Planned Outage	4/22/2025	176.90	1
Transformer	Planned Outage	4/22/2025	213.53	4
Transformer	Planned Outage	4/22/2025	770.70	6
Transformer	Planned Outage	4/22/2025	48.55	1
Transformer	Planned Outage	4/22/2025	204.30	6
Transformer	Planned Outage	4/22/2025	363.97	1
None	Planned Outage	4/22/2025	114.75	1
Transformer	Planned Outage	4/22/2025	243.13	4
Transformer	Planned Outage	4/22/2025	252.90	6
Transformer	Planned Outage	4/22/2025	980.40	4
Switch	Planned Outage	4/22/2025	208.90	1
Transformer	Planned Outage	4/22/2025	407.30	3
Transformer	Planned Outage	4/22/2025	185.05	3
Transformer	Planned Outage	4/22/2025	196.70	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	4/22/2025	77.97	2
Transformer Bank	Planned Outage	4/22/2025	108.50	6
PLF	Planned Outage	4/22/2025	200.07	2
Transformer	Planned Outage	4/22/2025	327.80	6
Transformer	Planned Outage	4/22/2025	878.00	12
Transformer Bank	Planned Outage	4/22/2025	136.35	1
Transformer	Planned Outage	4/22/2025	452.65	11
Transformer	Planned Outage	4/22/2025	512.27	4
Transformer	Planned Outage	4/22/2025	48.27	8
Transformer	Planned Outage	4/22/2025	28.78	1
Transformer	Planned Outage	4/22/2025	594.00	8
Transformer	Planned Outage	4/22/2025	23.00	1
Transformer	Planned Outage	4/22/2025	78.13	2
PLF	Planned Outage	4/22/2025	141.65	1
PLF	Planned Outage	4/22/2025	141.65	1
PLF	Planned Outage	4/22/2025	316.43	1
PLF	Planned Outage	4/22/2025	141.65	1
PLF	Planned Outage	4/22/2025	8,283.00	60
OH Other	Planned Outage	4/22/2025	138.40	1
PLF	Planned Outage	4/22/2025	247.00	1
Transformer Bank	Planned Outage	4/22/2025	1,055.85	9
Transformer Bank	Planned Outage	4/23/2025	496.13	4
Transformer	Planned Outage	4/23/2025	303.77	1
Transformer	Planned Outage	4/23/2025	1,276.33	14
Transformer	Planned Outage	4/23/2025	36.45	1
Transformer	Planned Outage	4/23/2025	113.97	2
None	Planned Outage	4/23/2025	128.75	3
None	Planned Outage	4/23/2025	1,541.22	19
Transformer	Planned Outage	4/23/2025	130.27	4
Transformer Bank	Planned Outage	4/23/2025	62.43	2
Transformer	Planned Outage	4/23/2025	677.72	7
Transformer	Planned Outage	4/23/2025	327.00	6
Primary Wire	Planned Outage	4/23/2025	8,457.40	42
Transformer	Planned Outage	4/23/2025	237.60	9
Transformer Bank	Planned Outage	4/23/2025	111.47	4
Transformer	Planned Outage	4/23/2025	87.27	4
PLF	Planned Outage	4/23/2025	449.05	3
Transformer	Planned Outage	4/23/2025	52.05	9
Transformer	Planned Outage	4/23/2025	19.65	3
None	Planned Outage	4/23/2025	391.40	6
PLF	Planned Outage	4/23/2025	1,880.15	31
Transformer	Planned Outage	4/23/2025	262.42	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	4/23/2025	988.43	13
Transformer Bank	Planned Outage	4/24/2025	2,185.60	16
Transformer	Planned Outage	4/24/2025	196.65	3
Breaker	Planned Outage	4/24/2025	11,436.95	861
Transformer	Planned Outage	4/24/2025	27.58	1
Transformer	Planned Outage	4/24/2025	1,663.07	8
Transformer	Planned Outage	4/24/2025	136.67	5
Transformer	Planned Outage	4/24/2025	90.00	12
Transformer	Planned Outage	4/24/2025	79.75	5
Transformer Bank	Planned Outage	4/24/2025	37.20	1
Transformer	Planned Outage	4/24/2025	291.45	3
Transformer	Planned Outage	4/24/2025	1,512.08	5
Transformer Bank	Planned Outage	4/24/2025	202.95	1
Transformer Bank	Planned Outage	4/24/2025	215.93	4
Transformer	Planned Outage	4/24/2025	478.13	11
PLF	Planned Outage	4/24/2025	650.42	25
Transformer	Planned Outage	4/24/2025	600.53	4
Transformer Bank	Planned Outage	4/24/2025	92.15	1
Transformer	Planned Outage	4/24/2025	325.05	11
Transformer	Planned Outage	4/24/2025	67.30	2
Transformer	Planned Outage	4/24/2025	1,660.40	14
Transformer	Planned Outage	4/24/2025	33.60	1
Transformer	Planned Outage	4/24/2025	248.00	4
PLF	Planned Outage	4/24/2025	1,853.00	15
Transformer	Planned Outage	4/24/2025	67.40	1
Transformer	Planned Outage	4/24/2025	67.75	3
Transformer	Planned Outage	4/24/2025	32.97	1
PLF	Planned Outage	4/24/2025	327.20	8
Transformer	Planned Outage	4/25/2025	59.00	4
Transformer	Planned Outage	4/25/2025	1,906.50	6
Transformer	Planned Outage	4/25/2025	1,671.00	6
PLF	Planned Outage	4/25/2025	216.60	2
PLF	Planned Outage	4/25/2025	841.87	16
PLF	Planned Outage	4/25/2025	1,194.97	22
Service point	Planned Outage	4/25/2025	40.25	1
PLF	Planned Outage	4/25/2025	330.00	10
Transformer	Planned Outage	4/25/2025	149.87	16
Transformer	Planned Outage	4/25/2025	1,171.00	10
Transformer Bank	Planned Outage	4/25/2025	194.50	5
None	Planned Outage	4/25/2025	377.33	4
PLF	Planned Outage	4/25/2025	120.40	4
Transformer	Planned Outage	4/25/2025	266.33	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	4/26/2025	126.05	3
PLF	Planned Outage	4/26/2025	153.45	1
PLF	Planned Outage	4/26/2025	2,561.33	17
Transformer	Planned Outage	4/26/2025	110.95	1
Transformer	Planned Outage	4/26/2025	81.42	1
Breaker	Planned Outage	4/26/2025	7.20	1
Breaker	Planned Outage	4/26/2025	5,379.90	711
Breaker	Planned Outage	4/26/2025	7.95	1
Breaker	Planned Outage	4/26/2025	7.12	1
Transformer	Planned Outage	4/26/2025	63.00	15
PLF	Planned Outage	4/26/2025	115.15	3
PLF	Planned Outage	4/27/2025	7,068.25	147
PLF	Planned Outage	4/27/2025	48.08	1
PLF	Planned Outage	4/27/2025	47.98	1
Transformer	Planned Outage	4/27/2025	36.20	2
Transformer	Planned Outage	4/27/2025	176.65	3
PLF	Planned Outage	4/27/2025	13,339.33	34
PLF	Planned Outage	4/27/2025	391.95	1
PLF	Planned Outage	4/27/2025	94.63	1
TX Repaired (OH)	Planned Outage	4/27/2025	100.92	5
PLF	Planned Outage	4/27/2025	2,955.55	39
PLF	Planned Outage	4/27/2025	110.73	2
None	Planned Outage	4/28/2025	521.47	8
None	Planned Outage	4/28/2025	81.60	6
Transformer Bank	Planned Outage	4/28/2025	405.43	2
Transformer	Planned Outage	4/28/2025	1,272.40	8
Primary Wire	Planned Outage	4/28/2025	816.00	4
Transformer	Planned Outage	4/28/2025	370.18	1
Transformer	Planned Outage	4/28/2025	2,460.62	7
Transformer Bank	Planned Outage	4/28/2025	1,377.27	4
Primary Wire	Planned Outage	4/28/2025	1,161.30	9
Transformer	Planned Outage	4/28/2025	197.40	4
Transformer	Planned Outage	4/28/2025	51.70	2
Transformer	Planned Outage	4/28/2025	522.70	3
Transformer	Planned Outage	4/28/2025	152.65	3
None	Planned Outage	4/28/2025	867.10	6
Transformer	Planned Outage	4/28/2025	45.28	11
Transformer	Planned Outage	4/28/2025	129.95	3
Transformer	Planned Outage	4/28/2025	80.70	6
PLF	Planned Outage	4/28/2025	590.70	11
Switch	Planned Outage	4/28/2025	5,780.00	1275
PLF	Planned Outage	4/28/2025	6,408.27	112

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	4/29/2025	10.05	1
Transformer	Planned Outage	4/29/2025	23.42	1
Transformer	Planned Outage	4/29/2025	150.75	9
None	Planned Outage	4/29/2025	5,825.23	22
Transformer	Planned Outage	4/29/2025	1,502.05	11
Transformer	Planned Outage	4/29/2025	3,873.83	11
Transformer	Planned Outage	4/29/2025	236.93	4
Transformer	Planned Outage	4/29/2025	305.27	4
Transformer	Planned Outage	4/29/2025	55.90	2
PLF	Planned Outage	4/29/2025	350.95	1
Transformer	Planned Outage	4/29/2025	93.83	2
Transformer	Planned Outage	4/29/2025	64.07	2
PLF	Planned Outage	4/29/2025	1,874.25	9
Transformer	Planned Outage	4/29/2025	15.68	1
Transformer	Planned Outage	4/29/2025	182.00	8
Transformer	Planned Outage	4/29/2025	359.33	4
Transformer	Planned Outage	4/29/2025	166.48	7
Transformer	Planned Outage	4/29/2025	28.28	1
Transformer	Planned Outage	4/29/2025	45.85	1
PLF	Planned Outage	4/29/2025	847.50	6
Transformer	Planned Outage	4/29/2025	1,185.60	8
Transformer	Planned Outage	4/29/2025	2,384.53	16
Transformer	Planned Outage	4/29/2025	111.50	3
Transformer	Planned Outage	4/29/2025	114.05	3
None	Planned Outage	4/29/2025	20.58	5
Transformer	Planned Outage	4/29/2025	245.80	2
None	Planned Outage	4/29/2025	864.00	36
None	Planned Outage	4/29/2025	749.42	23
PLF	Planned Outage	4/29/2025	869.00	30
PLF	Planned Outage	4/29/2025	167.00	5
PLF	Planned Outage	4/29/2025	119.23	2
Transformer	Planned Outage	4/29/2025	29.28	1
Transformer Bank	Planned Outage	4/29/2025	178.90	2
Transformer	Planned Outage	4/29/2025	32.27	1
Transformer	Planned Outage	4/29/2025	962.93	16
Transformer	Planned Outage	4/29/2025	1,889.83	23
Transformer	Planned Outage	4/29/2025	44.00	6
Transformer Bank	Planned Outage	4/29/2025	69.50	3
Transformer	Planned Outage	4/29/2025	710.80	8
Transformer	Planned Outage	4/29/2025	3,677.20	12
Breaker	Planned Outage	4/29/2025	7,674.33	644
PLF	Planned Outage	4/29/2025	347.92	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	4/29/2025	252.62	1
Transformer	Planned Outage	4/30/2025	175.10	6
Switch	Planned Outage	4/30/2025	6,389.25	35
PLF	Planned Outage	4/30/2025	526.20	2
Transformer	Planned Outage	4/30/2025	622.40	6
Transformer	Planned Outage	4/30/2025	1,049.60	16
Transformer	Planned Outage	4/30/2025	176.87	2
Transformer	Planned Outage	4/30/2025	241.08	1
Transformer	Planned Outage	4/30/2025	335.03	1
Transformer	Planned Outage	4/30/2025	344.48	11
Transformer Bank	Planned Outage	4/30/2025	14.53	1
None	Planned Outage	4/30/2025	1,810.90	13
Transformer	Planned Outage	4/30/2025	2,765.33	16
Transformer	Planned Outage	4/30/2025	2,766.13	16
PLF	Planned Outage	4/30/2025	1,523.17	5
None	Planned Outage	4/30/2025	131.72	1
PLF	Planned Outage	4/30/2025	64.82	1
PLF	Planned Outage	4/30/2025	255.93	4
Transformer	Planned Outage	4/30/2025	143.25	5
Transformer	Planned Outage	4/30/2025	41.17	1
Transformer	Planned Outage	4/30/2025	261.80	3
Transformer	Planned Outage	4/30/2025	354.58	5
Transformer	Planned Outage	4/30/2025	1,828.63	17
PLF	Planned Outage	4/30/2025	28.20	1
Transformer Bank	Planned Outage	4/30/2025	67.48	1
Transformer	Planned Outage	4/30/2025	1,157.87	16
Transformer Bank	Planned Outage	4/30/2025	1,338.77	2
Breaker	Planned Outage	4/30/2025	5,426.57	619
Service point	Planned Outage	4/30/2025	21.05	1
Transformer	Planned Outage	4/30/2025	409.70	1
Transformer	Planned Outage	4/30/2025	179.87	8
Transformer	Planned Outage	5/1/2025	178.15	7
Transformer	Planned Outage	5/1/2025	166.27	8
Transformer	Planned Outage	5/1/2025	735.60	6
Transformer	Planned Outage	5/1/2025	15,203.10	22
PLF	Planned Outage	5/1/2025	102.33	1
PLF	Planned Outage	5/1/2025	8,638.42	23
Transformer	Planned Outage	5/1/2025	37.17	1
Transformer	Planned Outage	5/1/2025	175.93	2
Transformer	Planned Outage	5/1/2025	31.55	1
Transformer Bank	Planned Outage	5/1/2025	487.93	2
Transformer	Planned Outage	5/1/2025	999.67	10

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/1/2025	225.90	6
PLF	Planned Outage	5/1/2025	3,635.75	15
Transformer	Planned Outage	5/1/2025	3,100.00	8
Transformer	Planned Outage	5/1/2025	374.27	7
PLF	Planned Outage	5/1/2025	173.50	1
Transformer Bank	Planned Outage	5/1/2025	99.57	1
Transformer	Planned Outage	5/1/2025	35.33	1
None	Planned Outage	5/1/2025	489.25	95
None	Planned Outage	5/1/2025	2,123.25	15
Transformer	Planned Outage	5/1/2025	176.20	4
Transformer Bank	Planned Outage	5/1/2025	182.02	1
Transformer	Planned Outage	5/1/2025	87.30	1
None	Planned Outage	5/1/2025	4,804.17	50
Transformer Bank	Planned Outage	5/1/2025	428.10	9
Transformer	Planned Outage	5/2/2025	646.63	2
PLF	Planned Outage	5/2/2025	394.47	2
PLF	Planned Outage	5/2/2025	98.92	5
Transformer	Planned Outage	5/2/2025	960.00	6
Transformer	Planned Outage	5/2/2025	164.25	1
Transformer Bank	Planned Outage	5/2/2025	82.50	1
None	Planned Outage	5/2/2025	83.97	1
Transformer	Planned Outage	5/2/2025	105.15	3
PLF	Planned Outage	5/2/2025	2,599.50	15
Transformer	Planned Outage	5/2/2025	152.50	3
Transformer	Planned Outage	5/2/2025	178.07	2
None	Planned Outage	5/2/2025	380.68	7
Transformer Bank	Planned Outage	5/2/2025	572.58	5
Transformer Bank	Planned Outage	5/2/2025	20.53	7
Transformer Bank	Planned Outage	5/2/2025	85.62	1
Transformer Bank	Planned Outage	5/2/2025	8.05	3
PLF	Planned Outage	5/3/2025	1,011.50	10
PLF	Planned Outage	5/3/2025	285.45	1
None	Planned Outage	5/3/2025	879.60	12
Transformer	Planned Outage	5/3/2025	217.40	12
Breaker	Planned Outage	5/4/2025	11.30	1
Breaker	Planned Outage	5/4/2025	11.12	1
Breaker	Planned Outage	5/4/2025	10,529.80	969
Breaker	Planned Outage	5/4/2025	2,278.50	210
Breaker	Planned Outage	5/4/2025	132.60	12
Breaker	Planned Outage	5/4/2025	282.53	26
None	Planned Outage	5/4/2025	37.80	1
None	Planned Outage	5/4/2025	11,181.03	1018

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	5/4/2025	18,408.07	1676
Breaker	Planned Outage	5/4/2025	22,858.03	1141
Breaker	Planned Outage	5/4/2025	26,271.23	74
Breaker	Planned Outage	5/4/2025	20.08	1
Breaker	Planned Outage	5/4/2025	20.17	1
Breaker	Planned Outage	5/4/2025	164,024.92	457
None	Planned Outage	5/4/2025	9.73	1
None	Planned Outage	5/4/2025	7.82	1
None	Planned Outage	5/4/2025	3.87	1
None	Planned Outage	5/4/2025	750.57	253
Transformer	Planned Outage	5/4/2025	27.98	1
Breaker	Planned Outage	5/4/2025	128,043.78	457
Secondary Wire	Planned Outage	5/4/2025	1,446.58	5
Transformer	Planned Outage	5/5/2025	380.33	7
Service - Crew	Planned Outage	5/5/2025	577.00	5
Breaker	Planned Outage	5/5/2025	30,143.10	2301
None	Planned Outage	5/5/2025	1,348.95	23
PLF	Planned Outage	5/5/2025	2,685.43	34
PLF	Planned Outage	5/5/2025	78.98	1
PLF	Planned Outage	5/5/2025	78.98	1
PLF	Planned Outage	5/5/2025	78.98	1
PLF	Planned Outage	5/5/2025	78.98	1
Transformer	Planned Outage	5/5/2025	561.82	13
Transformer	Planned Outage	5/5/2025	917.00	6
Transformer	Planned Outage	5/5/2025	350.60	3
Transformer	Planned Outage	5/5/2025	272.10	9
Primary Wire	Planned Outage	5/5/2025	324.37	2
Transformer	Planned Outage	5/5/2025	537.00	6
PLF	Planned Outage	5/5/2025	5,392.97	62
Transformer	Planned Outage	5/5/2025	200.15	3
Transformer	Planned Outage	5/5/2025	175.12	1
PLF	Planned Outage	5/5/2025	10,787.85	27
Transformer	Planned Outage	5/5/2025	646.05	9
PLF	Planned Outage	5/5/2025	4,815.07	49
Transformer	Planned Outage	5/5/2025	1,704.50	10
PLF	Planned Outage	5/5/2025	2,982.65	29
Transformer	Planned Outage	5/5/2025	559.58	5
Transformer	Planned Outage	5/5/2025	449.98	7
Transformer	Planned Outage	5/5/2025	1,155.83	19
Transformer	Planned Outage	5/5/2025	839.77	14
Transformer	Planned Outage	5/5/2025	1,078.57	19
Transformer	Planned Outage	5/5/2025	666.67	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/5/2025	141.77	1
PLF	Planned Outage	5/5/2025	31,003.23	109
PLF	Planned Outage	5/5/2025	361.67	70
None	Planned Outage	5/5/2025	1,602.73	116
Primary Wire	Planned Outage	5/5/2025	31,210.33	218
Invalid	Planned Outage	5/5/2025	1,748.70	87
None	Planned Outage	5/5/2025	831.33	116
Transformer	Planned Outage	5/5/2025	2,074.60	11
Transformer Bank	Planned Outage	5/5/2025	2,009.00	6
PLF	Planned Outage	5/5/2025	3.00	3
Transformer	Planned Outage	5/5/2025	32.65	1
Breaker	Planned Outage	5/6/2025	24,289.28	361
Primary Wire	Planned Outage	5/6/2025	1,188.80	3
Primary Wire	Planned Outage	5/6/2025	396.37	1
Breaker	Planned Outage	5/6/2025	35,935.80	2372
Breaker	Planned Outage	5/6/2025	15.17	1
Breaker	Planned Outage	5/6/2025	15.17	1
Breaker	Planned Outage	5/6/2025	15.17	1
Transformer	Planned Outage	5/6/2025	722.20	12
Transformer Bank	Planned Outage	5/6/2025	380.60	6
Transformer	Planned Outage	5/6/2025	976.65	9
None	Planned Outage	5/6/2025	446.33	2
Transformer Bank	Planned Outage	5/6/2025	251.75	1
None	Planned Outage	5/6/2025	75.88	1
Primary Wire	Planned Outage	5/6/2025	348.78	1
Primary Wire	Planned Outage	5/6/2025	348.87	1
Primary Wire	Planned Outage	5/6/2025	348.87	1
Primary Wire	Planned Outage	5/6/2025	5,534.93	16
None	Planned Outage	5/6/2025	10,081.50	143
Transformer	Planned Outage	5/6/2025	131.07	8
Transformer	Planned Outage	5/6/2025	825.50	6
Transformer	Planned Outage	5/6/2025	78.30	1
None	Planned Outage	5/6/2025	9,947.00	60
None	Planned Outage	5/6/2025	2,669.25	45
Transformer	Planned Outage	5/6/2025	350.67	4
Transformer	Planned Outage	5/6/2025	12.63	2
Transformer Bank	Planned Outage	5/6/2025	30.33	4
PLF	Planned Outage	5/6/2025	104.80	2
Transformer	Planned Outage	5/6/2025	418.55	33
Transformer	Planned Outage	5/6/2025	227.73	8
Transformer	Planned Outage	5/6/2025	145.30	3
PLF	Planned Outage	5/6/2025	224.70	14

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/6/2025	35.60	1
PLF	Planned Outage	5/6/2025	905.07	4
Transformer	Planned Outage	5/6/2025	343.83	5
PLF	Planned Outage	5/7/2025	1,093.87	14
Transformer	Planned Outage	5/7/2025	570.70	2
Transformer	Planned Outage	5/7/2025	1,547.70	14
Transformer	Planned Outage	5/7/2025	92.20	4
Transformer	Planned Outage	5/7/2025	7,735.50	45
Primary Wire	Planned Outage	5/7/2025	351.23	2
PLF	Planned Outage	5/7/2025	446.53	4
PLF	Planned Outage	5/7/2025	550.53	4
PLF	Planned Outage	5/7/2025	552.17	5
PLF	Planned Outage	5/7/2025	1,546.30	14
PLF	Planned Outage	5/7/2025	351.37	1
Transformer	Planned Outage	5/7/2025	164.10	9
Transformer	Planned Outage	5/7/2025	1,039.20	8
Transformer	Planned Outage	5/7/2025	1,329.53	11
None	Planned Outage	5/7/2025	2,960.67	40
None	Planned Outage	5/7/2025	1,586.62	23
Transformer	Planned Outage	5/7/2025	2,513.07	19
PLF	Planned Outage	5/7/2025	25.57	1
Transformer	Planned Outage	5/7/2025	131.20	1
Transformer	Planned Outage	5/7/2025	770.40	9
Transformer	Planned Outage	5/7/2025	733.60	6
PLF	Planned Outage	5/7/2025	114.13	1
None	Planned Outage	5/7/2025	505.50	9
PLF	Planned Outage	5/7/2025	18.92	1
PLF	Planned Outage	5/7/2025	1,094.27	8
PLF	Planned Outage	5/7/2025	204.00	9
PLF	Planned Outage	5/7/2025	184.93	8
PLF	Planned Outage	5/7/2025	166.37	31
PLF	Planned Outage	5/7/2025	223.25	19
PLF	Planned Outage	5/7/2025	1,974.33	5
None	Planned Outage	5/7/2025	10,622.33	110
Transformer	Planned Outage	5/7/2025	170.00	10
Transformer	Planned Outage	5/8/2025	516.60	6
Transformer	Planned Outage	5/8/2025	2,001.10	6
Transformer	Planned Outage	5/8/2025	344.60	6
Transformer	Planned Outage	5/8/2025	44.20	6
PLF	Planned Outage	5/8/2025	3,878.93	32
Transformer	Planned Outage	5/8/2025	912.93	8
Primary Wire	Planned Outage	5/8/2025	68.80	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/8/2025	1,347.15	9
Transformer	Planned Outage	5/8/2025	882.40	6
Transformer	Planned Outage	5/8/2025	467.08	5
PLF	Planned Outage	5/8/2025	918.67	26
Transformer	Planned Outage	5/8/2025	832.80	6
Transformer	Planned Outage	5/8/2025	412.90	6
PLF	Planned Outage	5/8/2025	1,648.53	16
PLF	Planned Outage	5/8/2025	384.10	2
Transformer	Planned Outage	5/8/2025	568.17	7
Transformer	Planned Outage	5/8/2025	1,978.00	20
Transformer	Planned Outage	5/8/2025	467.68	11
OH Other	Planned Outage	5/8/2025	10,906.92	85
Transformer	Planned Outage	5/8/2025	157.30	13
Transformer	Planned Outage	5/8/2025	12.08	1
Transformer	Planned Outage	5/8/2025	922.15	3
None	Planned Outage	5/8/2025	11,148.80	1072
None	Planned Outage	5/8/2025	10.75	1
None	Planned Outage	5/8/2025	114.40	22
None	Planned Outage	5/8/2025	1,981.47	22
Transformer Bank	Planned Outage	5/8/2025	909.50	3
Transformer	Planned Outage	5/8/2025	15.25	1
Transformer	Planned Outage	5/8/2025	70.83	2
Transformer	Planned Outage	5/8/2025	2,168.50	10
PLF	Planned Outage	5/9/2025	184.07	11
Transformer	Planned Outage	5/9/2025	171.40	3
PLF	Planned Outage	5/9/2025	9,387.00	30
PLF	Planned Outage	5/9/2025	4,699.08	17
Transformer	Planned Outage	5/9/2025	786.90	9
PLF	Planned Outage	5/9/2025	299.15	1
PLF	Planned Outage	5/9/2025	1,160.27	4
PLF	Planned Outage	5/9/2025	1,451.70	9
Transformer	Planned Outage	5/9/2025	201.38	1
PLF	Planned Outage	5/9/2025	509.35	61
PLF	Planned Outage	5/9/2025	1,653.30	198
Transformer	Planned Outage	5/9/2025	2,123.70	9
Transformer	Planned Outage	5/9/2025	281.40	9
Transformer	Planned Outage	5/9/2025	3,693.03	23
PLF	Planned Outage	5/9/2025	175.50	9
Transformer	Planned Outage	5/9/2025	56.60	3
PLF	Planned Outage	5/9/2025	110.33	4
Invalid	Planned Outage	5/9/2025	4,627.98	23
None	Planned Outage	5/9/2025	5,204.85	63

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	5/9/2025	1,574.40	12
Transformer	Planned Outage	5/9/2025	101.67	4
Transformer	Planned Outage	5/9/2025	649.60	6
Transformer Bank	Planned Outage	5/10/2025	207.80	4
Breaker	Planned Outage	5/10/2025	23,800.40	1592
Breaker	Planned Outage	5/10/2025	15.17	1
Breaker	Planned Outage	5/10/2025	15.17	1
Breaker	Planned Outage	5/10/2025	7,790.00	779
None	Planned Outage	5/10/2025	484.25	13
None	Planned Outage	5/10/2025	12.78	1
Breaker	Planned Outage	5/10/2025	7,035.00	1005
Breaker	Planned Outage	5/10/2025	1,190.67	188
Switch	Planned Outage	5/10/2025	277.92	23
Switch	Planned Outage	5/10/2025	20,034.32	431
Switch	Planned Outage	5/10/2025	107.33	40
Switch	Planned Outage	5/10/2025	13,347.20	388
Switch	Planned Outage	5/10/2025	21,090.33	628
Breaker	Planned Outage	5/10/2025	520.87	52
Transformer	Planned Outage	5/11/2025	32.67	4
Transformer Bank	Planned Outage	5/11/2025	32.00	5
Transformer	Planned Outage	5/11/2025	1,382.42	5
None	Planned Outage	5/11/2025	1,397.40	12
Switch	Planned Outage	5/11/2025	862.50	18
Switch	Planned Outage	5/11/2025	526.83	5
Switch	Planned Outage	5/11/2025	6,345.70	89
Breaker	Planned Outage	5/12/2025	14,897.57	806
Breaker	Planned Outage	5/12/2025	225.00	18
Breaker	Planned Outage	5/12/2025	1,675.00	134
Breaker	Planned Outage	5/12/2025	87.35	1
Breaker	Planned Outage	5/12/2025	46,322.77	529
Breaker	Planned Outage	5/12/2025	87.08	1
Breaker	Planned Outage	5/12/2025	14.95	1
Breaker	Planned Outage	5/12/2025	15.08	1
Breaker	Planned Outage	5/12/2025	15.02	1
Breaker	Planned Outage	5/12/2025	17,278.75	1803
Breaker	Planned Outage	5/12/2025	14.88	1
Transformer	Planned Outage	5/12/2025	2,711.78	17
Breaker	Planned Outage	5/12/2025	23,379.20	2248
Transformer	Planned Outage	5/12/2025	156.58	5
Transformer	Planned Outage	5/12/2025	96.17	2
PLF	Planned Outage	5/12/2025	455.17	5
PLF	Planned Outage	5/12/2025	1,260.75	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/12/2025	62.40	2
Transformer	Planned Outage	5/12/2025	155.05	3
Primary Wire	Planned Outage	5/12/2025	729.17	25
Primary Wire	Planned Outage	5/12/2025	8,701.77	26
Transformer Bank	Planned Outage	5/13/2025	115.22	1
Transformer Bank	Planned Outage	5/13/2025	46.63	1
Transformer Bank	Planned Outage	5/13/2025	7.83	1
Transformer Bank	Planned Outage	5/13/2025	32.17	1
Transformer Bank	Planned Outage	5/13/2025	7.83	1
Transformer Bank	Planned Outage	5/13/2025	46.52	1
Transformer Bank	Planned Outage	5/13/2025	31.27	4
Transformer Bank	Planned Outage	5/13/2025	136.40	4
Transformer Bank	Planned Outage	5/13/2025	46.53	1
Transformer Bank	Planned Outage	5/13/2025	46.50	1
Transformer Bank	Planned Outage	5/13/2025	46.57	1
Transformer Bank	Planned Outage	5/13/2025	46.58	1
Transformer Bank	Planned Outage	5/13/2025	7.80	1
Transformer Bank	Planned Outage	5/13/2025	46.53	1
Transformer Bank	Planned Outage	5/13/2025	46.63	1
Transformer Bank	Planned Outage	5/13/2025	372.13	8
Transformer Bank	Planned Outage	5/13/2025	44.47	1
Transformer Bank	Planned Outage	5/13/2025	44.33	1
Transformer Bank	Planned Outage	5/13/2025	44.38	1
Transformer Bank	Planned Outage	5/13/2025	44.27	1
Transformer Bank	Planned Outage	5/13/2025	44.27	1
Transformer Bank	Planned Outage	5/13/2025	44.40	1
Transformer Bank	Planned Outage	5/13/2025	44.32	1
Transformer Bank	Planned Outage	5/13/2025	44.25	1
Transformer Bank	Planned Outage	5/13/2025	44.23	1
Transformer Bank	Planned Outage	5/13/2025	25.82	1
Transformer Bank	Planned Outage	5/13/2025	32.93	1
Transformer Bank	Planned Outage	5/13/2025	20.65	7
Breaker	Planned Outage	5/13/2025	6.53	1
Breaker	Planned Outage	5/13/2025	6.60	1
Breaker	Planned Outage	5/13/2025	6.60	1
Breaker	Planned Outage	5/13/2025	10,153.08	1669
Breaker	Planned Outage	5/13/2025	5.60	1
PLF	Planned Outage	5/13/2025	1,251.07	4
PLF	Planned Outage	5/13/2025	1,869.00	10
PLF	Planned Outage	5/13/2025	2,346.33	20
Transformer Bank	Planned Outage	5/13/2025	384.73	1
Transformer	Planned Outage	5/13/2025	790.80	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/13/2025	126.25	1
None	Planned Outage	5/13/2025	2,775.30	22
PLF	Planned Outage	5/13/2025	289.87	1
Transformer	Planned Outage	5/13/2025	1,616.00	8
Transformer	Planned Outage	5/13/2025	3,071.73	8
Transformer	Planned Outage	5/13/2025	1,102.73	4
Transformer	Planned Outage	5/13/2025	16.97	1
Transformer	Planned Outage	5/13/2025	274.25	3
Transformer	Planned Outage	5/13/2025	31.50	5
Transformer	Planned Outage	5/13/2025	6.30	1
Transformer	Planned Outage	5/13/2025	50.20	1
Transformer	Planned Outage	5/13/2025	282.75	15
Transformer	Planned Outage	5/13/2025	51.20	1
Transformer	Planned Outage	5/13/2025	49.82	1
Transformer	Planned Outage	5/13/2025	375.45	3
Transformer	Planned Outage	5/13/2025	998.53	8
Transformer	Planned Outage	5/13/2025	624.42	5
Transformer	Planned Outage	5/13/2025	1,237.83	10
Transformer	Planned Outage	5/13/2025	195.30	9
Transformer	Planned Outage	5/13/2025	49.67	5
PLF	Planned Outage	5/13/2025	606.00	3
Transformer	Planned Outage	5/13/2025	692.73	4
Transformer Bank	Planned Outage	5/13/2025	310.32	1
Transformer	Planned Outage	5/13/2025	94.13	4
Transformer	Planned Outage	5/13/2025	707.10	6
None	Planned Outage	5/13/2025	1,653.68	313
Transformer	Planned Outage	5/13/2025	88.10	6
Transformer	Planned Outage	5/13/2025	251.20	8
Service point	Planned Outage	5/13/2025	160.38	1
Transformer Bank	Planned Outage	5/13/2025	318.25	15
Transformer Bank	Planned Outage	5/14/2025	93.13	2
PLF	Planned Outage	5/14/2025	83.83	1
None	Planned Outage	5/14/2025	3,603.95	49
Transformer	Planned Outage	5/14/2025	877.80	19
PLF	Planned Outage	5/14/2025	2,529.90	81
Transformer	Planned Outage	5/14/2025	612.40	2
Transformer	Planned Outage	5/14/2025	1,025.20	12
Transformer	Planned Outage	5/14/2025	259.48	1
Transformer	Planned Outage	5/14/2025	70.22	11
Transformer	Planned Outage	5/14/2025	536.90	6
Transformer	Planned Outage	5/14/2025	499.52	17
Transformer	Planned Outage	5/14/2025	637.65	27

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/14/2025	1,568.60	12
PLF	Planned Outage	5/14/2025	2,572.73	14
Transformer	Planned Outage	5/14/2025	1,393.33	11
Transformer	Planned Outage	5/14/2025	1,394.43	11
PLF	Planned Outage	5/14/2025	225.07	2
PLF	Planned Outage	5/14/2025	161.37	1
Transformer	Planned Outage	5/14/2025	720.27	8
PLF	Planned Outage	5/14/2025	1,528.93	2
None	Planned Outage	5/14/2025	10,388.50	237
PLF	Planned Outage	5/14/2025	3.05	1
PLF	Planned Outage	5/14/2025	26.73	1
Transformer	Planned Outage	5/14/2025	13.47	4
None	Planned Outage	5/14/2025	1,730.40	24
Transformer	Planned Outage	5/14/2025	55.25	5
PLF	Planned Outage	5/14/2025	3,172.95	99
Transformer	Planned Outage	5/14/2025	15.20	1
Transformer	Planned Outage	5/14/2025	18.87	1
Transformer	Planned Outage	5/14/2025	31.13	2
PLF	Planned Outage	5/14/2025	169.93	1
Transformer	Planned Outage	5/15/2025	191.07	8
Transformer	Planned Outage	5/15/2025	228.83	1
PLF	Planned Outage	5/15/2025	136.80	48
PLF	Planned Outage	5/15/2025	5,070.22	13
Transformer	Planned Outage	5/15/2025	2,458.60	19
Transformer	Planned Outage	5/15/2025	639.67	2
None	Planned Outage	5/15/2025	4,396.33	22
Service point	Planned Outage	5/15/2025	59.10	1
Transformer	Planned Outage	5/15/2025	1,250.67	8
Transformer	Planned Outage	5/15/2025	372.07	1
None	Planned Outage	5/15/2025	720.70	6
PLF	Planned Outage	5/15/2025	10,738.00	84
None	Planned Outage	5/15/2025	1,211.65	11
Transformer	Planned Outage	5/15/2025	714.00	6
PLF	Planned Outage	5/15/2025	4,127.50	75
Transformer	Planned Outage	5/15/2025	899.00	20
Transformer	Planned Outage	5/15/2025	359.68	7
None	Planned Outage	5/15/2025	925.73	8
Transformer	Planned Outage	5/15/2025	109.80	6
Transformer	Planned Outage	5/15/2025	365.33	8
Transformer Bank	Planned Outage	5/15/2025	90.22	1
Transformer Bank	Planned Outage	5/15/2025	84.13	2
TX Repaired (PM)	Planned Outage	5/15/2025	5,901.07	16

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	5/15/2025	22.73	1
Transformer Bank	Planned Outage	5/15/2025	240.47	2
None	Planned Outage	5/15/2025	28,940.80	1064
Transformer	Planned Outage	5/16/2025	1,061.33	8
Transformer	Planned Outage	5/16/2025	397.70	6
Transformer Bank	Planned Outage	5/16/2025	500.80	2
Transformer	Planned Outage	5/16/2025	321.60	2
Transformer	Planned Outage	5/16/2025	991.87	4
Transformer	Planned Outage	5/16/2025	160.30	1
Transformer	Planned Outage	5/16/2025	254.67	1
Transformer	Planned Outage	5/16/2025	271.20	9
Transformer	Planned Outage	5/16/2025	214.60	4
PLF	Planned Outage	5/16/2025	185.67	4
PLF	Planned Outage	5/16/2025	35.93	7
Transformer	Planned Outage	5/16/2025	272.13	4
Transformer	Planned Outage	5/16/2025	54.70	2
Transformer	Planned Outage	5/16/2025	70.93	2
Transformer	Planned Outage	5/16/2025	1,792.27	8
Primary Wire	Planned Outage	5/16/2025	2,742.00	12
Transformer	Planned Outage	5/16/2025	896.33	4
PLF	Planned Outage	5/16/2025	486.83	2
Transformer	Planned Outage	5/16/2025	50.20	4
None	Planned Outage	5/16/2025	25,571.90	678
Transformer	Planned Outage	5/16/2025	153.53	7
Transformer Bank	Planned Outage	5/16/2025	63.77	1
Transformer	Planned Outage	5/17/2025	179.00	10
Breaker	Planned Outage	5/17/2025	5,973.92	539
Transformer	Planned Outage	5/17/2025	506.55	9
Breaker	Planned Outage	5/17/2025	11.23	1
Breaker	Planned Outage	5/17/2025	11.23	1
Breaker	Planned Outage	5/17/2025	11.23	1
Breaker	Planned Outage	5/17/2025	18,681.03	1663
Breaker	Planned Outage	5/17/2025	11.23	1
Breaker	Planned Outage	5/17/2025	2,644.80	551
PLF	Planned Outage	5/17/2025	156.30	6
Transformer	Planned Outage	5/17/2025	274.80	4
Transformer	Planned Outage	5/17/2025	124.00	2
Transformer	Planned Outage	5/17/2025	329.10	6
PLF	Planned Outage	5/17/2025	382.73	1
Primary Wire	Planned Outage	5/17/2025	3,044.85	9
Breaker	Planned Outage	5/17/2025	5.27	1
Breaker	Planned Outage	5/17/2025	4.40	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	5/17/2025	4.90	1
Breaker	Planned Outage	5/17/2025	5.03	1
Breaker	Planned Outage	5/17/2025	4.53	1
Breaker	Planned Outage	5/17/2025	4.67	1
Breaker	Planned Outage	5/17/2025	7,431.27	1411
Breaker	Planned Outage	5/17/2025	5.03	1
Breaker	Planned Outage	5/17/2025	5.17	1
Breaker	Planned Outage	5/17/2025	5.12	1
Breaker	Planned Outage	5/17/2025	5.18	1
Breaker	Planned Outage	5/17/2025	5.25	1
Breaker	Planned Outage	5/17/2025	5.32	1
Breaker	Planned Outage	5/17/2025	4.38	1
Breaker	Planned Outage	5/17/2025	5.33	1
Breaker	Planned Outage	5/17/2025	4.47	1
Breaker	Planned Outage	5/17/2025	4.83	1
Breaker	Planned Outage	5/17/2025	4.97	1
Breaker	Planned Outage	5/17/2025	4.45	1
Breaker	Planned Outage	5/17/2025	4.60	1
Breaker	Planned Outage	5/17/2025	4.53	1
Breaker	Planned Outage	5/17/2025	4.63	1
Breaker	Planned Outage	5/17/2025	4.70	1
Breaker	Planned Outage	5/17/2025	4.77	1
Breaker	Planned Outage	5/17/2025	4.73	1
Breaker	Planned Outage	5/17/2025	5.33	1
Transformer	Planned Outage	5/17/2025	179.67	7
Transformer	Planned Outage	5/18/2025	2,396.20	12
Transformer	Planned Outage	5/18/2025	1,795.50	9
Transformer	Planned Outage	5/18/2025	99.70	2
PLF	Planned Outage	5/18/2025	51.08	1
Transformer	Planned Outage	5/18/2025	124.90	3
Transformer	Planned Outage	5/18/2025	221.00	5
PLF	Planned Outage	5/18/2025	156.15	1
None	Planned Outage	5/18/2025	40.37	2
Transformer	Planned Outage	5/19/2025	572.28	1
None	Planned Outage	5/19/2025	6,939.75	19
Transformer	Planned Outage	5/19/2025	606.53	8
Transformer	Planned Outage	5/19/2025	926.47	2
Transformer	Planned Outage	5/19/2025	1,843.80	4
Primary Wire	Planned Outage	5/19/2025	967.53	4
PLF	Planned Outage	5/19/2025	137.68	1
Transformer	Planned Outage	5/19/2025	1,037.70	9
Transformer	Planned Outage	5/19/2025	460.13	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/19/2025	1,215.50	15
PLF	Planned Outage	5/19/2025	264.77	1
PLF	Planned Outage	5/19/2025	62.37	2
Transformer	Planned Outage	5/19/2025	46.13	1
PLF	Planned Outage	5/19/2025	51.37	2
Transformer	Planned Outage	5/19/2025	136.80	8
Transformer	Planned Outage	5/19/2025	19.10	2
Transformer	Planned Outage	5/19/2025	144.20	7
Transformer	Planned Outage	5/20/2025	291.90	9
PLF	Planned Outage	5/20/2025	440.03	1
PLF	Planned Outage	5/20/2025	3,406.30	23
Primary Wire	Planned Outage	5/20/2025	1,835.80	4
Transformer	Planned Outage	5/20/2025	512.65	3
Transformer	Planned Outage	5/20/2025	842.92	35
Transformer	Planned Outage	5/20/2025	2,921.73	34
Transformer	Planned Outage	5/20/2025	175.93	4
PLF	Planned Outage	5/20/2025	18.95	1
None	Planned Outage	5/20/2025	257.53	4
None	Planned Outage	5/20/2025	1,732.30	34
Transformer	Planned Outage	5/20/2025	762.45	9
PLF	Planned Outage	5/20/2025	668.20	2
Transformer	Planned Outage	5/20/2025	1,669.40	4
Transformer	Planned Outage	5/20/2025	1,080.47	19
Transformer	Planned Outage	5/20/2025	277.67	4
PLF	Planned Outage	5/20/2025	3,190.40	24
PLF	Planned Outage	5/20/2025	431.95	3
PLF	Planned Outage	5/20/2025	420.25	1
None	Planned Outage	5/20/2025	1,132.53	8
None	Planned Outage	5/20/2025	1,595.73	22
Transformer	Planned Outage	5/20/2025	54.00	10
Transformer	Planned Outage	5/20/2025	212.98	1
PLF	Planned Outage	5/20/2025	11.35	1
PLF	Planned Outage	5/20/2025	50.67	10
PLF	Planned Outage	5/20/2025	1.18	1
Transformer	Planned Outage	5/20/2025	299.37	1
Transformer	Planned Outage	5/20/2025	534.27	2
Transformer Bank	Planned Outage	5/20/2025	35.83	1
PLF	Planned Outage	5/20/2025	3,777.80	39
Transformer	Planned Outage	5/20/2025	83.80	3
Transformer	Planned Outage	5/21/2025	279.40	12
Breaker	Planned Outage	5/21/2025	22,146.33	1580
Transformer Bank	Planned Outage	5/21/2025	1,190.83	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/21/2025	68.48	1
Transformer	Planned Outage	5/21/2025	421.60	4
Transformer Bank	Planned Outage	5/21/2025	70.28	1
None	Planned Outage	5/21/2025	108.80	4
Transformer	Planned Outage	5/21/2025	4,695.97	34
Transformer Bank	Planned Outage	5/21/2025	353.90	1
PLF	Planned Outage	5/21/2025	78.43	2
Transformer	Planned Outage	5/21/2025	640.02	11
Transformer	Planned Outage	5/21/2025	1,413.83	10
Transformer	Planned Outage	5/21/2025	2,242.07	26
Transformer	Planned Outage	5/21/2025	169.95	3
PLF	Planned Outage	5/21/2025	83.13	4
PLF	Planned Outage	5/21/2025	76.95	19
Transformer	Planned Outage	5/21/2025	89.83	1
Transformer Bank	Planned Outage	5/21/2025	101.13	1
Transformer	Planned Outage	5/21/2025	142.93	4
Transformer	Planned Outage	5/21/2025	160.33	5
None	Planned Outage	5/21/2025	476.83	2
Switch	Planned Outage	5/22/2025	343.70	21
Switch	Planned Outage	5/22/2025	5,226.28	319
Breaker	Planned Outage	5/22/2025	1,195.98	73
Breaker	Planned Outage	5/22/2025	27,261.87	1664
Breaker	Planned Outage	5/22/2025	16.32	1
Breaker	Planned Outage	5/22/2025	16.77	1
Transformer Bank	Planned Outage	5/22/2025	17.58	1
Transformer	Planned Outage	5/22/2025	620.27	4
Transformer Bank	Planned Outage	5/22/2025	209.77	7
Transformer	Planned Outage	5/22/2025	1,722.33	5
Transformer	Planned Outage	5/22/2025	422.00	1
None	Planned Outage	5/22/2025	610.23	2
Transformer	Planned Outage	5/22/2025	1,268.25	5
Transformer	Planned Outage	5/22/2025	2,280.95	7
Transformer	Planned Outage	5/22/2025	325.17	1
Transformer Bank	Planned Outage	5/22/2025	78.75	5
Primary Wire	Planned Outage	5/22/2025	2,961.02	11
Transformer	Planned Outage	5/22/2025	1,241.60	12
Transformer	Planned Outage	5/22/2025	284.07	4
Transformer	Planned Outage	5/22/2025	236.25	3
Transformer	Planned Outage	5/23/2025	72.73	2
Transformer	Planned Outage	5/23/2025	220.63	1
Transformer Bank	Planned Outage	5/23/2025	375.67	2
Transformer	Planned Outage	5/23/2025	1,267.13	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/23/2025	679.90	6
Transformer	Planned Outage	5/23/2025	128.88	1
Transformer	Planned Outage	5/23/2025	146.75	1
None	Planned Outage	5/23/2025	834.40	7
PLF	Planned Outage	5/23/2025	36.20	1
Transformer	Planned Outage	5/23/2025	112.80	4
Transformer	Planned Outage	5/23/2025	2,965.58	19
Transformer Bank	Planned Outage	5/23/2025	120.37	2
Transformer Bank	Planned Outage	5/23/2025	478.07	4
Transformer Bank	Planned Outage	5/23/2025	282.33	7
Transformer	Planned Outage	5/24/2025	216.75	15
Transformer	Planned Outage	5/24/2025	906.00	18
Transformer	Planned Outage	5/24/2025	1,273.10	6
Transformer	Planned Outage	5/24/2025	25.58	1
Transformer	Planned Outage	5/24/2025	361.67	10
Breaker	Planned Outage	5/24/2025	68.95	1
Breaker	Planned Outage	5/24/2025	49,506.10	718
Breaker	Planned Outage	5/24/2025	69.00	1
Breaker	Planned Outage	5/24/2025	68.95	1
Breaker	Planned Outage	5/24/2025	68.95	1
Breaker	Planned Outage	5/24/2025	68.95	1
Transformer	Planned Outage	5/24/2025	3,870.53	8
Transformer	Planned Outage	5/24/2025	5,782.00	12
Transformer	Planned Outage	5/24/2025	521.53	4
PLF	Planned Outage	5/24/2025	4,320.63	7
PLF	Planned Outage	5/25/2025	580.00	10
PLF	Planned Outage	5/25/2025	3,247.07	98
Transformer	Planned Outage	5/25/2025	147.75	3
Transformer	Planned Outage	5/25/2025	246.40	3
Transformer	Planned Outage	5/25/2025	39.33	8
PLF	Planned Outage	5/25/2025	14,786.98	43
PLF	Planned Outage	5/25/2025	1,237.67	4
Breaker	Planned Outage	5/25/2025	13,775.47	1123
Breaker	Planned Outage	5/25/2025	12.30	1
Breaker	Planned Outage	5/25/2025	12.47	1
Breaker	Planned Outage	5/25/2025	12.47	1
Breaker	Planned Outage	5/25/2025	3,958.90	118
Breaker	Planned Outage	5/25/2025	3,958.90	118
Breaker	Planned Outage	5/25/2025	2,976.70	289
Breaker	Planned Outage	5/25/2025	6.02	1
Breaker	Planned Outage	5/25/2025	6.02	1
Breaker	Planned Outage	5/25/2025	6.02	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	5/25/2025	12,501.92	2113
Breaker	Planned Outage	5/25/2025	6.02	1
Breaker	Planned Outage	5/25/2025	6.02	1
Breaker	Planned Outage	5/25/2025	6.02	1
Breaker	Planned Outage	5/25/2025	6.02	1
None	Planned Outage	5/26/2025	473.85	1
Transformer	Planned Outage	5/26/2025	668.85	7
Breaker	Planned Outage	5/26/2025	13,545.87	1264
Transformer	Planned Outage	5/26/2025	236.32	11
PLF	Planned Outage	5/27/2025	637.27	44
Breaker	Planned Outage	5/27/2025	2,127.57	1538
PLF	Planned Outage	5/27/2025	227.82	1
Transformer	Planned Outage	5/27/2025	1,351.00	21
Transformer Bank	Planned Outage	5/27/2025	603.57	2
PLF	Planned Outage	5/27/2025	67.45	1
PLF	Planned Outage	5/27/2025	1,781.70	9
PLF	Planned Outage	5/27/2025	345.50	5
PLF	Planned Outage	5/27/2025	6,225.07	16
Transformer	Planned Outage	5/27/2025	1,658.80	8
Transformer	Planned Outage	5/27/2025	631.85	3
Transformer	Planned Outage	5/27/2025	973.23	7
Transformer	Planned Outage	5/27/2025	117.45	3
Transformer	Planned Outage	5/27/2025	2,548.95	9
None	Planned Outage	5/27/2025	7.33	1
Transformer	Planned Outage	5/27/2025	1,906.40	12
None	Planned Outage	5/27/2025	1,497.87	8
None	Planned Outage	5/27/2025	2,480.87	17
Transformer	Planned Outage	5/27/2025	104.85	27
Transformer	Planned Outage	5/27/2025	432.83	5
Transformer	Planned Outage	5/27/2025	48.22	1
Transformer	Planned Outage	5/27/2025	339.15	21
Transformer	Planned Outage	5/27/2025	207.00	6
Transformer	Planned Outage	5/27/2025	1,411.00	12
Transformer Bank	Planned Outage	5/27/2025	337.20	6
Transformer	Planned Outage	5/27/2025	1,760.80	6
PLF	Planned Outage	5/27/2025	485.13	19
PLF	Planned Outage	5/28/2025	223.70	3
PLF	Planned Outage	5/28/2025	175.33	2
Transformer Bank	Planned Outage	5/28/2025	171.10	6
None	Planned Outage	5/28/2025	1,709.73	8
None	Planned Outage	5/28/2025	770.12	7
Transformer	Planned Outage	5/28/2025	732.13	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Primary Wire	Planned Outage	5/28/2025	1,144.50	18
Transformer	Planned Outage	5/28/2025	1,392.80	8
Transformer	Planned Outage	5/28/2025	978.30	6
None	Planned Outage	5/28/2025	395.80	6
Transformer	Planned Outage	5/28/2025	100.83	5
Transformer	Planned Outage	5/28/2025	110.23	2
None	Planned Outage	5/28/2025	1,328.83	7
Transformer Bank	Planned Outage	5/28/2025	269.18	1
Transformer Bank	Planned Outage	5/28/2025	903.30	6
Transformer	Planned Outage	5/28/2025	71.93	2
Transformer	Planned Outage	5/28/2025	49.77	1
Service point	Planned Outage	5/28/2025	42.30	1
Transformer	Planned Outage	5/29/2025	253.65	9
Transformer	Planned Outage	5/29/2025	171.93	1
PLF	Planned Outage	5/29/2025	2,391.40	22
Transformer	Planned Outage	5/29/2025	954.68	7
Transformer	Planned Outage	5/29/2025	1,281.20	6
None	Planned Outage	5/29/2025	969.50	5
Switch	Planned Outage	5/29/2025	1,794.50	15
PLF	Planned Outage	5/29/2025	1,939.30	11
Transformer	Planned Outage	5/29/2025	812.70	18
Transformer	Planned Outage	5/29/2025	430.00	3
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	11,151.47	1648
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Breaker	Planned Outage	5/29/2025	6.77	1
Transformer	Planned Outage	5/29/2025	304.93	2
Transformer	Planned Outage	5/29/2025	63.75	9
Transformer Bank	Planned Outage	5/29/2025	70.15	1
Transformer	Planned Outage	5/29/2025	1,545.07	8
Transformer	Planned Outage	5/29/2025	797.30	6
Transformer Bank	Planned Outage	5/29/2025	742.30	6
Transformer Bank	Planned Outage	5/29/2025	204.33	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	5/29/2025	83.83	5
None	Planned Outage	5/29/2025	578.80	4
Transformer	Planned Outage	5/29/2025	1,253.93	7
Transformer	Planned Outage	5/29/2025	1,894.80	6
Invalid	Planned Outage	5/29/2025	142.85	3
Breaker	Planned Outage	5/29/2025	39.83	5
Breaker	Planned Outage	5/29/2025	667.40	94
PLF	Planned Outage	5/29/2025	142.33	1
None	Planned Outage	5/29/2025	141.72	1
PLF	Planned Outage	5/30/2025	238.52	1
Transformer Bank	Planned Outage	5/30/2025	975.33	8
Transformer	Planned Outage	5/30/2025	119.42	5
Transformer	Planned Outage	5/30/2025	360.38	7
Transformer	Planned Outage	5/30/2025	526.75	21
Transformer	Planned Outage	5/30/2025	457.50	3
Transformer	Planned Outage	5/30/2025	147.60	9
Transformer	Planned Outage	5/30/2025	282.57	7
Transformer	Planned Outage	5/30/2025	462.30	3
Transformer	Planned Outage	5/30/2025	80.30	6
OH Other	Planned Outage	5/30/2025	53,767.27	934
Transformer	Planned Outage	5/30/2025	216.70	1
OH Other	Planned Outage	5/30/2025	9.57	1
OH Other	Planned Outage	5/30/2025	233.33	56
Breaker	Planned Outage	5/30/2025	10.93	1
Breaker	Planned Outage	5/30/2025	10,017.20	951
Breaker	Planned Outage	5/30/2025	10.93	1
Transformer	Planned Outage	5/30/2025	1,015.95	9
Transformer	Planned Outage	5/30/2025	286.20	6
Transformer	Planned Outage	5/30/2025	539.70	6
PLF	Planned Outage	5/30/2025	1,462.00	40
PLF	Planned Outage	5/30/2025	379.12	1
Breaker	Planned Outage	5/30/2025	10.38	1
Breaker	Planned Outage	5/30/2025	7,343.90	713
Transformer	Planned Outage	5/31/2025	370.38	1
Breaker	Planned Outage	5/31/2025	18.50	1
Breaker	Planned Outage	5/31/2025	18.50	1
Breaker	Planned Outage	5/31/2025	23,937.65	1839
Breaker	Planned Outage	5/31/2025	18.50	1
Breaker	Planned Outage	5/31/2025	18.50	1
Transformer	Planned Outage	5/31/2025	87.15	3
Breaker	Planned Outage	5/31/2025	25,255.40	591
Breaker	Planned Outage	5/31/2025	27,680.82	647

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	5/31/2025	14.38	1
Breaker	Planned Outage	5/31/2025	35,378.50	2454
Breaker	Planned Outage	5/31/2025	14.52	1
Breaker	Planned Outage	5/31/2025	14.50	1
PLF	Planned Outage	5/31/2025	321.33	1
PLF	Planned Outage	5/31/2025	624.80	4
PLF	Planned Outage	5/31/2025	327.37	2
PLF	Planned Outage	5/31/2025	321.57	2
Secondary Wire	Planned Outage	5/31/2025	1,340.40	6
Switch	Planned Outage	5/31/2025	426.50	15
PLF	Planned Outage	6/1/2025	59.65	1
Breaker	Planned Outage	6/1/2025	17,415.00	1161
Transformer Bank	Planned Outage	6/1/2025	872.00	3
Primary Wire	Planned Outage	6/1/2025	5,097.93	47
Transformer	Planned Outage	6/1/2025	3,319.20	12
Transformer	Planned Outage	6/1/2025	188.25	15
Transformer	Planned Outage	6/2/2025	451.90	6
Transformer	Planned Outage	6/2/2025	1,820.20	2
Transformer	Planned Outage	6/2/2025	1,746.45	9
Transformer	Planned Outage	6/2/2025	17.73	7
Transformer	Planned Outage	6/2/2025	886.75	1
Transformer	Planned Outage	6/2/2025	855.53	1
Transformer	Planned Outage	6/2/2025	5,990.25	7
Transformer	Planned Outage	6/2/2025	190.70	2
Transformer Bank	Planned Outage	6/2/2025	861.05	1
Transformer	Planned Outage	6/2/2025	323.17	5
Transformer	Planned Outage	6/2/2025	8,274.47	34
Transformer	Planned Outage	6/2/2025	6,292.80	12
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	150,560.05	1283
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	938.67	8
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	18,890.67	161
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
PLF	Planned Outage	6/2/2025	117.33	1
Transformer Bank	Planned Outage	6/2/2025	639.65	1
Primary Wire	Planned Outage	6/2/2025	233.30	2
None	Planned Outage	6/2/2025	17.12	1
None	Planned Outage	6/2/2025	17.58	1
None	Planned Outage	6/2/2025	17.33	1
None	Planned Outage	6/2/2025	17.17	1
None	Planned Outage	6/2/2025	17.45	1
None	Planned Outage	6/2/2025	17.22	1
None	Planned Outage	6/2/2025	35.23	2
None	Planned Outage	6/2/2025	16.20	1
None	Planned Outage	6/2/2025	16.33	1
None	Planned Outage	6/2/2025	16.38	1
None	Planned Outage	6/2/2025	16.48	1
None	Planned Outage	6/2/2025	16.60	1
None	Planned Outage	6/2/2025	16.68	1
None	Planned Outage	6/2/2025	16.18	1
None	Planned Outage	6/2/2025	16.82	1
None	Planned Outage	6/2/2025	16.40	1
None	Planned Outage	6/2/2025	16.22	1
None	Planned Outage	6/2/2025	15.27	1
None	Planned Outage	6/2/2025	15.98	1
None	Planned Outage	6/2/2025	15.20	1
None	Planned Outage	6/2/2025	15.85	1
None	Planned Outage	6/2/2025	15.48	1
None	Planned Outage	6/2/2025	14.77	1
None	Planned Outage	6/2/2025	14.93	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.73	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.15	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.15	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.30	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.65	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.10	1
None	Planned Outage	6/2/2025	13.12	1
None	Planned Outage	6/2/2025	13.17	1
None	Planned Outage	6/2/2025	2,744.87	209
None	Planned Outage	6/2/2025	3,020.67	230
None	Planned Outage	6/2/2025	1,339.60	102
Invalid	Planned Outage	6/2/2025	837.30	3
PLF	Planned Outage	6/2/2025	1,617.58	5
None	Planned Outage	6/2/2025	1,200.00	10
Transformer	Planned Outage	6/2/2025	926.45	7
Transformer	Planned Outage	6/2/2025	176.60	4
Transformer Bank	Planned Outage	6/2/2025	401.57	2
Transformer Bank	Planned Outage	6/3/2025	346.70	2
PLF	Planned Outage	6/3/2025	173.00	1
Transformer	Planned Outage	6/3/2025	750.03	2
Transformer	Planned Outage	6/3/2025	471.80	3
Transformer	Planned Outage	6/3/2025	633.33	4
Switch	Planned Outage	6/3/2025	575.80	2
Transformer	Planned Outage	6/3/2025	993.60	8
Transformer	Planned Outage	6/3/2025	437.33	10
Transformer	Planned Outage	6/3/2025	625.30	6
None	Planned Outage	6/3/2025	3,917.33	113
None	Planned Outage	6/3/2025	1,768.20	84
Transformer	Planned Outage	6/3/2025	2,316.00	8
Transformer	Planned Outage	6/3/2025	415.43	2
Transformer	Planned Outage	6/3/2025	69.68	1
Transformer	Planned Outage	6/3/2025	169.10	6
PLF	Planned Outage	6/3/2025	502.67	8
Transformer	Planned Outage	6/3/2025	1,002.80	6
Transformer	Planned Outage	6/3/2025	1,502.55	9
Breaker	Planned Outage	6/3/2025	17,622.93	1528
Transformer	Planned Outage	6/3/2025	211.28	1
Transformer	Planned Outage	6/3/2025	42.73	2
PLF	Planned Outage	6/3/2025	334.00	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	6/3/2025	96.47	4
Transformer	Planned Outage	6/3/2025	404.00	15
Transformer	Planned Outage	6/4/2025	13.38	1
Transformer	Planned Outage	6/4/2025	457.10	3
Primary Wire	Planned Outage	6/4/2025	588.20	4
Transformer	Planned Outage	6/4/2025	729.33	4
Transformer	Planned Outage	6/4/2025	311.00	1
PLF	Planned Outage	6/4/2025	552.20	22
Transformer	Planned Outage	6/4/2025	256.60	4
Transformer	Planned Outage	6/4/2025	565.60	8
Transformer	Planned Outage	6/4/2025	77.60	6
Transformer	Planned Outage	6/4/2025	377.10	6
Transformer	Planned Outage	6/4/2025	315.70	7
Transformer	Planned Outage	6/4/2025	48.03	2
Transformer	Planned Outage	6/4/2025	106.35	3
Transformer	Planned Outage	6/4/2025	26.18	1
Transformer	Planned Outage	6/4/2025	119.90	11
PLF	Planned Outage	6/4/2025	29.33	1
PLF	Planned Outage	6/4/2025	19,660.50	257
PLF	Planned Outage	6/4/2025	23,057.65	791
PLF	Planned Outage	6/4/2025	528.30	18
PLF	Planned Outage	6/4/2025	87.80	3
PLF	Planned Outage	6/4/2025	21,821.33	245
PLF	Planned Outage	6/4/2025	1,062.40	12
PLF	Planned Outage	6/4/2025	791.47	2
PLF	Planned Outage	6/4/2025	532.93	2
Transformer	Planned Outage	6/4/2025	112.60	4
PLF	Planned Outage	6/4/2025	55.27	1
Breaker	Planned Outage	6/4/2025	8.85	1
Breaker	Planned Outage	6/4/2025	9.02	1
Breaker	Planned Outage	6/4/2025	9.08	1
Breaker	Planned Outage	6/4/2025	9.08	1
Breaker	Planned Outage	6/4/2025	8.78	1
Breaker	Planned Outage	6/4/2025	4,641.97	887
Breaker	Planned Outage	6/4/2025	8.63	1
Breaker	Planned Outage	6/4/2025	8.72	1
Transformer Bank	Planned Outage	6/4/2025	359.73	2
Transformer Bank	Planned Outage	6/4/2025	288.10	1
Transformer	Planned Outage	6/5/2025	440.80	3
Transformer	Planned Outage	6/5/2025	414.87	7
Transformer	Planned Outage	6/5/2025	1,287.18	7
Transformer	Planned Outage	6/5/2025	1,513.20	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	6/5/2025	4,652.43	314
Transformer	Planned Outage	6/5/2025	158.57	2
Transformer	Planned Outage	6/5/2025	283.87	8
Transformer	Planned Outage	6/5/2025	658.60	4
Transformer	Planned Outage	6/5/2025	264.97	1
Transformer	Planned Outage	6/5/2025	153.25	3
Transformer	Planned Outage	6/5/2025	263.40	6
Transformer	Planned Outage	6/5/2025	298.30	6
Transformer	Planned Outage	6/5/2025	171.47	2
None	Planned Outage	6/5/2025	6,861.17	35
Transformer	Planned Outage	6/5/2025	233.07	32
Service point	Planned Outage	6/5/2025	7.47	1
Invalid	Planned Outage	6/5/2025	29.05	1
Switch	Planned Outage	6/5/2025	4,900.33	10
Transformer	Planned Outage	6/5/2025	79.87	4
Transformer	Planned Outage	6/5/2025	78.33	1
Transformer	Planned Outage	6/5/2025	107.10	3
Transformer Bank	Planned Outage	6/5/2025	403.60	6
Transformer	Planned Outage	6/5/2025	795.87	4
Transformer	Planned Outage	6/6/2025	980.83	11
PLF	Planned Outage	6/6/2025	23.92	1
Transformer	Planned Outage	6/6/2025	1,101.30	9
Transformer	Planned Outage	6/6/2025	190.07	2
Transformer	Planned Outage	6/6/2025	201.37	1
Transformer	Planned Outage	6/6/2025	321.00	10
PLF	Planned Outage	6/6/2025	59.33	1
Primary Wire	Planned Outage	6/6/2025	31,522.40	112
Primary Wire	Planned Outage	6/6/2025	637.00	21
Transformer	Planned Outage	6/6/2025	122.27	2
Transformer	Planned Outage	6/6/2025	2,146.40	16
Transformer	Planned Outage	6/6/2025	17.22	1
Transformer	Planned Outage	6/6/2025	313.47	4
Transformer	Planned Outage	6/6/2025	747.67	10
Primary Wire	Planned Outage	6/6/2025	40.75	1
None	Planned Outage	6/6/2025	6,724.67	14
Primary Wire	Planned Outage	6/6/2025	7.40	4
Primary Wire	Planned Outage	6/6/2025	7.80	4
Primary Wire	Planned Outage	6/6/2025	9.53	4
None	Planned Outage	6/6/2025	6,557.50	86
Transformer	Planned Outage	6/6/2025	248.65	3
Transformer	Planned Outage	6/6/2025	40.35	1
Transformer	Planned Outage	6/6/2025	134.20	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	6/6/2025	59.93	4
PLF	Planned Outage	6/6/2025	35.30	1
None	Planned Outage	6/6/2025	424.83	10
Invalid	Planned Outage	6/7/2025	457.92	7
Transformer	Planned Outage	6/7/2025	57.93	4
Transformer Bank	Planned Outage	6/7/2025	100.13	4
Transformer	Planned Outage	6/7/2025	69.95	3
Transformer	Planned Outage	6/7/2025	76.25	1
Transformer	Planned Outage	6/7/2025	170.92	5
Transformer	Planned Outage	6/7/2025	74.33	4
Transformer	Planned Outage	6/7/2025	535.35	9
Transformer	Planned Outage	6/7/2025	108.13	2
Transformer	Planned Outage	6/7/2025	32.90	1
Transformer	Planned Outage	6/7/2025	69.55	3
Transformer	Planned Outage	6/7/2025	126.53	2
None	Planned Outage	6/7/2025	7,168.33	68
Transformer	Planned Outage	6/8/2025	52.53	2
Transformer	Planned Outage	6/8/2025	29.63	2
Transformer	Planned Outage	6/8/2025	51.97	2
Transformer	Planned Outage	6/8/2025	61.75	3
Transformer	Planned Outage	6/8/2025	85.53	4
Transformer	Planned Outage	6/8/2025	106.93	2
Transformer	Planned Outage	6/8/2025	51.50	3
Transformer	Planned Outage	6/8/2025	97.13	4
PLF	Planned Outage	6/8/2025	82.10	3
Transformer	Planned Outage	6/8/2025	67.53	2
None	Planned Outage	6/8/2025	790.80	9
None	Planned Outage	6/9/2025	1,187.73	17
None	Planned Outage	6/9/2025	333.47	4
PLF	Planned Outage	6/9/2025	509.83	14
TX Repaired (OH)	Planned Outage	6/9/2025	12.08	1
Transformer	Planned Outage	6/9/2025	877.80	9
PLF	Planned Outage	6/9/2025	254.50	1
Transformer	Planned Outage	6/9/2025	81.13	1
Transformer Bank	Planned Outage	6/9/2025	948.50	7
Service point	Planned Outage	6/9/2025	128.97	1
Primary Wire	Planned Outage	6/9/2025	1,862.25	15
None	Planned Outage	6/9/2025	7,512.98	71
Transformer	Planned Outage	6/9/2025	641.70	3
Transformer	Planned Outage	6/9/2025	1,276.00	8
Transformer	Planned Outage	6/9/2025	566.90	2
Transformer Bank	Planned Outage	6/9/2025	364.25	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
OH Other	Planned Outage	6/9/2025	42.90	1
OH Other	Planned Outage	6/9/2025	42.57	1
OH Other	Planned Outage	6/9/2025	21,169.97	521
OH Other	Planned Outage	6/9/2025	41.90	1
PLF	Planned Outage	6/9/2025	195.75	1
Transformer	Planned Outage	6/9/2025	89.00	6
Invalid	Planned Outage	6/9/2025	43.07	2
Transformer	Planned Outage	6/9/2025	125.77	7
PLF	Planned Outage	6/9/2025	545.93	2
Transformer	Planned Outage	6/10/2025	79.10	6
Transformer	Planned Outage	6/10/2025	79.60	6
Transformer Bank	Planned Outage	6/10/2025	87.90	6
Transformer	Planned Outage	6/10/2025	1,454.60	14
Transformer	Planned Outage	6/10/2025	1,308.58	5
PLF	Planned Outage	6/10/2025	1,051.20	9
None	Planned Outage	6/10/2025	5,262.50	30
None	Planned Outage	6/10/2025	24,227.00	140
Transformer	Planned Outage	6/10/2025	170.42	5
Transformer	Planned Outage	6/10/2025	77.67	4
Transformer	Planned Outage	6/10/2025	451.47	4
Transformer	Planned Outage	6/10/2025	21.30	1
Transformer	Planned Outage	6/10/2025	305.10	9
Transformer	Planned Outage	6/10/2025	15.63	1
Invalid	Planned Outage	6/10/2025	351.07	8
Transformer Bank	Planned Outage	6/10/2025	1,358.93	7
None	Planned Outage	6/10/2025	133.25	1
Transformer	Planned Outage	6/10/2025	944.75	5
TX Repaired (PM)	Planned Outage	6/10/2025	944.75	5
Connections	Planned Outage	6/10/2025	60.80	12
Transformer	Planned Outage	6/10/2025	76.45	3
Transformer	Planned Outage	6/10/2025	596.00	4
Transformer	Planned Outage	6/10/2025	28.62	1
Transformer	Planned Outage	6/10/2025	1,338.15	11
Transformer	Planned Outage	6/10/2025	68.27	2
Transformer	Planned Outage	6/10/2025	45.70	3
Transformer	Planned Outage	6/10/2025	52.10	1
Transformer	Planned Outage	6/10/2025	155.15	3
Transformer	Planned Outage	6/11/2025	339.93	4
Transformer Bank	Planned Outage	6/11/2025	489.30	9
Transformer	Planned Outage	6/11/2025	334.80	4
Transformer	Planned Outage	6/11/2025	598.37	2
Invalid	Planned Outage	6/11/2025	2,172.70	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	6/11/2025	1,656.00	368
PLF	Planned Outage	6/11/2025	5.02	1
PLF	Planned Outage	6/11/2025	4.52	1
PLF	Planned Outage	6/11/2025	4.52	1
Transformer Bank	Planned Outage	6/11/2025	515.78	7
Transformer	Planned Outage	6/11/2025	5,512.53	34
Transformer	Planned Outage	6/11/2025	86.70	9
Transformer	Planned Outage	6/11/2025	68,881.70	249
Transformer	Planned Outage	6/11/2025	488.40	6
Transformer	Planned Outage	6/11/2025	74.52	1
Transformer	Planned Outage	6/11/2025	1,447.67	4
None	Planned Outage	6/11/2025	290.57	1
Transformer	Planned Outage	6/11/2025	1,981.00	10
Transformer	Planned Outage	6/11/2025	1,969.83	10
Switch	Planned Outage	6/11/2025	254.78	1
Transformer	Planned Outage	6/11/2025	57.80	12
Transformer	Planned Outage	6/11/2025	236.33	1
Transformer	Planned Outage	6/11/2025	180.40	8
Transformer	Planned Outage	6/11/2025	498.30	3
Transformer	Planned Outage	6/11/2025	300.58	5
Transformer	Planned Outage	6/11/2025	224.67	4
Transformer	Planned Outage	6/11/2025	313.17	5
Transformer	Planned Outage	6/11/2025	241.87	8
Transformer	Planned Outage	6/11/2025	753.00	6
Transformer	Planned Outage	6/11/2025	189.27	2
Transformer Bank	Planned Outage	6/11/2025	44.98	1
Breaker	Planned Outage	6/11/2025	4,639.25	241
Cross Arm	Planned Outage	6/11/2025	15,316.00	60
None	Planned Outage	6/11/2025	494.67	16
PLF	Planned Outage	6/11/2025	693.42	53
Transformer	Planned Outage	6/11/2025	3,951.75	9
PLF	Planned Outage	6/11/2025	5,620.00	10
Breaker	Planned Outage	6/11/2025	5.68	1
Breaker	Planned Outage	6/11/2025	6.02	1
Breaker	Planned Outage	6/11/2025	2,719.08	487
Breaker	Planned Outage	6/11/2025	5.52	1
Breaker	Planned Outage	6/11/2025	5.83	1
Breaker	Planned Outage	6/11/2025	5.12	1
Breaker	Planned Outage	6/11/2025	5.20	1
Breaker	Planned Outage	6/11/2025	5.30	1
PLF	Planned Outage	6/11/2025	2,911.78	151
None	Planned Outage	6/11/2025	607.25	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	6/12/2025	51.80	2
PLF	Planned Outage	6/12/2025	4,707.63	37
PLF	Planned Outage	6/12/2025	2,296.80	6
TX Replaced (PM)	Planned Outage	6/12/2025	3,458.25	9
PLF	Planned Outage	6/12/2025	350.15	1
PLF	Planned Outage	6/12/2025	16,784.00	48
Transformer	Planned Outage	6/12/2025	300.50	2
Transformer	Planned Outage	6/12/2025	910.47	7
Transformer	Planned Outage	6/12/2025	271.10	3
Transformer	Planned Outage	6/12/2025	1,054.08	13
Transformer	Planned Outage	6/12/2025	1,730.93	4
Transformer	Planned Outage	6/12/2025	1,224.25	5
PLF	Planned Outage	6/12/2025	6,053.67	22
PLF	Planned Outage	6/12/2025	237.57	1
Transformer	Planned Outage	6/12/2025	31.13	1
Transformer	Planned Outage	6/12/2025	683.17	10
Transformer	Planned Outage	6/12/2025	2,676.60	6
Transformer	Planned Outage	6/12/2025	1,731.17	10
Invalid	Planned Outage	6/12/2025	207.75	3
Transformer	Planned Outage	6/12/2025	356.67	8
PLF	Planned Outage	6/12/2025	474.60	2
Transformer	Planned Outage	6/12/2025	347.60	8
PLF	Planned Outage	6/12/2025	134.38	1
Transformer Bank	Planned Outage	6/12/2025	897.75	9
Transformer	Planned Outage	6/12/2025	487.20	6
Transformer	Planned Outage	6/12/2025	971.10	9
PLF	Planned Outage	6/12/2025	160.35	1
Transformer	Planned Outage	6/12/2025	96.88	1
Transformer	Planned Outage	6/12/2025	232.87	2
None	Planned Outage	6/12/2025	997.15	21
Transformer	Planned Outage	6/12/2025	2,545.30	6
Transformer	Planned Outage	6/12/2025	58.20	2
Primary Wire	Planned Outage	6/12/2025	4,290.42	25
PLF	Planned Outage	6/12/2025	416.27	2
Transformer	Planned Outage	6/12/2025	64.33	2
Breaker	Planned Outage	6/12/2025	3,202.42	415
Breaker	Planned Outage	6/12/2025	7.67	1
Breaker	Planned Outage	6/12/2025	7.83	1
PLF	Planned Outage	6/12/2025	217.32	13
Transformer Bank	Planned Outage	6/12/2025	300.27	8
PLF	Planned Outage	6/12/2025	772.80	3
PLF	Planned Outage	6/13/2025	1,546.50	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	6/13/2025	224.58	7
Breaker	Planned Outage	6/13/2025	6.68	1
Breaker	Planned Outage	6/13/2025	4,257.28	637
Breaker	Planned Outage	6/13/2025	6.68	1
Breaker	Planned Outage	6/13/2025	6.68	1
Breaker	Planned Outage	6/13/2025	6.68	1
PLF	Planned Outage	6/13/2025	564.03	1
Transformer	Planned Outage	6/13/2025	527.67	4
PLF	Planned Outage	6/13/2025	423.65	1
Transformer Bank	Planned Outage	6/13/2025	119.45	1
Transformer	Planned Outage	6/13/2025	370.50	9
PLF	Planned Outage	6/13/2025	424.33	4
PLF	Planned Outage	6/13/2025	105.43	1
PLF	Planned Outage	6/13/2025	1,165.45	11
Transformer	Planned Outage	6/13/2025	595.23	7
None	Planned Outage	6/13/2025	3,301.33	20
None	Planned Outage	6/13/2025	165.07	1
Transformer	Planned Outage	6/13/2025	266.87	2
None	Planned Outage	6/13/2025	1,211.83	11
Transformer	Planned Outage	6/13/2025	164.53	4
Switch	Planned Outage	6/13/2025	1,559.40	113
Switch	Planned Outage	6/13/2025	13.80	1
Switch	Planned Outage	6/13/2025	13.80	1
Transformer	Planned Outage	6/13/2025	1,769.47	8
Invalid	Planned Outage	6/13/2025	24.05	1
Transformer	Planned Outage	6/13/2025	24.98	1
Transformer	Planned Outage	6/13/2025	144.53	4
Invalid	Planned Outage	6/13/2025	98.50	10
Transformer	Planned Outage	6/13/2025	32.38	1
Transformer	Planned Outage	6/13/2025	36.48	1
Transformer	Planned Outage	6/13/2025	93.17	1
Primary Wire	Planned Outage	6/13/2025	276.77	1
Transformer Bank	Planned Outage	6/13/2025	268.40	12
Transformer	Planned Outage	6/13/2025	1,962.10	14
Breaker	Planned Outage	6/13/2025	10,094.93	338
Transformer	Planned Outage	6/13/2025	792.33	10
Breaker	Planned Outage	6/13/2025	10,905.00	900
None	Planned Outage	6/13/2025	947.60	6
Transformer	Planned Outage	6/14/2025	863.50	11
PLF	Planned Outage	6/14/2025	237.85	3
Transformer	Planned Outage	6/14/2025	56.33	4
Breaker	Planned Outage	6/14/2025	66,112.20	1701

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	6/15/2025	108,891.20	1104
PLF	Planned Outage	6/15/2025	22.30	1
Transformer	Planned Outage	6/15/2025	215.83	5
Transformer	Planned Outage	6/15/2025	533.98	7
Transformer	Planned Outage	6/15/2025	70.65	1
PLF	Planned Outage	6/15/2025	131.08	5
Transformer Bank	Planned Outage	6/15/2025	117.67	2
Transformer	Planned Outage	6/15/2025	256.50	6
Transformer	Planned Outage	6/15/2025	38.50	1
Transformer	Planned Outage	6/15/2025	74.63	2
Transformer	Planned Outage	6/15/2025	330.18	11
Transformer	Planned Outage	6/15/2025	223.40	6
Transformer Bank	Planned Outage	6/16/2025	222.10	1
Transformer	Planned Outage	6/16/2025	167.50	5
Transformer	Planned Outage	6/16/2025	386.20	1
Transformer	Planned Outage	6/16/2025	358.82	1
Transformer	Planned Outage	6/16/2025	336.17	1
Transformer	Planned Outage	6/16/2025	28.95	9
Transformer	Planned Outage	6/16/2025	1,038.50	6
Transformer	Planned Outage	6/16/2025	244.72	1
Transformer	Planned Outage	6/16/2025	516.00	8
PLF	Planned Outage	6/16/2025	2,738.85	19
Transformer Bank	Planned Outage	6/16/2025	401.05	3
None	Planned Outage	6/16/2025	290.60	4
Transformer	Planned Outage	6/16/2025	215.60	3
Transformer	Planned Outage	6/16/2025	560.30	13
None	Planned Outage	6/16/2025	4,823.83	10
Transformer	Planned Outage	6/16/2025	231.40	13
Transformer	Planned Outage	6/16/2025	242.30	2
PLF	Planned Outage	6/17/2025	1,067.02	73
Transformer Bank	Planned Outage	6/17/2025	406.17	2
Transformer	Planned Outage	6/17/2025	217.52	1
Primary Wire	Planned Outage	6/17/2025	2,350.70	6
PLF	Planned Outage	6/17/2025	96.80	2
Primary Wire	Planned Outage	6/17/2025	1,313.90	7
Primary Wire	Planned Outage	6/17/2025	193.17	10
Transformer	Planned Outage	6/17/2025	318.00	9
Transformer	Planned Outage	6/17/2025	1,401.07	4
PLF	Planned Outage	6/17/2025	151.70	1
Primary Wire	Planned Outage	6/17/2025	317.67	1
Transformer	Planned Outage	6/17/2025	805.12	7
Transformer	Planned Outage	6/17/2025	1,715.60	24

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	6/17/2025	937.73	13
PLF	Planned Outage	6/17/2025	315.17	1
PLF	Planned Outage	6/17/2025	215.58	5
Transformer	Planned Outage	6/17/2025	369.60	12
Transformer	Planned Outage	6/17/2025	178.93	4
PLF	Planned Outage	6/17/2025	51.08	1
Transformer	Planned Outage	6/17/2025	162.13	4
None	Planned Outage	6/17/2025	1,934.27	4
PLF	Planned Outage	6/17/2025	197.33	10
Breaker	Planned Outage	6/17/2025	9,752.00	552
Breaker	Planned Outage	6/17/2025	17.27	1
PLF	Planned Outage	6/17/2025	193.85	1
PLF	Planned Outage	6/17/2025	1,633.50	33
PLF	Planned Outage	6/17/2025	24,456.93	97
Transformer	Planned Outage	6/17/2025	267.00	15
Transformer	Planned Outage	6/18/2025	3,040.58	11
PLF	Planned Outage	6/18/2025	3,801.00	42
Switch	Planned Outage	6/18/2025	80.27	1
Switch	Planned Outage	6/18/2025	78.25	1
Switch	Planned Outage	6/18/2025	80.67	1
Breaker	Planned Outage	6/18/2025	78.32	1
Switch	Planned Outage	6/18/2025	78.95	1
Switch	Planned Outage	6/18/2025	77.88	1
Switch	Planned Outage	6/18/2025	642.13	8
Switch	Planned Outage	6/18/2025	304.13	4
Transformer	Planned Outage	6/18/2025	44.70	1
Transformer	Planned Outage	6/18/2025	1.13	1
PLF	Planned Outage	6/18/2025	16.63	1
None	Planned Outage	6/18/2025	11,584.70	111
Invalid	Planned Outage	6/18/2025	37.45	1
Invalid	Planned Outage	6/18/2025	586.33	5
Transformer	Planned Outage	6/18/2025	731.67	10
Transformer	Planned Outage	6/18/2025	69.78	1
None	Planned Outage	6/18/2025	707.80	12
Transformer	Planned Outage	6/18/2025	868.80	3
Transformer	Planned Outage	6/18/2025	507.37	2
Transformer	Planned Outage	6/18/2025	104.83	2
Transformer	Planned Outage	6/18/2025	258.35	3
Transformer	Planned Outage	6/18/2025	146.02	1
None	Planned Outage	6/18/2025	142.50	3
Transformer	Planned Outage	6/18/2025	230.00	10
Transformer	Planned Outage	6/18/2025	179.75	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	6/18/2025	122.20	6
Transformer	Planned Outage	6/18/2025	168.33	10
Transformer	Planned Outage	6/18/2025	440.70	13
Transformer	Planned Outage	6/18/2025	34.50	2
Breaker	Planned Outage	6/18/2025	405,424.87	1942
Transformer	Planned Outage	6/19/2025	207.90	7
PLF	Planned Outage	6/19/2025	283.45	1
Transformer	Planned Outage	6/19/2025	495.47	16
Transformer	Planned Outage	6/19/2025	502.50	2
Transformer	Planned Outage	6/19/2025	3,616.43	22
Transformer Bank	Planned Outage	6/19/2025	1,592.13	4
Transformer	Planned Outage	6/19/2025	91.65	1
Transformer	Planned Outage	6/19/2025	49.10	6
Switch	Planned Outage	6/19/2025	194.23	1
Transformer	Planned Outage	6/20/2025	2,293.90	7
Transformer Bank	Planned Outage	6/20/2025	456.55	3
OH Other	Planned Outage	6/20/2025	43.20	1
Transformer	Planned Outage	6/20/2025	1,420.42	5
PLF	Planned Outage	6/20/2025	4.78	1
PLF	Planned Outage	6/20/2025	282.60	1
Transformer	Planned Outage	6/20/2025	244.60	2
Transformer	Planned Outage	6/20/2025	740.68	19
Transformer	Planned Outage	6/20/2025	117.80	4
Transformer	Planned Outage	6/20/2025	1,467.95	11
PLF	Planned Outage	6/20/2025	47.02	1
PLF	Planned Outage	6/20/2025	55.28	1
Transformer	Planned Outage	6/20/2025	104.83	1
Transformer Bank	Planned Outage	6/20/2025	17.77	1
Transformer	Planned Outage	6/20/2025	111.07	4
Transformer	Planned Outage	6/20/2025	90.60	3
Transformer	Planned Outage	6/20/2025	97.00	5
Breaker	Planned Outage	6/20/2025	1.17	1
Breaker	Planned Outage	6/20/2025	2,266.00	1320
Breaker	Planned Outage	6/20/2025	1.28	1
Breaker	Planned Outage	6/20/2025	1.33	1
Breaker	Planned Outage	6/20/2025	1.33	1
Breaker	Planned Outage	6/20/2025	1.17	1
Invalid	Planned Outage	6/20/2025	112.58	7
Service point	Planned Outage	6/20/2025	24.78	1
PLF	Planned Outage	6/20/2025	1,775.43	98
Transformer	Planned Outage	6/20/2025	47.32	1
Transformer	Planned Outage	6/20/2025	434.00	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	6/21/2025	720.10	6
Transformer	Planned Outage	6/21/2025	194.95	7
Transformer	Planned Outage	6/21/2025	190.20	4
Transformer	Planned Outage	6/21/2025	191.40	4
Breaker	Planned Outage	6/21/2025	40,880.95	3421
Breaker	Planned Outage	6/21/2025	6,284.68	3337
Transformer	Planned Outage	6/21/2025	1,605.13	4
Transformer	Planned Outage	6/21/2025	3.42	1
Transformer	Planned Outage	6/21/2025	1,120.40	3
Transformer Bank	Planned Outage	6/21/2025	49.67	2
Transformer	Planned Outage	6/21/2025	351.00	9
Invalid	Planned Outage	6/21/2025	10,081.73	911
Invalid	Planned Outage	6/21/2025	2,229.00	12
Transformer Bank	Planned Outage	6/21/2025	452.70	2
Transformer	Planned Outage	6/21/2025	89.83	7
Invalid	Planned Outage	6/21/2025	1,696.67	5
Transformer	Planned Outage	6/22/2025	965.98	11
Transformer	Planned Outage	6/22/2025	52.63	2
Transformer	Planned Outage	6/22/2025	40.20	4
Transformer	Planned Outage	6/22/2025	73.97	2
Transformer	Planned Outage	6/22/2025	191.45	7
Transformer	Planned Outage	6/22/2025	160.00	6
Transformer	Planned Outage	6/22/2025	28.07	2
Transformer	Planned Outage	6/22/2025	20.25	1
Transformer	Planned Outage	6/22/2025	32.65	1
Transformer	Planned Outage	6/22/2025	64.80	8
Primary Wire	Planned Outage	6/22/2025	264.43	2
Service point	Planned Outage	6/22/2025	1.58	1
Service point	Planned Outage	6/22/2025	1.47	1
Service point	Planned Outage	6/23/2025	3.83	1
Transformer Bank	Planned Outage	6/23/2025	148.50	5
Transformer	Planned Outage	6/23/2025	44.03	2
Transformer	Planned Outage	6/23/2025	506.27	4
Transformer Bank	Planned Outage	6/23/2025	877.25	3
Transformer	Planned Outage	6/23/2025	373.33	5
PLF	Planned Outage	6/23/2025	2,552.25	9
None	Planned Outage	6/23/2025	3,411.10	11
Transformer	Planned Outage	6/23/2025	736.27	8
Transformer	Planned Outage	6/23/2025	348.60	9
Transformer	Planned Outage	6/23/2025	151.07	2
Invalid	Planned Outage	6/23/2025	518.10	11
Transformer	Planned Outage	6/23/2025	1,094.83	10

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	6/23/2025	741.83	10
Transformer	Planned Outage	6/23/2025	106.52	11
PLF	Planned Outage	6/23/2025	47.95	1
Transformer	Planned Outage	6/23/2025	530.30	3
Transformer	Planned Outage	6/23/2025	122.93	4
PLF	Planned Outage	6/23/2025	38.25	3
Transformer	Planned Outage	6/23/2025	919.05	11
Transformer	Planned Outage	6/23/2025	73.35	3
Transformer	Planned Outage	6/23/2025	73.73	4
Breaker	Planned Outage	6/23/2025	155.13	13
Breaker	Planned Outage	6/23/2025	12.02	1
Breaker	Planned Outage	6/23/2025	12.58	1
Breaker	Planned Outage	6/23/2025	11.73	1
Breaker	Planned Outage	6/23/2025	27,968.42	2347
Breaker	Planned Outage	6/23/2025	12.65	1
Breaker	Planned Outage	6/23/2025	11.80	1
Breaker	Planned Outage	6/23/2025	12.15	1
Breaker	Planned Outage	6/23/2025	12.25	1
Breaker	Planned Outage	6/23/2025	12.33	1
Breaker	Planned Outage	6/23/2025	12.48	1
Transformer	Planned Outage	6/23/2025	3,254.00	12
PLF	Planned Outage	6/23/2025	390.27	1
None	Planned Outage	6/23/2025	1,010.53	11
Transformer	Planned Outage	6/23/2025	105.42	11
Transformer Bank	Planned Outage	6/24/2025	174.80	2
Transformer	Planned Outage	6/24/2025	754.33	10
Transformer	Planned Outage	6/24/2025	475.67	4
Transformer	Planned Outage	6/24/2025	134.67	4
PLF	Planned Outage	6/24/2025	8,286.00	30
Transformer	Planned Outage	6/24/2025	339.62	1
TX Repaired (PM)	Planned Outage	6/24/2025	1,549.80	3
Transformer	Planned Outage	6/24/2025	29.83	2
Transformer	Planned Outage	6/24/2025	157.93	1
Transformer	Planned Outage	6/24/2025	262.50	2
None	Planned Outage	6/24/2025	294.85	1
Transformer	Planned Outage	6/24/2025	569.80	4
Transformer	Planned Outage	6/24/2025	272.17	2
Transformer	Planned Outage	6/24/2025	288.90	9
PLF	Planned Outage	6/24/2025	177.53	1
PLF	Planned Outage	6/24/2025	355.20	2
Transformer Bank	Planned Outage	6/24/2025	30.37	1
PLF	Planned Outage	6/24/2025	152.95	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Primary Wire	Planned Outage	6/24/2025	4.80	1
PLF	Planned Outage	6/24/2025	197.60	3
None	Planned Outage	6/24/2025	142.08	5
Transformer	Planned Outage	6/24/2025	89.90	3
Invalid	Planned Outage	6/24/2025	1,247.40	2
Transformer	Planned Outage	6/24/2025	125.80	4
Transformer	Planned Outage	6/24/2025	209.00	22
Transformer	Planned Outage	6/24/2025	90.03	2
Transformer	Planned Outage	6/24/2025	58.40	3
None	Planned Outage	6/24/2025	512.40	4
Transformer	Planned Outage	6/24/2025	1,283.83	10
Transformer	Planned Outage	6/25/2025	85.88	1
Breaker	Planned Outage	6/25/2025	4.17	2
Breaker	Planned Outage	6/25/2025	4,480.00	280
Transformer	Planned Outage	6/25/2025	728.50	5
Primary Wire	Planned Outage	6/25/2025	387.10	2
PLF	Planned Outage	6/25/2025	348.60	1
PLF	Planned Outage	6/25/2025	234.00	2
Transformer	Planned Outage	6/25/2025	811.35	9
Transformer	Planned Outage	6/25/2025	1,577.10	9
PLF	Planned Outage	6/25/2025	1,275.30	26
Transformer	Planned Outage	6/25/2025	863.13	11
OH Other	Planned Outage	6/25/2025	69.73	2
PLF	Planned Outage	6/25/2025	1,265.25	15
PLF	Planned Outage	6/25/2025	18,208.80	54
Transformer	Planned Outage	6/25/2025	897.07	8
Transformer	Planned Outage	6/25/2025	396.40	12
Transformer	Planned Outage	6/25/2025	652.40	8
Transformer	Planned Outage	6/25/2025	480.55	7
Transformer	Planned Outage	6/25/2025	67.50	6
Transformer	Planned Outage	6/25/2025	621.50	5
Transformer	Planned Outage	6/25/2025	659.80	6
Transformer	Planned Outage	6/25/2025	656.80	6
None	Planned Outage	6/25/2025	661.50	6
None	Planned Outage	6/25/2025	662.10	6
PLF	Planned Outage	6/25/2025	80.68	1
Transformer	Planned Outage	6/25/2025	881.40	12
Transformer	Planned Outage	6/25/2025	219.83	5
OH Other	Planned Outage	6/25/2025	55.30	7
PLF	Planned Outage	6/25/2025	5,718.52	17
Transformer	Planned Outage	6/25/2025	181.95	9
None	Planned Outage	6/25/2025	5,894.72	11

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	6/25/2025	5,359.50	10
Transformer	Planned Outage	6/25/2025	45.40	2
None	Planned Outage	6/25/2025	5,162.30	114
None	Planned Outage	6/25/2025	270.60	6
None	Planned Outage	6/25/2025	1.05	1
None	Planned Outage	6/25/2025	236.75	3
None	Planned Outage	6/25/2025	298.00	8
Transformer	Planned Outage	6/26/2025	74.87	2
Transformer	Planned Outage	6/26/2025	783.53	4
Transformer	Planned Outage	6/26/2025	1,317.00	12
Transformer Bank	Planned Outage	6/26/2025	1,069.80	9
Transformer	Planned Outage	6/26/2025	452.00	3
PLF	Planned Outage	6/26/2025	3,210.67	28
None	Planned Outage	6/26/2025	517.75	5
PLF	Planned Outage	6/26/2025	87.58	1
Transformer	Planned Outage	6/26/2025	440.93	4
Transformer	Planned Outage	6/26/2025	485.62	1
Transformer	Planned Outage	6/26/2025	483.27	1
Transformer	Planned Outage	6/26/2025	361.75	5
Transformer	Planned Outage	6/26/2025	1,820.70	7
Transformer	Planned Outage	6/26/2025	747.60	7
Transformer	Planned Outage	6/26/2025	141.30	3
Transformer	Planned Outage	6/26/2025	196.40	1
Transformer	Planned Outage	6/26/2025	996.40	12
Transformer	Planned Outage	6/26/2025	51.00	1
Transformer	Planned Outage	6/26/2025	1,711.00	12
Transformer	Planned Outage	6/26/2025	594.53	8
Transformer	Planned Outage	6/26/2025	36.40	4
PLF	Planned Outage	6/26/2025	96.60	2
Transformer	Planned Outage	6/26/2025	41.48	1
Transformer	Planned Outage	6/26/2025	243.80	4
Breaker	Planned Outage	6/26/2025	3,001.13	763
Breaker	Planned Outage	6/26/2025	6.23	1
Breaker	Planned Outage	6/26/2025	7.90	1
Breaker	Planned Outage	6/26/2025	3.32	1
Breaker	Planned Outage	6/26/2025	7.93	1
Breaker	Planned Outage	6/26/2025	7.98	1
Breaker	Planned Outage	6/26/2025	8.07	1
Breaker	Planned Outage	6/26/2025	8.07	1
Transformer	Planned Outage	6/26/2025	1,439.43	7
Transformer	Planned Outage	6/26/2025	34.68	1
Primary Wire	Planned Outage	6/26/2025	1,030.47	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	6/26/2025	93.43	1
Transformer	Planned Outage	6/26/2025	67.07	1
Transformer	Planned Outage	6/26/2025	136.85	3
Transformer	Planned Outage	6/26/2025	429.73	11
Transformer	Planned Outage	6/27/2025	183.40	14
Transformer	Planned Outage	6/27/2025	9.30	1
Breaker	Planned Outage	6/27/2025	115.45	1
Breaker	Planned Outage	6/27/2025	115.52	1
Breaker	Planned Outage	6/27/2025	115.37	1
Breaker	Planned Outage	6/27/2025	230,240.83	2005
Breaker	Planned Outage	6/27/2025	54,290.13	616
Breaker	Planned Outage	6/27/2025	88.13	1
Breaker	Planned Outage	6/27/2025	88.13	1
Breaker	Planned Outage	6/27/2025	88.13	1
Breaker	Planned Outage	6/27/2025	11.77	1
PLF	Planned Outage	6/27/2025	486.00	15
Transformer	Planned Outage	6/27/2025	303.73	4
Transformer	Planned Outage	6/27/2025	478.80	6
Breaker	Planned Outage	6/27/2025	15,080.75	337
Transformer	Planned Outage	6/27/2025	178.00	6
PLF	Planned Outage	6/27/2025	107.50	3
PLF	Planned Outage	6/27/2025	337.60	6
Service point	Planned Outage	6/27/2025	1,000.50	23
Transformer	Planned Outage	6/27/2025	295.20	2
PLF	Planned Outage	6/27/2025	736.00	5
PLF	Planned Outage	6/27/2025	1,260.43	2
Transformer	Planned Outage	6/28/2025	190.88	13
None	Planned Outage	6/28/2025	2,092.35	13
PLF	Planned Outage	6/28/2025	129.50	1
Transformer	Planned Outage	6/28/2025	219.27	4
Transformer	Planned Outage	6/28/2025	104.12	1
Transformer	Planned Outage	6/28/2025	115.55	3
Transformer	Planned Outage	6/28/2025	187.42	5
Transformer	Planned Outage	6/28/2025	135.90	6
Transformer	Planned Outage	6/29/2025	43.57	2
Breaker	Planned Outage	6/29/2025	44.48	1
Breaker	Planned Outage	6/29/2025	62,098.73	1396
Breaker	Planned Outage	6/29/2025	33.63	1
Breaker	Planned Outage	6/29/2025	2,152.53	64
Breaker	Planned Outage	6/29/2025	44,765.97	1331
Breaker	Planned Outage	6/29/2025	33.63	1
Transformer Bank	Planned Outage	6/29/2025	686.58	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	6/29/2025	297.27	7
Transformer Bank	Planned Outage	6/29/2025	842.85	3
PLF	Planned Outage	6/29/2025	338.45	7
Transformer	Planned Outage	6/29/2025	700.40	24
PLF	Planned Outage	6/29/2025	3,305.33	40
Secondary Wire	Planned Outage	6/29/2025	1,476.50	10
Transformer Bank	Planned Outage	6/29/2025	369.18	1
Switch	Planned Outage	6/30/2025	427.30	6
Transformer Bank	Planned Outage	6/30/2025	68.67	10
UG Other	Planned Outage	6/30/2025	167.85	1
UG Other	Planned Outage	6/30/2025	6,109.93	37
Transformer	Planned Outage	6/30/2025	79.00	5
PLF	Planned Outage	6/30/2025	13,344.13	82
Transformer	Planned Outage	6/30/2025	4,642.97	38
Transformer	Planned Outage	6/30/2025	177.80	4
PLF	Planned Outage	6/30/2025	333.47	2
Transformer	Planned Outage	6/30/2025	112.05	9
Transformer	Planned Outage	6/30/2025	217.00	4
Transformer	Planned Outage	6/30/2025	19.50	1
Transformer	Planned Outage	6/30/2025	62.42	1
Transformer	Planned Outage	6/30/2025	6,058.47	38
Transformer	Planned Outage	6/30/2025	68.45	3
PLF	Planned Outage	6/30/2025	123.75	1
PLF	Planned Outage	6/30/2025	31.90	2
PLF	Planned Outage	6/30/2025	1,916.97	131
PLF	Planned Outage	6/30/2025	995.07	68
PLF	Planned Outage	6/30/2025	1,938.30	21
PLF	Planned Outage	6/30/2025	274.23	38
Invalid	Planned Outage	6/30/2025	432.02	7
Transformer	Planned Outage	6/30/2025	301.87	8
Switch	Planned Outage	6/30/2025	6,492.93	22
Transformer	Planned Outage	6/30/2025	48.00	3
Primary Wire	Planned Outage	7/1/2025	602.85	9
Transformer	Planned Outage	7/1/2025	1,183.07	8
Transformer	Planned Outage	7/1/2025	16.23	2
PLF	Planned Outage	7/1/2025	178.93	1
Transformer	Planned Outage	7/1/2025	55.15	1
PLF	Planned Outage	7/1/2025	390.88	1
Transformer	Planned Outage	7/1/2025	39.45	1
None	Planned Outage	7/1/2025	473.25	5
Transformer	Planned Outage	7/1/2025	591.62	7
Transformer Bank	Planned Outage	7/1/2025	154.27	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	7/1/2025	176.00	22
None	Planned Outage	7/1/2025	351.40	1
PLF	Planned Outage	7/1/2025	1,273.80	3
Transformer	Planned Outage	7/1/2025	463.05	9
PLF	Planned Outage	7/1/2025	53.60	12
Transformer	Planned Outage	7/1/2025	152.80	2
PLF	Planned Outage	7/1/2025	368.23	2
Transformer	Planned Outage	7/1/2025	465.63	2
PLF	Planned Outage	7/1/2025	106.65	3
PLF	Planned Outage	7/1/2025	515.03	2
PLF	Planned Outage	7/1/2025	194.17	1
PLF	Planned Outage	7/1/2025	1,488.42	5
Transformer	Planned Outage	7/1/2025	330.17	7
Transformer	Planned Outage	7/1/2025	78.17	10
Transformer	Planned Outage	7/2/2025	76.50	5
None	Planned Outage	7/2/2025	38.92	1
None	Planned Outage	7/2/2025	396.37	47
PLF	Planned Outage	7/2/2025	141.45	1
Transformer	Planned Outage	7/2/2025	240.03	2
Transformer	Planned Outage	7/2/2025	2,776.50	6
Transformer	Planned Outage	7/2/2025	72.67	8
PLF	Planned Outage	7/2/2025	992.20	3
None	Planned Outage	7/2/2025	711.83	10
Transformer	Planned Outage	7/2/2025	527.13	4
Transformer	Planned Outage	7/2/2025	264.53	4
None	Planned Outage	7/2/2025	539.50	6
Transformer	Planned Outage	7/2/2025	124.67	5
Transformer	Planned Outage	7/2/2025	40.80	2
Transformer	Planned Outage	7/3/2025	86.00	4
PLF	Planned Outage	7/3/2025	17.42	1
Transformer	Planned Outage	7/3/2025	265.67	4
Transformer	Planned Outage	7/3/2025	663.25	7
Transformer	Planned Outage	7/3/2025	473.33	5
None	Planned Outage	7/3/2025	161.30	3
Breaker	Planned Outage	7/3/2025	3,648.38	479
Breaker	Planned Outage	7/3/2025	9.33	1
Transformer	Planned Outage	7/3/2025	942.27	8
PLF	Planned Outage	7/3/2025	4,914.63	47
Transformer Bank	Planned Outage	7/3/2025	386.53	4
None	Planned Outage	7/4/2025	7.23	2
Transformer	Planned Outage	7/4/2025	93.10	6
Transformer	Planned Outage	7/4/2025	94.23	11

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	7/4/2025	167.00	6
Breaker	Planned Outage	7/4/2025	13,396.65	279
Transformer	Planned Outage	7/4/2025	4,911.20	16
Breaker	Planned Outage	7/4/2025	36.50	1
Breaker	Planned Outage	7/4/2025	36.53	1
Breaker	Planned Outage	7/4/2025	36.18	1
Breaker	Planned Outage	7/4/2025	36.15	1
Breaker	Planned Outage	7/4/2025	36.48	1
Breaker	Planned Outage	7/4/2025	36.32	1
Breaker	Planned Outage	7/4/2025	36.72	1
Breaker	Planned Outage	7/4/2025	36.65	1
Breaker	Planned Outage	7/4/2025	36.38	1
Breaker	Planned Outage	7/4/2025	36.53	1
Breaker	Planned Outage	7/4/2025	35.82	1
Breaker	Planned Outage	7/4/2025	36.07	1
Breaker	Planned Outage	7/4/2025	35.97	1
Breaker	Planned Outage	7/4/2025	36.63	1
Breaker	Planned Outage	7/4/2025	73.27	2
Breaker	Planned Outage	7/4/2025	35.05	1
Breaker	Planned Outage	7/4/2025	35.63	1
Breaker	Planned Outage	7/4/2025	35.02	1
Breaker	Planned Outage	7/4/2025	35.70	1
Breaker	Planned Outage	7/4/2025	35.37	1
Breaker	Planned Outage	7/4/2025	34.23	1
Breaker	Planned Outage	7/4/2025	33.97	1
Breaker	Planned Outage	7/4/2025	33.92	1
Breaker	Planned Outage	7/4/2025	34.58	1
Breaker	Planned Outage	7/4/2025	33.90	1
Breaker	Planned Outage	7/4/2025	34.68	1
Breaker	Planned Outage	7/4/2025	33.80	1
Breaker	Planned Outage	7/4/2025	33.17	1
Breaker	Planned Outage	7/4/2025	33.55	1
Breaker	Planned Outage	7/4/2025	33.63	1
Breaker	Planned Outage	7/4/2025	33.27	1
Breaker	Planned Outage	7/4/2025	33.68	1
Breaker	Planned Outage	7/4/2025	33.65	1
Breaker	Planned Outage	7/4/2025	32.97	1
Breaker	Planned Outage	7/4/2025	33.13	1
Breaker	Planned Outage	7/4/2025	31.90	1
Breaker	Planned Outage	7/4/2025	32.57	1
Breaker	Planned Outage	7/4/2025	32.13	1
Breaker	Planned Outage	7/4/2025	31.92	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/4/2025	31.70	1
Breaker	Planned Outage	7/4/2025	30.85	1
Breaker	Planned Outage	7/4/2025	31.70	1
Breaker	Planned Outage	7/4/2025	31.10	1
Breaker	Planned Outage	7/4/2025	30.25	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	1,119.10	38
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.62	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.73	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	1,975.38	67
Breaker	Planned Outage	7/4/2025	29.62	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	6,193.37	209
Breaker	Planned Outage	7/4/2025	88.90	3
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.47	1
Breaker	Planned Outage	7/4/2025	29.70	1
Breaker	Planned Outage	7/4/2025	29.42	1
Breaker	Planned Outage	7/4/2025	14.38	1
Breaker	Planned Outage	7/4/2025	14.38	1
Breaker	Planned Outage	7/4/2025	15,591.80	1204
Breaker	Planned Outage	7/4/2025	14.38	1
Transformer	Planned Outage	7/4/2025	98.40	1
Transformer	Planned Outage	7/4/2025	162.45	3
Transformer Bank	Planned Outage	7/4/2025	3,685.55	11
Primary Wire	Planned Outage	7/4/2025	2,096.27	8
PLF	Planned Outage	7/4/2025	4,198.50	18
PLF	Planned Outage	7/4/2025	203.00	12
None	Planned Outage	7/5/2025	1,646.00	20
Transformer Bank	Planned Outage	7/5/2025	132.32	1
Transformer	Planned Outage	7/5/2025	423.90	6
Transformer	Planned Outage	7/5/2025	566.00	6
Transformer	Planned Outage	7/5/2025	638.80	12
Transformer	Planned Outage	7/5/2025	218.30	6
Transformer	Planned Outage	7/5/2025	979.00	10
Transformer	Planned Outage	7/5/2025	99.52	7
Transformer	Planned Outage	7/5/2025	127.70	6
Transformer	Planned Outage	7/5/2025	734.33	10
PLF	Planned Outage	7/6/2025	287.80	6
PLF	Planned Outage	7/6/2025	6,787.93	58
Switch	Planned Outage	7/6/2025	17.42	1
Switch	Planned Outage	7/6/2025	4,492.02	277
Transformer	Planned Outage	7/6/2025	337.60	6
PLF	Planned Outage	7/6/2025	794.33	20
Transformer	Planned Outage	7/6/2025	22.08	1
Switch	Planned Outage	7/6/2025	2,676.67	10
PLF	Planned Outage	7/6/2025	501.70	6
Transformer	Planned Outage	7/6/2025	110.73	2
Transformer	Planned Outage	7/6/2025	78.02	1
Transformer	Planned Outage	7/7/2025	96.60	3
Transformer	Planned Outage	7/7/2025	280.35	9
Transformer	Planned Outage	7/7/2025	63.47	2
Transformer	Planned Outage	7/7/2025	272.00	10
Transformer	Planned Outage	7/7/2025	99.33	4
Transformer Bank	Planned Outage	7/7/2025	803.90	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	7/7/2025	1,522.33	4
Transformer	Planned Outage	7/7/2025	649.30	6
Transformer	Planned Outage	7/7/2025	942.55	3
PLF	Planned Outage	7/7/2025	744.53	32
None	Planned Outage	7/7/2025	81.90	26
None	Planned Outage	7/7/2025	35.53	26
Transformer	Planned Outage	7/7/2025	55.07	1
Transformer	Planned Outage	7/7/2025	558.33	10
Transformer	Planned Outage	7/7/2025	597.73	8
Transformer	Planned Outage	7/7/2025	433.97	2
PLF	Planned Outage	7/7/2025	634.10	3
Transformer	Planned Outage	7/7/2025	173.53	2
Transformer	Planned Outage	7/7/2025	29.77	2
None	Planned Outage	7/7/2025	746.50	5
Transformer	Planned Outage	7/7/2025	236.25	3
None	Planned Outage	7/8/2025	194.70	2
Transformer	Planned Outage	7/8/2025	237.07	16
PLF	Planned Outage	7/8/2025	4,914.00	63
PLF	Planned Outage	7/8/2025	234.00	3
PLF	Planned Outage	7/8/2025	77.98	1
Transformer	Planned Outage	7/8/2025	126.05	3
PLF	Planned Outage	7/8/2025	1,368.15	7
Transformer	Planned Outage	7/8/2025	38.17	2
PLF	Planned Outage	7/8/2025	510.20	1
Transformer	Planned Outage	7/8/2025	1,235.70	3
Transformer	Planned Outage	7/8/2025	267.50	5
Transformer	Planned Outage	7/8/2025	155.67	4
PLF	Planned Outage	7/8/2025	85.95	1
Transformer	Planned Outage	7/8/2025	578.93	4
PLF	Planned Outage	7/8/2025	649.13	4
Transformer	Planned Outage	7/8/2025	615.13	4
Transformer	Planned Outage	7/8/2025	939.20	6
PLF	Planned Outage	7/8/2025	461.50	2
Transformer	Planned Outage	7/8/2025	917.20	6
Transformer Bank	Planned Outage	7/8/2025	582.35	3
Transformer	Planned Outage	7/8/2025	736.40	4
PLF	Planned Outage	7/8/2025	7.33	1
None	Planned Outage	7/8/2025	927.20	6
Transformer	Planned Outage	7/8/2025	449.73	4
Transformer	Planned Outage	7/8/2025	445.27	4
Transformer	Planned Outage	7/8/2025	332.35	3
Transformer	Planned Outage	7/8/2025	1,292.25	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	7/8/2025	2,337.25	15
Transformer	Planned Outage	7/8/2025	157.05	3
Transformer	Planned Outage	7/8/2025	398.80	4
Transformer	Planned Outage	7/8/2025	40.70	2
Transformer	Planned Outage	7/8/2025	116.27	2
Transformer	Planned Outage	7/8/2025	36.83	1
Transformer	Planned Outage	7/8/2025	639.28	11
Transformer	Planned Outage	7/8/2025	333.60	12
PLF	Planned Outage	7/9/2025	181.20	1
Transformer	Planned Outage	7/9/2025	2,882.25	9
Transformer	Planned Outage	7/9/2025	565.30	6
Switch	Planned Outage	7/9/2025	57,772.15	249
Transformer	Planned Outage	7/9/2025	125.93	1
Transformer	Planned Outage	7/9/2025	394.47	2
None	Planned Outage	7/9/2025	974.67	8
PLF	Planned Outage	7/9/2025	117.37	1
Transformer	Planned Outage	7/9/2025	229.80	6
Transformer	Planned Outage	7/9/2025	440.13	4
PLF	Planned Outage	7/9/2025	141.33	32
Transformer	Planned Outage	7/9/2025	252.63	2
Transformer	Planned Outage	7/9/2025	254.58	5
Transformer	Planned Outage	7/9/2025	1,113.15	9
Transformer	Planned Outage	7/9/2025	719.72	7
PLF	Planned Outage	7/9/2025	191.00	10
PLF	Planned Outage	7/10/2025	40,194.00	180
None	Planned Outage	7/10/2025	194.23	2
Transformer	Planned Outage	7/10/2025	346.10	6
Transformer	Planned Outage	7/10/2025	3,797.20	12
Transformer	Planned Outage	7/10/2025	496.07	7
Transformer	Planned Outage	7/10/2025	10,439.25	155
Transformer	Planned Outage	7/10/2025	11,091.87	164
Transformer	Planned Outage	7/10/2025	1,456.05	9
PLF	Planned Outage	7/10/2025	30.67	10
PLF	Planned Outage	7/10/2025	15.50	5
Transformer	Planned Outage	7/10/2025	892.00	10
Transformer Bank	Planned Outage	7/10/2025	572.60	3
PLF	Planned Outage	7/10/2025	174.73	4
Transformer	Planned Outage	7/10/2025	1,128.75	7
None	Planned Outage	7/10/2025	150.45	1
None	Planned Outage	7/10/2025	112.07	1
Transformer Bank	Planned Outage	7/10/2025	211.17	7
Transformer	Planned Outage	7/10/2025	106.90	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Invalid	Planned Outage	7/10/2025	404.67	4
Transformer	Planned Outage	7/10/2025	101.87	4
Transformer	Planned Outage	7/10/2025	11.60	3
Transformer	Planned Outage	7/10/2025	165.50	1
None	Planned Outage	7/10/2025	386.20	2
Transformer	Planned Outage	7/10/2025	1,271.90	3
None	Planned Outage	7/10/2025	2,373.12	7
PLF	Planned Outage	7/10/2025	141.28	1
Transformer	Planned Outage	7/10/2025	74.65	3
Transformer	Planned Outage	7/10/2025	52.03	1
Transformer	Planned Outage	7/10/2025	1,072.00	8
None	Planned Outage	7/10/2025	2,686.93	22
Breaker	Planned Outage	7/11/2025	2,512.40	2284
Transformer	Planned Outage	7/11/2025	130.17	5
Transformer	Planned Outage	7/11/2025	82.65	3
Transformer	Planned Outage	7/11/2025	45.20	3
Transformer	Planned Outage	7/11/2025	260.33	10
Transformer	Planned Outage	7/11/2025	43.32	1
Transformer	Planned Outage	7/11/2025	102.12	1
PLF	Planned Outage	7/11/2025	279.40	1
Transformer	Planned Outage	7/11/2025	66.00	10
Transformer	Planned Outage	7/11/2025	166.30	1
Transformer	Planned Outage	7/11/2025	8,719.20	24
Transformer	Planned Outage	7/11/2025	479.05	3
Transformer	Planned Outage	7/11/2025	96.08	5
Transformer	Planned Outage	7/11/2025	403.13	2
PLF	Planned Outage	7/11/2025	483.57	2
None	Planned Outage	7/11/2025	265.50	6
Transformer	Planned Outage	7/11/2025	98.00	6
PLF	Planned Outage	7/11/2025	464.03	1
UG Other	Planned Outage	7/11/2025	404.25	3
Transformer Bank	Planned Outage	7/11/2025	82.57	1
TX Repaired (OH)	Planned Outage	7/11/2025	773.25	5
PLF	Planned Outage	7/11/2025	920.75	3
Transformer	Planned Outage	7/11/2025	432.02	7
Transformer	Planned Outage	7/11/2025	133.23	2
Transformer Bank	Planned Outage	7/11/2025	121.02	1
Transformer	Planned Outage	7/11/2025	78.42	1
Transformer	Planned Outage	7/11/2025	146.82	1
Transformer	Planned Outage	7/11/2025	61.60	3
None	Planned Outage	7/11/2025	162.83	2
Breaker	Planned Outage	7/12/2025	923.40	171

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/12/2025	4.95	1
Transformer	Planned Outage	7/12/2025	483.67	20
Breaker	Planned Outage	7/12/2025	3,779.20	192
Switch	Planned Outage	7/12/2025	1,190.03	2
Transformer	Planned Outage	7/12/2025	12.53	8
Transformer	Planned Outage	7/12/2025	1,366.13	8
Transformer	Planned Outage	7/12/2025	432.13	8
Transformer	Planned Outage	7/12/2025	190.85	3
PLF	Planned Outage	7/12/2025	2,066.42	5
None	Planned Outage	7/12/2025	783.67	10
PLF	Planned Outage	7/13/2025	496.85	19
Switch	Planned Outage	7/13/2025	747.70	2
PLF	Planned Outage	7/13/2025	464.10	91
PLF	Planned Outage	7/13/2025	239.83	2
Transformer	Planned Outage	7/13/2025	63.90	1
Transformer Bank	Planned Outage	7/13/2025	41.33	2
Transformer Bank	Planned Outage	7/13/2025	1,366.10	3
Transformer	Planned Outage	7/13/2025	77.57	2
Transformer	Planned Outage	7/13/2025	198.58	5
Transformer	Planned Outage	7/13/2025	48.70	6
PLF	Planned Outage	7/13/2025	20.33	1
Transformer	Planned Outage	7/13/2025	26.13	4
Transformer	Planned Outage	7/13/2025	98.75	5
None	Planned Outage	7/14/2025	162.18	1
Transformer	Planned Outage	7/14/2025	1,651.80	9
PLF	Planned Outage	7/14/2025	1,210.05	3
Transformer	Planned Outage	7/14/2025	343.40	4
Transformer	Planned Outage	7/14/2025	369.87	2
Transformer	Planned Outage	7/14/2025	915.47	8
Primary Wire	Planned Outage	7/14/2025	4,777.15	21
Transformer	Planned Outage	7/14/2025	1,664.25	9
Transformer	Planned Outage	7/14/2025	1,109.10	6
Transformer	Planned Outage	7/14/2025	119.13	2
None	Planned Outage	7/14/2025	2,337.00	38
Transformer	Planned Outage	7/14/2025	169.20	1
Transformer	Planned Outage	7/14/2025	497.33	10
Transformer	Planned Outage	7/14/2025	694.20	9
Breaker	Planned Outage	7/14/2025	8,008.80	1278
Invalid	Planned Outage	7/14/2025	50,910.33	1874
None	Planned Outage	7/14/2025	12,275.10	46
Transformer Bank	Planned Outage	7/14/2025	787.38	1
PLF	Planned Outage	7/14/2025	518.15	43

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	7/14/2025	66.45	3
Breaker	Planned Outage	7/14/2025	4,021.67	508
Breaker	Planned Outage	7/14/2025	4.42	1
Breaker	Planned Outage	7/14/2025	92,892.50	730
Breaker	Planned Outage	7/14/2025	3,597.07	28
None	Planned Outage	7/14/2025	5,423.00	204
PLF	Planned Outage	7/14/2025	2,878.63	7
PLF	Planned Outage	7/14/2025	252.45	9
Transformer Bank	Planned Outage	7/15/2025	656.30	3
Transformer	Planned Outage	7/15/2025	1,393.20	27
Transformer Bank	Planned Outage	7/15/2025	1,257.40	6
Transformer	Planned Outage	7/15/2025	489.00	2
PLF	Planned Outage	7/15/2025	96.63	1
Transformer	Planned Outage	7/15/2025	49.45	3
PLF	Planned Outage	7/15/2025	1,256.30	102
Transformer	Planned Outage	7/15/2025	205.93	2
Breaker	Planned Outage	7/15/2025	101.78	1
Breaker	Planned Outage	7/15/2025	102.02	1
Breaker	Planned Outage	7/15/2025	102.13	1
Breaker	Planned Outage	7/15/2025	102.23	1
Breaker	Planned Outage	7/15/2025	102.23	1
Breaker	Planned Outage	7/15/2025	269,919.90	2658
Breaker	Planned Outage	7/15/2025	101.43	1
Breaker	Planned Outage	7/15/2025	101.55	1
Breaker	Planned Outage	7/15/2025	101.67	1
Breaker	Planned Outage	7/15/2025	101.88	1
Transformer	Planned Outage	7/15/2025	1,558.67	10
Invalid	Planned Outage	7/15/2025	76.83	1
Invalid	Planned Outage	7/15/2025	93.65	1
Transformer	Planned Outage	7/15/2025	45.80	4
Transformer Bank	Planned Outage	7/15/2025	52.80	3
Transformer	Planned Outage	7/15/2025	119.75	5
Transformer	Planned Outage	7/15/2025	1,523.07	8
Transformer	Planned Outage	7/15/2025	1,094.67	5
Primary Wire	Planned Outage	7/15/2025	348.80	32
Transformer	Planned Outage	7/15/2025	532.25	5
Transformer	Planned Outage	7/15/2025	147.33	4
None	Planned Outage	7/16/2025	587.00	60
Transformer	Planned Outage	7/16/2025	2,061.03	7
Transformer	Planned Outage	7/16/2025	2,347.20	8
Transformer	Planned Outage	7/16/2025	1,048.02	13
None	Planned Outage	7/16/2025	4,641.65	39

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	7/16/2025	3,299.40	12
Transformer	Planned Outage	7/16/2025	356.82	1
Transformer	Planned Outage	7/16/2025	427.73	4
PLF	Planned Outage	7/16/2025	5,199.57	26
PLF	Planned Outage	7/16/2025	3,201.98	23
Transformer	Planned Outage	7/16/2025	121.40	6
Transformer	Planned Outage	7/16/2025	1,071.77	11
Transformer	Planned Outage	7/16/2025	1,059.33	4
Transformer	Planned Outage	7/16/2025	4,808.90	19
Transformer	Planned Outage	7/16/2025	13.02	11
Transformer	Planned Outage	7/16/2025	252.12	1
Transformer	Planned Outage	7/16/2025	1,667.20	8
Transformer	Planned Outage	7/16/2025	612.07	4
Transformer	Planned Outage	7/16/2025	734.00	8
Transformer	Planned Outage	7/16/2025	220.33	10
Transformer	Planned Outage	7/16/2025	48.30	2
None	Planned Outage	7/16/2025	290.45	1
PLF	Planned Outage	7/16/2025	162.60	2
Transformer	Planned Outage	7/16/2025	1,548.50	5
Transformer Bank	Planned Outage	7/16/2025	216.88	13
Transformer	Planned Outage	7/16/2025	2,039.33	7
PLF	Planned Outage	7/16/2025	122.17	1
Invalid	Planned Outage	7/17/2025	200.00	3
Transformer	Planned Outage	7/17/2025	810.13	8
Transformer	Planned Outage	7/17/2025	312.70	6
None	Planned Outage	7/17/2025	2,700.67	20
Transformer	Planned Outage	7/17/2025	1,953.25	13
Transformer	Planned Outage	7/17/2025	1,049.65	7
Transformer	Planned Outage	7/17/2025	376.02	11
None	Planned Outage	7/17/2025	155.73	8
Transformer Bank	Planned Outage	7/17/2025	158.10	3
None	Planned Outage	7/17/2025	1,502.67	14
None	Planned Outage	7/17/2025	4,187.00	15
Transformer	Planned Outage	7/17/2025	437.03	7
Transformer	Planned Outage	7/17/2025	92.05	7
PLF	Planned Outage	7/17/2025	32.82	11
PLF	Planned Outage	7/18/2025	53.78	1
Transformer	Planned Outage	7/18/2025	170.45	7
Transformer	Planned Outage	7/18/2025	50.75	5
Transformer	Planned Outage	7/18/2025	163.60	8
Transformer	Planned Outage	7/18/2025	799.07	8
Transformer	Planned Outage	7/18/2025	29.50	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	7/18/2025	90.00	5
Transformer	Planned Outage	7/18/2025	125.87	4
PLF	Planned Outage	7/18/2025	58.95	1
Transformer	Planned Outage	7/18/2025	232.80	6
Transformer	Planned Outage	7/18/2025	6,074.60	7
PLF	Planned Outage	7/18/2025	77.20	3
Transformer	Planned Outage	7/18/2025	22.15	1
Transformer	Planned Outage	7/18/2025	78.55	1
Transformer	Planned Outage	7/18/2025	100.20	4
Transformer	Planned Outage	7/18/2025	174.73	2
Transformer	Planned Outage	7/18/2025	96.07	4
Transformer	Planned Outage	7/18/2025	233.68	7
Transformer	Planned Outage	7/18/2025	399.83	10
Breaker	Planned Outage	7/18/2025	6,846.75	1611
Breaker	Planned Outage	7/18/2025	6.10	1
Transformer	Planned Outage	7/19/2025	223.30	6
Transformer	Planned Outage	7/19/2025	234.40	6
None	Planned Outage	7/19/2025	4,371.73	56
Transformer	Planned Outage	7/19/2025	76.50	2
Transformer	Planned Outage	7/19/2025	94.07	1
Transformer	Planned Outage	7/19/2025	67.75	1
Transformer	Planned Outage	7/19/2025	2.13	1
Transformer	Planned Outage	7/19/2025	316.50	9
Transformer	Planned Outage	7/19/2025	53.55	3
Transformer	Planned Outage	7/19/2025	53.87	2
Transformer	Planned Outage	7/19/2025	119.27	2
PLF	Planned Outage	7/19/2025	1,339.43	22
Transformer	Planned Outage	7/19/2025	16.97	1
Breaker	Planned Outage	7/19/2025	232.37	1
Breaker	Planned Outage	7/19/2025	232.00	1
Breaker	Planned Outage	7/19/2025	232.10	1
Transformer	Planned Outage	7/19/2025	60.37	2
Transformer	Planned Outage	7/19/2025	258.70	6
Transformer	Planned Outage	7/19/2025	147.27	4
Breaker	Planned Outage	7/19/2025	34,708.95	1233
Transformer	Planned Outage	7/19/2025	162.62	11
Transformer	Planned Outage	7/19/2025	545.23	11
None	Planned Outage	7/20/2025	7,145.48	839
Transformer	Planned Outage	7/20/2025	180.38	1
Transformer Bank	Planned Outage	7/20/2025	117.57	1
Transformer	Planned Outage	7/20/2025	25.47	2
Transformer	Planned Outage	7/20/2025	86.65	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	7/20/2025	12.85	1
Transformer	Planned Outage	7/20/2025	29.02	1
Transformer	Planned Outage	7/20/2025	22.00	2
Transformer	Planned Outage	7/20/2025	44.03	2
Invalid	Planned Outage	7/20/2025	4,391.60	12
Transformer	Planned Outage	7/20/2025	111.93	4
PLF	Planned Outage	7/20/2025	2,273.47	118
Transformer	Planned Outage	7/20/2025	83.60	4
Transformer	Planned Outage	7/20/2025	21.62	1
Transformer	Planned Outage	7/20/2025	71.27	2
Transformer	Planned Outage	7/20/2025	108.17	5
Transformer	Planned Outage	7/20/2025	39.55	1
PLF	Planned Outage	7/20/2025	317.90	1
None	Planned Outage	7/20/2025	957.07	16
Transformer	Planned Outage	7/21/2025	505.67	5
Transformer	Planned Outage	7/21/2025	150.63	1
Transformer	Planned Outage	7/21/2025	50.65	3
Transformer	Planned Outage	7/21/2025	147.12	7
Transformer	Planned Outage	7/21/2025	113.70	6
Breaker	Planned Outage	7/21/2025	1,738.80	483
Transformer Bank	Planned Outage	7/21/2025	950.33	5
Transformer Bank	Planned Outage	7/21/2025	94.50	3
Transformer	Planned Outage	7/21/2025	1,030.17	7
Transformer	Planned Outage	7/21/2025	289.05	1
None	Planned Outage	7/21/2025	234.50	2
Service point	Planned Outage	7/21/2025	48.87	1
Transformer	Planned Outage	7/21/2025	41.12	1
None	Planned Outage	7/21/2025	614.25	7
Transformer	Planned Outage	7/21/2025	328.25	3
TX Repaired (OH)	Planned Outage	7/21/2025	1,052.60	4
PLF	Planned Outage	7/21/2025	46.85	1
Transformer	Planned Outage	7/21/2025	558.42	5
Switch	Planned Outage	7/21/2025	9,915.40	132
Transformer Bank	Planned Outage	7/21/2025	486.70	1
Transformer Bank	Planned Outage	7/21/2025	1,001.53	4
PLF	Planned Outage	7/21/2025	261.67	1
Transformer	Planned Outage	7/21/2025	1,098.60	9
Transformer	Planned Outage	7/21/2025	249.67	1
Breaker	Planned Outage	7/21/2025	6,667.00	885
Transformer	Planned Outage	7/22/2025	371.70	2
None	Planned Outage	7/22/2025	477.80	3
Transformer	Planned Outage	7/22/2025	202.17	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	7/22/2025	26.75	1
Transformer	Planned Outage	7/22/2025	174.30	1
Transformer	Planned Outage	7/22/2025	119.90	2
Transformer	Planned Outage	7/22/2025	1,107.40	12
Transformer	Planned Outage	7/22/2025	793.07	8
PLF	Planned Outage	7/22/2025	416.35	11
Transformer Bank	Planned Outage	7/22/2025	70.35	1
PLF	Planned Outage	7/22/2025	33.65	1
Transformer	Planned Outage	7/22/2025	511.65	9
Transformer	Planned Outage	7/22/2025	319.00	6
PLF	Planned Outage	7/22/2025	3,271.20	48
Transformer	Planned Outage	7/22/2025	18.50	1
None	Planned Outage	7/22/2025	222.10	3
Transformer	Planned Outage	7/22/2025	1,773.33	14
Transformer	Planned Outage	7/22/2025	129.05	1
Transformer	Planned Outage	7/22/2025	64.67	2
Transformer	Planned Outage	7/22/2025	31.45	1
Transformer	Planned Outage	7/22/2025	250.80	9
Transformer	Planned Outage	7/22/2025	67.13	2
Transformer	Planned Outage	7/22/2025	59.33	2
Transformer	Planned Outage	7/22/2025	45.02	1
Transformer	Planned Outage	7/22/2025	215.83	10
Primary Wire	Planned Outage	7/22/2025	60.12	1
Transformer	Planned Outage	7/22/2025	26.17	1
Transformer	Planned Outage	7/22/2025	32.63	11
Transformer	Planned Outage	7/22/2025	44.18	1
PLF	Planned Outage	7/22/2025	385.25	1
Transformer Bank	Planned Outage	7/22/2025	450.30	3
Transformer	Planned Outage	7/22/2025	90.53	4
Transformer	Planned Outage	7/22/2025	758.00	5
Transformer	Planned Outage	7/23/2025	1,371.07	7
Transformer	Planned Outage	7/23/2025	1,028.42	7
Transformer	Planned Outage	7/23/2025	263.73	4
Transformer	Planned Outage	7/23/2025	336.30	1
Transformer	Planned Outage	7/23/2025	708.83	5
Transformer	Planned Outage	7/23/2025	44.95	1
Transformer	Planned Outage	7/23/2025	416.40	4
Transformer	Planned Outage	7/23/2025	948.85	3
Primary Wire	Planned Outage	7/23/2025	4,695.60	26
Primary Wire	Planned Outage	7/23/2025	183.85	1
Transformer Bank	Planned Outage	7/23/2025	998.00	4
Transformer	Planned Outage	7/23/2025	238.67	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	7/23/2025	862.30	3
Invalid	Planned Outage	7/23/2025	74,318.75	825
Transformer	Planned Outage	7/23/2025	417.90	3
None	Planned Outage	7/23/2025	123.80	6
Breaker	Planned Outage	7/23/2025	46,187.73	1634
Transformer	Planned Outage	7/23/2025	770.70	9
Transformer	Planned Outage	7/23/2025	446.50	6
None	Planned Outage	7/23/2025	838.80	9
None	Planned Outage	7/23/2025	2,338.05	9
Service - Crew	Planned Outage	7/23/2025	25.42	1
None	Planned Outage	7/23/2025	23.03	1
None	Planned Outage	7/23/2025	286.53	14
None	Planned Outage	7/23/2025	612.15	7
None	Planned Outage	7/23/2025	2,440.55	19
None	Planned Outage	7/23/2025	128.28	1
Transformer	Planned Outage	7/23/2025	22.90	6
Transformer Bank	Planned Outage	7/23/2025	877.75	3
Transformer Bank	Planned Outage	7/23/2025	232.62	1
Transformer	Planned Outage	7/23/2025	26.80	2
Transformer	Planned Outage	7/23/2025	46.93	8
Transformer Bank	Planned Outage	7/23/2025	807.95	3
Transformer	Planned Outage	7/24/2025	218.13	8
Transformer	Planned Outage	7/24/2025	136.50	7
Transformer Bank	Planned Outage	7/24/2025	250.33	10
Transformer Bank	Planned Outage	7/24/2025	42.80	6
Transformer Bank	Planned Outage	7/24/2025	233.07	2
PLF	Planned Outage	7/24/2025	678.50	2
Transformer	Planned Outage	7/24/2025	1,610.00	8
PLF	Planned Outage	7/24/2025	192.47	2
PLF	Planned Outage	7/24/2025	26,347.95	87
PLF	Planned Outage	7/24/2025	258.52	1
None	Planned Outage	7/24/2025	1,416.80	8
Transformer	Planned Outage	7/24/2025	1,842.00	10
Transformer	Planned Outage	7/24/2025	300.33	2
PLF	Planned Outage	7/24/2025	106.53	17
Transformer	Planned Outage	7/24/2025	541.33	5
Transformer	Planned Outage	7/24/2025	588.30	6
Transformer	Planned Outage	7/24/2025	85.80	2
Transformer	Planned Outage	7/24/2025	89.33	4
Invalid	Planned Outage	7/24/2025	46.60	3
PLF	Planned Outage	7/24/2025	9,805.33	80
Transformer Bank	Planned Outage	7/24/2025	169.80	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	7/24/2025	338.25	11
PLF	Planned Outage	7/24/2025	928.45	31
Breaker	Planned Outage	7/25/2025	14.50	1
Breaker	Planned Outage	7/25/2025	6,985.42	479
PLF	Planned Outage	7/25/2025	1,011.00	10
Invalid	Planned Outage	7/25/2025	647.05	1
Breaker	Planned Outage	7/25/2025	8.90	1
Breaker	Planned Outage	7/25/2025	8.88	1
Breaker	Planned Outage	7/25/2025	14,344.53	1681
Transformer	Planned Outage	7/25/2025	524.17	2
Transformer	Planned Outage	7/25/2025	307.20	1
Transformer	Planned Outage	7/25/2025	147.30	6
Transformer	Planned Outage	7/25/2025	185.53	2
Transformer	Planned Outage	7/25/2025	255.85	3
Transformer Bank	Planned Outage	7/25/2025	250.55	3
Transformer	Planned Outage	7/25/2025	96.38	1
Transformer	Planned Outage	7/25/2025	107.52	1
Transformer Bank	Planned Outage	7/25/2025	563.73	8
Transformer	Planned Outage	7/25/2025	411.73	8
Transformer	Planned Outage	7/25/2025	77.70	6
Transformer Bank	Planned Outage	7/25/2025	250.95	3
None	Planned Outage	7/25/2025	1,888.60	426
PLF	Planned Outage	7/25/2025	281.00	6
Transformer Bank	Planned Outage	7/26/2025	97.60	16
None	Planned Outage	7/26/2025	605.33	1
Switch	Planned Outage	7/26/2025	2,191.00	10
Transformer	Planned Outage	7/26/2025	1,415.87	7
PLF	Planned Outage	7/26/2025	3,199.50	18
Transformer	Planned Outage	7/26/2025	32.25	1
PLF	Planned Outage	7/26/2025	92.35	1
PLF	Planned Outage	7/26/2025	1,200.55	13
Transformer	Planned Outage	7/26/2025	152.00	12
Transformer	Planned Outage	7/26/2025	140.15	3
Transformer	Planned Outage	7/26/2025	46.40	1
Transformer	Planned Outage	7/26/2025	93.40	2
PLF	Planned Outage	7/26/2025	55.70	1
PLF	Planned Outage	7/26/2025	282.95	3
Transformer	Planned Outage	7/26/2025	32.62	1
Transformer	Planned Outage	7/26/2025	236.50	6
Transformer	Planned Outage	7/26/2025	2,223.00	13
UG Other	Planned Outage	7/26/2025	4.70	1
UG Other	Planned Outage	7/26/2025	231.33	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	7/26/2025	328.60	4
Transformer	Planned Outage	7/26/2025	154.20	6
Transformer	Planned Outage	7/26/2025	826.82	7
Transformer	Planned Outage	7/27/2025	56.28	1
None	Planned Outage	7/27/2025	323.67	4
Breaker	Planned Outage	7/27/2025	4,339.67	1385
PLF	Planned Outage	7/27/2025	74,173.00	242
Transformer	Planned Outage	7/27/2025	61.37	2
Breaker	Planned Outage	7/27/2025	32,275.95	1239
Breaker	Planned Outage	7/27/2025	15,786.30	606
PLF	Planned Outage	7/27/2025	1,163.87	58
Breaker	Planned Outage	7/27/2025	178,055.43	2362
PLF	Planned Outage	7/27/2025	6,023.90	177
None	Planned Outage	7/27/2025	39,170.10	177
Transformer	Planned Outage	7/27/2025	45.03	7
Transformer	Planned Outage	7/27/2025	207.67	4
Transformer Bank	Planned Outage	7/27/2025	1,472.13	4
Transformer Bank	Planned Outage	7/27/2025	1,246.50	5
PLF	Planned Outage	7/27/2025	600.80	2
PLF	Planned Outage	7/28/2025	1,943.33	88
None	Planned Outage	7/28/2025	630.30	9
PLF	Planned Outage	7/28/2025	2,588.60	12
Breaker	Planned Outage	7/28/2025	37.23	1
None	Planned Outage	7/28/2025	4,647.93	124
None	Planned Outage	7/28/2025	1,808.40	88
PLF	Planned Outage	7/28/2025	482.23	34
Transformer Bank	Planned Outage	7/28/2025	299.92	1
Transformer Bank	Planned Outage	7/28/2025	202.32	1
PLF	Planned Outage	7/28/2025	1,275.67	43
Transformer	Planned Outage	7/28/2025	1,324.65	9
PLF	Planned Outage	7/28/2025	519.17	50
PLF	Planned Outage	7/28/2025	111.20	1
PLF	Planned Outage	7/28/2025	466.47	4
PLF	Planned Outage	7/28/2025	574.00	41
Transformer	Planned Outage	7/28/2025	417.20	6
Switch	Planned Outage	7/28/2025	85.03	2
Transformer	Planned Outage	7/28/2025	458.67	5
Transformer	Planned Outage	7/28/2025	71.95	1
Transformer	Planned Outage	7/28/2025	76.70	1
Transformer	Planned Outage	7/28/2025	269.60	6
Transformer	Planned Outage	7/28/2025	147.77	2
Transformer Bank	Planned Outage	7/28/2025	1,774.50	10

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	7/28/2025	574.58	7
PLF	Planned Outage	7/28/2025	43.28	1
Transformer	Planned Outage	7/28/2025	55.47	2
Transformer Bank	Planned Outage	7/29/2025	90.82	1
Transformer	Planned Outage	7/29/2025	80.10	9
Transformer	Planned Outage	7/29/2025	380.80	14
Transformer	Planned Outage	7/29/2025	407.87	19
Transformer Bank	Planned Outage	7/29/2025	243.07	2
Primary Wire	Planned Outage	7/29/2025	241.83	1
Primary Wire	Planned Outage	7/29/2025	2,169.45	9
Primary Wire	Planned Outage	7/29/2025	240.97	1
Transformer	Planned Outage	7/29/2025	92.53	4
Transformer	Planned Outage	7/29/2025	114.92	5
Transformer	Planned Outage	7/29/2025	75.47	4
Transformer	Planned Outage	7/29/2025	546.00	7
PLF	Planned Outage	7/29/2025	22.87	7
Transformer	Planned Outage	7/29/2025	99.17	7
Transformer	Planned Outage	7/29/2025	102.60	4
None	Planned Outage	7/29/2025	10,465.03	22
Transformer	Planned Outage	7/29/2025	42.92	1
Transformer	Planned Outage	7/29/2025	132.73	2
Transformer	Planned Outage	7/29/2025	48.30	2
PLF	Planned Outage	7/29/2025	2,728.50	34
Breaker	Planned Outage	7/29/2025	1.85	1
Breaker	Planned Outage	7/29/2025	2.07	1
Breaker	Planned Outage	7/29/2025	2.22	1
Breaker	Planned Outage	7/29/2025	2.30	1
Breaker	Planned Outage	7/29/2025	2,371.50	918
Breaker	Planned Outage	7/29/2025	1.98	1
Switch	Planned Outage	7/29/2025	15,104.45	181
Transformer	Planned Outage	7/29/2025	100.08	5
Transformer	Planned Outage	7/29/2025	99.33	2
Transformer	Planned Outage	7/29/2025	393.00	3
Transformer Bank	Planned Outage	7/29/2025	301.73	1
Transformer	Planned Outage	7/29/2025	149.67	2
None	Planned Outage	7/29/2025	679.58	7
Breaker	Planned Outage	7/29/2025	271,792.33	1138
Breaker	Planned Outage	7/29/2025	238.83	1
Breaker	Planned Outage	7/29/2025	238.90	1
Breaker	Planned Outage	7/29/2025	94.98	1
Breaker	Planned Outage	7/29/2025	94.98	1
Breaker	Planned Outage	7/29/2025	10,846.13	914

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	7/29/2025	94.98	1
Breaker	Planned Outage	7/29/2025	97.95	1
Invalid	Planned Outage	7/29/2025	38,876.67	872
Invalid	Planned Outage	7/29/2025	47.95	1
Transformer	Planned Outage	7/29/2025	1,573.83	19
Breaker	Planned Outage	7/29/2025	15,720.80	914
Transformer	Planned Outage	7/29/2025	1,236.20	7
PLF	Planned Outage	7/29/2025	235.90	7
Transformer	Planned Outage	7/29/2025	306.15	13
PLF	Planned Outage	7/29/2025	1,317.50	15
Transformer	Planned Outage	7/30/2025	49.20	6
Transformer	Planned Outage	7/30/2025	97.07	8
Primary Wire	Planned Outage	7/30/2025	309.00	1
Transformer	Planned Outage	7/30/2025	835.75	1
Breaker	Planned Outage	7/30/2025	64,937.60	546
PLF	Planned Outage	7/30/2025	129.95	3
PLF	Planned Outage	7/30/2025	1,444.80	43
PLF	Planned Outage	7/30/2025	1,407.00	42
Transformer	Planned Outage	7/30/2025	682.92	11
PLF	Planned Outage	7/30/2025	1,020.00	6
PLF	Planned Outage	7/30/2025	152.10	13
Transformer	Planned Outage	7/30/2025	8.28	1
Transformer	Planned Outage	7/30/2025	795.43	2
Transformer	Planned Outage	7/30/2025	242.27	4
Transformer	Planned Outage	7/30/2025	6.07	2
Transformer	Planned Outage	7/30/2025	708.58	11
Transformer	Planned Outage	7/30/2025	192.75	3
Transformer	Planned Outage	7/30/2025	288.00	3
Transformer	Planned Outage	7/30/2025	184.98	11
Transformer	Planned Outage	7/30/2025	809.78	11
Transformer Bank	Planned Outage	7/30/2025	283.60	2
Breaker	Planned Outage	7/30/2025	5.17	1
Breaker	Planned Outage	7/30/2025	680.40	126
Transformer	Planned Outage	7/30/2025	61.25	7
Transformer	Planned Outage	7/30/2025	78.37	2
Transformer	Planned Outage	7/31/2025	774.07	4
Primary Wire	Planned Outage	7/31/2025	3,984.72	13
Transformer	Planned Outage	7/31/2025	232.13	8
Transformer	Planned Outage	7/31/2025	292.83	5
Transformer	Planned Outage	7/31/2025	94.40	6
Transformer	Planned Outage	7/31/2025	61.60	8
Transformer	Planned Outage	7/31/2025	409.07	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	7/31/2025	649.58	5
PLF	Planned Outage	7/31/2025	2,231.73	8
PLF	Planned Outage	7/31/2025	407.85	1
Transformer	Planned Outage	7/31/2025	133.35	3
Transformer	Planned Outage	7/31/2025	92.53	4
PLF	Planned Outage	7/31/2025	255.38	1
Transformer	Planned Outage	7/31/2025	1,277.03	13
Transformer	Planned Outage	7/31/2025	46.65	1
Transformer	Planned Outage	7/31/2025	107.23	1
PLF	Planned Outage	7/31/2025	91.57	2
Transformer	Planned Outage	7/31/2025	16.72	1
TX Repaired (OH)	Planned Outage	7/31/2025	699.75	3
Transformer	Planned Outage	7/31/2025	48.78	1
Transformer	Planned Outage	7/31/2025	39.60	18
Transformer	Planned Outage	7/31/2025	88.90	7
Transformer	Planned Outage	8/1/2025	207.30	9
PLF	Planned Outage	8/1/2025	166.80	2
Breaker	Planned Outage	8/1/2025	32,851.20	1711
Breaker	Planned Outage	8/1/2025	19.28	1
PLF	Planned Outage	8/1/2025	306.75	15
Transformer	Planned Outage	8/1/2025	701.20	3
Transformer Bank	Planned Outage	8/1/2025	99.93	4
PLF	Planned Outage	8/1/2025	9,621.50	35
Transformer	Planned Outage	8/1/2025	161.33	4
Transformer	Planned Outage	8/1/2025	31.10	2
PLF	Planned Outage	8/1/2025	53.83	5
Transformer	Planned Outage	8/1/2025	2,212.80	16
PLF	Planned Outage	8/1/2025	146.90	1
Transformer	Planned Outage	8/1/2025	24.87	1
Transformer	Planned Outage	8/1/2025	256.65	3
Transformer	Planned Outage	8/1/2025	138.25	7
Transformer	Planned Outage	8/1/2025	109.30	3
Transformer	Planned Outage	8/1/2025	63.90	2
Transformer	Planned Outage	8/1/2025	196.47	7
Invalid	Planned Outage	8/1/2025	1,108.53	4
Transformer	Planned Outage	8/1/2025	45.68	1
Transformer	Planned Outage	8/1/2025	82.35	1
PLF	Planned Outage	8/1/2025	401.22	7
Transformer	Planned Outage	8/1/2025	173.60	4
Transformer	Planned Outage	8/1/2025	56.55	9
Breaker	Planned Outage	8/1/2025	425.25	35
Transformer Bank	Planned Outage	8/1/2025	174.40	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	8/2/2025	238.17	10
Transformer	Planned Outage	8/2/2025	28.47	2
Transformer	Planned Outage	8/2/2025	7.53	1
PLF	Planned Outage	8/2/2025	301.12	1
Transformer	Planned Outage	8/2/2025	1,544.53	8
Transformer	Planned Outage	8/2/2025	980.47	11
PLF	Planned Outage	8/2/2025	205.02	1
Breaker	Planned Outage	8/2/2025	7,543.47	1088
Breaker	Planned Outage	8/2/2025	7.28	1
Breaker	Planned Outage	8/2/2025	7.47	1
Transformer	Planned Outage	8/2/2025	18.47	1
Transformer	Planned Outage	8/2/2025	212.55	13
PLF	Planned Outage	8/2/2025	171.38	1
Transformer	Planned Outage	8/2/2025	8.33	2
Transformer	Planned Outage	8/2/2025	590.52	11
Transformer	Planned Outage	8/2/2025	22.13	1
None	Planned Outage	8/2/2025	744.22	7
Transformer	Planned Outage	8/2/2025	4.10	1
Transformer	Planned Outage	8/2/2025	104.07	4
Transformer	Planned Outage	8/3/2025	26.92	1
Transformer	Planned Outage	8/3/2025	602.33	13
Transformer	Planned Outage	8/3/2025	255.20	11
Transformer Bank	Planned Outage	8/3/2025	15.67	1
Transformer Bank	Planned Outage	8/3/2025	65.43	2
Transformer	Planned Outage	8/3/2025	28.40	6
Service point	Planned Outage	8/3/2025	63.78	1
Transformer Bank	Planned Outage	8/3/2025	4.80	3
Transformer	Planned Outage	8/3/2025	185.67	2
Transformer	Planned Outage	8/3/2025	116.00	2
Transformer	Planned Outage	8/3/2025	47.93	1
Transformer	Planned Outage	8/3/2025	138.72	7
Transformer	Planned Outage	8/3/2025	90.27	4
None	Planned Outage	8/3/2025	2,375.67	10
Transformer	Planned Outage	8/3/2025	1,415.70	9
PLF	Planned Outage	8/3/2025	994.20	36
None	Planned Outage	8/3/2025	62.40	13
Transformer	Planned Outage	8/3/2025	577.73	8
Transformer Bank	Planned Outage	8/3/2025	218.25	5
Transformer Bank	Planned Outage	8/4/2025	62.17	1
Transformer	Planned Outage	8/4/2025	12.33	10
Breaker	Planned Outage	8/4/2025	1,766,331.00	1219
Transformer	Planned Outage	8/4/2025	279.00	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	8/4/2025	2,227.17	35
Transformer	Planned Outage	8/4/2025	10,227.43	22
Transformer	Planned Outage	8/4/2025	288.23	1
Primary Wire	Planned Outage	8/4/2025	150.10	19
PLF	Planned Outage	8/4/2025	129.80	22
Transformer	Planned Outage	8/4/2025	88.47	4
Transformer	Planned Outage	8/4/2025	575.07	8
Transformer	Planned Outage	8/4/2025	221.20	1
Transformer	Planned Outage	8/4/2025	434.42	5
Transformer	Planned Outage	8/4/2025	853.47	8
PLF	Planned Outage	8/4/2025	189.38	11
Transformer	Planned Outage	8/4/2025	1,800.45	9
Transformer	Planned Outage	8/4/2025	49.33	2
Primary Wire	Planned Outage	8/4/2025	97.65	7
Transformer Bank	Planned Outage	8/4/2025	65.98	1
Transformer	Planned Outage	8/4/2025	24.93	1
Transformer	Planned Outage	8/4/2025	1,112.63	2
Switch	Planned Outage	8/4/2025	262.50	3
Switch	Planned Outage	8/4/2025	87.37	1
Switch	Planned Outage	8/4/2025	71.40	3
Breaker	Planned Outage	8/4/2025	25,041.60	1504
Breaker	Planned Outage	8/4/2025	16.73	1
Transformer	Planned Outage	8/4/2025	1,090.42	5
Transformer	Planned Outage	8/5/2025	1,481.67	7
Transformer Bank	Planned Outage	8/5/2025	59.45	1
Transformer Bank	Planned Outage	8/5/2025	118.25	3
Transformer Bank	Planned Outage	8/5/2025	151.50	3
Transformer	Planned Outage	8/5/2025	11.25	5
Transformer	Planned Outage	8/5/2025	29.55	3
TX Repaired (OH)	Planned Outage	8/5/2025	121.83	2
PLF	Planned Outage	8/5/2025	71.25	5
Transformer	Planned Outage	8/5/2025	69.58	1
Transformer	Planned Outage	8/5/2025	565.23	2
Transformer	Planned Outage	8/5/2025	1,336.65	9
Transformer Bank	Planned Outage	8/5/2025	288.20	2
Transformer	Planned Outage	8/5/2025	242.23	1
Transformer	Planned Outage	8/5/2025	395.97	7
Transformer	Planned Outage	8/5/2025	352.73	11
Transformer	Planned Outage	8/5/2025	819.80	2
Transformer	Planned Outage	8/5/2025	902.80	12
Transformer	Planned Outage	8/5/2025	79.93	2
Transformer	Planned Outage	8/5/2025	1,231.63	11

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Invalid	Planned Outage	8/5/2025	46.38	1
Transformer	Planned Outage	8/5/2025	12.25	5
Transformer	Planned Outage	8/5/2025	108.92	5
Transformer	Planned Outage	8/5/2025	3.17	1
Transformer	Planned Outage	8/5/2025	110.80	2
Transformer Bank	Planned Outage	8/5/2025	324.40	12
PLF	Planned Outage	8/5/2025	1,029.60	18
Transformer	Planned Outage	8/5/2025	37.07	4
PLF	Planned Outage	8/5/2025	252.40	4
PLF	Planned Outage	8/5/2025	7,949.52	131
PLF	Planned Outage	8/5/2025	61.78	1
Transformer	Planned Outage	8/5/2025	457.38	13
Transformer	Planned Outage	8/5/2025	1,672.75	15
Transformer	Planned Outage	8/5/2025	1,013.25	5
Transformer	Planned Outage	8/6/2025	261.92	7
None	Planned Outage	8/6/2025	312.32	1
Transformer	Planned Outage	8/6/2025	22.37	2
OH Other	Planned Outage	8/6/2025	104.95	3
Transformer	Planned Outage	8/6/2025	219.33	4
Transformer	Planned Outage	8/6/2025	5.65	3
Transformer	Planned Outage	8/6/2025	4.25	1
Transformer	Planned Outage	8/6/2025	160.70	1
None	Planned Outage	8/6/2025	351.67	5
Transformer	Planned Outage	8/6/2025	247.37	1
Transformer	Planned Outage	8/6/2025	9.10	1
None	Planned Outage	8/6/2025	3,169.40	39
Transformer	Planned Outage	8/6/2025	357.55	3
Transformer	Planned Outage	8/6/2025	704.27	8
Transformer	Planned Outage	8/6/2025	2,179.92	5
PLF	Planned Outage	8/6/2025	36.20	1
None	Planned Outage	8/6/2025	334.73	4
Transformer	Planned Outage	8/6/2025	58.57	1
PLF	Planned Outage	8/6/2025	229.80	6
PLF	Planned Outage	8/6/2025	126.35	1
Transformer	Planned Outage	8/6/2025	168.40	8
Primary Wire	Planned Outage	8/6/2025	3,907.20	37
Primary Wire	Planned Outage	8/6/2025	779.80	14
Transformer	Planned Outage	8/6/2025	2,610.30	14
Transformer	Planned Outage	8/7/2025	239.80	12
Transformer	Planned Outage	8/7/2025	48.47	4
Transformer	Planned Outage	8/7/2025	10.13	4
Transformer	Planned Outage	8/7/2025	111.22	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	8/7/2025	125.90	3
Transformer	Planned Outage	8/7/2025	85.52	7
Transformer Bank	Planned Outage	8/7/2025	37.47	1
Transformer	Planned Outage	8/7/2025	790.83	13
Transformer	Planned Outage	8/7/2025	12.32	1
Transformer	Planned Outage	8/7/2025	220.27	8
None	Planned Outage	8/7/2025	287.87	4
Transformer	Planned Outage	8/7/2025	259.70	6
Transformer	Planned Outage	8/7/2025	226.53	4
PLF	Planned Outage	8/7/2025	90.53	2
PLF	Planned Outage	8/7/2025	43.37	1
Transformer	Planned Outage	8/7/2025	173.27	4
Transformer	Planned Outage	8/7/2025	514.67	10
PLF	Planned Outage	8/7/2025	196.93	1
Transformer Bank	Planned Outage	8/7/2025	335.23	2
Transformer	Planned Outage	8/7/2025	104.13	4
Transformer	Planned Outage	8/7/2025	66.30	1
Transformer	Planned Outage	8/7/2025	114.87	4
Transformer	Planned Outage	8/7/2025	192.40	6
Transformer	Planned Outage	8/7/2025	98.40	9
PLF	Planned Outage	8/7/2025	476.67	8
None	Planned Outage	8/7/2025	1,334.85	11
None	Planned Outage	8/7/2025	1,330.63	11
Transformer	Planned Outage	8/7/2025	193.25	5
Breaker	Planned Outage	8/7/2025	22,457.60	528
Breaker	Planned Outage	8/7/2025	42.53	1
Breaker	Planned Outage	8/7/2025	1,356.00	60
Breaker	Planned Outage	8/7/2025	153.08	5
PLF	Planned Outage	8/7/2025	243.75	5
Breaker	Planned Outage	8/7/2025	23,092.83	635
Primary Wire	Planned Outage	8/7/2025	56,262.00	180
Breaker	Planned Outage	8/7/2025	15,820.00	1130
Breaker	Planned Outage	8/7/2025	15.27	1
Breaker	Planned Outage	8/7/2025	6.45	1
Breaker	Planned Outage	8/7/2025	4.53	1
Breaker	Planned Outage	8/7/2025	4.53	1
Breaker	Planned Outage	8/7/2025	6,206.13	1369
Breaker	Planned Outage	8/7/2025	6.45	1
Breaker	Planned Outage	8/7/2025	4.53	1
Breaker	Planned Outage	8/7/2025	4.53	1
Breaker	Planned Outage	8/7/2025	4.53	1
Breaker	Planned Outage	8/7/2025	4.53	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	8/8/2025	63.35	1
None	Planned Outage	8/8/2025	323.58	1
Transformer	Planned Outage	8/8/2025	162.00	1
Transformer	Planned Outage	8/8/2025	49.60	1
Transformer Bank	Planned Outage	8/8/2025	80.07	1
PLF	Planned Outage	8/8/2025	369.15	107
Transformer Bank	Planned Outage	8/8/2025	665.20	3
Transformer	Planned Outage	8/8/2025	149.22	1
Transformer	Planned Outage	8/8/2025	68.17	5
Transformer	Planned Outage	8/8/2025	32.73	1
Pole	Planned Outage	8/8/2025	5,650.67	20
Transformer Bank	Planned Outage	8/8/2025	4.62	1
Transformer	Planned Outage	8/8/2025	2,351.33	10
Transformer	Planned Outage	8/8/2025	326.10	9
Transformer	Planned Outage	8/8/2025	28.33	2
Transformer	Planned Outage	8/8/2025	134.53	8
Transformer	Planned Outage	8/8/2025	342.75	9
Pole	Planned Outage	8/8/2025	35.00	1
Transformer	Planned Outage	8/8/2025	1,217.88	13
Transformer	Planned Outage	8/8/2025	8.13	2
Transformer	Planned Outage	8/8/2025	12.07	2
Breaker	Planned Outage	8/8/2025	274,560.00	2304
Breaker	Planned Outage	8/8/2025	9,809.97	151
Breaker	Planned Outage	8/8/2025	20,367.25	1285
Switch	Planned Outage	8/8/2025	369,379.50	254
Transformer	Planned Outage	8/9/2025	582.08	1
Transformer	Planned Outage	8/9/2025	1,163.47	2
PLF	Planned Outage	8/9/2025	304.32	1
PLF	Planned Outage	8/9/2025	1,340.95	13
Transformer	Planned Outage	8/9/2025	127.63	2
Transformer	Planned Outage	8/9/2025	70.33	2
PLF	Planned Outage	8/9/2025	123.83	5
Transformer	Planned Outage	8/10/2025	34.00	5
None	Planned Outage	8/10/2025	1,357.33	20
PLF	Planned Outage	8/10/2025	353.10	11
None	Planned Outage	8/10/2025	878.80	169
Transformer	Planned Outage	8/10/2025	230.47	2
Transformer	Planned Outage	8/10/2025	115.25	3
Transformer	Planned Outage	8/10/2025	100.40	6
Transformer	Planned Outage	8/10/2025	54.10	6
Transformer	Planned Outage	8/10/2025	58.83	2
Transformer	Planned Outage	8/10/2025	523.67	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	8/11/2025	215.28	1
PLF	Planned Outage	8/11/2025	2,069.87	8
PLF	Planned Outage	8/11/2025	1,484.70	6
Transformer	Planned Outage	8/11/2025	131.60	4
Transformer	Planned Outage	8/11/2025	98.55	3
Service point	Planned Outage	8/11/2025	100.50	1
Transformer	Planned Outage	8/11/2025	106.50	1
Transformer	Planned Outage	8/11/2025	119.73	2
Transformer	Planned Outage	8/11/2025	25.85	1
None	Planned Outage	8/11/2025	963.20	21
Transformer	Planned Outage	8/11/2025	9.33	4
Transformer	Planned Outage	8/11/2025	234.47	2
Transformer	Planned Outage	8/11/2025	172.97	1
Transformer	Planned Outage	8/11/2025	758.25	15
Transformer	Planned Outage	8/11/2025	8.00	8
Transformer	Planned Outage	8/11/2025	343.70	3
Transformer	Planned Outage	8/11/2025	48.10	2
Switch	Planned Outage	8/11/2025	10,414.25	55
Breaker	Planned Outage	8/11/2025	7,908.27	128
Breaker	Planned Outage	8/11/2025	13.98	1
Breaker	Planned Outage	8/11/2025	52.20	1
Breaker	Planned Outage	8/11/2025	32,364.00	620
Breaker	Planned Outage	8/11/2025	2,942.13	68
Breaker	Planned Outage	8/11/2025	714.93	56
None	Planned Outage	8/11/2025	15.83	1
None	Planned Outage	8/11/2025	9,245.20	696
Breaker	Planned Outage	8/12/2025	65.60	1
Breaker	Planned Outage	8/12/2025	42,705.60	651
Transformer	Planned Outage	8/12/2025	1,412.53	8
Transformer	Planned Outage	8/12/2025	173.55	1
Primary Wire	Planned Outage	8/12/2025	4,181.67	10
Transformer	Planned Outage	8/12/2025	35.50	10
PLF	Planned Outage	8/12/2025	44.47	2
Transformer	Planned Outage	8/12/2025	561.37	22
Transformer	Planned Outage	8/12/2025	380.30	3
Transformer	Planned Outage	8/12/2025	377.45	1
None	Planned Outage	8/12/2025	10,498.25	49
Transformer	Planned Outage	8/12/2025	1,941.27	4
Transformer	Planned Outage	8/12/2025	151.72	1
Transformer	Planned Outage	8/12/2025	67.00	10
Transformer	Planned Outage	8/12/2025	351.50	1
Switch	Planned Outage	8/12/2025	322.12	77

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	8/12/2025	288.83	5
Transformer	Planned Outage	8/12/2025	310.35	9
Transformer	Planned Outage	8/12/2025	80.70	9
Transformer	Planned Outage	8/12/2025	36.63	7
Service - Crew	Planned Outage	8/12/2025	26.33	1
Transformer	Planned Outage	8/12/2025	558.50	10
None	Planned Outage	8/12/2025	163.00	6
Transformer	Planned Outage	8/12/2025	125.90	2
Transformer	Planned Outage	8/12/2025	73.50	7
Breaker	Planned Outage	8/12/2025	2,448.50	415
Breaker	Planned Outage	8/12/2025	5.65	1
Breaker	Planned Outage	8/12/2025	5.55	1
Service - Crew	Planned Outage	8/12/2025	98.00	1
Transformer	Planned Outage	8/12/2025	2,298.57	7
PLF	Planned Outage	8/12/2025	232.87	1
Transformer	Planned Outage	8/13/2025	500.55	9
Transformer Bank	Planned Outage	8/13/2025	31.70	3
Transformer	Planned Outage	8/13/2025	54.47	4
Switch	Planned Outage	8/13/2025	4,003.73	4
PLF	Planned Outage	8/13/2025	178.57	2
Transformer	Planned Outage	8/13/2025	55.03	1
Transformer	Planned Outage	8/13/2025	71.47	8
Transformer	Planned Outage	8/13/2025	236.00	8
Transformer	Planned Outage	8/13/2025	734.93	2
Transformer	Planned Outage	8/13/2025	85.28	17
Transformer	Planned Outage	8/13/2025	229.47	8
Transformer	Planned Outage	8/13/2025	46.50	6
Transformer	Planned Outage	8/13/2025	314.08	5
Transformer Bank	Planned Outage	8/13/2025	1,724.17	5
Transformer	Planned Outage	8/13/2025	4,409.80	34
Breaker	Planned Outage	8/13/2025	67,107.18	499
Transformer Bank	Planned Outage	8/13/2025	65.10	9
Invalid	Planned Outage	8/13/2025	13.75	3
PLF	Planned Outage	8/13/2025	646.93	1
Switch	Planned Outage	8/13/2025	10,001.07	256
Switch	Planned Outage	8/13/2025	14,194.45	23
Switch	Planned Outage	8/13/2025	143,827.02	233
PLF	Planned Outage	8/13/2025	142,929.97	233
Transformer	Planned Outage	8/13/2025	93.55	3
Transformer	Planned Outage	8/13/2025	18.37	2
Transformer	Planned Outage	8/13/2025	46.83	5
Transformer	Planned Outage	8/14/2025	11.67	10

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	8/14/2025	902.15	3
PLF	Planned Outage	8/14/2025	3,649.45	21
Transformer	Planned Outage	8/14/2025	511.60	4
None	Planned Outage	8/14/2025	542.75	5
Transformer	Planned Outage	8/14/2025	4,930.95	9
PLF	Planned Outage	8/14/2025	5,551.47	32
PLF	Planned Outage	8/14/2025	6,244.80	36
Transformer	Planned Outage	8/14/2025	375.17	5
Transformer	Planned Outage	8/14/2025	1,959.90	6
Transformer	Planned Outage	8/14/2025	1,632.58	5
Transformer	Planned Outage	8/14/2025	51.00	5
Transformer	Planned Outage	8/14/2025	63.67	5
PLF	Planned Outage	8/14/2025	23,469.75	45
PLF	Planned Outage	8/14/2025	26,616.05	51
Transformer Bank	Planned Outage	8/14/2025	16.40	6
Transformer	Planned Outage	8/14/2025	7.60	6
Invalid	Planned Outage	8/14/2025	260.98	7
Transformer	Planned Outage	8/14/2025	782.03	2
Transformer Bank	Planned Outage	8/14/2025	390.05	1
Transformer	Planned Outage	8/14/2025	559.00	6
TX Repaired (OH)	Planned Outage	8/14/2025	2,579.20	16
Transformer	Planned Outage	8/14/2025	302.25	5
Invalid	Planned Outage	8/14/2025	739.47	16
Transformer Bank	Planned Outage	8/14/2025	44.52	1
Transformer	Planned Outage	8/14/2025	297.73	7
Transformer	Planned Outage	8/14/2025	101.33	10
PLF	Planned Outage	8/14/2025	224.90	1
PLF	Planned Outage	8/14/2025	566.50	11
Transformer	Planned Outage	8/14/2025	55.27	1
Transformer	Planned Outage	8/15/2025	40.27	8
Transformer	Planned Outage	8/15/2025	254.80	12
Transformer	Planned Outage	8/15/2025	14.47	4
Transformer	Planned Outage	8/15/2025	24.35	3
Transformer	Planned Outage	8/15/2025	25.63	2
Transformer	Planned Outage	8/15/2025	1,340.80	4
Transformer	Planned Outage	8/15/2025	738.30	9
Transformer	Planned Outage	8/15/2025	4.38	1
Primary Wire	Planned Outage	8/15/2025	56.90	1
PLF	Planned Outage	8/15/2025	362.55	1
PLF	Planned Outage	8/15/2025	1,263.33	5
PLF	Planned Outage	8/15/2025	135.00	3
Transformer	Planned Outage	8/15/2025	122.47	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	8/16/2025	82.60	1
Transformer	Planned Outage	8/16/2025	82.45	1
Transformer	Planned Outage	8/16/2025	22.70	3
None	Planned Outage	8/16/2025	600.80	2
PLF	Planned Outage	8/16/2025	2,282.60	12
PLF	Planned Outage	8/16/2025	868.70	6
PLF	Planned Outage	8/16/2025	551.40	6
PLF	Planned Outage	8/16/2025	97.30	2
Transformer	Planned Outage	8/16/2025	20.83	2
Breaker	Planned Outage	8/16/2025	7.87	1
Breaker	Planned Outage	8/16/2025	7.87	1
Breaker	Planned Outage	8/16/2025	7.87	1
Breaker	Planned Outage	8/16/2025	21,507.47	2734
Breaker	Planned Outage	8/16/2025	24,229.80	1923
Breaker	Planned Outage	8/16/2025	13.57	1
PLF	Planned Outage	8/17/2025	10.50	3
Service - Crew	Planned Outage	8/17/2025	132.50	6
PLF	Planned Outage	8/17/2025	6,062.47	22
Transformer	Planned Outage	8/17/2025	5.10	2
Transformer	Planned Outage	8/17/2025	180.60	6
PLF	Planned Outage	8/17/2025	720.45	9
Transformer	Planned Outage	8/18/2025	69.22	1
Transformer Bank	Planned Outage	8/18/2025	32.85	1
Transformer Bank	Planned Outage	8/18/2025	217.35	3
Transformer	Planned Outage	8/18/2025	8.58	5
Transformer	Planned Outage	8/18/2025	182.75	5
Switch	Planned Outage	8/18/2025	25.85	1
Transformer	Planned Outage	8/18/2025	94.40	6
Transformer	Planned Outage	8/18/2025	483.60	8
Transformer	Planned Outage	8/18/2025	60.45	1
Transformer	Planned Outage	8/18/2025	39.57	2
Transformer Bank	Planned Outage	8/18/2025	863.60	6
PLF	Planned Outage	8/18/2025	106.25	5
Transformer	Planned Outage	8/18/2025	76.43	2
Transformer	Planned Outage	8/18/2025	31.00	3
Transformer	Planned Outage	8/18/2025	989.78	1
Transformer	Planned Outage	8/18/2025	372.07	4
Invalid	Planned Outage	8/18/2025	86.58	5
Transformer	Planned Outage	8/18/2025	523.60	4
None	Planned Outage	8/18/2025	453.27	52
None	Planned Outage	8/18/2025	51.68	1
None	Planned Outage	8/18/2025	51.72	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Switch	Planned Outage	8/18/2025	1,560.00	117
PLF	Planned Outage	8/18/2025	285.13	4
None	Planned Outage	8/18/2025	755.85	3
Transformer	Planned Outage	8/19/2025	30.75	9
Transformer	Planned Outage	8/19/2025	77.07	4
Transformer	Planned Outage	8/19/2025	117.65	3
Transformer	Planned Outage	8/19/2025	221.50	6
Transformer	Planned Outage	8/19/2025	407.20	4
Transformer	Planned Outage	8/19/2025	1,149.92	5
None	Planned Outage	8/19/2025	415.33	10
PLF	Planned Outage	8/19/2025	134.00	1
None	Planned Outage	8/19/2025	488.42	5
Transformer	Planned Outage	8/19/2025	1,319.15	21
Transformer	Planned Outage	8/19/2025	440.88	7
None	Planned Outage	8/19/2025	293.65	21
Transformer	Planned Outage	8/19/2025	31.67	4
None	Planned Outage	8/19/2025	1,702.13	13
Transformer	Planned Outage	8/19/2025	43.85	3
Transformer	Planned Outage	8/19/2025	54.33	2
Transformer	Planned Outage	8/19/2025	249.80	3
Transformer	Planned Outage	8/19/2025	205.33	7
Transformer	Planned Outage	8/19/2025	7.75	1
PLF	Planned Outage	8/19/2025	43.47	4
Invalid	Planned Outage	8/19/2025	123.27	4
PLF	Planned Outage	8/19/2025	28.40	3
Transformer	Planned Outage	8/19/2025	256.00	8
Transformer	Planned Outage	8/19/2025	304.10	1
Transformer	Planned Outage	8/19/2025	980.13	8
PLF	Planned Outage	8/19/2025	3,635.87	74
Transformer	Planned Outage	8/19/2025	98.43	2
Transformer	Planned Outage	8/19/2025	91.87	2
PLF	Planned Outage	8/19/2025	54.90	2
Transformer	Planned Outage	8/19/2025	66.22	1
Transformer	Planned Outage	8/19/2025	256.95	1
Transformer	Planned Outage	8/19/2025	43.82	1
Transformer	Planned Outage	8/20/2025	24.20	3
Transformer	Planned Outage	8/20/2025	98.47	14
Transformer	Planned Outage	8/20/2025	10.35	9
Transformer	Planned Outage	8/20/2025	17.20	2
None	Planned Outage	8/20/2025	259.75	3
Transformer	Planned Outage	8/20/2025	343.47	1
Transformer	Planned Outage	8/20/2025	3,245.70	18

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	8/20/2025	877.13	4
Transformer	Planned Outage	8/20/2025	413.30	3
Transformer	Planned Outage	8/20/2025	456.80	8
Transformer	Planned Outage	8/20/2025	5.07	2
Transformer	Planned Outage	8/20/2025	632.75	5
Transformer	Planned Outage	8/20/2025	183.33	8
Invalid	Planned Outage	8/20/2025	1,891.52	7
Transformer	Planned Outage	8/20/2025	294.42	1
OH Other	Planned Outage	8/20/2025	34.27	8
Transformer	Planned Outage	8/20/2025	121.17	1
Switch	Planned Outage	8/20/2025	291.63	1
None	Planned Outage	8/20/2025	1,050.33	20
Transformer	Planned Outage	8/20/2025	735.60	6
PLF	Planned Outage	8/20/2025	2,670.83	10
Transformer	Planned Outage	8/20/2025	12.35	3
Transformer	Planned Outage	8/20/2025	188.70	6
PLF	Planned Outage	8/20/2025	258.05	13
Transformer	Planned Outage	8/20/2025	294.07	4
Transformer	Planned Outage	8/20/2025	331.50	10
PLF	Planned Outage	8/20/2025	175.90	1
None	Planned Outage	8/20/2025	344.20	6
Transformer	Planned Outage	8/20/2025	15.95	1
Transformer	Planned Outage	8/20/2025	24.43	2
Breaker	Planned Outage	8/20/2025	5,435.60	1524
Breaker	Planned Outage	8/20/2025	3.55	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	87,726.60	1467
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	3.55	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Breaker	Planned Outage	8/20/2025	59.80	1
Transformer	Planned Outage	8/20/2025	201.85	1
Switch	Planned Outage	8/20/2025	58.55	3
Transformer Bank	Planned Outage	8/21/2025	647.55	3
Transformer	Planned Outage	8/21/2025	207.20	2
Transformer	Planned Outage	8/21/2025	838.20	6
Transformer	Planned Outage	8/21/2025	1,108.53	8
Transformer	Planned Outage	8/21/2025	139.47	1
PLF	Planned Outage	8/21/2025	143.92	1
Transformer	Planned Outage	8/21/2025	598.25	5
Transformer Bank	Planned Outage	8/21/2025	1,688.17	5
Transformer	Planned Outage	8/21/2025	249.78	1
Transformer	Planned Outage	8/21/2025	11.35	3
Transformer	Planned Outage	8/21/2025	1,109.10	6
Transformer	Planned Outage	8/21/2025	346.03	7
Transformer	Planned Outage	8/21/2025	8.30	6
Transformer	Planned Outage	8/21/2025	910.80	11
Transformer	Planned Outage	8/21/2025	69.23	1
Transformer	Planned Outage	8/21/2025	46.48	1
Transformer	Planned Outage	8/21/2025	148.05	9
None	Planned Outage	8/21/2025	509.47	8
Transformer Bank	Planned Outage	8/21/2025	55.60	2
None	Planned Outage	8/21/2025	972.90	9
Transformer Bank	Planned Outage	8/21/2025	1,530.50	6
PLF	Planned Outage	8/22/2025	403.15	11
PLF	Planned Outage	8/22/2025	341.50	2
PLF	Planned Outage	8/22/2025	1,626.33	10
Transformer Bank	Planned Outage	8/22/2025	8.60	1
PLF	Planned Outage	8/22/2025	532.60	12
Transformer	Planned Outage	8/22/2025	192.90	1
Transformer Bank	Planned Outage	8/22/2025	9.15	1
Transformer	Planned Outage	8/22/2025	101.90	3
Transformer	Planned Outage	8/22/2025	15.52	1
Transformer	Planned Outage	8/22/2025	422.80	3
Transformer	Planned Outage	8/22/2025	595.12	7
PLF	Planned Outage	8/22/2025	9,894.80	24

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	8/22/2025	828.60	6
PLF	Planned Outage	8/22/2025	246.17	1
Transformer	Planned Outage	8/22/2025	60.13	4
PLF	Planned Outage	8/22/2025	136.25	1
None	Planned Outage	8/22/2025	117.50	6
PLF	Planned Outage	8/22/2025	151.02	13
Transformer	Planned Outage	8/22/2025	103.00	4
Transformer	Planned Outage	8/22/2025	129.40	6
Transformer	Planned Outage	8/22/2025	34.13	4
Transformer	Planned Outage	8/22/2025	129.57	13
PLF	Planned Outage	8/22/2025	1,568.42	29
Transformer	Planned Outage	8/22/2025	10.40	4
None	Planned Outage	8/22/2025	121.33	35
PLF	Planned Outage	8/22/2025	103.32	1
Transformer	Planned Outage	8/22/2025	31.97	1
Transformer	Planned Outage	8/22/2025	2,388.55	23
Transformer	Planned Outage	8/22/2025	206.60	4
Transformer	Planned Outage	8/22/2025	41.48	1
Transformer	Planned Outage	8/22/2025	109.35	3
Transformer	Planned Outage	8/22/2025	59.93	4
Transformer	Planned Outage	8/22/2025	1,432.40	12
Transformer	Planned Outage	8/22/2025	929.83	7
PLF	Planned Outage	8/22/2025	262.97	2
Transformer	Planned Outage	8/22/2025	29.87	4
Service point	Planned Outage	8/23/2025	19.50	1
Transformer	Planned Outage	8/23/2025	853.53	4
Transformer	Planned Outage	8/23/2025	114.18	1
Transformer	Planned Outage	8/23/2025	15.25	5
PLF	Planned Outage	8/23/2025	91.18	1
PLF	Planned Outage	8/23/2025	142.07	1
None	Planned Outage	8/23/2025	2,085.87	8
PLF	Planned Outage	8/23/2025	11.70	3
None	Planned Outage	8/24/2025	6,365.25	369
Transformer	Planned Outage	8/24/2025	34.78	1
Transformer	Planned Outage	8/24/2025	115.70	6
Transformer	Planned Outage	8/24/2025	44.68	1
None	Planned Outage	8/24/2025	4,026.60	36
None	Planned Outage	8/24/2025	78.83	11
Switch	Planned Outage	8/24/2025	1,214.02	23
Transformer	Planned Outage	8/25/2025	189.10	1
Primary Wire	Planned Outage	8/25/2025	7,149.17	25
PLF	Planned Outage	8/25/2025	58.50	27

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	8/25/2025	248.45	1
PLF	Planned Outage	8/25/2025	33,020.48	113
Transformer	Planned Outage	8/25/2025	439.95	7
Transformer Bank	Planned Outage	8/25/2025	152.60	1
PLF	Planned Outage	8/25/2025	134.43	2
PLF	Planned Outage	8/25/2025	123.08	35
PLF	Planned Outage	8/25/2025	284.40	27
Transformer	Planned Outage	8/25/2025	53.00	5
PLF	Planned Outage	8/25/2025	343.07	2
Transformer Bank	Planned Outage	8/25/2025	340.25	1
PLF	Planned Outage	8/25/2025	1,726.00	8
Transformer	Planned Outage	8/25/2025	1,487.38	7
Transformer	Planned Outage	8/25/2025	770.67	5
Transformer	Planned Outage	8/26/2025	19.72	1
Breaker	Planned Outage	8/26/2025	3,616.30	841
Breaker	Planned Outage	8/26/2025	6.78	1
Breaker	Planned Outage	8/26/2025	6.78	1
Breaker	Planned Outage	8/26/2025	6.78	1
Transformer Bank	Planned Outage	8/26/2025	265.80	2
Transformer	Planned Outage	8/26/2025	1,336.15	3
PLF	Planned Outage	8/26/2025	11.20	7
None	Planned Outage	8/26/2025	205.02	1
Transformer	Planned Outage	8/26/2025	294.53	4
Transformer Bank	Planned Outage	8/26/2025	21.90	1
Switch	Planned Outage	8/26/2025	125.37	1
Transformer	Planned Outage	8/26/2025	1,653.17	26
Transformer	Planned Outage	8/26/2025	719.47	8
Transformer	Planned Outage	8/26/2025	145.32	1
Transformer	Planned Outage	8/26/2025	1,251.50	10
PLF	Planned Outage	8/26/2025	379.75	7
Transformer	Planned Outage	8/26/2025	211.25	1
Transformer	Planned Outage	8/26/2025	311.25	9
Transformer	Planned Outage	8/26/2025	144.20	6
Transformer	Planned Outage	8/26/2025	104.60	6
Transformer	Planned Outage	8/26/2025	284.15	3
Transformer	Planned Outage	8/26/2025	429.83	10
Transformer	Planned Outage	8/26/2025	189.65	3
Transformer	Planned Outage	8/26/2025	36.00	2
PLF	Planned Outage	8/26/2025	161.05	1
Transformer	Planned Outage	8/26/2025	300.83	5
Transformer	Planned Outage	8/26/2025	744.00	9
None	Planned Outage	8/26/2025	1,251.40	12

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	8/27/2025	17.27	7
Transformer	Planned Outage	8/27/2025	152.25	9
Transformer	Planned Outage	8/27/2025	304.40	8
Transformer Bank	Planned Outage	8/27/2025	369.03	1
Primary Wire	Planned Outage	8/27/2025	17,088.40	84
Transformer	Planned Outage	8/27/2025	492.30	2
Transformer Bank	Planned Outage	8/27/2025	90.72	1
PLF	Planned Outage	8/27/2025	330.60	57
Transformer Bank	Planned Outage	8/27/2025	282.15	1
Transformer	Planned Outage	8/27/2025	95.23	2
Transformer	Planned Outage	8/27/2025	104.58	5
Transformer	Planned Outage	8/27/2025	299.23	2
Transformer	Planned Outage	8/27/2025	32.32	1
Transformer	Planned Outage	8/27/2025	314.85	9
Transformer	Planned Outage	8/27/2025	214.62	1
Transformer	Planned Outage	8/27/2025	669.20	6
Transformer	Planned Outage	8/27/2025	524.27	4
Transformer	Planned Outage	8/27/2025	259.12	7
Service point	Planned Outage	8/27/2025	279.03	1
Transformer	Planned Outage	8/27/2025	64.87	14
Transformer	Planned Outage	8/27/2025	176.25	15
Transformer	Planned Outage	8/27/2025	22.70	1
Transformer	Planned Outage	8/27/2025	67.40	4
Transformer	Planned Outage	8/27/2025	8.33	5
Transformer	Planned Outage	8/27/2025	260.30	6
Transformer	Planned Outage	8/27/2025	305.08	7
Transformer	Planned Outage	8/27/2025	168.60	9
Transformer	Planned Outage	8/27/2025	67.10	3
Transformer	Planned Outage	8/27/2025	34.40	4
Transformer	Planned Outage	8/27/2025	19.88	1
Transformer	Planned Outage	8/27/2025	370.00	5
PLF	Planned Outage	8/27/2025	1,889.23	38
Transformer	Planned Outage	8/27/2025	1,741.83	7
PLF	Planned Outage	8/27/2025	1,827.70	6
Transformer	Planned Outage	8/27/2025	1,102.00	10
Transformer	Planned Outage	8/28/2025	305.78	7
Transformer	Planned Outage	8/28/2025	796.27	8
Transformer	Planned Outage	8/28/2025	1,532.10	6
PLF	Planned Outage	8/28/2025	180.73	2
Transformer	Planned Outage	8/28/2025	46.70	1
Transformer	Planned Outage	8/28/2025	61.72	1
PLF	Planned Outage	8/28/2025	2,200.42	25

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	8/28/2025	38.27	4
Transformer	Planned Outage	8/28/2025	113.65	1
Transformer	Planned Outage	8/28/2025	450.18	1
Transformer	Planned Outage	8/28/2025	32.45	1
None	Planned Outage	8/28/2025	2,182.78	19
Transformer	Planned Outage	8/28/2025	196.55	1
Transformer	Planned Outage	8/28/2025	162.63	1
None	Planned Outage	8/28/2025	936.25	15
None	Planned Outage	8/28/2025	107.00	60
PLF	Planned Outage	8/28/2025	9.70	3
PLF	Planned Outage	8/28/2025	1,370.00	75
Breaker	Planned Outage	8/28/2025	31,496.00	3937
None	Planned Outage	8/28/2025	174.88	7
None	Planned Outage	8/28/2025	252.63	11
PLF	Planned Outage	8/28/2025	332.33	10
Transformer	Planned Outage	8/28/2025	1,822.10	7
Transformer	Planned Outage	8/29/2025	395.08	5
Transformer Bank	Planned Outage	8/29/2025	30.77	2
Transformer Bank	Planned Outage	8/29/2025	1,326.40	6
Transformer Bank	Planned Outage	8/29/2025	154.28	1
Transformer	Planned Outage	8/29/2025	946.80	6
Transformer	Planned Outage	8/29/2025	59.75	5
Transformer	Planned Outage	8/29/2025	77.93	1
Transformer Bank	Planned Outage	8/29/2025	90.93	4
Transformer Bank	Planned Outage	8/29/2025	29.33	1
Transformer	Planned Outage	8/29/2025	3,584.63	31
Transformer	Planned Outage	8/29/2025	19.80	2
Transformer	Planned Outage	8/29/2025	31.22	1
Transformer	Planned Outage	8/29/2025	22.15	3
Transformer	Planned Outage	8/29/2025	68.80	2
Transformer	Planned Outage	8/29/2025	373.10	7
Transformer Bank	Planned Outage	8/29/2025	27.83	5
Transformer	Planned Outage	8/29/2025	3,233.75	15
Transformer	Planned Outage	8/30/2025	44.22	7
Transformer	Planned Outage	8/30/2025	16.97	2
Transformer Bank	Planned Outage	8/30/2025	108.60	9
Transformer	Planned Outage	8/30/2025	121.75	1
Transformer	Planned Outage	8/30/2025	41.85	1
Transformer	Planned Outage	8/30/2025	39.93	1
Transformer	Planned Outage	8/30/2025	24.15	9
Breaker	Planned Outage	8/30/2025	219.33	56
Breaker	Planned Outage	8/30/2025	219.33	56

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	8/30/2025	1,421.33	16
Transformer	Planned Outage	8/30/2025	32.37	1
Transformer	Planned Outage	8/31/2025	30.10	7
Transformer	Planned Outage	8/31/2025	15.87	4
Transformer	Planned Outage	8/31/2025	82.53	4
Transformer	Planned Outage	8/31/2025	124.30	6
Transformer	Planned Outage	8/31/2025	39.52	1
Transformer Bank	Planned Outage	8/31/2025	18.20	1
Transformer	Planned Outage	8/31/2025	494.00	8
Transformer	Planned Outage	8/31/2025	25.37	1
Transformer	Planned Outage	8/31/2025	7,228.83	11
Breaker	Planned Outage	8/31/2025	26,378.08	845
Breaker	Planned Outage	9/1/2025	16.53	1
Breaker	Planned Outage	9/1/2025	15.92	1
Breaker	Planned Outage	9/1/2025	10,386.67	656
Breaker	Planned Outage	9/1/2025	16.10	1
Breaker	Planned Outage	9/1/2025	16.20	1
Breaker	Planned Outage	9/1/2025	5,205.25	705
Breaker	Planned Outage	9/1/2025	16.00	1
Transformer	Planned Outage	9/1/2025	50.20	4
Switch	Planned Outage	9/1/2025	25,621.50	174
Switch	Planned Outage	9/1/2025	1,692.27	8
Switch	Planned Outage	9/1/2025	8,035.73	38
Switch	Planned Outage	9/1/2025	9,095.93	43
Switch	Planned Outage	9/1/2025	8,543.50	70
Transformer	Planned Outage	9/1/2025	41.45	1
Transformer	Planned Outage	9/1/2025	8.37	1
Transformer	Planned Outage	9/1/2025	7.08	1
Secondary Wire	Planned Outage	9/1/2025	1,363.70	6
Transformer Bank	Planned Outage	9/1/2025	9.02	1
PLF	Planned Outage	9/1/2025	201.47	2
Transformer	Planned Outage	9/1/2025	7.93	4
Transformer	Planned Outage	9/2/2025	61.30	2
Transformer	Planned Outage	9/2/2025	853.07	8
Primary Wire	Planned Outage	9/2/2025	114.25	15
Transformer	Planned Outage	9/2/2025	111.88	7
Transformer	Planned Outage	9/2/2025	1,556.20	6
Transformer Bank	Planned Outage	9/2/2025	208.82	1
Transformer	Planned Outage	9/2/2025	143.07	4
Transformer Bank	Planned Outage	9/2/2025	615.20	2
None	Planned Outage	9/2/2025	15.72	1
None	Planned Outage	9/2/2025	12,458.70	762

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/2/2025	151.13	1
Transformer	Planned Outage	9/2/2025	247.60	4
None	Planned Outage	9/2/2025	468.53	7
Transformer	Planned Outage	9/2/2025	3.10	3
Transformer	Planned Outage	9/2/2025	342.25	5
Transformer	Planned Outage	9/2/2025	75.07	1
PLF	Planned Outage	9/2/2025	310.03	2
PLF	Planned Outage	9/2/2025	59.23	2
Breaker	Planned Outage	9/2/2025	3,340.20	586
Breaker	Planned Outage	9/2/2025	5.98	1
Breaker	Planned Outage	9/2/2025	5.78	1
Breaker	Planned Outage	9/2/2025	5.75	1
Invalid	Planned Outage	9/2/2025	2,677.00	12
Transformer	Planned Outage	9/2/2025	41.83	10
Service point	Planned Outage	9/2/2025	62.07	1
Transformer Bank	Planned Outage	9/2/2025	400.88	1
Transformer	Planned Outage	9/3/2025	348.90	3
None	Planned Outage	9/3/2025	238.20	4
Transformer	Planned Outage	9/3/2025	2.35	1
Transformer	Planned Outage	9/3/2025	55.10	2
Transformer	Planned Outage	9/3/2025	101.90	3
Transformer Bank	Planned Outage	9/3/2025	1,135.60	3
Transformer	Planned Outage	9/3/2025	99.53	1
Transformer	Planned Outage	9/3/2025	1,031.10	3
Transformer	Planned Outage	9/3/2025	10.65	3
Transformer	Planned Outage	9/3/2025	739.75	3
None	Planned Outage	9/3/2025	4.93	1
None	Planned Outage	9/3/2025	78.93	16
Transformer	Planned Outage	9/3/2025	184.33	5
Transformer	Planned Outage	9/3/2025	240.53	2
Transformer	Planned Outage	9/3/2025	255.03	1
None	Planned Outage	9/3/2025	635.60	7
Transformer	Planned Outage	9/3/2025	15.58	1
Transformer	Planned Outage	9/3/2025	135.30	11
Transformer	Planned Outage	9/3/2025	763.33	8
None	Planned Outage	9/3/2025	1,744.27	31
None	Planned Outage	9/3/2025	328.00	4
Transformer	Planned Outage	9/3/2025	158.70	6
Transformer	Planned Outage	9/3/2025	128.60	3
Invalid	Planned Outage	9/3/2025	1,232.13	8
Transformer	Planned Outage	9/3/2025	104.20	6
Transformer Bank	Planned Outage	9/3/2025	12.40	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/3/2025	37.95	3
Transformer Bank	Planned Outage	9/3/2025	87.47	2
Transformer	Planned Outage	9/3/2025	545.15	3
Transformer Bank	Planned Outage	9/3/2025	40.13	1
Transformer	Planned Outage	9/3/2025	207.87	1
Transformer Bank	Planned Outage	9/4/2025	37.25	1
Transformer	Planned Outage	9/4/2025	20.57	1
Transformer Bank	Planned Outage	9/4/2025	25.20	4
None	Planned Outage	9/4/2025	56.45	1
Transformer	Planned Outage	9/4/2025	570.40	3
PLF	Planned Outage	9/4/2025	123.27	4
Transformer	Planned Outage	9/4/2025	14.80	1
Transformer	Planned Outage	9/4/2025	924.85	3
Transformer	Planned Outage	9/4/2025	45.80	3
Transformer Bank	Planned Outage	9/4/2025	67.27	1
Transformer	Planned Outage	9/4/2025	261.83	5
Transformer	Planned Outage	9/4/2025	40.60	3
Transformer	Planned Outage	9/4/2025	87.27	1
Transformer	Planned Outage	9/4/2025	1,034.42	5
Transformer Bank	Planned Outage	9/4/2025	147.77	1
Transformer	Planned Outage	9/4/2025	1,205.47	8
Transformer	Planned Outage	9/4/2025	173.22	1
Transformer	Planned Outage	9/4/2025	78.32	1
Transformer	Planned Outage	9/4/2025	106.67	4
Transformer	Planned Outage	9/4/2025	8.08	5
None	Planned Outage	9/4/2025	7,141.50	27
Transformer	Planned Outage	9/4/2025	12.73	1
Transformer	Planned Outage	9/4/2025	46.20	1
Transformer	Planned Outage	9/4/2025	41.43	1
PLF	Planned Outage	9/4/2025	550.50	5
Transformer	Planned Outage	9/4/2025	55.73	2
Transformer	Planned Outage	9/4/2025	11.55	1
Transformer	Planned Outage	9/4/2025	1,167.45	3
Transformer	Planned Outage	9/5/2025	24.27	1
Transformer	Planned Outage	9/5/2025	62.40	4
Transformer	Planned Outage	9/5/2025	110.33	4
Transformer	Planned Outage	9/5/2025	1,140.50	5
Transformer Bank	Planned Outage	9/5/2025	41.12	1
PLF	Planned Outage	9/5/2025	356.08	1
Transformer	Planned Outage	9/5/2025	4.00	2
Transformer	Planned Outage	9/5/2025	540.80	4
Transformer	Planned Outage	9/5/2025	360.62	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	9/5/2025	130.35	1
Transformer	Planned Outage	9/5/2025	32.40	8
Transformer	Planned Outage	9/5/2025	662.55	7
Transformer	Planned Outage	9/5/2025	106.10	1
Transformer	Planned Outage	9/5/2025	9.62	1
Transformer	Planned Outage	9/5/2025	2,317.80	4
Primary Wire	Planned Outage	9/5/2025	1,196.25	15
Primary Wire	Planned Outage	9/5/2025	17,126.08	35
Transformer Bank	Planned Outage	9/5/2025	74.80	3
Transformer	Planned Outage	9/5/2025	3.73	1
Transformer	Planned Outage	9/6/2025	36.52	7
None	Planned Outage	9/6/2025	2,988.67	10
Transformer	Planned Outage	9/6/2025	233.97	1
PLF	Planned Outage	9/6/2025	237.22	1
Transformer	Planned Outage	9/6/2025	3,058.53	7
PLF	Planned Outage	9/6/2025	357.80	1
Transformer	Planned Outage	9/6/2025	31.92	5
Transformer	Planned Outage	9/6/2025	35.35	3
Transformer	Planned Outage	9/6/2025	27.00	2
Transformer	Planned Outage	9/6/2025	54.60	7
Transformer	Planned Outage	9/7/2025	716.60	12
Transformer	Planned Outage	9/7/2025	1,436.50	5
Transformer Bank	Planned Outage	9/7/2025	39.27	1
Transformer Bank	Planned Outage	9/7/2025	6.23	2
Transformer	Planned Outage	9/7/2025	5.63	2
Transformer	Planned Outage	9/7/2025	89.90	2
Transformer	Planned Outage	9/8/2025	8,551.67	25
Transformer Bank	Planned Outage	9/8/2025	234.07	4
Transformer	Planned Outage	9/8/2025	513.25	3
Transformer	Planned Outage	9/8/2025	56.57	1
Transformer	Planned Outage	9/8/2025	384.47	1
Transformer	Planned Outage	9/8/2025	1,026.67	4
Transformer	Planned Outage	9/8/2025	3,096.60	12
Transformer	Planned Outage	9/8/2025	73.97	1
Transformer	Planned Outage	9/8/2025	477.10	2
Transformer	Planned Outage	9/8/2025	861.87	8
PLF	Planned Outage	9/8/2025	252.83	10
Transformer	Planned Outage	9/8/2025	26.10	3
Transformer	Planned Outage	9/8/2025	16.45	7
Transformer	Planned Outage	9/8/2025	7.23	7
Transformer	Planned Outage	9/8/2025	9.10	7
Transformer	Planned Outage	9/8/2025	10.97	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/8/2025	12.72	7
Transformer	Planned Outage	9/8/2025	17.15	7
Transformer Bank	Planned Outage	9/8/2025	267.60	9
Transformer	Planned Outage	9/8/2025	768.95	7
Transformer	Planned Outage	9/8/2025	140.60	2
Service - Crew	Planned Outage	9/8/2025	38.22	1
Service point	Planned Outage	9/8/2025	31.77	1
None	Planned Outage	9/8/2025	469.10	6
Primary Wire	Planned Outage	9/8/2025	523.00	12
Primary Wire	Planned Outage	9/8/2025	175.00	25
Transformer Bank	Planned Outage	9/8/2025	618.10	2
Transformer	Planned Outage	9/8/2025	10.27	4
Transformer	Planned Outage	9/8/2025	2,063.10	6
Transformer	Planned Outage	9/9/2025	27.27	2
Transformer	Planned Outage	9/9/2025	31.12	1
Transformer	Planned Outage	9/9/2025	808.32	11
Transformer	Planned Outage	9/9/2025	178.37	1
PLF	Planned Outage	9/9/2025	6,264.90	27
PLF	Planned Outage	9/9/2025	232.03	1
Transformer	Planned Outage	9/9/2025	287.33	5
Transformer	Planned Outage	9/9/2025	178.97	7
Transformer Bank	Planned Outage	9/9/2025	11.68	1
Transformer Bank	Planned Outage	9/9/2025	320.40	4
Transformer	Planned Outage	9/9/2025	92.13	2
Transformer Bank	Planned Outage	9/9/2025	92.23	1
Transformer	Planned Outage	9/9/2025	155.40	6
PLF	Planned Outage	9/9/2025	699.30	3
PLF	Planned Outage	9/9/2025	93.92	23
Transformer	Planned Outage	9/9/2025	256.83	5
Transformer	Planned Outage	9/9/2025	1,091.67	10
Service point	Planned Outage	9/9/2025	1,477.37	41
Transformer	Planned Outage	9/9/2025	1,210.17	5
PLF	Planned Outage	9/9/2025	17,202.25	79
Transformer	Planned Outage	9/9/2025	5.23	2
Transformer	Planned Outage	9/9/2025	300.50	10
Transformer	Planned Outage	9/9/2025	37.17	5
Transformer	Planned Outage	9/9/2025	97.72	13
Transformer	Planned Outage	9/9/2025	206.80	2
None	Planned Outage	9/9/2025	5,244.53	71
Transformer	Planned Outage	9/9/2025	116.03	2
PLF	Planned Outage	9/9/2025	628.40	24
Transformer	Planned Outage	9/9/2025	537.60	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	9/9/2025	558,000.55	1159
None	Planned Outage	9/9/2025	125,658.45	261
None	Planned Outage	9/9/2025	557,015.40	1159
None	Planned Outage	9/9/2025	531,063.00	1105
None	Planned Outage	9/9/2025	480.60	1
None	Planned Outage	9/9/2025	532,002.25	1105
None	Planned Outage	9/9/2025	481.45	1
Invalid	Planned Outage	9/9/2025	186.42	5
Transformer Bank	Planned Outage	9/10/2025	257.50	3
Transformer Bank	Planned Outage	9/10/2025	28.55	1
Transformer Bank	Planned Outage	9/10/2025	1,230.60	9
Transformer	Planned Outage	9/10/2025	1,250.45	3
Transformer	Planned Outage	9/10/2025	957.75	9
Transformer	Planned Outage	9/10/2025	281.80	6
Switch	Planned Outage	9/10/2025	1,346.83	5
PLF	Planned Outage	9/10/2025	745.13	2
Transformer	Planned Outage	9/10/2025	329.40	3
PLF	Planned Outage	9/10/2025	4,151.97	17
Switch	Planned Outage	9/10/2025	16,035.30	81
PLF	Planned Outage	9/10/2025	917.07	4
PLF	Planned Outage	9/10/2025	182.87	26
Transformer	Planned Outage	9/10/2025	397.75	5
Transformer Bank	Planned Outage	9/10/2025	402.07	1
Transformer	Planned Outage	9/10/2025	219.20	8
Transformer	Planned Outage	9/10/2025	2,744.80	12
Transformer	Planned Outage	9/10/2025	2,724.40	12
Transformer	Planned Outage	9/10/2025	1,376.32	7
Transformer	Planned Outage	9/10/2025	1,624.00	7
Transformer	Planned Outage	9/10/2025	275.80	7
Transformer	Planned Outage	9/10/2025	110.80	8
Transformer	Planned Outage	9/10/2025	183.00	12
PLF	Planned Outage	9/10/2025	3,369.77	43
Transformer Bank	Planned Outage	9/10/2025	392.50	1
PLF	Planned Outage	9/10/2025	309.10	6
Transformer	Planned Outage	9/10/2025	356.18	1
Transformer	Planned Outage	9/10/2025	178.00	6
None	Planned Outage	9/11/2025	3,120.00	25
Transformer	Planned Outage	9/11/2025	251.17	5
Transformer	Planned Outage	9/11/2025	1,191.45	9
PLF	Planned Outage	9/11/2025	150.87	2
Invalid	Planned Outage	9/11/2025	2,038.50	27
Invalid	Planned Outage	9/11/2025	284.03	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	9/11/2025	12,088.80	27
Invalid	Planned Outage	9/11/2025	1,347.20	6
Transformer Bank	Planned Outage	9/11/2025	41.65	3
None	Planned Outage	9/11/2025	565.60	21
None	Planned Outage	9/11/2025	107.25	45
Transformer	Planned Outage	9/11/2025	258.77	7
Transformer	Planned Outage	9/11/2025	409.90	3
Transformer	Planned Outage	9/11/2025	18.73	1
Transformer	Planned Outage	9/11/2025	665.80	2
Transformer	Planned Outage	9/11/2025	151.50	2
PLF	Planned Outage	9/11/2025	367.97	2
Transformer	Planned Outage	9/11/2025	174.50	6
Transformer	Planned Outage	9/11/2025	114.07	4
Transformer Bank	Planned Outage	9/11/2025	739.63	1
None	Planned Outage	9/11/2025	4,555.83	50
Transformer	Planned Outage	9/11/2025	1,392.93	4
Transformer	Planned Outage	9/11/2025	442.93	11
Service point	Planned Outage	9/11/2025	56.17	1
Transformer	Planned Outage	9/11/2025	182.10	3
Transformer	Planned Outage	9/11/2025	146.10	9
Transformer	Planned Outage	9/11/2025	366.92	7
Transformer	Planned Outage	9/11/2025	31.67	2
Transformer	Planned Outage	9/11/2025	24.72	1
None	Planned Outage	9/11/2025	6,166.77	38
PLF	Planned Outage	9/11/2025	839.33	10
Transformer	Planned Outage	9/11/2025	39.02	1
None	Planned Outage	9/11/2025	482.53	7
Transformer	Planned Outage	9/11/2025	133.37	2
Transformer Bank	Planned Outage	9/11/2025	216.28	1
Transformer Bank	Planned Outage	9/11/2025	89.20	2
Transformer	Planned Outage	9/12/2025	866.67	10
Transformer	Planned Outage	9/12/2025	31.57	2
Transformer	Planned Outage	9/12/2025	58.80	3
Transformer	Planned Outage	9/12/2025	20.40	1
Service point	Planned Outage	9/12/2025	171.12	1
Transformer	Planned Outage	9/12/2025	103.33	4
Transformer	Planned Outage	9/12/2025	82.05	3
Transformer	Planned Outage	9/12/2025	62.43	1
Transformer	Planned Outage	9/12/2025	183.70	2
Transformer	Planned Outage	9/12/2025	2,271.60	8
Transformer	Planned Outage	9/12/2025	1,000.42	5
Transformer	Planned Outage	9/12/2025	301.83	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	9/12/2025	6,826.67	1600
Breaker	Planned Outage	9/12/2025	4.27	1
Breaker	Planned Outage	9/12/2025	4.27	1
Breaker	Planned Outage	9/12/2025	4.27	1
Breaker	Planned Outage	9/12/2025	4.27	1
Breaker	Planned Outage	9/12/2025	4.27	1
Transformer	Planned Outage	9/12/2025	737.83	19
Transformer	Planned Outage	9/12/2025	1.48	1
Transformer Bank	Planned Outage	9/12/2025	40.67	2
Transformer Bank	Planned Outage	9/12/2025	9.48	1
Transformer	Planned Outage	9/12/2025	410.55	9
Transformer Bank	Planned Outage	9/12/2025	223.47	1
Transformer	Planned Outage	9/12/2025	9.77	1
Transformer	Planned Outage	9/12/2025	153.25	3
Transformer	Planned Outage	9/12/2025	76.75	5
Transformer	Planned Outage	9/12/2025	25.72	1
Transformer	Planned Outage	9/12/2025	54.02	1
Transformer Bank	Planned Outage	9/12/2025	80.10	2
Transformer	Planned Outage	9/12/2025	103.40	4
Transformer	Planned Outage	9/13/2025	13.57	2
Transformer	Planned Outage	9/13/2025	35.10	2
Transformer	Planned Outage	9/13/2025	30.57	7
Transformer	Planned Outage	9/13/2025	163.00	6
PLF	Planned Outage	9/13/2025	2.47	1
Transformer Bank	Planned Outage	9/13/2025	251.70	2
Primary Wire	Planned Outage	9/13/2025	9,098.00	20
Transformer Bank	Planned Outage	9/13/2025	173.93	4
Transformer	Planned Outage	9/13/2025	131.93	4
Transformer	Planned Outage	9/13/2025	43.10	1
Transformer	Planned Outage	9/13/2025	138.20	3
Transformer	Planned Outage	9/13/2025	6.53	1
Transformer	Planned Outage	9/13/2025	63.20	6
Transformer	Planned Outage	9/13/2025	51.55	1
Transformer	Planned Outage	9/13/2025	101.00	4
Transformer	Planned Outage	9/13/2025	830.20	7
Transformer	Planned Outage	9/13/2025	200.92	5
Transformer	Planned Outage	9/13/2025	15.00	2
Transformer	Planned Outage	9/13/2025	28.05	1
PLF	Planned Outage	9/13/2025	21.48	1
Transformer	Planned Outage	9/13/2025	749.40	4
Transformer Bank	Planned Outage	9/13/2025	33.30	1
Transformer	Planned Outage	9/14/2025	18.90	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/14/2025	52.40	6
Transformer	Planned Outage	9/14/2025	47.42	5
Transformer Bank	Planned Outage	9/14/2025	133.50	5
Transformer Bank	Planned Outage	9/14/2025	28.80	1
Transformer	Planned Outage	9/14/2025	31.03	1
Transformer	Planned Outage	9/14/2025	20.43	1
Transformer Bank	Planned Outage	9/14/2025	367.65	3
PLF	Planned Outage	9/14/2025	24.57	11
Transformer	Planned Outage	9/14/2025	186.00	9
Transformer	Planned Outage	9/14/2025	148.70	3
Transformer	Planned Outage	9/14/2025	28.20	3
Transformer	Planned Outage	9/14/2025	69.27	2
Transformer	Planned Outage	9/14/2025	93.90	3
Transformer	Planned Outage	9/14/2025	42.30	2
Transformer	Planned Outage	9/14/2025	36.10	1
Transformer	Planned Outage	9/14/2025	46.58	1
Transformer	Planned Outage	9/14/2025	32.92	1
Transformer	Planned Outage	9/14/2025	28.38	1
Switch	Planned Outage	9/14/2025	160.65	1
Transformer Bank	Planned Outage	9/15/2025	332.15	7
Transformer	Planned Outage	9/15/2025	84.28	13
Transformer	Planned Outage	9/15/2025	141.30	6
Transformer	Planned Outage	9/15/2025	24.00	4
Transformer	Planned Outage	9/15/2025	25.50	6
Transformer	Planned Outage	9/15/2025	65.73	2
Transformer	Planned Outage	9/15/2025	14.25	1
Transformer	Planned Outage	9/15/2025	40.17	10
Invalid	Planned Outage	9/15/2025	33.35	1
Transformer	Planned Outage	9/15/2025	33.00	5
Transformer	Planned Outage	9/15/2025	592.80	6
Transformer	Planned Outage	9/15/2025	336.20	2
Transformer	Planned Outage	9/15/2025	102.80	6
Transformer	Planned Outage	9/15/2025	2,982.80	12
PLF	Planned Outage	9/15/2025	688.53	4
Transformer	Planned Outage	9/15/2025	820.45	3
Transformer	Planned Outage	9/15/2025	855.83	5
Transformer	Planned Outage	9/15/2025	504.87	2
PLF	Planned Outage	9/15/2025	168.57	2
PLF	Planned Outage	9/15/2025	395.70	1
Transformer	Planned Outage	9/15/2025	206.27	8
Transformer	Planned Outage	9/15/2025	151.60	3
Transformer	Planned Outage	9/15/2025	93.55	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	9/15/2025	73.10	1
Transformer	Planned Outage	9/15/2025	108.40	1
Transformer	Planned Outage	9/15/2025	216.07	2
Transformer	Planned Outage	9/15/2025	86.95	1
Invalid	Planned Outage	9/15/2025	132.47	4
Transformer	Planned Outage	9/15/2025	1,598.68	7
Transformer	Planned Outage	9/15/2025	3.80	2
Transformer	Planned Outage	9/15/2025	577.60	12
Transformer	Planned Outage	9/15/2025	24.60	2
None	Planned Outage	9/15/2025	529.80	9
Transformer	Planned Outage	9/15/2025	118.95	13
Transformer	Planned Outage	9/15/2025	31.05	1
Transformer	Planned Outage	9/16/2025	103.53	4
Transformer	Planned Outage	9/16/2025	45.03	2
Transformer Bank	Planned Outage	9/16/2025	32.92	1
Transformer	Planned Outage	9/16/2025	46.87	1
Primary Wire	Planned Outage	9/16/2025	501.38	67
Transformer	Planned Outage	9/16/2025	28.67	1
Transformer	Planned Outage	9/16/2025	43.43	2
Transformer	Planned Outage	9/16/2025	36.50	3
Transformer	Planned Outage	9/16/2025	25.17	2
PLF	Planned Outage	9/16/2025	146.43	1
Transformer	Planned Outage	9/16/2025	368.80	1
Transformer	Planned Outage	9/16/2025	402.50	6
PLF	Planned Outage	9/16/2025	397.28	1
Breaker	Planned Outage	9/16/2025	12,925.90	2379
Transformer	Planned Outage	9/16/2025	3,759.60	12
Transformer	Planned Outage	9/16/2025	357.93	2
Transformer	Planned Outage	9/16/2025	2,634.25	15
Transformer	Planned Outage	9/16/2025	71.10	2
Transformer	Planned Outage	9/16/2025	16.20	12
PLF	Planned Outage	9/16/2025	181.42	1
Transformer	Planned Outage	9/16/2025	423.07	2
Transformer	Planned Outage	9/16/2025	237.07	7
Transformer	Planned Outage	9/16/2025	42.95	3
Transformer	Planned Outage	9/16/2025	172.12	1
Transformer	Planned Outage	9/16/2025	25.40	1
Transformer	Planned Outage	9/16/2025	121.17	5
None	Planned Outage	9/16/2025	540.80	8
PLF	Planned Outage	9/16/2025	174.35	33
Transformer	Planned Outage	9/16/2025	146.13	16
Service - Crew	Planned Outage	9/16/2025	324.90	9

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	9/16/2025	265.90	3
Transformer	Planned Outage	9/16/2025	43.80	2
Transformer	Planned Outage	9/16/2025	1,242.00	10
Transformer	Planned Outage	9/16/2025	1,122.10	7
Transformer	Planned Outage	9/16/2025	22.40	7
Transformer	Planned Outage	9/16/2025	869.00	4
PLF	Planned Outage	9/16/2025	45,791.20	112
Transformer	Planned Outage	9/17/2025	50.20	1
Transformer	Planned Outage	9/17/2025	3,504.00	10
Transformer	Planned Outage	9/17/2025	711.42	5
Transformer	Planned Outage	9/17/2025	532.25	15
Transformer	Planned Outage	9/17/2025	7.20	3
Transformer	Planned Outage	9/17/2025	127.87	7
Transformer	Planned Outage	9/17/2025	1,299.78	7
Transformer Bank	Planned Outage	9/17/2025	100.95	1
UG Other	Planned Outage	9/17/2025	186.18	1
PLF	Planned Outage	9/17/2025	10,794.60	36
Transformer	Planned Outage	9/17/2025	147.07	4
Service point	Planned Outage	9/17/2025	60.52	1
Transformer	Planned Outage	9/17/2025	403.00	13
PLF	Planned Outage	9/17/2025	51.78	1
PLF	Planned Outage	9/17/2025	5,319.17	26
Transformer	Planned Outage	9/17/2025	162.98	7
Invalid	Planned Outage	9/17/2025	302.87	7
Transformer	Planned Outage	9/17/2025	1,817.70	6
Transformer	Planned Outage	9/17/2025	571.73	16
Transformer	Planned Outage	9/17/2025	550.40	16
Transformer	Planned Outage	9/17/2025	139.70	2
Transformer	Planned Outage	9/17/2025	31.57	2
Transformer	Planned Outage	9/17/2025	786.33	7
Transformer	Planned Outage	9/17/2025	94.20	3
Transformer	Planned Outage	9/17/2025	170.58	5
Transformer	Planned Outage	9/17/2025	12.80	4
Transformer	Planned Outage	9/17/2025	375.85	3
None	Planned Outage	9/17/2025	103.02	1
Transformer	Planned Outage	9/17/2025	2,249.22	13
Transformer	Planned Outage	9/17/2025	142.55	3
Transformer	Planned Outage	9/17/2025	301.27	2
PLF	Planned Outage	9/17/2025	317.30	3
Transformer	Planned Outage	9/17/2025	646.53	8
Transformer	Planned Outage	9/17/2025	388.00	6
PLF	Planned Outage	9/17/2025	70.88	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/17/2025	23.20	4
Transformer	Planned Outage	9/17/2025	79.00	5
Transformer	Planned Outage	9/17/2025	39.08	7
Transformer	Planned Outage	9/17/2025	19.20	4
Transformer	Planned Outage	9/17/2025	55.40	12
Transformer	Planned Outage	9/17/2025	2,758.82	7
Transformer	Planned Outage	9/17/2025	98.50	15
Transformer Bank	Planned Outage	9/17/2025	607.47	2
Transformer	Planned Outage	9/18/2025	12.12	1
Transformer	Planned Outage	9/18/2025	15.08	1
Transformer	Planned Outage	9/18/2025	204.67	10
PLF	Planned Outage	9/18/2025	162.47	2
Transformer	Planned Outage	9/18/2025	89.48	1
Transformer Bank	Planned Outage	9/18/2025	276.20	2
Transformer	Planned Outage	9/18/2025	2,116.27	16
Transformer	Planned Outage	9/18/2025	146.17	5
Transformer Bank	Planned Outage	9/18/2025	20.30	1
Transformer	Planned Outage	9/18/2025	213.85	7
Transformer	Planned Outage	9/18/2025	1,327.30	6
PLF	Planned Outage	9/18/2025	2,666.40	18
PLF	Planned Outage	9/18/2025	12,418.50	102
Transformer	Planned Outage	9/18/2025	1,258.90	6
Transformer	Planned Outage	9/18/2025	1,657.58	5
Transformer	Planned Outage	9/18/2025	66.10	6
Transformer	Planned Outage	9/18/2025	508.42	5
PLF	Planned Outage	9/18/2025	1,705.32	7
Transformer	Planned Outage	9/18/2025	763.47	4
Transformer	Planned Outage	9/18/2025	10.07	4
None	Planned Outage	9/18/2025	37.57	1
Transformer	Planned Outage	9/18/2025	192.20	2
None	Planned Outage	9/18/2025	753.50	6
Service - Crew	Planned Outage	9/18/2025	479.08	1
None	Planned Outage	9/18/2025	660.30	6
PLF	Planned Outage	9/18/2025	39.60	2
Transformer Bank	Planned Outage	9/18/2025	1,053.77	2
PLF	Planned Outage	9/18/2025	159.28	1
Transformer	Planned Outage	9/18/2025	36.73	1
Transformer	Planned Outage	9/18/2025	73.03	2
Transformer	Planned Outage	9/18/2025	50.87	2
Transformer	Planned Outage	9/18/2025	440.85	3
Transformer	Planned Outage	9/18/2025	1,252.17	5
Transformer Bank	Planned Outage	9/18/2025	229.58	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/19/2025	1,804.50	9
Transformer	Planned Outage	9/19/2025	5,415.35	17
Transformer	Planned Outage	9/19/2025	362.13	8
Transformer	Planned Outage	9/19/2025	207.35	3
Transformer	Planned Outage	9/19/2025	216.87	1
PLF	Planned Outage	9/19/2025	91.23	46
PLF	Planned Outage	9/19/2025	146.77	74
PLF	Planned Outage	9/19/2025	770.40	24
Transformer	Planned Outage	9/19/2025	405.07	4
Transformer	Planned Outage	9/19/2025	58.67	2
Transformer	Planned Outage	9/19/2025	402.73	4
Transformer	Planned Outage	9/19/2025	746.20	3
Transformer	Planned Outage	9/19/2025	8.43	2
Primary Wire	Planned Outage	9/19/2025	734.30	42
Transformer	Planned Outage	9/19/2025	2,030.53	8
Transformer	Planned Outage	9/19/2025	47.40	4
PLF	Planned Outage	9/19/2025	6.50	2
Transformer	Planned Outage	9/19/2025	135.68	7
Transformer	Planned Outage	9/19/2025	213.50	6
Primary Wire	Planned Outage	9/19/2025	274.27	2
Transformer	Planned Outage	9/20/2025	841.20	8
PLF	Planned Outage	9/20/2025	224.63	1
None	Planned Outage	9/20/2025	1,871.10	11
None	Planned Outage	9/20/2025	267.87	8
Transformer	Planned Outage	9/20/2025	29.20	2
Transformer	Planned Outage	9/20/2025	6.27	4
Transformer	Planned Outage	9/20/2025	117.10	3
Primary Wire	Planned Outage	9/20/2025	151.77	2
Transformer	Planned Outage	9/20/2025	12.25	1
Transformer	Planned Outage	9/20/2025	112.20	4
None	Planned Outage	9/21/2025	431.83	5
Transformer	Planned Outage	9/21/2025	122.00	10
Transformer	Planned Outage	9/21/2025	90.20	11
Transformer	Planned Outage	9/21/2025	2,012.25	15
Invalid	Planned Outage	9/21/2025	421.92	5
Transformer	Planned Outage	9/21/2025	211.20	11
Transformer	Planned Outage	9/21/2025	22.52	1
Invalid	Planned Outage	9/22/2025	992.60	4
Transformer	Planned Outage	9/22/2025	697.17	5
Transformer	Planned Outage	9/22/2025	11,373.00	34
Transformer	Planned Outage	9/22/2025	121.33	7
Transformer	Planned Outage	9/22/2025	8.45	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/22/2025	297.38	7
Transformer	Planned Outage	9/22/2025	24.38	7
Transformer Bank	Planned Outage	9/22/2025	122.25	1
PLF	Planned Outage	9/22/2025	291.70	1
Transformer	Planned Outage	9/22/2025	30.00	3
PLF	Planned Outage	9/22/2025	2,114.20	12
PLF	Planned Outage	9/22/2025	2.03	1
Transformer	Planned Outage	9/22/2025	165.20	7
Transformer	Planned Outage	9/22/2025	18.13	4
Transformer Bank	Planned Outage	9/22/2025	57.53	1
Transformer	Planned Outage	9/22/2025	132.80	4
Transformer	Planned Outage	9/22/2025	89.58	5
Transformer	Planned Outage	9/22/2025	351.40	28
Transformer Bank	Planned Outage	9/22/2025	481.42	1
Transformer Bank	Planned Outage	9/22/2025	31.13	1
Transformer	Planned Outage	9/22/2025	129.95	3
Transformer	Planned Outage	9/22/2025	30.87	1
Transformer Bank	Planned Outage	9/22/2025	329.40	1
None	Planned Outage	9/22/2025	1,255.00	10
Transformer	Planned Outage	9/22/2025	161.40	6
Transformer	Planned Outage	9/22/2025	10.15	7
Transformer Bank	Planned Outage	9/22/2025	114.45	9
None	Planned Outage	9/23/2025	176.13	8
Transformer	Planned Outage	9/23/2025	574.00	6
Transformer	Planned Outage	9/23/2025	52.80	36
Transformer	Planned Outage	9/23/2025	818.55	9
Transformer Bank	Planned Outage	9/23/2025	53.80	1
Transformer	Planned Outage	9/23/2025	530.93	8
Transformer	Planned Outage	9/23/2025	781.25	3
Transformer	Planned Outage	9/23/2025	3,009.00	9
Transformer	Planned Outage	9/23/2025	561.75	9
PLF	Planned Outage	9/23/2025	961.02	23
Transformer	Planned Outage	9/23/2025	253.47	1
Transformer	Planned Outage	9/23/2025	821.20	3
Transformer	Planned Outage	9/23/2025	828.70	3
Transformer	Planned Outage	9/23/2025	2,577.20	17
Transformer	Planned Outage	9/23/2025	7,102.80	24
Transformer	Planned Outage	9/23/2025	300.17	1
Transformer	Planned Outage	9/23/2025	96.17	2
Transformer Bank	Planned Outage	9/23/2025	2,277.57	14
PLF	Planned Outage	9/23/2025	1,123.73	7
Transformer	Planned Outage	9/23/2025	1,508.27	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	9/23/2025	16.97	1
Transformer	Planned Outage	9/23/2025	1,508.80	16
Transformer	Planned Outage	9/23/2025	2.67	2
Breaker	Planned Outage	9/23/2025	8,489.90	1163
Breaker	Planned Outage	9/23/2025	7.92	1
Breaker	Planned Outage	9/23/2025	7.92	1
Meter Damaged	Planned Outage	9/23/2025	53.73	2
Transformer Bank	Planned Outage	9/23/2025	132.80	4
Transformer	Planned Outage	9/23/2025	3,165.17	10
PLF	Planned Outage	9/24/2025	267.73	1
PLF	Planned Outage	9/24/2025	378.33	4
Transformer	Planned Outage	9/24/2025	400.67	20
Transformer	Planned Outage	9/24/2025	380.67	20
PLF	Planned Outage	9/24/2025	12,798.92	35
Transformer Bank	Planned Outage	9/24/2025	327.37	14
Transformer	Planned Outage	9/24/2025	244.65	7
Transformer	Planned Outage	9/24/2025	1,486.58	5
Transformer	Planned Outage	9/24/2025	8,291.47	31
Transformer	Planned Outage	9/24/2025	252.13	1
Transformer	Planned Outage	9/24/2025	252.27	1
Transformer	Planned Outage	9/24/2025	252.25	1
Transformer	Planned Outage	9/24/2025	252.10	1
Transformer	Planned Outage	9/24/2025	252.07	1
Transformer	Planned Outage	9/24/2025	252.18	1
Transformer	Planned Outage	9/24/2025	252.08	1
Transformer	Planned Outage	9/24/2025	252.12	1
Transformer	Planned Outage	9/24/2025	252.08	1
Transformer	Planned Outage	9/24/2025	252.30	1
Transformer	Planned Outage	9/24/2025	252.37	1
Transformer	Planned Outage	9/24/2025	252.08	1
Transformer	Planned Outage	9/24/2025	252.28	1
Transformer	Planned Outage	9/24/2025	252.22	1
Transformer	Planned Outage	9/24/2025	252.10	1
Transformer	Planned Outage	9/24/2025	252.17	1
Transformer	Planned Outage	9/24/2025	252.35	1
Transformer	Planned Outage	9/24/2025	252.12	1
Transformer	Planned Outage	9/24/2025	252.35	1
Transformer	Planned Outage	9/24/2025	252.33	1
Transformer	Planned Outage	9/24/2025	252.15	1
Transformer	Planned Outage	9/24/2025	36.27	32
Transformer	Planned Outage	9/24/2025	2,681.80	11
Transformer	Planned Outage	9/24/2025	1,401.33	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/24/2025	101.00	2
Transformer	Planned Outage	9/24/2025	188.67	5
Transformer	Planned Outage	9/24/2025	15.93	2
Transformer	Planned Outage	9/24/2025	309.50	5
Transformer	Planned Outage	9/24/2025	1,412.37	7
Transformer	Planned Outage	9/24/2025	52.80	3
PLF	Planned Outage	9/24/2025	124.20	1
Service point	Planned Outage	9/24/2025	7.75	1
Transformer	Planned Outage	9/24/2025	811.95	9
None	Planned Outage	9/24/2025	198.33	100
Transformer Bank	Planned Outage	9/24/2025	62.63	1
Transformer	Planned Outage	9/24/2025	253.50	10
PLF	Planned Outage	9/24/2025	234.40	1
Transformer	Planned Outage	9/24/2025	69.75	3
Transformer	Planned Outage	9/24/2025	19.17	2
PLF	Planned Outage	9/24/2025	154.27	4
Transformer	Planned Outage	9/24/2025	1,865.83	10
PLF	Planned Outage	9/24/2025	7,941.75	45
PLF	Planned Outage	9/24/2025	683.57	2
Transformer Bank	Planned Outage	9/24/2025	578.67	2
PLF	Planned Outage	9/25/2025	39.27	2
Transformer	Planned Outage	9/25/2025	574.40	4
PLF	Planned Outage	9/25/2025	1,929.40	11
Transformer Bank	Planned Outage	9/25/2025	78.70	2
Transformer	Planned Outage	9/25/2025	4,213.60	16
None	Planned Outage	9/25/2025	639.47	16
Transformer	Planned Outage	9/25/2025	791.08	5
Transformer	Planned Outage	9/25/2025	309.05	1
Transformer	Planned Outage	9/25/2025	429.00	6
Transformer	Planned Outage	9/25/2025	71.03	2
PLF	Planned Outage	9/25/2025	3.73	1
Transformer	Planned Outage	9/25/2025	125.12	1
Transformer	Planned Outage	9/25/2025	835.20	18
Transformer	Planned Outage	9/25/2025	503.75	13
Transformer	Planned Outage	9/25/2025	365.52	1
Transformer	Planned Outage	9/25/2025	165.25	5
PLF	Planned Outage	9/25/2025	716.67	40
PLF	Planned Outage	9/25/2025	264.53	2
Transformer	Planned Outage	9/25/2025	60.17	5
PLF	Planned Outage	9/25/2025	77.42	5
Transformer	Planned Outage	9/25/2025	1,184.90	17
PLF	Planned Outage	9/25/2025	9,666.37	13

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/25/2025	82.13	7
Transformer	Planned Outage	9/25/2025	230.65	3
Transformer	Planned Outage	9/25/2025	336.42	5
Service point	Planned Outage	9/25/2025	55.57	1
Service point	Planned Outage	9/25/2025	36.80	1
Transformer Bank	Planned Outage	9/25/2025	117.40	2
PLF	Planned Outage	9/25/2025	5,528.75	15
PLF	Planned Outage	9/25/2025	8,479.72	23
PLF	Planned Outage	9/25/2025	231.17	1
Transformer	Planned Outage	9/25/2025	125.02	1
PLF	Planned Outage	9/25/2025	104.87	1
PLF	Planned Outage	9/25/2025	969.20	3
PLF	Planned Outage	9/25/2025	267.20	3
Transformer	Planned Outage	9/26/2025	31.05	3
Transformer	Planned Outage	9/26/2025	1,820.53	8
PLF	Planned Outage	9/26/2025	683.03	62
PLF	Planned Outage	9/26/2025	386.17	35
Transformer	Planned Outage	9/26/2025	2.93	1
Transformer	Planned Outage	9/26/2025	24.75	1
Primary Wire	Planned Outage	9/26/2025	398.90	6
Transformer	Planned Outage	9/26/2025	294.67	8
Transformer	Planned Outage	9/26/2025	2,209.08	7
Transformer	Planned Outage	9/26/2025	1,340.50	6
Transformer	Planned Outage	9/26/2025	196.80	8
Transformer	Planned Outage	9/26/2025	2,072.13	8
None	Planned Outage	9/26/2025	270.00	8
Transformer	Planned Outage	9/26/2025	1,400.27	16
Transformer	Planned Outage	9/26/2025	125.03	1
None	Planned Outage	9/26/2025	574.57	2
None	Planned Outage	9/26/2025	1,099.40	6
Transformer	Planned Outage	9/26/2025	4.53	1
Transformer Bank	Planned Outage	9/26/2025	30.50	5
Transformer	Planned Outage	9/26/2025	196.08	1
PLF	Planned Outage	9/26/2025	57.17	1
Transformer	Planned Outage	9/26/2025	435.30	9
Transformer	Planned Outage	9/26/2025	10.88	1
Transformer	Planned Outage	9/26/2025	23.00	2
Transformer	Planned Outage	9/26/2025	3,555.33	8
Transformer	Planned Outage	9/26/2025	17.87	4
Transformer	Planned Outage	9/26/2025	31.35	9
Transformer	Planned Outage	9/26/2025	4.97	1
OH Other	Planned Outage	9/26/2025	28.33	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/26/2025	65.33	8
Transformer	Planned Outage	9/27/2025	13.70	3
Transformer	Planned Outage	9/27/2025	59.15	3
Transformer Bank	Planned Outage	9/27/2025	70.97	1
Transformer	Planned Outage	9/27/2025	34.35	1
Transformer	Planned Outage	9/27/2025	20.13	2
PLF	Planned Outage	9/27/2025	360.88	1
Transformer	Planned Outage	9/27/2025	123.60	9
Transformer	Planned Outage	9/27/2025	321.17	10
Transformer	Planned Outage	9/27/2025	265.07	8
Transformer	Planned Outage	9/27/2025	1,802.60	6
None	Planned Outage	9/27/2025	106.52	7
Transformer Bank	Planned Outage	9/27/2025	44.48	1
Transformer	Planned Outage	9/27/2025	66.40	4
Service point	Planned Outage	9/28/2025	17.30	1
PLF	Planned Outage	9/28/2025	17.73	8
Transformer Bank	Planned Outage	9/28/2025	41.35	3
Transformer	Planned Outage	9/28/2025	11.93	1
PLF	Planned Outage	9/28/2025	272.20	1
PLF	Planned Outage	9/28/2025	298.68	1
Transformer Bank	Planned Outage	9/28/2025	83.65	3
PLF	Planned Outage	9/28/2025	65.27	2
Transformer Bank	Planned Outage	9/28/2025	60.07	4
Transformer Bank	Planned Outage	9/28/2025	26.42	5
Transformer	Planned Outage	9/28/2025	11.15	3
Transformer	Planned Outage	9/28/2025	19.08	1
Transformer	Planned Outage	9/28/2025	33.13	2
Transformer	Planned Outage	9/28/2025	37.23	1
Transformer	Planned Outage	9/28/2025	59.93	2
Transformer	Planned Outage	9/28/2025	2.90	1
Transformer	Planned Outage	9/28/2025	53.00	2
PLF	Planned Outage	9/28/2025	1.00	1
Transformer	Planned Outage	9/29/2025	42.08	5
Transformer Bank	Planned Outage	9/29/2025	353.13	2
Transformer	Planned Outage	9/29/2025	58.70	1
Primary Wire	Planned Outage	9/29/2025	16,858.13	73
PLF	Planned Outage	9/29/2025	4,356.07	19
Transformer	Planned Outage	9/29/2025	2,224.95	7
Transformer	Planned Outage	9/29/2025	294.33	4
Transformer	Planned Outage	9/29/2025	14.17	1
Transformer	Planned Outage	9/29/2025	611.25	5
Transformer	Planned Outage	9/29/2025	119.00	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/29/2025	276.58	5
None	Planned Outage	9/29/2025	186.17	10
Transformer	Planned Outage	9/29/2025	178.03	2
Transformer	Planned Outage	9/29/2025	592.93	8
Transformer	Planned Outage	9/29/2025	544.40	8
Transformer	Planned Outage	9/29/2025	3,146.80	12
PLF	Planned Outage	9/29/2025	1,017.25	15
Transformer	Planned Outage	9/29/2025	272.10	6
Transformer	Planned Outage	9/29/2025	386.87	7
Breaker	Planned Outage	9/29/2025	9.27	1
Breaker	Planned Outage	9/29/2025	9.00	1
Breaker	Planned Outage	9/29/2025	8.70	1
Breaker	Planned Outage	9/29/2025	8.82	1
Breaker	Planned Outage	9/29/2025	15,039.00	1620
Breaker	Planned Outage	9/29/2025	8.97	1
PLF	Planned Outage	9/29/2025	11.60	3
None	Planned Outage	9/29/2025	36.00	1
None	Planned Outage	9/29/2025	38.10	6
Transformer	Planned Outage	9/29/2025	211.60	8
PLF	Planned Outage	9/29/2025	783.00	9
Transformer	Planned Outage	9/29/2025	1,564.27	16
PLF	Planned Outage	9/29/2025	176.02	1
Transformer	Planned Outage	9/29/2025	15.27	1
PLF	Planned Outage	9/29/2025	1,652.33	4
PLF	Planned Outage	9/29/2025	18.47	4
Transformer	Planned Outage	9/29/2025	87.07	8
Transformer	Planned Outage	9/29/2025	60.67	4
PLF	Planned Outage	9/29/2025	376.02	1
PLF	Planned Outage	9/29/2025	377.38	1
PLF	Planned Outage	9/29/2025	730.00	10
Transformer	Planned Outage	9/30/2025	112.50	6
Transformer	Planned Outage	9/30/2025	185.87	8
Transformer	Planned Outage	9/30/2025	258.60	12
Transformer	Planned Outage	9/30/2025	30.17	2
Transformer	Planned Outage	9/30/2025	208.65	1
Transformer	Planned Outage	9/30/2025	663.27	4
Transformer	Planned Outage	9/30/2025	11.63	2
Transformer	Planned Outage	9/30/2025	273.53	4
Transformer	Planned Outage	9/30/2025	273.93	4
Transformer	Planned Outage	9/30/2025	140.70	6
Transformer	Planned Outage	9/30/2025	55.27	2
Transformer	Planned Outage	9/30/2025	329.87	16

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	9/30/2025	493.25	5
Transformer	Planned Outage	9/30/2025	196.80	18
Transformer	Planned Outage	9/30/2025	16.25	1
Transformer	Planned Outage	9/30/2025	9.58	5
PLF	Planned Outage	9/30/2025	41.53	1
Transformer	Planned Outage	9/30/2025	313.43	1
Transformer	Planned Outage	9/30/2025	191.80	12
None	Planned Outage	9/30/2025	977.17	10
Transformer	Planned Outage	9/30/2025	609.82	7
Transformer	Planned Outage	9/30/2025	155.25	15
Transformer	Planned Outage	9/30/2025	1,642.87	19
Transformer	Planned Outage	9/30/2025	1,402.17	47
Transformer	Planned Outage	9/30/2025	22.50	5
Transformer	Planned Outage	9/30/2025	88.08	5
Transformer	Planned Outage	9/30/2025	1,282.05	33
Transformer	Planned Outage	9/30/2025	1,570.00	10
Breaker	Planned Outage	9/30/2025	2.58	1
Breaker	Planned Outage	9/30/2025	2.98	1
Breaker	Planned Outage	9/30/2025	3.02	1
Breaker	Planned Outage	9/30/2025	3,897.90	1917
Breaker	Planned Outage	9/30/2025	2.93	1
Breaker	Planned Outage	9/30/2025	2.15	1
Breaker	Planned Outage	9/30/2025	2.68	1
Breaker	Planned Outage	9/30/2025	2,649.43	1303
Breaker	Planned Outage	9/30/2025	2.83	1
Breaker	Planned Outage	9/30/2025	2.48	1
Breaker	Planned Outage	9/30/2025	2.38	1
Breaker	Planned Outage	9/30/2025	2.00	1
Breaker	Planned Outage	9/30/2025	3,806.40	1872
Breaker	Planned Outage	9/30/2025	2.03	1
Breaker	Planned Outage	9/30/2025	2.27	1
Breaker	Planned Outage	9/30/2025	2.07	1
Breaker	Planned Outage	9/30/2025	2.18	1
Breaker	Planned Outage	9/30/2025	2.68	1
Breaker	Planned Outage	9/30/2025	2.83	1
Breaker	Planned Outage	9/30/2025	2.10	1
Breaker	Planned Outage	9/30/2025	2.63	1
Breaker	Planned Outage	9/30/2025	2.75	1
Breaker	Planned Outage	9/30/2025	344.85	171
Breaker	Planned Outage	9/30/2025	2.75	1
Breaker	Planned Outage	9/30/2025	262.17	130
Breaker	Planned Outage	9/30/2025	2.75	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	9/30/2025	2.57	1
Breaker	Planned Outage	9/30/2025	2.02	1
Breaker	Planned Outage	9/30/2025	8,179.60	4056
Breaker	Planned Outage	9/30/2025	3,178.27	1576
Breaker	Planned Outage	9/30/2025	4,529.43	2246
Breaker	Planned Outage	9/30/2025	2.27	1
Breaker	Planned Outage	9/30/2025	2.45	1
Breaker	Planned Outage	9/30/2025	5,331.67	175
Breaker	Planned Outage	9/30/2025	304.67	10
Transformer	Planned Outage	9/30/2025	31.50	1
Transformer	Planned Outage	9/30/2025	16.67	5
Transformer	Planned Outage	9/30/2025	301.23	14
Transformer	Planned Outage	10/1/2025	543.95	3
Transformer	Planned Outage	10/1/2025	2,015.53	7
Transformer	Planned Outage	10/1/2025	86.30	2
Transformer	Planned Outage	10/1/2025	269.75	13
PLF	Planned Outage	10/1/2025	141.60	9
Transformer	Planned Outage	10/1/2025	663.00	9
Transformer	Planned Outage	10/1/2025	185.80	3
Transformer	Planned Outage	10/1/2025	727.42	5
Transformer	Planned Outage	10/1/2025	248.00	3
PLF	Planned Outage	10/1/2025	92.40	24
Transformer	Planned Outage	10/1/2025	3,602.67	7
Transformer	Planned Outage	10/1/2025	132.53	7
Transformer	Planned Outage	10/1/2025	1,679.47	8
Transformer	Planned Outage	10/1/2025	4,976.03	22
Transformer	Planned Outage	10/1/2025	2,387.70	14
Transformer	Planned Outage	10/1/2025	168.77	2
Breaker	Planned Outage	10/1/2025	104,726.60	362
Transformer	Planned Outage	10/1/2025	250.07	4
Transformer	Planned Outage	10/1/2025	6.67	5
PLF	Planned Outage	10/1/2025	294.27	1
Transformer	Planned Outage	10/1/2025	877.00	10
Transformer	Planned Outage	10/1/2025	289.47	8
Transformer	Planned Outage	10/1/2025	352.38	1
Transformer	Planned Outage	10/1/2025	18.80	2
PLF	Planned Outage	10/1/2025	2,564.07	4
Transformer	Planned Outage	10/1/2025	17.93	4
PLF	Planned Outage	10/1/2025	215.83	2
Cut Out 100 amp - PLF	Planned Outage	10/1/2025	765.80	4
Transformer	Planned Outage	10/1/2025	267.40	12
Transformer	Planned Outage	10/1/2025	170.40	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/1/2025	39.33	2
Transformer	Planned Outage	10/1/2025	202.77	14
Transformer	Planned Outage	10/1/2025	1,030.47	26
Transformer	Planned Outage	10/1/2025	1,863.20	8
Transformer	Planned Outage	10/1/2025	189.27	4
Transformer	Planned Outage	10/1/2025	714.40	3
Transformer	Planned Outage	10/2/2025	365.78	1
Transformer	Planned Outage	10/2/2025	367.00	1
Transformer	Planned Outage	10/2/2025	734.00	2
Transformer	Planned Outage	10/2/2025	734.00	2
Invalid	Planned Outage	10/2/2025	33,830.25	645
Transformer	Planned Outage	10/2/2025	367.00	1
Transformer	Planned Outage	10/2/2025	69.53	2
Transformer	Planned Outage	10/2/2025	33.13	2
Transformer Bank	Planned Outage	10/2/2025	15.70	6
PLF	Planned Outage	10/2/2025	102.00	45
PLF	Planned Outage	10/2/2025	308.83	2
Transformer Bank	Planned Outage	10/2/2025	1,228.03	7
Transformer	Planned Outage	10/2/2025	15.00	10
Transformer	Planned Outage	10/2/2025	348.73	2
Primary Wire	Planned Outage	10/2/2025	59,736.00	190
Transformer Bank	Planned Outage	10/2/2025	95.57	1
Transformer	Planned Outage	10/2/2025	104.70	3
Transformer	Planned Outage	10/2/2025	2,722.77	14
Transformer	Planned Outage	10/2/2025	710.90	3
Primary Wire	Planned Outage	10/2/2025	5,403.28	19
Transformer	Planned Outage	10/2/2025	382.00	8
PLF	Planned Outage	10/2/2025	277.08	19
PLF	Planned Outage	10/2/2025	4,313.60	12
Transformer	Planned Outage	10/2/2025	299.67	5
PLF	Planned Outage	10/2/2025	252.18	1
PLF	Planned Outage	10/2/2025	93.63	2
PLF	Planned Outage	10/2/2025	12.85	1
Switch	Planned Outage	10/2/2025	969.80	78
PLF	Planned Outage	10/2/2025	207.10	3
Transformer	Planned Outage	10/2/2025	191.80	3
Transformer	Planned Outage	10/2/2025	66.65	1
PLF	Planned Outage	10/2/2025	331.15	1
Transformer	Planned Outage	10/2/2025	1,615.50	3
Transformer Bank	Planned Outage	10/2/2025	137.33	1
Transformer	Planned Outage	10/2/2025	14.07	4
Switch	Planned Outage	10/3/2025	109.15	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/3/2025	57.57	2
PLF	Planned Outage	10/3/2025	170.28	1
Transformer	Planned Outage	10/3/2025	149.42	1
Transformer	Planned Outage	10/3/2025	738.00	8
PLF	Planned Outage	10/3/2025	848.40	18
Transformer	Planned Outage	10/3/2025	133.65	3
OH Other	Planned Outage	10/3/2025	22.00	2
Transformer	Planned Outage	10/3/2025	228.60	6
Transformer	Planned Outage	10/3/2025	648.80	8
None	Planned Outage	10/3/2025	132.00	4
PLF	Planned Outage	10/3/2025	1,686.10	26
PLF	Planned Outage	10/3/2025	478.80	21
Transformer	Planned Outage	10/3/2025	10.80	3
PLF	Planned Outage	10/3/2025	31.97	7
Transformer	Planned Outage	10/3/2025	34.15	1
Primary Wire	Planned Outage	10/3/2025	8,101.50	15
Transformer	Planned Outage	10/3/2025	79.65	3
Transformer	Planned Outage	10/3/2025	209.08	5
Transformer	Planned Outage	10/3/2025	5.97	2
Transformer	Planned Outage	10/3/2025	115.57	2
Transformer	Planned Outage	10/3/2025	52.20	2
PLF	Planned Outage	10/4/2025	137.13	22
PLF	Planned Outage	10/4/2025	365.93	2
None	Planned Outage	10/4/2025	584.40	9
None	Planned Outage	10/4/2025	233.07	4
Breaker	Planned Outage	10/4/2025	7,355.40	897
Transformer	Planned Outage	10/5/2025	345.95	1
Transformer Bank	Planned Outage	10/5/2025	242.92	1
Transformer	Planned Outage	10/5/2025	45.80	3
Transformer	Planned Outage	10/5/2025	637.60	4
Transformer	Planned Outage	10/5/2025	74.67	5
Transformer Bank	Planned Outage	10/5/2025	127.95	3
Transformer	Planned Outage	10/5/2025	80.93	8
Transformer	Planned Outage	10/5/2025	12.90	1
Transformer	Planned Outage	10/5/2025	39.82	1
PLF	Planned Outage	10/5/2025	1,884.90	103
Service point	Planned Outage	10/6/2025	340.50	1
Transformer	Planned Outage	10/6/2025	720.13	8
Transformer	Planned Outage	10/6/2025	141.87	8
Transformer	Planned Outage	10/6/2025	57.67	2
Transformer	Planned Outage	10/6/2025	838.75	11
Transformer	Planned Outage	10/6/2025	1,425.50	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	10/6/2025	3,777.58	13
Transformer	Planned Outage	10/6/2025	505.20	2
Transformer	Planned Outage	10/6/2025	94.58	5
Transformer	Planned Outage	10/6/2025	183.90	3
Transformer	Planned Outage	10/6/2025	3,760.40	28
Transformer	Planned Outage	10/6/2025	269.52	1
Transformer	Planned Outage	10/6/2025	127.27	2
Transformer	Planned Outage	10/6/2025	190.95	3
Transformer Bank	Planned Outage	10/6/2025	121.10	2
Transformer	Planned Outage	10/6/2025	469.73	8
Transformer	Planned Outage	10/6/2025	81.85	1
Transformer	Planned Outage	10/6/2025	105.50	6
Transformer	Planned Outage	10/6/2025	257.50	5
Transformer	Planned Outage	10/6/2025	14.45	3
Transformer	Planned Outage	10/6/2025	555.60	8
Transformer	Planned Outage	10/6/2025	10.67	8
Transformer	Planned Outage	10/6/2025	146.90	3
Transformer	Planned Outage	10/6/2025	3.20	3
Transformer	Planned Outage	10/6/2025	106.87	4
Transformer	Planned Outage	10/6/2025	73.15	7
Transformer Bank	Planned Outage	10/6/2025	110.17	5
None	Planned Outage	10/6/2025	475.77	14
None	Planned Outage	10/6/2025	167.60	6
None	Planned Outage	10/6/2025	101.10	6
None	Planned Outage	10/6/2025	973.05	9
Service point	Planned Outage	10/6/2025	92.53	1
PLF	Planned Outage	10/6/2025	344.48	1
None	Planned Outage	10/6/2025	933.42	23
PLF	Planned Outage	10/7/2025	101.75	1
Transformer	Planned Outage	10/7/2025	291.20	2
PLF	Planned Outage	10/7/2025	4,685.80	14
PLF	Planned Outage	10/7/2025	653.08	85
Transformer	Planned Outage	10/7/2025	1,658.17	5
Transformer	Planned Outage	10/7/2025	55.75	3
PLF	Planned Outage	10/7/2025	3,748.85	21
Transformer	Planned Outage	10/7/2025	950.72	7
Transformer	Planned Outage	10/7/2025	946.35	81
Transformer	Planned Outage	10/7/2025	35.13	4
Transformer Bank	Planned Outage	10/7/2025	180.77	11
Transformer	Planned Outage	10/7/2025	62.47	4
PLF	Planned Outage	10/7/2025	113.62	1
Transformer	Planned Outage	10/7/2025	31.57	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/7/2025	584.80	6
Transformer	Planned Outage	10/7/2025	3,284.55	9
Transformer	Planned Outage	10/7/2025	151.00	3
Transformer	Planned Outage	10/7/2025	91.53	1
Transformer	Planned Outage	10/7/2025	294.40	6
Transformer	Planned Outage	10/7/2025	457.13	4
Transformer	Planned Outage	10/7/2025	298.92	5
Transformer	Planned Outage	10/7/2025	24.20	6
Transformer	Planned Outage	10/7/2025	386.00	4
PLF	Planned Outage	10/7/2025	86.95	1
Transformer	Planned Outage	10/7/2025	293.60	8
Transformer	Planned Outage	10/7/2025	467.95	7
Transformer	Planned Outage	10/7/2025	855.17	10
Transformer	Planned Outage	10/7/2025	321.07	4
Transformer	Planned Outage	10/8/2025	475.65	7
Transformer	Planned Outage	10/8/2025	38.27	4
Breaker	Planned Outage	10/8/2025	10.90	1
Breaker	Planned Outage	10/8/2025	10.90	1
Breaker	Planned Outage	10/8/2025	10.90	1
Breaker	Planned Outage	10/8/2025	28,656.10	2629
Breaker	Planned Outage	10/8/2025	10.90	1
Breaker	Planned Outage	10/8/2025	10.90	1
Breaker	Planned Outage	10/8/2025	10.90	1
None	Planned Outage	10/8/2025	117.00	3
None	Planned Outage	10/8/2025	268.20	36
Transformer	Planned Outage	10/8/2025	1,286.93	4
Transformer	Planned Outage	10/8/2025	205.57	7
PLF	Planned Outage	10/8/2025	34.98	1
Transformer	Planned Outage	10/8/2025	1,726.20	7
Transformer	Planned Outage	10/8/2025	778.00	6
None	Planned Outage	10/8/2025	2,203.30	11
Transformer	Planned Outage	10/8/2025	181.35	1
Transformer	Planned Outage	10/8/2025	718.33	4
PLF	Planned Outage	10/8/2025	182.20	1
Transformer	Planned Outage	10/8/2025	5.65	3
Transformer	Planned Outage	10/8/2025	438.35	11
Transformer Bank	Planned Outage	10/8/2025	216.72	1
Transformer	Planned Outage	10/8/2025	83.20	6
Transformer	Planned Outage	10/8/2025	61.53	2
Transformer	Planned Outage	10/8/2025	21.90	6
Transformer	Planned Outage	10/8/2025	21.00	3
None	Planned Outage	10/8/2025	61.65	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Service point	Planned Outage	10/8/2025	16.20	1
Transformer	Planned Outage	10/8/2025	9.42	5
Transformer	Planned Outage	10/8/2025	239.25	9
Transformer	Planned Outage	10/8/2025	109.40	3
Transformer	Planned Outage	10/8/2025	799.73	2
Transformer	Planned Outage	10/8/2025	22.30	3
Transformer	Planned Outage	10/8/2025	4.30	1
Transformer	Planned Outage	10/8/2025	218.80	4
Transformer	Planned Outage	10/9/2025	1,121.33	8
Transformer	Planned Outage	10/9/2025	159.97	2
Transformer	Planned Outage	10/9/2025	504.20	4
Transformer	Planned Outage	10/9/2025	412.28	1
Transformer	Planned Outage	10/9/2025	59.88	1
None	Planned Outage	10/9/2025	2,411.73	16
Transformer	Planned Outage	10/9/2025	1,277.70	6
PLF	Planned Outage	10/9/2025	4,309.00	12
None	Planned Outage	10/9/2025	275.40	102
None	Planned Outage	10/9/2025	1,104.27	8
PLF	Planned Outage	10/9/2025	228.17	1
Switch	Planned Outage	10/9/2025	294.57	2
Transformer	Planned Outage	10/9/2025	104.13	8
Transformer	Planned Outage	10/9/2025	671.20	8
Transformer	Planned Outage	10/9/2025	140.08	5
Transformer	Planned Outage	10/9/2025	172.60	12
Transformer	Planned Outage	10/9/2025	1.35	1
Transformer	Planned Outage	10/9/2025	353.47	8
Transformer	Planned Outage	10/9/2025	194.00	6
Transformer	Planned Outage	10/9/2025	12.42	5
Transformer	Planned Outage	10/9/2025	70.27	4
PLF	Planned Outage	10/9/2025	158.33	1
PLF	Planned Outage	10/9/2025	2.30	2
Transformer	Planned Outage	10/9/2025	18.70	2
PLF	Planned Outage	10/9/2025	291.45	1
PLF	Planned Outage	10/9/2025	524.43	2
PLF	Planned Outage	10/9/2025	732.50	6
Transformer	Planned Outage	10/9/2025	1,539.33	10
Transformer	Planned Outage	10/10/2025	173.47	4
Transformer	Planned Outage	10/10/2025	84.37	2
Transformer	Planned Outage	10/10/2025	1,009.00	12
Transformer Bank	Planned Outage	10/10/2025	517.00	4
Transformer	Planned Outage	10/10/2025	232.40	8
Transformer	Planned Outage	10/10/2025	800.00	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	10/10/2025	1.75	1
Invalid	Planned Outage	10/10/2025	16.82	1
Invalid	Planned Outage	10/10/2025	16.82	1
Invalid	Planned Outage	10/10/2025	9,045.07	856
Transformer	Planned Outage	10/10/2025	77.07	4
Transformer	Planned Outage	10/10/2025	173.83	2
Transformer	Planned Outage	10/10/2025	338.60	4
Transformer	Planned Outage	10/10/2025	557.40	4
Transformer	Planned Outage	10/10/2025	8.77	2
Transformer	Planned Outage	10/10/2025	113.60	16
Transformer	Planned Outage	10/10/2025	7.00	7
Transformer Bank	Planned Outage	10/10/2025	164.33	5
Transformer	Planned Outage	10/10/2025	131.00	6
Transformer	Planned Outage	10/10/2025	51.88	11
Transformer	Planned Outage	10/10/2025	255.13	4
Transformer	Planned Outage	10/10/2025	2.17	1
Transformer	Planned Outage	10/10/2025	115.50	9
Transformer	Planned Outage	10/10/2025	62.77	7
Transformer	Planned Outage	10/10/2025	221.40	9
Transformer	Planned Outage	10/10/2025	92.75	5
Transformer	Planned Outage	10/10/2025	177.00	12
PLF	Planned Outage	10/10/2025	7.97	2
Service point	Planned Outage	10/10/2025	19.82	1
Transformer	Planned Outage	10/10/2025	363.37	11
Transformer	Planned Outage	10/10/2025	19.28	1
Transformer	Planned Outage	10/10/2025	761.85	27
None	Planned Outage	10/11/2025	982.70	6
Transformer	Planned Outage	10/11/2025	165.00	6
Transformer	Planned Outage	10/11/2025	195.98	1
PLF	Planned Outage	10/11/2025	470.98	1
Transformer Bank	Planned Outage	10/11/2025	362.48	13
Transformer	Planned Outage	10/11/2025	25.73	8
Transformer	Planned Outage	10/11/2025	550.20	12
Transformer	Planned Outage	10/11/2025	63.50	3
Transformer	Planned Outage	10/11/2025	24.00	3
Transformer	Planned Outage	10/12/2025	238.05	3
Transformer	Planned Outage	10/12/2025	19.53	4
Transformer Bank	Planned Outage	10/12/2025	24.17	1
Transformer Bank	Planned Outage	10/12/2025	41.63	1
Transformer	Planned Outage	10/12/2025	238.80	9
Transformer	Planned Outage	10/12/2025	167.08	5
Transformer	Planned Outage	10/12/2025	15.93	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	10/12/2025	23.73	4
Transformer	Planned Outage	10/12/2025	23.25	5
None	Planned Outage	10/12/2025	816.02	11
Breaker	Planned Outage	10/12/2025	8.32	1
Breaker	Planned Outage	10/12/2025	8.32	1
Breaker	Planned Outage	10/12/2025	9,996.63	1202
Transformer	Planned Outage	10/13/2025	15.05	1
Transformer	Planned Outage	10/13/2025	372.07	4
PLF	Planned Outage	10/13/2025	376.02	1
Primary Wire	Planned Outage	10/13/2025	2,392.83	10
Transformer	Planned Outage	10/13/2025	63.33	10
Transformer	Planned Outage	10/13/2025	377.17	2
Transformer	Planned Outage	10/13/2025	14.83	10
Transformer	Planned Outage	10/13/2025	5.80	3
Transformer	Planned Outage	10/13/2025	381.42	5
Transformer	Planned Outage	10/13/2025	991.10	11
Transformer	Planned Outage	10/13/2025	182.05	3
Transformer	Planned Outage	10/13/2025	5,807.60	24
Transformer	Planned Outage	10/13/2025	4.60	2
Transformer	Planned Outage	10/13/2025	1,997.87	8
Transformer	Planned Outage	10/13/2025	47.32	1
PLF	Planned Outage	10/13/2025	7.07	2
None	Planned Outage	10/13/2025	135.82	1
Transformer	Planned Outage	10/13/2025	660.75	5
Transformer	Planned Outage	10/13/2025	349.42	5
Transformer	Planned Outage	10/14/2025	1,230.55	3
Transformer Bank	Planned Outage	10/14/2025	211.77	2
Transformer Bank	Planned Outage	10/14/2025	227.13	1
Transformer Bank	Planned Outage	10/14/2025	281.63	2
Primary Wire	Planned Outage	10/14/2025	613.53	2
Transformer	Planned Outage	10/14/2025	103.60	7
PLF	Planned Outage	10/14/2025	6,230.53	8
Switch	Planned Outage	10/14/2025	1,084.60	6
None	Planned Outage	10/14/2025	275.82	1
Transformer Bank	Planned Outage	10/14/2025	129.98	1
Transformer	Planned Outage	10/14/2025	238.32	1
Transformer	Planned Outage	10/14/2025	788.80	8
Transformer	Planned Outage	10/14/2025	87.27	1
Switch	Planned Outage	10/14/2025	1,047.15	9
Transformer	Planned Outage	10/14/2025	106.27	1
None	Planned Outage	10/14/2025	72.47	1
Transformer	Planned Outage	10/14/2025	10.25	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	10/14/2025	209.17	2
Transformer	Planned Outage	10/14/2025	631.00	15
Transformer	Planned Outage	10/14/2025	50.12	1
Transformer	Planned Outage	10/14/2025	301.52	1
Transformer	Planned Outage	10/14/2025	355.67	5
Transformer	Planned Outage	10/15/2025	311.17	10
Transformer	Planned Outage	10/15/2025	2,010.20	23
PLF	Planned Outage	10/15/2025	285.15	1
None	Planned Outage	10/15/2025	135.20	4
PLF	Planned Outage	10/15/2025	7,242.00	20
Transformer	Planned Outage	10/15/2025	301.48	1
None	Planned Outage	10/15/2025	2,650.17	10
Transformer	Planned Outage	10/15/2025	288.90	1
Invalid	Planned Outage	10/15/2025	175.95	3
Switch	Planned Outage	10/15/2025	187.03	1
Transformer	Planned Outage	10/15/2025	51.30	3
Transformer	Planned Outage	10/15/2025	6.93	1
Transformer	Planned Outage	10/15/2025	71.20	8
Transformer	Planned Outage	10/15/2025	128.57	1
None	Planned Outage	10/15/2025	596.75	11
Transformer	Planned Outage	10/15/2025	115.60	3
Transformer	Planned Outage	10/15/2025	110.67	2
None	Planned Outage	10/15/2025	2,904.70	31
Transformer	Planned Outage	10/15/2025	272.97	2
Transformer	Planned Outage	10/15/2025	201.55	1
Transformer	Planned Outage	10/15/2025	384.25	3
PLF	Planned Outage	10/15/2025	1,506.30	18
PLF	Planned Outage	10/15/2025	119.67	5
Transformer	Planned Outage	10/15/2025	71.00	4
Transformer	Planned Outage	10/15/2025	1,438.27	8
None	Planned Outage	10/15/2025	126.90	2
None	Planned Outage	10/15/2025	4,809.30	82
None	Planned Outage	10/15/2025	144.20	3
Transformer	Planned Outage	10/15/2025	295.83	10
Transformer	Planned Outage	10/15/2025	38.12	1
Transformer	Planned Outage	10/15/2025	387.90	6
Transformer	Planned Outage	10/16/2025	9.57	1
Transformer	Planned Outage	10/16/2025	606.60	6
Transformer	Planned Outage	10/16/2025	155.75	3
Transformer Bank	Planned Outage	10/16/2025	288.47	1
Transformer	Planned Outage	10/16/2025	672.67	5
PLF	Planned Outage	10/16/2025	147.52	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/16/2025	162.25	3
None	Planned Outage	10/16/2025	12,981.90	109
Transformer	Planned Outage	10/16/2025	254.13	8
Switch	Planned Outage	10/16/2025	138.98	31
Switch	Planned Outage	10/16/2025	147.40	33
None	Planned Outage	10/16/2025	470.50	6
PLF	Planned Outage	10/16/2025	59.97	1
Transformer	Planned Outage	10/16/2025	61.67	2
Transformer	Planned Outage	10/16/2025	36.15	1
Invalid	Planned Outage	10/16/2025	127,246.60	1308
Transformer	Planned Outage	10/16/2025	670.50	3
Transformer	Planned Outage	10/16/2025	2.27	2
Transformer	Planned Outage	10/16/2025	31.35	9
Transformer	Planned Outage	10/16/2025	51.20	3
PLF	Planned Outage	10/16/2025	213.12	1
Transformer	Planned Outage	10/16/2025	232.33	5
PLF	Planned Outage	10/16/2025	356.60	6
PLF	Planned Outage	10/16/2025	189.47	1
Transformer	Planned Outage	10/17/2025	317.17	11
Transformer	Planned Outage	10/17/2025	116.43	2
Invalid	Planned Outage	10/17/2025	20.00	5
Transformer	Planned Outage	10/17/2025	474.50	6
Transformer	Planned Outage	10/17/2025	586.90	3
Transformer	Planned Outage	10/17/2025	1,463.60	3
Transformer	Planned Outage	10/17/2025	231.73	16
Transformer	Planned Outage	10/17/2025	31.67	25
Transformer	Planned Outage	10/17/2025	2,088.75	25
PLF	Planned Outage	10/17/2025	27.87	2
Transformer	Planned Outage	10/17/2025	547.80	6
Transformer	Planned Outage	10/17/2025	1,673.60	8
Transformer	Planned Outage	10/17/2025	10.75	1
Transformer	Planned Outage	10/17/2025	12.00	2
Transformer	Planned Outage	10/17/2025	9.10	3
Transformer	Planned Outage	10/17/2025	56.43	1
Transformer Bank	Planned Outage	10/17/2025	1,530.00	9
PLF	Planned Outage	10/18/2025	315.22	1
Transformer	Planned Outage	10/18/2025	154.70	1
Transformer	Planned Outage	10/18/2025	238.00	21
Transformer	Planned Outage	10/18/2025	60.80	2
PLF	Planned Outage	10/18/2025	66,013.72	277
Transformer	Planned Outage	10/18/2025	643.60	6
Transformer	Planned Outage	10/18/2025	37.57	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	10/18/2025	6.77	1
Transformer Bank	Planned Outage	10/19/2025	542.00	6
Transformer Bank	Planned Outage	10/19/2025	389.27	2
Transformer	Planned Outage	10/19/2025	19.40	4
Invalid	Planned Outage	10/19/2025	73.75	3
Transformer	Planned Outage	10/19/2025	86.87	4
Transformer	Planned Outage	10/19/2025	62.07	2
Transformer	Planned Outage	10/19/2025	117.65	3
Transformer	Planned Outage	10/19/2025	1,598.80	14
None	Planned Outage	10/19/2025	3,421.60	376
Transformer	Planned Outage	10/19/2025	537.00	5
Switch	Planned Outage	10/19/2025	166.70	3
Transformer	Planned Outage	10/19/2025	91.33	10
PLF	Planned Outage	10/20/2025	220.50	9
Transformer	Planned Outage	10/20/2025	543.53	4
Transformer	Planned Outage	10/20/2025	610.87	11
Transformer	Planned Outage	10/20/2025	7.17	2
Transformer	Planned Outage	10/21/2025	169.43	2
Transformer	Planned Outage	10/21/2025	3,273.33	16
PLF	Planned Outage	10/21/2025	14.23	1
None	Planned Outage	10/21/2025	1,520.00	15
Primary Wire	Planned Outage	10/21/2025	262,789.45	343
Primary Wire	Planned Outage	10/21/2025	6,138.13	32
Primary Wire	Planned Outage	10/21/2025	4,354.13	32
Primary Wire	Planned Outage	10/21/2025	4,022.00	20
Primary Wire	Planned Outage	10/21/2025	5,831.73	38
Primary Wire	Planned Outage	10/21/2025	548.73	1
Primary Wire	Planned Outage	10/21/2025	7,064.83	38
Primary Wire	Planned Outage	10/21/2025	6,657.00	30
Transformer	Planned Outage	10/22/2025	86.10	2
Transformer	Planned Outage	10/22/2025	518.80	3
Transformer	Planned Outage	10/22/2025	533.40	3
Transformer	Planned Outage	10/22/2025	526.87	2
Transformer	Planned Outage	10/22/2025	109.17	1
Transformer Bank	Planned Outage	10/22/2025	111.75	3
Transformer	Planned Outage	10/22/2025	1,733.07	8
PLF	Planned Outage	10/22/2025	804.00	36
Transformer	Planned Outage	10/23/2025	68.83	7
Transformer	Planned Outage	10/23/2025	112.57	11
PLF	Planned Outage	10/23/2025	134.72	1
Transformer	Planned Outage	10/23/2025	22.60	2
Transformer	Planned Outage	10/23/2025	15.10	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	10/23/2025	111.22	1
PLF	Planned Outage	10/23/2025	483.87	38
PLF	Planned Outage	10/23/2025	1,402.67	80
Transformer	Planned Outage	10/23/2025	91.32	1
Transformer	Planned Outage	10/23/2025	16.07	1
Transformer	Planned Outage	10/23/2025	192.83	1
Transformer	Planned Outage	10/23/2025	2.12	1
Primary Wire	Planned Outage	10/23/2025	17,642.67	64
Transformer	Planned Outage	10/23/2025	412.65	7
PLF	Planned Outage	10/23/2025	2,213.20	6
Transformer	Planned Outage	10/23/2025	851.43	7
OH Other	Planned Outage	10/23/2025	64.28	7
Transformer	Planned Outage	10/23/2025	9.93	1
Transformer	Planned Outage	10/23/2025	130.35	9
Transformer	Planned Outage	10/23/2025	334.45	3
Transformer	Planned Outage	10/23/2025	2.58	1
Transformer	Planned Outage	10/23/2025	7.90	3
Transformer	Planned Outage	10/23/2025	74.42	5
Transformer	Planned Outage	10/23/2025	10.57	2
PLF	Planned Outage	10/23/2025	6.75	5
Breaker	Planned Outage	10/23/2025	14,294.13	1936
Transformer	Planned Outage	10/23/2025	21.50	1
Transformer	Planned Outage	10/23/2025	12.05	3
Transformer	Planned Outage	10/23/2025	65.20	2
Transformer	Planned Outage	10/23/2025	76.55	3
PLF	Planned Outage	10/23/2025	228.98	1
PLF	Planned Outage	10/24/2025	92.20	12
Transformer Bank	Planned Outage	10/24/2025	137.88	1
Transformer Bank	Planned Outage	10/24/2025	710.10	9
Transformer	Planned Outage	10/24/2025	248.00	8
Transformer	Planned Outage	10/24/2025	100.50	3
Transformer	Planned Outage	10/24/2025	144.08	7
Transformer	Planned Outage	10/24/2025	535.13	4
Transformer	Planned Outage	10/24/2025	59.65	3
Transformer	Planned Outage	10/24/2025	214.25	1
None	Planned Outage	10/24/2025	84.38	1
Transformer	Planned Outage	10/24/2025	28.95	1
Transformer	Planned Outage	10/24/2025	10.07	1
Transformer	Planned Outage	10/24/2025	477.98	7
Transformer	Planned Outage	10/24/2025	12.90	3
Transformer	Planned Outage	10/24/2025	164.00	3
Transformer	Planned Outage	10/24/2025	84.40	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/24/2025	59.55	9
Transformer	Planned Outage	10/24/2025	449.00	6
PLF	Planned Outage	10/24/2025	221.77	1
Transformer	Planned Outage	10/24/2025	51.80	4
PLF	Planned Outage	10/24/2025	1,126.40	12
PLF	Planned Outage	10/24/2025	121.83	2
Transformer	Planned Outage	10/24/2025	84.50	3
Transformer	Planned Outage	10/24/2025	64.27	8
PLF	Planned Outage	10/24/2025	191.00	1
Transformer	Planned Outage	10/24/2025	502.95	7
Transformer	Planned Outage	10/24/2025	111.20	6
PLF	Planned Outage	10/25/2025	31,083.73	46
PLF	Planned Outage	10/25/2025	390.93	2
Transformer	Planned Outage	10/25/2025	14.50	1
Transformer	Planned Outage	10/25/2025	36.32	1
Transformer	Planned Outage	10/25/2025	13.45	1
Transformer	Planned Outage	10/25/2025	2,387.00	11
Transformer	Planned Outage	10/25/2025	68.00	8
Switch	Planned Outage	10/25/2025	54.08	1
Switch	Planned Outage	10/25/2025	61,261.93	1202
Switch	Planned Outage	10/25/2025	53.78	1
Transformer	Planned Outage	10/26/2025	104.92	5
Transformer	Planned Outage	10/26/2025	485.72	1
Transformer	Planned Outage	10/26/2025	2,691.75	9
Transformer Bank	Planned Outage	10/26/2025	66.07	1
Transformer Bank	Planned Outage	10/26/2025	743.33	2
Transformer	Planned Outage	10/26/2025	36.20	2
Transformer	Planned Outage	10/26/2025	91.30	3
PLF	Planned Outage	10/26/2025	821.95	17
Transformer	Planned Outage	10/26/2025	50.70	3
Transformer Bank	Planned Outage	10/26/2025	176.80	16
Transformer	Planned Outage	10/26/2025	43.42	5
Transformer	Planned Outage	10/26/2025	47.30	2
PLF	Planned Outage	10/27/2025	1,052.10	3
Transformer Bank	Planned Outage	10/27/2025	510.67	5
Transformer	Planned Outage	10/27/2025	280.93	8
None	Planned Outage	10/27/2025	2,038.40	7
Service point	Planned Outage	10/27/2025	189.62	1
Transformer	Planned Outage	10/27/2025	7.45	3
Service point	Planned Outage	10/27/2025	189.05	1
Transformer	Planned Outage	10/27/2025	3.00	3
Transformer	Planned Outage	10/27/2025	3.80	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/27/2025	4.60	3
Transformer	Planned Outage	10/27/2025	5.35	3
Transformer	Planned Outage	10/27/2025	6.15	3
Transformer	Planned Outage	10/27/2025	500.05	3
PLF	Planned Outage	10/27/2025	21.50	1
Transformer	Planned Outage	10/27/2025	379.17	5
Transformer	Planned Outage	10/27/2025	186.40	4
Transformer	Planned Outage	10/27/2025	202.00	5
Transformer Bank	Planned Outage	10/27/2025	64.18	1
Transformer	Planned Outage	10/27/2025	629.00	10
Transformer	Planned Outage	10/27/2025	24.35	1
Transformer	Planned Outage	10/27/2025	54.00	6
Transformer	Planned Outage	10/27/2025	4,530.50	51
Transformer	Planned Outage	10/27/2025	676.13	8
Transformer	Planned Outage	10/27/2025	20.07	7
Transformer	Planned Outage	10/27/2025	2,548.40	6
Transformer	Planned Outage	10/27/2025	370.98	1
Primary Wire	Planned Outage	10/27/2025	8,793.00	20
Primary Wire	Planned Outage	10/27/2025	94,496.08	215
None	Planned Outage	10/27/2025	3,777.40	44
None	Planned Outage	10/27/2025	3.65	1
None	Planned Outage	10/27/2025	3.65	1
None	Planned Outage	10/27/2025	3.65	1
None	Planned Outage	10/27/2025	3.65	1
None	Planned Outage	10/27/2025	3.65	1
None	Planned Outage	10/27/2025	2,609.75	715
OCR, Sec.	Planned Outage	10/27/2025	4,068.00	270
OCR, Sec.	Planned Outage	10/27/2025	13,512.80	889
None	Planned Outage	10/27/2025	361.97	1
None	Planned Outage	10/27/2025	7.67	1
PLF	Planned Outage	10/27/2025	3,174.75	5
Transformer	Planned Outage	10/27/2025	2,582.17	10
Transformer	Planned Outage	10/27/2025	446.83	5
Transformer	Planned Outage	10/28/2025	350.17	22
Transformer	Planned Outage	10/28/2025	648.27	13
Transformer	Planned Outage	10/28/2025	849.15	17
Transformer	Planned Outage	10/28/2025	18.33	2
Transformer Bank	Planned Outage	10/28/2025	187.48	1
Transformer	Planned Outage	10/28/2025	369.60	4
PLF	Planned Outage	10/28/2025	6,726.50	110
Transformer	Planned Outage	10/28/2025	248.85	7
Transformer	Planned Outage	10/28/2025	506.57	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/28/2025	21.50	1
Transformer Bank	Planned Outage	10/28/2025	141.23	1
PLF	Planned Outage	10/28/2025	72.50	58
PLF	Planned Outage	10/28/2025	47.73	8
Transformer	Planned Outage	10/28/2025	5.33	4
Transformer	Planned Outage	10/28/2025	643.70	6
Transformer Bank	Planned Outage	10/28/2025	626.83	2
PLF	Planned Outage	10/28/2025	244.27	1
PLF	Planned Outage	10/28/2025	122.70	6
Transformer	Planned Outage	10/28/2025	82.60	4
Transformer	Planned Outage	10/28/2025	467.80	3
Transformer Bank	Planned Outage	10/28/2025	571.10	3
Transformer	Planned Outage	10/28/2025	34.07	4
Transformer	Planned Outage	10/28/2025	210.20	6
PLF	Planned Outage	10/28/2025	2,166.17	10
Transformer Bank	Planned Outage	10/28/2025	198.00	6
Transformer	Planned Outage	10/28/2025	28.40	8
Transformer	Planned Outage	10/28/2025	475.72	17
None	Planned Outage	10/28/2025	472.65	9
PLF	Planned Outage	10/28/2025	2,261.15	123
Transformer	Planned Outage	10/28/2025	80.65	3
Transformer	Planned Outage	10/28/2025	105.80	4
Transformer	Planned Outage	10/28/2025	72.63	2
Transformer	Planned Outage	10/28/2025	2.95	1
Transformer	Planned Outage	10/28/2025	982.73	4
Transformer	Planned Outage	10/28/2025	895.60	4
Transformer	Planned Outage	10/28/2025	529.67	7
Transformer	Planned Outage	10/28/2025	483.17	2
Transformer Bank	Planned Outage	10/29/2025	347.43	14
Transformer Bank	Planned Outage	10/29/2025	123.92	5
Transformer	Planned Outage	10/29/2025	129.78	1
None	Planned Outage	10/29/2025	1,896.90	9
Transformer	Planned Outage	10/29/2025	805.70	6
Switch	Planned Outage	10/29/2025	121.23	1
Transformer	Planned Outage	10/29/2025	1,953.33	8
Transformer	Planned Outage	10/29/2025	12.67	2
Transformer	Planned Outage	10/29/2025	22.67	2
Transformer	Planned Outage	10/29/2025	122.57	2
Transformer	Planned Outage	10/29/2025	244.18	13
PLF	Planned Outage	10/29/2025	654.27	2
Transformer	Planned Outage	10/29/2025	21.25	3
Transformer	Planned Outage	10/29/2025	143.35	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/29/2025	344.00	5
Transformer	Planned Outage	10/29/2025	4,046.33	20
Transformer	Planned Outage	10/29/2025	10.50	7
Transformer	Planned Outage	10/29/2025	13.45	3
Transformer	Planned Outage	10/29/2025	592.67	7
Transformer	Planned Outage	10/29/2025	473.65	3
Transformer	Planned Outage	10/29/2025	135.10	3
Transformer	Planned Outage	10/29/2025	39.40	12
Transformer	Planned Outage	10/29/2025	131.55	9
Switch	Planned Outage	10/29/2025	942.67	7
Transformer	Planned Outage	10/29/2025	6.00	3
Breaker	Planned Outage	10/30/2025	17,220.00	1400
Transformer	Planned Outage	10/30/2025	78.57	2
Transformer	Planned Outage	10/30/2025	891.60	9
Transformer	Planned Outage	10/30/2025	58.43	1
Transformer	Planned Outage	10/30/2025	58.40	1
Transformer	Planned Outage	10/30/2025	164.25	5
PLF	Planned Outage	10/30/2025	209.58	1
None	Planned Outage	10/30/2025	1,913.40	18
Transformer	Planned Outage	10/30/2025	63.33	5
Transformer	Planned Outage	10/30/2025	53.83	19
Transformer	Planned Outage	10/30/2025	239.27	37
PLF	Planned Outage	10/30/2025	755.80	12
Transformer	Planned Outage	10/30/2025	136.07	2
PLF	Planned Outage	10/30/2025	25.78	13
Transformer	Planned Outage	10/30/2025	1,648.40	12
Breaker	Planned Outage	10/30/2025	5.37	1
Breaker	Planned Outage	10/30/2025	5.37	1
Breaker	Planned Outage	10/30/2025	65.12	1
Breaker	Planned Outage	10/30/2025	65.27	1
Breaker	Planned Outage	10/30/2025	64.83	1
Breaker	Planned Outage	10/30/2025	64.93	1
Breaker	Planned Outage	10/30/2025	65.00	1
Breaker	Planned Outage	10/30/2025	65.07	1
Breaker	Planned Outage	10/30/2025	6,722.52	1349
Breaker	Planned Outage	10/30/2025	65.20	1
Breaker	Planned Outage	10/30/2025	65.32	1
Breaker	Planned Outage	10/30/2025	5.37	1
Breaker	Planned Outage	10/30/2025	5.37	1
Breaker	Planned Outage	10/30/2025	5.37	1
Breaker	Planned Outage	10/30/2025	5.37	1
Transformer	Planned Outage	10/30/2025	742.82	7

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	10/30/2025	15.90	3
Transformer	Planned Outage	10/30/2025	103.13	2
Transformer	Planned Outage	10/30/2025	297.73	8
PLF	Planned Outage	10/30/2025	236.50	11
Transformer	Planned Outage	10/30/2025	15.25	1
None	Planned Outage	10/30/2025	462.00	7
Transformer	Planned Outage	10/30/2025	103.15	3
None	Planned Outage	10/30/2025	127.08	125
Transformer	Planned Outage	10/30/2025	17.00	1
PLF	Planned Outage	10/30/2025	181.13	2
Transformer	Planned Outage	10/30/2025	164.73	7
Transformer Bank	Planned Outage	10/30/2025	7,190.67	20
Transformer	Planned Outage	10/30/2025	40.20	2
Primary Wire	Planned Outage	10/31/2025	546.80	2
Switch	Planned Outage	10/31/2025	1,227.75	15
Transformer	Planned Outage	10/31/2025	189.67	4
Transformer	Planned Outage	10/31/2025	779.87	4
PLF	Planned Outage	10/31/2025	3,687.93	188
Transformer	Planned Outage	10/31/2025	178.70	3
Transformer	Planned Outage	10/31/2025	147.20	1
Transformer	Planned Outage	10/31/2025	89.22	1
Transformer	Planned Outage	10/31/2025	4,046.40	16
Transformer	Planned Outage	10/31/2025	358.07	1
Transformer	Planned Outage	10/31/2025	206.33	2
PLF	Planned Outage	10/31/2025	125.07	1
Transformer	Planned Outage	10/31/2025	120.33	5
PLF	Planned Outage	10/31/2025	52.37	2
Transformer	Planned Outage	10/31/2025	59.27	4
Transformer	Planned Outage	10/31/2025	75.87	1
Transformer	Planned Outage	10/31/2025	859.40	4
Transformer Bank	Planned Outage	10/31/2025	68.07	2
Service point	Planned Outage	10/31/2025	10.45	1
PLF	Planned Outage	11/1/2025	2,504.83	7
PLF	Planned Outage	11/1/2025	253.33	8
PLF	Planned Outage	11/1/2025	62.60	2
PLF	Planned Outage	11/1/2025	31.27	1
Transformer	Planned Outage	11/1/2025	52.32	1
Transformer Bank	Planned Outage	11/1/2025	175.35	9
Transformer	Planned Outage	11/1/2025	14.67	4
Transformer Bank	Planned Outage	11/1/2025	4.17	2
PLF	Planned Outage	11/1/2025	1,364.20	57
Transformer	Planned Outage	11/1/2025	65.50	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Switch	Planned Outage	11/1/2025	3,778.02	91
Transformer	Planned Outage	11/1/2025	8.30	2
Transformer	Planned Outage	11/2/2025	99.50	6
PLF	Planned Outage	11/2/2025	21.47	4
PLF	Planned Outage	11/2/2025	3,037.60	12
Invalid	Planned Outage	11/2/2025	1,289.00	12
Transformer	Planned Outage	11/2/2025	32.45	1
Transformer	Planned Outage	11/3/2025	434.70	7
Transformer	Planned Outage	11/3/2025	242.50	6
PLF	Planned Outage	11/3/2025	12.50	1
PLF	Planned Outage	11/3/2025	1,041.17	10
Transformer	Planned Outage	11/3/2025	76.50	2
PLF	Planned Outage	11/3/2025	318.08	1
Transformer	Planned Outage	11/3/2025	207.32	1
Transformer	Planned Outage	11/3/2025	318.20	4
Transformer Bank	Planned Outage	11/3/2025	1,261.08	5
Transformer	Planned Outage	11/3/2025	748.05	9
None	Planned Outage	11/3/2025	1,020.00	16
Transformer	Planned Outage	11/3/2025	123.50	5
Transformer	Planned Outage	11/3/2025	1,530.20	6
Transformer	Planned Outage	11/3/2025	1,952.70	9
Transformer Bank	Planned Outage	11/3/2025	415.10	6
Transformer	Planned Outage	11/3/2025	445.80	4
PLF	Planned Outage	11/3/2025	41.50	1
Transformer	Planned Outage	11/3/2025	225.67	4
Transformer Bank	Planned Outage	11/3/2025	73.53	4
Transformer	Planned Outage	11/3/2025	12.45	1
Transformer	Planned Outage	11/3/2025	13.48	1
Transformer Bank	Planned Outage	11/3/2025	327.72	7
Transformer	Planned Outage	11/3/2025	12.33	1
Transformer Bank	Planned Outage	11/3/2025	184.12	1
Transformer Bank	Planned Outage	11/3/2025	7,583.67	20
Transformer Bank	Planned Outage	11/4/2025	179.97	1
Transformer Bank	Planned Outage	11/4/2025	1,280.07	7
Transformer	Planned Outage	11/4/2025	512.50	25
Service point	Planned Outage	11/4/2025	129.55	1
Transformer	Planned Outage	11/4/2025	4,972.78	17
PLF	Planned Outage	11/4/2025	4,838.82	13
Transformer	Planned Outage	11/4/2025	315.90	9
Transformer	Planned Outage	11/4/2025	47.87	2
Primary Wire	Planned Outage	11/4/2025	8.25	3
Transformer	Planned Outage	11/4/2025	87.73	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	11/4/2025	325.15	7
Transformer Bank	Planned Outage	11/4/2025	602.47	7
Transformer	Planned Outage	11/4/2025	294.43	2
PLF	Planned Outage	11/4/2025	8,419.50	30
Transformer	Planned Outage	11/4/2025	272.10	18
Transformer	Planned Outage	11/4/2025	42.30	3
None	Planned Outage	11/5/2025	29.08	1
Transformer	Planned Outage	11/5/2025	3,630.90	14
Transformer	Planned Outage	11/5/2025	202.45	1
PLF	Planned Outage	11/5/2025	356.92	1
Transformer	Planned Outage	11/5/2025	15.92	5
Transformer	Planned Outage	11/5/2025	235.90	3
Transformer	Planned Outage	11/5/2025	17.05	3
PLF	Planned Outage	11/5/2025	1,436.07	13
Transformer	Planned Outage	11/5/2025	1,292.32	11
Transformer	Planned Outage	11/5/2025	183.28	7
Transformer	Planned Outage	11/5/2025	811.07	8
PLF	Planned Outage	11/5/2025	741.40	3
Transformer	Planned Outage	11/5/2025	272.30	6
None	Planned Outage	11/5/2025	309.75	7
Transformer Bank	Planned Outage	11/5/2025	457.15	3
PLF	Planned Outage	11/5/2025	54.02	7
Transformer	Planned Outage	11/5/2025	88.42	5
Transformer	Planned Outage	11/5/2025	744.67	5
PLF	Planned Outage	11/5/2025	197.93	2
Transformer	Planned Outage	11/6/2025	128.32	1
Transformer	Planned Outage	11/6/2025	357.33	8
Transformer	Planned Outage	11/6/2025	181.67	2
Transformer	Planned Outage	11/6/2025	124.00	1
Transformer	Planned Outage	11/6/2025	4,220.53	14
PLF	Planned Outage	11/6/2025	149.75	1
Transformer	Planned Outage	11/6/2025	72.20	4
Transformer	Planned Outage	11/6/2025	5.83	5
None	Planned Outage	11/6/2025	895.00	12
Transformer	Planned Outage	11/6/2025	155.80	4
Transformer	Planned Outage	11/6/2025	154.13	4
Transformer	Planned Outage	11/6/2025	436.80	7
Transformer	Planned Outage	11/6/2025	181.73	8
Transformer	Planned Outage	11/6/2025	6.02	1
Transformer	Planned Outage	11/6/2025	51.70	6
Transformer	Planned Outage	11/6/2025	4.60	4
Transformer	Planned Outage	11/6/2025	38.47	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
OH Other	Planned Outage	11/6/2025	9,210.67	40
None	Planned Outage	11/6/2025	107.47	62
None	Planned Outage	11/6/2025	196.67	50
PLF	Planned Outage	11/6/2025	116.70	1
PLF	Planned Outage	11/7/2025	11,868.08	55
Transformer	Planned Outage	11/7/2025	564.67	11
Transformer	Planned Outage	11/7/2025	363.00	9
Transformer	Planned Outage	11/7/2025	77.78	13
Transformer	Planned Outage	11/7/2025	51.08	5
Transformer	Planned Outage	11/7/2025	115.23	2
Transformer	Planned Outage	11/7/2025	327.35	3
Transformer	Planned Outage	11/7/2025	184.53	2
Transformer	Planned Outage	11/7/2025	59.97	7
Transformer	Planned Outage	11/7/2025	160.37	2
Transformer	Planned Outage	11/7/2025	11.37	1
Transformer	Planned Outage	11/7/2025	271.50	6
Transformer	Planned Outage	11/7/2025	23.27	2
Transformer	Planned Outage	11/7/2025	137.47	4
Transformer	Planned Outage	11/7/2025	90.60	3
Transformer	Planned Outage	11/7/2025	893.20	6
Transformer	Planned Outage	11/7/2025	38.33	4
Transformer	Planned Outage	11/7/2025	407.40	14
Transformer	Planned Outage	11/7/2025	206.15	7
Transformer	Planned Outage	11/7/2025	82.10	2
Transformer	Planned Outage	11/7/2025	289.67	5
Transformer	Planned Outage	11/7/2025	169.17	7
Transformer	Planned Outage	11/7/2025	177.08	5
Transformer	Planned Outage	11/7/2025	93.40	2
Transformer	Planned Outage	11/7/2025	9.23	1
Transformer	Planned Outage	11/7/2025	24.62	1
Transformer	Planned Outage	11/7/2025	66.20	4
None	Planned Outage	11/8/2025	204.93	8
None	Planned Outage	11/8/2025	774.40	4
PLF	Planned Outage	11/8/2025	265.67	1
Service point	Planned Outage	11/8/2025	425.65	1
Transformer Bank	Planned Outage	11/8/2025	253.17	2
Transformer Bank	Planned Outage	11/8/2025	191.58	1
Transformer	Planned Outage	11/8/2025	31.80	4
Transformer	Planned Outage	11/8/2025	35.83	2
Transformer	Planned Outage	11/8/2025	77.58	7
Transformer	Planned Outage	11/8/2025	3.10	2
Transformer	Planned Outage	11/8/2025	29.73	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	11/8/2025	33.70	6
Transformer Bank	Planned Outage	11/9/2025	26.43	1
PLF	Planned Outage	11/9/2025	564.78	7
Transformer	Planned Outage	11/10/2025	55.80	9
Transformer	Planned Outage	11/10/2025	259.70	3
Transformer	Planned Outage	11/10/2025	114.22	7
Transformer	Planned Outage	11/10/2025	736.05	7
Transformer	Planned Outage	11/10/2025	207.20	6
None	Planned Outage	11/10/2025	107.40	4
Transformer Bank	Planned Outage	11/10/2025	200.27	4
Transformer	Planned Outage	11/10/2025	21.60	9
Transformer	Planned Outage	11/10/2025	26.22	1
None	Planned Outage	11/10/2025	453.10	6
Transformer	Planned Outage	11/10/2025	33.35	3
Transformer	Planned Outage	11/10/2025	36.52	7
Transformer	Planned Outage	11/10/2025	17.58	5
Transformer	Planned Outage	11/10/2025	438.27	8
Transformer	Planned Outage	11/10/2025	8.53	8
Transformer	Planned Outage	11/10/2025	320.83	5
Invalid	Planned Outage	11/10/2025	70.53	8
Transformer	Planned Outage	11/10/2025	21.23	13
PLF	Planned Outage	11/11/2025	3,872.87	14
PLF	Planned Outage	11/11/2025	1,138.80	12
Transformer	Planned Outage	11/11/2025	498.30	9
Breaker	Planned Outage	11/11/2025	25,767.35	581
Breaker	Planned Outage	11/11/2025	47.95	1
Breaker	Planned Outage	11/11/2025	48.37	1
Transformer	Planned Outage	11/11/2025	62.42	5
Transformer Bank	Planned Outage	11/11/2025	18.73	2
Transformer Bank	Planned Outage	11/11/2025	35.73	4
PLF	Planned Outage	11/11/2025	476.57	2
PLF	Planned Outage	11/11/2025	303.67	1
PLF	Planned Outage	11/11/2025	2,951.12	11
PLF	Planned Outage	11/11/2025	616.95	27
Transformer	Planned Outage	11/11/2025	431.33	8
Transformer	Planned Outage	11/11/2025	149.00	10
Transformer	Planned Outage	11/11/2025	1,278.92	5
Switch	Planned Outage	11/11/2025	490.07	4
PLF	Planned Outage	11/11/2025	426.57	2
None	Planned Outage	11/11/2025	15,428.00	1330
Transformer	Planned Outage	11/11/2025	362.72	7
Transformer	Planned Outage	11/11/2025	92.67	10

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	11/11/2025	45.97	7
None	Planned Outage	11/11/2025	59.42	23
None	Planned Outage	11/11/2025	847.33	328
PLF	Planned Outage	11/11/2025	4,636.18	17
Transformer	Planned Outage	11/11/2025	56.17	5
Transformer	Planned Outage	11/11/2025	399.77	1
Transformer	Planned Outage	11/11/2025	575.70	6
Transformer	Planned Outage	11/11/2025	11.80	3
Transformer	Planned Outage	11/11/2025	35.32	13
PLF	Planned Outage	11/11/2025	110.75	3
Transformer	Planned Outage	11/11/2025	249.60	8
PLF	Planned Outage	11/11/2025	335.67	1
Transformer	Planned Outage	11/11/2025	40.75	5
Transformer	Planned Outage	11/11/2025	74.58	5
Transformer	Planned Outage	11/11/2025	11.25	1
Transformer	Planned Outage	11/11/2025	763.33	10
None	Planned Outage	11/12/2025	177.80	2
Transformer	Planned Outage	11/12/2025	444.02	1
Transformer Bank	Planned Outage	11/12/2025	626.27	4
PLF	Planned Outage	11/12/2025	1,672.33	4
Transformer	Planned Outage	11/12/2025	113.45	1
Transformer	Planned Outage	11/12/2025	5.80	4
Transformer	Planned Outage	11/12/2025	39.20	6
Transformer	Planned Outage	11/12/2025	97.75	1
Transformer	Planned Outage	11/12/2025	123.00	6
Transformer	Planned Outage	11/12/2025	1,033.43	7
Transformer	Planned Outage	11/12/2025	28.83	10
Service point	Planned Outage	11/12/2025	114.70	1
None	Planned Outage	11/12/2025	908.93	8
PLF	Planned Outage	11/12/2025	11.47	8
Transformer	Planned Outage	11/12/2025	40.70	1
PLF	Planned Outage	11/12/2025	2,778.97	11
Transformer Bank	Planned Outage	11/13/2025	241.93	2
None	Planned Outage	11/13/2025	211.35	3
Transformer	Planned Outage	11/13/2025	22.80	4
Transformer	Planned Outage	11/13/2025	5,332.80	18
Transformer	Planned Outage	11/13/2025	322.67	8
PLF	Planned Outage	11/13/2025	102.42	1
Transformer Bank	Planned Outage	11/13/2025	569.42	5
Transformer	Planned Outage	11/13/2025	409.00	6
PLF	Planned Outage	11/13/2025	5,188.40	68
Transformer	Planned Outage	11/13/2025	161.35	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	11/13/2025	246.95	11
UG Other	Planned Outage	11/13/2025	105.65	1
Transformer	Planned Outage	11/13/2025	42.72	1
Transformer	Planned Outage	11/13/2025	267.42	5
PLF	Planned Outage	11/13/2025	2,741.95	29
Invalid	Planned Outage	11/14/2025	1,084.95	9
Transformer	Planned Outage	11/14/2025	1,830.73	4
Transformer	Planned Outage	11/14/2025	378.83	5
PLF	Planned Outage	11/14/2025	4,488.40	14
PLF	Planned Outage	11/14/2025	29.33	11
Transformer	Planned Outage	11/14/2025	123.13	1
Transformer Bank	Planned Outage	11/14/2025	1,110.10	3
Transformer	Planned Outage	11/14/2025	100.33	4
Switch	Planned Outage	11/14/2025	5,192.83	10
Switch	Planned Outage	11/14/2025	834.12	1
Switch	Planned Outage	11/14/2025	834.12	1
Switch	Planned Outage	11/14/2025	118,624.60	228
Switch	Planned Outage	11/14/2025	4,984.00	10
Switch	Planned Outage	11/14/2025	10,925.95	21
Switch	Planned Outage	11/14/2025	8,057.17	10
Transformer	Planned Outage	11/14/2025	277.13	1
Transformer	Planned Outage	11/14/2025	42.75	5
Transformer	Planned Outage	11/14/2025	425.20	2
Transformer Bank	Planned Outage	11/14/2025	177.75	9
Transformer	Planned Outage	11/14/2025	162.05	3
Transformer	Planned Outage	11/14/2025	74.78	7
Transformer	Planned Outage	11/14/2025	40.83	5
Transformer	Planned Outage	11/14/2025	24.25	5
Transformer	Planned Outage	11/14/2025	93.45	9
Switch	Planned Outage	11/14/2025	3,142.83	10
Transformer Bank	Planned Outage	11/15/2025	251.70	1
None	Planned Outage	11/15/2025	587.30	3
Transformer Bank	Planned Outage	11/15/2025	3.97	1
PLF	Planned Outage	11/15/2025	271.83	5
Transformer	Planned Outage	11/15/2025	152.33	1
Transformer Bank	Planned Outage	11/15/2025	946.42	5
None	Planned Outage	11/15/2025	58.45	7
Transformer	Planned Outage	11/15/2025	48.28	1
Transformer	Planned Outage	11/15/2025	12.20	2
Transformer	Planned Outage	11/15/2025	122.65	3
PLF	Planned Outage	11/15/2025	34.40	4
Transformer	Planned Outage	11/15/2025	651.07	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	11/16/2025	147.97	2
Transformer	Planned Outage	11/16/2025	1,582.13	8
Transformer Bank	Planned Outage	11/16/2025	63.87	1
PLF	Planned Outage	11/16/2025	272.40	1
PLF	Planned Outage	11/16/2025	188.42	17
Breaker	Planned Outage	11/17/2025	10,500.42	869
Primary Wire	Planned Outage	11/17/2025	253.82	1
Primary Wire	Planned Outage	11/17/2025	1,001.20	4
Transformer Bank	Planned Outage	11/17/2025	2,074.80	6
Transformer Bank	Planned Outage	11/17/2025	345.72	1
Transformer	Planned Outage	11/17/2025	14.20	4
Transformer	Planned Outage	11/17/2025	74.00	5
Transformer	Planned Outage	11/17/2025	92.85	9
Transformer	Planned Outage	11/17/2025	2,260.67	8
Primary Wire	Planned Outage	11/17/2025	487.33	1
Primary Wire	Planned Outage	11/17/2025	12,854.50	30
Transformer	Planned Outage	11/17/2025	180.60	7
Transformer	Planned Outage	11/17/2025	265.67	4
Primary Wire	Planned Outage	11/17/2025	15,389.73	44
Transformer	Planned Outage	11/17/2025	108.05	3
Transformer Bank	Planned Outage	11/17/2025	14.13	8
Transformer	Planned Outage	11/17/2025	7.03	2
Transformer	Planned Outage	11/17/2025	12.63	1
Transformer	Planned Outage	11/17/2025	3.55	3
Transformer	Planned Outage	11/17/2025	18.38	1
Transformer Bank	Planned Outage	11/17/2025	626.03	7
PLF	Planned Outage	11/18/2025	6,709.33	32
Transformer	Planned Outage	11/18/2025	259.45	3
Transformer	Planned Outage	11/18/2025	257.50	5
Transformer	Planned Outage	11/18/2025	55.30	7
Transformer Bank	Planned Outage	11/18/2025	55.70	6
Transformer	Planned Outage	11/18/2025	1,788.25	5
Transformer Bank	Planned Outage	11/18/2025	432.70	6
Transformer	Planned Outage	11/18/2025	195.90	6
Transformer	Planned Outage	11/18/2025	2.93	2
Transformer	Planned Outage	11/18/2025	170.25	1
Transformer	Planned Outage	11/18/2025	280.57	19
Transformer	Planned Outage	11/18/2025	32.10	3
Transformer	Planned Outage	11/18/2025	362.70	9
Transformer	Planned Outage	11/18/2025	33.47	4
Transformer Bank	Planned Outage	11/18/2025	1,743.92	5
Transformer Bank	Planned Outage	11/18/2025	89.10	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	11/18/2025	92.08	1
Transformer	Planned Outage	11/18/2025	2,368.50	18
Transformer	Planned Outage	11/18/2025	34.83	2
Transformer	Planned Outage	11/18/2025	27.35	1
Transformer	Planned Outage	11/18/2025	1,182.30	9
None	Planned Outage	11/18/2025	1,560.53	56
Transformer Bank	Planned Outage	11/18/2025	67.40	2
Transformer Bank	Planned Outage	11/18/2025	2.03	2
Transformer	Planned Outage	11/18/2025	6.13	1
Transformer	Planned Outage	11/18/2025	11.33	4
Transformer	Planned Outage	11/18/2025	164.93	4
Transformer Bank	Planned Outage	11/18/2025	115.67	5
Transformer Bank	Planned Outage	11/18/2025	1,416.27	8
Transformer	Planned Outage	11/19/2025	172.67	5
Breaker	Planned Outage	11/19/2025	25,506.00	654
Breaker	Planned Outage	11/19/2025	25,506.00	654
Primary Wire	Planned Outage	11/19/2025	681.20	8
Primary Wire	Planned Outage	11/19/2025	152.35	1
Transformer	Planned Outage	11/19/2025	1,444.22	7
None	Planned Outage	11/19/2025	2,437.23	11
None	Planned Outage	11/19/2025	221.57	1
None	Planned Outage	11/19/2025	232.68	1
PLF	Planned Outage	11/19/2025	46,082.67	110
Transformer	Planned Outage	11/19/2025	656.65	3
Primary Wire	Planned Outage	11/19/2025	5,228.30	14
Breaker	Planned Outage	11/19/2025	15,436.00	454
Breaker	Planned Outage	11/19/2025	15,436.00	454
Transformer	Planned Outage	11/19/2025	154.27	2
Transformer	Planned Outage	11/19/2025	873.00	6
Transformer	Planned Outage	11/19/2025	52.87	2
Transformer Bank	Planned Outage	11/19/2025	56.80	1
Transformer Bank	Planned Outage	11/19/2025	22.60	2
Transformer	Planned Outage	11/19/2025	8.20	2
Transformer	Planned Outage	11/19/2025	82.20	2
Transformer	Planned Outage	11/19/2025	156.67	4
Transformer	Planned Outage	11/19/2025	36.83	2
Transformer	Planned Outage	11/19/2025	29.57	1
None	Planned Outage	11/19/2025	2,071.87	41
None	Planned Outage	11/19/2025	1,639.00	20
PLF	Planned Outage	11/19/2025	409.25	5
Transformer	Planned Outage	11/19/2025	18.63	1
Transformer Bank	Planned Outage	11/19/2025	417.92	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	11/19/2025	3.60	3
Transformer	Planned Outage	11/19/2025	1,023.00	5
Transformer	Planned Outage	11/20/2025	269.20	6
Transformer	Planned Outage	11/20/2025	264.00	5
Transformer	Planned Outage	11/20/2025	411.30	1
Transformer	Planned Outage	11/20/2025	3,517.20	8
Transformer	Planned Outage	11/20/2025	367.10	1
Transformer	Planned Outage	11/20/2025	25.90	1
Transformer	Planned Outage	11/20/2025	1,843.23	11
Transformer	Planned Outage	11/20/2025	320.30	6
Transformer	Planned Outage	11/20/2025	38.13	8
Transformer Bank	Planned Outage	11/20/2025	318.57	2
Transformer Bank	Planned Outage	11/20/2025	318.97	2
Transformer	Planned Outage	11/20/2025	746.10	9
Transformer	Planned Outage	11/20/2025	55.00	4
Transformer	Planned Outage	11/20/2025	20.80	4
Transformer	Planned Outage	11/20/2025	76.75	5
Transformer	Planned Outage	11/20/2025	24.67	8
Transformer	Planned Outage	11/20/2025	31.75	5
Transformer	Planned Outage	11/20/2025	80.27	4
Transformer Bank	Planned Outage	11/20/2025	8.13	4
PLF	Planned Outage	11/20/2025	25.92	1
Transformer	Planned Outage	11/20/2025	963.43	2
PLF	Planned Outage	11/20/2025	340.97	1
Transformer	Planned Outage	11/21/2025	459.10	2
Transformer	Planned Outage	11/21/2025	11.70	1
Transformer Bank	Planned Outage	11/21/2025	64.97	2
Transformer Bank	Planned Outage	11/21/2025	311.55	1
Transformer Bank	Planned Outage	11/21/2025	456.50	2
Transformer	Planned Outage	11/21/2025	762.88	13
Transformer	Planned Outage	11/21/2025	57.93	2
Transformer	Planned Outage	11/21/2025	20.93	1
Transformer	Planned Outage	11/21/2025	131.63	1
Transformer	Planned Outage	11/21/2025	7.13	4
Transformer	Planned Outage	11/21/2025	3.80	1
Transformer	Planned Outage	11/21/2025	1,965.90	9
Transformer	Planned Outage	11/21/2025	24.40	2
Transformer	Planned Outage	11/21/2025	295.98	7
Transformer	Planned Outage	11/21/2025	60.90	7
Transformer	Planned Outage	11/21/2025	7.75	3
Transformer	Planned Outage	11/21/2025	40.13	4
Transformer	Planned Outage	11/21/2025	259.50	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	11/21/2025	11.80	1
Transformer	Planned Outage	11/21/2025	13.60	2
Transformer	Planned Outage	11/21/2025	73.38	1
Transformer	Planned Outage	11/21/2025	39.60	2
Transformer	Planned Outage	11/21/2025	22.83	1
Transformer	Planned Outage	11/21/2025	36.57	1
Transformer	Planned Outage	11/21/2025	47.00	2
Transformer	Planned Outage	11/21/2025	36.17	5
Transformer Bank	Planned Outage	11/21/2025	576.33	14
Transformer	Planned Outage	11/21/2025	117.42	5
Invalid	Planned Outage	11/21/2025	102.77	2
Service point	Planned Outage	11/22/2025	70.25	1
PLF	Planned Outage	11/22/2025	386.92	1
Transformer	Planned Outage	11/22/2025	594.55	3
Transformer	Planned Outage	11/22/2025	195.00	9
None	Planned Outage	11/22/2025	464.53	8
Transformer	Planned Outage	11/22/2025	1,289.28	7
None	Planned Outage	11/22/2025	1,738.10	21
PLF	Planned Outage	11/22/2025	304.80	1
None	Planned Outage	11/22/2025	322.40	6
None	Planned Outage	11/22/2025	303.73	8
Transformer Bank	Planned Outage	11/22/2025	26.83	1
Transformer	Planned Outage	11/22/2025	8.05	3
Transformer Bank	Planned Outage	11/22/2025	28.87	1
Transformer Bank	Planned Outage	11/22/2025	256.80	9
Transformer	Planned Outage	11/23/2025	8.67	1
Transformer Bank	Planned Outage	11/23/2025	50.68	1
Transformer	Planned Outage	11/23/2025	74.40	1
Transformer	Planned Outage	11/23/2025	16.53	4
Transformer	Planned Outage	11/23/2025	9.20	4
Transformer	Planned Outage	11/23/2025	324.00	10
Transformer	Planned Outage	11/23/2025	22.97	1
Transformer	Planned Outage	11/23/2025	22.33	4
Transformer	Planned Outage	11/23/2025	109.73	4
Transformer	Planned Outage	11/24/2025	480.00	4
PLF	Planned Outage	11/24/2025	148.67	10
Transformer	Planned Outage	11/24/2025	18.67	5
Transformer	Planned Outage	11/24/2025	90.45	1
Transformer	Planned Outage	11/24/2025	67.67	7
Transformer	Planned Outage	11/24/2025	1,747.62	23
Transformer	Planned Outage	11/24/2025	267.47	8
Transformer	Planned Outage	11/24/2025	33.07	4

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	11/24/2025	103.20	4
Transformer	Planned Outage	11/24/2025	80.20	1
PLF	Planned Outage	11/24/2025	468.27	4
Transformer	Planned Outage	11/24/2025	44.22	1
Transformer	Planned Outage	11/24/2025	24.27	4
Transformer	Planned Outage	11/24/2025	78.40	8
PLF	Planned Outage	11/24/2025	1,569.75	21
PLF	Planned Outage	11/24/2025	41.85	3
None	Planned Outage	11/24/2025	126.20	12
Transformer	Planned Outage	11/24/2025	294.00	9
Transformer	Planned Outage	11/24/2025	35.33	10
Transformer	Planned Outage	11/24/2025	10.15	1
Transformer	Planned Outage	11/24/2025	367.33	8
Transformer	Planned Outage	11/24/2025	29.10	3
Transformer	Planned Outage	11/24/2025	267.33	8
Transformer	Planned Outage	11/24/2025	301.00	4
Transformer	Planned Outage	11/24/2025	617.00	6
Transformer	Planned Outage	11/25/2025	4,197.60	12
Transformer	Planned Outage	11/25/2025	13.40	4
PLF	Planned Outage	11/25/2025	484.40	12
PLF	Planned Outage	11/25/2025	151.95	1
Transformer	Planned Outage	11/25/2025	192.67	5
None	Planned Outage	11/25/2025	34.88	1
None	Planned Outage	11/25/2025	104.30	3
PLF	Planned Outage	11/25/2025	3,939.00	36
Primary Wire	Planned Outage	11/25/2025	160.28	1
Primary Wire	Planned Outage	11/25/2025	160.90	1
Primary Wire	Planned Outage	11/25/2025	160.70	1
Primary Wire	Planned Outage	11/25/2025	160.28	1
Primary Wire	Planned Outage	11/25/2025	24.93	11
Primary Wire	Planned Outage	11/25/2025	30.62	11
Primary Wire	Planned Outage	11/25/2025	30.07	11
Primary Wire	Planned Outage	11/25/2025	5,974.23	38
Transformer	Planned Outage	11/25/2025	47.20	1
Transformer	Planned Outage	11/25/2025	284.37	2
Transformer	Planned Outage	11/25/2025	237.73	1
PLF	Planned Outage	11/25/2025	1,619.80	13
Service point	Planned Outage	11/25/2025	11.90	1
None	Planned Outage	11/25/2025	235.00	12
Transformer	Planned Outage	11/25/2025	116.80	6
None	Planned Outage	11/25/2025	716.33	5
Transformer	Planned Outage	11/25/2025	111.30	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	11/25/2025	35.48	1
Transformer	Planned Outage	11/25/2025	1,570.45	7
Transformer	Planned Outage	11/25/2025	1,168.65	9
Transformer Bank	Planned Outage	11/25/2025	240.50	13
PLF	Planned Outage	11/25/2025	238.97	1
Transformer	Planned Outage	11/25/2025	113.30	11
Transformer	Planned Outage	11/25/2025	68.20	2
PLF	Planned Outage	11/26/2025	647.05	3
Transformer	Planned Outage	11/26/2025	345.42	25
Transformer	Planned Outage	11/26/2025	23.10	11
Transformer	Planned Outage	11/26/2025	389.48	1
Transformer	Planned Outage	11/26/2025	116.53	4
Transformer	Planned Outage	11/26/2025	1,896.83	10
Transformer	Planned Outage	11/26/2025	11.20	7
Transformer	Planned Outage	11/26/2025	1,408.50	9
Transformer	Planned Outage	11/26/2025	963.45	9
Transformer	Planned Outage	11/26/2025	50.05	7
Transformer	Planned Outage	11/26/2025	77.90	2
Transformer	Planned Outage	11/26/2025	222.98	17
Transformer Bank	Planned Outage	11/26/2025	122.18	1
Transformer Bank	Planned Outage	11/26/2025	436.67	2
Breaker	Planned Outage	11/27/2025	3,899.70	189
Breaker	Planned Outage	11/27/2025	8,199.68	1049
Breaker	Planned Outage	11/27/2025	22,274.00	1295
Switch	Planned Outage	11/28/2025	1,965.83	10
Switch	Planned Outage	11/28/2025	188.12	1
Transformer	Planned Outage	11/29/2025	1,699.48	7
None	Planned Outage	11/29/2025	494.43	7
None	Planned Outage	11/29/2025	82.83	2
Transformer	Planned Outage	11/29/2025	168.05	3
Transformer	Planned Outage	11/29/2025	868.00	8
None	Planned Outage	11/29/2025	169.40	3
Transformer	Planned Outage	11/29/2025	750.80	8
Transformer	Planned Outage	11/29/2025	548.45	7
Transformer	Planned Outage	11/29/2025	27.38	1
Transformer	Planned Outage	11/29/2025	164.87	4
Transformer	Planned Outage	11/29/2025	104.50	2
Transformer	Planned Outage	11/29/2025	13.07	4
PLF	Planned Outage	11/30/2025	337.28	7
Transformer	Planned Outage	11/30/2025	104.77	2
Transformer	Planned Outage	11/30/2025	3.75	1
Transformer	Planned Outage	12/1/2025	725.25	9

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/1/2025	17.98	1
Transformer	Planned Outage	12/1/2025	602.25	15
Transformer	Planned Outage	12/1/2025	404.40	8
Transformer	Planned Outage	12/1/2025	98.85	3
Transformer	Planned Outage	12/1/2025	94.90	2
Transformer	Planned Outage	12/1/2025	58.70	1
Transformer	Planned Outage	12/1/2025	1,580.92	5
Transformer	Planned Outage	12/1/2025	62.60	4
Transformer Bank	Planned Outage	12/1/2025	251.23	1
Transformer	Planned Outage	12/1/2025	13.67	5
None	Planned Outage	12/1/2025	2,096.40	9
Transformer	Planned Outage	12/1/2025	120.83	5
Transformer	Planned Outage	12/1/2025	22.13	2
Transformer	Planned Outage	12/1/2025	3.27	2
Transformer	Planned Outage	12/1/2025	1,694.00	11
Transformer	Planned Outage	12/1/2025	54.37	2
Transformer	Planned Outage	12/1/2025	70.00	5
Transformer	Planned Outage	12/1/2025	130.58	1
Transformer	Planned Outage	12/1/2025	127.80	27
Transformer	Planned Outage	12/1/2025	54.73	2
PLF	Planned Outage	12/2/2025	15.02	1
Primary Wire	Planned Outage	12/2/2025	236.98	1
Primary Wire	Planned Outage	12/2/2025	472.97	2
Transformer	Planned Outage	12/2/2025	367.87	1
Transformer	Planned Outage	12/2/2025	253.50	6
Transformer	Planned Outage	12/2/2025	1,034.33	4
Transformer	Planned Outage	12/2/2025	18.45	1
Breaker	Planned Outage	12/2/2025	2,057.00	242
Transformer Bank	Planned Outage	12/2/2025	298.07	1
Transformer	Planned Outage	12/2/2025	2.00	2
Transformer	Planned Outage	12/2/2025	90.60	12
Transformer	Planned Outage	12/2/2025	4,787.07	14
Transformer Bank	Planned Outage	12/2/2025	55.62	1
Transformer	Planned Outage	12/2/2025	58.17	2
Transformer	Planned Outage	12/2/2025	160.58	1
Transformer	Planned Outage	12/2/2025	1,444.08	13
Transformer	Planned Outage	12/2/2025	678.65	21
PLF	Planned Outage	12/2/2025	361.07	16
PLF	Planned Outage	12/2/2025	85.20	4
Transformer	Planned Outage	12/2/2025	60.87	4
Transformer	Planned Outage	12/2/2025	918.75	5
Transformer	Planned Outage	12/2/2025	7.25	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
None	Planned Outage	12/2/2025	149.45	3
Transformer	Planned Outage	12/2/2025	214.53	4
Transformer	Planned Outage	12/2/2025	3.07	1
Transformer	Planned Outage	12/2/2025	231.27	2
Transformer	Planned Outage	12/2/2025	4.80	4
Transformer	Planned Outage	12/2/2025	341.47	8
Transformer	Planned Outage	12/2/2025	57.67	4
Transformer	Planned Outage	12/2/2025	58.67	2
Transformer	Planned Outage	12/2/2025	875.70	7
Transformer	Planned Outage	12/2/2025	347.50	5
Transformer	Planned Outage	12/2/2025	1,315.83	10
Transformer	Planned Outage	12/2/2025	21.97	1
Transformer	Planned Outage	12/2/2025	34.28	1
Transformer	Planned Outage	12/2/2025	23.27	4
Transformer	Planned Outage	12/2/2025	23.47	4
None	Planned Outage	12/2/2025	1,337.00	140
Transformer Bank	Planned Outage	12/3/2025	45.12	1
Transformer Bank	Planned Outage	12/3/2025	305.83	2
Transformer	Planned Outage	12/3/2025	125.90	3
Transformer	Planned Outage	12/3/2025	43.50	10
Transformer	Planned Outage	12/3/2025	309.87	4
Transformer	Planned Outage	12/3/2025	37.92	1
Transformer	Planned Outage	12/3/2025	36.60	1
PLF	Planned Outage	12/3/2025	347.82	1
Transformer	Planned Outage	12/3/2025	223.25	5
Transformer	Planned Outage	12/3/2025	5.93	2
None	Planned Outage	12/3/2025	542.33	20
PLF	Planned Outage	12/3/2025	78.53	1
Transformer	Planned Outage	12/3/2025	106.40	8
Transformer	Planned Outage	12/3/2025	57.13	1
Transformer	Planned Outage	12/3/2025	11.70	6
Transformer	Planned Outage	12/3/2025	413.47	8
Transformer	Planned Outage	12/3/2025	170.27	2
Transformer	Planned Outage	12/3/2025	889.35	9
Transformer	Planned Outage	12/3/2025	131.70	2
Transformer	Planned Outage	12/3/2025	32.08	1
Transformer	Planned Outage	12/3/2025	153.08	5
PLF	Planned Outage	12/3/2025	1,032.80	8
Transformer	Planned Outage	12/3/2025	233.32	1
None	Planned Outage	12/3/2025	253.92	5
Transformer Bank	Planned Outage	12/4/2025	213.37	2
PLF	Planned Outage	12/4/2025	81.00	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/4/2025	406.80	4
None	Planned Outage	12/4/2025	141.27	4
Transformer	Planned Outage	12/4/2025	140.80	4
Transformer	Planned Outage	12/4/2025	1,331.30	6
PLF	Planned Outage	12/4/2025	258.40	19
Transformer	Planned Outage	12/4/2025	386.80	8
Transformer	Planned Outage	12/4/2025	225.10	1
PLF	Planned Outage	12/4/2025	8,996.00	78
PLF	Planned Outage	12/4/2025	7,534.83	53
PLF	Planned Outage	12/4/2025	3,806.60	28
PLF	Planned Outage	12/4/2025	3,126.85	23
Transformer	Planned Outage	12/4/2025	535.42	5
Transformer	Planned Outage	12/4/2025	68.87	4
Transformer	Planned Outage	12/4/2025	517.20	8
Transformer	Planned Outage	12/4/2025	394.83	5
Transformer	Planned Outage	12/4/2025	77.07	8
None	Planned Outage	12/4/2025	1,341.73	29
Transformer	Planned Outage	12/4/2025	436.00	10
PLF	Planned Outage	12/4/2025	120.15	3
Service point	Planned Outage	12/4/2025	12.48	1
Transformer Bank	Planned Outage	12/4/2025	776.90	2
Transformer	Planned Outage	12/5/2025	72.20	6
Transformer	Planned Outage	12/5/2025	1,144.53	8
PLF	Planned Outage	12/5/2025	55.50	1
Transformer	Planned Outage	12/5/2025	28.13	4
Transformer	Planned Outage	12/5/2025	127.48	1
Transformer	Planned Outage	12/5/2025	8.67	2
Transformer	Planned Outage	12/5/2025	458.62	7
Service point	Planned Outage	12/5/2025	65.68	1
None	Planned Outage	12/5/2025	1,024.50	15
Transformer	Planned Outage	12/5/2025	199.65	9
Transformer	Planned Outage	12/5/2025	57.52	1
Transformer	Planned Outage	12/5/2025	885.33	10
Transformer	Planned Outage	12/5/2025	58.07	2
None	Planned Outage	12/5/2025	1,365.15	57
Transformer	Planned Outage	12/5/2025	285.60	8
Transformer	Planned Outage	12/5/2025	816.50	10
Transformer	Planned Outage	12/5/2025	12.05	3
Transformer	Planned Outage	12/5/2025	302.80	8
None	Planned Outage	12/6/2025	10,097.43	17
Breaker	Planned Outage	12/6/2025	4,606.38	577
Transformer	Planned Outage	12/6/2025	93.67	5

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	12/6/2025	270.52	1
Transformer	Planned Outage	12/6/2025	61.58	5
Transformer	Planned Outage	12/6/2025	31.25	3
None	Planned Outage	12/6/2025	651.23	7
Transformer	Planned Outage	12/6/2025	344.33	20
Transformer	Planned Outage	12/6/2025	116.30	6
Transformer	Planned Outage	12/6/2025	61.25	5
Transformer	Planned Outage	12/6/2025	70.73	4
PLF	Planned Outage	12/6/2025	170,441.10	738
None	Planned Outage	12/6/2025	553.73	8
PLF	Planned Outage	12/6/2025	137.40	2
Transformer	Planned Outage	12/6/2025	89.60	4
PLF	Planned Outage	12/6/2025	11,466.00	36
PLF	Planned Outage	12/6/2025	143.67	1
PLF	Planned Outage	12/6/2025	124.80	1
Transformer Bank	Planned Outage	12/7/2025	1.50	1
Invalid	Planned Outage	12/7/2025	841.87	8
Breaker	Planned Outage	12/7/2025	2,266.18	47
Breaker	Planned Outage	12/7/2025	15,889.80	639
Breaker	Planned Outage	12/7/2025	23,221.95	477
None	Planned Outage	12/7/2025	13,380.00	892
Service point	Planned Outage	12/7/2025	3.95	1
Switch	Planned Outage	12/7/2025	1,713.88	391
Switch	Planned Outage	12/7/2025	353.17	326
PLF	Planned Outage	12/7/2025	3,830.73	74
Transformer	Planned Outage	12/7/2025	1,866.20	7
Breaker	Planned Outage	12/8/2025	5,904.07	913
PLF	Planned Outage	12/8/2025	371.00	21
Transformer	Planned Outage	12/8/2025	298.10	6
Transformer	Planned Outage	12/8/2025	47.42	5
Transformer	Planned Outage	12/8/2025	77.33	4
Primary Wire	Planned Outage	12/8/2025	3,938.50	15
Transformer	Planned Outage	12/8/2025	258.80	12
Transformer	Planned Outage	12/8/2025	1,497.73	8
Transformer	Planned Outage	12/8/2025	59.70	1
Transformer	Planned Outage	12/8/2025	44.87	1
Transformer	Planned Outage	12/8/2025	242.10	6
Transformer	Planned Outage	12/8/2025	161.87	8
None	Planned Outage	12/8/2025	88.67	10
Transformer	Planned Outage	12/8/2025	692.82	11
Transformer	Planned Outage	12/8/2025	638.50	5
Transformer	Planned Outage	12/8/2025	157.45	3

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/8/2025	1,611.92	5
Transformer	Planned Outage	12/8/2025	50.20	4
None	Planned Outage	12/8/2025	43.97	1
None	Planned Outage	12/8/2025	43.97	1
None	Planned Outage	12/8/2025	43.97	1
None	Planned Outage	12/8/2025	43.97	1
None	Planned Outage	12/8/2025	2,132.75	57
Transformer	Planned Outage	12/8/2025	62.80	12
Transformer	Planned Outage	12/8/2025	45.55	1
PLF	Planned Outage	12/8/2025	146.40	24
Transformer	Planned Outage	12/8/2025	74.50	6
Transformer	Planned Outage	12/8/2025	7.80	4
Transformer	Planned Outage	12/8/2025	139.80	6
Transformer	Planned Outage	12/8/2025	65.50	1
None	Planned Outage	12/8/2025	175.50	3
Transformer	Planned Outage	12/8/2025	240.33	4
Transformer	Planned Outage	12/8/2025	479.60	6
Transformer	Planned Outage	12/8/2025	88.85	3
Transformer Bank	Planned Outage	12/8/2025	58.60	2
Transformer	Planned Outage	12/8/2025	1,013.87	8
PLF	Planned Outage	12/8/2025	79.25	3
None	Planned Outage	12/8/2025	9,145.03	77
Transformer Bank	Planned Outage	12/8/2025	720.67	4
Transformer	Planned Outage	12/9/2025	1,095.05	11
Transformer	Planned Outage	12/9/2025	4,324.60	12
Transformer	Planned Outage	12/9/2025	587.30	3
Transformer	Planned Outage	12/9/2025	587.40	3
Transformer	Planned Outage	12/9/2025	1,228.62	7
Transformer	Planned Outage	12/9/2025	2,926.00	7
Transformer	Planned Outage	12/9/2025	615.70	6
Transformer Bank	Planned Outage	12/9/2025	419.98	1
Transformer	Planned Outage	12/9/2025	634.93	8
Transformer	Planned Outage	12/9/2025	85.75	5
Transformer	Planned Outage	12/9/2025	845.67	4
Transformer	Planned Outage	12/9/2025	1,035.18	7
Transformer	Planned Outage	12/9/2025	130.50	2
Transformer	Planned Outage	12/9/2025	696.20	6
Transformer	Planned Outage	12/9/2025	102.77	2
Transformer	Planned Outage	12/9/2025	50.38	1
Transformer	Planned Outage	12/9/2025	51.98	1
PLF	Planned Outage	12/9/2025	1,821.98	7
Transformer Bank	Planned Outage	12/9/2025	26.22	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Recloser	Planned Outage	12/9/2025	391.33	40
PLF	Planned Outage	12/9/2025	491.17	10
Transformer	Planned Outage	12/9/2025	70.05	3
Transformer	Planned Outage	12/9/2025	20.77	7
Transformer	Planned Outage	12/9/2025	147.20	6
Transformer	Planned Outage	12/9/2025	244.87	4
PLF	Planned Outage	12/9/2025	650.27	4
PLF	Planned Outage	12/9/2025	3,663.90	23
Transformer	Planned Outage	12/9/2025	124.50	5
Transformer	Planned Outage	12/9/2025	306.92	5
Transformer	Planned Outage	12/9/2025	5.78	1
Transformer	Planned Outage	12/9/2025	141.17	14
Transformer	Planned Outage	12/9/2025	300.75	5
Transformer	Planned Outage	12/9/2025	55.20	12
Primary Wire	Planned Outage	12/9/2025	1,477.47	7
PLF	Planned Outage	12/9/2025	535.33	40
Transformer	Planned Outage	12/9/2025	135.95	3
Transformer	Planned Outage	12/10/2025	31.92	5
Transformer	Planned Outage	12/10/2025	124.60	1
Transformer	Planned Outage	12/10/2025	1,462.67	10
Transformer	Planned Outage	12/10/2025	34.27	4
Transformer	Planned Outage	12/10/2025	663.85	33
Primary Wire	Planned Outage	12/10/2025	154.20	4
Transformer	Planned Outage	12/10/2025	938.00	10
Transformer	Planned Outage	12/10/2025	183.13	4
Transformer	Planned Outage	12/10/2025	221.20	14
PLF	Planned Outage	12/10/2025	484.93	2
Transformer	Planned Outage	12/10/2025	14.47	2
Transformer Bank	Planned Outage	12/10/2025	125.17	1
Transformer	Planned Outage	12/10/2025	34.83	22
Transformer	Planned Outage	12/10/2025	57.93	22
Transformer	Planned Outage	12/10/2025	40.70	22
Transformer	Planned Outage	12/10/2025	63.43	22
Transformer	Planned Outage	12/10/2025	69.30	22
Transformer	Planned Outage	12/10/2025	75.17	22
Transformer	Planned Outage	12/10/2025	94.23	22
Transformer	Planned Outage	12/10/2025	3,486.27	22
None	Planned Outage	12/10/2025	2,152.73	14
Transformer	Planned Outage	12/10/2025	90.10	2
PLF	Planned Outage	12/10/2025	2,531.60	12
Transformer	Planned Outage	12/10/2025	458.53	8
Transformer Bank	Planned Outage	12/10/2025	1,925.00	22

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/10/2025	234.68	1
PLF	Planned Outage	12/10/2025	4,129.97	19
Transformer	Planned Outage	12/10/2025	133.73	8
Switch	Planned Outage	12/10/2025	541.13	2
Transformer	Planned Outage	12/10/2025	48.83	10
Transformer	Planned Outage	12/10/2025	580.80	8
PLF	Planned Outage	12/10/2025	1,443.58	85
Transformer	Planned Outage	12/10/2025	601.33	4
PLF	Planned Outage	12/10/2025	554.67	4
PLF	Planned Outage	12/10/2025	12.23	2
PLF	Planned Outage	12/10/2025	406.50	9
Transformer	Planned Outage	12/10/2025	109.60	4
Service point	Planned Outage	12/10/2025	29.07	1
Transformer	Planned Outage	12/10/2025	3,307.92	25
Transformer	Planned Outage	12/10/2025	85.42	1
Transformer	Planned Outage	12/10/2025	157.85	7
Transformer	Planned Outage	12/10/2025	136.20	9
Transformer Bank	Planned Outage	12/10/2025	32.00	2
Transformer	Planned Outage	12/10/2025	809.13	4
PLF	Planned Outage	12/10/2025	120.60	1
Transformer	Planned Outage	12/10/2025	90.20	4
PLF	Planned Outage	12/10/2025	78.82	1
Transformer	Planned Outage	12/11/2025	136.70	6
Transformer	Planned Outage	12/11/2025	404.87	4
Transformer	Planned Outage	12/11/2025	353.15	1
Transformer	Planned Outage	12/11/2025	86.42	5
Transformer	Planned Outage	12/11/2025	40.60	7
Transformer Bank	Planned Outage	12/11/2025	124.33	4
Transformer	Planned Outage	12/11/2025	235.53	2
Transformer	Planned Outage	12/11/2025	76.67	10
Transformer	Planned Outage	12/11/2025	239.25	5
Transformer	Planned Outage	12/11/2025	116.13	2
Transformer Bank	Planned Outage	12/11/2025	582.98	7
Transformer	Planned Outage	12/11/2025	38.15	3
Transformer	Planned Outage	12/11/2025	145.00	10
Transformer	Planned Outage	12/11/2025	195.65	13
Transformer Bank	Planned Outage	12/11/2025	404.20	1
Transformer	Planned Outage	12/11/2025	18.75	3
Transformer	Planned Outage	12/11/2025	922.05	9
Transformer	Planned Outage	12/11/2025	395.93	1
Transformer	Planned Outage	12/11/2025	32.45	3
PLF	Planned Outage	12/11/2025	132.20	2

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/11/2025	295.80	6
Transformer	Planned Outage	12/11/2025	502.80	8
Transformer	Planned Outage	12/11/2025	314.35	1
Transformer	Planned Outage	12/11/2025	1,144.50	6
Transformer Bank	Planned Outage	12/11/2025	45.92	1
Transformer	Planned Outage	12/11/2025	367.70	2
Transformer	Planned Outage	12/11/2025	72.00	9
Transformer	Planned Outage	12/11/2025	170.75	5
PLF	Planned Outage	12/11/2025	2,435.83	10
PLF	Planned Outage	12/11/2025	3,865.33	16
Transformer	Planned Outage	12/11/2025	12.15	9
Transformer	Planned Outage	12/11/2025	220.33	1
Transformer	Planned Outage	12/11/2025	5.20	3
Transformer	Planned Outage	12/11/2025	221.00	4
Transformer	Planned Outage	12/11/2025	16.60	12
Transformer	Planned Outage	12/11/2025	91.87	8
Transformer	Planned Outage	12/11/2025	315.12	7
Breaker	Planned Outage	12/11/2025	56.35	1
Breaker	Planned Outage	12/11/2025	1,407.92	25
Breaker	Planned Outage	12/11/2025	71,444.33	1340
Breaker	Planned Outage	12/11/2025	56.35	1
Breaker	Planned Outage	12/11/2025	56.35	1
Breaker	Planned Outage	12/11/2025	56.35	1
Breaker	Planned Outage	12/11/2025	56.35	1
Breaker	Planned Outage	12/11/2025	56.35	1
Breaker	Planned Outage	12/11/2025	56.35	1
Breaker	Planned Outage	12/11/2025	337.90	6
Breaker	Planned Outage	12/11/2025	450.53	8
Breaker	Planned Outage	12/11/2025	337.90	6
Transformer Bank	Planned Outage	12/11/2025	127.73	2
Transformer	Planned Outage	12/11/2025	94.83	10
Transformer Bank	Planned Outage	12/11/2025	56.00	2
Transformer	Planned Outage	12/11/2025	73.50	2
Transformer	Planned Outage	12/12/2025	255.60	3
Transformer	Planned Outage	12/12/2025	705.87	8
Transformer	Planned Outage	12/12/2025	329.73	4
Transformer Bank	Planned Outage	12/12/2025	109.70	3
Transformer	Planned Outage	12/12/2025	181.80	3
Service point	Planned Outage	12/12/2025	264.70	1
Transformer	Planned Outage	12/12/2025	111.80	1
Transformer	Planned Outage	12/12/2025	295.50	6
Transformer	Planned Outage	12/12/2025	775.87	8

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	12/12/2025	211.10	1
PLF	Planned Outage	12/12/2025	135.73	1
Transformer	Planned Outage	12/12/2025	22.15	1
Transformer	Planned Outage	12/12/2025	51.55	3
Transformer	Planned Outage	12/12/2025	48.67	5
Transformer	Planned Outage	12/12/2025	435.40	4
Transformer	Planned Outage	12/12/2025	17.55	1
Transformer	Planned Outage	12/12/2025	148.75	7
Invalid	Planned Outage	12/13/2025	600.17	5
Transformer	Planned Outage	12/13/2025	59.53	1
PLF	Planned Outage	12/13/2025	141.43	1
Transformer	Planned Outage	12/13/2025	6.25	3
Transformer	Planned Outage	12/13/2025	548.55	9
None	Planned Outage	12/13/2025	89.70	6
Transformer	Planned Outage	12/13/2025	299.20	6
Transformer Bank	Planned Outage	12/13/2025	33.07	4
PLF	Planned Outage	12/13/2025	1,067.37	2
Transformer	Planned Outage	12/13/2025	48.80	6
Transformer	Planned Outage	12/13/2025	201.13	4
Transformer Bank	Planned Outage	12/13/2025	1,212.80	4
Transformer	Planned Outage	12/13/2025	35.23	7
None	Planned Outage	12/13/2025	51.80	2
PLF	Planned Outage	12/13/2025	390.60	14
PLF	Planned Outage	12/14/2025	2,779.50	51
PLF	Planned Outage	12/14/2025	276.47	26
Transformer	Planned Outage	12/14/2025	2,546.83	5
PLF	Planned Outage	12/14/2025	1,242.93	79
PLF	Planned Outage	12/14/2025	32.97	2
Transformer Bank	Planned Outage	12/14/2025	245.25	1
Transformer Bank	Planned Outage	12/15/2025	224.67	1
Transformer	Planned Outage	12/15/2025	66.30	6
Transformer	Planned Outage	12/15/2025	130.42	25
Transformer	Planned Outage	12/15/2025	133.10	3
Transformer	Planned Outage	12/15/2025	3,059.70	14
Transformer	Planned Outage	12/15/2025	9.40	4
Transformer	Planned Outage	12/15/2025	154.08	5
Transformer	Planned Outage	12/15/2025	439.80	2
Transformer	Planned Outage	12/15/2025	201.40	1
Transformer	Planned Outage	12/15/2025	8.20	1
Transformer	Planned Outage	12/15/2025	196.53	2
Transformer	Planned Outage	12/15/2025	412.82	1
Transformer	Planned Outage	12/15/2025	410.60	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer Bank	Planned Outage	12/15/2025	409.58	1
Transformer	Planned Outage	12/15/2025	1,230.85	3
Transformer	Planned Outage	12/15/2025	31.00	3
None	Planned Outage	12/15/2025	90.20	1
Transformer	Planned Outage	12/15/2025	21.10	1
Transformer	Planned Outage	12/15/2025	19.90	6
PLF	Planned Outage	12/15/2025	570.03	2
Transformer	Planned Outage	12/15/2025	88.40	4
Transformer	Planned Outage	12/15/2025	19.48	7
Transformer	Planned Outage	12/15/2025	72.40	8
PLF	Planned Outage	12/15/2025	511.05	9
Transformer	Planned Outage	12/15/2025	62.83	1
Transformer	Planned Outage	12/15/2025	415.78	19
Transformer	Planned Outage	12/15/2025	26.95	1
Transformer	Planned Outage	12/15/2025	125.87	2
Transformer	Planned Outage	12/15/2025	23.85	1
Transformer	Planned Outage	12/15/2025	16.20	2
None	Planned Outage	12/15/2025	246.00	5
Transformer	Planned Outage	12/15/2025	758.40	8
Transformer	Planned Outage	12/16/2025	5,065.95	9
Transformer Bank	Planned Outage	12/16/2025	52.82	1
Transformer	Planned Outage	12/16/2025	693.77	13
Transformer	Planned Outage	12/16/2025	364.62	1
Transformer	Planned Outage	12/16/2025	11.65	1
PLF	Planned Outage	12/16/2025	210.25	1
Transformer	Planned Outage	12/16/2025	18.75	1
Transformer	Planned Outage	12/16/2025	11.85	1
Transformer	Planned Outage	12/16/2025	39.37	2
Transformer	Planned Outage	12/16/2025	1,436.67	8
Transformer	Planned Outage	12/16/2025	897.83	5
Transformer	Planned Outage	12/16/2025	11.53	1
Transformer	Planned Outage	12/16/2025	203.13	1
Transformer	Planned Outage	12/16/2025	10.75	3
Transformer	Planned Outage	12/16/2025	71.85	1
Transformer	Planned Outage	12/16/2025	22.05	3
Transformer	Planned Outage	12/16/2025	20.17	1
Transformer	Planned Outage	12/16/2025	45.80	2
PLF	Planned Outage	12/17/2025	79.10	1
PLF	Planned Outage	12/17/2025	29,662.50	375
Transformer Bank	Planned Outage	12/17/2025	63.55	1
Transformer	Planned Outage	12/17/2025	1,326.27	8
Transformer	Planned Outage	12/17/2025	103.20	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/17/2025	2,957.25	9
Transformer Bank	Planned Outage	12/17/2025	1,064.75	5
Primary Wire	Planned Outage	12/17/2025	1,000.78	13
Transformer	Planned Outage	12/17/2025	4,370.33	14
Transformer	Planned Outage	12/17/2025	99.35	3
Transformer	Planned Outage	12/17/2025	2,495.85	9
Breaker	Planned Outage	12/17/2025	8.63	1
Breaker	Planned Outage	12/17/2025	8.83	1
Breaker	Planned Outage	12/17/2025	8.93	1
Breaker	Planned Outage	12/17/2025	9.00	1
Breaker	Planned Outage	12/17/2025	11.73	1
Breaker	Planned Outage	12/17/2025	8,344.70	917
Breaker	Planned Outage	12/17/2025	11.73	1
Transformer	Planned Outage	12/17/2025	306.55	1
Transformer	Planned Outage	12/17/2025	372.83	10
Transformer	Planned Outage	12/17/2025	58.63	2
Primary Wire	Planned Outage	12/17/2025	811.05	3
Transformer	Planned Outage	12/17/2025	26.57	2
Transformer	Planned Outage	12/17/2025	652.50	9
Transformer	Planned Outage	12/17/2025	485.50	5
Transformer	Planned Outage	12/17/2025	124.27	1
None	Planned Outage	12/17/2025	124.10	3
Transformer	Planned Outage	12/17/2025	193.60	2
Transformer	Planned Outage	12/17/2025	265.25	3
Transformer Bank	Planned Outage	12/17/2025	101.07	2
PLF	Planned Outage	12/17/2025	888.77	7
Transformer Bank	Planned Outage	12/17/2025	171.65	1
Transformer	Planned Outage	12/17/2025	107.70	6
Transformer	Planned Outage	12/17/2025	162.20	6
Transformer	Planned Outage	12/17/2025	13.30	1
Transformer Bank	Planned Outage	12/17/2025	130.53	2
None	Planned Outage	12/17/2025	846.53	14
Transformer Bank	Planned Outage	12/18/2025	253.98	1
Transformer	Planned Outage	12/18/2025	238.80	2
Transformer Bank	Planned Outage	12/18/2025	78.30	6
Transformer	Planned Outage	12/18/2025	46.17	10
Transformer Bank	Planned Outage	12/18/2025	41.27	2
Transformer Bank	Planned Outage	12/18/2025	527.70	3
PLF	Planned Outage	12/18/2025	526.28	7
Transformer Bank	Planned Outage	12/18/2025	4.38	1
Transformer Bank	Planned Outage	12/18/2025	1,477.40	12
Transformer	Planned Outage	12/18/2025	8.10	6

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
PLF	Planned Outage	12/18/2025	3,257.00	15
Transformer	Planned Outage	12/18/2025	129.83	1
Transformer	Planned Outage	12/18/2025	127.80	1
Transformer Bank	Planned Outage	12/18/2025	309.32	1
Invalid	Planned Outage	12/18/2025	25.80	1
Transformer	Planned Outage	12/18/2025	79.75	3
Transformer	Planned Outage	12/18/2025	1,199.80	6
Transformer	Planned Outage	12/18/2025	1,184.70	6
PLF	Planned Outage	12/18/2025	20.65	3
None	Planned Outage	12/18/2025	395.80	6
PLF	Planned Outage	12/18/2025	78.00	26
Transformer	Planned Outage	12/18/2025	19.17	2
Transformer	Planned Outage	12/18/2025	223.30	3
Transformer	Planned Outage	12/18/2025	8.40	3
Transformer	Planned Outage	12/18/2025	233.57	7
Transformer Bank	Planned Outage	12/18/2025	97.25	3
Transformer	Planned Outage	12/18/2025	34.93	4
PLF	Planned Outage	12/18/2025	5.83	5
PLF	Planned Outage	12/18/2025	17.92	5
Transformer	Planned Outage	12/18/2025	311.73	7
Transformer	Planned Outage	12/18/2025	6.33	5
PLF	Planned Outage	12/18/2025	46.22	1
PLF	Planned Outage	12/18/2025	43.98	1
PLF	Planned Outage	12/18/2025	584.75	15
None	Planned Outage	12/18/2025	306.15	3
Transformer	Planned Outage	12/18/2025	4.10	1
Transformer	Planned Outage	12/18/2025	426.80	11
Invalid	Planned Outage	12/18/2025	583.83	10
Transformer Bank	Planned Outage	12/18/2025	131.45	1
Transformer	Planned Outage	12/18/2025	218.90	2
Transformer	Planned Outage	12/18/2025	121.22	7
PLF	Planned Outage	12/18/2025	407.20	1
Transformer	Planned Outage	12/18/2025	20.60	6
Transformer	Planned Outage	12/19/2025	360.20	4
Transformer	Planned Outage	12/19/2025	510.77	7
Transformer	Planned Outage	12/19/2025	380.30	6
Breaker	Planned Outage	12/19/2025	5.70	1
Breaker	Planned Outage	12/19/2025	85.25	11
Breaker	Planned Outage	12/19/2025	5.70	1
Breaker	Planned Outage	12/19/2025	5.70	1
Breaker	Planned Outage	12/19/2025	5.70	1
Breaker	Planned Outage	12/19/2025	5.70	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	12/19/2025	5.70	1
Breaker	Planned Outage	12/19/2025	7.75	1
Breaker	Planned Outage	12/19/2025	15,128.00	1952
Breaker	Planned Outage	12/19/2025	5.70	1
Breaker	Planned Outage	12/19/2025	5.70	1
Breaker	Planned Outage	12/19/2025	8,401.00	1084
Breaker	Planned Outage	12/19/2025	8,742.00	1128
Breaker	Planned Outage	12/19/2025	20,010.50	2582
PLF	Planned Outage	12/19/2025	2,865.33	16
Breaker	Planned Outage	12/19/2025	2.20	1
Breaker	Planned Outage	12/19/2025	2.35	1
Breaker	Planned Outage	12/19/2025	2.37	1
Breaker	Planned Outage	12/19/2025	2.03	1
Breaker	Planned Outage	12/19/2025	5.53	1
Breaker	Planned Outage	12/19/2025	2.33	1
Breaker	Planned Outage	12/19/2025	2.40	1
Breaker	Planned Outage	12/19/2025	2.37	1
Breaker	Planned Outage	12/19/2025	2.35	1
Breaker	Planned Outage	12/19/2025	5.53	1
Breaker	Planned Outage	12/19/2025	2.37	1
Breaker	Planned Outage	12/19/2025	2.32	1
Breaker	Planned Outage	12/19/2025	2.32	1
Breaker	Planned Outage	12/19/2025	2.42	1
Breaker	Planned Outage	12/19/2025	2.33	1
Breaker	Planned Outage	12/19/2025	2.48	1
Breaker	Planned Outage	12/19/2025	5.53	1
Breaker	Planned Outage	12/19/2025	2.20	1
Breaker	Planned Outage	12/19/2025	2.22	1
Breaker	Planned Outage	12/19/2025	2.37	1
Breaker	Planned Outage	12/19/2025	5.57	1
Breaker	Planned Outage	12/19/2025	2.47	1
Breaker	Planned Outage	12/19/2025	2.23	1
Breaker	Planned Outage	12/19/2025	5.55	1
Breaker	Planned Outage	12/19/2025	2.22	1
Breaker	Planned Outage	12/19/2025	2.22	1
Breaker	Planned Outage	12/19/2025	2.38	1
Breaker	Planned Outage	12/19/2025	2.27	1
Breaker	Planned Outage	12/19/2025	5.57	1
Breaker	Planned Outage	12/19/2025	5.55	1
Breaker	Planned Outage	12/19/2025	3.50	1
Breaker	Planned Outage	12/19/2025	5.55	1
Breaker	Planned Outage	12/19/2025	2.28	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	12/19/2025	1.98	1
Breaker	Planned Outage	12/19/2025	5.53	1
Breaker	Planned Outage	12/19/2025	3.52	1
Breaker	Planned Outage	12/19/2025	5.53	1
Breaker	Planned Outage	12/19/2025	2.17	1
Breaker	Planned Outage	12/19/2025	2.43	1
Breaker	Planned Outage	12/19/2025	2.20	1
Breaker	Planned Outage	12/19/2025	2.45	1
Breaker	Planned Outage	12/19/2025	5.53	1
Breaker	Planned Outage	12/19/2025	2.18	1
Breaker	Planned Outage	12/19/2025	1.90	1
Breaker	Planned Outage	12/19/2025	1.90	1
Breaker	Planned Outage	12/19/2025	2.23	1
Breaker	Planned Outage	12/19/2025	2.48	1
Breaker	Planned Outage	12/19/2025	2.48	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	1.08	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	1.08	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Breaker	Planned Outage	12/19/2025	4.15	1
Transformer	Planned Outage	12/19/2025	80.33	5
Transformer	Planned Outage	12/19/2025	63.93	7
Transformer	Planned Outage	12/19/2025	916.10	3
Transformer	Planned Outage	12/19/2025	303.60	1
Transformer	Planned Outage	12/19/2025	364.87	4
Transformer Bank	Planned Outage	12/19/2025	130.25	1
None	Planned Outage	12/19/2025	311.40	6
Transformer	Planned Outage	12/19/2025	176.28	7
PLF	Planned Outage	12/19/2025	504.00	40
PLF	Planned Outage	12/19/2025	257.82	31
Transformer	Planned Outage	12/19/2025	2.70	1
Transformer Bank	Planned Outage	12/19/2025	51.53	2
Transformer	Planned Outage	12/19/2025	303.07	8
Transformer	Planned Outage	12/19/2025	54.00	5
Transformer	Planned Outage	12/19/2025	42.95	1
Transformer	Planned Outage	12/19/2025	48.07	4
PLF	Planned Outage	12/19/2025	51.37	2
Transformer	Planned Outage	12/19/2025	168.08	5
Transformer	Planned Outage	12/19/2025	53.87	4
Transformer	Planned Outage	12/19/2025	373.20	12
Transformer	Planned Outage	12/19/2025	26.27	1
Transformer	Planned Outage	12/19/2025	7.00	3
PLF	Planned Outage	12/19/2025	1,343.60	12
PLF	Planned Outage	12/20/2025	1,489.77	22
Transformer	Planned Outage	12/20/2025	423.62	7
Transformer	Planned Outage	12/20/2025	116.85	3
Transformer	Planned Outage	12/20/2025	9.75	3
Transformer	Planned Outage	12/20/2025	338.82	1
Transformer	Planned Outage	12/20/2025	1,570.33	5
Transformer	Planned Outage	12/20/2025	292.45	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/20/2025	917.75	5
Transformer	Planned Outage	12/20/2025	31.90	3
Transformer	Planned Outage	12/20/2025	24.55	3
Transformer	Planned Outage	12/20/2025	41.18	7
Breaker	Planned Outage	12/20/2025	7,356.33	761
Transformer	Planned Outage	12/21/2025	137.60	6
Transformer	Planned Outage	12/21/2025	212.67	2
Transformer	Planned Outage	12/22/2025	328.20	12
Transformer	Planned Outage	12/22/2025	153.83	10
Transformer	Planned Outage	12/22/2025	418.60	7
Breaker	Planned Outage	12/22/2025	4,395.07	1108
Primary Wire	Planned Outage	12/22/2025	579.75	9
PLF	Planned Outage	12/22/2025	1,417.00	20
Transformer	Planned Outage	12/22/2025	3,001.25	15
Transformer	Planned Outage	12/22/2025	2,579.63	13
Transformer	Planned Outage	12/22/2025	139.77	2
PLF	Planned Outage	12/22/2025	1,090.67	16
Transformer	Planned Outage	12/22/2025	1,273.40	6
PLF	Planned Outage	12/22/2025	42.78	1
Transformer	Planned Outage	12/22/2025	1,584.00	5
Transformer	Planned Outage	12/22/2025	1,531.30	6
PLF	Planned Outage	12/22/2025	296.48	1
Transformer	Planned Outage	12/22/2025	129.80	2
Transformer	Planned Outage	12/22/2025	2,045.63	7
Transformer	Planned Outage	12/22/2025	391.08	19
PLF	Planned Outage	12/22/2025	132.53	1
Transformer	Planned Outage	12/22/2025	162.92	5
Transformer	Planned Outage	12/22/2025	56.47	2
Transformer	Planned Outage	12/22/2025	394.57	7
Service - Crew	Planned Outage	12/22/2025	7.62	1
Recloser	Planned Outage	12/22/2025	6,272.00	840
Recloser	Planned Outage	12/22/2025	8.27	1
Recloser	Planned Outage	12/22/2025	8.27	1
PLF	Planned Outage	12/22/2025	79.60	12
Transformer	Planned Outage	12/22/2025	1,551.87	8
PLF	Planned Outage	12/22/2025	199.73	4
Service - Crew	Planned Outage	12/22/2025	52.20	1
Transformer	Planned Outage	12/22/2025	27.70	6
Transformer	Planned Outage	12/22/2025	189.50	3
Transformer	Planned Outage	12/22/2025	251.73	4
Transformer	Planned Outage	12/22/2025	313.80	4
Transformer	Planned Outage	12/22/2025	1,063.00	15

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/22/2025	27.47	4
Transformer Bank	Planned Outage	12/23/2025	1,210.60	6
Transformer	Planned Outage	12/23/2025	22.17	10
Transformer	Planned Outage	12/23/2025	112.12	1
Transformer	Planned Outage	12/23/2025	12.60	12
Transformer	Planned Outage	12/23/2025	123.43	1
Transformer	Planned Outage	12/23/2025	36.13	2
Transformer	Planned Outage	12/23/2025	618.60	1
Transformer	Planned Outage	12/23/2025	35.48	1
Transformer	Planned Outage	12/23/2025	394.90	6
Transformer	Planned Outage	12/23/2025	80.30	3
PLF	Planned Outage	12/23/2025	206.50	2
Transformer	Planned Outage	12/23/2025	23.23	2
Transformer	Planned Outage	12/24/2025	928.20	6
Transformer Bank	Planned Outage	12/25/2025	35.20	6
Transformer Bank	Planned Outage	12/26/2025	6.95	3
Transformer	Planned Outage	12/26/2025	146.83	5
Transformer	Planned Outage	12/26/2025	141.07	4
Transformer	Planned Outage	12/26/2025	128.20	4
None	Planned Outage	12/26/2025	905.20	12
Transformer	Planned Outage	12/27/2025	453.33	8
PLF	Planned Outage	12/27/2025	8,180.33	20
PLF	Planned Outage	12/27/2025	945.30	3
PLF	Planned Outage	12/27/2025	119.58	5
Transformer	Planned Outage	12/28/2025	30.97	1
Transformer	Planned Outage	12/28/2025	19.55	3
Recloser	Planned Outage	12/28/2025	7,686.05	347
Transformer	Planned Outage	12/28/2025	71.80	1
Transformer	Planned Outage	12/28/2025	8.45	1
Transformer	Planned Outage	12/29/2025	263.47	8
PLF	Planned Outage	12/29/2025	92.30	1
Transformer Bank	Planned Outage	12/29/2025	27.40	3
PLF	Planned Outage	12/29/2025	23,866.85	111
Transformer	Planned Outage	12/29/2025	463.50	5
Transformer	Planned Outage	12/29/2025	330.87	1
Transformer	Planned Outage	12/29/2025	590.00	2
Transformer	Planned Outage	12/29/2025	41.28	1
Transformer	Planned Outage	12/29/2025	777.90	3
Transformer	Planned Outage	12/29/2025	880.80	12
Transformer	Planned Outage	12/29/2025	126.35	7
Transformer	Planned Outage	12/29/2025	38.50	2
PLF	Planned Outage	12/29/2025	53.55	1

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/29/2025	149.83	5
Transformer	Planned Outage	12/29/2025	107.37	2
Transformer	Planned Outage	12/29/2025	101.55	3
Transformer	Planned Outage	12/29/2025	100.67	10
Transformer	Planned Outage	12/29/2025	92.20	2
Transformer	Planned Outage	12/29/2025	12.47	4
Transformer	Planned Outage	12/29/2025	408.00	5
Transformer	Planned Outage	12/29/2025	75.75	3
None	Planned Outage	12/29/2025	517.60	6
PLF	Planned Outage	12/30/2025	8,601.00	61
Primary Wire	Planned Outage	12/30/2025	166.22	1
Transformer	Planned Outage	12/30/2025	187.20	9
Transformer	Planned Outage	12/30/2025	238.25	5
PLF	Planned Outage	12/30/2025	82.65	9
Transformer	Planned Outage	12/30/2025	28.48	1
Transformer	Planned Outage	12/30/2025	17.40	3
PLF	Planned Outage	12/30/2025	390.15	1
PLF	Planned Outage	12/30/2025	226.90	1
PLF	Planned Outage	12/30/2025	34.00	4
Transformer	Planned Outage	12/30/2025	223.07	1
Transformer	Planned Outage	12/30/2025	234.07	2
Transformer	Planned Outage	12/30/2025	74.87	2
Transformer	Planned Outage	12/30/2025	90.33	5
Transformer	Planned Outage	12/30/2025	1,072.58	5
PLF	Planned Outage	12/30/2025	149.60	3
Transformer	Planned Outage	12/30/2025	1,358.13	11
Transformer	Planned Outage	12/30/2025	62.23	2
Transformer	Planned Outage	12/30/2025	38.40	2
PLF	Planned Outage	12/31/2025	9,115.60	24
Transformer	Planned Outage	12/31/2025	101.30	1
PLF	Planned Outage	12/31/2025	161.08	1
PLF	Planned Outage	12/31/2025	322.37	2
Transformer Bank	Planned Outage	12/31/2025	90.33	1
PLF	Planned Outage	12/31/2025	1,343.17	10
Transformer	Planned Outage	12/31/2025	805.23	7
Transformer	Planned Outage	12/31/2025	788.08	7
Transformer	Planned Outage	12/31/2025	104.20	4
PLF	Planned Outage	12/31/2025	248.40	18
Transformer	Planned Outage	12/31/2025	530.53	8
Transformer	Planned Outage	12/31/2025	31.53	2
Transformer	Planned Outage	12/31/2025	7.42	5
Invalid	Planned Outage	12/31/2025	301.33	20

Appendix D - Adjusted Planned Distribution Outages

Outage_Events	Reason_for_Exclusion	Outage_Date	CMI_Excluded	CI_Excluded
Transformer	Planned Outage	12/31/2025	32.88	1
Total			**20,786,033.54**	**388,555**

Appendix D - Adjusted Planned Substation Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	1/1/2025 7:28	136,149.93	2,486
Substation	FPSC Commission Rule 26-6.0455	1/6/2025 12:24	268.88	73
Substation	FPSC Commission Rule 26-6.0455	1/7/2025 18:11	1,767.00	684
Substation	FPSC Commission Rule 26-6.0455	1/11/2025 3:06	28,685.03	334
Substation	FPSC Commission Rule 26-6.0455	1/11/2025 3:06	15,538.42	335
Substation	FPSC Commission Rule 26-6.0455	1/11/2025 7:32	3,150.00	1,080
Substation	FPSC Commission Rule 26-6.0455	1/11/2025 7:32	3.48	1
Substation	FPSC Commission Rule 26-6.0455	1/13/2025 9:13	1.97	1
Substation	FPSC Commission Rule 26-6.0455	1/13/2025 9:13	1.53	1
Substation	FPSC Commission Rule 26-6.0455	1/13/2025 9:13	1.80	1
Substation	FPSC Commission Rule 26-6.0455	1/13/2025 9:13	1,786.33	1,165
Substation	FPSC Commission Rule 26-6.0455	1/13/2025 9:13	1.42	1
Substation	FPSC Commission Rule 26-6.0455	1/13/2025 9:13	1.62	1
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	784.12	7
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	1,120.33	10
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	1,118.33	10
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	4,704.70	42
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	1,456.43	13
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	29,706.50	265
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	1,453.83	13
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	18.20	7
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	54.60	21
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	2,854.80	1,098
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	2.60	1
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	2,800.83	25
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	1,568.47	14
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	5,380.80	48
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 19:57	99,769.00	890
Substation	FPSC Commission Rule 26-6.0455	1/19/2025 20:11	979.00	10
Substation	FPSC Commission Rule 26-6.0455	1/29/2025 9:29	11.12	1
Substation	FPSC Commission Rule 26-6.0455	1/29/2025 9:29	15,985.77	1,438
Substation	FPSC Commission Rule 26-6.0455	1/29/2025 9:29	11,060.47	1,211
Substation	FPSC Commission Rule 26-6.0455	1/29/2025 9:29	82,646.67	2,450
Substation	FPSC Commission Rule 26-6.0455	1/29/2025 9:29	40,722.92	1,777
Substation	FPSC Commission Rule 26-6.0455	2/12/2025 11:00	2.98	1
Substation	FPSC Commission Rule 26-6.0455	2/12/2025 11:00	844.28	283
Substation	FPSC Commission Rule 26-6.0455	2/12/2025 11:00	35.80	12
Substation	FPSC Commission Rule 26-6.0455	3/14/2025 10:25	9,746.40	1,179
Substation	FPSC Commission Rule 26-6.0455	3/14/2025 10:25	8.27	1
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 8:17	2,928.03	754
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 8:17	48,532.08	1,345
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 8:17	12,091.30	1,703

Appendix D - Adjusted Planned Substation Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 8:17	35,768.40	984
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 8:17	36.35	1
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 17:08	70.55	1
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 17:08	106,468.80	984
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 17:08	81,691.00	755
Substation	FPSC Commission Rule 26-6.0455	3/25/2025 17:08	108.20	1
Substation	FPSC Commission Rule 26-6.0455	3/27/2025 10:22	3.50	2
Substation	FPSC Commission Rule 26-6.0455	3/27/2025 10:22	1,522.50	870
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 15:58	134,113.70	1,698
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 15:58	116,340.00	1,385
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 15:58	83.97	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 15:58	84.00	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 15:58	122,052.00	1,453
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 15:58	116,554.82	1,453
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 15:58	142,632.00	1,698
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.30	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	10.37	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	16,282.50	1,503
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	20,700.90	1,683
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	18,486.90	1,503
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	18,476.70	1,527
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	11.85	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	54.17	5
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12,301.67	1,220
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	18,696.00	1,520
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	147.60	12
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	14,762.00	1,220
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	22,469.70	1,857
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.30	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.30	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1

Appendix D - Adjusted Planned Substation Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.30	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	8.77	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	16,279.70	1,857
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.30	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	35.15	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	17,708.00	1,520
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.30	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.10	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	119.17	11
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	12.30	1
Substation	FPSC Commission Rule 26-6.0455	4/6/2025 16:01	135.30	11
Substation	FPSC Commission Rule 26-6.0455	4/19/2025 14:45	527.57	266
Substation	FPSC Commission Rule 26-6.0455	5/5/2025 4:16	5.03	2
Substation	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	3,609.67	170
Substation	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	35.88	1
Substation	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	35.88	1
Substation	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	14,685.30	1,998
Substation	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	7,827.75	1,065
Substation	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	1,249.50	170
Substation	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	1,190.00	476
Substation	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	308.70	42
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	62,598.25	1,339
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	91.37	1
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	8,351.20	858
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	65,783.25	1,521
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	36.78	1
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	36.78	1
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	167,475.10	1,833
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	102,155.57	1,123
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	36.78	1
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	1,028.50	22
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	63,193.77	1,718
Substation	FPSC Commission Rule 26-6.0455	5/15/2025 7:59	3,606.20	57
Substation	FPSC Commission Rule 26-6.0455	5/28/2025 18:44	55,746.73	883

Appendix D - Adjusted Planned Substation Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:47	29,736.75	1,395
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:47	8,438.70	414
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	98.62	1
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	6,913.80	414
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	471.60	4
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	98.62	1
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	98.62	1
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	40,814.80	2,444
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	238,511.70	2,023
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	98.62	1
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 15:49	98.62	1
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 16:00	174.10	2
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 16:00	175.50	2
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 16:03	256.00	30
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 16:16	29,821.80	414
Substation	FPSC Commission Rule 26-6.0455	6/7/2025 18:50	147.87	4
Substation	FPSC Commission Rule 26-6.0455	6/19/2025 11:22	17.30	1
Substation	FPSC Commission Rule 26-6.0455	7/3/2025 20:40	59,518.80	972
Substation	FPSC Commission Rule 26-6.0455	7/3/2025 20:40	77,827.57	1,271
Substation	FPSC Commission Rule 26-6.0455	7/3/2025 20:40	54,926.30	897
Substation	FPSC Commission Rule 26-6.0455	7/3/2025 20:40	44,987.40	972
Substation	FPSC Commission Rule 26-6.0455	7/3/2025 20:40	43,743.70	897
Substation	FPSC Commission Rule 26-6.0455	7/12/2025 12:44	14,764.10	1,662
Substation	FPSC Commission Rule 26-6.0455	7/27/2025 17:12	17,401.33	124
Substation	FPSC Commission Rule 26-6.0455	7/27/2025 17:12	170.97	1
Substation	FPSC Commission Rule 26-6.0455	7/27/2025 17:12	295,839.60	1,722
Substation	FPSC Commission Rule 26-6.0455	7/27/2025 17:12	4,123.20	24
Substation	FPSC Commission Rule 26-6.0455	7/27/2025 17:12	170.77	1
Substation	FPSC Commission Rule 26-6.0455	7/29/2025 15:40	21.02	13
Substation	FPSC Commission Rule 26-6.0455	7/29/2025 15:40	1,501.88	929
Substation	FPSC Commission Rule 26-6.0455	7/29/2025 15:40	1.62	1
Substation	FPSC Commission Rule 26-6.0455	7/29/2025 15:40	1.62	1
Substation	FPSC Commission Rule 26-6.0455	8/5/2025 9:22	167.20	24
Substation	FPSC Commission Rule 26-6.0455	8/5/2025 9:22	11,989.63	1,721
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 16:17	1,960.80	688
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 16:17	2.85	1
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	74,356.53	964
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	4,561.75	71
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	482,433.80	964
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	588,028.75	1,175
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	79,071.10	158
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	1,000.90	2

Appendix D - Adjusted Planned Substation Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	106.82	1
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	5,061.12	71
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	500.45	1
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	121,044.58	1,175
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	206.03	2
Substation	FPSC Commission Rule 26-6.0455	8/21/2025 17:05	103.02	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 5:55	1.47	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 5:55	2,016.00	1,728
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 5:55	1.28	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 5:55	1.63	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 5:55	1.57	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 5:55	1.38	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	16.68	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	183.52	11
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	60.28	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	16.68	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	32,582.55	1,953
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	11,712.72	1,139
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	10.37	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	8,390.67	1,085
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	60.18	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:23	60.38	1
Substation	FPSC Commission Rule 26-6.0455	8/23/2025 15:25	10.67	2
Substation	FPSC Commission Rule 26-6.0455	8/25/2025 20:52	347.35	1
Substation	FPSC Commission Rule 26-6.0455	9/28/2025 14:04	740.42	1
Substation	FPSC Commission Rule 26-6.0455	10/2/2025 11:03	45,662.28	1,309
Substation	FPSC Commission Rule 26-6.0455	10/2/2025 11:03	2,055.17	38
Substation	FPSC Commission Rule 26-6.0455	10/2/2025 11:03	23,400.00	800
Substation	FPSC Commission Rule 26-6.0455	10/2/2025 11:03	63,061.17	1,166
Substation	FPSC Commission Rule 26-6.0455	10/11/2025 8:32	797.40	9
Substation	FPSC Commission Rule 26-6.0455	10/11/2025 8:32	88.60	1
Substation	FPSC Commission Rule 26-6.0455	10/11/2025 8:32	26,752.17	302
Substation	FPSC Commission Rule 26-6.0455	10/11/2025 8:32	1,236.75	9
Substation	FPSC Commission Rule 26-6.0455	10/11/2025 8:32	138.60	1
Substation	FPSC Commission Rule 26-6.0455	10/11/2025 8:32	26,757.20	302
Substation	FPSC Commission Rule 26-6.0455	10/11/2025 8:32	88.60	1
Substation	FPSC Commission Rule 26-6.0455	10/24/2025 11:26	5,517.07	1,217
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	5.92	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	40.00	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	7.73	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	40.28	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	1,076.40	27

Appendix D - Adjusted Planned Substation Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	6,047.25	733
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	6.02	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	7.97	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	7.73	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	8.10	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	41,736.53	1,168
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	35.73	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	8.18	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	8.10	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	70,165.33	1,760
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	486.75	59
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	7,086.60	1,116
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	8.03	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	7.80	1
Substation	FPSC Commission Rule 26-6.0455	10/27/2025 8:54	7.90	1
Substation	FPSC Commission Rule 26-6.0455	10/28/2025 5:52	478.50	99
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 8:54	10.80	2
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 8:54	62.22	1
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 8:54	108,544.95	2,259
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 8:54	59,017.50	1,350
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 8:54	48.47	1
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 8:54	80,971.00	1,299
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 8:54	62.12	1
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 8:54	48.57	1
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 9:38	3,532.50	1,350
Substation	FPSC Commission Rule 26-6.0455	10/29/2025 9:38	1,620.00	1,350
Substation	FPSC Commission Rule 26-6.0455	11/23/2025 11:26	62,746.25	1,491
Substation	FPSC Commission Rule 26-6.0455	11/23/2025 11:26	53,879.25	995
Substation	FPSC Commission Rule 26-6.0455	11/23/2025 11:26	30.77	1
Substation	FPSC Commission Rule 26-6.0455	11/23/2025 11:26	72,640.10	2,361
Substation	FPSC Commission Rule 26-6.0455	11/23/2025 11:26	26,985.40	428
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	95.17	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	81,434.63	1,811
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	111.90	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	56.10	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	92.70	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	111.93	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	2,239.33	40
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	111.87	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	112.13	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	3,893.90	138
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	56.00	2

Appendix D - Adjusted Planned Substation Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	47.50	1
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	90.13	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	95.50	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	56.10	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	41,505.75	1,485
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	27.95	1
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	43,043.00	770
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	4,695.60	84
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	94.17	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	90.37	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	52.77	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	95.33	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	95.20	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	90.10	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	90.53	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	95.03	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	95.37	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	72,010.00	1,516
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	95.57	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	93.73	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	139.75	5
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	90.07	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	83,570.50	1,495
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	101,793.90	1,821
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	56.40	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	760.80	16
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	56.03	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	279.50	5
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	85,527.00	1,530
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	55.90	1
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	90.53	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	56.10	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	95.53	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	56.10	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	92.63	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	112.10	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	56.23	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	671.40	12
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	92.70	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	92.73	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	111.97	2
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	111.97	2

Appendix D - Adjusted Planned Substation Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Substation	FPSC Commission Rule 26-6.0455	12/12/2025 9:46	90.17	2
Substation	FPSC Commission Rule 26-6.0455	12/20/2025 7:34	12.80	3
Substation	FPSC Commission Rule 26-6.0455	12/20/2025 7:34	11,067.73	2,594
Substation	FPSC Commission Rule 26-6.0455	12/26/2025 16:49	55,771.83	1,049
Substation	FPSC Commission Rule 26-6.0455	12/26/2025 16:49	101,409.00	1,540
Substation	FPSC Commission Rule 26-6.0455	12/26/2025 16:49	111,009.20	1,453
Total			**6,155,216.36**	**131,163**

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	2,481.50	709
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	3.78	1
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	5,057.50	1,445
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	3.50	1
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	3.40	1
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	1,982.47	524
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	5,466.92	1,445
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	2,682.38	709
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	3.78	1
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	4,005.20	1,178
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	8,578.20	2,523
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	4,379.20	1,288
Transmission	FPSC Commission Rule 26-6.0455	2/3/2025 5:43	265.20	78
Transmission	FPSC Commission Rule 26-6.0455	2/20/2025 12:08	3,577.90	1,934
Transmission	FPSC Commission Rule 26-6.0455	2/20/2025 12:08	7.40	4
Transmission	FPSC Commission Rule 26-6.0455	2/20/2025 12:08	2,706.55	1,463
Transmission	FPSC Commission Rule 26-6.0455	2/20/2025 12:08	22.20	12
Transmission	FPSC Commission Rule 26-6.0455	2/20/2025 12:08	2.60	1
Transmission	FPSC Commission Rule 26-6.0455	2/20/2025 12:08	2.60	1
Transmission	FPSC Commission Rule 26-6.0455	2/20/2025 12:08	1.85	1
Transmission	FPSC Commission Rule 26-6.0455	2/20/2025 12:08	1.85	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	4,720.82	1,901
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	9.93	4
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	1.95	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.67	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	1,827.73	736
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.67	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.23	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.60	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.50	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.57	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.67	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.33	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.07	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.13	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.48	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	5,788.65	2,331
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.43	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.05	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	1.82	1
Transmission	FPSC Commission Rule 26-6.0455	3/2/2025 1:07	2.43	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.10	1

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.40	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	6,014.25	729
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	11,863.50	1,438
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	7.97	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.63	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.58	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.43	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.53	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.13	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.73	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.07	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	17,663.25	2,141
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	22,976.25	2,785
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.87	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	7.93	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.23	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.83	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.75	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.38	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.48	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.57	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.25	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.05	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.30	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.03	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.32	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.25	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.40	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:36	8.67	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	8,676.10	1,637
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.80	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.02	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	13,525.60	2,544
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	6,252.40	1,176
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.18	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.77	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.43	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	6,232.80	1,176
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.02	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.60	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	4.95	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	8,703.38	1,637

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.32	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.15	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.27	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	6,163.90	1,163
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	6,397.10	1,207
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.30	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	6,183.28	1,163
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	6,417.22	1,207
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	26.58	5
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.32	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	4.93	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.53	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.38	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.35	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.10	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.72	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.67	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.85	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.53	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.47	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:39	5.23	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.17	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.48	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.72	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.97	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.85	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	3,020.83	1,250
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.85	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.32	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.93	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.40	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.35	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.47	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.53	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.15	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.30	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.58	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.13	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.27	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.57	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.15	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	3,603.25	1,491

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	1,459.67	604
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	9.67	4
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.55	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.40	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.33	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	3.05	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.68	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.52	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.73	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.47	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.08	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.27	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	938.40	391
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	3,554.40	1,481
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	3,885.60	1,619
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.65	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.40	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.45	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.65	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.38	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2,906.40	1,211
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	4,137.60	1,724
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2,390.40	996
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	6,523.20	2,718
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	6,571.20	2,738
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.77	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.22	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.05	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.12	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2,649.60	1,104
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.58	1
Transmission	FPSC Commission Rule 26-6.0455	3/3/2025 9:41	2.22	1
Transmission	FPSC Commission Rule 26-6.0455	3/5/2025 13:25	758.45	21
Transmission	FPSC Commission Rule 26-6.0455	3/5/2025 13:25	46,468.75	1,875
Transmission	FPSC Commission Rule 26-6.0455	3/5/2025 13:25	24.78	1
Transmission	FPSC Commission Rule 26-6.0455	3/5/2025 13:25	58,472.88	1,619
Transmission	FPSC Commission Rule 26-6.0455	3/5/2025 13:25	67,718.75	1,875
Transmission	FPSC Commission Rule 26-6.0455	4/23/2025 17:49	145,806.13	1,706
Transmission	FPSC Commission Rule 26-6.0455	4/23/2025 17:49	812.25	15
Transmission	FPSC Commission Rule 26-6.0455	4/23/2025 17:49	85.57	1
Transmission	FPSC Commission Rule 26-6.0455	4/23/2025 19:12	38.75	15
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	37.80	1

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	66,439.00	2,370
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	81.35	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	24,365.13	763
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	81,813.20	2,562
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	1,213.47	38
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	166.60	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	626.32	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	32.07	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	29,837.35	789
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	31.72	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	32.07	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	32.07	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	618.20	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	474.30	34
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	3,661.83	254
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	32.07	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	32.07	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	79,379.42	1,435
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	165.95	3
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	69,826.90	858
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	288.07	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	17,480.00	1,200
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	37.80	1
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	8,079.30	573
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	1,065.27	38
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	75,682.00	2,370
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	113,133.65	427
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	109,350.10	678
Transmission	FPSC Commission Rule 26-6.0455	5/4/2025 12:26	613.05	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	35.88	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 4:23	3,498.60	476
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	34,304.50	2,185
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	17.22	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.75	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	17.00	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	17.22	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	17.22	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.62	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.83	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.57	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.52	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.80	1

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	17.17	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.67	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.95	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	8,390.57	1,667
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	100.67	20
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.70	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	26,171.90	1,667
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	329.70	21
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	17.05	1
Transmission	FPSC Commission Rule 26-6.0455	5/13/2025 14:00	16.88	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.78	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.40	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.48	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2,073.00	691
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.32	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	8.13	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.72	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.78	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.53	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.65	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	10,730.13	352
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	8.13	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.42	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	205.83	26
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	316.67	40
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	6,573.00	2,191
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	3,249.00	1,083
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	3,219.00	1,073
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.65	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	8.13	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	66.88	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.92	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	8.13	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	8.13	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	66.93	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	66.83	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	3.05	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.82	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	3,174.58	401
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.95	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	3.18	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	619.85	231

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	4,848.80	1,653
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	3,220.57	1,223
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.63	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	8.13	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	1,956.15	729
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	5,925.33	2,020
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	1,950.67	665
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2,140.90	813
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2,903.37	1,082
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2,111.78	787
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	4,478.48	1,669
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.57	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	2.90	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	3.22	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 6:53	8.13	1
Transmission	FPSC Commission Rule 26-6.0455	5/15/2025 7:32	245.70	14
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	2,004.20	1,822
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	776.60	706
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,577.80	1,372
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,430.00	1,300
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,252.90	1,139
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1.20	1
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	844.80	704
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,310.40	1,092
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	44.40	37
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,927.40	1,676
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	547.40	476
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,482.35	1,289
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,256.40	1,047
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	8.17	7
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,230.83	1,055
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1,937.83	1,661
Transmission	FPSC Commission Rule 26-6.0455	5/21/2025 18:52	1.17	1
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	6,626.75	2,039
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	299.00	92
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	44,348.75	2,087
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	701.25	33
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	131.60	1
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	2,570.75	791
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	107.25	33
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	39,631.25	1,865
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	19,465.00	916

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	27,518.75	1,295
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	116,790.00	916
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	4,080.00	32
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	27,281.33	1,295
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	21.07	1
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:37	197,845.42	1,865
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:39	26,701.97	133
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:39	2,208.43	11
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:39	26,545.20	132
Transmission	FPSC Commission Rule 26-6.0455	6/11/2025 21:39	2,212.10	11
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.37	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.65	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.53	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.47	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.05	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.93	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.08	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.23	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.38	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.32	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.60	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	40.33	11
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.57	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	4.92	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.00	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.32	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.93	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	6.63	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.15	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.42	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5,642.87	1,532
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	6,869.42	1,865
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	4.85	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.30	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	61.80	12
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	2,444.20	1,452
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	6.63	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.15	1

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	6,182.00	1,686
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5,591.67	1,525
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5,533.00	1,509
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	44.00	12
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	3.67	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.47	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.48	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	6.63	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.53	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	6.63	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	4.97	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	4.72	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	8,657.15	1,681
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	6.63	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.20	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.60	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.40	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	77.35	21
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	257.83	70
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.00	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	15.10	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.27	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	2,794.33	1,660
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.08	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	4,497.35	1,221
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	3.68	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.22	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	6,349.20	1,221
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	2,299.43	1,366
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:14	5.13	1
Transmission	FPSC Commission Rule 26-6.0455	7/29/2025 16:15	143,257.95	877
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2.28	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.90	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.88	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.97	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.85	1

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2.13	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2.03	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.97	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	3,039.57	1,361
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1,695.10	759
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	3,544.30	1,587
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	46.90	21
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2,014.47	902
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	3,725.20	1,668
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	3,606.83	1,615
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.73	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	4,428.15	53
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	48,291.90	578
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	97,010.78	1,193
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.85	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2.20	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.93	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2.05	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2.23	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2.05	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	75,159.15	1,089
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	81.33	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	26,652.45	319
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.67	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	23,066.70	207
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.80	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	81.33	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	72.40	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	72.02	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1,380.20	618
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	3,879.30	1,737
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	6,324.80	2,832
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	60,566.02	841
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	288.07	4
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	72,587.85	831
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	3,406.65	39
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.55	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	8,691.20	112
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	620.80	8
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	71.60	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	3,269.60	1,464
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.87	1

Appendix D - Adjusted Planned Transmission Outages

Outage Events	Reason for Exclusion	Outage Date	CMI Excluded	CI Excluded
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.80	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.83	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.92	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	77.92	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	77.98	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.87	1
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2,306.60	1,214
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	2,055.80	1,082
Transmission	FPSC Commission Rule 26-6.0455	8/22/2025 11:25	1.62	1
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	220.05	27
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	13,838.70	1,698
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	51,908.00	1,520
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	34.15	1
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	277.65	27
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	15,630.67	1,520
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	17,625.63	1,714
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	2,971.88	289
Transmission	FPSC Commission Rule 26-6.0455	8/31/2025 9:25	10.28	1
Total			**2,685,463.28**	**175,764**

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13001	South Hillsborough	N/A	10.96	771.00	24,255.00	431.00	N/A	8.08	739.00	3,136.47	11.00	-
13002	South Hillsborough	N/A	0.26	20.00	-	-	N/A	0.83	11.00	-	-	-
13003	South Hillsborough	N/A	23.71	581.00	148,010.58	1,159.00	N/A	2.52	207.00	729.80	5.00	-
13004	Dade City	N/A	9.28	531.00	7,096.25	96.00	N/A	14.75	928.00	32.13	1.00	-
13005	Dade City	N/A	6.08	260.00	26,470.13	92.00	N/A	2.98	448.00	-	-	-
13006	Dade City	N/A	21.45	789.00	92,073.15	1,946.00	N/A	14.37	992.00	44,712.63	345.00	-
13007	Plant City	N/A	29.42	499.00	40,908.48	227.00	N/A	3.94	78.00	12,527.67	159.00	-
13008	Plant City	N/A	17.57	393.00	40,380.80	175.00	N/A	2.46	32.00	509.25	3.00	-
13009	Plant City	N/A	3.02	73.00	11,267.23	52.00	N/A	0.99	45.00	31,149.77	285.00	-
13010	Plant City	N/A	7.17	455.00	393,168.13	9,009.00	N/A	15.45	1,358.00	2,574.28	95.00	-
13011	Plant City	N/A	26.69	1,465.00	91,593.98	5,059.00	N/A	2.60	186.00	139.18	2.00	-
13012	Western	N/A	0.32	257.00	-	-	N/A	0.24	45.00	-	-	-
13013	Western	N/A	0.17	53.00	-	-	N/A	1.41	187.00	-	-	-
13016	Western	N/A	0.73	117.00	736.20	6.00	N/A	0.52	103.00	-	-	-
13017	South Hillsborough	N/A	8.58	364.00	6,501.48	64.00	N/A	9.75	1,154.00	19,770.15	204.00	-
13019	South Hillsborough	N/A	10.98	660.00	8,888.37	3,443.00	N/A	10.17	992.00	19,417.07	1,301.00	-
13020	South Hillsborough	N/A	17.45	1,241.00	12,596.08	468.00	N/A	15.82	1,335.00	274.25	2.00	-
13021	Central	N/A	1.98	160.00	9,570.47	89.00	N/A	6.20	1,115.00	15,615.95	48.00	-
13022	Central	N/A	3.28	465.00	6,353.60	73.00	N/A	1.01	356.00	-	-	-
13023	Central	N/A	8.34	1,018.00	34,394.43	370.00	N/A	2.04	400.00	1,386.18	13.00	-
13024	Central	N/A	7.56	789.00	5,239.93	47.00	N/A	1.89	234.00	1,348.80	54.00	-
13026	Central	N/A	1.92	173.00	-	-	N/A	6.78	1,720.00	5,019.53	61.00	-
13027	Central	N/A	9.12	700.00	194,225.48	658.00	N/A	2.11	426.00	116.50	2.00	-
13028	Central	N/A	5.34	599.00	19,414.77	169.00	N/A	4.60	1,455.00	359.20	3.00	-
13029	Central	N/A	5.66	519.00	8,742.82	73.00	N/A	3.78	684.00	1,998.42	13.00	-
13030	Winter Haven	N/A	27.74	830.00	112,589.78	654.00	N/A	15.22	1,042.00	321,100.42	4,047.00	-
13031	Winter Haven	N/A	10.67	470.00	13,676.57	116.00	N/A	17.08	952.00	6,013.42	230.00	-
13034	Central	N/A	9.97	1,319.00	21,023.00	140.00	N/A	1.71	257.00	250.25	3.00	-
13035	Central	N/A	5.03	495.00	227,214.40	1,478.00	N/A	0.73	95.00	18,232.10	93.00	-
13036	Central	N/A	8.88	984.00	15,592.65	205.00	N/A	1.41	272.00	214.73	1.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	4.34	0.10	-	-	-	4.24	127.00	59,320.08	1,663.00	16.10%	7.86
-	Yes	3.29	2.60	-	-	-	0.69	1.00	-	-	5.45%	4.84
-	Yes	7.86	0.03	-	-	-	7.83	106.00	-	-	2.05%	3.99
-	Yes	4.30	-	-	-	-	4.30	107.00	-	-	31.96%	8.34
-	Yes	1.99	0.28	-	-	-	1.71	42.00	69,261.33	1,263.00	-16.25%	3.04
-	Yes	6.46	0.21	-	-	-	6.25	93.00	143,620.75	1,853.00	17.26%	7.88
-	Yes	3.62	0.25	-	6,506.05	587.00	3.37	36.00	4,503.40	1,112.00	-19.24%	5.96
-	Yes	0.44	0.01	-	236.48	3.00	0.43	2.00	46,481.35	726.00	-1.44%	2.73
-	Yes	2.28	0.09	-	-	-	2.19	31.00	18,179.33	148.00	-25.17%	2.2
-	Yes	5.51	0.89	-	-	-	4.62	109.00	47,039.37	608.00	12.72%	7.8
-	Yes	6.14	0.43	-	-	-	5.71	80.00	-	-	-0.40%	7.39
-	Yes	0.76	0.09	-	-	-	0.67	30.00	-	-	-38.58%	0.78
-	Yes	1.51	0.82	-	-	-	0.69	47.00	12,818.00	290.00	-40.75%	2.21
-	Yes	1.59	0.68	-	-	-	0.91	34.00	-	-	-9.74%	3.89
-	Yes	2.63	0.67	10.00	-	-	1.96	34.00	-	-	-30.67%	6.24
-	Yes	4.65	1.35	51.00	-	-	3.30	25.00	-	-	-5.11%	9.66
-	Yes	6.98	1.07	24.00	166,769.02	2,390.00	5.91	191.00	64,036.23	8,858.00	120.08%	11.07
-	Yes	3.88	0.39	-	-	-	3.49	75.00	189,691.33	2,729.00	-5.70%	6.29
-	Yes	0.93	0.11	-	-	-	0.82	18.00	-	-	4.05%	2.57
-	Yes	2.43	0.10	-	-	-	2.33	107.00	-	-	3.36%	6.15
-	Yes	1.89	0.13	-	205.83	50.00	1.76	92.00	115,896.85	3,241.00	2.86%	4.68
-	Yes	1.34	0.04	-	-	-	1.30	80.00	-	-	8.17%	5.56
-	Yes	1.20	0.46	-	-	-	0.74	36.00	-	-	9.19%	5.11
-	Yes	1.85	0.23	-	28.20	1.00	1.62	28.00	80,621.27	4,153.00	2.31%	6.19
-	Yes	1.22	0.29	-	-	-	0.93	24.00	-	-	9.56%	5.5
-	Yes	5.88	0.64	-	-	-	5.24	86.00	35,847.35	782.00	12.59%	9.12
-	Yes	7.18	0.29	-	-	-	6.89	115.00	164,476.38	1,522.00	69.18%	5.6
-	Yes	1.85	0.03	-	-	-	1.82	96.00	-	-	19.91%	5.6
-	Yes	2.27	0.02	-	-	-	2.25	80.00	-	-	5.46%	5.79
-	Yes	3.90	1.53	-	-	-	2.37	125.00	187,886.07	4,867.00	-6.69%	6

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13037	Central	N/A	5.51	652.00	21,773.38	322.00	N/A	1.65	341.00	93.37	1.00	-
13038	Eastern	N/A	6.40	371.00	111,379.77	379.00	N/A	5.46	370.00	2,275.13	40.00	-
13039	Eastern	N/A	6.82	432.00	5,321.40	92.00	N/A	9.38	772.00	7,751.15	49.00	-
13040	Eastern	N/A	0.36	7.00	31,029.10	229.00	N/A	12.91	1,064.00	53,657.45	306.00	-
13041	Eastern	N/A	5.41	316.00	21,830.65	242.00	N/A	15.74	1,025.00	-	-	-
13042	Central	N/A	7.48	877.00	16,100.57	56.00	N/A	5.10	544.00	240.35	5.00	-
13043	Central	N/A	12.72	1,796.00	34,482.82	359.00	N/A	2.15	553.00	478.53	6.00	-
13044	Central	N/A	10.91	1,637.00	98,832.52	1,388.00	N/A	1.08	15.00	2,707.48	16.00	-
13045	Central	N/A	6.83	987.00	45,222.53	298.00	N/A	0.18	35.00	119.52	1.00	-
13046	Central	N/A	7.54	1,063.00	13,728.63	132.00	N/A	1.52	119.00	2,030.40	44.00	-
13047	Central	N/A	3.33	576.00	2,240.78	16.00	N/A	0.77	204.00	5,540.72	36.00	-
13048	Central	N/A	7.96	1,116.00	18,602.18	461.00	N/A	1.82	120.00	481.67	10.00	-
13049	Central	N/A	5.73	699.00	7,977.32	64.00	N/A	2.34	500.00	49,996.48	195.00	-
13050	Central	N/A	0.05	-	1,820.25	45.00	N/A	0.80	29.00	9,791.83	77.00	-
13051	Central	N/A	1.44	80.00	3,884.08	69.00	N/A	4.03	949.00	2,540.68	30.00	-
13052	Central	N/A	0.60	41.00	-	-	N/A	0.63	135.00	-	-	-
13053	Central	N/A	8.63	1,152.00	5,894.27	68.00	N/A	4.10	401.00	130.07	2.00	-
13054	Central	N/A	0.12	-	280.68	1.00	N/A	1.17	440.00	10,853.68	209.00	-
13055	Central	N/A	0.11	-	-	-	N/A	0.38	26.00	-	-	-
13057	Central	N/A	0.17	4.00	15,974.85	193.00	N/A	0.82	178.00	-	-	-
13059	Western	N/A	6.19	687.00	8,107.60	109.00	N/A	2.91	142.00	253.48	3.00	-
13060	Western	N/A	4.61	759.00	131,817.17	664.00	N/A	1.99	571.00	-	-	-
13061	Western	N/A	5.03	671.00	3,150.48	17.00	N/A	4.94	1,292.00	42.33	1.00	-
13062	Western	N/A	4.29	582.00	34,723.77	953.00	N/A	0.15	15.00	2,675.35	65.00	-
13063	Western	N/A	1.90	164.00	1,538.33	34.00	N/A	9.55	2,069.00	2,102.80	24.00	-
13064	Western	N/A	8.74	917.00	28,838.23	191.00	N/A	4.79	707.00	25,713.87	81.00	-
13065	Western	N/A	8.72	1,145.00	25,081.12	200.00	N/A	2.21	579.00	17,138.97	310.00	-
13066	Western	N/A	2.92	458.00	8,560.25	51.00	N/A	-	-	-	-	-
13067	Western	N/A	4.96	670.00	5,216.05	51.00	N/A	0.59	32.00	-	-	-
13068	Western	N/A	5.56	788.00	19,573.50	149.00	N/A	1.90	345.00	5,432.77	49.00	-
13069	Western	N/A	3.86	569.00	14,607.33	66.00	N/A	1.28	407.00	926.30	5.00	-
13070	Western	N/A	13.26	386.00	78,671.40	642.00	N/A	5.88	199.00	5,082.70	11.00	-
13071	Western	N/A	1.64	66.00	377.08	2.00	N/A	30.12	1,427.00	16,484.95	111.00	-
13072	Western	N/A	4.62	698.00	2,114.58	33.00	N/A	4.67	109.00	76.82	2.00	-
13073	Western	N/A	3.45	466.00	7,464.02	37.00	N/A	7.49	353.00	2,404.88	28.00	-
13076	Western	N/A	2.16	109.00	1,451.95	26.00	N/A	1.71	124.00	1,110.53	23.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	2.90	0.08	-	-	-	2.82	174.00	63,509.75	1,104.00	-1.11%	4.47
-	Yes	2.21	0.10	-	-	-	2.11	65.00	-	-	7.94%	4.76
-	Yes	3.18	0.07	-	-	-	3.11	60.00	42,158.67	1,274.00	1.89%	7
-	Yes	2.37	1.69	-	-	-	0.68	5.00	-	-	10.71%	6.2
-	Yes	4.82	0.16	-	-	-	4.66	109.00	-	-	-3.23%	7.79
-	Yes	2.55	0.06	-	-	-	2.49	169.00	-	-	8.13%	5.45
-	Yes	1.68	0.05	-	-	-	1.63	119.00	131,005.95	2,451.00	7.76%	9.17
-	Yes	2.04	0.18	-	-	-	1.86	139.00	3,743.60	1,337.00	3.45%	8.1
-	Yes	1.93	0.10	-	-	-	1.83	191.00	100,427.60	1,209.00	3.77%	4.95
-	Yes	2.97	-	-	-	-	2.97	246.00	54,491.72	1,434.00	-36.27%	5.13
-	Yes	1.31	0.07	-	-	-	1.24	78.00	-	-	-2.29%	2.99
-	Yes	2.64	0.13	-	-	-	2.51	204.00	360,512.08	5,526.00	-3.87%	5.72
-	Yes	1.63	0.05	-	-	-	1.58	124.00	5,373.77	1,311.00	-6.71%	4.17
-	Yes	1.98	1.54	3.00	-	-	0.44	2.00	-	-	-4.05%	5.21
-	Yes	1.99	0.17	-	-	-	1.82	50.00	-	-	13.06%	4.76
-	Yes	1.77	0.09	-	-	-	1.68	12.00	-	-	12.11%	6.85
-	Yes	2.55	0.13	-	-	-	2.42	158.00	-	-	-4.48%	6.18
-	Yes	1.56	0.54	-	-	-	1.02	7.00	-	-	-27.34%	1.86
-	Yes	3.42	1.49	1.00	-	-	1.93	7.00	3,182.00	37.00	-24.61%	2.39
-	Yes	1.53	0.20	2.00	-	-	1.33	9.00	885.15	189.00	-1.69%	7.54
-	Yes	2.22	0.34	-	-	-	1.88	182.00	-	-	-1.20%	4.95
-	Yes	2.00	-	-	-	-	2.00	150.00	32,935.90	883.00	31.73%	6.85
-	Yes	3.54	0.90	-	-	-	2.64	191.00	-	-	146.28%	7.29
-	Yes	2.38	-	-	-	-	2.38	137.00	-	-	-6.54%	2.43
-	Yes	3.21	-	-	-	-	3.21	96.00	242,368.50	2,382.00	-17.60%	6.18
-	Yes	2.06	0.02	-	-	-	2.04	180.00	21,858.40	1,987.00	-5.98%	8.02
-	Yes	0.94	-	-	-	-	0.94	82.00	-	-	-2.01%	5.86
-	Yes	0.61	0.05	-	-	-	0.56	77.00	-	-	0.98%	2.07
-	Yes	1.67	0.37	-	-	-	1.30	68.00	-	-	-14.97%	6.02
-	Yes	1.28	0.03	-	78,369.15	1,241.00	1.25	64.00	118.77	2.00	3.33%	5.28
-	Yes	2.13	0.05	-	-	-	2.08	129.00	-	-	11.46%	5.35
-	Yes	3.37	0.32	-	-	-	3.05	23.00	67,695.45	862.00	-3.19%	3.64
-	Yes	3.15	0.90	-	281.95	6.00	2.25	23.00	127,463.85	1,483.00	-4.01%	8.13
-	Yes	2.00	0.21	-	-	-	1.79	144.00	46,236.92	1,550.00	-9.23%	5.21
-	Yes	1.99	0.16	1.00	-	-	1.83	81.00	-	-	-16.58%	4.78
-	Yes	1.57	-	-	-	-	1.57	31.00	-	-	27.72%	6.45

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13077	Western	N/A	7.41	619.00	17,689.05	100.00	N/A	2.14	75.00	344.45	2.00	-
13078	Western	N/A	7.20	905.00	19,379.13	108.00	N/A	0.99	125.00	4,459.12	15.00	-
13079	Western	N/A	3.57	653.00	6,758.05	31.00	N/A	5.22	848.00	62,338.48	1,531.00	-
13080	Western	N/A	8.04	1,110.00	8,227.43	75.00	N/A	1.36	540.00	5,693.88	15.00	-
13081	Western	N/A	2.90	465.00	3,495.80	21.00	N/A	1.81	790.00	7,182.00	115.00	-
13082	Western	N/A	6.38	772.00	16,668.05	77.00	N/A	1.00	311.00	22,173.80	61.00	-
13084	Eastern	N/A	3.97	169.00	10,003.02	93.00	N/A	2.03	87.00	390.12	2.00	-
13085	Eastern	N/A	2.45	63.00	4,301.95	21.00	N/A	0.52	8.00	346.32	1.00	-
13086	Eastern	N/A	4.78	386.00	14,442.13	57.00	N/A	0.36	9.00	84,152.18	442.00	-
13087	Eastern	N/A	4.27	369.00	1,476.87	16.00	N/A	2.59	327.00	45,758.98	155.00	-
13088	Central	N/A	3.49	415.00	4,867.67	40.00	N/A	1.66	339.00	5,381.07	8.00	-
13089	Central	N/A	7.35	881.00	6,547.85	72.00	N/A	1.53	382.00	76.25	1.00	-
13090	Central	N/A	4.66	695.00	18,994.50	319.00	N/A	1.52	353.00	14,188.98	78.00	-
13091	Central	N/A	5.28	680.00	13,880.30	133.00	N/A	0.09	24.00	175.82	1.00	-
13092	Central	N/A	5.57	662.00	3,964.17	33.00	N/A	0.36	54.00	156.48	2.00	-
13093	Central	N/A	3.39	668.00	10,640.78	102.00	N/A	1.57	89.00	61.53	1.00	-
13094	Central	N/A	6.12	813.00	20,443.57	329.00	N/A	2.56	796.00	8,494.43	22.00	-
13095	Central	N/A	7.62	659.00	16,532.22	106.00	N/A	0.70	100.00	19,252.65	101.00	-
13096	Central	N/A	19.34	687.00	94,385.18	1,459.00	N/A	12.44	544.00	14,573.68	49.00	-
13097	Central	N/A	11.72	490.00	155,161.98	956.00	N/A	29.05	819.00	28,922.92	152.00	-
13098	Central	N/A	10.03	563.00	34,662.98	420.00	N/A	10.74	608.00	45,099.30	182.00	-
13099	Central	N/A	8.71	328.00	52,635.88	887.00	N/A	26.31	921.00	20,637.92	170.00	-
13100	Central	N/A	2.81	243.00	1,144.37	16.00	N/A	2.32	134.00	-	-	-
13101	Central	N/A	2.21	326.00	130.68	5.00	N/A	1.27	193.00	1,416.07	40.00	-
13102	Central	N/A	4.74	782.00	7,793.75	87.00	N/A	2.22	111.00	824.18	14.00	-
13103	Central	N/A	3.41	605.00	264,260.95	3,677.00	N/A	0.34	16.00	11,211.47	57.00	-
13104	Central	N/A	3.79	405.00	2,814.90	17.00	N/A	6.06	609.00	-	-	-
13105	Central	N/A	5.02	475.00	2,671.23	22.00	N/A	5.44	622.00	-	-	-
13106	Central	N/A	1.16	231.00	13,040.47	106.00	N/A	8.61	2,312.00	126,904.70	451.00	-
13107	Central	N/A	3.12	460.00	3,695.57	36.00	N/A	7.78	1,433.00	6,235.43	37.00	-
13109	Western	N/A	4.02	669.00	35,338.45	236.00	N/A	5.33	1,658.00	2,680.18	8.00	-
13110	Western	N/A	0.96	39.00	7,522.88	76.00	N/A	3.17	372.00	-	-	-
13111	Western	N/A	3.00	438.00	4,737.02	24.00	N/A	2.70	427.00	638.38	5.00	-
13112	Western	N/A	3.40	460.00	3,279.98	51.00	N/A	6.20	2,075.00	5,924.68	11.00	-
13113	Western	N/A	1.96	298.00	6,820.07	117.00	N/A	1.97	298.00	33.30	1.00	-
13114	Western	N/A	1.24	122.00	24,297.43	292.00	N/A	3.70	1,733.00	6,821.28	23.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	3.34	0.16	-	-	-	3.18	135.00	78,463.63	1,582.00	12.34%	7.01
-	Yes	1.01	0.06	-	-	-	0.95	14.00	53,973.10	1,119.00	0.86%	5.84
-	Yes	2.40	0.13	-	44,955.35	2,881.00	2.27	129.00	-	-	4.11%	6.58
-	Yes	2.26	0.21	-	-	-	2.05	119.00	-	-	0.88%	7.98
-	Yes	1.20	0.51	-	-	-	0.69	74.00	-	-	19.81%	6.29
-	Yes	0.44	0.07	-	-	-	0.37	24.00	-	-	8.70%	6.12
-	Yes	2.45	0.24	-	-	-	2.21	38.00	-	-	-2.68%	3.99
-	Yes	1.25	0.37	-	-	-	0.88	8.00	-	-	111.11%	7.41
-	Yes	3.26	0.09	-	-	-	3.17	45.00	592.65	439.00	-45.03%	3.43
-	Yes	2.79	0.40	-	-	-	2.39	116.00	-	-	11.15%	6.28
-	Yes	1.14	0.04	-	-	-	1.10	66.00	35,284.47	813.00	1.54%	2.63
-	Yes	1.24	0.99	-	-	-	0.25	15.00	53,522.95	1,229.00	26.06%	6.87
-	Yes	2.52	0.40	-	-	-	2.12	79.00	-	-	6.83%	5.16
-	Yes	2.81	0.24	-	-	-	2.57	153.00	-	-	-51.54%	3.15
-	Yes	1.35	0.19	-	-	-	1.16	118.00	310,567.70	834.00	21.93%	3.28
-	Yes	1.89	0.21	-	-	-	1.68	123.00	-	-	-32.18%	2.74
-	Yes	3.78	1.13	-	37.25	1.00	2.65	149.00	146,394.67	3,022.00	28.13%	8.61
-	Yes	5.32	1.88	-	-	-	3.44	108.00	-	-	3.57%	4.35
-	Yes	3.38	0.10	-	-	-	3.28	81.00	102,604.35	1,270.00	2.38%	8.18
-	Yes	6.49	2.11	-	-	-	4.38	91.00	-	-	8.36%	7.78
-	Yes	4.52	0.07	-	-	-	4.45	105.00	-	-	-2.57%	6.83
-	Yes	6.16	0.07	-	-	-	6.09	50.00	1.00	1.00	9.01%	8.35
-	Yes	2.13	-	-	-	-	2.13	66.00	-	-	-74.45%	2.46
-	Yes	2.14	-	-	-	-	2.14	157.00	-	-	-3.38%	3.43
-	Yes	3.83	0.13	-	-	-	3.70	231.00	-	-	-7.10%	4.32
-	Yes	1.89	0.16	-	-	-	1.73	158.00	-	-	-4.74%	3.42
-	Yes	2.16	0.14	-	-	-	2.02	77.00	-	-	11.46%	5.74
-	Yes	1.65	-	-	-	-	1.65	51.00	-	-	3.27%	6.31
-	Yes	1.45	0.27	-	19,495.47	2,611.00	1.18	43.00	-	-	-11.22%	5.54
-	Yes	3.29	0.15	-	-	-	3.14	151.00	-	-	14.66%	8.29
-	Yes	2.70	1.30	-	-	-	1.40	113.00	-	-	14.48%	5.85
-	Yes	2.15	0.31	-	-	-	1.84	27.00	-	-	17.82%	5.95
-	Yes	1.96	0.45	-	-	-	1.51	61.00	-	-	8.00%	4.59
-	Yes	2.94	0.32	-	-	-	2.62	97.00	-	-	-14.80%	6.85
-	Yes	1.05	0.17	-	-	-	0.88	38.00	-	-	5.03%	2.09
-	Yes	2.37	0.65	-	-	-	1.72	68.00	21,582.15	4,219.00	-60.44%	3.81

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13115	Winter Haven	N/A	6.59	495.00	24,230.75	237.00	N/A	2.88	211.00	4,131.52	19.00	-
13116	Winter Haven	N/A		-	-	-	N/A	-	-	-	-	-
13117	Winter Haven	N/A	11.82	711.00	19,015.00	144.00	N/A	28.18	1,189.00	109,004.48	2,069.00	-
13118	Winter Haven	N/A	6.51	566.00	682,929.62	1,925.00	N/A	19.59	1,150.00	138.72	4.00	-
13119	Plant City	N/A	1.61	29.00	852.20	4.00	N/A	2.17	634.00	287.38	43.00	-
13120	Plant City	N/A	2.43	64.00	39,289.62	315.00	N/A	10.96	961.00	4,214.98	40.00	-
13121	Plant City	N/A	3.54	93.00	10,356.40	186.00	N/A	7.38	703.00	11,394.62	85.00	-
13122	Plant City	N/A	4.00	319.00	697.58	5.00	N/A	1.15	67.00	84,728.45	212.00	-
13123	Plant City	N/A	7.56	741.00	27,960.42	194.00	N/A	1.62	283.00	5,333.57	46.00	-
13124	Plant City	N/A	6.76	338.00	35,369.30	639.00	N/A	3.59	185.00	10,768.70	84.00	-
13125	Plant City	N/A	4.00	428.00	98.13	1.00	N/A	3.73	371.00	104.03	1.00	-
13126	Plant City	N/A	17.33	478.00	38,802.55	1,258.00	N/A	6.33	324.00	20,174.13	142.00	-
13127	Eastern	N/A	4.91	272.00	43,087.03	416.00	N/A	20.79	1,458.00	9,386.13	92.00	-
13128	Eastern	N/A	9.22	586.00	37,983.02	267.00	N/A	8.29	618.00	173,038.42	2,085.00	-
13129	Eastern	N/A	2.86	251.00	14,219.15	139.00	N/A	5.51	421.00	1,062.17	5.00	-
13130	Eastern	N/A	8.47	478.00	19,326.72	204.00	N/A	6.79	890.00	59,676.98	894.00	-
13132	Eastern	N/A	1.52	42.00	1,025.70	22.00	N/A	1.80	117.00	388.37	1.00	-
13133	Eastern	N/A	13.46	1,368.00	126,862.90	5,775.00	N/A	4.95	1,064.00	299,449.07	1,949.00	-
13134	Eastern	N/A	2.14	172.00	3,785.60	38.00	N/A	2.64	218.00	257.07	2.00	-
13136	Western	N/A	4.29	493.00	20,684.05	171.00	N/A	0.49	11.00	2,201.15	19.00	-
13137	Western	N/A	0.76	131.00	2,205.73	32.00	N/A	2.47	772.00	18,608.78	104.00	-
13138	Western	N/A	0.73	152.00	5,310.45	9.00	N/A	7.31	845.00	141.73	2.00	-
13139	Western	N/A	5.38	495.00	1,540.32	14.00	N/A	4.09	996.00	2,097.43	35.00	-
13140	Western	N/A	3.05	391.00	17,090.93	269.00	N/A	1.64	907.00	1,160.98	8.00	-
13141	Western	N/A	1.94	464.00	118,125.42	640.00	N/A	1.32	502.00	3,745.82	7.00	-
13142	Western	N/A	2.59	570.00	27,136.48	539.00	N/A	1.97	1,206.00	126.42	3.00	-
13143	Western	N/A	8.02	1,138.00	32,839.28	196.00	N/A	0.68	184.00	13,481.65	60.00	-
13146	Plant City	N/A	27.59	644.00	43,144.40	225.00	N/A	4.36	106.00	1,309.95	12.00	-
13147	Plant City	N/A	28.65	904.00	199,376.03	2,092.00	N/A	16.14	801.00	287.87	1.00	-
13148	Plant City	N/A	29.38	645.00	112,614.42	3,487.00	N/A	2.91	66.00	1,099.18	7.00	-
13150	Winter Haven	N/A	4.28	369.00	20,094.65	151.00	N/A	6.43	228.00	413.18	1.00	-
13151	Winter Haven	N/A	1.81	37.00	26,712.38	276.00	N/A	13.66	2,144.00	806.17	16.00	-
13152	Winter Haven	N/A	3.43	327.00	9,603.78	84.00	N/A	8.83	613.00	32,406.13	293.00	-
13153	Winter Haven	N/A	7.23	696.00	25,150.17	335.00	N/A	4.51	342.00	3,125.30	63.00	-
13154	Western	N/A	3.65	399.00	13,745.38	74.00	N/A	8.83	1,477.00	11,369.22	31.00	-
13155	Western	N/A	3.74	397.00	242,643.65	2,853.00	N/A	12.23	1,315.00	1,350.97	12.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	2.23	0.07	-	-	-	2.16	63.00	-	-	21.19%	6.52
-	Yes	-	-	-	-	-	-	-	-	-	0.00%	0
-	Yes	7.08	2.62	-	-	-	4.46	101.00	404,831.80	4,239.00	-22.42%	6.47
-	Yes	5.62	1.10	-	-	-	4.52	130.00	2,749.18	717.00	-26.78%	7
-	Yes	2.28	0.09	-	-	-	2.19	17.00	113,056.63	684.00	29.79%	6.23
-	Yes	3.17	1.00	-	-	-	2.17	26.00	115,603.75	2,100.00	-10.09%	5.79
-	Yes	3.12	0.32	-	36.63	1.00	2.80	64.00	44,730.65	862.00	-6.56%	8.12
-	Yes	1.42	0.09	-	-	-	1.33	49.00	-	-	-45.27%	3.59
-	Yes	2.98	0.03	-	-	-	2.95	135.00	-	-	44.44%	5.2
-	Yes	3.70	0.03	-	-	-	3.67	107.00	26,746.02	622.00	-16.31%	5.03
-	Yes	4.19	1.66	-	-	-	2.53	131.00	-	-	-2.78%	5.94
-	Yes	6.24	0.80	-	-	-	5.44	23.00	32,535.73	802.00	90.58%	5.87
-	Yes	4.09	-	-	-	-	4.09	119.00	-	-	10.60%	8.97
-	Yes	3.37	0.03	-	-	-	3.34	104.00	-	-	1.19%	5.96
-	Yes	2.01	0.13	-	-	-	1.88	47.00	-	-	-4.44%	4.09
-	Yes	4.44	0.13	-	-	-	4.31	145.00	43,439.00	718.00	4.59%	7.74
-	Yes	1.01	0.13	-	-	-	0.88	14.00	-	-	-25.63%	1.77
-	Yes	3.73	0.96	-	-	-	2.77	61.00	-	-	12.54%	9.6
-	Yes	1.19	0.12	-	-	-	1.07	53.00	20,420.97	442.00	-8.33%	1.98
-	Yes	1.49	0.08	-	-	-	1.41	26.00	-	-	54.05%	4.56
-	Yes	1.41	0.16	-	-	-	1.25	98.00	-	-	3.62%	4.29
-	Yes	1.43	0.13	-	-	-	1.30	37.00	-	-	-18.79%	4.02
-	Yes	1.70	0.04	-	-	-	1.66	65.00	1,639.47	1,537.00	-7.42%	7.36
-	Yes	0.63	0.27	-	-	-	0.36	36.00	-	-	14.56%	4.72
-	Yes	1.45	0.38	-	-	-	1.07	132.00	-	-	1.69%	6
-	Yes	1.10	0.28	-	-	-	0.82	69.00	-	-	5.05%	5.62
-	Yes	3.41	1.33	24.00	-	-	2.08	205.00	-	-	-0.76%	7.87
-	Yes	9.89	0.40	-	375,310.25	2,431.00	9.49	72.00	72.98	1.00	1.17%	3.47
-	Yes	6.14	0.07	-	-	-	6.07	70.00	18,860.40	372.00	-1.34%	7.39
-	Yes	6.01	0.07	-	-	-	5.94	67.00	-	-	8.36%	3.5
-	Yes	3.57	0.37	1.00	-	-	3.20	90.00	75.08	1.00	-3.87%	7.94
-	Yes	3.54	0.02	-	-	-	3.52	24.00	25,363.30	2,198.00	24.78%	7.15
-	Yes	3.08	0.13	-	-	-	2.95	143.00	-	-	-4.96%	5.75
-	Yes	1.42	0.04	-	-	-	1.38	50.00	-	-	-3.03%	4.48
-	Yes	1.35	-	-	-	-	1.35	83.00	125,455.50	2,031.00	-8.11%	6.91
-	Yes	3.05	1.04	-	110.15	1.00	2.01	54.00	184,314.28	1,889.00	1.24%	7.35

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13156	Western	N/A	2.20	209.00	34,729.37	150.00	N/A	3.90	929.00	44,402.02	220.00	-
13157	Western	N/A	0.87	65.00	8,848.65	72.00	N/A	10.35	573.00	78,079.38	179.00	-
13158	Central	N/A		-	-	-	N/A	-	-	-	-	-
13159	Central	N/A	9.37	1,078.00	17,057.78	282.00	N/A	1.61	272.00	362.83	5.00	-
13160	Central	N/A	4.95	555.00	45,755.00	233.00	N/A	2.04	385.00	2,710.93	7.00	-
13161	Western	N/A	3.54	456.00	8,687.08	149.00	N/A	0.19	58.00	58.30	1.00	-
13162	Western	N/A	5.20	553.00	31,441.02	188.00	N/A	1.92	314.00	51.93	1.00	-
13163	Western	N/A	5.82	939.00	36,806.30	207.00	N/A	0.58	137.00	1,507.48	8.00	-
13164	Western	N/A	5.79	734.00	49,807.82	617.00	N/A	0.90	29.00	237.38	3.00	-
13165	Western	N/A	1.82	295.00	-	-	N/A	0.73	55.00	-	-	-
13166	Western	N/A	2.74	748.00	8,487.85	78.00	N/A	1.32	537.00	88.72	1.00	-
13167	Western	N/A	7.75	1,386.00	29,069.05	216.00	N/A	0.87	431.00	106.25	1.00	-
13169	Eastern	N/A	0.79	6.00	29,280.95	3,317.00	N/A	10.37	1,228.00	2,551.07	8.00	-
13170	Eastern	N/A	0.29	1.00	21,707.35	763.00	N/A	16.85	2,130.00	4,743.95	26.00	-
13171	Eastern	N/A	5.30	233.00	9,411.95	60.00	N/A	14.90	1,353.00	82,681.90	517.00	-
13172	Eastern	N/A	6.75	394.00	12,181.35	132.00	N/A	3.87	273.00	1,409.47	7.00	-
13173	Eastern	N/A	3.27	477.00	1,151.38	45.00	N/A	15.12	2,299.00	3,329.20	11.00	-
13174	Eastern	N/A	1.88	14.00	157,394.42	1,956.00	N/A	17.02	3,280.00	353.97	2.00	-
13175	Central	N/A	16.85	1,803.00	745,579.65	2,315.00	N/A	1.09	46.00	56,078.28	729.00	-
13176	Central	N/A	6.45	787.00	278.98	5.00	N/A	4.84	212.00	171,365.15	1,316.00	-
13177	Central	N/A	3.23	326.00	12,320.63	134.00	N/A	0.49	51.00	267.42	2.00	-
13178	Central	N/A	3.09	105.00	8,086.20	57.00	N/A	0.71	166.00	-	-	-
13180	Central	N/A	2.17	265.00	26,975.68	127.00	N/A	0.62	251.00	8,154.63	268.00	-
13181	Central	N/A	3.70	307.00	18,884.98	56.00	N/A	1.47	896.00	1,478.08	10.00	-
13183	Central	N/A	6.52	365.00	8,505.80	51.00	N/A	0.62	37.00	9,369.38	269.00	-
13184	Central	N/A	1.48	68.00	23,321.10	33.00	N/A	0.53	38.00	-	-	-
13185	Central	N/A	2.54	217.00	908.25	21.00	N/A	7.80	1,060.00	8,114.02	58.00	-
13186	Central	N/A	4.57	491.00	2,676.98	40.00	N/A	0.67	113.00	12,698.33	37.00	-
13187	Central	N/A	6.01	554.00	17,186.55	152.00	N/A	5.01	672.00	1,510.55	6.00	-
13188	Central	N/A	4.86	416.00	19,378.95	187.00	N/A	6.00	631.00	45,963.35	135.00	-
13189	Western	N/A	2.21	146.00	820.73	3.00	N/A	1.92	76.00	38.38	1.00	-
13190	Western	N/A	7.38	526.00	1,369.58	8.00	N/A	11.73	556.00	63,493.92	402.00	-
13191	Western	N/A	4.50	353.00	1,577.85	34.00	N/A	7.04	416.00	12,884.75	136.00	-
13192	Western	N/A	3.95	283.00	97,609.05	315.00	N/A	8.19	835.00	3,679.67	14.00	-
13193	Western	N/A		-	65,177.67	338.00	N/A	10.23	829.00	-	-	-
13194	Western	N/A	4.96	187.00	16,563.67	75.00	N/A	2.22	123.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	2.14	0.07	-	-	-	2.07	69.00	9.00	9.00	3.42%	4.84
-	Yes	1.21	0.34	-	-	-	0.87	71.00	-	-	3.36%	3.69
-	Yes	0.86	0.86	-	-	-	-	-	-	-	-41.70%	3.09
-	Yes	1.59	0.09	-	-	-	1.50	124.00	-	-	-22.93%	5.68
-	Yes	0.80	0.06	-	-	-	0.74	28.00	-	-	-54.71%	2.79
-	Yes	0.53	0.06	-	-	-	0.47	51.00	39,712.33	545.00	4.48%	2.8
-	Yes	1.62	0.16	-	-	-	1.46	122.00	-	-	7.56%	7.97
-	Yes	1.39	0.08	-	-	-	1.31	99.00	-	-	-0.58%	6.83
-	Yes	1.75	0.35	-	-	-	1.40	31.00	-	-	-2.08%	5.66
-	Yes	0.55	0.37	-	-	-	0.18	-	25,947.37	327.00	-7.99%	3.34
-	Yes	4.17	0.74	-	-	-	3.43	227.00	319,317.47	4,530.00	16.43%	8.15
-	Yes	1.47	0.04	-	-	-	1.43	135.00	189,301.53	1,907.00	3.88%	8.03
-	Yes	3.65	1.65	-	-	-	2.00	17.00	10,664.88	1,240.00	1.12%	7.24
-	Yes	4.87	1.90	-	-	-	2.97	13.00	-	-	4.32%	9.66
-	Yes	4.09	0.15	-	-	-	3.94	72.00	66,028.70	1,749.00	-3.42%	8.46
-	Yes	3.54	0.11	-	-	-	3.43	54.00	-	-	-9.03%	3.93
-	Yes	3.87	1.94	7.00	-	-	1.93	7.00	4,268.60	2,788.00	0.12%	8.14
-	Yes	2.77	0.35	-	80,482.33	3,067.00	2.42	16.00	-	-	9.31%	8.92
-	Yes	4.52	0.23	-	-	-	4.29	177.00	-	-	-6.02%	8.58
-	Yes	3.76	0.36	-	-	-	3.40	103.00	250,193.30	3,229.00	-7.41%	8.12
-	Yes	1.70	0.20	-	-	-	1.50	108.00	27,579.32	657.00	22.39%	3.99
-	Yes	2.97	0.38	-	1,339.45	11.00	2.59	57.00	65,283.15	910.00	13.82%	7
-	Yes	1.54	0.73	-	12.98	1.00	0.81	47.00	78,003.60	1,572.00	-12.95%	3.63
-	Yes	2.09	0.17	-	-	-	1.92	95.00	163,298.17	2,570.00	-11.31%	5.96
-	Yes	1.26	0.22	-	-	-	1.04	36.00	71,346.93	1,286.00	29.21%	4.07
-	Yes	2.12	0.40	-	-	-	1.72	62.00	-	-	9.83%	2.57
-	Yes	1.25	0.06	-	-	-	1.19	75.00	-	-	-4.23%	3.85
-	Yes	2.27	-	-	-	-	2.27	152.00	-	-	8.50%	3.19
-	Yes	2.21	0.06	-	-	-	2.15	118.00	139,669.33	1,280.00	6.29%	5.41
-	Yes	2.58	0.01	-	-	-	2.57	110.00	387,497.93	2,248.00	-1.61%	5.51
-	Yes	1.86	0.16	-	-	-	1.70	68.00	26,662.47	835.00	-1.62%	7.31
-	Yes	4.64	0.63	-	-	-	4.01	118.00	1,087.63	487.00	-4.59%	7.27
-	Yes	3.49	0.32	-	-	-	3.17	82.00	183,005.32	4,485.00	-9.99%	6.4
-	Yes	4.33	0.40	-	-	-	3.93	23.00	152,707.83	2,002.00	-0.53%	7.44
-	Yes	4.99	1.91	-	-	-	3.08	2.00	67,598.52	493.00	-7.79%	3.55
-	Yes	1.33	0.12	-	-	-	1.21	19.00	-	-	-24.44%	2.01

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13195	Western	N/A	0.71	69.00	-	-	N/A	2.12	23.00	-	-	-
13198	Western	N/A	2.95	502.00	27,678.83	131.00	N/A	5.23	348.00	2,112.67	12.00	-
13199	Western	N/A	4.31	645.00	7,427.37	145.00	N/A	1.13	166.00	966.47	2.00	-
13200	Western	N/A	0.36	23.00	119.78	2.00	N/A	0.39	5.00	-	-	-
13201	Western	N/A	2.75	395.00	-	-	N/A	0.95	515.00	30,448.72	172.00	-
13204	Central	N/A	2.85	309.00	452.30	7.00	N/A	8.14	1,436.00	136.50	1.00	-
13205	Central	N/A	2.15	173.00	1,487.75	44.00	N/A	8.94	896.00	-	-	-
13206	Western	N/A	10.07	1,344.00	33,234.65	271.00	N/A	0.56	94.00	147.20	3.00	-
13207	Western	N/A	8.31	689.00	23,727.37	716.00	N/A	4.25	177.00	2,552.58	25.00	-
13208	Western	N/A	2.92	265.00	1,352.02	19.00	N/A	4.39	176.00	7,673.40	28.00	-
13210	Western	N/A	6.65	648.00	38,708.50	1,222.00	N/A	5.78	224.00	3,654.68	33.00	-
13211	Eastern	N/A	1.44	66.00	6,061.25	120.00	N/A	7.34	605.00	62.05	3.00	-
13213	Eastern	N/A	16.89	681.00	155,291.70	2,981.00	N/A	13.03	1,089.00	114,968.88	501.00	-
13214	Eastern	N/A	5.91	429.00	1,346.73	29.00	N/A	4.58	239.00	2,343.65	14.00	-
13215	Eastern	N/A	0.05	2.00	-	-	N/A	0.28	3.00	-	-	-
13217	Western	N/A	2.80	318.00	19,134.78	85.00	N/A	1.85	188.00	-	-	-
13218	Western	N/A	5.51	572.00	31,818.17	266.00	N/A	2.13	773.00	37,521.23	58.00	-
13219	Western	N/A	8.64	1,131.00	21,936.07	205.00	N/A	4.08	511.00	9,263.00	131.00	-
13220	Western	N/A	3.93	356.00	11,152.45	44.00	N/A	3.01	347.00	6,117.32	63.00	-
13221	Central	N/A	3.52	130.00	2,615.33	9.00	N/A	5.83	1,263.00	4,283.48	54.00	-
13222	Central	N/A	2.54	186.00	1,921.32	7.00	N/A	1.80	38.00	-	-	-
13223	Central	N/A	4.48	321.00	2,835.23	38.00	N/A	1.52	131.00	-	-	-
13224	Central	N/A	9.23	840.00	187,252.47	1,260.00	N/A	2.53	568.00	276.57	4.00	-
13225	Eastern	N/A	5.77	448.00	51,148.68	257.00	N/A	4.59	381.00	48,328.73	347.00	-
13226	Eastern	N/A	3.00	323.00	18,332.38	117.00	N/A	7.61	962.00	2,272.67	40.00	-
13227	Eastern	N/A	5.99	452.00	25,555.33	213.00	N/A	10.21	830.00	3,829.47	26.00	-
13228	Eastern	N/A	3.95	246.00	15,700.15	1,041.00	N/A	5.61	1,187.00	75,655.73	778.00	-
13229	Eastern	N/A	8.02	651.00	24,232.58	313.00	N/A	5.45	635.00	29,081.22	386.00	-
13230	Eastern	N/A	3.71	225.00	183.57	2.00	N/A	6.53	868.00	16,072.10	130.00	-
13231	Eastern	N/A	4.61	409.00	75,453.73	391.00	N/A	8.78	754.00	121.98	1.00	-
13233	South Hillsborough	N/A	5.91	74.00	19,065.83	281.00	N/A	19.47	1,750.00	46,181.38	650.00	-
13235	South Hillsborough	N/A	0.01	-	6,763.67	15.00	N/A	30.87	3,003.00	53,417.17	112.00	-
13236	South Hillsborough	N/A	3.41	38.00	-	-	N/A	21.44	2,063.00	147.10	2.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	1.43	0.78	-	-	-	0.65	29.00	-	-	0.51%	5.92
-	Yes	3.09	0.44	-	-	-	2.65	172.00	-	-	-1.69%	4.64
-	Yes	0.91	0.17	-	-	-	0.74	86.00	-	-	33.94%	5.17
-	Yes	0.64	0.05	-	-	-	0.59	46.00	-	-	-5.59%	3.21
-	Yes	2.51	0.95	-	-	-	1.56	95.00	42,746.00	957.00	3.33%	5.89
-	Yes	2.56	0.23	-	-	-	2.33	122.00	-	-	-0.93%	4.27
-	Yes	1.93	0.39	-	-	-	1.54	63.00	181,707.83	1,115.00	91.08%	6.21
-	Yes	1.24	0.13	-	-	-	1.11	90.00	10,603.75	1,497.00	6.57%	7.62
-	Yes	1.05	0.38	-	-	-	0.67	26.00	-	-	-4.95%	6.34
-	Yes	1.23	0.17	-	-	-	1.06	96.00	-	-	-3.57%	3.51
-	Yes	2.33	0.27	-	-	-	2.06	103.00	-	-	0.00%	5.37
-	Yes	2.24	0.33	-	-	-	1.91	15.00	-	-	28.45%	9.03
-	Yes	5.95	2.02	-	-	-	3.93	118.00	6,243.13	1,854.00	-13.57%	8.28
-	Yes	2.97	0.26	-	-	-	2.71	68.00	29,260.40	2,181.00	5.83%	4.36
-	Yes	1.66	0.99	-	-	-	0.67	8.00	-	-	1.54%	2.64
-	Yes	3.06	0.91	-	-	-	2.15	71.00	-	-	15.09%	5.11
-	Yes	2.02	0.17	-	-	-	1.85	75.00	-	-	4.56%	4.82
-	Yes	2.66	0.14	-	-	-	2.52	196.00	23,053.70	3,590.00	8.48%	7.93
-	Yes	1.36	0.08	-	-	-	1.28	18.00	-	-	-11.58%	2.75
-	Yes	1.90	0.17	-	-	-	1.73	28.00	-	-	5.81%	5.65
-	Yes	2.47	0.50	-	-	-	1.97	45.00	-	-	16.37%	5.19
-	Yes	2.98	0.23	-	-	-	2.75	67.00	-	-	1.65%	3.69
-	Yes	3.25	0.83	-	-	-	2.42	63.00	-	-	5.24%	7.43
-	Yes	0.58	0.06	-	-	-	0.52	7.00	3,367.20	828.00	-4.42%	3.68
-	Yes	2.57	0.13	-	-	-	2.44	36.00	-	-	3.76%	8.27
-	Yes	3.18	0.04	-	-	-	3.14	78.00	-	-	11.29%	7.69
-	Yes	3.53	0.22	-	-	-	3.31	80.00	16,249.27	2,454.00	5.20%	7.49
-	Yes	2.37	0.11	-	44.82	1.00	2.26	84.00	60,188.78	1,343.00	-2.70%	5.76
-	Yes	2.67	0.26	7.00	-	-	2.41	113.00	-	-	1.13%	5.38
-	Yes	3.45	0.17	-	-	-	3.28	88.00	1,799.17	1,270.00	-2.93%	6.29
-	Yes	5.68	1.80	-	-	-	3.88	10.00	-	-	262.50%	6.96
-	Yes	7.39	4.21	-	-	-	3.18	3.00	-	-	30.50%	11.04
-	Yes	6.81	2.86	-	-	-	3.95	9.00	110,552.42	2,080.00	108.99%	9.07

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13237	South Hillsborough	N/A	0.10	-	60.83	1.00	N/A	23.88	2,024.00	1,056.68	11.00	-
13238	South Hillsborough	N/A	0.02	-	8,862.68	62.00	N/A	25.88	1,976.00	17,895.80	698.00	-
13239	South Hillsborough	N/A	0.29	5.00	-	-	N/A	7.61	946.00	-	-	-
13240	South Hillsborough	N/A	0.81	11.00	16,859.93	267.00	N/A	17.14	1,121.00	41,620.05	227.00	-
13241	Plant City	N/A	7.37	593.00	11,237.03	66.00	N/A	4.83	492.00	42,707.98	187.00	-
13242	Plant City	N/A	12.72	369.00	14,119.08	183.00	N/A	5.24	413.00	15,141.00	24.00	-
13243	Plant City	N/A	12.06	859.00	74,825.12	440.00	N/A	8.23	598.00	59,847.90	750.00	-
13253	Central	N/A	0.09	-	-	-	N/A	-	-	-	-	-
13254	South Hillsborough	N/A	21.43	700.00	80,887.98	1,053.00	N/A	11.83	1,033.00	55,025.85	836.00	-
13256	South Hillsborough	N/A	21.30	557.00	93,102.90	1,572.00	N/A	7.04	766.00	56,209.97	279.00	-
13258	Central	N/A		-	-	-	N/A	0.40	23.00	-	-	-
13259	Central	N/A		-	-	-	N/A	1.46	65.00	-	-	-
13260	Central	N/A		-	-	-	N/A	-	-	-	-	-
13261	Central	N/A		-	-	-	N/A	1.26	11.00	-	-	-
13262	Central	N/A		-	-	-	N/A	0.01	1.00	-	-	-
13263	Central	N/A		-	-	-	N/A	0.30	2.00	-	-	-
13264	Central	N/A		-	4,937.55	238.00	N/A	1.62	806.00	58,626.40	144.00	-
13265	Central	N/A		-	-	-	N/A	0.84	59.00	-	-	-
13267	Plant City	N/A	-	-	3,506.00	20.00	N/A	1.28	16.00	-	-	-
13268	Plant City	N/A	2.44	78.00	1,991.50	10.00	N/A	1.52	14.00	-	-	-
13269	Plant City	N/A	1.67	31.00	-	-	N/A	4.45	96.00	-	-	-
13270	Western	N/A	0.36	29.00	11,128.82	84.00	N/A	4.28	500.00	2,006.42	20.00	-
13275	Western	N/A		-	-	-	N/A	1.35	4.00	27.67	1.00	-
13276	Western	N/A		-	-	-	N/A	2.56	11.00	-	-	-
13278	Winter Haven	N/A	7.89	671.00	12,670.57	60.00	N/A	1.11	93.00	31.00	1.00	-
13279	Winter Haven	N/A	9.22	942.00	18,001.42	100.00	N/A	1.71	49.00	189.82	3.00	-
13280	Winter Haven	N/A	2.80	99.00	-	-	N/A	0.60	14.00	90.47	1.00	-
13281	Winter Haven	N/A		-	-	-	N/A	0.18	5.00	-	-	-
13282	Winter Haven	N/A		-	-	-	N/A	0.11	2.00	-	-	-
13283	Winter Haven	N/A		-	-	-	N/A	0.23	6.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	4.81	3.21	-	-	-	1.60	4.00	-	-	-21.80%	9.4
-	Yes	5.76	4.78	-	-	-	0.98	3.00	197,542.83	1,921.00	18.50%	8.2
-	Yes	3.23	1.38	-	-	-	1.85	4.00	-	-	-58.89%	3.4
-	Yes	4.33	2.11	-	-	-	2.22	16.00	-	-	36.36%	5.25
-	Yes	1.54	-	-	-	-	1.54	38.00	-	-	1.04%	6.78
-	Yes	4.70	0.10	-	-	-	4.60	94.00	-	-	13.00%	4.78
-	Yes	3.48	0.17	-	118.85	3.00	3.31	204.00	216,728.48	2,922.00	31.90%	8.56
-	Yes	0.46	0.02	-	-	-	0.44	-	-	-	-67.80%	1.8
-	Yes	12.61	0.20	-	-	-	12.41	140.00	245,105.50	3,751.00	20.10%	7.29
-	Yes	1.95	0.24	-	-	-	1.71	3.00	-	-	18.62%	4.14
-	Yes	0.34	0.34	-	-	-	-	-	-	-	10.48%	6.01
-	Yes	0.76	0.76	-	-	-	-	-	-	-	8.27%	5.37
-	Yes	-	-	-	-	-	-	-	-	-	-100.00%	0
-	Yes	0.78	0.78	-	-	-	-	-	-	-	11.23%	3.17
-	Yes	0.76	0.76	-	-	-	-	-	-	-	100.00%	0.29
-	Yes	1.10	1.10	-	-	-	-	-	-	-	103.33%	1.22
-	Yes	1.53	1.51	144.00	-	-	0.02	-	48,535.58	1,670.00	-3.65%	5.8
-	Yes	0.63	0.63	-	-	-	-	-	-	-	-26.88%	2.04
-	Yes	2.14	0.47	-	-	-	1.67	2.00	744.00	15.00	-7.34%	7.07
-	Yes	2.88	0.09	-	-	-	2.79	8.00	-	-	-31.07%	3.15
-	Yes	2.45	0.16	-	-	-	2.29	8.00	-	-	-24.43%	1.67
-	Yes	1.50	0.51	-	-	-	0.99	4.00	91,069.23	1,583.00	24.29%	1.74
-	Yes	2.32	2.32	-	-	-	-	-	-	-	0.00%	2.7
-	Yes	1.68	1.68	-	-	-	-	-	-	-	-52.56%	2.96
-	Yes	3.98	0.12	-	-	-	3.86	193.00	-	-	34.67%	6.72
-	Yes	5.76	0.97	-	91.32	1.00	4.79	226.00	115,345.60	2,352.00	0.16%	6.33
-	Yes	2.80	0.32	-	-	-	2.48	48.00	-	-	-51.53%	2.69
-	Yes	0.95	0.94	-	-	-	0.01	-	-	-	-31.05%	5.93
-	Yes	1.21	1.20	-	-	-	0.01	-	-	-	-32.49%	5.07
-	Yes	1.23	1.23	-	-	-	-	-	-	-	-31.79%	4.87

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13284	Winter Haven	N/A		-	-	-	N/A	-	-	-	-	-
13285	Winter Haven	N/A		-	-	-	N/A	-	-	-	-	-
13288	Winter Haven	N/A	1.03	86.00	2,031.98	7.00	N/A	2.00	120.00	-	-	-
13289	Winter Haven	N/A	3.98	276.00	21,262.83	277.00	N/A	2.29	384.00	19,737.62	38.00	-
13290	Winter Haven	N/A	4.72	552.00	74,072.25	450.00	N/A	1.24	342.00	54,861.27	249.00	-
13291	Winter Haven	N/A	6.70	550.00	56,429.45	260.00	N/A	7.72	938.00	560.60	5.00	-
13292	Winter Haven	N/A	6.31	517.00	1,899.03	13.00	N/A	7.34	582.00	58,387.68	85.00	-
13293	Winter Haven	N/A	8.33	997.00	16,389.05	213.00	N/A	4.14	577.00	320.87	16.00	-
13294	Winter Haven	N/A	13.47	710.00	14,237.18	100.00	N/A	4.24	446.00	1,009.57	14.00	-
13295	Winter Haven	N/A	2.72	277.00	13,229.43	118.00	N/A	11.22	931.00	15,328.97	118.00	-
13296	Winter Haven	N/A	5.89	337.00	557.72	11.00	N/A	28.80	1,958.00	39,609.40	216.00	-
13297	Winter Haven	N/A	2.77	118.00	21,518.22	57.00	N/A	11.91	1,048.00	12,729.37	80.00	-
13298	Winter Haven	N/A	137.05	1,182.00	519,825.88	7,647.00	N/A	7.05	68.00	10,924.50	451.00	-
13299	Winter Haven	N/A	8.14	293.00	31,316.87	194.00	N/A	8.32	489.00	1,072.42	5.00	-
13302	South Hillsborough	N/A	2.81	209.00	200,219.27	1,004.00	N/A	20.29	1,496.00	47,018.53	235.00	-
13303	South Hillsborough	N/A	22.48	831.00	28,700.07	224.00	N/A	13.61	527.00	3,990.83	10.00	-
13304	South Hillsborough	N/A	0.72	9.00	24,687.02	262.00	N/A	23.67	2,102.00	441.50	2.00	-
13305	South Hillsborough	N/A		-	21,180.47	242.00	N/A	25.15	1,794.00	119,828.18	1,421.00	-
13308	Winter Haven	N/A	6.19	624.00	29,331.67	1,118.00	N/A	3.56	599.00	1,270.22	5.00	-
13309	Winter Haven	N/A	2.51	266.00	1,723.33	32.00	N/A	0.36	44.00	79.47	3.00	-
13310	Winter Haven	N/A	2.05	358.00	23,077.47	75.00	N/A	0.68	215.00	-	-	-
13311	Winter Haven	N/A	5.74	683.00	13,562.33	132.00	N/A	0.63	100.00	69.90	1.00	-
13312	Winter Haven	N/A	3.93	463.00	5,370.95	285.00	N/A	2.70	465.00	3,357.78	11.00	-
13313	Winter Haven	N/A	2.28	231.00	6,112.80	45.00	N/A	1.37	140.00	313.17	5.00	-
13314	Winter Haven	N/A	0.98	27.00	4,543.50	18.00	N/A	3.70	423.00	988.73	2.00	-
13315	Winter Haven	N/A		-	-	-	N/A	0.33	13.00	-	-	-
13317	Western	N/A	0.78	-	-	-	N/A	5.30	1,432.00	51.55	1.00	-
13318	Western	N/A		-	-	-	N/A	-	-	-	-	-
13319	Western	N/A		-	-	-	N/A	-	-	-	-	-
13320	Western	N/A		-	-	-	N/A	-	-	-	-	-
13321	Western	N/A		-	-	-	N/A	1.45	6.00	-	-	-
13322	Western	N/A	0.01	-	-	-	N/A	1.63	669.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	0.08	0.08	-	-	-	-	-	-	-	0.00%	0
-	Yes	0.06	0.06	-	-	-	-	-	-	-	0.00%	0
-	Yes	1.49	0.22	-	-	-	1.27	26.00	-	-	5.36%	5.9
-	Yes	3.04	0.17	-	-	-	2.87	82.00	250,464.90	2,909.00	9.95%	4.09
-	Yes	3.33	0.12	-	3,721.48	31.00	3.21	190.00	243,915.05	3,409.00	11.22%	4.36
-	Yes	4.49	0.72	-	-	-	3.77	83.00	-	-	69.46%	8.49
-	Yes	3.40	0.12	-	-	-	3.28	150.00	-	-	86.14%	5.64
-	Yes	3.44	0.07	-	-	-	3.37	140.00	-	-	17.47%	5.58
-	Yes	5.49	0.30	-	-	-	5.19	151.00	-	-	7.37%	6.99
-	Yes	3.77	0.62	-	-	-	3.15	44.00	-	-	32.01%	6.64
-	Yes	6.75	1.10	-	-	-	5.65	147.00	-	-	13.50%	7.65
-	Yes	3.84	0.12	-	-	-	3.72	150.00	5,672.37	1,329.00	-32.74%	3.76
-	Yes	24.05	-	-	-	-	24.05	106.00	74,221.87	934.00	26.85%	7.37
-	Yes	3.21	0.08	-	-	-	3.13	34.00	38,144.62	811.00	-30.58%	4.63
-	Yes	3.01	1.48	-	-	-	1.53	8.00	149,311.50	1,710.00	-4.48%	6.19
-	Yes	10.43	3.94	-	-	-	6.49	96.00	-	-	-36.40%	5.47
-	Yes	5.62	3.63	-	-	-	1.99	3.00	-	-	11.67%	7.37
-	Yes	3.45	3.12	-	-	-	0.33	-	29,328.15	6,601.00	8.70%	5.37
-	Yes	3.86	0.24	-	-	-	3.62	178.00	55,663.53	1,616.00	11.53%	6.77
-	Yes	1.71	0.04	-	-	-	1.67	51.00	13,394.68	352.00	-7.32%	3.67
-	Yes	1.36	0.05	-	-	-	1.31	20.00	24,397.73	1,119.00	6.21%	3.25
-	Yes	3.06	0.16	-	814.13	18.00	2.90	143.00	36,642.27	798.00	-2.04%	4.33
-	Yes	3.23	0.23	-	-	-	3.00	83.00	-	-	-3.91%	7.12
-	Yes	2.07	0.44	-	-	-	1.63	29.00	25,964.45	453.00	-7.18%	5.3
-	Yes	2.48	0.63	-	-	-	1.85	42.00	-	-	14.55%	4.41
-	Yes	0.58	0.58	-	-	-	-	-	-	-	-49.28%	0.7
-	Yes	3.79	3.47	-	-	-	0.32	3.00	-	-	-1.08%	4.6
-	Yes	1.17	1.17	-	-	-	-	-	-	-	0.00%	0.07
-	Yes	0.97	0.97	-	-	-	-	-	-	-	-14.29%	0.06
-	Yes	1.12	1.12	-	-	-	-	-	-	-	0.00%	0.07
-	Yes	2.11	2.11	-	-	-	-	-	-	-	119.83%	2.66
-	Yes	3.13	2.77	1.00	-	-	0.36	-	-	-	-7.87%	3.63

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13323	Western	N/A	0.36	50.00	-	-	N/A	4.61	244.00	11,452.32	33.00	-
13324	Eastern	N/A	6.08	223.00	14,738.82	125.00	N/A	1.13	22.00	153.03	1.00	-
13325	Eastern	N/A	0.07	32.00	727.92	11.00	N/A	0.02	3.00	39.92	1.00	-
13326	Eastern	N/A	0.62	4.00	2,824.65	131.00	N/A	3.31	120.00	-	-	-
13327	Eastern	N/A	2.13	16.00	3,508.43	15.00	N/A	0.55	10.00	-	-	-
13328	Dade City	N/A	5.34	493.00	15,016.63	95.00	N/A	1.83	73.00	6,395.68	138.00	-
13329	Dade City	N/A	6.88	474.00	44,526.97	536.00	N/A	3.29	184.00	7,990.32	122.00	-
13330	Dade City	N/A	35.11	1,276.00	50,085.42	231.00	N/A	21.00	549.00	600.30	4.00	-
13331	Dade City	N/A	27.51	1,150.00	73,164.97	1,500.00	N/A	4.38	165.00	3,757.95	25.00	-
13332	Western	N/A	1.82	74.00	2,334.60	23.00	N/A	11.14	1,687.00	10,677.27	83.00	-
13333	Western	N/A	1.07	92.00	2,219.88	27.00	N/A	3.42	371.00	98.15	2.00	-
13334	Western	N/A	3.66	529.00	45,530.32	431.00	N/A	2.58	299.00	63,112.72	179.00	-
13335	Western	N/A	1.38	33.00	75.48	1.00	N/A	1.80	27.00	-	-	-
13336	Western	N/A	2.45	56.00	53.32	1.00	N/A	2.94	205.00	3,435.78	15.00	-
13337	Western	N/A	2.76	237.00	342,690.40	794.00	N/A	5.61	2,112.00	159,605.13	1,768.00	-
13338	Western	N/A	2.97	128.00	1,112.32	15.00	N/A	2.39	243.00	1,393.33	8.00	-
13339	Western	N/A	0.48	3.00	-	-	N/A	5.34	1,273.00	-	-	-
13340	South Hillsborough	N/A	1.41	28.00	3,689.17	29.00	N/A	9.32	1,274.00	5,593.00	14.00	-
13341	South Hillsborough	N/A	3.61	99.00	3,407.18	33.00	N/A	25.84	2,263.00	241.98	1.00	-
13342	South Hillsborough	N/A	7.94	368.00	66,858.68	164.00	N/A	9.58	1,007.00	32,035.15	147.00	-
13343	South Hillsborough	N/A	2.16	57.00	38,709.18	391.00	N/A	11.36	1,349.00	544.65	9.00	-
13344	South Hillsborough	N/A	0.53	17.00	103.40	3.00	N/A	1.43	475.00	-	-	-
13346	South Hillsborough	N/A	0.70	9.00	-	-	N/A	10.12	900.00	91,175.12	764.00	-
13348	Central	N/A	3.55	531.00	31,247.98	174.00	N/A	7.50	1,977.00	14,473.40	54.00	-
13349	Central	N/A	0.05	-	550.23	2.00	N/A	0.10	3.00	-	-	-
13350	Central	N/A	0.03	21.00	2,624.68	41.00	N/A	1.85	386.00	2,189.85	72.00	-
13351	Central	N/A	2.27	388.00	9,213.50	120.00	N/A	7.27	1,737.00	19,805.32	164.00	-
13352	Central	N/A	0.64	102.00	25,394.87	178.00	N/A	5.98	1,684.00	-	-	-
13353	Central	N/A		-	-	-	N/A	0.85	78.00	-	-	-
13354	Central	N/A	1.15	12.00	5,529.47	82.00	N/A	8.48	1,770.00	15,599.37	75.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	1.52	1.33	-	-	-	0.19	8.00	-	-	-24.86%	1.36
-	Yes	3.98	0.10	-	-	-	3.88	32.00	25,320.45	452.00	-50.79%	2.5
-	Yes	0.58	0.11	-	-	-	0.47	7.00	2,347.27	352.00	-84.78%	0.91
-	Yes	1.76	0.37	-	-	-	1.39	5.00	9,914.67	130.00	-28.20%	5.5
-	Yes	0.61	0.07	-	-	-	0.54	4.00	-	-	-27.49%	2.4
-	Yes	1.85	0.07	-	-	-	1.78	50.00	48,322.70	551.00	7.76%	3.61
-	Yes	3.06	0.06	-	-	-	3.00	118.00	92,690.88	3,794.00	8.01%	4.99
-	Yes	5.72	0.51	-	-	-	5.21	164.00	10,971.25	1,965.00	4.02%	6.99
-	Yes	3.99	0.11	-	-	-	3.88	85.00	-	-	12.84%	5.01
-	Yes	1.88	0.06	-	-	-	1.82	67.00	-	-	5.96%	5.33
-	Yes	2.26	0.19	-	-	-	2.07	84.00	40,461.67	550.00	-8.10%	3.97
-	Yes	2.39	0.31	-	-	-	2.08	78.00	-	-	14.63%	6.74
-	Yes	2.14	0.92	-	-	-	1.22	7.00	-	-	-17.71%	4.09
-	Yes	1.50	0.12	-	-	-	1.38	5.00	-	-	4.01%	5.71
-	Yes	2.69	0.16	-	-	-	2.53	172.00	-	-	2.60%	6.72
-	Yes	4.01	0.27	-	-	-	3.74	34.00	-	-	38.97%	6.99
-	Yes	1.62	1.22	1.00	-	-	0.40	-	-	-	-4.50%	7.42
-	Yes	4.44	1.06	-	-	-	3.38	18.00	-	-	-6.19%	9.54
-	Yes	6.09	2.73	9.00	-	-	3.36	33.00	-	-	170.95%	9.7
-	Yes	5.40	0.31	-	-	-	5.09	42.00	126,544.93	1,410.00	-18.02%	6.28
-	Yes	4.76	2.91	-	-	-	1.85	5.00	-	-	-8.76%	6.77
-	Yes	2.16	0.83	-	-	-	1.33	3.00	-	-	-72.55%	2.77
-	Yes	5.13	2.37	-	-	-	2.76	25.00	-	-	-33.91%	6.9
-	Yes	2.85	0.35	-	-	-	2.50	214.00	-	-	6.30%	7.25
-	Yes	1.64	0.72	-	-	-	0.92	10.00	-	-	0.87%	2.31
-	Yes	0.68	0.39	-	-	-	0.29	6.00	-	-	20.60%	4.04
-	Yes	2.84	1.14	-	-	-	1.70	54.00	-	-	14.23%	6.34
-	Yes	2.09	0.93	-	-	-	1.16	43.00	-	-	1.59%	4.46
-	Yes	2.58	2.58	-	-	-	-	-	-	-	50.00%	1.92
-	Yes	2.42	0.08	-	-	-	2.34	54.00	116,790.35	3,662.00	26.35%	9.11

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13355	Central	N/A		-	-	-	N/A	0.06	2.00	-	-	-
13356	Plant City	N/A		-	-	-	N/A	-	-	-	-	-
13358	Western	N/A	4.26	955.00	12,177.38	61.00	N/A	1.52	590.00	677.45	12.00	-
13359	Western	N/A	6.03	521.00	155,439.00	1,688.00	N/A	4.99	291.00	788.05	6.00	-
13360	Western	N/A	0.04	10.00	-	-	N/A	0.08	47.00	-	-	-
13362	Central	N/A		-	-	-	N/A	0.82	233.00	10,817.00	30.00	-
13363	Central	N/A		-	-	-	N/A	0.01	-	-	-	-
13364	Central	N/A		-	61.20	54.00	N/A	0.48	300.00	-	-	-
13365	Central	N/A	2.04	345.00	25,660.28	324.00	N/A	8.07	935.00	29,956.03	161.00	-
13366	Central	N/A		-	-	-	N/A	0.53	5.00	192.72	2.00	-
13367	Central	N/A	0.01	-	53.62	1.00	N/A	0.72	232.00	1,254.53	2.00	-
13368	Central	N/A		-	-	-	N/A	-	-	-	-	-
13369	Central	N/A		-	-	-	N/A	-	-	-	-	-
13370	Winter Haven	N/A	8.17	780.00	43,696.58	371.00	N/A	4.95	503.00	4,397.97	55.00	-
13371	Winter Haven	N/A	7.21	451.00	33,624.00	231.00	N/A	9.65	930.00	1,992.52	12.00	-
13372	Winter Haven	N/A	2.34	237.00	1,604.78	22.00	N/A	1.20	54.00	-	-	-
13373	Winter Haven	N/A	14.10	1,448.00	108,028.38	1,536.00	N/A	1.28	205.00	234,491.60	1,825.00	-
13375	Western	N/A		-	-	-	N/A	0.05	-	-	-	-
13376	Western	N/A		-	-	-	N/A	0.18	23.00	-	-	-
13377	Western	N/A	4.12	879.00	204,093.60	3,675.00	N/A	2.01	167.00	5,604.58	68.00	-
13378	Western	N/A		-	-	-	N/A	-	-	-	-	-
13379	Western	N/A		-	-	-	N/A	0.12	-	149.17	1.00	-
13380	Western	N/A		-	-	-	N/A	0.06	401.00	-	-	-
13381	Western	N/A		-	-	-	N/A	0.15	2.00	-	-	-
13382	Western	N/A		-	-	-	N/A	0.19	-	-	-	-
13383	Western	N/A		-	-	-	N/A	0.88	9.00	-	-	-
13384	Western	N/A		-	-	-	N/A	0.01	8.00	-	-	-
13385	Western	N/A		-	-	-	N/A	-	-	-	-	-
13388	Plant City	N/A	16.97	482.00	6,554.22	72.00	N/A	8.67	193.00	343.10	2.00	-
13389	Plant City	N/A	16.81	910.00	23,732.68	176.00	N/A	7.07	143.00	47.90	1.00	-
13390	Plant City	N/A	26.88	974.00	80,766.67	1,500.00	N/A	19.53	574.00	32,868.63	219.00	-
13391	Plant City	N/A	48.01	1,148.00	60,022.20	1,049.00	N/A	8.72	390.00	170,547.95	1,908.00	-
13397	Central	N/A	0.28	55.00	-	-	N/A	0.34	48.00	-	-	-
13398	Central	N/A	0.47	13.00	1,368.60	36.00	N/A	1.33	1,834.00	1,115.93	4.00	-
13399	Central	N/A	0.74	41.00	195.30	2.00	N/A	0.11	16.00	28,289.03	185.00	-
13400	Central	N/A	1.90	117.00	2,795.53	35.00	N/A	2.08	2,094.00	6,308.83	17.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	1.02	0.74	-	-	-	0.28	2.00	-	-	-53.68%	3.08
-	Yes	-	-	-	-	-	-	-	-	-	0.00%	0
-	Yes	2.56	0.77	-	-	-	1.79	186.00	-	-	6.60%	9.05
-	Yes	3.49	1.41	-	-	-	2.08	83.00	-	-	-3.68%	5.76
-	Yes	1.66	0.81	-	-	-	0.85	4.00	-	-	9.09%	0.12
-	Yes	0.40	0.08	-	-	-	0.32	1.00	-	-	-69.30%	2.02
-	Yes	1.03	0.97	-	281.60	2.00	0.06	-	-	-	100.00%	2.1
-	Yes	0.39	0.09	-	-	-	0.30	2.00	-	-	3.30%	0.94
-	Yes	5.55	2.00	-	-	-	3.55	15.00	86,228.43	1,181.00	15.20%	7.35
-	Yes	1.23	0.82	-	-	-	0.41	4.00	-	-	-5.27%	5.93
-	Yes	1.51	0.76	-	5,578.30	211.00	0.75	1.00	-	-	338.56%	6.71
-	Yes	0.09	0.09	-	-	-	-	-	-	-	59.29%	4.03
-	Yes	0.15	0.15	-	-	-	-	1.00	-	-	-40.31%	2.71
-	Yes	3.04	0.18	-	-	-	2.86	181.00	-	-	42.86%	7.3
-	Yes	2.58	0.12	6.00	-	-	2.46	51.00	45,224.80	1,314.00	21.47%	5.94
-	Yes	1.31	0.11	-	-	-	1.20	21.00	13,566.00	315.00	9.65%	6.25
-	Yes	3.97	0.19	-	-	-	3.78	185.00	69,641.55	2,558.00	-32.37%	6.54
-	Yes	0.87	0.87	-	-	-	-	-	-	-	24.68%	1.92
-	Yes	1.03	1.03	-	-	-	-	-	-	-	-12.44%	1.69
-	Yes	3.02	0.79	-	-	-	2.23	72.00	-	-	-15.95%	4.9
-	Yes	0.01	0.01	-	-	-	-	-	-	-	0.00%	0
-	Yes	1.15	1.15	-	-	-	-	-	-	-	-29.79%	4.29
-	Yes	0.16	0.16	-	-	-	-	-	1,887.30	418.00	15.63%	0.37
-	Yes	0.19	0.19	-	-	-	-	-	-	-	-7.35%	0.63
-	Yes	1.19	1.19	-	-	-	-	-	-	-	27.56%	7.36
-	Yes	0.97	0.97	2.00	-	-	-	-	-	-	-17.11%	3.44
-	Yes	0.83	0.83	-	-	-	-	-	-	-	-25.94%	3.14
-	Yes	0.02	0.02	-	-	-	-	-	-	-	0.00%	0
-	Yes	5.02	0.85	-	-	-	4.17	105.00	-	-	17.01%	6.33
-	Yes	6.49	0.04	-	-	-	6.45	171.00	224,201.15	2,392.00	1.32%	5.37
-	Yes	6.51	0.34	-	-	-	6.17	223.00	-	-	10.08%	6.99
-	Yes	8.97	0.24	-	-	-	8.73	178.00	448,870.43	6,795.00	0.49%	8.13
-	Yes	1.07	0.11	-	-	-	0.96	62.00	-	-	70.66%	4.13
-	Yes	2.03	1.78	213.00	-	-	0.25	3.00	-	-	34.97%	5.21
-	Yes	0.47	0.38	-	-	-	0.09	2.00	-	-	361.62%	9.14
-	Yes	3.28	1.83	-	-	-	1.45	43.00	195,927.50	4,159.00	11.70%	4.39

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13405	Western	N/A	8.83	178.00	13,732.82	113.00	N/A	4.24	170.00	831.03	9.00	-
13406	Western	N/A	1.37	28.00	239.33	2.00	N/A	5.91	272.00	263.93	1.00	-
13410	Plant City	N/A	4.84	411.00	17,168.57	75.00	N/A	2.95	158.00	146.20	2.00	-
13412	Plant City	N/A	1.07	97.00	9,740.33	24.00	N/A	0.03	1.00	41.48	1.00	-
13414	Plant City	N/A	6.81	475.00	34,650.85	218.00	N/A	6.74	438.00	86,731.62	505.00	-
13417	Central	N/A	4.80	621.00	2,641.47	20.00	N/A	1.74	150.00	2,559.83	7.00	-
13418	Central	N/A	7.53	1,043.00	13,830.85	172.00	N/A	3.56	398.00	5,130.98	16.00	-
13419	Central	N/A	10.15	1,365.00	27,994.45	508.00	N/A	1.09	113.00	364.15	5.00	-
13420	Central	N/A	2.87	295.00	11,458.17	111.00	N/A	7.77	1,498.00	27,821.63	251.00	-
13422	Dade City	N/A	29.30	931.00	220,824.38	2,384.00	N/A	16.39	781.00	14,360.65	109.00	-
13423	Dade City	N/A	27.81	628.00	222,241.13	1,508.00	N/A	11.80	939.00	48.55	1.00	-
13425	Western	N/A	0.62	4.00	14,765.43	172.00	N/A	15.28	1,635.00	119,007.80	752.00	-
13426	Western	N/A	5.80	401.00	21,628.90	280.00	N/A	12.12	1,357.00	81,488.22	332.00	-
13427	Western	N/A	-	1.00	-	-	N/A	3.95	291.00	-	-	-
13428	Western	N/A	0.83	51.00	-	-	N/A	9.25	1,067.00	18,007.65	68.00	-
13430	Dade City	N/A	29.26	552.00	70,808.08	1,449.00	N/A	21.17	679.00	30,552.20	349.00	-
13431	Dade City	N/A	9.30	139.00	35,204.67	188.00	N/A	36.14	1,149.00	54.52	1.00	-
13432	Dade City	N/A	2.01	30.00	277,046.28	811.00	N/A	18.76	754.00	19,440.13	55.00	-
13433	Eastern	N/A	7.21	168.00	10,088.67	54.00	N/A	3.48	378.00	630.93	4.00	-
13434	Eastern	N/A	9.94	843.00	66,076.18	1,254.00	N/A	4.38	572.00	3.38	1.00	-
13435	Eastern	N/A	8.28	369.00	8,345.95	91.00	N/A	2.44	398.00	42,266.47	41.00	-
13436	Eastern	N/A	11.50	649.00	105,352.07	1,612.00	N/A	7.02	631.00	8,225.13	50.00	-
13438	South Hillsborough	N/A	1.00	101.00	48,044.03	342.00	N/A	22.84	2,981.00	43,357.32	224.00	-
13439	South Hillsborough	N/A	2.80	320.00	30,701.57	87.00	N/A	7.20	507.00	3,597.03	13.00	-
13440	South Hillsborough	N/A	2.03	1.00	68.83	1.00	N/A	21.48	2,042.00	1,199.10	3.00	-
13442	Winter Haven	N/A	9.91	374.00	199,809.40	1,653.00	N/A	20.75	1,594.00	21,656.62	74.00	-
13443	Winter Haven	N/A	9.68	618.00	34,929.88	238.00	N/A	9.83	971.00	27,230.60	231.00	-
13444	Winter Haven	N/A	3.98	327.00	11,436.87	50.00	N/A	1.67	213.00	3,129.00	21.00	-
13446	Western	N/A	-	3.00	-	-	N/A	0.72	87.00	-	-	-
13447	Western	N/A	1.60	53.00	12,691.57	133.00	N/A	1.00	46.00	384.07	2.00	-
13448	Western	N/A	1.32	95.00	2,052.37	13.00	N/A	2.60	755.00	140.68	2.00	-
13449	Western	N/A	2.57	204.00	12,406.77	138.00	N/A	1.67	187.00	7,808.77	66.00	-
13450	Western	N/A	0.61	18.00	1,074.45	17.00	N/A	1.91	65.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	2.96	0.54	-	-	-	2.42	25.00	-	-	7.83%	1.79
-	Yes	5.12	1.12	-	-	-	4.00	29.00	24,216.88	335.00	17.89%	5.6
-	Yes	4.46	1.22	-	-	-	3.24	157.00	239,017.07	1,436.00	-2.41%	4.85
-	Yes	0.63	0.05	-	-	-	0.58	20.00	-	-	2.11%	7.75
-	Yes	6.73	0.39	-	4,226.27	90.00	6.34	206.00	95,824.62	2,262.00	54.44%	8.17
-	Yes	3.24	0.26	-	-	-	2.98	170.00	3,281.93	895.00	14.37%	5.73
-	Yes	1.84	0.11	-	-	-	1.73	156.00	-	-	2.00%	6.11
-	Yes	1.59	0.14	-	-	-	1.45	142.00	-	-	6.30%	7.59
-	Yes	2.09	0.08	-	-	-	2.01	134.00	-	-	2.07%	6.42
-	Yes	9.12	0.88	-	-	-	8.24	105.00	26,517.40	1,829.00	29.86%	7.35
-	Yes	3.67	0.59	-	196.93	1.00	3.08	59.00	199,820.73	4,475.00	46.80%	6.43
-	Yes	2.51	0.92	-	-	-	1.59	6.00	-	-	-12.19%	6.7
-	Yes	1.15	0.07	-	-	-	1.08	15.00	-	-	3.59%	7.22
-	Yes	0.17	0.08	-	-	-	0.09	-	-	-	-11.45%	1.16
-	Yes	3.33	0.78	-	-	-	2.55	67.00	70,588.82	2,377.00	-8.65%	4.33
-	Yes	9.09	2.98	-	-	-	6.11	91.00	7,462.58	1,842.00	21.60%	5.91
-	Yes	12.72	7.88	-	-	-	4.84	25.00	-	-	-26.88%	4.08
-	Yes	3.41	1.07	-	77,947.65	1,651.00	2.34	39.00	7,039.35	915.00	17.72%	6.91
-	Yes	3.50	0.37	-	-	-	3.13	50.00	-	-	-12.28%	6.07
-	Yes	4.30	0.10	-	-	-	4.20	220.00	-	-	-4.05%	6.63
-	Yes	3.76	0.10	-	-	-	3.66	60.00	14,512.05	813.00	28.94%	5.97
-	Yes	4.65	0.12	-	-	-	4.53	196.00	203,093.28	2,954.00	10.52%	7.04
-	Yes	5.49	3.64	-	-	-	1.85	12.00	243,121.62	4,498.00	-2.47%	8.28
-	Yes	4.14	0.71	-	-	-	3.43	149.00	-	-	-23.73%	4.37
-	Yes	8.44	2.43	-	-	-	6.01	18.00	-	-	59.69%	10.38
-	Yes	2.12	0.13	-	-	-	1.99	49.00	7.07	2.00	-11.11%	8.56
-	Yes	3.18	0.05	-	-	-	3.13	73.00	-	-	4.11%	7.35
-	Yes	2.45	0.19	-	-	-	2.26	119.00	-	-	13.83%	3.54
-	Yes	1.25	1.25	-	-	-	-	-	-	-	-3.07%	2.84
-	Yes	0.94	0.12	-	-	-	0.82	23.00	5,140.80	357.00	-23.59%	5.15
-	Yes	1.15	0.68	-	-	-	0.47	16.00	-	-	2.63%	3.51
-	Yes	1.76	1.02	-	-	-	0.74	29.00	-	-	-4.58%	4.58
-	Yes	2.20	1.00	-	-	-	1.20	43.00	5,804.35	127.00	-3.81%	6.32

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13451	Western	N/A	0.14	-	-	-	N/A	2.37	93.00	-	-	-
13452	Western	N/A	0.20	15.00	-	-	N/A	0.19	5.00	-	-	-
13453	Western	N/A	0.14	3.00	193.28	1.00	N/A	4.51	29.00	20,382.75	21.00	-
13454	Eastern	N/A	3.21	198.00	22,259.77	208.00	N/A	14.28	1,263.00	951.87	4.00	-
13455	Eastern	N/A	2.90	205.00	2,170.93	38.00	N/A	3.23	759.00	13,400.28	103.00	-
13456	Eastern	N/A	1.65	150.00	543.72	21.00	N/A	3.18	890.00	-	-	-
13457	Eastern	N/A	2.21	106.00	39,975.45	345.00	N/A	5.39	684.00	3,310.45	7.00	-
13458	Eastern	N/A	15.30	470.00	14,191.83	82.00	N/A	4.75	116.00	36,316.58	312.00	-
13459	Eastern	N/A	10.20	396.00	208,949.05	2,188.00	N/A	16.21	556.00	1,054.68	11.00	-
13460	Eastern	N/A	35.63	805.00	132,155.00	1,131.00	N/A	6.58	342.00	66,886.32	1,118.00	-
13461	Eastern	N/A	24.74	901.00	281,202.68	3,752.00	N/A	12.09	369.00	432,844.13	829.00	-
13462	Plant City	N/A	3.05	181.00	1,113.28	18.00	N/A	12.43	1,050.00	6,675.90	35.00	-
13463	Plant City	N/A	4.93	478.00	108,836.37	244.00	N/A	1.88	130.00	284.38	1.00	-
13464	Plant City	N/A	4.92	343.00	11,482.27	24.00	N/A	4.95	294.00	28,727.87	377.00	-
13466	Central	N/A	0.60	21.00	170.93	1.00	N/A	0.24	8.00	-	-	-
13467	Central	N/A		-	-	-	N/A	0.24	4.00	-	-	-
13468	Central	N/A	3.17	355.00	4,779.20	47.00	N/A	8.55	1,083.00	125.77	1.00	-
13469	Central	N/A	1.99	95.00	2,233.57	28.00	N/A	8.51	717.00	2,451.60	24.00	-
13470	Winter Haven	N/A	31.47	1,735.00	93,120.43	488.00	N/A	8.62	615.00	6,851.10	59.00	-
13471	Winter Haven	N/A	4.28	425.00	14,316.65	53.00	N/A	5.18	524.00	2,452.13	8.00	-
13473	Winter Haven	N/A	7.28	566.00	5,056.32	16.00	N/A	10.75	596.00	14,747.32	41.00	-
13479	Winter Haven	N/A	6.75	454.00	2,341.58	624.00	N/A	5.40	274.00	209.22	3.00	-
13480	Western	N/A	0.75	7.00	5,847.45	63.00	N/A	11.50	1,599.00	128,931.92	444.00	-
13481	Western	N/A		-	87.77	1.00	N/A	6.66	755.00	19,857.40	113.00	-
13482	Western	N/A	0.91	9.00	8,111.02	73.00	N/A	15.60	1,576.00	19,414.20	98.00	-
13483	Western	N/A	2.81	357.00	1,265.60	8.00	N/A	15.28	1,368.00	152,910.03	1,176.00	-
13484	Western	N/A	0.18	3.00	-	-	N/A	11.26	1,446.00	6,018.57	49.00	-
13485	Western	N/A	2.90	125.00	466.05	5.00	N/A	7.59	767.00	646.93	9.00	-
13488	South Hillsborough	N/A	0.97	93.00	276,086.48	2,066.00	N/A	18.80	2,512.00	16,116.47	118.00	-
13489	South Hillsborough	N/A	6.16	252.00	274,577.35	1,552.00	N/A	3.88	194.00	4,211.62	40.00	-
13490	Western	N/A	0.93	126.00	267.45	1.00	N/A	7.13	713.00	22,653.20	86.00	-
13491	Western	N/A	0.60	52.00	2,993.65	45.00	N/A	12.44	1,660.00	14,794.30	199.00	-
13492	Western	N/A	5.23	560.00	39,756.03	486.00	N/A	2.59	230.00	220,765.08	412.00	-
13493	Western	N/A	2.10	259.00	9,031.55	37.00	N/A	3.50	321.00	6,739.30	50.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	1.60	0.73	-	-	-	0.87	17.00	10,159.65	107.00	-15.16%	3.75
-	Yes	0.75	0.14	-	-	-	0.61	21.00	-	-	-25.41%	0.91
-	Yes	5.13	4.66	1.00	-	-	0.47	10.00	20,098.10	151.00	-11.71%	6.03
-	Yes	2.28	0.22	-	-	-	2.06	42.00	97,029.33	1,582.00	-7.04%	6.47
-	Yes	2.09	0.13	-	-	-	1.96	37.00	-	-	12.50%	4.32
-	Yes	2.47	0.70	-	-	-	1.77	33.00	40,687.03	1,074.00	0.25%	4.01
-	Yes	2.63	0.21	-	-	-	2.42	74.00	71,443.40	665.00	3.44%	4.21
-	Yes	8.27	0.59	-	-	-	7.68	98.00	84,917.93	1,083.00	0.59%	3.43
-	Yes	7.96	3.28	-	-	-	4.68	102.00	949.07	718.00	15.94%	5.82
-	Yes	7.38	0.23	-	-	-	7.15	74.00	139,293.82	1,813.00	0.74%	5.41
-	Yes	8.17	0.06	-	-	-	8.11	109.00	283,887.50	7,216.00	-17.46%	6.24
-	Yes	3.94	0.33	-	-	-	3.61	73.00	-	-	-10.87%	8.61
-	Yes	4.08	0.02	-	-	-	4.06	116.00	-	-	-14.61%	1.52
-	Yes	4.40	0.11	-	-	-	4.29	116.00	25,954.85	411.00	-0.43%	2.31
-	Yes	0.96	0.12	-	-	-	0.84	24.00	-	-	-22.29%	3.59
-	Yes	1.90	1.88	-	-	-	0.02	-	-	-	21.36%	2.67
-	Yes	3.39	0.82	-	-	-	2.57	102.00	-	-	5.36%	4.72
-	Yes	4.04	0.49	-	-	-	3.55	50.00	-	-	21.52%	8.81
-	Yes	4.15	0.05	-	176.05	6.00	4.10	105.00	67,929.72	2,326.00	-3.19%	8.2
-	Yes	4.07	0.61	-	-	-	3.46	83.00	68,490.70	990.00	11.45%	4.38
-	Yes	4.47	0.22	-	-	-	4.25	118.00	-	-	37.43%	7.05
-	Yes	5.71	0.49	-	-	-	5.22	84.00	-	-	16.17%	6.61
-	Yes	0.96	0.02	-	-	-	0.94	6.00	-	-	3.49%	5.34
-	Yes	5.60	2.59	-	-	-	3.01	3.00	-	-	11.20%	4.07
-	Yes	2.61	0.77	-	-	-	1.84	5.00	239.72	2.00	-16.97%	6.75
-	Yes	1.97	1.69	-	-	-	0.28	3.00	124,757.83	1,114.00	5.96%	6.58
-	Yes	4.05	1.00	-	-	-	3.05	24.00	-	-	3.59%	5.2
-	Yes	2.57	0.19	-	-	-	2.38	20.00	-	-	4.20%	6.45
-	Yes	3.32	0.88	-	-	-	2.44	196.00	-	-	1.95%	6.79
-	Yes	4.55	0.80	-	-	-	3.75	73.00	-	-	9.28%	4.24
-	Yes	1.94	0.08	-	-	-	1.86	97.00	-	-	-11.42%	3.8
-	Yes	3.06	0.21	-	98.42	1.00	2.85	59.00	174,984.83	1,778.00	-3.79%	5.08
-	Yes	2.02	0.28	-	12.27	1.00	1.74	40.00	62,351.87	488.00	3.25%	6.03
-	Yes	2.10	0.49	-	82.88	1.00	1.61	97.00	77,817.23	1,414.00	-3.03%	2.88

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13494	South Hillsborough	N/A	0.33	2.00	-	-	N/A	3.62	415.00	5,590.95	46.00	-
13495	Eastern	N/A	2.62	202.00	7,672.08	86.00	N/A	10.31	1,195.00	-	-	-
13496	Central	N/A	1.09	73.00	3,720.03	7.00	N/A	1.04	396.00	-	-	-
13497	Central	N/A	0.11	3.00	318.10	6.00	N/A	1.38	138.00	18.00	2.00	-
13498	Central	N/A		-	-	-	N/A	0.44	-	-	-	-
13499	Central	N/A	0.04	2.00	-	-	N/A	0.60	47.00	-	-	-
13501	Eastern	N/A	0.92	17.00	4,032.17	54.00	N/A	1.96	63.00	1,694.35	23.00	-
13502	Eastern	N/A	6.26	409.00	33,354.12	4,754.00	N/A	11.88	2,111.00	23,878.07	76.00	-
13504	Eastern	N/A	0.13	6.00	-	-	N/A	1.25	12.00	-	-	-
13505	Eastern	N/A	2.66	147.00	1,280.97	12.00	N/A	5.82	887.00	138.98	3.00	-
13506	Eastern	N/A	2.54	87.00	6,881.55	77.00	N/A	4.98	594.00	124.78	1.00	-
13507	Eastern	N/A	0.05	-	90.50	2.00	N/A	1.88	35.00	-	-	-
13509	Eastern	N/A	1.66	86.00	6,116.08	135.00	N/A	7.67	961.00	5,010.42	25.00	-
13510	Western	N/A	3.02	251.00	28,930.98	184.00	N/A	10.43	1,309.00	33,108.32	231.00	-
13511	Western	N/A	3.14	360.00	6,852.13	50.00	N/A	4.56	337.00	8,259.27	51.00	-
13512	Western	N/A	3.50	430.00	9,537.23	100.00	N/A	8.22	1,359.00	31,063.53	98.00	-
13513	Western	N/A	0.85	26.00	45,535.12	232.00	N/A	1.50	217.00	-	-	-
13514	Western	N/A	0.74	106.00	259.30	2.00	N/A	5.63	584.00	7,727.68	62.00	-
13516	Western	N/A	3.75	465.00	16,172.47	74.00	N/A	5.30	387.00	88,941.48	366.00	-
13517	Western	N/A	4.08	430.00	23,592.67	166.00	N/A	3.49	1,076.00	44.00	1.00	-
13518	Western	N/A	0.28	25.00	-	-	N/A	0.20	3.00	-	-	-
13519	Western	N/A	0.62	33.00	-	-	N/A	0.12	89.00	-	-	-
13520	Western	N/A	0.70	80.00	3,643.20	22.00	N/A	4.27	459.00	83.88	2.00	-
13521	Western	N/A	0.01	-	-	-	N/A	1.87	24.00	-	-	-
13522	Western	N/A	8.77	1,090.00	211,910.28	1,329.00	N/A	3.03	413.00	355.87	3.00	-
13523	Western	N/A	4.59	519.00	18,680.72	123.00	N/A	1.88	1,136.00	13,686.97	187.00	-
13524	Western	N/A	0.97	122.00	-	-	N/A	1.29	101.00	20.17	1.00	-
13530	Western	N/A	5.41	873.00	28,446.17	85.00	N/A	-	-	-	-	-
13531	Western	N/A	2.07	47.00	1,261.80	8.00	N/A	5.24	182.00	2,928.87	12.00	-
13532	Western	N/A	4.26	338.00	6,579.95	64.00	N/A	1.33	76.00	4,627.90	154.00	-
13533	Western	N/A	2.06	230.00	56,656.55	1,716.00	N/A	9.85	1,644.00	39,447.67	372.00	-
13535	Western	N/A	3.73	211.00	25,723.93	311.00	N/A	19.09	1,964.00	85,396.57	468.00	-
13538	Western	N/A	0.21	5.00	996.33	19.00	N/A	14.02	919.00	15,394.38	123.00	-
13539	Western	N/A	0.62	10.00	-	-	N/A	13.02	1,126.00	109,018.78	351.00	-
13540	Western	N/A	0.20	4.00	2,443.47	56.00	N/A	6.74	699.00	4,164.83	8.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	2.57	0.97	-	-	-	1.60	7.00	-	-	42.48%	3.22
-	Yes	3.52	2.13	-	-	-	1.39	41.00	-	-	153.25%	5.85
-	Yes	1.92	0.09	-	-	-	1.83	12.00	-	-	-54.42%	2.01
-	Yes	3.51	2.41	-	-	-	1.10	4.00	-	-	27.72%	6.22
-	Yes	0.77	0.77	-	-	-	-	-	-	-	4.08%	5.1
-	Yes	3.31	1.68	-	-	-	1.63	2.00	-	-	20.93%	7.57
-	Yes	1.84	0.21	-	-	-	1.63	7.00	-	-	-7.72%	6.22
-	Yes	5.08	1.31	-	-	-	3.77	105.00	3,346.77	2,612.00	13.22%	9.42
-	Yes	2.12	1.30	-	-	-	0.82	5.00	-	-	-15.72%	3.7
-	Yes	3.30	1.36	-	-	-	1.94	62.00	43,585.45	1,091.00	1.04%	5.82
-	Yes	4.61	1.74	-	-	-	2.87	28.00	-	-	2.79%	5.15
-	Yes	1.69	1.38	-	-	-	0.31	2.00	640.90	34.00	12.82%	4.84
-	Yes	2.63	0.74	-	-	-	1.89	10.00	-	-	-49.65%	3.62
-	Yes	2.35	0.46	-	-	-	1.89	37.00	-	-	-0.99%	5.98
-	Yes	2.32	0.39	-	-	-	1.93	79.00	-	-	-3.85%	5.24
-	Yes	2.27	0.29	-	-	-	1.98	37.00	-	-	3.26%	6.01
-	Yes	0.95	0.56	-	9,802.80	168.00	0.39	9.00	7,418.50	111.00	-2.63%	4.07
-	Yes	3.79	0.32	-	-	-	3.47	43.00	-	-	0.00%	4.25
-	Yes	1.89	0.12	-	-	-	1.77	77.00	49,935.55	923.00	3.67%	5.09
-	Yes	1.87	0.07	-	-	-	1.80	33.00	184,424.50	2,210.00	3.25%	6.68
-	Yes	1.37	0.37	-	-	-	1.00	58.00	-	-	8.60%	4.67
-	Yes	1.08	0.02	-	-	-	1.06	62.00	-	-	19.32%	2.47
-	Yes	2.24	0.53	-	-	-	1.71	52.00	84,819.00	1,176.00	-2.31%	4.23
-	Yes	0.75	0.33	-	-	-	0.42	10.00	-	-	-2.15%	4.1
-	Yes	1.87	0.69	-	-	-	1.18	146.00	5,960.25	1,555.00	-14.35%	5.61
-	Yes	2.06	0.10	-	-	-	1.96	225.00	-	-	-11.21%	4.91
-	Yes	1.26	0.33	-	-	-	0.93	67.00	-	-	29.89%	9.17
-	Yes	0.85	0.18	-	-	-	0.67	-	-	-	4.92%	4.05
-	Yes	3.14	0.95	-	-	-	2.19	37.00	45,110.45	529.00	32.19%	5.38
-	Yes	1.93	0.04	-	-	-	1.89	58.00	-	-	3.35%	5.25
-	Yes	3.01	0.07	-	-	-	2.94	93.00	-	-	15.40%	6.52
-	Yes	2.16	0.08	-	-	-	2.08	100.00	-	-	1.10%	8.24
-	Yes	2.43	1.07	1.00	-	-	1.36	11.00	-	-	-0.77%	6.42
-	Yes	2.02	0.12	-	-	-	1.90	8.00	15,580.20	1,129.00	15.90%	5.54
-	Yes	2.04	0.16	-	-	-	1.88	4.00	-	-	-1.63%	2.42

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13541	Western	N/A		-	-	-	N/A	15.01	1,007.00	6,892.80	18.00	-
13544	Western	N/A	0.49	29.00	36.98	1.00	N/A	5.17	703.00	6,650.98	163.00	-
13546	Central	N/A	6.34	293.00	87.45	1.00	N/A	3.17	56.00	75.08	1.00	-
13547	Central	N/A	3.91	308.00	10,473.20	24.00	N/A	1.97	227.00	108.13	1.00	-
13548	Central	N/A		-	-	-	N/A	-	-	-	-	-
13549	Central	N/A		-	-	-	N/A	0.06	-	-	-	-
13551	Central	N/A		-	-	-	N/A	-	-	-	-	-
13552	Central	N/A	2.76	44.00	-	-	N/A	1.26	24.00	124.45	1.00	-
13553	Central	N/A		2.00	-	-	N/A	1.21	1.00	-	-	-
13554	Central	N/A		-	-	-	N/A	-	-	-	-	-
13560	Central	N/A		-	-	-	N/A	0.14	-	-	-	-
13561	Central	N/A		-	-	-	N/A	0.15	-	-	-	-
13562	Central	N/A		-	-	-	N/A	0.42	337.00	-	-	-
13563	Central	N/A		-	-	-	N/A	0.36	-	-	-	-
13564	Central	N/A		-	-	-	N/A	0.56	365.00	-	-	-
13565	Central	N/A		-	-	-	N/A	0.39	-	-	-	-
13566	Central	N/A		-	-	-	N/A	1.47	616.00	-	-	-
13567	Central	N/A		-	-	-	N/A	0.04	507.00	-	-	-
13572	Western	N/A	0.76	68.00	11,526.60	76.00	N/A	9.26	951.00	2,973.32	11.00	-
13573	Western	N/A	0.46	5.00	5,317.63	58.00	N/A	10.76	1,047.00	6,691.50	69.00	-
13574	Western	N/A	2.81	232.00	10,053.60	137.00	N/A	6.02	605.00	446.13	2.00	-
13575	Western	N/A	0.24	5.00	-	-	N/A	5.89	600.00	7,189.73	78.00	-
13576	Eastern	N/A	2.89	233.00	102,623.27	268.00	N/A	14.90	1,439.00	9,223.03	87.00	-
13577	Eastern	N/A	3.15	234.00	5,214.08	40.00	N/A	9.44	738.00	18,549.52	119.00	-
13579	Eastern	N/A	6.26	192.00	122,733.15	1,099.00	N/A	17.94	1,399.00	180,392.17	2,412.00	-
13582	Western	N/A	5.83	176.00	33,697.23	347.00	N/A	19.13	1,293.00	17,824.73	73.00	-
13583	Western	N/A	4.60	120.00	167.27	2.00	N/A	6.52	379.00	10,117.73	62.00	-
13584	Western	N/A	0.19	1.00	4,514.57	68.00	N/A	10.34	947.00	15,188.93	102.00	-
13585	Western	N/A	0.51	17.00	-	-	N/A	7.13	1,398.00	33,042.12	123.00	-
13586	Western	N/A	4.39	98.00	7,116.28	47.00	N/A	21.07	1,169.00	10,235.30	35.00	-
13587	Western	N/A	1.56	4.00	40,490.32	243.00	N/A	14.53	2,248.00	21,570.25	165.00	-
13589	Western	N/A	0.08	4.00	-	-	N/A	11.82	1,339.00	346.82	1.00	-
13590	Central	N/A	2.72	320.00	47,621.52	820.00	N/A	4.04	1,452.00	5,712.43	41.00	-
13591	Central	N/A	7.95	1,051.00	12,508.53	85.00	N/A	2.44	616.00	6,929.95	45.00	-
13592	Central	N/A	5.90	979.00	34,319.47	172.00	N/A	3.28	208.00	129.27	2.00	-
13593	Central	N/A	4.55	504.00	8,929.98	116.00	N/A	2.41	188.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	1.54	1.54	-	-	-	-	-	-	-	-11.37%	4.91
-	Yes	2.09	0.12	-	-	-	1.97	11.00	-	-	-3.01%	2.9
-	Yes	5.36	0.96	1.00	-	-	4.40	73.00	-	-	8.72%	8.73
-	Yes	3.46	0.15	-	-	-	3.31	75.00	-	-	7.63%	4.23
-	Yes	-	-	-	-	-	-	-	-	-	0.00%	0
-	Yes	-	-	-	-	-	-	-	-	-	0.00%	0
-	Yes	0.37	0.11	-	-	-	0.26	-	-	-	3.77%	0.55
-	Yes	2.22	0.34	-	-	-	1.88	10.00	3,939.63	152.00	36.30%	5.82
-	Yes	0.60	0.60	-	-	-	-	-	-	-	-34.67%	3.09
-	Yes	0.34	0.34	-	-	-	-	-	-	-	149.62%	6.49
-	Yes	2.34	2.34	-	-	-	-	-	-	-	-24.69%	1.83
-	Yes	3.98	3.98	-	-	-	-	-	-	-	-21.81%	2.33
-	Yes	3.13	3.13	-	-	-	-	-	-	-	-0.29%	3.4
-	Yes	2.24	2.24	-	-	-	-	-	-	-	19.65%	2.07
-	Yes	2.16	2.16	-	536.97	362.00	-	-	-	-	-3.06%	3.49
-	Yes	2.73	2.73	-	-	-	-	-	-	-	-16.36%	2.3
-	Yes	1.14	1.14	-	-	-	-	-	-	-	100.00%	1.32
-	Yes	1.11	1.11	-	-	-	-	-	-	-	33.78%	0.99
-	Yes	1.13	0.21	-	-	-	0.92	7.00	-	-	1.57%	3.87
-	Yes	1.02	0.27	-	-	-	0.75	5.00	-	-	11.53%	4.74
-	Yes	1.78	0.04	-	-	-	1.74	54.00	103,784.25	1,730.00	-3.52%	3.84
-	Yes	1.16	0.24	-	-	-	0.92	18.00	-	-	-2.31%	2.54
-	Yes	4.80	0.40	-	-	-	4.40	137.00	141,038.33	1,612.00	5.19%	8.1
-	Yes	3.35	0.02	-	1,736.17	1,063.00	3.33	87.00	-	-	10.80%	5.13
-	Yes	3.36	0.15	-	-	-	3.21	82.00	-	-	4.29%	8.26
-	Yes	5.81	2.05	1.00	-	-	3.76	36.00	443,511.40	1,504.00	10.00%	10.34
-	Yes	3.10	0.22	-	-	-	2.88	10.00	-	-	-4.17%	5.29
-	Yes	2.14	0.05	-	-	-	2.09	7.00	118,445.97	1,865.00	-8.38%	4.48
-	Yes	1.65	0.44	-	-	-	1.21	9.00	-	-	-6.41%	5.55
-	Yes	3.50	0.86	-	-	-	2.64	32.00	-	-	4.32%	7.24
-	Yes	2.84	1.05	-	-	-	1.79	7.00	-	-	13.56%	8.04
-	Yes	5.04	2.20	-	-	-	2.84	9.00	-	-	19.83%	7.13
-	Yes	3.29	0.03	-	-	-	3.26	181.00	-	-	80.54%	7.33
-	Yes	3.76	0.12	-	-	-	3.64	264.00	-	-	-45.91%	6.28
-	Yes	1.98	0.16	-	-	-	1.82	107.00	-	-	-6.10%	5.08
-	Yes	2.58	0.24	-	-	-	2.34	117.00	36,026.32	763.00	0.48%	4.2

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13598	Central	N/A		-	-	-	N/A	0.02	-	-	-	-
13600	Central	N/A	6.18	773.00	33.67	1.00	N/A	2.52	604.00	14,876.47	25.00	-
13601	Central	N/A	3.36	392.00	30,112.05	290.00	N/A	9.78	1,213.00	53,951.00	882.00	-
13602	Central	N/A		-	-	-	N/A	-	-	-	-	-
13605	Western	N/A	2.61	234.00	13,275.80	65.00	N/A	4.29	425.00	320.87	2.00	-
13606	Western	N/A	0.75	25.00	-	-	N/A	0.39	183.00	-	-	-
13607	Western	N/A		-	-	-	N/A	-	-	-	-	-
13608	Western	N/A		-	-	-	N/A	-	2.00	-	-	-
13610	Western	N/A	5.60	630.00	190,463.82	1,021.00	N/A	2.09	667.00	3,830.55	62.00	-
13611	Western	N/A	3.31	344.00	28,284.30	106.00	N/A	0.84	513.00	625.63	1.00	-
13612	Western	N/A	7.27	489.00	41,699.57	361.00	N/A	7.56	540.00	35,260.42	205.00	-
13613	Western	N/A	5.57	737.00	12,164.82	159.00	N/A	0.93	294.00	728.77	4.00	-
13614	Western	N/A		-	-	-	N/A	-	-	-	-	-
13621	Western	N/A	15.60	420.00	3,600.90	41.00	N/A	4.95	83.00	172.42	2.00	-
13622	Western	N/A	19.10	751.00	108,046.40	1,020.00	N/A	16.51	709.00	31,975.02	136.00	-
13624	Western	N/A	15.67	368.00	123,998.52	884.00	N/A	11.27	297.00	18,810.45	252.00	-
13630	Central	N/A	5.74	678.00	139,138.83	1,090.00	N/A	1.73	299.00	1,962.82	35.00	-
13631	Central	N/A	5.47	352.00	21,396.48	244.00	N/A	11.08	1,009.00	20,573.08	105.00	-
13632	Central	N/A	2.66	244.00	9,703.85	48.00	N/A	3.80	241.00	-	-	-
13633	Central	N/A	1.77	96.00	1,481.13	10.00	N/A	8.31	914.00	2,762.80	11.00	-
13635	Western	N/A	0.05	-	103.60	2.00	N/A	2.58	25.00	-	-	-
13636	Western	N/A	0.04	1.00	-	-	N/A	0.54	7.00	-	-	-
13637	Western	N/A	0.60	57.00	47.45	1.00	N/A	1.44	103.00	-	-	-
13638	Western	N/A	2.11	206.00	1,520.68	12.00	N/A	1.14	132.00	2,164.62	26.00	-
13639	Western	N/A		-	-	-	N/A	-	-	-	-	-
13640	Western	N/A		-	-	-	N/A	2.09	9.00	-	-	-
13641	Western	N/A		-	-	-	N/A	1.23	18.00	-	-	-
13642	Western	N/A		-	-	-	N/A	0.25	5.00	-	-	-
13643	Western	N/A		-	-	-	N/A	1.58	10.00	-	-	-
13645	South Hillsborough	N/A	1.57	19.00	-	-	N/A	20.29	1,946.00	242.25	2.00	-
13646	South Hillsborough	N/A	0.16	1.00	100,167.47	595.00	N/A	17.81	1,711.00	4,343.47	19.00	-
13647	South Hillsborough	N/A	1.28	70.00	-	-	N/A	22.41	1,903.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	1.82	1.82	-	-	-	-	-	-	-	2.61%	1.18
-	Yes	1.52	0.14	-	-	-	1.38	58.00	-	-	1.31%	6.98
-	Yes	2.12	0.11	-	-	-	2.01	110.00	-	-	-1.96%	5
-	Yes	0.87	0.87	-	-	-	-	-	-	-	8.98%	2.79
-	Yes	0.88	0.20	-	-	-	0.68	19.00	-	-	2.83%	2.54
-	Yes	1.44	0.05	-	-	-	1.39	69.00	-	-	-15.89%	0.9
-	Yes	-	-	-	-	-	-	-	-	-	-1.12%	8.86
-	Yes	-	-	-	-	-	-	-	-	-	2.06%	18.79
-	Yes	1.53	0.45	-	18.73	1.00	1.08	49.00	431,232.98	8,520.00	-5.06%	5.63
-	Yes	0.90	0.16	-	-	-	0.74	17.00	-	-	31.97%	3.22
-	Yes	1.37	0.14	-	239.92	5.00	1.23	44.00	51,619.95	2,286.00	-23.70%	3.96
-	Yes	1.29	0.26	-	-	-	1.03	73.00	10,884.45	1,103.00	-5.80%	3.57
-	Yes	-	-	-	-	-	-	-	-	-	0.00%	0
-	Yes	2.96	0.02	-	-	-	2.94	28.00	18,124.60	1,057.00	0.63%	3.17
-	Yes	2.02	0.06	-	-	-	1.96	8.00	111,683.43	4,372.00	5.23%	9.66
-	Yes	3.87	0.04	-	-	-	3.83	51.00	35,270.25	713.00	9.20%	4.39
-	Yes	3.68	0.36	-	-	-	3.32	231.00	-	-	4.52%	6.24
-	Yes	2.29	0.32	-	-	-	1.97	91.00	17,419.55	1,452.00	-0.56%	7.11
-	Yes	2.15	0.09	-	-	-	2.06	99.00	-	-	-21.74%	2.16
-	Yes	3.69	0.31	-	-	-	3.38	119.00	41,174.07	1,126.00	-6.79%	5.77
-	Yes	2.79	1.37	-	-	-	1.42	18.00	-	-	-18.16%	7.03
-	Yes	1.87	0.73	-	-	-	1.14	3.00	-	-	-9.29%	4.59
-	Yes	3.16	1.64	-	-	-	1.52	22.00	-	-	71.76%	2.92
-	Yes	2.12	0.51	-	-	-	1.61	44.00	-	-	-4.90%	2.33
-	Yes	0.42	0.42	-	-	-	-	-	-	-	0.00%	0
-	Yes	3.39	3.39	-	654.80	8.00	-	-	-	-	-43.06%	4.84
-	Yes	3.60	3.60	-	-	-	-	-	335.37	20.00	19.53%	2.02
-	Yes	3.25	3.25	-	-	-	-	-	266.10	3.00	-19.11%	2.54
-	Yes	6.76	6.76	-	-	-	-	-	1,732.00	12.00	-18.71%	2.26
-	Yes	5.22	2.81	-	-	-	2.41	19.00	-	-	-32.25%	7.73
-	Yes	4.73	1.59	-	-	-	3.14	8.00	-	-	14.97%	7.91
-	Yes	4.73	3.96	-	-	-	0.77	15.00	-	-	2.16%	9.95

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13648	South Hillsborough	N/A	14.65	368.00	50,489.12	688.00	N/A	18.74	1,033.00	15,571.97	82.00	-
13649	South Hillsborough	N/A	5.05	327.00	4,603.28	42.00	N/A	2.68	265.00	40.90	1.00	-
13650	South Hillsborough	N/A		-	-	-	N/A	11.09	1,051.00	36,942.75	351.00	-
13651	South Hillsborough	N/A	3.22	154.00	7,015.52	48.00	N/A	14.60	1,661.00	874,953.87	608.00	-
13652	South Hillsborough	N/A	3.50	194.00	2,263.27	68.00	N/A	11.37	844.00	280.28	1.00	-
13655	Plant City	N/A	3.15	167.00	163.98	4.00	N/A	14.34	810.00	2,798.27	8.00	-
13656	Plant City	N/A	34.92	1,022.00	94,057.35	591.00	N/A	6.02	287.00	386,960.38	955.00	-
13657	Plant City	N/A	15.40	448.00	21,990.83	95.00	N/A	5.86	285.00	4,723.57	18.00	-
13659	Winter Haven	N/A	3.68	96.00	10,086.27	80.00	N/A	19.96	1,377.00	25,017.45	146.00	-
13660	Winter Haven	N/A	1.42	33.00	86.03	1.00	N/A	13.15	993.00	91,125.58	300.00	-
13661	Winter Haven	N/A	6.73	342.00	15,169.00	436.00	N/A	23.52	1,630.00	12,521.30	78.00	-
13668	Plant City	N/A	9.20	293.00	9,309.50	134.00	N/A	11.48	806.00	8,957.02	35.00	-
13669	Western	N/A	1.36	100.00	941.17	2.00	N/A	14.66	1,210.00	2,157.73	44.00	-
13670	Western	N/A	0.44	2.00	346.82	1.00	N/A	8.72	617.00	12,893.48	84.00	-
13671	Western	N/A	0.10	-	2,612.33	34.00	N/A	13.20	1,719.00	27,570.07	178.00	-
13672	Western	N/A	1.05	63.00	9,116.92	80.00	N/A	20.06	2,758.00	86,250.48	259.00	-
13673	Western	N/A	0.07	-	3,593.20	40.00	N/A	14.63	1,204.00	4,299.45	15.00	-
13674	Western	N/A	0.17	1.00	-	-	N/A	10.45	1,073.00	-	-	-
13677	Western	N/A	4.74	93.00	17,160.23	461.00	N/A	21.73	1,073.00	3,403.28	7.00	-
13678	Western	N/A	1.87	65.00	8,199.68	67.00	N/A	22.49	2,443.00	9,043.12	121.00	-
13679	Western	N/A	9.21	341.00	60,185.92	1,303.00	N/A	17.43	886.00	1,591.20	15.00	-
13685	Eastern	N/A	2.42	111.00	5,079.82	96.00	N/A	17.91	1,282.00	16,652.03	142.00	-
13686	Eastern	N/A	3.11	96.00	14,904.83	114.00	N/A	16.48	1,233.00	751.80	3.00	-
13687	Eastern	N/A	15.28	534.00	18,733.98	197.00	N/A	14.43	1,021.00	90,406.17	1,518.00	-
13690	Eastern	N/A	1.75	81.00	61,424.02	416.00	N/A	11.54	769.00	4,174.17	9.00	-
13691	Eastern	N/A	0.89	28.00	13,856.62	89.00	N/A	10.99	878.00	-	-	-
13692	Eastern	N/A	1.09	19.00	544.65	4.00	N/A	6.68	633.00	18,194.12	157.00	-
13693	Eastern	N/A	4.78	189.00	104,514.25	450.00	N/A	7.50	624.00	44,379.63	274.00	-
13695	Winter Haven	N/A	3.74	389.00	13,587.63	124.00	N/A	2.80	402.00	18,207.00	135.00	-
13696	Winter Haven	N/A	13.46	1,283.00	113,032.73	1,368.00	N/A	1.95	108.00	56,861.25	521.00	-
13697	Winter Haven	N/A	19.36	983.00	47,543.62	529.00	N/A	17.52	908.00	53.98	1.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	8.96	1.94	-	-	-	7.02	104.00	-	-	17.99%	7.28
-	Yes	1.72	0.12	7.00	-	-	1.60	44.00	-	-	10.67%	2.8
-	Yes	3.45	2.22	-	-	-	1.23	2.00	20,852.00	1,040.00	-2.00%	4.41
-	Yes	6.50	1.75	-	-	-	4.75	48.00	-	-	9.52%	8.97
-	Yes	3.51	1.96	-	-	-	1.55	15.00	-	-	-34.58%	4.39
-	Yes	3.23	0.09	-	-	-	3.14	71.00	-	-	-3.11%	4.05
-	Yes	8.13	0.35	-	-	-	7.78	126.00	-	-	-20.11%	7.11
-	Yes	6.00	0.18	-	-	-	5.82	132.00	-	-	-100.00%	0
-	Yes	5.34	1.76	-	-	-	3.58	83.00	-	-	45.53%	7
-	Yes	6.98	4.01	-	-	-	2.97	5.00	-	-	108.85%	5.43
-	Yes	5.56	1.98	-	-	-	3.58	39.00	12,224.40	2,004.00	18.90%	9.94
-	Yes	2.05	0.95	16.00	-	-	1.10	22.00	-	-	-100.00%	0
-	Yes	2.61	0.61	9.00	-	-	2.00	56.00	-	-	8.47%	5.25
-	Yes	0.90	0.11	-	-	-	0.79	1.00	-	-	-11.95%	2.58
-	Yes	3.05	1.67	-	-	-	1.38	20.00	-	-	-0.67%	5.95
-	Yes	4.36	0.83	-	-	-	3.53	15.00	-	-	-13.53%	7.22
-	Yes	4.02	1.95	-	-	-	2.07	10.00	-	-	20.42%	5.78
-	Yes	4.69	1.81	-	-	-	2.88	9.00	-	-	-17.68%	4.89
-	Yes	7.79	5.06	-	-	-	2.73	18.00	207,563.93	2,428.00	28.19%	9.05
-	Yes	3.74	0.92	-	-	-	2.82	13.00	229.60	6.00	5.65%	7.86
-	Yes	4.82	0.48	-	-	-	4.34	77.00	-	-	22.44%	9.44
-	Yes	4.66	1.91	-	-	-	2.75	61.00	95,742.00	1,458.00	-1.43%	8.28
-	Yes	2.77	0.12	-	-	-	2.65	58.00	-	-	-0.12%	8.02
-	Yes	7.23	0.23	10.00	-	-	7.00	190.00	12,491.70	234.00	5.00%	8.4
-	Yes	2.77	1.21	-	-	-	1.56	26.00	-	-	-9.12%	5.88
-	Yes	3.27	0.73	-	-	-	2.54	14.00	-	-	1.65%	5.56
-	Yes	2.15	0.11	-	-	-	2.04	14.00	-	-	-14.42%	2.67
-	Yes	3.69	0.99	-	-	-	2.70	63.00	119,020.60	876.00	-6.07%	5.11
-	Yes	0.80	0.03	-	-	-	0.77	19.00	143,476.87	2,144.00	54.55%	10.2
-	Yes	4.70	0.28	-	450,765.60	7,733.00	4.42	188.00	-	-	10.61%	9.38
-	Yes	5.91	0.62	-	-	-	5.29	142.00	4,101.30	882.00	614.00%	3.57

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13698	Winter Haven	N/A	16.88	1,041.00	40,090.07	175.00	N/A	3.89	24.00	4,828.82	62.00	-
13699	Winter Haven	N/A	4.51	285.00	14,223.45	235.00	N/A	12.81	1,018.00	-	-	-
13705	Eastern	N/A	8.41	483.00	44,094.08	242.00	N/A	11.59	969.00	6,789.48	59.00	-
13706	Eastern	N/A	3.78	185.00	18,887.62	250.00	N/A	11.71	1,505.00	15,809.15	51.00	-
13707	Eastern	N/A	1.19	57.00	3,458.63	72.00	N/A	8.39	1,097.00	4,891.42	30.00	-
13708	Eastern	N/A	1.09	45.00	2,349.60	5.00	N/A	14.49	2,205.00	202,401.40	2,242.00	-
13709	Eastern	N/A	6.20	541.00	32,329.97	173.00	N/A	8.17	609.00	263.00	4.00	-
13710	Eastern	N/A	6.13	296.00	53,299.43	2,045.00	N/A	16.92	2,370.00	81,862.62	412.00	-
13711	Eastern	N/A	1.24	12.00	929.02	14.00	N/A	17.76	2,717.00	149.77	1.00	-
13712	Eastern	N/A	8.52	417.00	11,364.68	55.00	N/A	6.29	556.00	288.50	2.00	-
13713	Central	N/A		-	-	-	N/A	0.04	1.00	-	-	-
13714	Central	N/A	0.47	7.00	73,063.87	748.00	N/A	15.74	3,333.00	4,446.00	14.00	-
13715	Central	N/A	0.61	5.00	9,600.00	61.00	N/A	10.73	3,444.00	123,753.45	273.00	-
13716	Central	N/A	0.02	-	-	-	N/A	7.11	578.00	3,321.00	60.00	-
13717	Central	N/A	1.86	6.00	-	-	N/A	8.86	539.00	763.12	6.00	-
13718	Central	N/A	0.01	-	8,043.83	47.00	N/A	18.80	1,160.00	2,720.25	5.00	-
13719	Central	N/A	0.23	-	28,401.67	200.00	N/A	26.58	1,657.00	50,368.33	268.00	-
13722	Plant City	N/A	9.71	418.00	3,738.50	28.00	N/A	2.87	80.00	2,971.38	55.00	-
13723	Plant City	N/A	14.54	397.00	210,634.30	2,328.00	N/A	4.34	209.00	2,212.65	114.00	-
13724	Plant City	N/A	15.16	430.00	87,699.52	1,098.00	N/A	44.79	880.00	5,307.55	14.00	-
13729	Eastern	N/A	2.03	37.00	31,935.00	289.00	N/A	10.72	928.00	40,915.05	181.00	-
13731	Eastern	N/A	0.10	1.00	14,053.60	176.00	N/A	11.40	895.00	31,906.98	115.00	-
13732	Eastern	N/A	0.10	21.00	36,677.77	193.00	N/A	16.59	1,249.00	24,739.60	96.00	-
13733	Eastern	N/A	1.06	2.00	17,315.03	109.00	N/A	21.39	1,529.00	3,803.57	22.00	-
13737	Western	N/A	2.48	333.00	1,072.47	20.00	N/A	3.17	271.00	7,234.22	28.00	-
13738	Western	N/A	0.88	58.00	641.40	4.00	N/A	3.86	590.00	-	-	-
13739	Western	N/A	0.83	44.00	681.25	9.00	N/A	0.83	121.00	-	-	-
13740	Western	N/A	10.49	1,332.00	6,128.17	65.00	N/A	0.19	18.00	-	-	-
13741	Western	N/A	0.04	1.00	-	-	N/A	0.52	372.00	-	-	-
13742	Western	N/A		-	-	-	N/A	0.35	83.00	-	-	-
13743	Western	N/A	2.67	330.00	791.17	8.00	N/A	1.00	1,325.00	64,490.50	1,445.00	-
13745	Western	N/A	0.63	26.00	21,427.62	215.00	N/A	16.49	1,802.00	41,612.97	277.00	-
13747	Western	N/A	1.35	127.00	9,294.22	105.00	N/A	2.65	479.00	1,322.03	34.00	-
13748	Western	N/A	4.33	364.00	66,419.60	838.00	N/A	7.94	761.00	22,051.27	133.00	-
13749	Western	N/A	1.75	202.00	165,572.80	1,450.00	N/A	9.87	1,234.00	19,746.22	112.00	-
13750	Western	N/A	3.95	195.00	6,053.20	33.00	N/A	8.18	834.00	31,822.40	109.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	5.46	0.66	-	-	-	4.80	103.00	4,872.27	1,208.00	-5.92%	6.83
-	Yes	2.53	0.51	-	-	-	2.02	14.00	4,602.43	1,297.00	13.64%	5
-	Yes	3.23	0.14	-	-	-	3.09	187.00	-	-	0.14%	6.93
-	Yes	2.75	0.20	-	56,194.83	1,715.00	2.55	55.00	10,575.83	1,715.00	-5.25%	7.22
-	Yes	3.43	0.92	-	-	-	2.51	18.00	-	-	3.81%	5.18
-	Yes	4.14	0.80	-	-	-	3.34	26.00	494,027.60	10,233.00	20.44%	9.31
-	Yes	2.65	0.12	-	-	-	2.53	50.00	-	-	5.04%	5
-	Yes	3.12	0.23	-	-	-	2.89	64.00	52,222.05	2,727.00	-2.39%	9.8
-	Yes	4.29	1.04	-	-	-	3.25	12.00	58,147.92	2,745.00	3.24%	10.21
-	Yes	5.78	1.06	-	-	-	4.72	133.00	154,293.93	4,308.00	1.25%	5.65
-	Yes	0.25	0.07	-	-	-	0.18	-	-	-	0.00%	0.01
-	Yes	5.02	2.30	-	6.73	1.00	2.72	27.00	368,994.80	6,725.00	2.05%	8.98
-	Yes	5.24	2.19	2.00	18,091.03	6,742.00	3.05	40.00	10,762.85	4,011.00	22.36%	7.77
-	Yes	4.38	0.78	-	-	-	3.60	58.00	-	-	-1.57%	3.14
-	Yes	5.37	2.28	-	-	-	3.09	16.00	-	-	26.06%	5.95
-	Yes	3.96	2.87	-	-	-	1.09	-	47,858.03	1,045.00	-3.01%	6.13
-	Yes	4.22	1.95	-	-	-	2.27	15.00	-	-	54.47%	5.87
-	Yes	3.46	0.02	-	-	-	3.44	80.00	-	-	14.88%	6.64
-	Yes	4.50	0.07	-	-	-	4.43	47.00	1,982.17	651.00	12.47%	4.06
-	Yes	8.04	1.91	8.00	28.07	1.00	6.13	135.00	124,444.23	2,495.00	-1.40%	7.04
-	Yes	2.56	0.07	-	-	-	2.49	10.00	48,085.00	978.00	-0.73%	5.42
-	Yes	2.86	1.63	-	-	-	1.23	2.00	-	-	-4.63%	4.12
-	Yes	1.92	1.78	-	-	-	0.14	-	-	-	-15.24%	6.45
-	Yes	4.10	2.22	-	-	-	1.88	9.00	486,287.22	4,642.00	-10.24%	8.24
-	Yes	2.49	0.37	-	-	-	2.12	164.00	-	-	-3.18%	4.56
-	Yes	2.39	0.96	7.00	-	-	1.43	77.00	83,686.95	1,088.00	-2.35%	6.22
-	Yes	1.45	0.45	-	-	-	1.00	18.00	-	-	-5.31%	3.21
-	Yes	1.29	0.30	-	-	-	0.99	80.00	-	-	-0.33%	6.11
-	Yes	0.55	0.55	-	-	-	-	-	-	-	3.94%	2.9
-	Yes	0.36	0.36	-	-	-	-	-	-	-	163.16%	1.5
-	Yes	3.69	2.32	-	-	-	1.37	210.00	-	-	2.97%	4.5
-	Yes	2.95	0.42	-	-	-	2.53	23.00	-	-	-6.93%	6.98
-	Yes	1.56	0.22	-	-	-	1.34	31.00	-	-	-7.24%	3.33
-	Yes	3.78	0.39	-	1,440.00	1,152.00	3.39	65.00	-	-	0.27%	7.3
-	Yes	2.14	0.31	-	-	-	1.83	38.00	-	-	-1.54%	5.74
-	Yes	3.67	0.38	-	-	-	3.29	30.00	-	-	-6.39%	4.1

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13753	Western	N/A	3.99	626.00	1,106.60	6.00	N/A	0.07	9.00	-	-	-
13754	Western	N/A	7.21	942.00	10,836.52	173.00	N/A	4.70	360.00	160.43	1.00	-
13756	Western	N/A	2.12	779.00	35,315.08	315.00	N/A	2.23	935.00	1,125.55	4.00	-
13761	Western	N/A	0.34	5.00	31.50	1.00	N/A	1.77	1,052.00	-	-	-
13762	Western	N/A	0.16	7.00	763.28	5.00	N/A	1.97	33.00	-	-	-
13763	Western	N/A		-	-	-	N/A	0.03	-	-	-	-
13764	Western	N/A	0.16	-	-	-	N/A	1.30	474.00	49.83	1.00	-
13765	Western	N/A		-	-	-	N/A	0.64	9.00	-	-	-
13766	Western	N/A		-	-	-	N/A	1.24	14.00	-	-	-
13769	Winter Haven	N/A	15.33	354.00	15,635.47	156.00	N/A	29.10	1,984.00	12,573.30	63.00	-
13770	Winter Haven	N/A	3.18	178.00	10,322.18	197.00	N/A	32.07	2,035.00	951.98	9.00	-
13772	Winter Haven	N/A	8.36	314.00	9,183.50	133.00	N/A	10.30	427.00	1,585.43	17.00	-
13777	South Hillsborough	N/A	2.12	249.00	14,193.32	2,231.00	N/A	12.48	810.00	57,674.42	477.00	-
13780	South Hillsborough	N/A	6.82	649.00	29,492.28	178.00	N/A	9.95	761.00	12,654.75	75.00	-
13781	South Hillsborough	N/A	0.23	18.00	-	-	N/A	0.71	69.00	-	-	-
13785	Plant City	N/A	14.83	323.00	8,402.33	64.00	N/A	36.27	508.00	2,894.87	26.00	-
13786	Plant City	N/A	43.43	796.00	55,342.18	499.00	N/A	4.17	39.00	6,442.30	77.00	-
13787	Plant City	N/A	42.59	884.00	33,856.72	663.00	N/A	10.42	160.00	60,008.67	196.00	-
13793	Eastern	N/A	3.77	194.00	15,633.93	1,027.00	N/A	12.86	1,437.00	19,420.37	203.00	-
13795	Eastern	N/A	3.76	131.00	32,854.45	202.00	N/A	18.44	1,341.00	360,019.18	1,150.00	-
13796	Eastern	N/A	6.44	153.00	6,845.32	46.00	N/A	9.90	1,337.00	9,732.72	53.00	-
13797	Eastern	N/A	3.55	168.00	5,796.30	52.00	N/A	18.73	1,293.00	4,936.72	34.00	-
13798	Eastern	N/A	3.51	185.00	32,077.95	389.00	N/A	10.00	1,053.00	499.53	5.00	-
13799	Eastern	N/A	2.60	125.00	21,350.05	194.00	N/A	11.55	1,706.00	10,243.55	58.00	-
13805	Plant City	N/A	44.88	1,062.00	74,365.02	858.00	N/A	13.71	155.00	184,917.70	911.00	-
13807	Plant City	N/A	43.91	1,309.00	67,185.10	566.00	N/A	7.25	322.00	3,968.13	22.00	-
13808	Plant City	N/A	99.13	1,788.00	66,217.82	552.00	N/A	9.83	157.00	3,899.97	17.00	-
13813	Dade City	N/A	45.01	755.00	55,047.45	421.00	N/A	10.13	156.00	2,910.02	25.00	-
13815	Dade City	N/A	36.00	499.00	258,652.77	877.00	N/A	19.74	200.00	5,249.47	21.00	-
13817	South Hillsborough	N/A	13.68	735.00	269,351.42	2,668.00	N/A	20.37	1,368.00	119,701.75	1,144.00	-
13818	South Hillsborough	N/A	1.06	7.00	463.07	1.00	N/A	13.46	1,164.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	1.79	0.03	-	-	-	1.76	156.00	2,087.10	759.00	-5.68%	4.48
-	Yes	0.93	0.14	3.00	-	-	0.79	65.00	-	-	6.76%	7.11
-	Yes	1.59	0.38	-	-	-	1.21	99.00	112,095.98	1,787.00	3.73%	6.12
-	Yes	1.60	0.65	-	-	-	0.95	15.00	-	-	0.33%	3.07
-	Yes	3.04	2.03	-	-	-	1.01	15.00	-	-	-6.45%	5.8
-	Yes	0.53	0.53	-	-	-	-	-	-	-	7.07%	3.03
-	Yes	0.88	0.13	-	-	-	0.75	11.00	-	-	-4.09%	4.92
-	Yes	0.85	0.85	8.00	-	-	-	-	-	-	13.07%	1.99
-	Yes	2.43	2.43	-	-	-	-	-	-	-	32.77%	1.58
-	Yes	8.28	2.10	-	119,939.47	2,338.00	6.18	46.00	181,317.50	7,983.00	60.59%	9.25
-	Yes	5.10	1.05	-	-	-	4.05	123.00	-	-	-2.94%	8.25
-	Yes	7.54	3.89	-	-	-	3.65	17.00	-	-	-43.48%	4.38
-	Yes	4.56	2.20	-	-	-	2.36	112.00	176,640.58	2,351.00	-21.70%	6.28
-	Yes	2.48	0.55	-	-	-	1.93	78.00	-	-	-3.92%	6.86
-	Yes	1.11	0.18	-	-	-	0.93	12.00	-	-	41.22%	8.36
-	Yes	9.05	6.07	-	-	-	2.98	39.00	-	-	16.88%	4.57
-	Yes	6.74	0.56	-	-	-	6.18	104.00	-	-	0.27%	3.74
-	Yes	8.92	0.34	-	-	-	8.58	158.00	-	-	-1.32%	6.71
-	Yes	3.14	0.77	-	-	-	2.37	54.00	218,369.63	2,466.00	4.52%	7.4
-	Yes	3.54	0.14	-	-	-	3.40	57.00	29,425.82	514.00	2.99%	8.28
-	Yes	3.39	0.54	-	-	-	2.85	40.00	222,193.88	4,258.00	-0.56%	5.29
-	Yes	3.56	0.35	-	-	-	3.21	68.00	53,763.17	1,621.00	10.90%	9.46
-	Yes	2.09	0.25	-	-	-	1.84	25.00	-	-	-21.19%	6.88
-	Yes	2.78	0.29	-	-	-	2.49	44.00	-	-	0.46%	6.53
-	Yes	5.65	0.03	-	-	-	5.62	95.00	-	-	0.86%	5.88
-	Yes	11.81	0.10	-	-	-	11.71	245.00	16,671.93	3,650.00	46.10%	8.81
-	Yes	16.86	0.24	-	-	-	16.62	172.00	-	-	6.14%	8.64
-	Yes	5.06	0.03	-	-	-	5.03	50.00	108,192.57	2,859.00	14.04%	3.9
-	Yes	6.48	0.26	-	-	-	6.22	27.00	171,584.60	3,110.00	13.73%	2.9
-	Yes	6.56	1.16	14.00	425.45	381.00	5.40	112.00	4,035.65	430.00	-19.43%	7.88
-	Yes	5.82	1.82	9.00	-	-	4.00	6.00	-	-	76.85%	5.27

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13819	South Hillsborough	N/A	0.53	3.00	50,110.23	394.00	N/A	2.15	417.00	-	-	-
13820	South Hillsborough	N/A	2.77	64.00	8,845.20	49.00	N/A	3.20	326.00	238.13	3.00	-
13822	South Hillsborough	N/A	1.80	47.00	2,784.55	29.00	N/A	20.01	1,567.00	158.87	2.00	-
13823	Central	N/A		-	-	-	N/A	0.01	-	-	-	-
13825	Central	N/A	7.14	772.00	22,226.62	186.00	N/A	2.23	641.00	1,094.48	16.00	-
13826	Central	N/A	2.96	181.00	58,252.35	417.00	N/A	7.88	1,661.00	1,140.75	19.00	-
13827	Central	N/A	3.99	370.00	63,789.07	353.00	N/A	3.44	387.00	1,315.83	25.00	-
13828	Central	N/A	5.73	468.00	132,671.65	628.00	N/A	3.64	949.00	7,337.95	126.00	-
13829	Central	N/A	0.91	37.00	4,848.27	55.00	N/A	8.51	790.00	59,172.62	299.00	-
13830	Central	N/A	3.69	292.00	12,266.53	109.00	N/A	5.19	297.00	107.98	11.00	-
13831	Central	N/A	0.30	46.00	32,629.33	391.00	N/A	5.89	1,141.00	101,810.18	664.00	-
13832	Central	N/A	3.00	247.00	8,814.33	139.00	N/A	1.40	150.00	11,322.28	145.00	-
13833	Central	N/A		-	-	-	N/A	0.02	-	-	-	-
13834	Central	N/A		-	-	-	N/A	-	-	-	-	-
13835	Central	N/A	3.69	460.00	871.70	18.00	N/A	6.30	862.00	37,584.05	117.00	-
13836	Central	N/A	1.83	77.00	3,127.95	39.00	N/A	16.98	567.00	44,930.78	127.00	-
13837	Central	N/A	3.97	398.00	31,163.68	106.00	N/A	7.59	615.00	18,327.57	69.00	-
13838	Central	N/A	4.86	257.00	45,435.08	292.00	N/A	3.48	344.00	16,221.13	52.00	-
13839	Central	N/A	6.77	325.00	173,359.23	2,614.00	N/A	17.27	856.00	5,453.67	51.00	-
13840	Central	N/A	4.51	148.00	1,862.02	13.00	N/A	2.50	159.00	46.93	1.00	-
13843	Central	N/A	0.22	3.00	-	-	N/A	0.17	2.00	-	-	-
13844	Central	N/A	0.15	4.00	-	-	N/A	2.97	727.00	32,642.13	352.00	-
13845	Central	N/A		-	-	-	N/A	3.95	1.00	-	-	-
13850	Plant City	N/A	0.08	2.00	84,227.35	249.00	N/A	15.18	958.00	45,669.87	207.00	-
13853	Plant City	N/A	2.11	21.00	77,156.65	616.00	N/A	27.99	1,509.00	37,782.95	293.00	-
13854	Plant City	N/A	10.49	601.00	100,476.77	1,667.00	N/A	14.79	1,314.00	1,896.02	6.00	-
13858	Central	N/A		-	-	-	N/A	0.24	-	-	-	-
13859	Central	N/A		-	-	-	N/A	0.01	-	-	-	-
13860	Western	N/A	1.36	46.00	2,132.95	4.00	N/A	10.86	1,008.00	10,810.83	39.00	-
13863	Western	N/A	0.25	13.00	5,909.57	71.00	N/A	9.14	715.00	36,804.77	227.00	-
13864	Western	N/A	0.82	42.00	3,087.80	30.00	N/A	4.80	323.00	278.85	5.00	-
13865	Western	N/A	2.02	111.00	6,310.92	11.00	N/A	17.35	1,760.00	572.68	2.00	-
13866	Western	N/A	0.38	15.00	-	-	N/A	2.65	87.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	2.75	0.83	-	-	-	1.92	5.00	1,985.73	424.00	44.52%	2.11
-	Yes	2.73	1.58	-	124.58	9.00	1.15	13.00	72,863.62	1,993.00	162.50%	2.73
-	Yes	5.78	3.79	21.00	-	-	1.99	20.00	-	-	-14.33%	5.5
-	Yes	0.50	0.23	-	-	-	0.27	-	-	-	31.85%	2.07
-	Yes	2.58	0.02	-	-	-	2.56	161.00	69,134.18	1,529.00	13.71%	5.89
-	Yes	4.38	1.79	-	-	-	2.59	106.00	-	-	-32.64%	5.49
-	Yes	1.15	0.04	-	-	-	1.11	44.00	-	-	16.01%	3.55
-	Yes	1.72	0.15	-	-	-	1.57	24.00	34,444.20	959.00	18.46%	7.25
-	Yes	3.24	0.10	-	-	-	3.14	21.00	-	-	3.05%	3.72
-	Yes	3.60	0.63	-	-	-	2.97	63.00	-	-	8.79%	4.21
-	Yes	1.45	0.04	-	-	-	1.41	71.00	-	-	14.16%	3.87
-	Yes	1.61	1.00	-	-	-	0.61	14.00	12,070.78	412.00	-6.17%	2.28
-	Yes	0.07	0.07	-	-	-	-	1.00	-	-	14.82%	4.57
-	Yes	0.11	0.11	-	-	-	-	-	-	-	-29.76%	2.36
-	Yes	1.38	0.03	-	-	-	1.35	31.00	-	-	11.58%	5.59
-	Yes	2.97	1.34	-	-	-	1.63	26.00	-	-	-3.90%	4.93
-	Yes	2.69	0.53	-	-	-	2.16	51.00	-	-	0.98%	5.15
-	Yes	1.98	0.26	-	-	-	1.72	47.00	39,287.05	1,809.00	-33.09%	4.51
-	Yes	5.58	0.12	-	-	-	5.46	103.00	152,223.37	2,576.00	-21.49%	8.44
-	Yes	3.21	0.07	-	-	-	3.14	136.00	-	-	-65.05%	2.38
-	Yes	1.64	1.22	-	-	-	0.42	-	-	-	-50.38%	2.63
-	Yes	2.77	0.74	-	-	-	2.03	16.00	-	-	-3.13%	5.88
-	Yes	0.44	0.44	-	-	-	-	-	-	-	-23.54%	3.02
-	Yes	1.87	0.80	-	-	-	1.07	1.00	52,721.47	716.00	-1.50%	3.94
-	Yes	4.34	2.80	-	-	-	1.54	9.00	116,729.77	1,518.00	0.99%	8.2
-	Yes	5.57	1.11	-	-	-	4.46	48.00	-	-	-0.84%	8.3
-	Yes	0.44	0.44	-	-	-	-	-	-	-	14.31%	6.31
-	Yes	2.12	2.12	-	-	-	-	-	-	-	100.00%	2.11
-	Yes	1.60	0.10	-	-	-	1.50	8.00	-	-	9.12%	5.98
-	Yes	1.78	0.84	-	-	-	0.94	12.00	-	-	9.94%	3.87
-	Yes	2.51	0.26	-	-	-	2.25	71.00	24,926.67	433.00	3.69%	5.06
-	Yes	5.12	1.06	-	-	-	4.06	50.00	-	-	14.84%	10.14
-	Yes	1.56	0.16	-	-	-	1.40	6.00	-	-	-40.86%	4.24

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13867	Western	N/A	1.69	108.00	20,462.37	56.00	N/A	2.00	95.00	32,215.32	162.00	-
13869	Western	N/A	0.17	5.00	6,636.32	122.00	N/A	7.18	567.00	10,417.58	79.00	-
13870	Western	N/A	2.38	39.00	23,177.42	285.00	N/A	20.34	2,157.00	48,519.75	252.00	-
13871	Western	N/A	1.43	26.00	101,829.85	310.00	N/A	8.80	1,053.00	9,415.55	69.00	-
13872	Western	N/A	-	-	-	-	N/A	11.37	911.00	78,595.67	922.00	-
13873	Western	N/A	2.19	40.00	13,708.83	172.00	N/A	10.53	1,018.00	27,463.87	338.00	-
13878	Eastern	N/A	1.98	44.00	-	-	N/A	8.91	1,486.00	27,798.55	85.00	-
13879	Eastern	N/A	0.13	3.00	7,684.23	99.00	N/A	8.64	2,270.00	16,929.50	73.00	-
13880	Eastern	N/A	0.15	2.00	199.27	1.00	N/A	8.20	1,659.00	246.92	2.00	-
13881	Eastern	N/A		-	-	-	N/A	1.74	120.00	302.73	2.00	-
13882	Eastern	N/A		-	-	-	N/A	2.24	395.00	-	-	-
13883	Eastern	N/A	1.10	35.00	4,489.85	84.00	N/A	6.84	1,407.00	68.98	1.00	-
13884	Eastern	N/A	0.31	-	15,912.13	145.00	N/A	11.48	1,608.00	69,949.13	477.00	-
13885	Eastern	N/A	0.57	7.00	1,538.08	40.00	N/A	9.97	1,194.00	2,661.75	9.00	-
13886	Western	N/A		-	3,030.33	14.00	N/A	11.64	1,146.00	13,447.08	75.00	-
13888	Western	N/A	0.84	16.00	3,208.90	14.00	N/A	11.66	1,143.00	27,600.08	125.00	-
13889	Western	N/A	6.86	282.00	5,066.02	64.00	N/A	13.72	1,427.00	17,749.15	127.00	-
13890	Western	N/A	0.17	14.00	270.58	1.00	N/A	7.05	660.00	7,021.00	70.00	-
13891	Western	N/A	0.01	-	-	-	N/A	17.34	1,365.00	30,210.42	108.00	-
13892	Western	N/A	0.38	12.00	2,875.50	54.00	N/A	11.37	1,098.00	5,021.90	13.00	-
13893	Western	N/A		-	-	-	N/A	-	-	-	-	-
13895	Western	N/A	0.76	80.00	19,952.75	1,641.00	N/A	2.20	231.00	881.53	18.00	-
13896	South Hillsborough	N/A	7.65	717.00	10,228.72	170.00	N/A	11.00	1,154.00	12,748.38	47.00	-
13897	South Hillsborough	N/A	2.39	24.00	3,181.23	99.00	N/A	19.44	1,343.00	28,965.37	249.00	-
13898	South Hillsborough	N/A	0.53	9.00	-	-	N/A	21.42	2,019.00	8,373.22	67.00	-
13899	South Hillsborough	N/A	7.13	507.00	25,392.15	202.00	N/A	6.74	849.00	-	-	-
13900	South Hillsborough	N/A	1.84	25.00	223,066.03	2,477.00	N/A	23.86	2,361.00	-	-	-
13901	South Hillsborough	N/A		-	3,447.03	34.00	N/A	15.93	971.00	-	-	-
13906	Eastern	N/A	8.70	429.00	121,541.48	3,120.00	N/A	17.81	1,169.00	23,099.90	198.00	-
13909	Eastern	N/A	7.12	467.00	90,336.40	724.00	N/A	8.12	173.00	28,952.32	163.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	2.14	0.19	-	-	-	1.95	42.00	10,047.60	216.00	-12.62%	4.71
-	Yes	1.11	0.10	-	-	-	1.01	9.00	-	-	6.08%	6.63
-	Yes	1.89	0.03	-	-	-	1.86	26.00	717,753.42	2,359.00	19.80%	8.53
-	Yes	2.09	0.36	-	-	-	1.73	11.00	135,795.87	2,172.00	24.87%	4.82
-	Yes	1.52	1.43	9.00	-	-	0.09	-	-	-	8.72%	3.99
-	Yes	0.74	0.02	-	-	-	0.72	5.00	101,936.67	1,060.00	-15.52%	6.04
-	Yes	2.63	0.41	-	-	-	2.22	22.00	-	-	-4.51%	5.72
-	Yes	2.85	1.73	-	-	-	1.12	10.00	-	-	-10.66%	6.45
-	Yes	2.51	1.35	-	-	-	1.16	9.00	10,168.70	1,667.00	-1.51%	7.83
-	Yes	1.78	1.18	-	-	-	0.60	4.00	-	-	-12.59%	3.54
-	Yes	1.27	1.27	-	-	-	-	-	-	-	3.85%	2.97
-	Yes	2.76	1.04	-	-	-	1.72	23.00	-	-	-11.79%	5.91
-	Yes	2.20	0.28	-	-	-	1.92	11.00	11,971.63	1,625.00	-8.21%	6.15
-	Yes	2.65	0.89	-	-	-	1.76	12.00	-	-	-4.37%	4.6
-	Yes	2.18	1.76	-	-	-	0.42	1.00	-	-	-6.33%	4.44
-	Yes	2.59	0.44	-	-	-	2.15	9.00	142,999.12	1,165.00	15.66%	5.54
-	Yes	3.30	0.33	-	-	-	2.97	56.00	-	-	-3.94%	10.23
-	Yes	1.63	0.07	-	-	-	1.56	59.00	-	-	-21.07%	4.12
-	Yes	2.25	1.48	-	-	-	0.77	15.00	-	-	2.23%	6.88
-	Yes	2.62	0.12	-	-	-	2.50	18.00	-	-	4.91%	6.84
-	Yes	0.20	0.20	-	-	-	-	-	-	-	0.00%	0.01
-	Yes	2.22	0.20	-	-	-	2.02	15.00	-	-	-13.65%	4.3
-	Yes	5.20	2.27	11.00	-	-	2.93	66.00	-	-	-3.41%	5.66
-	Yes	7.26	4.63	-	-	-	2.63	9.00	-	-	77.08%	6.18
-	Yes	9.98	5.51	-	-	-	4.47	6.00	150,467.38	4,293.00	-13.32%	8.33
-	Yes	3.93	0.12	-	-	-	3.81	112.00	-	-	1.49%	6.79
-	Yes	5.61	1.07	-	-	-	4.54	21.00	49,542.80	2,348.00	-7.80%	7.56
-	Yes	4.46	3.80	-	-	-	0.66	-	-	-	1.53%	5.97
-	Yes	4.06	0.13	-	84.80	2.00	3.93	61.00	74,147.20	1,632.00	23.63%	9
-	Yes	4.08	0.93	-	-	-	3.15	124.00	-	-	32.70%	7.71

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13910	Eastern	N/A	6.34	378.00	132,942.67	552.00	N/A	10.48	809.00	8,640.32	74.00	-
13911	Eastern	N/A	6.60	567.00	70,369.80	365.00	N/A	6.57	759.00	26,493.12	209.00	-
13916	Winter Haven	N/A	0.84	70.00	15,853.00	134.00	N/A	15.79	1,708.00	492.42	4.00	-
13918	Winter Haven	N/A	1.64	85.00	-	-	N/A	10.90	748.00	4,798.68	54.00	-
13919	Winter Haven	N/A	0.01	-	-	-	N/A	1.08	36.00	174.15	3.00	-
13920	Winter Haven	N/A	1.42	63.00	110.47	2.00	N/A	12.26	1,516.00	9,267.15	75.00	-
13921	Winter Haven	N/A	2.43	163.00	-	-	N/A	6.27	594.00	7,116.00	45.00	-
13922	Winter Haven	N/A	0.31	11.00	32,565.00	653.00	N/A	36.44	2,513.00	3,205.87	6.00	-
13924	Winter Haven	N/A	45.54	415.00	107,804.12	751.00	N/A	20.10	1,243.00	130,295.12	1,020.00	-
13927	Winter Haven	N/A	23.36	710.00	76,824.32	677.00	N/A	14.16	1,395.00	8,355.95	143.00	-
13928	Winter Haven	N/A		3.00	-	-	N/A	-	1.00	-	-	-
13932	Central	N/A	1.23	154.00	15,077.33	128.00	N/A	4.52	292.00	6,072.13	170.00	-
13934	Central	N/A	0.67	12.00	6,715.98	167.00	N/A	8.84	988.00	22,135.40	76.00	-
13935	Central	N/A	1.87	99.00	11,117.95	96.00	N/A	5.83	467.00	23,796.60	276.00	-
13939	Central	N/A	1.76	79.00	9,202.88	115.00	N/A	12.60	1,107.00	83,757.62	384.00	-
13940	Eastern	N/A		-	-	-	N/A	-	-	-	-	-
13942	Central	N/A	0.11	35.00	179,137.22	1,335.00	N/A	1.74	1,613.00	-	-	-
13943	Central	N/A	0.20	12.00	-	-	N/A	0.57	60.00	-	-	-
13944	Central	N/A	0.14	-	-	-	N/A	0.75	340.00	-	-	-
13945	Central	N/A		-	-	-	N/A	0.48	251.00	-	-	-
13946	Central	N/A	8.01	1,212.00	43,310.37	649.00	N/A	0.33	40.00	40.02	1.00	-
13947	Central	N/A	9.23	1,396.00	41,141.07	574.00	N/A	0.91	24.00	1,133.12	25.00	-
13948	Central	N/A	3.91	642.00	11,049.23	213.00	N/A	10.30	787.00	51,876.85	487.00	-
13951	Eastern	N/A	0.98	57.00	2,343.30	10.00	N/A	1.60	102.00	1,734.87	4.00	-
13952	Eastern	N/A	0.38	12.00	-	-	N/A	2.56	69.00	83.85	1.00	-
13953	Eastern	N/A	4.15	152.00	17,984.52	90.00	N/A	7.10	239.00	109.67	1.00	-
13954	Eastern	N/A	0.41	4.00	-	-	N/A	3.42	108.00	-	-	-
13955	Eastern	N/A	0.81	35.00	14.73	2.00	N/A	0.43	18.00	-	-	-
13956	Eastern	N/A	0.04	-	1,120.12	13.00	N/A	2.71	758.00	-	-	-
13957	Eastern	N/A	0.16	1.00	501.52	4.00	N/A	3.64	718.00	76.67	1.00	-
13959	Plant City	N/A	1.76	95.00	7,055.53	32.00	N/A	24.87	1,947.00	21,638.30	101.00	-
13961	Plant City	N/A	1.43	110.00	80,634.33	398.00	N/A	8.72	677.00	45,005.85	187.00	-
13962	Plant City	N/A	8.06	213.00	3,893.40	22.00	N/A	21.00	848.00	1,736.52	20.00	-
13963	Eastern	N/A	3.45	216.00	3,610.00	15.00	N/A	1.80	127.00	-	-	-
13964	Eastern	N/A	6.98	425.00	1,608.47	23.00	N/A	1.34	12.00	475.35	1.00	-
13967	Winter Haven	N/A	3.63	256.00	4,718.97	39.00	N/A	14.11	1,364.00	56,210.55	238.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	3.81	0.08	-	90,015.73	1,225.00	3.73	152.00	4,409.20	876.00	-1.03%	5.79
-	Yes	2.22	0.15	-	-	-	2.07	52.00	-	-	3.15%	5.24
-	Yes	1.43	0.07	-	-	-	1.36	15.00	-	-	0.52%	5.82
-	Yes	2.48	0.19	-	-	-	2.29	16.00	-	-	0.25%	4.05
-	Yes	0.79	0.20	-	-	-	0.59	13.00	-	-	-58.90%	0.6
-	Yes	2.52	0.33	-	-	-	2.19	12.00	222,667.17	2,546.00	3.50%	5.91
-	Yes	1.68	0.10	-	-	-	1.58	45.00	-	-	-3.82%	2.77
-	Yes	5.69	1.99	-	-	-	3.70	4.00	-	-	-1.37%	7.21
-	Yes	32.35	2.20	-	-	-	30.15	145.00	452,180.90	5,252.00	34.23%	6.98
-	Yes	7.92	0.31	-	-	-	7.61	82.00	-	-	30.82%	9.72
-	Yes	-	-	-	-	-	-	-	-	-	0.00%	0
-	Yes	1.59	0.05	-	-	-	1.54	24.00	-	-	5.12%	2.26
-	Yes	2.30	0.12	-	-	-	2.18	27.00	-	-	-11.79%	5.91
-	Yes	2.47	0.29	-	-	-	2.18	80.00	-	-	33.23%	4.13
-	Yes	3.05	0.08	-	-	-	2.97	79.00	-	-	-3.62%	5.86
-	Yes	0.02	0.02	-	-	-	-	-	-	-	-100.00%	0
-	Yes	1.52	1.49	171.00	65.35	1.00	0.03	4.00	501,474.87	6,106.00	28.57%	4.41
-	Yes	1.78	0.93	-	-	-	0.85	187.00	-	-	-48.39%	2.89
-	Yes	1.61	1.47	-	-	-	0.14	8.00	-	-	22.33%	1.26
-	Yes	1.14	1.14	-	-	-	-	-	-	-	100.00%	2.6
-	Yes	2.78	0.06	-	-	-	2.72	214.00	-	-	16.44%	5.1
-	Yes	3.30	0.12	-	-	-	3.18	201.00	-	-	100.00%	6.26
-	Yes	3.40	0.06	-	24,182.50	569.00	3.34	154.00	64,775.23	1,020.00	22.94%	8.36
-	Yes	2.28	0.63	-	-	-	1.65	27.00	-	-	-8.27%	3.66
-	Yes	1.10	0.21	-	-	-	0.89	4.00	-	-	-3.67%	3.15
-	Yes	2.54	0.19	-	-	-	2.35	27.00	-	-	-35.21%	5.19
-	Yes	2.38	0.45	-	-	-	1.93	16.00	1,807.07	160.00	-33.88%	3.2
-	Yes	1.27	0.22	1.00	-	-	1.05	5.00	-	-	-24.39%	0.62
-	Yes	2.08	0.72	-	-	-	1.36	10.00	-	-	23.19%	3.4
-	Yes	2.15	1.67	-	-	-	0.48	5.00	-	-	-0.72%	4.15
-	Yes	6.29	3.24	-	-	-	3.05	16.00	95,183.82	2,110.00	-19.61%	2.5
-	Yes	1.89	0.13	-	-	-	1.76	9.00	-	-	-71.54%	2.45
-	Yes	9.54	3.31	-	-	-	6.23	89.00	-	-	-0.33%	8.93
-	Yes	2.71	1.01	-	-	-	1.70	44.00	-	-	-20.38%	2.97
-	Yes	2.26	0.44	-	-	-	1.82	30.00	2,621.82	452.00	95.83%	8.46
-	Yes	3.60	0.07	-	-	-	3.53	105.00	46,212.82	1,733.00	-0.41%	7.34

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
13968	Winter Haven	N/A	5.21	569.00	5,733.00	126.00	N/A	3.81	472.00	9,928.70	124.00	-
13971	Winter Haven	N/A	0.13	2.00	11,493.33	91.00	N/A	27.23	2,543.00	26,804.50	164.00	-
13972	Winter Haven	N/A	2.17	51.00	-	-	N/A	17.06	1,051.00	34.18	1.00	-
13973	Winter Haven	N/A	1.22	5.00	2,283.50	30.00	N/A	9.20	840.00	22,419.00	88.00	-
13974	Winter Haven	N/A	1.87	127.00	3,256.22	22.00	N/A	16.88	909.00	82.35	1.00	-
13980	Plant City	N/A	0.98	2.00	166.22	3.00	N/A	0.34	6.00	-	-	-
13982	Plant City	N/A	9.43	281.00	2,180.85	44.00	N/A	5.01	93.00	598.82	3.00	-
13983	Plant City	N/A	15.57	486.00	229,029.38	3,738.00	N/A	28.60	578.00	24,883.52	103.00	-
13984	Plant City	N/A	4.51	111.00	2,151.35	21.00	N/A	11.31	721.00	10,796.92	12.00	-
13985	Central	N/A	0.02	-	2,760.33	70.00	N/A	17.23	2,237.00	13,492.52	159.00	-
13986	Central	N/A	1.13	4.00	18,030.90	75.00	N/A	14.59	1,099.00	-	-	-
13987	Central	N/A	0.03	-	2,187.33	17.00	N/A	10.79	1,087.00	30,114.98	103.00	-
13988	Central	N/A		-	-	-	N/A	14.41	1,459.00	54,798.22	167.00	-
13989	Central	N/A	-	-	205.62	1.00	N/A	20.11	1,734.00	3,647.80	22.00	-
13990	Central	N/A	0.25	-	-	-	N/A	15.93	1,150.00	1,704.50	14.00	-
13991	Central	N/A	0.37	7.00	5,778.73	29.00	N/A	17.12	1,260.00	4,678.23	10.00	-
13992	Central	N/A		-	2,851.77	13.00	N/A	14.38	1,048.00	-	-	-
13993	Central	N/A	4.94	183.00	4,258.20	35.00	N/A	21.81	1,054.00	2,521.72	51.00	-
13994	Central	N/A		-	-	-	N/A	-	-	-	-	-
14000	Plant City	N/A	22.69	717.00	11,891.28	88.00	N/A	7.55	480.00	2,128.73	12.00	-
14001	Plant City	N/A	0.61	2.00	-	-	N/A	0.89	42.00	-	-	-
14002	Plant City	N/A	-	-	19,353.72	192.00	N/A	24.03	1,538.00	25,967.00	123.00	-
14004	Plant City	N/A	0.05	1.00	-	-	N/A	0.22	3.00	-	-	-
14010	Central	N/A		-	-	-	N/A	2.11	40.00	-	-	-
14011	Central	N/A	0.74	7.00	58,593.50	269.00	N/A	6.23	1,070.00	4,305.67	89.00	-
14012	Central	N/A	10.93	610.00	137,878.92	3,948.00	N/A	8.22	1,313.00	1,633.20	6.00	-
14014	Central	N/A	0.44	16.00	5,785.82	131.00	N/A	2.44	676.00	33,803.32	287.00	-
14020	South Hillsborough	N/A	1.14	47.00	16,009.38	165.00	N/A	10.79	992.00	21,994.93	135.00	-
14021	South Hillsborough	N/A	12.44	649.00	94,521.65	746.00	N/A	16.45	1,334.00	27,292.18	191.00	-
14022	South Hillsborough	N/A	1.03	2.00	1,365.10	34.00	N/A	6.66	473.00	13,983.10	40.00	-
14023	South Hillsborough	N/A	12.19	404.00	948.32	4.00	N/A	10.19	697.00	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	3.06	0.06	-	-	-	3.00	168.00	-	-	1.94%	3.67
-	Yes	3.97	1.36	-	-	-	2.61	55.00	-	-	489.86%	8.73
-	Yes	2.15	0.10	-	-	-	2.05	8.00	-	-	-32.15%	5.36
-	Yes	1.42	0.22	-	-	-	1.20	14.00	-	-	-50.66%	3.37
-	Yes	4.16	0.15	-	3,170.83	250.00	4.01	24.00	2,911.37	774.00	100.00%	3.92
-	Yes	2.73	0.08	-	-	-	2.65	2.00	-	-	100.00%	0.13
-	Yes	4.40	0.25	-	-	-	4.15	89.00	-	-	100.00%	2.55
-	Yes	4.66	1.53	-	-	-	3.13	91.00	-	-	267.55%	5.55
-	Yes	4.41	1.24	-	-	-	3.17	67.00	-	-	-4.94%	8.66
-	Yes	3.28	0.74	-	-	-	2.54	15.00	-	-	-21.97%	7.85
-	Yes	3.08	2.00	-	-	-	1.08	4.00	-	-	-6.62%	6.07
-	Yes	6.09	2.84	-	-	-	3.25	8.00	5,062.55	1,099.00	0.81%	4.97
-	Yes	3.35	3.35	-	-	-	-	-	6,034.18	1,461.00	20.27%	7.06
-	Yes	4.22	2.39	-	-	-	1.83	5.00	-	-	-1.37%	6.5
-	Yes	3.45	2.46	-	-	-	0.99	-	-	-	-51.37%	5.69
-	Yes	6.55	4.34	-	-	-	2.21	9.00	-	-	56.71%	6.77
-	Yes	7.13	5.55	-	-	-	1.58	1.00	-	-	5.26%	5.4
-	Yes	4.96	0.17	-	-	-	4.79	94.00	-	-	14.61%	6.51
-	Yes	0.10	0.10	-	-	-	-	-	-	-	0.00%	0
-	Yes	5.92	0.31	-	-	-	5.61	101.00	42,848.12	2,579.00	35.92%	8.4
-	Yes	0.62	0.13	-	-	-	0.49	-	-	-	-61.92%	0.91
-	Yes	4.69	4.05	-	-	-	0.64	4.00	-	-	101.73%	8.17
-	Yes	0.43	0.04	-	-	-	0.39	1.00	-	-	-87.39%	0.15
-	Yes	1.90	1.90	-	-	-	-	-	-	-	16.14%	7.41
-	Yes	2.35	1.86	-	-	-	0.49	2.00	-	-	-37.43%	6.37
-	Yes	7.70	0.86	-	-	-	6.84	63.00	4,383.05	3,058.00	10.60%	8.24
-	Yes	1.32	0.95	-	-	-	0.37	1.00	-	-	219.84%	8.06
-	Yes	2.83	0.58	-	225.25	13.00	2.25	11.00	124,915.92	3,117.00	-18.52%	7.61
-	Yes	5.10	0.06	-	-	-	5.04	141.00	-	-	61.86%	10.44
-	Yes	2.74	0.48	-	-	-	2.26	13.00	-	-	-52.16%	3.1
-	Yes	7.56	0.41	-	-	-	7.15	92.00	128,032.08	2,397.00	20.88%	6.83

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14024	South Hillsborough	N/A	3.85	191.00	8,377.47	99.00	N/A	5.76	676.00	60.12	1.00	-
14025	South Hillsborough	N/A	1.04	53.00	1,302.25	24.00	N/A	14.76	1,377.00	11,150.90	54.00	-
14026	South Hillsborough	N/A	3.14	60.00	274.37	3.00	N/A	13.74	795.00	16,698.50	192.00	-
14030	Western	N/A	2.96	88.00	54,214.28	1,504.00	N/A	34.10	2,322.00	65,449.33	464.00	-
14031	Western	N/A	7.38	348.00	102,358.73	3,313.00	N/A	14.53	1,742.00	3,585.08	68.00	-
14032	Western	N/A	1.37	42.00	-	-	N/A	10.46	1,320.00	467.25	2.00	-
14035	Western	N/A	0.93	72.00	17,251.27	231.00	N/A	2.21	341.00	918.60	36.00	-
14036	Western	N/A		-	-	-	N/A	0.83	30.00	454.30	2.00	-
14037	Western	N/A	0.70	4.00	11,733.17	136.00	N/A	18.99	2,018.00	46,859.25	355.00	-
14040	Central	N/A	3.76	224.00	88,261.97	1,104.00	N/A	16.69	1,659.00	28,107.68	165.00	-
14041	Central	N/A	12.23	514.00	7,711.60	84.00	N/A	17.92	1,139.00	12,202.77	70.00	-
14042	Central	N/A	2.48	105.00	-	-	N/A	12.68	1,195.00	7,722.47	32.00	-
14043	Central	N/A		-	-	-	N/A	-	-	-	-	-
14045	Central	N/A	0.26	4.00	-	-	N/A	1.01	7.00	-	-	-
14046	Central	N/A	6.75	250.00	25,519.47	91.00	N/A	4.01	202.00	5,864.60	23.00	-
14050	Plant City	N/A	33.57	473.00	81,469.48	1,026.00	N/A	3.22	7.00	1,158.75	7.00	-
14051	Plant City	N/A	1.76	-	-	-	N/A	0.07	-	-	-	-
14059	Central	N/A	0.07	2.00	-	-	N/A	2.24	1,345.00	547.55	3.00	-
14060	Central	N/A		-	-	-	N/A	0.53	31.00	-	-	-
14064	Central	N/A		-	-	-	N/A	0.94	456.00	-	-	-
14065	Central	N/A		-	23,463.60	316.00	N/A	7.02	1,464.00	156,771.87	511.00	-
14066	Central	N/A		-	-	-	N/A	0.16	12.00	117.00	9.00	-
14069	Western	N/A	4.02	211.00	35,306.40	495.00	N/A	21.11	1,173.00	3,347.28	21.00	-
14070	Western	N/A	0.08	4.00	70,129.13	504.00	N/A	18.92	1,177.00	46,555.92	482.00	-
14071	Western	N/A	8.17	342.00	86,759.42	1,284.00	N/A	23.33	1,332.00	44,889.45	605.00	-
14079	Western	N/A	0.41	-	1,326.80	34.00	N/A	14.65	1,229.00	18,494.18	65.00	-
14080	Western	N/A	0.01	-	-	-	N/A	16.91	1,448.00	10,560.90	126.00	-
14081	Western	N/A	1.07	79.00	-	-	N/A	11.89	1,567.00	-	-	-
14082	Western	N/A		-	570.25	3.00	N/A	13.34	1,055.00	493,871.03	1,028.00	-
14083	Western	N/A		-	-	-	N/A	16.45	1,719.00	10,189.48	29.00	-
14084	Western	N/A	0.11	5.00	16,329.00	180.00	N/A	15.78	1,163.00	25,334.97	301.00	-
14089	Central	N/A	0.16	3.00	391.37	1.00	N/A	19.64	728.00	61,268.92	240.00	-
14090	Central	N/A	0.11	-	14,983.52	97.00	N/A	9.01	677.00	4,870.02	19.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	3.07	0.33	-	-	-	2.74	57.00	-	-	-45.39%	4.68
-	Yes	3.93	1.92	-	-	-	2.01	20.00	-	-	-46.05%	5.87
-	Yes	2.71	1.04	-	44,297.63	733.00	1.67	8.00	-	-	96.72%	4.8
-	Yes	3.43	1.35	-	-	-	2.08	40.00	-	-	3.01%	11.64
-	Yes	3.23	0.44	-	-	-	2.79	39.00	-	-	10.59%	8.56
-	Yes	3.46	1.88	-	-	-	1.58	39.00	254.72	71.00	-7.48%	5.81
-	Yes	1.66	0.95	-	-	-	0.71	3.00	-	-	-18.27%	3.49
-	Yes	1.31	1.26	-	-	-	0.05	-	4,517.28	1,390.00	-12.55%	2.3
-	Yes	3.72	2.27	1.00	-	-	1.45	1.00	2,129.40	2,028.00	-2.97%	7.83
-	Yes	4.53	0.35	-	-	-	4.18	104.00	-	-	11.52%	7.55
-	Yes	5.25	0.52	2.00	-	-	4.73	67.00	111,910.28	1,651.00	13.50%	8.83
-	Yes	4.55	0.10	-	-	-	4.45	60.00	6,170.73	2,665.00	-48.99%	5.57
-	Yes	-	-	-	-	-	-	-	-	-	0.00%	0
-	Yes	1.51	1.51	-	-	-	-	-	-	-	4.77%	5.05
-	Yes	4.38	1.05	-	-	-	3.33	60.00	130,117.30	2,034.00	26.20%	8.43
-	Yes	11.28	0.76	-	-	-	10.52	10.00	160,418.10	2,399.00	-59.54%	1.42
-	Yes	0.04	-	-	-	-	0.04	-	3.27	1.00	100.00%	0.2
-	Yes	1.99	1.99	1.00	-	-	-	-	-	-	3.99%	6
-	Yes	0.84	0.84	-	-	-	-	-	-	-	-31.17%	2.65
-	Yes	2.32	2.32	212.00	-	-	-	-	-	-	-6.58%	7.53
-	Yes	1.52	1.52	141.00	-	-	-	-	-	-	-6.48%	4.62
-	Yes	0.88	0.88	-	-	-	-	-	-	-	629.41%	1.24
-	Yes	6.64	5.02	-	-	-	1.62	11.00	-	-	7.28%	7.66
-	Yes	3.83	1.45	-	-	-	2.38	16.00	-	-	-3.73%	7.48
-	Yes	8.17	4.67	-	-	-	3.50	29.00	227,078.38	6,684.00	2.09%	9.77
-	Yes	6.55	4.41	1.00	-	-	2.14	2.00	-	-	-16.12%	5.88
-	Yes	2.75	2.16	-	-	-	0.59	-	-	-	-3.24%	6.28
-	Yes	3.65	3.00	-	-	-	0.65	21.00	244,924.90	1,667.00	-2.31%	7.2
-	Yes	3.08	3.08	-	-	-	-	-	197,392.87	3,410.00	17.74%	6.97
-	Yes	4.61	4.34	-	-	-	0.27	1.00	-	-	-7.63%	7.14
-	Yes	3.57	1.65	-	111,093.97	1,169.00	1.92	3.00	-	-	-7.25%	6.78
-	Yes	8.42	5.26	-	-	-	3.16	7.00	-	-	-63.57%	3.72
-	Yes	4.77	3.48	-	-	-	1.29	12.00	170,716.62	2,816.00	6.86%	6.23

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14091	Central	N/A	0.22	-	289.45	2.00	N/A	12.30	1,032.00	234.43	1.00	-
14092	Central	N/A	-	-	28,703.97	180.00	N/A	17.05	1,406.00	17,763.30	186.00	-
14094	Central	N/A	0.03	2.00	216.53	8.00	N/A	10.21	1,475.00	28,481.57	220.00	-
14095	Central	N/A		-	6,924.50	66.00	N/A	17.49	1,177.00	2,423.48	11.00	-
14096	Central	N/A		-	-	-	N/A	14.06	1,321.00	311.08	1.00	-
14099	Central	N/A	2.66	41.00	6,246.88	14.00	N/A	10.57	685.00	7,047.20	16.00	-
14100	Central	N/A		-	7,038.48	57.00	N/A	21.40	2,143.00	50,625.03	125.00	-
14101	Central	N/A		-	-	-	N/A	20.71	1,523.00	2,760.60	6.00	-
14102	Central	N/A	1.85	47.00	58.57	1.00	N/A	19.08	1,840.00	2,192.80	8.00	-
14109	Eastern	N/A	0.45	4.00	-	-	N/A	5.44	656.00	7,214.22	57.00	-
14110	Eastern	N/A	2.10	95.00	147,321.15	524.00	N/A	17.87	810.00	17,054.98	192.00	-
14111	Eastern	N/A	7.18	482.00	4,815.15	60.00	N/A	7.93	688.00	13,235.90	68.00	-
14112	Eastern	N/A	2.89	112.00	4,797.28	36.00	N/A	13.63	915.00	15,620.00	28.00	-
14114	Eastern	N/A	8.16	393.00	77,635.60	691.00	N/A	19.15	1,931.00	20,349.05	125.00	-
14115	Eastern	N/A	0.86	11.00	2,652.87	24.00	N/A	3.39	137.00	4,142.08	8.00	-
14116	Eastern	N/A	0.81	44.00	10.75	1.00	N/A	2.63	398.00	55.65	1.00	-
14117	Eastern	N/A	0.97	78.00	912.17	11.00	N/A	2.31	99.00	1,372.30	3.00	-
14119	Plant City	N/A	0.05	2.00	-	-	N/A	10.74	1,006.00	-	-	-
14120	Plant City	N/A	0.40	4.00	380.78	3.00	N/A	14.65	964.00	18,942.23	172.00	-
14121	Plant City	N/A	0.48	8.00	22,733.32	348.00	N/A	11.52	744.00	8,049.63	60.00	-
14122	Plant City	N/A		-	6,171.00	44.00	N/A	22.94	1,347.00	57,235.42	553.00	-
14123	Plant City	N/A	5.85	152.00	445.32	26.00	N/A	14.63	892.00	-	-	-
14124	Plant City	N/A	4.86	105.00	1,622.65	15.00	N/A	14.08	887.00	3,211.53	32.00	-
14125	Plant City	N/A	0.82	1.00	8,822.67	45.00	N/A	24.62	1,698.00	22,802.87	150.00	-
14144	South Hillsborough	N/A	7.13	569.00	67,778.12	293.00	N/A	15.08	1,262.00	87,932.97	653.00	-
14145	South Hillsborough	N/A	0.19	2.00	11,851.33	163.00	N/A	22.12	1,742.00	-	-	-
14146	South Hillsborough	N/A	13.11	440.00	1,204.87	12.00	N/A	13.46	654.00	1,416.97	17.00	-
14147	South Hillsborough	N/A	8.77	181.00	13,906.67	168.00	N/A	19.72	982.00	801.30	5.00	-
14187	Winter Haven	N/A	6.75	234.00	86,856.12	943.00	N/A	15.18	677.00	574.68	8.00	-
14188	Winter Haven	N/A	2.96	94.00	2,030.32	26.00	N/A	4.18	76.00	-	-	-
14196	Eastern	N/A		-	-	-	N/A	0.07	1.00	-	-	-
14197	Eastern	N/A	1.87	32.00	667.33	7.00	N/A	0.78	56.00	219.27	4.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	4.43	2.68	-	-	-	1.75	3.00	-	-	37.68%	5.7
-	Yes	3.48	2.52	-	-	-	0.96	4.00	-	-	100.00%	7.21
-	Yes	5.52	3.94	-	-	-	1.58	8.00	-	-	-17.22%	6.54
-	Yes	3.19	3.19	-	-	-	-	-	95,436.15	1,181.00	-38.99%	5.9
-	Yes	4.98	4.14	-	-	-	0.84	-	-	-	1.94%	6.3
-	Yes	7.05	2.70	-	-	-	4.35	11.00	-	-	-2.91%	4.34
-	Yes	4.00	4.00	-	-	-	-	-	-	-	4.18%	7.73
-	Yes	5.65	5.65	-	-	-	-	-	89,433.52	1,524.00	-0.69%	7.22
-	Yes	6.96	5.06	1.00	-	-	1.90	17.00	-	-	-5.13%	8.69
-	Yes	1.70	0.27	-	-	-	1.43	21.00	40,494.00	680.00	-6.31%	2.97
-	Yes	2.57	0.14	-	-	-	2.43	15.00	26,254.53	892.00	-18.50%	5.86
-	Yes	2.92	0.04	-	-	-	2.88	67.00	-	-	-6.29%	6.26
-	Yes	3.04	0.21	-	36.68	1.00	2.83	32.00	73,534.80	1,052.00	11.35%	8.24
-	Yes	3.71	0.15	-	-	-	3.56	43.00	-	-	52.94%	10.92
-	Yes	2.89	1.59	1.00	-	-	1.30	12.00	-	-	-8.08%	5.46
-	Yes	1.95	0.16	-	-	-	1.79	50.00	-	-	-4.65%	3.69
-	Yes	1.82	0.20	-	-	-	1.62	25.00	-	-	8.97%	6.56
-	Yes	2.47	1.52	-	-	-	0.95	1.00	30,288.33	1,096.00	-64.44%	4.21
-	Yes	4.89	2.93	-	-	-	1.96	10.00	111,159.20	984.00	-0.10%	9.57
-	Yes	2.68	1.29	-	-	-	1.39	4.00	-	-	-7.88%	4.91
-	Yes	3.24	3.05	-	-	-	0.19	-	155,084.55	2,244.00	-15.35%	8.49
-	Yes	6.74	3.08	-	-	-	3.66	48.00	-	-	1.05%	6.76
-	Yes	6.72	3.26	-	-	-	3.46	81.00	-	-	23.46%	5.21
-	Yes	6.06	4.52	1.00	-	-	1.54	6.00	167,136.57	1,706.00	43.42%	10.57
-	Yes	2.97	0.21	-	-	-	2.76	30.00	190,823.97	1,862.00	-5.39%	6.14
-	Yes	5.52	3.61	15.00	-	-	1.91	4.00	-	-	-0.73%	6.82
-	Yes	7.56	3.77	-	-	-	3.79	33.00	-	-	11.61%	6.44
-	Yes	7.54	4.71	-	-	-	2.83	14.00	-	-	10.00%	4.73
-	Yes	7.16	4.75	-	-	-	2.41	13.00	-	-	149.42%	6.41
-	Yes	5.93	3.04	-	-	-	2.89	42.00	-	-	8.58%	2.53
-	Yes	0.02	0.02	-	-	-	-	-	-	-	17.49%	6.92
-	Yes	2.23	0.14	-	-	-	2.09	15.00	-	-	17.32%	2.98

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14198	Eastern	N/A	1.96	50.00	-	-	N/A	3.53	254.00	396.22	1.00	-
14199	Eastern	N/A	0.97	33.00	3,093.52	13.00	N/A	0.51	24.00	372.32	2.00	-
14200	South Hillsborough	N/A		-	-	-	N/A	-	-	-	-	-
14201	South Hillsborough	N/A		-	-	-	N/A	-	-	-	-	-
14202	South Hillsborough	N/A	3.24	25.00	23,268.83	248.00	N/A	12.58	1,062.00	62,220.58	224.00	-
14203	South Hillsborough	N/A	1.41	4.00	-	-	N/A	1.28	11.00	94.50	1.00	-
14207	Eastern	N/A	0.15	2.00	-	-	N/A	-	-	-	-	-
14208	Eastern	N/A		-	-	-	N/A	0.05	1.00	-	-	-
14209	Eastern	N/A		-	-	-	N/A	0.15	-	-	-	-
14210	Eastern	N/A		-	-	-	N/A	0.01	1.00	-	-	-
14216	Central	N/A	5.61	127.00	395.40	7.00	N/A	33.19	324.00	9,685.22	16.00	-
14217	Central	N/A	3.06	23.00	696.27	2.00	N/A	7.86	724.00	3,774.77	9.00	-
14218	Central	N/A	0.06	2.00	-	-	N/A	23.90	1,927.00	-	-	-
14221	Central	N/A		-	15,382.73	107.00	N/A	21.71	1,693.00	14,968.97	50.00	-
14222	Central	N/A		-	42.65	1.00	N/A	21.26	1,224.00	1,558.80	8.00	-
14226	Central	N/A	0.33	27.00	-	-	N/A	0.72	301.00	-	-	-
14227	Central	N/A		-	-	-	N/A	0.04	29.00	-	-	-
14228	Central	N/A		-	-	-	N/A	0.26	529.00	-	-	-
14229	Central	N/A		-	-	-	N/A	-	-	-	-	-
14230	Central	N/A		-	-	-	N/A	0.04	401.00	-	-	-
14231	Central	N/A		-	-	-	N/A	-	-	-	-	-
14232	Central	N/A		-	-	-	N/A	-	-	-	-	-
14233	Central	N/A		-	-	-	N/A	-	-	-	-	-
14258	South Hillsborough	N/A	12.96	150.00	42,528.63	212.00	N/A	23.50	1,453.00	122.07	2.00	-
14259	South Hillsborough	N/A	40.70	359.00	38,107.78	342.00	N/A	4.14	118.00	54,927.20	297.00	-
14260	South Hillsborough	N/A	0.07	1.00	-	-	N/A	34.77	2,312.00	24,873.18	81.00	-
14261	South Hillsborough	N/A	78.98	837.00	431,781.65	1,730.00	N/A	28.10	1,137.00	24,743.92	178.00	-
14266	Central	N/A	2.21	134.00	100,473.33	1,824.00	N/A	10.36	2,463.00	14,216.32	113.00	-
14267	Central	N/A		-	-	-	N/A	19.13	1,585.00	30,256.57	72.00	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	3.53	1.13	-	-	-	2.40	46.00	68,079.23	1,017.00	-3.45%	5.59
-	Yes	2.72	0.61	-	-	-	2.11	20.00	4,270.50	78.00	-2.14%	6.4
-	Yes	0.07	0.07	-	-	-	-	-	-	-	-4.73%	4.83
-	Yes	0.10	0.10	-	-	-	-	-	-	-	-22.62%	6.67
-	Yes	5.87	1.28	-	-	-	4.59	6.00	-	-	529.11%	4.97
-	Yes	2.42	1.38	-	-	-	1.04	6.00	-	-	0.20%	4.89
-	Yes	0.24	0.05	-	-	-	0.19	-	-	-	17.92%	3.75
-	Yes	0.33	0.15	-	-	-	0.18	-	-	-	26.38%	3.21
-	Yes	0.60	0.23	-	-	-	0.37	-	-	-	326.91%	9.52
-	Yes	0.19	0.19	-	-	-	-	-	-	-	7.84%	3.85
-	Yes	8.49	5.02	-	-	-	3.47	5.00	-	-	-83.96%	1.29
-	Yes	3.17	1.10	-	-	-	2.07	3.00	51,425.00	748.00	32.12%	3.99
-	Yes	6.48	3.97	-	-	-	2.51	-	-	-	27.88%	8.76
-	Yes	4.54	2.78	-	-	-	1.76	1.00	-	-	8.43%	6.82
-	Yes	9.18	9.05	-	-	-	0.13	-	-	-	50.13%	5.66
-	Yes	1.99	1.94	-	-	-	0.05	4.00	17,249.25	327.00	100.00%	0.56
-	Yes	0.74	0.74	-	-	-	-	-	-	-	100.00%	0.8
-	Yes	0.94	0.94	-	-	-	-	-	-	-	-3.31%	1.17
-	Yes	0.65	0.65	-	-	-	-	-	-	-	0.00%	0
-	Yes	0.84	0.84	-	-	-	-	-	-	-	-10.00%	0.36
-	Yes	0.33	0.33	-	-	-	-	-	-	-	0.00%	0.01
-	Yes	0.39	0.39	-	-	-	-	-	-	-	0.00%	0.02
-	Yes	-	-	-	-	-	-	-	-	-	0.00%	0
-	Yes	5.98	3.18	-	-	-	2.80	39.00	321,289.33	3,286.00	8.78%	7.06
-	Yes	1.76	0.21	-	-	-	1.55	7.00	61,609.77	949.00	0.42%	2.39
-	Yes	8.14	5.43	-	-	-	2.71	1.00	-	-	8.63%	10.57
-	Yes	14.48	3.78	-	-	-	10.70	47.00	-	-	26.88%	8.78
-	Yes	4.33	0.43	-	-	-	3.90	66.00	-	-	10.82%	8.4
-	Yes	4.15	2.40	-	-	-	1.75	3.00	-	-	-3.28%	6.2

Appendix E - Feeder Specific Report and Attached Laterals Data

Displays the CMI (customer minutes of interruption), CI (customer interruptions), customer count it serves, and overhead/underground feeder and lateral mileage for each of the distribution circuits on Tampa Electric system.

(A) Circuit	(B) Division	(C) Number of OH Lateral Lines	(D) Number of OH Lateral Miles	(E) Number of Customers Served on OH Lateral Lines	(F) CMI for OH Lateral Lines	(G) CI for OH Lateral Lines	(H) Number of URD Lateral Lines	(I) Number of URD Lateral Miles	(J) Number of Customers Served on URD Lateral Lines	(K) CMI for URD Lateral Lines	(L) CI for URD Lateral Lines	(M) Number of Automatic Line Sectionalizing Devices on the Lateral
14268	Central	N/A		-	-	-	N/A	12.34	866.00	10,303.72	62.00	-
14269	Central	N/A	7.17	490.00	22,540.50	148.00	N/A	10.92	1,726.00	770.32	8.00	-
14274	Western	N/A	28.52	515.00	279,602.05	1,013.00	N/A	21.79	506.00	5,756.05	57.00	-
14275	Western	N/A	0.71	9.00	-	-	N/A	28.48	1,349.00	2,406.15	13.00	-
14306	Dade City	N/A	17.17	421.00	32,254.10	222.00	N/A	1.92	23.00	-	-	-
14310	Eastern	N/A		-	-	-	N/A	-	-	-	-	-
14316	South Hillsborough	N/A		-	1,583.08	22.00	N/A	15.53	1,254.00	6,146.15	40.00	-
14317	South Hillsborough	N/A		-	-	-	N/A	8.21	684.00	49.93	1.00	-
14319	South Hillsborough	N/A		-	-	-	N/A	11.46	539.00	29,886.35	168.00	-
14320	South Hillsborough	N/A	0.36	49.00	4,049.67	88.00	N/A	8.71	937.00	-	-	-
14322	Eastern	N/A	9.07	-	36,383.20	355.00	N/A	1.96	-	-	-	-
14322	South Hillsborough	N/A		-	68.72	1.00	N/A	4.68	145.00	444.27	7.00	-
14333	Eastern	N/A		-	-	-	N/A	-	-	-	-	-
14341	Eastern	N/A	4.22	20.00	12,504.25	37.00	N/A	10.68	162.00	-	-	-
14349	Western	N/A	10.77	1,126.00	40,693.30	388.00	N/A	6.27	908.00	932.98	16.00	-
14350	Western	N/A		-	-	-	N/A	-	-	-	-	-
14355	Eastern	N/A	1.38	21.00	1,729.60	949.00	N/A	9.39	2,615.00	5,257.75	93.00	-
14356	Eastern	N/A	0.86	21.00	112.08	1.00	N/A	7.74	1,752.00	17,283.02	31.00	-
14358	Eastern	N/A	0.20	8.00	-	-	N/A	6.37	1,080.00	21,295.03	116.00	-
14396	South Hillsborough	N/A	1.92	91.00	207,111.93	1,381.00	N/A	15.89	2,185.00	203,533.50	629.00	-
14397	South Hillsborough	N/A	2.10	46.00	667.23	9.00	N/A	4.41	569.00	15,599.20	76.00	-
14398	South Hillsborough	N/A	5.91	167.00	5,531.57	53.00	N/A	18.58	1,444.00	9,174.27	100.00	-
14399	South Hillsborough	N/A	4.74	131.00	133,478.50	1,131.00	N/A	26.06	2,391.00	5,140.05	20.00	-
14937	Winter Haven	N/A	2.82	158.00	1,994.10	23.00	N/A	0.88	31.00	1,997.18	18.00	-
13647	South Hillsborough	N/A	1.28	-	-	-	N/A	22.41	-	2,588.42	10.00	-
14578	Plant City	N/A		-	668.10	18.00	N/A	3.42	-	-	-	-

(N) Number of Automatic Line Sectionalizing Devices on the Feeder	(O) Feeder Looped?	(P) Total Length of Feeder	(Q) Length of URD Portion of Feeder Circuit	(R) Number of Customers Served by URD Feeders	(S) CMI for URD Feeders	(T) CI for URD Feeders	(U) Length of OH Portion of the Feeder Circuit	(V) Number of Customers Served by OH Feeders	(W) CMI for OH Feeders	(X) CI for OH Feeders	(Y) % Load Growth Since December 31	(Z) Recorded Peak Load Recorded through December 31
-	Yes	3.00	1.66	-	-	-	1.34	-	187,409.42	907.00	4.02%	3.88
-	Yes	4.52	0.55	-	-	-	3.97	159.00	-	-	100.00%	7.88
-	Yes	6.12	1.01	-	-	-	5.11	94.00	89,240.50	678.00	16.88%	6.37
-	Yes	5.54	3.22	1.00	-	-	2.32	12.00	212,423.57	1,366.00	13.77%	8.51
-	Yes	3.64	0.51	-	-	-	3.13	78.00	-	-	-22.40%	2.46
-	Yes	0.40	0.12	-	-	-	0.28	-	-	-	-54.17%	5.61
-	Yes	4.98	4.98	-	-	-	-	-	196,239.10	1,942.00	-20.39%	4.84
-	Yes	3.32	3.32	-	-	-	-	-	-	-	-4.91%	2.71
-	Yes	5.10	5.10	-	-	-	-	-	54,226.13	830.00	0.00%	1.92
-	Yes	3.40	1.98	-	-	-	1.42	7.00	-	-	5.08%	4.76
-	Yes	6.45	0.04	-	-	-	6.41	-	-	-	100.00%	7.83
-	Yes	3.28	3.28	-	-	-	-	-	-	-	100.00%	0.5
-	Yes	2.30	2.26	-	-	-	0.04	-	-	-	0.00%	0
-	Yes	2.46	1.39	-	-	-	1.07	-	12,587.28	354.00	566.67%	0.4
-	Yes	3.95	0.27	-	160.42	2.00	3.68	329.00	231,870.15	2,330.00	100.00%	7.82
-	Yes	0.02	0.02	-	-	-	-	-	-	-	100.00%	0.02
-	Yes	2.22	0.54	-	-	-	1.68	25.00	-	-	2.11%	7.73
-	Yes	3.70	2.44	-	-	-	1.26	11.00	-	-	2.95%	7.69
-	Yes	2.42	1.69	-	-	-	0.73	9.00	-	-	-2.60%	5.62
-	Yes	3.60	1.45	-	-	-	2.15	51.00	415,196.93	2,357.00	5.36%	8.06
-	Yes	5.81	3.76	-	-	-	2.05	4.00	-	-	-1.43%	4.14
-	Yes	4.64	1.76	-	-	-	2.88	20.00	92,543.30	1,622.00	-3.56%	7.58
-	Yes	2.63	1.00	-	-	-	1.63	5.00	-	-	-4.70%	8.92
-	Yes	4.98	0.92	-	-	-	4.06	80.00	-	-	53.87%	5.97
-	Yes	4.73	3.96	-	-	-	0.77	-	-	-	0.00%	0
-	Yes	7.94	7.92	-	-	-	0.02	-	-	-	18.55%	1.47