



William P. Cox  
Senior Counsel  
Florida Power & Light Company  
700 Universe Boulevard  
Juno Beach, FL 33408-0420  
(561) 304-5662  
(561) 691-7135 (Facsimile)  
E-mail: will.p.cox@fpl.com

April 1, 2025

**-VIA ELECTRONIC FILING-**

Adam Teitzman  
Commission Clerk  
Florida Public Service Commission  
2540 Shumard Oak Boulevard  
Tallahassee, FL 32399-0850

RECEIVED-FPSC  
2025 APR -1 PM 3:17  
COMMISSION  
CLERK

Re: Docket No. 20250000-OT  
Florida Power & Light Company's 2025 – 2034 Ten Year Power Plant Site Plan

Dear Mr. Teitzman:

Please find enclosed for electronic filing Florida Power & Light Company's 2025 – 2034 Ten Year Power Plant Site Plan. Per Commission Staff's request, five (5) hard copies will also be provided to your office.

Please contact me if you have any questions regarding this submission.

Sincerely,

s/ William P. Cox  
William P. Cox  
Senior Counsel  
Florida Bar No. 0093531

WPC:cw  
Enclosures

COM \_\_\_\_\_  
AFD \_\_\_\_\_  
APA \_\_\_\_\_  
ECO \_\_\_\_\_  
ENG 4 hard copies  
GCL \_\_\_\_\_  
IDM \_\_\_\_\_  
CLK \_\_\_\_\_

# Ten Year Power Plant Site Plan 2025 – 2034



**FPL®**

... MJO  
... JOV  
... A  
... JOV  
... ENG  
... JOV  
... MJO  
... JOV



***(This page is intentionally left blank.)***



**FPL®**

***Ten Year Power Plant Site Plan***

***2025-2034***

***Submitted To:***

***Florida Public  
Service Commission***

***April 2025***

**(This page is intentionally left blank.)**

## Table of Contents

List of Figures, Tables, and Maps .....	v
List of Schedules .....	vi
Overview of the Document .....	1
List of Abbreviations Used in Forms .....	3
Executive Summary .....	5
Chapter I. Description of Existing Resources .....	18
I.A FPL System: .....	20
I.A.1. Description of Existing Resources .....	20
I.A.2. FPL - Owned Resources .....	20
I.A.3. FPL - Capacity and Energy Power Purchases .....	27
I.A.4. FPL – Demand-Side Management (DSM) .....	31
I.A.5. Existing Generating Units in FPL's Service Area .....	31
Chapter II. Forecast of Electric Power Demand .....	41
II.A. Overview of the Load Forecasting Process .....	43
II.B. Customer Forecasts .....	44
II.C. Energy Sales Forecasts .....	45
II.D. Net Energy for Load (NEL) .....	49
II.E. System Peak Forecasts .....	50
II.F. Hourly Load Forecast .....	53
II.G. Uncertainty .....	53
II.H. DSM .....	54
Chapter III. Projection of Incremental Resource Additions .....	69
III.A. FPL's Resource Planning .....	71
III.B. Projected Incremental Resource Changes in the Resource Plan .....	81
III.C. Discussion of the Resource Plan and Issues Impacting Resource Planning Work .....	81
III.D. Demand-Side Management (DSM) .....	89
III.E. Transmission Plan .....	93
III.F. Renewable Resources and Storage Technology .....	132
III.G. Fuel Mix and Fuel Price Forecasts .....	147
Chapter IV. Environmental and Land Use Information .....	253
IV.A. Protection of the Environment .....	255
IV.B. Environmental Organization Contributions .....	256
IV.C. Environmental Communication and Facilitation .....	256
IV.D. Environmental Policy .....	257

---

IV.E. Environmental Management .....	259
IV.F. Environmental Assurance Program .....	259
IV.G. Preferred and Potential Sites .....	260
Chapter V. Other Planning Assumptions & Information .....	266
Appendix. Preferred and Potential Solar Site Descriptions and Maps .....	277
A. Site Descriptions, Environmental, and Land Use Information .....	278
B. Preferred Sites.....	281
1. Preferred Site #1 – Flatford Solar Energy Center, Manatee County.....	282
2. Preferred Site #2 – Mare Branch Solar Energy Center, DeSoto County.....	287
3. Preferred Site #3 – Price Creek Solar Energy Center, Columbia County.....	292
4. Preferred Site #4 – Swamp Cabbage Solar Energy Center, Hendry County.....	297
5. Preferred Site #5 – Big Brook Solar Energy Center, Calhoun County.....	302
6. Preferred Site #6 – Mallard Solar Energy Center, Brevard County.....	307
7. Preferred Site #7 – Boardwalk Solar Energy Center, Collier County.....	312
8. Preferred Site #8 – Goldenrod Solar Energy Center, Collier County.....	317
9. Preferred Site #9 – North Orange Solar Energy Center, St. Lucie County.....	322
10. Preferred Site #10 – Sea Grape Solar Energy Center, St. Lucie County.....	327
11. Preferred Site #11 – Clover Solar Energy Center, St. Lucie County.....	332
12. Preferred Site #12 – Sand Pine Solar Energy Center, Calhoun County.....	337
13. Preferred Site #13 – Hendry Solar Energy Center, Hendry County.....	342
14. Preferred Site #14 – Tangelo Solar Energy Center, Okeechobee County.....	347
15. Preferred Site #15 – Wood Stork Solar Energy Center, St. Lucie County.....	352
16. Preferred Site #16 – Indrio Solar Energy Center, St. Lucie County.....	357
17. Preferred Site #17 – Middle Lake Solar Energy Center, Madison County.....	362
18. Preferred Site #18 – Ambersweet Solar Energy Center, Indian River County.....	367
19. Preferred Site #19 – County Line Solar Energy Center, Charlotte/DeSoto County.....	372
20. Preferred Site #20 – Saddle Solar Energy Center, DeSoto County.....	377

---



21.	Preferred Site #21 – Cocoplum Solar Energy Center, Hendry County.....	382
22.	Preferred Site #22 – Catfish Solar Energy Center, Okeechobee County.....	387
23.	Preferred Site #23 – Hardwood Hammock Solar Energy Center, Walton County.....	392
24.	Preferred Site #24 – Maple Trail Solar Energy Center, Baker County.....	397
25.	Preferred Site #25 – Pinecone Solar Energy Center, Calhoun County.....	402
26.	Preferred Site #26 – Joshua Creek Solar Energy Center, DeSoto County.....	407
27.	Preferred Site #27 – Spanish Moss Solar Energy Center, St. Lucie County.....	412
28.	Preferred Site #28 – Vernia Solar Energy Center, Indian River County.....	417
29.	Preferred Site #29 – LaBelle Solar Energy Center, Hendry County.....	422
30.	Preferred Site #30 – Lansing Smith Battery Energy Storage System Center, Bay County.....	427
31.	Preferred Site #31 – Putnam Battery Energy Storage System Center, Putnam County.....	432
32.	Preferred Site #32 – Turkey Point Units 6 & 7, Miami-Dade County.....	437

C.	Potential Sites .....	442
1.	Potential Site #1 – Waveland Solar Energy Center, St. Lucie County.....	443
2.	Potential Site #2 – Inlet Solar Energy Center, Indian River County.....	447
3.	Potential Site #3 – Wabasso Solar Energy Center, Indian River County.....	451
4.	Potential Site #4 – Shores Solar Energy Center, Indian River County.....	455
5.	Potential Site #5 – Beachland Solar Energy Center, Indian River County.....	459
6.	Potential Site #6 – Treefrog Solar Energy Center, Collier County.....	463
7.	Potential Site #7 – Honeybee Branch Solar Energy Center, Collier County.....	467
8.	Potential Site #8 – Bromeliad Solar Energy Center, Collier County.....	471
9.	Potential Site #9 – Myakka Solar Energy Center, Manatee County.....	475
10.	Potential Site #10 – Sand Gully Solar Energy Center, DeSoto County.....	479
11.	Potential Site #11 – Gum Creek Solar Energy Center, Jackson County.....	483

12.	Potential Site #12 – Cardinal Solar Energy Center, Indian River	
	County .....	487
13.	Potential Site #13 – Pine Lily Solar Energy Center, St. Lucie	
	County .....	491
14.	Potential Site #14 – Wild Lime Solar Energy Center, St. Lucie	
	County .....	495
15.	Potential Site #15 – Spoonbill Solar Energy Center, Collier	
	County .....	499
16.	Potential Site #16 – Shell Creek Solar Energy Center,	
	Charlotte/DeSoto County .....	503
17.	Potential Site #17 – Carlton Solar Energy Center, St. Lucie	
	County .....	507
18.	Potential Site #18 – Owen Branch Solar Energy Center, Manatee	
	County .....	511

## List of Figures, Tables, and Maps

<b>Figure ES-1</b>	<b>Nuclear and Solar Energy as a Percentage of Net Electric Load .....</b>	<b>7</b>
<b>Figure ES-2</b>	<b>FPL System Heat Rate (2001-2024) .....</b>	<b>14</b>
<b>Table ES-1</b>	<b>Resource Additions/Subtractions in FPL's Resource Plan .....</b>	<b>16</b>
<b>Figure I.A.2.1</b>	<b>FPL's Generating Resources by Location (as of December 31, 2024) .....</b>	<b>21</b>
<b>Table I.A.2.1</b>	<b>FPL's Generating Resources by Unit Type (as of December 31, 2024) .....</b>	<b>22</b>
<b>Figure I.A.2.2</b>	<b>FPL's Bulk Transmission System .....</b>	<b>26</b>
<b>Table I.A.3.1</b>	<b>FPL's Purchased Power Resources by Contract (as of December 31, 2024) .....</b>	<b>28</b>
<b>Table I.A.3.2</b>	<b>FPL's Firm Purchased Power Summer MW .....</b>	<b>29</b>
<b>Table I.A.3.3</b>	<b>FPL's Firm Purchased Power Winter MW .....</b>	<b>30</b>
<b>Figure III.A.1</b>	<b>Overview of IRP Process .....</b>	<b>72</b>
<b>Table III.E.1</b>	<b>List of Proposed Power Lines .....</b>	<b>93</b>
<b>Table III.F.1</b>	<b>List of FPL-Owned Solar Facilities Through April 1<sup>st</sup>, 2025 .....</b>	<b>135</b>
<b>Table III.F.2</b>	<b>List of FPL Battery Storage Facilities .....</b>	<b>145</b>
<b>Table IV.C.1</b>	<b>2024 FPL Environmental Outreach Activities .....</b>	<b>257</b>
<b>Table IV.G.1</b>	<b>List of Preferred Sites .....</b>	<b>262</b>
<b>Table IV.G.2</b>	<b>List of Potential Sites .....</b>	<b>264</b>
<b>Figure A.A.1</b>	<b>Relationship of Regional Hydrogeologic Units to Major Stratigraphic Units .....</b>	<b>279</b>
<b>Figure A.A.2</b>	<b>Florida Regions Map .....</b>	<b>280</b>

## List of Schedules

<b>Schedule 1</b>	<b>FPL Existing Generating Facilities as of December 31, 2024 .....</b>	<b>32</b>
<b>Schedule 2.1</b>	<b>History of Energy Consumption &amp; Number of Customers by Customer Class .....</b>	<b>55</b>
<b>Schedule 2.1</b>	<b>Forecast of Energy Consumption &amp; Number of Customers by Customer Class .....</b>	<b>56</b>
<b>Schedule 2.2</b>	<b>History of Energy Consumption &amp; Number of Customers by Customer Class (Continued) .....</b>	<b>57</b>
<b>Schedule 2.2</b>	<b>Forecast of Energy Consumption &amp; Number of Customers by Customer Class (Continued) .....</b>	<b>58</b>
<b>Schedule 2.3</b>	<b>History of Energy Consumption &amp; Number of Customers by Customer Class (Continued) .....</b>	<b>59</b>
<b>Schedule 2.3</b>	<b>Forecast of Energy Consumption &amp; Number of Customers by Customer Class (Continued) .....</b>	<b>60</b>
<b>Schedule 3.1</b>	<b>History of Summer Peak Demand (MW) .....</b>	<b>61</b>
<b>Schedule 3.1</b>	<b>Forecast of Summer Peak Demand (MW) .....</b>	<b>62</b>
<b>Schedule 3.2</b>	<b>History of Winter Peak Demand (MW) .....</b>	<b>63</b>
<b>Schedule 3.2</b>	<b>Forecast of Winter Peak Demand (MW) .....</b>	<b>64</b>
<b>Schedule 3.3</b>	<b>History of Annual Net Energy for Load (GWh) .....</b>	<b>65</b>
<b>Schedule 3.3</b>	<b>Forecast of Annual Net Energy for Load (GWh) .....</b>	<b>66</b>
<b>Schedule 4</b>	<b>Previous Year Actual and Two-Year Forecast of Total Peak Demand And Net Energy for Load (NEL) by Month .....</b>	<b>67</b>
<b>Schedule 5</b>	<b>Actual Fuel Requirements .....</b>	<b>155</b>
<b>Schedule 5</b>	<b>Forecasted Fuel Requirements .....</b>	<b>156</b>
<b>Schedule 6.1</b>	<b>Actual Energy Sources .....</b>	<b>157</b>
<b>Schedule 6.1</b>	<b>Forecasted Energy Sources .....</b>	<b>158</b>
<b>Schedule 6.2</b>	<b>Actual Energy Sources % by Fuel Type .....</b>	<b>159</b>
<b>Schedule 6.2</b>	<b>Forecasted Energy Sources % by Fuel Type .....</b>	<b>160</b>

<b>Schedule 7.1</b>	<b>Forecast of Capacity, Demand, and Scheduled Maintenance at Time Of Summer Peak .....</b>	<b>161</b>
<b>Schedule 7.2</b>	<b>Forecast of Capacity, Demand, and Scheduled Maintenance at Time of Winter Peak .....</b>	<b>162</b>
<b>Schedule 8</b>	<b>Planned and Prospective Generating Facility Additions and Changes .....</b>	<b>163</b>
<b>Schedule 9</b>	<b>Status Report and Specifications of Proposed Generating Facilities.....</b>	<b>166</b>
<b>Schedule 10</b>	<b>Status Report and Specifications of Proposed Transmission Lines .....</b>	<b>211</b>
<b>Schedule 11.1</b>	<b>FPL Existing Firm and Non-Firm Capacity and Energy by Primary Fuel Type Actuals for the Year 2024 .....</b>	<b>249</b>
<b>Schedule 11.2</b>	<b>FPL Existing Non-Firm Self-Service Renewable Generation Facilities Actuals for the Year 2024 .....</b>	<b>250</b>
<b>Schedule 11.3</b>	<b>FPL Renewable Capacity and Energy Projections, 2025-2034 .....</b>	<b>251</b>



***(This page is intentionally left blank.)***

## **Overview of the Document**

Chapter 186, Florida Statutes, requires that each electric utility in the State of Florida with a minimum existing generating capacity of 250 megawatts (MW) must annually submit a Ten-Year Power Plant Site Plan (Site Plan). This Site Plan should include an estimate of the utility's future electric power generating needs, a projection of how these estimated generating needs could be met, and disclosure of information pertaining to the utility's Preferred and Potential power plant sites. The information contained in this Site Plan is compiled and presented in accordance with Rules 25-22.070, 25-22.071, and 25-22.072, Florida Administrative Code (F.A.C.).

Site Plans are long-term planning documents and should be viewed in this context. A Site Plan contains uncertain forecasts and tentative planning information. Forecasts evolve, and all planning information is subject to change, at the discretion of the utility. Much of the data submitted is preliminary in nature and is presented in a general manner. Specific and detailed data will be submitted as part of the Florida site certification process, or through other proceedings and filings, at the appropriate time.

This Site Plan document addresses Florida Power & Light Company (FPL), which includes the service area of the former Gulf Power Company (Gulf). NextEra Energy, Inc. (NextEra Energy), the parent company of FPL, acquired Gulf in January 2019. Resource planning is now being done for the single entity of FPL, with Gulf's former service area now referred to as FPL's Northwest Florida Division (FPL NWFL). The information presented in this Site Plan is based on integrated resource planning (IRP) analyses that were carried out in 2024 and the 1<sup>st</sup> Quarter of 2025. The forecasted information presented in this plan addresses the years 2025 through 2034.

This document is organized in the following manner:

### **Chapter I – Description of Existing Resources**

This chapter provides an overview of FPL's current generating facilities. Also included is information on other FPL resources including purchased power, demand-side management (DSM), and FPL's transmission system.

## **Chapter II – Forecast of Electric Power Demand**

The load forecasting methodology utilized for FPL, and the resulting forecast of seasonal peaks and annual energy usage, are presented in Chapter II. Included in this discussion is the projected significant impact of federal and state energy efficiency codes and standards.

## **Chapter III – Projection of Incremental Resource Additions**

This chapter discusses the IRP process and presents currently projected resource additions for FPL. This chapter also discusses a number of factors or issues that either have changed, or may change, the resource plan presented in this Site Plan. Furthermore, this chapter also discusses previous and planned DSM efforts, the projected significant impact of state/federal energy efficiency codes and standards, previous and planned renewable energy efforts, projected transmission additions, and the fuel cost forecasting processes.

## **Chapter IV – Environmental and Land Use Information**

This chapter discusses environmental information as well as Preferred and Potential Site locations for additional electric generation facilities for FPL.

Site descriptions and site maps for Preferred and Potential sites are located in the Appendix.

## **Chapter V – Other Planning Assumptions and Information**

This chapter addresses twelve (12) "discussion items" which pertain to additional information that is included in a Site Plan filing.

## **Appendix – Site Descriptions and Site Maps for Preferred and Potential Sites.**

The appendix includes all site descriptions and maps for the Preferred and Potential Sites that were included in Chapter IV.

<b>FPL</b> <b>List of Abbreviations</b> <b>Used in Forms</b>		
<b>Reference</b>	<b>Abbreviation</b>	<b>Definition</b>
Unit Type	BS	Battery Storage
	CC	Combined Cycle
	CT	Combustion Turbine
	GT	Gas Turbine
	PV	Photovoltaic
	ST	Steam Unit (Fossil or Nuclear)
	IC	Internal Combustion
Fuel Type	BIT	Bituminous Coal
	FO2	#1, #2 or Kerosene Oil (Distillate)
	FO6	#4,#5,#6 Oil (Heavy)
	N/A	Not Applicable
	NG	Natural Gas
	No	None
	NUC	Uranium
	Pet	Petroleum Coke
	Solar	Solar Energy
	SUB	Sub Bituminous Coal
	ULSD	Ultra - Low Sulfur Distillate
Fuel Transportation	N/A	Not Applicable
	No	None
	PL	Pipeline
	RR	Railroad
	TK	Truck
	WA	Water
Unit/Site Status	L	Regulatory approval pending. Not under construction
	OP	Operating Unit
	OT	Other
	P	Planned Unit
	RT	Retired
	T	Regulatory approval received but not under construction
	U	Under construction, less than or equal to 50% Complete
	V	Under construction, more than 50% Complete
Other	ESP	Electrostatic Precipitators
	k-Factor	The k-factor for the capital costs of a given unit is the cumulative present value of revenue requirements (CPVRR) divided by the total installed cost
	ST	Solar Together
	SoBRA	Solar Rate Base Adjustment

***(This page is intentionally left blank.)***



## **Executive Summary**

This Site Plan addresses the projected electric power generating resource additions and retirements for the years 2025 through 2034 for FPL.

### **I. Background / Overview of FPL's 2025 Site Plan**

This 2025 Site Plan presents the current plans to augment and enhance the electric generation capability of the FPL system to meet projected incremental resource needs for a reliable and economic electric system for 2025 through 2034. As customers continue to move into FPL's service area and extreme weather events occur with more frequency, it is more important than ever that FPL has sufficient resources to meet continued growth, maintain adequate reserves, and provide reliable energy at all times. In order to meet these needs economically, FPL is planning on the following actions during the ten-year reporting period of this document:


- 1) Install 17,433 MW of cost-effective, solar generation - These solar additions will generate reliable energy using no fuel, which mitigates the commodity price risk to customers, enhances fuel diversity and helps secure Florida's energy independence.
- 2) Install 7,603 MW of battery storage – As a complement to FPL's planned solar additions, FPL is planning to deploy 7,603 MW of battery storage, which provides cost-effective capacity, regardless of the time of day or the weather conditions. These additions enable solar energy produced during the day to be stored and delivered even when the sun is not shining. Storage acts as a key resource that improves system reliability and resource adequacy by addressing the evening peak cost-effectively.
- 3) Develop natural gas capacity for a potential in-service date of 2032 – Solar and battery storage remain the most-cost effective resource options as well as the only viable options to meet FPL's needs in the near-term. However, long-term trends of load growth require FPL to continually examine other options to provide resource adequacy to its customers when they need it the most. Consequently, FPL projects 475 MW of combustion turbine (CT) capacity coming online in 2032.

As FPL's system continues to incorporate additional cost-effective solar generation, the Company is continuing to adapt its resource planning to meet customers' reliability needs through available, dispatchable resources that provide value to customers. Just as FPL's system has advanced and modernized over time to incorporate a wide variety of resource options, resource adequacy must also be modernized to consider conditions that affect the delivery of power in times of greatest need. FPL's proposed resource additions in this plan are a result of a comprehensive, stochastic loss of load

probability (LOLP) analysis designed so that FPL's proposed system additions optimally address system needs for each hour of the year. This enhancement of an existing reliability criterion factors in variations in system load, generating unit outages, and solar performance results in a resource plan that provides reliability for customers throughout the year in a variety of system conditions.

Regarding FPL's fuel mix, FPL delivered approximately 28% of its energy from nuclear and solar generation during 2024. Nearly all the remainder of FPL's energy generation in 2024 came from natural gas. By 2034, the last year of the ten-year reporting period addressed in this document, the percentage of the total energy delivered to all customers on FPL's system from nuclear and solar generation is projected to be approximately 53%. New cost-effective solar will also provide fuel diversity and energy independence by reducing the amount of natural gas FPL will use to generate electricity compared to the present day and adding battery storage will provide cost-effective capacity to help maintain system reliability. This diversity will also help to act as a hedge against swings in natural gas price volatility, providing additional savings to FPL customers during these periods. The graph below in Figure ES-1 represents a ten-year projection for the years 2025 through 2034 of the percentage of FPL's total generation (GWh) consisting of nuclear and solar, a result of FPL's commitment to building the lowest cost generation for customers. Further details regarding projections of energy by fuel/generation type are presented in Schedules 6.1 and 6.2 in Chapter III.

**Figure ES-1: Nuclear and Solar Energy as a Percentage of Net Electric Load**

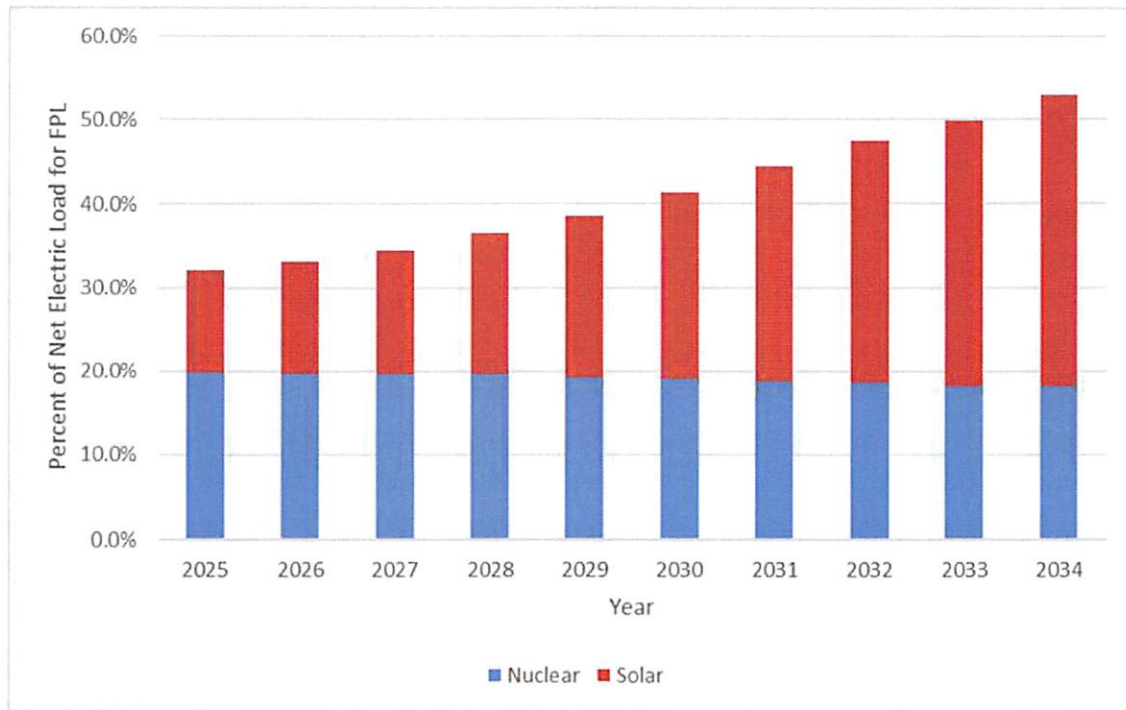

By design, the primary focus of this document is on projected supply side additions, *i.e.*, electric generation capability and the sites for these additions. The supply side additions discussed herein are resources projected to be needed after accounting for existing and projected demand-side management (DSM) resources (including demand response and energy efficiency). In April of 2024, FPL filed its DSM Goals for the period of 2025 through 2034, and these Goals were approved by the FPSC on December 3, 2024. These DSM Goals address demand-side activities that reduce system peak loads and annual energy usage, along with consideration of the impacts of DSM on electric rates under which all customers are served. DSM is discussed in more detail in Chapters I, II, and III.

Additionally, FPL's load forecast accounts for a very large amount of energy efficiency that results from federal and state energy efficiency codes and standards. The projected impacts of these energy efficiency codes and standards are discussed later in this Executive Summary and in Chapters II and III. The updated load forecast presented in this Site Plan also accounts for the projected impact of both private rooftop photovoltaic (PV) solar and electric vehicle (EV) adoption.

FPL's projected resource additions and retirements over the ten-year reporting period are summarized below in Section II of this Executive Summary. In addition, there are several factors that either have influenced, or may influence, ongoing resource planning efforts. These factors could result in different

resources being added in the future than those presented in this document. These factors are discussed in Section III of this Executive Summary. Additional information regarding these topics is presented later in this document in Chapter III.

## **II. Summary of Projected Changes in Resources:**

A summary of the projected resources, including additions and retirements, is presented below. This discussion is presented in terms of the various types of resource options (such as solar and battery storage) in the resource plan.

### **Solar:**

At the end of 2024, FPL had a total of approximately 7,038 MW<sup>1</sup> of utility-owned solar generation, all of which are PV facilities. These solar sites are located throughout FPL's service area.

The resource plan presented in this Site Plan continues to show significant increases in solar PV resources over the ten-year reporting period. Approximately 17,433 MW of additional, cost-effective PV generation is projected to be added in the 2025 through 2034 time period. These solar MW consist of solar facilities that are projected to be 74.5 MW each. When combining these projected additional solar facilities with the approximately 7,038 MW of solar PV already installed on FPL's system at the end of 2024, FPL's projected total of solar PV by the end of 2034 is 24,471 MW.

FPL received cost recovery approval for the 2025 solar additions in this year's resource plan pursuant to the Solar Base Rate Adjustment (SoBRA) provisions in the 2021 Settlement Agreement<sup>2</sup>. FPL's solar additions in 2026 through 2029 are consistent with FPL's petition for a base rate adjustment filed on February 28, 2025. The other solar additions shown in this Site Plan for the years 2030 through 2034 are based on an expectation that these solar additions will also be shown to be cost-effective. FPL's resource planning work in 2025 and beyond will continue to analyze the projected system economics of these later solar additions. FPL will seek Florida Public Service Commission (FPSC) approval for cost recovery of these later solar additions at appropriate times as has been FPL's practice with previous solar additions.

---

<sup>1</sup> Each reference to PV capacity throughout this Site Plan reflects the nameplate rating, Alternating Current (AC), unless noted otherwise.

<sup>2</sup> The 2025 SoBRA additions were approved by the FPSC in 2024

**Battery Storage:**

Currently, FPL has 469 MW of large-scale, grid-connected battery storage installed on its system at three separate locations. The first of these locations is a battery storage facility with a projected maximum output of 409 MW that was placed in-service at the existing Manatee plant site. This large battery storage facility is charged by solar energy from an existing nearby PV facility. Another 60 MW of battery storage, consisting of two 30 MW battery storage facilities installed at the Echo River and Sunshine Gateway solar centers in the FPL service area, were also placed into service at the end of 2021. Both of these 30 MW battery storage facilities are also charged by existing solar facilities.

For new storage facilities, FPL plans on adding 521.5 MW of battery storage at the end of 2025. FPL's battery storage additions in 2026 through 2029 totaling 3,431 MW are consistent with FPL's petition for a base rate adjustment filed on February 28, 2025. For the 2030 through 2034 time period, FPL plans on adding 3,651 MW of battery storage. In total, FPL's resource plan presented in this Site Plan projects that an additional 7,603 MW (nameplate) of battery storage facilities will be installed by 2034, which results in a total of 8,072 MW by the end of 2034. These battery storage facilities will primarily be sited adjacent to solar throughout FPL's service area. These additions will both improve overall system reliability and increase operational versatility by allowing batteries to be charged by the lowest cost resource available.

In addition to the large-scale batteries that FPL factors into its resource planning analyses, FPL's system also includes several smaller-scale batteries that provide varied services to FPL's system. These batteries are discussed further in Chapter III.

**Development of Potential New Combustion Turbine Generation:**

In the near term, solar and battery storage continue to be the most cost-effective and only available resource options for FPL customers. However, long-term trends of load growth require FPL to examine other options to provide resource adequacy to its customers when they need it the most. Consequently, FPL projects 475 MW of CT capacity coming online in 2032.

**Modernization of FPL's Fossil-Fueled Generation:**

For several years, FPL has undertaken a variety of efforts to modernize its fossil-fueled generation fleet based on cost-effectiveness. These efforts have resulted in substantial enhancements to the fleet of generating units, including improved system fuel efficiency and increased capacity, reduced system air emission rates, and dramatically reduced fuel-related costs for FPL customers. FPL plans to continue these efforts and to further improve the efficiency and capabilities of FPL's generation fleet through two principal initiatives: (i) retirement of existing generating units that are no longer economic to operate and



(ii) enhancements to existing generating units. These modernization efforts are separately described below.

**(i) Retirement of Existing Generating Units That Are No Longer Economic to Operate:**

The resource plan for the 2025 TYSP reflects the retirements of two units: Gulf Clean Energy Center Units 4 & 5. These units will be retired at the end of 2029. In the 2024 TYSP, FPL had previously reflected the retirement of its 25% ownership share (215 MW) in the coal-fueled Scherer Unit 3 in Georgia at the end of 2028. Because the primary owner of Unit 3, Georgia Power, amended its retirement date for Scherer Unit 3, FPL has had to follow suit and push out its retirement date for its interest in that unit to outside of the ten-year period of this Site Plan.

**(ii) Enhancements to Existing Generating Units:**

In previous Site Plans, FPL discussed plans to upgrade the CT components in a number of FPL's existing CC units to continue to add additional summer capacity and improve the overall fuel efficiency of the fleet. These upgrade efforts remain a part of FPL's resource planning. Information regarding the specific units, timing, and magnitude of these upgrades is presented in Schedule 8 in Chapter III.

**Nuclear energy:**

Nuclear energy remains an important factor in FPL's resource planning due to its combination of low fuel cost, around-the-clock operation, and location close to major load centers. FPL's current nuclear fleet consists of four nuclear units located at two sites within its service area. In total, these sites provide approximately 3,500 MW of summer capacity and in 2024, provided 28,009 GWh of energy to FPL's system. This amount of energy represented roughly 19% of FPL's generation in 2024. In order for these units continue to provide around-the-clock energy to FPL's customers, FPL secured Subsequent License Renewals (SLR) for both units at Turkey Point and is in the process of securing SLRs for both units at St. Lucie. More detailed information on these re-licensing efforts is available in Chapter III. For purposes of this Site Plan, FPL's resource planning analyses have assumed the continued operation of Turkey Point Units 3 & 4 through 2052 and 2053, respectively and St. Lucie Units 1 & 2 through 2056 and 2063, respectively.

Regarding potential future nuclear additions, in June 2009, FPL began the process of securing Combined Operating Licenses (COL) from the federal Nuclear Regulatory Commission (NRC) for two future nuclear units, Turkey Point Units 6 & 7, that would be sited at FPL's Turkey Point site (the location of two existing nuclear generating units). In April 2018, FPL received NRC approval for these two COLs, and these licenses currently remain valid with the earliest possible in-service dates for Turkey Point 6 & 7 beyond

the ten-year period addressed in this 2025 Site Plan. FPL is also continuing to monitor advanced nuclear power options such as small modular reactors (SMR). Should SMR plants become a commercially viable technology in the future, FPL is planning to begin the initial stages of Early Site Permitting in 2026-2027 timeframe, available under NRC rules, for a potential SMR at a site that is adjacent to an existing nuclear power plant. This strategic move is aimed at minimizing risks, allowing emerging technologies to mature, and enabling robust and well-developed regulatory frameworks prior to deployment, while remaining cognizant of the current high costs of nuclear and SMR development and taking a stepwise approach. FPL is closely monitoring current initiatives at both the Department of Energy and the NRC. By taking these steps early on, FPL aims to be well-positioned to benefit from potential state and federal incentives for future nuclear deployment. The projected in-service date of an SMR would be outside the ten-year period addressed in this Site Plan.

### **III. Other Factors That Have Influenced, or Could Further Influence, FPL's Resource Planning Work:**

There are a number of factors that have influenced, or which may influence, FPL's resource planning work. These ten other factors are summarized below. These additional factors are presented in no particular order, and their potential influences on FPL's resource planning work are further discussed in Chapters II and III.

Factor # 1: Continued Impacts of Tax Credits for Batteries and Solar. FPL's resource planning work continues to factor in tax credits for new utility-owned batteries and solar. For new utility owned standalone batteries, the 30% Investment Tax Credit (ITC) effectively lowers the capital cost for a new battery, with the potential of an additional 10% if the battery is located in a specific area. For new utility-owned solar, a utility can elect a Production Tax Credit (PTC) for new solar that is based on the amount of energy (MWh) the new solar facility generates each year for the first ten years of operation. For future resource additions, the PTC rate in 2025 starts at \$30 for each MWh generated.<sup>3</sup> The \$30 per MWh credit amount for a new solar facility that comes in-service increases with inflation each year. FPL's resource plan presented in this Site Plan accounts for the effects of these tax credits.

Factor # 2: The critical need to maintain a balance between load and generating capacity in specific regions of FPL's service area, such as in Northwest Florida and Southeastern Florida (Miami-Dade and

---

<sup>3</sup> To give an idea of the magnitude of the impact of the solar PTC, consider a simple example of a 75 MW solar facility that produces approximately 150,000 MWh per year in 2025 (*i.e.*, if assuming a net capacity factor of 23%). The proposed solar PTC for that year would result in a tax credit of (150,000 MWh x \$30/MWh =) \$4.5 million. This first year tax credit would then be extended for nine more years while being adjusted for inflation.

Broward counties). This balance has both reliability and economic implications for FPL's system and customers, and it is a key reason that FPL has expanded generation and transmission in specific areas in the past. The battery storage units that FPL is adding throughout the ten-year period will aid in addressing these balance concerns.

Factor # 3: The desire to maintain/enhance fuel diversity in the FPL system while considering system economics and reliability. Diversity is sought in terms of the types of fuel that FPL utilizes and how these fuels are transported to the locations of FPL's generation units. These fuel diversity objectives are considered in light of economic impacts to FPL's customers. For example, FPL is projecting the addition of significant amounts of cost-effective PV generation throughout the ten-year reporting period of this document. These PV additions enhance fuel diversity while at the same time allowing for the lowest cost generation resource to be constructed and operated. To enhance the reliability of these PV solar additions, FPL is planning to add cost-effective battery storage to maintain adequate generation and reserves at the time of the net system peak (FPL's peak after accounting for solar generation). At the same time, FPL is continuing to retire generating units that are no longer cost-effective for FPL customers. In addition, FPL also seeks to: 1) further enhance the efficiency with which it uses natural gas to generate electricity, 2) maintain the ability to use backup distillate oil that is stored on-site at many of FPL's gas-fueled generating units for purposes of system reliability, and 3) examine the ability of existing units to run on alternative clean fuels, such as hydrogen and renewable natural gas. All of the aforementioned additions enhance the overall fuel diversity of FPL's system which increases the energy independence of FPL's customers in the State of Florida.

Factor # 4: The need to maintain an appropriate balance of DSM and supply resources from the perspectives of both system reliability and operations. FPL addresses this through the use of a 10% generation-only reserve margin (GRM) reliability criterion to complement its other two reliability criteria: a 20%<sup>4</sup> total reserve margin criterion for Summer and Winter, and an annual 0.1 day/year LOLP criterion. Together, these three criteria allow FPL to address this specific concern regarding system reliability and operations in a comprehensive manner.

Factor # 5: The significant impact of federal and state energy efficiency codes and standards. The incremental impacts of these energy efficiency codes and standards are projected to have significant impacts by reducing forecasted Summer and Winter peak loads, and by reducing annual net energy for

---

<sup>4</sup> The 20% reserve margin requirement is a minimum requirement – FPL's projected reserve margin may be higher than 20% during some years as additional resources are added for resource needs and meeting other reliability criteria.

load (NEL), in FPL's system. From the end of 2024 through the year 2034, these energy efficiency codes and standards are projected to reduce Summer peak load by approximately 2,000 MW, reduce Winter peak load by approximately 520 MW, and reduce annual energy usage by approximately 2,460 GWh. In addition, energy efficiency codes and standards significantly reduce the potential for cost-effective utility DSM programs. The projected impacts of these energy efficiency codes and standards are discussed in more detail in Chapter II.

Factor # 6: The fuel cost and efficiency of FPL's fossil-fueled generation fleet and the avoidance of fuel costs through increased solar generation. There are two main factors that drive utility system costs for FPL's fossil-fueled generation fleet: (i) forecasted natural gas costs, and (ii) the efficiency with which generating units convert fuel into electricity. Forecasted natural gas costs have recently been one of the lowest cost options for fuel, leading to low overall system fuel costs for FPL's customers when compared with fuels such as oil and coal. In addition to these low natural gas costs, FPL customers also experience lower rates resulting from two other characteristics of FPL's system: 1) the amount of solar generation on FPL's system and 2) the efficiency of FPL's fossil-fueled generating units.


In 2024, FPL projects that its customers saved approximately \$218 million in system fuel costs from having solar generation on its system. Since 2017 (when FPL began scaling investment in cost-effective large scale universal solar facilities), FPL has avoided approximately \$1.1 billion of fuel costs because of its solar generation.

FPL has built a generating fleet that is increasingly fuel efficient. The amount of natural gas (measured in British Thermal Units, or BTU) needed to produce a kilowatt-hour (kWh) of electricity has declined from approximately 9,621 in 2001 to approximately 7,095 in 2024 as shown in Figure ES-2 below. This improvement of approximately 27% in fuel efficiency is truly significant, especially when considering the 20,000 MW-plus magnitude of gas-fueled generation on FPL's system. This trend of increasing system efficiency is very beneficial to a utility's customers as it helps to lower customers' electric rates.<sup>5</sup>

---

<sup>5</sup> However, because the potential benefits of utility DSM programs are based on DSM's ability to avoid utility system costs, such as fuel costs, the trend of steadily decreasing system fuel \$/MWh costs automatically results in a significant lowering of the cost-effectiveness of utility DSM programs that focus on reducing annual energy use.

**Figure ES-2: FPL System Heat Rate (2001-2024)**

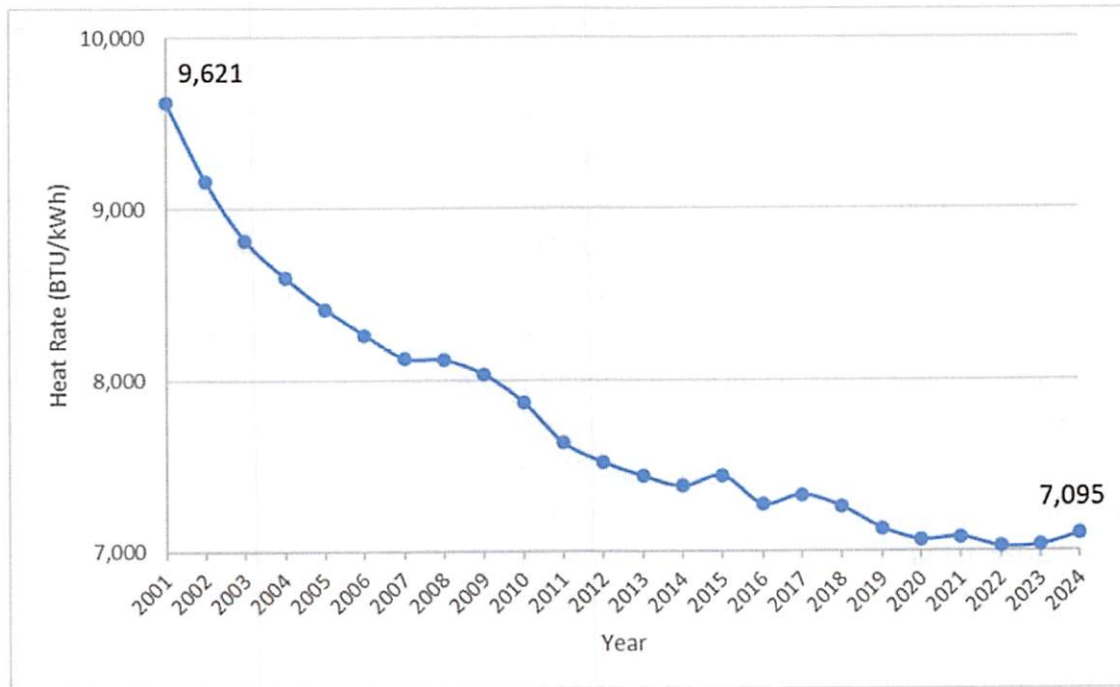

This significant improvement in FPL's fuel efficiency has resulted in FPL customers saving \$650 million in fuel costs in 2024, and an estimated cumulative savings for FPL customers of approximately \$15.3 billion from 2001 through 2024.

Factor # 7: Projected changes in CO<sub>2</sub> regulation and associated compliance costs. Since 2007, FPL has evaluated potential carbon dioxide (CO<sub>2</sub>) regulation and/or legislation and has utilized projected compliance costs for CO<sub>2</sub> emissions prepared by an independent consultant, ICF, in its resource planning work. FPL continues to utilize ICF's forecast of projected CO<sub>2</sub> compliance costs in its resource planning process. The projected compliance costs in the current plan are the same as those used in the 2024 Ten Year Site Plan.

Factor # 8: Projected increases in electric vehicle (EV) adoption. FPL's current load forecast continues to project increasing levels of EV adoption throughout the ten-year period. These projected impacts of EVs on annual energy usage and peak loads are discussed later in this document in Chapter II.

Factor # 9: Enhancing system reliability to prepare for extreme weather events. Over the past several years, extreme weather events have caused significant outages and disruptions to electric grids across the country. These events include widespread hot weather in California in the summer of 2020, historic

cold weather in February 2021 in Texas, and extreme cold conditions throughout the Mid-Atlantic and Southeast around Christmas of 2022. FPL's Northwest FL area has continually set records in winter peak demand, including its latest record peak early in 2025 when widespread snowfall occurred throughout northern Florida. In addition to these events, FPL's service area regularly experiences periods of hotter than average weather throughout the year and hurricanes that can potentially affect the output of its generation fleet. While FPL does not plan its system around extreme events, it continues to believe it is prudent to consider and prepare for the possibility of extreme weather events and the ability to reliably serve customers under those circumstances. To that end, FPL has reviewed the lessons learned from the outages and service disruptions experienced in other jurisdictions and enhanced its own system so that it is adequately prepared. This includes winterizing FPL's nuclear and fossil-fueled generation units, enhancing cooperation and preparation between FPL and suppliers of natural gas and fuel oil, and keeping generation units as "extreme winter only" units that will provide the lowest cost backup capacity in the event of extreme winter weather in FPL's service area. The battery storage units that FPL is adding throughout the ten-year period will also provide additional reliable capacity during extreme weather events.

FPL will continue to work with regulatory authorities, such as the Federal Energy Regulatory Commission (FERC), the FPSC, and the North American Electric Reliability Corporation (NERC), to follow their guidance regarding proper planning procedures for extreme weather events.

Factor # 10: Enhancing the system for resource adequacy and system reliability throughout the entire year.

FPL's planning processes center around maintaining the reliability of its bulk electric system. For over the past two decades, the metric that drove most of FPL's reliability needs was its minimum 20% standard reserve margin, calculated at the time of summer and winter peak load. However, FPL's evolving system requires more in-depth reliability metrics to fully analyze resource adequacy across every hour of the year and through various potential scenarios, including variations in load, generating outages, and solar performance. Therefore, FPL has expanded use of its LOLP metric to include stochastic modeling that fully encompasses all of these scenarios, leading to a more robust evaluation of the reliability and resource adequacy of FPL's system. FPL's planned resources in this Site Plan address resource adequacy concerns by adding a variety of resources throughout the ten-year period that results in a robust, reliable, and cost-effective system to serve FPL's customers. This expanded methodology is discussed more thoroughly in Chapter III.

Each of these factors described above will continue to be examined in FPL's ongoing resource planning work in 2025 and future years.

#### IV. FPL's Projected Resource Plan:

FPL's projected resource plan for the 2025 Site Plan is shown below. Regarding the resources projected in the Site Plan, no final decisions are needed at this time, nor have any decisions been made regarding many of the resource additions shown in the resource plan presented in this 2025 Site Plan. This is particularly relevant to resource additions shown for the years 2030 through 2034. Consequently, resource additions shown for these later years are more prone to change in the future.

**Table ES-1: Resource Additions/Subtractions in FPL's Resource Plan**

Year	Changes to Existing Generation	Subtractions	New Generation Additions	Summer RM%
2025	+18 MW CC Upgrades	Pea Ridge (12 MW)	894 MW SoBRA*	22.4
2026			521.5 MW Battery NWFL** 894 MW Solar 1,419.5 MW Battery	24.1
2027	+48 MW CC Upgrades	Broward South (4 MW)	1,192 MW Solar 819.5 MW Battery	27.2
2028	+14 MW CC Upgrades	Lansing Smith 3A (32 MW)	1,490 MW Solar 596 MW Battery	26.6
2029		GCEC 4 (75 MW), GCEC 5 (75 MW)	1,788 MW Solar 596 MW Battery	26.3
2030		Perdido 1&2 (3 MW)	2,235 MW Solar 596 MW Battery	25.8
2031			2,235 MW Solar 596 MW Battery	25.7
2032		Palm Beach SWA 1 (40 MW)	2,235 MW Solar 2x0 Manatee CT (475 MW)	25.4
2033			2,235 MW Solar 1,192 MW Battery	25.5
2034			2,235 MW Solar 1,267 MW Battery	25.1
Nameplate Solar Additions (2025-2034):			17,433	
Nameplate Storage Additions (2025-2034):			7,603	

All solar and battery storage additions are in nameplate MW.

\* These solar facilities were approved in FPL's 2021 Rate Case Settlement. All other solar additions will be presented to the FPSC for approval of cost recovery at a later date once the specific sites and costs for these additions are finalized.

\*\* These battery storage units are projected to have an in-service date of October 01, 2025.

***(This page is intentionally left blank.)***



## **CHAPTER I**

---

### **Description of Existing Resources**

***(This page is intentionally left blank.)***

## **I.A FPL System:**

### **I.A.1 Description of Existing Resources**

FPL's service area (including the former Gulf Power area now referred to as FPL NWFL) contains approximately 35,000 square miles. Currently, FPL serves more than 6 million customer accounts representing approximately 12 million people in 43 counties in peninsular and Northwest Florida. These customers are served by a variety of resources including FPL-owned fossil-fuel, renewable (solar), and nuclear generating units; non-utility owned generation; DSM; and purchased power.


### **I.A.2 FPL - Owned Resources**

As of December 31, 2024, FPL owned electric generating resources located at 116 sites distributed geographically throughout its service area and one site in Georgia (partial FPL ownership of one unit). These generating facilities consist of: four nuclear units, one coal steam-unit (the aforementioned partially owned unit in Georgia), 17 combined-cycle (CC) units, six fossil steam units, four gas turbines (GTs), 17 simple-cycle combustion turbines (CTs), two landfill gas units, three battery storage units, and 96 solar PV facilities. The locations of the 150 generating units that were in commercial operation on December 31, 2024, are shown on Figure I.A.2.1 and in Table I.A.2.1.

FPL's bulk transmission system, including both overhead and underground lines, is comprised of approximately 9,500 circuit miles of transmission lines. Integration of the generation, transmission, and distribution systems is achieved through FPL's 921 substations in Florida.

The existing FPL system, including generating plants, major transmission stations, and transmission lines, is shown on Figure I.A.2.2.

## FPL Generating Resources by Location

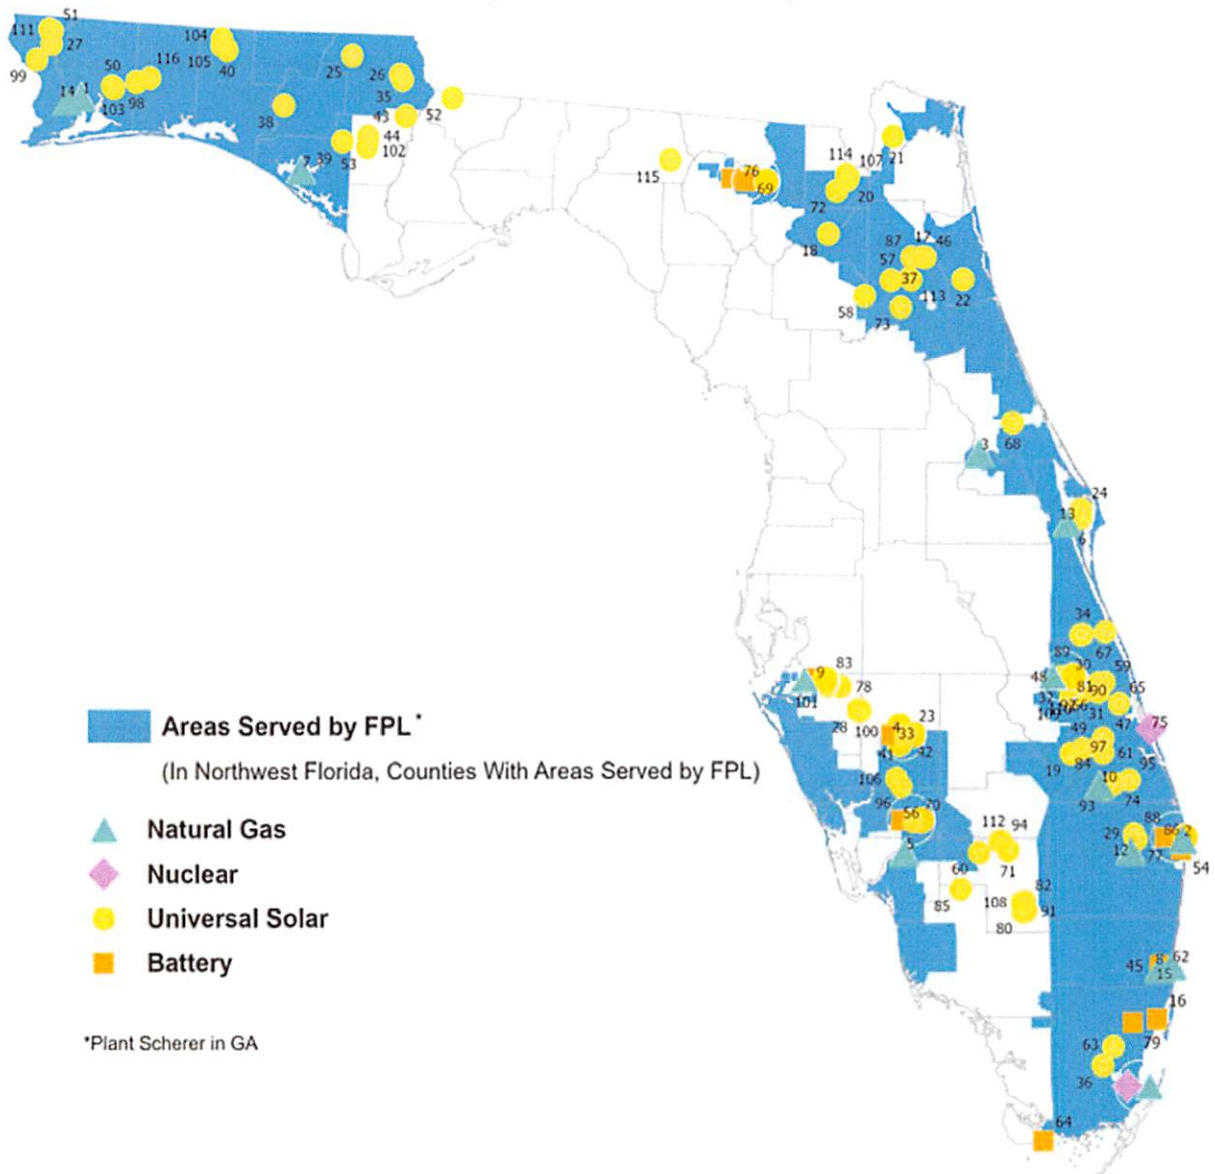

There are four small battery pilot projects shown on the map that are not listed in Table I.A.2: #26 – Florida Bay, #32 – Southwest, #36 – Wynwood, and #57 – FIU Microgrid. These sites are discussed in Chapter III.

**Figure I.A.2.1: FPL’s Generating Resources by Location (as of December 31, 2024)**

**Table I.A.2.1: FPL's Capacity Resources by Unit Type (as of December 31, 2024)**

Page 1 of 4

Map Key #	Unit Type/ Plant Name	Location	Number of Units	Fuel	Summer MW <sup>1/</sup>
<b><u>Nuclear</u></b>					
75	St. Lucie <sup>2/</sup>	St. Lucie County, FL	2	Nuclear	1,821
11	Turkey Point	Miami-Dade County, FL	2	Nuclear	1,681
<b>Total Nuclear:</b>			<b>4</b>		<b>3,502</b>
<b><u>Coal Steam</u></b>					
-	Scherer*	Monroe County, Ga	1	Coal	215
<b>Total Coal Steam:</b>			<b>1</b>		<b>215</b>
<b><u>Combined-Cycle</u></b>					
5	Fort Myers	Lee County, FL	1	Gas	1,822
9	Manatee	Manatee County, FL	1	Gas	1,246
3	Sanford	Volusia County, FL	2	Gas	2,418
7	Lansing Smith*	Bay County, FL	1	Gas	641
13	Cape Canaveral	Brevard County, FL	1	Gas/Oil	1,290
10	Martin	Martin County, FL	3	Gas/Oil	2,223
55	Okeechobee <sup>3/</sup>	Okeechobee County, FL	1	Gas/Oil	1,720
62	Port Everglades	City of Hollywood, FL	1	Gas/Oil	1,237
2	Riviera Beach	City of Riviera Beach, FL	1	Gas/Oil	1,290
11	Turkey Point	Miami-Dade County, FL	1	Gas/Oil	1,292
12	West County	Palm Beach County, FL	3	Gas/Oil	3,771
45	Dania Beach Clean Energy Center	Broward County, FL	1	Gas/Oil	1,246
<b>Total Combined Cycle:</b>			<b>17</b>		<b>20,196</b>
<b><u>Gas/Oil Steam</u></b>					
9	Manatee <sup>4/</sup>	Manatee County, FL	2	Gas/Oil	0
14	Gulf Clean Energy Center*	Escambia County, FL	4	Gas Steam	961
<b>Total Oil/Gas Steam:</b>			<b>6</b>		<b>961</b>
<b><u>Gas Turbines (GT)</u></b>					
5	Fort Myers (GT)	Lee County, FL	2	Oil	102
8	Lauderdale (GT)	Broward County, FL	2	Gas/Oil	69
<b>Total Gas Turbines/Diesels:</b>			<b>4</b>		<b>171</b>
<b><u>Combustion Turbines</u></b>					
8	Lauderdale	Broward County, FL	5	Gas/Oil	1,155
5	Fort Myers	Lee County, FL	4	Gas/Oil	852
1	Pea Ridge*	Santa Rosa County, FL	3	Gas	12
7	Lansing Smith*	Bay County, FL	1	Oil	32
14	Gulf Clean Energy Center*	Escambia County, FL	4	Gas	926
<b>Total Combustion Turbines:</b>			<b>17</b>		<b>2,977</b>
<b><u>Land Fill Gas</u></b>					
69	Perdido LFG*	Escambia County, FL	2	LFG	3
<b>Total LFG:</b>			<b>2</b>		<b>3</b>

1/ The solar capacity values shown are nameplate capacity only, not firm capacity.

Information on Summer and Winter Firm capacity for solar units is provided in Schedule 1.

2/ Total capability of St. Lucie 1 is 981 Summer /1,003 Winter MW, FPL's share of St. Lucie 2 is 840 Summer /860 Winter MW.

FPL's ownership share of St. Lucie Units 1 and 2 is 100% and 85%, respectively.

3/ As part of the Okeechobee Hydrogen Gas Pilot Program, a portion of the CO<sub>2</sub> generated from the unit is transferred to an electrolyzer where it is then converted into Hydrogen Gas.

4/ Manatee Units 1 & 2 are Winter Peaking ONLY units. They will only be manned and operated during an Extreme Winter event in which additional capacity is needed to meet load.

\* Represents units located in the former Gulf Service Area but are now part of FPL's system and fall under the FPL NW region.

Map Key “-” is shown for units that are located outside the State of Florida and therefore do not appear on the Map in Figure I.A.2.1.

**Table I.A.2.1: FPL’s Capacity Resources by Unit Type (as of December 31, 2024)**

Page 2 of 4

Map Key #	Unit Type/ Plant Name	Location	Number of Units	Fuel	Summer MW <sup>1</sup>
<b><u>Battery Storage</u></b>					
9	Manatee Battery Storage	Manatee County, FL	1	Storage	409
69	Sunshine Gateway Battery Storage	Columbia County, FL	1	Storage	30
76	Echo River Battery Storage	Suwannee County, FL	1	Storage	30
<b>Total Battery Storage:</b>			<b>3</b>		<b>469</b>
<b><u>PV</u></b>					
4	DeSoto Solar	DeSoto County, FL	1	Solar Energy	25
56	Babcock Ranch Solar	Charlotte County, FL	1	Solar Energy	74.5
41	Citrus Solar	DeSoto County, FL	1	Solar Energy	74.5
9	Manatee Solar	Manatee County, FL	1	Solar Energy	74.5
6	Space Coast Solar	Brevard County, FL	1	Solar Energy	10
65	Interstate Solar	St. Lucie County, FL	1	Solar Energy	74.5
63	Miami Dade Solar	Miami-Dade County, FL	1	Solar Energy	74.5
68	Pioneer Trail Solar	Volusia County, FL	1	Solar Energy	74.5
69	Sunshine Gateway Solar	Columbia County, FL	1	Solar Energy	74.5
58	Horizon Solar	Alachua County, FL	1	Solar Energy	74.5
42	Wildflower Solar	DeSoto County, FL	1	Solar Energy	74.5
66	Indian River Solar	Indian River County, FL	1	Solar Energy	74.5
57	Coral Farms Solar	Putnam County, FL	1	Solar Energy	74.5
60	Hammock Solar	Hendry County, FL	1	Solar Energy	74.5
67	Barefoot Bay Solar	Brevard County, FL	1	Solar Energy	74.5
59	Blue Cypress Solar	Indian River County, FL	1	Solar Energy	74.5
61	Loggerhead Solar	St. Lucie County, FL	1	Solar Energy	74.5
70	Babcock Preserve Solar	Charlotte County, FL	1	Solar Energy	74.5
71	Blue Heron Solar	Hendry County, FL	1	Solar Energy	74.5
23	Cattle Ranch Solar	DeSoto County, FL	1	Solar Energy	74.5
76	Echo River Solar	Suwannee County, FL	1	Solar Energy	74.5
20	Egret Solar	Baker County, FL	1	Solar Energy	74.5
77	Hibiscus Solar	Palm Beach County, FL	1	Solar Energy	74.5
19	Lakeside Solar	Okeechobee County, FL	1	Solar Energy	74.5
21	Nassau Solar	Nassau County, FL	1	Solar Energy	74.5
72	Northern Preserve Solar	Baker County, FL	1	Solar Energy	74.5
55	Okeechobee Solar	Okeechobee County, FL	1	Solar Energy	74.5
78	Southfork Solar	Manatee County, FL	1	Solar Energy	74.5
74	Sweetbay Solar	Martin County, FL	1	Solar Energy	74.5
22	Trailside Solar	St. Johns County, FL	1	Solar Energy	74.5
73	Twin Lakes Solar	Putnam County, FL	1	Solar Energy	74.5
18	Union Springs Solar	Union County, FL	1	Solar Energy	74.5
17	Magnolia Springs Solar	Clay County, FL	1	Solar Energy	74.5
31	Pelican Solar	St. Lucie County, FL	1	Solar Energy	74.5
34	Palm Bay Solar	Brevard County, FL	1	Solar Energy	74.5
33	Rodeo Solar	DeSoto County, FL	1	Solar Energy	74.5
24	Discovery Solar	Brevard County, FL	1	Solar Energy	74.5
30	Orange Blossom Solar	Indian River County, FL	1	Solar Energy	74.5

1/ The solar capacity values shown are nameplate capacity only, not firm capacity.

Information on Summer and Winter Firm capacity for solar units is provided in Schedule 1.

\* Represents units located in the former Gulf Service Area but are now part of FPL's system and fall under the FPL NW region.

**Table I.A.2.1: FPL's Capacity Resources by Unit Type (as of December 31, 2024)**

Page 3 of 4

Map Key #	Unit Type/ Plant Name	Location	Number of Units	Fuel	Summer MW <sup>1</sup>
<b><u>PV Continued</u></b>					
29	Sabal Palm Solar	Palm Beach County, FL	1	Solar Energy	74.5
32	Fort Drum Solar	Okeechobee County, FL	1	Solar Energy	74.5
28	Willow Solar	Manatee County, FL	1	Solar Energy	74.5
82	Ghost Orchid Solar	Hendry County, FL	1	Solar Energy	74.5
80	Sawgrass Solar	Hendry County, FL	1	Solar Energy	74.5
84	Sundew Solar	St. Lucie County, FL	1	Solar Energy	74.5
85	Immokalee Solar	Collier County, FL	1	Solar Energy	74.5
81	Grove Solar	Indian River County, FL	1	Solar Energy	74.5
83	Elder Branch Solar	Manatee County, FL	1	Solar Energy	74.5
25	Blue Indigo Solar*	Jackson County, FL	1	Solar Energy	74.5
26	Blue Springs Solar*	Jackson County, FL	1	Solar Energy	74.5
27	Cotton Creek Solar*	Escambia County, FL	1	Solar Energy	74.5
46	Anhinga Solar	Clay County, FL	1	Solar Energy	74.5
35	Apalachee Solar*	Jackson County, FL	1	Solar Energy	74.5
50	Blackwater Solar*	Santa Rosa County, FL	1	Solar Energy	74.5
49	Bluefield Preserve Solar	St. Lucie County, FL	1	Solar Energy	74.5
48	Cavendish Solar	Okeechobee County, FL	1	Solar Energy	74.5
40	Chautauqua Solar*	Walton County, FL	1	Solar Energy	74.5
43	Chipola Solar*	Calhoun County, FL	1	Solar Energy	74.5
38	Cypress Pond Solar*	Washington County, FL	1	Solar Energy	74.5
37	Etonia Creek Solar	Putnam County, FL	1	Solar Energy	74.5
36	Everglades Solar	Miami-Dade County, FL	1	Solar Energy	74.5
51	First City Solar*	Escambia County, FL	1	Solar Energy	74.5
44	Flowers Creek Solar*	Calhoun County, FL	1	Solar Energy	74.5
47	Pink Trail Solar	St. Lucie County, FL	1	Solar Energy	74.5
39	Saw Palmetto Solar*	Bay County, FL	1	Solar Energy	74.5
53	Shirer Branch Solar*	Calhoun County, FL	1	Solar Energy	74.5
52	Wild Azalea Solar*	Gadsden County, FL	1	Solar Energy	74.5
91	Beautyberry Solar	Hendry County, FL	1	Solar Energy	74.5
94	Caloosahatchee Solar	Hendry County, FL	1	Solar Energy	74.5
98	Canoe Solar*	Okaloosa County, FL	1	Solar Energy	74.5
89	Ibis Solar	Brevard County, FL	1	Solar Energy	74.5
93	Monarch Solar	Martin County, FL	1	Solar Energy	74.5
90	Orchard Solar	Indian River/St. Lucie County, FL	1	Solar Energy	74.5
97	Pineapple Solar	St. Lucie County, FL	1	Solar Energy	74.5
96	Prairie Creek Solar	DeSoto County, FL	1	Solar Energy	74.5
88	Silver Palm Solar	Palm Beach County, FL	1	Solar Energy	74.5
87	Terrill Creek Solar	Clay County, FL	1	Solar Energy	74.5
92	Turnpike Solar	Indian River County, FL	1	Solar Energy	74.5
95	White Tail Solar	Martin County, FL	1	Solar Energy	74.5
103	Big Juniper Creek Solar*	Calhoun County, FL	1	Solar Energy	74.5
102	Fourmile Creek Solar*	Calhoun County, FL	1	Solar Energy	74.5
106	Hawthorne Creek Solar	DeSoto County, FL	1	Solar Energy	74.5
107	Nature Trail Solar	Baker County, FL	1	Solar Energy	74.5

1/ The solar capacity values shown are nameplate capacity only, not firm capacity.

Information on Summer and Winter Firm capacity for solar units is provided in Schedule 1.

\* Represents units located in the former Gulf Service Area but are now part of FPL's system and fall under the FPL NW region.

**Table I.A.2.1: FPL's Capacity Resources by Unit Type (as of December 31, 2024)**

Page 4 of 4

Map Key#	Unit Type/ Plant Name	Location	Number of Units	Fuel	Summer MW <sup>1</sup>
<u>PV <sup>2</sup> Continued</u>					
104	Pecan Tree Solar*	Walton County, FL	1	Solar Energy	74.5
100	Sambucus Solar	Manatee County, FL	1	Solar Energy	74.5
99	Sparkleberry Solar*	Escambia County, FL	1	Solar Energy	74.5
101	Three Creeks Solar	Manatee County, FL	1	Solar Energy	74.5
105	Wild Quail Solar*	Walton County, FL	1	Solar Energy	74.5
108	Woodyard Solar	Hendry County, FL	1	Solar Energy	74.5
110	Buttonwood Solar	St. Lucie County, FL	1	Solar Energy	74.5
114	Cedar Trail Solar	Baker County, FL	1	Solar Energy	74.5
113	Georges Lakes Solar	Putnam County, FL	1	Solar Energy	74.5
112	Hendry Isles Solar	Hendry County, FL	1	Solar Energy	74.5
109	Honeybell Solar	Okeechobee County, FL	1	Solar Energy	74.5
111	Mitchell Creek Solar*	Escambia County, FL	1	Solar Energy	74.5
116	Kayak Solar*	Okaloosa County, FL	1	Solar Energy	74.5
115	Norton Creek Solar	Madison County, FL	1	Solar Energy	74.5
Total Nameplate PV:			96		7,038
Total Units:			150		35,531
Nameplate System Generation as of December 31, 2024 =					35,531
Firm System Generation as of December 31, 2024 =					31,691

1/ The solar capacity values shown are nameplate capacity only, not firm capacity.

Information on Summer and Winter Firm capacity for solar units is provided in Schedule 1.

\* Represents units located in the former Gulf Service Area but are now part of FPL's system and fall under the FPL NW region.



# FPL Bulk Transmission System



## FPL Substation and Transmission System Configuration

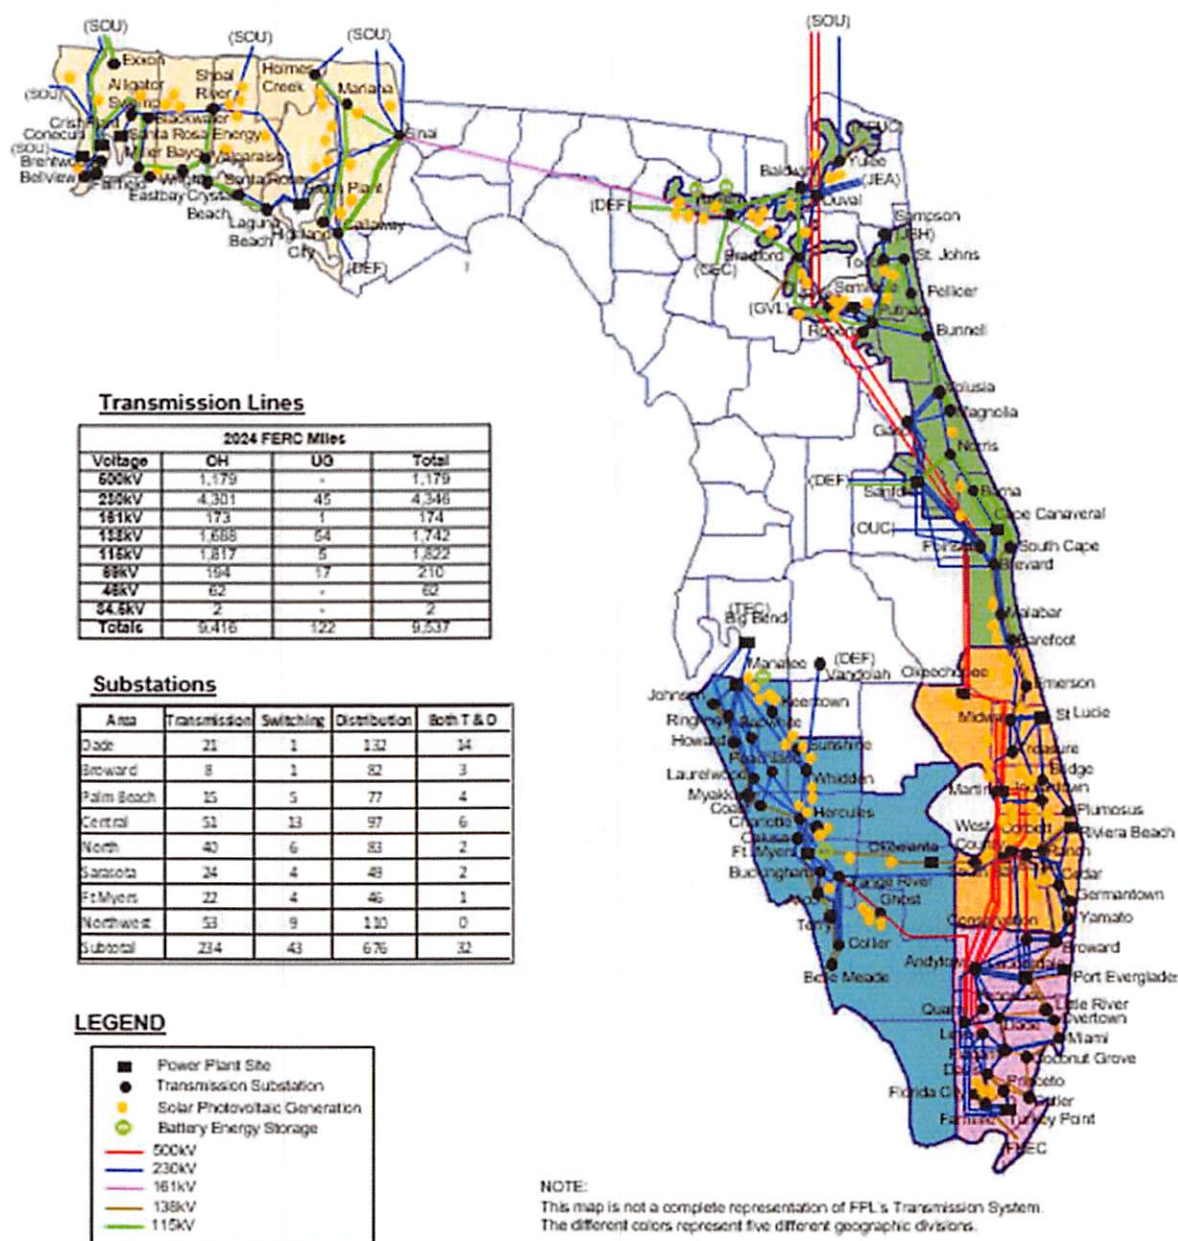


Figure I.A.2.2: FPL Bulk Transmission System

### **I.A.3 FPL - Capacity and Energy Power Purchases**

#### **Firm Capacity: Purchases from Qualifying Facilities (QF)**

Firm capacity power purchases remain part of FPL's resource mix. A cogeneration facility is one that simultaneously produces electrical and thermal energy, with the thermal energy (e.g., steam) used for industrial, commercial, or cooling and heating purposes. A small power production facility is one that does not exceed 80 MW (unless it is exempted from this size limitation by the Solar, Wind, Waste, and Geothermal Power Production Incentives Act of 1990) and uses solar, wind, waste, geothermal, or other renewable resources as its primary energy source.

FPL currently has a contract to purchase firm capacity and energy from the Broward South qualifying facility during the ten-year reporting period of this Site Plan. The 2024 actual and 2025-2034 projected contributions from these facilities are shown in Table I.A.3.1, Table I.A.3.2, and Table I.A.3.3.

#### **Firm Capacity: Purchases from Utilities**

FPL currently does not have any firm purchases from other utilities planned.

#### **Firm Capacity: Other Purchases**

FPL has four other firm capacity purchase contracts. Two of these contracts are with the Palm Beach Solid Waste Authority, and two are with Morgan Stanley Capital Group's Kingfisher I and Kingfisher II wind projects. Table I.A.3.2 and I.A.3.3 present the Summer and Winter MW, respectively, resulting from these contracts under the category heading of Other Purchases.

#### **Non-Firm (As Available) Energy Purchases**

FPL purchases non-firm (as-available) energy from cogeneration and small power production facilities including energy from three solar PV facilities. The lower half of Table I.A.3.1 shows the amount of energy purchased in 2024 from these facilities along with the amount of energy purchased from customer-sited generation.

**Table I.A.3.1: FPL's Purchased Power Resources by Contract (as of December 31, 2024)**

<b>Firm Capacity Purchases (MW)</b>	<b>Location (City or County)</b>	<b>Fuel</b>	<b>Summer MW</b>
<b><u>I. Purchase from QF's: Cogeneration/Small Power Production Facilities</u></b>			
Broward South Landfill (firm)	Broward	Solid Waste	3.5
		<b>Total:</b>	3.5
<b><u>II. Purchases from Utilities &amp; IPP</u></b>			
Santa Rosa, Southern Company Services		Natural Gas	230
Palm Beach SWA - REF 1	Palm Beach	Solid Waste	40
Palm Beach SWA - REF 2	Palm Beach	Solid Waste	70
MSCG - Kingfisher I	Oklahoma	Wind	53
MSCG - Kingfisher II	Oklahoma	Wind	28
		<b>Total:</b>	421
<b>Total Net Firm Generating Capability:</b>			<b>425</b>

<b><u>Non-Firm Energy Purchases (MWH)</u></b>			<b>Energy (MWH) Delivered to FPL in 2024</b>
<b>Project</b>	<b>County</b>	<b>Fuel</b>	
Miami Dade Resource Recovery <sup>1/</sup>	Dade	Solid Waste	-
Broward South Landfill (as-available) <sup>1/</sup>	Broward	Solid Waste	45,118
Lee County Solid Waste <sup>1/</sup>	Lee	Solid Waste	19,532
Next Era energy Resources - Brevard Landfill <sup>1/</sup>	Brevard	Landfill Gas	36,260
Florida Crystals - Okeelanta <sup>1/</sup>	Palm Beach	Bagasse/Wood	38,508
Waste Management Renewable Energy - Collier Landfill <sup>1/</sup>	Collier	Landfill Gas	345
Next Era Energy Resources - Seminole Landfill <sup>1/</sup>	Seminole	Landfill Gas	12,602
Tropicana - Bradenton	Manatee	Natural Gas	10,899
Georgia Pacific Palatka Mill	Putnam	Paper by-product	7,376
Aria Energy - Sarasota Landfill <sup>1/</sup>	Sarasota	Landfill Gas	1,788
Waste Management Renewable Energy - Broward Landfill <sup>1/</sup>	Broward	Landfill Gas	2,186
Fortistar - Charlotte Landfill <sup>1/</sup>	Charlotte	Landfill Gas	102
Customer Owned PV & Wind <sup>1/</sup>	Various	PV/Wind	770,381
International Paper Company <sup>1/</sup>	Escambia	Biomass	968
Ascend Performance Materials	Escambia	Gas	31,356
Gulf Coast Solar Center I , II, III <sup>1/</sup>	Various	Sun	226,722
<b>Total Energy from Renewable Non-Firm Purchases Delivered to FPL in 2024 <sup>1/</sup>:</b>			<b>1,161,888</b>
<b>Total Energy from All Non-Firm Purchases Delivered to FPL in 2024:</b>			<b>1,204,143</b>

1/ These Non-Firm Energy Purchases are renewable and are reflected on Schedule 11.1, row 9, column 6.

**Table I.A.3.2: FPL's Firm Purchased Power Summer MW**

**Summary of FPL's Firm Capacity Purchases: Summer MW (for August of Year Shown)**

**I. Purchases from QF's**

Cogeneration Small Power Production Facilities	Contract Start Date	Contract End Date	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
Broward South Landfill	01/01/93	12/31/26	1.4	1.4	0	0	0	0	0	0	0	0
Broward South Landfill	01/01/95	12/31/26	1.5	1.5	0	0	0	0	0	0	0	0
Broward South Landfill	01/01/97	12/31/26	0.6	0.6	0	0	0	0	0	0	0	0
QF Purchases Subtotal:			3.5	3.5	0.0	0	0	0	0	0	0	0

**II. Purchases from Utilities**

	Contract Start Date	Contract End Date	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
None	-	-	-	-	-	-	-	-	-	-	-	-
Utility Purchases Subtotal:			0	0	0	0	0	0	0	0	0	0

<b>Total of QF and Utility Purchases =</b>			<b>3.5</b>	<b>3.5</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>
--	--	--	------------	------------	------------	------------	------------	----------	----------	----------	----------	----------

**III. Other Purchases**

	Contract Start Date	Contract End Date	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
Palm Beach SWA - REF1 <sup>1/</sup>	01/01/12	04/01/32	40	40	40	40	40	40	40	0	0	0
Palm Beach SWA - REF2	01/01/15	06/01/34	70	70	70	70	70	70	70	70	70	0
MSCG - Kingfisher I <sup>2/</sup>	01/01/17	12/31/35	53	53	53	53	53	53	53	53	53	53
MSCG - Kingfisher II <sup>2/</sup>	01/01/17	12/31/35	28	28	28	28	28	28	28	28	28	28
Gulf Solar PPAs <sup>3/</sup>	11/17/14	12/31/42	41	40	40	40	40	40	40	40	40	40
Other Purchases Subtotal:			232	231	231	231	231	231	231	191	191	121

<b>Total "Non-QF" Purchases =</b>			<b>232</b>	<b>231</b>	<b>231</b>	<b>231</b>	<b>231</b>	<b>231</b>	<b>231</b>	<b>191</b>	<b>191</b>	<b>121</b>
-----------------------------------	--	--	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

<b>Summer Firm Capacity Purchases Total MW:</b>			<b>2025</b>	<b>2026</b>	<b>2027</b>	<b>2028</b>	<b>2029</b>	<b>2030</b>	<b>2031</b>	<b>2032</b>	<b>2033</b>	<b>2034</b>
			<b>235</b>	<b>235</b>	<b>231</b>	<b>231</b>	<b>231</b>	<b>231</b>	<b>231</b>	<b>191</b>	<b>191</b>	<b>121</b>

1/ When the second unit came into commercial service at the Palm Beach SWA, neither unit met the standards to be a small power producer, and these became accounted for under "Other Purchases".

2/ These PPAs are from a variable wind source; however, the PPA supplier has committed to a certain amount of minimum MW per hour which FPL and Gulf treat as firm capacity for resource planning purposes.

3/ These PPAs are non-firm, energy-only contracts due to the unscheduled, intermittent nature of solar resources. For resource planning purposes, a portion of the nameplate rating of the solar facilities has been, and continues to, provide, on average, a non-zero value at the system Summer peak hour.

**Table I.A.3.3: FPL's Firm Purchased Power Winter MW**

**Summary of FPL's Firm Capacity Purchases: Winter MW (for January of Year Shown)**

**I. Purchases from QF's**

Cogeneration Small Power Production Facilities	Contract Start Date	Contract End Date	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
Broward South Landfill	01/01/93	12/31/26	1.4	1.4	0	0	0	0	0	0	0	0
Broward South Landfill	01/01/95	12/31/26	1.5	1.5	0	0	0	0	0	0	0	0
Broward South Landfill	01/01/97	12/31/26	0.6	0.6	0	0	0	0	0	0	0	0
QF Purchases Subtotal:			3.5	3.5	0.0	0.0	0	0	0	0	0	0

**II. Purchases from Utilities**

	Contract Start Date	Contract End Date	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
None	-	-	-	-	-	-	-	-	-	-	-	-
Utility Purchases Subtotal:			0	0	0	0	0	0	0	0	0	0

<b>Total of QF and Utility Purchases =</b>			<b>3.5</b>	<b>3.5</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>
--	--	--	------------	------------	------------	------------	------------	----------	----------	----------	----------	----------

**III. Other Purchases**

	Contract Start Date	Contract End Date	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
Santa Rosa, SCS	06/01/24	04/30/25	230	0	0	0	0	0	0	0	0	0
Palm Beach SWA - REF1 <sup>1/</sup>	01/01/12	04/01/32	40	40	40	40	40	40	40	40	0	0
Palm Beach SWA - REF2	01/01/15	06/01/34	70	70	70	70	70	70	70	70	70	70
MSCG - Kingfisher I <sup>2/</sup>	01/01/17	12/31/35	71	71	71	71	71	71	71	71	71	71
MSCG - Kingfisher II <sup>2/</sup>	01/01/17	12/31/35	38	38	38	38	38	38	38	38	38	38
Gulf Solar PPAs <sup>3/</sup>	11/17/14	12/31/42	0	0	0	0	0	0	0	0	0	0
Other Purchases Subtotal:			449	219	219	219	219	219	219	219	179	179

<b>Total "Non-QF" Purchases =</b>			<b>449</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>179</b>	<b>179</b>
-----------------------------------	--	--	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

<b>Winter Firm Capacity Purchases Total MW:</b>			<b>453</b>	<b>223</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>219</b>	<b>179</b>	<b>179</b>
---	--	--	------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

1/ When the second unit came into commercial service at the Palm Beach SWA, neither unit met the standards to be a small power producer, and these became accounted for under "Other Purchases".

2/ These PPAs are from a variable wind source; however, the PPA supplier has committed to a certain amount of minimum MW per hour which FPL and Gulf treat as firm capacity for resource planning purposes.

3/ These PPAs are non-firm, energy-only contracts due to the unscheduled, intermittent nature of solar resources. For resource planning purposes, a portion of the nameplate rating of the solar facilities has been, and continues to, provide, on average, a non-zero value at the system Summer peak hour.

#### **I.A.4 Demand-Side Management (DSM)**

FPL has continually explored and implemented cost-effective DSM programs since 1978, and it has consistently been among the leading utilities nationally in achieving substantial DSM efficiencies. These programs include innovative conservation/energy efficiency and load management initiatives. In the FPL service area the company's DSM efforts through the end of 2024 have resulted in a cumulative Summer peak reduction of 5,695 MW at the generator and an estimated cumulative energy savings of 102,684 Gigawatt-Hours (GWh) at the generator. After accounting for the 20% total reserve margin requirement, FPL's DSM efforts through 2024 have eliminated the need to construct the equivalent of approximately sixty-eight (68) new 100 MW generating units. Also, it is important to note that FPL has achieved these significant DSM accomplishments while minimizing the DSM-based impact on electric rates for all of its customers by using the Rate Impact Measure (RIM) cost-effectiveness screening calculation approach.

In 2024, the Florida Public Service Commission (FPSC) set DSM Goals for the years 2025 through 2034 for FPL and the other Florida utilities subject to the Florida Energy Efficiency and Conservation Act (FEECA). In March 2025, FPL filed for FPSC approval its DSM Plan with which it intends to meet the DSM Goals. In this Site Plan, FPL assumes that the annual reduction values for Summer MW, Winter MW, and energy (MWh) set forth in the DSM Goals order (Order No. PSC-2024-0505-FOF-EG) will be met as shown in various schedules presented in this Site Plan.

#### **I.A.5 Existing Generating Units in FPL's Service Area**

Schedule 1 presents the generating capacity in FPL's service area as of December 31, 2024.

# Schedule 1: FPL Existing Generating Facilities as of December 31, 2024

Page 1 of 8

Schedule 1																
FPL Existing Generating Facilities As of December 31, 2024																
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	
Plant Name	Unit No.	Area	Location	Unit Type	Fuel Pri.	Fuel Alt.	Fuel Transport.		Fuel Days Use	Commercial In-Service Month/Year	Expected Retirement Month/Year	Gen.Max. Nameplate KW	Net Capability <sup>1/</sup>		Firm Capability <sup>2/</sup>	
							Pri.	Alt.					Winter MW	Summer MW	Winter MW	Summer MW
Anhinga Solar <sup>2/</sup>	1	FPL	Clay County 29.88213,-81.67818	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	1.86	28.46
Apalachee Solar <sup>2/</sup>	1	FPL NWFL	Jackson County 30.76055,-85.06952	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	0.00	36.04
Babcock Preserve Solar <sup>2/</sup>	1	FPL	Charlotte County 32,33/41S/26E : 4/42S/26E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-20	Unknown	74,500	74.5	74.5	0.00	37.24
Babcock Ranch Solar <sup>2/</sup>	1	FPL	Charlotte County 29,31,32/41S/26E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-16	Unknown	74,500	74.5	74.5	0.00	37.38
Barefoot Bay Solar <sup>2/</sup>	1	FPL	Brevard County 1, 10, 15,16/30S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5	0.00	41.42
Beautyberry Solar <sup>2/</sup>	1	FPL	Hendry County 26.373000,-81.026000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	2.55	30.08
Big Juniper Solar <sup>2/</sup>	1	FPL NWFL	Santa Rosa County 30.639000,-86.925000	PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	0.00	36.76
Blackwater Solar <sup>2/</sup>	1	FPL NWFL	Santa Rosa County 30.64691,-86.93821	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	0.00	27.88
Blue Cypress Solar <sup>2/</sup>	1	FPL	Indian River County 16/33S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5	0.00	39.77
Blue Heron Solar <sup>2/</sup>	1	FPL	Hendry County 28,33/43S/32E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-20	Unknown	74,500	74.5	74.5	0.00	37.55
Blue Indigo Solar <sup>2/</sup>	1	FPL NWFL	Jackson County 2/5N/12W : 35,36/6N/12W	PV	Solar	Solar	N/A	N/A	--	Mar-20	Unknown	74,500	74.5	74.5	0.00	49.96
Blue Springs Solar <sup>2/</sup>	1	FPL NWFL	Jackson County 36/5N/9W	PV	Solar	Solar	N/A	N/A	--	Dec-21	Unknown	74,500	74.5	74.5	0.02	41.01
Bluefield Preserve Solar <sup>2/</sup>	1	FPL	St. Lucie County 27.24354,-80.67097	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	1.94	21.96
Buttonwood Solar <sup>2/</sup>	1	FPL	St. Lucie County 27.548000,-80.672000	PV	Solar	Solar	N/A	N/A	Unknown	Nov-24	Unknown	74,500	74.5	74.5	2.21	33.66
Caloosahatchee Solar <sup>2/</sup>	1	FPL	Hendry County 26.752000,-81.160000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	1.93	29.66

1/ These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

2/ Those projected firm MW values represent the contribution of both non-solar and solar facilities at Summer and Winter Peak.

**Schedule 1**  
**FPL Existing Generating Facilities**  
**As of December 31, 2024**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	
Plant Name	Unit No.	Area	Location	Unit Type	Fuel Pct.	Fuel Alt.	Fuel Transport. Pct.	Fuel Alt.	Fuel Days Use	Commercial In-Service Month/Year	Actual/Expected Retirement Month/Year	Gen.Max. Nameplate KW	Net Capacity <sup>1/</sup>		Firm Capacity <sup>2/</sup>	
													Winter MW	Summer MW	Winter MW	Summer MW
Canoe Solar <sup>2/</sup>	1	FPL NMFL	Okaloosa County 30.680000, -86.782000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	0.00	37.13
												74,500	74.5	74.5	0.00	37.13
Cape Canaveral	3	FPL	Brevard County 18/23S/36E	CC	NG	FO <sub>2</sub>	PL	TK	Unknown	Apr-13	Unknown	1,418,000	1,418	1,290	1,418	1,290
												1,418,000	1,418	1,290	1,418	1,290
Cattle Ranch Solar <sup>2/</sup>	1	FPL	Desoto County 19,24,25/36S/26E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-20	Unknown	74,500	74.5	74.5	1.50	28.68
												74,500	74.5	74.5	1.50	28.68
Cavendish Solar <sup>2/</sup>	1	FPL	Okaloosa County 27.628, -80.80317	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	4.28	29.75
												74,500	74.5	74.5	4.28	29.75
Cedar Trail Solar <sup>2/</sup>	1	FPL NMFL	Baker County 30.322000, -82.192000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	0.29	5.64
												74,500	74.5	74.5	0.29	5.64
Chautauqua Solar <sup>2/</sup>	1	FPL NMFL	Walton County 30.87576, -86.20813	PV	Solar	Solar	N/A	N/A	Unknown	Feb-23	Unknown	74,500	74.5	74.5	0.00	40.13
												74,500	74.5	74.5	0.00	40.13
Chipola Solar <sup>2/</sup>	1	FPL NMFL	Calhoun County 30.45643, -85.27719	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	0.00	33.81
												74,500	74.5	74.5	0.00	33.81
Citrus Solar <sup>2/</sup>	1	FPL	DeSoto County 35/36S/25E : 2/37S/25E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-16	Unknown	74,500	74.5	74.5	0.00	38.80
												74,500	74.5	74.5	0.00	38.80
Coral Farms Solar <sup>2/</sup>	1	FPL	Putnam County 27,28,33,34/8S/24E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-18	Unknown	74,500	74.5	74.5	11.03	46.58
												74,500	74.5	74.5	11.03	46.58
Cotton Creek Solar <sup>2/</sup>	1	FPL NMFL	Jackson County 7/4N/8W	PV	Solar	Solar	N/A	N/A	—	Dec-21	Unknown	74,500	74.5	74.5	0.04	41.10
												74,500	74.5	74.5	0.04	41.10
Cypress Pond Solar <sup>2/</sup>	1	FPL NMFL	Washington County 30.59444, -85.83008	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	0.00	37.17
												74,500	74.5	74.5	0.00	37.17
Dania Beach Clean Energy Center	7	FPL	Broward County 30/50S/42E	CC	NG	FO <sub>2</sub>	PL	TK	Unknown	Jan-22	Unknown	1,252,000	1,252	1,246	1,252	1,246
												1,252,000	1,252	1,246	1,252	1,246
DeSoto Solar <sup>2/</sup>	1	FPL	DeSoto County 27/36S/25E	PV	Solar	Solar	N/A	N/A	Unknown	Oct-09	Unknown	22,950	25	25	0.71	10.27
												22,950	25	25	0.71	10.27
Discovery Solar <sup>2/</sup>	1	FPL	Brevard County 25,35,36/22S/36E	PV	Solar	Solar	N/A	N/A	Unknown	Jul-21	Unknown	74,500	74.5	74.5	0.99	36.94
												74,500	74.5	74.5	0.99	36.94
Echo River Battery Storage	1	FPL	Suwannee County 24,25,19/2S/14E : 30/2S/15E	BS	N/A	N/A	N/A	N/A	Unknown	Dec-21	Unknown	30,000	30.0	30.0	30.0	30.0
												30,000	30.0	30.0	30.0	30.0

1/ These ratings are peak capacity ratings for non-Solar units and Nameplate ratings for Solar units.

2/ These projected firm/MW values represent the contribution of both non-solar and solar facilities at Summer and Winter Peak.



**Schedule 1**  
**FPL Existing Generating Facilities**  
**As of December 31, 2024**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	
	Unit			Unit	Fuel	Fuel	Fuel	Fuel	Commercial	Actual/	Gen.Max.	Net Capacity <sup>1/</sup>		Firm Capacity <sup>2/</sup>		
Plant Name	No.	Area	Location	Type	Pri.	Alt.	Pri.	Alt.	In-Service	Expected	Nameplate	Winter	Summer	Winter	Summer	
									Month/Year	Retirement	KW	MW	MW	MW	MW	
Echo River Solar <sup>2/</sup>			Suwannee County													
			24,25,19/2S/14E : 30/2S/15E								74,500	74.5	74.5	0.00	42.60	
	1			PV	Solar	Solar	N/A	N/A	Unknown	May-20	Unknown	74,500	74.5	74.5	0.00	42.60
Egret Solar <sup>2/</sup>		FPL	Baker County													
			26,27/2S/21E								74,500	74.5	74.5	0.28	38.16	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Dec-20	Unknown	74,500	74.5	74.5	0.28	38.16
Elder Branch Solar <sup>2/</sup>		FPL	Manatee County													
			18, 33S, 21E								74,500	74.5	74.5	0.51	32.19	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-22	Unknown	74,500	74.5	74.5	0.51	32.19
Elonia Creek Solar <sup>2/</sup>		FPL	Putnam County													
			29.76723,-81.77749								74,500	74.5	74.5	1.39	34.34	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	1.39	34.34
Everglades Solar <sup>2/</sup>		FPL	Miami-Dade County													
			25.54255,-80.55434								74,500	74.5	74.5	3.14	23.94	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	3.14	23.94
First City Solar <sup>2/</sup>		FPL NWFL	Escambia County													
			30.91993,-87.34002								74,500	74.5	74.5	0.00	28.69	
	1									Jan-23	Unknown	74,500	74.5	74.5	0.00	28.69
Flowers Creek Solar <sup>2/</sup>		FPL NWFL	Calhoun County													
			30.57013,-85.03932								74,500	74.5	74.5	0.00	34.22	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	0.00	34.22
Fort Drum Solar <sup>2/</sup>		FPL	Okeechobee County													
			2,11,13/33S/35E								74,500	74.5	74.5	0.89	34.80	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Aug-21	Unknown	74,500	74.5	74.5	0.89	34.80
Fort Myers		FPL	Lee County													
			35/43S/25E								2,911,000	2,911	2,776	2,911	2,776	
	2			CC	NG	No	FL	No	Unknown	Jun-02	Unknown	1,920,000	1,920	1,822	1,920	1,822
	3			CT	NG	FO <sub>2</sub>	TK	TK	Unknown	Jun-03	Unknown	868,000	868	852	868	852
	1, 9			GT	FO <sub>2</sub>	No	WA	No	Unknown	May-74	Unknown	123,000	123	102	123	102
Fourmile Creek Solar <sup>2/</sup>		FPL NWFL	Calhoun County													
			30.441000,-85.276000								74,500	74.5	74.5	0.00	38.53	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	0.00	38.53
Georges Lake Solar <sup>2/</sup>		FPL	Putnam County													
			29.780000,-81.765000								74,500	74.5	74.5	0.63	5.00	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Nov-24	Unknown	74,500	74.5	74.5	0.63	5.00
Ghost Orchid Solar <sup>2/</sup>		FPL	Hendry County													
			4,5 47S, 33E								74,500	74.5	74.5	1.95	22.08	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-22	Unknown	74,500	74.5	74.5	1.95	22.08
Grove Solar <sup>2/</sup>		FPL	Indian River County													
			29, 33S, 37E								74,500	74.5	74.5	1.88	24.21	
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-22	Unknown	74,500	74.5	74.5	1.88	24.21
Gulf Clean Energy Center		FPL NWFL	Escambia County													
			25/1N30W								1,901,000	1,901	1,887	1,901	1,887	
	4			ST	NG	-	FL	-	-	Jul-59	4th Q 2029	75,000	75	75	75	75
	5			ST	NG	-	FL	-	-	Jun-61	4th Q 2029	75,000	75	75	75	75
	6			ST	NG	-	FL	-	-	May-70	Unknown	315,000	315	315	315	315
	7			ST	NG	-	FL	-	-	Aug-73	Unknown	496,000	496	496	496	496
	8			CT	NG	-	FL	-	-	Dec-21	Unknown	940,000	940	926	940	926

1/ These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

2/ These projected firm MW values represent the contribution of both non-solar and solar facilities at Summer and Winter Peak.

**Schedule 1**  
**FPL Existing Generating Facilities**  
**As of December 31, 2024**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	
	Unit No.	Area	Location	Unit Type	Fuel Ftl	Fuel Alt.	Fuel Transport. Ftl	Fuel Days Use	Commercial In-Service Month/Year	Actual/Expected Retirement Month/Year	Gen.Max. Nameplate KW	Net Capability <sup>1/</sup> Winter MW	Summer MW	Firm Capability <sup>2/</sup> Winter MW	Summer MW	
Plant Name																
Hammock Solar <sup>2/</sup>		FPL	Hendry County 34/43S/30E : 3,4,9,10/44S/30E													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5	0.00	38.90
												74,500	74.5	74.5	0.00	38.90
Hawthorne Creek Solar <sup>2/</sup>		FPL	Desoto County 27.086000, -81.836000													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	1.18	31.49
												74,500	74.5	74.5	1.18	31.49
Hendry Isles Solar <sup>2/</sup>		FPL	Hendry County 26.749000, -81.192000													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Nov-24	Unknown	74,500	74.5	74.5	2.34	22.11
												74,500	74.5	74.5	2.34	22.11
Hibiscus Solar <sup>2/</sup>		FPL	Palm Beach County 2/43S/40E													
	1			PV	Solar	Solar	N/A	N/A	Unknown	May-20	Unknown	74,500	74.5	74.5	0.00	36.71
												74,500	74.5	74.5	0.00	36.71
Honeybell Solar <sup>2/</sup>		FPL	Okeechobee County 27.522000, -80.744000													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Nov-24	Unknown	74,500	74.5	74.5	2.20	32.68
												74,500	74.5	74.5	2.20	32.68
Horizon Solar <sup>2/</sup>		FPL	Alachua County 25,35,36/9S/22E : 30, 31/9S/23E													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-18	Unknown	74,500	74.5	74.5	1.10	39.29
												74,500	74.5	74.5	1.10	39.29
Ibis Solar <sup>2/</sup>		FPL	Brevard County 27.853000, -80.682000													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	1.98	35.07
												74,500	74.5	74.5	1.98	35.07
Immokalee Solar <sup>2/</sup>		FPL	Collier County 4, 9, 16, 46S, 29E													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-22	Unknown	74,500	74.5	74.5	2.47	20.70
												74,500	74.5	74.5	2.47	20.70
Indian River Solar <sup>2/</sup>		FPL	Indian River County 30/33S/38E													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-18	Unknown	74,500	74.5	74.5	0.00	39.54
												74,500	74.5	74.5	0.00	39.54
Interstate Solar <sup>2/</sup>		FPL	St. Lucie County 28,33/34S/39E													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Jan-19	Unknown	74,500	74.5	74.5	0.00	37.94
												74,500	74.5	74.5	0.00	37.94
Kayak Solar <sup>2/</sup>		FPL NWFL	Okaloosa County 30.704000, -86.700000													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Dec-24	Unknown	74,500	74.5	74.5	0.00	10.97
												74,500	74.5	74.5	0.00	10.97
Lakeside Solar <sup>2/</sup>		FPL	Okeechobee County 28,29,32/37S/36E													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Dec-20	Unknown	74,500	74.5	74.5	1.18	36.08
												74,500	74.5	74.5	1.18	36.08
Lansing Smith		FPL NWFL	Bay County 36/2S/15W													
	3			CC	NG	—	FL	—	—	Apr-02	Unknown	705,000	705	673	705	673
	A			CT	LO	—	TK	—	—	May-71	4th Q 2027	665,000	665	641	665	641
Lauderdale		FPL	Brow ard County 30/50S/42E													
	6			CT	NG	FO <sub>2</sub>	FL	TK	Unknown	Dec-16	Unknown	1,228,400	1,218	1,224	1,218	1,224
	3, 5			GT	NG	FO <sub>2</sub>	FL	TK	Unknown	Aug-70	Unknown	1,155,000	1,145	1,155	1,145	1,155
Loggerhead Solar <sup>2/</sup>		FPL	St. Lucie County 21/37S/38E													
	1			PV	Solar	Solar	N/A	N/A	Unknown	Mar-18	Unknown	74,500	74.5	74.5	0.58	26.38
												74,500	74.5	74.5	0.58	26.38

1/ These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

2/ These projected firm MW values represent the combination of both non-solar and solar resources at summer and winter peak.

**Schedule 1**  
**FPL Existing Generating Facilities**  
**As of December 31, 2024**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	
Plant Name	Unit No.	Area	Location	Unit Type	Fuel P/L	Fuel Transport P/L	Fuel Alt. P/L	Fuel Days Use	Commercial In-Service Month/Year	Expected Retirement Month/Year	Gen.Max. Nameplate KW	Net Capacity <sup>1/</sup> Winter MW	Net Capacity <sup>1/</sup> Summer MW	Firm Capacity <sup>2/</sup> Winter MW	Firm Capacity <sup>2/</sup> Summer MW	
Magnolia Springs Solar <sup>2/</sup>	1	FPL	Clay County 15,16,21,22/7S/26E	PV	Solar	Solar	N/A	N/A	Unknown	Apr-21	Unknown	74,500	74.5	74.5	1.03	39.11
Manatee Battery Storage	1	FPL	Manatee County 1,12,13,24/33S/19E : 18,19/33S/20E	BS	N/A	N/A	N/A	N/A	Unknown	Dec-21	Unknown	409,000	409	409	409	409
Manatee Solar <sup>2/</sup>	1	FPL	Manatee County 1,12,13,24/33S/19E : 18,19/33S/20E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-16	Unknown	74,500	74.5	74.5	0.00	38.70
Manatee	1 <sup>3/</sup> 2 <sup>3/</sup> 3	FPL	Manatee County 18/33S/20E	ST ST CC	NG NG NG	FO <sub>2</sub> FO <sub>2</sub> No	PL PL PL	WA WA No	Unknown Unknown Unknown	Oct-76 Dec-77 Jun-05	4/ 4/ Unknown	2,988,000 819,000 1,348,000	1,348 0 1,348	1,246 0 1,246	1,348 0 1,348	1,246 0 1,246
Martin	3 4 8	FPL	Martin County 30/39S/38E	CC CC CC	NG NG NG	No No FO <sub>2</sub>	PL PL PL	No No TK	Unknown Unknown Unknown	Feb-94 Apr-94 Jun-05	Unknown Unknown Unknown	538,000 520,000 1,327,000	538 529 1,327	487 487 1,249	2,394 538 1,327	2,223 529 1,249
Marri Dado Solar <sup>2/</sup>	1	FPL	Marri-Dade County 13/55S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-19	Unknown	74,500	74.5	74.5	0.00	36.14
Mitchell Creek Solar <sup>2/</sup>	1	FPL MAFL	Escambia County 30.928510, -87.364140	PV	Solar	Solar	N/A	N/A	Unknown	Nov-24	Unknown	74,500	74.5	74.5	0.00	29.19
Monarch Solar <sup>2/</sup>	1	FPL	Martin County 27.030740, -80.524800	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	1.52	30.37
Nassau Solar <sup>2/</sup>	1	FPL	Nassau County 2/1N/24E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-20	Unknown	74,500	74.5	74.5	1.02	37.03
Nature Trail Solar <sup>2/</sup>	1	FPL	Baker County 30.313000, -82.177000	PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	0.36	37.61
Northern Preserve Solar <sup>2/</sup>	1	FPL	Baker County 13,18/3S/20E : 24/3S/21E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-20	Unknown	74,500	74.5	74.5	0.00	33.61
Norton Creek Solar <sup>2/</sup>	1	FPL	Madison County 30.383000, -83.327000	PV	Solar	Solar	N/A	N/A	Unknown	Dec-24	Unknown	74,500	74.5	74.5	0.03	24.27
Okeechobee <sup>4/</sup>	1	FPL	Okeechobee 2/33S/35E	CC	NG	FO <sub>2</sub>	PL	TK	Unknown	Mar-19	Unknown	1,720,000	1,672	1,720	1,672	1,720
Okeechobee Solar <sup>2/</sup>	1	FPL	Okeechobee County 1,12,13/33S/35E	PV	Solar	Solar	N/A	N/A	Unknown	May-20	Unknown	74,500	74.5	74.5	0.00	36.21

<sup>1/</sup> These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

<sup>2/</sup> These projected firm MW values represent the contribution of both non-solar and solar facilities at Summer and Winter Peak.

<sup>3/</sup> Manatee Units 1 & 2 are Winter Peaking ONLY units. They will only be manned and operated during an Extreme Winter event in which additional capacity is needed to meet load.

<sup>4/</sup> As part of the Okeechobee Hydrogen Gas Pilot Program, a portion of the CO<sub>2</sub> generated from the unit is transferred to an electrolyzer

where it is then converted into Hydrogen Gas.

Florida Power & Light Company

**Schedule 1**  
**FPL Existing Generating Facilities**  
**As of December 31, 2024**

(1)	(2)	(3)		(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
	Unit	Area	Location	Unit	Fuel	Fuel	Fuel	Fuel	Alt.	Commercial	Actual/	Gen.Max.	Net Capability <sup>1/</sup>		Firm Capability <sup>2/</sup>	
Plant Name	No.			Type	Pct.	Alt.	Pct.	Alt.	Days	In-Service	Expected	Nameplate	Winter	Summer	Winter	Summer
		FPL							Use	Month/Year	Retirement	KW	MW	MW	MW	MW
Orange Blossom Solar <sup>2/</sup>	1		Indian River County 19/33S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Jul-21	Unknown	74,500	74.5	74.5	1.21	37.83
												74,500	74.5	74.5	1.21	37.83
Orchard Solar <sup>2/</sup>	1	FPL	Indian River/St. Lucie County 27.556000, -80.570000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	2.92	35.99
												74,500	74.5	74.5	2.92	35.99
Palm Bay Solar <sup>2/</sup>	1	FPL	Brevard County 19,30/30S/37E	PV	Solar	Solar	N/A	N/A	Unknown	May-21	Unknown	74,500	74.5	74.5	0.83	39.78
												74,500	74.5	74.5	0.83	39.78
Pea Ridge	1	FPL NWFL	Santa Rosa County 15/1N/28W	CT	NG	--	FL	--	--	May-98	4th Q 2024	5,000	5	4	5	4
	2			CT	NG	--	FL	--	--	May-98	4th Q 2024	5,000	5	4	5	4
	3			CT	NG	--	FL	--	--	May-98	4th Q 2024	5,000	5	4	5	4
Pecan Tree Solar <sup>2/</sup>	1	FPL NWFL	Walton County 30.933000, -86.246000	PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	0.00	40.07
												74,500	74.5	74.5	0.00	40.07
Pelican Solar <sup>2/</sup>	1	FPL	St. Lucie County 6,7/34S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Apr-21	Unknown	74,500	74.5	74.5	1.85	37.61
												74,500	74.5	74.5	1.85	37.61
Perdido LFG	1	FPL NWFL	Escambia County	IC	LFG	--	FL	--	--	Oct-10	4th Q 2029	3,000	3	3	3	3
	2			IC	LFG	--	FL	--	--	Oct-10	4th Q 2029	1,500	1.5	1.5	1.5	1.5
												1,500	1.5	1.5	1.5	1.5
Pineapple Solar <sup>2/</sup>	1	FPL	St. Lucie County 27.255000, -80.571000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	2.19	32.64
												74,500	74.5	74.5	2.19	32.64
Pink Trail Solar <sup>2/</sup>	1	FPL	St. Lucie County 27.29783, -80.54214	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	2.58	21.84
												74,500	74.5	74.5	2.58	21.84
Pioneer Trail Solar <sup>2/</sup>	1	FPL	Volkusia County 21/17S/32E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-19	Unknown	74,500	74.5	74.5	0.00	35.83
												74,500	74.5	74.5	0.00	35.83
Port Everglades	5	FPL	City of Hollywood 23/50S/42E	CC	NG	FO <sub>2</sub>	FL	TK	Unknown	Apr-16	Unknown	1,333,000	1,333	1,237	1,333	1,237
												1,333,000	1,333	1,237	1,333	1,237
Prairie Creek Solar <sup>2/</sup>	1	FPL	Desoto County 27.045000, -81.809000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	1.37	32.07
												74,500	74.5	74.5	1.37	32.07
Riviera Beach	5	FPL	City of Riviera Beach 33/42S/432E	CC	NG	FO <sub>2</sub>	FL	TK	Unknown	Apr-14	Unknown	1,406,000	1,406	1,290	1,406	1,290
												1,406,000	1,406	1,290	1,406	1,290
Rodeo Solar <sup>2/</sup>	1	FPL	DeSoto County 23,24,25,26,27/36S/25E	PV	Solar	Solar	N/A	N/A	Unknown	May-21	Unknown	74,500	74.5	74.5	1.50	36.68
												74,500	74.5	74.5	1.50	36.68
Sabal Palm Solar <sup>2/</sup>	1	FPL	Palm Beach County 33/42S/40E	PV	Solar	Solar	N/A	N/A	Unknown	Jun-21	Unknown	74,500	74.5	74.5	1.53	38.21
												74,500	74.5	74.5	1.53	38.21

1/ These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

2/ These projected firm MW values represent the contribution of both non-solar and solar facilities at Summer and Winter Peak.

**Schedule 1**  
**FPL Existing Generating Facilities**  
**As of December 31, 2024**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	
Plant Name	Unit No.	Area	Location	Unit Type	Fuel Pri.	Fuel Alt.	Fuel Transport Pri.	Fuel Alt.	Fuel Days Use	Commercial In-Service Month/Year	Expected Retirement Month/Year	Gen.Max. Nameplate kW	Net Capacity <sup>1/</sup> Winter MW	Summer MW	Firm Capacity <sup>2/</sup> Winter MW	Summer MW
Sambucus Solar <sup>2/</sup>	1	FPL	Manatee County 27.449000, -82.064000	PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	0.93	30.74
Sanford	4	FPL	Volusia County 16/19S/30E	CC	NG	No	FL	No	Unknown	Oct-03	Unknown	2,530,000	2,530	2,418	2,530	2,418
	5			CC	NG	No	FL	No	Unknown	Jun-02	Unknown	1,278,000	1,278	1,209	1,278	1,209
Saw Palmetto Solar <sup>2/</sup>	1	FPL NAFI	Bay County 30.4213, -85.44103	PV	Solar	Solar	N/A	N/A	Unknown	Jan-23	Unknown	74,500	74.5	74.5	0.00	39.70
Sawgrass Solar <sup>2/</sup>	1	FPL	Hendry County 20, 21, 28, 29, 47S, 33E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-22	Unknown	74,500	74.5	74.5	1.93	21.86
Scherer <sup>5/</sup>	3	FPL NAFI	Monroe, GA	ST	C	—	RR	—	—	Jan-87	4th Q 2034	215,000	215	215	215	215
Shirer Branch Solar <sup>2/</sup>	1	FPL NAFI	Calhoun County 30.39891, -85.27975	PV	Solar	Solar	N/A	N/A	Unknown	Feb-23	Unknown	74,500	74.5	74.5	0.00	39.47
Silver Palm Solar <sup>2/</sup>	1	FPL	Palm Beach County 26.788000, -80.352000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	2.64	30.94
Southfork Solar <sup>2/</sup>	1	FPL	Manatee County 26/33S/21E	PV	Solar	Solar	N/A	N/A	Unknown	May-20	Unknown	74,500	74.5	74.5	0.00	43.15
Space Coast Solar <sup>2/</sup>	1	FPL	Brevard County 13/23S/36E	PV	Solar	Solar	N/A	N/A	Unknown	Apr-10	Unknown	10,000	10	10	0.13	3.76
Sparkberry Solar <sup>2/</sup>	1	FPL NAFI	Escambia County 30.763000, -87.433000	PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	0.00	37.92
St. Lucie <sup>6/</sup>	1	FPL	St. Lucie County 16/36S/41E	ST	Nuc	No	TK	No	Unknown	May-76	Unknown	1,863,000	1,863	1,821	1,863	1,821
	2			ST	Nuc	No	TK	No	Unknown	Jun-83	Unknown	1,003,000	1,003	981	1,003	981
Sundew Solar <sup>2/</sup>	1	FPL	St. Lucie County 17, 37S, 38E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-22	Unknown	74,500	74.5	74.5	1.91	26.32
Sunshine Gateway Battery Storage	1	FPL	Columbia County 25,26,35,36/2S/15E: 31,32/5S/16E	BS	N/A	N/A	N/A	N/A	Unknown	Dec-21	Unknown	30,000	30.0	30.0	30.0	30.0
Sunshine Gateway Solar <sup>2/</sup>	1	FPL	Columbia County 25,26,35,36/2S/15E: 31,32/5S/16E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-19	Unknown	74,500	74.5	74.5	0.00	40.31
Sweetbay Solar <sup>2/</sup>	1	FPL	Martin County 17,19/39S/38E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-20	Unknown	74,500	74.5	74.5	0.00	31.15

1/ These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

2/ These projected firm MW values represent the contribution of both non-solar and solar facilities at Summer and Winter Peak.

5/ Unit capabilities shown represent FPL NAFI's portion of Scherer Unit 3 (25%) located in Georgia.

6/ Total capability of St. Lucie 1 is 981 Summer/1,003 Winter MW. FPL's share of St. Lucie 2 is 840 Summer/860 Winter MW.

FPL's ownership share of St. Lucie Units 1 and 2 is 100% and 85%, respectively, as shown above. FPL's share of the deliverable capacity from each unit is approx. 92.5% and excludes the Orlando Utilities Commission (OUC) and Florida Municipal Power Agency (FMPA) combined portion of approximately 7.44% per unit.

Florida Power & Light Company

**Schedule 1**  
**FPL Existing Generating Facilities**  
**As of December 31, 2024**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)	
Plant Name	Unit No.	Area	Location	Unit Type	Fuel Pti.	Alt.	Fuel Transport	Alt.	Fuel Days Use	Commercial In-Service Month/Year	Actual/Expected Retirement Month/Year	Gen.Max. Nameplate KW	Net Winter MW	Capacity Summer MW	Firm Winter MW	Capacity Summer MW
Terrill Creek Solar <sup>2/</sup>	1	FPL	Clay County 29.884000, -81.767000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	0.66	34.21
Three Creeks Solar <sup>2/</sup>	1	FPL	Manatee County 27.581000, -82.260000	PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	0.96	32.94
Traskside Solar <sup>2/</sup>	1	FPL	St. Johns County 25.368S/28E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-20	Unknown	74,500	74.5	74.5	1.02	39.55
Turkey Point	3	FPL	Miami Dade County 27/57S/40E	ST	Nuc	No	TK	No	Unknown	Nov-72	Unknown	3,083,000	3,083	2,973	3,083	2,973
	4			ST	Nuc	No	TK	No	Unknown	Jun-73	Unknown	859,000	859	837	859	837
	5			CC	NG	FO2	FL	TK	Unknown	May-07	Unknown	1,358,000	1,358	1,292	1,358	1,292
Turnpike Solar <sup>2/</sup>	1	FPL	Indian River County 27.568000, -80.645000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	2.84	34.60
Tw in Lakes Solar <sup>2/</sup>	1	FPL	Putnam County 19,20,25/10S/24E : 30/10S/25E	PV	Solar	Solar	N/A	N/A	Unknown	Mar-20	Unknown	74,500	74.5	74.5	0.96	38.32
Union Springs Solar <sup>2/</sup>	1	FPL	Union County 3,4,9,10/6S/20E : 33/5S/20E	PV	Solar	Solar	N/A	N/A	Unknown	Dec-20	Unknown	74,500	74.5	74.5	0.83	38.91
West County	1	FPL	Palm Beach County 29/43S/40E	CC	NG	FO2	FL	TK	Unknown	Aug-09	Unknown	4,047,000	4,047	3,771	4,047	3,771
	2			CC	NG	FO2	FL	TK	Unknown	Nov-09	Unknown	1,349,000	1,349	1,257	1,349	1,257
	3			CC	NG	FO2	FL	TK	Unknown	May-11	Unknown	1,349,000	1,349	1,257	1,349	1,257
White Tail Solar <sup>2/</sup>	1	FPL	Martin County 27.080000, -80.379000	PV	Solar	Solar	N/A	N/A	Unknown	Jan-24	Unknown	74,500	74.5	74.5	3.12	36.32
Wild Azelea Solar <sup>2/</sup>	1	FPL NWFL	Gadsden County 30.6758, -84.74033	PV	Solar	Solar	N/A	N/A	Unknown	Feb-23	Unknown	74,500	74.5	74.5	0.00	40.92
Wild Quail Solar <sup>2/</sup>	1	FPL NWFL	Walton County 30.898050, -86.250070	PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	0.00	41.34
Wildflower Solar <sup>2/</sup>	1	FPL	Desoto County 25,26,36S/25E	PV	Solar	Solar	N/A	N/A	Unknown	Jan-18	Unknown	74,500	74.5	74.5	0.00	38.67
Willow Solar <sup>2/</sup>	1	FPL	Manatee County 2,3,10,11/35S/22E	PV	Solar	Solar	N/A	N/A	Unknown	Jul-21	Unknown	74,500	74.5	74.5	1.30	35.83
Woodyard Solar <sup>2/</sup>	1	FPL	Hendry County 26.420000, -81.051000	PV	Solar	Solar	N/A	N/A	Unknown	Mar-24	Unknown	74,500	74.5	74.5	2.17	28.98
Total Nameplate System Generating Capacity as of December 31, 2024 <sup>7/</sup> =													36,821	35,831	-	-
Total Firm System Generating Capacity as of December 31, 2024 <sup>8/</sup> =													-	-	29,878	31,691

1/ These ratings are peak capability ratings for non-Solar units and Nameplate ratings for Solar units.

2/ These projected firm MW values represent the contribution of both non-solar and solar facilities at Summer and Winter Peak.

7/ The Total Nameplate System Generating Capacity value shown includes FPL-owned firm and non-firm generating capacity.

8/ The System Firm Generating Capacity value shown includes only firm generating capacity.

Florida Power & Light Company

***(This page is intentionally left blank.)***

## **CHAPTER II**

---

### **Forecast of Electric Power Demand**



***(This page is intentionally left blank.)***

## **II. Forecast of Electric Power Demand**

### **II.A. Overview of the Load Forecasting Process**

The load forecasting team developed the forecasts of customers, sales, net energy for load (NEL), and peak demands presented in this 2025 Site Plan. The forecasts presented in this Site Plan were developed using consistent methodologies for both the FPL Legacy and FPL NWFL areas. These methodologies were also used to develop the forecasts previously presented in the four prior Site Plans. The load forecasting team continues to evaluate and implement appropriate enhancements to the forecasting methodologies for this and upcoming forecasts.

The long-term forecasts of customers, sales, NEL, and peak loads for the integrated system are developed annually. The forecasts for the integrated system for years 2025 and beyond were developed by combining the forecasts for the FPL Legacy and FPL NWFL areas. This is consistent with the forecasting methods employed for the prior three Site Plans. These forecasts are utilized throughout this 2025 Site Plan and are key inputs in the resource planning analyses that led to the integrated resource plans presented in this document.

The following pages describe how the forecasts of customers, sales, NEL, and peak loads were initially developed separately for the FPL Legacy and FPL NWFL areas and then combined into a single set of forecasts for the integrated system. This approach is because the historical data needed to develop the forecasts are for the legacy areas; historical data for the integrated system was not available when the forecasts were developed.

Similar to previous forecasts, the drivers for the forecasts include household growth, economic conditions, electricity prices, weather, and energy efficiency codes and standards. The forecasts for customers, energy sales, NEL, and summer peak demands are 50% probability (P50) forecasts, which means there is a 50% probability that actual results will be either higher or lower than the forecast.

The projections for population growth, household growth, and other economic variables are obtained from S&P Global, a leading economic forecasting firm that has been previously used by FPL. Additionally, the projections for electric vehicle adoption and impact come from Bloomberg New Energy Finance and Wood Mackenzie, while the projections for private solar adoption and impact are from Wood Mackenzie. Both Bloomberg and Wood Mackenzie are well known for their

financial and energy forecasts. Using statistical models, these inputs are quantified in terms of their impact on the respective forecasts.

Weather is a key factor that affects energy sales and peak demand. The weather variables for use in the forecasting models are as follows:

1. The residential and commercial energy models incorporate heating degree hours and/or cooling degree hours. The threshold temperatures differ based on how each customer group responds to temperatures.
2. The Summer peak demand models incorporate minimum and maximum temperatures of the peak Summer day, while the Winter peak demand models incorporate minimum temperatures on the peak Winter day and the buildup of heating degree hours on the day prior to the peak day. Additional details are provided later in this chapter.

The weather variables used in the FPL models are based on a composite hourly temperature from the following weather stations: Miami, Fort Myers, Daytona Beach, and West Palm Beach. The temperatures for each weather station are weighted based on the energy sales associated with that region. The resulting composite temperatures are then used to derive the cooling degree hours and heating degree hours used in the energy models as well as the peak day temperatures used in the Summer and Winter peak demand models.

The weather variables used in the FPL NWFL models are based on the hourly temperatures from the Pensacola weather station. The Pensacola hourly temperatures are then used to derive the cooling degree hours and heating degree hours used in the energy models, the peak day cooling degree hours used in the Summer peak demand model, and the temperatures used in the Winter peak demand model.

## **II.B. Customer Forecasts**

The customer forecasts for the integrated system for 2025 and beyond are the sum of the respective class-level customer forecasts for the FPL and FPL NWFL areas. The class-level customer forecasts were developed using a combination of regression models, exponential smoothing models, and inputs regarding wholesale contracts. The statistical models were developed using the software package MetrixND. The methods and tools used to develop the customer forecasts are consistent with those used for the prior four Site Plans, with routine updates

to include additional historical data and updated economic projections, along with minor changes to model specifications.

The residential customer forecasts were developed using regression models which include households, lag dependent variables, and binary variables. The commercial customer models were segmented by rate code, and the models were a combination of regression models and exponential smoothing models. The commercial regression models included total non-agriculture employment for Florida, Florida Gross State Product, lagged dependent variables, and binary variables. The industrial customer models were also segmented by rate code, and the models were a combination of a regression model and exponential smoothing models. The industrial regression model included housing starts, lagged dependent variables, and a binary variable. The customer forecasts for the Metro and Other customer classes were developed by applying the last known value since little to no changes are expected in these customer classes. The Street & Highway Lighting forecast was developed by the lighting team. Resale (wholesale) customers were forecasted based on known or likely wholesale contracts.

Total customer growth is projected to grow at an average annual rate of 1.0% during the forecast period. The primary driver of customer growth is population growth.

## **II.C. Energy Sales Forecasts**

Energy sales forecasts for the integrated system for 2025 and beyond are the sum of the respective class-level energy sales forecasts for the Legacy FPL and FPL NWFL areas. First, forecasts were developed for the major revenue classes, wholesale energy sales, and losses. Next, energy adjustments were calculated for factors, such as electric vehicles and private solar, and were applied to the class-level energy sales forecasts. Finally, these forecasts were then aggregated up to arrive at NEL forecasts (a bottom-up approach). The statistical models used in the energy sales forecasting process were developed using the software package MetrixND.

The methods and tools used to develop the energy sales forecasts were consistent with those used for the prior four Site Plans, with routine updates to include additional historical data and updated economic projections, along with minor updates to model specifications.

## **1. Residential Sales**

The residential energy sales forecasts were developed using econometric models. Residential energy sales were first expressed as monthly use per customer per billing day. The forecasted energy use per customer per billing day was then multiplied by the projected number of billing days and customers to arrive at the residential billed energy sales forecast. The billed energy sales were then adjusted for unbilled energy to arrive at the calendar month delivered energy sales forecast. The residential energy use per customer per billing day models include variables for cooling degree hours, heating degree hours, real wages per household, the moving average of real electricity price increases over time, energy savings from changes to energy efficiency codes and standards, binary variables, and autoregressive terms. The residential energy sales forecasts were also adjusted to reflect the anticipated impacts of continued adoption of electric vehicles and private solar.

2025 residential energy sales for the integrated system are projected to be 54.5% of sales to ultimate consumers and are projected to grow at an average annual rate of 1.5% over the forecast period.

## **2. Commercial Sales**

The commercial energy sales forecasts were also developed using econometric models where the energy sales were expressed as monthly use per customer per billing day. The forecasted energy use per customer per billing day was multiplied by the projected number of billing days and customers to arrive at the commercial billed energy sales forecasts. The billed energy sales were then adjusted for unbilled energy to arrive at the calendar month delivered energy sales forecasts. The commercial energy use per customer forecasts were developed using separate models based on rate code. The two FPL models were for small/medium customers (commercial customers on energy only and demand rates less than 500 kilowatt) and large customers (commercial customers on demand rates of 500 kW or higher). The FPL NWFL models were for small customers (commercial customers on General Service or GS rates) and large customers (commercial customers on demand rates of 25 kW or higher). The commercial energy sales models utilize variables for cooling degree hours, heating degree hours, housing starts, employment, the moving average of real electricity price increases over time, energy savings from changes to energy efficiency codes and standards, binary variables, and autoregressive terms. The commercial lighting sales forecast was developed using inputs from FPL's lighting team. These forecasts are then added together to arrive at the total commercial sales forecast. The total commercial energy sales forecast was also adjusted to reflect the impacts of private solar.

2025 commercial energy sales for the integrated system are projected to be 41.4% of sales to ultimate consumers and are projected to grow at an average annual rate of 0.4% over the forecast period.

### **3. Industrial Sales**

The projected industrial class energy sales were also forecasted using both econometric and exponential smoothing models. Industrial energy sales were expressed as either energy sales per customer or energy sales per customer per bill day. The resulting forecasts were then multiplied by bill days and/or customers to arrive at the billed energy sales forecasts. Energy usage for FPL's small and medium industrial customers (industrial customers on rate GS) was forecasted using an econometric model which included a lag dependent variable and binary variables while energy usage for large industrial customers were forecasted using an exponential smoothing model. FPL NWFL's industrial energy usage was forecasted using an exponential smoothing model. The industrial lighting sales forecast was developed using inputs from FPL's lighting team. These forecasts were then added together to arrive at the total industrial sales forecast. The total industrial sales forecast was adjusted to reflect the impact of very large demand, high load factor customers projected to take service on the FPL system during the planning period beginning in 2028.

For potential new customers with significant or unique load requirements, FPL's historical practice is to include the associated load in the forecast only after FPL and the customer have reached a definitive agreement or other binding commitment to extend service to the customer. At this time, there are no definitive agreements in place or other binding commitments between FPL and any large power users. However, based on discussions with potential large power users, such as a data centers, FPL believes there is a high probability for customers with significant load requirements to be served on the FPL system beginning in 2028 with total load growing to approximately 732 MW by 2033.

2025 industrial energy sales for the integrated system are projected to be 3.7% of sales to ultimate consumers and are projected grow at an average annual rate of 8.9% over the forecast period.

### **4. Railroad & Railways Sales and Street and Highway Sales**

The Railroad & Railway class consists solely of Miami-Dade County's Metrorail system. The Railroad & Railways sales forecast was developed using a regression model which included monthly binary variables and autoregressive terms.

The forecast inputs for Street and Highway sales forecasts were provided by FPL's lighting team.

**5. Other Public Authority Sales**

This class consists of a sports field rate schedule (which is closed to new customers) and one governmental account. The forecast for this class was developed using an exponential smoothing model.

**6. Total Sales to Ultimate Customer**

The sales forecasts for each of the revenue classes were each summed to produce the Total Sales to Ultimate Customer forecasts.

**7. Sales for Resale**

Sales for Resale (wholesale) customers are comprised of sales to municipalities and/or electric co-operatives. These customers differ from jurisdictional customers in that they are not the ultimate users of electricity. Instead, they resell this electricity to their own customers.

The Sales for Resale forecast includes wholesale loads served under full and partial-requirements contracts that provide other utilities all, or a portion of, their load requirements at a level of service equivalent to FPL's own native load customers. There are currently twelve customers in this class: Florida Keys Electric Cooperative, Lee County Electric Cooperative, New Smyrna Beach, Wauchula, Homestead, Quincy, Moore Haven, Florida Public Utilities Company, Blountstown, Alachua, Jacksonville Electric Authority, and Bartow.

Since May 2011, FPL has provided service to the Florida Keys Electric Cooperative under a long-term, full-requirements contract which continues through 2032, with an option to extend the contract through 2052. The sales to Florida Keys Electric Cooperative are based on customer-supplied information and historical coincidence factors.

FPL sales to Lee County began in 2010. Lee County has a contract with FPL for the full requirements of their load, which began in 2014 and continues through 2033, with an option to extend the contract through 2053. Forecasted NEL for Lee County is based on customer-supplied information and historical usage trends.

FPL sales to New Smyrna Beach began in February 2014. The contract continues through December 2030. Under a second contract, additional sales to New Smyrna Beach began in

July 2017 and continues through December 2030. The two contracts have the option to be extended for three years through 2033.

FPL sales to Wauchula began in January 2024 and continue through December 2030.

FPL sales to Homestead began in August 2015. The contract continues through December 2028. Under a separate contract, additional sales to Homestead began in January 2020 and will continue through December 2028.

FPL sales to Quincy began in January 2016. The contract continues through December 2027.

FPL sales to Moore Haven began in July 2016. The contract continues through December 2025.

FPL began sales to Florida Public Utilities Company are under four contracts, with two that began sales in January 2018 and the other two that began in 2020. The contracts have been consolidated, with sales continuing through December 2029 with a four-year extension option.

FPL sales to Blountstown began in May 2022 and continue through April 2027.

FPL sales to Alachua began in April 2022 and continue through March 2029.

FPL sales to Jacksonville Electric Authority began in January 2022 and continue through December 2041.

FPL sales to Bartow began in January 2024 and continue through December 2030.

#### **II.D. Net Energy for Load (NEL)**

The NEL forecasts for the years 2025 through 2034 are the sums of the retail energy, wholesale energy, and losses forecasts. Through the use of the energy efficiency variable, the retail energy sales forecast includes the impacts from major energy efficiency codes and standards, including those associated with the 2005 National Energy Policy Act, the 2007 Energy Independence and Security Act, and savings resulting from the use of compact fluorescent lamps (CFL) and light emitting diodes (LED). The estimated impact from these codes and standards includes engineering estimates and any resulting behavioral changes. The impact of these savings began in 2005, and,



from that year forward, their cumulative impact on NEL for the integrated system is projected to be a reduction of 9,645 GWh by 2034. This represents a 6.1% reduction in what the forecasted NEL for 2034 would have been absent these codes and standards. The incremental reduction from 2025 to 2034 is expected to be 2,460 GWh. The estimated impacts from codes and standards are based on the energy efficiency variables in the respective energy models. Collectively, this represents an extraordinary amount of energy efficiency on the integrated system. In addition, this energy efficiency is not funded through Energy Conservation Cost Recovery (ECCR) Clause rates paid by the general body of customers.

Adjustments were made to the NEL forecast to address the impact of incremental private (customer-owned) solar that is projected to be added during the forecast period. The impact of private solar on the NEL forecast for the integrated system is projected to be a reduction of approximately 9,300 GWh by 2034. Adjustments were also made for the additional load projected to be added due to the incremental adoption of new plug-in EVs. This results in an increase on the integrated system of approximately 12,000 GWh by 2034.

The combined NEL impacts of the adjustments for private solar and EV programs are an incremental net increase of almost 2,800 GWh by the end of the Site Plan forecast period, compared to the incremental net increase of approximately 2,000 GWh in the prior Site Plan. Although there was an increase in the impact of private solar, the substantial growth in the load additions from plug-in EVs more than offset the impact of load reductions due to private solar.

## **II.E. System Peak Forecasts**

The rate of absolute growth in peak load is a function of the size of the customer base, projected economic conditions, and energy efficiency codes and standards. The peak load forecast models capture these behavioral relationships. The peak load forecasts also reflect changes in load from private solar, plug-in EVs, economic development riders, and wholesale requirements contracts.

The monthly peak loads for the integrated system from 2025 and beyond are the highest hourly demand from the forecasted system hourly load forecast, which was developed by first adjusting FPL NWFL's load to reflect Eastern time zone and then summing the forecasted system hourly loads for the systems. The integrated system peak load forecast reflects the growth in peak load and includes the expected reduction to the peak demand for the integrated system that results from load diversity.

When viewed as separate systems or regions, the loads peak at different times which results in load diversity, primarily due to the FPL NWFL system being located in a different time zone than the rest of the FPL system. The benefit of load diversity is a reduction to the integrated system peak demand. By 2034, the peak demand reductions from load diversity are projected to be 142 MW in the Summer and 543 MW in the Winter.

The savings from energy efficiency codes and standards incorporated into the peak forecast include the impacts from the 2005 National Energy Policy Act, the 2007 Energy Independence and Security Act, and the use of CFLs and LEDs. The impact from these energy efficiency standards began in 2005, and their cumulative reduction, from that year, on the integrated Summer peak is projected to reach approximately 8,100 MW by 2034. This reduction includes engineering estimates and any resulting behavioral changes.

For the integrated system, the cumulative 2034 impacts from these energy efficiency codes and standards are projected to effectively reduce the Summer peak by approximately 25% and the Winter peak by approximately 6% for that year. From the end of 2024 through 2034, the projected incremental impacts from these energy efficiency codes and standards are a reduction on the Summer peak of approximately 2,000 MW and a reduction on the Winter peak of approximately 520 MW.

As noted previously, the peak forecasts were also adjusted for the estimated load impacts from private solar and plug-in EVs. Plug-in EVs are projected to increase peak load on the integrated system by approximately 2,500 MW in the Summer and 1,000 MW in the Winter by the end of 2034. Incremental additions of private solar on the integrated system are expected to decrease system peak load by approximately 2,240 MW in the Summer and 155 MW in the Winter by the end of 2034.

The forecasting methodologies for Summer, Winter, and monthly system peaks are discussed below.

#### **1. System Summer Peak**

The Summer peak demand forecast for the integrated system is the highest hourly demand during the Summer months from the integrated system hourly forecast which was developed by summing the forecasted system hourly loads for FPL and FPL NWFL. This approach ensures the Summer peak demand forecast for the integrated system reflects the growth in

Summer peak load while reflecting the previously mentioned peak demand reduction associated with load diversity. The Summer peak demand for the integrated system is projected to occur in August.

The Summer peak forecasts were developed using econometric models where the peak loads were expressed as Summer peak load per customer and the resulting projected peak loads per customer were multiplied by the forecast number of customers to arrive at the Summer peak load forecasts. The models included variables for weather, employment or income, and peak load reductions from change in energy efficiency codes and standards. The peak loads were then adjusted to account for the expected changes in loads resulting from private solar, plug-in EVs, and wholesale requirements contracts to derive FPL's system Summer peak.

## **2. System Winter Peak**

The Winter peak forecast presented in this Site Plan is the highest hourly demand during the Winter months from the integrated system hourly forecast, which was developed by summing the forecasted system hourly loads for FPL and FPL NWFL. This approach ensures the Winter peak demand forecast for the integrated system reflects the growth in Winter peak while reflecting the Winter peak demand reduction associated with load diversity. The Winter peak demand for the integrated system is projected to occur in January.

FPL developed P50 normal weather Winter peak loads using two econometric models, one each for the FPL and FPL NWFL areas. The model for FPL expressed Winter peak load as peak load per customer and included weather variables, employment, and binary variables. The projected peak load per customer was multiplied by the customer forecast to arrive at the projected Winter peak load. The projections were then adjusted for the expected changes in loads resulting from private solar, plug-in EVs, and wholesale requirement contracts to arrive at the forecasted normal weather Winter peak load. The model for FPL NWFL expressed Winter peak load as peak load and included weather, population, and peak load reductions from changes in energy efficiency codes and standards. The projected load was then adjusted for the expected changes in loads resulting from private solar and plug-in EVs to arrive at the forecasted normal weather Winter peak load.

## **3. Monthly Peak Forecasts**

The forecasting process for the monthly peaks assumes the Summer peak for FPL occurs in the month of August while the Summer peak for FPL NWFL occurs in the month of July. It also assumes that the Winter peak for both areas occur in the month of January. Finally, the

remaining monthly peaks are forecasted based on the historical relationship between the monthly peaks and the annual Summer peak.

The monthly peak demand forecasts for the integrated system for 2025 and beyond are the highest hourly demand by month from the integrated system hourly forecasts. This approach ensures the integrated monthly peak demand forecast reflects the growth in monthly peaks as well as the monthly peak demand reductions associated with load diversity. The Summer peak for the integrated FPL system occurs in August because of the large size of the FPL Legacy area. The Winter peak for the integrated FPL system occurs in January.

## **II.F. Hourly Load Forecast**

The forecasted values for system hourly load on the integrated system were the summation of the FPL Legacy and FPL NWFL hourly load for the period. The FPL NWFL system hourly load was adjusted from Central to Eastern time zone to be consistent with FPL Legacy's system hourly load.

Forecasted values for FPL's system hourly load were developed using a system load forecasting program named MetrixLT. This model uses years of historical FPL hourly system load data to develop load shapes. The model generates a projection of hourly load values based on these load shapes and the forecast of FPL's monthly peaks and energy.

Forecasted values for FPL NWFL's system hourly load were also developed using MetrixLT, which uses historical FPL NWFL hourly system load data to develop load shapes. The model generates a projection of hourly load values based on these load shapes and the forecast of FPL NWFL's monthly peaks and energy.

## **II.G. Uncertainty**

Uncertainty is inherent in the load forecasting process. This uncertainty can result from a number of factors, including unexpected changes in consumer behavior, structural shifts in the economy, economic/business cycles, and fluctuating weather conditions. Large weather fluctuations can and frequently do result in significant deviations between actual and forecasted peak demands. In particular, Winter peak demands have experienced significantly greater volatility than those observed for the Summer peak or NEL.

The inherent uncertainty in load forecasting is addressed in different ways regarding the overall resource planning and operational planning work. With respect to resource planning work, the utilization of a 20% total reserve margin (TRM) criterion, a Loss-of-Load-Probability (LOLP) criterion of 0.1 days per year, and a 10% generation-only reserve margin (GRM) criterion are designed to maintain reliable electric service for customers in light of forecasting and other uncertainties. In addition, FPL's Winter peak demands have experienced significantly greater volatility than the Summer peak or NEL, and this greater volatility results in additional risks to FPL's ability to serve winter load. FPL continues to analyze system impacts of Winter peak demands due to this greater volatility. In addition, FPL's shift to stochastic LOLP modeling provides a look at a variety of different weather scenarios that affect FPL's demand throughout the year.

## **II.H. DSM**

In this Site Plan, FPL accounts for the effects of its DSM energy efficiency programs through August 2024, which are embedded in the actual usage data for forecasting purposes. In addition, FPL accounts for the following projected DSM MW and MWh impacts as "line item reductions" to the forecasts as part of the IRP process: 1) the impacts of incremental energy efficiency that have been implemented after the 2024 Summer peaks have occurred, 2) projected impacts from incremental energy efficiency and load management, and 3) the impacts from previous signups in FPL's load management programs that will continue through 2034. After making these line-item adjustments to the load forecasted load values, the resulting "firm" load forecast, as shown in Chapter III in Schedules 7.1 and 7.2, is then used in the IRP work.

### **Historical and Forecast Load Information – Schedules 2-4**

Schedules 2 through 4 below provide information regarding FPL's historical and forecasted load. Note that all historical information combines the load information of FPL and FPL NWFL.

**Schedule 2.1**  
**History of Energy Consumption**  
**And Number of Customers by Customer Class**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
<u>Year</u>	<u>Population</u>	<u>Members per Household</u>	<u>Rural &amp; Residential</u>			<u>Commercial</u>		
			<u>GWh</u>	<u>Average No. of Customers</u>	<u>Average kWh Consumption Per Customer</u>	<u>GWh</u>	<u>Average No. of Customers</u>	<u>Average kWh Consumption Per Customer</u>
2015	10,758,616	2.33	64,232	4,618,890	13,906	51,263	587,965	87,186
2016	10,937,941	2.34	64,027	4,680,566	13,679	51,225	596,232	85,915
2017	11,075,378	2.34	63,373	4,740,017	13,370	50,951	604,336	84,309
2018	11,171,510	2.33	64,643	4,798,780	13,471	51,238	610,454	83,935
2019	11,256,787	2.30	65,872	4,886,791	13,480	51,857	622,212	83,344
2020	11,332,537	2.28	69,197	4,960,827	13,949	49,685	628,861	79,007
2021	11,441,385	2.27	67,162	5,036,950	13,334	50,506	636,044	79,407
2022	11,630,105	2.27	69,348	5,113,458	13,562	51,851	641,605	80,814
2023	11,827,634	2.28	70,206	5,179,816	13,554	52,507	642,772	81,689
2024	11,990,462	2.27	70,894	5,287,101	13,409	53,138	650,176	81,729

**Historical Values (2015 - 2024):**

Col. (2) represents population in the area served by the consolidated system.

Col. (4) and Col. (7) represent actual energy sales including the impacts of existing conservation. These values are at the meter.

Col. (5) and Col. (8) represent the annual average of the twelve monthly values.

**Schedule 2.1**  
**Forecast of Energy Consumption**  
**And Number of Customers by Customer Class**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
Year	Population	Members per Household	Rural & Residential			Commercial		
			GWh	Average No. of Customers	Average kWh Consumption Per Customer	GWh	Average No. of Customers	Average kWh Consumption Per Customer
2025	12,228,942	2.28	69,688	5,355,964	13,011	52,838	657,928	80,310
2026	12,426,323	2.29	70,291	5,420,089	12,969	53,168	665,449	79,899
2027	12,554,958	2.29	70,778	5,483,159	12,908	53,260	672,449	79,203
2028	12,656,294	2.28	71,742	5,543,418	12,942	53,598	679,113	78,923
2029	12,759,832	2.28	72,777	5,600,718	12,994	53,921	685,631	78,645
2030	12,865,517	2.27	73,793	5,656,354	13,046	54,126	691,983	78,218
2031	12,973,547	2.27	75,012	5,711,056	13,134	54,311	697,995	77,809
2032	13,082,486	2.27	76,510	5,764,905	13,272	54,475	703,883	77,393
2033	13,191,965	2.27	77,954	5,817,992	13,399	54,556	709,638	76,878
2034	13,300,596	2.27	79,392	5,870,592	13,524	54,566	715,294	76,285

**Projected Values (2025 - 2034):**

Col. (2) represents population in the area served by the consolidated system.

Col. (4) and Col. (7) represent forecasted energy sales that do not include the impact of incremental conservation. These values are at the meter.

Col. (5) and Col. (8) represent the annual average of the twelve monthly values.

**Schedule 2.2**  
**History of Energy Consumption**  
**And Number of Customers by Customer Class**

(1)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
	<b>Industrial</b>			Railroads & Railways	Street & Highway Lighting	Sales to Public Authorities	Sales to Ultimate Consumers
<u>Year</u>	<u>GWh</u>	<u>Average No. of Customers</u>	<u>Average kWh Consumption Per Customer</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>
2015	4,849	11,560	419,443	92	473	23	120,931
2016	4,892	12,012	407,231	92	472	23	120,730
2017	4,693	11,904	394,249	83	473	41	119,614
2018	4,770	11,850	402,549	80	473	23	121,227
2019	4,759	12,043	395,169	82	456	23	123,050
2020	4,749	12,239	388,022	71	445	20	124,166
2021	4,721	12,785	369,236	68	433	19	122,908
2022	4,714	14,094	334,458	71	427	39	126,450
2023	4,617	15,625	295,521	67	420	86	127,904
2024	4,841	15,160	319,325	67	417	29	129,386

**Historical Values (2015 - 2024):**

Col. (11) represents the annual average of the twelve monthly values.

Col. (16) represents actual energy sales including the impacts of existing conservation. These values are at the meter.

Col. (16) = Schedule 2.1 Col. (4) + Schedule 2.1 Col. (7) + Col. (10) + Col. (13) + Col. (14) + Col. (15).



**Schedule 2.2**  
**Forecast of Energy Consumption**  
**And Number of Customers by Customer Class**

(1)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
	<b>Industrial</b>			Railroads & Railways	Street & Highway Lighting	Sales to Public Authorities	Sales to Ultimate Consumers
<u>Year</u>	<u>GWh</u>	<u>Average No. of Customers</u>	<u>Average kWh Consumption Per Customer</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>
2025	4,724	15,748	299,944	68	413	23	127,754
2026	4,735	15,713	301,325	68	376	23	128,661
2027	4,739	15,729	301,312	68	354	23	129,222
2028	6,026	15,822	380,856	68	345	23	131,801
2029	7,313	15,966	458,060	68	339	23	134,441
2030	8,600	16,093	534,419	68	338	23	136,948
2031	9,141	16,156	565,774	68	338	23	138,892
2032	9,679	16,125	600,236	68	338	23	141,092
2033	10,214	15,984	638,985	68	338	23	143,152
2034	10,210	15,751	648,203	68	338	23	144,597

**Projected Values (2025 - 2034):**

Col. (10) and Col.(15) represent forecasted energy sales that do not include the impact of incremental conservation. These values are at the meter.

Col. (11) represents the annual average of the twelve monthly values.

Col. (16) = Schedule 2.1 Col. (4) + Schedule 2.1 Col. (7) + Col. (10) + Col. (13)  
+ Col. (14) + Col. (15).

**Schedule 2.3**  
**History of Energy Consumption**  
**And Number of Customers by Customer Class**

(1)	(17)	(18)	(19)	(20)	(21)
<u>Year</u>	<u>Sales for Resale GWh</u>	<u>Utility Use &amp; Losses GWh</u>	<u>Net Energy For Load GWh</u>	<u>Average No. of Other Customers</u>	<u>Total Average Number of Customers</u>
2015	6,926	6,895	134,752	4,517	5,222,932
2016	6,937	5,981	133,649	4,603	5,293,413
2017	6,711	6,136	132,460	4,674	5,360,931
2018	7,089	6,188	134,504	4,923	5,426,008
2019	7,616	6,499	137,165	5,357	5,526,403
2020	8,503	6,514	139,183	5,743	5,607,670
2021	7,060	6,800	136,768	6,153	5,691,932
2022	8,476	5,990	140,916	6,687	5,775,844
2023	8,167	7,684	143,756	6,947	5,845,160
2024	8,923	7,794	146,103	7,314	5,959,751

**Historical Values (2015 - 2024):**

Col. (19) represents actual energy sales including the impacts of existing conservation.

Col. (19) = Schedule 2.2 Col. (16) + Col. (17) + Col. (18). Historical NEL includes the impacts of existing conservation and agrees to Col. (5) on schedule 3.3.

Col. (20) represents the annual average of the twelve monthly values.

Col. (21) = Schedule 2.1 Col. (5) + Schedule 2.1 Col. (8)  
+ Schedule 2.2 Col. (11) + Col. (20).

**Schedule 2.3**  
**Forecast of Energy Consumption**  
**And Number of Customers by Customer Class**

(1)	(17)	(18)	(19)	(20)	(21)
<u>Year</u>	<u>Sales for Resale GWh</u>	<u>Utility Use &amp; Losses GWh</u>	<u>Net Energy For Load GWh</u>	<u>Average No. of Other Customers</u>	<u>Total Average Number of Customers</u>
2025	8,662	8,377	144,793	7,842	6,037,481
2026	8,666	7,604	144,931	8,433	6,109,683
2027	8,660	8,023	145,905	8,826	6,180,163
2028	8,588	8,172	148,562	9,025	6,247,378
2029	8,264	8,272	150,976	9,230	6,311,545
2030	7,771	8,374	153,094	9,452	6,373,882
2031	7,046	8,437	154,375	9,554	6,434,761
2032	7,018	8,618	156,728	9,554	6,494,467
2033	7,041	8,729	158,922	9,554	6,553,168
2034	7,063	8,814	160,473	9,554	6,611,191

**Projected Values (2025 - 2034):**

Col. (19) represents forecasted energy sales that do not include the impact of incremental conservation and agrees to Col. (2) on Schedule 3.3.

Col. (19) = Schedule 2.2 Col. (16) + Col. (17) + Col. (18).

Col. (20) represents the annual average of the twelve monthly values.

Col. (21) = Schedule 2.1 Col. (5) + Schedule 2.1 Col. (8)  
+ Schedule 2.2 Col. (11) + Col. (20).

**Schedule 3.1**  
**History of Summer Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Wholesale	Retail	Interruptible	Res. Load Management	Residential Conservation	C/I Load Management	C/I Conservation	Net Firm Demand
2015	25,361	1,381	23,980	0	878	1,779	826	1,104	23,657
2016	26,044	1,443	24,601	0	882	1,809	836	1,119	24,326
2017	25,662	1,467	24,194	0	910	1,826	825	1,135	23,927
2018	25,411	1,418	23,993	0	866	1,839	866	1,149	23,679
2019	26,594	1,367	25,227	0	852	1,850	879	1,159	24,863
2020	26,400	1,595	24,805	0	845	1,861	887	1,175	24,668
2021	26,248	1,401	24,847	0	830	1,874	882	1,190	24,536
2022	26,429	1,572	24,857	0	827	1,886	871	1,201	24,731
2023	28,461	1,652	26,808	0	797	1,900	946	1,210	26,718
2024	28,266	1,731	26,535	0	863	1,917	961	1,221	26,442

**Historical Values (2015 - 2024):**

Col. (2) and Col. (3) are actual values for historical Summer peaks. As such, they incorporate the effects of conservation (Col. 7 & Col. 9) and may incorporate the effects of load control if load control was operated on these peak days. Col. (2) represents the actual Net Firm Demand.

Col. (5) through Col. (9) represent actual DSM capabilities and represent annual (12-month) values.

Col. (10) represents a hypothetical "Net Firm Demand" as if the load control values had definitely been exercised on the peak.

Col. (10) is derived by the formula: Col. (10) = Col. (2) - Col.(6) + Col. (8).

**Schedule 3.1**  
**Forecast of Summer Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
August of Year	Total	Wholesale	Retail	Interruptible	Res. Load Management*	Residential Conservation	C/I Load Management*	C/I Conservation	Net Firm Demand
2025	28,312	1,728	26,584	0	937	21	1,025	12	26,317
2026	28,664	1,727	26,937	0	925	40	1,032	19	26,648
2027	28,925	1,723	27,202	0	913	59	1,038	26	26,888
2028	29,333	1,708	27,625	0	902	77	1,043	34	27,277
2029	29,687	1,606	28,081	0	896	95	1,047	41	27,608
2030	29,982	1,484	28,498	0	893	113	1,051	49	27,877
2031	30,301	1,315	28,987	0	891	131	1,055	57	28,168
2032	30,823	1,319	29,504	0	889	148	1,059	65	28,662
2033	31,257	1,323	29,934	0	888	166	1,063	73	29,068
2034	31,677	1,327	30,351	0	887	183	1,067	81	29,459

**Projected Values (2025 - 2034):**

Col. (2) - Col. (4) represent forecasted peak and do not include incremental conservation, cumulative load management, or incremental load management.

Col. (5) through Col. (9) represent cumulative load management, incremental conservation, and load management. All values are projected August values.

Col. (8) represents FPL's Business On Call, CDR, CILC, and curtailable programs/rates.

Col. (10) represents a "Net Firm Demand" which accounts for all of the incremental conservation and assumes all of the load control is implemented on the peak. Col. (10) is derived by the formula: Col. (10) = Col. (2) - Col. (5) - Col. (6) - Col. (7) - Col. (8) - Col. (9).

\* Res. Load Management and C/I Load Management include Lee County and FKEC whose loads are served by FPL.

**Schedule 3.2**  
**History of Winter Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
Year	Total	Firm Wholesale	Retail	Interruptible	Res. Load Management	Residential Conservation	C/I Load Management	C/I Conservation	Net Firm Demand
2015	21,961	1,403	20,558	0	822	1204	551	522	20,588
2016	18,826	1,167	17,659	0	742	1232	570	528	17,514
2017	19,320	1,187	18,133	0	759	1238	577	541	17,984
2018	21,533	1,332	20,201	0	750	1244	588	547	20,194
2019	17,941	1,498	16,442	0	706	1248	613	557	16,621
2020	19,569	1,312	18,257	0	702	1253	614	568	18,253
2021	17,486	1,344	16,142	0	689	1256	619	580	16,178
2022	21,027	1,230	19,797	0	681	1258	628	584	19,718
2023	19,271	1,214	18,057	0	670	1263	631	589	17,970
2024	18,595	1,093	17,502	0	743	1,272	657	597	17,195

**Historical Values (2015 - 2024):**

Col. (2) and Col. (3) are actual values for historical Winter peaks. As such, they incorporate the effects of conservation (Col. 7 & Col. 9) and may incorporate the effects of load control if load control was operated on these peak days. Col. (2) represents the actual Net Firm Demand.

Col. (5) through Col. (9) represent actual DSM capabilities and represent annual (12-month) values.

Col. (10) represents a hypothetical "Net Firm Demand" as if the load control values had definitely been exercised on the peak.

Col. (10) is derived by the formula: Col. (10) = Col. (2) - Col. (6) + Col. (8).

**Schedule 3.2**  
**Forecast of Winter Peak Demand (MW)**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)
January of Year	Total	Firm Wholesale	Retail	Interruptible	Res. Load Management*	Residential Conservation	C/I Load Management*	C/I Conservation	Net Firm Demand
2025	23,042	1,375	21,667	0	778	12	717	7	21,527
2026	23,323	1,377	21,946	0	766	23	722	12	21,800
2027	23,648	1,380	22,268	0	754	35	727	17	22,116
2028	24,136	1,364	22,772	0	742	46	732	22	22,594
2029	24,603	1,313	23,290	0	731	57	735	27	23,053
2030	25,011	1,216	23,795	0	726	68	739	32	23,446
2031	25,384	1,140	24,244	0	721	79	742	37	23,804
2032	25,852	1,144	24,707	0	716	90	746	43	24,256
2033	26,245	1,149	25,096	0	712	102	749	48	24,634
2034	26,638	1,153	25,485	0	708	113	752	54	25,011

**Projected Values (2025 - 2034):**

Col. (2) - Col. (4) represent forecasted peak and do not include incremental conservation, cumulative load management, or incremental load management.

Col. (5) through Col. (9) represent cumulative load management, incremental conservation, and load management. All values are projected January values.

Col. (8) represents FPL's Business On Call, CDR, CILC, and curtailable programs/rates.

Col. (10) represents a "Net Firm Demand" which accounts for all of the incremental conservation and assumes all of the load control is implemented on the peak. Col. (10) is derived by the formula: Col. (10) = Col. (2) - Col. (5) - Col. (6) - Col. (7) - Col. (8) - Col. (9).

\* Res. Load Management and C/I Load Management include Lee County and FKEC whose loads are served by FPL.

**Schedule 3.3**  
**History of Annual Net Energy for Load (GWh)**  
(All values are "at the generator" values except for Col (8))

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
<u>Year</u>	<u>Net Energy For Load without DSM GWh</u>	<u>Residential Conservation GWh</u>	<u>C/I Conservation GWh</u>	<u>Actual Net Energy For Load GWh</u>	<u>Sales for Resale GWh</u>	<u>Utility Use &amp; Losses GWh</u>	<u>Actual Total Retail Sales (GWh)</u>	<u>Load Factor(%)</u>
2015	141,611	3,862	2,997	134,752	6,926	6,895	120,931	60.7%
2016	140,578	3,891	3,038	133,649	6,937	5,981	120,730	58.4%
2017	139,467	3,920	3,088	132,460	6,711	6,136	119,614	58.9%
2018	141,604	3,947	3,153	134,504	7,089	6,188	121,227	60.4%
2019	144,323	3,972	3,186	137,165	7,616	6,499	123,050	58.9%
2020	146,397	3,995	3,219	139,183	8,503	6,514	124,166	60.0%
2021	144,025	4,021	3,236	136,768	7,060	6,800	122,908	59.5%
2022	148,226	4,057	3,253	140,916	8,476	5,990	126,450	60.9%
2023	151,150	4,091	3,303	143,756	8,167	7,684	127,904	57.7%
2024	153,582	4,140	3,339	146,103	8,923	7,794	129,386	58.8%

**Historical Values (2015 - 2024):**

Col. (2) represents derived NEL not including conservation using the formula: Col. (2) = Col. (3) + Col. (4) + Col. (5)

Col. (3) & Col. (4) are annual (12-month) DSM values and represent total GWh reductions experienced each year.

Col. (8) is the Total Retail Sales calculated using the formula: Col. (8) = Col. (5) - Col. (6) - Col. (7). These values are at the meter.

Col. (9) is calculated using Col. (5) from this page and the greater of Col. (2) from Schedules 3.1 and 3.2 using the formula:

Col. (9) = ((Col. (5)\*1000) / ((Col. (2) \* 8760). Adjustments are made for leap years.



**Schedule 3.3**  
**Forecast of Annual Net Energy for Load (GWh)**  
**(All values are "at the generator" values except for Col (8))**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)
	Forecasted Net Energy For Load without DSM	Residential Conservation	C/I Conservation	Net Energy For Load Adjusted for DSM	Sales for Resale	Utility Use & Losses	Forecasted Total Billed Retail Energy Sales w/o DSM	Load Factor(%)
<u>Year</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	<u>GWh</u>	
2025	144,793	75	69	144,649	8,662	8,377	127,754	58.3%
2026	144,931	126	118	144,687	8,666	7,604	128,661	57.6%
2027	145,905	176	168	145,561	8,660	8,023	129,222	57.4%
2028	148,562	225	219	148,118	8,588	8,172	131,801	57.5%
2029	150,976	273	270	150,433	8,264	8,272	134,441	57.8%
2030	153,094	322	322	152,449	7,771	8,374	136,948	58.0%
2031	154,375	371	375	153,629	7,046	8,437	138,892	57.9%
2032	156,728	419	429	155,880	7,018	8,618	141,092	57.6%
2033	158,922	468	483	157,971	7,041	8,729	143,152	57.7%
2034	160,473	515	539	159,419	7,063	8,814	144,597	57.5%

**Projected Values (2025 - 2034):**

Col. (2) represents Forecasted NEL and does not include incremental conservation. It is the summation of Cols. (3) through (5).

Col. (3) & Col. (4) are forecasted values representing reduction on sales from incremental conservation

Col. (5) is forecasted NEL and includes incremental conservation as well company use and losses.

Col. (8) is Total Retail Sales. The values are calculated using the formula: Col. (8) = Col. (2) - Col. (6) - Col. (7).  
These values are at the meter.

Col. (9) is calculated using Col. (5) from this page and Col. (10) from Schedule 3.1 using the formula:

Col. (9) = ((Col. (5)\*1000) / ((Col. (2) \* 8760). Adjustments are made for leap years.

**Schedule 4**  
**Previous Year Actual and Two-Year Forecast of**  
**Total Peak Demand and Net Energy for Load (NEL) by Month**

(1)	(2)	(3)	(4)	(5)	(6)	(7)
	2024 ACTUAL		2025 FORECAST		2026 FORECAST	
	Total		Total		Total	
Month	Peak Demand	NEL	Peak Demand	NEL	Peak Demand	NEL
	MW	GWh	MW	GWh	MW	GWh
JAN	18,595	10,188	23,042	10,542	23,323	10,352
FEB	18,147	9,124	21,421	9,694	21,702	9,820
MAR	20,596	10,676	21,414	10,598	21,691	10,713
APR	21,148	10,783	22,918	11,142	23,211	11,178
MAY	26,889	14,122	25,189	12,760	25,503	12,751
JUN	27,296	13,848	27,189	13,506	27,523	13,559
JUL	27,722	15,298	27,656	14,484	28,006	14,535
AUG	28,266	14,957	28,312	14,663	28,664	14,636
SEP	26,477	14,014	27,191	13,478	27,531	13,488
OCT	26,287	12,059	25,394	12,571	25,711	12,464
NOV	19,524	10,933	22,162	10,605	22,447	10,626
DEC	18,408	10,101	20,935	10,751	21,211	10,807
<b>Annual Values:</b>		<b>146,103</b>		<b>144,793</b>		<b>144,931</b>

Col. (3) annual value shown is consistent with the value shown in Col.(5) of Schedule 3.3.

Cols. (4) through (7) do not include the impacts of cumulative load management, incremental utility conservation, or incremental load management.

***(This page is intentionally left blank.)***

## **CHAPTER III**

---

### **Projection of Incremental Resource Additions**

***(This page is intentionally left blank.)***

### **III. Projection of Incremental Resource Additions**

#### **III.A. FPL's Resource Planning:**

FPL utilizes its well-established, but continually evolving integrated resource planning (IRP) process, in whole or in part as dictated by analysis needs, to determine: (i) the magnitude and timing of needed resources, and (ii) the type of resources that should be added. This section describes FPL's basic IRP process which was used during 2024 and early 2025 to develop the resource plans for FPL's system that are presented in this 2025 Site Plan. It also discusses some of the key assumptions, in addition to a new load forecast discussed in the previous chapter, which were used in developing this resource plan.

#### **Four Fundamental Steps of FPL's Resource Planning:**

The four fundamental steps of FPL's resource planning process are:

Step 1: Determine the magnitude and timing of FPL's new resource needs;

Step 2: Identify which resource options and resource plans can meet the determined magnitude and timing of projected resource needs (*e.g.*, identify competing options and resource plans);

Step 3: Evaluate the competing options and resource plans based on system economics and non-economic factors; and,

Step 4: Select a resource plan and commit, as needed, to near-term options.

Figure III.A.1 graphically outlines the 4 steps.

# Overview of IRP Process: Fundamental Steps

Figure III.A.1: Overview of IRP Process

## Fundamental


### IRP Steps

(1) Determine the magnitude and timing of new resource needs

(2) Identify DSM and generation resource options, perform preliminary analyses, and develop resource plans which can meet the determined magnitude and timing of resource needs

(3) Evaluate the competing resource plans based on system economics and non-economic factors

(4) Finalize Integrated Resource Plan & commit to near-term options

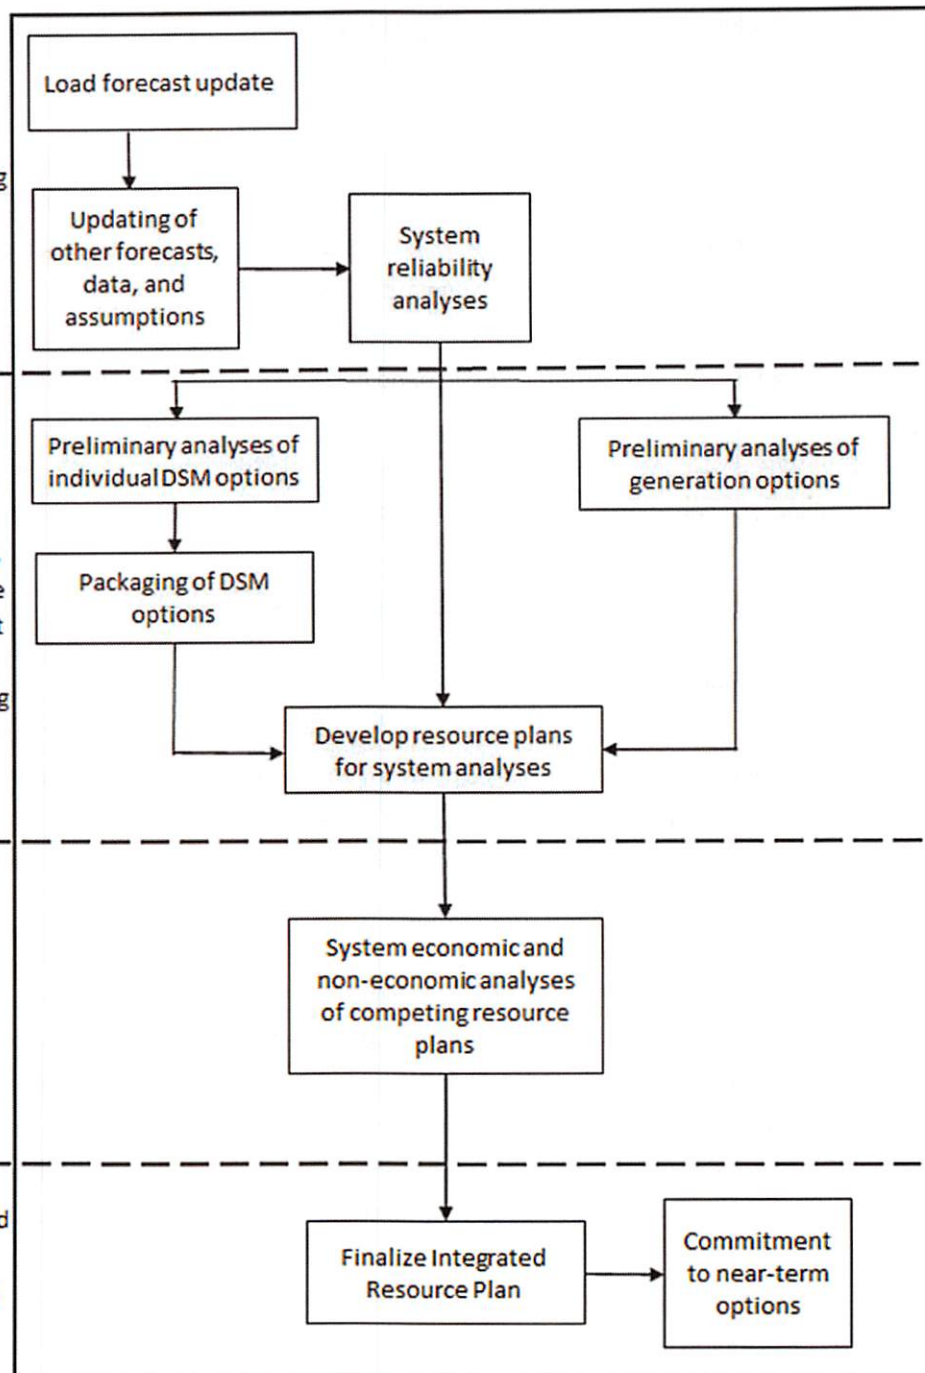

## **Step 1: Determine the Magnitude and Timing of New Resource Needs:**

The first of the four resource planning steps is essentially a determination of the amount and timing of MW load reduction, new capacity additions, or a combination of both, which are needed to maintain and/or enhance system reliability. This step is often referred to as a reliability assessment for the utility system.

This analysis typically starts with an updated load forecast. Several databases are also updated in this first fundamental step, not only with the new information regarding forecasted loads, but also with other information that is used throughout other aspects of FPL's resource planning process. Examples of this new information include: delivered fuel price projections, current financial and economic assumptions, current power plant capability and operating assumptions, costs of new resource additions, and current DSM demand and energy reduction assumptions.

FPL's process also includes key sets of projections regarding three specific types of resources: (1) generating unit capacity changes, (2) firm capacity PPAs, and (3) DSM implementation.

### **Key Assumptions Regarding the Three Types of Resources:**

#### **Generating Unit Capacity Additions:**

The first set of assumptions, generating unit capacity changes, is based on current projections of new generating capacity additions and planned retirements of existing generating units. In this 2025 Site Plan, there are four types of projected generation capacity changes through the ten-year reporting time frame of this document. These changes are listed below in general chronological order:

##### **1. Additional Solar Energy Facilities:**

In this 2025 Site Plan, the resource plan projects the addition of approximately 17,433 MW of new solar PV generation during the 2025-2034 period. These PV additions are projected to be sited throughout FPL's service area. These projected solar additions for 2025-2034, when combined with solar additions made prior to 2025, will result in a total of approximately 24,471 MW of total installed utility PV by the end of 2034.

All PV projected to be added from 2025-2034 are "tracking" solar. In fixed-tilt solar configurations, the solar panels remain facing the same angle, while tracking solar changes the angle of the solar panels to follow the path of the sun during the day, generally resulting



in greater annual energy production, which allows for a greater customer benefit from fuel savings and production tax credits.

## **2. Additional Battery Storage:**

At the end of 2021, a battery storage facility with a projected maximum output of 409 MW was placed in-service at the existing Manatee plant site. This large battery storage facility is charged by solar energy from an existing nearby PV facility. Two 30 MW battery storage facilities were installed at two different locations in the FPL service area and put into service at the end of 2021. Both 30 MW battery storage facilities are also charged by existing solar facilities. In addition, the resource plan presented in this Site Plan projects that an additional 7,603 MW of battery storage facilities will be installed by 2034 throughout FPL's service area.

## **3. Retirement of Existing Generating Units:**

The resource plan for the 2025 TYSP reflects the retirements of two units: Gulf Clean Energy Center Units 4 & 5. These units will be retired at the end of 2029. In the 2024 TYSP, FPL had previously reflected the retirement of its 25% ownership share (215 MW) in the coal-fueled Scherer Unit 3 in Georgia at the end of 2028. As a result of the primary owner of Unit 3, Georgia Power, amending its retirement date for Scherer Unit 3, FPL has had to follow suit and push out its retirement date for its interest in that unit to outside of the ten-year period of this Site Plan.

## **4. Enhancements of Existing Generating Units:**

In its 2024 Site Plan, FPL discussed plans to upgrade the CT components in several of FPL's existing CC units. That upgrade effort is still included in the resource plan presented in this Site Plan. These additional upgrades are projected to be completed by 2028. Information regarding the specific units, timing, and magnitude of these upgrades is presented in Schedule 8 in this chapter.

In addition, FPL implemented a pilot project that results in hydrogen replacing a portion of the natural gas that is currently being used to fuel the existing Okeechobee CC unit. In this pilot project, hydrogen is created by using solar energy, or other energy from the electric grid, to power an electrolyzer that separates water into hydrogen and oxygen (If the hydrogen is created using only solar or other renewable energy sources, the hydrogen is referred to as "green" hydrogen). The resulting hydrogen is then stored in on-site tanks until it is used as a fuel. The objective of the pilot project is to test, in practice, the concept

of blending natural gas with hydrogen as a fuel for CC unit use. This pilot project went into service in late 2023.

**Firm Capacity PPAs:**

The second set of assumptions involves other firm capacity PPAs. These assumptions are generally consistent with those presented in FPL's 2024 Site Plan.

The remaining projected firm capacity purchases are from independent power producers. Details for these other purchases, including the annual total capacity values, are presented in Chapter I in Tables I.A.3.2 and I.A.3.3. These purchased firm capacity amounts were incorporated in the resource planning work that led to the resource plan presented in this document.

**DSM Implementation:**

The third set of assumptions involves a projection of the amount of incremental DSM that FPL anticipates implementing annually over the ten-year reporting period of 2025-2034 for this Site Plan. In April of 2024, FPL filed its proposed 2024 DSM Goals. These Goals were approved by the FPSC and FPL filed a plan to meet these goals in March 2025. This plan accounts for the projected annual amounts of Summer MW reduction, Winter MW reduction, and energy (MWh) reduction for the years 2025-2034.

**The Three Reliability Criteria Used to Determine FPL's Projected Resource Needs:**

FPL's resource planning process applies these key assumptions, plus the other updated information described above, in the first fundamental step: determining the magnitude and timing of future resource needs. This determination is accomplished through system reliability analyses. Until 2014, FPL's reliability analyses were based on dual planning criteria, including a minimum peak-period total reserve margin (TRM) of 20% (FPL applies this criterion to both Summer and Winter peaks) and a maximum LOLP of 0.1 day per year. Both criteria are commonly used throughout the utility industry. Beginning in 2014, FPL began utilizing a third reliability criterion: a 10% GRM.

These reliability criteria utilize two basic types of methodologies: deterministic and probabilistic. The calculation of excess firm capacity at the annual system peaks (reserve margin) is a common method, and this relatively simple deterministic calculation can be performed on a spreadsheet. It provides an indication of the adequacy of a generating system's capacity resources compared to its load during peak periods. However, deterministic methods do not take into account probabilistic-related elements, such as the impact of individual unit failures. For example, two 50 MW units that

can be counted on to run 90% of the time are more valuable in regard to utility system reliability than is one 100 MW unit that also can be counted on to run 90% of the time. Probabilistic methods can also account for the value of being part of an interconnected system with access to multiple capacity sources.

For this reason, probabilistic methodologies have been used to provide an additional perspective on the reliability of a generating system and are used to perform system reliability analyses. Among the most widely used is LOLP, which FPL's resource planning group utilizes. Simply stated, LOLP is an index of how well a generating system may be able to meet its firm demand (*i.e.*, a measure of how often load may exceed available resources). In contrast to reserve margin, the calculation of LOLP looks at the daily peak demands for each year, while taking into consideration such probabilistic events as the unavailability of individual generators due to scheduled maintenance or forced outages.

LOLP is expressed in terms of the projected probability that a utility will be unable to meet its entire firm load at some point during a year. The probability of not being able to meet the firm load is calculated for each day of the year using the daily peak hourly load. These daily probabilities are then summed to develop an annual probability value. This annual probability value is commonly expressed as "the number of days per year" that the system firm load could not be met. The standard for LOLP used by FPL's resource planning group is a maximum of 0.1 day per year which is commonly accepted throughout the industry. This analysis requires a more complicated calculation methodology than the reserve margin analysis. LOLP analyses are typically carried out using computer software models, such as the Tie Line Assistance and Generation Reliability (TIGER) program used by FPL.

Recently, FPL has expanded usage of its LOLP criterion by utilizing a stochastic approach to LOLP modeling. As FPL's system continues to incorporate additional cost-effective intermittent solar generation, the Company is continuing to adapt its resource planning to ensure that customers' reliability needs are met through available, dispatchable resources that provide value to customers. Just as FPL's system has advanced and modernized over time, resource adequacy must also be modernized to consider evolving conditions that affect the delivery of power in times of greatest need. To that end, FPL retained an independent third-party consulting firm, E3 Consulting, to perform a comprehensive, stochastic LOLP analysis to ensure that FPL's proposed system additions optimally address system needs for each hour of the year.

FPL's incorporation of cost-effective solar has increased to the extent that the peak hour of the year – i.e., the hour of greatest demand on the system – is no longer the most critical hour for determining reliability need. Now, the most critical time for capacity on FPL's system is at peak net demand, which most often occurs between 5:00 p.m. and 8:00 p.m., when solar facilities are providing less generation output. For these hours, as well as all other hours throughout the year, FPL needs additional, more modernized modeling analysis to determine its resource adequacy and identify where its greatest resource needs lie. Thus, for its 2025 resource planning, FPL added a stochastic LOLP analysis tailored to its system to identify (1) hourly periods of the year where there is increased likelihood for a loss of load, and (2) available resources that can remediate the potential for that loss.

Stochastic LOLP modeling incorporates vast amounts of data to develop a granular view of a utility's system adequacy in hour-by-hour segments. This modeling incorporates significantly more data in assessing system reliability than a traditional LOLP analysis, providing a substantially wider range of load and generation conditions across numerous scenarios. Through this analysis, a utility can more effectively determine the sufficiency of its hourly generation supply throughout the year, which, in turn, allows it to identify any needed system additions.

The stochastic LOLP analysis incorporates a tremendous amount of system-specific data required to develop a probabilistic hourly load and supply projection and identify the system's reliability needs. In comparison, a traditional reserve margin analysis provides a more limited and simplified look at system operations, examining only the peak demand hour at two times of the year – once in the winter and once in the summer – without considering the unique generation attributes of the utility's fleet. The traditional reserve margin analysis therefore carries analytical shortcomings, particularly for systems that incorporate substantial renewable generation. For example, as FPL's solar generation portfolio has increased, the hours of the day with the least reserves are more likely to be found in the evening as the sun begins to set and solar generation decreases. The traditional reserve margin analysis does not fully reflect this more recent trend. The traditional reserve margin analysis also fails to capture the interactive effects of non-dispatchable generation and load, which have become increasingly challenging to predict and model. The stochastic LOLP analysis addresses these shortcomings by accounting for and modeling these factors, assessing resource availability at every hour of the year and identifying the periods when reserves are most depleted, wherever they may fall.

The stochastic modeling also presents a more sophisticated analysis than FPL's prior LOLP analyses. A traditional LOLP analysis models expected generation unavailability based upon

historic forced outage rates, resulting in a cumulative probability matrix of potential unit outages. The stochastic LOLP analysis, however, simulates a random selection of plant outages, which better reflects the unpredictable nature of unavailable generation as observed in normal system operations. Additionally, a traditional LOLP analysis models an expected solar generation profile, whereas the stochastic LOLP analysis produces a reliability assessment that captures the natural variability in solar production due to weather conditions. The stochastic LOLP model also better captures the synergistic interactions between load and non-dispatchable generation because it models the variability of each input separately.

For FPL's 2025 planning, the consulting firm E3 coordinated with FPL and used hourly temperature data from representative weather stations to develop hourly load profiles using a machine learning algorithm trained on actual load and temperatures from 2003 to 2023. E3 also used historic satellite data to simulate hourly solar generation at each of the current and future solar generating sites for the 1980 to 2023 period, as well as actual historical generating unit availability data to calculate an expected forced outage rate and a mean time to repair for every generating unit in the FPL fleet. The model used these inputs to randomly select which units may experience an outage at any given time within the simulations. FPL has incorporated the results of this study to produce the resource plan in this Site Plan and will continue to examine stochastic LOLP studies to accentuate future resource planning efforts.

FPL's third reliability criterion, the 10% minimum Summer and Winter GRM criterion, augments the other two reliability criteria by providing an indication of the respective roles that DSM and generation are projected to play each year as FPL maintains its 20% Summer and Winter TRMs (which account for both generation and DSM resources). All three reliability criteria are useful to identify the timing and magnitude of the resource needs because of the different perspectives the three criteria provide. In addition, the GRM criterion is particularly useful in providing direction regarding the mix of generation (solar, battery storage, etc.) and DSM resources that should be added to maintain and enhance system reliability.

## **Step 2: Identify Resource Options and Plans That Can Meet the Determined Magnitude and Timing of Projected Resource Needs:**

The initial activities associated with this second fundamental step of resource planning generally proceed concurrently with the activities associated with Step 1. During Step 2, preliminary economic screening analyses of new capacity options that are identical, or virtually identical, in certain key characteristics may be conducted to determine what type of new capacity option

appears to be the most competitive on FPL's system. Preliminary analyses also can help identify capacity size (MW) values, projected construction/permitting schedules, and operating parameters and costs. Similarly, preliminary economic screening analyses of new DSM options and/or evaluation of existing DSM options are often conducted in this second fundamental IRP step when FPL is determining its DSM goals.

FPL's resource planning group typically utilizes an optimization model to perform the preliminary economic screening of generation resource options. For the preliminary economic screening analyses of DSM resource options, FPL typically uses its DSM Conservation, Planning, and Forecasting (CPF) model, which is an FPL spreadsheet model utilizing the FPSC's approved methodology for performing preliminary economic screening of individual DSM measures and programs. Then, as the focus of DSM analyses progresses from analysis of individual DSM measures to the development of DSM portfolios, FPL typically uses two additional models. One is a proprietary non-linear programming (NLP) model that is used to analyze the potential for lowering system peak loads through additional load management/demand response capability. The other model that is utilized is a proprietary linear programming (LP) model with which DSM portfolios are developed.

The next step is typically to "package" the individual new resource options, both Supply options and DSM portfolios, emerging from these preliminary economic screening analyses into different resource plans that are designed to meet the system reliability criteria. In other words, resource plans are created by combining individual resource options so that the timing and magnitude of projected new resource needs are met. The creation of these competing resource plans is typically carried out using spreadsheet and/or dynamic programming techniques.

At the conclusion of the second fundamental resource planning step, different combinations of new resource options (*i.e.*, resource plans) of a magnitude and timing necessary to meet the projected resource needs are identified.

### **Step 3: Evaluate the Competing Options and Resource Plans Based on System Economics and Non-Economic Factors:**

At the completion of fundamental Steps 1 and 2, the most viable new resource options have been identified, and these resource options have been combined into resource plans that each meet the magnitude and timing of projected resource needs. The stage is set for evaluating these resource options and resource plans in system economic analyses that aim to account for all the impacts to

the utility system from the competing resource options/resource plans. FPL's resource planning group typically utilizes the AURORA optimization model to develop and perform the system economic analyses of resource plans. Other spreadsheet models may also be used to further analyze the resource plans.

The basic economic analyses of the competing resource plans focus on total system economics. The standard basis for comparing the economics of competing resource plans is their relative impact on electricity rate levels, with the general objective of minimizing the projected levelized system average electric rate (*i.e.*, a Rate Impact Measure or RIM methodology). In analyses in which the DSM contribution has already been determined through the same IRP process and/or FPSC approval, and therefore the only competing options are new generating units and/or purchase options, comparisons of the impacts of competing resource plans on both electricity rates and system revenue requirements will yield identical outcomes in regard to the relative rankings of the resource options being evaluated. Consequently, the competing options and resource plans in such cases can be evaluated on a system cumulative present value revenue requirement (CPVRR) basis.

FPL's resource planning group also includes other factors in its evaluation of resource options and resource plans. Although these factors may have an economic component or impact, they are often discussed in quantitative but non-economic terms, such as percentages, tons, etc., rather than in terms of dollars. These factors are often referred to as "system concerns or factors," which include reducing emissions, maintaining/enhancing fuel diversity, and maintaining a regional balance between load and generating capacity, particularly in the Southeastern region of FPL's area that consists of Miami-Dade and Broward counties. In conducting the evaluations needed to determine which resource options and resource plans are best for the utility system, the non-economic evaluations are conducted with an eye to whether the system concern is positively or negatively impacted by a given resource option or resource plan. These and other factors are discussed later in this chapter in section III.C.

#### **Step 4: Finalizing the Current Resource Plan**

The results of the previous three fundamental steps are typically used to develop a new or updated resource plan. The current resource plan presented in this 2025 Site Plan is summarized in the following section.

### **III.B. Projected Incremental Resource Changes in the Resource Plan**

The projection of major changes in the resource plan, including both utility-owned generation and PPAs, for the years 2025-2034 is summarized in Table ES-1 in the Executive Summary. In regard to DSM additions, all of the DSM presented in this Site Plan represents FPL's DSM through the end of 2034. Those annual amounts are shown in Schedules 3.1, 3.2, and 3.3 in Chapter II.

A summary of some of the larger resource additions/retirements include those listed below :

- New solar (PV) additions from 2025 through 2034 of approximately 17,433 MW (nameplate);
- A total addition of approximately 7,603 MW of battery storage through 2034;
- Capacity upgrades at several of FPL's existing CC units through 2028;
- The retirement of Gulf Coast Clean Energy Center Units 4 and 5 at the end of 2029; and
- The addition of a 2x0 CT of approximately 475 MW in 2032.

With the exception of certain resource additions and retirements listed above in the earlier years of the 2025-2034 time period addressed in this 2025 Site Plan, FPL notes that final decisions on other resource options shown in this Site Plan are not needed at this time, nor have they been made. This is particularly relevant to resource additions shown for years increasingly further out in the ten-year reporting period. Consequently, those resource additions are more prone to future change.

### **III.C Discussion of the Resource Plan and Issues Impacting Resource Planning Work**

In considering the resource plans presented in this Site Plan, it is useful to note that there are at least ten significant factors that either influenced the current resource plan or which may result in future changes. These factors are discussed below (in no particular order).

#### **1. Impacts of the Tax Credits for Batteries and Solar:**

FPL's resource planning work continues to factor in tax credits for new utility-owned batteries, solar, and hydrogen. For new utility owned standalone batteries, the 30% Investment Tax Credit (ITC) effectively lowers the capital cost for a new battery, with the potential of an additional 10% if the battery is located in a specific area. For new utility-owned solar, a utility can elect a Production Tax Credit (PTC) for new solar that is based on the amount of energy (MWh) the new solar facility generates each year for the first ten years of operation. For future



resource additions, the PTC starts in 2024 at \$30 for each MWh generated.<sup>6</sup> The \$30 per MWh credit amount for a new solar facility that comes in-service increases with inflation each year. FPL's resource plan presented in this Site Plan accounts for the effects of these tax credits.

**2. The critical need to maintain a balance between load and generating capacity in specific regions of FPL's service area, such as in Northwest Florida and Southeastern Florida (Miami-Dade and Broward counties):**

This balance has both reliability and economic implications for FPL's system and customers, and it is a key reason that FPL has expanded generation and transmission in specific areas in the past. The battery storage units that FPL is adding throughout the ten-year period will aid in addressing these balance concerns.

**3. The desire to maintain/enhance fuel diversity in the FPL system while considering system economics and reliability:**

In 2024, FPL used natural gas to generate approximately 72% of the total electricity it delivered to its customers. By 2034, due largely to significant solar additions, the percentage of electricity generated by natural gas for FPL's system is projected to decrease to approximately 46% based on the resource plan presented in this Site Plan. Due to this reliance on natural gas, opportunities to economically maintain and enhance fuel diversity are continually sought, with due consideration given to system economics. For example, FPL is projecting the addition of significant amounts of cost-effective PV generation throughout the ten-year reporting period of this document. These PV additions enhance fuel diversity while at the same time allowing for the lowest cost generation resource to be constructed and operated. To enhance the reliability of these PV solar additions, FPL is planning to add cost-effective battery storage to ensure adequate generation and reserves at the time of the net system peak (FPL's peak after accounting for solar generation).

In the past, coal-fired units have been examined as an option to increase system fuel diversity. However, coal units have ceased to be viable generation options for a number of reasons which include: (i) increased economic competitiveness of solar and battery storage, (ii) much lower forecasted costs for natural gas, (iii) increased availability of natural gas, and (iv) environmental regulations regarding coal units. Consequently, FPL does not believe that new advanced technology coal units are viable fuel diversity enhancement options in Florida.

Therefore, FPL has focused on: (i) cost-effectively adding solar energy and battery storage to enhance fuel diversity and independence, (ii) diversifying the sources of natural gas, (iii) diversifying the gas transportation paths used to deliver natural gas to FPL's generating units, (iv) using natural gas more efficiently, and (v) expanding the ability of its units to burn liquid fuel as a backup to natural gas. FPL has also launched a pilot project that tests the concept of using green hydrogen as a substitute for some of the natural gas now being used to fuel one of its existing CC units.

Solar Energy: The resource plan in this 2025 Site Plan projects that FPL will have a total of approximately 24,471 MW of PV generation by the end of 2034. Such a level of PV nameplate capacity would represent about 77% of FPL's current total installed capacity (MW). However, the impact of PV contribution in terms of actual energy produced (MWh) is smaller. Because solar energy can only be generated during daylight hours and is impacted by factors such as clouds and rain, PV has a capacity factor of approximately 23% to 30% in the state of Florida. As a result, FPL's solar additions would be projected to supply approximately 35% of the total energy (MWh) delivered in 2034 (as shown in Schedule 6.2 later in this chapter).<sup>7</sup>

Based on the resource plan presented in this 2025 Site Plan, it is projected that by 2034 approximately 99% of all energy produced on FPL's system will be that of natural gas, nuclear, and solar, with solar alone accounting for approximately 35% of all the energy produced by the system. This percentage of energy that is projected to be delivered by nuclear and solar energy sources is significant for a utility system of FPL's size, especially when considering that the total amount of energy projected to be delivered to customers in 2034 will have also increased by approximately 11%. The projections of energy by fuel/generation type are presented in Schedules 6.1 and 6.2 later in this chapter.

Nuclear Energy: In 2008, the FPSC approved the need to increase capacity at FPL's four existing nuclear units and authorized the company to recover project-related expenditures that were approved as a result of annual nuclear cost recovery filings. FPL successfully completed this nuclear capacity uprate project. Approximately 520 MW of additional nuclear capacity was delivered by the project, which represents an increase of approximately 30% more incremental capacity than was originally forecasted when the project began. Additional uprates followed which resulted in approximately 40 MW more capacity. FPL's customers are currently benefitting from lower fuel costs and reduced system emissions provided by this additional nuclear capacity.

In June 2009, FPL began the process of securing Combined Operating Licenses (COL) from the federal Nuclear Regulatory Commission (NRC) for two future nuclear units, Turkey Point Units 6 & 7, that would be sited at FPL's Turkey Point site (the location of two existing nuclear generating units). In April 2018, FPL received NRC approval for these two COLs, and these licenses currently remain valid.

FPL has paused the decision whether to seek FPSC approval to move forward with construction of Turkey Point Units 6 & 7. FPL intends to incorporate into any decision regarding Turkey Point Units 6 & 7 the experience gained from the construction and operation of Georgia Power's Vogtle nuclear units. As a result, the earliest possible in-service dates for Turkey Point 6 & 7 are beyond the ten-year period addressed in this 2025 Site Plan. This Site Plan continues to present the Turkey Point location as a Preferred Site for nuclear generation as indicated in Chapter IV.

On January 30, 2018, FPL applied to the NRC for Subsequent License Renewal (SLR) for FPL's existing Turkey Point Units 3 & 4. The previous license terms for these two existing nuclear units extended into the years 2032 and 2033, respectively. The SLR requested approval to extend the operating licenses by 20 years to 2052 and 2053, respectively. The NRC granted approval for the SLR in December 2019. On February 24, 2022, the NRC on its own accord reversed its adjudicatory decision interpreting environmental rules related to SLRs. In particular, the NRC concluded that its environmental review of all pending SLR requests under the National Environmental Policy Act was insufficient due to inadequacies of the NRC's Generic Environmental Impact Statement (GEIS) for license renewal, which is applicable to all plants. With this action, the NRC directed its staff to amend the Turkey Point Units 3 & 4 operating licenses by removing the 20-year term of licensed operation added by the SLR, thereby restoring the previous operating license expiration dates of 2032 and 2033 for Turkey Point Units 3 & 4, respectively.

Following this decision, SLR applicants had the option to satisfy the environmental review requirements either by requesting the NRC Staff to proceed with an entirely site-specific EIS or by waiting for the NRC to issue a revised GEIS that would address all SLR applications. In response to the NRC's action, FPL decided to pursue an entirely site-specific EIS for Turkey Point Units 3 & 4. The NRC completed its site-specific review of the application and reissued the 20-year SLR term for Turkey Point Units 3 and 4 on September 17, 2024. An intervenor's request for hearing on the Turkey Point SLR application was denied and a petition for review of that decision remains pending before the Commission. For purposes of this Site Plan filing,

FPL's resource planning analyses have assumed the continued operation of Turkey Point Units 3 & 4 through the currently pending new license termination dates of 2052 and 2053 for Turkey Point Units 3 & 4, respectively.

In the 3<sup>rd</sup> Quarter of 2021, FPL applied to the NRC for an SLR for its existing St. Lucie nuclear Units 1 & 2. If approved by the NRC, the SLRs for St. Lucie Units 1 & 2 will extend the licenses for those facilities for an additional 20 years until 2056 and 2063, respectively. The NRC schedule for the review of the St. Lucie SLR application has been delayed as the NRC worked to revise its generic EIS for license renewal in response to the Turkey Point SLR decision. FPL chose to wait for the completion of the NRC's revised GEIS and have the NRC incorporate that generic analysis into its St. Lucie review. The revised GEIS was published in August 2024. The current expectation is that the St. Lucie review, which incorporates the GEIS, will be completed in 2026. The revised GEIS is currently subject to a challenge in the Court of Appeals for the D.C. Circuit, but the NRC's review of the application remains ongoing. Similar to the assumption for the Turkey Point Units, FPL's resource planning analyses have assumed the continued operation of St. Lucie Units 1 & 2 through the new license termination dates of 2056 and 2063 for St. Lucie Units 1 & 2, respectively.

FPL is also continuing to monitor advanced nuclear power options such as small modular reactors (SMR). FPL is planning to begin the initial stages of Early Site Permitting in 2026-2027 timeframe, available as permitted under NRC rules, for a potential SMR at a site that is adjacent to an existing nuclear power plant. This strategic move is aimed at minimizing risks, allowing emerging technologies to mature, and ensuring that robust regulatory frameworks are well-developed prior to deployment, while remaining cognizant of the current high costs of nuclear and SMR development and taking a stepwise approach. FPL is closely monitoring current initiatives at both the Department of Energy and the NRC. By taking these steps early on, FPL aims to be well-positioned to benefit from potential state and federal incentives for future nuclear deployment. The projected in-service date of an SMR would be outside the ten-year period addressed in this Site Plan.

Natural gas sourcing and delivery: FPL utilizes several natural gas pipelines to serve our existing natural gas units in Florida. These pipelines provide reliable, economic, and diverse natural gas supply to FPL and the State of Florida. In FPL NWFL, FPL's plants are served by Gulf South Pipeline Company, LP (Gulf South) and the Florida Gas Transmission Company, LLC (FGT). In peninsular Florida, FPL delivers gas using the FGT and the Gulfstream Natural

Gas System (Gulfstream) pipelines along with the Sabal Trail Transmission and the Florida Southeast Connection pipelines which were placed in service in 2017.

Using natural gas more efficiently: FPL has sought ways to utilize natural gas more efficiently for years. Since 2008, FPL has modernized several of its existing plants sites from older, less efficient units into highly efficient CC units with much lower heat rates and higher capacities. These modernized units have improved the overall efficiency of FPL's system, allowing for higher output while using lower amounts of natural gas. This improved efficiency is graphically shown in Figure ES-2 in the Executive Summary.

Dual-fuel capability at existing units: Efforts are being made to maintain the ability to utilize ultra-low sulfur distillate (ULSD) oil at existing units that have that capability. Four new CTs were added at the Gulf Clean Energy Center in late 2021; these units have the capability to burn either natural gas or ULSD fuel oil. Having backup fuel capability ensures the ability of these units to provide generation even during potential disruptions of gas supply.

In the future, FPL's resource planning group will continue to identify and evaluate alternatives that may maintain or enhance system fuel diversity.

**4. The need to maintain an appropriate balance of DSM and supply resources from the perspectives of both system reliability and operations:**

As mentioned earlier in Section III.A, FPL utilizes a 10% GRM to ensure that system reliability is not negatively affected by an overreliance on non-generation resources, particularly at times of extreme load. This GRM reliability criterion was developed as a result of extensive analyses – which have been described in detail in prior FPL Site Plans – of FPL's system from both resource planning and system operations perspectives. The potential for overreliance upon non-generating resources for system reliability remains an important resource planning issue and is one that will continue to be examined in ongoing resource planning work.

**5. The significant impact of federal and state energy efficiency codes and standards:**

As discussed in Chapter II, the load forecasts for FPL include projected impacts from federal and state energy efficiency codes and standards. The magnitude of energy efficiency that is currently projected to be delivered to customers of the single, integrated system through these codes and standards is significant.

These energy efficiency codes and standards are projected to have significant incremental impacts by reducing forecasted Summer and Winter peak loads, and by reducing annual net energy for load (NEL), in FPL's system. From the end of 2024 through the year 2034, these energy efficiency codes and standards are projected to reduce Summer peak load by approximately 2,000 MW, reduce Winter peak load by approximately 520 MW, and reduce annual energy usage by approximately 2,460 GWh.

In addition to lowering the load forecast from what it otherwise would have been, and thus serving to lower projected load and resource needs, this projected energy efficiency from the codes and standards also affects resource planning in another way: it lowers the potential market for utility DSM programs to cost-effectively deliver energy efficiency.

**6. The fuel cost and efficiency of FPL's fossil-fueled generation fleet and the avoidance of fuel costs through increased solar generation:**

There are two main factors that drive utility system costs for FPL's fossil-fueled generation fleet: (i) forecasted natural gas costs, and (ii) the efficiency with which generating units convert fuel into electricity. Forecasted natural gas costs have recently been one of the lowest cost options for fuel, leading to low overall system fuel costs for FPL's customers when compared to other fuels like oil or coal. In addition to these natural gas costs, FPL customers also experience lower rates resulting from two other characteristics of FPL's system: 1) the amount of solar generation on FPL's system and 2) the efficiency of FPL's fossil-fueled generating units.

In 2024, FPL projects that its customers saved approximately \$218 million in system fuel costs from having solar generation on its system. Since 2009 (when FPL began adding large scale universal solar facilities to its generation mix), FPL has avoided over \$1.1 billion of fuel costs because of its solar generation.

In regard to the fuel efficiency of FPL's fossil-fueled generating units, the amount of natural gas (BTU) needed to produce a kWh of electricity has declined from approximately 9,621 in 2001 to approximately 7,095 in 2024. This improvement of approximately 27% in fuel efficiency is truly significant, especially when considering the 20,000 MW-plus magnitude of gas-fueled generation on FPL's system. This significant improvement in FPL's fuel efficiency has resulted in FPL's customers saving \$650 million in fuel costs in 2024, and an estimated cumulative savings for FPL's customers of approximately \$15.3 billion from 2001 through 2024.

**7. Projected changes in CO<sub>2</sub> regulation and associated compliance costs:**

Since 2007, FPL has evaluated potential carbon dioxide (CO<sub>2</sub>) regulation and/or legislation and has utilized projected compliance costs for CO<sub>2</sub> emissions prepared by an independent consultant, ICF, in its resource planning work. FPL continues to utilize ICF's forecast of projected CO<sub>2</sub> compliance costs in its resource planning process. The projected compliance costs in the current plan are the same as those used in the 2024 Ten Year Site Plan.

**8. Projected increases in electric vehicle (EV) adoption:**

FPL's current load forecast continues to project increasing levels of EV adoption throughout the ten-year period. These projected impacts of EVs on annual energy usage and peak loads are discussed in this document in Chapter II. Both the higher MWh and peak hour MW impacts will have resource planning implications.

**9. Enhancing system reliability during extreme weather events:**

Over the past several years, extreme weather events have caused significant outages and disruptions to electric grids across the country. These events include widespread hot weather in California in the summer of 2020, historic cold weather in February 2021 in Texas, and extreme cold conditions throughout the Mid-Atlantic and Southeast around Christmas of 2022. FPL's Northwest FL area has continually set records in winter peak demand, including its latest record peak early in 2025 when widespread snowfall occurred throughout northern Florida. In addition to these events, FPL's service area regularly experiences periods of hotter than average weather throughout the year and hurricanes that can potentially affect the output of its generation fleet. While FPL does not plan its system around extreme events, it continues to believe it is prudent to consider and prepare for the possibility of extreme weather events and the ability to reliably serve customers under those circumstances. To that end, FPL has reviewed the lessons learned from the outages and service disruptions experienced in other jurisdictions and enhanced its own system to ensure it is adequately prepared. This includes winterizing FPL's nuclear and fossil-fueled generation units, enhancing cooperation and preparation between FPL and suppliers of natural gas and fuel oil, and keeping generation units as "extreme winter only" units that will provide the lowest cost backup capacity in the event of extreme winter weather in FPL's service area. The battery storage units that FPL is adding throughout the ten-year period will also provide additional reliable capacity during extreme weather events.

FPL will continue to work with regulatory authorities, such as the Florida PSC, the Federal Energy Regulatory Commission (FERC) and the North American Electric Reliability

Corporation (NERC), to follow their guidance regarding proper planning procedures for extreme weather events.

**10. Ensuring resource adequacy and system reliability throughout the entire year:**

FPL's planning processes center around ensuring the reliability of its bulk electric system. For over the past two decades, the metric that drove most of FPL's reliability needs was its minimum 20% standard reserve margin, calculated at the time of summer and winter peak load. However, FPL's evolving system requires more in-depth reliability metrics to fully analyze resource adequacy across every hour of the year and through various potential scenarios, including variations in load, generating outages, and solar performance. Therefore, FPL has expanded use of its LOLP metric to include stochastic modeling that fully encompasses all of these scenarios, leading to a more robust evaluation of the reliability and resource adequacy of FPL's system. FPL's planned resources in this Site Plan address these resource adequacy concerns.

### **III.D Demand-Side Management (DSM)**

FPL has sought and implemented cost-effective DSM programs since 1978. As such, cost-effective DSM has been a key focus of FPL's resource planning work for more than 40 years. During that time, FPL's DSM programs have included many energy efficiency and load management programs and initiatives.

There are several important factors affecting the feasibility and cost-effectiveness of utility DSM programs. The first factor is the growing impact of federal and state energy efficiency codes and standards. As discussed first in Chapters I and II, and earlier in Section III.C above, the projected incremental impacts of these energy efficiency codes and standards during the 2025-2034 time period has significantly lowered FPL's projected load and resource needs. In addition, these energy efficiency codes and standards significantly reduce the potential for cost-effective utility DSM programs.

Another factor placing downward pressure on the cost-effectiveness of utility DSM on the FPL system is the steadily increasing efficiency with which FPL generates electricity. FPL's generating system has steadily become more efficient in its ability to generate electricity using less fossil fuel. For example, the FPL system is projected to use 27% less fossil fuel to generate a MWh in 2025 than it did in 2001. Again, this is very good for FPL's customers because it helps to significantly



lower fuel costs and electric rates. However, the improvements in generating system efficiency affect DSM cost-effectiveness by lowering the system fuel costs of energy delivered to FPL's customers. Therefore, the improvements in generating system efficiency reduce the potential fuel savings benefits from the kWh reduction impacts of DSM, thus lowering potential DSM benefits and DSM cost-effectiveness. As FPL adds more and more solar to its system, the overall efficiency of its system will continue to improve. Although the efficiency of FPL's system reduces possible benefits from DSM, FPL will continue to look for innovations and opportunities to cost-effectively empower customers and add system benefits through its DSM programs in the future.

In 2024, new DSM goals for the period 2025-2034 were approved in Docket No. 20240012-EG. FPL filed a DSM Plan to achieve these goals in March 2025. The DSM impacts contained in this Site Plan reflect the demand and energy impacts associated with the currently approved goals and proposed programs.

#### **DSM Programs and Research & Development Efforts in FPL's 2025 DSM Plan**

##### **1. Residential Home Energy Survey (HES)**

This program educates customers on energy efficiency and encourages implementation of recommended practices and measures, even if these are not included in FPL's DSM programs. The HES is also used to identify potential candidates for other FPL DSM programs.

##### **2. Residential Load Management (On Call)**

This program allows FPL to turn off certain customer-selected appliances using FPL-installed equipment during periods of extreme demand, capacity shortages, system emergencies, or for system frequency regulation. This program also includes a new HVAC on-bill option pilot.

##### **3. Residential HVAC**

This program encourages customers to install high-efficiency central air-conditioning systems.

##### **4. Residential Ceiling Insulation**

This program encourages customers to improve their home's thermal efficiency.

**5. Residential New Construction (BuildSmart®)**

This program encourages builders and developers to design and construct new homes to achieve BuildSmart® certification and move towards ENERGY STAR® qualifications.

**6. Residential Low Income**

This program assists low-income customers through FPL-conducted Energy Retrofits and state Weatherization Assistance Provider (WAP) agencies.

**7. Residential Low Income Renter Pilot**

This program encourages the adoption of high efficiency HVAC equipment in low-income rental properties.

**8. Business Energy Evaluation (BEE)**

This program educates customers on energy efficiency and encourages implementation of recommended practices and measures, even if these are not included in FPL's DSM programs. The BEE is also used to identify potential candidates for other FPL DSM programs.

**9. Commercial/Industrial Demand Reduction (CDR)**

This program allows FPL to control customer loads of 200 kW or greater during periods of extreme demand, capacity shortages, or system emergencies.

**10. Commercial/Industrial Load Control (CILC)**

This program allows FPL to control customer loads of 200 kW or greater during periods of extreme demand, capacity shortages, or system emergencies. It was closed to new participants as of December 31, 2000.

**11. Commercial Curtailable Load Program**

This program allows FPL to request curtailment of customer loads with a minimum commitment of 4,000 kW of Non-Firm Demand during periods of capacity shortages or system emergencies. The program was closed to new participants December 31, 2021.

**12. Business On-Call**

This program allows FPL to turn off customers' direct expansion central electric air conditioning units using FPL-installed equipment during periods of extreme demand, capacity shortages, or system emergencies.

**13. Business Heating, Ventilating and Air Conditioning (HVAC)**

This program encourages customers to install high-efficiency HVAC systems.

**14. Business Lighting**

This program encourages customers to install high-efficiency lighting systems.

**15. Business Custom Incentive (BCI)**

This program encourages customers to install unique high-efficiency technologies not covered by other FPL DSM programs.

**16. Conservation Research & Development (CRD) Project**

This project consists of industry research and studies designed to: identify new energy-efficient technologies; evaluate and quantify their impacts on energy, demand and customers; and where appropriate and cost-effective, incorporate an emerging technology into a DSM program.

### III.E Transmission Plan

The transmission plan will allow for the reliable delivery of the required capacity and energy to FPL's retail and wholesale customers. The following table presents FPL's proposed future additions of 230 kV and above bulk transmission lines that must be certified under the Transmission Line Siting Act (TLSA). There is one such line in the FPL system for this ten-year reporting period.

**Table III.E.1: List of Proposed Power Lines**

(1)	(2)	(3)	(4)	(5)	(6)	(7)
Line Ownership	Terminals (To)	Terminals (From)	Line Length CKT. Miles	Commercial In-Service Date (Mo/Yr)	Nominal Voltage (KV)	Capacity (MVA)
FPL	Sweatt <sup>1/</sup>	Whidden	79	June/2026	230	1195

<sup>1/</sup> Need Determination for the Whidden to Sweatt project was approved on May 17, 2022, and Conditions of Certification were received in September 2022. The project is scheduled to be completed by June 2026.

There will also be transmission facilities needed to connect several projected generation capacity additions to the FPL transmission system. These transmission facilities are described on the following pages. Sites for longer term additions, such as projected PV and BESS additions for 2027 and beyond, have not yet been definitively determined so no transmission analyses for these additions have been performed.

### **III.E.1 Transmission Facilities for the Canoe Battery Energy Storage System Center in Okaloosa County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Canoe Battery Energy Storage System Center in Okaloosa County in the 4<sup>th</sup> Quarter of 2025 is projected to be:

#### **I.Substation:**

1. Extend the existing 34.5 kV bus at Mink Substation to connect the BESS.
2. Add relays and other protective equipment.
3. Breaker replacements: None

#### **II.Transmission:**

1. No additional transmission work is required.
2. No upgrades are expected to be necessary at this time.

### **III.E.2 Transmission Facilities for the Blackwater Battery Energy Storage System Center in Santa Rosa County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Blackwater Battery Energy Storage System Center in Santa Rosa County in the 4<sup>th</sup> Quarter of 2025 is projected to be:

#### **I. Substation:**

1. Extend the existing 34.5 kV bus at Rooster Substation to connect the BESS.
2. Add relays and other protective equipment.
3. Breaker replacements: None

#### **II. Transmission:**

1. No additional transmission work is required.
2. No upgrades are expected to be necessary at this time.

### **III.E.3 Transmission Facilities for the Chipola River Battery Energy Storage System Center in Calhoun County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Chipola River Battery Energy Storage System Center in Calhoun County in the 4<sup>th</sup> Quarter of 2025 is projected to be:

#### **I. Substation:**

1. Extend the existing 34.5 kV bus at Melvin Substation to connect the BESS.
2. Add relays and other protective equipment.
3. Breaker replacements: None

#### **II. Transmission:**

1. No additional transmission work is required.
2. No upgrades are expected to be necessary at this time.

### **III.E.4 Transmission Facilities for the Fourmile Creek Battery Energy Storage System Center in Calhoun County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Fourmile Creek Battery Energy Storage System Center in Calhoun County in the 4<sup>th</sup> Quarter of 2025 is projected to be:

#### **I. Substation:**

1. Extend the existing 34.5 kV bus at Quincy Substation to connect the BESS.
2. Add relays and other protective equipment.
3. Breaker replacements: None

#### **II. Transmission:**

1. No additional transmission work is required.
2. No upgrades are expected to be necessary at this time.



### **III.E.5 Transmission Facilities for the Tenmile Creek Battery Energy Storage System Center in Calhoun County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Tenmile Creek Battery Energy Storage System Center in Calhoun County in the 4<sup>th</sup> Quarter of 2025 is projected to be:

#### **I. Substation:**

1. Extend the existing 34.5 kV bus at Tenmile Substation to connect the BESS.
2. Add relays and other protective equipment.
3. Breaker replacements: None

#### **II. Transmission:**

1. No additional transmission work is required.
2. No upgrades are expected to be necessary at this

### **III.E.6 Transmission Facilities for the Shirer Branch Battery Energy Storage System Center in Calhoun County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Shirer Branch Battery Energy Storage System Center in Calhoun County in the 4<sup>th</sup> Quarter of 2025 is projected to be:

#### **I. Substation:**

1. Extend the existing 34.5 kV bus at Mayo Substation to connect the BESS.
2. Add relays and other protective equipment.
3. Breaker replacements: None

#### **II. Transmission:**

1. No additional transmission work is required.
2. No upgrades are expected to be necessary at this time.

### **III.E.7 Transmission Facilities for the Kayak Battery Energy Storage System Center in Okaloosa County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Kayak Battery Energy Storage System Center in Okaloosa County in the 4<sup>th</sup> Quarter of 2025 is projected to be:

#### **I. Substation:**

1. Extend the existing 34.5 kV bus at Kayak Substation to connect the BESS.
2. Add relays and other protective equipment.
3. Breaker replacements: None

#### **II. Transmission:**

1. No additional transmission work is required.
2. No upgrades are expected to be necessary at this time.

### **III.E.8 Transmission Facilities for the Flatford Solar Energy Center in Manatee County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Flatford Solar Energy Center in Manatee County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new single bus, two (2) breaker 230 kV substation (Flatford) on the project site, adjacent to the Gridiron - Lemur 230 kV line corridor.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array at Flatford substation.
3. Construct 34.5 kV bus to connect the PV array to Flatford 230 kV substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. Loop the Gridiron - Lemur 230 kV line into Flatford substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.9 Transmission Facilities for the Mare Branch Solar Energy Center in DeSoto County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Mare Branch Solar Energy Center in DeSoto County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new 230 kV substation (Stallion) on the project site.
2. Add one 230 kV line switch at Whidden for string bus to Stallion substation (approximately 7.0 miles).
3. Add one 230kV breaker at Stallion substation.
4. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
5. Construct 34.5 kV bus to connect the PV array to Stallion 230 kV substation.
6. Add relays and other protective equipment.
7. Breaker replacements: None

#### **II. Transmission:**

1. Construct approximately 7.0 miles string bus from Whidden 230 kV to Stallion substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.10 Transmission Facilities for the Price Creek Solar Energy Center in Columbia County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Price Creek Solar Energy Center in Columbia County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new single bus, two (2) breaker 230 kV substation (Madonna) on the project site, adjacent to the Claude - Raven 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array at Madonna substation.
3. Construct 34.5 kV bus to connect the PV array to Madonna 230 kV substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. Loop the adjacent Claude - Raven 230 kV into Madonna substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.11 Transmission Facilities for the Swamp Cabbage Solar Energy Center in Hendry County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Swamp Cabbage Solar Energy Center in Hendry County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new single bus, two (2) breaker 230 kV substation (Swamp) on the project site, approximately 3.15 miles from the Alva - Witt 230 kV line corridor.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array at Swamp substation.
3. Construct 34.5 kV bus to connect the PV array to Swamp 230 kV substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. Loop the Alva - Witt 230 kV line (approximately 3.15 miles) into Swamp substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.12 Transmission Facilities for the Big Brook Solar Energy Center in Calhoun County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Big Brook Solar Energy Center in Calhoun County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new single bus, two (2) breaker 230 kV substation (Song) on the project site, adjacent to the Melvin – Tenmile 230 kV line corridor.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array at Song substation.
3. Construct 34.5 kV bus to connect the PV array to Song 230 kV substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. Loop the Melvin - Tenmile 230 kV line into Song substation.
2. No additional upgrades are expected to be necessary at this time.



### **III.E.13 Transmission Facilities for the Mallard Solar Energy Center in Brevard County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Mallard Solar Energy Center in Brevard County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new 230 kV substation (Goodwin) on the project site.
2. Add one 230 kV line switch at Crayfish for string bus to Goodwin substation (approximately 0.7 miles).
3. Add one 230kV breaker at Goodwin substation
4. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
5. Construct 34.5 kV bus to connect the PV array to Goodwin 230 kV substation.
6. Add relays and other protective equipment.
7. Breaker replacements: None

#### **II. Transmission:**

1. Construct approximately 0.7 miles string bus from Crayfish 230 kV to Goodwin substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.14 Transmission Facilities for the Boardwalk Solar Energy Center in Collier County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Boardwalk Solar Energy Center in Collier County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Extend 500 kV bus at Puma substation to a new substation (Boardwalk) and interconnect the 500/34.5kV transformer through a 500kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Boardwalk 500 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None.

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.15 Transmission Facilities for the Goldenrod Solar Energy Center in Collier County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Goldenrod Solar Energy Center in Collier County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Extend 500 kV bus at Boardwalk substation and interconnect the 500/34.5kV transformer through a 500kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Boardwalk 500 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.16 Transmission Facilities for the North Orange Solar Energy Center in St. Lucie County**

The work required to connect the approximate 74.5 MW (nameplate, AC) North Orange Solar Energy Center in St. Lucie County in the 2<sup>nd</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new single bus, two (2) breaker 230 kV substation (Apricot) on the project site, adjacent to the future Sunbreak – future Muscadine 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array at Apricot substation.
3. Construct 34.5 kV bus to connect the PV array to Apricot 230 kV substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. Loop the adjacent Sunbreak - Muscadine 230 kV into Apricot substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.17 Transmission Facilities for the Sea Grape Solar Energy Center in St. Lucie County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Sea Grape Solar Energy Center in St. Lucie County in the 2<sup>nd</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new single bus, two (2) breaker 230 kV substation (Muscadine) on the project site, adjacent to the future Sunbreak - Morrow 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array at Muscadine substation.
3. Construct 34.5 kV bus to connect the PV array to Muscadine 230 kV substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. Loop the adjacent Sunbreak - Morrow 230 kV into Muscadine substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.18 Transmission Facilities for the Clover Solar Energy Center in St. Lucie County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Clover Solar Energy Center in St. Lucie County in the 2<sup>nd</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new 230 kV substation (Clover) on the project site.
2. Add one 230 kV line switch at future Sunbreak for string bus to Clover substation (approximately 0.1 miles).
3. Add one 230kV breaker at Clover substation.
4. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array.
5. Construct 34.5 kV bus to connect the PV array to Clover 230 kV substation.
6. Add relays and other protective equipment.
7. Breaker replacements: None

#### **II. Transmission:**

1. Construct approximately 0.1 miles string bus from Sunbreak 230 kV to Clover substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.19 Transmission Facilities for the Sand Pine Solar Energy Center in Calhoun County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Sand Pine Solar Energy Center in Calhoun County in the 2<sup>nd</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Quincy substation to a new substation (Chinkapin) and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Chinkapin 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None.

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.20 Transmission Facilities for the Hendry Solar Energy Center in Hendry County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Hendry Solar Energy Center in Hendry County in the 1<sup>st</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 500 kV bus at Ghost substation and interconnect the 500/34.5kV transformer through a 500kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Ghost 500 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.



### **III.E.21 Transmission Facilities for the Tangelo Solar Energy Center in Okeechobee County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Tangelo Solar Energy Center in Okeechobee County in the 1<sup>st</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Seville substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Seville 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.22 Transmission Facilities for the Wood Stork Solar Energy Center in St. Lucie County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Wood Stork Solar Energy Center in St. Lucie County in the 1<sup>st</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Glint substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Glint 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.23 Transmission Facilities for the Indrio Solar Energy Center in St. Lucie County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Indrio Solar Energy Center in St. Lucie County in the 1<sup>st</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Construct a new single bus, two (2) breaker 230 kV substation (Estuary) on the project site, adjacent to the new Sunbreak - Heritage 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array at Estuary substation.
3. Construct 34.5 kV bus to connect the PV array to Estuary 230 kV substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. Loop the adjacent new Sunbreak - Heritage 230 kV into Estuary substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.24 Transmission Facilities for the Middle Lake Solar Energy Center in Madison County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Middle Lake Solar Energy Center in Madison County in the 2<sup>nd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 161 kV bus at Bandit substation and interconnect the 161/34.5kV transformer through a 161kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Bandit 161 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.25 Transmission Facilities for the Ambersweet Solar Energy Center in Indian River County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Ambersweet Solar Energy Center in Indian River County in the 2<sup>nd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Construct a new single bus, three (3) breaker 230 kV substation (Ambersweet) on the project site, adjacent to the new Sunbreak - Kiran 230 kV line.
2. Add one 230/34.5 kV main step-up transformer (85 MVA) with a 230 kV breaker to connect PV inverter array at Ambersweet substation.
3. Construct 34.5 kV bus to connect the PV array to Ambersweet 230 kV substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. Loop the adjacent new Sunbreak - Kiran 230 kV into Ambersweet substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.26 Transmission Facilities for the County Line Solar Energy Center in DeSoto County**

The work required to connect the approximate 74.5 MW (nameplate, AC) County Line Solar Energy Center in DeSoto County in the 2<sup>nd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Notts substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Notts 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.27 Transmission Facilities for the Saddle Solar Energy Center in DeSoto County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Saddle Solar Energy Center in DeSoto County in the 2<sup>nd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Ponna substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Ponna 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.28 Transmission Facilities for the Cocoplum Solar Energy Center in Hendry County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Cocoplum Solar Energy Center in Hendry County in the 3<sup>rd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Witt to a new (Mulberry) substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Mulberry 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.



### **III.E.29 Transmission Facilities for the Catfish Solar Energy Center in Okeechobee County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Catfish Solar Energy Center in Okeechobee County in the 3<sup>rd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Pyrite substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Pyrite 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.30 Transmission Facilities for the Hardwood Hammock Solar Energy Center in Walton County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Hardwood Hammock Solar Energy Center in Walton County in the 3<sup>rd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Quail substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Quail 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.31 Transmission Facilities for the Maple Trail Solar Energy Center in Baker County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Maple Trail Solar Energy Center in Baker County in the 3<sup>rd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Deodar substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Deodar 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.32 Transmission Facilities for the Pinecone Solar Energy Center in Calhoun County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Pinecone Solar Energy Center in Calhoun County in the 3<sup>rd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Chinkapin substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Chinkapin 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.33 Transmission Facilities for the Joshua Creek Solar Energy Center in DeSoto County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Joshua Creek Solar Energy Center in DeSoto County in the 3<sup>rd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Stallion substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Stallion 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.34 Transmission Facilities for the Spanish Moss Solar Energy Center in St. Lucie County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Spanish Moss Solar Energy Center in St. Lucie County in the 3<sup>rd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Apricot substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
3. Construct 34.5 kV bus to connect the PV array to Apricot 230 kV Substation.
4. Add relays and other protective equipment.
5. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.

### **III.E.35 Transmission Facilities for the Vernia Solar Energy Center in Indian River County**

The work required to connect the approximate 74.5 MW (nameplate, AC) Vernia Solar Energy Center in Indian River County in the 3<sup>rd</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Ambersweet substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Ambersweet 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

- I. No additional upgrades are expected to be necessary at this time.

### **III.E.36 Transmission Facilities for the LaBelle Solar Energy Center in Hendry County**

The work required to connect the approximate 74.5 MW (nameplate, AC) LaBelle Solar Energy Center in Hendry County in the 1<sup>st</sup> Quarter of 2028 is projected to be:

#### **I. Substation:**

1. Extend 230 kV bus at Swamp substation and interconnect the 230/34.5kV transformer through a 230kV breaker.
2. Construct 34.5 kV bus to connect the PV array to Swamp 230 kV Substation.
3. Add relays and other protective equipment.
4. Breaker replacements: None

#### **II. Transmission:**

1. No additional upgrades are expected to be necessary at this time.



### **III.E.37 Transmission Facilities for the Lansing Smith Battery Energy Storage Center in Bay County**

The work required to connect the approximate two 200 MW (nameplate, AC) each Lansing Smith Battery Energy Center in Bay County in the 1<sup>st</sup> Quarter of 2026 is projected to be:

#### **I. Substation:**

1. Construct a new 230 kV substation (Parakeet) on the project site.
2. Add one 230 kV line switch at Lansing Smith for string bus to Parakeet substation (approximately 0.26 miles).
3. Add two 230/34.5 kV main step-up transformers (225 MVA) with a 230 kV breaker each to connect BESS.
4. Construct 34.5 kV bus to connect the BESS to Parakeet 230 kV substation.
5. Add relays and other protective equipment.
6. Breaker replacements: None

#### **II. Transmission:**

1. Construct approximately 0.26 miles string bus from Lansing Smith 230 kV to Parakeet substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.E.38 Transmission Facilities for the Putnam Battery Energy Storage Center in Putnam County**

The work required to connect the approximate 200 MW (nameplate, AC) Putnam Battery Energy Center in Putnam County in the 1<sup>st</sup> Quarter of 2027 is projected to be:

#### **I. Substation:**

1. Construct a new 115 kV substation (Putnam BESS U1) on the project site.
2. Add one 115 kV line switch at Putnam switchyard for string bus to Putnam BESS U1 substation (approximately 0.3 miles).
3. Add one 115/34.5 kV main step-up transformers (85 MVA) with a 115 kV breaker to connect the BESS.
4. Construct 34.5 kV bus to connect the BESS to Putnam BESS U1 115 kV substation.
5. Add relays and other protective equipment.
6. Breaker replacements: None

#### **II. Transmission:**

1. Construct approximately 0.3 miles string bus from Putnam switchyard 115 kV to Putnam BESS U1 substation.
2. No additional upgrades are expected to be necessary at this time.

### **III.F. Renewable Resources and Storage Technology**

#### **FPL's Renewable Energy Efforts Through 2024:**

FPL has been the leading Florida utility in examining ways to effectively utilize renewable energy technologies to serve its customers. Since 1976, FPL has been an industry leader in renewable energy research and development and in facilitating the implementation of various renewable energy technologies. FPL's (including FPL NWFL) renewable energy efforts through 2024 are briefly discussed below in five categories of solar/renewable activities. Plans for new renewable energy facilities from 2025-2034 are then discussed in a separate section.

##### **1) Early Research & Development Efforts:**

In the late 1970s, FPL assisted the Florida Solar Energy Center (FSEC) in demonstrating the first residential PV system east of the Mississippi River. This PV installation at FSEC's Brevard County location was in operation for more than 15 years and provided valuable information about PV performance capabilities in Florida on both a daily and annual basis. In 1984, FPL installed a second PV system at its Flagami substation in Miami. This 10-kilowatt (kW) system operated for several years before it was removed to make room for substation expansion. In addition, FPL maintained a thin-film PV test facility at the FPL Martin Plant Site for several years to test new thin-film PV technologies.

##### **2) Demand-Side & Customer Efforts:**

In terms of utilizing renewable energy sources to meet its customers' needs, FPL initiated the first utility-sponsored conservation program in Florida designed to facilitate the implementation of solar technologies by its customers. FPL's Conservation Water Heating Program, first implemented in 1982, offered incentive payments to customers who chose solar water heaters. Before the program ended (because it was no longer cost-effective), FPL paid incentives to approximately 48,000 customers who installed solar water heaters.

In the mid-1980s, FPL introduced another renewable energy program, FPL's Passive Home Program. This program was created to broadly disseminate information about passive solar building design techniques that are most applicable in Florida's climate. As part of this program, three Florida architectural firms created complete construction blueprints for six passive home designs with the assistance of the FSEC and FPL. These designs and blueprints were available to customers at a low cost. During its existence, the program received a U.S.

Department of Energy award for innovation and led to a revision of the Florida Model Energy Building Code which was the incorporation of one of the most significant passive design techniques highlighted in the program: radiant barrier insulation.

FPL has continued to analyze and promote PV utilization. These efforts have included PV research, such as the 1991 research project to evaluate the feasibility of using small PV systems to directly power residential swimming pool pumps. FPL's PV efforts also included educational efforts, such as FPL's Next Generation Solar Station Program. This initiative delivered teacher training and curriculum that was tied to the Sunshine Teacher Standards in Florida. The program provided teacher grants to promote and fund projects in the classrooms.

Gulf Power (Gulf) offered customers the opportunity to contribute to the development of solar PV beginning with the Solar for Schools program in its 1995 DSM Plan. This voluntary program ultimately developed multiple PV installations in schools across Northwest Florida and was used primarily for educational purposes. In 1999, Gulf offered customers an additional opportunity through an optional rate rider. The PV Rate Rider program was intended to give customers an opportunity to contribute towards the construction of a solar PV facility along with other customers across the Southern Company territory.

In 2008, Gulf received FPSC approval to offer an experimental solar water heating program. This program was intended to help customers overcome the high initial cost of adopting solar thermal water heating technology. The program spanned three years and was absorbed into a larger portfolio of renewable program offerings in Gulf's 2010 DSM Plan.

In 2009, as part of its DSM Goals decision, the FPSC imposed a requirement for Florida's investor-owned utilities to spend up to a certain capped amount annually to facilitate demand-side solar water heater and PV applications. The annual spending caps for these applications over the five-year period was approximately \$15.5 million per year for FPL and approximately \$576,000 per year for Gulf. In response to this direction, FPL received approval from the FPSC in 2011 to initiate a solar pilot portfolio consisting of three PV-based programs and three solar water heating-based programs, plus a Renewable Research and Demonstration project. Gulf received similar approval from the FPSC in 2011 to initiate a solar pilot portfolio consisting of two PV-based programs and two solar water heating-based programs. Analyses of the results by both FPL and Gulf from these pilot programs since their inception consistently showed that none of these pilot programs were cost-effective for customers using any of the three cost-effectiveness screening tests used by the State of Florida. As a result, consistent with the

FPSC's December 2014 DSM Goals Order No. PSC-14-0696-FOF-EU, these pilot programs expired on December 31, 2015.

Gulf conducted market research in 2015 indicating customer interest in a renewable energy alternative to private rooftop PV. After further research into innovative offerings across the industry, Gulf developed a subscription-based program model commonly known as community solar. Gulf received FPSC approval in 2016 for a Community Solar program intended to facilitate construction of a 1 MW facility in Northwest Florida once adequate subscriptions were secured. However, customer interest was not adequate enough to justify construction of the project.

In addition, FPL assists customers interested in installing PV equipment at their facilities. Consistent with Rule 25-6.065, F.A.C., Interconnection and Net Metering of Customer-Owned Renewable Generation, FPL works with customers to interconnect these customer-owned PV systems. Through December 2024, approximately 113,097 customer systems (predominantly residential) have been interconnected with FPL (including FPL NWFL). These values represent approximately 2% of FPL's total number of customer accounts.

**3) Supply Side Efforts – Power Purchases:**

FPL has facilitated several renewable energy projects (facilities which burn bagasse, waste wood, municipal waste, etc.) through PPAs. FPL purchases firm capacity and energy, and/or as-available energy, from these types of facilities. For example, FPL has a contract to receive firm capacity from the Solid Waste Authority of Palm Beach (SWA) through April 2034.

FPL currently has three PPAs with solar facilities totaling approximately 120 MW of nameplate capacity. In addition, FPL has two PPAs totaling approximately 81 MW based, at least in part, on receiving firm amounts of hourly energy from out-of-state sources that were originally wind-generated. Tables I.A.3.1, I.A.3.2, and I.A.3.3 in Chapter I provide information regarding both firm and non-firm capacity PPAs from renewable energy facilities in the two areas.

**4) Supply Side Efforts – Utility Owned Facilities:**

At the time this Site Plan is filed (April 1, 2025), FPL will own 108 universal solar generating facilities. All of these facilities are PV facilities and together they represent approximately 7,932 MW (nameplate) of generation for FPL. Each of these solar facilities is listed below in Table III.F.1.

**Table III.F.1: List of FPL-Owned Solar Facilities Through April 1<sup>st</sup>, 2025**

	<b>Solar Energy Center</b>	<b>County</b>	<b>Nameplate MW</b>	<b>Type</b>	<b>COD</b>
1	DeSoto	DeSoto	25	Tracking	Oct-09
2	Space Coast	Brevard	10	Fixed	Apr-10
3	Manatee	Manatee	74.5	Fixed	Dec-16
4	Citrus	Desoto	74.5	Fixed	Dec-16
5	Babcock Ranch	Charlotte	74.5	Fixed	Dec-16
6	Horizon	Alachua/Putnam	74.5	Fixed	Jan-18
7	Coral Farms	Putnam	74.5	Fixed	Jan-18
8	Wildflower	DeSoto	74.5	Fixed	Jan-18
9	Indian River	Indian River	74.5	Fixed	Jan-18
10	Blue Cypress	Indian River	74.5	Fixed	Mar-18
11	Barefoot Bay	Brevard	74.5	Fixed	Mar-18
12	Hammock	Hendry	74.5	Fixed	Mar-18
13	Loggerhead	St. Lucie	74.5	Fixed	Mar-18
14	Miami-Dade	Miami-Dade	74.5	Fixed	Jan-19
15	Interstate	St. Lucie	74.5	Fixed	Jan-19
16	Sunshine Gateway	Columbia	74.5	Fixed	Jan-19
17	Pioneer Trail	Volusia	74.5	Fixed	Jan-19
18	Sweetbay	Martin	74.5	Fixed	Jan-20
19	Northern Preserve	Baker	74.5	Fixed	Jan-20
20	Cattle Ranch	DeSoto	74.5	Tracking	Jan-20
21	Twin Lakes	Putnam	74.5	Tracking	Jan-20
22	Blue Heron	Hendry	74.5	Fixed	Jan-20
23	Babcock Preserve	Charlotte	74.5	Fixed	Jan-20
24	Hibiscus	Palm Beach	74.5	Fixed	Apr-20
25	Okeechobee	Okeechobee	74.5	Fixed	Apr-20
26	Southfork	Manatee	74.5	Tracking	Apr-20
27	Echo River	Suwannee	74.5	Tracking	Apr-20
28	Blue Indigo	Jackson	74.5	Tracking	Apr-20
29	Lakeside	Okeechobee	74.5	Fixed	Dec-20
30	Trailside	St. Johns	74.5	Tracking	Dec-20
31	Union Springs	Union	74.5	Tracking	Dec-20
32	Egret	Baker	74.5	Tracking	Dec-20
33	Nassau	Nassau	74.5	Tracking	Dec-20
34	Magnolia Springs	Clay	74.5	Tracking	Mar-21
35	Pelican	St. Lucie	74.5	Fixed	Mar-21
36	Palm Bay	Brevard	74.5	Fixed	Mar-21
37	Rodeo	DeSoto	74.5	Tracking	Mar-21
38	Sabal Palm	Palm Beach	74.5	Fixed	Apr-21
39	Willow	Manatee	74.5	Tracking	May-21
40	Discovery	Brevard	74.5	Fixed	May-21
41	Orange Blossom	Indian River	74.5	Fixed	May-21
42	Fort Drum	Okeechobee	74.5	Fixed	Jun-21
43	Blue Springs	Jackson	74.5	Tracking	Dec-21
44	Cotton Creek	Escambia	74.5	Fixed	Dec-21

**Table III.F.1: List of FPL-Owned Solar Facilities Through April 1<sup>st</sup>, 2025, Continued**

	<b>Solar Energy Center</b>	<b>County</b>	<b>Nameplate MW</b>	<b>Type</b>	<b>COD</b>
45	Ghost Orchid	Hendry	74.5	Fixed	Jan-22
46	Sawgrass	Hendry	74.5	Fixed	Jan-22
47	Sundew	St. Lucie	74.5	Fixed	Jan-22
48	Elder Branch	Manatee	74.5	Tracking	Jan-22
49	Grove	Indian River	74.5	Fixed	Jan-22
50	Immokalee	Collier	74.5	Fixed	Jan-22
51	Everglades	Miami-Dade	74.5	Fixed	Jan-23
52	Pink Trail	St. Lucie	74.5	Fixed	Jan-23
53	Bluefield Preserve	St. Lucie	74.5	Fixed	Jan-23
54	Cavendish	Okeechobee	74.5	Tracking	Jan-23
55	Anhinga	Clay	74.5	Tracking	Jan-23
56	Blackwater River	Santa Rosa	74.5	Fixed	Jan-23
57	Chipola River	Calhoun	74.5	Tracking	Jan-23
58	Flowers Creek	Calhoun	74.5	Tracking	Jan-23
59	First City	Escambia	74.5	Fixed	Jan-23
60	Apalachee	Jackson	74.5	Tracking	Jan-23
61	Wild Azalea	Gadsden	74.5	Tracking	Feb-23
62	Chautauqua	Walton	74.5	Tracking	Feb-23
63	Shirer Branch	Calhoun	74.5	Tracking	Feb-23
64	Saw Palmetto	Bay	74.5	Tracking	Apr-23
65	Cypress Pond	Washington	74.5	Tracking	Apr-23
66	Etonia Creek	Putnam	74.5	Tracking	Apr-23
67	Terrill Creek	Clay	74.5	Tracking	Jan-24
68	Silver Plam	Palm Beach	74.5	Tracking	Jan-24
69	Ibis	Brevard	74.5	Tracking	Jan-24
70	Orchard	Indian River/St. Lucie	74.5	Tracking	Jan-24
71	Beautyberry	Hendry	74.5	Tracking	Jan-24
72	Turnpike	Indian River	74.5	Tracking	Jan-24
73	Monarch	Martin	74.5	Tracking	Jan-24
74	Caloosahatchee	Hendry	74.5	Tracking	Jan-24
75	White Tail	Martin	74.5	Tracking	Jan-24
76	Prairie Creek	DeSoto	74.5	Tracking	Jan-24
77	Pineapple	St. Lucie	74.5	Tracking	Jan-24
78	Canoe	Okaloosa	74.5	Tracking	Jan-24
79	Sambucus	Manatee	74.5	Tracking	Mar-24
80	Sparkleberry	Escambia	74.5	Tracking	Mar-24
81	Three Creeks	Manatee	74.5	Tracking	Mar-24
82	Fourmile Creek	Calhoun	74.5	Tracking	Mar-24
83	Big Juniper Creek	Calhoun	74.5	Tracking	Mar-24
84	Pecan Tree	Walton	74.5	Tracking	Mar-24
85	Wild Quail	Walton	74.5	Tracking	Mar-24
86	Hawthorne Creek	DeSoto	74.5	Tracking	Mar-24
87	Nature Trail	Baker	74.5	Tracking	Mar-24
88	Woodyard	Hendry	74.5	Tracking	Mar-24

**Table III.F.1: List of FPL-Owned Solar Facilities Through April 1<sup>st</sup>, 2025, Continued**

	Solar Energy Center	County	Nameplate MW	Type	COD
89	Honeybell	Okeechobee	74.5	Tracking	Nov-24
90	Buttonwood	St. Lucie	74.5	Tracking	Nov-24
91	Mitchell Creek	Escambia	74.5	Tracking	Nov-24
92	Hendry Isles	Hendry	74.5	Tracking	Nov-24
93	Georges Lake	Putnam	74.5	Tracking	Nov-24
94	Cedar Trail	Baker	74.5	Tracking	Nov-24
95	Norton Creek	Madison	74.5	Tracking	Dec-24
96	Kayak	Okaloosa	74.5	Tracking	Dec-24
97	Holowpaw	Palm Beach	74.5	Tracking	Jan-25
98	Speckled Perch	Okeechobee	74.5	Tracking	Jan-25
99	Big Water	Okeechobee	74.5	Tracking	Jan-25
100	Fawn	Martin	74.5	Tracking	Jan-25
101	Hog Bay	DeSoto	74.5	Tracking	Jan-25
102	Green Pasture	Charlotte	74.5	Tracking	Jan-25
103	Thomas Creek	Nassau	74.5	Tracking	Jan-25
104	Redlands	Miami-Dade	74.5	Fixed	Jan-25
105	Fox Trail	Brevard	74.5	Tracking	Jan-25
106	Long Creek	Manatee	74.5	Tracking	Jan-25
107	Swallowtail	Walton	74.5	Tracking	Jan-25
108	Tenmile Creek	Calhoun	74.5	Tracking	Jan-25

**5) Ongoing Research & Development Efforts:**

FPL has a “Living Lab” across several of its office locations and select customer sites to demonstrate FPL’s renewable energy commitment to employees and visitors. Through various Living Lab projects, FPL is able to evaluate multiple solar and storage technologies and applications for the purpose of developing a renewable business model resulting in the most cost-effective and reliable uses for FPL’s customers. FPL currently has approximately 293 kW of PV as part of the Living Lab, including a 157 kW floating solar installation in Miami-Dade County that can enable FPL to compare generation and O&M costs for floating versus ground-mount solar PV. In 2020, FPL expanded the Living Lab to include residential sites around Palm Beach County to test battery storage in a residential setting. The test addresses both potential benefits of having a 5-to-8 kW storage system for home backup power and the ability of FPL to remotely control the storage systems to provide services to the electric grid. In 2021, FPL added solar PV paired with battery storage in a residential setting and 460 kW of linear generators. FPL plans to continue to expand the Living Lab as new technologies come to market.



FPL has also been in discussions with several private companies on multiple emerging technology initiatives, including ocean current, thermal storage, hydrogen, fuel cell technology, and energy storage.

Regarding PV's impact on the FPL system, FPL developed a methodology to determine what firm capacity value at FPL's Summer and Winter peak hours would be appropriate to apply to existing and potential PV facilities. The potential capacity contribution of PV facilities is dependent upon several factors including: site location, technology, design, and the total amount of solar that is operating on FPL's system.

Based on the results of its analyses using that methodology, firm capacity values are assigned to each new solar facility. These firm capacity values are described in terms of the percentage of the facility's nameplate (AC) rating that can be counted on as firm capacity at the Summer and Winter peak load hours. For example, two of FPL's earliest PV facilities, DeSoto and Space Coast, have been assigned firm capacity values of approximately 46% for DeSoto and 32% for Space Coast at FPL's Summer peak hour (that typically occurs in the 4 p.m. to 5 p.m. hour), but contribute firm capacity of only 3% for DeSoto and 1% for Space Coast during FPL's Winter peak hour (that typically occurs in the 7 a.m. to 8 a.m. hour). Similarly, each new solar facility is assigned a specific firm capacity value based on the factors described above. Information on each solar unit's firm capacity is available in the footnotes of Schedule 1 in Chapter I and the entries for new units in Schedule 8 later in this chapter. FPL will continue to evaluate the firm capacity assigned to solar and battery facilities as it adapts more sophisticated resource adequacy methods like stochastic LOLP.

FPL has also conducted research on residential battery systems to evaluate both the potential to shift solar contribution to peak hours and to dispatch storage as a demand-response resource.

### **Renewable Energy, Battery Storage, and Electric Vehicle Projections for 2025 through 2034:**

This section addresses efforts regarding renewable energy in both universal (utility-scale) and distributed solar, as well as FPL's SolarTogether™ program. In addition, efforts regarding battery storage are also addressed. These efforts and plans are summarized below.

1. **Utility-Scale Solar:**

In 2009, FPL constructed 110 MW of solar energy facilities including two PV facilities totaling 35 MW and one 75 MW solar thermal facility. This solar thermal facility location at the Martin plant, was retired in the 1<sup>st</sup> Quarter of 2023. From 2009 through 2017, the costs of solar equipment, especially PV equipment, declined significantly and universal PV facilities became increasingly competitive economically with more conventional generation options. As a result, FPL added three new PV facilities of approximately 74.5 MW each near the end of 2016.

In the 1<sup>st</sup> Quarter of 2018, eight additional PV facilities of 74.5 MW each, or 596 MW in total, also went into commercial operation. These eight PV facilities were added under the Solar Base Rate Adjustment (SoBRA) provision of the Commission's order approving the settlement agreement for FPL's base rate case in 2016 (Order No. PSC-16-0560-AS-EI) and comprised two groups of four solar facilities each. In 2019, four more 74.5 MW PV facilities, or approximately 298 MW, were added as SoBRA facilities. An additional four 74.5 MW PV facilities, or approximately 298 MW, were placed into commercial operation in the 2<sup>nd</sup> Quarter of 2020. This completed the addition of solar under the 2016 SoBRA mechanism.

In the FPL NWFL service area, a total of three new 74.5 MW PV facilities were added. The first was placed into service in April 2020, and two additional sites achieved commercial operation in December of 2021.

As part of FPL's 2021 Rate Case Settlement (Order PSC-2021-0446-S-EI), the FPSC authorized FPL to construct 447 MW of PV solar in 2022 and an additional 745 MW of PV solar in 2023. The six sites totaling 447 MW in the 2022 group achieved commercial operation in January 2022. The ten additional sites comprising the 2023 group achieved commercial operation in January 2023.

Additionally, the Settlement also authorized FPL to construct 894 MW of PV solar in 2024 and 894 MW in 2025, for a total of 1,788 MW of PV, using a SoBRA mechanism identical in concept to the previous SoBRA. Each of these additions must be cost effective and fall below a cost cap of \$1,250 kWac. The first 894 MW of PV solar for the 2024 SoBRA achieved commercial operation in January 2023, and the second 894 MW for the 2025 SoBRA achieved commercial operation in January 2025.

The resource plan presented in this Site Plan continues to show significant additions in solar (PV) resources over the ten-year reporting period. Approximately 17,433 MW of additional PV

generation is projected to be added in the 2025-2034 time period. The projected total of solar PV for the single integrated utility by the end of 2034 is equal to 24,471 MW.

Ongoing resource planning work will continue to analyze the projected system economics of solar and all other resource options. Information regarding the Preferred and Potential Sites for the projected solar additions, particularly in the near-term, is presented in Chapter IV and in the Appendix.

2. **Distributed PV Pilot Programs:**

FPL began implementation of two distributed PV pilot programs in 2015. The first is a voluntary, community-based, solar partnership pilot to install new solar-powered generating facilities. The program is funded by contributions from customers who volunteer to participate in the pilot and does not rely on subsidies from non-participating customers. The second program has installed approximately 3.4 MW of distributed generation (DG) PV and expired at the end of 2020. The objective of this second program was to collect grid integration data for DG PV and develop operational best practices for addressing potential problems that may be identified. The PV installed under this pilot program will continue to be evaluated for these purposes. A brief description of these pilot programs follows.

a. **Voluntary, Community-Based Solar Partnership Pilot Program:**

The Voluntary Solar Pilot Program, named FPL SolarNow™, provides FPL customers with a flexible opportunity to support solar power in Florida. The FPSC approved FPL's request for this three-year pilot program in Order No. PSC-14-0468-TRF-EI on August 29, 2014. The pilot program's tariff became effective in January 2015. The final program disposition and five-year extension of the pilot was approved on December 1, 2020 by the FPSC in Order No. PSC-2020-0508-TRF-EI, and the program will now sunset on December 31, 2025.

This pilot program provides all customers the opportunity to support bringing solar projects into local communities by funding the construction of solar facilities in local public areas, such as parks, zoos, schools, and museums. Customers can participate in the program through voluntary contributions of \$9/month. As of the end of 2024, there were 33,240 participants enrolled in the Voluntary Solar Pilot Program. This program has installed 84 projects located in 35 communities within the FPL service area. These projects represent approximately 2,531 kW-DC of PV generation.

In addition to the SolarNow™ pilot program, FPL has also installed 121.6 kW (DC) of distributed solar generators at eight different locations and 5.4 kW (DC) of non-grid tied solar throughout the FPL NWFL territory.

**b. C&I Solar Partnership Pilot Program:**

This pilot program was conducted in partnership with interested commercial and industrial customers over an approximately five-year period and expired in 2020. Limited investments were made in PV facilities located at customer sites on selected distribution circuits within FPL's service area.

The primary objective was to examine the effect of high localized PV penetration on FPL's distribution system and to determine how best to address any problems that may be identified. FPL installed approximately 3.8 MW of PV facilities on circuits that experience specific loading conditions to better study feeder loading impacts, with approximately 3.4 MW remaining in operation. In addition, FPL evaluated the integration of solar into urban areas to test its impact on the distribution system on feeders that are heavily loaded.

**3. FPL SolarTogether™ Program:**

In March of 2019, FPL filed for FPSC approval of a community solar program under the market name FPL SolarTogether™. This voluntary program offers FPL customers the option to purchase solar output/attributes from cost-effective, large-scale solar energy centers. The proposed program did not require customers who participate to be bound to a long-term contract or subject to upfront enrollment costs or termination penalties. Under this program, participants' monthly electric bills would show both a subscription charge and a subscription credit line item associated with the subscribers' share of the actual solar energy generated. The FPL SolarTogether™ program was designed to leverage the economies of scale of universal solar to deliver long-term savings to both program participants and non-participants.

In March 2020, the FPSC approved the FPL SolarTogether™ program (Order PSC-2020-0084-S-EI). From 2020 through 2024, FPL has installed 3,278 MW of solar under the SolarTogether™ program. Approximately 1,005 MW has been allocated to residential customers, 2,190 MW has been allocated to commercial, industrial, and governmental customers, and 83 MW have been allocated to the low-income portion of SolarTogether™, marketed as FPL SunAssist™.

4. **Solar Power Facilities Pilot Program:**

As part of FPL's 2021 Settlement Agreement, FPL received approval to offer a four-year voluntary pilot program to commercial and industrial customers that may elect to have FPL install and maintain a solar facility on their site for a monthly tariff charge (the "Solar Power Facilities Pilot Program"). The output of this solar facility would be used solely by the participating customer. The fixed term tariff will recover the project capital costs and ongoing operating expenses through a monthly fixed charge from the program participants, such that the general body of customers will not be impacted.

**Battery Storage Efforts:**

Battery storage technology has continued to advance, and the cost of storage is projected to continue to decline over the long-term, aided, in part, by continued tax credits. As a result, battery storage is an economically competitive firm capacity option for FPL's system. As previously discussed, a 409 MW battery storage facility was added in late 2021 at the existing Manatee plant site. Additional battery storage capacity was added in late 2021 with 30 MW of battery storage added at both the existing Sunshine Gateway Solar Energy Center and at the Echo River Solar Energy Center. An additional total of approximately 7,603 (nameplate) MW of battery storage is also included in the resource plan through 2034. These batteries help to minimize solar curtailment during shoulder load daytime hours and meet load demand in the evenings and in winter mornings. Batteries are also able to ramp up their output much faster than conventional generation, making them effective at meeting load demand as solar generation reduces during evening hours.

In addition, FPL is analyzing the potential of battery storage technology to benefit FPL's customers in other ways. These analyses have been, and are currently, being carried out through implementation of two pilot projects designed to evaluate different potential applications for batteries on FPL's system.

The objectives of the two pilot projects are to identify the most promising applications for batteries on FPL's system and to gain experience with battery installation and operation. This information will position FPL to expeditiously take advantage of battery storage for the benefit of FPL's customers as the economics of the technology continue to improve. For the purpose of discussing these two pilot projects, they will be referred to as the "small scale" and "large scale" storage pilot projects.

1. **Small Scale Storage Pilot Projects:**

In 2016 and early 2017, FPL installed approximately 4 MW of battery storage systems, spread across six sites, with the general objective of demonstrating the operational capabilities of batteries and learning how to integrate them into FPL's system. These small storage projects were designed with a distinct set of high-priority battery storage grid applications in mind. These applications include peak shaving, frequency response, and backup power. In addition, these initial projects were designed to provide FPL with an opportunity to determine how to best integrate storage into FPL's operational software systems and how best to dispatch and/or control the storage systems.

To this end, FPL installed multiple projects that have been in service for more than eight years and have yielded valuable information regarding the applications listed above. These projects and learnings from them include: (i) a 1.5 MW battery in Miami-Dade County using second life automotive batteries for peak shaving and frequency response (found that high in-house integration costs coupled with low remaining capacity in second-life batteries do not support the business case), (ii) a 1.5 MW battery in Monroe County for backup power and voltage support (showcased the complexity of working with customer's equipment), (iii) a relocatable 0.75 MW uninterruptible power supply (UPS) battery at Trividia Health, Inc. in Broward County (provides consistent support to mitigate customer's momentary disruptions and reliability issues but relocation is costly and requires high technical expertise), and (iv) smaller kilowatt-scale systems in several communities for distributed storage reliability (applications successfully provide reliability support for residential customers during grid events but FPL found front-of-the-meter deployment is more expensive than BTM installations). FPL decommissioned the 1.5 MW battery in in Miami-Dade County, the 0.75 MW UPS and the small kilo-watt scale systems in several communities at the end of 2022.

2. **Large Scale (50 MW) Storage Pilot Project:**

The small-scale battery storage pilot projects described above are complemented by up to 50 MW of additional battery projects. These pilot projects were authorized under the Settlement Agreement in FPL's 2016 base rate case. The 50 MW of batteries that have been, and will continue, to be deployed in this larger pilot project have expanded the number of storage applications and configurations that FPL will be able to test and have made the scale of deployment more meaningful given the large size of FPL's system.

The first two storage projects under this pilot, placed in-service in the 1<sup>st</sup> Quarter of 2018, involve pairing battery storage with existing universal PV facilities. One of the projects is a 4

MW battery sited at FPL's Citrus Solar Energy Center. This project captures clipped (curtailed) solar energy from the solar panels during high solar insolation hours, then releases this energy in other hours. The second project is a 10 MW battery at FPL's Babcock Ranch Solar Energy Center. This project is designed to shift PV output from non-peak times to peak times and to provide "smoothing" of solar output and regulation services. These two projects are designed to enhance the operations of existing solar facilities that were installed in 2016. The data and lessons gathered from these two projects enable more optimized design configurations for solar-paired battery projects as well as improved operational parameters for economic dispatch. In 2021, FPL added an additional 1 MW to the existing Babcock Ranch Battery Storage System to test the design and performance of various battery augmentation solutions to mitigate degradation.

In the 4<sup>th</sup> Quarter of 2019, a 10 MW battery in Wynwood, a dense urban area close to downtown Miami, went into service. The project is designed to examine the use of batteries to support the distribution system with a focus on addressing grid, system, and customer challenges. Key learnings relate to the challenges of installing a battery in a dense urban area, including the decision to install in a building to allow for increased energy density, and integration into the distribution control system to allow for seamless integration into the Automated Feeder Switching system.

Two additional projects placed in-service in 2020 are designed to enhance reliability for FPL customers and the grid. One is an 11.5 MW battery that will augment the Dania Beach Clean Energy Center Unit 7. This project evaluates using battery storage to black start large generating units. The other is a 3 MW battery alongside an existing solar PV system to create a microgrid. The microgrid will be used for local resiliency and to provide additional grid services, including mitigation of disruptions potentially caused by solar in the distribution system. The projects have thus far yielded valuable learnings about interconnection approach and properly sizing the battery to account for the inrush current needed to energize the load for these applications.

The last three projects explore battery storage opportunities associated with electric vehicles (EVs) and EV infrastructure. The first explores the potential for utilizing EVs as grid resources on FPL's system for the first time ever; the 1.25 MW of Electric-Vehicle-to-Grid (EV2G) batteries using electric school buses will be able to discharge electricity to the grid when needed. The first two buses were delivered in the 3<sup>rd</sup> Quarter of 2020 and 1<sup>st</sup> Quarter of 2021; the remaining three buses, delayed due to supply chain constraints, were delivered in 2<sup>nd</sup>

Quarter of 2024. The second EV plus storage pilot adds 0.35 MW of battery storage to two FPL EVolution® pilot sites in Columbia County and Nassau County (0.7 MW total) to provide grid benefits in the form of peak shaving and a reduction in distribution upgrades. The third and final pilot project, the “FPL EVolution® Hub”, has two parts: (i) 7.25 MW of storage paired with 5 MW solar PV to create a renewable microgrid, and (ii) two trailers each fitted with 0.65 MW (total 1.3 MW) of storage and 6 EV (12 total) fast chargers. The microgrid will be used to charge the trailers that will be deployed throughout FPL service area during grid events to increase resiliency for EV charging. The microgrid will also be used to provide electricity to a nearby administrative building, warehouse, and several biodiesel tanks when not being used to charge the battery trailers. The first and third pilot projects have completed construction and are operational as of 2022. The EV + Storage project in Columbia and Nassau counties was placed into service in the 1<sup>st</sup> Quarter in 2024.

A summary of FPL's battery storage facilities is presented in Table III.F.2 below.

**Table III.F.2: List of FPL Battery Storage Facilities**

In-Service Date	Location/Projects	Status	Nameplate MW
2016-2017	2016 Pilots	Operational	1.5
2018	Citrus Solar Energy Center	Operational	4
2018	Babcock Ranch Solar Energy Center	Operational	10
2019	Wynwood	Operational	10
2020	Dania Beach Energy Center	Operational	11.5
2020	University Microgrid	Operational	3
2020	EV2G	Operational	1.25
2021	Manatee	Operational	409
2021	Sunshine Gateway	Operational	30
2021	Echo River	Operational	30
2023	EV + Storage	Operational	0.7
2022	FPL EVolution® Hub	Operational	8.55
<b>Total:</b>			<b>520</b>

#### **Electric Vehicle Efforts:**

Florida is ranked second in the nation for EV adoption, and more Floridians are buying EVs every year. FPL began implementation of the FPL EVolution® pilot program in 2019 to support



the growth of EVs with the goal to install more than 1,000 charging ports. The primary objective of this pilot program for FPL is to gather data and learnings ahead of projected mass EV adoption to ensure future EV investments enhance service and reduce costs. The FPL EVolution® Pilot focuses on three key areas: a) influences of infrastructure build-out on adoption; b) rate structures and demand models; and c) grid impacts of fast-charging. This pilot program is being conducted in partnership with interested host customers over an approximate three-year period. Installations encompass different EV charging technologies and market segments, including level 2 workplace charging at public and/or private workplaces; destination charging at well-attended locations; residential charging at customers' homes; and fast charging in high-traffic areas, along highway corridors and evacuation routes to enable long distance travel. These places include Florida's Turnpike Service Plazas, public parking areas, tourist attractions, hospitals, and large businesses that employ hundreds of Florida residents.

As part of FPL's 2021 Settlement Agreement, FPL received approval to expand the initial FPL EVolution® Pilot and add additional EV programs that were launched in 2022, including: i) public fast charging, ii) new technologies and software, iii) education and outreach, iv) a voluntary residential EV charging services tariff, and v) a voluntary commercial EV charging services tariff.

In addition, pursuant to Order No. 2020-0512-TRF-EI, issued December 21, 2020, FPL has implemented three optional five-year EV public charging pilot tariffs. The first tariff, Utility-Owned Public Charging for Electric Vehicles (Rate Schedule UEV), establishes a rate for FPL to charge drivers directly at certain utility-owned FPL EVolution® fast charging stations. The second set of tariffs, Electric Vehicle Charging Infrastructure Riders to General Service Demand and General Service Large Demand (Rate Schedules GSD-1EV and GSLD-1EV), limit the demand cost associated with general service demand rates billed to third-party public charging stations operating in FPL's service area. The tariffs took effect in January 2021 and will last for a period of five years.

As of December 31, 2024, FPL EVolution® Public has installed 910 Level 2 charging ports and 321 fast charging ports. There are 76 FPL EVolution fast charging sites operating under the UEV rate schedule and approximately 200 additional ports expected to be online by the end of 2025. FPL has also added 274 charging ports under the fleet pilot in 2024 and 30 level 2 charging ports under the CEVCS-1 tariff in 2025. Additionally, FPL added 9,007 level 2 chargers for residential customers, allowing managed EV charging during off-peak hours, avoiding additional load during peak. The FPL EVolution® pilot has provided FPL valuable

early insights and best practices into EV charging infrastructure deployment in the areas of siting, equipment, installation, and grid reliability.

### **III.G Fuel Mix and Fuel Price Forecasts**

#### **1. FPL Fuel Mix**

FPL's fuel mix since the early 1990s has seen a steady increase in the amount of natural gas, which FPL uses to produce electricity due, in part, to the introduction of highly efficient and cost-effective CC generating units and the ready availability of abundant, U.S.-produced natural gas. Since 2001, FPL has focused on modernizing its gas-fired generation fleet by modernizing existing units and adding CC units to its generation mix. These new CC units have dramatically improved the efficiency of FPL's generation system in general and, more specifically, the efficiency with which natural gas is utilized as discussed in the Executive Summary.

In regard to access to alternative fuel availability, the addition of four CTs at the Gulf Clean Energy Center in 2021, capable of burning natural gas or ULSD oil, has also provided additional fuel diversity and reliability.

FPL has also taken measures over the last few years to eliminate the use of coal as a fuel. FPL shuttered Cedar Bay in 2016, St. Johns River Power Park in 2018, the Indiantown Co-Gen coal-fueled unit in late 2020, and the Scherer 4 unit on January 1, 2022. The conversion of the Gulf Clean Energy Center to natural gas in 2020, plus the retirement of FPL's ownership portion of the Daniel Units 1 & 2 in January 2024 demonstrates a continued commitment to eliminate coal from the generation portfolio.

In addition, FPL increased its utilization of nuclear energy through capacity uprates of its four existing nuclear units. With these uprates, more than 500 MW of additional nuclear capacity have been added to the FPL system. As mentioned previously, FPL has obtained the COLs from the NRC for two new nuclear units, Turkey Point Units 6 & 7. FPL has now paused this process to decide when to pursue approval from the FPSC to proceed to construction.

By the end of April 2025, FPL will have approximately 7,932 MW of renewable PV generating capability comprised mainly of 74.5 MW solar facilities at 108 sites. A significant amount of additional solar is projected in the current resource plan as discussed throughout this Site Plan.

These solar additions will increase solar as a percentage of FPL's generation from 9% in 2024 to 35% in 2034.

Ongoing resource planning work will continue to focus on identifying and evaluating alternatives that would most cost-effectively maintain and/or enhance long-term fuel diversity. These fuel-diverse alternatives may include additional solar energy facilities, obtaining additional access to diversified sources of natural gas such as liquefied natural gas (LNG) and natural gas from the Mid-Continent and Marcellus regions, preserving the ability to utilize fuel oil at existing units, and increased utilization of nuclear energy, and the purchase of power from renewable energy facilities (As previously discussed, new, advanced technology coal-fueled generating units are no longer considered as viable options in Florida). The evaluation of the feasibility and cost-effectiveness of these and other possible fuel diversity alternatives will be part of on-going resource planning efforts.

As part of the effort to introduce further fuel diversity and resiliency into FPL's generation system, a green hydrogen electrolysis pilot project has been developed and deployed at FPL's Okeechobee CC unit. This pilot utilizes solar energy to perform electrolysis and generate hydrogen fuel. This hydrogen fuel is then burned in a portion of the combined cycle unit to test the capability of FPL's existing units to burn hydrogen instead of natural gas. This pilot allows FPL to assess how the CTs in a CC unit operate with a hydrogen and natural gas fuel mix, and also provides insight into how a hydrogen fuel production and storage facility can be effectively used on site with combustion turbine units. To provide a source of hydrogen to burn for this pilot, FPL built an approximate 25 MW electrolyzer and a storage facility for the production and on-site storage of hydrogen at Okeechobee. The electrolyzer is interconnected with renewable generation at the Okeechobee site so that electrical energy from a solar facility can be used by the electrolyzer to separate water into hydrogen and oxygen gases. The oxygen is released into the air while the hydrogen is compressed and stored on-site where it can later be used as fuel in the CT units at the Okeechobee site. This pilot project went into service in late 2023.

Current use of various fuels to supply energy to customers, plus projections of this "fuel mix" through 2034 based on the resource plan presented in this document, are presented in Schedules 5, 6.1, and 6.2 that appear later in this chapter.

## **2. Fossil Fuel Cost Forecasts**

### **FPL's Fuel Cost Forecasts**

Fossil fuel price forecasts, and the resulting projected price differentials between fuels, are major drivers used to evaluate alternatives for meeting future resource needs. FPL's forecasts are generally consistent with other published contemporary forecasts. A September 2024 fuel cost forecast was used in the analyses which developed the resource plans presented in this 2025 Site Plan.

Future oil and natural gas prices, and to a lesser extent, coal prices, are inherently uncertain due to a significant number of unpredictable and uncontrollable drivers that influence the short- and long-term price of oil, natural gas, and coal. These drivers include U.S. and worldwide demand, production capacity, economic growth, environmental requirements, and politics.

The inherent uncertainty and unpredictability of these factors today and in the future clearly underscore the need to develop a set of plausible oil, natural gas, and solid fuel (coal) price scenarios that will bound a reasonable set of long-term price outcomes. In this light, Low, Medium, and High price forecasts for fossil fuels were developed in anticipation of the 2025 resource planning work.

FPL's Medium price forecast methodology is consistent for oil and natural gas. For oil and natural gas commodity prices, FPL's Medium price forecast applies the following methodology:

- a. For the then-current plus two years (2024-2026), the methodology used the September 2024 forward curve for New York Harbor 0.5% sulfur heavy oil, WTI Crude Oil, Ultra-Low Sulfur Diesel (ULSD) fuel oil, and Henry Hub natural gas commodity prices (As S&P Global no longer publishes a Long Term forecast for 0.7% Sulfur Heavy Oil, FPL now forecasts a 0.5% Sulfur heavy oil price using a combination of market quotes and 1% Sulfur heavy oil price forecasts);
- b. For the next two years (2027 and 2028), FPL used a 50/50 blend of the September 2024 forward curve and the most current projections at the time from S&P Global (formerly called The PIRA Energy Group);
- c. For the 2029-2050 period, FPL used the annual projections from S&P Global for oil and natural gas commodity prices;
- d. For the period beyond 2050 for oil and natural gas, FPL used the real rate of escalation from the Energy Information Administration (EIA). In addition to the development of oil and natural gas commodity prices, nominal price forecasts

also were prepared for oil and natural gas transportation costs. The addition of commodity and transportation forecasts resulted in delivered price forecasts.

FPL's Medium price forecast methodology is also consistent for coal prices. FPL uses a combination of actual coal purchases, current market quotes provided to FPL, Long Term PRB Coal price forecast up to 2050 from S&P Global and rail rate growth from historical data to build a coal price forecast for Plant Scherer.

In cases where multiple fuel cost forecasts are used, a Medium fuel cost forecast is developed first. FPL's approach has been to then adjust the Medium fuel cost forecast upward (for the High fuel cost forecast) or downward (for the Low fuel cost forecast) by multiplying the annual cost values from the Medium fuel cost forecast by a factor of  $(1 + \text{the historical volatility of the 12-month forward price, one year ahead})$  for the High fuel cost forecast, or by a factor of  $(1 - \text{the historical volatility of the 12-month forward price, one year ahead})$  for the Low fuel cost forecast.

### **3. Natural Gas Storage**

FPL currently has under contract 4.0 billion cubic feet (Bcf) of firm natural gas storage capacity at the Bay Gas storage facility in Alabama. This contract has been extended through March 31, 2029. FPL has predominately utilized natural gas storage to help mitigate gas supply problems caused by severe weather and/or infrastructure problems. To diversify FPL's natural gas storage portfolio, FPL entered into a storage contract with SG Resources Mississippi, L.L.C. (Southern Pines Storage) for 1 Bcf of storage capacity. The current contract with Southern Pines Storage is set to expire March 31, 2030. This storage facility is located in Mississippi and is connected to numerous pipelines including FGT, Southeast Supply Header, and Transco. Effective April 1, 2025, FPL will add an incremental 2 Bcf of storage capacity at Petal Storage located in Mississippi; the contract will extend through March 31, 2028.

FPL's ability to manage the daily "swings" in natural gas demand that can occur on its system due to weather and unit availability changes is challenging, particularly from oversupply situations. Natural gas storage is a valuable tool to help manage the daily balancing of supply and demand. From a balancing perspective, injection and withdrawal rights associated with gas storage have become an increasingly important part of the evaluation of overall gas storage requirements.

As FPL's system grows to meet customer needs, it must maintain adequate gas storage capacity to continue to help mitigate supply and/or infrastructure problems and to provide the ability to manage its supply and demand on a daily basis. The gas storage portfolio is continually evaluated and subscription for additional gas storage capacity is possible if needed to help increase reliability, provide the necessary flexibility to respond to demand changes, and diversify the overall portfolio.

#### **4. Securing Additional Natural Gas**

Reliance upon natural gas to produce electricity for FPL's customers is projected to continue for a number of years due to FPL's growing load. As discussed above, FPL plans to add significantly more solar PV facilities that utilize no fossil fuel and will reduce FPL's reliance on natural gas throughout the ten-year period of the Site Plan and beyond.

FPL has historically purchased the gas transportation capacity required for new natural gas supply from two existing natural gas pipeline companies: FGT and Gulfstream. In mid-2017, a third new pipeline system, consisting of the Sabal Trail and Florida Southeast Connection pipelines, went into operation. This new pipeline system is now providing fuel for FPL's Riviera, Okeechobee, and Martin plants. The new pipeline system will also allow needed support for gas-fueled FPL generation facilities in several counties.

#### **5. Nuclear Fuel Cost Forecast**

This section discusses the various steps needed to fabricate nuclear fuel for delivery to nuclear power plants, the method used to forecast the price for each step, and other comments regarding FPL's nuclear fuel cost forecast.

##### **a) Steps Required for Nuclear Fuel to be delivered to FPL's Plants**

Four separate steps are required before nuclear fuel can be used in a commercial nuclear power reactor. These steps are summarized below.

**(1) Mining:** Uranium is produced in many countries such as Canada, Australia, Kazakhstan, and the United States. During the first step, uranium is mined from the ground using techniques such as open pit mining, underground mining, in-situ leaching operations, or production as a by-product from other mining operations, such as gold, copper, or phosphate rocks. The product from this first step is the raw uranium delivered as an oxide,  $U_3O_8$  (sometimes referred to as yellowcake).

**(2) Conversion:** During the second step, the  $U_3O_8$  is chemically converted into  $UF_6$  which, when heated, changes into a gaseous state. This second step further removes any chemical impurities and serves as preparation for the third step, which requires uranium to be in a gaseous state.

**(3) Enrichment:** Natural uranium contains 0.711% of uranium at an atomic mass of 235 (U-235) and 99.289% of uranium at an atomic mass of 238 (U-238). FPL's nuclear reactors use uranium with a higher percentage of up to almost five percent (5%) of U-235 atoms. Because natural uranium does not contain a sufficient amount of U-235, the third step increases the percentage amount of U-235 from 0.711% to a level specified when designing the reactor core (typically in a range from approximately 2.0% to as high as 4.95%). The output of this enrichment process is enriched uranium in the form of  $UF_6$ .

**(4) Fabrication:** During the last step, fuel fabrication, the enriched  $UF_6$  is changed to a  $UO_2$  powder, pressed into pellets, and fed into tubes, which are sealed and bundled together into fuel assemblies. These fuel assemblies are then delivered to the plant site for insertion into a reactor.

Like other utilities, FPL has purchased raw uranium and the other components of the nuclear fuel cycle separately from numerous suppliers from different countries.

#### **b) Price Forecasts for Each Step**

**(1) Mining:** The impact of the earthquake and tsunami that struck the Fukushima nuclear complex in Japan in March 2011 is still being felt in the uranium market because the majority of the Japanese nuclear reactors are still not operating. As a result, current demand has remained declined and several of the production facilities have either closed or announced delays. Factors of importance are:

- Some of the uranium inventory from the U.S. Department of Energy (DOE) is finding its way into the market periodically to fund cleanup of certain DOE facilities.
- Although only two new nuclear units are starting production in the U.S. in the short-term, other countries have announced an increase in construction of new units which may cause uranium prices to trend up in the near future.

Over a ten-year horizon, FPL expects the market to be more consistent with market fundamentals. The supply picture remains stable, with laws enacted in 2020 to resolve the import of Russian-enriched uranium, by allowing continued imports of Russian-enriched uranium to meet about 15-24% of needs from 2025-2040 for currently operating and new units. New and current uranium production facilities are decreasing capacity due to continued low prices and demands. Actual demand tends to grow over time because of the long lead time to build nuclear units. However, FPL cannot discount the possibility of future periodic sharp increases in prices but believes such occurrences will likely be temporary in nature.

**(2) Conversion:** The conversion market is also in a state of flux due to the Fukushima events. Planned production is currently forecasted to be insufficient to meet a higher demand scenario, but it is projected to be sufficient to meet most reference case scenarios. As with additional raw uranium production, supply will expand beyond the current level if more firm commitments are made. FPL expects long-term price stability for conversion services to support world demand.

**(3) Enrichment:** Since the Fukushima events in March 2011, the near-term price of enrichment services has declined. However, plans for construction of several new facilities that were expected to come on-line after 2011 have been delayed and/or cancelled. Also, some of the existing high operating cost diffusion plants have shut down. As with supply for the other steps of the nuclear fuel cycle, expansion of future capacity is feasible within the lead time for constructing new nuclear units and any other projected increase in demand. Meanwhile, world supply and demand will continue to be balanced such that FPL expects an adequate supply of enrichment services. The current supply/demand profile will likely result in the price of enrichment services remaining stable for the next few years, then starting to increase.

**(4) Fabrication:** Because the nuclear fuel fabrication process is highly regulated by the NRC, not all production facilities can qualify as suppliers to nuclear reactors in the U.S. Although world supply and demand are expected to show significant excess capacity for the foreseeable future, the gap is not as wide for U.S. supply and demand. The supply for the U.S. market is expected to be sufficient to meet U.S. demand for the foreseeable future.



**c) Other Comments Regarding FPL's Nuclear Fuel Cost Forecast**

FPL's nuclear fuel price forecasts are the result of FPL's analysis based on inputs from various nuclear fuel market expert reports and studies. There is adequate projected supply, including planned and prospective mine expansions, to meet FPL demands, including operation of the two Turkey Point nuclear units, even through the 2052 and 2053 dates that are a part of FPL's SLR requests for these units.

**Schedule 5: Actual  
Fuel Requirements**

Fuel Requirements	Units	Actual <sup>1/</sup>	
		FPL	
		2023	2024
(1) Nuclear	Trillion BTU	310	301
(2) Coal	1,000 TON	474	372
(3) Residual (FO <sub>6</sub> ) - Total	1,000 BBL	0	0
(4) Steam	1,000 BBL	0	0
(5) Distillate (FO <sub>2</sub> ) - Total	1,000 BBL	170	178
(6) Steam	1,000 BBL	3	0
(7) CC	1,000 BBL	93	51
(8) CT	1,000 BBL	75	127
(9) Natural Gas - Total	1,000 MCF	764,300	742,232
(10) Steam	1,000 MCF	23,774	26,133
(11) CC	1,000 MCF	700,054	697,665
(12) CC PPAs - Gas <sup>2/</sup>	1,000 MCF	29,041	0
(13) CT	1,000 MCF	11,432	18,434
(14) Hydrogen <sup>3/</sup>	Trillion BTU	0.002	0.10
(15) Other <sup>4/</sup>	1,000 MCF	189	160

1/ Source: A Schedules.

2/ The Natural Gas PPA that we had with the Shell Plant was retired at the end of 2023.

3/ Represents the Hydrogen Gas produced from the Okeechobee H2 Pilot Program

4/ Perdido Units' landfill gas burn included in Other

Note: Solar contributions are provided on Schedules 6.1 and 6.2.

**Schedule 5: Forecasted  
Fuel Requirements**

Fuel Requirements	Units	Forecasted									
		2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
		<b>FPL</b>									
(1) Nuclear	Trillion BTU	303	300	302	308	306	307	306	308	306	307
(2) Coal	1,000 TON	271	302	406	326	360	359	352	368	433	466
(3) Residual (FO <sub>9</sub> ) - Total	1,000 BBL	0	0	0	0	0	2	9	0	0	0
(4) Steam	1,000 BBL	0	0	0	0	0	2	9	0	0	0
(5) Distillate (FO <sub>2</sub> ) - Total	1,000 BBL	8	10	8	9	8	8	4	5	5	2
(6) Steam	1,000 BBL	8	10	8	9	7	8	4	5	5	2
(7) CC	1,000 BBL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(8) CT	1,000 BBL	0.0	0.6	0.2	0.0	1.7	0.0	0.0	0.0	0.0	0.0
(9) Natural Gas - Total	1,000 MCF	672,979	667,530	647,617	638,954	628,378	611,221	583,085	561,314	551,144	523,465
(10) Steam	1,000 MCF	19,690	20,424	15,957	16,199	14,835	14,784	13,172	10,919	13,078	12,002
(11) CC	1,000 MCF	644,888	639,487	625,959	618,308	609,660	591,392	565,784	546,151	532,868	507,689
(12) CC PPAs - Gas <sup>2/</sup>	1,000 MCF	0	0	0	0	0	0	0	0	0	0
(13) CT	1,000 MCF	8,401	7,619	5,702	4,448	3,882	5,044	4,129	4,245	5,198	3,775
(14) Hydrogen <sup>3/</sup>	1,000 MCF	0	0	0	0	0	0	0	0	0	0
(15) Other <sup>4/</sup>	1,000 MCF	258	260	260	261	260	0	0	0	0	0

1/ Source: A Schedules.

2/ The Natural Gas PPA that we had with the Shell Plant was retired at the end of 2023.

3/ Represents the Hydrogen Gas produced from the Okeechobee H2 Pilot Program - FPL does not include Hydrogen in its forecasted fuel requirements.

4/ Perdido Units' landfill gas burn included in Other

Note: Solar contributions are provided on Schedules 6.1 and 6.2.

**Schedule 6.1 Actual  
Energy Sources**

Energy Sources	Units	Actual <sup>1/</sup>	
		FPL	
		2023	2024
(1) Annual Energy Interchange <sup>2/</sup>	GWH	0	0
(2) Nuclear	GWH	28,767	28,009
(3) Coal	GWH	472	533
(4) Residual(FO <sub>2</sub> ) -Total	GWH	0.0	0.0
(5) Steam	GWH	0	0
(6) Distillate(FO <sub>2</sub> ) -Total	GWH	233.2	116.4
(7) Steam	GWH	7	9
(8) CC	GWH	79	43
(9) CT	GWH	147	64
(10) Natural Gas -Total	GWH	105,854	104,335
(11) Steam	GWH	1,870	2,074
(12) CC	GWH	101,578	100,515
(13) CC PPAs - Gas <sup>3/</sup>	GWH	1,367	0
(14) CT	GWH	1,040	1,747
(15) Solar <sup>4/</sup>	GWH	9,460	12,404
(16) PV	GWH	6,253	6,929
(17) Solar Together <sup>5/</sup>	GWH	2,992	5,260
(18) Solar PPAs	GWH	215	215
(19) Wind PPAs	GWH	1,029	1,029
(20) Hydrogen Gas <sup>6/</sup>	GWH	0.36	16
(21) Other <sup>7/</sup>	GWH	(2,060)	(356)
Net Energy For Load <sup>8/</sup>	GWH	143,756	146,103

1/ Sources: Actuals for FPL and FPL NWFL: A Schedules and Actual Data for Next Generation Solar Centers Report.

2/ Represents interchange between FPL/FPL NWFL and other utilities. For FPL NW, this number represents the net energy exchange with Southern Co.

3/ The Natural Gas PPA that we had with the Shell Plant was retired at the end of 2023.

4/ Represents output from FPL and FPL NWFL's Solar PV, Solar Together (ST), Solar Thermal, and Solar PPA facilities.

5/ The values shown represent energy produced from FPL-owned solar facilities that are part of FPL's SolarTogether (ST) program. Environmental attributes in the form of renewable energy certificates for that participant's allocation of the total energy produced are retired on the participant's behalf.

6/ Represents the Hydrogen Gas produced from the Okeechobee H2 Pilot Program

7/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, etc., net of Economy and other Power Sales as well as the LFG generation from the Perdido unit.

8/ Net Energy For Load values for the years 2023 and 2024 are shown in column (2) on Schedule 3.3 History of Annual Net Energy for Load

**Schedule 6.1 Forecasted  
Energy Sources**

FPL											
<u>Energy Sources</u>	<u>Units</u>	<u>2025</u>	<u>2026</u>	<u>2027</u>	<u>2028</u>	<u>2029</u>	<u>2030</u>	<u>2031</u>	<u>2032</u>	<u>2033</u>	<u>2034</u>
(1) Annual Energy Interchange <sup>1/</sup>	GWH	0	0	0	0	0	0	0	0	0	0
(2) Nuclear	GWH	28,750	28,504	28,610	29,223	29,032	29,135	29,029	29,219	29,029	29,136
(3) Coal	GWH	421	472	643	513	569	565	553	580	684	738
(4) Residual(FO <sub>3</sub> ) -Total	GWH	0	0	0	0	0	2	0	0	11	0
(5) Steam	GWH	0	0	0	0	0	2	6	0	0	0
(6) Distillate(FO <sub>2</sub> ) -Total	GWH	4	6	4	3	2	3	2	2	2	1
(7) Steam	GWH	3	4	3	3	2	3	2	2	2	1
(8) CC	GWH	0	0	0	0	0	0	0	0	0	0
(9) CT	GWH	1	2	1	0	0	0	0	0	0	0
(10) Natural Gas -Total	GWH	94,814	93,777	92,577	91,462	90,046	86,919	82,865	79,789	76,982	73,448
(11) Steam	GWH	1,826	1,900	1,487	1,514	1,387	1,383	1,228	1,020	1,222	1,125
(12) CC	GWH	92,206	91,163	90,552	89,532	88,294	85,059	81,262	78,370	75,267	71,967
(13) CC PPAs - Gas <sup>2/</sup>	GWH	0	0	0	0	0	0	0	0	0	0
(14) CT	GWH	782	713	538	416	365	476	375	399	493	356
(15) Solar <sup>3/</sup>	GWH	17,692	19,662	21,736	25,140	29,159	34,294	39,720	45,254	50,328	55,800
(16) PV	GWH	10,206	12,178	14,279	17,691	21,753	26,914	32,375	37,920	43,109	48,577
(17) Solar Together <sup>4/</sup>	GWH	7,266	7,264	7,238	7,230	7,188	7,163	7,129	7,119	7,012	7,012
(18) Solar PPAs	GWH	220	220	219	219	218	217	216	215	207	210
(19) Wind PPAs	GWH	1,031	1,031	1,031	1,033	1,031	1,031	1,031	1,033	1,031	1,031
(20) Hydrogen Gas <sup>5/</sup>	GWH	0	0	0	0	0	0	0	0	0	0
(21) Other <sup>6/</sup>	GWH	2,055	1,453	1,277	1,160	1,110	1,145	1,175	851	854	319
Net Energy For Load <sup>7/</sup>	GWH	144,793	144,931	145,905	148,562	150,976	153,094	154,375	156,728	158,922	160,473

1/ Represents interchange between FPL and other utilities.

2/ The Natural Gas PPA that we had with the Shell Plant was retired at the end of 2023.

3/ Represents output from FPL and FPL NWFL's Solar PV, Solar Together (ST), Solar Thermal, and Solar PPA facilities.

4/ The values shown represent energy produced from FPL-owned solar facilities that are part of FPL's SolarTogether (ST) program. Environmental attributes in the form of renewable energy certificates for that participant's allocation of the total energy produced are retired on the participant's behalf.

5/ Represents the Hydrogen Gas produced from the Okeechobee H2 Pilot Program

6/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, etc., net of Economy and other Power Sales as well as the Perdido Unit projected generation.

7/ Net Energy For Load values for the years 2023 and 2024 are shown in column (2) on Schedule 3.3 History of Annual Net Energy for Load and values for 2025 - 2034 are shown in Col. (2) on Schedule 3.3 Forecast of Annual Net Energy for Load.

Schedule 6.2 Actual  
Energy Sources % by Fuel Type

Energy Source	Units	Actual <sup>1/</sup>	
		2023	2024
(1) Annual Energy <sup>2/</sup> Interchange	%	0.0	0.0
(2) Nuclear	%	20.0	19.2
(3) Coal	%	0.3	0.4
(4) Residual (FO <sub>a</sub> ) - Total	%	0.0	0.0
(5) Steam	%	0.0	0.0
(6) Distillate (FO <sub>2</sub> ) - Total	%	0.2	0.1
(7) Steam	%	0.0	0.0
(8) CC	%	0.1	0.0
(9) CT	%	0.1	0.0
(10) Natural Gas - Total	%	73.6	71.4
(11) Steam	%	1.3	1.4
(12) CC	%	70.7	68.8
(13) CC PPAs - Gas <sup>3/</sup>	%	1.0	0.0
(14) CT	%	0.7	1.2
(15) Solar <sup>4/</sup>	%	6.6	8.5
(16) PV	%	4.3	4.7
(17) Solar Together <sup>5/</sup>	%	2.1	3.6
(18) Solar PPAs	%	0.1	0.1
(19) Wind PPAs	%	0.7	0.7
(20) Hydrogen Gas <sup>6/</sup>	%	0.0	0.0
(21) Other <sup>7/</sup>	%	(1.4)	(0.2)

1/ Sources: Actuals for FPL and FPL NWFL: A. Schedules and Actual Data for Next Generation Solar Centers Report. 2/ Represents interchange between FPL/FPL NWFL and other utilities. For FPL NW, this number represents the net energy exchange with Southern Co. 3/ The Natural Gas PPA that we had with the Shell Plant was retired at the end of 2023. 4/ Represents output from FPL and FPL NWFL's Solar PV, Solar Together (ST), Solar Thermal, and Solar PPA facilities. 5/ The values shown represent energy produced from FPL-owned solar facilities that are part of FPL's SolarTogether (ST) program. Environmental attributes in the form of renewable energy certificates for that participants allocation of the total energy produced are retired on the participants behalf. 6/ Represents the Hydrogen Gas produced from the Okeechobee H2 Pilot Program 7/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, etc., net of Economy and other Power Sales as well as the LFG generation from the Perdido unit.

Schedule 6.2 Forecasted  
Energy Sources % by Fuel Type

		FPL									
Energy Source	Units	2025	2026	2027	2028	2029	2030	2031	2032	2033	2034
(1) Annual Energy Interchange <sup>1/</sup>	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(2) Nuclear	%	19.9	19.7	19.6	19.7	19.2	19.0	18.8	18.6	18.3	18.2
(3) Coal	%	0.3	0.3	0.4	0.3	0.4	0.4	0.4	0.4	0.4	0.5
(4) Residual (FO <sub>2</sub> ) -Total	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(5) Steam	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(6) Distillate (FO <sub>2</sub> ) -Total	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(7) Steam	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(8) CC	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(9) CT	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(10) Natural Gas -Total	%	65.5	64.7	63.5	61.6	59.6	56.8	53.7	50.9	48.4	45.8
(11) Steam	%	1.3	1.3	1.0	1.0	0.9	0.9	0.8	0.7	0.8	0.7
(12) CC	%	63.7	62.9	62.1	60.3	58.5	55.6	52.6	50.0	47.4	44.8
(13) CC PPAs - Gas <sup>2/</sup>	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(14) CT	%	0.5	0.5	0.4	0.3	0.2	0.3	0.2	0.3	0.3	0.2
(15) Solar <sup>3/</sup>	%	12.2	13.6	14.9	16.9	19.3	22.4	25.7	28.9	31.7	34.8
(16) PV	%	7.0	8.4	9.8	11.9	14.4	17.6	21.0	24.2	27.1	30.3
(17) Solar Together <sup>4/</sup>	%	5.0	5.0	5.0	4.9	4.8	4.7	4.6	4.5	4.4	4.4
(18) Solar PPAs	%	0.2	0.2	0.2	0.1	0.1	0.1	0.1	0.1	0.1	0.1
(19) Wind PPAs	%	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.6	0.6
(20) Hydrogen Gas <sup>5/</sup>	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(21) Other <sup>6/</sup>	%	1.4	1.0	0.9	0.8	0.7	0.7	0.8	0.5	0.5	0.2
		100	100	100	100	100	100	100	100	100	100

1/ Represents interchange between FPL and other utilities.

2/ The Natural Gas PPA that we had with the Shell Plant was retired at the end of 2023.

3/ Represents output from FPL and FPL NWFL's Solar PV, Solar Together (ST), Solar Thermal, and Solar PPA facilities.

4/ The values shown represent energy produced from FPL-owned solar facilities that are part of FPL's SolarTogether (ST) program. Environmental attributes in the form of renewable energy certificates for that participant's allocation of the total energy produced are retired on the participant's behalf.

5/ Represents the Hydrogen Gas produced from the Okeechobee H2 Pilot Program

6/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, etc., net of Economy and other Power Sales as well as the Perdido Unit projected generation.

**Schedule 7.1**  
**Forecast of Capacity, Demand, and Scheduled**  
**Maintenance At Time Of Summer Peak**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
August of	Firm Installed Capacity MW	Firm Capacity Import MW	Firm Capacity Export MW	Firm QF MW	Total Firm Capacity Available MW	Total Peak Demand MW	DSM MW	Firm Summer Peak Demand MW	Total Reserve Margin Before Maintenance MW	% of Peak	Scheduled Maintenance MW	Total Reserve Margin After Maintenance MW	% of Peak	Generation Only Reserve Margin After Maintenance MW	% of Peak
2025	31,971	232	0	4	32,206	28,312	1,995	26,317	5,889	22.4	0	5,889	22.4	3,894	13.8
2026	32,838	231	0	4	33,073	28,664	2,016	26,648	6,425	24.1	0	6,425	24.1	4,409	15.4
2027	33,970	231	0	0	34,201	28,925	2,036	26,888	7,313	27.2	0	7,313	27.2	5,276	18.2
2028	34,312	231	0	0	34,543	29,333	2,056	27,277	7,266	26.6	0	7,266	26.6	5,210	17.8
2029	34,637	231	0	0	34,869	29,687	2,079	27,608	7,261	26.3	0	7,261	26.3	5,182	17.5
2030	34,830	231	0	0	35,061	29,982	2,106	27,877	7,184	25.8	0	7,184	25.8	5,079	16.9
2031	35,180	231	0	0	35,411	30,301	2,133	28,168	7,242	25.7	0	7,242	25.7	5,109	16.9
2032	35,753	191	0	0	35,944	30,823	2,161	28,662	7,282	25.4	0	7,282	25.4	5,121	16.6
2033	36,282	191	0	0	36,472	31,257	2,189	29,068	7,404	25.5	0	7,404	25.5	5,215	16.7
2034	36,735	121	0	0	36,856	31,677	2,217	29,460	7,396	25.1	0	7,396	25.1	5,179	16.3

Col. (2) represents capacity additions and changes projected to be in-service by June 1st. These MW are generally considered to be available to meet summer peak loads which are forecasted to occur during August of the year indicated.

Col. (6) = Col.(2) + Col.(3) - Col.(4) + Col.(5).

Col.(7) reflects the load forecast without incremental DSM or cumulative load management.

Col.(8) represents cumulative load management capability, plus incremental conservation and load management, from 9/2024-on intended for use with the 2025 load forecast.

Col.(10) = Col.(6) - Col.(9)

Col.(11) = Col.(10) / Col.(9)

Col.(12) indicates the capacity of units projected to be out-of-service for planned maintenance during the summer peak period.

Col.(13) = Col.(10) - Col.(12)

Col.(14) = Col.(13) / Col.(9)

Col.(15) = Col.(6) - Col.(7) - Col.(12)

Col.(16) = Col.(15) / Col.(7)



**Schedule 7.2**  
**Forecast of Capacity, Demand, and Scheduled**  
**Maintenance At Time Of Winter Peak**

(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	(16)
August of	Firm Installed Capacity MW	Firm Capacity Import MW	Firm Capacity Export MW	Firm QF MW	Total Firm Capacity Available MW	Total Peak Demand MW	DSM MW	Firm Summer Peak Demand MW	Total Reserve Margin Before Maintenance MW	% of Peak	Scheduled Maintenance MW	Total Reserve Margin After Maintenance MW	% of Peak	Generation Only Reserve Margin After Maintenance MW	% of Peak
2025	29,898	449	0	4	30,351	23,042	1,514	21,527	8,823	41.0	0	8,823	41.0	7,309	31.7
2026	30,451	219	0	4	30,674	23,323	1,523	21,800	8,874	40.7	0	8,874	40.7	7,350	31.5
2027	31,924	219	0	0	32,143	23,648	1,532	22,116	10,027	45.3	0	10,027	45.3	8,495	35.9
2028	33,046	219	0	0	33,265	24,136	1,542	22,594	10,672	47.2	0	10,672	47.2	9,130	37.8
2029	33,687	219	0	0	33,906	24,603	1,550	23,053	10,853	47.1	0	10,853	47.1	9,302	37.8
2030	33,887	219	0	0	34,106	25,011	1,565	23,446	10,660	45.5	0	10,660	45.5	9,095	36.4
2031	34,546	219	0	0	34,765	25,384	1,580	23,804	10,961	46.0	0	10,961	46.0	9,381	37.0
2032	35,680	219	0	0	35,899	25,852	1,595	24,256	11,643	48.0	0	11,643	48.0	10,048	38.9
2033	35,743	179	0	0	35,922	26,245	1,611	24,634	11,288	45.8	0	11,288	45.8	9,678	36.9
2034	37,000	179	0	0	37,179	26,638	1,627	25,011	12,168	48.6	0	12,168	48.6	10,541	39.6

Col. (2) represents capacity additions and changes projected to be in-service by June 1st. These MW are generally considered to be available to meet summer peak loads which are forecasted to occur during August of the year indicated.

Col. (6) = Col.(2) + Col.(3) - Col(4) + Col(5).

Col.(7) reflects the load forecast without incremental DSM or cumulative load management.

Col.(8) represents cumulative load management capability, plus incremental conservation and load management, from 9/2024-on intended for use with the 2025 load forecast.

Col.(10) = Col.(6) - Col.(9)

Col.(11) = Col.(10) / Col.(9)

Col.(12) indicates the capacity of units projected to be out-of-service for planned maintenance during the summer peak period.

Col.(13) = Col.(10) - Col.(12)

Col.(14) = Col.(13) / Col.(9)

Col.(15) = Col.(6) - Col.(7) - Col.(12)

Col.(16) = Col.(15) / Col.(7)

**Schedule 8 - Resource Plan**  
**Planned And Prospective Generating Facility Additions And Changes <sup>1/</sup> : FPL**

	(2)	(3)	(4)	(5)	(5)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)	
Plant Name	Unit No.	Location	Unit Type	Fuel				Const. Start Mo./Yr.	Comm. In-Service Mo./Yr.	Expected Retirement Mo./Yr.	Gen. Max. Nameplate KW	Firm Net Capacity <sup>2/</sup>			Status
				Pri.	Alt.	Pri.	Alt.					Winter MW	Summer MW		
ADDITIONS/ CHANGES															
FPL															
2025															
Martin Upgrade	4	Martin County	CC	NG	No	PL	No	-	1st Q 2025	Unknown	520,000	9	-	OP	
Sanford Upgrade	5	Volusia County	CC	NG	No	PL	No	-	1st Q 2025	Unknown	1,252,000	26	10	OP	
Turkey Point Upgrade	5	Miami-Dade County	CC	NG	FO <sub>2</sub>	PL	TK	-	2nd Q 2025	Unknown	1,358,000	3	8	OP	
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(11)	OT	
2025 Changes/Additions Total:												38	7		
2026															
Pea Ridge Retirement	1	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	2nd Q 2025	5,000	-	(4)	P	
Pea Ridge Retirement	2	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	2nd Q 2025	5,000	-	(4)	P	
Pea Ridge Retirement	3	Santa Rosa	GT	NG	PL	NA	NA	-	May-98	2nd Q 2025	5,000	-	(4)	P	
Gulf Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	4th Q 2025	Unknown	521,500	522	349	P	
Flatford Solar <sup>3/</sup>	1	Manatee County	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	74,500	5	3	P	
Mare Branch Solar <sup>3/</sup>	1	DeSoto County	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	74,500	2	23	P	
Price Creek Solar <sup>3/</sup>	1	Columbia County	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	74,500	0	6	P	
Swamp Cabbage Solar <sup>3/</sup>	1	Hendry County	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	74,500	3	22	P	
Big Brook Solar <sup>3/</sup>	1	Calhoun County	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	74,500	0	21	P	
Mallard Solar <sup>3/</sup>	1	Brevard County	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	74,500	2	4	P	
Boardwalk Solar <sup>3/</sup>	1	Collier County	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	74,500	2	9	P	
Goldenrod Solar <sup>3/</sup>	1	Collier County	PV	Solar	Solar	N/A	N/A	-	1st Q 2026	Unknown	74,500	2	4	P	
North Orange Solar <sup>3/</sup>	1	St. Lucie County	PV	Solar	Solar	N/A	N/A	-	2nd Q 2026	Unknown	74,500	3	4	P	
Sea Grape Solar <sup>3/</sup>	1	St. Lucie County	PV	Solar	Solar	N/A	N/A	-	2nd Q 2026	Unknown	74,500	2	4	P	
Clover Solar <sup>3/</sup>	1	St. Lucie County	PV	Solar	Solar	N/A	N/A	-	2nd Q 2026	Unknown	74,500	3	4	P	
Sand Pine Solar <sup>3/</sup>	1	Calhoun County	PV	Solar	Solar	N/A	N/A	-	2nd Q 2026	Unknown	74,500	0	10	P	
Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	1st Q 2026	Unknown	1,419,500	1,420	997	P	
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(12)	OT	
2026 Changes/Additions Total:												1,966	1,435		

<sup>1/</sup> Schedule 8 shows only planned and prospective changes to FPL generating facilities and does not reflect changes to purchases. Changes to purchases are reflected on Tables ES-1, IA.3.1, and IA.3.2

<sup>2/</sup> The Winter Total MW value consists of all generation additions and changes achieved by January. The Summer Total MW value consists of all generation additions and changes achieved by June. All MW additions/changes occurring after June each year will be accounted for in reserve margin calculations in the following year. MW Difference in Changes/Additions Total due to rounding.

<sup>3/</sup> Solar MW values reflect firm capacity only, not nameplate ratings and FPL currently assumes 0.35% degradation annually for PV output.

<sup>4/</sup> Battery MW values reflect firm capacity only, not nameplate ratings.

**Schedule 8 - Resource Plan**  
**Planned And Prospective Generating Facility Additions And Changes<sup>1/</sup>: FPL**

	(2)	(3)	(4)	(5)	(5)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)
Plant Name	Unit No.	Location	Unit Type	Fuel				Const. Start Mo./Yr.	Comm. In-Service Mo./Yr.	Expected Retirement Mo./Yr.	Gen. Max. Nameplate KW	Firm Net Capacity <sup>2/</sup>		Status
				Fuel	Transport	Pri.	Alt.					Winter MW	Summer MW	
ADDITIONS/ CHANGES														
FPL														
2027														
Hendry Solar <sup>3/</sup>	1	Hendry County	PV	Solar	Solar	N/A	N/A	-	1st Q 2027	Unknown	74,500	2	4	P
Tangelo Solar <sup>3/</sup>	1	Okeechobee County	PV	Solar	Solar	N/A	N/A	-	1st Q 2027	Unknown	74,500	2	4	P
Wood Stork Solar <sup>3/</sup>	1	St. Lucie County	PV	Solar	Solar	N/A	N/A	-	1st Q 2027	Unknown	74,500	2	4	P
Indrio Solar <sup>3/</sup>	1	St. Lucie County	PV	Solar	Solar	N/A	N/A	-	1st Q 2027	Unknown	74,500	2	4	P
West County Upgrade	1	Palm Beach County	CC	NG	FO <sub>2</sub>	PL	TK	-	1st Q 2027	Unknown	1,349,000	9	-	OP
West County Upgrade	2	Palm Beach County	CC	NG	FO <sub>2</sub>	PL	TK	-	1st Q 2027	Unknown	1,349,000	9	-	OP
West County Upgrade	3	Palm Beach County	CC	NG	FO <sub>2</sub>	PL	TK	-	1st Q 2027	Unknown	1,349,000	9	-	OP
Middle Lake Solar <sup>3/</sup>	1	Madison County	PV	Solar	Solar	N/A	N/A	-	2nd Q 2027	Unknown	74,500	2	4	P
Ambersweet Solar <sup>3/</sup>	1	Indian River County	PV	Solar	Solar	N/A	N/A	-	2nd Q 2027	Unknown	74,500	2	4	P
County Line Solar <sup>3/</sup>	1	Charlotte, DeSoto County	PV	Solar	Solar	N/A	N/A	-	2nd Q 2027	Unknown	74,500	2	4	P
Saddle Solar <sup>3/</sup>	1	DeSoto County	PV	Solar	Solar	N/A	N/A	-	2nd Q 2027	Unknown	74,500	2	4	P
Manatee Upgrade	3	Manatee County	CC	NG	No	PL	No	-	2nd Q 2027	Unknown	1,346,000	5	29	OP
Martin Upgrade	8	Martin County	CC	NG	FO <sub>2</sub>	PL	TK	-	2nd Q 2027	Unknown	1,327,000	5	19	OP
Cocoplum Solar <sup>3/</sup>	1	Hendry County	PV	Solar	Solar	N/A	N/A	-	3rd Q 2027	Unknown	74,500	2	4	P
Catfish Solar <sup>3/</sup>	1	Okeechobee County	PV	Solar	Solar	N/A	N/A	-	3rd Q 2027	Unknown	74,500	2	4	P
Hardwood Hammock Solar <sup>3/</sup>	1	Walton County	PV	Solar	Solar	N/A	N/A	-	3rd Q 2027	Unknown	74,500	2	4	P
Maple Trail Solar <sup>3/</sup>	1	Baker County	PV	Solar	Solar	N/A	N/A	-	3rd Q 2027	Unknown	74,500	2	4	P
Pinecone Solar <sup>3/</sup>	1	Calhoun County	PV	Solar	Solar	N/A	N/A	-	4th Q 2027	Unknown	74,500	2	4	P
Joshua Creek Solar <sup>3/</sup>	1	DeSoto County	PV	Solar	Solar	N/A	N/A	-	4th Q 2027	Unknown	74,500	2	4	P
Spanish Moss Solar <sup>3/</sup>	1	St. Lucie County	PV	Solar	Solar	N/A	N/A	-	4th Q 2027	Unknown	74,500	2	4	P
Vernia Solar <sup>3/</sup>	1	Indian River County	PV	Solar	Solar	N/A	N/A	-	4th Q 2027	Unknown	74,500	2	4	P
Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	1st Q 2027	Unknown	819,500	820	432	P
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(12)	OT
2027 Changes/Additions Total:												896	531	
2028														
Lansing Smith Retirement	3A	Broward County	CT	LO	-	TK	-	-	May-71	4th Q 2027	40,000	(40)	(32)	P
Manatee Upgrade	3	Manatee County	CC	NG	No	PL	No	-	1st Q 2028	Unknown	1,346,000	3	14	OP
Solar PV <sup>3/</sup>	1	Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2028	Unknown	1,490,000	0	79	P
Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	1st Q 2028	Unknown	596,000	596	298	P
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(13)	OT
2028 Changes/Additions Total:												559	346	
2029														
Gulf Clean Energy Center Retirement	4	Escambia County	ST	NG	-	PL	-	-	Jun-61	4th Q 2029	75,000	(75)	(75)	P
Gulf Clean Energy Center Retirement	5	Escambia County	ST	NG	-	PL	-	-	Jun-61	4th Q 2029	75,000	(75)	(75)	P
Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	1st Q 2029	Unknown	596,000	596	247	P
Solar PV <sup>3/</sup>	1	Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2029	Unknown	1,788,000	0	95	P
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(13)	OT
2029 Changes/Additions Total:												446	179	

1/ Schedule 8 shows only planned and prospective changes to FPL generating facilities and does not reflect changes to purchases. Changes to purchases are reflected on Tables ES-1, LA3.1, and LA3.2

2/ The Winter Total MW value consists of all generation additions and changes achieved by January. The Summer Total MW value consists of all generation additions and changes achieved by June. All MW additions/changes occurring after June each year will be accounted for in reserve margin calculations in the following year. MW Difference in Changes/Additions Total due to rounding.

3/ Solar MW values reflect firm capacity only, not nameplate ratings and FPL currently assumes 0.35% degradation annually for PV output.

4/ Battery MW values reflect firm capacity only, not nameplate ratings.

**Schedule 8 - Resource Plan**  
**Planned And Prospective Generating Facility Additions And Changes <sup>1/</sup> : FPL**

	(2)	(3)	(4)	(5)	(5)	(7)	(8)	(9)	(10)	(11)	(12)	(13)	(14)	(15)
				Fuel		Fuel		Const.	Comm.	Expected	Gen. Max.	Firm		
	Unit		Unit	Fuel	Transport	Start	Mo./Yr.	Mo./Yr.	Retirement	Mo./Yr.	Nameplate	Net Capacity <sup>2/</sup>		
Plant Name	No.	Location	Type	Pri.	Alt.	Pri.	Alt.	Mo./Yr.	Mo./Yr.	Mo./Yr.	KW	Winter	Summer	Status
<b>ADDITIONS/ CHANGES</b>														
<b>FPL</b>														
<b>2030</b>														
Perdido Retirement	1	Escambia County	IC	LFG	-	PL	-	-	Oct-10	4th Q 2029	1,500	(2)	(2)	P
Perdido Retirement	2	Escambia County	IC	LFG	-	PL	-	-	Oct-10	4th Q 2029	1,500	(2)	(2)	P
Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	1st Q 2030	Unknown	596,000	596	244	P
Solar PV <sup>3/</sup>	1	Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2030	Unknown	2,235,000	0	119	P
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(13)	OT
<b>2030 Changes/Additions Total:</b>												<b>593</b>	<b>347</b>	
<b>2031</b>														
Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	1st Q 2031	Unknown	596,000	596	244	P
Solar PV <sup>3/</sup>	1	Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2031	Unknown	2,235,000	0	119	P
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(14)	OT
<b>2031 Changes/Additions Total:</b>												<b>596</b>	<b>349</b>	
<b>2032</b>														
2x0 Manatee CT	1	Manatee County	CT	NG	-	PL	-	-	1st Q 2032	Unknown	475,000	475	469	P
Solar PV <sup>3/</sup>	1	Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2032	Unknown	2,235,000	0	119	P
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(14)	OT
<b>2032 Changes/Additions Total:</b>												<b>475</b>	<b>574</b>	
<b>2033</b>														
Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	1st Q 2033	Unknown	1,192,000	1,192	424	P
Solar PV <sup>3/</sup>	1	Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2033	Unknown	2,235,000	0	119	P
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(14)	OT
<b>2033 Changes/Additions Total:</b>												<b>1,192</b>	<b>528</b>	
<b>2034</b>														
Battery Storage <sup>4/</sup>	1	Unknown	BS	N/A	N/A	N/A	N/A	-	1st Q 2034	Unknown	1,267,000	1,267	350	P
Solar PV <sup>3/</sup>	1	Unknown	PV	Solar	Solar	N/A	N/A	-	1st Q 2034	Unknown	2,235,000	0	119	P
Scherer Retirement	3	Monroe County, GA	FS	C	-	RR	-	-	Jan-87	4th Q 2034	215,000	(215)	(215)	P
Solar Degradation <sup>3/</sup>	N/A	N/A	N/A	N/A	N/A	N/A	N/A	-	N/A	N/A	N/A	-	(15)	OT
<b>2034 Changes/Additions Total:</b>												<b>1,052</b>	<b>239</b>	

1/ Schedule 8 shows only planned and prospective changes to FPL generating facilities and does not reflect changes to purchases. Changes to purchases are reflected on Tables ES-1, IA.3.1, and IA.3.2

2/ The Winter Total MW value consists of all generation additions and changes achieved by January. The Summer Total MW value consists of all generation additions and changes achieved by June. All MW additions/changes occurring after June each year will be accounted for in reserve margin calculations in the following year. MW Difference in Changes/Additions Total due to rounding.

3/ Solar MW values reflect firm capacity only, not nameplate ratings and FPL currently assumes 0.35% degradation annually for PV output.

4/ Battery MW values reflect firm capacity only, not nameplate ratings.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Gulf Battery Storage (3-Hour Duration)
- (2) **Capacity**  
a. Nameplate (AC) 522 MW  
b. Summer Firm (AC) 349 MW  
c. Winter Firm (AC) 522 MW
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2024  
b. Commercial In-service date: 4th Q 2025
- (5) **Fuel**  
a. Primary Fuel Not applicable  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** This is a compilation of several BESS sites that will all be located at existing Solar sites.
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Round-Trip Efficiency 87.00%  
Average Net Operating Heat Rate (ANOHr): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHr): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 20 years  
Total Installed Cost (2025 \$/kW): 1,031  
Direct Construction Cost (\$/kW): 1,011  
AFUDC Amount (2025 \$/kW): 19.80  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2025 \$) 0.90 (First Full Year Operation)  
Variable O&M (\$/MWH): (2025 \$) 0.00  
K Factor: 0.98

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Flatford Solar Energy Center (Manatee County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 3 MW  
c. Winter Firm (AC) 5 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 925 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 27.70% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

2/ FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Mare Branch Solar Energy Center (DeSoto County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 23 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 669 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.55% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

2/ FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Price Creek Solar Energy Center (Columbia County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 6 MW  
c. Winter Firm (AC) 0 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 792 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 27.79% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHRR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHRR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.



**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Swamp Cabbage Solar Energy Center (Hendry County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 22 MW  
c. Winter Firm (AC) 3 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 725 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 27.14% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Big Brook Solar Energy Center (Calhoun County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 21 MW  
c. Winter Firm (AC) - MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 848 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 29.05% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

- 1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.
- 2/ FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Mallard Solar Energy Center (Brevard County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 456 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.30% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOH): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIH): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Boardwalk Solar Energy Center (Collier County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 9 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 553 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.98% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Goldenrod Solar Energy Center (Collier County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 610 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 29.11% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** North Orange Solar Energy Center (St. Lucie County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 3 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 656 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.41% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

2/ FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Sea Grape Solar Energy Center (St. Lucie County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 564 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.47% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOH): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIH): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Clover Solar Energy Center (St. Lucie County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 3 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 433 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.47% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.



**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Sand Pine Solar Energy Center (Calhoun County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 10 MW  
c. Winter Firm (AC) - MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 719 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 27.62% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2026 \$/kW): 1,721  
Direct Construction Cost (\$/kW): 1,639  
AFUDC Amount (2026 \$/kW): 83  
Escalation (\$/kW): Accounted for in Direct Construction Cost  
Fixed O&M (\$/kW-Yr.): (2026 \$) 4.35 (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) 0.00  
K Factor: 1.11

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Battery Storage (4-Hour Duration)
- (2) **Capacity**  
a. Nameplate (AC) 1,420 MW  
b. Summer Firm (AC) 997 MW  
c. Winter Firm (AC) 1,420 MW
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2025  
b. Commercial In-service date: 2026
- (5) **Fuel**  
a. Primary Fuel Not applicable  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Round-Trip Efficiency 88.00%  
Average Net Operating Heat Rate (ANOHRR): Not applicable  
Base Operation 75F,100%  
Average Net Incremental Heat Rate (ANIHRR): Not applicable  
Peak Operation 75F,100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 20 years  
Total Installed Cost (2026 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2026 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2026 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2026 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Hendry Solar Energy Center (Hendry County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 641 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHr): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHr): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWh): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

## Schedule 9

**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Tangelo Solar Energy Center (Okeechobee County)
- (2) **Capacity**
- |                                   |         |
|-----------------------------------|---------|
| a. Nameplate (AC)                 | 74.5 MW |
| b. Summer Firm (AC) <sup>1/</sup> | 4 MW    |
| c. Winter Firm (AC)               | 2 MW    |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- |                                   |      |
|-----------------------------------|------|
| a. Field construction start-date: | 2026 |
| b. Commercial In-service date:    | 2027 |
- (5) **Fuel**
- |                   |                |
|-------------------|----------------|
| a. Primary Fuel   | Solar          |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 748 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**
- |  |                                    |
|--|------------------------------------|
| Planned Outage Factor (POF):               | Not applicable                     |
| Forced Outage Factor (FOF):                | Not applicable                     |
| Equivalent Availability Factor (EAF):      | Not applicable                     |
| Resulting Capacity Factor (%):             | 28.59% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR):   | Not applicable                     |
| Base Operation 75F, 100%                   |                                    |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable                     |
| Peak Operation 75F, 100%                   |                                    |
- (13) **Projected Unit Financial Data \***
- |                                    |                                 |
|------------------------------------|---------------------------------|
| Book Life (Years):                 | 35 years                        |
| Total Installed Cost (2027 \$/kW): | TBD                             |
| Direct Construction Cost (\$/kW):  | TBD                             |
| AFUDC Amount (2027 \$/kW):         | TBD                             |
| Escalation (\$/kW):                | TBD                             |
| Fixed O&M (\$/kW-Yr.): (2027 \$)   | TBD (First Full Year Operation) |
| Variable O&M (\$/MWH): (2027 \$)   | TBD                             |
| K Factor:                          | TBD                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Wood Stork Solar Energy Center (St. Lucie County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 603 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Indrio Solar Energy Center (St. Lucie County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 400 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Middle Lake Solar Energy Center (Madison County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 524 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

## Schedule 9

**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Ambersweet Solar Energy Center (Indian River County)
- (2) **Capacity**
- |                                   |         |
|-----------------------------------|---------|
| a. Nameplate (AC)                 | 74.5 MW |
| b. Summer Firm (AC) <sup>1/</sup> | 4 MW    |
| c. Winter Firm (AC)               | 2 MW    |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- |                                   |      |
|-----------------------------------|------|
| a. Field construction start-date: | 2026 |
| b. Commercial In-service date:    | 2027 |
- (5) **Fuel**
- |                   |                |
|-------------------|----------------|
| a. Primary Fuel   | Solar          |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 518 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**
- |  |                                    |
|--|------------------------------------|
| Planned Outage Factor (POF):               | Not applicable                     |
| Forced Outage Factor (FOF):                | Not applicable                     |
| Equivalent Availability Factor (EAF):      | Not applicable                     |
| Resulting Capacity Factor (%):             | 28.59% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR):   | Not applicable                     |
| Base Operation 75F, 100%                   |                                    |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable                     |
| Peak Operation 75F, 100%                   |                                    |
- (13) **Projected Unit Financial Data \***
- |                                    |                                 |
|------------------------------------|---------------------------------|
| Book Life (Years):                 | 35 years                        |
| Total Installed Cost (2027 \$/kW): | TBD                             |
| Direct Construction Cost (\$/kW):  | TBD                             |
| AFUDC Amount (2027 \$/kW):         | TBD                             |
| Escalation (\$/kW):                | TBD                             |
| Fixed O&M (\$/kW-Yr.): (2027 \$)   | TBD (First Full Year Operation) |
| Variable O&M (\$/MWH): (2027 \$)   | TBD                             |
| K Factor:                          | TBD                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

2/ FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.



**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** County Line Solar Energy Center (Charlotte/DeSoto County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 630 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Saddle Solar Energy Center (DeSoto County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 647 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Cocoplum Solar Energy Center (Hendry County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 470 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Catfish Solar Energy Center (Okeechobee County)
- (2) **Capacity**
- |                                   |         |
|-----------------------------------|---------|
| a. Nameplate (AC)                 | 74.5 MW |
| b. Summer Firm (AC) <sup>1/</sup> | 4 MW    |
| c. Winter Firm (AC)               | 2 MW    |
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**
- |                                   |      |
|-----------------------------------|------|
| a. Field construction start-date: | 2026 |
| b. Commercial In-service date:    | 2027 |
- (5) **Fuel**
- |                   |                |
|-------------------|----------------|
| a. Primary Fuel   | Solar          |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 837 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**
- |  |                                    |
|--|------------------------------------|
| Planned Outage Factor (POF):               | Not applicable                     |
| Forced Outage Factor (FOF):                | Not applicable                     |
| Equivalent Availability Factor (EAF):      | Not applicable                     |
| Resulting Capacity Factor (%):             | 28.59% (First Full Year Operation) |
| Average Net Operating Heat Rate (ANOHR):   | Not applicable                     |
| Base Operation 75F, 100%                   |                                    |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable                     |
| Peak Operation 75F, 100%                   |                                    |
- (13) **Projected Unit Financial Data \***
- |                                    |                                 |
|------------------------------------|---------------------------------|
| Book Life (Years):                 | 35 years                        |
| Total Installed Cost (2027 \$/kW): | TBD                             |
| Direct Construction Cost (\$/kW):  | TBD                             |
| AFUDC Amount (2027 \$/kW):         | TBD                             |
| Escalation (\$/kW):                | TBD                             |
| Fixed O&M (\$/kW-Yr.): (2027 \$)   | TBD (First Full Year Operation) |
| Variable O&M (\$/MWH): (2027 \$)   | TBD                             |
| K Factor:                          | TBD                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

2/ FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Hardwood Hammock Solar Energy Center (Walton County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 750 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Maple Trail Solar Energy Center (Baker County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 930 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

2/ FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Pinecone Solar Energy Center (Calhoun County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 438 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Joshua Creek Solar Energy Center (DeSoto County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 621 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHr): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

2/ FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.



**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Spanish Moss Solar Energy Center (St. Lucie County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 483 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Vernia Solar Energy Center (Indian River County)
- (2) **Capacity**  
a. Nameplate (AC) 74.5 MW  
b. Summer Firm (AC)<sup>1/</sup> 4 MW  
c. Winter Firm (AC) 2 MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2026  
b. Commercial In-service date: 2027
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 533 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): 28.59% (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2027 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2027 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2027 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2027 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- |      |  |                                   |                             |
|------|--|-----------------------------------|-----------------------------|
| (1)  | <b>Plant Name and Unit Number:</b>         | Battery Storage (4-Hour Duration) |                             |
| (2)  | <b>Capacity</b>                            |                                   |                             |
|      | a. Nameplate (AC)                          | 819.5 MW                          |                             |
|      | b. Summer Firm (AC)                        | 432 MW                            |                             |
|      | c. Winter Firm (AC)                        | 819.5 MW                          |                             |
| (3)  | <b>Technology Type:</b>                    | Battery                           |                             |
| (4)  | <b>Anticipated Construction Timing</b>     |                                   |                             |
|      | a. Field construction start-date:          | 2026                              |                             |
|      | b. Commercial In-service date:             | 2027                              |                             |
| (5)  | <b>Fuel</b>                                |                                   |                             |
|      | a. Primary Fuel                            |                                   | Not applicable              |
|      | b. Alternate Fuel                          |                                   | Not applicable              |
| (6)  | <b>Air Pollution and Control Strategy:</b> | Not applicable                    |                             |
| (7)  | <b>Cooling Method:</b>                     | Not applicable                    |                             |
| (8)  | <b>Total Site Area:</b>                    | TBD                               | Acres                       |
| (9)  | <b>Construction Status:</b>                | P                                 | (Planned Unit)              |
| (10) | <b>Certification Status:</b>               | —                                 |                             |
| (11) | <b>Status with Federal Agencies:</b>       | —                                 |                             |
| (12) | <b>Projected Unit Performance Data:</b>    |                                   |                             |
|      | Planned Outage Factor (POF):               |                                   | Not applicable              |
|      | Forced Outage Factor (FOF):                |                                   | Not applicable              |
|      | Equivalent Availability Factor (EAF):      |                                   | Not applicable              |
|      | Round-Trip Efficiency                      |                                   | 88.00%                      |
|      | Average Net Operating Heat Rate (ANOHR):   |                                   | Not applicable              |
|      | Base Operation 75F, 100%                   |                                   |                             |
|      | Average Net Incremental Heat Rate (ANIHR): |                                   | Not applicable              |
|      | Peak Operation 75F, 100%                   |                                   |                             |
| (13) | <b>Projected Unit Financial Data *</b>     |                                   |                             |
|      | Book Life (Years):                         | 20 years                          |                             |
|      | Total Installed Cost (2027 \$/kW):         | TBD                               |                             |
|      | Direct Construction Cost (\$/kW):          | TBD                               |                             |
|      | AFUDC Amount (2027 \$/kW):                 | TBD                               |                             |
|      | Escalation (\$/kW):                        | TBD                               |                             |
|      | Fixed O&M (\$/kW-Yr.): (2027 \$)           | TBD                               | (First Full Year Operation) |
|      | Variable O&M (\$/MWH): (2027 \$)           | TBD                               |                             |
|      | K Factor:                                  | TBD                               |                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Solar PV
- (2) **Capacity**  
a. Nameplate (AC) 1,490 MW  
b. Summer Firm (AC)<sup>1/</sup> 79 MW  
c. Winter Firm (AC) - MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2027  
b. Commercial In-service date: 2028
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** 748 Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): TBD (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2028 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2028 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2028 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2028 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- |      |  |   |                             |
|------|--|---|-----------------------------|
| (1)  | <b>Plant Name and Unit Number:</b>         | Unsited Battery Storage (4-Hour Duration) |                             |
| (2)  | <b>Capacity</b>                            |   |                             |
|      | a. Nameplate (AC)                          | 596                                       | MW                          |
|      | b. Summer Firm (AC)                        | 298                                       | MW                          |
|      | c. Winter Firm (AC)                        | 596                                       | MW                          |
| (3)  | <b>Technology Type:</b>                    | Battery                                   |                             |
| (4)  | <b>Anticipated Construction Timing</b>     |   |                             |
|      | a. Field construction start-date:          | 2027                                      |                             |
|      | b. Commercial In-service date:             | 2028                                      |                             |
| (5)  | <b>Fuel</b>                                |   |                             |
|      | a. Primary Fuel                            |   | Not applicable              |
|      | b. Alternate Fuel                          |   | Not applicable              |
| (6)  | <b>Air Pollution and Control Strategy:</b> | Not applicable                            |                             |
| (7)  | <b>Cooling Method:</b>                     | Not applicable                            |                             |
| (8)  | <b>Total Site Area:</b>                    | TBD                                       | Acres                       |
| (9)  | <b>Construction Status:</b>                | P   | (Planned Unit)              |
| (10) | <b>Certification Status:</b>               | —   |                             |
| (11) | <b>Status with Federal Agencies:</b>       | —   |                             |
| (12) | <b>Projected Unit Performance Data:</b>    |   |                             |
|      | Planned Outage Factor (POF):               |   | Not applicable              |
|      | Forced Outage Factor (FOF):                |   | Not applicable              |
|      | Equivalent Availability Factor (EAF):      |   | Not applicable              |
|      | Round-Trip Efficiency                      |   | TBD                         |
|      | Average Net Operating Heat Rate (ANOHR):   |   | Not applicable              |
|      | Base Operation 75F, 100%                   |   |                             |
|      | Average Net Incremental Heat Rate (ANIHR): |   | Not applicable              |
|      | Peak Operation 75F, 100%                   |   |                             |
| (13) | <b>Projected Unit Financial Data *</b>     |   |                             |
|      | Book Life (Years):                         | 20  | years                       |
|      | Total Installed Cost (2028 \$/kW):         | TBD                                       |                             |
|      | Direct Construction Cost (\$/kW):          | TBD                                       |                             |
|      | AFUDC Amount (2028 \$/kW):                 | TBD                                       |                             |
|      | Escalation (\$/kW):                        | TBD                                       |                             |
|      | Fixed O&M (\$/kW-Yr.): (2028 \$)           | TBD                                       | (First Full Year Operation) |
|      | Variable O&M (\$/MWh): (2028 \$)           | TBD                                       |                             |
|      | K Factor:                                  | TBD                                       |                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Solar PV
- (2) **Capacity**  
a. Nameplate (AC) 1,788 MW  
b. Summer Firm (AC)<sup>1/</sup> 95 MW  
c. Winter Firm (AC) - MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2028  
b. Commercial In-service date: 2029
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): TBD (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2029 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2029 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2029 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2029 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Battery Storage (4-Hour Duration)
- (2) **Capacity**
- |                     |        |
|---------------------|--------|
| a. Nameplate (AC)   | 596 MW |
| b. Summer Firm (AC) | 247 MW |
| c. Winter Firm (AC) | 596 MW |
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**
- |                                   |      |
|-----------------------------------|------|
| a. Field construction start-date: | 2028 |
| b. Commercial In-service date:    | 2029 |
- (5) **Fuel**
- |                   |                |
|-------------------|----------------|
| a. Primary Fuel   | Not applicable |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**
- |  |                |
|--|----------------|
| Planned Outage Factor (POF):               | Not applicable |
| Forced Outage Factor (FOF):                | Not applicable |
| Equivalent Availability Factor (EAF):      | Not applicable |
| Round-Trip Efficiency                      | TBD            |
| Average Net Operating Heat Rate (ANOHR):   | Not applicable |
| Base Operation 75F, 100%                   |                |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100%                   |                |
- (13) **Projected Unit Financial Data \***
- |                                    |                                 |
|------------------------------------|---------------------------------|
| Book Life (Years):                 | 20 years                        |
| Total Installed Cost (2029 \$/kW): | TBD                             |
| Direct Construction Cost (\$/kW):  | TBD                             |
| AFUDC Amount (2029 \$/kW):         | TBD                             |
| Escalation (\$/kW):                | TBD                             |
| Fixed O&M (\$/kW-Yr.): (2029 \$)   | TBD (First Full Year Operation) |
| Variable O&M (\$/MWH): (2029 \$)   | TBD                             |
| K Factor:                          | TBD                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Solar PV
- (2) **Capacity**  
a. Nameplate (AC) 2,235 MW  
b. Summer Firm (AC)<sup>1/</sup> 119 MW  
c. Winter Firm (AC) - MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2029  
b. Commercial In-service date: 2030
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): TBD (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2030 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2030 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2030 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2030 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.



**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- |      |  |  |                             |
|------|--|--|-----------------------------|
| (1)  | <b>Plant Name and Unit Number:</b>         | Unsitd Battery Storage (4-Hour Duration) |                             |
| (2)  | <b>Capacity</b>                            |  |                             |
|      | a. Nameplate (AC)                          | 596                                      | MW                          |
|      | b. Summer Firm (AC)                        | 244                                      | MW                          |
|      | c. Winter Firm (AC)                        | 596                                      | MW                          |
| (3)  | <b>Technology Type:</b>                    | Battery                                  |                             |
| (4)  | <b>Anticipated Construction Timing</b>     |  |                             |
|      | a. Field construction start-date:          | 2029                                     |                             |
|      | b. Commercial In-service date:             | 2030                                     |                             |
| (5)  | <b>Fuel</b>                                |  |                             |
|      | a. Primary Fuel                            |  | Not applicable              |
|      | b. Alternate Fuel                          |  | Not applicable              |
| (6)  | <b>Air Pollution and Control Strategy:</b> | Not applicable                           |                             |
| (7)  | <b>Cooling Method:</b>                     | Not applicable                           |                             |
| (8)  | <b>Total Site Area:</b>                    | TBD                                      | Acres                       |
| (9)  | <b>Construction Status:</b>                | P  | (Planned Unit)              |
| (10) | <b>Certification Status:</b>               | —  |                             |
| (11) | <b>Status with Federal Agencies:</b>       | —  |                             |
| (12) | <b>Projected Unit Performance Data:</b>    |  |                             |
|      | Planned Outage Factor (POF):               |  | Not applicable              |
|      | Forced Outage Factor (FOF):                |  | Not applicable              |
|      | Equivalent Availability Factor (EAF):      |  | Not applicable              |
|      | Round-Trip Efficiency                      |  | TBD                         |
|      | Average Net Operating Heat Rate (ANOHR):   |  | Not applicable              |
|      | Base Operation 75F, 100%                   |  |                             |
|      | Average Net Incremental Heat Rate (ANIHR): |  | Not applicable              |
|      | Peak Operation 75F, 100%                   |  |                             |
| (13) | <b>Projected Unit Financial Data *</b>     |  |                             |
|      | Book Life (Years):                         | 20                                       | years                       |
|      | Total Installed Cost (2030 \$/kW):         | TBD                                      |                             |
|      | Direct Construction Cost (\$/kW):          | TBD                                      |                             |
|      | AFUDC Amount (2030 \$/kW):                 | TBD                                      |                             |
|      | Escalation (\$/kW):                        | TBD                                      |                             |
|      | Fixed O&M (\$/kW-Yr.): (2030 \$)           | TBD                                      | (First Full Year Operation) |
|      | Variable O&M (\$/MWH): (2030 \$)           | TBD                                      |                             |
|      | K Factor:                                  | TBD                                      |                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Solar PV
- (2) **Capacity**  
a. Nameplate (AC) 2,235 MW  
b. Summer Firm (AC)<sup>1/</sup> 119 MW  
c. Winter Firm (AC) - MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2030  
b. Commercial In-service date: 2031
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): TBD (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2031 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2031 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2031 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWh): (2031 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- |      |  |  |                             |
|------|--|--|-----------------------------|
| (1)  | <b>Plant Name and Unit Number:</b>         | Unsite Battery Storage (4-Hour Duration) |                             |
| (2)  | <b>Capacity</b>                            |  |                             |
|      | a. Nameplate (AC)                          | 596                                      | MW                          |
|      | b. Summer Firm (AC)                        | 244                                      | MW                          |
|      | c. Winter Firm (AC)                        | 596                                      | MW                          |
| (3)  | <b>Technology Type:</b>                    | Battery                                  |                             |
| (4)  | <b>Anticipated Construction Timing</b>     |  |                             |
|      | a. Field construction start-date:          | 2030                                     |                             |
|      | b. Commercial In-service date:             | 2031                                     |                             |
| (5)  | <b>Fuel</b>                                |  |                             |
|      | a. Primary Fuel                            |  | Not applicable              |
|      | b. Alternate Fuel                          |  | Not applicable              |
| (6)  | <b>Air Pollution and Control Strategy:</b> | Not applicable                           |                             |
| (7)  | <b>Cooling Method:</b>                     | Not applicable                           |                             |
| (8)  | <b>Total Site Area:</b>                    | TBD                                      | Acres                       |
| (9)  | <b>Construction Status:</b>                | P  | (Planned Unit)              |
| (10) | <b>Certification Status:</b>               | —  |                             |
| (11) | <b>Status with Federal Agencies:</b>       | —  |                             |
| (12) | <b>Projected Unit Performance Data:</b>    |  |                             |
|      | Planned Outage Factor (POF):               |  | Not applicable              |
|      | Forced Outage Factor (FOF):                |  | Not applicable              |
|      | Equivalent Availability Factor (EAF):      |  | Not applicable              |
|      | Round-Trip Efficiency                      |  | TBD                         |
|      | Average Net Operating Heat Rate (ANOH):    |  | Not applicable              |
|      | Base Operation 75F, 100%                   |  |                             |
|      | Average Net Incremental Heat Rate (ANIH):  |  | Not applicable              |
|      | Peak Operation 75F, 100%                   |  |                             |
| (13) | <b>Projected Unit Financial Data *</b>     |  |                             |
|      | Book Life (Years):                         | 20                                       | years                       |
|      | Total Installed Cost (2031 \$/kW):         | TBD                                      |                             |
|      | Direct Construction Cost (\$/kW):          | TBD                                      |                             |
|      | AFUDC Amount (2031 \$/kW):                 | TBD                                      |                             |
|      | Escalation (\$/kW):                        | TBD                                      |                             |
|      | Fixed O&M (\$/kW-Yr.): (2031 \$)           | TBD                                      | (First Full Year Operation) |
|      | Variable O&M (\$/MWH): (2031 \$)           | TBD                                      |                             |
|      | K Factor:                                  | TBD                                      |                             |

\* \$/kW values are based on nameplate capacity.

Note: Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** 2x0 Manatee CT
- (2) **Capacity**  
a. Nameplate (AC) 475 MW  
b. Summer Firm (AC)<sup>1/</sup> 469 MW  
c. Winter Firm (AC) 475 MW
- (3) **Technology Type:** Combustion Turbine
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2028  
b. Commercial In-service date: 2032
- (5) **Fuel**  
a. Primary Fuel Natural Gas  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): TBD  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 50 years  
Total Installed Cost (2032 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2032 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2032 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2032 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Solar PV
- (2) **Capacity**  
a. Nameplate (AC) 2,235 MW  
b. Summer Firm (AC)<sup>1/</sup> 119 MW  
c. Winter Firm (AC) - MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2031  
b. Commercial In-service date: 2032
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): TBD (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHR): Not applicable  
Base Operation 75F, 100%  
Average Net Incremental Heat Rate (ANIHR): Not applicable  
Peak Operation 75F, 100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2032 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2032 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2032 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWH): (2032 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Solar PV
- (2) **Capacity**  
a. Nameplate (AC) 2,235 MW  
b. Summer Firm (AC)<sup>1/</sup> 119 MW  
c. Winter Firm (AC) - MW
- (3) **Technology Type:** Photovoltaic (PV)
- (4) **Anticipated Construction Timing**  
a. Field construction start-date: 2032  
b. Commercial In-service date: 2033
- (5) **Fuel**  
a. Primary Fuel Solar  
b. Alternate Fuel Not applicable
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**  
Planned Outage Factor (POF): Not applicable  
Forced Outage Factor (FOF): Not applicable  
Equivalent Availability Factor (EAF): Not applicable  
Resulting Capacity Factor (%): TBD (First Full Year Operation)  
Average Net Operating Heat Rate (ANOHr): Not applicable  
Base Operation 75F,100%  
Average Net Incremental Heat Rate (ANIHr): Not applicable  
Peak Operation 75F,100%
- (13) **Projected Unit Financial Data \***  
Book Life (Years): 35 years  
Total Installed Cost (2033 \$/kW): TBD  
Direct Construction Cost (\$/kW): TBD  
AFUDC Amount (2033 \$/kW): TBD  
Escalation (\$/kW): TBD  
Fixed O&M (\$/kW-Yr.): (2033 \$) TBD (First Full Year Operation)  
Variable O&M (\$/MWh): (2033 \$) TBD  
K Factor: TBD

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Battery Storage (4-Hour Duration)
- (2) **Capacity**
- |                     |          |
|---------------------|----------|
| a. Nameplate (AC)   | 1,192 MW |
| b. Summer Firm (AC) | 424 MW   |
| c. Winter Firm (AC) | 1,192 MW |
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**
- |                                   |      |
|-----------------------------------|------|
| a. Field construction start-date: | 2032 |
| b. Commercial In-service date:    | 2033 |
- (5) **Fuel**
- |                   |                |
|-------------------|----------------|
| a. Primary Fuel   | Not applicable |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**
- |  |                |
|--|----------------|
| Planned Outage Factor (POF):               | Not applicable |
| Forced Outage Factor (FOF):                | Not applicable |
| Equivalent Availability Factor (EAF):      | Not applicable |
| Round-Trip Efficiency                      | TBD            |
| Average Net Operating Heat Rate (ANOHR):   | Not applicable |
| Base Operation 75F, 100%                   |                |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100%                   |                |
- (13) **Projected Unit Financial Data \***
- |                                    |                                 |
|------------------------------------|---------------------------------|
| Book Life (Years):                 | 20 years                        |
| Total Installed Cost (2033 \$/kW): | TBD                             |
| Direct Construction Cost (\$/kW):  | TBD                             |
| AFUDC Amount (2033 \$/kW):         | TBD                             |
| Escalation (\$/kW):                | TBD                             |
| Fixed O&M (\$/kW-Yr.): (2033 \$)   | TBD (First Full Year Operation) |
| Variable O&M (\$/MWH): (2033 \$)   | TBD                             |
| K Factor:                          | TBD                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.

**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- |      |  |                   |                             |
|------|--|-------------------|-----------------------------|
| (1)  | <b>Plant Name and Unit Number:</b>         | Unsite Solar PV   |                             |
| (2)  | <b>Capacity</b>                            |                   |                             |
|      | a. Nameplate (AC)                          | 2,235             | MW                          |
|      | b. Summer Firm (AC)                        | 119               | MW                          |
|      | c. Winter Firm (AC)                        | -                 | MW                          |
| (3)  | <b>Technology Type:</b>                    | Photovoltaic (PV) |                             |
| (4)  | <b>Anticipated Construction Timing</b>     |                   |                             |
|      | a. Field construction start-date:          | 2033              |                             |
|      | b. Commercial In-service date:             | 2034              |                             |
| (5)  | <b>Fuel</b>                                |                   |                             |
|      | a. Primary Fuel                            | Solar             |                             |
|      | b. Alternate Fuel                          | Not applicable    |                             |
| (6)  | <b>Air Pollution and Control Strategy:</b> | Not applicable    |                             |
| (7)  | <b>Cooling Method:</b>                     | Not applicable    |                             |
| (8)  | <b>Total Site Area:</b>                    | TBD               | Acres                       |
| (9)  | <b>Construction Status:</b>                | P                 | (Planned Unit)              |
| (10) | <b>Certification Status:</b>               | —                 |                             |
| (11) | <b>Status with Federal Agencies:</b>       | —                 |                             |
| (12) | <b>Projected Unit Performance Data:</b>    |                   |                             |
|      | Planned Outage Factor (POF):               | Not applicable    |                             |
|      | Forced Outage Factor (FOF):                | Not applicable    |                             |
|      | Equivalent Availability Factor (EAF):      | Not applicable    |                             |
|      | Resulting Capacity Factor (%):             | TBD               | (First Full Year Operation) |
|      | Average Net Operating Heat Rate (ANOH):    | Not applicable    |                             |
|      | Base Operation 75F, 100%                   |                   |                             |
|      | Average Net Incremental Heat Rate (ANIH):  | Not applicable    |                             |
|      | Peak Operation 75F, 100%                   |                   |                             |
| (13) | <b>Projected Unit Financial Data *</b>     |                   |                             |
|      | Book Life (Years):                         | 35                | years                       |
|      | Total Installed Cost (2034 \$/kW):         | TBD               |                             |
|      | Direct Construction Cost (\$/kW):          | TBD               |                             |
|      | AFUDC Amount (2034 \$/kW):                 | TBD               |                             |
|      | Escalation (\$/kW):                        | TBD               |                             |
|      | Fixed O&M (\$/kW-Yr.): (2034 \$)           | TBD               | (First Full Year Operation) |
|      | Variable O&M (\$/MWh): (2034 \$)           | TBD               |                             |
|      | K Factor:                                  | TBD               |                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

1/ The value shown represents FPL's current projection of the firm capacity of this amount of incremental PV assuming the planned PV additions in prior years. As the amount of PV on FPL's system increases, the remaining Summer load not served by solar is altered so that the remaining Summer peak load moves to later in the day. Because the amount of solar energy diminishes in these later hours, the firm capacity value of the incremental solar is decreased.

2/ FPL will continue to analyze the projected impacts of increasing amounts of battery storage in its on-going resource planning work.



**Schedule 9**  
**Status Report and Specifications of Proposed Generating Facilities**

- (1) **Plant Name and Unit Number:** Unsited Battery Storage (4-Hour Duration)
- (2) **Capacity**
- |                                   |          |
|-----------------------------------|----------|
| a. Nameplate (AC)                 | 1,267 MW |
| b. Summer Firm (AC) <sup>1/</sup> | 350 MW   |
| c. Winter Firm (AC)               | 1,267 MW |
- (3) **Technology Type:** Battery
- (4) **Anticipated Construction Timing**
- |                                   |      |
|-----------------------------------|------|
| a. Field construction start-date: | 2033 |
| b. Commercial In-service date:    | 2034 |
- (5) **Fuel**
- |                   |                |
|-------------------|----------------|
| a. Primary Fuel   | Not applicable |
| b. Alternate Fuel | Not applicable |
- (6) **Air Pollution and Control Strategy:** Not applicable
- (7) **Cooling Method:** Not applicable
- (8) **Total Site Area:** TBD Acres
- (9) **Construction Status:** P (Planned Unit)
- (10) **Certification Status:** —
- (11) **Status with Federal Agencies:** —
- (12) **Projected Unit Performance Data:**
- |  |                |
|--|----------------|
| Planned Outage Factor (POF):               | Not applicable |
| Forced Outage Factor (FOF):                | Not applicable |
| Equivalent Availability Factor (EAF):      | Not applicable |
| Round-Trip Efficiency                      | TBD            |
| Average Net Operating Heat Rate (ANOHR):   | Not applicable |
| Base Operation 75F, 100%                   |                |
| Average Net Incremental Heat Rate (ANIHR): | Not applicable |
| Peak Operation 75F, 100%                   |                |
- (13) **Projected Unit Financial Data \***
- |                                    |                                 |
|------------------------------------|---------------------------------|
| Book Life (Years):                 | 20 years                        |
| Total Installed Cost (2034 \$/kW): | TBD                             |
| Direct Construction Cost (\$/kW):  | TBD                             |
| AFUDC Amount (2034 \$/kW):         | TBD                             |
| Escalation (\$/kW):                | TBD                             |
| Fixed O&M (\$/kW-Yr.): (2034 \$)   | TBD (First Full Year Operation) |
| Variable O&M (\$/MWH): (2034 \$)   | TBD                             |
| K Factor:                          | TBD                             |

\* \$/kW values are based on nameplate capacity.

**Note:** Total installed cost includes transmission interconnection and AFUDC.

<sup>1/</sup> The value shown represents FPL's current projection of the firm capacity of this battery storage after the net load of the system and other battery storage being discharged. Because battery storage "flattens" the peak period, the firm capacity value of storage decreases as more battery storage is added to the system.

<sup>2/</sup> FPL will continue to analyze the projected impacts of increasing amounts of PV in its on-going resource planning work.

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Canoe Battery Energy Storage System Center (Okaloosa County)**

The Canoe Battery Energy Storage System Center will be connected to the transmission bus at Mink Substation, approximately 0.0 miles to connect the BESS.

(1) Point of Origin and Termination:	Mink Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2025
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Mink Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Blackwater Battery Energy Storage System Center (Santa Rosa County)**

The Blackwater Battery Energy Storage System Center will be connected to the transmission bus at Rooster Substation, approximately 0.0 miles to connect the BESS.

(1) Point of Origin and Termination:	Rooster Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2025
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Rooster Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**  
**Chipola River Battery Energy Storage System Center (Calhoun County)**

The Chipola River Battery Energy Storage System Center will be connected to the transmission bus at Melvin Substation, approximately 0.0 miles to connect the BESS.

(1) Point of Origin and Termination:	Melvin Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2025
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Melvin Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Fourmile Creek Battery Energy Storage System Center (Calhoun County)**

The Fourmile Creek Battery Energy Storage System Center will be connected to the transmission bus at Quincy Substation, approximately 0.0 miles to connect the BESS.

(1) Point of Origin and Termination:	Quincy Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2025
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Quincy Substation
(9) Participation with Other Utilities:	None

---

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Tenmile Creek Battery Energy Storage System Center (Calhoun County)**

The Tenmile Creek Battery Energy Storage System Center will be connected to the transmission bus at Tenmile Substation, approximately 0.0 miles to connect the BESS.

(1) Point of Origin and Termination:	Tenmile Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2025
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Tenmile Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Shirer Branch Battery Energy Storage System Center (Calhoun County)**

The Shirer Branch Battery Energy Storage System Center will be connected to the transmission bus at Mayo Substation, approximately 0.0 miles to connect the BESS.

(1) Point of Origin and Termination:	Mayo Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	115 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2025
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Mayo Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Kayak Battery Energy Storage System Center (Okaloosa County)**

The Kayak Battery Energy Storage System Center will be connected to the transmission bus at Kayak Substation, approximately 0.0 miles to connect the BESS.

(1) Point of Origin and Termination:	Kayak Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2025
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Kayak Substation
(9) Participation with Other Utilities:	None

---



**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Flatford Solar Energy Center (Manatee County)**

The Flatford Solar Energy Center will require bifurcating the new FPL Gridiron - Keentown 230 kV transmission line approximately 0.0 miles to connect a new Flatford substation and the solar PV inverter array.

(1) Point of Origin and Termination:	Gridiron - Lemur 230kV transmission line to the new Flatford Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Flatford Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Mare Branch Solar Energy Center (DeSoto County)**

The Mare Branch Solar Energy Center will require extending a transmission line from the Whidden Substation approximately 7.0 miles to connect the new Stallion Substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Whidden Substation to the new Stallion Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	Approximately 7.0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Stallion Substation
(9) Participation with Other Utilities:	None

---

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Price Creek Solar Energy Center (Columbia County)**

The Price Creek Solar Energy Center will require bifurcating the FPL Claude - Raven 230 kV transmission line approximately 0.0 miles to connect a new Madonna substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Claude - Raven 230 kV transmission line to new Madonna Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Madonna Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Swamp Cabbage Solar Energy Center (Hendry County)**

The Swamp Cabbage Solar Energy Center will require bifurcating the FPL Alva - Witt 230 kV transmission line approximately 3.15 miles to connect a new Swamp substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Alva - Witt 230 kV transmission line to new Swamp Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	Approximately 3.15 miles double circuit
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Swamp Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Big Brook Solar Energy Center (Calhoun County)**

The Big Brook Solar Energy Center will require bifurcating the FPL Melvin - Tenmile 230 kV transmission line approximately 0.0 miles to connect a new Song substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Melvin - Tenmile 230 kV transmission line to new Song Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Song Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Mallard Solar Energy Center (Brevard County)**

The Mallard Solar Energy Center will require extending the transmission bus at Crayfish Substation approximately 0.7 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Crayfish Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0.7 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Goodwin Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Boardwalk Solar Energy Center (Collier County)**

The Boardwalk Solar Energy Center will require extending the transmission bus at Puma Substation approximately 0.0 miles to connect a new Boardwalk substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Puma Substation
(2) Number of Lines:	0
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	500 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Boardwalk Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Goldenrod Solar Energy Center (Collier County)**

The Goldenrod Solar Energy Center will require extending the transmission bus at Puma/Boardwalk Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Boardwalk Substation
(2) Number of Lines:	0
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	500 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Boardwalk Substation
(9) Participation with Other Utilities:	None

---



**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**North Orange Solar Energy Center (St. Lucie County)**

The North Orange Solar Energy Center will require bifurcating the new FPL Sunbreak - Morrow 230 kV transmission line approximately 0.0 miles to connect a new Apricot substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Sunbreak - Morrow 230 kV transmission line to new Apricot Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Apricot Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Sea Grape Solar Energy Center (St. Lucie County)**

The Sea Grape Solar Energy Center will require bifurcating the new FPL Sunbreak - Morrow 230 kV transmission line approximately 0.0 miles to connect a new Muscadine substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Sunbreak - Morrow 230 kV transmission line to new Muscadine Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Muscadine Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Clover Solar Energy Center (St. Lucie County)**

The Clover Solar Energy Center will require extending a transmission line from the new Sunbreak Substation approximately 2.0 miles to connect the new Clover Substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Sunbreak Substation to the new Clover Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	Approximately 2 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Clover Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Sand Pine Solar Energy Center (Calhoun County)**

The Sand Pine Solar Energy Center will require extending the transmission bus at Quincy Substation approximately 0.0 miles to connect a new Chinkapin substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Quincy Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Chinkapin Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Hendry Solar Energy Center (Hendry County)**

The Hendry Solar Energy Center will require extending the transmission bus at Ghost Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Ghost Substation
(2) Number of Lines:	0
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	500 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Ghost Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Tangelo Solar Energy Center (Okeechobee County)**

The Tangelo Solar Energy Center will require extending the transmission bus at Seville Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Seville Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Seville Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Wood Stork Solar Energy Center (St. Lucie County)**

The Wood Stork Solar Energy Center will require extending the transmission bus at Glint Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Glint Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Glint Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Indrio Solar Energy Center (St. Lucie County)**

The Indrio Solar Energy Center will require bifurcating the new FPL Sunbreak - Heritage 230 kV transmission line approximately 0.0 miles to connect a new Estuary substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Sunbreak - Heritage 230 kV transmission line to new Estuary Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Estuary Substation
(9) Participation with Other Utilities:	None

---



**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Middle Lake Solar Energy Center (Madison County)**

The Middle Lake Solar Energy Center will require extending the transmission bus at future Bandit Substation approximately 0.0 miles to connect a new Sound substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Bandit Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	161 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Sound Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Ambersweet Solar Energy Center (Indian River County)**

The Indrio Solar Energy Center will require bifurcating the new FPL Sunbreak - Kiran 230 kV transmission line approximately 0.0 miles to connect a new Ambersweet substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Sunbreak - Kiran 230 kV transmission line to new Ambersweet Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Ambersweet Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**County Line Solar Energy Center (DeSoto County)**

The County Line Solar Energy Center will require extending the transmission bus at Notts Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Notts Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Notts Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Saddle Solar Energy Center (DeSoto County)**

The Saddle Solar Energy Center will require extending the transmission bus at Ponna Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Ponna Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Ponna Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Cocoplum Solar Energy Center (Hendry County)**

The Cocoplum Solar Energy Center will require extending the transmission bus at Witt Substation approximately 0.0 miles to connect a new Mulberry substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Witt Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Mulberry Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Catfish Solar Energy Center (Okeechobee County)**

The Catfish Solar Energy Center will require extending the transmission bus at Pyrite Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Pyrite Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Pyrite Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Hardwood Hammock Solar Energy Center (Walton County)**

The Hardwood Hammock Solar Energy Center will require extending the transmission bus at Quail Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Quail Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Quail Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Maple Trail Solar Energy Center (Baker County)**

The Maple Trail Solar Energy Center will require extending the transmission bus at Deodar Substation approximately 0.0 miles to connect a new Maple substation and connect the solar PV inverter array.

(1) Point of Origin and Termination:	Deodar Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Maple Substation
(9) Participation with Other Utilities:	None

---



**Schedule 10  
Status Report and Specifications of Proposed Transmission Lines**

**Pinecone Solar Energy Center (Calhoun County)**

The Pinecone Solar Energy Center will require extending the transmission bus at Chinkapin Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Chinkapin Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Chinkapin Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Joshua Creek Solar Energy Center (DeSoto County)**

The Joshua Creek Solar Energy Center will require extending a transmission bus at Stallion Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Stallion Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0.0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Stallion Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Spanish Moss Solar Energy Center (St. Lucie County)**

The Spanish Moss Solar Energy Center will require extending the transmission bus at Apricot Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Apricot Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Apricot Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Vernia Solar Energy Center (Indian River County)**

The Vernia Solar Energy Center will require extending the transmission bus at Ambersweet Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Ambersweet Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Ambersweet Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**LaBelle Solar Energy Center (Hendry County)**

The LaBelle Solar Energy Center will require extending the transmission bus at Swamp Substation approximately 0.0 miles to connect the solar PV inverter array.

(1) Point of Origin and Termination:	Swamp Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2027 End date: 2028
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Swamp Substation
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Lansing Smith Battery Energy Storage System Center (Bay County)**

The Lansing Smith Battery Energy Storage System Center will require extending the transmission bus at Lansing Smith Switchyard approximately 0.26 miles to connect the BESS.

(1) Point of Origin and Termination:	Lansing Smith Switchyard
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0.26 miles
(5) Voltage:	230 kV
(6) Anticipated Construction Timing:	Start date: 2025 End date: 2026
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Lansing Smith Switchyard
(9) Participation with Other Utilities:	None

---

**Schedule 10**  
**Status Report and Specifications of Proposed Transmission Lines**

**Putnam Battery Energy Storage System Center (Putnam County)**

The Putnam Battery Energy Storage System Center will require extending the transmission bus at Putnam Substation approximately 0.3 miles to connect the BESS.

(1) Point of Origin and Termination:	Putnam BESS U1 Substation
(2) Number of Lines:	1
(3) Right-of-way	FPL – Owned
(4) Line Length:	0.3 miles
(5) Voltage:	115 kV
(6) Anticipated Construction Timing:	Start date: 2026 End date: 2027
(7) Anticipated Capital Investment: (Trans. and Sub.)	Included in total installed cost on Schedule 9
(8) Substations:	Putnam BESS U1Substation
(9) Participation with Other Utilities:	None

---

**Schedule 11.1: FPL**

**Existing Firm and Non-Firm Capacity and Energy by Primary Fuel Type  
Actuals for the Year 2024**

	(1)	(2)	(3)	(4)	(5)	(8)	(9)
	Generation by Primary Fuel	Net (MW) Capability				NEL GWh <sup>(2)</sup>	Fuel Mix %
		Summer (MW)	Summer (%)	Winter (MW)	Winter (%)		
(1)	Coal	215	0.6%	215	0.6%	533	0.4%
(2)	Nuclear	3,502	9.8%	3,588	9.7%	28,009	19.2%
(3)	Residual	0	0.0%	0	0.0%	0	0.0%
(4)	Distillate	134	0.4%	163	0.4%	116	0.1%
(5)	Natural Gas	24,170	67.8%	25,345	68.6%	104,335	71.4%
(6)	Landfill Gas	3	0.0%	3	0.0%		
(7)	Solar (Firm & Non-Firm)	7,038	19.7%	7,038	19.1%	12,404	8.5%
(8)	Battery	469	1.3%	469	1.3%	-	-
(9)	<b>FPL Existing Units Total <sup>(1)</sup>:</b>	<b>35,531</b>	<b>99.7%</b>	<b>36,821</b>	<b>99.7%</b>	<b>145,398</b>	<b>99.5%</b>
(10)	Renewables (Purchases)- Firm	122	0.3%	109	0.3%	1,855	1.3%
(11)	Renewables (Purchases)- Non-Firm	Not Applicable	—	Not Applicable	—	1,162	0.8%
(12)	<b>Renewable Total:</b>	<b>122</b>	<b>0.0</b>	<b>109</b>	<b>0.0</b>	<b>3,017</b>	<b>2.1%</b>
(13)	<b>Purchases Other / (Sales) :</b>	<b>0.0</b>	<b>0.0%</b>	<b>0.0</b>	<b>0.0%</b>	<b>(2,312)</b>	<b>-1.6%</b>
(14)	<b>Total:</b>	<b>35,653</b>	<b>100.0%</b>	<b>36,930</b>	<b>100.0%</b>	<b>146,103</b>	<b>100.0%</b>

Note:

- (1) FPL Existing Units Total values on row (9), columns (2) and (4) match the Total Nameplate System Generating Capacity values found on Schedule 1 for Summer and Winter.
- (2) Net Energy for Load GWh values on row (14), column (8), matches Schedule 6.1 value for 2024.
- (3) Information on projected renewable capacity and energy is available in Schedule 6.1, Schedule 8, and Schedule 9.



**Schedule 11.2: FPL**

**Existing Non-Firm Self-Service Renewable Generation Facilities  
Actuals for the Year 2024 <sup>1/</sup>**

(1)	(2)	(3)	(4)	(5)	(6) = (3)+(4)-(5)
Type of Facility	Installed Capacity DC (MW)	Renewable Projected Annual Output (MWh) 2/	Annual Energy Purchased from FPL (MWh) 3/	Annual Energy Sold to FPL - Total (MWh) 4/	Projected Annual Energy Used by Customers 5/
Customer-Owned Renewable Generation (0 kW to 10 kW)	733.80	1,063,276	1,072,792	484,470	1,651,598
Customer-Owned Renewable Generation (> 10 kW to 100 kW)	484.07	774,996	701,611	266,711	1,209,896
Customer-Owned Renewable Generation (> 100 kW - 2 MW)	66.30	110,257	393,691	19,200	484,748
<b>Totals</b>	<b>1,284.17</b>	<b>1,948,529</b>	<b>2,168,094</b>	<b>770,381</b>	<b>3,346,242</b>

1/ There were approximately 113,097 customers with renewable generation facilities interconnected with FPL on December 31, 2024.

2/ The Projected Annual Output value is based on NREL's PV Watts 1 program and uses the Installed Capacity value in column (2), adjusted for the date when each facility was installed and assuming each facility operated as planned.

3/ The Annual Energy Purchased from FPL is an actual value from FPL's metered data for 2024.

4/ The Annual Energy Sold to FPL - Total is an actual value from FPL's metered data for 2024. These are the total MWh that were "overproduced" by the customer each month throughout 2024.

5/ The Projected Annual Energy Used by Customers is a projected value that equals:

(Renewable Projected Annual output + Annual Energy Purchased ) minus the Annual Energy Sold to FPL - Total).

**Schedule 11.3: FPL**

**Renewable Capacity and Energy  
Projections, 2025-2034**

**Capacity Projections (Nameplate MW)**

<b>Renewable Type:</b>	<b>2025</b>	<b>2026</b>	<b>2027</b>	<b>2028</b>	<b>2029</b>	<b>2030</b>	<b>2031</b>	<b>2032</b>	<b>2033</b>	<b>2034</b>
Solar (Firm & Non-Firm)	7,932	8,826	10,018	11,508	13,296	15,531	17,766	20,001	22,236	24,471
Renewables (Purchases)- Firm	420	420	417	417	417	417	417	362	272	272
Renewables (Purchases)- Non-Firm	120	120	120	120	120	120	120	120	120	120
Customer-Owned Renewable Generation	1,275	1,616	2,013	2,465	2,963	3,528	4,140	4,720	5,350	6,027

**Energy Projections (GWh)**

<b>Renewable Type:</b>	<b>2025</b>	<b>2026</b>	<b>2027</b>	<b>2028</b>	<b>2029</b>	<b>2030</b>	<b>2031</b>	<b>2032</b>	<b>2033</b>	<b>2034</b>
Solar (Firm & Non-Firm)	17,692	19,662	21,736	25,140	29,159	34,294	39,720	45,254	50,328	55,800
Renewables (Purchases)- Firm	1,855	1,855	1,855	1,855	1,855	1,855	1,855	1,855	1,855	1,855
Renewables (Purchases)- Non-Firm	*	*	*	*	*	*	*	*	*	*
Customer-Owned Renewable Generation	2,056	2,633	3,298	4,060	4,909	5,860	6,908	7,960	9,027	10,178

\* FPL does not project non-firm energy as it is dependent on outside factors. Energy production from FPL's 120 MW of solar PPAs is included in the "Solar" entry

***(This page is intentionally left blank.)***

## **CHAPTER IV**

---

### **Environmental and Land Use Information**

***(This page is intentionally left blank.)***

## **IV. Environmental and Land Use Information**

### **IV.A. Protection of the Environment**

Reliable and low-cost energy is the lifeblood of Florida's growing population, expanding economy, and environmental resource restoration and management. Through its commitment to environmental excellence, FPL is helping to solve Florida's energy challenges sustainably and responsibly, while maintaining service reliability and keeping customer rates as low as possible. With one of the cleanest, most efficient power-generation fleets in the nation, FPL has reduced its use of heavy oil, including foreign oil, by approximately 99.99 percent – from approximately 41 million barrels annually in 2001 to less than 0.181 million barrels in 2024. FPL also has one of the lowest emissions profiles among U.S. utilities. In 2024, CO<sub>2</sub> rates for FPL were 18% lower, then the U.S. electric power sector average. At the end of 2024, FPL had approximately 7,038 MW of solar generation capability on its system (which consists entirely of universal solar PV), making FPL the largest producer of solar energy-generated electricity in Florida. In addition, FPL also has renewable energy purchase agreements for approximately 120 MW of universal solar PV generation.

This 2025 Site Plan for FPL presents a resource plan which shows a significant amount of additional solar. FPL's system is projected to have approximately 24,471 MW of solar by the end of the ten-year reporting period (2034) for this Site Plan.

FPL maintains its commitment to environmental stewardship through proactive collaboration with communities and organizations working to preserve Florida's unique habitat and natural resources. The many projects and programs in which FPL actively participates includes the creation and management of the Manatee Lagoon – An FPL Eco-Discovery Center®, a busy and thriving center in its nine years of operation which welcomes close to 200,000 visitors annually. In addition, the Everglades Mitigation Bank, Solar Stewardship program and the Turkey Point Crocodile Management Program are excellent examples of FPL's stewardship. Over the past 18 years, FPL has invested more than \$160 million to construct and retrofit more than 185,000 poles to make them more bird-friendly, reducing avian risk and improving service reliability to our customers. To identify and proactively address high-risk distribution structures, FPL created the energy industry's first avian risk assessment model. In 2022, FPL updated the avian risk assessment model as part of integrating Gulf Power into FPL's Avian Protection Program, and to further enhance avian assessment for eagles and wood storks, and protection processes.

In 2017, FPL launched its Solar Stewardship program in partnership with Audubon Florida. For the majority of its solar sites, FPL works with Audubon Florida and other local organizations to craft site-specific habitat enhancement and preservation plans focused on providing habitat opportunities for birds, pollinators and other wildlife. FPL accomplishes this through a variety of prescriptive methodologies, including but not limited to:

- Restoring hydrology to wetlands;
- Increasing biodiversity through the use of appropriate native plant species;
- Removing invasive species and implementing procedures to prevent regrowth;
- Incorporating pollinator species into ground covers; and
- Installing artificial perches, nest boxes and platforms for wildlife use.

FPL continues to work with regulatory agencies, municipalities, academic institutions, and community groups to address local or regional environmental objectives.

#### **IV.B Environmental Organization Contributions**

In 2024, FPL, through its charitable arm, the NextEra Energy Foundation, supported a broad base of environmental organizations with donations focused on education, conservation, and research. Those organizations include Fish & Wildlife Foundation of Florida, Florida State Parks Foundation, Inwater Research Group, Florida Defenders of Wildlife, Mote Marine Laboratory and Aquarium, Ocean Research & Conservation Association, Navarre Beach Sea Turtle Conservation Center, Conservation Florida, East Coast Zoological Foundation, Gulfarium C.A.R.E. Foundation, North Florida Land Trust, and Audubon (state & local chapters). FPL employees serve in board and leadership positions for many organizations that focus on environmental restoration, preservation, and stewardship. A partial list of these organizations includes Grassy Waters Conservancy, Loggerhead Marinelife Center, Marine Resources Council, Busch Wildlife Sanctuary, Florida Oceanographic Society and Audubon Florida. FPL employees also invest volunteer hours supporting conservation partners in maintaining, restoring, and protecting waters, wetlands, forests, beaches, parks, historic sites, and wildlife.

#### **IV.C Environmental Communication and Facilitation**

FPL is involved in many efforts to enhance environmental conservation through the facilitation of energy efficiency, environmental awareness, and through public education. Some of FPL's 2024 environmental outreach activities are summarized in Table IV.C.1.

**Table IV.C.1: 2024 FPL Environmental Outreach Activities**

Activity	Count (#)
Visitors to Manatee Lagoon - An FPL Eco-Discovery Center®	<b>197,289</b>
Number of website visits to Manatee Lagoon website, visitmanateelagoon.com	856,798 781,808
Number of website visits to NextEra and FPL's Environmental & Corporate Sustainability Websites	<b>22,099</b>
Visitors to Manatee Park, Ft. Myers	<b>191,805</b>
Home Energy Surveys	Field Surveys: 16,452 Phone Surveys: 9,603 Online Surveys: 74,124 <b>Total: 100,179</b>

#### **IV.D Environmental Policy**

FPL and its parent company, NextEra Energy, are committed to remaining an industry leader in environmental conservation and stewardship, not only because it makes business sense, but because it is the right thing to do. This commitment to compliance, conservation, communication, and continuous improvement fosters a culture of environmental excellence and drives its business planning, operations, and daily work.

In accordance with commitments to environmental compliance, conservation and stewardship, FPL and NextEra Energy endeavor to:

**Comply:**

- Site, design, permit, construct, operate, and maintain our facilities in an environmentally responsible manner;
- Comply with all applicable environmental laws, regulations, and permits;
- Proactively identify environmental risks and take action to mitigate those risks;
- Participate in legislative and regulatory processes to ensure that environmental laws, regulations, guidance documents, and policies are technically sound and economically feasible; and
- Pursue opportunities to exceed environmental standards.

**Conserve:**

- Promote the efficient use of energy, both within our company and in our communities;



- Prevent pollution, minimize waste, and conserve natural resources;
- Promote sustainability in our daily actions and project planning, where applicable;
- Endeavor to avoid, to the extent practicable, impacts to habitat, wildlife, jurisdictional waters, and cultural resources; minimize, and/or mitigate unavoidable impacts to such resources; and
- Lead with innovative solutions that synthesize environmental conservation and prudent operations.

Communicate:

- Communicate this policy annually to all employees, and maintain on internal website for easy reference;
- Invest in environmental training and awareness to achieve a corporate culture of environmental excellence;
- Maintain honest and open dialogue with stakeholders, including federal, state and local agencies on environmental goals, processes, and performance; and
- Highlight policy with external stakeholders and provide accurate reporting on environmental impacts (sustainability reporting).

Continuously Improve:

- Establish, monitor, and report progress toward environmental targets;
- Review and update this policy on a regular basis;
- Drive continuous improvement through ongoing evaluations of our environmental management system to incorporate lessons learned and best practices;
- Perform self-assessments of our operating facilities through the internal environmental audit program to ensure compliance, share best practices, and incorporate learnings across the fleet; and
- Maintain strong strategic vision to continuously seek innovative win-win solutions to complex environmental issues

FPL complies with all environmental laws, regulations, and permit requirements, and designs, constructs, and operates its facilities in an environmentally sound and responsible manner. FPL also responds immediately and effectively to any known environmental hazards or non-compliance situations. The commitment to the environment does not end there. FPL proactively pursues opportunities to perform better than current environmental standards require, including reducing

waste and emission of pollutants, recycling materials, and conserving natural resources throughout their operations and day-to-day work activities. FPL encourages cost-effective, efficient uses of energy, both within the Company and with its customers. These actions are just a few examples of how FPL is committed to the environment.

To ensure FPL is adhering to its environmental commitment, it has developed rigorous environmental governance procedures and programs. These include its Environmental Assurance Program. Through this program, FPL conducts periodic environmental self-evaluations to verify that its operations comply with environmental laws, regulations, and permit requirements. Regular evaluations also help identify best practices and opportunities for improvement.

#### **IV.E Environmental Management**

To successfully implement this Environmental Policy, FPL has developed a robust Environmental Management System to direct and control the fulfillment of the organization's environmental responsibilities. A key component of the system is an Environmental Assurance Program, which is described in section IV.F below. Other system components include: executive management support and commitment, dedicated environmental corporate governance program, written environmental policies and procedures, delineation of organizational responsibilities and individual accountabilities, allocation of appropriate resources for environmental compliance management (which includes reporting and corrective action when non-compliance occurs), environmental incident and/or emergency response, environmental risk assessment/management, environmental regulatory development and tracking, and environmental management information systems.

#### **IV.F Environmental Assurance Program**

FPL's Environmental Assurance Program consists of activities designed to evaluate environmental performance, verify compliance with corporate policy and legal and regulatory requirements, and communicate results to corporate management. The principal mechanism for pursuing environmental assurance is an environmental audit. An environmental audit is defined as a management tool comprised of a systematic, documented, risk-based, and objective evaluation of the performance of the organization and its specific management systems and equipment designed to protect the environment. An environmental audit's primary objective is to facilitate management control of environmental practices and assess compliance with existing environmental regulatory requirements and corporate policies. In addition to FPL facility audits, through the Environmental

Assurance Program, audits of third-party vendors used for recycling and/or disposal of waste generated by FPL operations are performed. Vendor audits provide information used for selecting candidates or incumbent vendors for disposal and recycling needs.

In addition to periodic environmental audits, NextEra Energy's Environmental Construction Compliance Assurance Program provides routine onsite inspections during construction and site-specific environmental training to everyone anticipated to be onsite during construction. Similar to an environmental audit, these inspections are performed to ensure compliance with the requirements of environmental permits, licenses, and corporate policies during the construction phase. Additionally, the Construction Compliance Assurance Program has integrated remote satellite and drone monitoring technology to broaden its inspection capabilities and increase the frequency of onsite observations.

FPL has also implemented a Corporate Environmental Governance System in which quarterly reviews are performed of each business unit deemed to have potential for significant environmental exposure. Quarterly reviews evaluate operations for potential environmental risks and consistency with the Environmental Policy. Items tracked during the quarterly reviews include processes for the identification and management of environmental risks, metrics, and indicators and progress changes since the most recent review.

#### **IV.G Preferred and Potential Sites**

Based upon projection of future resource needs and analyses of viable resource options, 39 Preferred Sites and 18 Potential Sites have been identified for adding future generation. Some of these sites currently have existing generation. Preferred Sites are those locations where significant reviews have taken place and action has either been taken, action is committed, or it is likely that action will be taken to site new generation. Potential Sites are those with attributes that would support the siting of generation and are under consideration as a location for future generation. The identification of a Potential Site does not necessarily indicate that a definitive decision has been made to pursue new generation, generation expansion, or modernization, nor does this designation necessarily indicate that the size or technology of a generating resource has been determined. The Preferred Sites and Potential Sites are discussed in separate sections below.

#### **IV.G.1 Preferred Sites**

For the 2025 Ten-Year Site Plan, 39 Preferred Sites have been identified. These include new sites for the development of solar generation facilities, battery storage facilities, and nuclear generation. Sites for numerous solar additions in 2026 and 2027 have been selected, and these sites are described in this section. Potential sites for possible 2028 and beyond solar additions are discussed later in the Potential Site section.

These 39 Preferred Sites are listed in Table IV.G.1 below, and information about each site is presented in the Appendix at the end of this document. The sites are presented in general chronological order of when resources are projected to be added to the FPL system. The topographical features of each site, land use, and facility layout figures are provided in maps that also appear in the Appendix at the end of this document. Note that the first several Preferred Sites listed do not show up in the Appendix section of this document as they are Battery Energy Storage System Centers that are all located at existing solar sites. These sites are also referred to as the 521.5 MW “2025 Gulf Battery” throughout this document.

**Table IV.G.1: List of FPL Preferred Sites**

<b>Site Name</b>	<b>County</b>	<b>Technology</b>
Canoe Battery Energy Storage System Center	Okaloosa	Storage
Blackwater Battery Energy Storage System Center	Santa Rosa	Storage
Chipola River Battery Energy Storage System Center	Calhoun	Storage
Fourmile Creek Battery Energy Storage System Center	Calhoun	Storage
Tenmile Creek Battery Energy Storage System Center	Calhoun	Storage
Shirer Branch Battery Energy Storage System Center	Calhoun	Storage
Kayak Battery Energy Storage System Center	Okaloosa	Storage
Flatford Solar Energy Center	Manatee	Solar
Mare Branch Solar Energy Center	DeSoto	Solar
Price Creek Solar Energy Center	Columbia	Solar
Swamp Cabbage Solar Energy Center	Hendry	Solar
Big Brook Solar Energy Center	Calhoun	Solar
Mallard Solar Energy Center	Brevard	Solar
Boardwalk Solar Energy Center	Collier	Solar
Goldenrod Solar Energy Center	Collier	Solar
North Orange Solar Energy Center	St. Lucie	Solar
Sea Grape Solar Energy Center	St. Lucie	Solar
Clover Solar Energy Center	St. Lucie	Solar
Sand Pine Solar Energy Center	Calhoun	Solar
Hendry Solar Energy Center	Hendry	Solar
Tangelo Solar Energy Center	Okeechobee	Solar
Wood Stork Solar Energy Center	St. Lucie	Solar
Indrio Solar Energy Center	St. Lucie	Solar
Middle Lake Solar Energy Center	Madison	Solar
Ambersweet Solar Energy Center	Indian River	Solar
County Line Solar Energy Center	Charlotte, DeSoto	Solar
Saddle Solar Energy Center	DeSoto	Solar
Cocoplum Solar Energy Center	Hendry	Solar
Catfish Solar Energy Center	Okeechobee	Solar
Hardwood Hammock Solar Energy Center	Walton	Solar
Maple Trail Solar Energy Center	Baker	Solar
Pinecone Solar Energy Center	Calhoun	Solar
Joshua Creek Solar Energy Center	DeSoto	Solar
Spanish Moss Solar Energy Center	St. Lucie	Solar
Vernia Solar Energy Center	Indian River	Solar
LaBelle Solar Energy Center	Hendry	Solar
Lansing Smith Battery Energy Storage System Center	Bay	Storage
Putnam Battery Energy Storage System Center	Putnam	Storage
Turkey Point 6 & 7	Miami-Dade	Nuclear

#### **IV.G.2 Potential Sites**

There are 18 Potential Sites currently identified for future generation and storage additions to meet projected capacity and energy needs. Each of these Potential Sites offers a range of considerations relative to engineering and/or costs associated with the construction and operation of feasible technologies. In addition, each Potential Site has distinctive characteristics that would require further definition and attention. Unless otherwise noted, the water quantities discussed below are in reference to universal solar PV generation rather than for gas-fueled generation.

Permits are considered obtainable for each site. No significant environmental constraints are currently known for any of these sites. FPL considers each site equally viable. These Potential Sites are listed in Table IV.G.2 below and are briefly discussed in the Appendix at the end of this document.

**Table IV.G.2: List of FPL Potential Sites**

<b>Name</b>	<b>County</b>	<b>Technology</b>
Waveland Solar Energy Center	St. Lucie	Solar
Inlet Solar Energy Center	Indian River	Solar
Wabasso Solar Energy Center	Indian River	Solar
Shores Solar Energy Center	Indian River	Solar
Beachland Solar Energy Center	Indian River	Solar
Treefrog Solar Energy Center	Collier	Solar
Honeybee Solar Energy Center	Collier	Solar
Bromeliad Solar Energy Center	Collier	Solar
Myakka Solar Energy Center	Manatee	Solar
Sand Gully Solar Energy Center	DeSoto	Solar
Gum Creek Solar Energy Center	Jackson	Solar
Cardinal Solar Energy Center	Indian River	Solar
Pine Lily Solar Energy Center	St. Lucie	Solar
Wild Lime Solar Energy Center	St. Lucie	Solar
Spoonbill Solar Energy Center	Collier	Solar
Shell Creek Solar Energy Center	Charlotte, DeSoto	Solar
Carlton Solar Energy Center	St. Lucie	Solar
Owen Branch Solar Energy Center	Manatee	Solar

***(This page is intentionally left blank.)***



## CHAPTER V

---

### Other Planning Assumptions & Information

***(This page is left intentionally blank.)***

## Introduction

The FPSC, in Docket No. 960111-EU, specified certain information to be included in an electric utility's Ten-Year Power Plant Site Plan filing. This specified information includes 12 items listed under a heading entitled "Other Planning Assumptions and Information." These 12 items concern specific aspects of a utility's resource planning work. The FPSC requested a discussion or a description of each of these items.

These 12 items are addressed individually below as separate "Discussion Items".

### **Discussion Item # 1: Describe how any transmission constraints were modeled and explain the impacts on the plan. Discuss any plans for alleviating any transmission constraints.**

---

FPL's resource planning work considers two types of transmission limitations/constraints: external limitations and internal limitations. External limitations involve FPL's ties to its neighboring electric systems. Internal limitations involve the flow of electricity within the FPL system.

The external limitations are important because they affect the development of assumptions for the amount of external assistance that is available to the FPL area, as well as the amount and price of economy energy purchases. Therefore, these external limitations are incorporated both in the reliability analysis and economic analysis aspects of resource planning. The amount of external assistance that is assumed to be available is based on the projected transfer capability to the FPL area from outside entities as well as historical levels of available assistance. In the LOLP portion of its reliability analyses, FPL's resource planning group models the amount of external assistance as an additional generator(s) within the system that provides capacity in all but the peak load months. The assumed amount and price of economy energy are based on historical values and projections from production costing models.

Internal transmission limitations are addressed in economic analyses by identifying potential geographic locations for potential new generating units that minimize adverse impacts to the flow of electricity within the system. The internal transmission limitations are also addressed by: 1) developing the direct costs for siting potential new units at different locations, 2) evaluating the cost impacts created by the new unit/unit location combination on the operation of existing generating units in the system, and/or 3) evaluating the costs of transmission and/or generation additions that may be needed to address regional concerns regarding an imbalance between load and generation in a given region. Costs for these site, region, and system factors are developed for use in economic analyses. These factors are also considered in both system and regional reliability analyses. When analyzing DSM portfolios, such as for a DSM Goals docket, the potential to avoid or defer regional transmission additions that might otherwise be needed is typically

analyzed. In addition, transfer limits for capacity and energy that can be imported into the Southeastern Florida region of FPL's area (Miami-Dade and Broward Counties) or transferred between FPL and FPL NWFL service areas are also developed, as applicable, for use in reliability analyses and production costing analyses.

Annual transmission planning work determines transmission additions needed to address limitations and maintain/enhance system and regional reliability. Planned transmission facilities to interconnect and integrate generating units in the resource plan, including those transmission facilities that must be certified under the Transmission Line Siting Act, are presented in Chapter III.

**Discussion Item # 2: Discuss the extent to which the overall economics of the plan were analyzed. Discuss how the plan is determined to be cost-effective. Discuss any changes in the generation expansion plan as a result of sensitivity tests to the base case load forecast.**

---

FPL's resource planning group typically performs economic analyses of competing resource plans using levelized system average electric rates (*i.e.*, a Rate Impact Measure or RIM approach) as an economic criterion. In addition, for analyses in which DSM levels are not changed and only supply options are analyzed, the equivalent criterion of the cumulative present value of revenue requirements (CPVRR) may also be used.<sup>7</sup> This type of evaluation was used in developing the resource plan for the 2025 Site Plan.

**Discussion Item # 3: Explain and discuss the assumptions used to derive the base case fuel forecast. Explain the extent to which the utility tested the sensitivity of the base case plan to high and low fuel price scenarios. If high and low fuel price sensitivities were performed, explain the changes made to the base case fuel price forecast to generate the sensitivities. If high and low fuel price scenarios were performed as part of the planning process, discuss the resulting changes, if any, in the generation expansion plan under the high and low fuel price scenarios. If high and low fuel price sensitivities were not evaluated, describe how the base case plan is tested for sensitivity to varying fuel prices.**

---

---

<sup>7</sup> FPL's basic approach in its resource planning work is to base decisions on a lowest electric rate basis. However, when DSM levels are considered a "given" in the analysis (*i.e.*, when only new generating options are considered), the lowest electric rate basis approach and the lowest system cumulative present value of revenue requirements (CPVRR) basis approach yield identical results in terms of which resource options are more economic. In such cases, resource options can be evaluated on the simpler-to-calculate (but equivalent) lowest CPVRR basis.

The basic assumptions used to derive fuel price forecasts are discussed in Chapter III of this document. FPL's resource planning group may use a single fuel cost forecast, or multiple fuel cost forecasts (Low, Medium, and High), in its analyses as appropriate.

In cases where multiple fuel cost forecasts are used, a Medium fuel cost forecast is developed first. Then the approach has been to adjust the Medium fuel cost forecast upward (for the High fuel cost forecast) or downward (for the Low fuel cost forecast) by multiplying the annual cost values from the Medium fuel cost forecast by a factor of  $(1 + \text{the historical volatility of the 12-month forward price, one year ahead})$  for the High fuel cost forecast, or by a factor of  $(1 - \text{the historical volatility of the 12-month forward price, one year ahead})$  for the Low fuel cost forecast.

The resource plan presented in this Site Plan is based on an updated fuel cost forecast developed in September 2024.

**Discussion Item # 4: Describe how the sensitivity of the plan was tested with respect to holding the differential between oil/gas and coal constant over the planning horizon.**

---

In its 2024 and early 2025 resource planning work, a forecast scenario in which the differential between oil/gas and coal was held constant was not utilized. This is, in part, because FPL is currently using small amounts of oil as a fuel and is projecting to use very little coal as a fuel during the ten-year period. These trends are shown on Schedules 5, 6.1, and 6.2 in Chapter III.

**Discussion Item # 5: Describe how generating unit performance was modeled in the planning process.**

---

The performance of existing generating units is modeled using current projections for scheduled outages, unplanned outages, capacity output ratings, and heat rate information. Schedule 1 in Chapter I and Schedule 8 in Chapter III present the current and projected capacity output ratings of the existing generating units. The values used for outages and heat rates are generally consistent with the values that have been used in planning studies in recent years.

For new unit performance, FPL utilized current projections for the capital costs, fixed and variable operating and maintenance costs, capital replacement costs, construction schedules, heat rates (as appropriate), and capacity ratings for all construction options in its resource planning work. A summary of this information for the new capacity options that FPL currently projects to add over the reporting horizon for this document is presented on the Schedule 9 forms in Chapter III.

**Discussion Item # 6: Describe and discuss the financial assumptions used in the planning process. Discuss how the sensitivity of the plan was tested with respect to varying financial assumptions.**

---

The financial assumptions used in the resource planning analyses that led to the resource plan that is presented in this 2025 Site Plan were: in late 2024, an incremental capital structure of 40.40% debt and 59.60% equity; (ii) a 5.30% cost of debt; (iii) a 10.80% return on equity; and (iv) an after-tax discount rate of 8.04%. In early 2025, these assumptions were changed to: an incremental capital structure of 40.40% debt and 59.60% equity; (ii) a 5.68% cost of debt; (iii) a 10.80% return on equity; and (iv) an after-tax discount rate of 8.15%. No other financial assumptions were used in the 2024 and early 2025 resource planning work.

**Discussion Item # 7: Describe in detail the electric utility's Integrated Resource Planning process. Discuss whether the optimization was based on revenue requirements, rates, or total resource cost.**

---

FPL's IRP process is described in detail in Chapter III of this document.

The standard basis for comparing the economics of competing resource plans in FPL's basic IRP process is the impact of the plans on electricity rate levels, with the objective generally being to minimize the projected levelized system average electric rate (*i.e.*, a Rate Impact Measure or RIM approach). As discussed in response to Discussion Item # 2, both the electricity rate perspective and the CPVRR perspective for the system yield identical results in terms of which resource options are more economical when DSM levels are unchanged between competing resource plans. Therefore, in planning work in which DSM levels were unchanged, FPL's resource planning group utilizes the equivalent, but simpler-to-calculate CPVRR perspective.

**Discussion Item # 8: Define and discuss the electric utility's generation and transmission reliability criteria.**

---

FPL's resource planning group uses three system reliability criteria in its resource planning work that address various resource options including: utility generation, power purchases, and DSM options. One criterion is a minimum 20% Summer and Winter total reserve margin. Another reliability criterion is a maximum of 0.1 days per-year LOLP. The third criterion is a minimum 10% GRM. These three reliability criteria are discussed in Chapter III of this document.

For transmission reliability analysis, transmission planning criteria have been adopted that are consistent with those established by the Florida Reliability Coordinating Council (FRCC) and the Southeastern Electric Reliability Corporation (SERC). The FRCC and SERC have adopted transmission planning criteria that are consistent with the Reliability Standards established by the NERC. The *NERC Reliability Standards* are available on the NERC internet site (<http://www.nerc.com/>).

In addition, *Facility Interconnection Requirements* (FIR) documents for the FPL system have been developed. The document for FPL is available on FPL's Open Access Same-time Information System (OASIS) website, <https://www.oatiaoasis.com/FPL/index.html>, under the "Interconnection Request Information" directory. Furthermore, all new transmission facilities within the FPL service territory that are used to meet FPL load are planned to comply with Extreme Wind Loading Criteria as implemented in FPL Design Guidelines.

FPL's transmission planning group generally limits planned flows on its transmission facilities to no more than 100% of the applicable thermal rating. There may be isolated cases for which it is acceptable to deviate from the general criteria stated below. There are several factors that could influence these criteria, such as the overall number of potential customers that may be impacted, the probability of an outage actually occurring, transmission system performance, and other factors.

The normal and contingency voltage criteria for FPL stations are provided below:

**Normal/Contingency...<sup>8</sup>**

<u>Voltage Level (kV)</u>	<u>Vmin (p.u.)</u>	<u>Vmax (p.u.)</u>
69, 115, 138	0.95/0.95	1.05/1.07
161	0.95/0.95	1.05/1.10
230	0.95/0.95	1.06/1.07
500	0.95/0.95	1.07/1.10
Turkey Point (*)	1.013/1.013	1.06/1.06
St. Lucie (*)	1.00/1.00	1.06/1.06

(\*) Voltage range criteria for FPL's Nuclear Power Plants

<sup>8</sup> Immediately following a contingency, steady-state voltages may deviate from the normal voltage range if there are known automatic or manual operating actions to adjust the voltage to within the contingency voltage range. However, the steady-state voltage must never exceed voltage System Operating Limits (SOLs), which have a lower limit of 0.90pu and a higher limit of 1.10pu for all transmission facilities, excluding nuclear plant switchyards for which the SOLs are equal to the normal/contingency limits.

**Discussion Item # 9: Discuss how the electric utility verifies the durability of energy savings for its DSM programs.**

---

FPL periodically revises the projected impacts of its DSM programs on demand and energy consumption. Engineering models, calibrated with current field-metered data, are updated at regular intervals. Participation trends are tracked for all of FPL's DSM programs in order to adjust impacts each year for changes in the mix of efficiency measures being installed by program participants. For its load management programs, FPL conducts periodic tests of its load management equipment to ensure it is functioning correctly. These tests, plus actual load management events, also allow FPL to gauge the MW reduction capabilities of its load management programs on an ongoing basis.

**Discussion Item # 10: Discuss how strategic concerns are incorporated in the planning process.**

---

The Executive Summary and Chapter III provide a discussion of a variety of system concerns/issues that influence FPL's resource planning process. Please see those chapters for a discussion of those concerns/issues.

In addition to these system concerns/issues, there are other strategic factors that FPL's resource planning group typically considers when choosing among resource options. These include: (1) technology risk; (2) environmental risk; and (3) site feasibility. The consideration of these factors may include both economic and non-economic aspects. Technology risk is an assessment of the relative maturity of competing technologies. For example, a prototype technology that has not achieved general commercial acceptance has a higher risk than a technology in wide use and, therefore, assuming all else is equal, is less desirable.

Environmental risk is an assessment of the relative environmental acceptability of different generating technologies and their associated environmental impacts on the utility system, including projected environmental compliance costs. Technologies regarded as more acceptable from an environmental perspective for a prospective resource plan are those that minimize environmental impacts for the utility system as a whole through highly efficient fuel use, state-of-the-art environmental controls, and generating technologies that do not utilize fossil fuels (such as nuclear and solar).

Site feasibility assesses a wide range of economic, regulatory, and environmental factors related to successfully developing and operating the specified technology at the site in question. Projects that are more acceptable have sites with fewer barriers to successful development.



All of these factors play a part in resource planning and decision-making, including decisions to construct capacity or purchase power.

**Discussion Item # 11: Describe the procurement process the electric utility intends to utilize to acquire the additional supply-side resources identified in the electric utility's ten-year site plan.**

---

As shown in this 2025 Site Plan, the current resource plan reflects the following major supply-side or generation resource additions in FPL's area: CT component upgrades at various existing CCs, addition of new PV facilities, the addition of new battery storage facilities, and potential new CT additions.

CT upgrades are planned to take place at various CC units throughout the FPL area that address Summer and Winter capacity. The original equipment manufacturers (OEM) of the CTs approached FPL regarding the possibility of upgrading these units. Following negotiations with the OEMs and economic analyses that showed upgrading was cost-effective for customers, FPL decided to proceed with the CT upgrades and the supporting balance of plant modifications.

For new solar, battery and gas generation facilities for FPL, the selection of equipment and installation contractors has been, and will continue to be, done via competitive bidding. FPL's Engineering & Construction (E&C) group seek bids from multiple suppliers for major components such as PV panels, inverters, batteries, combustion turbine generators (CT) and step-up transformers. Where possible, volume is leveraged to achieve economies of scale and options are evaluated based on total cost of ownership. Remaining balance-of-system (BOS) material purchases, as well as engineering and construction services, are typically competitively bid out as well to determine the best value.

**Discussion Item # 12: Provide the transmission construction and upgrade plans for electric utility system lines that must be certified under the Transmission Line Siting Act (403.52 – 403.536, F. S.) during the planning horizon. Also, provide the rationale for any new or upgraded line.**

---

FPL has identified the need for one new transmission line that require certification under the Transmission Line Siting Act (as shown on Table III.E.1 in Chapter III).

The 230 kV line will connect FPL's Whidden Substation to a new Sweatt 230 kV Substation. A determination of need for the line was filed with the FPSC in April 2022, and a final order certifying the corridor for the project was issued in September 2022. The project is scheduled to be completed by June 2026. The construction of this line and substation is necessary to serve existing and future FPL customers

in the west Florida area in and around Okeechobee, Highlands, Desoto, Collier, Lee, Sarasota, and Manatee Counties in a reliable and effective manner.

***(This page is left intentionally blank.)***

## **Appendix**

---

### **Preferred and Potential Solar Site Descriptions and Maps**

**Appendix A**

***Site Descriptions, Environmental, and Land Use Information:  
Supplemental Information***

***Relationship of Regional Hydrogeologic Units  
to Major Stratigraphic Units  
and  
Florida Regions***

**Figure A.A.1: Relationship of Regional Hydrogeologic Units to Major Stratigraphic Units**

Relationship of Regional Hydrogeologic Units to Major Stratigraphic Units

		Panhandle Florida		North Florida		South Florida	
System	Series	Stratigraphic Unit	Hydrogeologic Unit	Stratigraphic Unit	Hydrogeologic Unit	Stratigraphic Unit	Hydrogeologic Unit
Quaternary	Holocene	Undifferentiated terrace marine and fluvial deposits	Surficial aquifer system (Sand and Gravel aquifer)	Undifferentiated terrace marine and fluvial deposits	Surficial aquifer system	Terrace Deposits Miami Limestone Key Largo Limestone Anastasia Formation Fort Thompson Formation Caloosahatchee Marl	Surficial aquifer system (Biscayne aquifer)
	Pleistocene						
Tertiary	Pliocene	Citronelle Formation Undifferentiated coarse sand and gravel	Intermediate confining unit	Micosukee Formation Alachua Formation	Intermediate aquifer system or intermediate confining unit	Tamiami Formation	Intermediate aquifer system or intermediate confining unit
	Miocene	Alum Bluff Group Pensacola Clay Intracoastal Formation Hawthorn Group Chipola Formation Bruce Creek Limestone St. Marks Formation Chattahoochee Formation		Hawthorn Group St. Marks Formation		Hawthorn Group	
	Oligocene	Chickasawhay Limestone Suwannee Limestone Marianna Limestone Bucaturra Clay		Suwannee Limestone		Suwannee Limestone	
	Eocene	Ocala Limestone Lisbon Formation Tallahatta Formation Undifferentiated older Rocks	Sub-Floridan confining unit	Ocala Limestone Avon Park Formation Oldsmar Formation	Floridan aquifer system	Ocala Limestone Avon Park Formation Oldsmar Formation	Floridan aquifer system
	Paleocene	Undifferentiated		Cedar Keys Formation		Cedar Keys Formation	
		Undifferentiated		Undifferentiated	Sub-Floridan confining unit		
Cretaceous and older							

Note: This information is referred to in subsection k, Geological Features of Site and Adjacent Areas, for each of the Preferred Sites.

Figure A.A.2: Florida Regions Map



Note: This information is referred to in subsection k, Geological Features of Site and Adjacent Areas, for each of the Preferred Sites

## **Appendix B Preferred Sites**


Below are the descriptions regarding each of the 32 Preferred Sites listed in Table IV.G.1. Following the descriptions are maps showing the topographical features, land use, and facility layout of each site.




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #1: Flatford Solar Energy Center, Manatee County***

Preferred Site		Flatford Solar Energy Center
County	Manatee	
Facility Acreage	925	
COD	1/31/2026	
For PV facilities: tracking or fixed	Tracking	
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
e.	Existing Land Uses	
Site	Citrus groves and other crop land	
Adjacent Areas	Pasture and other crop lands	
f.	General Environment Features On and in the Site Vicinity	
1. Natural Environment	Site is agricultural in nature.	
2. Listed Species	Gopher tortoise and Florida sandhill crane	
3. Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.	
4. Other Significant Features	FPL is not aware of any other significant features of the site.	
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
90. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).	
j. Water Resources	Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.	
k. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.	
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
o. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
s. Status of Applications	FDEP ERP Issued: 12/27/2023 USACE Standard Permit Issued: 01/28/2025	

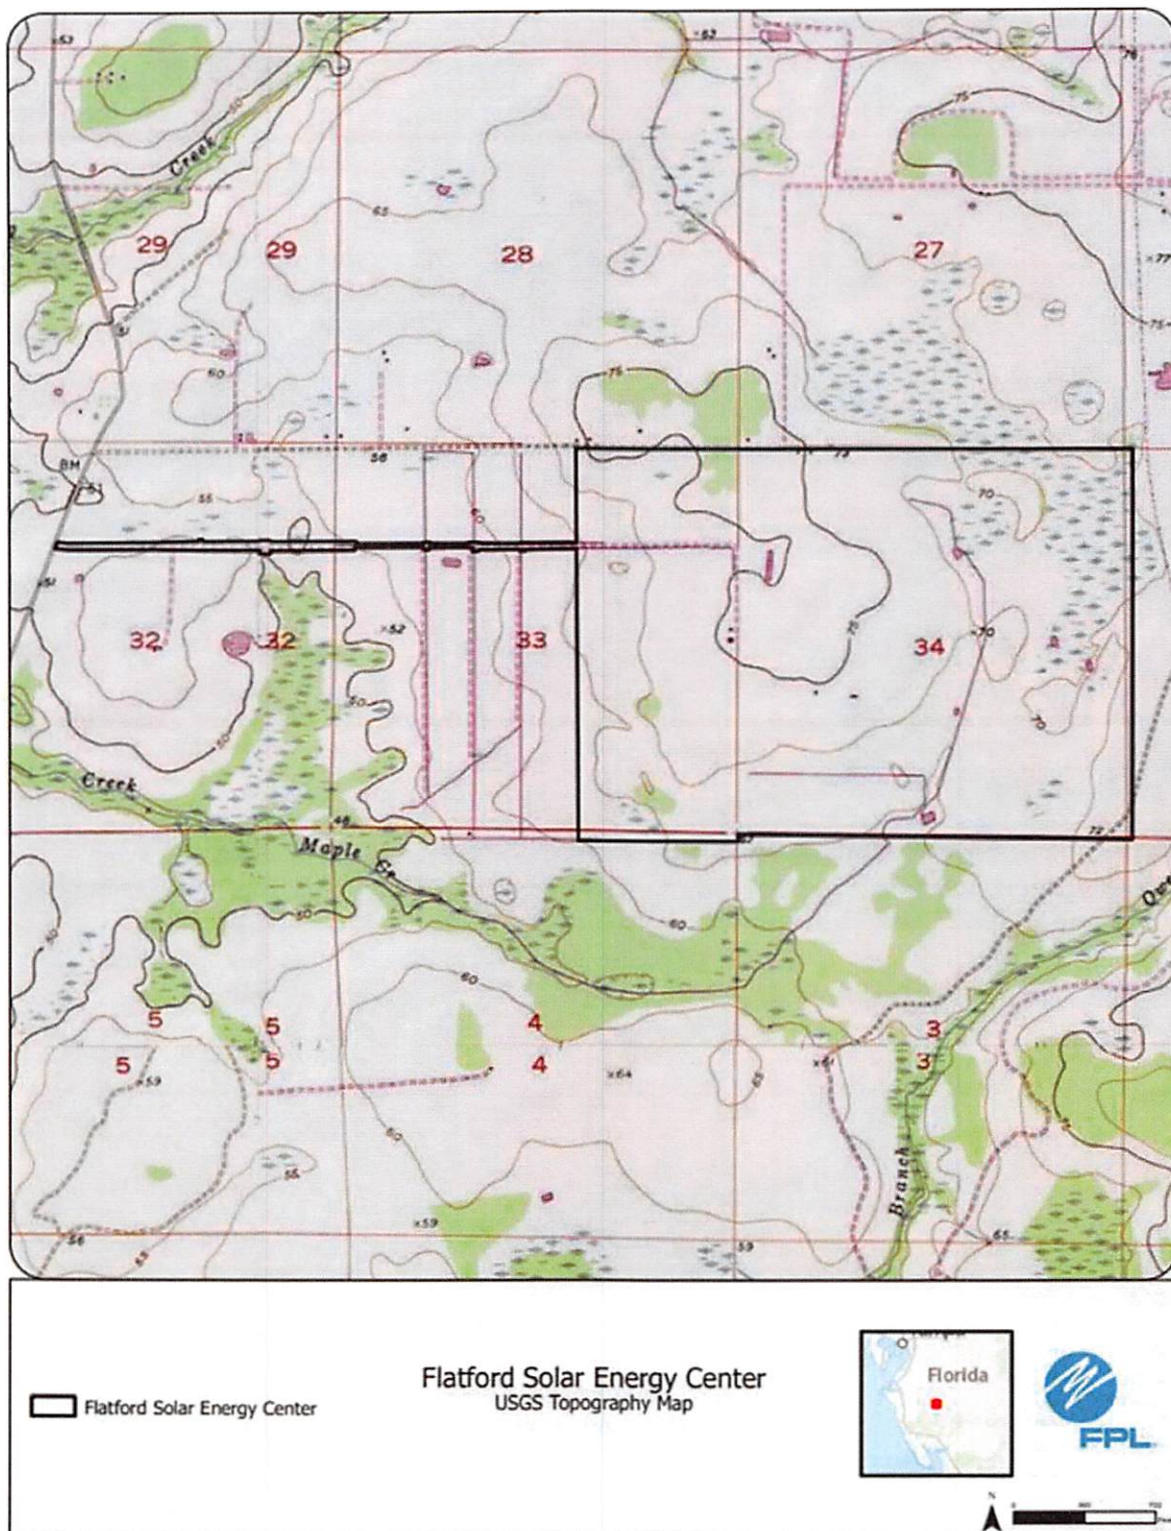



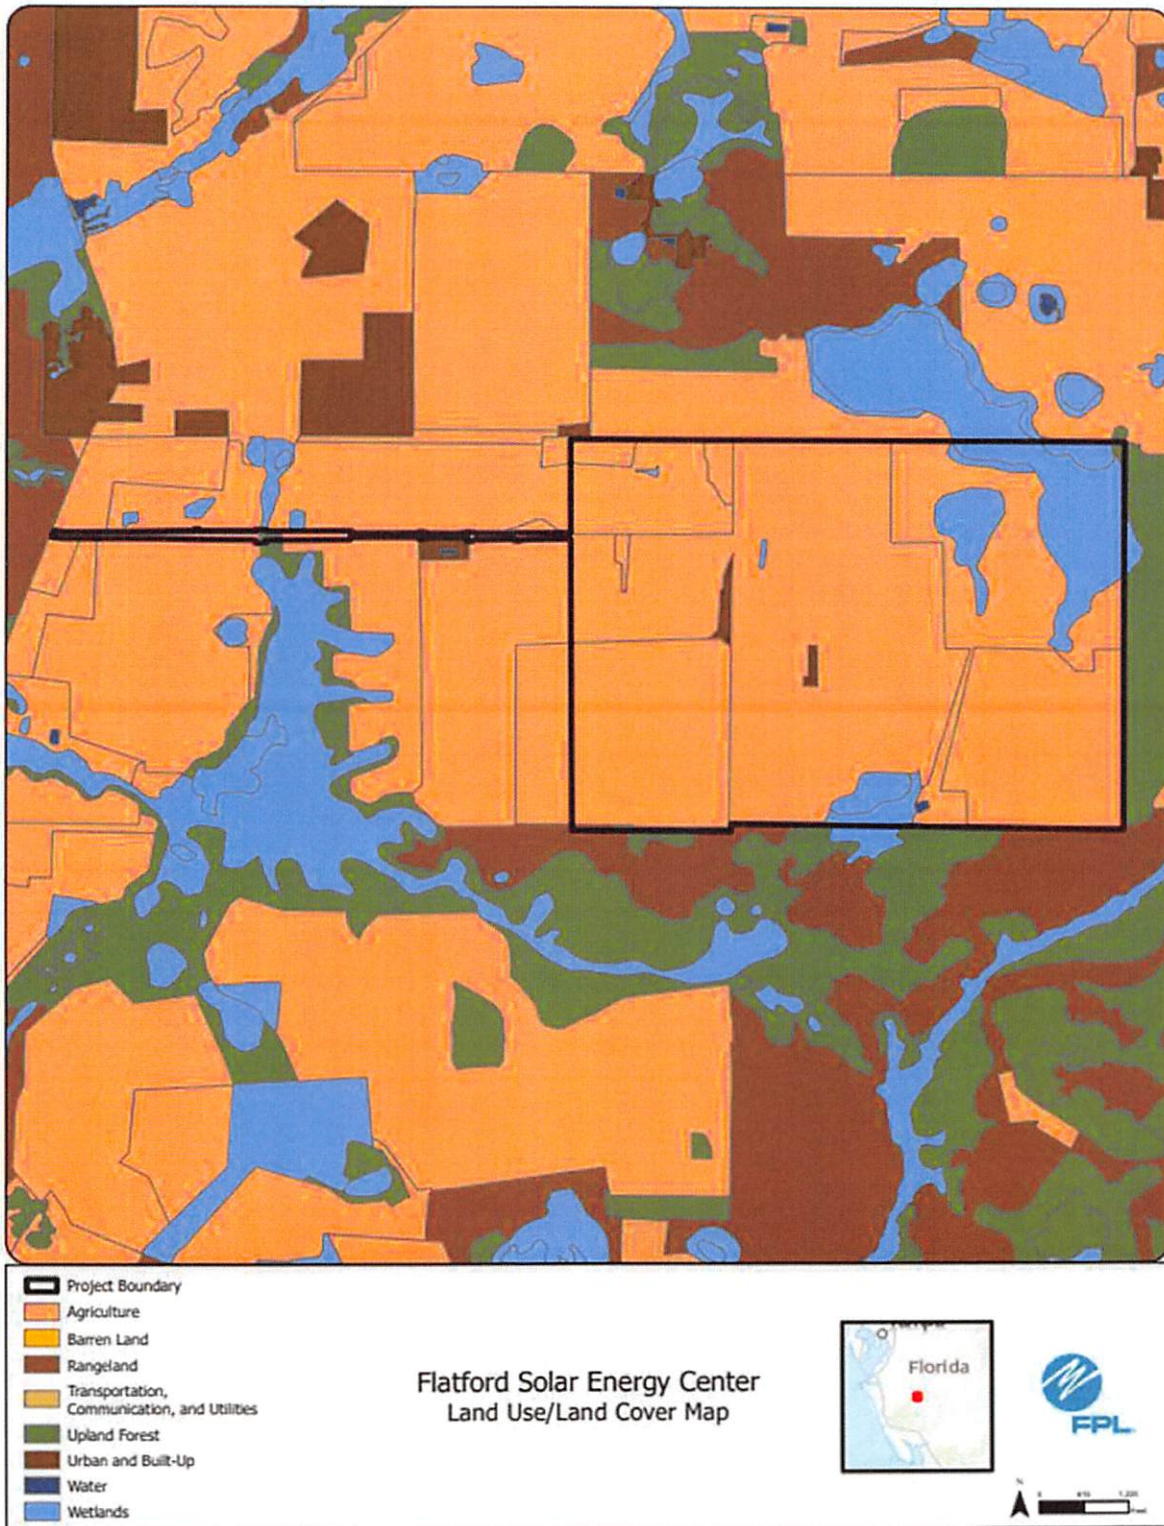





 Flatford Solar Energy Center

# Flatford Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***


***Preferred Site #2: Mare Branch Solar Energy Center, DeSoto County***

	Preferred Site	Mare Branch Solar Energy Center
	County	DeSoto
	Facility Acreage	669
	COD	1/31/2026
	For PV facilities: tracking or fixed	Tracking
	Reference Maps	
a.	USGS Map	See Figures in the following pages
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
e.	Existing Land Uses:	
	Site	Row and field crops
	Adjacent Areas	Solar sites, other row/field crops
f.	General Environment Features On and in the Site Vicinity	
1.	Natural Environment	Site is primarily row and field crops
2.	Listed Species	Gopher tortoise, Audubon's crested caracara, Florida sandhill crane
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	FPL is not aware of any other significant features of the site.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h.	Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.
k.	Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar
		Process: Not Applicable for Solar
m.	Water Supply Sources by Type	Potable: Minimal
		Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
n.	Water Conservation Strategies Under Consideration	Cooling: Not Applicable for Solar
		Process: Not Applicable for Solar
o.	Water Discharges and Pollution Control	Potable and Panel Cleaning: Onsite well or surface water or delivered to site
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
q.	Air Emissions and Control Systems	Solar does not require fuel and no waste products will be generated at the site.
r.	Noise Emissions and Control Systems	Solar does not require fuel and no waste products will be generated at the site.
s.	Status of Applications	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems.
		Combustion Control - Not Applicable
		Combustor Design - Not Applicable
		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
		FDEP ERP Issued: 8/4/2023
		FDEP 404 GP Issued: 8/4/2023



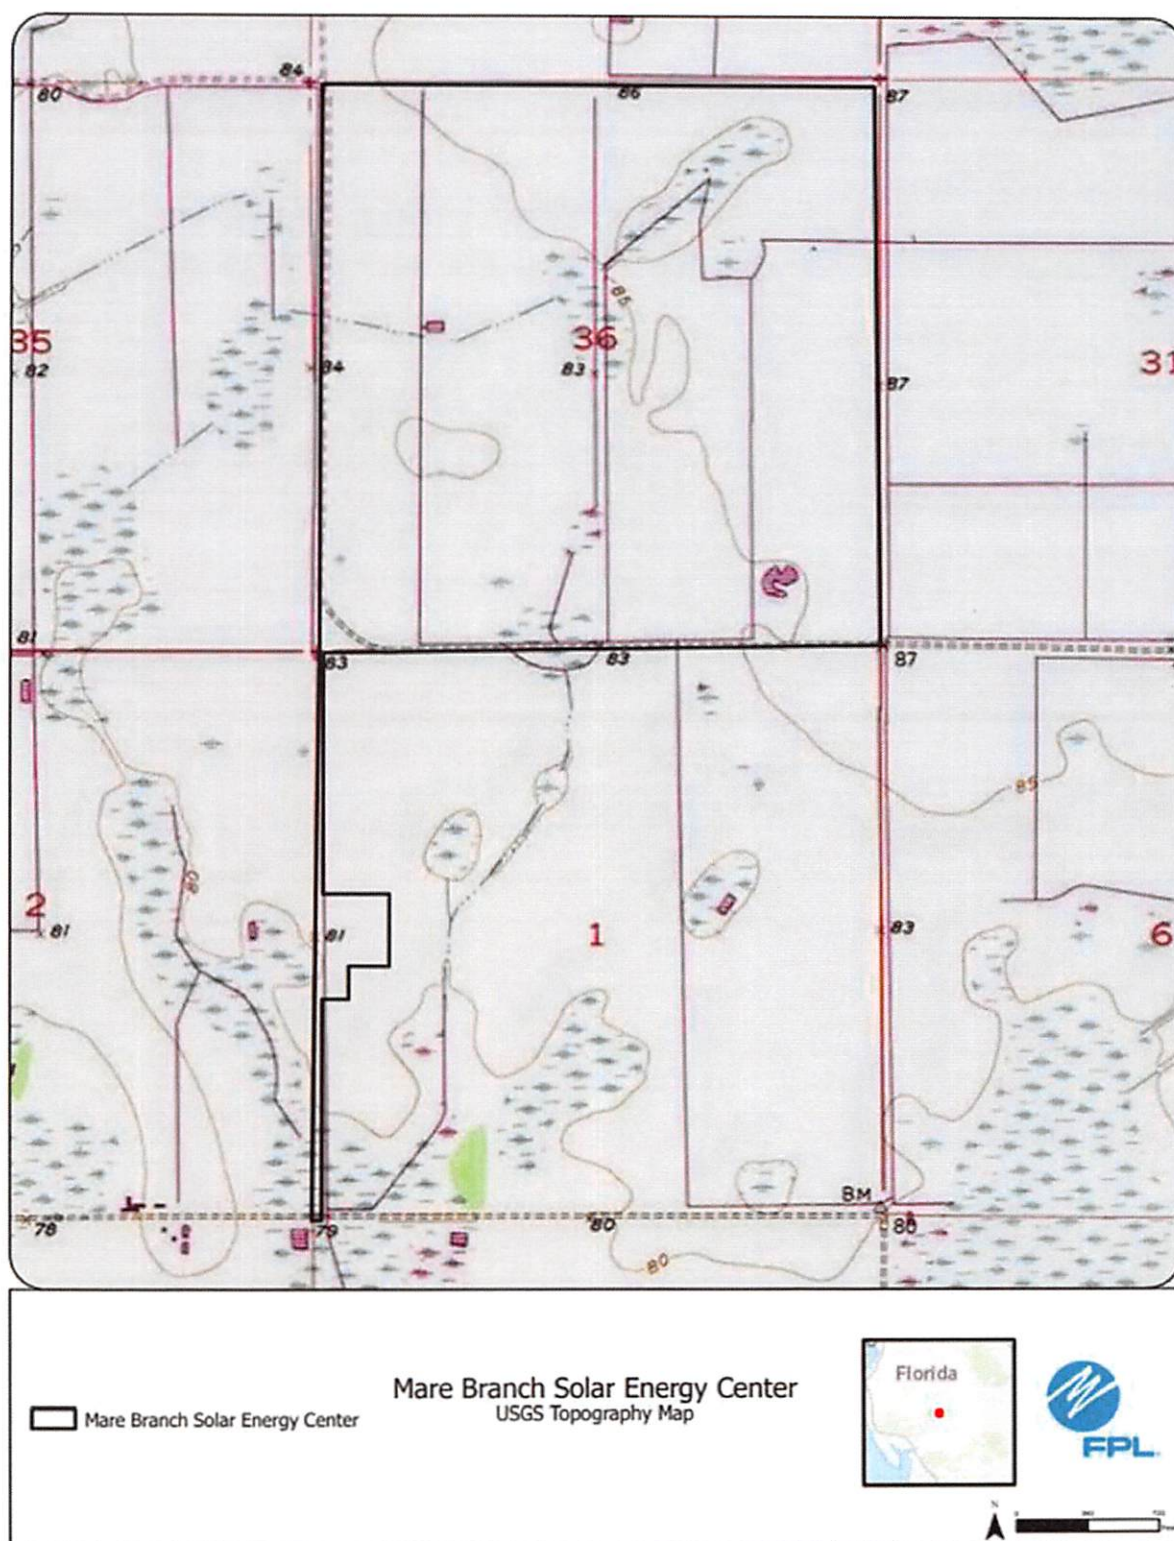



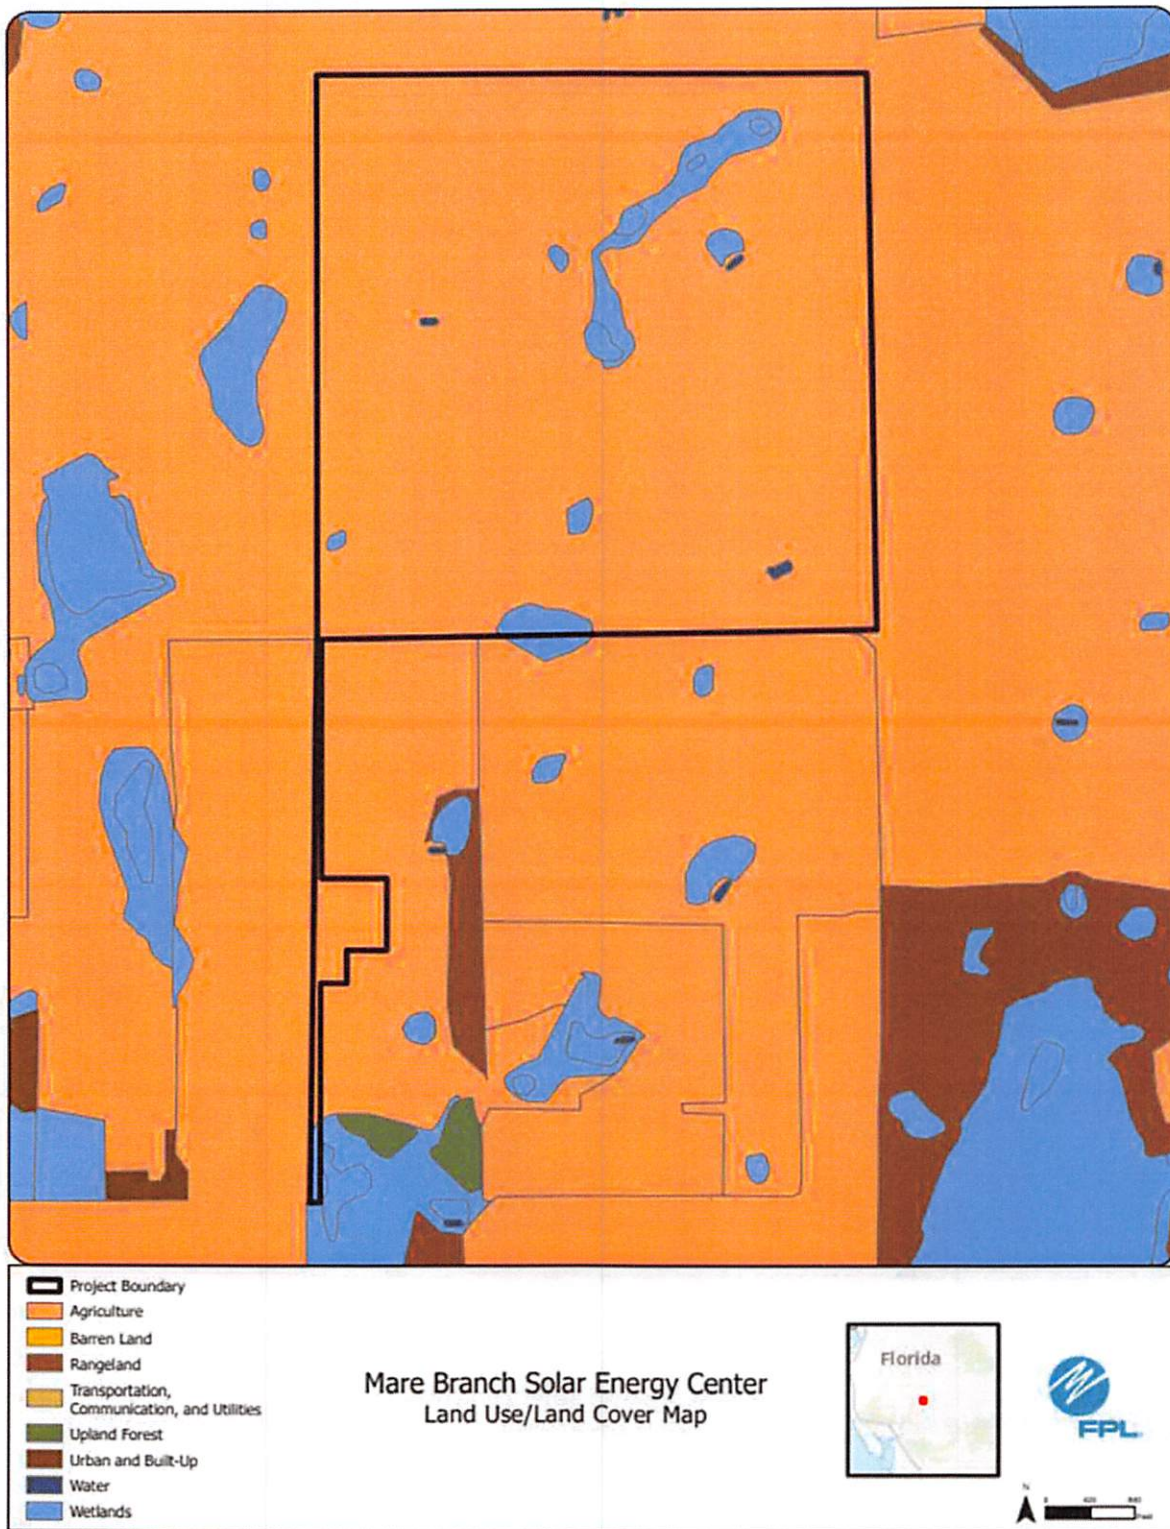





 Mare Branch Solar Energy Center

# Mare Branch Solar Energy Center Facility Layout Map



***Site Description, Environmental, and Land Use Information:  
Supplemental Information***


***Preferred Site #3: Price Creek Solar Energy Center, Columbia County***

County	Columbia	Preferred Site	Price Creek Solar Energy Center
Facility Acreage	792		
COD	1/31/2026		
For PV facilities: tracking or fixed	Tracking		
			Reference Maps
a. USGS Map	See Figures in the following pages		
b. Proposed Facilities Layout			
c. Map of Site and Adjacent Areas			
d. Land Use Map of site and Adjacent Areas			
e. Site			Existing Land Uses
			Primarily conifer plantation and forest regeneration areas
f. Adjacent Areas			Pine trees and wetlands
			General Environment Features On and in the Site Vicinity
1. Natural Environment			Site is primarily tree plantation and forest regeneration areas
2. Listed Species			None observed
3. Natural Resources of Regional Significance Status			No natural resources of regional significance status at or adjacent to the site.
4. Other Significant Features			FPL Duval-Raven 230kV Transmission line along N boundary, Lake Butler-Price 115kV transmission line from NW to SE across property, Georgia Southern and Florida Railroad defines SW boundary, Community of Lulu 1.75 S of property.
g. Design Features and Mitigation Options			The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations			Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors			The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources			Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.
k. Geological Features of Site and Adjacent Areas			See Figures in the following pages. Site is located in the Panhandle region.
l. Project Water Quantities for Various Uses			Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type			Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration			Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control			Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control			Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems			Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustion Design - Not Applicable
r. Noise Emissions and Control Systems			PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications			FDCEP ERP issued: 10/30/2023 FDCEP 404 GP issued: 10/30/2023







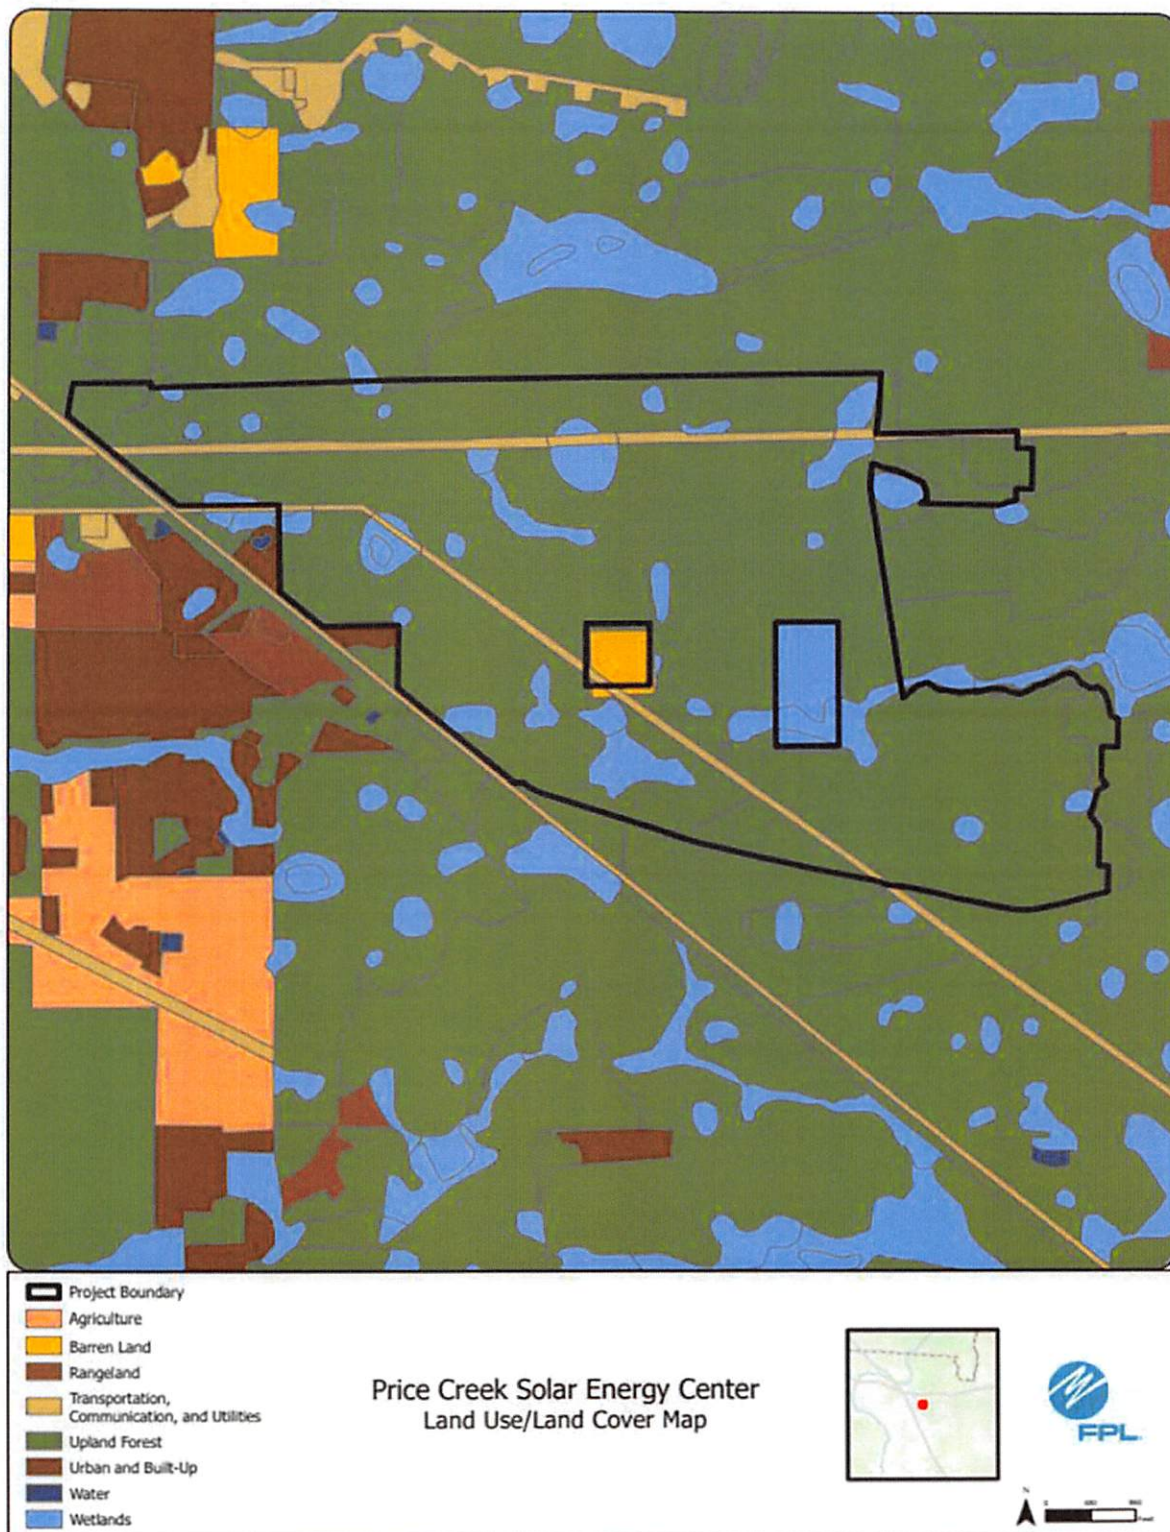





 Price Creek Solar Energy Center

# Price Creek Solar Energy Center Facility Layout Map





***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #4: Swamp Cabbage Solar Energy Center, Hendry  
County***



Preferred Site		Swamp Cabbage Solar Energy Center
County		Hendry
Facility Acreage		725
COD		1/31/2026
For PV facilities: tracking or fixed		Tracking
		Reference Maps
a. USGS Map		See Figures in the following pages
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
		Existing Land Uses
e. Site		Active citrus and pasture from previous citrus
f. Adjacent Areas		Agricultural and low density residential
		General Environment Features On and in the Site Vicinity
1. Natural Environment		Site is primarily active citrus with pasture land from previous citrus areas
2. Listed Species		Audubon's crested caracara, southeastern American kestrel, little blue heron, gopher tortoise
3. Natural Resources of Regional Significance Status		No natural resources of regional significance status at or adjacent to the site.
4. Other Significant Features		FPL is not aware of any other significant features of the site.
g. Design Features and Mitigation Options		The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the South region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustion Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP issued: 8/21/2023 FDEP 404 GP issued: 8/21/2023

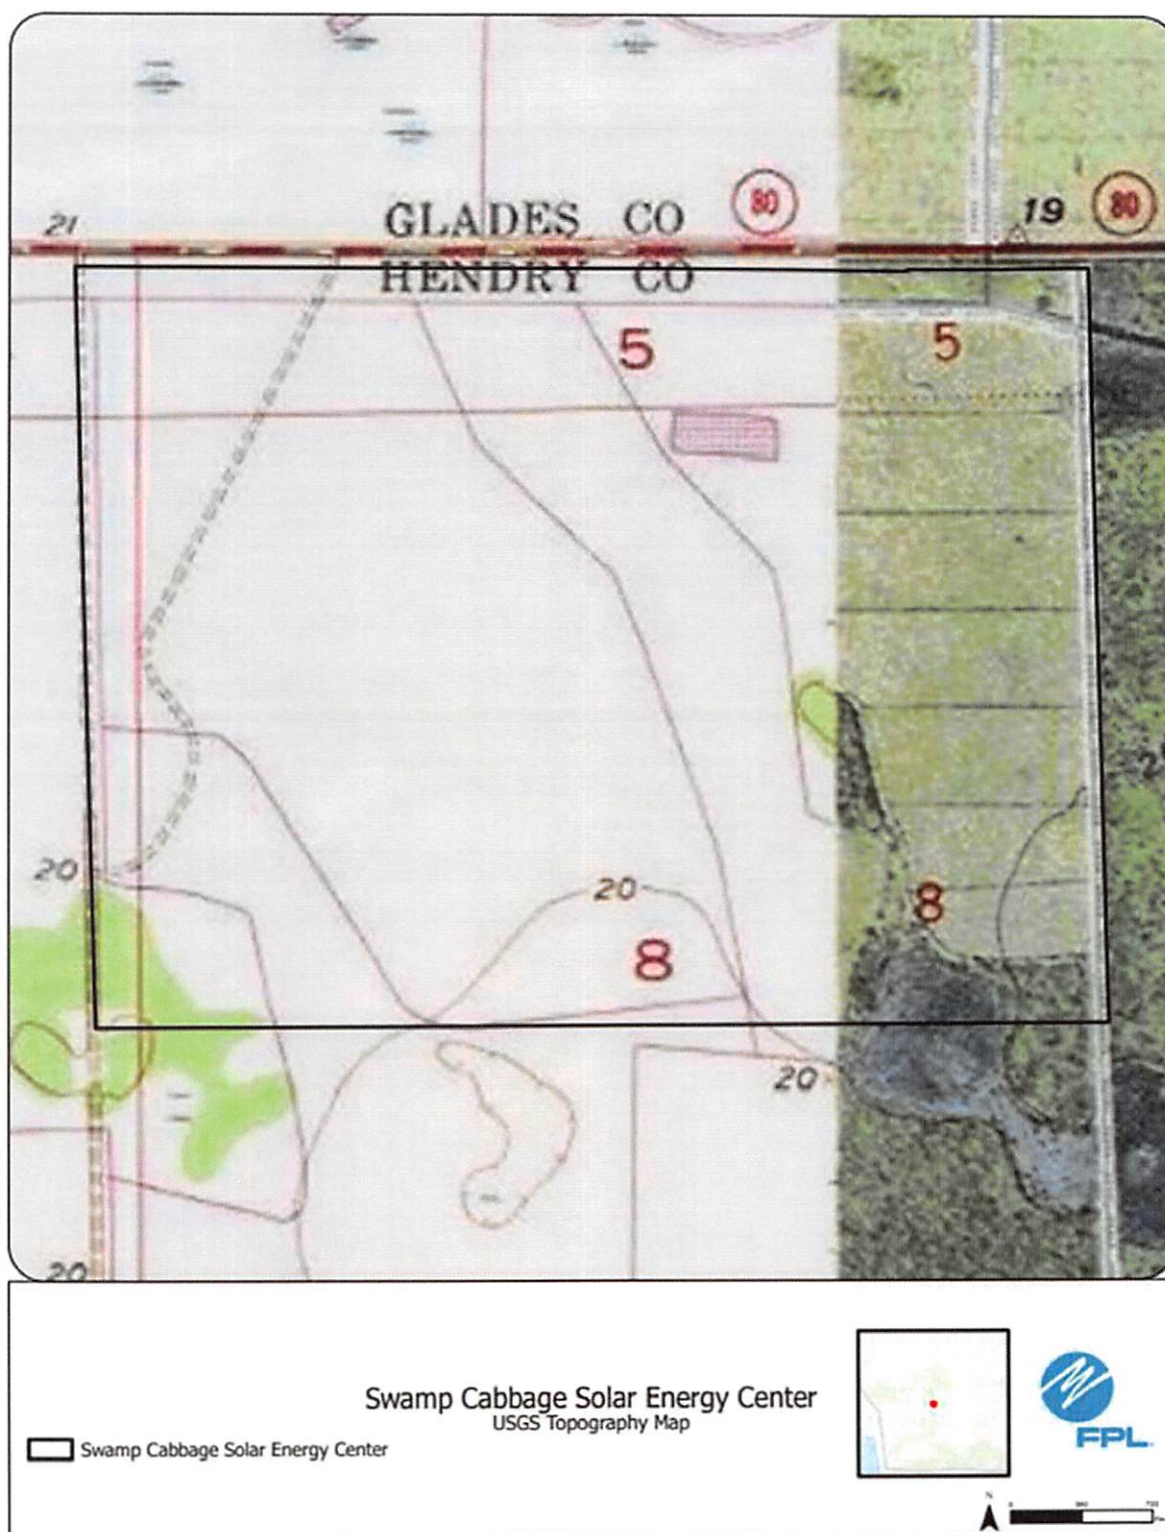

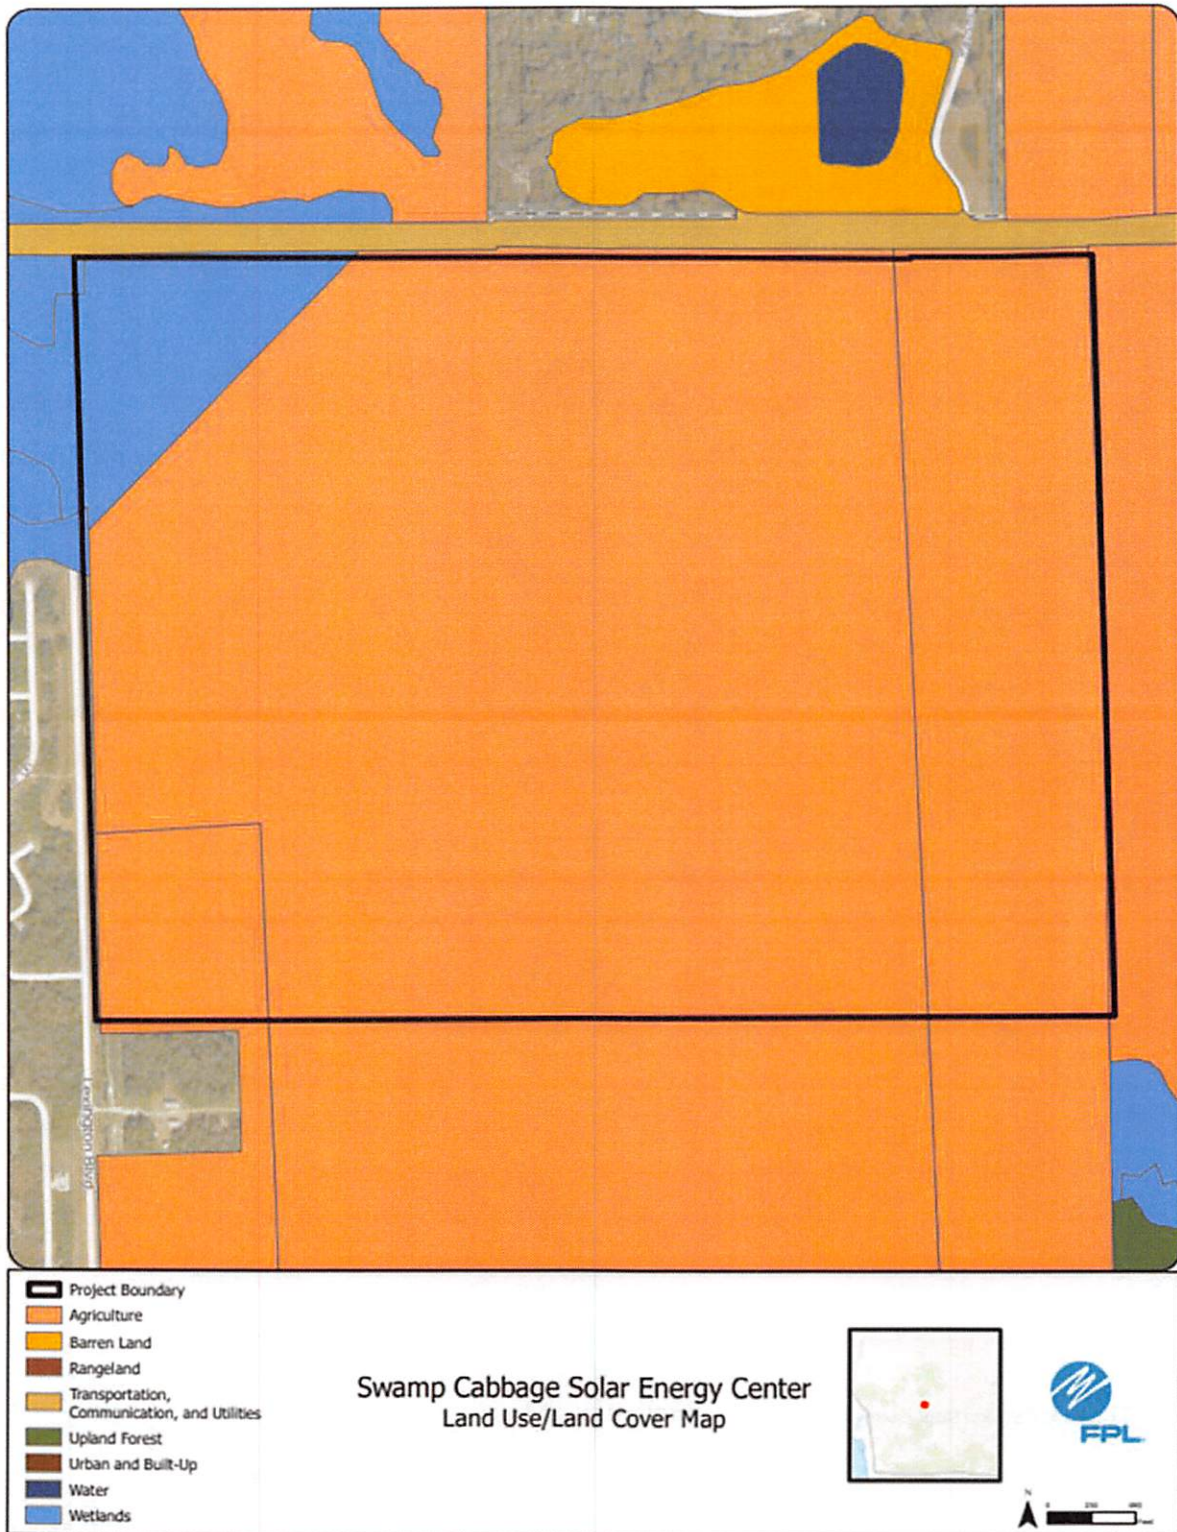





Swamp Cabbage Solar Energy Center

### Swamp Cabbage Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #5: Big Brook Solar Energy Center, Calhoun County***

Preferred Site		Big Brook Solar Energy Center
County	Cathoun	
Facility Acreage	848	
COB	1/31/2026	
For PV facilities: tracking or fixed	Tracking	
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
e. Site	Silviculture operation / deer hunting	
Adjacent Areas	Silvicultural and residential	
General Environment Features on and in the Site Vicinity		
1. Natural Environment	Site is silviculture	
2. Listed Species	Gopher tortoise, eastern indigo snake	
3. Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.	
4. Other Significant Features	FPL is not aware of any other significant features of the site.	
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
i. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.)	
j. Water Resources	Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.	
k. Geological Features of Site and Adjacent Areas	See Figures in the following pages. Site is located in the Panhandle region.	
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
o. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
s. Status of Applications	FDEP ERP Issued: 3/25/2024	



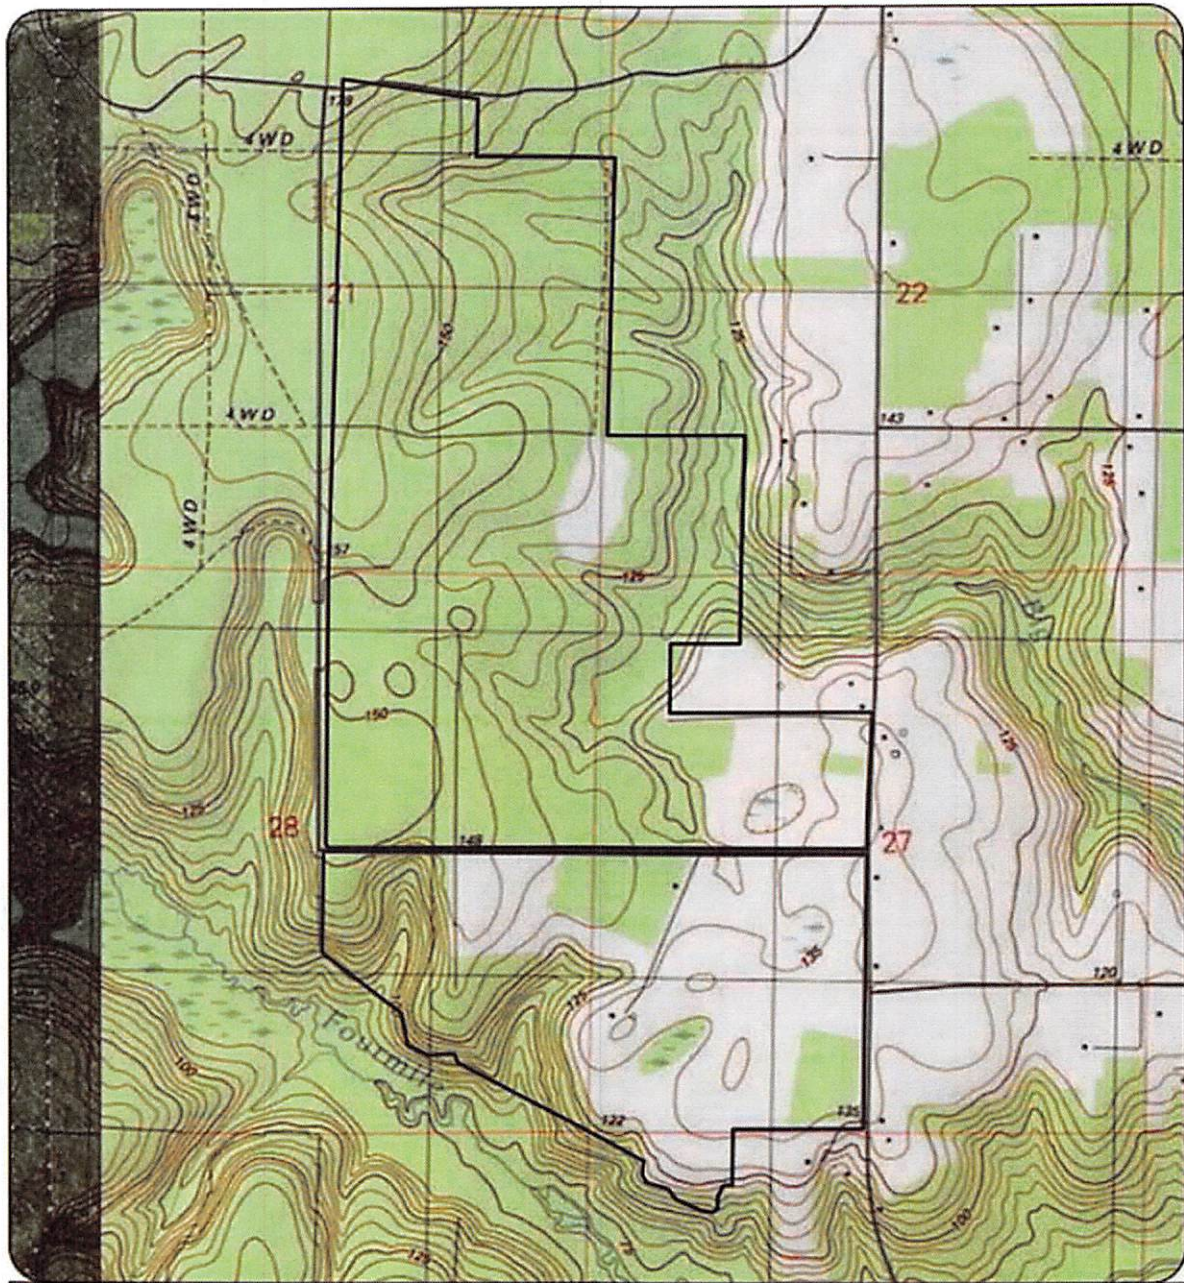


Big Brook Solar Energy Center

Big Brook Solar Energy Center  
USGS Topography Map





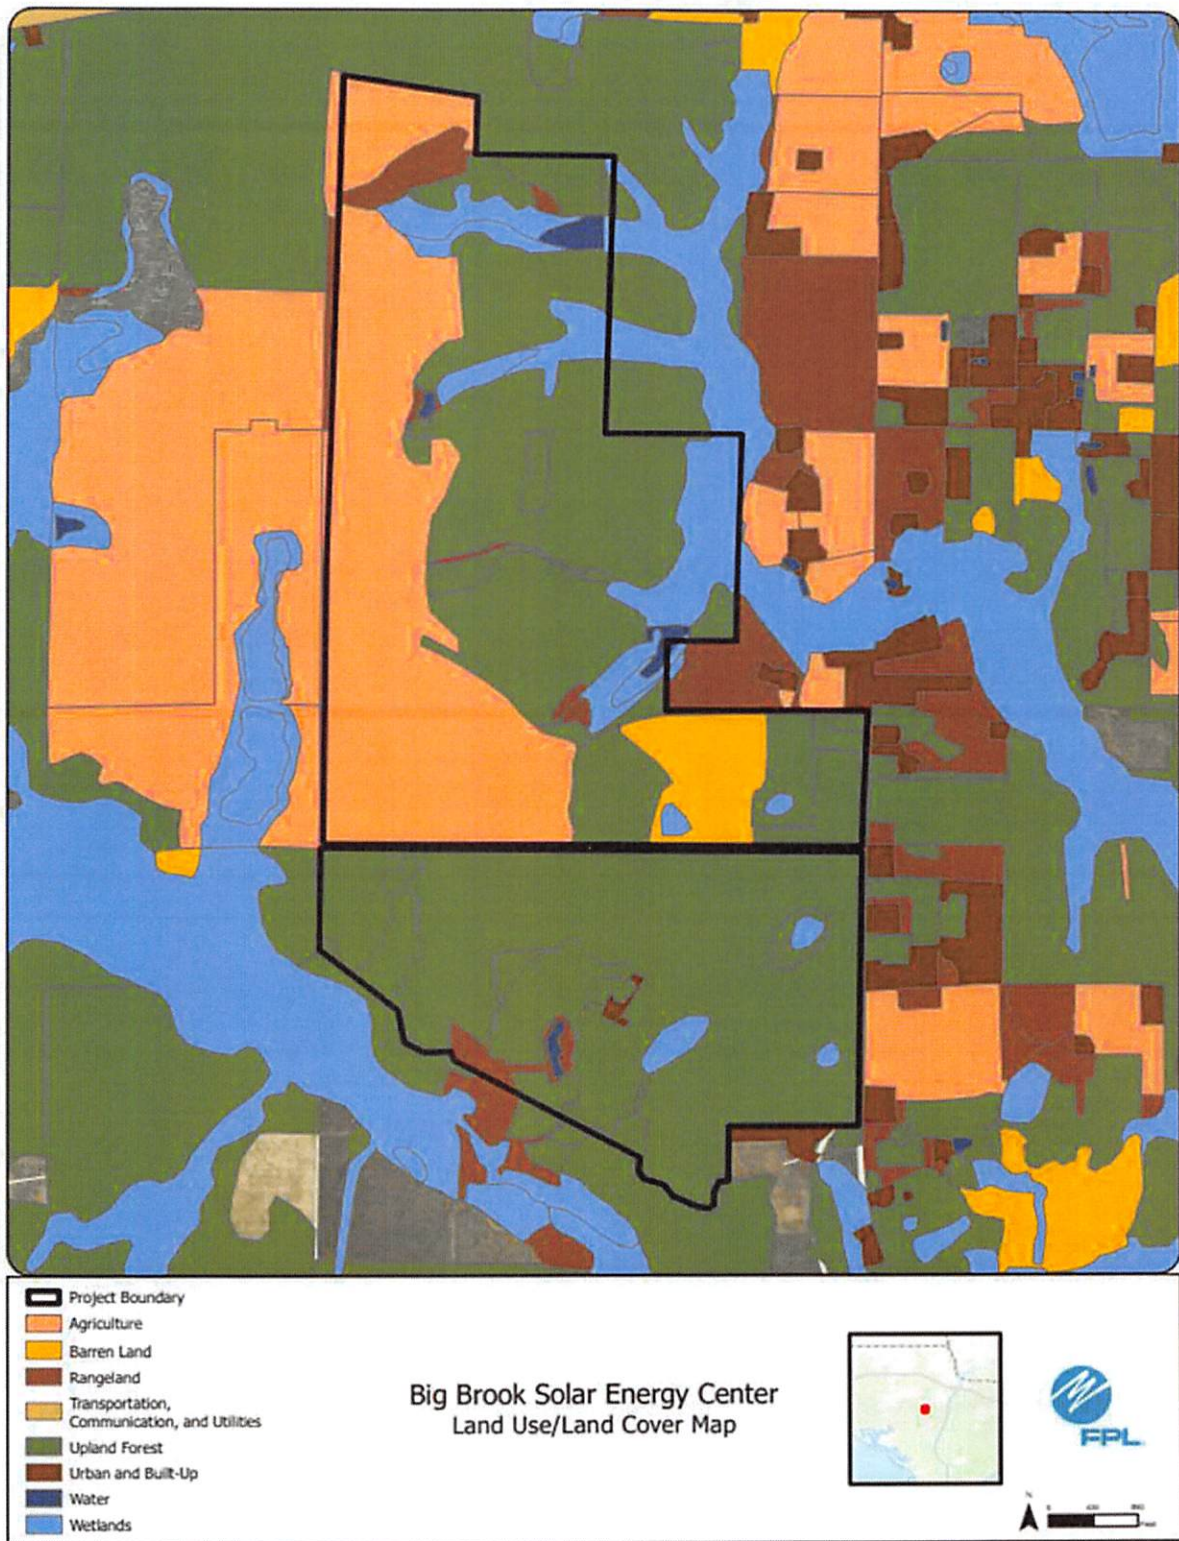





Big Brook Solar Energy Center

# Big Brook Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #6: Mallard Solar Energy Center, Brevard County***

	Preferred Site	Malard Solar Energy Center	County	Brevard	456	CDD	1/31/2026	Tracking	Reference Maps:	
a.	USGS Map	See Figures in the following pages								
b.	Proposed Facilities Layout									
c.	Map of site and adjacent Areas									
d.	Land Use Map of site and adjacent Areas									
e.	Existing Land Uses									
f.	Adjacent Areas	Various agriculture								
g.	General Environment	General Environment Features On and in the Site Vicinity								
1.	Natural Environment	Agriculture								
2.	Listed Species	No adverse impacts to listed species are anticipated								
3.	Natural Resources of Regional Significance Status	None								
4.	Other Significant Features	FPL is not aware of any other significant features of the site.								
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.								
h.	Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.								
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).								
j.	Water Resources	Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/VUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.								
k.	Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.								
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall								
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site								
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.								
o.	Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.								
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.								
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustion Design - Not Applicable								
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.								
s.	Status of Applications	FDEP BRP Issued: 1/24/2024								





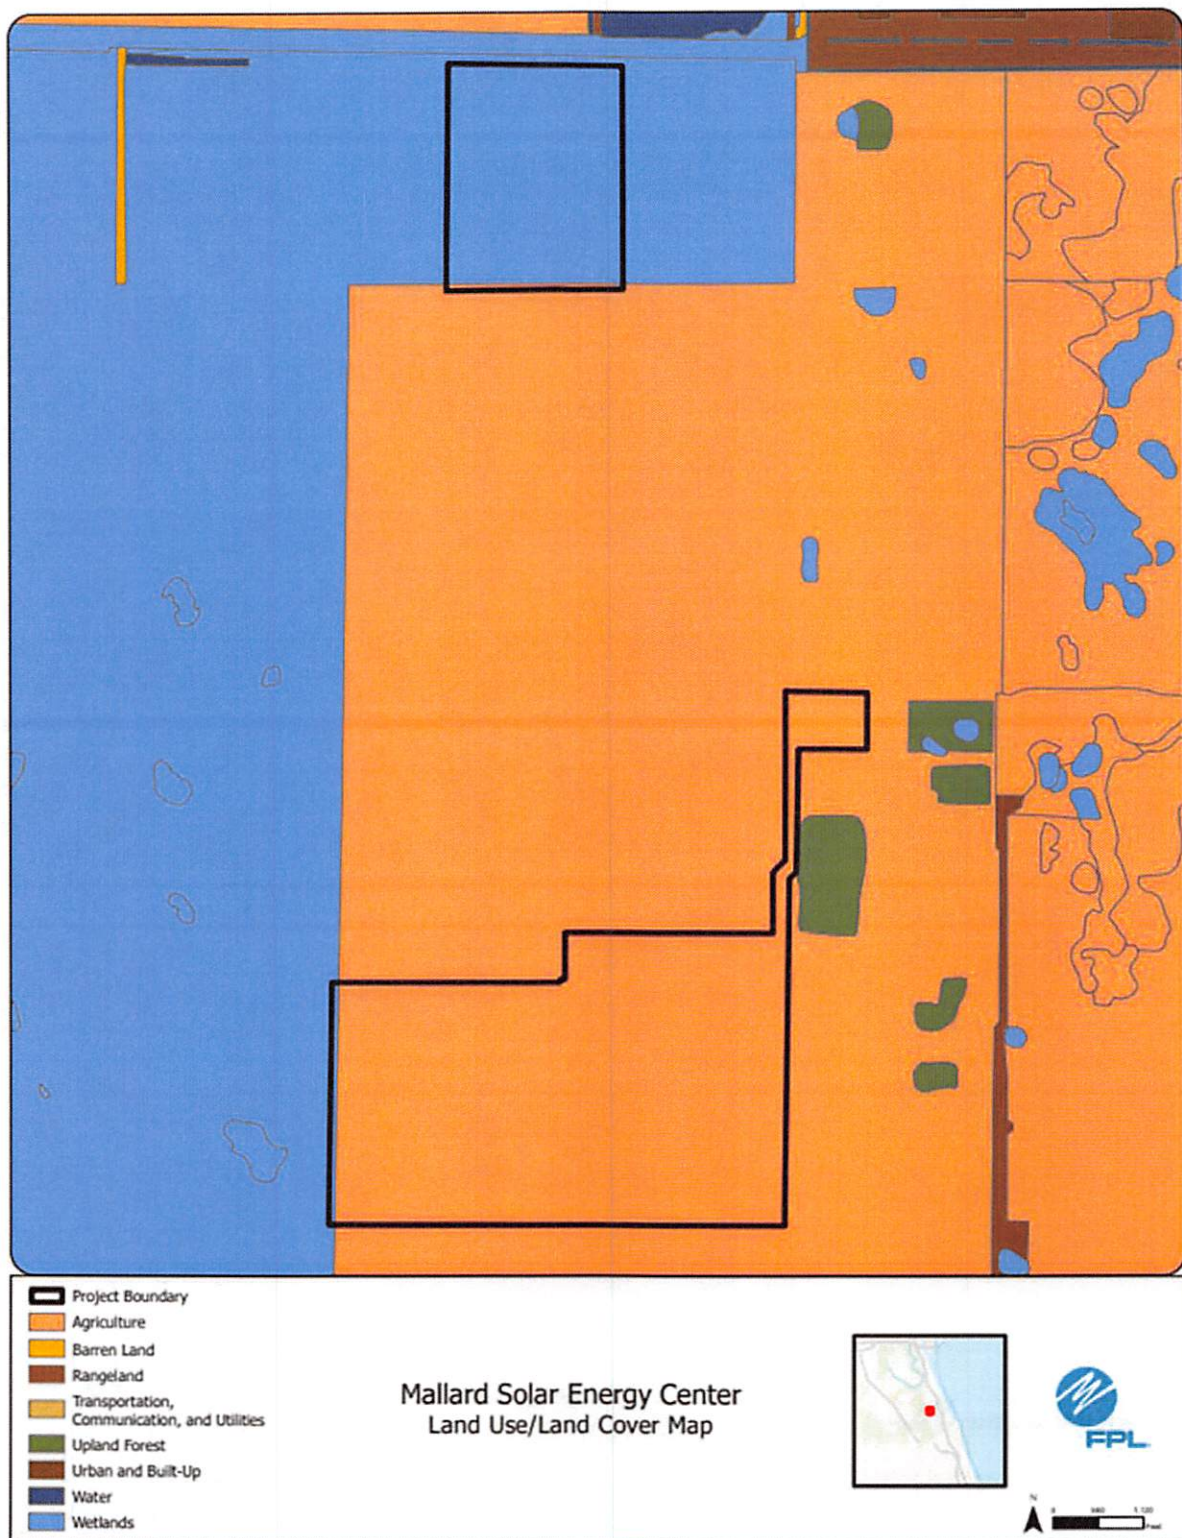





 Mallard Solar Energy Center

# Mallard Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #7: Boardwalk Solar Energy Center, Collier County***

	County	Order	Boardwalk Solar Energy Center
	Facility Acreage	553	
	COD	1/13/2026	
	For PV facilities: tracking or fixed	Tracking	
	Reference Maps		
a.	USGS Map	See Figures in the following pages	
b.	Proposed Facilities Layout		
c.	Map of site and Adjacent Areas		
d.	Land Use Map of site and Adjacent Areas		
e.	Site	Agriculture	Existing Land Uses
	Adjacent Areas	Agriculture	
f.	General Environment Features On and in the Site Vicinity		
1.	Natural Environment	Agriculture	
2.	Used Species	No adverse impacts to listed species are anticipated	
3.	Natural Resources of Regional Significance Status		
4.	Other Significant Features		
g.	Design Features and Mitigation Options	<p>The design includes an approximately 74.5 MW solar panel PV facility, on-site transmission substation, and site interconnection system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.</p> <p>Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.</p> <p>The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.)</p> <p>Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.</p> <p>See Figure in the following pages. Site is located in the South region.</p>	
h.	Local Government Future Land Use Designations		
i.	Site Selection Criteria Factors		
j.	Water Resources		
k.	Geological Features of Site and Adjacent Areas	<p>Cooling: Not Applicable for Solar Process: Not Applicable for Solar Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall</p> <p>Cooling: Not Applicable for Solar Process: Not Applicable for Solar Panel Cleaning: Onsite well or surface water or delivered to site</p> <p>Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and timing of low-to-no irrigation grass or groundcover.</p> <p>Solar does not require fuel and no waste products will be generated at the site.</p> <p>Solar does not require fuel and no waste products will be generated at the site.</p>	
m.	Water Supply Sources by Type		
n.	Water Conservation Strategies Under Consideration		
o.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control		
p.	Air Emissions and Control Systems	<p>Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems.</p> <p>Combustion Control - Not Applicable</p>	
q.	Air Emissions and Control Systems		
r.	Noise Emissions and Control Systems		
s.	Status of Applications	<p>PDPE ERP issued: 1/24/24</p> <p>PDPE 404 GP issued: 1/24/24</p>	



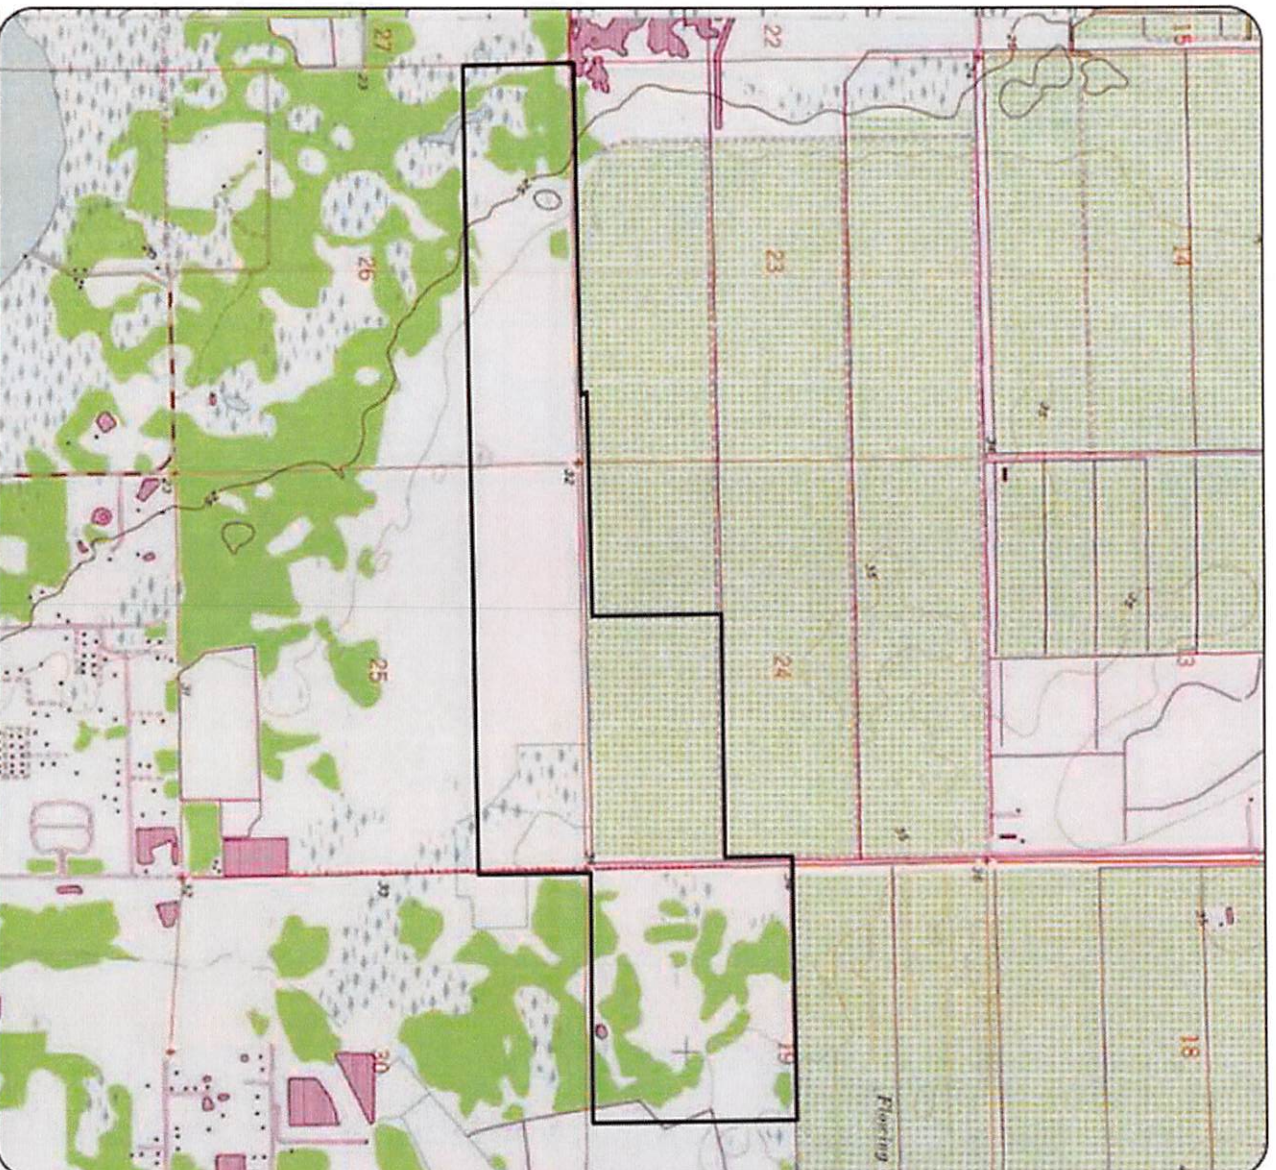


☐ Boardwalk Solar Energy Center

Boardwalk Solar Energy Center  
USGS Topography Map





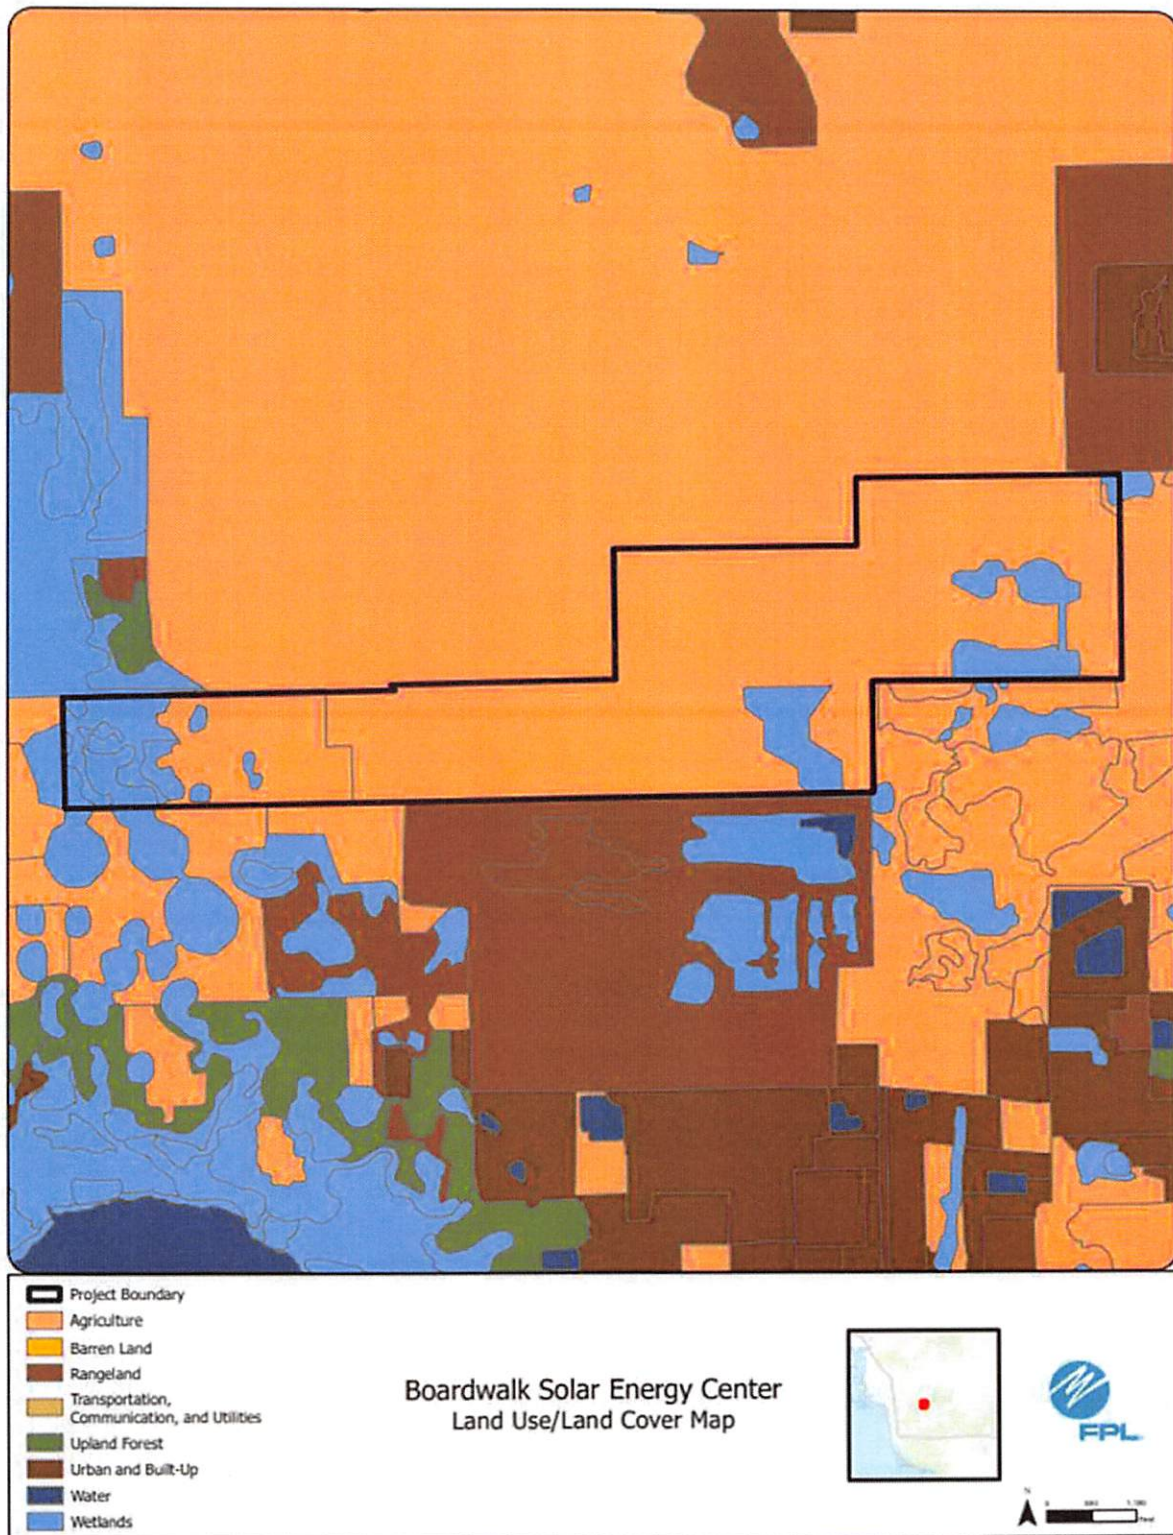





***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #8: Goldenrod Solar Energy Center, Collier County***

Preferred Site		Goldenrod Solar Energy Center
County		Cotler
Facility Acreage		610
COD		1/31/2026
For PV facilities: tracking or fixed		Tracking
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
e. Site		Agriculture
f. Adjacent Areas		Agriculture
General Environment Features On and in the Site Vicinity		
g. Natural Environment		Agriculture
h. Listed Species	No adverse impacts to listed species are anticipated.	
i. Natural Resources of Regional Significance Status	Corkscrew Swamp on the adjacent property to the west.	
j. Other Significant Features	FPL is not aware of any other significant features of the site.	
k. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
l. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
m. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.)	
n. Water Resources	Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.	
o. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.	
p. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
q. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
r. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
s. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
t. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
u. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
v. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
w. Status of Applications	FDEP ERP Issued: 4/9/2024	






Goldenrod Solar Energy Center

Goldenrod Solar Energy Center  
USGS Topography Map





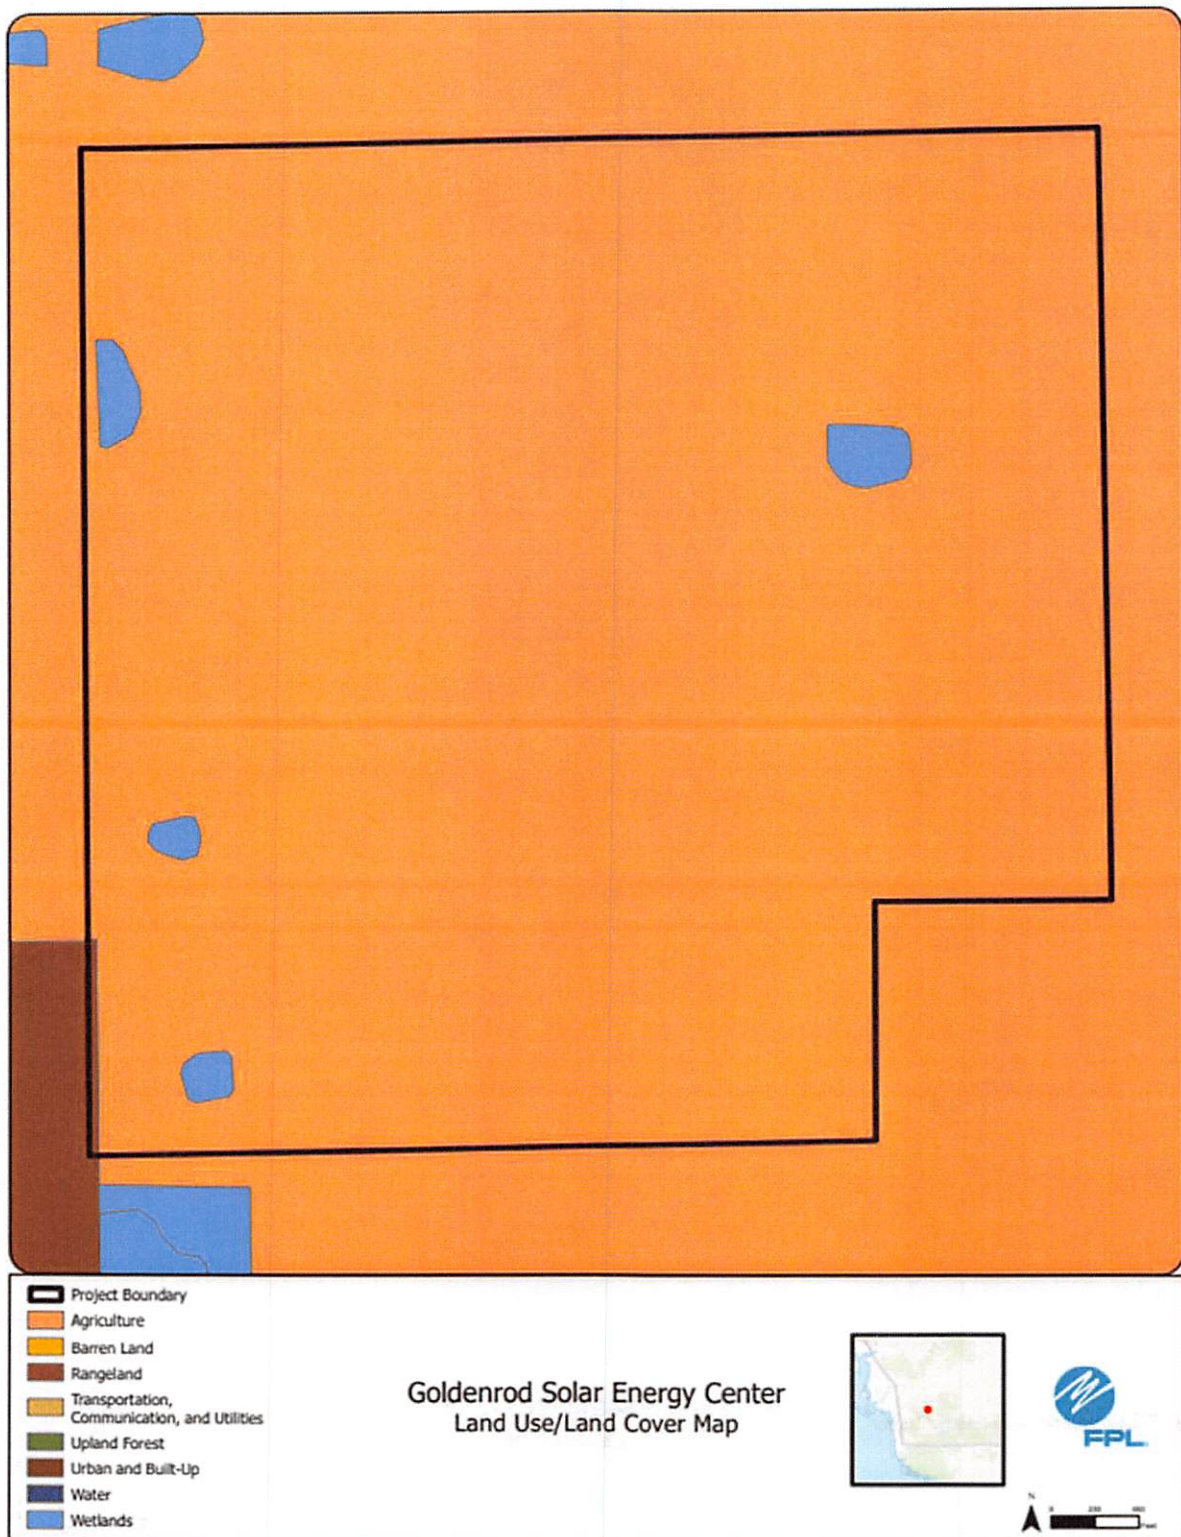





 Goldenrod Solar Energy Center

# Goldenrod Solar Energy Center Facility Layout Map







***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #9: North Orange Solar Energy Center, St. Lucie  
County***


Preferred Site		North Orange Solar Energy Center
County		St. Lucie
Facility Acreage		2037 (656 project acres)
COD		4/30/2026
For PV facilities: tracking or fixed		Tracking
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
e. Site	Previously used for agricultural purposes	
Adjacent Areas	Agriculture	
General Environment Features On and In the Site Vicinity		
f. 1. Natural Environment	Site is primarily fallow cropland.	
2. Listed Species	Everglade snail kite, Florida sandhill crane, Audubon's crested caracara, wading birds	
3. Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.	
4. Other Significant Features	Formerly documented bald eagle nests to west of property	
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
i. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).	
j. Water Resources	Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.	
k. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.	
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
o. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
s. Status of Applications	FDEP ERP Issued: 5/5/23 FDEP 404 GP Issued: 5/5/23	

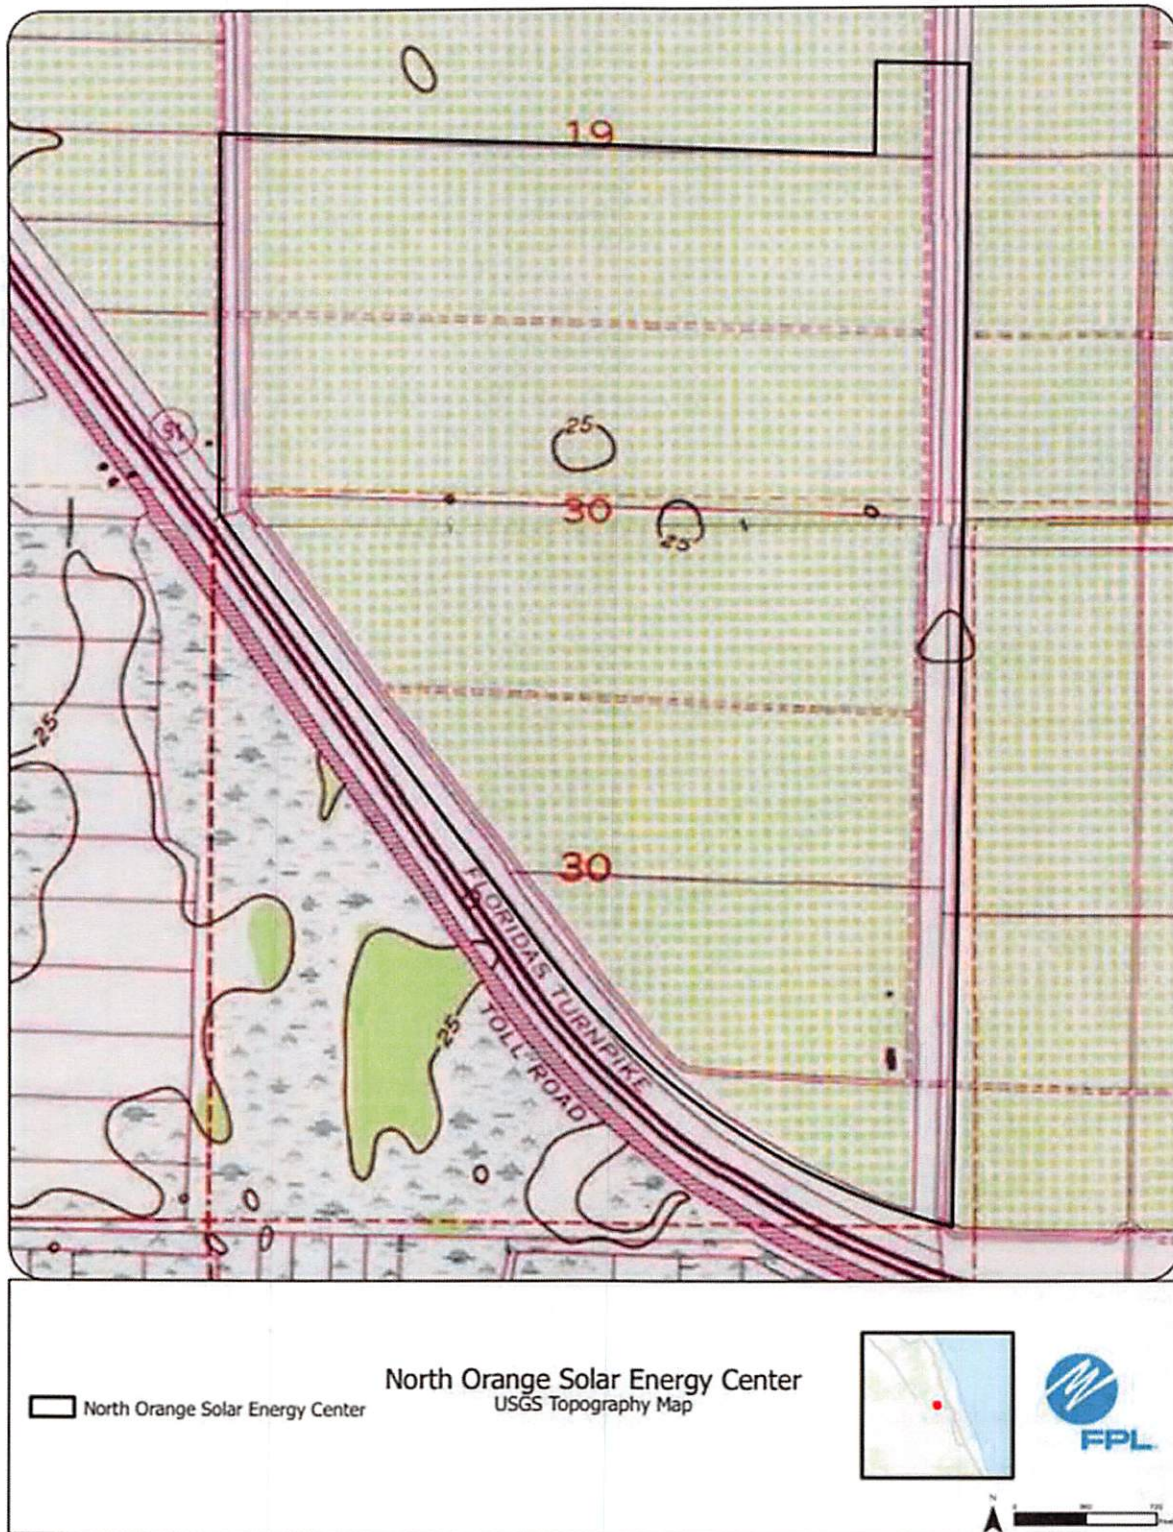



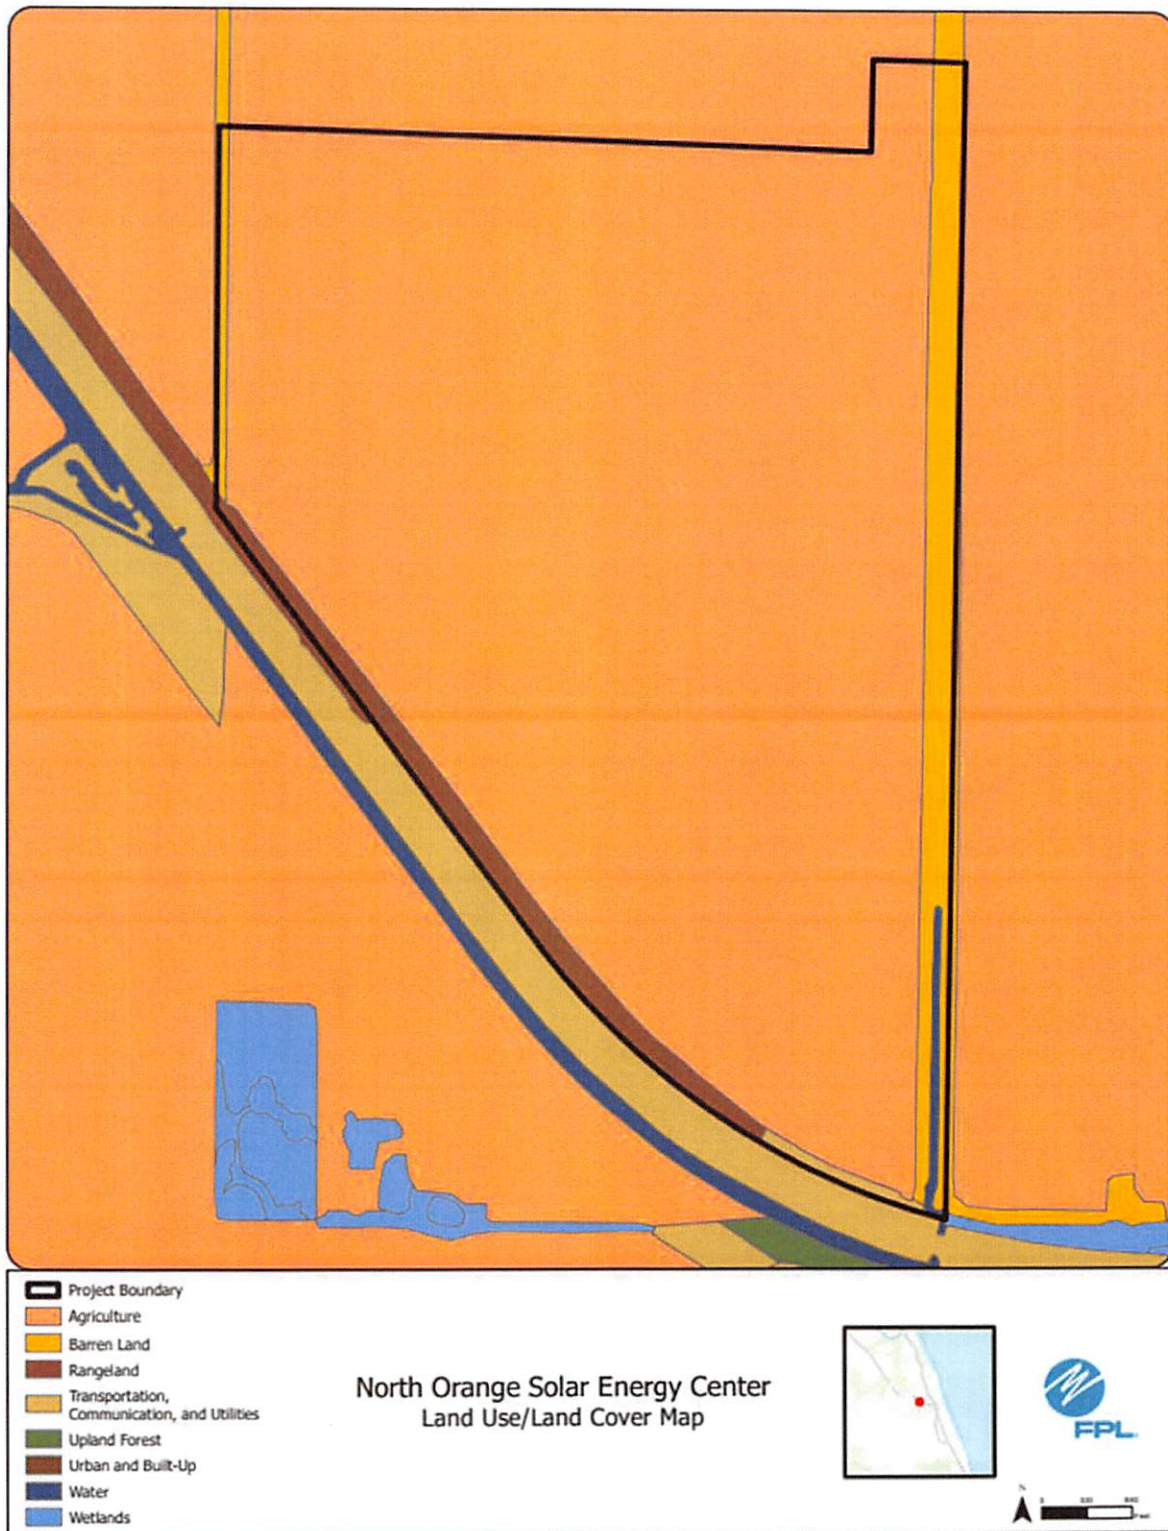



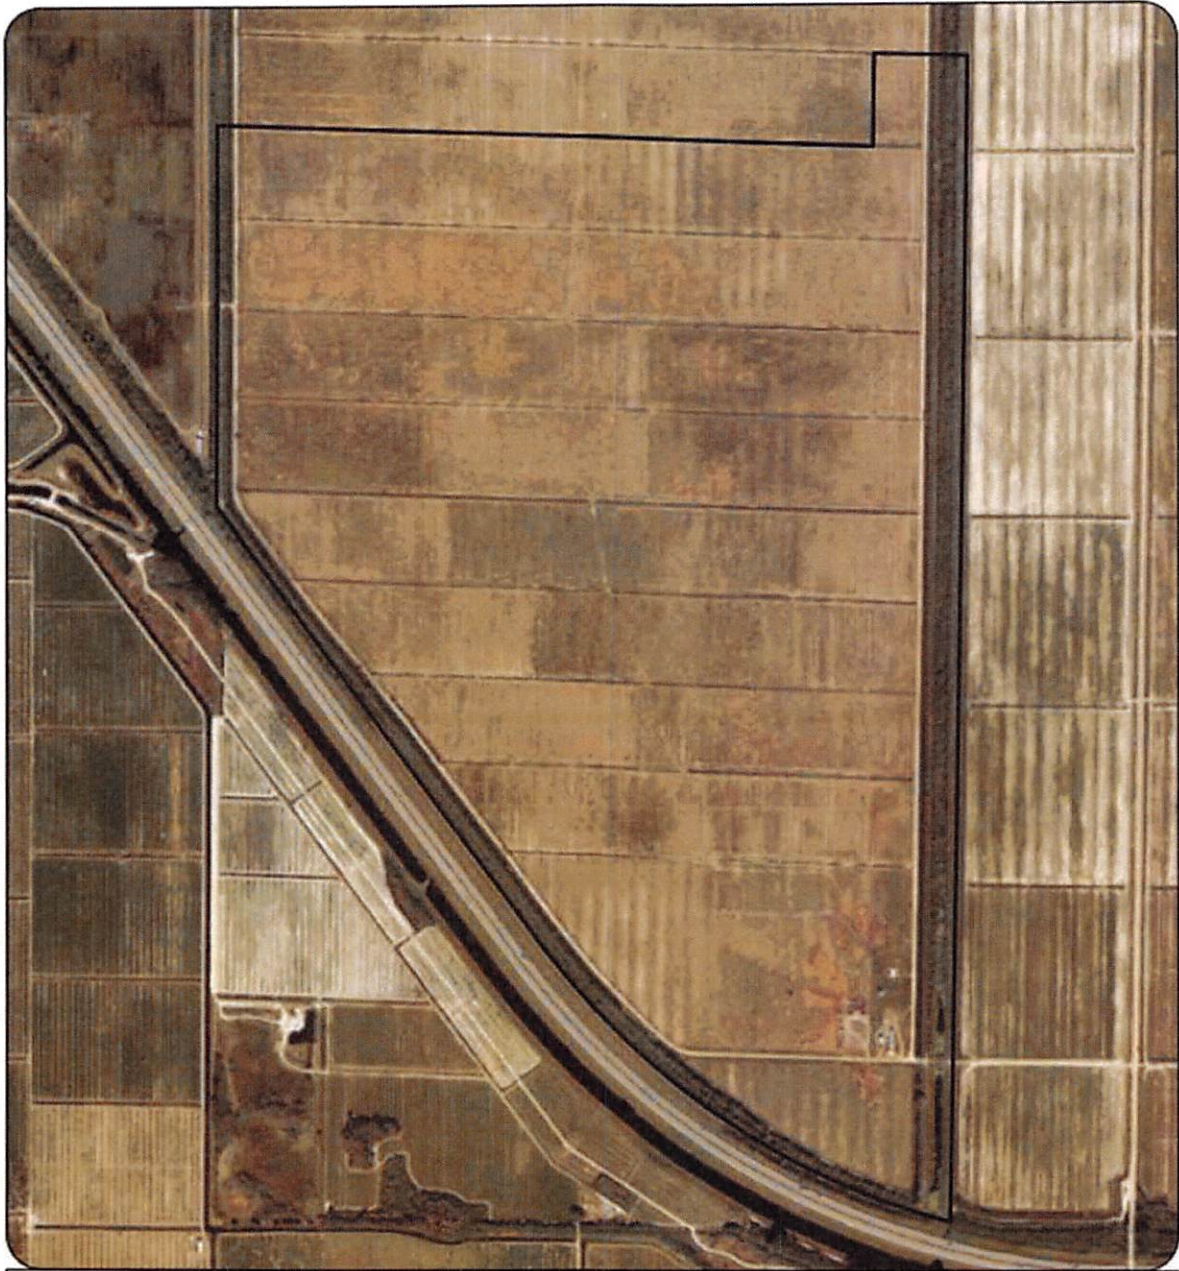

 North Orange Solar Energy Center

# North Orange Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***


***Preferred Site #10: Sea Grape Solar Energy Center, St. Lucie County***


County	St. Lucie
Facility Acreage	2037 (564 project acres)
COD	4/30/2026
For PV facilities: tracking or fixed	Tracking
USGS Map	See Figures in the following pages
a. Proposed Facilities Layout	
b. Map of Site and Adjacent Areas	
c. Land Use Map of site and Adjacent Areas	
d. Existing Land Uses	
e. Site	inactive citrus grove, cattle
f. Adjacent Areas	Adjacent solar sites
g. General Environment Features On and in the Site Vicinity	
1. Natural Environment	Site is primarily remnant citrus that is grazed by cattle.
2. Listed Species	Everglade snail kite, Florida sandhill crane, Audubon's crested caracara, wading birds
3. Natural Resources of Regional Significance Status	No natural resources of regional significance status sit or adjacent to the site.
4. Other Significant Features	Formerly documented bald eagle nests to west of property
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.)
j. Water Resources	Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/VUP or meets VMAU permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.
k. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
p. Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Design - Not Applicable Combustion Control - Not Applicable
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications	FDEP ERP issued: 6/26/23 FDEP 404 GP issued: 7/5/23



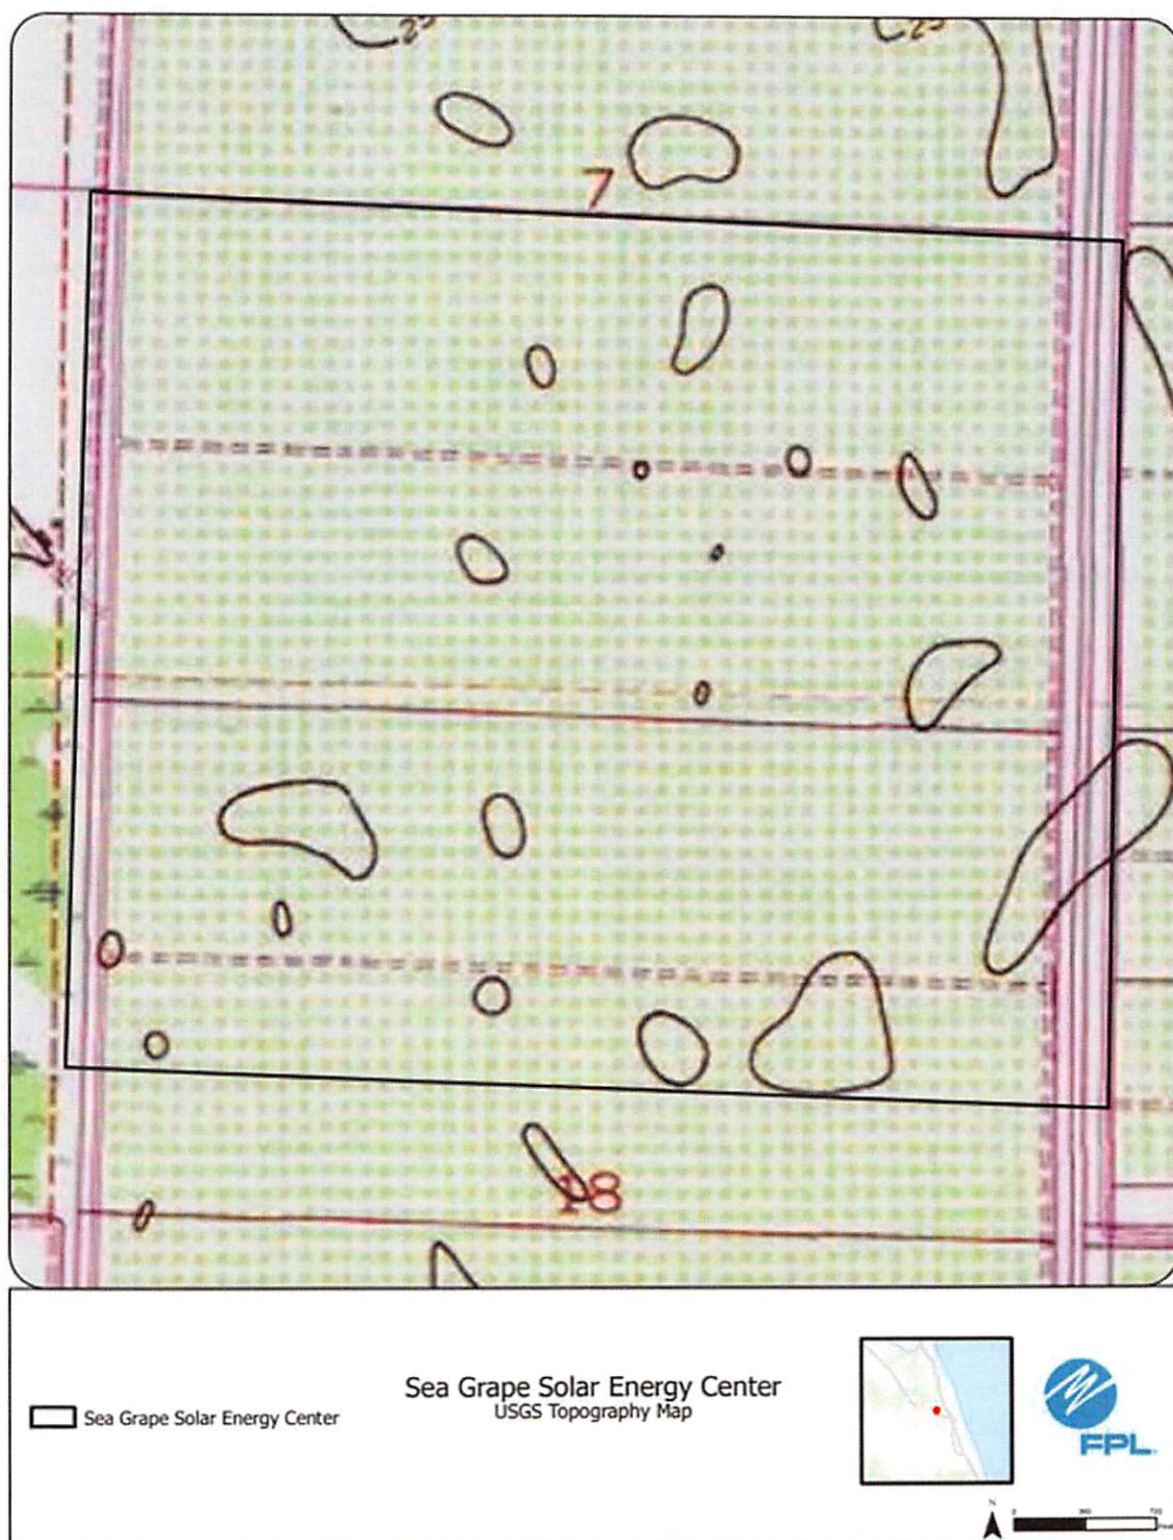



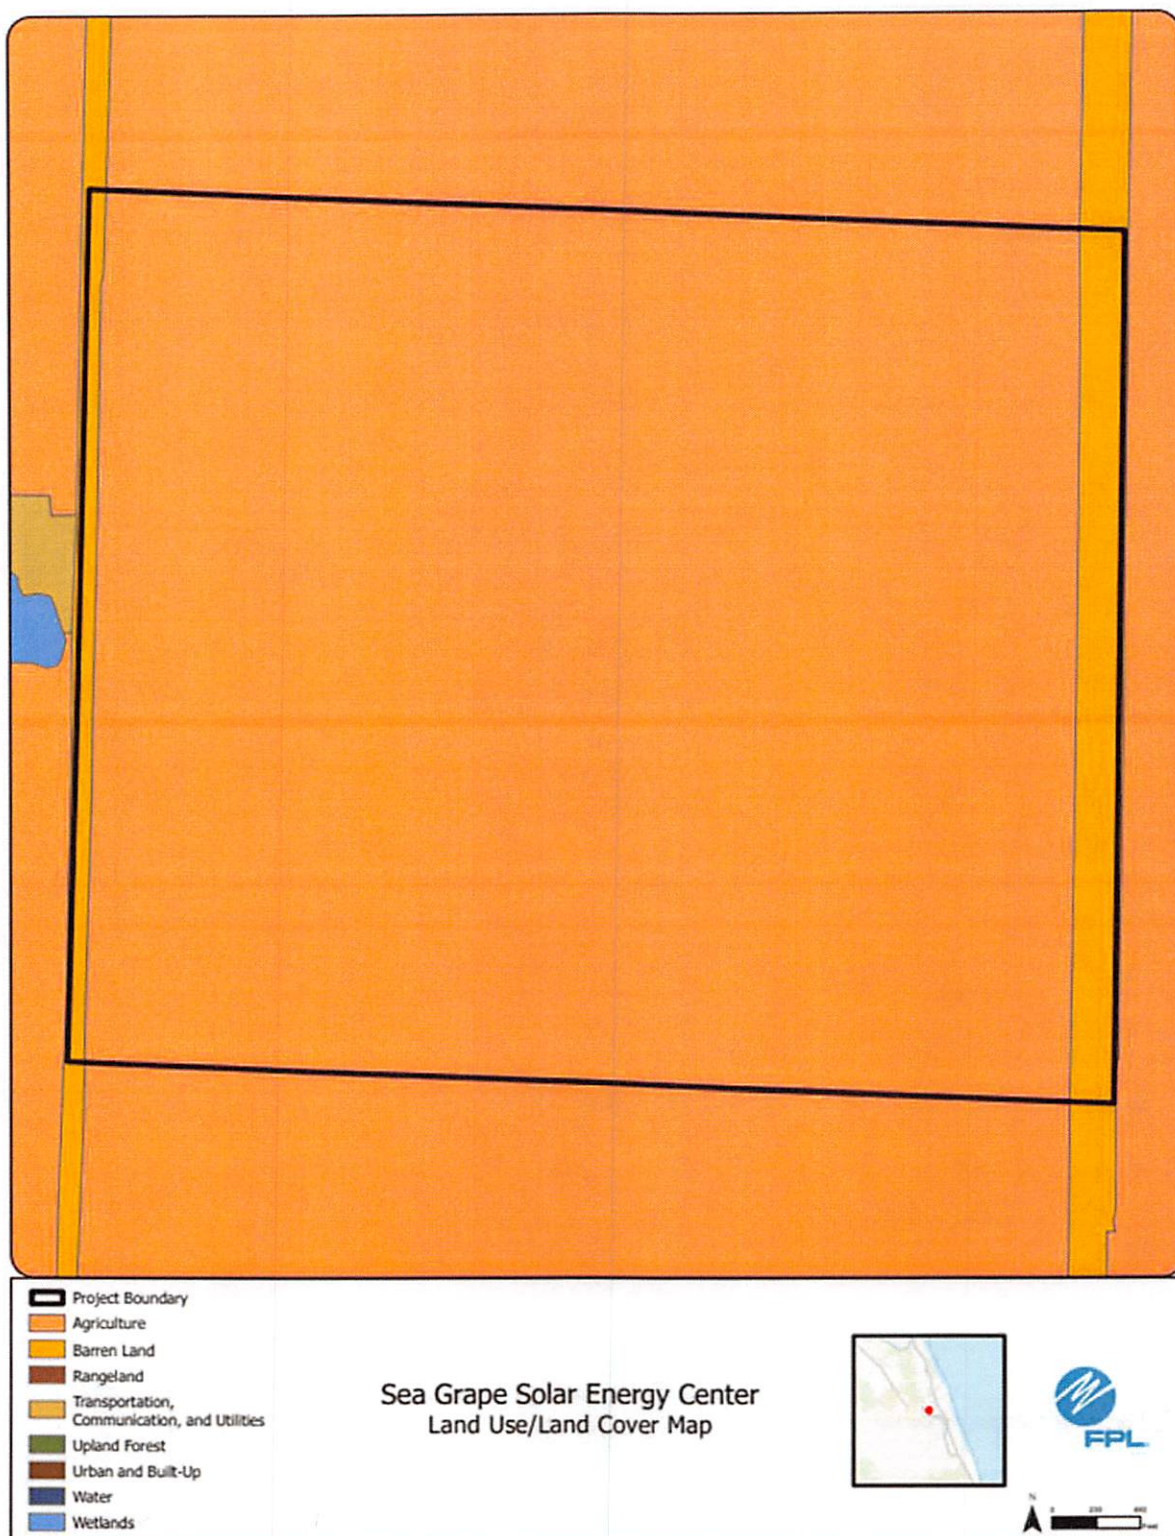

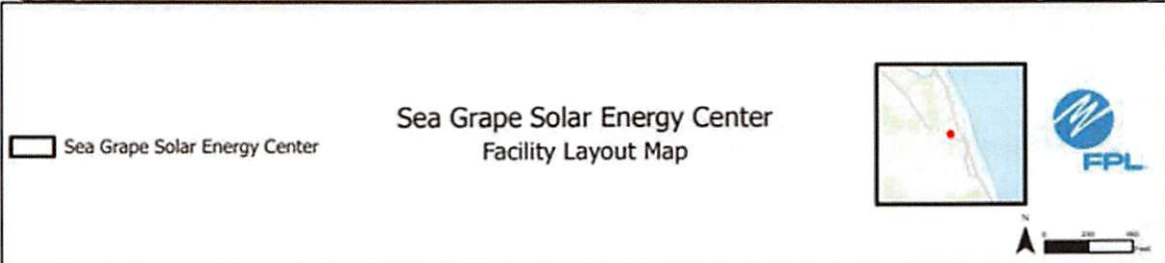




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #11: Clover Solar Energy Center, St. Lucie County***

Preferred Site		Clover Solar Energy Center
County	St. Lucie	
Facility Acreage	10,341 (433 project acres)	
COD	4/30/2026	
For PV facilities: tracking or fixed	Tracking	
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
e. Site	Improved pasture	
f. Adjacent Areas	Fallow agriculture, improved pasture, C-25 canal	
General Environment Features On and in the Site Vicinity		
1. Natural Environment	The entire property consists of improved pasture with agricultural ditches.	
2. Listed Species	Audubon's crested caracara, wading birds	
3. Natural Resources of Regional Significance Status	C-25 canal is located immediately south of the project.	
4. Other Significant Features	FPL is not aware of any other significant features of the site.	
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
i. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).	
j. Water Resources	Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.	
k. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.	
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
o. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
s. Status of Applications	FDEP ERP Issued: 6/12/2024	





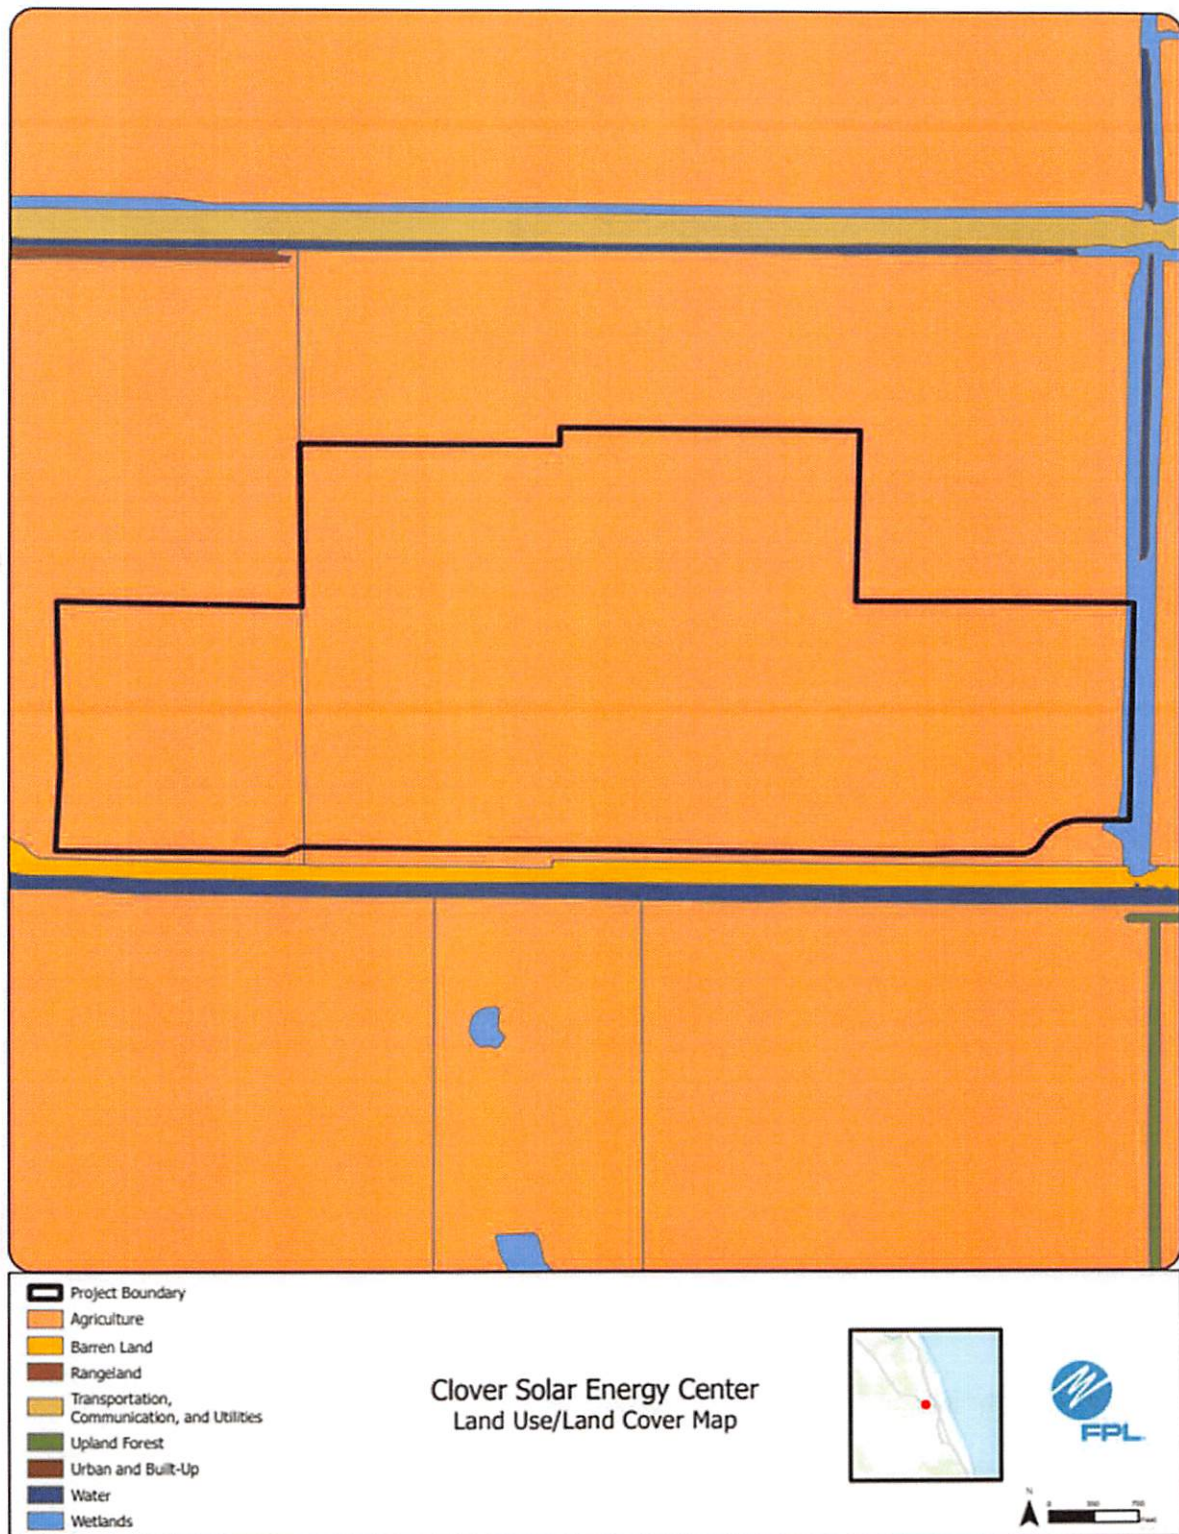



 Clover Solar Energy Center

### Clover Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #12: Sand Pine Solar Energy Center, Calhoun County***



Preferred Site		Sand Pine Solar Energy Center
County	Cathoun	
Facility Acreage	719	
COD	4/30/2026	
For PV facilities: tracking or fixed	Tracking	
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
e.	Existing Land Uses	
Site	Silviculture, hunting	
Adjacent Areas	Timber, croplands, horse farms, solar	
f.	General Environment Features On and in the Site Vicinity	
1. Natural Environment	Site is primarily silviculture.	
2. Listed Species	Gopher tortoise	
3. Natural Resources of Regional Significance Status	Chipola Experimental Forest and Juniper Creek Wildlife Management Area to South of property.	
4. Other Significant Features	FPL is not aware of any other significant features of the site.	
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
i. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).	
j. Water Resources	Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.	
k. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the Panhandle region.	
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
o. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
s. Status of Applications	FDEP ERP Issued: 8/24/2023	




 Sand Pine Solar Energy Center

Sand Pine Solar Energy Center  
USGS Topography Map





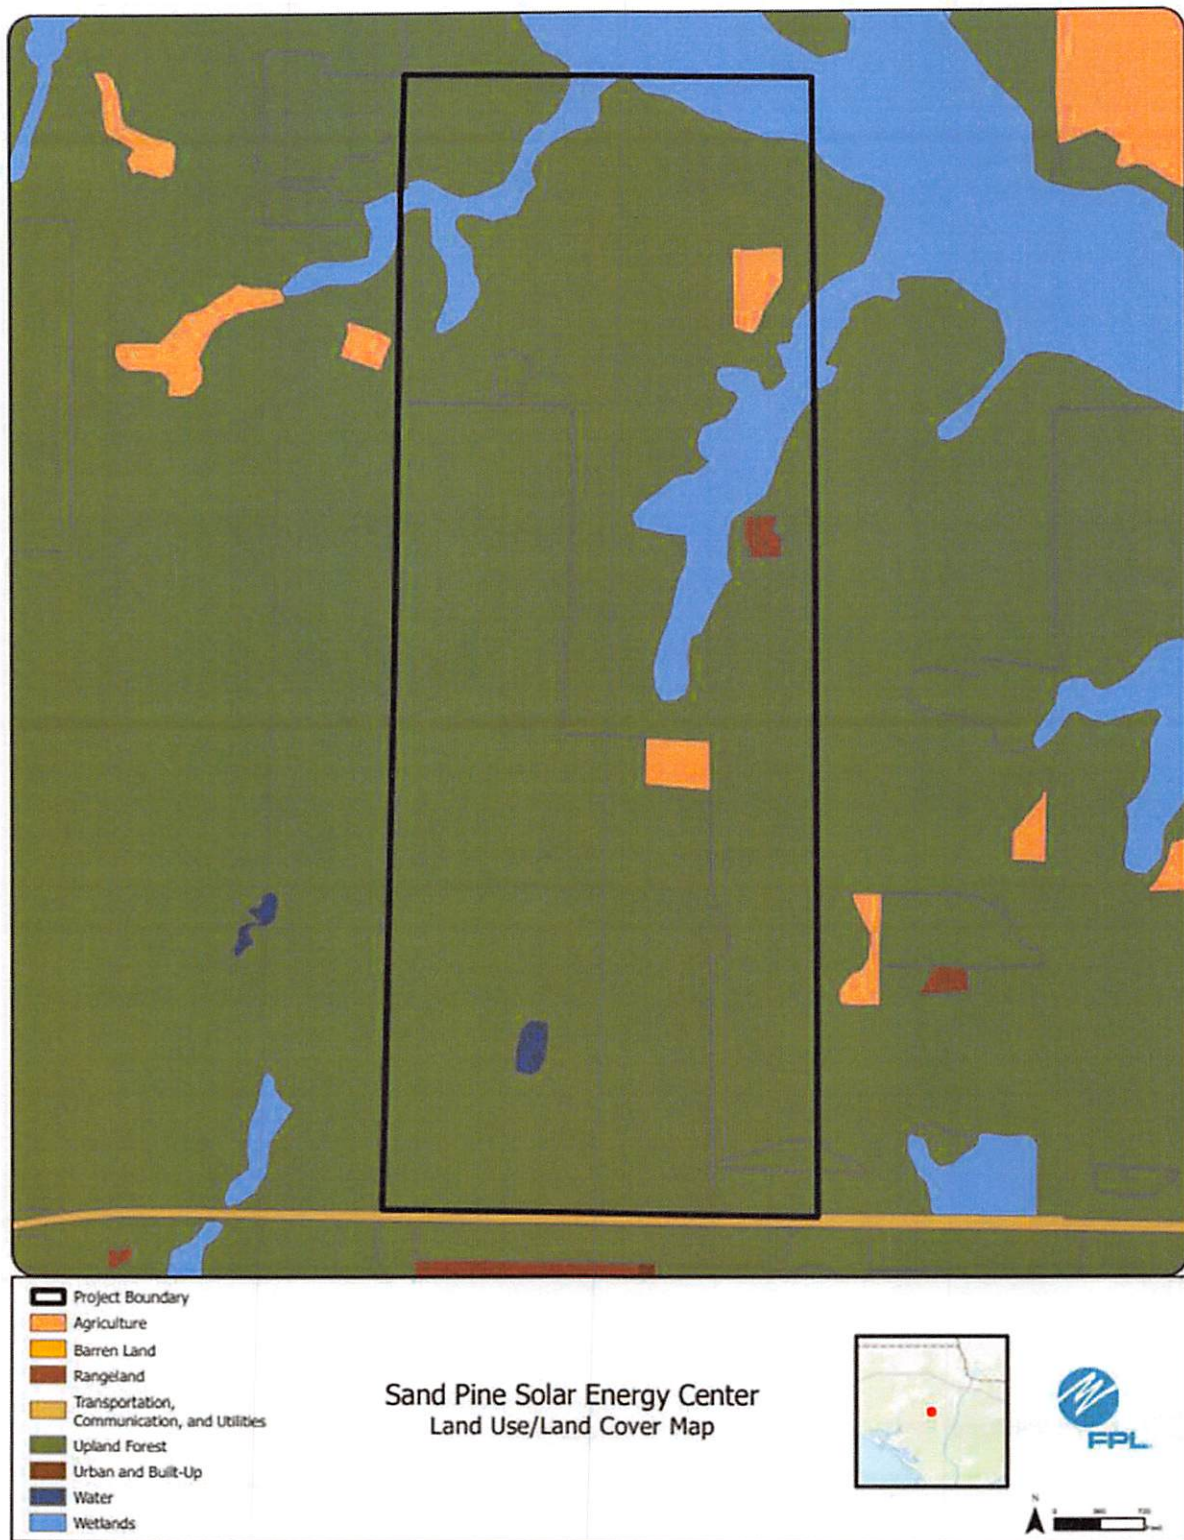



 Sand Pine Solar Energy Center

# Sand Pine Solar Energy Center Facility Layout Map



***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #13: Hendry Solar Energy Center, Hendry County***




Preferred Site		Hendry Solar Energy Center
County	Hendry	
Facility Acreage	641	
COD	1/31/2027	
For PV facilities: tracking or fixed	Tracking	
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
e. Site	Improved pasture and wetlands	
f. Adjacent Areas	Various crop agriculture	
General Environment Features On and in the Site Vicinity		
1. Natural Environment	Site is actively used as improved pasture with a few wetlands and agricultural ditches.	
2. Listed Species	Audubon's crested caracara, gopher tortoise	
3. Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.	
4. Other Significant Features	FPL is not aware of any other significant features of the site.	
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
i. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).	
j. Water Resources	Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.	
k. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.	
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
o. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
s. Status of Applications	FDEP ERP Issued: 1/10/24 FDEP 404 GP Issued: 1/10/24	




 Hendry Solar Energy Center

Hendry Solar Energy Center  
USGS Topography Map





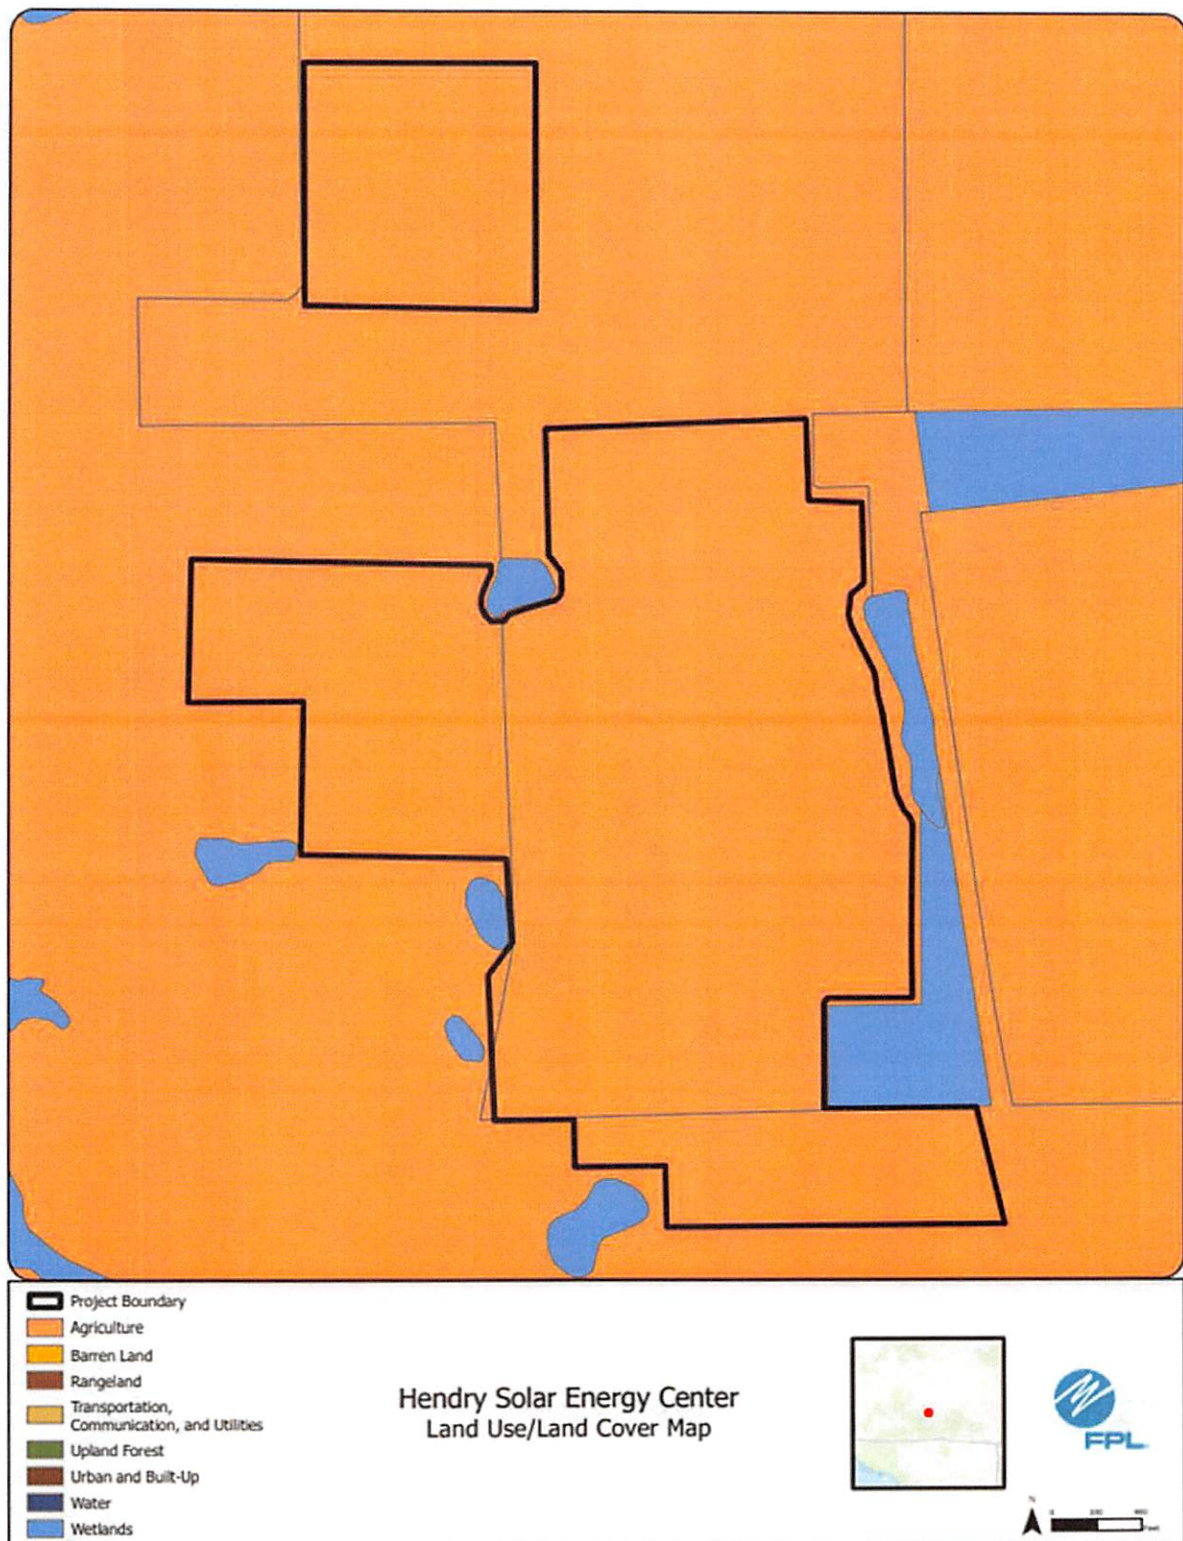





 Hendry Solar Energy Center

### Hendry Solar Energy Center Facility Layout Map



***Site Description, Environmental, and Land Use Information:  
Supplemental Information***


***Preferred Site #14: Tangelo Solar Energy Center, Okeechobee County***

County	Okaloosa	Tango Solar Energy Center
Facility Acreage	748	
GOB	1/31/2027	
For PV facilities: tracking or fixed	Tracking	
USGS Map		
Proposed Facilities Layout		
Map of Site and Adjacent Areas		
Land Use Map of Site and Adjacent Areas		
Site		
Adjacent Areas		
General Environment Features On and in the Site Vicinity		
1. Natural Environment		The upland use is predominantly improved pasture. There are also forested wetlands and agricultural ditches.
2. Listed Species		Audubon's crested caracara and wading birds
3. Natural Resources or Regional Significance Status		No natural resources or regional significance status at or adjacent to the site.
4. Other Significant Features		FPL is not aware of any other significant features of the site.
g. Design Features and Mitigation Options		The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
n. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
l. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing onsite water resources may be used to meet water requirements if permit is pulled or if the facility has an existing CUP/VUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the South region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Potable: Minimal Process: Not Applicable for Solar Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Potable: Not Applicable for Solar Process: Not Applicable for Solar
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for control systems. Combustion Control - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP issued: 3/29/2024







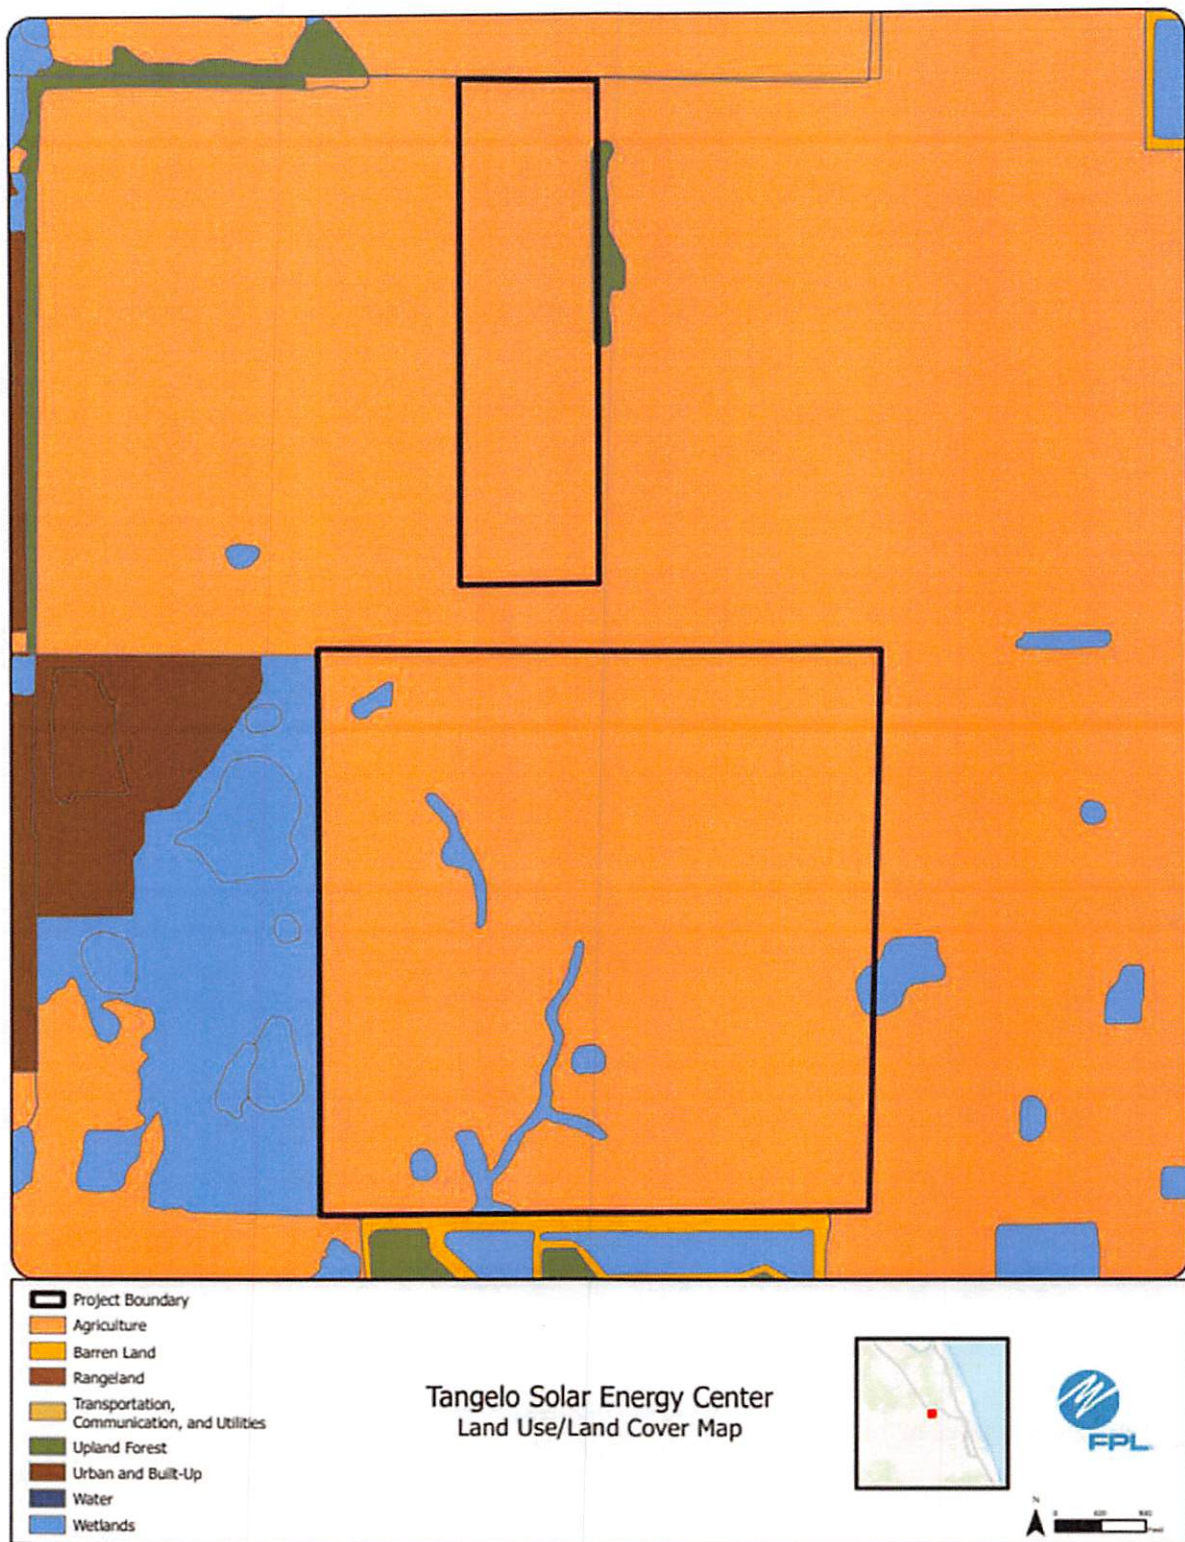



 Tangelo Solar Energy Center

# Tangelo Solar Energy Center Facility Layout Map



***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #15: Wood Stork Solar Energy Center, St. Lucie County***




Preferred Site		Wood Stork Solar Energy Center
County		St. Lucie
Facility Acreage		2831 (603 project acres)
COD		1/31/2027
For PV facilities: tracking or fixed		Tracking
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
e. Site		Active citrus groves
f. Adjacent Areas		Citrus, pasture, crop
General Environment Features On and in the Site Vicinity		
1. Natural Environment		Most of the property consists of active citrus groves, with a large surface water in the northern portion of the property, a few sparsely located hardwood forest areas along the eastern side of the property, and irrigation ditches occurring throughout the property.
2. Listed Species		Bald eagle, Audubon's crested caracara, wading birds
3. Natural Resources of Regional Significance Status		A documented Audubon's crested caracara nest is on site and accounted for in the project design.
4. Other Significant Features		A bald eagle nest is located northeast of the project area.
g. Design Features and Mitigation Options		The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the South region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP Issued: 9/28/23 FDEP 404 GP Issued: 9/28/23







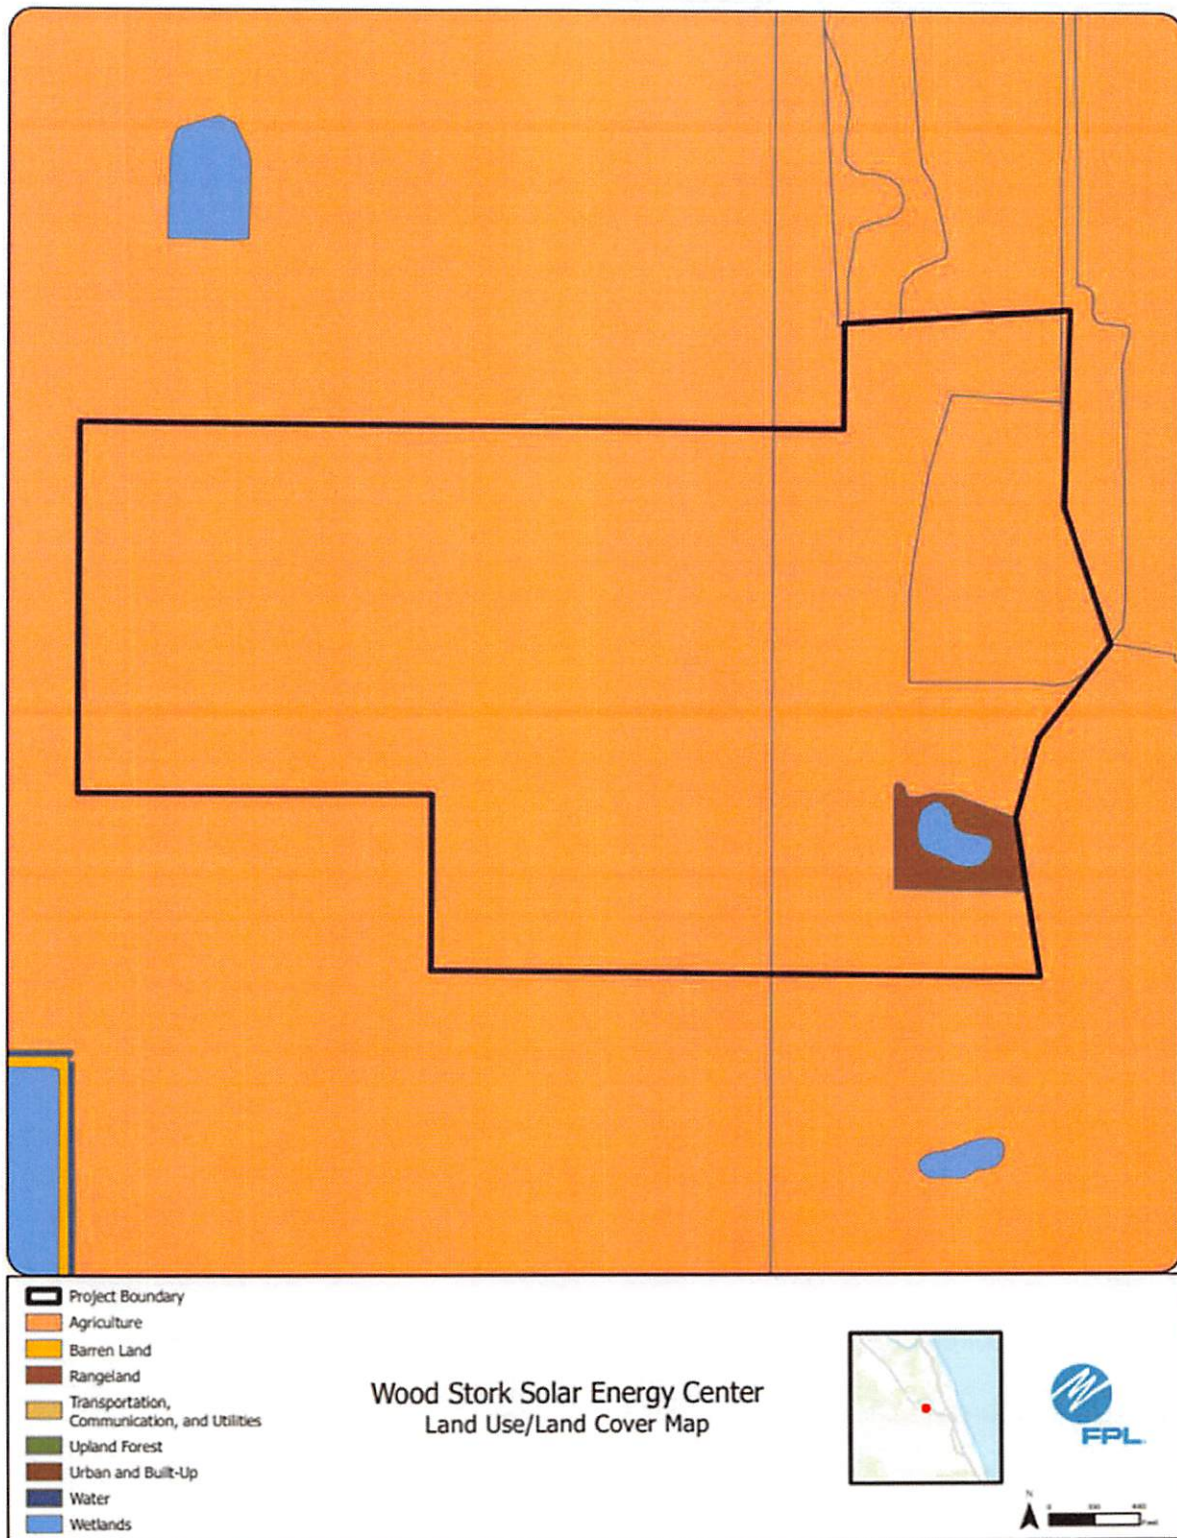





Wood Stork Solar Energy Center

# Wood Stork Solar Energy Center Facility Layout Map





***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #16: Indrio Solar Energy Center, St. Lucie County***

[illegible]



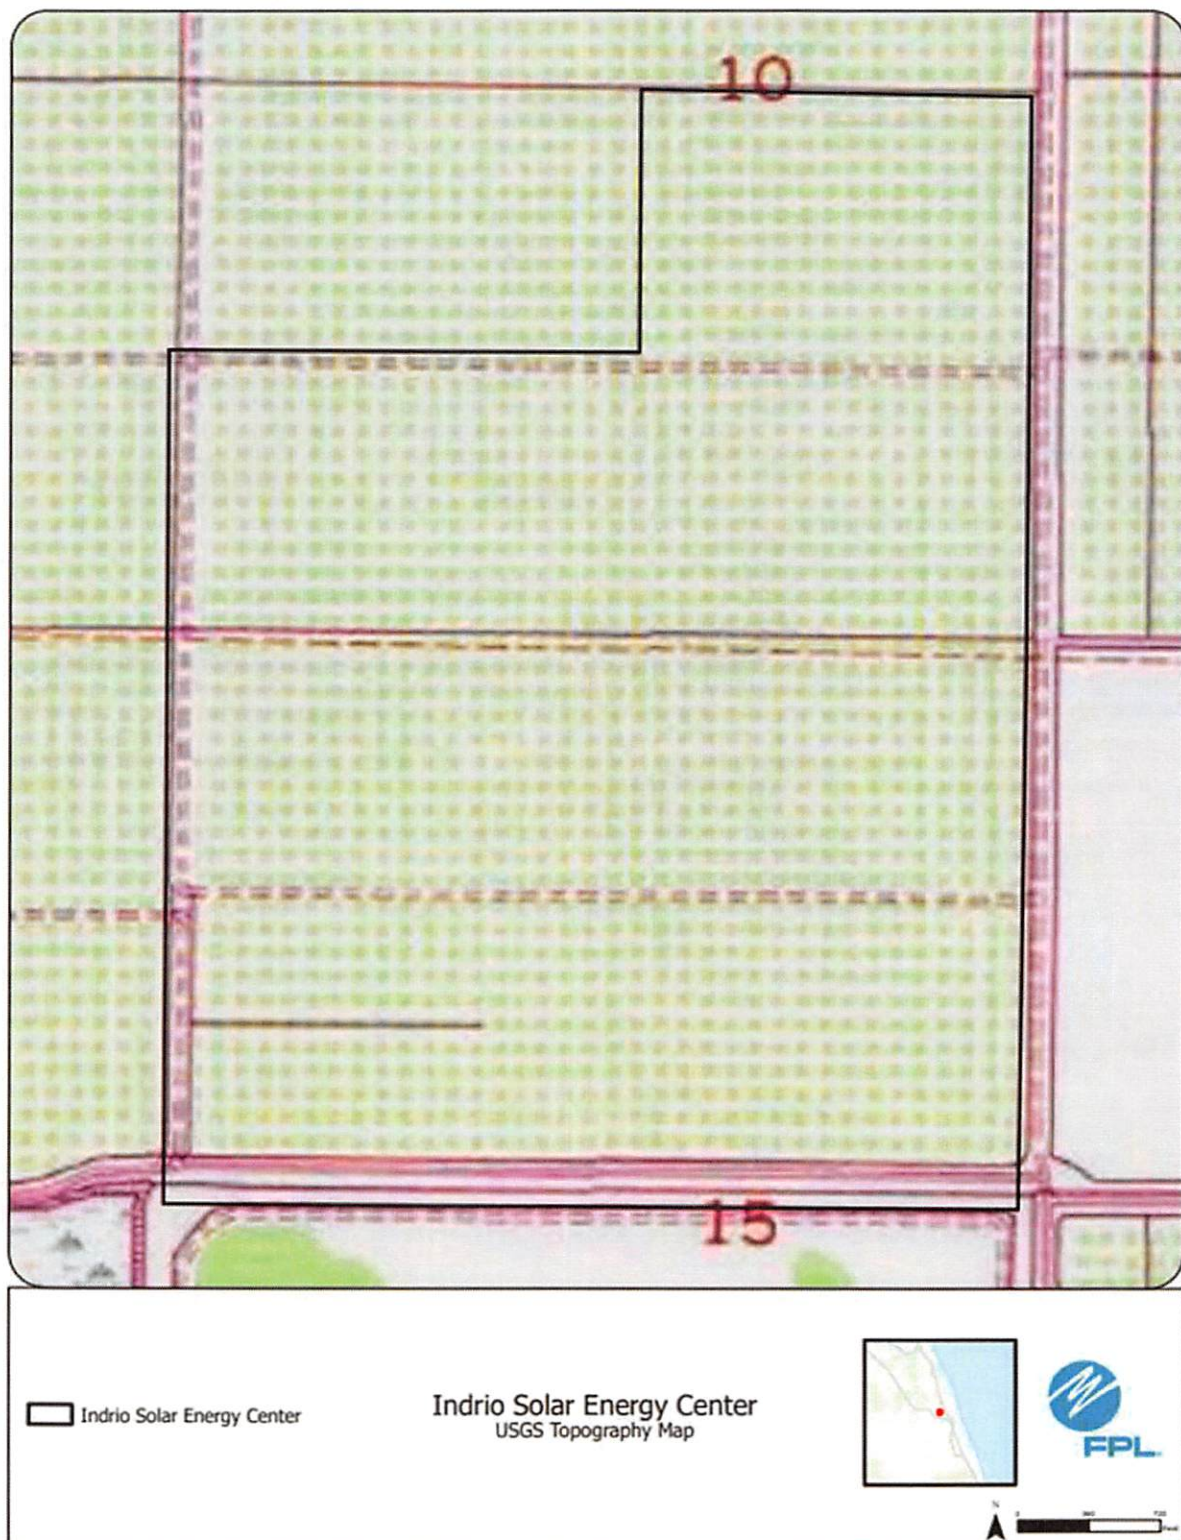

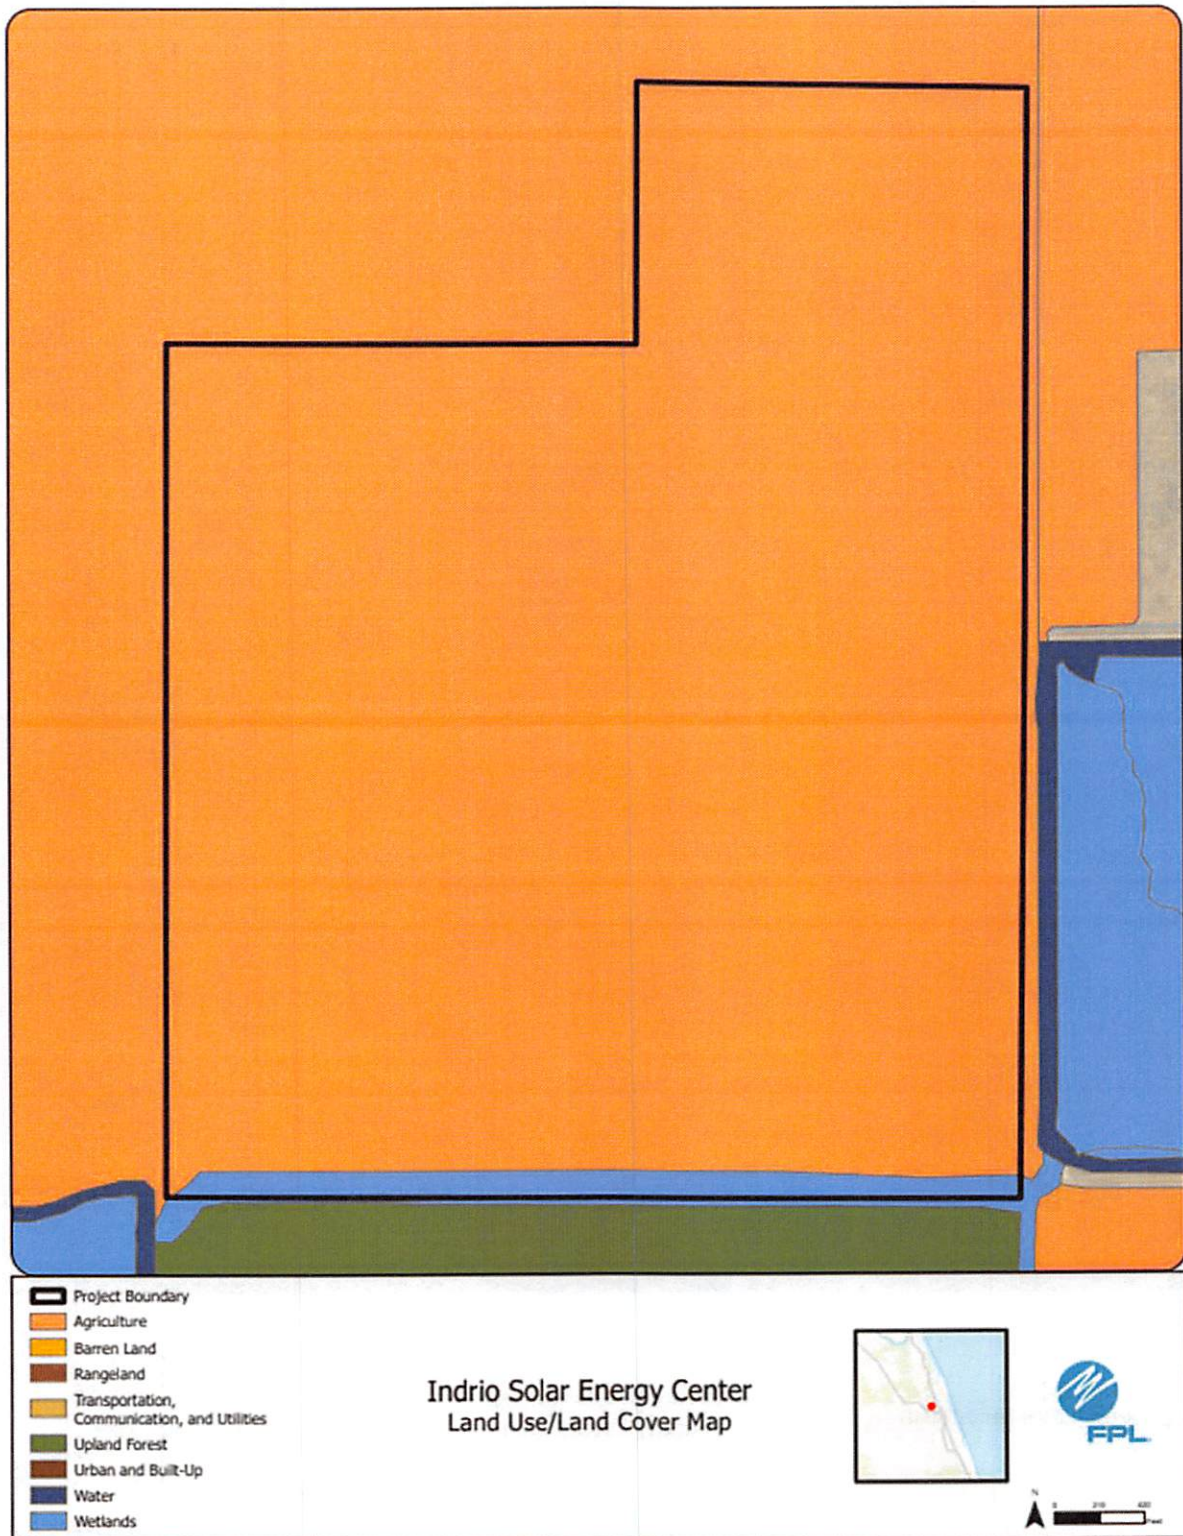





 Indrio Solar Energy Center

# Indrio Solar Energy Center Facility Layout Map






***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #17: Middle Lake Solar Energy Center, Madison County***

Preferred Site		Middle Lake Energy Center
County		Madison
Facility Acreage		524
COD		4/30/2027
For PV facilities: tracking or fixed		Tracking
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
e. Site		Pasture and silviculture
Adjacent Areas		Agricultural lands, I-10 and low density residential
f. General Environment Features On and in the Site Vicinity		
1. Natural Environment		Site is open pasture that is used for cattle and silviculture. Forested wetlands with other surface waters associated with Norton Creek.
2. Listed Species		Bald eagle nest and gopher tortoises
3. Natural Resources of Regional Significance Status		Norton Creek runs through this property which includes Booze Lake, Middle Lake and Peterson Sink.
4. Other Significant Features		Karst features exist on this site.
g. Design Features and Mitigation Options		The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing onsite water resources may be used to meet water requirements if permit is pulled. Otherwise, water will need to be trucked from off-site.
k. Geological Features of Site and Adjacent Areas		See Figures in the following pages. Site is located in the Panhandle region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP Issued: 4/15/2024





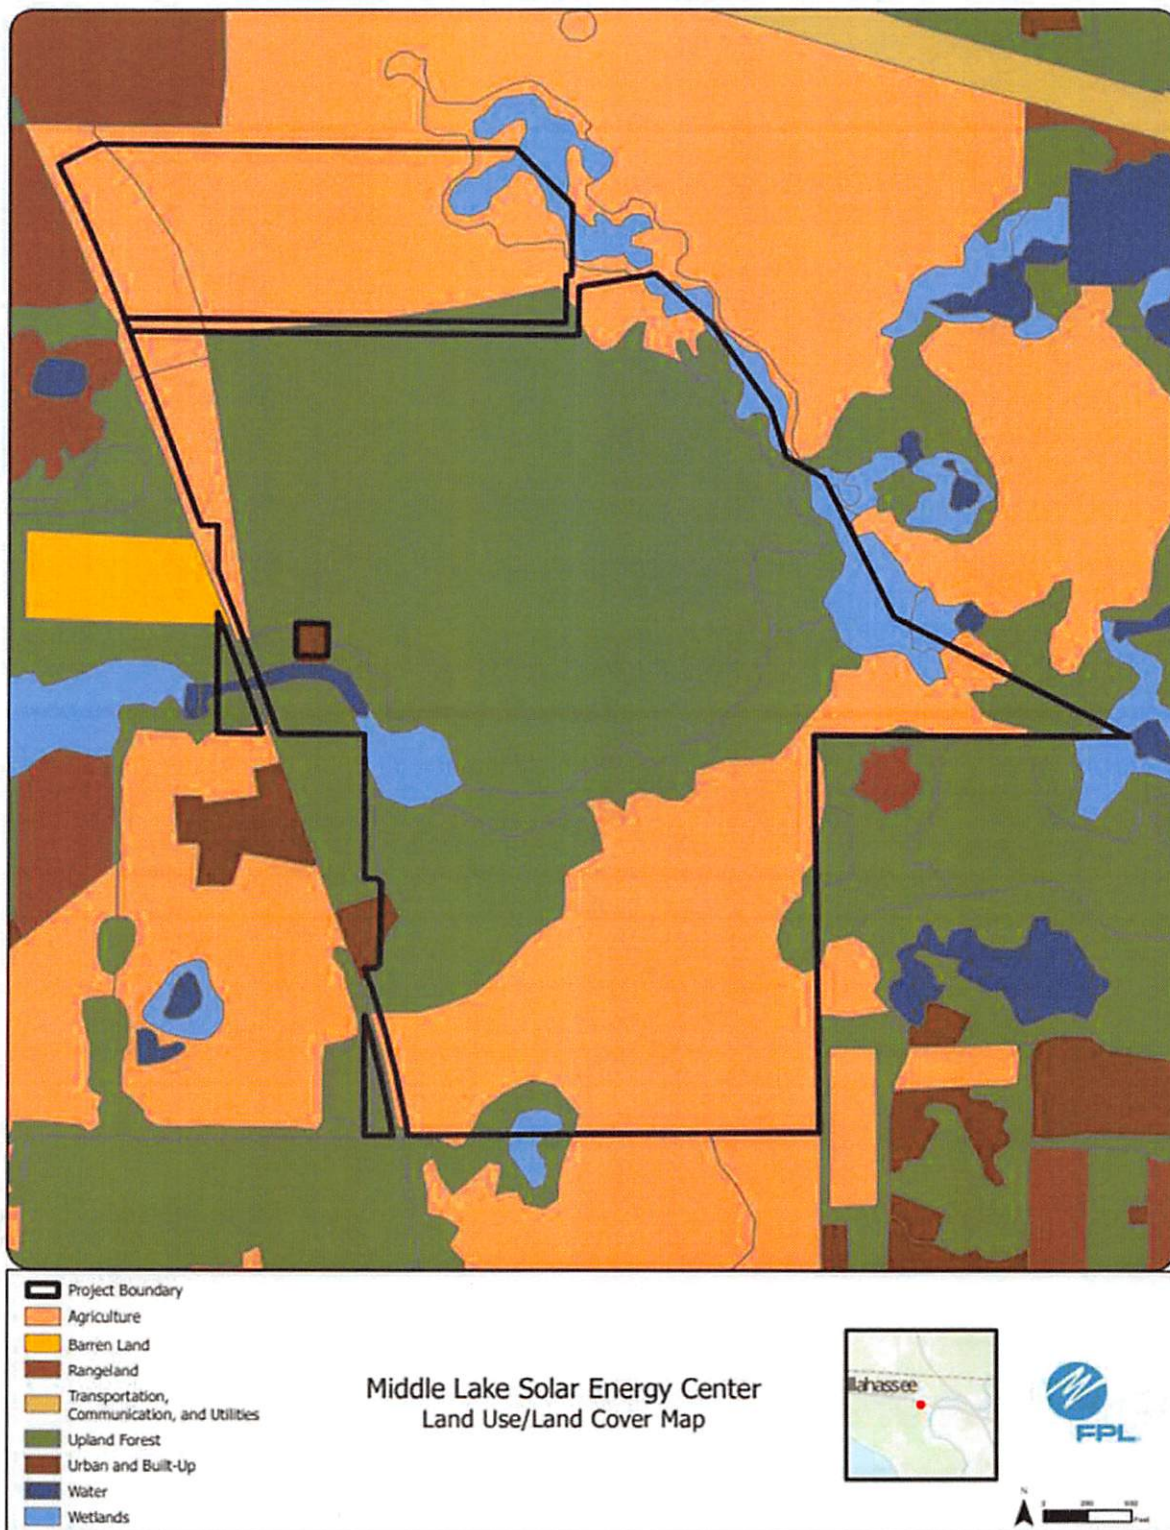





 Middle Lake Solar Energy Center

# Middle Lake Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***


***Preferred Site #18: Ambersweet Solar Energy Center, Indian River  
County***

Preferred Site		Ambersweet Solar Energy Center
County	Indian River	
Facility Acreage	518	
COD	4/30/2027	
For PV facilities: tracking or fixed	Tracking	
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses:		
e. Site	Improved pasture	
Adjacent Areas	Solar, citrus	
General Environment Features On and in the Site Vicinity		
f. 1. Natural Environment	Site is entirely improved pasture with several agricultural ditches	
2. Listed Species	Audubon's crested caracara, wading birds	
3. Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.	
4. Other Significant Features	FPL is not aware of any other significant features of the site.	
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
i. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).	
j. Water Resources	Existing onsite water resources may be used to meet water requirements if permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked from off-site.	
k. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.	
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
o. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
s. Status of Applications	FDEP ERP Issued: 6/27/2024	





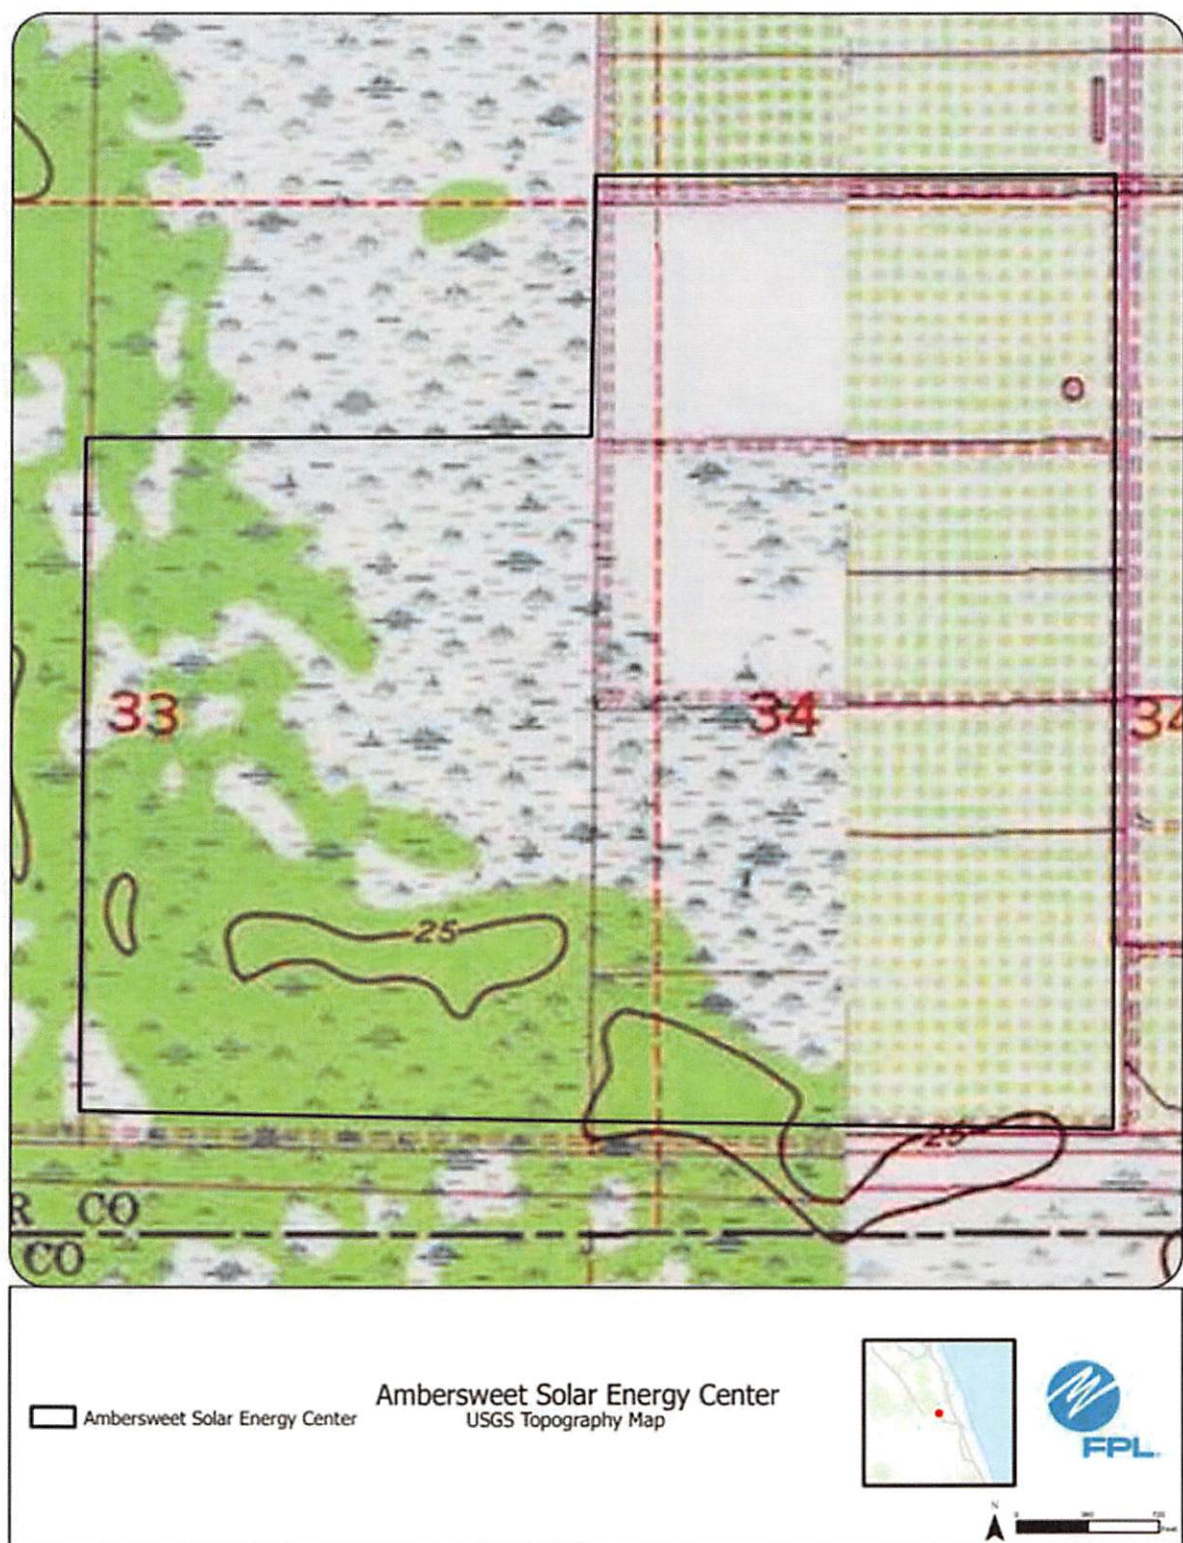



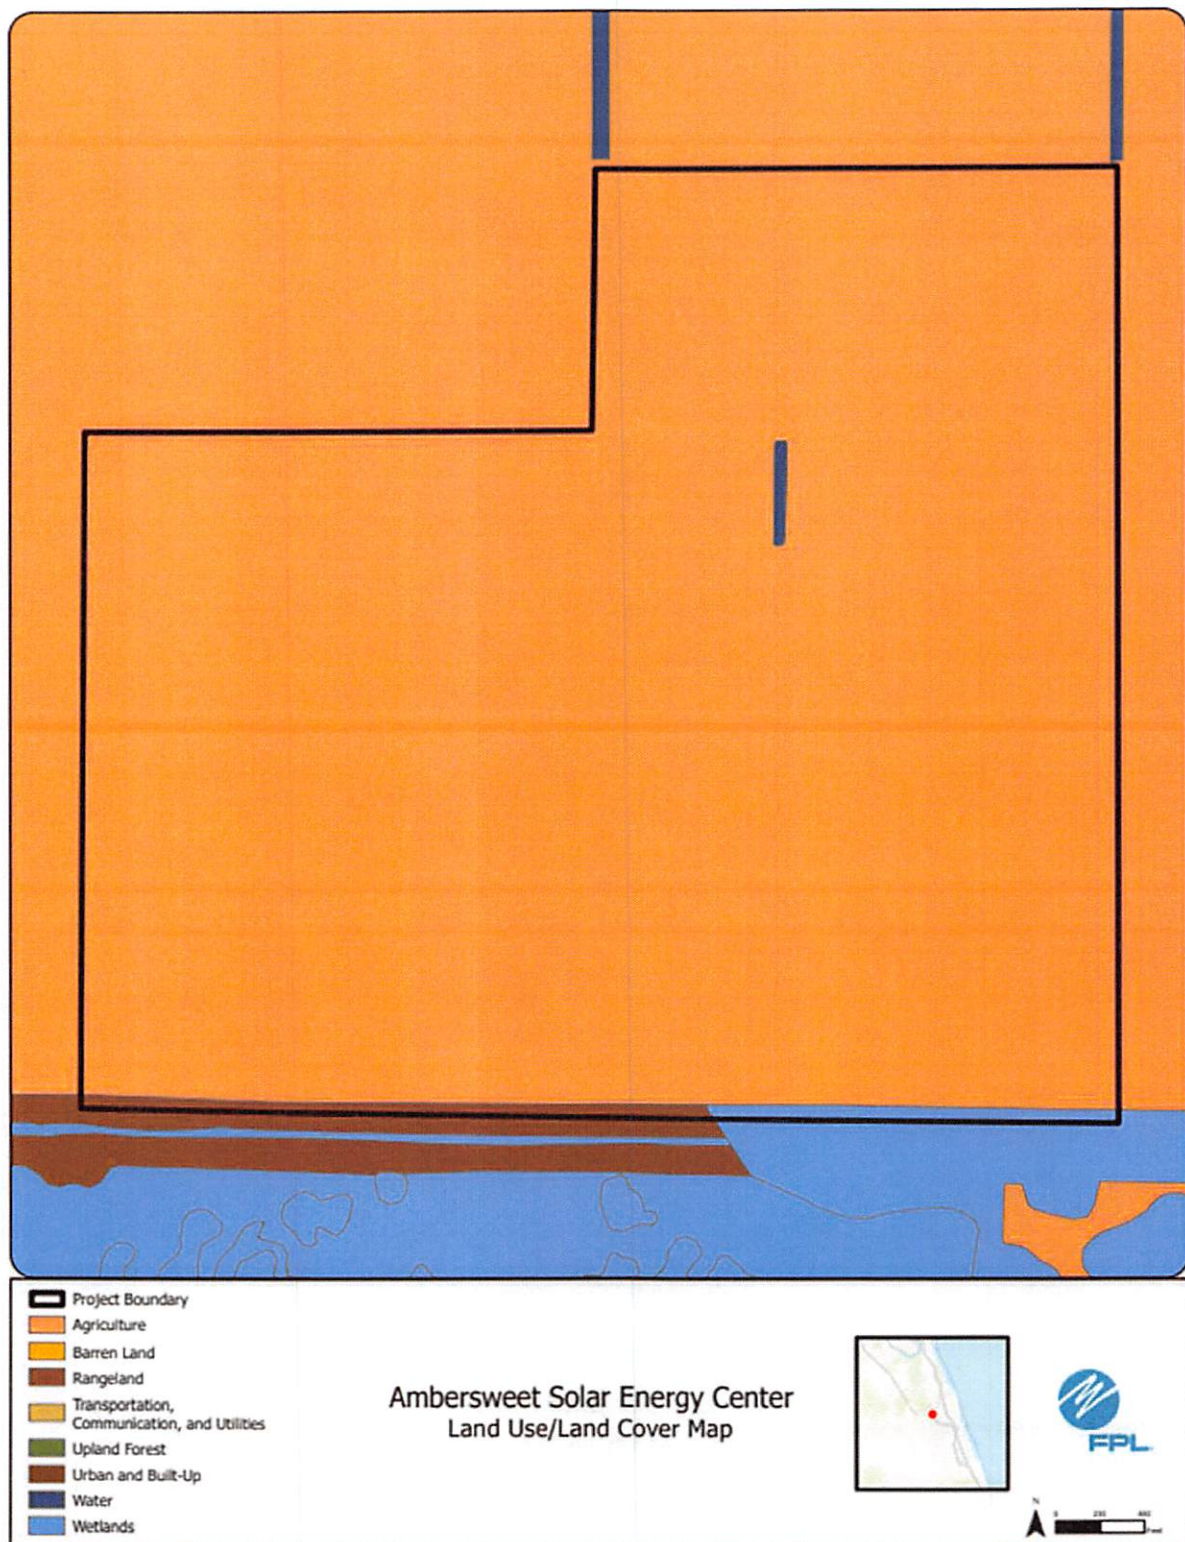



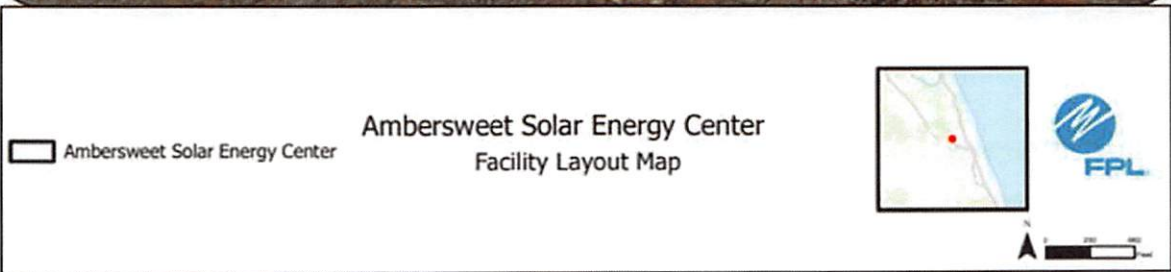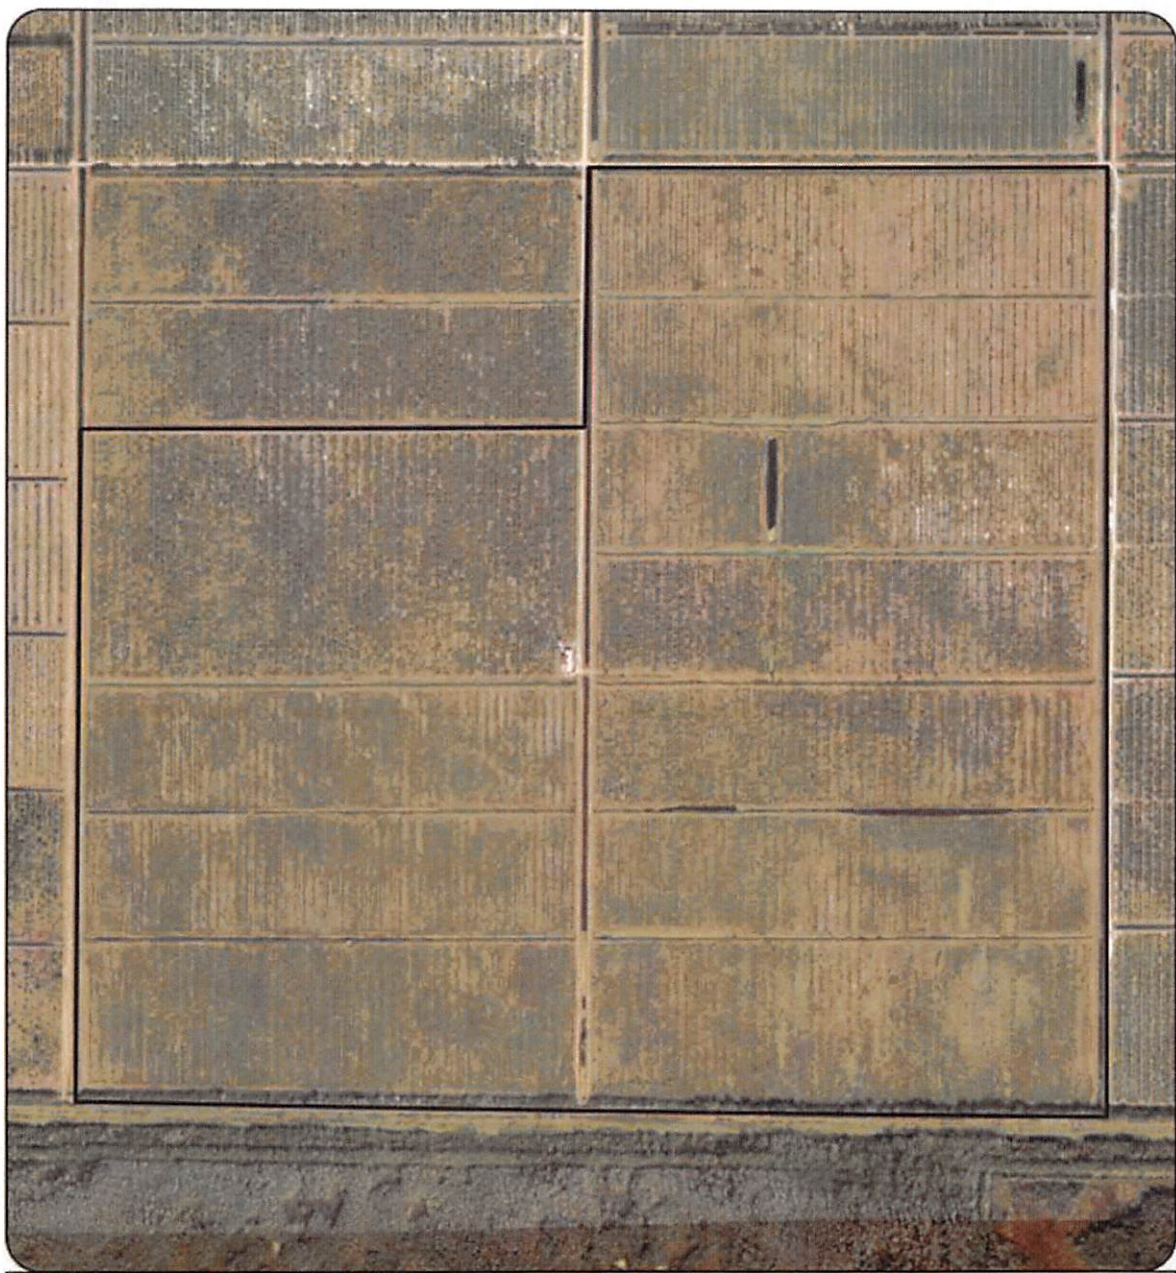



***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #19: County Line Solar Energy Center,  
Charlotte/DeSoto County***

Preferred Site		County Line Solar Energy Center
County	DeSoto/Charlotte	
Facility Acreage	630	
COD	4/30/2027	
For PV facilities: tracking or fixed	Tracking	
Reference Maps		
a. USGS Map	See Figures in the following pages	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
e.	Existing Land Uses	
Site	Citrus and pasture	
Adjacent Areas	Adjacent areas are primarily citrus and other agricultural land	
f.	General Environment Features On and in the Site Vicinity	
1. Natural Environment	Site is primarily citrus	
2. Listed Species	Gopher tortoise and Audubon's crested caracara	
3. Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.	
4. Other Significant Features	FPL is not aware of any other significant features of the site.	
g. Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	
h. Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.	
i. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).	
j. Water Resources	Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.	
k. Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the Central region.	
l. Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall	
m. Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site	
n. Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.	
o. Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.	
q. Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable	
r. Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.	
s. Status of Applications	FDEP ERP Issued: 2/6/2024 FDEP 404 GP Issued: 2/6/2024	



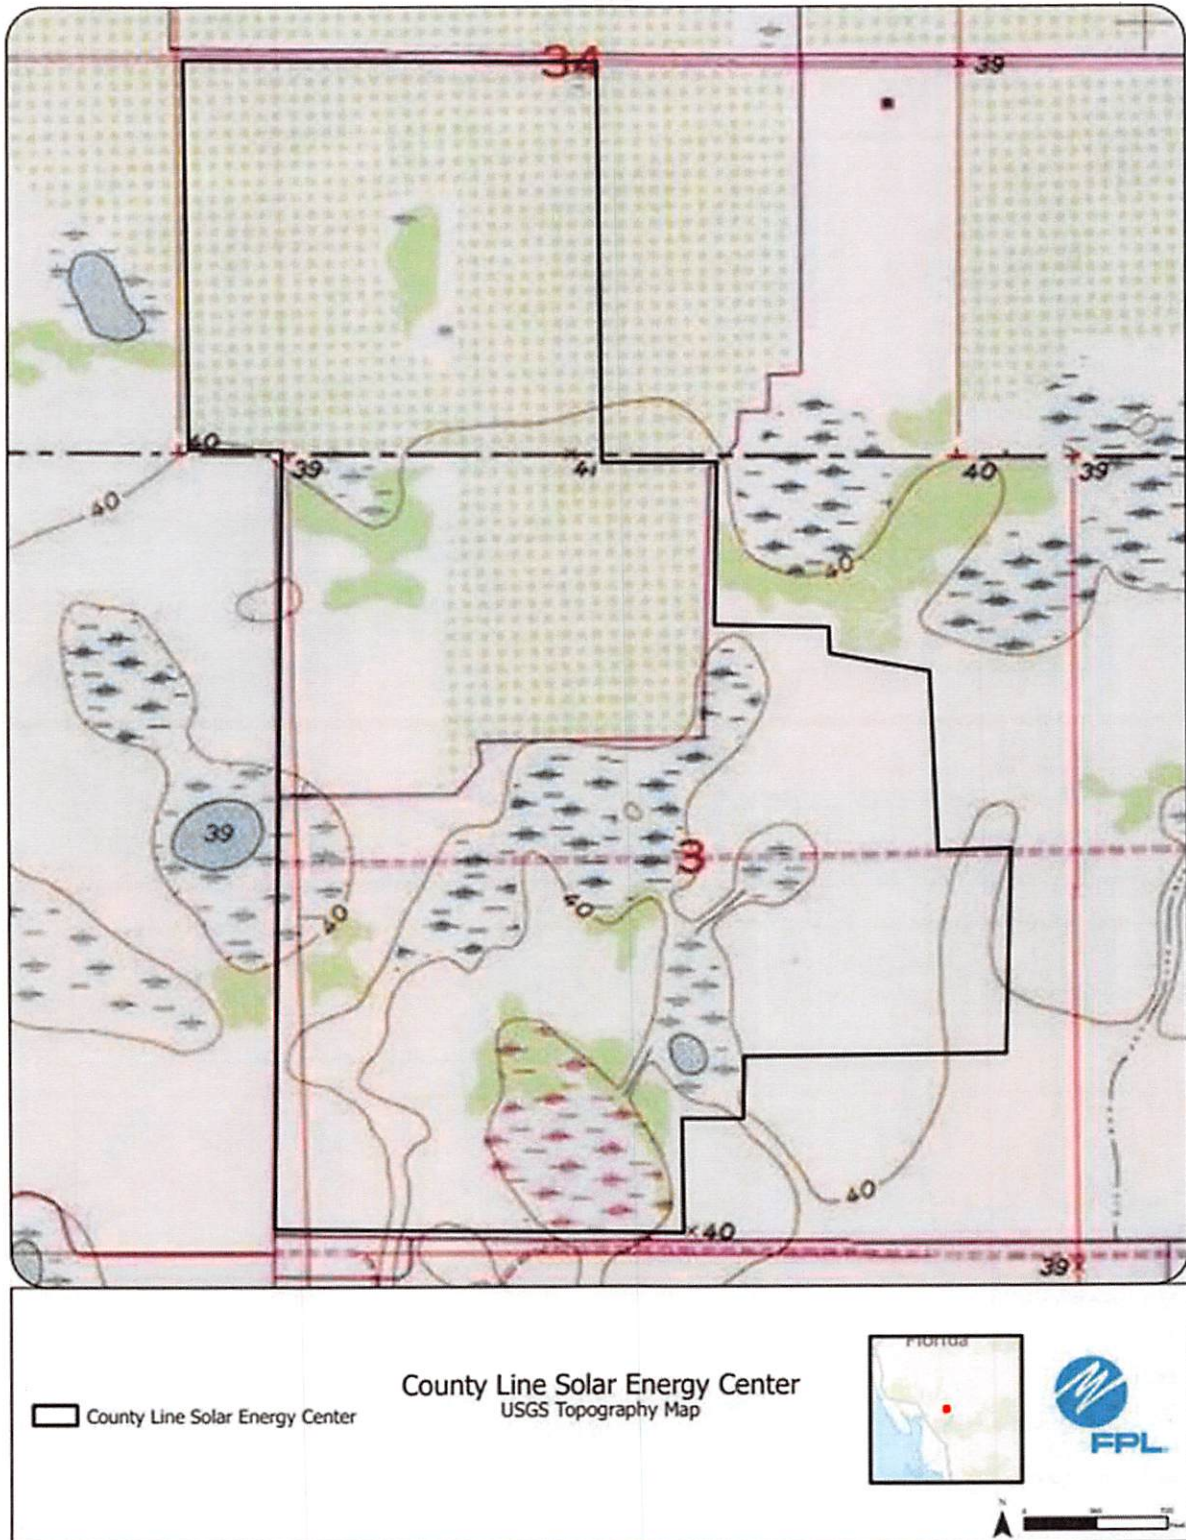

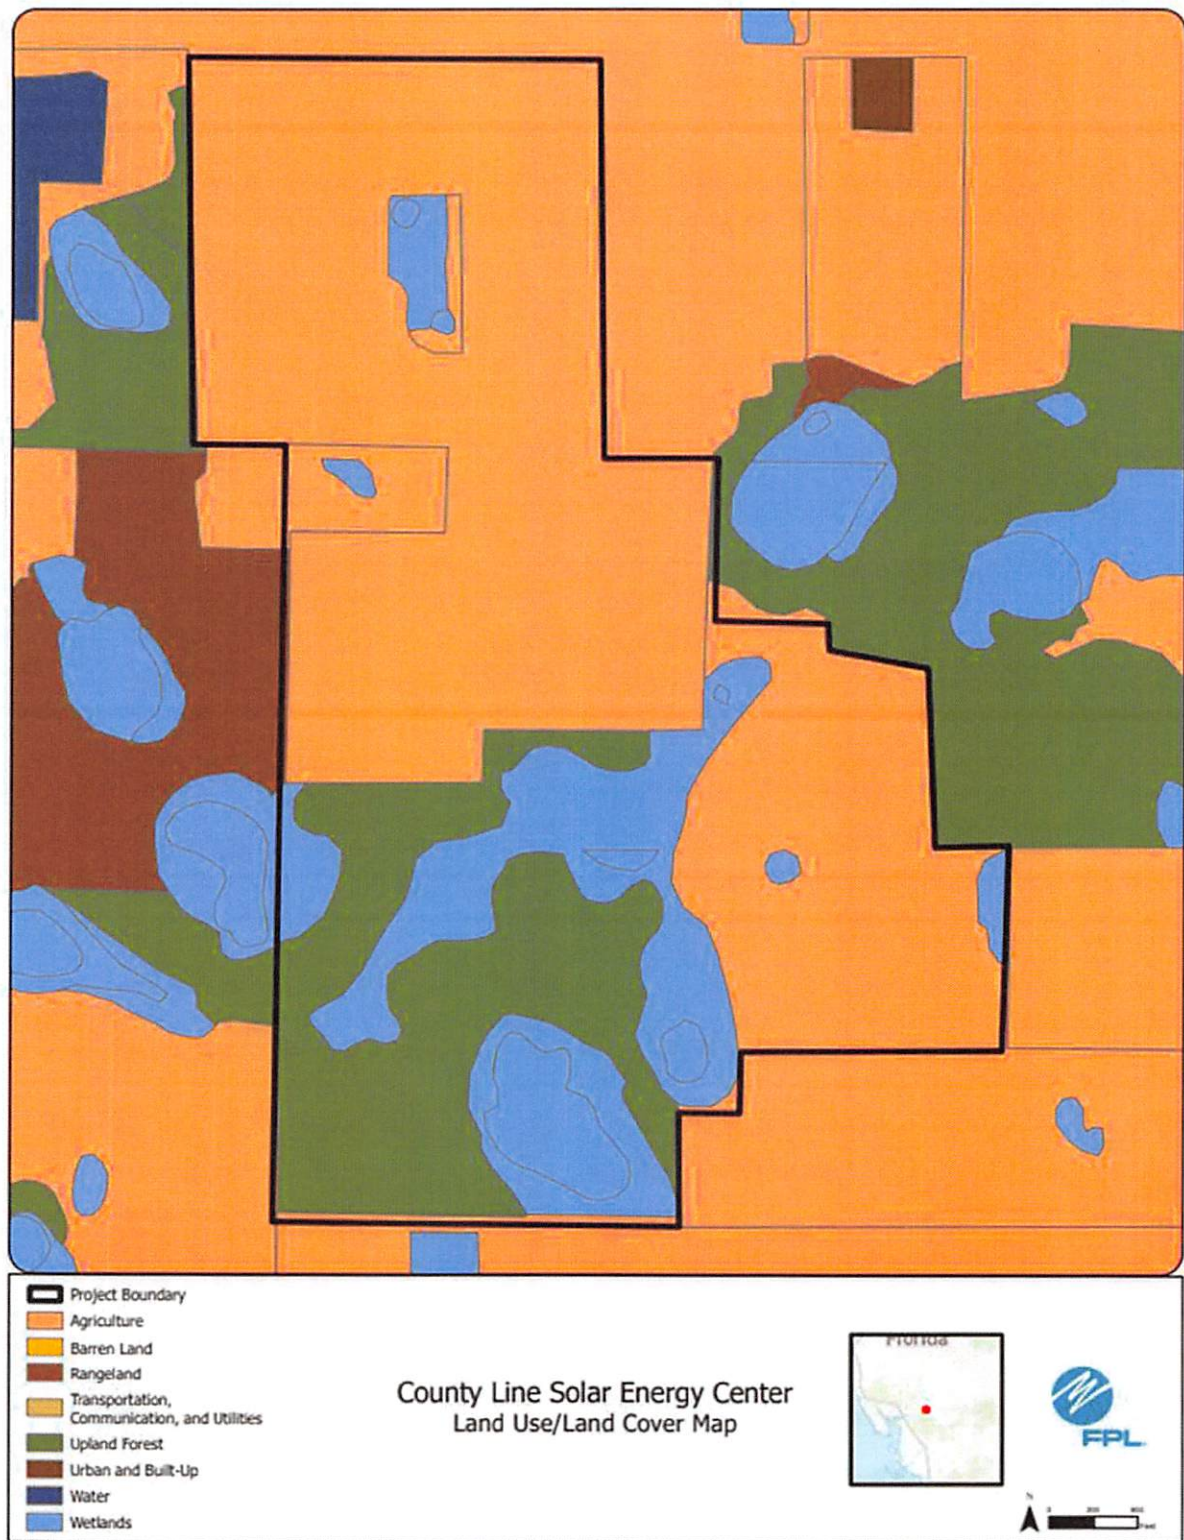





 County Line Solar Energy Center

# County Line Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #20: Saddle Solar Energy Center,  
DeSoto County***



Preferred Site		Saddle Solar Energy Center
County		DeSoto
Facility Acreage		647
COD		4/30/2027
For PV facilities: tracking or fixed		Tracking
Reference Maps		
a. USGS Map		See Figures in the following pages
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
e. Site		Former citrus and row crops
f. Adjacent Areas		Agricultural lands and low density residential
General Environment Features On and in the Site Vicinity		
1. Natural Environment		Site has been cleared of citrus and is currently open fields.
2. Listed Species		Audubon's crested caracara and Florida burrowing owls
3. Natural Resources of Regional Significance Status		Hawthorne Creek and Hog Bay are located just north of the project area.
4. Other Significant Features		FPL is not aware of any significant features nearby.
g. Design Features and Mitigation Options		The design includes a approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUPWUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the Central region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustion Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP issued: 2/29/2024



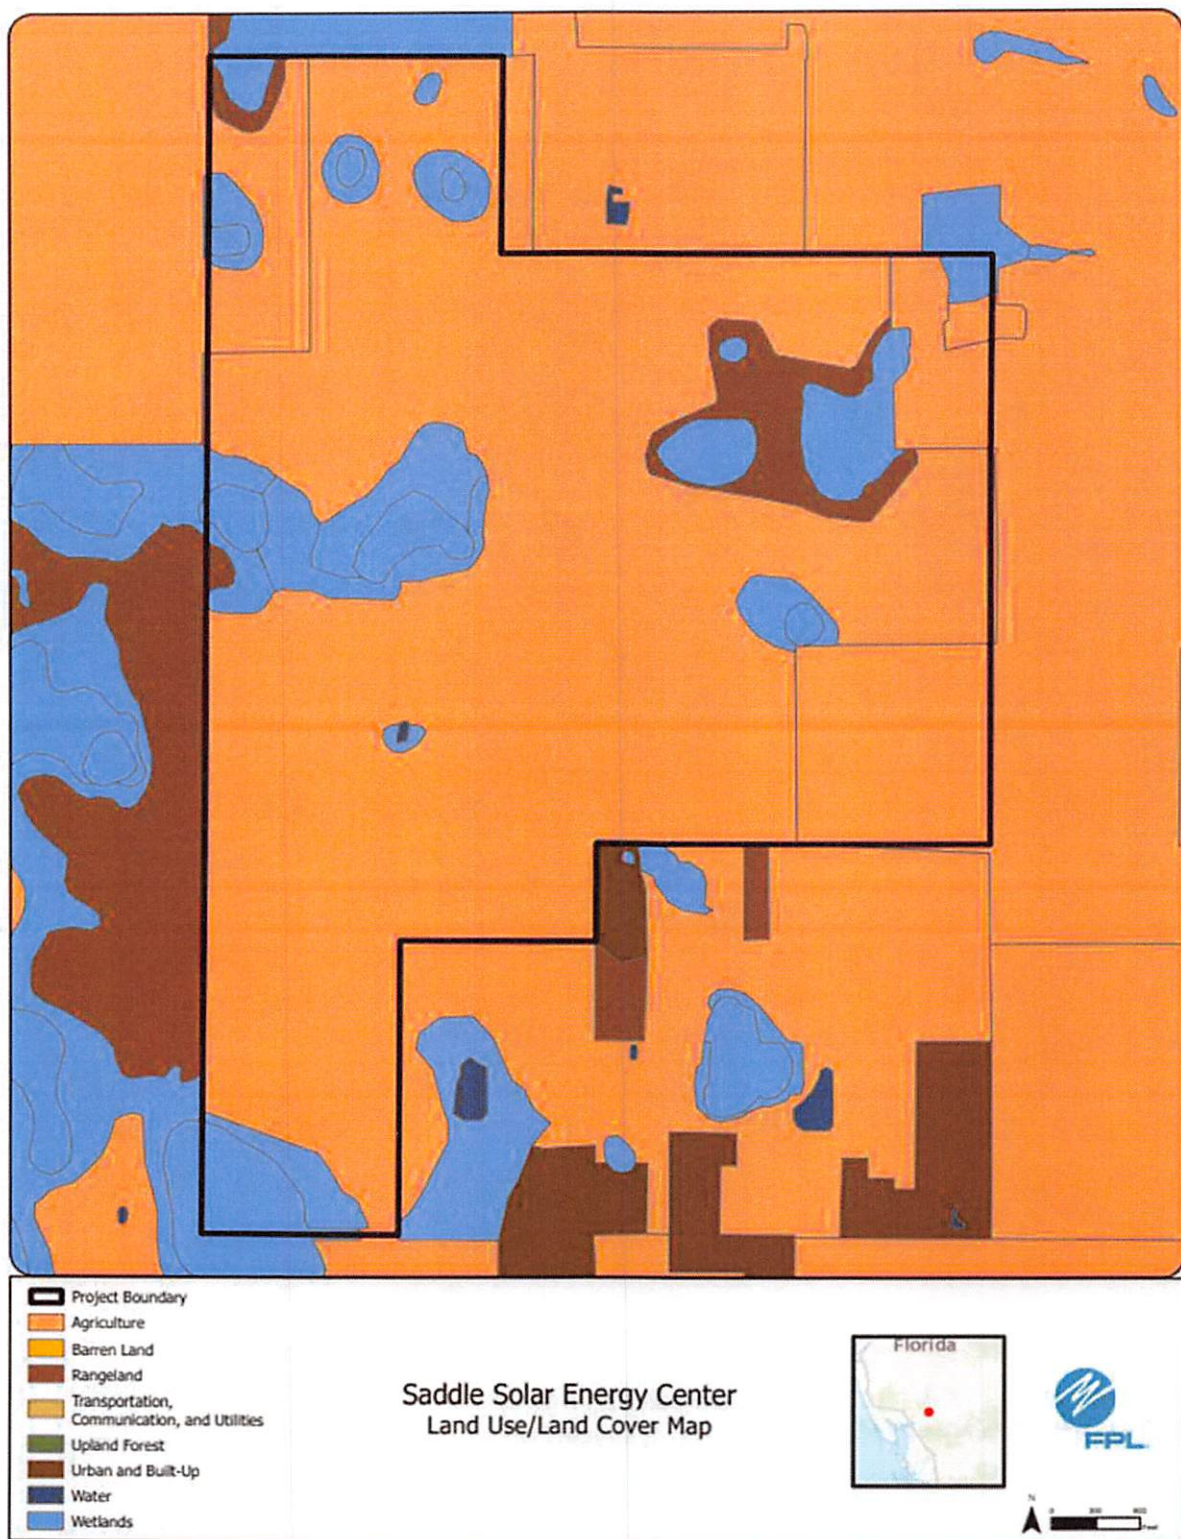





 Saddle Solar Energy Center

# Saddle Solar Energy Center Facility Layout Map



***Site Description, Environmental, and Land Use Information:  
Supplemental Information***


***Preferred Site #21: Cocoplum Solar Energy Center, Hendry County***

Preferred Site		Cocoplum Solar Energy Center
County		Hendry
Facility Acreage		1665 (470 project acres)
COD		7/31/2027
For PV facilities: tracking or fixed		Tracking
Reference Maps		
a. USGS Map		See Figures in the following pages
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
e.		Existing Land Uses
Site		Agricultural pasture, agricultural ditches, and wetlands
Adjacent Areas		Various agriculture, above ground impoundment, and SR80
f.		General Environment Features On and in the Site Vicinity
1. Natural Environment		The entire property consists of improved pasture with agricultural ditches and some natural wetlands.
2. Listed Species		Audubon's crested caracara, wading birds
3. Natural Resources of Regional Significance Status		Large, aboveground impoundment located adjacent to site.
4. Other Significant Features		FPL is not aware of any other significant features of the site.
g. Design Features and Mitigation Options		The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.)
j. Water Resources		Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the South region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP 404 NPR Issued: 9/14/2023 FDEP ERP Issued: 9/14/2023







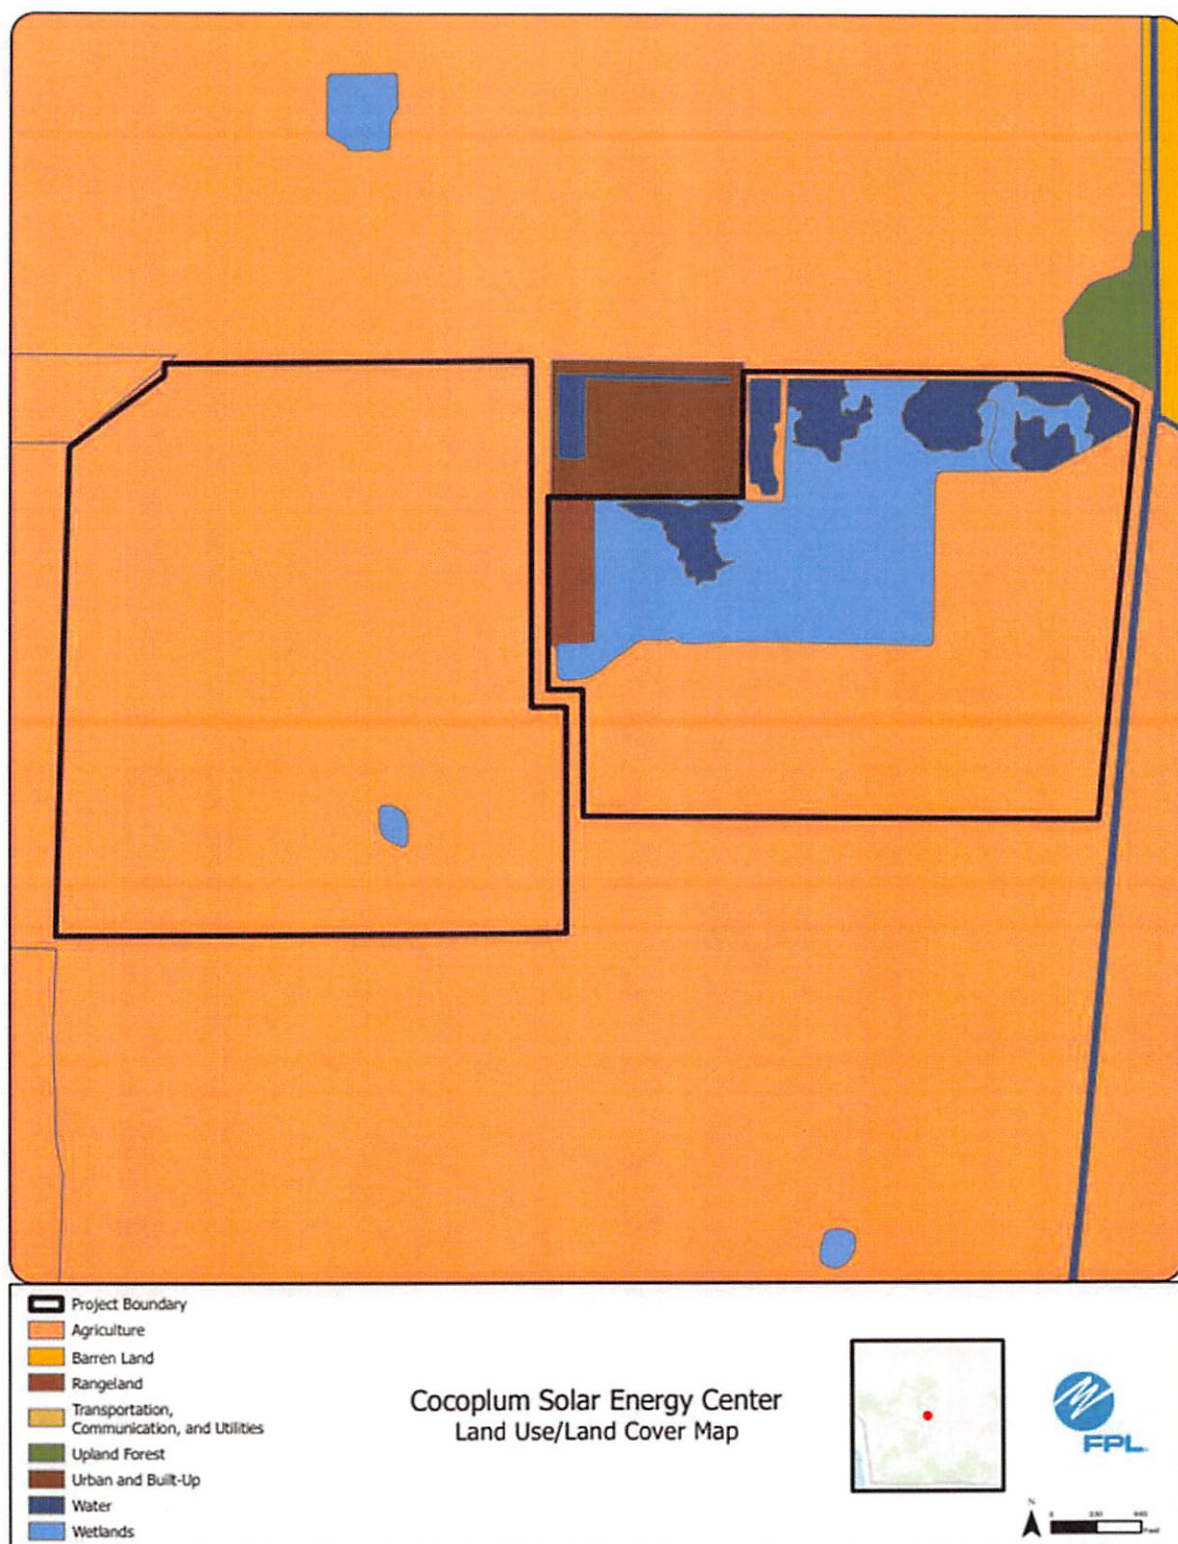






 Cocoplum Solar Energy Center

### Cocoplum Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #22: Catfish Solar Energy Center, Okeechobee County***

Preferred Site		Catfish Solar Energy Center
a.	County	Okeechobee
b.	Facility Acreage	1525 (837 project acres)
c.	COD	7/31/2027
d.	For PV facilities: tracking or fixed	Tracking
Reference Maps		
a.	USGS Map	See Figures in the following pages
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
Existing Land Uses		
e.	Site	Predominantly improved pasture and woodland pasture
f.	Adjacent Areas	Solar, residential
General Environment Features On and In the Site Vicinity		
1.	Natural Environment	Site is improved pasture with some interspersed forested and herbaceous wetlands.
2.	Listed Species	Gopher tortoise, Audubon's crested caracara, Florida burrowing owl
3.	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4.	Other Significant Features	Historic Evergreen Cemetery located just NW of project area.
g.	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h.	Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j.	Water Resources	Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked from off-site.
k.	Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.
l.	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel, therefore there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	FDEP ERP Issued: 11/27/2023





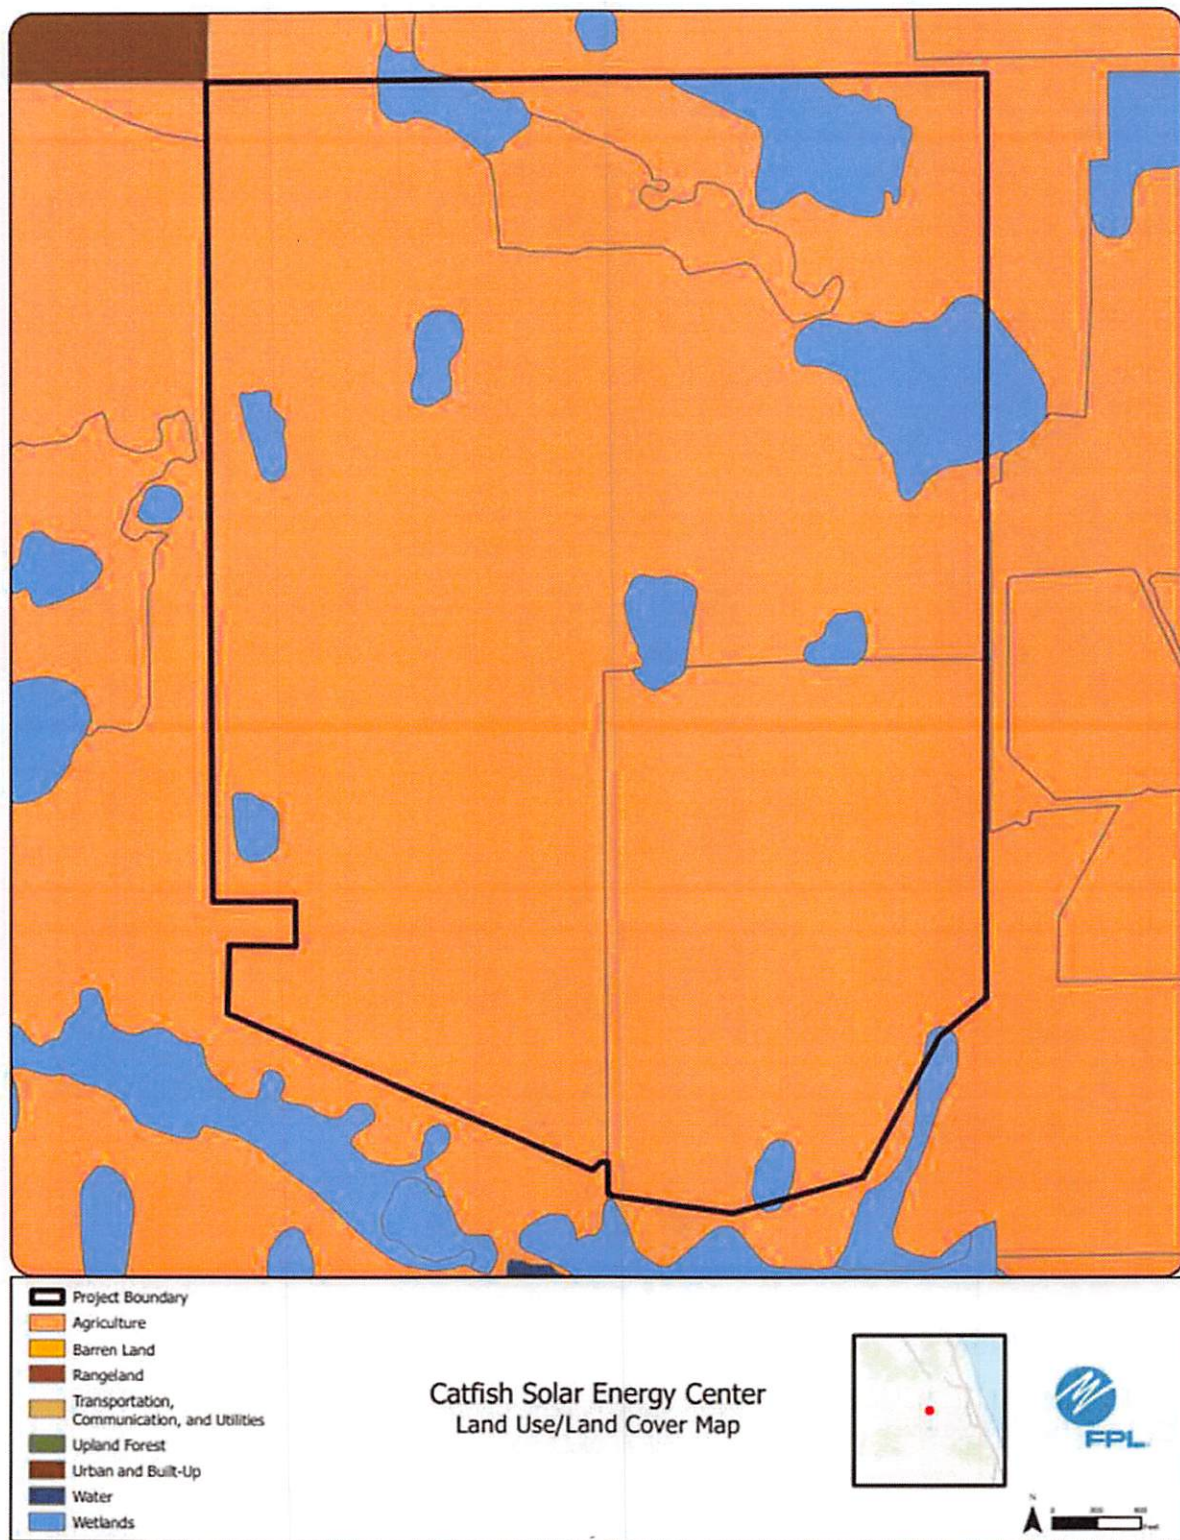





 Catfish Solar Energy Center

# Catfish Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #23: Hardwood Hammock Solar Energy Center, Walton  
County***


County	Watson	Hardwood Hammock Solar Energy Center
Facility Acreage	750	
COO	7/8/12/07	
For PV facilities: tracking or fixed	Tracking	
USGS Map	See Figures in the following pages	
Proposed Facilities Layout		
Map of Site and Adjacent Areas		
Land Use Map of site and Adjacent Areas		
Site		
Adjacent Areas	Prime and wetlands	
	Primarily pine	
	General Environment Features On and in the Site Vicinity	
1	Natural Environment	Site is primarily pine and wetlands.
2	Listed Species	Gopher tortoise
3	Natural Resources of Regional Significance Status	No natural resources of regional significance status at or adjacent to the site.
4	Other Significant Features	FPL is not aware of any other significant features of the site.
5	Design Features and Mitigation Options	The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
6	Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
7	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.)
8	Water Resources	Existing CUP/MURP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.
9	Geological Features of Site and Adjacent Areas	See Figures in the following pages. Site located in the Panhandle region.
10	Project Water Quantities for Various Uses	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
11	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
12	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
13	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
14	Air Emissions and Control Systems	Solar does not require fuel and no waste products will be generated at the site.
15	Noise Emissions and Control Systems	Need for Control Systems: Combustion Control - Not Applicable Combustion Design - Not Applicable
16	Status of Applications	USACE 404 issued 9/29/24 FDEP ERP issued 9/10/24
17		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.



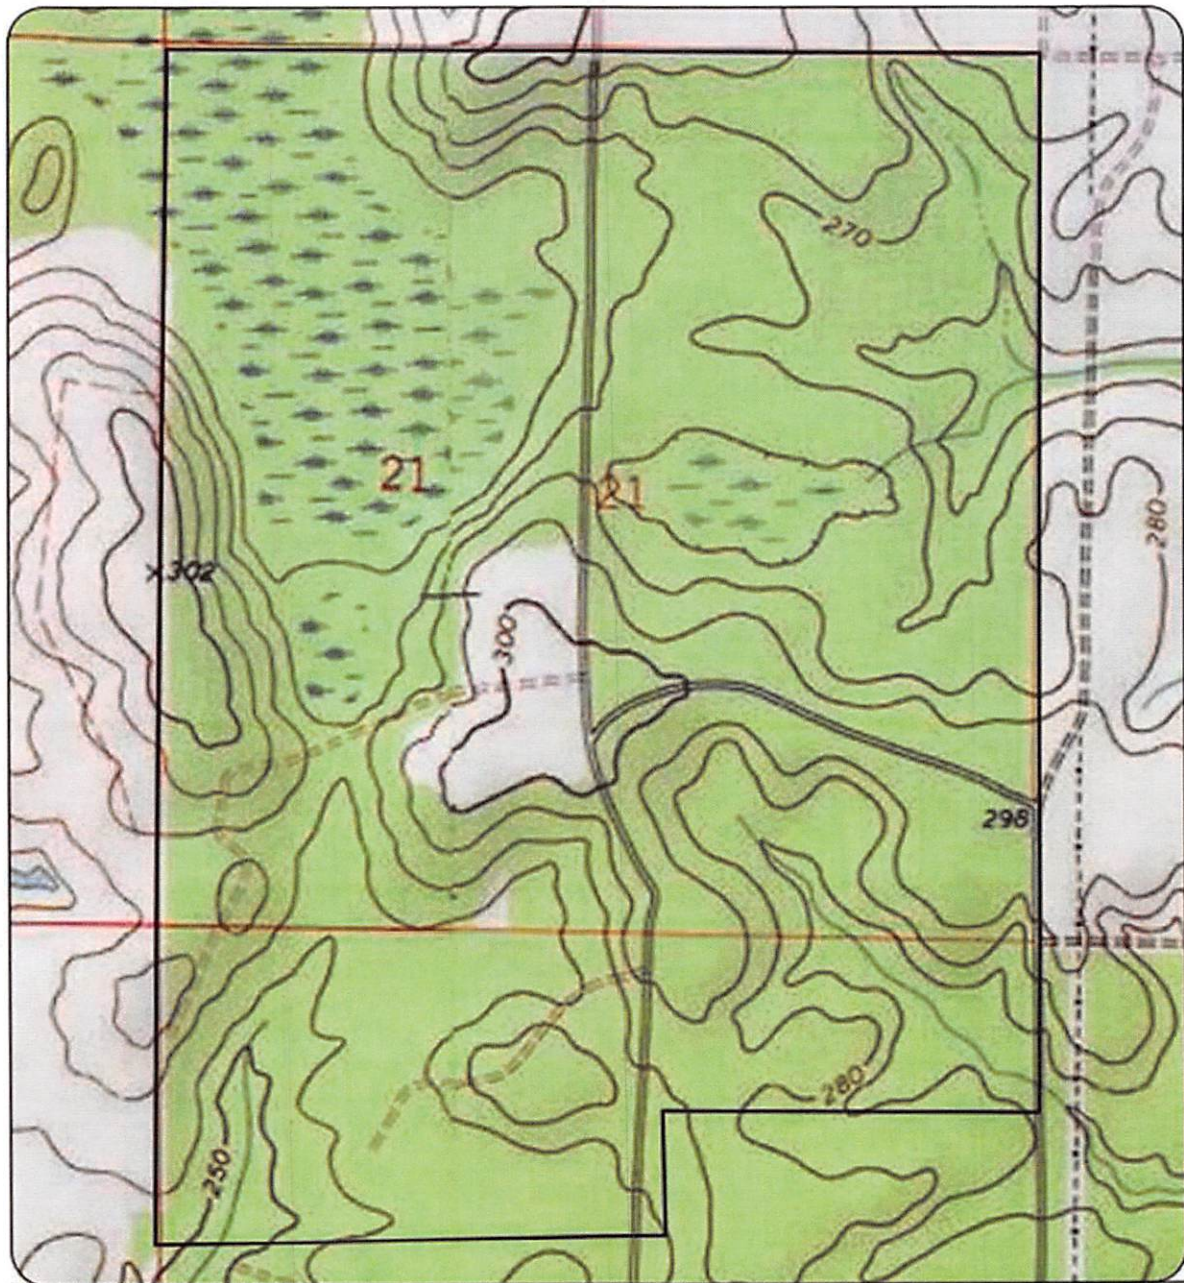


Hardwood Hammock Solar Energy Center  
USGS Topography Map

Hardwood Hammock Solar Energy Center





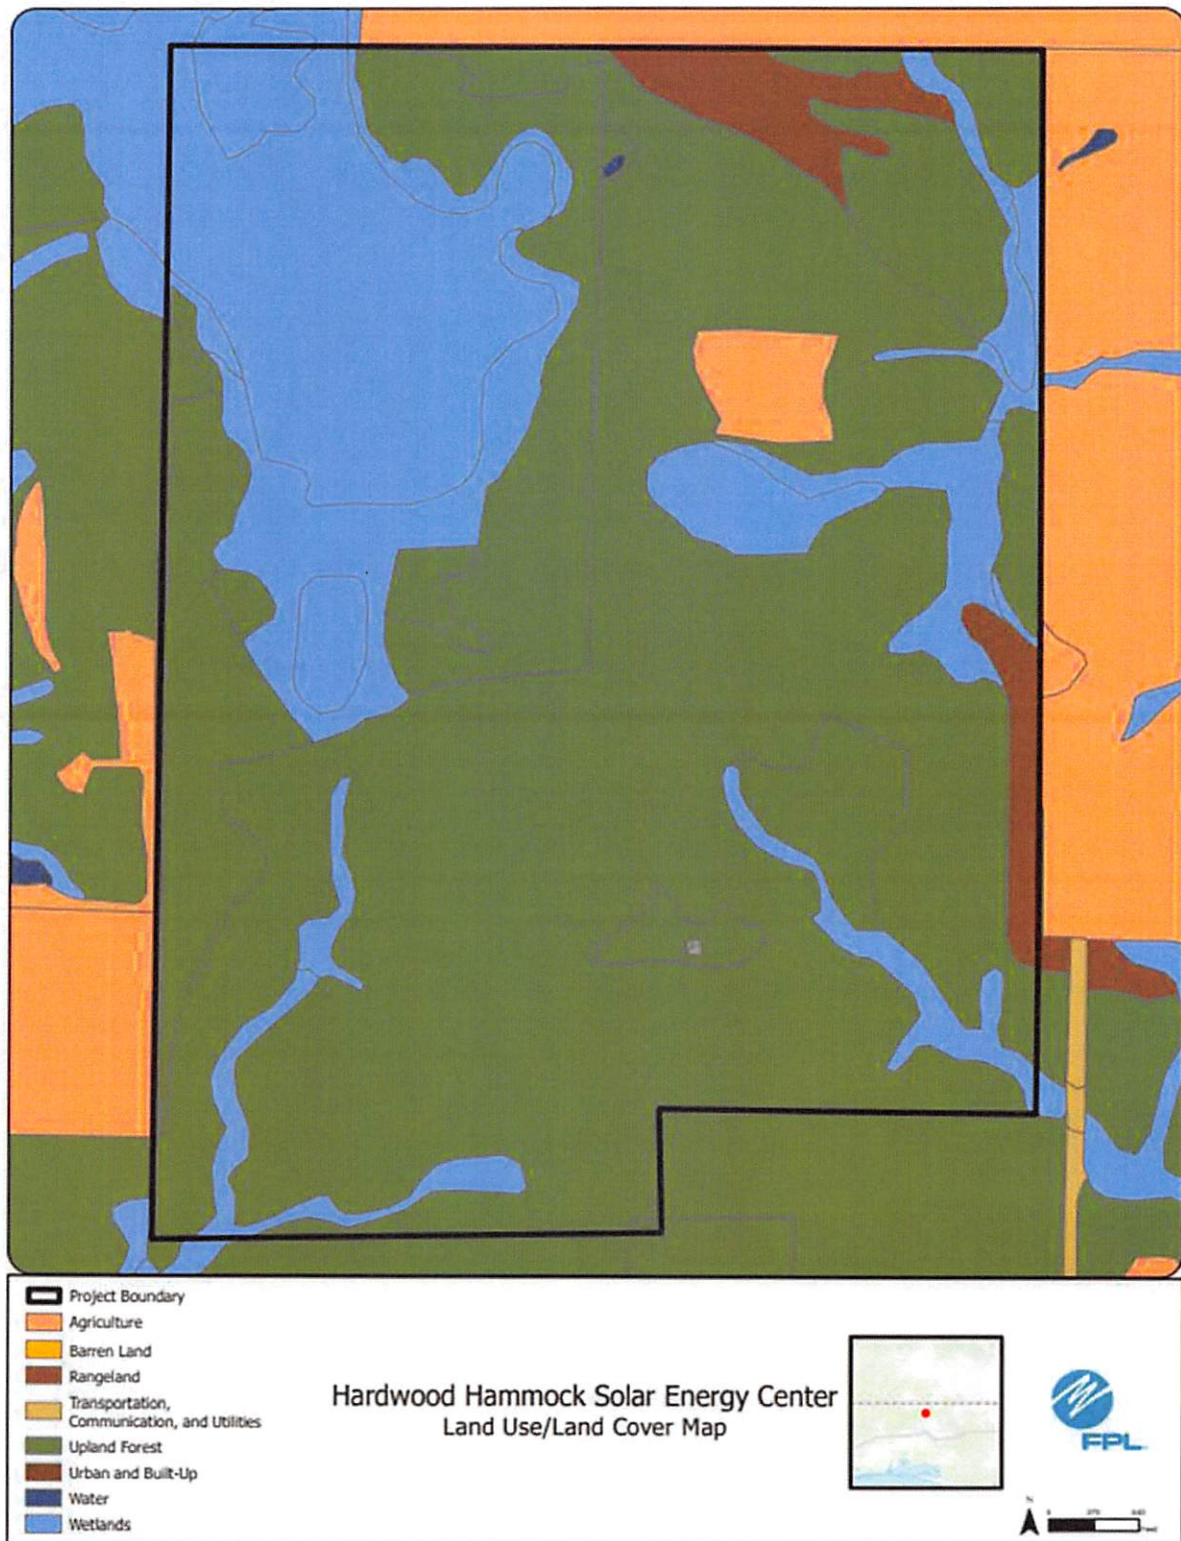






# Hardwood Hammock Solar Energy Center Facility Layout Map

 Hardwood Hammock Solar Energy Center




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***


***Preferred Site #24: Maple Trail Solar Energy Center, Baker County***

Preferred Site	Maple Trail Solar Energy Center	Baker	2430 (930 project acres)	7/31/2027	Tracking	Reference Maps	See Figures in the following pages	USGS Map	Proposed Facilities Layout	Map of Site and Adjacent Areas	Land Use Map of Site and Adjacent Areas	Site	Adjacent Areas	General Environment Features On and in the Site Vicinity	1. Natural Environment The site is dominated by silviculture with a natural creek system, wetlands, and other surface waters also present on site. 2. Listed Species Gopher tortoise 3. Natural Resources of Regional Significance Status Natural creek running through the site. 4. Other Significant Features FPL is not aware of any other significant features of the site. 5. Design Features and Mitigation Options The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation. 6. Local Government Future Land Use Designations Solar facilities are permitted in unincorporated agriculturally zoned areas at this time. 7. Site Selection Criteria Factors The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.). 8. Water Resources Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-title criteria. Otherwise, water will need to be trucked in from off-site. 9. Geological Features of Site and Adjacent Areas See Figures in the following page. Site is located in the Panhandle region. 10. Project Water Quantities for Various Uses Cooling: Not Applicable for Solar Process: Not Applicable for Solar Purification: Minimal 11. Water Supply Sources by Type Cooling: Not Applicable for Solar Process: Not Applicable for Solar Purification: On-site well or surface water or delivered to site 12. Water Conservation Strategies Under Consideration Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover. 13. Water Discharges and Pollution Control Solar does not require fuel and no waste products will be generated at the site. 14. Pollution Control Solar does not require fuel and no waste products will be generated at the site. 15. Air Emissions and Control Systems Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for control systems. Combustion Control - Not Applicable Combustion Design - Not Applicable 16. Noise Emissions and Control Systems PV Solar energy generation does not emit noise therefore there will be no need for noise control systems. 17. Status of Applications FDEP ERP issued: 9/3/2024 USACE 404 Permit issued: 1/28/2025
----------------	---------------------------------	-------	--------------------------	-----------	----------	----------------	------------------------------------	----------	----------------------------	--------------------------------	---	------	----------------	--	--



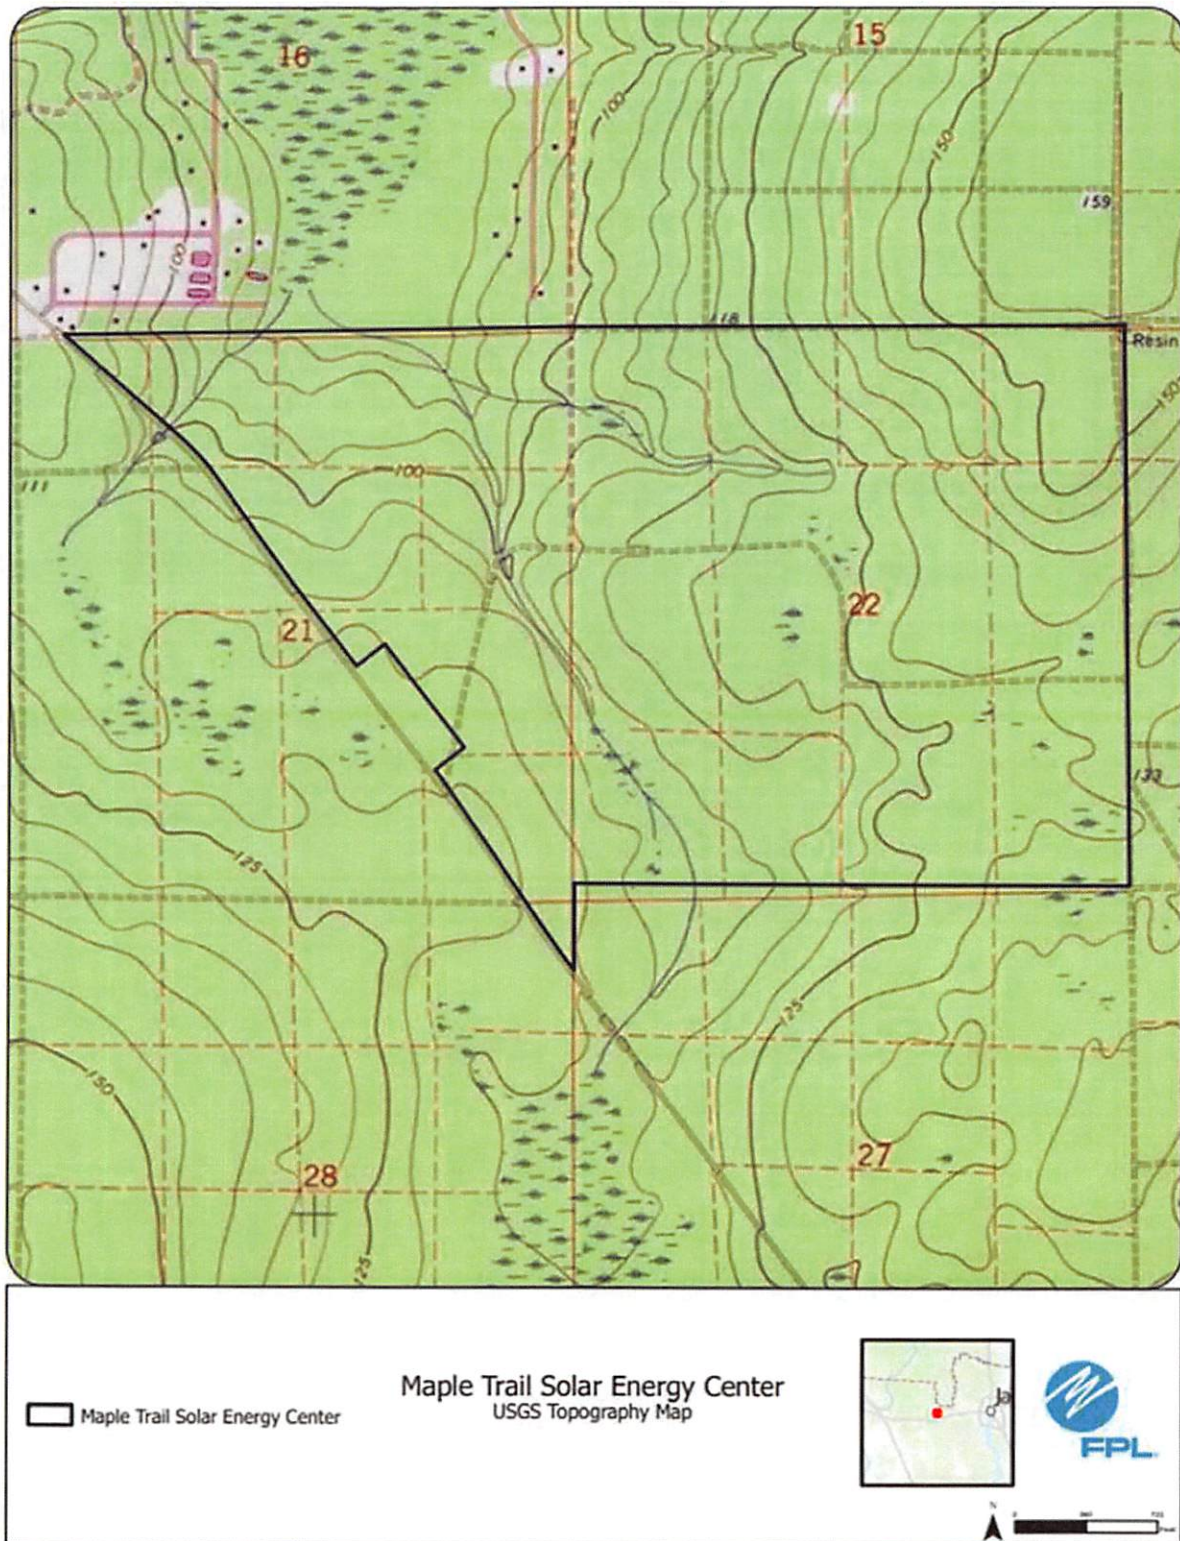



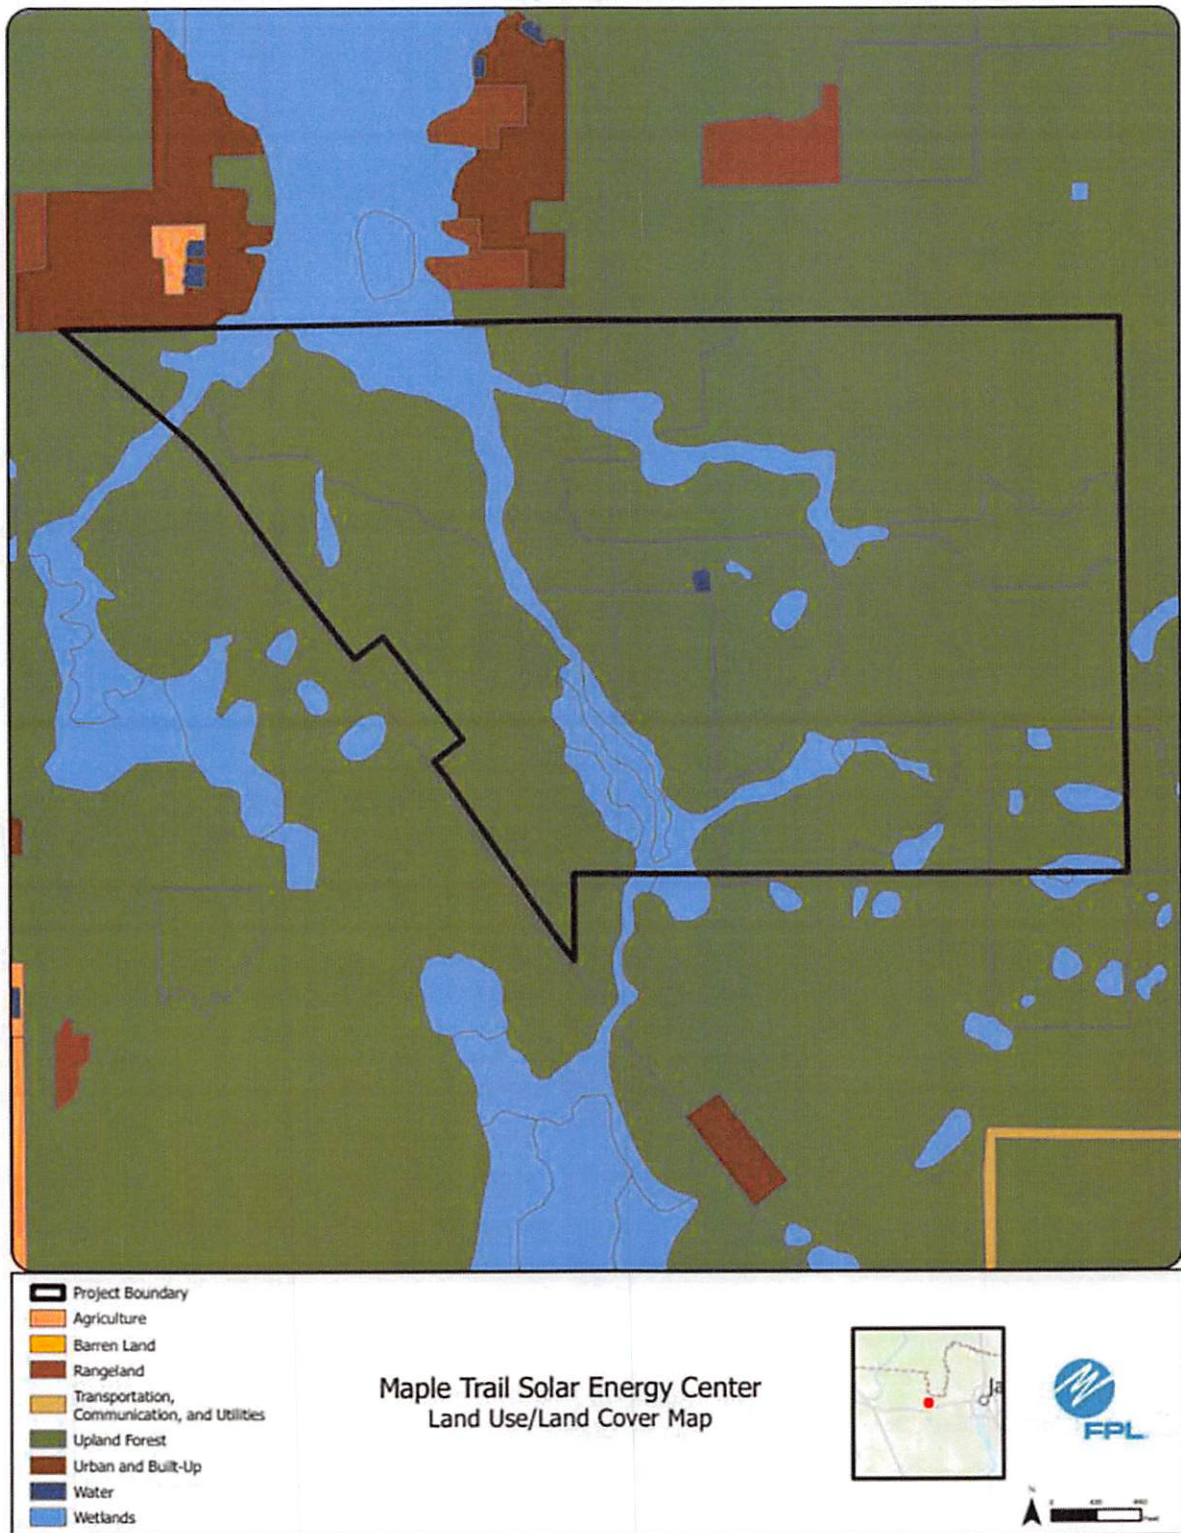





 Maple Trail Solar Energy Center

# Maple Trail Solar Energy Center Facility Layout Map





***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #25: Pinecone Solar Energy Center, Calhoun County***

Preferred Site		Pinecone Solar Energy Center
County		Calhoun
Facility Acreage		1220.29 (438 project area)
COD		10/31/2027
For PV facilities: tracking or fixed		Tracking
Reference Maps		
a. USGS Map		See Figures in the following pages
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
e.		Existing Land Uses
Site		Silviculture, hunting
Adjacent Areas		Timber, croplands, horse farms
f.		General Environment Features On and in the Site Vicinity
1. Natural Environment		Site is primarily silviculture with some forested wetlands
2. Listed Species		Gopher tortoise, eastern indigo snake
3. Natural Resources of Regional Significance Status		Chipola Experimental Forest and Juniper Creek Wildlife Management Area to South of property.
4. Other Significant Features		FPL is not aware of any other significant features of the site.
g. Design Features and Mitigation Options		The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing onsite water resources may be used to meet water requirements if permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the Panhandle region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP Issued: 2/3/2025




 Pinecone Solar Energy Center

Pinecone Solar Energy Center  
USGS Topography Map





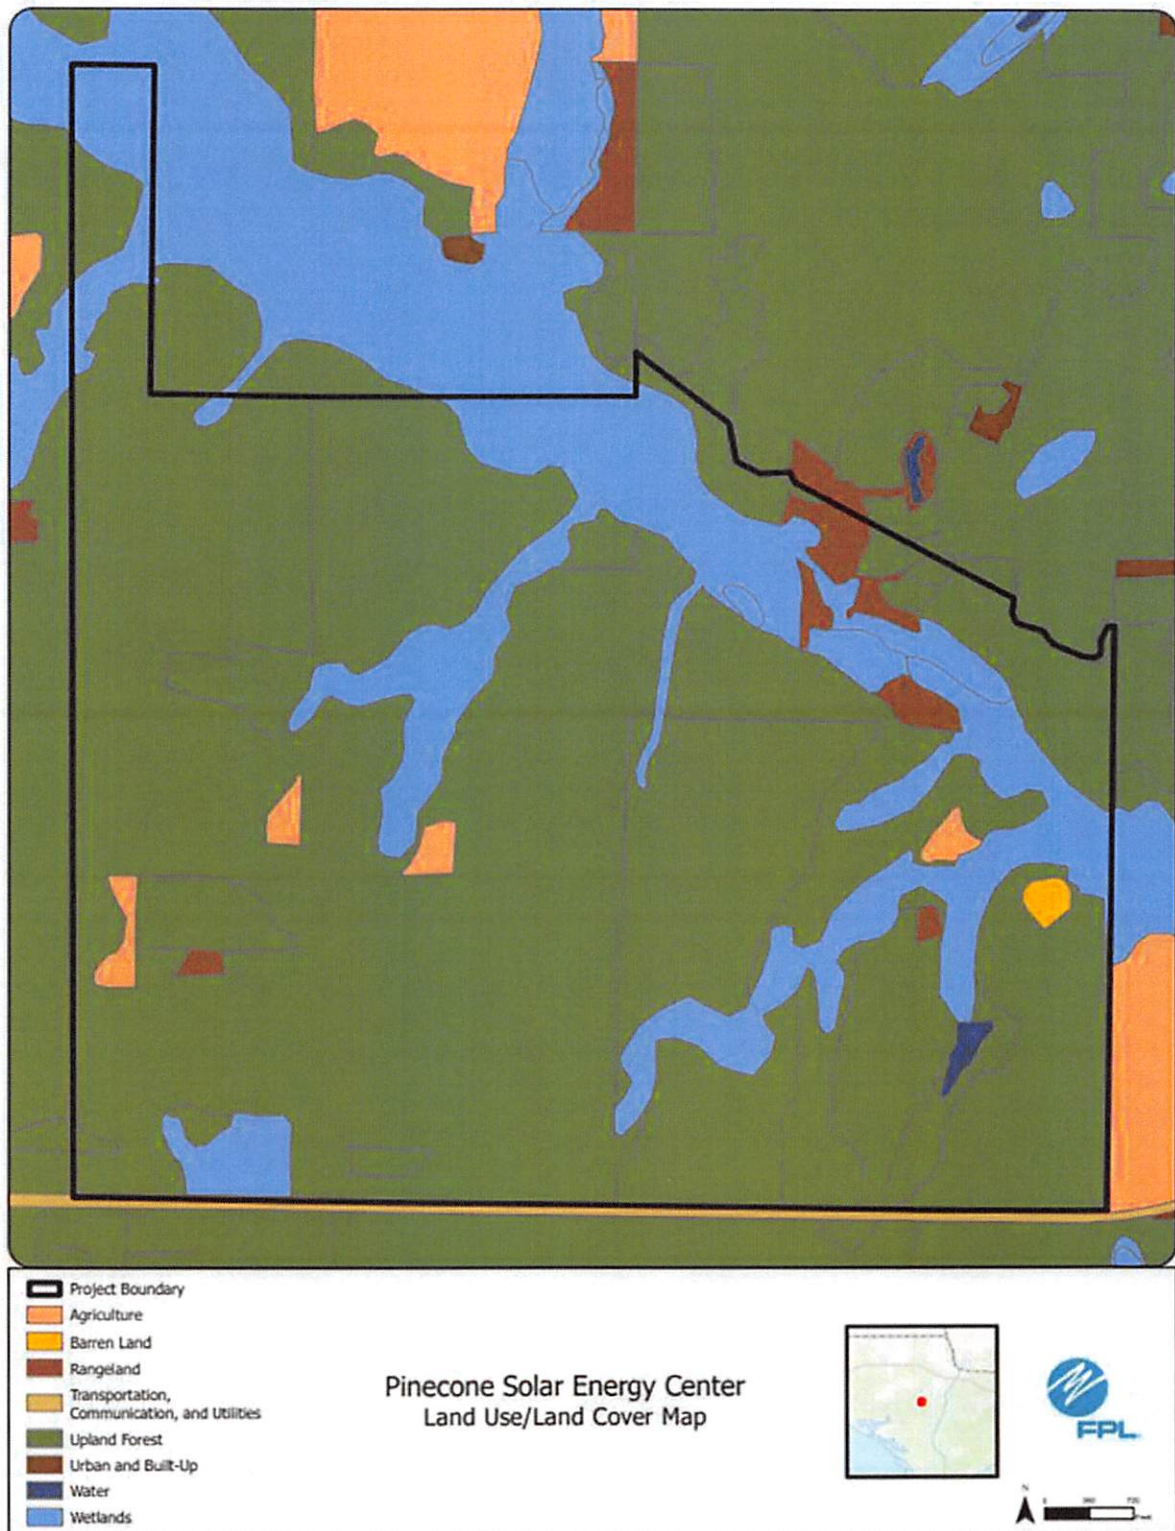



 Pinecone Solar Energy Center

# Pinecone Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #26: Joshua Creek Solar Energy Center, DeSoto  
County***



Preferred Site		Joshua Creek Solar Energy Center
County		DeSoto
Facility Acreage		621
COD		10/31/2027
For PV facilities: tracking or fixed		Tracking
		(Reference Maps)
a. USGS Map		See Figures in the following pages
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
		(Existing Land Uses)
e. Site		Row crops
f. Adjacent Areas		Agricultural lands and low density residential
		(General Environment Features: On and in the Site Vicinity)
1. Natural Environment		Site is row crop fields with some wetland features around the property.
2. Listed Species		Audubon's crested caracara
3. Natural Resources of Regional Significance Status		Joshua Creek
4. Other Significant Features		FPL is not aware of any significant features nearby.
g. Design Features and Mitigation Options		The design includes a approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUPWUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the Central region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP Issued: 4/24/2024

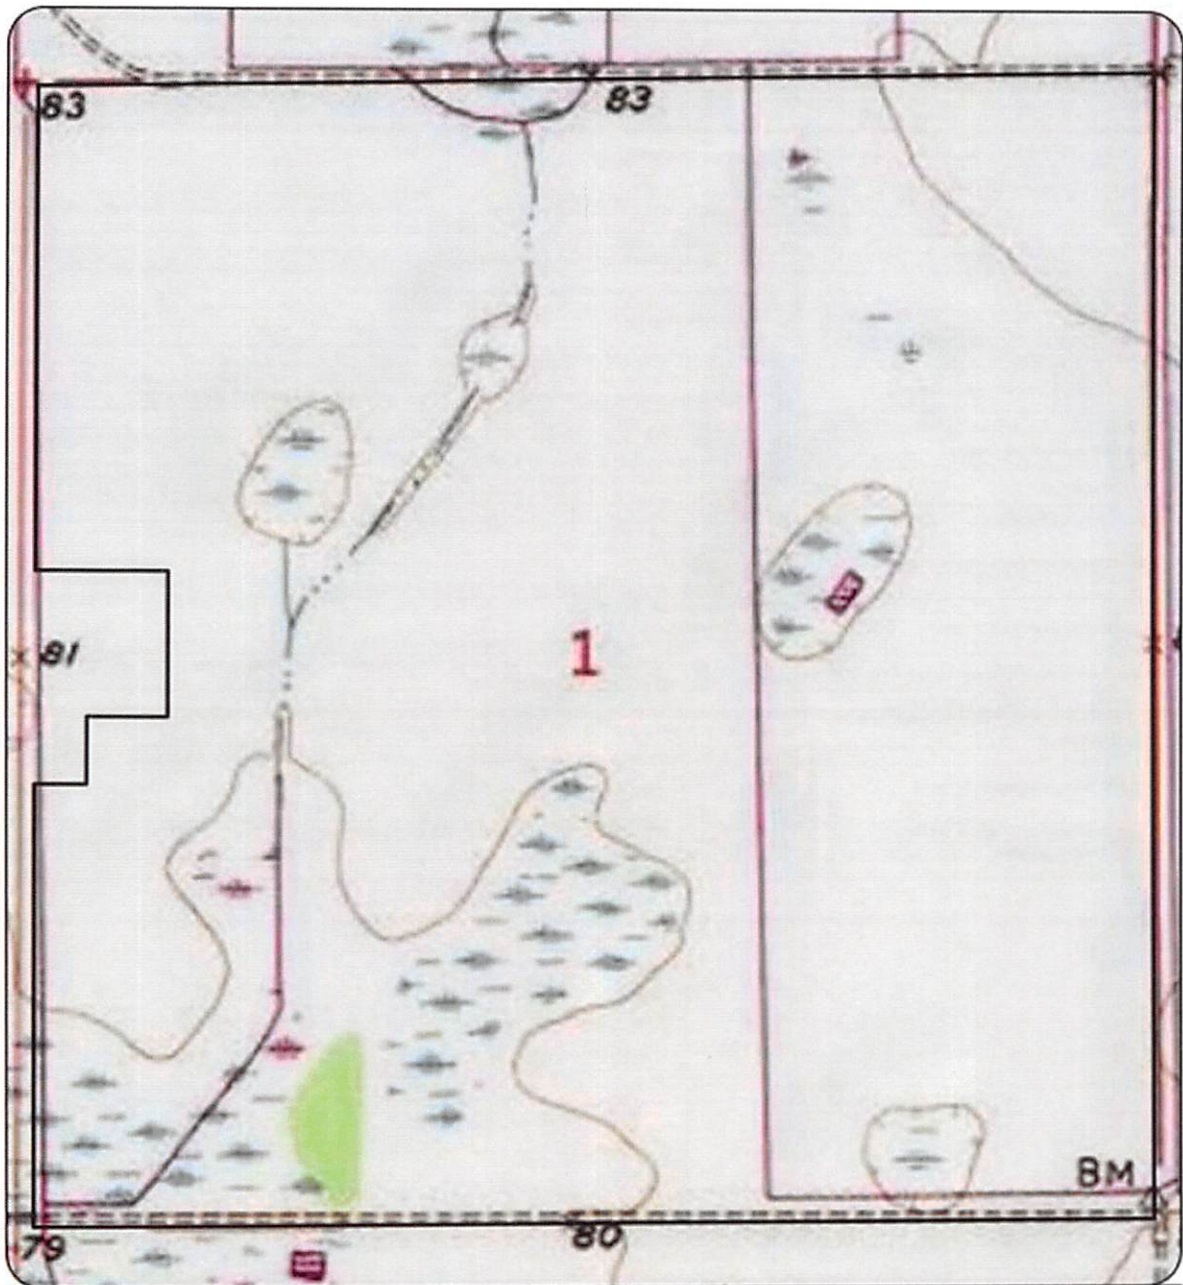


 Joshua Creek Solar Energy Center

Joshua Creek Solar Energy Center  
 USGS Topography Map





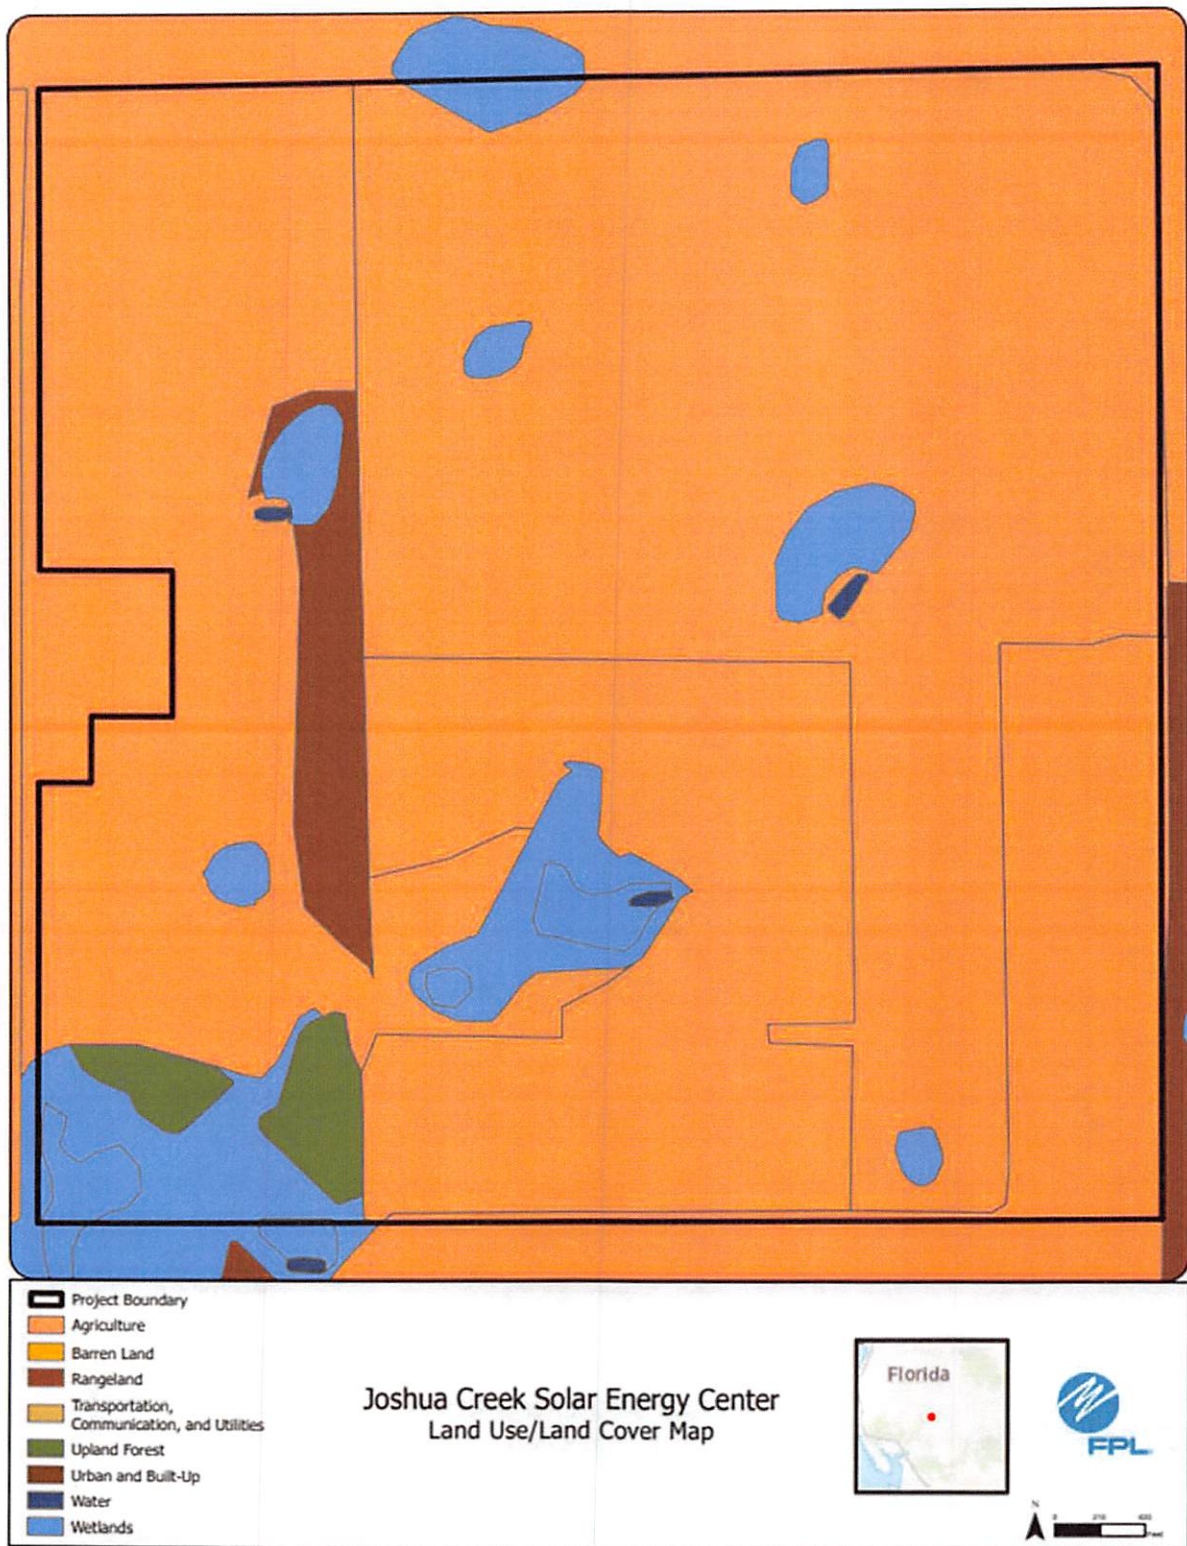





 Joshua Creek Solar Energy Center

# Joshua Creek Solar Energy Center Facility Layout Map





***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #27: Spanish Moss Solar Energy Center, St. Lucie  
County***


Potential Site		Spanish Moss Solar Energy Center
County		St. Lucie
Facility Acreage		2037 (483 project acres)
COD		10/31/2027
For PV facilities: tracking or fixed		Tracking
		Reference Maps
a. USGS Map		See Figures in the following pages
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
e.		Existing Land Uses
Site		Improved pasture with agricultural ditches and wetlands
Adjacent Areas		Various agriculture, ditches, and wetlands
f.		General Environment Features On and in the Site Vicinity
1. Natural Environment		Improved pasture with agricultural ditches and two small wetlands
2. Listed Species		Audubon's crested caracara, wading birds
3. Natural Resources of Regional Significance Status		No natural resources of regional significance status at or adjacent to the site.
4. Other Significant Features		Formerly documented bald eagle nests to west of property
g. Design Features and Mitigation Options		The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the South region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP Issued: 3/13/24



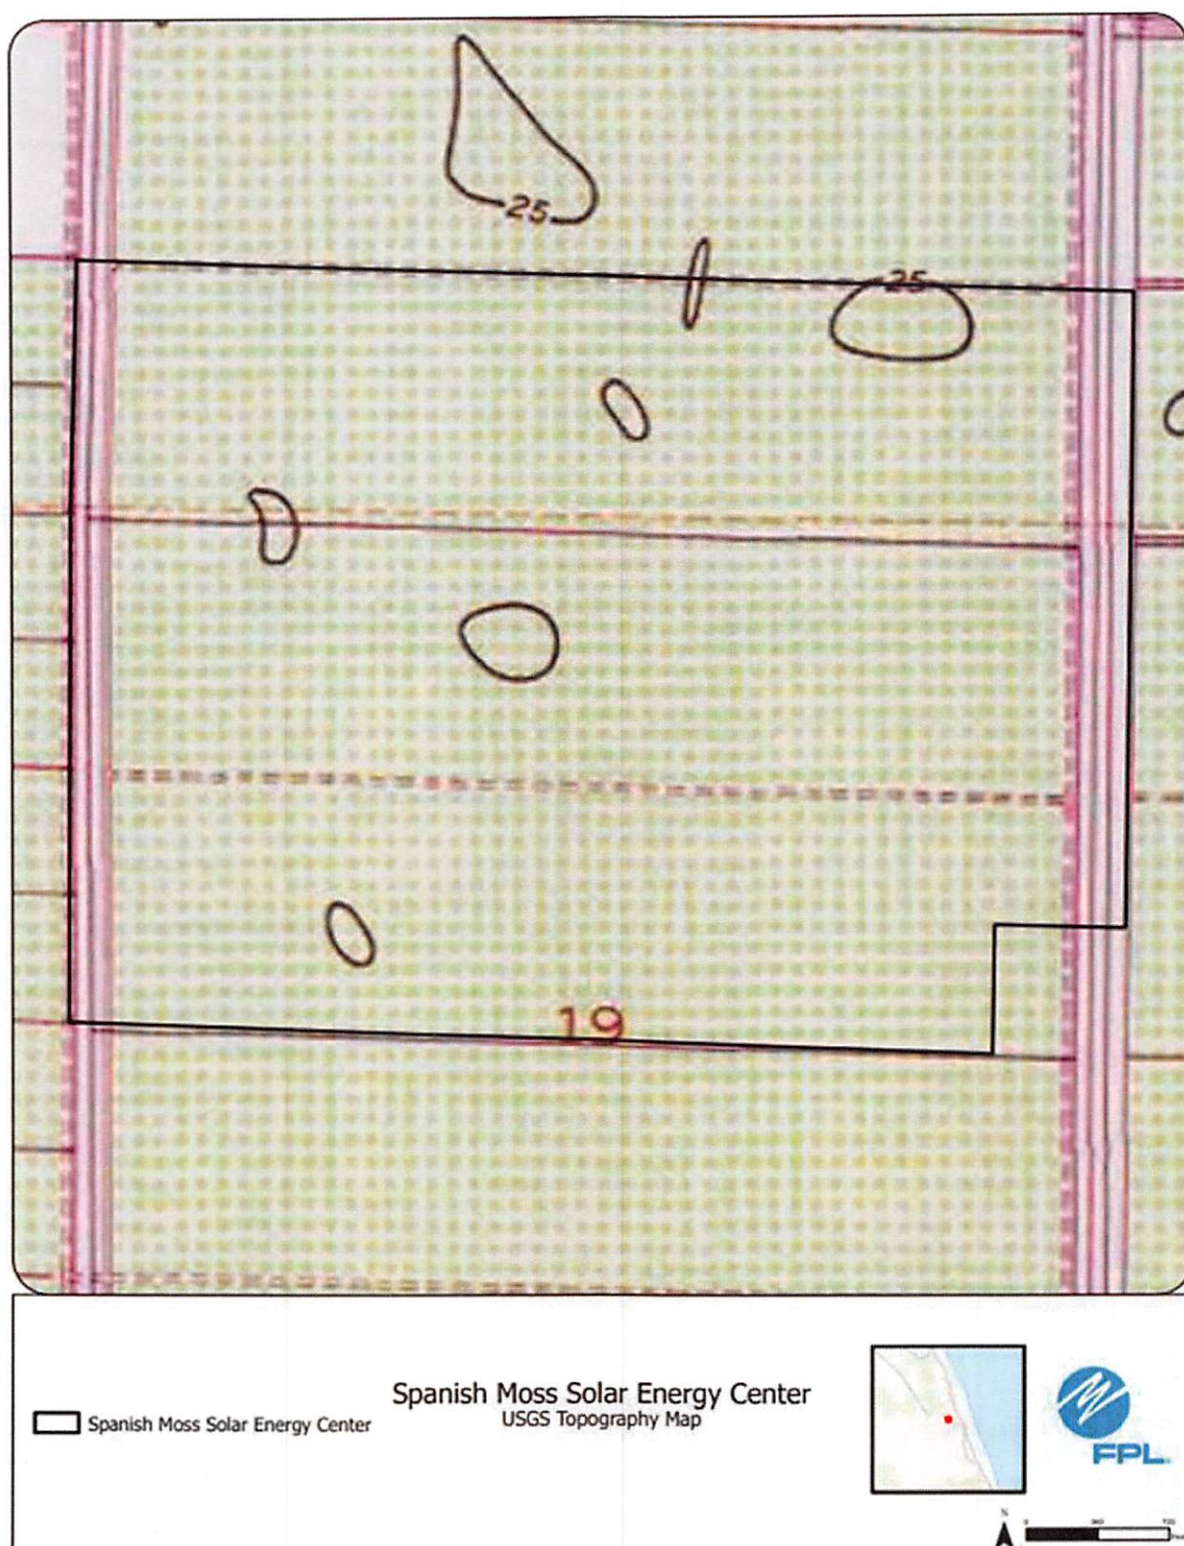

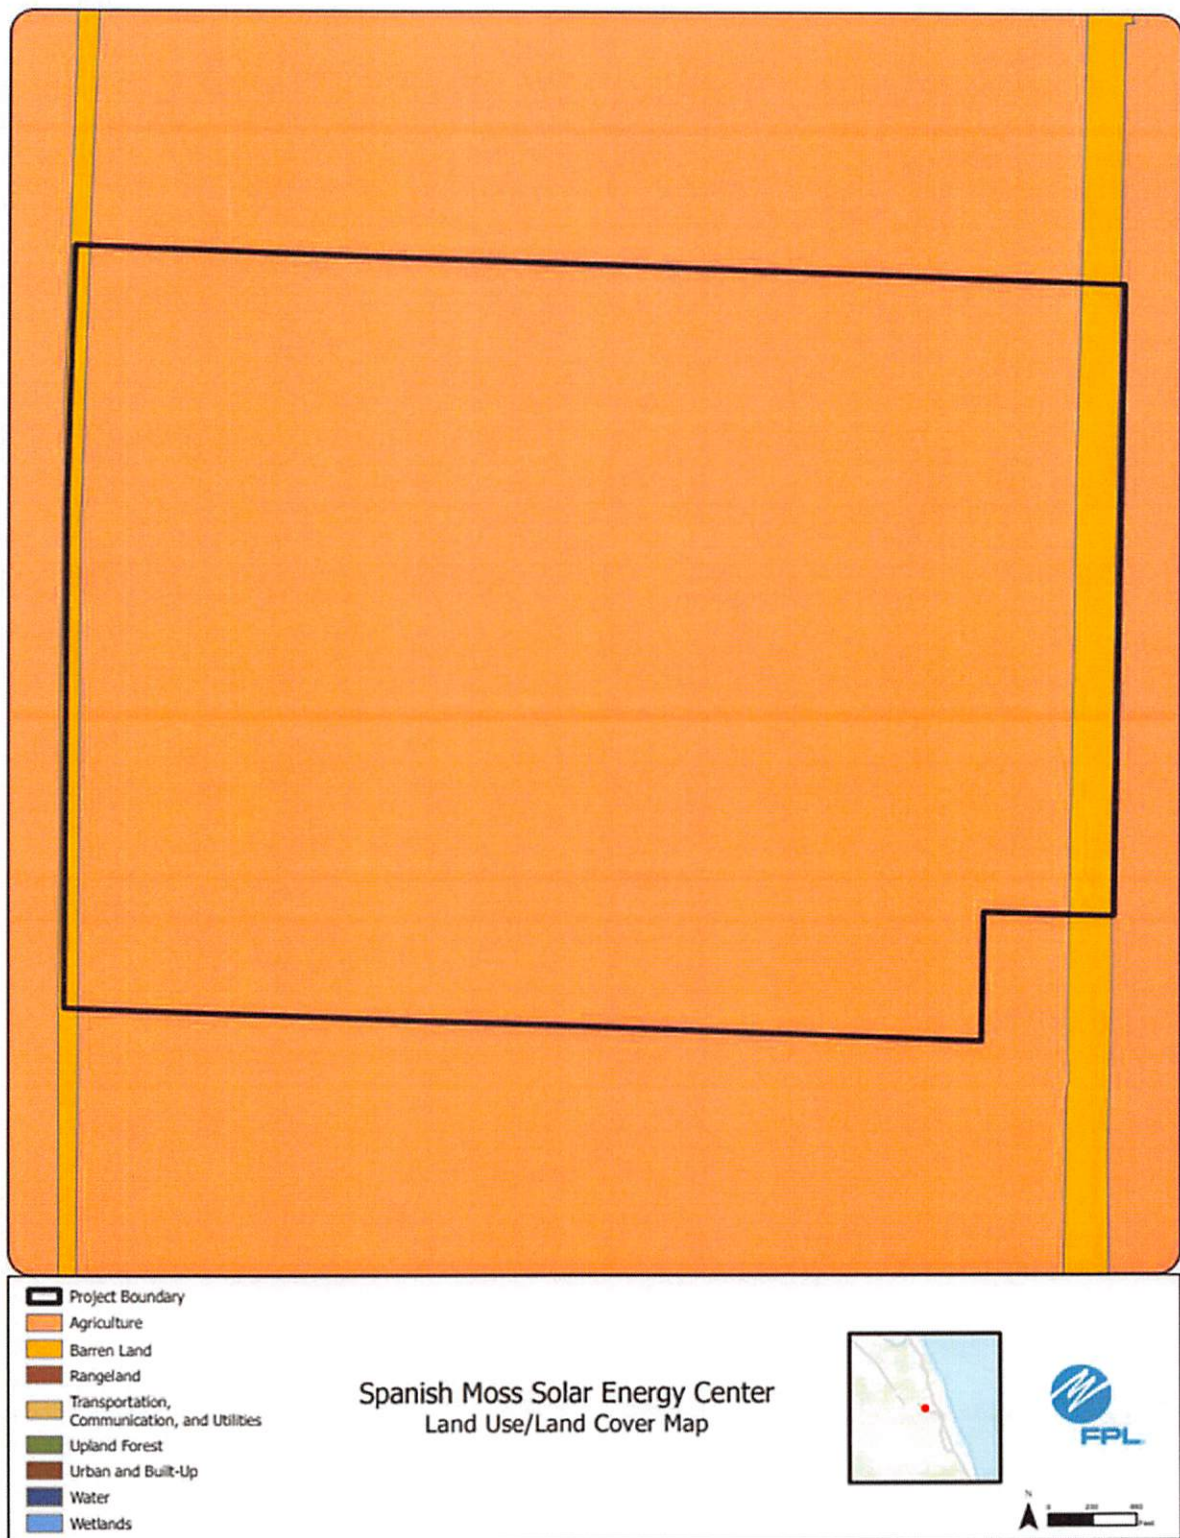



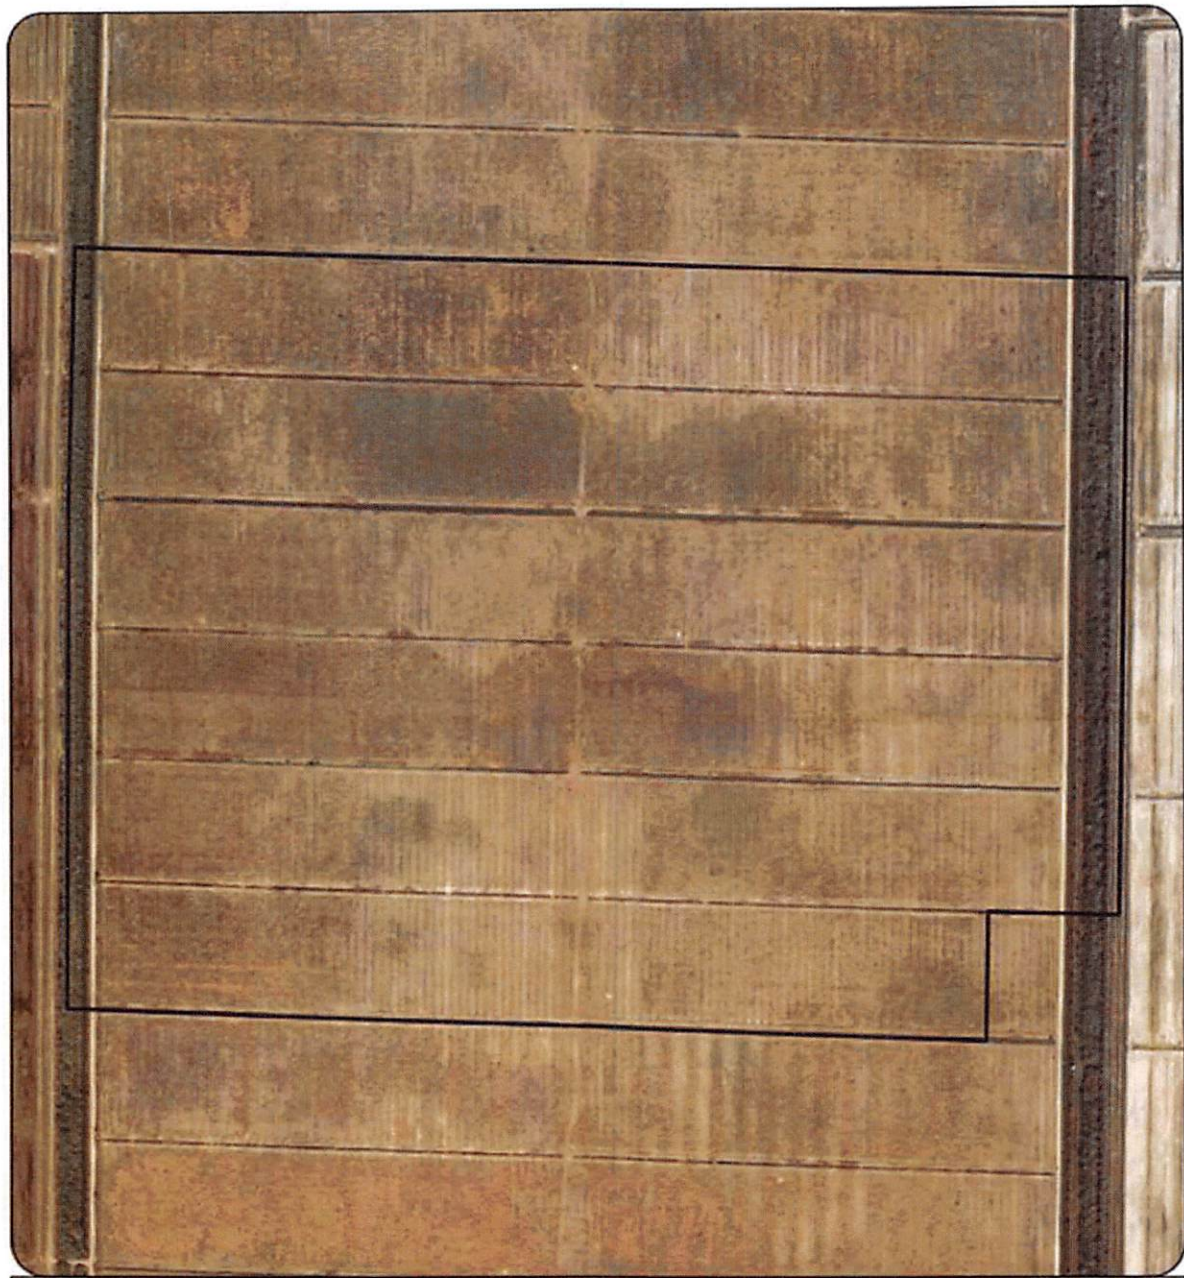

Spanish Moss Solar Energy Center

# Spanish Moss Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***


***Preferred Site #28: Vernia Solar Energy Center, Indian River County***



Preferred Site		Vernia Solar Energy Center
County		Indian River
Facility Acreage		533
COO		10/31/2027
For PV facilities: tracking or fixed		Tracking
		Reference Maps
a. USGS Map		See Figures in the following pages
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
e.		Existing Land Uses
Site		Citrus, improved pasture, forested wetlands, agricultural ditches
Adjacent Areas		Solar and citrus
f.		General Environment Features On and In the Site Vicinity
1. Natural Environment		Citrus, improved pasture, forested wetlands, and agricultural ditches
2. Listed Species		Audubon's crested caracara, wading birds
3. Natural Resources of Regional Significance Status		No natural resources of regional significance status at or adjacent to the site.
4. Other Significant Features		FPL is not aware of any other significant features of the site.
g. Design Features and Mitigation Options		The design includes an approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing onsite water resources may be used to meet water requirements if permit is pulled or if the facility has an existing CUP/WUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages. Site is located in the South region.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable: Minimal Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m. Water Supply Sources by Type		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Potable and Panel Cleaning: Onsite well or surface water or delivered to site
n. Water Conservation Strategies Under Consideration		Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o. Water Discharges and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Solar does not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r. Noise Emissions and Control Systems		PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s. Status of Applications		FDEP ERP: Application not yet submitted

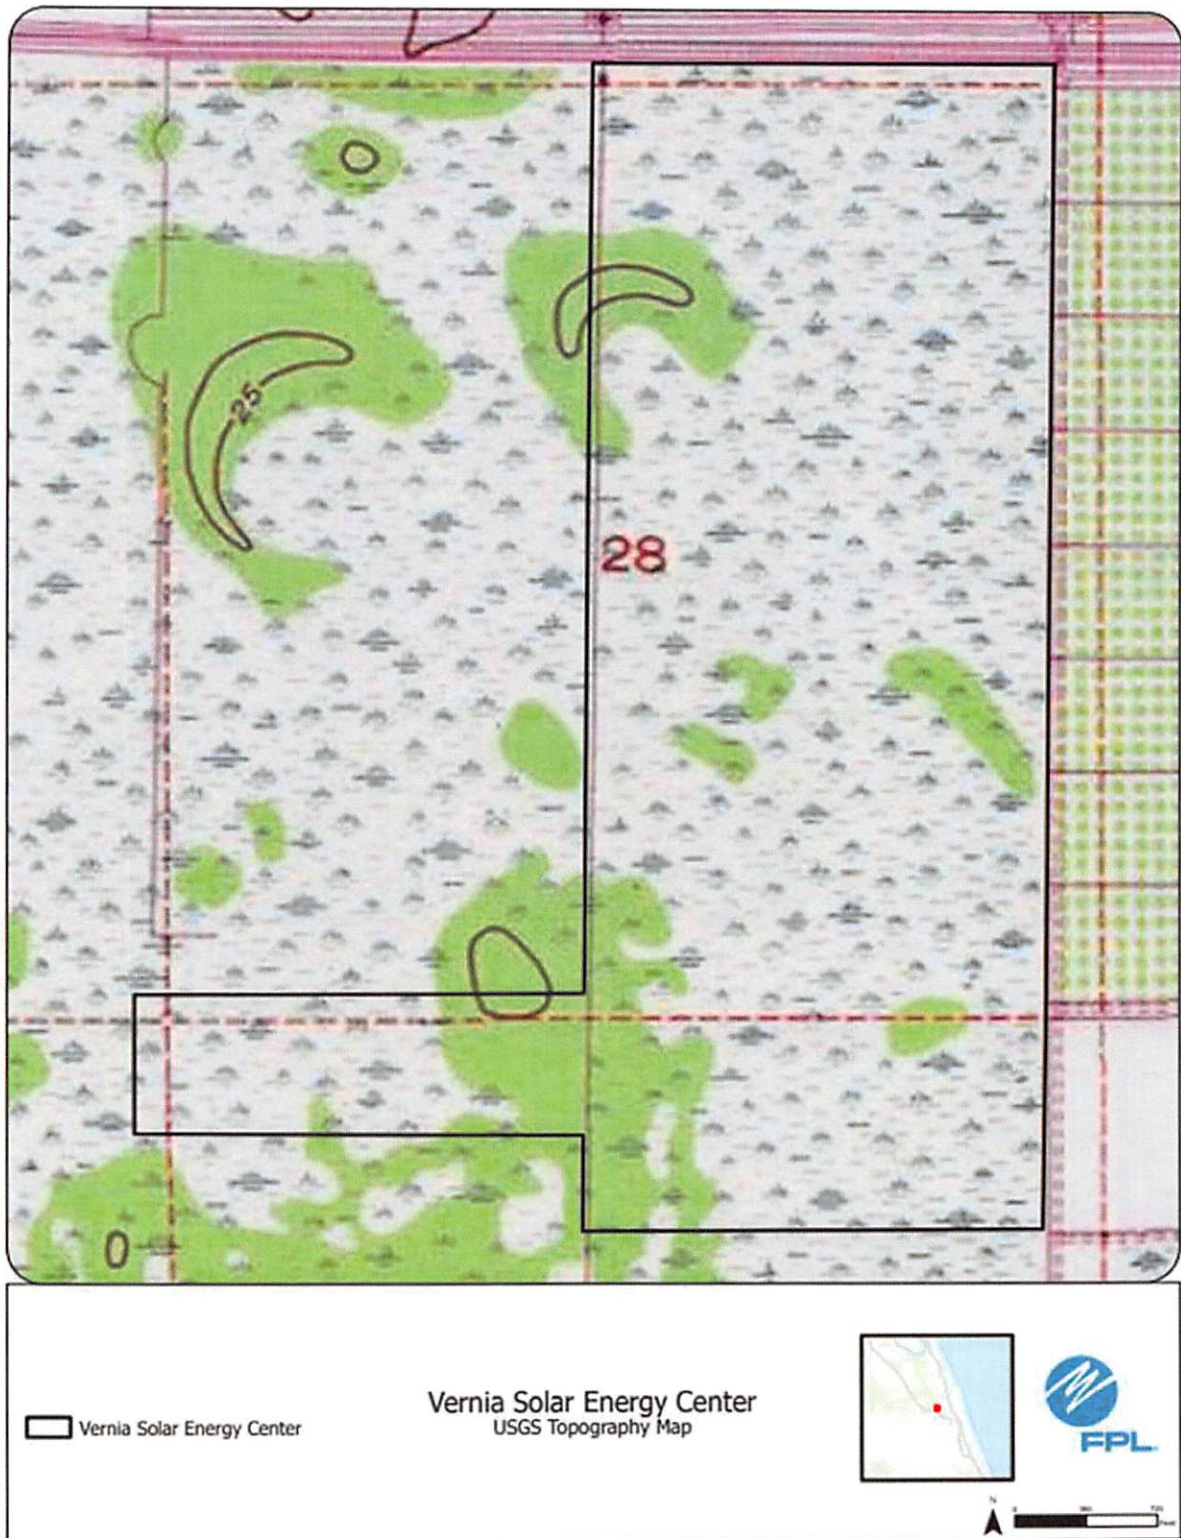



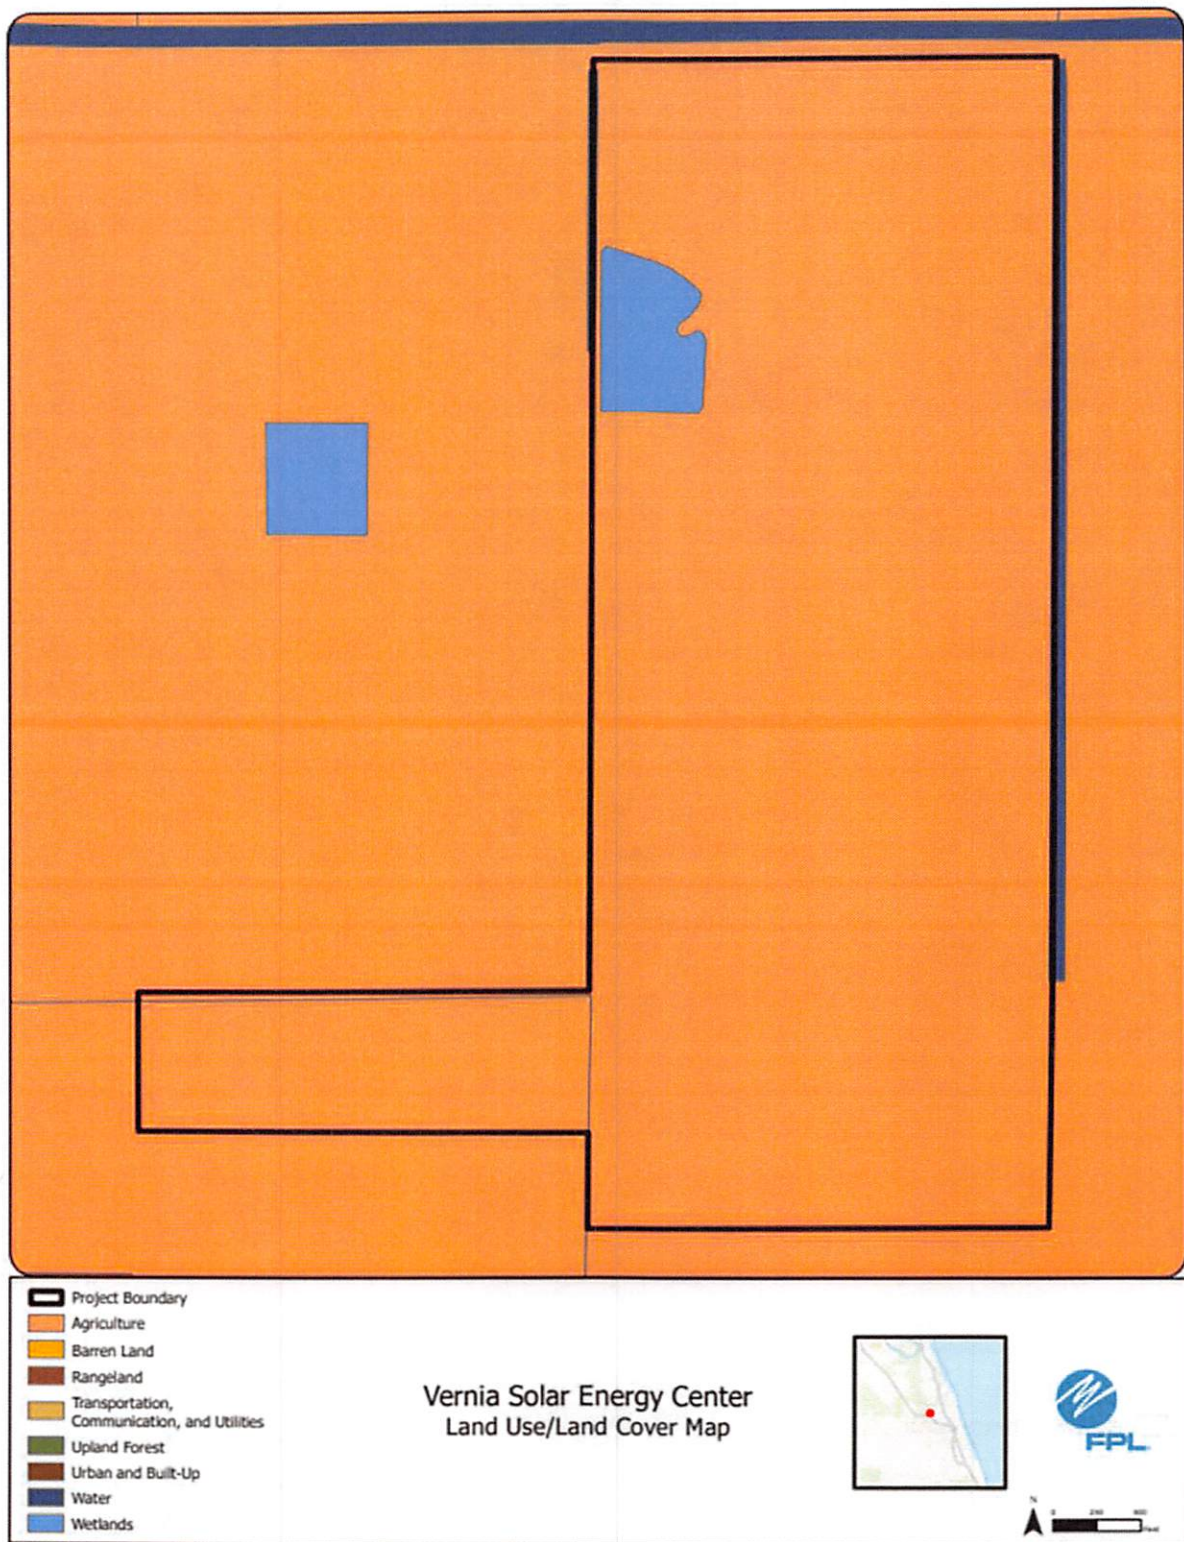





 Vernia Solar Energy Center

# Vernia Solar Energy Center Facility Layout Map




***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #29: LaBelle Solar Energy Center, Hendry County***


	Preferred Site	Labette Solar Energy Center
	County	Hendry
	Facility Acreage	439
	CO2	
	For PV facilities: tracking or fixed	Tracking
	Reference Maps	
a.	USGS Map	
b.	Proposed Facilities Layout	
c.	Map of Site and Adjacent Areas	
d.	Land Use Map of site and Adjacent Areas	
e.	Site	Existing Land Uses
		Actively managed citrus
		Agricultural lands/low density residential
f.		General Environment Features On and in the Site Vicinity
1.	Natural Environment	Entire project site is managed citrus with some ponds dug for irrigation
2.	Listed Species	Audubon's crested caracara
3.	Natural Resources or Regional Significance Status	A few miles north of the project site is the Caloosahatchee River.
4.	Other Significant Features	FPL is not aware of any significant features nearby.
g.	Design Features and Mitigation Options	The design includes a approximately 74.5 MW solar tracking panel PV facility, on-site transmission substation, and site stormwater system. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h.	Local Government Future Land Use Designations	Solar facilities are permitted in unincorporated agriculturally zoned areas at this time.
i.	Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.)
j.	Water Resources	Existing on-site water resources may be used to meet water requirements if a permit is pulled or if the facility has an existing CUP/VUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked in from off-site.
k.	Geological Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the South region.
		Cooling: Not Applicable for Solar Process: Not Applicable for Solar Ponding: Minimal
l.	Project Water Quantities for Various Uses	Panel Cleaning: Minimal and only needed in the absence of sufficient rainfall
m.	Water Supply Sources by Type	Cooling: Not Applicable for Solar Process: Not Applicable for Solar Ponding: Minimal and only needed in the absence of sufficient rainfall
n.	Water Conservation Strategies Under Consideration	Solar (PV) does not require a permanent water source. Additional water conservation strategies include selection and planting of low-to-no irrigation grass or groundcover.
o.	Water Discharges and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
p.	Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Solar does not require fuel and no waste products will be generated at the site.
q.	Air Emissions and Control Systems	Fuel - PV Solar energy generation does not use any type of combustion fuel; therefore, there will be no air emissions or need for control systems. Combustion Control - Not Applicable
r.	Noise Emissions and Control Systems	PV Solar energy generation does not emit noise therefore there will be no need for noise control systems.
s.	Status of Applications	FDEP ERP: Application not yet submitted



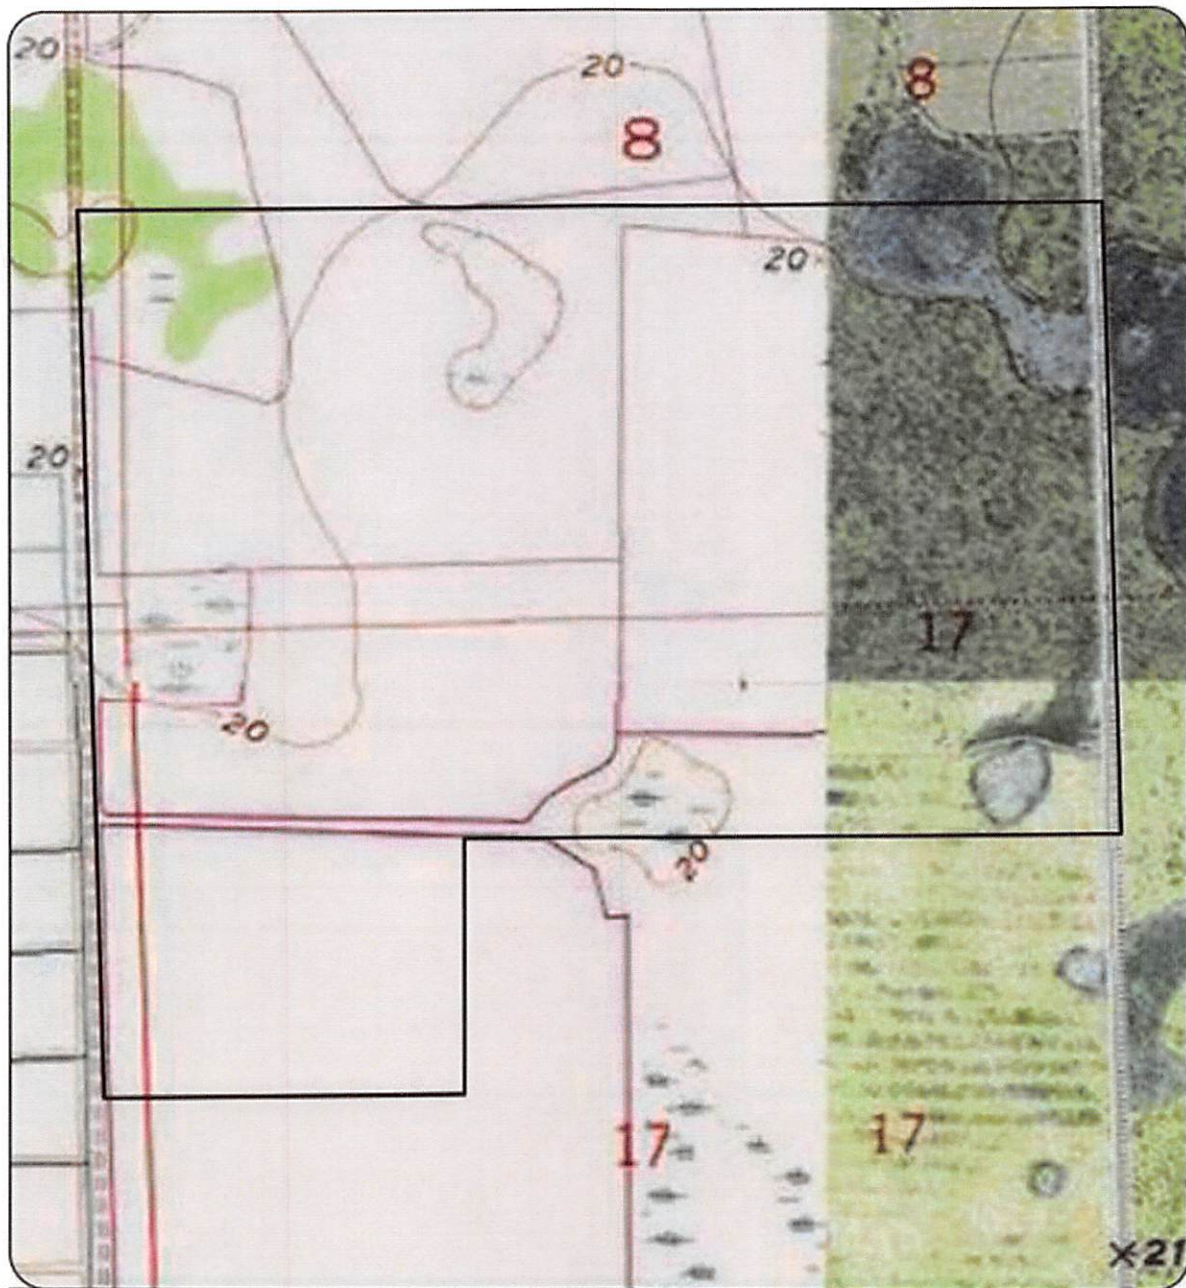


 LaBelle Solar Energy Center

LaBelle Solar Energy Center  
USGS Topography Map





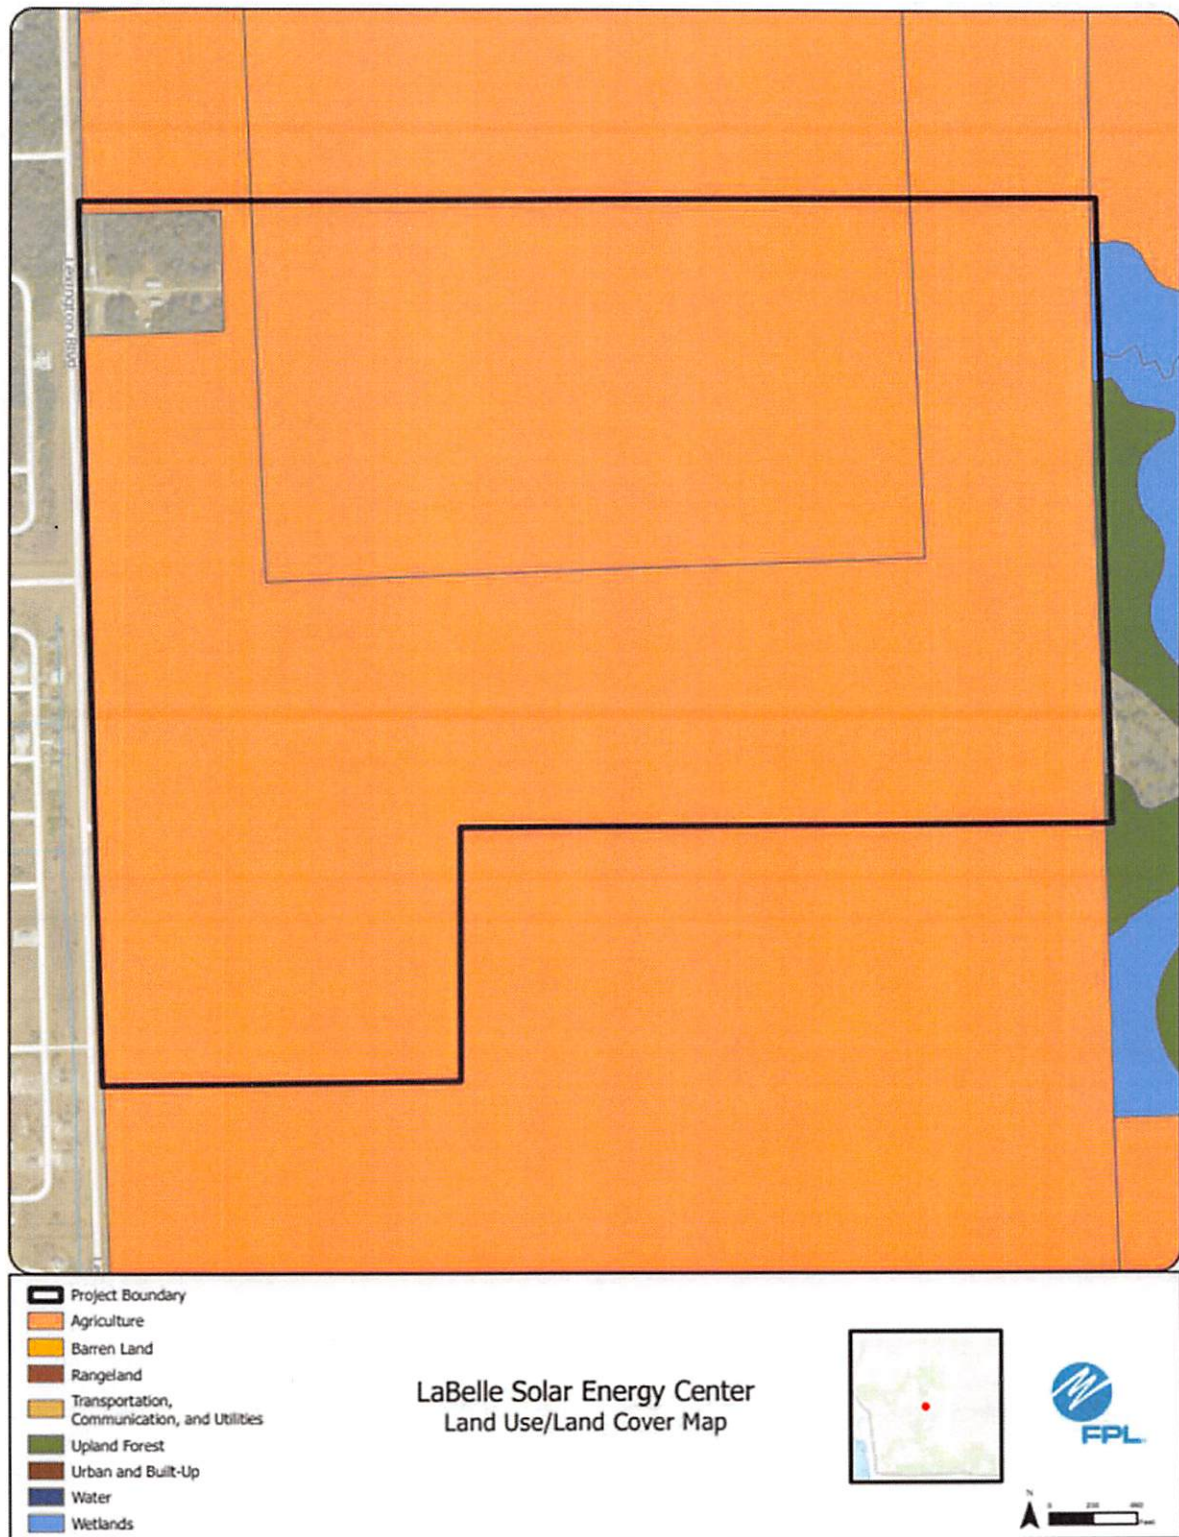






 LaBelle Solar Energy Center

# LaBelle Solar Energy Center Facility Layout Map



***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #30: Lansing Smith Battery Energy Storage Site, Bay  
County***

Preferred site	County	Bay	10/1/2025	For PV location: tracking or fixed	N/A	Reference Maps	See Figures in the following pages	Adjacent Areas	North Bay	General Environmental Features On and in the Site Vicinity	1. Natural Environment	N/A, former coal storage area at FPL Plant Lansing Smith	2. Listed Species	N/A	3. Natural Resources or Regional Significance Status	No natural resources or regional significance status at or adjacent to the site.	4. Other Significant Features	FPL is not aware of any other significant features or the site.	5. Design Features and Mitigation Options	The design includes 400 kW of 4-hour batteries (1,600kWh total) surrounded by a berm for storm surge protection. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.	6. Local Government Future Land Use Designations	CSWH Conservation Station	7. Site Selection Criteria Factors	The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).	8. Water Resources	Existing onsite water resources may be used to meet water requirements if permit is pulled or if the facility has an existing CUPWUP or meets wind permit-by-use criteria. Otherwise, water will need to be trucked from off-site.	9. Geotechnical Features of Site and Adjacent Areas	See Figure in the following pages. Site is located in the North region.	10. Project Water Quantities for Various Uses	Cooling: Not Applicable for Battery Process; Minimal	Cooling: Not Applicable for Battery Process; Not Applicable for Battery	11. Water Supply Sources by Type	Cooling: Not Applicable for Battery Process; Not Applicable for Battery	12. Water Conservation Strategies Under Consideration	Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.	13. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	Battery does not require fuel and no waste products will be generated at the site.	14. Air Emissions and Control Systems	Fuel - Battery projects do not use any type of combustion fuel therefore, there will be no air emissions or need for control systems. Combustion Control - Not Applicable	15. Noise Emissions and Control Systems	If applicable, noise control system will be installed if results from any required sound noise studies show the need for one.	16. Status of Applications	FCEP EIRP issued 11/15/2024 USACE 404 NWP issued 12/16/2024
----------------	--------	-----	-----------	------------------------------------	-----	----------------	------------------------------------	----------------	-----------	--	------------------------	--	-------------------	-----	--	--	-------------------------------	---	---	--	--	---------------------------	------------------------------------	---	--------------------	--	---	---	---	--	---	----------------------------------	---	---	---	---	--	---------------------------------------	---	---	---	----------------------------	--





Lansing Smith Battery Energy Storage Site  
Facility Layout Map

 Lansing Smith Battery Energy Storage Site









# Lansing Smith Battery Energy Storage Site Facility Layout Map

 Lansing Smith Battery Energy Storage Site






***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #31: Putnam Battery Energy Storage Site, Putnam  
County***


Preferred Site		Putnam Battery Energy Storage
County		Putnam
Facility Acreage		57
COO		7/31/2027
For PV facilities: tracking or fixed		N/A
Reference Maps		
a. USGS Map		See Figures in the following pages
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
Site		Industrial
Adjacent Areas		Power generation facilities and highway
General Environment Features On and in the Site Vicinity		
1. Natural Environment		Forested wetlands, disturbed land, shrub and brush, ditches, reservoir
2. Listed Species		Gopher tortoise
3. Natural Resources of Regional Significance Status		Site is located along the St. John's River, conservation areas and state parks are in the general vicinity
4. Other Significant Features		FPL is not aware of any other significant features of the site.
g. Design Features and Mitigation Options		The design includes a battery energy storage system (BESS), stormwater system, and transmission substation and an on-site transmission interconnection line and ROW. Mitigation for unavoidable impacts, if required, may occur through off-site mitigation.
h. Local Government Future Land Use Designations		Property is zoned as industrial heavy (IH). Previously permitted for industrial power generation facility.
i. Site Selection Criteria Factors		The site selection criteria included system load, transmission interconnection, economics, and environmental compatibility (e.g., wetlands, wildlife, threatened and endangered species, etc.).
j. Water Resources		Existing onsite water resources may be used to meet water requirements if permit is pulled or if the facility has an existing CUPWUP or meets WMD permit-by-rule criteria. Otherwise, water will need to be trucked from off-site.
k. Geological Features of Site and Adjacent Areas		See Figure in the following pages.
l. Project Water Quantities for Various Uses		Cooling: Not Applicable for Battery Process: Not Applicable for Battery Potable: Minimal
m. Water Supply Sources by Type		Cooling: Not Applicable for Battery Process: Not Applicable for Battery Potable: Onsite well or delivered to site
n. Water Conservation Strategies Under Consideration		Batteries do not require a permanent water source.
o. Water Discharges and Pollution Control		Best Management Practices (BMPs) will be employed to prevent and control inadvertent release of pollutants.
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control		Batteries do not require fuel and no waste products will be generated at the site.
q. Air Emissions and Control Systems		Fuel - Battery projects do not use any type of combustion fuel; therefore, there will be no air emissions or need for Control Systems. Combustion Control - Not Applicable Combustor Design - Not Applicable
r. Noise Emissions and Control Systems		If applicable, noise control system will be installed if results from any required sound noise studies show the need for one.
s. Status of Applications		FDRE ERP: Application not yet submitted

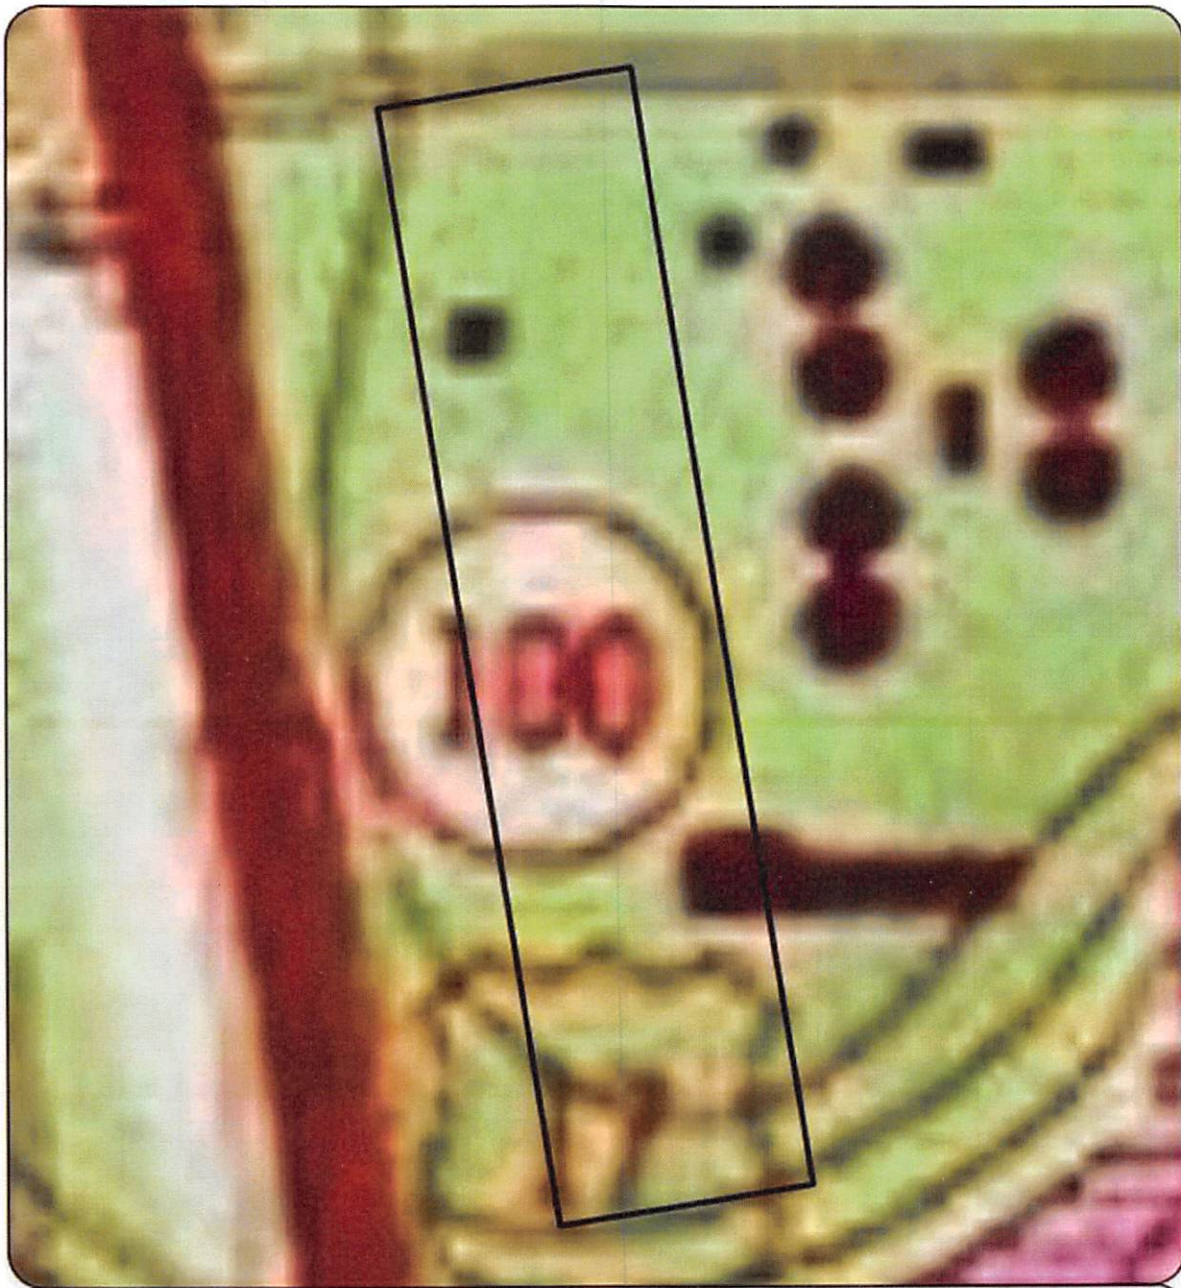


 Putnam Battery Energy Storage Site

Putnam Battery Energy Storage Site  
USGS Topography Map



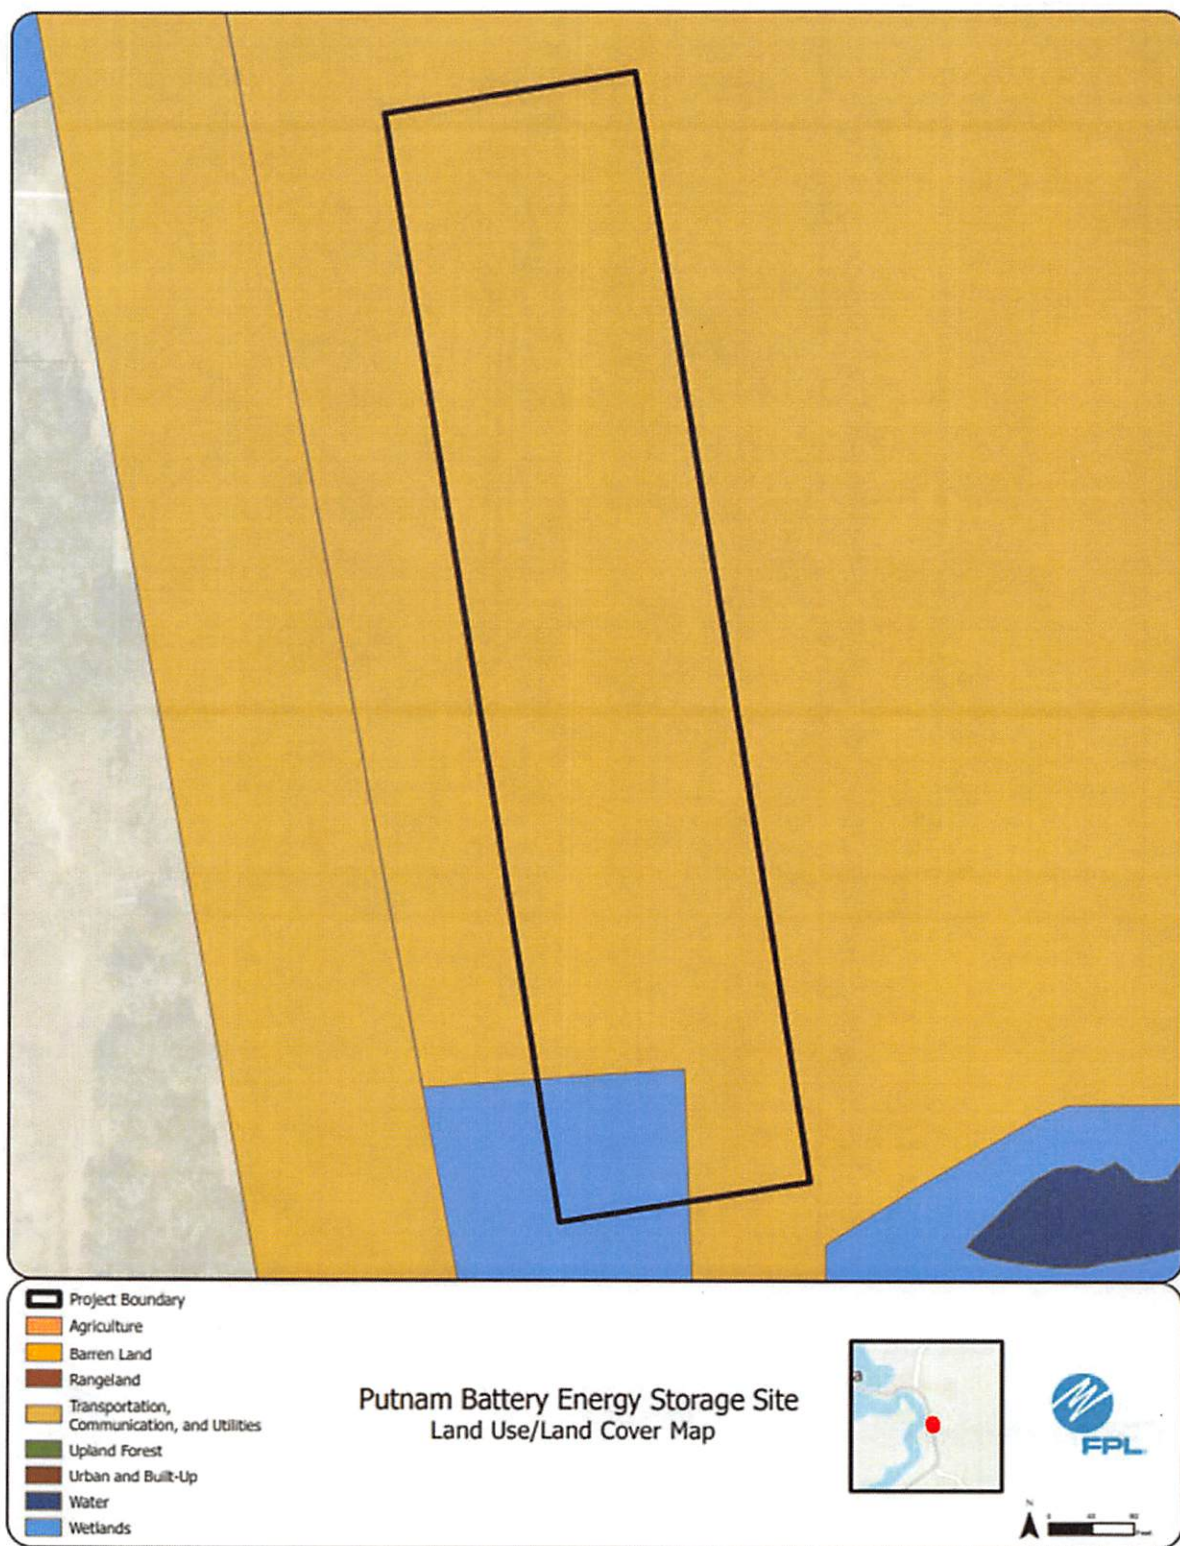



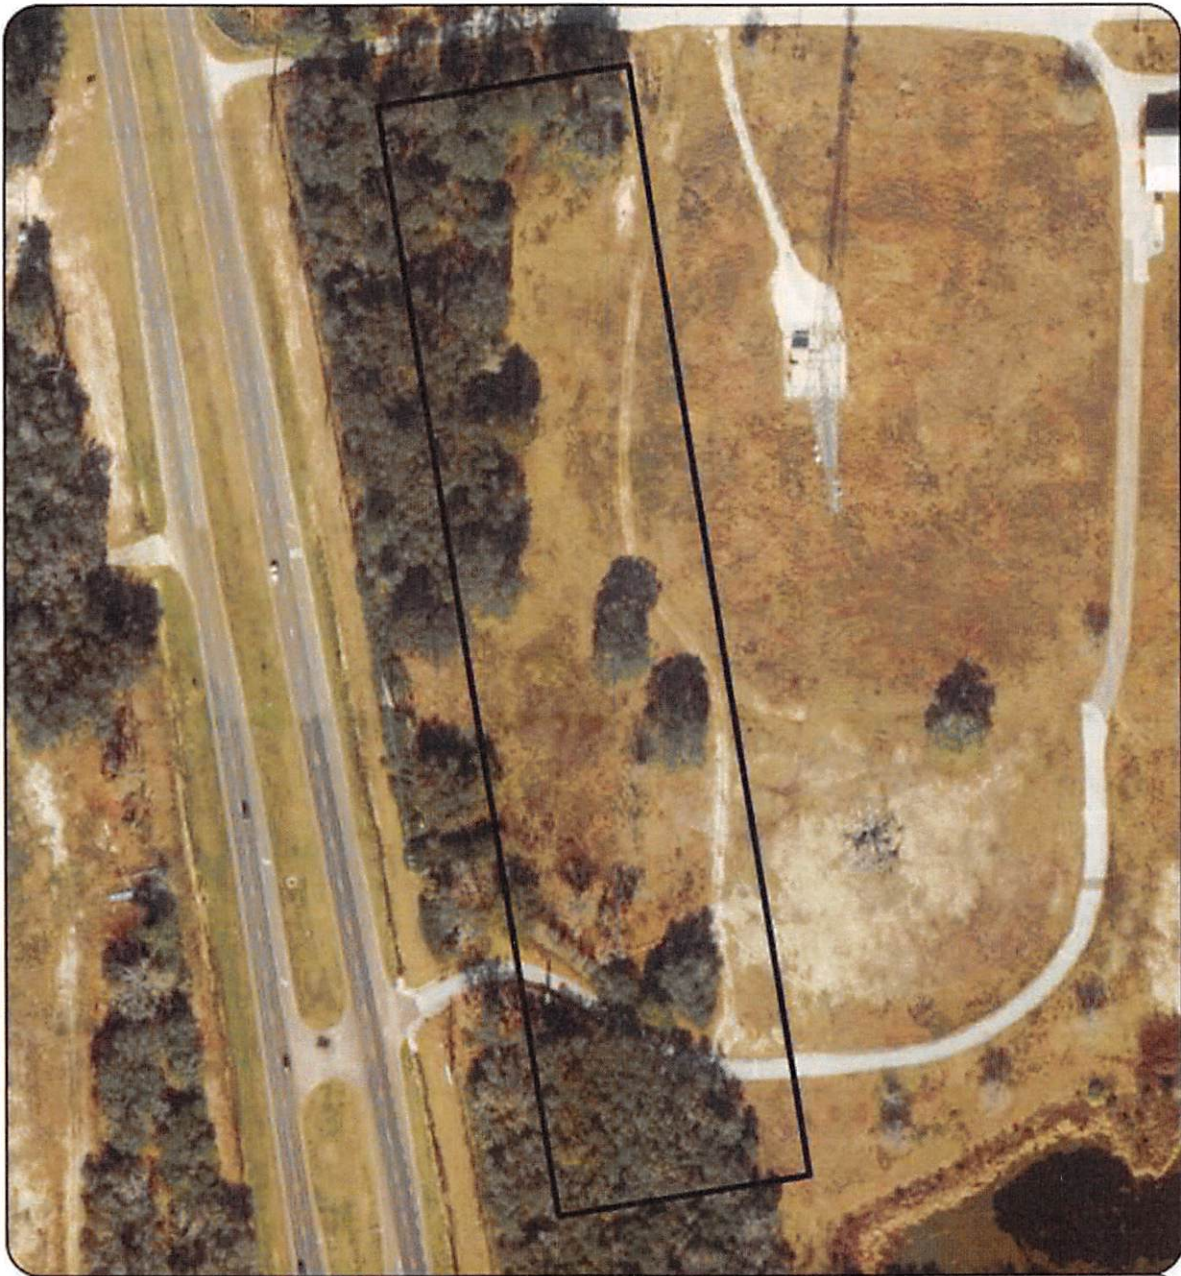

 Putnam Battery Energy Storage Site

Putnam Battery Energy Storage Site  
Facility Layout Map





***Site Description, Environmental, and Land Use Information:  
Supplemental Information***

***Preferred Site #32: Turkey Point Units 6 & 7, Miami-Dade County***


Preferred Site		Turkey Point Units 6&7
County		Miami-Dade
Facility Acreage	N/A	
COD	TBD	
For PV facilities: tracking or fixed	N/A	
Reference Maps		
a. USGS Map	See Figures at the end of this chapter	
b. Proposed Facilities Layout		
c. Map of Site and Adjacent Areas		
d. Land Use Map of site and Adjacent Areas		
Existing Land Uses		
Site	Electrical generating facilities	
Adjacent Areas	Undeveloped, the Everglades Mitigation Bank, South Florida Water Management District Canal L-31E, Biscayne Bay and state-owned land on Card Sound	
General Environment Features On and in the Site Vicinity		
1. Natural Environment	The site includes hypersaline mud flats, man-made cooling canals and remnant canals, previously filled areas/roadways, mangrove heads associated with historical tidal channels, dwarf mangroves, open water/discharge canal associated with the cooling canals on the western portion of the site, spoil berms associated with remnant canals, and upland spoil areas.	
2. Listed Species	Listed species known to occur include the peregrine falcon, wood stork, American crocodile, roseate spoonbill, little blue heron, snowy egret, American oystercatcher, least tern, white ibis, Florida manatee, eastern indigo snake, snail kite, and white-crowned pigeon. Some listed flora species likely to occur include pine pink, Florida brickell-bush, Florida tarantula, mullein nightshade, and Lamarck's trema. The construction and operation of Turkey Point Units 6 & 7 are not expected to adversely affect listed species.	
3. Natural Resources of Regional Significance Status	Significant features in the vicinity of the site include Biscayne Bay, Biscayne National Park, Biscayne Bay Aquatic Preserve, Miami-Dade County Homestead Bayfront Park, and Everglades National Park.	
4. Other Significant Features	FPL is not aware of any other significant features of the site.	
g. Design Features and Mitigation Options	The technology proposed is the Westinghouse AP1000 pressurized water reactor. This design is certified by the Nuclear Regulatory Commission under 10 CFR 52. The Westinghouse AP1000 consists of the reactor, steam generators, pressurizer, and steam turbine/electric generator. The projected generating capacity from each unit is 1,100 MW. Condenser cooling will use six circulating water cooling towers. The structures to be constructed include the containment building, shield building, auxiliary building, turbine building, annex building, diesel generator building, and radiowaste building. The plant area will also contain the Clear Sky substation (switchyard) that will connect to FPL's transmission system.	
h. Local Government Future Land Use Designations	Current future land use designations include Industrial, Utilities, Communications, and Unlimited Manufacturing with a dual designation of Mangrove Protection Area. There are also areas of the site designated Interim District.	
i. Site Selection Criteria Factors	Site selection included the following criteria: existing transmission and transportation infrastructure to support new generation, the size and seclusion of the site while being relatively close to the load center, economics, and the long-standing record of safe and secure operation of nuclear generation at the site since the early 1970s.	
j. Water Resources	Water requirements will be met by reclaimed water from Miami-Dade County and a back-up supply of saline groundwater from below the marine environment of Biscayne Bay.	
k. Geological Features of Site and Adjacent Areas	See Figure at the end of this Chapter. The site is located in the South Florida region.	
l. Project Water Quantities for Various Uses	Cooling: 55.3 million gallons per day (mgd) Process: 1.3 mgd Potable: .05 mgd Panel Cleaning: Not Applicable	
m. Water Supply Sources by Type	Cooling: Miami-Dade reclaimed water and saline groundwater from Biscayne Bay via radial collector wells Process: Miami-Dade Water and Sewer Department Potable: Miami-Dade Water and Sewer Department	
n. Water Conservation Strategies Under Consideration	Turkey Point Units 6 & 7 will use reclaimed water 24 hours per day, 365 days per year when operating and when the reclaimed water is available in sufficient quantity and quality.	
o. Water Discharges and Pollution Control	Blowdown water or discharge from the cooling towers, along with other waste streams, will be injected into the boulder zone of the Floridan Aquifer. Non-point source discharges are not an issue since there will be none at this facility. Stormwater runoff will be released to the closed-loop cooling canal system.	
p. Fuel Delivery, Storage, Waste Disposal, and Pollution Control	The Turkey Point Units 6 & 7 reactors will contain enriched uranium fuel assemblies. Fuel assemblies will be transported to Turkey Point for use in Units 6 & 7 by truck from a fuel fabrication facility in accordance with U.S. Department of Transportation and NRC regulations. Spent fuel being discharged will remain in the permitted spent fuel pool while short half-life isotopes decay.  After a sufficient decay period, the fuel would be transferred to an on-site independent spent fuel storage installation facility or a permitted off-site disposal facility. Packaging of the fuel for off-site shipment will comply with the applicable DOT and NRC regulations for transportation of radioactive material.  The U.S. Department of Energy is responsible for spent fuel transportation from reactor sites to a repository under the Nuclear Waste Policy Act of 1982, as amended. FPL has executed a standard spent nuclear fuel disposal contract with DOE for fuel used in Units 6 & 7.	
q. Air Emissions and Control Systems	Fuel - The units will minimize FPL system air pollutant emissions by using nuclear fuel to generate electric power. Combustion Control / Combustor Design - Not Applicable  Note: The diesel engines necessary to support Turkey Point Units 6 & 7 and fire pump engines will be purchased from manufacturers whose engines meet the EPA's New Source Performance Standards Subpart III emission limits.	
r. Noise Emissions and Control Systems	Predicted noise levels associated with these projects are not expected to result in adverse noise impacts in the vicinity of the site.	
s. Status of Applications	Need Determination issued: April 2008 FL Site Certification Received: May 14, 2014 USACE Section 404 Permit: December 18, 2019 COL received: April 5, 2018 Miami-Dade County Unusual Use approvals: issued in 2007 and 2013 Land Use Consistency Determination: issued in 2013 Prevention of Significant Deterioration: issued in 2009	



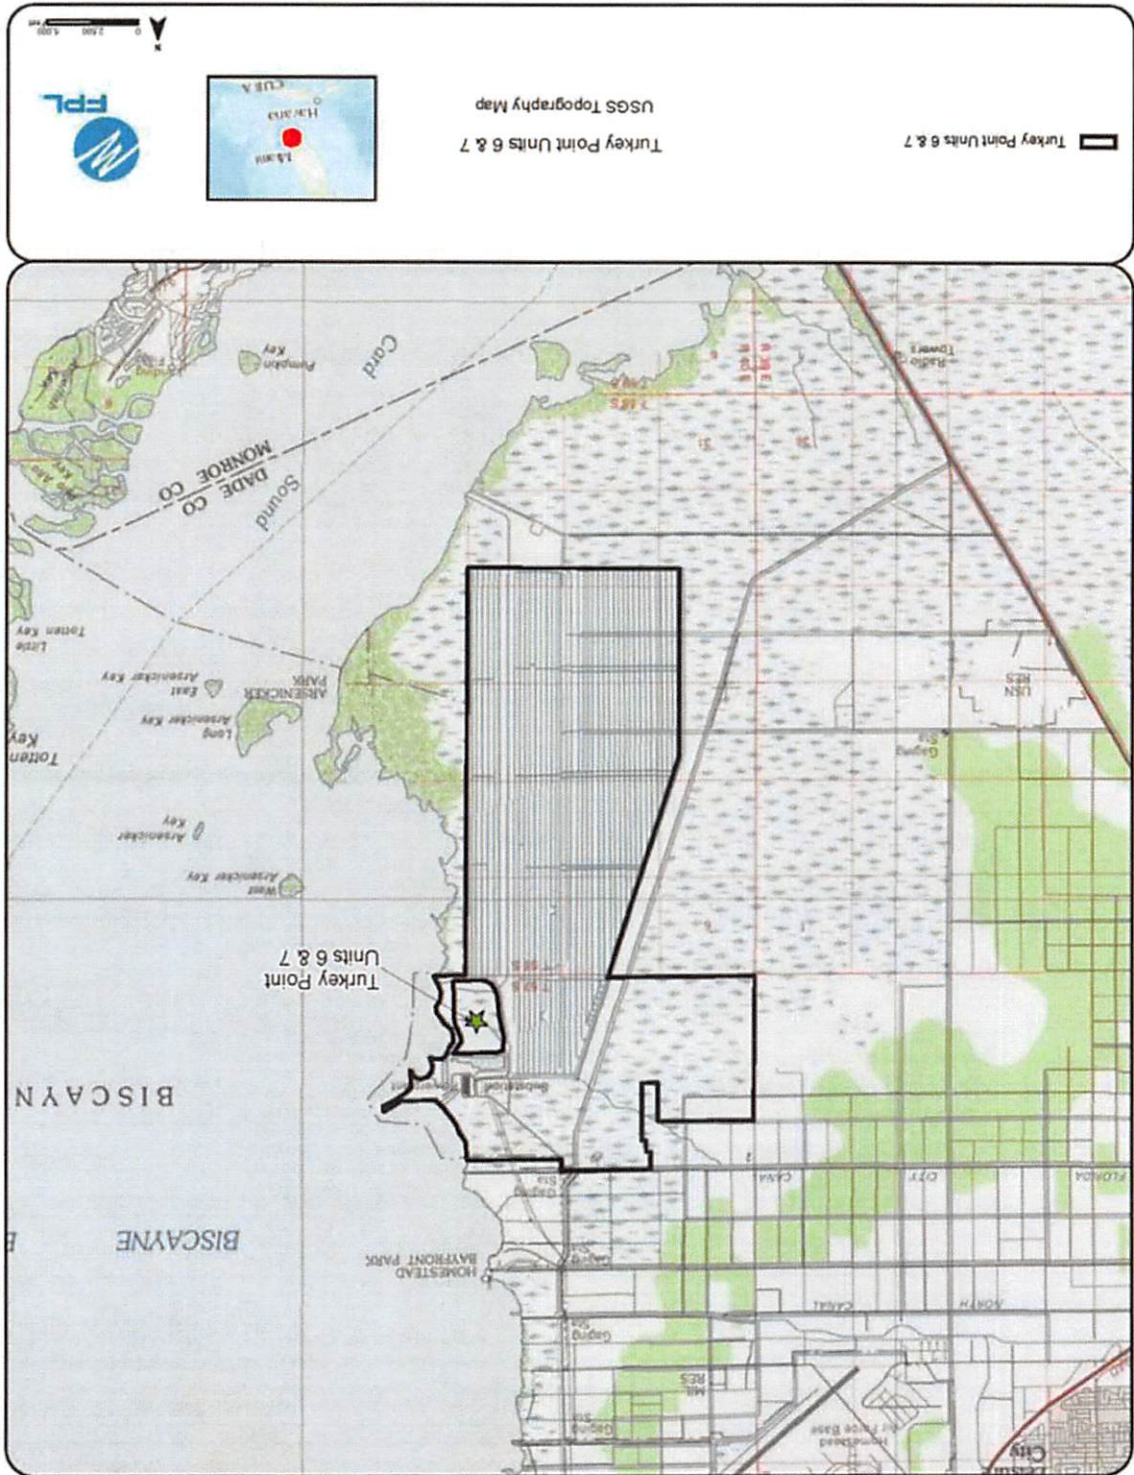

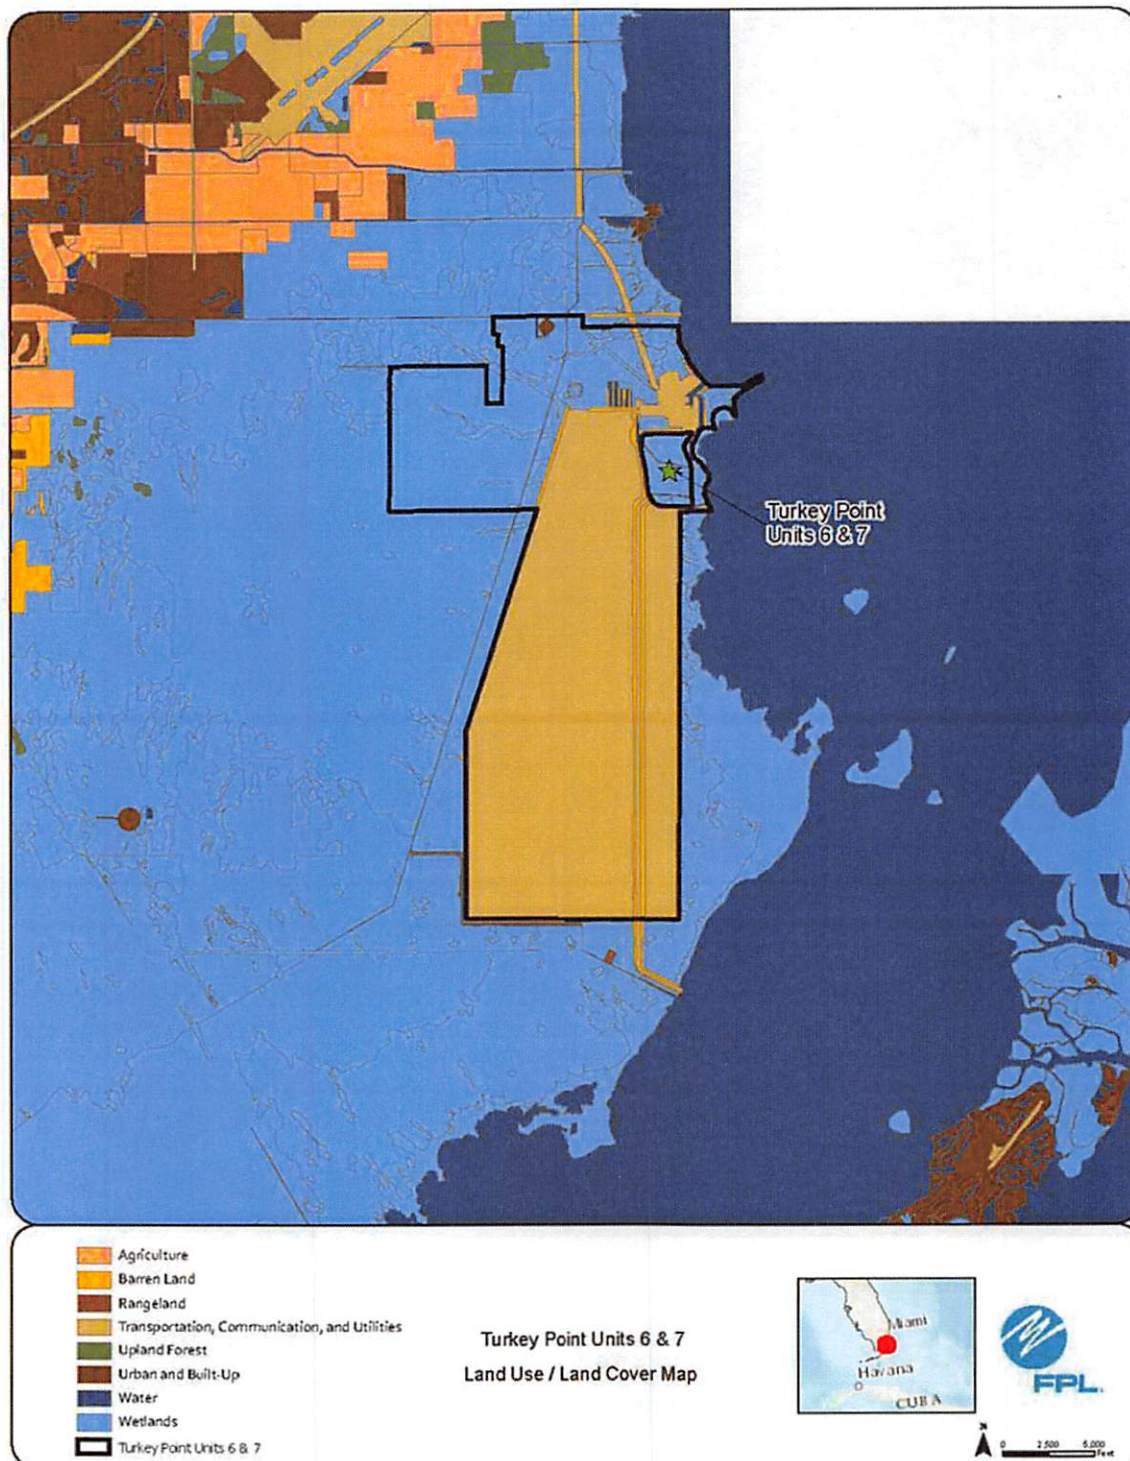



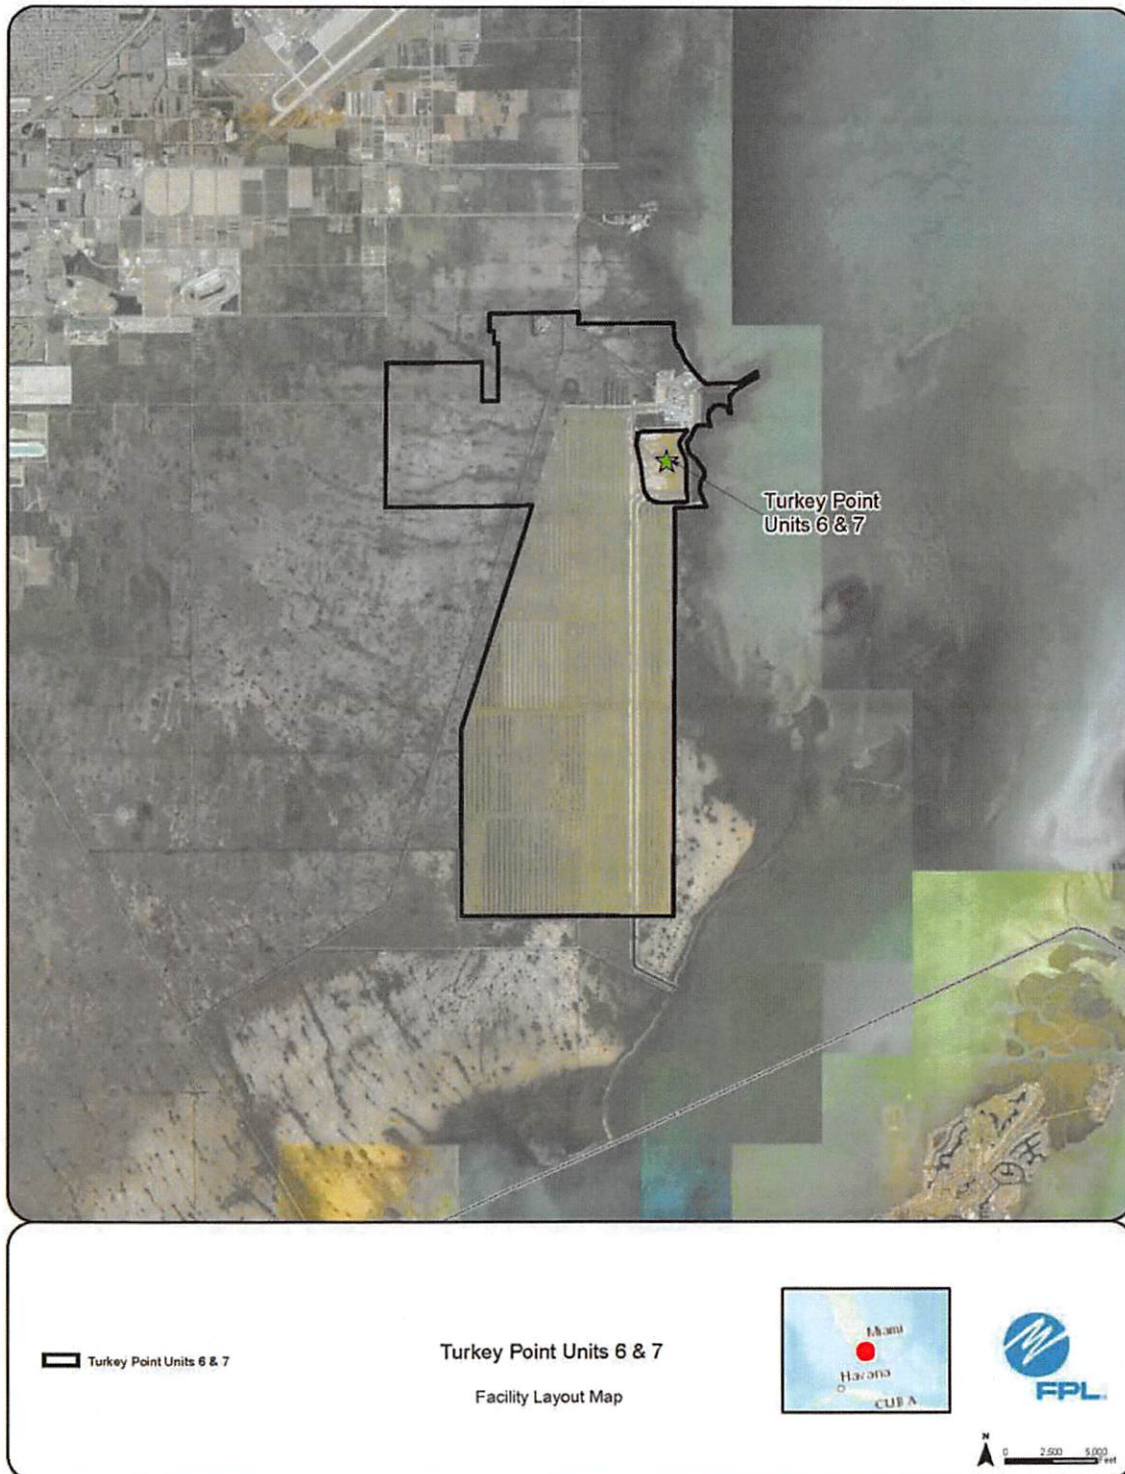

## **Appendix C Potential Sites**

Below are the descriptions regarding each of the 18 Potential Sites listed in Table IV.G.2 in Chapter IV. Following the descriptions are maps showing the topographical features, land use, and facility layout of each site.

### **FPL Area Potential Site #1: Waveland Solar Energy Center**

This potential site in St. Lucie County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

Site is currently improved pasture with agricultural ditches. Surrounding area is improved pasture, fallow agriculture and various active agriculture.

#### **c. Environmental Features**

Site consists mainly of improved pasture with agricultural ditches. Listed species include Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.


Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

#### **e. Supply Sources**


Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.

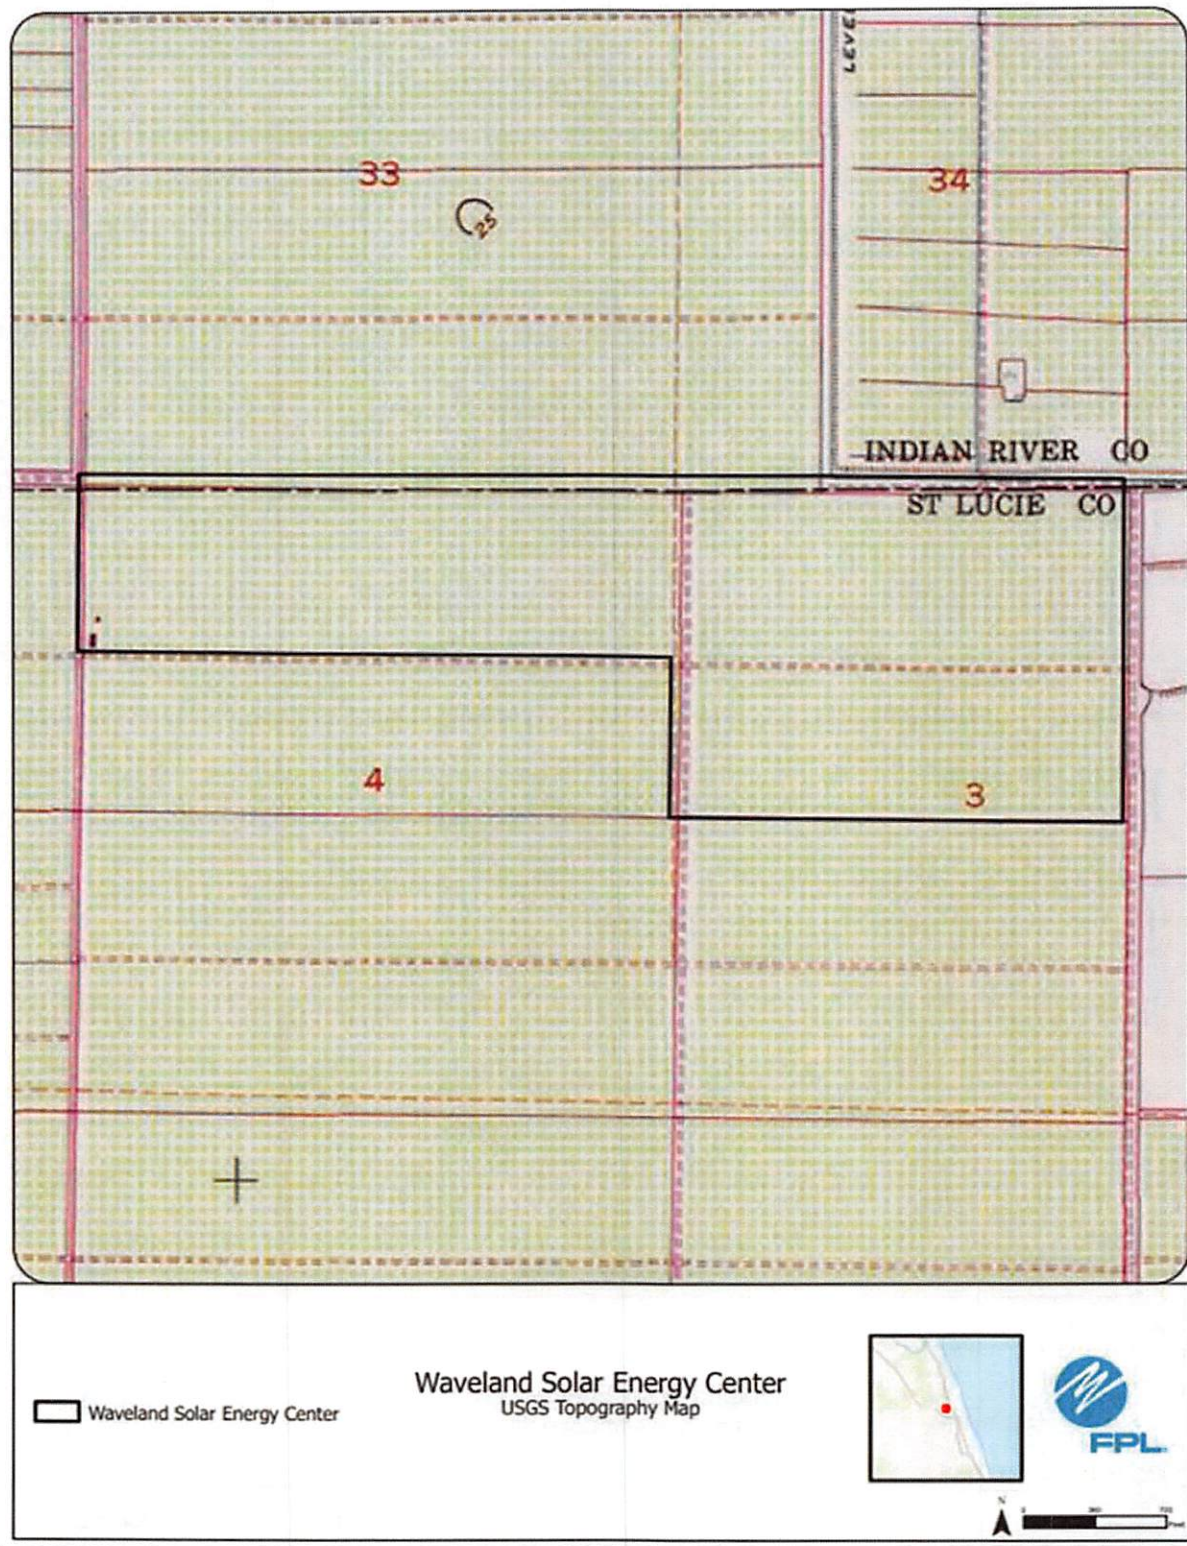



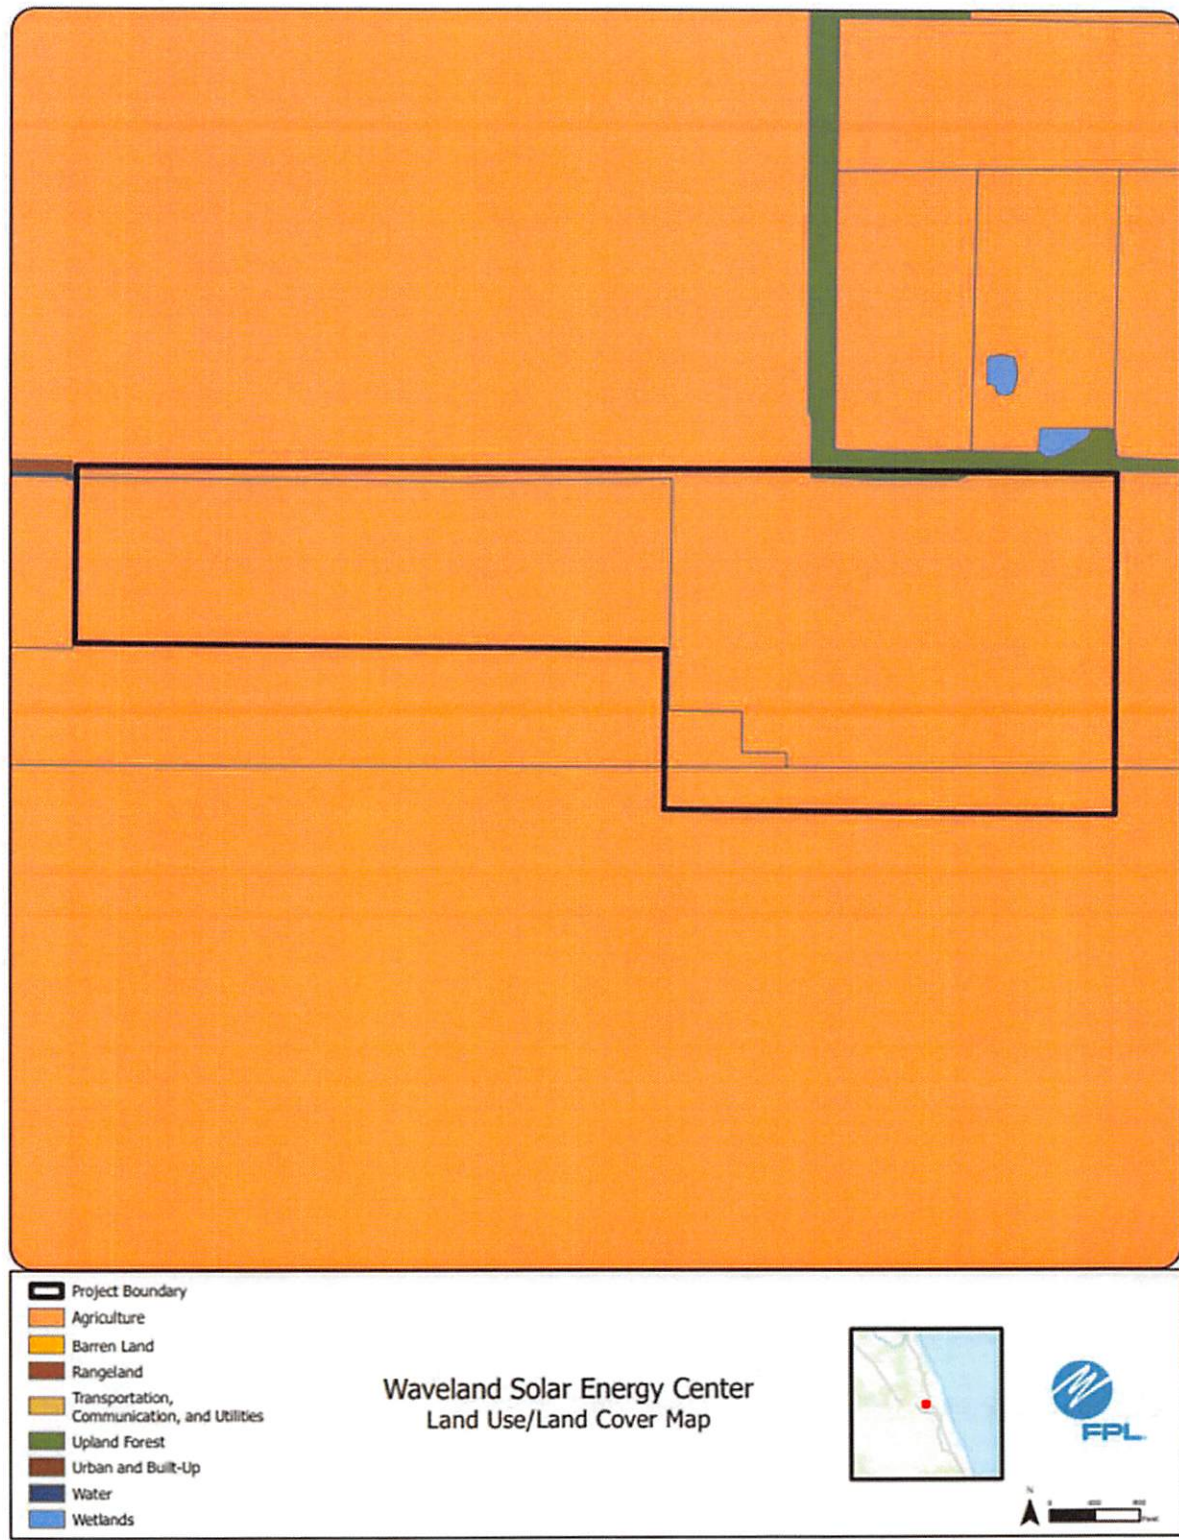





 Waveland Solar Energy Center

# Waveland Solar Energy Center Facility Layout Map



## **FPL Area Potential Site #2: Inlet Solar Energy Center**

This potential site in Indian River County is under evaluation for future PV.

### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

### **b. Existing Land Uses of Site and Adjacent Areas**

Site consists of improved pasture with agricultural ditches. Surrounding area is categorized by fallow agriculture, improved pasture and an adjacent solar energy center. A cell tower (not owned by FPL) is located in the central/west portion of the project area.

### **c. Environmental Features**

The entire site is improved pasture with agricultural ditches. Listed species include Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


### **e. Supply Sources**


Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



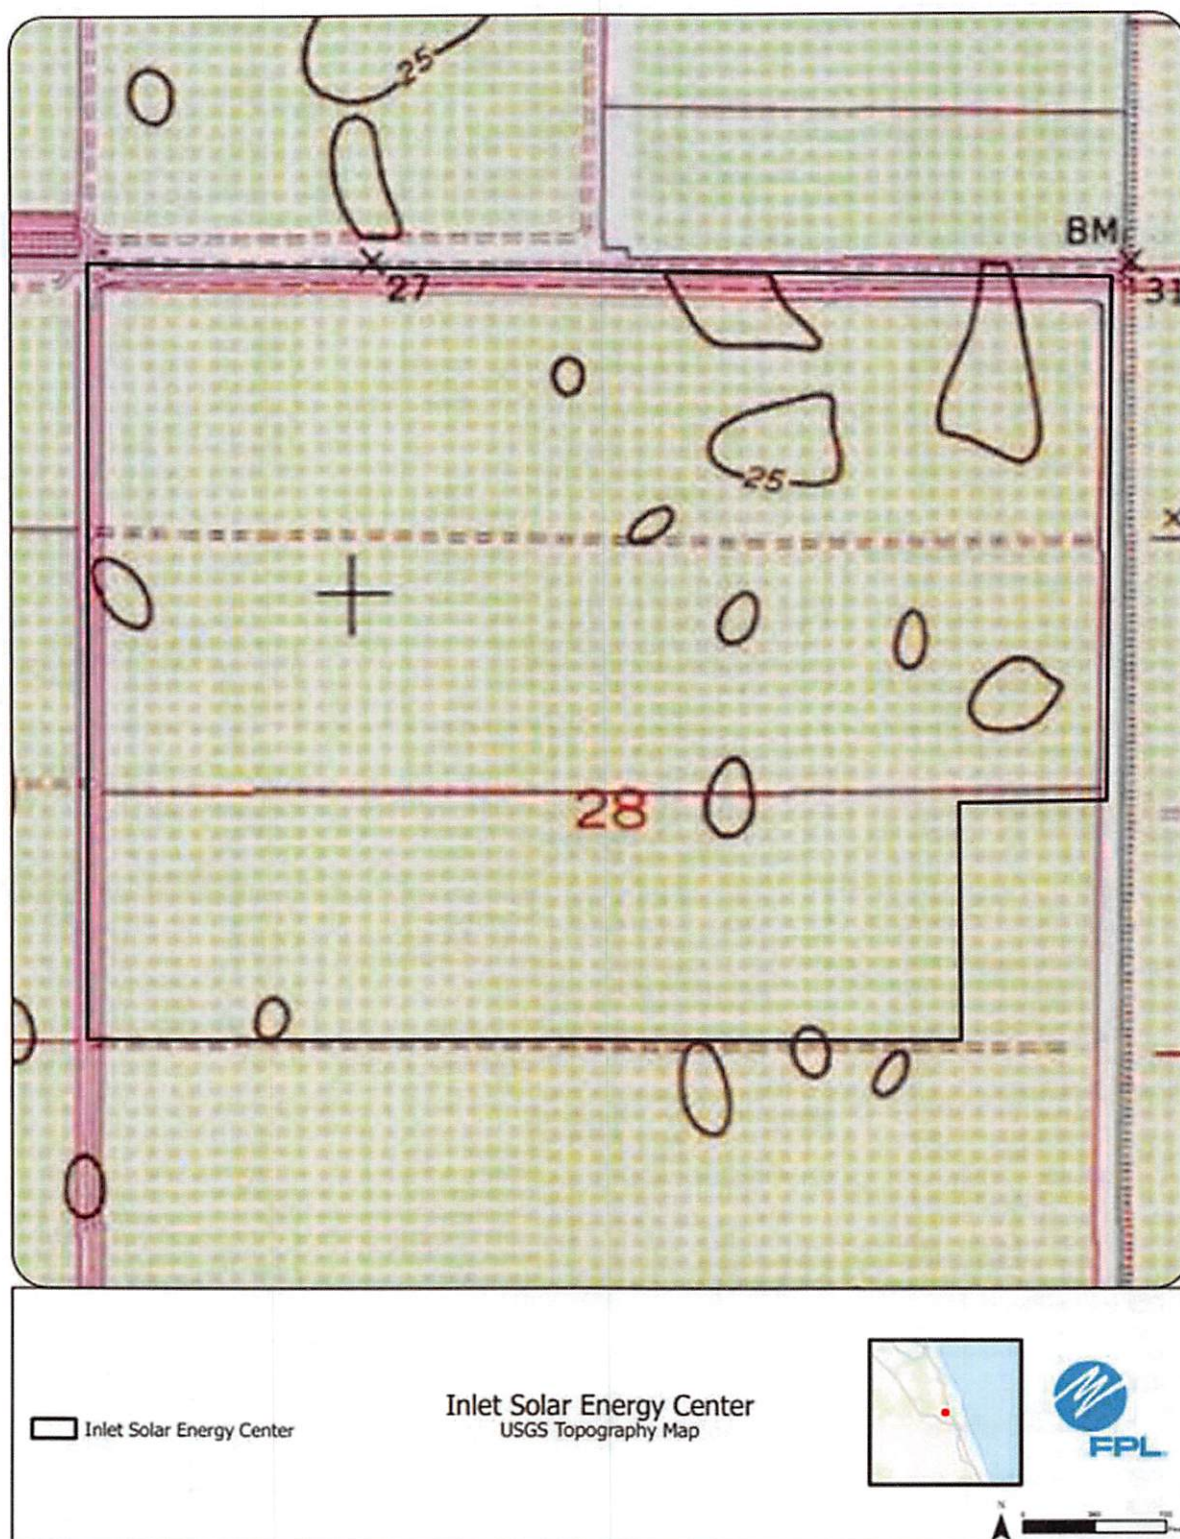

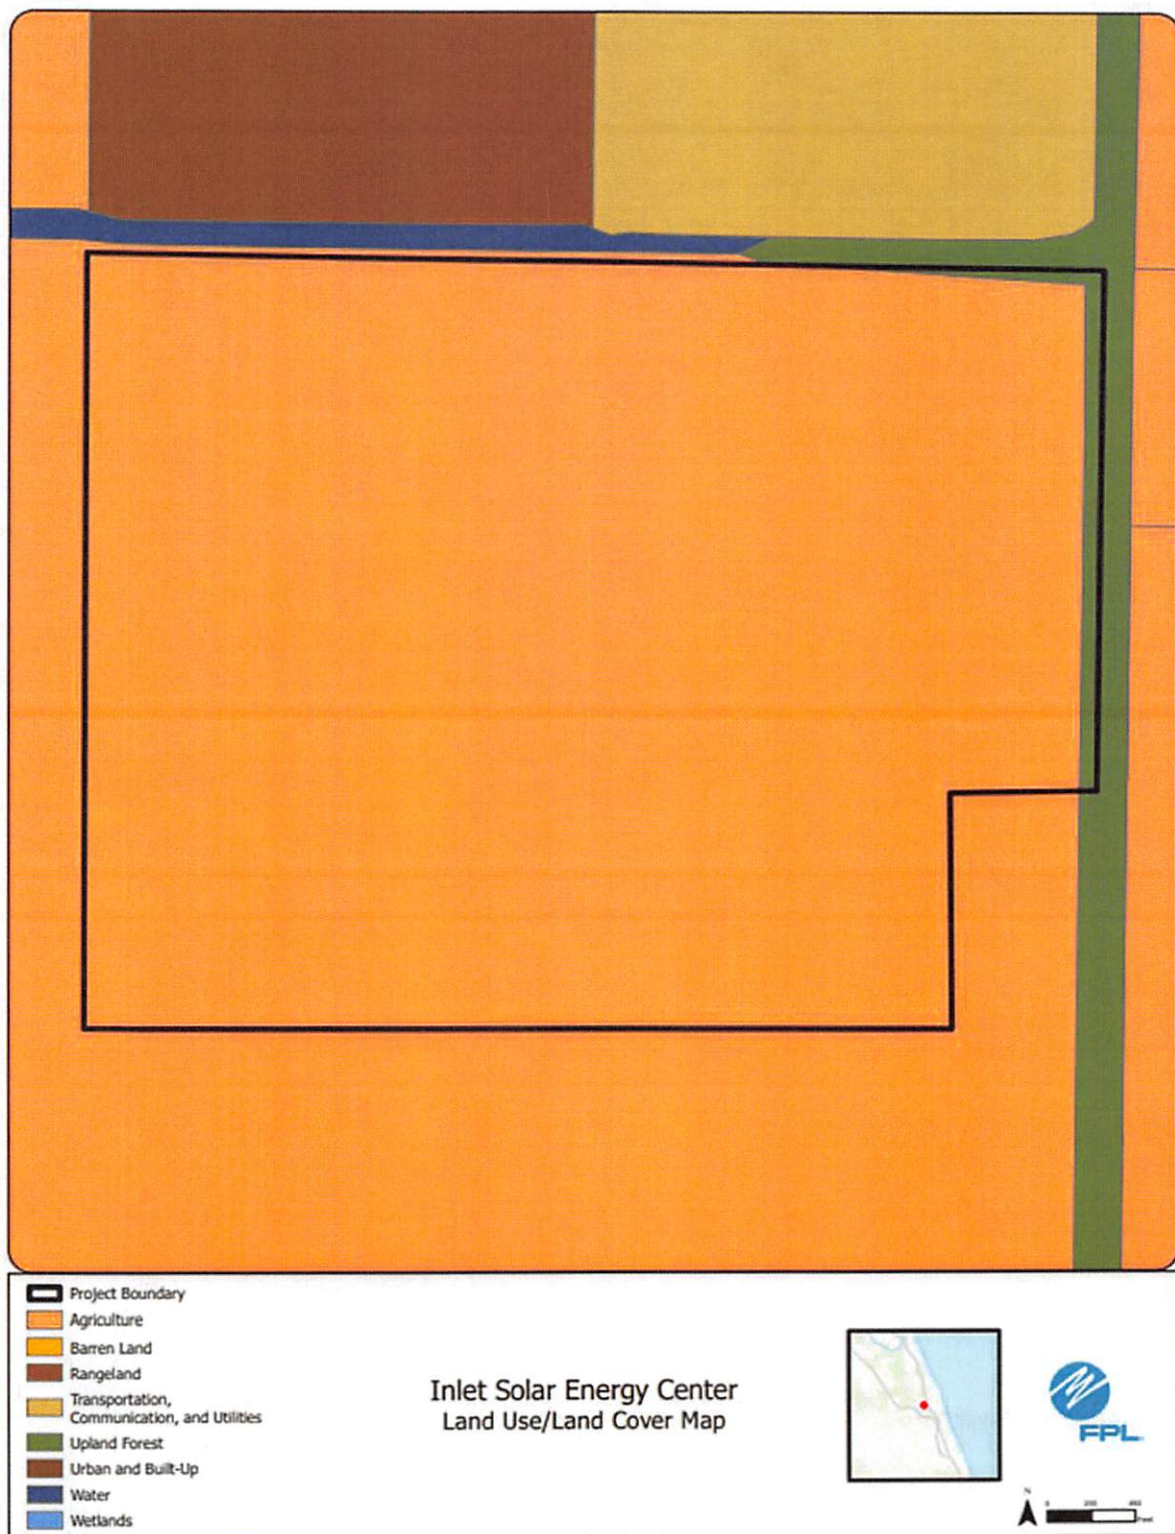





### **FPL Area Potential Site #3: Wabasso Solar Energy Center**

This potential site in Indian River County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

Site is improved pasture and citrus. Surrounding area includes citrus groves and an adjacent solar energy center.

#### **c. Environmental Features**

Site is primarily citrus and improved pasture with agricultural ditches throughout the property. Listed species expected in the vicinity of the project are Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


#### **e. Supply Sources**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



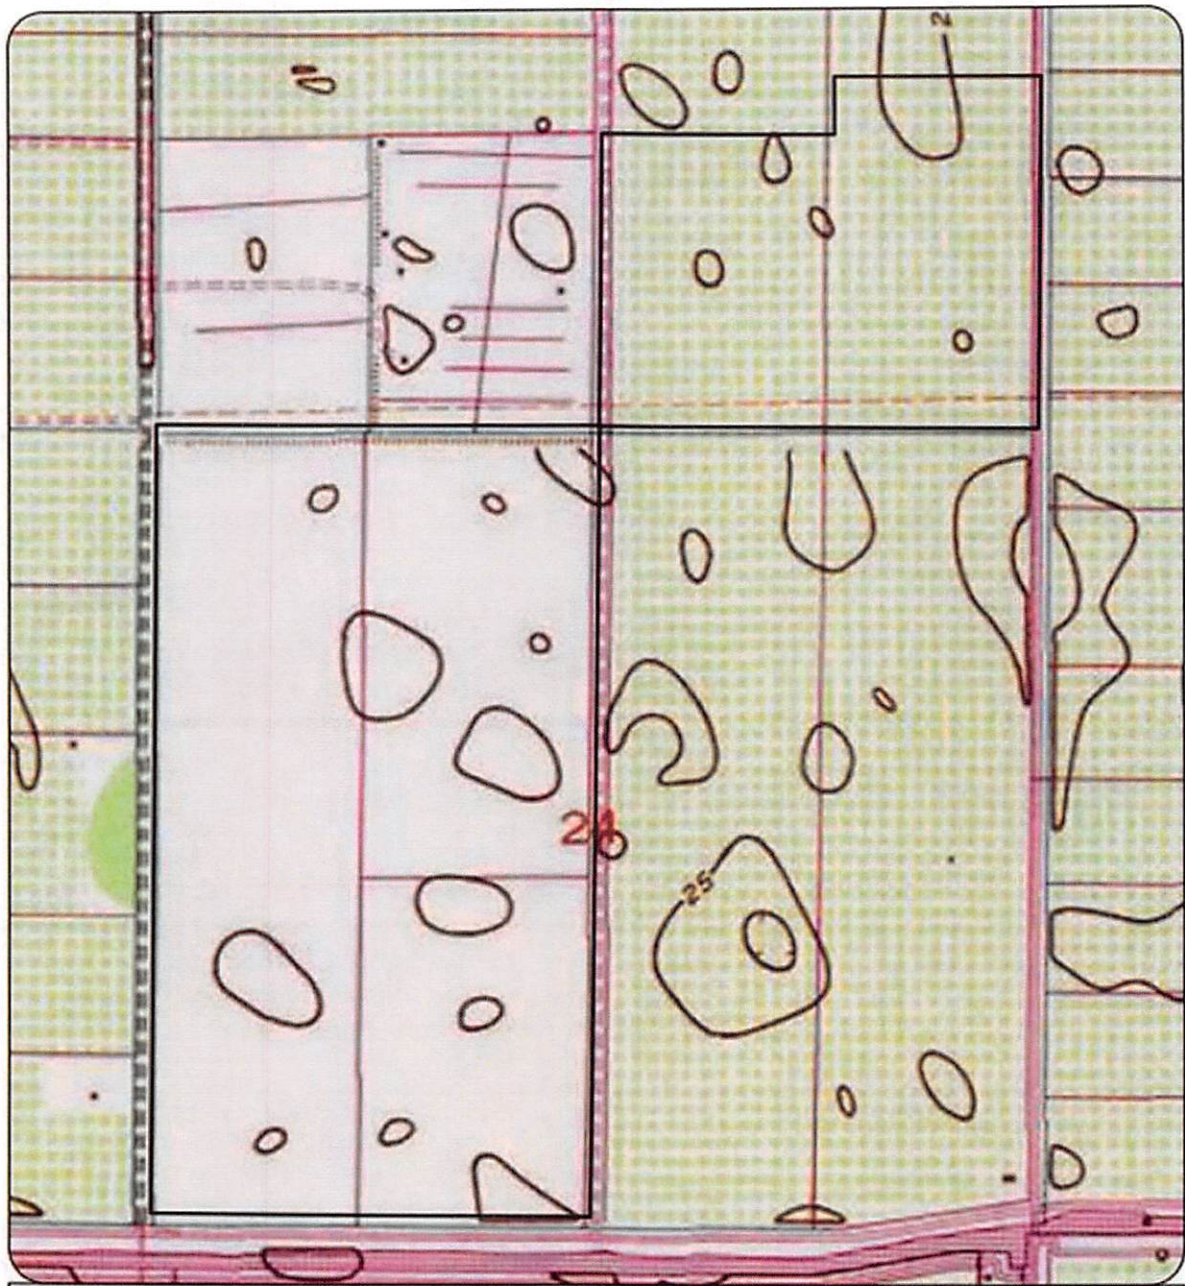


 Wabasso Solar Energy Center

**Wabasso Solar Energy Center**  
 USGS Topography Map





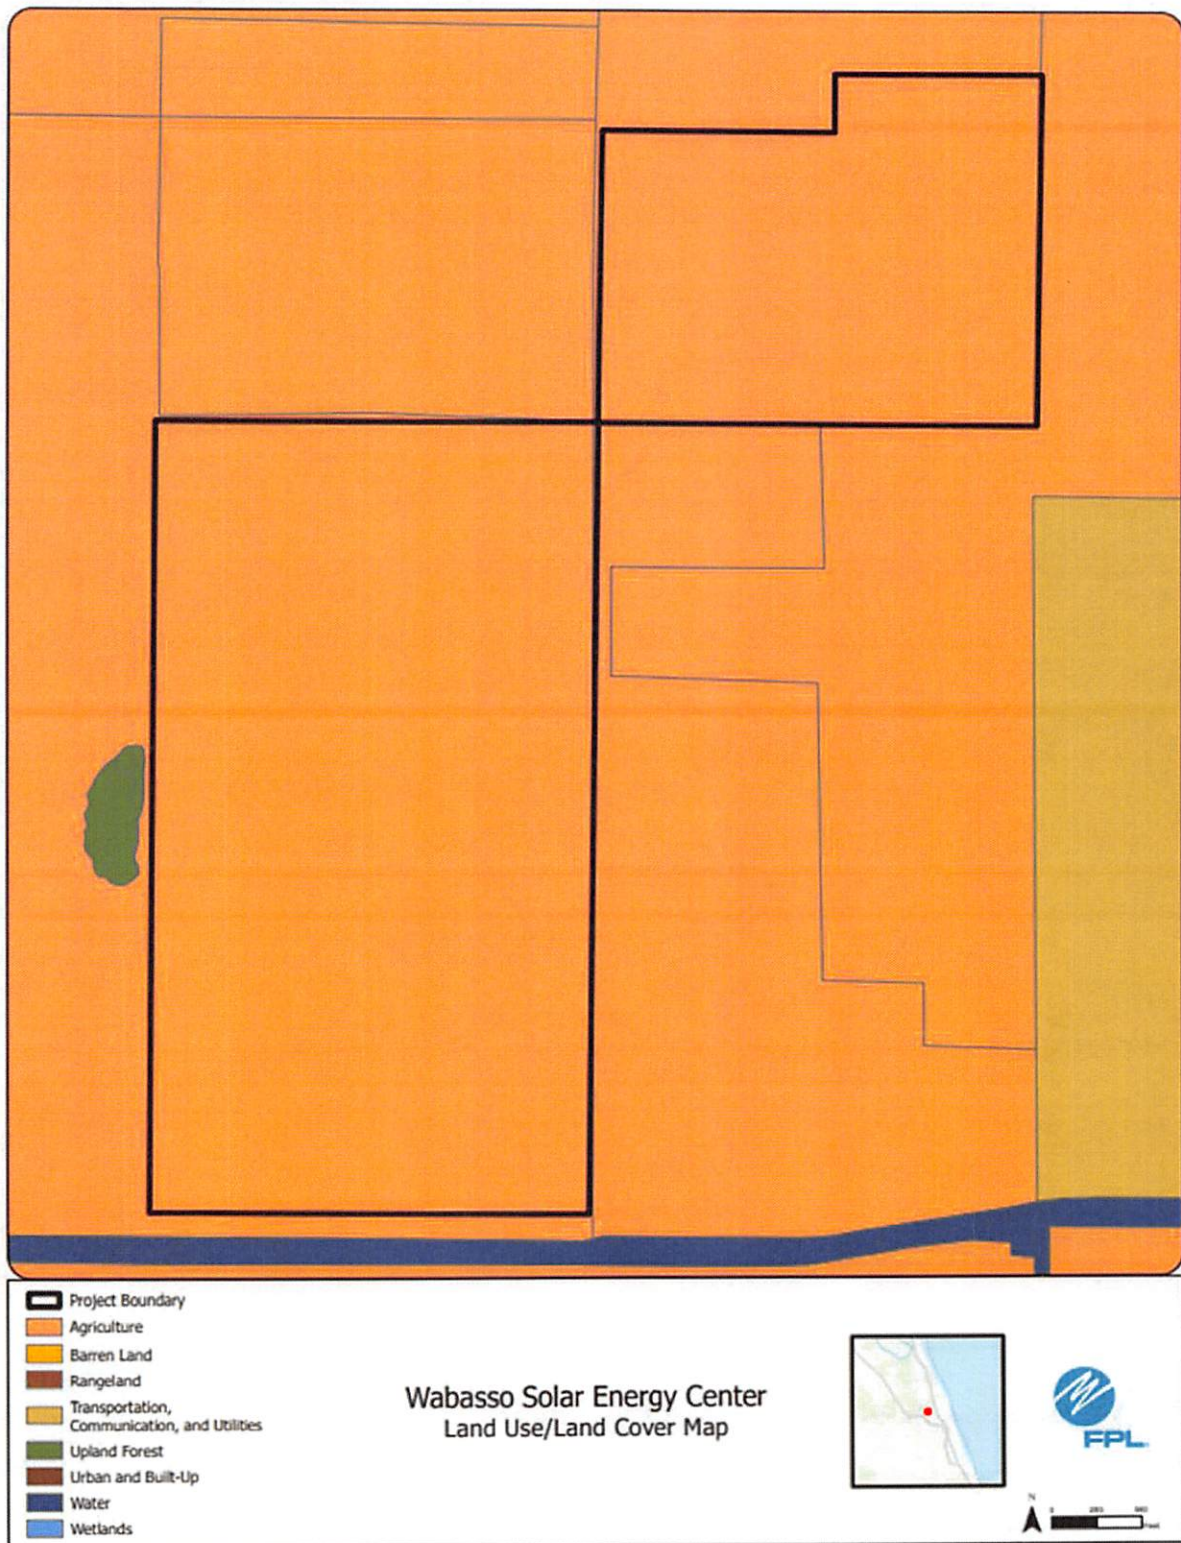






 Wabasso Solar Energy Center

# Wabasso Solar Energy Center Facility Layout Map



#### **FPL Area Potential Site #4: Shores Solar Energy Center**

This potential site in Indian River County is under evaluation for future PV.

##### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

##### **b. Existing Land Uses of Site and Adjacent Areas**

Site is improved pasture and citrus. Surrounding area includes agricultural ditches, citrus groves and an adjacent solar energy center.

##### **c. Environmental Features**

Site is primarily citrus and improved pasture with agricultural ditches throughout the property. Listed species expected in the vicinity of the project are Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

##### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


##### **e. Supply Sources**

Cooling: Not Applicable for PV.


Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.




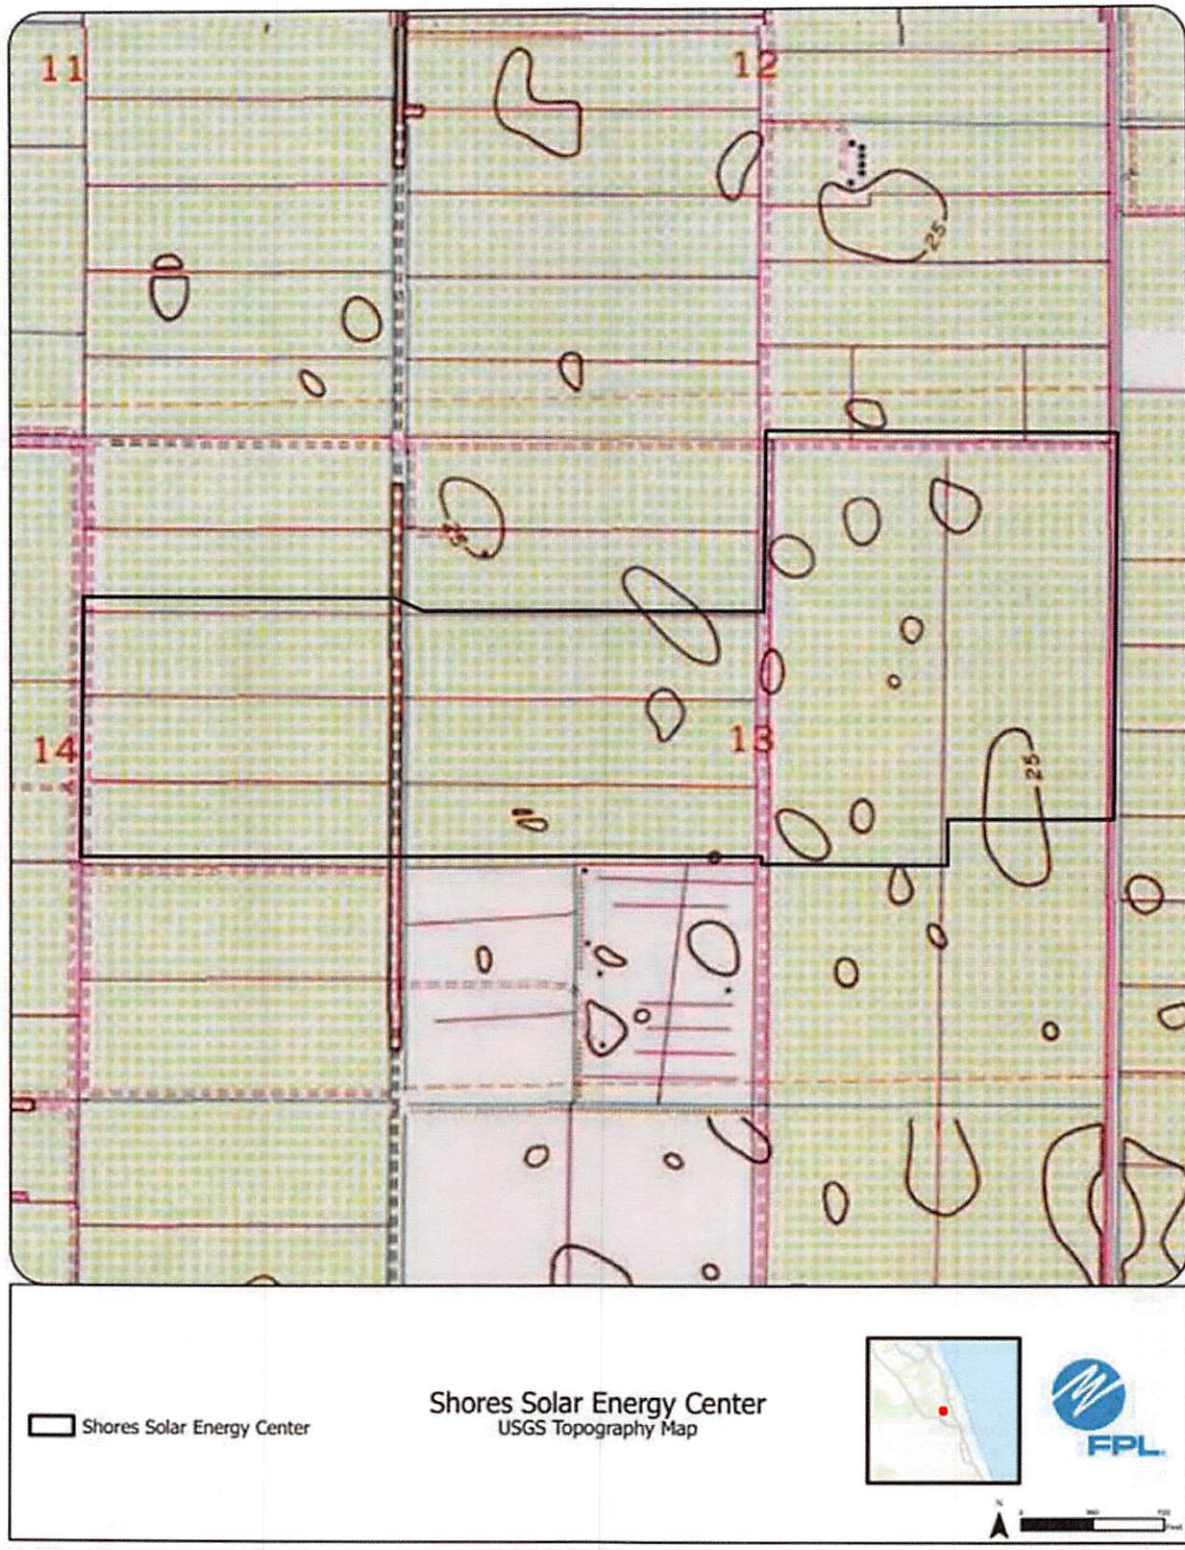



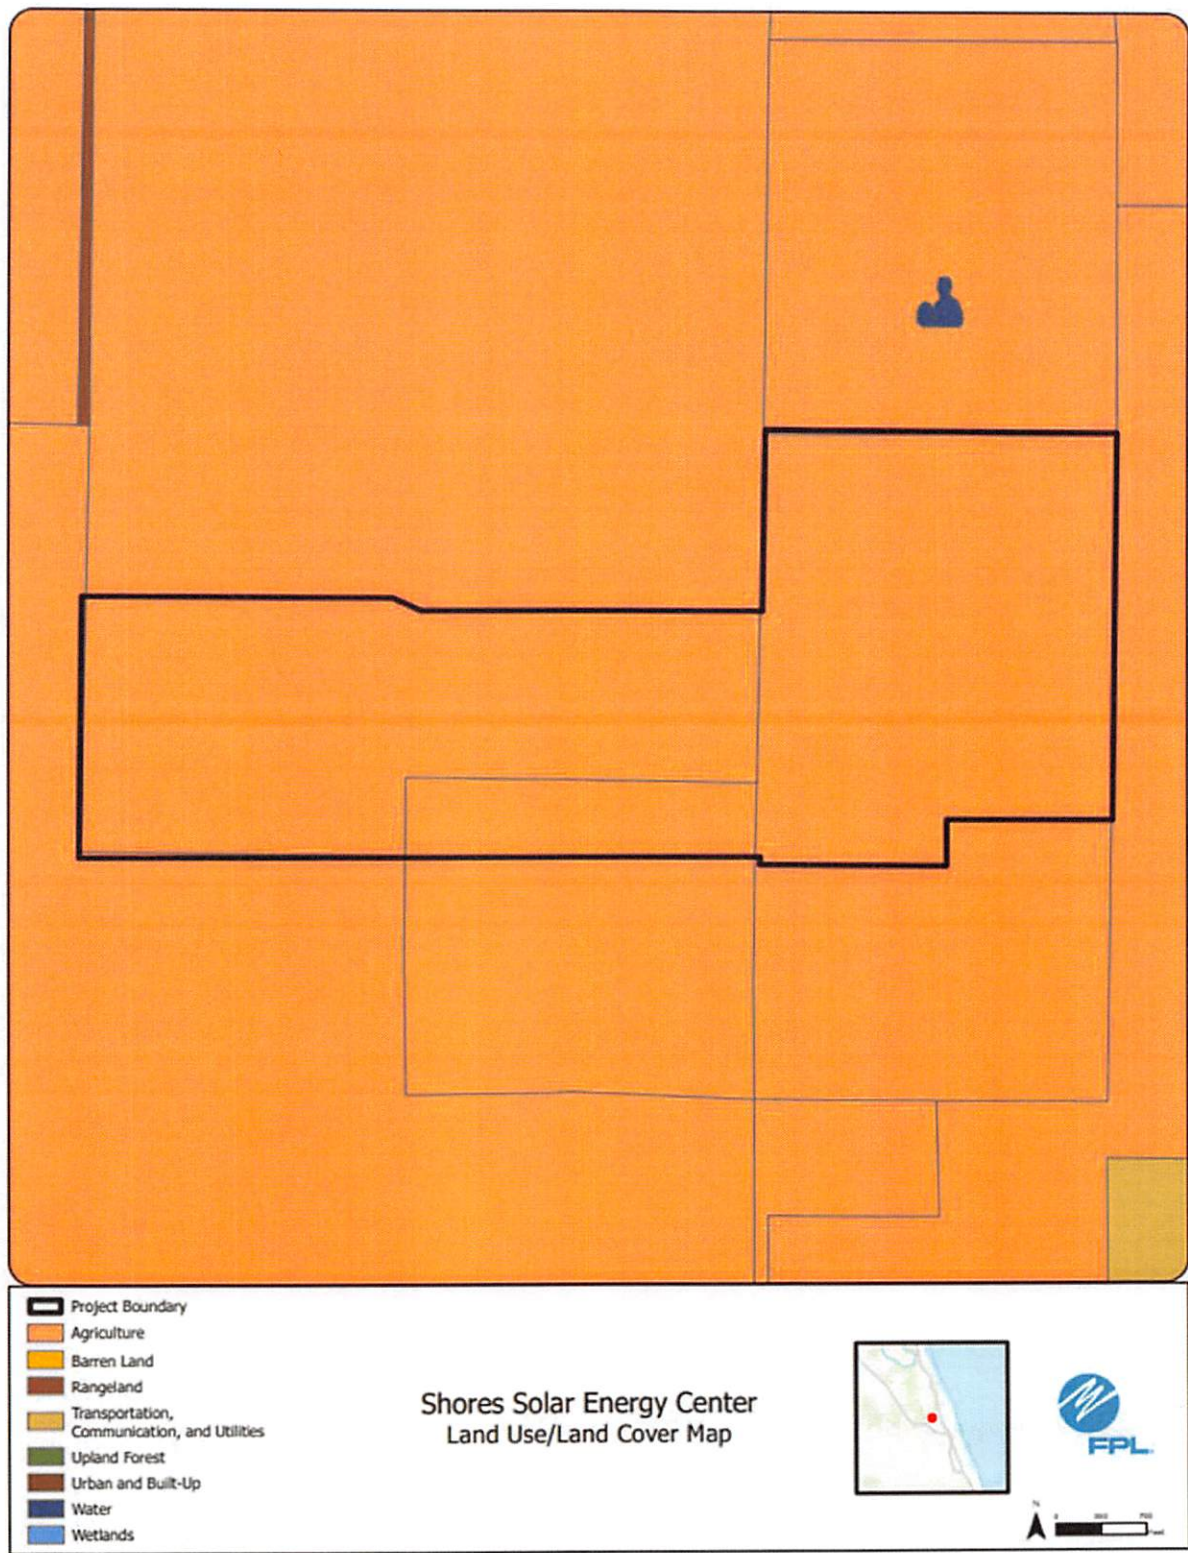



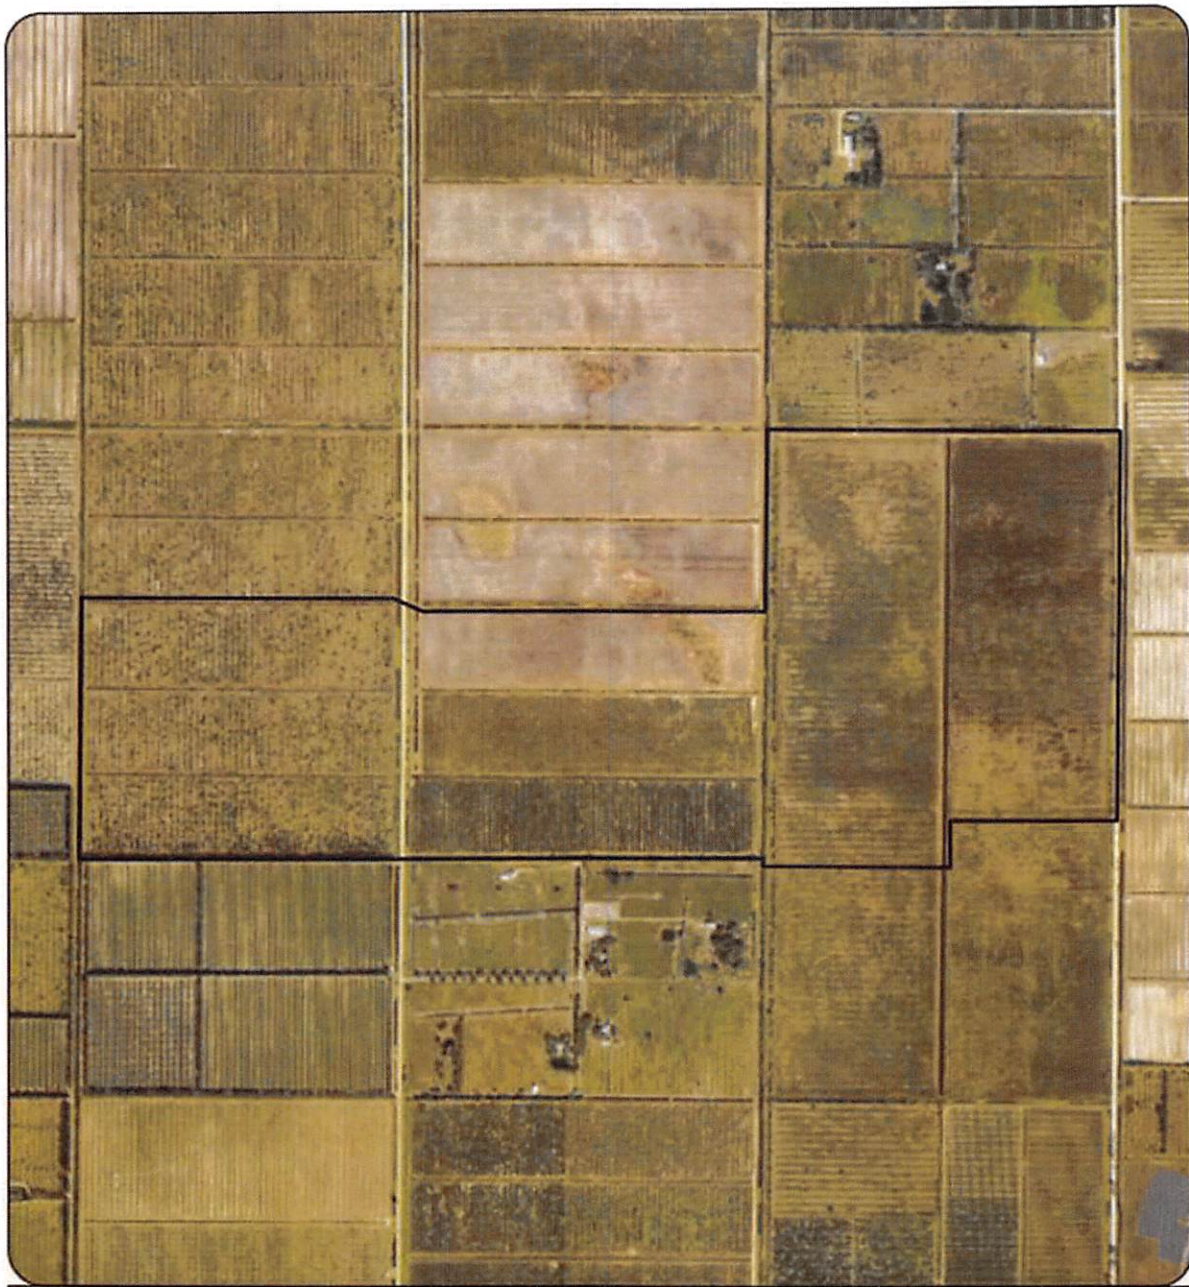

 Shores Solar Energy Center

# Shores Solar Energy Center Facility Layout Map



### **FPL Area Potential Site #5: Beachland Solar Energy Center**

This potential site in Indian River County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

Site is improved pasture and citrus. Surrounding area includes agricultural ditches, citrus groves and an adjacent solar energy center.

#### **c. Environmental Features**

Site is primarily citrus and improved pasture with agricultural ditches throughout the property. Listed species expected in the vicinity of the project are Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


#### **e. Supply Sources**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



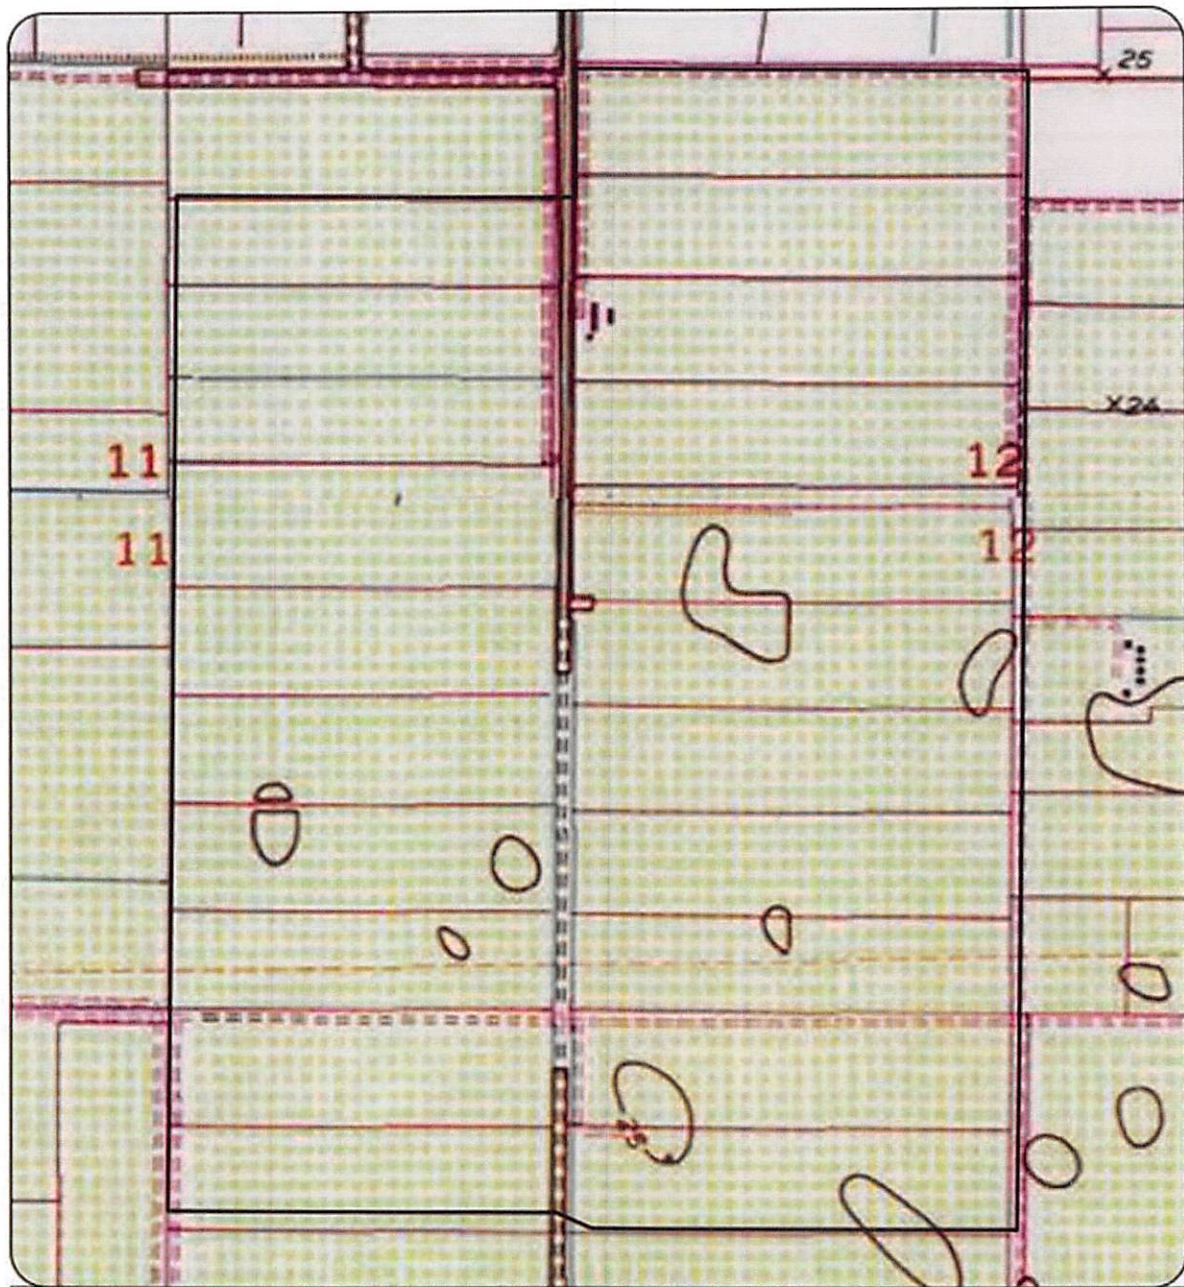


Beachland Solar Energy Center


Beachland Solar Energy Center  
USGS Topography Map





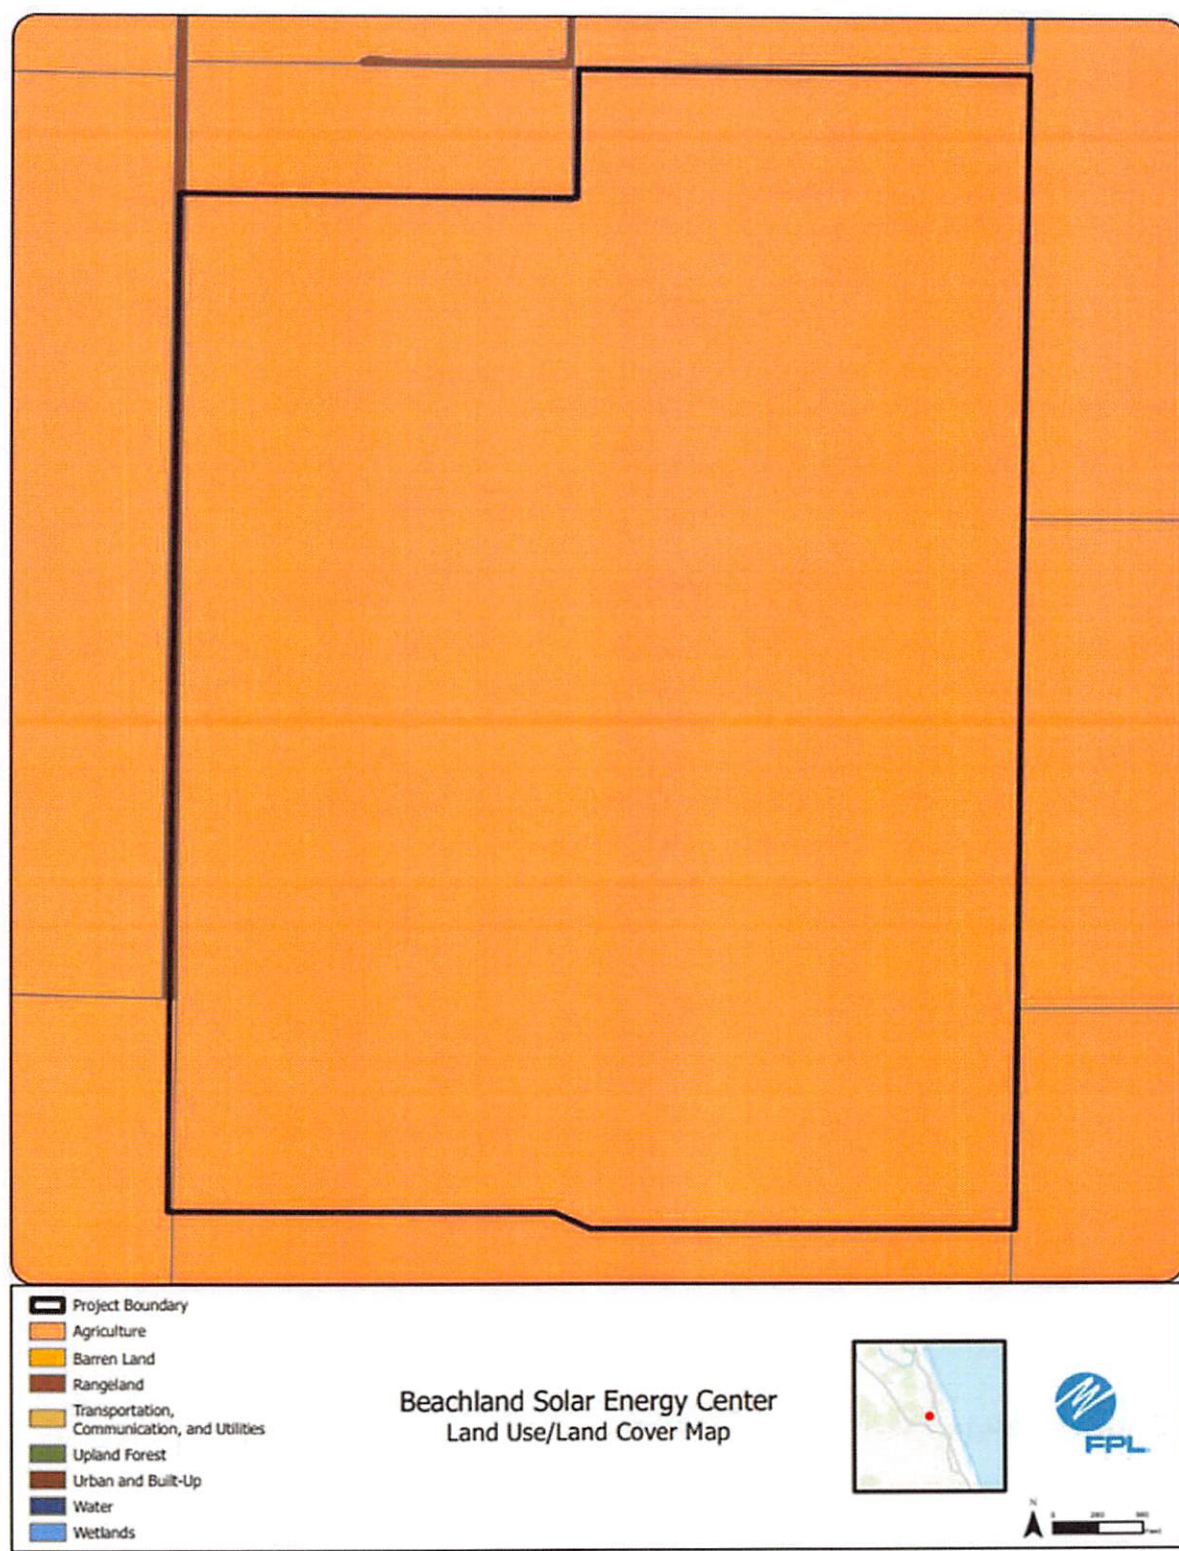



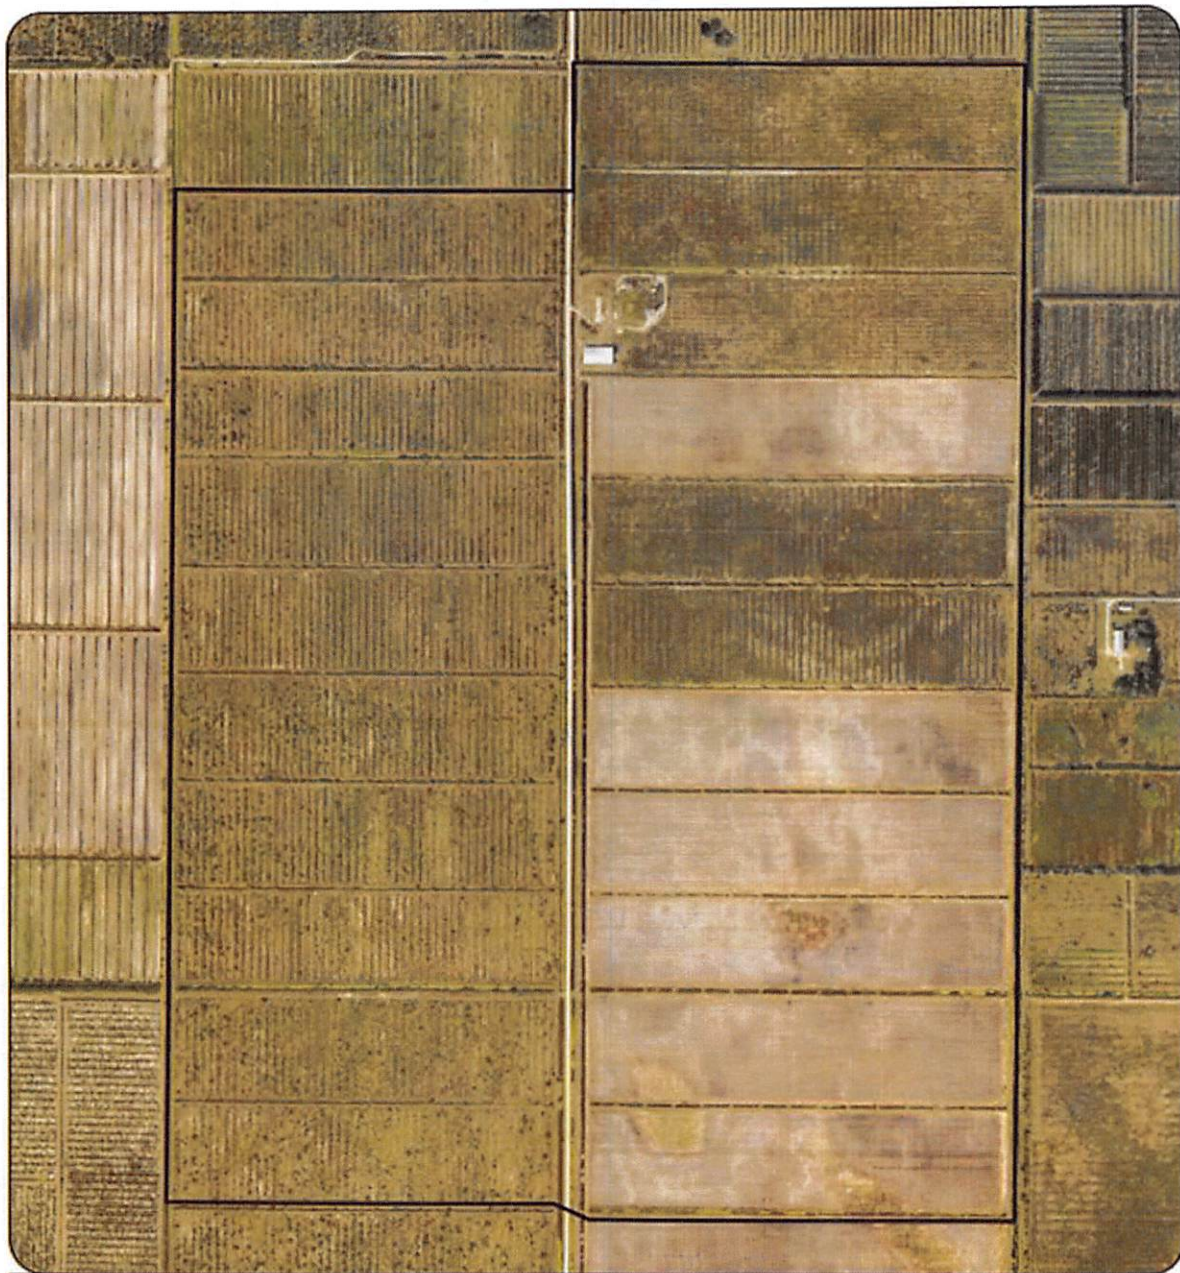

 Beachland Solar Energy Center

# Beachland Solar Energy Center Facility Layout Map



## **FPL Area Potential Site #6: Treefrog Solar Energy Center**

This potential site in Collier County is under evaluation for future PV.

### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

### **b. Existing Land Uses of Site and Adjacent Areas**

The site and the surrounding area consist of various agricultural activities.

### **c. Environmental Features**

Site is generally comprised of various agricultural areas and wetlands. Listed species in the vicinity of the project include the Audubon's crested caracara, Florida panther and gopher tortoise. No adverse impacts to listed species are anticipated. Corkscrew Swamp is located approximately 5,000 feet to the west.

### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


### **e. Supply Sources**

Cooling: Not Applicable for PV.


Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



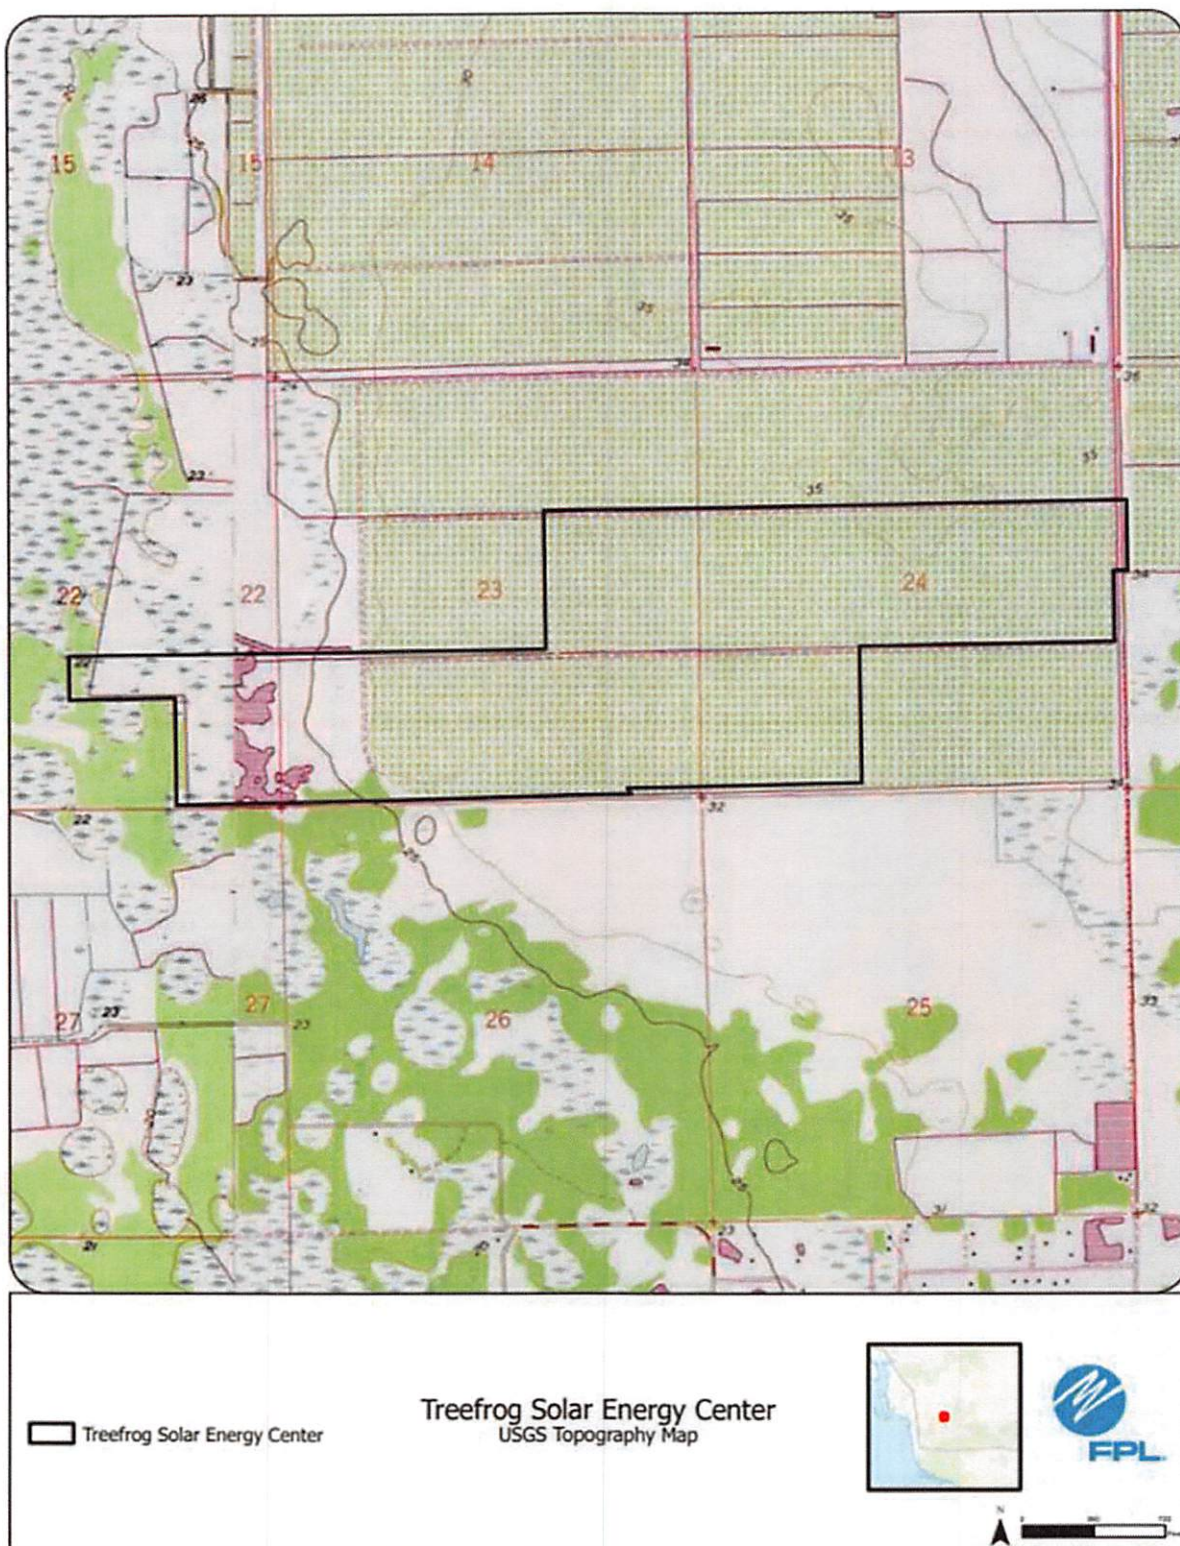



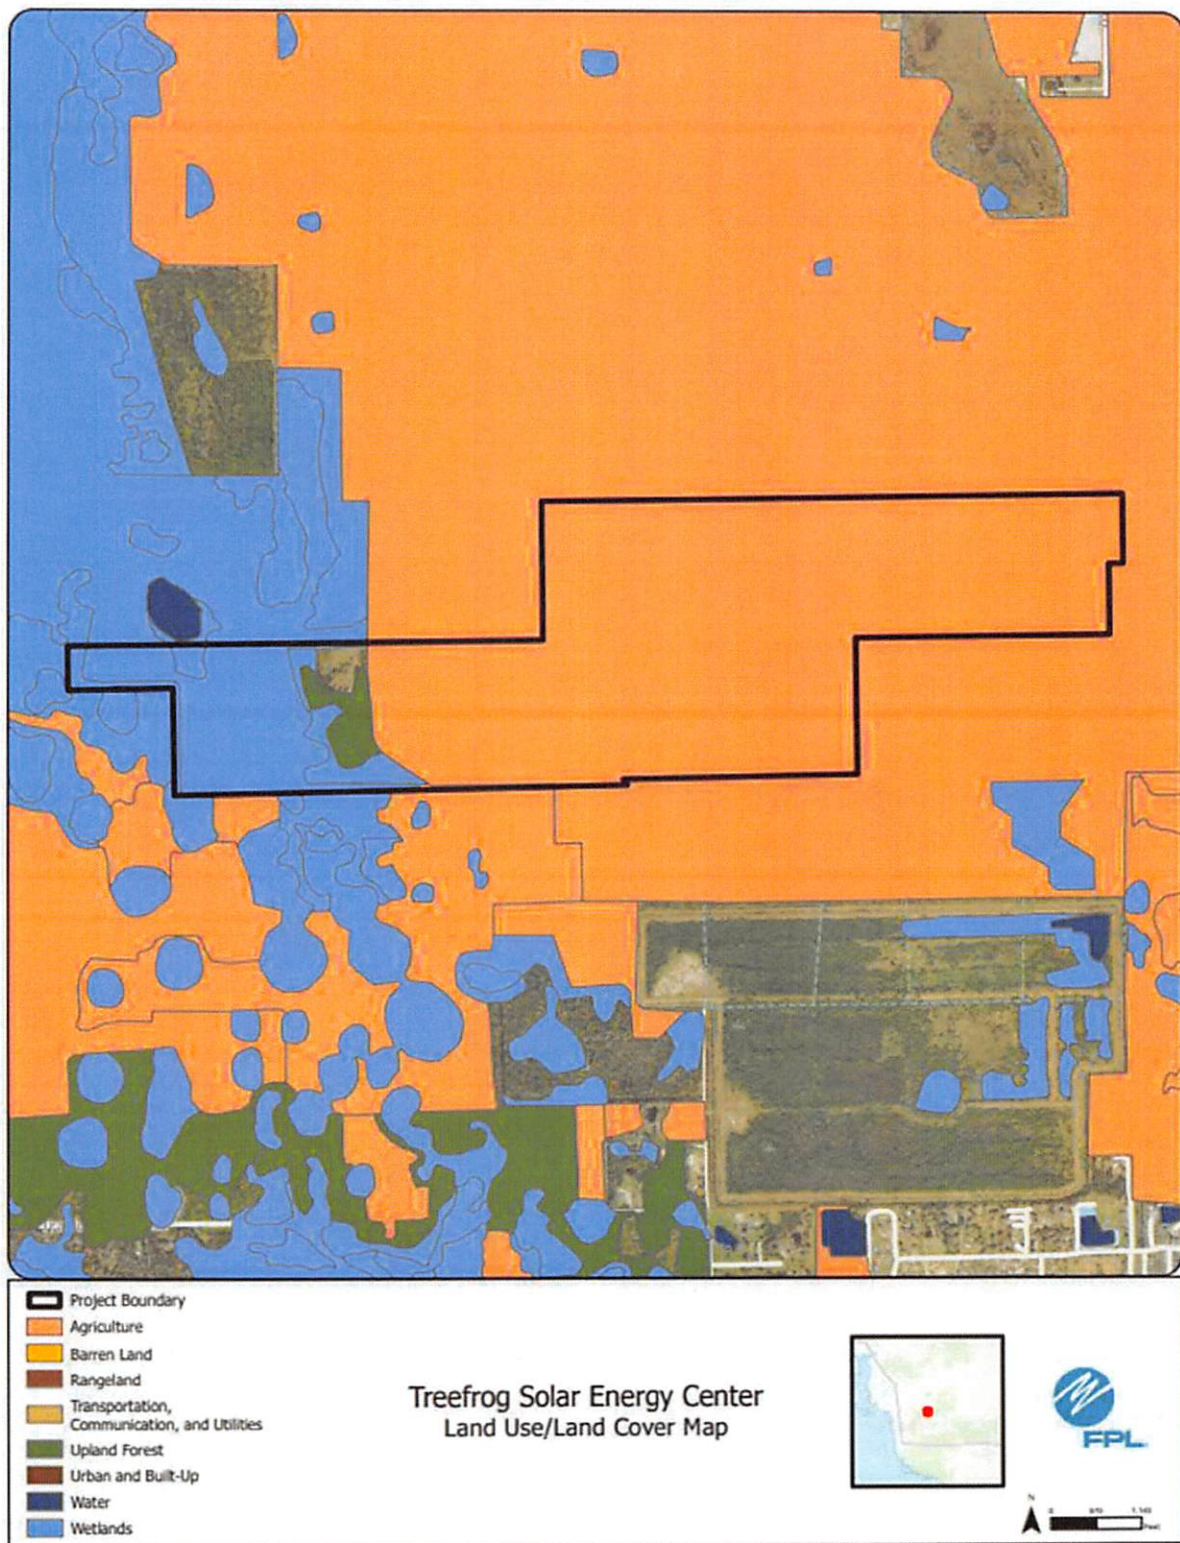





 Treefrog Solar Energy Center

# Treefrog Solar Energy Center Facility Layout Map





## **FPL Area Potential Site #7: Honeybee Branch Solar Energy Center**

This potential site in Collier County is under evaluation for future PV.

### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

### **b. Existing Land Uses of Site and Adjacent Areas**

The site and the surrounding area consist of various agricultural activities.

### **c. Environmental Features**

Site is generally comprised of various agricultural areas and wetlands. Listed species in the vicinity of the project include the Audubon's crested caracara, Florida panther and gopher tortoise. No adverse impacts to listed species are anticipated. Corkscrew Swamp is located approximately 4,000 feet to the southwest.

### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.


Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

### **e. Supply Sources**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.

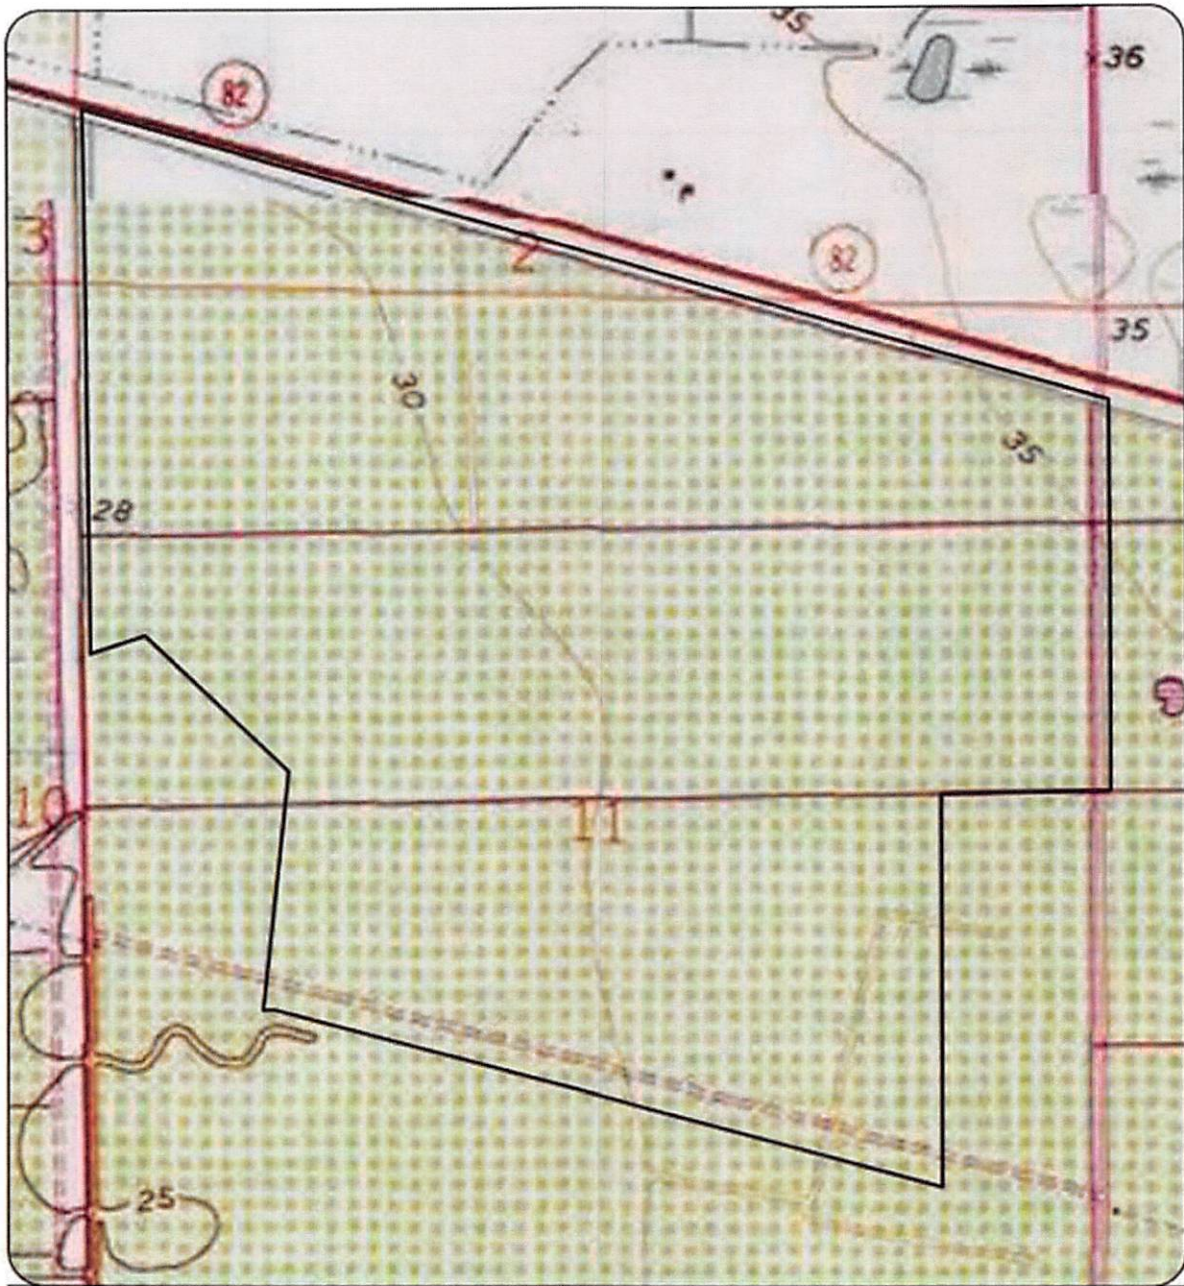


 Honeybee Solar Energy Center

Honeybee Solar Energy Center  
 USGS Topography Map





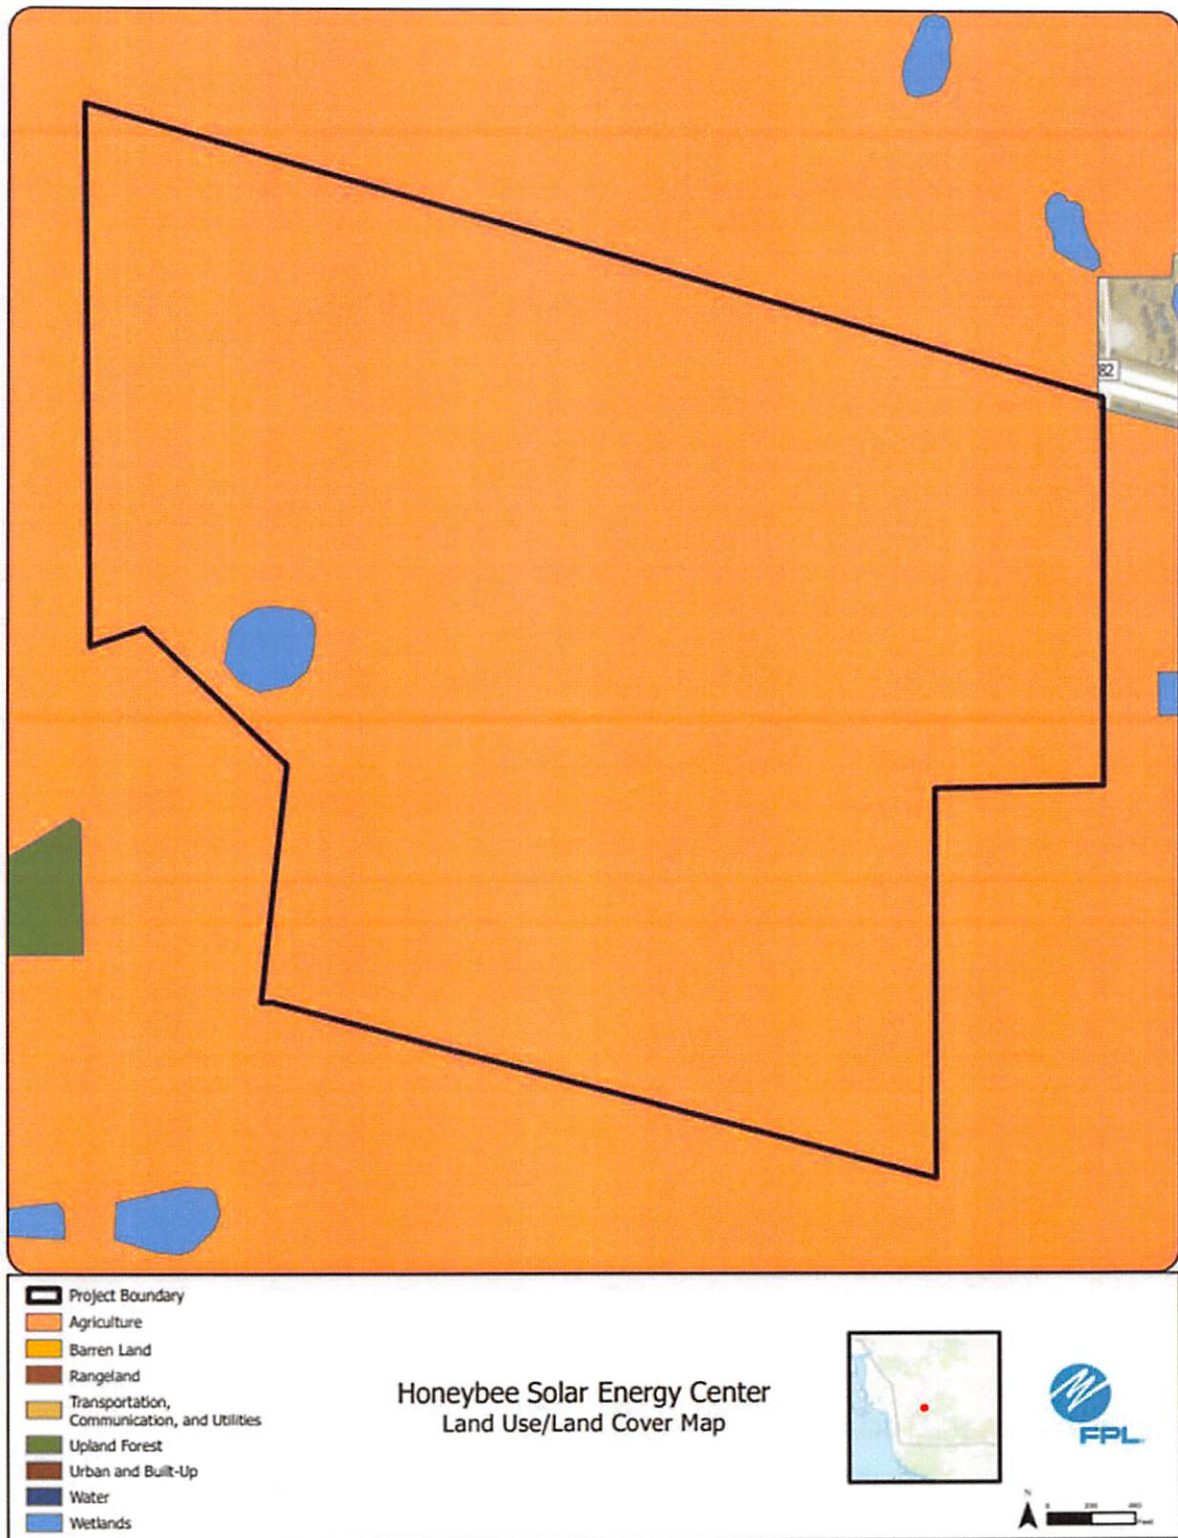





 Honeybee Solar Energy Center

# Honeybee Solar Energy Center Facility Layout Map



### **FPL Area Potential Site #8: Bromeliad Solar Energy Center**

This potential site in Collier County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

The site and the surrounding area consist of various agricultural activities.

#### **c. Environmental Features**

Site is generally comprised of various agricultural areas and wetlands. Listed species in the vicinity of the project include the Audubon's crested caracara, Florida panther and gopher tortoise. No adverse impacts to listed species are anticipated. Corkscrew Swamp is located approximately 1,800 feet to the west.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


#### **e. Supply Sources**


Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



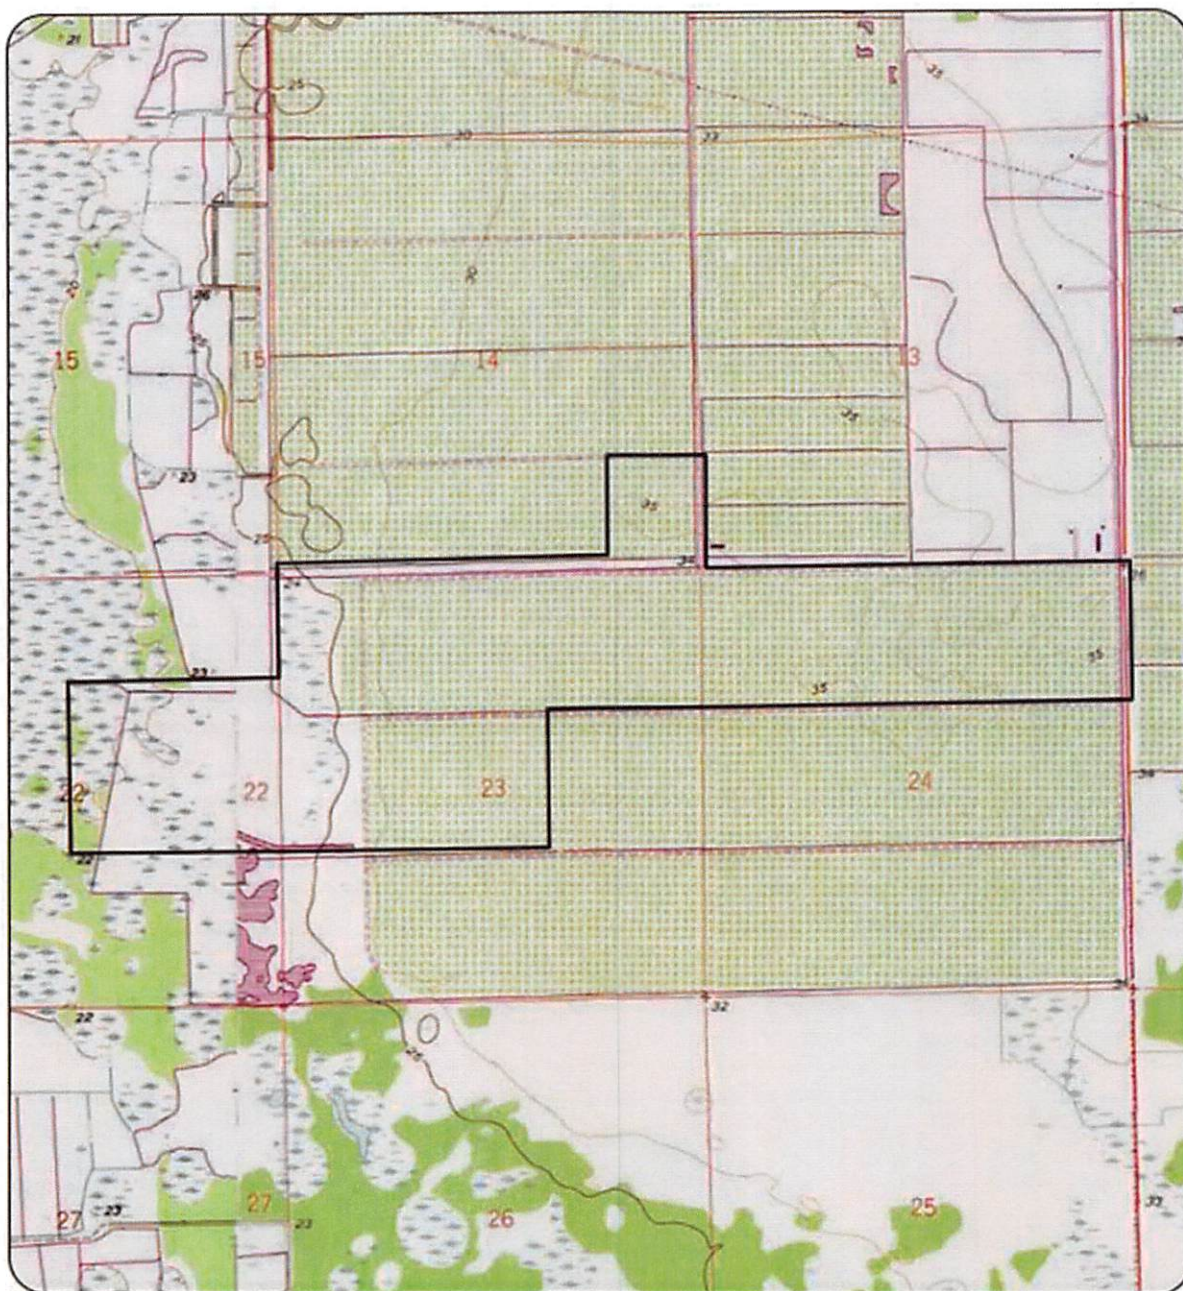


 Bromeliad Solar Energy Center

**Bromeliad Solar Energy Center**  
USGS Topography Map





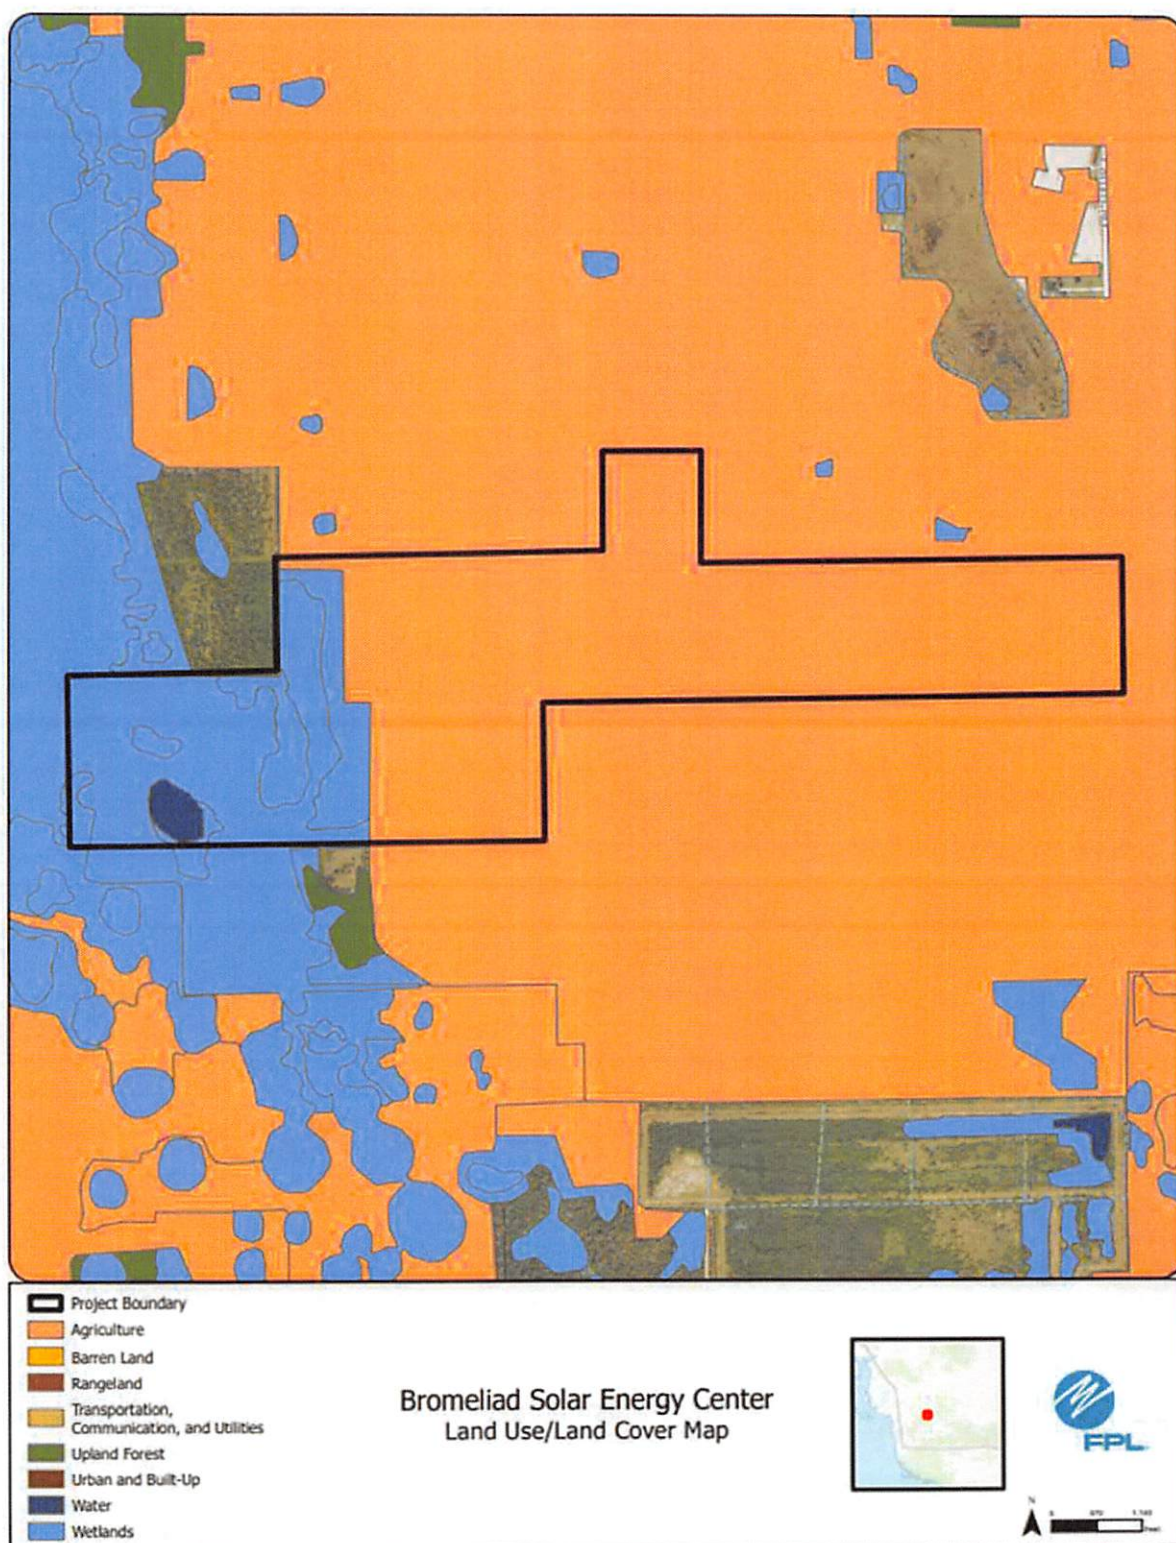





 Bromeliad Solar Energy Center

# Bromeliad Solar Energy Center Facility Layout Map



### **FPL Area Potential Site #9: Myakka Solar Energy Center**

This potential site in Manatee County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

Site was formerly citrus and now consists of open fields with adjacent wetlands. Surrounding area is currently agricultural land and low-density residential areas.

#### **c. Environmental Features**

Site consists mainly of open fields with adjacent wetlands. Owens Branch is near the project. Listed species in the vicinity of the project include Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


#### **e. Supply Sources**

Cooling: Not Applicable for PV.


Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



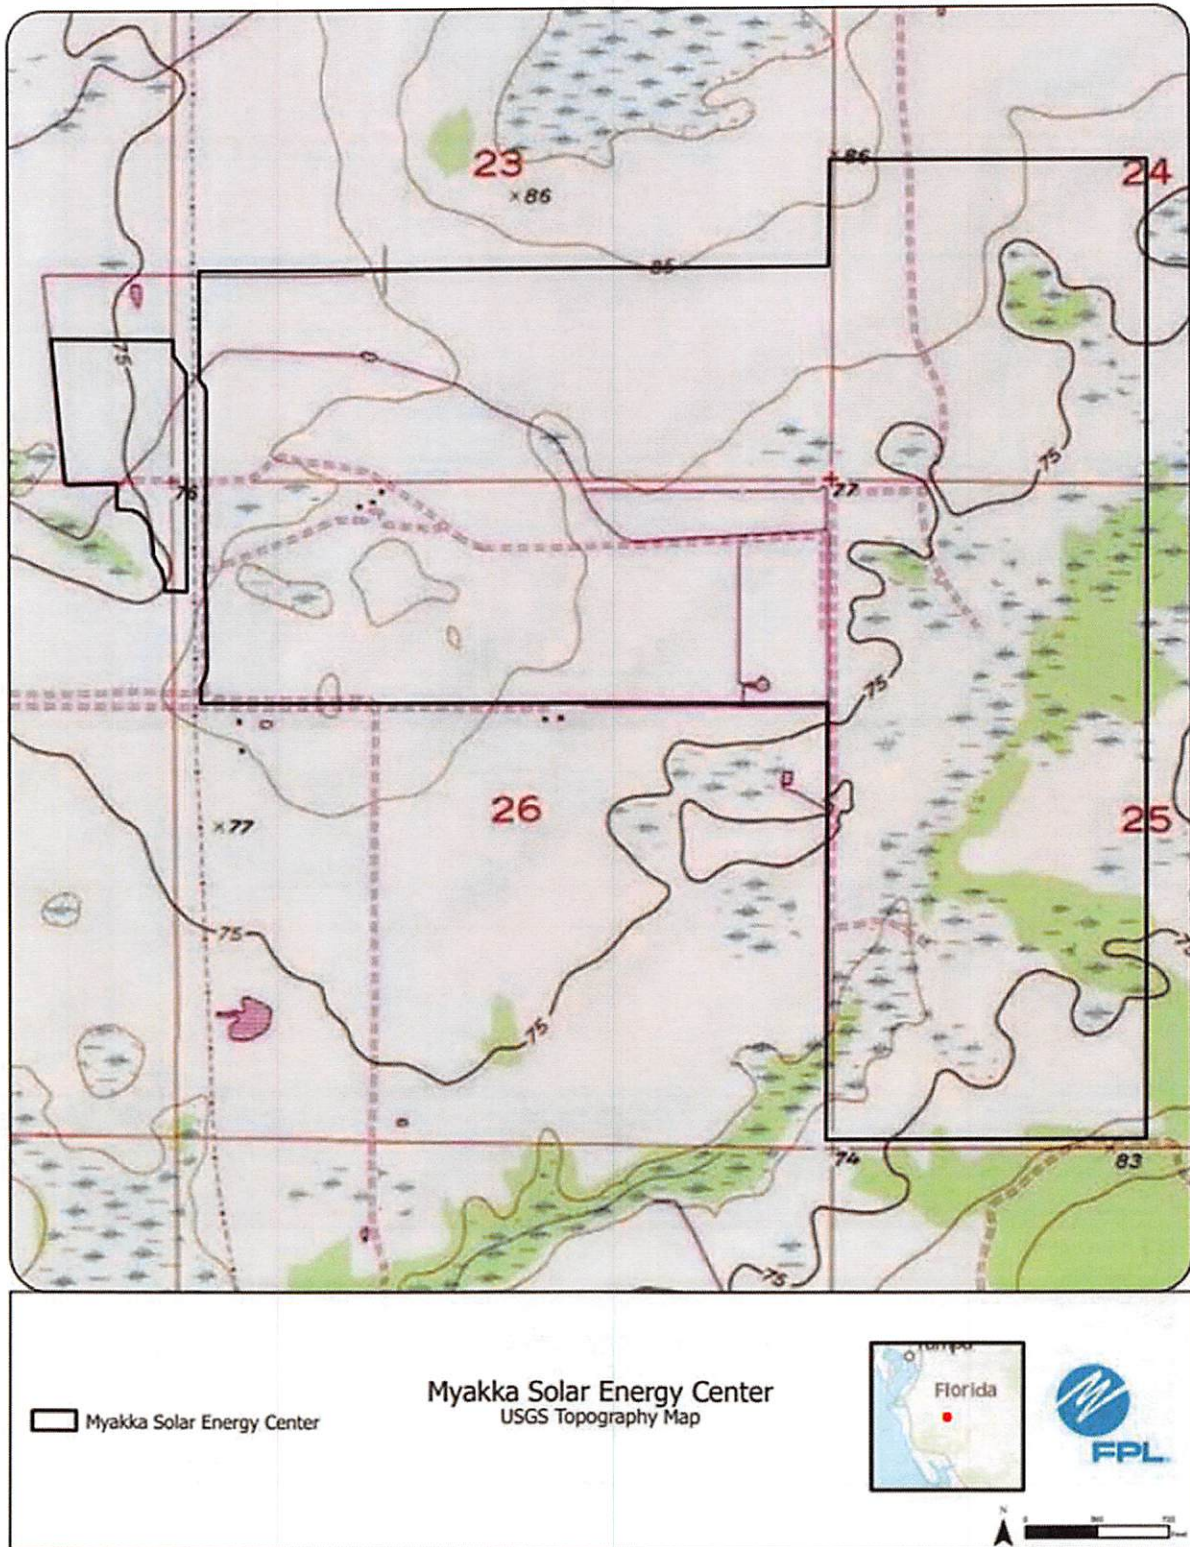



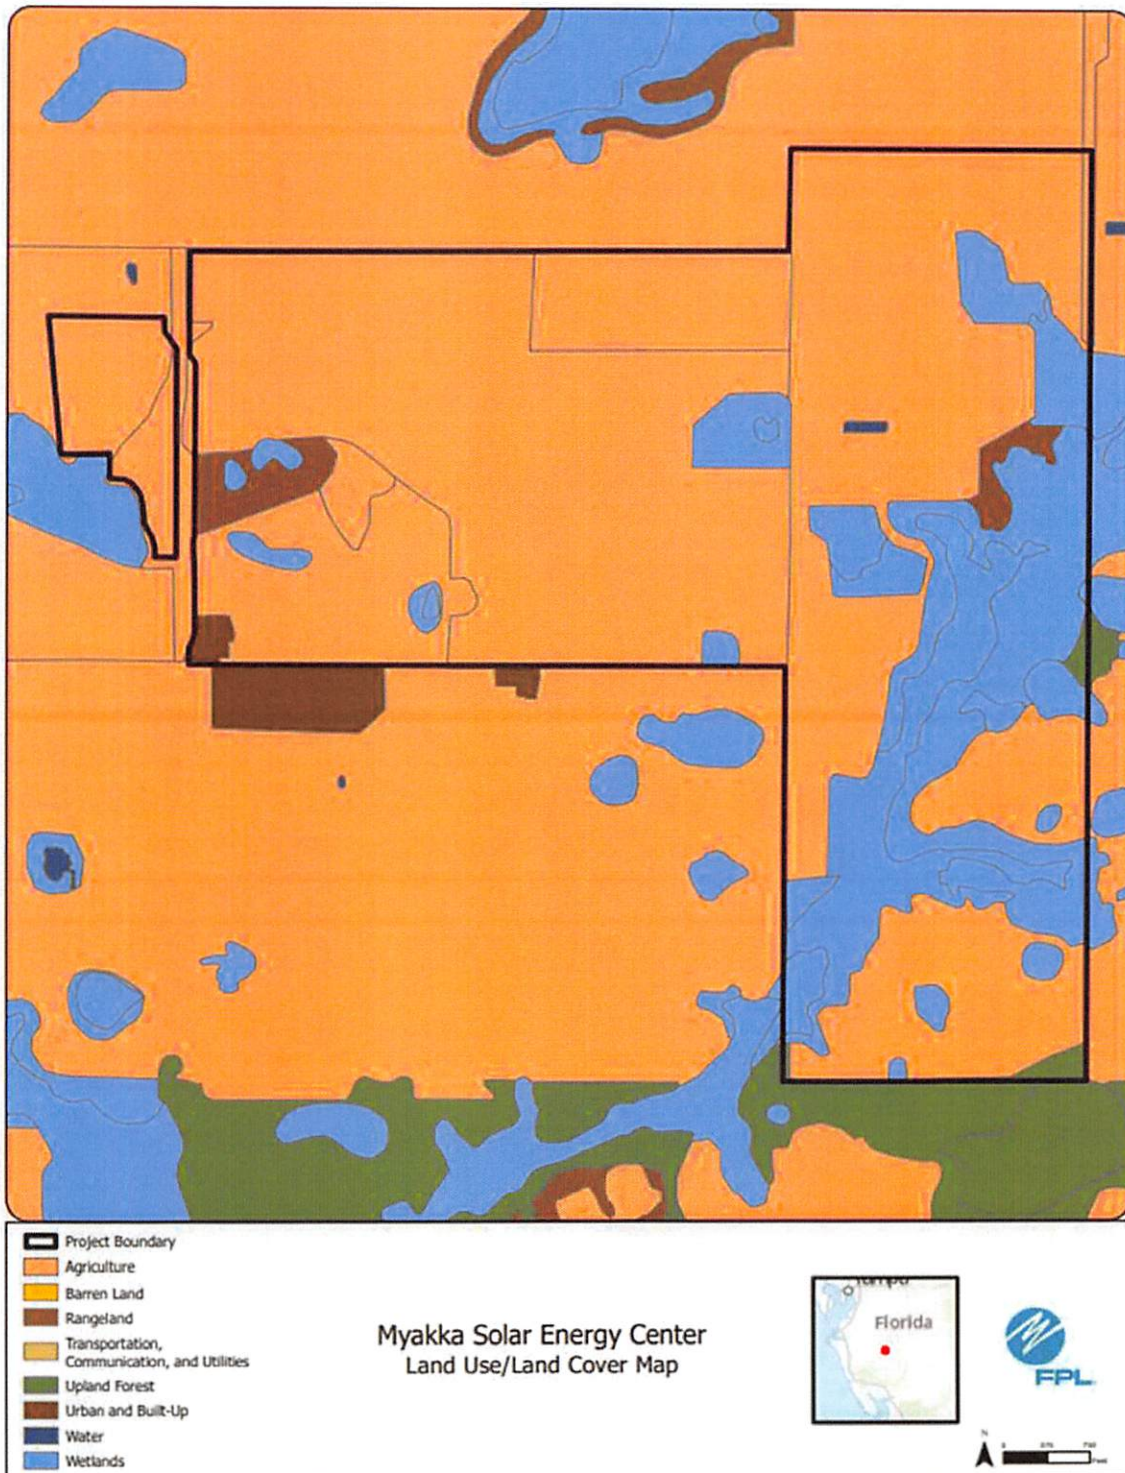



 Myakka Solar Energy Center

# Myakka Solar Energy Center Facility Layout Map





## **FPL Area Potential Site #10: Sand Gully Solar Energy Center**

This potential site in DeSoto County is under evaluation for future PV.

### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

### **b. Existing Land Uses of Site and Adjacent Areas**

Site is improved pasture with agricultural ditches. Surrounding area includes various agricultural activities, agricultural ditches, canals and wetlands.

### **c. Environmental Features**

Site is improved pasture with agricultural ditches. Listed species in the vicinity of the project include Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.


Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

### **e. Supply Sources**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.

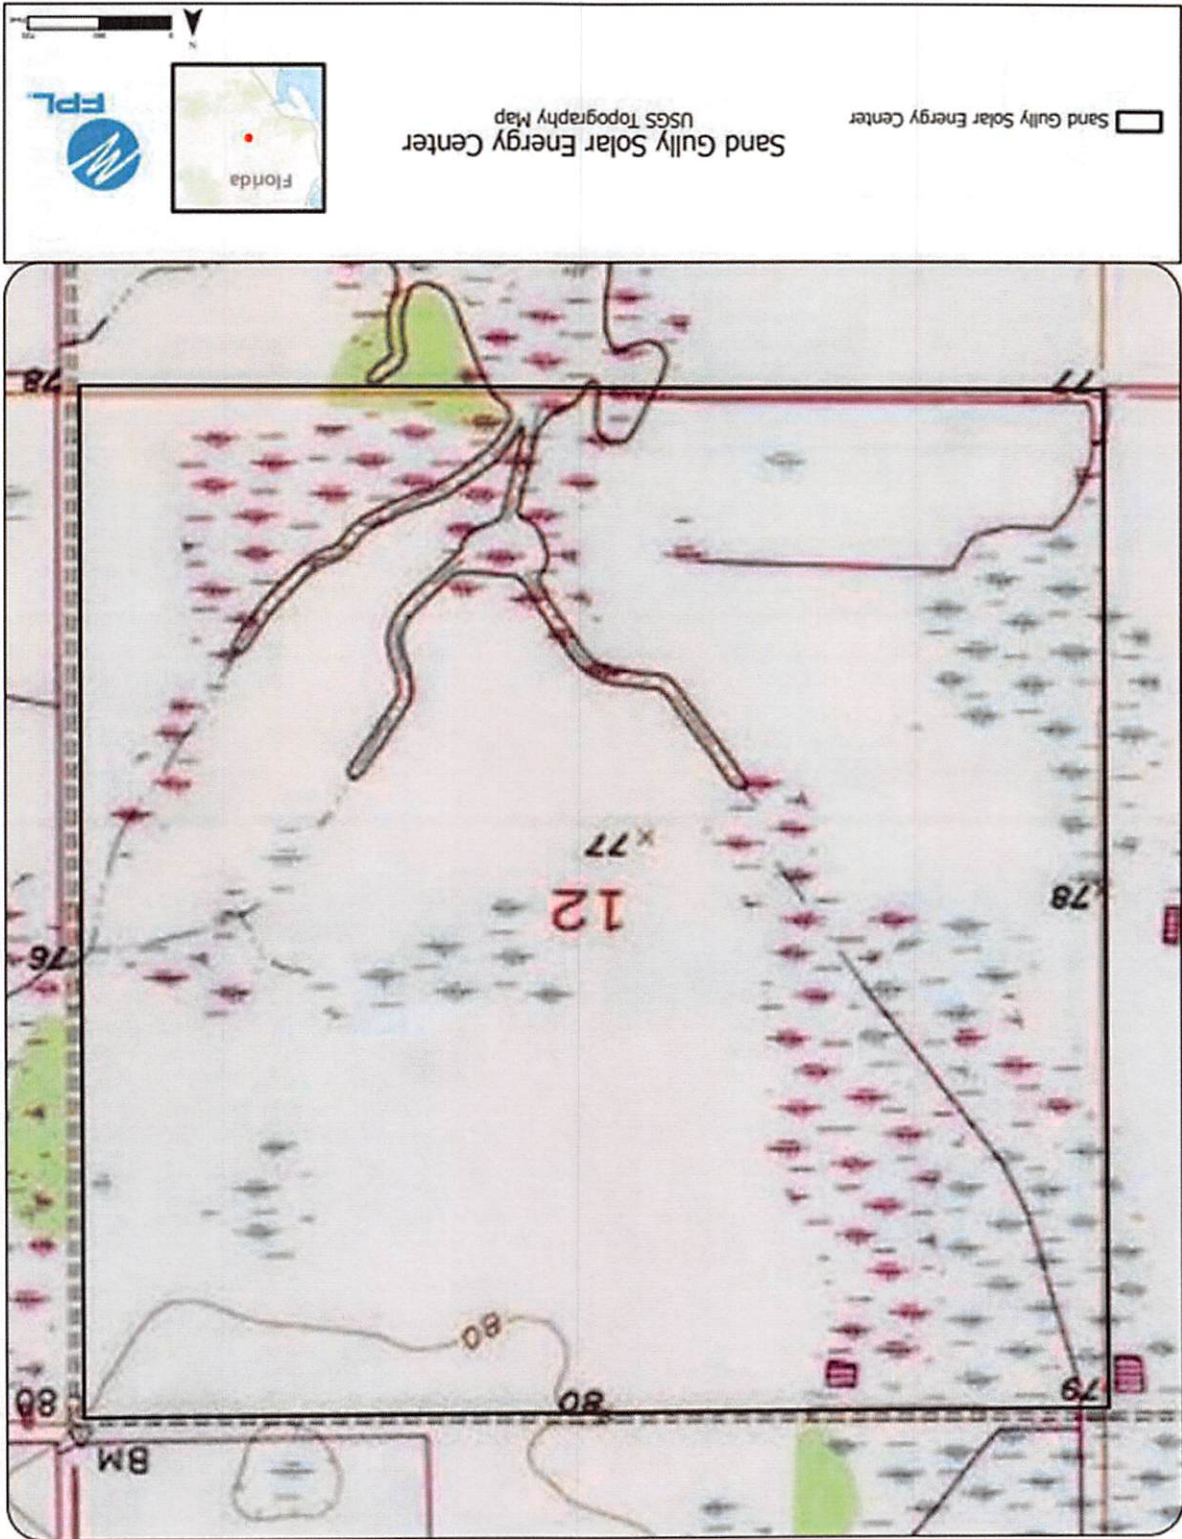







 Sand Gully Solar Energy Center

# Sand Gully Solar Energy Center Facility Layout Map



### **FPL Area Potential Site #11: Gum Creek Solar Energy Center**

This potential site in Jackson County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

Site is primarily silviculture and wetlands. Surrounding area includes agricultural lands, silviculture operations and residential properties.

#### **c. Environmental Features**

Site is primarily silviculture and wetlands. Listed species observed during the general wildlife survey were limited to gopher tortoise.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


#### **e. Supply Sources**

Cooling: Not Applicable for PV.


Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.




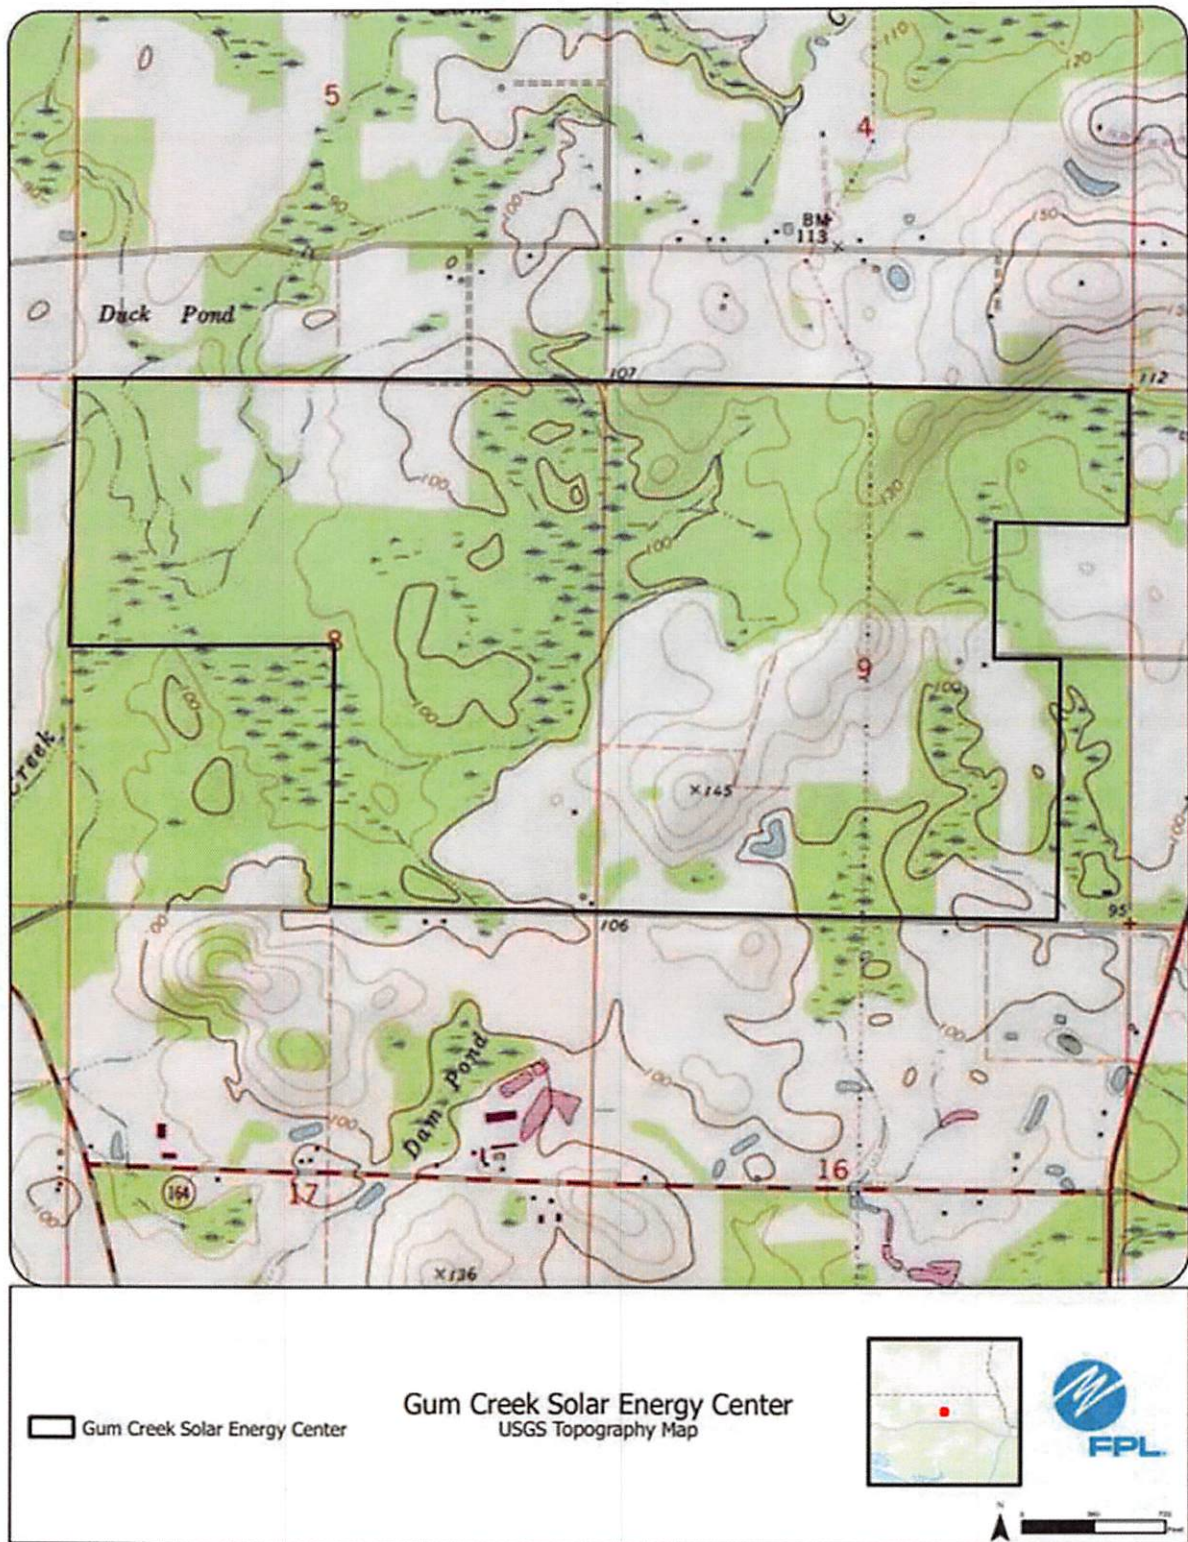



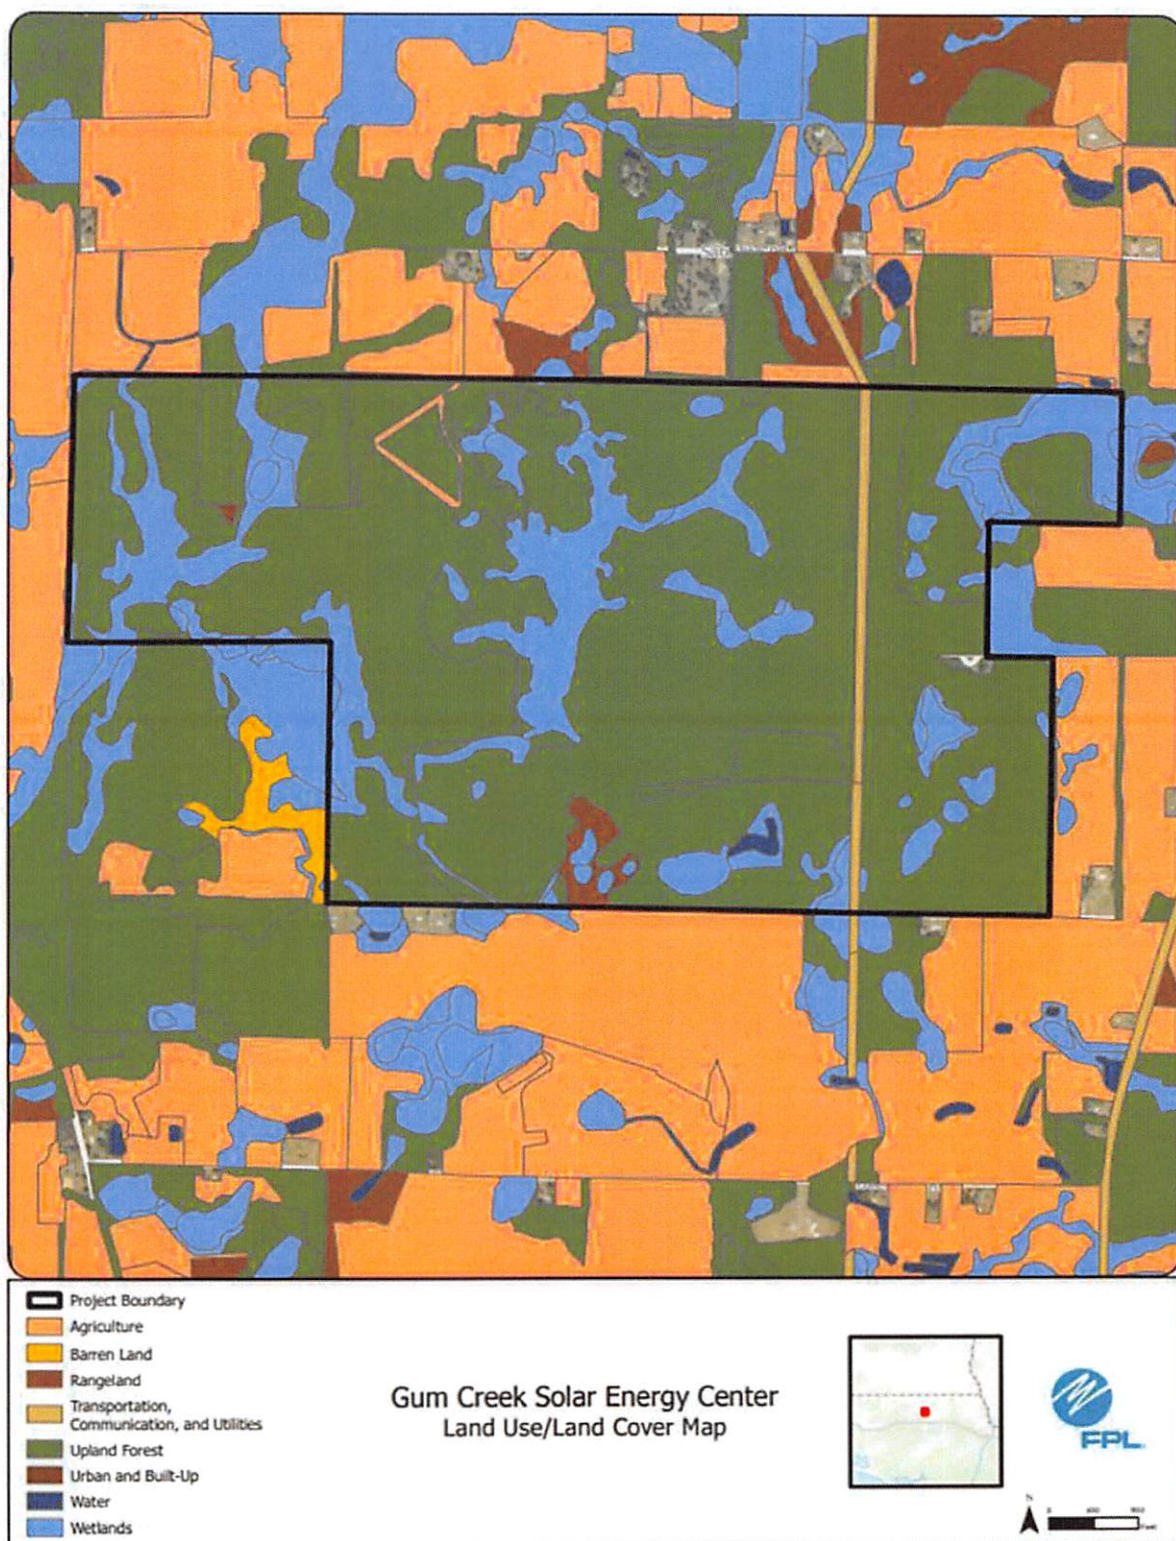




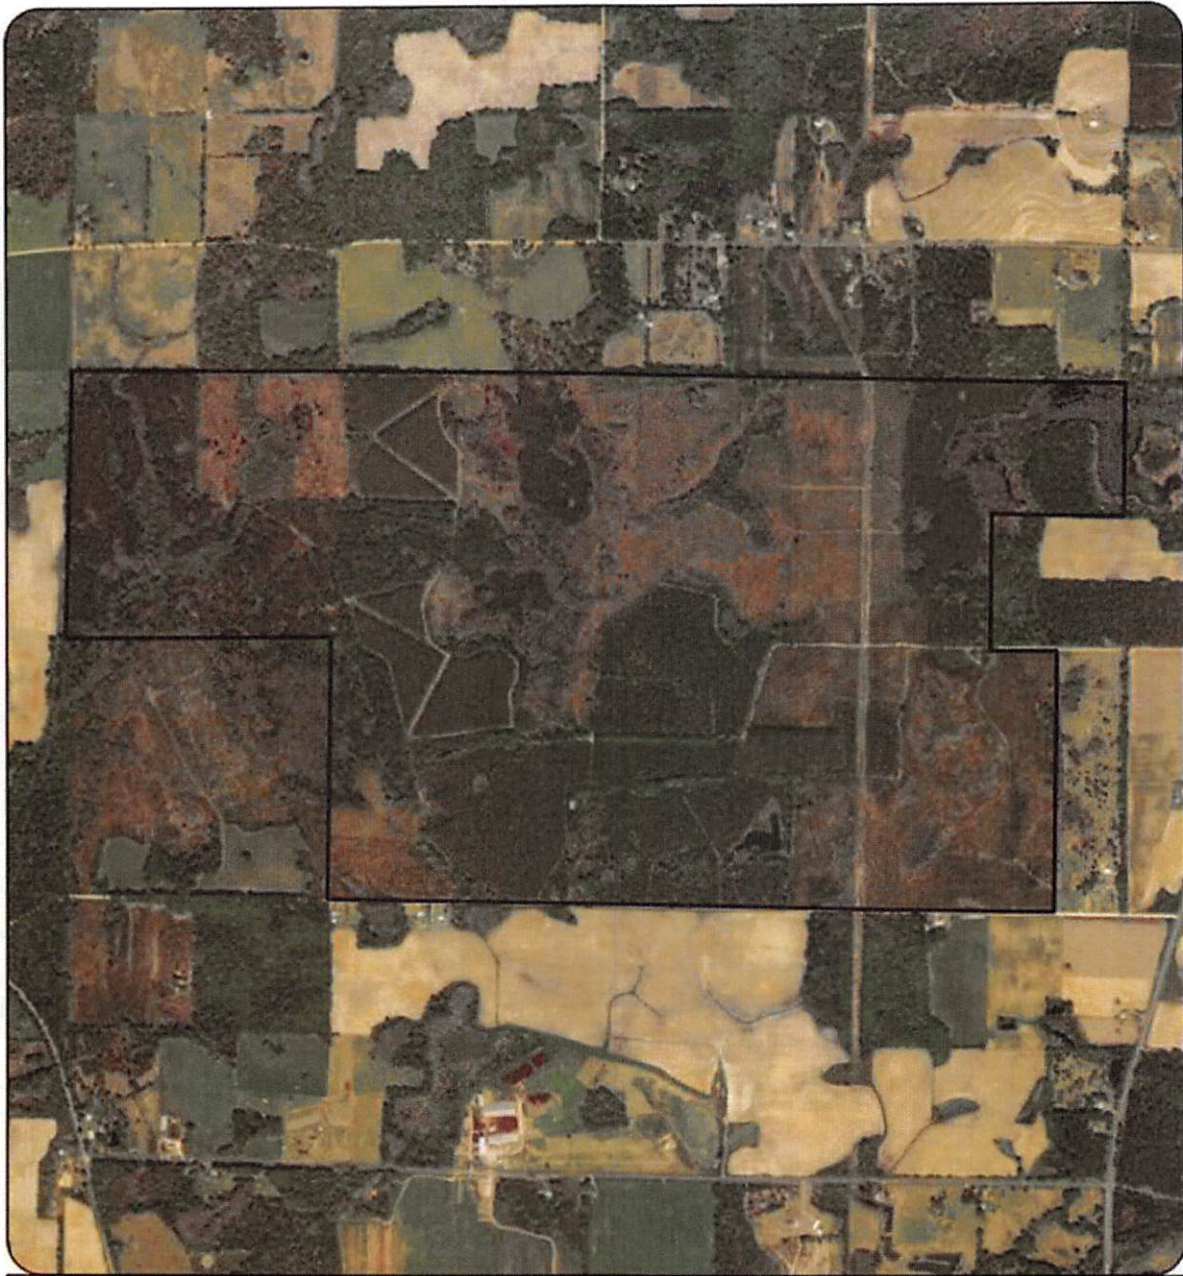

 Gum Creek Solar Energy Center

# Gum Creek Solar Energy Center Facility Layout Map



## **FPL Area Potential Site #12: Cardinal Solar Energy Center**

This potential site in Brevard County is under evaluation for future PV.

### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

### **b. Existing Land Uses of Site and Adjacent Areas**

Site and adjoining properties consist of agricultural lands, wetlands, and reservoirs.

### **c. Environmental Features**

Site is agricultural. An Audubon's crested caracara nest was identified approximately 2000 feet to the east on the adjoining property. No adverse impacts to listed species are anticipated.

### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


### **e. Supply Sources**


Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



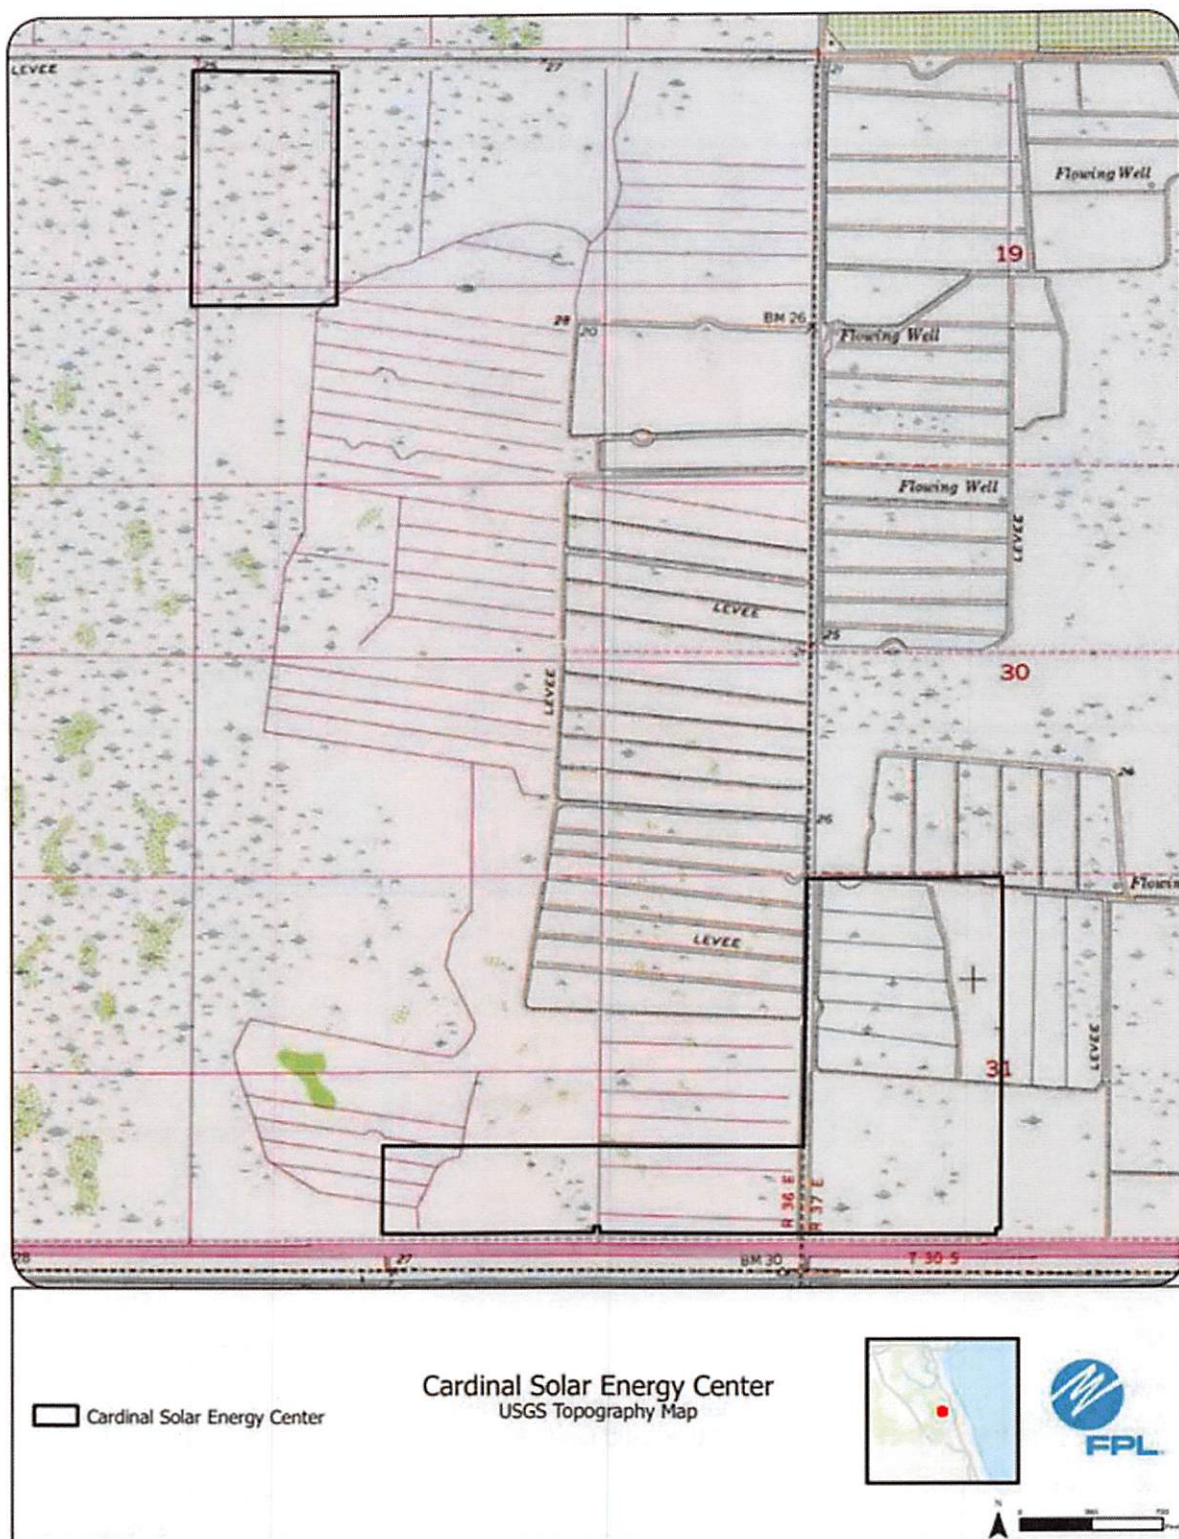

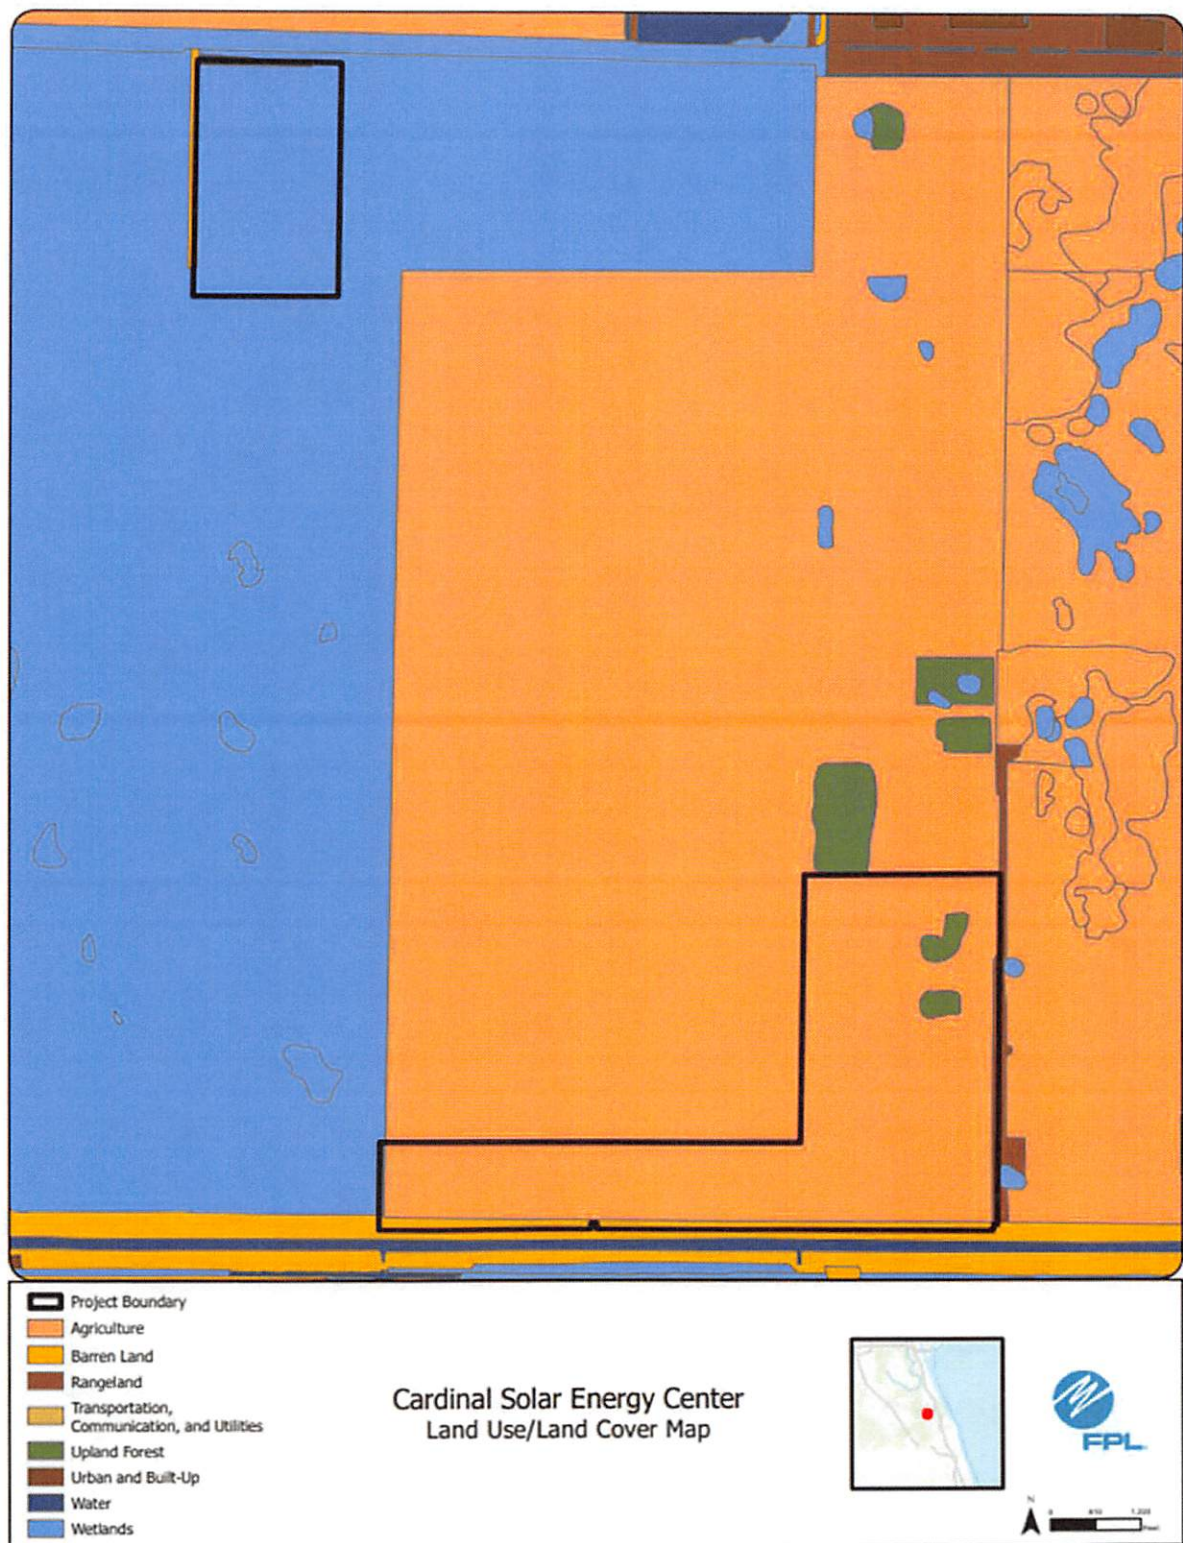





 Cardinal Solar Energy Center

# Cardinal Solar Energy Center Facility Layout Map





### **FPL Area Potential Site #13: Pine Lily Solar Energy Center**

This potential site in St. Lucie County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

Site is active citrus with agricultural ditches and natural wetlands. Adjacent properties include citrus, ditches, and wetlands.

#### **c. Environmental Features**

The site is dominated by active citrus groves with agricultural ditches and some natural wetlands. Listed species in the vicinity of the project include Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

#### **e. Supply Sources**


Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.





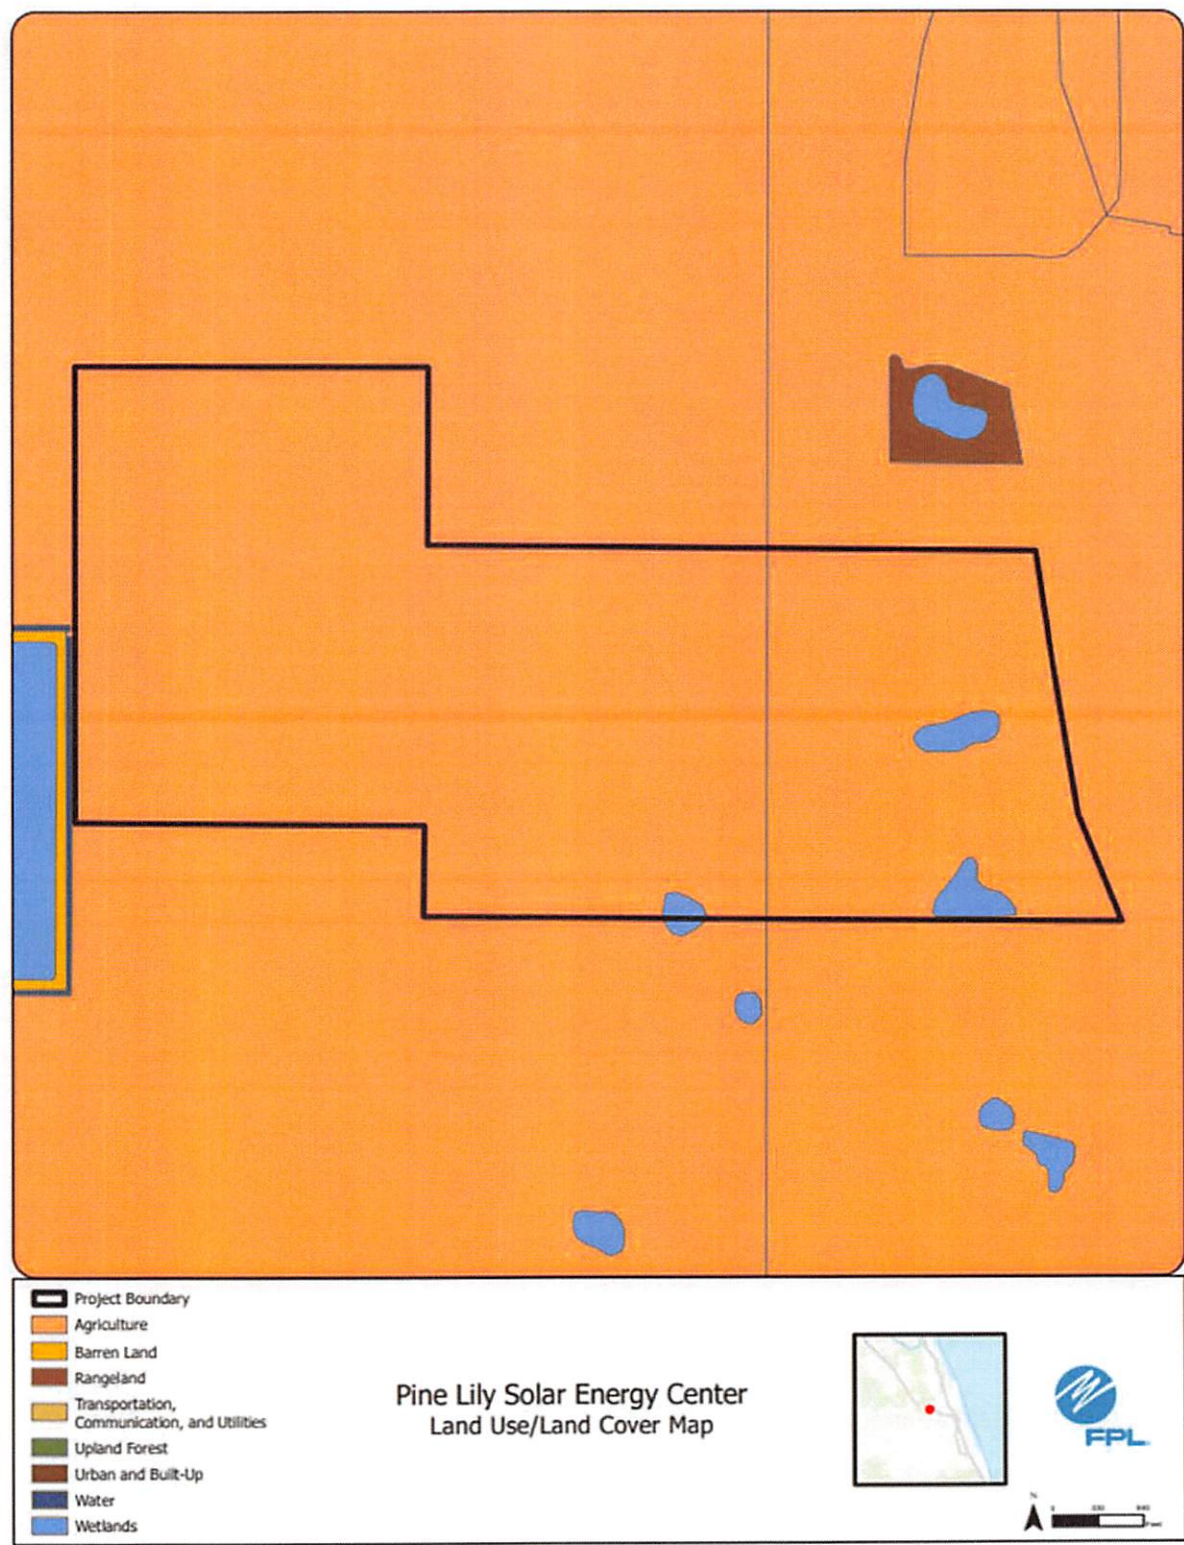





 Pine Lily Solar Energy Center

# Pine Lily Solar Energy Center Facility Layout Map



### **FPL Area Potential Site #14: Wild Lime Solar Energy Center**

This potential site in St. Lucie County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

Site is active citrus and improved pasture with agricultural ditches and natural wetlands. Adjacent properties include citrus, ditches, and wetlands.

#### **c. Environmental Features**

The site is dominated by active citrus groves, improved pasture, agricultural ditches and some natural wetlands. Listed species in the vicinity of the project include Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


#### **e. Supply Sources**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



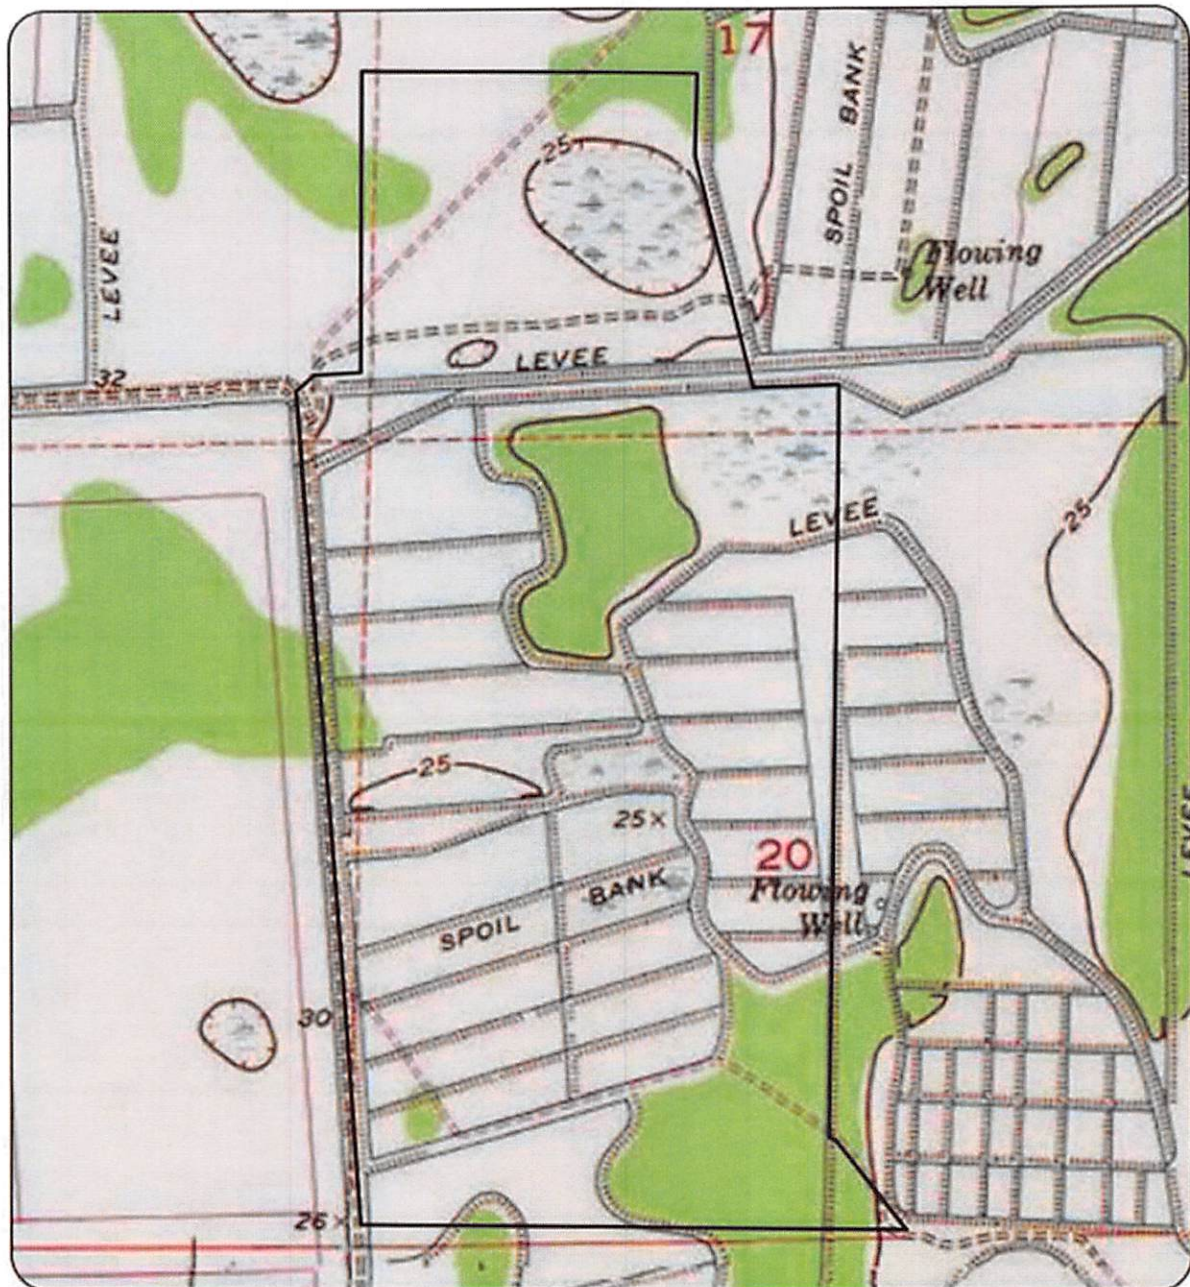


Wild Lime Solar Energy Center

Wild Lime Solar Energy Center  
USGS Topography Map





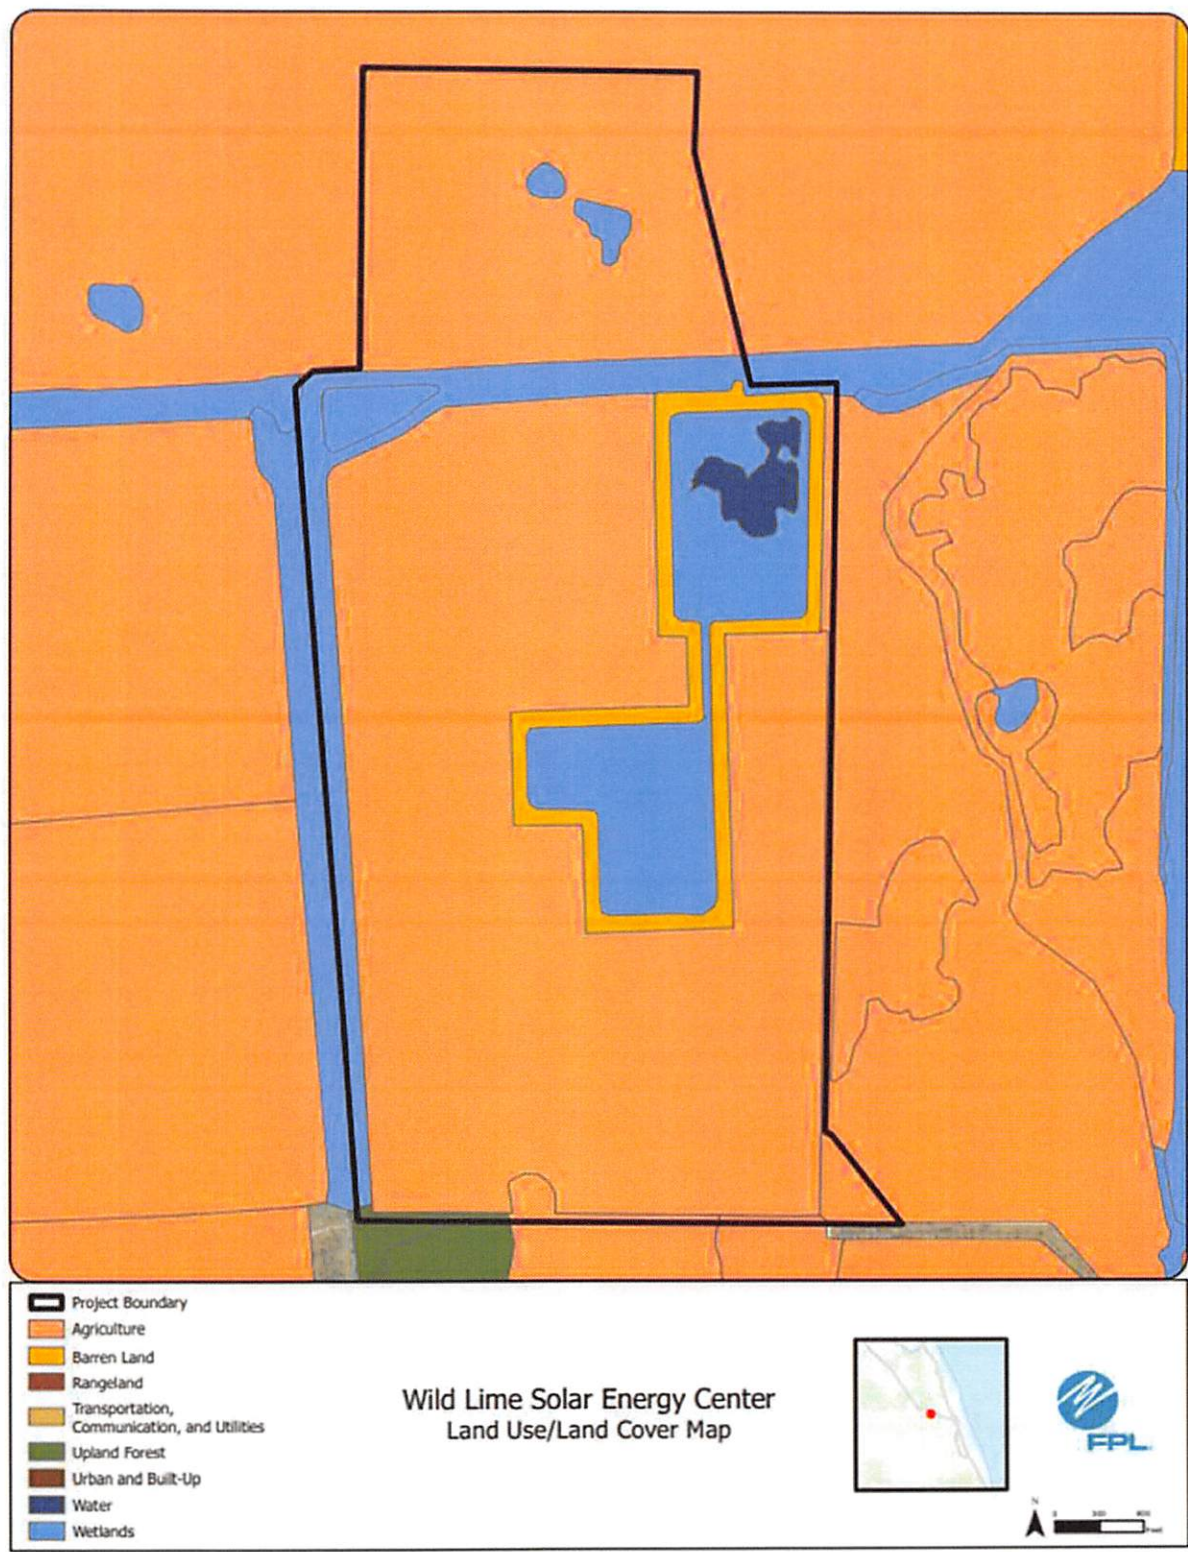





 Wild Lime Solar Energy Center

# Wild Lime Solar Energy Center Facility Layout Map



### **FPL Area Potential Site #15: Spoonbill Solar Energy Center**

This potential site in Collier County is under evaluation for future PV.

#### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

#### **b. Existing Land Uses of Site and Adjacent Areas**

The site and the surrounding area consist of various agricultural activities.

#### **c. Environmental Features**

Site is generally comprised of various agricultural areas and wetlands. Listed species in the vicinity of the project include the Audubon's crested caracara, Florida panther and gopher tortoise. No adverse impacts to listed species are anticipated. Corkscrew Swamp is located approximately 3,000 feet to the west.

#### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


#### **e. Supply Sources**

Cooling: Not Applicable for PV.


Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.







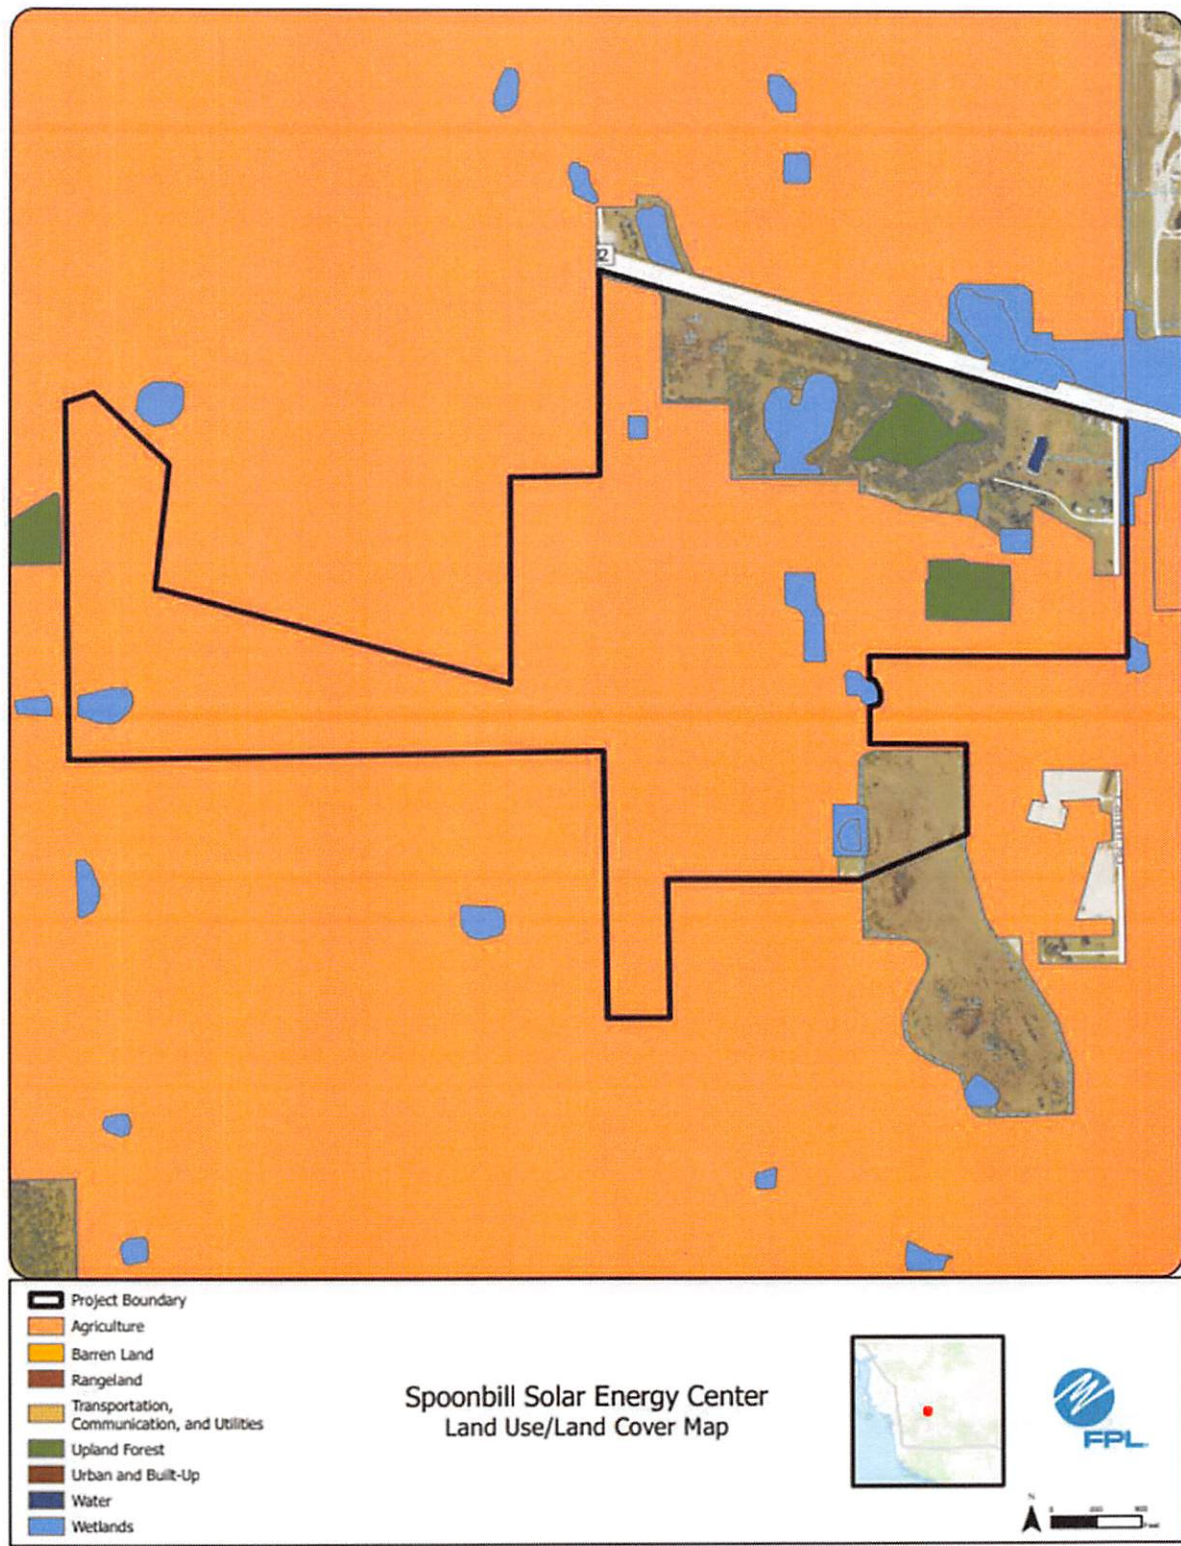






 Spoonbill Solar Energy Center

# Spoonbill Solar Energy Center Facility Layout Map



## **FPL Area Potential Site #16: Shell Creek Solar Energy Center**

This potential site in Charlotte and DeSoto Counties is under evaluation for future PV.

### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

### **b. Existing Land Uses of Site and Adjacent Areas**

The site and the surrounding area consist of various agricultural areas, pasture, and wetlands.

### **c. Environmental Features**

Site is generally comprised of various agricultural areas. Listed species in the vicinity of the project include Audubon's crested caracara and gopher tortoise. No adverse impacts to listed species are anticipated.

### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


### **e. Supply Sources**

Cooling: Not Applicable for PV.


Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



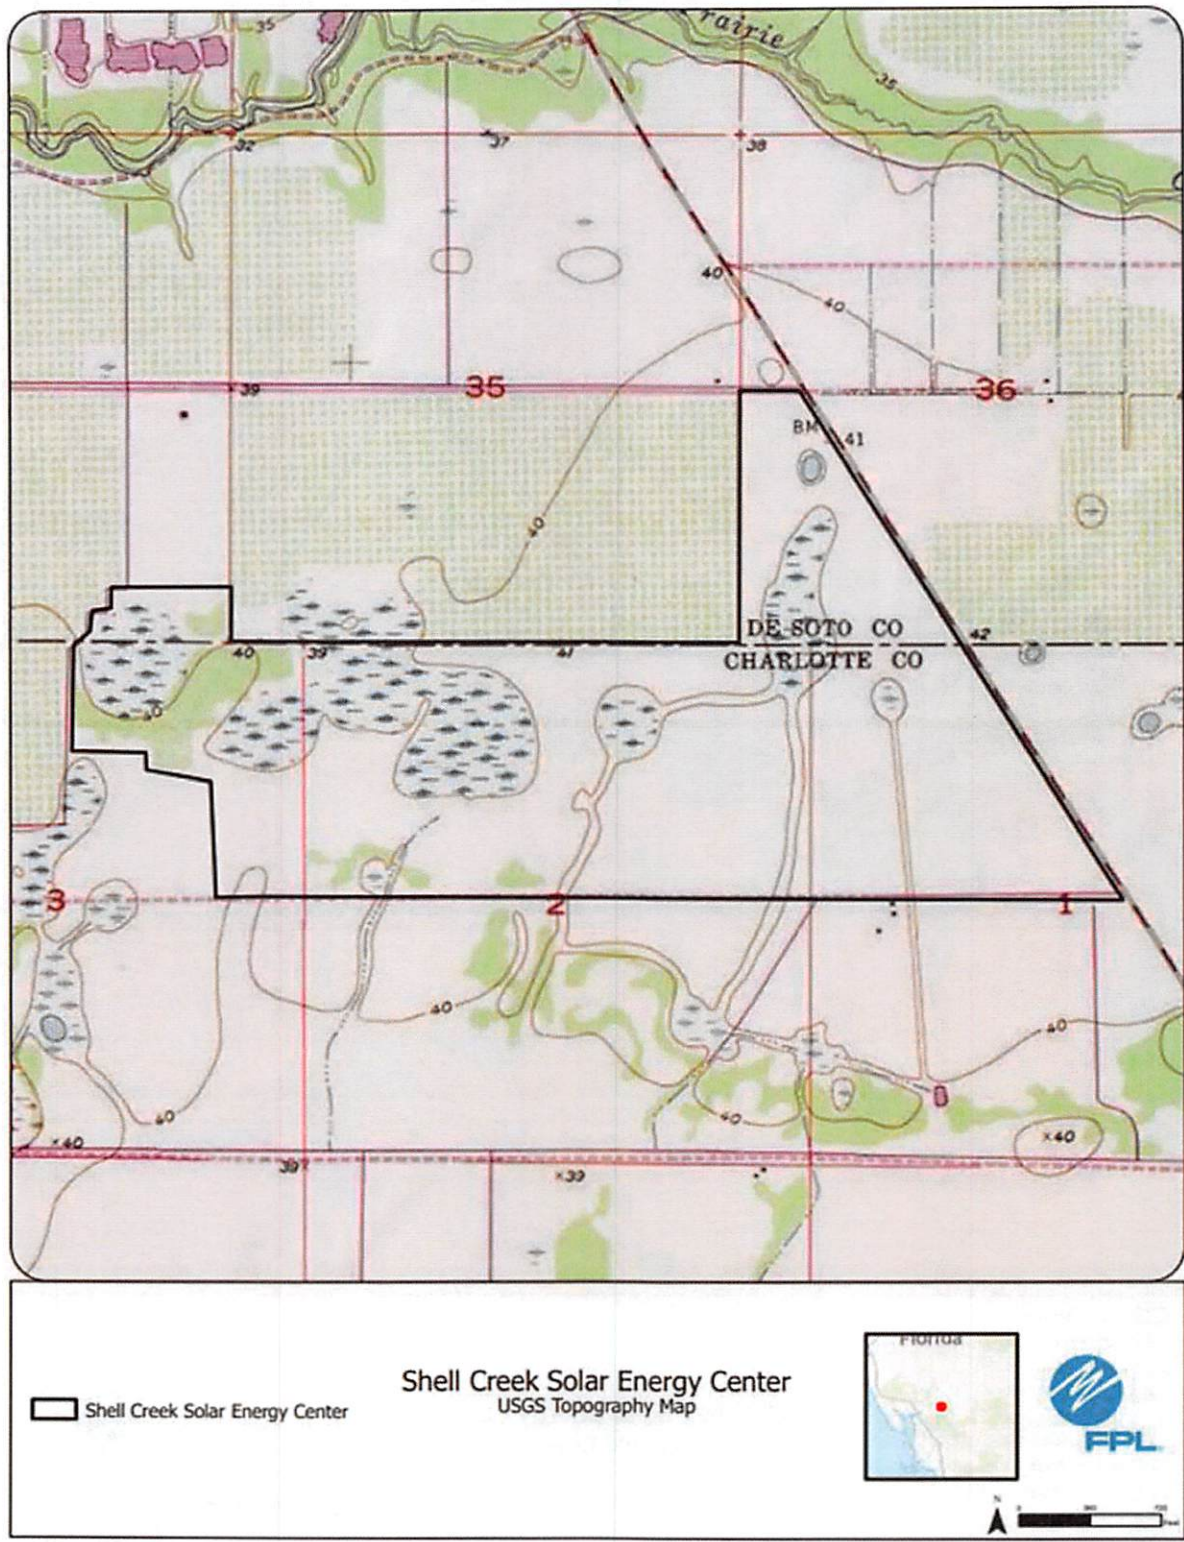




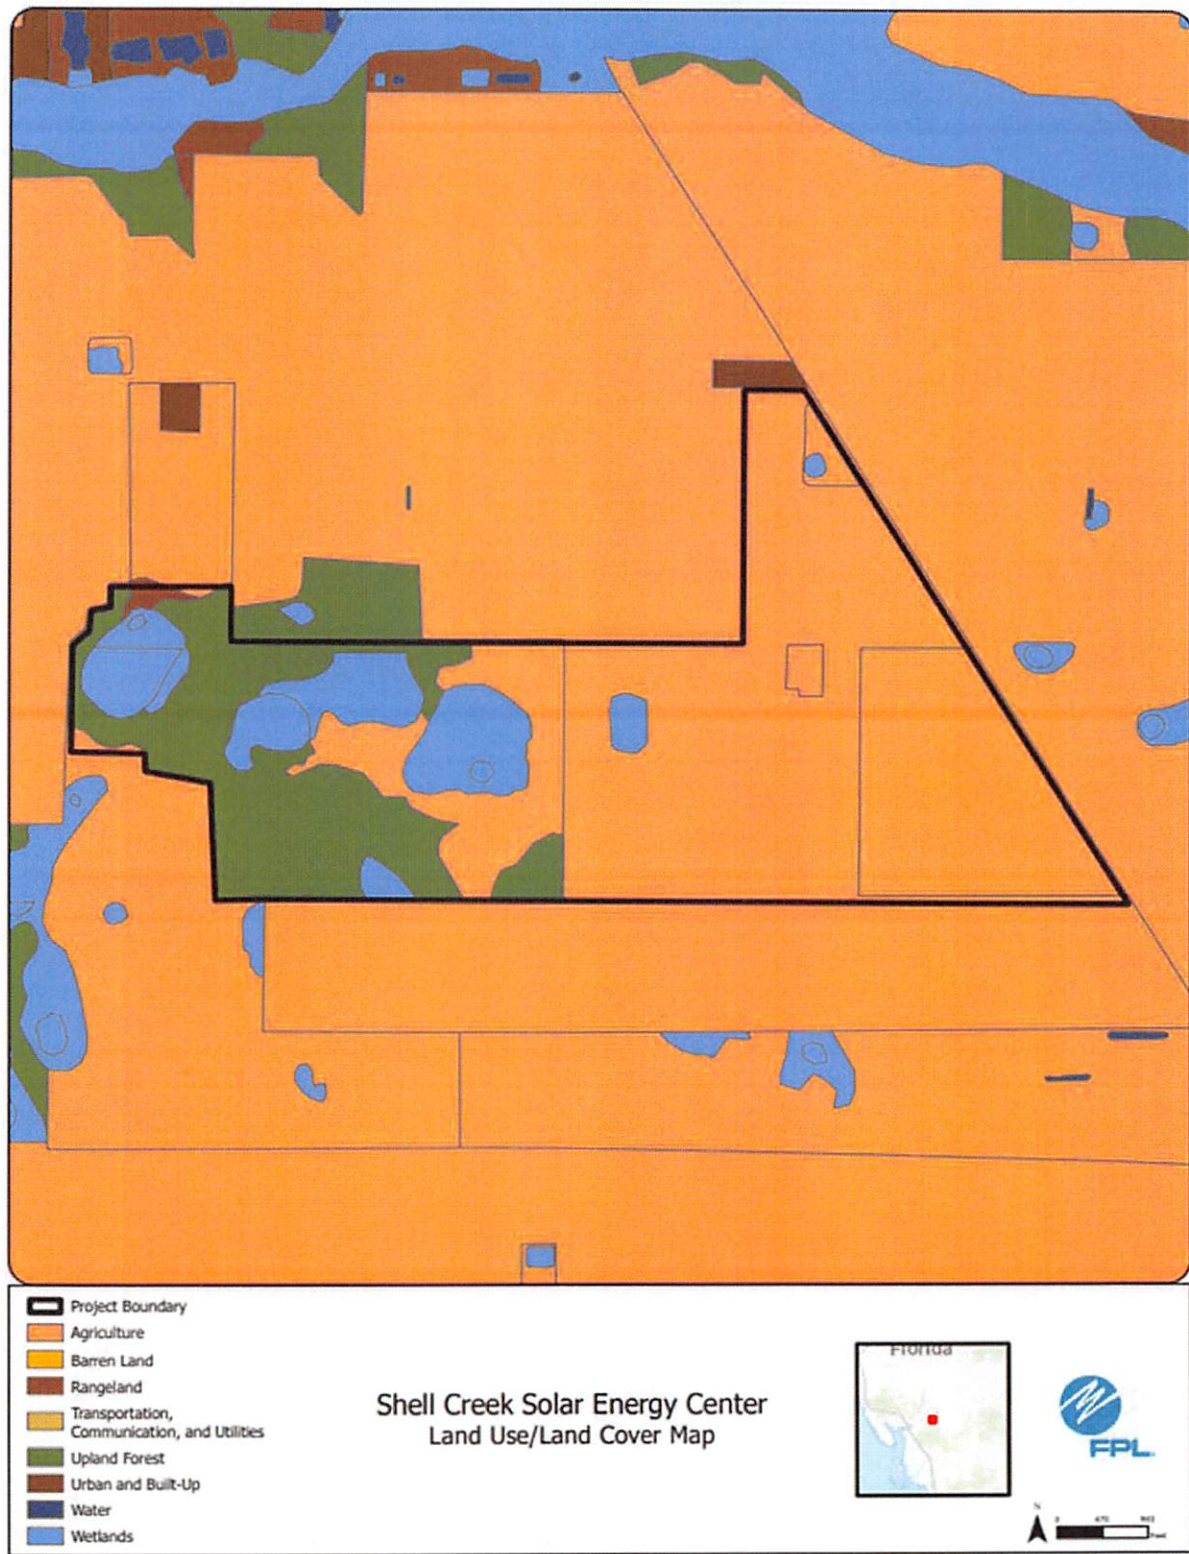





 Shell Creek Solar Energy Center

# Shell Creek Solar Energy Center Facility Layout Map





## **FPL Area Potential Site #17: Carlton Solar Energy Center**

This potential site in St. Lucie County is under evaluation for future PV.

### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

### **b. Existing Land Uses of Site and Adjacent Areas**

Site is improved pasture with agricultural ditches. Surrounding area is used for various agricultural purposes.

### **c. Environmental Features**

Site is improved pasture surrounded by agricultural ditches. The County Line Canal is west of the property. Listed species in the vicinity of the project include Audubon's crested caracara and wading birds. No adverse impacts to listed species are anticipated.

### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.


Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.

### **e. Supply Sources**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.

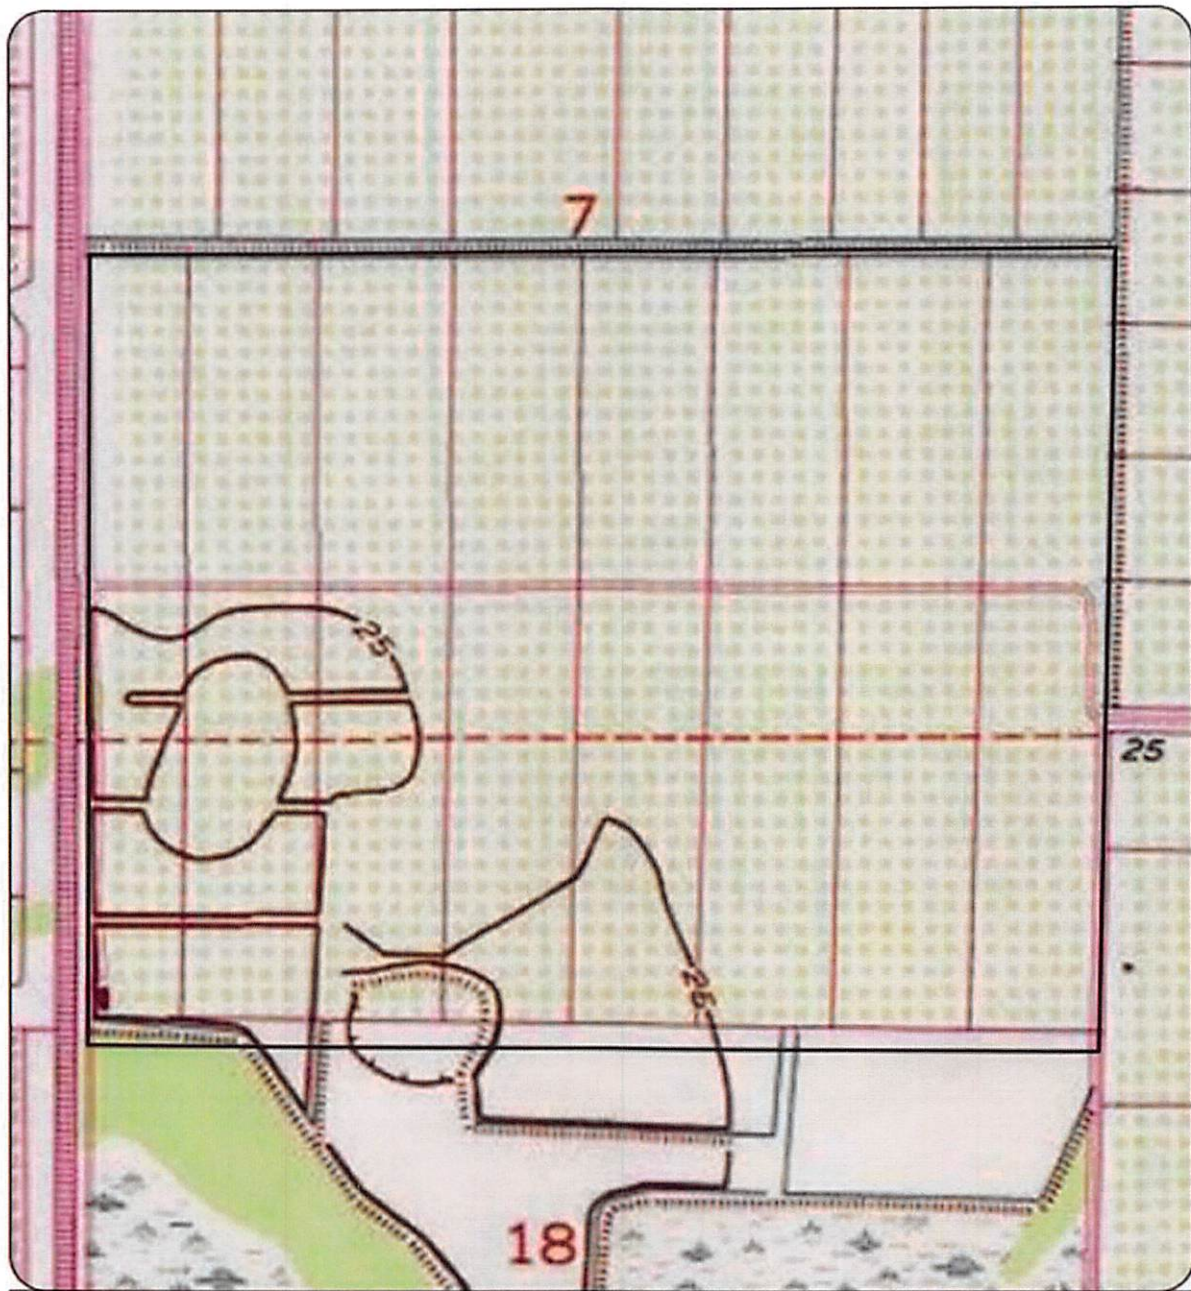



 Carlton Solar Energy Center

Carlton Solar Energy Center  
 USGS Topography Map





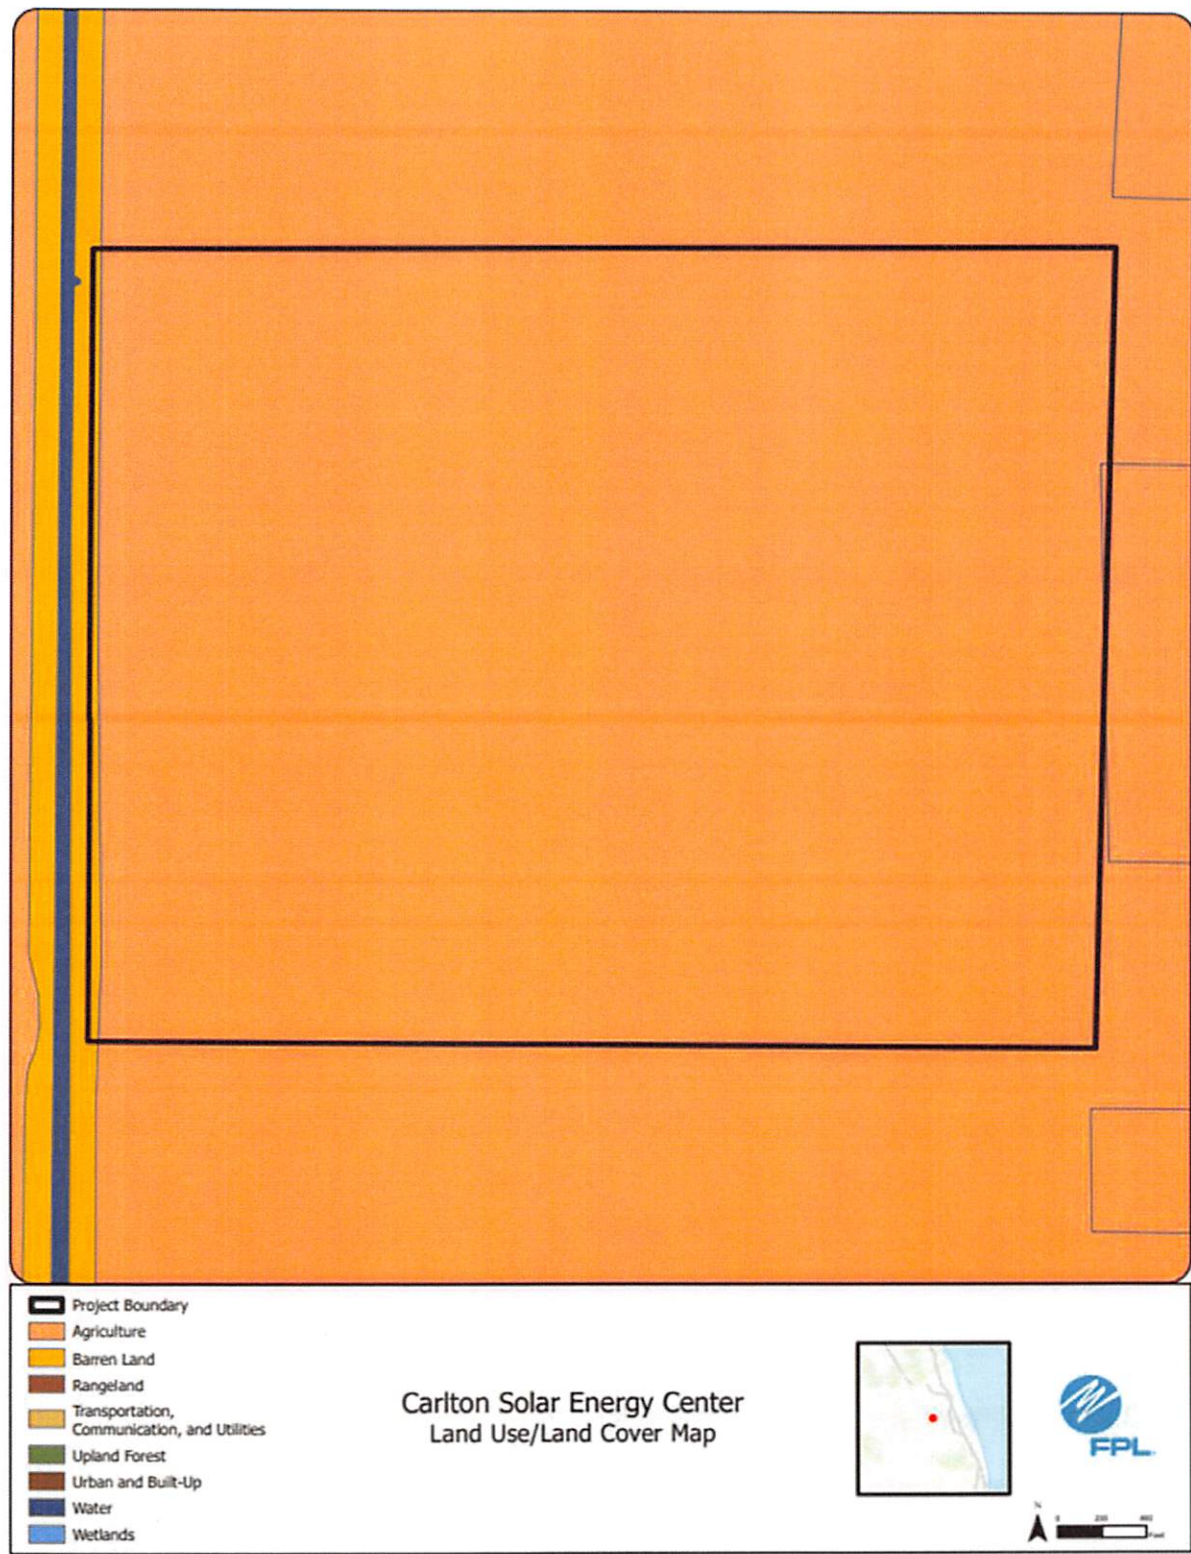

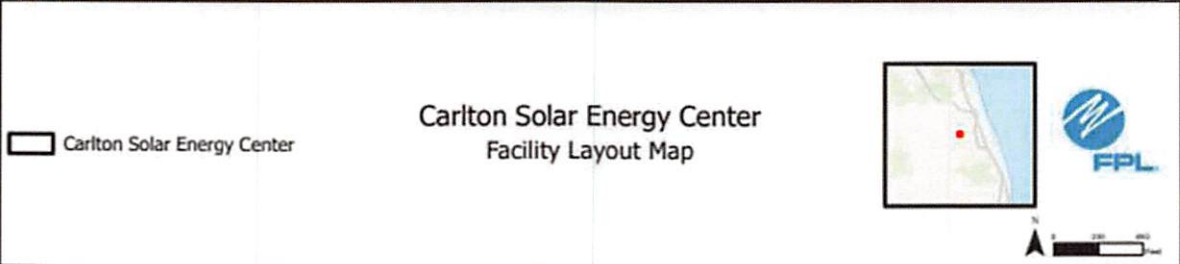



## **FPL Area Potential Site #18: Owen Branch Solar Energy Center**

This potential site in Manatee County is under evaluation for future PV.

### **a. U.S. Geological Survey (USGS) Map**

See Figures on subsequent pages.

### **b. Existing Land Uses of Site and Adjacent Areas**

Site was former citrus with open fields with an adjacent wetland system. Surrounding area is primarily agricultural land and low-density residential area.

### **c. Environmental Features**

Maple Creek is in the vicinity of the site. Listed species expected in the vicinity of the site include Audubon's crested caracara, gopher tortoise and wading birds. No adverse impacts to listed species are anticipated.

### **d. Water Quantities Required**

Cooling: Not Applicable for PV.

Process: Not Applicable for PV.

Potable: Minimal.

Panel Cleaning: Minimal for PV and only needed in the absence of sufficient rainfall.


### **e. Supply Sources**

Cooling: Not Applicable for PV.


Process: Not Applicable for PV.

Potable and Panel Cleaning: Onsite well or surface water or delivered to site.



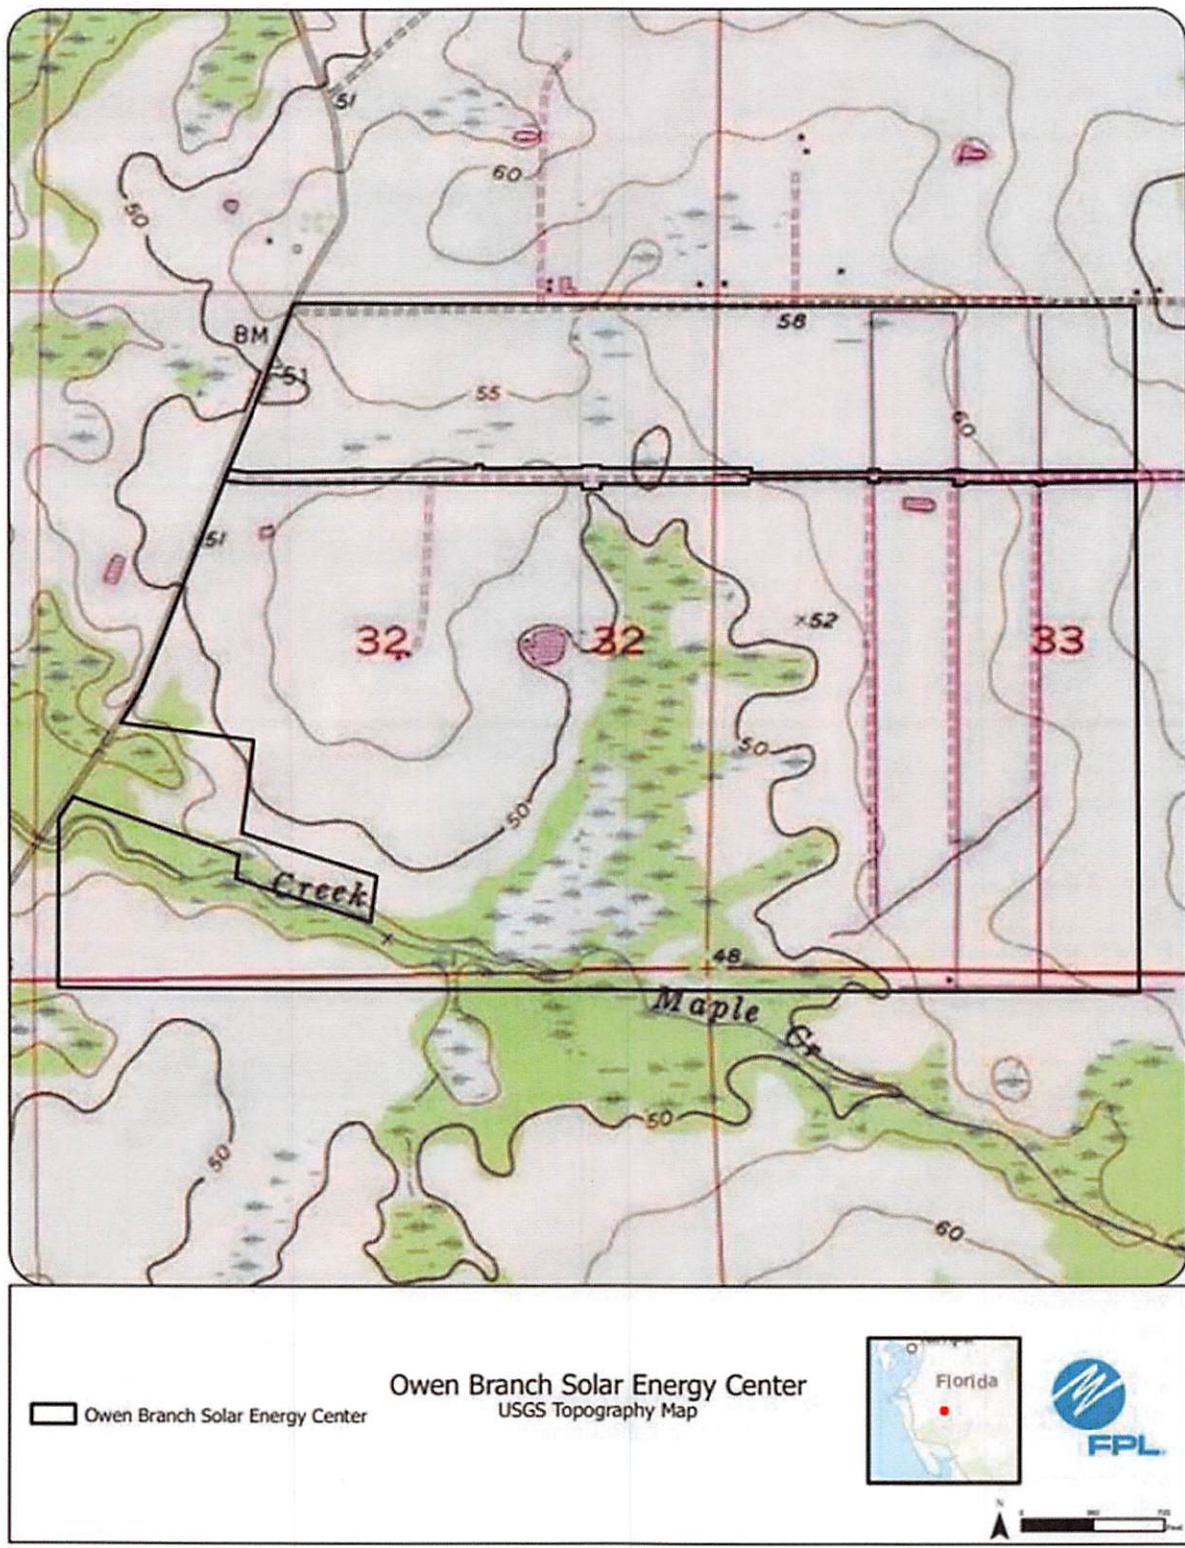



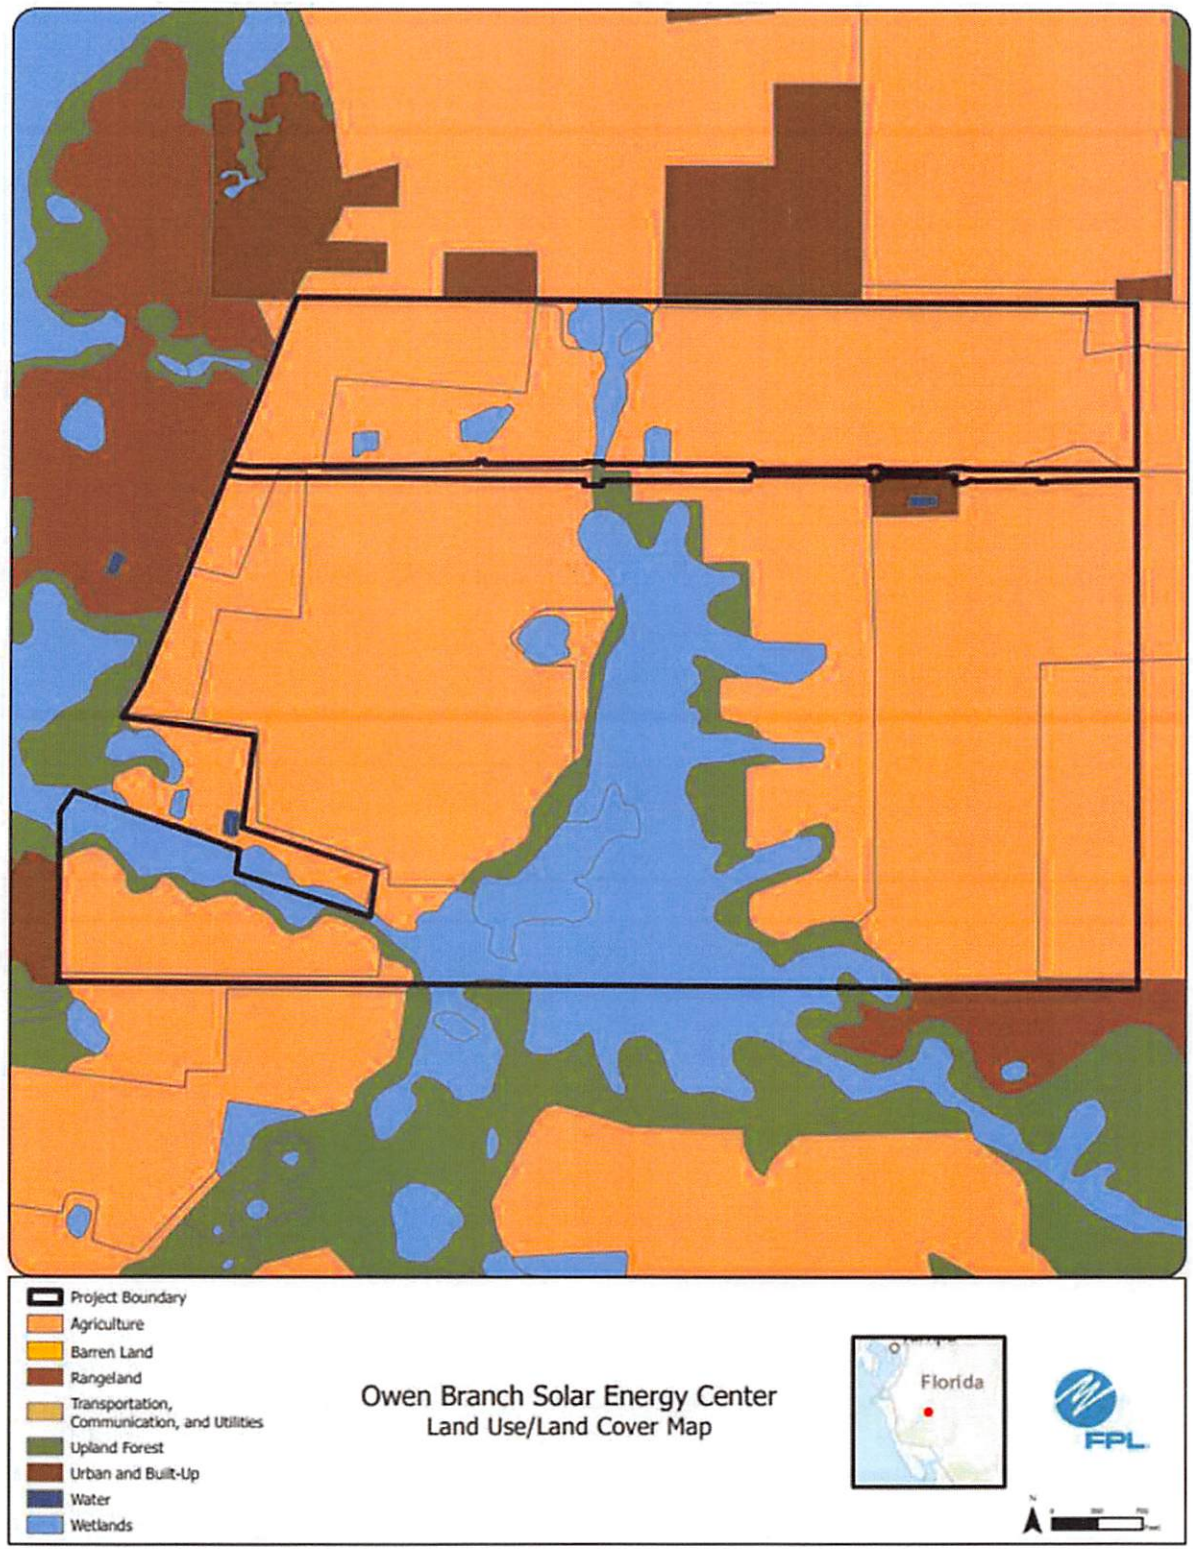





 Owen Branch Solar Energy Center

Owen Branch Solar Energy Center  
Facility Layout Map

